


10" FOUNDATION WALL ON 22"x6" THICK CONC. FTG UNDER ALL 2"x6" KNEEWALL AS REQ'D BY GRADING - SEE DETAILS
MAX BACKFILL HEIGHT: 4'-7" FOR 10" FNDN. WALL W/ KNEEWALL ON TOP

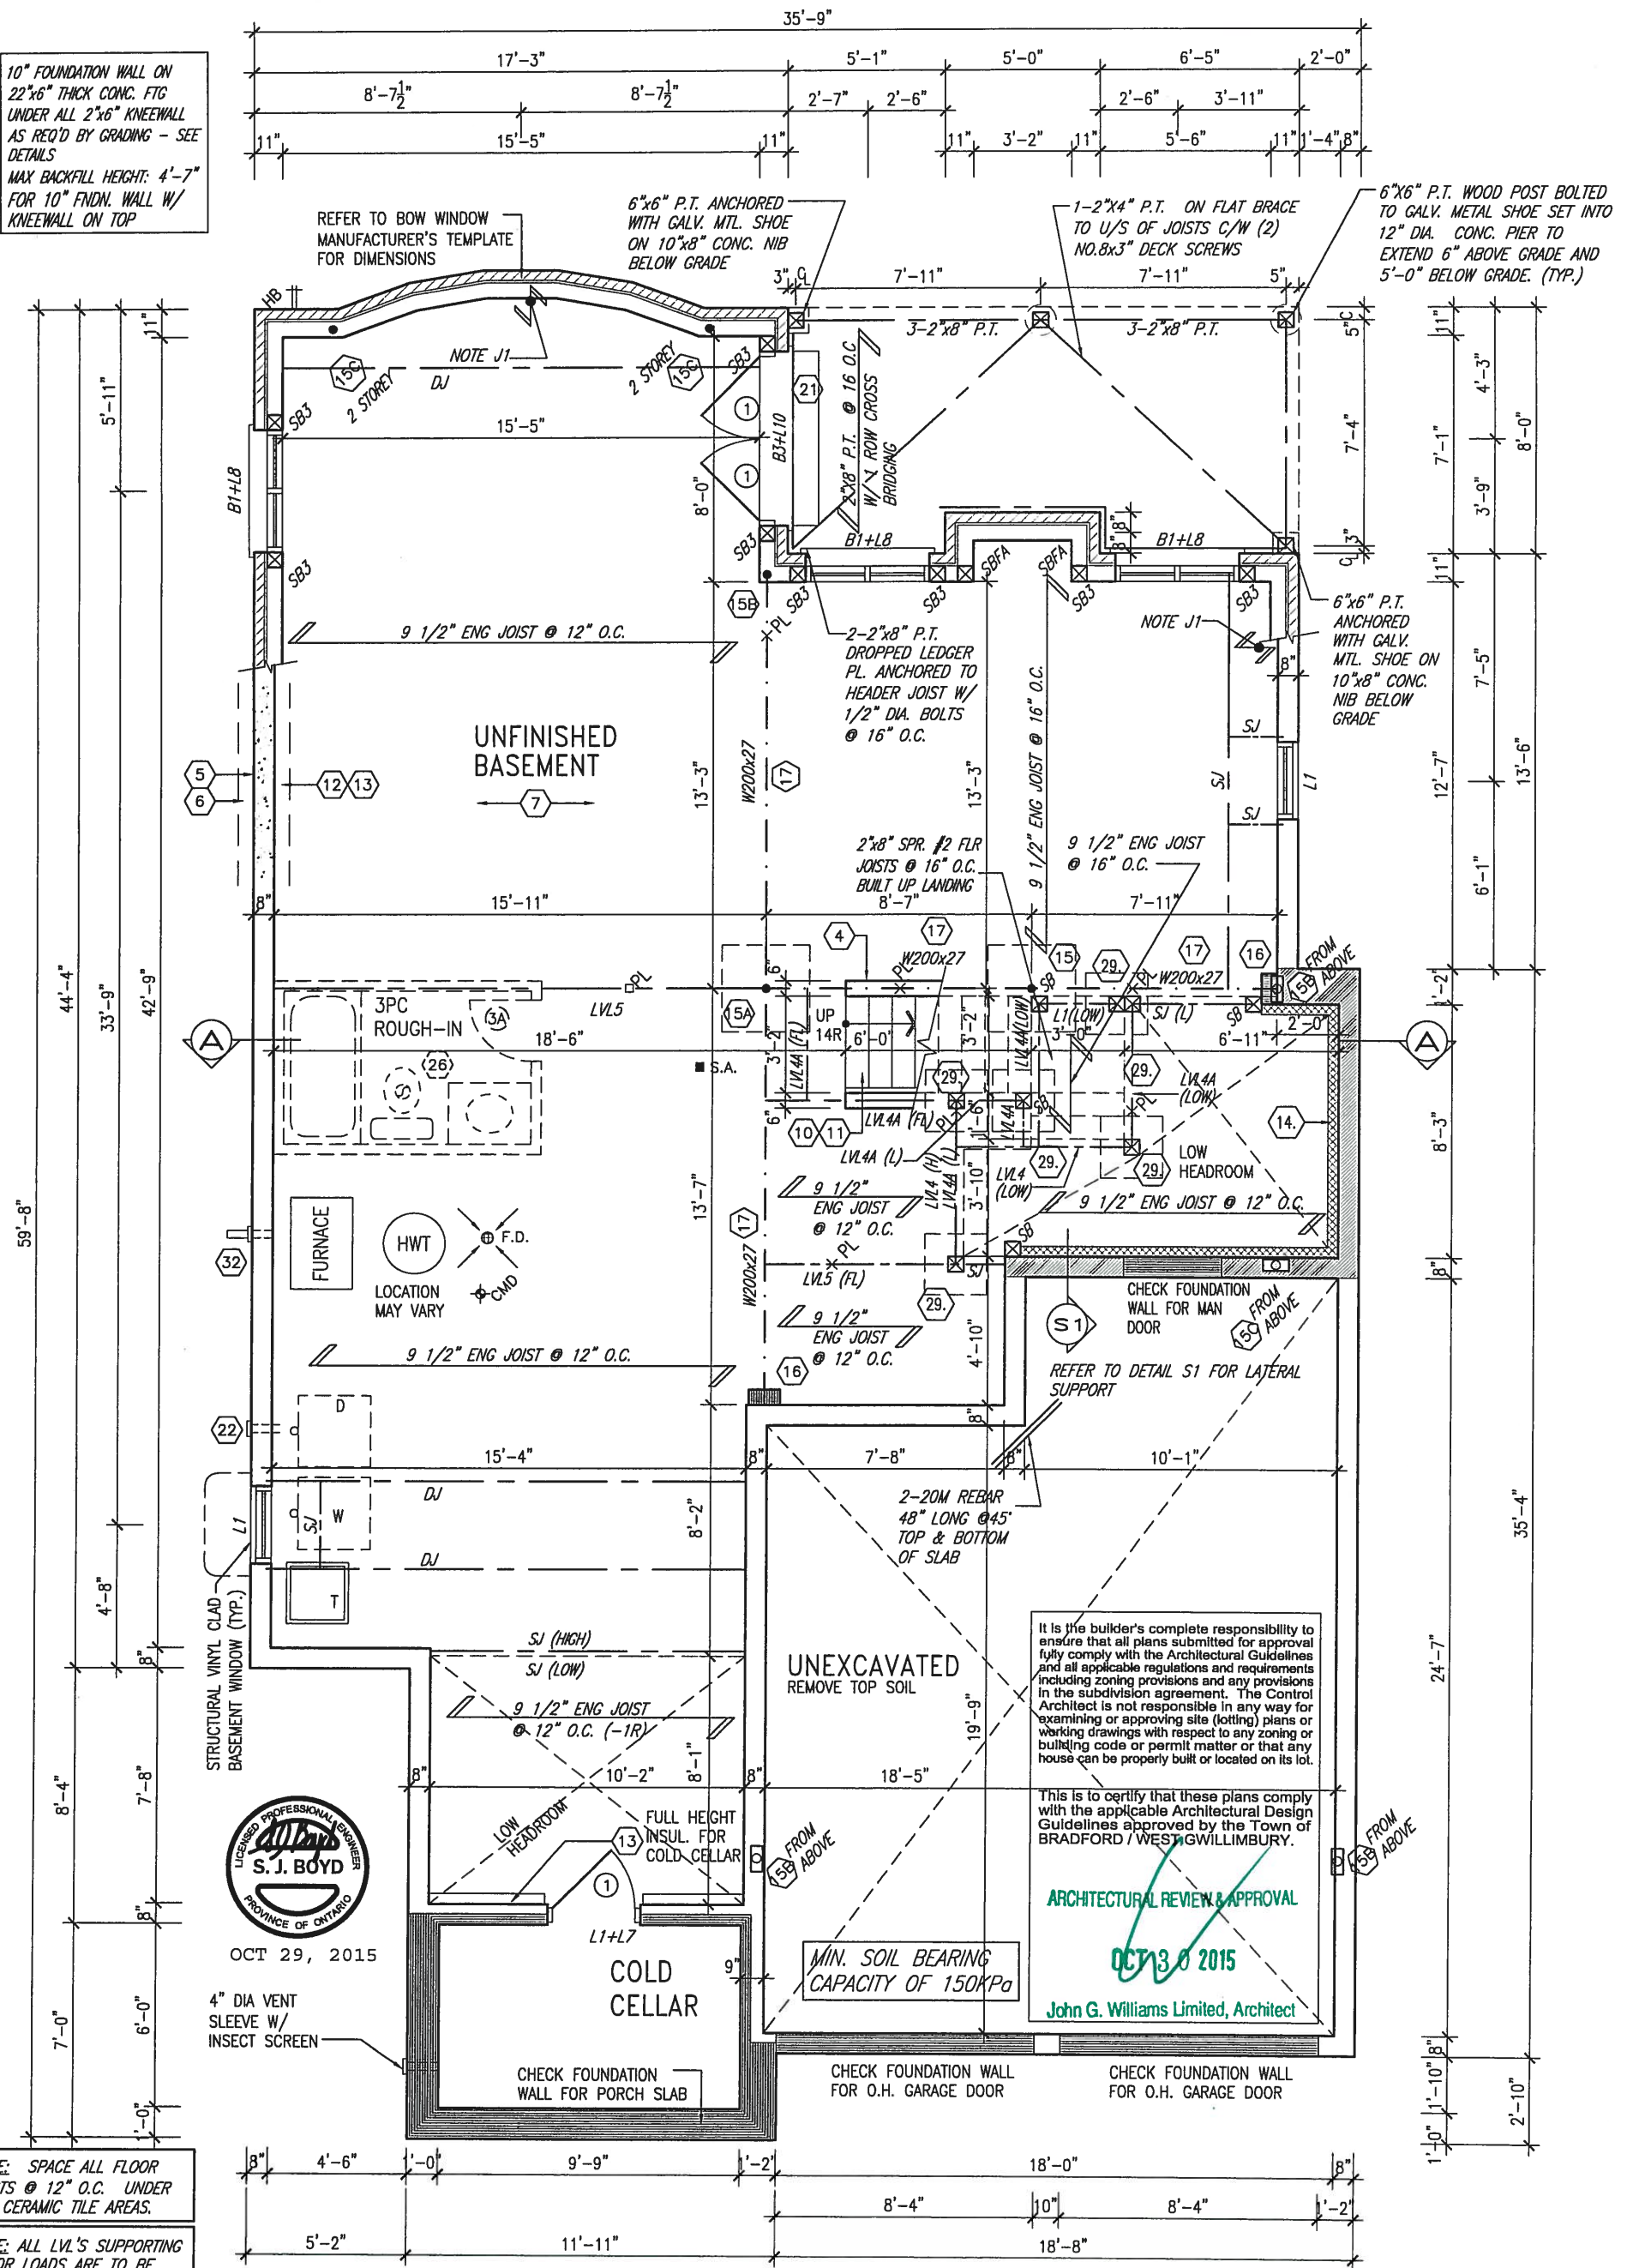

NOTE: SPACE ALL FLOOR JOISTS @ 12" O.C. UNDER ALL CERAMIC TILE AREAS.

NOTE: ALL LVL'S SUPPORTING FLOOR LOADS ARE TO BE SPECIFIED BY FLOOR TRUSS MANUFACTURER.

NOTE J1: PROVIDE SOLID BLOCKING @ 24" O.C. WHERE FLOOR JOISTS ARE PARALLEL TO FOUNDATION WALL (TYP.)

BASEMENT PLAN 'C'
SEE PAGE 8 FOR AREA CHART

NOTE: FLOOR FRAMING INFO REFER TO SHOP DRAWINGS FOR ALL TRUSS-JOIST INFORMATION AND DETAILS. UNLESS OTHERWISE NOTED.

LOT 23
RIDEAU 2

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.			BAYVIEW WELLINGTON			S42-2		
9.			project name			drawing no.		
8.			GREEN VALLEY ESTATES			1		
7.			BRADFORD, ON			13045		
6.	REVISED AS PER ENG COMMENTS	OCT 28-15	date			BASEMENT PLAN 'A'		
5.	REVISED AS PER FLOOR LAYOUT	OCT 06-15	drawn by			file name		
4.	REVISED FOR LOT 23	AUG 17-15	BO.BIM			13045-S42-2-L0T 23		
3.	REVISED AS PER ENG'S COMMENTS	MAY 04-15	checked by			scale		
2.	ADDED UPGRADED REAR ELEVATIONS.	OCT. 06/14	3/16" = 1'-0"			date		
1.	ISSUED FOR CLIENT REVIEW	SEP 04-14	Richard - H:\ARCHIVE\WORKING\2013\13045.BW\units\42\13045-S42-2-L0T 23.dwg - Wed - Oct 28 2015 - 4:10 PM					
no.	description	date	by					
9.								
8.								
7.								
6.	REVISED AS PER ENG COMMENTS	OCT 28-15	RC					
5.	REVISED AS PER FLOOR LAYOUT	OCT 06-15	RC					
4.	REVISED FOR LOT 23	AUG 17-15	CL					
3.	REVISED AS PER ENG'S COMMENTS	MAY 04-15	RC					
2.	ADDED UPGRADED REAR ELEVATIONS.	OCT. 06/14	GW					
1.	ISSUED FOR CLIENT REVIEW	SEP 04-14	RC					
no.	description	date	by					


50
HSS 3 1/2" x 3
1/2"x1/4" C/W
4"x4"x1/4" TOP AND
BOTTOM PLATES
PROVIDE BASE PLATE
4 1/2"x10"x1/2" W/
(2) 1/2" DIA x12"x2"
HOOK ANCHORS FIELD
WELD COL TO BASE
PLATE

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GWILLIMBURY.

ARCHITECTURAL REVIEW & APPROVAL

OCT 30 2015
John G. Williams Limited, Architect

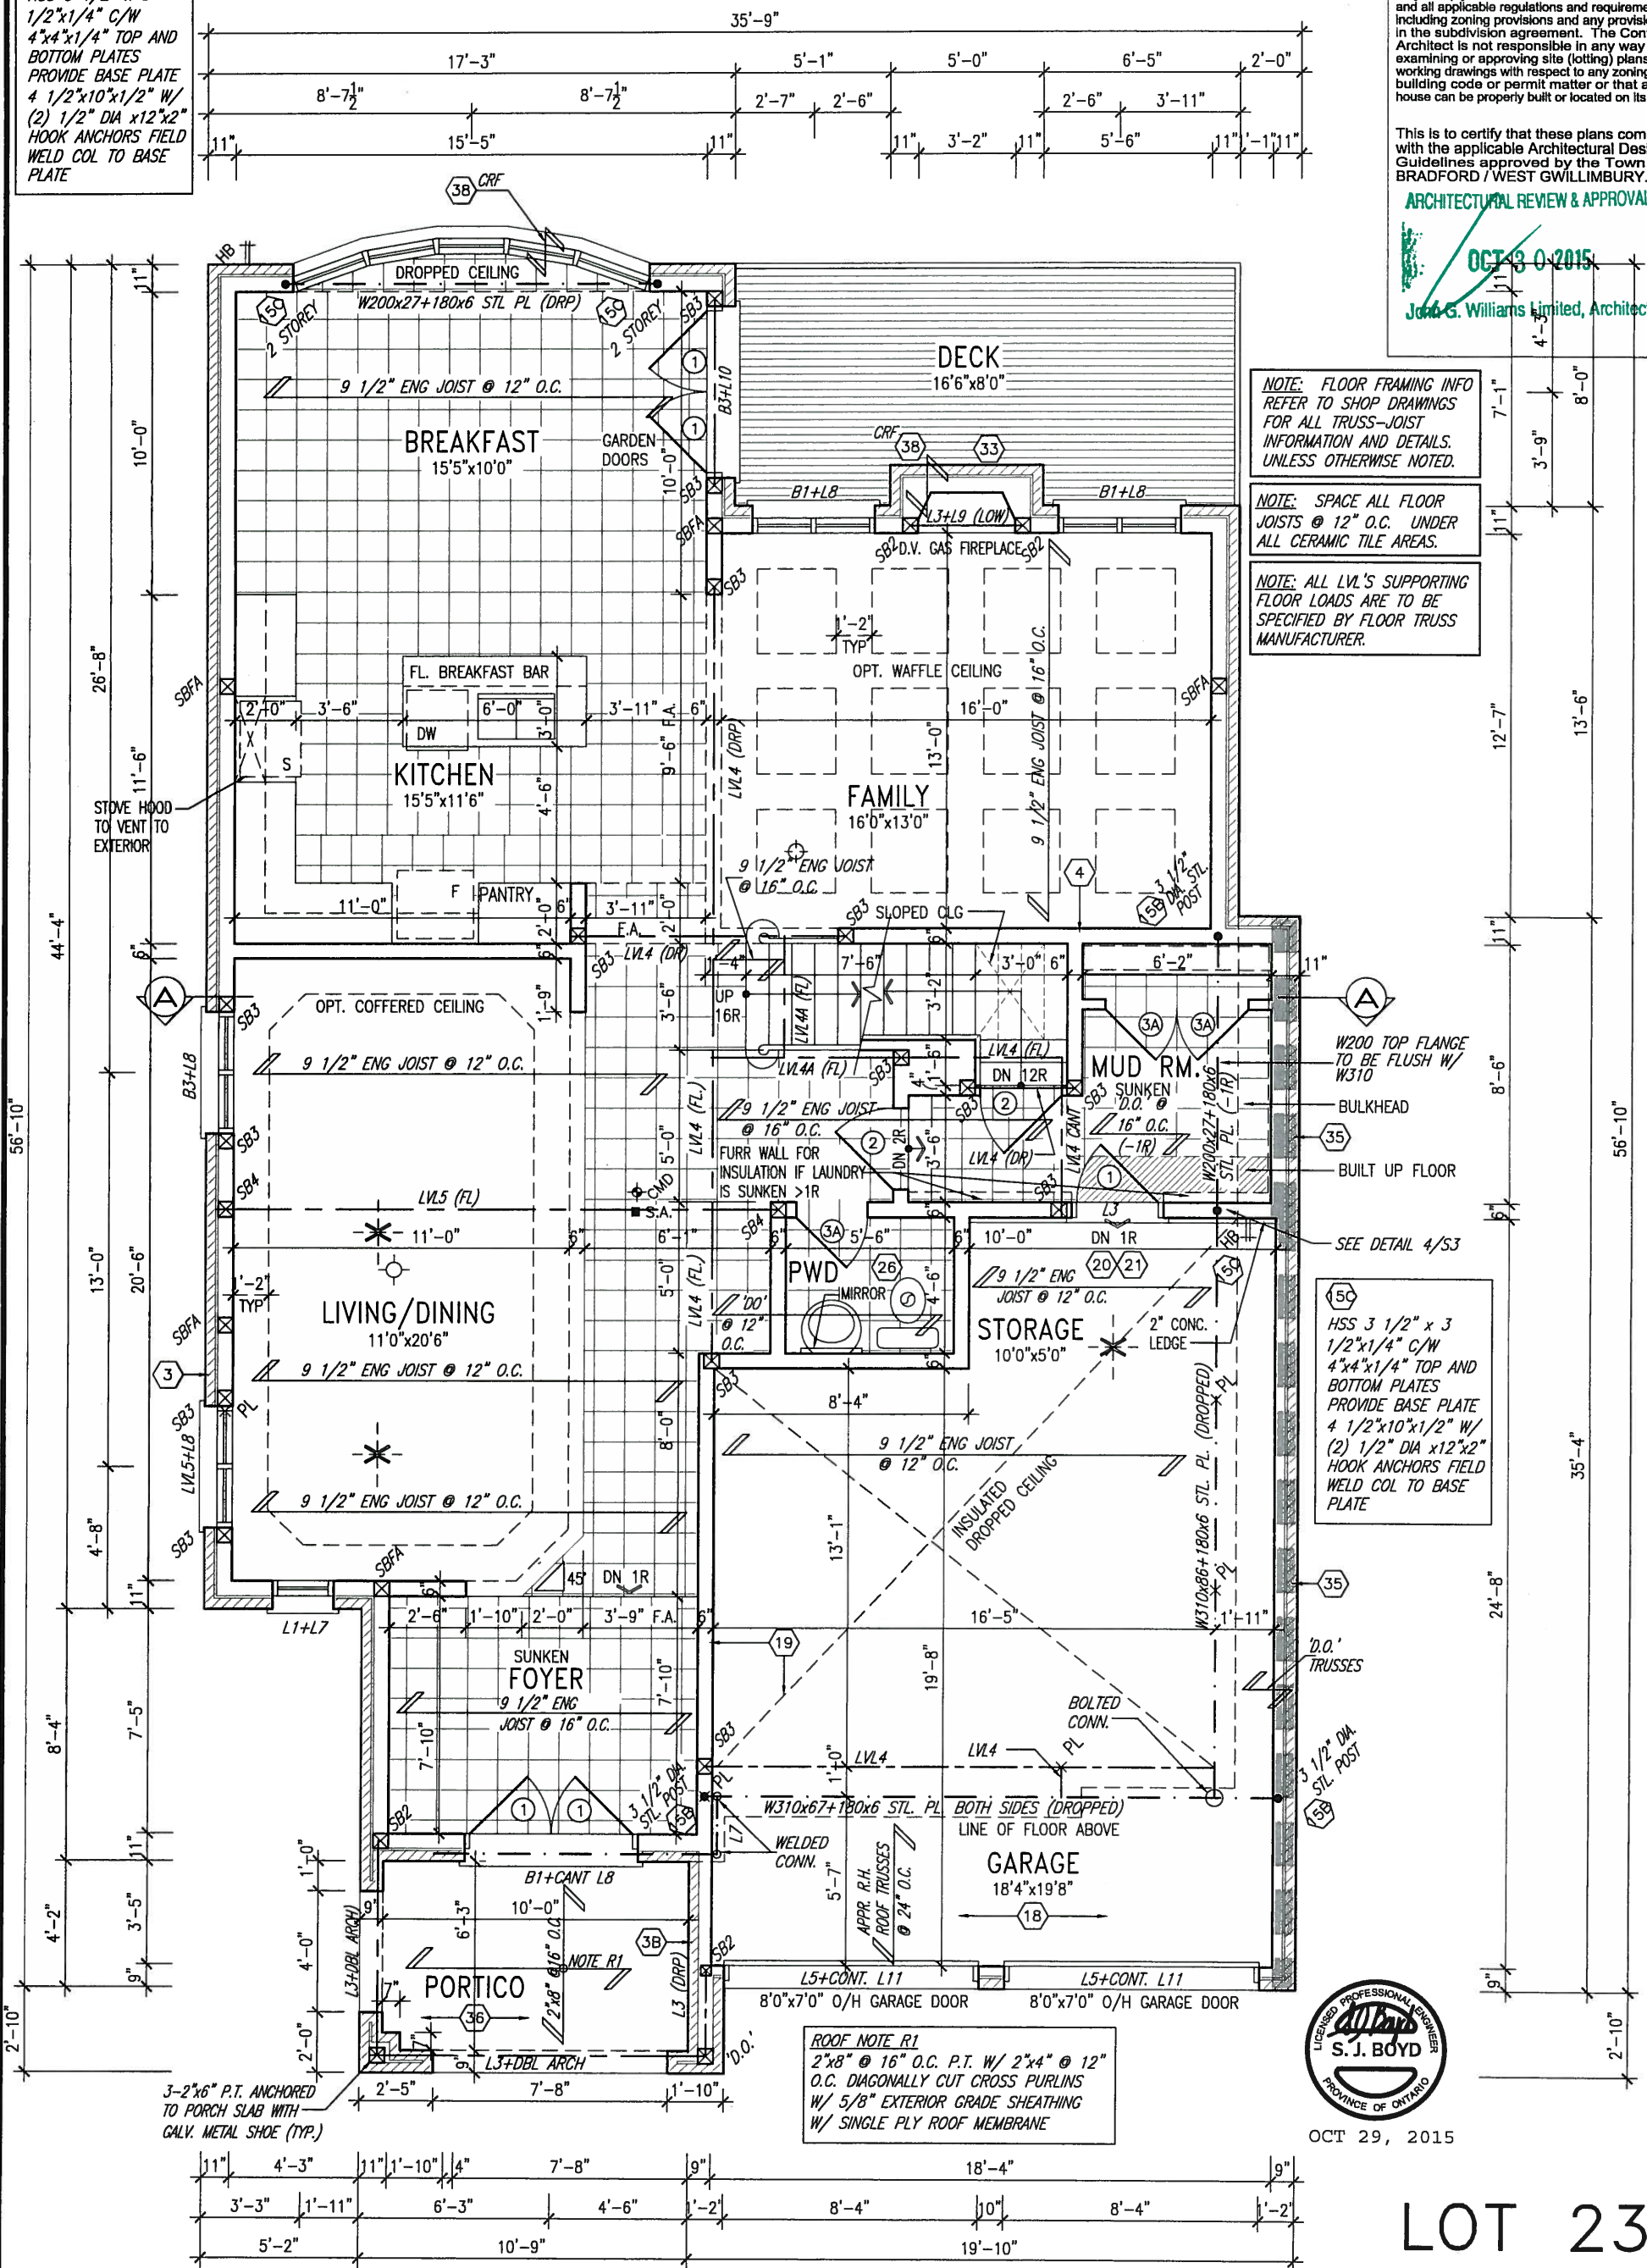

GROUND FLOOR PLAN 'C'

LOT 23
RIDEAU 2

9			
8			
7			
6	REVISED AS PER ENG COMMENTS	OCT 28-15	RC
5	REVISED AS PER FLOOR LAYOUT	OCT 06-15	RC
4	REVISED FOR LOT 23	AUG 17-15	CL
3	REVISED AS PER ENG'S COMMENTS	MAY 04-15	RC
2	ADDED UPGRADED REAR ELEVATIONS.	OCT. 06/14	GW
1	ISSUED FOR CLIENT REVIEW	SEP 04-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information
Wallington Jno-Baptiste 25591
name
registration information BCIN
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3
DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON		S42-2	
project name	GREEN VALLEY ESTATES	municipality	BRADFORD, ON
date	APR 17/14	scale	3/16" = 1'-0"
drawn by	BO.BIM	checked by	
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\42\13045-S42-2-LOT 23.dwg - Wed - Oct 28 2015 - 4:10 PM		drawing no. 2	

STUD WALL REINFORCEMENT
FOR FUTURE GRAB BARS IN
MAIN BATHROOM
REINFORCEMENT OF STUD WALLS
SHALL BE INSTALLED ADJACENT TO
WATER CLOSETS AND SHOWER OR
BATHTUB IN MAIN BATHROOM. REFER
TO OBC. 9.5.2.3, 3.8.3.8.(1)(d) &
3.8.3.1.3.(1)(f). AND DETAILS
PROVIDED

Architectural Floor Plan Details:

- Rooms and Dimensions:**
 - Master Bedroom: 19'7" x 13'2"
 - Bedroom 4: 12'0" x 10'0"
 - Bedroom 3: 13'5" (10'1") x 12'6" (11'0")
 - Bedroom 2: 13'0" x 14'6" (13'6")
 - Ensuite (Master): 6'0" x 8'0"
 - Ensuite 2: 8'8" x 6'8"
 - Shared Bath: 5'0" x 6'8"
 - Wardrobe (WIC): Multiple locations throughout the bedrooms.
- Structural and Material Notes:**
 - APPROVED RAISED HEEL ROOF TRUSSES @ 24" O.C. (STEPPED IF REQ'D)
 - G.T. BY TRUSS MANUF. (STEPPED IF REQ'D)
 - JACK TRUSSES (STEPPED IF REQ'D)
 - OPT. RAISED TRAY CEILING
 - 42" x 60" GLASS SHOWER
 - 6'0" FREESTANDING TUB
 - SEAT
 - MIRROR
 - F.A. (Floor Area)
 - S.A. (Structural Area)
 - OMD (Overhead Mechanical Device)
 - 45° (Angle)
 - DN 16R (Down 16 Railing)
 - RAILING
 - 20" HIGH DECORATIVE MTL. (Metal)
 - ROOF SCUPPER
 - FLAT ROOF
 - DRAIN SCUPPER MIN 2% SLOPE
 - TOP PLATE RAISED 18"
 - ROOF BELOW
- Dimensions and Layout:**
 - Overall dimensions: 52'-8" (width) x 52'-8" (depth).
 - Room dimensions are provided in feet and inches.
 - Truss spacing is noted as 24" O.C. (On Center).
 - Various structural notes and material specifications are included.

John G. Williams Limited, Architect

NOTE:
REFER TO ROOF TRUSS MANUF. FOR
ROOF TRUSS LAYOUTS & BEAM SIZES.

LOT 23
RIDEAU 2

9	.	.	.	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
8	.	.	.	
7	.	.	.	qualification information
6	REVISED AS PER ENG COMMENTS	OCT 28-15	RC	Wellington Jno-Baptista 25591
5	REVISED AS PER FLOOR LAYOUT	OCT 06-15	RC	name
4	REVISED FOR LOT 23	AUG 17-15	CL	registration information
3	REVISED AS PER ENG'S COMMENTS	MAY 04-15	RC	VAS Design Inc. 42658
2	ADDED UPGRADED REAR ELEVATIONS.	OCT. 06/14	GW	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.
1	ISSUED FOR CLIENT REVIEW	SEP 04-14	RC	
no.	description	date	by	

**VA3
DESIGN**

300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

S42-2


project name GREEN VALLEY ESTATES	municipality BRADFORD, ON	project no. 13045
date APR 17/14	SECOND FLOOR PLAN 'A'	
drawing no. 3		
drawn by BO.BIM	checked by -	scale 3/16" = 1'-0"
file name 13045-S2-2-L0T 23		
RICHARD - H:\ARCHIVE\WORKING\2013\13045 BIM\units\42\13045-S2-2-L0T 23.dwg - Wed - 04-08-2015 - 4:10 PM		

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission

It is the builder's complete responsibility to ensure that all construction complies with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GUILMBURY.


This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GUILMBURY.

ARCHITECTURAL REVIEW APPROVAL
OCT 3 0 2015
John G. Williams Limited Architect

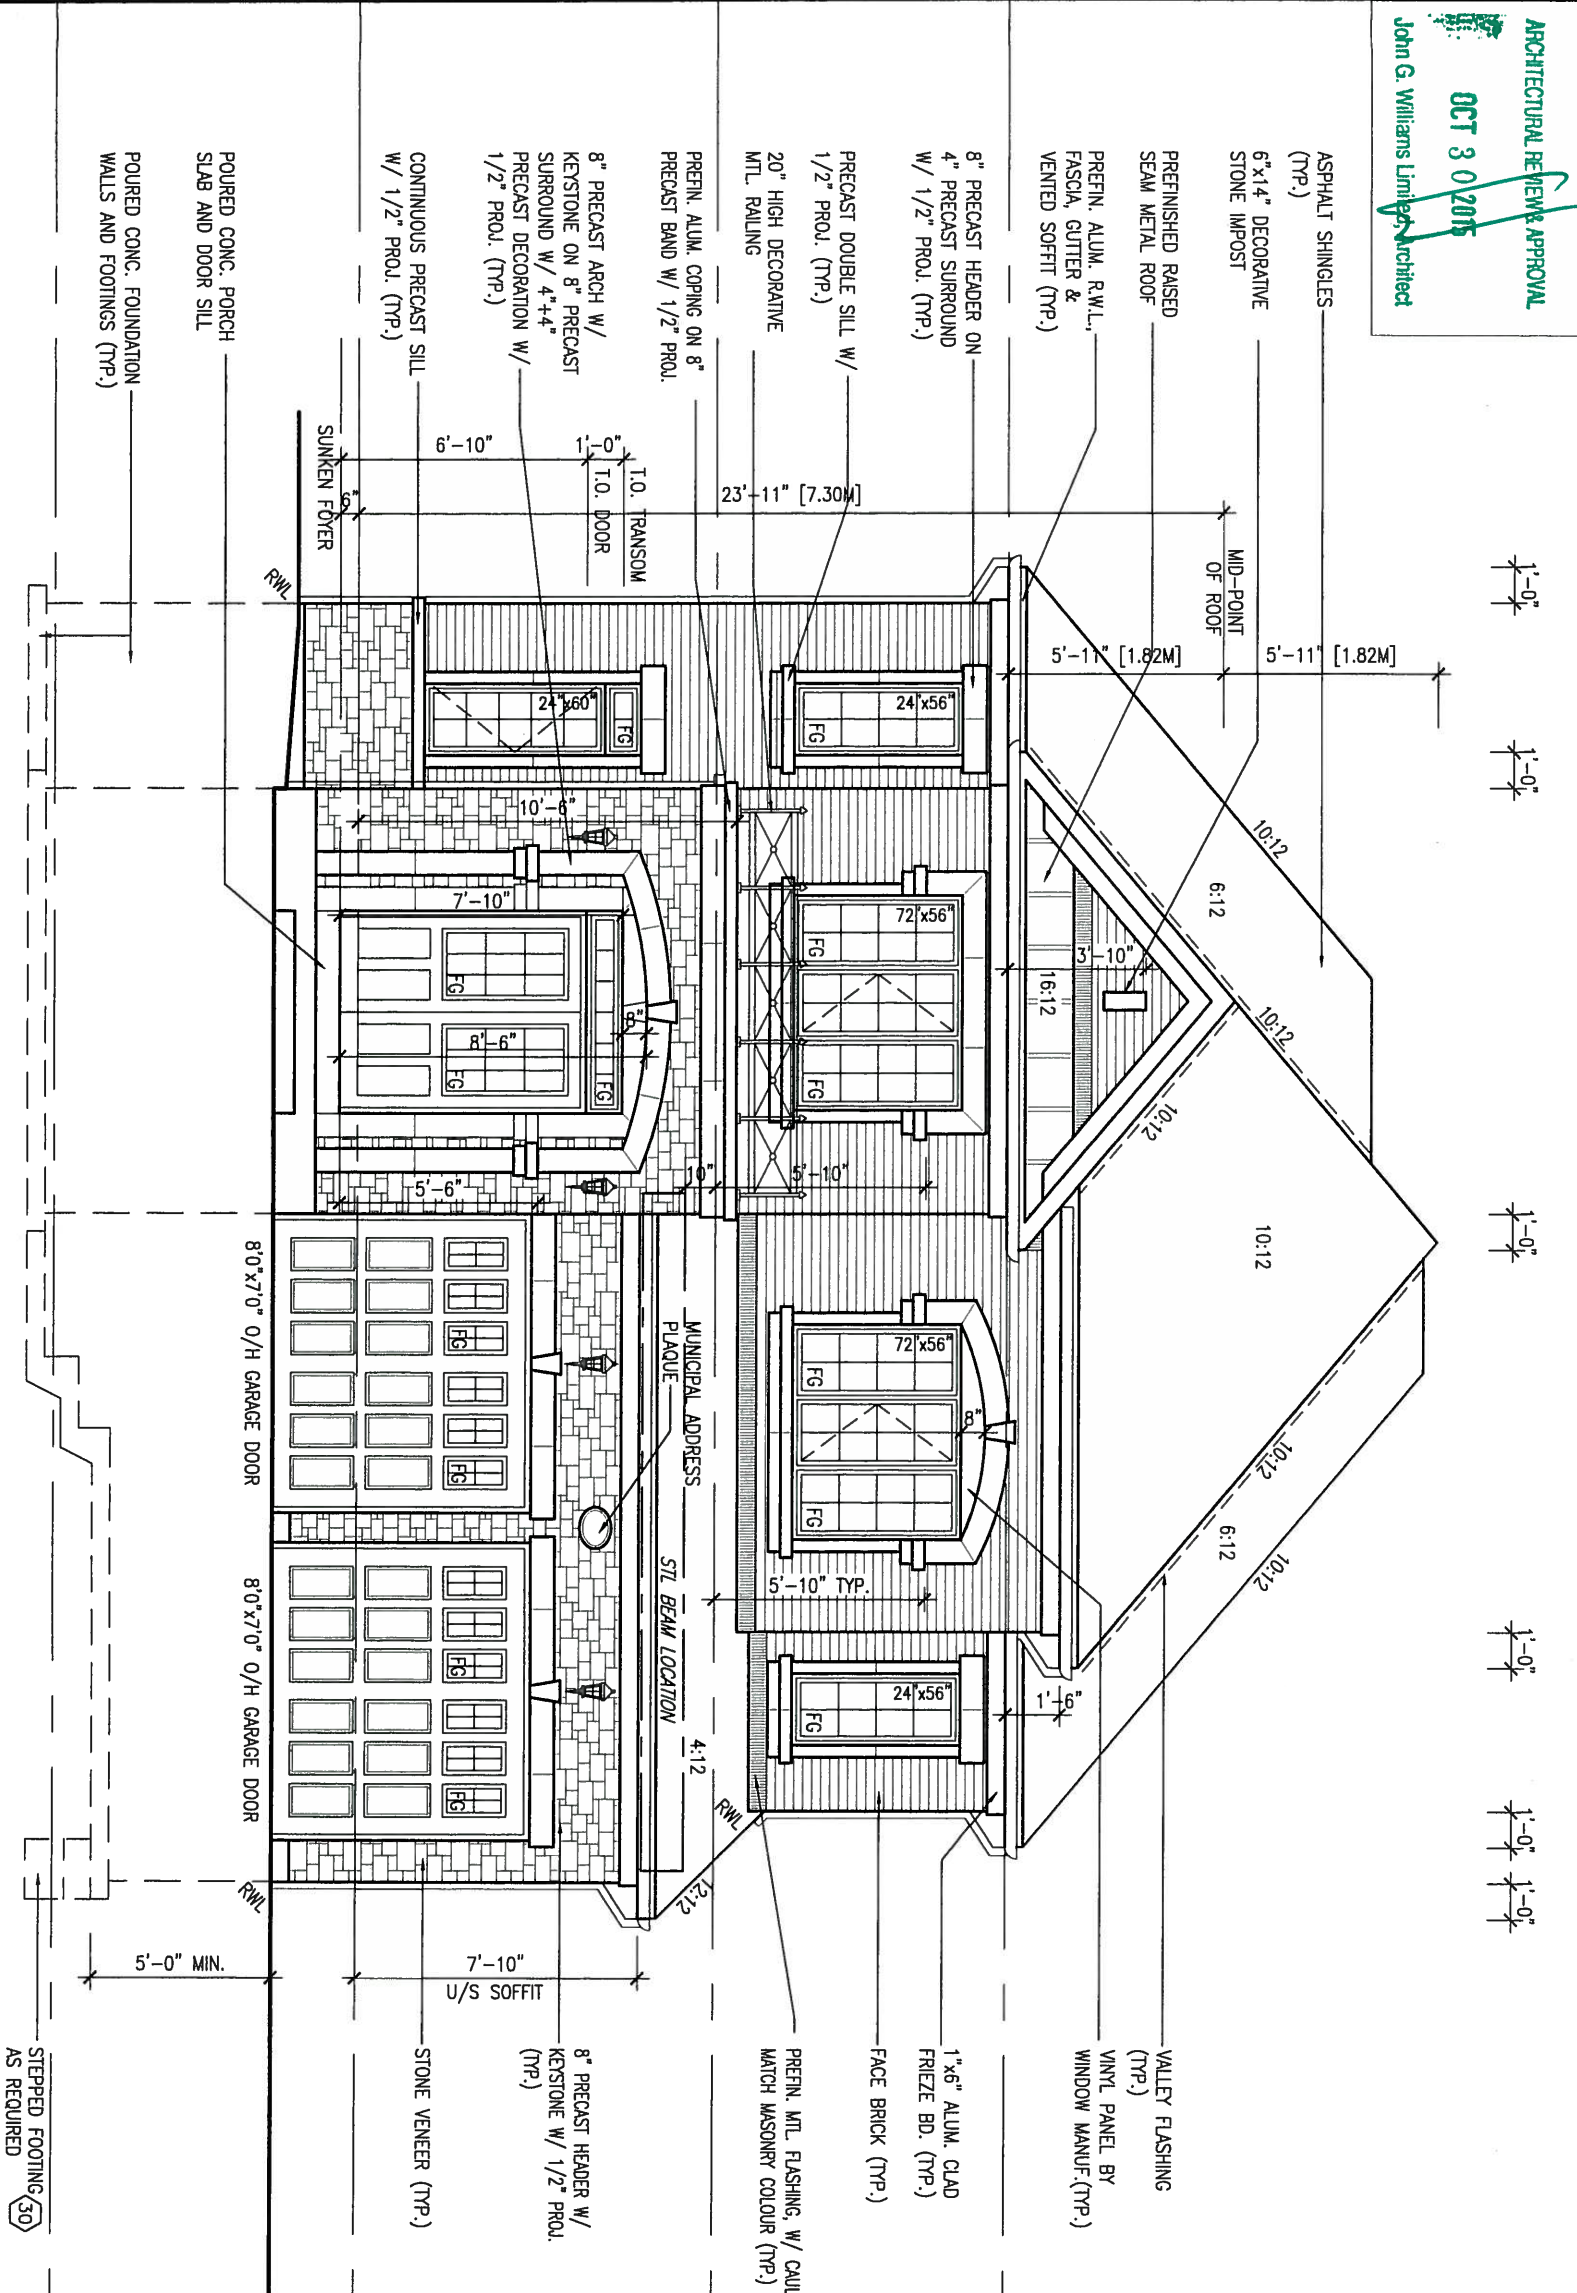


1'-0" 1'-0" 1'-0" 1'-0" 1'-0" 1'-0"

FRONT ELEVATION 'C'

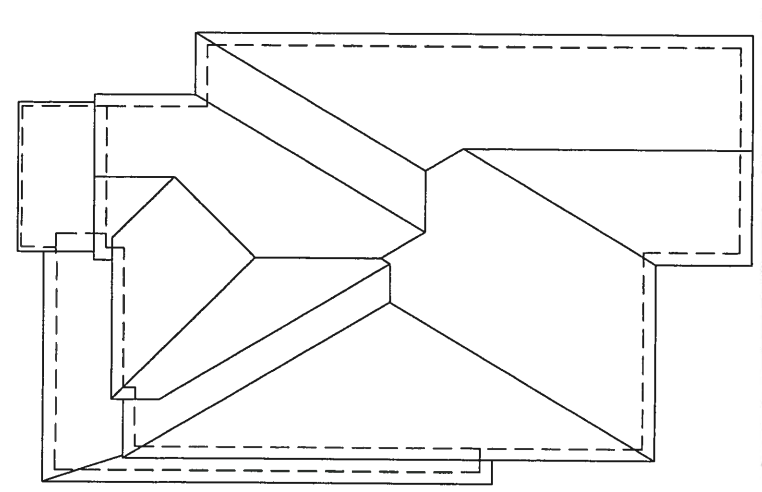

ROOF PLAN 'C'

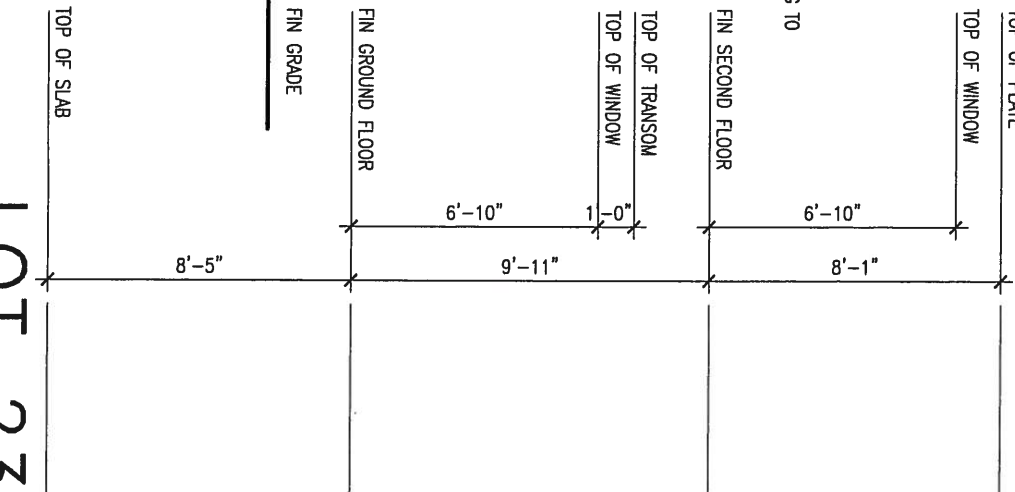

REAR ELEVATION 'C'

6 REVISED AS PER ENG COMMENTS		OCT 28-15	RC
5 REVISED AS PER FLOOR LAYOUT		OCT 06-15	RC
4 REVISED FOR LOT 23		AUG 17-15	CL
3 REVISED AS PER ENG'S COMMENTS		MAY 04-15	RC
2 ADDED UPGRADED REAR ELEVATIONS.		OCT. 06/14	GW
1 ISSUED FOR CLIENT REVIEW		SEP 04-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	
qualification information	
name	Wellington Jno-Baptiste
registration information	25591
VA3 Design Inc.	BCIN 42658
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	

VA3 DESIGN	
300A Wilson Avenue	
Toronto ON M3H 1S8	
t 416.630.2255 f 416.630.4782	
va3design.com	

BAYVIEW WELLINGTON	
project name	GREEN VALLEY ESTATES
date	APR 17/14
drawn by	BD.BIM
checked by	
scale	3/16" = 1'-0"
project no.	13045
municipality	BRADFORD, ON
drawing no.	4
file name	13045-S42-2-LOT 23
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BM\mils\42\13045-S42-2-LOT 23.dwg - Wed - Oct 28 2015 - 4:10 PM	

S42-2	
FRONT ELEVATION 'C'	

$$x_0 = 1$$

1-0



ARCHITECTURAL REVIEW & A.
OCT 9 0 2015
John G. Williams Limited, Archi

John G. Williams Limited, Arci

30 STEPPED FOOTING
AS REQUIRED

WALL AREA	1176.04 SQ. FT.
RSO AREA	91.78 SQ. FT.
LIMITING DISTANCE	1.2 M (7%)
OPENING ALLOWED	82.32 SQ. FT.
OPENING PROVIDED	79.47 SQ. FT.

LOT 23
RIDEAU 2

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	
qualification information	
Wellington Jno-Baptiste	25591
name	BCIN
registration information	
VA3 Design Inc.	42658
<p>Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.</p>	

t 416.630.2255 f 416.630.4782
va3design.com

project name	municipality		project no.
GREEN VALLEY ESTATES	BRADFORD, ON		13045
date	LEFT SIDE ELEVATION 'C'		drawing no.
APR 17/14			5
drawn by	checked by	scale	file name
BD.BIM	-	3/16" = 1'-0"	13045-S42-2-LOT 23
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\42\13045-S42-2-LOT 23.dwg - Wed - Oct 28 2015 - 4:10 PM			

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

REFER TO FRONT ELEVATION FOR
TYPICAL NOTES.

1'-0" 1'-0" 1'-0" 1'-0"

1'-0"

1'-0"

1'-0"

OCT 29, 2015



It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions of the Building Code. The Architect is not responsible for any errors or omissions in the drawings or for any zoning or building code or permit matter or that any house can be properly built or located on its lot.

ARCHITECTURAL REVIEW & APPROVAL

OCT 30 2015

John G. Williams Limited, Architect

VALLEY FLASHING (TYP.) 10:12 10:12 10:12 8:12 10:12 8:12 10:12

MTL. FLASHING, W/ CAULKING
BEHIND CLADDING (TYP.)

PREP. MTL. FLASHING, W/ CAULKING TO
MATCH MASONRY COLOUR (TYP.)

10'-6"

5'-0" MIN.

RWL

4'-0" RET.

7'-10" U/S SOFFIT

BRICK VENEER CONSTRUCTION
(FOR WALLS LESS THAN 1.2M (3'-11") FROM THE LOT LINE)
45 MINUTE FIRE RATED WALL
PROVIDE A CONTINUOUS LAYER OF 12.7mm (1/2") TYPE 'X' GYPSUM BOARD (INTERIOR SIDE)
BE FILLED WITH INSULATION CONFORMING TO CAN/ULC-S702, "MINERAL FIBRE THERMAL INSULATION
FOR BUILDINGS" WITH A MASS OF NOT LESS THAN 1.22 kg/SQ.M. AND MUST FILL AT LEAST 90% OF
THE CAVITY THICKNESS. THE TYPE 'X' & INSULATION MUST BE RUN CONTINUOUSLY BEHIND ALL
INTERSECTING PARTITIONS, MECHANICAL CHASES, BATHUBS, SHOWERS, ETC. ENSURE INSULATION &
TYPE 'X' IS INSTALLED IN GARAGE EXTERIOR WALLS.
(REFER TO SECTION SB-2 OF OBC 2006-SUPPLEMENTARY STANDARDS)

35

12:12

28"x48"

28"x48"

FG

4'-0" RETURN

30"x16"

8:12

8'-4" U/S SOFFIT

TOP OF TRANSOM

FIN SECOND FLOOR

TOP OF WINDOW

TOP OF PLATE

FIN GRADE

TOP OF SLAB

5'-0" MIN.

WALL AREA 1123.05 SQ. FT.
LIMITING DISTANCE 1.2 M (7%)
OPENING ALLOWED 78.61 SQ. FT.
OPENING PROVIDED 62.45 SQ. FT.

STEPPED FOOTING (30)
AS REQUIRED

RIGHT SIDE ELEVATION 'C'

LOT 23
RIDEAU 2

9.
8.
7.
6.	REVISED AS PER ENG COMMENTS	OCT 28-15	RC	Wellington Jno-Baptiste	25591
5.	REVISED AS PER FLOOR LAYOUT	OCT 06-15	RC	name	BCN
4.	REVISED FOR LOT 23	AUG 17-15	CL	registration information	42658
3.	REVISED AS PER ENG'S COMMENTS	MAY 04-15	RC	VA3 Design Inc.	
2.	ADDED UPGRADED REAR ELEVATIONS.	OCT. 06/14	GW	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	
1.	ISSUED FOR CLIENT REVIEW	SEP 04-14	RC		
no.	description	date	by		

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

project name GREEN VALLEY ESTATES municipality BRADFORD, ON
date APR 17/14
drawn by BD.BIM checked by scale 3/16" = 1'-0"
RIGHT SIDE ELEVATION 'C'

S42-2

project no. 13045


drawing no. 6

13045-S42-2-Lot 23
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BM\units\42\13045-S42-2-Lot 23.dwg - Wed - Oct 28 2015 - 4:10 PM

REFER TO FRONT ELEVATION FOR
TYPICAL NOTES.

UNINSULATED OPENINGS (PER OBC, SB-12.2.1.1(7))			
S42-2 ELEVATION C W.O.B.	ENERGY EFFICIENCY - OBC SB12		
ELEVATION	WALL AREA S.F.	OPENING S.F.	PERCENTAGE
FRONT	693.00 S.F.	92.33 S.F.	13.32 %
LEFT SIDE	1053.00 S.F.	78.44 S.F.	7.45 %
RIGHT SIDE	1056.00 S.F.	66.39 S.F.	6.29 %
REAR	908.00 S.F.	204.00 S.F.	22.47 %
TOTAL SQ. FT.	3710.00 S.F.	441.16 S.F.	11.89 %
TOTAL SQ. M.	344.67 S.M.	40.98 S.M.	11.89 %

AREA CALCULATIONS		ELEV. B
GROUND FLOOR AREA	1318 SF	
SECOND FLOOR AREA	1561 SF	
SUBTOTAL	2879 SF	
DEDUCT ALL OPEN AREAS	0 SF	
TOTAL NET AREA	2879 SF	
	(267.47 m ²)	
FINISHED BSMT AREA	0 SF	
COVERGE W/OUT PORCH	1764 SF	
	(163.88 m ²)	
COVERGE W/ PORCH	1843 SF	
	(171.22 m ²)	

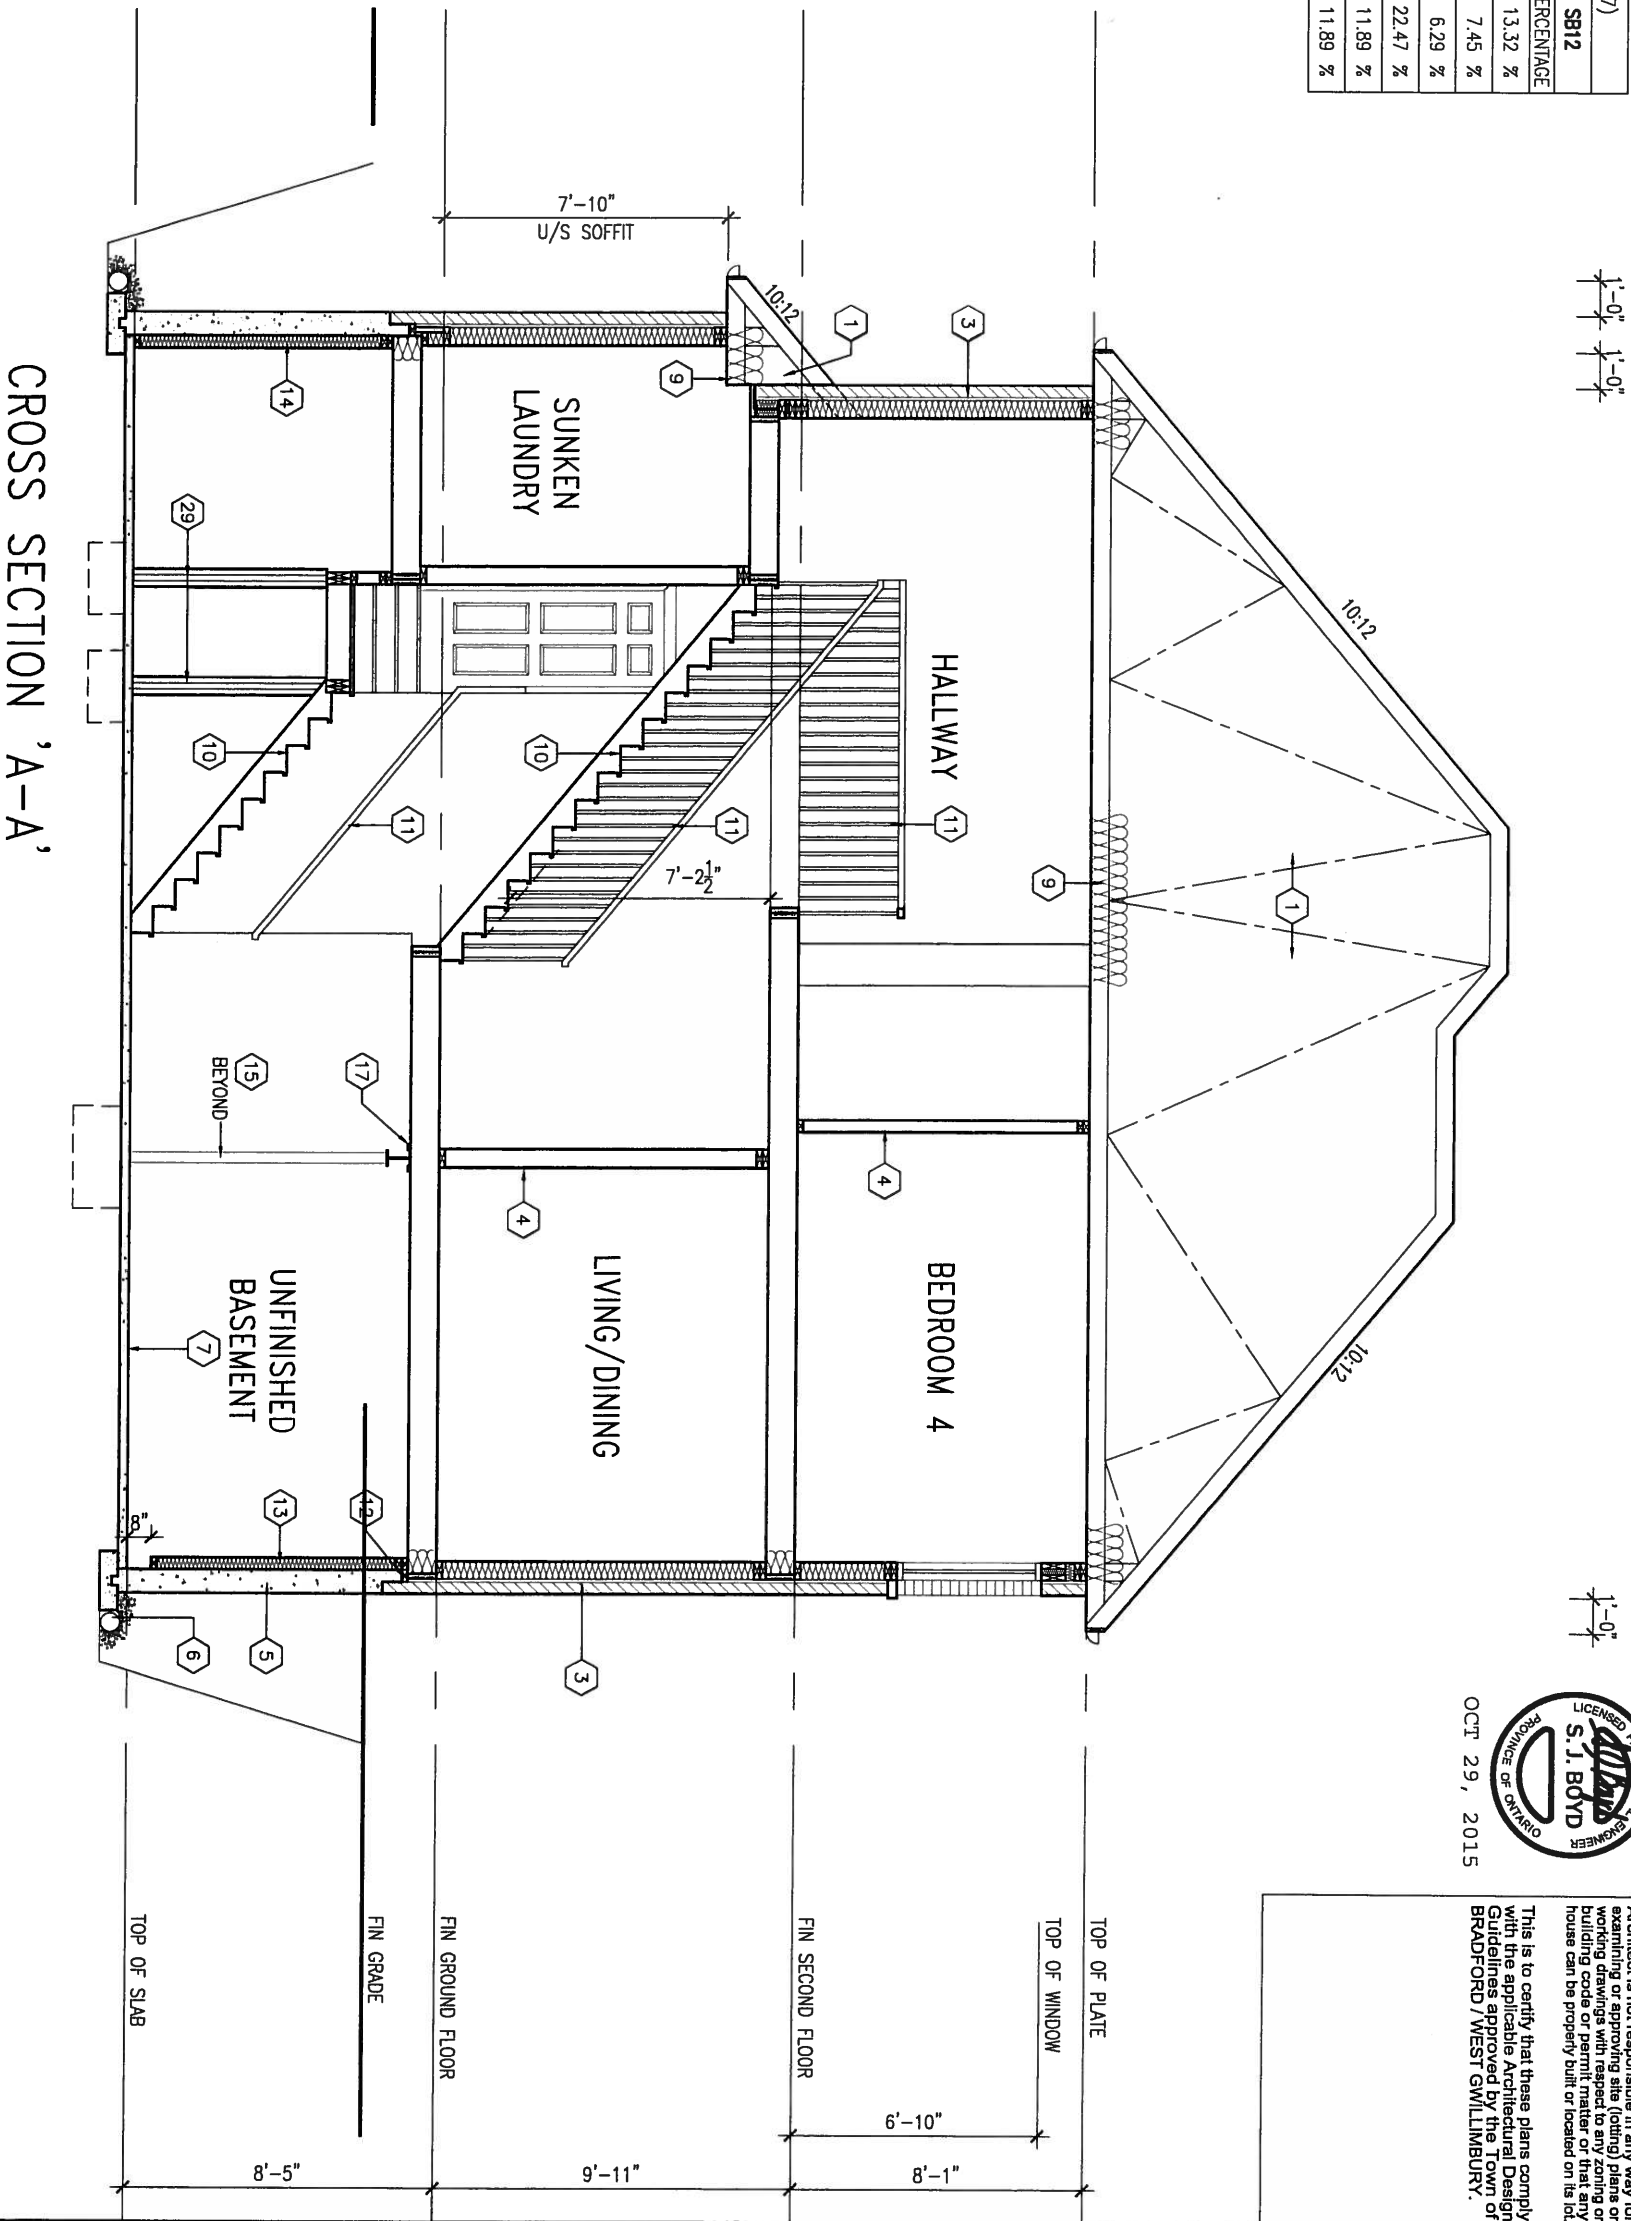

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GWILLIMBURY.

LOT 23
RIDEAU 2

9		-		-		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.		BAYVIEW WELLINGTON		S42-2	
8		-		-		qualification information		project name		project no.	
7		-		-		Wellington Jno-Baptiste		GREEN VALLEY ESTATES		13045	
6		REVISED AS PER ENG COMMENTS		OCT 28-15		RC		municipality		BRADFORD, ON	
5		REVISED AS PER FLOOR LAYOUT		OCT 06-15		RC		date		APR 17/14	
4		REVISED FOR LOT 23		AUG 17-15		CL		checked by		scale	
3		REVISED AS PER ENG'S COMMENTS		MAY 04-15		RC		drawn by		file name	
2		ADDED UPGRADED REAR ELEVATIONS.		OCT. 06/14		GW		-		13045-S42-2-LOT 23	
1		ISSUED FOR CLIENT REVIEW		SEP 04-14		RC		3/16" = 1'-0"		13045-S42-2-LOT 23.dwg	
no.		description		date		by		Richard - H:\ARCHIVE\WORKING\2013\13045.BW\units\42\13045-S42-2-LOT 23.dwg		Wed - Oct 28 2015 - 4:10 PM	

VA3
DESIGN

300A Wilson Avenue
Toronto ON M5H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

CROSS SECTION 'A-A'

8

CONSTRUCTION NOTES (Unless otherwise noted)

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. **ONT. REG. 332/12-2012 OBC**

1. ROOF CONSTRUCTION

NO.210 [10.25kg/m2] ASPHALT SHINGLES, 10mm [3/8"] PLYWOOD SHEATHING WITH "H" CLIPS, APPROVED WOOD TRUSSES @ 600mm [24"] O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm [3'-0"] FROM EDGE OF ROOF AND MIN. 300mm [12"] BEYOND INNER FACE OF EXTERIOR WALL. (EAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 8:12 OR GREATER) 38x89 (2"x4") TRUSS BRACING @ 1830mm [6'-0"] O.C. AT BOTTOM CHORD. PREFIN. ALUM. EAVESTROUGH, FASCIA, RWL & VENTED SOFFIT. PROVIDE ICE & WATER SHIELD TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE DAMMING. ROOF SHEATHING TO BE FASTENED 150 (6") c/c ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 (16"). ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT RIDGE [OBC 9.19.1.2].

2. FRAME WALL CONSTRUCTION (2"x6") (SB-12-TABLE 2.1.1.2A)
SIDING AS PER ELEV., 19x38 [1"x2"] VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm [3/8"] EXT. TYPE SHEATHING, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm [8"] ABOVE FINISH GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION.

2A. FRAME WALL CONSTRUCTION (2"x6") (R28)
SIDING AS PER ELEV., 19x38 [1"x2"] VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 28mm [1 1/4"] EXTERIOR STRUCTURAL INSULATED SHEATHING RSI 0.7 (R4) BY "B" OR EQUAL, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., RSI 4.23 (R24) INSUL. AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INT. DRYWALL FINISH. SIDING TO BE MIN. 200mm [8"] ABOVE FINISH GRADE.

2B. FRAME WALL CONSTRUCTION (2"x4")- GARAGE WALLS
SIDING AS PER ELEV., 19x38 [1"x2"] VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm [3/8"] EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm [16"] O.C. (MAX. HEIGHT 3000mm [9'-10"], WITH APPR. DIAGONAL WALL BRACING. SIDING TO BE MIN. 200mm [8"] ABOVE FINISH GRADE.

2C. RESERVED

2D. STUCCO WALL CONSTRUCTION (2"x4") -GARAGE WALLS
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm [1"] MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPROVED AIR/MOISTURE BARRIER ON 13mm [1/2"] EXT. TYPE SHEATHING ON 38x89 (2"x4") STUDS @ 400 [16"] O.C.. STUCCO TO BE MIN. 200 [8"] ABOVE FINISH GRADE.

2E. WALLS ADJACENT TO ATTIC SPACE - NO CLADDING
9.5mm [3/8"] EXT. TYPE SHEATHING, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INTERIOR DRYWALL FINISH. MID-HIGHT BLOCKING REQ'D. IF NO SHEATHING APPLIED. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION.

3. BRICK VENEER CONSTRUCTION (2"x6") (SB-12-TABLE 2.1.1.2A)
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL. APPROVED SHEATHING PAPER, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., INSULATION & APPR. VAPOUR BARRIER WITH APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INTERIOR DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm [32"] O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm [6"] BEHIND BUILDING PAPER. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. BRICK TO BE MIN. 150mm [6"] ABOVE FINISH GRADE.

3A. BRICK VENEER CONSTRUCTION (2"x6") (R28)
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL. APPR. SHEATHING PAPER, 28mm [1 1/4"] EXT. STRUCT. INSULATED SHEATHING RSI 0.7 (R4) BY "B" OR EQUAL, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., RSI 4.23 (R24) INSUL. & APPR. VAPOUR BARRIER WITH APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INT. DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm [32"] O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm [6"] BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm [6"] ABOVE FINISH GRADE.

3B. BRICK VENEER CONSTRUCTION (2"x4")- GARAGE WALLS
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL 600mm (24") O.C. VERTICAL. APPR. SHEATHING PAPER, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm [16"] O.C. (MAX. HEIGHT 3000mm 9'-10") WITH APPR. DIAGONAL WALL BRACING. PROVIDE WEEP HOLES @ 800mm [32"] O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm [6"] BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm [6"] ABOVE FINISH GRADE.

3C. STUCCO WALL CONSTRUCTION (2"x6")
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.(2) & 9.28 THAT EMPLOYS A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm [1"] MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 13mm [1/2"] EXT. TYPE SHEATHING ON 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., INSULATION, APPROVED VAPOUR BARRIER, 13mm [1/2"] GYPSUM WALLBOARD INTERIOR FINISH. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. STUCCO TO BE MIN. 200 [8"] ABOVE FINISH GRADE.

4. INTERIOR STUD PARTITIONS
FOR BEARING PARTITIONS 38x89 (2"x4") @ 400mm [16"] O.C. FOR 2 STOREYS AND 300mm [12"] O.C. FOR 3 STOREYS, NON-BEARING PARTITIONS 38x89 (2"x4") @ 400mm [16"] O.C. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND 2/38x89 (2/2"x4") TOP PLATE. 13mm [1/2"] INT. DRYWALL BOTH SIDES OF STUDS, PROVIDE 38x140 [2"x6"] STUDS/PLATES WHERE NOTED.

5. FOUNDATION WALL/FOOTINGS: (9.15.3, 9.15.4, 9.13.2, 9.14.2.1.(2))
200mm [8"] POURED CONC. FDTN. WALL 15MPa [2200psi] WITH BITUMENOUS DAMPROOFING AND DRAINAGE LAYER, DRAINAGE LAYER REQ'D. WHEN BASEMENT INSUL. EXTENDS 900 [2'-11"] BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D. WHEN FDTN. WALL IS WATERPROOFED. MAXIMUM POUR HEIGHT 2390 [7'-10"] ON 500x155 [20"x6"] CONTINUOUS KEYED CONC. FTG. BRACE FDTN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL, WITH MIN. BEARING CAPACITY OF 150kPa OR GREATER. IF SOIL BEARING DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED.
STOREYS SUPPORTED [W/ MASONRY VENEER] [W/ SIDING ONLY]

1	16" WIDE x 6" DEEP	16" WIDE x 6" DEEP
2	20" WIDE x 6" DEEP	20" WIDE x 6" DEEP
3	26" WIDE x 9" DEEP	20" WIDE x 6" DEEP

-SEE OBC 9.15.3.

-MAXIMUM FLOOR LIVE LOAD OF 2.4kPa. (50psf.) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.9m [16'-1"].
-REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING CAPACITY.

STRIP FOOTING SUPPORTING EXTERIOR WALLS (FOR W.O.B.)
-ASSUMING MASONRY VENEER CONSTRUCTION, MAX. FLOOR LIVE LOAD OF 2.4kPa. (50psf.) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.9m [16'-1"]. THE STRIP FOOTING SIZE IS AS FOLLOWS:
2 STOREY WITH WALK-OUT BASEMENT 545x175 [22"x7"]

6. FOUNDATION DRAINAGE OBC 9.14.2, & 9.14.3.
100mm (4") DIA. FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED STONE OVER AND AROUND DRAINAGE TILES.

7. BASEMENT SLAB OBC 9.3.1.6 (1)(b), 9.16.4.5 (1), 9.25.3.3 (15)
80mm (3") MIN. 25MPa [3600psi] CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL, OR 20MPa. (3000psi) CONC. WITH DAMPROOFING BELOW SLAB. UNDER SLAB INSULATION PER SB-12. ALL SLAB JOINTS & PENETRATIONS TO BE CAULKED.

8. EXPOSED FLOOR TO EXTERIOR (SB-12-TABLE 2.1.1.2A)
PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

9. ATTIC INSULATION (SB-12-TABLE 2.1.1.2A) (SB-12-2.1.1.7)
RSI 5.81 (R50) BLOWN IN ROOF INSULATION AND APPROVED VAPOUR BARRIER, 16mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL. RSI 3.52 (R20) MIN. ABOVE INNER SURFACE OF EXTERIOR WALL

10. ALL STAIRS/EXTERIOR STAIRS -OBC. 9.8.-
UNIFORM RISE -5mm (1/4") MAX BETWEEN ADJACENT TREADS OR LANDINGS
-10mm (1/2") MAX BETWEEN TALLEST & SHORTEST RISE IN FLIGHT

MAX. RISE	= 200 [7'-7/8"]
MIN. RUN	= 210 [8'-1/4"]
MIN. TREAD	= 235 [9'-1/4"]
MAX. NOSING	= 25 [1"]
MIN. HEADROOM	= 1950 [6'-5"]
RAIL @ LANDING	= 900 [2'-11"]
RAIL @ STAIR	= 865 [2'-10"] to 965 [3'-2"]
MIN. STAIR WIDTH	= 860 [2'-10"]

FOR CURVED STAIRS
MIN. RUN = 150 [6"]
MIN. AVG. RUN = 200 [8"]
HANDRAILS -OBC. 9.8.7.-

FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT TO BE 50 [2"] MIN. HANDRAILS TO BE CONTINUOUS EXCEPT FOR NEWEL POST AT CHANGES OF DIRECTION .

INTERIOR GUARDS -OBC. 9.8.8.-
INTERIOR GUARDS: 900mm [2'-11"] MIN. HIGH
EXTERIOR GUARDS - OBC. 9.8.8.
900mm [36"] HIGH GUARD WHERE DISTANCE FROM PORCH TO FIN. GRADE IS LESS THAN 1800mm [71"]. 1070mm [42"] HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1800mm [71"].

SILL PLATE - OBC. 9.23.7.
38x89 (2"x4") SILL PLATE WITH 13mm [1/2"] DIA. ANCHOR BOLTS 200mm [8"] LONG, EMBEDDED MIN. 100mm [4"] INTO CONC. @ 2400mm [7'-10"] O.C., CAULKING OR 25 [1"] MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FDTN. WALL
USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

FOUNDATION INSULATION (SB-12-2.1.1.6), 9.25.2.3, 9.13.2.6)
BASEMENT WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm [8"] ABOVE THE FINISHED FLOOR & NO CLOSER THAN 50mm [2"] OF THE BASEMENT SLAB. INSULATION TO HAVE APPROVED VAPOUR BARRIER. DAMPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL. NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. AIR BARRIER TO BE SEALED TO FDTN. WALL WITH CAULKING.

14. BEARING STUD PARTITION
38x89 (2"x4") STUDS @ 400mm [16"] O.C. 38x89 (2"x4") SILL PLATE ON DAMPROOFING MATERIAL, 13mm [1/2"] DIA. ANCHOR BOLTS 200mm [8"] LONG, EMBEDDED MIN. 100mm [4"] INTO CONC. @ 2400mm [7'-10"] O.C. 100mm [4"] HIGH CONC. CURB ON 350x155 [14"x6"] CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15. STEEL BASEMENT COLUMN (SEE O.B.C. 9.15.3.3)
89mm (3-1/2") DIA x 3.0mm [0.118] SINGLE WALL TUBE TYPE 2 ADJUSTABLE STL. COL. W/ MIN. CAPACITY OF 71.2kn [16,000lbs.] AT A MAX. EXTENSION OF 2318mm [7'-7 1/2"] CONFORMING TO CAN/CSG8-7.2.94, AND WITH 150x150x9.5 (6"x6"x3/8") STL. PLATE TOP & BOTTOM. 870x870x410 (34"x34"x16") CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 Kpa. MINIMUM AND AS PER SOILS REPORT.

STEEL BASEMENT COLUMN (SEE O.B.C. 9.15.3.3)
89mm (3-1/2") DIA x 4.78mm [1.88] FIXED STL. COL. WITH 150x150x9.5 (6"x6"x3/8") STL. TOP & BOTTOM PLATE ON 1070x1070x460 (42"x42"x18") CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 Kpa. MIN. AND AS PER SOILS REPORT.

15A. STEEL COLUMN
90mm (3-1/2") DIA x 4.78mm [1.88] NON-ADJUSTABLE STL. COL. TO BE ON 150x150x9.5 (6"x6"x3/8") STEEL TOP PLATE, & BOTTOM PLATE. BASE PLATE 120x250x12.5 (4 1/2"x10"x1/2") WITH 2-12mm DIA. x 300mm LONG x50mm HOOK ANCHORS [2-1/2"x1"x2"] FIELD WELD COL. TO BASE PLATE.

16. BEAM POCKET OR 300x150 (12"x6") POURED CONC. NIB WALLS. MIN. BEARING 90mm (3-1/2")

17. 19x64 (1"x3") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM.

18. GARAGE SLAB
100mm (4") 32MPa [4640psi] CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT.

19. GARAGE CEILINGS/INTERIOR WALLS
13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. TAPE AND SEAL ALL JOINTS AIRTIGHT PER O.B.C. 9.10.9.16. REFER TO SB-12, TABLE 2.1.1.2.A. FOR REQUIRED THERMAL INSULATION.

20. DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING PER OBC 9.10.13.15.

21. EXTERIOR STEP
PRECAST CONCRETE STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 200mm [7'-7/8"] MIN. TREAD 250mm [9'-1/2"]. SEE OBC. 9.8.9.2., 9.8.9.3. & 9.8.10.

22. DRYER EXHAUST (OBC-8.2.3.8.(7) & 6.2.4.1.1)
CAPPED DRYER EXHAUST VENTED TO EXTERIOR. (USE 100mm (4") DIA. SMOOTH WALL VENT PIPE)

23. INSULATED ATTIC ACCESS (OBC-9.19.2.1, & SB12-2.1.1.7)
ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x610mm (21 1/2"x24") & A MIN. AREA OF 0.32 SQ.M. (3.44 SQ.FT.) WITH WEATHERSTRIPPING. RSI 3.52 (R20) RIGID INSUL. BACKING.

24. FIREPLACE CHIMNEYS - OBC. 9.2.1.
TOP OF FIREPLACE CHIMNEY SHALL BE 915mm [3'-0"] ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm [2'-0"] ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm [10'-0"] FROM THE CHIMNEY.

25. LINEN CLOSET, 4 SHELVES MIN. 350mm [14"] DEEP.

26. MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC. 9.32.3.5. & 9.32.3.10.

27. STEEL BEARING PLATE FOR MASONRY WALLS
280x280x16 (11"x11"x5/8") STL. PLATE FOR STL BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL. ANCHORED WITH 2-19mm [3/4"] x 200mm [8"] LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

SOLID WOOD BEARING FOR WOOD STUD WALLS
SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPRISED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC 9.17.4.2(2).

28. RESERVED

29. BEARING WOOD POST (BASEMENT) (OBC 9.17.4.)
3-38x140 [3-2"x6"] BUILT-UP POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. BOLT, 610x610x300 [24"x24"x12"] CONC. FOOTING.

30. STEPPED FOOTINGS OBC 9.15.3.9.
MIN. HORIZ. STEP = 600mm [24"].
MAX. VERT. STEP = 600mm [24"]

31. SLAB ON GRADE
MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4") COARSE GRANULAR FILL. REINFORCED WITH 6x6-WY2.9xW2.9 MESH PLACED NEAR MID-DEPTH OF SLAB. CONC. STRENGTH 32 MPa [4640 psi] WITH 5-8% AIR ENTRAINMENT ON COMPACTED SUB-GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION UNDER SLAB.

32. DIRECT VENTING GAS FURNACE/ H.W.T VENT
DIRECT VENT FURNACE TERMINAL MIN. 900mm [36"] FROM A GAS REGULATOR, MIN. 300mm [12"] ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS, HRV INTAKE TO BE A MIN. OF 1830mm [6'-0"] FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.

33. DIRECT VENTING GAS FIREPLACE VENT
DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm [12"] FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

34. SUBFLOOR, JOIST STRAPPING AND BRIDGING
16mm (5/8") T & G SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION (* SEE OBC 9.30.6. *) 6mm (1/4") PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (* SEE OBC 9.30.2. *)
FLOOR JOISTS WITH SPANS OVER 2100mm (6'-11") TO BE BRIDGED WITH 38x38 (2"x2") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'-11") O.C. MAX. AND WHEN SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 19x64 (1"x3") @ 2100mm (6'-11") O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED. (* SEE OBC 9.23.9.4. *)

35. EXPOSED BUILDING FACE OBC. 9.10.15. & SB-2-2.3.5.(2)
EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE (LD) IS LESS THAN 1.2M [3'-11"]. WHERE THE LD IS LESS THAN 600mm [1'-11"] THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES. OFFENDING GARAGE WALLS INCLUDED.

36. COLD CELLAR PORCH SLAB (OBC 9.40.)
FOR MAX. 2500mm [8'-2"] PORCH DEPTH [SHORTEST DIM.], 150mm (6") 32MPa [4640psi] CONC. SLAB WITH 5-8% AIR ENTRAINMENT. REINF. WITH 10M BARS @ 200mm [7 7/8"] O.C. EACH WAY IN BOTTOM THIRD OF SLAB. MIN. 30mm [1 1/4"] COVER. 600x600 [23 5/8"x23 5/8"] 10M DOWELS @ 600mm [23 5/8"] O.C., ANCHORED IN PERIMETER FDTN. WALLS. SLOPE SLAB MIN. 1.0% FROM HOUSE WALL. SLAB TO HAVE MIN. 75mm [3"] BEARING ON FDTN. WALLS. PROVIDE [L7] Lintel OVER CELLAR DOOR WITH 100mm [4"] END BEARING.

THE FDTN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm [3-1/2"] THICK TO A MAX. DEPTH OF 600mm (24") AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm [8"] O.C. VERTICALLY AND 900mm [36"] O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

38. CONVENTIONAL ROOF FRAMING (2.0Kpa. SNOW LOAD)
38x140 [2"x6"] RAFTERS @ 400mm [16"] O.C. FOR MAX 11'-7" SPAN. 38x184 [2"x8"] RIDGE BOARD, 38x89 (2"x4") COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 (2"x4") @ 400mm [16"] O.C. FOR MAX. 2830mm [9'-3"] SPAN & 38x140 [2"x6"] @ 400 [16"] O.C. FOR MAX. 4450mm [14'-7"] SPAN
RAFTERS FOR BUILT-UP ROOF TO BE 38x89 (2"x4") @ 600mm [24"] O.C. WITH A 38x89 (2"x4") CENTRE POST TO THE TRUSS BELOW, LATERALLY BRACED @ 1800mm [6'-0"] O.C. VERTICALLY.

GENERAL NOTES

WINDOWS: 1) MINIMUM BEDROOM WINDOW -OBC. 9.9.10.1.-
AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.35m2 UNOBSTRUCTED GLAZED OR OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380 mm [1'-3"].
2) WINDOW GUARDS -OBC. 9.8.8.1.(6).
A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm [1'-7"] ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm [5'-11"]
3) EXTERIOR WINDOWS
SHALL COMPLY WITH OBC DIV.-8.9.7.3. & SB12-2.1.1.8

GENERAL: 1) MECHANICAL VENTILATION IS REQUIRED TO COMPLY WITH OBC-DIV. 6, 6.2.2. SEE MECHANICAL DRAWINGS.
2) ALL DOWNSPOUTS TO DRAIN AWAY FROM THE BUILDING AS PER OBC 9.26.18.2. & 5.6.2.2.(3) & MUNICIPAL STANDARDS.
3) ALL WINDOW WELLS TO DRAIN TO FOOTING LEVEL PER OBC 9.14.6.3. CHECK WITH THE LOCAL AUTHORITY.
4) STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM
REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM. REFER TO OBC. 9.5.2.3.3, 3.8.3.8.(1)(c) & 3.8.3.13.(1)(f). SEE DETAIL.
5) ALL EXTERIOR DOORS TO COMPLY WITH THERMAL RESISTANCE AS STATED IN O.B.C. SB-12-2.1.1.9.
6) ALL AIR BARRIER SYSTEMS ARE REQUIRED TO COMPLY WITH O.B.C. DIV.-8.9.25.3.



LUMBER: 1) ALL LUMBER SHALL BE SPRUCE NO.2 GRADE, UNLESS NOTED OTHERWISE.
2) STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED OTHERWISE.
3) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE No.2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.
4) ALL LAMINATED VENEER LUMBER (L.V.L.) BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY TRUSS MANUFACTURER.
5) LVL BEAMS SHALL BE 2.0E-2950Fb MIN., NAIL EACH PLY OF LVL WITH 89mm (3 1/2") LONG COMMON WIRE NAILS @ 300mm [12"] O.C. STAGGERED IN 2 ROWS FOR 184, 240 & 300mm [7 1/4", 9 1/2", 11 7/8"] DEPTHS AND STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS ADD 13mm [1/2"] DIA. GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm [3'-0"] O.C.
6) PROVIDE FACE MOUNT BEAM HANGERS TYPE "SCL" MANUFACTURED BY SIMPSON STRONG-TIE OR EQUAL FOR ALL LVL BEAM TO BEAM CONNECTIONS UNLESS OTHERWISE NOTED. REFER TO ENG. FLOOR LAYOUTS.
7) JOIST HANGERS: PROVIDE METAL HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP WOOD MEMBERS.
8) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONCRETE BY AT LEAST 2 ml. POLYETHYLENE FLUA, No. 50 (45lbs) RO. IN ROOFING OR OTHER DAMPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 150mm [6"] ABOVE THE GROUND.

STEEL: 1) STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA-G40-21 GRADE 300W. HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO CSA-G40.21 GRADE 350W "STRUCTURAL QUALITY STEEL". OBC. 8-9.23.4.3.
2) REINFORCING STEEL SHALL CONFORM TO CSA G30-18M GRADE 400R.

STUCCO: 1) ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

LEGEND	
	CLASS "B" VENT
	EXHAUST FAN TO EXTERIOR
	DUPLEX OUTLET (HEIGHT A.F.F)
	WEATHERPROOF DUPLEX OUTLET
	POT LIGHT
	LIGHT FIXTURE (PULL CHAIN)
	SWITCH
	FLOOR DRAIN
	SJ SINGLE JOIST
	DJ DOUBLE JOIST
	TJ TRIPLE JOIST
	LVL LAMINATED VENEER LUMBER
	POINT LOAD FROM ABOVE
	P.T. PRESSURE TREATED LUMBER
	G.T. GIRDER TRUSS BY ROOF TRUSS MANUF.
	FLAT ARCH
	CURVED ARCH
	M.C. MEDICINE CABINET (RECESSED)
	CONC. BLOCK WALL
	DOUBLE VOLUME WALL
	SEE NOTE (39.)
	SOLID WOOD BEARING (SPRUCE No. 2). SOLID BEARING TO BE AS WIDE AS SUPPORTED MEMBER OR AS DIRECTED BY STRUCTURAL ENGINEER. SOLID BEARING TO BE MINIMUM 2 PIECES.
	SOLID WOOD BEARING TO MATCH FROM ABOVE







CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB AND REPORT ANY DISCREPANCY TO VA3 DESIGN BEFORE PROCEEDING WITH THE WORK. ALL DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND THE PROPERTY OF VA3 DESIGN WHICH IF REQUESTED MUST BE RETURNED AT THE COMPLETION OF THE WORK. ALL DRAWINGS TO BE USED FOR CONSTRUCTION

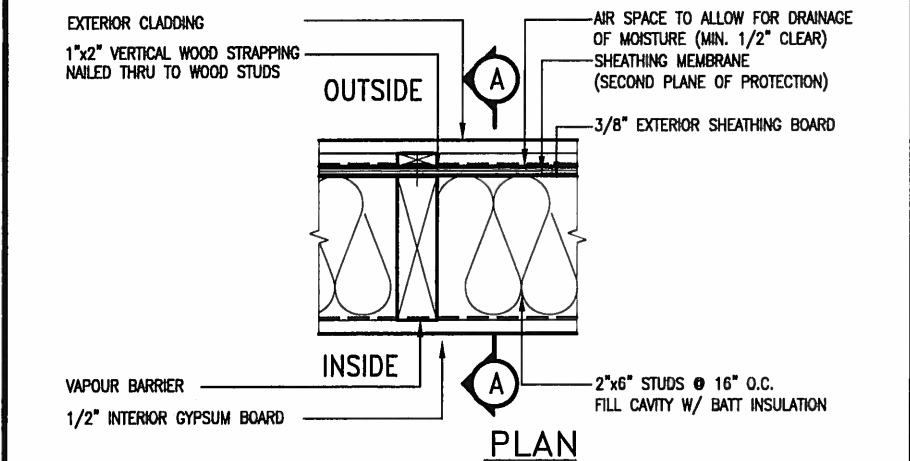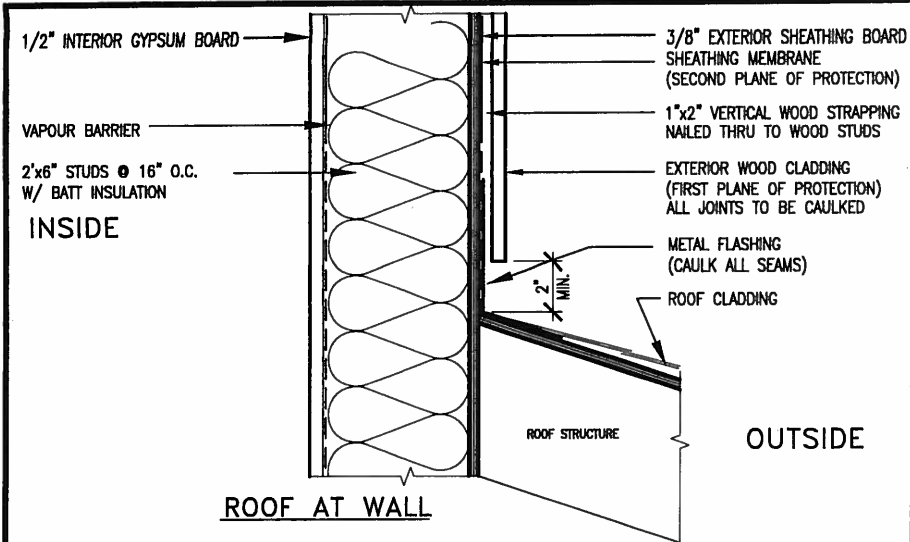

EXTERIOR WOOD CLADDING WALL ASSEMBLY

STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM.

REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM. FUTURE GRAB BARS TO BE MOUNTED TO RESIST HORIZ. AND VERT. LOADS OF 1.3 KN (300 lb). REFER TO OBC, DIV. B-9.5.2.3., WATER CLOSET 3.8.3.8.(3)(a) & 3.8.3.8.(3)(c), SHOWER 3.8.3.13.(2)(f), BATHTUB & 3.8.3.13.(4)(c), AND DETAILS PROVIDED.

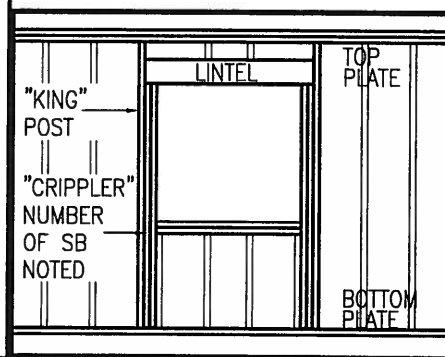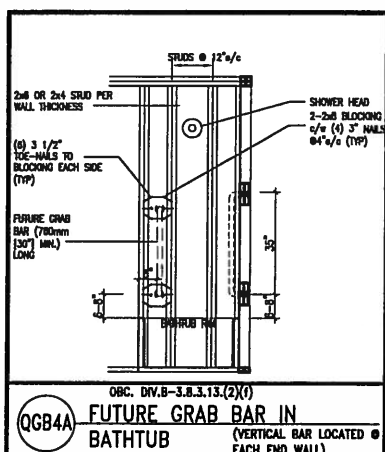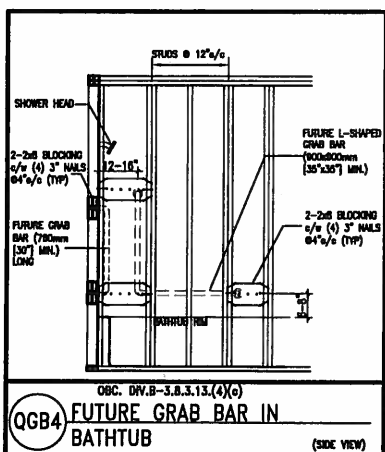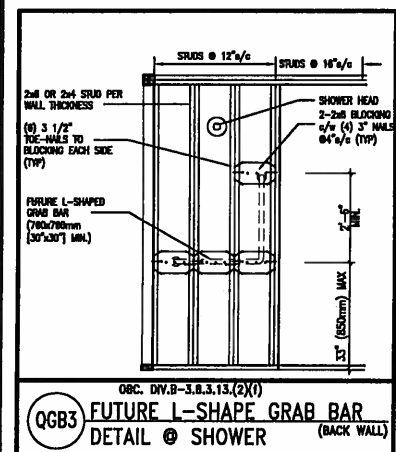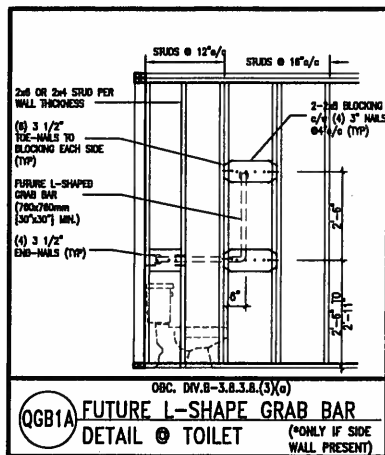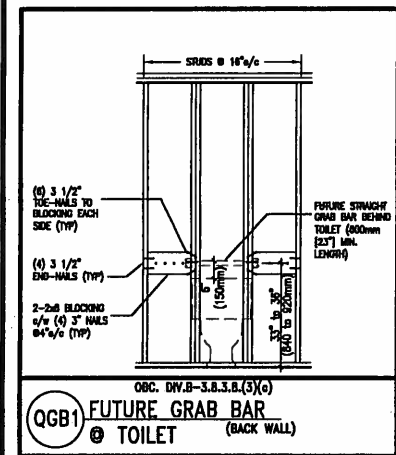

MAX. HEIGHT FOR 2"x4" GARAGE WALL IS AS FOLLOW:

- 2"x4" @ 16" O.C. - 9'-10"
- 2"x4" @ 12" O.C. - 10'-9"
- 3"x4" @ 16" O.C. - 11'-2"
- 3"x4" @ 12" O.C. - 12'-4"

NOTES:

- FOR ROOF DESIGN SNOW LOAD OF 2.5 KPa. SUPPORTED ROOF TRUSS LENGTH OF 6.0m AND FLOOR JOIST LENGTH OF 2.5m OF ONE FLOOR.
- PROVIDE HORIZONTAL SOLID BLOCKING @ 1200 O.C. (4'-0")
- PROVIDE A MINIMUM OF 9.5mm (3/8") PLYWOOD OR OSB EXTERIOR SHEATHING ON THE EXTERIOR FACE.
- FOR A 1/50 YEAR REFERENCE WIND PRESSURE OF 0.6 KPa.
- STUDS GREATER THAN 9'-10" HIGH TO BE No. 2 SPF
- STUD SPECIFICATION IS SUITABLE FOR BRICK VENEER OR SIDING.

**** MAX. HEIGHT FOR 2"x6" EXTERIOR WALL IS AS FOLLOW:**

- 2"x6" @ 16" O.C. - 12'-6"
- 2"x6" @ 12" O.C. - 13'-10"
- 2"x6" @ 16" O.C. - 15'-0"
- 2"x6" @ 12" O.C. - 17'-4"

MAX. HEIGHT FOR 2"x8" EXTERIOR WALL IS AS FOLLOWS:

- 2"x8" @ 16" O.C. - 16'-0"
- 2"x8" @ 12" O.C. - 17'-9"
- 2"x8" @ 16" O.C. - 20'-4"
- 2"x8" @ 12" O.C. - 22'-4"

NOTES:

- FOR ROOF DESIGN SNOW LOAD OF 2.5 KPa
- SUPPORTED ROOF TRUSS LENGTH OF 6.0m ONLY.
- PROVIDE HORIZONTAL SOLID BLOCKING @ 1200 O.C. (4'-0")
- PROVIDE A MINIMUM OF 9.5mm (3/8") PLYWOOD OR OSB EXTERIOR SHEATHING ON THE EXTERIOR FACE AND 12.5mm (1/2") GYPSUM BOARD ON THE INTERIOR FACE.
- WALL FRAMING SHALL CONFORM TO OBC 9.23.10.1.(2)
- FOR A 1/50 YEAR REFERENCE WIND PRESSURE OF 0.6 KPa
- STUDS GREATER THAN 9'-10" HIGH TO BE No. 2 SPF.
- STUD SPECIFICATION IS SUITABLE FOR BRICK VENEER OR SIDING.

** STUD INFORMATION TAKEN FROM OBC TABLE A-30

"CRIPPLE" DETAIL




OCT 29, 2015

9			
8			
7			
6			
5			
4			
3			
2	UPDATE TO CODE	APR 16-15	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	
qualification information	
Wellington Jno-Baptiste	25591
name	BCM
registration information	
VA3 Design Inc.	42658
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com


BAYVIEW WELLINGTON		CONST NOTE	
project name	GREEN VALLEY ESTATES	municipality	BRADFORD
date	APR 2014	project no.	13045
drawn by	RC	checked by	scale
3/16" = 1'-0"		CONSTRUCTION NOTES	file name
13045-CONST-OBC 2015		drawing no.	CN2
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Thu - Apr 16 2015 - 6:56 AM			

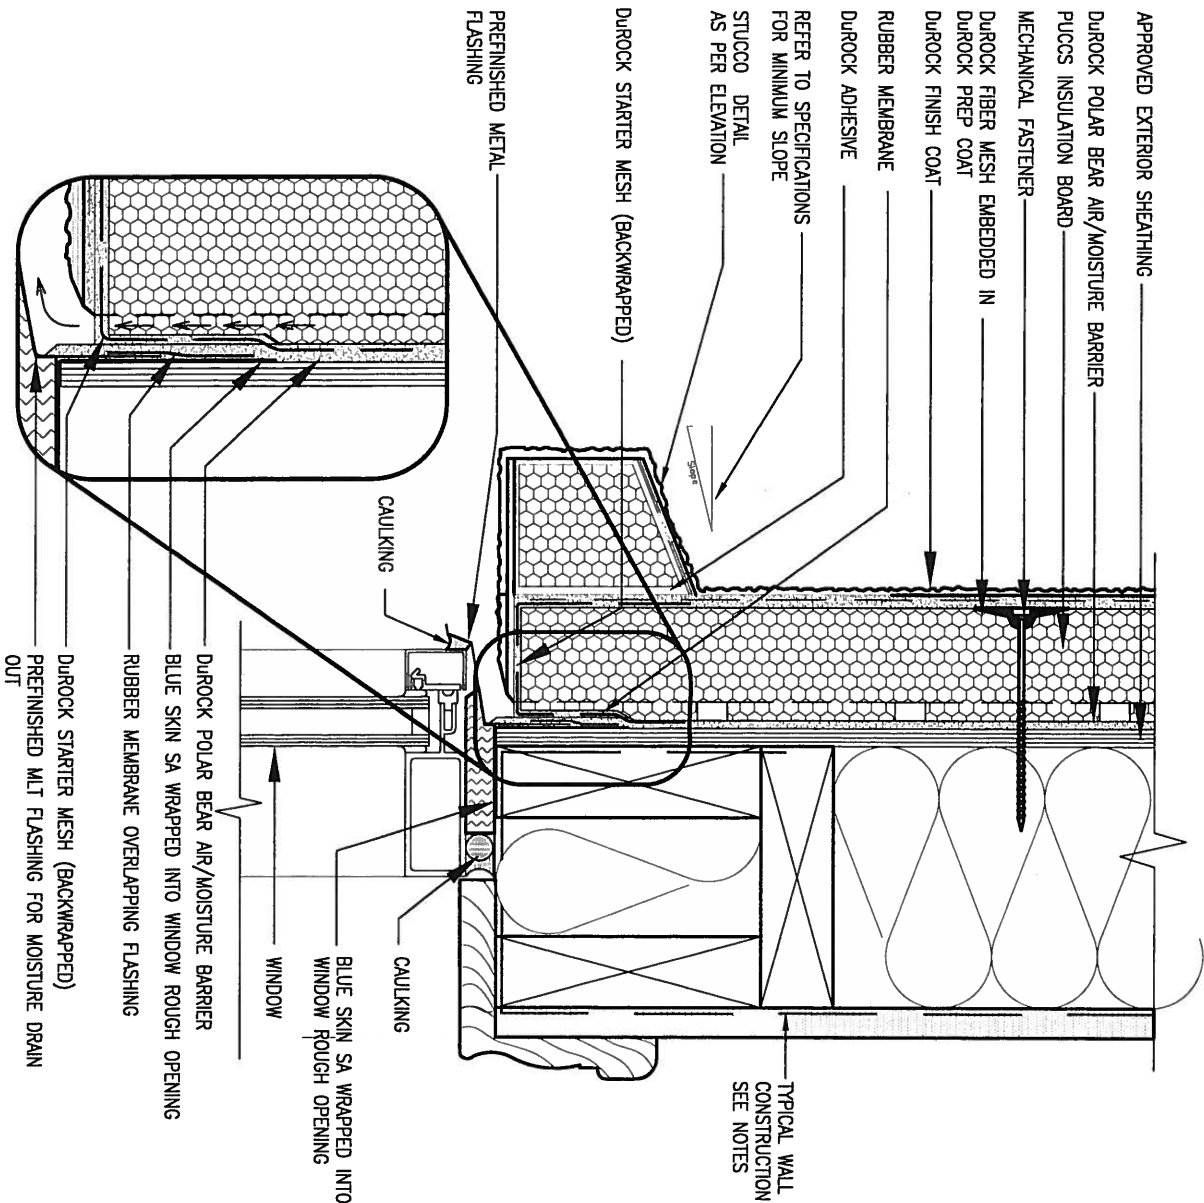

1 WINDOW HEADER

CN3 SCALE: 3"=1'-0"

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.
DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

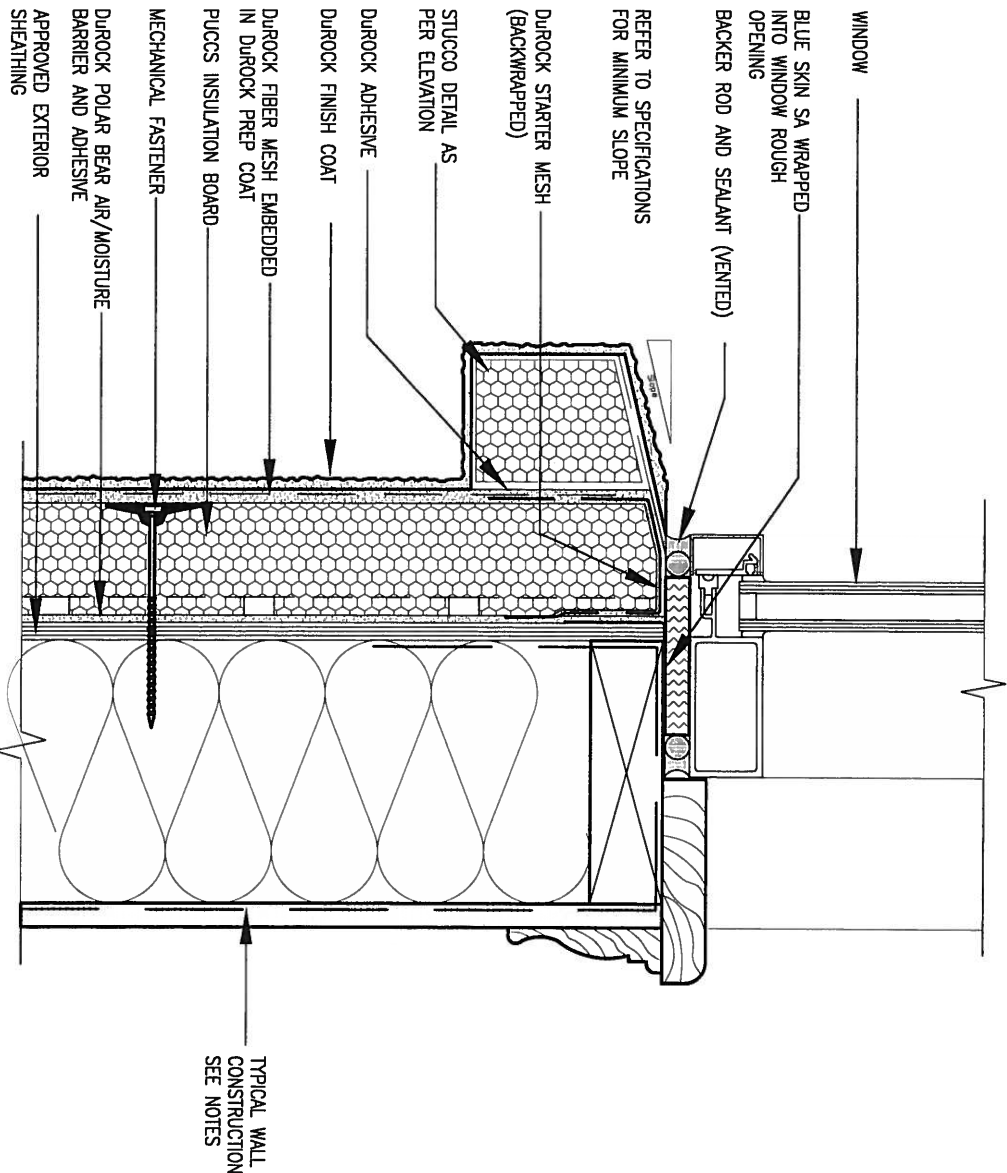

2 WINDOW SILL

CN3 SCALE: 3"=1'-0"

9.	.	.	.
8.	.	.	.
7.	.	.	.
6.	.	.	.
5.	.	.	.
4.	.	.	.
3.	.	.	.
2	UPDATE TO CODE	APR 16-15	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.			
qualification information			
Wellington Jno-Baptiste		25591	
signature		BCN	
name		42658	
registration information			
VA3 Design Inc.			
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.			


VA3
DESIGN

300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

CONST NOTE

project name	GREEN VALLEY ESTATES	municipality	BRADFORD	project no.	13045
date	APR 2014	scale	3/16" = 1'-0"	drawing no.	CN3
drawn by	RC	checked by	-	CONSTRUCTION NOTES	
13045-CONST-OBC 2015					
RICIARD - H:\ARCHIVE\WORKING\2013\13045.DW\units\13045-CONST-OBC 2015.dwg - Thu - Apr 16 2015 - 6:57 AM					

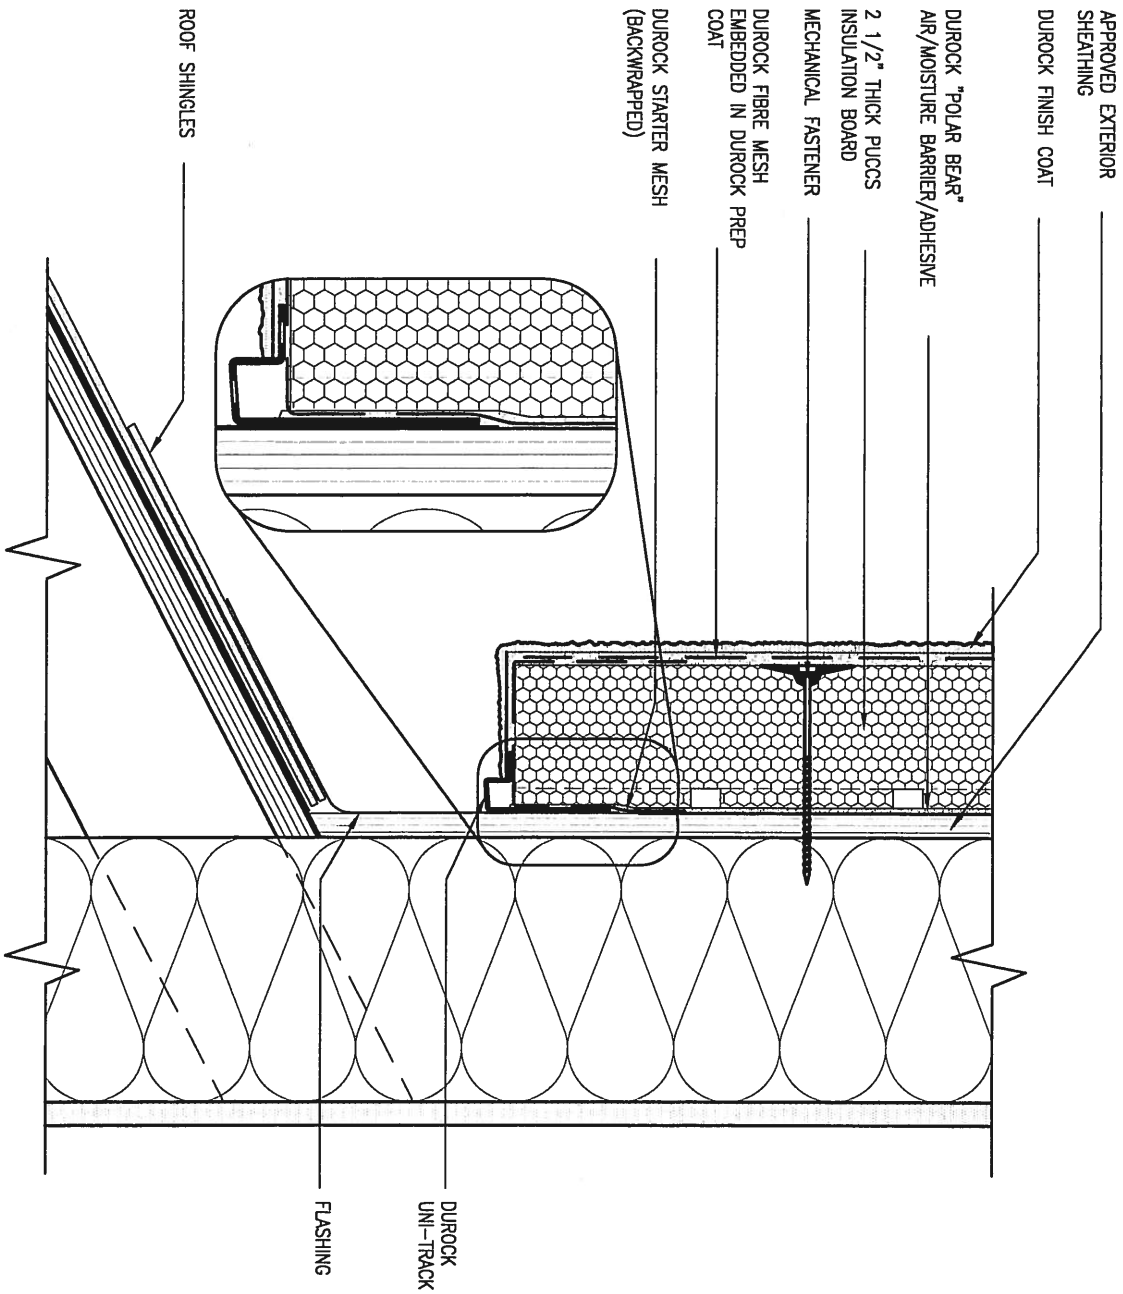


3 STUCCO TERMINATION @ ROOF

CN4 SCALE: 3"=1'-0"

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

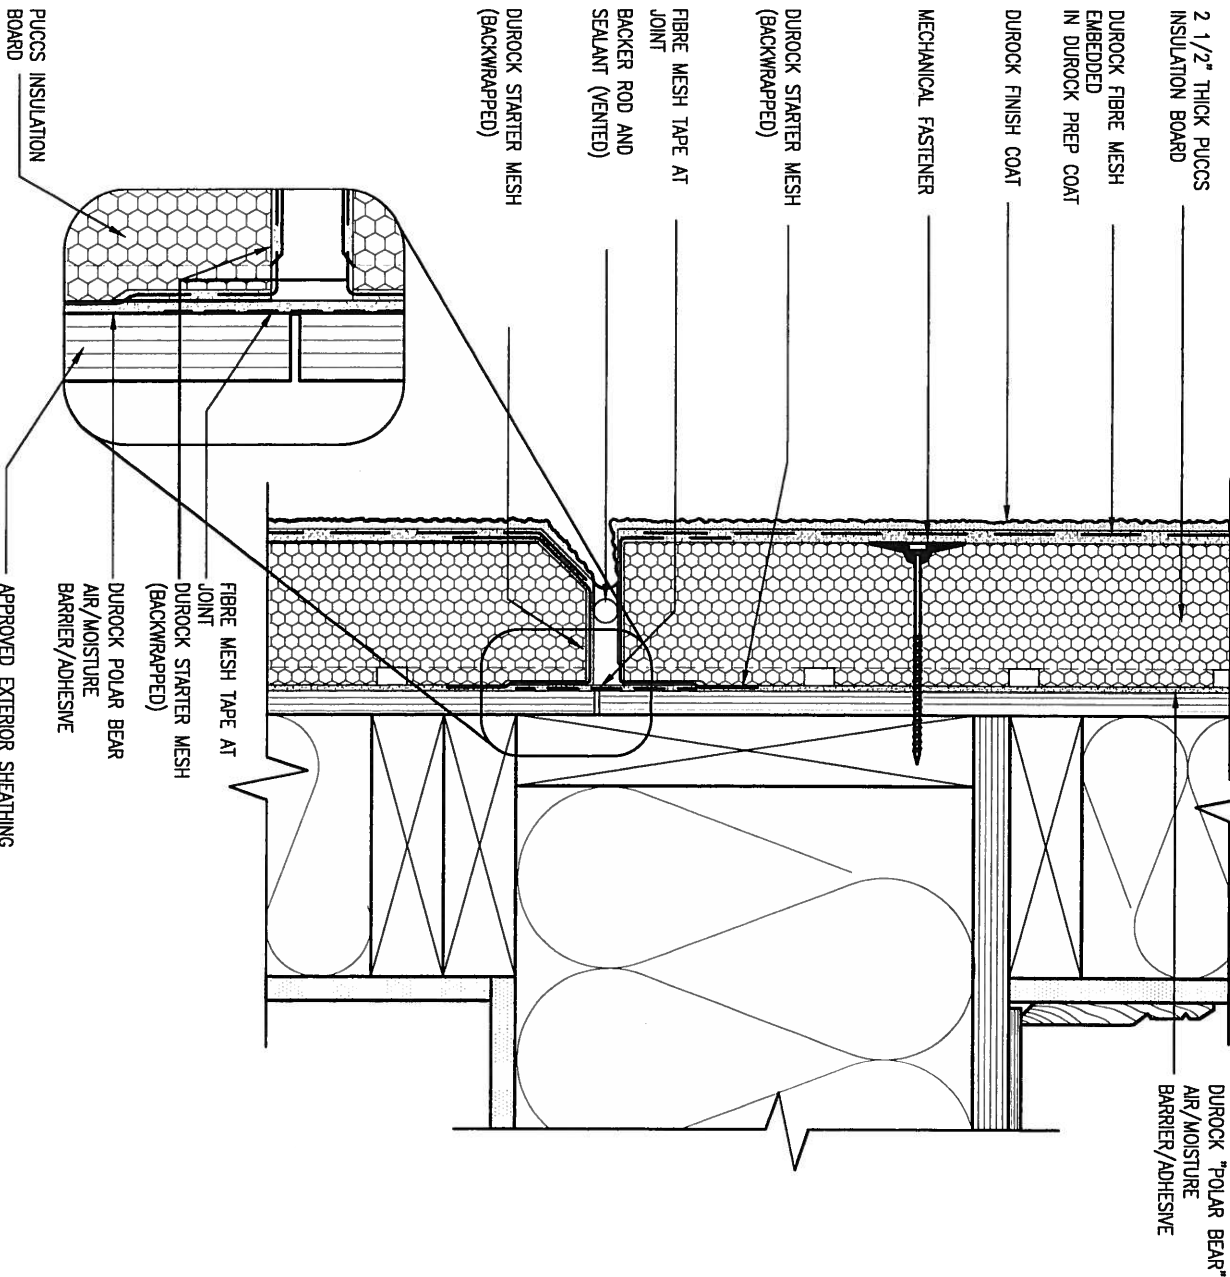

4 HORIZONTAL EXPANSION JOINT

CN4 SCALE: 3"=1'-0"

9.	.	.	.
8.	.	.	.
7.	.	.	.
6.	.	.	.
5.	.	.	.
4.	.	.	.
3.	.	.	.
2.	UPDATE TO CODE	APR 16-15	RC
1.	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.			
qualification information			
Wellington Jno-Baptiste		25591	BCIN
name			
registration information		42658	
VA3 Design Inc.			
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.			

VA3 DESIGN

300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

project name **GREEN VALLEY ESTATES** municipality **BRADFORD**

date **APR 2014** scale **3/16" = 1'-0"**

drawn by **RC** checked by **-**

CONSTRUCTION NOTES

file name **13045-CONST-OBC 2015**


RICIARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Thu - Apr 16 2015 - 6:57 AM

CONST NOTE

project no. **13045**

drawing no.

CN4

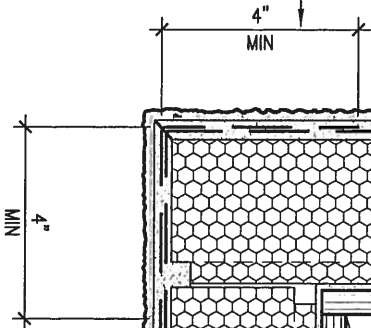


CNS

SCALE: 3"=1'-0"

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

DETAILS ARE BASED ON DUROCK PUCCS SYSTEM



CNS

SCALE: 3"=1'-0"

9	.	.	.	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
8	.	.	.	
7	.	.	.	qualification information
6	.	.	.	Wellington Jno-Baptista 25591
5	.	.	.	name signature BCIN
4	.	.	.	registration information
3	.	.	.	VAS Design Inc. 42658
2	UPDATE TO CODE		APR 16-15	RC
1	ISSUE FOR CLIENT REVIEW		MAY 07-14	RC
no.	description		date	by

qualification information

Wilmington One Baptist Church

VA3 Design Inc. 426

Contractor must verify all dimensions on the job and report any discrepancies to the Designer before proceeding with the work. All

of the Designer which must be returned at the completion of the work.

All c

300A Wilson Avenue

1000

BAYVIEW WELLINGTON

CONST NOTE

project name
GREEN VALLEY ESTATES

municipality
BRADFORD

project no.
13045

date
APR 2014

RC

—

3/16"

$$= 1' - 0'$$

CONSTRUCTION NOTES

13045-CONST-ORC 2015


1000

CN5

RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Thu - Apr 16 2015 - 6:57 AM

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

SB12-COMPLIANCE PACKAGE 'J'

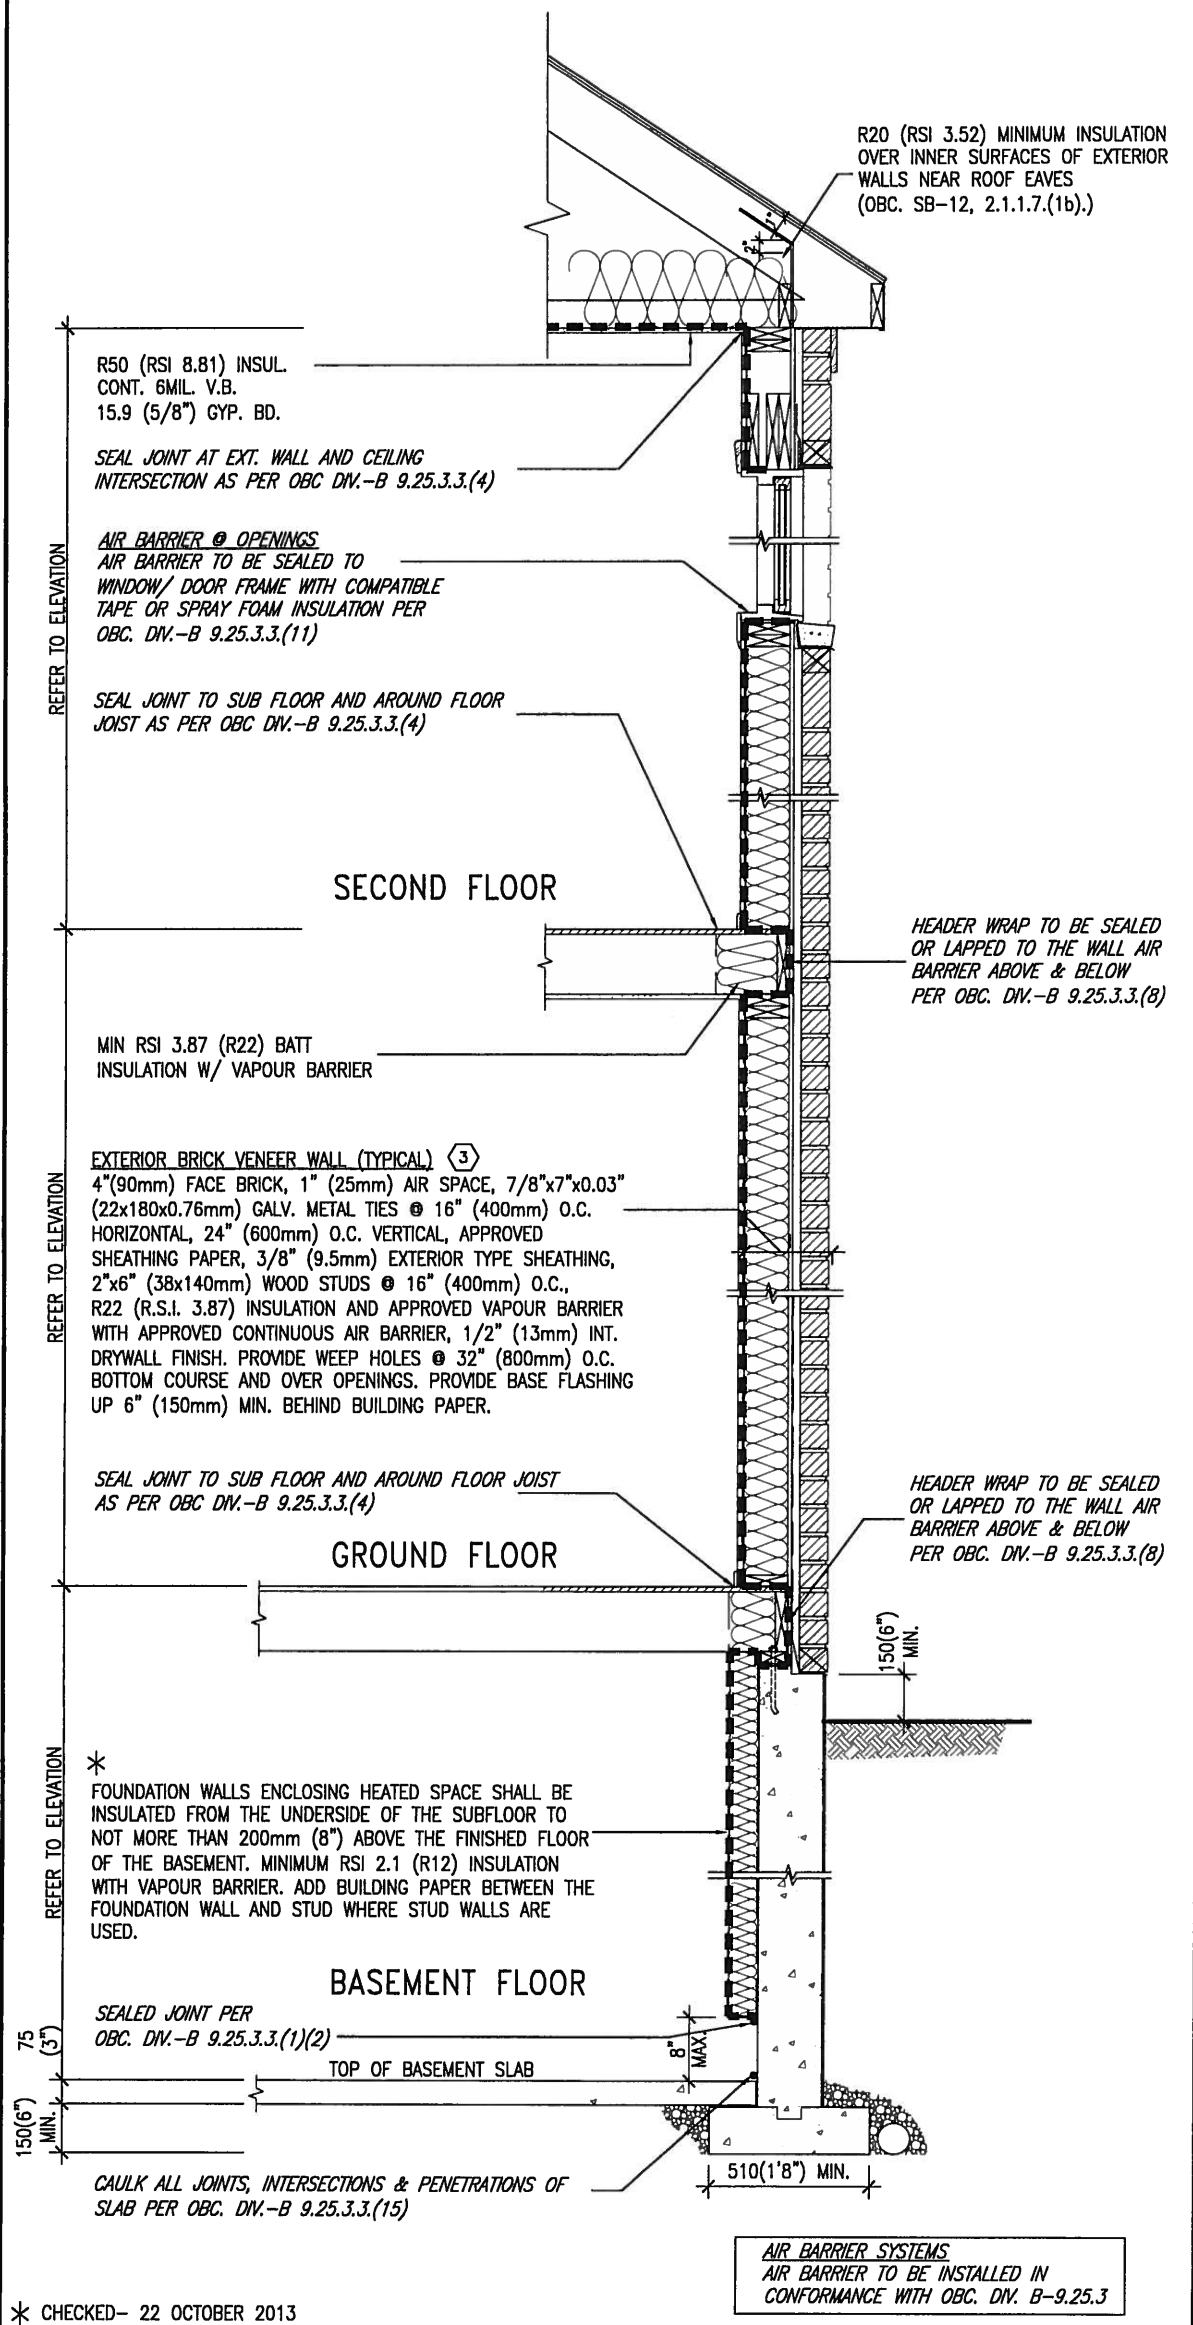

EW TYPICAL EXT. WALL AIR BARRIER CONTINUITY SECTION W/ BRICK VENEER SCALE: N.T.S.

SEMI & SINGLES ONLY


THE MINIMAL THERMAL PERFORMANCE OF BUILDING ENVELOPE AND EQUIPMENT SHALL CONFORM TO THE FOLLOWING SB-12 COMPLIANCE PACKAGE AS PER OBC SUPPLEMENTARY STANDARD SB-12, SECTION 2.1.1.1

USE SB-12 COMPLIANCE PACKAGE (J):

COMPONENT	J	Notes:
Ceiling with Attic Space Minimum RSI (R) value	8.81 (R50)	BLOWN -LOOSE
Ceiling without Attic Space Minimum RSI (R) value	5.46 (R31)	BATT or SPRAY
Exposed Floor Minimum RSI (R) value	5.46 (R31)	BATT or SPRAY
Walls Above Grade Minimum RSI (R) value	3.87 (R22)	6" R22 BATT
Basement Walls Minimum RSI (R) value	2.11 (R12)	4" R12 BLANKET
Edge of Below Grade Slab ≤600mm below grade Minimum RSI (R) value	1.76 (R10)	RIGID INSUL
Windows & Sliding glass Doors Maximum U-value	1.8	DOUBLE PANE LOW EMISSVITY
Skylights Maximum U-value	2.8	DOUBLE PANE LOW EMISSVITY
Space Heating Equipment Minimum AFUE	94%	NATURAL GAS
Hot Water Heater Minimum EF	0.67	NATURAL GAS
HRV Minimum Efficiency	60%	-



OCT 29, 2015

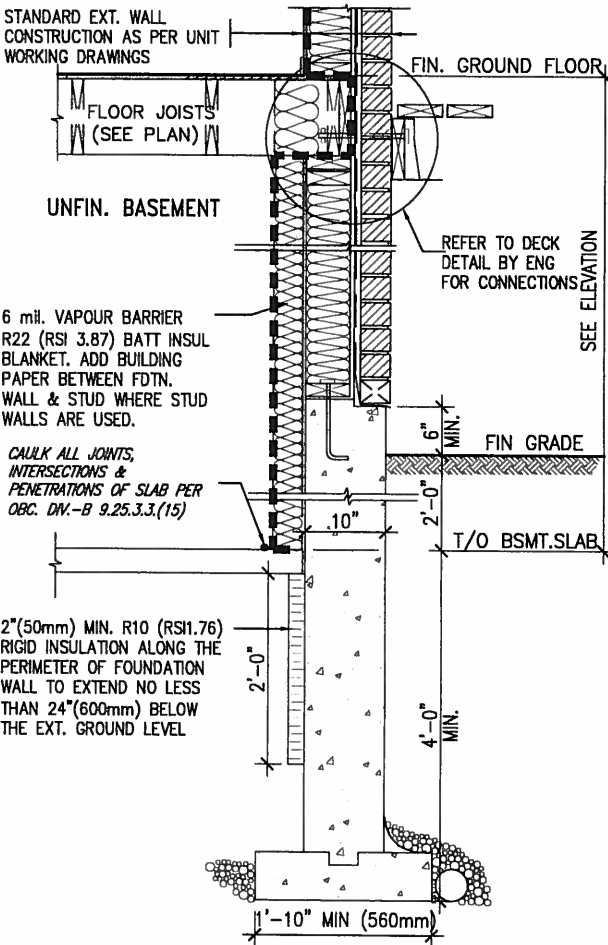

* REVISED- 15 MARCH 2013

SECTION AT W.O.D/W.O.B.


9	.	.	.
8	.	.	.
7	.	.	.
6	.	.	.
5	.	.	.
4	.	.	.
3	.	.	.
2	UPDATE TO CODE	APR 16-15	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
qualification information
Wellington Jno-Baptiste 25591
name
registration information
VA3 Design Inc. 42658
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON		CONST NOTE	
project name GREEN VALLEY ESTATES	municipality BRADFORD	project no. 13045	
date APR 2014	checked by RC	scale 3/16" = 1'-0"	CONSTRUCTION NOTES file name 13045-CONST-OBC 2015
drawing no. CN6			


COMPLIANCE TO OBC SB-12 2.1.1.1(11)

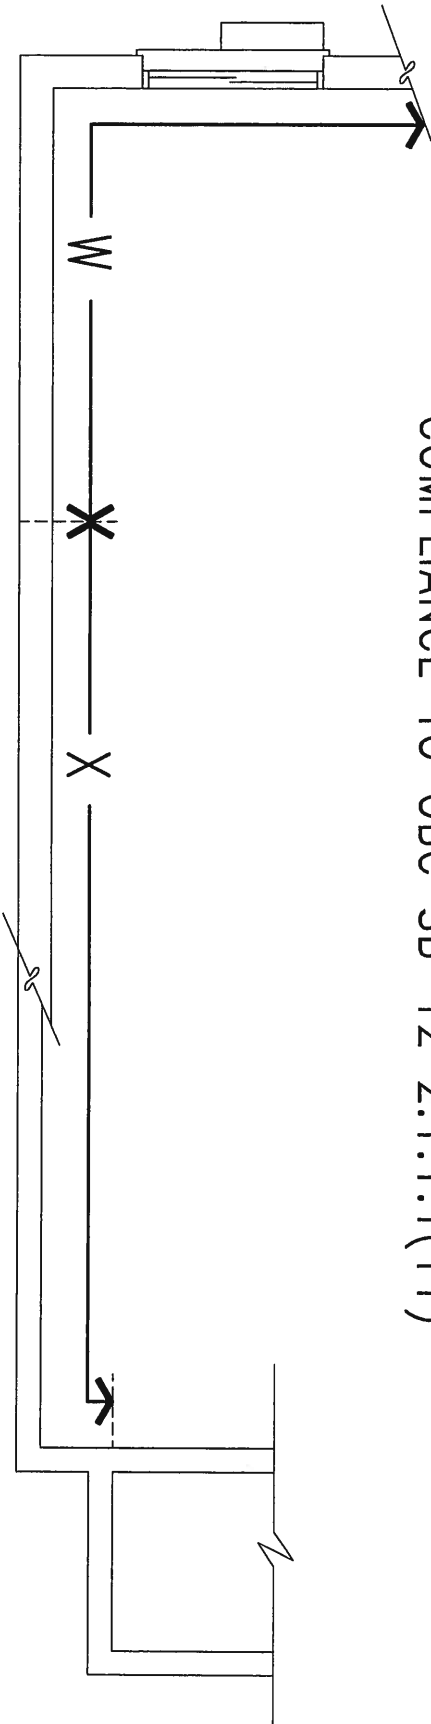

WOB PLAN



OCT 29, 2015

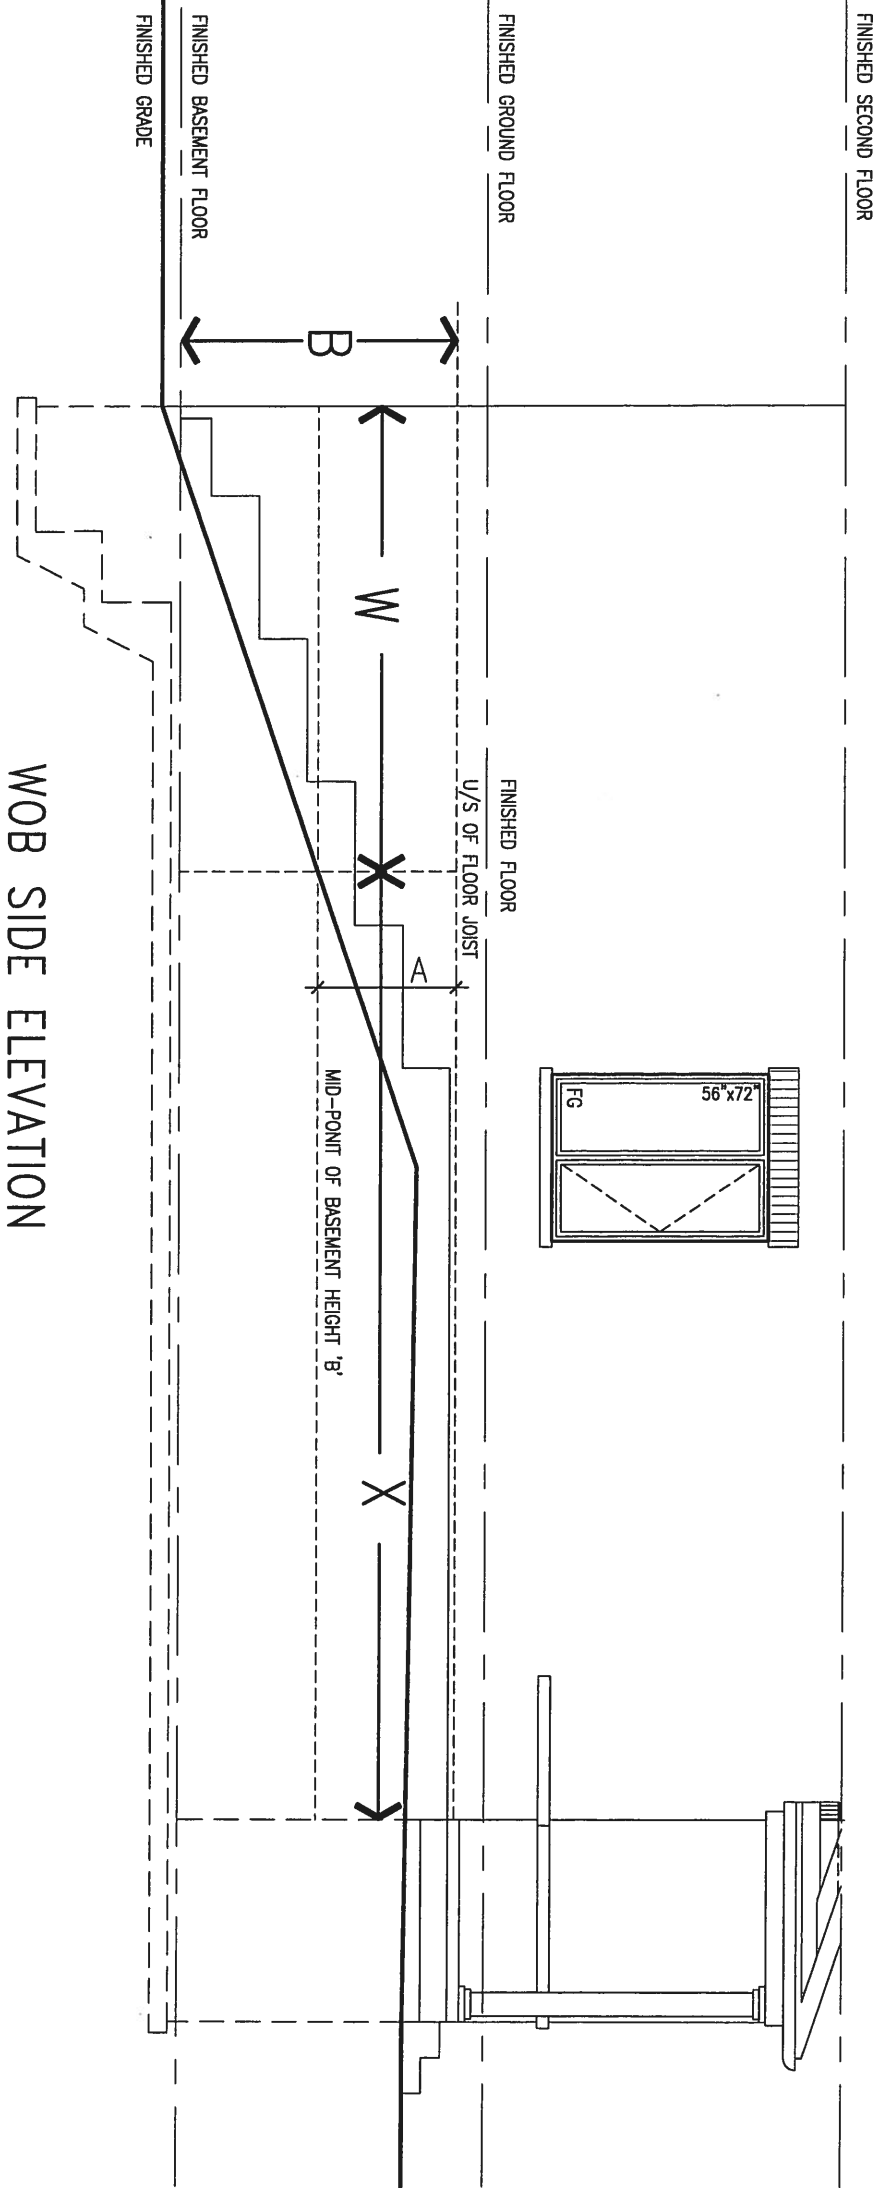

WOB SIDE ELEVATION

WHEN EXPOSED WALL "A" IS GREATER THAN 50% OF BASEMENT WALL HEIGHT "B" INSULATION VALUE FOR WALL IN SECTION "W" IS NOT LESS THAN IS REQUIRED FOR ABOVE GRADE WALL AS REQUIRED BY TABLE 2.1.1.2A



WHEN EXPOSED WALL "A" IS LESS THAN 50% OF BASEMENT WALL HEIGHT "B" INSULATION VALUE FOR WALL IN SECTION "X" IS NOT LESS THAN BASEMENT WALL AS REQUIRED BY TABLE 2.1.1.2A

9	.	.	.
8	.	.	.
7	.	.	.
6	.	.	.
5	.	.	.
4	.	.	.
3	.	.	.
2	UPDATE TO CODE	APR 16-15	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and taken responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.		
qualification information		
Wellington Jno-Baptiste	25591	BCIN
name registration information		
VA3 Design Inc.	42658	
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.		

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON		CONST NOTE	
project name	GREEN VALLEY ESTATES	municipality	BRADFORD
date	APR 2014	project no.	13045
drawn by	RC	checked by	-
scale	3/16" = 1'-0"	file name	13045-CONST-OBC 2015
CONSTRUCTION NOTES			
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Thu - Apr 16 2015 - 6:56 AM			
drawing no.			CN7

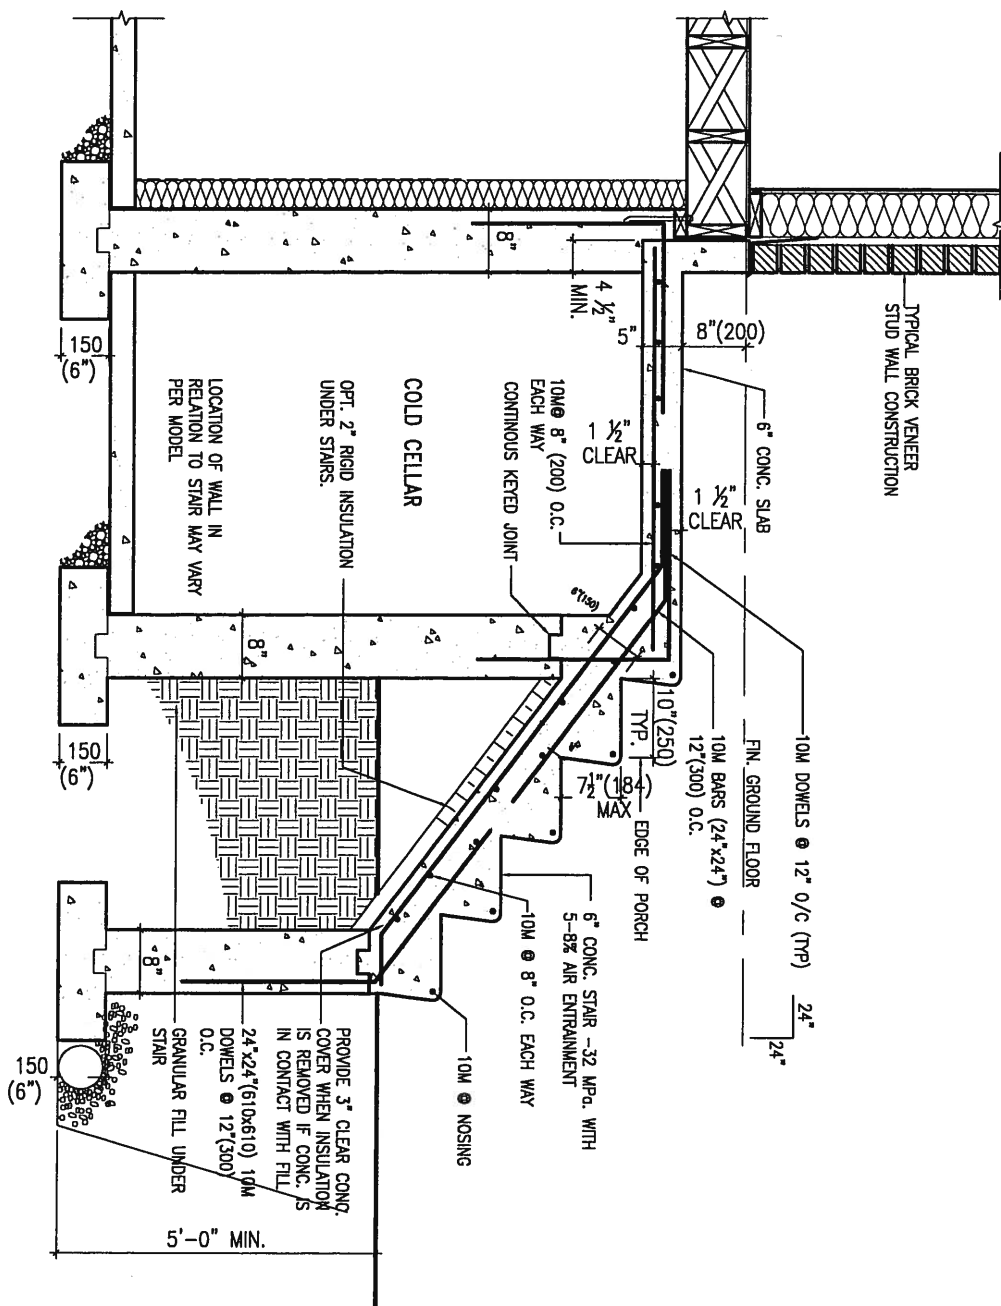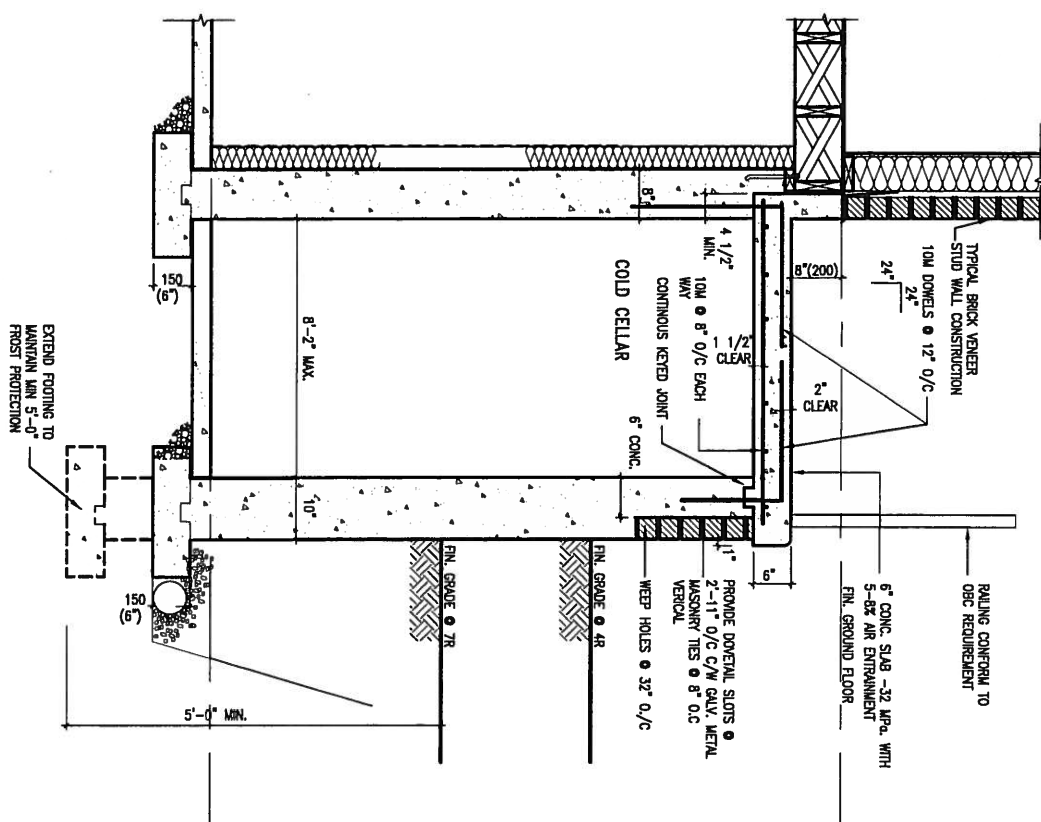


OCT 29, 2015



9	.	.	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	 VA3 DESIGN 300A Wilson Avenue Toronto ON M3H 1S8 t 416.630.2255 f 416.630.4782 va3design.com	BAYVIEW WELLINGTON project name GREEN VALLEY ESTATES date APR 2014 drawn by RC checked by - scale 3/16" = 1'-0"	CONST NOTE municipality BRADFORD CONSTRUCTION NOTES file name 13045-CONST-0BC 2015	project no. 13045 drawing no. CN8
8	.	.	qualification information				
7	.	.	Wellington Jno-Baptiste  25591				
6	.	.	name				
5	.	.	signature				
4	.	.	BCN				
3	.	.	registration information				
2	UPDATE TO CODE	APR 16-15	RC	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	VA3 Design Inc. 42658		
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC				
no.	description	date	by				

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

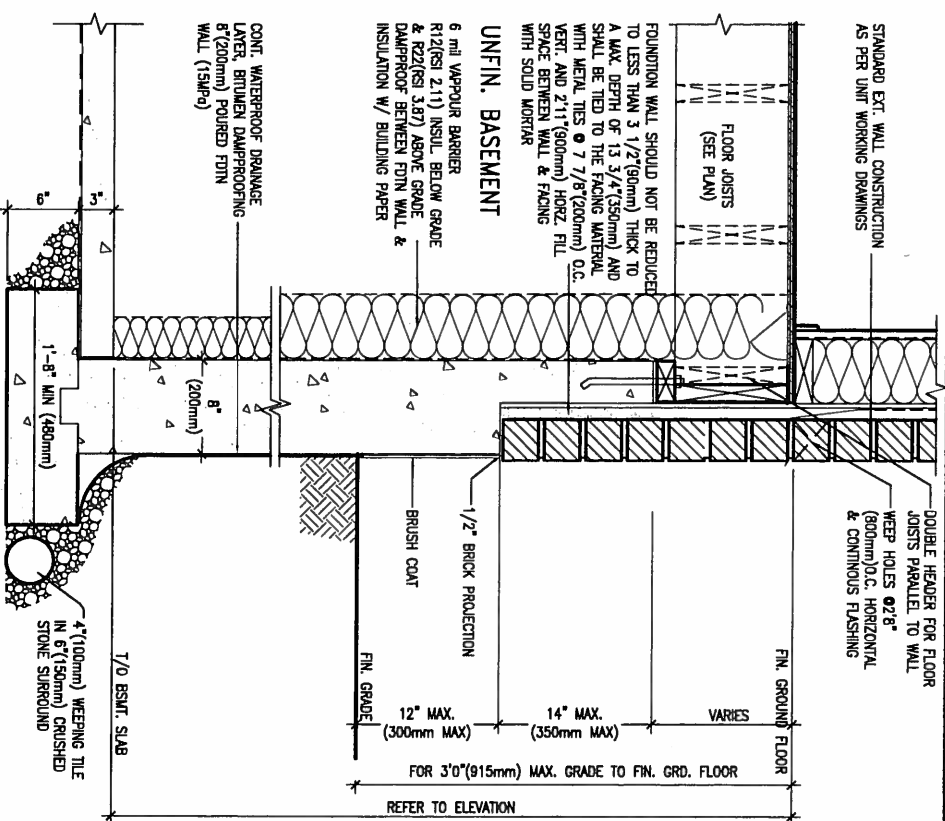

WALK-OUT DECK WALL SECTION FOR
GRADE TO FIN. FLOOR 3'0" (900mm)

MAX. HEIGHT DIFFERENCE

OCT 29, 2015

OCT 29, 2015


RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-08C 2015.dwg - Mon - May 4 2015 - 4:04 PM

300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com


Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

9	.	.	.
8	.	.	.
7	.	.	.
6	.	.	.
5	.	.	.
4	.	.	.
3	.	.	.
2	UPDATE TO CODE	APR 16-15	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission

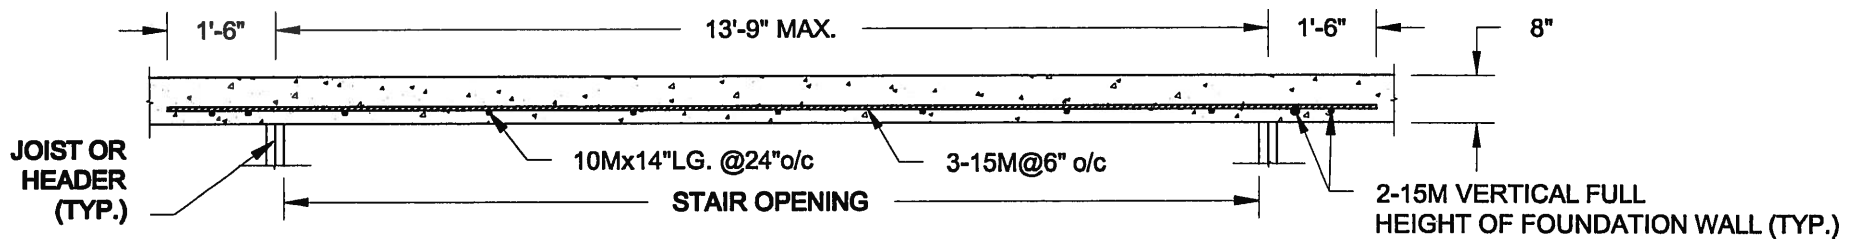


PLAN VIEW
NOT TO SCALE

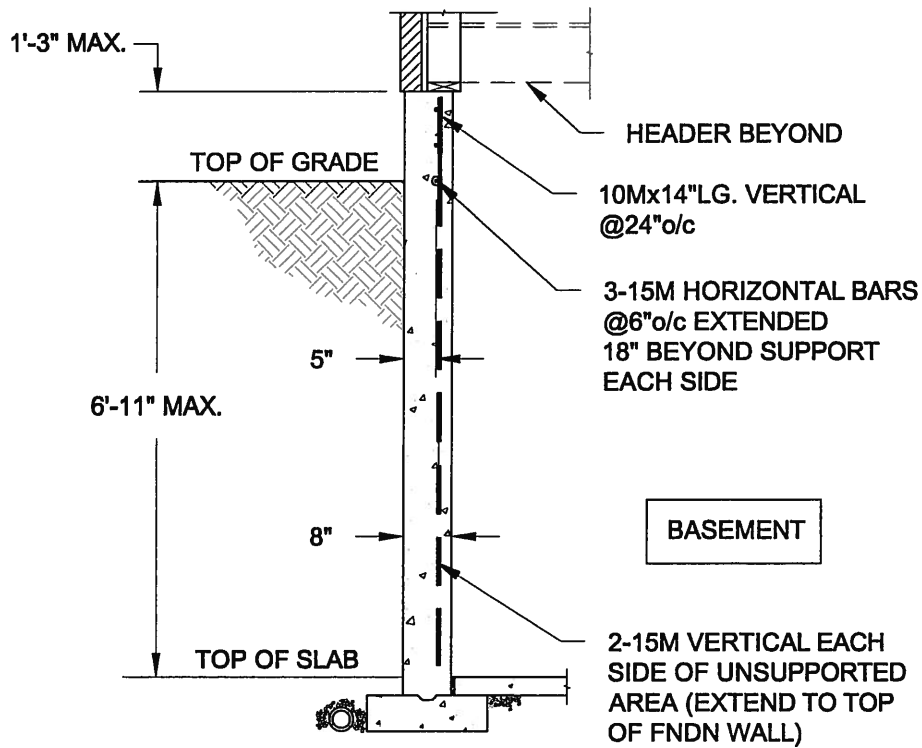


NOTE:

1. CONFORM TO ONTARIO BUILDING CODE, 2012.
2. CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS TO BE 15 MPa. MIN.
3. REINFORCING STEEL TO BE GRADE 400.

1A
S1 **LATERALLY UNSUPPORTED WALL**
SCALE: 3/8" = 1'-0"

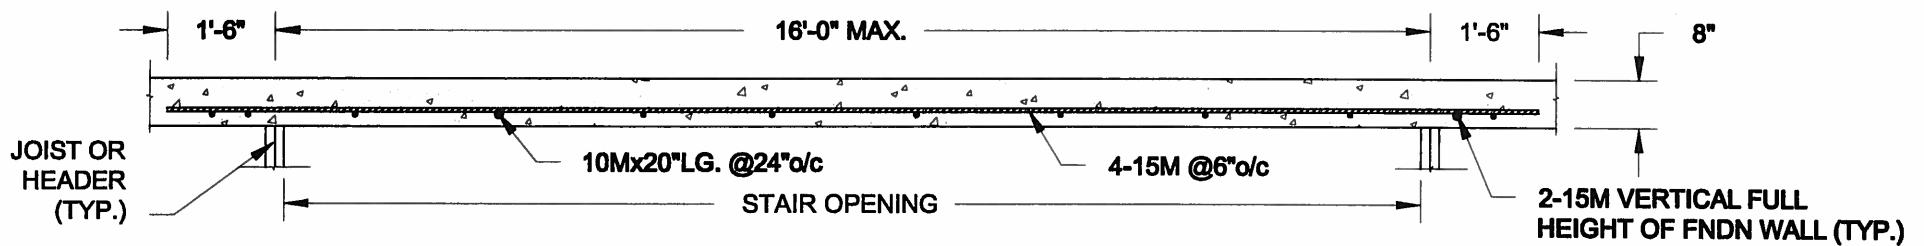

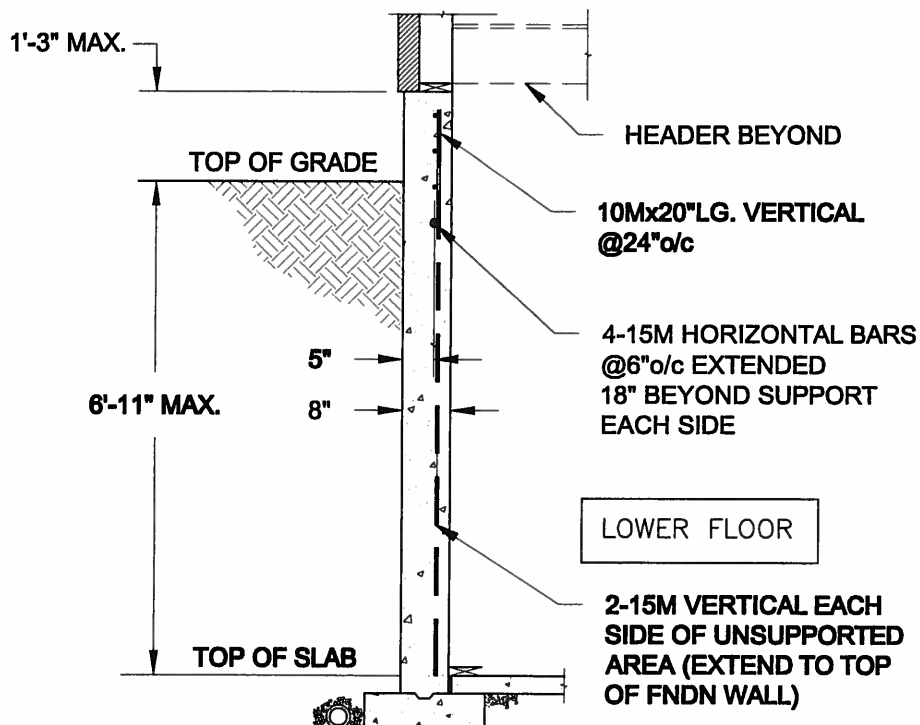

PLAN VIEW
NOT TO SCALE




NOTE:

1. CONFORM TO ONTARIO BUILDING CODE, 2012.
2. CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS TO BE 15 MPa. MIN.
3. REINFORCING STEEL TO BE GRADE 400.


1B
S1 **LATERALLY UNSUPPORTED WALL**
SCALE: 3/8" = 1'-0"

Scale: AS NOTED		<div>QUAILE ENGINEERING LTD.</div> <div></div> <div>38 Parkside Drive, UNIT 7 Newmarket, ON L3Y 8J9 T: 905-853-8547 E: quaile.eng@rogers.com</div>	<div>Engineer's Seal:</div> <div></div> <div>APR 24, 2015</div>		<div>Project:</div> <div>BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT BRADFORD, ONTARIO</div>	
Date: FEB-28-2015			TYPICAL STRUCTURAL DETAILS FOR SINGLES			
Drawn: SC	Checked: SJB		Project No.: 14-095		Drawing No.: S1	

FOR 9 1/2" JOIST DEPTH

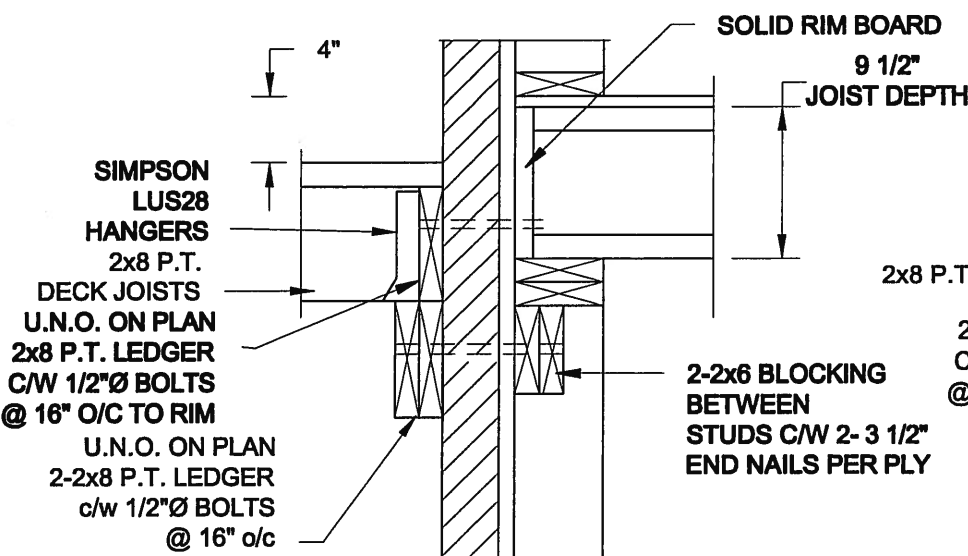


1A
S2 DECK FASTENING DETAIL
SCALE: 1" = 1'-0"

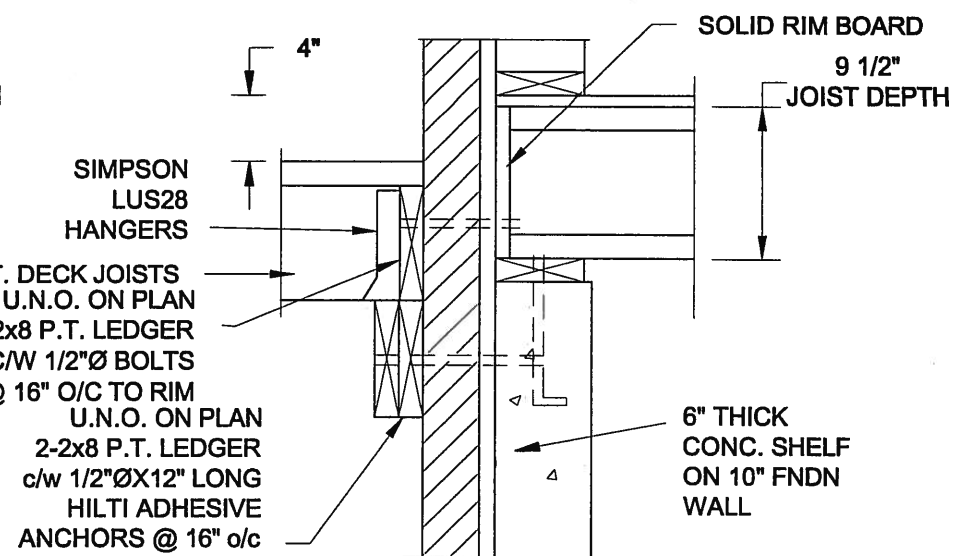


1B
S2 DECK FASTENING DETAIL
SCALE: 1" = 1'-0"

- NOTE: 1. WHERE BACKFILL HEIGHT < 4'-7", PROVIDE 2x6 @ 16" o/c KNEEWALL ON 10" THICK CONC FNDN WALL
2. WHERE BACKFILL HEIGHT > 4'-7", PROVIDE 6" CONC SHELF FOR BRICK VENEER ON 10" THICK CONC FNDN WALL
3. FOOTING TO BE 22"x6" THICK UNLESS NOTED OTHERWISE ON PLAN.

FOR 11 7/8" JOIST DEPTH

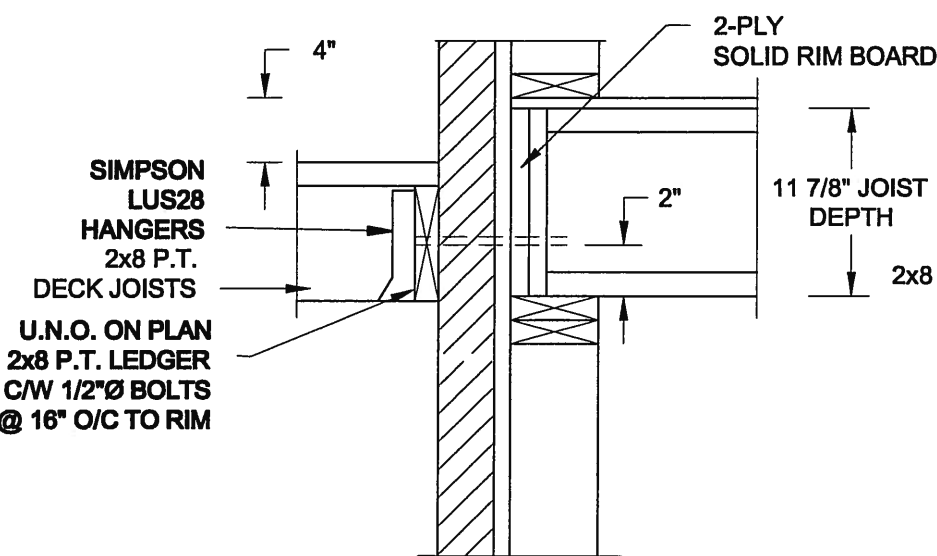


2A
S2 DECK FASTENING DETAIL
SCALE: 1" = 1'-0"

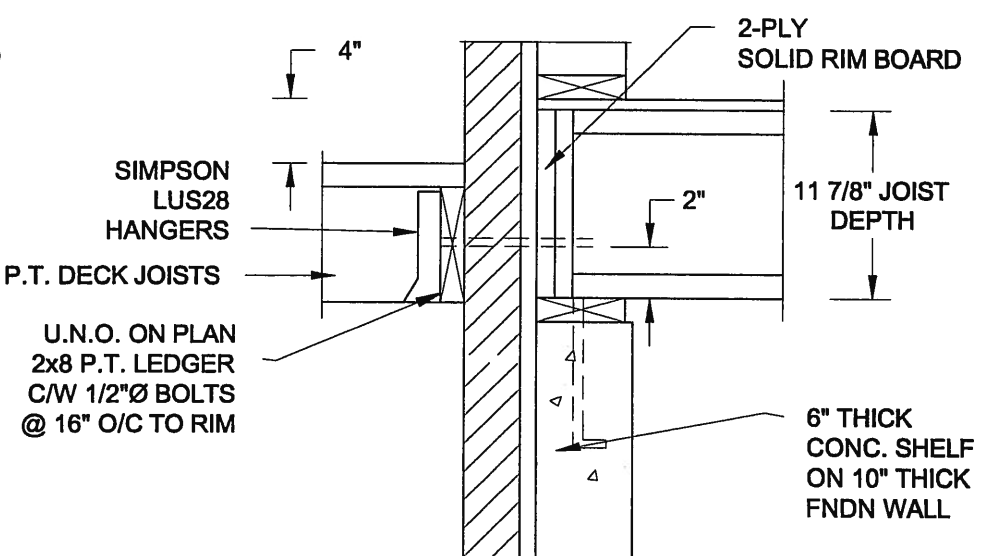


2B
S2 DECK FASTENING DETAIL
SCALE: 1" = 1'-0"

- NOTE: 1. WHERE BACKFILL HEIGHT < 4'-7", PROVIDE 2x6 @ 16" o/c KNEEWALL ON 10" THICK CONC FNDN WALL
2. WHERE BACKFILL HEIGHT > 4'-7", PROVIDE 6" CONC SHELF FOR BRICK VENEER ON 10" THICK CONC FNDN WALL
3. FOOTING TO BE 22"x6" THICK UNLESS NOTED OTHERWISE ON PLAN.

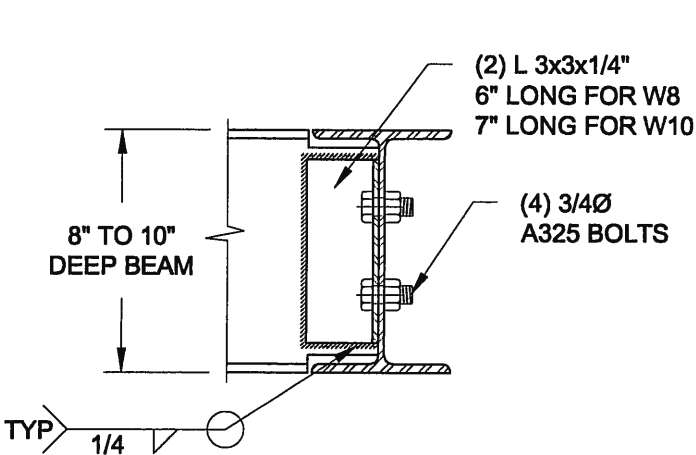

NOTE: DETAIL IS APPLICABLE TO W8x40 (W200x59) BEAM MAX AND W10x39 (W250x58) BEAM MAX.

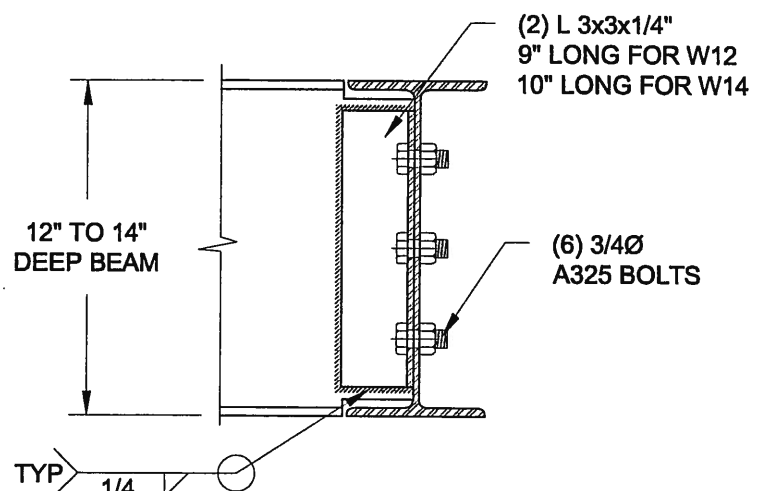

NOTE: DETAIL IS APPLICABLE TO W12x58 (W310x86) BEAM MAX AND W14x48 (W360x72) BEAM MAX.

3
S2 STEEL BEAM CONNECTION DETAIL
SCALE: 1-1/2" = 1'-0"

Scale:
AS NOTED

Date:
FEB-28-2015

Drawn:
SC

Checked:
SJB

QUAILE ENGINEERING LTD.



38 Parkside Drive, UNIT 7
Newmarket, ON
L3Y 8J9
T: 905-853-8547
E: quaile.eng@rogers.com

Engineer's Seal:



Project:

BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT
BRADFORD, ONTARIO


TYPICAL STRUCTURAL DETAILS FOR SINGLES

Project No.:


14-095

Drawing No.:


S2

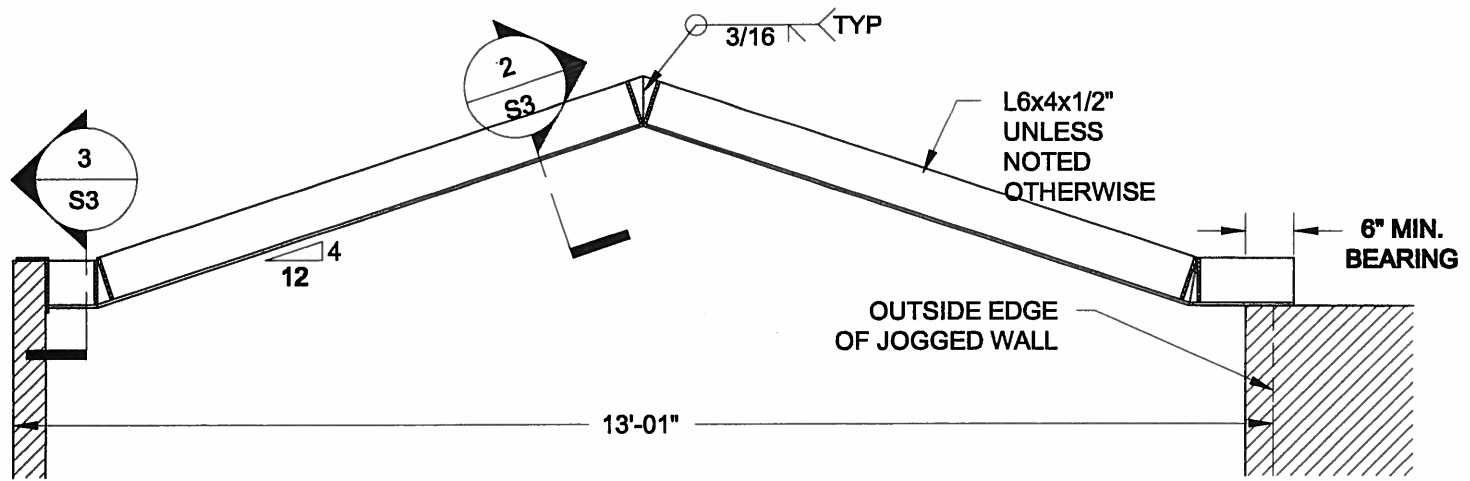


1
S3 **STEEL LINTEL AT GABLE**
SCALE: 1/2" = 1'-0"

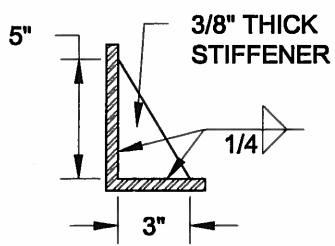

2
S3 **TYP. STIFFENER**
SCALE: 1 1/2" = 1'-0"

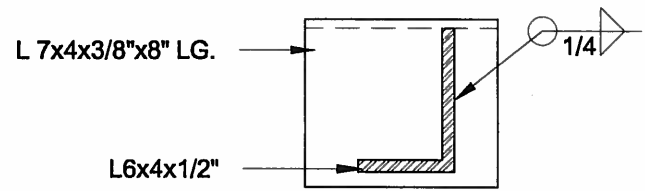

3
S3 **INVERTED ANGLE**
SCALE: 1 1/2" = 1'-0"

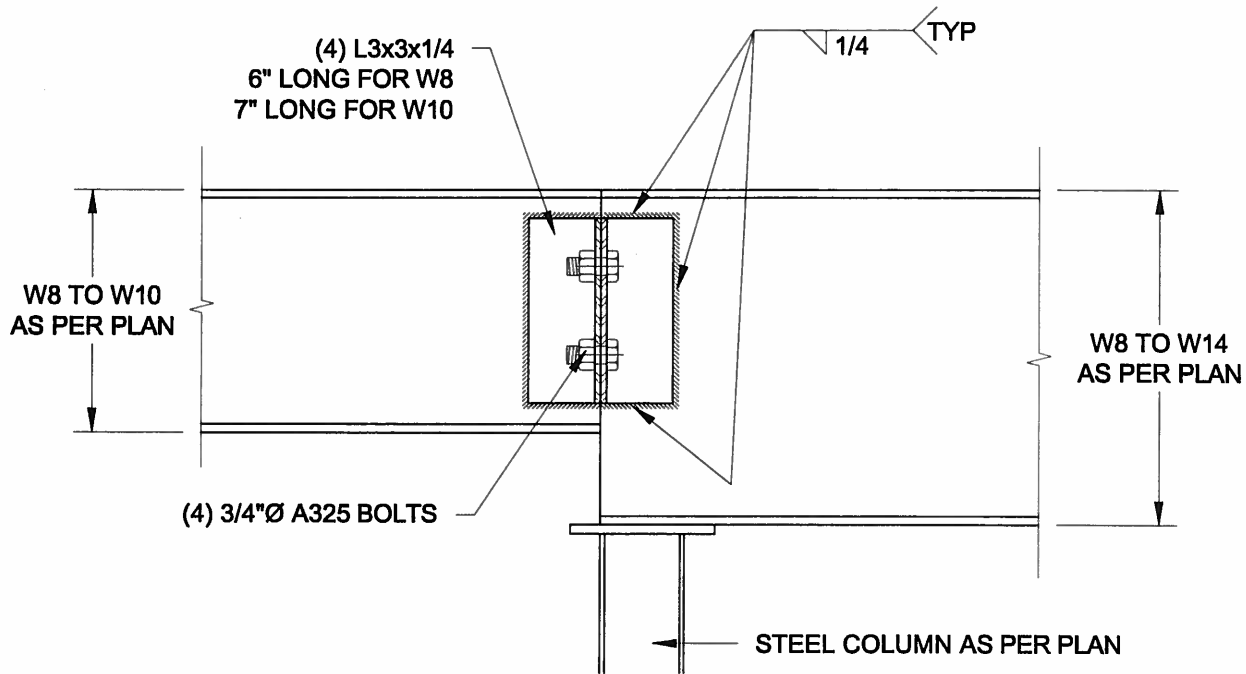

4
S3 **STEEL BEAM CONNECTION**
SCALE: 1 1/2" = 1'-0"

Scale:
AS NOTED

Date:
FEB-26-2015

Drawn: SC
Checked: SJB

QUAILE ENGINEERING LTD.



38 Parkside Drive, UNIT 7
Newmarket, ON
L3Y 8J9
T: 905-853-8547
E: quaille.eng@rogers.com

Engineer's Seal



APR 24, 2015

Project:

BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT
BRADFORD, ONTARIO


TYPICAL STRUCTURAL DETAILS FOR SINGLES

Project No.:

14-095

Drawing No.:


S3

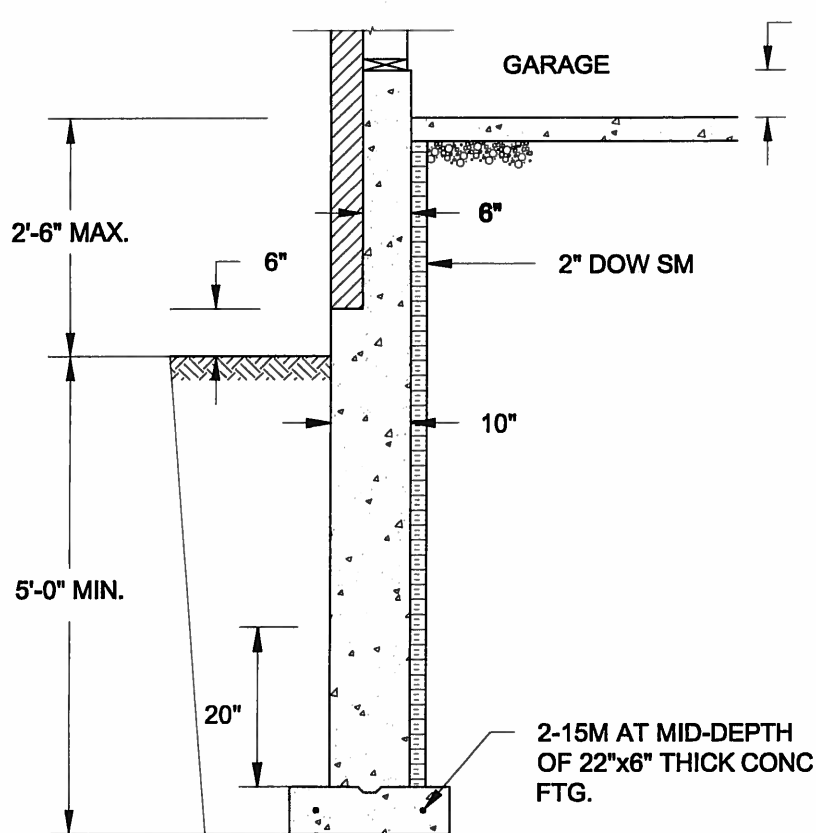

1A
S4 **REINFORCED BRICKSHELF**
SCALE: 1/2" = 1'-0"


NOTE:

1. CONFORM TO ONTARIO BUILDING CODE, 2012.
2. CONCRETE TO HAVE 28-DAY COMPRESSIVE STRENGTH OF 20 MPa.
3. REINFORCING BARS TO BE GRADE 400 DEFORMED STEEL.
4. PROVIDE 3" COVER TO SOIL MINIMUM.

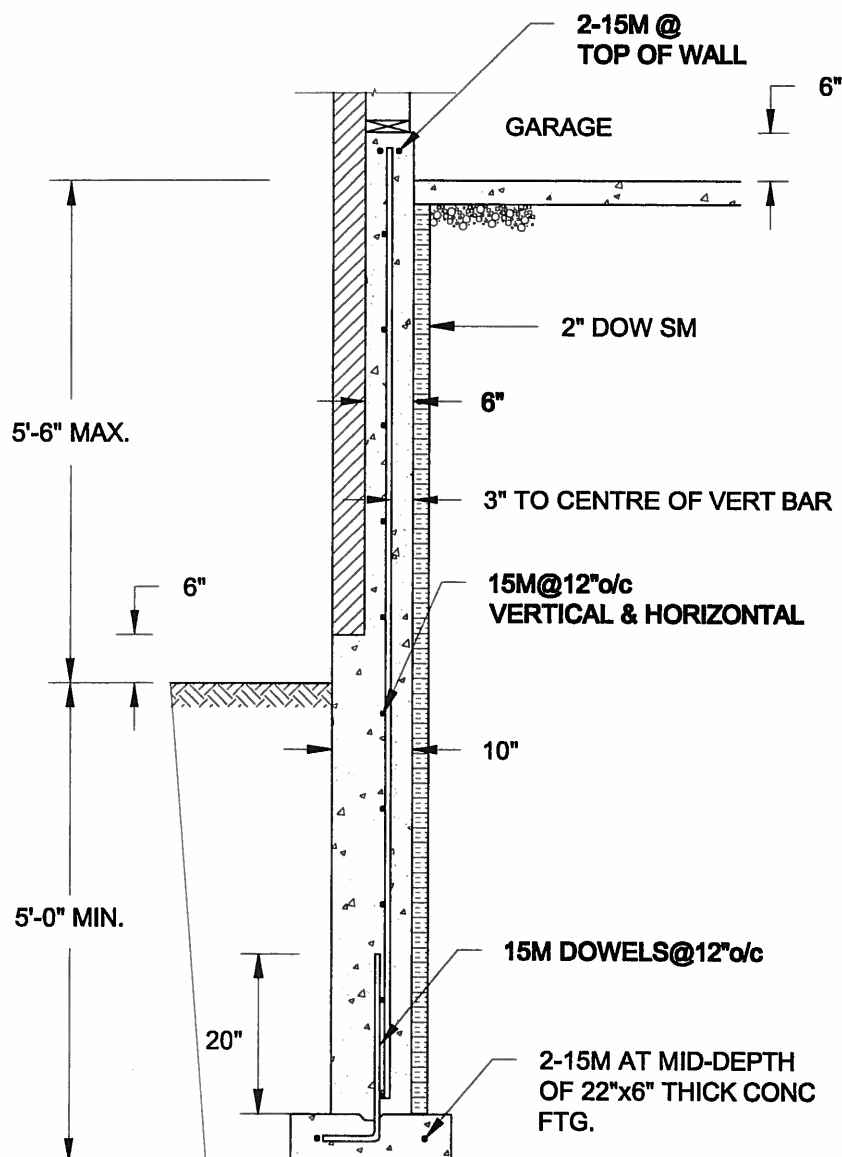

1B
S4 **REINFORCED BRICKSHELF**
SCALE: 1/2" = 1'-0"

FOR 9 1/2" JOIST DEPTH

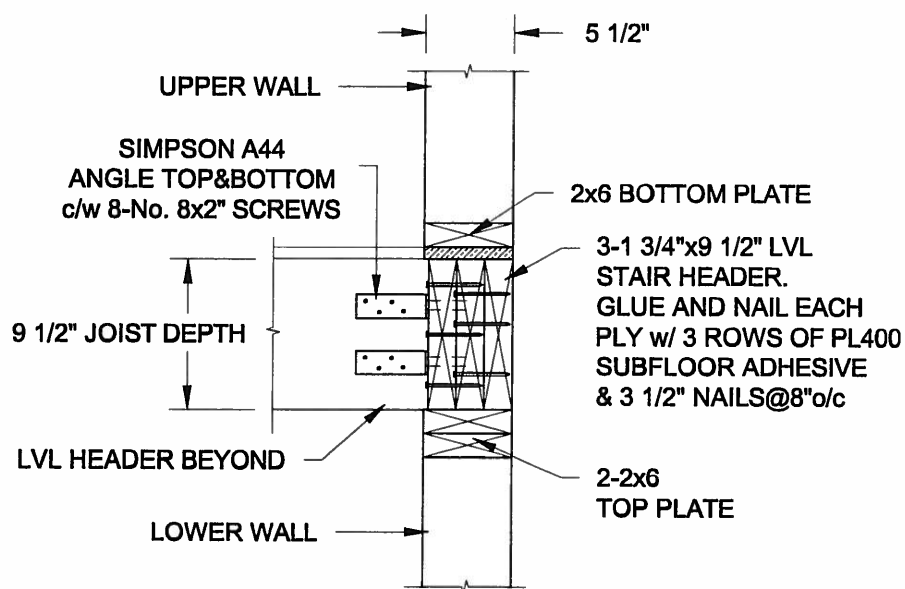

2
S4 **STAIR HEADER @ EXTERIOR WALL**
SCALE: 1" = 1'-0"

Scale:
AS NOTED

Date:
JUL-13-2015

Drawn:
SC

Checked:
SJB

QUAILE ENGINEERING LTD.



38 Parkside Drive, UNIT 7
Newmarket, ON
L3Y 8J9
T: 905-853-8547
E: quaille.eng@rogers.com

Engineer's Seal



SEPT 28, 2015

Project:

BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT
BRADFORD, ONTARIO

TYPICAL STRUCTURAL DETAILS FOR SINGLES

Project No.:

14-095

Drawing No.:

S4