

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GWILLIMBURY.



ARCHITECTURAL REVIEW & APPROVAL

JUL 09 2015


John G. Williams Limited, Architect



JULY 3, 2015

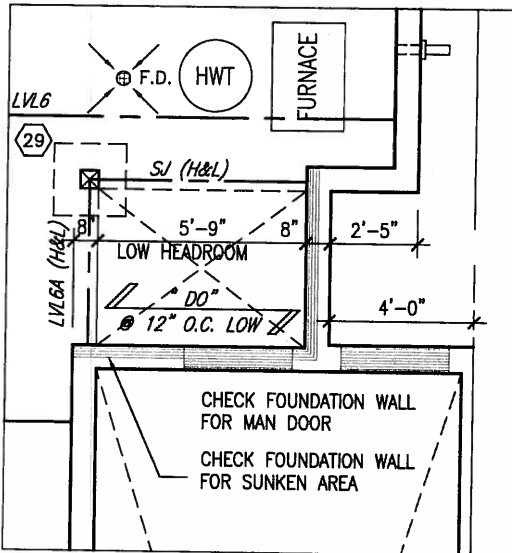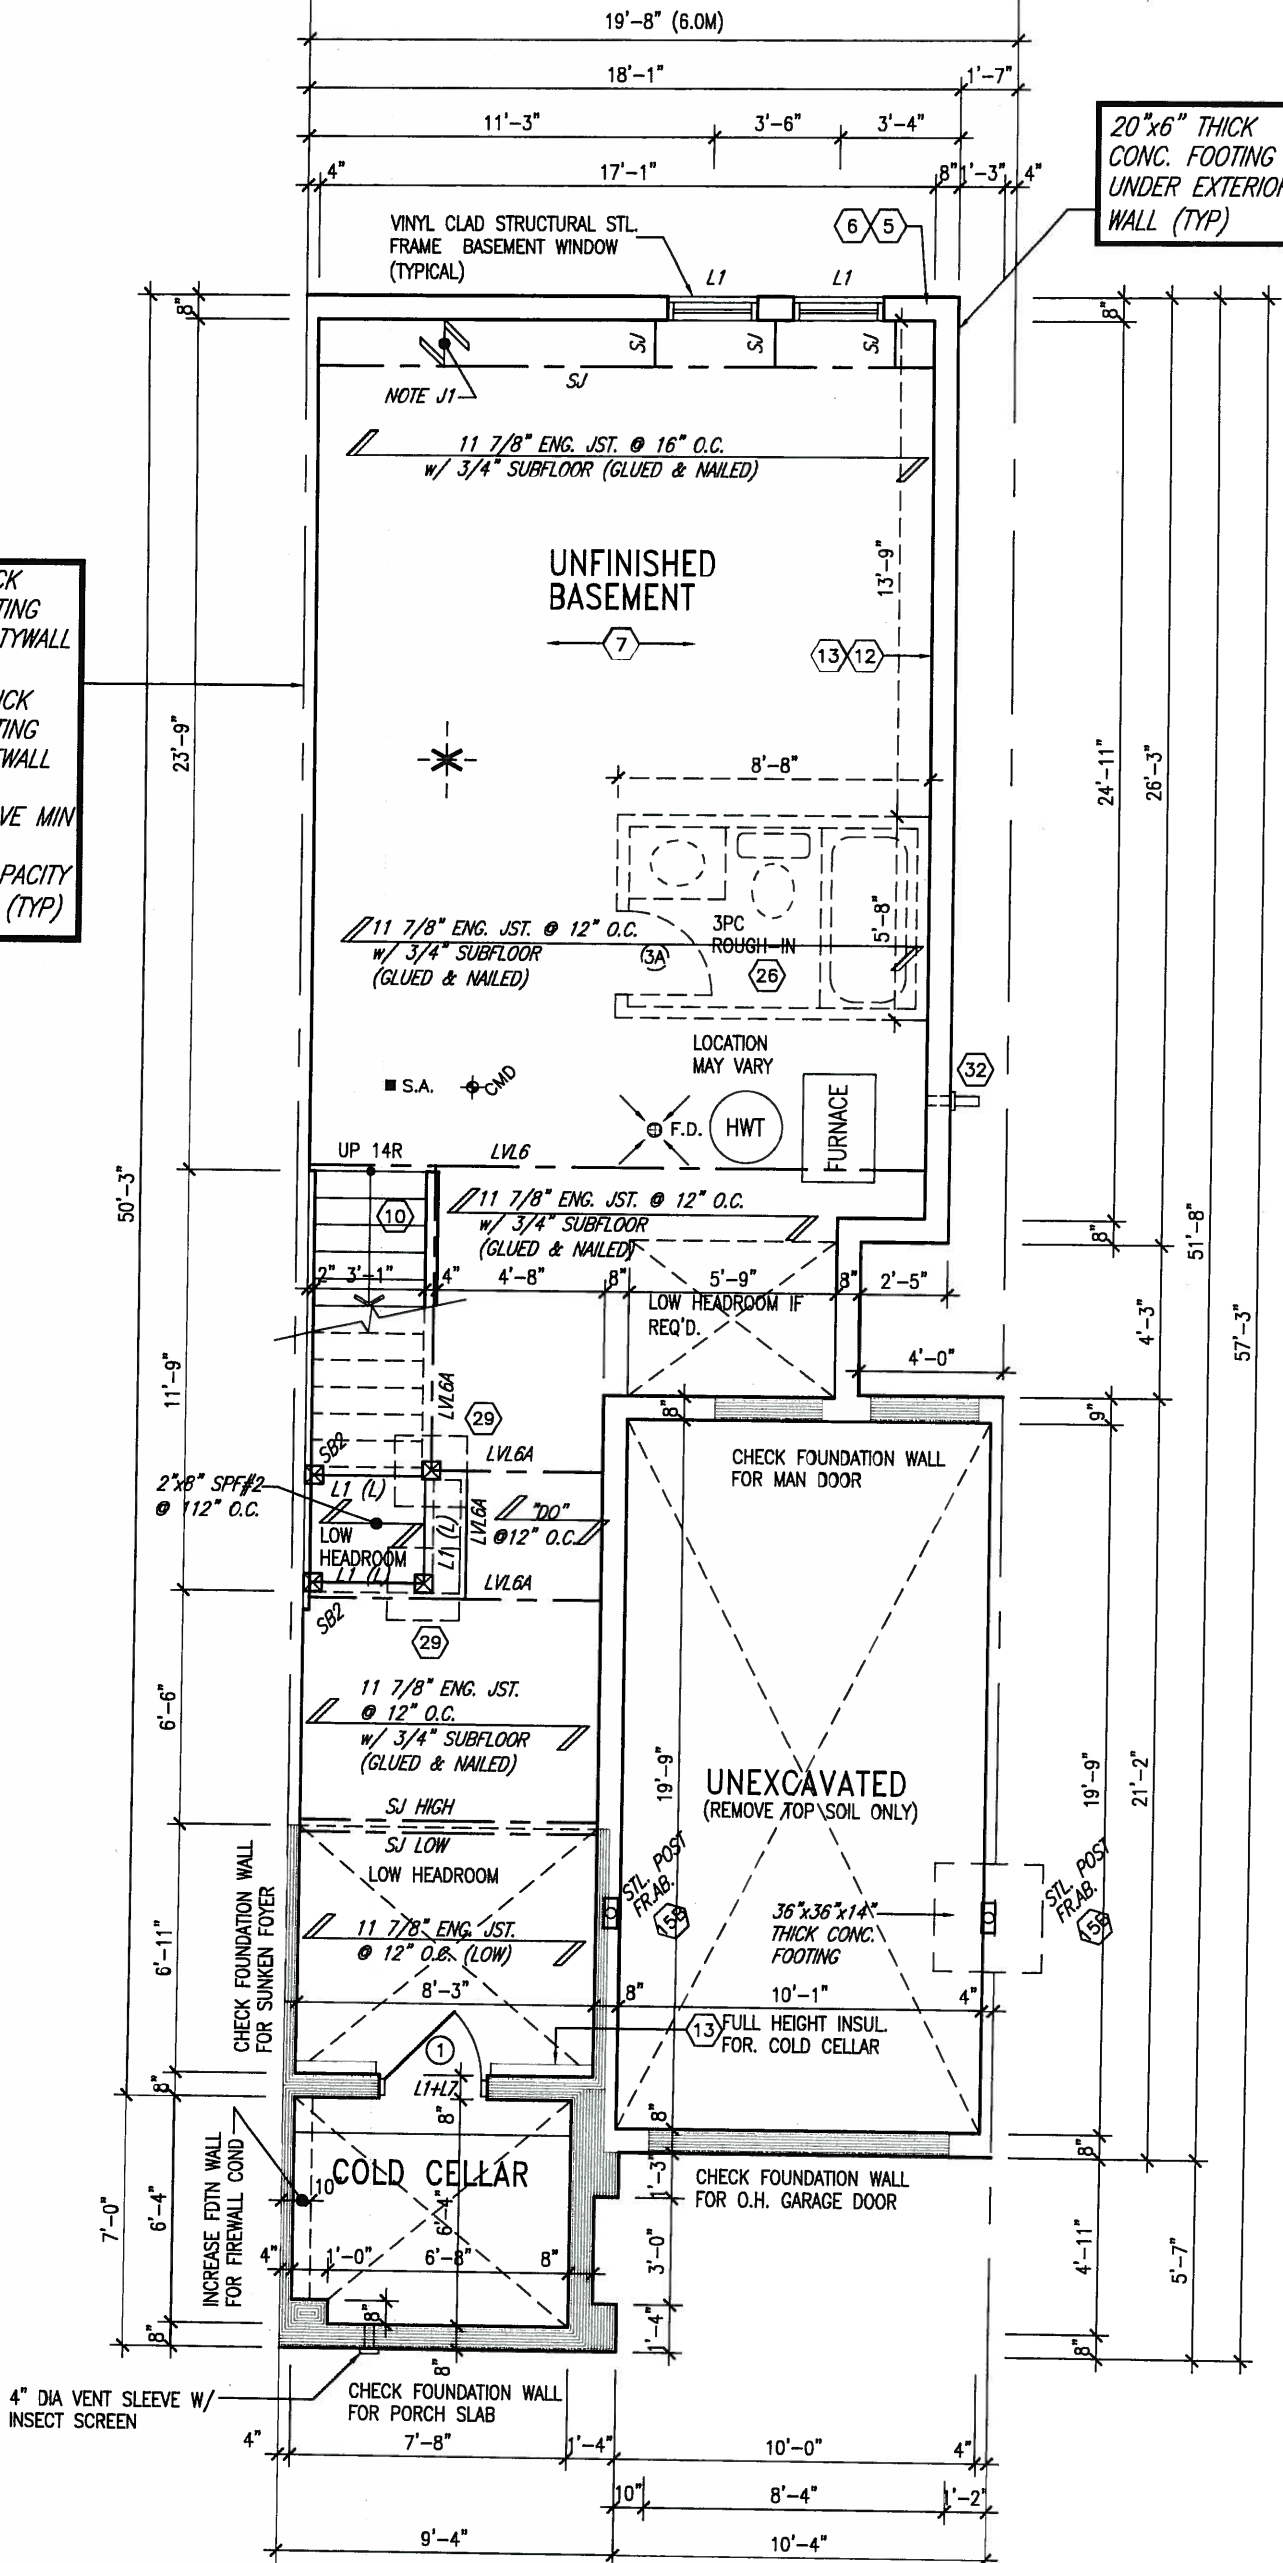

PARTIAL PLAN
SUNKEN 1R COND

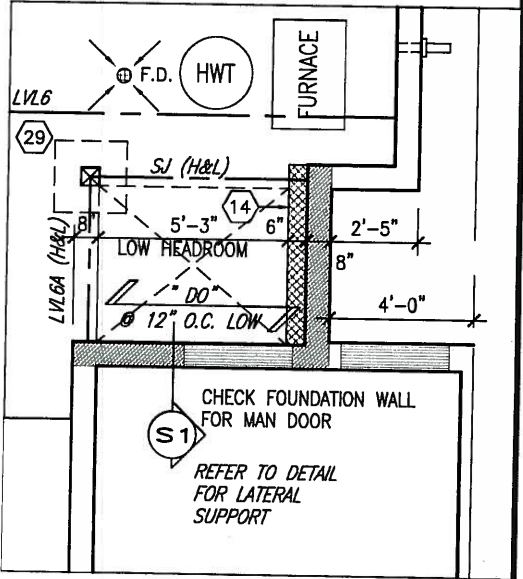

PARTIAL PLAN
SUNKEN 2R OR
MORE COND

NOTE:
ALL LVL'S SUPPORTING FLOOR LOADS ARE TO BE SPECIFIED BY THE FLOOR TRUSS MANUFACTURER.

NOTE J1: PROVIDE SOLID BLOCKING @ 24" O.C. WHERE FLOOR JOISTS ARE PARALLEL TO FOUNDATION WALL (TYP.)

NOTE:
FLOOR FRAMING INFO REFER TO ENG SHOP DRAWINGS FOR ALL TRUSS-JOIST INFORMATION AND DETAILS. UNLESS OTHERWISE NOTED.

ENGINEERED FLOOR SUBFLOORS
ALL SUBFLOORS TO BE 3/4" PLYWOOD AND TO BE GLUED AND NAILED ON THIS FLOOR FOR ENGINEERED JOIST ONLY.

9.					
8.					
7.					
6.					
5.	REVISED EXT. COLS	MAY 25-15	AF		
4.	ADD COLD CELLAR, 5'-0" FROST PROTECTION	JUL 21-14	QS		
3.	REVISED AS PER ENG COMMENTS	MAY 30-14	RC		
2.	REVISED AS PER TRUSS COORDINATION	MAY 17-14	RC		
1.	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC		
no.	description	date	by		

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information
Wellington Jno-Baptiste 25591
name
registration information BCIN
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3
DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

TH1
NAPA 1

project name
GREEN VALLEY ESTATES

municipality
BRADFORD

project no.
13045

date
APR 2014

drawn by
RC

checked by
-

scale
3/16" = 1'-0"

BASEMENT FLOOR PLAN

drawing no.
1

file name
13045-TH1

INDICATES FIRE RATED WALL ASSEMBLY



JULY 3, 2015

NOTE:
ALL OPENINGS IN FIRE
RATED WALL ASSEMBLY TO
BE LINED WITH 1 LAYER OF
5/8" TYPE 'X' OR EQ.

REFER TO
STAIR HEADER
DETAIL S3

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD/WEST GWILLIMBURY.

ARCHITECTURAL REVIEW & APPROVAL

JUL 10 9 2015

John G. Williams Limited, Architect

NOTE:
ALL LVL'S SUPPORTING FLOOR LOADS ARE TO
BE SPECIFIED BY THE FLOOR TRUSS
MANUFACTURER.

AREA CALCULATIONS	ELEV. A	ELEV. B
GROUND FLOOR AREA	729 SF	729 SF
SECOND FLOOR AREA	942 SF	950 SF
SUBTOTAL	1671 SF	1679 SF
DEDUCT ALL OPEN AREAS	10 SF	10 SF
TOTAL NET AREA	1661 SF (154.31 m ²)	1669 SF (155.06 m ²)
FINISHED BSMT AREA	0 SF	0 SF
COVERAGE W/OUT PORCH	946 SF (87.87 m ²)	946 SF (87.87 m ²)
COVERAGE W/ PORCH	1010 SF (93.83 m ²)	1010 SF (93.83 m ²)

GROUND FLOOR PLAN 'A'

NOTE:
FLOOR FRAMING INFO REFER TO ENG SHOP
DRAWINGS FOR ALL TRUSS-JOIST INFORMATION
AND DETAILS. UNLESS OTHERWISE NOTED.

ENGINEERED FLOOR SUBFLOORS

ALL SUBFLOORS TO BE 3/4" PLYWOOD AND TO
BE GLUED AND NAILED ON THIS FLOOR FOR
ENGINEERED JOIST ONLY.

no.	description	date	by
9			
8			
7			
6			
5	REVISED EXT. COLS	MAY 25-15	AF
4	ADD COLD CELLAR, 5'-0" FROST PROTECTION	JUL 21-14	OS
3	REVISED AS PER ENG COMMENTS	MAY 30-14	RC
2	REVISED AS PER TRUSS COORDINATION	MAY 17-14	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information
Wellington Jno-Baptiste 25591
name
registration information
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

**VA3
DESIGN**

300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

project name
GREEN VALLEY ESTATES

municipality
BRADFORD

TH1
NAPA 1

project no.
13045

date
APR 2014

drawn by
RC

checked by

scale
3/16" = 1'-0"

GROUND FLOOR PLAN

file name
13045-TH1

drawing no.
2


RICHARD H:\ARCHIVE\WORKING\2013\13045 BW\units\6 DM TOWNS\13045-H1.dwg - Wed J 1 2015 - 11:49 AM

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

INDICATES FIRE RATED WALL ASSEMBLY



JULY 3, 2015

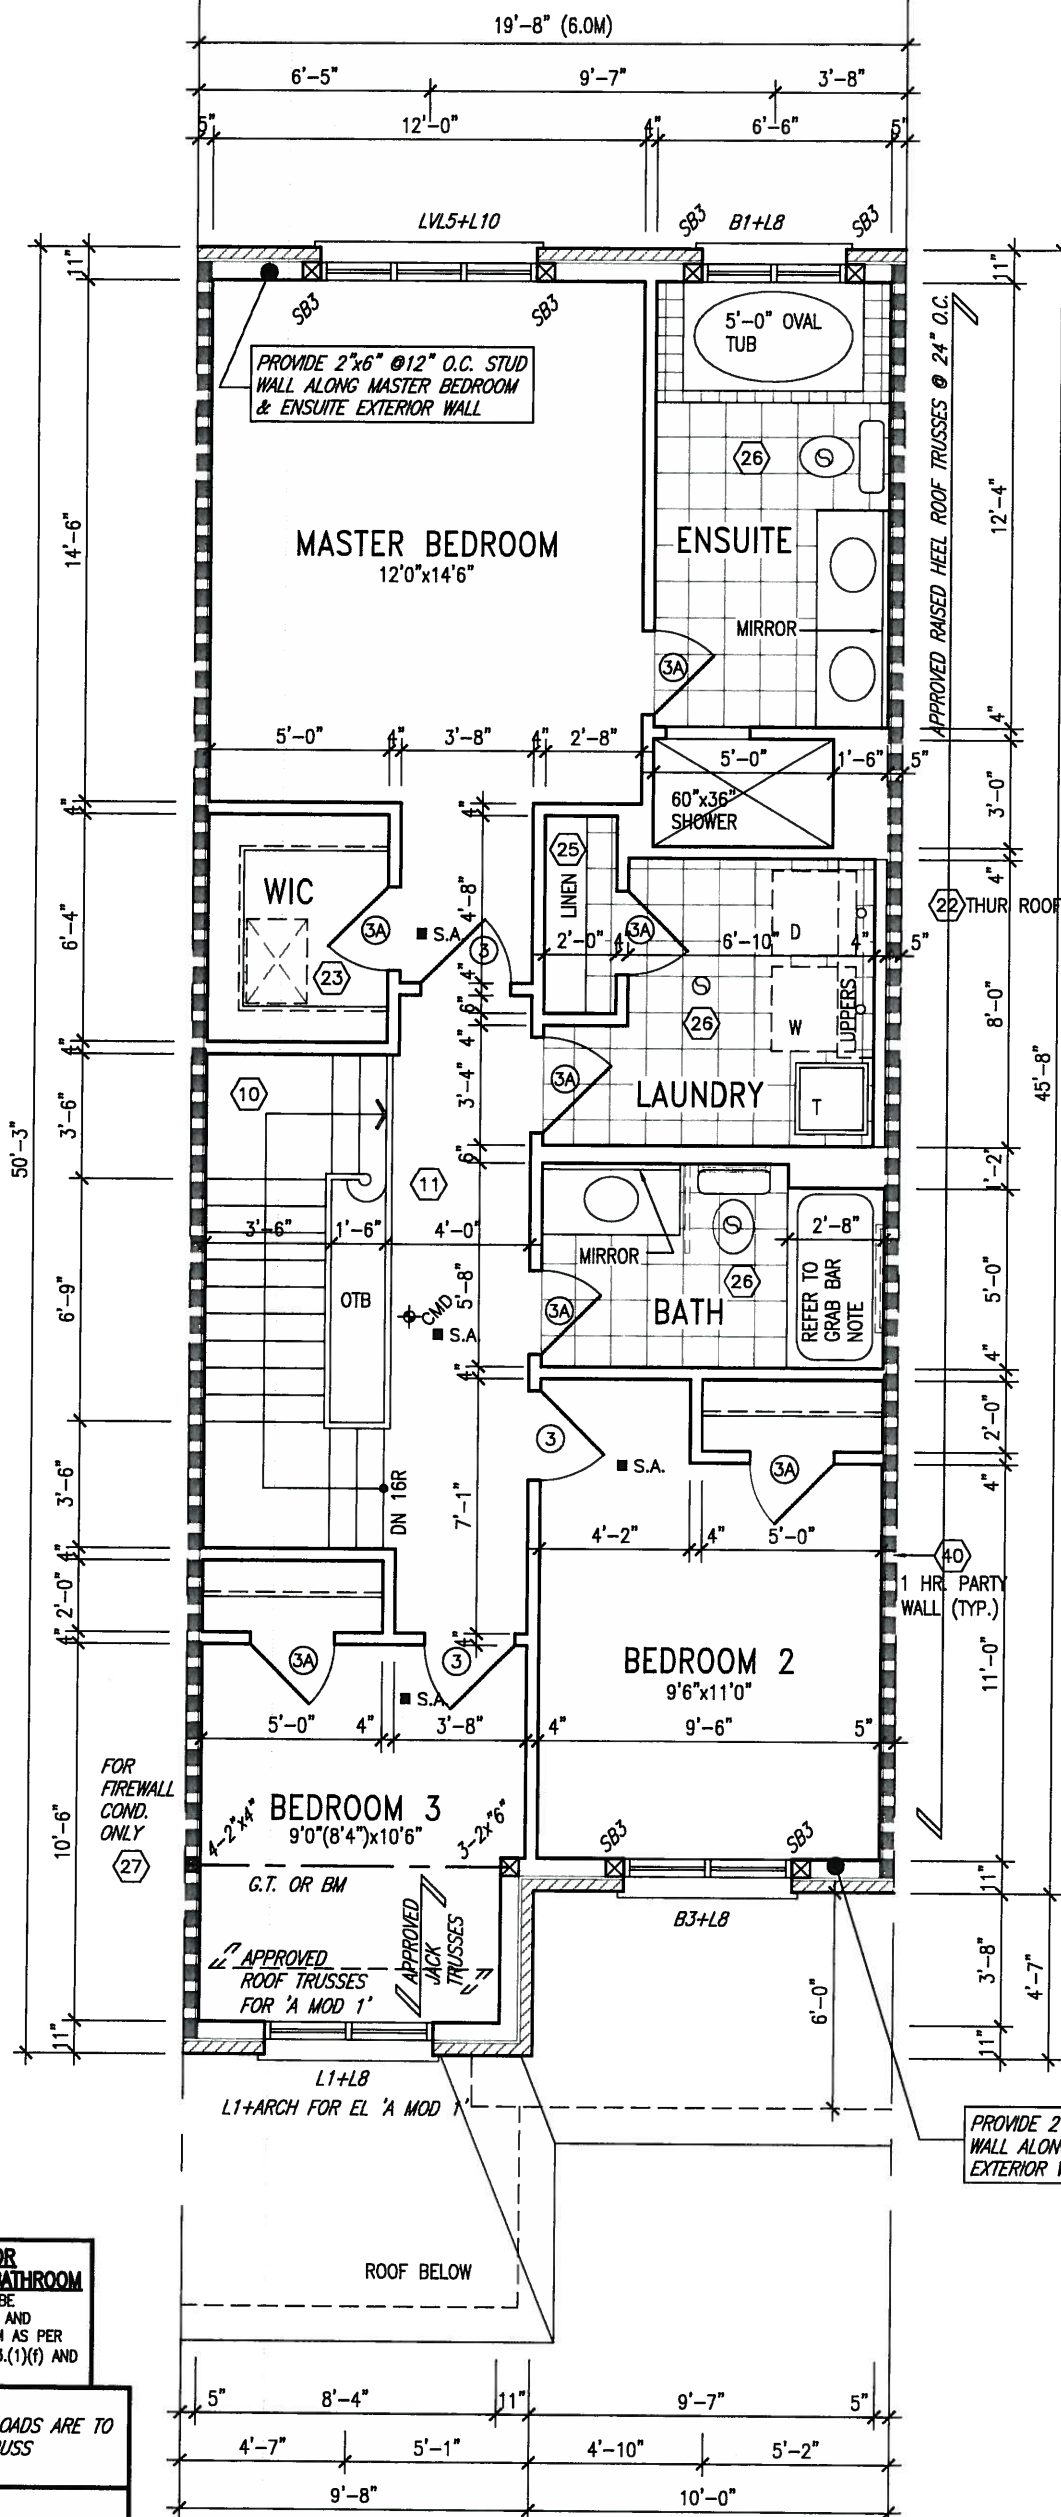

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GWILLIMBURY.

ARCHITECTURAL REVIEW & APPROVAL

JUL 09 2015

John G. Williams Limited, Architect

STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM
REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM AS PER O.B.C. 9.5.2.3, 3.8.3.8.(1)(d), & 3.8.3.13.(1)(f) AND DETAILS PROVIDED

NOTE:
ALL LVL'S SUPPORTING FLOOR LOADS ARE TO BE SPECIFIED BY THE FLOOR TRUSS MANUFACTURER.

NOTE:
FLOOR FRAMING INFO REFER TO ENG SHOP DRAWINGS FOR ALL TRUSS-JOIST INFORMATION AND DETAILS. UNLESS OTHERWISE NOTED.

ENGINEERED FLOOR SUBFLOORS
ALL SUBFLOORS TO BE 3/4" PLYWOOD AND TO BE GLUED AND NAILED ON THIS FLOOR FOR ENGINEERED JOIST ONLY.

NOTE: ROOF FRAMING
ROOF TRUSS INFORMATION REFER TO ROOF TRUSS SHOP DRAWINGS FOR ALL ROOF FRAMING INFORMATION UNLESS OTHERWISE NOTED.

NOTE: ROOF STRUCTURE MAY VARY

REFER TO ROOF TRUSS MANUFACTURERS' BUILDING BLOCK TRUSS LAYOUT FOR ACTUAL ROOF STRUCTURE

9			
8			
7			
6			
5	REVISED EXT. COLS	MAY 25-15	AF
4	ADD COLD CELLAR, 5'-0" FROST PROTECTION	JUL 21-14	QS
3	REVISED AS PER ENG COMMENTS	MAY 30-14	RC
2	REVISED AS PER TRUSS COORDINATION	MAY 17-14	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information

Wellington Jno-Baptiste 25591

name registration information BCN

VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.


VA3 DESIGN

300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

TH1
NAPA 1

project name	GREEN VALLEY ESTATES	municipality	BRADFORD	project no.	13045
date	APR 2014	checked by	scale	3/16" = 1'-0"	
drawn by	RC				
SECOND FLOOR PLAN					drawing no.
13045-TH1					3
RICHARD -- H:\ARCHIVE\WORKING\2013\13045.BW\units\6.0M_TOWNS\13045-TH1.dwg -- Wed -- Jul 1 2015 -- 11:49 AM					

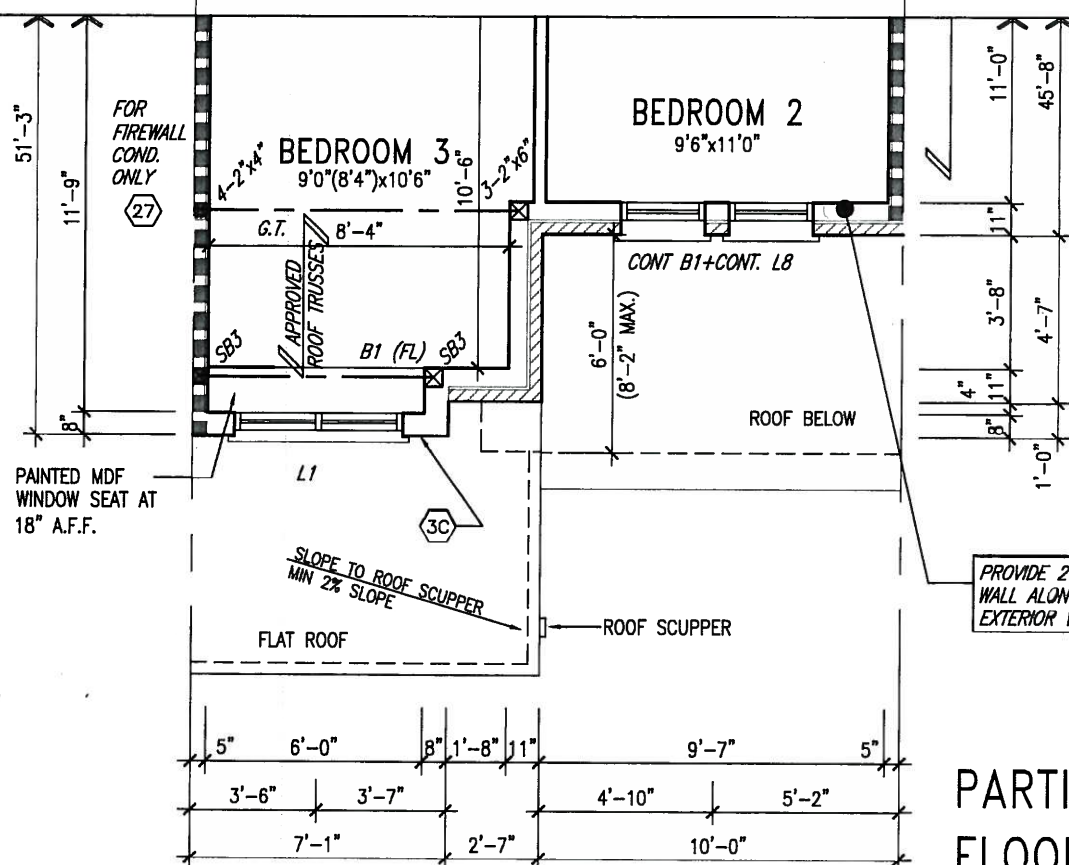


NOTE: ROOF STRUCTURE MAY VARY

REFER TO ROOF TRUSS
MANUFACTURERS' BUILDING
BLOCK TRUSS LAYOUT FOR
ACTUAL ROOF STRUCTURE

NOTE: ROOF FRAMING
ROOF TRUSS INFORMATION REFER TO ROOF
TRUSS SHOP DRAWINGS FOR ALL ROOF FRAMING
INFORMATION UNLESS OTHERWISE NOTED.



JULY 3, 2015

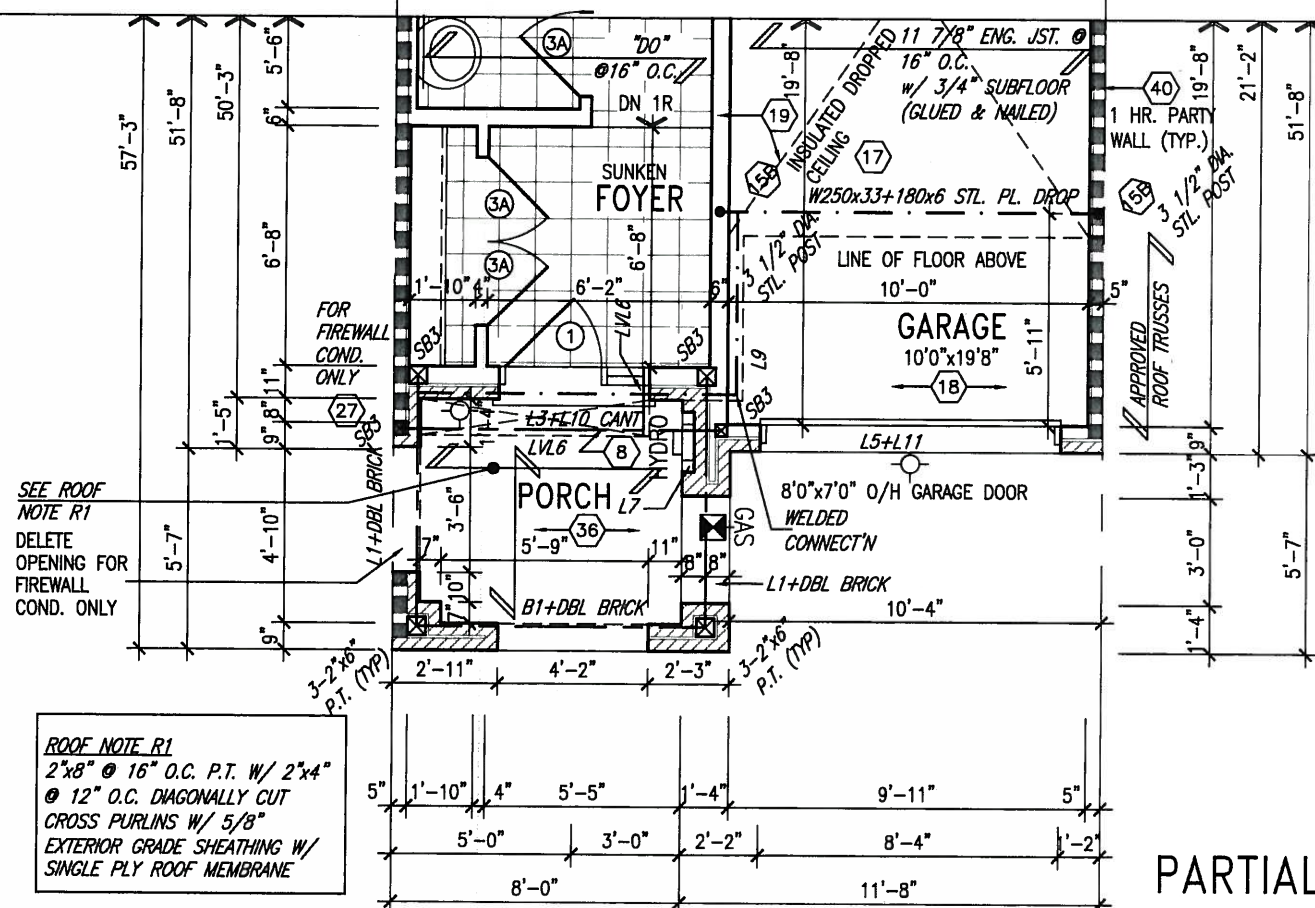


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GWILLIMBURY.

ARCHITECTURAL REVIEW & APPROVAL

~~JUL 09 2015~~

John G. Williams Limited, Architect

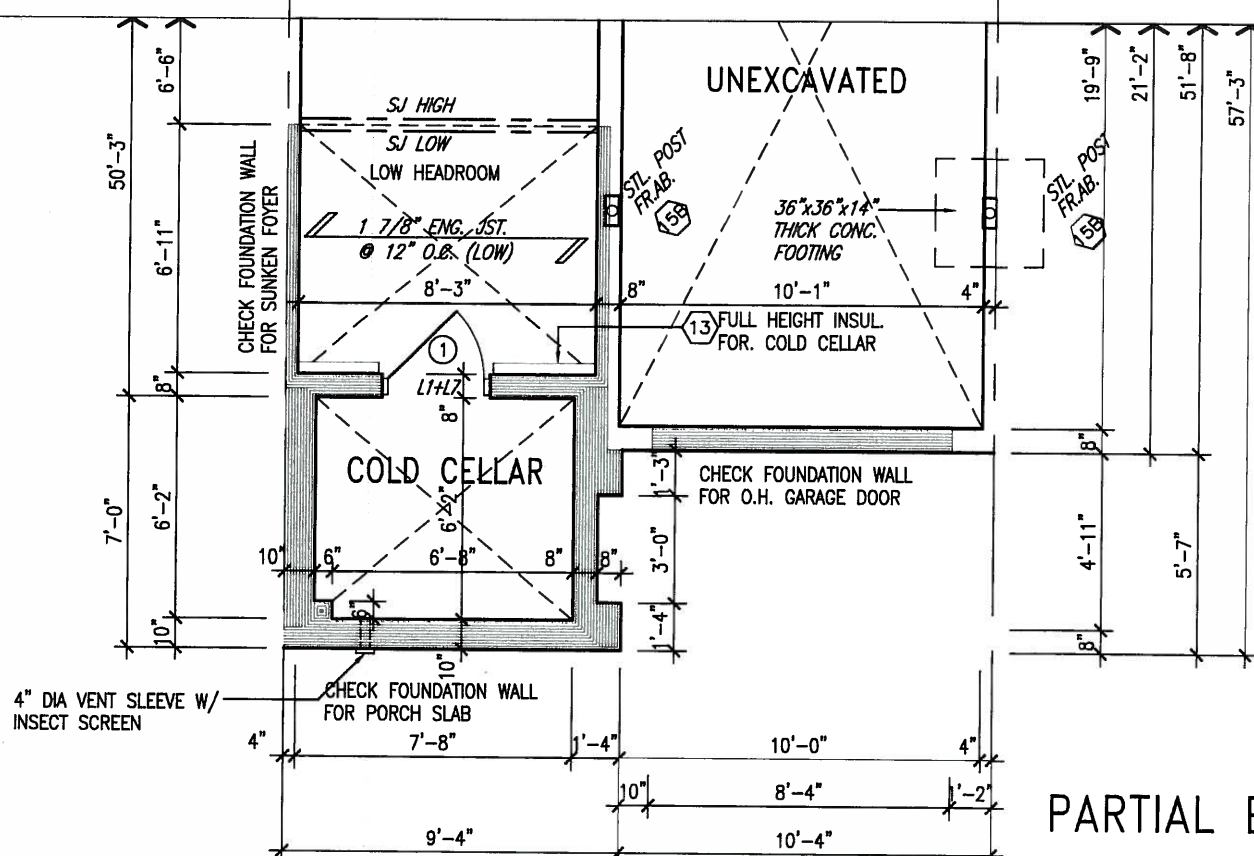

NOTE: ROOF FRAMING
ROOF TRUSS INFORMATION REFER TO ROOF
TRUSS SHOP DRAWINGS FOR ALL ROOF
FRAMING INFORMATION UNLESS OTHERWISE
NOTED.

NOTE:
ALL LVL'S SUPPORTING FLOOR LOADS ARE TO
BE SPECIFIED BY THE FLOOR TRUSS
MANUFACTURER.

NOTE:
FLOOR FRAMING INFO REFER TO ENG SHOP
DRAWINGS FOR ALL TRUSS-JOIST INFORMATION
AND DETAILS. UNLESS OTHERWISE NOTED.

ENGINEERED FLOOR SUBFLOORS
ALL SUBFLOORS TO BE 3/4" PLYWOOD AND TO
BE GLUED AND NAILED ON THIS FLOOR FOR
ENGINEERED JOIST ONLY.

NOTE J1: PROVIDE SOLID BLOCKING @ 24" O.C. WHERE FLOOR JOISTS ARE PARALLEL TO FOUNDATION WALL (TYP.)

9	WELLER TO FOUNDATION WALL (1117)	-	-	-	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer. qualification information Wellington Jno-Baptiste <i>J. Baptiste</i> 25591 name <i>signature</i> BCIN registration information VA3 Design Inc. 42658 Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be used.
8		-	-	-	
7		-	-	-	
6		-	-	-	
5	REVISED EXT. COLS	MAY 25-15	AF		
4	ADD COLD CELLAR, 5'-0 FROST PROTECTION	JUL 21-14	QS		
3	REVISED AS PER ENG COMMENTS	MAY 30-14	RC		
2	REVISED AS PER TRUSS COORDINATION	MAY 17-14	RC		
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC		
no.	description		date	by	

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information

Wellington Jno-Baptiste		25591
name	signature	BCIN
registration information		
VA3 Design Inc.		42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All change and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be copied.

**VA3
DESIGN**

300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

project name
GREEN VALLEY ESTATES

municipality
BRADFORD

TH1
NAPA 1

Project no.
3045

date
APR 2014

drawn by
PC

checked by _____

scale


PARTIAL FLOOR PLAN B

Drawing no.

file name
13045-TH1

RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\6.0M TOWNS\13045-TH1.dwg - Wed - Jul 1 2015 - 11:49 AM

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

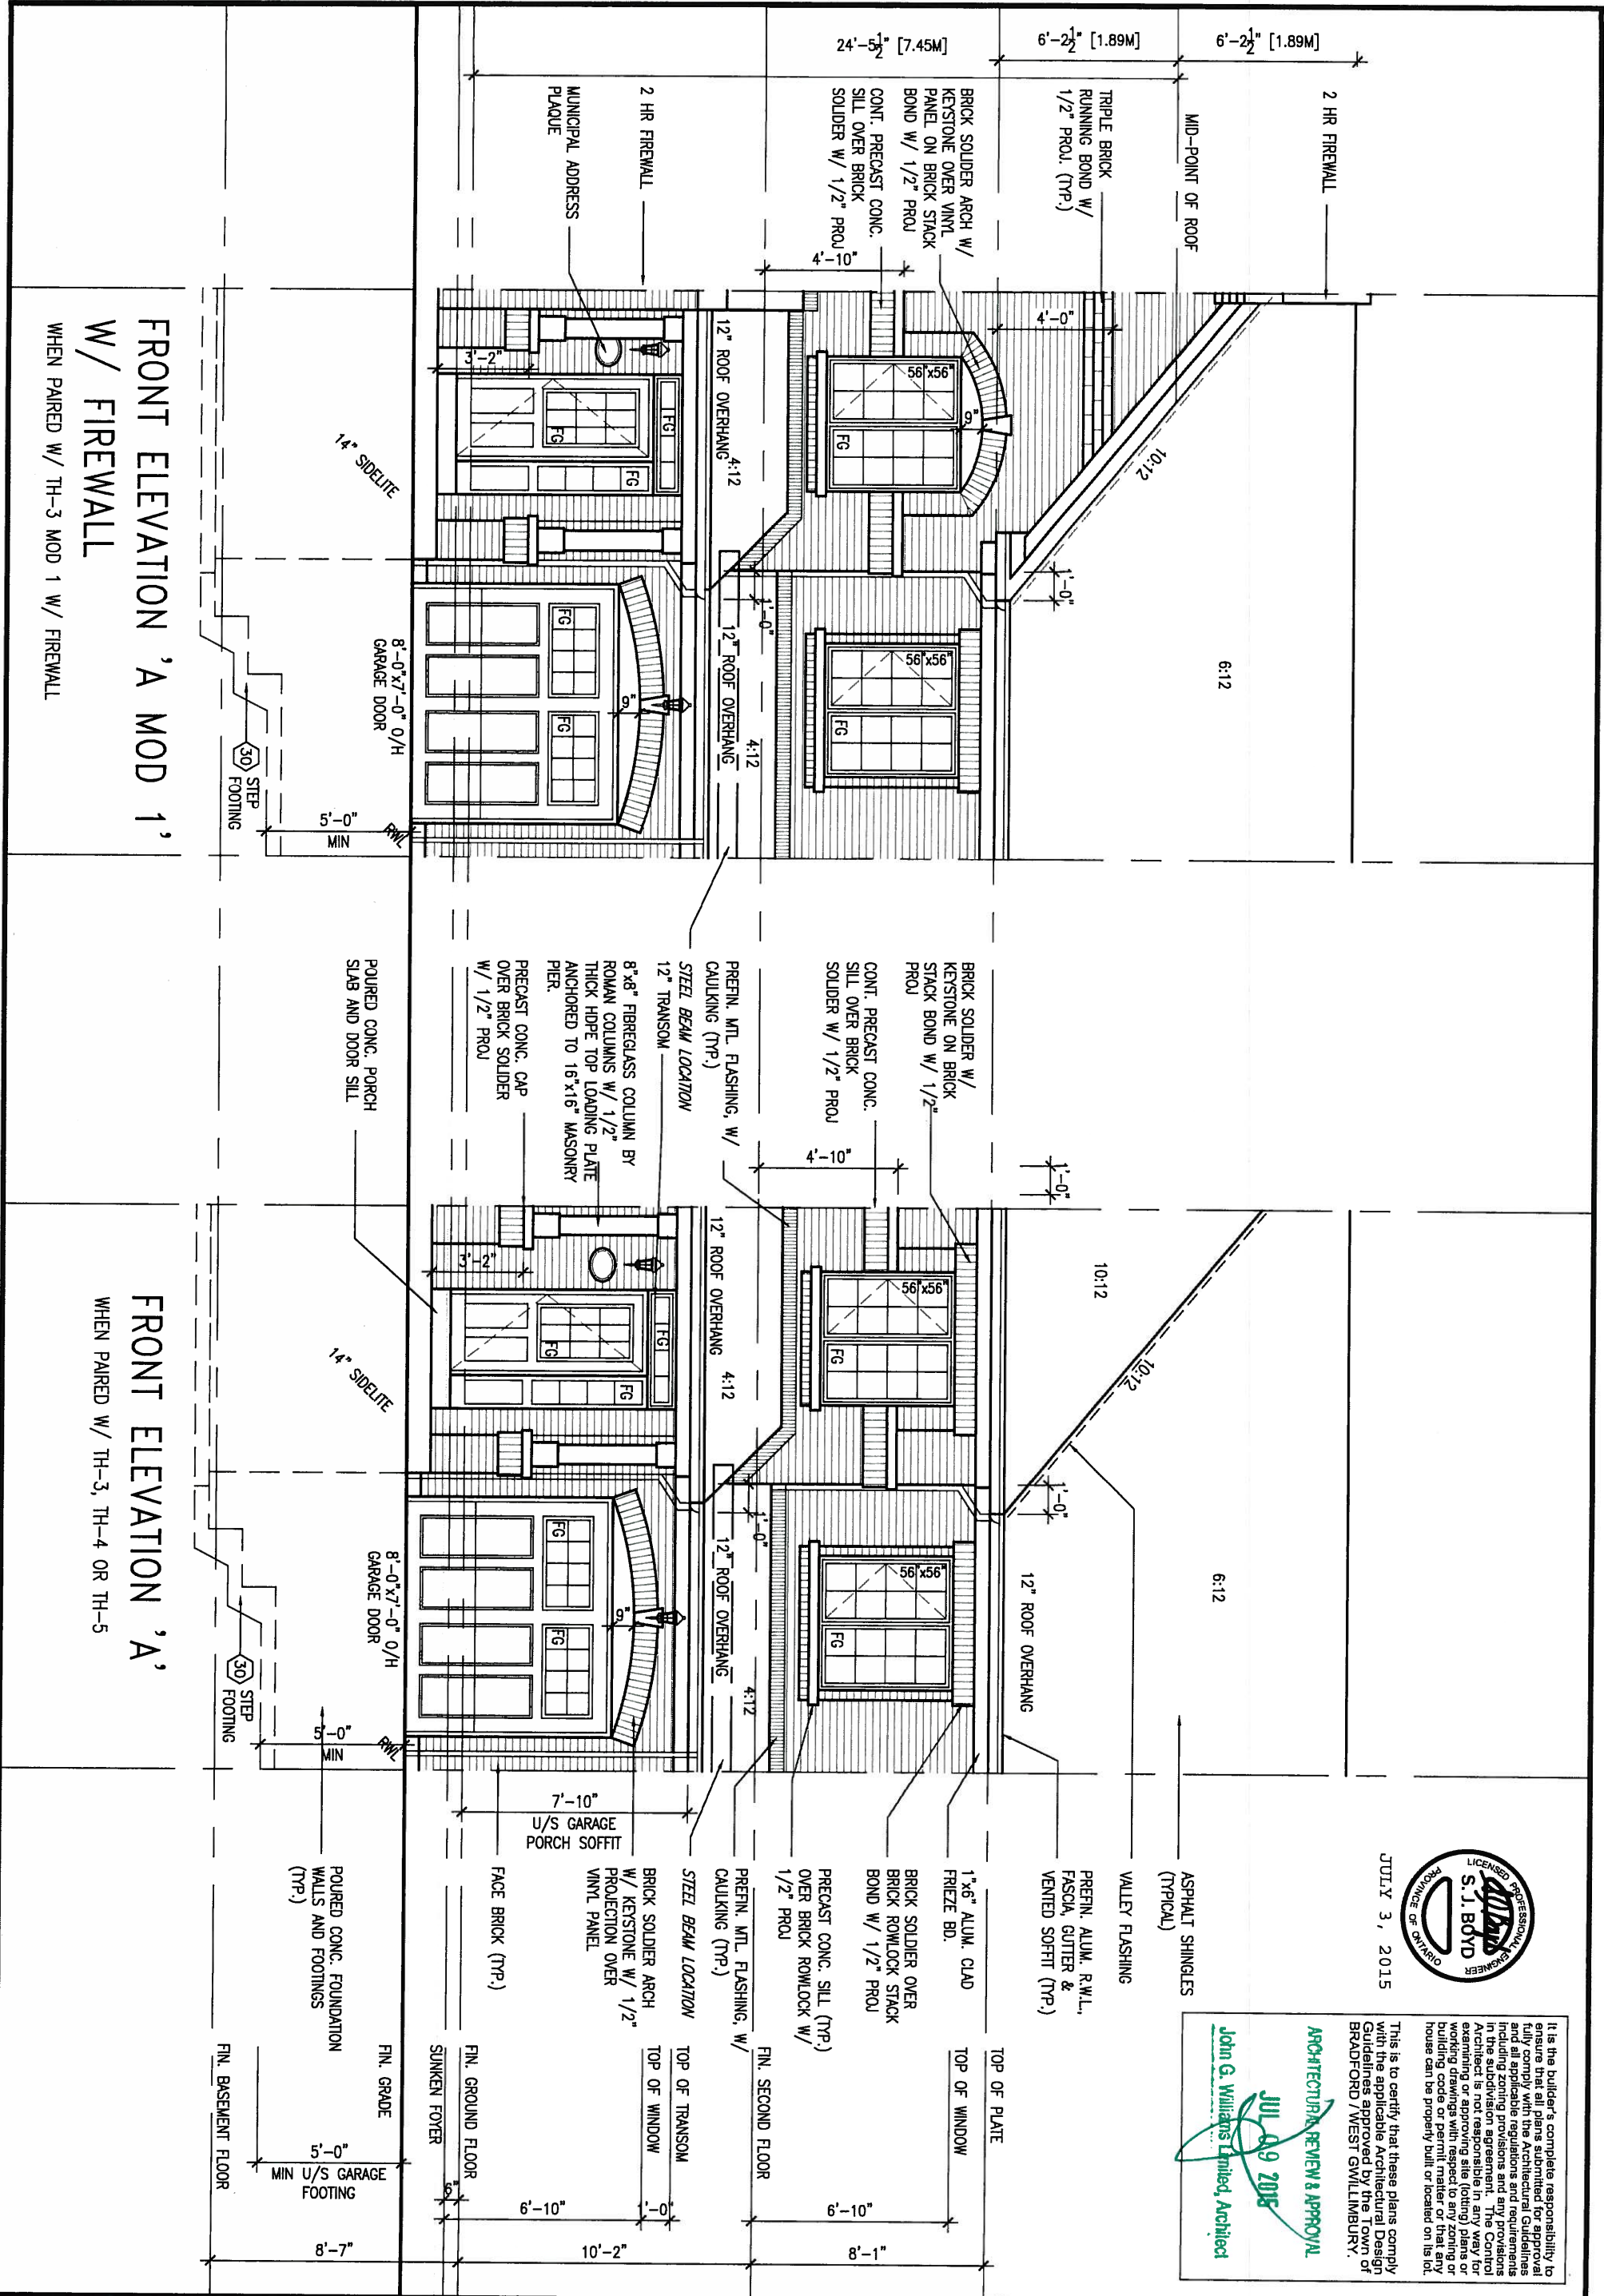

JULY 3, 2015

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with applicable building codes and all applicable regulations and requirements including zoning regulations and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Town of BRADFORD / WEST GUILDFORD.

ARCHITECTURAL REVIEW & APPROVAL
JUL 09 2015
John G. Williams Limited, Architect

9	.	.	.
8	.	.	.
7	.	.	.
6	.	.	.
5	REVISED EXT. COLS	MAY 25-15	AF
4	ADD COLD CELLAR, 5'-0" FROST PROTECTION	JUL 21-14	QS
3	REVISED AS PER ENG COMMENTS	MAY 30-14	RC
2	REVISED AS PER TRUSS COORDINATION	MAY 17-14	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information
Wellington Jno-Baptiste 25591
name registration information BCIN
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON		TH1 NAPA 1	
project name GREEN VALLEY ESTATES	municipality BRADFORD	project no. 13045	drawing no. 5
date APR 2014	checked by RC	scale 3/16" = 1'-0"	file name 13045-TH1
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\6.0M TOWNS\13045-TH1.dwg - Wed - Jul 1 2015 - 11:49 AM			



JULY 3, 2015


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions of the Planning Act, R.S.O. 1990, c. P.22, as amended. The Architect is not responsible for any way for examining or approving site plans or drawings or building drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

ARCHITECTURAL REVIEW & APPROVAL

JUL 09 2015

John G. Williams Limited, Architect

FRONT ELEVATION 'B'

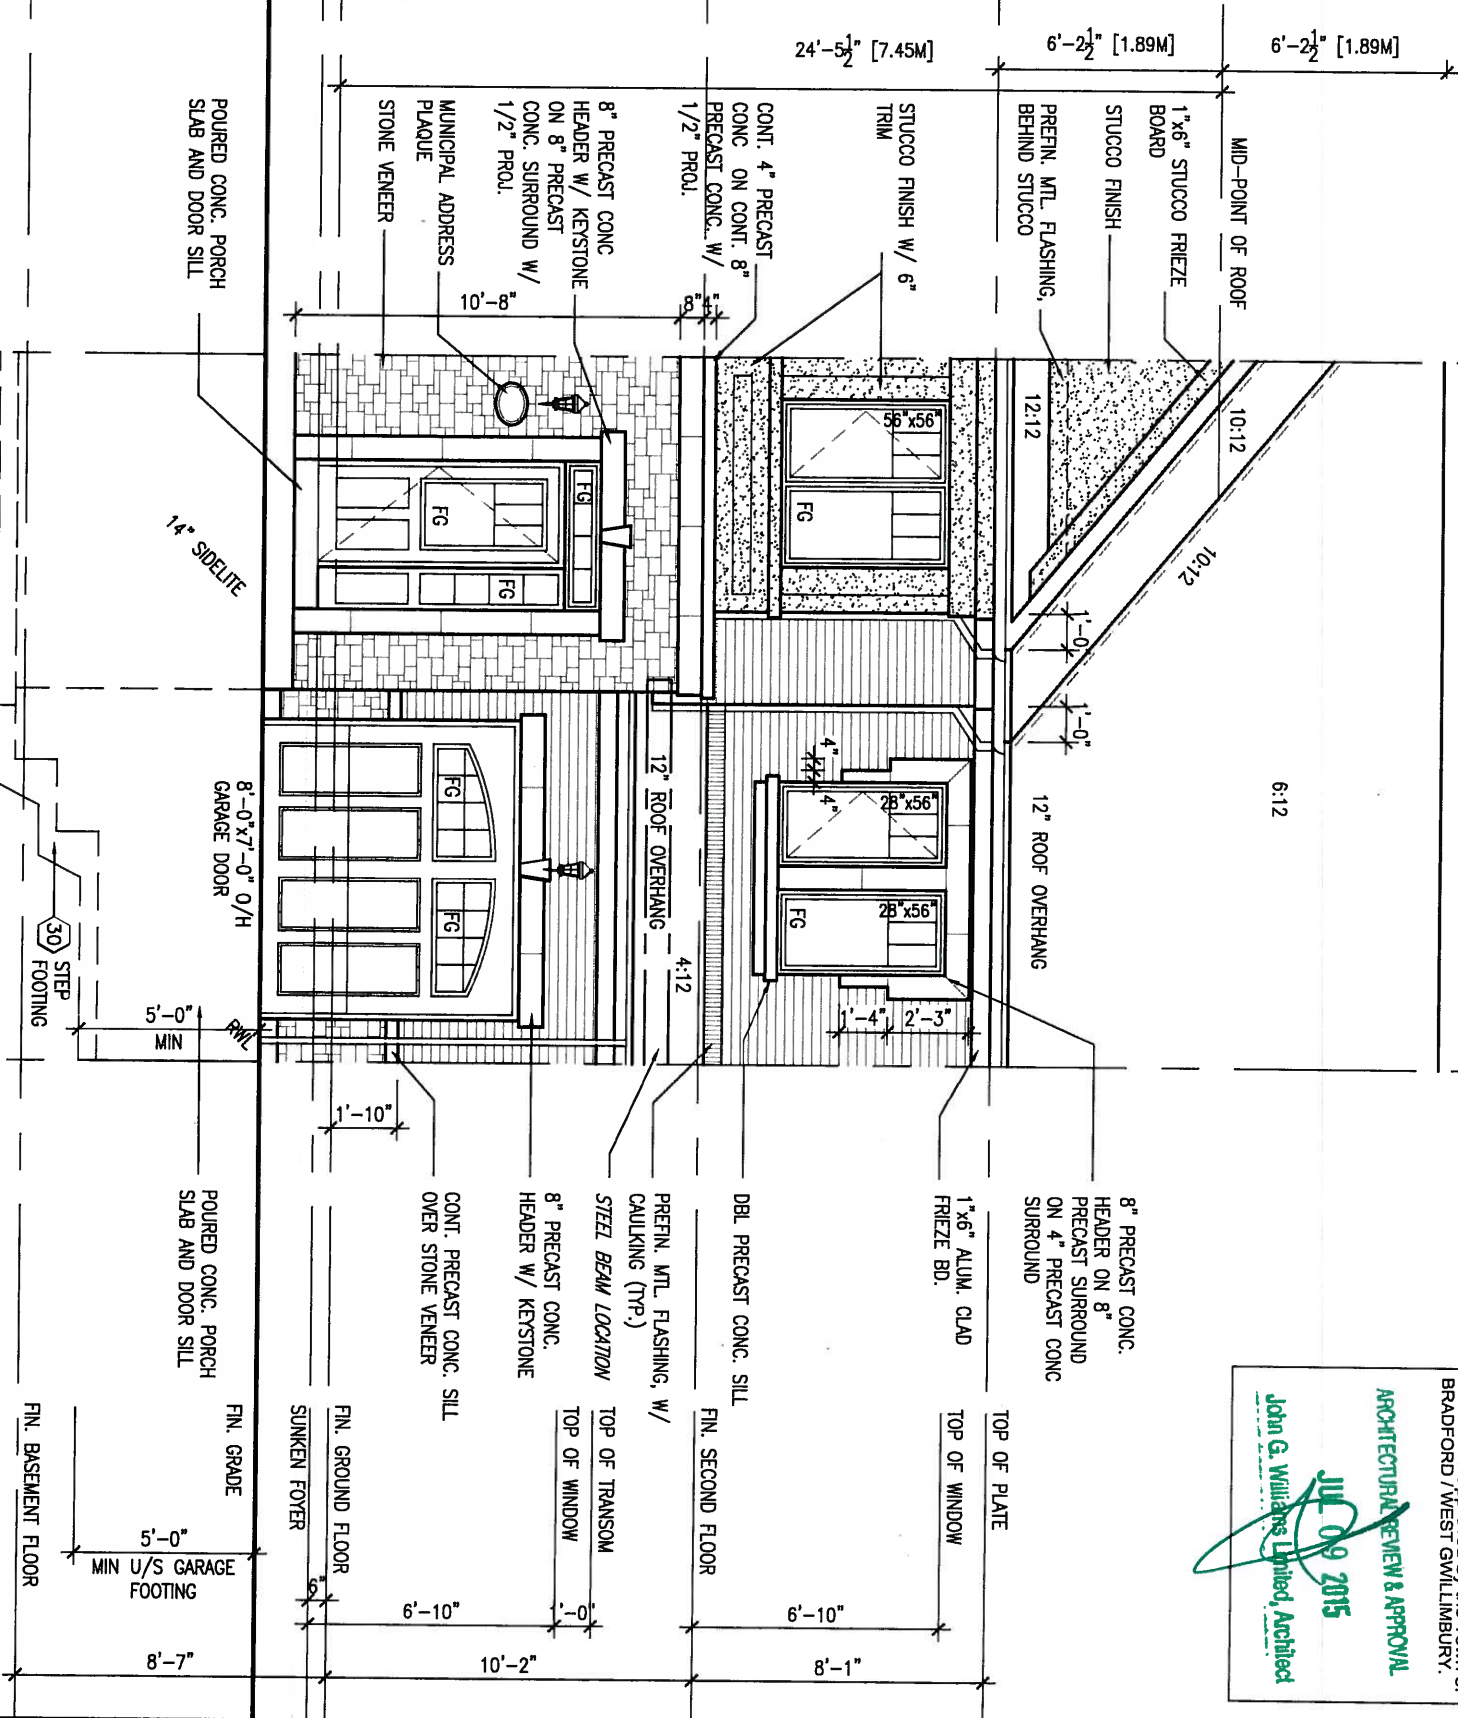

no.	description	date	by
9			
8			
7			
6			
5	REVISED EXT. COLS	MAY 25-15	AF
4	ADD COLD CELLAR, 5'-0 FROST PROTECTION	JUL 21-14	QS
3	REVISED AS PER ENG COMMENTS	MAY 30-14	RC
2	REVISED AS PER TRUSS COORDINATION	MAY 17-14	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information

Wellington Jno-Baptista 25591
signature
BCIN
42658

name registration information
VA3 Design Inc.

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON		TH1 NAPA 1	
project name GREEN VALLEY ESTATES	municipality BRADFORD	project no. 13045	drawing no. 6
date APR 2014	checked by RC	scale 3/16" = 1'-0"	FRONT ELEVATIONS
file name 13045-TH1			
RICHARD H \ARCHIVE\WORKING\2013\13045 BW\un\ts\6.0M TOWNS\13045 TH1.dwg Wed Jul 1 2015 - 11:49 AM			



JULY 3, 2015

It is the builder's complete responsibility to ensure that all work is constructed in accordance with the applicable Architectural Design Guidelines approved by the Town of Bradford / West Gwillimbury. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

TH1
NAPA 1

project no.
13045

drawing no.

7

BAYVIEW WELLINGTON

project name
GREEN VALLEY ESTATES

municipality
BRADFORD

date
APR 2014

INTERIOR SIDE ELEVATION 'A'

drawn by
RC

checked by

scale
3/16" = 1'-0"

file name
13045-TH1

**VA3
DESIGN**

300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com


The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information

Wellington Jno-Baptiste 25591

name
registration information
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

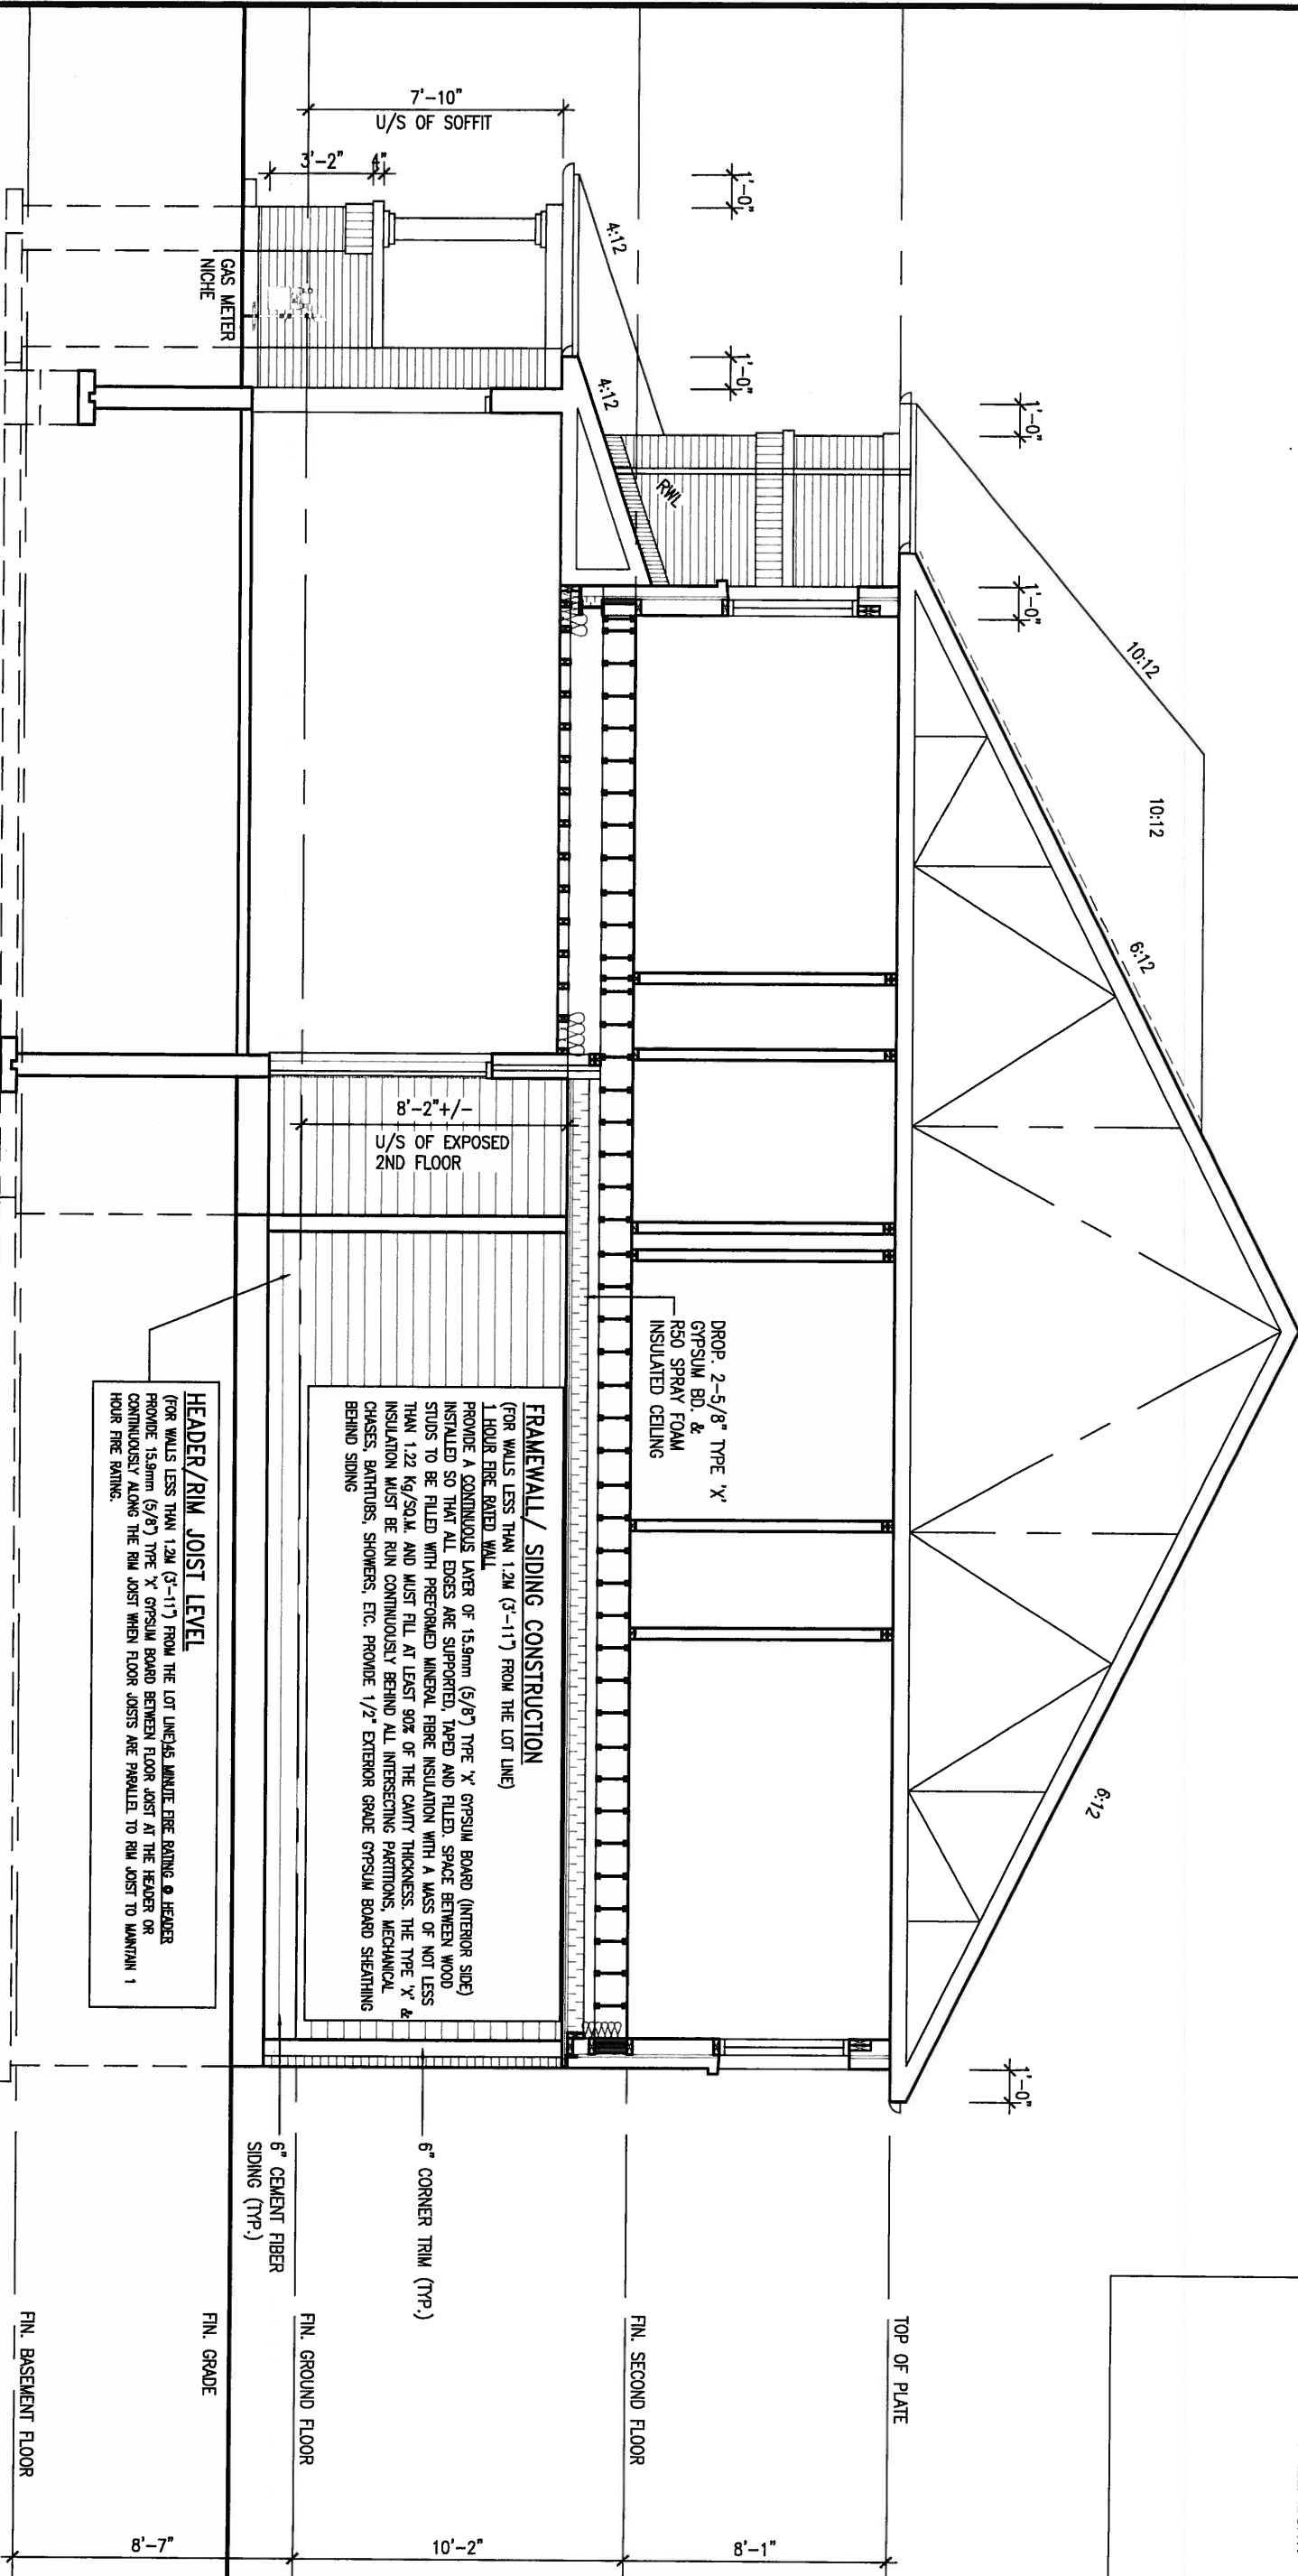

INTERIOR SIDE ELEVATION - ELEV. 'A'


no.	description	date	by
9			
8			
7			
6			
5	REVISED EXT. COLS	MAY 25-15	AF
4	ADD COLD CELLAR, 5'-0 FROST PROTECTION	JUL 21-14	QS
3	REVISED AS PER ENG COMMENTS	MAY 30-14	RC
2	REVISED AS PER TRUSS COORDINATION	MAY 17-14	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC

UNINSULATED OPENINGS (PER OBC, SB-12.2.1.1(7))			
TH-1 ELEVATION A & A MOD W/O	ENERGY EFFICIENCY - OBC SB12		
ELEVATION	WALL AREA S.F.	OPENING S.F.	PERCENTAGE
FRONT	398 S.F.	47.72 S.F.	11.99 %
LEFT SIDE	1018 S.F.	0 S.F.	0.00 %
RIGHT SIDE	925 S.F.	0 S.F.	0.00 %
REAR	455 S.F.	131.67 S.F.	28.94 %
TOTAL SQ. FT.	2796.00 S.F.	179.39 S.F.	6.42 %
TOTAL SQ. M.	259.75 S.M.	16.67 S.M.	6.42 %

UNINSULATED OPENINGS (PER OBC, SB-12.2.1.1(7))			
TH-1 ELEVATION B W/O	ENERGY EFFICIENCY - OBC SB12		
ELEVATION	WALL AREA S.F.	OPENING S.F.	PERCENTAGE
FRONT	398 S.F.	47.72 S.F.	11.99 %
LEFT SIDE	1018 S.F.	0 S.F.	0.00 %
RIGHT SIDE	925 S.F.	0 S.F.	0.00 %
REAR	455 S.F.	131.67 S.F.	28.94 %
TOTAL SQ. FT.	2796.00 S.F.	179.39 S.F.	6.42 %
TOTAL SQ. M.	259.75 S.M.	16.67 S.M.	6.42 %



CROSS SECTION A-A

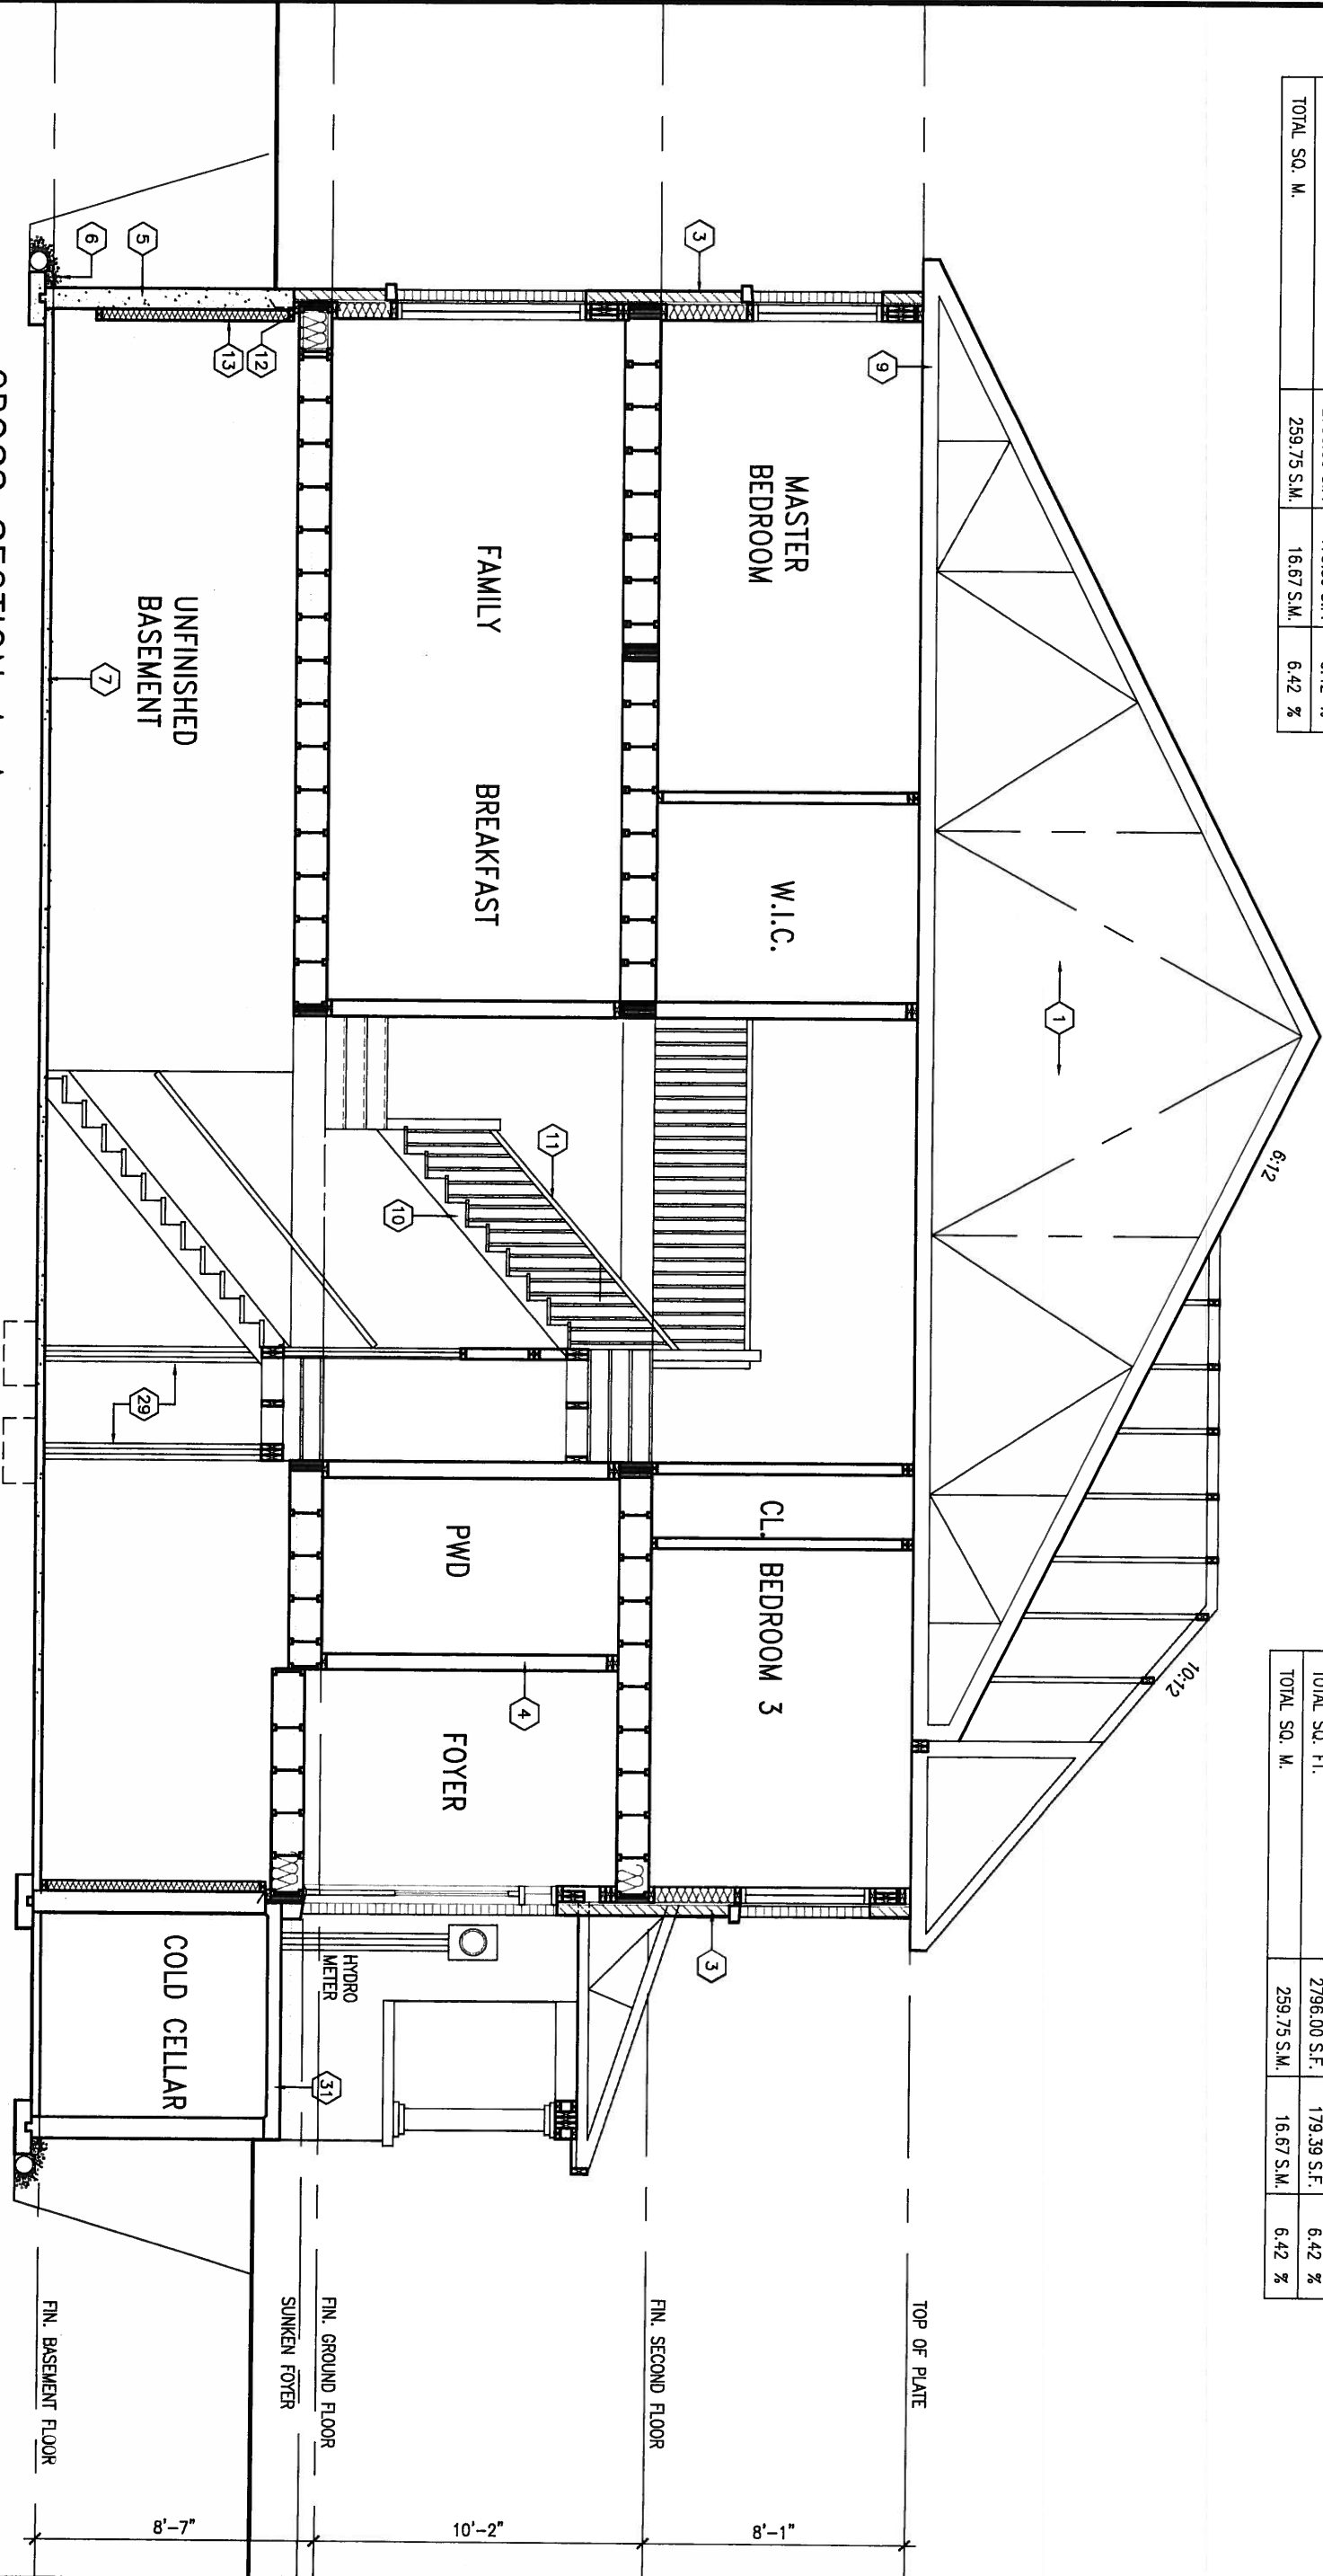

no.	description	date	by
9	.	.	.
8	.	.	.
7	.	.	.
6	.	.	.
5	REVISED EXT. COLS	MAY 25-15	AF
4	ADD COLD CELLAR, 5'-0 FROST PROTECTION	JUL 21-14	QS
3	REVISED AS PER ENG COMMENTS	MAY 30-14	RC
2	REVISED AS PER TRUSS COORDINATION	MAY 17-14	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.




qualification information

Wellington Jno-Baptiste 25591
signature
name registration information BCN
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON		TH1 NAPA 1	project no. 13045
project name GREEN VALLEY ESTATES	municipality BRADFORD	SECTION 13045-TH1	
date APR 2014	checked by RC	scale 3/16" = 1'-0"	drawing no. 10
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\6.0M TOWNS\13045-TH1.dwg - Wed - Jul 1 2015 - 11:49 AM			

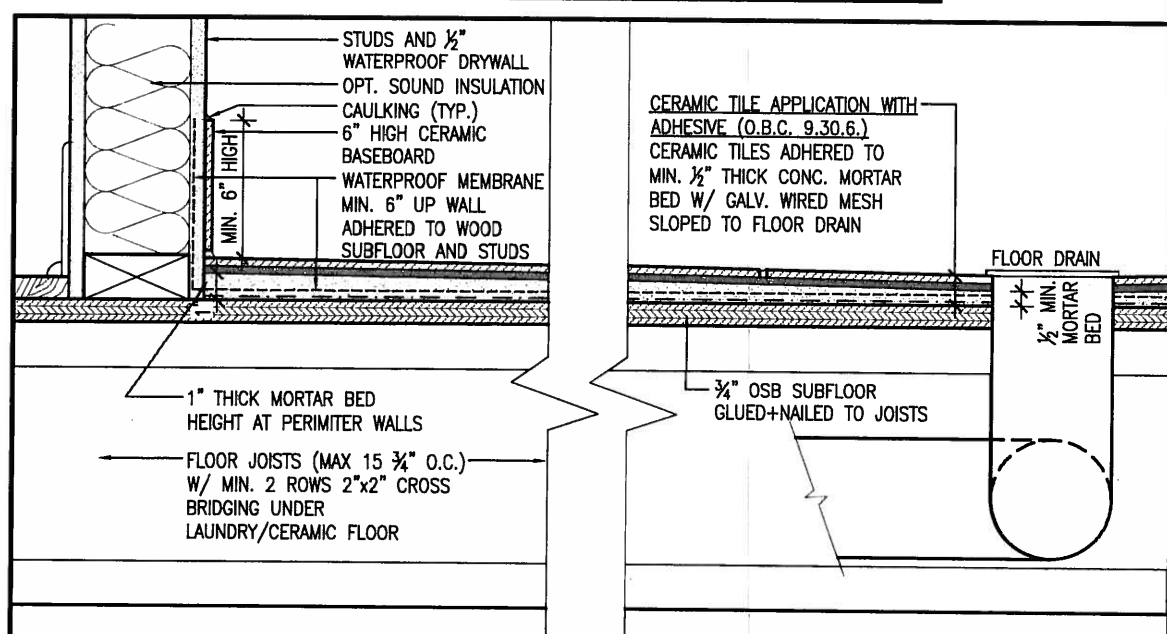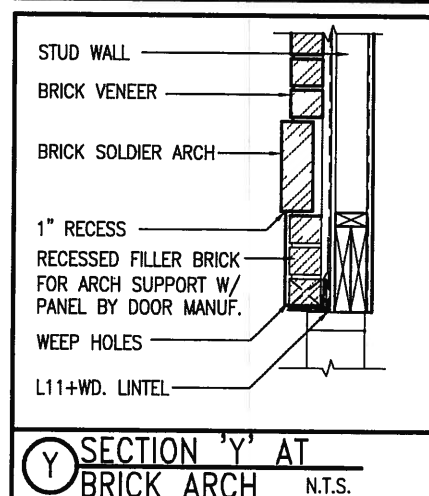

BAYVIEW WELLINGTON		TH1 NAPA 1	
project name GREEN VALLEY ESTATES		municipality BRADFORD	
date APR 2014		project no. 13045	
drawn by RC		checked by -	
scale 3/16" = 1'-0"		details 13045-TH1	
drawing no. AD1			

CONSTRUCTION NOTES (Unless otherwise noted)

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. **ONT. REG. 332/12-2012 OBC**

1. ROOF CONSTRUCTION

NO.210 [10.25kg/m²] ASPHALT SHINGLES, 10mm [3/8"] PLYWOOD SHEATHING WITH "H" CLIPS, APPROVED WOOD TRUSSES @ 600mm [24"] O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm [3'-0"] FROM EDGE OF ROOF AND MIN. 300mm [12"] BEYOND INNER FACE OF EXTERIOR WALL, [EAVES PROTECTION NOT REQ'D FOR ROOF SLOPES 8:12 OR GREATER] 38x89 [2"x4"] TRUSS BRACING @ 1830mm [6'-0"] O.C. AT BOTTOM CHORD, PREFIN. ALUM. EAVESTROUGH, FASCIA, R/WL & VENTED SOFFIT, PROVIDE ICE & WATER SHIELD TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE DAMMING. ROOF SHEATHING TO BE FASTENED 150 [6"] c/c ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 [16"]. ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT RIDGE [OBC 9.19.1.2.].

2. FRAME WALL CONSTRUCTION (2"x6") (SB-12-TABLE 2.1.1.2.A) SIDING AS PER ELEV., 19x38 [1"x2"] VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm [3/8"] EXT. TYPE SHEATHING, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INT. DRYWALL FINISH, SIDING TO BE MIN. 200mm [8"] ABOVE FINISH GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION.

2A. FRAME WALL CONSTRUCTION (2"x6") (R28) SIDING AS PER ELEV., 19x38 [1"x2"] VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 28mm [1 1/8"] EXTERIOR STRUCTURAL INSULATED SHEATHING RSI 0.7 [R4] BY "BP" OR EQUAL, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., RSI 4.23 [R24] INSUL. AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INT. DRYWALL FINISH, SIDING TO BE MIN. 200mm [8"] ABOVE FINISH GRADE.

2B. FRAME WALL CONSTRUCTION (2"x4")- GARAGE WALLS SIDING AS PER ELEV., 19x38 [1"x2"] VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm [3/8"] EXT. TYPE SHEATHING, 38x89 [2"x4"] STUDS @ 400mm [16"] O.C. (MAX. HEIGHT 3000mm [9'-10"], WITH APPR. DIAGONAL WALL BRACING, SIDING TO BE MIN. 200mm [8"] ABOVE FINISH GRADE.

2C. RESERVED

2D. STUCCO WALL CONSTRUCTION (2"x4")-GARAGE WALLS STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.[2] & 9.28 THAT EMPLOY A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm [1"] MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPROVED AIR/MOISTURE BARRIER ON 13mm [1/2"] EXT. TYPE SHEATHING ON 38x89 [2"x4"] STUDS @ 400 [16"] O.C.. STUCCO TO BE MIN. 200 [8"] ABOVE FINISH GRADE.

2E. WALLS ADJACENT TO ATTIC SPACE - NO CLADDING 9.5mm [3/8"] EXT. TYPE SHEATHING, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INTERIOR DRYWALL FINISH. MID-HEIGHT BLOCKING REQ'D. IF NO SHEATHING APPLIED. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION.

3. BRICK VENEER CONSTRUCTION (2"x6") (SB-12-TABLE 2.1.1.2.A) 90mm [4"] FACE BRICK, 25mm [1"] AIR SPACE, 22x180x0.76mm [7/8"x7"x0.03"] GALV. METAL TIES @ 400mm [16"] O.C. HORIZONTAL 600mm [24"] O.C. VERTICAL. APPROVED SHEATHING PAPER, 9.5mm [3/8"] EXT. TYPE SHEATHING, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., INSULATION & APPR. VAPOUR BARRIER WITH APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INTERIOR DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm [32"] O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm [6"] BEHIND BUILDING PAPER. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. BRICK TO BE MIN. 150mm [6"] ABOVE FINISH GRADE.

3A. BRICK VENEER CONSTRUCTION (2"x6") (R28) 90mm [4"] FACE BRICK, 25mm [1"] AIR SPACE, 22x180x0.76mm [7/8"x7"x0.03"] GALV. METAL TIES @ 400mm [16"] O.C. HORIZONTAL 600mm [24"] O.C. VERTICAL. APPR. SHEATHING PAPER, 28mm [1 1/8"] EXT. STRUCT. INSULATED SHEATHING RSI 0.7 [R4] BY "BP" OR EQUAL, 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., RSI 4.23 [R24] INSUL. & APPR. VAPOUR BARRIER WITH APPR. CONTIN. AIR BARRIER, 13mm [1/2"] INT. DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm [32"] O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm [6"] BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm [6"] ABOVE FINISH GRADE.

3B. BRICK VENEER CONSTRUCTION (2"x4")- GARAGE WALLS 90mm [4"] FACE BRICK, 25mm [1"] AIR SPACE, 22x180x0.76mm [7/8"x7"x0.03"] GALV. METAL TIES @ 400mm [16"] O.C. HORIZONTAL 600mm [24"] O.C. VERTICAL. APPR. SHEATHING PAPER, 9.5mm [3/8"] EXT. TYPE SHEATHING, 38x89 [2"x4"] STUDS @ 400mm [16"] O.C. (MAX. HEIGHT 3000mm 9'-10") WITH APPR. DIAGONAL WALL BRACING. PROVIDE WEEP HOLES @ 800mm [32"] O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm [6"] BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm [6"] ABOVE FINISH GRADE.

3C. STUCCO WALL CONSTRUCTION (2"x6") STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.1.1.[2] & 9.28 THAT EMPLOYS A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm [1"] MIN. EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 13mm [1/2"] EXT. TYPE SHEATHING ON 38x140 [2"x6"] STUDS @ 400mm [16"] O.C., INSULATION, APPROVED VAPOUR BARRIER, 13mm [1/2"] GYPSUM WALLBOARD INTERIOR FINISH. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. STUCCO TO BE MIN. 200 [8"] ABOVE FINISH GRADE.

4. INTERIOR STUD PARTITIONS FOR BEARING PARTITIONS 38x89 [2"x4"] @ 400mm [16"] O.C. FOR 2 STOREYS AND 300mm [12"] O.C. FOR 3 STOREYS, NON-BEARING PARTITIONS 38x89 [2"x4"] @ 400mm [24"] O.C. PROVIDE 38x89 [2"x4"] BOTTOM PLATE AND 2/38x89 [2/2"x4"] TOP PLATE, 13mm [1/2"] INT. DRYWALL BOTH SIDES OF STUDS, PROVIDE 38x140 [2"x6"] STUDS/PLATES WHERE NOTED.

5. FOUNDATION WALL/FOOTINGS: (9.15.3, 9.15.4, 9.13.2, 9.14.2.1.(2)) 200mm [8"] POURED CONC. FDTN. WALL 15MPa [2200psi] WITH BITUMENOUS DAMPPROOFING AND DRAINAGE LAYER, DRAINAGE LAYER REQ'D. WHEN BASEMENT INSUL. EXTENDS 900 [2'-11"] BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D. WHEN FDTN. WALL IS WATERPROOFED. MAXIMUM POUR HEIGHT 2390 [7'-10"] ON 500x155 [20"x6"] CONTINUOUS KEYED CONC. FTG. BRACE FDTN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL, WITH MIN. BEARING CAPACITY OF 150kPa OR GREATER. IF SOIL BEARING DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED. STOREYS SUPPORTED [W/ MASONRY VENEER] [W/ SIDING ONLY]

1	16" WIDE x 6" DEEP	16" WIDE x 6" DEEP
2	20" WIDE x 6" DEEP	20" WIDE x 6" DEEP
3	24" WIDE x 9" DEEP	20" WIDE x 6" DEEP

-SEE OBC 9.15.3.
-MAXIMUM FLOOR LIVE LOAD OF 2.4kPa. [50psf.] PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.9m [16'-1"].
-REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING CAPACITY.

STRIP FOOTING SUPPORTING EXTERIOR WALLS (FOR W.O.B.) -ASSUMING MASONRY VENEER CONSTRUCTION, MAX. FLOOR LIVE LOAD OF 2.4kPa. [50psf.] PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.9m [16'-1"]. THE STRIP FOOTING SIZE IS AS FOLLOWS:

2 STOREY WITH WALK-OUT BASEMENT 545x175 [22"x7"]

6. FOUNDATION DRAINAGE OBC 9.14.2. & 9.14.3. 100mm [4"] DIA. FOUNDATION DRAINAGE TILE 150mm [6"] CRUSHED STONE OVER AND AROUND DRAINAGE TILES.

7. BASEMENT SLAB OBC 9.3.1.6.(1)(b), 9.16.4.5.(1), 9.25.3.3.(15) 80mm [3"] MIN. 25MPa [3600psi] CONC. SLAB ON 100mm [4"] COARSE GRANULAR FILL, OR 20MPa [3000psi] CONC. WITH DAMPPROOFING BELOW SLAB, UNDER SLAB INSULATION PER SB-12. ALL SLAB JOINTS & PENETRATIONS TO BE CAULKED.

8. EXPOSED FLOOR TO EXTERIOR (SB-12-TABLE 2.1.1.2.A) PROVIDE RSI 5.46 [R31] INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

9. ATTIC INSULATION (SB-12-TABLE 2.1.1.2.A) (SB-12-2.1.1.7) RSI 8.81 [R50] BLOWN IN ROOF INSULATION AND APPROVED VAPOUR BARRIER, 16mm [5/8"] INT. DRYWALL FINISH OR APPROVED EQUAL, RSI 3.52 [R20] MIN. ABOVE INNER SURFACE OF EXTERIOR WALL

10. ALL STAIRS/EXTERIOR STAIRS -OBC 9.8.- UNIFORM RISE -5mm [1/4"] MAX BETWEEN ADJACENT TREADS OR LANDINGS -10mm [1/2"] MAX BETWEEN TALLEST & SHORTEST RISE IN FLIGHT

MAX. RISE = 200 [7'-7/8"]
MIN. RUN = 210 [8'-1/4"]
MIN. TREAD = 235 [9'-1/4"]
MAX. NOSING = 25 [1"]
MIN. HEADROOM = 1950 [6'-5"]
RAIL @ LANDING = 900 [2'-11"]
RAIL @ STAIR = 865 [2'-10"] TO 965 [3'-2"]
MIN. STAIR WIDTH = 860 [2'-10"]
FOR CURVED STAIRS
MIN. RUN = 150 [6"]
MIN. AVG. RUN = 200 [8"]

11. HANDRAILS -OBC 9.8.7.- FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm [4"] BETWEEN PICKETS. CLEARANCE BETWEEN HANDRAIL AND SURFACE BEHIND IT TO BE 50 [2"] MIN. HANDRAILS TO BE CONTINUOUS EXCEPT FOR NEWEL POST AT CHANGES OF DIRECTION .
INTERIOR GUARDS -OBC 9.8.8.- INTERIOR GUARDS: 900mm [2'-11"] MIN. HIGH
EXTERIOR GUARDS - OBC 9.8.8. 900mm [36"] HIGH GUARD WHERE DISTANCE FROM PORCH TO FIN. GRADE IS LESS THAN 1800mm [71"]. 1070mm [42"] HIGH GUARD IS REQUIRED WHERE DISTANCE EXCEEDS 1800mm [71"].

12. SILL PLATE - OBC 9.23.7. 38x89 [2"x4"] SILL PLATE WITH 13mm [1/2"] DIA. ANCHOR BOLTS 200mm [8"] LONG, EMBEDDED MIN. 100mm [4"] INTO CONC. @ 2400mm [7'-10"] O.C., CAULKING OR 25 [1"] MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FDTN. WALL. USE NON-SHRINK GROUT TO LEVEL SILL PLATE WHEN REQUIRED.

13. BASEMENT INSULATION (SB-12-2.1.1.6), 9.25.2.3, 9.13.2.6) FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm [8"] ABOVE THE FINISHED FLOOR & NO CLOSER THAN 50mm [2"] OF THE BASEMENT SLAB. INSULATION TO HAVE APPROVED VAPOUR BARRIER, DAMPPROOF WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL. NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. AIR BARRIER TO BE SEALED TO FDTN. WALL WITH CAULKING.

14. BEARING STUD PARTITION 38x89 [2"x4"] STUDS @ 400mm [16"] O.C. 38x89 [2"x4"] SILL PLATE ON DAMPPROOFING MATERIAL, 13mm [1/2"] DIA. ANCHOR BOLTS 200mm [8"] LONG, EMBEDDED MIN. 100mm [4"] INTO CONC. @ 2400mm [7'-10"] O.C. 100mm [4"] HIGH CONC. CURB ON 500x155 [14"x6"] CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15. STEEL BASEMENT COLUMNS (SEE O.B.C. 9.15.3.3) 89mm [3-1/2"] DIA x 3.0mm [0.118] SINGLE WALL TUBE TYPE 2 ADJUSTABLE STL. COL. W/ MIN. CAPACITY OF 71.2kn [16,000lbs.] AT A MAX. EXTENSION OF 2318mm [7'-7 1/2"] CONFORMING TO CAN/CSSB-7.2.94. AND WITH 150x150x9.5 [6"x6"x3/8"] STL. PLATE TOP & BOTTOM. 870x870x10 [34"x34"x1/2"] CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 kPa. MINIMUM AND AS PER SOILS REPORT.

15A. STEEL BASEMENT COLUMN (SEE O.B.C. 9.15.3.3) 89mm [3-1/2"] DIA x 4.78mm [1.88] FIXED STL. COL. WITH 150x150x9.5 [6"x6"x3/8"] STL. TOP & BOTTOM PLATE ON 1070x1070x460 [42"x42"x18"] CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 Kpa. MIN. AND AS PER SOILS REPORT.

15B. STEEL COLUMN 90mm [3-1/2"] DIA x 4.78mm [1.88] NON-ADJUSTABLE STL. COL. TO BE ON 150x150x9.5 [6"x6"x3/8"] STEEL TOP PLATE, & BOTTOM PLATE. BASE PLATE 120x250x12.5 [4 1/2"x10"x1/2"] WITH 2-12mm DIA. x 300mm LONG x50mm HOOK ANCHORS [2-1/2"x12"x2"] FIELD WELD COL. TO BASE PLATE.

16. BEAM POCKET OR 300x150 [12"x6"] POURED CONC. NIB WALLS. MIN. BEARING 90mm [3-1/2"]

17. 19x64 [1"x3"] CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM.

18. GARAGE SLAB 100mm [4"] 32MPa [4640psi] CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 [4"] COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT.

19. GARAGE CEILING/INTERIOR WALLS 13mm [1/2"] GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. TAPE AND SEAL ALL JOINTS AIRTIGHT PER O.B.C. 9.10.9.1.6. REFER TO SB-12, TABLE 2.1.1.2.A. FOR REQUIRED THERMAL INSULATION.

20. DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING PER OBC 9.10.13.15.

21. EXTERIOR STEP PRECAST CONCRETE STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 200mm [7'-7/8"] MIN. TREAD 250mm [9'-1/2"]. SEE OBC 9.8.9.2., 9.8.9.3. & 9.8.10.

22. DRYER EXHAUST (OBC-6.2.3.8.(7) & 6.2.4.11.) CAPPED DRYER EXHAUST VENTED TO EXTERIOR. (USE 100mm [4"] DIA. SMOOTH WALL VENT PIPE)

23. INSULATED ATTIC ACCESS (OBC-9.19.2.1. & SB12-2.1.1.7) ATTIC ACCESS HATCH WITH MIN. DIMENSION OF 545x610mm [21 1/2"x24"] & A MIN. AREA OF 0.32 SQ.M. [3.44 SQ.F.T.] WITH WEATHERSTRIPPING. RSI 3.52 [R20] RIGID INSUL. BACKING.

24. FIREPLACE CHIMNEYS OBC 9.2.1. TOP OF FIREPLACE CHIMNEY SHALL BE 915mm [3'-0"] ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm [2'-0"] ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm [10'-0"] FROM THE CHIMNEY.

25. LINEN CLOSET, 4 SHELVES MIN. 350mm [14"] DEEP.

26. MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC 9.32.3.5. & 9.32.3.10.

27. STEEL BEARING PLATE FOR MASONRY WALLS 280x280x16 [11"x11"x5/8"] STL. PLATE FOR STL BEAMS AND 280x280x12 [11"x11"x1/2"] STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL, ANCHORED WITH 2-19mm [3/4"] x 200mm [8"] LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

OR
SOLID WOOD BEARING FOR WOOD STUD WALLS SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPRISED OF BUILT-UP WOOD STUDS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC 9.17.4.2(2).

28. RESERVED

29. BEARING WOOD POST (BASEMENT) (OBC 9.17.4.) 3-38x140 [3-2"x6"] BUILT-UP POST ON METAL BASE JOE ANCHORED TO CONC. WITH 12.7 DIA. BOLT, 610x610x300 [24"x24"x12"] CONC. FOOTING.

30. STEPPED FOOTINGS OBC 9.15.3.9. MIN. HORIZ. STEP = 600mm [24"]
MAX. VERT. STEP = 600mm [24"]

31. SLAB ON GRADE MIN. 100mm [4"] CONCRETE SLAB ON GRADE ON 100mm [4"] COARSE GRANULAR FILL. REINFORCED WITH 6x6-W2.9xW2.9 MESH PLACED NEAR MID-DEPTH OF SLAB. CONC. STRENGTH 32 MPa [4640 psi] WITH 5-8% AIR ENTRAINMENT ON COMPACTED SUB-GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION UNDER SLAB.

32. DIRECT VENTING GAS FURNACE/ H.W.T VENT DIRECT VENT FURNACE TERMINAL MIN. 900mm [36"] FROM A GAS REGULATOR, MIN. 300mm [12"] ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. HRV INTAKE TO BE A MIN. OF 1830mm [6'-0"] FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.

33. DIRECT VENTING GAS FIREPLACE VENT DIRECT VENT GAS FIREPLACE. VENT TO BE A MINIMUM 300mm [12"] FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

34. SUBFLOOR JOIST STRAPPING AND BRIDGING 16mm [5/8"] T & G SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION (* SEE OBC 9.30.6. *) 6mm [1/4"] PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. (* SEE OBC 9.30.2. *) FLOOR JOISTS WITH SPANS OVER 2100mm [6'-11"] TO BE BRIDGED WITH 38x38 [2"x2"] CROSS BRACING OR SOLID BLOCKING @ 2100mm [6'-11"] O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A-1 OR A-2 STRAPPING SHALL BE 19x64 [1"x3"] @ 2100mm [6'-11"] O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED. (* SEE OBC 9.23.9.4. *)

35. EXPOSED BUILDING FACE OBC 9.10.15. & SB-2-2.3.5.(2) EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE LIMITING DISTANCE [LD] IS LESS THAN 1.2M [3'-11"]. WHERE THE LD IS LESS THAN 600mm [1'-11"] THE EXPOSING FACE SHALL BE CLAD IN NON-COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES. OFFENDING GARAGE WALLS INCLUDED.

36. COLD CELLAR PORCH SLAB (OBC 9.40.) FOR MAX. 2500mm [8'-2"] PORCH DEPTH (SHORTEST DIM.), 150mm [6"] 32MPa [4640psi] CONC. SLAB WITH 5-8% AIR ENTRAINMENT. REINF. WITH 10M BARS @ 200mm [7 7/8"] O.C. EACH WAY IN BOTTOM THIRD OF SLAB, MIN. 30mm [1 1/4"] COVER, 600x600 [23 5/8"x23 5/8"] 10M DOWELS @ 600mm [23 5/8"] O.C., ANCHORED IN PERIMETER FDTN. WALLS. SLOPE SLAB MIN. 1.0% FROM HOUSE WALL. SLAB TO HAVE MIN. 75mm [3"] BEARING ON FDTN. WALLS. PROVIDE [L7] LINTEL OVER CELLAR DOOR WITH 100mm [4"] END BEARING.

37. THE FDTN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm [3-1/2"] THICK TO A MAX. DEPTH OF 600mm [24"] AND SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm [8"] O.C. VERTICALLY AND 900mm [36"] O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

38. CONVENTIONAL ROOF FRAMING (2.0Kpa. SNOW LOAD) 38x140 [2"x6"] RAFTERS @ 400mm [16"] O.C. FOR MAX 11'-7" SPAN, 38x184 [2"x8"] RIDGE BOARD, 38x89 [2"x4"] COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x89 [2"x4"] @ 400mm [16"] O.C. FOR MAX. 2830mm [9'-3"] SPAN & 38x140 [2"x6"] @ 400 [16"] O.C. FOR MAX. 4450mm [14'-7"] SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x89 [2"x4"] @ 600mm [24"] O.C. WITH A 38x89 [2"x4"] CENTRE POST TO THE TRUSS BELOW, LATERALLY BRACED @ 1800mm [6'-0"] O.C. VERTICALLY.

GENERAL NOTES

WINDOWS: 1) MINIMUM BEDROOM WINDOW -OBC 9.9.10.1.- AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS TO HAVE MIN. 0.35m² UNSTRUCTURED GLAZED OR OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380 mm [1'-3"].

2) WINDOW GUARDS -OBC 9.8.8.1.(8). A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm [1'-7"] ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm [5'-11"]

3) EXTERIOR WINDOWS SHALL COMPLY WITH OBC DIV.-8.9.7.3. & SB12-2.1.1.8

GENERAL: 1) MECHANICAL VENTILATION IS REQUIRED TO COMPLY WITH OBC-DIV. B. 6.2.2. SEE MECHANICAL DRAWINGS.
2) ALL DOWNSPOUTS TO DRAIN AWAY FROM THE BUILDING AS PER OBC 9.26.18.2. & 5.6.2.2.(3) & MUNICIPAL STANDARDS
3) ALL WINDOW WELLS TO DRAIN TO FOOTING LEVEL PER OBC 9.14.6.3. CHECK WITH THE LOCAL AUTHORITY.
4) STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM. REFER TO OBC 9.5.2.3, 3.8.3.8.1)(d) & 3.8.3.13.(1)(i). SEE DETAIL.
5) ALL EXTERIOR DOORS TO COMPLY WITH THERMAL RESISTANCE AS STATED IN O.B.C. SB-12-2.1.1.

6) ALL AIR BARRIER SYSTEMS ARE REQUIRED TO COMPLY WITH O.B.C. DIV.-8.9.25.3.

LUMBER: 1) ALL LUMBER SHALL BE SPRUCE NO.2 GRADE, UNLESS NOTED OTHERWISE.
2) STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED OTHERWISE.
3) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE No.2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.
4) ALL LAMINATED VENEER LUMBER (L.V.L.) BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY TRUSS MANUFACTURER.
5) LVL BEAMS SHALL BE 2.0E-2950fb MIN., NAIL EACH PLY OF LVL WITH 89mm [3 1/2"] LONG COMMON WIRE NAILS @ 300mm [12"] O.C. STAGGERED IN 2 ROWS FOR 184, 240 & 300mm [7 1/4", 9 1/2", 11 7/8"] DEPTHS AND STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS ADD 13mm [1/2"] DIA. GALVANIZED BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm [3'-0"] O.C.
6) PROVIDE FACE MOUNT BEAM HANGERS TYPE "SC" MANUFACTURED BY SIMPSON STRONG-TIE OR EQUAL FOR ALL LVL BEAM TO BEAM CONNECTIONS UNLESS OTHERWISE NOTED. REFER TO ENG. FLOOR LAYOUTS.
7) JOIST HANGERS: PROVIDE METAL HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP WOOD MEMBERS.
8) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONCRETE BY AT LEAST 2 mm POLYETHYLENE FILM, No. 50 (45lbs) ROLL ROOFING OR OTHER DAMPPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 150mm [6"] ABOVE THE GROUND.

STEEL: 1) STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA-G-40-21 GRADE 300W. HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO CSA-G40-21 GRADE 350W STRUCTURAL QUALITY STEEL. OBC. 9.9.23.4.3.
2) REINFORCING STEEL SHALL CONFORM TO CSA-G30-18M GRADE 400R.

STUCCO: 1) ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

LEGEND

CLASS "B" VENT
EXHAUST FAN TO EXTERIOR
DUPLUX OUTLET (12" ABOVE SURFACE)
DUPLUX OUTLET (HEIGHT A.F.F)
WEATHERPROOF DUPLUX OUTLET
GFI DUPLUX OUTLET (HEIGHT A.F.F)
POT LIGHT
HEAVY DUTY OUTLET (220 volt)
LIGHT FIXTURE (PULL CHAIN)
LIGHT FIXTURE (CEILING MOUNTED)
SWITCH
LIGHT FIXTURE (WALL MOUNTED)
FLOOR DRAIN
HOSE BIB (NON-FREEZE)

SJ SINGLE JOIST
DJ DOUBLE JOIST
TJ TRIPLE JOIST
LVL LAMINATED VENEER LUMBER
POINT LOAD FROM ABOVE
P.T. PRESSURE TREATED LUMBER
G.T. GIRDER TRUSS BY ROOF TRUSS MANUF.
F.A. FLAT ARCH
C.A. CURVED ARCH
M.C. MEDICINE CABINET (RECESSED)
CONC. BLOCK WALL
DOUBLE VOLUME WALL
SEE NOTE 39.
SOLID WOOD BEARING (SPRUCE No. 2). SOLID BEARING TO BE AS WIDE AS SUPPORTED MEMBER OR AS DIRECTED BY STRUCTURAL ENGINEER. SOLID BEARING TO BE MINIMUM 2 PIECES.

SOLID WOOD BEARING TO MATCH FROM ABOVE
CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB AND REPORT ANY DISCREPANCY TO V&3 DESIGN BEFORE PROCEEDING WITH THE WORK. ALL DRAWINGS AND SPECIFICATIONS ARE INSTRUMENTS OF SERVICE AND THE PROPERTY OF V&3 DESIGN WHICH IF REQUESTED MUST BE RETURNED AT THE COMPLETION OF THE WORK. ALL DRAWINGS TO BE USED FOR CONSTRUCTION ONLY AFTER BUILDING PERMIT HAS BEEN ISSUED.

39. TWO STOREY VOLUME SPACES

-FOR A MAXIMUM 5490 mm [18'-0"] HEIGHT AND MAXIMUM SUPPORTED ROOF TRUSS LENGTH OF 6.0m, PROVIDE 2-38x140 [2-2"x6"] SPR.#2 CONTIN. STUDS @ 300mm [12"] O.C. (TRIPLE UP AT EVERY THIRD DOUBLY STUD FOR BRICK WALLS) C/W 9.6 [3/8"] THICK EXT. PLYWOOD SHEATHING. PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 1220 mm [4'-0"] O.C. VERTICALLY. -FOR WALLS WITH HORIZ. DISTANCES NOT EXCEEDING 2900 mm [9'-4"], PROVIDE 38x140 [2"x6"] STUDS @ 400 [16"] O.C. WITH CONTINUOUS 2-38x140 [2-2"x6"] TOP PLATES & 1-38x140 [1-2"x6"] BOTTOM PLATE & MINIMUM OF 3-38x184 [3-2"x8"] CONT. HEADER AT GRND. CEILING LEVEL TOE-NAILED & GLUED AT TOP. BOTTOM PLATES AND HEADERS.

40. TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.

41. FOUNDATION WALL (W.O.D./W.O.B.) -FOR LATERAL SUPPORT WHERE GRADE TO T/O BASEMENT SLAB EXCEEDS 1200mm [3'-11"]
FOR 200mm [8"] POURED CONC. FOUNDATION WALL PROVIDE VERTICAL 38x140 [2"x6"] WOOD STUDS @ 400 [16"] o.c. MATCH FLOOR JOIST SPACING WHEN PARALLEL WITH FLOOR JOISTS. [RAMSET BOTTOM PLATE TO SLAB & FASTEN TOP OF WALL TO FLOOR JOIST AND ALSO TIED TO 38x84 [2"x4"] @ 300 [12"] o.c. KNEE WALL]. REFER TO DETAIL.



42. EXTERIOR WALLS FOR WALK-OUT CONDITIONS

THE EXTERIOR BASEMENT STUD WALL TO BE 38x140 [2"x6"] STUDS @ 400mm [16"] o.c. OR 38x89 [2"x4"] STUDS @ 300mm [12"] o.c.

ONT. REG. 332/12-2012 OBC
Amendment O. Reg. 368/13
NOV. 13, 2014
REVISED







WOOD LINTELS AND BUILT-UP WOOD BEAMS

L1	2/38 x 184 (2/2" x 8")	SPR.#2
B1	3/38 x 184 (3/2" x 8")	SPR.#2
B2	4/38 x 184 (4/2" x 8")	SPR.#2
B7	5/38 x 184 (5/2" x 8")	SPR.#2

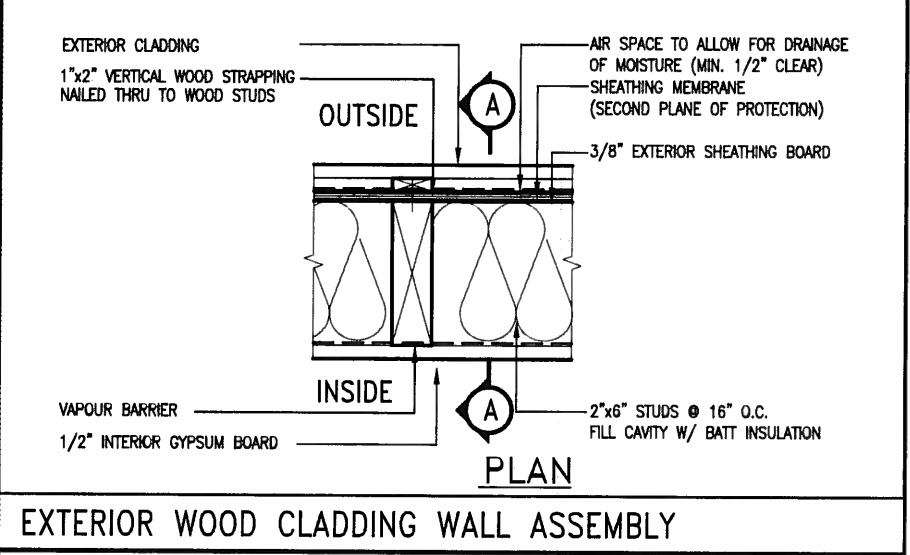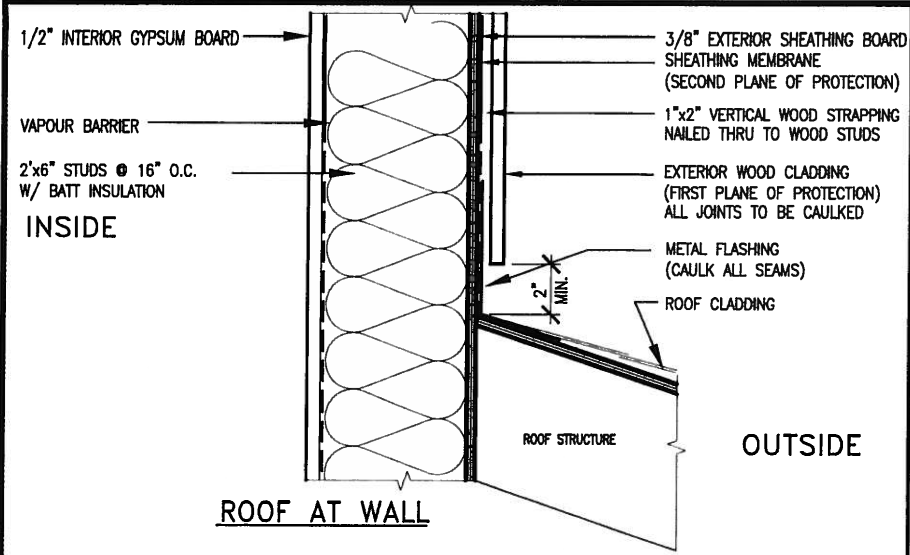

JULY 3, 2015

STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM
REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM.
FUTURE GRAB BARS TO BE MOUNTED TO RESIST HORIZ. AND VERT. LOADS OF 1.3 KN (300 lb)
REFER TO OBC, DIV. B- 9.5.2.3.. WATER CLOSET 3.8.3.8.(3)(c) & 3.8.3.8.(3)(c).. SHOWER 3.8.3.13.(2)(f).. BATHTUB & 3.8.3.13.(4)(c). AND DETAILS PROVIDED.

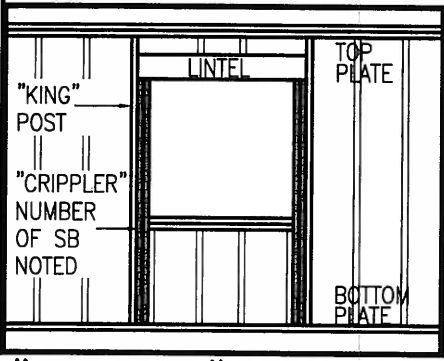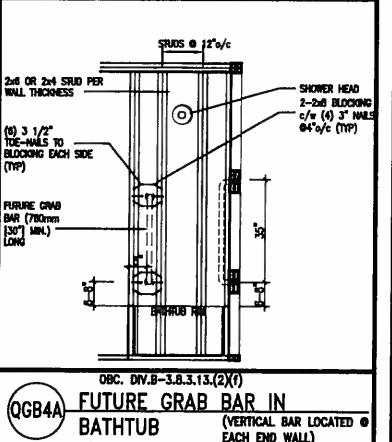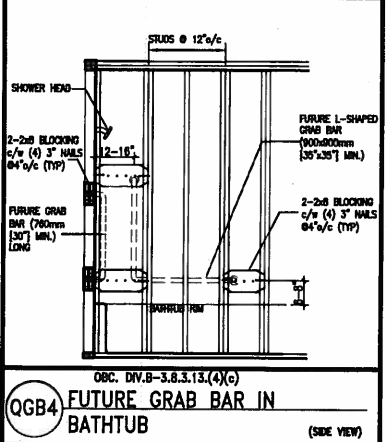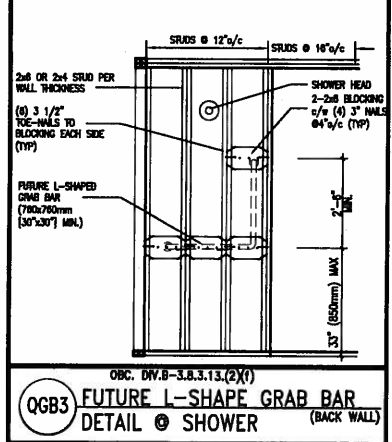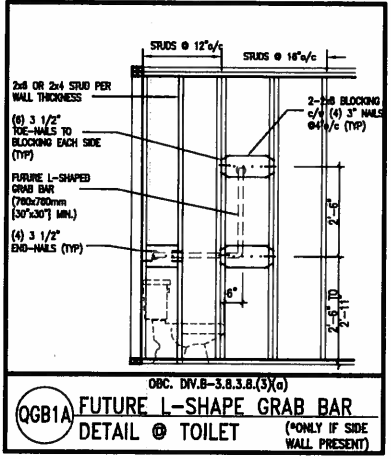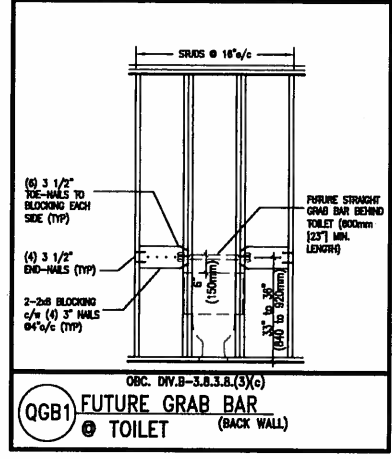

MAX. HEIGHT FOR 2"x4" GARAGE WALL IS AS FOLLOW:

2"x4" @ 16" O.C. - 9'-10"

2"x4" @ 12" O.C. - 10'-9"

3"x4" @ 16" O.C. - 11'-2"

3"x4" @ 12" O.C. - 12'-4"

NOTES:

- FOR ROOF DESIGN SNOW LOAD OF 2.5 KPa. SUPPORTED ROOF TRUSS LENGTH OF 6.0m AND FLOOR JOIST LENGTH OF 2.5m OF ONE FLOOR.
- PROVIDE HORIZONTAL SOLID BLOCKING @ 1200 O.C. (4'-0")
- PROVIDE A MINIMUM OF 9.5mm (3/8") PLYWOOD OR OSB EXTERIOR SHEATHING ON THE EXTERIOR FACE.
- FOR A 1/50 YEAR REFERENCE WIND PRESSURE OF 0.6 KPa.
- STUDS GREATER THAN 9'-10" HIGH TO BE No. 2 SPF
- STUD SPECIFICATION IS SUITABLE FOR BRICK VENEER OR SIDING.

**** MAX. HEIGHT FOR 2"x6" EXTERIOR WALL IS AS FOLLOW:**

2"x6" @ 16" O.C. - 12'-6"

2"x6" @ 12" O.C. - 13'-10"

2"x6" @ 16" O.C. - 15'-0"

2"x6" @ 12" O.C. - 17'-4"

MAX. HEIGHT FOR 2"x8" EXTERIOR WALL IS AS FOLLOWS:

2"x8" @ 16" O.C. - 16'-0"

2"x8" @ 12" O.C. - 17'-9"

2"x8" @ 16" O.C. - 20'-4"

2"x8" @ 12" O.C. - 22'-4"


NOTES:

- FOR ROOF DESIGN SNOW LOAD OF 2.5 KPa
- SUPPORTED ROOF TRUSS LENGTH OF 6.0m ONLY.
- PROVIDE HORIZONTAL SOLID BLOCKING @ 1200 O.C. (4'-0")
- PROVIDE A MINIMUM OF 9.5mm (3/8") PLYWOOD OR OSB EXTERIOR SHEATHING ON THE EXTERIOR FACE AND 12.5mm (1/2") GYPSUM BOARD ON THE INTERIOR FACE.
- WALL FRAMING SHALL CONFORM TO OBC 9.23.10.1.(2)
- FOR A 1/50 YEAR REFERENCE WIND PRESSURE OF 0.6 KPa
- STUDS GREATER THAN 9'-10" HIGH TO BE No. 2 SPF.
- STUD SPECIFICATION IS SUITABLE FOR BRICK VENEER OR SIDING.

**** STUD INFORMATION TAKEN FROM OBC TABLE A-30**

"CRIPPLE" DETAIL

9. .		The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.		 300A Wilson Avenue Toronto ON M3H 1S8 t 416.630.2255 f 416.630.4782 va3design.com	BAYVIEW WELLINGTON		CONST NOTE	
8. .		qualification information			project name		project no.	
7. .		Wellington Jno-Baptiste			GREEN VALLEY ESTATES		13045	
6. .		signature			municipality		drawing no.	
5. .		BCIN			BRADFORD		CN2	
4. .		42658		date		file name		
3. .		Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.		APR 2014		13045-CONST-OBC 2015		
2. UPDATE TO CODE		APR 16-15 RC		checked by		scale		
1. ISSUE FOR CLIENT REVIEW		MAY 07-14 RC		RC		3/16" = 1'-0"		
no. description		date by		RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Thu - Apr 16 2015 - 6:56 AM				

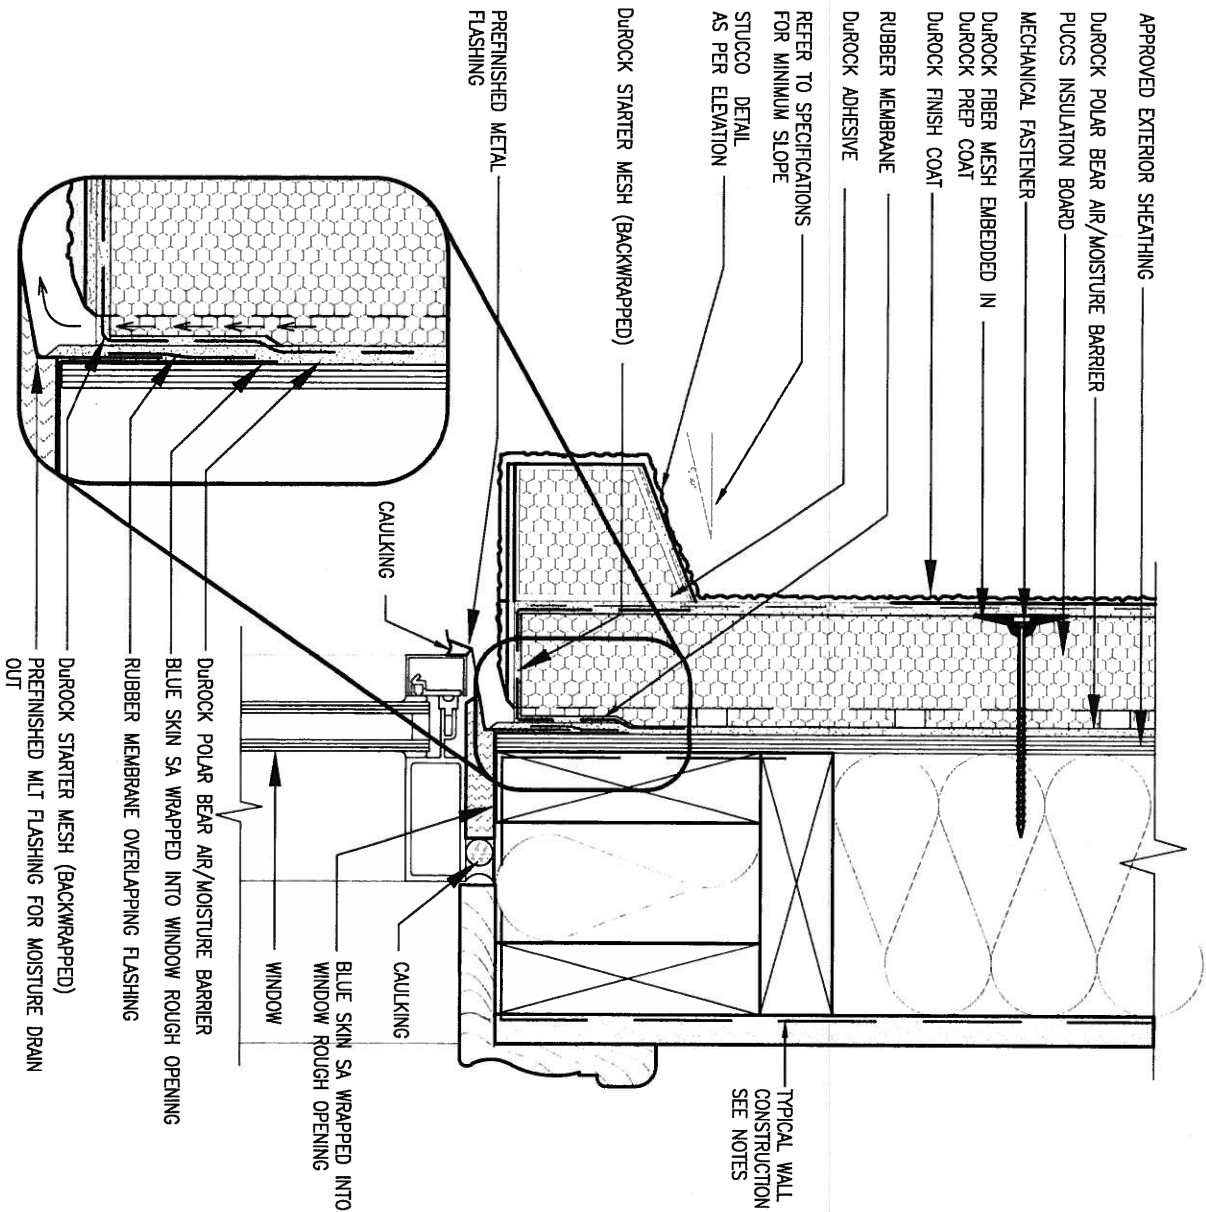


1 WINDOW HEADER

CN3 SCALE: 3"=1'-0"

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

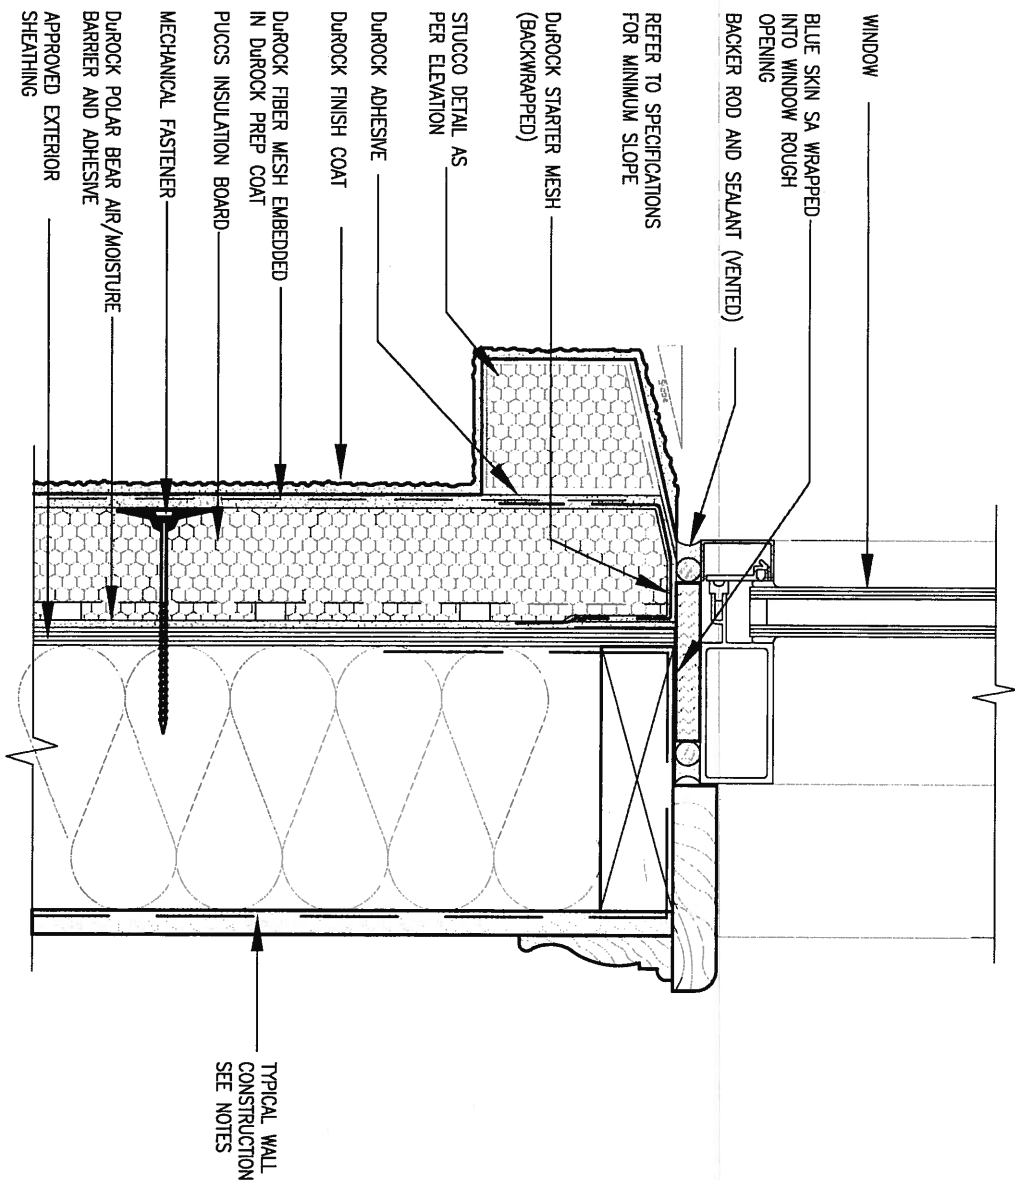

2 WINDOW SILL


CN3 SCALE: 3"=1'-0"

9.	.	.	.
8.	.	.	.
7.	.	.	.
6.	.	.	.
5.	.	.	.
4.	.	.	.
3.	.	.	.
2.	UPDATE TO CODE	APR 16-15	RC
1.	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.			
qualification information			
Wellington Jno-Baptiste		25591	
name		BCN	
registration information		42658	
VA3 Design Inc.			
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.			

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com


BAYVIEW WELLINGTON		CONST NOTE	
project name	GREEN VALLEY ESTATES	municipality	BRADFORD
date	APR 2014	project no.	13045
drawn by	RC	checked by	-
scale	3/16" = 1'-0"	CONSTRUCTION NOTES	
file name	13045-CONST-0BC 2015	drawing no.	CN3
RICHARD - H:\ARCHIVE\WORKING\2014\13045\13045-CONST-0BC 2015.dwg - Thu - Apr 16 2015 - 6:52 AM			

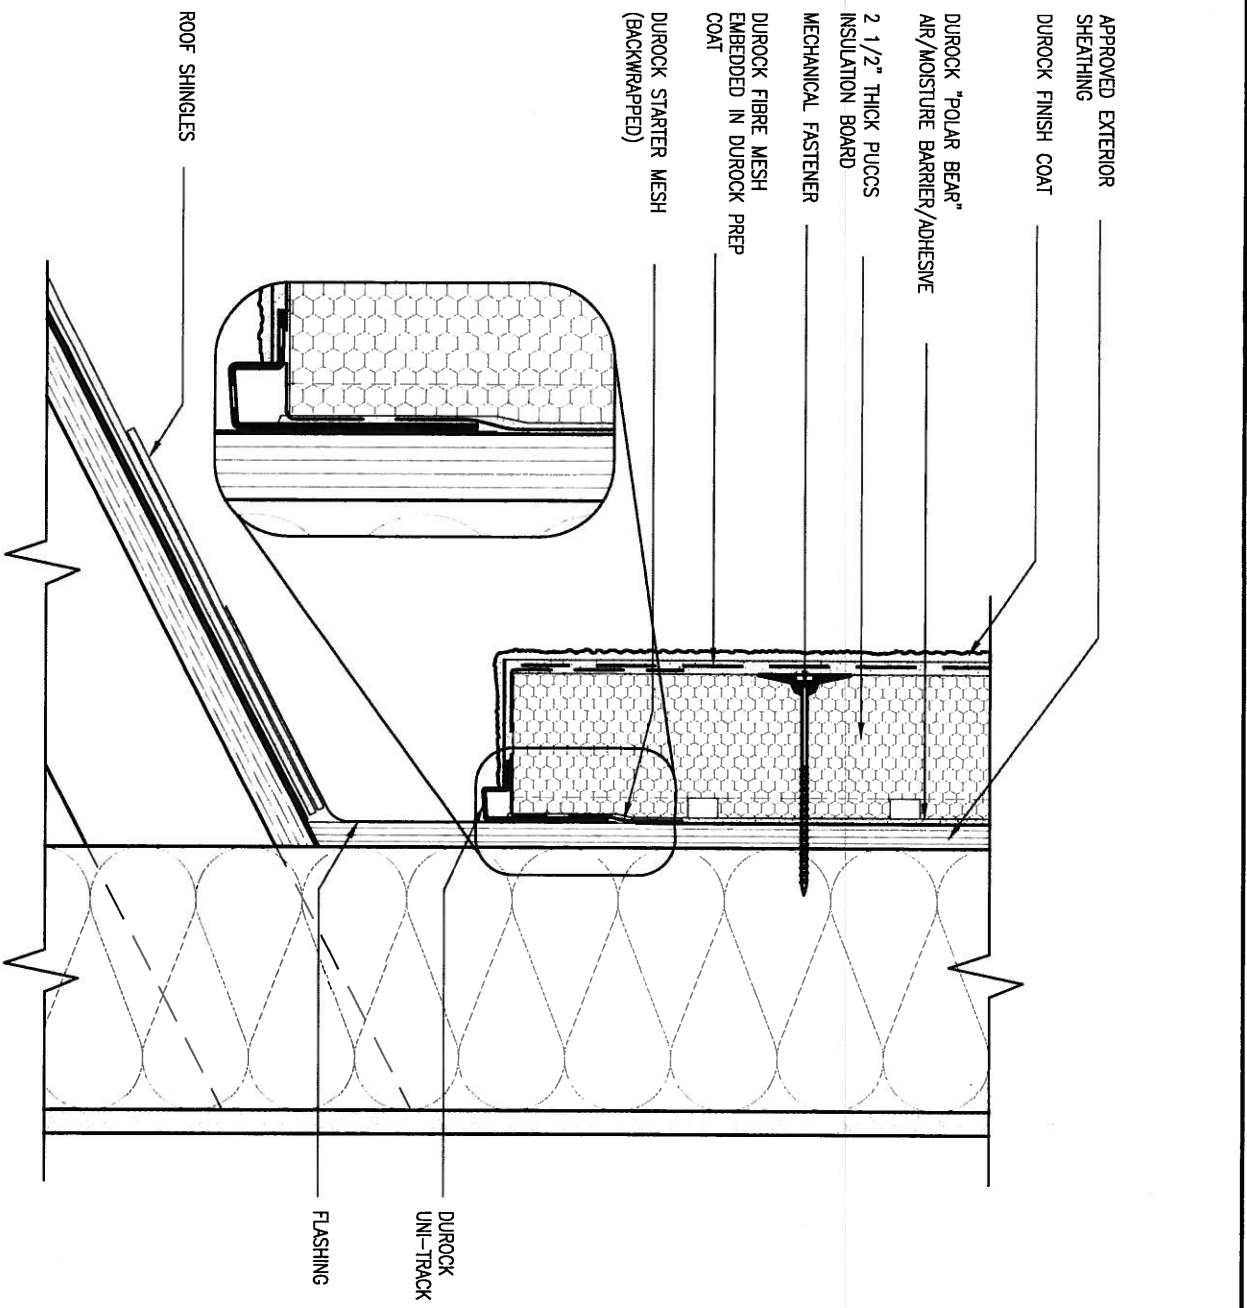

3 STUCCO TERMINATION @ ROOF

CN4 SCALE: 3"=1'-0"

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.
DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

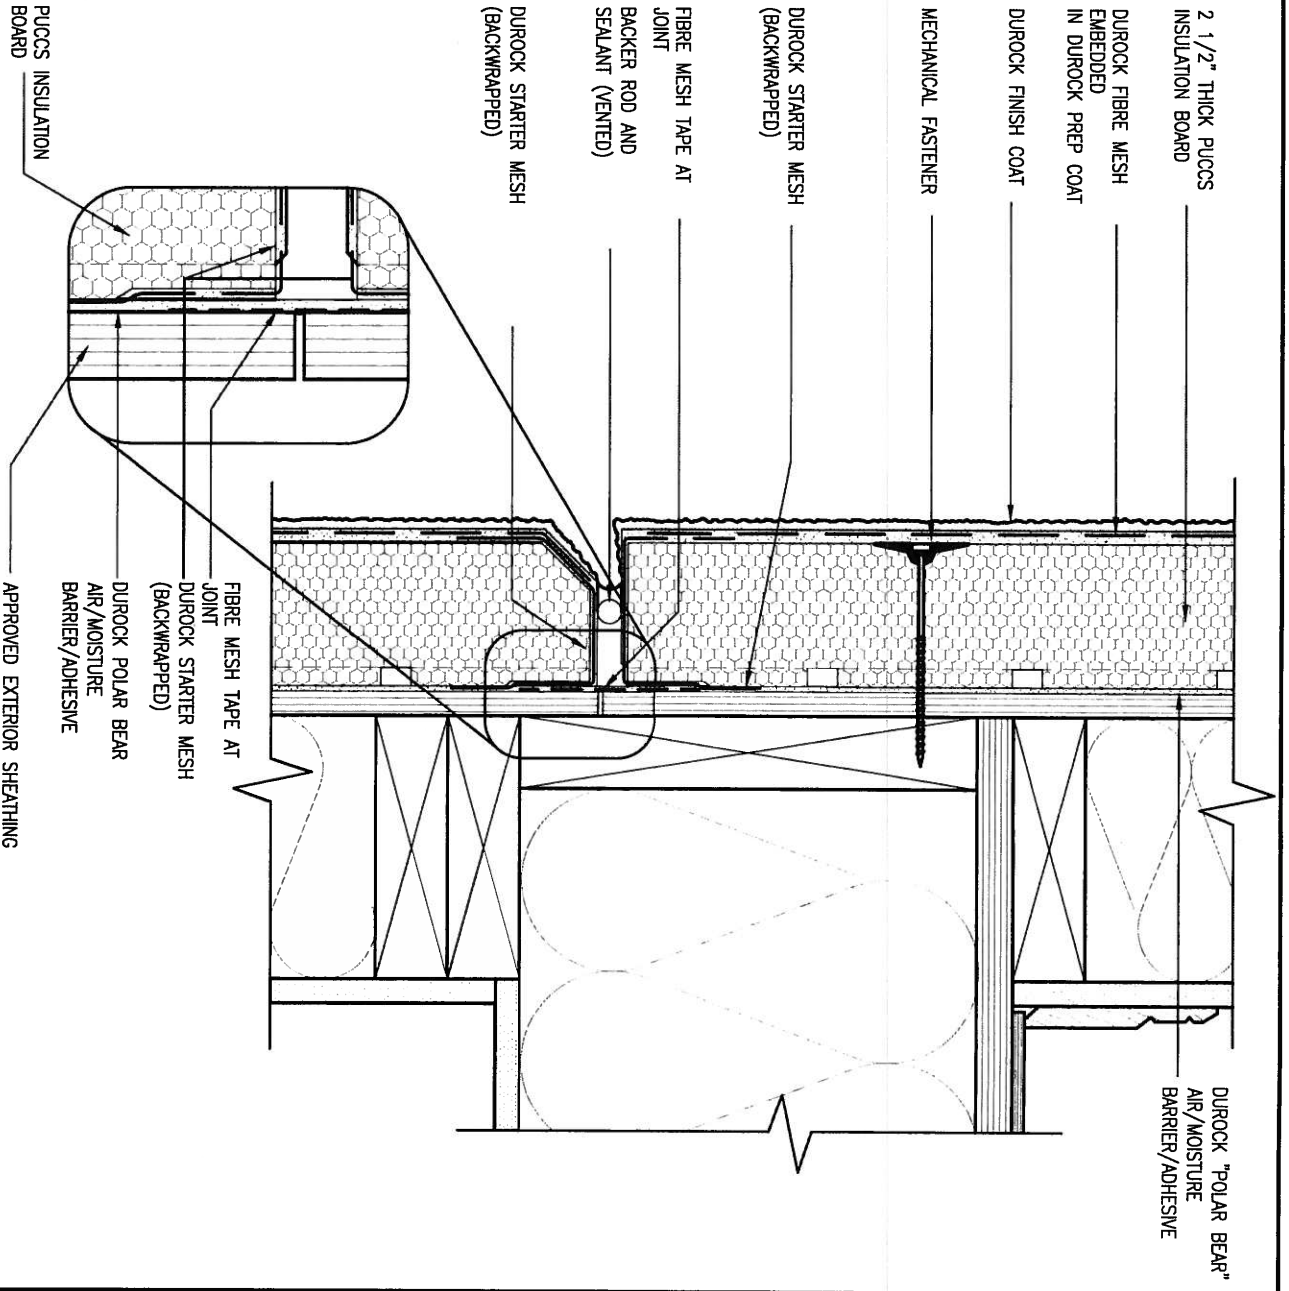

4 HORIZONTAL EXPANSION JOINT


CN4 SCALE: 3"=1'-0"

9	.	.	.
8	.	.	.
7	.	.	.
6	.	.	.
5	.	.	.
4	.	.	.
3	.	.	.
2	UPDATE TO CODE	APR 16-15	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.
qualification information
Wellington Jno-Baptiste 25591
name registration information BCN
VA3 Design Inc. 42658
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.


VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON		CONST NOTE	
project name GREEN VALLEY ESTATES	municipality BRADFORD	project no. 13045	drawing no. CN4
CONSTRUCTION NOTES			
date APR 2014	checked by RC	scale 3/16" = 1'-0"	file name 13045-CONST-0BC 2015
RICHARD - H:\ARCHIVE\WORKING\2013\13045-06\units\13045-0BC 2015.dwg - Thu - Apr 10, 2015 - 6:52 AM			

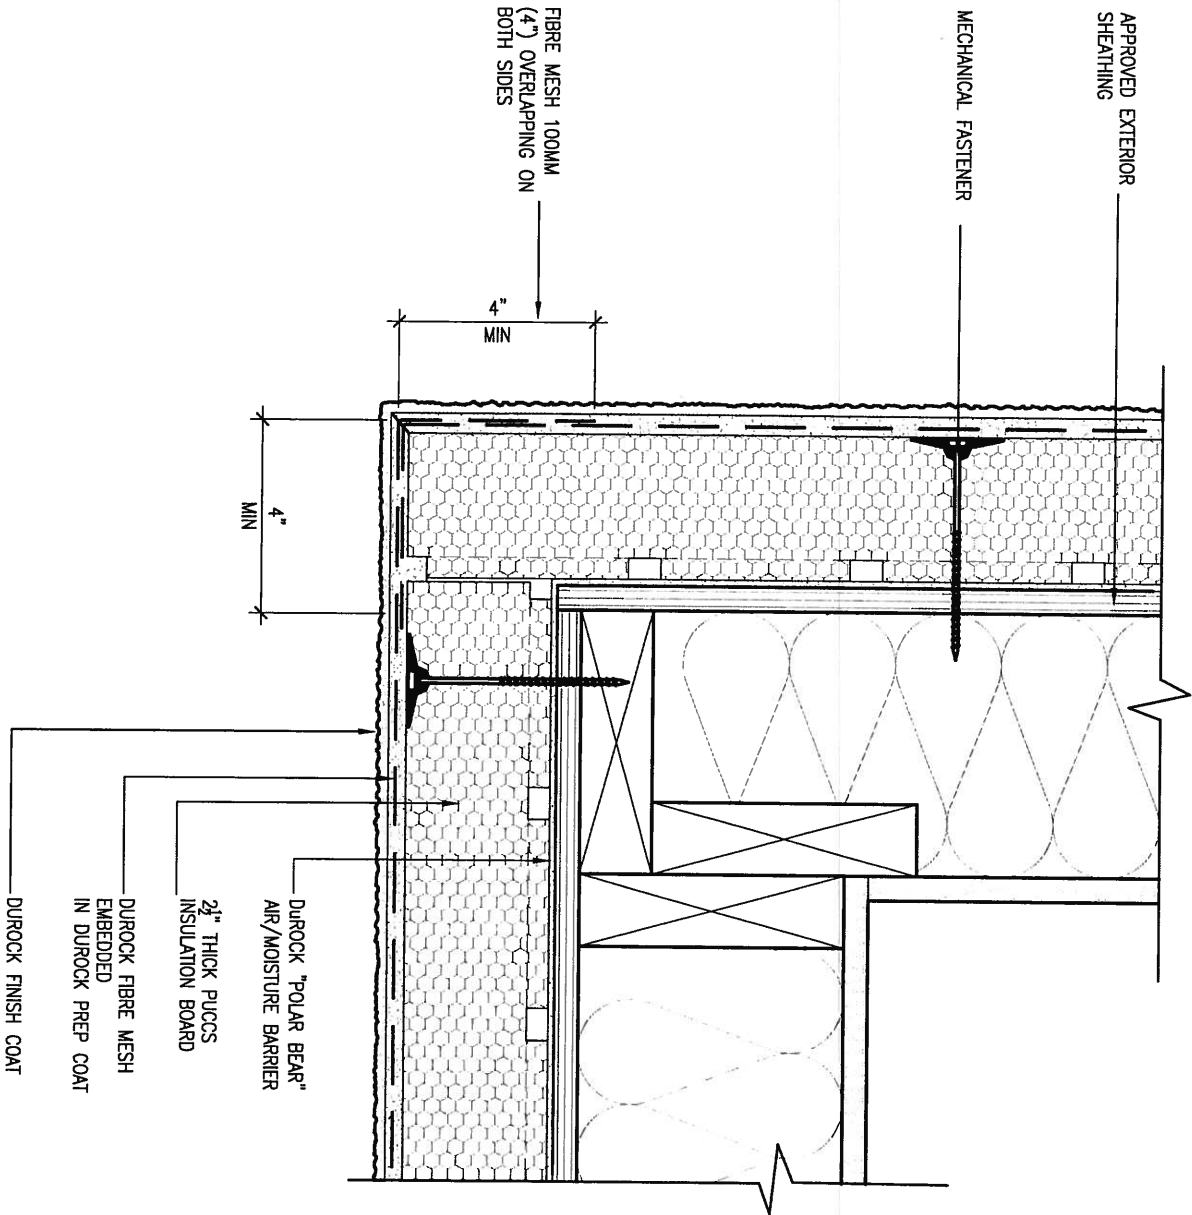

5 CORNER DETAIL
SCALE: 3"=1'-0"

ALL STUCCO WALLS TO HAVE A MINIMUM 10mm AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.
DETAILS ARE BASED ON DUROCK PUCCS SYSTEM

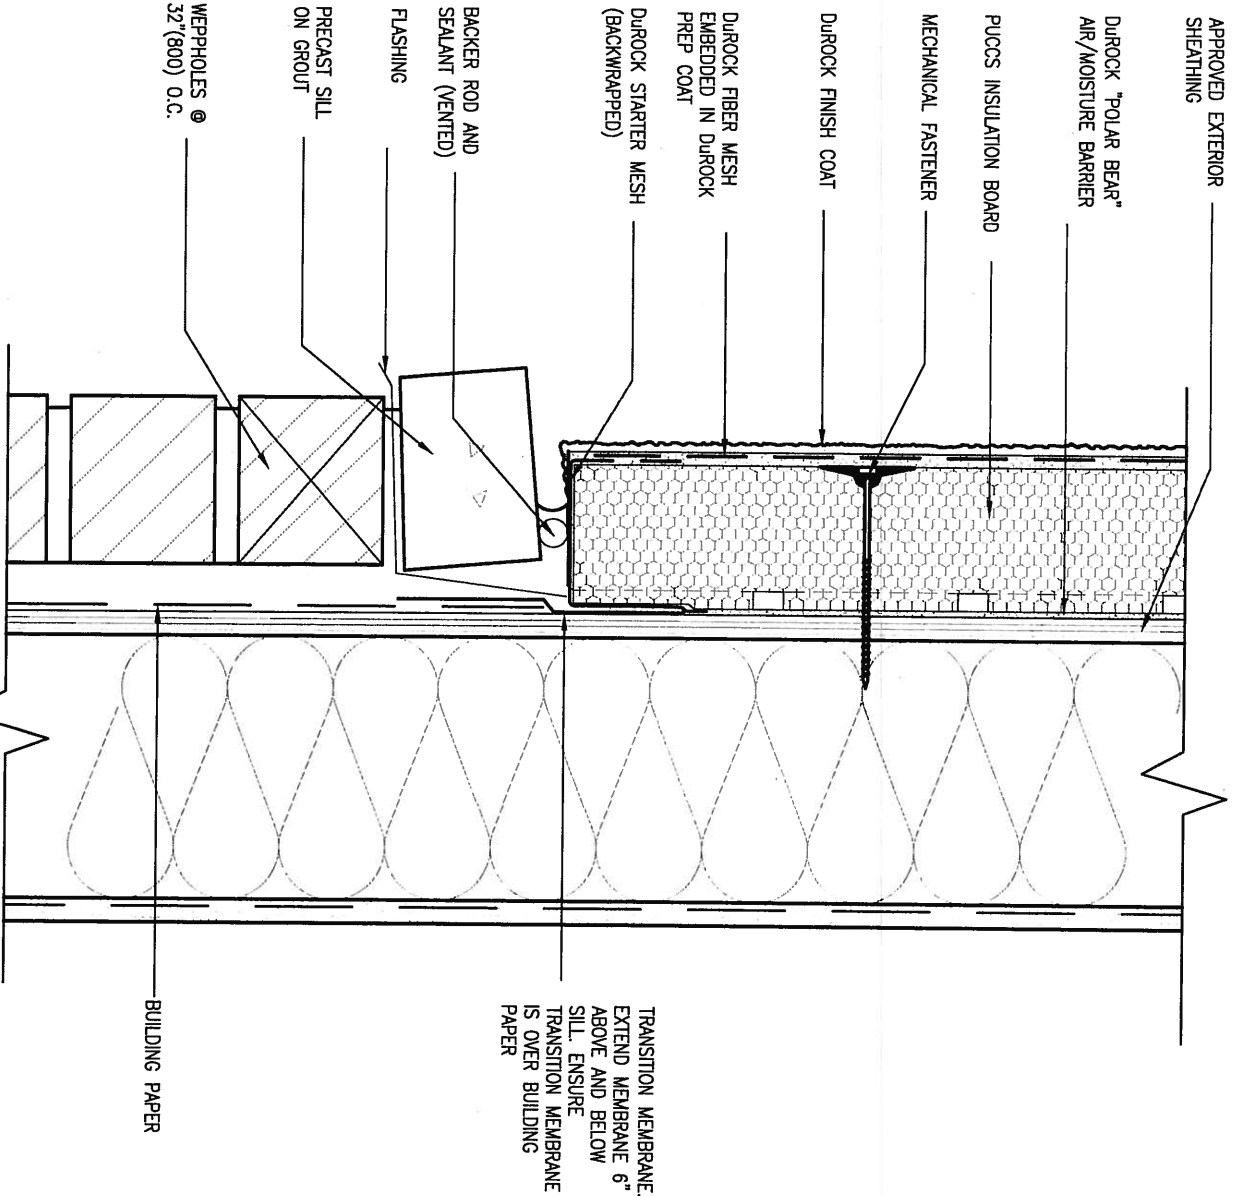

6 STUCCO / MASONRY PLINTH CONNECTION
SCALE: 3"=1'-0"

9			
8			
7			
6			
5			
4			
3			
2	UPDATE TO CODE	APR 16-15	RC
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	
qualification information	
Wellington Jno-Baptiste	25591
name	
registration information	
VA3 Design Inc.	42658
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON		CONST NOTE	
project name	GREEN VALLEY ESTATES	municipality	BRADFORD
date	APR 2014	checked by	RC
drawn by	RC	scale	3/16" = 1'-0"
CONSTRUCTION NOTES		file name	13045-CONST-08C 2015
RICHARD - H:\ARCHIVE\WORKING\2014\13045\13045-CONST-08C 2015.dwg - Thu - Apr 16, 2015 - 6:52 AM		drawing no.	CN5

SB12-COMPLIANCE PACKAGE 'D'


THE MINIMAL THERMAL PERFORMANCE OF BUILDING ENVELOPE AND EQUIPMENT SHALL CONFORM TO THE FOLLOWING SB-12 COMPLIANCE PACKAGE AS PER OBC SUPPLEMENTARY STANDARD SB-12, SECTION 2.1.1.1

USE SB-12 COMPLIANCE PACKAGE (D):

COMPONENT	D	Notes:
Ceiling with Attic Space	8.81 (R50)	BLOWN -LOOSE
Minimum RSI (R) value	(R50)	
Ceiling without Attic Space	5.46 (R31)	BATT or SPRAY
Minimum RSI (R) value	(R31)	
Exposed Floor	5.46 (R31)	BATT or SPRAY
Minimum RSI (R) value	(R31)	
Walls Above Grade	4.23 (R24)	6" R24 BATT
Minimum RSI (R) value	(R24)	
Basement Walls	3.52 (R20)	6" R20 BLANKET
Minimum RSI (R) value	(R20)	
Edge of Below Grade Slab ≤600mm below grade	1.76 (R10)	RIGID INSUL
Minimum RSI (R) value	(R10)	
Windows & Sliding glass Doors	1.8	DOUBLE PANE LOW EMISSIVITY
Maximum U-value		
Skylights	2.8	DOUBLE PANE LOW EMISSIVITY
Maximum U-value		
Space Heating Equipment	94%	NATURAL GAS
Minimum AFUE		
Hot Water Heater	0.67	NATURAL GAS
Minimum EF		
HRV	N/A	NOT REQUIRED
Minimum Efficiency		




JULY 3, 2015

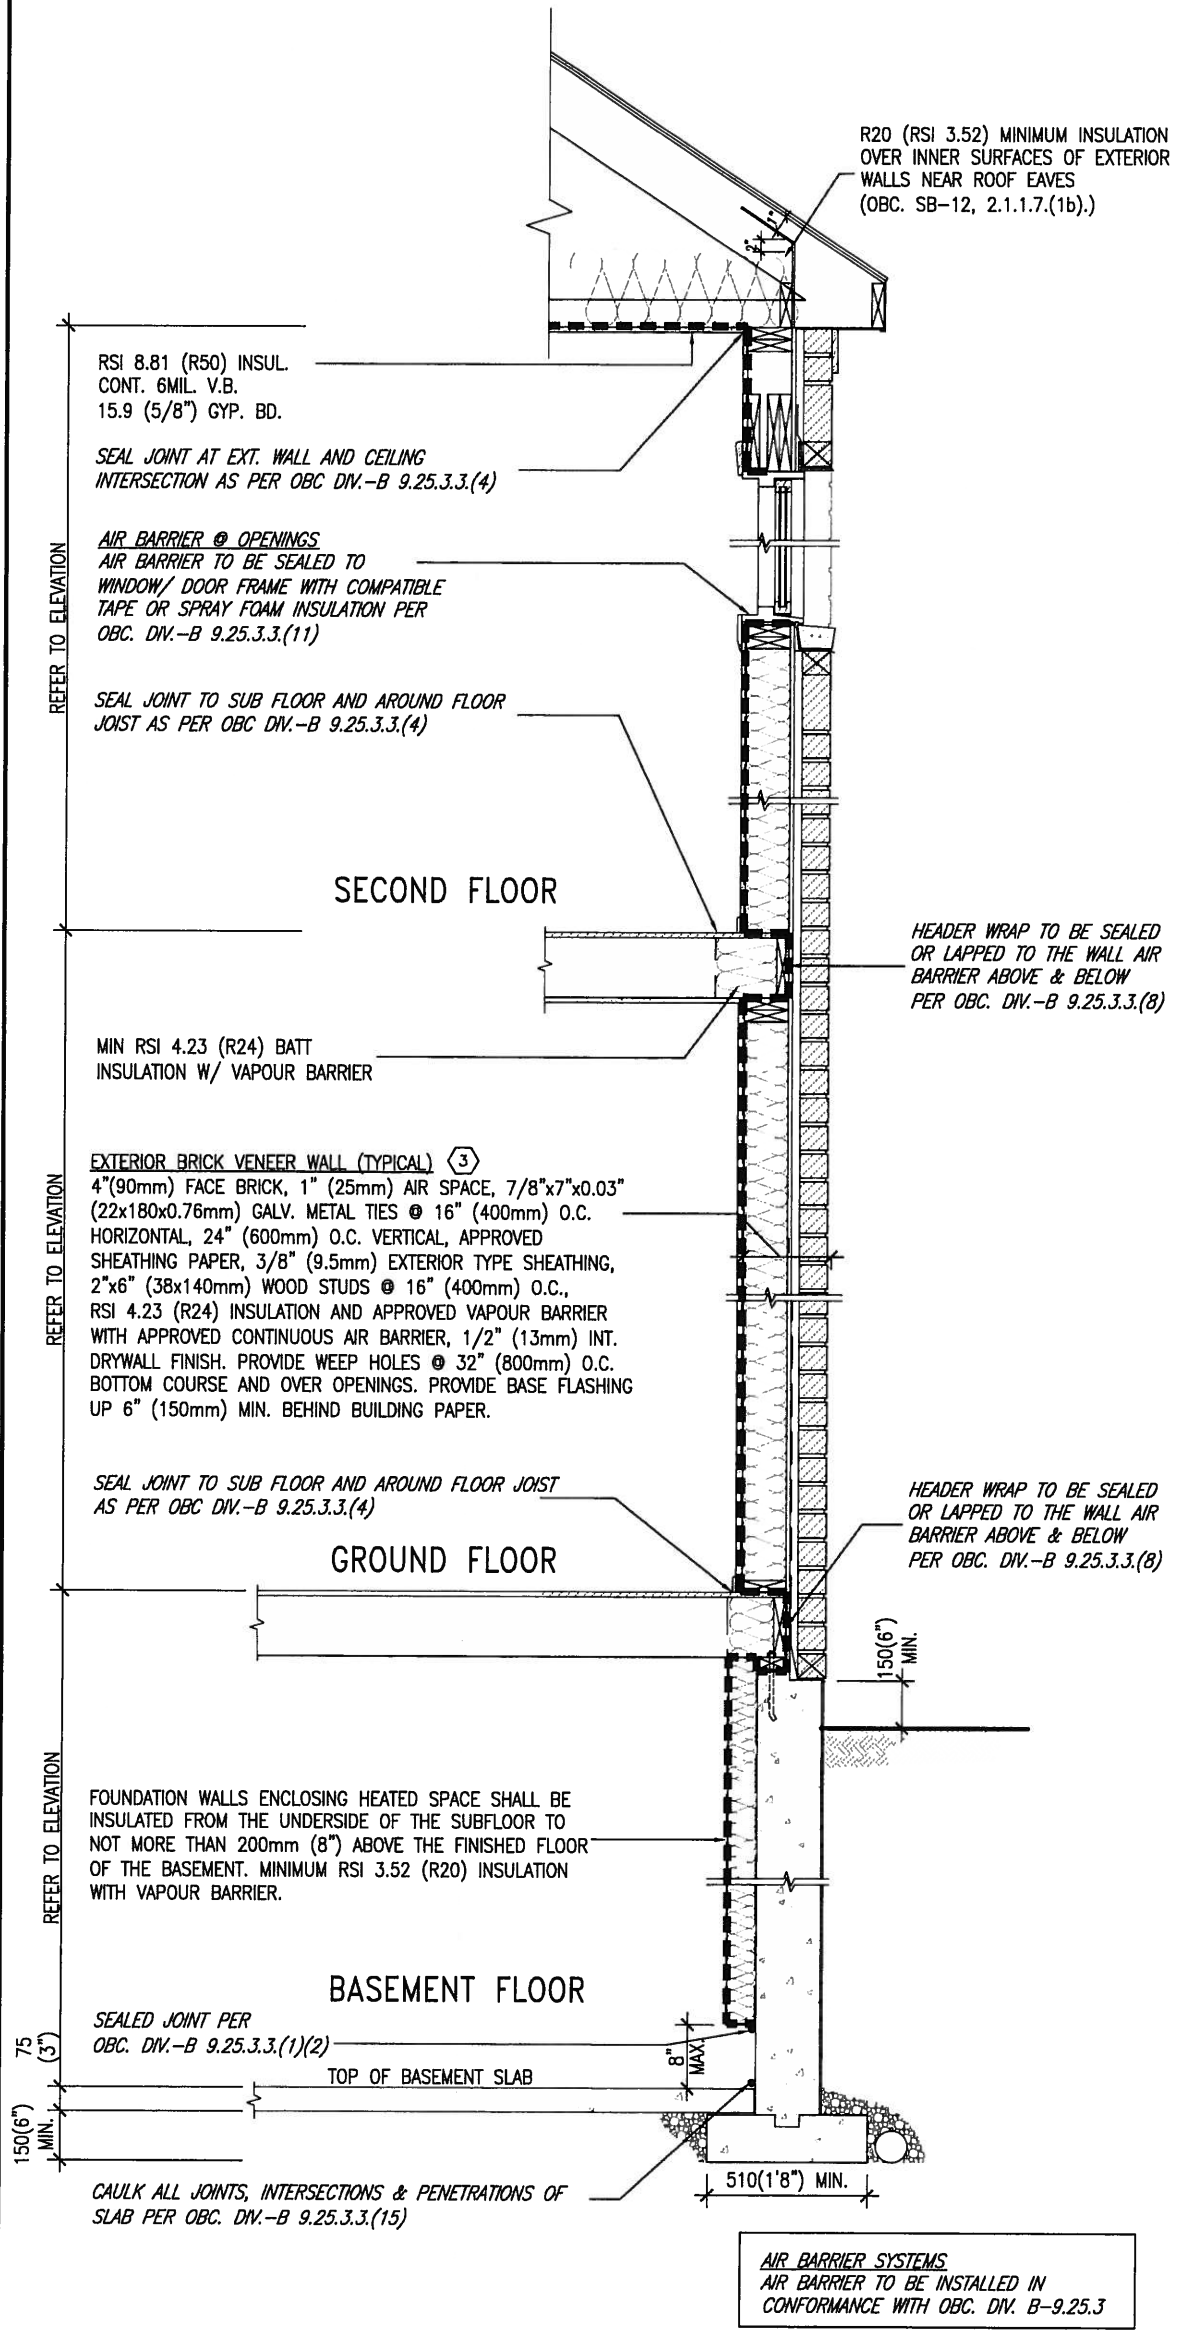

EW1 TYPICAL EXT. WALL AIR BARRIER CONTINUITY SECTION W/ BRICK VENEER SCALE: N.T.S.

TOWNS ONLY

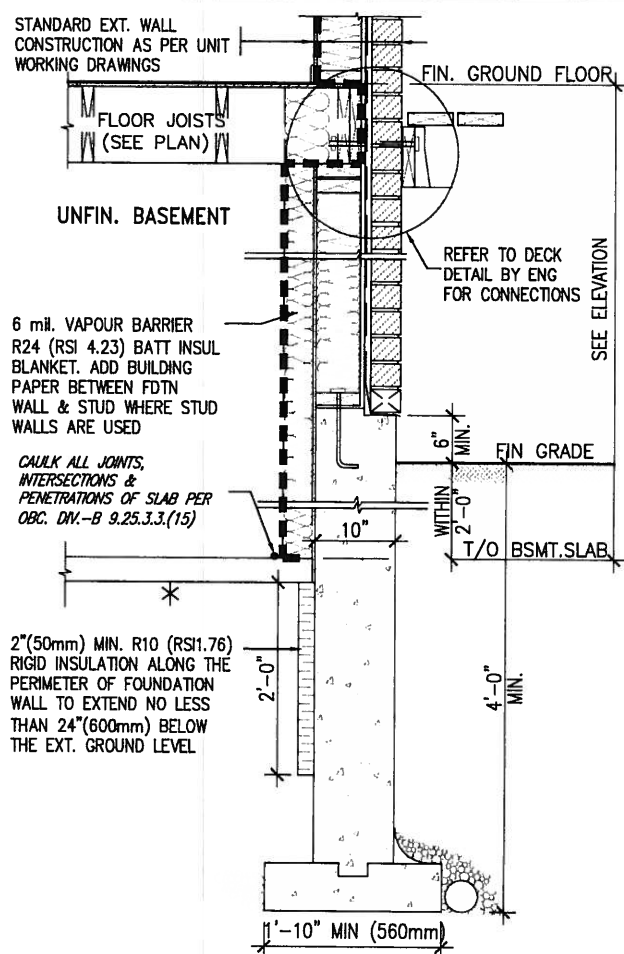

* REVISED- 15 MARCH 2013

SECTION AT W.O.D/W.O.B.

9.			
8.			
7.			
6.			
5.			
4.			
3.			
2.	UPDATE TO CODE	APR 16-15	RC
1.	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information
Wellington Jno-Baptiste 25591
name
registration information
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.



300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

CONST NOTE

project name
GREEN VALLEY ESTATES

municipality
BRADFORD

project no.
13045

date
APR 2014

drawn by
RC

checked by
scale
3/16" = 1'-0"


CONSTRUCTION NOTES

13045-CONST-OBC 2015

drawing no.

CN6


COMPLIANCE TO OBC SB-12 2.1.1.1(11)

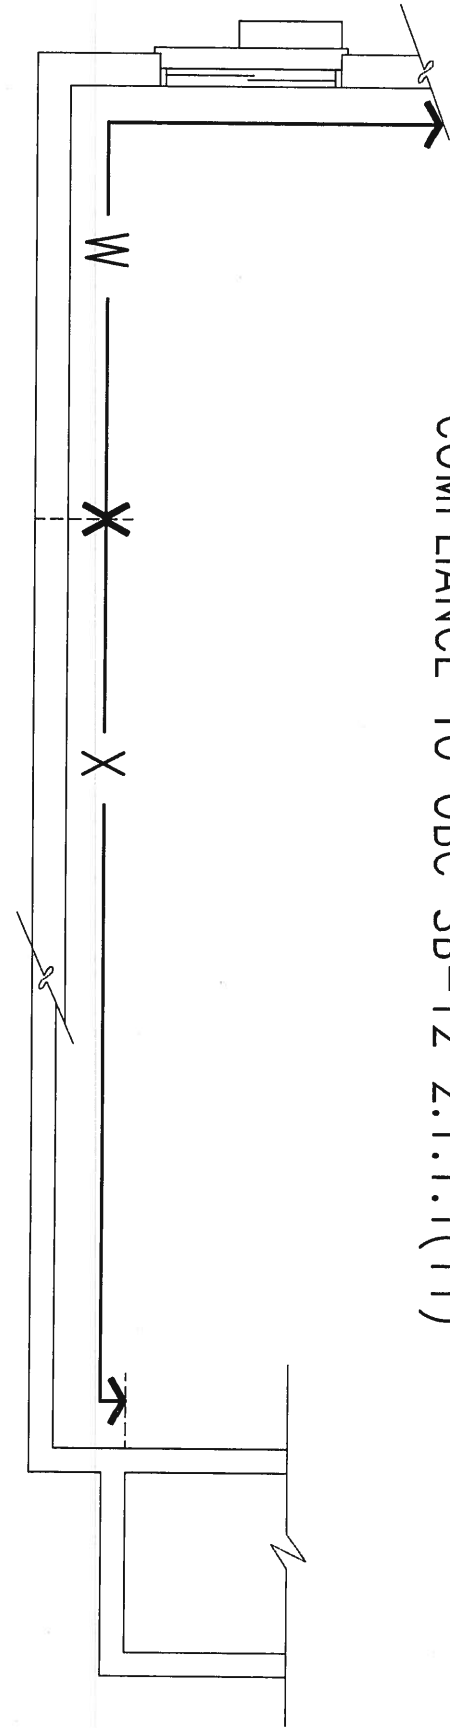

WOB PLAN



JULY 3, 2015

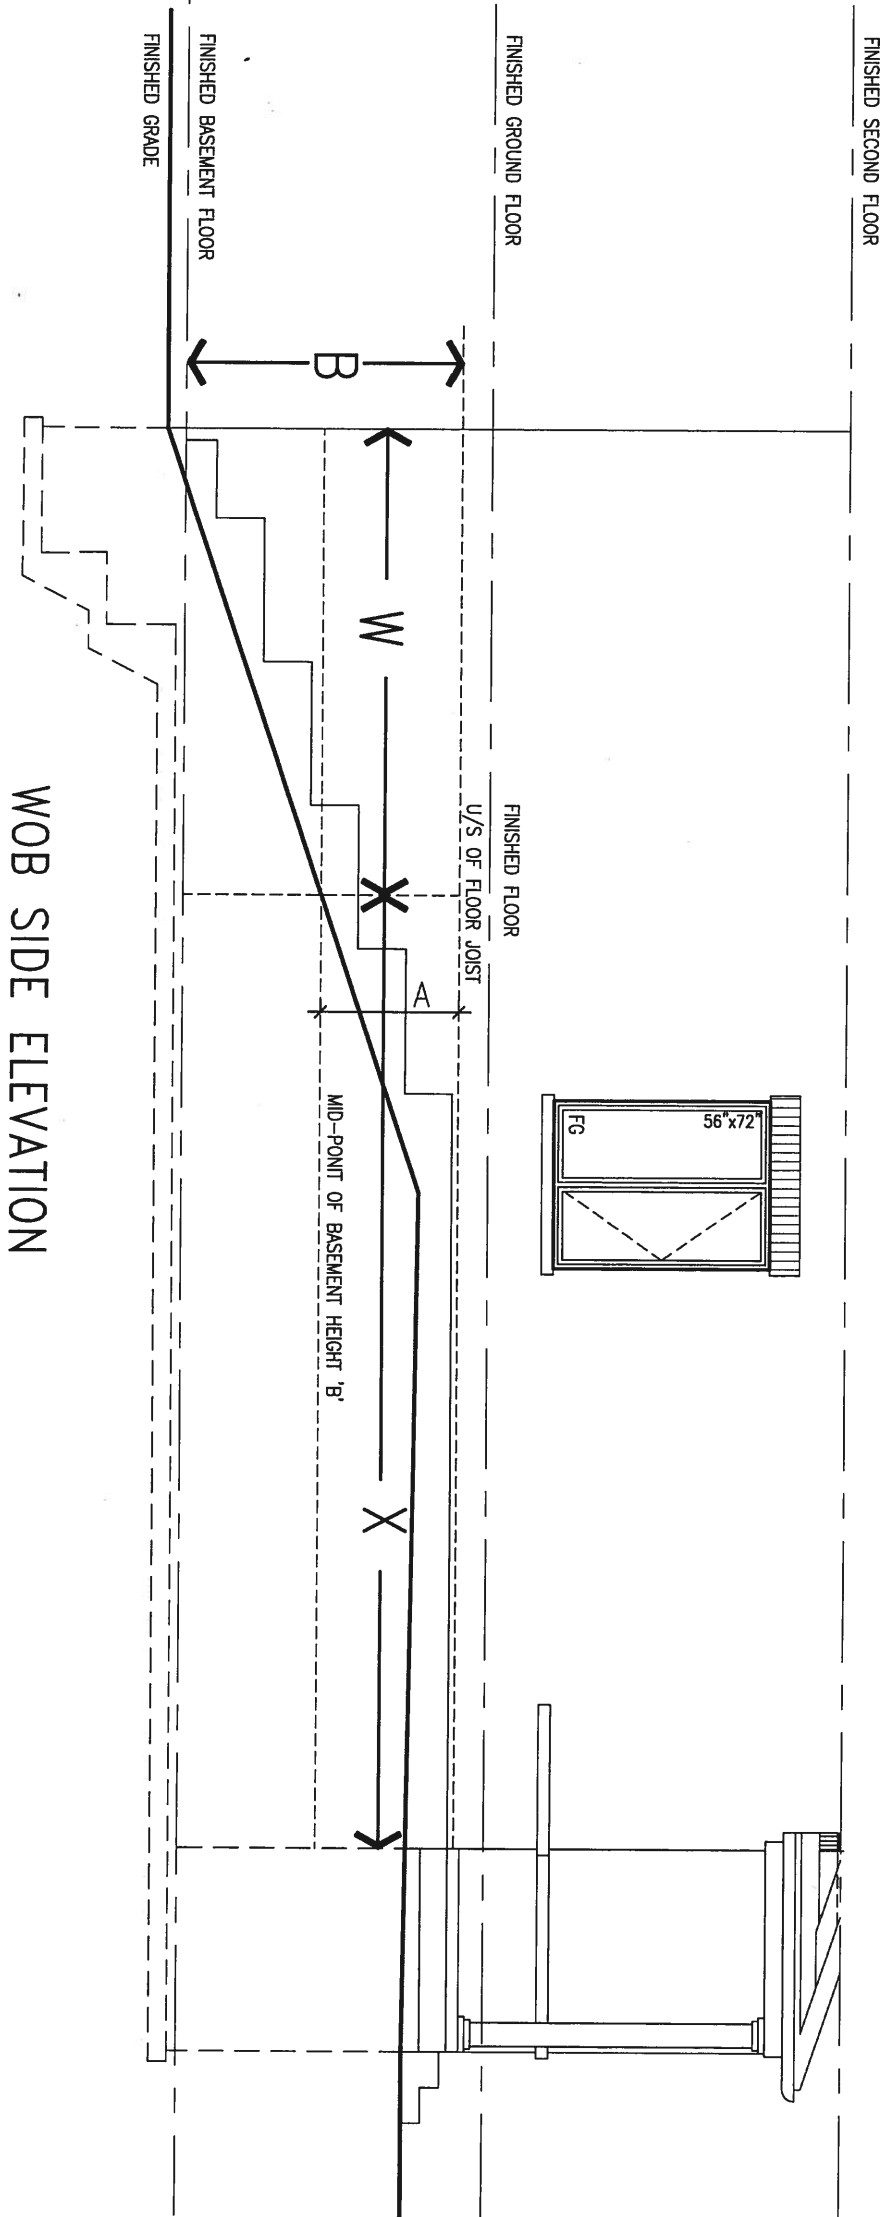


WOB SIDE ELEVATION


WHEN EXPOSED WALL "A" IS GREATER THAN 50% OF BASEMENT WALL HEIGHT "B" INSULATION VALUE FOR WALL IN SECTION "W" IS NOT LESS THAN IS REQUIRED FOR ABOVE GRADE WALL AS REQUIRED BY TABLE 2.1.1.2A

WHEN EXPOSED WALL "A" IS LESS THAN 50% OF BASEMENT WALL HEIGHT "B" INSULATION VALUE FOR WALL IN SECTION "X" IS NOT LESS THAN BASEMENT WALL AS REQUIRED BY TABLE 2.1.1.2A

9	.	.	.	The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	VA3 DESIGN 300A Wilson Avenue Toronto ON M3H 1S8 t 416.630.2255 f 416.630.4782 va3design.com	BAYVIEW WELLINGTON	project name GREEN VALLEY ESTATES	municipality BRADFORD	project no. 13045	drawing no. CN7	CONST NOTE
8	.	.	.	qualification information							
7	.	.	.	Wellington Jno-Baptiste 25591							
6	.	.	.	signature							
5	.	.	.	BCIN							
4	.	.	.	registration information	Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	date APR 2014	checked by RC	scale 3/16" = 1'-0"	file name 13045-CONST-OBC 2015	CONSTRUCTION NOTES	
3	.	.	.	VA3 Design Inc. 42658							
2	UPDATE TO CODE	APR 16-15	RC								
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC								
no.	description	date	by								

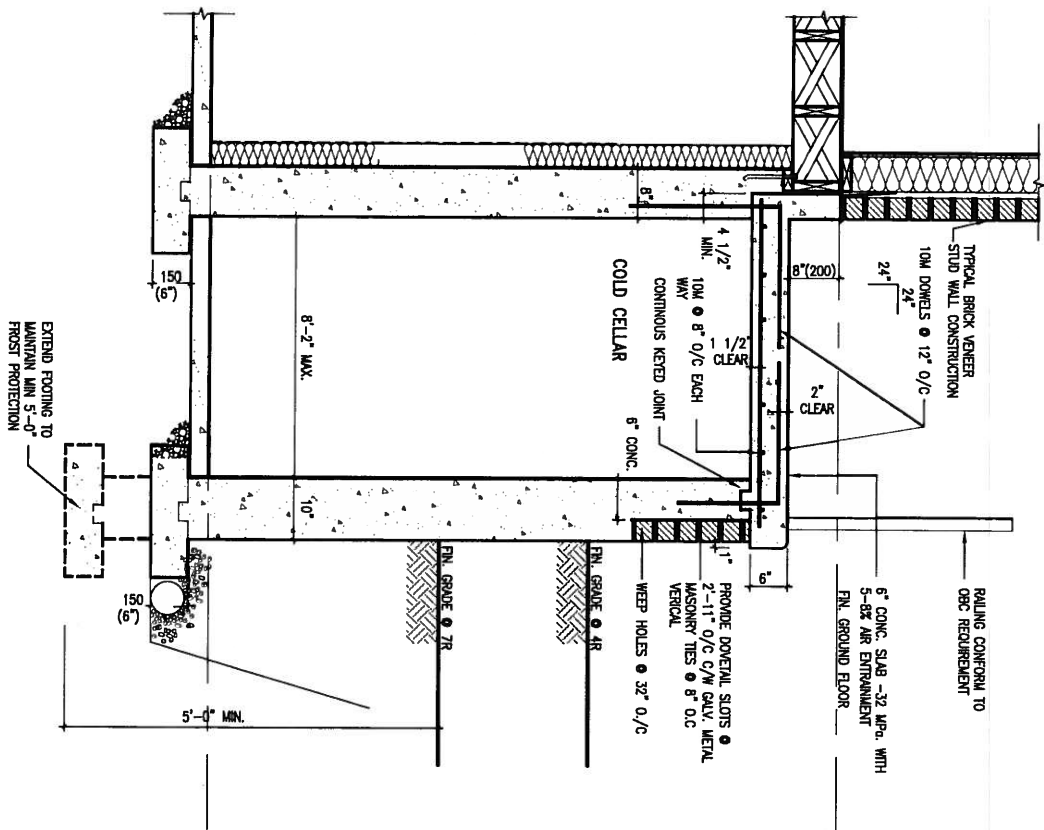

X1 SECTION AT PORCH FOR 4-7R CONDITION
SCALE: N.T.S.

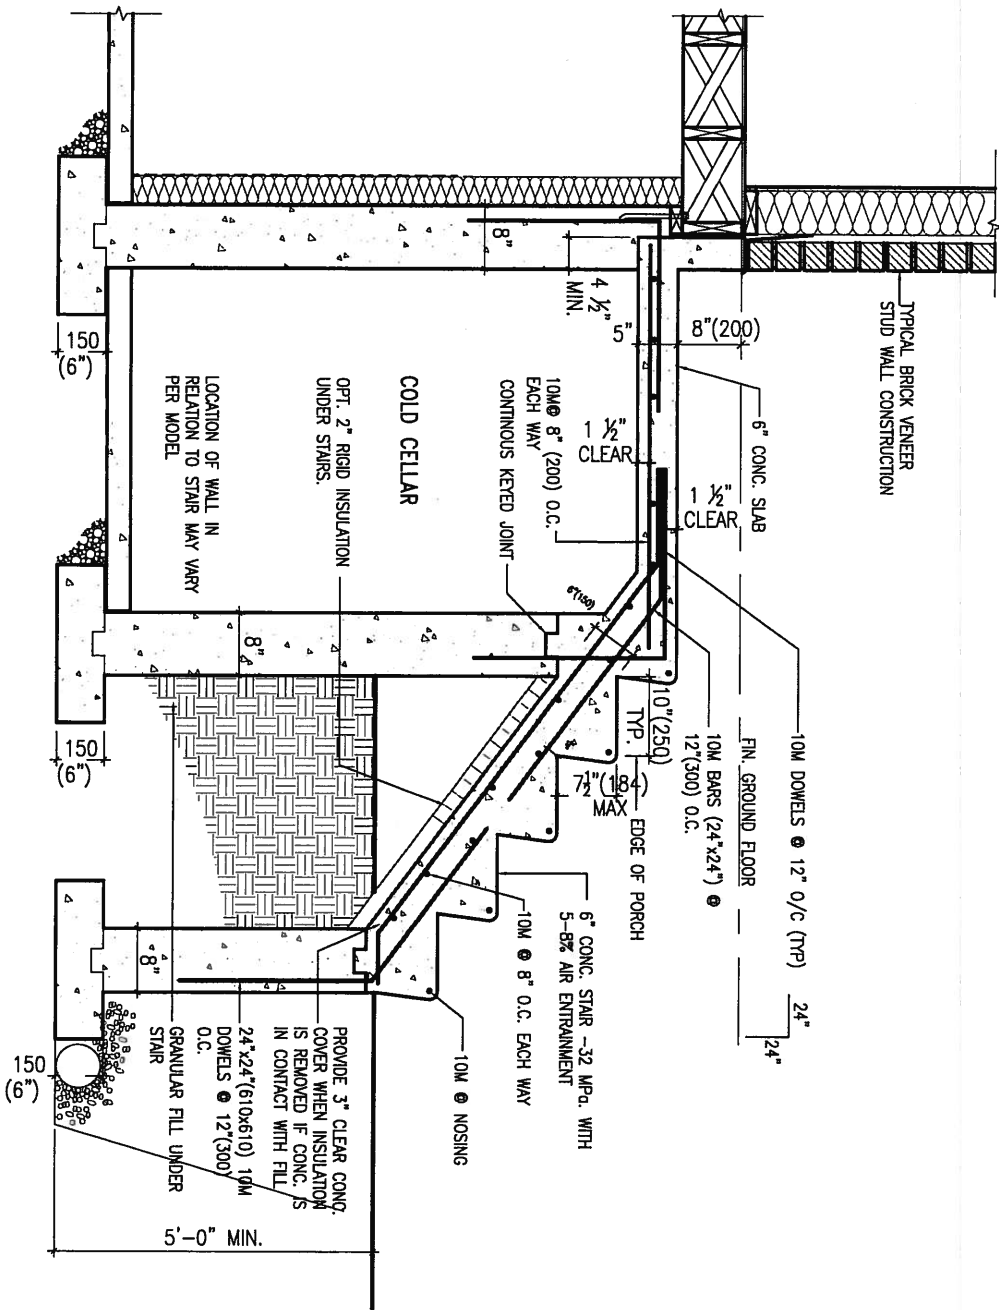

X2 EXTERIOR CONC. STAIR DETAIL (6 RISERS/ 7 RISERS SIMILAR)
SCALE: N.T.S.

JULY 3, 2015




9.	.	.	.
8.	.	.	.
7.	.	.	.
6.	.	.	.
5.	.	.	.
4.	.	.	.
3.	.	.	.
2.	UPDATE TO CODE	APR 16-15	RC
1.	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC
no.	description	date	by

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.	
qualification information	
Wellington Jno-Baptiste	25591
name	BCN
registration information	42658
VA3 Design Inc.	
Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.	



BAYVIEW WELLINGTON			CONST NOTE	
project name		municipality		project no.
GREEN VALLEY ESTATES		BRADFORD		13045
date		CONSTRUCTION NOTES		
APR 2014		drawing no.		
drawn by	checked by	scale	file name	
RC	-	3/16" = 1'-0"	13045-CONST-OBC 2015	
RICHARD - H:\ARCHIVE\WORKING\2013\13045.BW\units\13045-CONST-OBC 2015.dwg - Tue - May 12 2015 - 8:51 AM				
				CN8

JULY 3, 2015

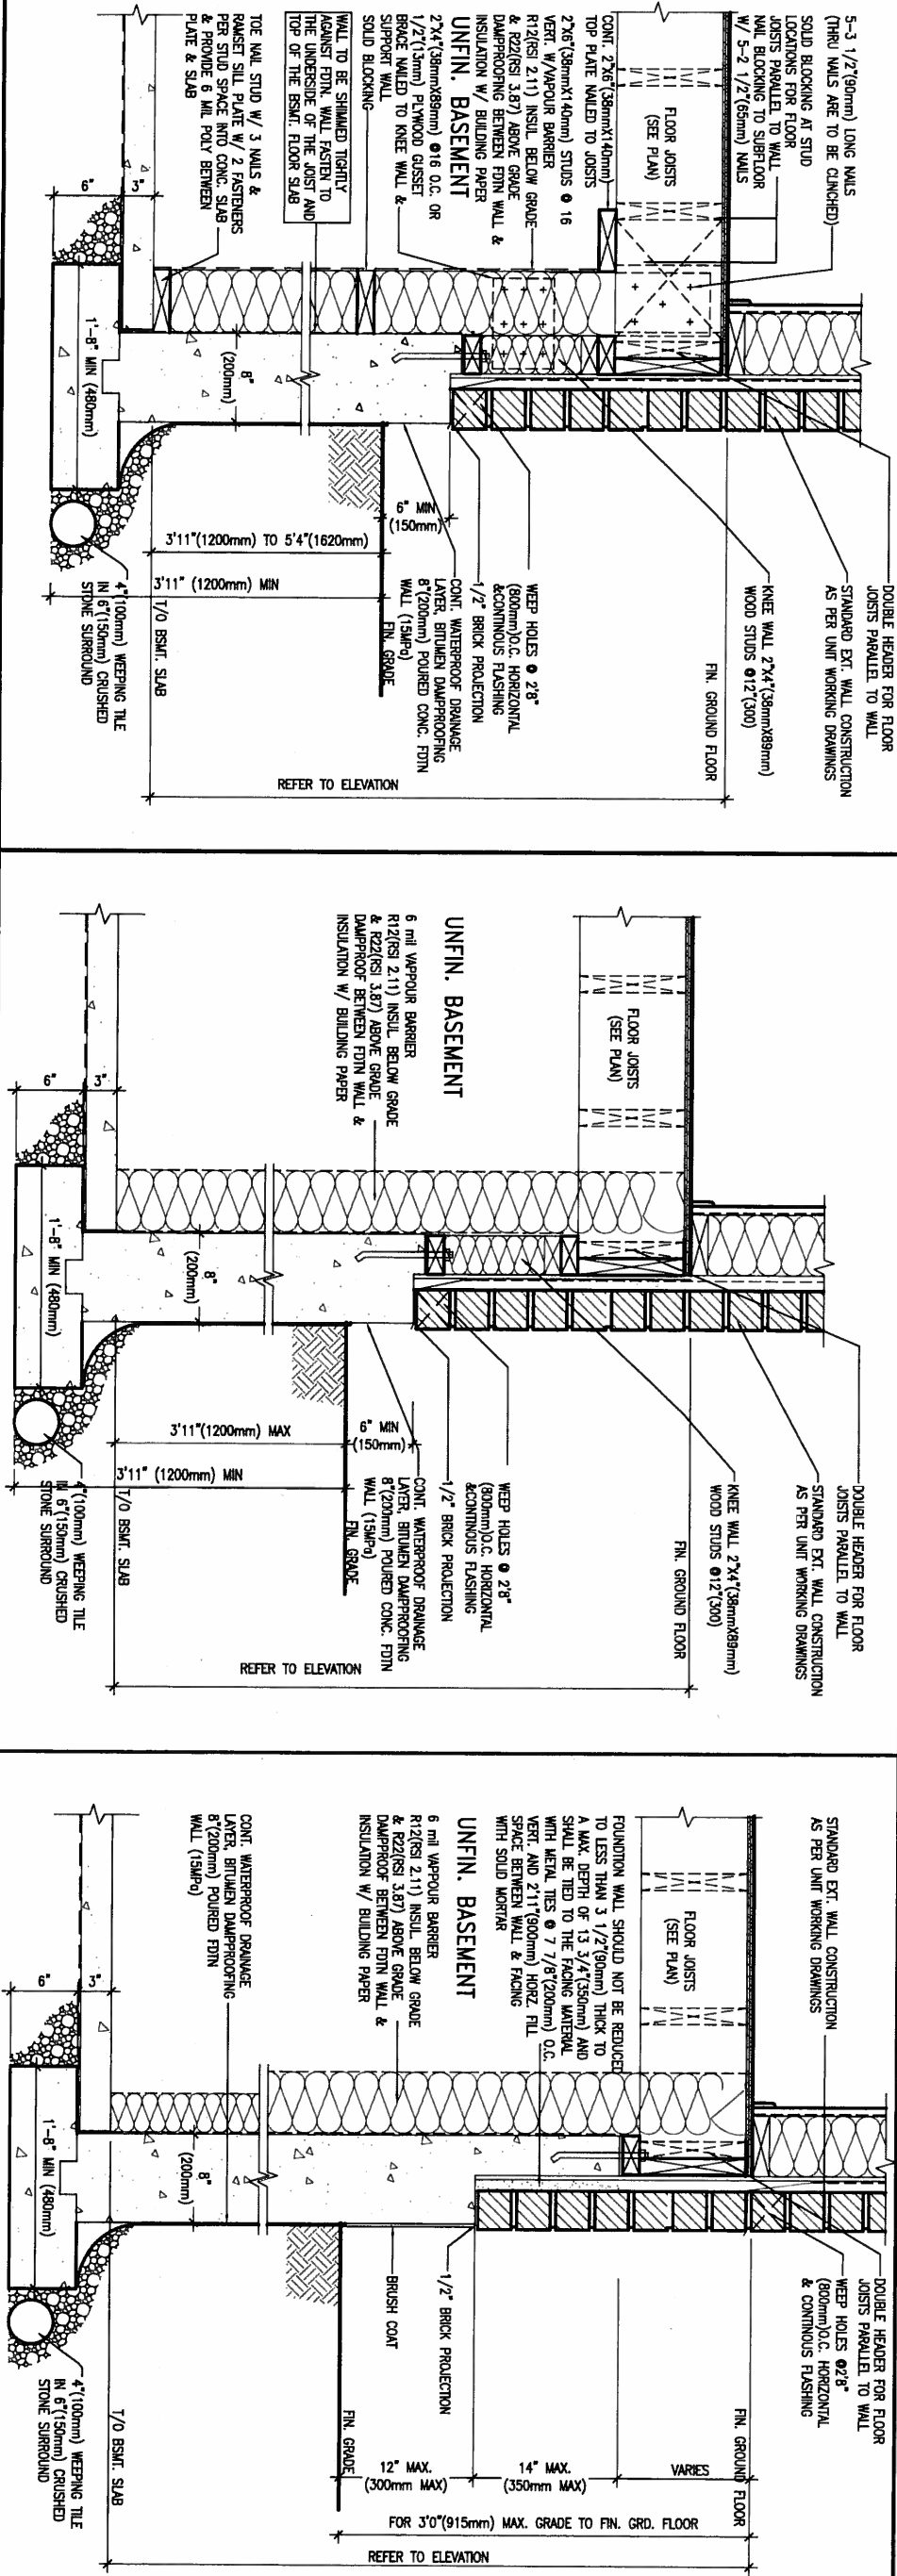

WALK-OUT WALL SECTION FOR GRADE
EW3.08B HEIGHTS BETWEEN 3'11" (1200mm) AND 5'4" (1620mm) BASEMENT SLAB TO GRADE
N.T.S.

WALK-OUT DECK WALL SECTION FOR GRADE
EW3.07B TO BASEMENT SLAB 3'11" (1200mm) MAX. HEIGHT DIFFERENCE
N.T.S.

WALK-OUT DECK WALL SECTION FOR
EW3.06B GRADE TO FIN. FLOOR 3'0" (900mm) MAX. HEIGHT DIFFERENCE
N.T.S.

9	.	.	.	.	.
8	.	.	.	.	.
7	.	.	.	.	.
6	.	.	.	.	.
5	.	.	.	.	.
4	.	.	.	.	.
3	.	.	.	.	.
2	UPDATE TO CODE	APR 16-15	RC	.	.
1	ISSUE FOR CLIENT REVIEW	MAY 07-14	RC	.	.
no.	description	date	by	.	.

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a Designer.

qualification information
Wellington Jno-Baptiste 25591
signature
name
registration information
VA3 Design Inc. 42658

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the Designer which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255 f 416.630.4782
va3design.com

BAYVIEW WELLINGTON

project name GREEN VALLEY ESTATES	municipality BRADFORD
date APR 2014	checked by RC
drawn by RICHARD	scale 3/16" = 1'-0"


file name
13045-CONST-0BC 2015

Mon - May 4 2015 - 4:04 PM


CONST NOTE

project no. 13045	drawing no. CN9
-----------------------------	---------------------------

CONSTRUCTION NOTES

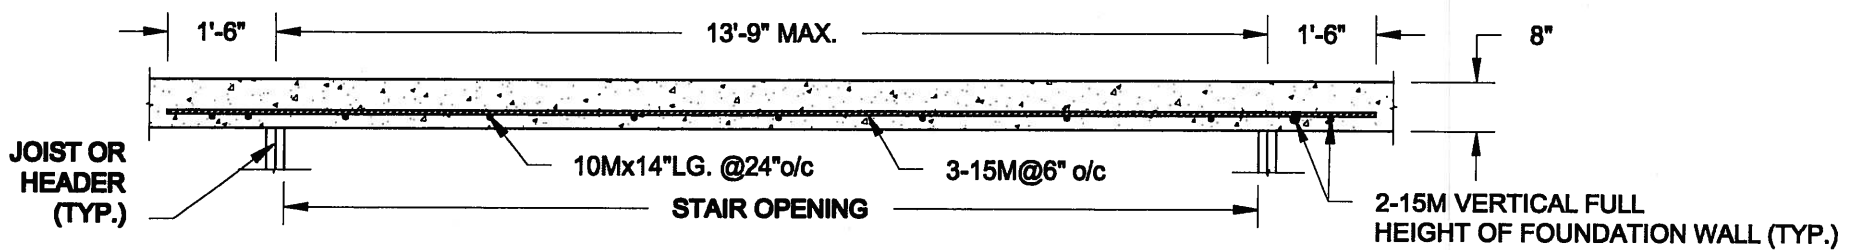


PLAN VIEW
NOT TO SCALE

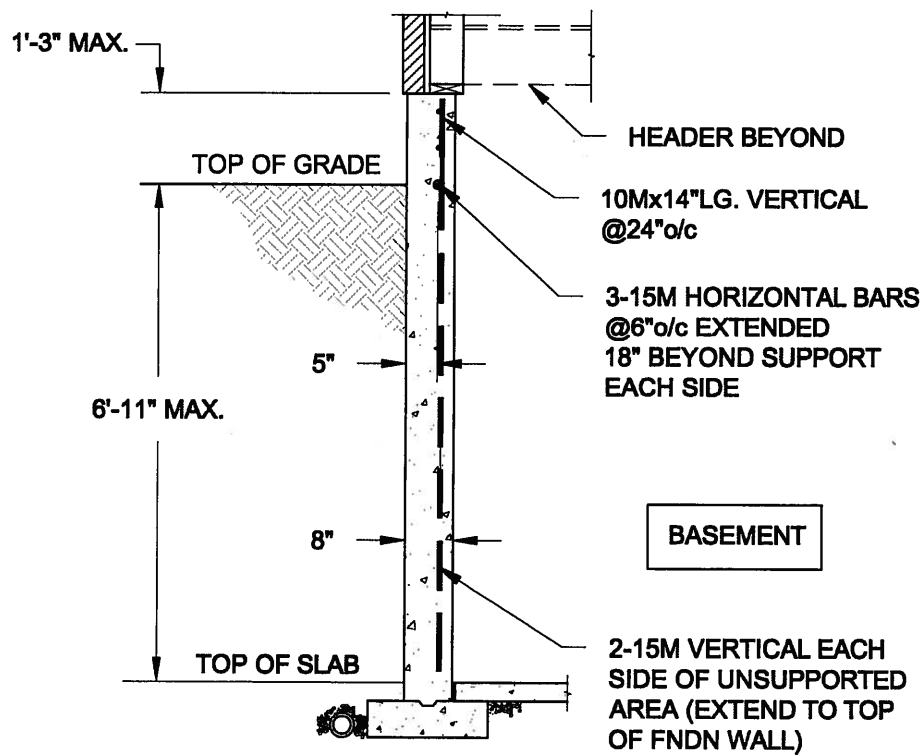


NOTE:

1. CONFORM TO ONTARIO BUILDING CODE, 2012.
2. CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS TO BE 15 MPa. MIN.
3. REINFORCING STEEL TO BE GRADE 400.

1A
S1 **LATERALLY UNSUPPORTED WALL**
SCALE: 3/8" = 1'-0"

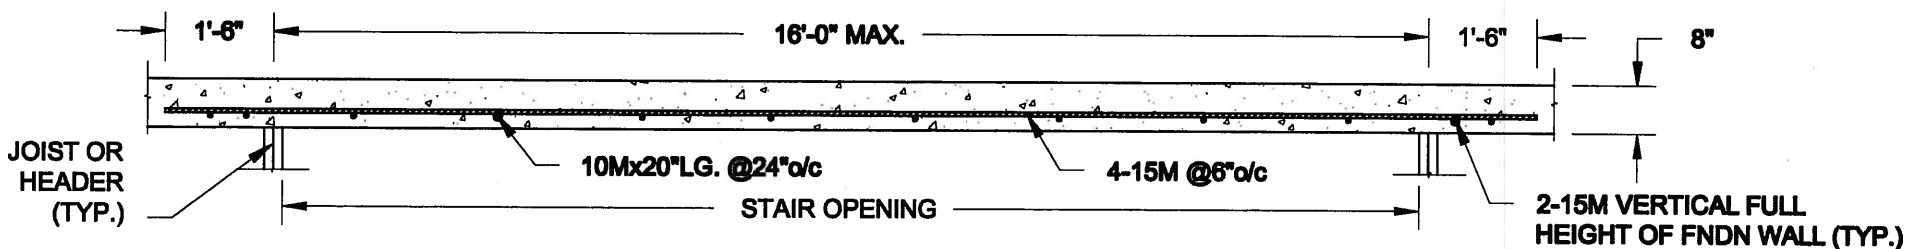

PLAN VIEW
NOT TO SCALE

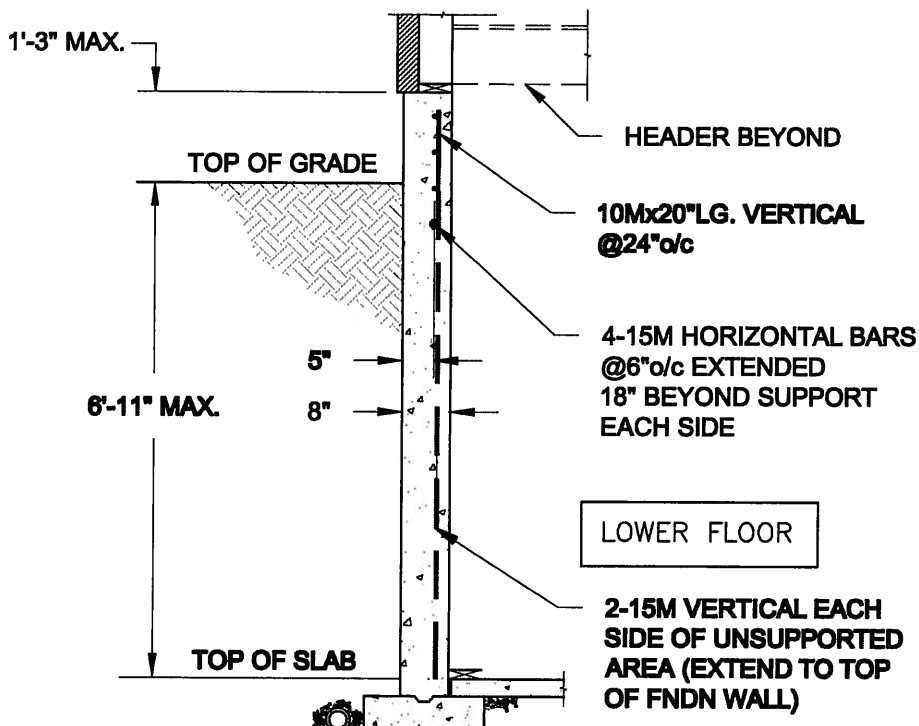


NOTE:

1. CONFORM TO ONTARIO BUILDING CODE, 2012.
2. CONCRETE COMPRESSIVE STRENGTH AT 28 DAYS TO BE 15 MPa. MIN.
3. REINFORCING STEEL TO BE GRADE 400.


1B
S1 **LATERALLY UNSUPPORTED WALL**
SCALE: 3/8" = 1'-0"

Scale: AS NOTED		QUAILE ENGINEERING LTD.  38 Parkside Drive, UNIT 7 Newmarket, ON L3Y 8J9 T: 905-853-8547 E: quaile.eng@rogers.com	Engineer's Seal:  JULY 3, 2015	Project: BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT BRADFORD, ONTARIO	
Date: MAY-27-2014			TYPICAL STRUCTURAL DETAILS		
Drawn: SC	Checked: SJB		Project No.: 14-096	Drawing No.: S1	

FOR 9 1/2" JOIST DEPTH

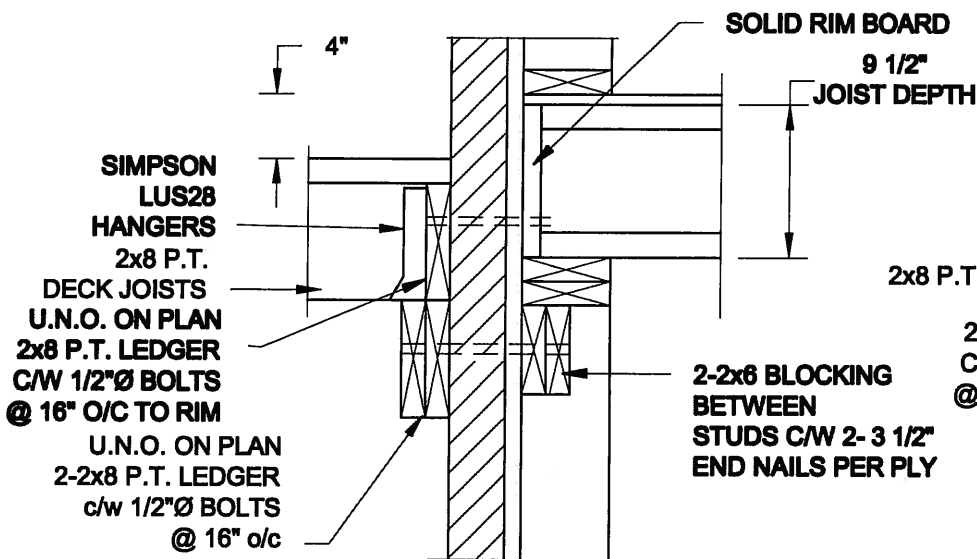


1A DECK FASTENING DETAIL
S2 SCALE: 1" = 1'-0"

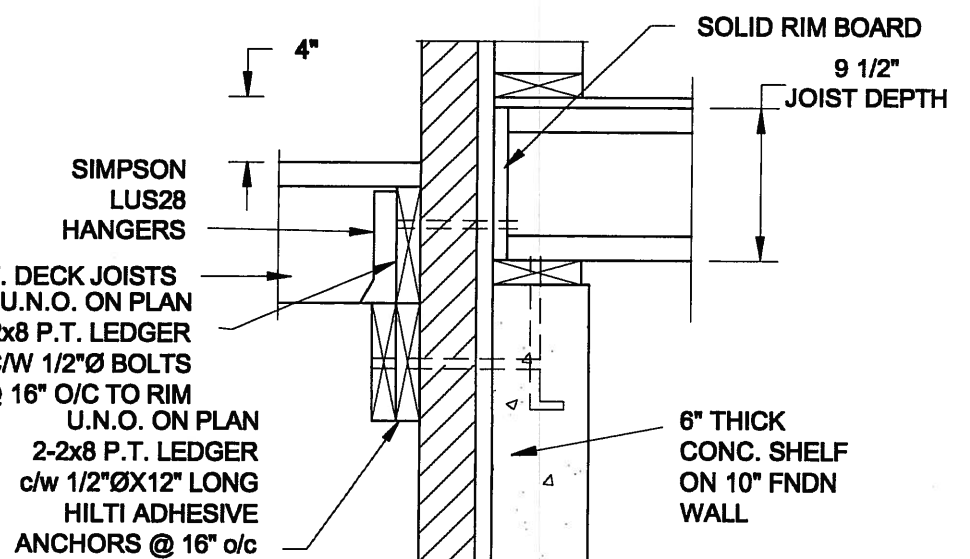


1B DECK FASTENING DETAIL
S2 SCALE: 1" = 1'-0"

- NOTE: 1. WHERE BACKFILL HEIGHT < 4'-7", PROVIDE 2x6 @ 16" o/c KNEEWALL ON 10" THICK CONC FNDN WALL
2. WHERE BACKFILL HEIGHT > 4'-7", PROVIDE 6" CONC SHELF FOR BRICK VENEER ON 10" THICK CONC FNDN WALL
3. FOOTING TO BE 22"x6" THICK UNLESS NOTED OTHERWISE ON PLAN.

FOR 11 7/8" JOIST DEPTH

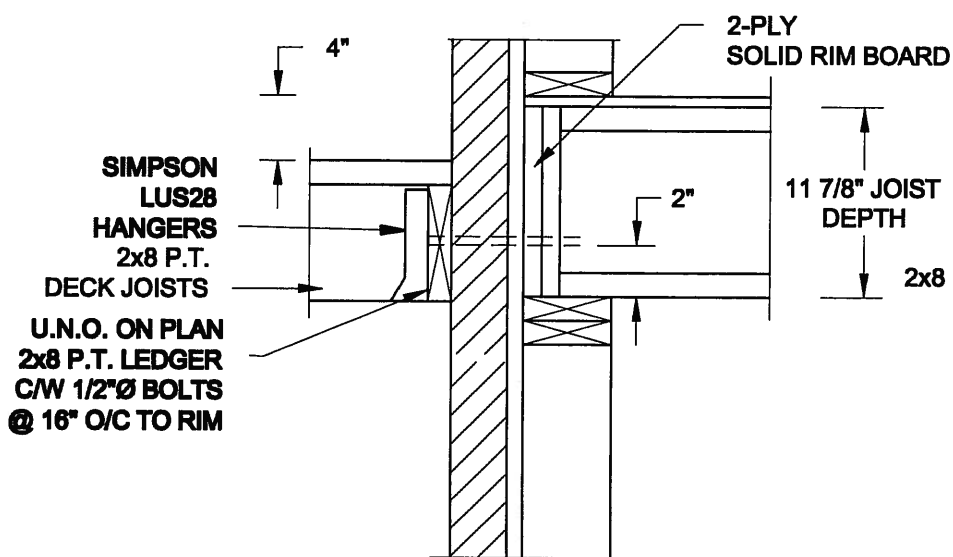


2A DECK FASTENING DETAIL
S2 SCALE: 1" = 1'-0"

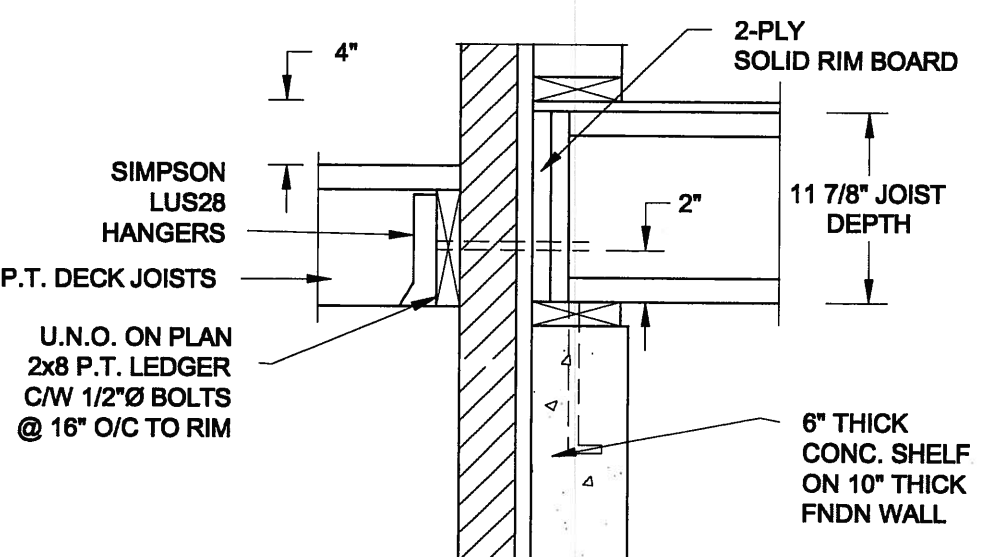


2B DECK FASTENING DETAIL
S2 SCALE: 1" = 1'-0"

- NOTE: 1. WHERE BACKFILL HEIGHT < 4'-7", PROVIDE 2x6 @ 16" o/c KNEEWALL ON 10" THICK CONC FNDN WALL
2. WHERE BACKFILL HEIGHT > 4'-7", PROVIDE 6" CONC SHELF FOR BRICK VENEER ON 10" THICK CONC FNDN WALL
3. FOOTING TO BE 22"x6" THICK UNLESS NOTED OTHERWISE ON PLAN.

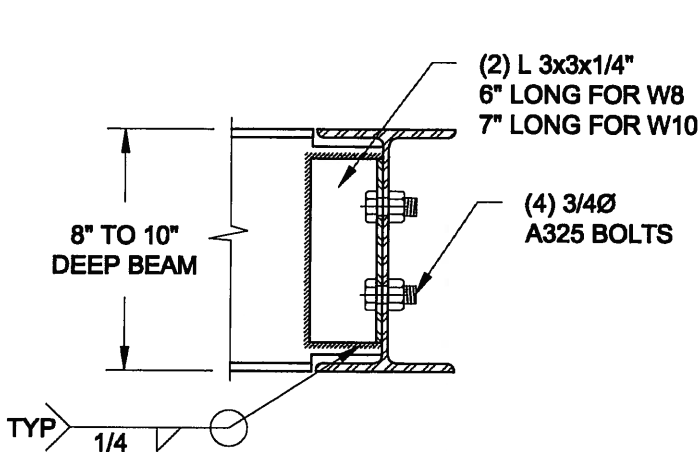

NOTE: DETAIL IS APPLICABLE TO W8x40 (W200x59) BEAM MAX AND W10x39 (W250x58) BEAM MAX.

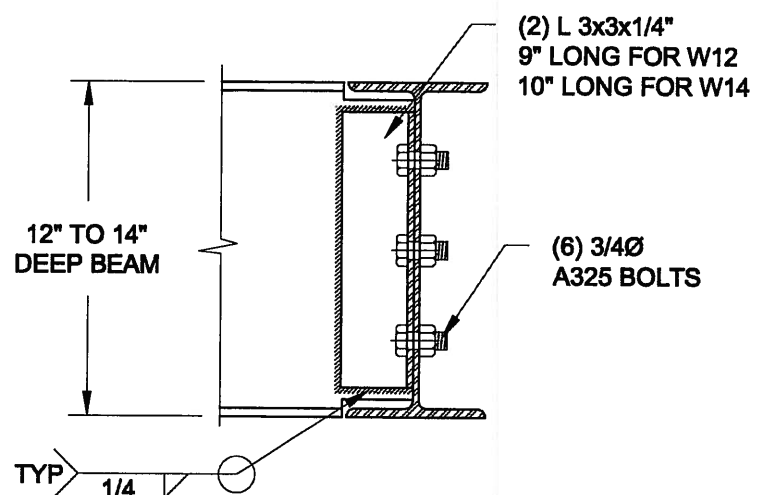


NOTE: DETAIL IS APPLICABLE TO W12x58 (W310x86) BEAM MAX AND W14x48 (W360x72) BEAM MAX.

3 STEEL BEAM CONNECTION DETAIL
S2 SCALE: 1-1/2" = 1'-0"


Scale: AS NOTED	QUAILE ENGINEERING LTD.  38 Parkside Drive, UNIT 7 Newmarket, ON L3Y 8J9 T: 905-853-8547 E: quaile.eng@rogers.com	Engineer's Seal  JULY 3, 2015	Project: BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT BRADFORD, ONTARIO
Date: MAY-27-2014			TYPICAL STRUCTURAL DETAILS
Drawn: SC			Project No.: 14-096
Checked: SJB			Drawing No.: S2

FOR 9 1/2" JOIST DEPTH

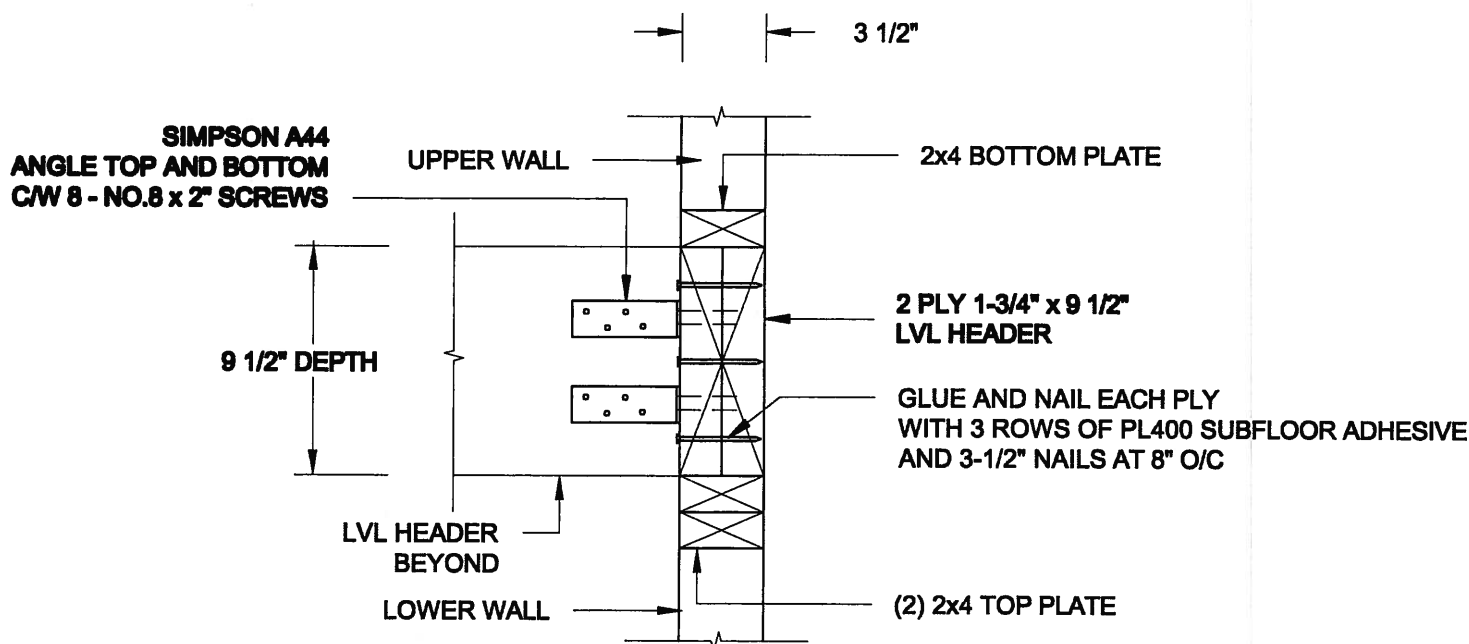

1A STAIR HEADER @ PARTYWALL
S3 SCALE: 1 1/2" = 1'-0"

FOR 11 7/8" JOIST DEPTH

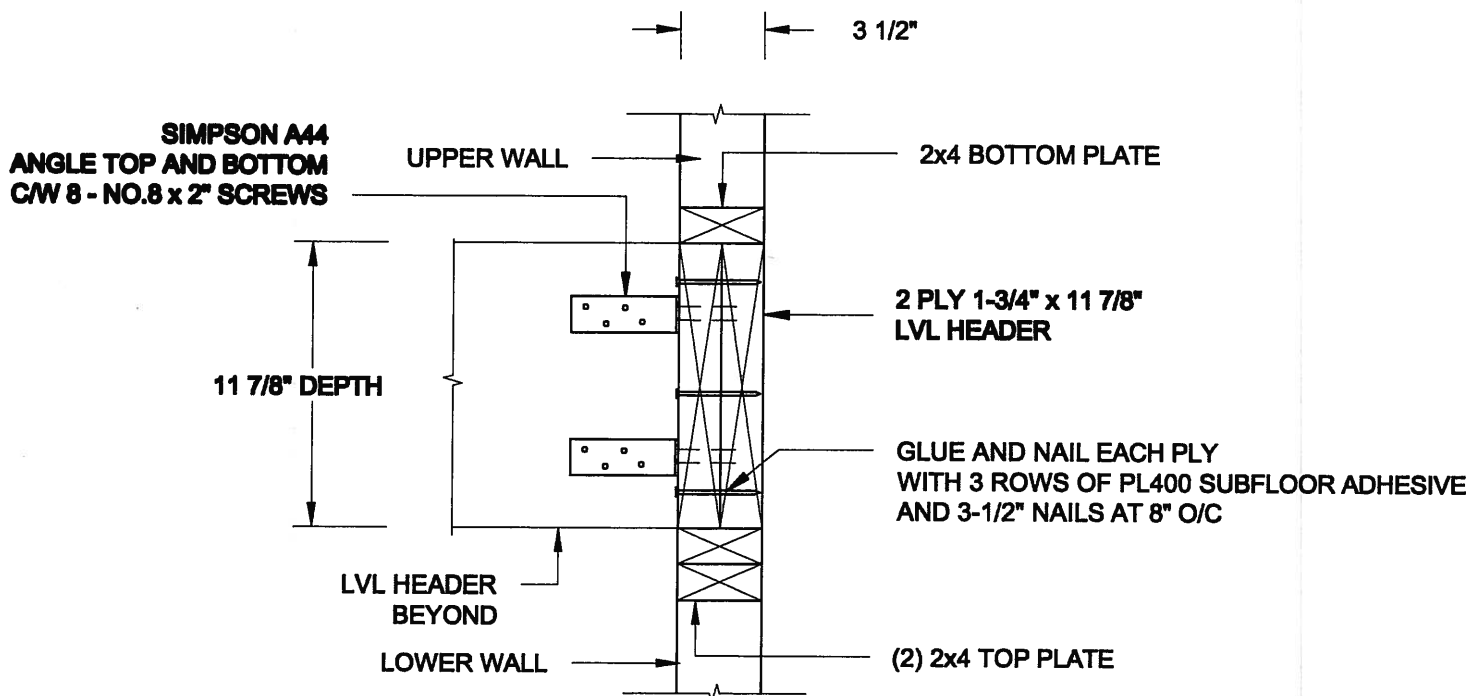

1B STAIR HEADER @ PARTYWALL
S3 SCALE: 1 1/2" = 1'-0"

Scale: AS NOTED		QUAILE ENGINEERING LTD.  38 Parkside Drive, UNIT 7 Newmarket, ON L3Y 8J9 T: 905-853-8547 E: quaile.eng@rogers.com	Engineer's Seal:  JULY 3, 2015	Project: BAYVIEW WELLINGTON HOMES - GREEN VALLEY ESTATES PROJECT BRADFORD, ONTARIO
Date: MAY-27-2014			TYPICAL STRUCTURAL DETAILS	
Drawn: SC	Checked: SJB		Project No.: 14-096	Drawing No.: S3