CONSTRUCTION NOTES (unless otherwise noted)

ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPECIFICATIONS AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. OHC REG. 332/12/-2012 OBC

1) **ROOF CONSTRUCTION**
NO.210 [10.29kg/m2] ASPHALT SHINGLES, 10mm (3/8") PLYWOOD SHEATHING WITH "H" CLIPS, APPROVED WOOD TRUSSES @ 600mm (24") O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. EAVES PROTECTION ABOVE AREAS FOR ROOF SULPES 8:12 OR greater) 38x89 (2x4") TRUSS BRACING @ 1830mm (6'-0") O.C. AT BOTTOM CHORD. PROVIDE ALUM. EAVESTROUGH, FASCIA, RWL & VENTED SOFFIT. PROVIDE ICE & WATER SHIELD TO ALL ROOF/WALL SURFACES SUSCEPTIBLE TO ICE FORMATION. ROOF SHEATHING TO BE FASTENED 150 (6") c/c ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 400 (16"). ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% AT EAVES & MIN. 25% AT ROOF (OBC 9.19.1.2.)

2) **FRAME WALL CONSTRUCTION (2"x6")** (SB-12-TABLE 2.1.1.2.A)
SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C. INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. GOING TO BE MIN. 200mm (8") ABOVE FINISH GRADE. REFER TO OBC SB-12, TABLE 2.1.1.2A FOR REQUIRED MINIMUM THERMAL INSULATION.

2A) **FRAME WALL CONSTRUCTION (2"x6") (R28)**
SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm (3/8") EXT. TYPE STRUCTURAL INSULATED SHEATHING R5 (0.7 (R4) BY "BP" OR EQUAL, 38x140 (2"x6") STUDS @ 400mm (16") O.C., R5 x2.5 (R24) INSUL. & APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. PROVIDE WEEP HOLES GOING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

2B) **FRAME WALL CONSTRUCTION (2"x4")- GARAGE WALLS**
SIDING AS PER ELEV., 19x38 (1"x2") VERTICAL WOOD FURRING, CONTIN. SHEATHING MEMBRANE, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x89 (2"x4") STUDS @ 400mm (16") O.C. (MAX. HEIGHT 3000mm (9'-10"), WITH APPR. DIAGONAL WALL BRACING. GOING TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

2C) RESERVED

3) **STUCCO WALL CONSTRUCTION (2"x6") -GARAGE WALLS**
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.11.(2) & 9.28 THAT EMPLOYS A MINIMUM 15mm DRY AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPROVED AIR/MOISTURE BARRIER ON 13mm (1/2") EXT. TYPE SHEATHING ON 38x89 (2"x4") STUDS @ 400 (16") O.C., STUCCO TO BE MIN. 200 (8") ABOVE FINISH GRADE.

4) **WALLS ADJACENT TO ATTIC SPACE – NO CLADDING**
9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C., INSULATION AND APPR. VAPOUR BARRIER AND APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. WEI-WEEP BLOCKING BELOW SHEATHING APPLIED. REFER TO OBC SB-12, TABLE 2.1.1.2A. FOR REQUIRED MINIMUM THERMAL INSULATION.

5) **BRICK VENEER CONSTRUCTION (2"x6")**(SB-12-TABLE 2.1.1.2.A)
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL, 600mm (24") O.C. VERTICAL, APPROVED SHEATHING PAPER, 9.5mm (3/8") EXT. TYPE SHEATHING, 38x140 (2"x6") STUDS @ 400mm (16") O.C. INSULATION & APPR. VAPOUR BARRIER WITH APPR. CONTIN. AIR BARRIER, 13mm (1/2") INTERIOR DRYWALL FINISH. PROVIDE WEEP HOLES @ 600mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

5A) **BRICK VENEER CONSTRUCTION (2"x6") -GARAGE WALLS**
90mm (4") FACE BRICK, 25mm (1") AIR SPACE, 22x180x0.76mm (7/8"x7"x0.03") GALV. METAL TIES @ 400mm (16") O.C. HORIZONTAL, 600mm (24") O.C. VERTICAL, APPROVED SHEATHING PAPER, 38mm (1") EXT. STRUCT. INSULATED SHEATHING R5 0.7 (R4) BY "BP" OR EQUAL, 38x140 (2"x6") STUDS @ 400mm (16") O.C., R5 x2.5 (R24) INSUL. & APPR. VAPOUR BARRIER WITH APPR. CONTIN. AIR BARRIER, 13mm (1/2") INT. DRYWALL FINISH. PROVIDE WEEP HOLES @ 800mm (32") O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER. BRICK TO BE MIN. 150mm (6") ABOVE FINISH GRADE.

6) **FOUNDATION DRAINAGE** OBC. 9.14.2. & 9.14.3.
100mm (4") DIA. FOUNDATION DRAINAGE TILE 150mm (6") CRUSHED STONE OVER AND AROUND DRAINAGE TILES

7) **BASEMENT SLAB** OBC. 9.3.1.6.(1)(b.), 9.16.4.5.(1), 9.25.3.3.(1b)
80mm (3")with 25MPa (3600psi) CONC. SLAB ON 100mm (4") EXTRUDED OR EXPANDED RIGID POLYSTYRENE ON APPR. CONTIN. AIR/MOISTURE BARRIER ON 13mm (1/2") EXT. TYPE SHEATHING ON 38x89 (2"x4") STUDS @ 400mm (16") O.C. INSULATION, PROVIDE DAMPPROOFING ON EXTERIOR SIDE OF 1/2"SPUN WALLBOARD INTERIOR FINISH. REFER TO OBC SB-12, TABLE 2.1.1.2A. FOR REQUIRED MINIMUM THERMAL INSULATION.

8) **INTERIOR STUD PARTITIONS**
FOR BEARING PARTITIONS 38x89 (2"x4") @ 400mm (16") O.C. FOR 2 STORIES AND 200mm (12") O.C. FOR 3 STORIES. NON-BEARING PARTITIONS 38x89 (2"x4") @ 600mm (24") O.C. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND 2/38x89 (2/2"x4") TOP PLATE. 13mm (1/2") INT. DRYWALL BOTH SIDES OF STUDS. HORIZONTAL BRACING 38x140 (2"x6") STUDS/PLATES WHERE NEEDED.

9) FOUNDATION WALL/FOOTINGS [9.15.3, 9.15.4, 9.13.2, 9.14.2.1.(2)]
200mm (8") POURED CONC. FDTN. WALL 15MPa (2200psi) WITH BITUMINOUS DAMPPROOFING AND DRAINAGE LAYER. DRAINAGE LAYER REQ'D. WHEN BASEMENT INSUL. EXTENDS 900 (2'-11") BELOW FIN. GRADE. DRAINAGE LAYER IS NOT REQ'D. WHEN FDTN. WALL IS WATERPROOFED. MAXIMUM POUR HEIGHT 2390 (7'-10") ON 500x150 FOOTING (CONTINUOUS VERIFIED FROM ENG. FTG. BREAK FDTN. WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY OF 150kPa OR GREATER. IF SOIL BEARING DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED.

STOREY'S SUPPORTED	W/ MASONRY VENEER	W/ SIDING ONLY
1	15" WIDE x 6" DEEP	15" WIDE x 6" DEEP
2	20" WIDE x 6" DEEP	20" WIDE x 6" DEEP
3	25" WIDE x 8" DEEP	20" WIDE x 6" DEEP

–SEE OBC 9.15.3.
–MAXIMUM FLOOR LIVE LOAD OF 2.4kPa. (50psf.) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.4m (14'–1")
–REFER TO SOILS REPORT FOR SOIL CONDITIONS AND BEARING CAPACITY.

STRIP FOOTING SUPPORTING EXTERIOR WALLS (FOR W.O.B.)
–ASSUMING MASONRY WALL CONSTRUCTION, MAX. FLOOR LIVE LOAD OF 2.4kPa. (50psf.) PER FLOOR, AND MAX. LENGTH OF SUPPORTED FLOOR JOISTS IS 4.4m (14'–1"). THE STRIP FOOTING SIZE IS AS FOLLOWS:

2 STOREY WITH WALK-OUT BASEMENT	545x175 (22"x7")

8) **STUCCO WALL CONSTRUCTION (2"x6")**
STUCCO CLADDING SYSTEM CONFORMING TO O.B.C. 9.27.11.(2) & 9.28 THAT EMPLOYS A MINIMUM 15mm DRY AIR SPACE BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 25mm (1") MIN. EXPANDED OR EXTRUDED RIGID POLYSTYRENE ON APPROVED AIR/MOISTURE BARRIER ON 13mm (1/2") EXT. TYPE SHEATHING ON 38x89 (2"x4") STUDS @ 400 (16") O.C., INSULATION, PROVIDE DAMPPROOFING ON EXTERIOR SIDE OF 1/2"SPUN WALLBOARD INTERIOR FINISH. REFER TO OBC SB-12, TABLE 2.1.1.2A. FOR REQUIRED MINIMUM THERMAL INSULATION.

9) **INTERIOR STUD PARTITIONS**
FOR BEARING PARTITIONS 38x89 (2"x4") @ 400mm (16") O.C. FOR 2 STORIES AND 200mm (12") O.C. FOR 3 STORIES. NON-BEARING PARTITIONS 38x89 (2"x4") @ 600mm (24") O.C. PROVIDE 38x89 (2"x4") BOTTOM PLATE AND 2/38x89 (2/2"x4") TOP PLATE. 13mm (1/2") INT. DRYWALL BOTH SIDES OF STUDS. HORIZONTAL BRACING 38x140 (2"x6") STUDS/PLATES WHERE NEEDED.

10) **BASEMENT INSULATION**(SB-12-2.1.1.6), 9.25.2.3., 9.13.2.6)
INSULATION INCLUDING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 200mm (8") ABOVE THE FINISHED FLOOR & NO CLOSER THAN 50mm (2") OF THE BASEMENT SLAB. INSULATION TO HAVE APPROVED VAPOUR BARRIER, DAMPPROOF WITH BUILDING PAPER. INSULATION TO BE PROTECTED BY 12.7mm (1/2") DRYWALL. GRADE LEVEL NOTE: FULL HEIGHT INSULATION AT COLD CELLAR WALLS. REFER TO OBC SB-12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION. AIR BARRIER TO BE SEALED TO FDTN. WALL WITH CAULKING.

11) **BEARING STUD PARTITION**
38x89 (2"x4") STUDS @ 400mm (16") O.C. 38x89 (2"x4") SILL PLATE ON DAMPPROOFING MATERIAL. 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'–10") O.C. 100mm (4") HIGH CONC. CURB ON 350x150 (14"x6") CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

12) **STEEL BASEMENT COLUMN**. OBC. (O.B.C. 9.15.3.5)
89mm(3"–1/2") DIA x 3.0mm(0.118") SINGLE WALL TUBE TYPE 2 ADJUSTABLE SILL COL. W/ MIN. CAPACITY OF 71.2kN (16,000lbs.) AT A MAX. EXTENSION OF 2318mm (7'–7 1/2") BELOW SUBFLOOR(2'–7 1/2"). PROVIDE 152x152x6.4mm (6"x6"x1/4") STL. PLATE TOP & BOTTOM. 87.0x87.0x140 (3"x3"x5 1/2") WOOD POST BELOW. PROVIDE 152x152x6.4mm (6"x6"x1/4") STL. PLATE BELOW WOOD POST. ON CONCRETE FOOTING CAPABLE OF SUSTAINING A PRESSURE OF 150 kpa. MINIMUM AND AS PER SOILS REPORT.

13) **STEEL BASEMENT COLUMN**. (OBC. (O.B.C. 9.15.3.5)
89mm(3"–1/2") DIA x 4.78mm(.188) FIXED STL. COL. WITH 150x150x6.6 (6"x6"x1/4") STL. TOP & BOTTOM PLATE ON FOR CONTINUOUS (42"x42"x14") CONC. FOOTING ON UNDISTURBED SOIL OR ENGINEERED FILL CAPABLE OF SUSTAINING A PRESSURE OF 150 kpa. MIN. AND AS PER SOILS REPORT.

14) **STEEL COLUMN**
89mm(3"–1/2") DIA x 4.78mm(.188) NON–ADJUSTABLE STL. COL. WITH 152x152x6.4 (6"x6"x1/4") STEEL TOP PLATE, & BOTTOM PLATE. BASE PLATE 230x230x12.5 (9"x9"x1/2") WITH 2–13mm. DIA. x 305mm. LONG HOOK ANCHORS (2–1/2"x12"x2") FIELD WELD COL. TO BASE PLATE.

15) **CONCRETE NIB/ POCKET**
BEAM POCKET OR 300x150 (12"x6") POURED CONC. NIB WALLS. MIN. BEARING 90mm (3–1/2")

16) 19x64 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM.

17) **GARAGE SLAB**
100mm (4") 25MPa (4640psi) CONC. SLAB WITH 5–8% AIR ENTRAINMENT ON OPT. 102 (4") COARSE GRANULAR FILL WITH COMPACTED SUB–GRADE OF CONSTANT NATIVE FILL. SLOPE TO FRONT.

18) **GARAGE CEILINGS/INTERIOR WALLS**
13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE. TAPE AND SEAL ALL JOINTS ARTIGHT PER O.B.C. 9.10.9.16. REFER TO SB–12, TABLE 2.1.1.2.A. FOR REQUIRED THERMAL INSULATION.

19) DOOR AND FRAME GASPROOFED. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHERSTRIPPING PER OBC 9.10.13.15.

20) **EXTERIOR STEP**
PROVIDE EXTERIOR STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 200mm (7–7/8") MIN. TREAD 250mm (9–1/2"). SEE OBC. 9.8.8.2., 9.8.8.3. & 9.8.10.

21) **DRYER EXHAUST** [OBC–6.2.3.8.(7) & 6.2.4.11.]
CAPPED DRYER EXHAUST VENTED TO EXTERIOR. (USE 100mm (4") DIA. SMOOTH WALL VENT PIPE)

22) **INSULATED ATTIC ACCESS** [OBC–9.19.2.1. & (SB12–2.1.1.7)]
PROVIDE INSULATED ATTIC ACCESS HATCH. MIN. 500mm (20") x (1 1/2"x24") & a MIN. AREA OF 0.32 SQM. (3.44 SQ.FT.) WITH WEATHERSTRIPPING. R50 3.52 (RSI 8.8) INSULATION ON HATCH.

23) **FIREPLACE CHIMNEYS**. (OBC. 9.21.)
TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'–0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND EXTEND 610mm (2'–0") MIN. HORIZONTAL DISTANCE WITH A HORIZ. DISTANCE OF 3050mm (10'–0") FROM THE CHIMNEY.

24) **LINEN CLOSET**
LINEN CLOSET, 4 SHELVES MIN. 350mm (14") DEEP.

25) **MECHANICAL EXHAUST**
MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR AS REQUIRED BY OBC. 9.32.3.5., & 9.32.3.10.

26) **STEEL BEARING PLATE FOR MASONRY WALLS**
200x200x6.6 (11"x11"x1/4") STL. PLATE FOR STL BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON 200x200 BLOCK PARTWALL, ANCHORED WITH 2–19mm (3/4") x 200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON–SHRINK GROUT.
OR
SOLID WOOD BEARING FOR WOOD STUD WALLS
SOLID BEARING TO BE AT LEAST AS WIDE AS THE SUPPORTED MEMBER. SOLID WOOD BEARING COMPRISED OF BUILT–UP WOOD COLUMNS TO BE CONSTRUCTED IN ACCORDANCE WITH OBC 9.17.4.2(2).

27) RESERVED

28) **BEARING WOOD POST (BASEMENT) (OBC 9.17.4.)**
3–38x140 (3"x6") BUILT–UP–POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 DIA. BOLT, E10x610x300 (24"x24"x12") CONC. FTG.

29) **STEPPED FOOTINGS OBC 9.15.3.9.**
MIN. HORIZ. STEP = 600mm (24"). MAX. VERT. STEP = 600mm (24")

30) **WALL ON GRADE**
MIN. 100mm (4") CONCRETE SLAB ON GRADE ON 100mm (4") COARSE GRANULAR FILL. REINFORCED WITH 6x6–W2.9xW2.9 WECH PLACED NEAR MID–DEPTH OF SLAB. CONC. STRENGTH 32 MPa (4640 psi) WITH 5–8% AIR ENTRAINMENT ON COMPACTED SUB–GRADE. REFER TO OBC SB–12, TABLE 2.1.1.2.A. FOR REQUIRED MINIMUM THERMAL INSULATION UNDER SLAB.

31) **DIRECT VENTING GAS FURNACE/ H.W.T. VENT**
DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS REGULATOR. MIN. 300mm (12") ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS. HRV INTAKE TO BE 1.8M. OR 1800mm (6'–0") FROM ANY OTHER TERMINALS. REFER TO GAS UTILIZATION CODE.

32) **DIRECT VENTING GAS FIREPLACE VENT**
DIRECT VENT GAS FIREPLACE, VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

33) **SUBFLOOR–JOIST STRAPPING AND BRIDGING**
76mm (3/8") 1 & G SUBFLOOR ON WOOD FLOOR JOISTS. PROVIDE 38x140 (2"x6") STRAPPING AT MID–SPAN OF JOIST (38" OR 3.0LB. x 9.5mm (1/4") PANEL TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORING. 1" SEE SHEET DETAILS. PROVIDE 38x140 (2"x6") FLOOR JOISTS WITH SPANS OVER 2100mm (6'–11") TO BE BRIDGED WITH 38x38 (2"x2") CROSS BRACING OR SOLID BLOCKING @ 2100mm (6'–11") O.C. MAX. AND WHERE SPECIFIED BY JOIST TABLES A–1 OR A–2 STRAPPING SHALL BE 19x64 (1"x3") @ 2100mm (6'–11") O.C. UNLESS A SOLID BLOCK CENTRE SPAN IS PROVIDED.
(* SEE OBC 9.23.9.4. *)

34) **EXPOSED BEARING FACE** OBC. 9.10.15. & SB–2–3.3.(2)
EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45 min. WHERE UNPROTECTED OPENINGS (U) IS LESS THAN 1.2M (3'–11"). WHERE THE LD IS LESS THAN 600mm (2'–11") THE EXPOSED FACE SHALL BE CLADDED IN NON–COMBUSTIBLE MATERIAL. SEE ELEVATIONS FOR ADDITIONAL NOTES.

35) **COLD CELLAR SPACE/ STAIR (OBC 9.40.)**
FOR MAX. 2500mm (8'–2") PORCH DEPTH (SHORTEST DIM.), 125mm (4 7/8") 32MPa (4640psi) CONC. SLAB WITH 5–8% AIR ENTRAINMENT. REINF. WITH 10 GAUGE WIRE MESH 152x152 (6"x6") O.C. EACH WAY. IN BOTTOM THRID OF SLAB. MIN. 30mm (1 1/4") COVER. 600x600 (23 5/8"x23 5/8") CONCRETE PAD UNDER SUMP PUMP. PROVIDE 38x140 (2"x6") STUDS @ 400mm (16") O.C. FOR STAIR. PROVIDE 38x140 (2"x6") STUDS @ 400mm (16") O.C. FOR HOUSE WALL. SLAB TO HAVE MIN. 300mm (12") BEARING ON FDTN. WALL & PROVIDE 12.7mm (1/2") OVER CELLAR DOOR AND WITH 100mm (4") END BEARING.

36) **BRICK CHASE**
THE FLUE SIZE MAY BE REDUCED TO LESS THAN 300mm (3–1/2") THICK TO A MIN. DEPTH OF 600mm (24") AND SHALL BE LINED WITH A FIRE STOPPING MATERIAL WITH METAL TIES SPACED 200mm (8") O.C. VERTICALLY AND 900mm (36") O.C. HORIZONTALLY. FILL SPACE BETWEEN WALL AND CHASE WITH SOLID MIX MORTAR.

37) **CONVENTIONAL ROOF FRAMING (2.0kpa. SNOW LOAD)**
38x140 (2"x6") RAFTERS @ 400mm (16"O.C.) FOR MAX 11'–7" SPAN, 38x184 (2"x8") RIDGE BOARD, 38x89 (2"x4") COLLAR TIES AT MIDSPAN. CEILING JOISTS TO BE 38x89 (2"x4") @ 400mm (16") O.C. FOR MAX 2830mm (9'–3") SPAN & 38x140 (2"x6") @ 400 (16") O.C. FOR MAX. 4400mm (14'–7") SPAN. RAFTERS FOR BUILT–UP ROOF TO BE 38x89 (2"x4") @ 600mm (24") O.C. WITH A 38x89 (2"x4") CENTRE POST TO THE TRUSS BELOW. LATERAL BRACED @ 1800mm (6'–0") O.C. VERTICALLY.

38) **TWO STOREY VOLUME SPACES**
–FOR A MAXIMUM 5490 mm (18'–0") HEIGHT AND MAXIMUM SUPPORTED ROOF TRUSS LENGTH OF 8.5m, PROVIDE 2–38x140 (2–2"x6") STUDS CONTIN. STUDS @ 300mm (12") O.C. (TRIPLE UP AT EVERY THIRD DOUBLE STUD FOR BRACE WALL) C/W 9.6 (3/8") THICK EXT. PLYWOOD SHEATHING. PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 1200 mm (4'–0") O.C. VERTICALLY. –FOR WALLS WITH HORIZ. DISTANCES NOT EXCEEDING 2590 mm (8'–6"), PROVIDE 38x140 (2"x6") STUDS @ 400 (16") O.C. WITH 2–38x140 (2–2"x6") TOP PLATES + 1–38x140 (1–2"x6") BOTTOM PLATE & MINIMUM OF 3–38x140 (3–2"x6") CORE HINGER AT GRID. CEILING LEVEL TIE–INALED & GLUED AT TOP, BOTTOM PLATES AND HEADERS.
TYPICAL 1 STOREY (NOT INSTALLED)
REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.

39) **FOUNDATION WALL (W.O.B./W.O.B.)**
–FOR LATERAL SUPPORT WHERE GRADE 1'–0" BASEMENT SLAB EXCEEDS 1220mm (4'–0") PROVIDE 38x89 (2"x4") POURED CONC. FOUNDATION WALL PROVIDE VERTICAL 38x140 (2"x6") WOOD STUDS @ 400 (16") o.c. WITH 2–38x140 (2–2"x6") WOOD PLATES. PROVIDE 38x89 (2"x4") BOTTOM PLATE TO SLAB & FASTEN TOP OF WALL TO FLOOR JOIST AND ALSO TIED TO 38x84 (2"x4") @ 300 (12") o.c. KNEE WALL. REFER TO DETAIL FOR CLARITY.

40) **EXTERIOR WALLS FOR WALK–OUT CONDITIONS**
THE EXTERIOR BASEMENT STUD WALL TO BE 38x140 (2"x6") STUDS @ 400mm (16") o.c. OR 38x89 (2"x4") STUDS @ 300mm (12"o.c.

WOOD LINTELS AND BUILT–UP WOOD BEAMS

L1 ---- 2/38 x 184 (2/2" x 8") SPF#2
B1 ---- 2/38 x 184 (2/2" x 8") SPF#2
B2 ---- 4/38 x 184 (4/2" x 8") SPF#2
B7 ---- 5/38 x 184 (5/2" x 8") SPF#2

L2 ---- 2/38 x 235 (2/2" x 10") SPF#2
B3 ---- 3/38 x 235 (3/2" x 10") SPF#2
B4 ---- 4/38 x 235 (4/2" x 10") SPF#2

L3 ---- 2/38 x 286 (2/2" x 12") SPF#2
B5 ---- 3/38 x 286 (3/2" x 12") SPF#2
B6 ---- 4/38 x 286 (4/2" x 12") SPF#2

LOOSE STEEL LINTELS

L7 ---- 2 x 89 x 6.4L (3–1/2" x 3–1/2" x 1/4")
L8 ---- 2 x 89 x 7.9L (3–1/2" x 3–1/2" x 5/16")
L9 ---- 102 x 89 x 7.9L (4" x 3–1/2" x 5/16")
L10---- 127 x 89 x 7.9L (5" x 3–1/2" x 5/16")
L11---- 127 x 89 x 11.0L (5" x 3–1/2" x 7/16")
L12---- 152 x 102 x 11.0L (6" x 4" x 7/16")
L13---- 178 x 102 x 11.0L (7" x 4" x 7/16")

LAMINATED VENEER LUMBER (LVL) BEAMS

LVL14 ---- 1–1 3/4"(45) 1/2" (2–45x184)
LVL1 ---- 2–1 3/4"(45) 1/4" (2–45x184)
LVL2 ---- 2–1 3/4"(45) 1/4" (2–45x184)
LVL3 ---- 4–1 3/4"(45) 1/4" (4–45x184)

LVL4A ---- 1–1 3/4"(45) 1/2" (1–45x240)
LVL4 ---- 2–1 3/4"(45) 1/2" (2–45x240)
LVL5 ---- 3–1 3/4"(45) 1/2" (3–45x240)
LVL6 ---- 4–1 3/4"(45) 1/2" (4–45x240)

LVL6A ---- 1–1 3/4"(45) 7/8" (1–45x300)
LVL6 ---- 2–1 3/4"(45) 7/8" (2–45x300)
LVL7 ---- 3–1 3/4"(45) 7/8" (3–45x300)
LVL8 ---- 4–1 3/4"(45) 7/8" (4–45x300)

WINDOWS:
1) MINIMUM BEDROOM WINDOW –OBC. 9.9.10.1.
● AT LEAST ONE BEDROOM WHICH IS GIVEN FLOOR IS TO HAVE MIN. 0.35m2 UNOBSTRUCTED GLAZED OR OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380 mm (1'–3").
2) WINDOW GUARDS –OBC. 9.8.8.1.(6)
● A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 480mm (1'–7") ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE ADJACENT GRADE IS GREATER THAN 1800mm (5'–11")
3) EXTERIOR WINDOWS
SHALL COMPLY WITH OBC DIV–B 9.7.3. & SB12–2.1.1.8.

DOOR SCHEDULE

1	EXTERIOR DOOR	813 x 2032 x 45 (32"x 6'–8" x 1–3/4") INSULATED MIN. R5 0.7 (R4)	
1A	EXTERIOR DOOR	865 x 2032 x 45 (2'–10" x 6'–8" x 1–3/4") INSULATED MIN. R5 0.7 (R4)	
1B	EXTERIOR DOOR	915 x 2032 x 45 (3'–0" x 6'–8" x 1–3/4") INSULATED MIN. R5 0.7 (R4)	
1C	EXTERIOR DOOR	915 x 2335 x 45 (3'–0" x 7'–8" x 1–3/4") INSULATED MIN. R5 0.7 (R4)	
1D	EXTERIOR DOOR	915 x 2335 x 45 (3'–0" x 7'–8" x 1–3/4") INSULATED MIN. R5 0.7 (R4)	
2	EXTERIOR DOOR	813 x 2032 x 45 (32" x 6'–8" x 1–3/4")	
2A	EXTERIOR DOOR	915 x 2032 x 45 (3'–0" x 6'–8" x 1–3/4") 20 MIN RATED DOOR AND FRAME, WITH APPROVED CLOSING DEVICE INSULATED MIN. R5 0.7 (R4)	
2B	EXTERIOR DOOR	915 x 2032 x 45 STRONG TIE OR EQUAL FOR ALL LVL BEAM TO BEAM CONNECTIONS UNLESS NOTED OTHERWISE	
3	EXTERIOR DOOR	760 x 2030 x 35 (2'–6" x 6'–8" x 1–3/8") WEATHERSTRIPPED INSTALLED	
3A	EXTERIOR DOOR	760 x 2030 x 35 (2'–6" x 6'–8" x 1–3/8")	
4	EXTERIOR DOOR	610 x 2030 x 35 (2'–0" x 6'–8" x 1–3/8")	
5	EXTERIOR DOOR	660 x 2030 x 35 (2'–2" x 6'–8" x 1–3/8")	
6	EXTERIOR DOOR	460 x 2030 x 35 (1'–6" x 6'–8" x 1–3/8")	

GENERAL:
1) MECHANICAL VENTILATION IS REQUIRED TO COMPLY WITH OBC–DIV. B, 6.2.2. SEE 9.8.2.2.(3) AND MUNICIPAL STANDARDS.
2) ALL DOWNSPOUTS TO DRAIN AWAY FROM THE BUILDING AS PER OBC 9.26.18.2., 9.8.2.2.(3) AND MUNICIPAL STANDARDS.
3) ALL WINDOW WELLS TO DRAIN TO FOOTING LEVEL PER OBC 9.14.6.3. CHECK WITH THE LOCAL AUTHORITY.
4) STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM. REFER TO OBC. 9.5.2.3., 3.8.3.8.(7)(d) & 3.8.3.13.(1)(f). SEE DETAIL.
● 5) ALL EXTERIOR DOORS TO COMPLY WITH THERMAL RESISTANCE AS STATED IN O.B.C.
● 6) ALL AIR BARRIER SYSTEMS ARE REQUIRED TO COMPLY WITH O.B.C. DIV.–B 9.25.3.
● 6) ALL LUMBER SHALL BE SPRUCE NO.2 GRADE, UNLESS NOTED OTHERWISE.

LUMBER:
1) STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED OTHERWISE.
2) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE NO. 2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE.
3) ALL LAMINATED VENEER LUMBER (LVL) BEAMS, GIRDER TRUSSES, AND METAL HANGER CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY TRUSS MANUFACTURER.
5) LVL BEAMS SHALL BE 2.0E –2950Fb MIN., NAIL EACH PLY OF LVL WITH 89mm (3 1/2") LONG COMMON NAILS AS FOLLOWS: 2–76mm (3") LVL STANDARD: 3 ROWS FOR GREATER DEPTHS AND FOR 4 PLY MEMBERS ADD 1ROW OF GALVANIZED BOLTS BOLTED AT MID–DEPTH OF BEAM @ 915mm (3'–0") O.C.
6) PROVIDE PROPER HANGERS AND HANGERS TYPE "SUT" MANUFACTURED BY SIMPSON STRONG TIE OR EQUAL FOR ALL LVL BEAM TO BEAM CONNECTIONS UNLESS NOTED OTHERWISE.
7) JOISTS HANGERS PROVIDE METAL HANGERS FOR ALL JOISTS AND BUILT–UP WOOD BEAMS. PROVIDE FULL FLUSH BEARING FOR WOOD MEMBERS.
8) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONC. BY AT LEAST 2 mil. POLYETHYLENE FILM. No.50 (450lb.) ROLL ROOFING OR OTHER DAMPPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 150mm (6") ABOVE THE GROUND.

STEEL:
1) STRUCTURAL STEEL SHALL CONFORM TO CSA–G40–21 GRADE 300W. HOLLOW STRUCTURAL SECTIONS SHALL CONFORM TO CSA–G40.21 GRADE 350W "STRUCTURAL QUALITY" OR STEEL OBC. B–9.23.4.3.
2) REINFORCING STEEL SHALL CONFORM TO CSA–G30–18M GRADE 400R.

STUCCO:
1) ALL STUCCO WALLS TO HAVE A MINIMUM 10mm ARTIF SPACE BEHIND THE CLADDING WITH PROVISION FOR DRAINAGE. THE EXTERIOR SHEATHING MUST NOT BE GYPSUM BASED. ALL STUCCO TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.

REFER TO INSULATION CHART FOR SB–12 COMPLIANCE PACKAGE TO BE USED FOR THIS MODEL.
The minimum thermal performance of building envelope and equipment shall conform to the selected package unless otherwise noted.

LEGEND

CLASS 'B' VENT
EXHAUST VENT
DUPLEX OUTLET (12" HIGH)
DUPLEX OUTLET (HEIGHT AS NOTED A.F.F)
WEATHERPROOF DUPLEX OUTLET
HEAVY DUTY OUTLET
POT LIG

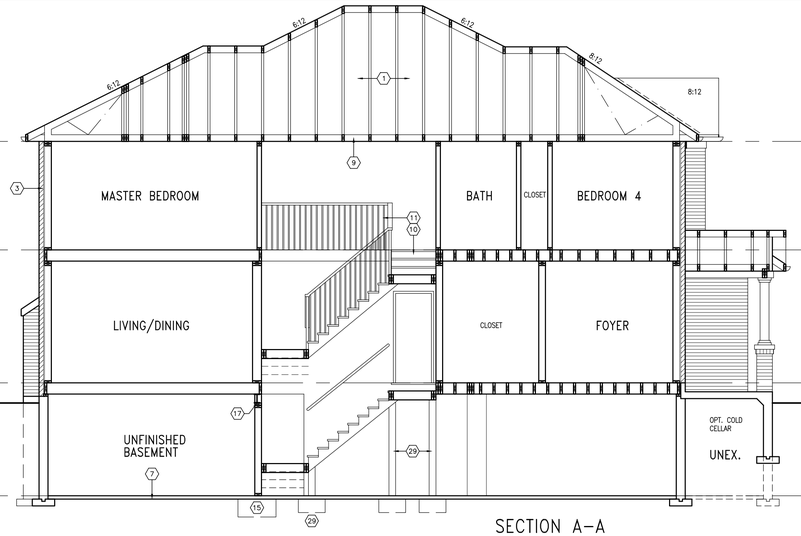

SECTION A-A

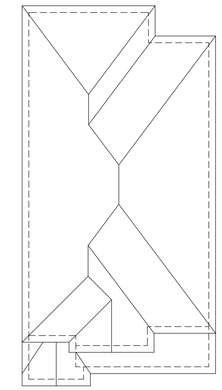

ROOF PLAN 'A'

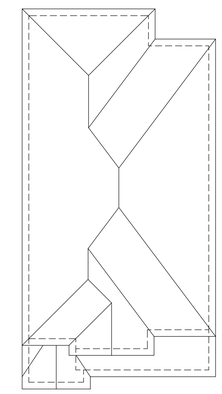

ROOF PLAN 'A'
W/ UPGRADE

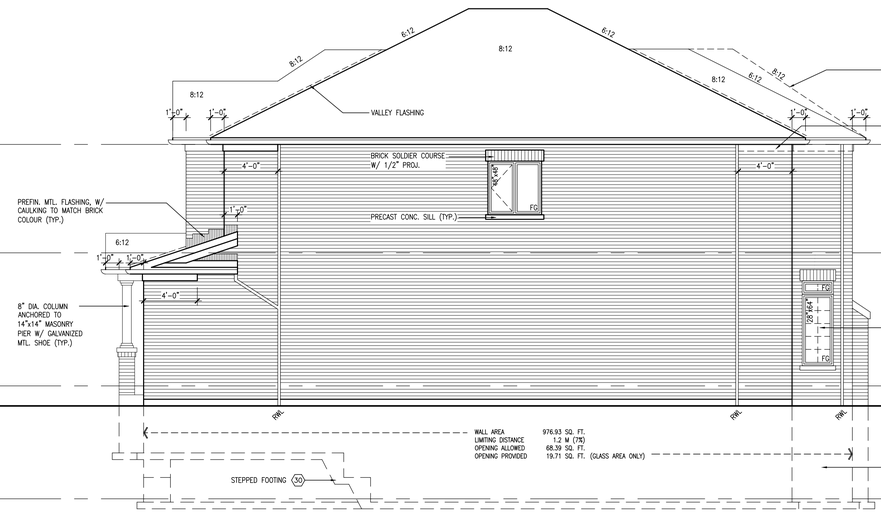

RIGHT SIDE ELEVATION 'A'

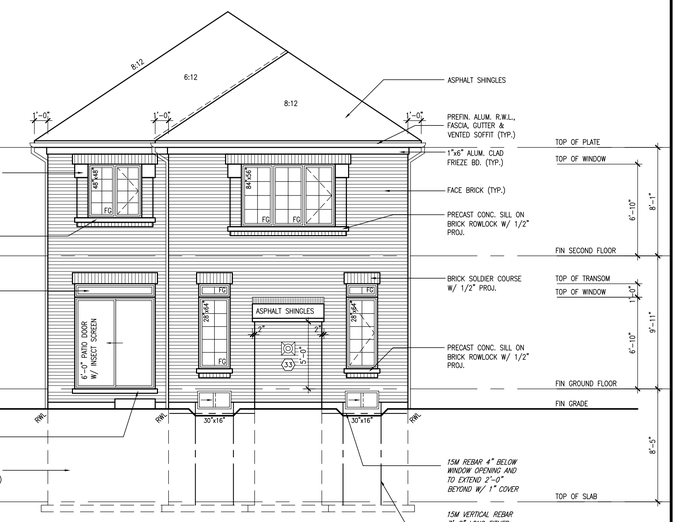

REAR ELEVATION 'A'
W/ UPGRADE

UNINSULATED OPENINGS (PER OBC. SB-12,2.1.1.(7)			
35-12 ELEVATION A	ENERGY EFFICIENCY – OBC SB12		
ELEVATION	WALL AREA S.F.	OPENING S.F.	PERCENTAGE
FRONT	523 S.F.	68.00 S.F.	13.00 %
LEFT SIDE	953 S.F.	46.89 S.F.	4.92 %
RIGHT SIDE	953 S.F.	30.78 S.F.	3.23 %
REAR	523 S.F.	131.89 S.F.	25.22 %
TOTAL SQ. FT.	2952.00 S.F.	277.56 S.F.	9.40 %
TOTAL SQ. M.	274.25 S.M.	25.79 S.M.	9.40 %

REAR ELEVATION 'A' & 'B'

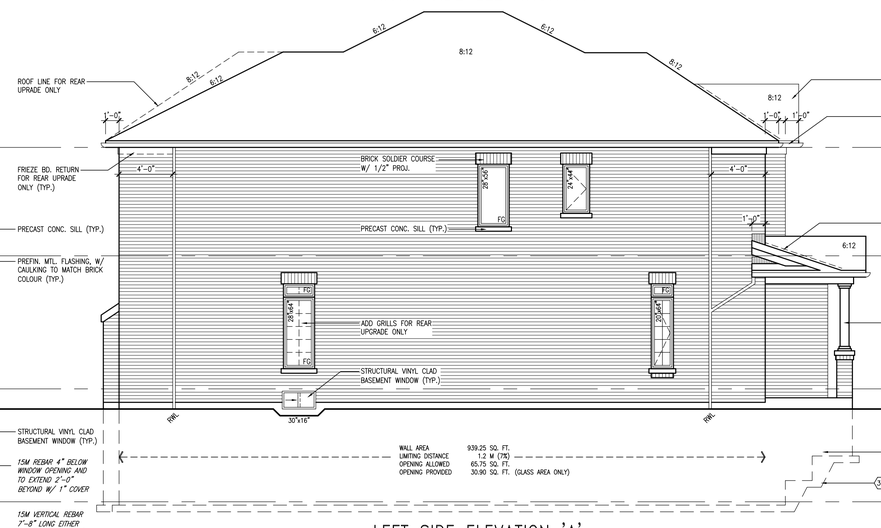

LEFT SIDE ELEVATION 'A'

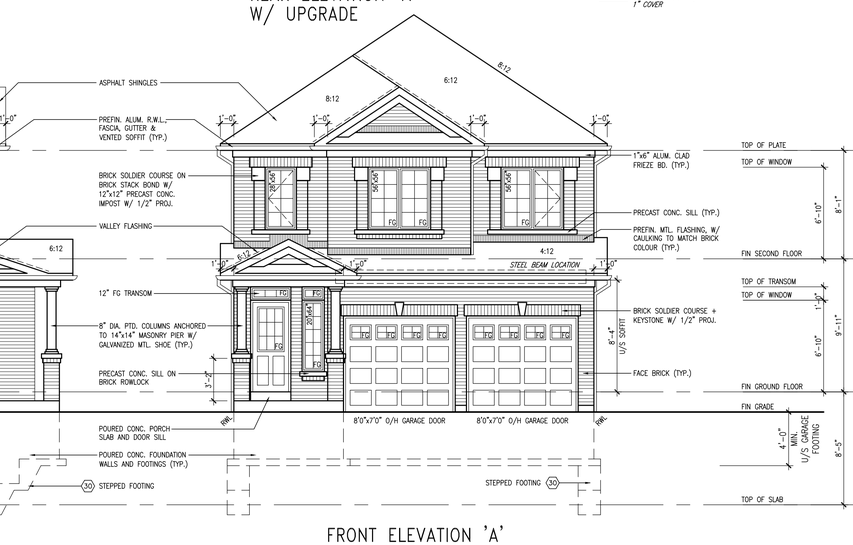

FRONT ELEVATION 'A'

no.	description	date	by
10		-	-
9		-	-
8		-	-
7		-	-
6		-	-
5		-	-
4		-	-
3	REVISED AS PER ENG. COMMENTS	APR 09–14	KC
2	REVISED AS PER ROOF AND FLOOR TRUSSES	MAR 25–14	KC
1	ISSUED FOR CLIENT REVIEW	FEB 18–14	KL

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the architect which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255
f 416.630.4782
va3design.com

All drawings specifications, related documents and design are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

BAYVIEW WELLINGTON

project name
VICTORIA VILLAGE
municipality
ST. CATHARINES, ON.
unit name
PRESTON 12
project no. 07004
unit no. 35–12

ELEVATIONS 'A'

date	scale	drawing no.
JANUARY 2014	3/16" = 1'-0"	2
drawn by KL	checked by –	file name 07004-35-12

STUD WALL REINFORCEMENT FOR FUTURE GRAB BARS IN MAIN BATHROOM

REINFORCEMENT OF STUD WALLS SHALL BE INSTALLED ADJACENT TO WATER CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM.
FUTURE GRAB BARS TO BE MOUNTED TO RESIST HORIZ. AND VERT. LOADS OF 1.3 KN (300 lb)
REFER TO OBC. 9.5.2.3, 3.8.3.6.(1)(a) & 3.8.3.13.(1)(f), AND DETAILS PROVIDED.

① VERTICAL STUDS

9'-0" HIGH CEILINGS: 2/2"x6" SPR. #2 OR 3/2"x4" SPR. #2

VERTICAL STUDS

8'-0" HIGH CEILINGS: 2/2"x6" SPR. #2 OR 3/2"x4" SPR. #2 (4" WALL)

② SOLID BLOCKING

2/2"x8" SPR. #2 NAILED WITH 3-ROWS OF 3" LONG COMMON NAILS @ 6" O.C. AND END NAILED TO STUDS WITH 6-3 1/2" LONG COMMON NAILS





GB1 FUTURE GRAB BAR @ TOILET (BACK WALL)



GB1A FUTURE DIAGONAL GRAB BAR DETAIL



GB1B FUTURE L-SHAPE GRAB BAR DETAIL (ALTERNATE)



GB2 FUTURE U-SHAPE GRAB BAR @ TOILET W/ REAR GRAB BAR (REAR VIEW)



GB2 FUTURE U-SHAPE GRAB BAR @ TOILET W/ REAR GRAB BAR (SIDE VIEW)



GB3 FUTURE GRAB BAR IN SHOWER / BATHTUB (SIDE VIEW)

PACKAGE J

COMPLIANCE TO OBC SB-12 2.1.1.1(11)

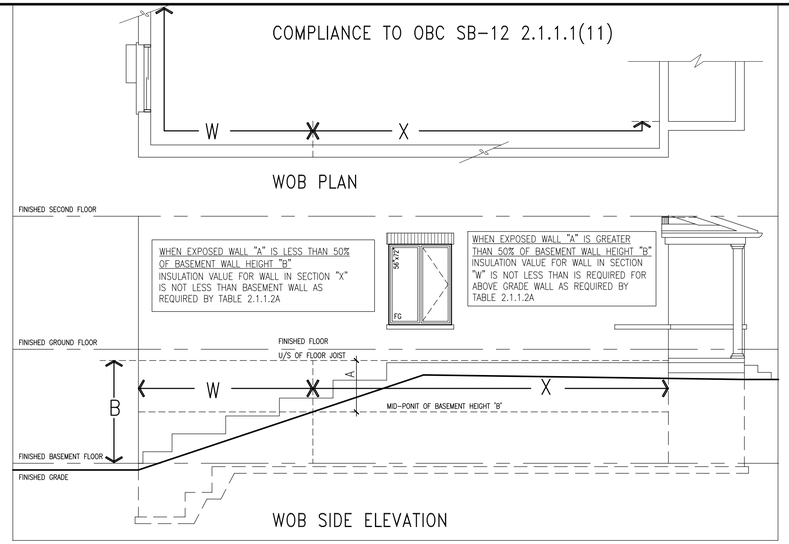

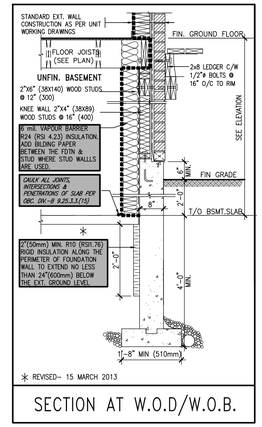

SECTION AT W.O.D/W.O.B.

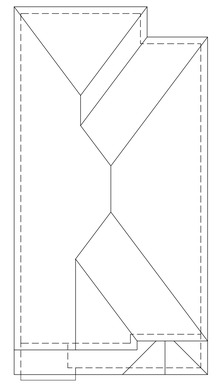

ROOF PLAN 'B'

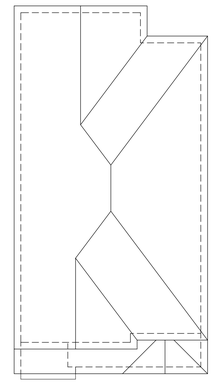

ROOF PLAN 'B' W/ UPGRADE

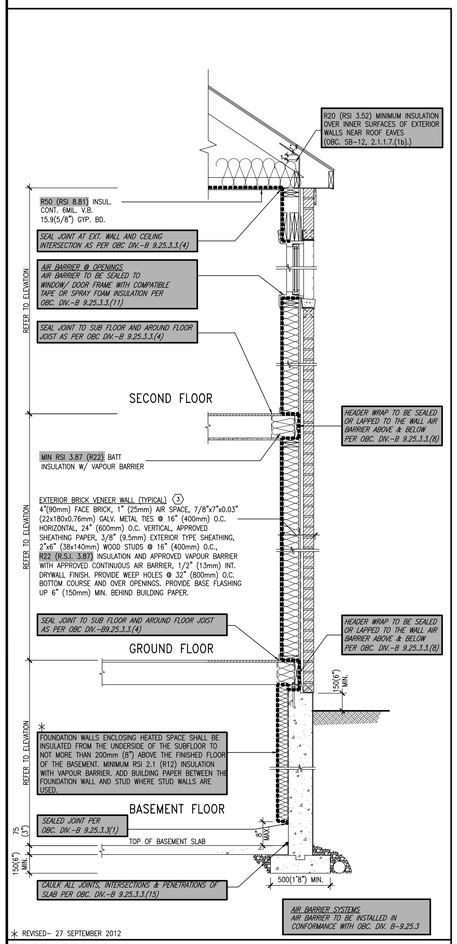

EW TYPICAL EXT. WALL AIR BARRIER CONTINUITY SECTION W/ BRICK VENEER SCALE: 1/2" = 1'-0"

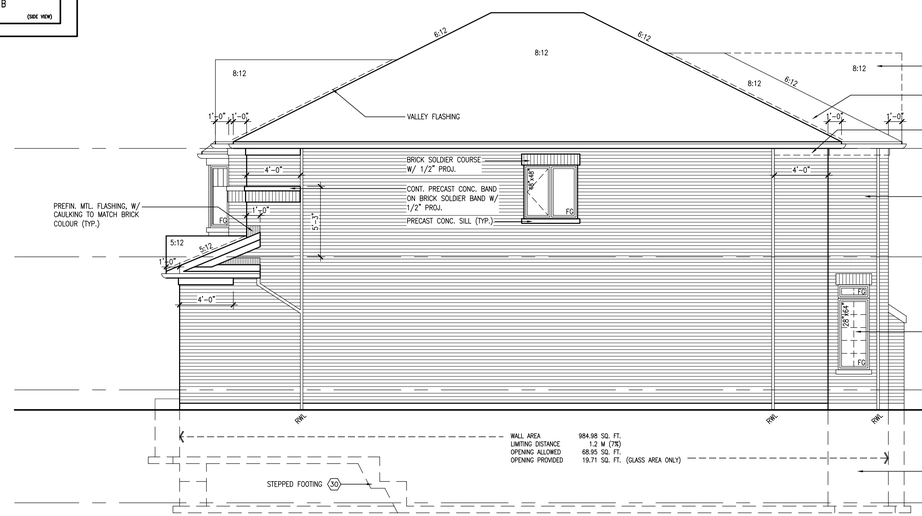

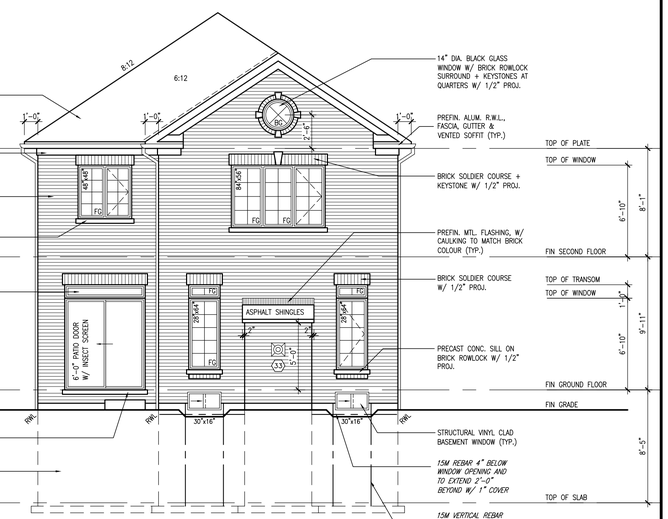

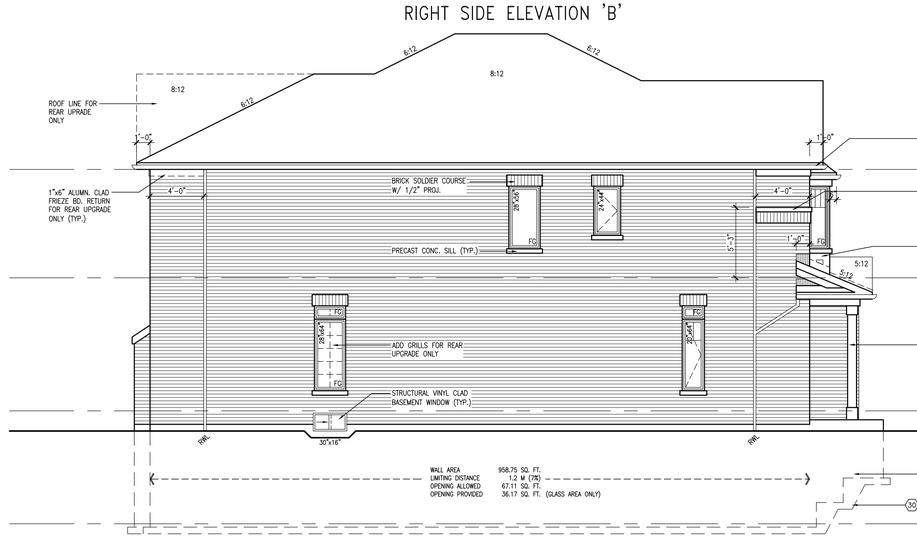

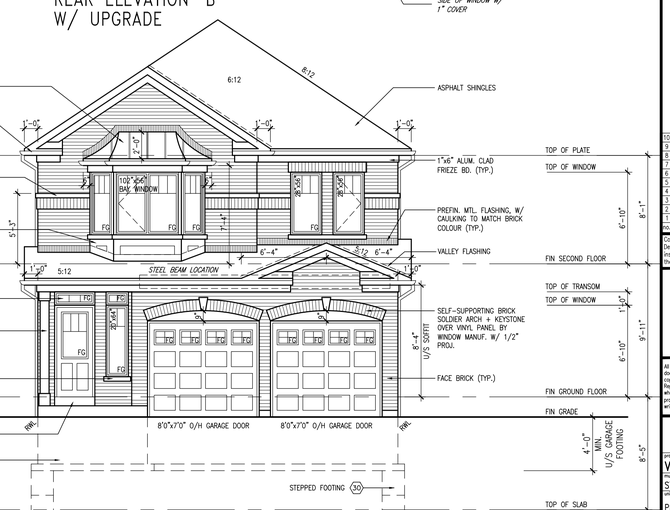

UNINSULATED OPENINGS (PER OBC. SB-12,2.1.1.(7)			
35-12 ELEVATION B	ENERGY EFFICIENCY - OBC SB12		
ELEVATION	WALL AREA S.F.	OPENING S.F.	PERCENTAGE
FRONT	523 S.F.	75.39 S.F.	14.41 %
LEFT SIDE	959 S.F.	46.89 S.F.	4.89 %
RIGHT SIDE	959 S.F.	30.78 S.F.	3.21 %
REAR	523 S.F.	131.89 S.F.	25.22 %
TOTAL SQ. FT.	2964.00 S.F.	284.95 S.F.	9.61 %
TOTAL SQ. M.	275.36 S.M.	26.47 S.M.	9.61 %

no.	description	date	by
10		-	-
9		-	-
8		-	-
7		-	-
6		-	-
5		-	-
4		-	-
3	REVISED AS PER ENG. COMMENTS	APR 09-14	RC
2	REVISED AS PER ROOF AND FLOOR TRUSSES	MAR 25-14	RC
1	ISSUED FOR CLIENT REVIEW	FEB 18-14	KL

Contractor must verify all dimensions on the job and report any discrepancy to the Designer before proceeding with the work. All drawings and specifications are instruments of service and the property of the architect which must be returned at the completion of the work. Drawings are not to be scaled.

VA3 DESIGN
300A Wilson Avenue
Toronto ON M3H 1S8
t 416.630.2255
f 416.630.4782
va3design.com

All drawings specifications, related documents and designs are the copyright property of VA3 DESIGN. Reproduction of this property in whole or in part is strictly prohibited without VA3 DESIGN's written permission.

BAYVIEW WELLINGTON

project name: VICTORIA VILLAGE
municipality: ST. CATHARINES, ON.
project no.: 07004
unit name: PRESTON 12
unit no.: 35-12
title: ELEVATIONS 'B'
date: JANUARY 2014
scale: 3/16" = 1'-0"
drawing no.: 3
drawn by: KL
checked by: --
file name: 07004-35-12