

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information					
Building number, street name Barossa 5 S38-5 WOB				Lot: Lot/con.	
Municipality Bradford		Postal code	Plan number/ other description		
B. Individual who reviews and takes responsibility for design activities					
Name David DaCosta			Firm gtaDesigns Inc.		
Street address 2985 Drew Road, Suite 202				Unit no.	Lot/con.
Municipality Mississauga		Postal code L4T 0A4	Province Ontario	E-mail dave@gtadesigns.ca	
Telephone number (905) 671-9800		Fax number (647) 494-9643		Cell number (416) 268-6820	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 of Division C]					
☐ House ☒ HVAC – House ☐ Building Structural ☐ Small Buildings ☐ Building Services ☐ Plumbing – House ☐ Large Buildings ☐ Detection, Lighting and Power ☐ Plumbing – All Buildings ☐ Complex Buildings ☐ Fire Protection ☐ On-site Sewage Systems					
Description of designer's work				Model Certification	
				Project #:	PJ-00204
				Layout #:	JB-04522
Heating and Cooling Load Calculations		Main		Builder	Bayview Wellington
Air System Design		Alternate X		Project	Green Valley East
Residential mechanical ventilation Design Summary		Area Sq ft: 2780		Model	Barossa 5
Residential System Design per CAN/CSA-F280-12					S38-5 WOB
Residential New Construction - Forced Air				SB-12	Package A1
D. Declaration of Designer					
I, <u>David DaCosta</u> declare that (choose one as appropriate): (print name) ☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4 Division C of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____ ☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5 of Division C, of the Building Code. Individual BCIN: <u>32964</u> Basis for exemption from registration: <u>Division C 3.2.4.1. (4)</u> ☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification:					
I certify that:					
1. The information contained in this schedule is true to the best of my knowledge.					
2. I have submitted this application with the knowledge and consent of the firm.					
<u>March 13, 2018</u> Date				 Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d), of Division C, Article 3.2.5.1. of Division C and all other persons who are exempt from qualifications under Subsections 3.2.4 . and 3.2.5.of Division C.
- Schedule 1 does not require to be completed a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited licence to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Heat loss and gain calculation summary sheet				CSA-F280-M12 Standard Form No. 1	
These documents issued for the use of Bayview Wellington				Layout No.	
and may not be used by any other persons without authorization. Documents for permit and/or construction are signed in red.				JB-04522	
Building Location					
Address (Model): S38-5 WOB			Site: Green Valley East		
Model: Barossa 5			Lot:		
City and Province: Bradford			Postal code:		
Calculations based on					
Dimensional information based on:			VA3 Design Jan/2018		
Attachment: Detached			Front facing: East/West		Assumed? Yes
No. of Levels: 3		Ventilated? Included	Air tightness: 1961-Present (ACH=3.57)		Assumed? Yes
Weather location: Bradford			Wind exposure: Sheltered		
HRV? LifeBreath		RNC155	Internal shading: Light-translucent		Occupants: 5
Sensible Eff. at -25C 71%		Apparent Effect. at -0C 84%	Units: Imperial		Area Sq ft: 2780
Sensible Eff. at -0C 75%					
Heating design conditions			Cooling design conditions		
Outdoor temp -9.4 Indoor temp: 72 Mean soil temp: 48			Outdoor temp 86 Indoor temp: 75 Latitude: 44		
Above grade walls			Below grade walls		
Style A: As per OBC SB12 Package A1 R 22			Style A: As per OBC SB12 Package A1 R 20ci		
Style B: Existing Walls (When Applicable) R 12			Style B:		
Style C:			Style C:		
Style D:			Style D:		
Floors on soil			Ceilings		
Style A: As per Selected OBC SB12 Package A1			Style A: As per Selected OBC SB12 Package A1 R 60		
Style B:			Style B: As per Selected OBC SB12 Package A1 R 31		
Exposed floors			Style C:		
Style A: As per Selected OBC SB12 Package A1 R 31			Doors		
Style B:			Style A: As per Selected OBC SB12 Package A1 R 4.00		
Windows			Style B:		
Style A: As per Selected OBC SB12 Package A1 R 3.55			Style C:		
Style B: Existing Windows (When Applicable) R 1.99			Skylights		
Style C:			Style A: As per Selected OBC SB12 Package A1 R 2.03		
Style D:			Style B:		
Attached documents: As per Shedule 1		Heat Loss/Gain Caculations based on CSA-F280-12 Effective R-Values			
Notes: Residential New Construction - Forced Air					
Calculations performed by					
Name: David DaCosta			Postal code: L4T 0A4		
Company: gtaDesigns Inc.			Telephone: (905) 671-9800		
Address: 2985 Drew Road, Suite 202			Fax: (416) 268-6820		
City: Mississauga			E-mail dave@gtadesigns.ca		

Builder: **Bayview Wellington**

Date: **March 13, 2018**

Project: **Green Valley East**

Model: **Barossa 5
S38-5 WOB**

System 1

I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under Division C subsection 3.2.5. of the Building Code.

Individual BCIN: 32964 *David DaCosta* David DaCosta

Project # **PJ-00204**
Layout # **JB-04522**

Page 3

DESIGN LOAD SPECIFICATIONS		AIR DISTRIBUTION & PRESSURE		FURNACE/AIR HANDLER DATA:		BOILER/WATER HEATER DATA:		A/C UNIT DATA:	
Level 1 Net Load	18,715 btu/h	Equipment External Static Pressure	0.5 "w.c.	Make	Amana	Make	Type	Amana	2.5 Ton
Level 2 Net Load	18,002 btu/h	Additional Equipment Pressure Drop	0.225 "w.c.	Model	AMEC960603BNA	Model		Cond.-----	2.5
Level 3 Net Load	17,459 btu/h	Available Design Pressure	0.275 "w.c.	Input Btu/h	60000	Input Btu/h		Coil -----	2.5
Level 4 Net Load	0 btu/h	Return Branch Longest Effective Length	300 ft	Output Btu/h	57600	Output Btu/h			
Total Heat Loss	54,176 btu/h	R/A Plenum Pressure	0.138 "w.c.	E.s.p.	0.50 " W.C.	Min.Output Btu/h	AWH		
Total Heat Gain	27,972 btu/h	S/A Plenum Pressure	0.14 "w.c.	Water Temp	deg. F.	Blower DATA:			
Combo System HL + 10%	59,593 Btu/h	Heating Air Flow Proportioning Factor	0.0216 cfm/btuh	AFUE	96%	Blower Speed Selected:	W2	Blower Type	ECM
Building Volume Vb	32202 ft³	Cooling Air Flow Proportioning Factor	0.0344 cfm/btuh	Aux. Heat				(Brushless DC OBC 12.3.1.5.(2))	
Ventilation Load	1,118 Btu/h.	R/A Temp	70 deg. F.	SB-12 Package	Package A1	Heating Check	1170 cfm	Cooling Check	963 cfm
Ventilation PVC	79.5 cfm	S/A Temp	116 deg. F.						
Supply Branch and Grill Sizing		Diffuser loss	0.01 "w.c.	Temp. Rise>>>	46 deg. F.	Selected cfm>	1170 cfm	Cooling Air Flow Rate	963 cfm

	Level 1														Level 2																		
S/A Outlet No.	1	2	3	4	24															5	6	7	8	9	10	11	12						
Room Use	BASE	BASE	BASE	BASE	BASE															KIT	KIT	GRT	PWD	MUD	FOY	LIV/DIN	LIV/DIN						
Btu/Outlet	3743	3743	3743	3743	3743															2695	2695	3021	1249	1004	3518	1910	1910						
Heating Airflow Rate CFM	81	81	81	81	81															58	58	65	27	22	76	41	41						
Cooling Airflow Rate CFM	18	18	18	18	18															82	82	91	11	5	49	66	66						
Duct Design Pressure	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13						
Actual Duct Length	50	37	19	30	62															52	45	46	30	22	29	9	47						
Equivalent Length	140	90	120	100	150	70	70	70	70	70	70	70	70	70	70	110	160	150	150	160	80	90	80	70	70	70	70						
Total Effective Length	190	127	139	130	212	70	70	70	70	70	70	70	70	70	70	162	205	196	180	182	109	99	127	70	70	70	70						
Adjusted Pressure	0.07	0.10	0.09	0.10	0.06	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.08	0.06	0.07	0.07	0.07	0.12	0.13	0.10	0.19	0.19	0.19	0.19	0.19						
Duct Size Round	6	6	6	6	6															6	6	6	4	4	6	5	5						
Outlet Size	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	3x10	3x10	4x10	3x10	3x10	4x10	4x10	4x10	4x10	4x10					
Trunk	E	C	C	B	D															D	D	D	C	C	B	A	C						

	Level 3												Level 4													
S/A Outlet No.	13	14	15	16	17	18	19	20	21	22	23															
Room Use	MAST	MAST	ENS	BED 2	BATH	WIC	BED 3	BED 3	LAUN	ENS 4	BED 4															
Btu/Outlet	2035	2035	1411	1553	931	904	2098	2098	2252	776	1364															
Heating Airflow Rate CFM	44	44	30	34	20	20	45	45	49	17	29															
Cooling Airflow Rate CFM	44	44	26	30	9	17	56	56	86	13	36															
Duct Design Pressure	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13
Actual Duct Length	77	73	66	47	44	47	46	44	56	44	75															
Equivalent Length	150	170	170	130	160	150	140	130	125	135	160	70	70	70	70	70	70	70	70	70	70	70	70	70	70	70
Total Effective Length	227	243	236	177	204	197	186	174	181	179	235	70	70	70	70	70	70	70	70	70	70	70	70	70	70	70
Adjusted Pressure	0.06	0.05	0.06	0.07	0.06	0.07	0.07	0.07	0.07	0.07	0.06	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	
Duct Size Round	5	5	4	4	4	4	5	5	6	3	5															
Outlet Size	3x10	3x10	3x10	3x10	3x10	3x10	3x10	3x10	4x10	3x10	3x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10
Trunk	E	D	D	C	B	B	B	B	B	C	E															

Return Branch And Grill Sizing	Grill Pressure Loss											0.02 "w.c.
R/A Inlet No.	1R	2R	3R	4R	5R	6R	7R	8R	9R	10R	11R	
Inlet Air Volume CFM	202	454	102	155	155	102						
Duct Design Pressure	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	
Actual Duct Length	12	24	42	46	47	58						
Equivalent Length	115	125	135	195	235	160	50	50	50	50	50	
Total Effective Length	127	149	177	241	282	218	50	50	50	50	50	
Adjusted Pressure	0.09	0.08	0.07	0.05	0.04	0.05	0.24	0.24	0.24	0.24	0.24	
Duct Size Round	8.0	11.0	6.0	8.0	8.5	6.0						
Inlet Size	FLC	8	8	8	8	8						
" "	x	x	x	x	x	x	x	x	x	x	x	
Inlet Size	9x6	30	14	14	14	14						
Trunk	Y	Z	Z	Z	Z	Y						

Return Trunk Duct Sizing	Trunk	CFM	Press.	Round	Rect. Size
Drop		1170	0.04	18.0	24x12
Z		1170	0.04	18.0	30x10 24x12
Y		304	0.05	10.5	12x8 10x10
X					
W					
V					
U					
T					
S					
R					
Q					

Supply Trunk Duct Sizing	Trunk	CFM	Press.	Round	Rect. Size
A		1170	0.05	17.0	26x10 22x12
B		336	0.06	10.5	12x8 10x10
C		793	0.05	15.0	26x8 20x10
D		491	0.05	12.5	18x8 14x10
E		154	0.06	8.0	8x8 8x7
F					
G					
H					
I					
J					
K					

2012 OBC

Builder: Bayview Wellington

Date: March 13, 2018

Project: Green Valley East

Model: Barossa 5
S38-5 WOB

System 1

Weather Data Bradford 44 -9.4 86 22 48.2

Heat Loss ^T 81.4 deg. F Ht gain ^T 11 deg. F GTA: 2780

Project #
Layout #

Level 3

	MAST	ENS	BED 2	BATH	WIC	BED 3	LAUN	ENS 4	BED 4		
Run ft. exposed wall A	51 A	19 A	16 A	6 A	10 A	24 A	21 A	8 A	14 A	A	A
Run ft. exposed wall B	B	B	B	B	B	B	B	B	B	B	B
Ceiling height	9.0	8.0	8.0	8.0	8.0	10.0	9.0	8.0	8.0	8.0	8.0
Floor area	341 Area	118 Area	184 Area	80 Area	27 Area	239 Area	108 Area	106 Area	190 Area	Area	Area
Exposed Ceilings A	341 A	118 A	184 A	80 A	27 A	239 A	108 A	106 A	190 A	A	A
Exposed Ceilings B	B	B	B	B	B	B	B	B	B	B	B
Exposed Floors	Flr	Flr	17 Flr	70 Flr	27 Flr	163 Flr	6 Flr	8 Flr	Flr	Flr	Flr
Gross Exp Wall A	459	152	128	48	80	240	189	64	112		
Gross Exp Wall B											

Components	R-Values	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain
North Shaded	3.55	22.93	10.91																		
East/West	3.55	22.93	27.35	32	734	875	13	298	356	18	413	196	8	183	87	9	206	246	43	986	1176
South	3.55	22.93	20.89																		
Existing Windows	1.99	40.90	22.15																		
Skylight	2.03	40.10	88.23																		
Doors	4.00	20.35	2.75																		
Net exposed walls A	17.03	4.78	0.65	427	2041	276	139	664	90	110	526	71	40	191	26	71	339	46	178	851	115
Net exposed walls B	8.50	9.58	1.29																		
Exposed Ceilings A	59.22	1.37	0.64	341	469	219	118	162	76	184	253	118	80	110	51	27	37	17	239	329	153
Exposed Ceilings B	22.86	3.56	1.66																		
Exposed Floors	29.80	2.73	0.17							17	46	3	70	191	12	27	74	5	163	445	27
Foundation Conductive Heatloss																					
Total Conductive																					
Heat Loss																					
Heat Gain																					
Air Leakage	Heat Loss/Gain	0.2250	0.0353																		
Case 1		0.02	0.07																		
Case 2		14.07	11.88																		
Case 3	x	0.03	0.07																		
Heat Gain People			239	2	97	90		34	34	1	37	25		20	12		20	21		91	122
Appliances Loads	1 =.25 percent		4196																		
Duct and Pipe loss			10%																		
Level 3 HL Total	17,459			4070				1411			1553			931		1	80	31	1	373	211
Level 3 HG Total	12,146				2582				746			867			275		904			4196	3259

Level 4

Run ft. exposed wall A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A
Run ft. exposed wall B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B
Ceiling height																					
Floor area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area
Exposed Ceilings A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A
Exposed Ceilings B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B
Exposed Floors	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr
Gross Exp Wall A																					
Gross Exp Wall B																					

Components	R-Values	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain
North Shaded	3.55	22.93	10.91																		
East/West	3.55	22.93	27.35																		
South	3.55	22.93	20.89																		
Existing Windows	1.99	40.90	22.15																		
Skylight	2.03	40.10	88.23																		
Doors	4.00	20.35	2.75																		
Net exposed walls A	17.03	4.78	0.65																		
Net exposed walls B	8.50	9.58	1.29																		
Exposed Ceilings A	59.22	1.37	0.64																		
Exposed Ceilings B	22.86	3.56	1.66																		
Exposed Floors	29.80	2.73	0.17																		
Foundation Conductive Heatloss																					
Total Conductive																					
Heat Loss																					
Heat Gain																					
Air Leakage	Heat Loss/Gain	0.0000	0.0353																		
Case 1		0.00	0.07																		
Case 2		14.07	11.88																		
Case 3	x	0.03	0.07																		
Heat Gain People			239																		
Appliances Loads	1 =.25 percent		4196																		
Duct and Pipe loss			10%																		
Level 4 HL Total	0																				
Level 4 HG Total	0																				

I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under

Division C subsection 3.2.5. of the Building Code. Individual BCIN:

32964

David DaCosta

David DaCosta

SB-12 Package

Package A1

Total Heat Loss	54,176	btu/h
Total Heat Gain	27,972	btu/h

I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under Division C subsection 3.2.5. of the Building Code.

Individual BCIN: 32964



David DaCosta

Package:
Package A1
Project:
Bradford
Model:
S38-5 WOB
RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

For systems serving one dwelling unit & conforming to the Ontario Building Code, O.reg 332/12

Location of Installation

Lot #	Plan #
Township	Bradford
Roll #	Permit #
Address	

Builder

Name	Bayview Wellington
Address	
City	
Tel	Fax

Installing Contractor

Name	
Address	
City	
Tel	Fax

Combustion Appliances 9.32.3.1(1)

- | | | |
|----|-------------------------------------|--|
| a) | ☒ | Direct vent (sealed combustion) only |
| b) | ☐ | Positive venting induced draft (except fireplaces) |
| c) | ☐ | Natural draft, B-vent or induced draft fireplaces |
| d) | ☐ | Solid fuel (including fireplaces) |
| e) | ☐ | No combustion Appliances |

Heating System

- | | |
|-------------------------------------|--|
| ☒ | Forced air |
| ☐ | Non forced air |
| ☐ | Electric space heat (if over 10% of heat load) |

House Type 9.32.3.1(2)

- | | | |
|-------|-------------------------------------|---|
| I | ☒ | Type a) or b) appliances only, no solid fuel |
| II | ☐ | Type I except with solid fuel (including fireplace) |
| III | ☐ | Any type c) appliance |
| IV | ☐ | Type I or II either electric space heat |
| Other | ☐ | Type I, II or IV no forced air |

System Design Option

- | | | |
|---|-------------------------------------|---|
| 1 | ☐ | Exhaust only / forced air system |
| 2 | ☐ | HRV WITH DUCTING / forced air system |
| 3 | ☒ | HRV simplified connection to forced air system |
| 4 | ☐ | HRV full ducting/not coupled to forced air system |
| | ☐ | Part 6 design |

Total Ventilation Capacity 9.32.3.3(1)

Bsmt & Master Bdrm	2 @ 21.2 cfm	42.4 cfm
Other Bedrooms	3 @ 10.6 cfm	31.8 cfm
Bathrooms & Kitchen	5 @ 10.6 cfm	53 cfm
Other rooms	5 @ 10.6 cfm	53 cfm
Total		<u>180.2</u>

Principal Ventilation Capacity 9.32.3.4(1)

Master bedroom	1 @ 31.8 cfm	31.8 cfm
Other bedrooms	3 @ 15.9 cfm	47.7 cfm
Total		<u>79.5</u>

Principal Exhaust Fan Capacity

Make	Model	Location
LifeBreath	RNC155	Base
132 cfm		Sones or Equiv.

Heat Recovery Ventilator

Make	LifeBreath
Model	RNC155
132 cfm high	80 cfm low
Sensible efficiency @ -25 deg C	71%
Sensible efficiency @ 0 deg C	75%

Note: Installer to balance HRV/ERV to within 10 percent of PVC

Supplemental Ventilation Capacity

Total ventilation capacity	180.2
Less principal exhaust capacity	79.5
REQUIRED supplemental vent. Capacity	<u>100.7</u> cfm

Supplemental Fans 9.32.3.5.

Location	cfm	Model	Sones
Ens	50	XB50	0.3
Bath	50	XB50	0.3
Ens 4	50	XB50	0.3

all fans HVI listed Make Broan or Equiv.

Designer Certification

I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.

Name David DaCosta

Signature



HRAI #

5190

BCIN #

32964

Date

March 13, 2018



2985 Drew Road, Suite 202, Mississauga, Ontario
 L4T 0A4 Tel: 905-671-9800 Fax: 647-494-9643
 e-mail dave@gtadesigns.ca

Energy Efficiency Design Summary: Prescriptive Method (Building Code Part 9, Residential)

Page 7
 Project # PJ-00204
 Layout # JB-04522

This form is used by a designer to demonstrate that the energy efficiency design of a house complies with the building code using the prescriptive method described in Subsection 3.1.1. of SB-12. This form is applicable where the ratio of gross area of windows/sidelights/skylights/glazing in doors and sliding glass doors to the gross area of peripheral walls is not more than 22%.

For use by Principal Authority

Application No:

Model/Certification Number

A. Project Information

Building number, street name	Barossa 5 S38-5 WOB	Unit number	Lot/Con
Municipality	Bradford	Postal code	Reg. Plan number / other description

B. Prescriptive Compliance [indicate the building code compliance package being employed in the house design]

SB-12 Prescriptive (input design package):

Package A1

Table: 3.1.1.2.A

C. Project Design Conditions

Climatic Zone (SB-1):	Heat. Equip. Efficiency	Space Heating Fuel Source		
☒ Zone 1 (< 5000 degree days) ☐ Zone 2 (≥ 5000 degree days)	☒ ≥ 92% AFUE ☐ ≥ 84% < 92% AFUE	☒ Gas ☐ Oil	☐ Propane ☐ Electric	☐ Solid Fuel ☐ Earth Energy
Ratio of Windows, Skylights & Glass (W, S & G) to Wall Area		Other Building Characteristics		
Area of Walls = <u>389.88</u> m ² or <u>4196.7</u> ft ²	W, S & G % = <u>11%</u>	☐ Log/Post&Beam ☐ Slab-on-ground ☒ Air Conditioning ☐ Air Sourced Heat Pump (ASHP) ☐ Ground Source Heat Pump (GSHP)	☐ ICF Above Grade ☒ Walkout Basement ☐ Combo Unit	☐ ICF Basement
Area of W, S & G = <u>44.128</u> m ² or <u>475.0</u> ft ²	Utilize Window Averaging ☐ Yes ☒ No			

D. Building Specifications [provide values and ratings of the energy efficiency components proposed]

Energy Efficiency Substitutions			
☐ ICF (3.1.1.2.(5) & (6) / 3.1.1.3.(5)) ☐ Combined space heating and domestic water heating systems (3.1.1.2(7) / 3.1.1.3.(7))			
☐ Airtightness substitution(s) Airtightness test required (Refer to Design Guide Attached)	☐ Table 3.1.1.4.B	Required:	Permitted Substitution:
	☐ Table 3.1.1.4.C	Required:	Permitted Substitution:
Building Component	Minimum RSI/R-Values or Maximum U-Value ¹		Efficiency Ratings
Thermal Insulation	Nominal	Effective	Windows & Doors Provide U-Value ⁽¹⁾ or ER rating
Ceiling with Attic Space	60		Windows/Sliding Glass Doors 1.6
Ceiling without Attic Space	31		Skylights 2.8
Exposed Floor	31		Mechanicals
Walls Above Grade	22		Heating Equip.(AFUE) 96%
Basement Walls	20.0ci		HRV Efficiency (SRE% at 0°C) 75%
Slab (all >600mm below grade)	x		DHW Heater (EF) 0.80
Slab (edge only ≤600mm below grade)	10		DWHR (CSA B55.1 (min. 42% efficiency)) #Showers 2
Slab (all ≤600mm below grade, or heated)	10		Combined Heating System

(1) U value to be provided in either W/(m²·K) or Btu/(h·ft²·°F) but not both.

E. Designer(s) [name(s) & BCIN(s), if applicable, of person(s) providing information herein to substantiate that design meets building code]

Name	BCIN	Signature
David DaCosta	32964	

Package: Package A1 System: System 1
Project: Bradford Model: S38-5 WOB

Air Leakage Calculations

Building Air Leakage Heat Loss				
B	LRairh	Vb	HL ^Δ T	HL _{leak}
0.018	0.322	32202	81.4	15172

Building Air Leakage Heat Gain				
B	LRairh	Vb	HG ^Δ T	HG _{Leak}
0.018	0.080	32202	11	508

Air Leakage Heat Loss/Gain Multiplier Table (Section 11)				
Level	Level Factor (LF)	Building Air	Level Conductive Heat Loss	Air Leakage Heat Loss Multiplier
Level 1	0.5	15172	10805	0.7020
Level 2	0.3		13060	0.3485
Level 3	0.2		13484	0.2250
Level 4	0		0	0.0000

Levels			
1	2	3	4
(LF)	(LF)	(LF)	(LF)
1.0	0.6	0.5	0.4
	0.4	0.3	0.3
		0.2	0.2
			0.1

HG LEAK		Air Leakage Heat Gain	
	508		0.0353
BUILDING CONDUCTIVE HEAT GAIN			14413

Levels this Dwelling	
3	

Ventilation Calculations

Ventilation Heat Loss

Ventilation Heat Loss				
C	PVC	HL ^Δ T	(1-E) HRV	HL _{bvent}
1.08	79.5	81.4	0.16	1118

Ventilation Heat Gain

Ventilation Heat Gain			
C	PVC	HG ^Δ T	HG _{bvent}
1.1	79.5	11	944

Case 1

Ventilation Heat Loss (Exhaust only Systems)

Case 1 - Exhaust Only				
Level	LF	HL _{bvent}	LVL Cond. HL	Multiplier
Level 1	0.5	1118	10805	0.05
Level 2	0.3		13060	0.03
Level 3	0.2		13484	0.02
Level 4	0		0	0.00

Case 1

Ventilation Heat Gain (Exhaust Only Systems)

Case 1 - Exhaust Only		Multiplier	
HG _{bvent}	944	0.07	
Building	14413		

Case 2

Ventilation Heat Loss (Direct Ducted Systems)

C	HL ^Δ T	(1-E) HRV	Multiplier
1.08	81.4	0.16	14.07

Case 2

Ventilation Heat Gain (Direct Ducted Systems)

C	HG ^Δ T	Multiplier
1.08	11	11.88

Case 3

Ventilation Heat Loss (Forced Air Systems)

HL _{bvent}		Multiplier
Total Ventilation Load	1118	0.03

Case 3

Ventilation Heat Gain (Forced Air Systems)

Vent Heat Gain		Multiplier
HG _{bvent}	HG*1.3	0.07
944	1	

Foundation Conductive Heatloss Level 1

1904 Watts 6497 Btu/h

Foundation Conductive Heatloss Level 2

Watts Btu/h


Envelope Air Leakage Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario ▼			
Region:	Bradford ▼			
Weather Station Location:	Open flat terrain, grass ▼			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest ▼			
Walls:	Heavy ▼			
Flue:	Heavy ▼			
Highest Ceiling Height (m):	6.70			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	911.96			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (ACH=3.57)			
Custom BDT Data:	ELA @ 10 Pa. ▼ 322.44 cm ²			
	3.57 ACH @ 50 Pa			
Mechanical Ventilation (L/s):	Total Supply:		Total Exhaust:	
	39.75		39.75	
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Heating Air Leakage Rate (ACH/H):		0.322		
Cooling Air Leakage Rate (ACH/H):		0.080		


Residential Foundation Thermal Load Calculator


Supplemental tool for CAN/CSA-F280

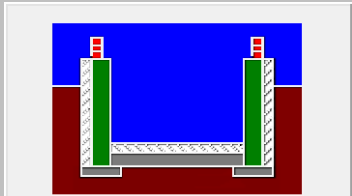
Weather Station Description		
Province:	Ontario	▼
Region:	Bradford	▼
Site Description		
Soil Conductivity:	High conductivity: moist soil	▼
Water Table:	Normal (7-10 m, 23-33 Ft)	▼
Foundation Dimensions		
Floor Length (m):	16.28	 Insulation Configuration
Floor Width (m):	4.60	
Exposed Perimeter (m):	33.22	
Wall Height (m):	2.74	
Depth Below Grade (m):	1.53	
Window Area (m ²):	0.56	
Door Area (m ²):	1.95	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		1483

Residential Slab on Grade Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

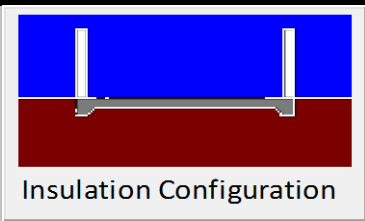Weather Station Description		
Province:	Ontario	▼
Region:	Bradford	▼
Site Description		
Soil Conductivity:	High conductivity: moist soil	▼
Water Table:	Normal (7-10 m, 23-33 Ft)	▼
Floor Dimensions		
Length (m):	10.77	 Insulation Configuration
Width (m):	2.64	
Exposed Perimeter (m):	18.29	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		287

	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A. R.A. T \$ F PE	SUPPLY AIR RETURN AIR THERMOSTAT PRINCIPAL EXHAUST FAN SWITCH W/R & PRINCIPAL EXHAUST FAN
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE RETURN AIR FROM BASEMENT SECOND FLOOR		
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER VOLUME DAMPER		RETURN ROUND DUCT				

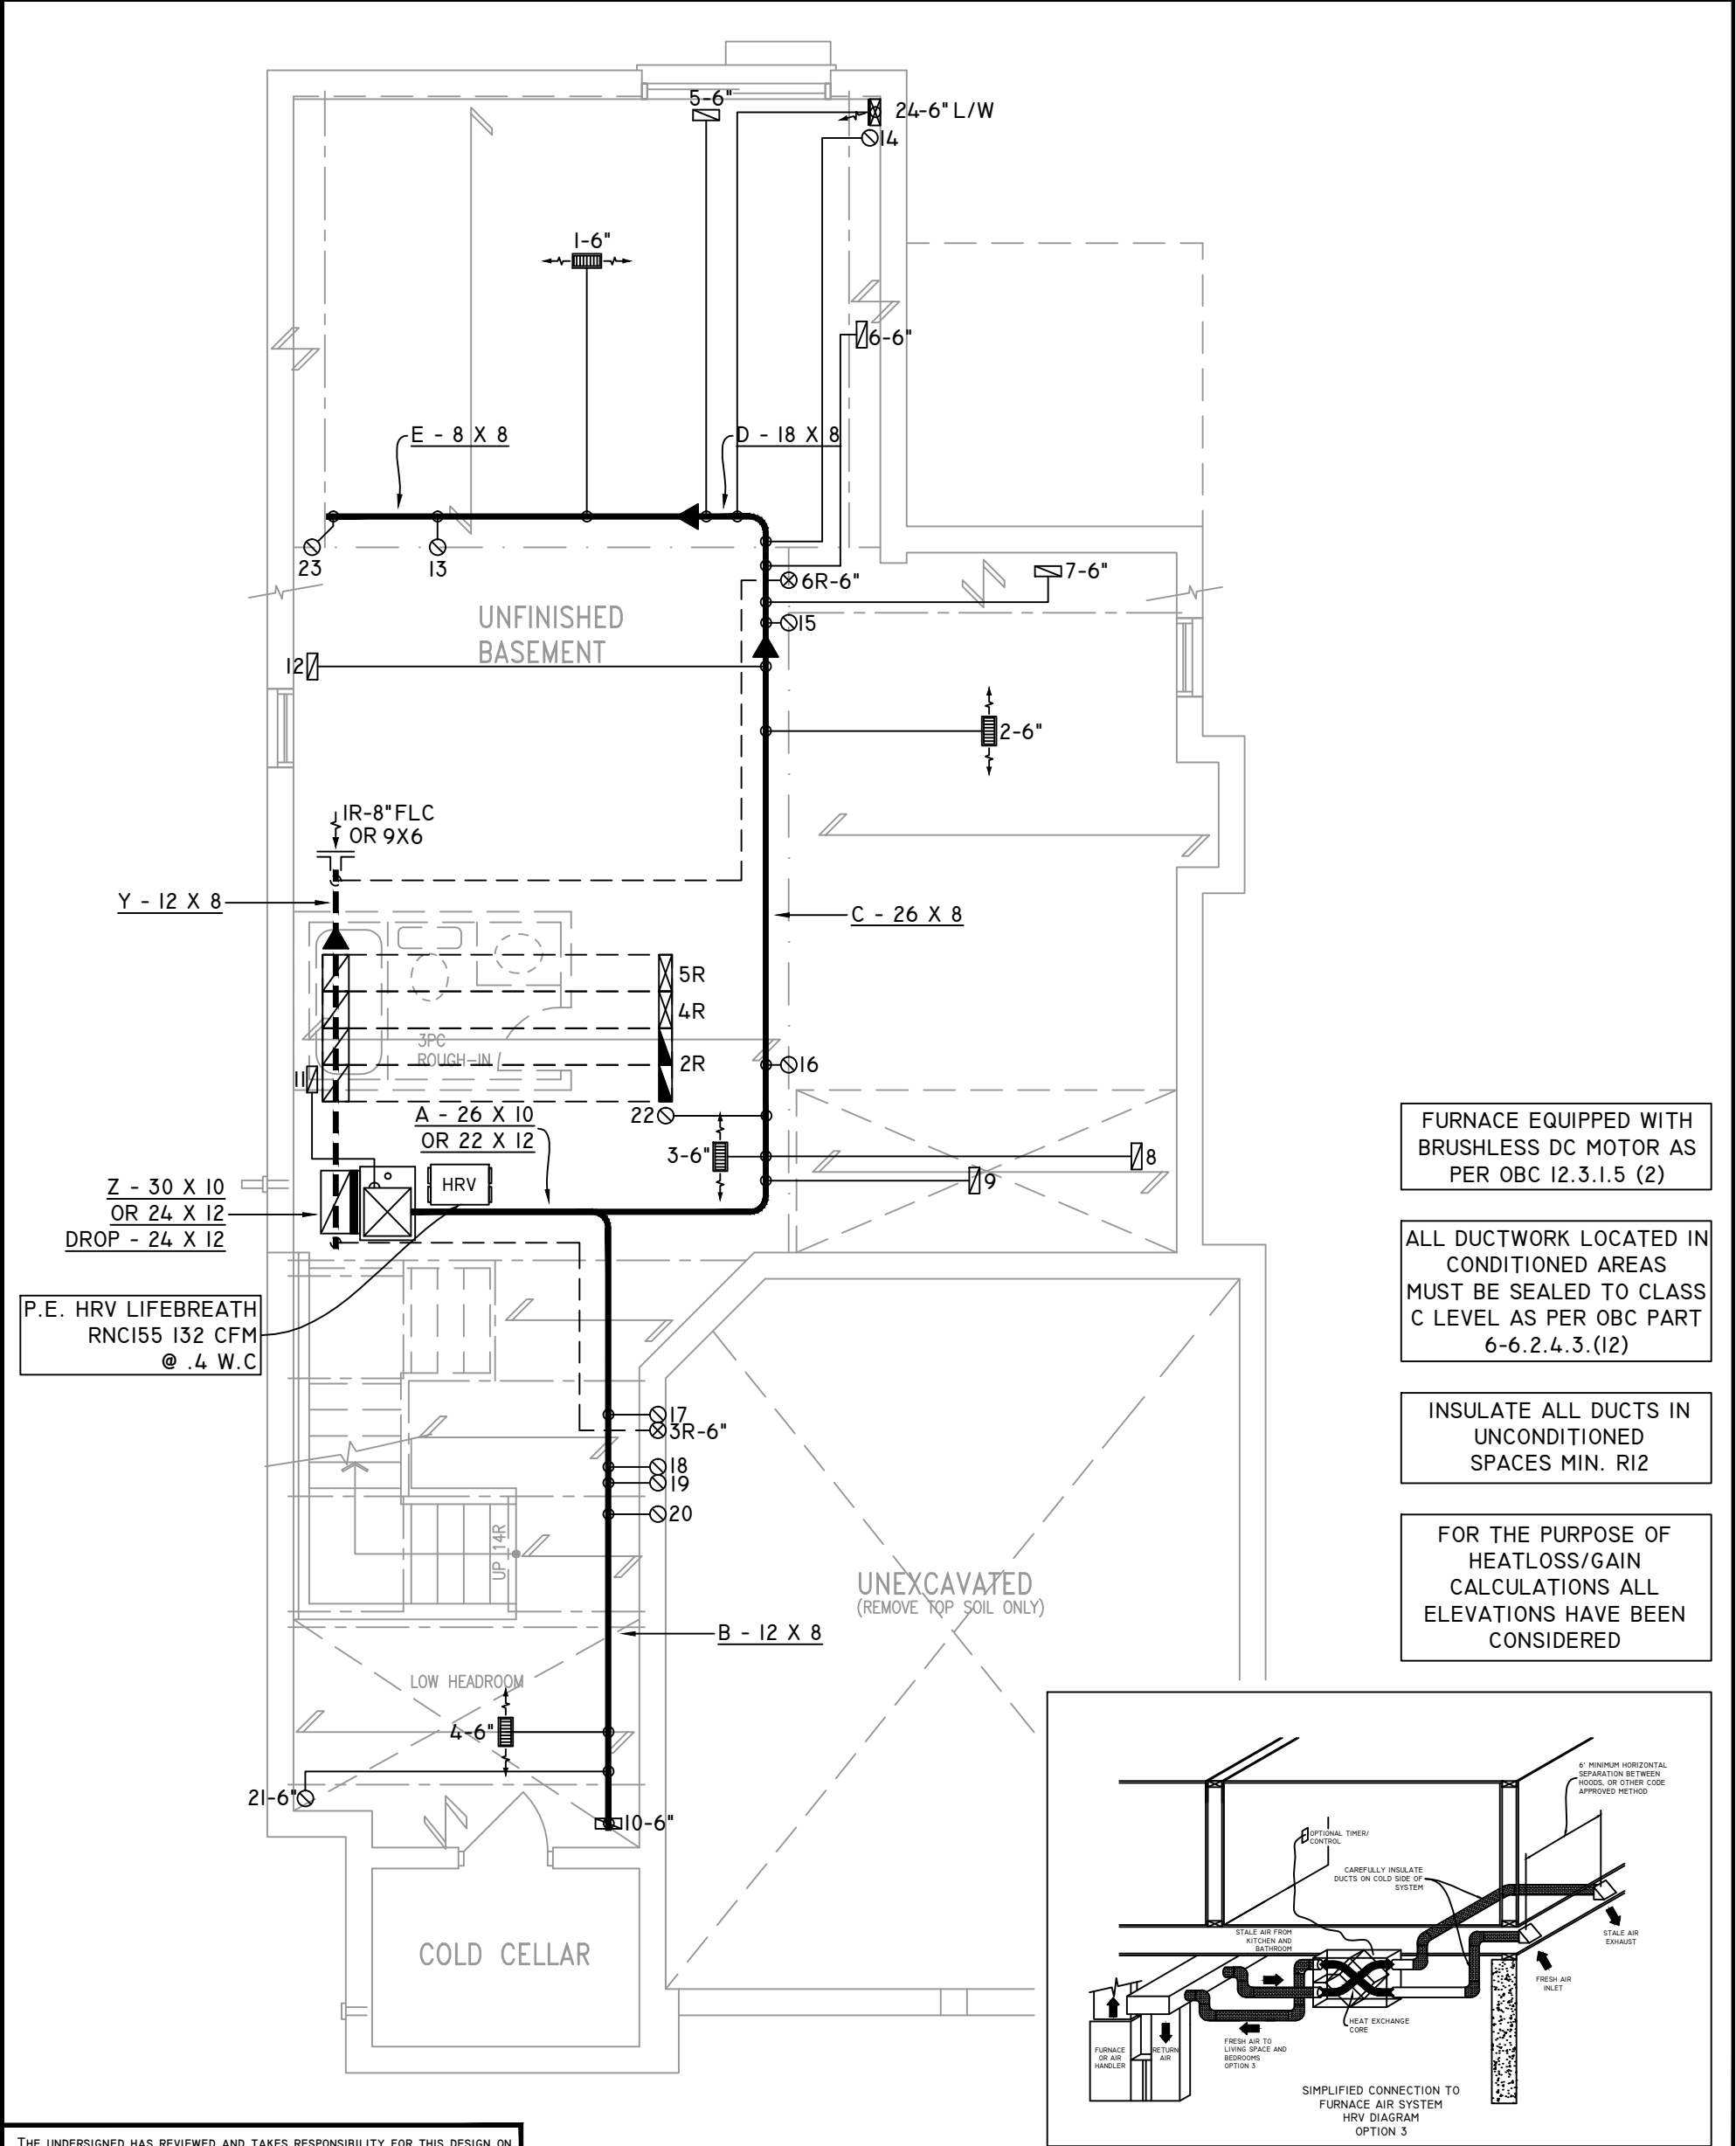


FURNACE EQUIPPED WITH
BRUSHLESS DC MOTOR AS
PER OBC 12.3.1.5 (2)

ALL DUCTWORK LOCATED IN
CONDITIONED AREAS
MUST BE SEALED TO CLASS
C LEVEL AS PER OBC PART
6-6.2.4.3.(12)

INSULATE ALL DUCTS IN
UNCONDITIONED
SPACES MIN. R12

FOR THE PURPOSE OF
HEATLOSS/GAIN
CALCULATIONS ALL
ELEVATIONS HAVE BEEN
CONSIDERED

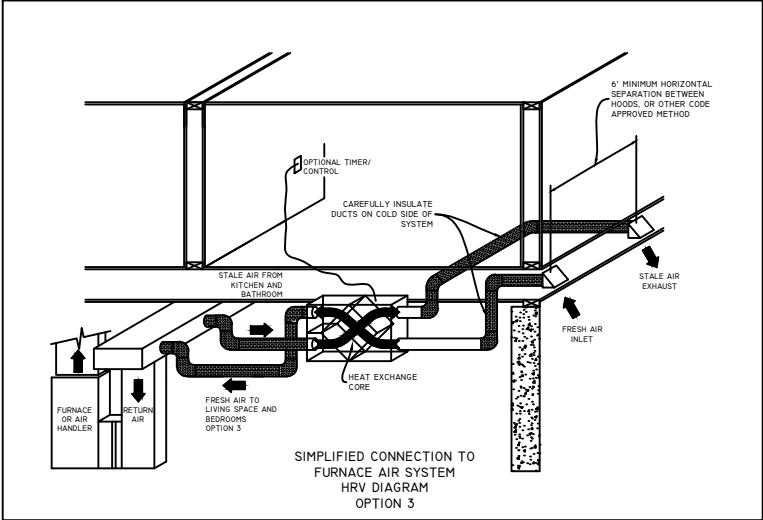

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER

QUALIFICATION INFORMATION

REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE ONTARIO BUILDING CODE

DAVID DA COSTA  B.C.I.N. 32964

SIGNATURE OF DESIGNER

BASEMENT PLAN 'A' –
W.O.B. CONDITION

OBC 2012

ZONE I COMPLIANCE
PACKAGE "A1" REF. TABLE 3.1.1.2.A

NOTES

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.

ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.

PROVIDE BALANCING DAMPERS ON ALL BRANCHES.

ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)

INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.

CONTRACTOR MUST WORK FROM APPROVED PLANS.

ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.

GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.



2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA

HEAT-LOSS	54,176	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960603BNA	OR EQUAL.
UNIT HEATING INPUT	60,000	BTU/HR.
UNIT HEATING OUTPUT	57,600	BTU/HR.
A/C COOLING CAPACITY	2.5	TONS.
FAN SPEED	1170	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	11	4	3
1ST FLOOR	8	1	2
BASEMENT	5	1	

FLOOR PLAN:		BASEMENT	
DRAWN BY:	CHECKED:	SQFT	
AP	DD	2780	
LAYOUT NO.	DRAWING NO.		
JB-04522	MI		

DATE:	MARCH 12, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	S38-5 WOB BAROSSA 5
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"

KITCHEN EXHAUST
100 CFM MIN. 6"

CIRCULATION PRINCIPAL
FAN SWITCH
TO BE CENTRALLY
LOCATED

ALL DUCTWORK LOCATED IN
CONDITIONED AREAS
MUST BE SEALED TO CLASS
C LEVEL AS PER OBC PART
6-6.2.4.3.(12)

INSULATE ALL DUCTS IN
UNCONDITIONED
SPACES MIN. R12

FOR THE PURPOSE OF
HEATLOSS/GAIN
CALCULATIONS ALL
ELEVATIONS HAVE BEEN
CONSIDERED

Rooms and areas shown include: KITCHEN, DECK, GREAT ROOM, LIVING/DINING, MUD, PWD, GARAGE, SUNKEN FOYER, PORCH, PANTRY, F, S, DW, OPT. COFFERED CEILING, OPT. WAFFLE CEILING, RAILING, OTA, UP 16R, DN 14R, DN 1R, DN IF REQ'D, 5R, 4R, 2R LW 30X8, 13, 14, 12, 23, 22, 15, 8, 16, 17, 18, 19, 20, 21, 22, 23, 5-6", 6-6", 7-6", 10-6", 21-6", 3R-6", 6R-6".

DAVID DA COSTA  B.C.I.N. 32964
SIGNATURE OF DESIGNER

OBC 2012

ZONE I COMPLIANCE
PACKAGE "AI" REF. TABLE 3.1.1.2.A

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO
BUILDING CODE.
ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE
SPECIFIED.
PROVIDE BALANCING DAMPERS ON ALL BRANCHES.
ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)
INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT
ALL DOORS 1" MIN.
CONTRACTOR MUST WORK FROM APPROVED PLANS.
ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE
RESPONSIBILITY OF GTA DESIGNS.
GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST
FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR
WITH IN THE DWELLING.

 **GTADESIGNS**

2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.


L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA


HEAT-LOSS	54,176	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960603BNA	OR EQUAL.
UNIT HEATING INPUT	60,000	BTU/HR.
UNIT HEATING OUTPUT	57,600	BTU/HR.
A/C COOLING CAPACITY	2.5	TONS.
FAN SPEED	1170	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	11	4	3
1ST FLOOR	8	1	2
BASEMENT	5	1	


FLOOR PLAN:		
GROUND FLOOR		
DRAWN BY: AP	CHECKED: DD	SQFT 2780
LAYOUT NO. JB-04522	DRAWING NO. M2	

DATE:	MARCH 12, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	S38-5 WOB BAROSSA 5
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"

	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER						PRINCIPAL EXHAUST FAN SWITCH
									W/R & PRINCIPAL EXHAUST FAN

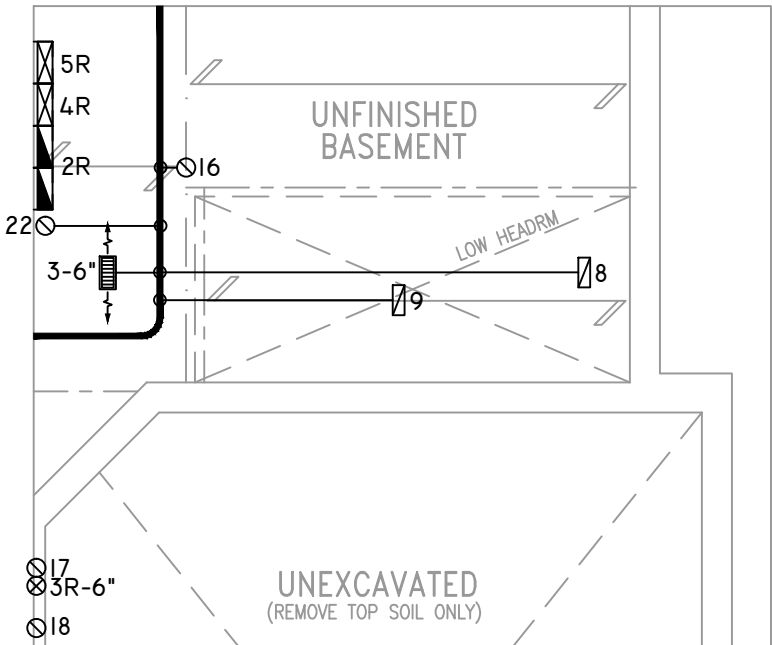

PART BSMT PLAN
MUDROOM & PWD SUNKEN 1R

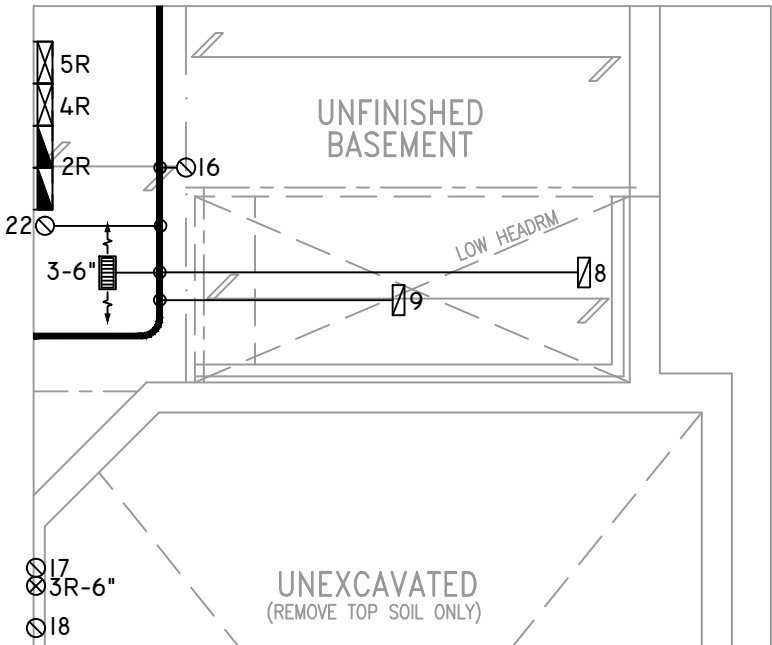

PART BSMT PLAN
MUDROOM & PWD SUNKEN 2-3R

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER

QUALIFICATION INFORMATION

REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE ONTARIO BUILDING CODE

DAVID DA COSTA  B.C.I.N. 32964
SIGNATURE OF DESIGNER

OBC 2012

ZONE I COMPLIANCE
PACKAGE "A1" REF. TABLE 3.1.1.2.A

NOTES

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.

ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.

PROVIDE BALANCING DAMPERS ON ALL BRANCHES.

ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)

INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.

CONTRACTOR MUST WORK FROM APPROVED PLANS.

ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.

GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.




2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA


HEAT-LOSS	54,176	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960603BNA	OR EQUAL.
UNIT HEATING INPUT	60,000	BTU/HR.
UNIT HEATING OUTPUT	57,600	BTU/HR.
A/C COOLING CAPACITY	2.5	TONS.
FAN SPEED	1170	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	11	4	3
1ST FLOOR	8	1	2
BASEMENT	5	1	


FLOOR PLAN: PARTIAL PLAN(S)		
DRAWN BY: AP	CHECKED: DD	SQFT 2780
LAYOUT NO. JB-04522	DRAWING NO. M4	

DATE: MARCH 12, 2018
CLIENT: BAYVIEW WELLINGTON
MODEL: S38-5 WOB BAROSSA 5
PROJECT: GREEN VALLEY EAST BRADFORD,ONT.
SCALE: 3/16" = 1'-0"


	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER						PRINCIPAL EXHAUST FAN SWITCH
									W/R & PRINCIPAL EXHAUST FAN

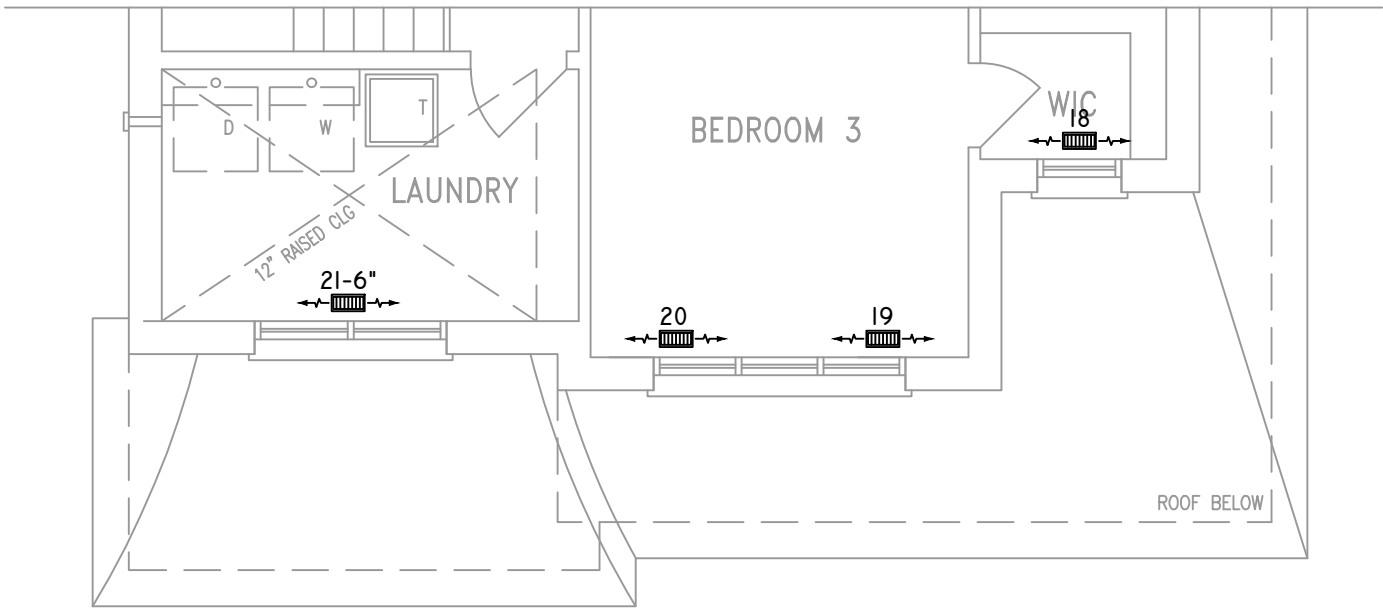

PART. SECOND FLOOR PLAN 'B'

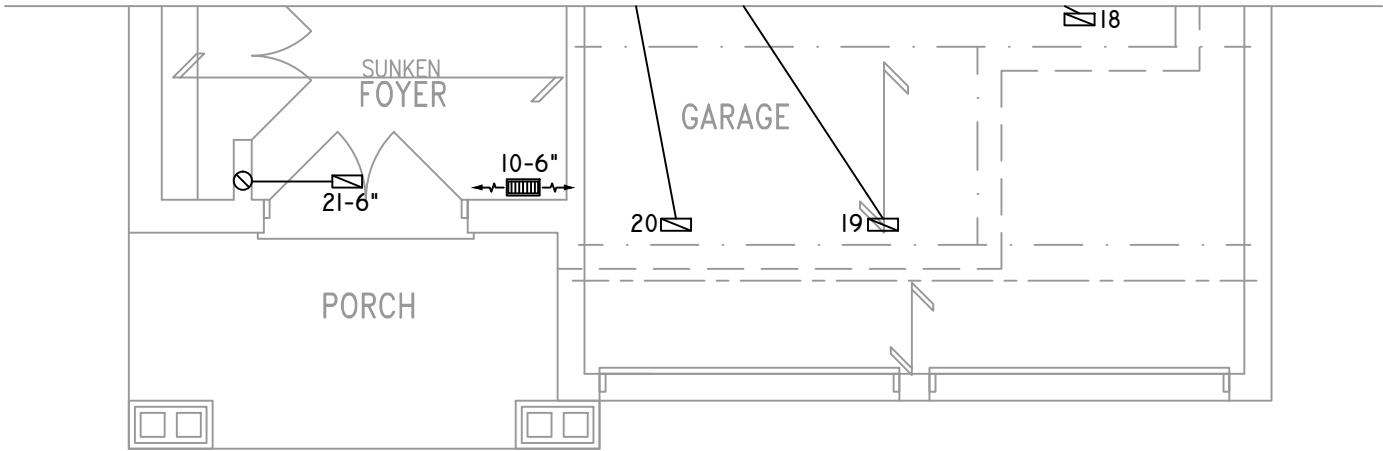

PART. GROUND FLOOR PLAN 'B'

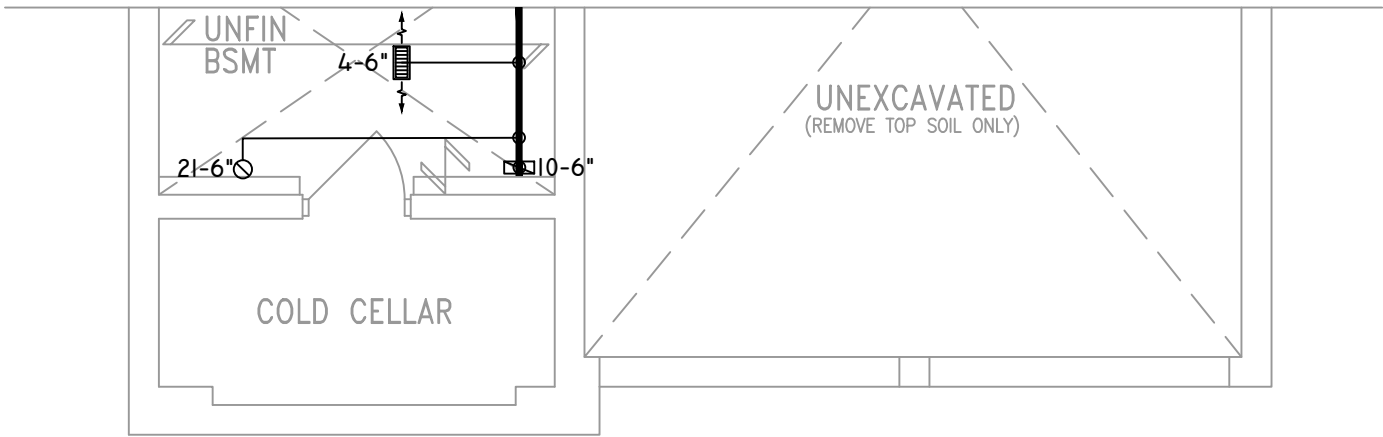

PART. BASEMENT PLAN 'B'

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER

QUALIFICATION INFORMATION

REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE ONTARIO BUILDING CODE

DAVID DA COSTA



B.C.I.N. 32964

SIGNATURE OF DESIGNER

OBC 2012

ZONE I COMPLIANCE
PACKAGE "AI" REF. TABLE 3.1.1.2.A

NOTES
INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.
ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.
PROVIDE BALANCING DAMPERS ON ALL BRANCHES.
ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)
INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.
CONTRACTOR MUST WORK FROM APPROVED PLANS.
ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.
GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.




2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA


HEAT-LOSS	54,176	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960603BNA	OR EQUAL.
UNIT HEATING INPUT	60,000	BTU/HR.
UNIT HEATING OUTPUT	57,600	BTU/HR.
A/C COOLING CAPACITY	2.5	TONS.
FAN SPEED	1170	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	11	4	3
1ST FLOOR	8	1	2
BASEMENT	5	1	


FLOOR PLAN:	
PARTIAL PLAN(S)	
DRAWN BY: AP	CHECKED: DD
LAYOUT NO. JB-04522	SQFT 2780
DRAWING NO. M5	

DATE:	MARCH 12, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	S38-5 WOB BAROSSA 5
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"


	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER						PRINCIPAL EXHAUST FAN SWITCH
									W/R & PRINCIPAL EXHAUST FAN

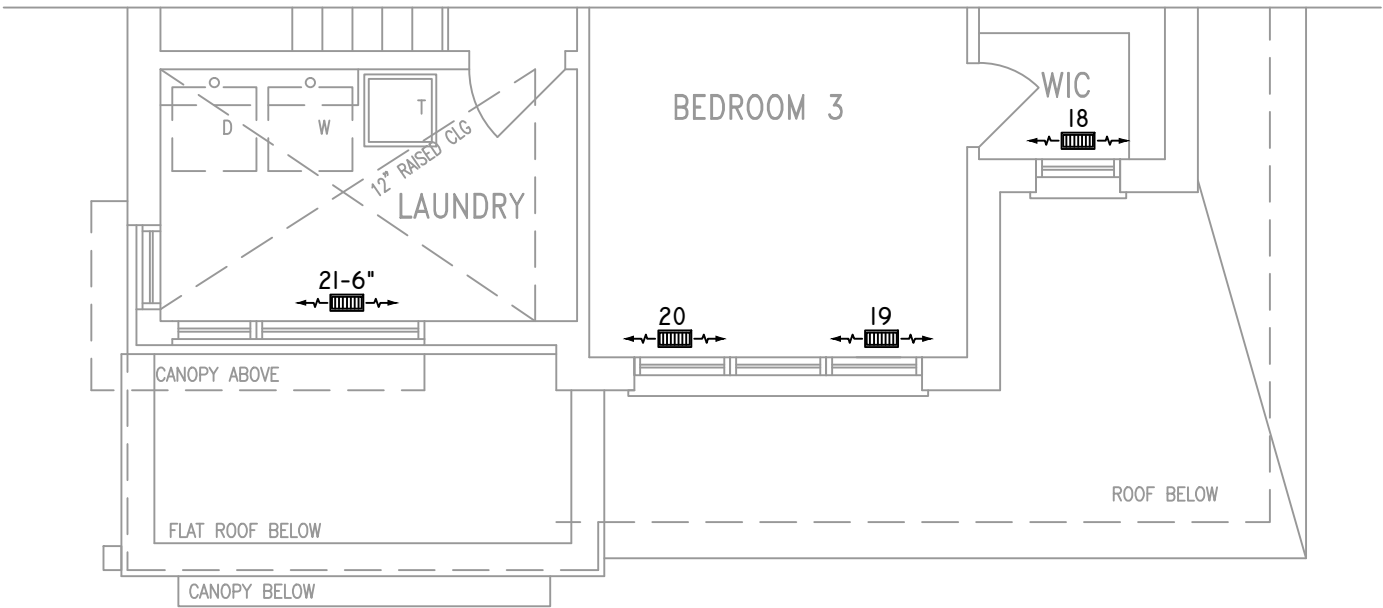

PART. SECOND FLOOR PLAN 'C'

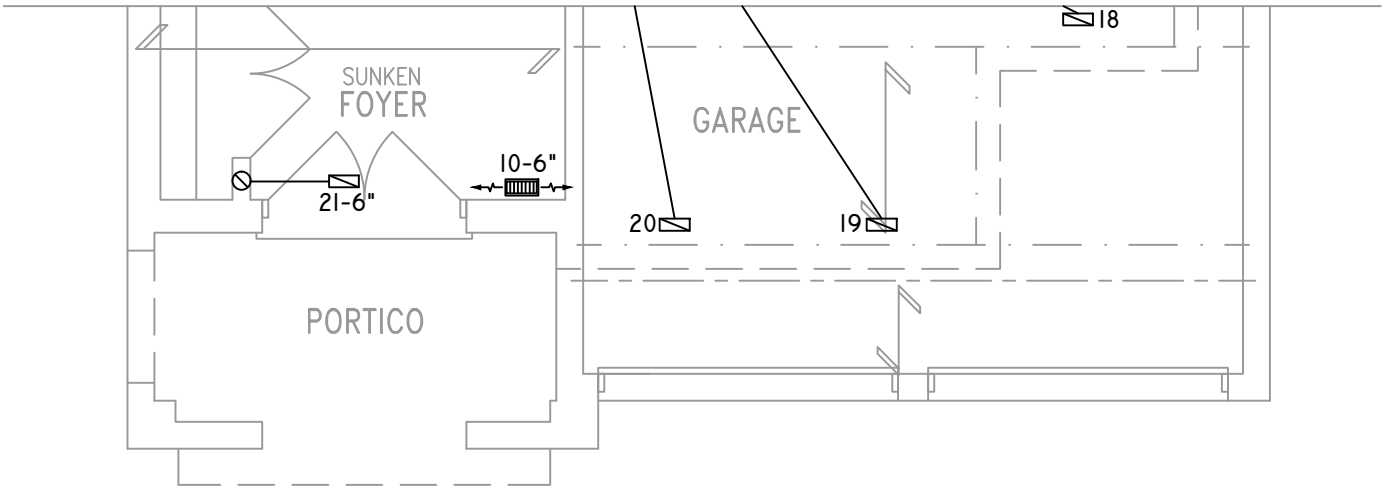

PART. GROUND FLOOR PLAN 'C'

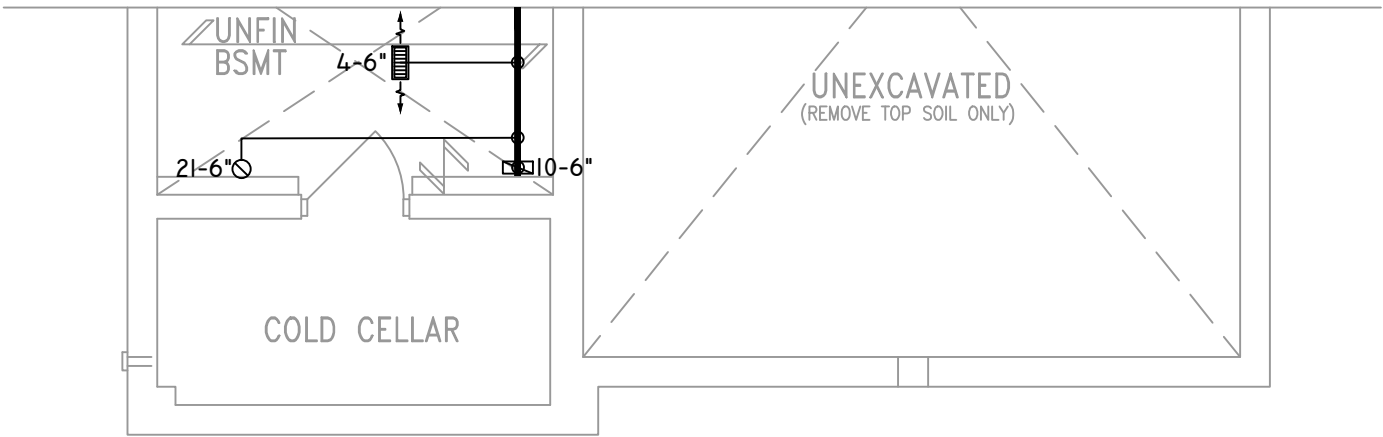

PART. BASEMENT PLAN 'C'

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER

QUALIFICATION INFORMATION

REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE ONTARIO BUILDING CODE

DAVID DA COSTA



B.C.I.N. 32964

SIGNATURE OF DESIGNER

OBC 2012

ZONE I COMPLIANCE
PACKAGE "A1" REF. TABLE 3.1.1.2.A

NOTES
INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.
ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.
PROVIDE BALANCING DAMPERS ON ALL BRANCHES.
ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)
INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.
CONTRACTOR MUST WORK FROM APPROVED PLANS.
ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.
GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.




2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADISIGNS.CA
WEB: WWW.GTADISIGNS.CA


HEAT-LOSS	54,176	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960603BNA	OR EQUAL.
UNIT HEATING INPUT	60,000	BTU/HR.
UNIT HEATING OUTPUT	57,600	BTU/HR.
A/C COOLING CAPACITY	2.5	TONS.
FAN SPEED	1170	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	11	4	3
1ST FLOOR	8	1	2
BASEMENT	5	1	


FLOOR PLAN:	
PARTIAL PLAN(S)	
DRAWN BY: AP	CHECKED: DD
LAYOUT NO. JB-04522	SQFT 2780
DRAWING NO. M6	

DATE:	MARCH 12, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	S38-5 WOB BAROSSA 5
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"

	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER						PRINCIPAL EXHAUST FAN SWITCH
									W/R & PRINCIPAL EXHAUST FAN

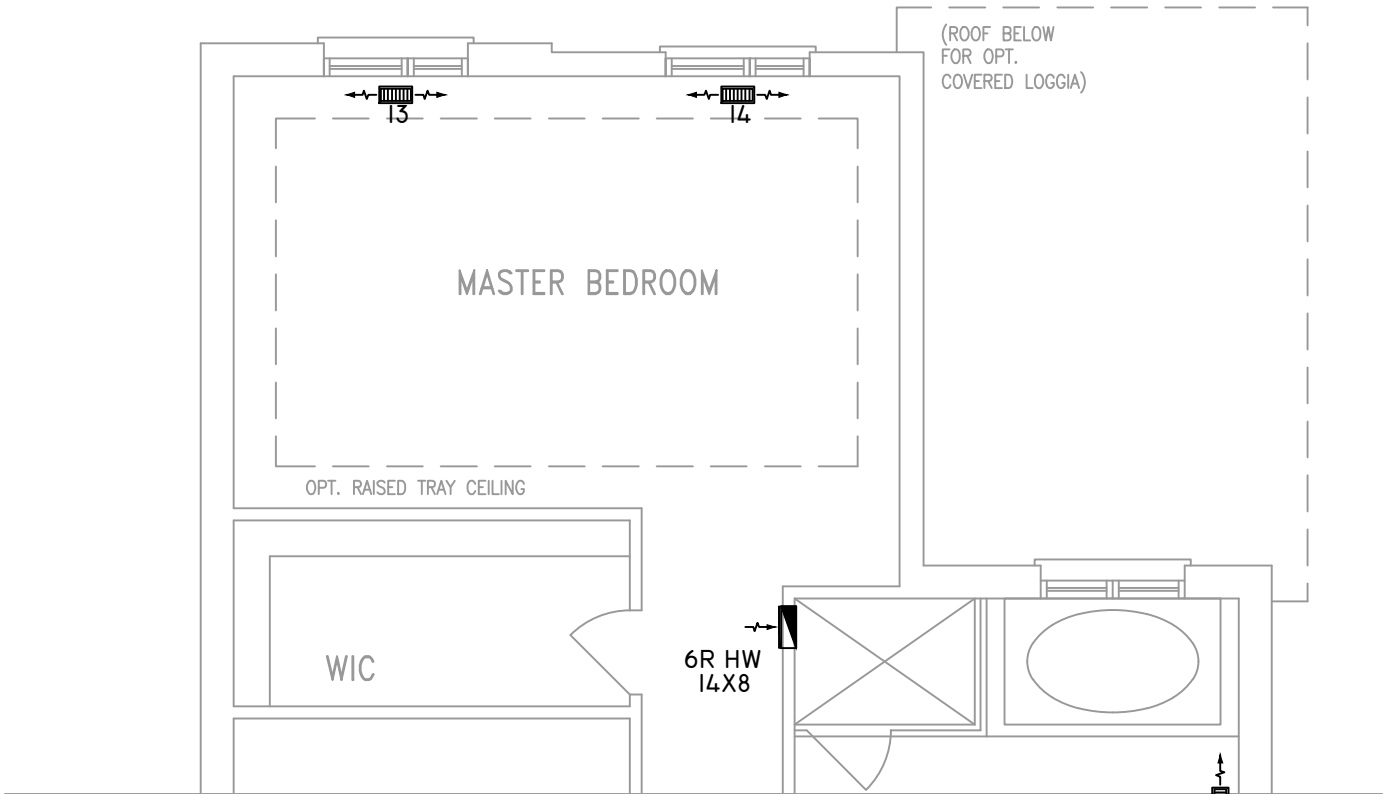

PART SECOND FLOOR PLAN 'C'
REAR UPGRADE

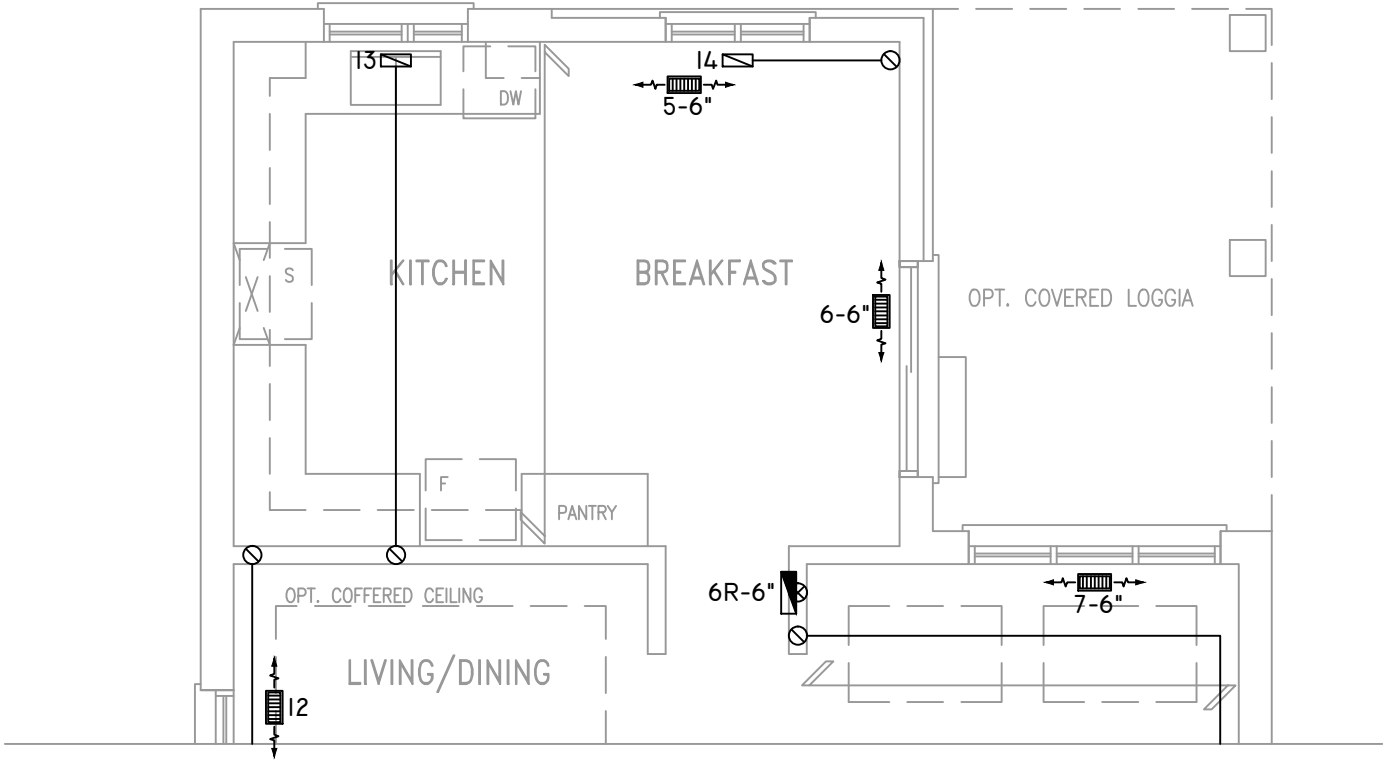

PART GRND FLOOR PLAN 'C'
REAR UPGRADE

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER

QUALIFICATION INFORMATION

REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE ONTARIO BUILDING CODE

DAVID DA COSTA



B.C.I.N. 32964

SIGNATURE OF DESIGNER

OBC 2012

ZONE I COMPLIANCE
PACKAGE "A1" REF. TABLE 3.1.1.2.A

NOTES
INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.
ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.
PROVIDE BALANCING DAMPERS ON ALL BRANCHES.
ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)
INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.
CONTRACTOR MUST WORK FROM APPROVED PLANS.
ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.
GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.



2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA

HEAT-LOSS	54,176	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960603BNA	OR EQUAL.
UNIT HEATING INPUT	60,000	BTU/HR.
UNIT HEATING OUTPUT	57,600	BTU/HR.
A/C COOLING CAPACITY	2.5	TONS.
FAN SPEED	1170	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	11	4	3
1ST FLOOR	8	1	2
BASEMENT	5	1	

FLOOR PLAN:	
PARTIAL PLAN(S)	
DRAWN BY: AP	CHECKED: DD
LAYOUT NO. JB-04522	SQFT 2780
DRAWING NO. M7	

DATE:	MARCH 12, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	S38-5 WOB BAROSSA 5
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"