

ASPHALT SHINGLES
12" FINISHED OH.
R.T.M.C.
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

DENOTES:

ALL B -2-2X10 FLUSH

* - ALL FIRST FLOOR
PLATE HEIGHT 7'-10"-0
U/S @ PLATE LEVEL

C -5/12 CATH. CEILING

H -12" RAISED CEILING


-12" HIGHER FASCIA ONLY

HARDWARE:

LUS26-2 -(X)
HGUS26-2 -(XX)
LJS26DS -(V)
LUS24 -(O)

T-180690

DENOTES:
CONVENTIONAL
FRAMING



TH-6E
EL:A UNIT5
401351

TH-3
EL:A UNIT6
401352


TH-3
EL:A(REV) UNIT7
401353

TH-3
EL:A UNIT8
401354

TH-3
EL:A(REV) UNIT9
401355

TH-6E
EL:A (REV)UNIT10
401356

10/12 PITCHES (TYP.)
UNLESS NOTED

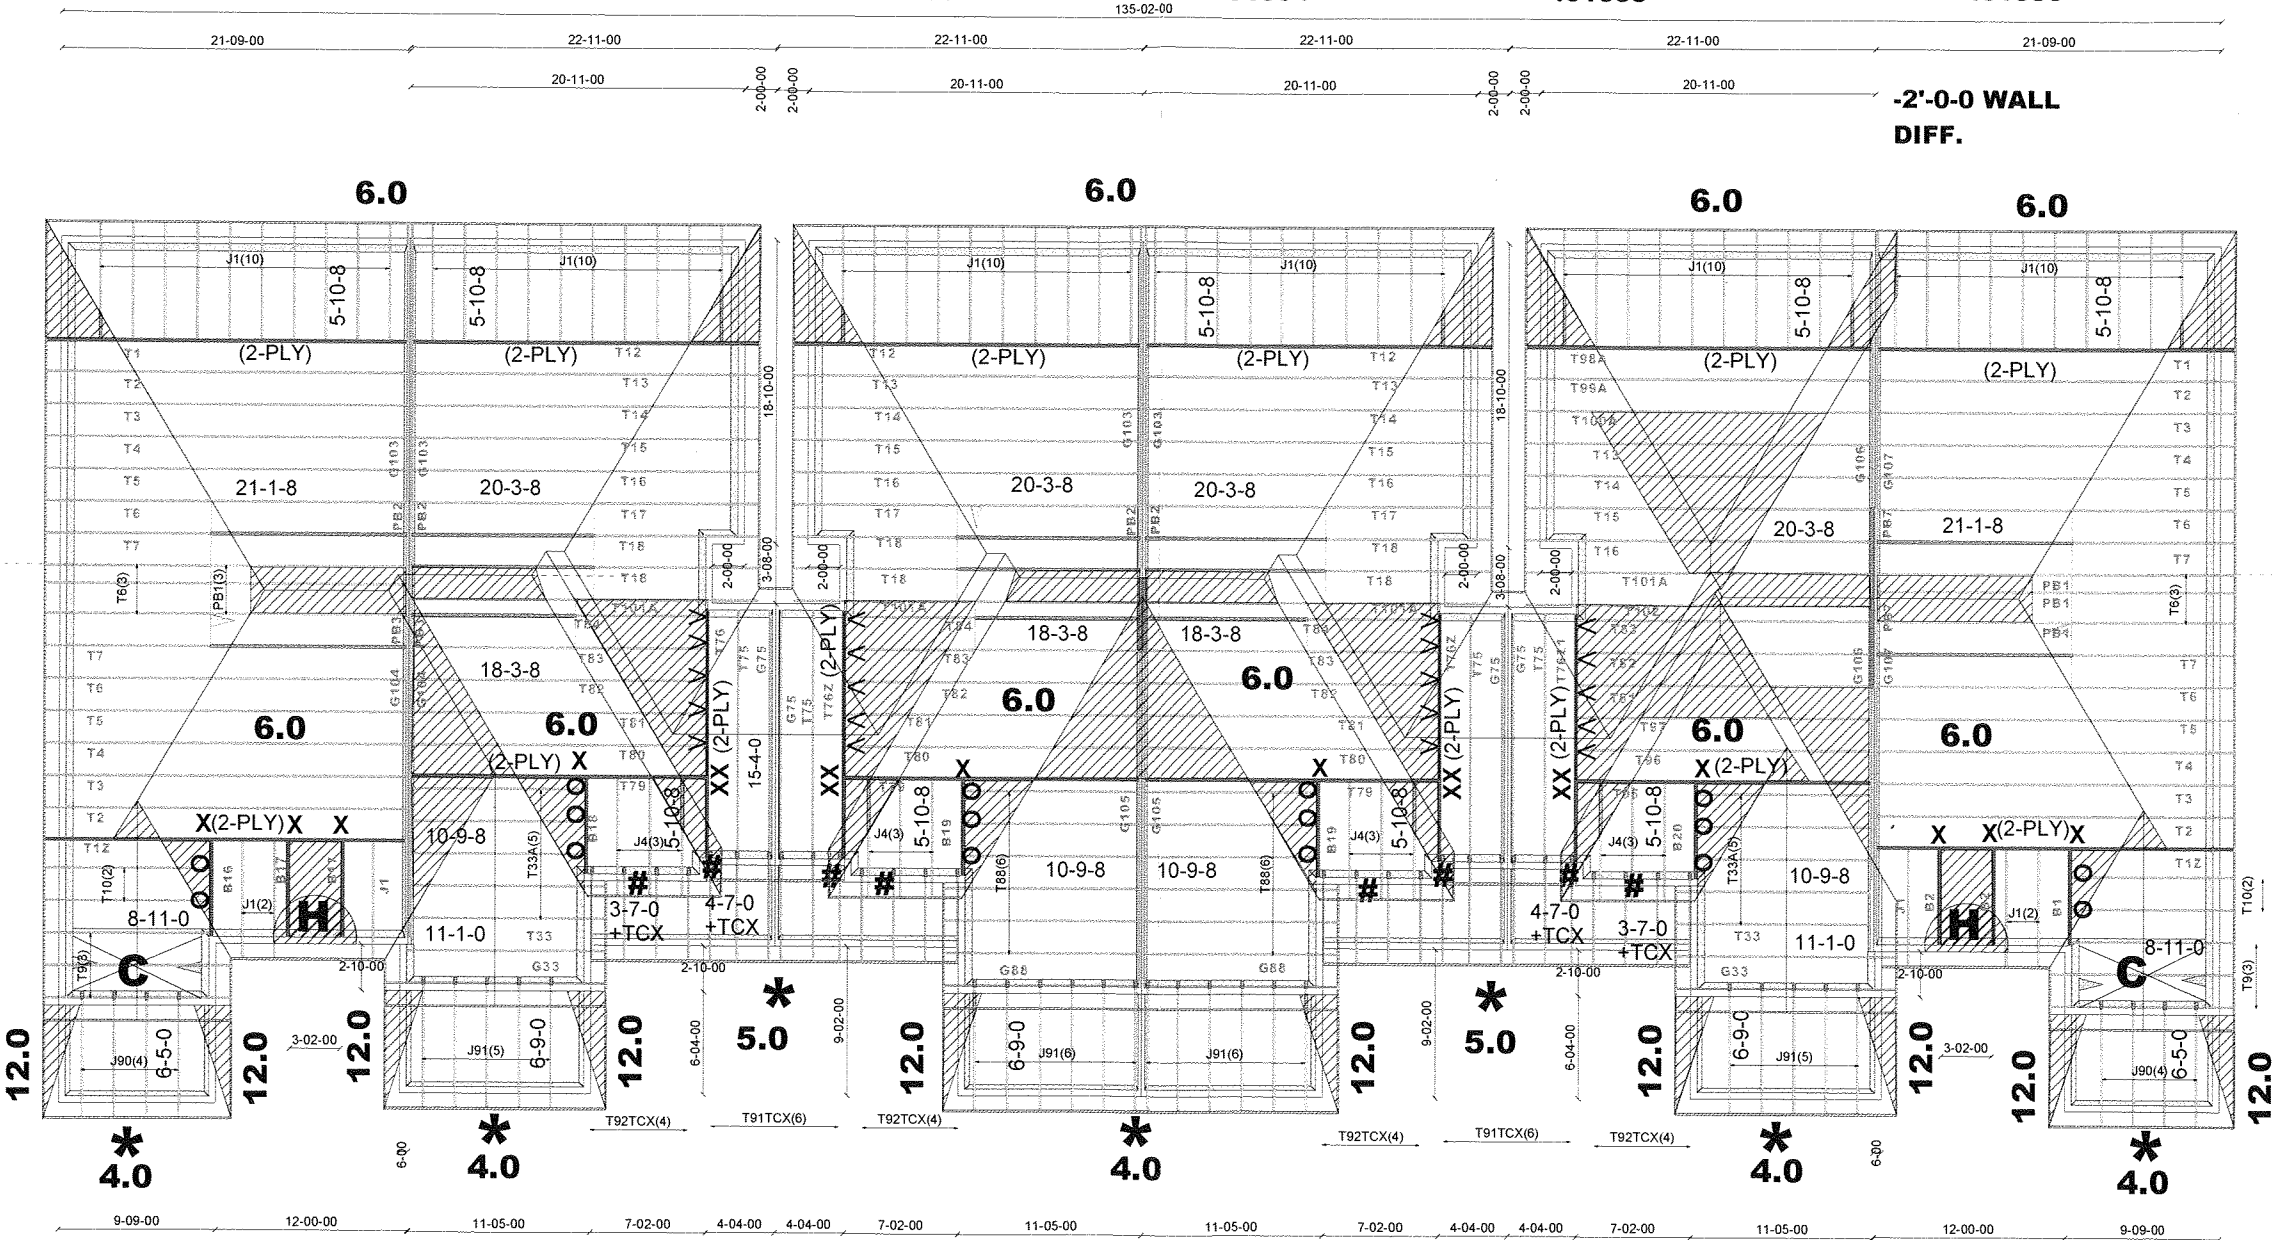

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART9 OF THE OBC LATEST EDITION
ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4"SPF@24"o.c.
WITH A 2"x4"SPF VERTICAL POST TO THE TRUSS UNDER AT EACH CROSS POINT.
POSTS LONGER THAN 6' TO BE Laterally BRACED SO THAT THE DISTANCE
BETWEEN END POINTS AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

DESIGN LOADS:

SNOW LOAD 21.0 psf
TC DEAD 6 psf
BC LIVE 10.5 psf
BC DEAD 7 psf



Job Track: 50264
Plan Log: 200499
Layout ID: 401350

Builder / Location:
BAYVIEW WELLINGTON / ST CATHERINES
Project: **PASSAGE ON THE CANAL**
Date: 2/11/2019 Sales: Mario DiCano Designer: AC

Model / Elevation:
FREEHOLD BLOCK 2 / UNITS 5 - 10

Mitek ver 8.2.3.229

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR
REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY
TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 6

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401352
 Ref #
 Page: 1 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T12 Half Hip Girder	10 /12	20-03-08	4-01-04	2 x 4	1-03-08	1-07-11 4-01-04	172.46 111.00		
	1	T13 Half Hip	10 /12	20-03-08	5-01-04	2 x 4	1-03-08	1-07-11 5-01-04	87.39 55.83		
	1	T14 Half Hip	10 /12	20-03-08	6-01-04	2 x 4	1-03-08	1-07-11 6-01-04	85.89 55.00		
	1	T15 Half Hip	10 /12	20-03-08	7-01-04	2 x 4	1-03-08	1-07-11 7-01-04	93.1 59.33		
	1	T16 Half Hip	10 /12	20-03-08	8-01-04	2 x 4	1-03-08	1-07-11 8-01-04	98.11 62.67		
	1	T17 Half Hip	10 /12	20-03-08	9-01-04	2 x 4	1-03-08	1-07-11 9-01-04	112.23 72.17		
	2	T18 Half Hip	10 /12	20-03-08	10-01-04	2 x 4	1-03-08	1-07-11 10-01-04	236.5 149.67		
	1	T33 Common	10 /12	11-01-00	6-03-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	49.4 33.67		
	5	T33A Common	10 /12	10-09-08	6-03-02	2 x 4	1-03-08	1-07-11 1-10-10	234.11 155.00		
	1	G33 GABLE	10 /12	11-01-00	6-03-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	53.85 37.67		
	1	T75 Common	6 /12	15-04-00	5-00-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	60.25 39.17		
	1	G75 GABLE	6 /12	15-04-00	5-00-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	57.71 38.17		
	1 2-ply	T76 Common Girder	6 /12	15-04-00	5-00-00	2 x 4 2 x 6		1-02-00 1-02-00	139.32 86.00		
	1 2-ply	T79 Half Hip Girder	10 /12	18-03-08	5-01-04	2 x 4 2 x 6		2-04-06 5-01-04	182.37 114.33		

DELIVERY SHIPLIST

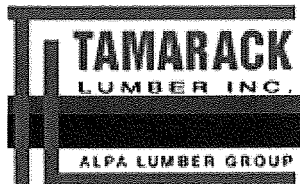


Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 6

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401352
 Ref #
 Page: 2 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T80 Half Hip	10 /12	18-03-08	6-01-04	2 x 4		2-04-06 6-01-04	78.75 49.50		
	1	T81 Half Hip	10 /12	18-03-08	7-01-04	2 x 4		2-04-06 7-01-04	83.26 51.67		
	1	T82 Half Hip	10 /12	18-03-08	8-01-04	2 x 4		2-04-06 8-01-04	91.64 58.67		
	1	T83 Half Hip	10 /12	18-03-08	9-01-04	2 x 4		2-04-06 9-01-04	99.46 62.67		
	1	T84 Half Hip	10 /12	18-03-08	10-01-04	2 x 4		2-04-06 10-01-04	111.91 69.50		
	3	T91TCX Monopitch	5 /12	4-07-00	3-03-04	2 x 4	1-03-08	1-00-09 3-03-05	65.78 45.50		
	4	T92TCX Monopitch	5 /12	3-07-00	2-10-04	2 x 4	1-03-08	1-00-09 2-10-05	73.09 50.67		
	1	T101A Half Hip	10 /12	18-03-08	9-01-10	2 x 6 2 x 4	3-03-08	3-03-11 9-01-04	113.9 69.67		
	1	G103 GABLE	6 /12	20-05-00	9-01-04	2 x 4	1-03-08	1-02-00 9-01-04	109.26 69.67		
	1	G104 GABLE	6 /12	22-05-00	9-01-04	2 x 4		1-02-00 9-01-04	119.12 74.83		
	1	PB2 Piggyback	6 /12	4-06-08	2-03-04	2 x 4		2-03-04	11.64 8.00		
	1	PB3 Piggyback	6 /12	6-06-08	1-06-06	2 x 4		1-06-06	18.38 12.50		
	10	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.94 106.67		
	3	J4 Jack-Open	6 /12	5-10-08	5-01-04	2 x 4	1-03-08	2-02-00 5-01-04	53.8 34.00		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 6

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401352
 Ref #
 Page: 3 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	5	J91 Jack-Open	4 /12	6-09-00	3-02-03	2 x 4	1-03-08	11-03 3-02-03	89.82 56.67		

TOTAL # TRUSS= 57

TOTAL BFT OF ALL TRUSSES= 1889.87 BFT. TOTAL WEIGHT OF ALL TRSSES 2950.46 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	LJS26DS	
3	Hardware	LUS24	
1	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 10

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 7

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401353
 Ref #
 Page: 1 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T12 Half Hip Girder	10 /12	20-03-08	4-01-04	2 x 4	1-03-08	1-07-11 4-01-04	172.46 111.00		
	1	T13 Half Hip	10 /12	20-03-08	5-01-04	2 x 4	1-03-08	1-07-11 5-01-04	87.39 55.83		
	1	T14 Half Hip	10 /12	20-03-08	6-01-04	2 x 4	1-03-08	1-07-11 6-01-04	85.89 55.00		
	1	T15 Half Hip	10 /12	20-03-08	7-01-04	2 x 4	1-03-08	1-07-11 7-01-04	93.1 59.33		
	1	T16 Half Hip	10 /12	20-03-08	8-01-04	2 x 4	1-03-08	1-07-11 8-01-04	98.11 62.67		
	1	T17 Half Hip	10 /12	20-03-08	9-01-04	2 x 4	1-03-08	1-07-11 9-01-04	112.23 72.17		
	2	T18 Half Hip	10 /12	20-03-08	10-01-04	2 x 4	1-03-08	1-07-11 10-01-04	236.5 149.67		
	1	T75 Common	6 /12	15-04-00	5-00-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	60.25 39.17		
	1	G75 GABLE	6 /12	15-04-00	5-00-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	57.71 38.17		
	1 2-ply	T76Z Common Girder	6 /12	15-04-00	5-00-00	2 x 4 2 x 6		1-02-00 1-02-00	139.32 86.00		
	1 2-ply	T79 Half Hip Girder	10 /12	18-03-08	5-01-04	2 x 4 2 x 6		2-04-06 5-01-04	182.37 114.33		
	1	T80 Half Hip	10 /12	18-03-08	6-01-04	2 x 4		2-04-06 6-01-04	78.75 49.50		
	1	T81 Half Hip	10 /12	18-03-08	7-01-04	2 x 4		2-04-06 7-01-04	83.26 51.67		
	1	T82 Half Hip	10 /12	18-03-08	8-01-04	2 x 4		2-04-06 8-01-04	91.64 58.67		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 7

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401353
 Ref #
 Page: 2 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T83 Half Hip	10 /12	18-03-08	9-01-04	2 x 4		2-04-06 9-01-04	99.46 62.67		
	1	T84 Half Hip	10 /12	18-03-08	10-01-04	2 x 4		2-04-06 10-01-04	111.91 69.50		
	6	T88 Monopitch	10 /12	10-09-08	10-07-10	2 x 4		1-07-11 10-07-10	336.85 216.00		
	1	G88 GABLE	10 /12	10-09-08	10-07-10	2 x 4	1-03-08	1-07-11 10-07-10	65.63 41.50		
	3	T91TCX Monopitch	5 /12	4-07-00	3-03-04	2 x 4	1-03-08	1-00-09 3-03-05	65.78 45.50		
	4	T92TCX Monopitch	5 /12	3-07-00	2-10-04	2 x 4	1-03-08	1-00-09 2-10-05	73.09 50.67		
	1	T101A Half Hip	10 /12	18-03-08	9-01-10	2 x 6 2 x 4	3-03-08	3-03-11 9-01-04	113.9 69.67		
	1	G103 GABLE	6 /12	20-05-00	9-01-04	2 x 4	1-03-08	1-02-00 9-01-04	109.26 69.67		
	1	G105 GABLE	0 /12	25-03-00	10-07-10	2 x 4		10-07-10 10-07-10	241.22 152.00		
	1	PB2 Piggyback	6 /12	4-06-08	2-03-04	2 x 4		2-03-04	11.64 8.00		
	10	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.94 106.67		
	3	J4 Jack-Open	6 /12	5-10-08	5-01-04	2 x 4	1-03-08	2-02-00 5-01-04	53.8 34.00		
	6	J91 Jack-Open	4 /12	6-09-00	3-02-03	2 x 4	1-03-08	11-03 3-02-03	107.79 68.00		


TOTAL # TRUSS= 57

TOTAL BFT OF ALL TRUSSES= 1997.03

BFT.

TOTAL WEIGHT OF ALL TRSSES 3137.27 LBS

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
Builder: BAYVIEW WELLINGTON /
Project: PASSAGE ON THE CANAL
Location: ST CATHERINES
Model: BLOCK 2 FREEHOLD
Lot #:
Elevation: A UNIT 7


Job Track: 50264
PlanLog: 200499
Layout ID: 401353
Ref #
Page: 3 of 3
Date: 02/11/2019
Designer: Andrew Conway
Sales Rep: Mario DiCano

HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	LJS26DS	
3	Hardware	LUS24	
1	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= **10**

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 8

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401354
 Ref #
 Page: 1 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T12 Half Hip Girder	10 /12	20-03-08	4-01-04	2 x 4	1-03-08	1-07-11 4-01-04	172.46 111.00		
	1	T13 Half Hip	10 /12	20-03-08	5-01-04	2 x 4	1-03-08	1-07-11 5-01-04	87.39 55.83		
	1	T14 Half Hip	10 /12	20-03-08	6-01-04	2 x 4	1-03-08	1-07-11 6-01-04	85.89 55.00		
	1	T15 Half Hip	10 /12	20-03-08	7-01-04	2 x 4	1-03-08	1-07-11 7-01-04	93.1 59.33		
	1	T16 Half Hip	10 /12	20-03-08	8-01-04	2 x 4	1-03-08	1-07-11 8-01-04	98.11 62.67		
	1	T17 Half Hip	10 /12	20-03-08	9-01-04	2 x 4	1-03-08	1-07-11 9-01-04	112.23 72.17		
	2	T18 Half Hip	10 /12	20-03-08	10-01-04	2 x 4	1-03-08	1-07-11 10-01-04	236.5 149.67		
	1	T75 Common	6 /12	15-04-00	5-00-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	60.25 39.17		
	1	G75 GABLE	6 /12	15-04-00	5-00-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	57.71 38.17		
	1 2-ply	T76Z Common Girder	6 /12	15-04-00	5-00-00	2 x 4 2 x 6		1-02-00 1-02-00	139.32 86.00		
	1 2-ply	T79 Half Hip Girder	10 /12	18-03-08	5-01-04	2 x 4 2 x 6		2-04-06 5-01-04	182.37 114.33		
	1	T80 Half Hip	10 /12	18-03-08	6-01-04	2 x 4		2-04-06 6-01-04	78.75 49.50		
	1	T81 Half Hip	10 /12	18-03-08	7-01-04	2 x 4		2-04-06 7-01-04	83.26 51.67		
	1	T82 Half Hip	10 /12	18-03-08	8-01-04	2 x 4		2-04-06 8-01-04	91.64 58.67		



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 8

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401354
 Ref #
 Page: 2 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T83 Half Hip	10 /12	18-03-08	9-01-04	2 x 4		2-04-06 9-01-04	99.46 62.67		
	1	T84 Half Hip	10 /12	18-03-08	10-01-04	2 x 4		2-04-06 10-01-04	111.91 69.50		
	6	T88 Monopitch	10 /12	10-09-08	10-07-10	2 x 4		1-07-11 10-07-10	336.85 216.00		
	1	G88 GABLE	10 /12	10-09-08	10-07-10	2 x 4	1-03-08	1-07-11 10-07-10	65.63 41.50		
	3	T91TCX Monopitch	5 /12	4-07-00	3-03-04	2 x 4	1-03-08	1-00-09 3-03-05	65.78 45.50		
	4	T92TCX Monopitch	5 /12	3-07-00	2-10-04	2 x 4	1-03-08	1-00-09 2-10-05	73.09 50.67		
	1	T101A Half Hip	10 /12	18-03-08	9-01-10	2 x 6 2 x 4	3-03-08	3-03-11 9-01-04	113.9 69.67		
	1	G103 GABLE	6 /12	20-05-00	9-01-04	2 x 4	1-03-08	1-02-00 9-01-04	109.26 69.67		
	1	G105 GABLE	0 /12	25-03-00	10-07-10	2 x 4		10-07-10 10-07-10	241.22 152.00		
	1	PB2 Piggyback	6 /12	4-06-08	2-03-04	2 x 4		2-03-04	11.64 8.00		
	10	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.94 106.67		
	3	J4 Jack-Open	6 /12	5-10-08	5-01-04	2 x 4	1-03-08	2-02-00 5-01-04	53.8 34.00		
	6	J91 Jack-Open	4 /12	6-09-00	3-02-03	2 x 4	1-03-08	11-03 3-02-03	107.79 68.00		


TOTAL # TRUSS= 57

TOTAL BFT OF ALL TRUSSES= 1997.03

BFT.

TOTAL WEIGHT OF ALL TRSSES 3137.27 LBS

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 8

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401354
 Ref #
 Page: 3 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	LJS26DS	
3	Hardware	LUS24	
1	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 10

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 9

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401355
 Ref #
 Page: 1 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T13 Half Hip	10 /12	20-03-08	5-01-04	2 x 4	1-03-08	1-07-11 5-01-04	87.39 55.83		
	1	T14 Half Hip	10 /12	20-03-08	6-01-04	2 x 4	1-03-08	1-07-11 6-01-04	85.89 55.00		
	1	T15 Half Hip	10 /12	20-03-08	7-01-04	2 x 4	1-03-08	1-07-11 7-01-04	93.1 59.33		
	1	T16 Half Hip	10 /12	20-03-08	8-01-04	2 x 4	1-03-08	1-07-11 8-01-04	98.11 62.67		
	1	T33 Common	10 /12	11-01-00	6-03-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	49.4 33.67		
	5	T33A Common	10 /12	10-09-08	6-03-02	2 x 4	1-03-08	1-07-11 1-10-10	234.11 155.00		
	1	G33 GABLE	10 /12	11-01-00	6-03-02	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	53.85 37.67		
	1	T75 Common	6 /12	15-04-00	5-00-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	60.25 39.17		
	1	G75 GABLE	6 /12	15-04-00	5-00-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	57.71 38.17		
	1 2-ply	T76Z1 Common Girder	6 /12	15-04-00	5-00-00	2 x 4 2 x 6		1-02-00 1-02-00	139.32 86.00		
	1	T81 Half Hip	10 /12	18-03-08	7-01-04	2 x 4		2-04-06 7-01-04	83.26 51.67		
	1	T82 Half Hip	10 /12	18-03-08	8-01-04	2 x 4		2-04-06 8-01-04	91.64 58.67		
	1	T83 Half Hip	10 /12	18-03-08	9-01-04	2 x 4		2-04-06 9-01-04	99.46 62.67		
	3	T91TCX Monopitch	5 /12	4-07-00	3-03-04	2 x 4	1-03-08	1-00-09 3-03-05	65.78 45.50		

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 9

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401355
 Ref #
 Page: 2 of 3
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	4	T92TCX Monopitch	5 /12	3-07-00	2-10-04	2 x 4	1-03-08	1-00-09 2-10-05	73.09 50.67		
	1 2-ply	T95 Hip Girder	10 /12	18-03-08	5-01-04	2 x 4 2 x 6		2-04-06 1-10-10	187.62 121.33		
	1	T96 Hip	10 /12	18-03-08	6-01-04	2 x 4		2-04-06 1-10-10	81.9 52.33		
	1	T97 Hip	10 /12	18-03-08	7-01-04	2 x 4		2-04-06 1-10-10	77.72 49.33		
	1 2-ply	T98A Hip Girder	10 /12	20-03-08	4-01-04	2 x 4	1-03-08	1-07-11 1-09-12	167.9 109.33		
	1	T99A Hip	10 /12	20-03-08	5-01-04	2 x 4	1-03-08	1-07-11 1-09-12	83.99 55.33		
	1	T100A Hip	10 /12	20-03-08	6-01-04	2 x 4	1-03-08	1-07-11 1-09-12	88.86 57.67		
	1	T101A Half Hip	10 /12	18-03-08	9-01-10	2 x 6 2 x 4	3-03-08	3-03-11 9-01-04	113.9 69.67		
	1	T102 Half Hip	10 /12	18-03-08	9-01-06	2 x 6 2 x 4	3-03-08	3-03-11 9-01-00	113.79 69.67		
	2	G106 GABLE	6 /12	17-05-00	9-10-08	2 x 4		1-02-00 9-10-08	169.83 109.33		
	10	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.94 106.67		
	3	J4 Jack-Open	6 /12	5-10-08	5-01-04	2 x 4	1-03-08	2-02-00 5-01-04	53.8 34.00		
	5	J91 Jack-Open	4 /12	6-09-00	3-02-03	2 x 4	1-03-08	11-03 3-02-03	89.82 56.67		


TOTAL # TRUSS= 55

TOTAL BFT OF ALL TRUSSES= 1783.02

BFT.

TOTAL WEIGHT OF ALL TRSSES 2769.47 LBS

DELIVERY SHIPLIST

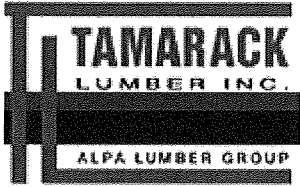

Lumber Yard: TAMARACK LUMBER
Builder: BAYVIEW WELLINGTON /
Project: PASSAGE ON THE CANAL
Location: ST CATHERINES
Model: BLOCK 2 FREEHOLD
Lot #:
Elevation: A UNIT 9


Job Track: 50264
PlanLog: 200499
Layout ID: 401355
Ref #
Page: 3 of 3
Date: 02/11/2019
Designer: Andrew Conway
Sales Rep: Mario DiCano

HARDWARE

QTY	TYPE	MODEL	LENGTH
5	Hardware	LJS26DS	
3	Hardware	LUS24	
1	Hardware	LUS26-2	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 10

DELIVERY SHIPLIST




Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 10

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401356
 Ref #
 Page: 1 of 2
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Half Hip Girder	10 /12	21-01-08	4-01-04	2 x 4 2 x 6	1-03-08	1-07-11 4-01-04	203.9 131.00		
	1 2-ply	T1Z Half Hip Girder	10 /12	21-01-08	4-01-04	2 x 4 2 x 6	1-03-08	1-07-11 4-01-04	203.9 131.00		
	2	T2 Half Hip	10 /12	21-01-08	5-01-04	2 x 4	1-03-08	1-07-11 5-01-04	179.6 117.33		
	2	T3 Half Hip	10 /12	21-01-08	6-01-04	2 x 4	1-03-08	1-07-11 6-01-04	191.49 121.33		
	2	T4 Half Hip	10 /12	21-01-08	7-01-04	2 x 4	1-03-08	1-07-11 7-01-04	190.98 122.67		
	2	T5 Half Hip	10 /12	21-01-08	8-01-04	2 x 4	1-03-08	1-07-11 8-01-04	200.88 128.00		
	5	T6 Half Hip	10 /12	21-01-08	9-01-04	2 x 4	1-03-08	1-07-11 9-01-04	573.25 364.17		
	2	T7 Half Hip	10 /12	21-01-08	10-01-04	2 x 4	1-03-08	1-07-11 10-01-04	241.17 151.00		
	3	T9 Scissor	10 /12 5 /12	8-11-00	5-04-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	125.83 83.00		
	2	T10 Common	10 /12	8-11-00	5-04-04	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	82.56 53.67		
	2	G107 GABLE	6 /12	21-05-00	9-01-04	2 x 4	1-03-08	1-02-00 9-01-04	230.92 148.33		
	3	PB1 Piggyback	10 /12	12-02-00	2-00-00	2 x 4		2-00-00	117.31 79.00		
	2	PB7 Piggyback	6 /12	5-06-08	2-09-04	2 x 4		2-09-04	29.24 20.00		
	13	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.33 138.67		


DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: BAYVIEW WELLINGTON /
 Project: PASSAGE ON THE CANAL
 Location: ST CATHERINES
 Model: BLOCK 2 FREEHOLD
 Lot #:
 Elevation: A UNIT 10

Job Track: 50264
 PlanLog: 200499
 Layout ID: 401356
 Ref #
 Page: 2 of 2
 Date: 02/11/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	4	J90 Jack-Open	4 /12	6-05-00	3-00-14	2 x 4	1-03-08	11-03 3-00-14	68.74 45.33		

TOTAL # TRUSS= 48 TOTAL BFT OF ALL TRUSSES= 1834.5 BFT. TOTAL WEIGHT OF ALL TRSSES 2858.09 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	LUS24	
3	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 5


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T1	2	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:41 2019 Page 2
ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-wPbzs0DCcfzpz2SRXCpWopnivQHmIF1pSirPKezkvge

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
P	4-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
Q	6-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
R	8-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
S	10-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
T	14-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
U	16-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
V	18-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
W	20-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
X	2-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
Y	4-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
Z	6-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AA	8-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AB	10-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AC	16-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AD	18-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AE	20-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---

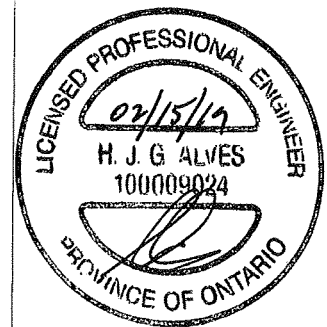

DWG NO. TAM T1903439
STRUCTURAL
COMPONENT ONLY 4/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T1Z	2	2	TRUSS DESC.		


Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:42 2019 Page 1

ID: 2Jul7VJZDQiUmwWYL4tF1nyS9e7-Ob9M3MEqNy5gb1d5wKIK1Kr_pYIRfKyGMazs5zkvgd

1-3-8 0-0 2-11-8 2-11-8 4-6-14 7-6-6 3-5-6 10-11-12 12-0-0 12-11-12 3-5-14 16-5-10 2-8-2 19-1-12 21-1-8

Scale = 1:36.2

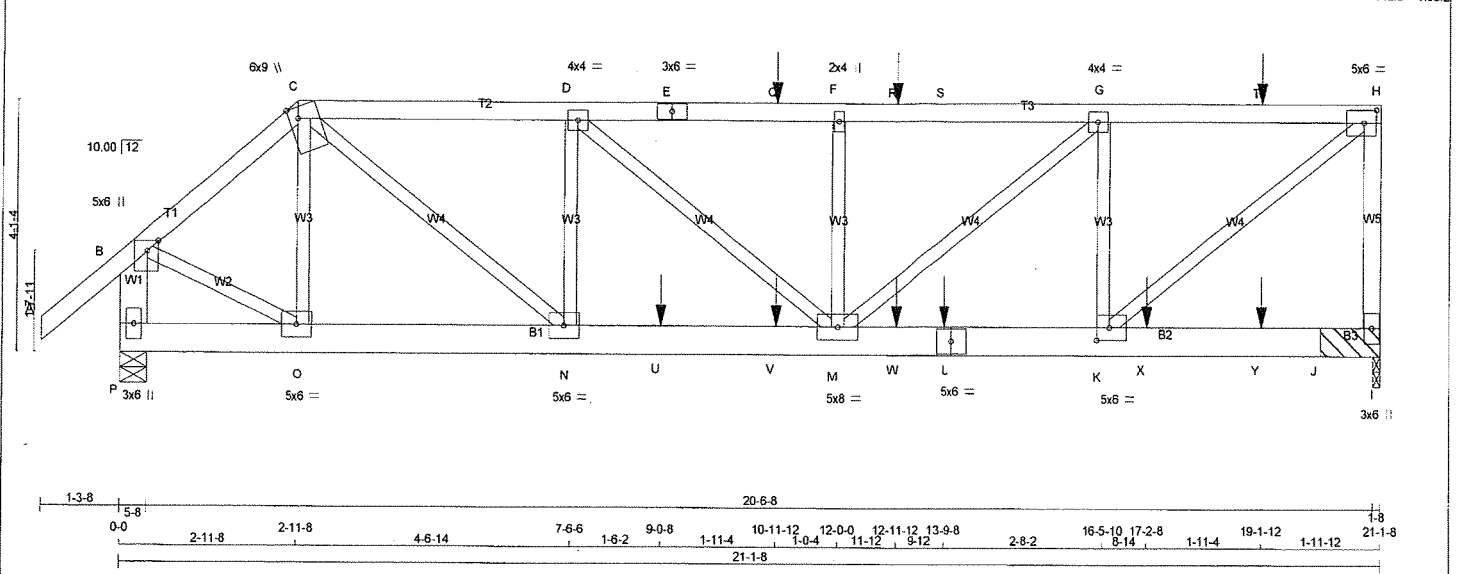

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - H	2x4	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
P - B	2x6	DRY No.2	SPF
P - L	2x6	DRY No.2	SPF
L - I	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
C-E 1	12	TOP
E-H 1	12	TOP
H-I 1	12	TOP
P-B 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
P-L 2	12	SIDE (15.8)
L-I 2	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	2.00	2.25
C	TTVVW+m	MT20	6.0	9.0	Edge	1.75
D	TMVW-t	MT20	4.0	4.0		
E	TS-t	MT20	3.0	6.0		
F	TMVW+w	MT20	2.0	4.0		
G	TMVW-t	MT20	4.0	4.0		
H	TMVW-t	MT20	5.0	6.0	2.50	2.50
I	BMV1+p	MT20	3.0	6.0		
K	BMVW-t	MT20	5.0	6.0	2.50	2.50
L	BS-t	MT20	5.0	6.0		
M	BMVWV-t	MT20	5.0	8.0		
N	BMVW-t	MT20	5.0	6.0		
O	BMVW-t	MT20	5.0	6.0		
P	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
I	2971	0	1-8	1-8 & BLOCK
P	2444	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
I	2273 1060 / 0 538 / 0 0 / 0 0 / 0 675 / 0 0 / 0
P	1860 896 / 0 419 / 0 0 / 0 0 / 0 545 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, P

2x6 DRY SPF No.2 BEARING BLOCK 12" LONG AT JT. I ATTACHED TO FRONT SIDE WITH 3 ROWS OF (0.122"x3") SPIRAL NAILS SPACED 3" C.C. 12 NAILS TOTAL.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. UNBRACED LENGTH (FT)	CS1 (LC) UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO					FR-TO		
A-B	0 / 34	-77.7	-77.7	0.08 (1)	10.00	O-C	-607 / 0 0.08 (1)
B-C	-2282 / 0	-77.7	-77.7	0.08 (1)	5.84	B-O	0 / 1884 0.23 (1)
C-D	-3951 / 0	-77.7	-77.7	0.20 (1)	4.61	K-H	0 / 4205 0.52 (1)
D-E	-4568 / 0	-77.7	-77.7	0.22 (1)	4.32	C-N	0 / 4205 0.52 (1)
E-Q	-4568 / 0	-92.7	-92.7	0.22 (1)	4.32	K-S	0 / 4205 0.52 (1)
Q-F	-4568 / 0	-92.7	-92.7	0.22 (1)	4.32	F-T	0 / 1672 0.21 (1)
F-R	-4568 / 0	-92.7	-92.7	0.25 (1)	4.28	M-S	0 / 892 0.18 (1)
R-S	-4568 / 0	-92.7	-92.7	0.25 (1)	4.28	S-F	0 / 892 0.18 (1)
S-G	-4568 / 0	-77.7	-77.7	0.25 (1)	4.28		
G-T	-3282 / 0	-77.7	-77.7	0.23 (1)	4.99		
T-H	-3282 / 0	-77.7	-77.7	0.23 (1)	4.99		
I-H	-2821 / 0	0.0	0.0	0.35 (1)	6.86		
P-B	-2389 / 0	0.0	0.0	0.09 (1)	7.88		

MEMB.	LOC.	LC1 MAX.	MAX+ FACE	DIR.	TYPE	HEEL	CONN.
JT	13-9-8	-628	-628	---	BACK VERT	TOTAL	---
Q	10-11-12	-94	-94	---	BACK VERT	TOTAL	---
R	12-11-12	-94	-94	---	BACK VERT	TOTAL	---
T	19-1-12	-94	-94	---	BACK VERT	TOTAL	---
U	9-0-8	-955	-955	---	BACK VERT	TOTAL	---
V	10-11-12	-56	-71	---	BACK VERT	TOTAL	---
W	12-11-12	-56	-71	---	BACK VERT	TOTAL	---
X	17-2-8	-628	-628	---	BACK VERT	TOTAL	---

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1 MAX.	MAX+ FACE	DIR.	TYPE	HEEL	CONN.
Q	10-11-12	-94	-94	---	BACK VERT	TOTAL	---
R	12-11-12	-94	-94	---	BACK VERT	TOTAL	---
T	19-1-12	-94	-94	---	BACK VERT	TOTAL	---
U	9-0-8	-955	-955	---	BACK VERT	TOTAL	---
V	10-11-12	-56	-71	---	BACK VERT	TOTAL	---
W	12-11-12	-56	-71	---	BACK VERT	TOTAL	---
X	17-2-8	-628	-628	---	BACK VERT	TOTAL	---

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 20.9 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.4 PSF
TOTAL LOAD = 44.8 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.70")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.70")
CALCULATED VERT. DEFL. (TL) = L/999 (0.14")

CSI: TC=0.35/1.00 (H-I:1), BC=0.54/1.00 (M-N:1),
WB=0.52/1.00 (H-K:1), SSI=0.24/1.00 (M-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (K) (INPUT = 0.90)
JSI METAL= 0.50 (L) (INPUT = 1.00)


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLDUNITS 5 - 10	DRWG NO.
401350	T1Z	2	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:42 2019 Page 2
ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-Ob9M3MEgNy5gbB1d5wKIK1Kr_pYIRfKyqMazs5zkvgd

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Y	19-1-12	-56	-71	---	BACK	VERT	TOTAL	---	---

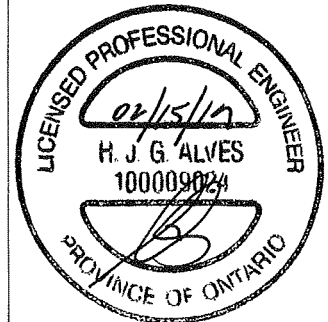


DWG NO. TAMT19034410
STRUCTURAL
COMPONENT ONLY 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T2	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:43 2019 Page 1

ID:2Jul?VJZDQiUmwWY14tF1nyS9e7-snjkhIES8GDxLbpedr_tEs_KDwqA9Q6v0KVOXzkvgc

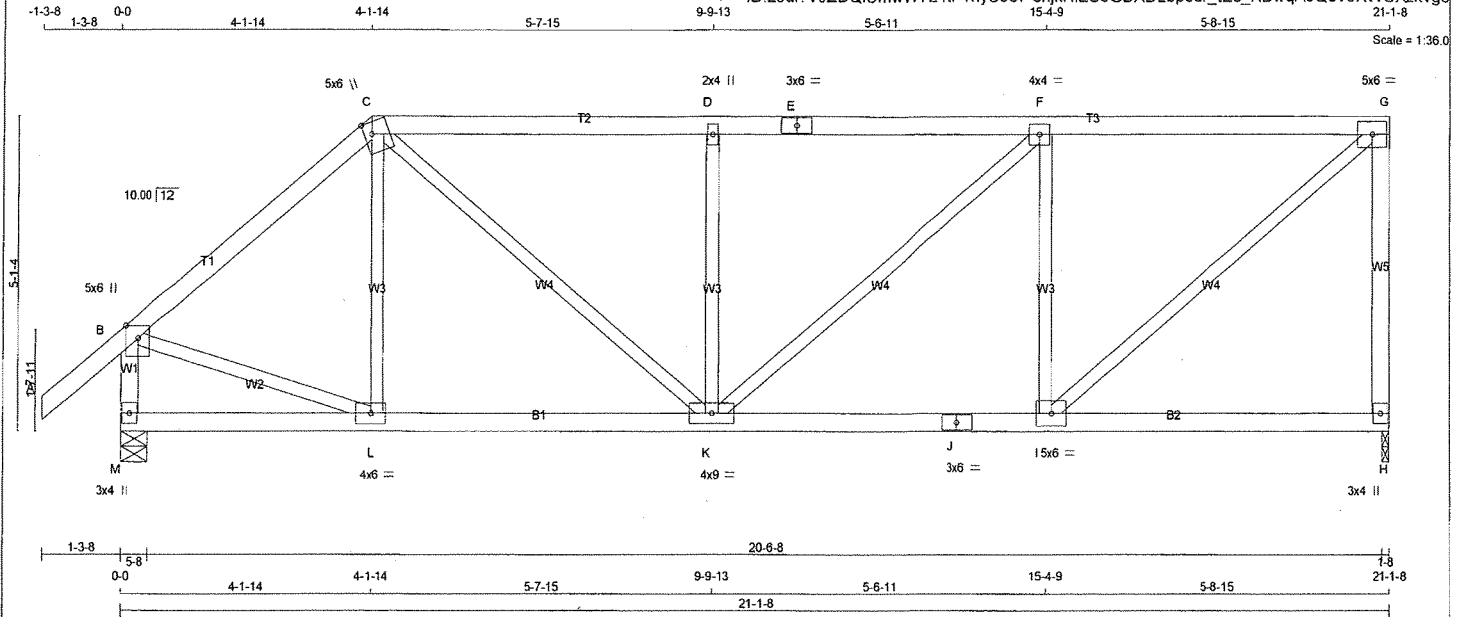

TOTAL WEIGHT = 4 X 90 = 359 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMVW+w	MT20	2.0	4.0		
E	TS-t	MT20	3.0	6.0		
F	TMVW-t	MT20	4.0	4.0		
G	TMVW-t	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-t	MT20	5.0	6.0		
K	BMVW-t	MT20	4.0	9.0		
L	BMVW-t	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
H	1238	0	1238	0
M	1346	0	1346	0

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	946	442 / 0	222 / 0	0 / 0	0 / 0	283 / 0	0 / 0
M	1021	499 / 0	222 / 0	0 / 0	0 / 0	300 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.01 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 34	-77.7 -77.7 0.11 (1)	L-C	-52 / 121 0.03 (3)
B-C	-1157 / 0	-77.7 -77.7 0.26 (1)	B-L	0 / 927 0.21 (1)
C-D	-1417 / 0	-77.7 -77.7 0.38 (1)	I-G	0 / 1503 0.34 (1)
D-E	-1417 / 0	-77.7 -77.7 0.39 (1)	C-K	0 / 697 0.16 (1)
E-F	-1417 / 0	-77.7 -77.7 0.39 (1)	I-F	-712 / 0 0.27 (1)
F-G	-1153 / 0	-77.7 -77.7 0.38 (1)	K-D	-470 / 0 0.18 (1)
H-G	-1146 / 0	0.0 0.0 0.51 (1)	K-F	0 / 350 0.08 (1)
M-B	-1264 / 0	0.0 0.0 0.14 (1)		
M-L	0 / 0	-39.5 -39.5 0.18 (3)		
L-K	0 / 885	-39.5 -39.5 0.30 (2)		
K-J	0 / 1153	-39.5 -39.5 0.39 (2)		
J-I	0 / 1153	-39.5 -39.5 0.39 (2)		
I-H	0 / 0	-39.5 -39.5 0.24 (3)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
DL = 6.0 PSF	
BOT CH.	LL = 10.5 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.70")
CALCULATED VERT. DEFL. (LL) = L/989 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.70")
CALCULATED VERT. DEFL. (TL) = L/989 (0.09")

CSI: TC=0.51/1.00 (G-H-1), BC=0.39/1.00 (I-K-2),
WB=0.34/1.00 (G-I-1), SS=0.21/1.00 (F-G-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.75 (C) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)

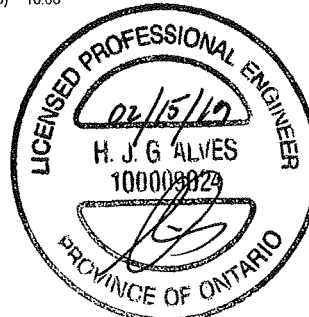

DWG NO. TAM T1903441
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T3	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

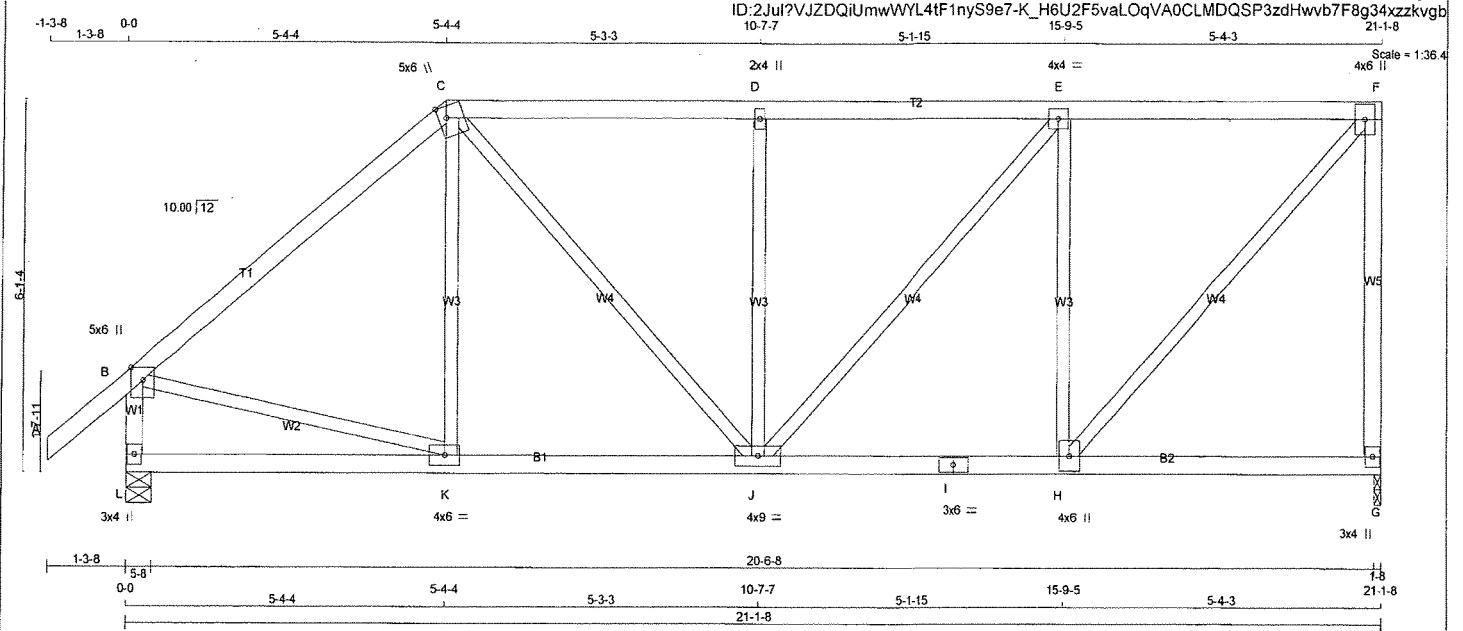

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TTVW+m	MT20	5.0	6.0	2.25	1.50
D	TMVW+w	MT20	2.0	4.0		
E	TMVW+t	MT20	4.0	4.0		
F	TMVW+p	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMVW+t	MT20	4.0	6.0		
I	BS-t	MT20	3.0	6.0		
J	BMVW+t	MT20	4.0	9.0		
K	BMVW+t	MT20	4.0	6.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG
G	1238	0	1238	0	0	1-8	1-8	1-8	1-8
L	1346	0	1346	0	0	5-8	5-8	5-8	5-8

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.36 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH	MEMB.	FORCE (LBS)
FR-TO		FROM	TO		FR-TO				
A-B	0/34	-77.7	-77.7	0.11 (1)	10.00	K-C	0/186	0.04 (3)	
B-C	-1144/0	-77.7	-77.7	0.45 (1)	5.36	B-K	0/901	0.20 (1)	
C-D	-1170/0	-77.7	-77.7	0.31 (1)	5.51	H-F	0/1338	0.30 (1)	
D-E	-1170/0	-77.7	-77.7	0.32 (1)	5.49	C-J	0/435	0.10 (1)	
E-F	-908/0	-77.7	-77.7	0.31 (1)	6.05	H-E	-747/0	0.44 (1)	
G-F	-1153/0	0.0	0.0	0.83 (1)	7.42	J-D	-436/0	0.26 (1)	
L-B	-1259/0	0.0	0.0	0.13 (1)	7.17	J-E	0/398	0.09 (1)	
L-K	0/0	-39.5	-39.5	0.22 (3)	10.00				
K-J	0/877	-39.5	-39.5	0.33 (2)	10.00				
J-I	0/906	-39.5	-39.5	0.33 (2)	10.00				
I-H	0/906	-39.5	-39.5	0.33 (2)	10.00				
H-G	0/0	-39.5	-39.5	0.21 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.9 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.4 PSF
TOTAL LOAD = 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.70")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.70")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.83/1.00 (F-G:1), BC=0.33/1.00 (J-K:2), WB=0.44/1.00 (E-H:1), SSI=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667
	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL = 0.45 (B) (INPUT = 1.00)

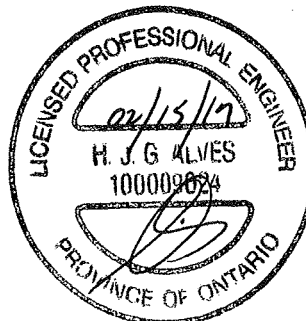

DWG NO. TAM 71903442
STRUCTURAL
COMPONENT ONLY

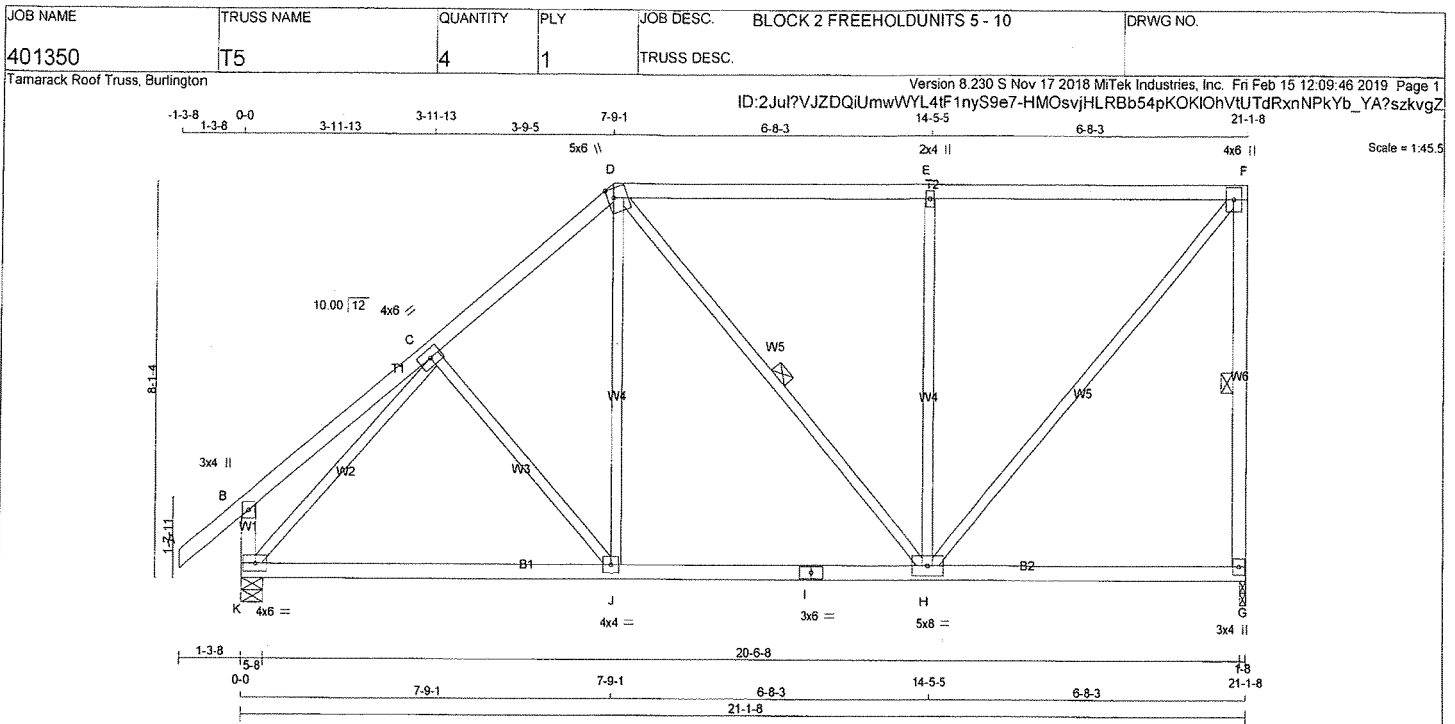

TOTAL WEIGHT = 4 X 100 = 402 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - B	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	6.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMVW+w	MT20	2.0	4.0		
F	TMVW+p	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	5.0	8.0		
I	BS-t	MT20	3.0	6.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMVW1-t	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
G	1238	0	1238	0	1-8	1-8
K	1346	0	1346	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	946	442 / 0	222 / 0	0 / 0	0 / 0	283 / 0	0 / 0
K	1021	499 / 0	222 / 0	0 / 0	0 / 0	300 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.68 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO					FR-TO		
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	C-J	-66 / 57
B-C	0 / 22	-77.7	-77.7	0.18 (1)	10.00	D-H	-50 / 0
C-D	-1072 / 0	-77.7	-77.7	0.20 (1)	5.85	H-E	-643 / 0
D-E	-800 / 0	-77.7	-77.7	0.63 (1)	5.68	H-F	0 / 1227
E-F	-800 / 0	-77.7	-77.7	0.63 (1)	5.68	K-C	-1308 / 0
G-F	-1128 / 0	0.0	0.0	0.33 (1)	5.98		
K-B	-223 / 0	0.0	0.0	0.02 (1)	7.81		
K-J	0 / 849	-39.5	-39.5	0.50 (2)	10.00		
J-I	0 / 810	-39.5	-39.5	0.50 (2)	10.00		
I-H	0 / 810	-39.5	-39.5	0.50 (2)	10.00		
H-G	0 / 0	-39.5	-39.5	0.29 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.9 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.4 PSF
TOTAL LOAD = 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.70")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL)= L/360 (0.70")
CALCULATED VERT. DEFL.(TL) = L/982 (0.26")

CSI: TC=0.63/1.00 (E-F:1), BC=0.50/1.00 (J-K:2), WB=0.81/1.00 (E-H:1), SSI=0.25/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (C) (INPUT = 0.90)
JSI METAL= 0.36 (F) (INPUT = 1.00)

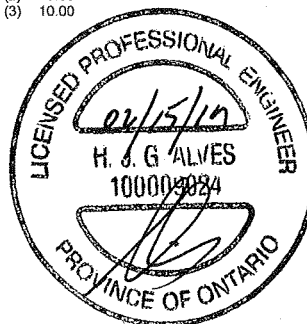


DWG NO. TAM 71903444
STRUCTURAL
COMPONENT ONLY

DWG NO. TAM 77903445
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T7	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:48 2019 Page 1
ID:2Jul?VJZDQiUmWYL4tF1nyS9e7-DiWdKPbyorpJ6UnRAR9alap?EfBrPCr3I1H4kzkgvX

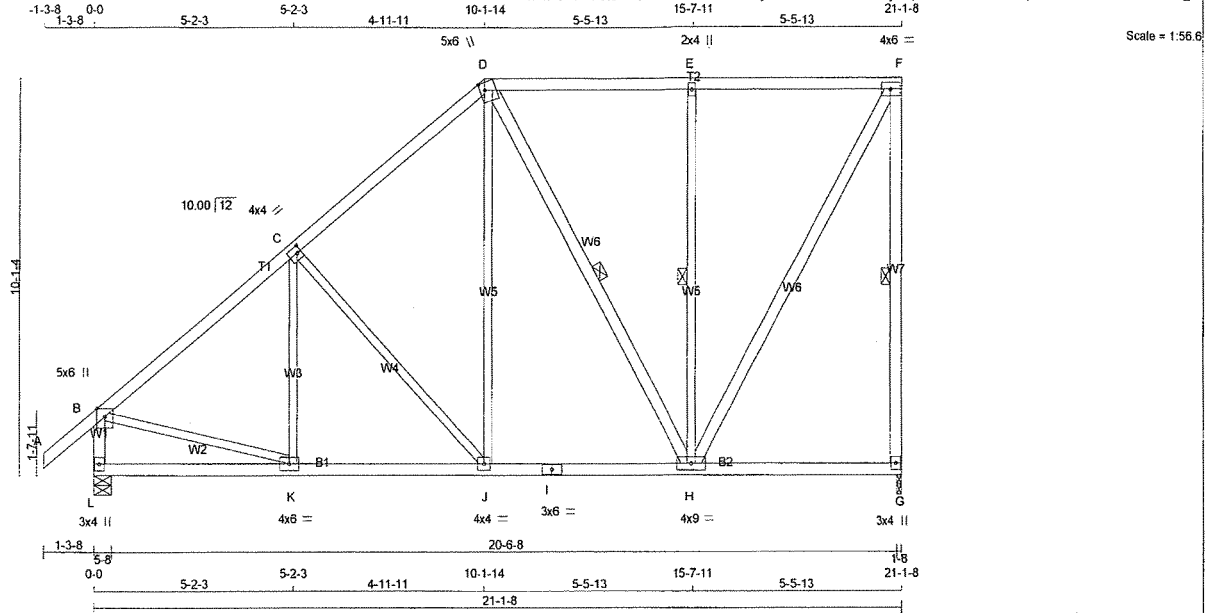

TOTAL WEIGHT = 4 X 121 = 482 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
L - B	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
D - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMWW-t	MT20	4.0	4.0	2.00	1.25
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TMVW-t	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMWWW-t	MT20	4.0	9.0		
I	BS-t	MT20	3.0	6.0		
J	BMWW-t	MT20	4.0	4.0		
K	BMWW-t	MT20	4.0	6.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED		MAXIMUM FACTORED		INPUT	REQRD	
	GROSS REACTION		GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
G	1238	0	1238	0	0	1-8	1-8
L	1346	0	1346	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	946	442 / 0	222 / 0	0 / 0	0 / 0	283 / 0	0 / 0
L	1021	499 / 0	222 / 0	0 / 0	0 / 0	300 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H, E-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1		MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
		FROM	TO				
FR-TO							
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	-4 / 163	0.04 (3)
B-C	-1170 / 0	-77.7	-77.7	0.39 (1)	5.41	-375 / 0	0.43 (1)
C-D	-905 / 0	-77.7	-77.7	0.37 (1)	5.98	-0 / 491	0.11 (2)
D-E	-556 / 0	-77.7	-77.7	0.40 (1)	6.25	-246 / 0	0.17 (1)
E-F	-556 / 0	-77.7	-77.7	0.40 (1)	6.25	-527 / 0	0.37 (1)
G-F	-1151 / 0	0.0	0.0	0.57 (1)	5.93	0 / 1133	0.18 (1)
L-B	-1263 / 0	0.0	0.0	0.13 (1)	7.16	0 / 951	0.21 (1)
L-K	0 / 0	-39.5	-39.5	0.19 (3)	10.00		
K-J	0 / 922	-39.5	-39.5	0.31 (2)	10.00		
J-I	0 / 675	-39.5	-39.5	0.31 (2)	10.00		
I-H	0 / 675	-39.5	-39.5	0.31 (2)	10.00		
H-G	0 / 0	-39.5	-39.5	0.23 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9	PSF
	DL = 6.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 44.8	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.70")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.70")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.57/1.00 (F-G:1), BC=0.31/1.00 (J-K:2), WB=0.43/1.00 (C-J:1), SSI=0.21/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.46 (B) (INPUT = 1.00)

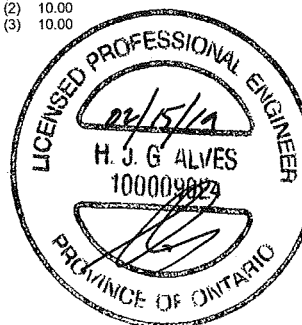


DWG NO. TAM 179034 46
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T9	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:49 2019 Page 1
ID:2Jul7VJZDQiUmwWYL4tF1nyS9e7-hx47XJJDj6zgxG3z?uyO7V63ae1Saxz_HynrcBzkvgWV

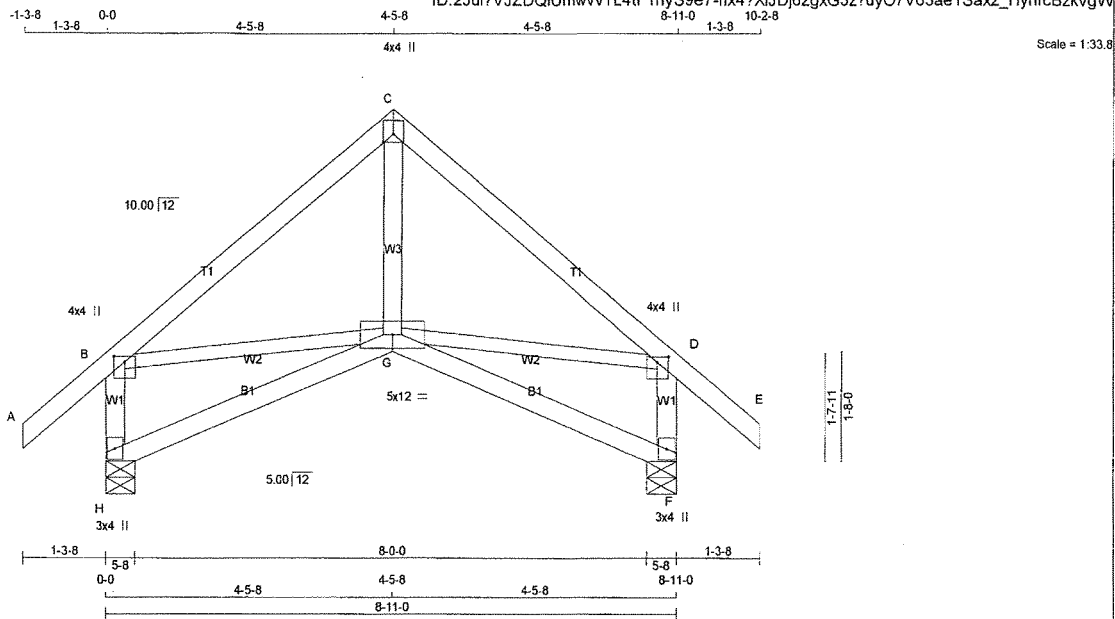

TOTAL WEIGHT = 6 X 42 = 252 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
H - B	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF

ALL WEBS EXCEPT	2x4 DRY	No.2	SPF
B - G	2x3 DRY	No.2	SPF
G - D	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	4.0	1.50	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BBWVW+p	MT20	5.0	12.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
H	630	0	630	0
F	630	0	630	0

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED					
H	474	244 / 0	94 / 0	0 / 0	136 / 0	0 / 0
F	474	244 / 0	94 / 0	0 / 0	136 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. (LC)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 34	-77.7	-77.7	G-C	0 / 278
B-C	-454 / 0	-77.7	-77.7	B-G	0 / 350
C-D	-454 / 0	-77.7	-77.7	G-D	0 / 350
D-E	0 / 34	-77.7	-77.7		
H-B	-542 / 0	0.0	0.0		
F-D	-542 / 0	0.0	0.0		
H-G	0 / 0	-39.5	-39.5		
G-F	0 / 0	-39.5	-39.5		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
DL = 6.0 PSF	
BOT CH.	LL = 10.5 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.30")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.03")
ALLOWABLE DEFL. (TL) = $L/360$ (0.30")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.20/1.00 (C-D:1), BC=0.18/1.00 (F-G:3), WB=0.08/1.00 (D-G:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.74 (C) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)

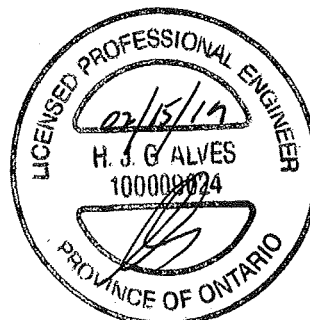


DWG NO. TAM 17903447
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T10	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:50 2019 Page 1

ID:2Jul?VJZDQIUmwWYL4tF1nyS9e7-98eN5KrUQ5XYQeAZbTdfjEM2NmJPX8WwWO8dzkvgV

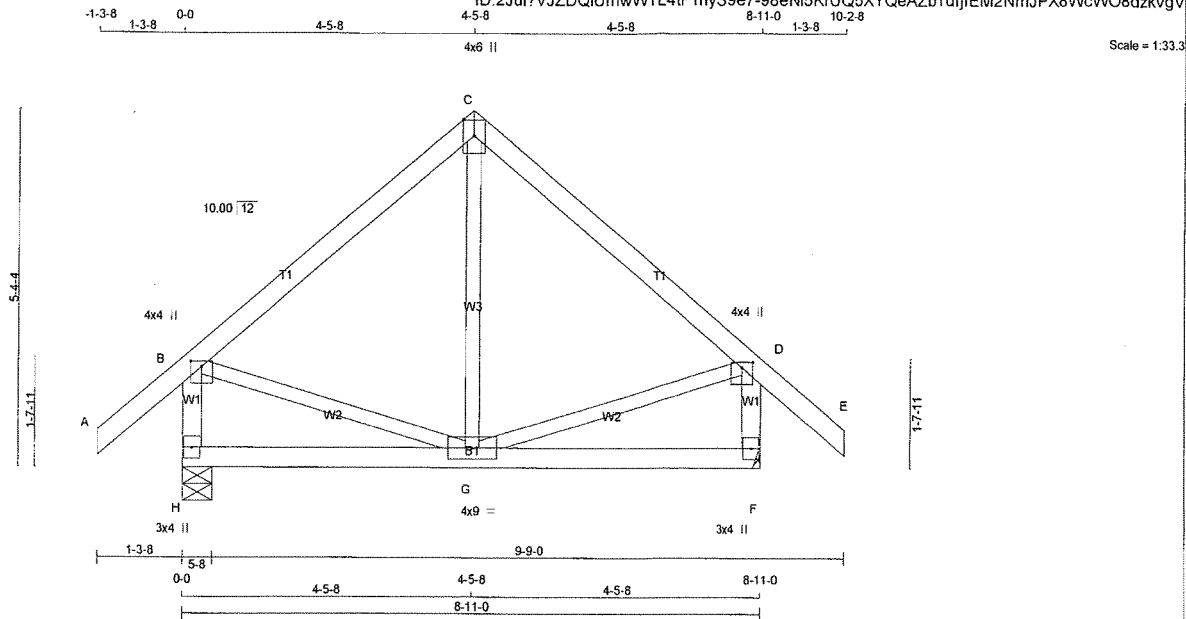

TOTAL WEIGHT = 4 X 41 = 165 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQRD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
H	630	0	630	0
F	630	0	630	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX / MIN. COMPONENT REACTIONS
JT	COMBINED
H	474
F	474

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 34	-77.7 -77.7	0.11 (1)	G-C	0 / 188	0.05 (3)	
B-C	-326 / 0	-77.7 -77.7	0.20 (1)	B-G	0 / 261	0.06 (1)	
C-D	-326 / 0	-77.7 -77.7	0.20 (1)	G-D	0 / 261	0.06 (1)	
D-E	0 / 34	-77.7 -77.7	0.11 (1)				
H-B	-563 / 0	0.0 0.0	0.06 (1)				
F-D	-563 / 0	0.0 0.0	0.06 (1)				
H-G	0 / 0	-39.5 -39.5	0.18 (3)				
G-F	0 / 0	-39.5 -39.5	0.18 (3)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH	LL = 20.9	PSF
	DL = 6.0	PSF
BOT CH	LL = 10.5	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 44.8	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60% OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.30")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.30")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.20/1.00 (C-D:1), BC=0.18/1.00 (G-H:3), WB=0.06/1.00 (B-G:1), SSI=0.12/1.00 (F-G:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.49 (B) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)

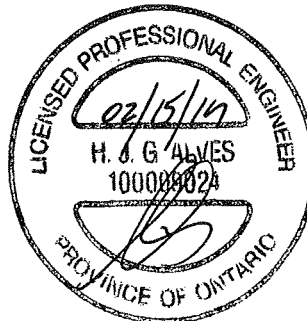

DWG NO. TAM 77903448
STRUCTURAL
COMPONENT ONLY

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T12	3	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:51 2019 Page 2
ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-dKClYRLUFJDOAaDM6J_sCwCPDSh82oshHIGGxh3zkvgU

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
P	3-8-12	-102	-102	---	FRONT	VERT	TOTAL	---	---
Q	5-8-12	-94	-94	---	FRONT	VERT	TOTAL	---	---
R	7-8-12	-94	-94	---	FRONT	VERT	TOTAL	---	---
S	9-8-12	-94	-94	---	FRONT	VERT	TOTAL	---	---
T	13-8-12	-94	-94	---	FRONT	VERT	TOTAL	---	---
U	17-8-12	-94	-94	---	FRONT	VERT	TOTAL	---	---
V	19-8-12	-111	-111	---	FRONT	VERT	TOTAL	---	---
W	1-8-12	-56	-71	---	FRONT	VERT	TOTAL	---	---
X	3-8-12	-56	-71	---	FRONT	VERT	TOTAL	---	---
Y	5-8-12	-56	-71	---	FRONT	VERT	TOTAL	---	---
Z	7-8-12	-56	-71	---	FRONT	VERT	TOTAL	---	---
AA	9-8-12	-56	-71	---	FRONT	VERT	TOTAL	---	---
AB	17-8-12	-56	-71	---	FRONT	VERT	TOTAL	---	---
AC	19-8-12	-65	-82	---	FRONT	VERT	TOTAL	---	---

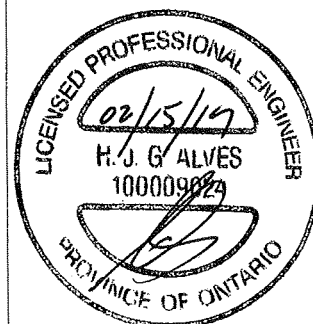


DWG NO. TAM T7903449
STRUCTURAL
COMPONENT ONLY 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T13	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:52 2019 Page 1

ID:2Jul?VJZDQIUmwWYL4tF1nyS9e7-5Wm89nL601LFokoYg0V5k8kWMr0UnF?Rzw?VDVzkgT

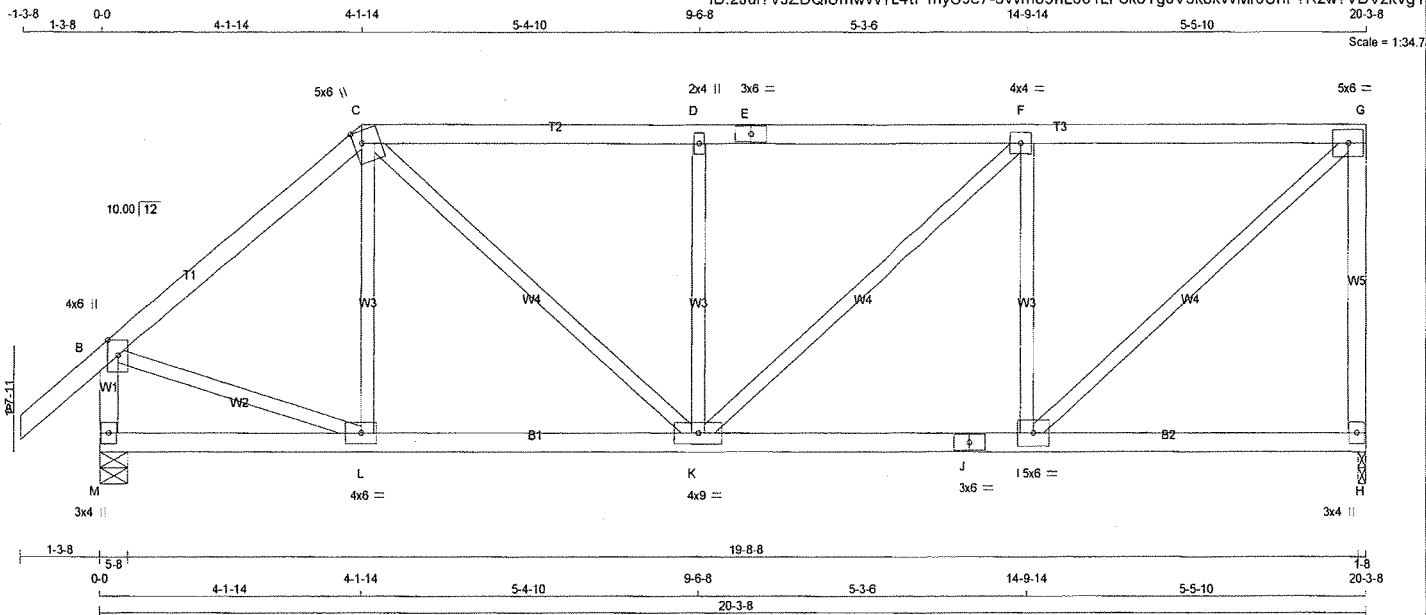

TOTAL WEIGHT = 4 X 87 = 350 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	1.50
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMW+w	MT20	2.0	4.0		
E	TS-t	MT20	3.0	6.0		
F	TMVW-t	MT20	4.0	4.0		
G	TMVW-t	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-t	MT20	5.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-t	MT20	4.0	9.0		
L	BMVW-t	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				GROSS REACTION			
JT	VERT	HORZ	UPLIFT	BRG	IN-SX	BRG	IN-SX
H	1189	0	1189	0	0	1-8	1-8
M	1297	0	1297	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	909	424 / 0	213 / 0	0 / 0	0 / 0	272 / 0	0 / 0
M	984	482 / 0	213 / 0	0 / 0	0 / 0	289 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.23 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED UNBRACED (LC) (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED (LC) (LBS)	MAX. FACTORED UNBRACED (LC) (LBS)
FR-TO				FR-TO			
A-B	0 / 34	-77.7	-77.7 0.11 (1)	10.00	L-C	-45 / 121	0.03 (3)
B-C	-1100 / 0	-77.7	-77.7 0.26 (1)	5.71	B-L	0 / 881	0.20 (1)
C-D	-1307 / 0	-77.7	-77.7 0.33 (1)	5.26	I-G	0 / 1407	0.32 (1)
D-E	-1308 / 0	-77.7	-77.7 0.34 (1)	5.23	C-K	0 / 624	0.14 (1)
E-F	-1308 / 0	-77.7	-77.7 0.34 (1)	5.23	I-F	-889 / 0	0.26 (1)
F-G	-1056 / 0	-77.7	-77.7 0.33 (1)	5.69	K-D	-446 / 0	0.17 (1)
H-G	-1102 / 0	0.0	0.0 0.49 (1)	7.54	K-F	0 / 340	0.08 (1)
M-B	-1234 / 0	0.0	0.0 0.13 (1)	7.23			
M-L	0 / 0	-39.5	-39.5 0.17 (3)	10.00			
L-K	0 / 842	-39.5	-39.5 0.28 (2)	10.00			
K-J	0 / 1056	-39.5	-39.5 0.35 (2)	10.00			
J-I	0 / 1056	-39.5	-39.5 0.35 (2)	10.00			
I-H	0 / 0	-39.5	-39.5 0.22 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9	PSF
DL = 6.0	PSF	
BOT CH.	LL = 10.5	PSF
DL = 7.4	PSF	
TOTAL LOAD = 44.8	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.68")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.04")
ALLOWABLE DEFL. (TL) = $L/360$ (0.68")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.08")

CSI: TC=0.49/1.00 (G-H:1), BC=0.35/1.00 (I-K:2), WB=0.32/1.00 (G-I:1), SSI=0.20/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (B) (INPUT = 0.90)
JSI METAL= 0.53 (B) (INPUT = 1.00)

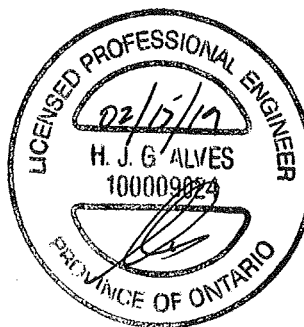

DRWG NO. TAM 119034 50
STRUCTURAL
COMPONENT ONLY

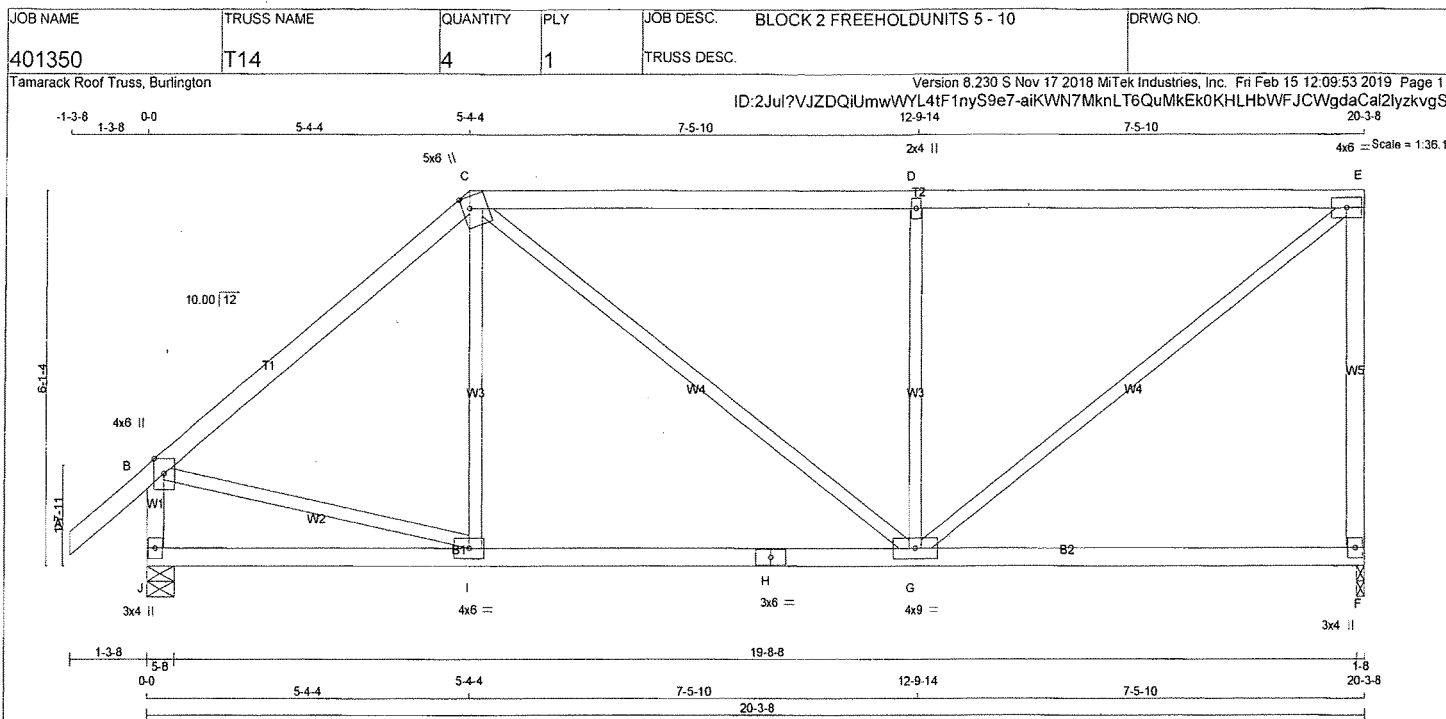

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR.

A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMVW+w	MT20	2.0	4.0		
E	TMVW-t	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BS-t	MT20	3.0	6.0		
I	BMVW-t	MT20	4.0	6.0		
J	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX		
F	1189	0	1189	0	0	1-8	1-8	
J	1297	0	1297	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LCASE		MAX / MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	909	424 / 0	213 / 0	0 / 0	0 / 0	272 / 0	0 / 0
J	984	482 / 0	213 / 0	0 / 0	0 / 0	289 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.54 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)		
FR-TO		FROM TO		UNBRAC LENGTH	FR-TO				
A-B	0 / 34	-77.7	-77.7	0.11 (1)	I-C	0 / 224	0.05 (3)		
B-C	-1090 / 0	-77.7	-77.7	0.45 (1)	C-G	0 / 330	0.07 (1)		
C-D	-1097 / 0	-77.7	-77.7	0.84 (1)	G-D	-719 / 0	0.42 (1)		
D-E	-1097 / 0	-77.7	-77.7	0.84 (1)	G-E	0 / 1387	0.31 (1)		
F-E	-1071 / 0	0.0	0.0	0.77 (1)	B-I	0 / 859	0.19 (1)		
J-B	-1215 / 0	0.0	0.0	0.13 (1)					
J-I	0 / 0	-39.5	-39.5	0.27 (3)					
I-H	0 / 837	-39.5	-39.5	0.52 (2)					
H-G	0 / 837	-39.5	-39.5	0.52 (2)					
G-F	0 / 0	-39.5	-39.5	0.42 (3)					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 20.9 PSF
DL	= 6.0 PSF
BOT CH. LL	= 10.5 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L^3/360 (0.68")$
 CALCULATED VERT. DEFL. (LL) = $L^3/999 (0.12")$
 ALLOWABLE DEFL. (TL) = $L^3/360 (0.68")$
 CALCULATED VERT. DEFL. (TL) = $L^3/999 (0.20")$

CSI: TC=0.84/1.00 (D-E:1), BC=0.52/1.00 (G-I:2), WB=0.42/1.00 (D-G:1), SSI=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1667	788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
 JSI METAL= 0.54 (B) (INPUT = 1.00)

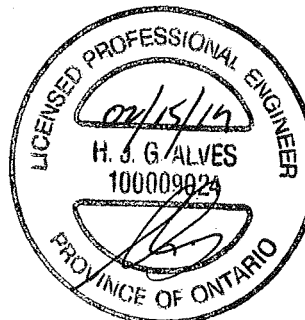


DWG NO. TAM 17903457
 STRUCTURAL
 COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T15	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:54 2019 Page 1

ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-2vtuaTNMYecz12xxoRYZqZqpufigmF3PjREUuHOzkvgR

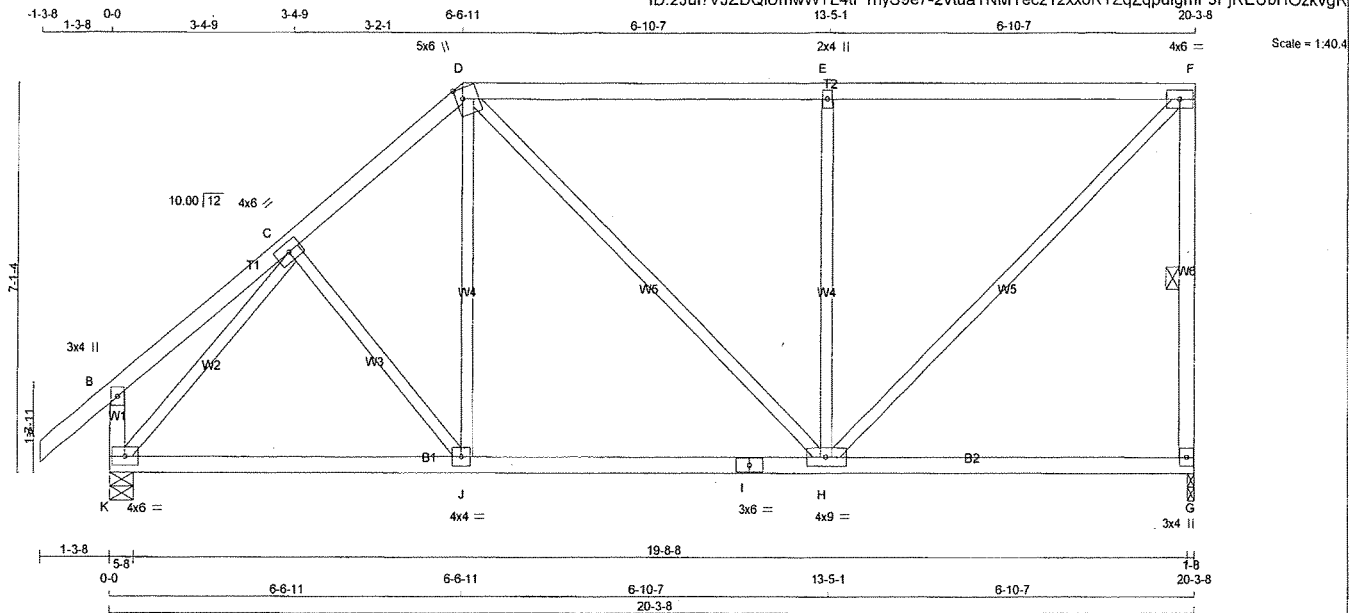

TOTAL WEIGHT = 4 X 93 = 372 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
G - F	2x4	DRY No.2	SPF
K - B	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
I - G	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TMVW-t	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	4.0	9.0		
I	BS-t	MT20	3.0	6.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMVW1-t	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	UPLIFT
G	1189	0	1189	0
K	1297	0	1297	0

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
G	909 424 / 0 213 / 0 0 / 0 0 / 0 272 / 0 0 / 0
K	984 482 / 0 213 / 0 0 / 0 0 / 0 289 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.36 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	C-J	0 / 81	0.02 (3)	
B-C	0 / 17	-77.7	-77.7	0.12 (1)	10.00	J-D	0 / 332	0.07 (2)	
C-D	-1062 / 0	-77.7	-77.7	0.14 (1)	5.96	D-H	0 / 117	0.03 (1)	
D-E	-887 / 0	-77.7	-77.7	0.67 (1)	5.36	H-E	-661 / 0	0.58 (1)	
E-F	-887 / 0	-77.7	-77.7	0.68 (1)	5.36	H-F	0 / 1246	0.28 (1)	
G-F	-1078 / 0	0.0	0.0	0.25 (1)	6.08	K-C	-1266 / 0	0.54 (1)	
K-B	-207 / 0	0.0	0.0	0.02 (1)	7.81				
K-J	0 / 797	-39.5	-39.5	0.41 (2)	10.00				
J-I	0 / 804	-39.5	-39.5	0.43 (2)	10.00				
I-H	0 / 804	-39.5	-39.5	0.43 (2)	10.00				
H-G	0 / 0	-39.5	-39.5	0.34 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9	PSF
DL = 6.0	PSF	
BOT CH.	LL = 10.5	PSF
DL = 7.4	PSF	
TOTAL LOAD = 44.8	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.68")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.09")
ALLOWABLE DEFL.(TL) = $L/360$ (0.68")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.16")

CSI: TC=0.68/1.00 (E-F 1), BC=0.43/1.00 (H-J 2),
WB=0.58/1.00 (E-H 1), SSI=0.26/1.00 (E-F 1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (F) (INPUT = 0.90)
JSI METAL = 0.31 (C) (INPUT = 1.00)




DWG NO. TAM 17903452
STRUCTURAL
COMPONENT ONLY

JOB NAME 401350	TRUSS NAME T16	QUANTITY 4	PLY 1	JOB DESC. BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
--------------------	-------------------	---------------	----------	--	----------

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Fri Feb 15 12:09:55 2019 Page 1

ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-W5RGooO_JykqfBW7L83oMmM0j374_UltgtE9qqzkgvQ

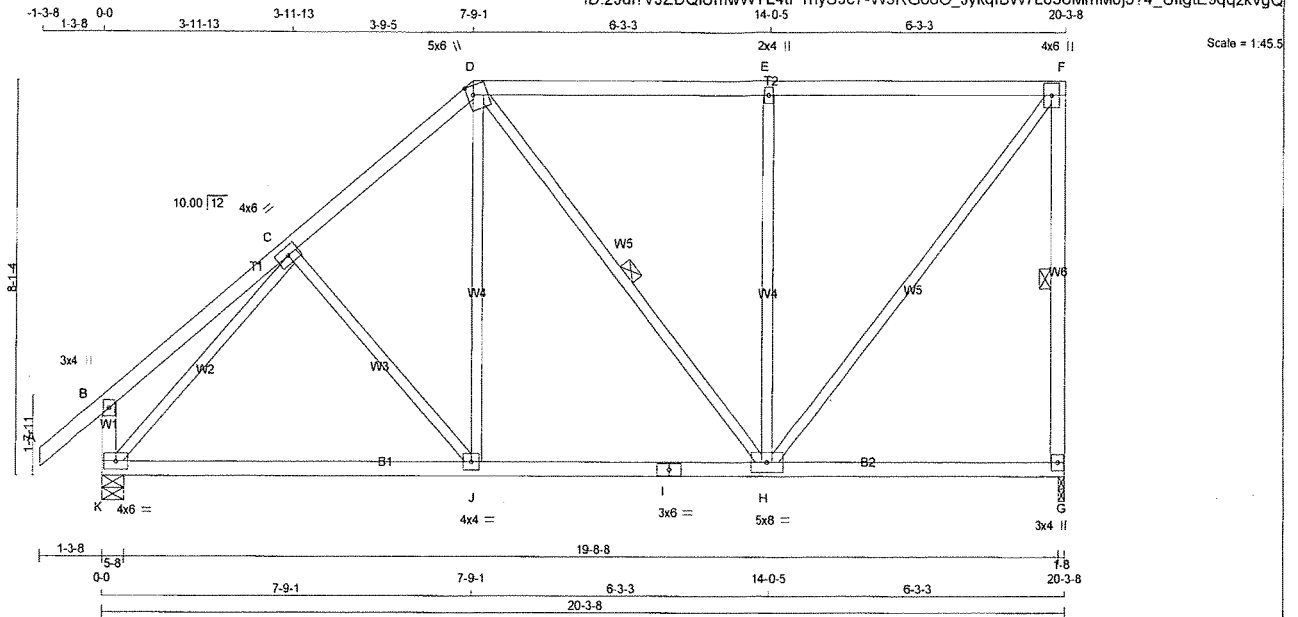

TOTAL WEIGHT = 4 X 98 = 392 lb

LUMBER	SIZE	DESCR.
N.L.G.A. RULES		
CHORDS		
A - D	2x4 DRY	No.2 SPF
D - F	2x4 DRY	No.2 SPF
G - F	2x4 DRY	No.2 SPF
K - B	2x4 DRY	No.2 SPF
K - I	2x4 DRY	No.2 SPF
I - G	2x4 DRY	No.2 SPF
ALL WEBS	2x3 DRY	No.2 SPF
EXCEPT		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	6.0		
D	TTVW+m	MT20	5.0	6.0	2.25	1.50
E	TMV+w	MT20	2.0	4.0		
F	TMVW+p	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMVW-t	MT20	5.0	8.0		
I	BS-t	MT20	3.0	6.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMVW-t	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
G	1189	0	1189	0	1-8	1-8
K	1297	0	1297	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	909	424 / 0	213 / 0	0 / 0	0 / 0	272 / 0	0 / 0
K	984	482 / 0	213 / 0	0 / 0	0 / 0	289 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	C-J	-77 / 51	0.05 (1)	
B-C	0 / 22	-77.7	-77.7	0.18 (1)	10.00	J-D	0 / 420	0.09 (2)	
C-D	-1008 / 0	-77.7	-77.7	0.20 (1)	5.98	D-H	-74 / 0	0.05 (3)	
D-E	-725 / 0	-77.7	-77.7	0.54 (1)	6.09	H-E	-603 / 0	0.76 (1)	
E-F	-726 / 0	-77.7	-77.7	0.54 (1)	6.09	H-F	0 / 1155	0.26 (1)	
G-F	-1085 / 0	0.0	0.0	0.32 (1)	6.07	K-C	-1243 / 0	0.74 (1)	
K-B	-223 / 0	0.0	0.0	0.02 (1)	7.81				
K-J	0 / 807	-39.5	-39.5	0.49 (2)	10.00				
J-I	0 / 761	-39.5	-39.5	0.49 (2)	10.00				
I-H	0 / 761	-39.5	-39.5	0.49 (2)	10.00				
H-G	0 / 0	-39.5	-39.5	0.25 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
	DL = 6.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.68")
CALCULATED VERT. DEFL.(LL) = L/989 (0.15")
ALLOWABLE DEFL.(TL)= L/360 (0.68")
CALCULATED VERT. DEFL.(TL) = L/939 (0.26")

CSI: TC=0.54/1.00 (E-F:1), BC=0.49/1.00 (J-K:2), WB=0.76/1.00 (E-H:1), SS=0.24/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1667 788 1987 1656	


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (C) (INPUT = 0.90)
JSI METAL= 0.33 (F) (INPUT = 1.00)

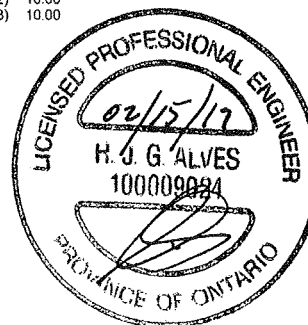

DWG NO. TAM 77903453
STRUCTURAL
COMPONENT ONLY

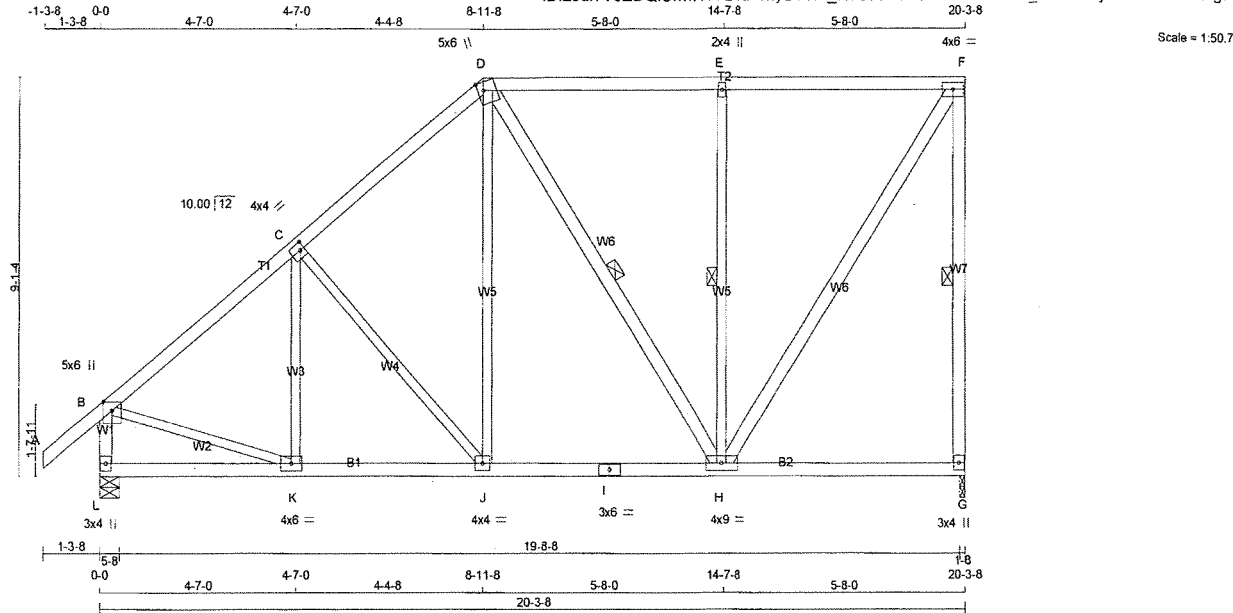

TOTAL WEIGHT = 3 X 112 = 337 lb [M]

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
L - B	2x4	DRY	No.2
L - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TMWW-t	MT20	4.0	4.0	2.00	1.25
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TMVW-t	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	4.0	9.0		
I	BS-t	MT20	3.0	6.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMVW-t	MT20	4.0	6.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG
G	1189	0	1189	0	0	0	1-8	1-8	5-8
L	1297	0	1297	0	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LOASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	909	424 / 0	213 / 0	0 / 0	0 / 0	272 / 0	0 / 0
L	984	482 / 0	213 / 0	0 / 0	0 / 0	289 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.65 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.


1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H, E-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	K-C	-53 / 114
B-C	-1111 / 0	-77.7	-77.7	0.29 (1)	5.65	C-J	-293 / 0
C-D	-916 / 0	-77.7	-77.7	0.28 (1)	6.09	J-D	0 / 430
D-E	-603 / 0	-77.7	-77.7	0.43 (1)	6.25	D-H	-154 / 0
E-F	-603 / 0	-77.7	-77.7	0.43 (1)	6.25	H-E	-545 / 0
G-F	-1099 / 0	0.0	0.0	0.42 (1)	6.04	H-F	0 / 1109
L-B	-1222 / 0	0.0	0.0	0.13 (1)	7.25	B-K	0 / 908
L-K	0 / 0	-39.5	-39.5	0.14 (3)	10.00		
K-J	0 / 874	-39.5	-39.5	0.26 (2)	10.00		
J-I	0 / 686	-39.5	-39.5	0.33 (2)	10.00		
I-H	0 / 686	-39.5	-39.5	0.33 (2)	10.00		
H-G	0 / 0	-39.5	-39.5	0.25 (3)	10.00		

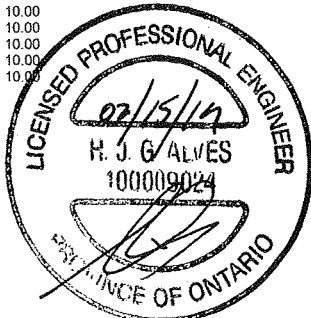

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9	PSF
	DL = 6.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 44.8	PSF

SPACING = 24.0 IN. CIC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.68")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.68")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.43/1.00 (E-F.1), BC=0.33/1.00 (H-J.2), WB=0.29/1.00 (E-H.1), SSI=0.21/1.00 (E-F.1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (F) (INPUT = 0.90)
JSI METAL= 0.43 (B) (INPUT = 1.00)

DWG NO. TAM 17103454
STRUCTURAL
COMPONENT ONLY



TOTAL WEIGHT = 6 X 118 = 709 lb

DRY; SEASONED LUMBER.

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	K-C	0 / 171	0.04 (3)
B-C	-112 / 10	-77.7	-77.7	0.39 (1)	5.52	C-J	-385 / 0	0.44 (1)
C-D	-839 / 0	-77.7	-77.7	0.37 (1)	6.15	J-D	0 / 488	0.11 (2)
D-E	-498 / 0	-77.7	-77.7	0.34 (1)	6.25	H-H	-276 / 0	0.18 (1)
E-F	-498 / 0	-77.7	-77.7	0.34 (1)	6.25	H-E	-486 / 0	0.34 (1)
G-F	-1108 / 0	0.0	0.0	0.55 (1)	6.02	H-F	0 / 1078	0.17 (1)
L-B	-1214 / 0	0.0	0.0	0.13 (1)	7.26	B-K	0 / 905	0.20 (1)
L-K	0 / 0	-39.5	-39.5	0.20 (3)	10.00			
K-J	0 / 877	-39.5	-39.5	0.31 (2)	10.00			
J-I	0 / 624	-39.5	-39.5	0.27 (2)	10.00			
I-H	0 / 624	-39.5	-39.5	0.27 (2)	10.00			
H-G	0 / 0	-39.5	-39.5	0.19 (3)	10.00			

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)


DWG NO. TAM 17203455
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T33	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:57 2019 Page 1

ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-SUZ1DUPFrZ_XuVgWTZ5GRBRQtsksSY?A7BjGujzkvgO

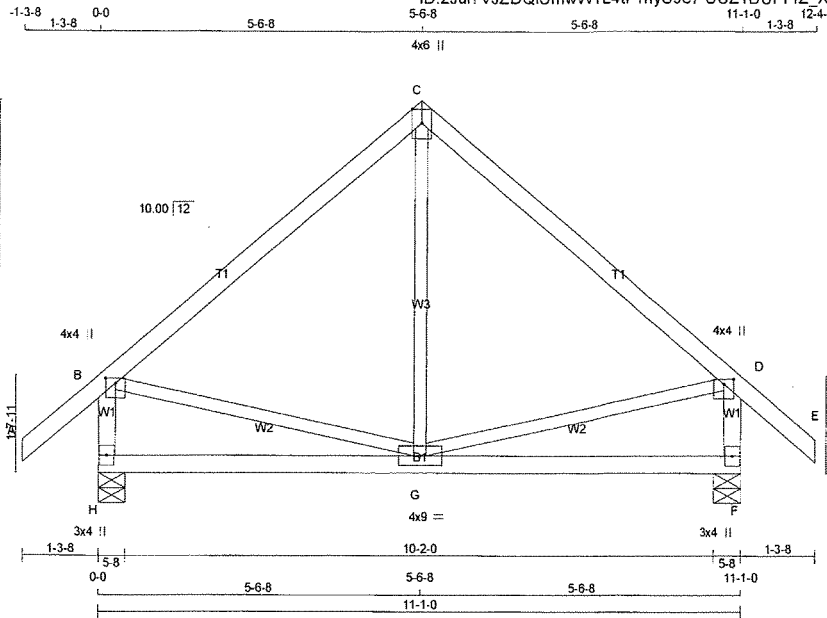

Scale = 1:37.3

TOTAL WEIGHT = 2 X 49 = 99 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
F - D	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-I	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
H	757	0	757	0	0	5-8	5-8	5-8	
F	757	0	757	0	0	5-8	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST CASE	MAX / MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	571	290 / 0	116 / 0	0 / 0	0 / 0	165 / 0	0 / 0	0 / 0	0 / 0
F	571	290 / 0	116 / 0	0 / 0	0 / 0	165 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MAX. MEMB. FORCE (LBS)	MEMB. FORCE (LBS)	MAX. MEMB. FORCE (LBS)	MAX. MEMB. FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	G-C	0 / 251
B-C	-428 / 0	-77.7	-77.7	0.31 (1)	6.25	B-G	0 / 337
C-D	-428 / 0	-77.7	-77.7	0.31 (1)	6.25	G-D	0 / 337
D-E	0 / 34	-77.7	-77.7	0.11 (1)	10.00		
H-B	-674 / 0	0.0	0.0	0.07 (1)	7.81		
F-D	-674 / 0	0.0	0.0	0.07 (1)	7.81		
H-G	0 / 0	-39.5	-39.5	0.28 (3)	10.00		
G-F	0 / 0	-39.5	-39.5	0.28 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	20.9	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	44.8	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.37")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.03")
ALLOWABLE DEFL. (TL) = $L/360$ (0.37")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.31/1.00 (B-C:1), BC=0.28/1.00 (G-H:3), WB=0.08/1.00 (B-G:1), SSI=0.15/1.00 (G-H:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MT20	618	354
	1667	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.61 (B) (INPUT = 0.90)
JSI METAL= 0.17 (B) (INPUT = 1.00)

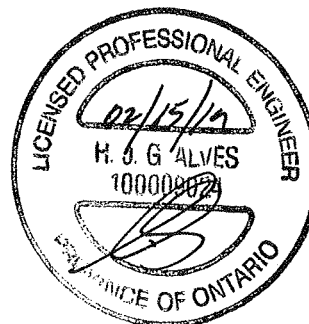


DWG NO. TAM. T7403456
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T33A	10	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

ID:2Jul7VJZDQiUmwWYL4tF1nyS9e7-OshneARVNBFE8pqua_7kXcXmNgQYwSXTaVCMzbzkgvM

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:59 2019 Page 1

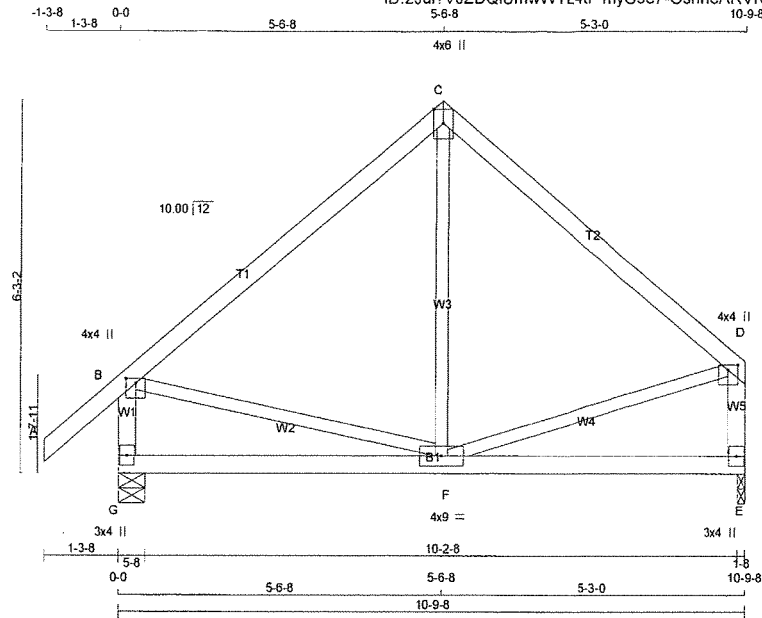

TOTAL WEIGHT = 10 X 47 = 468 lb

LUMBER

N. L. G. A. RULES
CHORDS SIZE

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
G - B	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
G - E	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
G	740	0	740	0
E	632	0	632	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE	PERM. LIVE
G	558	283 / 0	113 / 0	0 / 0
E	483	226 / 0	113 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1	MAX UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1
FR-TO		FROM	TO		FR-TO		
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	F-C	0 / 235
B-C	-403 / 0	-77.7	-77.7	0.31 (1)	6.25	B-F	0 / 317
C-D	-407 / 0	-77.7	-77.7	0.28 (1)	6.25	F-D	0 / 327
G-B	-651 / 0	0.0	0.0	0.07 (1)	7.81		
E-D	-560 / 0	0.0	0.0	0.06 (1)	7.81		
G-F	0 / 0	-39.5	-39.5	0.26 (3)	10.00		
F-E	0 / 0	-39.5	-39.5	0.26 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 20.9 PSF
DL	= 6.0 PSF
BOT CH. LL	= 10.5 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.31/1.00 (B-C:1), BC=0.26/1.00 (E-F:3),
WB=0.07/1.00 (D-F:1), SSI=0.15/1.00 (F-G:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) (INPUT = 0.90)

JSI METAL= 0.16 (B) (INPUT = 1.00)

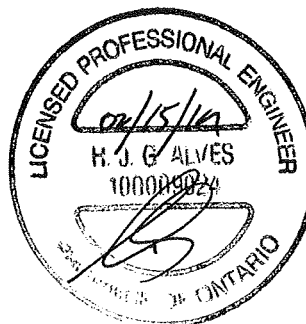


DRWG NO. TAM 77903458
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T75	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:00 2019 Page 1

ID: 2Jul?VJZDQiUmVYL4TF1nyS9e7-s3F9rWS78UM6lzP58fz3q3zH4gGfqScp9xwV2zkvgL

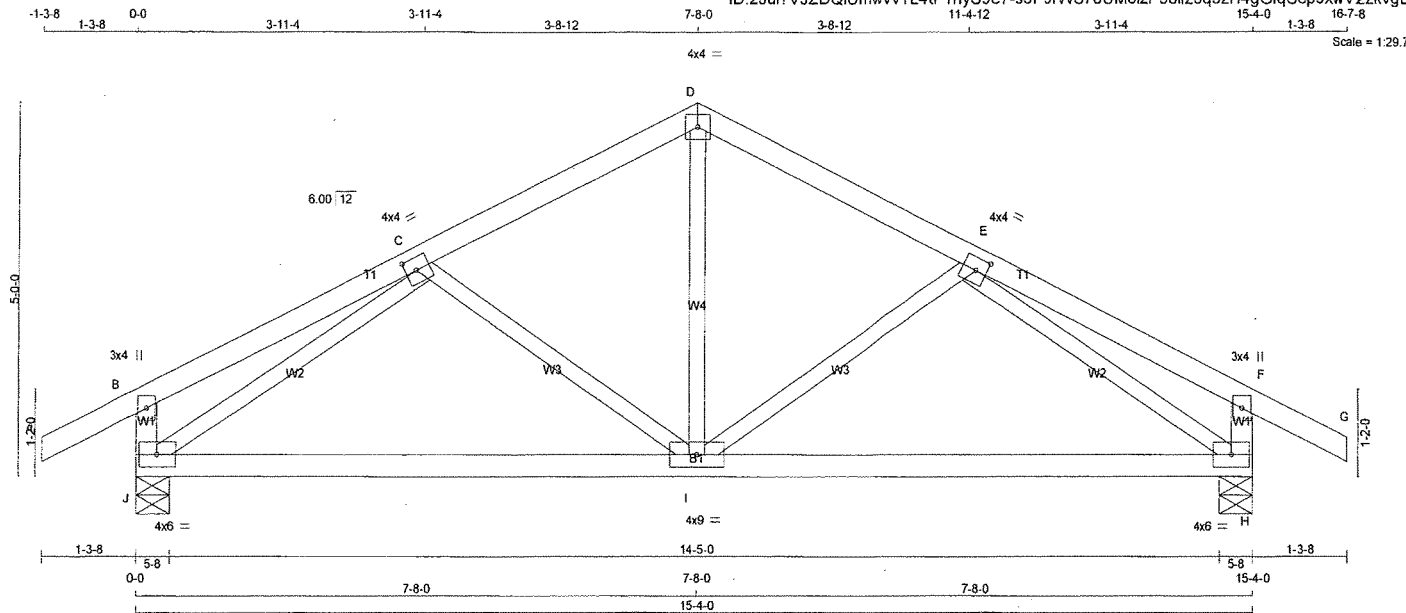

TOTAL WEIGHT = 4 X 60 = 241 lb [M][F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TTW-p	MT20	4.0	4.0		
E	TMWW-t	MT20	4.0	4.0	2.00	1.75
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	6.0		
I	BMWWW-t	MT20	4.0	9.0		
J	BMVW1-t	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
J	1004	0	0	5-8
H	1004	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED
J	760
H	760

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	MAX. FACTORED
MEMB.	FORCE	VERT.	(PLF)	CSI	(LC)	UNBRAC	MEMB.	FORCE
FR-TO	(LBS)	FROM	TO	LENGTH	FR-TO	(LBS)	CSI	(LC)
A-B	0/24	-77.7	-77.7	0.10 (1)	10.00	I-D	0/574	0.13 (2)
B-C	0/14	-77.7	-77.7	0.17 (1)	10.00	I-E	-158/35	0.06 (1)
C-D	-902/0	-77.7	-77.7	0.14 (1)	6.25	C-I	-158/35	0.06 (1)
D-E	-902/0	-77.7	-77.7	0.14 (1)	6.25	J-C	-1137/0	0.41 (1)
E-F	0/14	-77.7	-77.7	0.17 (1)	10.00	E-H	-1137/0	0.41 (1)
F-G	0/24	-77.7	-77.7	0.10 (1)	10.00			
J-B	-223/0	0.0	0.0	0.02 (1)	7.81			
H-F	-223/0	0.0	0.0	0.02 (1)	7.81			
J-I	0/921	-39.5	-39.5	0.62 (2)	10.00			
I-H	0/921	-39.5	-39.5	0.62 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	20.9	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	44.8	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.51")
CALCULATED VERT. DEFL.(LL)= L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.51")
CALCULATED VERT. DEFL.(TL)= L/999 (0.18")

CSI: TC=0.17/1.00 (E-F:1), BC=0.62/1.00 (H-I:2), WB=0.41/1.00 (E-H:1), SS=0.20/1.00 (H-I:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (E) (INPUT = 0.90)
JSI METAL= 0.39 (C) (INPUT = 1.00)

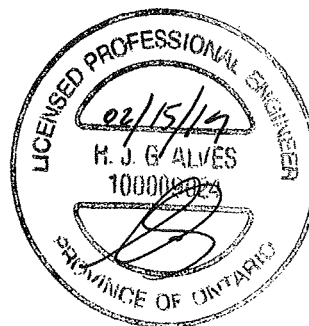


DWG NO. TAM T7903459
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	G75	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:30 2019 Page 1

ID:2Jul?VJZDQIUmwWYL4tF1nyS9e7-IHRpYF4JCGaN9L6KOC6xVqsw_aUdLRBwVgKRnzkgp

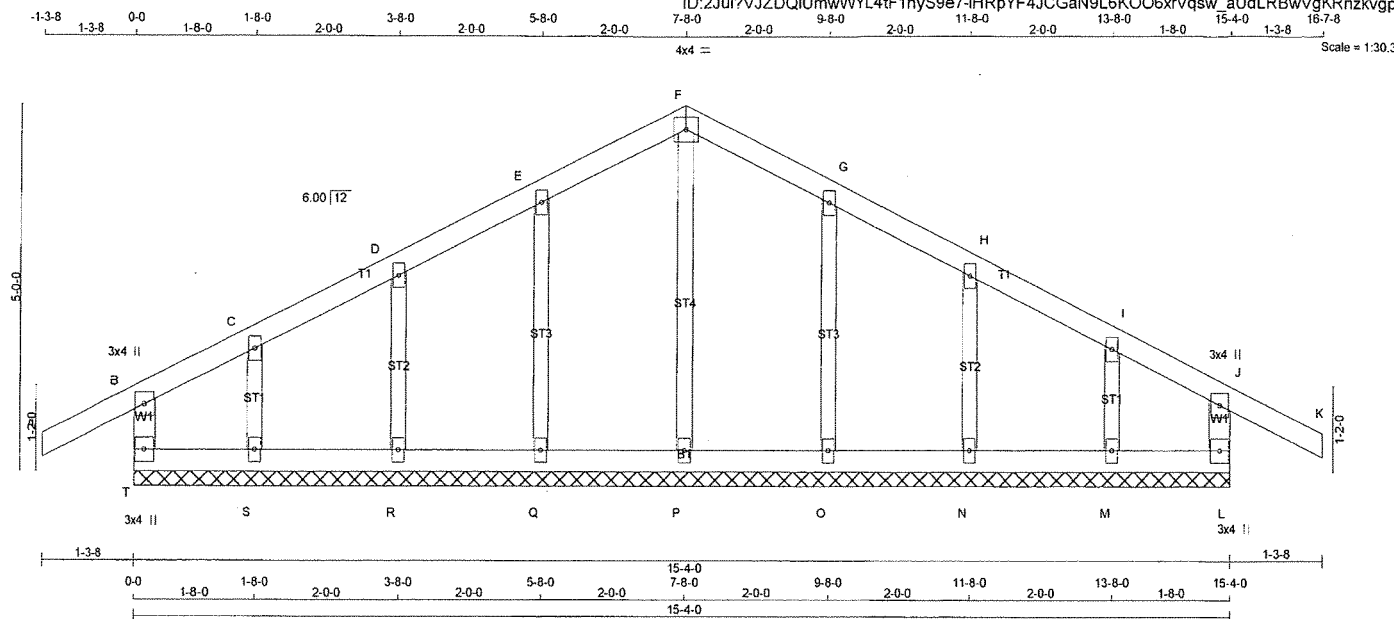

TOTAL WEIGHT = 4 X 58 = 231 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - F	2x4 DRY	No.2	SPF
F - K	2x4 DRY	No.2	SPF
T - B	2x4 DRY	No.2	SPF
L - J	2x4 DRY	No.2	SPF
T - L	2x4 DRY	No.2	SPF

ALL WEBS	2x3 DRY	No.2	SPF
ALL GABLE WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER			

GABLE STUDS SPACED AT 2'-0" O.C.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C, D, E, G, H, I					
C TMW+w	MT20	2.0	4.0		
F TTW+p	MT20	4.0	4.0		
J TMV+p	MT20	3.0	4.0		
L BMV1+p	MT20	3.0	4.0		
M, N, O, P, Q, R, S					
M BMW1+w	MT20	2.0	4.0		
T BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED	FACTORED	MAX. FACTORED	MAX. FACTORED	MAX. FACTORED	MAX. FACTORED
	FORCE	VERT. LOAD LC1	MAX. FORCE	MAX. FORCE	MAX. FORCE	MAX. FORCE
	(LBS)	(PLF)	(LBS)	(LBS)	(LBS)	(LBS)
FR-TO		FROM TO	LENGTH	FR-TO		
A-B	0/24	-77.7 -77.7	0.10 (1)	10.00	P-F	-187/0
B-C	-3/10	-77.7 -77.7	0.06 (1)	10.00	Q-E	-157/0
C-D	0/27	-77.7 -77.7	0.04 (1)	10.00	R-D	-160/0
D-E	0/28	-77.7 -77.7	0.04 (1)	10.00	S-C	-112/0
E-F	0/31	-77.7 -77.7	0.04 (1)	10.00	O-G	-157/0
F-G	0/31	-77.7 -77.7	0.04 (1)	10.00	N-H	-160/0
G-H	0/28	-77.7 -77.7	0.04 (1)	10.00	M-I	-112/0
H-I	0/27	-77.7 -77.7	0.04 (1)	10.00		
I-J	-3/10	-77.7 -77.7	0.06 (1)	10.00		
J-K	0/24	-77.7 -77.7	0.10 (1)	10.00		
T-B	-179/0	0.0 0.0	0.03 (1)	7.81		
L-J	-179/0	0.0 0.0	0.03 (1)	7.81		
T-S	-17/1	-39.5 -39.5	0.02 (3)	6.25		
S-R	-21/0	-39.5 -39.5	0.02 (3)	6.25		
R-Q	-25/0	-39.5 -39.5	0.02 (3)	6.25		
Q-P	-28/0	-39.5 -39.5	0.02 (3)	6.25		
P-O	-28/0	-39.5 -39.5	0.02 (3)	6.25		
O-N	-25/0	-39.5 -39.5	0.02 (3)	6.25		
N-M	-21/0	-39.5 -39.5	0.02 (3)	6.25		
M-L	-17/1	-39.5 -39.5	0.02 (3)	6.25		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
DL = 6.0 PSF	
BOT CH.	LL = 10.5 PSF
DL = 7.4 PSF	
TOTAL LOAD = 44.8 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.10/1.00 (J-K-1), BC=0.02/1.00 (R-S-3), WB=0.07/1.00 (F-P-1), SSI=0.07/1.00 (J-K-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (F) (INPUT = 0.90)

JSI METAL= 0.07 (H) (INPUT = 1.00)

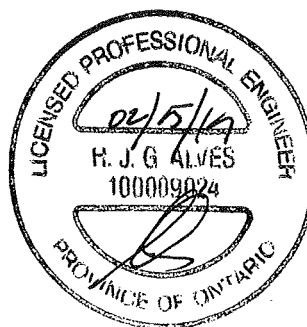


DWG NO. TAM 17903460
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T76	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MITek Industries, Inc. Fri Feb 15 12:10:01 2019 Page 1

ID:2Jul7VJZDQiUmwWYL4tF1nyS9e7-LFoX2sSlvoUzN6_HiPACc1c5tTz_OC0i2phT1UzkgvK

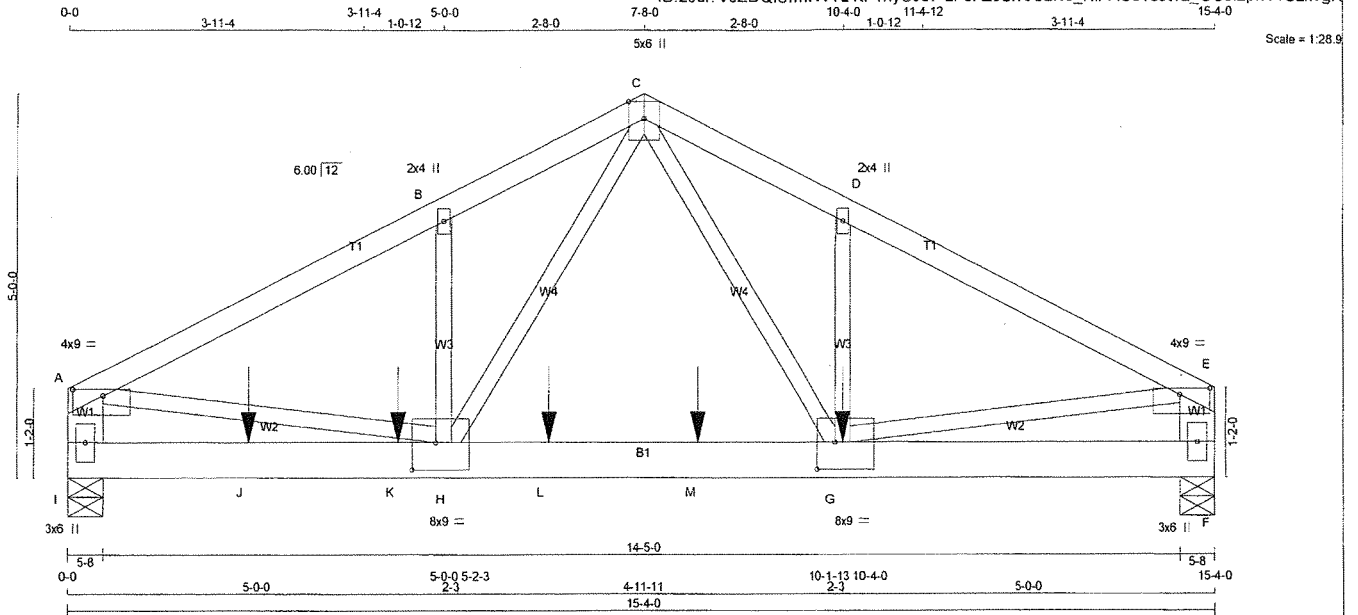

TOTAL WEIGHT = 2 X 70 = 139 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
I - A	2x6 DRY	No.2	SPF		
F - E	2x6 DRY	No.2	SPF		
I - F	2x6 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - E	12	TOP
I - A	12	TOP
F - E	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I - F	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
D - G	3	SIDE (434.2)
2x3	6	
B - H	3	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	9.0	1.00	4.75
B	TMVW+w	MT20	2.0	4.0		
C	TTVW+p	MT20	5.0	6.0	Edge	
D	TMVW+w	MT20	2.0	4.0		
E	TMVW+p	MT20	4.0	9.0	1.00	4.75
F	BMV1+p	MT20	3.0	6.0		
G	BMVWVW-t	MT20	8.0	9.0	4.25	2.75
H	BMVWVW-t	MT20	8.0	9.0	4.25	3.75
I	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	GROSS REACTION	IN-SX	BRG
I	4356	0	4356	0	5-8
F	3937	0	3937	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL
I	COMBINED	SNOW LIVE PERM.LIVE WIND	975 / 0	0 / 0
F	2988	1459 / 0 649 / 0 0 / 0 0 / 0	879 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	LENGTH	FR-TO	
A - B	-6281 / 0	-77.7 -77.7	0.37 (1)	3.66	G - D -328 / 0
B - C	-6284 / 0	-77.7 -77.7	0.18 (1)	3.78	G - E 0 / 5785
C - D	-6368 / 0	-77.7 -77.7	0.18 (1)	3.78	H - B -329 / 0
D - E	-6366 / 0	-77.7 -77.7	0.37 (1)	3.63	A - H 0 / 5689
I - A	-3851 / 0	0.0 0.0	0.14 (1)	7.21	H - C 0 / 3073
F - E	-3901 / 0	0.0 0.0	0.14 (1)	7.17	C - G 0 / 3227
I - J	0 / 0	-39.5 -39.5	0.51 (1)	10.00	
J - K	0 / 0	-39.5 -39.5	0.51 (1)	10.00	
K - H	0 / 0	-39.5 -39.5	0.51 (1)	10.00	
H - L	0 / 4098	-39.5 -39.5	0.78 (1)	10.00	
L - M	0 / 4098	-39.5 -39.5	0.78 (1)	10.00	
M - G	0 / 4098	-39.5 -39.5	0.78 (1)	10.00	
G - F	0 / 0	-39.5 -39.5	0.12 (2)	10.00	

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	10-4-0	-2366	-2366		FRONT	VERT	TOTAL		
J	2-4-12	-1032	-1032		FRONT	VERT	TOTAL		
K	4-4-12	-1032	-1032		FRONT	VERT	TOTAL		
L	6-4-12	-1032	-1032		FRONT	VERT	TOTAL		
M	8-4-12	-1032	-1032		FRONT	VERT	TOTAL		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
	DL = 6.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.51")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.51")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.37/1.00 (D-E:1), BC=0.78/1.00 (G-H:1), WB=0.71/1.00 (E-G:1), SSI=0.58/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) (INPUT = 0.90)
JSI METAL= 0.54 (E) (INPUT = 1.00)

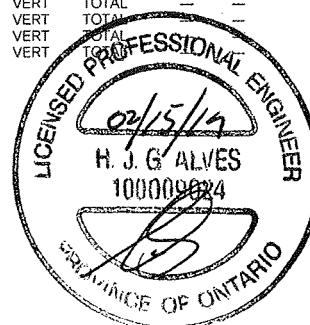


DWG NO. TAM 17403461
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T76Z	2	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:02 2019 Page 1
ID:2Jul?VJZDQIUmwWYL4tF1nyS9e7-pRMvGCTNf6cq?GYTG7hR8F9GdtJD7fGvHTQ1ZwzkvgJ

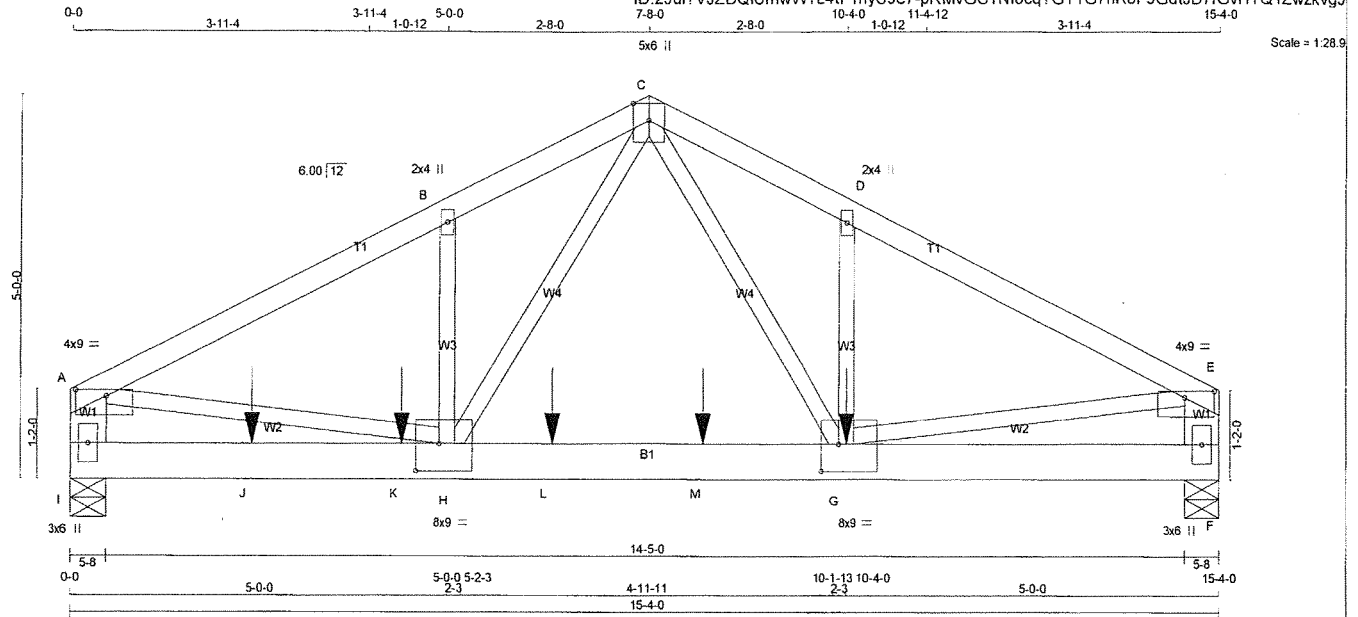

TOTAL WEIGHT = 4 X 70 = 279 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
I - A	2x6	DRY	No.2	SPF	
F - E	2x6	DRY	No.2	SPF	
I - F	2x6	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - E 1	12	TOP
I - A 2	12	TOP
F - E 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I - F 2	12	SIDE(183.1)
D - G 1	3	SIDE(434.2)
2x3 1	6	
B - H 1	3	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	9.0	1.00	4.75
B	TMW+w	MT20	2.0	4.0		
C	TTWV+p	MT20	5.0	6.0	Edge	
D	TMW+w	MT20	2.0	4.0		
E	TMVW-p	MT20	4.0	9.0	1.00	4.75
F	BMV1+p	MT20	3.0	6.0		
G	BMVWW-t	MT20	8.0	9.0	4.25	2.75
H	BMVWW-t	MT20	8.0	9.0	4.25	2.75
I	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	BRG
I	4356	0	0	4356	0	0	5-8	5-8	
F	3937	0	0	3937	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LCASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	3309	1607 / 0	726 / 0	0 / 0	0 / 0	975 / 0	0 / 0
F	2988	1459 / 0	649 / 0	0 / 0	0 / 0	879 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	MAX.	CS1 (LC)	MEMB.	FORCE (LBS)	MAX.	CS1 (LC)
FR-TO		FROM	TO			FR-TO			
A-B	-6281 / 0	-77.7	-77.7	0.37 (1)	3.66	G-D	-328 / 0	0.04 (1)	
B-C	-6284 / 0	-77.7	-77.7	0.18 (1)	3.78	G-E	0 / 5765	0.71 (1)	
C-D	-6368 / 0	-77.7	-77.7	0.18 (1)	3.76	H-B	-329 / 0	0.04 (1)	
D-E	-6366 / 0	-77.7	-77.7	0.37 (1)	3.63	A-H	0 / 5689	0.70 (1)	
I-A	-3851 / 0	0.0	0.0	0.14 (1)	7.21	H-C	0 / 3073	0.38 (1)	
F-E	-3901 / 0	0.0	0.0	0.14 (1)	7.17	C-G	0 / 3227	0.40 (1)	
I-J	0 / 0	-39.5	-39.5	0.51 (1)	10.00				
J-K	0 / 0	-39.5	-39.5	0.51 (1)	10.00				
K-H	0 / 0	-39.5	-39.5	0.51 (1)	10.00				
H-L	0 / 4098	-39.5	-39.5	0.78 (1)	10.00				
L-M	0 / 4098	-39.5	-39.5	0.78 (1)	10.00				
M-G	0 / 4098	-39.5	-39.5	0.78 (1)	10.00				
G-F	0 / 0	-39.5	-39.5	0.12 (2)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	10-4-0	-2366	-2366		BACK	VERT	TOTAL		
J	2-4-12	-1032	-1032		BACK	VERT	TOTAL		
K	4-4-12	-1032	-1032		BACK	VERT	TOTAL		
L	6-4-12	-1032	-1032		BACK	VERT	TOTAL		
M	8-4-12	-1032	-1032		BACK	VERT	TOTAL		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
DL = 6.0 PSF	
BOT CH.	LL = 10.5 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.51")
CALCULATED VERT. DEFL.(LL)= L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.51")
CALCULATED VERT. DEFL.(TL)= L/999 (0.18")

CSI: TC=0.37/1.00 (D-E:1), BC=0.78/1.00 (G-H:1), VB=0.71/1.00 (E-G:1), SS=0.58/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687
	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (H) (INPUT = 0.90)
JSI METAL= 0.54 (E) (INPUT = 1.00)

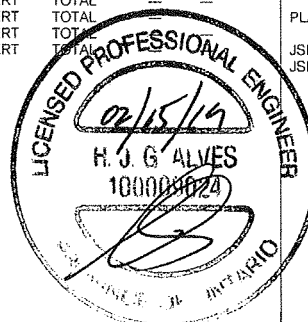

DRWG NO. TAM T76Z 3462
STRUCTURAL
COMPONENT ONLY

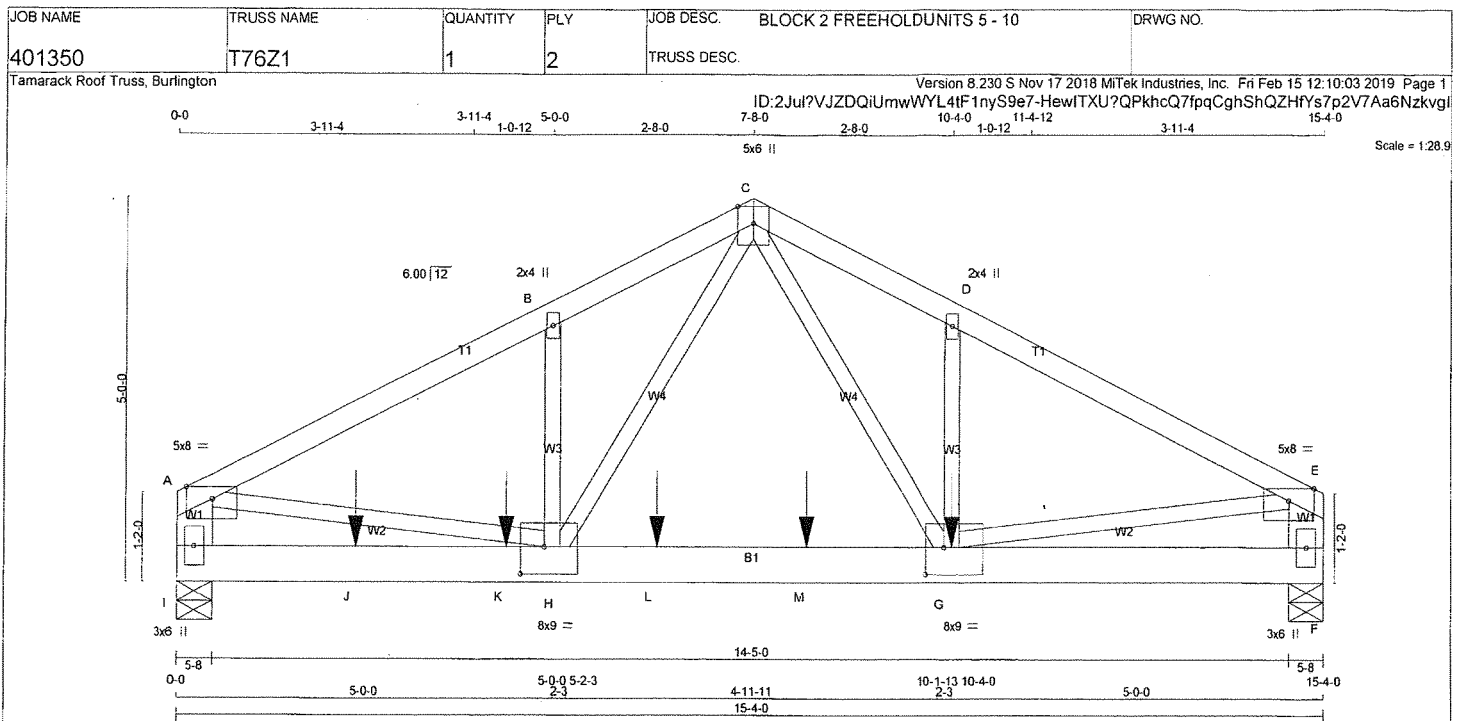

TOTAL WEIGHT = 2 X 70 = 139 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
I - A	2x6	DRY No.2	SPF
F - E	2x6	DRY No.2	SPF
I - F	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - E	12	TOP
I - A	12	TOP
F - E	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
I - F	12	SIDE (183.1)
WEBS: (0.122"x3") SPIRAL NAILS		
D - G	3	SIDE (394.1)
2x3	1	
B - H	3	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWV-p	MT20	5.0	8.0	Edge	
B	TMW+w	MT20	2.0	4.0		
C	TTWVW+p	MT20	5.0	6.0	Edge	
D	TMW+w	MT20	2.0	4.0		
E	TMWV-p	MT20	5.0	8.0	Edge	
F	BMV1+p	MT20	3.0	6.0		
G	BMWVWV-t	MT20	8.0	9.0	4.25	2.75
H	BMWVWV-t	MT20	8.0	9.0	4.25	3.75
I	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION	DOWN	GROSS REACTION	UP		
JT	VERT	HORZ	DOWN	HORZ	BRG	BRG
I	4305	0	4305	0	5-8	5-8
F	3834	0	3834	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	3273	1580 / 0	726 / 0	0 / 0	0 / 0	967 / 0	0 / 0
F	2916	1403 / 0	649 / 0	0 / 0	0 / 0	863 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.69 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	-6194 / 0	-77.7	-77.7	0.36 (1)	3.69	G-D	-330 / 0	0.04 (1)	
B-C	-6197 / 0	-77.7	-77.7	0.18 (1)	3.81	G-E	0 / 5610	0.69 (1)	
C-D	-6197 / 0	-77.7	-77.7	0.18 (1)	3.81	H-B	-330 / 0	0.04 (1)	
D-E	-6194 / 0	-77.7	-77.7	0.36 (1)	3.69	A-H	0 / 5610	0.69 (1)	
I-A	-3800 / 0	0.0	0.0	0.13 (1)	7.25	H-C	0 / 3084	0.38 (1)	
F-E	-3800 / 0	0.0	0.0	0.13 (1)	7.25	C-G	0 / 3084	0.38 (1)	
I-J	0 / 0	-39.5	-39.5	0.51 (1)	10.00				
J-K	0 / 0	-39.5	-39.5	0.51 (1)	10.00				
K-H	0 / 0	-39.5	-39.5	0.51 (1)	10.00				
H-L	0 / 4014	-39.5	-39.5	0.77 (1)	10.00				
L-M	0 / 4014	-39.5	-39.5	0.77 (1)	10.00				
M-G	0 / 4014	-39.5	-39.5	0.77 (1)	10.00				
G-F	0 / 0	-39.5	-39.5	0.12 (2)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	10-4-0	-2212	-2212	---	BACK	VERT	TOTAL	---	---
J	2-4-12	-1032	-1032	---	BACK	VERT	TOTAL	---	---
K	4-4-12	-1032	-1032	---	BACK	VERT	TOTAL	---	---
L	6-4-12	-1032	-1032	---	BACK	VERT	TOTAL	---	---
M	8-4-12	-1032	-1032	---	BACK	VERT	TOTAL	---	---

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	20.9	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	44.8	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.51")
CALCULATED VERT. DEFL.(LL)= L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.51")
CALCULATED VERT. DEFL.(TL)= L/999 (0.18")

CSI: TC=0.36/1.00 (D-E:1), BC=0.77/1.00 (G-H:1), WB=0.69/1.00 (E-G:1), SSI=0.58/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
	MAX	MIN	MAX MIN
MT20	618	354	1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.46 (A) (INPUT = 1.00)

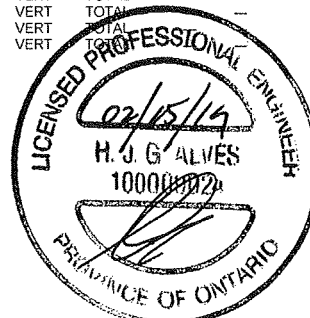

DWG NO. TAM 77903463
STRUCTURAL
COMPONENT ONLY

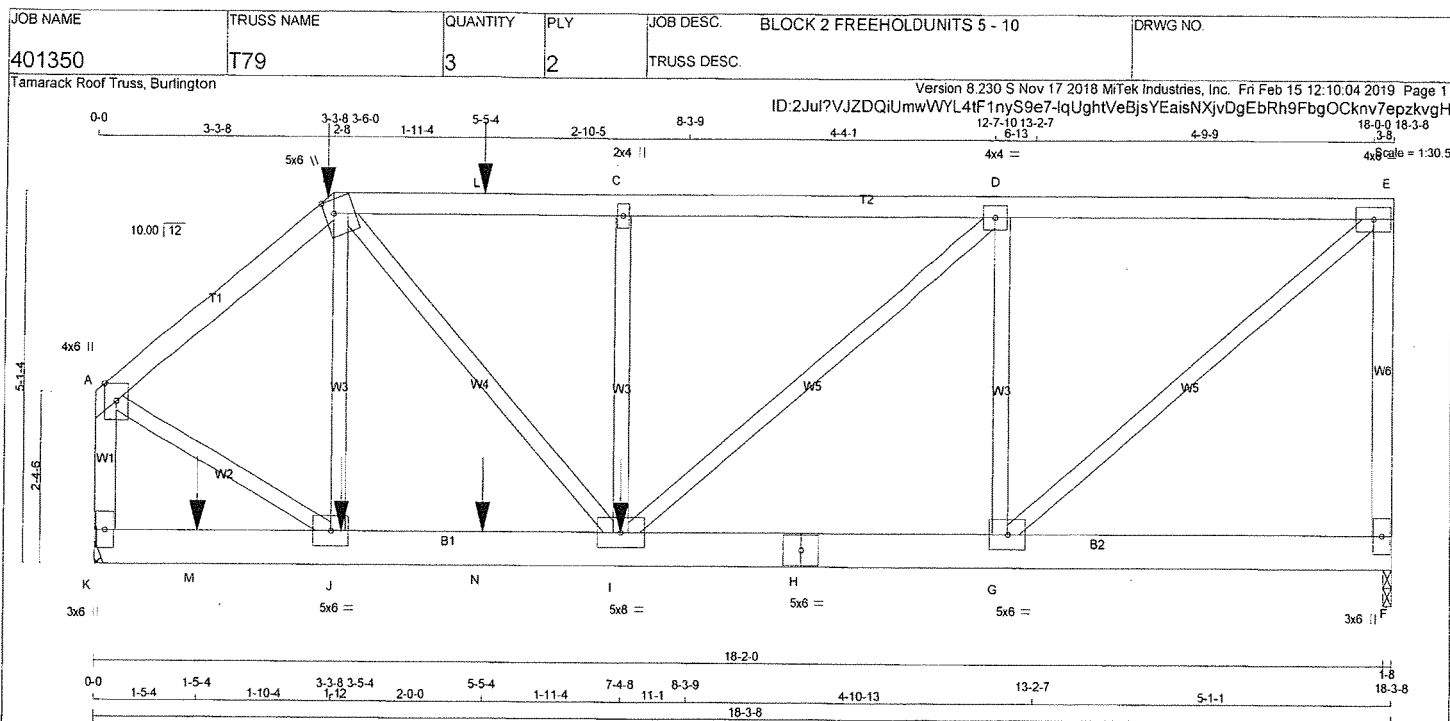

TOTAL WEIGHT = 6 X 91 = 547 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
K - H	2x6	DRY	No.2
H - F	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B 1 12		SIDE(61.0)
B-E 1 12		SIDE(61.0)
E-F 1 12		TOP
K-A 1 12		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K-H 2 12		SIDE(183.1)
H-F 2 12		TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		
I-C 1 6		SIDE(202.4)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0	Edge	
B	TTVW+m	MT20	5.0	6.0	2.25	1.50
C	TMVW+w	MT20	2.0	4.0		
D	TMVW-l	MT20	4.0	4.0		
E	TMVW-i	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	6.0		
G	BMVW-l	MT20	5.0	6.0		
H	BS-i	MT20	5.0	6.0		
I	BMVWV-l	MT20	5.0	8.0		
J	BMVW-l	MT20	5.0	6.0		
K	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
F	1782	0	1782	0	1-8	1-8
K	2406	0	2406	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	1351	664/0	291/0	0/0	0/0	396/0	0/0
K	1824	896/0	391/0	0/0	0/0	537/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.35 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (L)	MAX. UNBRAC	MEMB.	MAX. FORCE (LBS)	MAX. CSI (L)		
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	-2044/0	-77.7	-77.7	0.10 (1)	6.07	J-B	-551/0	0.10 (1)	
B-L	-2657/0	-77.7	-77.7	0.16 (1)	5.42	A-J	0/1804	0.22 (1)	
L-C	-2657/0	-77.7	-77.7	0.16 (1)	5.42	G-E	0/2343	0.29 (1)	
C-D	-2657/0	-77.7	-77.7	0.22 (1)	5.35	B-I	0/1684	0.21 (1)	
D-E	-1784/0	-77.7	-77.7	0.20 (1)	6.24	G-D	0/1684	0.21 (1)	
F-E	-1693/0	0.0	0.0	0.35 (1)	7.81	I-C	0/1684	0.21 (1)	
K-A	-2339/0	0.0	0.0	0.15 (1)	7.34	I-C	0/1684	0.21 (1)	
K-M	0/0	-39.5	-39.5	0.05 (2)	10.00				
M-J	0/0	-39.5	-39.5	0.05 (2)	10.00				
J-N	0/1553	-39.5	-39.5	0.15 (1)	10.00				
N-I	0/1553	-39.5	-39.5	0.15 (1)	10.00				
I-H	0/1784	-39.5	-39.5	0.16 (1)	10.00				
H-G	0/1784	-39.5	-39.5	0.16 (1)	10.00				
G-F	0/0	-39.5	-39.5	0.06 (3)	10.00				

02/15/10

H. J. G. ALVAREZ

10000902

LICENSED PROFESSIONAL

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.
B	3-3-8	-36	-41	---	FRONT	VERT
B	3-3-8	-100	-100	---	BACK	VERT
B	3-3-8	-152	-152	---	FRONT	VERT
I	7-4-8	-1478	-1478	---	BACK	VERT
J	3-5-4	-62	-78	---	BACK	VERT
L	5-5-4	-94	-94	---	BACK	VERT
M	1-5-4	-62	-78	---	BACK	VERT
N	5-5-4	-62	-78	---	BACK	VERT

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 20.9 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.4 PSF
TOTAL LOAD = 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.35/1.00 (E-F:1), BC=0.16/1.00 (G-I:1), WB=0.29/1.00 (E-G:1), SSI=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.77 (A) (INPUT = 0.90)
JSI METAL= 0.44 (A) (INPUT = 1.00)

DRWG NO. TAM 71203464
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T80	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:05 2019 Page 1
ID:2Jul?VJZDQIUmwWYL4tF1nyS9e7-D022uDWGy1_PskH2xFE9mntnq5RIK55LzRfhAFzkvgG

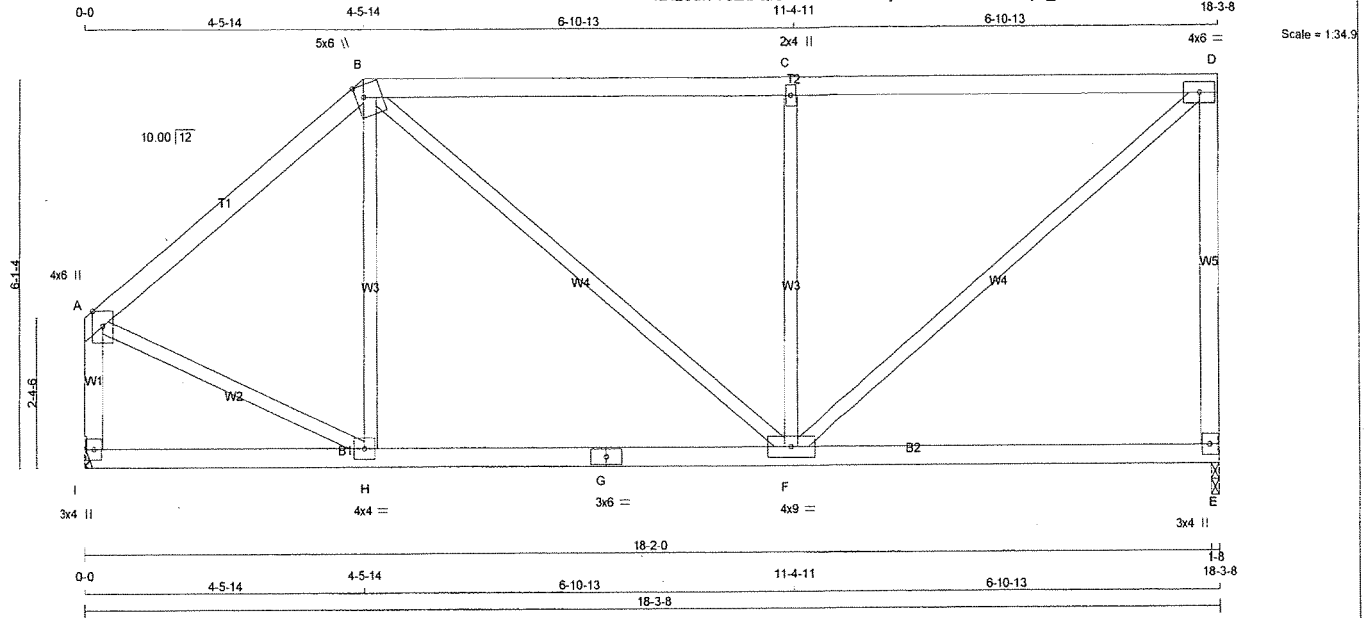

TOTAL WEIGHT = 3 X 79 = 236 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2
B - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
I - A	2x4	DRY	No.2
I - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - B	TMVW+p	MT20	4.0	6.0	Edge
B - D	TTWW+m	MT20	5.0	6.0	2.25 1.50
C - D	TMW+w	MT20	2.0	4.0	
D - E	TMVW-t	MT20	4.0	6.0	
E - F	BMV1+p	MT20	3.0	4.0	
F - G	BMWW-t	MT20	4.0	9.0	
G - H	BS-t	MT20	3.0	6.0	
H - I	BMWW-t	MT20	4.0	4.0	
I - E	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ UPLIFT		
E	1072	0	1072	0	1-8	1-8
I	1072	0	1072	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0
I	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.30 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	-848 / 0	-77.7	-77.7	0.29 (1)	6.23	H-B	-49 / 135 0.03 (3)		
B-C	-905 / 0	-77.7	-77.7	0.68 (1)	5.30	B-F	0 / 335 0.08 (1)		
C-D	-905 / 0	-77.7	-77.7	0.68 (1)	5.30	F-C	-664 / 0 0.39 (1)		
E-D	-962 / 0	0.0	0.0	0.69 (1)	7.81	F-D	0 / 1180 0.27 (1)		
I-A	-1006 / 0	0.0	0.0	0.13 (1)	7.80	A-H	0 / 711 0.16 (1)		
I-H	0 / 0	-39.5	-39.5	0.21 (3)	10.00				
H-G	0 / 649	-39.5	-39.5	0.43 (2)	10.00				
G-F	0 / 649	-39.5	-39.5	0.43 (2)	10.00				
F-E	0 / 0	-39.5	-39.5	0.36 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9	PSF
	DL = 6.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 44.8	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.61")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.09")
ALLOWABLE DEFL. (TL) = $L/360$ (0.61")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.15")

CSI: TC=0.69/1.00 (D-E:1), BC=0.43/1.00 (F-H:2),
WB=0.39/1.00 (C-F:1), SS=0.26/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (H) (INPUT = 0.90)
JSI METAL= 0.40 (A) (INPUT = 1.00)



DWG NO. TAM 17903465
STRUCTURAL
COMPONENT ONLY

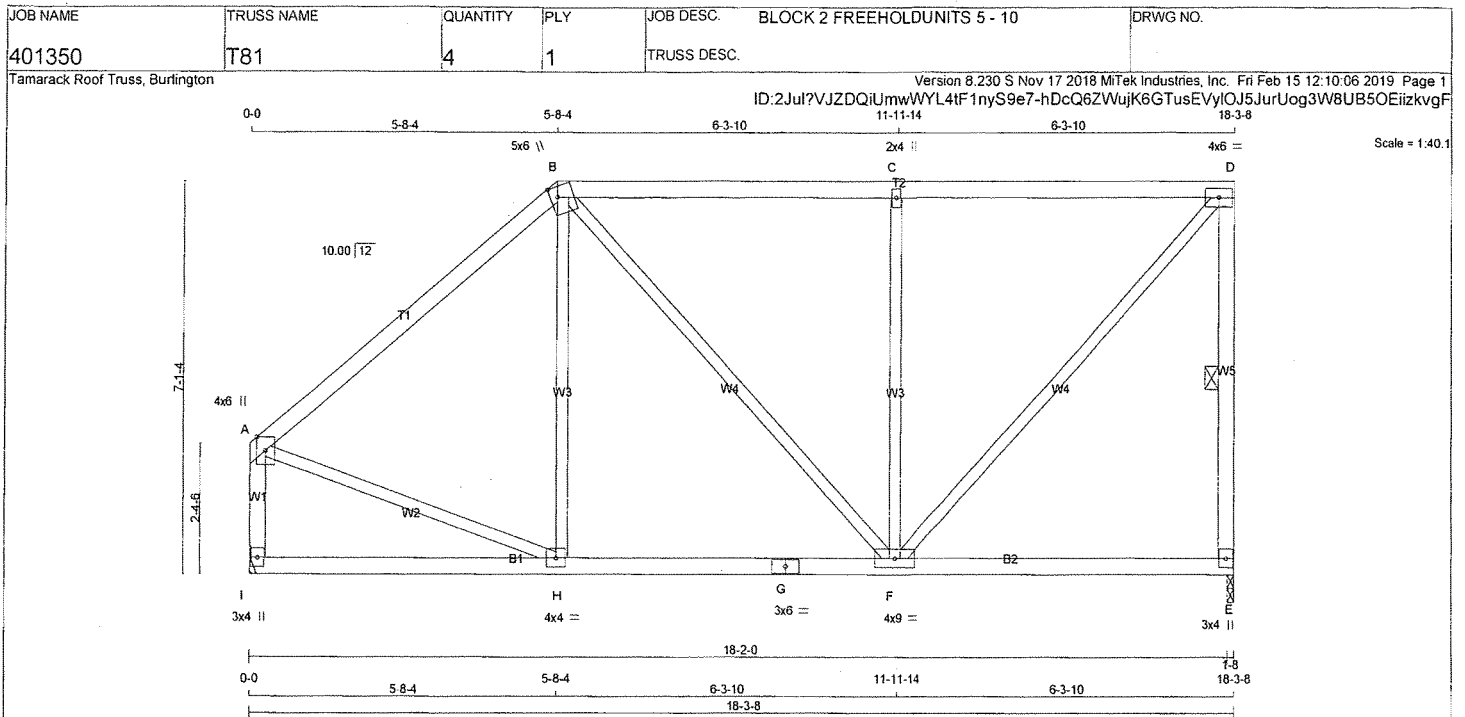

TOTAL WEIGHT = 4 X 83 = 333 lb [M]

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
I - A	2x4	DRY	No.2
I - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0	Edge	
B	TTWW+m	MT20	5.0	6.0	2.25	1.50
C	TMVW+w	MT20	2.0	4.0		
D	TMVW-t	MT20	4.0	6.0		
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BS-t	MT20	3.0	6.0		
H	BMVWW-t	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	UPLIFT	IN-SX	BRG	IN-SX
E	1072	0	0	1072	0	0	1-8	1-8	
I	1072	0	0	1072	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0
I	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-E.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED MAX. CS (LC)
FR-TO		FROM TO	LENGTH FR-TO
A-B	-834 / 0	-77.7 -77.7	0.49 (1) 5.96
B-C	-729 / 0	-77.7 -77.7	0.55 (1) 6.07
C-D	-729 / 0	-77.7 -77.7	0.55 (1) 6.07
E-D	-970 / 0	0.0 0.0	0.22 (1) 6.25
I-A	-980 / 0	0.0 0.0	0.12 (1) 7.81
I-H	0 / 0	-39.5 -39.5	0.24 (3) 10.00
H-G	0 / 640	-39.5 -39.5	0.36 (2) 10.00
G-F	0 / 640	-39.5 -39.5	0.36 (2) 10.00
F-E	0 / 0	-39.5 -39.5	0.28 (3) 10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	20.9 PSF
DL	=	8.0 PSF
BOT CH. LL	=	10.5 PSF
DL	=	7.4 PSF
TOTAL LOAD	=	44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.61")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.06")
ALLOWABLE DEFL. (TL) = $L/360$ (0.61")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.11")

CSI: TC=0.55/1.00 (C-D:1), BC=0.36/1.00 (F-H:2), WB=0.53/1.00 (C-F:1), SSI=0.24/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.82 (H) (INPUT = 0.90)
SI METAL= 0.41 (A) (INPUT = 1.00)

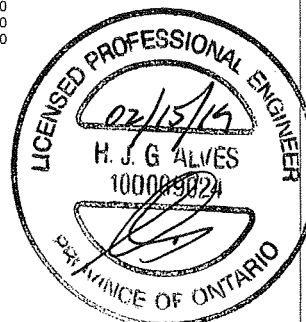


DWG NO. TAM 71903466
STRUCTURAL
COMPONENT ONLY

JOB NAME 401350	TRUSS NAME T82	QUANTITY 4	PLY 1	JOB DESC. BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:07 2019 Page 1

ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-9PAoJvXVUeE751RR2gHdrls5Mu6SoxpeQl8nF8zkvgE

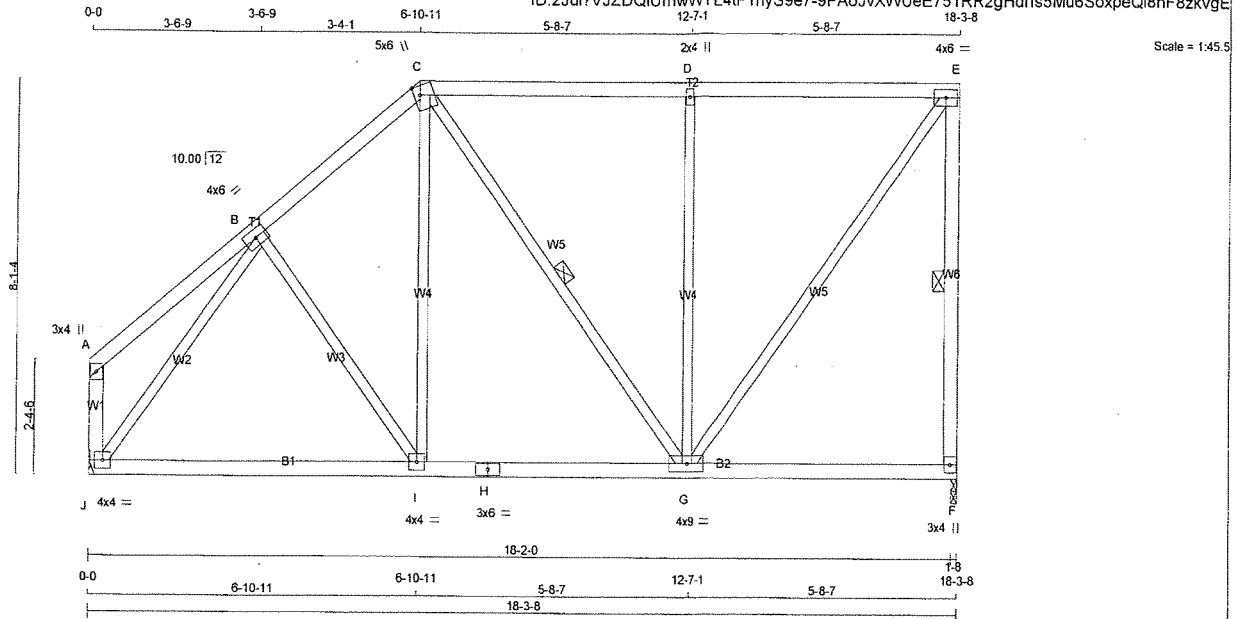

TOTAL WEIGHT = 4 X 92 = 367 lb

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
J - A	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-t	MT20	4.0	6.0		
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMW+w	MT20	2.0	4.0		
E	TMVW-t	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMWWW-t	MT20	4.0	9.0		
H	BS-t	MT20	3.0	6.0		
I	BMWW-t	MT20	4.0	4.0		
J	BMVW-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
F	1072	0	1072	0
J	1072	0	1072	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
F	819 382 / 0 192 / 0 0 / 0 0 / 0 245 / 0 0 / 0
J	819 382 / 0 192 / 0 0 / 0 0 / 0 245 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, C-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 19	-77.7 -77.7	0.14 (1)	10.00	B-I	0 / 89	0.02 (3)
B-C	-817 / 0	-77.7 -77.7	0.15 (1)	6.25	I-C	0 / 314	0.07 (2)
C-D	-593 / 0	-77.7 -77.7	0.44 (1)	6.25	C-G	-56 / 0	0.04 (3)
D-E	-593 / 0	-77.7 -77.7	0.44 (1)	6.25	G-D	-548 / 0	0.69 (1)
F-E	-977 / 0	0.0 0.0	0.29 (1)	6.25	G-E	0 / 1002	0.23 (1)
J-A	-102 / 0	0.0 0.0	0.01 (1)	7.81	J-B	-1045 / 0	0.63 (1)
J-I	0 / 600	-39.5 -39.5	0.38 (2)	10.00			
I-H	0 / 615	-39.5 -39.5	0.39 (2)	10.00			
H-G	0 / 615	-39.5 -39.5	0.39 (2)	10.00			
G-F	0 / 0	-39.5 -39.5	0.20 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	20.9	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	44.8	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.44/1.00 (D-E:1), BC=0.39/1.00 (G-I:2), WB=0.69/1.00 (D-G:1), GSI=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.31 (H) (INPUT = 1.00)

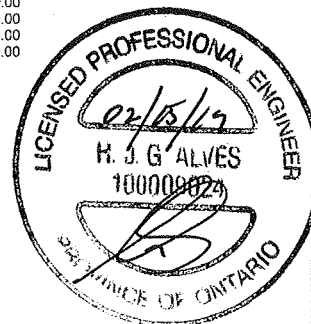


DWG NO. TAM 11903467
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T83	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:08 2019 Page 1

ID:2Jul7VJZDQiUmwWYL4tF1nyS9e7-dbkBWFY8FyM_jB0dcNosOWPhylUcXUnnfPILnazkvgD

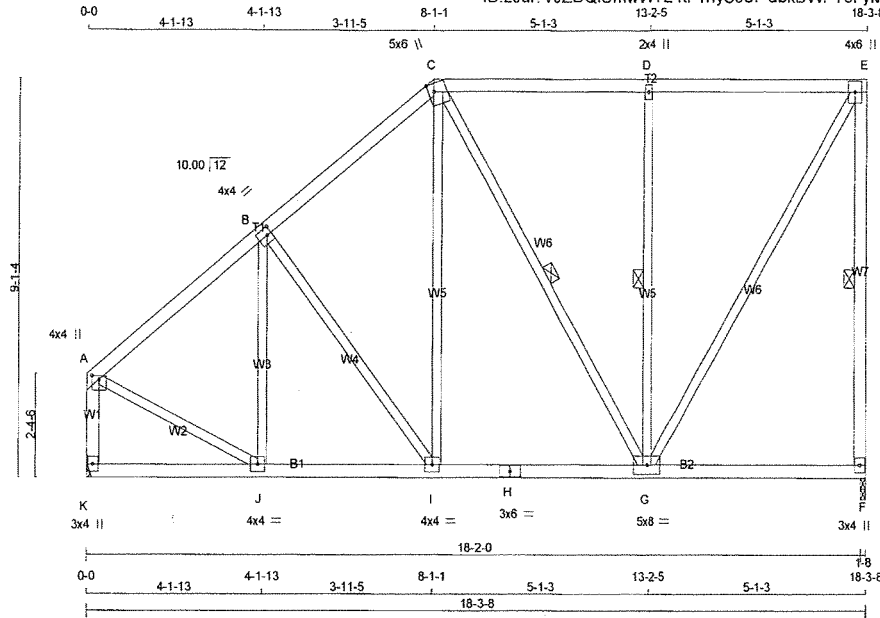

Scale = 1:50.7

TOTAL WEIGHT = 4 X 99 = 398 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
K - A	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW+p	MT20	4.0	4.0	1.00	2.00
B	TMWW-t	MT20	4.0	4.0	2.00	1.25
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMWW-w	MT20	2.0	4.0		
E	TMWW+p	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMWWW-t	MT20	5.0	8.0		
H	BS-t	MT20	3.0	6.0		
I	BMWW-t	MT20	4.0	4.0		
J	BMWW-t	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
F	1072	0	0	1-8
K	1072	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 1-8.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0
K	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, C-G, D-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-843 / 0	-77.7	-77.7 0.23 (1)	J-B	-147 / 48	0.08 (1)	
B-C	-747 / 0	-77.7	-77.7 0.22 (1)	B-I	-189 / 0	0.16 (1)	
C-D	-489 / 0	-77.7	-77.7 0.34 (1)	I-C	0 / 344	0.08 (2)	
D-E	-489 / 0	-77.7	-77.7 0.34 (1)	C-G	-138 / 0	0.10 (1)	
F-E	-991 / 0	0.0	0.0 0.38 (1)	G-D	-489 / 0	0.26 (1)	
K-A	-1005 / 0	0.0	0.0 0.13 (1)	G-E	0 / 970	0.22 (1)	
				A-J	0 / 741	0.17 (1)	
K-J	0 / 0	-39.5	-39.5 0.12 (3)				
J-I	0 / 666	-39.5	-39.5 0.21 (2)				
I-H	0 / 557	-39.5	-39.5 0.27 (2)				
H-G	0 / 557	-39.5	-39.5 0.27 (2)				
G-F	0 / 0	-39.5	-39.5 0.20 (3)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	20.9	PSF
	DL =	6.0	PSF
BOT CH.	LL =	10.5	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	44.8	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.61")
CALCULATED VERT. DEFL.(LL)= L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.61")
CALCULATED VERT. DEFL.(TL)= L/999 (0.05")

CSI: TC=0.38/1.00 (E-F:1), BC=0.27/1.00 (G-I:2), WB=0.26/1.00 (D-G:1), SSI=0.19/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (A) (INPUT = 0.90)

JSI METAL= 0.27 (H) (INPUT = 1.00)

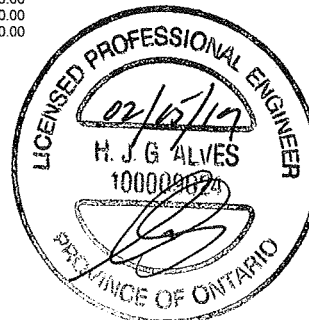


DWG NO. TAM 7703468
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T84	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:09 2019 Page 1
ID:2Jul?VJZDQIUmwWYL4tF1nyS9e7-6nHZkbZm0FUqKLbpA5J5wjxQtir1Gw?xu3duJ0zkvgC

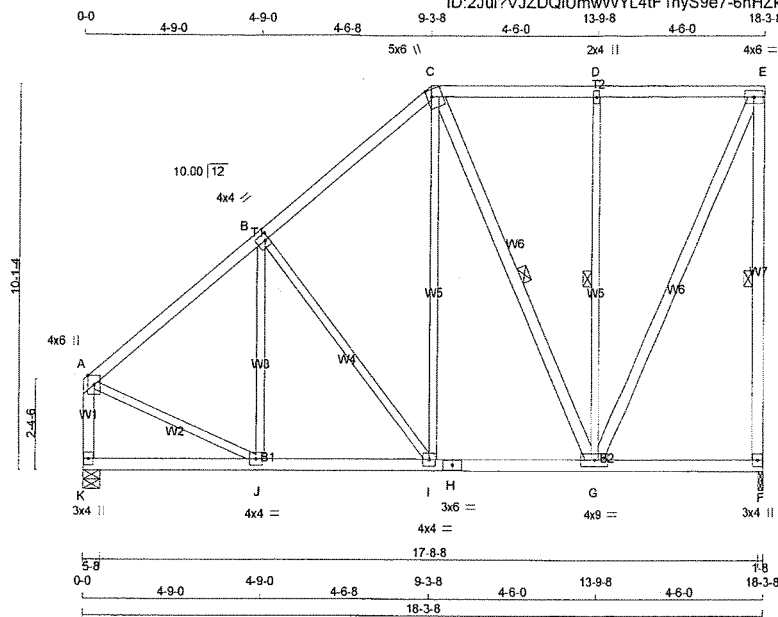

Scale = 1:58.2

TOTAL WEIGHT = 3 X 112 = 336 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
K - A	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS	EXCEPT	SIZE	LUMBER	DESCR.
C - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0	Edge	
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMVW-w	MT20	2.0	4.0		
E	TMVW-l	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BS-t	MT20	3.0	6.0		
I	BMVW-t	MT20	4.0	4.0		
J	BMVW-t	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	BRG
F	1072	0	1072	0	0	1-8	1-8	1-8	1-8
K	1072	0	1072	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0
K	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, C-G, D-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-856 / 0	-77.7 -77.7	0.22 (1)	6.25	J-B	-78 / 110	0.05 (1)
B-C	-684 / 0	-77.7 -77.7	0.22 (1)	6.25	B-I	-286 / 0	0.33 (1)
C-D	-400 / 0	-77.7 -77.7	0.20 (1)	6.25	I-C	0 / 410	0.09 (2)
D-E	-400 / 0	-77.7 -77.7	0.20 (1)	6.25	C-G	-258 / 0	0.16 (1)
F-E	-999 / 0	0.0 0.0	0.50 (1)	6.25	G-D	-430 / 0	0.30 (1)
K-A	-997 / 0	0.0 0.0	0.13 (1)	7.81	G-E	0 / 952	0.15 (1)
					A-J	0 / 737	0.17 (1)
K-J	0 / 0	-39.5 -39.5	0.17 (3)	10.00			
J-I	0 / 678	-39.5 -39.5	0.25 (2)	10.00			
I-H	0 / 507	-39.5 -39.5	0.21 (2)	10.00			
H-G	0 / 507	-39.5 -39.5	0.21 (2)	10.00			
G-F	0 / 0	-39.5 -39.5	0.15 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9	PSF
	DL = 6.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 44.8	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.61")
CALCULATED VERT. DEFL (LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.04")

CSI: TC=0.50/1.00 (E-F:1) , BC=0.25/1.00 (I-J:2) , WB=0.33/1.00 (B-I:1) , SSI=0.17/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (G) (INPUT = 0.90)

JSI METAL= 0.40 (A) (INPUT = 1.00)

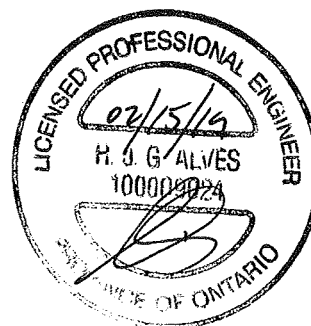


DWG NO. TAM 17903469
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T88	12	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:10 2019 Page 1

ID:2Jul?VJZDQiUmwVYL4tF1nyS9e7-a_rxxZOnZdhyVA0koqKTxUen6Ag?ly46jMSsTzkvgB

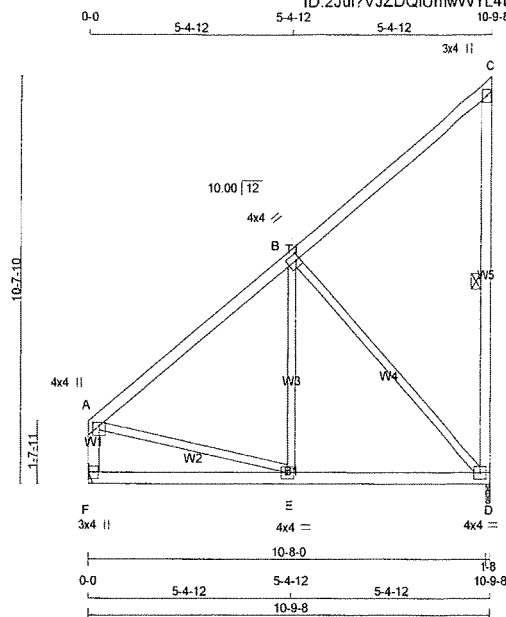

Scale = 1:58.0

TOTAL WEIGHT = 12 X 56 = 674 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF
F - A	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TMV+p	MT20	3.0	4.0		
D	BMVW-t	MT20	4.0	4.0		
E	BMVW-t	MT20	4.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
D	632	0	0	0
F	632	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	483	226 / 0	113 / 0	0 / 0	0 / 0	145 / 0	0 / 0
F	483	226 / 0	113 / 0	0 / 0	0 / 0	145 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-D.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	-443 / 0	-77.7	-77.7	0.30 (1)	6.25	E-B	0 / 286
B-C	-33 / 0	-77.7	-77.7	0.29 (1)	6.25	B-D	-537 / 0
D-C	-158 / 0	0.0	0.0	0.09 (1)	6.25	A-E	0 / 376
F-A	-551 / 0	0.0	0.0	0.06 (1)	7.81		
F-E	0 / 0	-39.5	-39.5	0.25 (3)	10.00		
E-D	0 / 366	-39.5	-39.5	0.29 (2)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
	DL = 6.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.36")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.03")
ALLOWABLE DEFL. (TL) = $L/360$ (0.36")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.30/1.00 (A-B:1), BC=0.29/1.00 (D-E:2), WB=0.67/1.00 (B-D:1), SSI=0.16/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.55 (A) (INPUT = 0.90)
JSI METAL= 0.15 (A) (INPUT = 1.00)




DWG NO. TAM T1903470
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	G88	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Fri Feb 15 12:09:31 2019 Page 1

ID:2Jul7VJZDQIUmwWYL4tF1nyS9e7-DU_Blb5xzaIEnVhVWx6dAOiN0bOwcMnXL88QuzDzkvg0

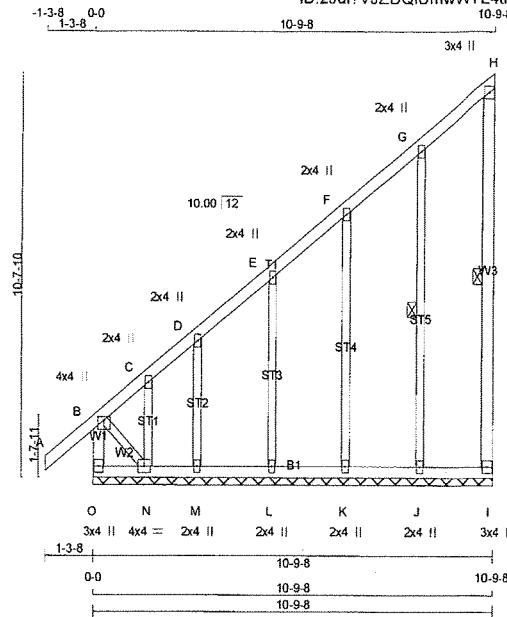

Scale = 1:58.3

TOTAL WEIGHT = 2 X 66 = 131 lb

LUMBER	SIZE	LUMBER	DESCR.
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
O - B	2x4	DRY	No.2
A - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
O - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT	2-0-0	OC.	

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, E, F, G					
C TMVW+w	MT20	2.0	4.0		
H TMV+p	MT20	3.0	4.0		
I BMV1+p	MT20	3.0	4.0		
J, K, L, M					
J BMV1+w	MT20	2.0	4.0		
N BMVW1-t	MT20	4.0	4.0		
O BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF H, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO			FROM TO			FR-TO			
O-B	-237 / 0	0.0	0.0	0.03 (1)	7.81	J-G	-175 / 0	0.09 (1)	
A-B	0 / 34	-77.7	-77.7	0.11 (1)	10.00	K-F	-150 / 0	0.14 (1)	
B-C	-51 / 0	-77.7	-77.7	0.10 (1)	6.25	L-E	-157 / 0	0.08 (1)	
C-D	-2 / 0	-77.7	-77.7	0.03 (1)	10.00	M-D	-141 / 0	0.03 (1)	
D-E	-7 / 0	-77.7	-77.7	0.04 (1)	10.00	N-C	-30 / 0	0.01 (1)	
E-F	-6 / 0	-77.7	-77.7	0.04 (1)	10.00	B-N	0 / 15	0.00 (1)	
F-G	0 / 0	-77.7	-77.7	0.04 (1)	10.00				
G-H	-9 / 0	-77.7	-77.7	0.04 (1)	10.00				
I-H	-67 / 0	0.0	0.0	0.04 (1)	6.25				
O-N	0 / 0	-39.5	-39.5	0.01 (3)	10.00				
N-M	0 / 10	-39.5	-39.5	0.02 (3)	10.00				
M-L	0 / 7	-39.5	-39.5	0.03 (3)	10.00				
L-K	0 / 4	-39.5	-39.5	0.03 (3)	10.00				
K-J	0 / 2	-39.5	-39.5	0.03 (3)	10.00				
J-I	0 / 0	-39.5	-39.5	0.03 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	20.9	PSF
	DL =	6.0	PSF
BOT CH.	LL =	10.5	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	44.8	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.11/1.00 (A-B:1), BC=0.03/1.00 (J-K:3), WB=0.14/1.00 (F-K:1), SS=0.07/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.09 (G) (INPUT = 1.00)




DWG NO. TAM 779034 71
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T91TCX	12	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:11 2019 Page 1

ID:2Jul?VJZDQIUmwWYL4tF1nyS9e7-2APJ9Ha1YtYafkCHWLZ081pqVXQkveELN6?OvzkvgA

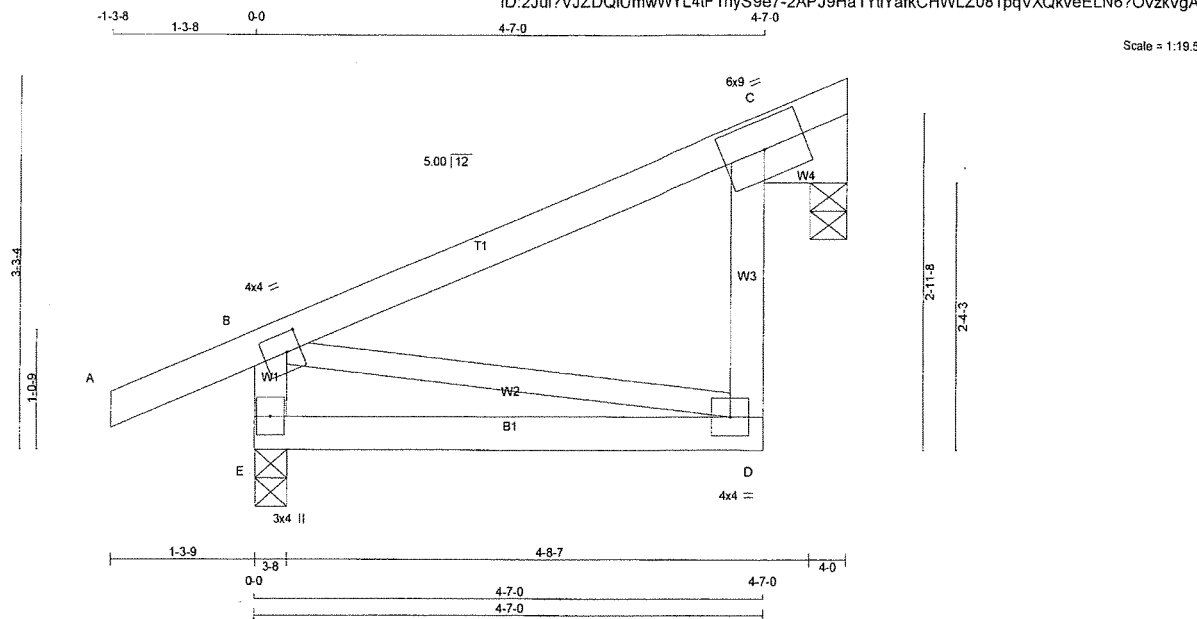

TOTAL WEIGHT = 12 X 22 = 263 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF
E - B	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	4.0	2.00	1.50
C	TMVW-1-t	MT20	6.0	9.0		
D	BMVW-1	MT20	4.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
C	269	269	4-0	4-0
E	373	373	3-8	3-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

JT	1ST LCASE	MAX /MIN	COMPONENT REACTIONS
C	COMBINED	SNOW	LIVE
E	278	152 / 0	48 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO	A-B	0 / 20	-77.7	-77.7	0.10 (1)	10.00		
	B-C	0 / 0	-77.7	-77.7	0.28 (1)	10.00		
	D-C	0 / 115	0.0	0.0	0.02 (3)	10.00		
	E-B	-283 / 0	0.0	0.0	0.03 (1)	7.81		
	E-D	0 / 0	-39.5	-39.5	0.19 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
	DL = 6.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.03")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.28/1.00 (B-C:1), BC=0.19/1.00 (D-E:3), WB=0.00/1.00 (B-D:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667
	788	1987	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)



DWG NO. TAM 17703472
STRUCTURAL
COMPONENT ONLY

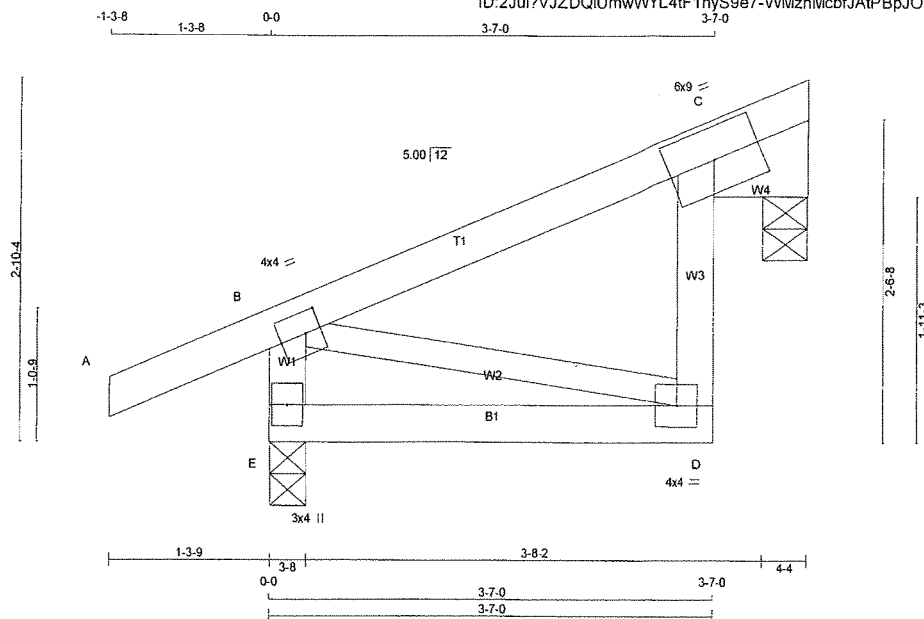

TOTAL WEIGHT = $16 \times 18 = 292 \text{ lb}$

LUMBER			
N L G A	RULES		
CHORDS	SIZE	LUMBER	DESCR
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
E - B	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY- SEASONED	LUMBER		SPF

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.50
C	TMVW1-t	MT20	6.0	9.0		
D	BMVW-t	MT20	4.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED			MAXIMUM FACTORED			INPUT	REQRD
GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
C	210	0	210	0	0	4-4	4-4
E	315	0	315	0	0	3-8	3-8

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS
CHORD AT JT(S): C

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	161	75 / 0	38 / 0	0 / 0	0 / 0	48 / 0	0 / 0
E	233	131 / 0	38 / 0	0 / 0	0 / 0	64 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C. E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/20	-77.7	-77.7	0.10 (1)	10.00	B-D	0/0 0.00 (1)
B-C	0/0	-77.7	-77.7	0.17 (1)	10.00		
D-C	0/90	0.0	0.0	0.02 (3)	10.00		
E-B	-244/0	0.0	0.0	0.02 (1)	7.81		
E-D	0/0	-39.5	-39.5	0.12 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP	CH.	LL =	20.9 PSF
		DL =	6.0 PSF
BOT	CH.	LL =	10.5 PSF
		DL =	7.4 PSF
TOTAL LOAD		=	44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.17/1.00 (B-C:1), BC=0.12/1.00 (D-E:3), WB=0.00/1.00 (B-D:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.16 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)




DWG NO. TAM 77203473
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T95	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Fri Feb 15 12:10:13 2019 Page 1

ID:2Jul?VJZDQIUmwWYL4f1nyS9e7-ZX4aycH4U?GpyuaPwN15Z6B_JD9CIsWphb6Sozkvg8

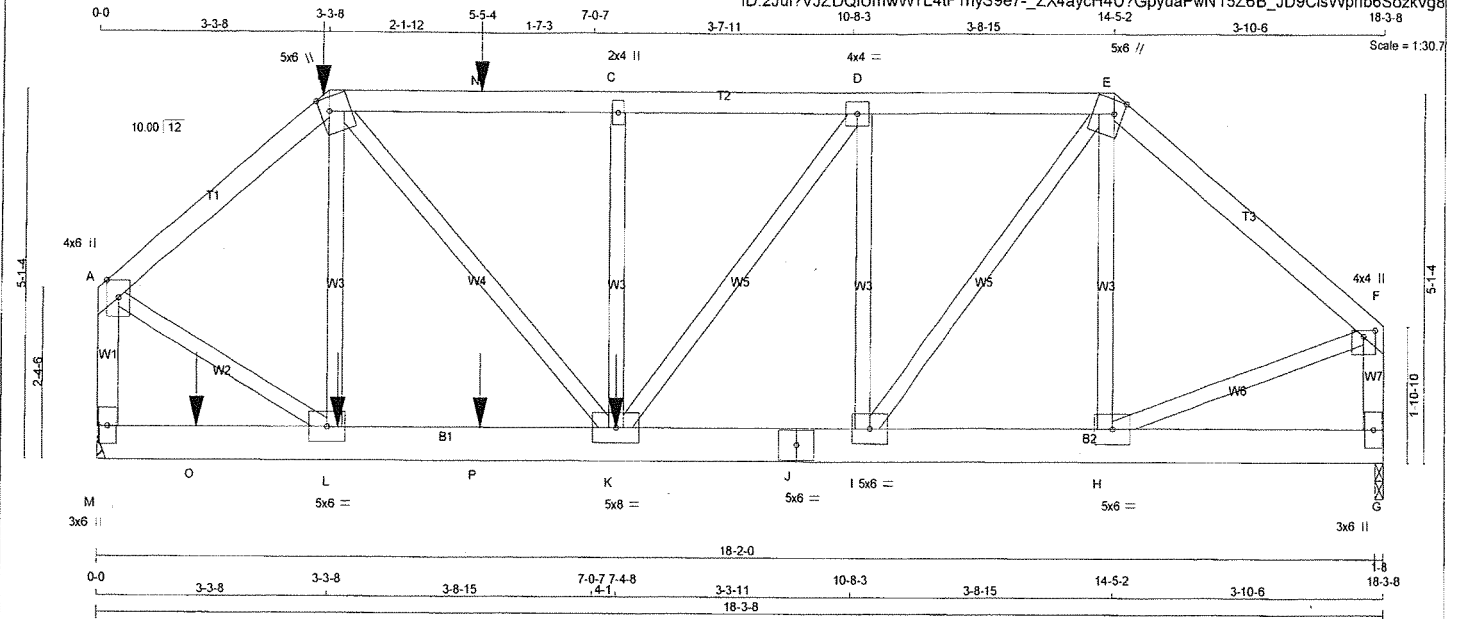

TOTAL WEIGHT = 2 X 94 = 188 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
M - A	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
M - J	2x6	DRY	No.2	SPF
J - G	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B 1	12	SIDE(61.0)
B-E 1	12	SIDE(61.0)
E-F 1	12	TOP
M-A 1	12	TOP
G-F 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
M-J 2	12	SIDE(183.1)
J-G 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	
C-K 1	6	SIDE(202.4)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0	Edge	
B	TTWW+m	MT20	5.0	6.0	2.25	1.50
C	TMVW+w	MT20	2.0	4.0		
D	TMVW-t	MT20	4.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	3.0	6.0		
H, I, L						
H	BMVW-t	MT20	5.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BMVW-t	MT20	5.0	8.0		
M	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER									
BEARINGS									
FACTORED				MAXIMUM FACTORED			INPUT	REQRD	
		GROSS REACTION		GROSS REACTION			BRG	BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
M	2252	0		2252	0	0	MECHANICAL		
G	1748	0		1748	0	0	1-8	1-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT M. MINIMUM BEARING LENGTH AT JOINT M = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1717	813 / 0	391 / 0	0 / 0	0 / 0	513 / 0	0 / 0
G	1327	646 / 0	291 / 0	0 / 0	0 / 0	391 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.48 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM	TO			FR-TO			
A-B	-1906/0	-77.7	-77.7	0.09 (1)	6.24	L-B	-473/0	0.09 (1)	
B-N	-2564/0	-77.7	-77.7	0.17 (1)	5.48	B-K	0/1702	0.21 (1)	
N-C	-2564/0	-77.7	-77.7	0.17 (1)	5.48	K-C	-376/0	0.07 (1)	
C-D	-2564/0	-77.7	-77.7	0.12 (1)	5.54	K-D	0/804	0.10 (1)	
D-E	-2088/0	-77.7	-77.7	0.08 (1)	6.04	I-D	-947/0	0.06 (1)	
E-F	-1658/0	-77.7	-77.7	0.12 (1)	6.25	I-E	0/1081	0.21 (1)	
M-A	-2189/0	0.0	0.0	0.14 (1)	7.52	H-B	0/1354	0.17 (1)	
G-F	-1684/0	0.0	0.0	0.10 (1)	7.81	A-F	0/1354	0.17 (1)	
M-O	0/0	-39.5	-39.5	0.05 (2)	10.00				
O-L	0/0	-39.5	-39.5	0.05 (2)	10.00				
L-P	0/1449	-39.5	-39.5	0.14 (1)	10.00				
P-K	0/1449	-39.5	-39.5	0.14 (1)	10.00				
K-J	0/2088	-39.5	-39.5	0.18 (1)	10.00				
J-I	0/2088	-39.5	-39.5	0.18 (1)	10.00				
I-H	0/1263	-39.5	-39.5	0.10 (1)	10.00				
H-G	0/0	-39.5	-39.5	0.03 (3)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TOTAL
B	3-3-8	-100	-100	---	FRONT	VERT	TOTAL
K	7-4-8	-1478	-1478	---	FRONT	VERT	TOTAL
L	3-5-4	-62	-78	---	FRONT	VERT	TOTAL
N	5-5-4	-94	-94	---	FRONT	VERT	TOTAL
O	1-5-4	-62	-78	---	FRONT	VERT	TOTAL
P	5-5-4	-62	-78	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.9 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.4 PSF
TOTAL LOAD = 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60% OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = $L/360 (0.81")$
CALCULATED VERT. DEFL (LL) = $L/999 (0.03")$
ALLOWABLE DEFL (TL) = $L/360 (0.81")$
CALCULATED VERT. DEFL (TL) = $L/999 (0.05")$

CSI: TC=0.17/1.00 (B-C:1), BC=0.18/1.00 (I-K:1), WB=0.21/1.00 (B-K:1), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
M20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.83 (F) (INPUT = 0.90)
JSI METAL= 0.41 (A) (INPUT = 1.00)


DWG NO. TAM 71203474
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T96	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:14 2019 Page 1

ID:2Jul?VJZDQIUmwWYL4tF1nyS9e7-SI5Snlcvro77R6ThzevGdnfK9jXsxCdglLKl?Ezkgv7

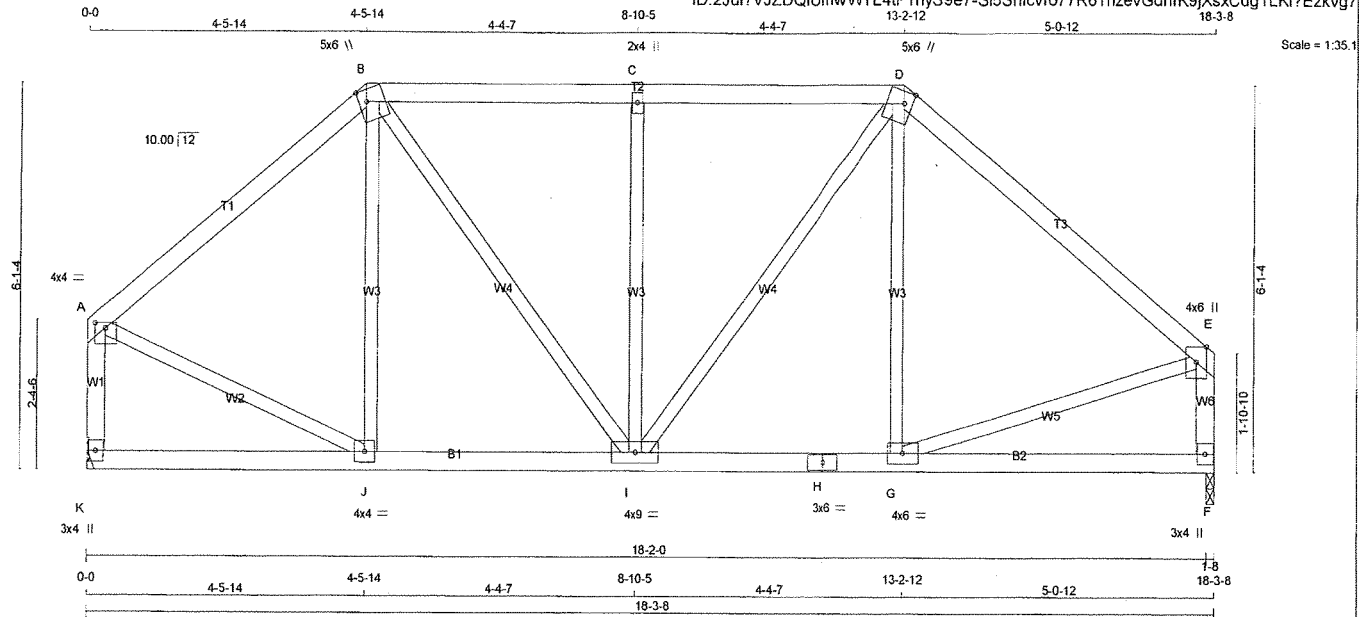

TOTAL WEIGHT = 82 lb
[M] [F]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR
A - B	2x4	DRY	No.2
B - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	4.0	1.00	2.00
B	TTWW+m	MT20	5.0	6.0	2.25	1.50
C	TMW+w	MT20	2.0	4.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMVW+p	MT20	4.0	6.0	Edge	
F	BMV1+p	MT20	3.0	4.0		
G	BMWW-t	MT20	4.0	6.0		
H	BS-t	MT20	3.0	6.0		
I	BMWW-t	MT20	4.0	9.0		
J	BMWW-t	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
K	1072 0	1072 0	0 0	MECHANICAL
F	1072 0	1072 0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0
F	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.14 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO						FR-TO			
A-B	-842 / 0	-77.7	-77.7	0.21 (1)	6.25	J-B	-79 / 96	0.05 (1)	0.05 (1)
B-C	-878 / 0	-77.7	-77.7	0.19 (1)	6.25	B-I	0 / 390	0.09 (1)	0.09 (1)
C-D	-878 / 0	-77.7	-77.7	0.19 (1)	6.25	I-C	-410 / 0	0.24 (1)	0.24 (1)
D-E	-909 / 0	-77.7	-77.7	0.27 (1)	6.14	I-D	0 / 301	0.07 (1)	0.07 (1)
K-A	-1000 / 0	0.0	0.0	0.13 (1)	7.81	G-D	0 / 159	0.04 (3)	0.04 (3)
F-E	-989 / 0	0.0	0.0	0.11 (1)	7.81	A-J	0 / 705	0.16 (1)	0.16 (1)
K-J	0 / 0	-39.5	-39.5	0.15 (3)	10.00	G-E	0 / 727	0.16 (1)	0.16 (1)
J-I	0 / 644	-39.5	-39.5	0.24 (2)	10.00				
I-H	0 / 697	-39.5	-39.5	0.28 (2)	10.00				
H-G	0 / 697	-39.5	-39.5	0.28 (2)	10.00				
G-F	0 / 0	-39.5	-39.5	0.18 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9	PSF
DL = 6.0	PSF	
BOT CH.	LL = 10.5	PSF
DL = 7.4	PSF	
TOTAL LOAD	= 44.8	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.61")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.03")
ALLOWABLE DEFL. (TL) = $L/360$ (0.61")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.27/1.00 (D-E:1), BC=0.28/1.00 (G-I:2), WB=0.24/1.00 (C-I:1), SI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (A) (INPUT = 0.90)
JSI METAL= 0.43 (E) (INPUT = 1.00)




DWG NO. TAM 17903475
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T97	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:15 2019 Page 1

ID:2Jul?VJZDQIUmwWYL4f1nyS9e7-wxfq_edXc5F_2G2zWLQVA_BTg7sgggCpG?4DXgzkgv6

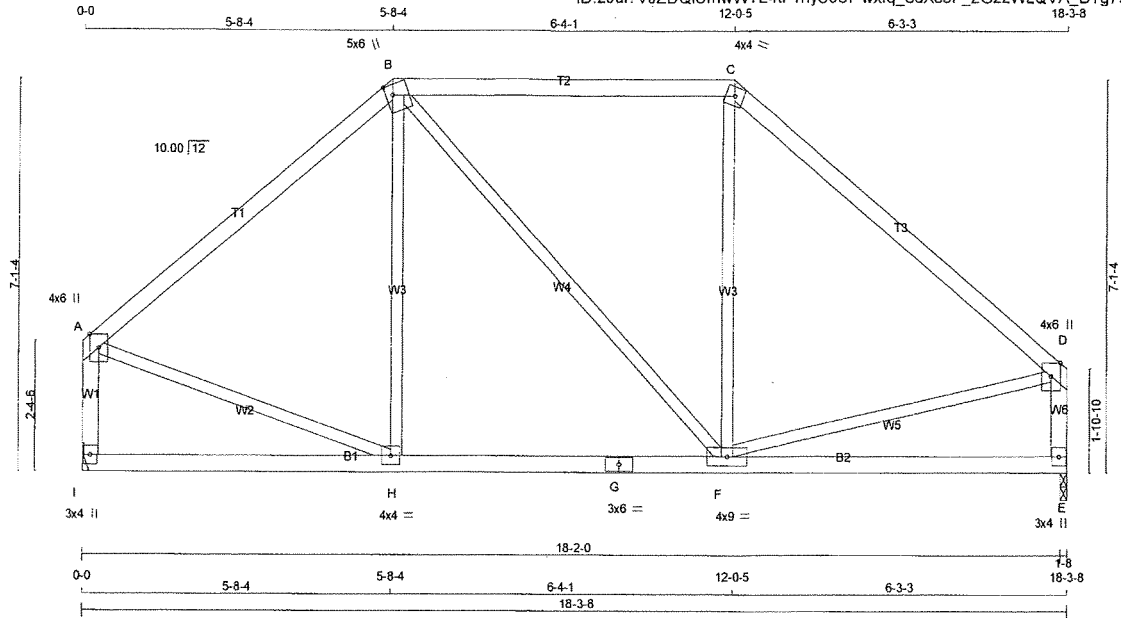

TOTAL WEIGHT = 78 lb [M][F]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
I - A	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
G - E	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0	Edge	
B	TTWW+m	MT20	5.0	6.0	2.25	1.50
C	TTW-m	MT20	4.0	4.0		
D	TMVW+p	MT20	4.0	6.0	Edge	
E	BMV1+p	MT20	3.0	4.0		
F	BMVWW-t	MT20	4.0	9.0		
G	BS-t	MT20	3.0	6.0		
H	BMVW-t	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
I	1072	0	1072	0	0	MECHANICAL
E	1072	0	1072	0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 1-8.

UNFACTORED REACTIONS

1ST LCASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0
E	819	382 / 0	192 / 0	0 / 0	0 / 0	245 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED				
MEMB.	FORCE (LBS)	VERT. LOAD	LC1	MAX. CS1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	-833 / 0	-77.7	-77.7	0.34 (1)	6.23	H-B	0 / 190	0.05 (3)	
B-C	-676 / 0	-77.7	-77.7	0.41 (1)	6.25	B-F	0 / 54	0.01 (1)	
C-D	-878 / 0	-77.7	-77.7	0.41 (1)	5.99	F-C	0 / 230	0.05 (3)	
I-A	-980 / 0	0.0	0.0	0.12 (1)	7.81	A-H	0 / 677	0.15 (1)	
E-D	-969 / 0	0.0	0.0	0.11 (1)	7.81	F-D	0 / 693	0.16 (1)	
I-H	0 / 0	-39.5	-39.5	0.24 (3)	10.00				
H-G	0 / 639	-39.5	-39.5	0.37 (2)	10.00				
G-F	0 / 639	-39.5	-39.5	0.37 (2)	10.00				
F-E	0 / 0	-39.5	-39.5	0.29 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
DL = 6.0 PSF	
BOT CH.	LL = 10.5 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60% OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CS1: TC=0.41/1.00 (C-D:1) . BC=0.37/1.00 (F-H:2) ,
WB=0.16/1.00 (D-F:1) , SS1=0.19/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (H) (INPUT = 0.90)
JSI METAL= 0.43 (D) (INPUT = 1.00)




DWG NO. TAM T903476
STRUCTURAL
COMPONENT ONLY

JOB NAME 401350	TRUSS NAME T98A	QUANTITY 1	PLY 2	JOB DESC. BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:16 2019 Page 1	
ID:2Jul7VJZDQiUmwWYL4tF1nyS9e7-O8DCC_e9MPNrgQd943xkCkh_WCTP6kzVfpm36zkvg5				Scale = 1:34.6	

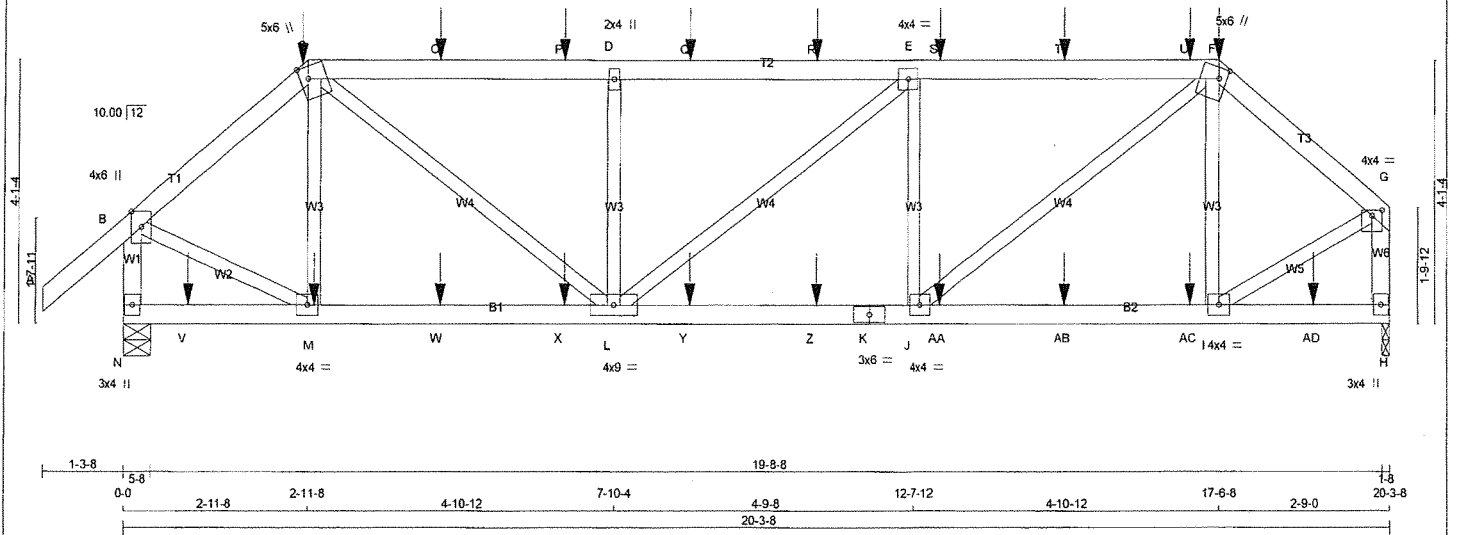

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - C 2x4 DRY No.2 SPF C - F 2x4 DRY No.2 SPF F - G 2x4 DRY No.2 SPF N - B 2x4 DRY No.2 SPF H - G 2x4 DRY No.2 SPF N - K 2x4 DRY No.2 SPF K - H 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-C 1 12 SIDE(61.0) C-F 1 12 SIDE(61.0) F-G 1 12 SIDE(61.0) N-B 1 12 TOP H-G 1 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS N-K 1 12 SIDE(61.0) K-H 1 12 SIDE(0.0) WEBS : (0.122"x3") SPIRAL NAILS 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY. SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP. PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMVW+p MT20 4.0 6.0 Edge C TTVW+m MT20 5.0 6.0 2.25 1.50 D TMW+w MT20 2.0 4.0 E TMW+t MT20 4.0 4.0 F TTVW+m MT20 5.0 6.0 2.00 1.50 G TMVW+p MT20 4.0 4.0 1.00 2.00 H BMV1+p MT20 3.0 4.0 I, J, M I BMW+t MT20 4.0 4.0 K BS-t MT20 3.0 6.0 L BMW+t MT20 4.0 9.0 N BMV1+p MT20 3.0 4.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG DOWN DOWN UPLIFT IN-SX IN-SX JT N 2183 0 2183 0 0 5-8 5-8 H 2077 0 2077 0 0 1-8 1-8 UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL N 1658 806 / 0 364 / 0 0 / 0 488 / 0 0 / 0 H 1583 754 / 0 362 / 0 0 / 0 468 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.27 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS FACTORED FACTORED WEBS MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. FORCE MAX. (LBS) (PLF) (LC) UNBRAC LENGTH (LBS) (LC) FR-TO FROM TO A-B 0 / 34 -77.7 -77.7 0.06 (1) 10.00 M-C -334 / 32 0.05 (1) B-C -1955 / 0 -77.7 -77.7 0.08 (1) 6.20 C-L 0 / 1542 0.19 (1) C-O -2707 / 0 -77.7 -77.7 0.24 (1) 5.28 L-D -637 / 0 0.09 (1) O-P -2707 / 0 -77.7 -77.7 0.24 (1) 5.28 L-E 0 / 26 0.00 (1) P-D -2707 / 0 -77.7 -77.7 0.24 (1) 5.28 J-E -663 / 0 0.05 (1) D-Q -2707 / 0 -77.7 -77.7 0.25 (1) 5.27 J-F 0 / 1590 0.20 (1) Q-R -2707 / 0 -77.7 -77.7 0.25 (1) 5.27 I-M 0 / 1590 0.20 (1) R-E -2707 / 0 -77.7 -77.7 0.25 (1) 5.27 I-N 0 / 1590 0.20 (1) E-S -2688 / 0 -77.7 -77.7 0.25 (1) 5.29 I-O 0 / 1590 0.20 (1) S-T -2688 / 0 -77.7 -77.7 0.25 (1) 5.29 J-M 0 / 1590 0.20 (1) T-U -2688 / 0 -77.7 -77.7 0.25 (1) 5.29 J-N 0 / 1590 0.20 (1) U-F -2688 / 0 -77.7 -77.7 0.25 (1) 5.29 J-O 0 / 1590 0.20 (1) F-G -1845 / 0 -77.7 -77.7 0.07 (1) 6.65 K-J 0 / 1590 0.20 (1) N-B -2119 / 0 0.0 0.0 12 (1) 7.62 K-L 0 / 1590 0.20 (1) H-G -2026 / 0 0.0 0.0 12 (1) 7.62 K-M 0 / 1590 0.20 (1) N-V 0 / 0 -39.5 -39.5 0.10 (3) 10.00 V-M 0 / 0 -39.5 -39.5 0.10 (3) 10.00 M-W 0 / 1487 -39.5 -39.5 0.23 (2) 10.00 W-X 0 / 1487 -39.5 -39.5 0.23 (2) 10.00 X-L 0 / 1487 -39.5 -39.5 0.23 (2) 10.00 L-Y 0 / 2687 -39.5 -39.5 0.33 (2) 10.00 Y-Z 0 / 2687 -39.5 -39.5 0.33 (2) 10.00 Z-K 0 / 2687 -39.5 -39.5 0.33 (2) 10.00 K-J 0 / 2687 -39.5 -39.5 0.33 (2) 10.00 J-AA 0 / 1400 -39.5 -39.5 0.23 (2) 10.00 AA-AB 0 / 1400 -39.5 -39.5 0.23 (2) 10.00 AB-AC 0 / 1400 -39.5 -39.5 0.23 (2) 10.00 AC-I 0 / 1400 -39.5 -39.5 0.23 (2) 10.00 I-AD 0 / 0 -39.5 -39.5 0.11 (3) 10.00 AD-H 0 / 0 -39.5 -39.5 0.11 (3) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX- FACE DIR. TYPE HEEL CONN. C 2-11-8 -38 -42 --- FRONT VERT DEAD --- C 2-11-8 -100 -100 --- BACK VERT TOTAL --- C 2-11-8 -180 -180 --- FRONT VERT SNOW --- F 17-6-8 -38 -42 --- FRONT VERT DEAD --- F 17-6-8 -180 -180 --- FRONT VERT SNOW --- M 3-0-12 -56 -71 --- BACK VERT TOTAL ---				DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 20.9 PSF DL = 6.0 PSF BOT CH. LL = 10.5 PSF DL = 7.4 PSF TOTAL LOAD = 44.8 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM *** NON STANDARD GIRDER *** ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, OBC 2012 - CSA 086-09, CSA 086-14 - TPIC 2011, TPIC 2014 (60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL. (LL) = L/360 (0.68") CALCULATED VERT. DEFL. (LL) = L/999 (0.04") ALLOWABLE DEFL. (TL) = L/360 (0.68") CALCULATED VERT. DEFL. (TL) = L/999 (0.08") CSI: TC=0.25/1.00 (E-F:1), BC=0.33/1.00 (J-L:2), WB=0.20/1.00 (F-J:1), SS=0.17/1.00 (E-F:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 788 1987 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (F) (INPUT = 0.90) JSI METAL= 0.44 (B) (INPUT = 1.00)			
---	--	--	--	--	--	--	--	--	--	--	--

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
O	5-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
P	7-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
Q	9-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
R	11-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
S	13-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
T	15-0-12	-94	-94	---	BACK	VERT	TOTAL	---	---
U	17-0-12	-114	-114	---	BACK	VERT	TOTAL	---	---
V	1-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
W	5-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
X	7-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
Y	9-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
Z	11-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AA	13-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AB	15-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AC	17-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---
AD	19-0-12	-56	-71	---	BACK	VERT	TOTAL	---	---

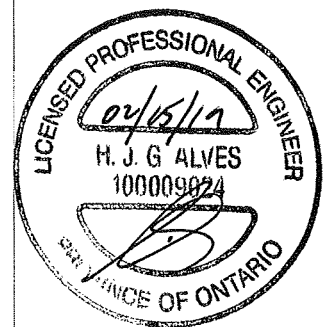


DWG NO. TAM 17903477
 STRUCTURAL
 COMPONENT ONLY 7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T99A	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:17 2019 Page 1

ID:2Jul2VJZDQIUmWVYL4tF1nyS9e7-tKmaPKfn7jVilaCMemSzFPn1wYl8Zg6jJZJbZkvg4

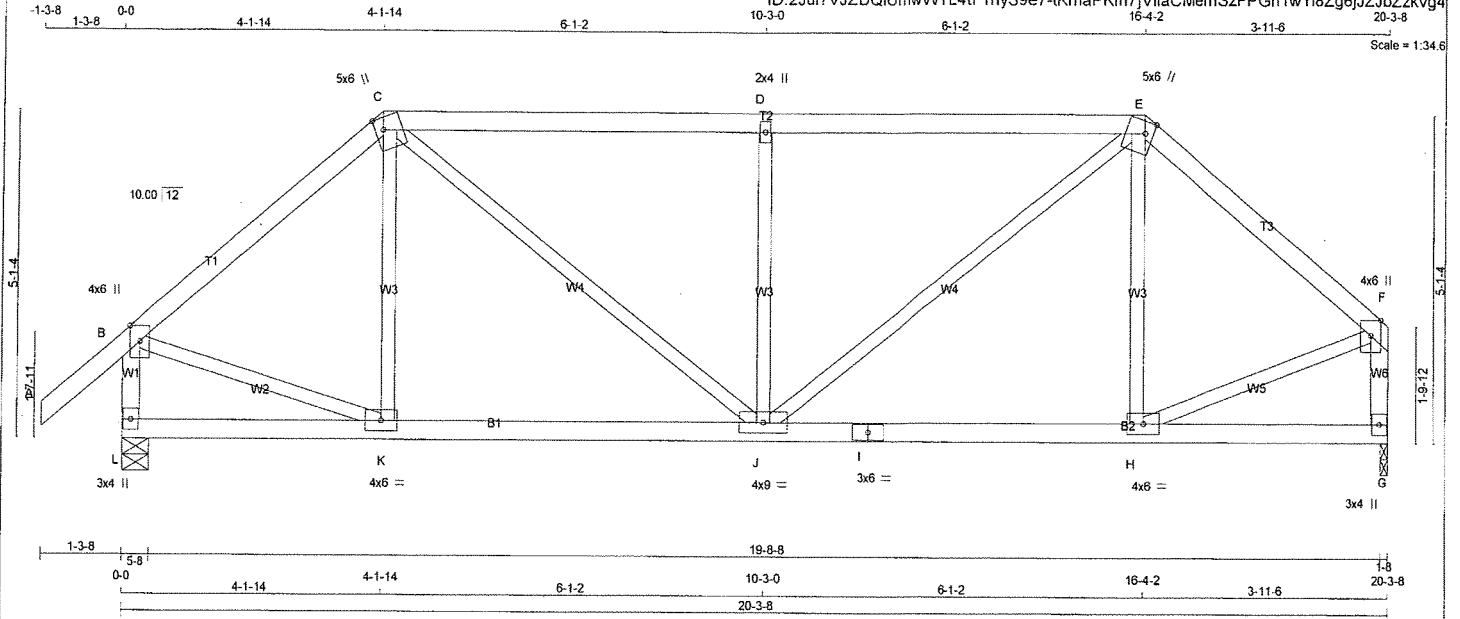

TOTAL WEIGHT = 84 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
E - F	2x4 DRY	No.2	SPF
L - B	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
L - I	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMW+w	MT20	2.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TMVW+p	MT20	4.0	6.0	Edge	
G	BMV1+p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	6.0		
I	BS-t	MT20	3.0	6.0		
J	BMVW-t	MT20	4.0	9.0		
K	BMVW-t	MT20	4.0	6.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
L	1297	0	1297	0	0	0	5-8	5-8	
G	1189	0	1189	0	0	0	1-8	1-8	

UNFACTORED REACTIONS

1ST LCASE	MAX / MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
L	984	482 / 0 213 / 0 0 / 0 0 / 0 289 / 0 0 / 0
G	909	424 / 0 213 / 0 0 / 0 0 / 0 272 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.84 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 34	-77.7 -77.7 0.11 (1)	10.00	K-C	-34 / 135	0.03 (3)	
B-C	-1103 / 0	-77.7 -77.7 0.26 (1)	5.71	C-J	0 / 641	0.14 (1)	
C-D	-1349 / 0	-77.7 -77.7 0.55 (1)	4.84	J-D	-577 / 0	0.22 (1)	
D-E	-1349 / 0	-77.7 -77.7 0.55 (1)	4.84	J-E	0 / 682	0.15 (1)	
E-F	-1063 / 0	-77.7 -77.7 0.23 (1)	5.82	H-E	-76 / 108	0.03 (1)	
L-B	-1237 / 0	0.0 0.0 0.13 (1)	7.22	B-K	0 / 884	0.20 (1)	
G-F	-1134 / 0	0.0 0.0 0.12 (1)	7.46	H-F	0 / 867	0.20 (1)	
L-K	0 / 0	-39.5 -39.5 0.19 (3)	10.00				
K-J	0 / 844	-39.5 -39.5 0.33 (2)	10.00				
J-I	0 / 813	-39.5 -39.5 0.32 (2)	10.00				
I-H	0 / 813	-39.5 -39.5 0.32 (2)	10.00				
H-G	0 / 0	-39.5 -39.5 0.18 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
	DL = 6.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.68")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.04")
ALLOWABLE DEFL. (TL) = $L/360$ (0.68")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.08")

CSI: TC=0.55/1.00 (C-D:1), BC=0.33/1.00 (J-K:2), WB=0.22/1.00 (D-J:1), SSI=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (B) (INPUT = 0.90)

JSI METAL= 0.53 (B) (INPUT = 1.00)



DWG NO. TAM 17703478
STRUCTURAL
COMPONENT ONLY

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MTek Industries, Inc. Fri Feb 15 12:10:18 2019 Page 1
ID:2Juf?VJZDQiUmwWYL4tF1nyS9e7-LWKzdgguQu0dZvknYCUzCodp?XKu5t?AGyyit8?zkvg3

Scale = 1:36.2

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - C 2x4 DRY No.2 SPF
C - E 2x4 DRY No.2 SPF
E - F 2x4 DRY No.2 SPF
L - B 2x4 DRY No.2 SPF
G - F 2x4 DRY No.2 SPF
L - I 2x4 DRY No.2 SPF
I - G 2x4 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMWw+p MT20 4.0 6.0 Edge
C TTWW+m MT20 5.0 6.0 2.25 1.50
D TMW+w MT20 2.0 4.0
E TTWW+m MT20 5.0 6.0 2.25 1.50
F TMWw+p MT20 4.0 6.0 Edge
G BMV1+p MT20 3.0 4.0
H BMWW-t MT20 4.0 6.0
I BS-t MT20 3.0 6.0
J BMWWw-t MT20 4.0 9.0
K BMWW-t MT20 4.0 6.0
L BMV1+p MT20 3.0 4.0
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
FACTORED MAXIMUM FACTORED INPUT REQ'D
GROSS REACTION GROSS REACTION BRG BRG
JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX
L 1297 0 1297 0 0 5-8 5-8
G 1189 0 1189 0 0 1-8 1-8
UNFACTORED REACTIONS
1ST LCASE MAX/MIN COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
L 984 482 / 0 213 / 0 0 / 0 0 / 0 289 / 0 0 / 0
G 909 424 / 0 213 / 0 0 / 0 0 / 0 272 / 0 0 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, G
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE laterally RESTRAINED.
LOADING
TOTAL LOAD CASES: (4)
CHORDS WEBS
MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD LC1 MAX CS1 (LC) UNBRAC LENGTH FR-TO MEMB. MAX. FACTORED FORCE (LBS) MAX CS1 (LC)
FR-TO FROM TO
A-B 0 / 34 -77.7 -77.7 0.11 (1) 10.00 K-C 0 / 186 0.04 (3)
B-C -1083 / 0 -77.7 -77.7 0.31 (1) 5.70 C-J 0 / 391 0.09 (1)
C-D -1084 / 0 -77.7 -77.7 0.25 (1) 5.78 J-D -461 / 0 0.27 (1)
D-E -1084 / 0 -77.7 -77.7 0.25 (1) 5.78 J-E 0 / 425 0.10 (1)
E-F -1056 / 0 -77.7 -77.7 0.29 (1) 5.79 H-E 0 / 162 0.04 (3)
L-B -1210 / 0 0.0 0.0 0.13 (1) 7.28 B-K 0 / 854 0.19 (1)
G-F -1106 / 0 0.0 0.0 0.12 (1) 7.52 H-F 0 / 841 0.19 (1)
L-K 0 / 0 -39.5 -39.5 0.21 (3) 10.00
K-J 0 / 831 -39.5 -39.5 0.32 (2) 10.00
J-I 0 / 810 -39.5 -39.5 0.31 (2) 10.00
I-H 0 / 810 -39.5 -39.5 0.31 (2) 10.00
H-G 0 / 0 -39.5 -39.5 0.20 (3) 10.00

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 20.9 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.4 PSF
TOTAL LOAD = 44.8 PSF
SPACING = 24.0 IN./C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , OBC 2012
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014
(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL)= L/360 (0.68")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.68")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.07")
CSI: TC=0.31/1.00 (B-C:1), BC=0.32/1.00 (J-K:2), WB=0.27/1.00 (D-J:1), SSI=0.18/1.00 (C-D:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10
COMPANION LIVE LOAD FACTOR = 1.00
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
GRIP= 0.89 (B) (INPUT = 0.90)
METAL= 0.53 (B) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER
02/15/14
H.J.G ALVES
100009824
PROVINCE OF ONTARIO


DWG NO. 17903479
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T101A	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:10:19 2019 Page 1

ID: 2Jul?VJZDQilUmwWYL4tF1nyS9e7-pjuLq0g2fKIQXIMKIBURKqM9WkDHcSKPBc2QgRzkvg2

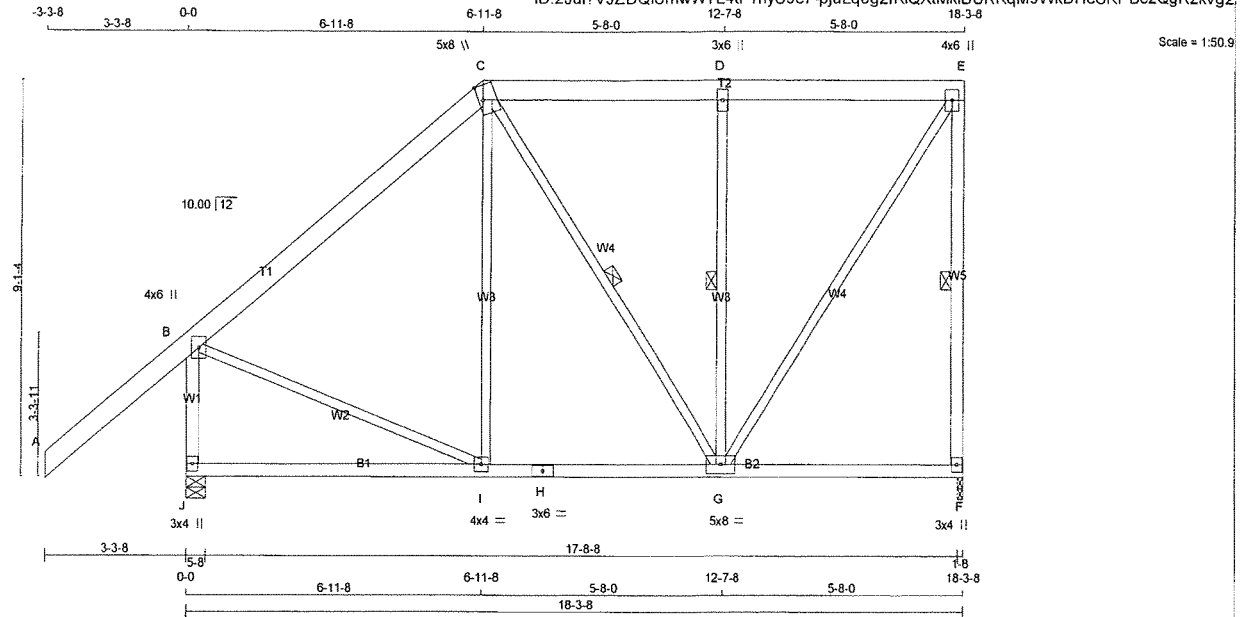

TOTAL WEIGHT = 4 X 114 = 456 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY	No.2	SPF
C - E	2x6	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D	
JT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG	BRG
F	1072	0	1072	0	0	1-8	1-8		
J	1339	0	1339	0	0	5-8	5-8		

UNFACTORED REACTIONS

1ST LCASE	MAX /MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
F	819	382 / 0 192 / 0 0 / 0 0 / 0 245 / 0 0 / 0
J	1004	526 / 0 192 / 0 0 / 0 0 / 0 286 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, C-G, D-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM TO	FR-TO
A-B	0 / 86	-77.7 -77.7 0.32 (1)	10.00 I-C 0 / 232 0.06 (3)
B-C	-721 / 0	-77.7 -77.7 0.33 (1)	6.25 C-G -64 / 0 0.05 (2)
C-D	-525 / 0	-77.7 -77.7 0.18 (1)	6.25 G-D -533 / 0 0.28 (1)
D-E	-525 / 0	-77.7 -77.7 0.18 (1)	6.25 G-E 0 / 960 0.22 (1)
F-E	-977 / 0	0.0 0.0 0.36 (1)	6.25 B-I 0 / 596 0.13 (1)
J-B	-1225 / 0	0.0 0.0 0.21 (1)	7.25
J-I	0 / 0	-39.5 -39.5 0.33 (3)	10.00
I-H	0 / 553	-39.5 -39.5 0.39 (2)	10.00
H-G	0 / 553	-39.5 -39.5 0.39 (2)	10.00
G-F	0 / 0	-39.5 -39.5 0.21 (3)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH	LL = 20.9 PSF
DL = 6.0 PSF	
BOT CH	LL = 10.5 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.61")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.10")
ALLOWABLE DEFL. (TL) = $L/360$ (0.61")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.17")

CSI: TC=0.36/1.00 (E-F:1) , BC=0.39/1.00 (G-I:2) , WB=0.28/1.00 (D-G:1) , SSI=0.17/1.00 (I-J:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1867
	788	1987	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)

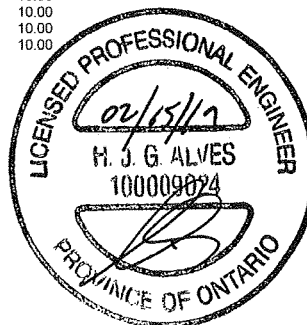


DWG NO. TAM 17903480
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	T102	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2019 MiTek Industries, Inc. Fri Feb 15 12:10:20 2019 Page 1
ID:2Jul?VJZDQiUmwVYL4tF1nyS9e7-HvSJ2MhgQeH191wxJu?gt2uK18YYLvaYQGn_Cuzkv91

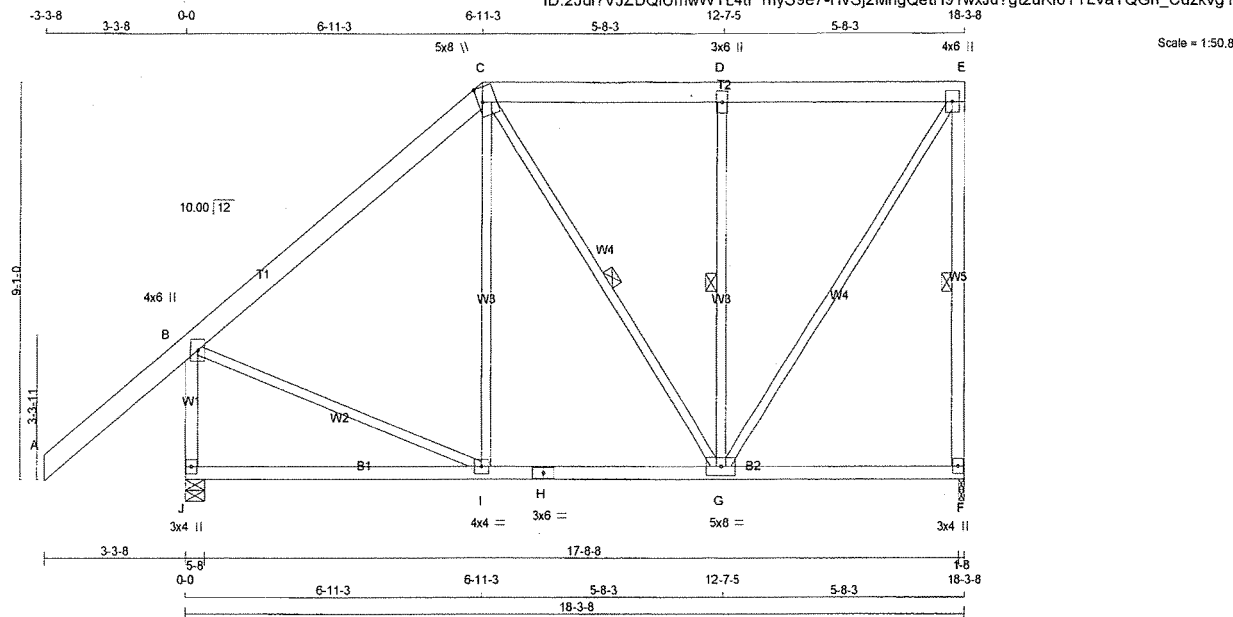

TOTAL WEIGHT = 114 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY	No.2
C - E	2x6	DRY	No.2
F - E	2x4	DRY	No.2
J - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0		
C	TTWW+m	MT20	5.0	8.0	4.00	1.25
D	TMVW+w	MT20	3.0	6.0		
E	TMVW+p	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	5.0	8.0		
H	BS-t	MT20	3.0	6.0		
I	BMVW-l	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	UPLIFT
F	1072	0	1072	0
J	1339	0	1339	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX / MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
F	COMBINED	SNOW	LIVE			
F	819	382 / 0	192 / 0	0 / 0	245 / 0	0 / 0
J	1004	526 / 0	192 / 0	0 / 0	286 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, C-G, D-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)	UNBRAC LENGTH	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 86	-77.7	-77.7 0.32 (1)	10.00	I-C	0 / 231	0.06 (3)
B-C	-722 / 0	-77.7	-77.7 0.33 (1)	6.25	C-G	-61 / 0	0.05 (3)
C-D	-527 / 0	-77.7	-77.7 0.19 (1)	6.25	G-D	-534 / 0	0.27 (1)
D-E	-527 / 0	-77.7	-77.7 0.19 (1)	6.25	G-E	0 / 960	0.22 (1)
F-E	-977 / 0	0.0	0.0 0.36 (1)	6.25	B-I	0 / 597	0.13 (1)
J-B	-1225 / 0	0.0	0.0 0.21 (1)	7.25			
J-I	0 / 0	-39.5	-39.5 0.33 (3)	10.00			
I-H	0 / 554	-39.5	-39.5 0.39 (2)	10.00			
H-G	0 / 554	-39.5	-39.5 0.39 (2)	10.00			
G-F	0 / 0	-39.5	-39.5 0.21 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
	DL = 6.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.36/1.00 (E-F:1), BC=0.39/1.00 (G-I:2), WB=0.27/1.00 (D-G:1), SSI=0.17/1.00 (I-J:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (B) (INPUT = 0.90)
JSI METAL= 0.44 (B) (INPUT = 1.00)

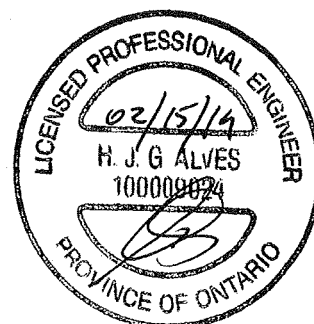


DRWG NO. TAM 77403481
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	G103	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:32 2019 Page 1

ID:2Jul7VJZDQIUmwWYL4tF1nyS9e7-hgYazx6Zkuq4OfGvP8PwwvBQnGm5DyUNo9RWgzkvgn

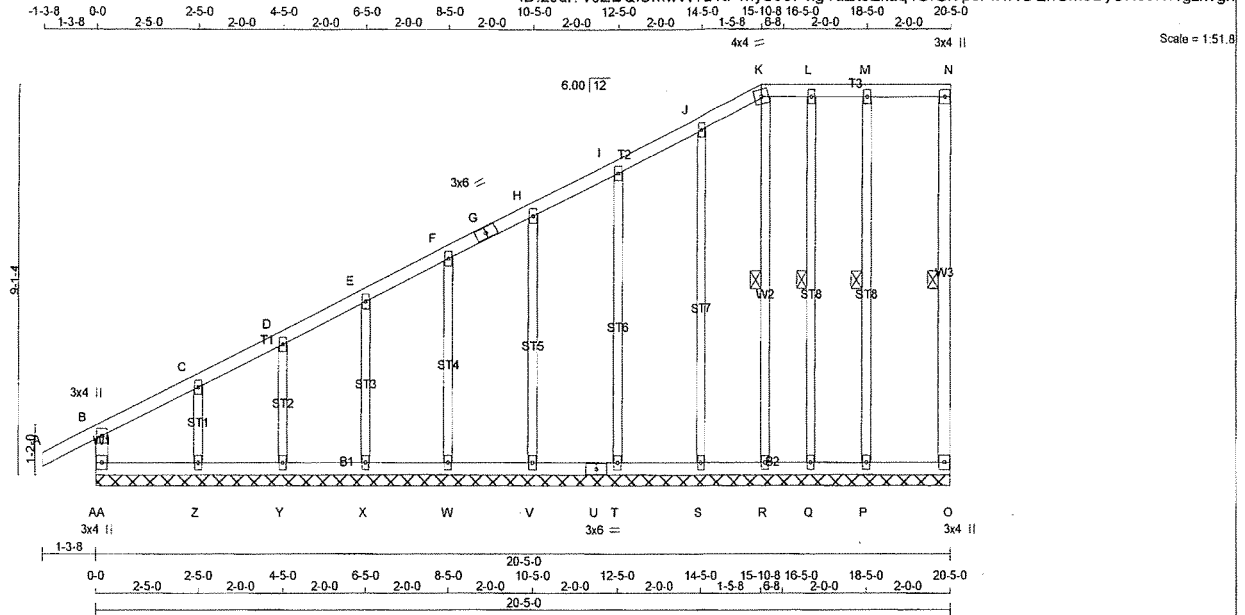

TOTAL WEIGHT = 4 X 109 = 437 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - G	2x4	DRY	No.2
G - K	2x4	DRY	No.2
K - N	2x4	DRY	No.2
O - N	2x4	DRY	No.2
AA- B	2x4	DRY	No.2
AA- U	2x4	DRY	No.2
U - O	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT	2-0-0	OC.	

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
C, D, E, F, H, I, J, L, M				
C	TMV+w	MT20	2.0	4.0
G	TS-t	MT20	3.0	6.0
K	TTW-m	MT20	4.0	4.0
N	TMV+p	MT20	3.0	4.0
O	BMV1+p	MT20	3.0	4.0
P, Q, R, S, T, V, W, X, Y, Z				
P	BMV1+w	MT20	2.0	4.0
U	BS-t	MT20	3.0	6.0
AA	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF N-O, M-P, L-Q, K-R.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO			FR-TO				
A-B	0/24	-77.7	-77.7 0.10 (1)	10.00	P-M	-139/0	0.08 (1)		
B-C	-24/0	-77.7	-77.7 0.05 (1)	6.25	Q-L	-94/0	0.05 (1)		
C-D	-18/0	-77.7	-77.7 0.04 (1)	6.25	S-J	-139/0	0.19 (1)		
D-E	-13/0	-77.7	-77.7 0.04 (1)	6.25	T-I	-158/0	0.15 (1)		
E-F	-10/0	-77.7	-77.7 0.04 (1)	6.25	V-H	-154/0	0.10 (1)		
F-G	-8/0	-77.7	-77.7 0.04 (1)	10.00	W-F	-154/0	0.07 (1)		
G-H	-8/0	-77.7	-77.7 0.04 (1)	10.00	X-E	-155/0	0.04 (1)		
H-I	-6/0	-77.7	-77.7 0.04 (1)	10.00	Y-D	-150/0	0.03 (1)		
I-J	-6/0	-77.7	-77.7 0.04 (1)	10.00	Z-C	-165/0	0.03 (1)		
J-K	-6/0	-77.7	-77.7 0.03 (1)	10.00	R-K	-99/0	0.05 (1)		
K-L	-2/0	-77.7	-77.7 0.02 (1)	10.00					
L-M	-2/0	-77.7	-77.7 0.03 (1)	10.00					
M-N	-2/0	-77.7	-77.7 0.03 (1)	10.00					
O-N	-73/0	0.0	0.0 0.01 (1)	6.25					
AA-B	-211/0	0.0	0.0 0.02 (2)	7.81					
AA-Z	0/20	-39.5	-39.5 0.04 (3)	10.00					
Z-Y	0/15	-39.5	-39.5 0.04 (3)	10.00					
Y-X	0/12	-39.5	-39.5 0.03 (3)	10.00					
X-W	0/9	-39.5	-39.5 0.03 (3)	10.00					
W-V	0/7	-39.5	-39.5 0.02 (3)	10.00					
V-U	0/6	-39.5	-39.5 0.03 (3)	10.00					
U-T	0/6	-39.5	-39.5 0.03 (3)	10.00					
T-S	0/4	-39.5	-39.5 0.03 (3)	10.00					
S-R	0/3	-39.5	-39.5 0.02 (3)	10.00					
R-Q	0/2	-39.5	-39.5 0.01 (3)	10.00					
Q-P	0/2	-39.5	-39.5 0.03 (3)	10.00					
P-O	0/2	-39.5	-39.5 0.03 (3)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.9 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.4 PSF
TOTAL LOAD = 44.8 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.10/1.00 (A-B 1), BC=0.04/1.00 (Z-AA:3)
WB=0.19/1.00 (J-S:1), SSI=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.60 (K) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

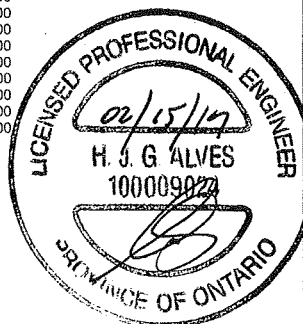


DRWG NO. TAM 17203482
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	G104	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:33 2019 Page 1

ID:2Jul?VJZDQiUmwWYL4IF1nyS9e7-9s6yAH7BVByx0pru3XgeT7SNzBczqgCecSv_26zkvgm

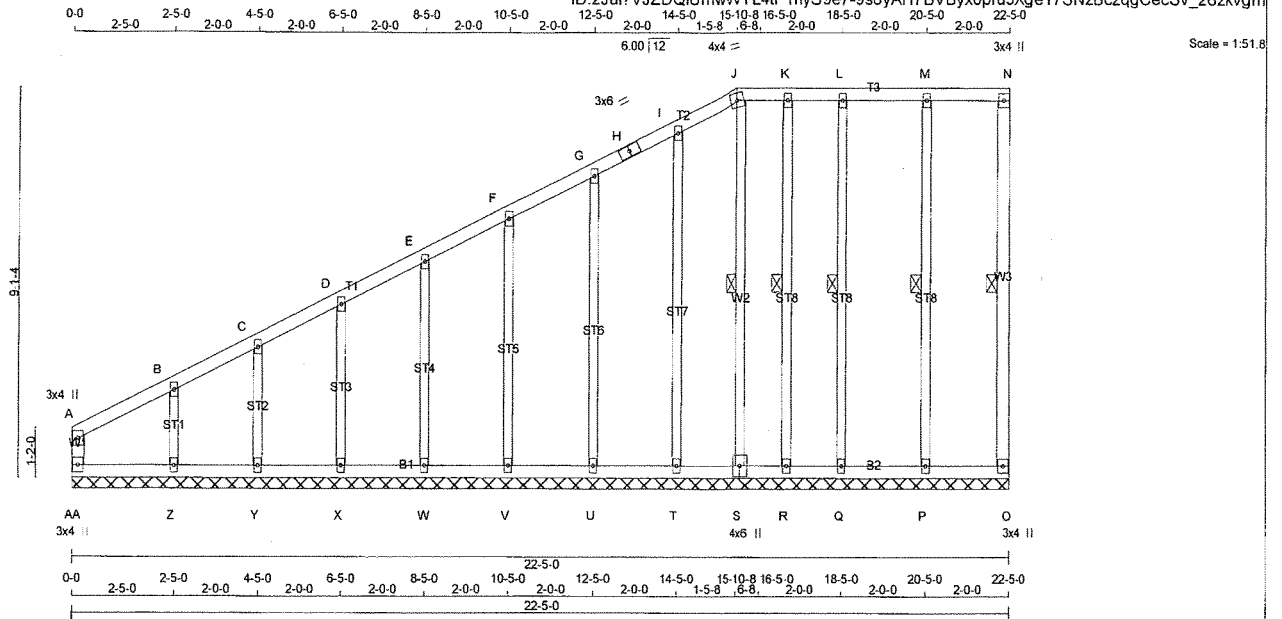

TOTAL WEIGHT = 2 X 119 = 238 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - H	2x4 DRY	No.2	SPF
H - J	2x4 DRY	No.2	SPF
J - N	2x4 DRY	No.2	SPF
O - N	2x4 DRY	No.2	SPF
AA- A	2x4 DRY	No.2	SPF
AA- S	2x4 DRY	No.2	SPF
S - O	2x4 DRY	No.2	SPF

ALL WEBS	2x3 DRY	No.2	SPF
ALL GABLE WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A - TMV+p	MT20	3.0	4.0		
B, C, D, E, F, G, I, K, L, M	MT20	2.0	4.0		
H - TS-t	MT20	3.0	6.0		
J - TTW-m	MT20	4.0	4.0		
N - TMV+p	MT20	3.0	4.0		
O - BMV1+p	MT20	3.0	4.0		
P, Q, R, T, U, V, W, X, Y, Z	MT20	2.0	4.0		
S - BSW1+i	MT20	4.0	6.0		
AA - BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF N-O, M-P, L-Q, K-R, J-S.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	-19/0	-77.7	-77.7	0.05 (1)	6.25	P-M	-168 / 0	0.09 (1)	
B-C	-20/0	-77.7	-77.7	0.05 (1)	6.25	Q-L	-131 / 0	0.07 (1)	
C-D	-12/0	-77.7	-77.7	0.04 (1)	6.25	R-K	-92 / 0	0.05 (1)	
D-E	-10/0	-77.7	-77.7	0.04 (1)	6.25	T-I	-139 / 0	0.19 (1)	
E-F	-8/0	-77.7	-77.7	0.04 (1)	10.00	U-G	-158 / 0	0.15 (1)	
F-G	-8/0	-77.7	-77.7	0.04 (1)	10.00	V-F	-154 / 0	0.10 (1)	
G-H	-8/0	-77.7	-77.7	0.04 (1)	10.00	W-E	-154 / 0	0.07 (1)	
H-I	-8/0	-77.7	-77.7	0.04 (1)	10.00	X-D	-156 / 0	0.04 (1)	
I-J	-8/0	-77.7	-77.7	0.03 (1)	10.00	Y-C	-146 / 0	0.03 (1)	
J-K	-2/0	-77.7	-77.7	0.02 (1)	10.00	Z-B	-182 / 0	0.03 (1)	
K-L	-2/0	-77.7	-77.7	0.03 (1)	10.00	S-J	-100 / 0	0.05 (1)	
L-M	-2/0	-77.7	-77.7	0.04 (1)	10.00				
M-N	-2/0	-77.7	-77.7	0.04 (1)	10.00				
O-N	-69/0	0.0	0.0	0.01 (1)	6.25				
AA-A	-93/0	0.0	0.0	0.02 (1)	7.81				
AA-Z	0/21	-39.5	-39.5	0.04 (2)	10.00				
Z-Y	0/15	-39.5	-39.5	0.04 (2)	10.00				
Y-X	0/12	-39.5	-39.5	0.03 (3)	10.00				
X-W	0/9	-39.5	-39.5	0.03 (3)	10.00				
W-V	0/7	-39.5	-39.5	0.02 (3)	10.00				
V-U	0/6	-39.5	-39.5	0.02 (3)	10.00				
U-T	0/4	-39.5	-39.5	0.02 (3)	10.00				
T-S	0/3	-39.5	-39.5	0.02 (3)	10.00				
S-R	0/2	-39.5	-39.5	0.01 (3)	10.00				
R-Q	0/2	-39.5	-39.5	0.02 (3)	10.00				
Q-P	0/2	-39.5	-39.5	0.03 (3)	10.00				
P-O	0/2	-39.5	-39.5	0.03 (3)	10.00				

REGISTERED PROFESSIONAL

02/16/17

H. J. ...

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	20.9	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	44.8	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (A-B:1), BC=0.04/1.00 (Z-AA:2), WB=0.19/1.00 (I-T:1), SS=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.60 (J) (INPUT = 0.90)

JSI METAL= 0.08 (B) (INPUT = 1.00)

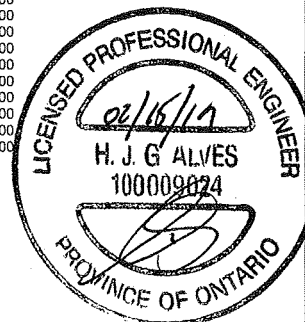


DWG NO. TAM 17903483
STRUCTURAL
COMPONENT ONLY

JOB NAME 401350	TRUSS NAME G105	QUANTITY 2	PLY 1	JOB DESC. BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:34 2019 Page 1

ID: 2Jul?VJZDQiUmwWYL4tF1nyS9e7-d3gK0d8pGV40ezP5dEBt0L?YubyLZ9zn6eYaYzkvg

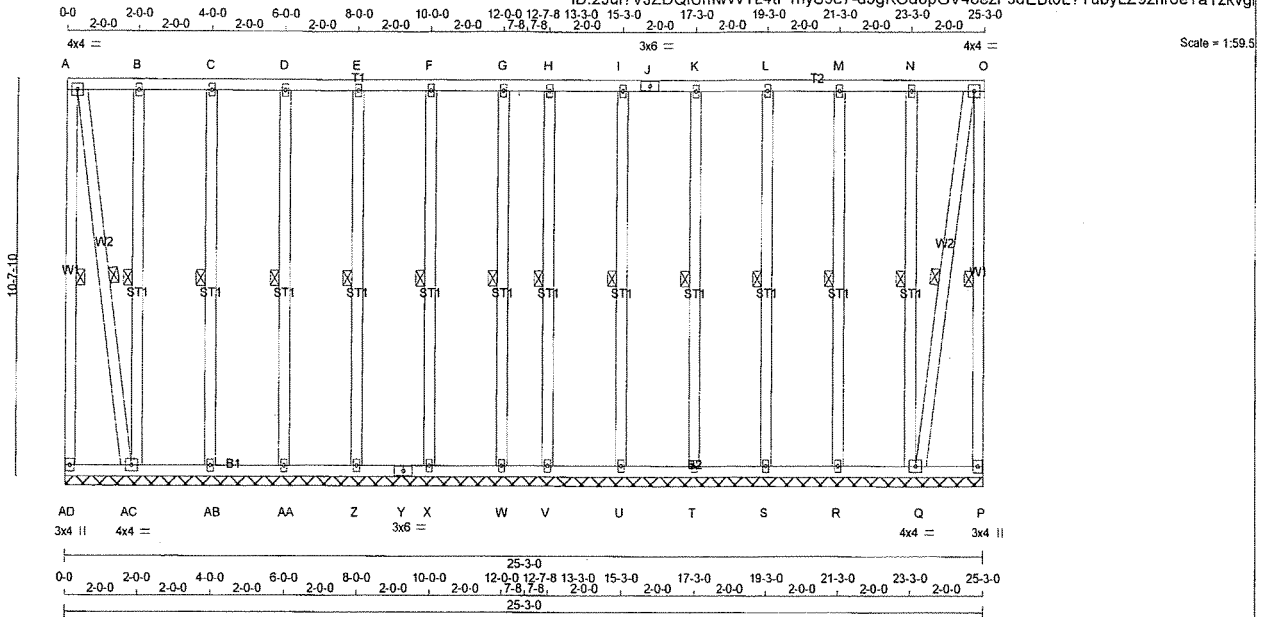

TOTAL WEIGHT = 2 X 241 = 482 lb [M]

LUMBER

N. L. G. A. RULES

CHORDS SIZE

AD- A	2x4	DRY	No.2
A - J	2x4	DRY	No.2
J - O	2x4	DRY	No.2
P - O	2x4	DRY	No.2
AD- Y	2x4	DRY	No.2
Y - P	2x4	DRY	No.2

ALL WEBS 2x4 DRY No.2 SPF

ALL GABLE WEBS 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0		
B, C, D, E, F, G, H, I, K, L, M, N						
B	TMVW-w	MT20	2.0	4.0		
J	TS-t	MT20	3.0	6.0		
O	TMVW-t	MT20	4.0	4.0		
P	BMV1+p	MT20	3.0	4.0		
Q	BMVW1-t	MT20	4.0	4.0		
R, S, T, U, V, W, X, Z, AA, AB						
R	BMW1+w	MT20	2.0	4.0		
Y	BS-t	MT20	3.0	6.0		
AC	BMVW1-t	MT20	4.0	4.0		
AD	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-AD, O-P, N-Q, M-R, L-S, K-T, I-U, H-V, B-AC, C-AB, D-AA, E-Z, F-X, G-W, A-AC, O-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO	FR-TO	
AD-A	-33/0	0.0 0.0 0.02 (1)	Q-N	-171/0
A-B	0/5	-77.7 -77.7 0.04 (1)	R-M	-154/0
B-C	0/0	-77.7 -77.7 0.04 (1)	S-L	-155/0
C-D	0/0	-77.7 -77.7 0.04 (1)	T-K	-155/0
D-E	0/0	-77.7 -77.7 0.04 (1)	U-I	-159/0
E-F	0/0	-77.7 -77.7 0.04 (1)	V-H	-123/0
F-G	0/0	-77.7 -77.7 0.04 (1)	AC-B	-171/0
G-H	0/0	-77.7 -77.7 0.03 (1)	AB-C	-154/0
H-I	0/0	-77.7 -77.7 0.04 (1)	AA-D	-155/0
I-J	0/0	-77.7 -77.7 0.04 (1)	Z-E	-155/0
J-K	0/0	-77.7 -77.7 0.04 (1)	X-F	-159/0
K-L	0/0	-77.7 -77.7 0.04 (1)	W-G	-123/0
L-M	0/0	-77.7 -77.7 0.04 (1)	A-AC	-31/0
M-N	0/5	-77.7 -77.7 0.04 (1)	Q-O	-31/0
N-O	0/5	-77.7 -77.7 0.04 (1)		
P-O	-33/0	0.0 0.0 0.02 (1)		
AD-AC	0/0	-39.5 -39.5 0.03 (3)		
AC-AB	0/0	-39.5 -39.5 0.03 (3)		
AB-AA	0/0	-39.5 -39.5 0.03 (3)		
AA-Z	0/0	-39.5 -39.5 0.02 (3)		
Z-Y	0/0	-39.5 -39.5 0.03 (3)		
Y-X	0/0	-39.5 -39.5 0.03 (3)		
X-W	0/0	-39.5 -39.5 0.03 (3)		
W-V	0/0	-39.5 -39.5 0.02 (3)		
V-U	0/0	-39.5 -39.5 0.03 (3)		
U-T	0/0	-39.5 -39.5 0.03 (3)		
T-S	0/0	-39.5 -39.5 0.02 (3)		
S-R	0/0	-39.5 -39.5 0.03 (3)		
R-Q	0/0	-39.5 -39.5 0.03 (3)		
Q-P	0/0	-39.5 -39.5 0.03 (3)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
	DL = 6.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.04/1.00 (A-B:1), BC=0.03/1.00 (AC-AD:3), WB=0.10/1.00 (B-AC:1), SSI=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE	GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SSI GRIP= 0.50 (AC) (INPUT = 0.90)
METAL= 0.04 (N) (INPUT = 1.00)

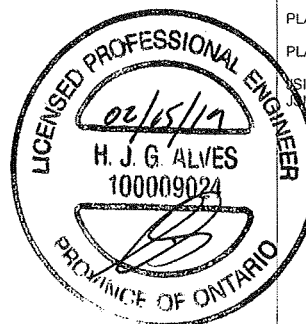


DWG NO. TAM 71703484
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	G106	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Fri Feb 15 12:09:35 2019 Page 1

ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-5FEibz8R0pCfF7_HAyisYYXj?Hblbvw3mO56_zkvgk

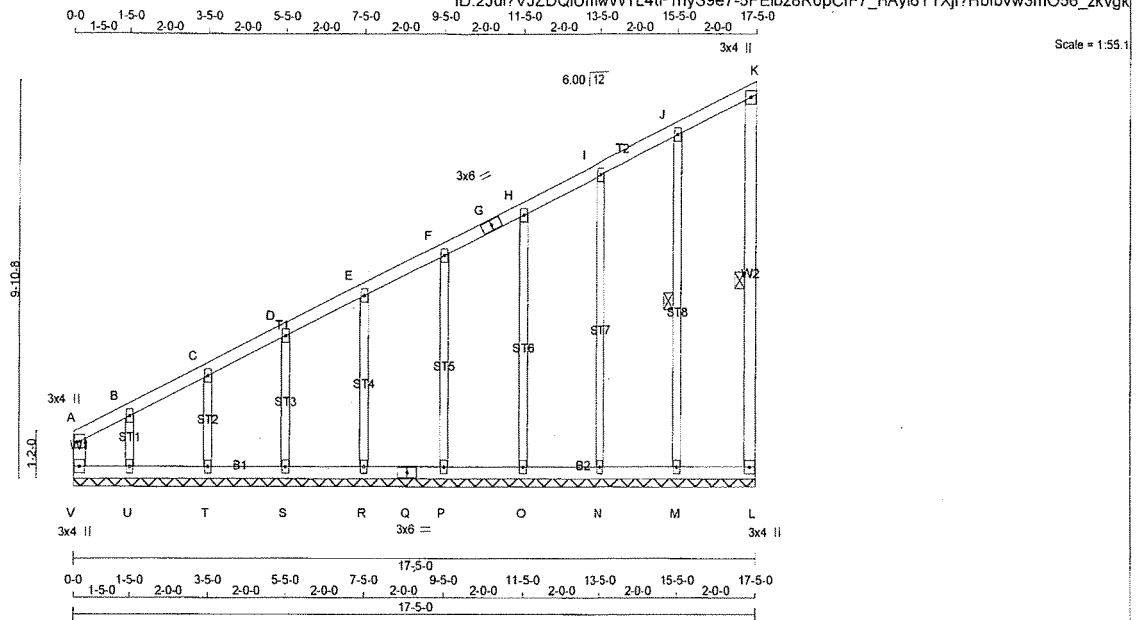

TOTAL WEIGHT = 2 X 85 = 170 lb
[M]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - G	2x4	DRY	No.2
G - K	2x4	DRY	No.2
L - K	2x4	DRY	No.2
V - A	2x4	DRY	No.2
V - Q	2x4	DRY	No.2
Q - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
ALL GABLE WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B, C, D, E, F, H, I, J						
B	TMV+w	MT20	2.0	4.0		
G	TS-t	MT20	3.0	6.0		
K	TMV+p	MT20	3.0	4.0		
L	BMV1+p	MT20	3.0	4.0		
M, N, O, P, R, S, T, U						
M	BMV1+w	MT20	2.0	4.0		
Q	BS-t	MT20	3.0	6.0		
V	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF K-L, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	-22 / 0	-77.7 -77.7	0.03 (1)	6.25	M-J	-167 / 0	0.09 (1)
B-C	-17 / 0	-77.7 -77.7	0.04 (1)	6.25	N-I	-154 / 0	0.18 (1)
C-D	-14 / 0	-77.7 -77.7	0.04 (1)	6.25	O-H	-155 / 0	0.12 (1)
D-E	-11 / 0	-77.7 -77.7	0.04 (1)	6.25	P-F	-154 / 0	0.08 (1)
E-F	-8 / 0	-77.7 -77.7	0.04 (1)	10.00	R-E	-155 / 0	0.05 (1)
F-G	-6 / 0	-77.7 -77.7	0.04 (1)	10.00	S-D	-153 / 0	0.04 (1)
G-H	-6 / 0	-77.7 -77.7	0.04 (1)	10.00	T-C	-158 / 0	0.03 (1)
H-I	-5 / 0	-77.7 -77.7	0.04 (1)	10.00	U-B	-130 / 0	0.02 (1)
I-J	-3 / 0	-77.7 -77.7	0.04 (1)	10.00			
J-K	-6 / 0	-77.7 -77.7	0.04 (1)	10.00			
L-K	-70 / 0	0.0 0.0	0.01 (1)	6.25			
V-A	-57 / 0	0.0 0.0	0.01 (1)	7.81			
V-U	0 / 22	-39.5 -39.5	0.02 (3)	10.00			
U-T	0 / 17	-39.5 -39.5	0.03 (2)	10.00			
T-S	0 / 13	-39.5 -39.5	0.03 (2)	10.00			
S-R	0 / 10	-39.5 -39.5	0.02 (3)	10.00			
R-Q	0 / 7	-39.5 -39.5	0.02 (3)	10.00			
Q-P	0 / 7	-39.5 -39.5	0.02 (3)	10.00			
P-O	0 / 6	-39.5 -39.5	0.02 (3)	10.00			
O-N	0 / 4	-39.5 -39.5	0.02 (3)	10.00			
N-M	0 / 3	-39.5 -39.5	0.03 (3)	10.00			
M-L	0 / 2	-39.5 -39.5	0.03 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9	PSF
	DL = 6.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 44.8	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.04/1.00 (J-K:1), BC=0.03/1.00 (M-N:3), WB=0.18/1.00 (I-N:1), SS=0.06/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.40 (F) (INPUT = 0.90)
JSI METAL= 0.07 (J) (INPUT = 1.00.)

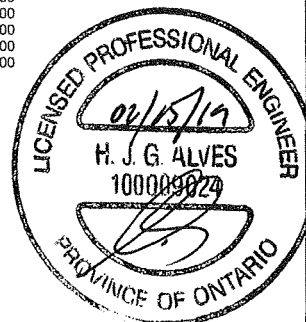


DWG NO. TAM 1703485
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	G107	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:36 2019 Page 1

ID:2Jul?VJZDQiUmWYL4tF1nyS9e7-ZRo4pJ93n6KWtGZTKfDL5m4tPPdf1134IQ7efRzkvgj

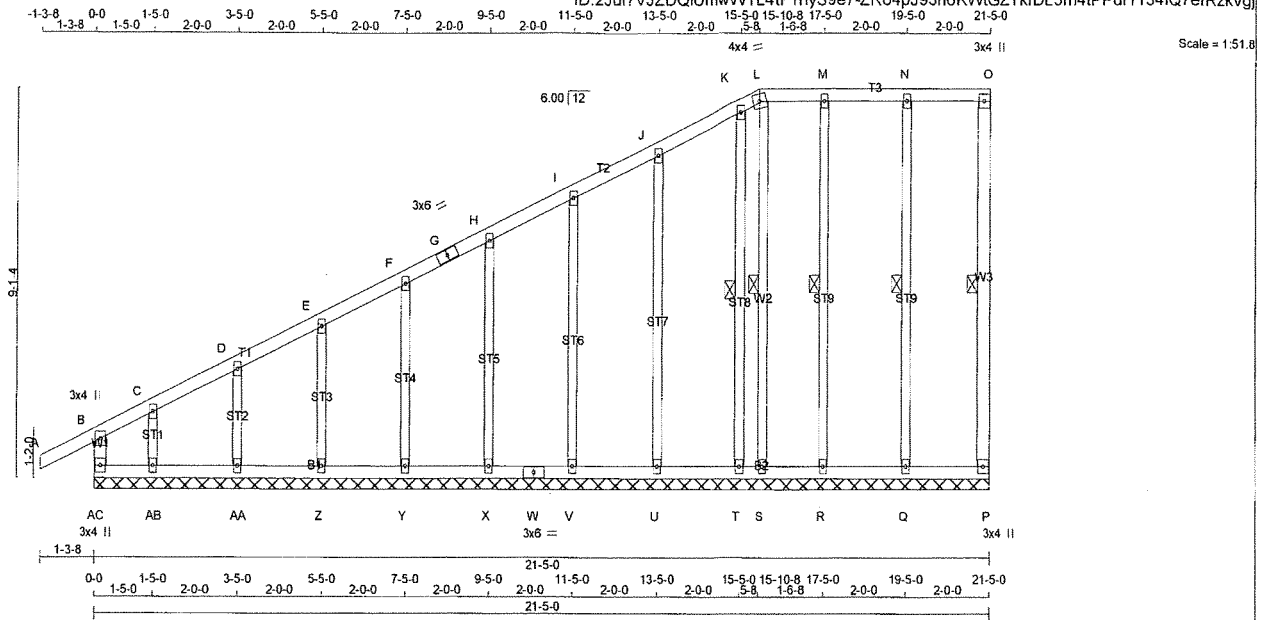

TOTAL WEIGHT = 2 X 115 = 231 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2
A - G	2x4	DRY	No.2
G - L	2x4	DRY	No.2
L - O	2x4	DRY	No.2
P - O	2x4	DRY	No.2
AC- B	2x4	DRY	No.2
AC- W	2x4	DRY	No.2
W - P	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C, D, E, F, H, I, J, K, M, N						
C	TMW+w	MT20	2.0	4.0		
G	TS-t	MT20	3.0	6.0		
L	TTW-m	MT20	4.0	4.0		
O	TMV+p	MT20	3.0	4.0		
P	BMV1+p	MT20	3.0	4.0		
Q, R, S, T, U, V, X, Y, Z, AA, AB						
Q	BMW1+w	MT20	2.0	4.0		
W	BS-t	MT20	3.0	6.0		
AC	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF O-P, N-Q, M-R, K-T, L-S.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO							
A-B	0/24	-77.7	-77.7	0.10 (1)	10.00	Q-N	-169 / 0
B-C	-40 / 0	-77.7	-77.7	0.08 (1)	6.25	R-M	-135 / 0
C-D	-15 / 0	-77.7	-77.7	0.04 (1)	6.25	T-K	-96 / 0
D-E	-15 / 0	-77.7	-77.7	0.04 (1)	6.25	U-J	-159 / 0
E-F	-11 / 0	-77.7	-77.7	0.04 (1)	6.25	V-I	-155 / 0
F-G	-9 / 0	-77.7	-77.7	0.04 (1)	10.00	X-H	-154 / 0
G-H	-9 / 0	-77.7	-77.7	0.04 (1)	10.00	Y-F	-155 / 0
H-I	-7 / 0	-77.7	-77.7	0.04 (1)	10.00	Z-E	-151 / 0
I-J	-5 / 0	-77.7	-77.7	0.04 (1)	10.00	AA-D	-166 / 0
J-K	-5 / 0	-77.7	-77.7	0.04 (1)	10.00	AB-C	-80 / 0
K-L	-4 / 0	-77.7	-77.7	0.02 (1)	10.00	S-L	-75 / 0
L-M	-1 / 0	-77.7	-77.7	0.03 (1)	10.00		
M-N	-1 / 0	-77.7	-77.7	0.04 (1)	10.00		
N-O	-1 / 0	-77.7	-77.7	0.04 (1)	10.00		
P-Q	-68 / 0	0.0	0.0	0.01 (1)	6.25		
AC-B	-207 / 0	0.0	0.0	0.04 (1)	7.81		
AC-AB	0 / 20	-39.5	-39.5	0.04 (1)	10.00		
AB-AA	0 / 17	-39.5	-39.5	0.03 (2)	10.00		
AA-Z	0 / 13	-39.5	-39.5	0.03 (2)	10.00		
Z-Y	0 / 10	-39.5	-39.5	0.02 (3)	10.00		
Y-X	0 / 8	-39.5	-39.5	0.02 (3)	10.00		
X-W	0 / 6	-39.5	-39.5	0.02 (3)	10.00		
W-V	0 / 6	-39.5	-39.5	0.02 (3)	10.00		
V-U	0 / 4	-39.5	-39.5	0.03 (3)	10.00		
U-T	0 / 3	-39.5	-39.5	0.03 (3)	10.00		
T-S	0 / 2	-39.5	-39.5	0.02 (3)	10.00		
S-R	0 / 1	-39.5	-39.5	0.02 (3)	10.00		
R-Q	0 / 1	-39.5	-39.5	0.03 (3)	10.00		
Q-P	0 / 1	-39.5	-39.5	0.03 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	20.9	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	44.8	PSF	

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.10/1.00 (A-B:1), BC=0.04/1.00 (AB-AC:1), WB=0.19/1.00 (J-U:1), SSI=0.07/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667
	MAX	MIN	MAX
	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.60 (L) (INPUT = 0.90)
JSI METAL= 0.07 (D) (INPUT = 1.00)

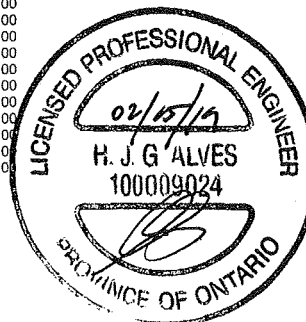


DRWG NO. TAM 1703486
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	PB1	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Fri Feb 15 12:09:37 2019 Page 1
ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-1dMT0eAiYQSNVQ8gInKadzc?qoxXmV9DX4tCBtzkv9

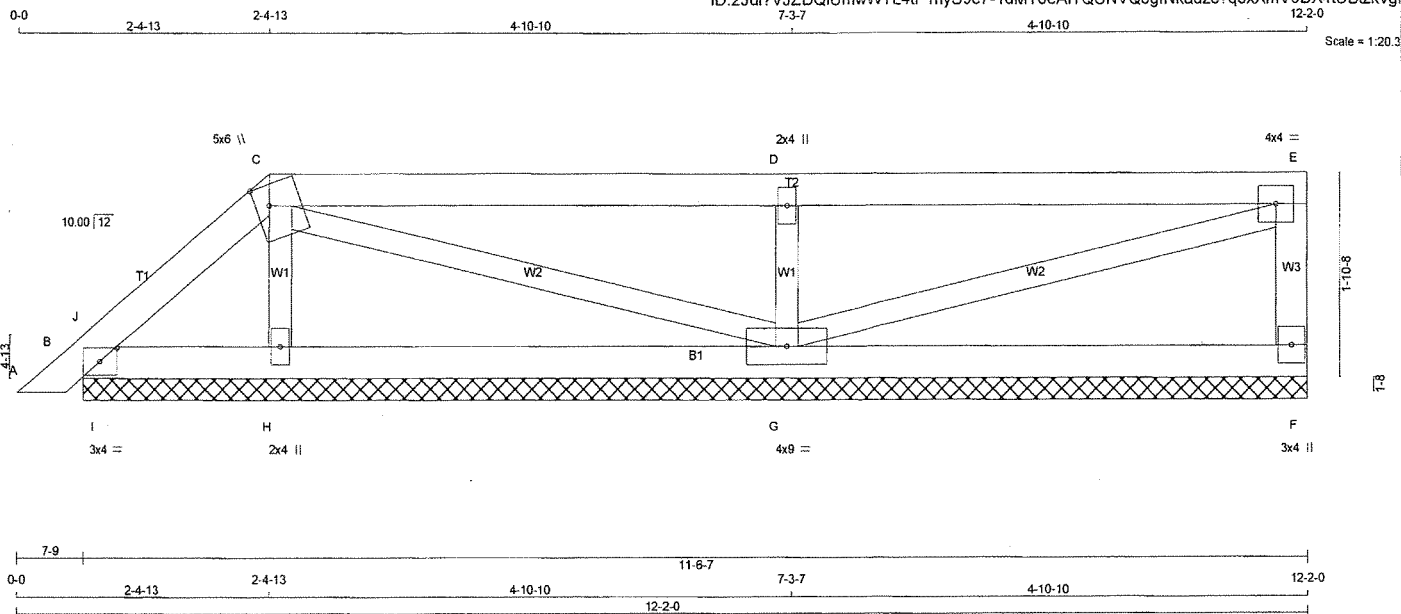

TOTAL WEIGHT = 6 X 39 = 235 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
F - E	2x4	DRY No.2	SPF
B - F	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
DRY, SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	1.50	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMW+w	MT20	2.0	4.0		
E	TMVW-I	MT20	4.0	4.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW1-I	MT20	4.0	9.0		
H	BMW1+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
F	221	0	221	0	11-6-7	11-6-7
B	149	0	149	0	11-6-7	11-6-7
H	320	0	320	0	11-6-7	11-6-7
G	704	0	704	0	11-6-7	11-6-7

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	169	78 / 0	40 / 0	0 / 0	0 / 0	51 / 0	0 / 0
B	106	75 / 0	6 / 0	0 / 0	0 / 0	25 / 0	0 / 0
H	253	94 / 0	77 / 0	0 / 0	0 / 0	81 / 0	0 / 0
G	535	258 / 0	119 / 0	0 / 0	0 / 0	158 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, B, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 / 12	-77.7	-77.7	0.02 (1)	10.00	H-C	-160 / 0	0.02 (1)	
B-J	-19 / 9	-77.7	-77.7	0.01 (1)	6.25	C-G	-23 / 0	0.01 (1)	
J-C	-46 / 0	-77.7	-77.7	0.02 (1)	6.25	G-D	-474 / 0	0.07 (1)	
C-D	0 / 0	-77.7	-77.7	0.31 (1)	10.00	G-E	0 / 0	0.00 (1)	
D-E	0 / 0	-77.7	-77.7	0.31 (1)	10.00	I-J	-106 / 0	0.00 (1)	
F-E	-144 / 0	0.0	0.0	0.02 (1)	7.81				
B-I	0 / 32	-39.5	-39.5	0.04 (1)	10.00				
I-H	0 / 32	-39.5	-39.5	0.09 (3)	10.00				
H-G	0 / 21	-39.5	-39.5	0.19 (3)	10.00				
G-F	0 / 0	-39.5	-39.5	0.19 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 20.9 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.4 PSF
TOTAL LOAD = 44.8 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.31/1.00 (C-D:1), BC=0.19/1.00 (G-H:3), WB=0.07/1.00 (D-G:1), SSI=0.19/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (D) (INPUT = 0.90)
JSI METAL= 0.10 (D) (INPUT = 1.00)




DWG NO. TAM 17903487
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLD UNITS 5 - 10	DRWG NO.
401350	PB2	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:38 2019 Page 1
ID:2Jul7VJZDQIUmwWYL4tF1nyS9e7-VWqrD_BKJkbE6ajss4FpAB9CGCIsVzTNikcljJzkvgh

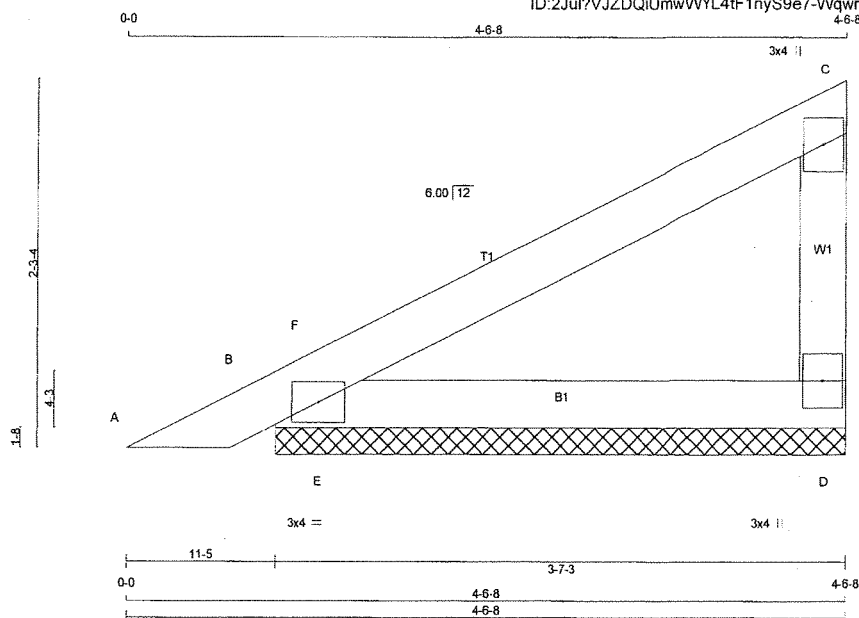

TOTAL WEIGHT = 4 X 12 = 47 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0		
C	TMV1-p	MT20	3.0	4.0		
D	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

BEARINGS			MAXIMUM FACTORED			INPUT	REQD
JT	FACTORED GROSS REACTION		GROSS REACTION			BRG	BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
D	211	0	211	0	0	3-7-3	3-7-3
B	279	0	279	0	0	3-7-3	3-7-3

UNFACTORED REACTIONS

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	161	75 / 0	38 / 0	0 / 0	0 / 0	48 / 0	0 / 0
B	208	112 / 0	38 / 0	0 / 0	0 / 0	59 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 14	-77.7	-77.7 0.04 (1)	10.00	E-F	-111 / 76 0.00 (1)	
B-F	-47 / 0	-77.7	-77.7 0.06 (3)	6.25			
F-C	0 / 5	-77.7	-77.7 0.14 (1)	10.00			
D-C	-127 / 0	0.0	0.0 0.01 (1)	7.81			
B-E	0 / 0	-39.5	-39.5 0.09 (1)	10.00			
E-D	0 / 0	-39.5	-39.5 0.12 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 20.9 PSF
	DL = 6.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (C-F:1), BC=0.12/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.13/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
		788	1987
			1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.04 (B) (INPUT = 1.00)




DWG NO. TAM 77903488
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	BLOCK 2 FREEHOLDUNITS 5 - 10	DRWG NO.
401350	PB7	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Fri Feb 15 12:09:39 2019 Page 1

ID:2Jul?VJZDQiUmwWYL4tF1nyS9e7-_0TDKRBy41j5kkl2Pnm2jOimBccyEQjW_OMJFmzkvgg

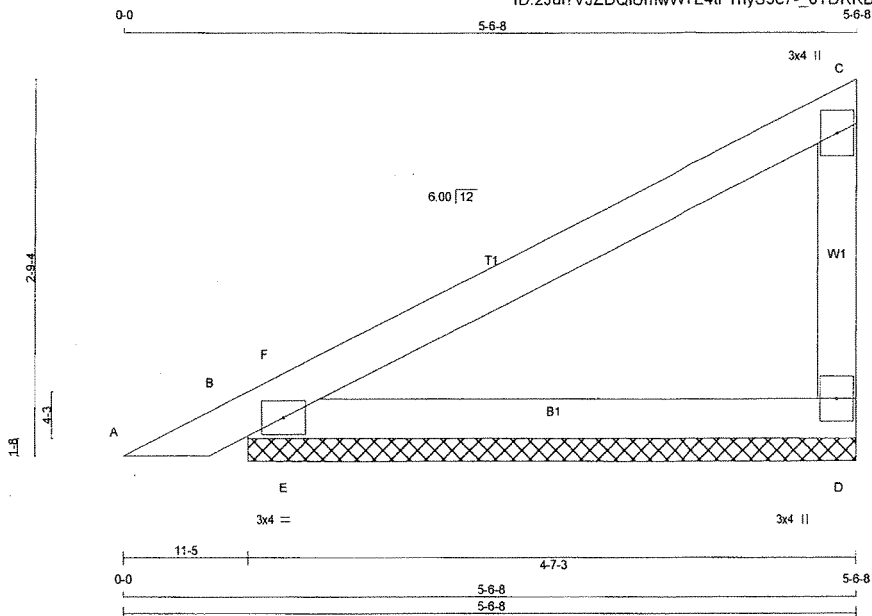

Scale = 1:16.4

TOTAL WEIGHT = 2 X 15 = 29 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - C	2x4 DRY	No.2
D - C	2x4 DRY	No.2
B - D	2x4 DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1+1	MT20	3.0	4.0		
C	TMV+p	MT20	3.0	4.0		
D	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
D	269	0	269	0	4-7-3	4-7-3
B	338	0	338	0	4-7-3	4-7-3

UNFACTORED REACTIONS

JT	1ST LCASE	MAX /MIN	COMPONENT REACTIONS
D	206	96 / 0	48 / 0
B	253	133 / 0	48 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO						FR-TO			
A-B	0 / 14	-77.7	-77.7	0.04 (1)	10.00	E-F	-172 / 120	0.00 (1)	
B-F	-72 / 0	-77.7	-77.7	0.08 (3)	6.25				
F-C	0 / 6	-77.7	-77.7	0.23 (1)	10.00				
D-C	-163 / 0	0.0	0.0	0.02 (1)	7.81				
B-E	0 / 0	-39.5	-39.5	0.13 (1)	10.00				
E-D	0 / 0	-39.5	-39.5	0.19 (2)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 20.9 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 10.5 PSF
	DL	= 7.4 PSF
TOTAL LOAD		= 44.8 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(60 % OF 20.9 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 20.9 P.S.F. SPECIFIED ROOF LIVE LOAD

CS1: TC=0.23/1.00 (C-F:1), BC=0.19/1.00 (D-E:2),
WB=0.00/1.00 (E-F:1), SSI=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.22 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



DRWG NO. TAM 77903490
STRUCTURAL
COMPONENT ONLY

LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab



Dome Double-Shear
Nailing Side View
(available on
some models)
U.S. Patent 5,603,580

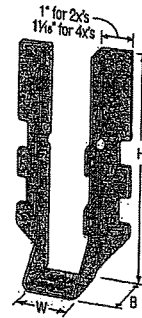


LUS28




LU26L




HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

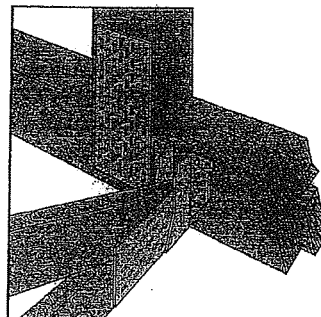

Plated Truss Connectors

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options information on pp. 125–127.


HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.46 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value

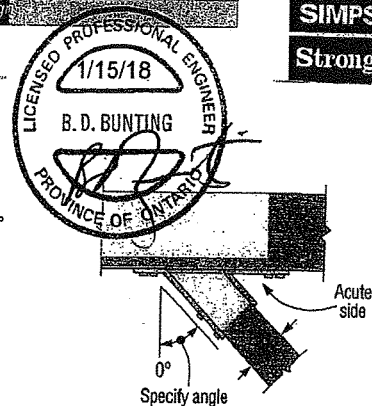**Standard and Double-Shear Joist Hangers (cont.)**

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _h ³	Header	Joist	D.F.C.		S-P-F	
								Uplift (K _h = 1.15)	Normal (K _h = 1.00)	Uplift (K _h = 1.15)	Normal (K _h = 1.00)
								lb.	lb.	lb.	lb.
								kN	kN	kN	kN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/4	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
LU26L	22	1 1/8	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
HUS26	16	1 1/8	5 1/4	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875
LJS26DS	18	1 1/8	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055	4265	1460	4115
HGUS26	12	1 1/8	5 1/4	5	4 1/4	(20) 16d	(8) 16d	2685	6625	2685	5700
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
HUS28	16	1 1/8	7 1/4	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2675	4345
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140	2495	1020	1770
LUS210	18	1 1/8	7 1/4	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_h is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.


Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.


These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _s ³	Header	Joist	D-Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K ₀ = 1.15) lb.	(K ₀ = 1.00) lb.	(K ₀ = 1.15) lb.	(K ₀ = 1.00) lb.
Double 2x Sizes											
LUS24-2	18	3 3/8	3 3/8	2	1 1/2	(4) 16d	(2) 16d	835	2020	590	1435
								835	2020	590	1435
LUS26-2	18	3 3/8	4 3/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
								1720	2595	1545	1920
HHUS26-2	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								2850	7335	2065	5205
HGUS26-2	12	3 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								4385	8950	3110	6355
LUS28-2	18	3 3/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
								1720	3325	1545	2575
HHUS28-2	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								3765	8940	2675	6345
HGUS28-2	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								6070	12980	4310	9215
LUS210-2	18	3 3/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
								2580	4500	2320	3195
HHUS210-2	14	3 3/8	9 3/8	3	8	(30) 16d	(10) 16d	4670	9660	4235	7000
								4670	9660	4235	7000
HGUS210-2	12	3 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								6840	14015	4855	10270
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								4385	8950	3110	6355
HGUS28-3	12	4 1/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								6070	12980	4310	9215
HHUS210-3	14	4 1/8	9	3	7 3/8	(30) 16d	(10) 16d	4670	9670	4235	8865
								4670	9670	4235	8865
HGUS210-3	12	4 1/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								6840	14645	4855	10400
Quadruple 2x Sizes											
HGUS26-4	12	6 3/8	5 3/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								4385	8950	3110	6355
HGUS28-4	12	6 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								6070	12980	4310	9215
HHUS210-4	14	6 3/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	4670	10155	4235	7210
								4670	10155	4235	7210
HGUS210-4	12	6 3/8	9 3/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
								6840	14645	4855	10400
HGUS212-4	12	6 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								7640	14995	5425	10645
HGUS214-4	12	6 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								10130	16400	7195	11645
4x Sizes											
LUS46	18	3 3/8	4 3/8	2	3 3/8	(4) 16d	(4) 16d	1720	2595	1545	1920
								1720	2595	1545	1920
HHUS46	14	3 3/8	5 3/8	3	3 3/8	(14) 16d	(6) 16d	2850	7335	2065	5205
								2850	7335	2065	5205
HGUS46	12	3 3/8	5 3/8	4	4 3/8	(20) 16d	(8) 16d	4385	8950	3110	6355
								4385	8950	3110	6355
LUS48	18	3 3/8	6 3/8	2	3 3/8	(6) 16d	(4) 16d	1720	3325	1545	2575
								1720	3325	1545	2575
HHUS48	14	3 3/8	7 3/8	3	6 3/8	(22) 16d	(8) 16d	3765	8940	2675	6345
								3765	8940	2675	6345
HGUS48	12	3 3/8	7 3/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
								6070	12980	4310	9215
LUS410	18	3 3/8	8 3/8	2	5 3/8	(8) 16d	(6) 16d	2580	4500	2320	3195
								2580	4500	2320	3195
HGUS410	12	3 3/8	9	4	8 3/8	(46) 16d	(16) 16d	6840	14015	4855	10270
								6840	14015	4855	10270
HGUS412	12	3 3/8	10 3/8	4	10 3/8	(56) 16d	(20) 16d	7640	14995	5425	10645
								7640	14995	5425	10645
HGUS414	12	3 3/8	12 3/8	4	11 3/8	(66) 16d	(22) 16d	10130	16400	7195	11645
								10130	16400	7195	11645



Plated Truss Connectors

See footnotes
on p. 258.

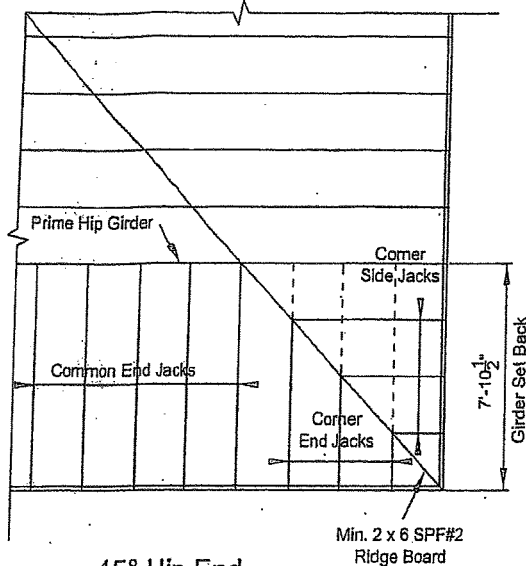

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD

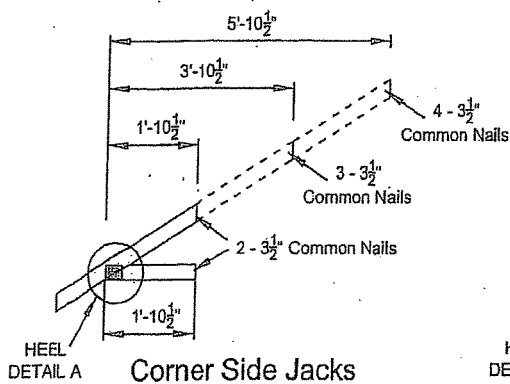


Corner Side Jacks

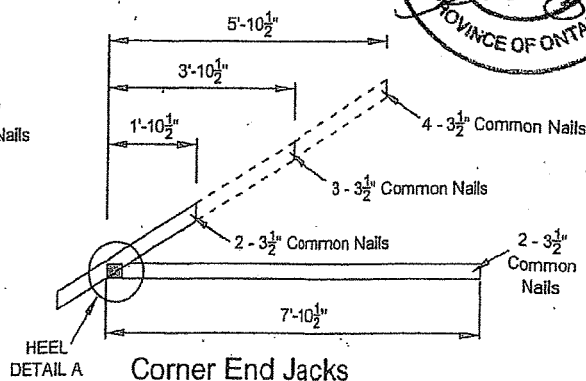

Corner End Jacks

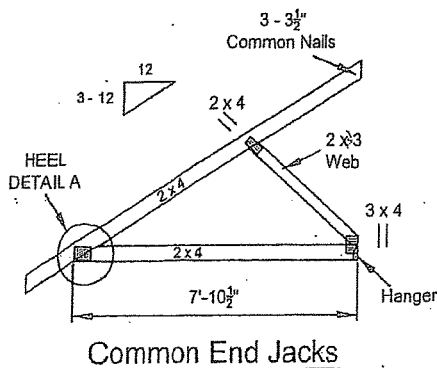


Common End Jacks

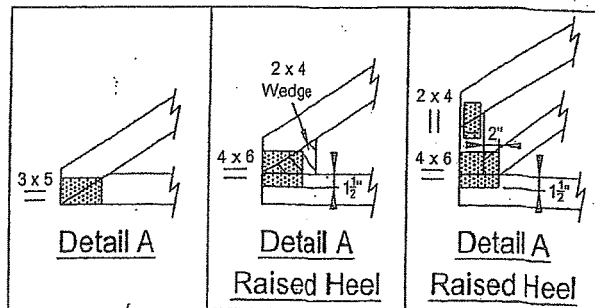

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800217

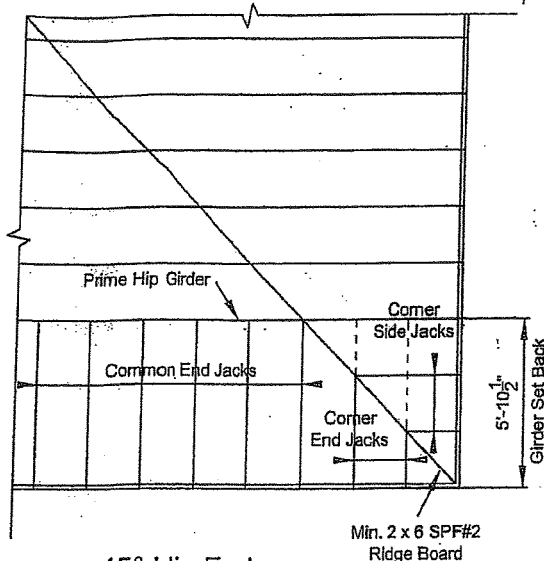

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD : 50.5 P.S.F

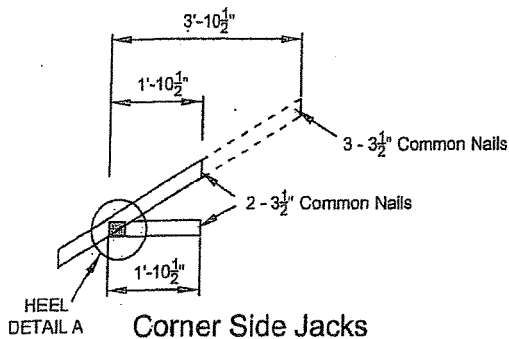


Corner Side Jacks

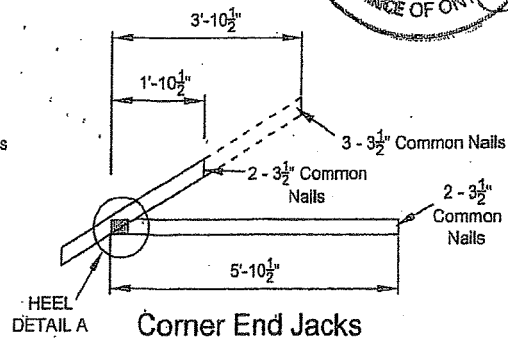

Corner End Jacks

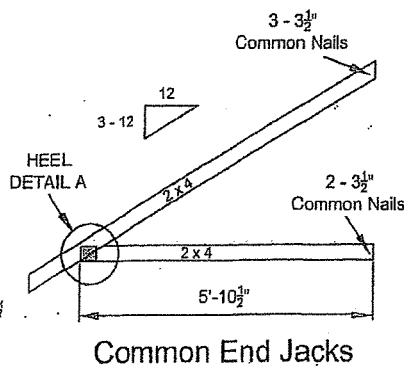

Common End Jacks


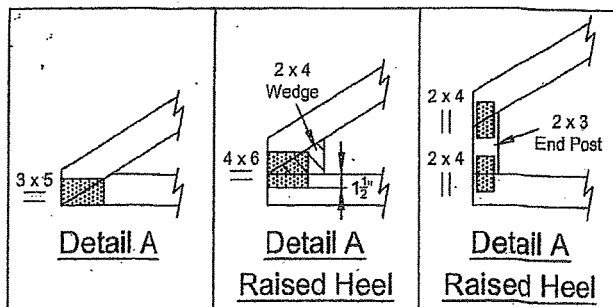


NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800216

Symbols

PLATE LOCATION AND ORIENTATION



— This symbol indicates the required direction of slots in connector plates.

*Plate location details available in Mitek software or upon request.

PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use 1, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in fractions of an inch or millimeters (Drawings not to scale)

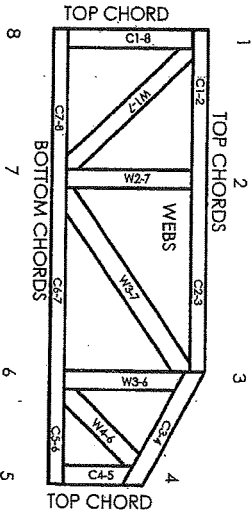

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12671-R

© 2007 Mitek® All Rights Reserved


Mitek Engineering Reference Sheet: MII-7473C rev. 10-08

MITEK
POWER TO PERFORMANCE™

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See AC308.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral bracing members may require bracing, or alternative I, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stock materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss of each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft, spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1800218

Feb 09, 2018