

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	67
J2	14-00-00	9 1/2" NI-40x	1	12
J3	12-00-00	9 1/2" NI-40x	1	36
J4	8-00-00	9 1/2" NI-40x	1	6
J5	6-00-00	9 1/2" NI-40x	1	12
J6	4-00-00	9 1/2" NI-40x	1	8
B11A DROP	18-00-00	VERSALAM-14 2.0E	3	3
B8	16-00-00	VERSALAM-10 2.0E	1	1
B9	16-00-00	VERSALAM-10 2.0E	4	4
B6	14-00-00	VERSALAM-10 2.0E	4	4
B12 DROP	12-00-00	VERSALAM-10 2.0E	2	2
B3	10-00-00	VERSALAM-10 2.0E	1	1
B2	8-00-00	VERSALAM-10 2.0E	1	1
B5	8-00-00	VERSALAM-10 2.0E	1	1
B13	6-00-00	VERSALAM-10 2.0E	1	1
B4	6-00-00	VERSALAM-10 2.0E	1	1
B7	6-00-00	VERSALAM-10 2.0E	1	1
B11 DROP	6-00-00	VERSALAM-10 2.0E	2	2
B1	4-00-00	VERSALAM-10 2.0E	1	1
B10 DROP	4-00-00	VERSALAM-10 2.0E	2	2

HANGERS SCHEDULE
H1-----IUS2.56/9.5
H2-----HUS1.81/10
H3-----HGUS410
H4-----LSSUH310

RIMBOARD
1-1/8" X 9 1/2" O.S.B

SUBFLOOR : 5/8" NAILED & GLUED

BBO--- BEAM BY OTHERS
APP---AS PER PLAN

--1 - 2 X 6 SPF # 2 squash block req'd on one side of each joist under interior load bearing walls.
--Multiple squash blocks are req'd under concentrated loads.


Do not scale - refer to architectural plans for dimensions

Ceramic tile application as per O.B.C. 9.30.6

S50-2 **ELEV. 'A' & 'B'**

SECOND FLOOR FRAMING


DESIGN LOADS:
LIVE LOAD : 40 PSF
DEAD LOAD : 15 PSF
DEAD LOAD : 20 PSF (TILED AREA)



WINDOW SEAT BY OTHERS @ ELEV. 'B'

T-1801001 - T-1801027

SITE COPY

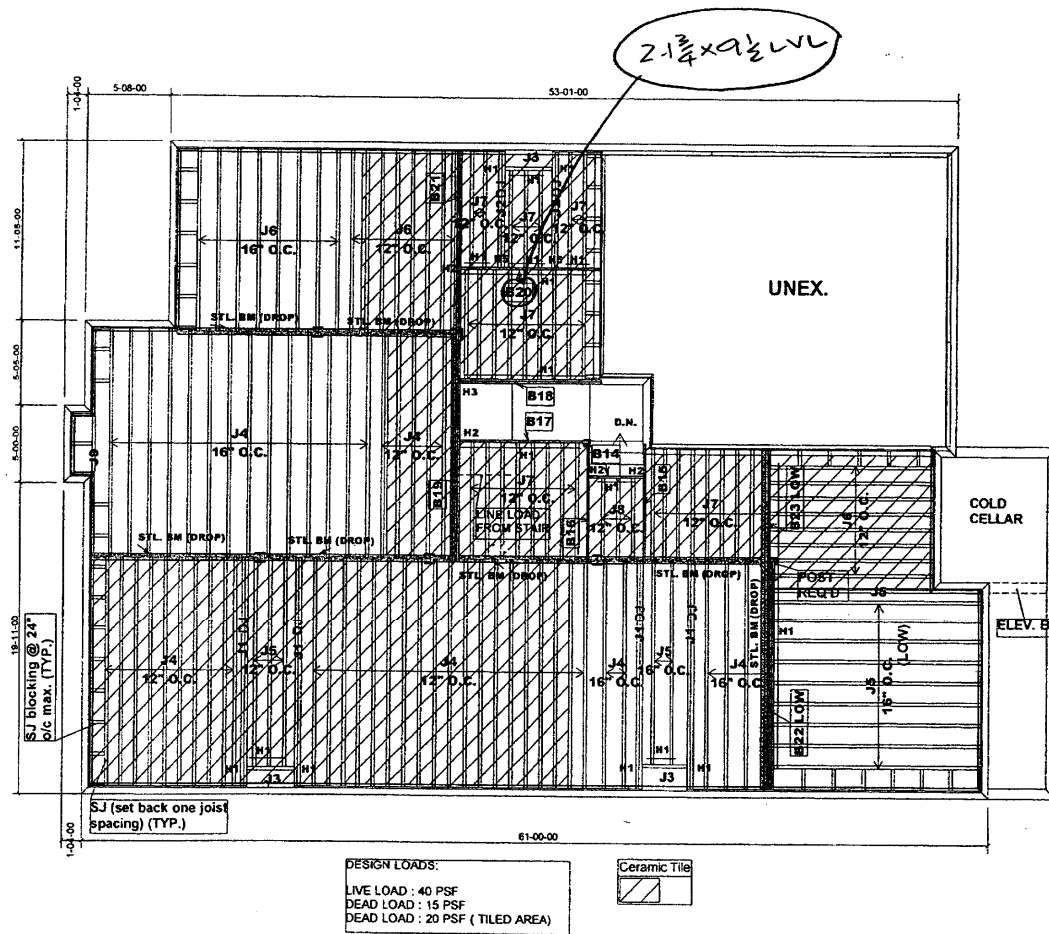

PlotID	Length	Products		
		Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-20	2	8
J2	8-00-00	9 1/2" NI-20	2	4
J3	4-00-00	9 1/2" NI-20	1	3
J4	16-00-00	9 1/2" NI-40x	1	54
J5	14-00-00	9 1/2" NI-40x	1	15
J6	12-00-00	9 1/2" NI-40x	1	24
J7	8-00-00	9 1/2" NI-40x	1	33
J8	6-00-00	9 1/2" NI-40x	1	3
J9	4-00-00	9 1/2" NI-40x	1	1
B22 LOW	16-00-00	VERSALAM-10 2.0E	3	3
B19	16-00-00	VERSALAM-10 2.0E	4	4
B21	12-00-00	VERSALAM-10 2.0E	2	2
B17	10-00-00	VERSALAM-10 2.0E	1	1
B20	10-00-00	VERSALAM-10 2.0E	1	1
B18	10-00-00	VERSALAM-10 2.0E	2	2
B15	8-00-00	VERSALAM-10 2.0E	1	1
B16	8-00-00	VERSALAM-10 2.0E	1	1
B23 LOW	8-00-00	VERSALAM-10 2.0E	1	1
B14	4-00-00	VERSALAM-10 2.0E	1	1

- HANGERS SCHEDULE**
- H1 — IUS2.56/9.5
 - H2 — HUS1.81/10
 - H3 — HGUS410
 - H5 — HU310-2
- RIMBOARD**
- 1-1/8" X 9 1/2" O.S.B
- SUBFLOOR : 5/8" NAILED & GLUED**
- BBO — BEAM BY OTHERS**
- APP — AS PER PLAN**

— 1 - 2 X 6 SPF # 2 squash block req'd on one side of each joist under interior load bearing walls.
 — Multiple squash blocks are req'd under concentrated loads.

Do not scale - refer to architectural plans for dimensions

Ceramic tile application as per O.B.C. 9.30.6

S50-2 **ELEV. 'A' & 'B'**

FIRST FLOOR FRAMING

AND W/OPT. W.O.D. COND.

DESIGN LOADS:
 LIVE LOAD : 40 PSF
 DEAD LOAD : 15 PSF
 DEAD LOAD : 20 PSF (TILED AREA)



JT:38514/84786 Builder: Bayview Wellington
 File: 263959 Project: Green Valley Estates


Location: Bradford
 Date: Jan. 26 / 2016

Designer: MQ
 Sheet: 2 of 3

Alpa Roof Trusses Inc.
 Maple, Ontario

Salesperson: Mario
 Tamarack Lumber

FCB-01-2018
 PL. 2

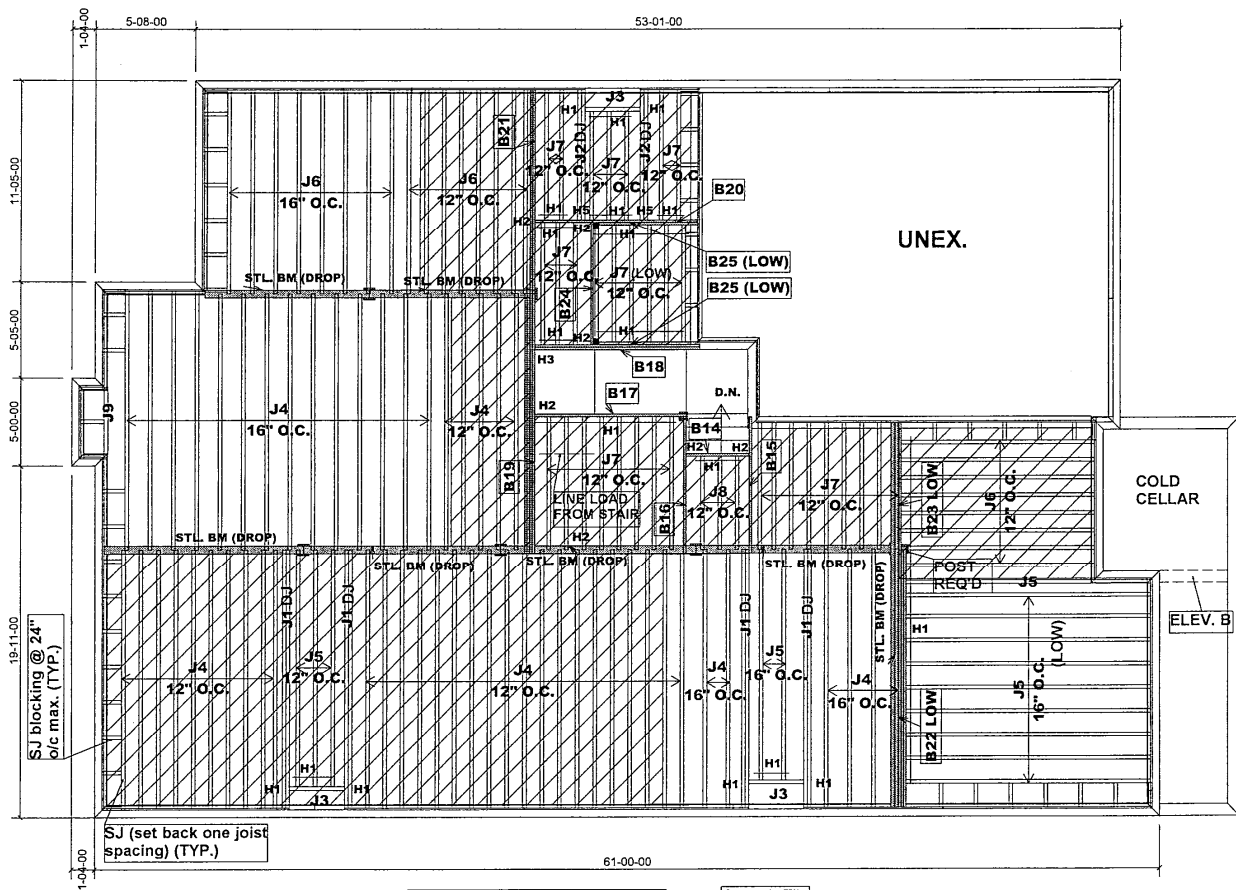

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-20	2	8
J2	8-00-00	9 1/2" NI-20	2	4
J3	4-00-00	9 1/2" NI-20	1	3
J4	16-00-00	9 1/2" NI-40x	1	54
J5	14-00-00	9 1/2" NI-40x	1	15
J6	12-00-00	9 1/2" NI-40x	1	24
J7	8-00-00	9 1/2" NI-40x	1	33
J8	6-00-00	9 1/2" NI-40x	1	3
J9	4-00-00	9 1/2" NI-40x	1	1
B22 LOW	16-00-00	VERSALAM-10 2.0E	3	3
B19	16-00-00	VERSALAM-10 2.0E	4	4
B21	12-00-00	VERSALAM-10 2.0E	2	2
B17	10-00-00	VERSALAM-10 2.0E	1	1
B20	10-00-00	VERSALAM-10 2.0E	1	1
B18	10-00-00	VERSALAM-10 2.0E	2	2
B15	8-00-00	VERSALAM-10 2.0E	1	1
B16	8-00-00	VERSALAM-10 2.0E	1	1
B23 LOW	8-00-00	VERSALAM-10 2.0E	1	1
B24	8-00-00	VERSALAM-10 2.0E	1	1
B25 (LOW)	8-00-00	VERSALAM-10 2.0E	1	1
B25 (LOW)	6-00-00	VERSALAM-10 2.0E	1	1
B14	4-00-00	VERSALAM-10 2.0E	1	1

HANGERS SCHEDULE

- H1-----IUS2.56/9.5
- H2-----HUS1.81/10
- H3-----HGUS410
- H5-----HU310-2

RIMBOARD

1-1/8" X 9 1/2" O.S.B
 SUBFLOOR : 5/8" NAILED & GLUED

BBO---- BEAM BY OTHERS
 APP---- AS PER PLAN

- 1 - 2 X 6 SPF # 2 squash block req'd on one side of each joist under interior load bearing walls.
- Multiple squash blocks are req'd under concentrated loads.

Do not scale - refer to architectural plans for dimensions

Ceramic tile application as per O.B.C. 9.30.6


S50-2 **ELEV. 'A' & 'B'**

FIRST FLOOR FRAMING

**W/OPT. SUNKEN COND.
 (-1R)/(-2R) AND MORE**

AND W/OPT. W.O.D. COND.

DESIGN LOADS:
 LIVE LOAD : 40 PSF
 DEAD LOAD : 15 PSF
 DEAD LOAD : 20 PSF (TILED AREA)



REVISED : JAN. 24, 2018

96434

JT:38514/84786

Builder: Bayview Wellington

Location: Bradford

Designer: MQ

Alpa Roof Trusses Inc.

Salesperson: Mario

File: (263959) 293765

Project: Green Valley Estates

Date: Jan. 26 / 2016

Sheet: 3 of 3

Maple, Ontario

Tamarack Lumber

SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\01

BC CALC® Design Report




Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 16:32:59

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\01
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

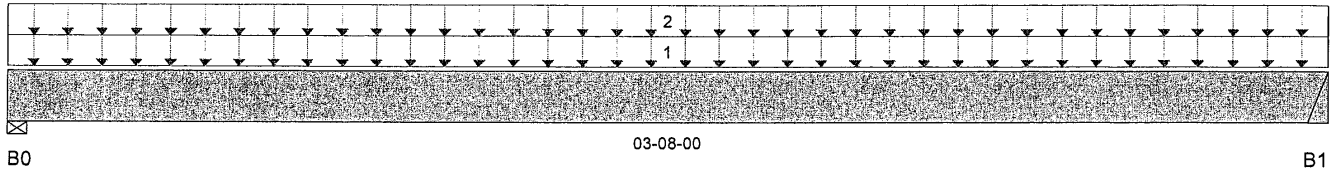

Total Horizontal Product Length = 03-08-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	480 / 0	189 / 0		
B1	449 / 0	177 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
1		Unf. Area (lb/ft ²)	L	00-00-00	03-08-00	40	15			03-04-00
2		Unf. Area (lb/ft ²)	L	00-00-00	03-08-00	40	15			03-00-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	701 ft-lbs	12,704 ft-lbs	5.5%	1	01-10-12
End Shear	410 lbs	5,785 lbs	7.1%	1	01-01-00
Total Load Defl.	L/999 (0.004")	n/a	n/a	4	01-10-12
Live Load Defl.	L/999 (0.003")	n/a	n/a	5	01-10-12
Max Defl.	0.004"	n/a	n/a	4	01-10-12
Span / Depth	4.2	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0 Wall/Plate	3-1/2" x 1-3/4"	957 lbs	25.4%	12.8%	Spruce Pine Fir
B1 Hanger	2" x 1-3/4"	894 lbs	n/a	20.9%	Hanger

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
 @ O.C., STAGGERED IN TWO ROWS



T-1801001
SITE COPY


BC CALC® Design Report

Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 16:33:11

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\02
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

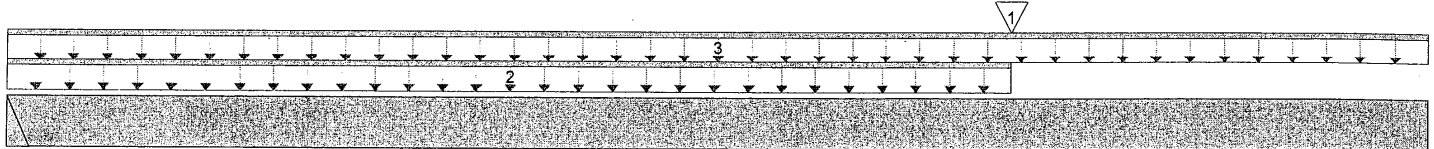

B0 07-05-00 B1

Total Horizontal Product Length = 07-05-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	313 / 0	136 / 0		
B1, 3-1/2"	478 / 0	203 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
1		Conc. Pt. (lbs)	L	05-03-00	05-03-00	449	177			n/a
2		Unf. Lin. (lb/ft)	L	00-00-00	05-03-00	27	10			n/a
3		Unf. Lin. (lb/ft)	L	00-00-00	07-05-00	27	10			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,746 ft-lbs	12,704 ft-lbs	13.7%	1	05-03-00
End Shear	907 lbs	5,785 lbs	15.7%	1	06-04-00
Total Load Defl.	L/999 (0.04")	n/a	n/a	4	03-10-02
Live Load Defl.	L/999 (0.028")	n/a	n/a	5	03-10-02
Max Defl.	0.04"	n/a	n/a	4	03-10-02
Span / Depth	8.9	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.


Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0 Hanger	2" x 1-3/4"	639 lbs	n/a	15%	Hanger
B1 Wall/Plate	3-1/2" x 1-3/4"	971 lbs	25.8%	13%	Spruce Pine Fir

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\03

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:38:20

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\03
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:



B0 08-11-00 B1

Total Horizontal Product Length = 08-11-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	446 / 0	189 / 0		
B1	446 / 0	189 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Unf. Area (lb/ft ²)	L	00-00-00	08-11-00	40	15			02-06-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,923 ft-lbs	12,704 ft-lbs	15.1%	1	04-05-08
End Shear	710 lbs	5,785 lbs	12.3%	1	00-11-08
Total Load Defl.	L/999 (0.074")	n/a	n/a	4	04-05-08
Live Load Defl.	L/999 (0.052")	n/a	n/a	5	04-05-08
Max Defl.	0.074"	n/a	n/a	4	04-05-08
Span / Depth	11	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0 Hanger	2" x 1-3/4"	905 lbs	n/a	21.2%	Hanger
B1 Hanger	2" x 1-3/4"	905 lbs	n/a	21.2%	Hanger

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS @ O.C., STAGGERED IN TWO ROWS





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\04

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:43:56

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\04
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

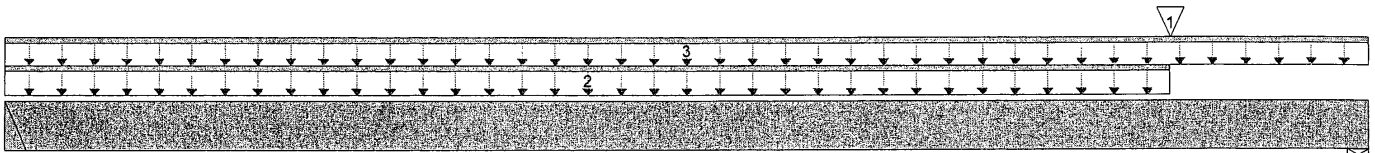

B0 05-02-00 B1

Total Horizontal Product Length = 05-02-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	184 / 0	83 / 0		
B1, 3-1/2"	521 / 0	227 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	04-05-00	04-05-00	446	189			n/a
2		Unf. Lin. (lb/ft)	L	00-00-00	04-05-00	27	10			n/a
3		Unf. Lin. (lb/ft)	L	00-00-00	05-02-00	27	10			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	601 ft-lbs	12,704 ft-lbs	4.7%	1	03-04-13
End Shear	620 lbs	5,785 lbs	10.7%	1	04-01-00
Total Load Defl.	L/999 (0.007")	n/a	n/a	4	02-08-00
Live Load Defl.	L/999 (0.005")	n/a	n/a	5	02-08-00
Max Defl.	0.007"	n/a	n/a	4	02-08-00
Span / Depth	6.1	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0 Hanger	2" x 1-3/4"	379 lbs	n/a	8.9%	Hanger
B1 Wall/Plate	3-1/2" x 1-3/4"	1,065 lbs	28.3%	14.3%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS @ O.C., STAGGERED IN TWO ROWS

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



T-1801004
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\05

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:37:53

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\05
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

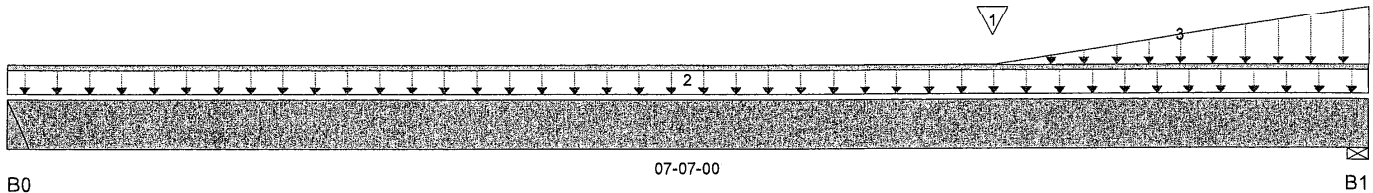

Total Horizontal Product Length = 07-07-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	116 / 0	61 / 0		
B1, 3-1/2"	178 / 0	85 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	05-06-00	05-06-00	47	18			n/a
2		Unf. Lin. (lb/ft)	L	00-00-00	07-07-00	27	10			n/a
3		Trapezoidal (lb/ft)	L	05-06-00	07-07-00	40	15			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	501 ft-lbs	12,704 ft-lbs	3.9%	1	04-02-11
End Shear	288 lbs	5,785 lbs	5%	1	06-06-00
Total Load Defl.	L/999 (0.014")	n/a	n/a	4	03-09-09
Live Load Defl.	L/999 (0.009")	n/a	n/a	5	03-10-07
Max Defl.	0.014"	n/a	n/a	4	03-09-09
Span / Depth	9.2	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 1-3/4"	249 lbs	n/a	5.8%	Hanger
B1 Wall/Plate	3-1/2" x 1-3/4"	373 lbs	9.9%	5%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.



User Notes

T-1801005
SITE COPY



Quadruple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\06

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 16:35:02

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\06
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

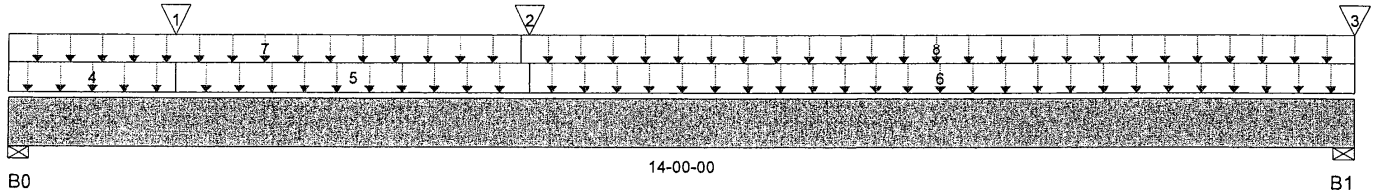

Total Horizontal Product Length = 14-00-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	3,358 / 0	1,516 / 0		
B1, 3-1/2"	3,415 / 0	1,668 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	01-09-00	01-09-00	184	83			n/a
2		Conc. Pt. (lbs)	L	05-05-00	05-05-00	313	136			n/a
3		Conc. Pt. (lbs)	L	14-00-00	14-00-00	116	61			n/a
4		Unf. Area (lb/ft^2)	L	00-00-00	01-09-00	40	15			02-06-00
5		Unf. Area (lb/ft^2)	L	01-09-00	05-05-00	40	15			03-00-00
6		Unf. Area (lb/ft^2)	L	05-05-00	14-00-00	40	15			03-11-00
7		Unf. Area (lb/ft^2)	L	00-00-00	05-04-00	40	15			07-06-00
8		Unf. Area (lb/ft^2)	L	05-04-00	14-00-00	40	20			07-06-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	23,383 ft-lbs	52,848 ft-lbs	44.2%	1	06-09-14
End Shear	6,053 lbs	23,142 lbs	26.2%	1	01-01-00
Total Load Defl.	L/300 (0.541")	0.677"	80%	4	06-11-05
Live Load Defl.	L/442 (0.367")	0.451"	81.4%	5	06-11-05
Max Defl.	0.541"	n/a	n/a	4	06-11-05
Span / Depth	17.1	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 7"	6,932 lbs	46%	23.2%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 7"	7,208 lbs	47.8%	24.1%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.



User Notes

Page 1 of 2
 NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
 @ 6" O.C., STAGGERED IN 2 ROWS, PLUS 1/2" Ø BOLTS, NUTS & WASHERS @ 40" O.C., STAGGERED IN 2 ROWS

T-1801006
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam07

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:38:03

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\07
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

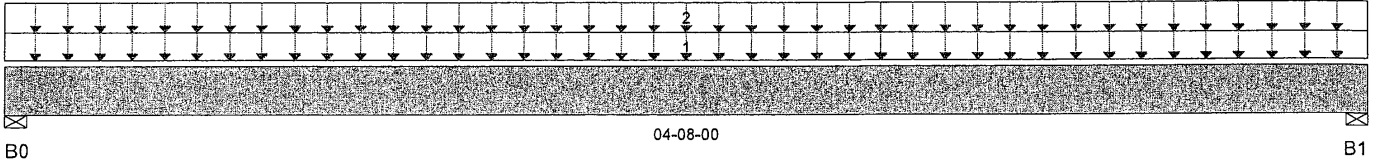

Total Horizontal Product Length = 04-08-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	980 / 0	379 / 0		
B1, 3-1/2"	980 / 0	379 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Unf. Area (lb/ft^2)	L	00-00-00	04-08-00	40	15			03-00-00
2		Unf. Area (lb/ft^2)	L	00-00-00	04-08-00	40	15			07-06-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,844 ft-lbs	12,704 ft-lbs	14.5%	1	02-04-00
End Shear	1,041 lbs	5,785 lbs	18%	1	01-01-00
Total Load Defl.	L/999 (0.016")	n/a	n/a	4	02-04-00
Live Load Defl.	L/999 (0.012")	n/a	n/a	5	02-04-00
Max Defl.	0.016"	n/a	n/a	4	02-04-00
Span / Depth	5.3	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 1-3/4"	1,943 lbs	51.6%	26%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 1-3/4"	1,943 lbs	51.6%	26%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
 @ O.C., STAGGERED IN TWO ROWS



FL801007
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam 08

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:38:24

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\08
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

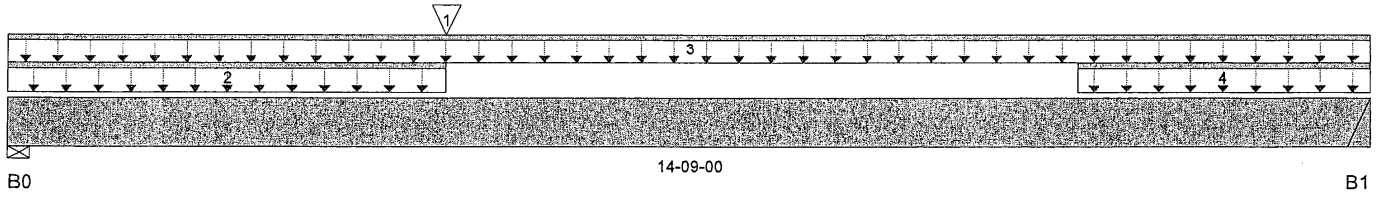

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	625 / 0	284 / 0		
B1	433 / 0	203 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	04-09-00	04-09-00	446	189			n/a
2		Unf. Lin. (lb/ft)	L	00-00-00	04-09-00	27	10			n/a
3		Unf. Lin. (lb/ft)	L	00-00-00	14-09-00	27	10			n/a
4		Unf. Lin. (lb/ft)	L	11-07-00	14-09-00	27	10			n/a

Controls Summary


	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	4,579 ft-lbs	12,704 ft-lbs	36%	1	04-09-00
End Shear	1,170 lbs	5,785 lbs	20.2%	1	01-01-00
Total Load Defl.	L/398 (0.435")	0.721"	60.3%	4	07-01-03
Live Load Defl.	L/582 (0.297")	0.481"	61.9%	5	07-01-03
Max Defl.	0.435"	1"	43.5%	4	07-01-03
Span / Depth	18.2	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 1-3/4"	1,292 lbs	34.3%	17.3%	Spruce Pine Fir
B1	Hanger 2" x 1-3/4"	904 lbs	n/a	21.2%	Hanger

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.



User Notes

T-1801004
SITE COPY



Quadruple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\09

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:41:47

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\09
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

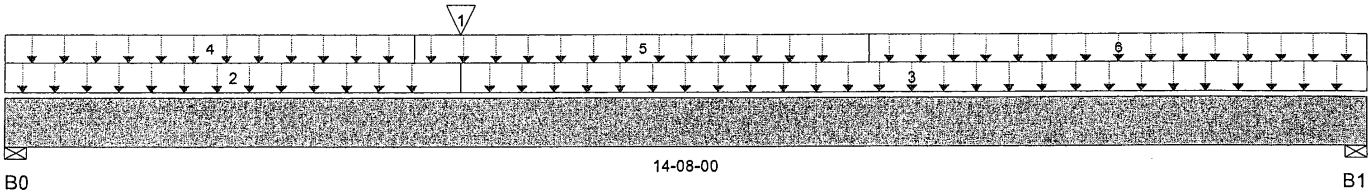

Total Horizontal Product Length = 14-08-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	3,517 / 0	1,566 / 0		
B1, 3-1/2"	2,594 / 0	1,196 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	04-11-00	04-11-00	433	203			n/a
2		Unf. Area (lb/ft^2)	L	00-00-00	04-11-00	40	15			07-06-00
3		Unf. Area (lb/ft^2)	L	04-11-00	14-08-00	40	15			01-09-00
4		Unf. Area (lb/ft^2)	L	00-00-00	04-05-00	40	15			06-00-00
5		Unf. Area (lb/ft^2)	L	04-05-00	09-04-00	40	20			06-00-00
6		Unf. Area (lb/ft^2)	L	09-04-00	14-08-00	40	15			06-00-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	21,475 ft-lbs	52,848 ft-lbs	40.6%	1	06-03-09
End Shear	6,054 lbs	23,142 lbs	26.2%	1	01-01-00
Total Load Defl.	L/311 (0.549")	0.71"	77.3%	4	07-01-08
Live Load Defl.	L/457 (0.373")	0.474"	78.8%	5	07-01-08
Max Defl.	0.549"	1"	54.9%	4	07-01-08
Span / Depth	17.9	n/a	n/a		00-00-00

Bearing Supports


	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 7"	7,232 lbs	48%	24.2%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 7"	5,387 lbs	35.7%	18%	Spruce Pine Fir

Notes

Desian meets Code minimum (L/240) Total load deflection criteria.
 Desian meets Code minimum (L/360) Live load deflection criteria.
 Desian meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Desian, as per NBCC and CSA 086.
 Desian based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

USER NOTES:

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
 @ 8" O.C., STAGGERED IN 2 ROWS, PLUS 1/2" Ø BOLTS, NUTS & WASHERS @ 40" O.C., STAGGERED IN 2 ROWS



T-18/10/17

SITE COPY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\10

BC CALC® Design Report




Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 10:41:59

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\10
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

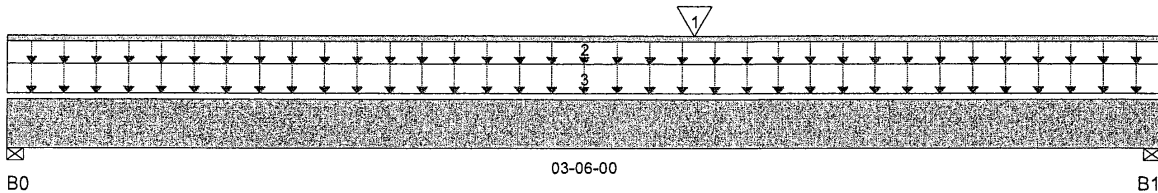

Total Horizontal Product Length = 03-06-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	1,106 / 0	624 / 0		
B1, 3-1/2"	1,674 / 0	886 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	02-01-00	02-01-00	2,594	1,196			n/a
2		Unf. Lin. (lb/ft)	L	00-00-00	03-06-00	0	60			n/a
3		Unf. Area (lb/ft^2)	L	00-00-00	03-06-00	40	15			01-04-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	4,110 ft-lbs	25,408 ft-lbs	16.2%	1	02-01-00
End Shear	3,410 lbs	11,571 lbs	29.5%	1	02-05-00
Total Load Defl.	L/999 (0.008")	n/a	n/a	4	01-10-00
Live Load Defl.	L/999 (0.005")	n/a	n/a	5	01-10-00
Max Defl.	0.008"	n/a	n/a	4	01-10-00
Span / Depth	3.8	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 3-1/2"	2,440 lbs	32.4%	16.3%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 3-1/2"	3,618 lbs	48%	24.2%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS @ 6" O.C.. STAGGERED IN TWO ROWS



T-1801010
SITE COPY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\11

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:42:13

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\11
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

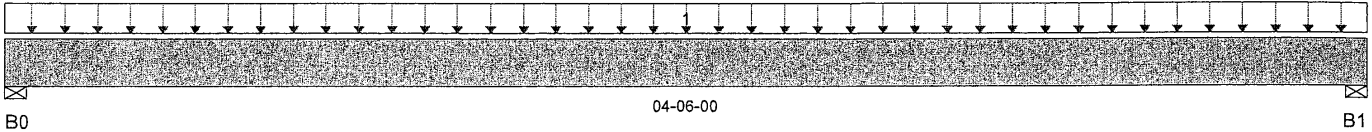

Total Horizontal Product Length = 04-06-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	1,350 / 0	528 / 0		
B1, 3-1/2"	1,350 / 0	528 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Unf. Area (lb/ft ²)	L	00-00-00	04-06-00	40	15			15-00-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,437 ft-lbs	25,408 ft-lbs	9.6%	1	02-03-00
End Shear	1,392 lbs	11,571 lbs	12%	1	01-01-00
Total Load Defl.	L/999 (0.01")	n/a	n/a	4	02-03-00
Live Load Defl.	L/999 (0.007")	n/a	n/a	5	02-03-00
Max Defl.	0.01"	n/a	n/a	4	02-03-00
Span / Depth	5.1	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0 Wall/Plate	3-1/2" x 3-1/2"	2,685 lbs	35.6%	18%	Spruce Pine Fir
B1 Wall/Plate	3-1/2" x 3-1/2"	2,685 lbs	35.6%	18%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS.
 @ 12" O.C., STAGGERED IN TWO ROWS (TOP WAREO)





Triple 1-3/4" x 14" VERSA-LAM® 2.0 3100 SP

Floor Beam11A

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:47:07

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\11A
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

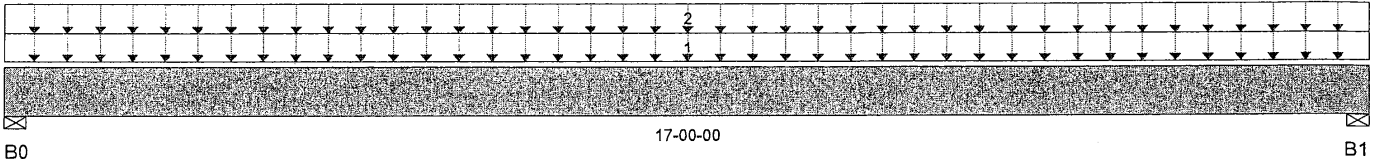

Total Horizontal Product Length = 17-00-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	5,100 / 0	2,412 / 0		
B1, 3-1/2"	5,100 / 0	2,412 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Unf. Area (lb/ft^2)	L	00-00-00	17-00-00	40	20			07-06-00
2		Unf. Area (lb/ft^2)	L	00-00-00	17-00-00	40	15			07-06-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	42,916 ft-lbs	82,449 ft-lbs	52.1%	1	08-06-00
End Shear	8,835 lbs	25,578 lbs	34.5%	1	01-05-08
Total Load Defl.	L/320 (0.62")	0.827"	75%	4	08-06-00
Live Load Defl.	L/472 (0.421")	0.551"	76.3%	5	08-06-00
Max Defl.	0.62"	1"	62%	4	08-06-00
Span / Depth	14.2	n/a	n/a		00-00-00

Bearing Supports


	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0	Wall/Plate 3-1/2" x 5-1/4"	10,665 lbs	94.3%	47.6%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 5-1/4"	10,665 lbs	94.3%	47.6%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
 @ 12" O.C.. STAGGERED IN TWO ROWS (TOP BOARD)





Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\12

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:42:26

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD , ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\12
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

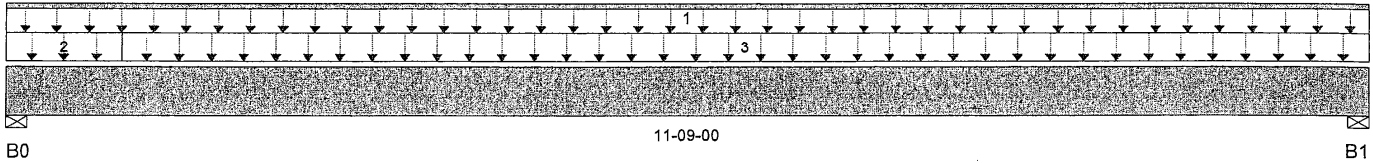

Total Horizontal Product Length = 11-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	1,528 / 0	1,014 / 0		
B1, 3-1/2"	1,528 / 0	983 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Unf. Lin. (lb/ft)	L	00-00-00	11-09-00	0	60			n/a
2		Unf. Area (lb/ft^2)	L	00-00-00	01-00-00	40	20			06-06-00
3		Unf. Area (lb/ft^2)	L	01-00-00	11-09-00	40	15			06-06-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	9,551 ft-lbs	25,408 ft-lbs	37.6%	1	05-10-08
End Shear	3,303 lbs	11,571 lbs	28.5%	1	01-01-00
Total Load Defl.	L/433 (0.313")	0.565"	55.4%	4	05-10-08
Live Load Defl.	L/713 (0.19")	0.376"	50.5%	5	05-10-08
Max Defl.	0.313"	1"	31.3%	4	05-10-08
Span / Depth	14.3	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0	Wall/Plate 3-1/2" x 3-1/2"	3,558 lbs	47.2%	23.8%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 3-1/2"	3,520 lbs	46.7%	23.6%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
 @ (2") O.C., STAGGERED IN TWO ROWS



T-1801013
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\13

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:42:40

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD , ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\13
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

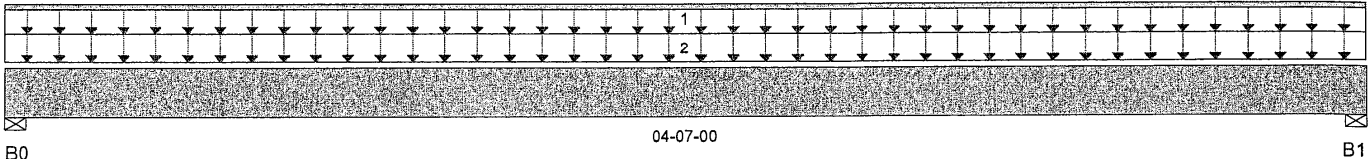

Total Horizontal Product Length = 04-07-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	878 / 0	478 / 0		
B1, 3-1/2"	878 / 0	478 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Unf. Lin. (lb/ft)	L	00-00-00	04-07-00	0	60			n/a
2		Unf. Area (lb/ft^2)	L	00-00-00	04-07-00	40	15			09-07-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,778 ft-lbs	12,704 ft-lbs	14%	1	02-03-08
End Shear	1,010 lbs	5,785 lbs	17.5%	1	01-01-00
Total Load Defl.	L/999 (0.015")	n/a	n/a	4	02-03-08
Live Load Defl.	L/999 (0.01")	n/a	n/a	5	02-03-08
Max Defl.	0.015"	n/a	n/a	4	02-03-08
Span / Depth	5.2	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 1-3/4"	1,915 lbs	50.8%	25.6%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 1-3/4"	1,915 lbs	50.8%	25.6%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.



T-1801014
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\14

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:43:21

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\14
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

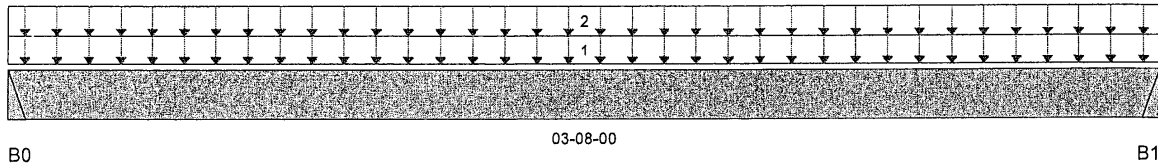

Total Horizontal Product Length = 03-08-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	458 / 0	208 / 0		
B1	458 / 0	208 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Unf. Area (lb/ft ²)	L	00-00-00	03-08-00	40	20			03-00-00
2		Unf. Area (lb/ft ²)	L	00-00-00	03-08-00	40	15			03-03-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	773 ft-lbs	12,704 ft-lbs	6.1%	1	01-10-00
End Shear	452 lbs	5,785 lbs	7.8%	1	00-11-08
Total Load Defl.	L/999 (0.005")	n/a	n/a	4	01-10-00
Live Load Defl.	L/999 (0.003")	n/a	n/a	5	01-10-00
Max Defl.	0.005"	n/a	n/a	4	01-10-00
Span / Depth	4.4	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Hanger 2" x 1-3/4"	948 lbs	n/a	22.2%	Hanger
B1	Hanger 2" x 1-3/4"	948 lbs	n/a	22.2%	Hanger

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



T-1801015
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\15

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:43:27

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\15
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

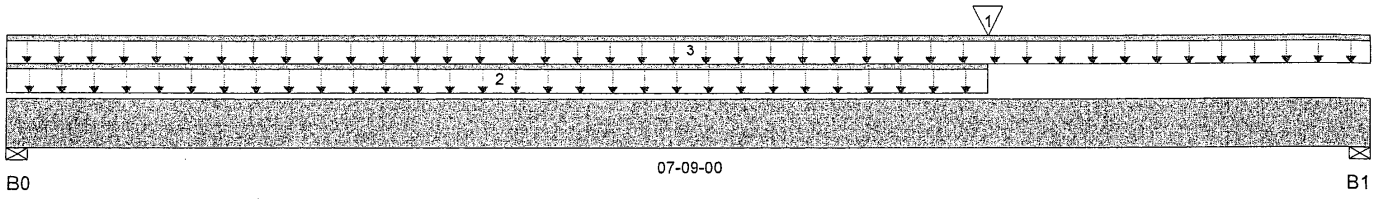

Total Horizontal Product Length = 07-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	324 / 0	179 / 0		
B1, 3-1/2"	494 / 0	253 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1	Conc. Pt. (lbs)	L	05-07-00	05-07-00	458	208			n/a
2	Unf. Lin. (lb/ft)	L	00-00-00	05-07-00	27	14			n/a
3	Unf. Lin. (lb/ft)	L	00-00-00	07-09-00	27	14			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,900 ft-lbs	12,704 ft-lbs	15%	1	05-07-00
End Shear	988 lbs	5,785 lbs	17.1%	1	06-08-00
Total Load Defl.	L/999 (0.047")	n/a	n/a	4	04-01-04
Live Load Defl.	L/999 (0.031")	n/a	n/a	5	04-01-04
Max Defl.	0.047"	n/a	n/a	4	04-01-04
Span / Depth	9.2	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 1-3/4"	710 lbs	18.8%	9.5%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 1-3/4"	1,057 lbs	28.1%	14.2%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.



T-182010.16
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\16

BC CALC® Design Report




Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 10:44:10

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\16
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

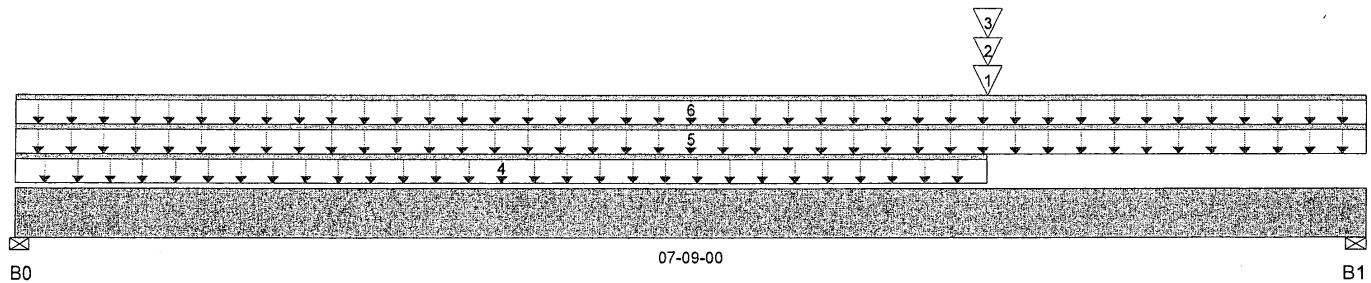

Total Horizontal Product Length = 07-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-5/8"	584 / 0	517 / 0		
B1, 3-1/2"	1,235 / 0	796 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	05-07-00	05-07-00	458	208			n/a
2		Conc. Pt. (lbs)	L	05-07-00	05-07-00	480	189			n/a
3		Conc. Pt. (lbs)	L	05-07-00	05-07-00	521	227			n/a
4		Unf. Lin. (lb/ft)	L	00-00-00	05-07-00	27	14			n/a
5		Unf. Lin. (lb/ft)	L	00-00-00	07-09-00	27	14			n/a
6		Unf. Lin. (lb/ft)	L	00-00-00	07-09-00	0	60			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	5,195 ft-lbs	12,704 ft-lbs	40.9%	1	05-07-00
End Shear	2,696 lbs	5,785 lbs	46.6%	1	06-08-00
Total Load Defl.	L/999 (0.124")	n/a	n/a	4	04-01-14
Live Load Defl.	L/999 (0.074")	n/a	n/a	5	04-01-14
Max Defl.	0.124"	n/a	n/a	4	04-01-14
Span / Depth	9.3	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 2-5/8" x 1-3/4"	1,523 lbs	53.9%	27.2%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 1-3/4"	2,847 lbs	75.6%	38.1%	Spruce Pine Fir

Notes



T-1801017
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam117


Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 10:45:31

BC CALC® Design Report

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD , ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\17
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

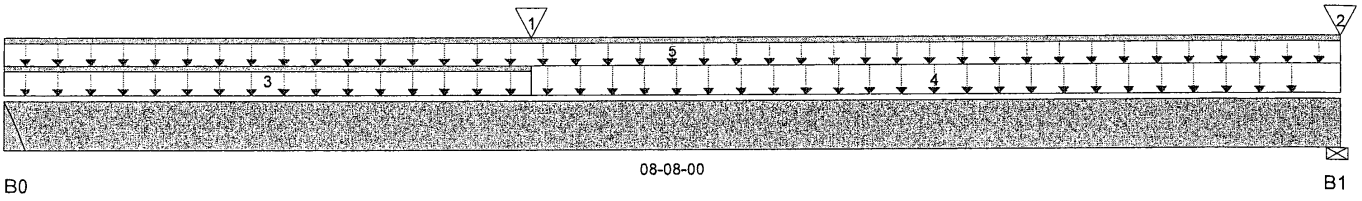

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	1,762 / 0	1,034 / 0		
B1, 3-5/8"	1,740 / 0	1,000 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	03-05-00	03-05-00	620	210			n/a
2		Conc. Pt. (lbs)	L	08-08-00	08-08-00	620	210			n/a
3		Unf. Lin. (lb/ft)	L	00-00-00	03-05-00	416	185			n/a
4		Unf. Area (lb/ft^2)	L	03-05-00	08-08-00	40	20			04-00-00
5		Unf. Lin. (lb/ft)	L	00-00-00	08-08-00	0	60			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	7,575 ft-lbs	12,704 ft-lbs	59.6%	1	03-05-00
End Shear	3,038 lbs	5,785 lbs	52.5%	1	00-11-08
Total Load Defl.	L/400 (0.25")	0.416"	60.1%	4	04-01-09
Live Load Defl.	L/642 (0.156")	0.277"	56.1%	5	04-00-13
Max Defl.	0.25"	1"	25%	4	04-01-09
Span / Depth	10.5	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0 Hanger	2" x 1-3/4"	3,935 lbs	n/a	92.1%	Hanger
B1 Wall/Plate	3-5/8" x 1-3/4"	3,860 lbs	98.9%	49.9%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



T-1801018

SITE COPY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\18

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 11:04:10

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\18
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

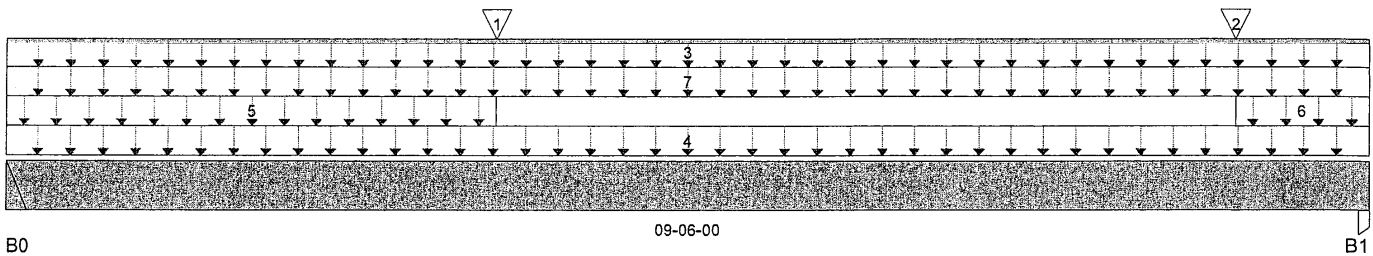

Total Horizontal Product Length = 09-06-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	1,818 / 0	1,361 / 0		
B1, 3-1/2"	2,029 / 0	1,446 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Conc. Pt. (lbs)	L	03-05-00	03-05-00	620	210			n/a
2		Conc. Pt. (lbs)	L	08-07-00	08-07-00	620	210			n/a
3		Unf. Lin. (lb/ft)	L	00-00-00	09-06-00	0	120			n/a
4		Unf. Area (lb/ft^2)	L	00-00-00	09-06-00	40	20			03-09-00
5		Unf. Area (lb/ft^2)	L	00-00-00	03-05-00	40	15			03-02-00
6		Unf. Area (lb/ft^2)	L	08-07-00	09-06-00	40	15			03-02-00
7		Unf. Area (lb/ft^2)	L	00-00-00	09-06-00	40	15			01-08-00

Controls Summary


	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	9,721 ft-lbs	25,408 ft-lbs	38.3%	1	03-10-10
End Shear	3,864 lbs	11,571 lbs	33.4%	1	08-05-00
Total Load Defl.	L/524 (0.21")	0.458"	45.8%	4	04-07-01
Live Load Defl.	L/999 (0.119")	n/a	n/a	5	04-07-01
Max Defl.	0.21"	1"	21%	4	04-07-01
Span / Depth	11.6	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	4,430 lbs	n/a	51.9%	Hanger
B1 Post	3-1/2" x 3-1/2"	4,851 lbs	22.8%	32.5%	Spruce Pine Fir

Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
 @ 12" O.C., STAGGERED IN 2 ROWS





Quadruple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\19

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 11:05:24

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\19
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

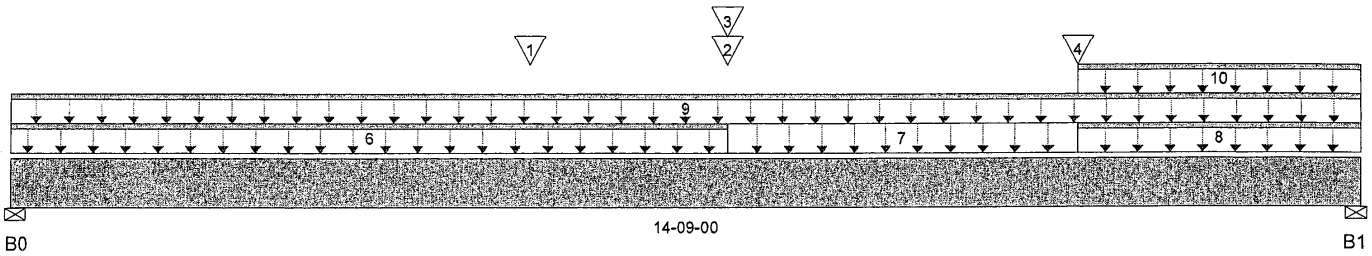

Total Horizontal Product Length = 14-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-5/8"	1,959 / 0	1,226 / 0		
B1, 2-5/8"	3,129 / 0	2,248 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
						1.00	0.65	1.00	1.15	
1		Conc. Pt. (lbs)	L	05-08-00	05-08-00	374	140			n/a
2		Conc. Pt. (lbs)	L	07-10-00	07-10-00	1,762	1,034			n/a
3		Conc. Pt. (lbs)	L	07-10-00	07-10-00	260	98			n/a
4		Conc. Pt. (lbs)	L	11-08-00	11-08-00	1,818	1,361			n/a
6		Unf. Lin. (lb/ft)	L	00-00-00	07-10-00	27	10			n/a
7		Unf. Area (lb/ft^2)	L	07-10-00	11-08-00	40	15			02-00-00
8		Unf. Lin. (lb/ft)	L	11-08-00	14-09-00	20	10			n/a
9		Unf. Lin. (lb/ft)	L	00-00-00	14-09-00	20	10			n/a
10		Unf. Lin. (lb/ft)	L	11-08-00	14-09-00	0	60			n/a

Controls Summary


	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	29,066 ft-lbs	52,848 ft-lbs	55%	1	07-10-00
End Shear	7,318 lbs	23,142 lbs	31.6%	1	13-08-14
Total Load Defl.	L/246 (0.705")	0.722"	97.7%	4	07-08-06
Live Load Defl.	L/400 (0.433")	0.481"	89.9%	5	07-08-06
Max Defl.	0.705"	1"	70.5%	4	07-08-06
Span / Depth	18.2	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 2-5/8" x 7"	4,471 lbs	39.6%	19.9%	Spruce Pine Fir
B1	Wall/Plate 2-5/8" x 7"	7,504 lbs	66.4%	33.5%	Spruce Pine Fir

Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS @ 12" O.C., STAGGERED IN 2 ROWS, PLUS 1/2" φ BOLTS, NUTS & WASHERS @ 40" O.C., STAGGERED IN 2 ROWS





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\20

Dry | 1 span | No cantilevers | 0/12 slope (deg)


January 29, 2016 10:46:21

BC CALC® Design Report



Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\20
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:



B0

09-04-00

B1

Total Horizontal Product Length = 09-04-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	1,381 / 0	713 / 0		
B1, 3-1/2"	1,419 / 0	732 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1	Unf. Area (lb/ft ²)	L	00-00-00	09-04-00	40	20			07-06-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	6,516 ft-lbs	12,704 ft-lbs	51.3%	1	04-07-04
End Shear	2,346 lbs	5,785 lbs	40.6%	1	00-11-08
Total Load Defl.	L/402 (0.268")	0.45"	59.7%	4	04-07-04
Live Load Defl.	L/610 (0.177")	0.3"	59%	5	04-07-04
Max Defl.	0.268"	1"	26.8%	4	04-07-04
Span / Depth	11.4	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0 Hanger	2" x 1-3/4"	2,963 lbs	n/a	69.4%	Hanger
B1 Wall/Plate	3-1/2" x 1-3/4"	3,043 lbs	80.8%	40.7%	Spruce Pine Fir

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.





Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\21

BC CALC® Design Report




Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 10:46:34

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\21
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

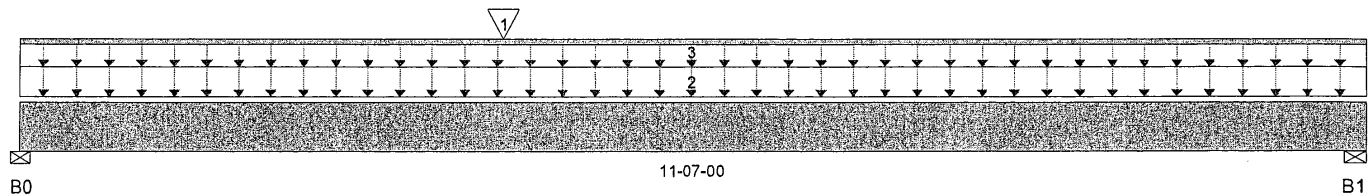

Total Horizontal Product Length = 11-07-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2"	1,112 / 0	969 / 0		
B1, 3-1/2"	733 / 0	782 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
1		Conc. Pt. (lbs)	L	04-02-00	04-02-00	1,381	713			n/a
2		Unf. Area (lb/ft^2)	L	00-00-00	11-07-00	40	20			01-00-00
3		Unf. Lin. (lb/ft)	L	00-00-00	11-07-00	0	60			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	10,200 ft-lbs	25,408 ft-lbs	40.1%	1	04-02-00
End Shear	2,714 lbs	11,571 lbs	23.5%	1	00-11-08
Total Load Defl.	L/471 (0.286")	0.563"	50.9%	4	05-05-07
Live Load Defl.	L/864 (0.156")	0.375"	41.7%	5	05-04-04
Max Defl.	0.286"	1"	28.6%	4	05-05-07
Span / Depth	14.2	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material	
B0	Wall/Plate	2" x 3-1/2"	2,879 lbs	66.8%	33.7%	Spruce Pine Fir
B1	Wall/Plate	3-1/2" x 3-1/2"	2,077 lbs	27.6%	13.9%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
 @ (2") O.C.. STAGGERED IN TWO ROWS





Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\22

BC CALC® Design Report




Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 10:46:44

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\22
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

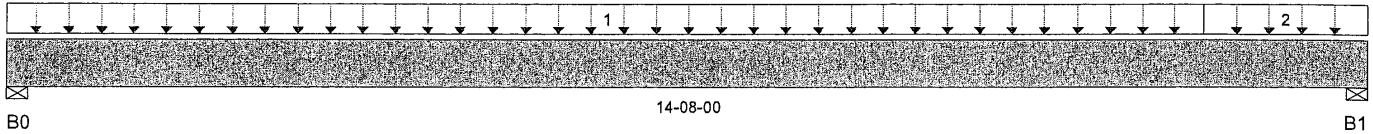

Total Horizontal Product Length = 14-08-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	2,145 / 0	913 / 0		
B1, 3-1/2"	2,034 / 0	915 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
1		Unf. Area (lb/ft ²)	L	00-00-00	12-11-00	40	15			07-04-00
2		Unf. Area (lb/ft ²)	L	12-11-00	14-08-00	40	20			05-07-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	14,968 ft-lbs	39,636 ft-lbs	37.8%	1	07-04-07
End Shear	3,714 lbs	17,356 lbs	21.4%	1	01-01-00
Total Load Defl.	L/335 (0.508")	0.71"	71.6%	4	07-04-07
Live Load Defl.	L/479 (0.356")	0.474"	75.2%	5	07-04-07
Max Defl.	0.508"	1"	50.8%	4	07-04-07
Span / Depth	17.9	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 5-1/4"	4,359 lbs	38.6%	19.4%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 5-1/4"	4,196 lbs	37.1%	18.7%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS @ 9" O.C., STAGGERED IN TWO ROWS





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\23


BC CALC® Design Report

Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 10:46:50

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\23
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

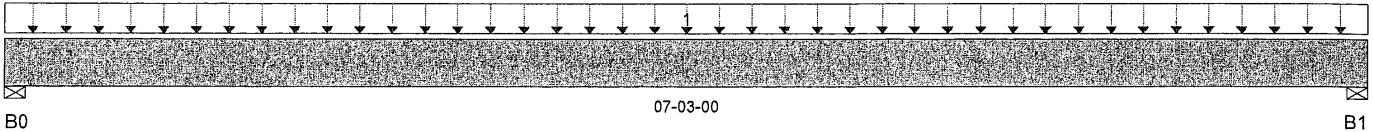

Total Horizontal Product Length = 07-03-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	810 / 0	422 / 0		
B1, 3-1/2"	810 / 0	422 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1	Unf. Area (lb/ft ²)	L	00-00-00	07-03-00	40	20			05-07-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,771 ft-lbs	12,704 ft-lbs	21.8%	1	03-07-08
End Shear	1,222 lbs	5,785 lbs	21.1%	1	01-01-00
Total Load Defl.	L/999 (0.065")	n/a	n/a	4	03-07-08
Live Load Defl.	L/999 (0.043")	n/a	n/a	5	03-07-08
Max Defl.	0.065"	n/a	n/a	4	03-07-08
Span / Depth	8.6	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports


	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/2" x 1-3/4"	1,742 lbs	46.2%	23.3%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 1-3/4"	1,742 lbs	46.2%	23.3%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS @ O.C., STAGGERED IN TWO ROWS



SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\24


BC CALC® Design Report

Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 29, 2016 10:46:59

Build 4516
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\24
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

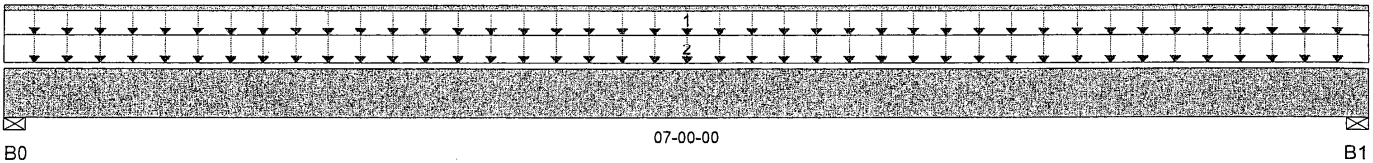

Total Horizontal Product Length = 07-00-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	374 / 0	171 / 0		
B1, 3-1/2"	374 / 0	171 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
1		Unf. Lin. (lb/ft)	L	00-00-00	07-00-00	27	14			n/a
2		Unf. Area (lb/ft^2)	L	00-00-00	07-00-00	40	15			02-00-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,185 ft-lbs	12,704 ft-lbs	9.3%	1	03-06-00
End Shear	535 lbs	5,785 lbs	9.3%	1	01-01-00
Total Load Defl.	L/999 (0.026")	n/a	n/a	4	03-06-00
Live Load Defl.	L/999 (0.018")	n/a	n/a	5	03-06-00
Max Defl.	0.026"	n/a	n/a	4	03-06-00
Span / Depth	8.3	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0	Wall/Plate 3-1/2" x 1-3/4"	775 lbs	20.6%	10.4%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 1-3/4"	775 lbs	20.6%	10.4%	Spruce Pine Fir

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Design meets User specified (1") Maximum total load deflection criteria.
 Calculations assume Member is Fully Braced.
 Resistance Factor phi has been applied to all presented results per CSA 086.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC and CSA 086.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4
 Deflections less than 1/8" were ignored in the results.



T-1801031
SITE COPY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

Floor Beam\25

BC CALC® Design Report




Dry | 1 span | No cantilevers | 0/12 slope (deg)

January 24, 2018 15:15:07

Build 6080
 Job Name: 38514
 Address: GREEN VALLEY ESTATES
 City, Province, Postal Code: BRADFORD, ON
 Customer:
 Code reports: CCMC 12472-R

File Name: 263959.bcc
 Description: Designs\25
 Specifier: S50-2
 Designer: MQ
 Company: ALPA ROOF TRUSSES
 Misc:

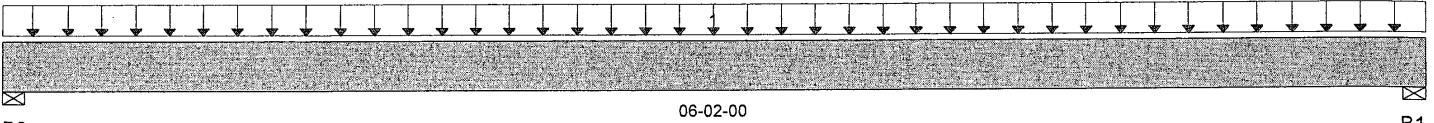

Total Horizontal Product Length = 06-02-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	432 / 0	231 / 0		
B1, 3-1/2"	432 / 0	231 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
1	Unf. Area (lb/ft^2)		L	00-00-00	06-02-00	40	20			03-06-00

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,236 ft-lbs	11,610 ft-lbs	10.6%	1	03-01-00
End Shear	607 lbs	5,785 lbs	10.5%	1	01-01-00
Total Load Defl.	L/999 (0.021")	n/a	n/a	4	03-01-00
Live Load Defl.	L/999 (0.013")	n/a	n/a	5	03-01-00
Max Defl.	0.021"	n/a	n/a	4	03-01-00
Span / Depth	7.2	n/a	n/a		00-00-00
Squash Blocks	Valid				

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B0	Wall/Plate 3-1/2" x 1-3/4"	936 lbs	24.8%	12.5%	Spruce Pine Fir
B1	Wall/Plate 3-1/2" x 1-3/4"	936 lbs	24.8%	12.5%	Spruce Pine Fir


BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume member is fully braced.
 Resistance Factor phi has been applied to all presented results per CSA O86.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 4

User Notes

NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS @ O.C., STAGGERED IN TWO ROWS



SITE COPY

NORDIC STRUCTURES

COMPANY
ALPA RT
MQ
Jan. 29, 2016 10:19

PROJECT
38514
SJ 7-8-0.wwb

S50-2 elev. A, B.

J7 @ 1st FL.


Design Check Calculation Sheet

Nordic Sizer - Canada 6.3

Loads:

Load	Type	Distribution	Pat-tern	Location (ft)		Magnitude		Unit
				Start	End	Start	End	
Load2	Live	Full Area				40.00		psf
Load3	Dead	Full Area				20.00		psf
Load4	Live	Point		5.42		374		lbs
Load5	Dead	Point		5.42		140		lbs
Self-weight	Dead	Full UDL				2.7		plf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

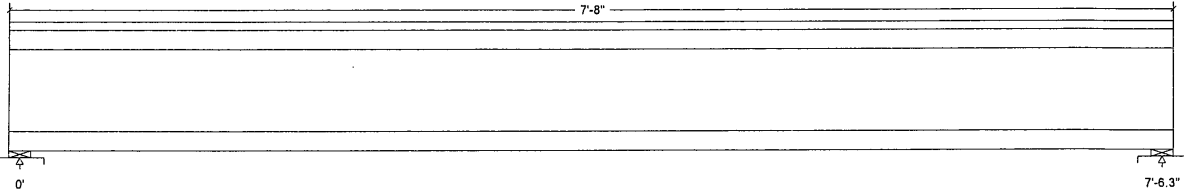

Unfactored:			
Dead	126		185
Live	259		416
Factored:			
Total	545		855
Bearing:			
Resistance			
Joist	1855		1855
Support	2724		2724
Anal/Des			
Joist	0.29		0.46
Support	0.20		0.31
Load case	#2		#2
Length	1-3/4		1-3/4
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.00		1.00

Nordic 9-1/2" NI-40x Floor joist @ 12" o.c.

Supports: All - Lumber Sill plate, No.1/No.2
Total length: 7'-8.0"; 5/8" nailed and glued OSB sheathing
This section PASSES the design code check.

Limit States Design using CSA-O86-09 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 855	Vr = 1895	lbs	Vf/Vr = 0.45
Moment (+)	Mf = 1654	Mr = 4824	lbs-ft	Mf/Mr = 0.34
Perm. Defl'n	0.01 = <L/999	0.25 = L/360	in	0.05
Live Defl'n	0.03 = <L/999	0.19 = L/480	in	0.15
Total Defl'n	0.04 = <L/999	0.38 = L/240	in	0.11
Bare Defl'n	0.03 = <L/999	0.25 = L/360	in	0.13
Vibration	Lmax = 7'-6	Lv = 16'-3	ft	
Defl'n	= 0.009	= 0.079	in	0.12

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
Moment (+) : LC #2 = 1.25D + 1.5L
Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)
Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L
Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
 L=live (use, occupancy) Ls=live (storage, equipment) F=fire


All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:




Deflection: EIComp = 258e06 lb-in² K* = 4.94e06 lbs
"Live" deflection = Deflection from all non-dead loads (live, wind, snow..)

Design Notes:

- Wood/Works analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-09 Engineering Design in Wood standard, which includes Update No.4
- NAIL ONE PLY TO ANOTHER WITH 3 1/2" SPIRAL NAILS
- Please verify that the default deflection limits are appropriate for your application.
- Refer to technical documentation for installation guidelines and construction details.
- Nordic I-joists are listed in CCMC evaluation report 13032-R.
- Joists shall be laterally supported at supports and continuously along the compression edge.
- The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the consequences thereof, on the information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural analysis of the component based on the design criteria and loadings shown.



T-1801077
SITE COPY




Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/360 Deflection Limit.
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
14"	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
16"	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	N/A	17'-1"	15'-5"	14'-6"	N/A
	NI-40x	17'-11"	16'-11"	16'-4"	N/A	18'-5"	17'-4"	16'-7"	N/A
	NI-60	18'-2"	17'-1"	16'-6"	N/A	18'-7"	17'-6"	16'-10"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-5"	N/A	20'-2"	18'-8"	17'-6"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-3"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
14"	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-7"	N/A
	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
16"	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/360 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Product	MSR	Splices per unit
NI-20	1950f MSR	33 pieces per unit
NI-40x	2100f MSR	33 pieces per unit
NI-60	1950f MSR	23 pieces per unit
NI-70	2100f MSR	23 pieces per unit
NI-80	2400f MSR	23 pieces per unit
NI-90	2400f MSR	23 pieces per unit
NI-90x	NPG Lumber	23 pieces per unit

Refer to the Installation Guide for Residential Floors for additional information.
CMC EVALUATION REPORT 13032-R

WEB HOLE SPECIFICATIONS

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- Joist top and bottom flanges must NEVER be cut, notched, or otherwise modified. Whenever possible, field-cut holes should be centred on the middle of the web.
- The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.

- The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the largest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
- A knockout is **not** considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
- Holes measuring 1-1/2 inches or smaller are permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.

- A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
- All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
- Limit three maximum size holes per span, of which one may be a duct chase opening.
- A group of round holes at approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS

Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Joist Depth	Joist Series	Minimum Distance from Inside Face of Any Support to Centre of Hole (ft - in.)														
		Round Hole Diameter (in.)														
		2	3	4	5	6	6-1/4	7	8	8-5/8	9	10	10-3/4	11	12	12-3/4
9-1/2"	NI-20	0-7"	1-6"	2-10"	4-3"	5-8"	6-0"	---	---	---	---	---	---	---	---	---
	NI-40x	0-7"	1-6"	3-0"	4-4"	6-0"	6-4"	---	---	---	---	---	---	---	---	---
	NI-60	1-3"	2-6"	4-0"	5-4"	7-0"	7-5"	---	---	---	---	---	---	---	---	---
	NI-70	2-0"	3-4"	4-9"	6-3"	8-0"	8-4"	---	---	---	---	---	---	---	---	---
	NI-80	2-3"	3-6"	5-0"	6-6"	8-2"	8-8"	---	---	---	---	---	---	---	---	---
11-7/8"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---	---	---	---
	NI-40x	0-7"	0-8"	1-3"	2-8"	4-0"	4-4"	5-5"	7-0"	8-4"	---	---	---	---	---	---
	NI-60	0-7"	1-8"	3-0"	4-3"	5-9"	6-0"	7-3"	8-10"	10-0"	---	---	---	---	---	---
	NI-70	1-3"	2-6"	4-0"	5-4"	6-9"	7-2"	8-4"	10-0"	11-2"	---	---	---	---	---	---
	NI-80	1-6"	2-10"	4-2"	5-6"	7-0"	7-5"	8-6"	10-3"	11-4"	---	---	---	---	---	---
14"	NI-20	0-7"	0-8"	1-5"	3-2"	4-10"	5-4"	6-9"	8-9"	10-2"	---	---	---	---	---	---
	NI-40x	0-7"	0-8"	0-9"	2-5"	4-4"	4-9"	6-3"	---	---	---	---	---	---	---	---
	NI-60	0-7"	0-8"	0-8"	1-0"	2-4"	2-9"	3-9"	5-2"	6-0"	6-6"	8-3"	10-2"	---	---	---
	NI-70	0-7"	0-8"	1-8"	3-0"	4-3"	4-8"	5-8"	7-2"	8-0"	8-8"	10-4"	11-9"	---	---	---
	NI-80	0-8"	1-10"	3-0"	4-5"	5-10"	6-2"	7-3"	8-9"	9-9"	10-4"	12-0"	13-5"	---	---	---
16"	NI-20	0-7"	0-8"	0-8"	1-6"	2-10"	3-2"	4-2"	5-6"	6-4"	7-0"	8-5"	9-8"	10-2"	12-2"	13-9"
	NI-40x	0-7"	0-8"	0-8"	1-6"	2-10"	3-2"	4-2"	5-6"	6-4"	7-0"	8-5"	9-8"	10-2"	12-2"	13-9"
	NI-60	0-7"	1-0"	2-3"	3-6"	4-10"	5-3"	6-3"	7-8"	8-6"	9-2"	10-8"	12-0"	12-4"	14-0"	15-6"
	NI-70	0-7"	1-3"	2-6"	3-10"	5-3"	5-6"	6-6"	8-0"	9-0"	9-5"	11-0"	12-3"	12-7"	14-5"	16-0"
	NI-80	0-7"	0-8"	0-8"	1-9"	3-3"	3-8"	4-9"	6-5"	7-5"	8-0"	9-10"	11-3"	11-9"	13-9"	15-4"

- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Hole location distance is measured from inside face of supports to centre of hole.
- Distances in this chart are based on uniformly loaded joists.
- The above table is based on the I-joists being used at their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.



TABLE 2
DUCT CHASE OPENING SIZES AND LOCATIONS

Simple Span Only

Joist Depth	Joist Series	Minimum distance from inside face of supports to centre of opening (ft - in.)									
		Duct Chase Length (in.)									
		8	10	12	14	16	18	20	22	24	
9-1/2"	NI-20	4-1"	4-5"	4-10"	5-4"	5-8"	6-1"	6-6"	7-1"	7-5"	
	NI-40x	5-3"	5-8"	6-0"	6-5"	6-10"	7-3"	7-8"	8-2"	8-6"	
	NI-60	5-4"	5-9"	6-2"	6-7"	7-1"	7-5"	8-0"	8-3"	8-9"	
	NI-70	5-1"	5-5"	5-10"	6-3"	6-7"	7-1"	7-6"	8-1"	8-4"	
	NI-80	5-3"	5-8"	6-0"	6-5"	6-10"	7-3"	7-8"	8-2"	8-6"	
11-7/8"	NI-20	5-9"	6-2"	6-6"	7-1"	7-5"	7-9"	8-3"	8-9"	9-4"	
	NI-40x	6-8"	7-2"	7-6"	8-1"	8-6"	9-1"	9-6"	10-1"	10-9"	
	NI-60	7-3"	7-8"	8-0"	8-6"	9-0"	9-3"	9-9"	10-3"	11-0"	
	NI-70	7-1"	7-4"	7-9"	8-3"	8-7"	9-1"	9-6"	10-1"	10-4"	
	NI-80	7-2"	7-7"	8-0"	8-5"	8-9"	9-3"	9-8"	10-2"	10-8"	
14"	NI-20	7-6"	7-11"	8-4"	8-9"	9-2"	9-7"	10-1"	10-7"	10-11"	
	NI-40x	8-1"	8-7"	9-0"	9-6"	10-1"	10-7"	11-2"	12-0"	12-8"	
	NI-60	8-9"	9-3"	9-8"	10-1"	10-6"	11-1"	11-6"	12-3"	13-0"	
	NI-70	8-7"	9-1"	9-5"	9-10"	10-4"	10-8"	11-2"	11-7"	12-3"	
	NI-80	9-0"	9-3"	9-9"	10-1"	10-7"	11-1"	11-6"	12-1"	12-6"	
16"	NI-20	9-2"	9-8"	10-0"	10-6"	10-11"	11-5"	11-9"	12-4"	12-11"	
	NI-40x	9-4"	9-9"	10-3"	10-7"	11-1"	11-7"	12-1"	12-7"	13-2"	
	NI-60	10-3"	10-8"	11-2"	11-6"	12-1"	12-6"	13-2"	14-1"	14-10"	
	NI-70	10-1"	10-5"	11-0"	11-4"	11-10"	12-3"	12-8"	13-3"	14-0"	
	NI-80	10-4"	10-9"	11-3"	11-9"	12-1"	12-7"	13-1"	13-8"	14-4"	

- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Duct chase opening location distance is measured from inside face of supports to centre of opening.
- The above table is based on simple-span joists only. For other applications, contact your local distributor.
- Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480.
- The above table is based on the I-joists being used at their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

FIGURE 7
FIELD-CUT HOLE LOCATOR

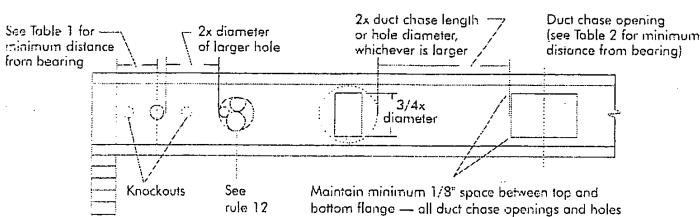

Knockouts are prescored holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on centre along the length of the I-joist. Where possible, it is preferable to use knockouts instead of field-cut holes.

Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.



Never stack building materials over unsheathed I-joists. Once sheathed, do not over-stress I-joists with concentrated loads from building materials.

WARNING: I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

AVOID ACCIDENTS BY FOLLOWING THESE IMPORTANT GUIDELINES:

- Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
- When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lay ends of adjoining bracing over at least two I-joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
- For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
- Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
- Never install a damaged I-joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.




PRODUCT WARRANTY

Chantiers Chibougamau guarantees that, in accordance with our specifications, Nordic products are free from manufacturing defects in material and workmanship.


Furthermore, Chantiers Chibougamau warrants that our products, when utilized in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the structure.

SITE COPY



Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
NI Joists	3,300

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.




Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
1-1/8" Rim Board Plus	8,090



*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

To avoid splitting flange, start nails at least 1-1/2" from end of I-joist. Nails may be driven at an angle to avoid splitting of bearing plate.

Minimum bearing length shall be 1-3/4" for the end bearings, and 3-1/2" for the intermediate bearings when applicable.



Pair of Squash Blocks	Maximum Factored Vertical Load per Pair of Squash Blocks (lbs)	
	3-1/2" wide	5-1/2" wide
2x Lumber	5,500	8,500
1-1/8" Rim Board Plus	4,300	6,600

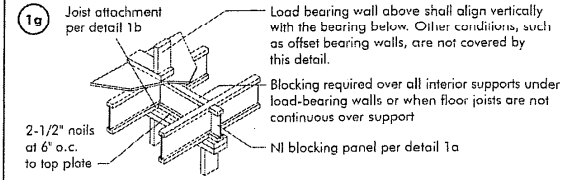


1h Backer block (use if hanger load exceeds 360 lbs). Before installing a backer block to a double I-joist, drive three additional 3" nails through the webs and filler block where the backer block will fit. Clinch. Install backer tight to top flange. Use twelve 3" nails, clinched when possible. Maximum factored resistance for hanger for this detail = 1,620 lbs.

BACKER BLOCKS (Blocks must be long enough to permit required nailing without splitting)







Flange Width	Material Thickness Required*	Minimum Depth**
2-1/2"	1"	5-1/2"
3-1/2"	1-1/2"	7-1/4"

* Minimum grade for backer block material shall be S-P-F No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-O325 or CAN/CSA-O437 Standard.
 ** For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

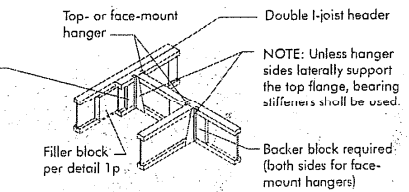


NOTE: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

For hanger capacity see hanger manufacturer's recommendations. Verify double I-joist capacity to support concentrated loads.

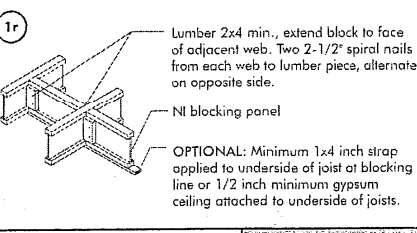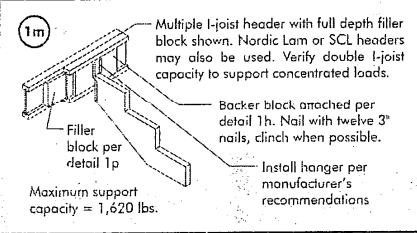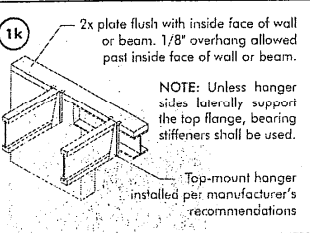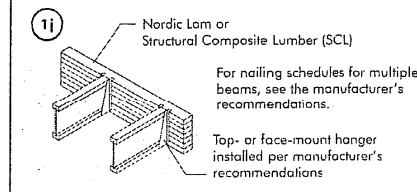

- 1p FILLER BLOCK REQUIREMENTS FOR DOUBLE I-JOIST CONSTRUCTION**
- NOTES:
- Support back of I-joist web during nailing to prevent damage to web/flange connection.
 - Leave a 1/8 to 1/4-inch gap between top of filler block and bottom of top I-joist flange.
 - Filler block is required between joists for full length of span.
 - Nail joists together with two rows of 3" nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
 - The maximum factored load that may be applied to one side of the double joist using this detail is 860 lbf/ft. Verify double I-joist capacity.

Flange Size	Net Depth	Filler Block Size
2-1/2" x 1-1/2"	9-1/2"	2-1/8" x 6"
	11-7/8"	2-1/8" x 8"
	14"	2-1/8" x 10"
3-1/2" x 1-1/2"	9-1/2"	3" x 6"
	11-7/8"	3" x 8"
	14"	3" x 10"
3-1/2" x 2"	11-7/8"	3" x 7"
	14"	3" x 9"
	16"	3" x 11"

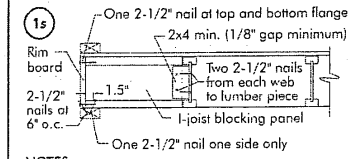

NOTES:

- In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.


All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

WEB STIFFENERS

RECOMMENDATIONS:

- A **bearing stiffener** is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found of the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.
- A **bearing stiffener** is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A **load stiffener** is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.


FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

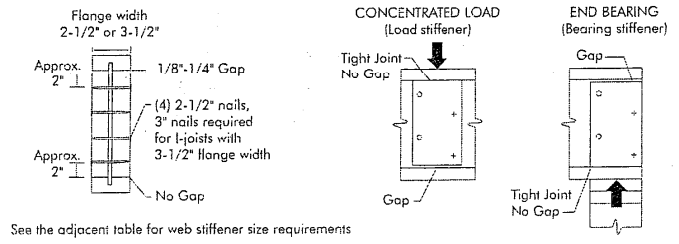

See the adjacent table for web stiffener size requirements



Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET

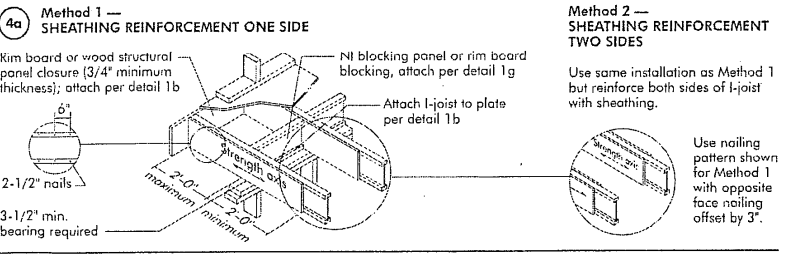

NOTE: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

RIM BOARD INSTALLATION DETAILS

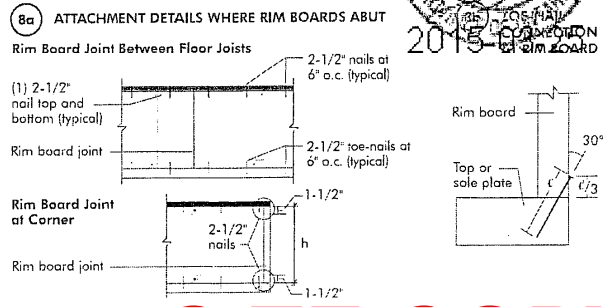

SITE COPY

CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

3a I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

CAUTION: Cantilevers formed this way must be carefully detailed to prevent moisture intrusion into the structure and potential decay of untreated I-joist extensions.

Note: This detail is applicable to cantilevers supporting a maximum specified uniform live load of 60 psf.

3b LUMBER CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

Note: This detail is applicable to cantilevers supporting a maximum specified uniform live load of 60 psf.

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

4a Method 1 — SHEATHING REINFORCEMENT ONE SIDE

Method 2 — SHEATHING REINFORCEMENT TWO SIDES

- Use same installation as Method 1 but reinforce both sides of I-joist with sheathing.
- Use nailing pattern shown for Method 1 with opposite face nailing offset by 3\".

Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4\" required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2\" nails at 6\" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

4b Alternate Method 2 — DOUBLE I-JOIST

Block I-joists together with filler blocks for the full length of the reinforcement. For I-joist flange widths greater than 3 inches place an additional row of 3\" nails along the centreline of the reinforcing panel from each side. Clinch when possible.

FIGURE 4 (continued)

For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in)	ROOF TRUSS SPAN (ft)	ROOF LOADING (UNFACTORED)											
		LL = 30 psf, DL = 15 psf			LL = 40 psf, DL = 15 psf			LL = 50 psf, DL = 15 psf					
		JOIST SPACING (in)			JOIST SPACING (in)			JOIST SPACING (in)					
		12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
11/2	26	N	N	X	X	N	N	X	X	N	N	X	X
30	N	N	X	X	X	N	N	X	X	N	N	X	X
32	N	N	X	X	X	N	N	X	X	N	N	X	X
34	N	N	X	X	X	N	N	X	X	N	N	X	X
36	N	N	X	X	X	N	N	X	X	N	N	X	X
40	N	N	X	X	X	N	N	X	X	N	N	X	X
42	N	N	X	X	X	N	N	X	X	N	N	X	X
11/8	26	N	N	X	X	N	N	X	X	N	N	X	X
30	N	N	X	X	X	N	N	X	X	N	N	X	X
32	N	N	X	X	X	N	N	X	X	N	N	X	X
34	N	N	X	X	X	N	N	X	X	N	N	X	X
36	N	N	X	X	X	N	N	X	X	N	N	X	X
40	N	N	X	X	X	N	N	X	X	N	N	X	X
42	N	N	X	X	X	N	N	X	X	N	N	X	X
6	26	N	N	N	N	N	N	N	N	N	N	N	N
28	N	N	N	N	N	N	N	N	N	N	N	N	N
30	N	N	N	N	N	N	N	N	N	N	N	N	N
32	N	N	N	N	N	N	N	N	N	N	N	N	N
34	N	N	N	N	N	N	N	N	N	N	N	N	N
36	N	N	N	N	N	N	N	N	N	N	N	N	N
40	N	N	N	N	N	N	N	N	N	N	N	N	N
42	N	N	N	N	N	N	N	N	N	N	N	N	N

- N = No reinforcement required.
- Ni reinforced with 3/4\" wood structural panel on one side only.
- Ni reinforced with 3/4\" wood structural panel on both sides, or double I-joist. X = Try a deeper joist or closer spacing.
- Maximum design load shall be: 15 psf roof dead load, 55 psf floor total load, and 80 psf wall load. Wall load is based on 3-0\" maximum width window or door openings.
- For larger openings, or multiple 3-0\" width openings spaced less than 6-0\" o.c., additional joists beneath the opening's cripple studs may be required.
- Table applies to joists 12\" to 24\" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use 12\" o.c. requirements for lesser spacing.
- For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam. When the roof is framed using a ridge board, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
- Cantilevered joists supporting girder trusses or roof beams may require additional reinforcing.

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

5a SHEATHING REINFORCEMENT

Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4\" required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2\" nails at 6\" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

5b SET-BACK DETAIL

Notes:

- Provide full depth blocking between joists over support (not shown for clarity).
- Attach I-joist to plate at all supports per detail 1b.
- 3-1/2\" minimum I-joist bearing required.

5c SET-BACK CONNECTION

Notes:

- Verify girder joist capacity if the back span exceeds the joist spacing.
- Attach double I-joist per detail 1p, if required.

FIGURE 5 (continued)

For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in)	ROOF TRUSS SPAN (ft)	ROOF LOADING (UNFACTORED)											
		LL = 30 psf, DL = 15 psf			LL = 40 psf, DL = 15 psf			LL = 50 psf, DL = 15 psf					
		JOIST SPACING (in)			JOIST SPACING (in)			JOIST SPACING (in)					
		12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
11/2	26	X	X	X	X	2	X	X	X	2	X	X	X
30	N	X	X	X	X	2	X	X	X	2	X	X	X
32	N	X	X	X	X	2	X	X	X	2	X	X	X
34	N	X	X	X	X	2	X	X	X	2	X	X	X
36	N	X	X	X	X	2	X	X	X	2	X	X	X
40	N	X	X	X	X	2	X	X	X	2	X	X	X
42	N	X	X	X	X	2	X	X	X	2	X	X	X
11/8	26	N	X	X	X	N	X	X	X	N	X	X	X
30	N	X	X	X	X	N	X	X	X	N	X	X	X
32	N	X	X	X	X	N	X	X	X	N	X	X	X
34	N	X	X	X	X	N	X	X	X	N	X	X	X
36	N	X	X	X	X	N	X	X	X	N	X	X	X
40	N	X	X	X	X	N	X	X	X	N	X	X	X
42	N	X	X	X	X	N	X	X	X	N	X	X	X

- N = No reinforcement required.
- Ni reinforced with 3/4\" wood structural panel on one side only.
- Ni reinforced with 3/4\" wood structural panel on both sides, or double I-joist. X = Try a deeper joist or closer spacing.
- Maximum design load shall be: 15 psf roof dead load, 55 psf floor total load, and 80 psf wall load. Wall load is based on 3-0\" maximum width window or door openings.
- For larger openings, or multiple 3-0\" width openings spaced less than 6-0\" o.c., additional joists beneath the opening's cripple studs may be required.
- Table applies to joists 12\" to 24\" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use 12\" o.c. requirements for lesser spacing.
- For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam. When the roof is framed using a ridge board, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
- Cantilevered joists supporting girder trusses or roof beams may require additional reinforcing.

WEB HOLES

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- Joist top and bottom flanges must NEVER be cut, notched, or otherwise modified.
- Whenever possible, field-cut holes should be centred on the middle of the web.
- The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
- The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the longest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
- A knockout is NOT considered a hole, may be utilized wherever it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
- Holes measuring 1-1/2 inches or smaller shall be permitted anywhere in a contoured section of a joist. Holes of greater size may be permitted subject to verification.
- A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
- All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
- Limit three maximum size holes per span, of which one may be a duct chase opening.
- A group of round holes at approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Joist Depth	Joist Series	Minimum distance from inside face of any support to centre of hole (ft-in.)												Span Adjustment Factor		
		2	3	4	5	6	7	8	9	10	11	12	13			
N40	N40	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
	N40	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
	N40	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
N60	N60	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
	N60	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
	N60	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
N80	N80	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
	N80	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
	N80	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
N100	N100	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
	N100	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0
	N100	0.7	0.8	0.9	1.0	1.1	1.2	1.3	1.4	1.5	1.6	1.7	1.8	1.9	2.0	1.0

- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Hole location distance is measured from inside face of supports to centre of hole.
- Distances in this chart are based on uniformly loaded joists.

OPTIONAL:

The above table is based on the I-joists used at their maximum span. If the I-joists are placed at less than their full maximum span (see Maximum Span Table) the minimum distance from the centreline of the hole to the face of any support (D) as given above may be reduced as follows:


$$\text{Reduced } D = \frac{\text{Actual } D}{\text{SAF}}$$

Where:

- Reduced = Distance from the inside face of any support to centre of hole, reduced for less-than-maximum span application. Distance shall not be less than 6 inches from the face of the support to edge of the hole.
- Actual = The actual measured span distance between the inside faces of supports (S).
- SAF = Span Adjustment Factor given in this table.
- D = The minimum distance from the inside face of any support to centre of hole from this table.
- If $\frac{\text{Actual}}{D}$ is greater than 1, use 1 in the above calculation for $\frac{\text{Actual}}{D}$.



FIGURE 7
FIELD-CUT HOLE LOCATOR

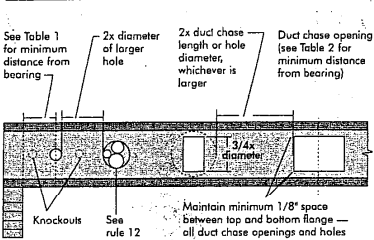

A knockout is NOT considered a hole, may be utilized wherever it occurs and may be ignored for purposes of calculating minimum distances between holes.

Knockouts are predrilled holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on centre along the length of the I-joist. Where possible, it is preferable to use knockouts instead of field-cut holes.



Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

TABLE 2
DUCT CHASE OPENING SIZES AND LOCATIONS — Simple Span Only

Joist Depth	Joist Series	Minimum distance from inside face of any support to centre of opening (ft-in.)									
		6	10	12	14	16	18	20	22	24	
N40	N40	4.1	4.5	4.10	4.4	4.8	5.1	5.4	5.7	6.0	6.3
	N40	5.0	5.4	5.0	5.3	5.7	6.0	6.3	6.6	6.9	
	N40	5.7	6.1	5.7	6.0	6.4	6.7	7.0	7.3	7.6	
N60	N60	5.0	5.4	5.0	5.3	5.7	6.0	6.3	6.6	6.9	
	N60	5.7	6.1	5.7	6.0	6.4	6.7	7.0	7.3	7.6	
	N60	6.4	6.8	6.4	6.7	7.1	7.4	7.7	8.0	8.3	
N80	N80	5.7	6.1	5.7	6.0	6.4	6.7	7.0	7.3	7.6	
	N80	6.4	6.8	6.4	6.7	7.1	7.4	7.7	8.0	8.3	
	N80	7.1	7.5	7.1	7.4	7.8	8.1	8.4	8.7	9.0	
N100	N100	6.4	6.8	6.4	6.7	7.1	7.4	7.7	8.0	8.3	
	N100	7.1	7.5	7.1	7.4	7.8	8.1	8.4	8.7	9.0	
	N100	7.8	8.2	7.8	8.1	8.5	8.8	9.1	9.4	9.7	

- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Duct chase opening location distance is measured from inside face of supports to centre of opening.
- The above table is based on simple-span joists only. For other applications, contact your local distributor.
- Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. For other applications, contact your local distributor.

INSTALLING THE GLUED FLOOR SYSTEM

- Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
- Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
- Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
- Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when tapped into place with a block and sledgehammer.
- Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
- Apply two lines of glue on I-joists where panel ends butt to assure proper gluing of each end.
- After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) than used on I-joist flanges.
- Tap the second row of panels into place, using a block to protect groove edges.
- Stagger end joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including T&G edges, is recommended. (Use a spacer tool or an 1/2-inch common nail to assure accurate and consistent spacing.)
- Complete all nailing of each panel before glue sets. Check the manufacturer's recommendations for cure time. (Warm weather accelerates glue setting.) Use 2" ring- or screw-shank nails for panels 3/4-inch thick or less, and 2-1/2" ring- or screw-shank nails for thicker panels. Space nails per the table below. Closer nail spacing may be required by some codes, or for diaphragm construction. The finished deck can be walked on right away and will carry construction loads without damage to the glue bond.

FASTENERS FOR SHEATHING AND SUBFLOORING⁽¹⁾

Maximum Fastener Spacing (ft.)	Maximum Panel Thickness (in.)	Nail Size and Type			Maximum Spacing of Fasteners (ft.)	Minimum Spacing (ft.)
		Common Nail or Screw	Ring Shank Nail	Strip		
16	5/8	2"	1-3/4"	2"	6"	12"
20	5/8	2"	1-3/4"	2"	6"	12"
24	3/4	2"	1-3/4"	2"	6"	12"


- Fasteners of sheathing and subflooring shall conform to the above table.
- Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
- Flooring screws shall not be less than 1/8-inch in diameter.
- Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
- Use only adhesives conforming to CAN/CGSB-7.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues; check with panel manufacturer.

Ref.: NRC-CNRC, National Building Code of Canada 2010, Table 9.23.3.5.


IMPORTANT NOTE: Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.

RIM BOARD INSTALLATION DETAILS


(8a) ATTACHMENT DETAILS WHERE RIM BOARDS ABUT

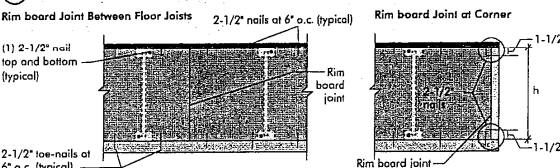

(8b) TOE-NAIL CONNECTION AT RIM BOARD



(8c) 2X LEDGER TO RIM BOARD ATTACHMENT DETAIL

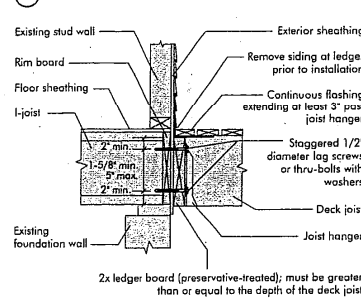


CHARTERS
CONSTRUCTION


PRODUCT WARRANTY

Charters Construction guarantees that, in accordance with our specifications, these products are free from manufacturing defects in material and workmanship.

Furthermore, Charters Construction warrants that our products, when utilized in accordance with our detailing and installation instructions, will meet or exceed our specifications for the lifetime of the structure.



SITE COPY

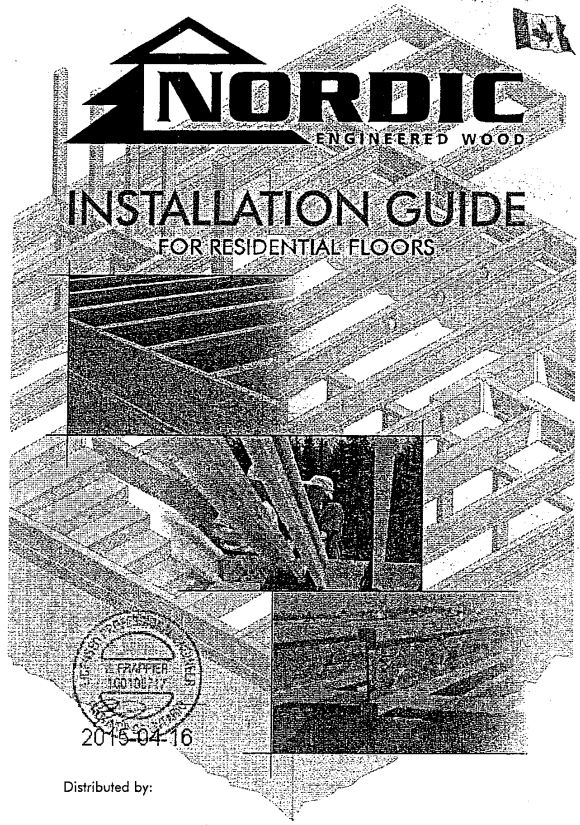


Distributed by:



SAFETY AND CONSTRUCTION PRECAUTIONS



WARNING
I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.



Avoid Accidents by Following these Important Guidelines:



1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged I-joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.


STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
 - Pick I-joists in bundles as shipped by the supplier.
 - Orient the bundles so that the webs of the I-joists are vertical.
 - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.

INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact your supplier.
2. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple spans must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge may never be used as blocking or rim boards. I-joist blocking panels or other engineered wood products – such as rim board – must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.

FIGURE 1
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

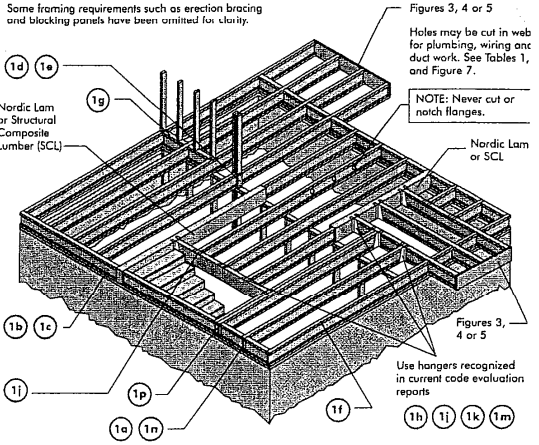

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

1a

Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
Ni Joists	3,300

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

1b

Blocking Panel or Rim Board Plus	Maximum Factored Uniform Vertical Load* (plf)
1-1/8" Rim Board Plus	8,090

*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

1c

1d

Pair of Squash Blocks	Maximum Factored Uniform Vertical Load* (plf)
3-1/2" wide	5,120
2x Lumber	5,500
1-1/8" Rim Board Plus	4,300
Pair of Squash Blocks (8d)	8,500
	6,600

Provide lateral bracing per detail 1a, 1b, or 1c

SITE COPY

MAXIMUM FLOOR SPANS

- Maximum clear spans applicable to simple-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CGS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
- Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
- Tables are based on Limit States Design per CAN/CSA O86-09 Standard, and NBC 2010.
- SI units conversion: 1 inch = 25.4 mm
1 foot = 0.305 m


MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS SIMPLE AND MULTIPLE SPANS

Joist Depth	Joist Series	Simple spans				Multiple spans			
		17.2	19.2	21.0	23.0	17.2	19.2	21.0	23.0
9-1/2"	NI-20	15.1'	14.2'	13.9'	13.5'	14.3'	13.4'	13.1'	12.7'
	NI-40x	16.1'	15.2'	14.8'	14.9'	17.5'	16.5'	15.1D'	15.5'
	NI-60	16.9'	15.4'	14.1D'	14.11'	17.7'	16.7'	16.0'	16.1'
	NI-70	17.1'	16.1'	15.6'	15.7'	18.7'	17.4'	16.9'	16.1D'
11-7/8"	NI-20	16.11'	16.0'	15.5'	15.6'	18.4'	17.3'	16.8'	16.7'
	NI-40x	18.1'	17.0'	16.5'	16.6'	20.0'	18.6'	17.9'	17.7'
	NI-60	18.4'	17.3'	16.9'	16.9'	20.3'	18.9'	18.0'	18.1'
	NI-70	19.4'	18.0'	17.4'	17.5'	21.4'	19.1'	18.0'	18.1'
14"	NI-80	19.9'	18.3'	17.6'	17.7'	21.9'	20.2'	19.3'	19.4'
	NI-90	20.2'	18.7'	17.1D'	17.11'	22.3'	20.7'	19.8'	19.9'
	NI-100	20.4'	18.9'	17.11'	17.1'	22.5'	20.9'	19.1D'	19.11'
	NI-40x	20.1'	18.7'	17.1D'	17.11'	22.2'	20.6'	19.8'	19.4'
17"	NI-60	20.5'	18.11'	18.11'	18.2'	22.7'	20.11'	20.0'	20.1'
	NI-70	21.7'	20.0'	19.1'	19.2'	23.1D'	22.4'	21.1'	21.21'
	NI-80	21.11'	20.3'	19.4'	19.4'	24.3'	22.2'	21.5'	21.61'
	NI-90	22.5'	20.8'	19.9'	19.1D'	24.9'	22.1D'	21.1D'	21.1D'
19"	NI-90x	22.7'	20.11'	19.11'	20.0'	25.0'	23.11'	22.0'	22.7'
	NI-20	22.5'	21.8'	19.1'	19.1D'	24.7'	22.5'	21.9'	21.1D'
	NI-40	23.4'	21.9'	20.9'	20.1D'	24.9'	24.0D'	23.11'	23.0D'
	NI-60	23.11'	22.11'	21.1'	21.1D'	26.5'	24.5'	23.3'	23.4'
21"	NI-90	24.5'	22.6'	21.6'	21.61'	26.11'	24.1D'	23.9'	23.9'
	NI-90x	24.8'	22.9'	21.9'	21.1D'	27.5'	25.2'	24.9'	24.31'

CCMC EVALUATION REPORT 13032-R

I-JOIST HANGERS

- Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
- All nailing must meet the hanger manufacturer's recommendations.
- Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
- Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the I-joist.




WEB STIFFENERS

RECOMMENDATIONS:

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.
 - A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
 - A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.
- SI units conversion: 1 inch = 25.4 mm

FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

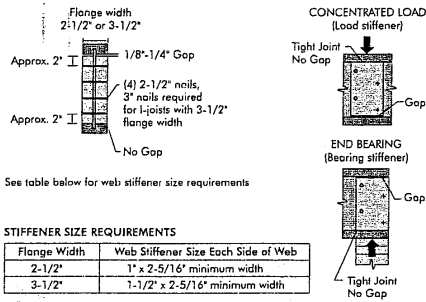

See table below for web stiffener size requirements

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width

NORDIC I-JOIST SERIES

Chomiers Chibougoumou Ltd. harvests its own trees, which enables Nordic products to adhere to strict quality control procedures throughout the manufacturing process. Every phase of the operation, from the raw timber to the finished product, reflects our commitment to quality.

Nordic Engineered Wood I-joists use only finger-jointed lumber in their flanges, ensuring consistent quality, superior strength and longer span carrying capacity.

1a Transfer load from above to bearing below. Install squash blocks per detail 1d. Match bearing area of blocks below to post above.

1b Use single I-joist for loads up to 3,200 plf, double I-joists for loads up to 6,600 plf (filler block not required). Attach I-joist to top plate using 2-1/2" nails at 6" o.c.

Provide backer for siding attachment unless nailable sheathing is used.

Rim board may be used in lieu of I-joists. Backer is not required when rim board is used. Bracing per code shall be carried to the foundation.

1c Load bearing wall above shall align vertically with the bearing below. Other conditions, such as offset bearing walls, are not covered by this detail.

Blocking required over all interior supports under load-bearing walls or when floor joists are not continuous over support.

Joist attachment per detail 1b

2-1/2" nails at 6" o.c. to top plate

NI blocking panel per detail 1c

1d Backer block (use if hanger load exceeds 360 lbs)

Before installing a backer block to a double I-joist, drive three additional 3" nails through the webs and filler block where the backer block will fit. Clinch. Install backer tight to top flange. Use twelve 3" nails, clinched when possible. Maximum factored resistance for hanger for this detail = 1,620 lbs.

Double I-joist header

Top- or face-mount hanger

Filler block per detail 1p

Backer block required (both sides for face-mount hangers)

1e Top- or face-mount hanger installed per manufacturer's recommendations

For nailing schedules for multiple beams, see the manufacturer's recommendations.

Note: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

1f 2x plate flush with inside face of wall or beam. 1/8" overhang allowed past inside face of wall or beam.

Top-mount hanger installed per manufacturer's recommendations

1g Multiple I-joist header with full depth filler block shown. Nordic Lam or SCL headers may also be used. Verify double I-joist capacity to support concentrated loads.

Filler block per detail 1p

Install hanger per manufacturer's recommendations

Backer block attached per detail 1h. Nail with twelve 3" nails, clinch when possible.

Maximum support capacity = 1,620 lbs.

1h Do not bevel-cut joist beyond inside face of wall.

Attach I-joist per detail 1b

Note: Blocking required at bearing for lateral support, not shown for clarity.

1i Notes:

- Support back of I-joist web during nailing to prevent damage to web/flange connection.
- Leave a 1/8" to 1/4-inch gap between top of filler block and bottom of top I-joist flange.
- Filler block is required between joists for full length of span.
- Nail joists together with two rows of 3" nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
- The maximum factored load that may be applied to one side of the double joist using this detail is 860 lb/ft. Verify double I-joist capacity.

FILLER BLOCK REQUIREMENTS FOR DOUBLE I-JOIST CONSTRUCTION

Flange Size	Joist Depth	Filler Block Size
2-1/2" x 1-1/2"	9-1/2"	2-1/8" x 6"
	11-7/8"	2-1/8" x 8"
	14"	2-1/8" x 10"
	16"	2-1/8" x 12"
3-1/2" x 1-1/2"	9-1/2"	3" x 6"
	11-7/8"	3" x 8"
	14"	3" x 10"
	16"	3" x 12"
3-1/2" x 2"	11-7/8"	3" x 9"
	14"	3" x 9"
	16"	3" x 11"

1j Lumber 2x4 min., extend block to face of adjacent web. Two 2-1/2" spiral nails from each web to lumber piece, alternate on opposite side.

NI blocking panel

Optional: Minimum 1x4 inch square gypsum ceiling attached to underside of joist.

1k One 2-1/2" nails at top and bottom flange

Rim board

Two 2-1/2" nails from each web to lumber piece

2x4 min. (1/8" gap minimum)

Two 2-1/2" nails from each web to lumber piece

I-joist blocking panel

One 2-1/2" nails one side only

2-1/2" nails at 6" o.c.

1l Notes:

- In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are...

SITE COPY