

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information					
Building number, street name TH-5 Alt WOB				Lot: Lot/con.	
Municipality Bradford		Postal code	Plan number/ other description		
B. Individual who reviews and takes responsibility for design activities					
Name David DaCosta			Firm gtaDesigns Inc.		
Street address 2985 Drew Road, Suite 202				Unit no.	Lot/con.
Municipality Mississauga		Postal code L4T 0A4	Province Ontario	E-mail dave@gtadesigns.ca	
Telephone number (905) 671-9800		Fax number (647) 494-9643		Cell number (416) 268-6820	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 of Division C]					
☐ House ☒ HVAC – House ☐ Building Structural ☐ Small Buildings ☐ Building Services ☐ Plumbing – House ☐ Large Buildings ☐ Detection, Lighting and Power ☐ Plumbing – All Buildings ☐ Complex Buildings ☐ Fire Protection ☐ On-site Sewage Systems					
Description of designer's work			Model Certification		Project #:
					Layout #:
Heating and Cooling Load Calculations			Main		PJ-00204
Air System Design			Alternate X		JB-04868
Residential mechanical ventilation Design Summary			Area Sq ft: 1894		
Residential System Design per CAN/CSA-F280-12			Builder		Bayview Wellington
Residential New Construction - Forced Air			Project		Green Valley East
			Model		TH-5 Alt WOB
			SB-12		Package A1
D. Declaration of Designer					
I, <u>David DaCosta</u> declare that (choose one as appropriate): (print name)					
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4 Division C of the Building Code. I am qualified, and the firm is registered in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____					
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5 of Division C, of the Building Code. Individual BCIN: <u>32964</u> Basis for exemption from registration: <u>Division C 3.2.4.1. (4)</u>					
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____					
I certify that: 1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.					
<u>June 20, 2018</u> Date			 Signature of Designer		

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d), of Division C, Article 3.2.5.1. of Division C and all other persons who are exempt from qualifications under Subsections 3.2.4 . and 3.2.5.of Division C.
- Schedule 1 does not require to be completed a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited licence to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Heat loss and gain calculation summary sheet				CSA-F280-M12 Standard Form No. 1	
These documents issued for the use of Bayview Wellington				Layout No.	
and may not be used by any other persons without authorization. Documents for permit and/or construction are signed in red.				JB-04868	
Building Location					
Address (Model): TH-5 Alt WOB			Site: Green Valley East		
Model:			Lot:		
City and Province: Bradford			Postal code:		
Calculations based on					
Dimensional information based on: VA3 DESIGN22/May/2018					
Attachment: Townhome			Front facing: East/West		Assumed? Yes
No. of Levels: 3		Ventilated? Included	Air tightness: 1961-Present (ACH=3.57)		Assumed? Yes
Weather location: Bradford			Wind exposure: Sheltered		
HRV? LifeBreath		RNC155	Internal shading: Light-translucent		Occupants: 4
Sensible Eff. at -25C 71%		Apparent Effect. at -0C 84%	Units: Imperial		Area Sq ft: 1894
Sensible Eff. at -0C 75%					
Heating design conditions			Cooling design conditions		
Outdoor temp -9.4 Indoor temp: 72 Mean soil temp: 48			Outdoor temp 86 Indoor temp: 75 Latitude: 44		
Above grade walls			Below grade walls		
Style A: As per OBC SB12 Package A1 R 22			Style A: As per OBC SB12 Package A1 R 20ci		
Style B: Existing Walls (When Applicable) R 12			Style B:		
Style C:			Style C:		
Style D:			Style D:		
Floors on soil			Ceilings		
Style A: As per Selected OBC SB12 Package A1			Style A: As per Selected OBC SB12 Package A1 R 60		
Style B:			Style B: As per Selected OBC SB12 Package A1 R 31		
Exposed floors			Style C:		
Style A: As per Selected OBC SB12 Package A1 R 31			Doors		
Style B:			Style A: As per Selected OBC SB12 Package A1 R 4.00		
Windows			Style B:		
Style A: As per Selected OBC SB12 Package A1 R 3.55			Style C:		
Style B: Existing Windows (When Applicable) R 1.99			Skylights		
Style C:			Style A: As per Selected OBC SB12 Package A1 R 2.03		
Style D:			Style B:		
Attached documents: As per Shedule 1		Heat Loss/Gain Caculations based on CSA-F280-12 Effective R-Values			
Notes: Residential New Construction - Forced Air					
Calculations performed by					
Name: David DaCosta			Postal code: L4T 0A4		
Company: gtaDesigns Inc.			Telephone: (905) 671-9800		
Address: 2985 Drew Road, Suite 202			Fax: (416) 268-6820		
City: Mississauga			E-mail: dave@gtadesigns.ca		

Builder: **Bayview Wellington**

Date: **June 20, 2018**

Project: **Green Valley East**

Model: **TH-5 Alt WOB**

System 1

I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under Division C subsection 3.2.5. of the Building Code.

Individual BCIN: 32964 *David DaCosta* David DaCosta

Page 3
Project # **PJ-00204**
Layout # **JB-04868**

DESIGN LOAD SPECIFICATIONS		AIR DISTRIBUTION & PRESSURE		FURNACE/AIR HANDLER DATA:		BOILER/WATER HEATER DATA:		A/C UNIT DATA:	
Level 1 Net Load	13,591 btu/h	Equipment External Static Pressure	0.5 "w.c.	Make	Amana	Make	Type	Amana	1.5 Ton
Level 2 Net Load	9,116 btu/h	Additional Equipment Pressure Drop	0.225 "w.c.	Model	AMEC960403ANA	Model		Cond.-----	1.5
Level 3 Net Load	7,648 btu/h	Available Design Pressure	0.275 "w.c.	Input Btu/h	40000	Input Btu/h		Coil -----	1.5
Level 4 Net Load	0 btu/h	Return Branch Longest Effective Length	300 ft	Output Btu/h	38400	Output Btu/h			
Total Heat Loss	30,355 btu/h	R/A Plenum Pressure	0.138 "w.c.	E.s.p.	0.50	" W.C.			
Total Heat Gain	17,524 btu/h	S/A Plenum Pressure	0.14 "w.c.	Water Temp		deg. F.			
Combo System HL + 10%	33,390 Btu/h	Heating Air Flow Proportioning Factor	0.0254 cfm/btuh	AFUE	96%				
Building Volume Vb	22196 ft³	Cooling Air Flow Proportioning Factor	0.0441 cfm/btuh	Aux. Heat					
Ventilation Load	895 Btu/h	R/A Temp	70 deg. F.	SB-12 Package	Package A1				
Ventilation PVC	63.6 cfm	S/A Temp	116 deg. F.						
Supply Branch and Grill Sizing		Diffuser loss	0.01 "w.c.	Temp. Rise>>>	46 deg. F.				

	Level 1													Level 2												
S/A Outlet No.	1	2	3	4										5	6	7	8									
Room Use	BASE	BASE	BASE	BASE										FAM/KIT	FAM/KIT	MUD	FOY									
Btu/Outlet	3398	3398	3398	3398										2838	2838	1212	2227									
Heating Airflow Rate CFM	86	86	86	86										72	72	31	57									
Cooling Airflow Rate CFM	57	57	57	57										101	101	6	34									
Duct Design Pressure	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13
Actual Duct Length	25	16	11	25										34	24	19	36									
Equivalent Length	110	140	130	110	70	70	70	70	70	70	70	70	70	100	80	140	100	70	70	70	70	70	70	70	70	
Total Effective Length	135	156	141	135	70	70	70	70	70	70	70	70	70	134	104	159	136	70	70	70	70	70	70	70	70	
Adjusted Pressure	0.10	0.08	0.09	0.10	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.10	0.13	0.08	0.10	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	
Duct Size Round	6	6	6	6										6	6	4	5									
Outlet Size	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	3x10	3x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	
Trunk	A	A	B	B										A	A	B	B									

	Level 3							Level 4																	
S/A Outlet No.	9	10	11	12	13	14	15																		
Room Use	MAST	MAST	LAUN	BED 2	BED 3	BATH	ENS																		
Btu/Outlet	1503	1503	241	1257	1306	130	1709																		
Heating Airflow Rate CFM	38	38	6	32	33	3	43																		
Cooling Airflow Rate CFM	54	54	50	51	51	3	41																		
Duct Design Pressure	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13	0.13
Actual Duct Length	57	51	30	38	51	41	37																		
Equivalent Length	120	130	150	90	130	160	120	70	70	70	70	70	70	70	70	70	70	70	70	70	70	70	70	70	
Total Effective Length	177	181	180	128	181	201	157	70	70	70	70	70	70	70	70	70	70	70	70	70	70	70	70	70	
Adjusted Pressure	0.07	0.07	0.07	0.10	0.07	0.06	0.08	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	0.19	
Duct Size Round	5	5	5	5	5	2	5																		
Outlet Size	3x10	3x10	3x10	3x10	3x10	3x10	3x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	4x10	
Trunk	B	B	A	A	A	A	B																		

Return Branch And Grill Sizing	Grill Pressure Loss										
	0.02 "w.c.										
R/A Inlet No.	1R	2R	3R	4R	5R	6R	7R	8R	9R	10R	11R
Inlet Air Volume CFM	175	342	105	150							
Duct Design Pressure	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12	0.12
Actual Duct Length	5	18	52	32							
Equivalent Length	155	165	105	140	50	50	50	50	50	50	50
Total Effective Length	160	183	157	172	50	50	50	50	50	50	50
Adjusted Pressure	0.07	0.06	0.07	0.07	0.24	0.24	0.24	0.24	0.24	0.24	0.24
Duct Size Round	7.0	10.5	6.0	7.5							
Inlet Size	FLC	6	8	8							
" "	x	x	x	x	x	x	x	x	x	x	x
Inlet Size		30	14	14							
Trunk	Z	Z	Z	Z							

Return Trunk Duct Sizing					Supply Trunk Duct Sizing				
Trunk	CFM	Press.	Round	Rect. Size	Trunk	CFM	Press.	Round	Rect. Size
Drop	772	0.06	14.0	24x10	A	392	0.06	11.0	14x8 10x10
Z	772	0.06	14.0	22x8 18x10	B	380	0.07	10.5	12x8 10x10
Y					C				
X					D				
W					E				
V					F				
U					G				
T					H				
S					I				
R					J				
Q					K				

SITE COPY

SITE COPY

2012 OBC

Builder: Bayview Wellington

Date: June 20, 2018

Project: Green Valley East

Model: TH-5 Alt WOB

System 1

Weather Data Bradford 44 -9.4 86 22 48.2

Heat Loss ^T 81.4 deg. F Ht gain ^T 11 deg. F GTA: 1894

Project #
Layout #

Level 1

BASE

Run ft. exposed wall A	44	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A
Run ft. exposed wall B	19	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B
Ceiling height	5.5	AG	5.5	AG	5.5	AG	5.5	AG	5.5	AG	5.5	AG	5.5	AG	5.5	AG
Floor area	737	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area
Exposed Ceilings A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A
Exposed Ceilings B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B
Exposed Floors	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr
Gross Exp Wall A	242															
Gross Exp Wall B	162															

Components	R-Values	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain
North Shaded	3.55	22.93	10.91														
East/West	3.55	22.93	27.35														
South	3.55	22.93	20.89														
WOB Windows	3.55	22.93	27.35	68	1559	1860											
Skylight	2.03	40.10	88.23														
Doors	4.00	20.35	2.75	21	427	58											
Net exposed walls A	21.13	3.85	0.52	221		115											
Net exposed walls B	21.13	3.85	0.52	94	360	49											
Exposed Ceilings A	59.22	1.37	0.64														
Exposed Ceilings B	22.86	3.56	1.66														
Exposed Floors	29.80	2.73	0.17														
Foundation Conductive Heatloss	On Grade () or Above ()																
Total Conductive	Heat Loss																
Air Leakage	Heat Loss/Gain	0.7377	0.0452														
Ventilation	Case 1	0.06	0.09														
	Case 2	14.07	11.88														
	Case 3	x	0.05	0.09													
Heat Gain People			239														
Appliances Loads	1 = .25 percent		3167														
Duct and Pipe loss			10%														
Level 1 HL Total	13,591			13,591													
Level 1 HG Total	5,137				5,137												

Level 2

FAM/KIT

MUD

FOY

Run ft. exposed wall A	41	A	7	A	15	A	A	A	A	A	A	A	A	A	A	A
Run ft. exposed wall B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B
Ceiling height	10.0		12.0		11.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Floor area	664	Area	35	Area	77	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area	Area
Exposed Ceilings A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A	A
Exposed Ceilings B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B	B
Exposed Floors	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr	Flr
Gross Exp Wall A	410		84		165											
Gross Exp Wall B																

Components	R-Values	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain	Loss	Gain
North Shaded	3.55	22.93	10.91														
East/West	3.55	22.93	27.35														
South	3.55	22.93	20.89														
Existing Windows	1.99	40.90	22.15														
Skylight	2.03	40.10	88.23														
Doors	4.00	20.35	2.75														
Net exposed walls A	17.03	4.78	0.65	330	1577	213											
Net exposed walls B	8.50	9.58	1.29														
Exposed Ceilings A	59.22	1.37	0.64														
Exposed Ceilings B	22.86	3.56	1.66														
Exposed Floors	29.80	2.73	0.17														
Foundation Conductive Heatloss	On Grade () or Above ()																
Total Conductive	Heat Loss																
Air Leakage	Heat Loss/Gain	0.6144	0.0452														
Ventilation	Case 1	0.05	0.09														
	Case 2	14.07	11.88														
	Case 3	x	0.05	0.09													
Heat Gain People			239														
Appliances Loads	1 = .25 percent		3167														
Duct and Pipe loss			10%														
Level 2 HL Total	9,116			9,116													
Level 2 HG Total	5,496				5,496												

SITE COPY

I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under

Division C subsection 3.2.5. of the Building Code. Individual BCIN:

32964

Dave DaCosta

Dave DaCosta

SB-12 Package

Package A1

Total Heat Loss	30,355	btu/h
Total Heat Gain	17,524	btu/h

I review and take responsibility for the design work and am qualified in the appropriate category as an "other designer" under Division C subsection 3.2.5. of the Building Code.

Individual BCIN: 32964



David DaCosta

Package: Package A1
Project: Bradford
Model: TH-5 Alt WOB

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

For systems serving one dwelling unit & conforming to the Ontario Building Code, O.reg 332/12

Location of Installation	
Lot #	Plan #
Township	Bradford
Roll #	Permit #
Address	

Builder	
Name	Bayview Wellington
Address	
City	
Tel	Fax

Installing Contractor	
Name	
Address	
City	
Tel	Fax

Combustion Appliances 9.32.3.1(1)		
a)	x	Direct vent (sealed combustion) only
b)		Positive venting induced draft (except fireplaces)
c)		Natural draft, B-vent or induced draft fireplaces
d)		Solid fuel (including fireplaces)
e)		No combustion Appliances

Heating System		
x	Forced air	Non forced air
		Electric space heat (if over 10% of heat load)

House Type 9.32.3.1(2)		
I	x	Type a) or b) appliances only, no solid fuel
II		Type I except with solid fuel (including fireplace)
III		Any type c) appliance
IV		Type I or II either electric space heat
Other		Type I, II or IV no forced air

System Design Option		
1	x	Exhaust only / forced air system
2		HRV WITH DUCTING / forced air system
3		HRV simplified connection to forced air system
4		HRV full ducting/not coupled to forced air system
		Part 6 design

Total Ventilation Capacity 9.32.3.3(1)				
Bsmt & Master Bdrm	2 @	21.2 cfm	42.4 cfm	
Other Bedrooms	2 @	10.6 cfm	21.2 cfm	
Bathrooms & Kitchen	4 @	10.6 cfm	42.4 cfm	
Other rooms	3 @	10.6 cfm	31.8 cfm	
Total			137.8	

Principal Ventilation Capacity 9.32.3.4(1)				
Master bedroom	1 @	31.8 cfm	31.8 cfm	
Other bedrooms	2 @	15.9 cfm	31.8 cfm	
Total			63.6	


Principal Exhaust Fan Capacity				
Make	Model	Location		
LifeBreath	RNC155	Base		
132 cfm		Sones	or Equiv.	

Heat Recovery Ventilator				
Make	LifeBreath			
Model	RNC155			
	132 cfm high		80 cfm low	
Sensible efficiency @ -25 deg C			71%	
Sensible efficiency @ 0 deg C			75%	

Note: Installer to balance HRV/ERV to within 10 percent of PVC

Supplemental Ventilation Capacity				
Total ventilation capacity			137.8	
Less principal exhaust capacity			63.6	
REQUIRED supplemental vent. Capacity			74.2	cfm

Supplemental Fans 9.32.3.5.				
Location	cfm	Model	Sones	
Ens	50	XB50	0.3	
Bath	50	XB50	0.3	
all fans HVI listed				
	Make	Broan	or Equiv.	

Designer Certification	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name	David DaCosta
Signature	
HRAI #	5150 BCIN # 32964
Date	June 20, 2018

SITE COPY



2985 Drew Road, Suite 202, Mississauga, Ontario
 L4T 0A4 Tel: 905-671-9800 Fax: 647-494-9643
 e-mail dave@gtadesigns.ca

Energy Efficiency Design Summary: Prescriptive Method (Building Code Part 9, Residential)

Page 7
 Project # PJ-00204
 Layout # JB-04868

This form is used by a designer to demonstrate that the energy efficiency design of a house complies with the building code using the prescriptive method described in Subsection 3.1.1. of SB-12. This form is applicable where the ratio of gross area of windows/sidelights/skylights/glazing in doors and sliding glass doors to the gross area of peripheral walls is not more than 22%.

For use by Principal Authority

Application No:

Model/Certification Number

A. Project Information

Building number, street name TH-5 Alt WOB		Unit number	Lot/Con
Municipality Bradford	Postal code	Reg. Plan number / other description	

B. Prescriptive Compliance [indicate the building code compliance package being employed in the house design]

SB-12 Prescriptive (input design package):

Package A1

Table: 3.1.1.2.A

C. Project Design Conditions

Climatic Zone (SB-1):	Heat. Equip. Efficiency	Space Heating Fuel Source		
☒ Zone 1 (< 5000 degree days) ☐ Zone 2 (≥ 5000 degree days)	☒ ≥ 92% AFUE ☐ ≥ 84% < 92% AFUE	☒ Gas ☐ Oil	☐ Propane ☐ Electric	☐ Solid Fuel ☐ Earth Energy
Ratio of Windows, Skylights & Glass (W, S & G) to Wall Area		Other Building Characteristics		
Area of Walls = <u>328.59</u> m ² or <u>3536.9</u> ft ²	W, S & G % = <u>7%</u>	☐ Log/Post&Beam ☐ Slab-on-ground ☒ Air Conditioning ☐ Air Sourced Heat Pump (ASHP) ☐ Ground Source Heat Pump (GSHP)		
Area of W, S & G = <u>22.668</u> m ² or <u>244.0</u> ft ²	Utilize Window Averaging ☐ Yes ☒ No	☐ ICF Above Grade ☒ Walkout Basement ☐ Combo Unit		

D. Building Specifications [provide values and ratings of the energy efficiency components proposed]

Energy Efficiency Substitutions			
☐ ICF (3.1.1.2.(5) & (6) / 3.1.1.3.(5)) ☐ Combined space heating and domestic water heating systems (3.1.1.2(7) / 3.1.1.3.(7))			
☐ Airtightness substitution(s) Airtightness test required (Refer to Design Guide Attached)	☐ Table 3.1.1.4.B Required:		Permitted Substitution:
	☐ Table 3.1.1.4.C Required:		Permitted Substitution:
Building Component	Minimum RSI/R-Values or Maximum U-Value ¹		Efficiency Ratings
Thermal Insulation	Nominal	Effective	Windows & Doors Provide U-Value ⁽¹⁾ or ER rating
Ceiling with Attic Space	60		Windows/Sliding Glass Doors 1.6
Ceiling without Attic Space	31		Skylights 2.8
Exposed Floor	31		Mechanicals
Walls Above Grade	22		Heating Equip.(AFUE) 96%
Basement Walls	20.0ci		HRV Efficiency (SRE% at 0°C) 75%
Slab (all >600mm below grade)	x		DHW Heater (EF) 0.80
Slab (edge only ≤600mm below grade)	10		DWHR (CSA B55.1 (min. 42% efficiency)) #Showers 2
Slab (all ≤600mm below grade, or heated)	10		Combined Heating System

(1) U value to be provided in either W/(m²·K) or Btu/(h·ft²·°F) but not both.

E. Designer(s) [name(s) & BCIN(s), if applicable, of person(s) providing information herein to substantiate that design meets building code]

Name David DaCosta	BCIN 32964	Signature
------------------------------	----------------------	---------------

Form authorized by OHBA, OBOA, LMCBO. Revised December 1, 2016.

SITE COPY

Package: Package A1 System: System 1
Project: Bradford Model: TH-5 Alt WOB

Air Leakage Calculations

Building Air Leakage Heat Loss				
B	LRairh	Vb	HL ^Δ T	HL _{leak}
0.018	0.345	22196	81.4	11220

Building Air Leakage Heat Gain				
B	LRairh	Vb	HG ^Δ T	HG _{Leak}
0.018	0.084	22196	11	370

Air Leakage Heat Loss/Gain Multiplier Table (Section 11)				
Level	Level Factor (LF)	Building Air	Level Conductive Heat Loss	Air Leakage Heat Loss Multiplier
Level 1	0.5	11220	7605	0.7377
Level 2	0.3		5479	0.6144
Level 3	0.2		5005	0.4483
Level 4	0		0	0.0000

Levels			
1	2	3	4
(LF)	(LF)	(LF)	(LF)
1.0	0.6	0.5	0.4
	0.4	0.3	0.3
		0.2	0.2
			0.1

HG LEAK		Air Leakage Heat Gain	
	370		0.0452
BUILDING CONDUCTIVE HEAT GAIN			8173

Levels this Dwelling	
3	

Ventilation Calculations

Ventilation Heat Loss

Ventilation Heat Loss				
C	PVC	HL ^Δ T	(1-E) HRV	HL _{bvent}
1.08	63.6	81.4	0.16	895

Ventilation Heat Gain

Ventilation Heat Gain			
C	PVC	HG ^Δ T	HG _{bvent}
1.1	63.6	11	756

Case 1

Ventilation Heat Loss (Exhaust only Systems)

Case 1 - Exhaust Only				
Level	LF	HL _{bvent}	LVL Cond. HL	Multiplier
Level 1	0.5	895	7605	0.06
Level 2	0.3		5479	0.05
Level 3	0.2		5005	0.04
Level 4	0		0	0.00

Case 1

Ventilation Heat Gain (Exhaust Only Systems)

Case 1 - Exhaust Only		Multiplier	
HG _{bvent}	756	0.09	
Building	8173		

Case 2

Ventilation Heat Loss (Direct Ducted Systems)

C	HL ^Δ T	(1-E) HRV	Multiplier
1.08	81.4	0.16	14.07

Case 2

Ventilation Heat Gain (Direct Ducted Systems)

C	HG ^Δ T	Multiplier
1.08	11	11.88

Case 3

Ventilation Heat Loss (Forced Air Systems)

HL _{bvent}		Multiplier	
Total Ventilation Load	895	0.05	

Case 3

Ventilation Heat Gain (Forced Air Systems)

Vent Heat Gain		Multiplier	
HG _{bvent}	HG*1.3	756	
756	1		

Foundation Conductive Heatloss Level 1

1541 Watts 5258 Btu/h

Foundation Conductive Heatloss Level 2

Watts Btu/h

Envelope Air Leakage Calculator


Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Bradford			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.16			
Building Configuration				
Type:	Semi-Detached			
Number of Stories:	Two			
Foundation:	Shallow			
House Volume (m ³):	628.58			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (ACH=3.57)			
Custom BDT Data:	ELA @ 10 Pa. 322.44 cm ²			
	3.57 ACH @ 50 Pa			
Mechanical Ventilation (L/s):	Total Supply:		Total Exhaust:	
	31.8		31.8	
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Heating Air Leakage Rate (ACH/H): 0.345				
Cooling Air Leakage Rate (ACH/H): 0.084				

SITE COPY

Residential Foundation Thermal Load Calculator


Supplemental tool for CAN/CSA-F280

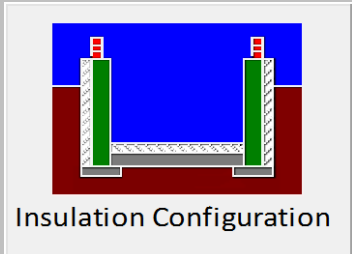Weather Station Description		
Province:	Ontario ▼	
Region:	Bradford ▼	
Site Description		
Soil Conductivity:	High conductivity: moist soil ▼	
Water Table:	Normal (7-10 m, 23-33 Ft) ▼	
Foundation Dimensions		
Floor Length (m):	17.99	 Insulation Configuration
Floor Width (m):	3.81	
Exposed Perimeter (m):	13.41	
Wall Height (m):	2.59	
Depth Below Grade (m):	0.91	
Window Area (m ²):	0.00	
Door Area (m ²):	1.95	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		1455


SITE COPY


Residential Slab on Grade Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

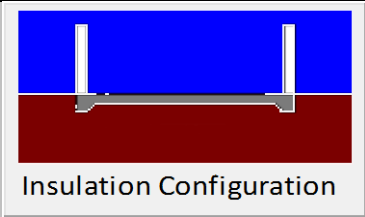
Weather Station Description		
Province:	Ontario ▼	
Region:	Bradford ▼	
Site Description		
Soil Conductivity:	High conductivity: moist soil ▼	
Water Table:	Normal (7-10 m, 23-33 Ft) ▼	
Floor Dimensions		
Length (m):	5.79	 Insulation Configuration
Width (m):	0.61	
Exposed Perimeter (m):	5.79	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		86

SITE COPY

	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER						PRINCIPAL EXHAUST FAN SWITCH
									W/R & PRINCIPAL EXHAUST FAN

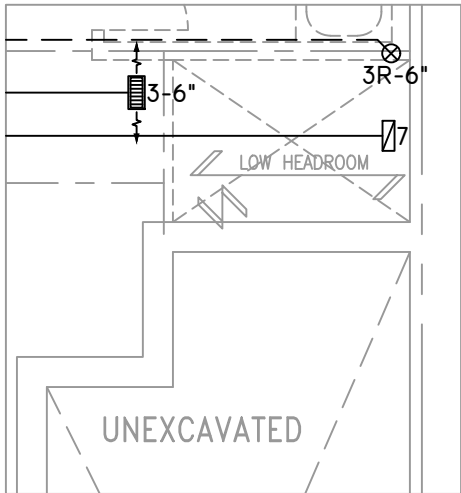

PARTIAL PLAN
SUNKEN 1R COND

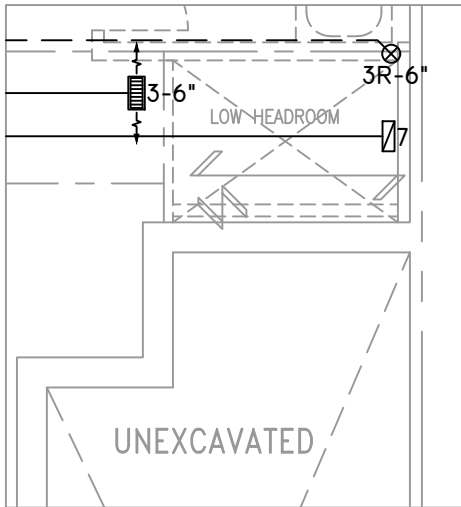

PARTIAL PLAN SUNKEN
2R OR MORE COND

FOR THE PURPOSE OF
HEATLOSS/GAIN
CALCULATIONS ALL
ELEVATIONS HAVE BEEN
CONSIDERED

FURNACE EQUIPPED WITH
BRUSHLESS DC MOTOR AS
PER OBC 12.3.1.5 (2)

INSULATE ALL DUCTS IN
UNCONDITIONED
SPACES MIN. R12

ALL DUCTWORK LOCATED IN
CONDITIONED AREAS
MUST BE SEALED TO CLASS
C LEVEL AS PER OBC PART
6-6.2.4.3.(12)

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON
BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE
REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER
QUALIFICATION INFORMATION
REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE
ONTARIO BUILDING CODE


DAVID DA COSTA


SIGNATURE OF DESIGNER

B.C.I.N. 32964

SITE COPY

PARTIAL BASEMENT PLAN 'A'
WOB COND

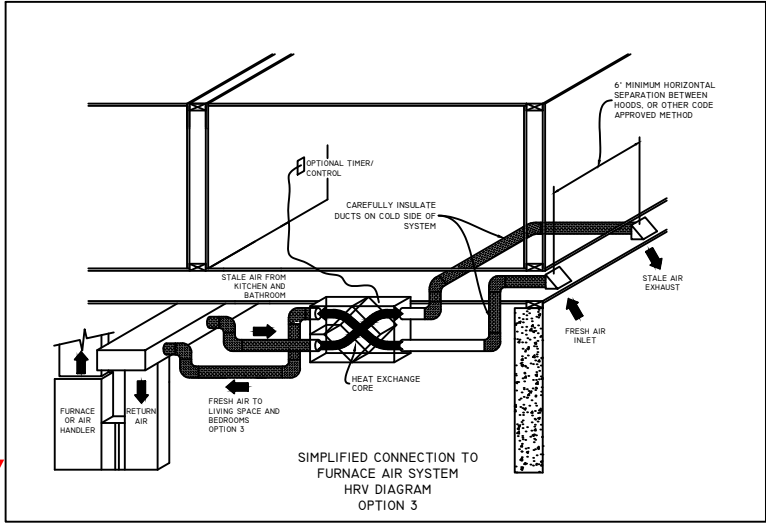

OBC 2012

ZONE I COMPLIANCE
PACKAGE "A1" REF. TABLE 3.1.1.2.A

NOTES
INSTALLATION TO COMPLY WITH THE LATEST ONTARIO
BUILDING CODE.
ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE
SPECIFIED.
PROVIDE BALANCING DAMPERS ON ALL BRANCHES.
ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)
INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT
ALL DOORS 1" MIN.
CONTRACTOR MUST WORK FROM APPROVED PLANS.
ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE
RESPONSIBILITY OF GTA DESIGNS.
GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST
FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR
WITH IN THE DWELLING.



**2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA**


HEAT-LOSS	30,355	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960403ANA	OR EQUAL.
UNIT HEATING INPUT	40,000	BTU/HR.
UNIT HEATING OUTPUT	38,400	BTU/HR.
A/C COOLING CAPACITY	1.5	TONS.
FAN SPEED	772	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	7	2	3
1ST FLOOR	4	1	2
BASEMENT	4	1	

FLOOR PLAN:	BASEMENT
DRAWN BY:	JL
CHECKED:	DD
LAYOUT NO:	JB-04868
SQFT	1894
DRAWING NO.	MI

DATE:	JUNE 14, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	TH-5 ALT WOB
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"

	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER				PRINCIPAL EXHAUST FAN SWITCH		W/R & PRINCIPAL EXHAUST FAN

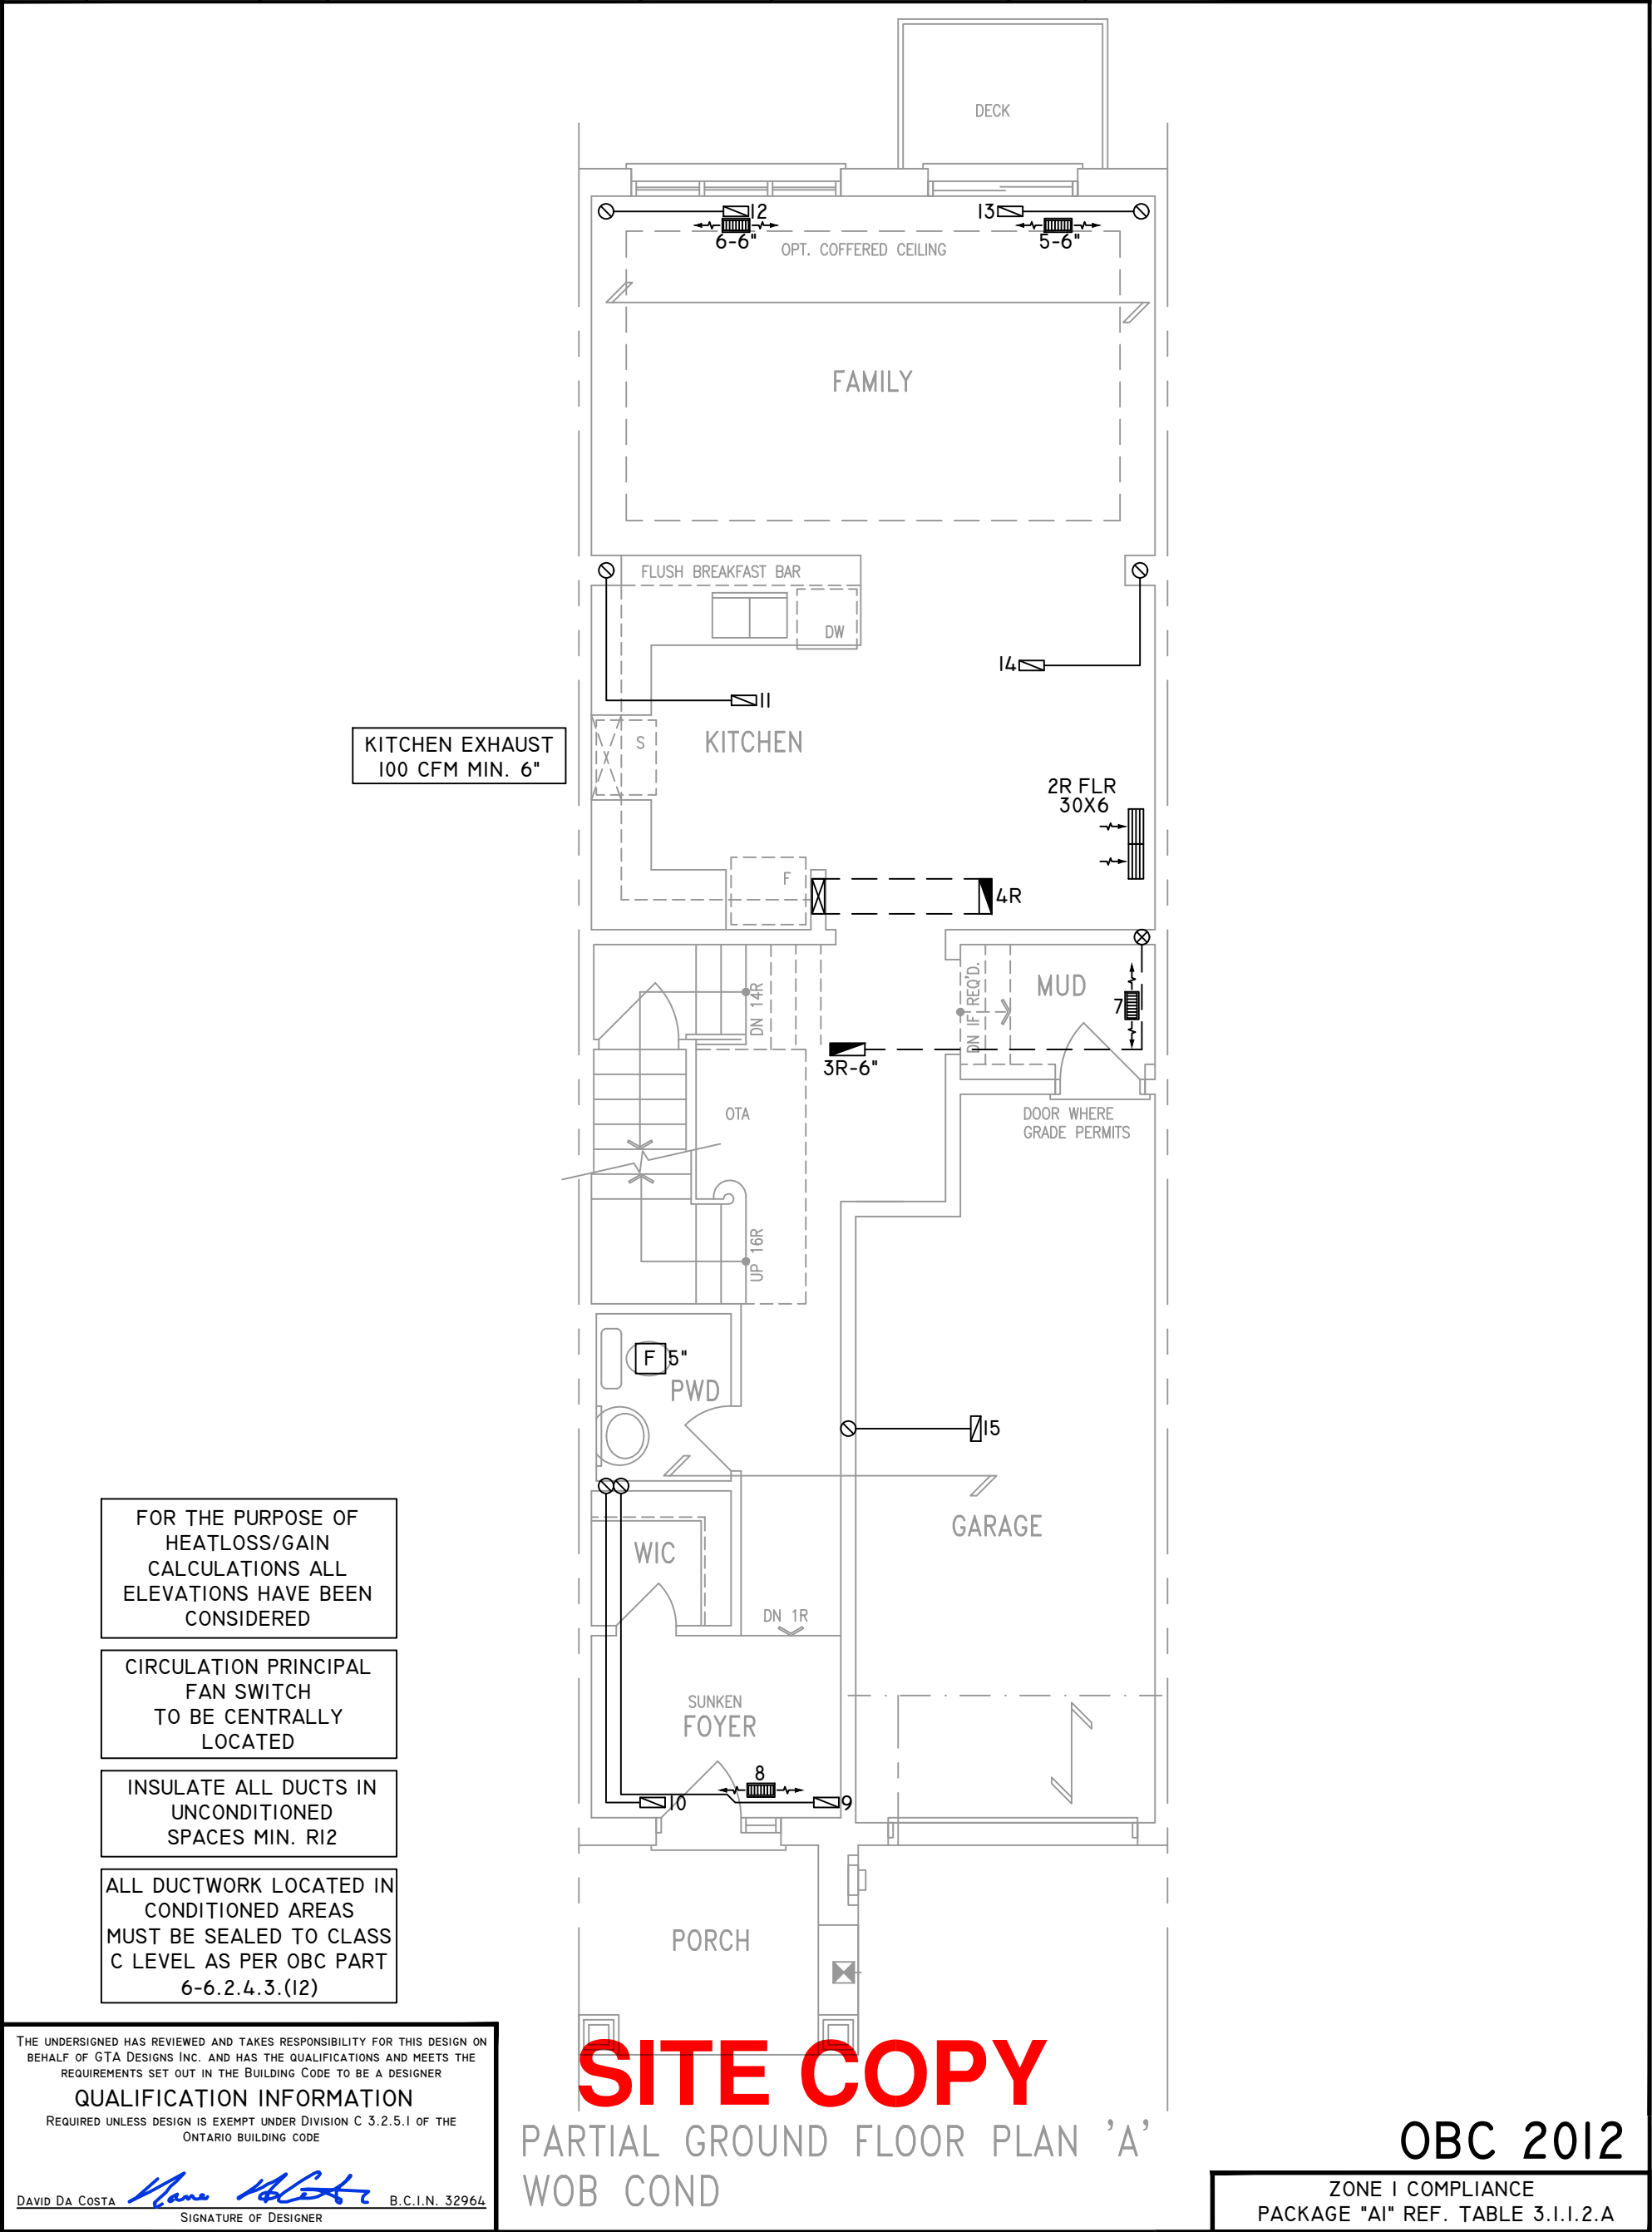

NOTES

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.

ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.

PROVIDE BALANCING DAMPERS ON ALL BRANCHES.

ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)

INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.

CONTRACTOR MUST WORK FROM APPROVED PLANS.

ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.

GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.




2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA


HEAT-LOSS	30,355	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960403ANA	OR EQUAL.
UNIT HEATING INPUT	40,000	BTU/HR.
UNIT HEATING OUTPUT	38,400	BTU/HR.
A/C COOLING CAPACITY	1.5	TONS.
FAN SPEED	772	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	7	2	3
1ST FLOOR	4	1	2
BASEMENT	4	1	

FLOOR PLAN: GROUND FLOOR		
DRAWN BY: JL	CHECKED: DD	SQFT 1894
LAYOUT NO. JB-04868	DRAWING NO. M2	

DATE:	JUNE 14, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	TH-5 ALT WOB
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"

	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER						PRINCIPAL EXHAUST FAN SWITCH W/R & PRINCIPAL EXHAUST FAN

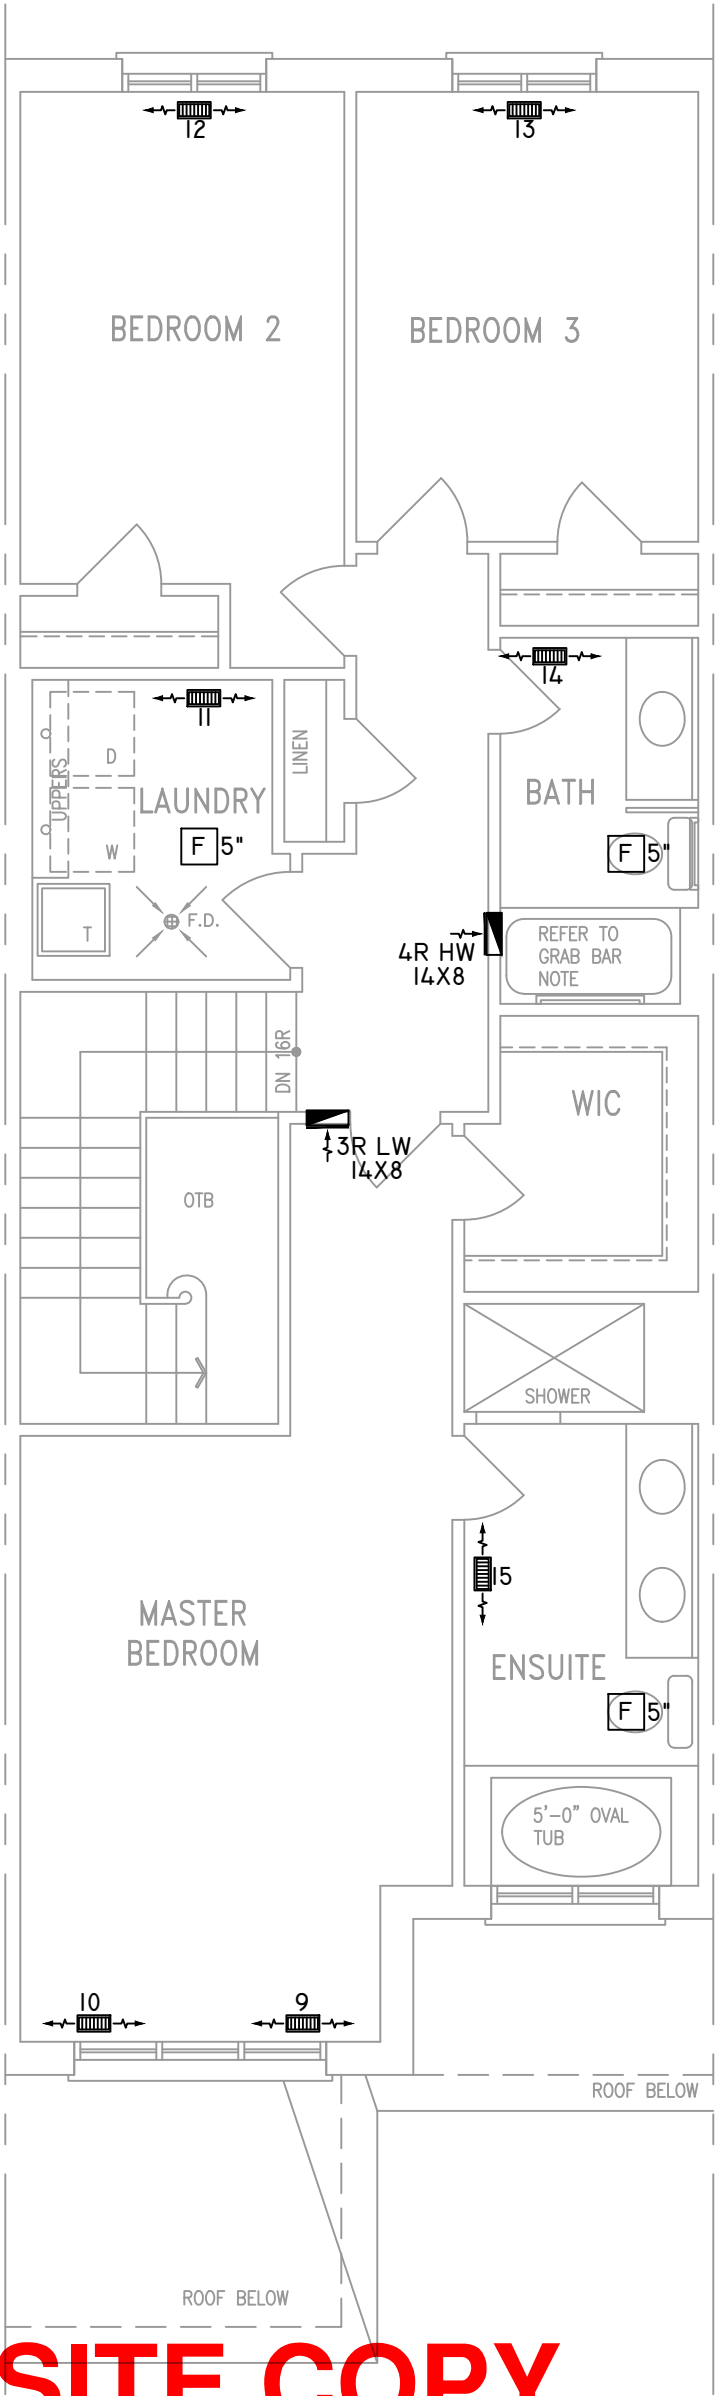

- FOR THE PURPOSE OF
HEATLOSS/GAIN
CALCULATIONS ALL
ELEVATIONS HAVE BEEN
CONSIDERED
- INSULATE ALL DUCTS IN
UNCONDITIONED
SPACES MIN. R12
- ALL DUCTWORK LOCATED IN
CONDITIONED AREAS
MUST BE SEALED TO CLASS
C LEVEL AS PER OBC PART
6-6.2.4.3.(12)

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER

QUALIFICATION INFORMATION

REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE ONTARIO BUILDING CODE

DAVID DA COSTA  B.C.I.N. 32964

SIGNATURE OF DESIGNER

SITE COPY

SECOND FLOOR PLAN 'A'

OBC 2012

ZONE I COMPLIANCE
PACKAGE "A1" REF. TABLE 3.1.1.2.A

NOTES

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.

ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.

PROVIDE BALANCING DAMPERS ON ALL BRANCHES.

ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)

INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.

CONTRACTOR MUST WORK FROM APPROVED PLANS.

ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.

GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.




2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA


HEAT-LOSS	30,355	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960403ANA	OR EQUAL.
UNIT HEATING INPUT	40,000	BTU/HR.
UNIT HEATING OUTPUT	38,400	BTU/HR.
A/C COOLING CAPACITY	1.5	TONS.
FAN SPEED	772	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	7	2	3
1ST FLOOR	4	1	2
BASEMENT	4	1	


FLOOR PLAN: SECOND FLOOR		
DRAWN BY: JL	CHECKED: DD	SQFT 1894
LAYOUT NO. JB-04868	DRAWING NO. M3	

DATE:	JUNE 14, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	TH-5 ALT WOB
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"


	FLEX DUCT		LOW/HIGH WALL/KICK SUPPLY DIFFUSER		DUCT CONNECTION TO JOIST LINING		RETURN AIR GRILLE (SIZE INDICATED ON DRAWING)	S.A.	SUPPLY AIR
	RIGID ROUND DUCT		HRV EXHAUST GRILLE		RETURN AIR PIPE RISER		RETURN AIR RISER UP TO FLOOR ABOVE	R.A.	RETURN AIR
	SUPPLY DIFFUSER		SUPPLY AIR PIPE RISER		RETURN ROUND DUCT		RETURN AIR FROM BASEMENT SECOND FLOOR		THERMOSTAT
			VOLUME DAMPER						PRINCIPAL EXHAUST FAN SWITCH
									W/R & PRINCIPAL EXHAUST FAN

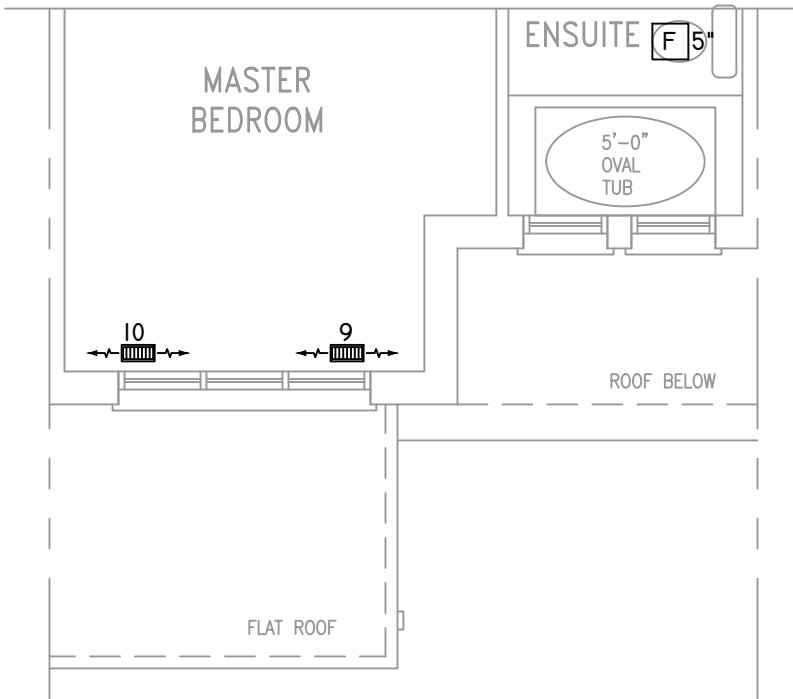

PARTIAL SECOND FLOOR PLAN 'B'

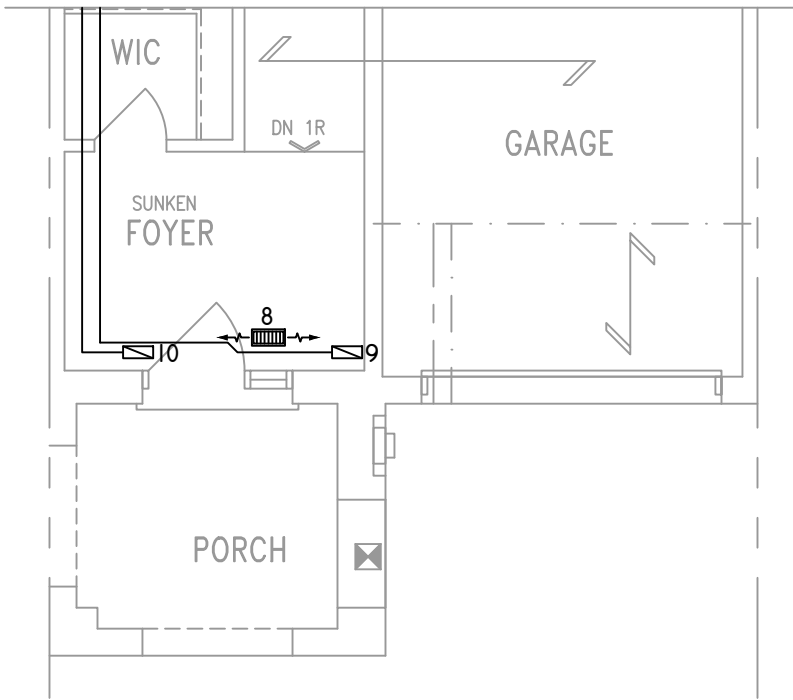

PARTIAL GROUND FLOOR PLAN 'B'

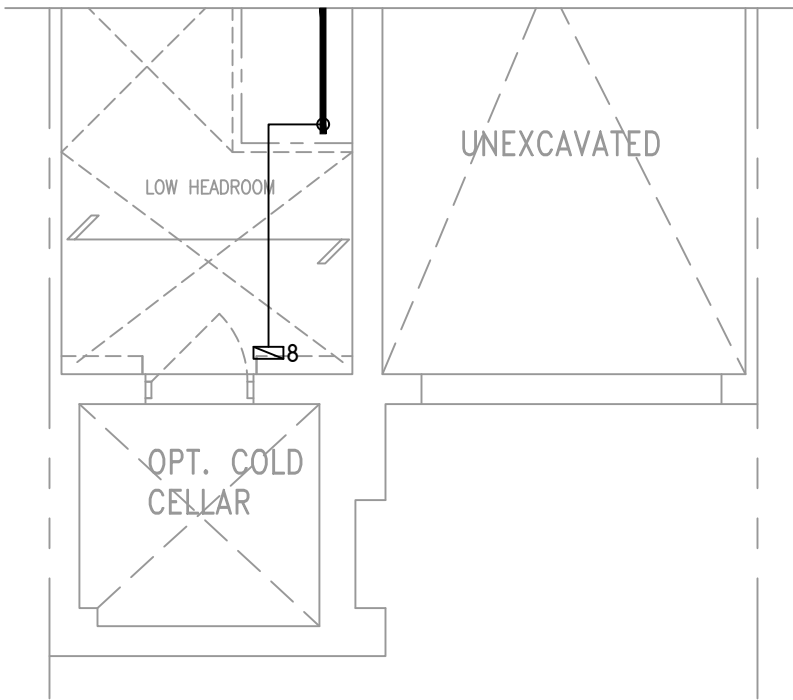

PARTIAL BASEMENT PLAN 'B'

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN ON BEHALF OF GTA DESIGNS INC. AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE BUILDING CODE TO BE A DESIGNER

QUALIFICATION INFORMATION

REQUIRED UNLESS DESIGN IS EXEMPT UNDER DIVISION C 3.2.5.1 OF THE ONTARIO BUILDING CODE

DAVID DA COSTA  B.C.I.N. 32964

SIGNATURE OF DESIGNER

SITE COPY

OBC 2012

ZONE I COMPLIANCE
PACKAGE "A1" REF. TABLE 3.1.1.2.A

NOTES
INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE.
ALL SUPPLY OUTLETS TO BE 5" DIA. UNLESS OTHERWISE SPECIFIED.
PROVIDE BALANCING DAMPERS ON ALL BRANCHES.
ALL R/A PARTITIONS 6" (FIRST FLOOR ONLY)
INSULATE DUCTS IN UNCONDITIONED SPACES R12 UNDERCUT ALL DOORS 1" MIN.
CONTRACTOR MUST WORK FROM APPROVED PLANS.
ANY ALTERATIONS TO THIS ORIGINAL PLAN ARE NOT THE RESPONSIBILITY OF GTA DESIGNS.
GTA DESIGNS MUST BE CONSULTED IF KITCHEN EXHAUST FAN EXCEEDS 700 CFM DEPRESSURIZATION MAY OCCUR WITH IN THE DWELLING.

**GTADESIGNS**

2985 DREW ROAD
SUITE 202,
MISSISSAUGA, ONT.
L4T 0A4 TEL: 905-671-9800
EMAIL: DAVE@GTADESIGNS.CA
WEB: WWW.GTADESIGNS.CA

HEAT-LOSS	30,355	BTU/HR.
UNIT MAKE	AMANA	OR EQUAL.
UNIT MODEL	AMEC960403ANA	OR EQUAL.
UNIT HEATING INPUT	40,000	BTU/HR.
UNIT HEATING OUTPUT	38,400	BTU/HR.
A/C COOLING CAPACITY	1.5	TONS.
FAN SPEED	772	CFM

# OF RUNS	S/A	R/A	FANS
3RD FLOOR			
2ND FLOOR	7	2	3
1ST FLOOR	4	1	2
BASEMENT	4	1	

FLOOR PLAN: PARTIAL PLAN(S)	
DRAWN BY: JL	CHECKED: DD
LAYOUT NO. JB-04868	SQFT 1894
DRAWING NO. M4	

DATE:	JUNE 14, 2018
CLIENT:	BAYVIEW WELLINGTON
MODEL:	TH-5 ALT WOB
PROJECT:	GREEN VALLEY EAST BRADFORD,ONT.
SCALE:	3/16" = 1'-0"