

FRONT ELEVATION 'A'

OBC 2012


DRAWING LIST:

37-7 (THE NEWCASTLE)
ELEVATION 'A'

- T1 TITLE SHEET
- A1 BASEMENT FLOOR ELEV. 'A'
- A2 PARTIAL BASEMENT FLOOR ELEV. 'A'
- A3 W/ SUNKEN MUD ROOM CONDITION
- A4 GROUND FLOOR ELEV. 'A'
- A5 SECOND FLOOR ELEV. 'A'
- A6 FRONT ELEVATION 'A'
- A7 RIGHT SIDE ELEVATION 'A'
- A8 REAR ELEVATION 'A'
- A9 LEFT SIDE ELEVATION 'A'
- A10 PARTIAL FLOOR PLANS ELEV. 'A'
- A11 WALK-OUT BASEMENT CONDITION
- A12 REAR ELEVATION 'A'
- D1 WALK-OUT BASEMENT CONDITION
- D2 CONSTRUCTION SHEET
- D3 CONSTRUCTION SHEET
- D4 TYPICAL SECTIONS

GROSS GLAZING AREA 'A'			
TOTAL PERIPHERAL WALL AREA	3045.14 SF	282.89 m²	
FRONT GLAZING AREA	68.02 SF	6.32 m²	
LEFT SIDE GLAZING AREA	29 SF	2.69 m²	
RIGHT SIDE GLAZING AREA	62.86 SF	5.84 m²	
REAR GLAZING AREA	130.91 SF	12.16 m²	
TOTAL GLAZING AREA	290.79 SF	27.01 m²	
TOTAL GLAZING PERCENTAGE	9.55 %		

ESQUIRE HOMES
NORTHGLEN - PH. 2
CLARINGTON, ONTARIO



RN design
Imagine • Inspire • Create

8395 JANE STREET
SUITE 203
VAUGHAN, ON
TEL: 905-738-3177
FAX: 905-738-5449

CONTACT PERSON: NELSON CUNHA

No.	REVISION COMMENTS:	DATE	DWN	CHK	No.	REVISION COMMENTS:	DATE	DWN	CHK	SCALE
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC						AS NOTED
										PROJECT No. 14093
										T1

THESE DRAWINGS ARE NOT TO BE SCALED


ALL DIMENSIONS MUST BE TAKEN FROM THE DRAWING PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.

REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, NELSON CUNHA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE PREPARED DRAWINGS. I AM A REGISTERED PROFESSIONAL ARCHITECT UNDER DIVISION C, PART 1, SUBSECTION 22 OF THE BUILDING ACT, 1997. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CATEGORIES.


QUALIFIED DESIGNER BCIN: 21032 | SIGNATURE:
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLAIRINGTON.

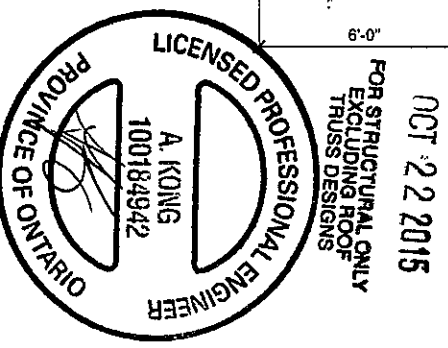


NOTE:
SPACE ALL FLOOR JOISTS @ 12" O.C.
UNDER ALL CERAMIC TILES AREA

**CHECK FOUNDATION WALL
FOR PORCH SLAB ABOVE**


 FIN design <i>Imagine • Inspire • Create</i> TEL (905) 738-5448 FAX (905) 738-5449	MODEL 37-7 (NEWCASTLE) - ELEVATION 'A'		No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE 3/16" = 1'0"
	CLIENT ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO		1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	--	NC	PROJECT NUMBER 14093
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE NOTED DIRECTLY TO FIN DESIGN LTD. REVISED: JANUARY 08, 2015 - FIN 5/14/15 IN ACCORDANCE TO SP-12 COMPLIANCE PACKAGE J								
1. NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF FIN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASS/SECTION/CATEGORIES.								
QUALIFIED DESIGNER BCIN: 21032		SIGNATURE:						
FIRM BCIN: 25995								
DATE: OCTOBER 19, 2015								
PAGE A1								

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for any errors or omissions in any drawings or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

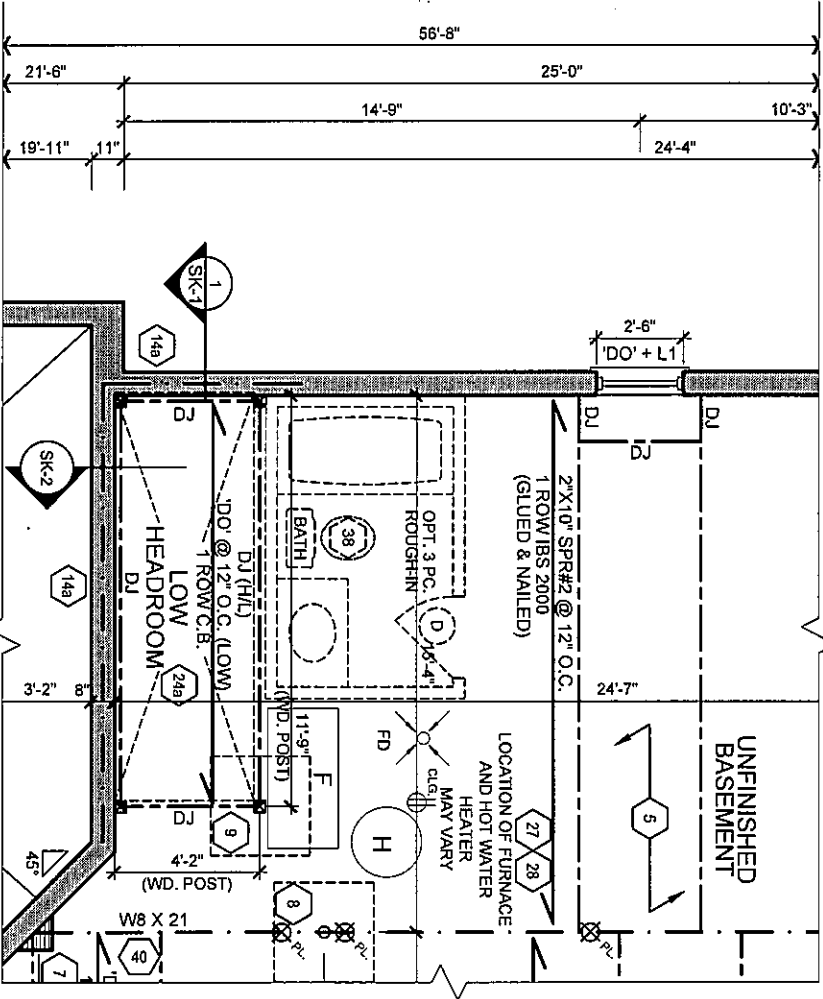


OCT 22 2015

FOR STRUCTURAL ONLY
EXCLUDING ROOF
TRUSS DESIGNS

 RN design <i>Imagine • Inspire • Create</i> TEL: (905) 736-3177 FAX: (905) 736-5449	MODEL 37-7 (NEWCASTLE) - ELEVATION 'A'	No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
	CLIENT ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO	1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	3/16" = 1'0"
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO 98-12 COMPLIANCE PACKAGE J	I, THE SIGNATURE, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE WORK SHOWN ON THESE DRAWINGS. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.	QUALIFIED DESIGNER BCIN: 21032			SIGNATURE:		PAGE A2
		FIRM BCIN: 26935			DATE: OCTOBER 19, 2015		
		PROJECT NUMBER 14093					

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

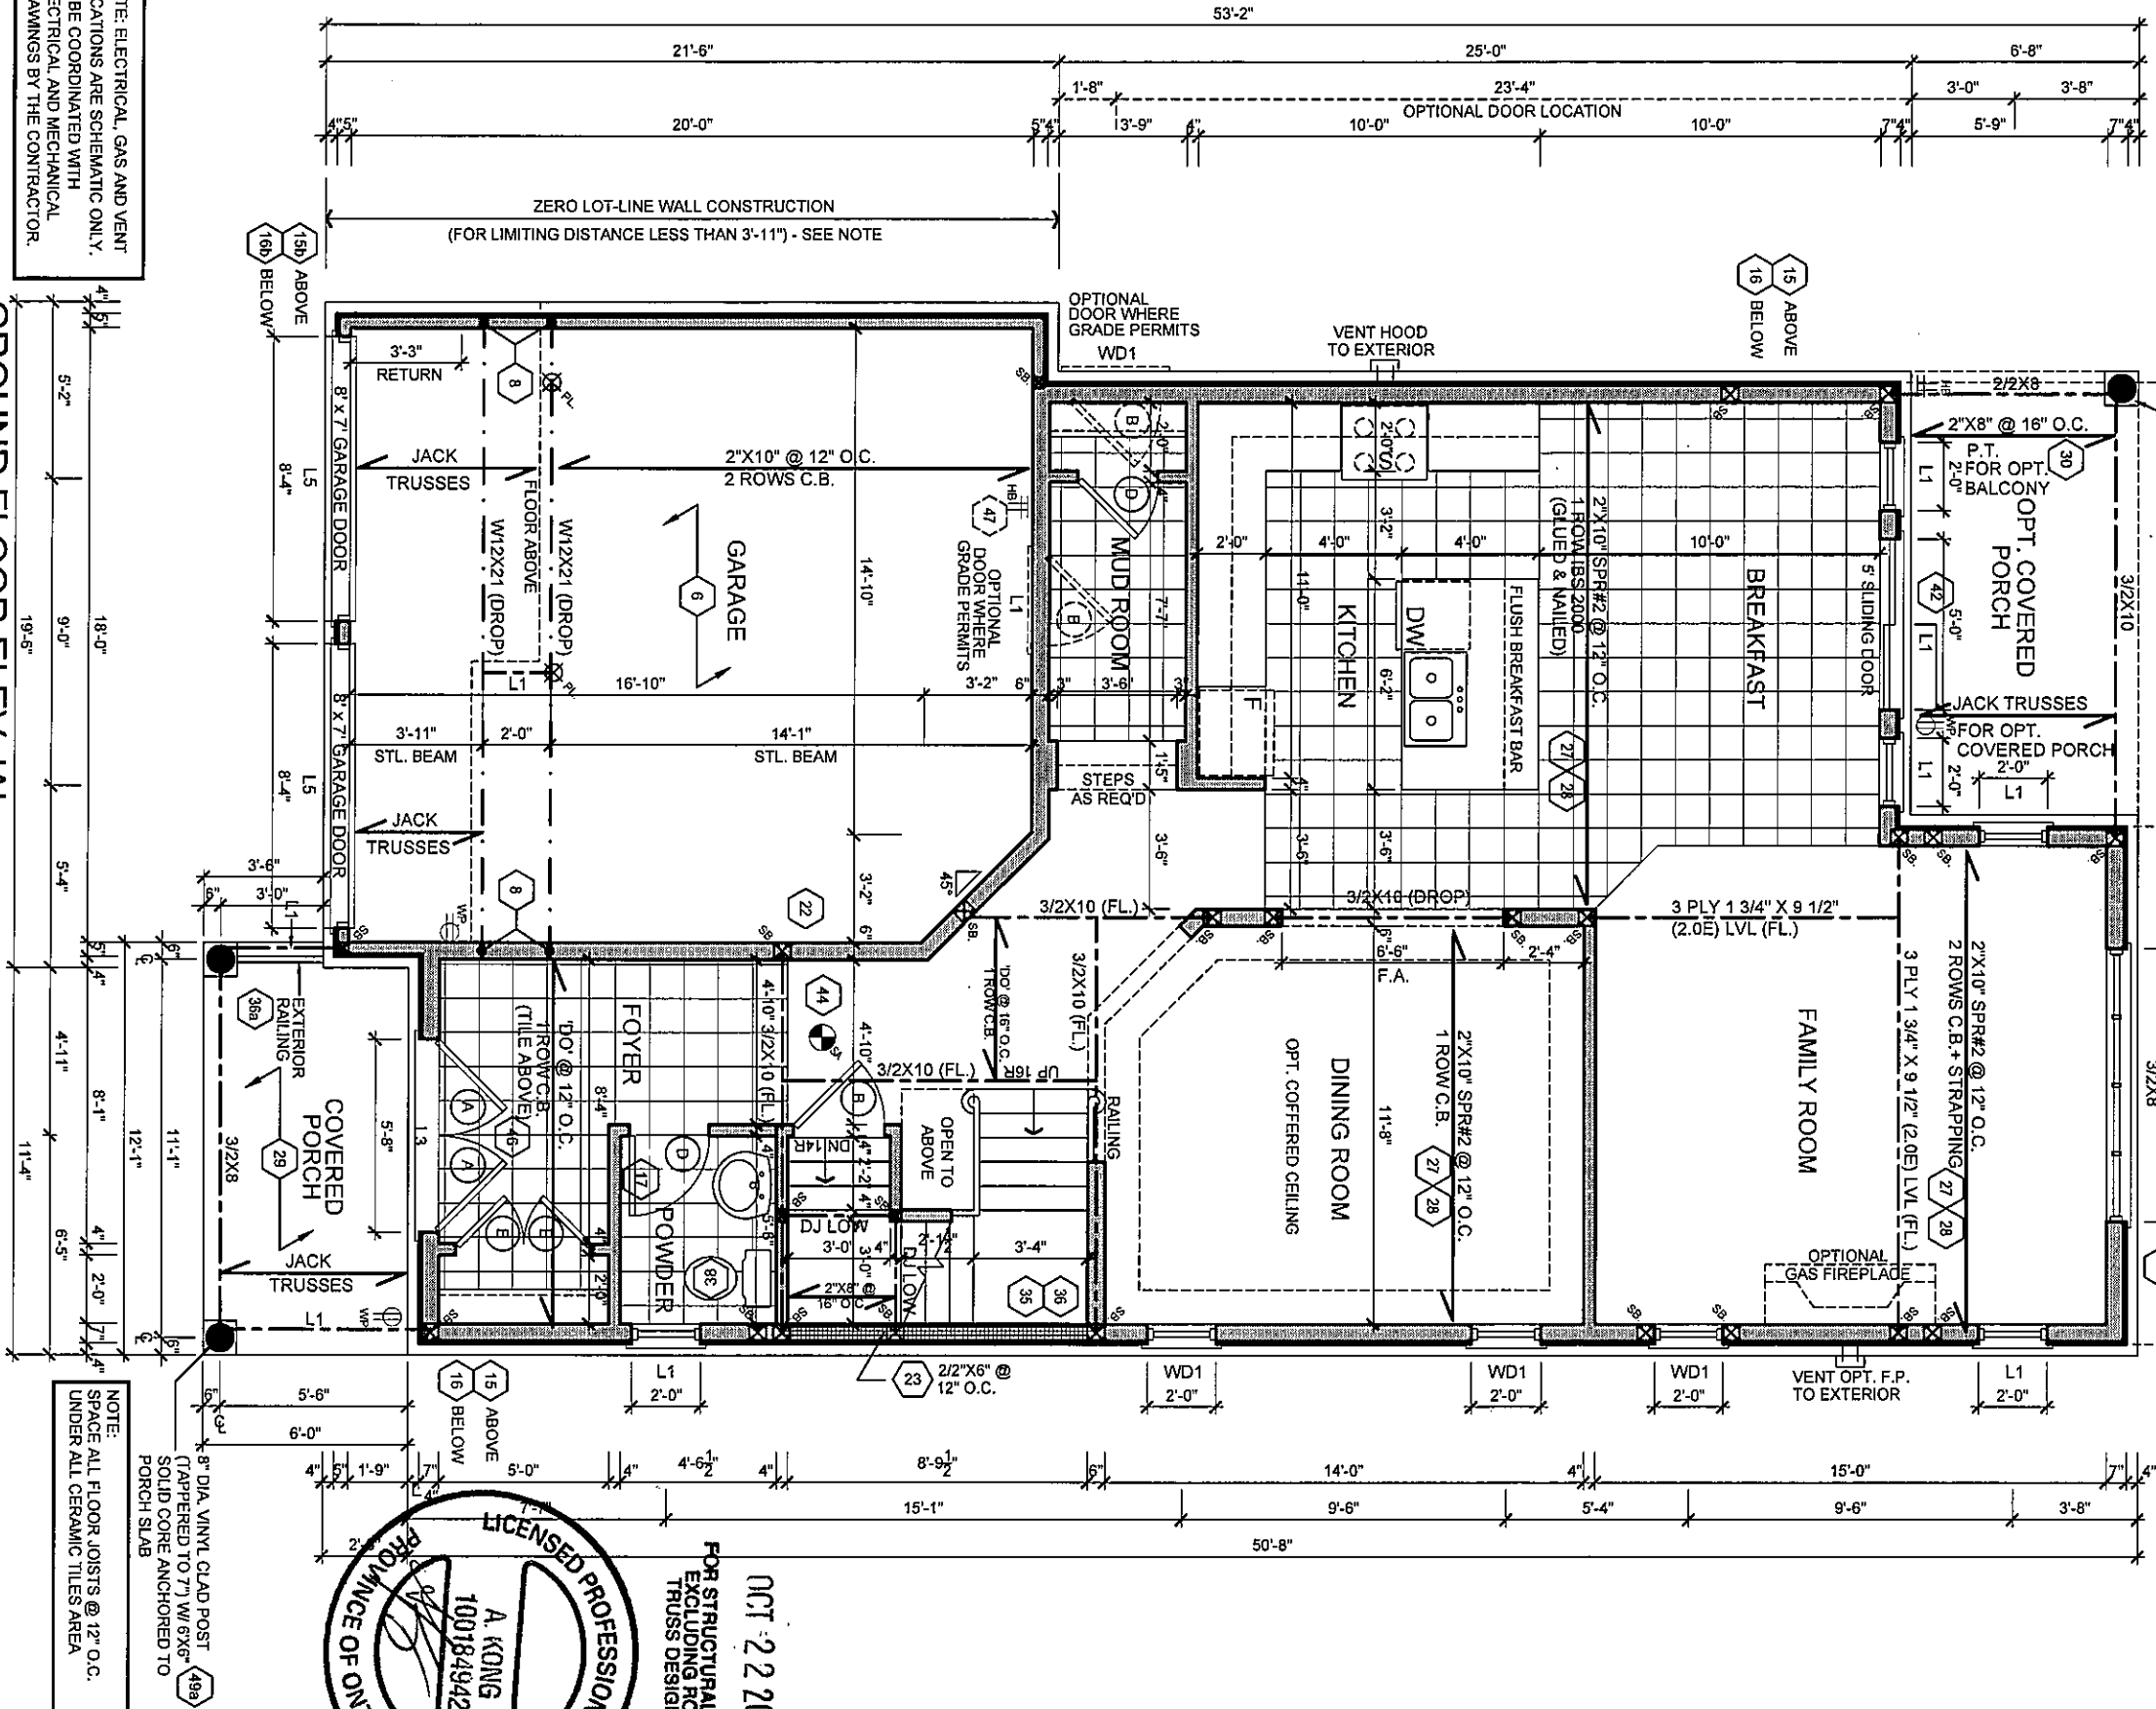

MODEL 37-7 (NEWCASTLE) - ELEVATION 'A'

CLIENT

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

No. ISSUED OR REVISION COMMENTS
1. UPDATED TO OBC 2012 - 2015 ENACTMENT

DATE DWN CHK
OCT. 19/15 - NC

SCALE 3/16" = 1'0"
PROJECT NUMBER 14093

FN design

Imagine - Inspire - Create
TEL: (905) 738-3177
FAX: (905) 738-5449


THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO FN DESIGN LTD.
REVISED: JANUARY 08, 2015 - FN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, THE DESIGNER, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ACCURACY OF THESE DRAWINGS. I AM A QUALIFIED PROFESSIONAL ENGINEER UNDER DIVISION C, PART 3, SUBSECTION 2.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CATEGORY.

QUALIFIED DESIGNER BCIN: 21032 SIGNATURE:
FIRM BCIN: 26935
DATE: OCTOBER 19, 2015



A3

PAGE

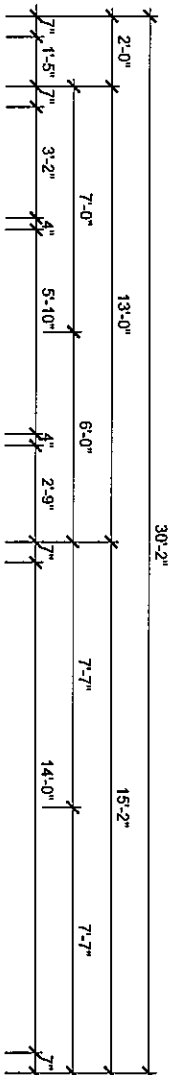


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements in the subdivision agreement. The Council Architect is not responsible in any way for examining or approving site (plotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

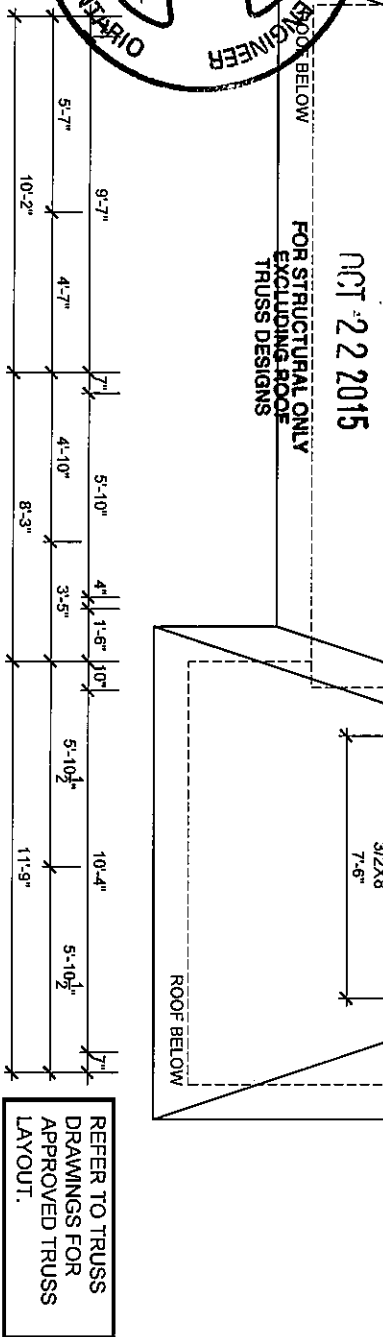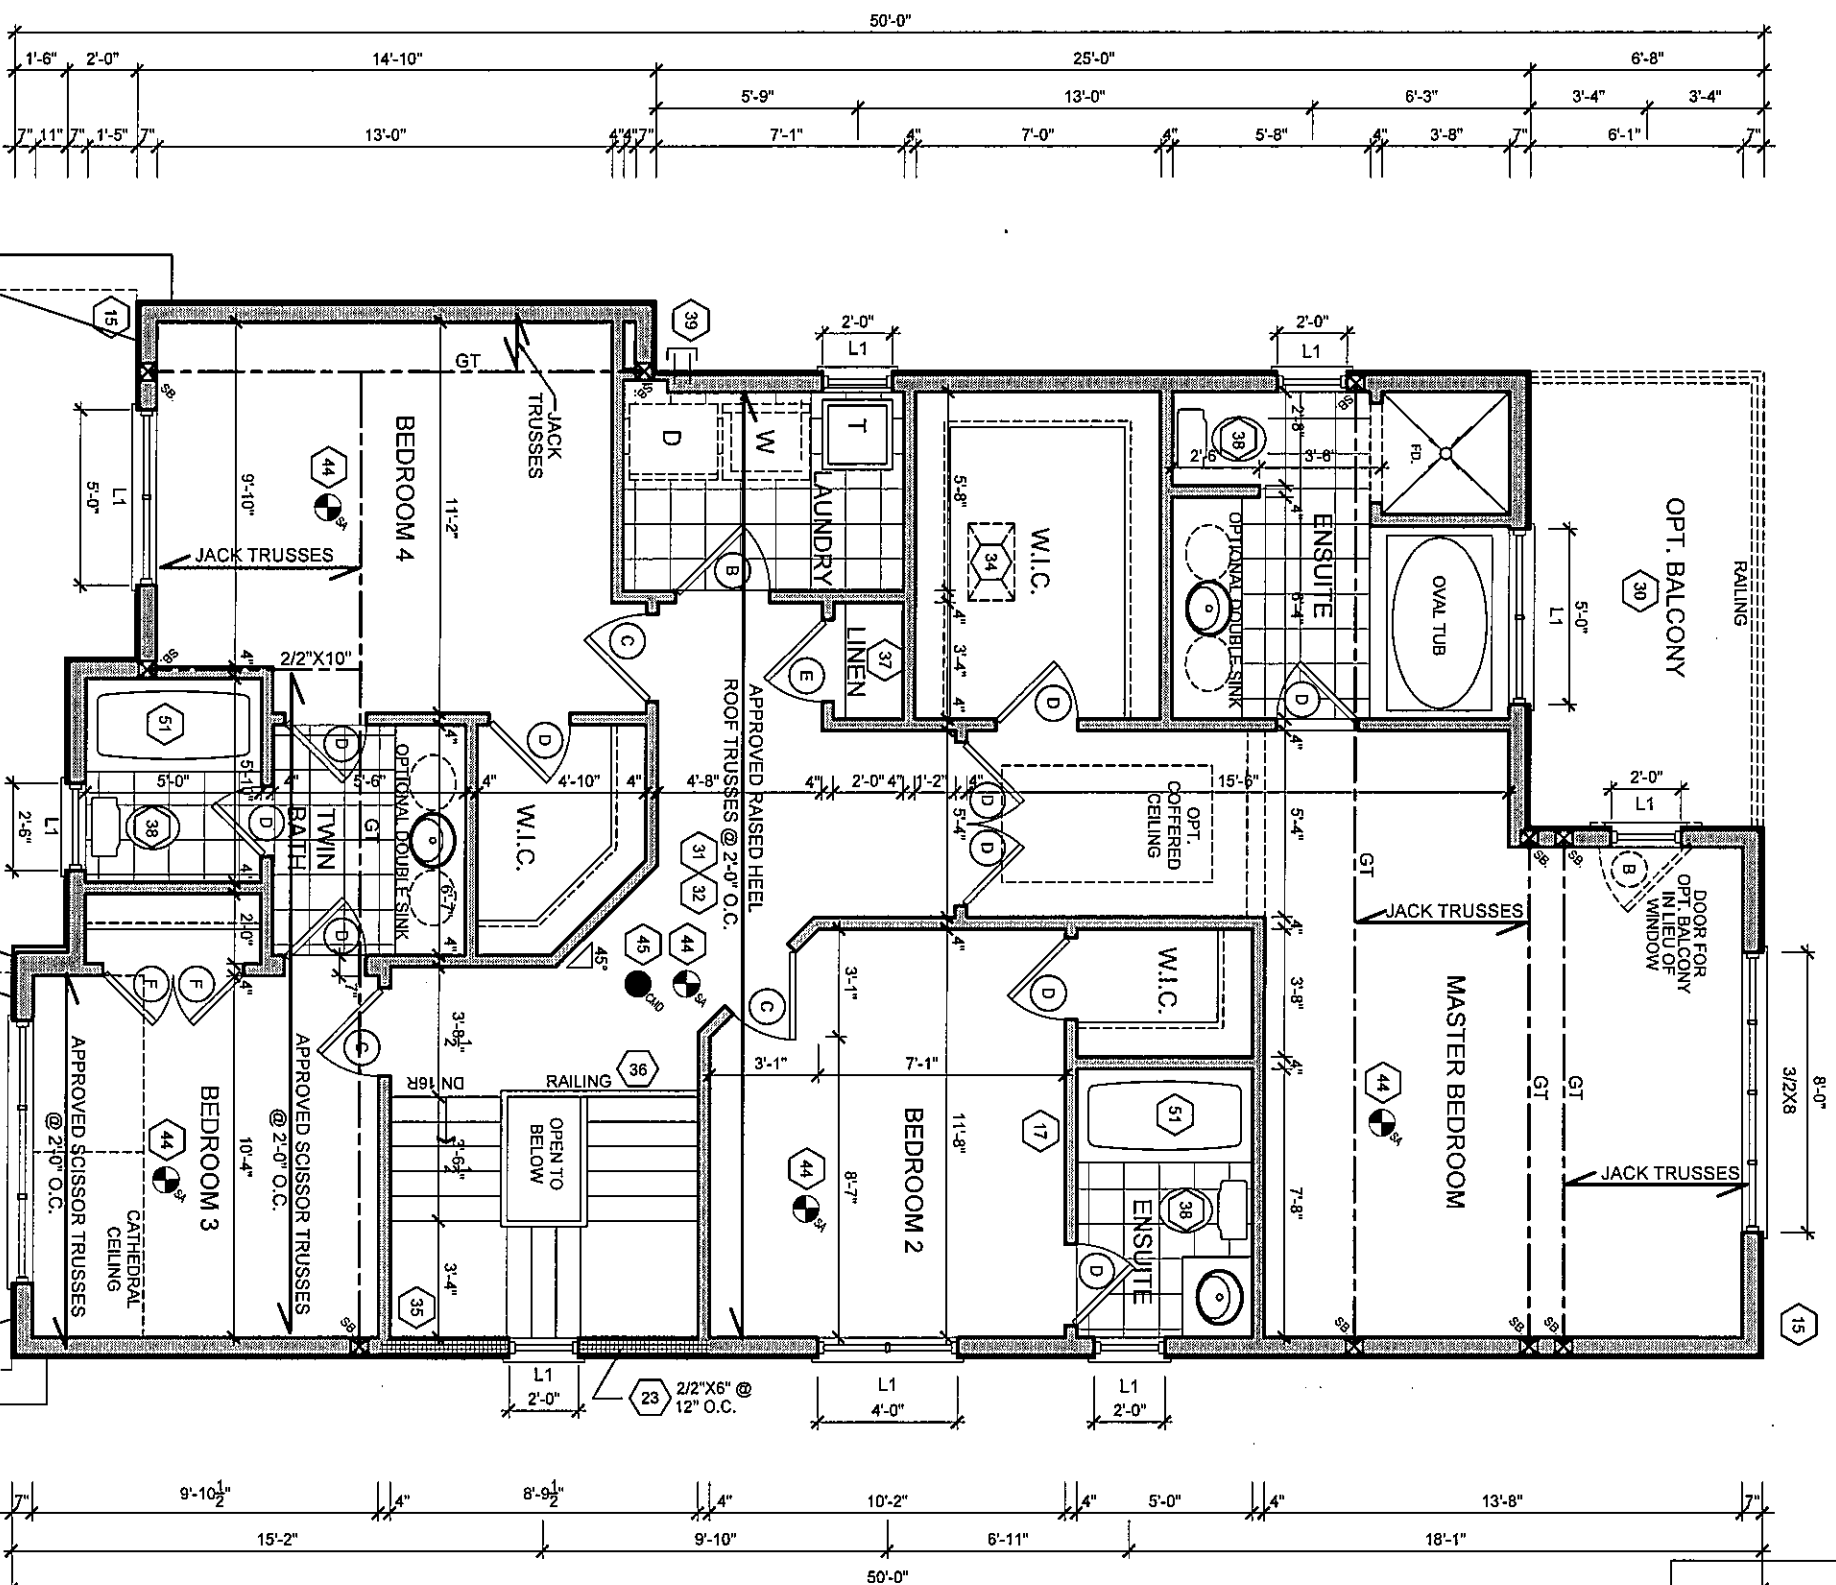


SECOND FLOOR ELEV. 'A'

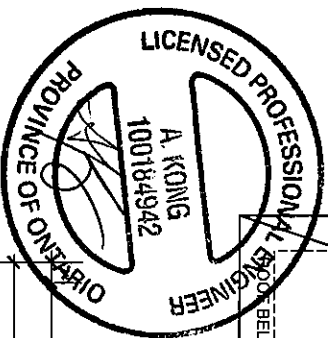

NCT 22 2015
FOR STRUCTURAL ONLY
EXCLUDING ROOF
TRUSS DESIGNS

REFER TO TRUSS
DRAWINGS FOR
APPROVED TRUSS
LAYOUT.



MODEL

37-7 (NEWCASTLE) - ELEVATION 'A'

CLIENT

ESQUIRE HOMES
NORTHCLEN - PHASE 2
CLARINGTON, ONTARIO

NO. ISSUED OR REVISION COMMENTS

DATE

DWN

CHK

1.

UPDATED TO OBC 2012 - 2015 ENACTMENT

OCT. 19/15

-

NC

SCALE

3/16" = 1'0"

PROJECT NUMBER

14093


PAGE

A4


THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J
CLASSIFICATION: RESIDENTIAL


1. I, A. KONG, DESIGNER, HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE SUBMISSION OF THESE PLANS TO THE BUILDING DEPARTMENT OF THE MUNICIPALITY OF CLARINGTON. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION: RESIDENTIAL.



QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 28935
DATE: OCTOBER 19, 2015
SIGNATURE:

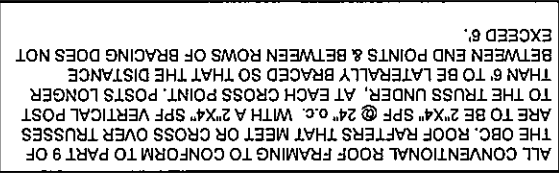

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC, ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER, AT EACH CROSS POINT, POSTS LONGER THAN 6' TO BE LATRALLY BRACED SO THAT THE DISTANCE BETWEEN END POINTS & BETWEEN ROWS OF BRACING DOES NOT EXCEED 8'.

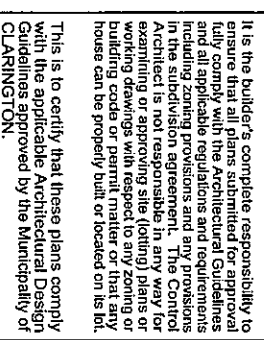

 RN design <i>Imagine • Inspire • Create</i> TEL.(905)738-3177 FAX.(905)738-5449	MODEL 37-7 (NEWCASTLE) - ELEVATION 'A'		No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE 3/16" = 1'0"
	CLIENT ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO	1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	--	NC	PROJECT NUMBER 14093	
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION. UNLESS OTHERWISE NOTED, DIMENSIONS MUST BE REPORTED DIRECTLY TO RN DESIGN. REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO 98-42 COMPLIANCE PACKAGE 1								
1. NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 32.4, OF THE BUILDING CODE. I AM A REGISTERED PROFESSIONAL ENGINEER, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.								
QUALIFIED DESIGNER BCIN: 21032				SIGNATURE:				
FIRM BCIN: 26995								
DATE:								
PAGE A5								

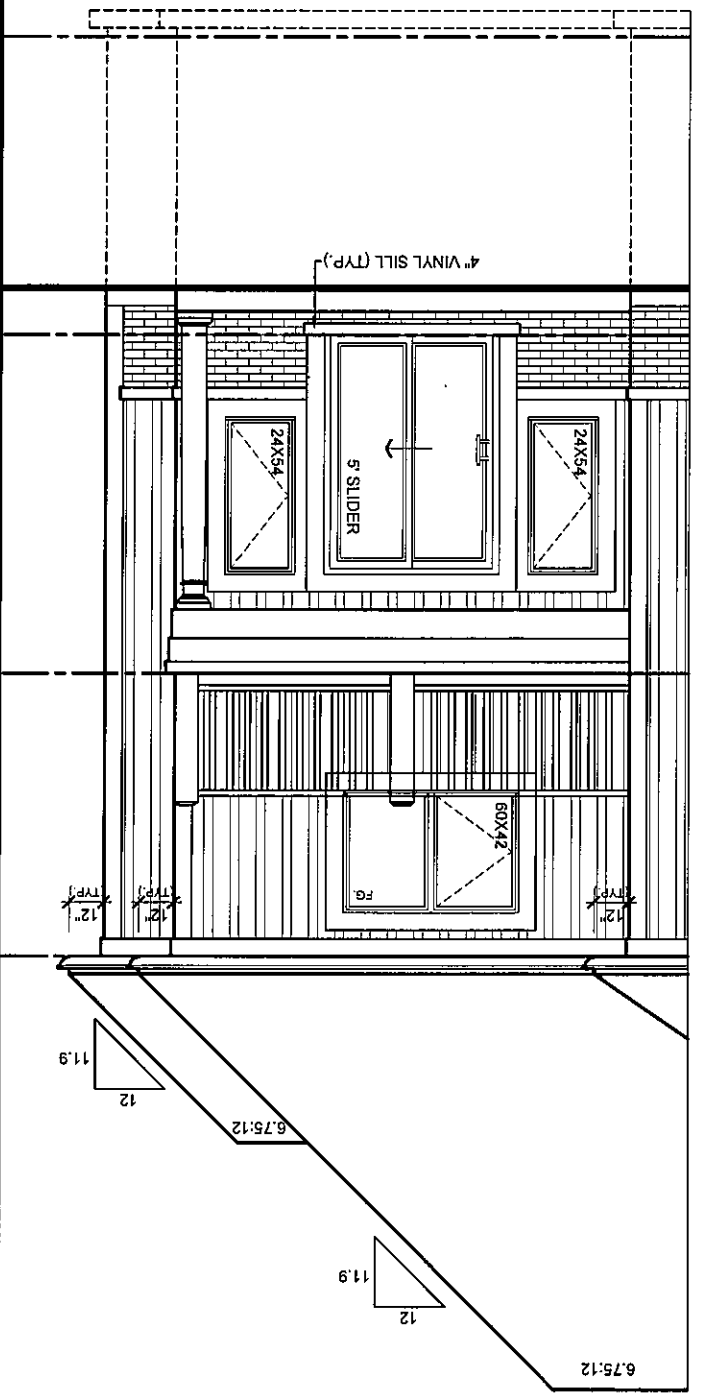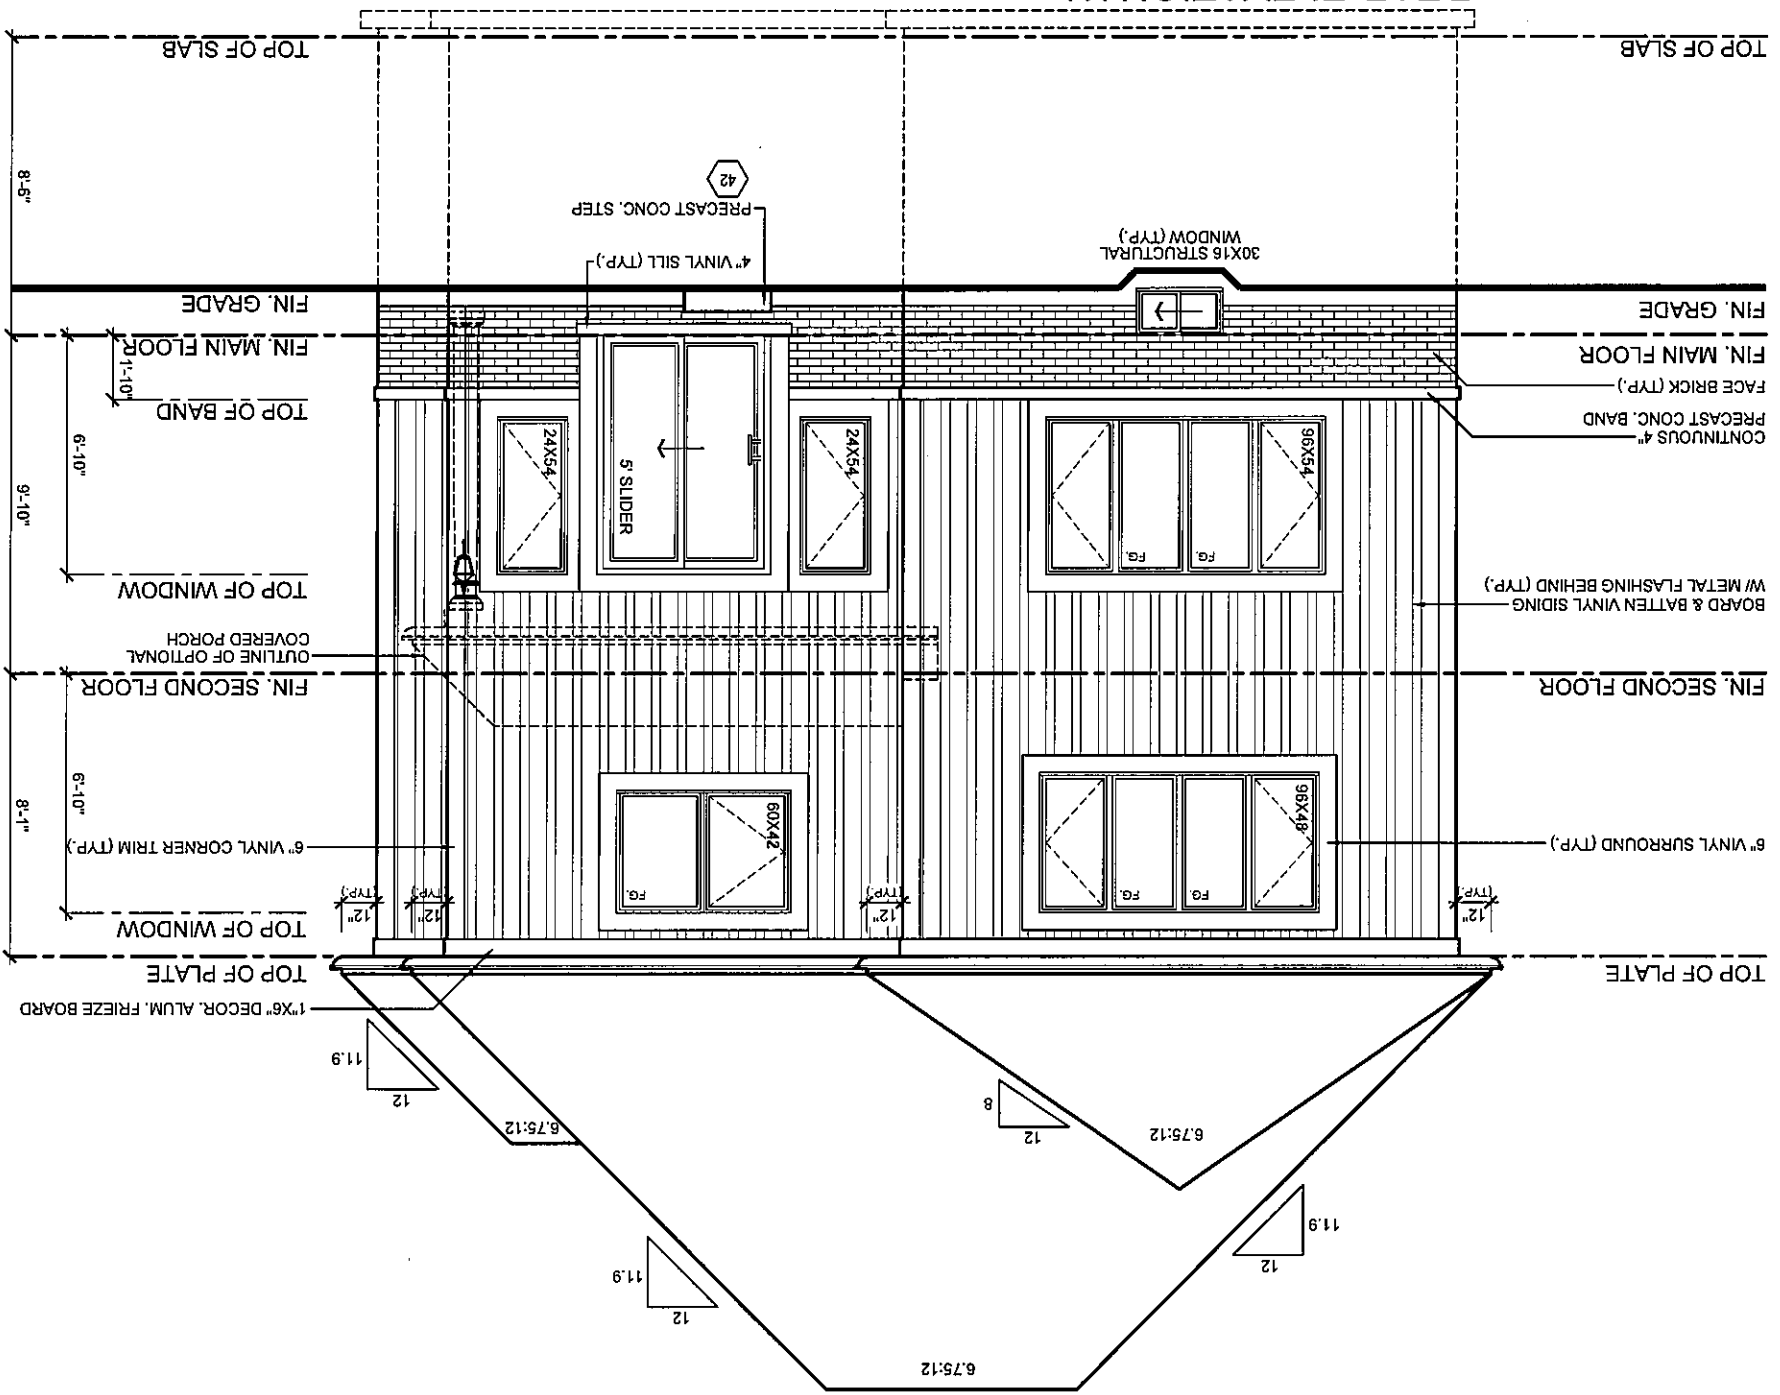

PARTIAL REAR ELEVATION
W/ OPT. PORCH & BALCONY



RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5448

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

MODEL: **37-7 (NEWCASTLE) - ELEVATION 'A'**

CLIENT:

No.	ISSUED OR REVISION COMMENTS
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT

DATE	DWN	CHK
OCT. 19/15	-	NC

SCALE: **3/16" = 1'0"**
PROJECT NUMBER: **14093**


QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015
SIGNATURE:

A7

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J


I, THE DESIGNER, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ACCURACY OF THE INFORMATION PROVIDED HEREIN.
I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES/CATEGORIES.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

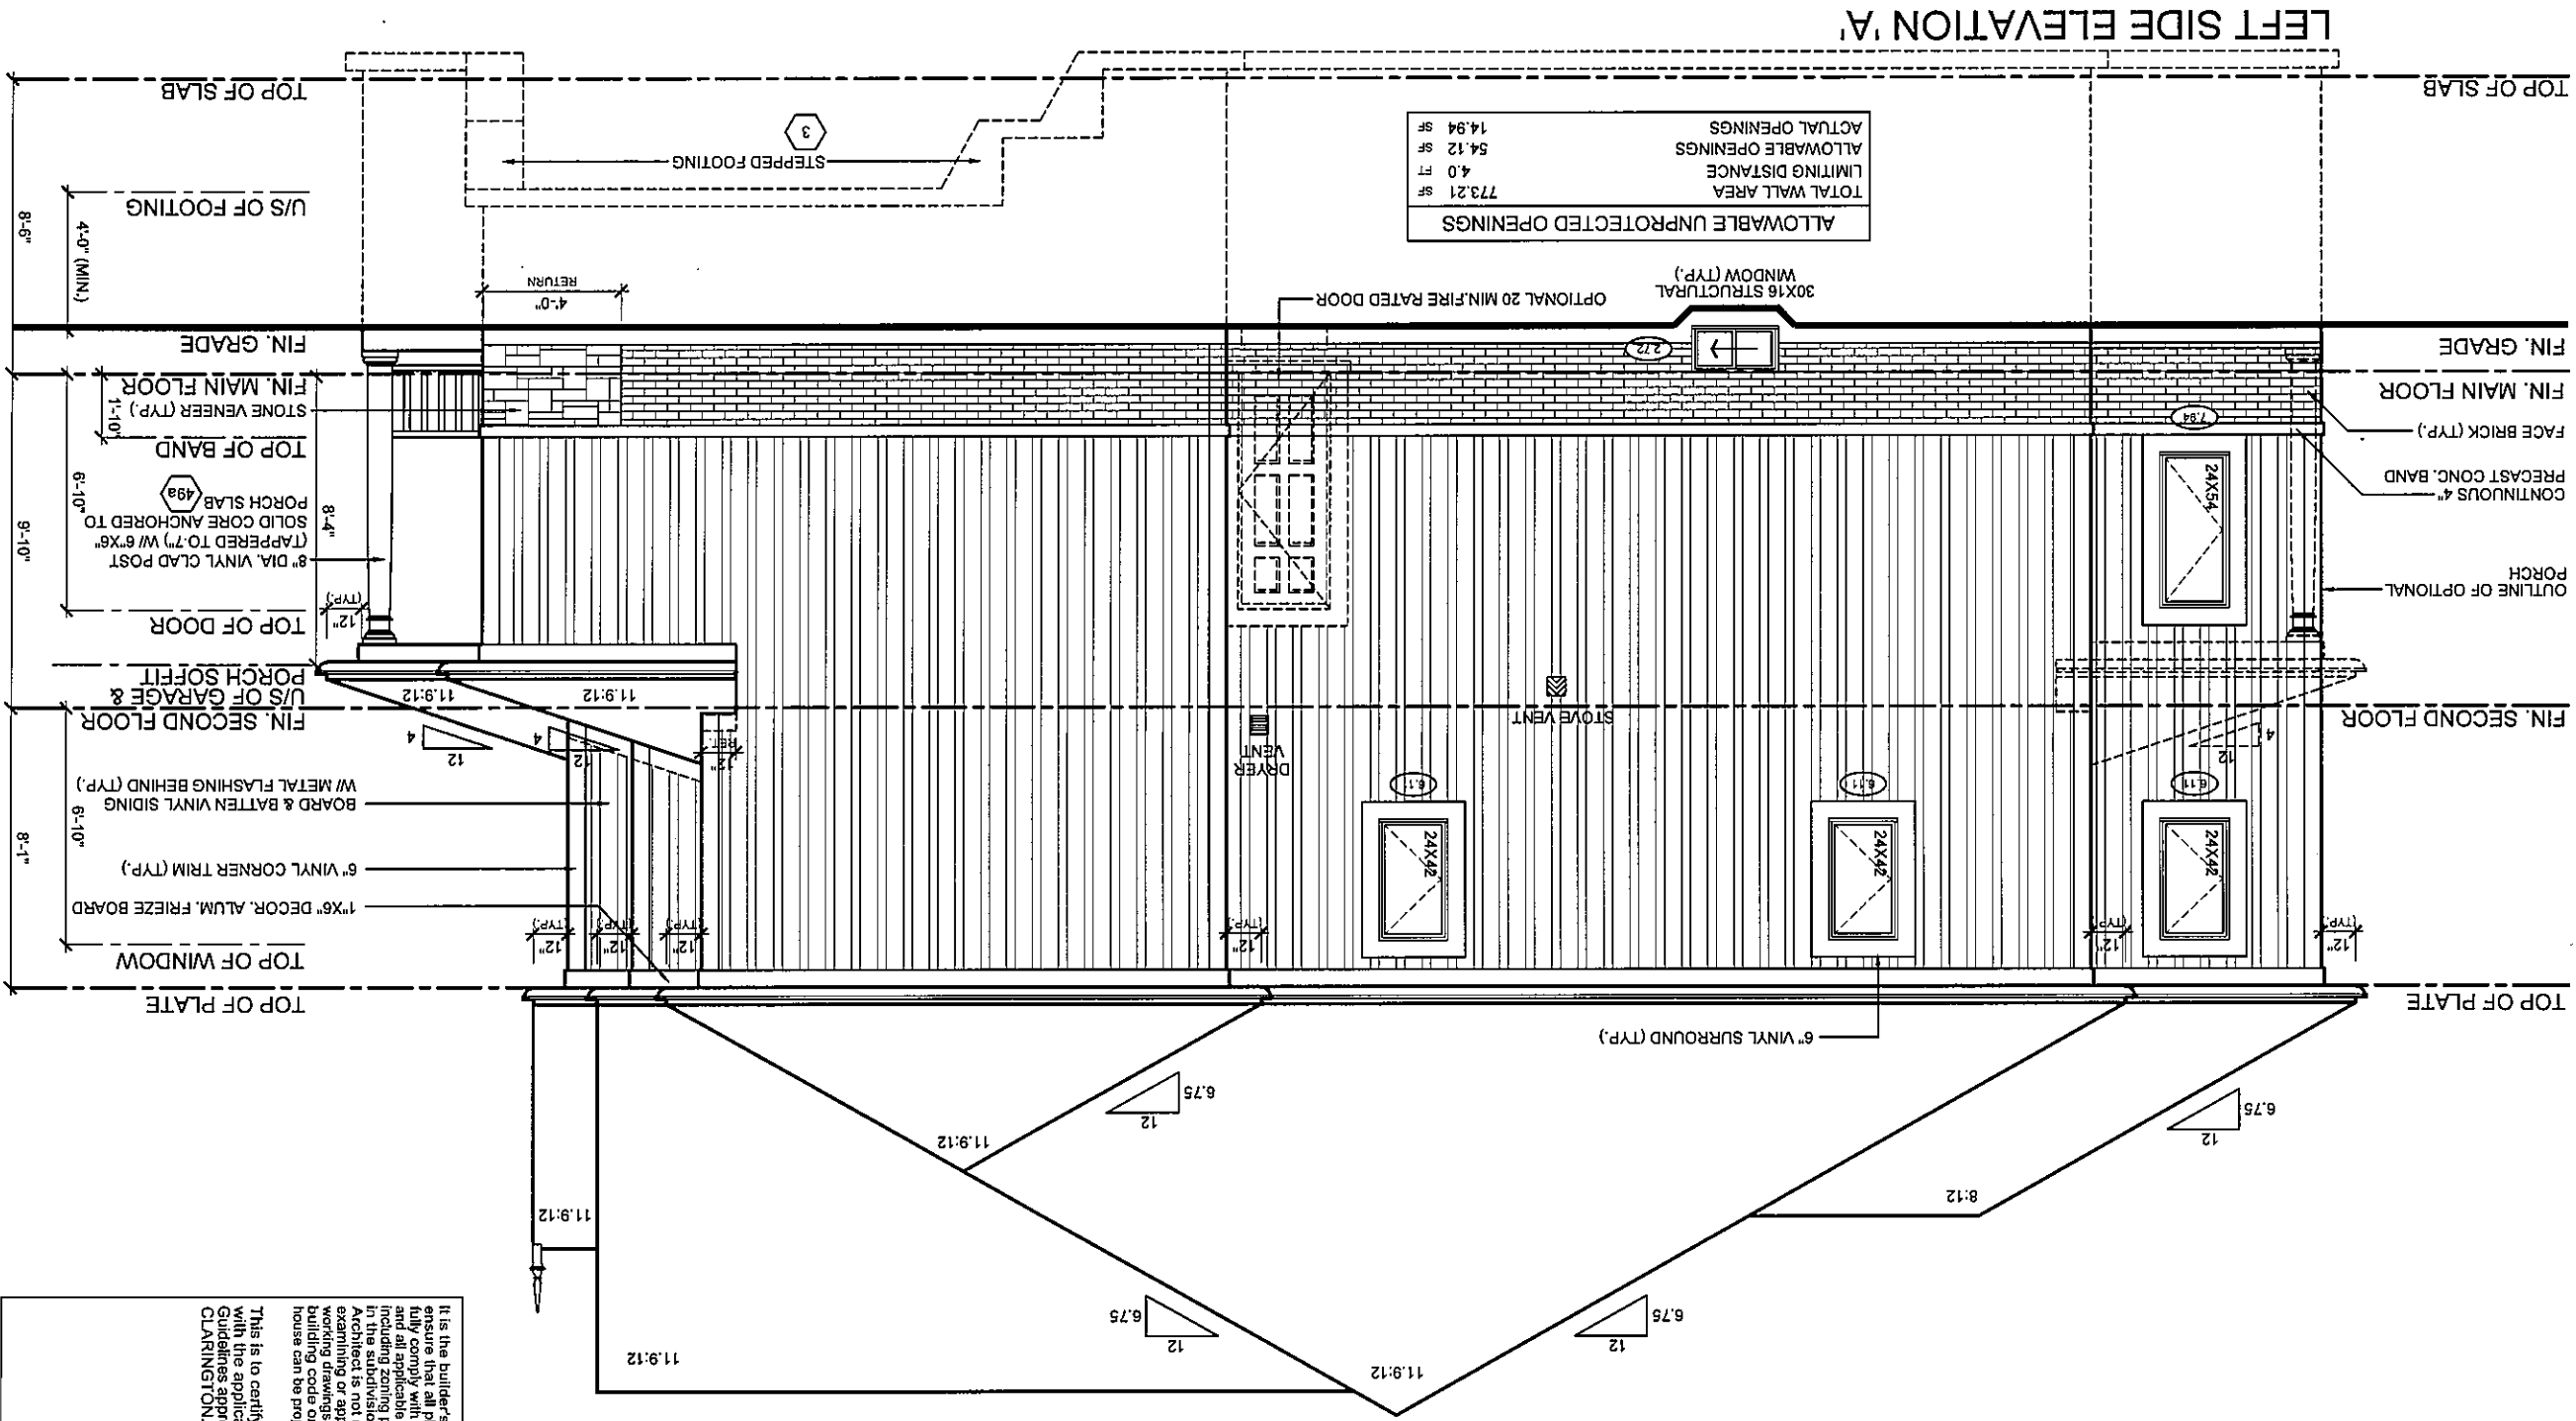

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

MODEL	37-7 (NEWCASTLE) - ELEVATION 'A'					
CLIENT						
	NO.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
	1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	--	NC	3/16" = 1'0"
						PROJECT NUMBER



RN design
Imagine • Inspire • Create
TEL: (905) 736-3177
FAX: (905) 736-5449

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 06, 2015 - RN STAFF IN ACCORDANCE TO 98-12 COMPLIANCE PACKAGE J

I, REGINA CHINA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THESE DRAWINGS.
I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015

SIGNATURE:

PAGE

A8

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

[illegible]

FOR CONTINUATION REFER TO BASEMENT FLOOR PLAN ELEVATION 'A'


FOR STRUCTURAL ONLY
EXCLUDING ROOF
TRUSS DESIGNS




30'-10"

2"x6" CAP RAIL W/2"x2" PICKETS,
MAX. 4" SPACING AS PER SB-7
SUPPLEMENTARY GUIDELINES TO
THE OBC CAP RAIL HEIGHT TO BE
36" FROM DECK EXCEPT WHERE
ADJACENT GRADE EXCEEDS 5'-11"
THEN RAIL TO BE 42" HIGH

-4"x4" POSTS @ 47" O.C. MAX.
ATTACHED TO JOISTS AS PER
SB-7 SUPPLEMENTRY

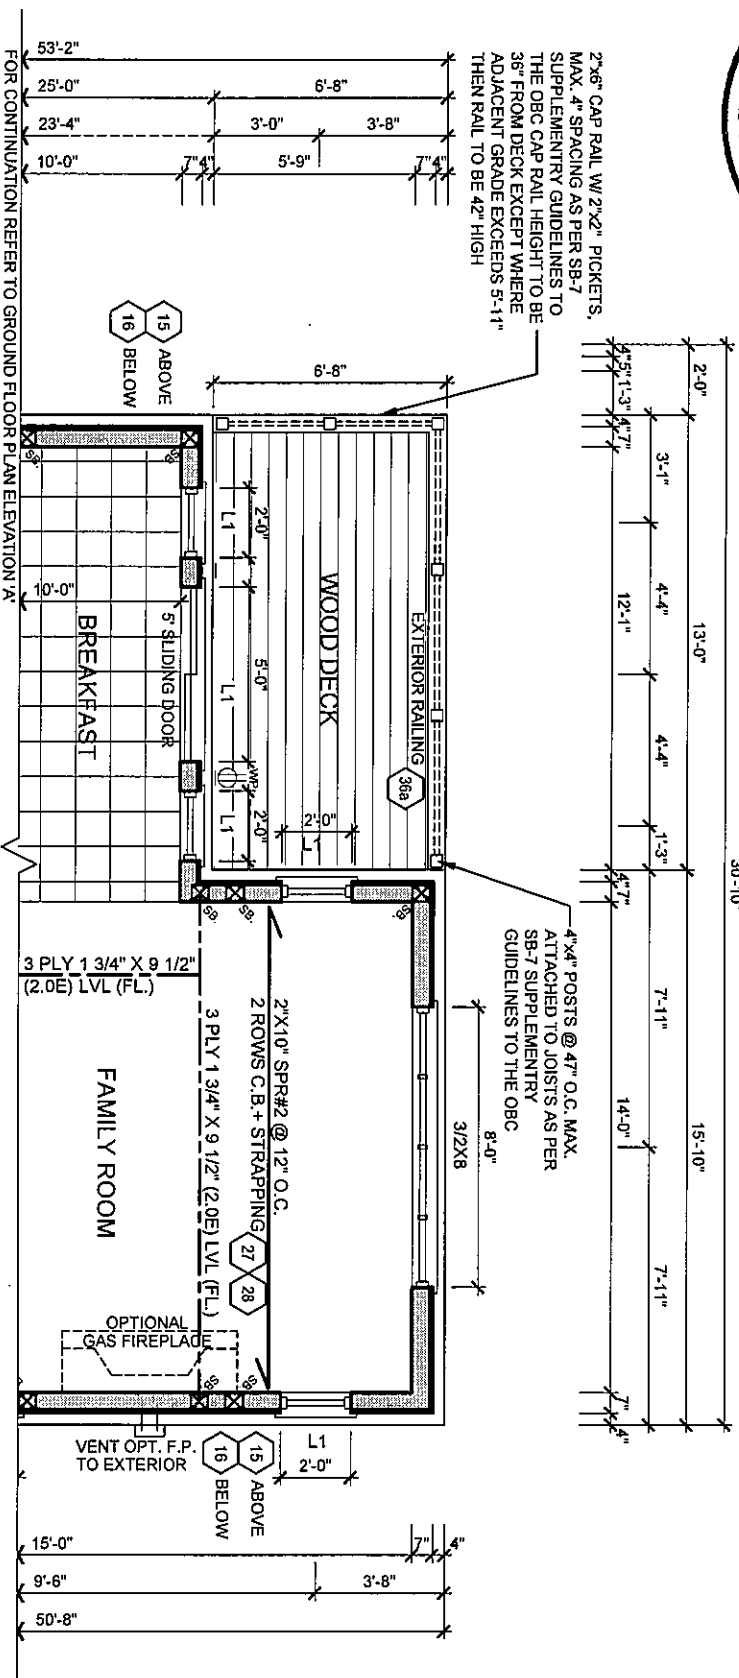

FOR CONTINUATION REFER TO GROUND FLOOR PLAN ELEVATION 'A'

 FN design <i>Imagine • Inspire • Create</i> TEL. (905) 738-3177 FAX. (905) 738-5449	MODEL 37-7 (NEWCASTLE) - ELEVATION 'A'		SCALE 3/16" = 1'0"	
	CLIENT ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO		PROJECT NUMBER 14093	
THESE DRAWINGS ARE NOT TO BE SCALED ALL DIMENSIONS MUST BE VERIFIED BY CONTACTING THE DESIGNER PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO FN DESIGN LTD. REVISED: JANUARY 08, 2015 - FN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J				
I, NEILSON CHUNG , DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE FOLLOWING DRAWING(S) UNLIMITED UNDER DIVISION C PART 3, SUBSECTION 32 OF THE REGULATION. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.		QUALIFIED DESIGNER BCIN: 21032 SIGNATURE: FIRM BCIN: 28995 DATE: OCTOBER 19, 2015		
No. 1.		ISSUED OR REVISION COMMENTS UPDATED TO OBC 2012 - 2015 ENACTMENT		DATE OCT. 19/15
				DWN --
				CHK NC
A9				

CONSTRUCTION NOTES:

COMPLIANCE PACKAGE J - O.B.C. 2012 - 2015 ENACTMENT

(UNLESS OTHERWISE NOTED)
-ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION.
-ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC.
-THERMAL RESISTANCE VALUES BASED ON ZONE 1

FOOTINGS / SLABS:

TYPICAL STRIP FOOTING:

O.B.C. 9.15.3.

-BASED ON 16-1/4" (9mm) MAX. SUPPORTED JOIST LENGTH
-MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
-SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10:90:1 (25:75:25) BEARING CAPACITY
-FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT)

1 TYPICAL STRIP FOOTING: (EXTERIOR WALL)

O.B.C. 9.15.3.5.

-FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
BRICK VENEER
-1 STOREY - 13" X 4" (330mm X 100mm)
-2 STOREY - 19" X 6" (485mm X 155mm)
-3 STOREY - 26" X 9" (660mm X 230mm)

2 TYPICAL STRIP FOOTING: (INTERIOR BEARING WALL)

O.B.C. 9.15.3.6.

-1 STOREY MASCONRY - 16" X 4" (410mm X 100mm)
-2 STOREY MASCONRY - 12" X 4" (305mm X 100mm)
-3 STOREY MASCONRY - 18" X 5" (450mm X 130mm)
-4 STOREY MASCONRY - 24" X 8" (600mm X 200mm)

3 STEP FOOTING:

O.B.C. 9.15.3.9.

-23 5/8" (600mm) MAX. VERTICAL RISE & 23 5/8" (600mm) MIN. HORIZONTAL RUN.

4 DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3.

-4" (100mm) MIN. DIA. Laid ON UNDISTURBED OR WELL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FTER. SLAB.

5 BASEMENT SLAB:

O.B.C. 9.13. & 9.16.

-3" (75mm) CONCRETE SLAB
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-R10 (R5) 1.76" INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. 9.8-12-2.1.1.6 (9))
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. 9B-9)

6 GARAGE SLAB / EXTERIOR SLAB:

O.B.C. 9.13.3.

-4" (100mm) CONCRETE SLAB
-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNKINDRED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.6.
-6" X 6" (W29 X W 29) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-R10 (R5) 1.76" INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. 9.8-12-2.1.1.6 (9))
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. 9B-9)

7 PLASTER:

O.B.C. 9.15.5.3.

-CONCRETE NIB - 4" X 12" (100mm X 300mm)
-BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9.20.11.2. TOP 7 7/8" (200mm) SOLID.
OR
-BEAM POCKET
-4" (100mm) INTO EDN. WALL W/ WIDTH TO MATCH BEAM SIZE
-1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.2) STRUCTURAL COLUMNS
-SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS. WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4 kPa).

8 STEEL PIPE COLUMN:

O.B.C. 9.15.3.4. & 9.17.3.

-FIXED COLUMN
-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS
-FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mm X 100mm X 6.35mm) STEEL BINA. PLATE
-FOR WOOD BEAMS, MIN. 4" X 4" X 1/4" (100mm X 100mm X 6.35mm) STEEL TOP & BINA. PLATES OR TOP PLATE TO EXTEND MIN. NEAR MID-DEPTH OF BEAM.
-ADJUSTABLE COLUMNS TO CONFORM TO CAN/CSG-7-2M4 WHERE IMPOSED LOAD DOES NOT EXCEED 36 kN (O.B.C. 9.17.3.4.)
COL. SPACING:
2 STOREY
-MAX. 9'-10" (2997mm)
-MAX. 9'-10" (2997mm)
3 STOREY
-MAX. 16'-0" (4880mm)
-MAX. 16'-0" (4880mm)
-WHERE COL. SITS ON FDN. WALL, USE 4" X 8" X 5/8" (100mm X 200mm X 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

WOOD COLUMN:

O.B.C. 9.17.4.1.

-5-1/2" X 5 1/2" (140mm X 140mm) SOLID WOOD COLUMN.
-METAL SHOE ANCHORED TO FOOTING
-25" X 25" X 12" (640mm X 640mm X 300mm) CONC. PAD (1 FLOOR
-34" X 34" X 14" (860mm X 860mm X 360mm) CONC. PAD (2 FLOORS
SUPPORTED W/ 9'-10" COL. SPACING)

10 BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)

O.B.C. 9.15.4.2.

-2"x8" (127mm) LEDGER BOARD FASTENED W/ 2" (51mm) ANCHOR BOLTS @ 4" O.C.
-WHERE WOOD BEAMS BEAR ON PRECASTS W/ UTI FLOOR ANCHOR NOTE 11
WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE
BETWEEN ADJACENT BEAMS
BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM)
2-1/2"x8" (64mm X 203mm) ANCHOR BOLTS

11 WALL ASSEMBLIES:

O.B.C. 9.15.4.2.

-FOR WALLS NOT EXCEEDING 9'-10" (3000mm) IN LATEROALLY SUPPORTED HEIGHT.
-8" (200mm) SOLID 2200psi (15MPa) CONCRETE
-MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 4'-0" (1200mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATEROALLY SUPPORTED HEIGHT.

12 FOUNDATION WALL:

O.B.C. 9.15.4.2.

-MAX. UNSUPPORTED HEIGHT OF 4'-7" (1400mm) & MAX. SUPPORTED HEIGHT OF 8'-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS.
-FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C. 19.15.4.1 SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C. - PART 4
-WALL SHALL EXTEND A MIN. 5 7/8" (150mm) ABOVE GRADE
-INSULATE W/ R12 (R5) 2.11" FROM UNDERSIDE OF SUPERIOR TO NOT MORE THAN 6" (150mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1, O.B.C. 12.1.1.2.A)
-BACK FILL W/ NON-ROST SUSCEPTIBLE SOIL
REDUCTION OF THICKNESS:
O.B.C. 9.15.4.7.
-WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
-IE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7 7/8" (200mm) VERTICALLY O.C. & 2'-11" (600mm) HORIZONTALLY
-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK
DAMP-PROOFING & WATERPROOFING:
-DAMP-PROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 4'-7" (1400mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.2 (9) (4)
-FINISHED BASEMENTS SHALL HAVE INTERIOR DAMPROOFING EXTENDING FROM SLAB TO GRADE LEVEL, & SHALL CONFORM TO O.B.C. 9.13.3.3 (3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMPROOFING.

13 FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

O.B.C. 9.23.

-3-20M BARS IN TOP PORTION OF WALL (UP TO 10'-0" OPENING)
-3-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING)
-4-20M BARS IN TOP PORTION OF WALL (15'-0" TO 15'-0" OPENING)
-BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL.
-BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER
-BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.
FRAME WALL CONSTRUCTION:
O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (R5) 3.87" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

14 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (R5) 3.87" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

15 ALTERNATE FRAME WALL CONSTRUCTION:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (R5) 2.46" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

16 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (R5) 2.46" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

17 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (R5) 2.46" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

18 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (R5) 2.46" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

19 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (R5) 2.46" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

20 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (R5) 2.46" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

21 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (R5) 2.46" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

22 BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.003" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRIPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BINA. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.2 (1))
-BRICK OR STONE SITS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1-1/2" (38mm) R8 (R5) 1.41" RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4)
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BINA. PLATE FOR THE FULL LENGTH OF WALL, OR
-CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BINA. PLATE FOR FULL LENGTH OF WALL
-R14 (R5) 2.46" INSULATION
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

23 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (R5) 2.46" INSULATION (ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

24 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BINA. PLATE FOR THE FULL LENGTH OF WALL, OR
-CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BINA. PLATE FOR FULL LENGTH OF WALL
-R14 (R5) 2.46" INSULATION
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

25 FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.28.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C.
ON BOTTOM FLR. WHEN 3 STOREYS
-BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BINA. PLATE FOR THE FULL LENGTH OF WALL, OR
-CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BINA. PLATE FOR FULL LENGTH OF WALL
-R14 (R5) 2.46" INSULATION
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

26 FRAME


- 43b) **EXTERIOR GUARDS @ JULIET BALCONY:**
-FOR RAILING SPANNING MAXIMUM OF 6'-0"
-PROVIDE PREPIN METAL RAILING W/ 76mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.8.8.5.
-GUARDS TO BE 3'-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE 2'-11" (660mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C. 9.8.8.2. OR
-FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C. 9.8.8.2.
-VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS LISTING 3 ROWS OF 3/8"x2 MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN. EMBEDMENT TO STUDS.
-PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.
- 37) **LINEN CLOSET 4 SHELVES MIN. 1'-2" (330mm) DEEP**
-WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR. O.B.C. 9.32.1.3.(3)
- 39) **CAPED DRYER VENT**
- 40) **1-1/2" (19mm)(38mm) BOTH SIDES OF STEEL.**
-WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mm POLYETHYLENE.
- 42) **PRECAST CONCRETE STEP**
-2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND
- 44) **SMOKE ALARM, O.B.C. - 9.10.19**
-PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
-PROVIDE 1 IN EACH BEDROOM
-INSTALLED AT OR NEAR CEILING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A VISUAL SIGNALING COMPONENT
-ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM
- 45) **CARBON MONOXIDE ALARM (CMA), O.B.C. - 9.33.4**
-WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.
-CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.
- 46) **MAIN DOOR TO BE OPERABLE FROM INSIDE W/O/UT KEY**
-PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIGHTLIGHT IS PRESENT.
-R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED
- 47) **GARAGE MAIN DOORS TO BE GAS PROTECTED WITH SELF CLOSING WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15. R4 (RSI 0.70)**
- 48) **TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT:**
1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY
OR
2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH. SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (7100mm) ABOVE ADJACENT GROUND LEVEL.
- 49) **EXTERIOR COLUMN W/ MASONRY PIER:**
-MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE.
-TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.
-1-1/4" X 1-1/4" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP.
-REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.
- 49b) **EXTERIOR COLUMN:**
-MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE
NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.
- 50) **COLD CELLARS:**
FOR COLD CELLARS PROVIDE THE FOLLOWING:
-VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.
-COVER VENT W/ BUG SCREEN
-WALL MOUNTED LIGHT FIXTURE
-1-1/2" FOR DOOR OPENING
-2'-6" X 6'-6" EXTERIOR TYPE DOOR (MIN. R-4 RSI 0.7)
-INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)
- 51) **STUD WALL REINFORCEMENT:**
O.B.C. 9.5.2.3.
-WALL STUDS ADJACENT TO WATER CLOSERS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)(d)(4)(c) & 3.8.3.13.(2)(1) & 3.8.3.13.(4)(c)
-GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)
- FRAME CONSTRUCTION:**
-ALL FRAMING LUMBER TO BE NO.1 AND NO. 2 SPF UNLESS NOTED OTHERWISE.
-ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN LOADS.
-JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING
-BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING
-DOUBLE STUDS @ OPENINGS
-DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mm)
-DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm)
-DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS
-BEAMS TO BE PLACED UNDER LOAD BEARING WALLS WHEN WALLS ARE PARALLEL TO FLOOR JOISTS

-BEAMS MAY BE A MAX. 2-1/2" (600mm) FROM LOAD BEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS
-APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS
-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 6" (38mm X 18mm)
-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 255mm) OR LARGER.

WINDOWS:
-WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER
-WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 1.8 W/(m2.K) OR
-AN ENERGY RATING OF NOT LESS THAN 21 FOR OPERABLE WINDOWS & 31 FOR FIXED WINDOWS
-BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING
-STYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 2.8 W/(m2.K)
-FOR GROSS GLAZED AREAS LESS THAN 17%

ADDITIONAL COMPLIANCE ALTERNATIVES FOR PACKAGE 1
-THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT THE WINDOWS AND SLIDING GLASS DOORS HAVE A MAXIMUM U-VALUE OF 1.6. OR THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A MINIMUM R20 (RSI 3.52).
OR
-WHERE BLOWN-IN INSULATION OR SPRAY-APPLIED FOAM INSULATION IS USED, THE MAXIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT:
a) THE THERMAL INSULATION VALUE IN A CEILING WITH AN ATTIC SPACE IS NOT LESS THAN R60 (RSI 10.55).
b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 PERCENTAGE POINTS.
c) THE MINIMUM AFUE OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS.
d) THE MINIMUM EFF OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY NOT LESS THAN 4 PERCENTAGE POINTS.

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

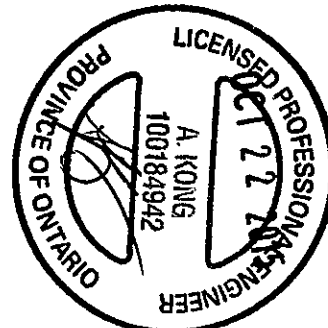

SCHEDULES

DOORS 46) 47)		WOOD BEAMS	
A 865x2030x45 (2'10"x6'8"x1-3/4")	WD1 3/2" X 8" SPR	WD6 5/2" X 10" SPR	WD10 2/1 3/4" X 1/4" (2.0E) LVL
B 815x2030x35 (2'6"x6'8"x1-3/8")	WD2 4/2" X 8" SPR	WD7 3/2" X 12" SPR	WD11 3/1 3/4" X 1/4" (2.0E) LVL
C 760x2030x35 (2'5"x6'8"x1-3/8")	WD3 5/2" X 8" SPR	WD8 4/2" X 12" SPR	WD12 2/1 3/4" X 1/2" (2.0E) LVL
D 710x2030x35 (2'4"x6'8"x1-3/8")	WD4 3/2" X 10" SPR	WD9 5/2" X 12" SPR	WD13 3/1 3/4" X 1/2" (2.0E) LVL
E 460x2030x35 (1'6"x6'8"x1-3/8")	WD5 4/2" X 10" SPR		WD14 2/1 3/4" X 11 7/8" (2.0E) LVL
F 610x2030x35 (2'0"x6'8"x1-3/8")			WD15 3/1 3/4" X 11 7/8" (2.0E) LVL
G OVER SIZED EXTERIOR DOOR -REFER TO ELEVATIONS FOR SIZE			
		LINTELS	
L1 2/2" X 8" SPR	L10 4-7/8" X 3-1/2" X 5/16" L	L15 5-7/8" X 4" X 1/2" L	
L3 2/2" X 10" SPR	L11 4-7/8" X 3-1/2" X 3/8" L	L16 7-1/8" X 4" X 3/8" L	
L5 2/2" X 12" SPR	L12 4-7/8" X 3-1/2" X 1/2" L	L17 7-1/8" X 4" X 1/2" L	
L7 3-1/2" X 3-1/2" X 1/4" L	L13 5-7/8" X 3-1/2" X 3/8" L		
L9 4" X 3-1/2" X 1/4" L	L14 5-7/8" X 3-1/2" X 1/2" L		
		STEEL BEAMS	
ST1 W6 X 15	ST3 W8 X 18	ST5 W8 X 24	
ST2 W6 X 20	ST4 W8 X 21		


PLAN/ELEVATION LEGEND	
44) SMOKE ALARM WATERPROOF DUPLEX OUTLET VENTS AND INTAKES HOSES BIB EXHAUST FAN COLD CELLAR VENT 50) STOVE VENT FIRE PLACE VENT DRYER VENT	45) CARBON MONOXIDE DETECTOR D.J. DOUBLE JOIST P.T. PRESURE TREATED LUMBER G.T. GENDER TRUSS A.F.F. ABOVE FINISHED FLOOR EXT. LIGHT FIXTURE (WALL MOUNTED) HYDRO METER GAS METER
X FLOOR DRAIN SOLID BEARING TO BE SAME WIDTH AS SUPPORTED MEMBERS POINT LOAD 2 STORY WALL UNDER SIDE FIXED GLAZING GLASS BLOCK BLACK GLASS	

FLOOR AREA CALCULATIONS									
ELEVATION	A								
FIRST FLOOR	1074								
SECOND FLOOR	1311								
TOTAL	2385								
DEDUCT O.T.B.	8								
TOTAL	2377								
FIN. BASEMENT	N/A								
TOTAL	2377								
LOFT PLAN	N/A								
TOTAL	2377								
COVERAGE (ft²)	1461								
W/O PORCH (m²)	135.7								
COVERAGE (ft²)	1532								
W/ PORCH (m²)	142.3								


		MODEL 37-7 (NEWCASTLE) - ELEVATION 'A'	
CLIENT		No. ISSUED OR REVISION COMMENTS	DATE
ESQUIRE HOMES		1. UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15
NORTHGLEN - PHASE 2			
CLARINGTON, ONTARIO			
REVISION: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J		QUALIFIED DESIGNER BCIN: 21032	SIGNATURE:
CLIENT SPECIFIC REVISIONS		FIRM BCIN: 26995	DATE: OCTOBER 19, 2015
PROJECT NUMBER 14093		SCALE N/A	
PAGE		D3	

It is the builder's complete responsibility to ensure that all plans submitted for approval are in accordance with the applicable zoning and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

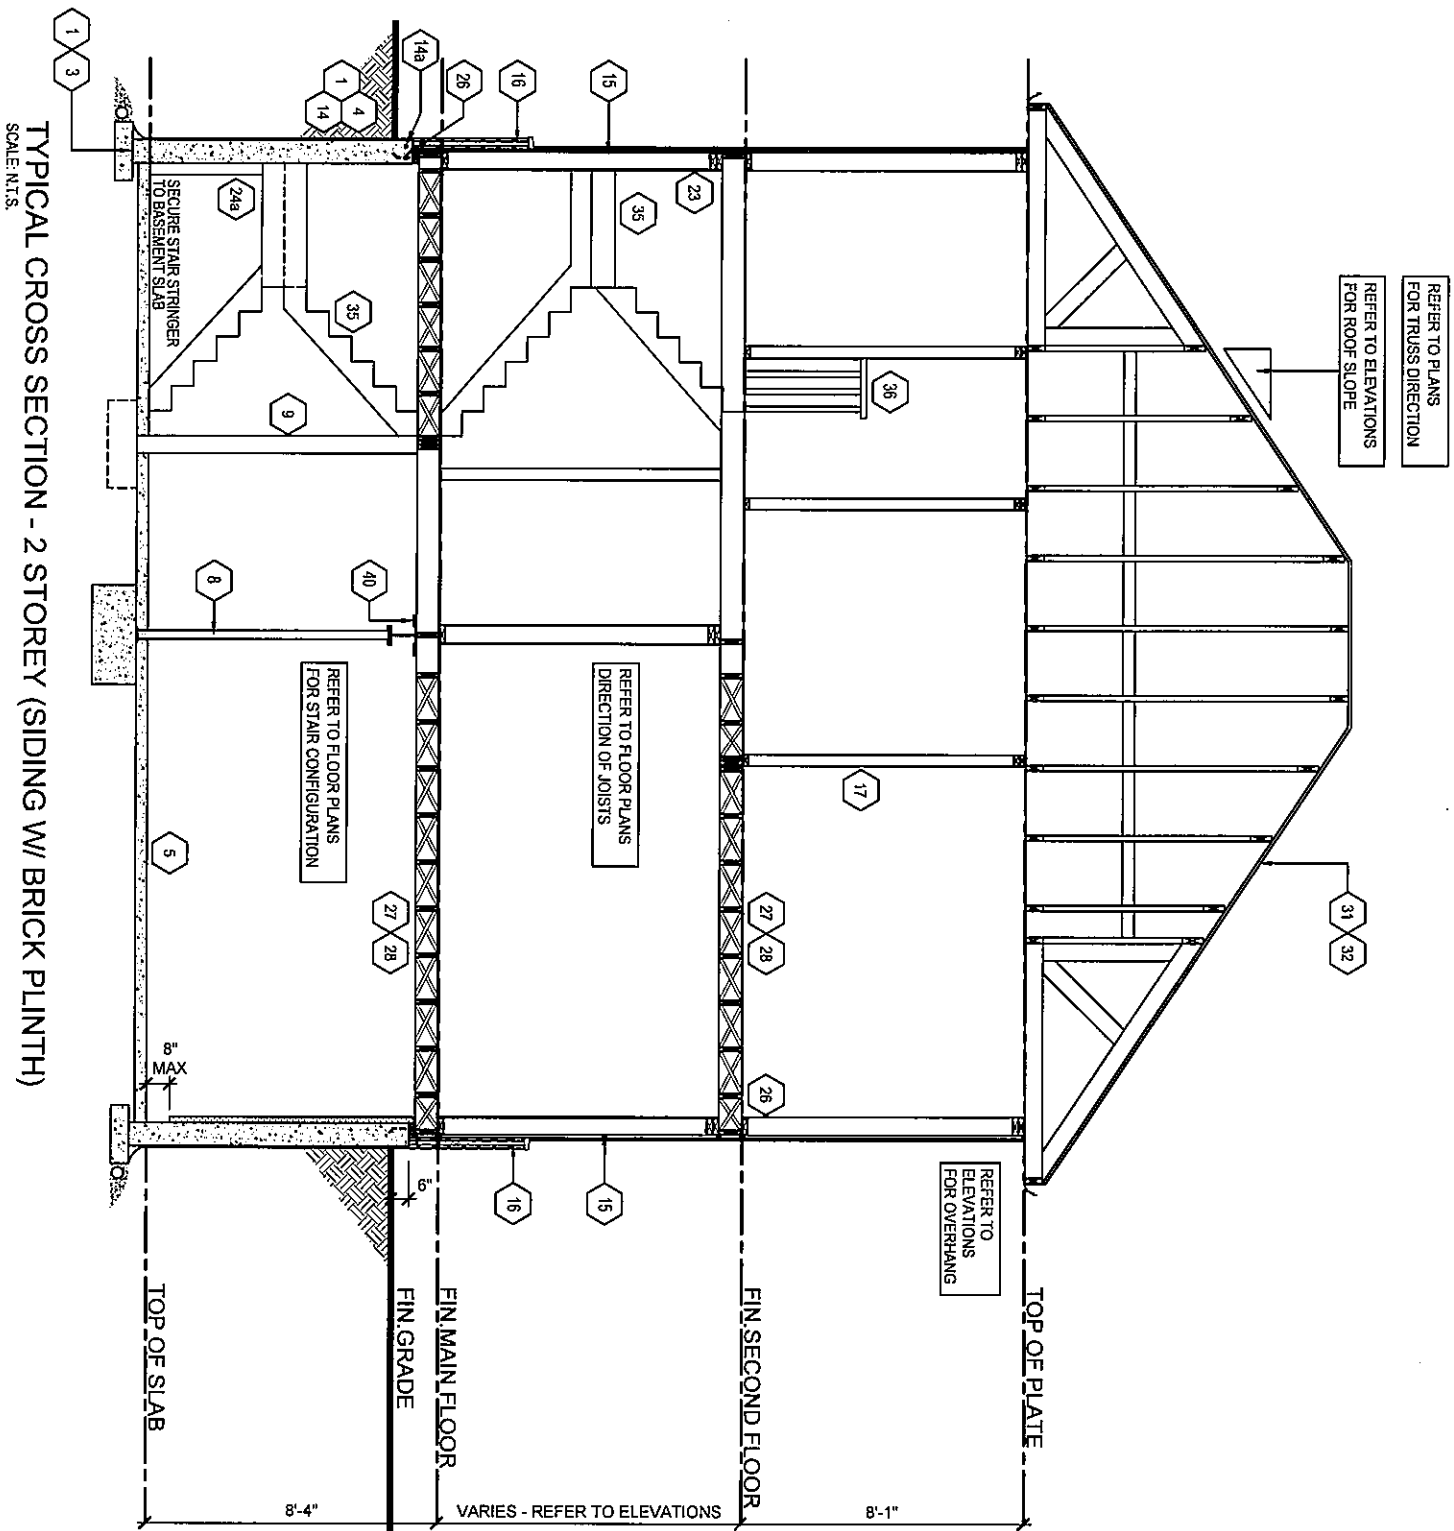

FOR STRUCTURAL ONLY

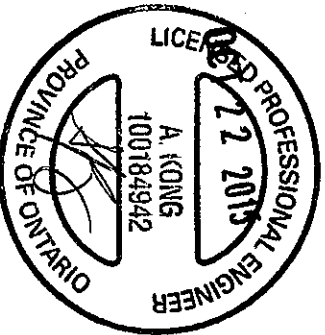

 RN design Imagine • Inspire • Create TEL: (905) 738-3177 FAX: (905) 738-5449	MODEL 37-7 (NEWCASTLE) - ELEVATION 'A'					
	CLIENT ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO					
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J	1. I, JESSE CUNHA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES/CATEGORIES.	No. ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
			1. UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	--	NC
						PROJECT NUMBER 14093
						PAGE D4
		QUALIFIED DESIGNER BCIN: 21032 FIRM BCIN: 26995 DATE: OCTOBER 19, 2015	SIGNATURE:			