


FRONT ELEVATION 'A'

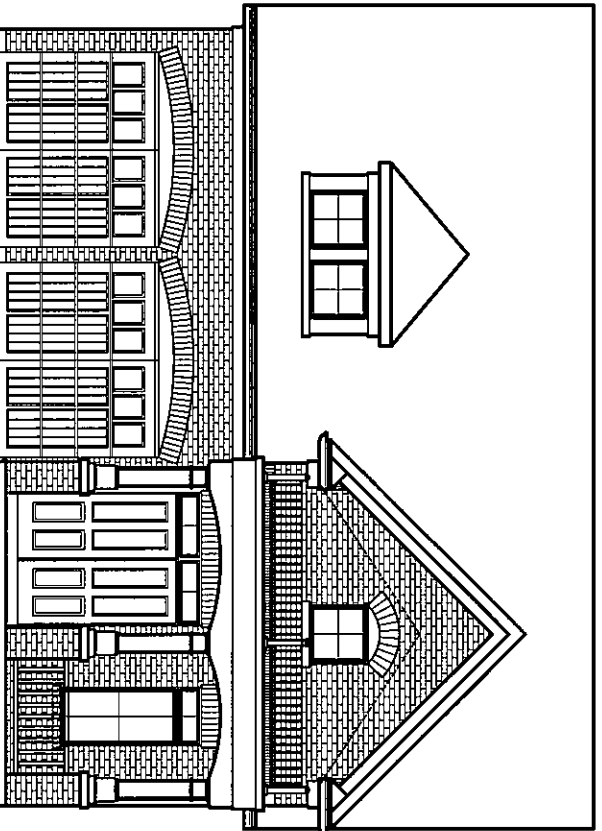

FRONT ELEVATION 'B'

OBC 2012

DRAWING LIST:

- 40-2
- T1

TITLE SHEET
- A1

BASEMENT FLOOR ELEV. 'A' & 'B'
- A2

GROUND FLOOR ELEV. 'A'
- A3

GROUND FLOOR ELEV. 'B'
- A4

FRONT ELEVATION 'A'
- A5

RIGHT SIDE ELEVATION 'A'
- A6

REAR ELEVATION 'A'
- A7

LEFT SIDE ELEVATION 'A'
- A8

FRONT ELEVATION 'B'
- A9

RIGHT SIDE ELEVATION 'B'
- A10

REAR ELEVATION 'B'
- A11

LEFT SIDE ELEVATION 'B'
- D1

CONSTRUCTION SHEET
- D2

CONSTRUCTION SHEET
- D3

CONSTRUCTION SHEET
- D4

TYPICAL SECTION

GROSS GLAZING AREA 'A'

TOTAL PERIPHERAL WALL AREA	2361.81 SF	219.41 m²
FRONT GLAZING AREA	20.40 SF	1.90 m²
LEFT SIDE GLAZING AREA	28.33 SF	2.63 m²
RIGHT SIDE GLAZING AREA	49.00 SF	4.55 m²
REAR GLAZING AREA	95.80 SF	8.90 m²
TOTAL GLAZING AREA	193.53 SF	17.98 m²
TOTAL GLAZING PERCENTAGE	8.19 %	

GROSS GLAZING AREA 'B'

TOTAL PERIPHERAL WALL AREA	2361.81 SF	219.41 m²
FRONT GLAZING AREA	22.75 SF	2.11 m²
LEFT SIDE GLAZING AREA	28.33 SF	2.63 m²
RIGHT SIDE GLAZING AREA	51.17 SF	4.75 m²
REAR GLAZING AREA	95.80 SF	8.90 m²
TOTAL GLAZING AREA	198.05 SF	18.40 m²
TOTAL GLAZING PERCENTAGE	8.39 %	

ESQUIRE HOMES

NORTHGLEN - PH. 2

CLARINGTON, ONTARIO



RN design

Imagine • Inspire • Create

8395 JANE STREET

SUITE 203

VAUGHAN, ON

TEL: 905-738-3177

FAX: 905-738-5449

CONTACT PERSON: NELSON CUNHA

No.	REVISION COMMENTS:	DATE	DWN	CHK	No.	REVISION COMMENTS:	DATE	DWN	CHK	SCALE
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	--	NC						AS NOTED
										PROJECT No.
										14093
										T1

THESE DRAWINGS ARE NOT TO BE SCALED

ALL DIMENSIONS MUST BE VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.



REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C OF THE REGISTRATION ACT, 1990. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032 SIGNATURE: FIRM BCIN: 26995 DATE: OCTOBER 19, 2015

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning regulations and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (existing) plans or building code or permit matter of that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

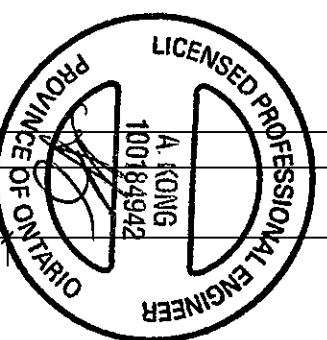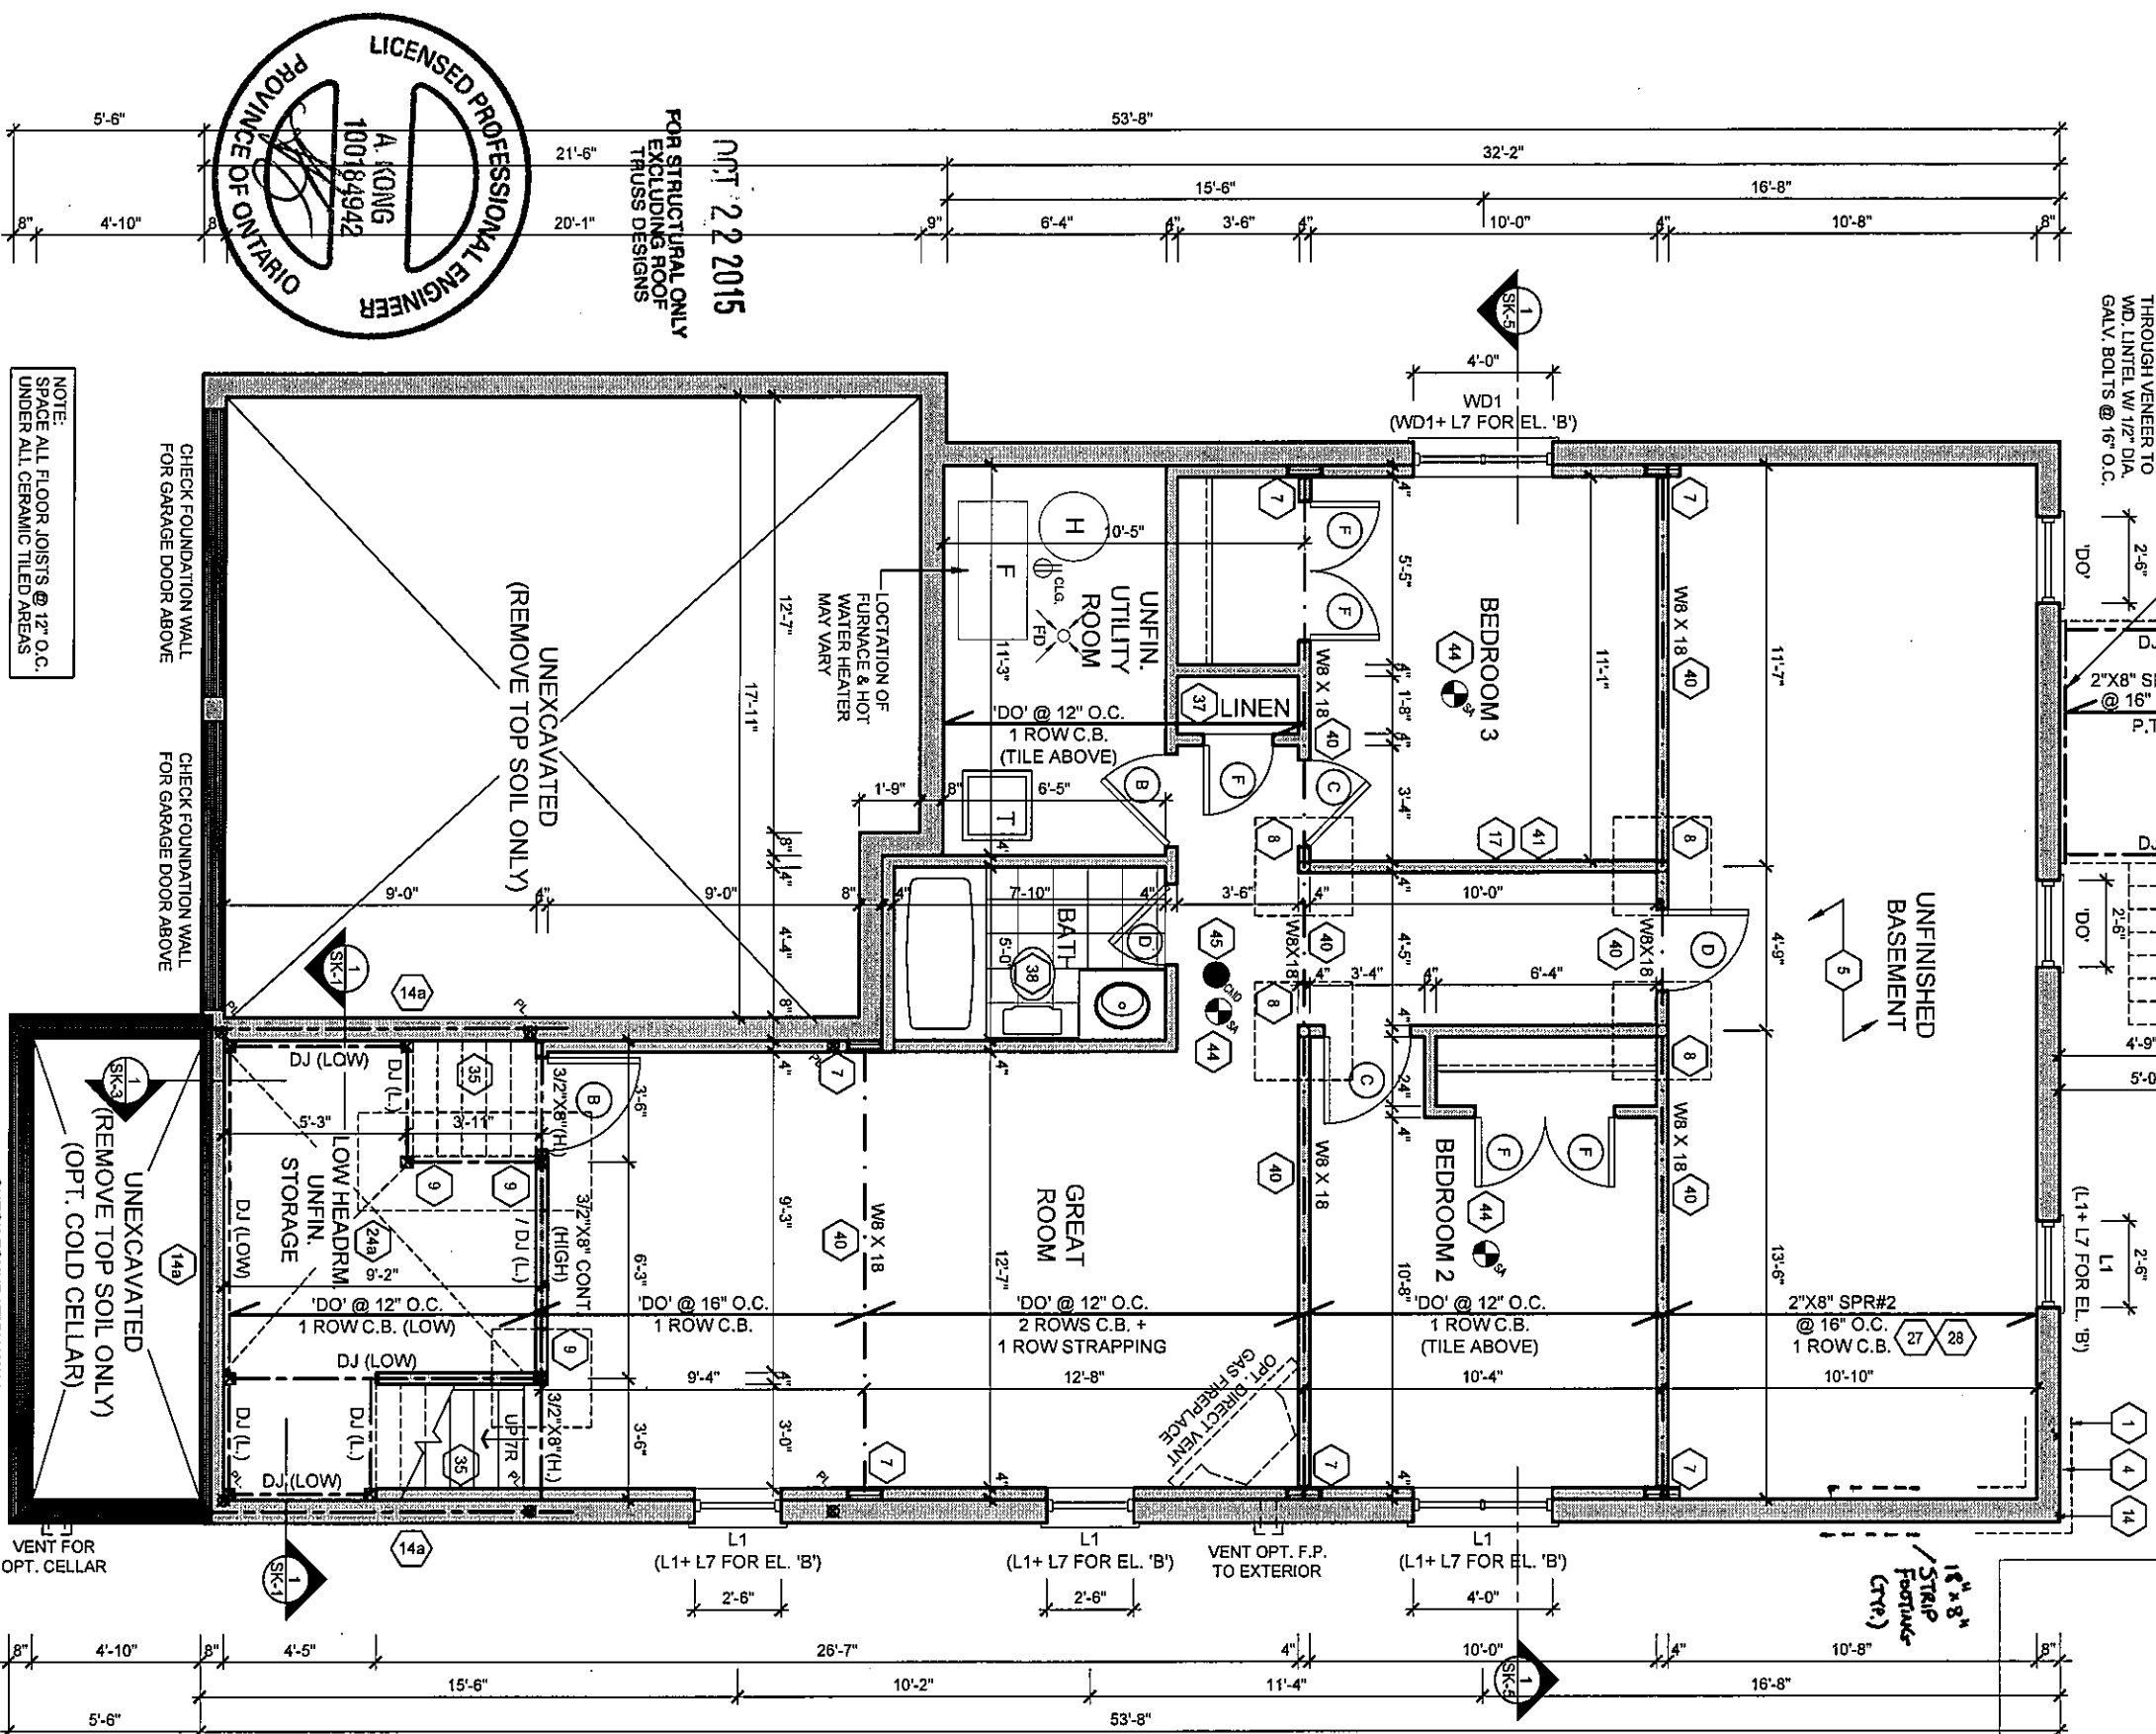

NOT 22 2015
FOR STRUCTURAL ONLY
EXCLUDING ROOF
TRUSS DESIGNS

BASEMENT FLOOR ELEV. 'A' & 'B'

MODEL				
40-2				
No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK SCALE
1	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT 19/15		NC 3/16" = 1'0"

rn design
Imagine it • Inspire it • Create it
TEL: (905) 738-3177
FAX: (905) 738-5449

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS SHOWN ARE UNLESS OTHERWISE NOTED.
TO COMMENCEMENT OF ANY WORK, ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, NELSON KONG, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED.
I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015
SIGNATURE:

PAGE
A1

12

6.0"

12

OPT. DOOR

No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK
1000-0078-20-000-0000	DATE SUBMITTED			

MODEL	40-2
CLIENT	


LOSS OF A HOME
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

I, NELSON CUNHA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

10

4"x4" POSTS @ 4'-0" O.C. MAX. —
ATTACHED TO JOISTS AS PER SG-
SUPPLEMENTRY GUIDELINES

2"x6" CAP RAIL W/ 2"x2" PICKETS, N
SPACING AS PER SG-7 SUPPLEMENT
GUIDELINES TO THE OBC CAP RAIL
HEIGHT TO BE 42" FROM DECK

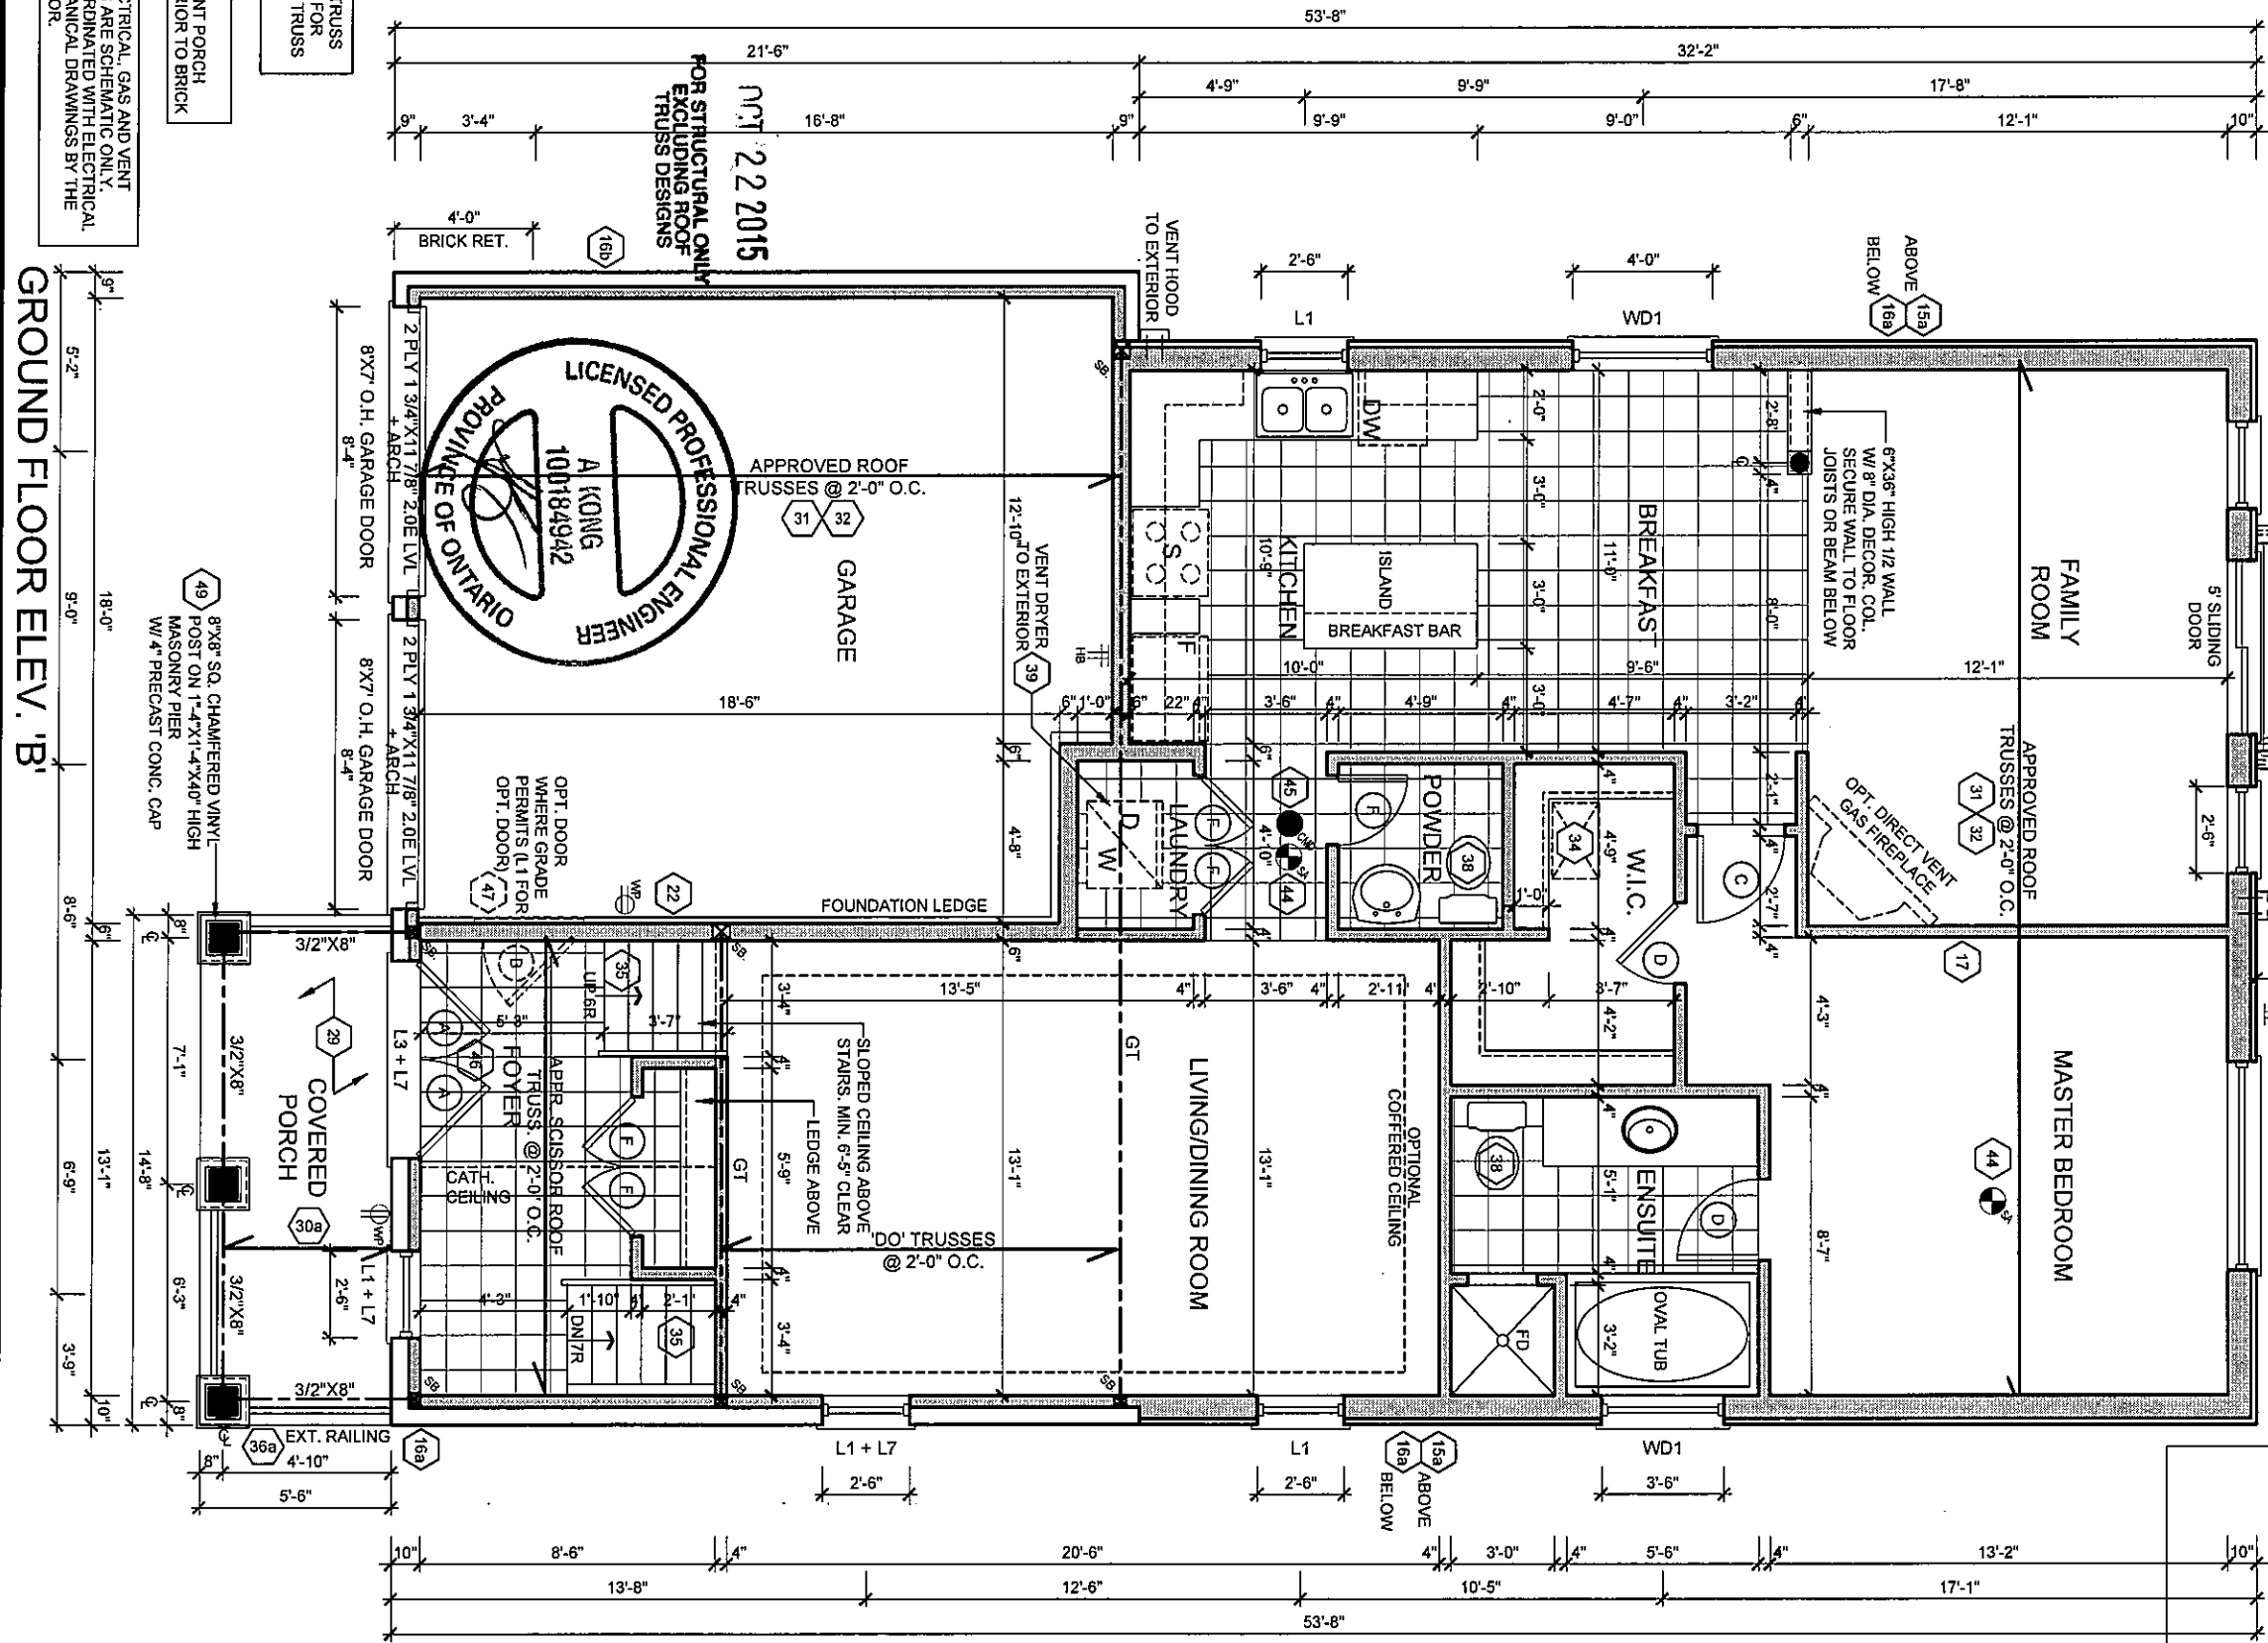

NOTE: ELECTRICAL, GAS AND VENT LOCATIONS ARE SCHEMATIC ONLY. TO BE COORDINATED WITH ELECTRICAL AND MECHANICAL DRAWINGS BY THE CONTRACTOR.

REFER TO TRUSS
DRAWINGS FOR
APPROVED TRUSS
LAYOUT.

**NOTE:
CONC. FRONT PORCH
POURED PRIOR TO BRICK**

GROUND FLOOR ELEV. 'B'

MODEL	40-2	No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
							3/16" = 1'0"
CLIENT		1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	PROJECT NUMBER

FAN design
Imagine • Inspire • Create
TEL. (905) 738-3177
FAX. (905) 738-5449

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK, ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RM DESIGN LTD.
REVISED: JANUARY 08, 2015 - IN ACCORDANCE TO S8-12 COMPLIANCE PACKAGE J

1. NELSON CANNOT DECLARE THAT I HAVE
RESPONSIBILITY FOR THE DESIGN WORK
UNDER DIVISION C, PART 3, SUBSECTION 3.1
I AM QUALIFIED, AND THE FIRM IS REGISTERED
CLASSES/CATEGORIES.

File:C:_RN_Standards\ACA 2016\temp\AcPublish_143481-4093-40-2-FINAL.dwg Plotted: Oct 19, 2015 By: ahhunt

A3

PROJECT NUMBER
14093

PART 9 OF THE OBC, ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER AT EACH CROSS POINT. POSTS LONGER THAN 6' TO BE LATERALLY BRACED SO THAT THE DISTANCE BETWEEN END POINTS & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

[illegible]

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable zoning provisions, including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

MODEL	40-2	No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
		1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	3/16" = 1'0"
CLIENT							PROJECT NUMBER

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

PAN design
Imagine • Inspire • Create
 TEL.(905)738-3177
 FAX.(905)738-5449


THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE DERIVED BY CONTRACTOR PRIOR
TO COMMENCEMENT OF ANY WORK AND NOT TO BE
MUST BE REPORTED DIRECTLY TO FN DESIGN LTD.
REVISED: JANUARY 09, 2015 - FN-519P (IN ACCORDANCE TO SP-22 COMPLIANCE PACKAGE J)

QUALIFIED DESIGNER BCIN:	21032	SIGNATURE:
FIRM BCIN:	26995	
DATE:	OCTOBER 19, 2015	

4A

RIGHT SIDE ELEVATION 'A'

TOTAL WALL AREA	745.56	SF
LIMITING DISTANCE	4.0	FT
ALLOWABLE OPENINGS	52.19	SF
ACTUAL OPENINGS	51.13	SF

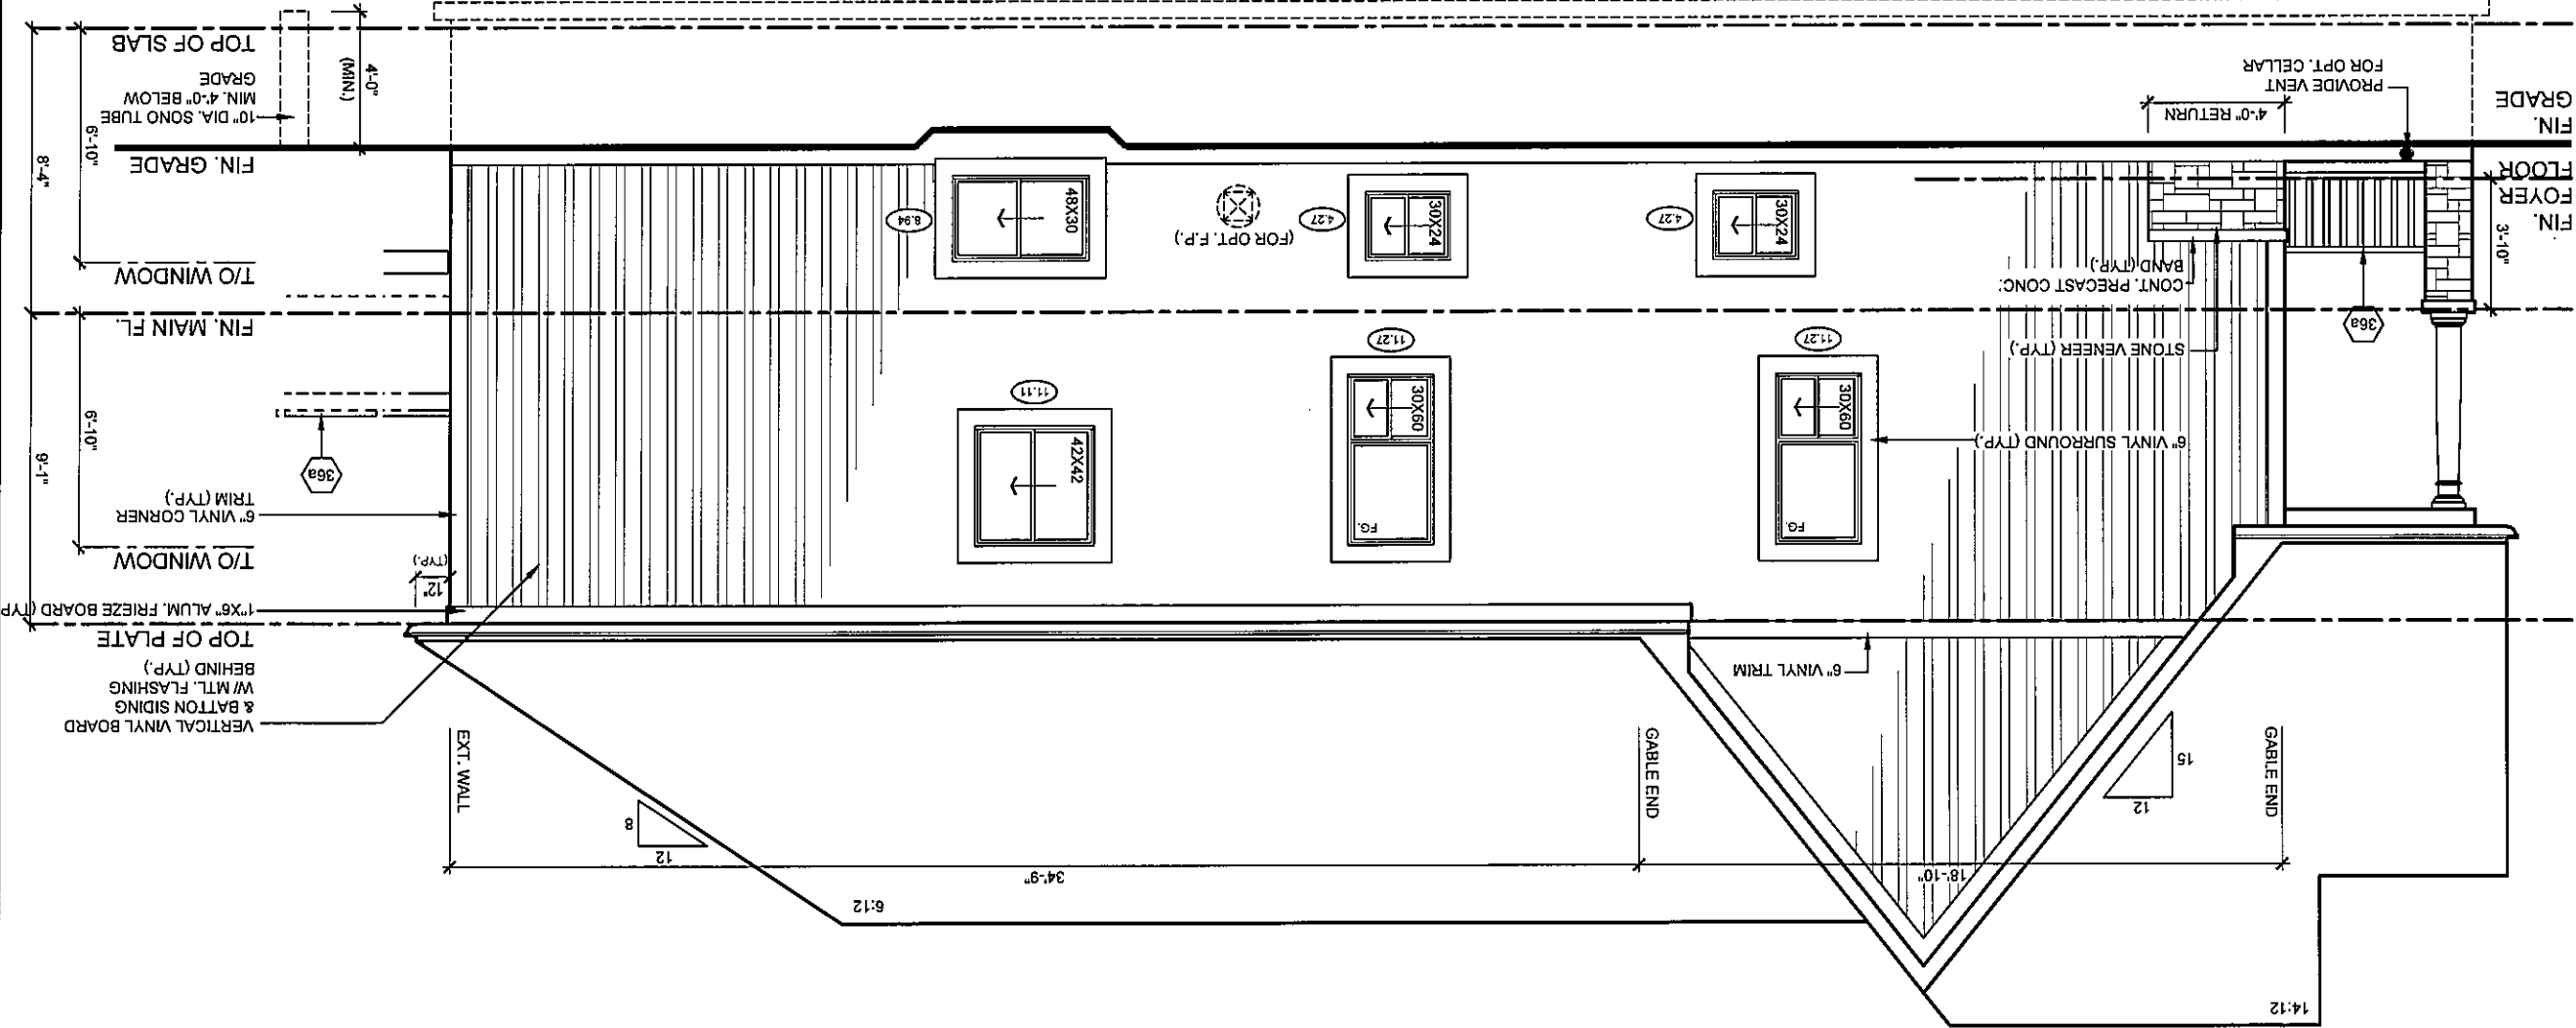

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Council has no responsibility for any errors or omissions in the drawings or for any delays or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

MODEL	40-2	No. ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
CLIENT	ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO	1. UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	3/16" = 1'0"
						PROJECT NUMBER 14093
						PAGE A5




RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, THE SIGNING REGULATOR, HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THESE PLANS AND AM LIMITED TO THE QUALITY OF THE INFORMATION PROVIDED TO ME BY THE CLIENT. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CATEGORY.


QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015

SIGNATURE:

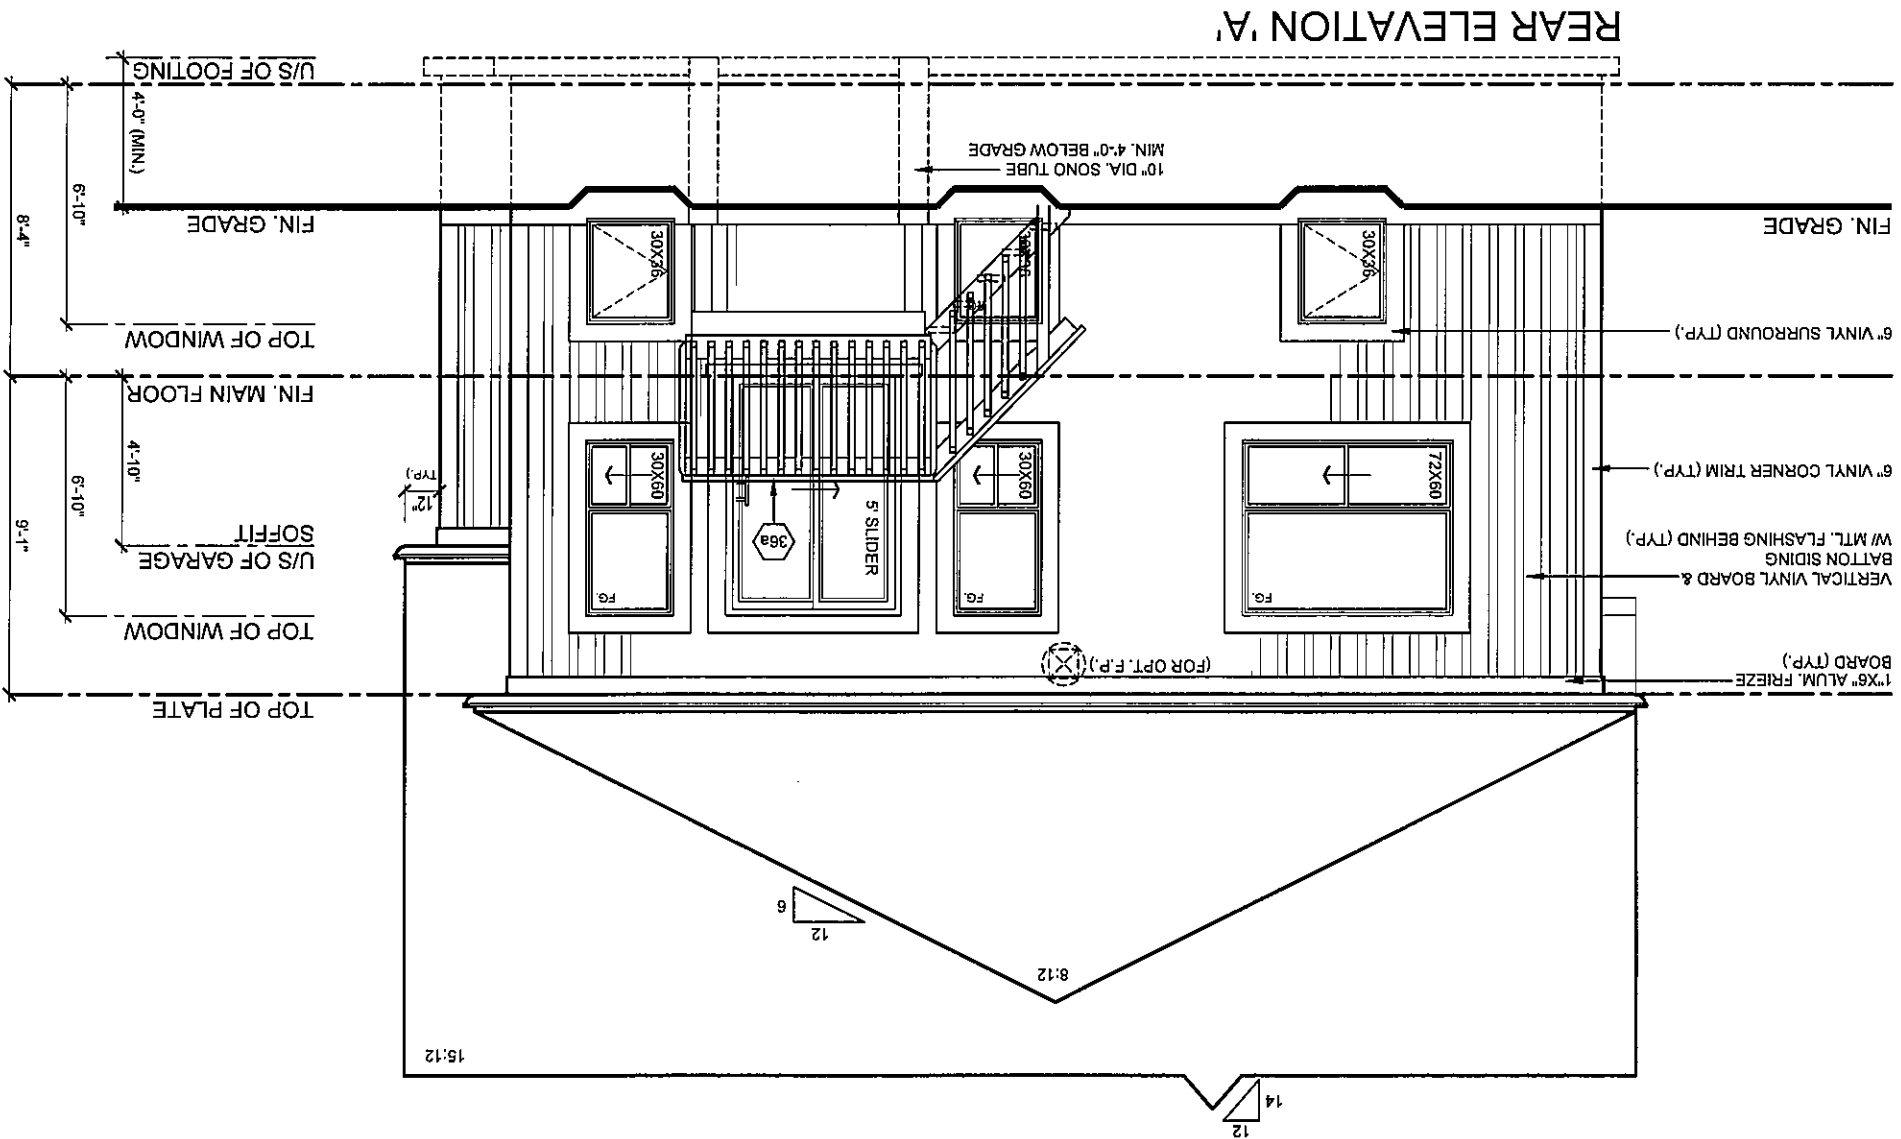

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site planning plans or building plans. It is the responsibility of the building code or permit officer that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

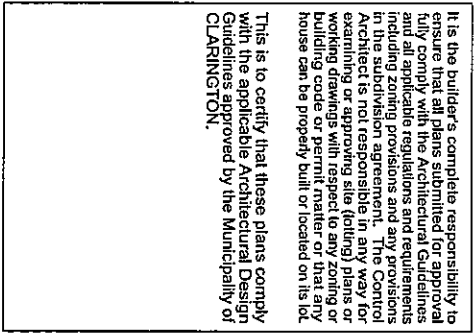

FN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449

MODEL: 40-2
CLIENT:

ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO

No.	ISSUED OR REVISION COMMENTS
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT


DATE	DWN	CHK
OCT. 19/15	-	NC

SCALE 3/16" = 1'0"
PROJECT NUMBER 14093

I, NELSON GUHA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN OF THE PROJECT. I AM A REGISTERED PROFESSIONAL ARCHITECT UNDER DIVISION 5 OF THE REGULATION OF PROFESSIONS ACT, 1990, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 28995
DATE: OCTOBER 19, 2015
SIGNATURE:

ALLOWABLE UNPROTECTED OPENINGS	447.65	SF
LIMITING DISTANCE	4.0	FT
ALLOWABLE OPENINGS	31.33	SF
ACTUAL OPENINGS	29.32	SF

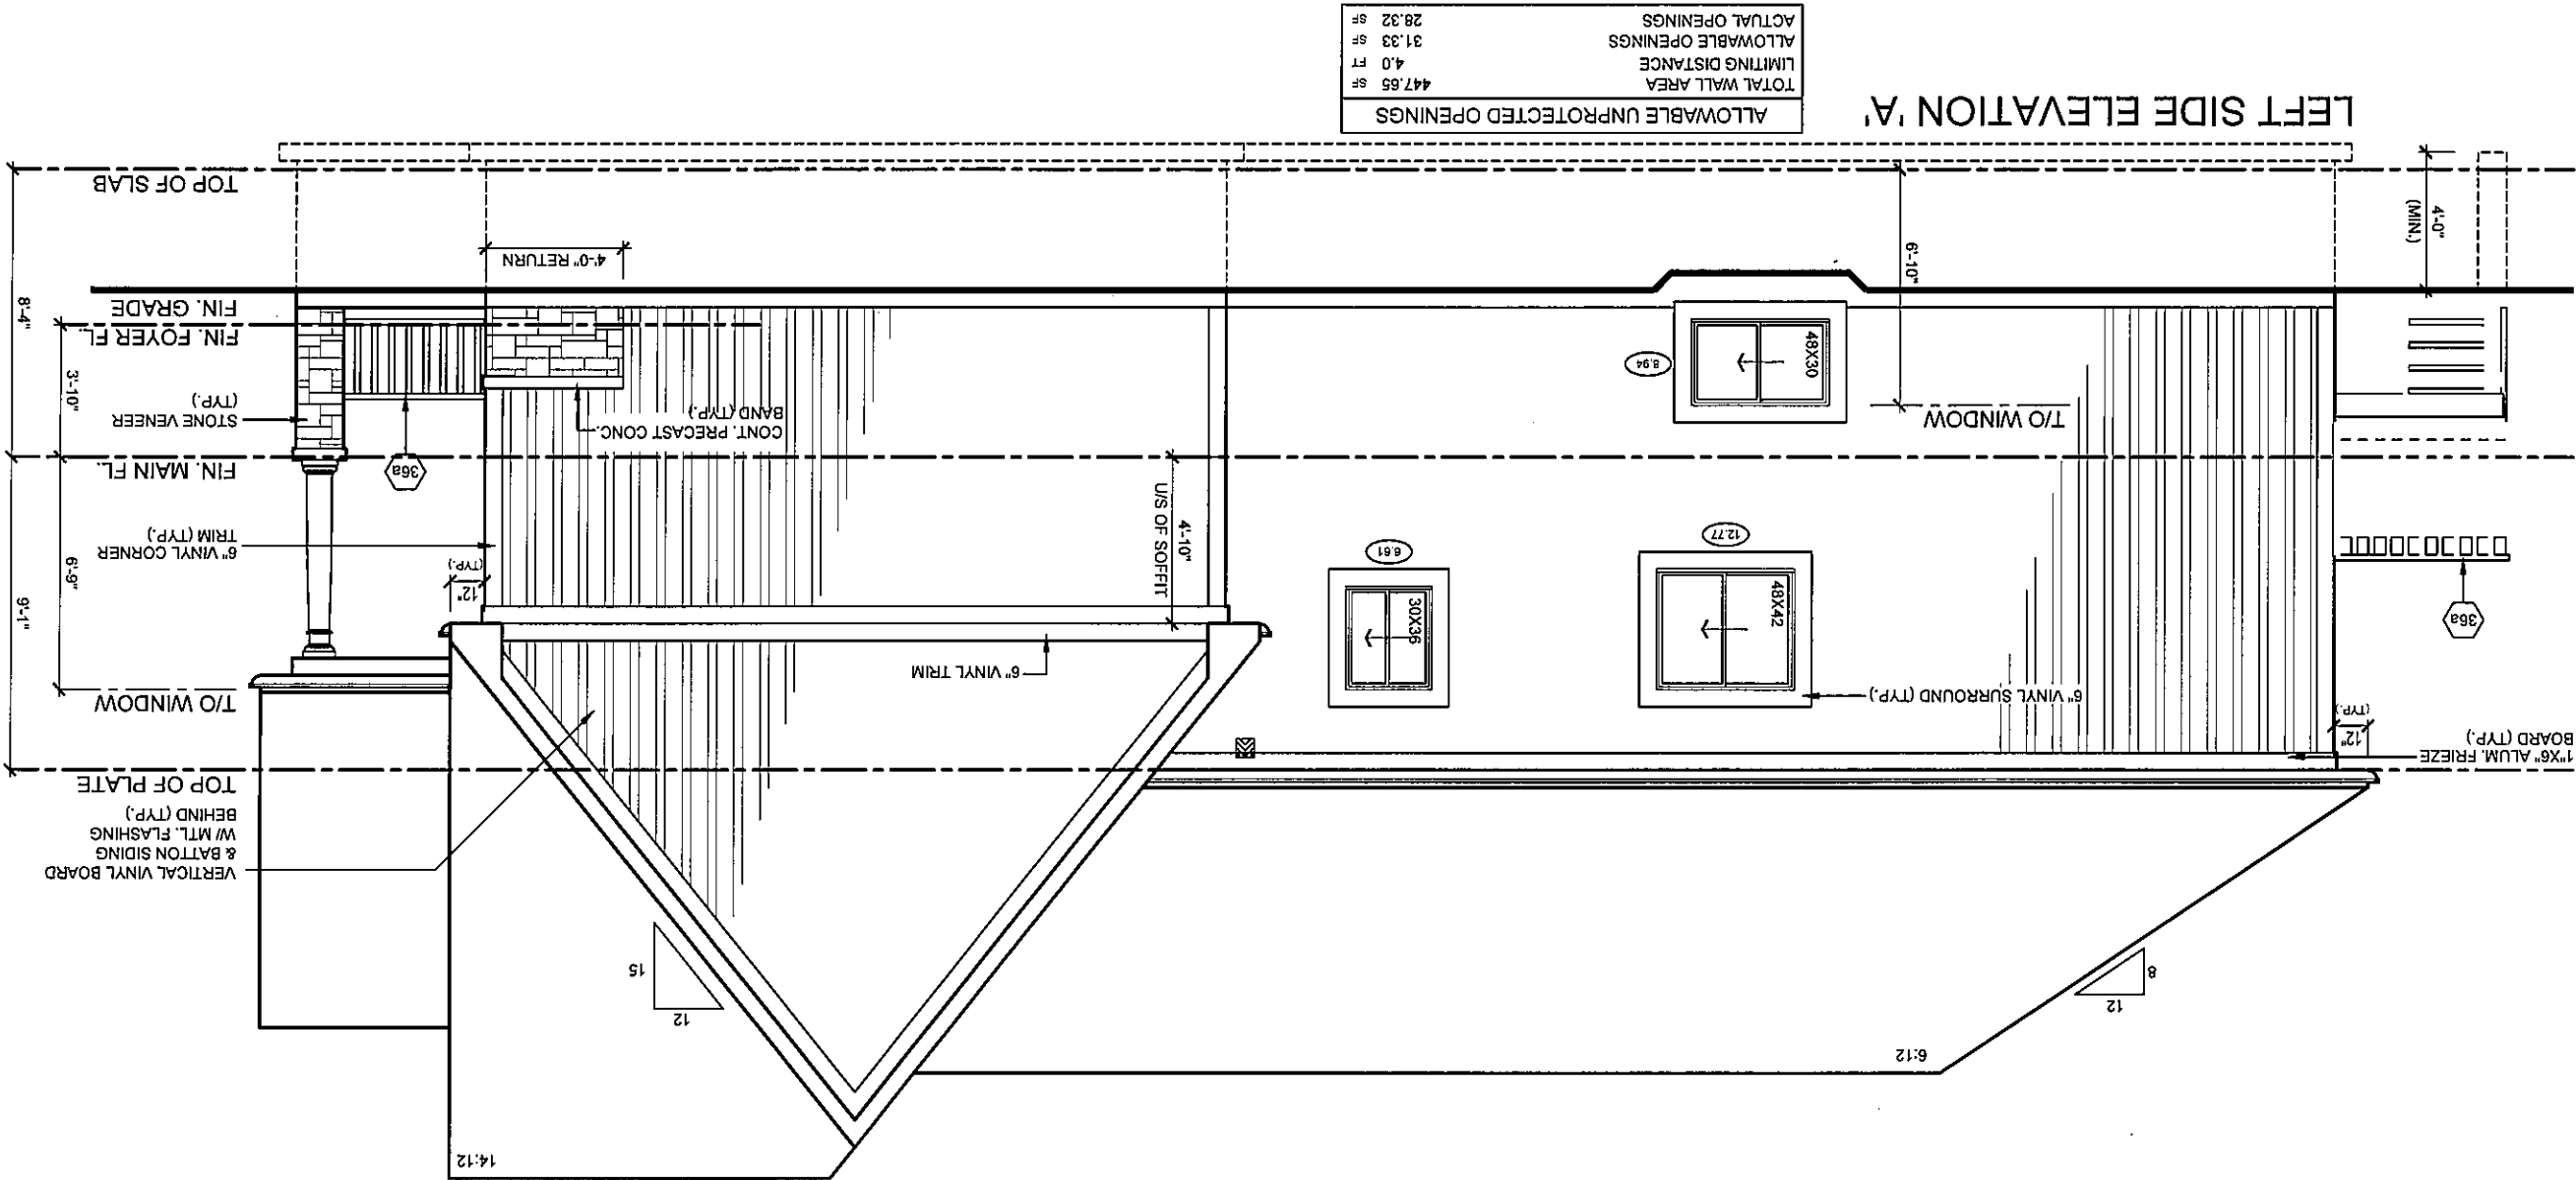

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Authority is not responsible in any way for working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

1. THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

1. DESIGN CONSULTANT HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THESE PLANS. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

FIRM BCIN: 26995

DATE: OCTOBER 19, 2015

SIGNATURE:

No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC

SCALE
3/16" = 1'0"


PROJECT NUMBER
14093

PAGE
A7

MODEL
40-2

CLIENT
ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO


FILE C:_RN_Standards\CA 2015\template\publish_143481\4093-40-2-FINAL.dwg Plotted: Oct 19, 2015 By: Aithunt

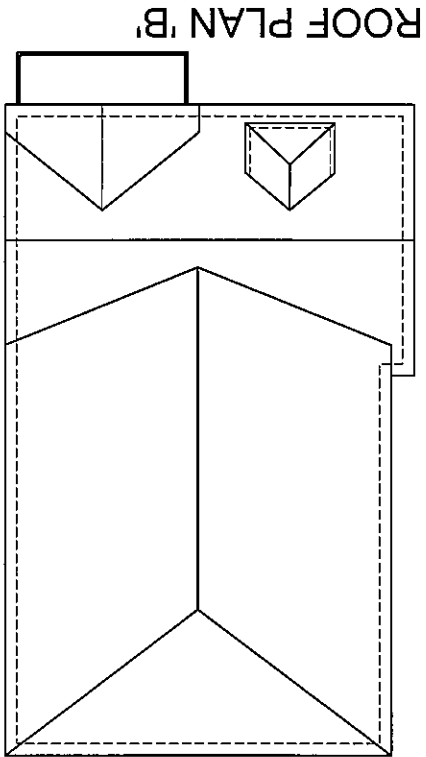

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"X4" SPF @ 24" o.c. WITH A 2"X4" SPF VERTICAL POST TO THE TRUSS UNDER. AT EACH CROSS POINT, POSTS LONGER THAN 6' TO BE Laterally Braced so that the distance between end points & between rows of bracing does not exceed 6'.

REFER TO TRUSS
DRAWINGS FOR
APPROVED TRUSS
LAYOUT.

DORMER FRAMING
CONV. FRAMING
33

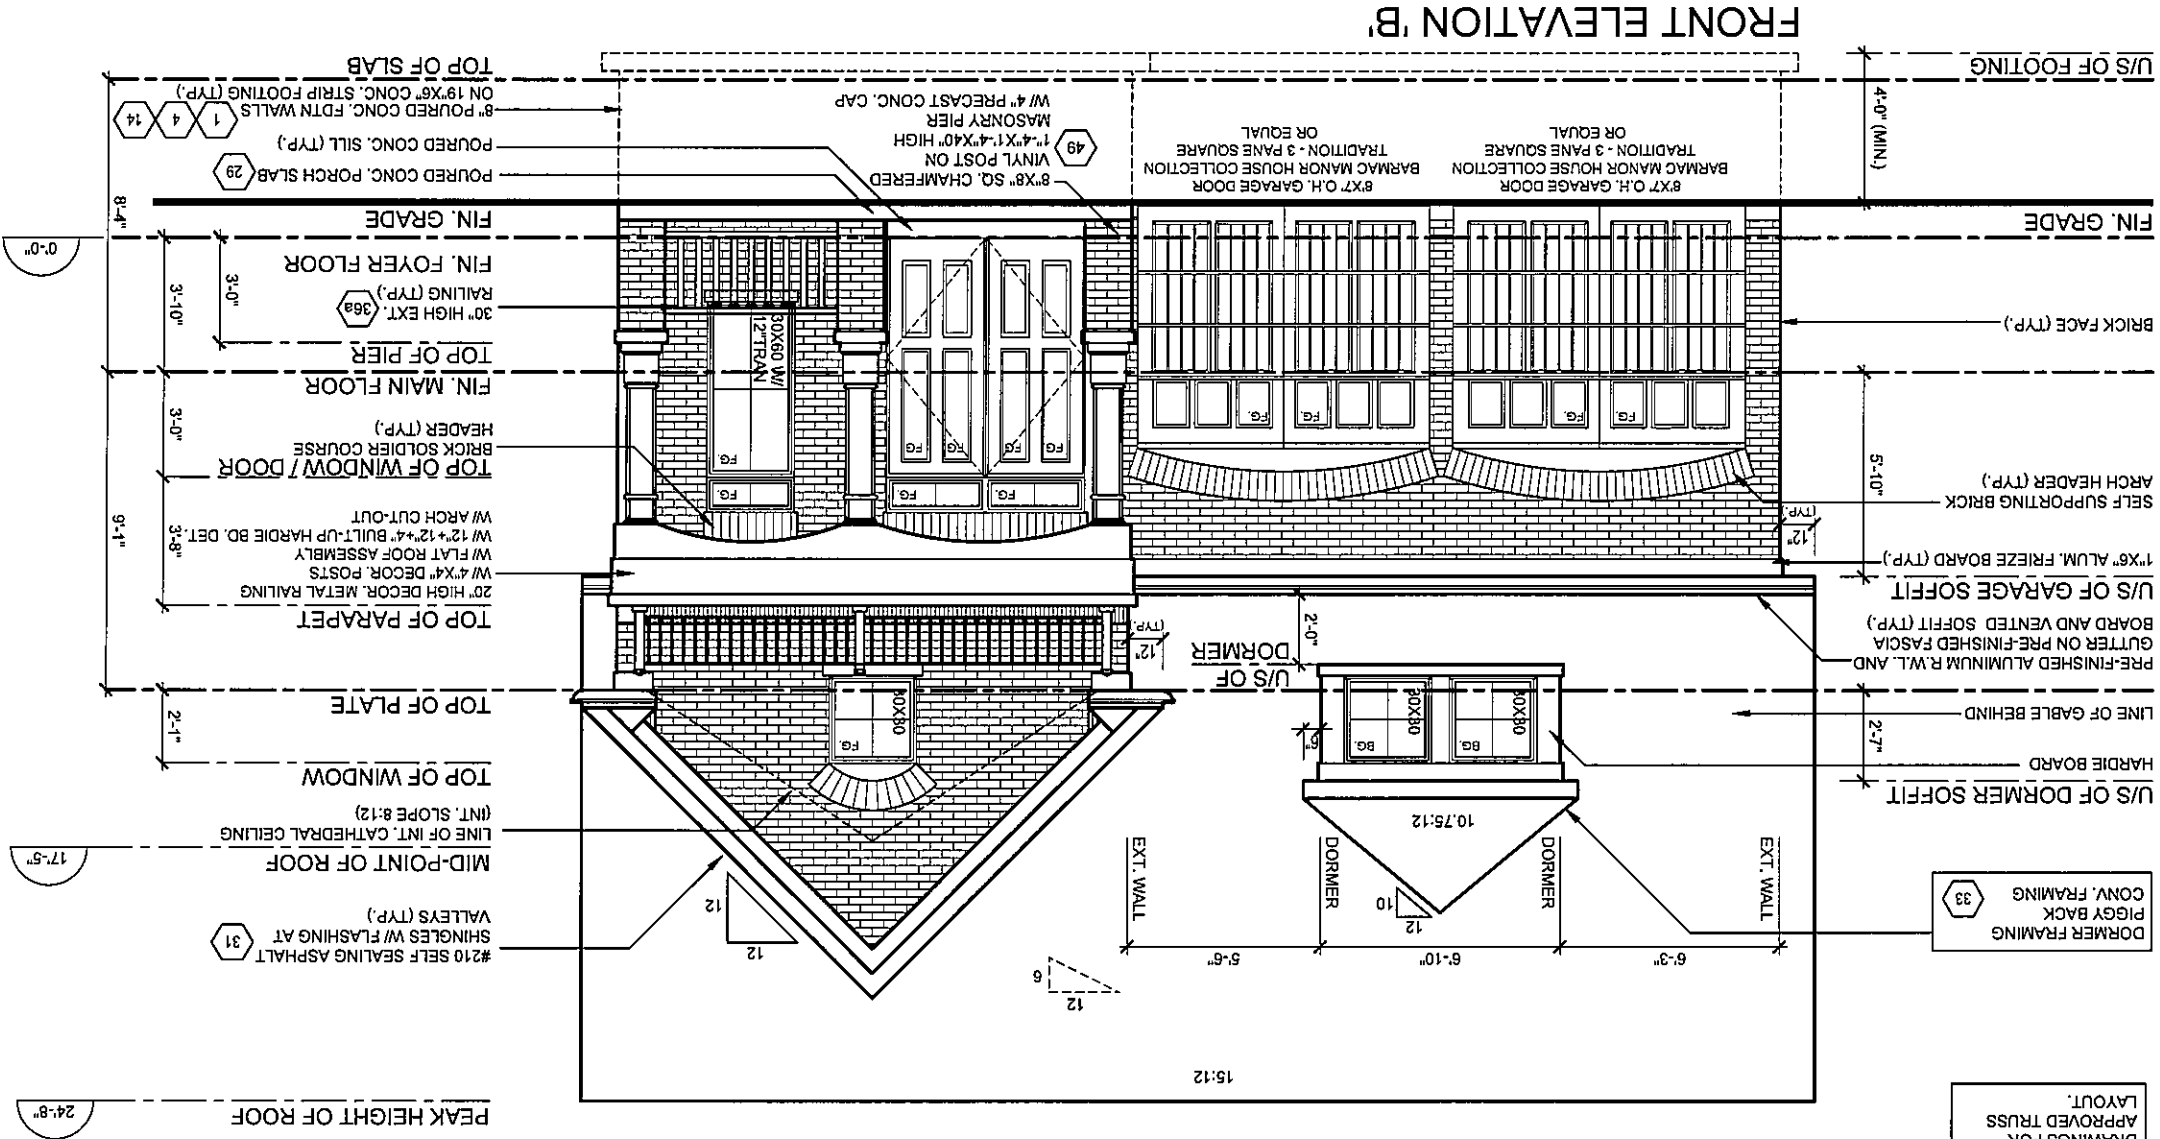

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Council Architect is not responsible in any way for obtaining or applying site (zoning) plans or for any other matters relating to the building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.



RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449

ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.
REVISED: JANUARY 09, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

1. DESIGN CONCEPTS THAT HAVE BEEN REVIEWED AND TAKE DESIGN UNDER DIVISION C, PART 1, SUBSECTION 2.4. OF THE BUILDING ACT, CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015

SIGNATURE:

MODEL

40-2

CLIENT

No. ISSUED OR REVISION COMMENTS
1. UPDATED TO OBC 2012 - 2015 ENACTMENT

DATE
OCT. 19/15

DWN CHK
- NC

SCALE
3/16" = 1'0"


PROJECT NUMBER
14093

PAGE

A8

RIGHT SIDE ELEVATION 'B'


TOTAL WALL AREA	744.74	SF
LIMITING DISTANCE	4.0	FT
ALLOWABLE OPENINGS	52.13	SF
ACTUAL OPENINGS	51.13	SF

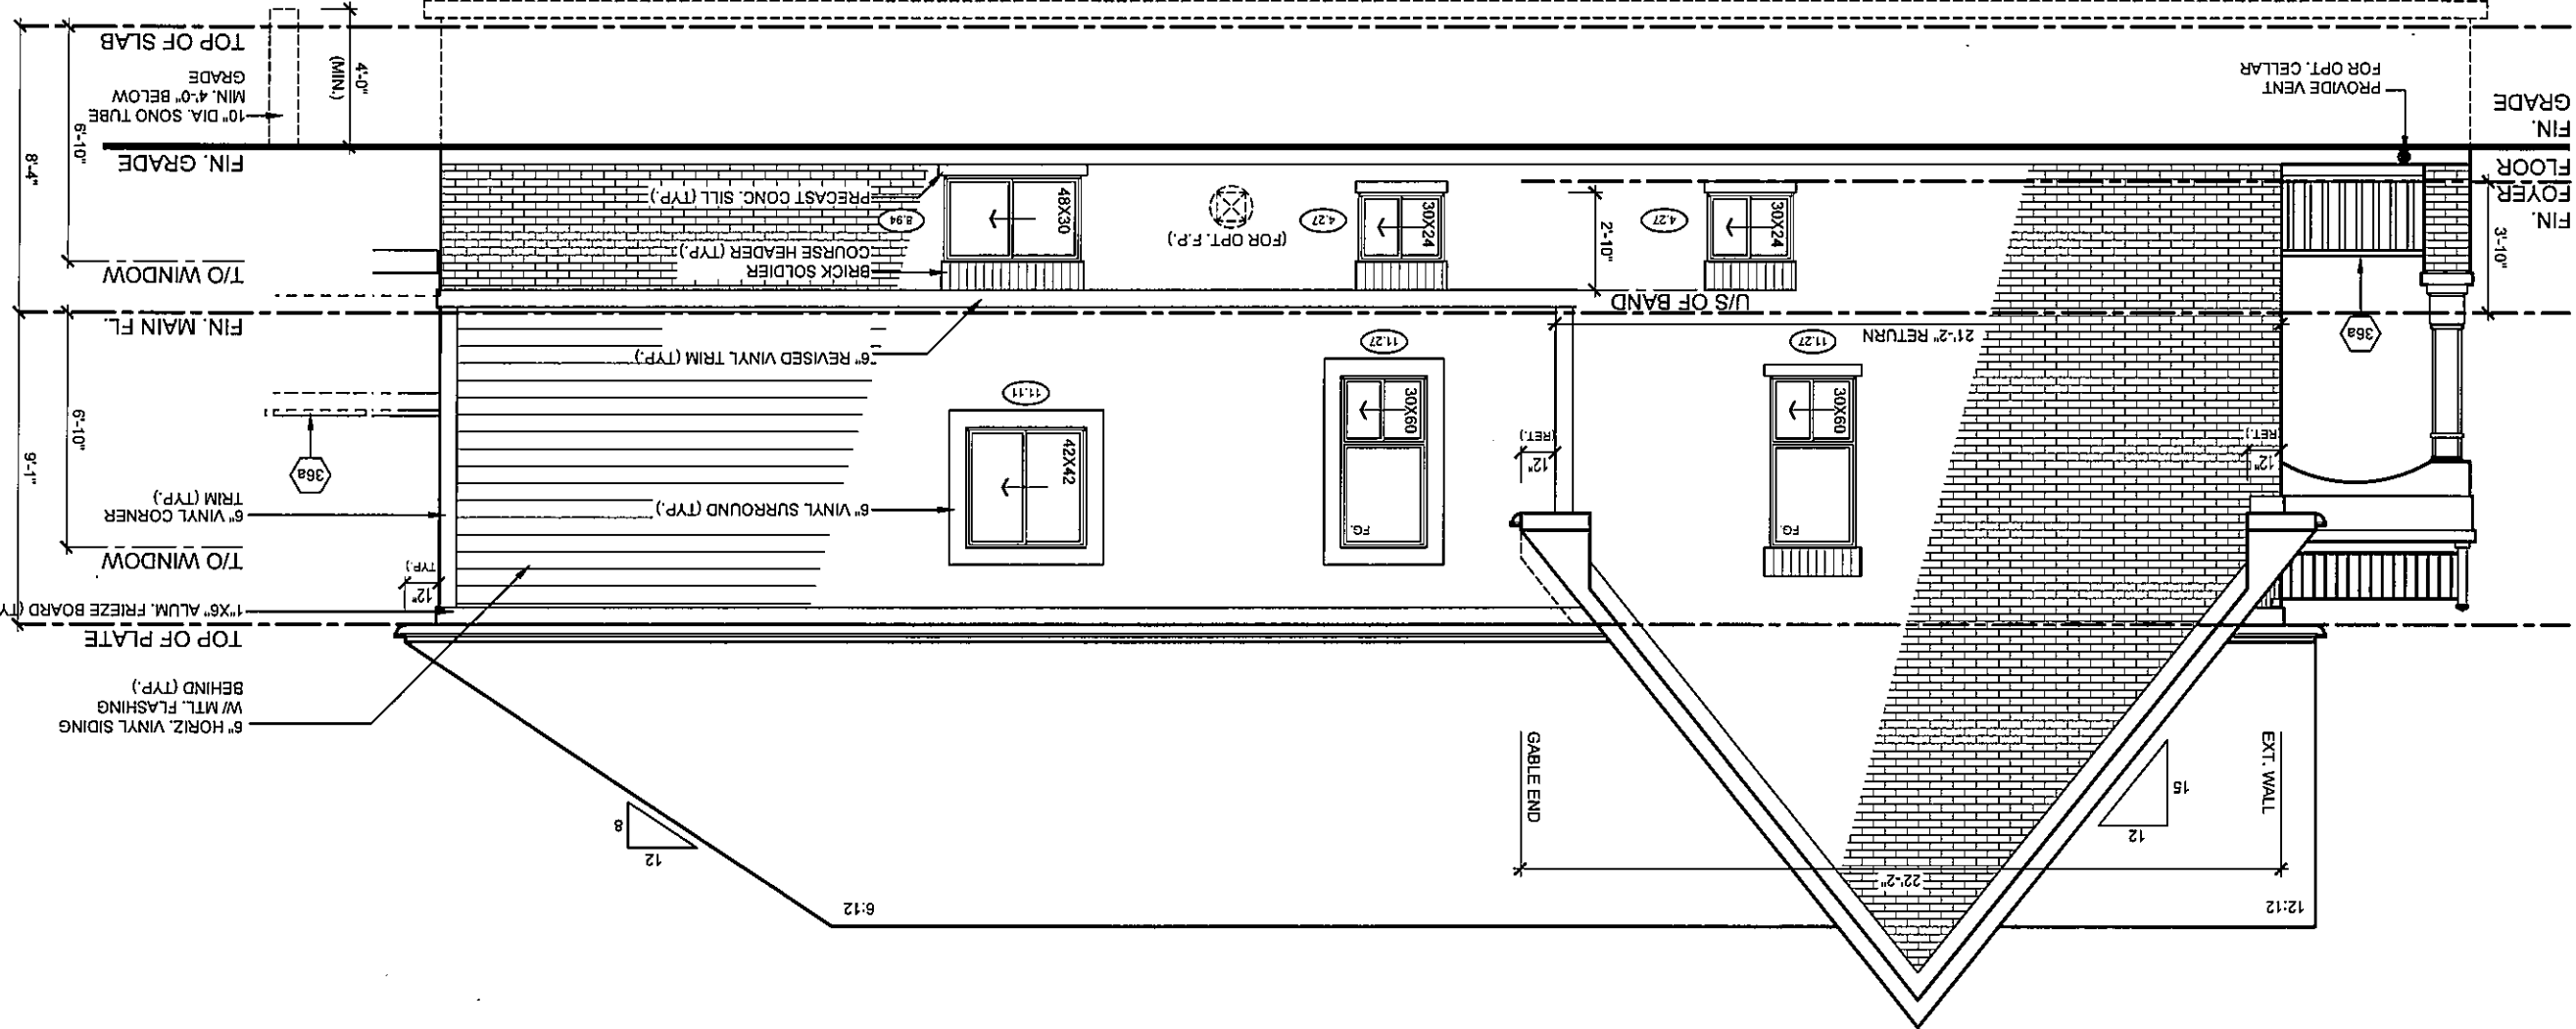

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for existing or existing site (existing) plans or existing or existing site (existing) plans or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

MODEL	40-2	No. ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
CLIENT	ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO	1. UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	3/16" = 1'0"
						PROJECT NUMBER 14093
						PAGE A9



FN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5448


THESE DRAWINGS ARE NOT TO BE SCALED
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO FN DESIGN LTD.
REVISED: JANUARY 08, 2015 - FN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J

I, NELSON GUNJA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THESE DRAWINGS. I AM A REGISTERED ARCHITECT UNDER DIVISION C, PART 3, SUBSECTION 32.2.1 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORY.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015


SIGNATURE:

File C:_RN_Standard\CA 2016\template\publish_14348114093-40-2-FINAL.dwg Plotted: Oct 19, 2015 By: Athul

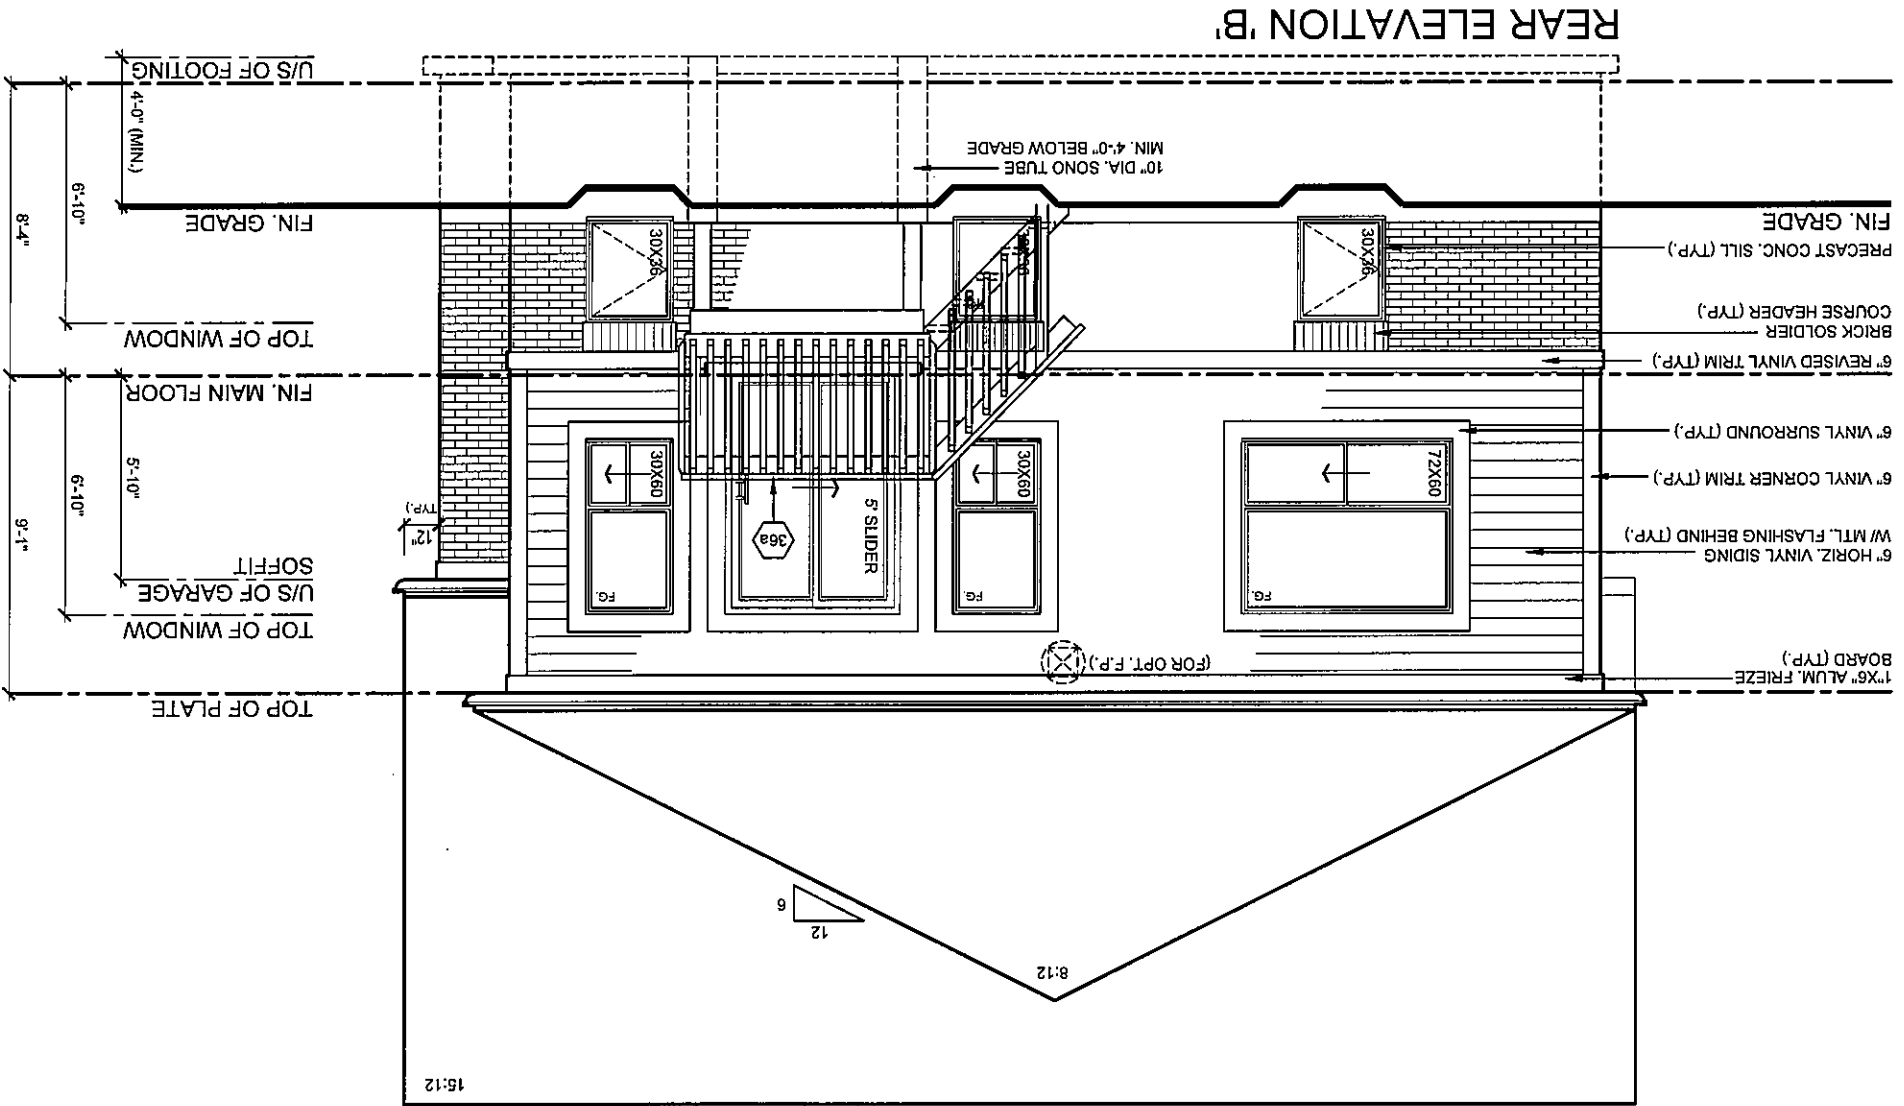


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.


 RN design <i>Imagine • Inspire • Create</i> TEL: (905) 738-3177 FAX: (905) 738-5449	MODEL	40-2		No. ISSUED OR REVISION COMMENTS		DATE	DWN	CHK	SCALE
	CLIENT	ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO		1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	3/16" = 1'0"
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. REVISED: JANUARY 06, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J	I HEREBY CERTIFY THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ACCURACY AND COMPLETENESS OF THESE DRAWINGS UNDER DIVISION C, PART 3, SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CODES.		QUALIFIED DESIGNER BCIN: 21032 FIRM BCIN: 26995		SIGNATURE:		PAGE		
			DATE: OCTOBER 19, 2015				14093 A10		

LEFT SIDE ELEVATION 'B'

ALLOWABLE UNPROTECTED OPENINGS	
TOTAL WALL AREA	447.65 SF
LIMITING DISTANCE	4.0 FT
ALLOWABLE OPENINGS	31.33 SF
ACTUAL OPENINGS	28.32 SF

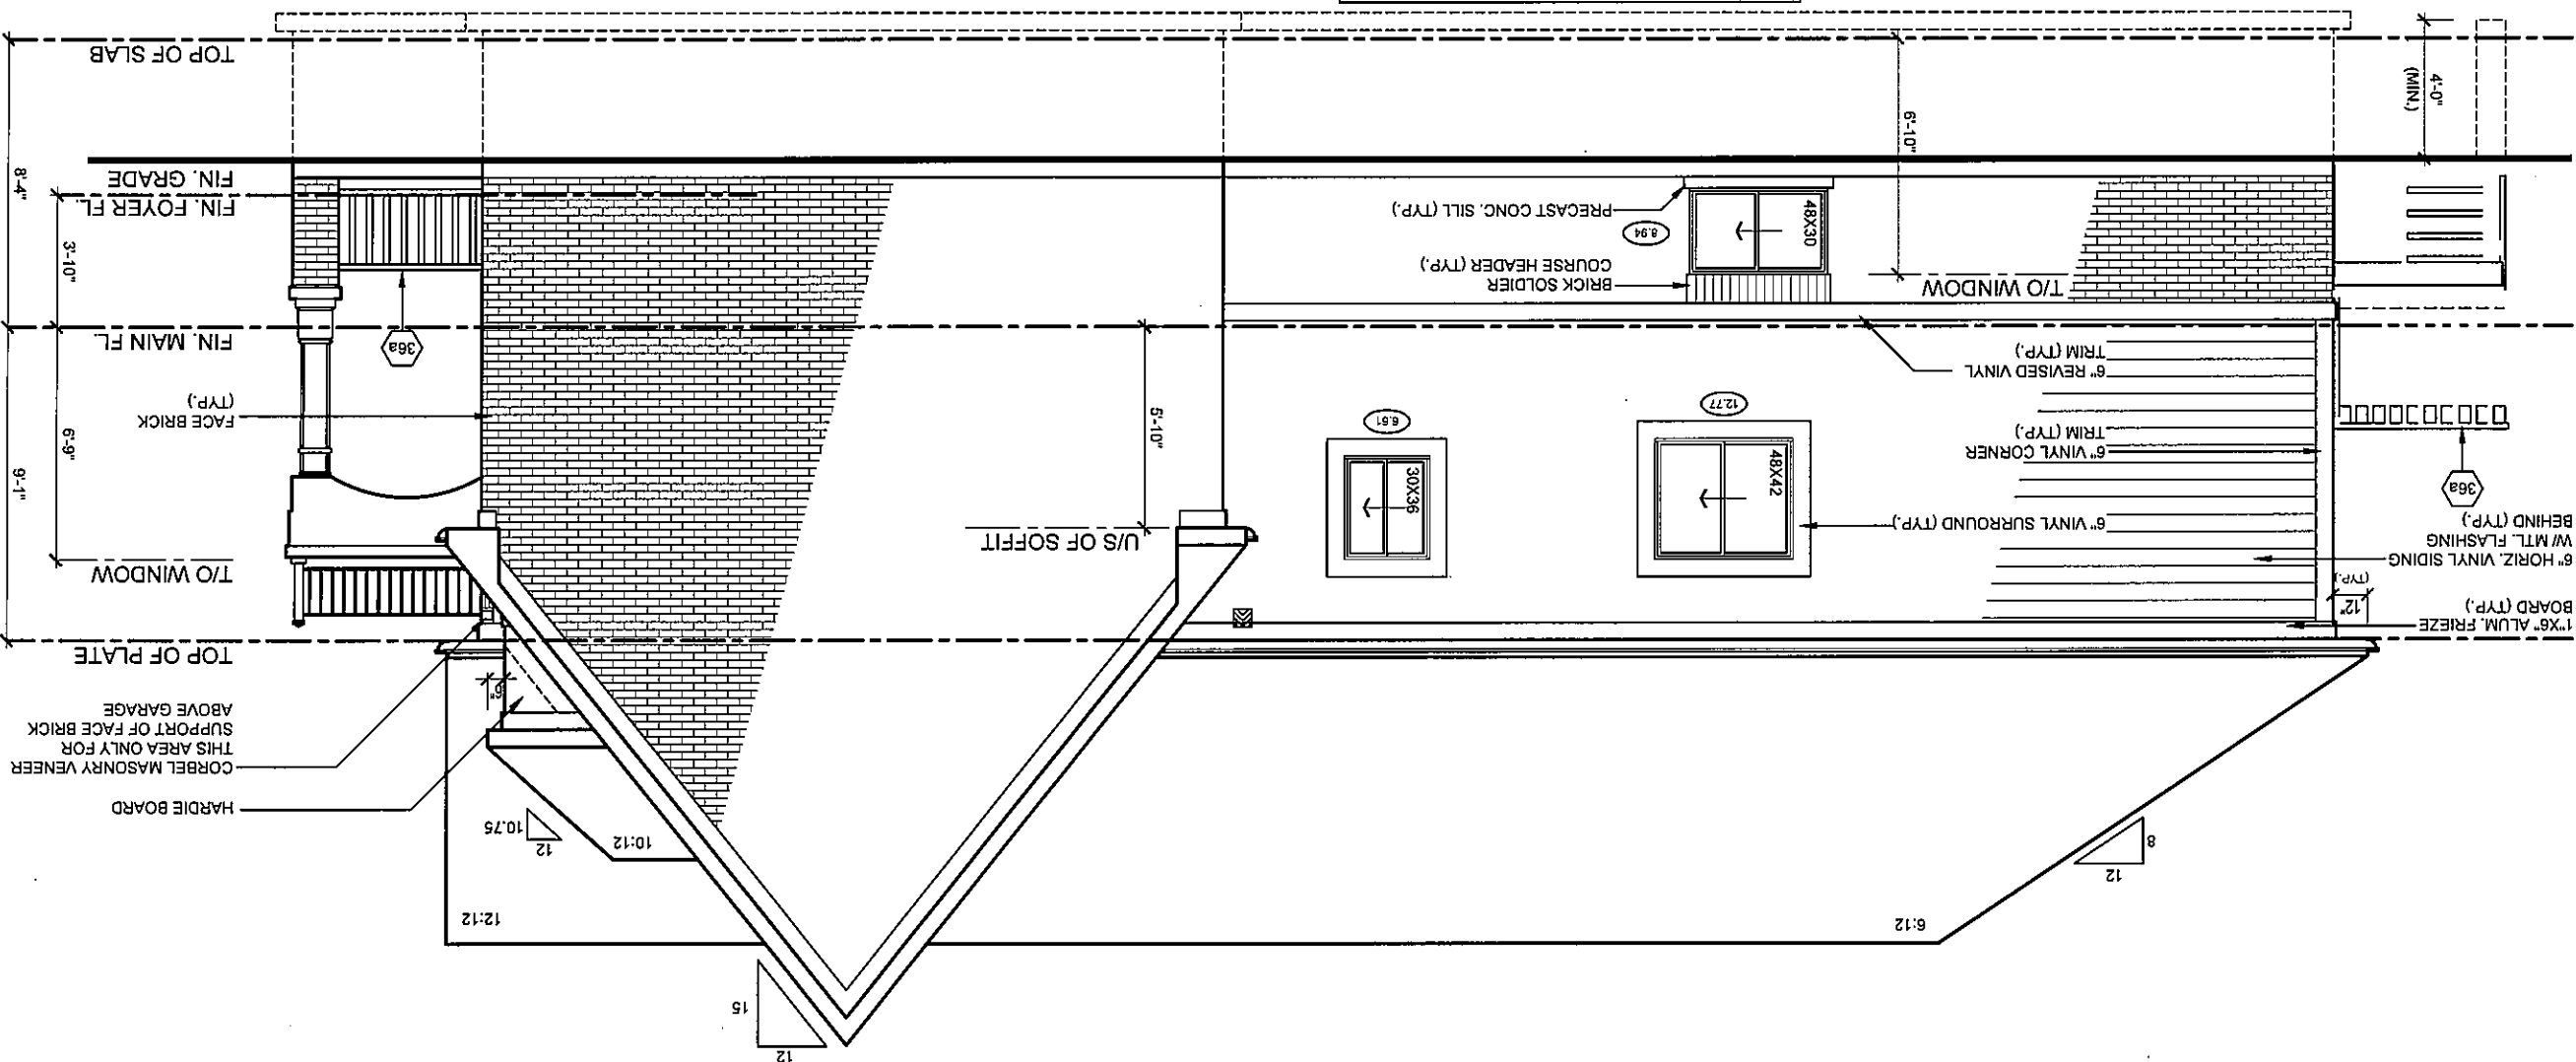

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code provisions. Plans for a house can be properly built or located on its lot.

 PN design Imagine • Inspire • Create TEL (905) 738-3177 FAX (905) 738-5449					
MODEL		40-2			
CLIENT		ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO			
No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	3/16" = 1'0"
					PROJECT NUMBER
					14093
					PAGE
					A11

CONSTRUCTION NOTES:

COMPLIANCE PACKAGE J - O.B.C. 2012 - 2015 ENACTMENT

(UNLESS OTHERWISE NOTED)
-ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION.
-THERMAL RESISTANCE GIVEN FIRST IN THERMAL FOLLOWED BY METRIC.
-FOOTINGS / SLABS:
O.B.C. 9.15.3.
-BASED ON 16" (14.9mm) MAX. SUPPORTED JOIST LENGTH
-MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
-SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10.9psi (75kPa) BEARING CAPACITY
-FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT)

TYPICAL STRIP FOOTING:

1 TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

O.B.C. 9.15.3.5.
-FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
-1-STOREY - 13" X 4" (330mm X 100mm)
-2-STOREY - 19" X 6" (485mm X 155mm)
-3-STOREY - 26" X 9" (660mm X 230mm)

SIDING-

-1-STOREY - 10" X 4" (255mm X 100mm)
-2-STOREY - 14" X 4" (340mm X 100mm)
-3-STOREY - 18" X 5" (460mm X 130mm)

2 TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

O.B.C. 9.15.3.6.
-1-STOREY MASONRY - 16" X 4" (410mm X 100mm)
-1-STOREY STUD - 12" X 4" (305mm X 100mm)
-2-STOREY MASONRY - 26" X 9" (650mm X 230mm)
-2-STOREY STUD - 18" X 5" (450mm X 130mm)
-3-STOREY MASONRY - 36" X 14" (900mm X 360mm)
-3-STOREY STUD - 24" X 8" (600mm X 200mm)

3 STEP FOOTING:

O.B.C. 9.15.3.9.
-23.5/8" (600mm) MAX. VERTICAL RISE & 23.5/8" (600mm) MIN. HORIZONTAL RUN.

4 DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3.
-4" (100mm) MIN. DIA. Laid ON UNDISTURBED OR WELL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF F.R. SLAB.
-COVER TOP & SIDES OF TILE OR PIPE W/ 5/7/8" (150mm) OF CRUSHED STONE OR OTHER COARSE CLEAN GRANULAR MATERIAL.
-TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

5 BASEMENT SLAB:

O.B.C. 9.13. & 9.14.
-3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-4" (100mm) OF COARSE GRANULAR MATERIAL -PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-R10 (RS1 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. 9.8-12-2.1.1.6 (5))
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. 9.8-9)

50 SLAB ON GROUND:

-3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-R10 (RS1 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE.
-4" (100mm) OF COARSE GRANULAR MATERIAL -PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C. 9.31.4.4.
-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. 9.8-9)

6 GARAGE SLAB / EXTERIOR SLAB:

-4" (100mm) CONCRETE SLAB
-460psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.4.
-6" X 6" (W2) X W 2.9" WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB -4" (100mm) OF COARSE GRANULAR MATERIAL
-ANY FILL PLACED UNDER SLAB, OTHER THAN COARSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

7 PILASTERS:

O.B.C. 9.15.5.3.
-CONCRETE NIB - 4" X 12" (100mm X 300mm)
-BLOCK NIB - 4" X 12" (100mm X 300mm) BOUNDED & TIED TO WALL AS PER O.B.C. 9.20.11.2. TOP 7/7/8" (200mm) SOLID.
OR

BEAM POCKET
-4" (100mm) RND FDN. WALL W/ WIDTH TO MATCH BEAM SIZE
-1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.2)
STRUCTURAL COLUMNS

SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4kPa).

8 STEEL PIPE COLUMN:

O.B.C. 9.15.3.4. & 9.17.3.
-FIXED COLUMN
-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS
-FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mm 100mm 6.35mm) STEEL BTM. PLATE
-FOR WOOD BEAMS, MIN. 4"x4"x1/4" (100mm 100mm 6.35mm) STEEL TOP & BTM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF 85MM
-ADJUSTABLE COLUMNS TO CONFORM TO CAN/CSG-2.2M WHERE IMPOSED LOAD DOES NOT EXCEED 36 kN (O.B.C. 9.17.3.4)
COL. SPACING:
2 STOREY
-MAX. 9'-10" (2977mm)
-34" X 34" X 1/8" (860mm 860mm 400mm)
-44" X 44" X 21" (1120mm 1120mm 530mm)
-MAX. 16'-0" (4880mm)
3 STOREY
-MAX. 9'-10" (2977mm)
-40" X 40" X 1/8" (1010mm 1010mm 480mm)
-MAX. 16'-0" (4880mm)
-51" X 51" X 24" (1295mm 1295mm 610mm)
-WHERE COL. SITS ON FDN. WALL, USE 4" X 8" X 5/8" (100mm 200mm 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

WOOD COLUMN:

O.B.C. 9.17.4.1.
-5 1/2" X 5 1/2" (140mm X 140mm) SOLID WOOD COLUMN.
-METAL SHOE ANCHORED TO FOOTING
-25" X 25" X 12" (640mm 640mm 300mm) CONC. PAD (1 FLOOR SUPPORTED W/ 9'-10" COL. SPACING)
-34" X 34" X 14" (860mm 860mm 360mm) CONC. PAD (2 FLOORS SUPPORTED W/ 9'-10" COL. SPACING)

10 BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)

-2"x8"x12" LEDGER BOARD FASTENED W/ 2/12" ANCHOR BOLTS @ 4" O.C.
-WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11 WHERE REQUIRED TO OBTAIN 6" SEPARATION DISTANCE
BETWEEN ADJACENT BEAMS

BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM)
-12"x11"x5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2- 1/2"x8"x8" ANCHOR BOLTS.

14 FOUNDATION WALL:

O.B.C. 9.15.4.2.
-FOR WALLS NOT EXCEEDING 9'-10" (3000mm) IN LATERALLY SUPPORTED HEIGHT.
-8" (200mm) SOLID 2200psi (15MPa) CONCRETE
-MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
-FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATERALLY SUPPORTED HEIGHT.

WALL ASSEMBLIES:

O.B.C. 9.15.4.7.
-WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
-TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7/7/8" (200mm) VERTICALLY O.C. & 2'-11" (900mm) HORIZONTALLY
-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK
DAMP-PROOFING & WATERPROOFING:
-DAMP-PROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 4'-0" (1.20m) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1. (2) (3) (4)
-FINISHED BASEMENTS SHALL HAVE INTERIOR DAMPROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3 (3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMPROOFING.

140 FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

-2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING)
-3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING)
-4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING)
-BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL.
-BARS TO HAVE MIN. 2' (600mm) CONCRETE COVER
-BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

15 FRAME WALL CONSTRUCTION:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RS1 3.87) INSULATION ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. 9.23.3. WALL = EMBT (SIC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:
-REPLACE R22 (RS1 3.87) INSULATION WITH R22 (RS1 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE 'X' GYPSUM BOARD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):
REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURERS SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

150 ALTERNATE FRAME WALL CONSTRUCTION:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-1-1/2" (38mm) RB (RS1 1.41) RIGID INSULATION W/ TAPERED JOINTS (O.B.C. 9.27.3.4)
-8RACE W/ CONT. 1/6 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS
-R14 (RS1 2.46) INSULATION ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 9.23.3. WALL = EMBT (SIC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RS1 2.46) INSULATION WITH R14 (RS1 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURERS SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID INSULATION

150 FRAME WALL CONSTRUCTION @ GARAGE

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.1)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 9.23.3. WALL = EMBT (SIC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.
REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):
REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURERS SPECIFICATIONS).
OR
-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

16 BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.
-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5/7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SITS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
-MIN. R22 (RS1 3.87) INSULATION ZONE 1, O.B.C. 12.1.1.2.A)
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. 9.23.3. WALL = EMBT (SIC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-REPLACE R22 (RS1 3.87) INSULATION WITH R22 (RS1 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.
O.B.C. 9.23.
-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS

160 ALTERNATE BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.
-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
-BASE FLASHING UP TO 5/7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SITS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1-1/2" (38mm) RB (RS1 1.41) RIGID INSULATION W/ TAPERED JOINTS (O.B.C. 9.27.3.4)
-2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS
-8RACE W/ CONT. 1/6 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR
-CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL
-R14 (RS1 2.46) INSULATION
-CONTINUOUS AIR/VAPOR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. 9.23.3. WALL = EMBT (SIC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6. BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RS1 2.46) INSULATION WITH R14 (RS1 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

CLIENT SPECIFIC REVISIONS

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

Imagine - Inspire - Create
TEL: (905) 738-3177
FAX: (905) 738-5449



ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO


REVISIONS: JANUARY 08, 2015 - RN STAFF
IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J
CLIENT SPECIFIC REVISIONS

REGIONAL COUNCIL REQUIRE THAT I HAVE REVIEWED AND TAKEN DESIGN UNDER DIVISION C PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 19, 2015

SIGNATURE:

D1

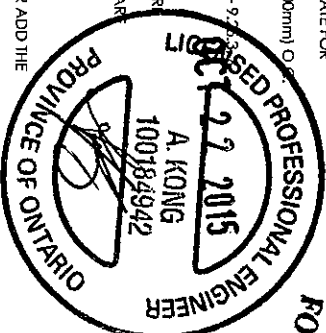

FOR STRUCTURAL ONLY

17) INTERIOR STUD WALLS:

O.B.C. 9.19.23.10.1.
-2" X 4" (38mmx 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

18) BEARING STUD WALL (BASEMENT):

-2" X 4" (38mmx 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DBL 2" X 4" OR 2" X 6" TOP PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C.
-FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB

19) PARTY WALL - BLOCK:

O.B.C. SB-3 WALL = B66 (STC = 57, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS
TO THE U/S OF ROOF DECK
-SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/
MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CALKED TO PREVENT
SMOKE PASSAGE
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES
-2" X 2" (38mmx 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH
SIDES
-ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE
CAVITY.
-7-1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-5/8" GYPSER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER
O.B.C. 9.10.9.9.1) & TABLE 2.1.1, SB-2
-ACoustICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
PARTY WALL - BLOCK (AGAINST GARAGE):
O.B.C. SB-3 WALL = B86 (STC = 51, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.
& 9.25.4.
-2" X 4" (38mmx 89mm) WOOD STRAPPING @ 16" (400mm) O.C.
-R20 (R3 3.87) RIGID INSULATION
-7-1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN
HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
REQ. INSULATION VALUES:
INSULATION VALUES PROVIDED BY CAN/CSA-F280-M90
-RIGID INSULATION = 20.00
-LOW DENSITY CONCRETE BLOCK = 1.70
-WOOD FRAME W/ GYPSUM = 2.22
-AIR FILM - MOVING = 0.68
-AIR FILM - STILL = 0.17
TOTAL "R" VALUE = 25.27

19b) FIREWALL:

O.B.C. 9.10.11.1 & 3.1.10. & SB-3 WALL = B66 (STC = 57, FIRE = 2 HR)
-ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING
AREA. O.B.C. 13.2.2.4.7.
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS
-2" X 2" (38mmx 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES
OF WALL
-SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
-7-1/2" (190mm) CONC. BLOCK, MIN. 2 HR. FIRE-RESISTANT RATING
-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
-5/8" GYPSER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER
O.B.C. 9.10.9.9.1) & TABLE 2.1.1, SB-2
-ACoustICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
-PROVIDE FAST FASCIA @ EAVES W/ BRICK CORRELATING
-THROUGH 5-7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/
-FIREWALL FLASHING PER O.B.C. 3.1.10.4.11)
-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER
THAN 9'-10" (3m), WALL NEEDED NOT EXTEND FAST UPPER ROOF SURFACE PER
O.B.C. 3.1.10.4.12)

20) PARTY WALL - FOUNDATION:

O.B.C. 9.15.4.2.
-7-7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 220psi (15MPa)
COMPRESSIVE STRENGTH AFTER 28 DAYS
-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2
21) PARTY WALL - WOOD STUD:
O.B.C. SB-3 WALL = W13g (STC = 57, FIRE = 1 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF
FOOTINGS TO THE U/S OF ROOF DECK
-2 ROWS 2"x4" (38mmx 89mm) STUDS @ 16" (400mm) O.C. W/ SEPARATE
2" X 4" (38mmx 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4"
 (38mmx 89mm) TOP PLATES
-SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF
90% OF THE CAVITY.
-5/8" (16mm) TYPE "X" GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED &
FILLED.
-ACoustICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
FOR 2 FLOORS SUPPORTED ABOVE 2" X 4" (38mmx 89mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE 2" X 6" (38mmx 140mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.

22) GARAGE WALL & CEILING:

O.B.C. 9.10.9.16.13)
-1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING
BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (R3 3.87) INSULATION IN WALLS.
-R31 (R5 4.1) INSULATION IN CEILINGS W/ FLOOR ABOVE
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.
9.25.3. & 9.25.4. FOR FLOOR ABOVE.
-INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN.
REQUIRED GARAGE AREA (REFER TO MUNICIPAL STANDARDS).
-1/2" (12.7mm) GYPSUM BOARD
-ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH
4-3 1/4" (82mm) TOE NAILS
-BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR
RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7/8" (200mm) O.C.
WALLS ADJACENT TO ATTIC SPACE:
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.
9.25.3. & 9.25.4.
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C.
-R22 (R3 3.87) INSULATION
-1/2" (12.7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING
ON ATTIC SIDE
-ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.25.12.1.

23) DOUBLE VOLUME WALLS:

O.B.C. 9.23.10.1.
-3/8" (9.5mm) PLYWOOD, 3/8" WATERBOARD OR 1/2" (12.7mm) TOE NAIL
-REFER TO PLAN FOR STUD SPECIFICATION
-STUDS FASTENED AT TOP & BOTTOM WITH 3/4" (19mm) TOE NAIL
-DOUBLE TOP PLATES FASTENED TOGETHER
7/8" (200mm) O.C.
-SOLID BRIDGING AT 3'-11" (1200mm) O.C.
-MIN. R22 (R3 3.87) INSULATION (ZONE 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100, 101, 102, 103, 104, 105, 106, 107, 108, 109, 110, 111, 112, 113, 114, 115, 116, 117, 118, 119, 120, 121, 122, 123, 124, 125, 126, 127, 128, 129, 130, 131, 132, 133, 134, 135, 136, 137, 138, 139, 140, 141, 142, 143, 144, 145, 146, 147, 148, 149, 150, 151, 152, 153, 154, 155, 156, 157, 158, 159, 160, 161, 162, 163, 164, 165, 166, 167, 168, 169, 170, 171, 172, 173, 174, 175, 176, 177, 178, 179, 180, 181, 182, 183, 184, 185, 186, 187, 188, 189, 190, 191, 192, 193, 194, 195, 196, 197, 198, 199, 200, 201, 202, 203, 204, 205, 206, 207, 208, 209, 210, 211, 212, 213, 214, 215, 216, 217, 218, 219, 220, 221, 222, 223, 224, 225, 226, 227, 228, 229, 230, 231, 232, 233, 234, 235, 236, 237, 238, 239, 240, 241, 242, 243, 244, 245, 246, 247, 248, 249, 250, 251, 252, 253, 254, 255, 256, 257, 258, 259, 260, 261, 262, 263, 264, 265, 266, 267, 268, 269, 270, 271, 272, 273, 274, 275, 276, 277, 278, 279, 280, 281, 282, 283, 284, 285, 286, 287, 288, 289, 290, 291, 292, 293, 294, 295, 296, 297, 298, 299, 300, 301, 302, 303, 304, 305, 306, 307, 308, 309, 310, 311, 312, 313, 314, 315, 316, 317, 318, 319, 320, 321, 322, 323, 324, 325, 326, 327, 328, 329, 330, 331, 332, 333, 334, 335, 336, 337, 338, 339, 340, 341, 342, 343, 344, 345, 346, 347, 348, 349, 350, 351, 352, 353, 354, 355, 356, 357, 358, 359, 360, 361, 362, 363, 364, 365, 366, 367, 368, 369, 370, 371, 372, 373, 374, 375, 376, 377, 378, 379, 380, 381, 382, 383, 384, 385, 386, 387, 388, 389, 390, 391, 392, 393, 394, 395, 396, 397, 398, 399, 400, 401, 402, 403, 404, 405, 406, 407, 408, 409, 410, 411, 412, 413, 414, 415, 416, 417, 418, 419, 420, 421, 422, 423, 424, 425, 426, 427, 428, 429, 430, 431, 432, 433, 434, 435, 436, 437, 438, 439, 440, 441, 442, 443, 444, 445, 446, 447, 448, 449, 450, 451, 452, 453, 454, 455, 456, 457, 458, 459, 460, 461, 462, 463, 464, 465, 466, 467, 468, 469, 470, 471, 472, 473, 474, 475, 476, 477, 478, 479, 480, 481, 482, 483, 484, 485, 486, 487, 488, 489, 490, 491, 492, 493, 494, 495, 496, 497, 498, 499, 500, 501, 502, 503, 504, 505, 506, 507, 508, 509, 510, 511, 512, 513, 514, 515, 516, 517, 518, 519, 520, 521, 522, 523, 524, 525, 526, 527, 528, 529, 530, 531, 532, 533, 534, 535, 536, 537, 538, 539, 540, 541, 542, 543, 544, 545, 546, 547, 548, 549, 550, 551, 552, 553, 554, 555, 556, 557, 558, 559, 560, 561, 562, 563, 564, 565, 566, 567, 568, 569, 570, 571, 572, 573, 574, 575, 576, 577, 578, 579, 580, 581, 582, 583, 584, 585, 586, 587, 588, 589, 590, 591, 592, 593, 594, 595, 596, 597, 598, 599, 600, 601, 602, 603, 604, 605, 606, 607, 608, 609, 610, 611, 612, 613, 614, 615, 616, 617, 618, 619, 620, 621, 622, 623, 624, 625, 626, 627, 628, 629, 630, 631, 632, 633, 634, 635, 636, 637, 638, 639, 640, 641, 642, 643, 644, 645, 646, 647, 648, 649, 650, 651, 652, 653, 654, 655, 656, 657, 658, 659, 660, 661, 662, 663, 664, 665, 666, 667, 668, 669, 670, 671, 672, 673, 674, 675, 676, 677, 678, 679, 680, 681, 682, 683, 684, 685, 686, 687, 688, 689, 690, 691, 692, 693, 694, 695, 696, 697, 698, 699, 700, 701, 702, 703, 704, 705, 706, 707, 708, 709, 710, 711, 712, 713, 714, 715, 716, 717, 718, 719, 720, 721, 722, 723, 724, 725, 726, 727, 728, 729, 730, 731, 732, 733, 734, 735, 736, 737, 738, 739, 740, 741, 742, 743, 744, 745, 746, 747, 748, 749, 750, 751, 752, 753, 754, 755, 756, 757, 758, 759, 760, 761, 762, 763, 764, 765, 766, 767, 768, 769, 770, 771, 772, 773, 774, 775, 776, 777, 778, 779, 780, 781, 782, 783, 784, 785, 786, 787, 788, 789, 790, 791, 792, 793, 794, 795, 796, 797, 798, 799, 800, 801, 802, 803, 804, 805, 806, 807, 808, 809, 810, 811, 812, 813, 814, 815, 816, 817, 818, 819, 820, 821, 822, 823, 824, 825, 826, 827, 828, 829, 830, 831, 832, 833, 834, 835, 836, 837, 838, 839, 840, 841, 842, 843, 844, 845, 846, 847, 848, 849, 850, 851, 852, 853, 854, 855, 856, 857, 858, 859, 860, 861, 862, 863, 864, 865, 866, 867, 868, 869, 870, 871, 872, 873, 874, 875, 876, 877, 878, 879, 880, 881, 882, 883, 884, 885, 886, 887, 888, 889, 890, 891, 892, 893, 894, 895, 896, 897, 898, 899, 900, 901, 902, 903, 904, 905, 906, 907, 908, 909, 910, 911, 912, 913, 914, 915, 916, 917, 918, 919, 920, 921, 922, 923, 924, 925, 926, 927, 928, 929, 930, 931, 932, 933, 934, 935, 936, 937, 938, 939, 940, 941, 942, 943, 944, 945, 946, 947, 948, 949, 950, 951, 952, 953, 954, 955, 956, 957, 958, 959, 960, 961, 962, 963, 964, 965, 966, 967, 968, 969, 970, 971, 972, 973, 974, 975, 976, 977, 978, 979, 980, 981, 982, 983, 984, 985, 986, 987, 988, 989, 990, 991, 992, 993, 994, 995, 996, 997, 998, 999, 1000, 1001, 1002, 1003, 1004, 1005, 1006, 1007, 1008, 1009, 1010, 1011, 1012, 1013, 1014, 1015, 1016, 1017, 1018, 1019, 1020, 1021, 1022, 1023, 1024, 1025, 1026, 1027, 1028, 1029, 1030, 1031, 1032, 1033, 1034, 1035, 1036, 1037, 1038, 1039, 1040, 1041, 1042, 1043, 1044, 1045, 1046, 1047, 1048, 1049, 1050, 1051, 1052, 1053, 1054, 1055, 1056, 1057, 1058, 1059, 1060, 1061, 1062, 1063, 1064, 1065, 1066, 1067, 1068, 1069, 1070, 1071, 1072, 1073, 1074, 1075, 1076, 1077, 1078, 1079, 1080, 1081, 1082, 1083, 1084, 1085, 1086, 1087, 1088, 1089, 1090, 1091, 1092, 1093, 1094, 1095, 1096, 1097, 1098, 1099, 1100, 1101, 1102, 1103, 1104, 1105, 1106, 1107, 1108, 1109, 1110, 1111, 1112, 1113, 1114, 1115, 1116, 1117, 1118, 1119, 1120, 1121, 1122, 1123, 1124, 1125, 1126, 1127, 1128, 1129, 1130, 1131, 1132, 1133, 1134, 1135, 1136, 1137, 1138, 1139, 1140, 1141, 1142, 1143, 1144, 1145, 1146, 1147, 1148, 1149, 1150, 1151, 1152, 1153, 1154, 1155, 1156, 1157, 1158, 1159, 1160, 1161, 1162, 1163, 1164, 1165, 1166, 1167, 1168, 1169, 1170, 1171, 1172, 1173, 1174, 1175, 1176, 1177, 1178, 1179, 1180, 1181, 1182, 1183, 1184, 1185, 1186, 1187, 1188, 1189, 1190, 1191, 1192, 1193, 1194, 1195, 1196, 1197, 1198, 1199, 1200, 1201, 1202, 1203, 1204, 1205, 1206, 1207, 1208, 1209, 1210, 1211, 1212, 1213, 1214, 1215, 1216, 1217, 1218, 1219, 1220, 1221, 1222, 1223, 1224, 1225, 1226, 1227, 1228, 1229, 1230, 1231, 1232, 1233, 1234, 1235, 1236, 1237, 1238, 1239, 1240, 1241, 1242, 1243, 1244, 1245, 1246, 1247, 1248, 1249, 1250, 1251, 1252, 1253, 1254, 1255, 1256, 1257, 1258, 1259, 1260, 1261, 1262, 1263, 1264, 1265, 1266, 1267, 1268, 1269, 1270, 1271, 1272, 1273, 1274, 1275, 1276, 1277, 1278, 1279, 1280, 1281, 1282, 1283, 1284, 1285, 1286, 1287, 1288, 1289, 1290, 1291, 1292, 1293, 1294, 1295, 1296, 1297, 1298, 1299, 1300, 1301, 1302, 1303, 1304, 1305, 1306, 1307, 1308, 1309, 1310, 1311, 1312, 1313, 1314, 1315, 1316, 1317, 1318, 1319, 1320, 1321, 1322, 1323, 1324, 1325, 1326, 1327, 1328, 1329, 1330, 1331, 1332, 1333, 1334, 1335, 1336, 1337, 1338, 1339, 1340, 1341, 1342, 1343, 1344, 1345, 1346, 1347, 1348, 1349, 1350, 1351, 1352, 1353, 1354, 1355, 1356, 1357, 1358, 1359, 1360, 1361, 1362, 1363, 1364, 1365, 1366, 1367, 1368, 1369, 1370, 1371, 1372, 1373, 1374, 1375, 1376, 1377, 1378, 1379, 1380, 1381, 1382, 1383, 1384, 1385, 1386, 1387, 1388, 1389, 1390, 1391, 1392, 1393, 1394, 1395, 1396, 1397, 1398, 1399, 1400, 1401, 1402, 1403, 1404, 1405, 1406, 1407, 1408, 1409, 1410, 1411, 1412, 1413, 1414, 1415, 1416, 1417, 1418, 1419, 1420, 1421, 1422, 1423, 1424, 1425, 1426, 1427, 1428, 1429, 1430, 1431, 1432, 1433, 1434, 1435, 1436, 1437, 1438, 1439, 1440, 1441, 1442, 1443, 1444, 1445, 1446, 1447, 1448, 1449, 1450, 1451, 1452, 1453, 1454, 1455, 1456, 1457, 1458, 1459, 1460, 1461, 1462, 1463, 1464, 1465, 1466, 1467, 1468, 1469, 1470, 1471, 1472, 1473, 1474, 1475, 1476, 1477, 1478, 1479, 1480, 1481, 1482, 1483, 1484, 1485, 1486, 1487, 1488, 1489, 1490, 1491, 1492, 1493, 1494, 1495, 1496, 1497, 1498, 1499, 1500, 1501, 1502, 1503, 1504, 1505, 1506, 1507, 1508, 1509, 1510, 1511, 1512, 1513, 1514, 1515, 1516, 1517, 1518, 1519, 1520, 1521, 1522, 1523, 1524, 1525, 1526, 1527, 1528, 1529, 1530, 1531, 1532, 1533, 1534, 1535, 1536, 1537, 1538, 1539, 1540, 1541, 1542, 1543, 1544, 1545, 1546, 1547, 1548, 1549, 1550, 1551, 1552, 1553, 1554, 1555, 1556, 1557, 1558, 1559, 1560, 1561, 1562, 1563, 1564, 1565, 1566, 1567, 1568, 1569, 1570, 1571, 1572, 1573, 1574, 1575, 1576, 1577, 1578, 1579, 1580, 1581, 1582, 1583, 1584, 1585, 1586, 1587, 1588, 1589, 1590, 1591, 1592, 1593, 1594, 1595, 1596, 1597, 1598, 1599, 1600, 1601, 1602, 1603, 1604, 1605, 1606, 1607, 1608, 1609, 1610, 1611, 1612, 1613, 1614, 1615, 1616, 1617, 1618, 1619, 1620, 1621, 1622, 1623, 1624, 1625, 1626, 1627, 1628, 1629, 1630, 1631, 1632, 1633, 1634, 1635, 1636, 1637, 1638, 1639, 1640, 1641, 1642, 1643, 1644, 1645, 1646, 1647, 1648, 1649, 1650, 1651, 1652, 1653, 1654, 1655, 1656, 1657, 1658, 1659, 1660, 1661, 1662, 1663, 1664, 1665, 1666, 1667, 1668, 1669, 1670, 1671, 1672, 1673, 1674, 1675, 1676, 1677, 1678, 1679, 1680, 1681, 1682, 1683, 1684, 1685, 1686, 1687, 1688, 1689, 1690, 1691, 1692, 1693, 1694, 1695, 1696, 1697, 1698, 1699, 1700, 1701, 1702, 1703, 1704, 1705, 1706, 1707, 1708, 1709, 1710, 1711, 1712, 1

- 36d) EXTERIOR GUARDS @ JULIET BALCONY:
-FOR RAILING SPANNING MAXIMUM OF 6'-0".
-PROVIDE PREFIN. METAL RAILING W/ 16mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.8.8.5.
-GUARDS TO BE 3'-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE 2'-11" (660mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C. 9.8.8.2. OR
-FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C. 9.8.8.2.
-VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"x9 MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN. EMBEDMENT TO STUDS.
-PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.
-LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP

37) WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR. O.B.C. -9.3.21, 3.13)

38) CAPED DRYER VENT

39) -1"x2" (19mmx38mm) BOTH SIDES OF STEEL.

40) WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE.

41) -PRECAST CONC. STEP

42) -2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND

43) SMOKE ALARM. O.B.C. -9.10.19.
-PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
-PROVIDE 1 IN EACH BEDROOM
-INSTALLED AT OR NEAR CEILING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A VISUAL SIGNALING COMPONENT
-ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM ACTIVATED.

44) CARBON MONOXIDE ALARM (CMA), O.B.C. -9.33.4.
-WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.
-CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.

45) -MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY
-PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 1.60 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT.
-R4 (RSJ 0.70) WHERE A STORM DOOR IS NOT PROVIDED

46) -GARAGE MAIN DOORS TO BE GAS PROOVED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLLTHER O.B.C. 9.10.13.15.
-R4 (RSJ 0.70)

47) -TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT:
1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY
OR
2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (7.0m) ABOVE ADJACENT GROUND LEVEL.

48) CLIENT SPECIFIC REVISIONS

49) EXTERIOR COLUMN W/ MASONRY TIE:
-MIN. 6"x6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.
-TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.
-1-4" X 1-4" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP.
-REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
-SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4.
-3/4" AIR SPACE AROUND POST.
OR
-MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
-1-4" X 1-4" MASONRY TIE TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.
-REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.

49a) EXTERIOR COLUMN:
-MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE
NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.

50) COLD CELLARS:
FOR COLD CELLARS PROVIDE THE FOLLOWING:
-VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.
-COVER VENT W/ BUG SCREEN
-WALL MOUNTED LIGHT FIXTURE
-1-1/2" FOR DOOR OPENING
-2-8" X 6-8" EXTERIOR TYPED DOOR (MIN. R-4 (RSJ 0.7)
-INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSJ 2.11)

51) STUD WALL REINFORCEMENT:
O.B.C. 9.5.2.3.
-WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BEDROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8, 3.10.18(c) & 3.8.3.13.12(i) & 3.8.3.13.14(i)
-GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.2.7.12)


FRAME CONSTRUCTION:
-ALL FRAMING LUMBER TO BE NO. 1 AND NO. 2 SPF UNLESS NOTED OTHERWISE.
-ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN LOADS.
-JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING
-BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING
-DOUBLE STUDS @ OPENINGS
-DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND TO 6" (3200mm)
-DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm)
-DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS
-BEAMS TO BE PLACED UNDER LOAD BEARING WALLS WHEN WALLS ARE PARALLEL TO FLOOR JOISTS

BEAMS MAY BE A MAX. 24" (600mm) FROM LOAD BEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS
-APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS
-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X 184mm)
-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 255mm) OR LARGER.

WINDOWS:
-WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER
-WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 1.8 W/(m2.K) OR
-AN ENERGY RATING OF NOT LESS THAN 2) FOR OPERABLE WINDOWS & 3) FOR FIXED WINDOWS
-BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING
-SLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 2.8 W/(m2.K)
-FOR GROSS GLAZED AREAS LESS THAN 17%

ADDITIONAL COMPLIANCE ALTERNATIVES FOR PACKAGE 1:
-THE MINIMUM R (RSJ) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSJ 3.52) PROVIDED: THAT THE WINDOWS AND SLIDING GLASS DOORS HAVE A MAXIMUM U-VALUE OF 1.6, OR THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A MINIMUM R20 (RSJ 3.52).
OR
-WHERE BLOWN-IN INSULATION OR SPRAY-APPLIED FOAM INSULATION IS USED, THE MINIMUM R (RSJ) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSJ 3.52) PROVIDED THAT:
a) THE THERMAL INSULATION VALUE IN A CEILING WITH AN ATTIC SPACE IS NOT LESS THAN R60 (RSJ 10.55).
b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 PERCENTAGE POINTS.
c) THE MINIMUM AFUE OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS.
d) THE MINIMUM EF OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY NOT LESS THAN 4 PERCENTAGE POINTS.

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

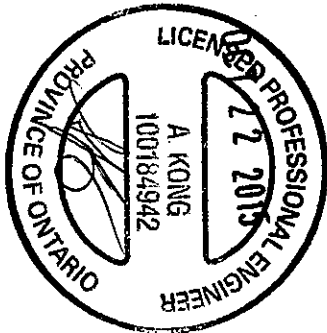

FOR STRUCTURAL ONLY

SCHEDULES

DOORS 46) 47)		WOOD BEAMS	
A 865x2030x45 (2'10"x6'8"x1-3/4")	WD1 3/2" X 8" SPR	WD6 5/2" X 10" SPR	WD10 2/1 3/4" X 7 1/4" (2.0E) LVL
B 815x2030x35 (2'8"x6'8"x1-3/8")	WD2 4/2" X 8" SPR	WD7 3/2" X 12" SPR	WD11 3/1 3/4" X 1/4" (2.0E) LVL
C 760x2030x35 (2'6"x6'8"x1-3/8")	WD3 5/2" X 8" SPR	WD8 4/2" X 12" SPR	WD12 2/1 3/4" X 9 1/2" (2.0E) LVL
D 710x2030x35 (2'4"x6'8"x1-3/8")	WD4 3/2" X 10" SPR	WD9 5/2" X 12" SPR	WD13 3/1 3/4" X 9 1/2" (2.0E) LVL
E 460x2030x35 (1'6"x6'8"x1-3/8")	WD5 4/2" X 10" SPR		WD14 2/1 3/4" X 11 7/8" (2.0E) LVL
F 610x2030x35 (2'0"x6'8"x1-3/8")			WD15 3/1 3/4" X 11 7/8" (2.0E) LVL
G OVER SIZED EXTERIOR DOOR -REFER TO ELEVATIONS FOR SIZE			
		LINTELS	
L1 2/2" X 8" SPR	L10 4-7/8" X 3-1/2" X 5/16" L	L15 5-7/8" X 4" X 1/2" L	
L3 2/2" X 10" SPR	L11 4-7/8" X 3-1/2" X 3/8" L	L16 7-1/8" X 4" X 3/8" L	
L5 2/2" X 12" SPR	L12 4-7/8" X 3-1/2" X 1/2" L	L17 7-1/8" X 4" X 1/2" L	
L7 3-1/2" X 3-1/2" X 1/4" L	L13 5-7/8" X 3-1/2" X 3/8" L		
L9 4" X 3-1/2" X 1/4" L	L14 5-7/8" X 3-1/2" X 1/2" L		
		STEEL BEAMS	
ST1 W 6 X 15	ST3 W 8 X 18	ST5 W 8 X 24	
ST2 W 6 X 20	ST4 W 8 X 21		


PLAN/ELEVATION LEGEND

44) SMOKE ALARM	45) CARBON MONOXIDE DETECTOR	X FLOOR DRAIN
WATERPROOF	D.O. DOUBLE JOIST	TO BE SAME WIDTH AS SUPPORTED MEMBERS
DOUBLE OUTLET	P.T. PRESSURE TREATED LUMBER	POINT LOAD
VENTS AND INTAKES	G.T. GUTTER TUBES	2 STOREY WALL
HOSE BIB	A.F.F. ABOVE FINISHED FLOOR	UNDER SIDE
EXHAUST FAN	EXT. LIGHT FIXTURE (WALL MOUNTED)	FIXED GLAZING
COLD CELLAR VENT 50)	HYDRO METER	GLASS BLOCK
STOVE VENT		BLACK GLASS
FIRE PLACE VENT		
DRYER VENT		


FLOOR AREA CALCULATIONS


ELEVATION	A & B				
FIRST FLOOR	1333				
SECOND FLOOR	N/A				
TOTAL	1333				
DEDUCT O.T.B.	N/A				
TOTAL	1333				
FIN. BASEMENT	752				
TOTAL	2085				
LOFT PLAN	N/A				
TOTAL	2085				
COVERAGE (ft ²)	1715				
W/O PORCH (m ²)	159.3				
COVERAGE (ft ²)	1796				
W/ PORCH (m ²)	166.8				

MODEL	40-2	No. ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
CLIENT	1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	N/A
ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO						PROJECT NUMBER 14093
RN design Imagine • Inspire • Create TEL: (905) 738-3177 FAX: (905) 738-6449						PAGE D3
IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J CLIENT SPECIFIC REVISIONS						
NELSON GUNDA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE ENTIRE PROJECT. I AM A REGISTERED PROFESSIONAL ENGINEER UNDER DIVISION C PART 3 SUBSECTION 3.2 OF THE ENGINEERING ACT. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CATEGORY.						QUALIFIED DESIGNER BCIN: 21032 FIRM BCIN: 26995 DATE: OCTOBER 19, 2015 SIGNATURE:

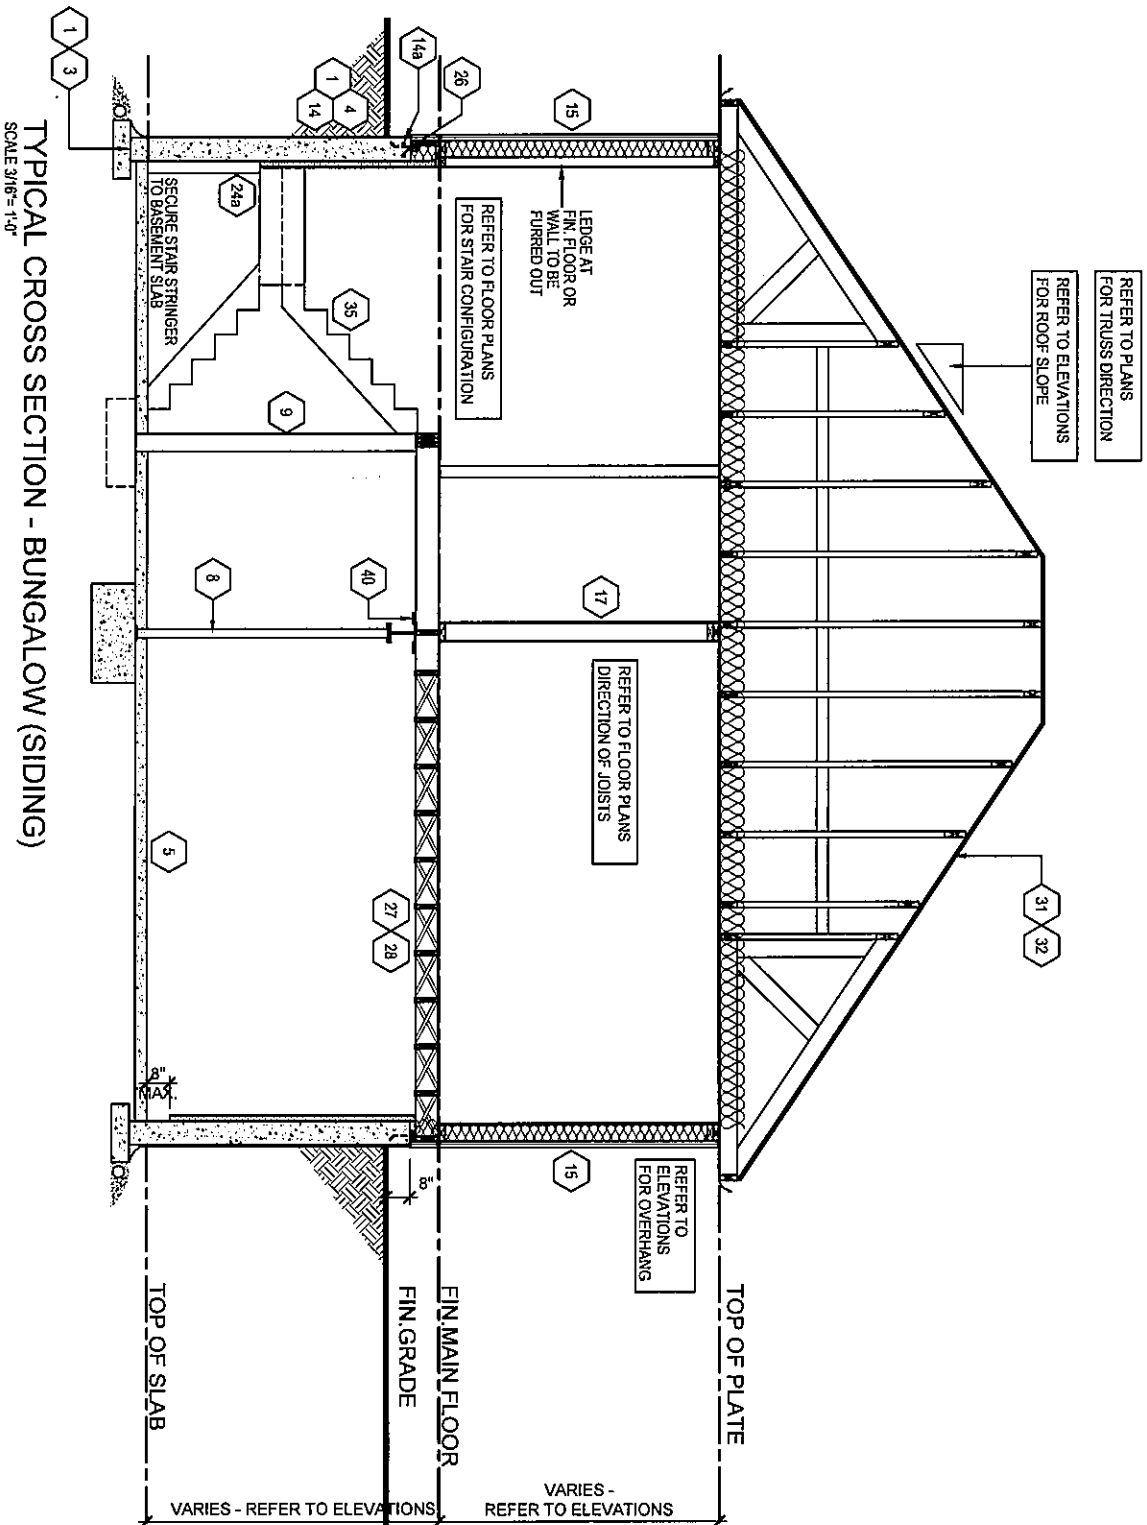

FOR STRUCTURAL ONLY

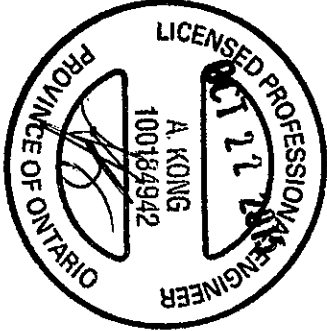

 FIN design <i>Imagine • Inspire • Create</i> TEL: (905) 738-3177 FAX: (905) 738-5448	MODEL	40-2				
	CLIENT	ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO				
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE OBTAINED FROM THE DRAWINGS. NO DIMENSIONS SHALL BE TAKEN FROM ANY OTHER SOURCE. TO COMMENCEMENT OF ANY WORK, ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO FIN DESIGN LTD. REVISED: JANUARY 08, 2015 - FIN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J	No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
	1.	UPDATED TO OBC 2012 - 2015 ENACTMENT	OCT. 19/15	-	NC	N/A
I, NELSON GUINIA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF FIN DESIGN LIMITED. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.	QUALIFIED DESIGNER BCIN:	21032	SIGNATURE:			
	FIRM BCIN:	28995	DATE:	OCTOBER 19, 2015		
PAGE	PROJECT NUMBER					14093
D4						