

FRONT **ELEVATION 'A'** 

FRONT ELEVATION 'B'

### OBC 2012

### DRAWING LIST:

# 37-1 (SAW MILL)

TITLE SHEET

BASEMENT FLOOR ELEV. 'A'
GROUND FLOOR ELEV. 'A'
SECOND FLOOR ELEV. 'A'
SECOND FLOOR ELEV. 'B'
BASEMENT FLOOR ELEV. 'B'
GROUND FLOOR ELEV. 'B'
SECOND FLOOR ELEV. 'B'
FRONT ELEVATION 'A'
REAR ELEVATION 'A'
REAR ELEVATION 'B'
REAR ELEVATION 'B'
REAR ELEVATION 'B'
CONSTRUCTION SHEET
CONSTRUCTION SHEET
CONSTRUCTION SHEET
TYPICAL SECTION

## **GROSS** AREA 'A'

TOTAL GLAZING AREA TOTAL GLAZING PERCENTAGE NT GLAZING AREA
T SIDE GLAZING AREA
HT SIDE GLAZING AREA
R GLAZING AREA GLAZING HERAL WALL AREA 2404.08 SF 80.14 SF 0 SF 15.94 SF 89.25 SF 223.34 m²
7.45 m²
0.00 m²
1.48 m²
8.29 m²

## **GROSS GLAZING** AREA 'B'

TOTAL PERIPHERAL WALL AR FRONT GLAZING AREA LEFT SIDE GLAZING AREA RIGHT SIDE GLAZING AREA REAR GLAZING AREA TOTAL GLAZING AREA TOTAL GLAZING PERCENTAGE WALL AREA 2404.08 SF 86.42 SF 0.0 SF 17.11 SF 89.25 SF 223.34 m² 8.03 m² 0.00 m² 1.59 m² 8.29 m²

ARINGTON, **ONTARIO** 





SUITE 203 VAUGHAN, ON TEL: 905-738-3177 FAX: 905-738-5449 8395 JANE STREET


RN design


CONTACT PERSON: NELSON CUNHA

			ONAT ONE.	26995	FIRM BCIN: 26995  PATE: OCTOBED 10 2015	TEO .	RK ON BEI ON 3.2.4. C STERED, I	DESIGN WO 3, SUBSECTION FIRM IS REGI	RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIA UNDER DIVISION C, PART 1, SUBSECTION 3.2.4. OF THE BUILDING CODE, I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSESICATEGORIES.	THE VERIFIED BY CONTRACTOR PRIOR OF ANY WORK. AN DISCREPANCIES SHECTLY TO RN DESIGN LTD. TAFFINACCORDANCE TO \$5-22 COMPLIANCE PACKAGE J
_			NATI IDE:	020 600	OTAL TELED DESIGNED BOING 21		E REVIEW	KE THAT I HAY	I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN	ARE NOT TO BE SCALED.
14093										
PROJECT No.										
AS NOTED							H	1 NC	OCT. 19/15	12 - 2015 ENACTMENT
DWN CHK SCALE	CHX	DWN	DATE		MENTS:	DWN CHK No. REVISION COMMENTS:	X No	VN CH	DATE	MENTS:
							-			

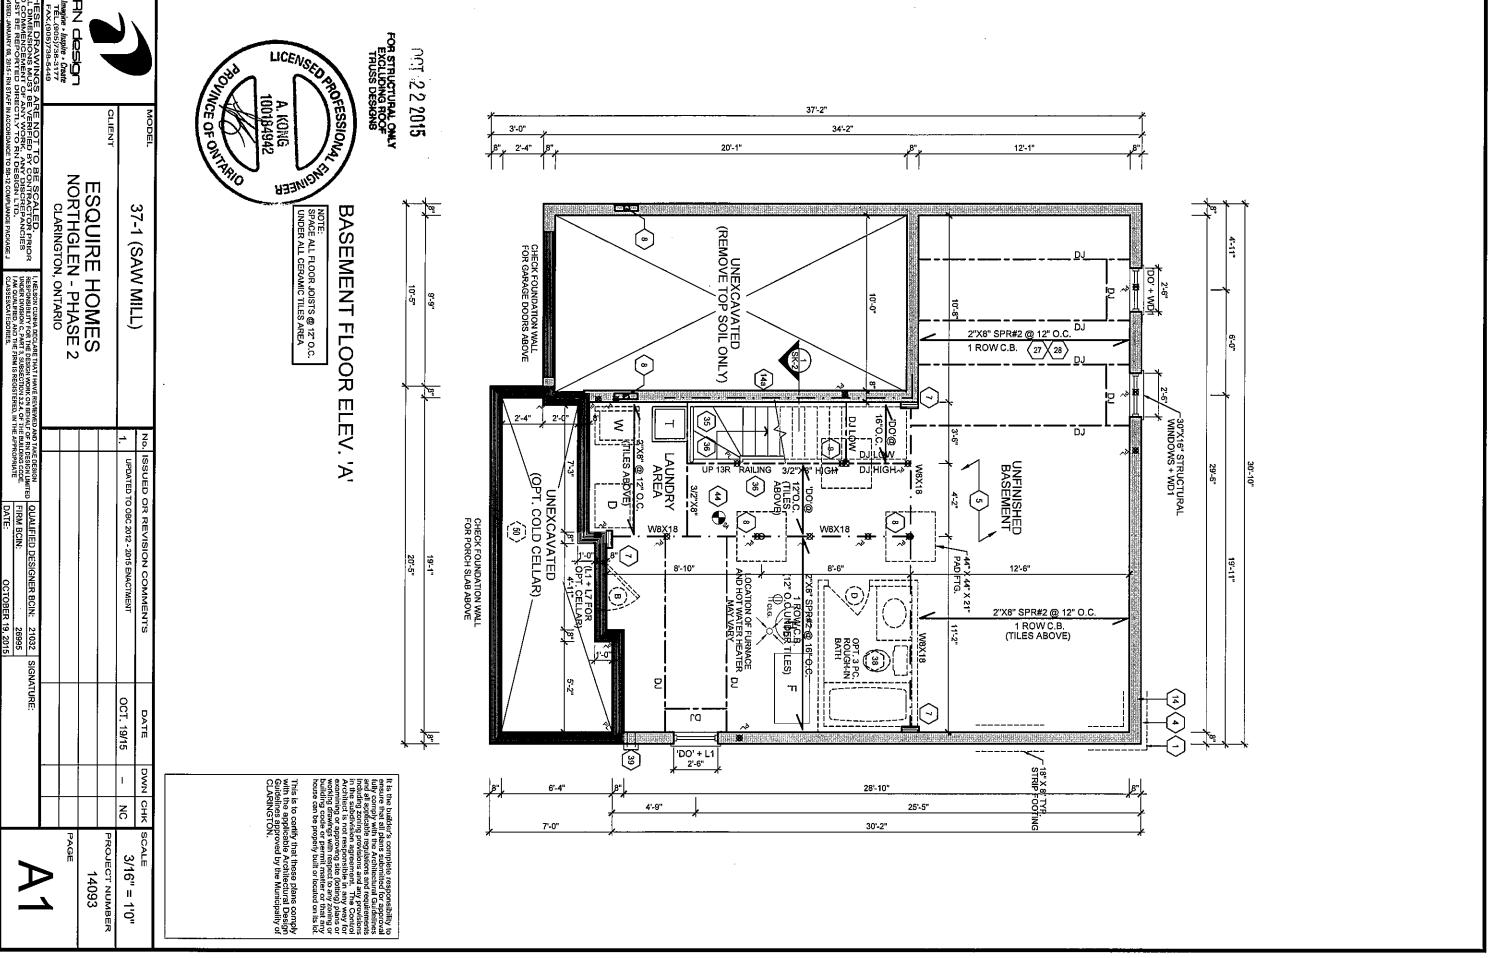


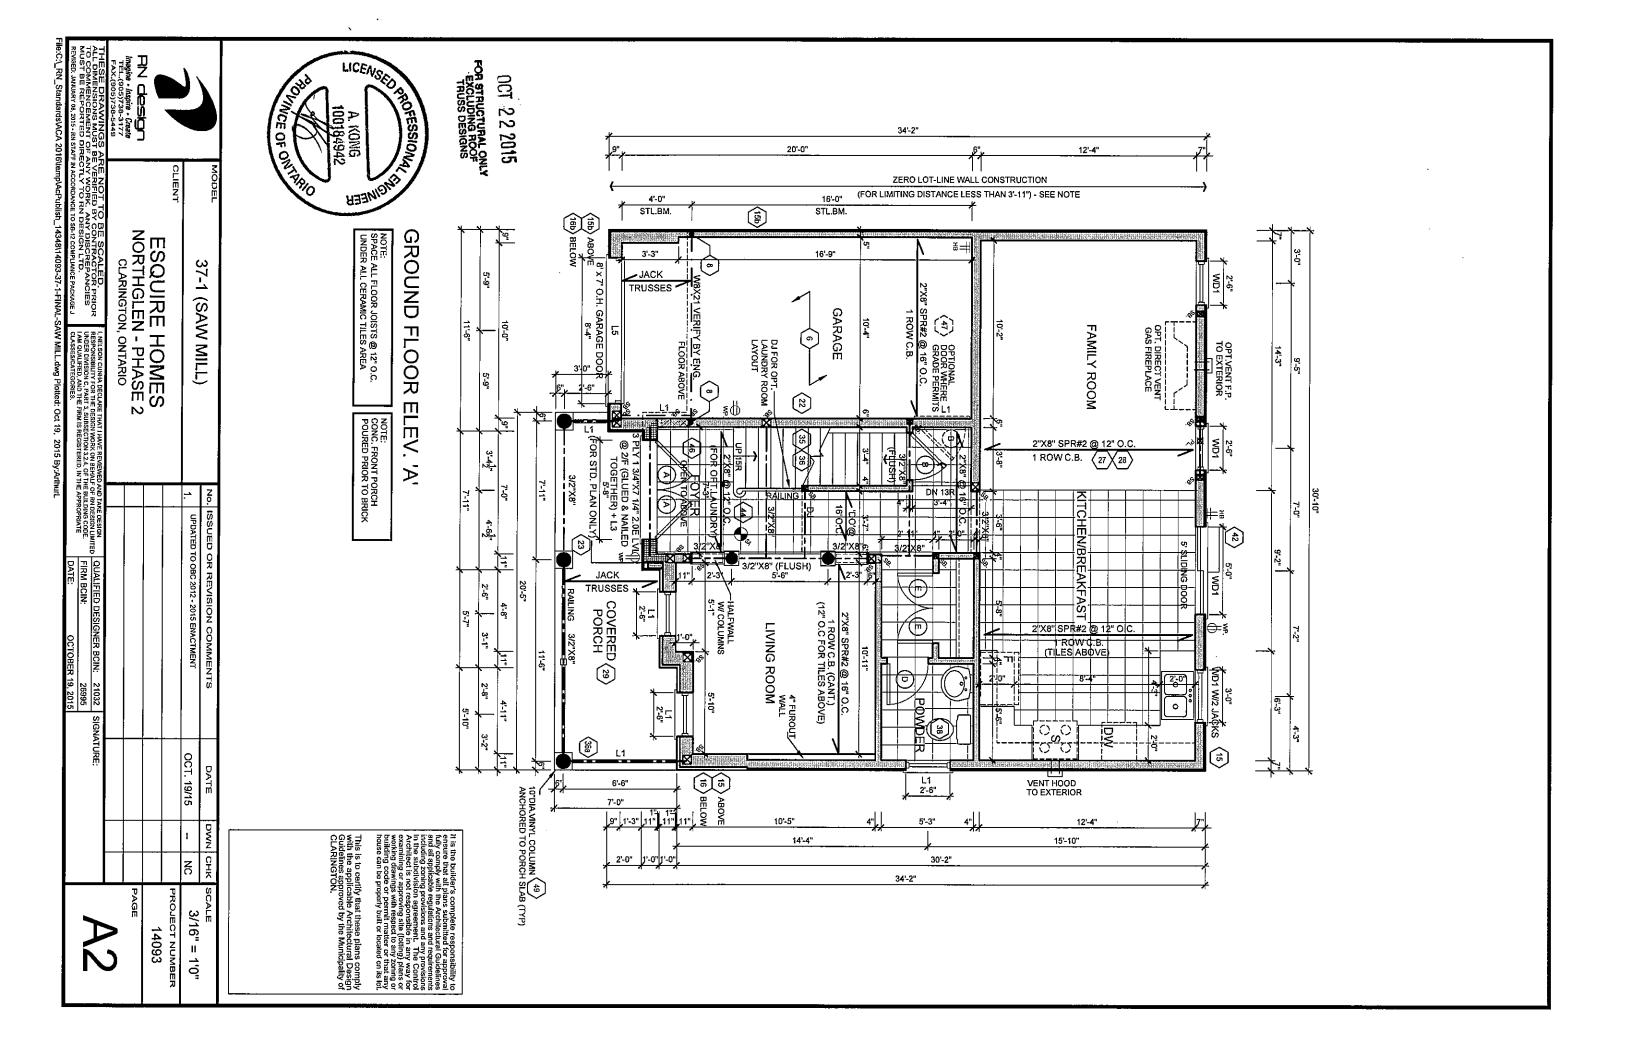


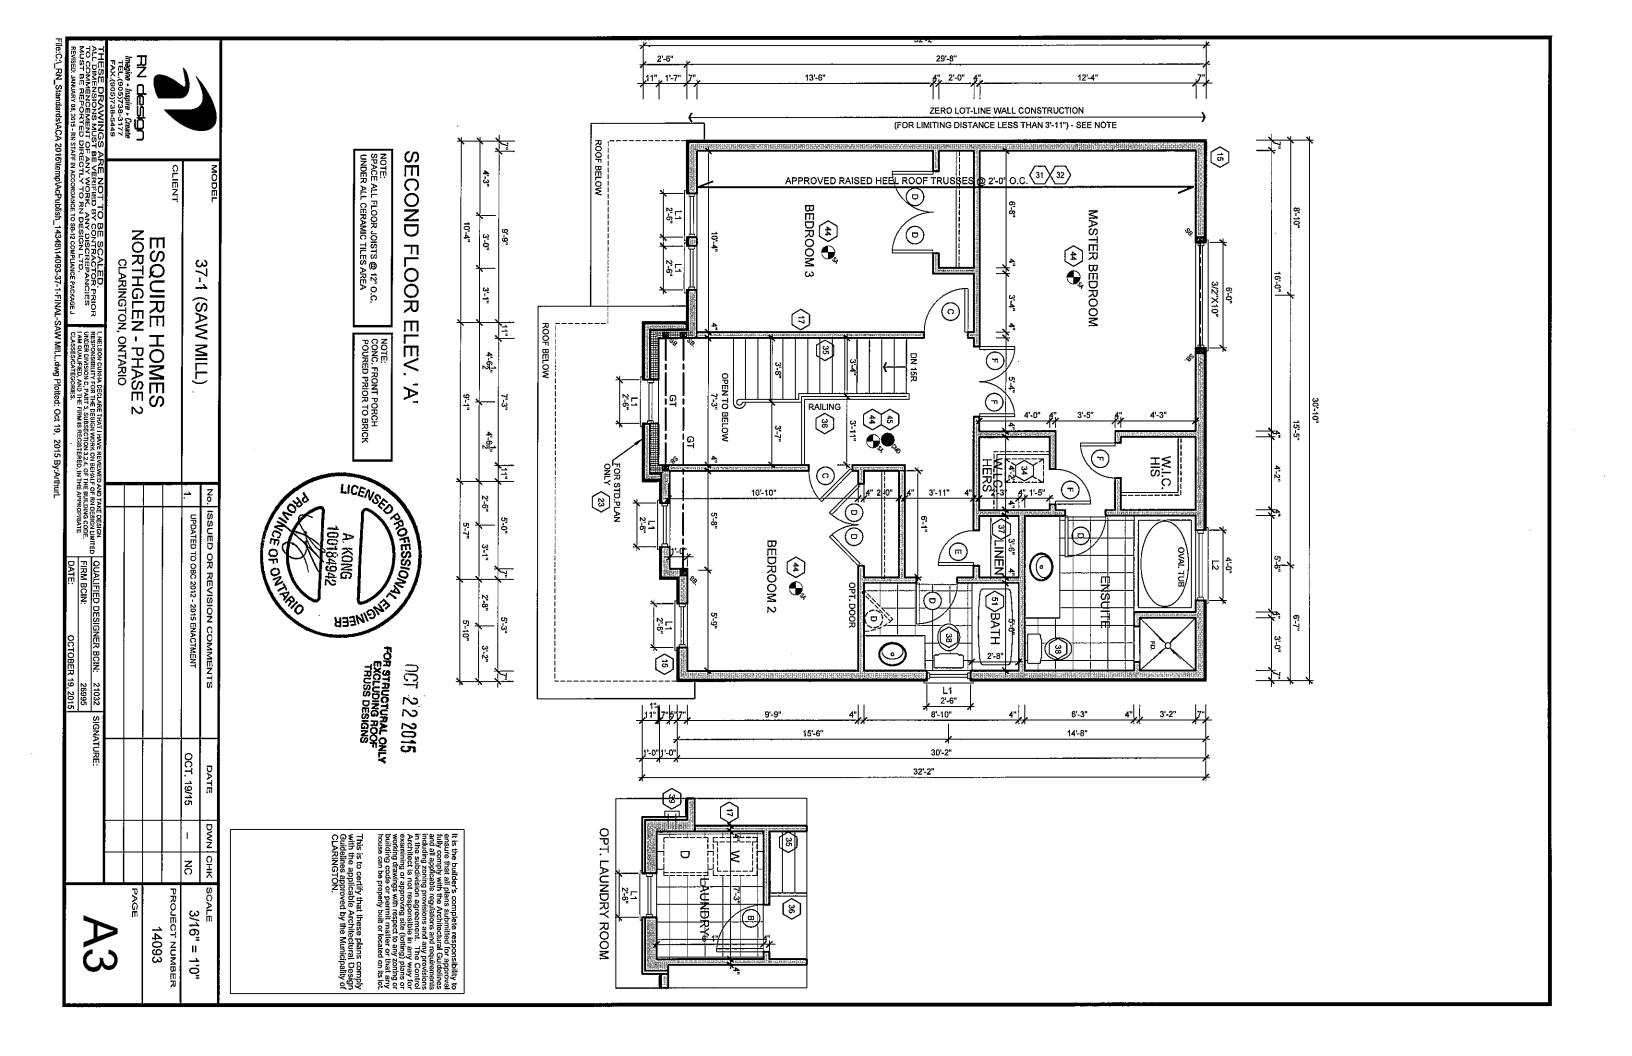


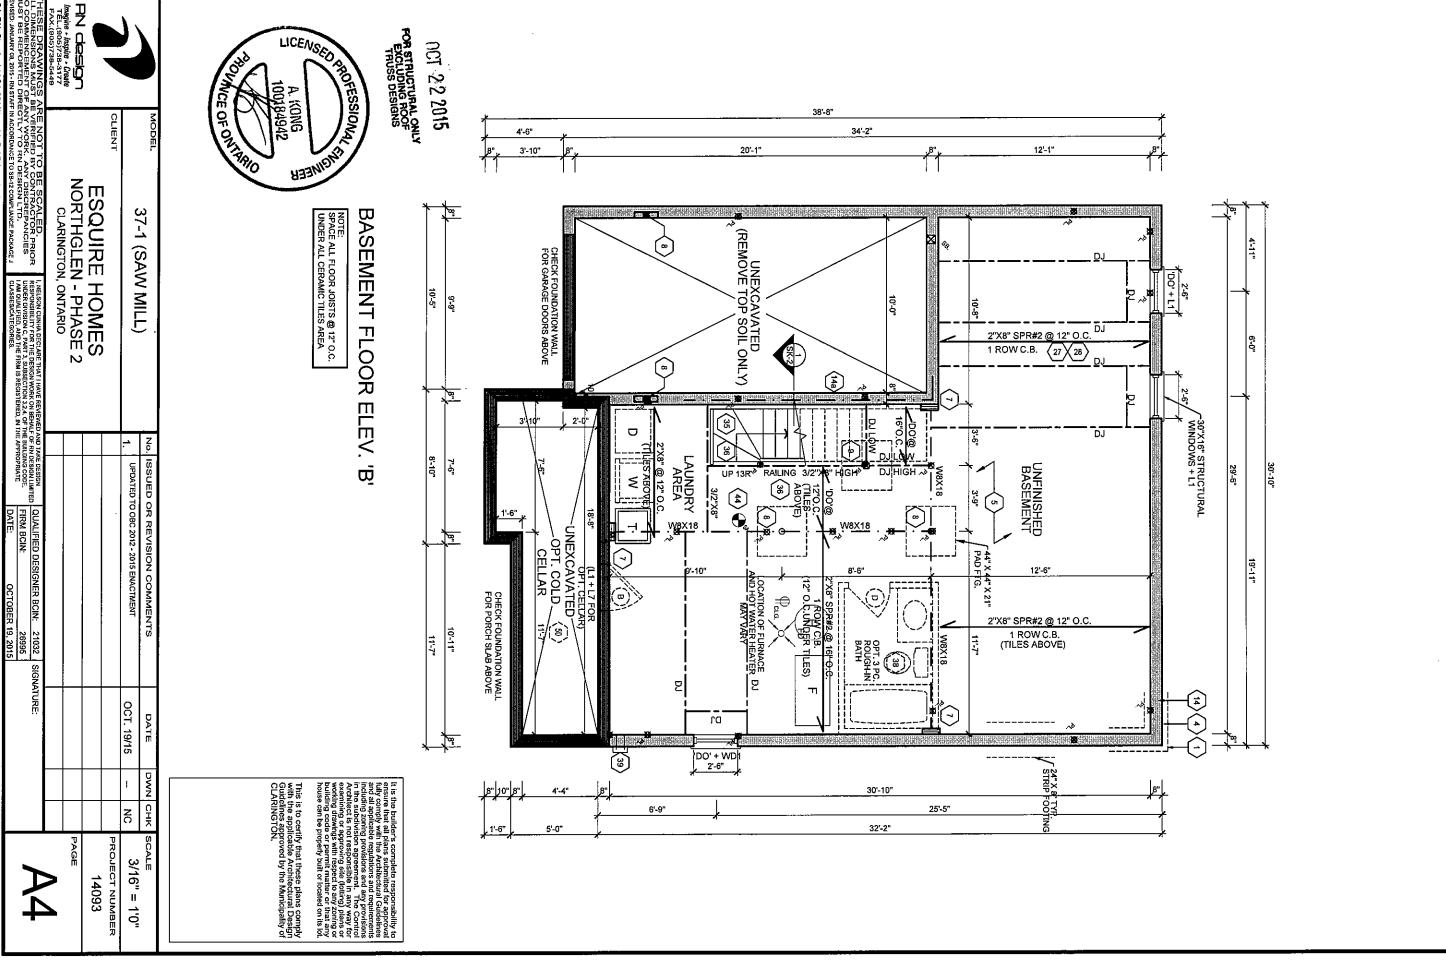



N\_Standards\ACA 2016\temp\AcPublish\_14348\14093-37-1-FINAL-SAW MILL.dwg Platted; Oct 19, 2015 By:ArthurL

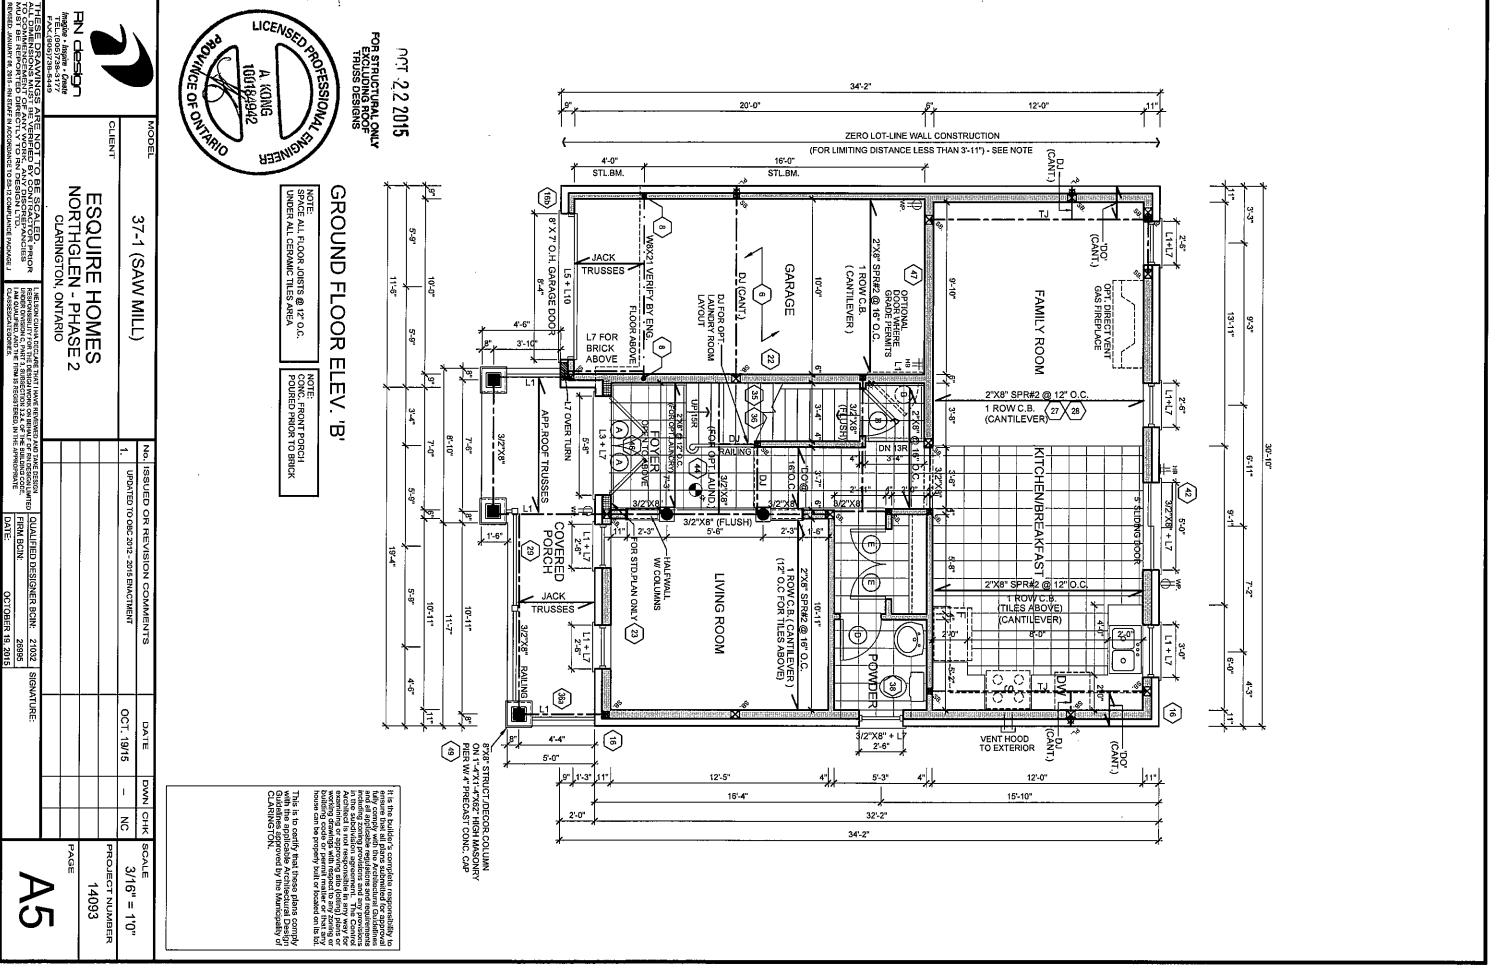


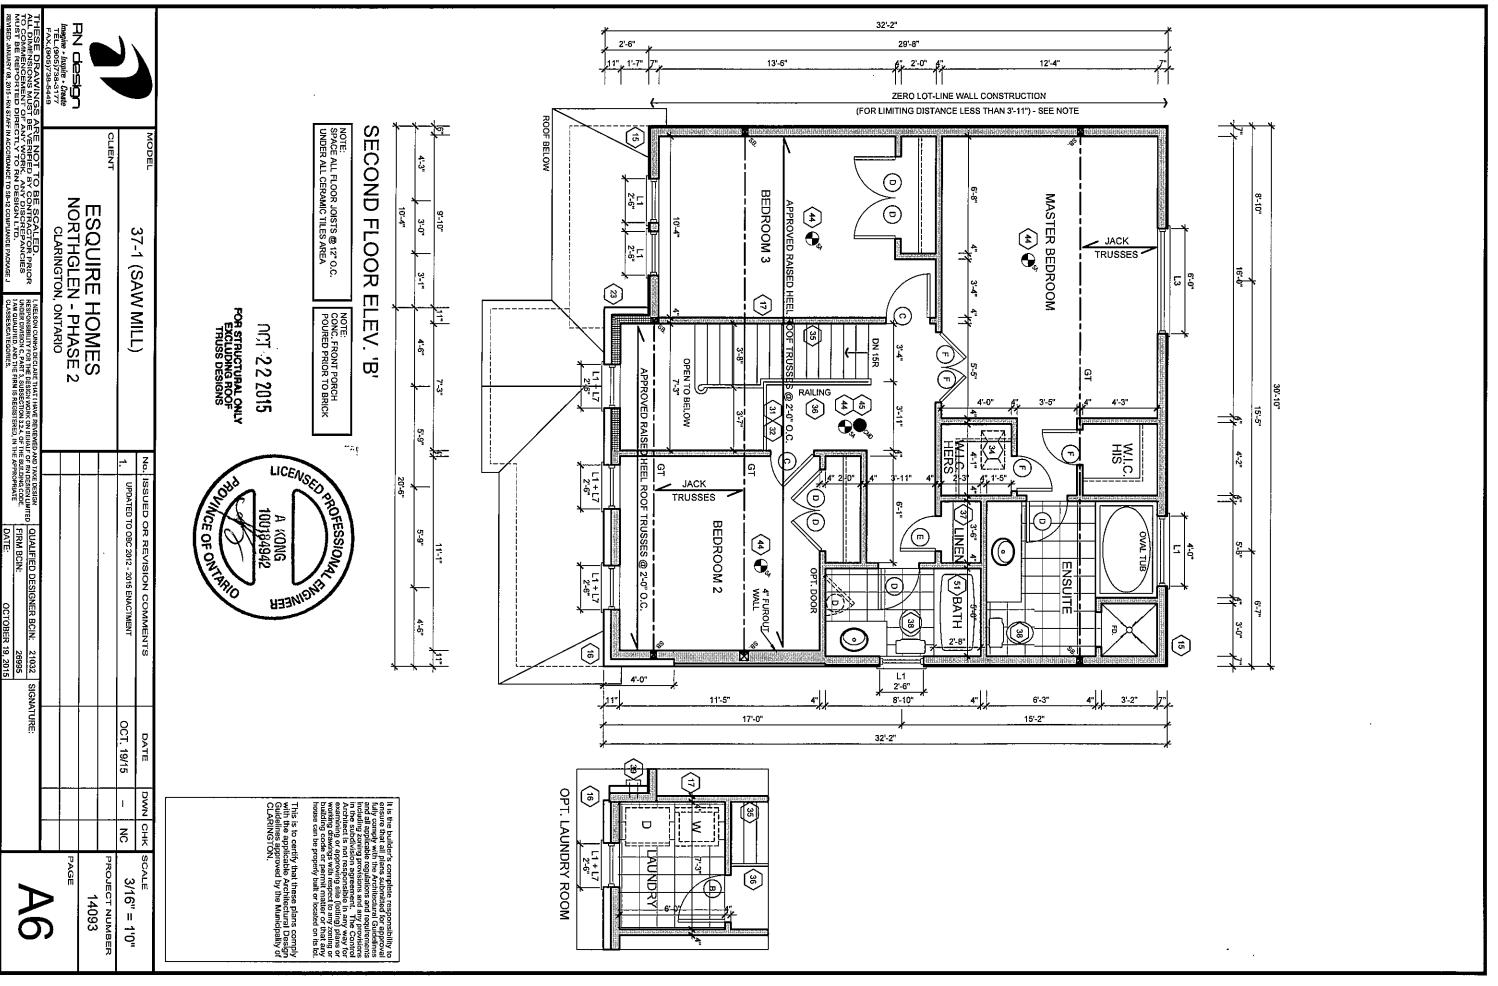


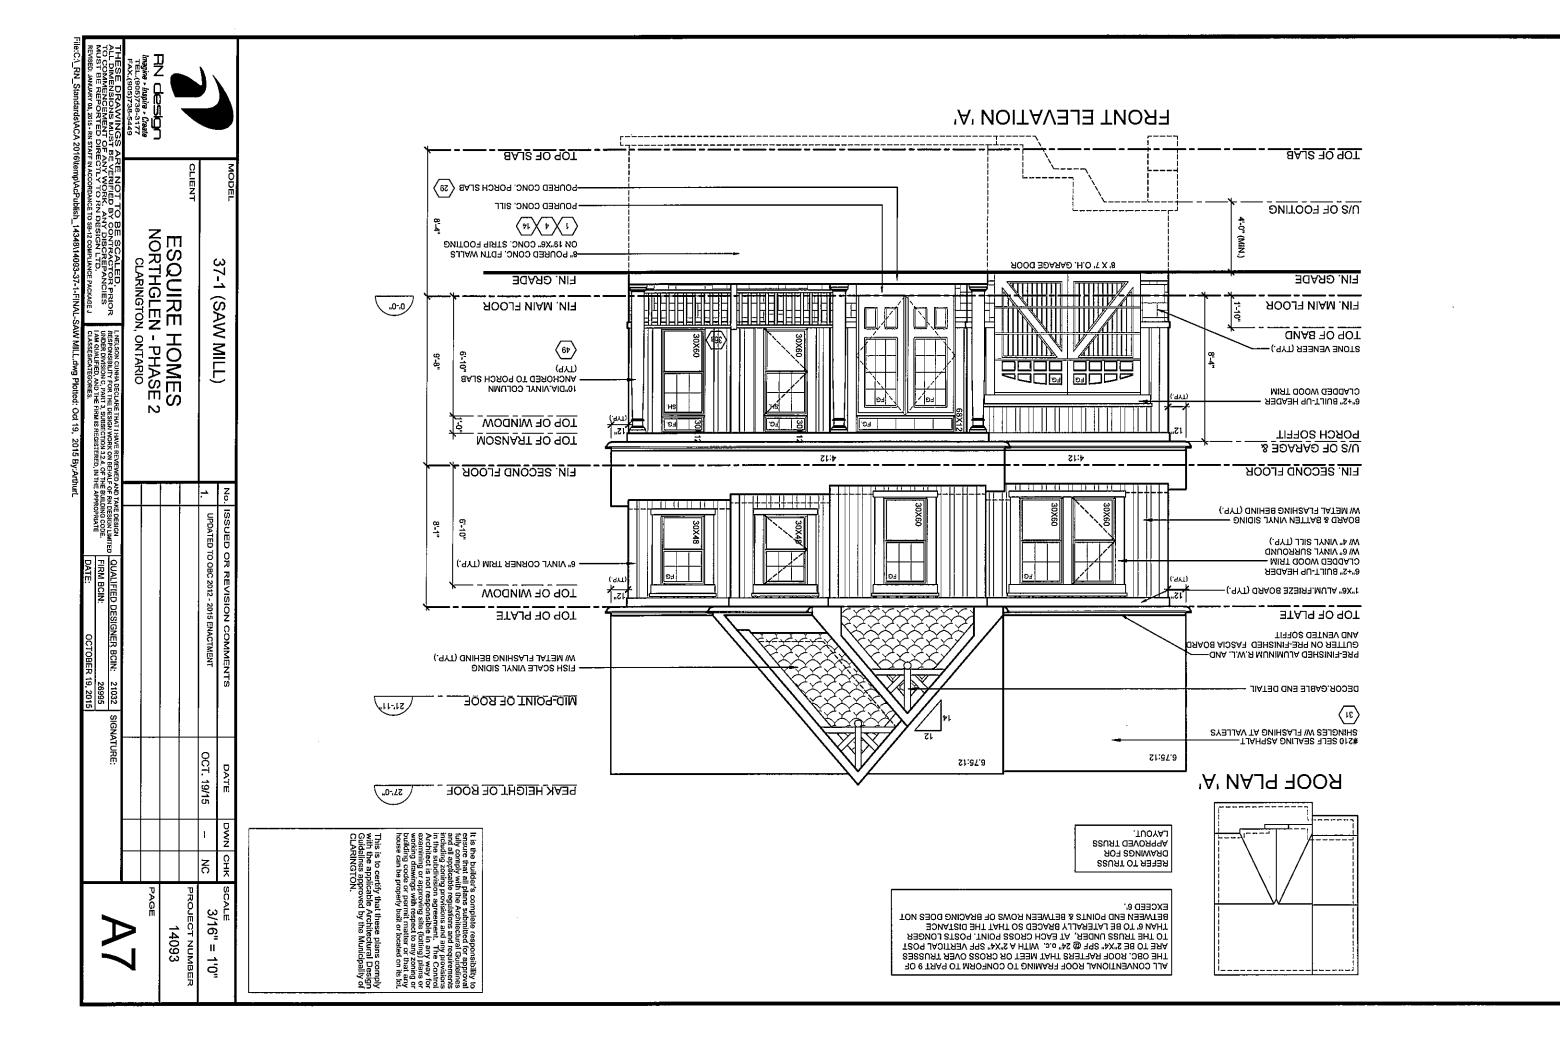


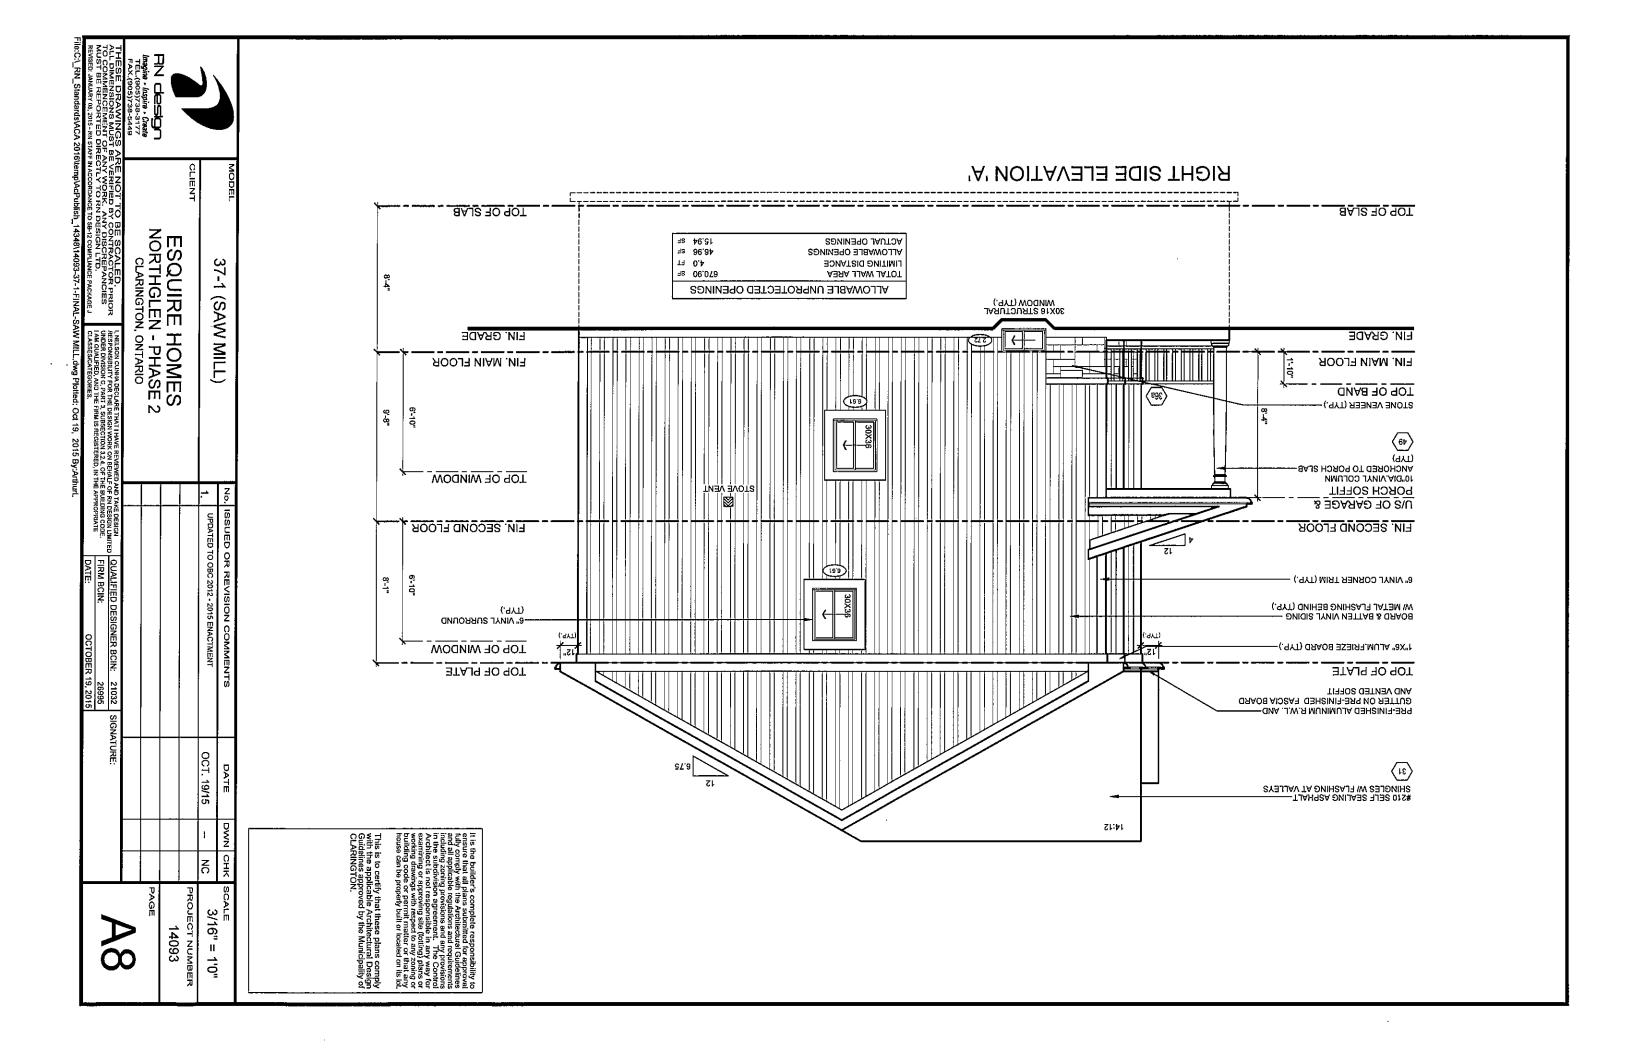

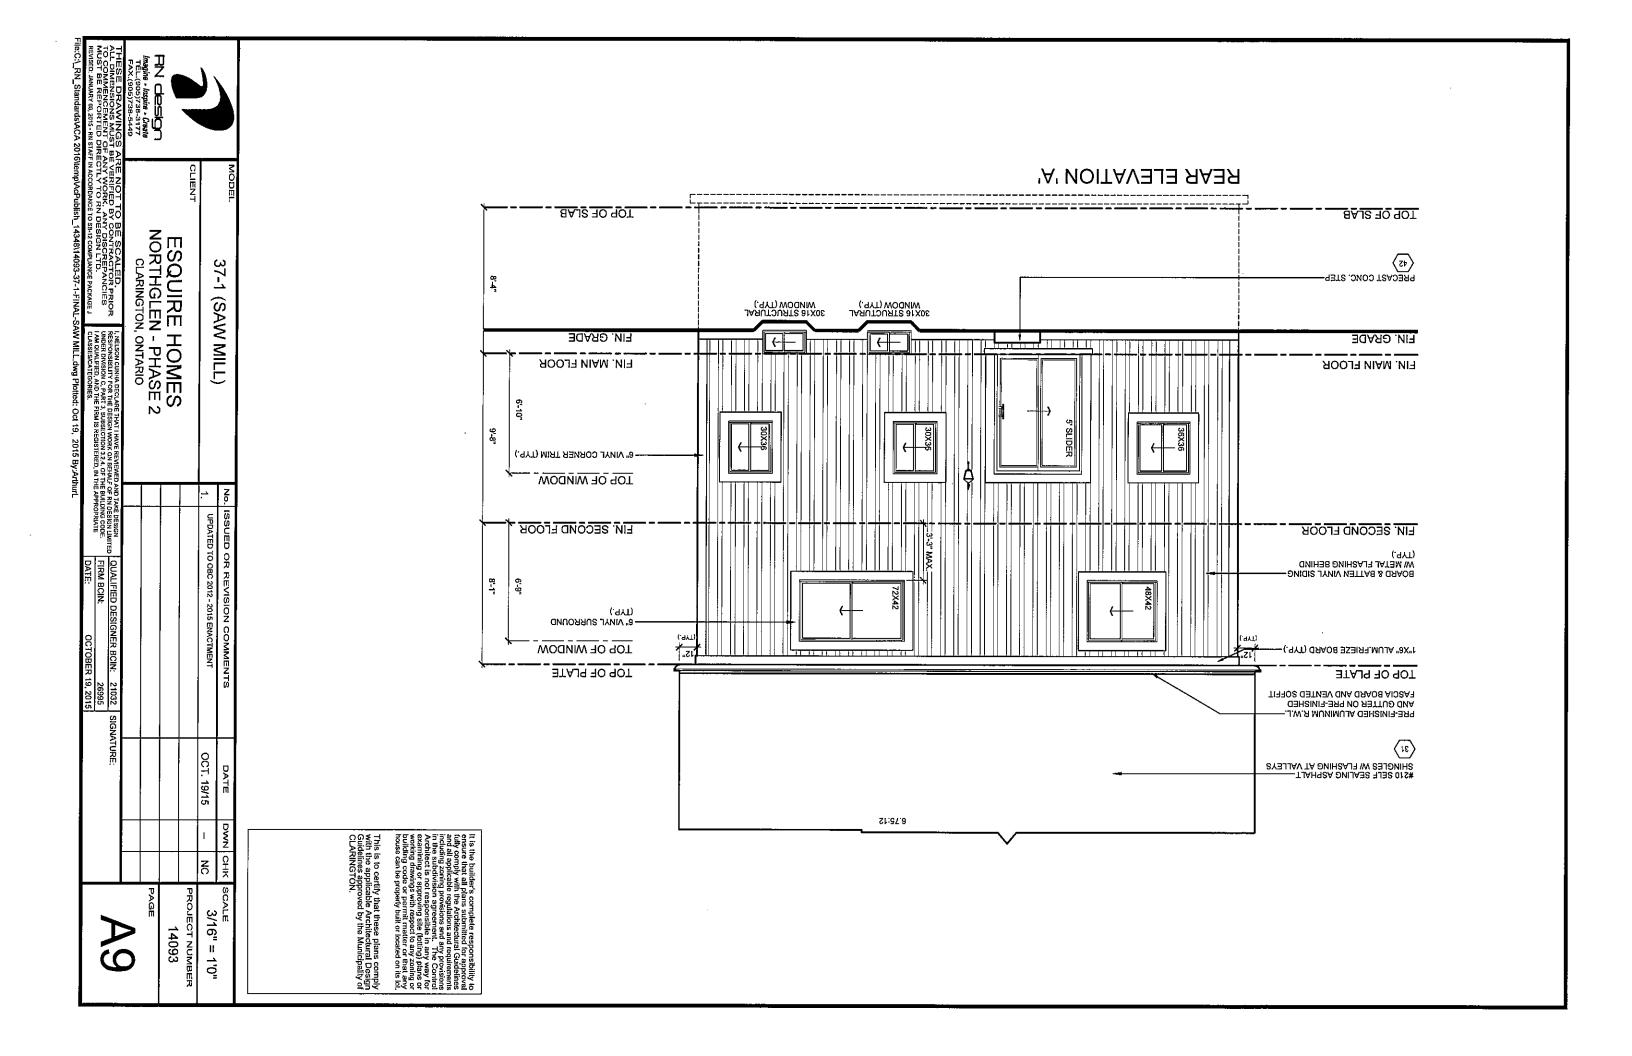


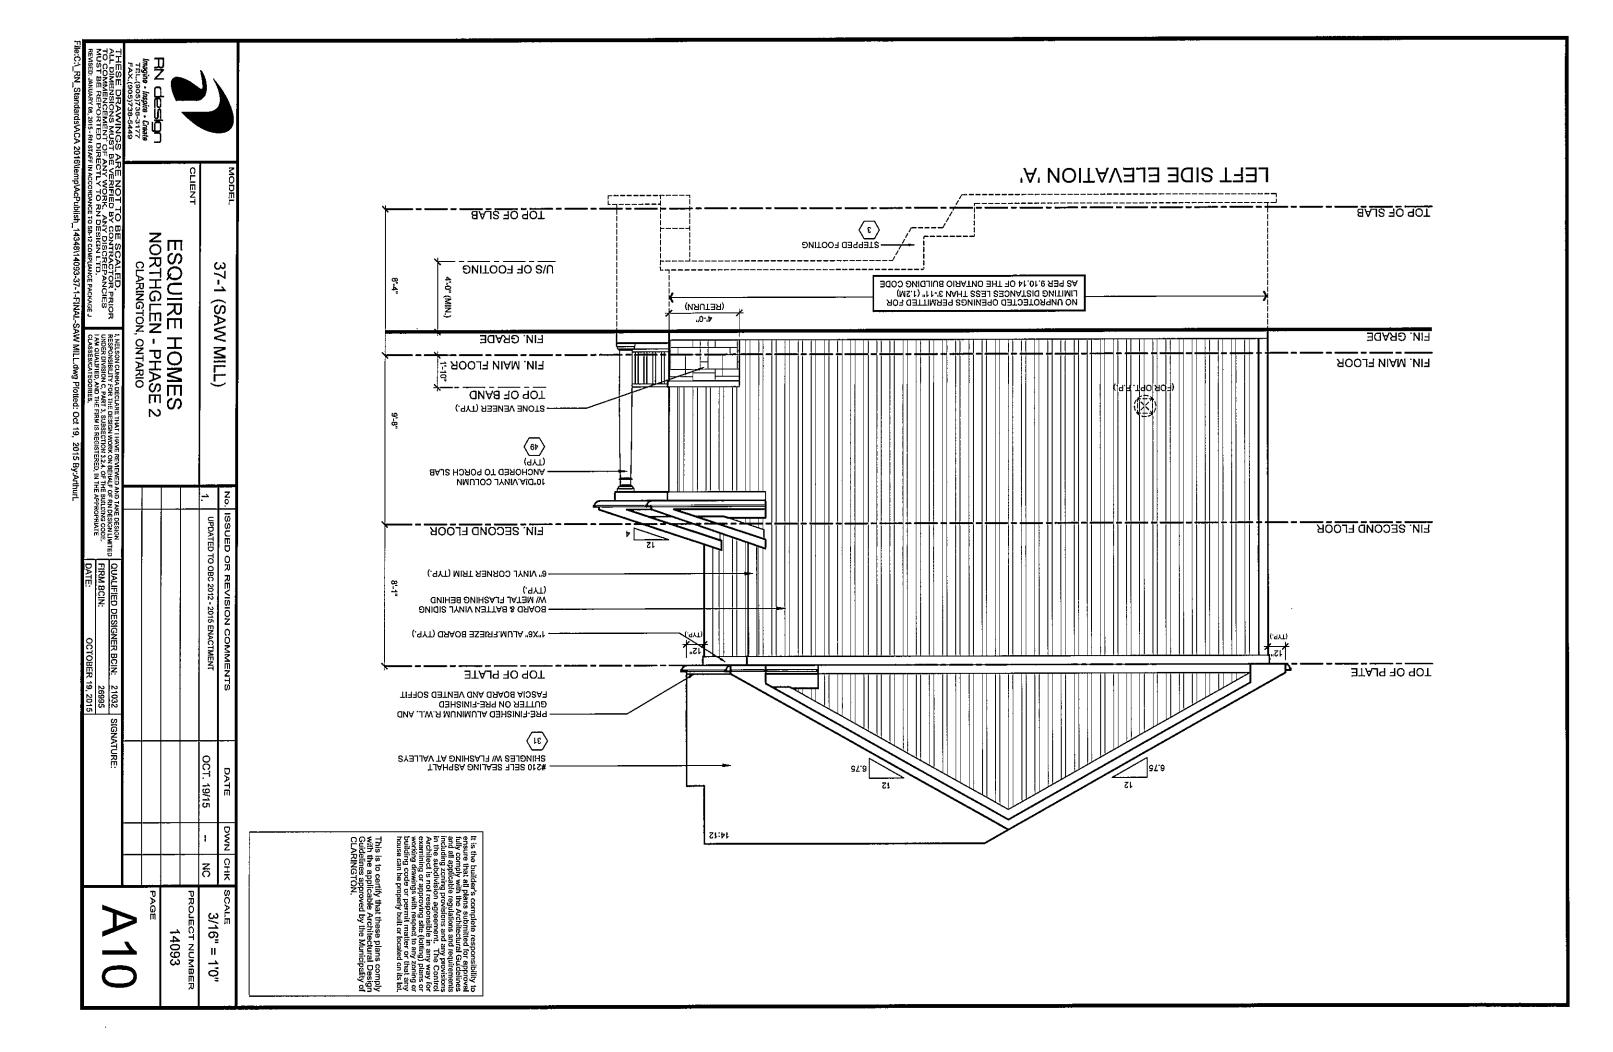

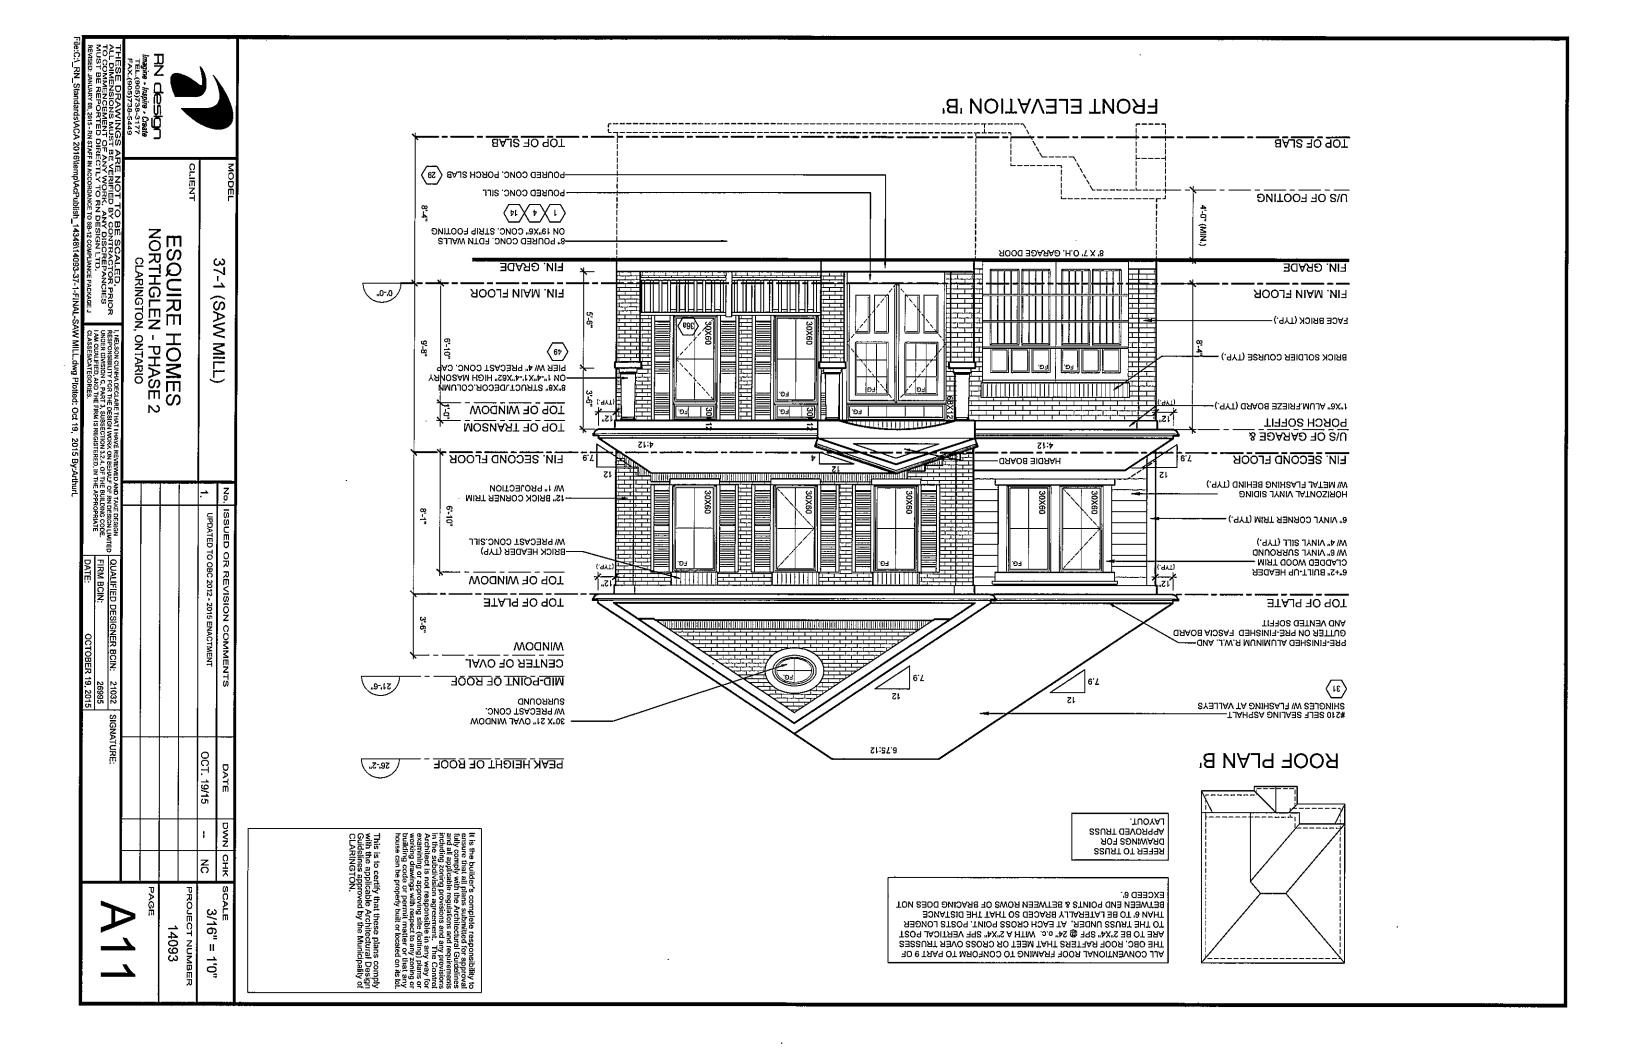

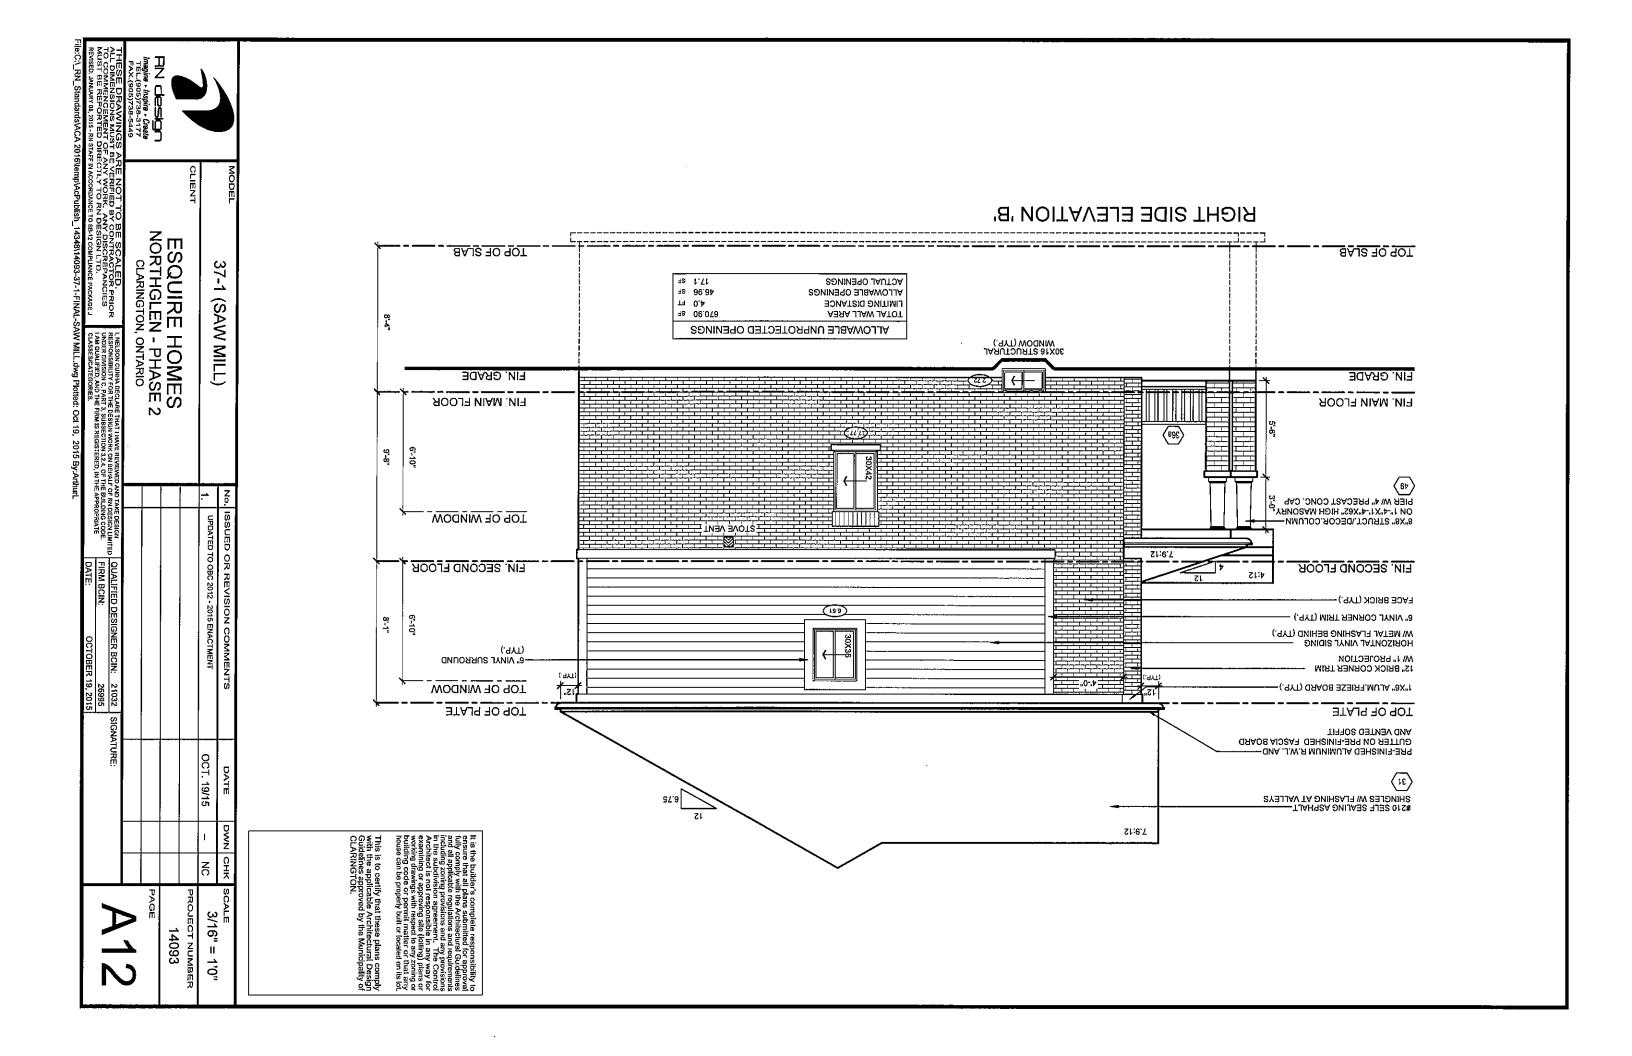

REAR ELEVATION 'B' ESQUIRE HOMES NORTHGLEN - PHASE 2 CLARINGTON, ONTARIO TOP OF SLAB TOP OF SLAB 37-1 (SAW MILL) PRECAST CONC. STEP-30X16 STRUCTURAL MNDDOW (TYP.) 30X16 STRUCTURAL WINDOW (TYP.) FIN. GRADE FIN. GRADE FIN. MAIN FLOOR FIN, MAIN FLOOR -FACE ВRICK (ТҮР.) 9-8 TOP OF WINDOW FIN. SECOND FLOOR LIN SECOND FLOOR - 6" VINYL CORNER TRIM (TYP.) HORIZONTAL VINYL SIDING WI METAL FLASHING BEHIND (TYP.) -<u>1</u>-- 6" VINYL SURROUND (TYP.) 1"X6" ALUM.FRIEZE BOARD (TYP.)~ TOP OF WINDOW **TOP OF PLATE** TOP OF PLATE PRE-FINISHED ALUMINUM R.W.L. AND GUTTER ON PRE-FINISHED FASCIA BOARD AND VENTED SOFFIT 19/15 #210 SELF SEALING ASPHALT
#10 SELF SEALING ASPHALT 51:87.8 3/16" = 1'0"

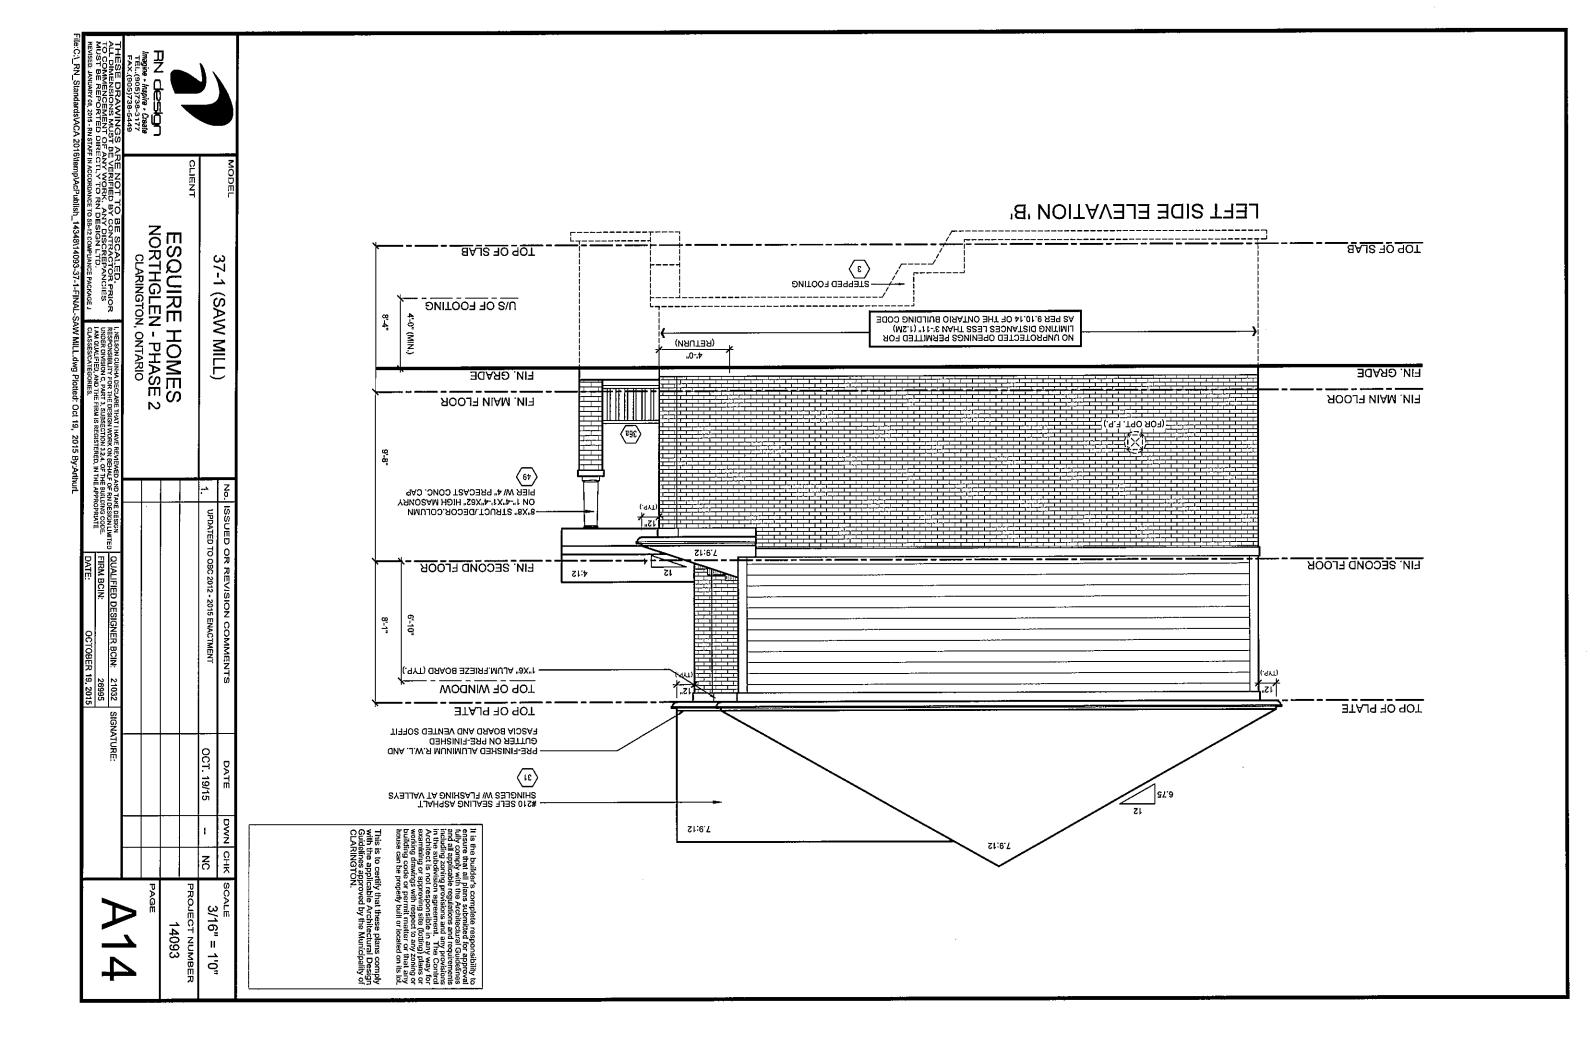

COMPLIANCE PACKAGE J - O.B.C. 2012 - 2015 ENACTMENT

(UNLESS OTHERWISE NOTED)
-ALL CONSTRUCTION TO CONFORM TO THE ONIARIO
BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES
HAVING JURISDICTION.
-ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC.
-THERMAL RESISTANCE VALUES BASED ON ZONE I

ON 16-1"(4,5m) MAX, SUPPORTED JOIST LENGTH
ODNS (15MPG) CONCRETE AFTER 28 DAYS
EST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL
10.9psi (75KPG) BEARING CAPACITY
HAVE COMTINUOUS KEY
ES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY
SOILS ENGINEERING REPORT)

TYPICAL STRIP FOOTING: (EXTERIOR WALLS)
O.B.C. P. 15.3.5.
-FIG. TO EXTEND MIX. 4-0" (1200mm) BELOV
BRICK VENEER -1 STOREY - 13" X-4" (2 -1 STOREY - 10" X 4"
-2 STOREY - 14" X 4"
-3 STOREY - 18" X 5" 4-0" (1200mm) BELOV TOREY - 13" X 4" (3 TOREY - 19" X 6" (4 TOREY - 26" X 9" (6 (255mm X 100mm) (360mm X 100mm) (460mm X 130mm) (330mm × 100mm) (485mm × 155mm) (660mm × 230mm)

2 TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)
O.B.C. 9.15.3.6.
-1 STOREY MASONRY - 16" X 4" (410mm x 100mm)
-1 STOREY STUD - 12" X 4" (305mm x 100mm)
-2 STOREY STUD - 18" X 5" (450mm x 230mm)
-2 STOREY STUD - 18" X 5" (450mm x 130mm)
-3 STOREY STUD - 24" X 8" (600mm x 230mm)
-3 STOREY STUD - 24" X 8" (600mm x 230mm)

3 STEP FOOTING:

O.B.C. 9.15.3.9. 23.5/8" [600mm] MAX. VERTICAL RISE & 23.5/8" [600mm] MIN. HORIZOI

DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3.

4" [100mm] MIN. DIA. LAID ON UNDISTURBED OR WELL COMPACTED SOIL WITOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FLR. SLAB.
COVER TOP & SIDES OF TILE OR PIPE W/ 5 7/8" (150mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL.
-TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

S BASEMENT SLAB

O.B.C. 9.13. & 9.16.

3" (75mm) CONCRETE SLAB
2200031 (15MPG) AFTER 2B DAYS - O.B.C. 9.16.4.5.
2200031 (15MPG) AFTER 2B DAYS - O.B.C. 9.16.4.5.
-DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR
TYPE "S ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMPPROOFING MAY BE OMITIED IF CONCRETE HAS MIN. 3600psi(25MPG)
COMPRESSIVE STRENGTH AFTER 2B DAYS
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB 1S REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO
O.B.C. 9.13.3.
-PIOLOSE ORAIN PER O.B.C.9.31.4.4.
-PIOLOSE DRAIN PER O.B.C.9.31.4.4.

OR DRAIN PER O.B.C.9.31, 4.4.

OR DRAIN PER O.B.C.9.31, 4.4.

(RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN (RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 12" (A00mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT THAN 23-1/2" (A00mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. SB-12-1.6 (5))

-UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY STANDARD (O.B.C. SB-P)

(50) SLAB ON GROUND:

-3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.
-220098 (15MPG) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMPPROOF BELOW SLAB W / MIN, 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S ROLL ROOFING W / " (100mm) LAPPED JOINIS.
-DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600ps)(25MPG) COMPRESSIVE STRENGTH AFTER 28 DAYS
-R10 [RS1 1.76] (MSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 29-1/2" (200mm) OF GRADE
-4" (100mm) OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB 8, FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.

OOR DRAIN PER 0.8,C.9.31, 4.4,
OOR DRAIN PER 0.8,C.9.31, 4.4,
NLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE
PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY
ANDARD (O.B.C, SB-9)

6 GARAGE SLAB / EXTERIOR SLAB:
-4"(100mm) CONICRETE SLAB
-4"(100mm) CONICRETE SLAB
-4650psi (32MPa) COMPRESSINE SIRENGTH AFTER 28 DAYS FOR
UNREINFORCED CONC. & WJ 5-8%, AIR ENTRAINMENT - O.B.C. 9.3.1.6,
-6" X 6" (M2.9 X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
-4" (100mm) OF COURSE GRANULAR MATERIAL
-ANY FILL PLACED UNDER SLAB, OTHER THAN COURSE CLEAN GRANULAR
MATERIAL, SHALL BE COMPACTED.

7 PILASTERS: .C. 9.15.5.3.

PILASTER
-CONCRETE NIB - 4" X 12" (100mm X 300mm)
-BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9:20.11.2. TOP 7 7/8" (200mm) SOLID.

BEAM POCKET

-4" (100mm) INTO FEN. WALL W/ WIDTH TO MATCH BEAM SIZE.
-1/2" (13mm) SPACE AROUND WOOD BEAMS (0.8.C. 9.23.2.2.)

STRUCTURAL COLLIMNS
-SIZES BASED ON COLLIMNS SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4kPq).

STEEL PIPE COLUMN:
O.B.C. 9.15.3.4. & 9.17.3.
-FIXED COLUMN

O.B.C. Y. 1324-T. TEKED COLUMN
-MIN. 3 1/2" (90mm) DIA. W/3/18" (4.76mm) WALL THICKNESS
-FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (122mmX 100mmX 6.35mm) STEEL BTM, PLATE
-FOR WOOD BEAMS, MIN. 4" X4" X 1/4" (100mmX 100mm X 6.35mm) STEEL TOP & BTM, PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM -ADJUSTABLE COLUMNS TO CONFORM TO CAN//CGSB-7.2-M WHERE IMPOSED LOAD DOES NOT EXCEED 34 KN (O.B.C. 9.17.3.4.)
COL. SPACING:
FIG SIZE:

FIG SIZE:

3 STOREY -MAX. 9'-10" (2997mm) MAX. 16'-0" (4880mm) -34" X 34" X 16" - [860mmX 860mmX 400mm] -44" X 44" X 21" - [1120mmX 1120mmX 530mm]

MAX. 16'-0" (4880mm) - 40" X 40" X 19" - (1010mmX 1010mmX 480mm) - 51" X 51" X 24" - (1255mmX 1295mmX 610mm) USE 4" X 8" X 5/8" (100mmX 200mmX 6mm) ANCHOR BOLTS

WHERE COL. SITS ON FDN. WALL, 6mm) STEEL PLATE WITH 2-5/8" (1:

37-1 (SAW MILL)

ESQUIRE HOMES NORTHGLEN - PHASE : CLARINGTON, ONTARIO

N

O.B.C. 9.17.4.1.
-5 1/2" X.5 1/2" (140mm X 140mm) SOLID WOOD COLUMN.
-METAL SHOE ANCHORED TO FOOTING
-25" X.92" X 12" (640mmX 400mmX 300mm) CONC. PAD (1 FLOOR SUPPORTED W/ 9-10" COL. SPACING)
-34" X.94" X 14" (840mmX 840mmX 380mm) CONC. PAD (2 FLOORS SUPPORTED W/ 9-10" COL. SPACING)

10) BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)
2"X6"X12" LEDGER BOARD FASTENED W/ 2/ 1/2" ANCHOR BOLTS @ 4" O.C.
-WHERE WOOD BEAMS BEAR ON TREWALLS USE GENERAL NOTE 11
WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE
BETWEEN ADJACENT BEAMS

PLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM)
-12'X11''X 5/8" STL. PLATE ON YOP OF SOUD CONCRETE BLOCK WITH
2- 1/2'/0'x8" ANCHOR BOLTS.

WALL ASSEMBLIES:

(14) FOUNDATION WALL:
O.B.C. 9.15.4.2.
FOR WALLS NOT EXCEEDING 9"-10" (3000)

m) IN LATERALLY SUPPORTED

0mm) solid 2200psi (15MPg) concrete Unsupported Height of 3-11" (1200mm) & Max. Supported Height 3" (2150mm) Measured from Grade to Finished Basement Floor. Malls not exceeding 9-d" (2750mm) in Laterally Supported

T (250mm) SOLID 2200psi (15MPa) CONCRETE
T (250mm) MASSURED HEIGHT OF 4-7" (1 400mm) & MAX. SUPPORTED HEIGHT
88-6" [2600mm] MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
NERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS.
RE CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN ONFORMANCE TO O.B.C.-T.9.15.4.1 SHALL BE USED OR IT SHALL BE SIGNED UNDER O.B.C.-PART 4

YALL SHALL EXTEND A MIN. 5 7/8" (1 50mm) ABOVE GRADE
SULATE W/ R12 (823 (2.11) FROM UNDERSIDE OF SUBFLOOR TO NOT ONE THAN 8" (200mm) ABOVE FINISHED HOOR OF BASEMENT
ONE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT

SUSCEPTIBLE SOIL

REDUCTION OF THICKNESS:

THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS 1/2" (90mm) THICK.

ACING MATERIAL WITH METAL TIES SPACED MAX. @ 7 7/8" (200mm) LLY O.C. & 2"-1" (900mm) HORIZONITALLY.

CE BETWEEN WALL AND FACING SOLID W/ MORTAR WALL IS REDUCED FOR JOSTS, THE REDUCED THICKNESS SHALL BE WALL IS REDUCED FOR JOSTS, THE REDUCED THICKNESS SHALL BE 3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICKNESS SHALL BE

DAMPPROOFING & WATERPROOFING: -DAMPPROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C.

DAMPPROOF THE EXTERIOR FACE OF WALL DELOW GRADE, 9.13.2.
9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 4-9" (1450mm) BELOW GRADE, A FON, WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.(2) (3) (4)
-HNISHED BASEMENTS SHALL HAVE INTERIOR DAMPPROOFING EXTENDING FROM \$1.00 TO GRADE LEYEL & SHALL CONFORM TO O.B.C. 9.13.3.3.(3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN, WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMPPROOFING.

**(** 

EDUNDATION WALLS @ UNSUPPORTED OPENINGS:

-2-20M BARS IN TOP PORTION OF WALL (UP TO 8:-0" OPENING)

-2-20M BARS IN TOP PORTION OF WALL (8:-0" TO 10:-0" OPENING)

-4-20M BARS IN TOP PORTION OF WALL (10:-0" TO 15:-0" OPENING)

-BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL.

-BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER

-BARS TO EXTEND 2:-0" (600mm) BEYOND BOTH SIDES OF OPENING.

(<u>5</u>)

FRAME WALL CONSTRUCTION:

O.B.C. 9.23.

SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" [200mm] FROM FINISHED

GRADE (O.B.C. 9.26.1.4. & 9.27.]

-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.

-I/4" (6mm) PLYWOOD [EXTERIOR TYPE] OR EQUIVALENT AS PER O.B.C. 9.23.1.6.

-Z' X 6" [38mm X 1.40mm) WOOD STUDS @ 16" (400mm) O.C.

-MIN. R22 (R31.387) INSULATION (20NE 1. O.B.C. 1.2.1.1.2.A.]

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.

-I/Z" (12.7mm) GYPSUM BOARD

NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =

-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 1.40mm) STUDS ARE REQUIRED TO

BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4-0" LIMITING DISTANCE]:

O.B.C. SB-3 WALL = EWID (STC = NJA, FIRE = 45 MIN)

R 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING

. R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE IG MAITEMAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m. I 1/2" (127mm) INTERIOR GYPSUM BOARD WITH 1/2" (127mm) TYPE M BOARD.

REQ. FOR FIRE RATING (LESS THAN 2-0" LIMITING DISTANCE):
-REFER TO REQUIREMENTS FOR LESS THAN 4-0" LIMITING DISTANCE AND
ADD/REFLACE THE FOLLOWING:
-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO
ANNUFACTURER'S SPECIFICATIONS).

-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm)
GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV

**(F)** ALTERNATE FRAME WALL CONSTRUCTION: O.B.C. 9.23.

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 77/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
GRADE (O.B.C. 9.28.1.4.) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 7.7.7.7.4.) Tay

TINOTING TWICE.

"(38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.

TIOM FLR. WHEN 3 STOREYS.

SI 2.46) INSULATION (ZONE 1. O.B.C. T.2.1.1.2.A.)

INVOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3.

(12.7mm) GYPSUM BOARD.

OITE-SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. I. 9.23, 10.1, =
12 FLOORS SUPPORTED ABOVE, 2" X 4" (38:mmX 89:mm) STUDS ARE
URED TO BE SPACED @ 12" (300:nm) O.C.

3 FLOORS SUPPORTED ABOVE, 2" X 6" (38:mmX 140:mm) STUDS ARE
URED TO BE SPACED @ 12" (300:nm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4-0" LIMITING DISTANCE]:

O.B.C. SB-3 WALL = EWI b (STC = N/A, FIRE = 45 MIN)

O.B.C. SB-3 WALL = EWI b (STC = N/A, FIRE = 45 MIN)

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9-23.1.6. BETWEEN RIGD INSULATION AND WOOD STUD.
-REPLACE R14 [RS] 2-46] INSULATION WITH R14 [RS] 2-46) ASSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2-8 kg/ sq.m.
-REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE "X" GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

-REFER TO REQUIREMENTS FOR LESS THAN 4-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

-VINYL SIDING IS PERMITIED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIG INSULATION

(15b) FRAME WALL CONSTRUCTION & GARAGE:
O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM
FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.
9.23.16.

-2.7.16.
-2.7.4. [38mmX 89mm] WOOD STUDS @ 16" (400mm) O.C.
-1.7" (13.7mm) GYPSUM BOARD

NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 19.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR HRE RATING (LESS THAN 4-0" LIMITING DISTANCE):
O.B.C. SP-3 WALL = EWID (STC = N/A, FRE = 45 MIN)
FOR 45 MINUTE FIRE RATID WALL REQUIREMENTS SUBSTITUTE AND/OR ADD
THE FOLLOWING MATERIALS:
-ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
-REPLACE 1/2"(12.7mm) GYPSUM BD. W1 1/2" (12.7mm) TYPE "X" GYPSUM BD.
REQ. FOR FIRE RATING (LESS THAN 2-0" LIMITING DISTANCE AND
ADD/REPLACE THE FOLLOWING:
-REFER TO REQUIREMENTS FOR LESS THAN 4-0" LIMITING DISTANCE AND
ADD/REPLACE THE FOLLOWING:

-REFER TO REQUIREMENTS FOR LESS THAN 4"4" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS),

-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

(16) BRICK VENEER CONSTRUCTION:
O.B.C. 9-23,
-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. MIN. 0.03° (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. PERTICAL SPACING PROVIDE WEEP HOLES @ 2-7" (800mm)O.C. @ BTM. COURSE & OVER

ASHING UP TO 57/8" (150mm) BEHIND WALL SHEATHING NE (O.B.C. 9/20.13.6/2) ) R. STONE SILLS UNDER OPENINGS, FLASHING UNDER

TITI) AIR SPACE
SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
IMM1) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.

(38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. 22 [RSI 3.87] INSULATION (ZONE 1. O.B.C. T.Z.1.1.2.A.) NUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3

NOIE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE]:

O.B.C. SB-3 WALL = EWID (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD
THE FOLLOWING MATERIALS:
-REPLACE R22 [RSI 3.87] MULLATION WITH R22 [RSI 3.87] ABSORPTIVE
INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.
-REPLACE 1/2"(12/mm) GYPSUM BD. W/ 1/2" [12/mm) TYPE "X GYPSUM BD.

ⓒ

ALTERNATE BRICK VENEER CONSTRUCTION:

O.B.C. 9.23.
3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX.
HEIGHT
-MIN. 0.03" (0.74mm) THICK 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS
@ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL
SPACING

-PROVIDE WEEP HOLES @ 2:-7" (800mm)O.C. @ BTM. COURSE & OVER OPENINGS

4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm)
ON BOTTOM FLR. WHEN 3 STOREYS
ON BOTTOM FLR. WHEN 3 STOREYS
CEW/ CONI. 16 GALIGE STEEL T BRACES FROM TOP PLATE TO BTM.
EFOR THE FULL LENGTH OF WALL. OR
FLY X4" (38mmX 89mm) SOUD WOOD BLOCKING @ APPROXIMATELY
EG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL
(RE) 2.46) INSULATION
(RE) 2.46) INSULATION
RINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. &

1/2" (12.7mm) GYPSUM BOARD
1/12" (12.7mm) GYPSUM BOARD
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =
FOR 2 FLOORS SUPPORTED ABOVE, Z" X 4" (38mmX 89mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.
FOR 3 FLOORS SUPPORTED ABOVE, Z" X" (38mmX 140mm) STUDS ARE
REQUIRED TO BE SPACED @ 12" (300mm) O.C.

CONTRACTOR TYPE) OR EQUIVALENT AS PER O.B.C.
INSULATION AND WOOD STUD.
INSULATION WITH R14 (RSI 2.46) ABSORPTIVE
ITH A MASS OF AT LEAST 2.8 Kg/ sq.m.
GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

15 A KONNO ON TARIO PROPESSIONAL SHEET OF THE PROPESSIONAL SHEET FOR STRUCTURAL ONLY ♦ CLIENT SPECIFIC REVISIONS

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE ERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

OCT, 19/15 DATE 14093 N/A

OMPLIANCE PACKAGE J

DOUBLE VOLUME WALLS:

O.B.C. 9.23.10.1.

3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING REFER TO PLAN FOR STUD SPECIFICATION

STUDS FASTENED AT TOP & BOTTOM WITH 3/ 3-1/4" (82mm) TOE NAILS FOURLE OF PLATES FASTENED TOGETHER WITH 3' (76mm) AT 7/18" (200mm) O.C.

-SOLID BRIDGING AT 3'-11" (1200mm) O.C.

-MIN RZZ [RSI 3.87) INSULATION (ZONE 1. O.B.C. 1.2.1.1.2.A.]

-CONTINUOUS ARY/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C. CAVIIY.
71 | 72" (199mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
51AGGER JOISTS & BEAMS MIN. 3 1/2" (99mm) @ PARTY WALLS AS PER
O.B.C. 9.10.9.9.(1) & 1ABLE 2.1.1. SB-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)

(190) PARTY WALL - BLOCK (AGAINST GARAGE):
O.B.C. SB-3 WALL = BSC (\$TC = 51, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3.
& 9.25.4. O.B.C. 1.9.23.10.1.

2": A" (380mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
2": A" (380mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DOUBLE Z" A" OR Z" X 6" TOP PLATES AND SINGLE BOTTOM PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

BEARING STUD WALL (BASEMEND):

2": X 4" (380mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
2": X 6" (380mmX 400mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DBL Z" X 4" OR Z" X 6" TOP PLATE.
-Z" X 4" OR Z" X 6" BOTTOM PLATE ON DAMPPROOFING MATERIAL.
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
-FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB WALLS ADJACENT TO ATTIC SPACE

1/2" (12.7mm) GYPSUM BOARD

-1/2" (12.7mm) GYPSUM BOARD

-1.7" (12.7mm) GYPSUM BOARD

-2" X 6" (38mmX 140mm) WOOD STUD:

-2" X 6" (38mmX 140mm) WOOD STUD: 223.3. & 9.25.9.

EXPOSED FLOOR.

FLOOR AS PER NOTE # 28

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/
O.B.C.- 9.25.3. & 9.25.4.
-R31 [RSI 5.46] INSULATION
-VENTED ALUMINUM SOFFIT (9b) FIREWALL:

O.B.C. 9.10.11. & 3.1.10. & SB-3 WALL = B66 (STC = 57, FIRE = 2 HR)

O.NE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING

AREA, O.B.C. 1.3.2.2.47.

-1/2" (1.2.7mm) GYPSUM BOARD W/ TAPED JOINTS

-2" X.Z" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES PARTY WALL - BLOCK:

O.B.C. SB-3 WALL = B66 (STC = 57, FIRE = 2 HR)

-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS
TO THE UJS OF ROOP DECK

-SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/
MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO PREVENT

SMOKE PASSAGE (22) GARAGE WALL & CEILIN O.B.C. 9.10.9.16.1 20) PARTY WALL - FOUNDATION: O.B.C. 9.15.4.2. A Y.25.4.

2" X.4" (38mmX 89mm) WOOD STRAPPING @ 16" (400mm) O.C.

-R20 (RSI 3.52) RIGID INSULATION

-7 1/2" (192mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)

-1/2" (192mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN

HOUSE AND GARAGE

-TAPE AND SEAL ALL JOINTS GAS TIGHT

REQ. INSULATION VALUES:

INSULATION VALUES PROVIDED BY CAN/CSA-F280-M90

-RIGID INSULATION VALUES = 1.70

-WOOD FRANKE W/ GYPSUM

-0.88

-MR FILM - MOYING

-0.88

-AR FILM - STILL

-0.89

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.87

-0.88

-0.87

-0.88

-0.87

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.88

-0.8 -ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9:23.10.1. =
FOR 2 FLOORS SUPPORTED ABOVE. 2" X 4" (38mmX 89mm) STUDS ARE
REQUIRED TO BE SPACED ® 12" (300mm) O.C.
FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE
REQUIRED TO BE SPACED ® 12" (300mm) O.C. SORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE D ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
[190mm] CONC. BLOCK, MIN. 2 HR. HRE-RESISTANT RATING
[190mm] CONC. BLOCK, MIN. 2 HR. HRE-RESISTANT RATING
FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
DEF JOISTS & BEAMS MIN. 5' (130mm) @ FIRE WALLS AS PER
9.10.579.(1) & TABLE 2.1.1 SB-2
1STICAL SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)
1UDE PAST FASCIA @ EAVES W JRRICK CORBELLING
UDDE PAST FASCIA @ EAVES W JRRICK CORBELLING
D 5 7/8' (130mm) ABOVE ROOF SURFACES & HAVE ALLIMINUM CAP W /
GH WALL FLASHING PER O.B.C. 3.1.10.4.(1)

B THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER
10' (13m), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER
3.1.10.4.(2) J'AMN) GYPSUM BOAKU ON BOTH SIDES OF WALL & WAS OF CHEE
HOUSE AND GARAGE
SUD SEAL ALL JOINTS GAS TIGHT
13.827] INSULATION IN WALLS,
13.827] INSULATION IN WALLS,
15.847] INSULATION IN CEILINGS W/ FLOOR ABOVE
15.447] INSULATION IN CEILINGS W/ FLOOR ABOVE.
15.447] INSULATION IN CEILINGS W/ FLOOR ABOVE.
19.25.4... FOR FLOOR ABOVE.
19.25.4... FOR FLOOR ABOVE.
19.25.4... FOR FLOOR ABOVE.
19.25.4... FOR FLOOR ABOVE.
10.25.4... FLOOR ABOVE.
10.25.4.. MX 140mm) WOOD STUDS @ 16" (400mm) O.C. THINSULATION THING GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING I) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPG) STRENGTH AFTER 28 DAYS WALL TO REST ON FOCTING PER GENERAL NOTE #2 PSUM BOARD W/ TAPED JOINTS BOTH SIDES 9mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH ROVIDED AS PER O.B.C. 9.19.2.1. , BOARD ON BOTH SIDES OF WALL & U/S OF CEILING ARAGE RN STAFF DMPLIANCE PACKAGE J RRIER IN CONFORMANCE W/ O.B.C.-ESQUIRE HOMES
NORTHGLEN - PHASE 2
CLARINGTON, ONTARIO 37-1 (SAW MILL) FICOR JOIST AS PER FLOOR PLANS

(29) FORCH SLABS ABOVE COLD CELLAR:

O.B.C. 9.39.1.4.

REINFORCED CONCRETE SLABS ABOVE COLD CELLARS THAT ARE SUPPORTED ON FOUNDATION WALLS NOT TO EXCEED 8-2"

-4 1/8" (125mm) 4590 pci (32 MPG) CONCL. ASB WITH 5 TO 8% AIR ENTRAINMENT REINFORCE WITH 1 (0M RARS @ 7 1/8" (220mm) EACH WAY

-1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB

3" (75mm) END BEAGING ON FOUNDATION WALL

-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.

-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.

-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.

-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.

-23 5/8" (600mm) X 25/8 1/20 DECKING W/ 1/4" SPACING

-2"X-4" WOOD PURLINS (CUT DIA-GONALLY) @ 12" O.C. LA TYNG UNFASTENED

ON SINGLE PLY WATERPROOF ROOF REMBRANE OR EQUIVALENT ON 5/8"

[15.5mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"X" WOOD PURLINS

[CUT DIA-GONALLY) @ 12" O.C. DIRECTLY ON 2"X" "ROOF JOISTS @ 12" O.C.

[OR AS NOTED ON PLAN]

-EXTERIOR GUARD AS PER #33G

-SUOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER

REQUIRED FOR OVER HEATED SPACES;

R

-ADD 2"X2" (38mm X 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENITIATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF CELLING AREA)

-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.

& 9.25.4. VAULTED OR CATHEDRAL CEILING:

O.B.C. 9.26. & TABLE A4
-NO. 210 (33. SKG/m2) ASPHALT SHINGLES
-FOR ROOFS BERWEEN 412 & 812 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WAIL.
-EAVES PROTECTION LAD BENEATH STARIER STIPP.
-EAVE PROTECTION NOT REQUIRED OVER UN-HEATED SPACES OR WHERE ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1.
-STARTER STIPP NOT REQUIRED AS PER O.B.C. 9.26.7.2.
-30" (100mm) PLYWOOD SHEATHING OR O.SB (0-2 GRADE) WITH "H" CLIPS.
-278" (39mm x 184mm) @ 16" O.C. W 17.27" (39mm x 38mm) CROSS PURLINS
@ 24" O.C. MAX. SPAN 135-3" (4050mm) OR O.B.C. 9.23.7.

2" X.4" (38mm X 89mm) PLATE

-1/Z" (12.7mm) DIA. ANCHOR BOLIS @ 7-10" (2400mm) O.C. FASTENED TO PLATE WY NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4" (100mm) INTO FOUNDATION WALL

-SIL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1" (25mm) THICK BEFORE COMPRESSING, OR FOAM GASKET, OR PLACED ON FULL BED OF MORTAR.

27) BRIDGING & STRAPPING:

O.B.C. 9.23.9.4.

ALSTRAPPING: (32) CELLING:
-RS0 (RSI 8.8) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. (4) --UNE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA ATFOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS.

--WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION WALLS INSTEAD OF USING BEARING POSTS.

-FLOOR STRUCTURE AS PER NOTE # 28.

25 DOUBLE MASONRY WYTHE WALL:

O.B.C. 9.20.8.2. SINGLE PLY WATERPROOF ROOF (%) (250) CORBEL MASONRY VENEER:
-MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1) (28) FLOOR ASSEMBLY: O.B.C. 9.26.

-NO. 210 (30. SKG/m2) ASPHALT SHINGLES
-NO. 210 (30. SKG/m2) ASPHALT SHINGLES
-NOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE E. VES PROTECTIF
EXTEND UP THE ROOF SLOPE MIN. 2-11" (900mm) FR MA EDGETO A
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTRIOR WALL.
-EAVES PROTECTION IADD BEN-EATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UN-HEATED SNOW
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-396" (100mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH
-APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUF ROOF ASSEMBLIES SILL PLATE: O.B.C. 9.23.14.3, 9.23.14.4 -5/8" (15.9mm) WAFERBOARD (R-1) GRADE) OR EQUIVALENT -FLOOR JOISTS AS PER FLOOR PLANS STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
30°C (10mm) PLYWOOD SHEATHING OR OSB (D-2 GRADE) WITH "H" CLIPS.
27'S" (38mm x 184mm) @ 16" O.C. W/ 27'Z" (38mm x 38mm) CROSS PURLINS
28" (O.C. MAX. SPAN 13'-3" (4050mm) OR
2'X IOC. MAX. SPAN 13'-3" (4050mm) OR
2'X IOC. MAX. SPAN 13'-3" (5180mm)
URLINS @ 24" O.C. MAX. SPAN 17'-0" (5180mm) 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.) ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C.-T.9.29.5.3.) FLOOR ASSEMBLIES: -3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER
-WYTHES TO BE TIED W/ METAL TIES INSTALLED AS PER O.B.C. 9,20,9,4.

SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS
-4" SILL W/ 2" BEARING ON EACH SIDE & ANCHOR BOILS @ 4-0" O.C.
-4" SILL W/ 2" BEARING ON EACH SIDE & MORTAR JOINT FILLED SOILD FOR FLOOR
JOISTS BEARING ON WYTHES, FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY
AREA. "Y.3" (19mm) OR 2" X 2" (38mmx 38mm) CROSS BRIDGING @ MAX.
-1,1" (2108mm) O.C.
-1,1" ( GLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT TALLED PER MANUFACTURER'S SPECIFICATIONS.
"EXTERIOR GRADE WOOD PANIEL TYPE UNDERLAY TAPERED PURLINS PED MIN. 2% TO ROOF SCUPPER.
"EXTERIOR GRADE PLYWOOD SHEATHING ON BY ROOF SCUPPER."
"EXTERIOR GRADE PLYWOOD SHEATHING ON PLAN)
"EXTERIOR GRADE PLYWOOD SHEATHING ON PLAN)
"EXTERIOR GRADE PLYWOOD SHEATHING ON PLAN) SS BRACING AS PER TRUSS MANUFACTURER ESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR MINUM) C VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT. mmx 64mm) NAILED TO U/S OF JOISTS @ MAX. 6-11" (2100mm) O.C TO SILL OR HEADER @ ENDS IG ILDING CODE. ISSUED OR REVISION COMMENTS OMOBESSION IN THE PROPERTY OF GEOF ON THE COM EXTERIOR GUARDS:

O.B.C. 58-7 & 9.8.8.3.

-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN 23 5/8" (800mm)).

-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN 25 5/8" (800mm).

-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2\*-11" (900mm) HIGH FOR DWELLING UNITS GUARDS TO BE 3-4" (1000mm) HIGH WHERE WALKING SURFACE IS MORE THAN 5\*-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (1000mm) MAX. SPACING
-PROVIDE MID-SPAN POSTS AS PER 58-7.
-GUARDS FOR FLIGHTS OF SITETS (EXCEPT EXIT STAIRS) TO BE 2\*-11" (900mm) HIGH THESE DRAWINGS ARE NOTTO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK.
ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD O.B.C. 9.8.4

-MAX. RISE = 7-3/32' (180mm)

-MIN. READ = 11" (280mm)

-MIN. READ = 11" (250mm)

-MIN. HEADROOM = 6-9" (250mm)

-MIN. WIDTH = 2-11" (900mm)

-MIN. WIDTH = 2-11" (900mm)

-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS

-FOUND, WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2

-FIG. FOR FOUND, WALL TO BE MIN. 4-0" (1220mm) BELOW GRADE GENERAL:

(35) PRIVATE STAIRS:

O.B.C. 9.8.4.

-MAX. RSE

-8-1/4" (210mm)

-MINI. IREAD

-9-1/4" (235mm)

-MIN. WOONG

-1" (25mm)

-MIN. HEADROOM = 6'-5" (1950mm)

-MIN. WIDTH

-MIN. WIDTH

(BETWEEN WALL FACES)

-MIN. WIDTH

-2'-11" (900mm)

(BETWEEN WALL FACES)

-MIN. WIDTH

-2'-11" (900mm)

(BETWEEN WOOD PICKEIS MAX. 4" BETWEEN PICKEIS

-FXIEROR CONC. SIEPS 10 HAVE MIN. 9 1/4" (235mm) TREAD &

MAX. 7 7/8" (200mm) RISE

-FOLIND. WALL REQUIRED WHEN NUMBER OF RISERS EXCREDS 2

-FIG. FOR FOUND. WALL TO BE MIN. 4-0" (1220mm) BELOW GRADE -R31 (RSI 5.46) INSULATION

-MINL 3" CLEARANCE FROM U/S OF ROOF SHEATHING TO INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH
O.B.C. 9.25.3. & 9.25.4.

-1/2" (12.7mm) GYPSUM BOARD

CONVENTIONAL FRAMING:
O.B.C. TABLE A6 OR A7

-2" X 6" (38mm X 140mm) RAFIERS ® 16" (400mm) O.C. MAX. SPAN 12-9"
(3990mm)
-2"X4" (39mm X 89mm) COLLAR TIES AT MIDSPANS
-CELING JOSIS TO BE 2" X 6" (39mmX 140mm) @ 16" (400mm) O.C.
UNLESS OTHERWISE NOTED.

UNLESS OTHERWISE NOTED.

UNLESS OTHERWISE NOTED.

RAFIERS & MIN. 1 1/2" (39mm) THICK. (36) INTERIOR GUARDS:
O.B.C. SB-7 & 9.8.8.3.
-GUARDS TO BE 3-6" (1070mm) HIGH
-FOR DMELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-INCLUDES WINDOWS OVER STARS, RAMPS AND LANDINGS
-PICKEIS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900m (34) ATTIC ACCESS HATCH:
O.B.C. 9.19:2.1.
-19:3/4" X 27:1/2" (500mm X 700mm) ATTIC HATCH WITH
WEATHERSTRIPPING & BACKED W/ R20 (RS):3.52) INSULATION. HEIGHT:

O.B.C. 9.8.7.4

-2-10" (865mm) MIN. TO 3-2" (965mm) MAX.

-3-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS)

- MEASURED VERTICALLY REMOM THE TOP OF THE HANDRAIL TO A

STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING O.B.C. 9.8.9.6

TIREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE FROM DEFECTS PER OBC 9.8.9.6.(4)

STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE VISUAL PATTERN TO DEMARCATE THE LEADING EDGE OF THE TREADS, LANDING AND THE BEGINNING AND END OF A RAMP. O.B.C. 9.8.7

O.B.C. 9.8.7

ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3"-7" (1100mm)

-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3"-7" (1100mm)

-TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH

-HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT

WHERE INTERRUPTED BY DOOR WAYS OR NEWEL POSTS AT CHANGES IN

DIRECTION HEIGHT:
O.B.C. 9.B.7.4
-2-10" (865mm) MIN. TO 3"-2" (965mm) MAX.
-2-2-10" (865mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A
STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING HANDRAILS:

O.B.C. 9.8.7

O.B.C. 9.8.7

O.B.C. 9.8.7

ONE HANDRAIL REQUIRED WHERE STAR WIDTH IS LESS THAN 3'-7" (1100mm)

-TWO HANDRAIL S REQUIRED WHERE STAR WIDTH EXCREDS 3-7" (1100mm)

-ONE HANDRAIL IS REQUIRED ON CURVED STARS OF ANY WIDTH WITHIN

ONE HANDRAIL IS REQUIRED ON CURVED STARS OF ANY WIDTH WITHIN

DWELLING UNITS

HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR

WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION PROJECTIONS:

O.B.C. 7,8,7,6

C.B.C. 7,8,7,6

HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR O.ECTIONS:

O.B.C. 9.8.7.6

O.B.C. 9.8.7.6

O.B.C. 9.8.7.6

O.B.C. 9.8.7.6

O.B.C. 9.8.7.6

PAIN CRES TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED TO FIHE STAR ENT SPECIFIC REVISIONS ÎATION: D.B.C. 9.8.7.3 HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4" m) BEYOND THE TOP & BOTTOM OF EACH STAIR AS OCT, 19/15 DWN CHK 14093 N/A

(%)

EXTERIOR GUARDS & JULIET BALCONY:

-FOR RAILING SPANNING MAXIMUM OF 6'-0":
-PROVIDE PREFIN, METAL RAILING W/76mm VERTICAL OPENING TO
-PROVIDE PREFIN, METAL APPENDIX A-9.8.8.5.
-GUARDS TO BE 3-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE 2-11" (1800mm) AS PER O.B.C.
-P.8.8.2. OR
-FOR DWELLING UNITS GUARDS TO BE 3-6" WHERE FLOOR TO
-FOR DWELLING UNITS GUARDS TO BE 3-6" WHERE FLOOR TO
-FOR DWELLING UNITS GUARDS TO BE 3-6" WHERE AS PER O.B.C.
-PROVIDE TO STUDIOS
-FOR DWELLING UNITS GUARDS TO BE 3-6" WHERE AS PER O.B.C.
-PROVIDE TO STUDIOS
-PROVIDED TO STUDIOS
-PROVIDE

ROWS OF 3/8"0 MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN. EMBEDMENT TO STUDS.
-PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.
-LINEN CLOSET 4 SHELVES MIN. 1"-2" (350mm) DEEP

-INEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEER

-WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE
AIR CHANGE PER HOUR. O.B.C.- 9:32.1:3.(3)

-CAPPED DRYER VENT

-WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT
WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM
CONCRETE W/ 6 mil POLYETHYLENE.

42 -PRECAST CONC. STEP
2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND

442 -2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND

SMOKE ALARM, O.B.C.- 9.10.19.

-PROVIDE 1 ON EACH HALDROR INCLUDING BASEMENTS
-PROVIDE 1 IN EACH BEDROOM
-PROVIDE 1 IN EACH BEDROOM
-PROVIDE 1 IN EACH HALLWAY SERVICING BEDROOMS
-INSTALLED AT OR NEACH CELLING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL
ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A
VISUAL SIGNALLING COMPONEN
-ALARMS MILL SIGNALLING TOMPONER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM

THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM

CARBON MONOXIDE ALARM (CMA), O.B.C.- 9.33.4.

WHERE THERE IS A FUEL BURNING APPUANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEPPING AREA.

-CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.

-MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY
-PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG.
UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT.
-R4 [RSI 0.70] WHERE A STORM DOOR IS NOT PROVIDED

(47) -GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.-R4 (RSI 0.70)

(48) -TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT;

1) WHERE THAT, FLOOR LEVEL HAS ACCESS TO A BALCONY OR

2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3"-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3"-3" (1000mm) ABOVE FLOOR AND 23"-0" [7.0m) ABOVE ADJACENT GROUND LEVEL.

CLIENT SPECIFIC REVISIONS

### (3)

EXTERIOR COLUMN:

-MIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/
METAL SADDLE

NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.

### (8) COLD CELLARS:

FOR COLD CELLARS PROVIDE THE FOLLOWING:

-VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.

-COVER VENT W/ BUG SCREEN

-WALL MOUNTED LIGHT FIXTURE

-L1+1/ FOR DOOR OPENING

-L1+1/ FOR DOOR OPENING

-NSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)

STUD WALL REINFORCEMENT:

O.B.C. 9.5.2.3.

-WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)[0]& 3.8.3.13.(4)[c]

3.8.3.13.(4)[c]

-CRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)

FRAME CONSTRUCTION:
-ALL FRAMING LUMBER TO BE No.1 AND No. 2 SPF UNLESS NOTED DING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND

JOIST TO HAVE MIN. 1-1/2" (38mm) END BEARING
-BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING
-BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING
-DOUBLE SIUDS @ OPENINGS
-DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE
BETWEEN 3-11" (1200mm) AND 10'-5" (3200mm)
-DOUBLE RIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2-7"
(800mm) AND 6-7" (2000mm)
-DOUBLE JOIST OR SOUD BLOCKING UNDER NON-LOAD BEARING
-PARALLEL PARTITIONS
-BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE
-BEAMS TO BE PLACED UNDER

-BEAMS MAY BE A MAX. 24" (600mm) FROM LOADBEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS
-APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X 184mm)

-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE HAN 23 5/8" (620mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 235mm) OR LARGER.

-WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER
-WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL
HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF
1.8 W/[m2.K) OR
-AN ENERGY RATING OF NOT LESS THAN 21 FOR OPERABLE WINDOWS &
31 FOR FIXED WINDOWS
-BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL
BE DOUBLE GLAZED WITH LOW-E COATING
-SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF
2.8 W/[m2.K] SKILIGHTON TO THE SKILIGHTON THE

ADDITIONAL COMPILANCE ALTERNATIVES FOR PACKAGE J.

THE MINIMUM R (RS)) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED: THAT THE WINDOWS AND SLIDING GLASS DOORS HAVE A MAXIMUM U-VALUE OF 1.6, OR THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A MINIMUM R20 (RSI 3.52).

ON THE MINIMUM R20 (RSI 3.52).

ON THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT:

ON THE THERMAL INSULATION VALUE IN A CELLING WITH AN ATTIC SPACE IS NOT LESS THAN R20 (RSI 3.52) PROVIDED THAT:

b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 PERCENTAGE POINTS.

C) THE MINIMUM AFUE OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS.

d) THE MINIMUM AFF OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY NOT LESS THAN 4 PERCENTAGE POINTS.

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

# FOR STRUCTURAL ONLY



### DOORS (46\(\)(47\) A 865x2030x45 (2'10"x6'8"x1-3/8") B 815x2030x35 (2'8"x6'8"x1-3/8") C 760x2030x35 (2'6"x6'8"x1-3/8") D 710x2030x35 (2'4"x6'8"x1-3/8") E 460x2030x35 (1'6"x6'8"x1-3/8") F 610x2030x35 (2'0"x6'8"x1-3/8") G 0VER 87FCC EVTEDING TOWNST WD1 3/2" X8" SPR WD2 4/2" X8" SPR WD3 5/2" X8" SPR WD4 3/2" X10" SPR WD5 4/2" X10" SPR ST1 W6 X 15 ST2 W6 X 20 2 2 2 3 4 4 7 2/2" X 8" SPR 2/2" X 10" SPR 2/2" X 12" SPR 2/12" X 3-1/2" X 1/4" L 4" X 3-1/2" X 1/4" L SCHEDULES WOOD BEAMS WZX8"SPR WD6 5/2"X10"SPR WI 5/2"X8"SPR WD7 3/2"X12"SPR WI 5/2"X8"SPR WD8 4/2"X12"SPR WI 3/2"X10"SPR WD9 5/2"X12"SPR WI STEEL BEAMS ST3 W8×18 ST4 W8×21 LINTELS 0 4-7/8" X 3-1/2" X 5/16" L 1 4-7/8" X 3-1/2" X 3/8" L 2 4-7/8" X 3-1/2" X 1/2" L 3 5-7/8" X 3-1/2" X 3/8" L 4 5-7/8" X 3-1/2" X 1/2" L WD10 2/1 3/4" X7 1/4" (2.0E] LVL WD11 3/1 3/4" X7 1/4" (2.0E] LVL WD12 2/1 3/4" X9 1/2" (2.0E] LVL WD13 3/1 3/4" X1 17/6" (2.0E] LVL WD14 2/1 3/4" X11 7/6" (2.0E] LVL WD15 3/1 3/4" X11 7/6" (2.0E] LVL L15 L16 L17 ST5 W8 X 24 5 5-7/8" X 4" X 1/2" L 5 7-1/8" X 4" X 3/8" L 7-1/8" X 4" X 1/2" L

**⊕ ™ Ш □ C ⊕ >** 

			CINI DACEMENT	)	•	
			TIN. DAGENENI	_	_	l
EVATION LEGEND	JNE		TOTAL $(ft^2)$	1672	1707	l
CARBON MONOXIDE	X	FLOOR DRAIN	LOFT PLAN	N/A	N/A	l
DOUBLE JOST	⊠ .	(TO BE SAME WIDTH AS	TOTAL (ft²)	1672	1707	
PRESSURE TREATED LUMBER	Ø	X POINT LOAD	(m <sup>2</sup> )	155.3	158.6	
GURDER TRUSS		FLAT ARCH	COVERAGE (ft²)	997	1015	
ABOVE FINESHED PLOOR	XXXXX	XXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXXX			3	
EXT. LIGHT PIXTURE	S/U	UNDER SIDE	W/O PORCH(m <sup>-</sup> ) 92.6		94.3	l
(MALL MOUNTED)	FG	PIXED GLAZING	COVERAGE (#2)		200	
HYDRO METER	GB	GLASS BLOCK		10	0711	
GAS METER	BG	BLACK GLASS	W/ PORCH (m <sup>2</sup> ) 103.6 104.8	103.6	104.8	
						ı

VENTS AND INTAKES

D.J. P.T.

WATERPROOF
DUPLEX OUTLET SMOKE ALARM

**(1)** P42

PLAN/ELEV

TOTAL

(ft<sup>2</sup>)

1672

1707 49 1756 966 790

DEDUCT O.T.B.

49

TOTAL

(ft²)

1721

948

FIRST FLOOR SECOND FLOOR

773

**ELEVATION** 

œ

OOR

ARE

D


O

ALCUL

ATIONS

**4**5

			_									
REVISED: JANUARY 08, 2015 - RN STAFF IN ACCORDANCE TO SB-12 COMPLIANCE PACKAGE J CLIENT SPECIFIC REVISIONS		TEL.(905)738-3177 FAX.(905)738-5449	Imagine - Inspire - Create			ノ		TARY SEASO	STORE PLACE VENT	COLD CRITAR ABALL (20)	(38) EXHAUST FAN	
SNS	2 COMPLIANCE PACKAGE J	115 - RN STAFF	CLARIN	NORTHG	ESQUI		0,-1	7 1-25 MODEL 32-1	G CAS METER	PENT HYDRO METER	Φ-	G.T.
CLASSES/CATEGORIES.	UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE.  AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE.	I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED	CLARING ION, ON IARIO	NORTHGLEN - PHASE 2	ESQUIRE HOMES		CONTRICE)	37-1 /SA\A/ NIII \	BG BLACK GLASS	ABTER GB GLASS BLOCK		ANOVE TRUSS  ANOVE
	THE BUILDING CODE.	ED AND TAKE DESIGN					1. UPDATED T	No. ISSUED (		~ \$		HCH
DATE: 0CTOBER 19, 2015	FIRM BCIN: 26995	QUALIFIED DESIGNER BCIN: 21032 SIGNATURE:					UPDATED TO OBC 2012 - 2015 ENACTMENT	No. ISSUED OR REVISION COMMENTS	W/ PORCH (m <sup>2</sup> ) 103.6 104.8	COVERAGE (ft <sup>2</sup> ) 1115	W/O PORCH(m <sup>2</sup> ) 92.6	COVERAGE (ft²) 997
5	L	SIGNAT							3.6 10	15 1128	.6 94.3	7 1015
		URE:					OCT. 19/15	DATE	4.8	28	3	15
							1	DWN CHK SCALE				
							NC	CHK :				
	[		フ 3	PAGE	14093	PROJECT NUMBER	N/A	""				

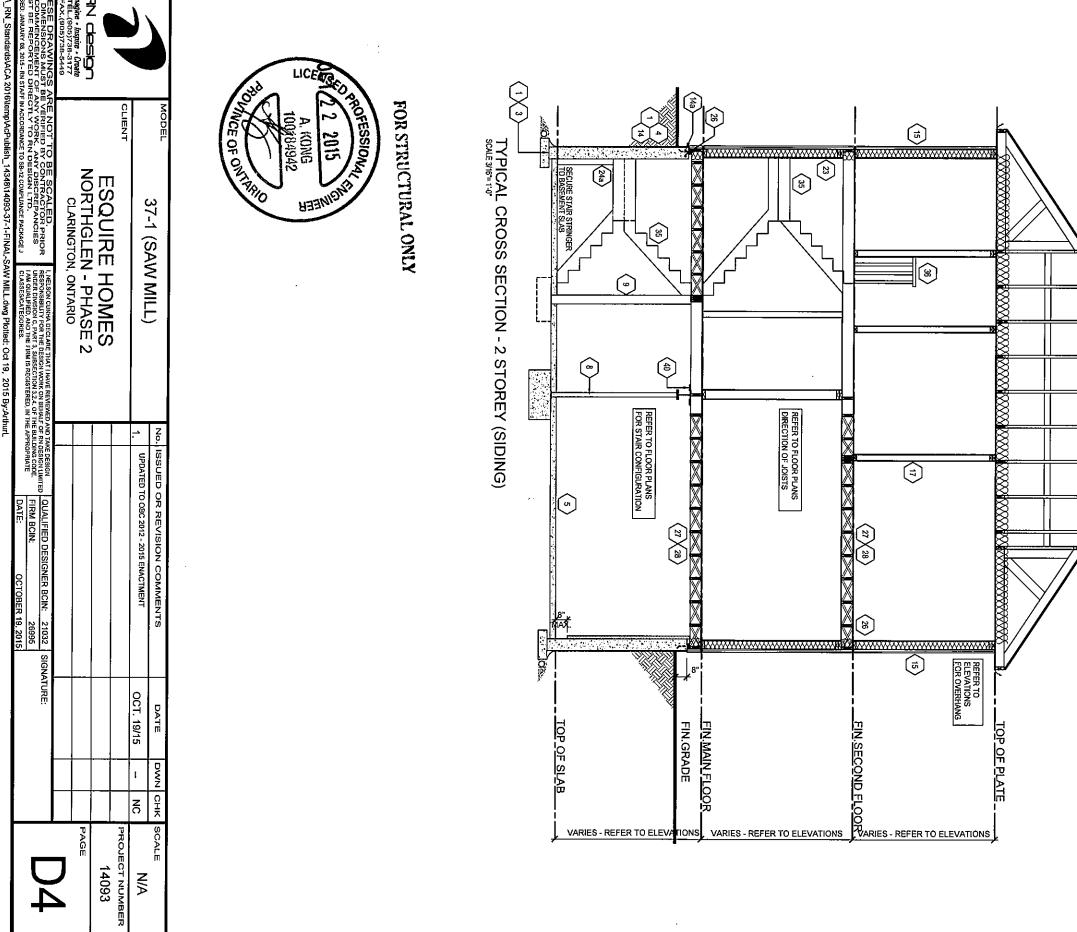

(32)