



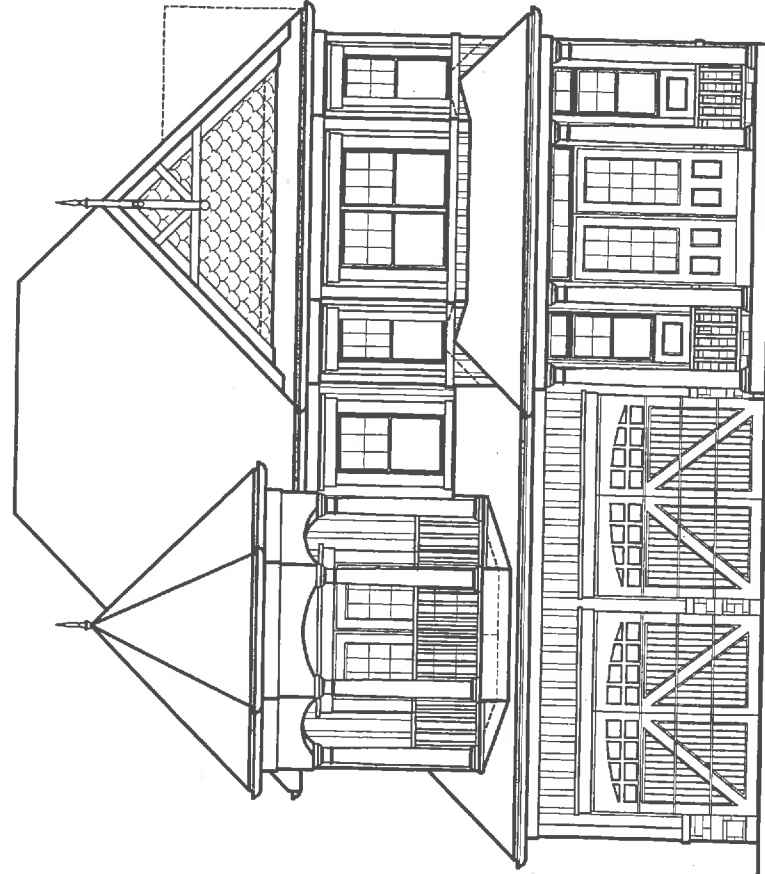

FRONT ELEVATION 'A'

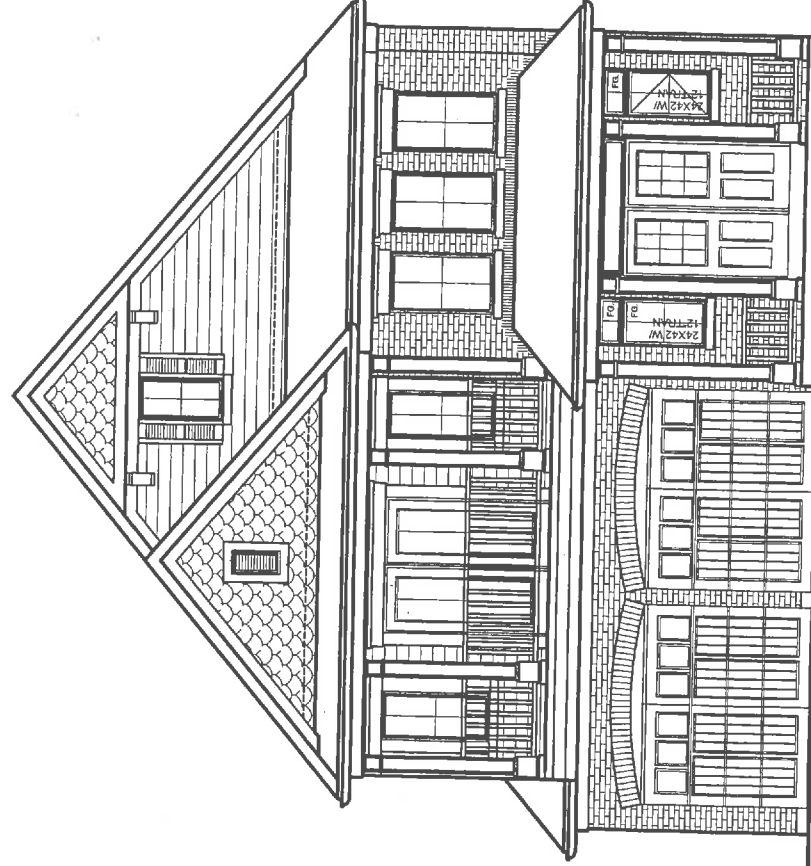

FRONT ELEVATION 'B'

DRAWING LIST:

40-5 (GEORGE)

- | | |
|------|-------------------------------|
| T1 | TITLE SHEET |
| A1 | BASEMENT FLOOR ELEV. 'A' |
| A2 | GROUND FLOOR ELEV. 'A' |
| A3 | SECOND FLOOR ELEV. 'A' |
| A4 | BASEMENT FLOOR ELEV. 'B' |
| A5 | GROUND FLOOR ELEV. 'B' |
| A6 | SECOND FLOOR ELEV. 'B' |
| A7 | FRONT ELEVATION 'A' |
| A8 | RIGHT SIDE ELEVATION 'A' |
| A9 | REAR ELEVATION 'A' |
| A10 | LEFT SIDE ELEVATION 'A' |
| A11 | FRONT ELEVATION 'B' |
| A12 | RIGHT SIDE ELEVATION 'B' |
| A13 | REAR ELEVATION 'B' |
| A13a | UPGRADED REAR ELEVATION 'B' |
| A14 | LEFT SIDE ELEVATION 'B' |
| A15 | BASEMENT FLOOR ELEV. 'A' |
| A16 | SIDE UPGRADE CONDITION |
| A17 | GROUND FLOOR ELEV. 'A' |
| A18 | SIDE UPGRADE CONDITION |
| A19 | SECOND FLOOR ELEV. 'A' |
| A20 | SIDE UPGRADE CONDITION |
| A21 | FRONT ELEV. 'A' |
| D1 | UPGRADE CONDITION |
| D2 | UPGRADED RIGHT SIDE ELEV. 'A' |
| D3 | PARTIAL PLANS |
| D4 | WALKOUT DECK CONDITION |
| D5 | UPGRADED REAR ELEVATION 'A' |
| D6 | WALKOUT DECK CONDITION |
| D7 | CONSTRUCTION SHEET |
| D8 | CONSTRUCTION SHEET |
| D9 | CONSTRUCTION SHEET |
| D10 | TYPICAL SECTION |

GROSS GLAZING AREA 'A'

TOTAL PERIPHERAL WALL AREA	3042.00 SF	282.60 m ²
FRONT GLAZING AREA	101.41 SF	9.42 m ²
LEFT SIDE GLAZING AREA	50.83 SF	4.72 m ²
RIGHT SIDE GLAZING AREA	62.5 SF	5.81 m ²
REAR GLAZING AREA	106.75 SF	9.92 m ²
TOTAL GLAZING AREA	321.49 SF	29.87 m ²
TOTAL GLAZING PERCENTAGE	10.57 %	

GROSS GLAZING AREA 'B'

TOTAL PERIPHERAL WALL AREA	3036.96 SF	282.13 m ²
FRONT GLAZING AREA	104.25 SF	9.68 m ²
LEFT SIDE GLAZING AREA	50.83 SF	4.72 m ²
RIGHT SIDE GLAZING AREA	62.5 SF	5.81 m ²
REAR GLAZING AREA	106.75 SF	9.92 m ²
TOTAL GLAZING AREA	324.33 SF	30.13 m ²
TOTAL GLAZING PERCENTAGE	10.68 %	

ESQUIRE HOMES

NORTHGLEN

CLARINGTON, ONTARIO



Imagine • Inspire • Create

8395 JANE STREET
SUITE 203
VAUGHAN, ON
TEL: 905-738-3177
FAX: 905-738-5449

CONTACT PERSON:

REVISION COMMENTS:

No.	REVISION COMMENTS:	DATE	DWN	CHK	No.	REVISION COMMENTS:	DATE	DWN	CHK	SCALE
1.	UPDATED TO OBC 2017 ENACTMENT	AUG. 28-2017	SB	NC						AS NOTED
2.	REVISED AS PER ENG. COMMENTS	SEPT. 27-2017	HAZ	NC						
3.	ISSUED FOR FINAL	OCT. 03-2017	SB	NC						

PROJECT No.

16062


THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS ARE TO BE VERIFIED BY CONTRACTOR PRIOR
TO COMMENCEMENT OF WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.

I, NELSON CUNHA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN
RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD.
UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE.
I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE
CLASSIFICATION CATEGORIES.

QUALIFIED DESIGNER BCIN: 21039
FIRM BCIN: 26999
DATE: OCTOBER 03, 2017

SIGNATURE:

T1

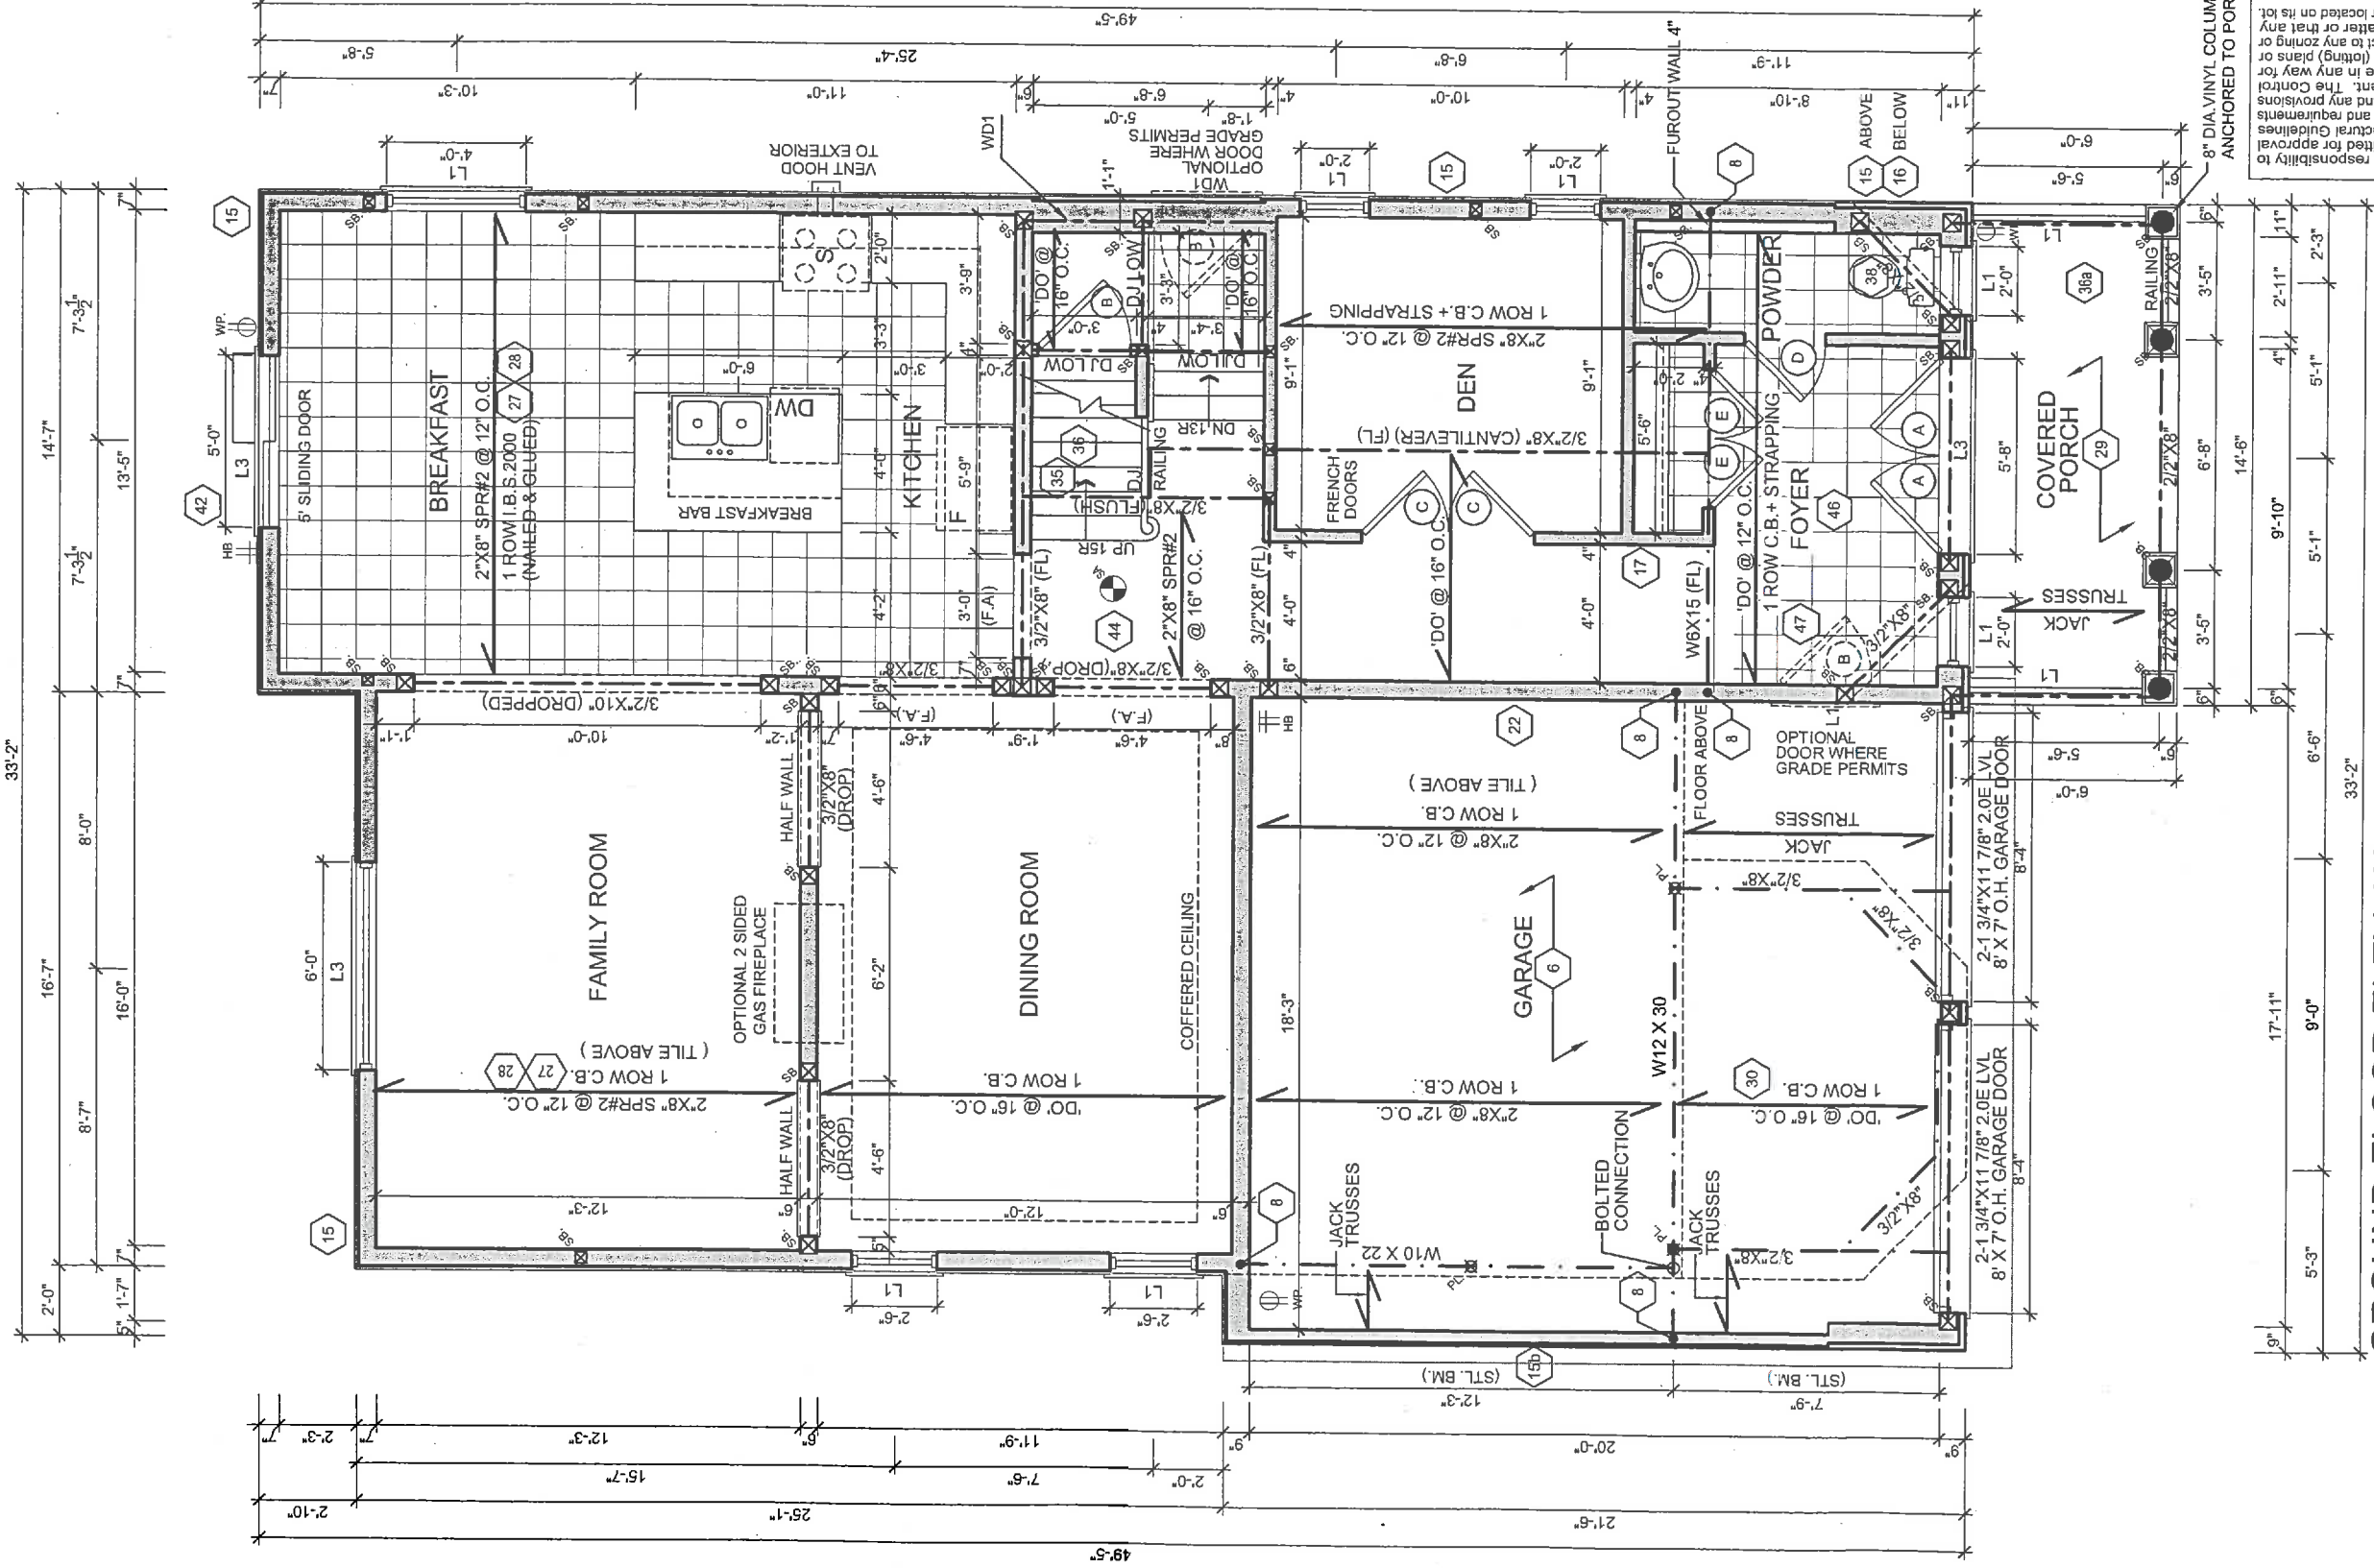

GROUND FLOOR ELEV. 'A'

NOTE:
SPACE ALL FLOOR JOISTS @ 12" O.C.
UNDER ALL CERAMIC TILES AREA

NOTE:
CONC. FRONT PORCH
POURED PRIOR TO BRICK



MODEL 40-5 (GEORGE)
CLIENT ESQUIRE HOMES NORTHGLEN CLARINGTON, ONTARIO

No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE	PAGE
1.	UPDATED TO OBC 2017 ENACTMENT	AUG. 28-2017	SB	NC	3/16" = 1'0"	16062
2.	REVISED AS PER ENG. COMMENTS	0 SEPT. 27-2017	HAZ	NC		
3.	ISSUED FOR FINAL	OCT. 03-2017	SB	NC		
						A2

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR
TO CONSTRUCTION. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RND DESIGN LTD.




I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN
RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RND DESIGN LIMITED
UNDER MY PROFESSIONAL CLASST 5, SUBSECTION 32.4 OF THE BUILDING CODE.
CLASSIFICATION: CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26896
DATE: OCTOBER 03, 2017

SIGNATURE:

This is to certify that these plans comply
with the applicable Architectural Design
Guidelines approved by the Municipality of
CLARINGTON.
Architect is not responsible in any way for
the subdivision agreement. The Control
including zoning provisions and any provisions
and all applicable regulations and requirements
fully comply with the Architectural Guidelines
ensure that all plans submitted for approval
It is the builder's complete responsibility to

0 5 2017
J. G. ALVAREZ
LICENSED PROFESSIONAL ENGINEER
756-9638 Fax: 1501-180-8998

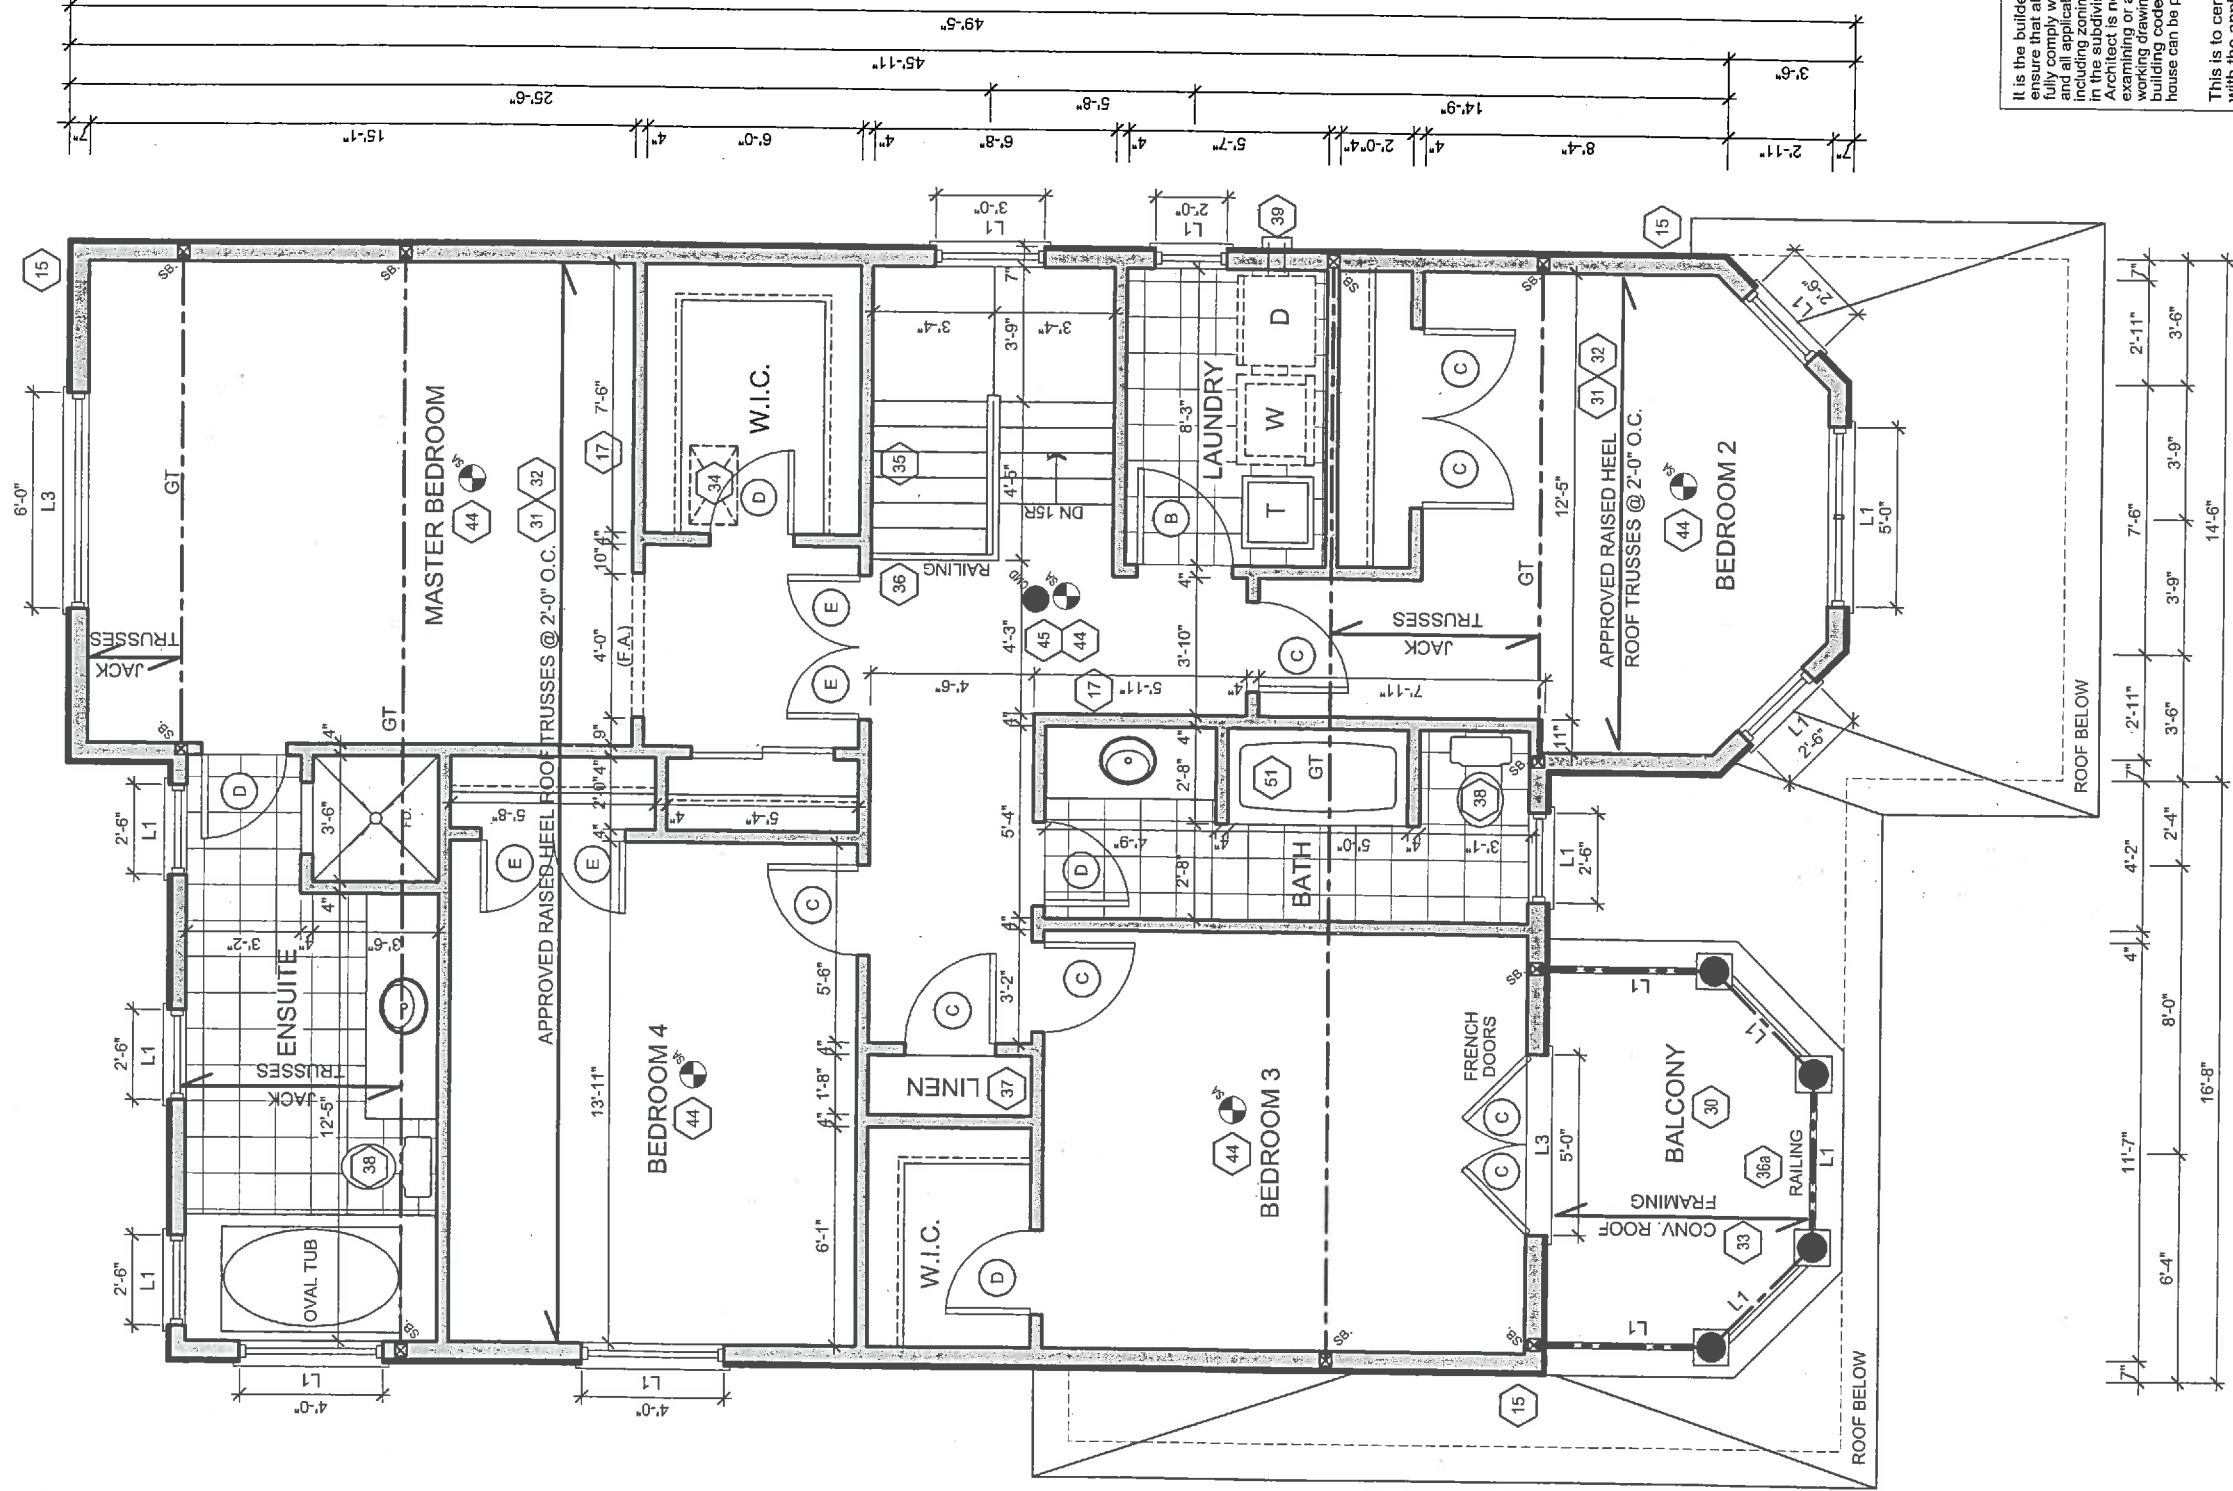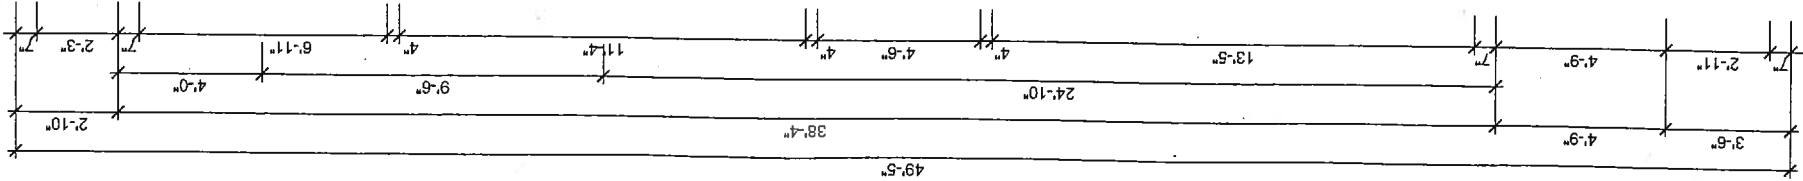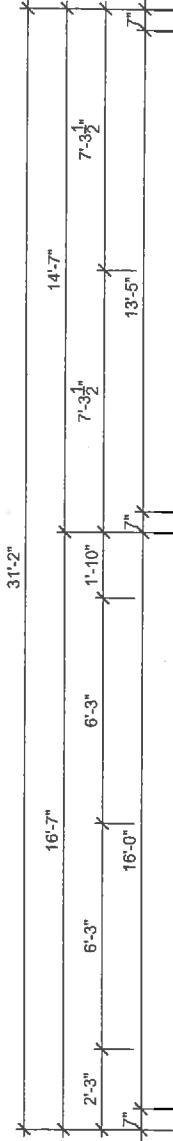

SECOND FLOOR ELEV. 'A'

NOTE:
SPACE ALL FLOOR JOISTS @ 12" O.C.
UNDER ALL CERAMIC TILES AREA

NOTE:
CONC. FRONT PORCH
POURED PRIOR TO BRICK

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements in the City of Clarington. The Architect or Architect-in-Charge is not responsible for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.


ARCHITECTURAL REVIEW & APPROVAL
OCT 10 2017
John G. Williams, Architect

05 2017
ENGINEERING
J. G. ALVAREZ
LICENSED PROFESSIONAL ENGINEER
PROVINCIAL REGISTRATION NO. 00014923

 RN design <i>Imagina • Inspira • Crea</i> TEL: (905) 738-3177 FAX: (905) 738-5449		MODEL CLIENT		40-5 (GEORGE) ESQUIRE HOMES NORTHGLEN CLARINGTON, ONTARIO		No. ISSUED OR REVISION COMMENTS		DATE	DWN	CHK	SCALE		
						1.	UPDATED TO OBC 2017 ENACTMENT	AUG. 28, 2017	SB	NC	3/16" = 10"		
						2.	REVISED AS PER ENG. COMMENTS	SEPT. 27, 2017	HAZ	NC		PROJECT NUMBER 16062	
						3.	ISSUED FOR FINAL	OCT. 03, 2017	SB	NC			PAGE
													
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.						I, NELSON CHINWA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES/CATEGORIES.							
						QUALIFIED DESIGNER BCIN: 21032							
						FIRM BCIN: 26995							
						DATE: OCTOBER 03, 2017							
SIGNATURE:													



File: C:_RN_Standards\tempAcPublish_682816062-40-5-GEORGE-FINAL.dwg Plotted: Oct 03, 2017 By: Jennifer D.

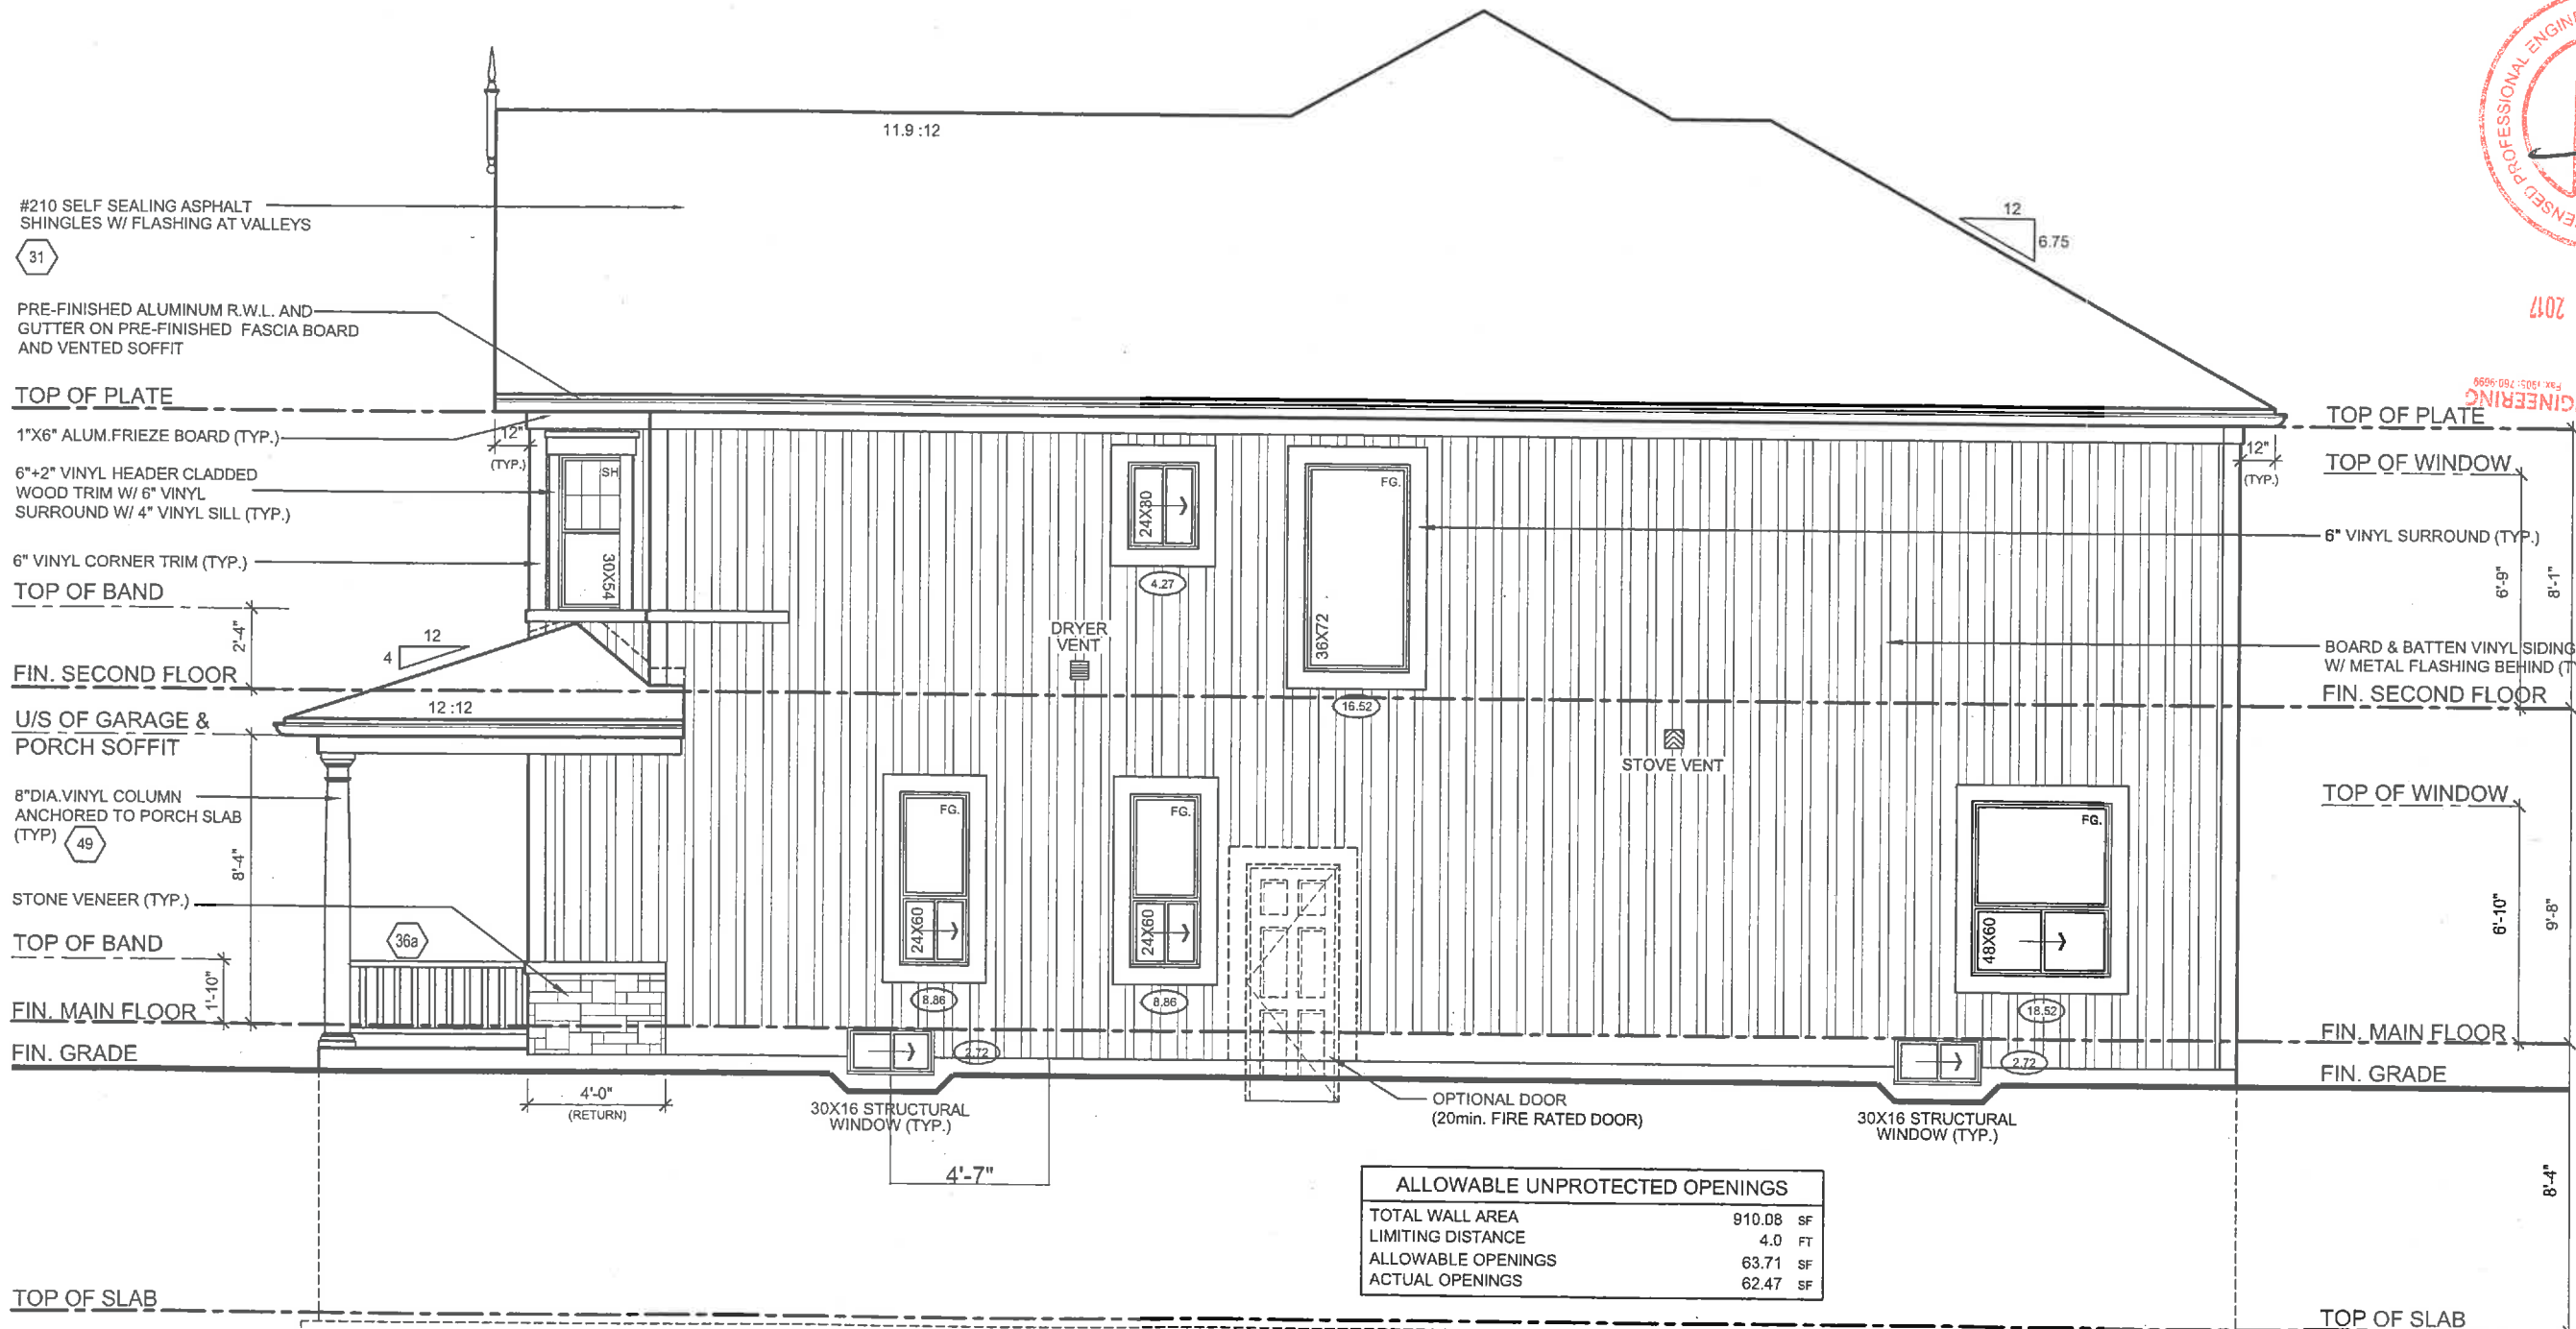


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

ARCHITECTURAL REVIEW APPROVAL
OCT 1 9 2017
John G. Williams, Licensed Architect

 rn design Imagine • Inspire • Create TEL: (905) 738-3177 FAX: (905) 738-5449	MODEL	40-5 (GEORGE)	
	CLIENT	ESQUIRE HOMES NORTHGLEN CLARINGTON, ONTARIO	
	ISSUED OR REVISION COMMENTS	1. UPDATED TO OBC 2017 ENACTMENT	2. REVISED AS PER ENG. COMMENTS
	1. 10/01/17	2. AUG. 28-2017	3. SEPT. 27-2017
SCALE		3/16" = 1'0"	PROJECT NUMBER
DWN		SB	HAZ
CHK		NC	NC
DATE		10/03/17	16062
SIGNATURE		A8	
QUALIFIED DESIGNER BCIN: 21032		FIRM BCIN: 26995	
DATE: OCTOBER 03, 2017			

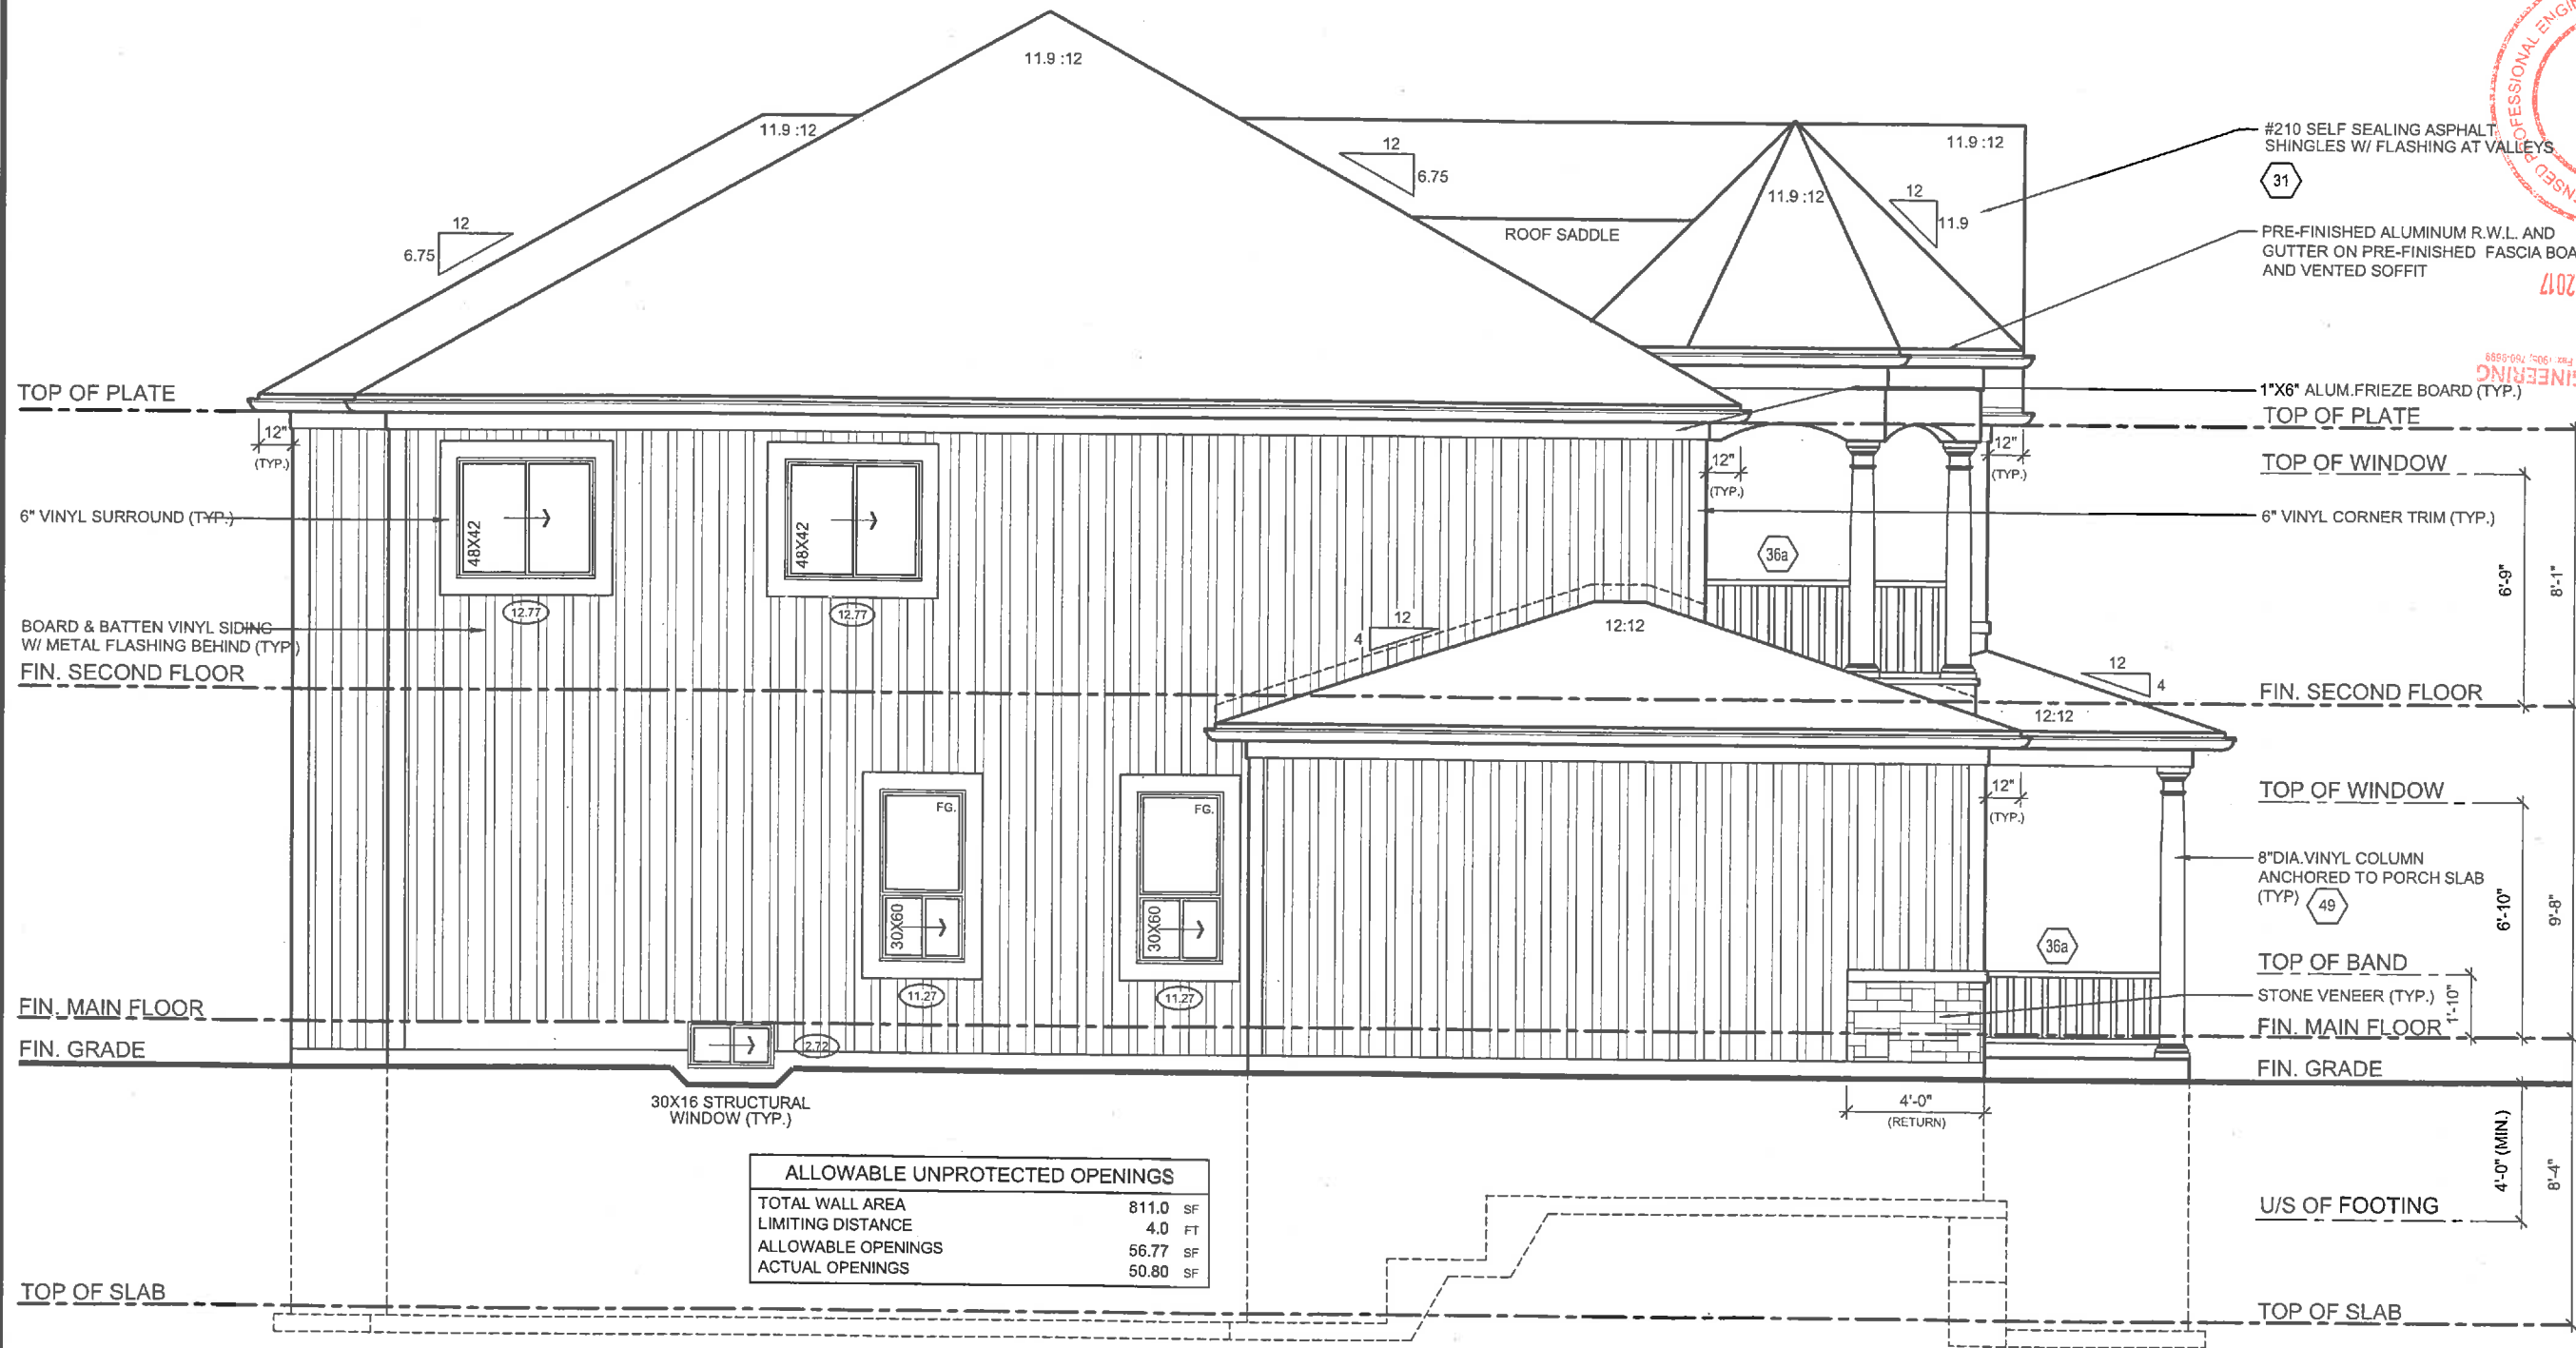

LEFT SIDE ELEVATION 'A'

It is the builder's complete responsibility to ensure that all plans submitted for approval comply with the Architectural Guidelines and Regulations and requirements including zoning provisions. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

ARCHITECTURAL REVIEW APPROVAL

OCT 1 1 2017

John G. Williams, Architect

MODEL	40-5 (GEORGE)		SCALE	3/16" = 1'0"	
	CLIENT	ESQUIRE HOMES NORTHGLEN CLARINGTON, ONTARIO	DVN	CHK	
			SB	NC	
			HAZ	NC	
PROJECT NUMBER		16062		PAGE	A10

No.	ISSUED OR REVISION COMMENTS	DATE
1.	UPDATED TO OBC 2017 ENACTMENT	AUG. 28-2017
2.	REVISED AS PER ENG. COMMENTS	SEPT. 27-2017
3.	ISSUED FOR FINAL	OCT. 03-2017

QUALIFIED DESIGNER BCIN:	21032	SIGNATURE:
FIRM BCIN:	26895	
DATE:	OCTOBER 03, 2017	



REFER TO TRUSS
DRAWINGS FOR
APPROVED TRUSS
LAYOUT.

PEAK HEIGHT OF ROOF

32'-1"

24

COMMITMENT

40-5 (GEORGE)

ESQUIRE HOMES
NORTHGLEN
CLARINGTON, ONTARIO

ART

SIGNATURE: _____


QUALIFIED DESIGNER BCIN:	21032
FIRM BCIN:	26995
DATE:	OCTOBER 03, 2017

I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES/CATEGORIES:

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.

File: C:_RN_Standards\temp\AcPublish_682816062-40-5-GEORGE-FINAL.dwg Plotted: Oct 03, 2017 By: JenniferD



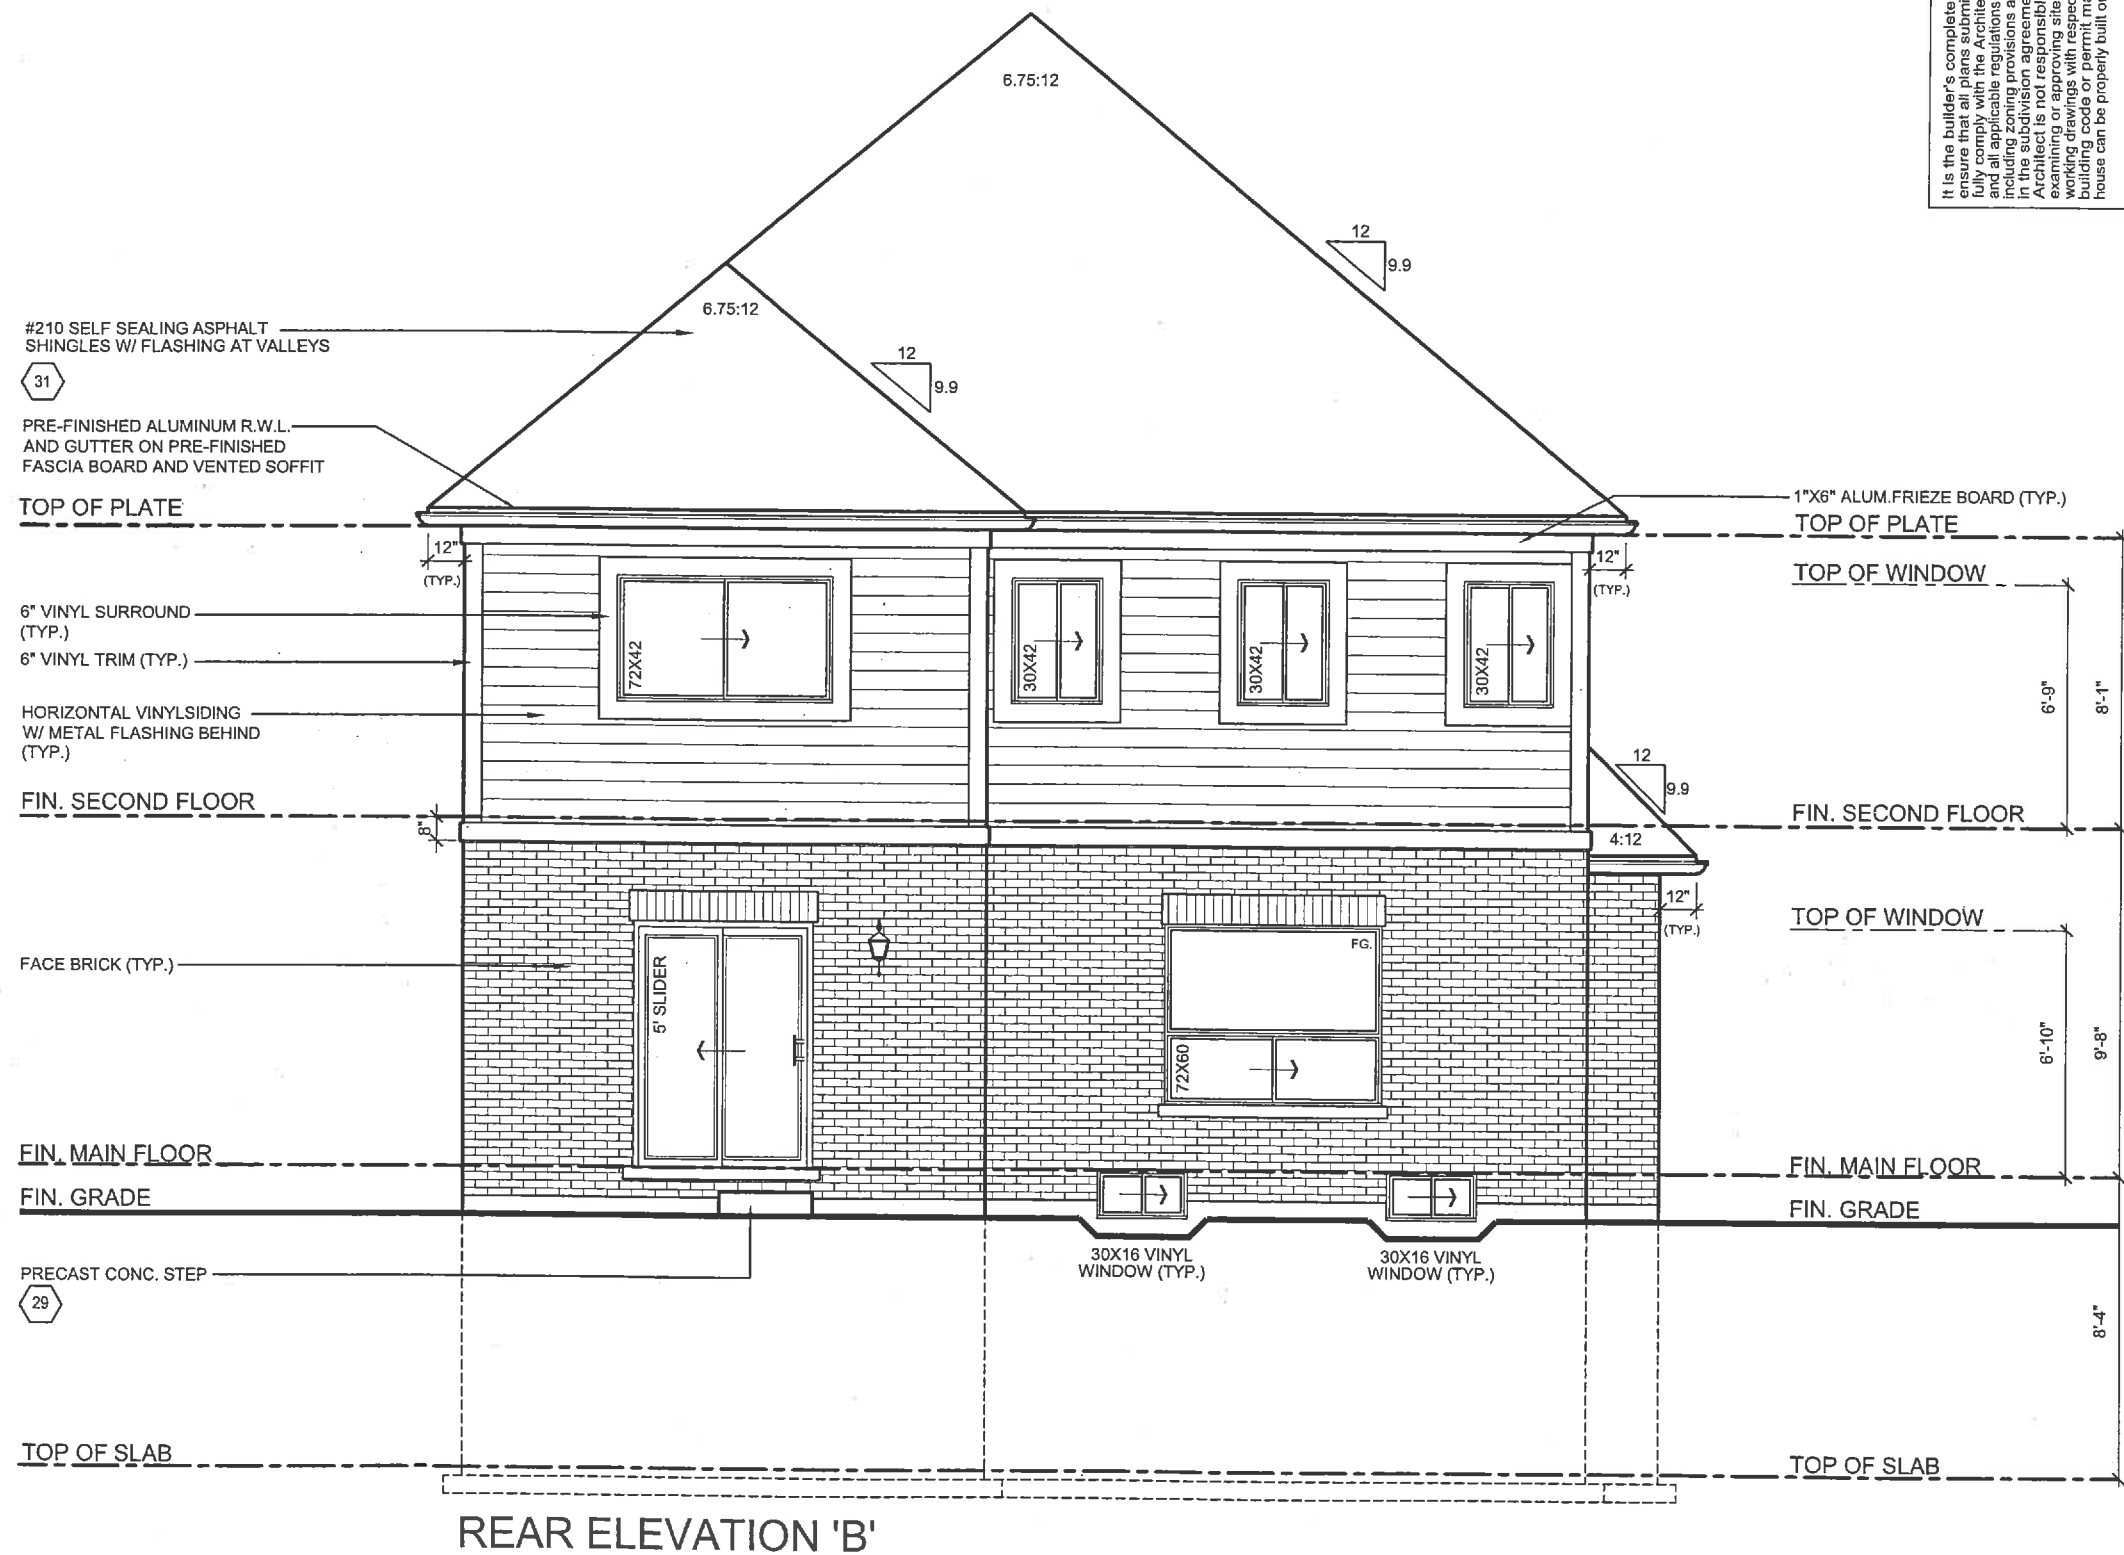

It is the builder's complete responsibility to ensure that the construction complies with the applicable regulations and all applicable provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

ARCHITECTURAL REVIEW & APPROVAL


OCT 10 2017

John G. Williams, Architect



 RN design <i>Imagine • Inspira • Create</i> TEL: (905) 738-3177 FAX: (905) 738-5449	MODEL
--	--

A13

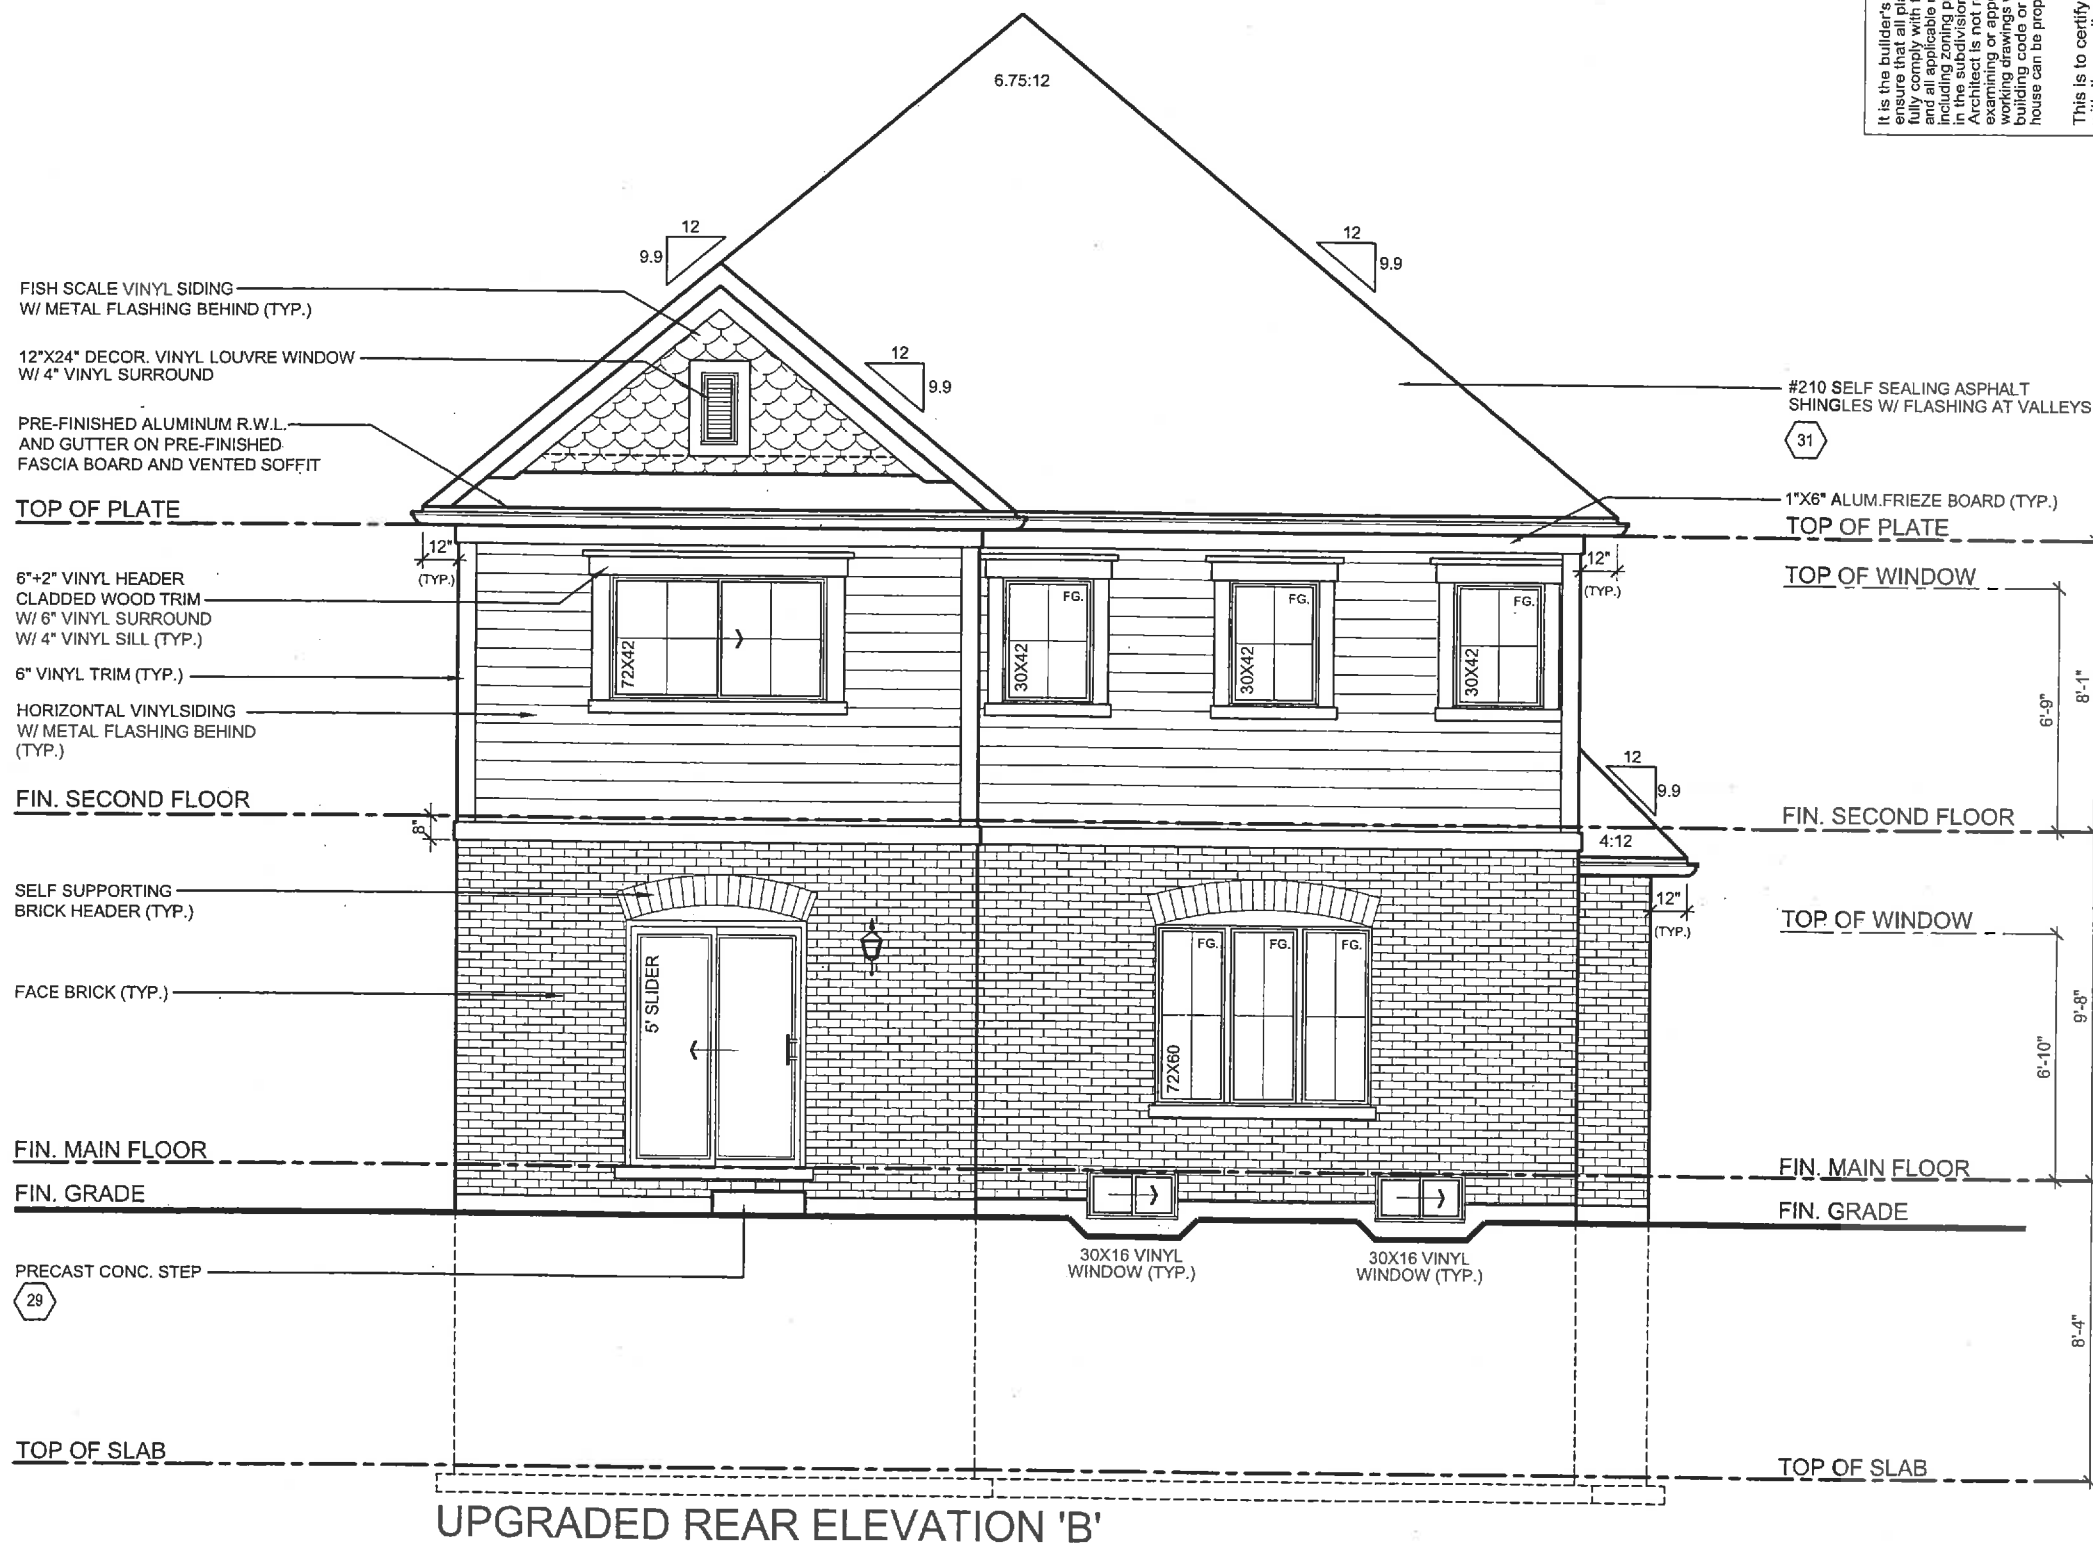

It is the builder's complete responsibility to ensure that all plans and specifications fully comply with the applicable Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.


ARCHITECTURAL REVIEW & APPROVAL

UCT 10 2017

Jana G. Williams, Architect



MODEL 40-5 (GEORGE) CLIENT ESQUIRE HOMES NORTHGLEN CLARINGTON, ONTARIO	ISSUED OR REVISION COMMENTS 1. UPDATED TO OBC 2017 ENACTMENT 2. REVISED AS PER ENG. COMMENTS 3. ISSUED FOR FINAL	DATE 10/03/2017 AUG. 28-2017 SEP. 27-2017 OCT. 03-2017	SCALE 3/16" = 1'0" PROJECT NUMBER 16062 PAGE 	
	QUALIFIED DESIGNER BCIN: 21032 FIRM BCIN: 26895 DATE: OCTOBER 03, 2017	SIGNATURE: 	A13a	
	THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO CONSTRUCTION. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD. I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSIFICATION CATEGORY.			

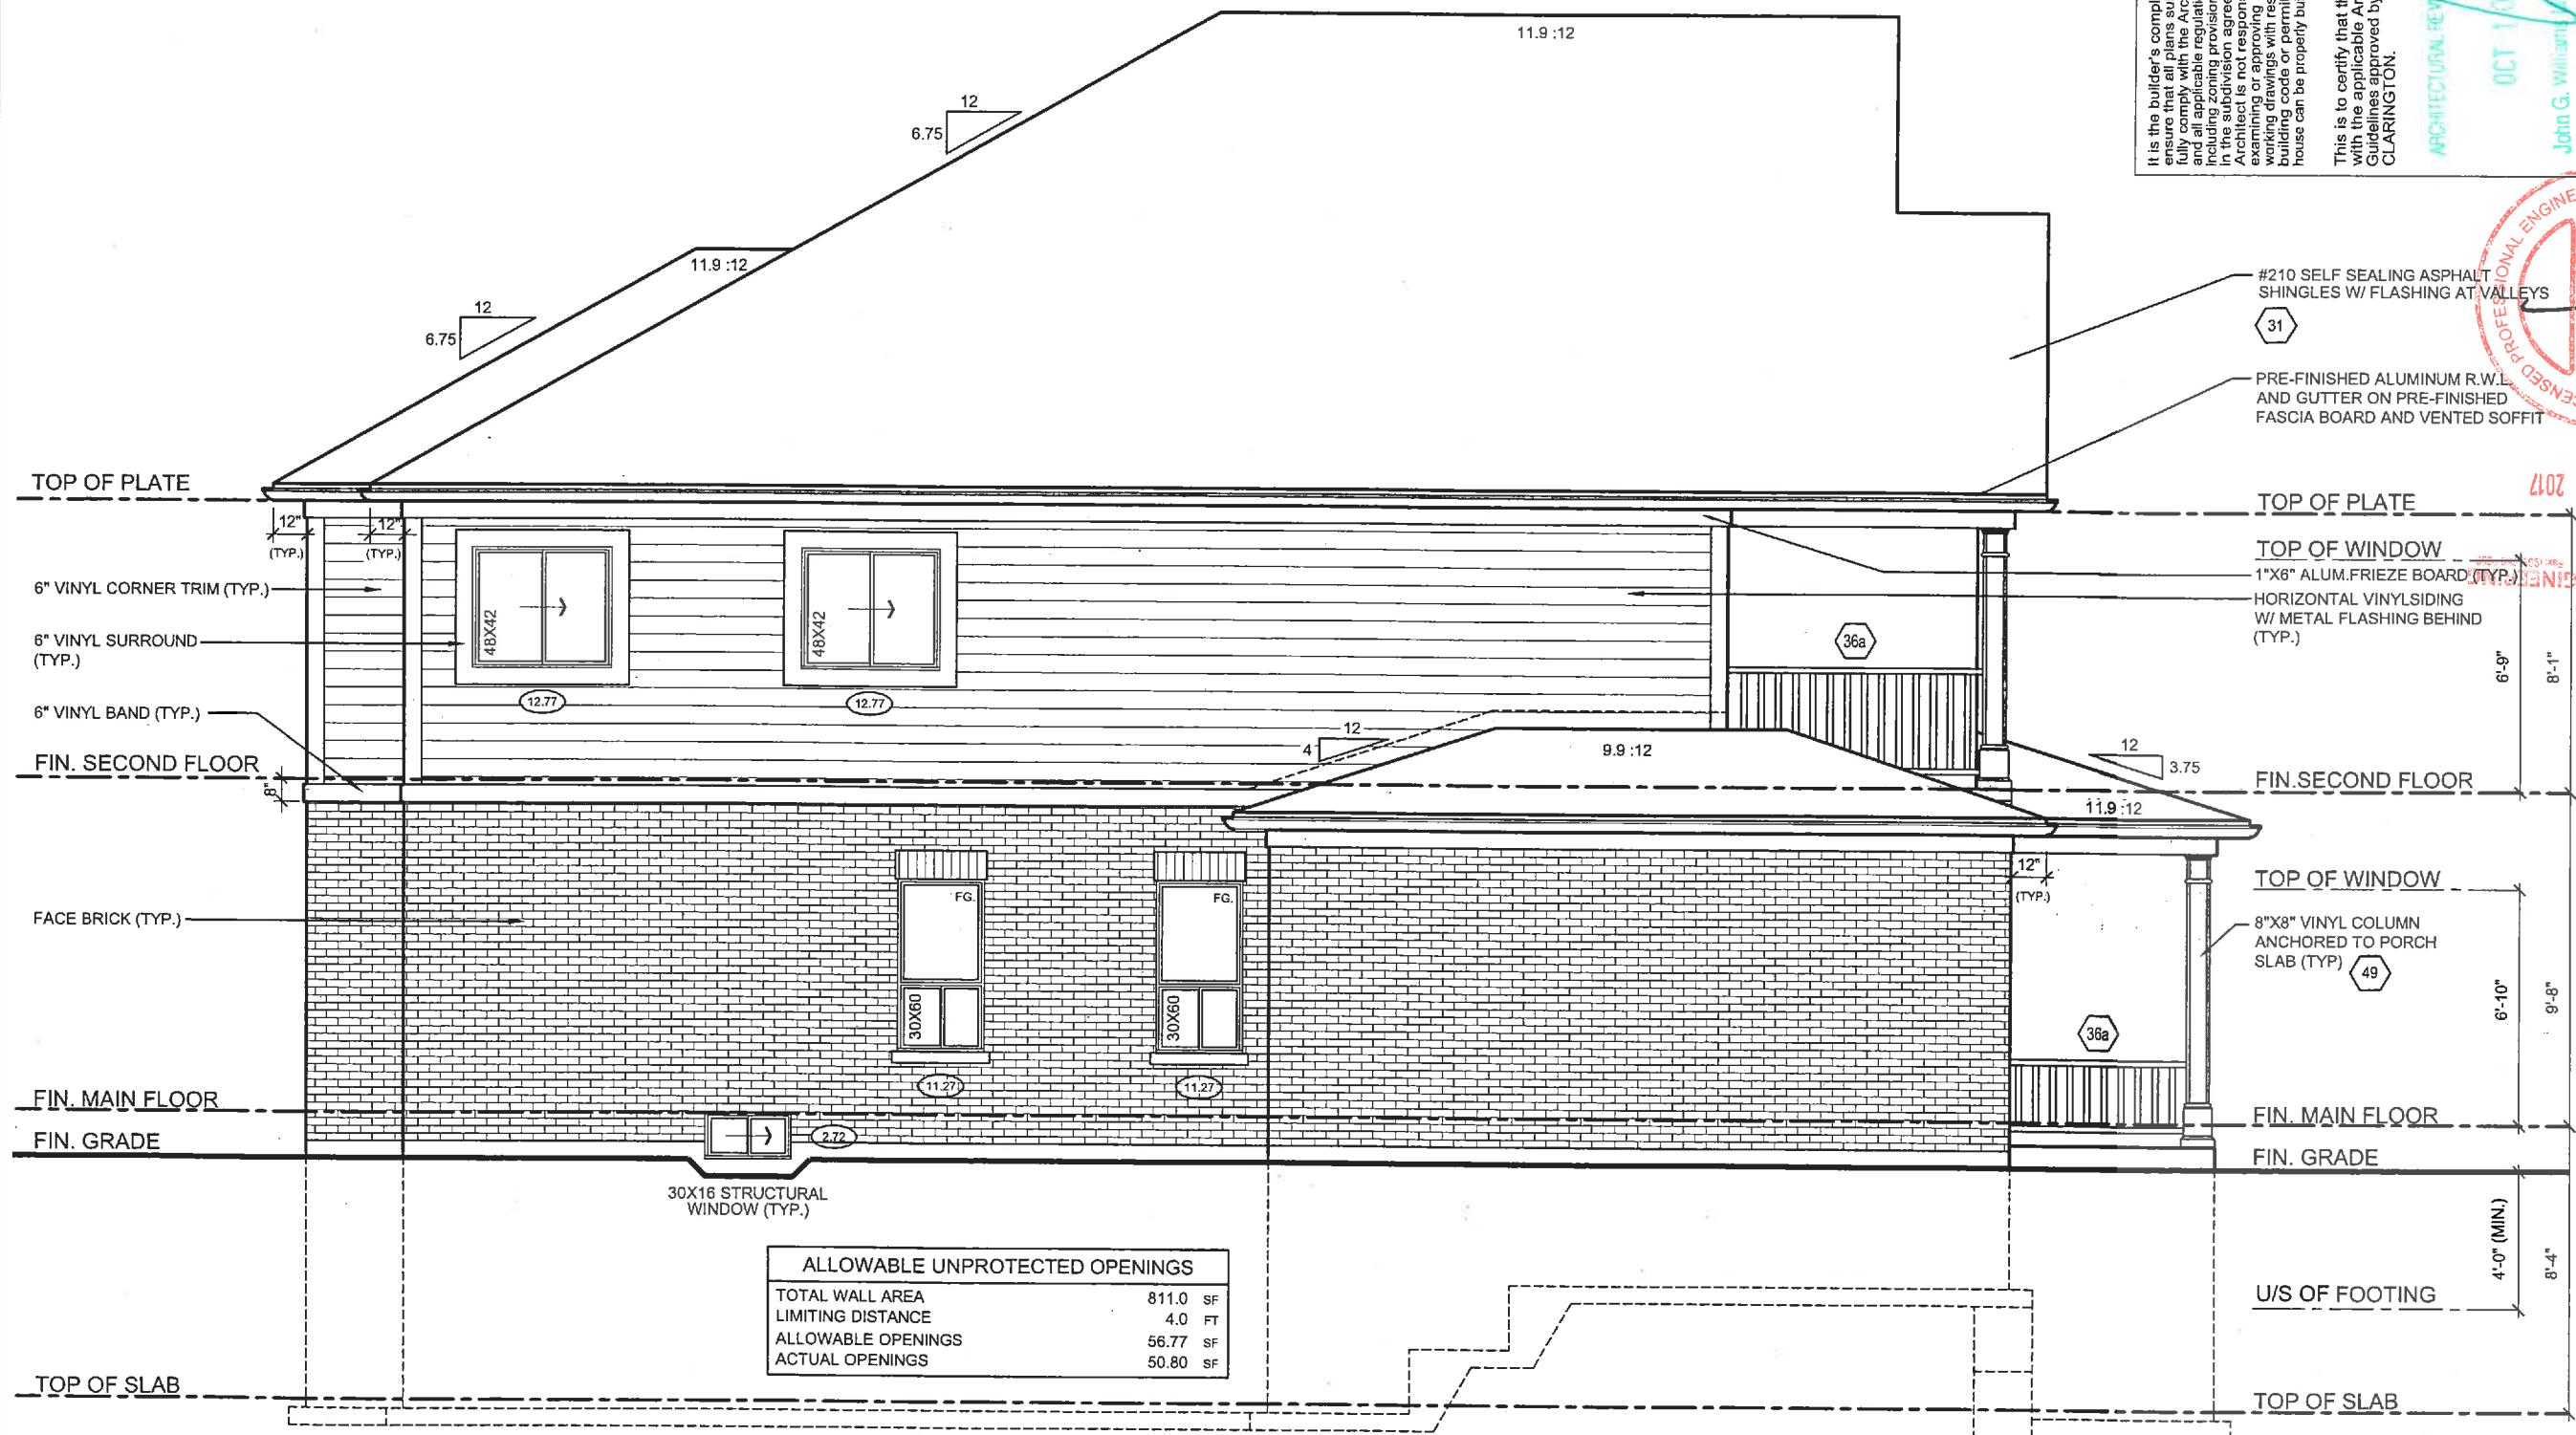

LEFT SIDE ELEVATION 'B'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for existing conditions (existing plans or working drawings) with respect to the building code or permit matter or that a house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARRINGTON.

ARCHITECTURAL REVIEW & APPROVAL
OCT 10 2017
John G. Williams, Architect

#210 SELF SEALING ASPHALT SHINGLES W/ FLASHING AT VALLEYS
31

PRE-FINISHED ALUMINUM R.W.L. AND GUTTER ON PRE-FINISHED FASCIA BOARD AND VENTED SOFFIT

TOP OF WINDOW
1"x6" ALUM. FRIEZE BOARD (TYP.)
HORIZONTAL VINYL SIDING W/ METAL FLASHING BEHIND (TYP.)

TOP OF WINDOW
8"x8" VINYL COLUMN ANCHORED TO PORCH SLAB (TYP.)
36a

ALLOWABLE UNPROTECTED OPENINGS	
TOTAL WALL AREA	811.0 SF
LIMITING DISTANCE	4.0 FT
ALLOWABLE OPENINGS	56.77 SF
ACTUAL OPENINGS	50.80 SF

 RN design Imagine • Inspire • Create TEL: (905) 736-3177 FAX: (905) 736-5449	MODEL 40-5 (GEORGE)	No.	ISSUED OR REVISION COMMENTS	CHK	DWN	SCALE 3/16" = 1'0"
	CLIENT ESQUIRE HOMES NORTHGLEN CLARRINGTON, ONTARIO	1.	UPDATED TO OBC 2017 ENACTMENT	NC	SB	PROJECT NUMBER 16062
		2.	REVISED AS PER ENG. COMMENTS	NC	HAZ	PAGE A14
		3.	ISSUED FOR FINAL	NC	SB	
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.		I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES/CATEGORIES.		SIGNATURE  J.G. ALVAREZ LICENSED PROFESSIONAL ENGINEER OCT 03 2017		
		QUALIFIED DESIGNER BCIN: 21032 FIRM BCIN: 26995 DATE: OCTOBER 03, 2017				


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

TECHNICAL REVIEW APPROVAL

10/11/2017

John G. Williams Architect, Architect

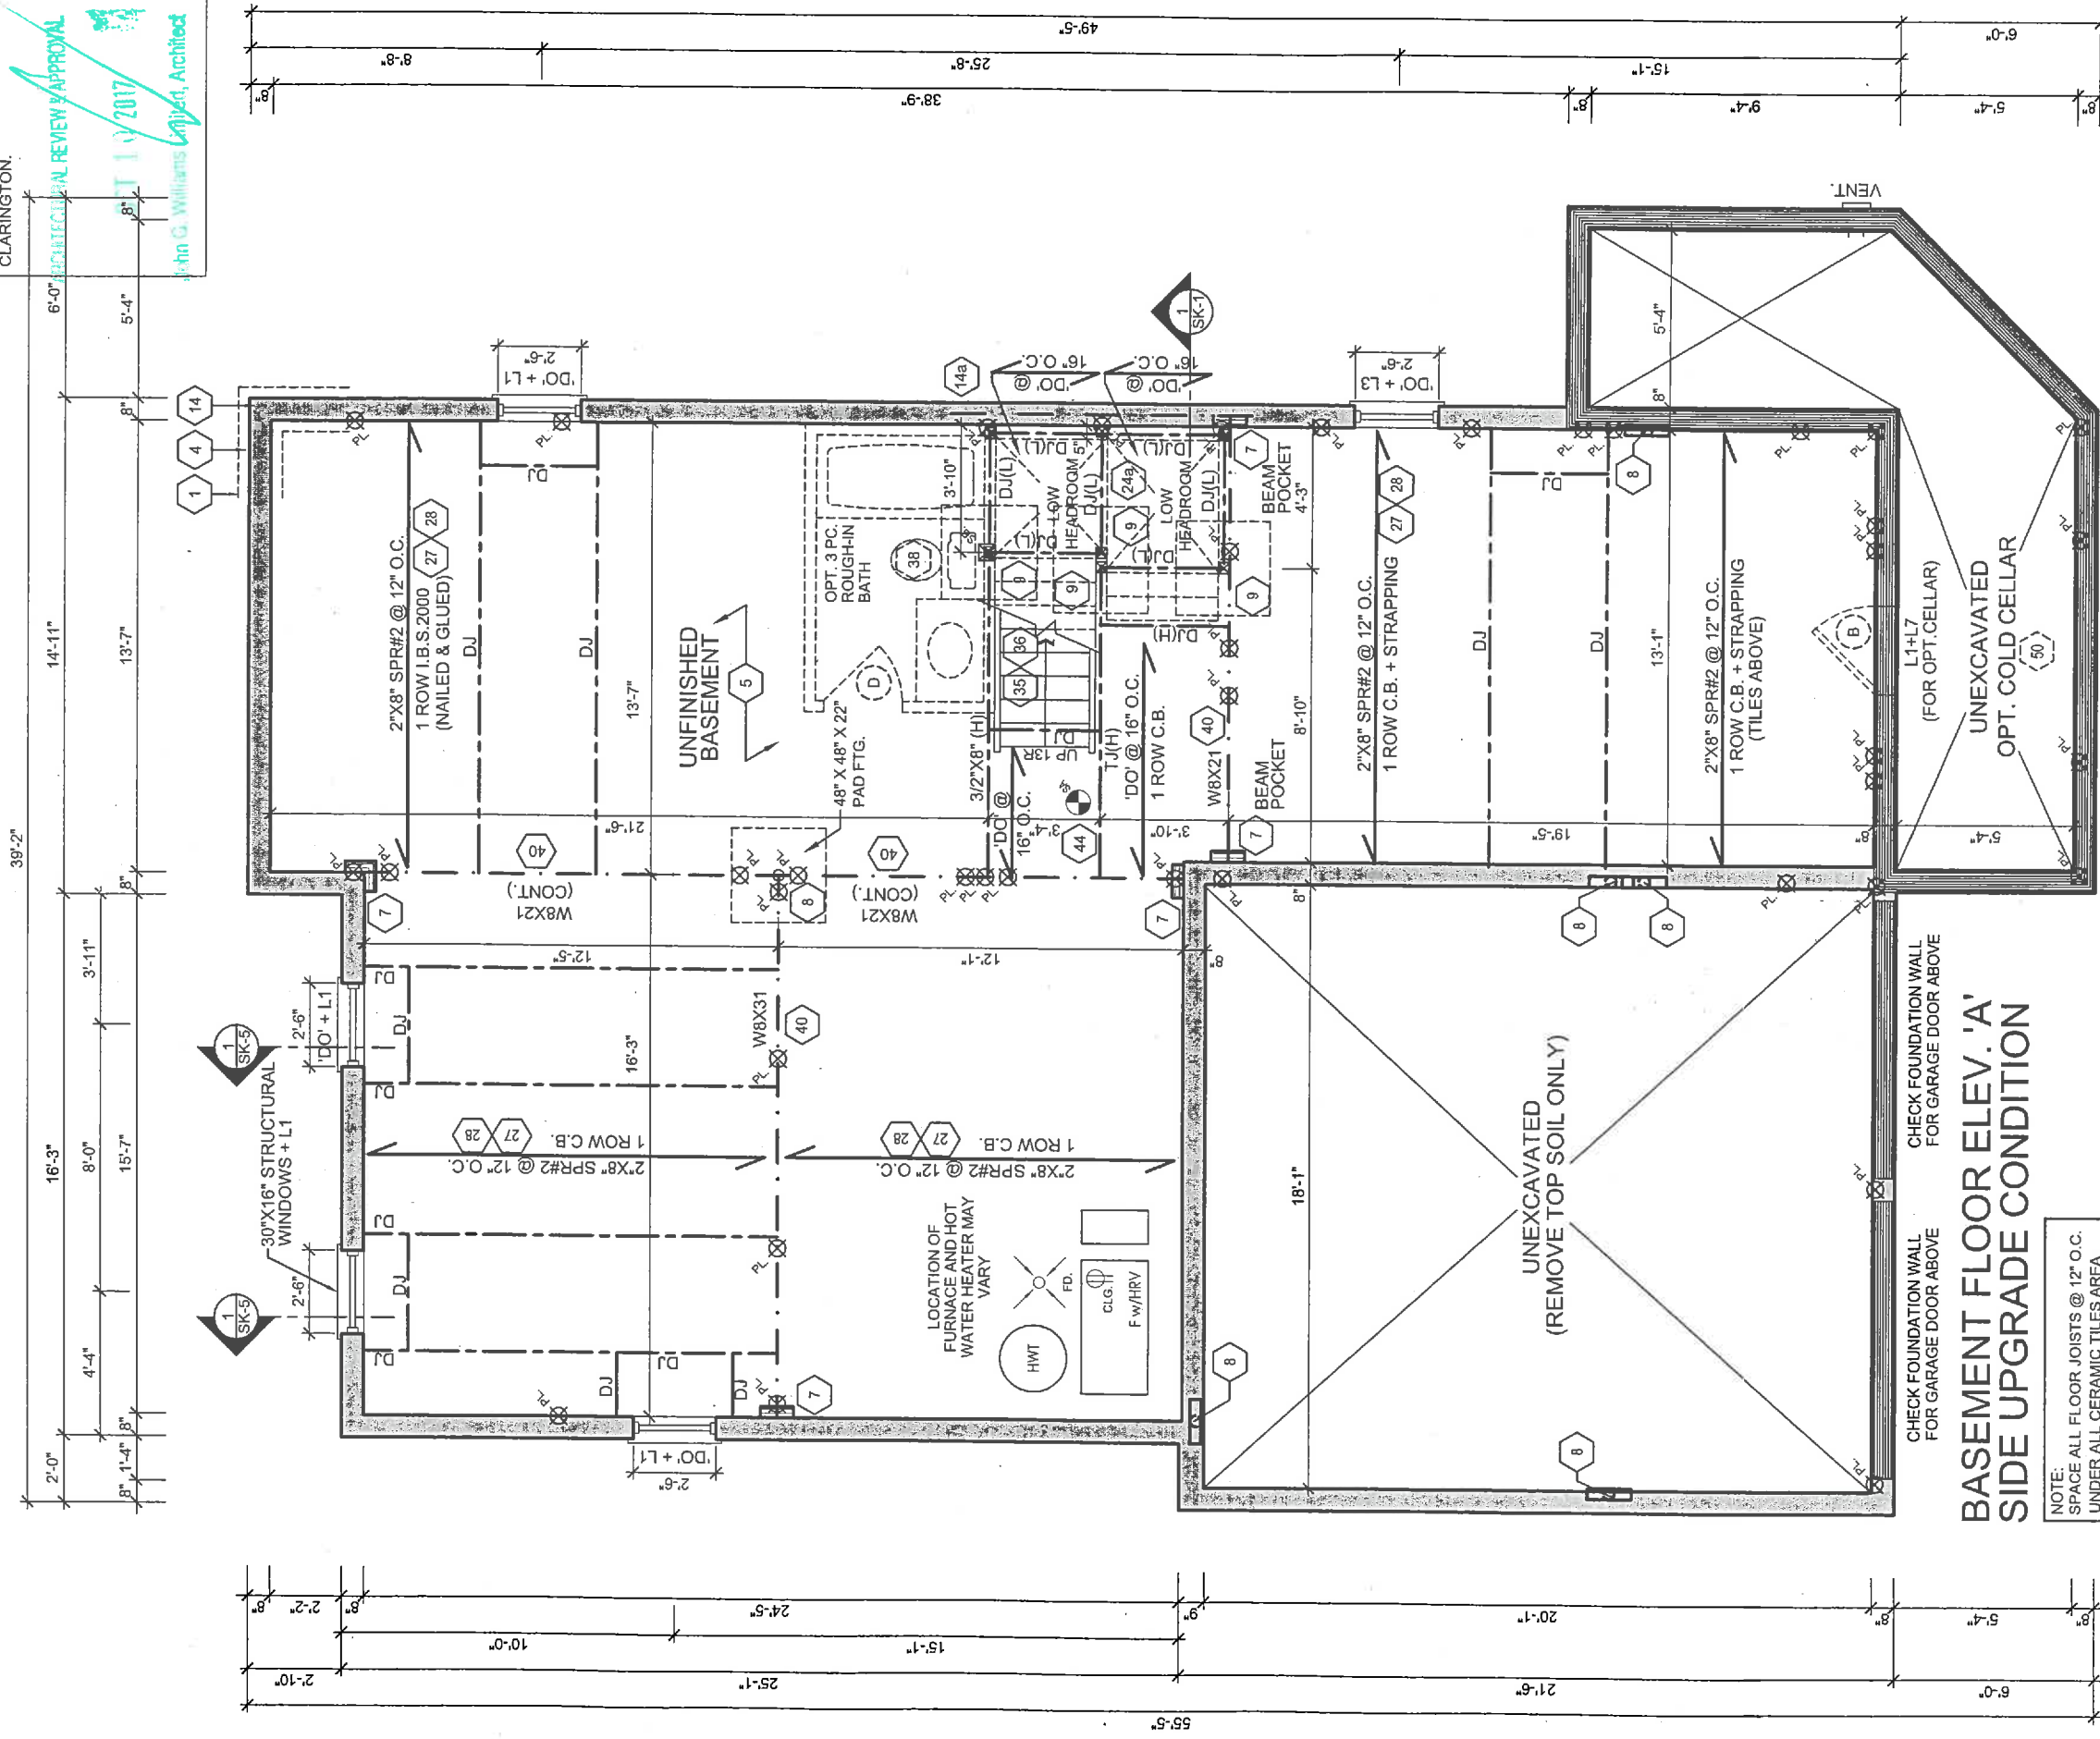

10/11/2017
J. G. ALVAREZ
LICENSED PROFESSIONAL ENGINEER

 RN design <i>Imagine • Inspire • Create</i> TEL: (905) 738-5449 FAX: (905) 738-5449	MODEL		40-5 (GEORGE)		DATE		SCALE		PROJECT NUMBER		PAGE		
	CLIENT		ESQUIRE HOMES NORTHGLEN CLARINGTON, ONTARIO		No.		ISSUED OR REVISION COMMENTS		DWN		CHK		
					1.		UPDATED TO ORC 2017 ENACTMENT		AUG. 28-2017		SB NC		
				2.		REVISED AS PER ENG. COMMENTS				HAZ		NC	
				3.		ISSUED FOR FINAL				SB		NC	



THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.

I, NELSON DUNHA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LIMITED. ALL DIMENSIONS AND THE FIRM IS REGISTERED IN THE APPROPRIATE CATEGORIES.



NOTE:
CONC. FRONT PORCH
POURED PRIOR TO BRICK


052017

TEL. (905) 738-5449
FAX. (905) 738-5449

**THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RND DESIGN LTD.**

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RND DESIGN LTD.

File:C:_RN_Standards\temp\AcPublish_6828\16062-40-5-GEORGE-FINAL.dwg Plotted: Oct 03 2017 By:JenniferD

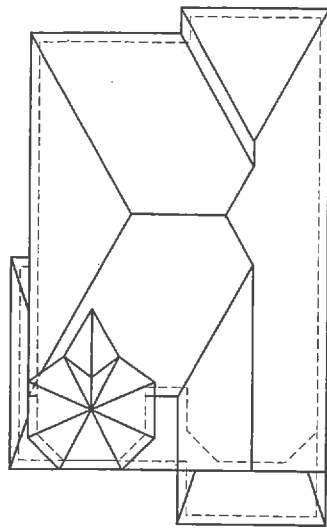

ROOF PLAN 'A'

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER, AT EACH CROSS POINT. POSTS LONGER THAN 6' TO BE Laterally Braced so that the distance between end points & between rows of bracing does not exceed 6'.

REFER TO TRUSS DRAWINGS FOR APPROVED TRUSS LAYOUT.



FRONT ELEVATION 'A'
UPGRADE CONDITION

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the applicable Guidelines and all applicable revisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

ARCHITECTURAL REVIEW & APPROVAL
OCT 10/2017
John G. Williams Limited Architect

PEAK HEIGHT OF ROOF 29'-10"

DECOR. GABLE DETAIL

MID-POINT OF ROOF 23'-10"

FISH SCALE VINYL SIDING
W/ METAL FLASHING BEHIND (TYP.)

1"x6" ALUM. FRIEZE BOARD (TYP.)

TOP OF PLATE

TOP OF WINDOW

6" VINYL CORNER TRIM (TYP.)

FIN. SECOND FLOOR

TOP OF TRANSOM

TOP OF WINDOW

8" DIA. VINYL COLUMN
ANCHORED TO PORCH SLAB
(TYP.)

EXTERIOR RAILING

FIN. MAIN FLOOR

FIN. GRADE

6" POURED CONC. FDN WALLS
ON 19"x6" CONC. STRIP FOOTING

POURED CONC. SILL

POURED CONC. PORCH SLAB

TOP OF SLAB

MODEL	40-5 (GEORGE)						
	CLIENT						
	ESQUIRE HOMES NORTHGLENN CLARINGTON, ONTARIO						
	PN design Imagine • Inspire • Create TEL: (905) 738-3177 FAX: (905) 738-5448						
No.	ISSUED OR REVISION COMMENTS	DATE	BY	CHK	SCALE	PROJECT NUMBER 16062	PAGE A18
	1. UPDATED TO OBC 2017 ENACTMENT	AUG. 28-2017	SB	NC	3/16" = 1'0"		
	2. REVISED AS PER ENG. COMMENTS	SEPT. 27-2017	HJZ	NC			
	3. ISSUED FOR FINAL	OCT. 03-2017	SB	NC			
QUALIFIED DESIGNER BCIN: 21032		FIRM BCIN: 26995		DATE: OCTOBER 03, 2017		SIGNATURE:	
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO PN DESIGN LTD.							

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON

Oct 16, 2017

John G. Williams Limited, Architect

ESCALE

SCALE
3/16" = 1'0"

PROJECT NUMBER
16062

PAGE

A19

PRE-FINISHED ALUMINUM R.W.L. AND——
GUTTER ON PRE-FINISHED FASCIA BOARD
AND VENTED SOFFIT

TOP OF PLATE

1"X6" ALUM.FRIEZE BOARD (TYP.)

6"+2" VINYL HEADER CLADDED
WOOD TRIM W/ 6" VINYL
SURROUND W/ 4" VINYL SILL (TYP.)

6" VINYL CORNER TRIM (TYP.)

4" VINYL BAND

TOP OF BAND

FIN. SECOND FLOOR

U/S OF GARAGE &
PORCH SOFFIT

8"DIA. VINYL COLUMN ———
ANCHORED TO PORCH SLAB
(TYP) 

DECORATIVE BRACKET

STONE VENEER (TYP.)

TOP OF BAND

FIN. MAIN FLOOR

FIN. GRADE

TOP OF SLAB

— DECOR.GABLE DETAIL

TOP OF PLATE

TOP OF WINDOW

— 6" VINYL SURROUND (TYP.)

BOARD & BATTEN VINYL
- SIDING W/ METAL
FLASHING BEHIND (TYP.)

TOP OF WINDOW

- 4" PRECAST CONC. BAND

TOP OF BAND

FIN MAIN FLOOR:

FIN. GRADE

TOP OF SLAB

UPGRADED RIGHT SIDE ELEVATION 'A'

40-5 (GEORGE)

ESQUIRE HOMES
NORTHGLEN
CLARINGTON, ONTARIO

I, NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF R/N DESIGN LIMITED UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSES/CATEGORIES.

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR
TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES
MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.

File: C:_RN_Standards\temp\AcPublish_68281606240-5-GEORGE-FINAL.dwg Plotted: Oct 03, 2017 By: JenniferD

17
REQ. FOR FIRE RATING: (LESS THAN 4'-0" LIMITING DISTANCE):
O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD R15 (RSI 2.64) ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
-REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

18
INTERIOR STUD WALLS:
O.B.C. 1.9.23.10.1.
-2" X 4" (38mmx 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
BEARING STUD WALL (BASEMENT):
O.B.C. 1.9.23.10.1.
-2" X 4" (38mmx 89mm) WOOD STUDS @ 16" (400mm) O.C. OR
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DBL. 2" X 4" OR 2" X 6" TOP PLATE.
-2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPROOFING MATERIAL.
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C.
-FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB

19
PARTY WALL - BLOCK:
O.B.C. SB-3 WALL = B4e (STC = 57, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK
-SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/ MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO PREVENT SMOKE PASSAGE
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES
-2" X 2" (38mmx 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH SIDES
-ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE CAVITY.
-7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER O.B.C. 9.10.9.2 (1) & TABLE 2.1.1. SB-2
-ACoustical SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)

20
PARTY WALL - BLOCK (AGAINST GARAGE):
O.B.C. SB-3 WALL = B5c (STC = 51, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS
-1/2" (12.7mm) GYPSUM BOARD
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-2" X 4" (38mmx 89mm) WOOD STRAPPING @ 16" (400mm) O.C.
-R20 (RSI 3.52) RIGID INSULATION
-7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)
-1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
REQ. INSULATION VALUES:
INSULATION VALUES PROVIDED BY CAN/CSA-F280-M90
-RIGID INSULATION = 20.00
-LOW DENSITY CONCRETE BLOCK = 1.70
-WOOD FRAME W/ GYPSUM = 2.72
-AIR FILM - MOVING = 0.68
-AIR FILM - STILL = 0.17
TOTAL R" VALUE = 25.27

21
FIREWALL:
O.B.C. 9.10.11.1. & 3.1.10. & SB-3 WALL = B4e (STC = 57, FIRE = 2 HR)
-ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING AREA. O.B.C. T.3.2.2.47.
-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS
-2" X 2" (38mmx 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES OF WALL
-SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
-7 1/2" (190mm) CONC. BLOCK, MIN. 2 HR FIRE-RESISTANT RATING
-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
-STAGGER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER O.B.C. 9.10.9.2 (1) & TABLE 2.1.1. SB-2
-ACoustical SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)
-PROTRUDE FAST FASCIA @ EAVES W/ BRICK CORBELING.
-EXTEND 5 7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/ THROUGH WALL FLASHING PER O.B.C. 3.1.10.4 (1)
-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER THAN 9'10" (3m), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER O.B.C. 3.1.10.4 (2)

22
PARTY WALL - FOUNDATION:
O.B.C. 9.15.4.2.
-7 7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2
PARTY WALL - WOOD STUD:
O.B.C. SB-3 WALL = W13a (STC = 57, FIRE = 1 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK
-2 ROWS 2"x4" (38mmx 89mm) STUDS @ 16" (400mm) O.C. W/ SEPARATE 3" X 4" (38mmx 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4" (38mmx 89mm) TOP PLATES
-SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE CAVITY.
-5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED & FILLED.
-ACoustical SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)
NOTE - SUPPORT FOR 2-3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
FOR 2 FLOORS SUPPORTED ABOVE 2" X 4" (38mmx 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE 2" X 6" (38mmx 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-IF 2"x6" STUDS ARE USED AT STAIR OPENING CONTINUE TO USE ON REMAINING FLOORS AT THE STAIR OPENING AT 16" O.C.

23
GARAGE WALL & CEILING:
O.B.C. 9.10.9.16.(3)
-1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING BETWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (RSI 3.87) INSULATION IN WALLS
-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4. FOR FLOOR ABOVE.
-INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN. 1/2" (12.7mm) GYPSUM BOARD
-ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH 4 - 3 1/4" (82mm) TOE NAILS
-BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7 7/8" (200mm) O.C.
WALLS ADJACENT TO ATTIC SPACE:
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C.
-R22 (RSI 3.87) INSULATION
-1/2" (12.7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING ON ATTIC SIDE
-ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1.

24
DOUBLE VOLUME WALLS:
O.B.C. 9.23.10.1.
-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING
-REFER TO PLAN FOR STUD SPECIFICATION
STUDS FASTENED AT TOP & BOTTOM WITH 3/3-1/4" (82mm) TOE NAILS
-DOUBLE TOP PLATES FASTENED TOGETHER WITH 3" (76mm) AT 7 7/8" (200mm) O.C.
-SOLID BRIDGING AT 3'-11" (1200mm) O.C.
-MIN. R22 (RSI 3.87) INSULATION (ZONE 1 OBC SB-12.1.3.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C. 9.25.3. & 9.25.9.

25
CLIENT SPECIFIC REVISIONS

24
EXPPOSED FLOOR:
-FLOOR AS PER NOTE # 28
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-R31 (RSI 5.46) INSULATION
-VENTED ALUMINUM SOFFIT

24
SUNKEN FINISHED AREAS:
-USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS.
-WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION WALLS INSTEAD OF USING BEARING POSTS.
-FLOOR STRUCTURE AS PER NOTE # 28.

25
DOUBLE MASONRY WYTHE WALL:
O.B.C. 9.20.8.2.
-3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER
-WYTHES TO BE TIED W/ METALS INSTALLED AS PER O.B.C. 9.20.9.4.
-SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS
-6 SILL W/ 2" BEARING ON EACH SIDE & ANCHOR BOLTS @ 4'-0" O.C.
NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY AREA.

25
CORBEL MASONRY VENEER:
-MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1)

26
FLOOR ASSEMBLIES:
SILL PLATE:
O.B.C. 9.23.7.
-2" X 4" (38mm x 89mm) PLATE
-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FASTENED TO PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4" (100mm) INTO FOUNDATION WALL.
-SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1" (25mm) THICK BEFORE COMpressING, OR FOAM GASKET, OR PLACED ON FULL BED OF MORTAR.

27
BRIDGING & STRAPPING:
O.B.C. 9.23.9.4.
a) STRAPPING
-1" X 3" (19mm x 64mm) NAILED TO U/S OF JOISTS @ MAX. 6'-11" (2100mm) O.C.
-FASTENED TO SILL OR HEADER @ ENDS
b) BRIDGING
-1" X 3" (19mm x 64mm) OR 2" X 2" (38mmx 38mm) CROSS BRIDGING @ MAX. 6'-11" (2100mm) O.C.
-c) & d) USED TOGETHER OR
-1/2" (38mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH STRAPPING (d)
g) FURRING OR PANEL TYPE CEILING
-STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING FINISH IS ATTACHED DIRECTLY TO JOISTS.

28
FLOOR ASSEMBLY:
O.B.C. 9.23.14.3. 9.23.14.4.
-5/8" (15.9mm) WATERBOARD (R-1 GRADE) OR EQUIVALENT
-FLOOR JOISTS AS PER FLOOR PLANS

29
PORCH SLAB:
O.B.C. 9.39.1.4.
-4 7/8" (125mm) 4650 psi (32 MPa) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT
-REINFORCE WITH 10M BARS @ 7 7/8" (200mm) EACH WAY
-1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB
-3" (75mm) END BEARING ON FOUNDATION WALL
-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.
-IF A COLD CELLAR IS LOCATED BELOW THE SLAB, SUPPORT ON FOUNDATION WALLS NOT TO EXCEED 8'-2"

30
EXTERIOR BALCONY ASSEMBLY:
-1 1/4" X 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING
-2"x4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8" (15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"x4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"x8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)
-EXTERIOR GUARD AS PER #36g
-SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER
REQUIRED FOR OVER HEATED SPACES:
-ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS [OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF CEILING AREA]
-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING [O.B.C. 1.9.29.5.3.]

30
EXTERIOR FLAT ROOF ASSEMBLY:
-SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT
-INSTALLED PER MANUFACTURER'S SPECIFICATIONS.
-1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPERED PURLINS SLOPED MIN. 2% TO ROOF SCUPPER.
-3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON
-2"x8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)
REQUIRED FOR OVER HEATED SPACES:
-ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS [OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF CEILING AREA]
-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING [O.B.C. 1.9.29.5.3.]

31
ROOF ASSEMBLIES
TYPICAL ROOF:
O.B.C. 9.26.
-NO. 210 (30. 5KG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAID BENEATH STARTER STRIP
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS
-APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURER'S LAYOUT)
-TRUSS BRACING AS PER TRUSS MANUFACTURER
-EAVESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR ALUMINUM)
-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT.

32
CEILING:
-R60 (RSI 10.56) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING [O.B.C. 1.9.29.5.3.]

32
VAULTED OR CATHEDRAL CEILING:
O.B.C. 9.26. & TABLE A4
-NO. 210 (30. 5KG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAID BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS.

32
CONVENTIONAL FRAMING:
O.B.C. TABLE A6 OR A7
-2" X 6" (38mm x 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9" (3890mm)
-2"x4" (38mm x 89mm) COLLAR TIES AT MIDSPANS
-CEILING JOISTS TO BE 2" X 6" (38mmx 140mm) @ 16" (400mm) O.C. UNLESS OTHERWISE NOTED.
-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON RAFTERS & MIN. 1 1/2" (38mm) THICK.
O.B.C. 9.25.3. & 9.25.4.
-1/2" (12.7mm) GYPSUM BOARD

32
ATTIC ACCESS HATCH:
OBC 9.19.2.1. & SB-12.3.1.1.8.(1)
-19 3/4" X 27 1/2" (500mm X 700mm) ATTIC HATCH WITH WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION.

32
GENERAL:
PRIVATE STAIRS:
O.B.C. 9.8.4.
-MAX. RISE = 7-7/8" (200mm)
-MIN. RUN = 8-1/4" (210mm)
-MAX. TREAD = 9-1/4" (235mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-5" (1950mm)
-MIN. WIDTH = 2'-10" (600mm)
-MIN. WIDTH (BETWEEN WALL FACES) = 2'-11" (900mm)
[EXIT STAIRS, BETWEEN GUARDS]
ANGLED TREADS:
-MIN. RUN = 5 7/8" (150mm)
-MIN. AVG. RUN = 7 7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD & MAX. 7 7/8" (200mm) RISE
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN DWELLING UNITS
-HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOORWAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION

32
HEIGHT:
O.B.C. 9.8.7.4
-2'-10" (605mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
PROJECTIONS:
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

32
PUBLIC STAIRS:
O.B.C. 9.8.4.
-MAX. RISE = 7-3/32" (180mm)
-MIN. RUN = 11" (280mm)
-MIN. TREAD = 11" (280mm)
-MAX. NOSING = 1" (25mm)
-MIN. HEADROOM = 6'-9" (2050mm)
-MIN. WIDTH = 2'-11" (900mm)
[EXIT STAIRS, BETWEEN GUARDS]
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE
HANDRAILS:
O.B.C. 9.8.7
-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)
-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)
-HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT WHERE INTERRUPTED BY DOORWAYS OR NEWEL POSTS AT CHANGES IN DIRECTION

32
HEIGHT:
O.B.C. 9.8.7.4
-2'-10" (605mm) MIN. TO 3'-2" (965mm) MAX.
-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS
-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING
PROJECTIONS:
O.B.C. 9.8.7.6
-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

32
TERMINATION:
O.B.C. 9.8.7.3
-ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4" (300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR
FINISH:
O.B.C. 9.8.9.6
-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE FROM DEFECTS PER OBC 9.8.9.6.1(4)
-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE VISUAL PATTERN TO DEMARKATE THE LEADING EDGE OF THE TREADS, LANDING AND THE BEGINNING AND END OF A RAMP.

32
INTERIOR GUARDS:
O.B.C. SB-7 & 9.8.8.3.
-GUARDS TO BE 3'-6" (1070mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

32
EXTERIOR GUARDS:
O.B.C. SB-7 & 9.8.8.3.
-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN 23 5/8" (600mm).
-GUARDS TO BE 3'-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING SURFACE IS MORE THAN 5'-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-PROVIDE MID-SPAN POSTS AS PER SB-7.
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

32
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

32
DATE: 28-03-2017
AUG. 28-2017
SEPT. 27-2017
OCT. 03-2017

32
SCALE: N/A
PROJECT NUMBER: 16062
PAGE



RN design
Imagine • Inspire • Create
TEL: (905) 738-5449
FAX: (905) 738-5449

CLIENT SPECIFIC REVISIONS

♦ CLIENT SPECIFIC REVISIONS

MODEL

40-5 (GEORGE)

CLIENT

ESQUIRE HOMES
NORTHGLEN
CLARINGTON, ONTARIO

No. | ISSUED OR REVISION COMMENTS

1. | UPDATED TO OBC 2017 ENACTMENT

2. | REVISED AS PER ENG. COMMENTS

3. | ISSUED FOR FINAL

QUALIFIED DESIGNER BCIN: 21032

DATE: OCTOBER 03, 2017

DATE: 28-03-2017

DATE: 28-03-2017

DATE: 28-03-2017

DATE: 28-03-2017

SCALE: N/A

PROJECT NUMBER: 16062

PAGE

SIGNATURE:

FILE: C:_RN_Standards\temp\AcPublish_682816062-40-5-GEORGE-FINAL.dwg Plotted: Oct 03, 2017 By: JenniferD

36b EXTERIOR GUARDS @ JULIET BALCONY:

- FOR RAILING SPANNING MAXIMUM OF 6'-0".
- PROVIDE PREIN. METAL RAILING W/ 76mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.8.8.5.
- GUARDS TO BE 3'-6" (1070mm)
- FOR DWELLING UNITS GUARDS TO BE 2'-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C. 9.8.8.2. OR
- FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C. 9.8.8.2.
- VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN. EMBEDMENT TO STUDS.
- PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.
- 37 -INLIN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP
- 38 -WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR. O.B.C.- 9.32.1.3.[3]
- 39 -CAPPED DRYER VENT
- 40 -1"x2" (19mmX38mm) BOTH SIDES OF STEEL.
- 41 -WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE.
- 42 -PRECAST CONC. STEP
- 2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND
- 44 SMOKE ALARM. O.B.C.- 9.10.19.
- PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
- PROVIDE 1 IN EACH BEDROOM
- PROVIDE 1 IN EACH HALLWAY SERVICING BEDROOMS
- INSTALLED AT OR NEAR CEILING
- ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A VISUAL SIGNALLING COMPONENT
- ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.
- CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.
- 46 -MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY
- PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT.
- R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED
- 47 -GARAGE MAIN DOORS TO BE GAS PROOFED WITH SELF CLOSING WEATHERSTRIPPING. THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.
- R4 (RSI 0.70)
- 48 -TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT;
- 1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY OR
- 2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (7.0m) ABOVE ADJACENT GROUND LEVEL.

49

EXTERIOR COLUMN W/ MASONRY PIER:

- MIN. 6"x6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.
- TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.
- 14" X 14" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP.
- REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
- SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4.
- 3/4" AIR SPACE AROUND POST.
- OR
- MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
- 14" X 14" MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.
- NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.
- EXTERIOR COLUMN:
- MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE
- PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.

50

COLD CELLARS:

- FOR COLD CELLARS PROVIDE THE FOLLOWING:
- VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.
- COVER VENT W/ BUG SCREEN
- WALL MOUNTED LIGHT FIXTURE
- 1-1/2" FOR DOOR OPENING
- 2'-3" X 6'-8" EXTERIOR TYPE DOOR (MIN R-4 RSI 0.7)
- INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)

51

STUD WALL REINFORCEMENT:

- O.B.C. 9.5.2.3.
- WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8. (3)[d]&[c] & 3.8.3.13.(2)[f] & 3.8.3.13.14)[c]
- GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.[2]
- FRAME CONSTRUCTION:
- ALL FRAMING LUMBER TO BE No.1 AND No. 2 SPF UNLESS NOTED OTHERWISE.
- ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN LOADS.
- JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING
- BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING
- DOUBLE STUDS @ OPENINGS
- DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mm)
- DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm)
- PARALLEL PARTITIONS
- BEAMS TO BE PLACED UNDER LOAD BLOCKING UNDER NON-LOAD BEARING PARALLEL TO FLOOR JOISTS

◆ CLIENT SPECIFIC REVISIONS

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

SCHEDULES

DOORS 48/47	WOOD BEAMS	
A 865x2030x45 (2'10"x6'8"x1-3/4")	WD1 3/2" X 8" SPR	WD7 3/2" X 12" SPR
B 815x2030x35 (2'8"x6'8"x1-3/8")	WD2 4/2" X 8" SPR	WD8 4/2" X 12" SPR
C 760x2030x35 (2'6"x6'8"x1-3/8")	WD3 5/2" X 8" SPR	WD9 5/2" X 12" SPR
D 710x2030x35 (2'4"x6'8"x1-3/8")		
E 460x2030x35 (1'6"x6'8"x1-3/8")	L1 2/2" X 8" SPR	L10 4-7/8" X 3-1/2" X 5/16" L
F 610x2030x35 (2'0"x6'8"x1-3/8")	L3 2/2" X 10" SPR	L11 4-7/8" X 3-1/2" X 3/8" L
G OVER SIZED EXTERIOR DOOR	L5 2/2" X 12" SPR	L12 4-7/8" X 3-1/2" X 1/2" L
-REFER TO ELEVATIONS FOR SIZE	L7 3-1/2" X 3-1/2" X 1/4" L	L13 5-7/8" X 3-1/2" X 3/8" L
	L9 4" X 3-1/2" X 1/4" L	L14 5-7/8" X 3-1/2" X 1/2" L
	STEEL BEAMS	
ST1 W 6 X 15	ST3 W 8 X 18	ST5 W 8 X 24
ST2 W 6 X 20	ST4 W 8 X 21	

PLAN/ELEVATION LEGEND

44 SMOKE ALARM	45 CARBON MONOXIDE DETECTOR	FLOOR DRAIN
WATERPROOF DUPLEX OUTLET	D.J. DOUBLE JOIST	SOLID BEARING
VENTS AND INTAKES	P.T. PRESSURE TREATED LUMBER	(TO BE SAME WIDTH AS SUPPORTED MEMBER)
HOSE BIB	G.T. GIRDER TRUSS	POINT LOAD
EXHAUST FAN	A.F.F. ABOVE FINISHED FLOOR	FLAT ARCH
COLD CELLAR VENT 50	EXT. LIGHT FIXTURE (WALL MOUNTED)	2 STORY WALL
STOVE VENT	HYDRO METER	U/S UNDER SIDE
FIRE PLACE VENT	GAS METER	FG FIXED GLAZING
DRYER VENT		GB GLASS BLOCK
		BG BLACK GLASS

FLOOR AREA CALCULATIONS

ELEVATION	A	B			
FIRST FLOOR	1147	1126			
SECOND FLOOR	1343	1341			
TOTAL (ft²)	2490	2467			
DEDUCT O.T.B.	0	0			
TOTAL (ft²)	2490	2467			
FIN. BASEMENT	0	0			
TOTAL (ft²)	2490	2467			
LOFT PLAN	N/A	N/A			
TOTAL (ft²)	2490	2467			
(m²)	231.3	229.2			
COVERAGE (ft²)	1536	1523			
W/O PORCH (m²)	142.7	141.5			
COVERAGE (ft²)	1608	1623			
W/ PORCH (m²)	149.4	150.8			



Imagine • Inspira • Create
RN design
TEL.(905)738-3177
FAX.(905)738-5449

MODEL 40-5 (GEORGE)

CLIENT ESQUIRE HOMES NORTHGLEN CLARINGTON, ONTARIO

No. ISSUED OR REVISION COMMENTS

No.	ISSUED OR REVISION COMMENTS	DATE	CHK	SCALE
1.	UPDATED TO OBC 2017 ENACTMENT	AUG-28-2017	SB	N/A
2.	REVISED AS PER ENG. COMMENTS	SEPT-27-2017	HAZ	PROJECT NUMBER 16062
3.	ISSUED FOR FINAL	OCT-03-2017	SB	PAGE

◆ CLIENT SPECIFIC REVISIONS

NELSON CUNHA DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF THE FIRM. I AM QUALIFIED, AND THE FIRM IS REGISTERED, IN THE APPROPRIATE CLASSIFICATION CATEGORIES.


QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26995
DATE: OCTOBER 03, 2017

SIGNATURE:

D3

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements in the subdivision and any provisions in the subdivision agreement. The Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the Municipality of CLARINGTON.

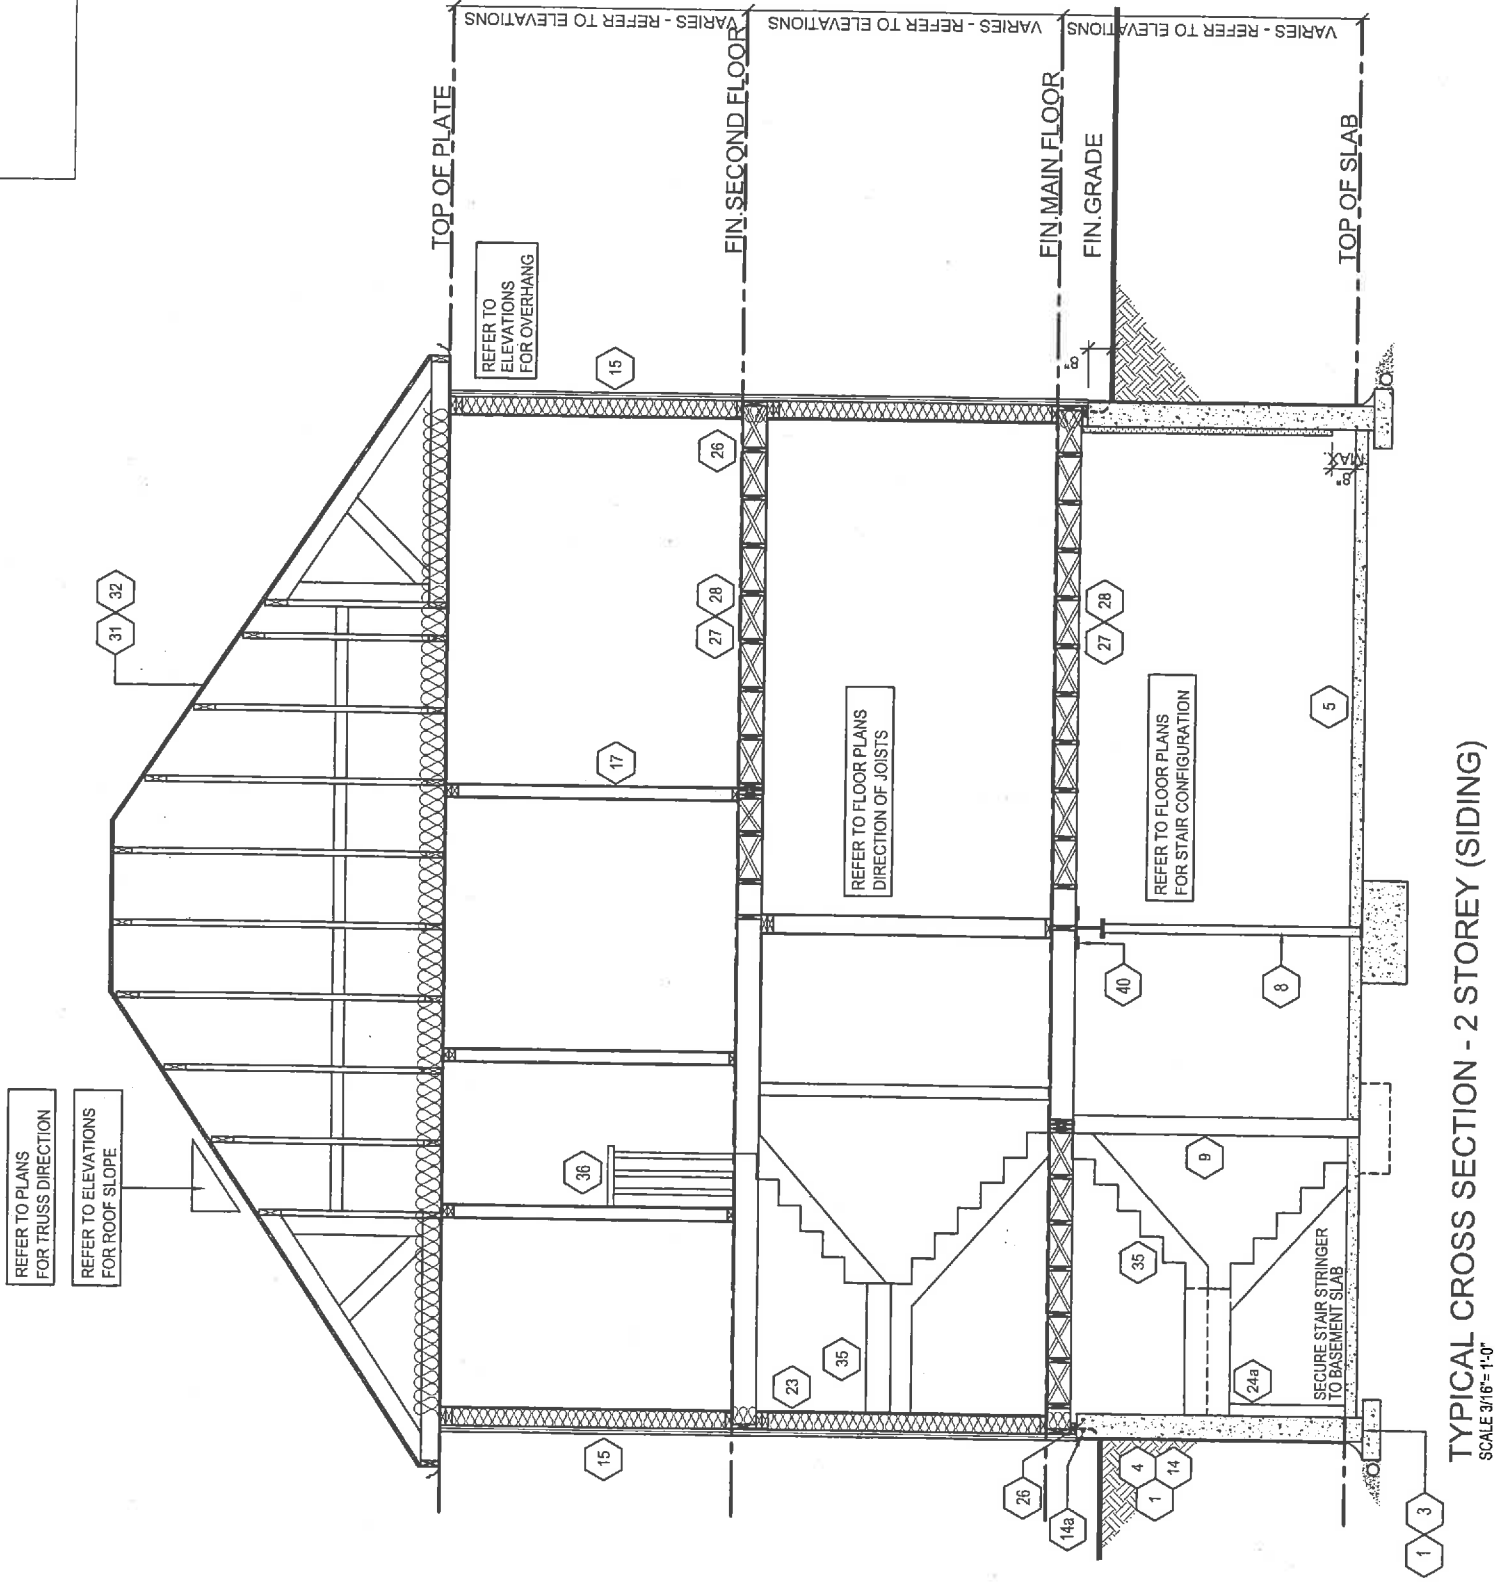

TYPICAL CROSS SECTION - 2 STOREY (SIDING)
SCALE 3/16" = 1'-0"



RN design
Imagine • Inspire • Create
TEL: (905) 738-3177
FAX: (905) 738-5449

MODEL
40-5 (GEORGE)

CLIENT
ESQUIRE HOMES
NORTHGLEN
CLARINGTON, ONTARIO

THESE DRAWINGS ARE NOT TO BE SCALED.
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD.

I, NELSON CUNHA, DECLARE THAT I HAVE REVIEWED AND TAKE DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3, SUBSECTION 3.2.4. OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES/CATEGORIES.

QUALIFIED DESIGNER BCIN: 21032
FIRM BCIN: 26895
DATE: OCTOBER 03, 2017
SIGNATURE:

No.	ISSUED OR REVISION COMMENTS	DATE	DWN	CHK	SCALE
1.	UPDATED TO OBC 2017 ENACTMENT	AUG. 28-2017	SB	NC	M/A
2.	REVISED AS PER ENG. COMMENTS	SEPT. 27-2017	HAZ	NC	PROJECT NUMBER 16062
3.	ISSUED FOR FINAL	OCT. 03-2017	SB	NC	PAGE 1 OF 1
D4					