



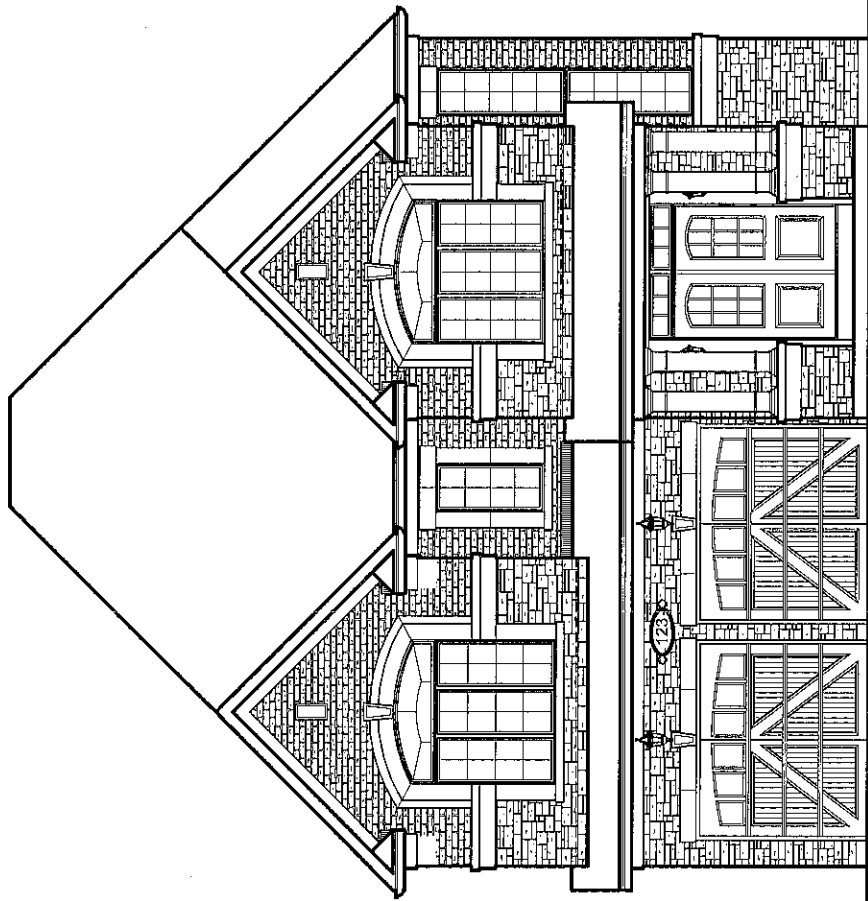

FRONT ELEVATION 'A'

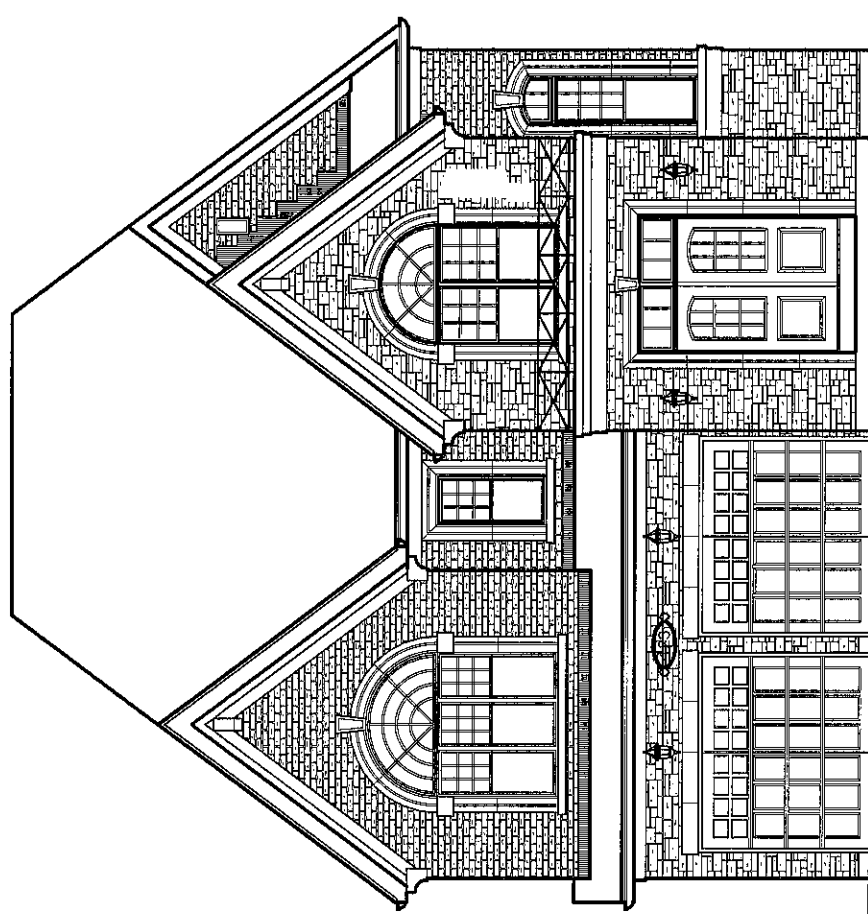

FRONT ELEVATION 'B'

Drawing List:

- A0 TITLE SHEET
- A1 BASEMENT FLOOR PLAN ELEV. 'A' & 'B'
- A2 GROUND FLOOR PLAN ELEV. 'A'
- A3 SECOND FLOOR PLAN ELEV. 'A'
- A4 PART. GROUND FLOOR PLAN ELEV. 'B'
- A5 PART. SECOND FLOOR PLAN ELEV. 'B'
- A6 FRONT ELEVATION 'A'
- A7 RIGHT SIDE ELEVATION 'A'
- A8 REAR ELEVATION 'A' & 'B'
- A9 LEFT SIDE ELEVATION 'A'
- A10 FRONT ELEVATION 'B'
- A11 RIGHT SIDE ELEVATION 'B'
- A12 LEFT SIDE ELEVATION 'B'
- A12 TYPICAL CROSS SECTION
- D1 CONSTRUCTION NOTES
- D2 CONSTRUCTION NOTES
- D3 CONSTRUCTION NOTES

Areas:

	ELEVATION 'A'		ELEVATION 'B'	
	SF	SM	SF	SM
GROUND FLOOR PLAN	1307.1	121.4	1307.1	121.4
SECOND FLOOR PLAN	1679.8	156.1	1679.9	156.1
SECOND FLOOR PLAN OTB	(92.5)	(8.6)	(92.5)	(8.6)
TOTAL AREA	2894.4	268.9	2894.5	268.9
COVERAGE INC PORCH	1765.1	164.0	1765.1	164.0
COVERAGE NOT INC PORCH	1704.3	158.3	1704.3	158.3

Gold Park Homes McLaughlin and Mayfield The Bach

File D:\caddm\projects\13098\architectural\mod\B3A1_F1A1-4113098 - 101-4-FINAL.dwg Plotted: Jan 26, 2016 By: JULIEP

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND
TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK
ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3
SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM
QUALIFIED AND THE FIRM IS REGISTERED IN THE
APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: 26-Jan-16

SIGNATURE:

[Signature]

client

Gold Park Homes

location

Brampton

project


McLaughlin and Mayfield

marketing name

The Bach

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REM	RPA	5				
2	ROOF TRUSS COORDINATION.	14-May-15	RPA	DJH	6				
3	REVISED PER ENG. COMMENTS & FLOOR COORDINATION	15-Jan-16	SM	JM	7				
4	ISSUED FOR PERMIT	26-Jan-16	hcz	JP	8				

PN design
Imagine • Inspire • Create



model

41-4

scale

3/16" = 1'0"

project #

13098

page

A0



FOR PORCH SLAB ABOVE

A circular professional seal for a Licensed Professional Engineer in the Province of Ontario. The seal features a central emblem with a stylized 'P' and 'E' and a signature. The text around the emblem reads 'LICENSED PROFESSIONAL ENGINEER' at the top and 'PROVINCE OF ONTARIO' at the bottom. In the center, the name 'A. KONG' and the license number '100184942' are printed.

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD.** UNDER DIVISION C PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: 26-Jan-16
SIGNATURE: 


Gold Park Homes	marketing name
project	
McLaughlin and Mayfield	The Bach
Brampton	

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015		RPA	5				
2	REVISED PER ENG. COMMENTS & FLOOR COORDINATION	15-Jan-16		JM	6				
3	ISSUED FOR PERMIT	26-Jan-16		JP	7				
4					8				

AIN design
Imagine • Inspire • Create

A


NOTE: NO UNPROTECTED OPENING;
FOR LIMITING DISTANCE LESS THAN:
AS PER 9.10.14 OF THE ONTARIO BUI

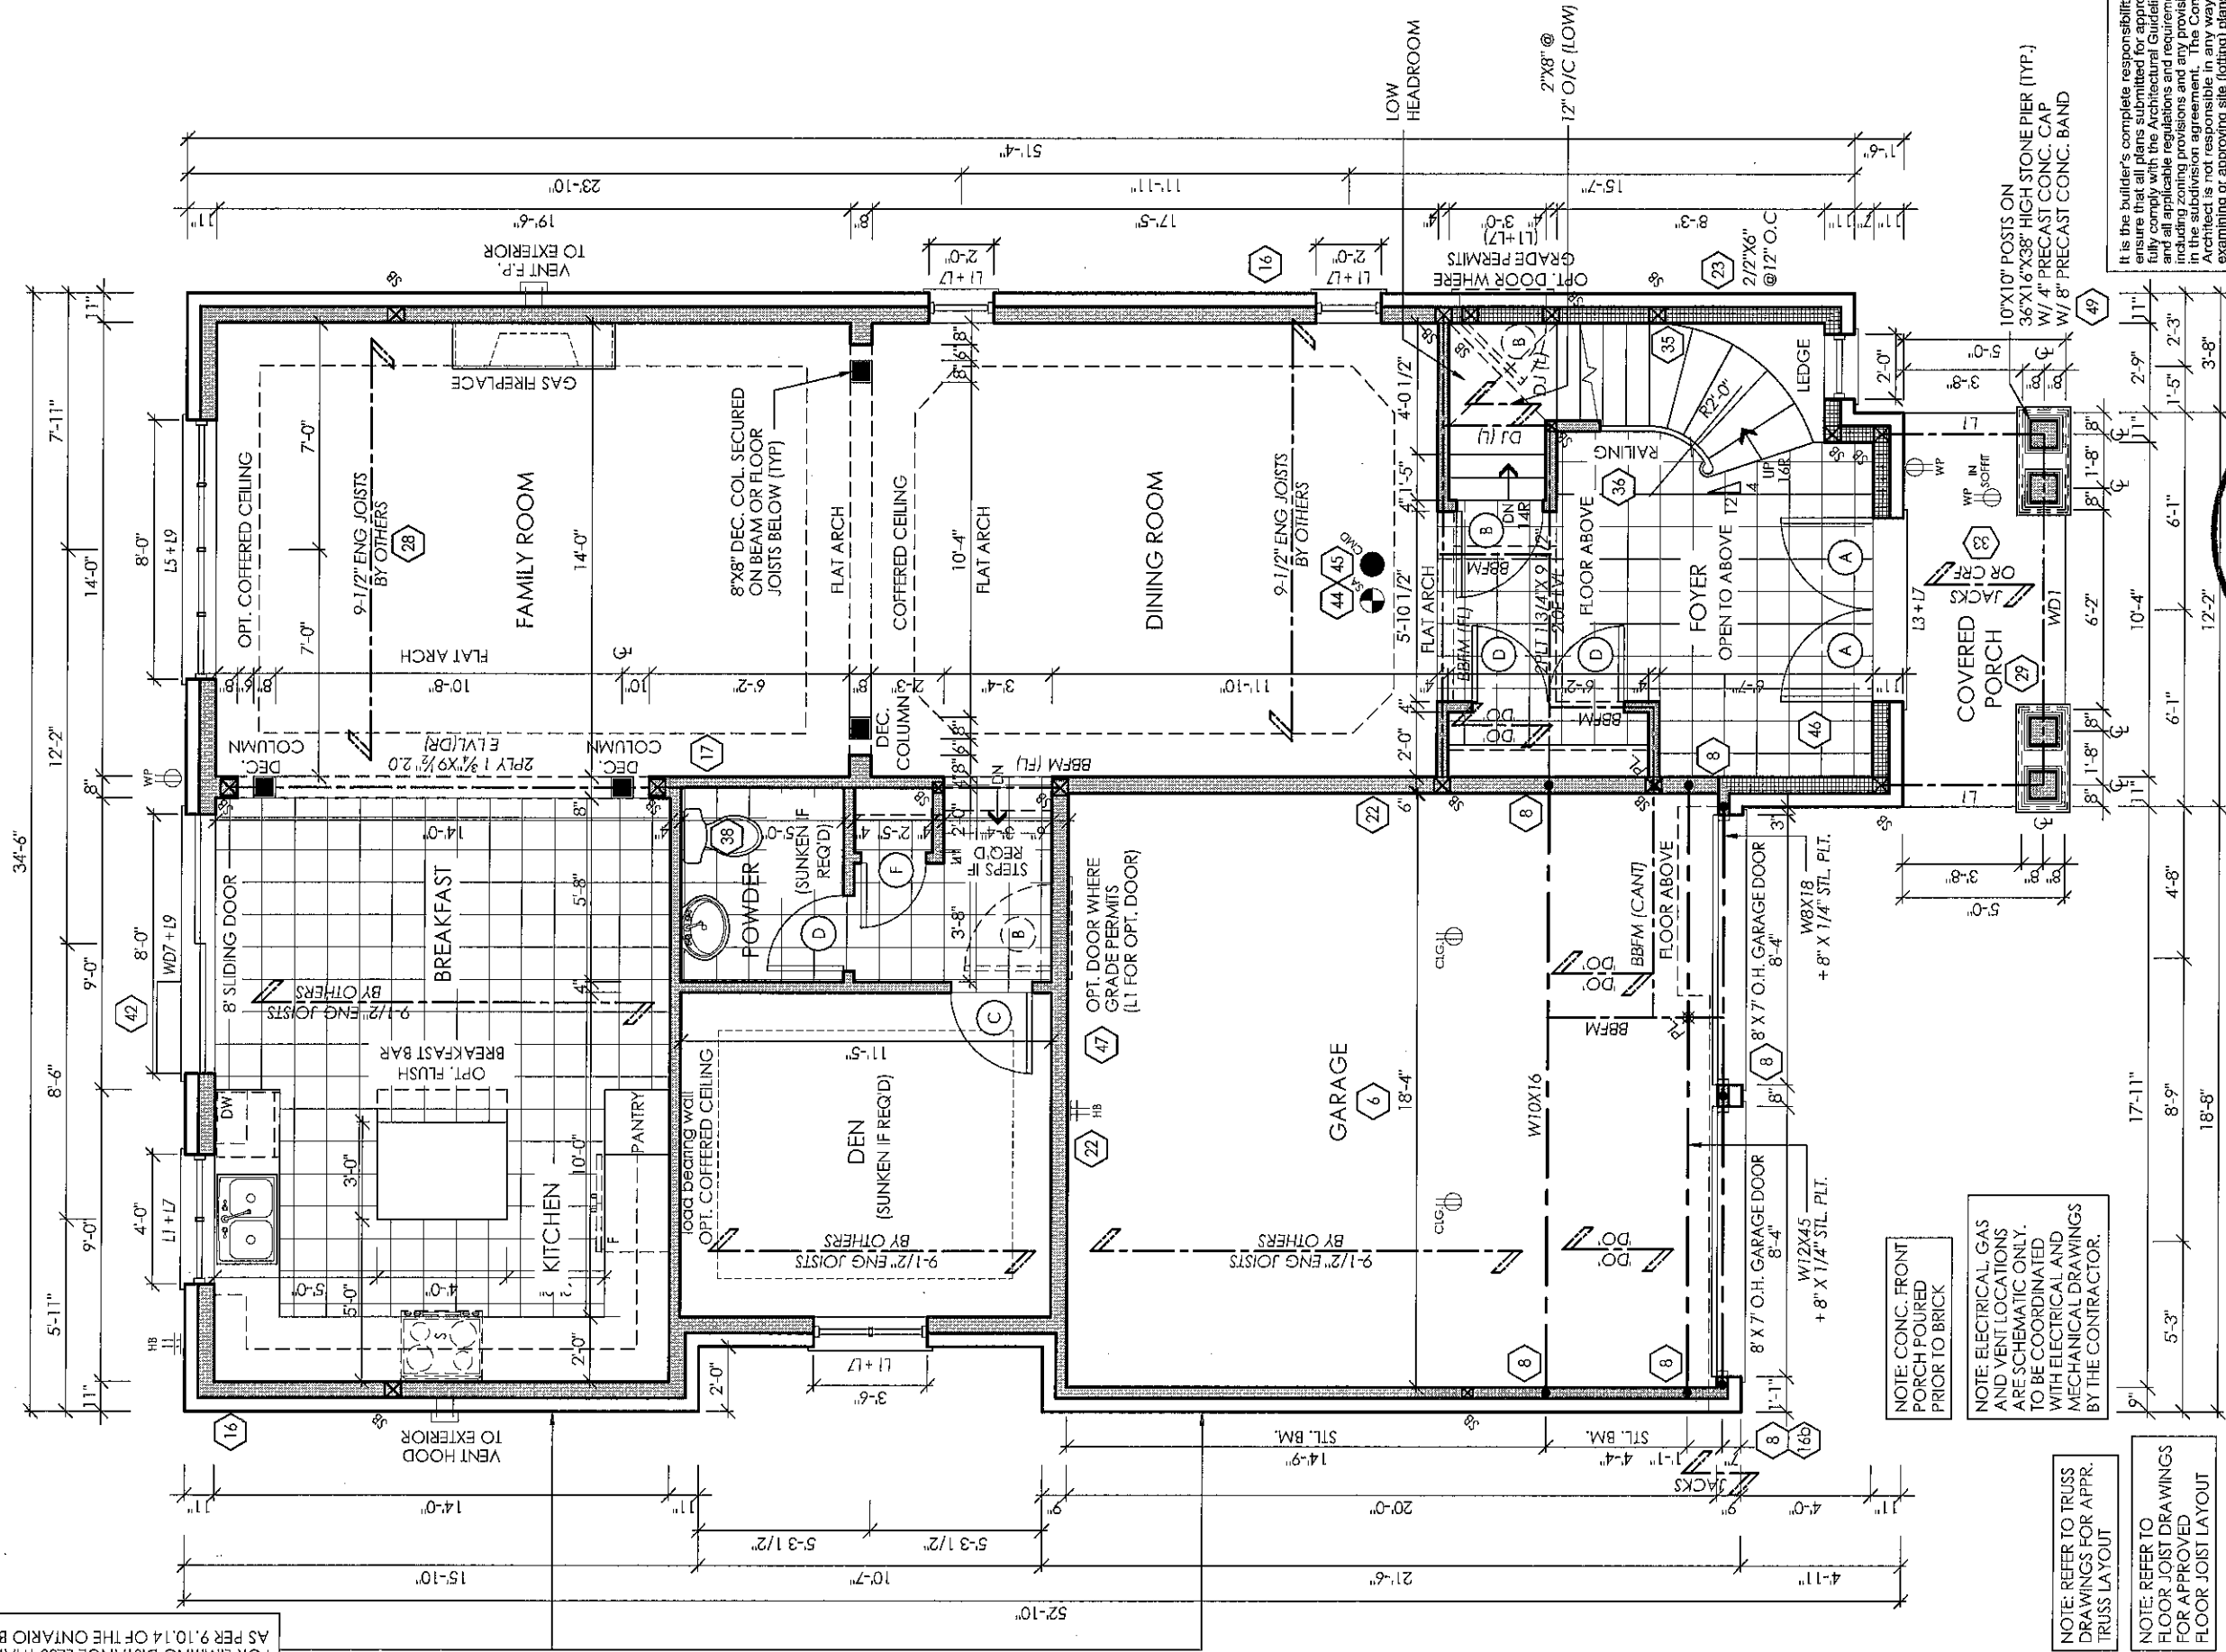

GROUND FLOOR PLAN ELEV. 'A'

FEB 12 2016

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS

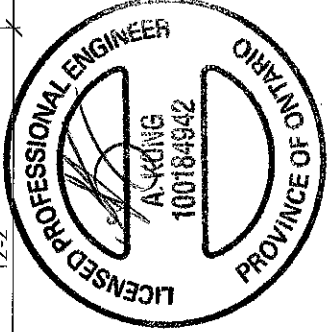

It is the builder's complete responsibility to ensure that all plans submitted for approval comply with the applicable Building Code and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

JAN 29 2016

John G. Williams Limited, Architect

client

Gold Park Homes

project

McLaughlin and Mayfield

location

Brampton

marketing name

The Bach

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	30/01/2015	REM	RPA	5				
2	REVISED PER ENG. COMMENTS & ROOM COORDINATION	15-Jan-16	SM	JM	6				
3	ISSUED FOR PERMIT	26-Jan-16	hz	jp	7				
4					8				


I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **BN DESIGN LTD.** UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: 26-Jan-16

SIGNATURE:

[Signature]

BN design
Imagine • Inspire • Create



model

41-4

scale

3/16" = 1'0"

project #

13098


page

A2

[illegible]

NOTE: ELECTRICAL, GAS AND VENT LOCATIONS ARE SCHEMATIC ONLY. TO BE COORDINATED WITH ELECTRICAL AND MECHANICAL DRAWINGS BY THE CONTRACTOR.

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS

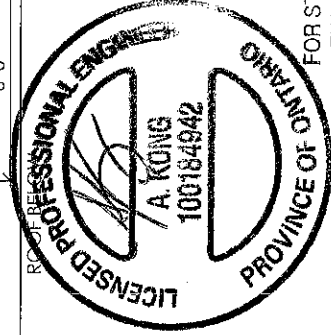

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

John G. Williams Limited, Architects

SIGNATURE:

project
McLaughlin and Mayfield

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REW	RPA	5				
2	ROOF TRUS COORDINATION.	14-May-15	RPA	DJH	6				
3	REVISED PER ENG. COMMENTS & FLOOR COORDINATION	15-Jun-16	SM	JM	7				
4	ISSUED FOR PERMIT	26-Jan-16	hz	jp	8				


RN design
Imagine • Inspire • Create




scale

A3


FOR CONTINUATION REFER TO SECOND FLOOR PLAN ELEV. 'A'

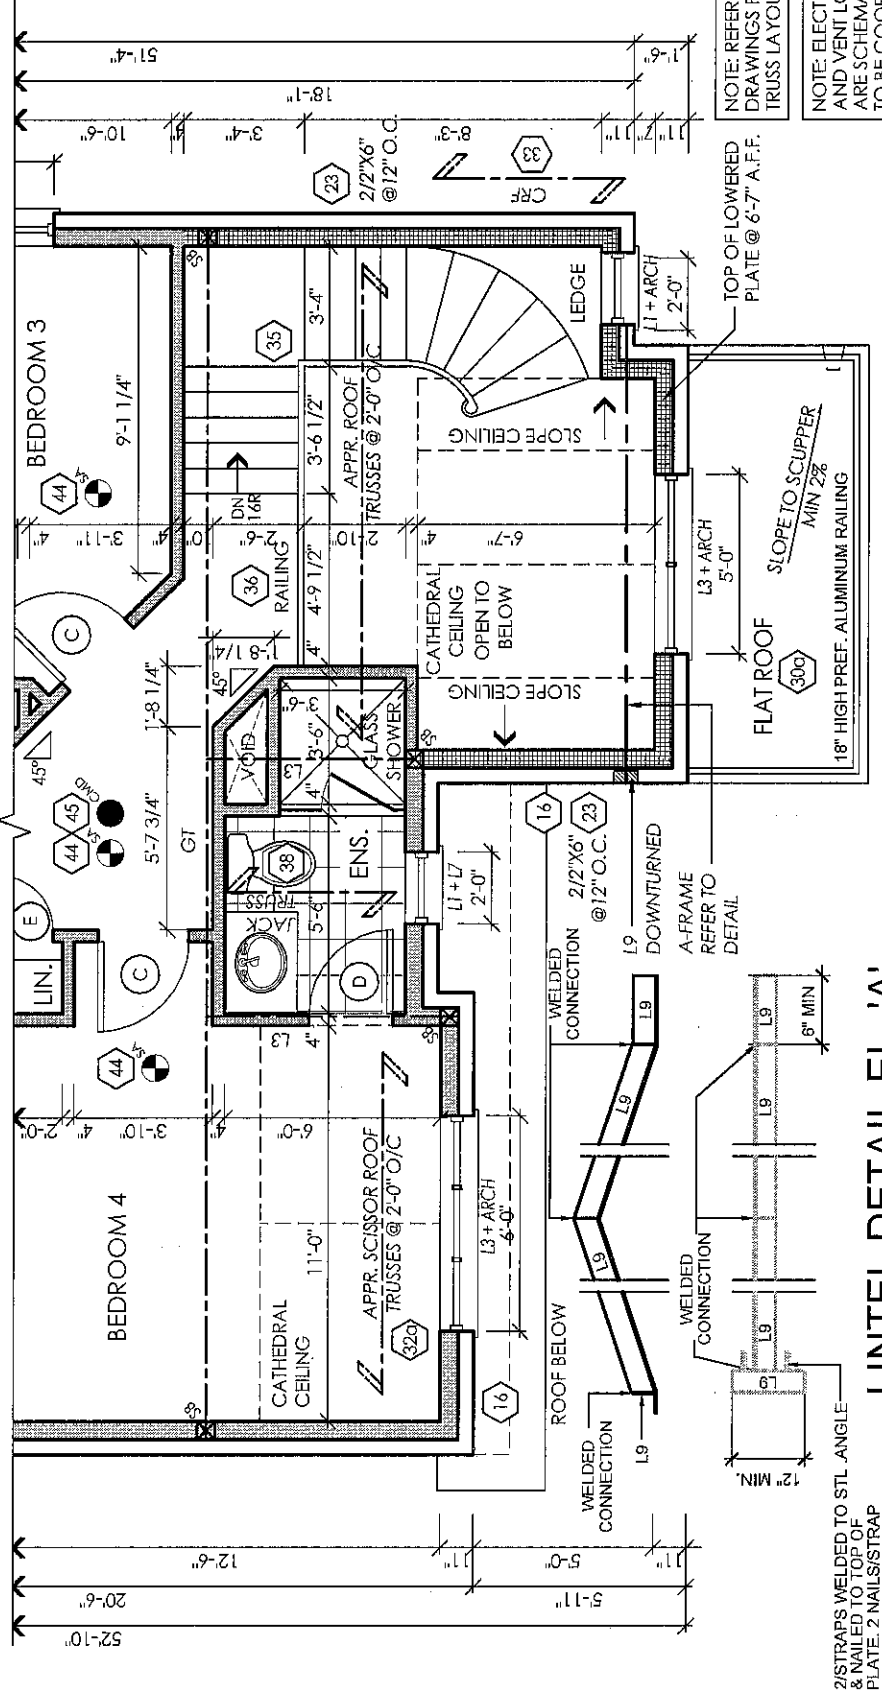

LINTEL DETAIL EL. 'A'

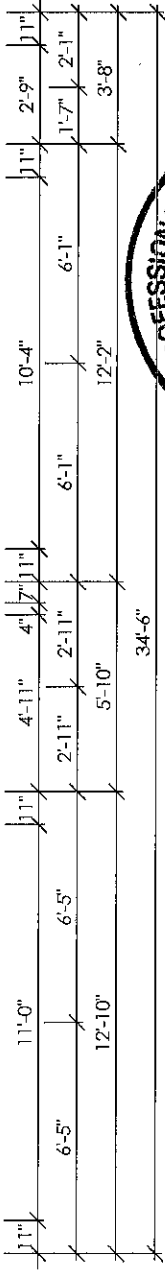


PART. SECOND FLOOR PLAN ELEV. 'B'

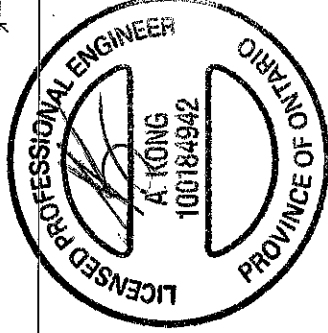

FEB 12 2016

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGN

FOR CONTINUATION REFER TO GROUND FLOOR PLAN ELEV. 'A'

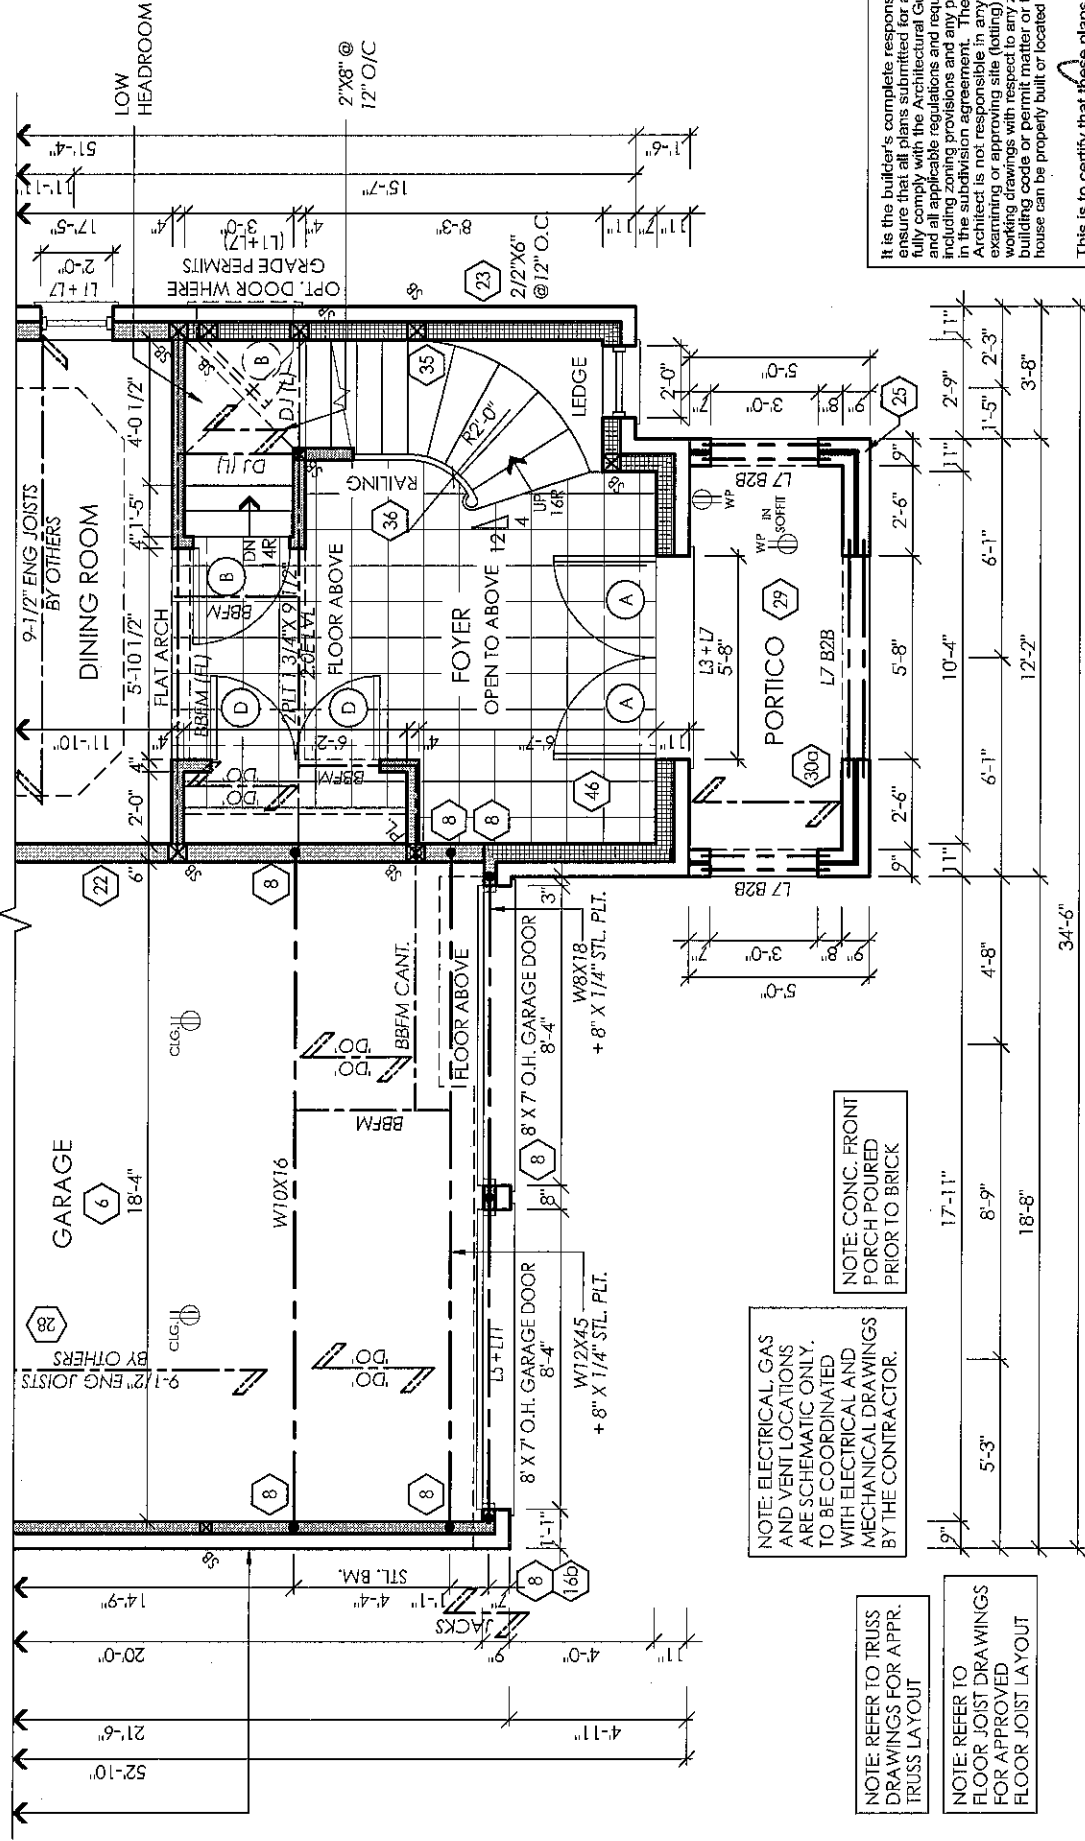

PART. GROUND FLOOR PLAN ELEV. 'B'

NOTE: REFER TO TRUSS
DRAWINGS FOR APPR.
TRUSS LAYOUT

NOTE: REFER TO
FLOOR JOIST DRAWINGS
FOR APPROVED
FLOOR JOIST LAYOUT

NOTE: ELECTRICAL GAS
AND VENT LOCATIONS
ARE SCHEMATIC ONLY.
TO BE COORDINATED
WITH ELECTRICAL AND
MECHANICAL DRAWINGS
BY THE CONTRACTOR.

NOTE: CONC. FRONT
PORCH POURED
PRIOR TO BRICK

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and applicable regulations and requirements including but not limited to the requirements in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

JAN 29 2016

John G. Williams Limited, Architect

File D:\Users\project13098\Architectural\Modell\FT141-413098-1-1-4-FINAL.dwg Plotted Jan 28, 2016 By: Julie P.

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND
TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK
ON BEHALF OF **ARN DESIGN LTD.** UNDER DIVISION C-PART-3
SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM
QUALIFIED AND THE FIRM IS REGISTERED IN THE
APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN:
FIRM BCIN:
DATE: 26-Jan-16

SIGNATURE:

client
Gold Park Homes
location
Brampton
project
McLaughlin and Mayfield
marketing name
The Bach

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REM	RPA	5				
2	ROOF TRUSS COORDINATION.	14-May-15	RPA	DJH	6				
3	REVISED PER ENG. COMMENTS & FLOOR COORDINATION	15-Jan-16	SM	JM	7				
4	ISSUED FOR PERMIT	26-Jan-16	Hz	JP	8				


model
41-4


scale
3/16" = 1'0"
project #
13098

page

A4

ARN design
Imagine • Inspire • Create



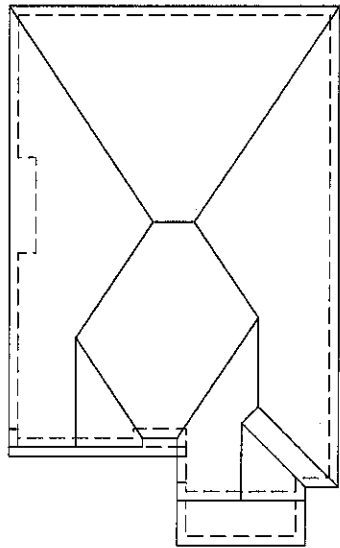

ROOF PLAN 'A'

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER, AT EACH CROSS POINT. POSTS LONGER THAN 6' TO BE Laterally Braced so that the distance between end points & between rows of bracing does not exceed 6'.

REFER TO TRUSS DRAWINGS FOR APPROVED TRUSS LAYOUT.

1"x8" DECOR. ALUM. CLAD FRIEZE BOARD (TYP.)

CATHEDRAL CEILING @ 10:12

PREFINISHED MTL. FLASHING W/ CAULKING TO MATCH

PRE-FINISHED ALUMINUM R.W.L. AND GUTTER ON PRE-FINISHED FASCIA BRD. AND VENTED SOFFIT

FACE BRICK (TYP.)

4"x8" PRECAST BAND

8" PRECAST BOND (TYP.)

4" PRECAST SILL (TYP.)

U/S OF GARAGE & PORCH SOFFIT

8" PRECAST HEADER W/ CENTRE RECESSED KEYSTONE (TYP.)

FIN. GROUND FLOOR

FIN. GRADE

U/S OF FOOTING

STEPPED FOOTING

TOP OF SLAB

FRONT ELEVATION 'A'

12 8:12 12 12

12:12

12" (TYP.)

1'-4" (TYP.)

12" (TYP.)

1'-4" (TYP.)

12" (TYP.)

1'-4" (TYP.)

12" (TYP.)

1'-4" (TYP.)

12" (TYP.)

1'-4" (TYP.)

12" (TYP.)

1'-4" (TYP.)

12" (TYP.)

1'-4" (TYP.)

12" (TYP.)

1'-4" (TYP.)

PEAK HEIGHT OF ROOF

34'-5"

#210 SELF SEALING ASPHALT SHINGLES W/ FLASHING AT VALLEYS

31

8" X 16" PRECAST STONE DETAIL

CATHEDRAL CEILING @ 8:12

MID HEIGHT OF ROOF

26'-2"

TOP OF STONE

72" X 20" EXTENDED ARCH TRANSOM W/ 4"x8" SELF SUPPORTING PRECAST ARCH HEADER W/ CENTER RECESSED KEYSTONE W/ 4"x8" PRECAST RETURNS W/ PRECAST CONC. SILL (TYP.)

TOP OF PLATE

TOP OF WINDOW

TOP OF BAND

8" PRECAST HEADER (TYP.)

METAL FLASHING BEHIND

FIN. SECOND FLOOR

8" PRECAST CONC. HEADER ABOVE DOOR ON 8" PRECAST SURROUND

TOP OF TRANSOM

TOP OF DOOR

TOP OF BAND

10"x10" POSTS ON 36"x16"x38" HIGH STONE PIER (TYP.) W/ 4" PRECAST CONC. CAP W/ 8" PRECAST CONC. BAND TOP OF PER

STONE VENEER TYP.

FIN. GROUND FLOOR

FIN. GRADE

8" POURED CONC. FDN. WALLS ON 19" X 6" CONC. STRIP FOOTING (TYP.)

1 4 14

(2) - 34"x82" EXT. DOORS W/ FIXED GLASS INSERTS (TYP.)

POURED CONC. DOOR SILL

POURED CONC. PORCH SLAB

TOP OF SLAB

49

29

GROSS GLAZING AREA 'A'

TOTAL PERIPHERAL WALL AREA	3463.15 SF	321.73 m²
FRONT GLAZING AREA	89.92 SF	8.35 m²
LEFT SIDE GLAZING AREA	13.89 SF	1.29 m²
RIGHT SIDE GLAZING AREA	64.33 SF	5.98 m²
REAR GLAZING AREA	167.74 SF	15.58 m²
TOTAL GLAZING AREA	335.88 SF	31.20 m²
TOTAL GLAZING PERCENTAGE	9.70 %	

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the zoning by-law. The Control Authority is not responsible for the accuracy of the information provided in the plans or for the results of any zoning or planning code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

JAN 29 2016

I, JULIO PINOZ DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: 26-Jan-16

SIGNATURE:

location
Brampton

client
Gold Park Homes

marking name
The Bach

project
McLaughlin and Mayfield

date dwn chk

revisions

date dwn chk

revisions

date dwn chk

revisions

date dwn chk

revisions

date dwn chk

revisions

model
41-4

scale
3/16" = 1'0"

project #
13098


page

A5

pin design
Imagine • Inspire • Create



John G. McLaughlin, Architect, Inc. File: G:\Users\jgmc\Documents\Projects\13098-41-4-FINAL.dwg Plotted: Jan 28, 2016 By: jgmc

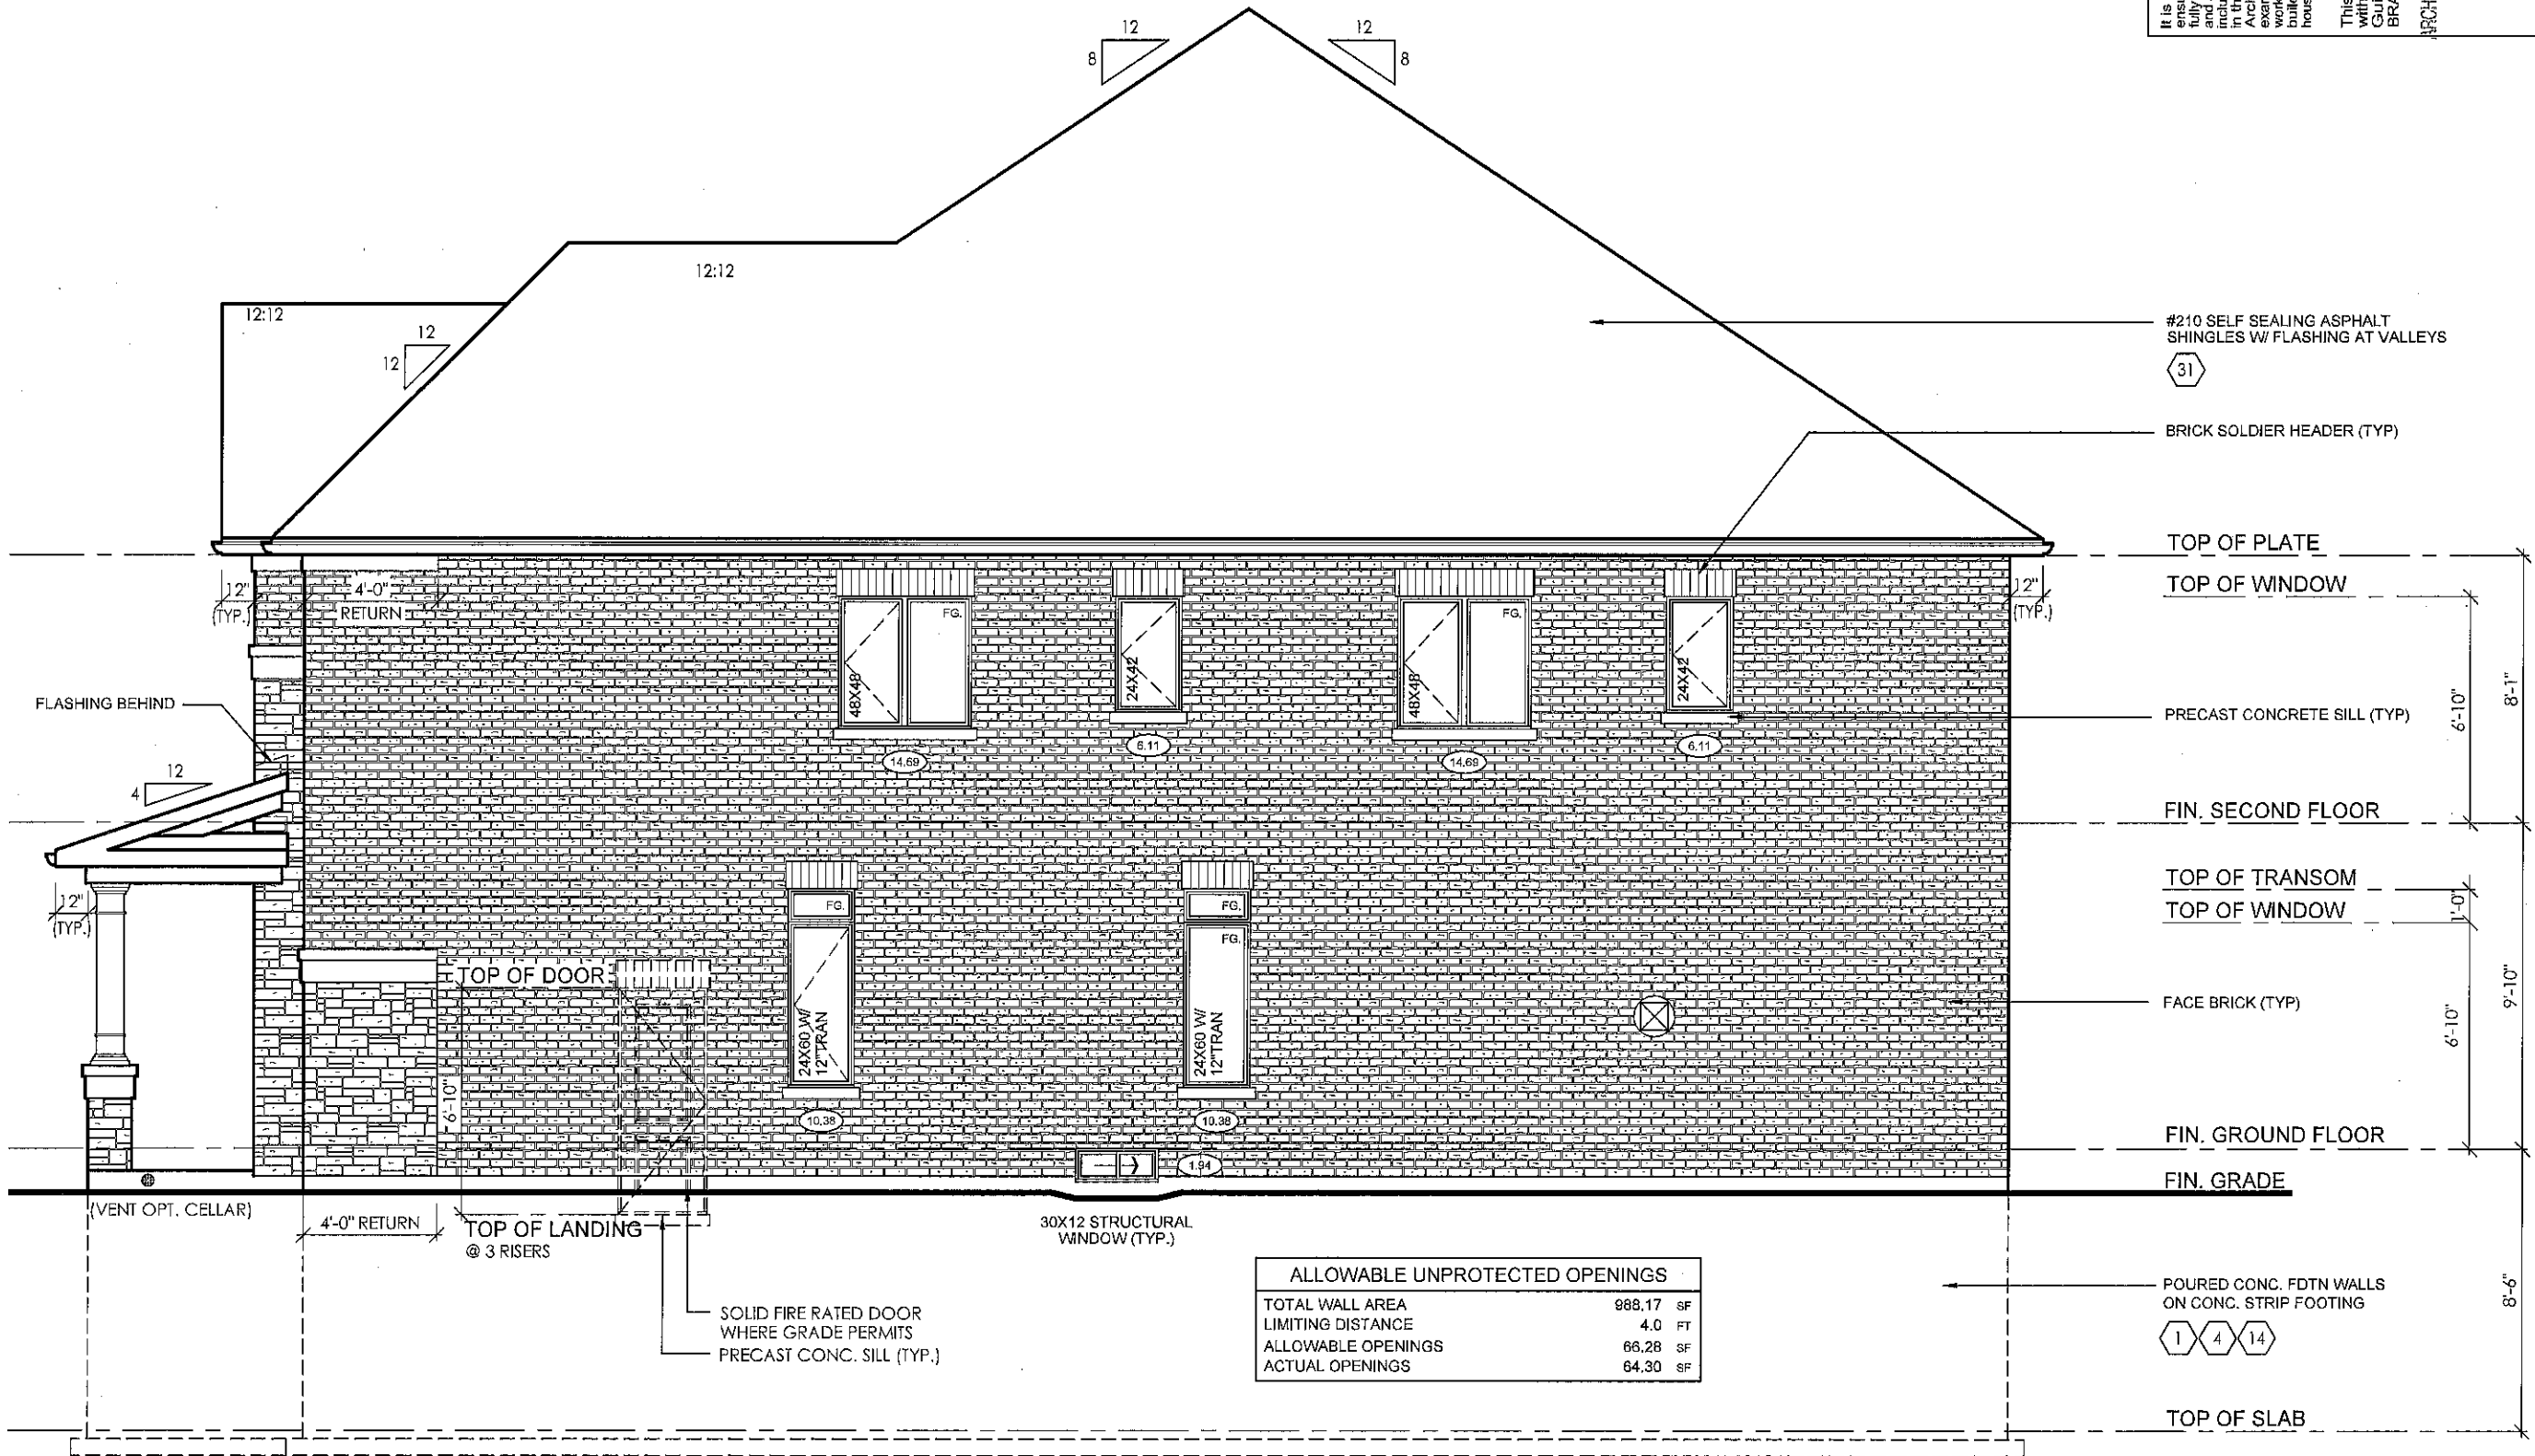

RIGHT SIDE ELEVATION 'A'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or existing conditions. The Control Architect's building code or permit matter of that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

JAN 29 2016

John G. Williams Licensed Architect

model
41-4

scale
3/16" = 1'0"

project #
13098

page




location		Brampton		marking name		The Bach		date dwn chk	
client		Gold Park Homes		McLaughlin and Mayfield		#		revisions	
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REM	RPA	5				
2	ISSUED FOR PERMIT	26-Jan-16	hr	JP	6				
3					7				
4					8				

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD.** UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26975
DATE: 26-Jan-16

SIGNATURE:

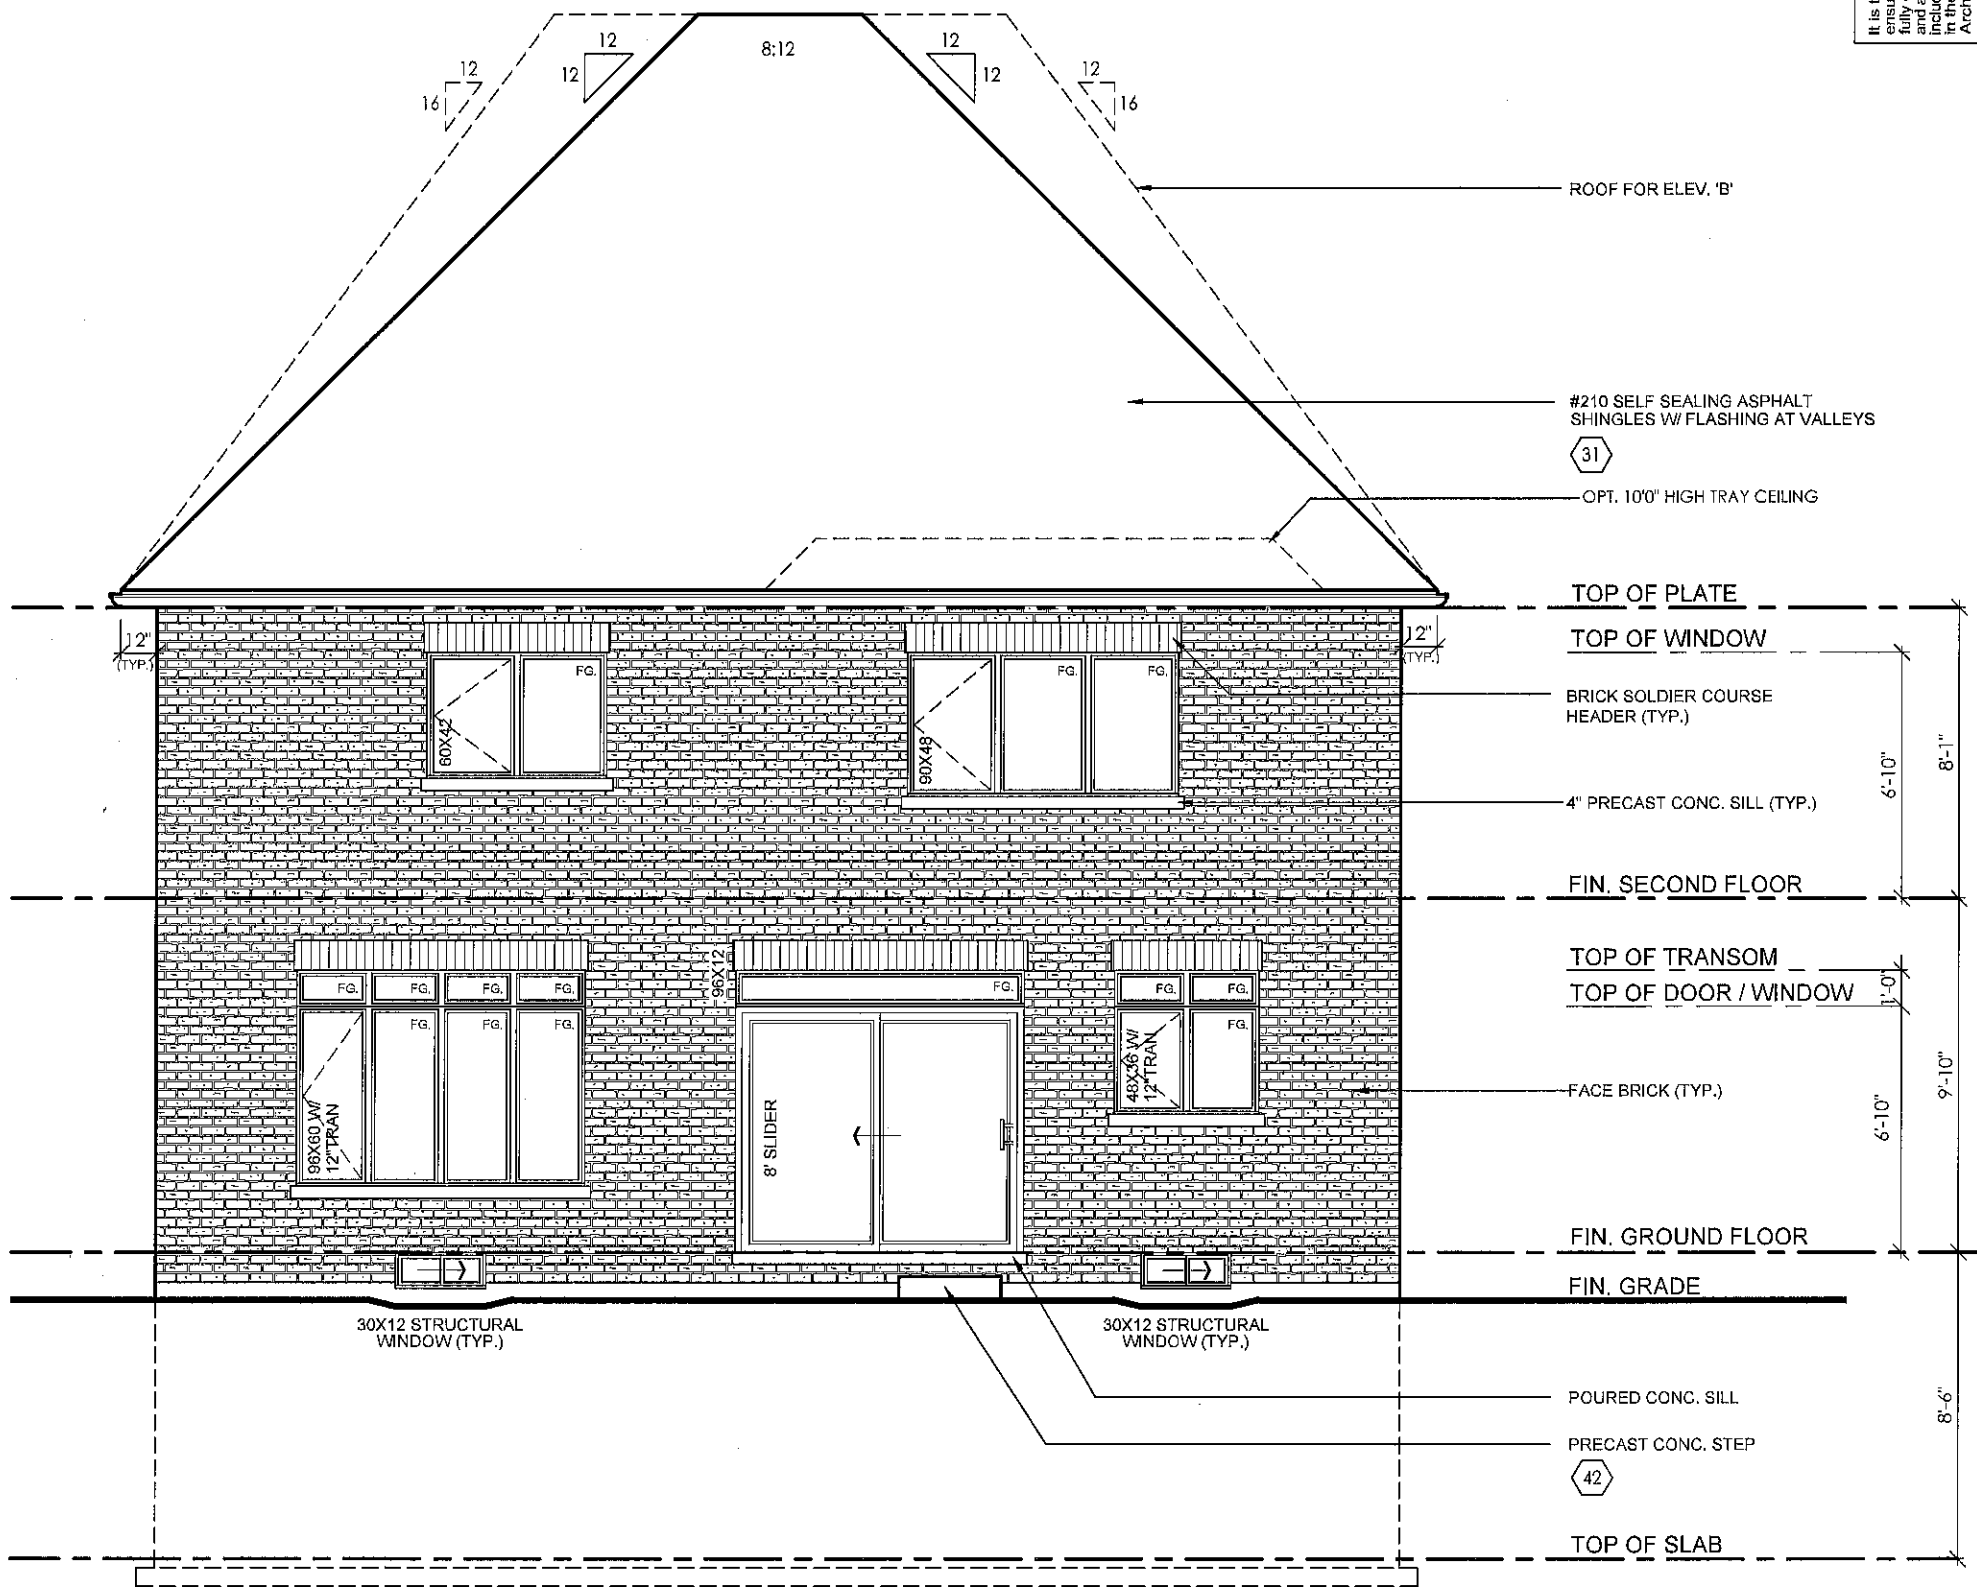

REAR ELEVATION 'A' & 'B'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including provisions and any provisions in the applicable zoning code. The City of Brampton is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

JAN 29 2016

John G. Williams Limited, Architect




location		Brampton							
project		The Bach							
client		McLaughlin and Mayfield							
#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REM	RPA	5				
2	ISSUED FOR PERMIT	26-Jan-16	hz	jp	6				
3					7				
4					8				

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF PN DESIGN LTD UNDER DIVISION C, PART-3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 356688
FIRM BCIN: 26795
DATE: 26-Jan-16

SIGNATURE:

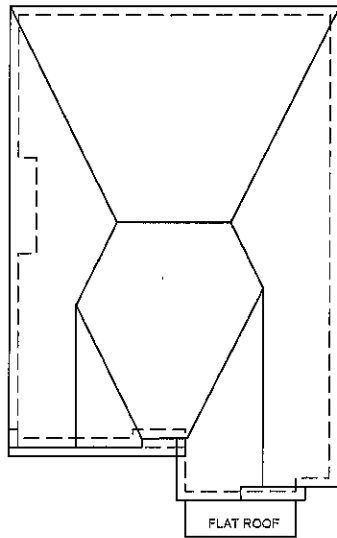

ROOF PLAN 'B'

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER, AT EACH CROSS POINT. POSTS LONGER THAN 6' TO BE Laterally BRACED SO THAT THE DISTANCE BETWEEN END POINTS & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

REFER TO TRUSS DRAWINGS FOR APPROVED TRUSS LAYOUT.

6"x4" DECOR. PRECAST CONC. DETAIL (TYP.)

1" X 8" + 1" X 2" ALUM. FASCIA BOARD (TYP.)

1" X 6" + 1" X 4" DECOR. ALUM. FRIEZE BOARD (TYP.)

CATHEDRAL CEILING @ 8:12

PRE-FINISHED ALUMINUM R.W.L. AND GUTTER ON PRE-FINISHED FASCIA BRD. AND VENTED SOFFIT

12"x10" PRECAST CONC. CORNICE DETAIL

FACE BRICK (TYP.)

4" PRECAST SILL (TYP.)

PREFINISHED MTL. FLASHING W/ CAULKING TO MATCH

U/S OF GARAGE SOFFIT

8" PRECAST HEADER W/ CENTRE RECESSED KEYSTONE (TYP)

STONE VENEER TYP.

FIN. GROUND FLOOR

FIN. GRADE

U/S OF FOOTING

STEPPED FOOTING

3

FRONT ELEVATION 'B'

GROSS GLAZING AREA 'B'

TOTAL PERIPHERAL WALL AREA	3457.79 SF	321.23 m²
FRONT GLAZING AREA	93.78 SF	8.71 m²
LEFT SIDE GLAZING AREA	13.89 SF	1.29 m²
RIGHT SIDE GLAZING AREA	64.33 SF	5.98 m²
REAR GLAZING AREA	167.74 SF	15.56 m²
TOTAL GLAZING AREA	339.74 SF	31.56 m²
TOTAL GLAZING PERCENTAGE	9.83 %	

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions of the subdivision agreement. The Control Authority reserves the right to require the architect or engineer to provide additional drawings or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

JAN 29 2016

John G. Williams Limited, Architect

PEAK HEIGHT OF ROOF

34'-5"

#210 SELF SEALING ASPHALT SHINGLES W/ FLASHING AT VALLEYS

31

8" X 16" PRECAST STONE DETAIL

TOP OF STONE DETAIL

MID HEIGHT OF ROOF

26'-2"

CATHEDRAL CEILING @ 8:12

60" X 30" DIA. ARCH TRANSOM W/ 8" SELF SUPPORTING PRECAST PROFILED ARCH HEADER W/ CENTER KEYSTONE 10"x8" STONE IMPOST W/ 8" PRECAST PROFILED RETURNS W/ 4" PRECAST CONC. SILL (TYP.)

TOP OF PLATE

TOP OF WINDOW

18" PRE-FINISHED ALUMINUM RAILING

16" BUILT-UP PRECAST DETAIL

8" SELF SUPPORTING PRECAST PROFILED ARCH HEADER W/ CENTER KEYSTONE W/ 8" PRECAST PROFILED RETURNS W/ 4" PRECAST CONC. SILL (TYP.)

FIN. SECOND FLOOR

TOP OF TRANSOM

TOP OF DOOR

TOP OF BAND

4"x8" CONT. PRECAST CONC. BAND

8" PRECAST PROFILED HEADER W/ CENTER KEYSTONE W/ 8" PRECAST PROFILED RETURNS

FIN. GROUND FLOOR

FIN. GRADE

8" POURED CONC. FDN. WALLS ON 19" X 6" CONC. STRIP FOOTING (TYP.)

1 4 14

(2) - 34"x82" EXT. DOORS W/ FIXED GLASS INSERTS (TYP.)

POURED CONC. DOOR SILL

POURED CONC. PORCH SLAB

29

TOP OF SLAB

location Brampton

client Gold Park Homes

marketing name The Bach

project Mclaughlin and Mayfield

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REM	RPA	5				
2	ISSUED FOR PERMIT	26-Jan-16	Hz	JP	6				
3					7				
4					8				

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 36688
FIRM BCIN: 26995
DATE: 26-Jan-16
SIGNATURE:

model 41-4

scale 3/16" = 1'0"

project # 13098

page


A9

PN design

Imagine • Inspire • Create



File D:\beam\project\13098\Architectural\Model\41-FRONT-41-3098-10-4-FINAL.dwg Plotted Jan 26, 2016 By: Julop

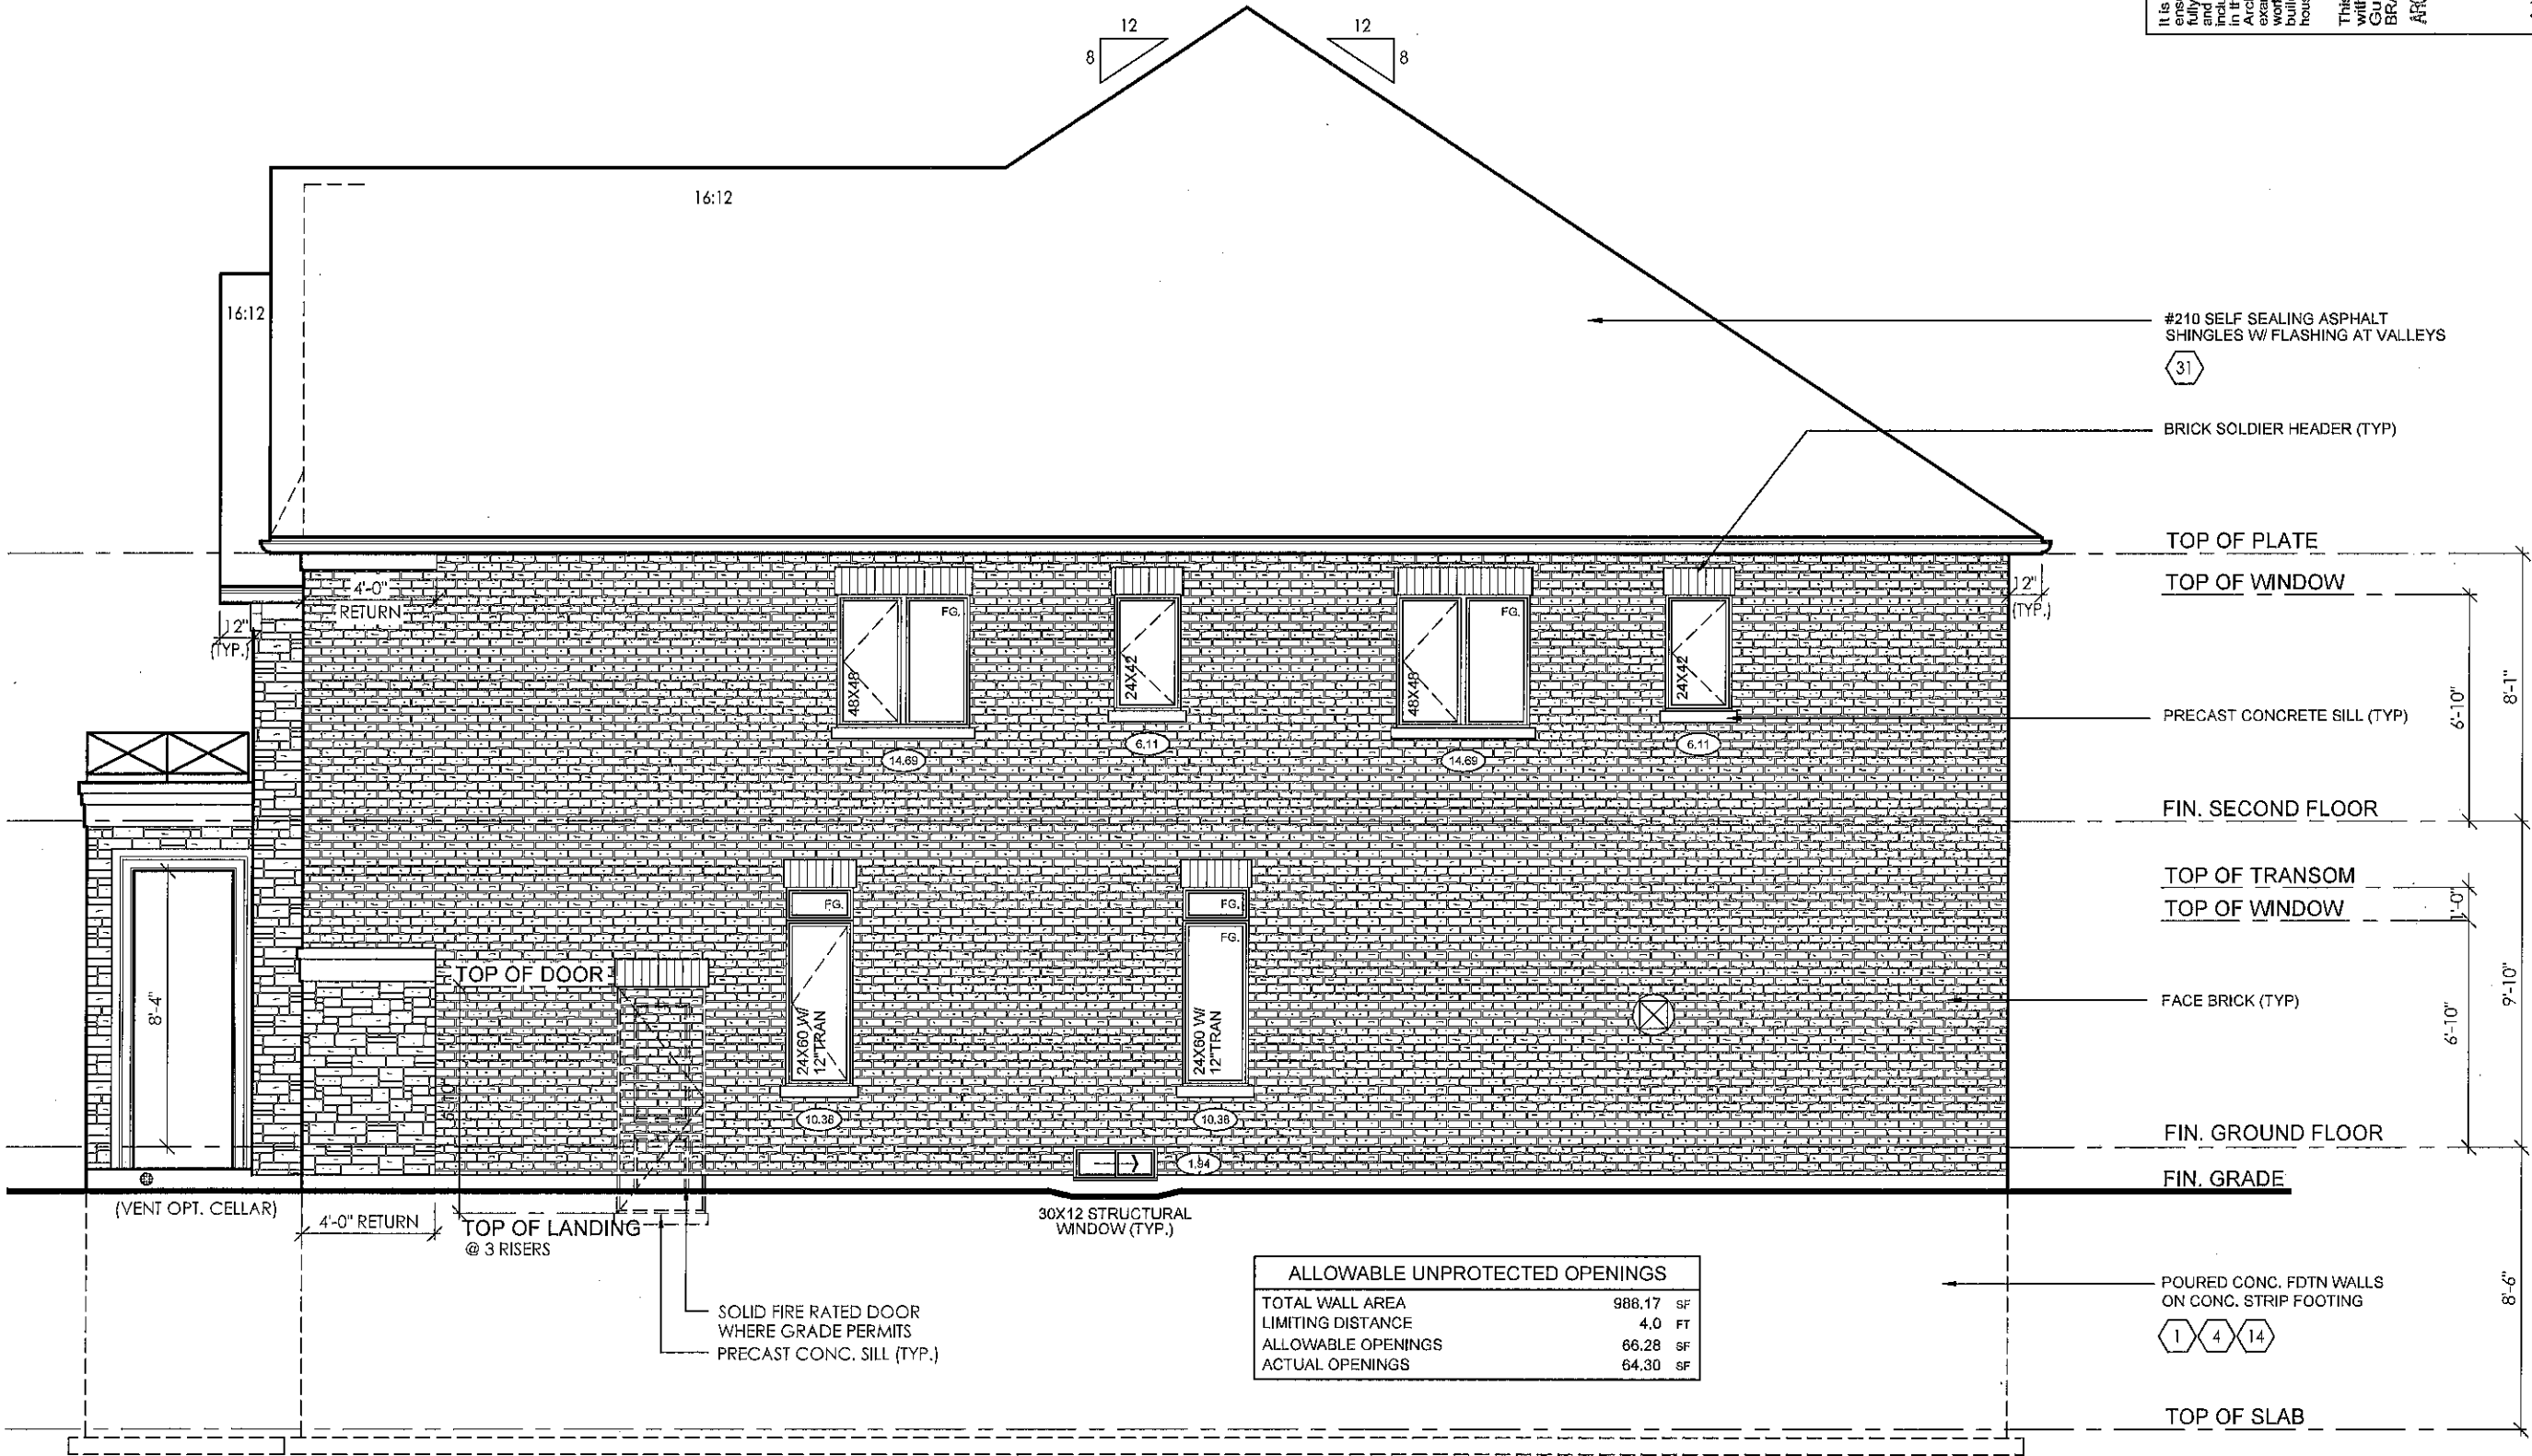

RIGHT SIDE ELEVATION 'B'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements in the jurisdiction. The Contractor is responsible for obtaining all necessary permits and ensuring that the work is completed in accordance with the approved drawings and the Building Code. The Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

JAN 29 2016

John G. Williams Limited, Architect

#210 SELF SEALING ASPHALT SHINGLES W/ FLASHING AT VALLEYS

BRICK SOLDIER HEADER (TYP)

TOP OF PLATE

TOP OF WINDOW

PRECAST CONCRETE SILL (TYP)

FIN. SECOND FLOOR

TOP OF TRANSOM

TOP OF WINDOW

FACE BRICK (TYP)

FIN. GROUND FLOOR

FIN. GRADE

POURED CONC. FDTN WALLS ON CONC. STRIP FOOTING

TOP OF SLAB


ALLOWABLE UNPROTECTED OPENINGS	
TOTAL WALL AREA	988.17 SF
LIMITING DISTANCE	4.0 FT
ALLOWABLE OPENINGS	66.28 SF
ACTUAL OPENINGS	64.30 SF


client		Gold Park Homes		Brampton		location			
project		McLaughlin and Mayfield		The Bach		marketing name			
#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REM	RPA	5				
2	ISSUED FOR PERMIT	26-Jan-16	hz	jp	6				
3					7				
4					8				

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD.** UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: 26-Jan-16

SIGNATURE:



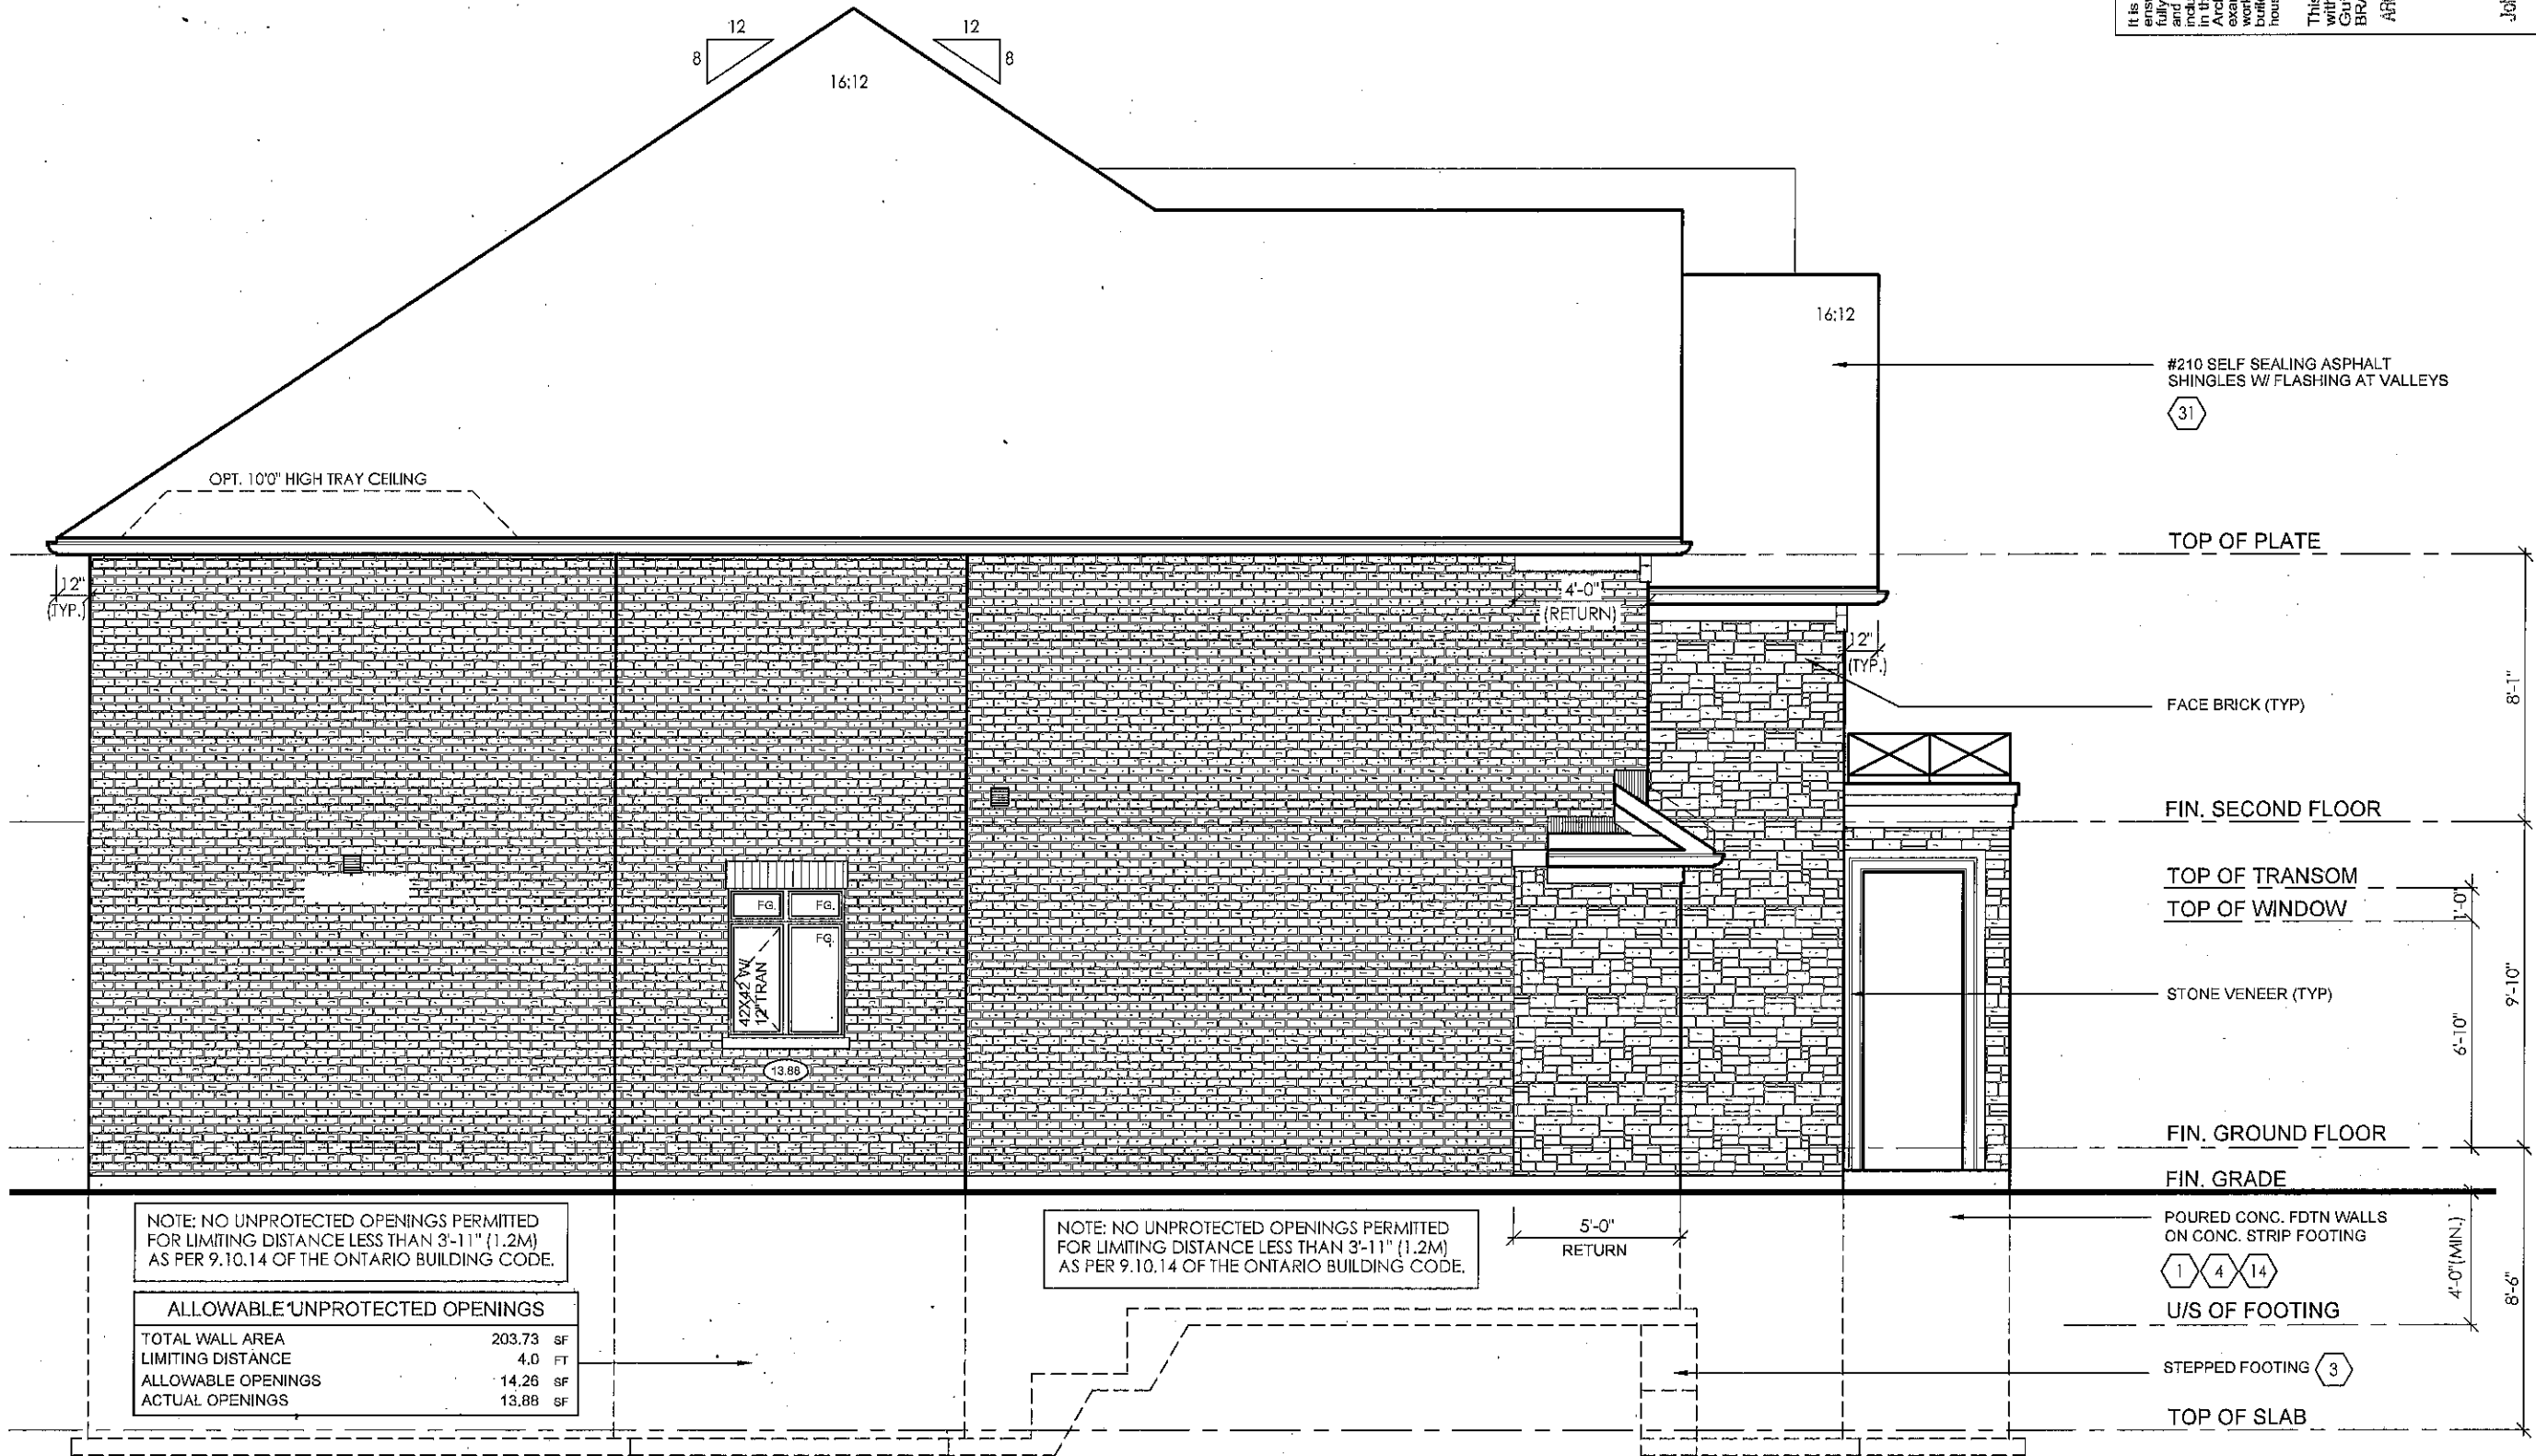

LEFT SIDE ELEVATION 'B'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building codes or permit matter or that any house can be properly built or located on this lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

JAN 29 2016

John G. Williams Limited, Architect




client		location							
Gold Park Homes		Brampton							
project		marketing name							
McLaughlin and Mayfield		The Bach							
#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REM	RPA	5				
2	ISSUED FOR PERMIT	26-Jan-16	Hz	JP	6				
3					7				
4					8				

I, JULIO PINOZ DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38498
FIRM BCIN: 26995
DATE: 26-Jan-16

SIGNATURE:

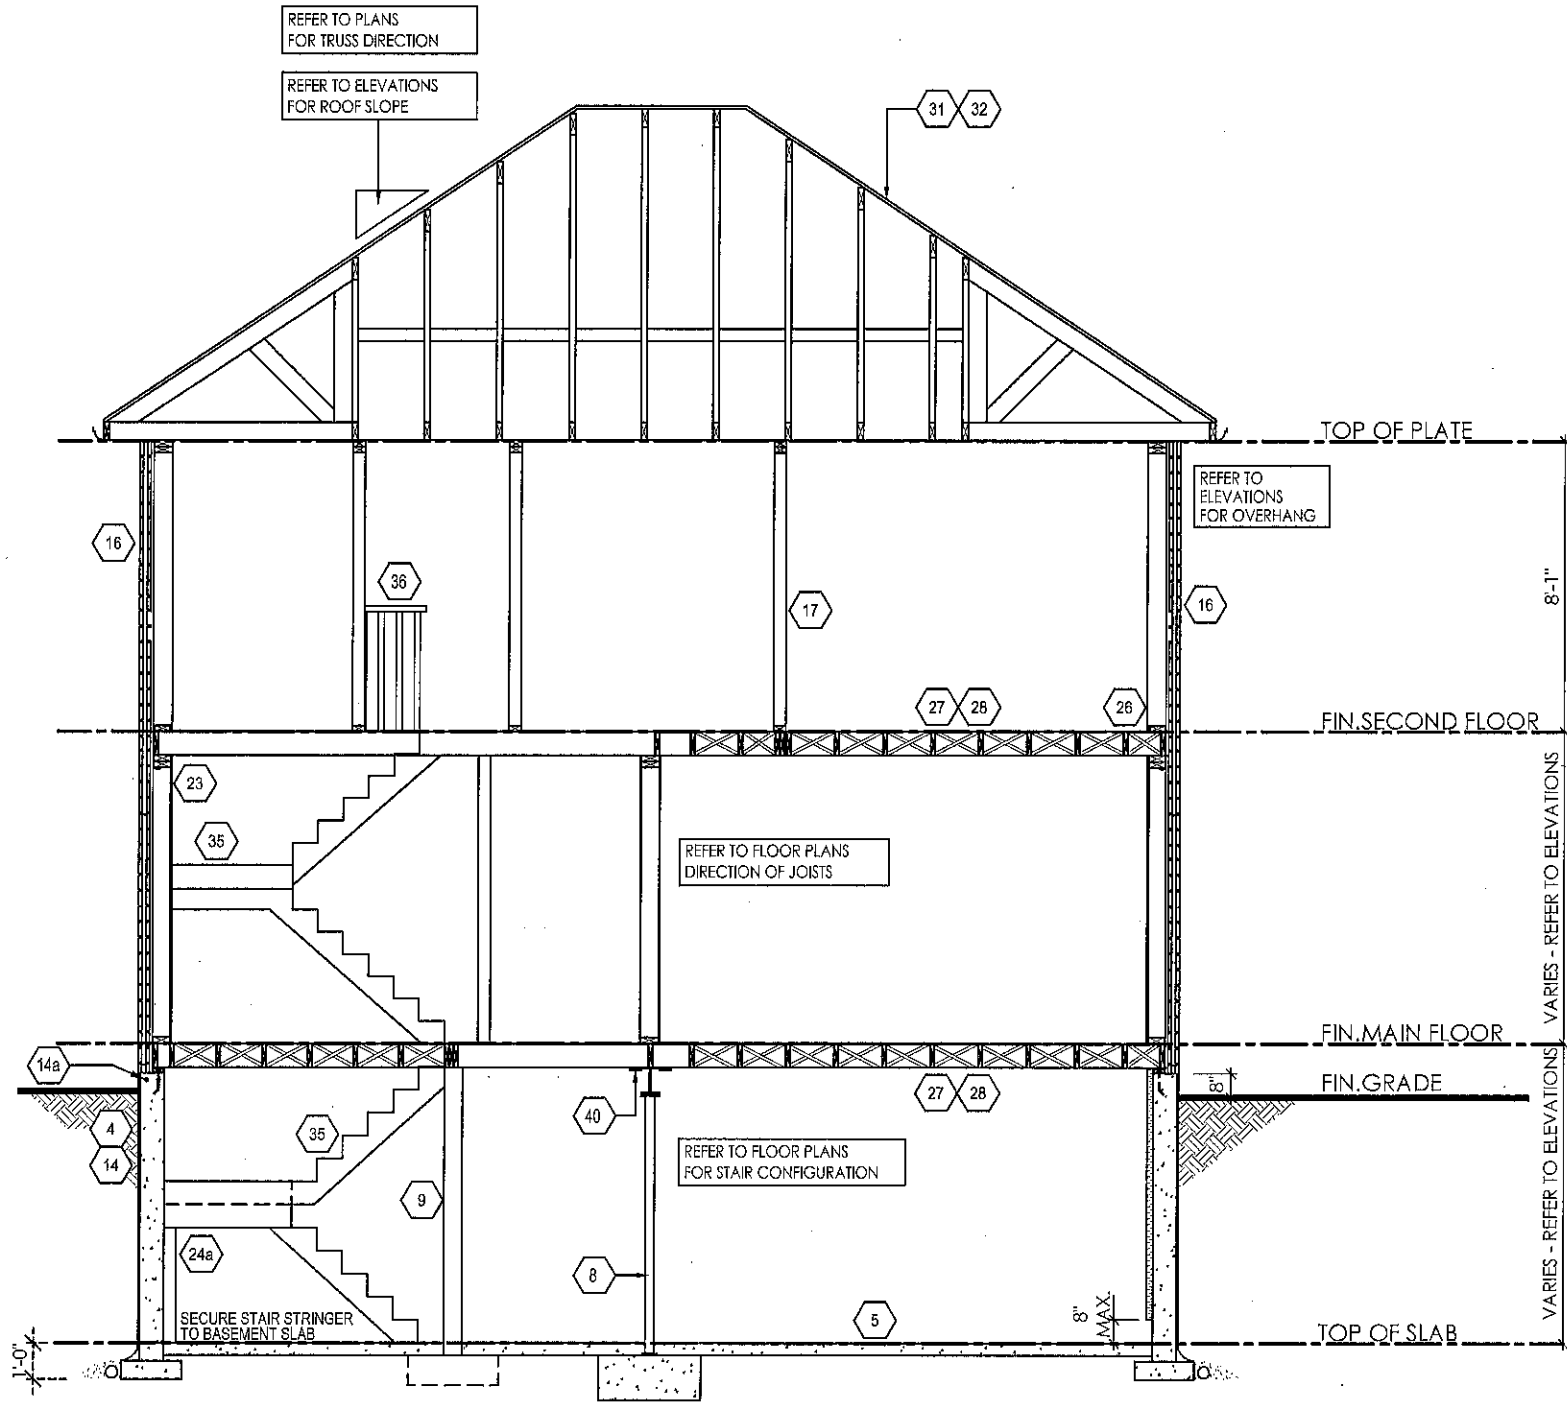

TYPICAL CROSS SECTION
SCALE: N.T.S.

model

41-4

scale

3/16" = 1'0"

project #

13098

page

A12

PN design

Imagine • Inspire • Create

client

Gold Park Homes

location

Brampton

project

McLaughlin and Mayfield

marking name

The Bach

#

1

ISSUED FOR CLIENT REVIEW.

30/01/2015

REM

RPA

5

2

ISSUED FOR PERMIT

26-Jan-16

Hz

JP

6

3

7

4

8

revisions

revisions

date dwn chk

date dwn chk

L. JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **PN DESIGN LTD.** UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688

FIRM BCIN: 26975

DATE: 26-Jan-16

SIGNATURE:

- 17

REQ. FOR FIRE RATING LESS THAN 4'-0" LIMITING DISTANCE:

O.B.C. SB-3 WALL = FW1b (STC = N/A, FIRE = 45 MIN)

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:

-ADD R15 (RSI 2.64) ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.

-REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

INTERIOR STUD WALLS:

O.B.C. 19.23.10.1.

-2" X 4" (38mmx 89mm) WOOD STUDS @ 16" (400mm) O.C. OR

-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C. W/

-DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE

-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.
- 18

BEARING STUD WALL (BASEMENT):

-2" X 4" (38mmx 89mm) WOOD STUDS @ 16" (400mm) O.C. OR

-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C. W/

-DBL. 2" X 4" OR 2" X 6" TOP PLATE.

-2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPROOFING MATERIAL.

-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C.

-FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB
- 19

PARTY WALL - BLOCK:

O.B.C. SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)

-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK

-SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/ MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO PREVENT SMOKE PASSAGE

-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES

-2" X 2" (38mmx 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH SIDES

-ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE CAVITY.

-7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)

-STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER O.B.C. 9.10.9.9.1) & TABLE 2.1.1. SB-2

-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)
- 19a

PARTY WALL - BLOCK (AGAINST GARAGE):

O.B.C. SB-3 WALL = B6c (STC = 51, FIRE = 2 HR)

-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS

-1/2" (12.7mm) GYPSUM BOARD

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4.

-2" X 4" (38mmx 89mm) WOOD STRAPPING @ 16" (400mm) O.C.

-R20 (RSI 3.52) RIGID INSULATION

-7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)

-1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN HOUSE AND GARAGE

-TAPE AND SEAL ALL JOINTS GAS TIGHT

REQ. INSULATION VALUES:

INSULATION VALUES PROVIDED BY CAN/CSA-P280-M90

-RIGID INSULATION = 20.00

-LOW DENSITY CONCRETE BLOCK = 1.70

-WOOD FRAME W/ GYPSUM = 2.72

-AIR FILM - MOVING = 0.68

-AIR FILM - STILL = 0.17

TOTAL "R" VALUE = 25.27
- 19b

FIREWALL:

O.B.C. 9.10.11.1. & 3.1.10.1. & SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)

- ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING AREA. O.B.C. 1.3.2.2.47.

-1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS

-2" X 2" (38mmx 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES OF WALL

-SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY

-7 1/2" (190mm) CONC. BLOCK, MIN. 2 HR. FIRE-RESISTANT RATING

-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS

-STAGGER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER O.B.C. 9.10.9.9.1) & TABLE 2.1.1. SB-2

-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)

-PROTRUDE PAST FASCIA @ EAVES W/ BRICK CORRELLING

-EXTEND 5/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/ THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.1)1)

-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER THAN 9'-0" (3m), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER O.B.C. 3.1.10.4.2)
- 20

PARTY WALL - FOUNDATION:

O.B.C. 9.15.4.2.

-7 7/8" (200mm) SOLD CONC. FOUNDATION WALL @ 2200psf (115MPa)

-COMPRESSIVE STRENGTH AFTER 28 DAYS

-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2
- 21

PARTY WALL - WOOD STUD:

O.B.C. SB-3 WALL = W18a (STC = 57, FIRE = 1 HR)

-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK

-2 ROWS 2"x4"(38mmx 89mm) STUDS @ 16"(400mm) O.C. W/ SEPARATE 2" X 4" (38mmx 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4" (38mmx 89mm) TOP PLATES

-SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE CAVITY.

-5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED & FILLED.

-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE [2] TO TABLE 1)

-NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =

-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmx 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmx 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- 22

GARAGE WALL & CEILING:

O.B.C. 9.10.9.16.3)

-1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING BETWEEN HOUSE AND GARAGE

-TAPE AND SEAL ALL JOINTS GAS TIGHT

-R22 (RSI 3.87) INSULATION IN WALLS.

-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4. FOR FLOOR ABOVE.

-INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN. REQUIRED GARAGE AREA (REFER TO MUNICIPAL STANDARDS).

-1/2" (12.7mm) GYPSUM BOARD

-ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH 4-3 1/4" (82mm) TOE NAILS

-BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7 7/8" (200mm) O.C.
- 22a

WALLS ADJACENT TO ATTIC SPACE:

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4.

-2" X 6" (38mmx 140mm) WOOD STUDS @ 16" (400mm) O.C.

-R22 (RSI 3.87) INSULATION

-1/2" (12.7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING ON ATTIC SIDE

-ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1.
- 23

DOUBLE VOLUME WALLS:

O.B.C. 9.23.10.1.

-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING

-REFER TO PLAN FOR STUD SPECIFICATION

-STUDS FASTENED AT TOP & BOTTOM WITH 3/ 3-1/4" (82mm) TOE NAILS

-DOUBLE TOP PLATES FASTENED TOGETHER WITH 3" (76mm) AT 7 7/8" (200mm) O.C.

-SOLID BRIDGING AT 3'-11" (1200mm) O.C.

-MIN. R22 (RSI 3.87) INSULATION (ZONE 1, O.B.C. 1.2.1.1.2.A.)

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C. 9.25.3. & 9.25.9.
- 24

EXPPOSED FLOOR:

-FLOOR AS PER NOTE # 28

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4.

-R31 (RSI 5.46) INSULATION

-VENIED ALUMINUM SOFT

24a

SUNKEN FINISHED AREAS:

-USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS.

-WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION WALLS INSTEAD OF USING BEARING POSTS.

-FLOOR STRUCTURE AS PER NOTE # 28.

25

DOUBLE MASONRY WYTHE WALL:

O.B.C. 9.20.8.2.

-3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER

-WYTHES TO BE TIED W/ METAL TIES INSTALLED AS PER O.B.C. 9.20.9.4.

-SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS

-6" SILL W/ 2" BEARING ON EACH SIDE & ANCHOR BOLTS @ 4'-0" O.C.

-NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY AREA.

25a

CORBEL MASONRY VENEER:

-MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.1.)

26

SILL PLATE

O.B.C. 9.23.7.

-2" X 4" (38mm x 89mm) PLATE

-1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FASTENED TO PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4" (100mm) INTO FOUNDATION WALL.

-SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1" (25mm) THICK BEFORE COMPRESSION, OR FOAM GASKET, OR PLACED ON FULL BED OF MORTAR.

27

BRIDGING & STRAPPING:

O.B.C. 9.23.9.4.

a) STRAPPING

-1" X 3" (19mmx 64mm) NAILED TO U/S OF JOISTS @ MAX. 6'-11" (2100mm) O.C.

-FASTENED TO SILL OR HEADER @ ENDS

b) BRIDGING

-1" X 3" (19mmx 64mm) OR 2" X 2" (38mmx 38mm) CROSS BRIDGING @ MAX. 6'-11" (2100mm) O.C.

c) BRIDGING & STRAPPING

-a) & b) USED TOGETHER OR

-1 1/2" (38mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH STRAPPING (a)

d) FURRING OR PANEL TYPE CEILING

-STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING FINISH IS ATTACHED DIRECTLY TO JOISTS.

28

FLOOR ASSEMBLY:

O.B.C. 9.23.14.3, 9.23.14.4

-5/8" (15.9mm) WATERBOARD (R-1 GRADE) OR EQUIVALENT

-FLOOR JOISTS AS PER FLOOR PLANS

29

PORCH SLABS ABOVE COLD CELLAR:

O.B.C. 9.39.1.4.

-REINFORCED CONCRETE SLABS ABOVE COLD CELLARS THAT ARE SUPPORTED ON FOUNDATION WALLS NOT TO EXCEED 8'-2"

-2"x4" WOOD PURLINS (CUT DIAGONALLY) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT

-REINFORCE WITH 10M BARS @ 7/8" (200mm) EACH WAY

-1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB

-3" (75mm) END BEARING ON FOUNDATION WALL

-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C.

30

EXTERIOR BALCONY ASSEMBLY:

-1 1/4" X 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING

-2"x4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8" (15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"x4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"x8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)

-EXTERIOR GUARD AS PER #36a

-SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER

REQUIRED FOR OVER HEATED SPACES:

-ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF CEILING AREA)

-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS

-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.

-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR

-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C.-1.9.29.5.3.)

30a

EXTERIOR FLAT ROOF ASSEMBLY:

-SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT

-INSTALLED PER MANUFACTURER'S SPECIFICATIONS.

-1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPERED PURLINS SLOPED MIN. 2% TO ROOF SCUPPER.

-3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON

-2"x8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)

REQUIRED FOR OVER HEATED SPACES:

-ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF CEILING AREA)

-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS

-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.

-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR

-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C.-1.9.29.5.3.)

31

ROOF ASSEMBLIES

TYPICAL ROOF:

O.B.C. 9.26.

-NO. 210 (80.5KG/m²) ASPHALT SHINGLES

-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.

-EAVES PROTECTION LAID BENEATH STAIRER STRIP.

-LEAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.

-STARTER STRIP AS PER O.B.C. 9.26.7.2.

-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)

-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS

-APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURER'S LAYOUT)

-TRUSS BRACING AS PER TRUSS MANUFACTURER

-EA VESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR ALUMINUM)

-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH .50% AT SOFFIT.

32

CEILING:

-R50 (RSI 8.8) INSULATION

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.

-1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR

-5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. 1.9.29.5.3.)

32a

VAULTED OR CATHEDRAL CEILING:

O.B.C. 9.26. & TABLE A4

-NO. 210 (80.5KG/m²) ASPHALT SHINGLES

-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.

-EAVES PROTECTION LAID BENEATH STAIRER STRIP.

-LEAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1.

-STARTER STRIP AS PER O.B.C. 9.26.7.2

-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)

-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS.

♦ CLIENT SPECIFIC REVISIONS

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD.** UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: 26-Jan-16
SIGNATURE:

client

location

Gold Park Homes

Brampton

project

marketing name

McLaughlin and Mayfield

The Bach

#

revisions

date

by arch

#

exchgs

date

dwn

chk

1

ISSUED FOR CLIENT REVIEW.

30/01/2016

5

2

ISSUED FOR PERMIT

26-Jan-16

16

3

4

PROFESSIONAL ENGINEER

100184942

FFR 17 2016

PROVINCE OF ONTARIO

-2"x8" (38mm x 184mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 13'-3" (4050mm) OR

-2"x10" (38mm x 235mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 17'-0" (5180mm)

-R31 (RSI 5.46) INSULATION

-MIN. 3" CLEARANCE FROM U/S OF ROOF SHEATHING TO INSULATION

-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C. 9.25.3. & 9.25.4.

-1/2" (12.7mm) GYPSUM BOARD

33

CONVENTIONAL FRAMING:

O.B.C. TABLE A6 OR A7

-2" X 6" (38mm X 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9" (3890mm)

-2"x4" (38mm x 89mm) COLLAR TIES AT MIDSPANS.

-CEILING JOISTS TO BE 2" X 6" (38mmx 140mm) @ 16" (400mm) O.C. UNLESS OTHERWISE NOTED.

-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON RAFTERS & MIN. 1 1/2" (38mm) THICK

34

ATTIC ACCESS HATCH:

O.B.C. 9.19.2.1.

-19 3/4" X 27 1/2" (500mm X 700mm) ATTIC HATCH WITH WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION.

35

GENERAL:

PRIVATE STAIRS:

O.B.C. 9.8.4.

-MAX. RISE = 7-7/8" (200mm)

-MIN. RUN = 8-1/4" (210mm)

-MIN. TREAD = 9-1/4" (235mm)

-MAX. NOSING = 1" (25mm)

-MIN. HEADROOM = 6'-5" (1950mm)

-MIN. WIDTH (BETWEEN WALL FACES) = 2'-10" (640mm)

-MIN. WIDTH = 2'-11" (900mm)

ANGLED TREADS:

-MIN. RUN = 5 7/8" (150mm)

-MIN. AVG. RUN = 7 7/8" (200mm)

-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS

-EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD & MAX. 7 7/8" (200mm) RISE

-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2

-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE

HANDRAILS:

O.B.C. 9.8.7

-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)

-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)

-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN DWELLING UNITS

-HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOORWAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION

36

HEIGHT:

O.B.C. 9.8.7.4

-2'-10" (665mm) MIN. TO 3'-2" (965mm) MAX.

-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS

-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

PROJECTIONS:

O.B.C. 9.8.7.6

-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

PUBLIC STAIRS:

O.B.C. 9.8.4.

-MAX. RISE = 7-3/32" (180mm)

-MIN. RUN = 11" (280mm)

-MIN. TREAD = 11" (280mm)

-MAX. NOSING = 1" (25mm)

-MIN. HEADROOM = 6'-9" (2050mm)

-MIN. WIDTH = 2'-11" (900mm)

EXIT STAIRS, BETWEEN GUARDS

-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS

-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2

-FIG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE

HANDRAILS:

O.B.C. 9.8.7

-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)

-TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3'-7" (1100mm)

-HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH

-HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT WHERE INTERRUPTED BY DOORWAYS OR NEWEL POSTS AT CHANGES IN DIRECTION

36a

HEIGHT:

O.B.C. 9.8.7.4

-2'-10" (665mm) MIN. TO 3'-2" (965mm) MAX.

-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS

-MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

PROJECTIONS:

O.B.C. 9.8.7.6

-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

TERMINATION:

O.B.C. 9.8.7.3

-ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4" (300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR AS

FINISH:

O.B.C. 9.8.9.6

-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE FROM DEFECTS PER OBC 9.8.9.6.14)

-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE VISUAL PATTERN TO DEMARCATE THE LEADING EDGE OF THE TREADS, LANDING AND THE BEGINNING AND END OF A RAMP.

36b

INTERIOR GUARDS:

O.B.C. SB-7 & 9.8.8.3.

-GUARDS TO BE 3'-6" (1070mm) HIGH

-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH

-INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS

-PICKETS TO HAVE 4" (100mm) MAX. SPACING

-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

EXTERIOR GUARDS:

O.B.C. SB-7 & 9.8.8.3.

-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN 23 5/8" (600mm).

-GUARDS TO BE 3'-6" (1070mm)

-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH

-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING SURFACE IS MORE THAN 5'-11" (1800mm) ABOVE ADJACENT GRADE

-PICKETS TO HAVE 4" (100mm) MAX. SPACING

-PROVIDE MID-SPAN POSTS AS PER SB-7

-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

RN design
Imagine • Inspire • Create

model	41-4
scale	3/16" = 1'0"
project #	13098

page

D2

File D:\design\project\0509-07\technical\Model\B1-FRM-4113028-1-FR-4-FINAL.dwg Printed: Jun 28, 2016 By: julio

360 EXTERIOR GUARDS @ JULIET BALCONY:

- FOR RAILING SPANNING MAXIMUM OF 6'-0".
- PROVIDE PREFIN. METAL RAILING W/ 76mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-2.8.8.5.
- GUARDS TO BE 3'-6" (1070mm)
- FOR DWELLING UNITS GUARDS TO BE 2'-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C. 9.8.8.2. OR
- FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C. 9.8.8.2.
- VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN. EMBEDMENT TO STUDS.
- PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.
- 37 -LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP
- 38 -WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR, O.B.C.- 9.32.1.3.(3)
- 39 -CAPPED DRYER VENT
- 40 -1"x2" (19mmX38mm) BOTH SIDES OF STEEL.
- 41 -WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE.
- 42 -PRECAST CONC. STEP
- 43 -2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND
- 44 SMOKE ALARM. O.B.C.- 9.10.19.
- PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
- PROVIDE 1 IN EACH BEDROOM
- INSTALL AT OR NEAR CEILING
- ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A VISUAL SIGNALING COMPONENT
- ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM
- 45 -CARBON MONOXIDE ALARM (CMA), O.B.C.- 9.33.4.
- WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.
- CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.
- 46 -MAIN DOOR TO BE OPERABLE FROM INSIDE W/O/UT KEY
- PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 140 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT.
- R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED
- 47 -GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.
- R4 (RSI 0.70)
- 48 -TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT:
- 1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY OR
- 2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (7.0m) ABOVE ADJACENT GROUND LEVEL.

49 EXTERIOR COLUMN W/ MASONRY PIER:

- MIN. 6"x6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.
- TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.
- 1-1/4" X 1-1/4" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP.
- REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
- SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4.
- 3/4" AIR SPACE AROUND POST.
- OR
- MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
- 1-1/4" X 1-1/4" MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.
- REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
- NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.

490 EXTERIOR COLUMN:

- MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE
- NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.

50 COLD CELLARS:

- FOR COLD CELLARS PROVIDE THE FOLLOWING:
- VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.
- COVER VENT W/ BUG SCREEN
- WALL MOUNTED LIGHT FIXTURE
- 1-1/4" FOR DOOR OPENING
- 2'-8" X 6'-8" EXTERIOR TYPE DOOR (MIN.R-4 (RSI 0.7)
- INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)

51 STUD WALL REINFORCEMENT:

- O.B.C. 9.5.2.3.
- WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH-TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)(c)&(c) & 3.8.3.13.(2)(f) & 3.8.3.13.(4)(c)
- GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)

FRAME CONSTRUCTION:

- ALL FRAMING LUMBER TO BE No.1 AND No.2 SPF UNLESS NOTED OTHERWISE.
- ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN LOADS.
- JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING
- BEAMS TO HAVE MIN. 3'-1/2" (89mm) END BEARING
- DOUBLE STUDS @ OPENINGS
- DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mm)
- DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm)
- DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS
- BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE PARALLEL TO FLOOR JOISTS


- BEAMS MAY BE A MAX. 2-1/2" (60mm) FROM LOADBEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS
- APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS
- FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X 184mm)
- FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 233mm) OR LARGER.

WINDOWS:

- WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER
- WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 1.8 W/(m2.K) OR
- AN ENERGY RATING OF NOT LESS THAN 21 FOR OPERABLE WINDOWS & 31 FOR FIXED WINDOWS
- BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING
- SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 2.8 W/(m2.K)
- FOR GROSS GLAZED AREAS LESS THAN 17%

ADDITIONAL COMPLIANCE ALTERNATIVES FOR PACKAGE 1.

- THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED; THAT THE WINDOWS AND SLIDING GLASS DOORS HAVE A MAXIMUM U-VALUE OF 1.6, OR THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A MINIMUM R20 (RSI 3.52);
- OR
- WHERE BLOW-IN INSULATION OR SPRAY-APPLIED FOAM INSULATION IS USED, THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT:
- a) THE THERMAL INSULATION VALUE IN A CEILING WITH AN ATTIC SPACE IS NOT LESS THAN R60 (RSI 10.55),
- b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 PERCENTAGE POINTS,
- c) THE MINIMUM AFUE OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS,
- d) THE MINIMUM EF OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY NOT LESS THAN 4 PERCENTAGE POINTS.

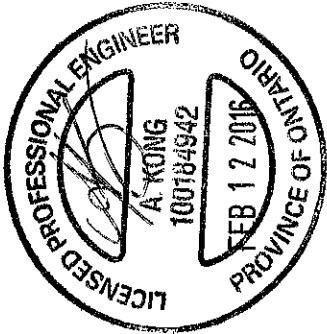

FOR STRUCTURAL ONLY

CLIENT SPECIFIC REVISIONS

DOORS

- A 845x2030x45 (27"Ox68"x1-3/4")
- B 815x2030x35 (26"x68"x1-3/8")
- C 760x2030x35 (26"x68"x1-3/8")
- D 710x2030x35 (24"x68"x1-3/8")
- E 460x2030x35 (16"x68"x1-3/8")
- F 610x2030x35 (20"x68"x1-3/8")
- G OVER SIZED EXTERIOR DOOR

STEEL BEAMS

- ST1 W 6 X 15
- ST2 W 6 X 20
- ST3 W 8 X 18
- ST4 W 8 X 21
- ST5 W 8 X 24

SCHEDULES

- WOOD BEAMS
- WD9 5/2" X 12" SPR
- WD10 2/1 3/4" X7 1/4" (2.0E) LVL
- WD11 3/1 3/4" X7 1/4" (2.0E) LVL
- WD12 2/1 3/4" X9 1/2" (2.0E) LVL
- WD13 3/1 3/4" X9 1/2" (2.0E) LVL
- WD14 2/1 3/4" X11 7/8" (2.0E) LVL
- WD15 3/1 3/4" X11 7/8" (2.0E) LVL
- WD1 3/2" X 8" SPR
- WD2 4/2" X 8" SPR
- WD3 5/2" X 8" SPR
- WD4 3/2" X 10" SPR
- WD5 4/2" X 10" SPR
- WD6 5/2" X 10" SPR
- WD7 3/2" X 12" SPR
- WD8 4/2" X 12" SPR

LINTELS

- L10 4-7/8" X 3-1/2" X 5/16" L
- L11 4-7/8" X 3-1/2" X 3/8" L
- L12 4-7/8" X 3-1/2" X 1/2" L
- L13 5-7/8" X 3-1/2" X 3/8" L
- L14 5-7/8" X 3-1/2" X 1/2" L
- L15 5-7/8" X 4" X 1/2" L
- L16 7-1/8" X 4" X 3/8" L
- L17 7-1/8" X 4" X 1/2" L

SMOKE ALARM

- WATERPROOF DUPLEX OUTLET
- VENTS AND INTAKES
- HOSE BIB
- EXHAUST FAN
- COLD CELLAR VENT
- STOVE VENT
- FIRE PLACE VENT
- DRYER VENT

PLAN/ELEVATION LEGEND

- CARBON MONOXIDE ALARM (CMA)
- D.J. DOUBLE JOIST
- P.T. PRESSURE TREATED LUMBER
- G.T. GIRDER TRUSS
- A.F.F. ABOVE FINISHED FLOOR
- EXT. LIGHT FIXTURE (WALL MOUNTED)
- HYDRO METER
- GAS METER
- FLOOR DRAIN
- SOLID BEARING TO BE SAME WIDTH AS SUPPORTED MEMBER
- POINT LOAD
- FLAT ARCH
- 2 STORY WALL
- U/S UNDER SIDE
- FG FIXED GLAZING
- GB GLASS BLOCK
- BG BLACK GLASS

I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38488
FIRM BCIN: 26975
DATE: 26-Jan-16

SIGNATURE:

location

Gold Park Homes

project

Mclaughlin and Mayfield

Brampton

marking name

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW.	30/01/2015	REM	RPA	5				
2	ISSUED FOR PERMIT	26-Jan-16	Hz	Jp	6				
3					7				
4					8				


model

41-4

scale
3/16" = 1'0"

FN design

Imagine • Inspire • Create



page

D3