FOOTINGS / SLABS: TYPICAL STRIP FOOTING:

O.B.C. 9.15.3. -BASED ON 16'-1"(4.9m) MAX, SUPPORTED JOIST LENGTH MIN. 22009si (15MPa) CONCRETE AFTER 28 DAYS
SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL
W/ MIN. 10.9psi (75KPa) BEARING CAPACITY
ETC. TO LANG CONTINUES FOR FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY

(AS PER SOILS ENGINEERING REPORT) TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

O.B.C. 9 15 3 5

O.B.C. 9.15.3.5. FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE BRICK VENEER -I STOREY - 13" X 4" (330mm X 100mm) -2 STOREY - 19" X 6" (485mm X 155mm) -3 STOREY - 26" X 9" (660mm X 230mm) -1 STOREY - 10" X 4" (255mm X 100mm) -2 STOREY - 14" X 4" (360mm X 100mm) -3 STOREY - 18" X 5" (460mm X 130mm)

2 TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

-1 STOREY MASONRY -16" X 4" | (410mm X 100mm) | -1 STOREY STUD -12" X 4" | (450mm X 100mm) | -1 2 STOREY MASONRY -26" X 9" | (450mm X 230mm) | -1 2 STOREY MASONRY -36" X 14" | (450mm X 130mm) | -1 2 STOREY STUD -24" X 8" | (450mm X 200mm) | -1 2 STOREY STUD |

3 STEP FOOTING: O.B.C. 9.15.3.9. -23 5/8" (600mm) MAX. VERTICAL RISE & 23 5/8" (600mm) MIN. HORIZONTAL

4 DRAINAGE TILE OR PIPE:

O.B.C. 9.14.3.

-4" (100mm) MIN. DIA. LAID ON UNDISTURBED OR WELL COMPACTED SOIL
W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FLR. SLAB.
-COVER TOP & SIDES OF TILE OR PIPE W/ 5.7/8" (150mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL

5 BASEMENT SLAB: O.B.C. 9.13. & 9.16.

-3" (75mm) CONCRETE SLAB 2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5. -ZZUDBI (TSMP) AFTER ZO DATS - U.S.C. ; 7.16.4.5;

-DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR

TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.

-DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa)

COMPRESSIVE STRENGFIN AFTER ZO DAYS

-4" (100mm) OF COURSE GRANULAR MATERIAL

-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.

WHESPE SLAB IS PECHIEDED TO BE WASTERDROCESED IT. SMALL CONFERNATION. WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO

FLOOR DRAIN PER O.B.C.9.31.4.4. -R10 (RS1 1.74) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. SB-12-

UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY

TANDARD (O.B.C. SB-9) 5a SLAB ON GROUND:

3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3. -3 (73111) CONCRETS LAB - 0.B.C. 7.16.4.5.
-2200psi (15MPa) AFTER 28 DAYS - 0.B.C. 9.16.4.5.
-DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR
TYPE "S" ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS -R10 (RSI 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE. 4"(100mm) OF COURSE GRANULAR MATERIAL
PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO

FLOOR DRAIN PER O.B.C.9.31.4.4. UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFIRM TO SUPPLEMENTARY STANDARD (O.B.C. SB-9)

6 GARAGE SLAB / EXTERIOR SLAB: -4"(100mm) CONCRETE SLAB

-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.6 6" X 6" (W2.9 X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB 4" (100mm) OF COURSE GRANULAR MATERIAL
-ANY FILL PLACED UNDER SLAB , OTHER THAN COURSE CLEAN GRANULAR
MATERIAL, SHALL BE COMPACTED.

7 PILASTERS: O.B.C. 9.15.5.3.

PILASTER
-CONCRETE NIB - 4" X 12" (100mm X 300mm)
-BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS
PER O.B.C. 9.20.11.2. TOP 7 7/8" (200mm) SOLID.

BEAM POCKET -4" (100mm) INTO FDN. WALL W/ WIDTH TO MATCH BEAM SIZE. -1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.

-SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4kPa).

8 STEEL PIPE COLUMN: O.B.C. 9.15.3.4. & 9.17.3.

-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS -FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mmX 100mm) 6.35mm) STEEL BTM. PLATE FOR WOOD BEAMS, MIN. 4"X4"X1/4" (100mmX 100mm X 6.35mm) STEEL TOP *BIM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH A 8.33/INITY 31E1

**BIM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM

**ADJUSTABLE COLUMNS TO CONFORM TO CANI/CGSB-7.2-M WHERE
IMPOSED LOAD DOES NOT EXCEED 36 KN (O.B.C. 9.17.3.4.)

COL. SPACING: -MAX. 9'-10" (2997mm) - 34" X 34" X 16" X 860mmX 400mm -MAX. 16'-0" (4880mm - 44" X 44" X 21"

- 40" X 40" X 19" -MAX. 9'-10" (2997mm) mmX 1010mmX 480mm) - (1010mmX 1010 - 51" X 51" X 24" -MAX. 16'-0" (4880mm) -WHERE COL. SITS ON FDN. WALL, USE 4" X 8" X 5/8" (100mmX 200mmX 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

9 WOOD COLUMN: O.B.C. 9.17.4.1. -5 1/2" X 5 1/2" (140mm X 140mm) SOLID WOOD COLUMN. METAL SHOE ANCHORED TO FOOTING

25" X 25" X 12" (640mmX 640mmX 300mm) CONC. PAD (1 FLOOR SUPPORTED W/ 9'-10" COL. SPACING)
34" X 34" X 14" (860mmX 860mmX 360mm) CONC. PAD (2 FLOORS
SUPPORTED W/ 9'-10" COL. SPACING) (10) BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)

-2"X8"X12" LEDGER BOARD FASTENED W/ 2/ 1/2" ANCHOR BOLTS @ 4" O.C WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 1 WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE 11 BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM)

12"X11"X 5/8" STL, PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2- 1/2"Ø x8" ANCHOR BOLTS. WALL ASSEMBLIES:

14 FOUNDATION WALL: O.B.C. 9.15.4.2.

-FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN LATERALLY SUPPORTED -Max. UnSupported Height of 3'-11" (1200mm) & Max. Supported Height of 3'-11" (1200mm) & Max. Supported Height of 5'-11" (1200mm) & Max. Supported Height of 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR. FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATERALLY SUPPORTED

-10" (250mm) SOLID 2200psi (15MPa) CONCRETE MAX, UNSUPPORTED HEIGHT OF 4'-7" (1400mm) & MAX, SUPPORTED HEIGH OF 8'-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR OF 8'-6' (ZOUMMIN MEASURED FROM GIADE TO FINISHED BASEMENT F LATERAL SUPPORT PROVIDED BY ANCHORED SILI PLATE TO JOISTS.
-FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C.-12', 15.4.1 SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C.- PART 4
-WALL SHALL EXTEND A MIN. 5.7/8" (150mm) ABOVE GRADE INSULATE W/R12 (RSI 2.11) FROM UNDERSIDE OF SUBFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1, O.B.C. T.2.1.1.2.A.)

-BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL

REDUCTION OF THICKNESS:

O.B.C. 9.15.4.7. -WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS HAN 3-1/2" (90mm) THICK THE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7 7/8" (200mm)
VERTICALLY O.C. & 2'-11" (900mm) HORIZONTALLY.
-FILL SPACE BETWEEN WALL AND FACING SOLID W/MORTAR WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK

DAMPPROOFING & WATERPROOFING:

DAMPPROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 7-13-2. - WHERE INSULATION EXTENDS TO MORE THAN 4"-9" (1450mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.(2) (3) (4) FINISHED BASEMENTS SHALL HAVE INTERIOR DAMPPROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3.(3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE
WATERPROPED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROPED DO NOT REQUIRE DAMPPROPING.

140 FOUNDATION WALLS @ UNSUPPORTED OPENINGS: -2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING) -3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING -4-20M BARS IN TOP PORTION OF WALL (10"-0" TO 15"-0" OPENING)
-BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL.

-BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER -BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING. (15) FRAME WALL CONSTRUCTION:

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED SIDING OK STUCCO AS PER ELEVATIONS, MIN. 7 7/8 (2001111) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)

-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (Amm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
-2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C. MIN, R22 (RSI 3.87) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A.) -CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4. -1/2" (12.7mm) GYPSUM BOARD

NOTE - SUPPORT FOR 3 FLOORS ABOVE - 0.B.C. T.9.23.10.1. =

-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:

-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE
INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.

-REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): -REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND -NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO

VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV. 150 ALTERNATE FRAME WALL CONSTRUCTION:

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/TAPED JOINTS (O.B.C. -87.27.3.4.)
-8RACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mmX 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO 8TM. PLATE FOR FULL LENGTH OF WALL.

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. -2. A 4 (SOMMAS ATMIN) WOOD STODS @ 16 (400min) O.C. @ 12 (SOOMIN) O.C. ON BOTTOM FLR. WHEN 3 STOREYS.
-R14 (RS12.46) INSULATION (ZONE 1. O.B.C. T.2.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. &

-1/2" (12.7mm) GYPSUM BOARD. NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O B C T 9 23 10 1 = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (390mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

ORC SR-3 WALL = EWILL (STC = N/A FIRE = 45 MINI) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:

-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.

-2.23 1.6. BETWEEN RIGID INSULATION AND WOOD STUD.

-REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/sq.m.
-REPLACE 1/2"(12.7mm) GYPSUM BD. W/1/2" (12.7mm) TYPE 'X' GYPSUM BD. REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

-REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:

-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID

(15b) FRAME WALL CONSTRUCTION @ GARAGE:

-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)

-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.

-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. -2 X4 (38mmx 87mm) WOOD SIUDS © 16 (400mm) O.C. -1/2" [12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C., 1.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED © 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE

REQUIRED TO BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 Min) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD

THE FOLLOWING MATERIALS:

-ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.

-REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE "X" GYPSUM BD. REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

-REFER TO REQUIREMENTS FOR LESS THAN 4"-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS) /INYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5./31. OVER SHEATHING

(16) BRICK VENEER CONSTRUCTION:

 \sim 1.20. 7.20. And \sim 1.20 (11m) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. HEIGHT -MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING -PROVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ 8TM. COURSE & OVER -BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING

MEMBRANE (O.B.C. 9.20.13.6.(2))
-BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER -1" (25mm) AIR SPACE -WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. 2 A 0 GOTTHIA 140THIN) WOOD STODS & 16 (400MM) O.C. MIN. R22 (RSI 3.87) INSULATION (200E 1. O.B.C. T. 21.1.2.A.) CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3.

1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTÉ AND/OR ADD THE FOLLOWING MATERIALS:

-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE
INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.

-REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

ALTERNATE BRICK VENEER CONSTRUCTION:

-1/2" (12.7mm) GYPSUM BOARD

O.B.C. 9.23. -3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. -MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS ® MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL -PROVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ BTM. COURSE & OVER BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE -BASE FLASHING OF TO \$7/8 (TSUITIN) BEHIND WALL SPEATHING MEMBER (O.B.C., 20.13.6.(2))

-BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
-1" (25mm) AIR SPACE
-1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/TAPED JOINTS (O.B.C. -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS -BRACE W/ CONT. 16 GAUGE STEEL 'T' BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mmX 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL -R14 (RSI 2.46) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. &

NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE. 2" X 4" (38mmX 89mm) STUDS ARE

REQUIRED TO BE SPACED @ 12" (300mm) O.C.

-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) -REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
-REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

16b BRICK VENEER CONSTRUCTION @ GARAGE:

O.B.C. 9.23. -3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. -MIN, 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ BTM, COURSE & OVER OPENINGS -BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2)) -BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER " (25mm) AIR SPACE I (ZOTIM) AIK SPACE WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2. 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. -1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - 0.8.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD ADD R15 (RSI 2.64) ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ EPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

17 INTERIOR STUD WALLS: O.B.C. T.9.23.10.1 -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/ -DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE -1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

18 BEARING STUD WALL (BASEMENT): 2" X 4" (38mmX 89mm) ∜700D STUDS @ 16" (400mm) O.C. OR -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/

- DBL. 2" X 4" OR 2" X 6" TOP PLATE. - 2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPPROOFING MATERIAL. 2 A 4 OR 2 A 6 SOTIOM THATE ON DAMP ROUTING MATE 1/2" (12.7mm) GYPSUM BOARD BOTH SIDES. 1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FOOTING AS PER GENERAL NOTE #2 W/4" CONC. CURB PARTY WALL - BLOCK:

O.B.C. SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS

TO THE U/S OF ROOF DECK SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/ MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO PREVEN SMOKE PASSAGE SMUNE PASSAGE -1/2" (12,7mm) GYPSUM BOARD W/TAPED JOINTS BOTH SIDES -2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH -ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE 7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)

-STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER O.B.C. 9.10.9.9.(1) & TABLE 2.1.1. SB-2 -ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1) 190 PARTY WALL - BLOCK (AGAINST GARAGE): O.B.C. SB-3 WALL = B5c (STC = 51, FIRE = 2 HR) -MIN. 1HR FIRE-RESISTANCE RATING CONTINUOU -CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. 2" X 4" (38mmX 89mm) WOOD STRAPPING @ 16" (400mm) O.C. -R20 (RSI 3.52) RIGID INSULATION -7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE) 1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN

HOUSE AND GARAGE TAPE AND SEAL ALL JOINTS GAS TIGHT REQ. INSULATION VALUES: INSULATION VALUES PROVIDED BY CAN/CSA-F280-M90 -RIGID INSULATION LOW DENSITY CONCRETE BLOCK = 1.70

-AIR FILM - STILL TOTAL "R" VALUE

(9b) FIREWALL:
O.B.C. 9.10.11. & 3.1.10. & SB-3. WALL = B6e (STC = S7. FIRE = 2 HR) ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING AREA, O.B.C. T.3.2.2.47. 1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS 2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES OF WALL SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY -7 1/2" (190mm) CONC. BLOCK, MIN. 2 HR. FIRE-RESISTANT RATING -EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS STAGGER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER O.B.C. 9.10.9.9.(1) & TABLE 2.1.1 SB-2 O.B.C., Y1.07.97.1) & TABLE 21.158-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
-PROTRUDE PAST FASCIA @ EAVES W, BRICK CORBELLING
-EXTEND 5.78" (150mm) ABOVE ROOF SURFACES, & HAVE ALUMINUM CAP W/
THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.[1] WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER (HAN 9'10" (3m), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER

O.B.C. 3.1.10.4.(2)

(20) PARTY WALL - FOUNDATION:
O.B.C. 9.15.4.2.
-7 7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa)
COMPRESSIVE STRENGTH AFTER 28 DAYS
-FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2

(21) PARTY WALL - WOOD STUD:
O.B.C. SB-3 WALL = W13a (STC = 57, FIRE = 1 HR)
-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK
-2 ROWS 2"X4"(38mmX 89mm) STUDS @ 16"(400mm) O.C. W/ SEPARATE 2" X 4" (38mmX 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4" 2-X-4 (361111M) BOTTOM PLATE & SEPARATE DOUBLE 2-X-4 (381111MX BYMM) TOP PLATES -SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF -5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED &

NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1,9.23,10,1, =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE QUIRED TO BE SPACED @ 12" (300mm) O.C. GARAGE WALL & CEILING:

O.B.C. 9.10.9.16.(3) $\,$ –1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING BETWEEN HOUSE AND GARAGE TAPE AND SEAL ALL JOINTS GAS TIGHT -R22 (RSL3 87) INSULATION IN WALLS 31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.-

-CONTINUOUS SALE, FOR FLOOR ABOVE.

9.25.3. & 9.25.4. FOR FLOOR ABOVE.

INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN.

REQUIRED GARAGE AREA (REFER TO MUNICIPAL STANDARDS).

-1/2" (12.7mm) GYPSUM BOARD

ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH 4 - 3 1/4" (82mm) TOE NAILS -BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7 7/8" (200mm) O.C

WALLS ADJACENT TO ATTIC SPACE: -1/2" (12.7mm) GYPSUM BOARD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.-9.25.3. & 9.25.4. 2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. -R22 (RSL3.87) INSULATION -RZZ (RST.367) INDUCTION
-RZZ (RST.367) INDUCT

23) DOUBLE VOLUME WALLS: O.B.C. 9.23.10.1.

-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING
REFER TO PLAN FOR STUD SPECIFICATION
-STUDS FASTENED AT TOP & BOTTOM WITH 3/ 3-1/4" (82mm) TOE NAILS -DOUBLE TOP PLATES FASTENED TOGETHER WITH 3" (76mm) AT -SOLID 8RIDGING AT 3'-11" (1200mm) O.C

24 EXPOSED FLOOR: OOR AS PER NOTE # 28 CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/
O.B.C.- 9.25.3. & 9.25.4.
-R31 (RSI 5.46) INSULATION

240 SUNKEN FINISHED AREAS: USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION ALLS INSTEAD OF USING BEARING POSTS FLOOR STRUCTURE AS PER NOTE # 28.

25 DOUBLE MASONRY WYTHE WALL:

-3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER -NYTHES TO BETIED W/ METAL TIES INSTALLED AS PER O.B.C. 9, 20, 9, 4.
SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS
-4" SILL W/ "BEARING ON FACH SIDE & ANCHOR BOLTS @ "A"O" O.C.
NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY

250 CORBEL MASONRY VENEER: -MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1)

FLOOR ASSEMBLIES: 26 SILL PLATE:

O.B.C. 9.23.7. -2" X 4" (38mm X 89mm) PLATE -2. A.4. [JOSTHITH A SYMINITY FLAID.]

-1/2" [12.7mm] DIA. ANCHOR BOLTS @ 7"-10" (2400mm) O.C. FASTENED TO PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4" ([JOD0mm]) NTO FOUNDATION WALL.

-SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1" (25mm) THICK BEFORE COMPRESSING, OR FOAM GASKET, OR PLACED ON FULL BED OF MORTAR.

27) BRIDGING & STRAPPING: O.B.C. 9.23.9.4.

-1" X 3" (19mmX 64mm) NAILED TO U/S OF JOISTS @ MAX. 6'-11" (2100mm) O.C. ENED TO SILL OR HEADER @ ENDS 5) BRIDGING -1" X 3" (19mmX 64mm) OR 2" X 2" (38mmX 38mm) CROSS BRIDGING @ MAX.

6'-11" (2100mm) O.C. c) BRIDGING & STRAPPING a) & b) USED TOGETHER OF -1 1/2" (38mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH STRAPPING (a) THE PARTY OF PARTY TYPE CELLING STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING FINISH IS ATTACHED DIRECTLY TO JOISTS.

28 FLOOR ASSEMBLY: O.B.C. 9.23.14.3, 9.23.14.4 -5/8" (15.9mm) WAFERBOARD (R-1 GRADE) OR EQUIVALENT -FLOOR JOISTS AS PER FLOOR PLANS

29 PORCH SLABS ABOVE COLD CELLAR:

O.B.C. 9.39.1.4.

-REINFORCED CONCRETE SLABS ABOVE COLD CELLARS THAT ARE SUPPORTED ON FOUNDATION WALLS NOT TO EXCEED 8'-2"

-47/8" [125mm] 4650 psi [32 MPa] CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT -REINFORCE WITH 10M BARS @ 7 7/8" (200mm) EACH WAY -1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB -3" (75mm) END BEARING ON FOUNDATION WALL

-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C. (30) EXTERIOR BALCONY ASSEMBLY:
-1 1/4" X 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING
-2"X4" WOOD PURIUNS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED
ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8" (15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"X4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"X8" ROOF JOISTS @ 12" O.C. OR AS NOTED ON PLAN

(OR AS NOTED ON PLAN)
- EXTERIOR GUARD AS PER #36a
- SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER
REQUIRED FOR OVER HEATED SPACES:
-ADD 2"X2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR
VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF

-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS 4 Y.25.4.

-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (0.8.C.-T.9.29.5.3.)

STERIOR FLAT ROOF ASSEMBLY:
SINGLE PLY WATEPPPOOF DOOS ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.

SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT INSTALLED PER MANUFACTURER'S SPECIFICATIONS. -1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPERED PURLINS -1/4 EXTERIOR GRADE WOOD PARKET IT BINDERENT THE SLOPED MIN. 2% TO ROOF SCUPPER. -3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON -2"X8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)

REQUIRED FOR OVER HEATED SPACES: -ADD 2'X2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS JOBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF CULLING AREA)
-ADD R31 (881,5.46) INSULATION BETWEEN JOISTS
-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.

-ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.)

ROOF ASSEMBLIES (31) TYPICAL ROOF:

O.B.C. 9.26.
-NO. 210 (30, 5KG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO
EXTEND UP THE ROOF SLOPE MIN. 2-11" (900mm) FROM EDGE TO A LINE NOT
LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL. EAVES PROTECTION LAID BENEATH STARTER STRIP -EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP AS PER O.B.C. 9.26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS

APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURER'S TRUSS BRACING AS PER TRUSS MANUFACTURER -EAVESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR ALUMINUM)
-ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT.

32 CEILING: -R50 (RSL8.8) INSULATION CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.

6 7.23-4. -1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.) O.B.C. 9.26. & TABLE A4

O.B.C. 9.26. & TABLE A4
-NO. 210 [30. 5KG/m2] ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO -FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2:-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAID BENEATH STARTER STRIP.
-EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9:26.5.1.
-STARTER STRIP AS PER O.B.C. 9:26.7.2.
-STARTER STRIP NOT REQUIRED AS PER O.B.C. 9:26.7.2.(3)
-3/8" (10mm) PLYWOOD SHEATHING OR OSB (0:2 GRADE) WITH "H" CLIPS.
-2'x8" (38mm x 184mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS.
PURLINS @ 24" O.C. MAX. SPAN 13:3" (4050mm) OR PURLINS @ 24" O.C. MAX. SPAN 13'-3" (4050mm) OR -2"x10" (38mm x 235mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 17'-0" (5180mm)

-R31 (R315.46) INSULATION U/S OF ROOF SHEATHING TO INSULATION
-MIN. 3" CLEARANCE FROM U/S OF ROOF SHEATHING TO INSULATION
-ODNITIOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH
O.B.C. 9.25.3. & 9.25.4. 1/2" (12.7mm) GYPSUM BOARD

CONVENTIONAL FRAMING:

RAFTERS & MIN. 1 1/2" (38mm) THICK

Smoke alarm 🐠

WATERPROO

HOSE BIB

EXHAUST FAN

FIRE PLACE VENT

DOUBLE JOIST

A.F.F. ABOVE FINISHED FLOOR

LUMBER

G.T. GIRDER TRUSS

PRESSURE TREATED

3-1/2" X 3-1/2" X 1/4" L L13 5-7/8" X 3-1/2" X 3/8" L

LINTELS

L14 5-7/8" X 3-1/2" X 1/2" L

D.J.

2/ 2" X 10" SPR

4" X 3-1/2" X 1/4" L

DUPLEX OUTLET

VENTS AND INTAKES

COLD CELLAR VENT (50)

LEGEND

O.B.C. TABLE A6 OR A7 -2" X 6" (38mm X 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9" (3890mm) -2"X4" (38mm X 89mm) COLLAR TIES AT MIDSPANS -CEILING JOISTS TO BE 2" X 6" (38mmX 140mm) @ 16" (400mm) O.C. HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON

<u>DOORS</u> CARBON MONOXIDE 4 865x2030x45 (2'10''x6'8''x1-3/4 B 815x2030x35 (2'8"x6'8"x1-3/8") 760x2030x35 (2'6"x6'8"x1-3/8" D 710x2030x35 (2'4'x6'8''x1-3/8") E 460x2030x35 (1'6"x6'8"x1-3/8") F 610x2030x35 (2'0'x6'8'x1-3/8") G OVER SIZED EXTERIOR DOO STEEL BEAMS ST1 W 6 X 15

WD14 2/13/4" X117/8" (2.0E) LV

WD15 3/1 3/4" X11 7/8" (2.0E) LV

ALARM (CMA) (45) EXT. LIGHT FIXTURE (WALL MOUNTED) **(H)** HYDRO METER **(G**) GAS METER FLOOR DRAIN ST2 W 6 X 20 ST3 W 8 X 18 SOLID BEARING ST4 W 8 X 21 ST5 W 8 X 24 POINT LOAD WOOD BEAMS FLAT ARCH VD1 3/2" X 8" SPR WD2 4/2" X 8" SPR 2 STORY WALL WD3 5/2" X 8" SPR U/S UNDER SIDE WD4 3/2" X 10" SPR WD5 4/ 2" X 10" SPR FG FIXED GLAZING WD6 5/ 2" X 10" SPR GB GLASS BLOCK WD7 3/2" X 12" SPR BG BLACK GLASS WD8 4/2" X 12" SPR WD9 5/2" X 12" SPR WD10 2/1 3/4" X7 1/4" (2.0E) LVL L10 4-7/8" X 3-1/2" X 5/16" L L15 5-7/8" X 4" X 1/2" WD11 3/13/4" X7 1/4" (2.0E) LVL L11 4-7/8" X 3-1/2" X 3/8" L L16 7-1/8" X 4" X 3/8" L WD12 2/1 3/4" X9 1/2" (2.0E) LVL

L12 4-7/8" X 3-1/2" X 1/2" L L17 7-1/8" X 4" X 1/2" L WD13 3/1 3/4" X9 1/2" (2.0E) LVL

34 ATTIC ACCESS HATCH: -19 3/4" X 27 1/2" (500mm X 700mm) ATTIC HATCH WITH PING & BACKED W/ R20 (RSI 3.52) INSULATION.

35 PRIVATE STAIRS:

O.B.C. 9.8.4.

-MIN. RUN = 5.7/8" (150mm)
-MIN. AVG. RUN = 7.7/8" (200mm)
-HIN. AVG. RUN = 7.7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9.1/4" (235mm) TREAD & MAX. 7 7/8" (200mm) RISE -FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2 -FTG, FOR FOUND, WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE

HANDRAILS: O.B.C. 9.8.7 -ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm) -TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-7" (1 100mm -ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN -HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION

HEIGHT: O.B.C. 9.8.7.4

- 2'-10" (865mm) MIN. TO 3'-2" (965mm) MAX. - 3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS -MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

PROJECTIONS:

O.B.C. 9.8.7.6

-HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP
STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

350 PUBLIC STAIRS:

O.B.C. 9.8.4. -MAX. RISE -MIN. RUN -MIN. TREAD = 7-3/32" (180mm = 11" (280mm = 11" (280mm = 1" (25mm) (280mm) (280mm) -MAX. NOSING (25mm) (2050mm) -MIN. HEADROOM = 6'-9" -MIN. WIDTH = 2'-11" (900mm)

(EXIT STAIRS, BETWEEN GUARDS)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2 FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE

HANDRAIL\$: O.B.C. 7.8.7

ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm) TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-'7" (1100mm) TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT ERE INTERRUPTED BY DOOR WAYS OR NEWEL POSTS AT CHANGES IN

- 2'-10" (865mm) MIN. TO 3'-2" (965mm) MAX. - 3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS) MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

PROJECTIONS: O.B.C. 9.8.7.6 - HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED

O.B.C. 9.8.7.3 - ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4" (300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR AS

O.B.C. 9.8.9.6 O.B.C. 9.8.9.6

-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE FROM DEFECTS PER OBC 9.8.9.6.(4)

-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE VISUAL PATTERN TO DEMARCATE THE LEADING EDGE OF THE TREADS, LANDING AND THE BEGINNING AND END OF A RAMP.

36 INTERIOR GUARDS: O.B.C. \$8-7 & 9.8.8.3.

-GUARDS TO BE 3'-6" (1070mm) HIGH -FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDING -PICKETS TO HAVE 4" (100mm) MAX. SPACING -GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

360 EXTERIOR GUARDS:

O.B.C. SB-7 & 9.8.8.3. -GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN -GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN 23 5/8" (600mm).

-GUARDS TO BE 3"-6" (1070mm).

-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2"-11" (900mm) HIGH FOR DWELLING UNITS GUARDS TO BE 3"-6" (1070mm) HIGH WHERE WALKING SURFACE IS MORE THAN 5"-11" (1800mm) ABOVE ADJACENT GRADE.

-PICKETS TO HAVE 4" (100mm) MAX. SPACING.

-PROVIDE MID-SPAN POSTS AS PER 58-7.

-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2"-11" (900mm) HIGH

(36b) EXTERIOR GUARDS ® JULIET BALCONY:

-FOR RAILING SPANNING MAXIMUM OF 6'-0".

-PROVIDE PREFIN. METAL RAILING W/ 76mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.8.8.5. -GUARDS TO BE 3'-6" (1070mm) -FOR DWELLING UNITS GUARDS TO BE 2'-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C. GRADE DIFFERENCE IS LESS HAN 5-11 [1800mm] AS PER O.B.C.
9.8.8.2. OR
-FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO
GRADE DIFFERENCE IS 5'-11" [1800mm] OR GREATER AS PER O.B.C. 9.8.8.2.
-VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN.

PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION 37 -LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP

-WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR, O.B.C.- 9.32.1.3.(3)

(39) -CAPPED DRYER VENT

40 -1"X2" (19mmX38mm) BOTH SIDES OF STEEL. -WOOD ERAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT -WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT
WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM

-PRECAST CONC. STEP
-2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND

Areas:

ELEVATION 'B' WCE OF ON SM SF SM GROUND FLOOR PLAN 706.1 65.6 706.1 65.6 MAIN FLOOR PLAN 1224.5 113.8 1224.5 113.8 SECOND FLOOR PLAN 1220.1 113.3 1220.1 113.3 SECOND FLOOR PLAN OTB (4.2)(0.4)(4.2)(0.4)TOTAL AREA (0) 3146.5 292.3 3146.5 292.3 OPT, GROUND FLOOR PLAN 706.1 706.1 65.6 65.6 OPT, MAIN FLOOR PLAN (1) 1224.5 113.8 1224.5 113.8 OPT, SECOND FLOOR PLAN (1) 1220.1 113.3 1220.1 113.3 OPT. SECOND FLOOR PLAN (4.2)(0.4)(4.2)(0.4)**TOTAL AREA (1)** 3146.5 292.3 3146.5 292.3 COVERAGE INC PORCH 1267.0 117.7 1267.0 117.7 COVERAGE NOT INC PORCH 1224.5 113.8 1224.5 113.8

100184942

MAR 0 4 2016

\$MOKE ALARM, O.B.C.-9.10.19.
-PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
-PROVIDE 1 IN EACH BEDROOM -PROVIDE 1 IN EACH HALLWAY SERVICING BEDROOMS - INSTALLED AT OR NEAR CEILING - INSTALLED AT OR NEAR CEILING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL
ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A
VISUAL SIGNALLING COMPONENT
-ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE
THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM

(CMA), O.B.C.-9.33.4. -WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA. -CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN

46) -MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY -PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT. -R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED

-GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.
-R4 (RS10.70) 48) -TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT;

1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY
OR
2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN

UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21-5/8" (550mm) IN WIDTH: SUCH WINDOW SHALL BE LOCATED SC THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (7.0m) ABOVE ADJACENT GROUND LEVEL

EXTERIOR COLUMN W/ MASONRY PIER:

-MIN. 6"X6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.

-1-OP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION
DRAWINGS.

-1-4" X 1-4" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP.
-REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
-SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4, -3/4" AIR SPACE AROUND POST.

-MIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR, SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE. -14" X 14" MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.

REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.

NOTE: BECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.

EXTERIOR COLUMN: -MIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE

MEI AL SADDLE
NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4. 50 COLD CELLARS: FOR COLD CELLARS PROVIDE THE FOLLOWING: VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.

-VENTING AREA TO BE EXJUIVALENT TO 0.2% OF COL -COVER VENT W, BUG SCREEN -WALL MOUNTED LIGHT FIXTURE -1+L7 FOR DOOR OPENING -2-8" X 6-8" EXTERIOR TYPE DOOR (MIN.R-4 RSI 0.7) -INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)

51 STUD WALL REINFORCEMENT:

-WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)(a)&(c) & 3.8.3.13.(2)(f) & 3.8.3.13.(4)(c)
-GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)
FRAME CONSTRUCTION:

-ALL FRAMING LUMBER TO BE NO.1 AND No. 2 SPF UNLESS NOTED OTHERWISE. -ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND -JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING -BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING -DOUBLE STUDS @ OPENINGS
-DOUBLE STUDS @ OPENINGS
-DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE
BETWEEN 3-11" (1200mm) AND 10'-8" (3200mm)
-DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm)
-DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS
-BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE PARALLEL TO FLOOR JOISTS

PARALLEL TO FLOOR JOISTS

-BEAMS MAY BE A MAX. 24" (600mm) FROM LOADBEARING WALLS
WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS

-APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN
THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS

1400 DURING SUPPORTING POOF LOADS SHALL HOTER FOR ANTH PROPERTY. -FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X -FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED

MORETHAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm) 235mm) OR LARGER. -WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER -WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL

HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 1.8 W/(m2.K) OR

-AN ENERGY RATING OF NOT LESS THAN 21 FOR OPERABLE WINDOWS &
31 FOR FIXED WINDOWS

-BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING -SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF -FOR GROSS GLAZED AREAS IESS THAN 17%

ADDITIONAL COMPLIANCE ALTERNATIVES FOR PACKAGE J. -THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED; THAT THE WINDOWS AND SLIDING GLASS DOORS HAVE A MAXIMUM U-VALUE OF 1.6, OR THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A MINIMUM R20 (RSI 3.52).

OR

-WHERE BLOWN-IN INSULATION OR SPRAY-APPLIED FOAM INSULATION IS USED,
THE MINIMUM R (RS)I) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE
GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED a) THE THERMAL INSULATION VALUE IN A CEILING WITH AN ATTIC SPACE IS NOT LESS THAN R60 (RSI 10.55),

b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 OF THE MINIMUM APUE OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS,

d) THE MINIMUM APUE OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY OROFESSION4

FOR STRUCTURAL ONLY ♦ CLIENT SPECIFIC REVISIONS

Gold Park

Huntington & Nashville Kleinburg

25-7

RN design Imagine - Inspire - Create



I. JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD.LINDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS

REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES. QUALIFIED DESIGNER BCIN:

SIGNATURE:

AO TITLE SHEET

FIRM BCIN:

PART. OPT. GROUND FLOOR PLAN ELEV 'A' & 'B' PART OPT MAIN FLOOR PLAN FLEV 'A' PART. OPT. SECOND FLOOR PLAN ELEV 'A' PART. STD. & OPT. SEC. FLR. PLAN ELEV 'B'

PART. STD. & OPT. MAIN FLR. PLAN EL. 'B' A4 FRONT ELEVATION 'A' FRONT ELEVATION 'B'

A5 RIGHT SIDE ELEVATION 'A' A6 REAR ELEVATION 'A' & 'B' OPT, REAR ELEVATION 'A' & 'B' A7 LEFT SIDE ELEVATION 'A'

A8 RIGHT SIDE ELEVATION 'B'

A 10 TYPICAL CROSS-SECTION

STAIR CROSS-SECTION

A9 LEFT SIDE ELEVATION 'B'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

revisions 30-Jan-15 BU RPA 1 ISSUED FOR CLIENT REVIEW CONFIRMED ROOF TRUSS LAYOUT FOR EL. 'A' 1-Jun-15 RPA DJH REVISED AS PER FLOOR & TRUSSES COORD. 10-Jun-15 RPA DJH REVISED AS PER ENGINEERING COMMENTS 3-Jul-15 RPA DJH 5 REVISED AREA CHART (FORMAT WAS INCORRECT) 13-Oct-15 CR REMOVED FIREPLACE JOG PROJECTION ON SIDE 14-Dec-15 CR

REVISED AS PER CHENT COMMENTS 16-Dec-15 CR CR

2-Feb-16 ES


24-Feb-16 JP


SHIFTED LOCATION OF MAIN FLOOR POWDER &

REVISED STAIRS AS PER CLIENT COMMENTS

ISSUED FOR PERMIT

Homes

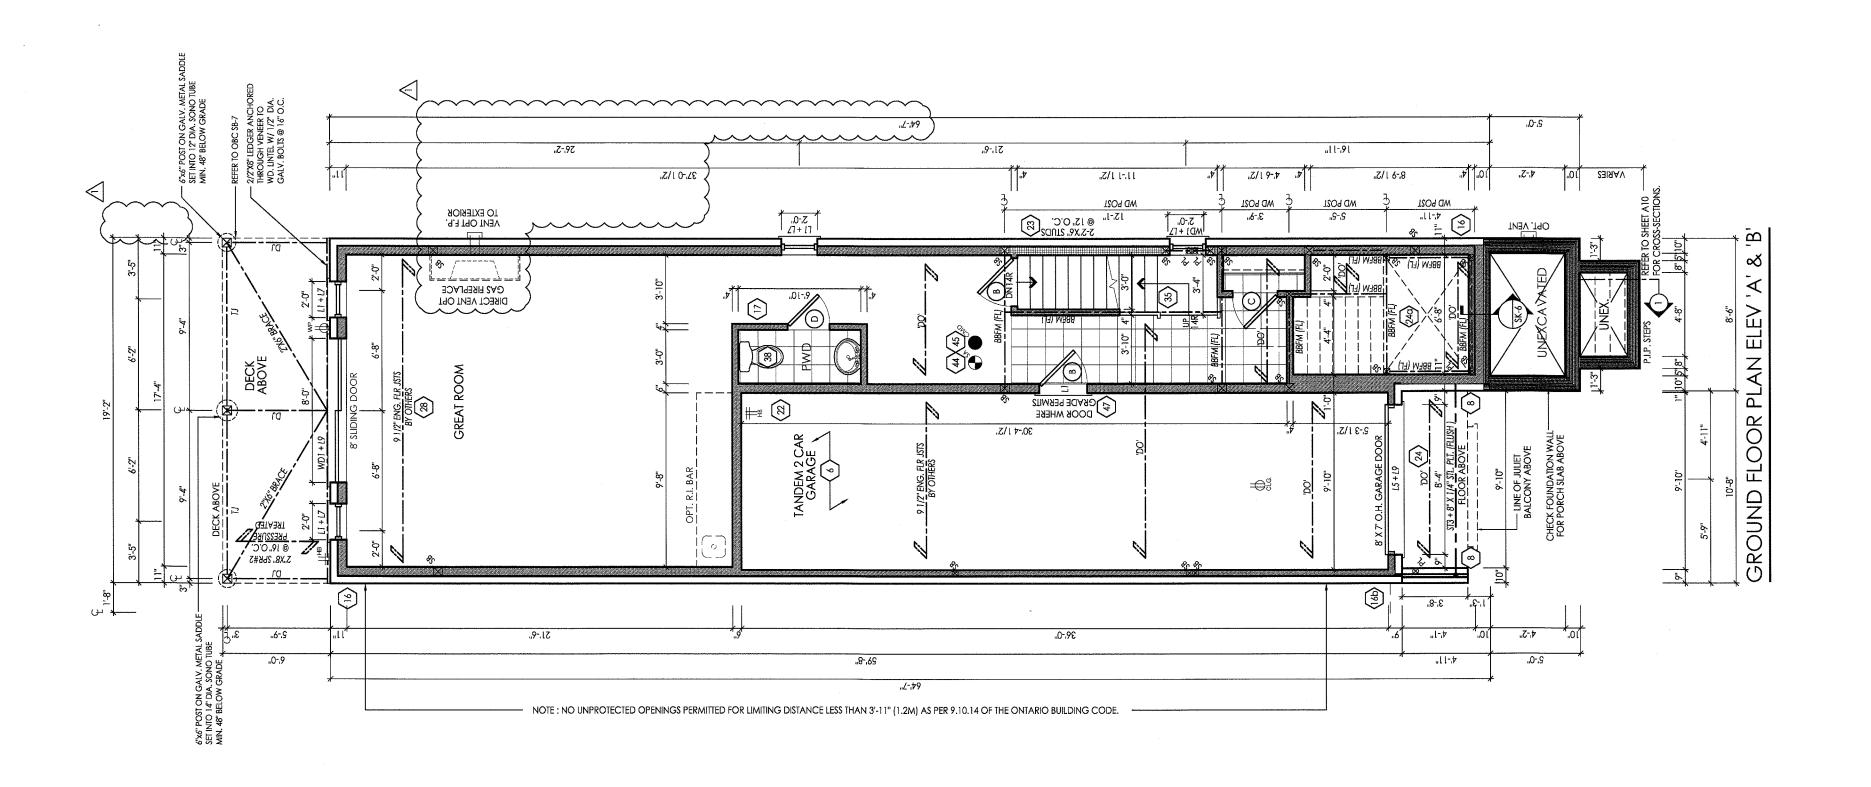

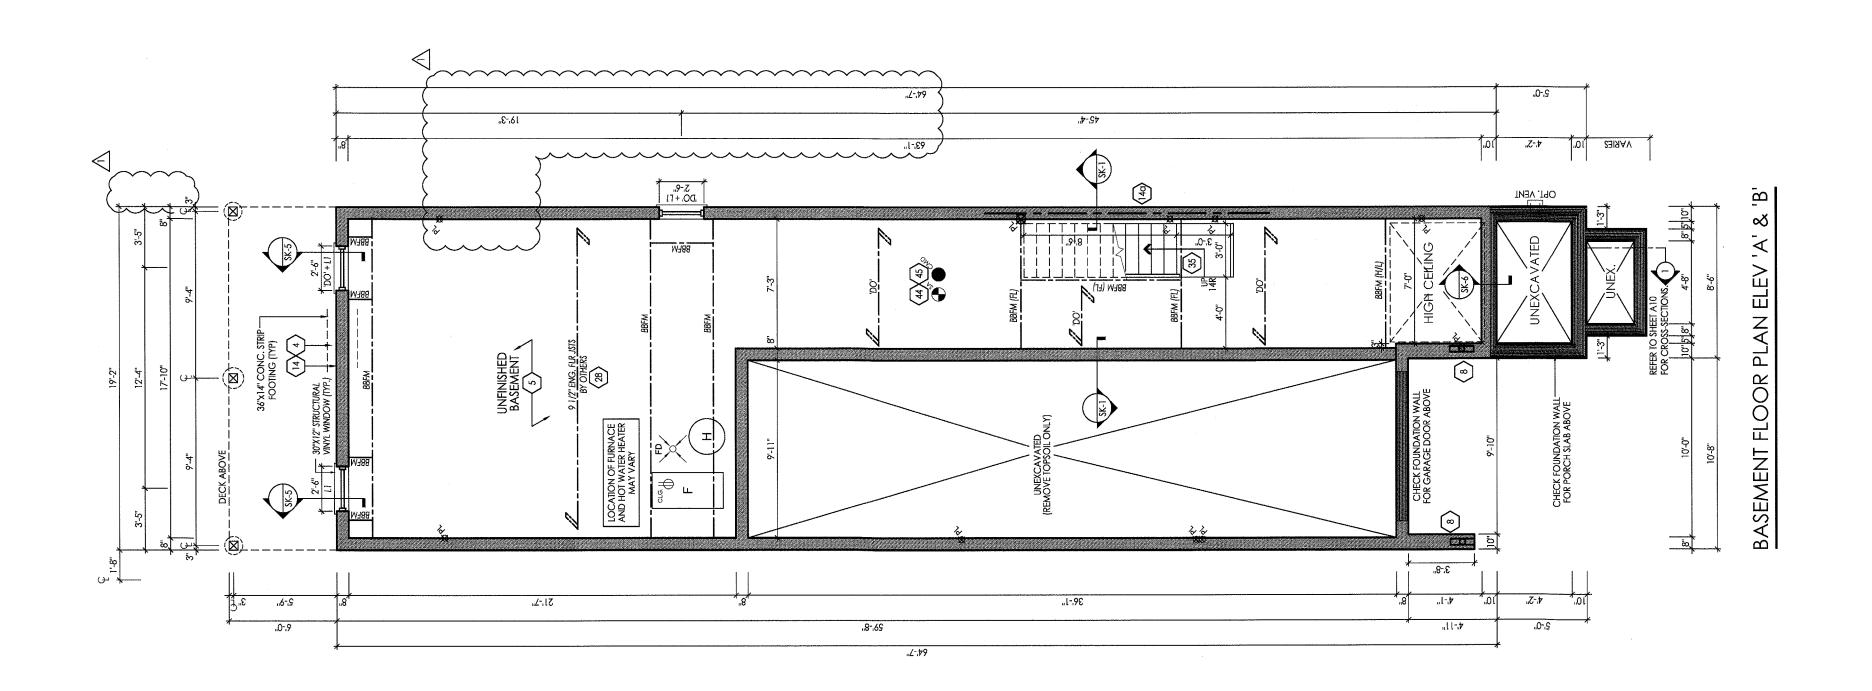



Imagine - Inspire - Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN:

SIGNATURE:


TE:

approximate a service of the service



MAR 0 4 2016

FOR STRUCTURAL ONLY EXCLUDING ENGINEERED ROOF TRUSS, FLOOR JOIST & FLOOR LVL BEAM DESIGNS



	h			
#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	30-Jan-15	BU	RPA
2	REVISED AS PER FLOOR & TRUSSES COORD.	10-Jun-15	RPA	HLG
\triangle	REMOVED FIREPLACE JOG PROJECTION ON SIDE OF HOUSE	14-Dec-15	CR	CR
3	REVISED AS PER CLIENT COMMENTS	16-Dec-15	CR	CR
4	REVISED AS PER ENGINEER COMMENTS	24-FE8-16	JP	JP
5	ISSUED FOR PERMIT	24-FEB-16	JP	JP

Gold Park Homes


Huntington & Nashville Kleinburg


25-7

ject # 14043

scale

A1

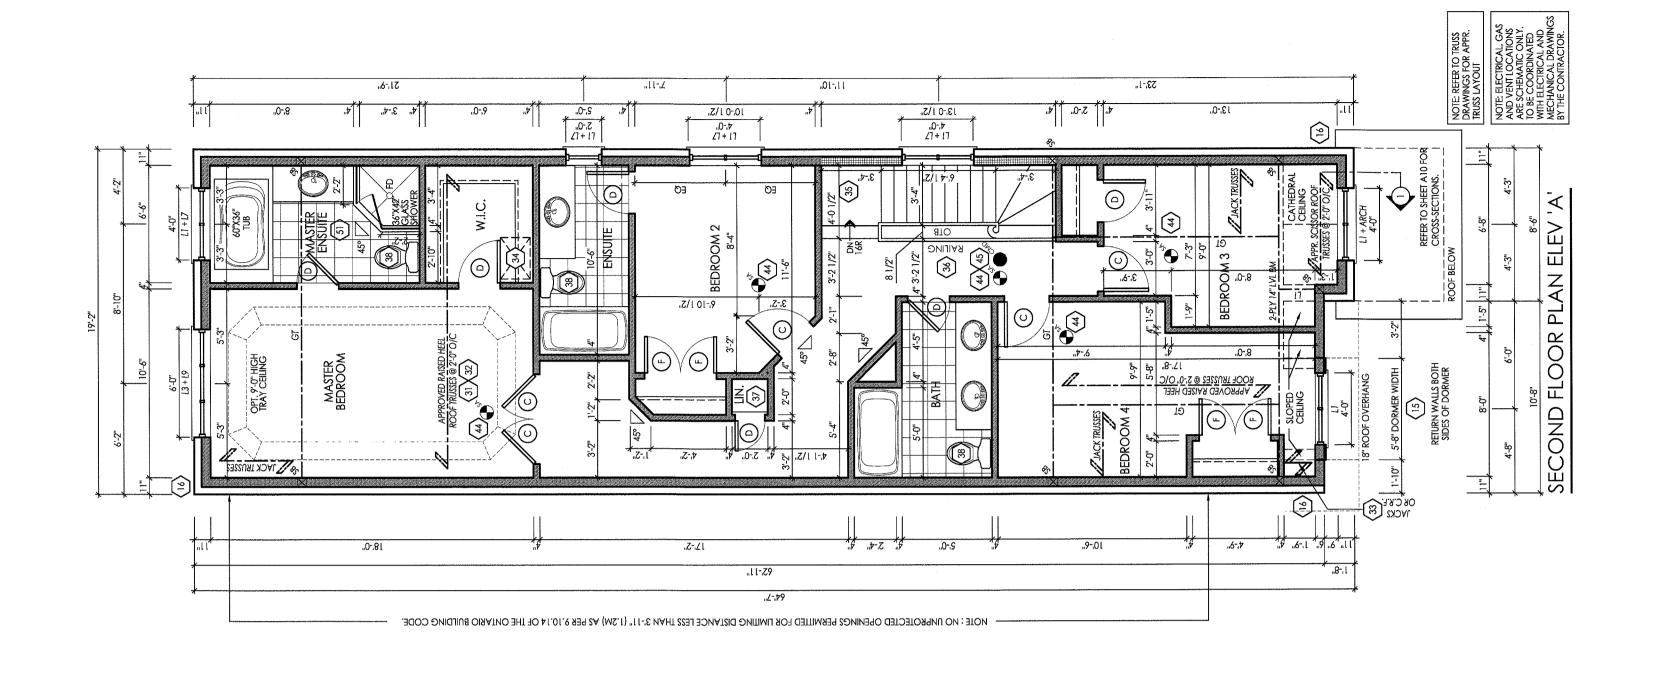

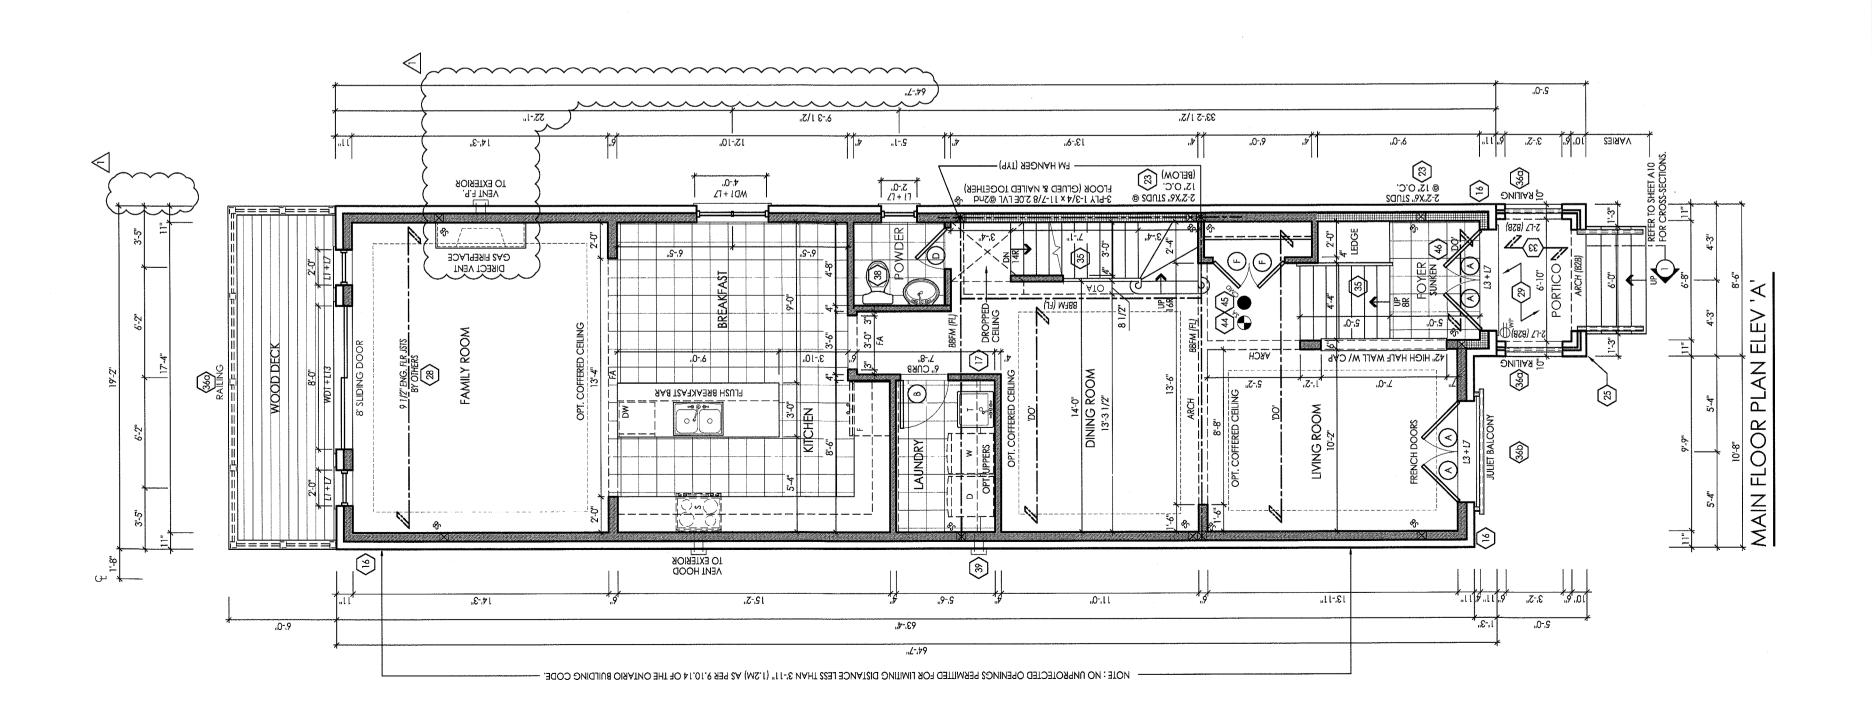




Imagine - Inspire - Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

SIGNATURE:






FOR STRUCTURAL ONLY EXCLUDING ENGINEERED ROOF TRUSS, FLOOR JOIST & FLOOR LVL BEAM DESIGNS

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.



1	ISSUED FOR CLIENT REVIEW	30-Jan-15	В
2	CONFIRMED ROOF TRUSS LAYOUT FOR EL. 'A'	1-Jun-15	RP/
3	REVISED AS PER FLOOR & TRUSSES COORD.	10-Jun-15	RPA
Â	REMOVED FIREPLACE JOG PROJECTION ON SIDE OF HOUSE	14-Dec-15	CR
4	REVISED AS PER CUENT COMMENTS	16-Dec-15	CR
5	SHIFTED LOCATION OF MAIN FLOOR POWDER & REVISED STAIRS AS PER CLIENT COMMENTS	2-Feb-16	ES
7	REVISED AS PER ENGINEER COMMENTS	24-Feb-16	E\$
8	ISSUED FOR PERMIT	24-FEB-16	JP

Gold Park Homes

Huntington & Nashville


Kleinburg


25-7

14043


5000

Α2

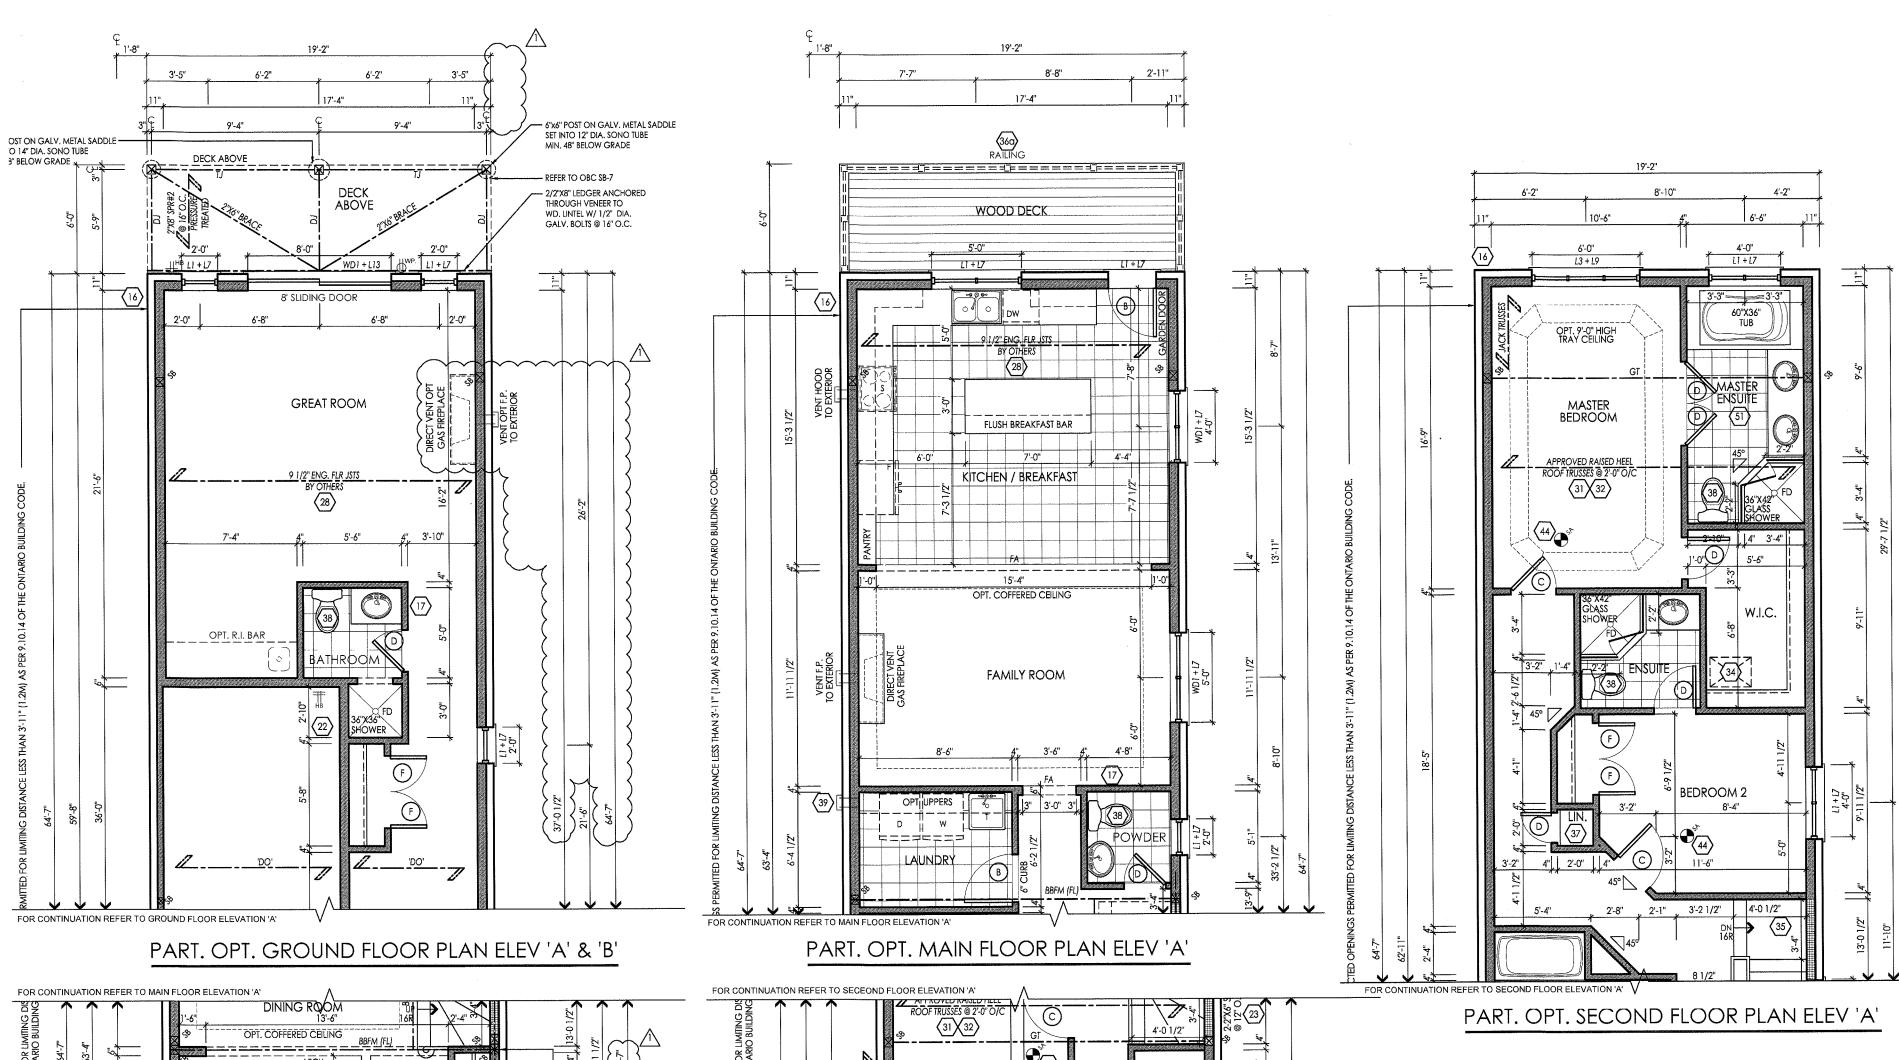

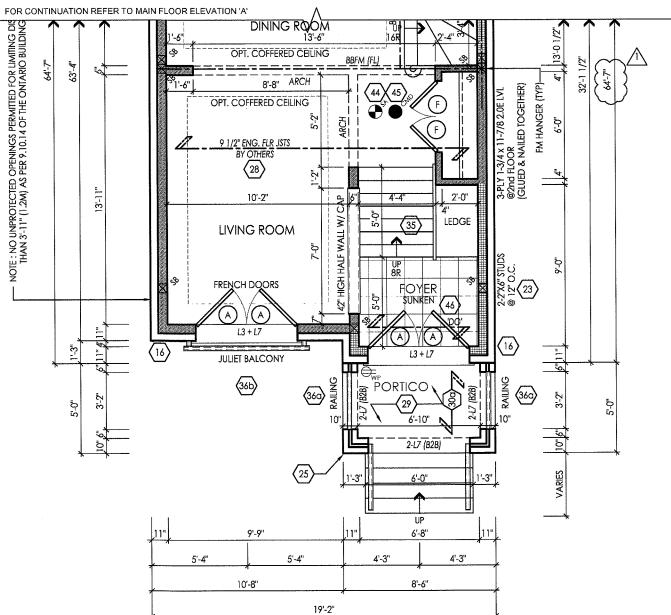

PART. STD. & OPT. MAIN FLR. PLAN EL. 'B'

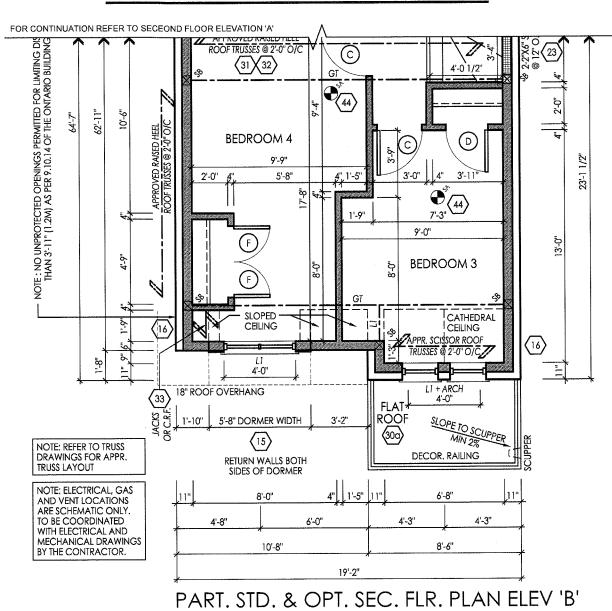






I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3,2,4
OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS
REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

SIGNATURE:



FOR STRUCTURAL ONLY EXCLUDING ENGINEERED ROOF TRUSS, FLOOR JOIST & FLOOR LVL BEAM DEGIGNS

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN. RCHITECTURAL REVIEW & APPROVAL 2 9 2016

ISSUED FOR CLIENT REVIEW REVISED AS PER FLOOR & TRUSSES COORD. REMOVED FIREPLACE JOG PROJECTION ON SIDE 3 REVISED AS PER CLIENT COMMENTS SHIFTED LOCATION OF MAIN FLOOR POWDER & REVISED STAIRS AS PER CLIENT COMMENTS

> Gold Park Homes

Huntington & Nashville Kleinburg


25-7


14043

scale

page

A3

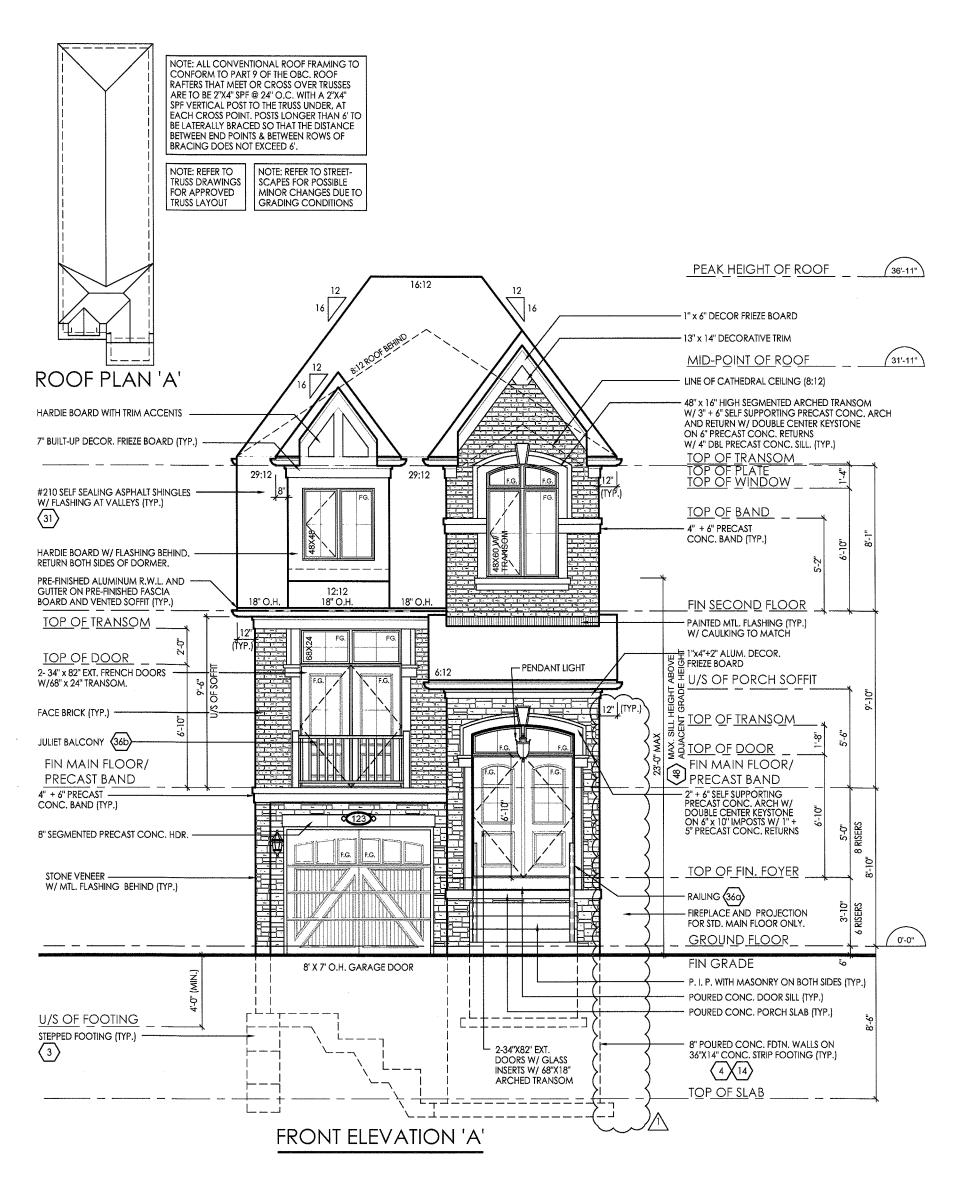

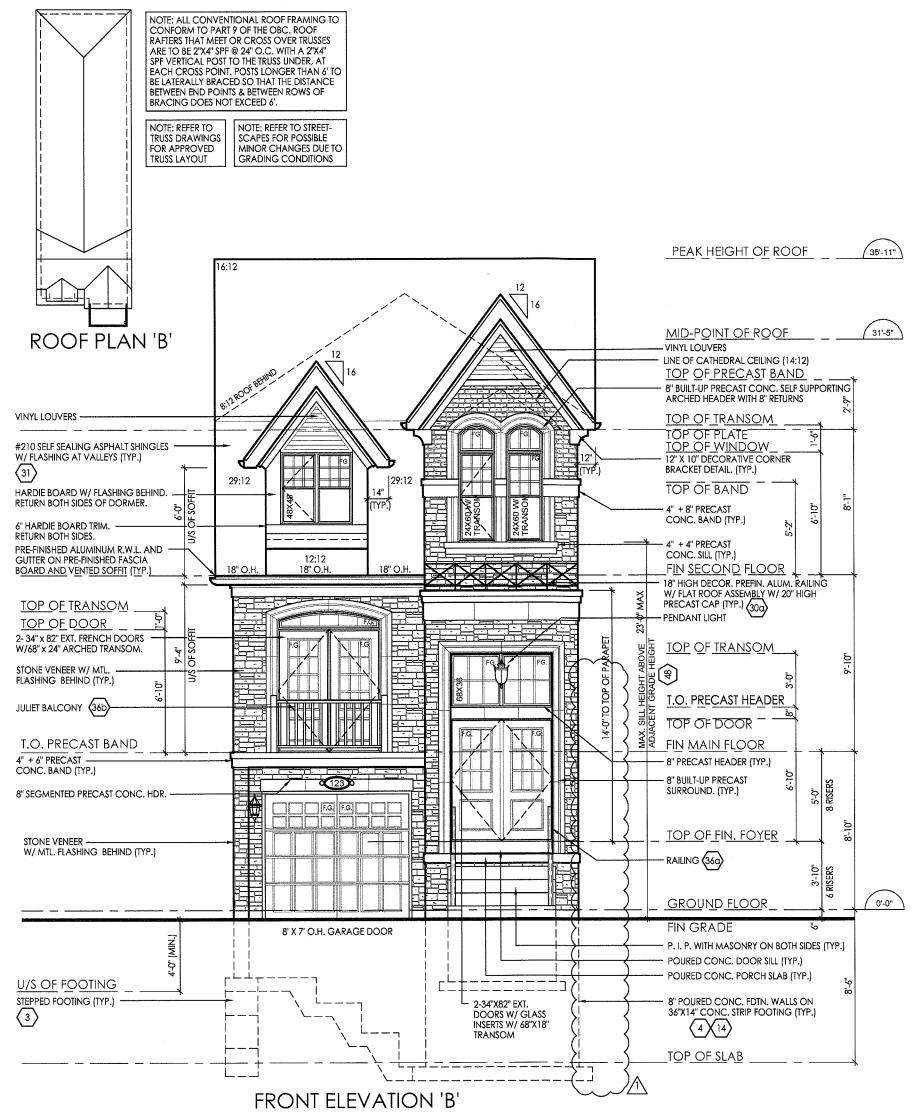

GROSS GLAZING AREA STD. 'A'

TOTAL PERIPHERAL WALL AREA	4303.30 SF	399.78 m²
FRONT GLAZING AREA	39.64 SF	3.68 m²
LEFT SIDE GLAZING AREA	O SF	0.00m^2
RIGHT SIDE GLAZING AREA	91.56 SF	8.51 m²
REAR GLAZING AREA	200.11 SF	18.59 m²
TOTAL GLAZING AREA	331.31 SF	30.78 m²
TOTAL GLAZING PERCENTAGE	7.70 %	

GROSS GLAZING AREA OPT. 'A'

TOTAL PERIPHERAL WALL AREA	4303.30 sf	399.78 m²
FRONT GLAZING AREA	39.64 sf	3.68 m²
LEFT SIDE GLAZING AREA	0 sf	0.00 m²
RIGHT SIDE GLAZING AREA	118.94 sf	11.05 m²
REAR GLAZING AREA	159.42 sf	14.81 m²
TOTAL GLAZING AREA TOTAL GLAZING PERCENTAGE	318.00 sf 7.39 %	29.54 m²

GROSS GLAZING AREA STD. 'B'

TOTAL PERIPHERAL WALL AREA	4303.30 SF	399.78 m ²
FRONT GLAZING AREA	37.23 SF	3.46 m ²
LEFT SIDE GLAZING AREA	0 SF	0.00 m ²
RIGHT SIDE GLAZING AREA	91.56 SF	8.51 m ²
REAR GLAZING AREA	200.11 SF	18.59 m ²
TOTAL GLAZING AREA TOTAL GLAZING PERCENTAGE	328.90 sF 7.64 %	30.55 m²

GROSS GLAZING AREA OPT. 'B'

TOTAL PERIPHERAL WALL AREA	4303.30 SF	399.78 m²
FRONT GLAZING AREA	37.23 SF	3.46 m²
LEFT SIDE GLAZING AREA	O SF	0.00 m²
RIGHT SIDE GLAZING AREA	118.94 SF	11.05 m²
REAR GLAZING AREA	159.42 SF	14.81 m²
TOTAL GLAZING AREA	315.59 SF	29.32 m²
TOTAL GLAZING PERCENTAGE	7.33 %	



Imagine - Inspire - Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN:

SIGNATURE


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN. ARCHITECTURAL REVIEW & APPROVAL G. Williams Limited, Architect

date dwn chk 30-Jan-15 BU RPA ISSUED FOR CLIENT REVIEW REMOVED FIREPLACE JOG PROJECTION ON SIDE 14-Dec-15 CR CR 16-Dec-15 CR CR REVISED AS PER CLIENT COMMENTS 24-FEB-16 JP

Gold Park Homes

25-7

Huntington & Nashville Kleinburg

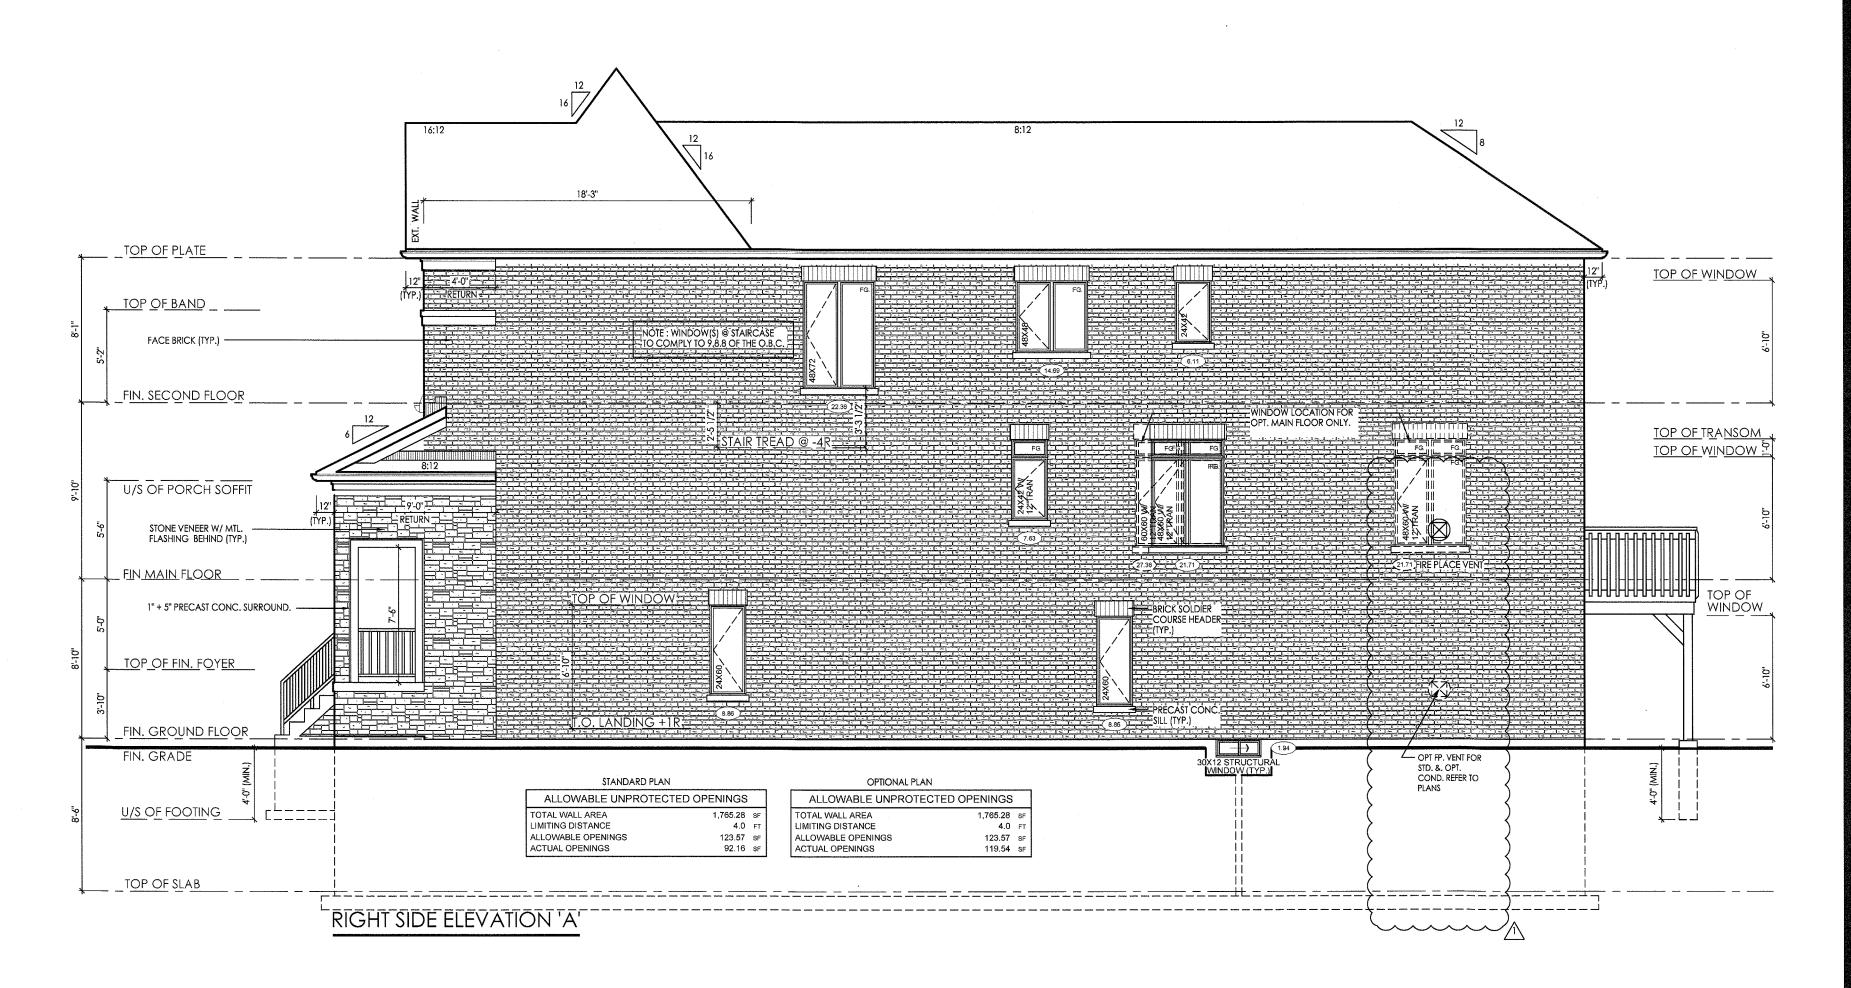



Imagine - Inspire - Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

SIGNATURE:




#	revisions	date	dwn	ch
1	ISSUED FOR CLIENT REVIEW	30-Jan-15	BU	RP.
\triangle	REMOVED FIREPLACE JOG PROJECTION ON SIDE OF HOUSE	14-Dec-15	CR	CI
2	REVISED AS PER CLIENT COMMENTS	16-Dec-15	CR	C
3	REVISED WINDOW LOCATION OVER STAIRS	2-FEB-16	ES	JF
4	ISSUED FOR PERMIT	2-Feb-16	ES	J.
client				
	Gold Par	k		


Gold Park Homes

Huntington & Nashville

Kleinburg

25-7

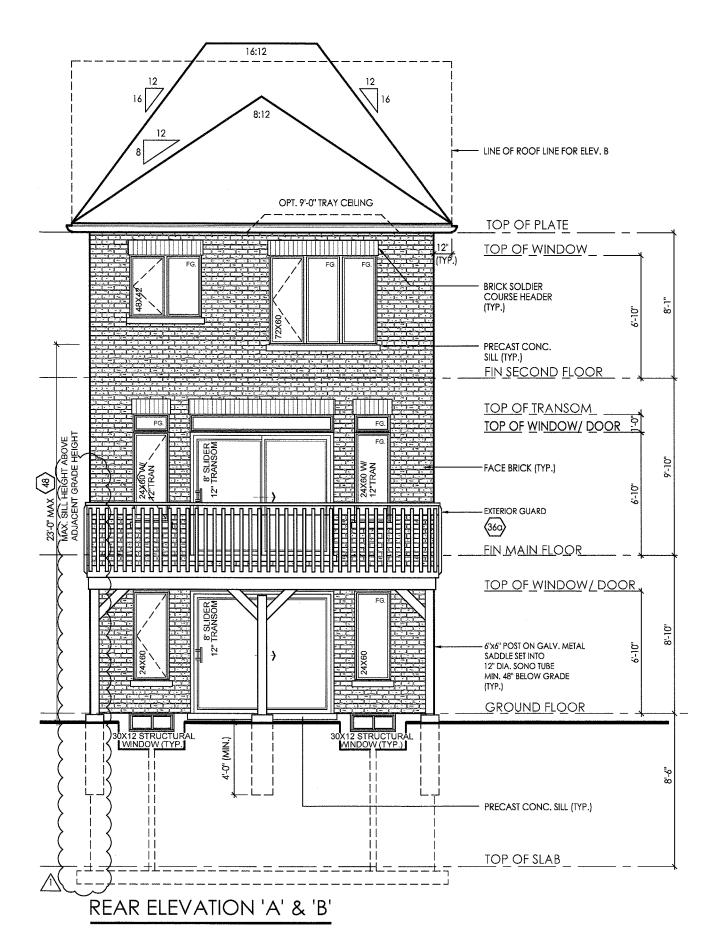

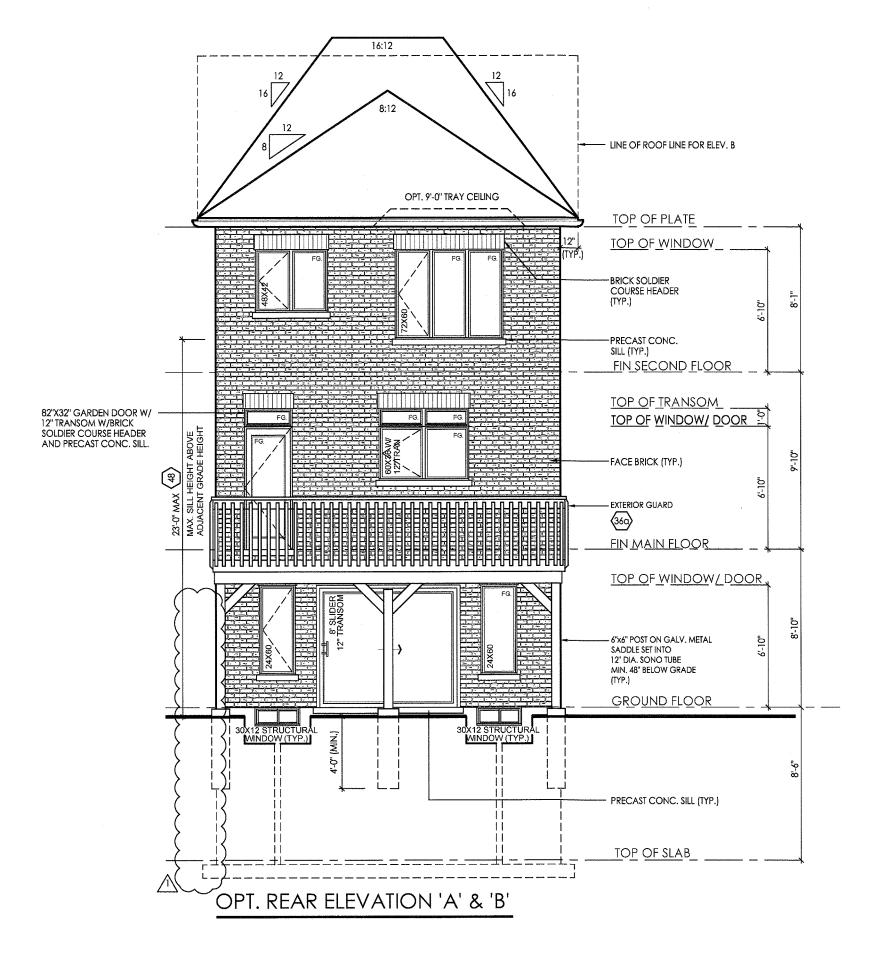



Imagine > Inspire > Create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN. IRCHITECTURAL REVIEW & APPROVAL EB 2 9 2016 ohn G. Williams Limited, Architect


	L			
#	revisions	date	dwn	chł
1	ISSUED FOR CLIENT REVIEW	30-Jan-15	BU	RPA
\triangle	REMOVED FIREPLACE JOG PROJECTION ON SIDE OF HOUSE	14-Dec-15	CR	CR
2	REVISED AS PER CUENT COMMENTS	16-Dec-15	CR	CR
3	ISSUED FOR PERMIT	24-FEB-16	JP	JP
		•		
•				
	1		I	L

Gold Park Homes

Huntington & Nashville

Kleinburg

25-7

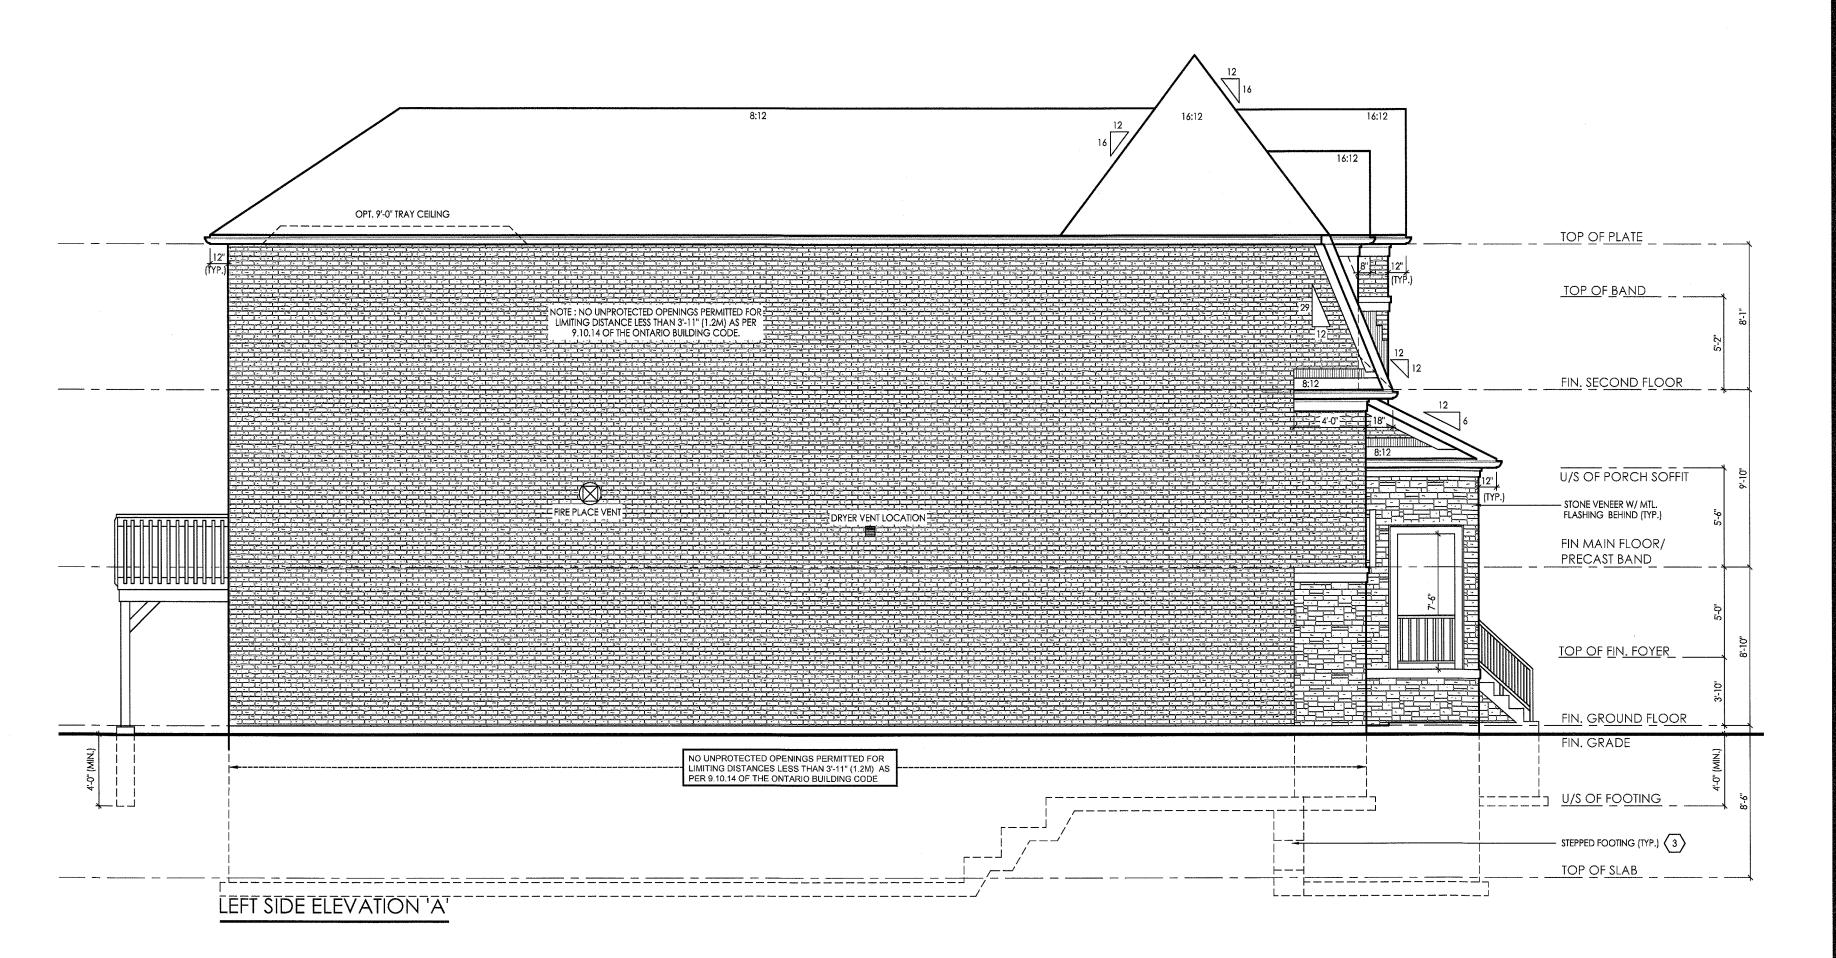



ayıne > inspire > create



I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD**, UNDER DIVISION C., PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

D/(12.

A Continues of the Cont

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

ARCHITECTURAL REVIEW & APPROVAL

#	revisions	date	dwn	ch
1	ISSUED FOR CLIENT REVIEW	30-Jan-15	BU	RP
2	REVISED AS PER CLIENT COMMENTS	16-Dec-15	CR	C
3	ISSUED FOR PERMIT	24-FEB-16	JP	Ji
4				
5				
6				
7				
8				
9				
10	The state of the s			
11				
12				

Gold Park Homes

project

Huntington & Nashville Kleinburg

model


25-7

project #

le

page

A7

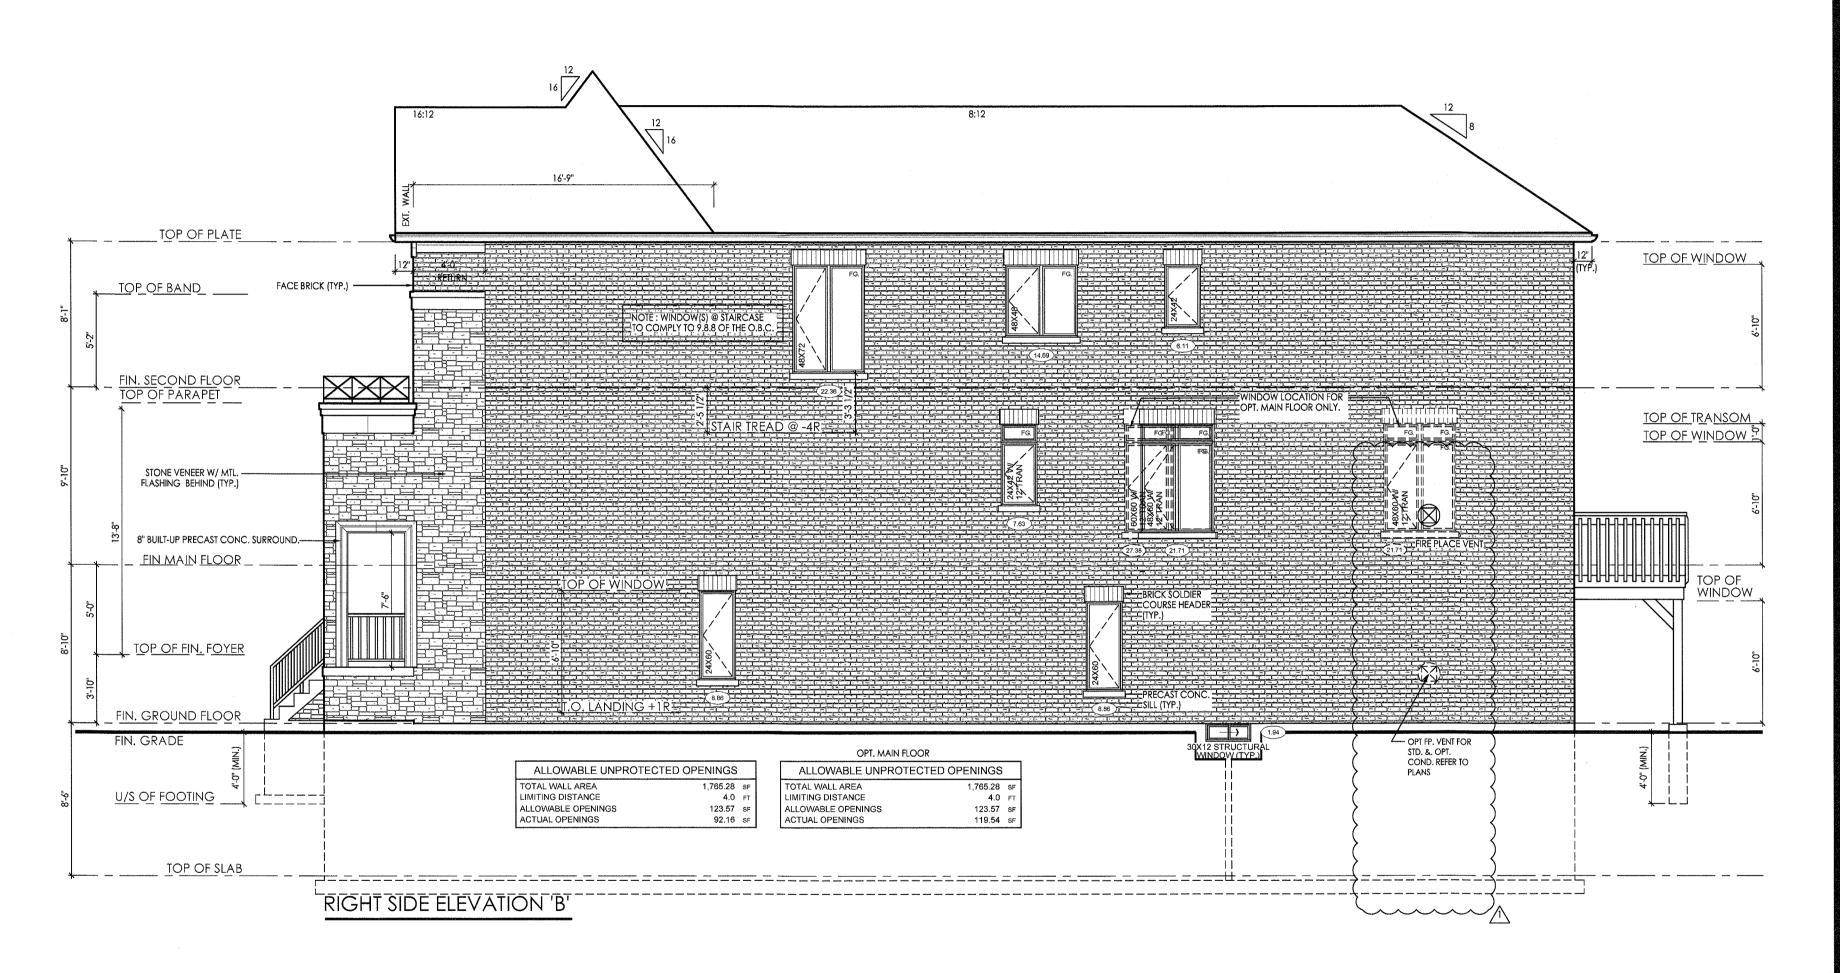





I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN:

SIGNATURE:




#	revisions	date	dwn	ch
1	ISSUED FOR CLIENT REVIEW	30-Jan-15	₿U	RP/
Â	REMOVED FIREPLACE JOG PROJECTION ON SIDE OF HOUSE	14-Dec-15	CR	CF
2	REVISED AS PER CLIENT COMMENTS	16-Dec-15	CR	CF
3	REVISED WINDOW LOCATION OVER STAIRS	2-FEB-16	ES	JP
4	ISSUED FOR PERMIT	24-Feb-16	JP	JP
			L	L

Gold Park

Homes

Huntington & Nashville Kleinburg

25-7

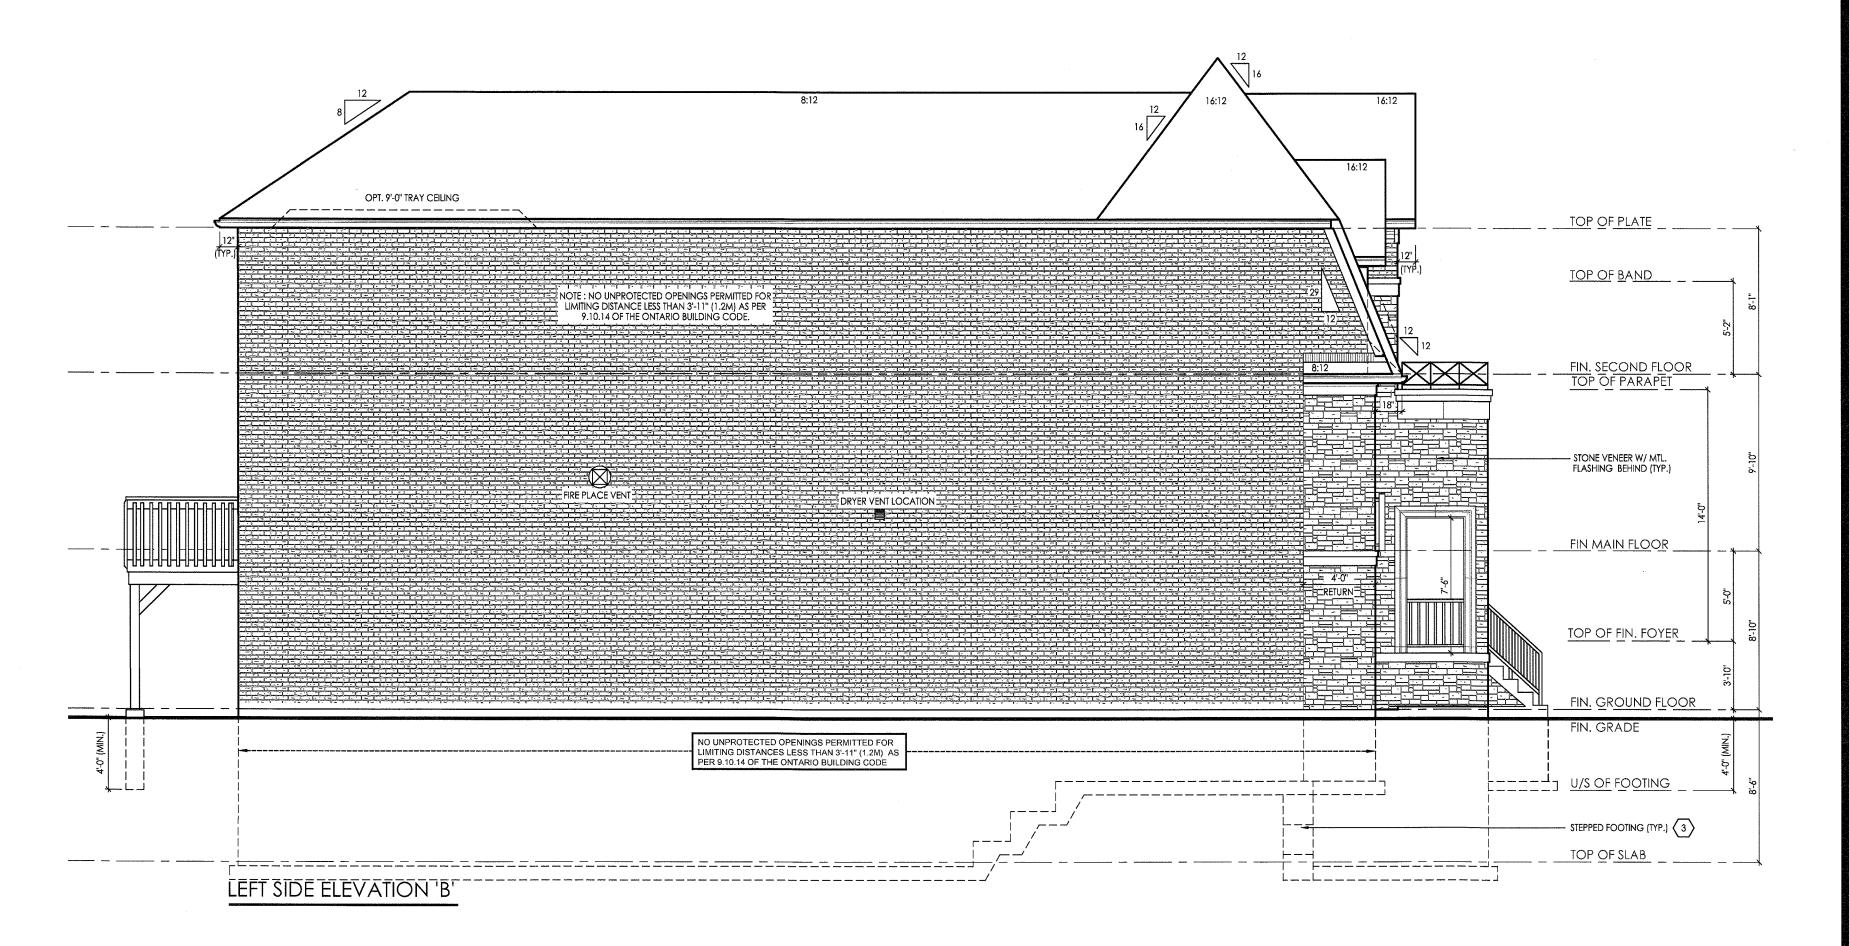





I, JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD**, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

SIGNATURE:

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN. ARCHITECTURAL REVIEW & APPROVAL F**eb** 2 9 2016


#	revisions	date	dwn	ch
1	ISSUED FOR CLIENT REVIEW	30-Jan-15	BU	RPA
2	REVISED AS PER CLIENT COMMENTS	16-Dec-15	CR	CR
3	ISSUED FOR PERMIT	24-FEB-16	JP	JP
4				
5				
6				
7				
8				
9				
10	AND DESCRIPTION OF THE PARTY OF			
11				
12				

An G. Williams Limited, Architect

Gold Park Homes

Huntington & Nashville Kleinburg

25-7

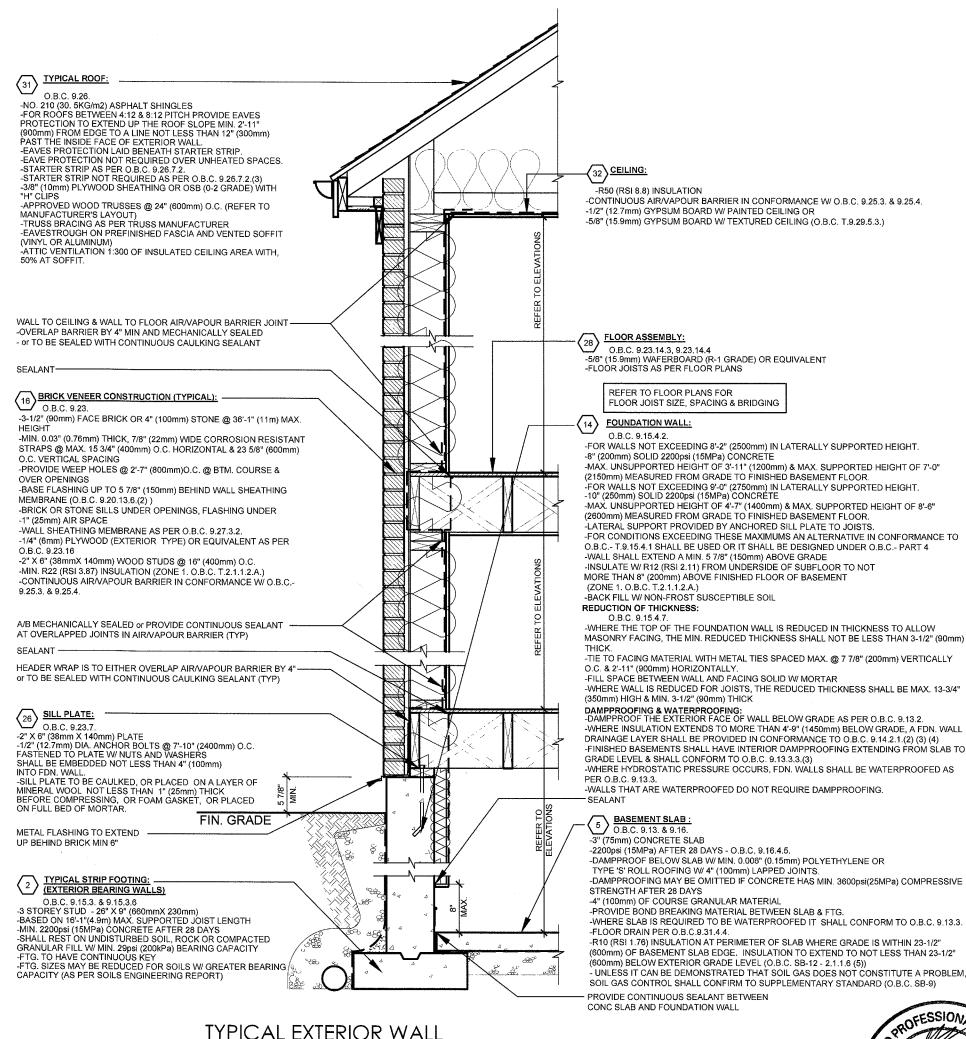

-R50 (RSI 8.8) INSULATION -CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4. -1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.) - 28 FLOOR ASSEMBLY: O.B.C. 9.23.14.3, 9.23.14.4 -5/8" (15.9mm) WAFERBOARD (R-1 GRADE) OR EQUIVALENT -FLOOR JOISTS AS PER FLOOR PLANS REFER TO FLOOR PLANS FOR (14) FOUNDATION WALL: O.B.C. 9.15.4.2. -FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN LATERALLY SUPPORTED HEIGHT.
-8" (200mm) SOLID 2200psi (15MPa) CONCRETE -MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR. -FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATERALLY SUPPORTED HEIGHT. -10" (250mm) SOLID 2200psi (15MPa) CONCRETE -MAX. UNSUPPORTED HEIGHT OF 4-7" (1400mm) & MAX. SUPPORTED HEIGHT OF 8-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR. -FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C.- T.9.15.4.1 SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C.- PART 4 -WALL SHALL EXTEND A MIN. 5 7/8" (150mm) ABOVE GRADE -INSULATE W/ R12 (RSI 2.11) FROM UNDERSIDE OF SUBFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT -BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL REDUCTION OF THICKNESS: -WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) I-HICK.

-TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7 7/8" (200mm) VERTICALLY


O.C. & 2"-11" (900mm) HORIZONTALLY.


-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR

-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK DAMPPROOFING & WATERPROOFING:
-DAMPPROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
-WHERE INSULATION EXTENDS TO MORE THAN 4'-9" (1450mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.(2) (3) (4) -FINISHED BASEMENTS SHALL HAVE INTERIOR DAMPPROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3.(3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS -WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMPPROOFING.

TYPICAL EXTERIOR WALL SECTION-BRICK

SCALE: 3/4"= 1'-0"

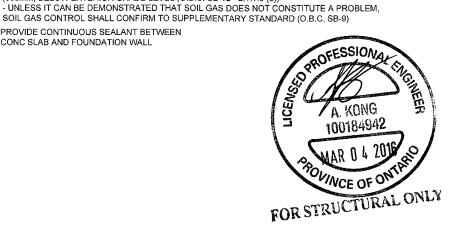

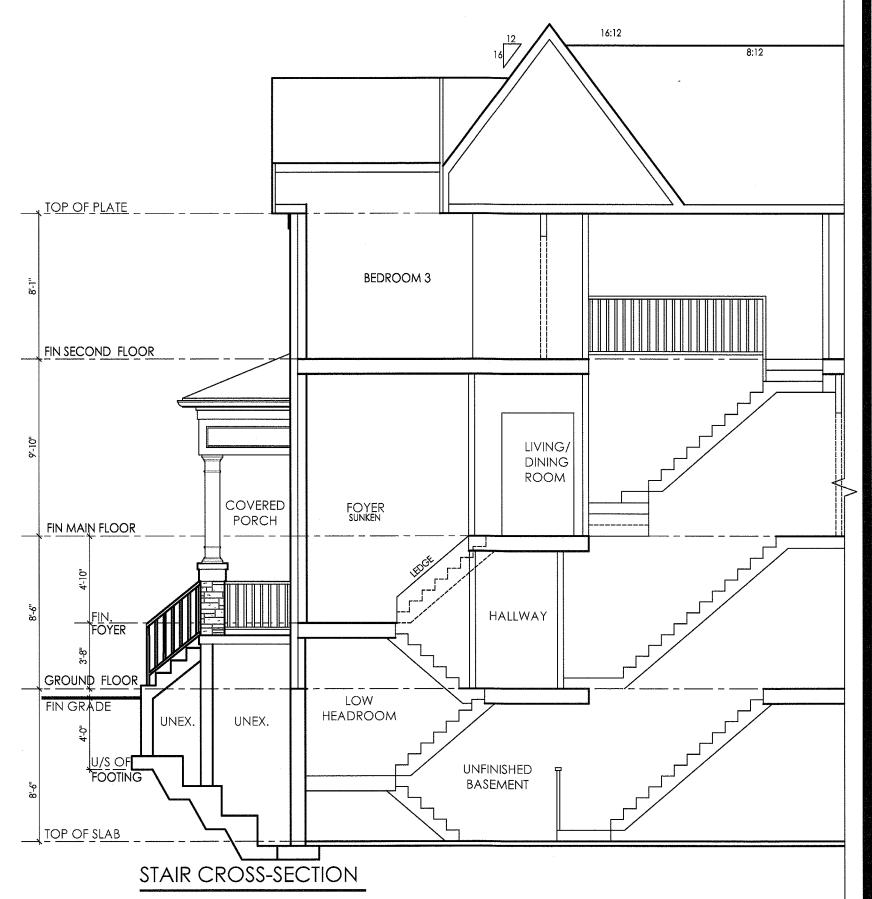





I. JULIO PINZON DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4
OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

SIGNATURE

revisions date dwn chk 1 ISSUED FOR CLIENT REVIEW 30-Jan-15 BU RPA 24-FEB-16 JP JP ISSUED FOR PERMIT 12 Gold Park Homes Huntington & Nashville Kleinburg

25-7

A10

