



# Soil Engineers Ltd.

CONSULTING ENGINEERS

GEOTECHNICAL • ENVIRONMENTAL • HYDROGEOLOGICAL • BUILDING SCIENCE

100 NUGGET AVENUE, TORONTO, ONTARIO M1S 3A7 • TEL: (416) 754-8515 • FAX: (416) 754-8516

BARRIE  
TEL: (705) 721-7863  
FAX: (705) 721-7864

MISSISSAUGA  
TEL: (905) 542-7605  
FAX: (905) 542-2769

OSHAWA  
TEL: (905) 440-2040  
FAX: (905) 725-1315

NEWMARKET  
TEL: (905) 853-0647  
FAX: (416) 754-8516

GRAVENHURST  
TEL: (705) 684-4242  
FAX: (705) 684-8522

PETERBOROUGH  
TEL: (905) 440-2040  
FAX: (905) 725-1315


HAMILTON  
TEL: (905) 777-7956  
FAX: (905) 542-2769

## Inspection No. 3

Lot 27 (Left), Lot 26 (Left and Right),  
Lot 25 (Left and Right), Lot 24 (Left and Right)  
Lot 23 (Left and Right) and  
Lot 22 (Left and Right) –  
Cranbrook Crescent

- 
- The inspected footing subgrade is capable of sustaining a Maximum Allowable Soil Pressure of 150 kPa.
- Two 15-mm steel reinforcing bars have been placed continuously in the strip footings.
- Two 15-mm steel reinforcing bars must be placed continuously in the upper section of the foundation walls and must be inspected by Soil Engineers Ltd.
- The layout and size of the strip footings and column pads of the dwellings are in general conformance with the approved permit drawing.

SOIL ENGINEERS LTD.

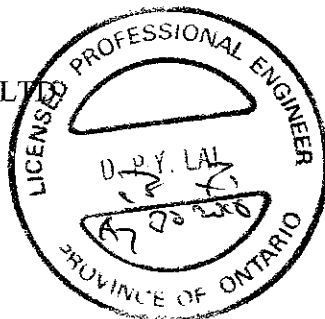

Dennis Lai, P.Eng.  
DL:vk

Gold Park Homes Inc.  
Attention: Mr. Michael Cipriano

REFERENCE NO. 1608-C052

DATE: August 30, 2016

### PROJECT:

Residential Subdivision  
Gold Park Homes at Kleinburg Glen  
Baron Street and Algoma Drive  
City of Vaughan

### JOB DESCRIPTION:

Footing Subgrade/Steel Reinforcing Bar Inspection

DATE OF INSPECTION: August 15, 2016

INSPECTOR: Jalal Fahimi, C.E.T.

### DESIGNED SOIL PRESSURE:

-

RECOMMENDED MAXIMUM ALLOWABLE SOIL PRESSURE FOR INSPECTED SUBGRADE:  
150 kPa

### AS-BUILT ELEVATION:

As recorded by site superintendent

### WATER CONDITION:

Moist

### DESCRIPTION OF INSPECTED SUBGRADE:

Compacted earth fill

### METHOD OF INSPECTION:

Visual and rod probe

### SUBGRADE:

Approved for 150 kPa

### GIVEN TO:

Bruno

1 kPa = 20.89 psf

The footings and foundation walls must be protected against frost action at all times.



# Soil Engineers Ltd.

CONSULTING ENGINEERS

GEOTECHNICAL • ENVIRONMENTAL • HYDROGEOLOGICAL • BUILDING SCIENCE

100 NUGGET AVENUE, TORONTO, ONTARIO M1S 3A7 • TEL: (416) 754-8515 • FAX: (416) 754-8516

BARRIE  
TEL: (705) 721-7863  
FAX: (705) 721-7864

MISSISSAUGA  
TEL: (905) 542-7605  
FAX: (905) 542-2769

OSHAWA  
TEL: (905) 440-2040  
FAX: (905) 725-1315

NEWMARKET  
TEL: (905) 853-0647  
FAX: (416) 754-8516

GRAVENHURST  
TEL: (705) 684-4242  
FAX: (705) 684-8522

PETERBOROUGH  
TEL: (905) 440-2040  
FAX: (905) 725-1315

HAMILTON  
TEL: (905) 777-7956  
FAX: (905) 542-2769

## Inspection No. 7

Lot 27 (Left) –  
Cranbrook Crescent

- Two 15-mm steel reinforcing bars have been placed continuously in the upper section of the foundation walls.

SOIL ENGINEERS LTD.

Dennis Lai, P.Eng.  
DL:vk



Gold Park Homes Inc.  
Attention: Mr. Michael Cipriano

REFERENCE NO. 1608-C052

DATE: August 30, 2016

PROJECT:  
Residential Subdivision  
Gold Park Homes at Kleinburg Glen  
Baron Street and Algoma Drive  
City of Vaughan

JOB DESCRIPTION:  
Steel Reinforcing Bar Inspection

DATE OF INSPECTION: August 19, 2016

INSPECTOR: Jalal Fahimi, C.E.T.

DESIGNED SOIL PRESSURE:

-

RECOMMENDED MAXIMUM ALLOWABLE SOIL PRESSURE FOR INSPECTED SUBGRADE:

-

AS-BUILT ELEVATION:

-

WATER CONDITION:

-

DESCRIPTION OF INSPECTED SUBGRADE:

-

METHOD OF INSPECTION:

Visual

SUBGRADE:

-

GIVEN TO:

Bruno

1 kPa = 20.89 psf

The footings and foundation walls must be protected against frost action at all times.