



FRONT ELEVATION 'A'



FRONT ELEVATION 'B'

Drawing List:

- A0 TITLE SHEET
- A1 BASEMENT FLOOR ELEV. 'A' & 'B'
- A2 GROUND FLOOR ELEV. 'A'
- A3 SECOND FLOOR ELEV. 'A'
- A4 PART. GROUND FLOOR ELEV. 'B'
- A5 PART. SECOND FLOOR ELEV. 'B'
- A6 FRONT ELEVATION 'A'
- A7 RIGHT SIDE ELEVATION 'A'
- A8 REAR ELEVATION 'A' & 'B'
- A9 LEFT SIDE ELEVATION 'A'
- A10 FRONT ELEVATION 'B'
- A11 RIGHT SIDE ELEVATION 'B'
- A12 LEFT SIDE ELEVATION 'B'
- A13 TYPICAL RAOSS-SECTION
- A14 PARTIAL BASEMENT FLOOR PLAN ELEV. 'A' & 'B' LOB CONDITION
- A15 PARTIAL GROUND FLOOR PLAN ELEV. 'A' & 'B' LOB CONDITION
- A16 PARTIAL REAR ELEVATION 'A' & 'B' LOB CONDITION
- A17 PARTIAL BASEMENT FLOOR PLAN ELEV. 'A' & 'B' WOD CONDITION
- A18 PARTIAL GROUND FLOOR PLAN ELEV. 'A' & 'B' WOD CONDITION
- A19 PARTIAL REAR ELEVATION 'A' & 'B' WOD CONDITION
- D1 CONSTRUCTION NOTES
- D2 CONSTRUCTION NOTES
- D3 CONSTRUCTION NOTES

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

9	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH						
10	ADDED DECK CONDITIONS FOR REVIEW	27-May-16	SM	JP						
11	REVISED AS PER CLIENT COMMENTS	21-Jun-16	JP	JP						
12	REVISED AS PER OBC S812 2017 UPDATE	3/29/2017	ES	ES						

Areas:

	ELEVATION 'A'		ELEVATION 'B'	
	SF	SM	SF	SM
GROUND FLOOR	971.3	90.2	971.3	90.2
SECOND FLOOR	1218.3	113.2	1215.4	112.9
TOTAL AREA	2189.6	203.4	2186.7	203.1
COVERAGE INC PORCH	1421.0	132.0	1421.0	132.0
COVERAGE NOT INC PORCH	1341.2	124.6	1341.2	124.6

Gold Park Homes
Mclaughlin and
Mayfield
The Bizet

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE:

J.P.

client
Gold Park Homes

location
Brampton

project
Mclaughlin and Mayfield

marketing name
The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	PS	ra	5	REVISED AS PER ENGINEERING COMM.	27-May-15	RPA	DJH
2	ADJUSTED STAIR LOCATION ON BSMT. & GRND. FLOOR	28-JUL-14	cr	cr	6	ISSUED FOR PERMIT	6/16/2015	RPA	DJH
3	FLOOR & TRUSS COORDINATION	18-Aug-14	FE	DJ	7	REVISED BREAKFAST BAR NOTATION TO STATE FLUSH	3-Sep-15	cr	cr
4	REVISED AS PER ARCH CONTROL COMM.	8/18/2014	ra	ra	8	REVISED AS PER UPDATED FLOOR JOIST	9/11/2015	cr	cr

RN design
Imagine • Inspire • Create




model
38-1

scale
3/16" = 1'0"

project #
13098


page

A0

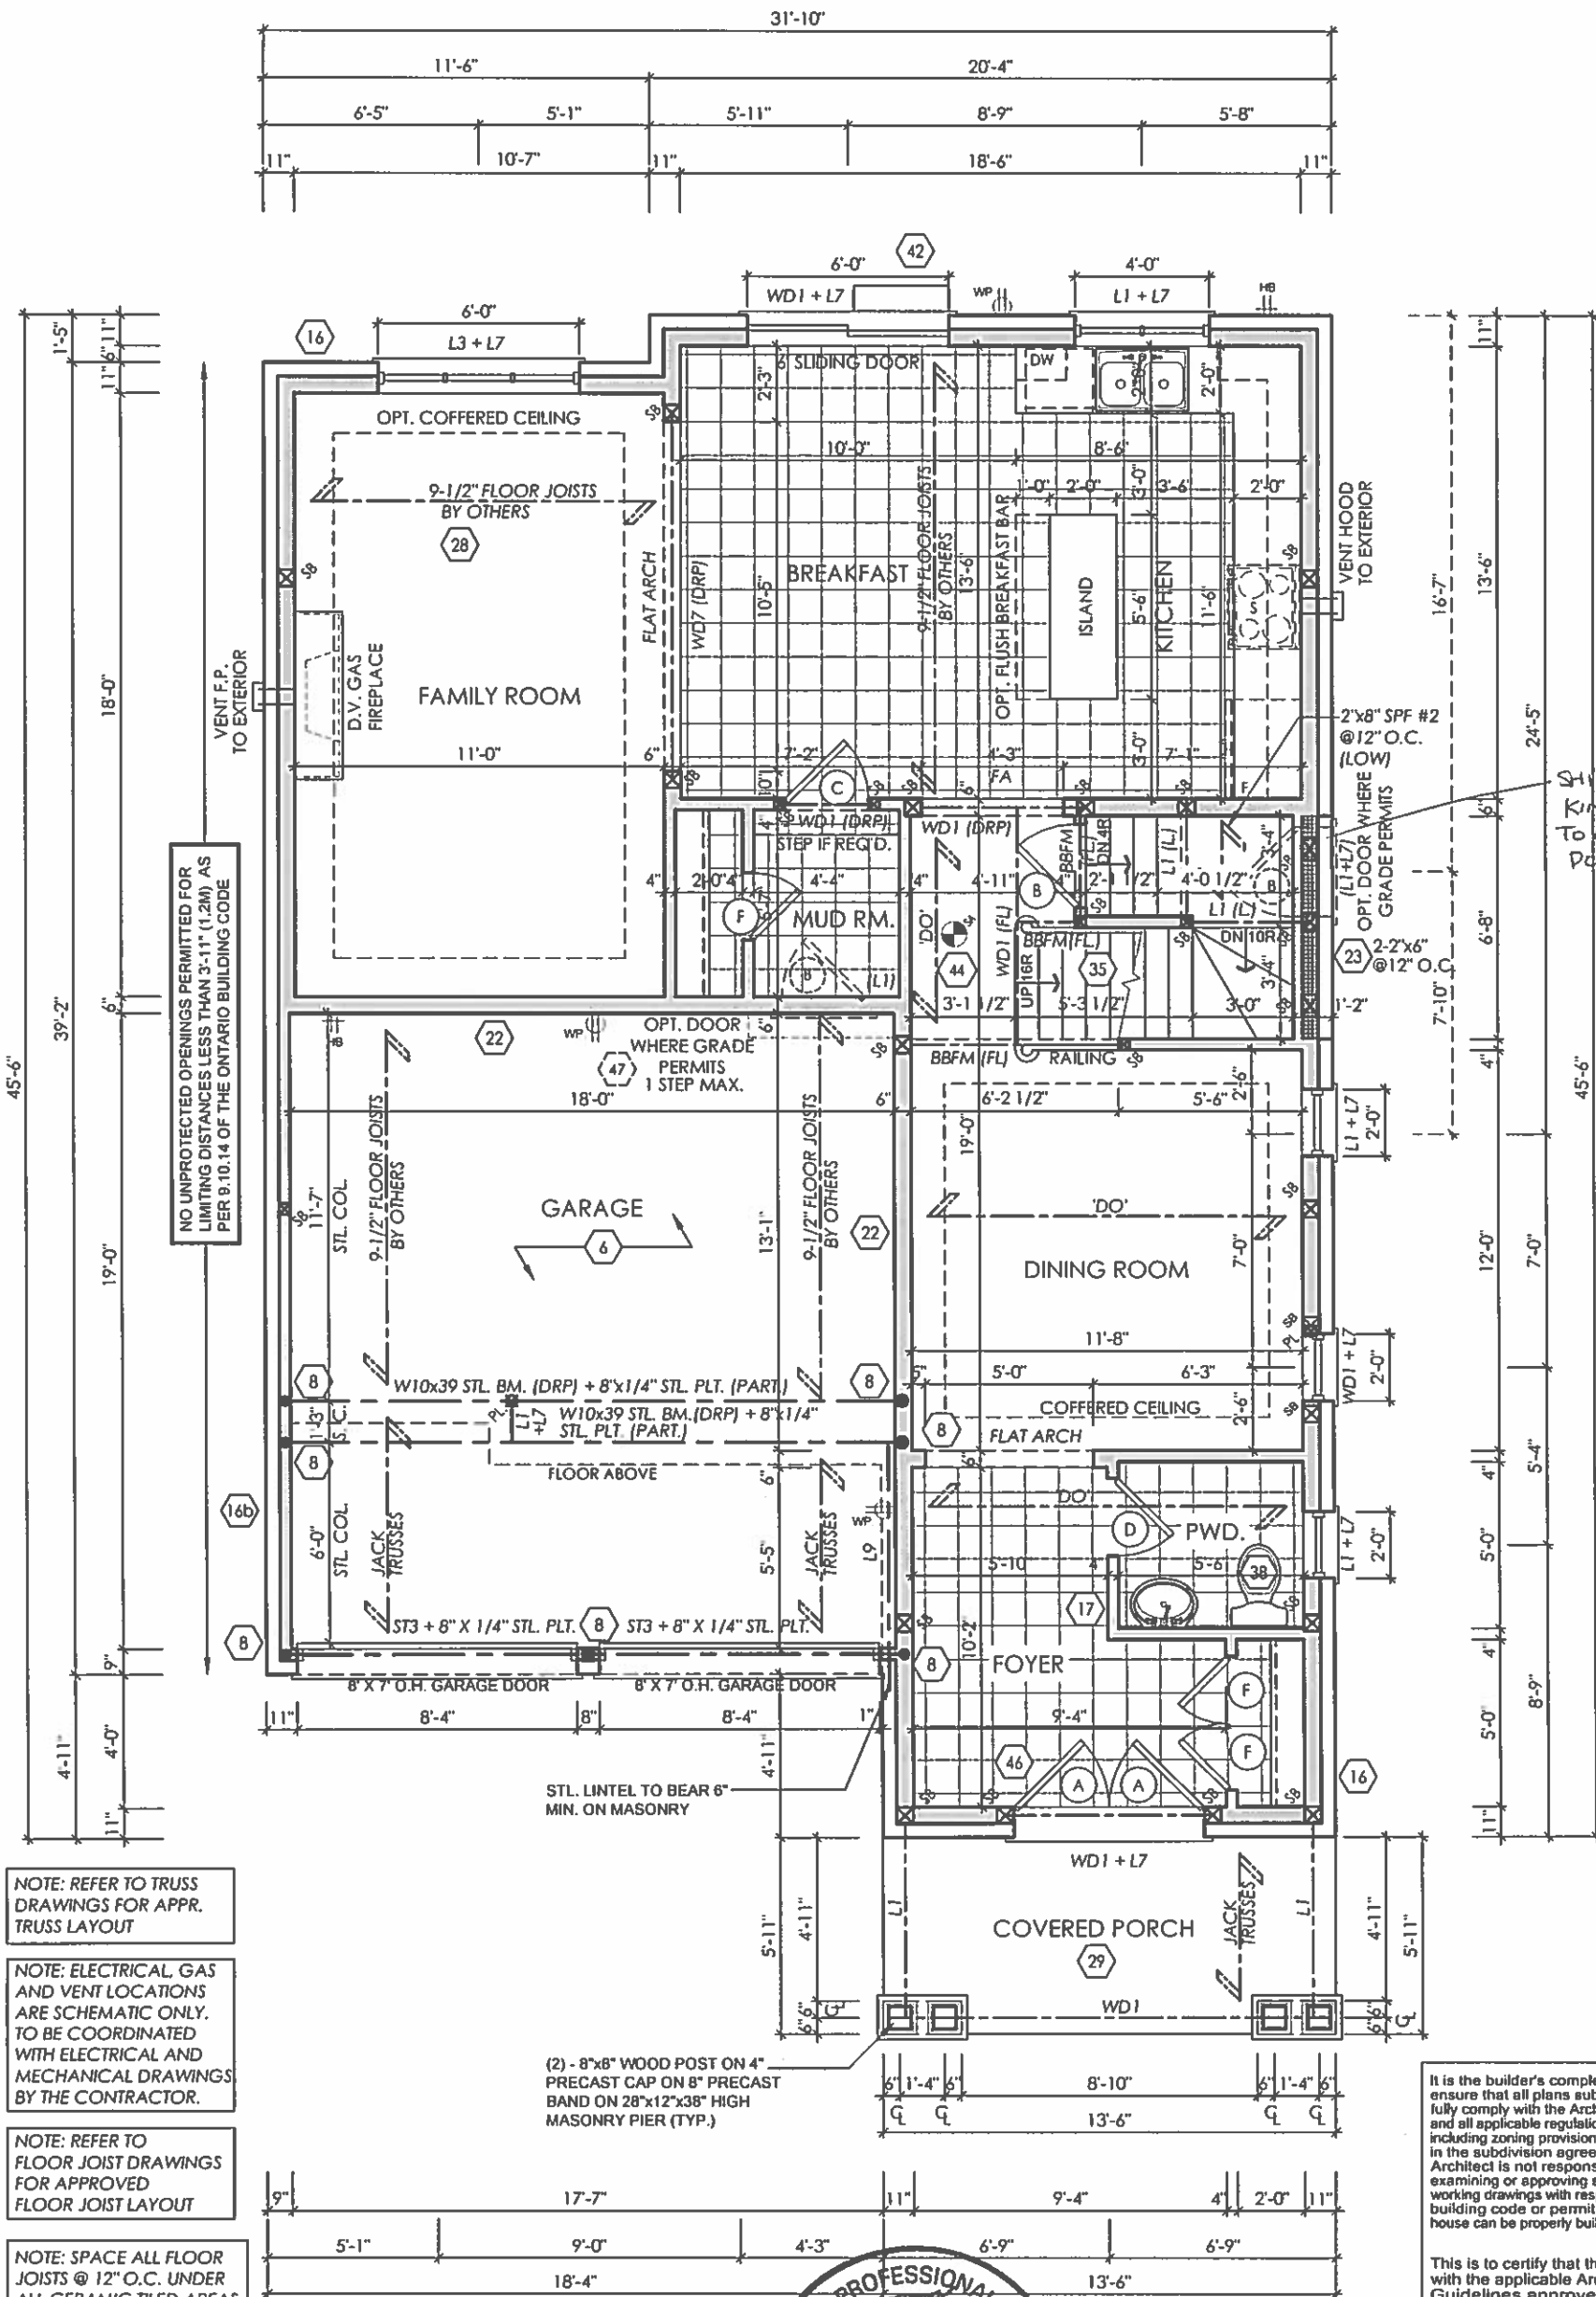

- NOTE: REFER TO TRUSS DRAWINGS FOR APPR. TRUSS LAYOUT
- NOTE: ELECTRICAL, GAS AND VENT LOCATIONS ARE SCHEMATIC ONLY. TO BE COORDINATED WITH ELECTRICAL AND MECHANICAL DRAWINGS BY THE CONTRACTOR.
- NOTE: REFER TO FLOOR JOIST DRAWINGS FOR APPROVED FLOOR JOIST LAYOUT
- NOTE: SPACE ALL FLOOR JOISTS @ 12" O.C. UNDER ALL CERAMIC TILED AREAS
- NOTE: CONC. FRONT PORCH POURED PRIOR TO BRICK

GROUND FLOOR ELEV. 'A'

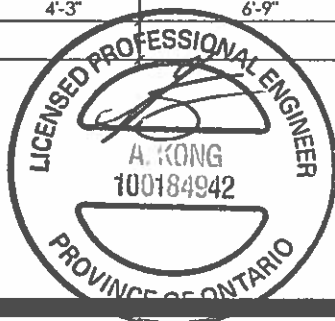

MAY 01 2017

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE:

Client
Gold Park Homes
project
McLaughlin and Mayfield

location
Brampton
marketing name
The Bizez

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	ps	ra	5	ISSUED FOR PERMIT	6/16/2015	RPA	DHH
2	ADJUSTED STAIR LOCATION ON BSMT. & GRND. FLOOR	28-JUL-14	cr	cr	6	REVISED BREAKFAST BAR NOTATION TO STATE FLUSH	3-Sep-15	cr	cr
3	FLOOR & TRUSS COORDINATION	18-Aug-14	lp	cl	7	REVISED AS PER UPDATED FLOOR JOIST LAYOUTS	9/11/2015	cr	cr
4	REVISED AS PER ENGINEERING COMMENT	27-NOV-15	RPA	DHH	8	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DHH


RN design
Imagine • Inspire • Create



model
38-1
scale
3/16" = 1'0"
project #
13098

page

A2

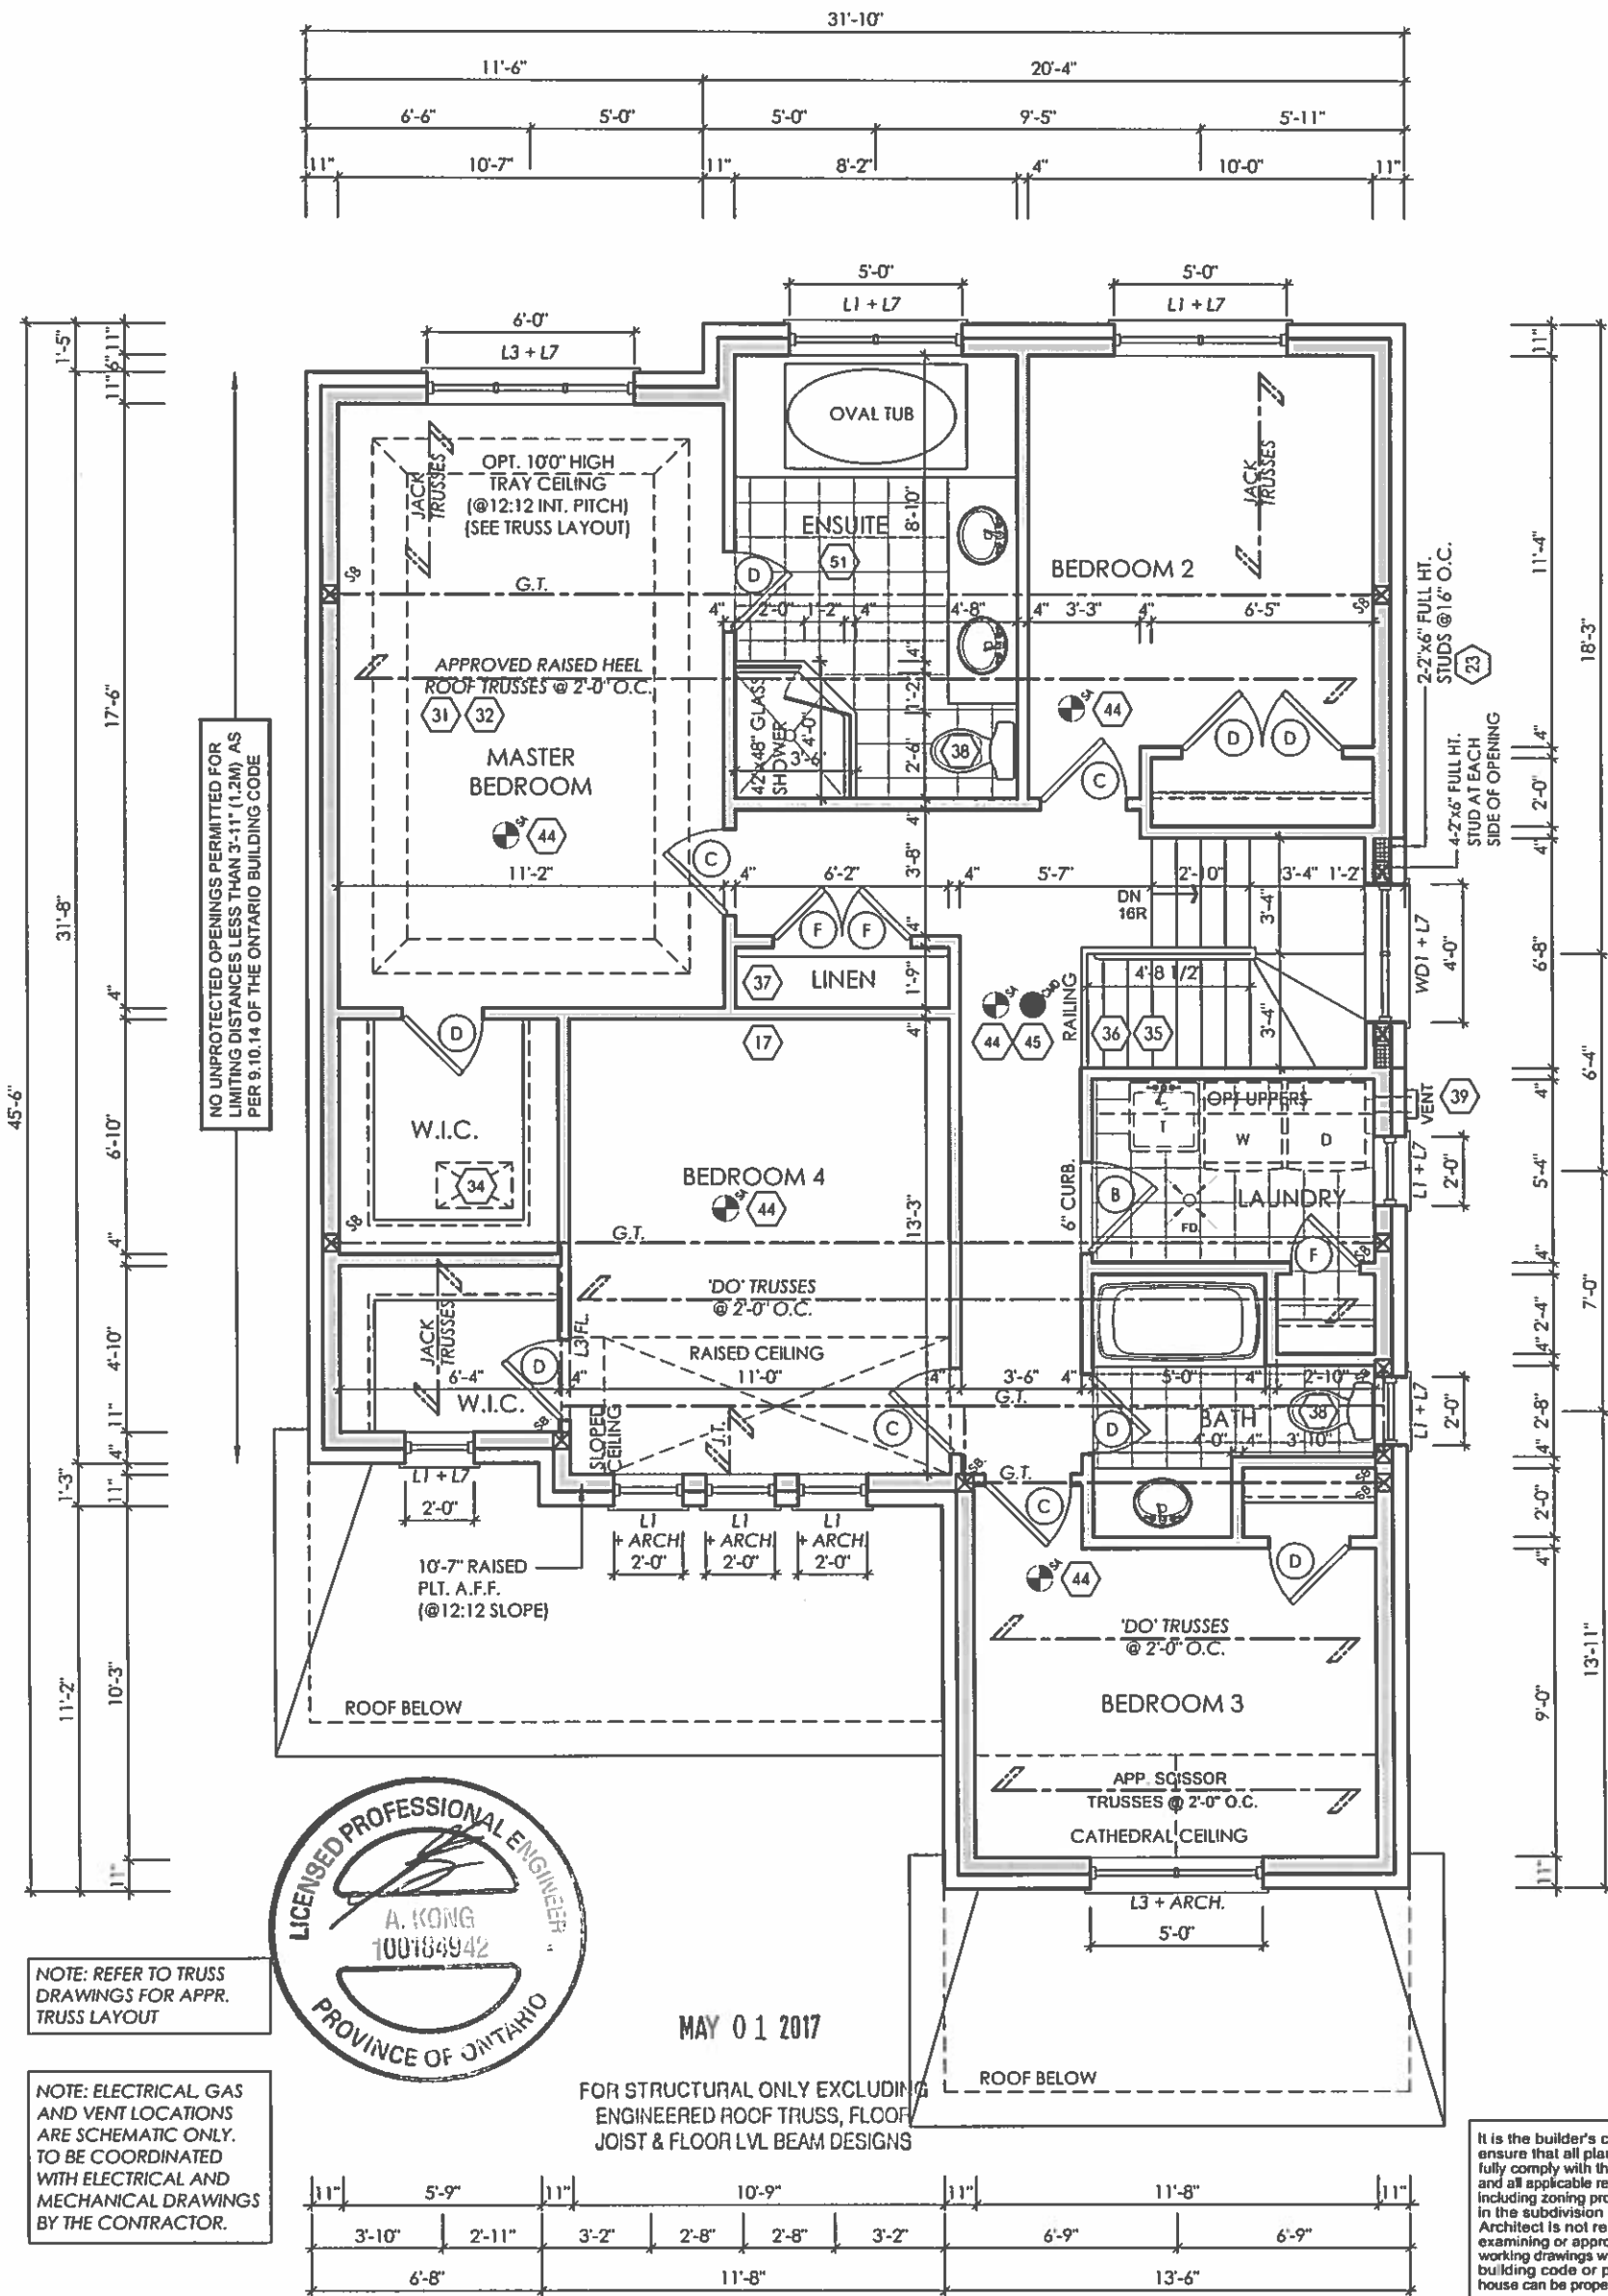

SECOND FLOOR ELEV. 'A'



MAY 01 2017

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL. BEAM DESIGNS

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE:

client
Gold Park Homes

location
Brampton

project
McLaughlin and Mayfield

marketing name
The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	ps	ta	5	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH
2	FLOOR & TRUSS COORDINATION	18-Aug-14	le	df	6	REVISED AS PER OBC SB-12 2017 UPDATE	29-Mar-17	es	es
3	REVISED AS PER ENGINEERING COMM.	27-May-15	RPA	DJH	7				
4	REVISED FOR PERIOD	6/16/2015	RPA	DJH	8				

RN design
Imagine • Inspire • Create




model
38-1

scale
3/16" = 1'0"

project #
13098


page

A3

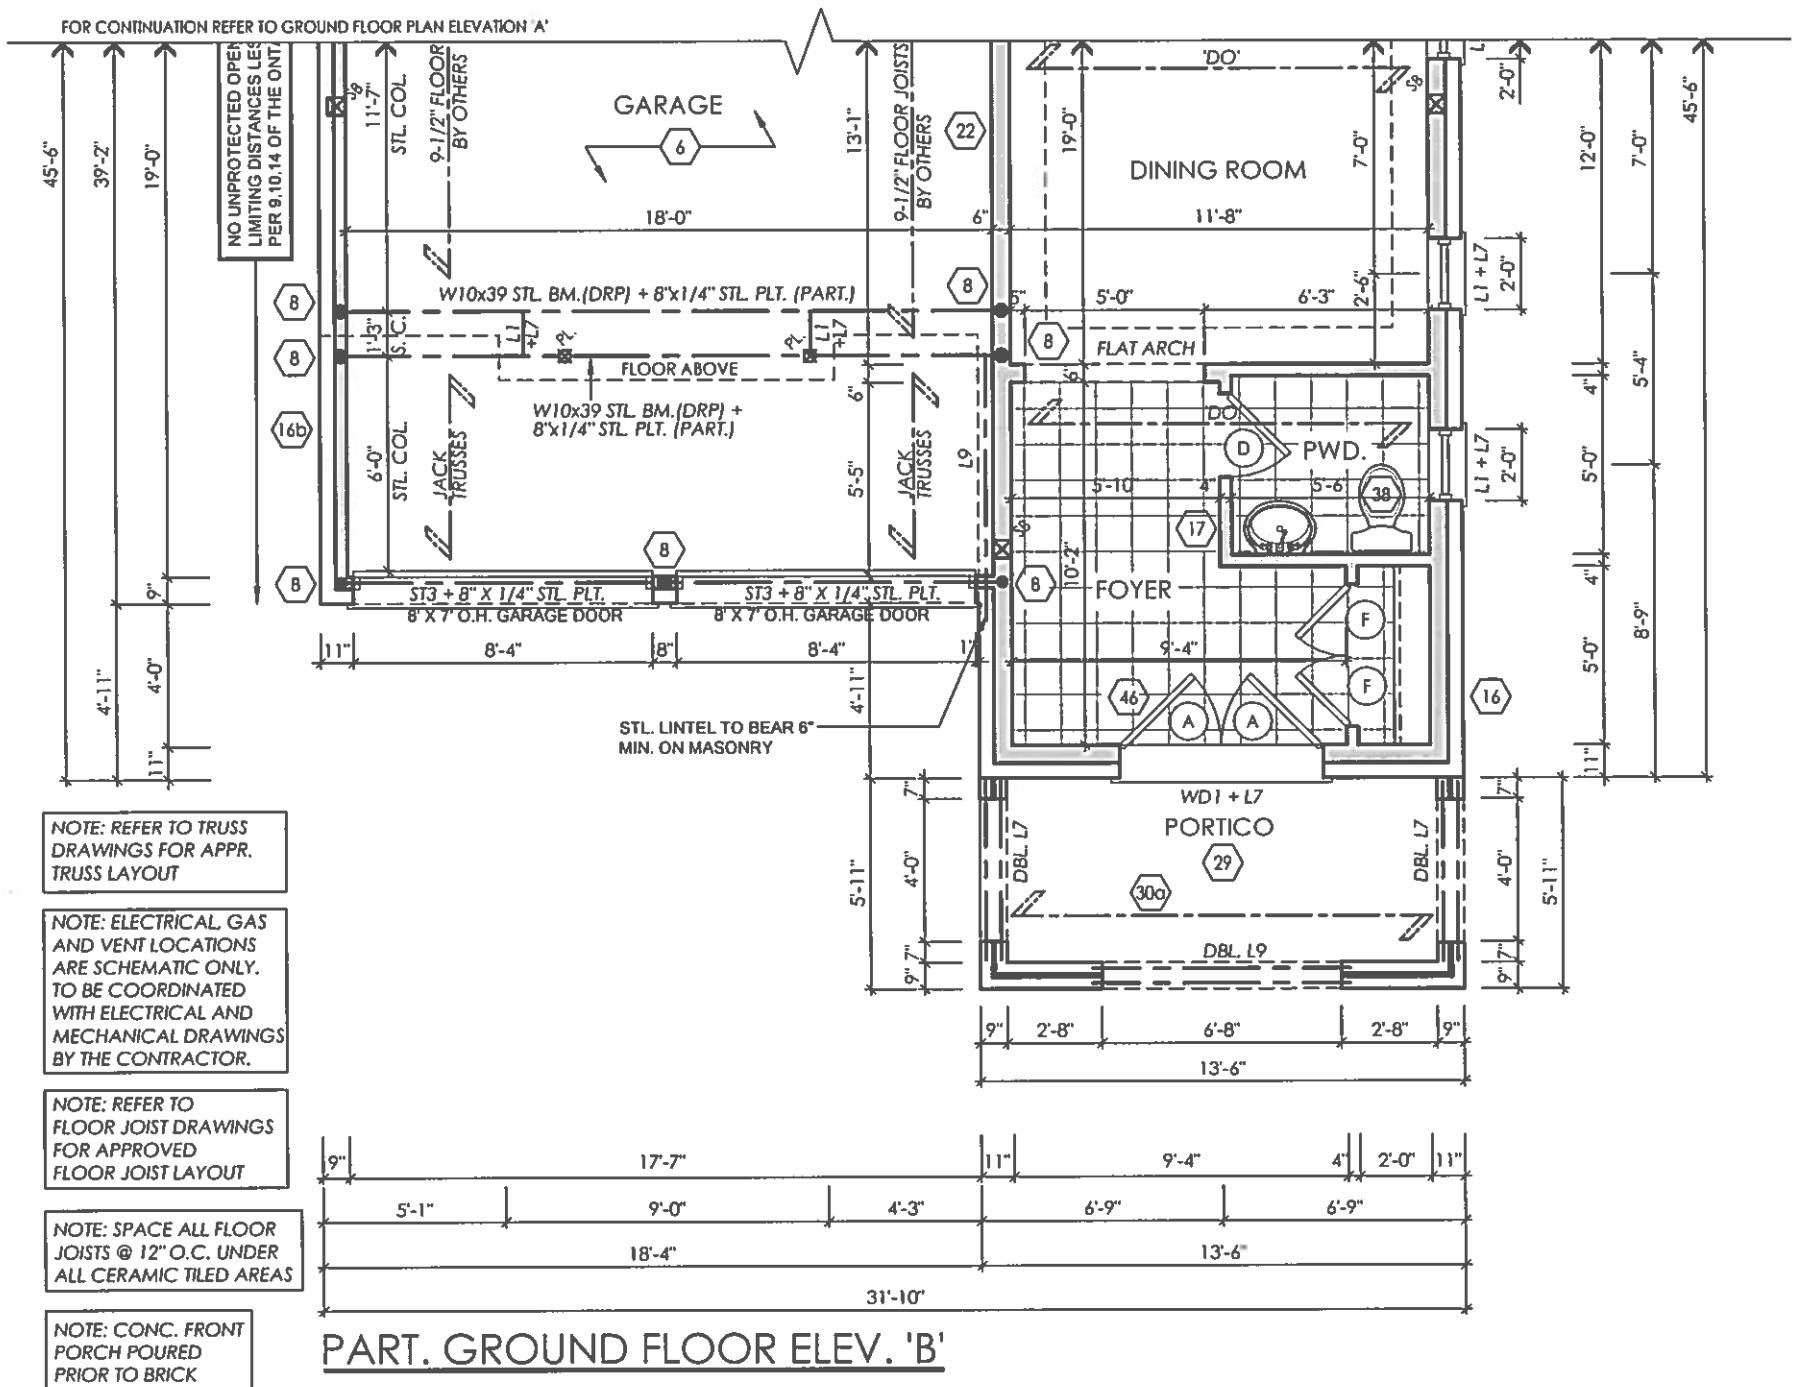

MAY 01 2017

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS

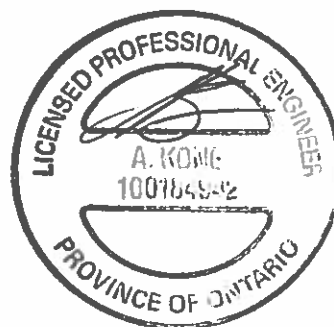

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE:

client
Gold Park Homes
project
McLaughlin and Mayfield

location
Brampton
marketing name
The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	ps	ra	5	ISSUED FOR PERMIT	6/16/2015	RPA	DJH
2	ADJUSTED STAIR LOCATION ON BSMT. & GRND. FLOOR	28-Jul-14	cr	cr	6	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH
3	FLOOR & TRUSS COORDINATION	18-Aug-14	le	dj	7				
4	DEVELOPED AS PER ENGINEERING COMM	27-Nov-15	DPA	DJH	8				

RN design
Imagine • Inspire • Create




model
38-1

scale
3/16" = 1'0"

project #
13098

page

A4

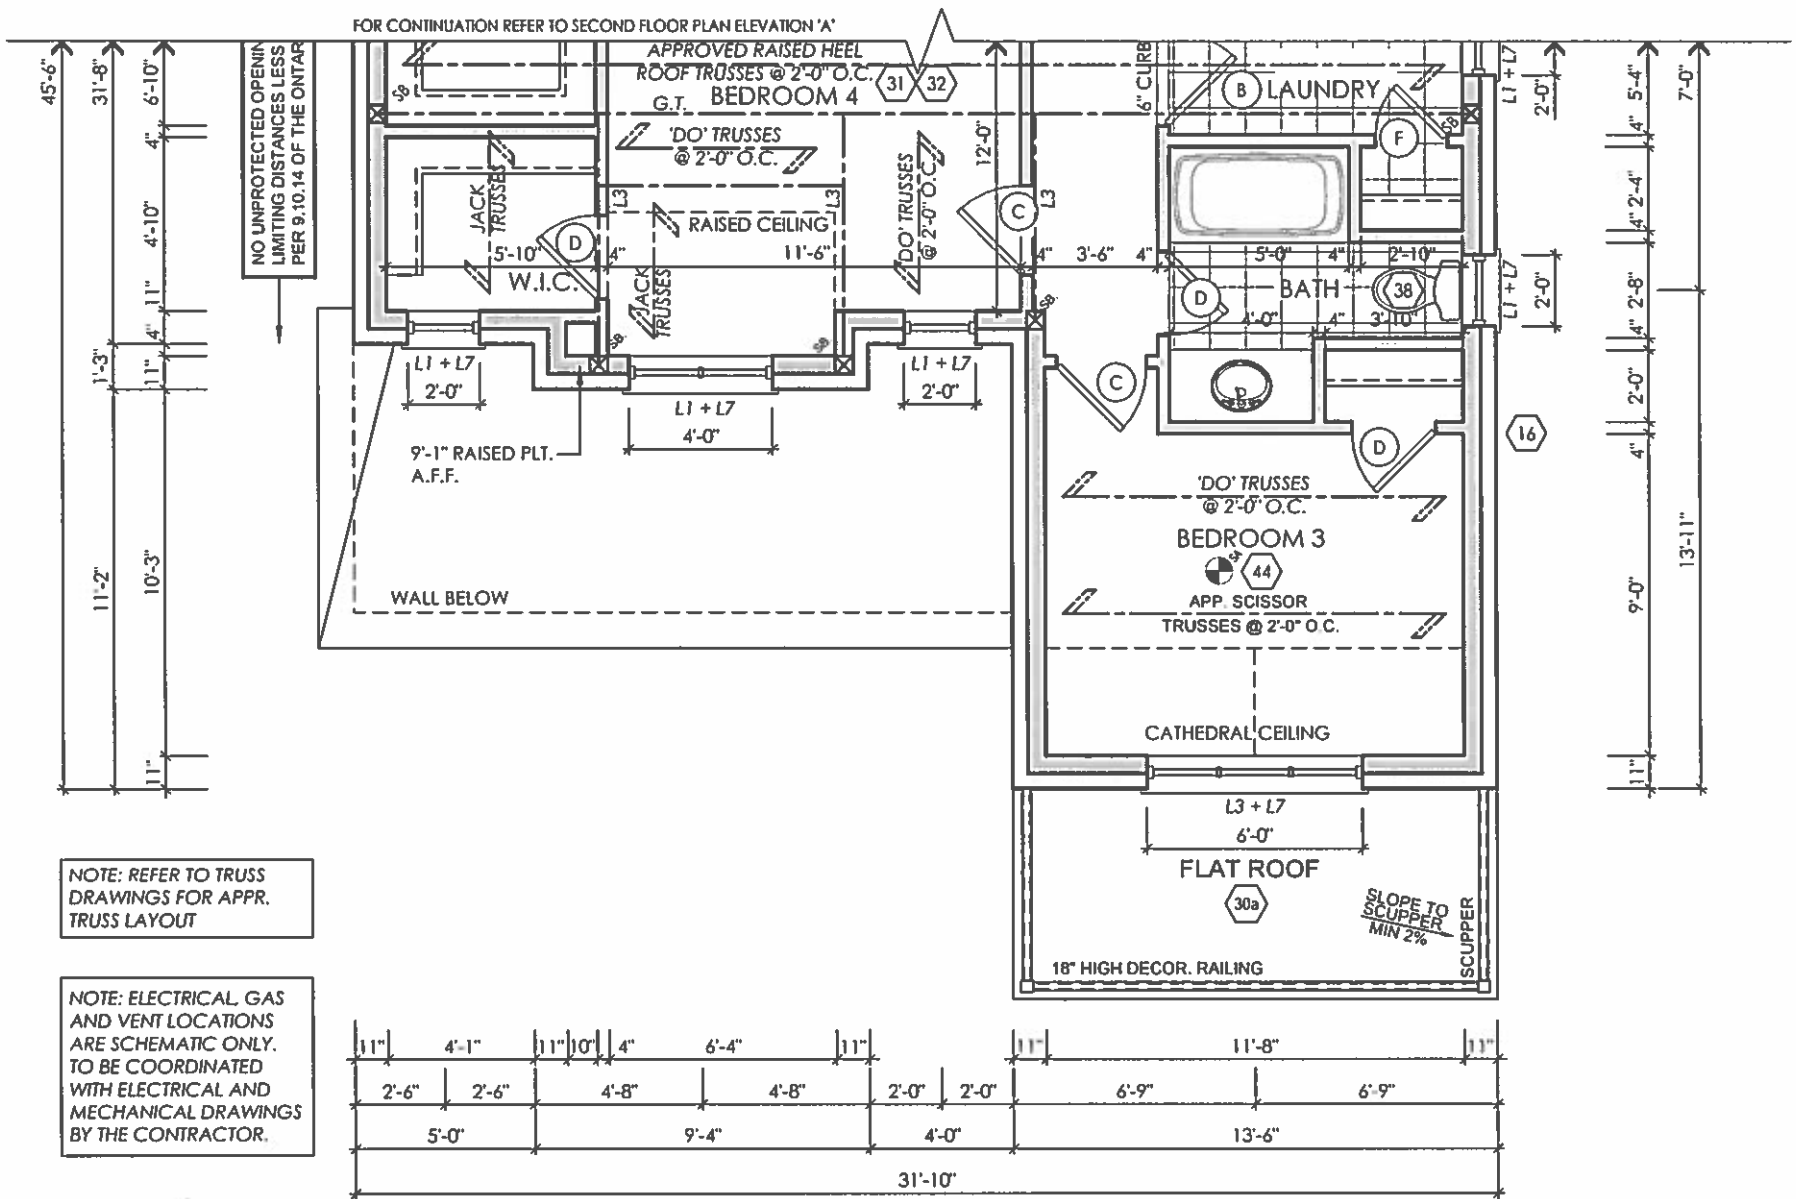

PART. SECOND FLOOR ELEV. 'B'

MAY 01 2017

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS



It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART-3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE:

Client: Gold Park Homes
Project: McLaughlin and Mayfield

Location: Brampton
Marketing name: The Bizet

RN design
Imagine • Inspire • Create

Model: 38-1


Scale: 3/16" = 1'0"

Project #: 13098

Page

A5

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	FLOOR & TRUSS COORDINATION	18-Aug-14	fe	dj	5				
2	ISSUED FOR PERMIT	6/16/2015	RPA	DJH	6				
3	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH	7				

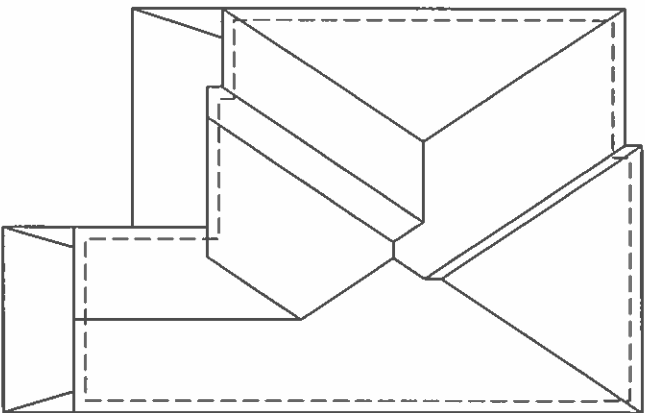

ROOF PLAN 'A'

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER. AT EACH CROSS POINT, POSTS LONGER THAN 6' TO BE Laterally Braced so that the distance between end points & between rows of bracing does not exceed 6'.

REFER TO TRUSS DRAWINGS FOR APPROVED TRUSS LAYOUT.

PRE-FINISHED ALUMINUM R.W.L. AND GUTTER ON PRE-FINISHED FASCIA BRD. AND VENTED SOFFIT 1"x6" DECOR. ALUM. CLAD FRIEZE BOARD (TYP.)

U/S OF SOFFIT & TOP OF RAISED PLATE

TOP OF PLATE

8" PRECAST HEADER ON 8" PRECAST RETURN (TYP.)

FACE BRICK (TYP.)

4"x8" PRECAST BAND

PRECAST SILL (TYP.)

U/S OF GARAGE & PORCH SOFFIT

8" PRECAST HEADER W/ CENTRE KEYSTONE (TYP.)

TOP OF BAND

2'-6"


8'-6"

U/S OF FOOTING

4'-0" (MIN.)

STEPPED FOOTING (TYP.)

FRONT ELEVATION 'A'

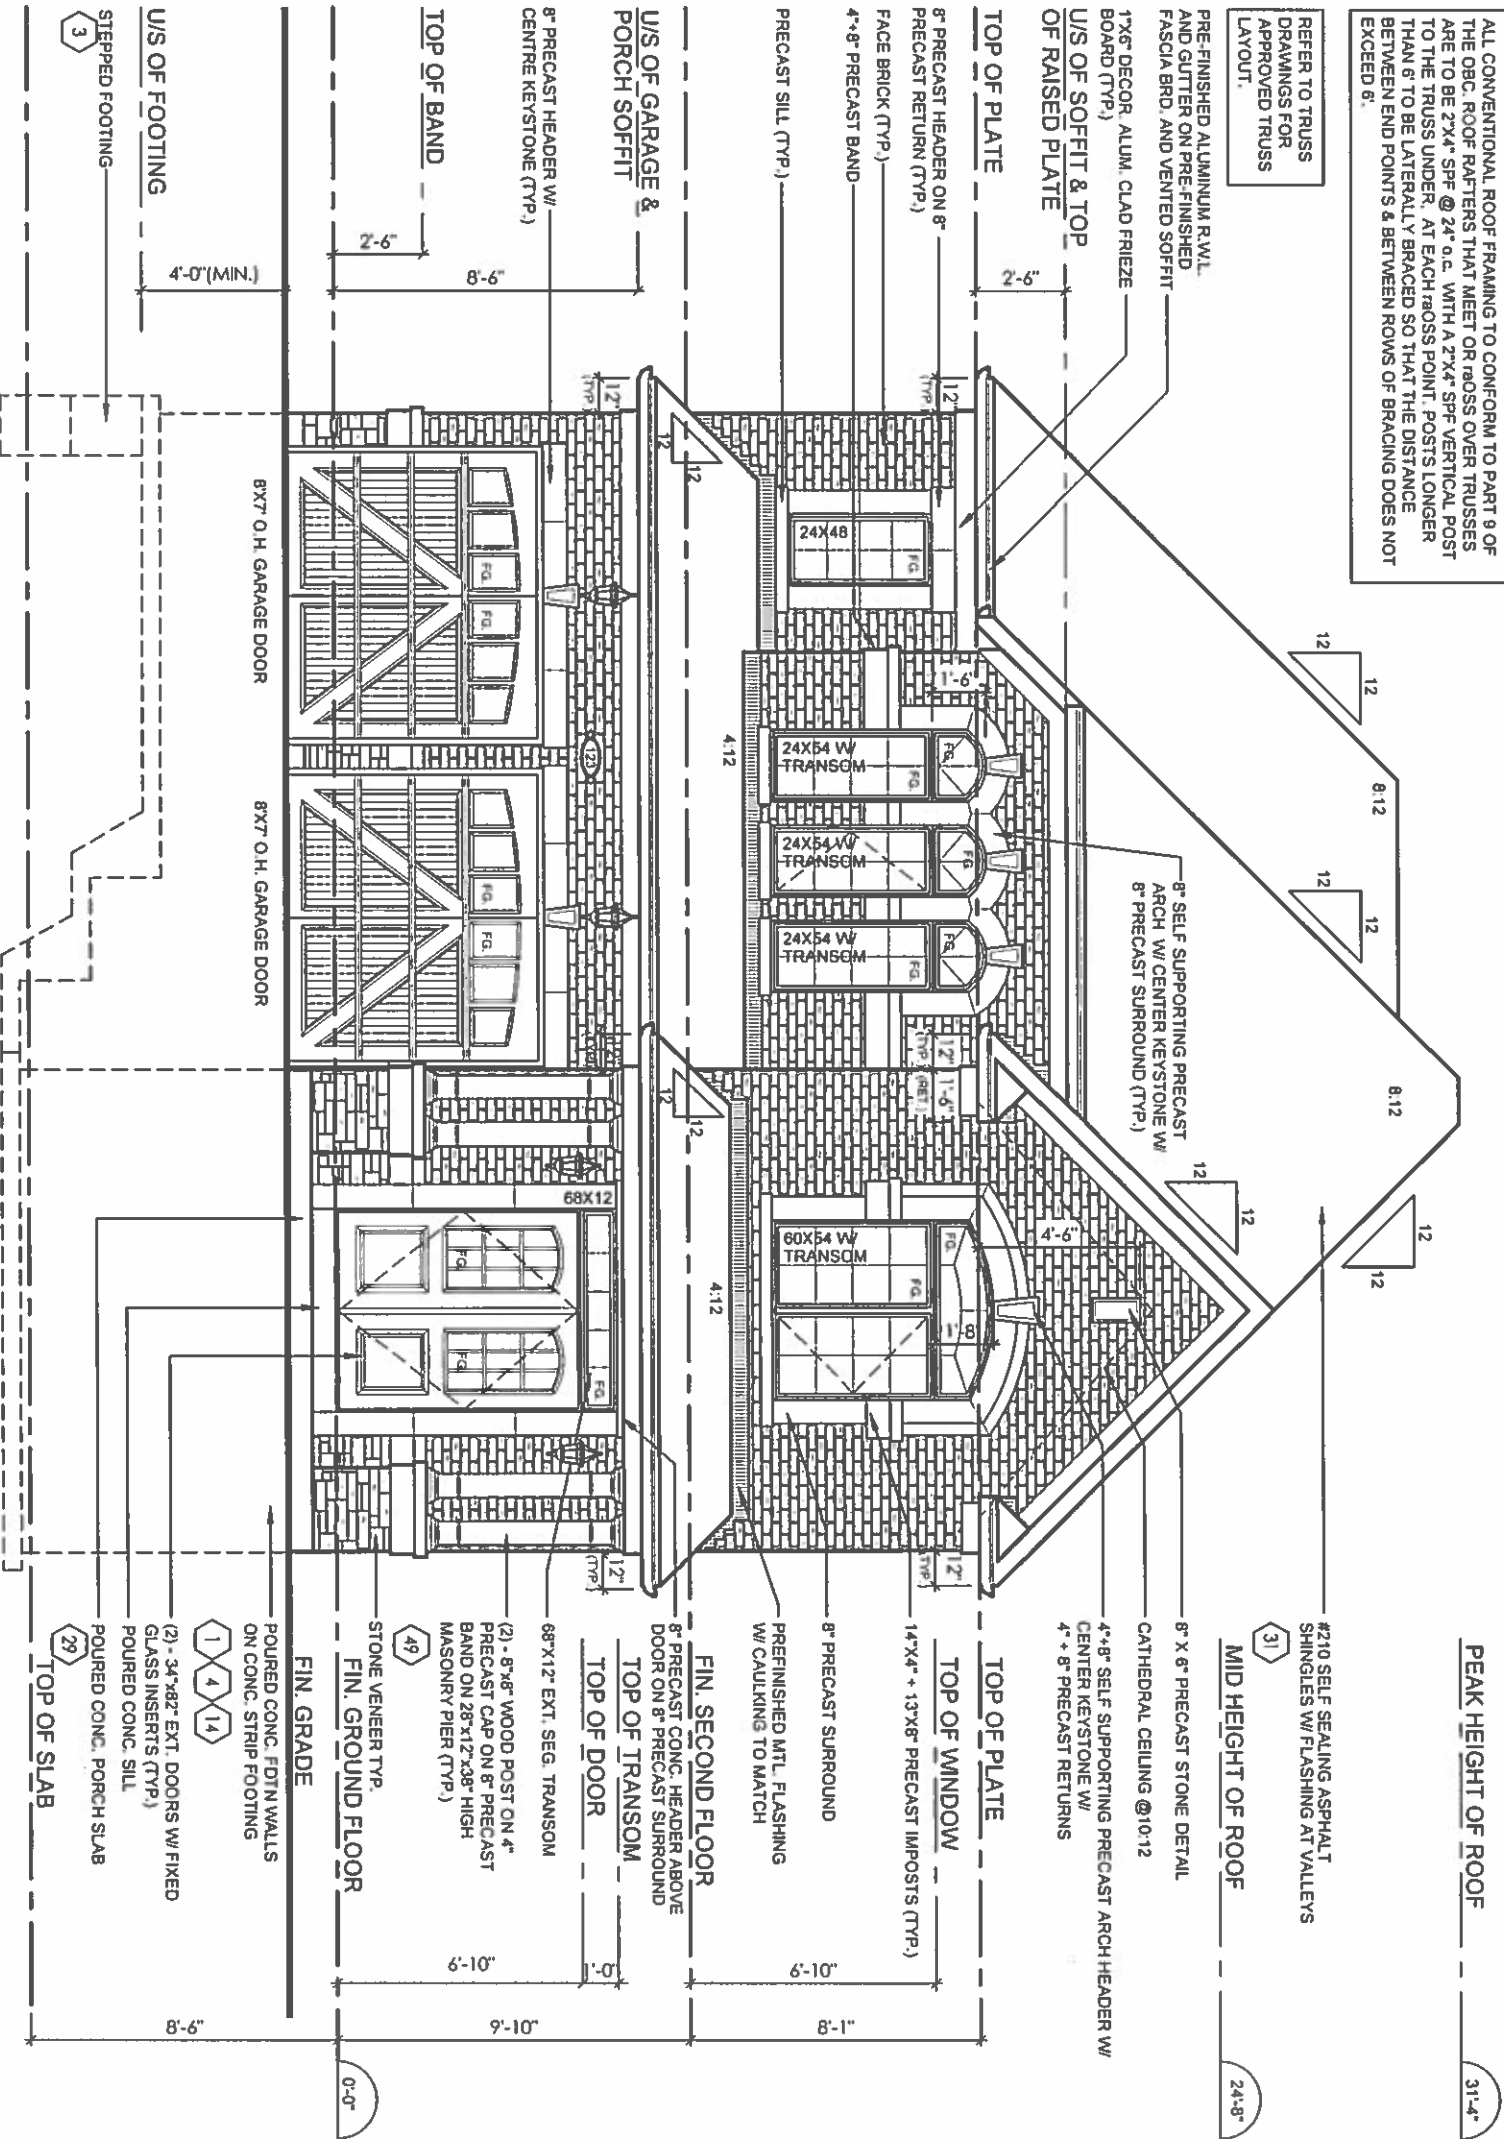

PEAK HEIGHT OF ROOF

31'-4"

MID HEIGHT OF ROOF

24'-8"

8" X 6" PRECAST STONE DETAIL

8" SELF SUPPORTING PRECAST ARCH W/ CENTER KEYSTONE W/ 8" PRECAST SURROUND (TYP.)

4"x8" SELF SUPPORTING PRECAST ARCH HEADER W/ CENTER KEYSTONE W/ 4" + 8" PRECAST RETURNS

TOP OF PLATE

TOP OF WINDOW

14"x4" + 13"x6" PRECAST IMPOSTS (TYP.)

8" PRECAST SURROUND

PRE-FINISHED MTL. FLASHING W/ CAULKING TO MATCH

FIN. SECOND FLOOR

8" PRECAST CONC. HEADER ABOVE DOOR ON 8" PRECAST SURROUND

TOP OF TRANSOM

TOP OF DOOR

68"x12" EXT. SEG. TRANSOM

(2) - 8"x6" WOOD POST ON 4" PRECAST CAP ON 8" PRECAST BAND ON 28"x12"x38" HIGH MASONRY PIER (TYP.)

STONE VENEER TYP.

FIN. GROUND FLOOR

FIN. GRADE

POURED CONC. FDTN WALLS ON CONC. STRIP FOOTING

(1) (4) (14)

(2) - 34"x82" EXT. DOORS W/ FIXED GLASS INSERTS (TYP.)

POURED CONC. SILL

POURED CONC. PORCH SLAB

TOP OF SLAB

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES. QUALIFIED DESIGNER BCIN: 38688 26995 DATE: JUNE 21/16

SIGNATURE:

client Gold Park Homes
project McLaughlin and Mayfield

location Brampton
marketing name The Bizez

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	ps	ra	5				
2	REVISED AS PER ARCH CONTROL COMMENTS.	8/18/2014	tpa	DJH	6				
3	ISSUED FOR PERMIT	6/16/2015	RPA	DJH	7				
4	ISSUED FOR CONSTRUCTION	9/17/2015	CS	DJH	8				


RN design
Imagine • Inspire • Create



model 38-1
scale 3/16" = 1'0"
project # 13098

page

A6

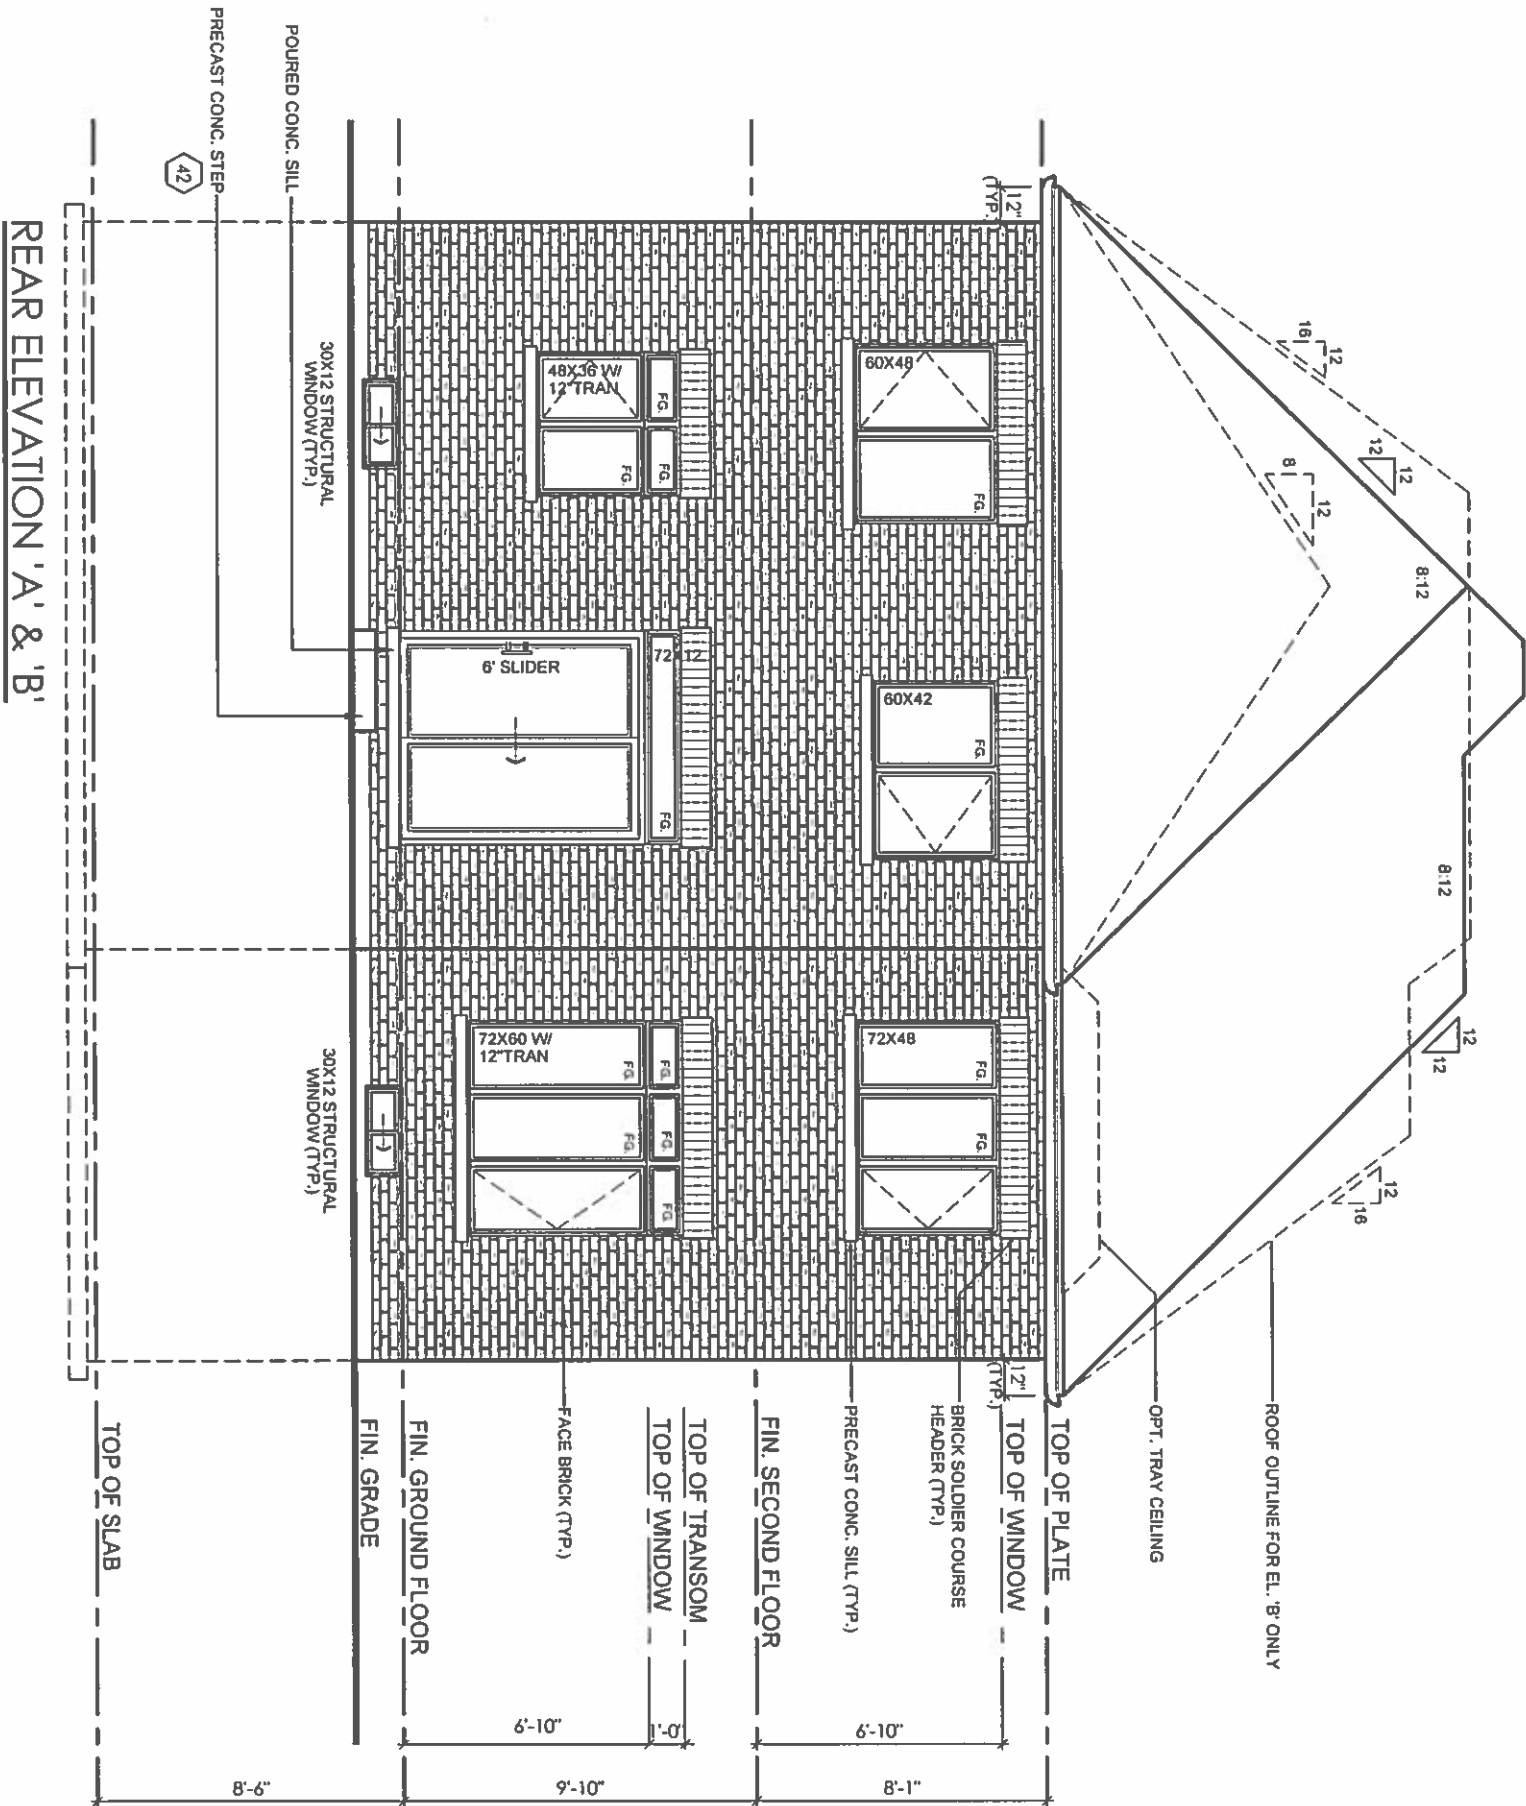

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART-3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES. QUALIFIED DESIGNER BCIN: 38688 FIRM BCIN: 26995 DATE: JUNE 21/16

SIGNATURE:

client
Gold Park Homes
project
McLaughlin and Mayfield

location
Brampton
marketing name
The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	PS	JO	5				
2	ISSUED FOR PERMIT	6/16/2015	RPA	DJH	6				
3	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH	7				
4					8				


RN design
Imagine • Inspire • Create



model
38-1
scale
3/16" = 1'0"
project #
13098

page

A8

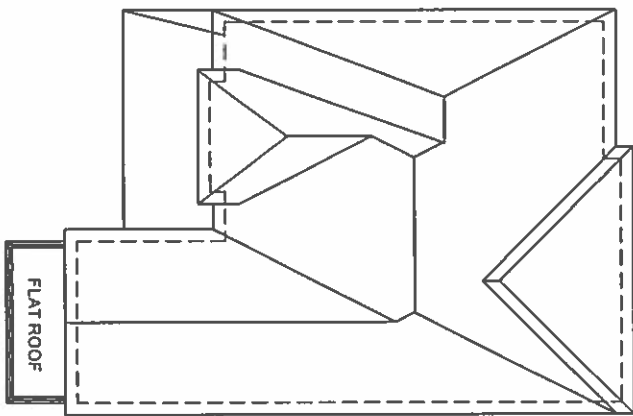

ROOF PLAN 'B'

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC. ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER. AT EACH CROSS POINT, POSTS LONGER THAN 6' TO BE Laterally BRACED SO THAT THE DISTANCE BETWEEN END POINTS & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

REFER TO TRUSS DRAWINGS FOR APPROVED TRUSS LAYOUT.

PRE-FINISHED ALUMINUM R.W.L. AND GUTTER ON PRE-FINISHED FASCIA BRD. AND VENTED SOFFIT

1"x6" DECOR. ALUM. CLAD FRIEZE BOARD (TYP.)

U/S OF RAISED SOFFIT

8" PRECAST HEADER & SURROUND (TYP.)

FACE BRICK (TYP.)

PRECAST SILL (TYP.)

U/S OF GARAGE

8" PRECAST HEADER (TYP.)

TOP OF BAND
CONTINUOUS 4"x8"
PRECAST CONC. BAND

U/S OF FOOTING

3
STEPPED FOOTING

PEAK HEIGHT OF ROOF

6"x20" DECOR. WOOD BRACKET (TYP.)

MID HEIGHT OF ROOF

RAISED SEAMED METAL ROOF

6"x20" DECOR. WOOD BRACKET (TYP.)

CATHEDRAL CEILING @ 8:12 INT. SLOPE

12"x10" PRECAST CONC. CORNICE DETAIL

TOP OF PLATE

TOP OF WINDOW

TOP OF BAND

4"x8" PRECAST BAND

DBL. PRECAST CONC. SILL

18" HIGH PRE-FINISHED METAL RAILING

16" BUILT-UP PRECAST DETAIL

FIN. SECOND FLOOR

TOP OF TRANSOM & U/S OF FLAT ARCH

TOP OF DOOR

68"x12" TRANSOM

8" PRECAST HEADER & SURROUND (TYP.)

STONE VENEER TYP.

FIN. GROUND FLOOR

FIN. GRADE

POURED CONC. FDN WALLS ON CONC. STRIP FOOTING

1
4
14

(2) - 34"x82" EXT. DOORS W/ FIXED GLASS INSERTS (TYP.)

POURED CONC. SILL

POURED CONC. PORCH SLAB

29
TOP OF SLAB

FRONT ELEVATION 'B'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE:

Client Gold Park Homes

location Brampton

project McLaughlin and Mayfield

marketing name The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	ps	tpa	5				
2	REVISED AS PER ARCH. CONTROL COMM.	8/18/2014	tpa	DJH	6				
3	ISSUED FOR PERMIT	6/16/2015	RPA	DJH	7				
4	REVISED FOR CONSTRUCTION	9/17/2015	CR	DJH	8				

RN design
Imagine • Inspire • Create



model 38-1


scale 3/16" = 1'0"

project # 13098

page

A10

ALLOWABLE UNPROTECTED OPENINGS	
TOTAL WALL AREA	875.98 SF
LIMITING DISTANCE	4.0 FT
ALLOWABLE OPENINGS	61.31 SF
ACTUAL OPENINGS	54.48 SF

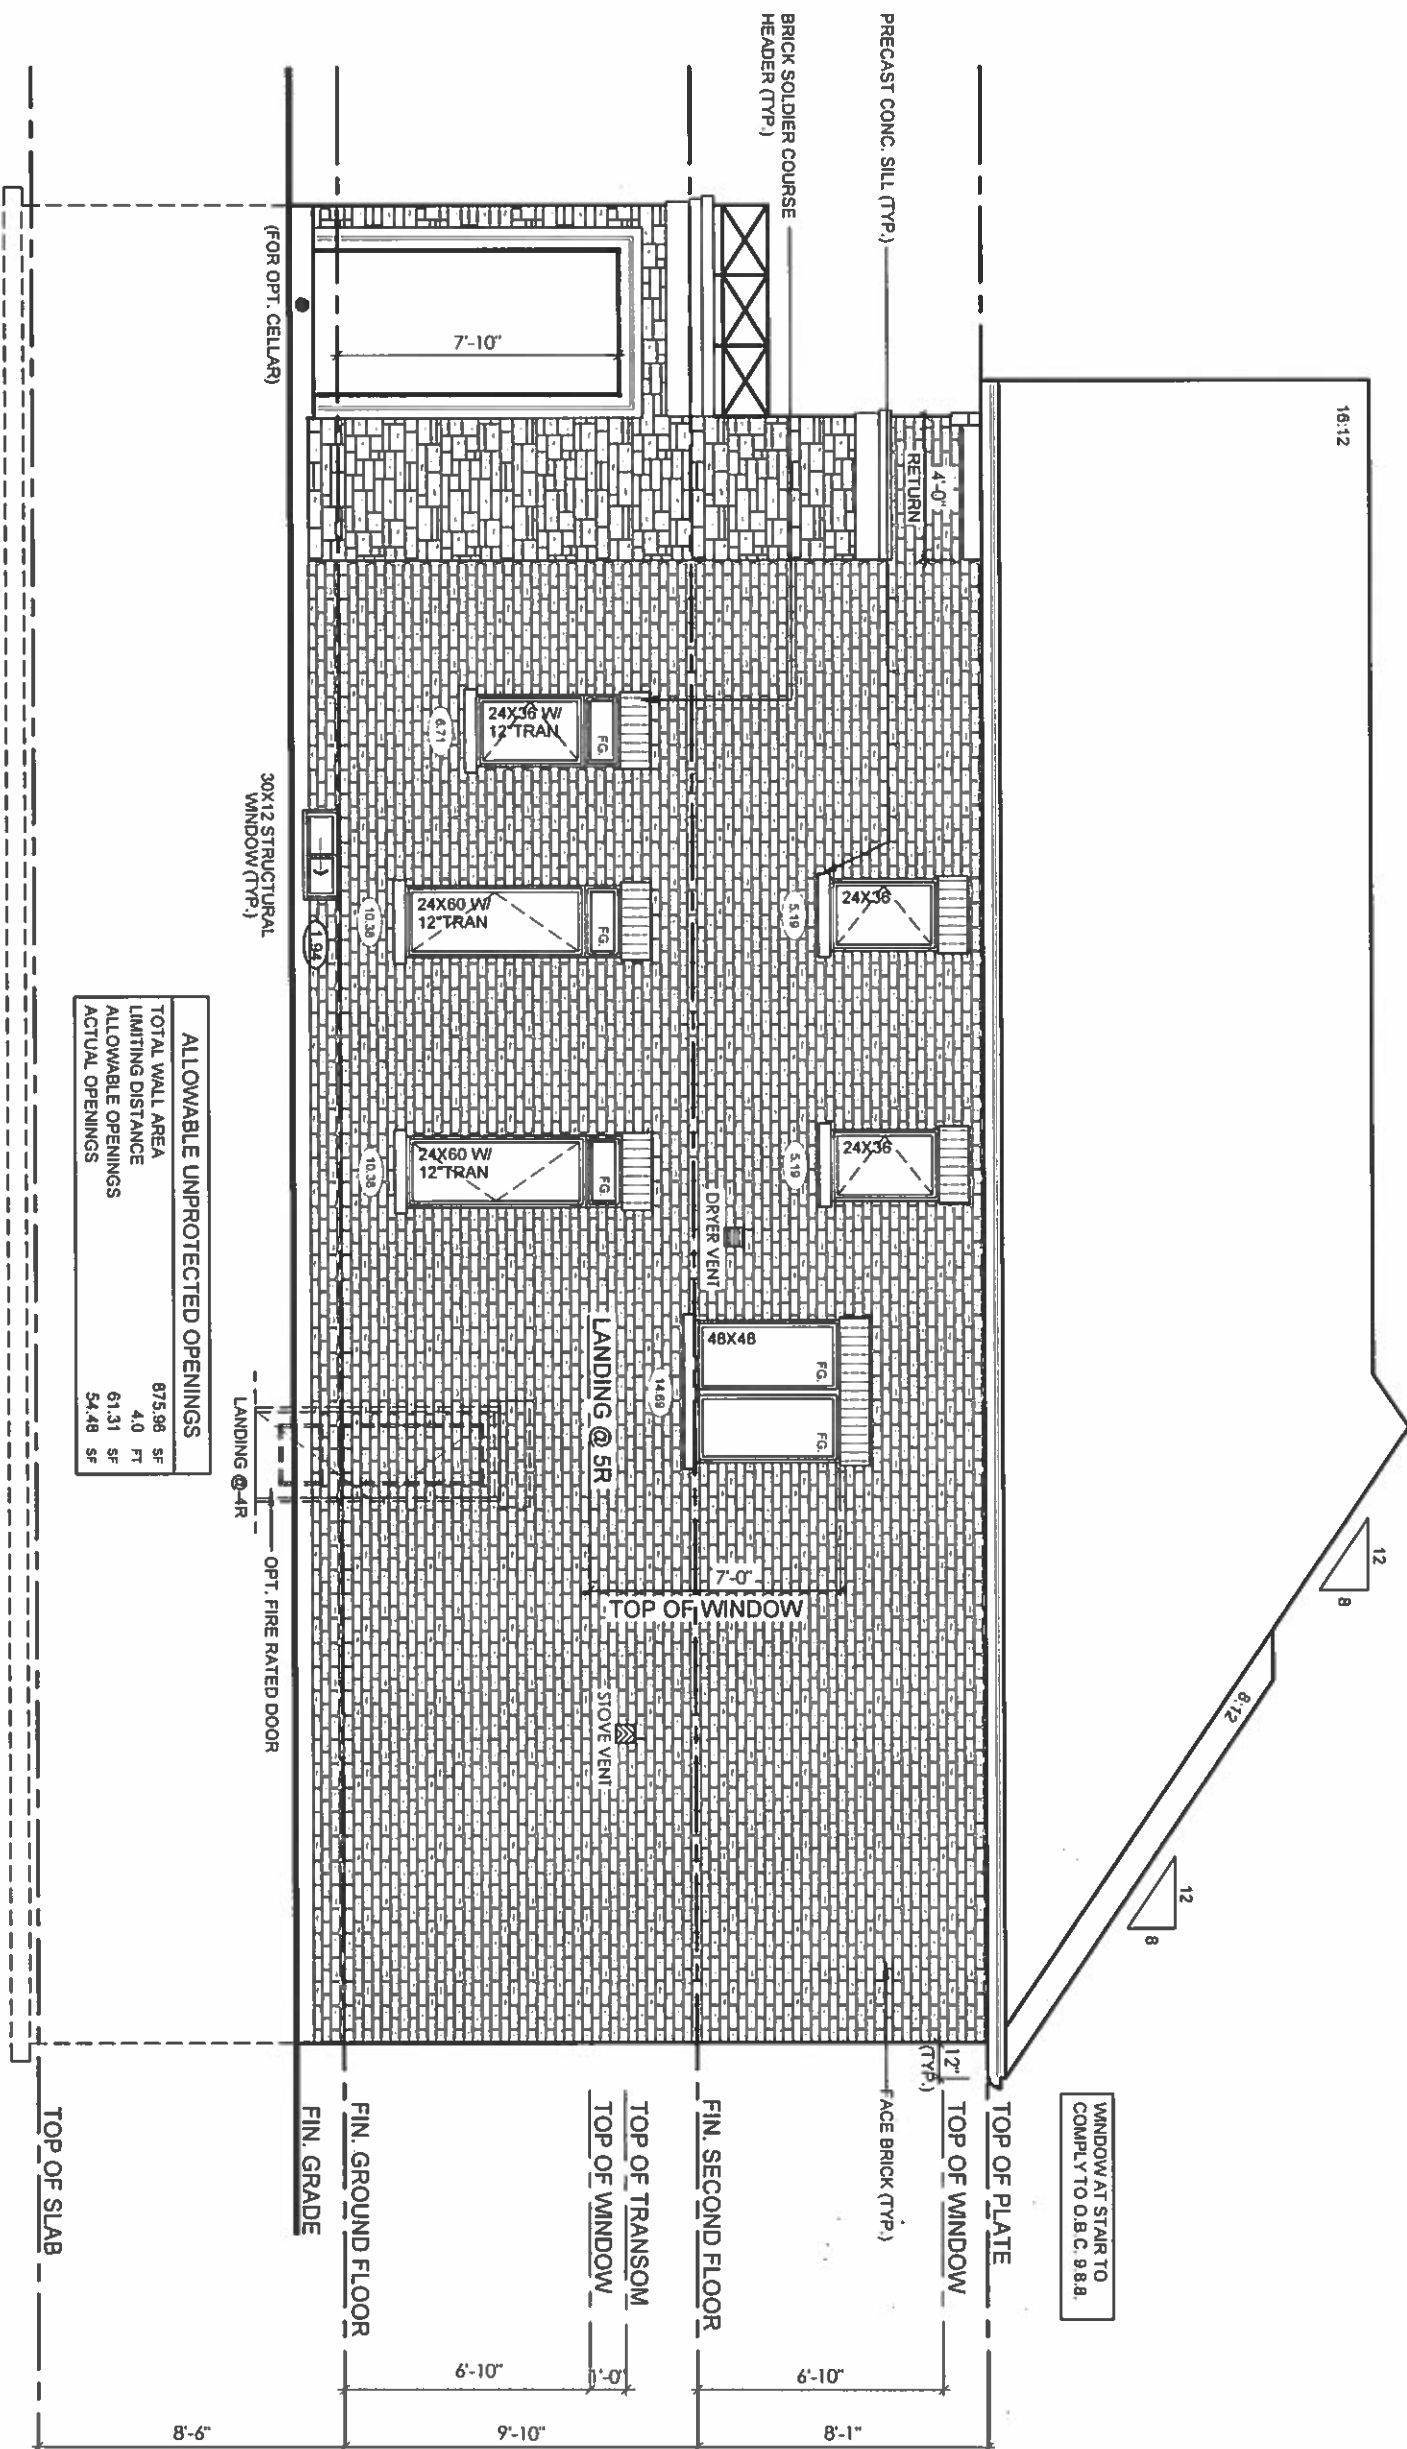

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

RALE

HA

N. JULIO PINZON. DECLARE THAT I HAVE REVIEWED AND
TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK
ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C.PART-3
SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM
QUALIFIED AND THE FIRM IS REGISTERED IN THE
APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: 11/17 JUNE 21/14

SIGNATURE:

client
Gold Park Homes

location
Brampton

project
Mclaughlin and Mayfield

marketing name
The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	PS	JA	5				
2	ISSUED FOR PERMIT	6/16/2015	RPA	DJH	6				
3	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH	7				

RN design
Imagine • Inspire • Create



model
38-1


scale
3/16" = 1'0"

project #
13098

page

A11

LEFT SIDE ELEVATION 'B'

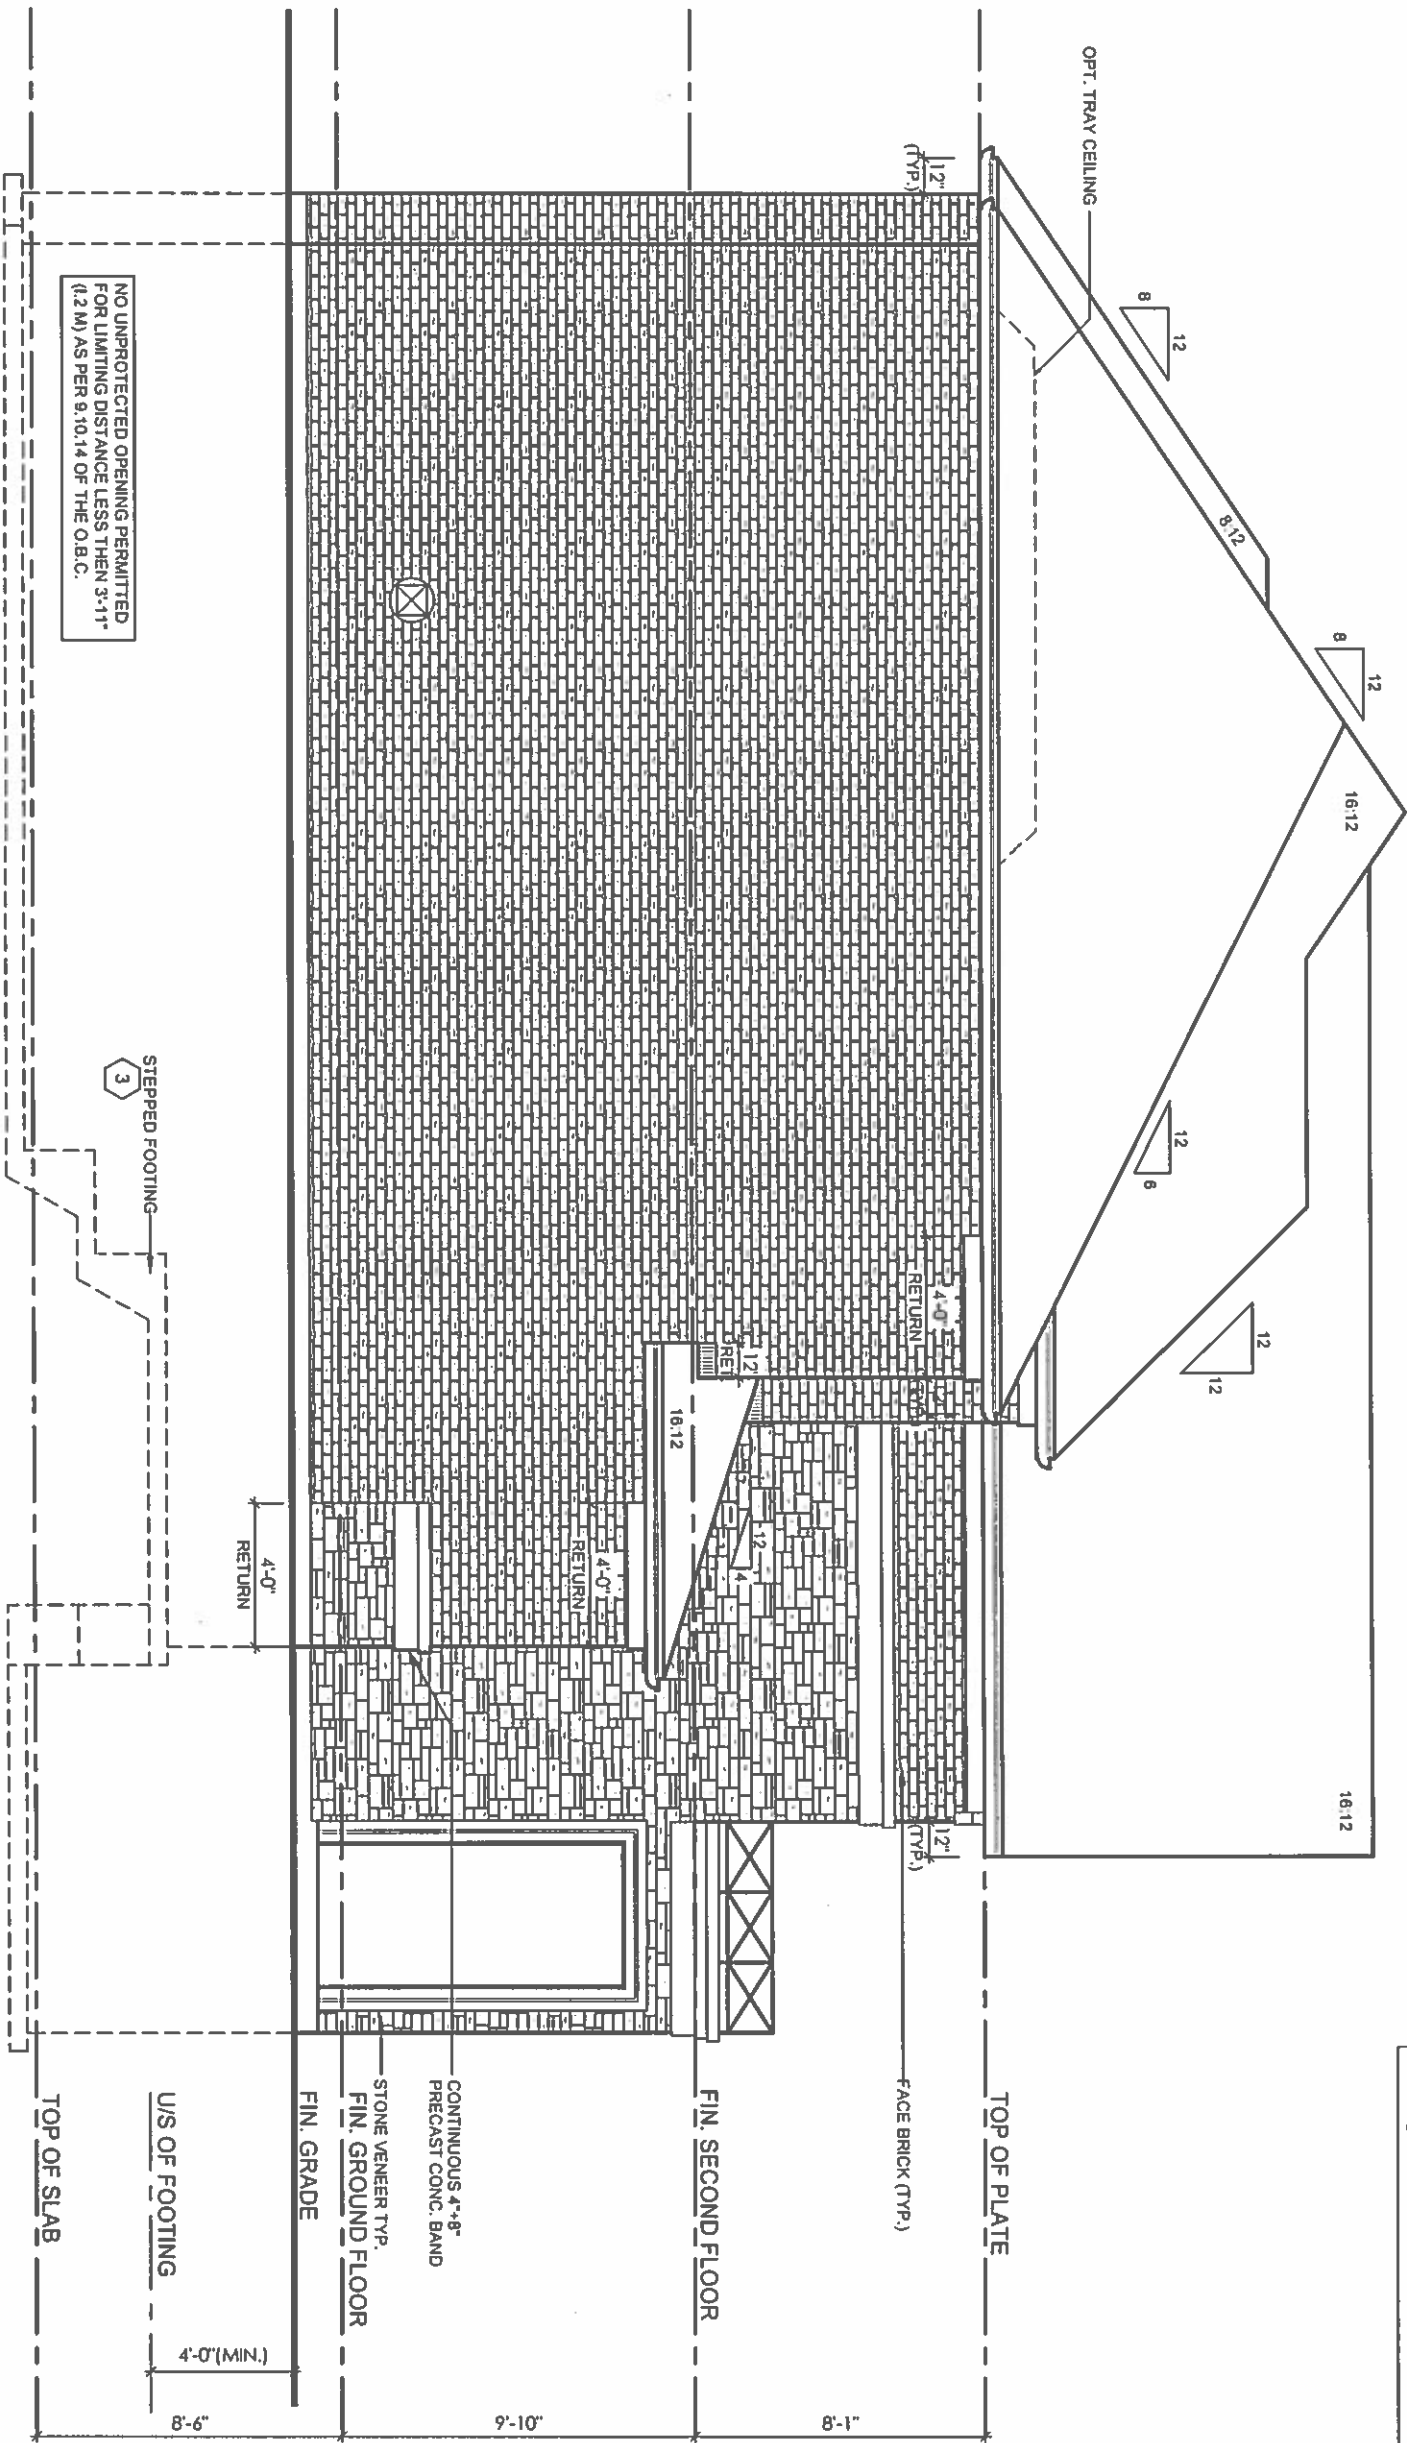

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE:

client Gold Park Homes
project Mclaughlin and Mayfield

location Brampton
marketing name The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	ps	rpa	5				
2	REVISED AS PER ARCH. CONTROL COMM.	8/18/2014	rpa	DJH	6				
3	ISSUED FOR PERMIT	6/16/2015	RFA	DJH	7				
4	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH	8				

RN design
Imagine • Inspire • Create



model 38-1


scale 3/16" = 1'0"

project # 13098

page

A12

TYPICAL CROSS-SECTION
SCALE: N.T.S.

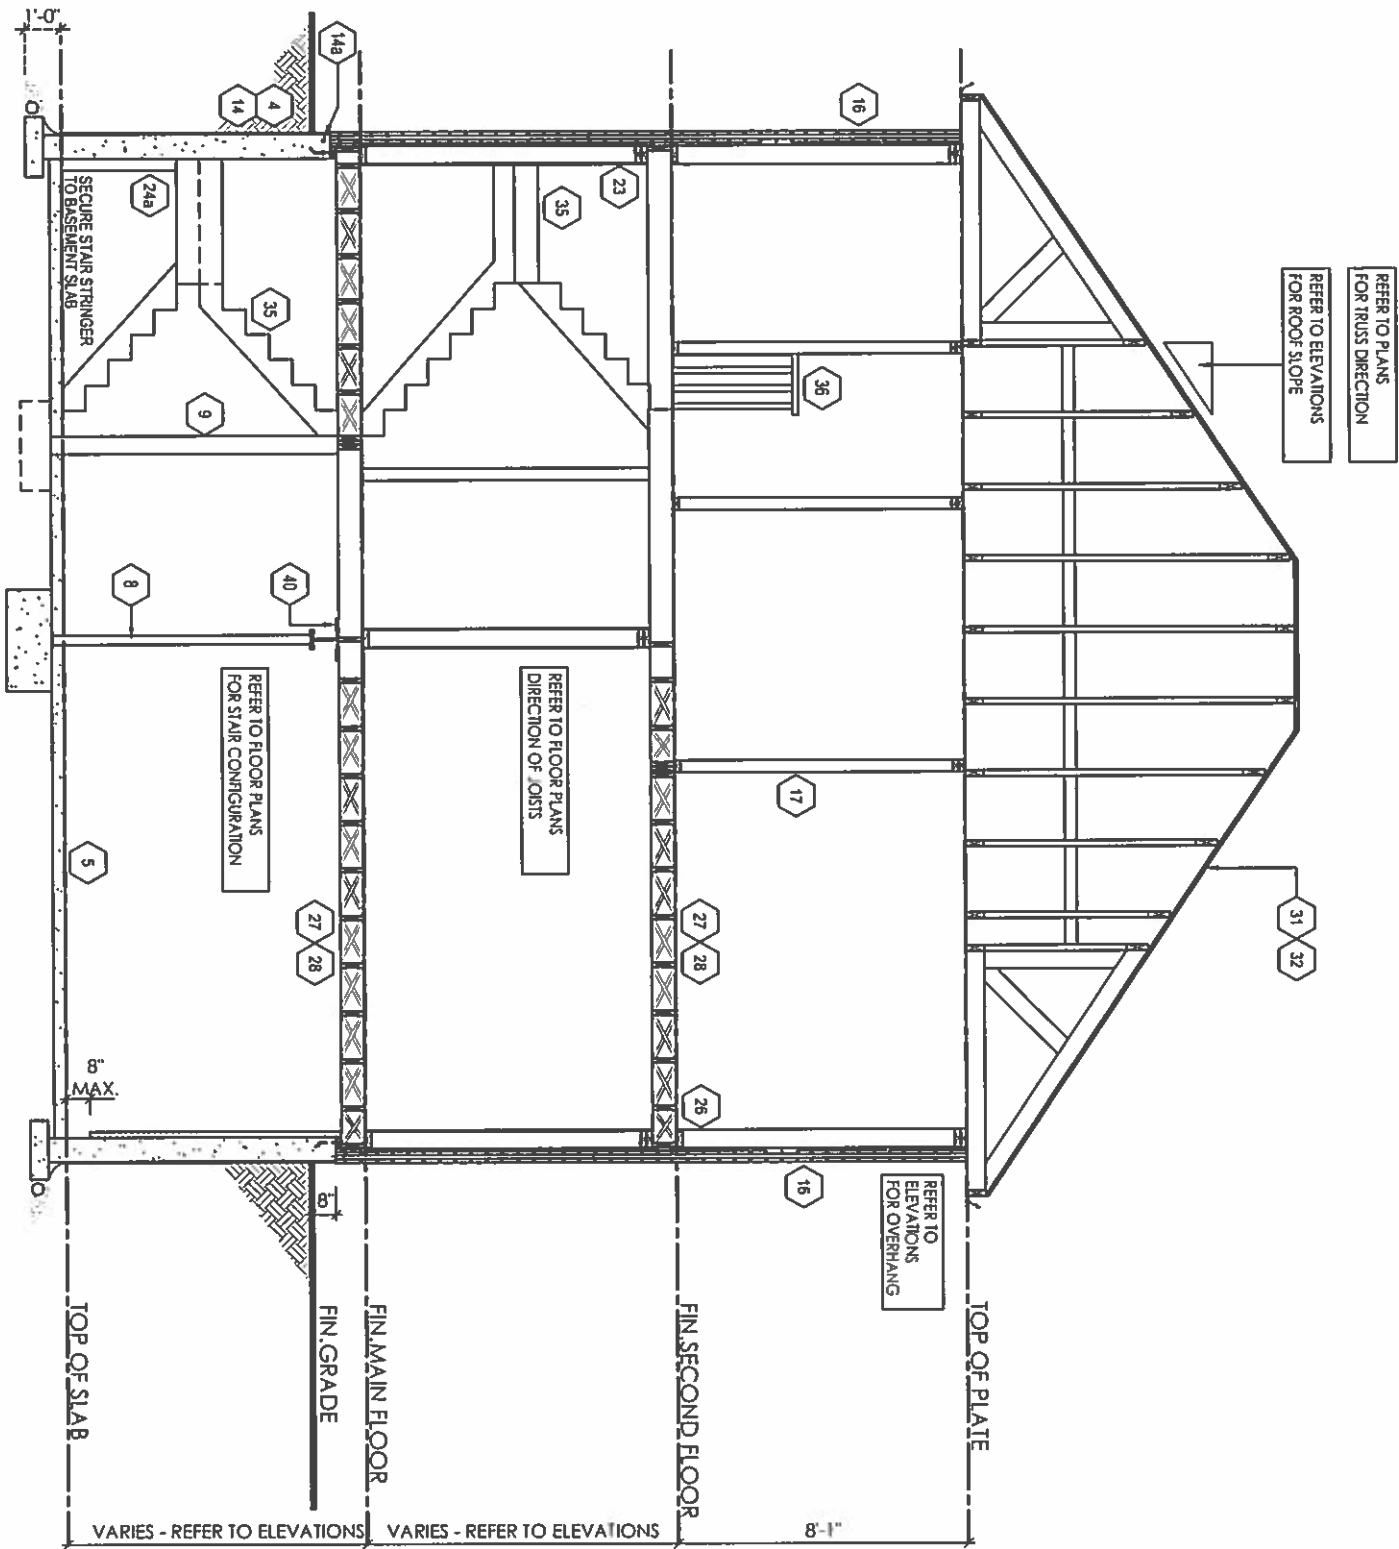

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LTD.** UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE:

[Handwritten Signature]

client
Gold Park Homes
project
McLaughlin and Mayfield

location
Brampton
marketing name
The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	ps	ia	5				
2	ISSUED FOR PERMIT	6/16/2015	RPA	DJH	6				
3	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH	7				
4					8				

RN design
Imagine • Inspire • Create



model
38-1


scale
3/16" = 1'0"

project #
13098

page

A13

PARTIAL BASEMENT FLOOR PLAN ELEV. 'A' & 'B'
LOB CONDITION

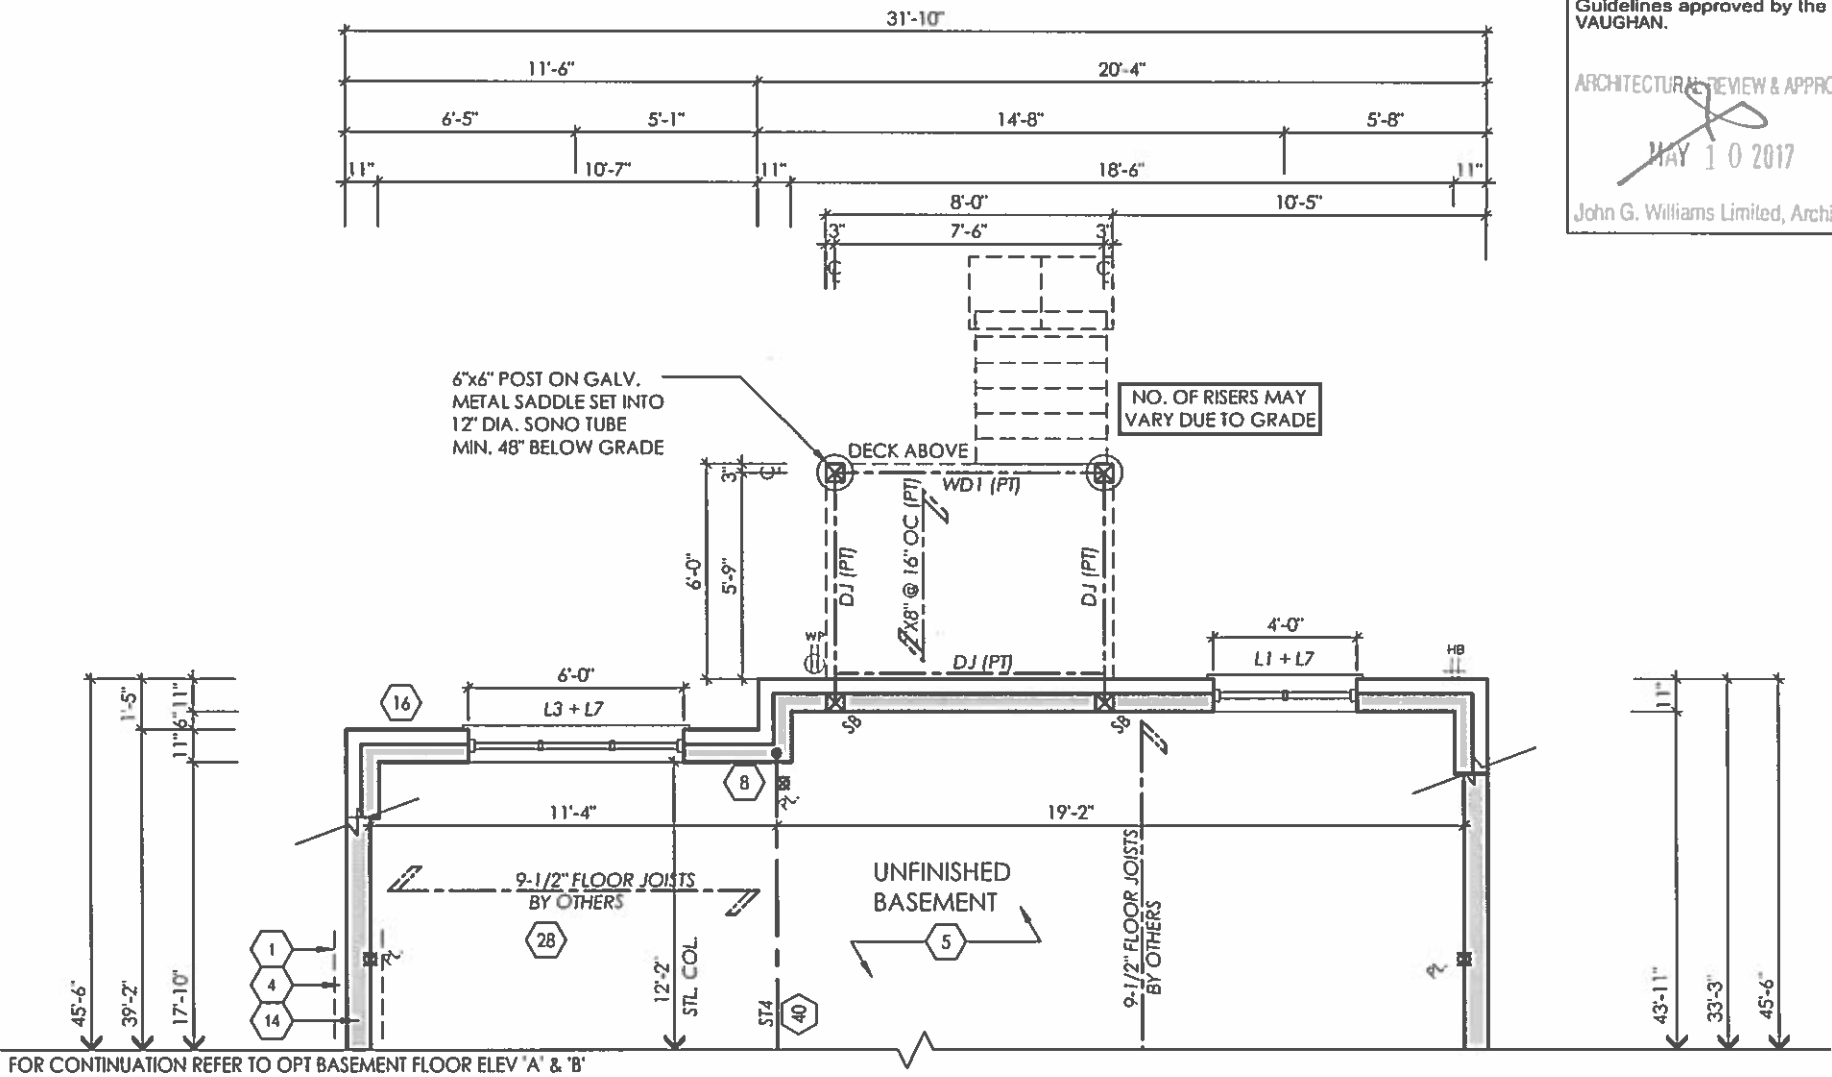

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.


This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

PARTIAL GROUND FLOOR PLAN ELEV. 'A' & 'B'
LOB CONDITION

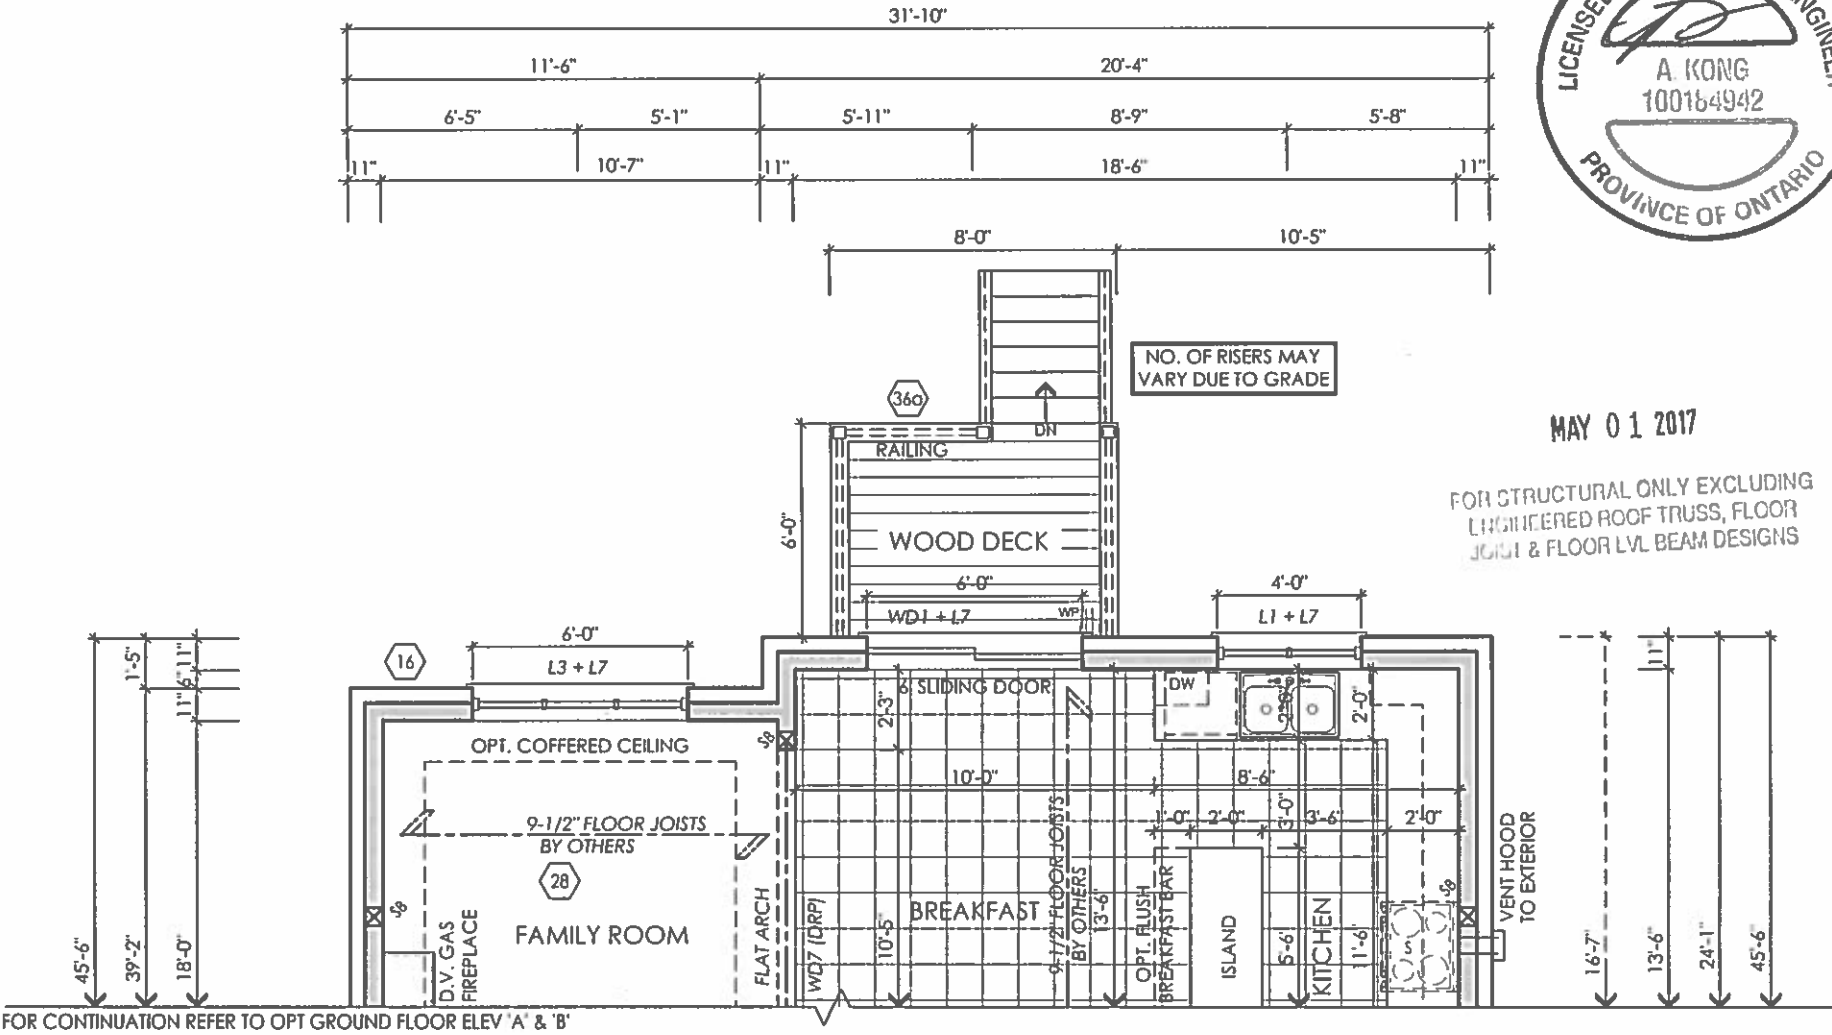

MAY 01 2017

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
FIRM BCIN: 26995
DATE: JUNE 21/16

SIGNATURE: *[Signature]*

client
Gold Park Homes

location
Brampton

project
McLaughlin and Mayfield

marketing name
The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	6-MAY-16	SM	JM					
2	ISSUED FOR PERMIT	27-MAY-16	SM	JP					

model
38-1

scale
3/16" = 1'0"

project #
13098

page
A14

ARN design
Imagine • Inspire • Create


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines prepared by the City of VAUGHAN.

ARCHITECTURAL REVIEW & APPROVAL

MAY 10 2017

John G. Williams Limited, Architect

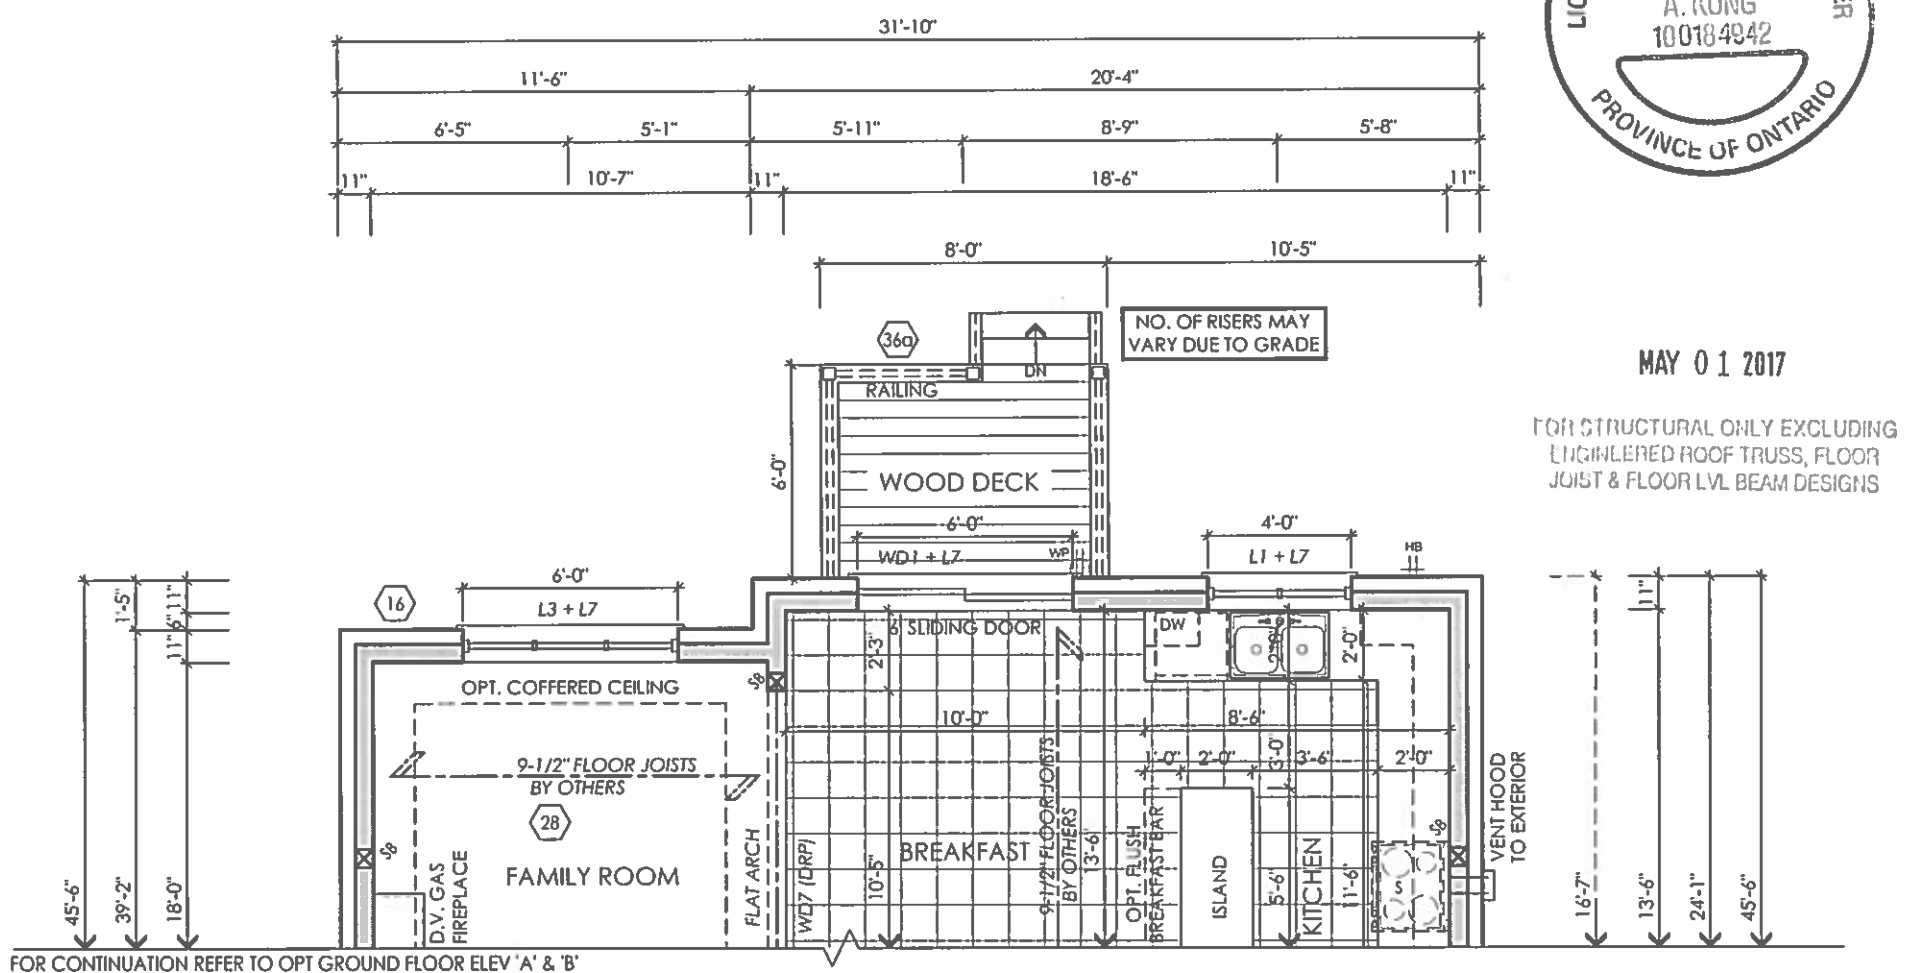

MAY 01 2017

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
 FIRM BCIN: 26995
 DATE: JUNE 21/16
 SIGNATURE: 

client
Gold Park Homes

project McLaughlin and Mayfield

location
Brampton

marketing name
The Bizet

RN design
Imagine • Inspire • Create


model
38-1

scale
 $3/16" = 1'0"$

project #
13098

page

A16

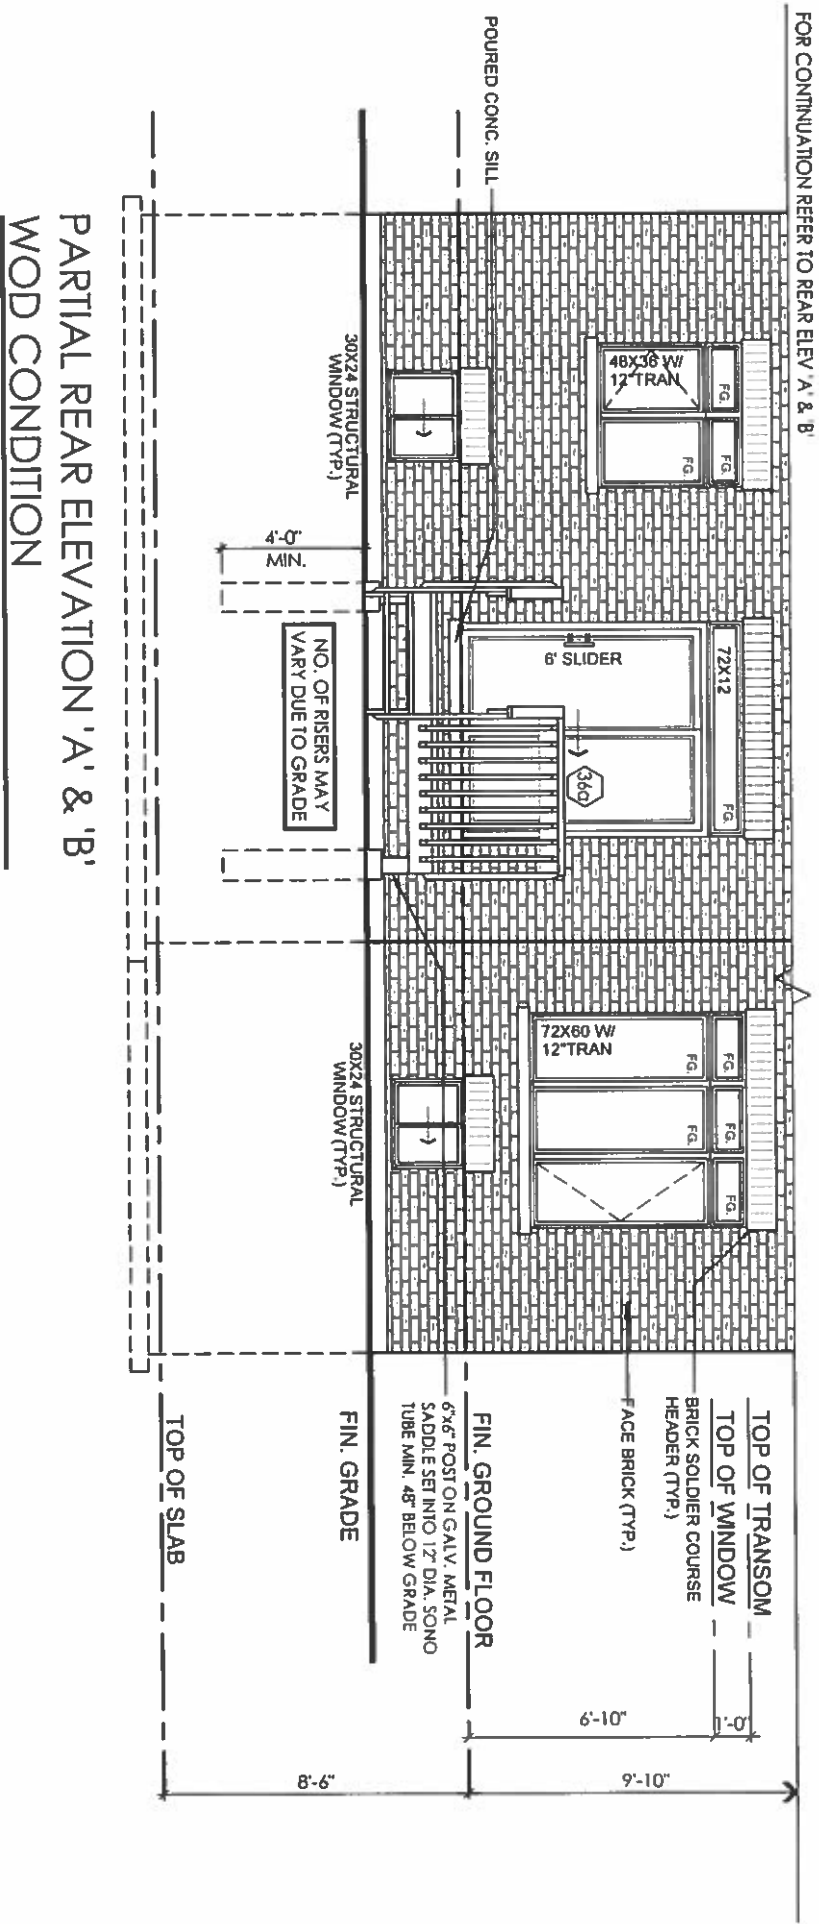


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

ARCHITECTURAL REVIEW & APPROVAL

 MAY 10 2017
 JUDITH G. WINDMILLS LIMITED, ARCHITECT

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688
 FIRM BCIN: 26995
 DATE: JUNE 21/16
 SIGNATURE: 

client
 Gold Park Homes

project
 McLaughlin and Mayfield

location
 Brampton

marketing name
 The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	6-MAY-16	SM	JM					
2	ISSUED FOR PERMIT	27-MAY-16	SM	JP					

RN design
 Imagine • Inspire • Create



model
 38-1

scale
 3/16" = 1'0"

project #
 13098

page
 A17

CONSTRUCTION NOTES:

COMPLIANCE PACKAGE A1 - OBC 2012 - 2017 ENACTMENT

(UNLESS OTHERWISE NOTED)

- ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION.
- ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC.
- THERMAL RESISTANCE VALUES BASED ON ZONE 1

FOOTINGS / SLABS:

TYPICAL STRIP FOOTING:

- O.B.C. 9.15.3.
- BASED ON 16'-1 7/8" MAX. SUPPORTED JOIST LENGTH
- MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
- SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10.9psi (75kPa) BEARING CAPACITY
- FTG. TO HAVE CONTINUOUS KEY
- FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT)

TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

- O.B.C. 9.15.3.5.
- FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
- BRICK VENEER
 - 1 STOREY - 13" X 4" (330mm X 100mm)
 - 2 STOREY - 17" X 6" (485mm X 155mm)
 - 3 STOREY - 26" X 9" (660mm X 230mm)

- SIDING:
 - 1 STOREY - 10" X 4" (255mm X 100mm)
 - 2 STOREY - 14" X 4" (360mm X 100mm)
 - 3 STOREY - 18" X 5" (460mm X 130mm)

TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

- O.B.C. 9.15.3.6.
- 1 STOREY MASONRY - 16" X 4" (410mm X 100mm)
- 1 STOREY STUD - 12" X 4" (305mm X 100mm)
- 2 STOREY MASONRY - 26" X 9" (660mm X 230mm)
- 2 STOREY STUD - 18" X 5" (460mm X 130mm)
- 3 STOREY MASONRY - 36" X 15" (910mm X 380mm)
- 3 STOREY STUD - 24" X 8" (610mm X 200mm)

STEP FOOTING:

- O.B.C. 9.15.3.9.
- 23 5/8" (600mm) MAX. VERTICAL RISE PER 2'-0" (610mm) MIN. HORIZONTAL RUN.

DRAINAGE TILE OR PIPE:

- O.B.C. 9.14.3.
- 4" (100mm) MIN. DIA. LAID ON UNDISTURBED OR WELL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FLR. SLAB
- COVER TOP & SIDES OF TILE OR PIPE W/ 5 7/8" (150mm) OF BRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL
- TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

BASEMENT SLAB:

- O.B.C. 9.13. & 9.16.
- 3" (75mm) CONCRETE SLAB
- 2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
- DAMP PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
- DAMP PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
- 4" (100mm) OF COURSE GRANULAR MATERIAL
- PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
- WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
- FLOOR DRAIN PER O.B.C. 9.31.4.4.
- R10 (RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (OBC SB-12 - 3.1.1.7 (5))
- UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. SB-9)

SLAB ON GROUND:

- 3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.
- 2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
- DAMP PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
- DAMP PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
- R10 (RSI 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE. (OBC SB-12.3.1.1.7.(6))
- 4" (100mm) OF COURSE GRANULAR MATERIAL
- PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
- WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
- FLOOR DRAIN PER O.B.C. 9.31.4.4.
- UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. SB-9)

GARAGE SLAB / EXTERIOR SLAB:

- 4" (100mm) CONCRETE SLAB
- 4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.6.
- 6" X 6" (W2.9 X W2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
- 4" (100mm) OF COURSE GRANULAR MATERIAL
- ANY FILL PLACED UNDER SLAB OTHER THAN COURSE CLEAN GRANULAR MATERIAL SHALL BE COMPACTED.

PILASTERS:

- O.B.C. 9.15.5.3.
- PILASTER
 - CONCRETE NIB - 4" X 12" (100mm X 300mm)
 - BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9.20.11.2. TOP 7 7/8" (200mm) SOLID.
- OR
 - BEAM POCKET
 - 4" (100mm) INTO FDN. WALL W/ WIDTH TO MATCH BEAM SIZE.
 - 1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.)
- STRUCTURAL COLUMNS
 - SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1 7/8" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psi (2.4kPa).

- SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1 7/8" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psi (2.4kPa).

STEEL PIPE COLUMN:

- O.B.C. 9.15.3.4. & 9.17.3.
- FIXED COLUMN
 - MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS
 - FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mm X 100mm X 6.35mm) STEEL BTM. PLATE
 - FOR WOOD BEAMS, MIN. 4" X 4" X 1/4" (100mm X 100mm X 6.35mm) STEEL TOP & BTM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM
 - ADJUSTABLE COLUMNS TO CONFORM TO CAN/CGSB-7.2-M WHERE IMPOSED LOAD DOES NOT EXCEED 36 kN (O.B.C. 9.17.3.4.)
- COL. SPACING: FTG SIZE:
 - 2 STOREY
 - MAX. 9'-10" (2997mm)
 - 34" X 34" X 16" (860mm X 860mm X 400mm)
 - 44" X 44" X 21" (1120mm X 1120mm X 530mm)
 - 3 STOREY
 - MAX. 9'-10" (2997mm)
 - 40" X 40" X 19" (1010mm X 1010mm X 480mm)
 - 51" X 51" X 24" (1295mm X 1295mm X 610mm)
- WHERE COL. SITS ON FDN. WALL USE 4" X 8" X 5/8" (100mm X 200mm X 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

WOOD COLUMN:

- OBC 9.17.4.1, 9.17.4.2, & 9.17.4.3.
- 5 1/4" x 5 1/4" (140mm x 140mm) SOLID WOOD COLUMN - OR
- 3-2"x6" (38mm x 140mm) BUILT UP COLUMN NAILED TOGETHER W/ 3" (76mm) NAILS SPACED NOT MORE THAN 12" (300mm) APART OR BOLTED TOGETHER W/ 3/8" (9.52mm) DIA BOLTS SPACED AT 18" (450mm) O.C.
- WRAP COLUMN BASE W/ 6 MIL. POLY
- COLUMN TO SIT DIRECTLY ON CONC PAD (NOT ON CONC SLAB)
- 25"x25"x12" (640mm x 640mm x 300mm) CONC PAD (1 FLOOR SUPPORTED W/ 9'-10" COL SPACING)
- 34"x34"x14" (860mm x 860mm x 360mm) CONC PAD (2 FLOORS SUPPORTED W/ 9'-10" COL SPACING)

BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)

- 2"x8"x12" LEDGER BOARD FASTENED W/ 2/ 1/2" ANCHOR BOLTS @ 4" O.C.
- WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11 WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE BETWEEN ADJACENT BEAMS

BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM)

- 12"x11"x 5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2- 1/2"x8" ANCHOR BOLTS.

WALL ASSEMBLIES:

FOUNDATION WALL:

- O.B.C. 9.15.4.2.
- FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN Laterally supported height.
- 8" (200mm) SOLID 2200psi (15MPa) CONCRETE
- MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
- FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN Laterally supported height.
- 10" (250mm) SOLID 2200psi (15MPa) CONCRETE
- MAX. UNSUPPORTED HEIGHT OF 4'-7" (1400mm) & MAX. SUPPORTED HEIGHT OF 8'-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
- LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS.
- FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C.- 1.9.15.4.2.A SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C.- PART 4
- WALL SHALL EXTEND A MIN. 5 7/8" (150mm) ABOVE GRADE
- INSULATE W/ R20 (RSI 3.52) CONTINUOUS INSULATION FROM UNDERSIDE OF SUBFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1 OBC SB-12.3.1.1.2.A.)
- ALTERNATE INSULATION METHOD: 2" (51mm) R10 (RSI 1.76) RIGID INSULATION W/ 2"x4" (38mm X 89mm) WOOD STUD W/ R12 (RSI 2.11) BATT INSULATION
- BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL
- REDUCTION OF THICKNESS:
 - O.B.C. 9.15.4.7.
 - WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
 - TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7 7/8" (200mm) VERTICALLY O.C. & 2'-11" (900mm) HORIZONTALLY.
 - FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
 - WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK

DAMP PROOFING & WATERPROOFING:

- DAMP PROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
- WHERE INSULATION EXTENDS TO MORE THAN 2'-11" (900mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.(2) (3) (4)
- FINISHED BASEMENTS SHALL HAVE INTERIOR DAMP PROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3.(3)
- WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
- WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMP PROOFING.

FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

- 2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING)
- 3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING)
- 4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING)
- BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL
- BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER
- BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

FRAME WALL CONSTRUCTION:

- O.B.C. 9.23.
- SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
- WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
- 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
- 2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
- MIN. R22 (RSI 3.87) INSULATION (ZONE 1, OBC SB-12.3.1.1.2.A.)
- CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4..
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:
 - REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE 'X' GYPSUM BOARD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

- REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
 - NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
 - OR
 - VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

ALTERNATE FRAME WALL CONSTRUCTION:

- O.B.C. 9.23.
- SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
- 1 1/2" (38mm) RB (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4.)
- BRACE W/ CONT. 16 GAUGE STEEL T' BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL.
- 2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS.
- R14 (RSI 2.46) INSULATION
- CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4.
- 1/2" (12.7mm) GYPSUM BOARD.
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
 - ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD.
 - REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

- REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
 - NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
 - OR
 - VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID INSULATION

FRAME WALL CONSTRUCTION @ GARAGE:

- O.B.C. 9.23.
- SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
- WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
- 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16.
- 2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
 - ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

- REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
 - NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
 - OR
 - VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

BRICK VENEER CONSTRUCTION:

- O.B.C. 9.23.
- 3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. HEIGHT
- MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
- PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
- BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
- BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
- 1" (25mm) AIR SPACE
- WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
- 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16
- 2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
- MIN. R22 (RSI 3.87) INSULATION (ZONE 1, OBC SB-12.3.1.1.2.A.)
- CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
 - REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

ALTERNATE BRICK VENEER CONSTRUCTION:

- O.B.C. 9.23.
- 3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. HEIGHT
- MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
- PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
- BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
- BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
- 1" (25mm) AIR SPACE
- 1 1/2" (38mm) RB (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4.)
- 2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS
- BRACE W/ CONT. 16 GAUGE STEEL T' BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR
- CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL
- R14 (RSI 2.46) INSULATION
- CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
 - ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD.
 - REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

BRICK VENEER CONSTRUCTION @ GARAGE:

- O.B.C. 9.23.
- 3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. HEIGHT
- MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
- PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BTM. COURSE & OVER OPENINGS
- BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
- BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
- 1" (25mm) AIR SPACE
- WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
- 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16
- 2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

CLIENT SPECIFIC REVISIONS

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES. QUALIFIED DESIGNER BCIN: 38688 FIRM BCIN: 26995 DATE: JUNE 21/16

SIGNATURE:

client Gold Park Homes

project Mclaughlin and Mayfield

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	DS	IO	5				
2	ISSUED FOR PERMIT	01/02/2015	RPA	DJH	6				
3	ISSUED FOR CONSTRUCTION	01/17/2015	CR	DJH	7				
4	REVISED AS PER OBC SB-12 2017 UPDATE	29-Mar-17	es	es	8				

location Brampton

marketing name The Bizet

RN design
Imagine - Inspire - Create



model 38-1

- 36b) **EXTERIOR GUARDS @ JULIET BALCONY:**
- FOR RAILING SPANNING MAXIMUM OF 6'-0".
 - PROVIDE PREFIN. METAL RAILING W/ 76mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.8.8.5.
 - GUARDS TO BE 3'-6" (1070mm)
 - FOR DWELLING UNITS GUARDS TO BE 2'-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C. 9.8.8.2. OR
 - FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C. 9.8.8.2.
 - VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN. EMBEDMENT TO STUDS.
 - PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.
- 37) -LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP
- 38) -WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR, O.B.C.- 9.32.1.3.(3)
- 39) -CAPPED DRYER VENT
- 40) -1"x2" (19mmX38mm) BOTH SIDES OF STEEL
- 41) -WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE.
- 42) -PRECAST CONC. STEP
- 2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND
- 44) SMOKE ALARM, O.B.C.- 9.10.19.
- PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
 - PROVIDE 1 IN EACH BEDROOM
 - PROVIDE 1 IN EACH HALLWAY SERVICING BEDROOMS
 - INSTALLED AT OR NEAR CEILING
 - ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A VISUAL SIGNALLING COMPONENT
 - ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM
- 45) CARBON MONOXIDE ALARM (CMA), O.B.C.- 9.33.4.
- WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.
 - CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.
- 46) -MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY
- PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT.
 - R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED
- 47) -GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER.
- WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.
- R4 (RSI 0.70)
- 48) -TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT;
- 1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY OR
- 2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (7.0m) ABOVE ADJACENT GROUND LEVEL.

- 49) **EXTERIOR COLUMN W/ MASONRY PIER:**
- MIN. 6"x6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.
 - TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.
 - 14" X 14" MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP.
 - REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
 - SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4.
 - 3/4" AIR SPACE AROUND POST.
 - OR
 - MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
 - 14" X 14" MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.
 - REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
 - NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.
- 49d) **EXTERIOR COLUMN:**
- MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE
 - NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.
- 50) **COLD CELLARS:**
- FOR COLD CELLARS PROVIDE THE FOLLOWING:
- VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.
 - COVER VENT W/ BUG SCREEN
 - WALL MOUNTED LIGHT FIXTURE
 - L1+L7 FOR DOOR OPENING
 - 2'-8" X 6'-8" EXTERIOR TYPE DOOR (MIN.R-4 RSI 0.7)
 - INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)

- 51) **STUD WALL REINFORCEMENT:**
- O.B.C. 9.5.2.3.
- WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)(a)&(c) & 3.8.3.13.(2)(f) & 3.8.3.13.(4)(c)
 - GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)
- FRAME CONSTRUCTION:**
- ALL FRAMING LUMBER TO BE No.1 AND No. 2 SPF UNLESS NOTED OTHERWISE.
 - ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN LOADS.
 - JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING
 - BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING
 - DOUBLE STUDS @ OPENINGS
 - DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mm)
 - DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm)
 - DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS
 - BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE PARALLEL TO FLOOR JOISTS

-BEAMS MAY BE A MAX. 24" (600mm) FROM LOADBEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS

- APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS
- FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X 184mm)
- FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 235mm) OR LARGER.

WINDOWS:

- WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER
- WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 1.6 W/(m2.K) OR
- AN ENERGY RATING OF NOT LESS THAN 25 FOR WINDOWS
- BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATING
- SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 2.8 W/(m2.K)
- FOR GROSS GLAZED AREAS LESS THAN AND EQUAL TO 17%



MAY 01 2017

FOR STRUCTURAL ONLY EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST & FLOOR LVL BEAM DESIGNS

GROSS GLAZING AREA 'A'

TOTAL PERIPHERAL WALL AREA	2777.76 SF	258.05 m²
FRONT GLAZING AREA	64.28 SF	5.97 m²
LEFT SIDE GLAZING AREA	0 SF	0.00 m²
RIGHT SIDE GLAZING AREA	53.28 SF	4.95 m²
REAR GLAZING AREA	161.44 SF	15.00 m²
TOTAL GLAZING AREA	279.00 SF	25.92 m²
TOTAL GLAZING PERCENTAGE	10.04 %	

GROSS GLAZING AREA 'B'

TOTAL PERIPHERAL WALL AREA	2797.96 SF	259.93 m²
FRONT GLAZING AREA	56.98 SF	5.29 m²
LEFT SIDE GLAZING AREA	0 SF	0.00 m²
RIGHT SIDE GLAZING AREA	53.28 SF	4.95 m²
REAR GLAZING AREA	161.44 SF	15.00 m²
TOTAL GLAZING AREA	271.70 SF	25.24 m²
TOTAL GLAZING PERCENTAGE	9.71 %	

CLIENT SPECIFIC REVISIONS

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

SCHEDULES

WOOD BEAMS

WD1	3/2" X 8" SPR	WD10	2/1 3/4" X 7 1/4" (2.0E) LVL
WD2	4/2" X 8" SPR	WD11	3/1 3/4" X 7 1/4" (2.0E) LVL
WD3	5/2" X 8" SPR	WD12	2/1 3/4" X 9 1/2" (2.0E) LVL
WD4	3/2" X 10" SPR	WD13	3/1 3/4" X 9 1/2" (2.0E) LVL
WD5	4/2" X 10" SPR	WD14	2/1 3/4" X 11 7/8" (2.0E) LVL
WD6	5/2" X 10" SPR	WD15	3/1 3/4" X 11 7/8" (2.0E) LVL
WD7	3/2" X 12" SPR	WD16	2/1 3/4" X 14" (2.0E) LVL
WD8	4/2" X 12" SPR	WD17	3/1 3/4" X 14" (2.0E) LVL
WD9	5/2" X 12" SPR		

LINTELS

L1	2/2" X 8" SPR	L9	4" X 3-1/2" X 1/4" L	L14	5-7/8" X 3-1/2" X 1/2" L
L3	2/2" X 10" SPR	L10	4-7/8" X 3-1/2" X 5/16" L	L15	5-7/8" X 4" X 1/2" L
L5	2/2" X 12" SPR	L11	4-7/8" X 3-1/2" X 3/8" L	L16	7-1/8" X 4" X 3/8" L
L7	3-1/2" X 3-1/2" X 1/4" L	L12	4-7/8" X 3-1/2" X 1/2" L	L17	7-1/8" X 4" X 1/2" L
L8	4-7/8" X 3-1/2" X 1/4" L	L13	5-7/8" X 3-1/2" X 3/8" L		

- SMOKE ALARM 44
- WATERPROOF DUPLEX OUTLET
- VENTS AND INTAKES
- HOSE BIB
- EXHAUST FAN 38
- COLD CELLAR VENT 50
- STOVE VENT
- FIRE PLACE VENT
- DRYER VENT

PLAN/ELEVATION LEGEND

- CARBON MONOXIDE ALARM (CMA) 45
- DOUBLE JOIST
- PRESSURE TREATED LUMBER
- GIRDER TRUSS
- ABOVE FINISHED FLOOR
- BEAM BY FLOOR MANUF
- FLUSH
- DROPPED
- REPEAT SAME JOIST SIZE
- UNDER SIDE
- FIXED GLAZING
- GLASS BLOCK
- BLACK GLASS
- FLOOR DRAIN
- SOLID BEARING (TO BE SAME WIDTH AS SUPPORTED MEMBER)
- POINT LOAD
- FLAT ARCH
- 2 STORY WALL
- EXT. LIGHT FIXTURE (WALL MOUNTED)
- HYDRO METER
- GAS METER

I, JULIO PINZON, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 38688

FIRM BCIN: 26995

DATE: JUNE 21/16

SIGNATURE:

client
Gold Park Homes

project
Mclaughlin and Mayfield

location
Brampton

marketing name
The Bizet

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04-JUL-14	PS	JA	5				
2	ISSUED FOR PERMIT	6/16/2015	RPA	DJH	6				
3	ISSUED FOR CONSTRUCTION	9/17/2015	CR	DJH	7				
4	REVISED AS PER CMR JUL 12 2017 UPDATE	29-MAR-17	PS	PS	8				

RN design
Imagine - Inspire - Create

model
38-1

scale
3/16" = 1'0"

project #
13098

page

D3