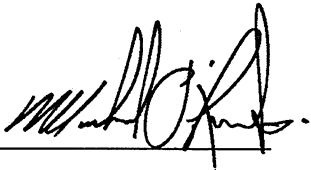


Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality VAUGHAN	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 38-4 Project: KLEINBURG GLEN	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u> declare that (choose one as appropriate):			
(print name)			
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge.			
2. I have submitted this application with the knowledge and consent of the firm.			
<u>March 7, 2017</u>			
Date		Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

SITE NAME: KLEINBURG GLEN BUILDER: GOLD PARK HOMES										DATE: Mar-17 LO# 72988		GFA: 2762		TYPE: 38-4		WINTER NATURAL AIR CHANGE RATE SUMMER NATURAL AIR CHANGE RATE		HEAT LOSS AT °F. 76 HEAT GAIN AT °F. 16		CSA-F280-12 SB-12 PACKAGE A1	
ROOM USE EXP. WALL CLG. HT.	MBR	ENS	WIC	BED-2	BED-3	BED-4	BATH	LAUN	ENS-2	DEN											
FACTORS LOSS GAIN	288	234	99	288	189	108	63	108	126	110											
GRS.WALL AREA	288	234	99	288	189	108	63	108	126	110											
GLAZING	0	0	0	0	0	0	0	0	0	0											
NORTH	21.3 16.9	7 149 118	0 0 0	8 170 135	0 0 0	0 0 0	0 0 0	15 319 253	0 0 0	22 468 371											
EAST	21.3 42.4	0 0 0	0 0 0	20 426 849	18 383 764	0 0 0	0 0 0	0 0 0	35 745 1486	0 0 0											
SOUTH	21.3 25.8	0 0 0	0 0 0	0 0 0	0 0 0	16 340 413	6 128 155	0 0 0	0 0 0	0 0 0											
WEST	21.3 42.4	21 447 891	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0											
SKYL.T.	21.3 87.5	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0											
DOORS	25.2 5.3	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0											
NET EXPOSED WALL	4.5 0.9	264 1178 248	99 442 93	260 1160 244	171 763 161	92 411 86	57 254 54	93 415 87	91 406 85	88 393 83											
NET EXPOSED BSMT WALL ABOVE GR	3.6 0.8	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0											
EXPOSED CLG	1.3 0.6	255 327 164	99 127 64	272 349 175	196 252 126	204 262 131	119 153 76	108 139 69	98 126 63	0 0 0											
NO ATTIC EXPOSED CLG	2.7 1.4	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0											
EXPOSED FLOOR	2.6 0.5	0 0 0	0 0 0	30 77 16	196 500 105	0 0 0	14 36 8	0 0 0	98 250 53	0 0 0											
BASEMENT/CRAWL HEAT LOSS	0	0	0	0	0	0	0	0	0	0											
SLAB ON GRADE HEAT LOSS	0	0	0	0	0	0	0	0	0	0											
SUBTOTAL HT LOSS	2016	1727	569	2182	1898	1013	570	873	1527	861											
SUB TOTAL HT GAIN	1430	1309	157	1419	1156	630	292	410	1637	454											
LEVEL FACTOR / MULTIPLIER	0.20 0.27	0.20 0.27	0.20 0.27	0.20 0.27	0.20 0.27	0.20 0.27	0.20 0.27	0.20 0.27	0.20 0.27	0.30 0.43											
AIR CHANGE HEAT LOSS	543	465	153	588	511	273	154	235	411	374											
AIR CHANGE HEAT GAIN	109	100	12	108	88	48	22	31	128	35											
DUCT LOSS	0	0	0	277	241	0	72	0	194	0											
DUCT GAIN	0	0	0	237	208	0	31	0	182	0											
HEAT GAIN PEOPLE	240	0	0	1	240	1	0	0	0	0											
HEAT GAIN APPLIANCES/LIGHTS	599	0	0	599	599	599	0	599	0	599											
TOTAL HT LOSS BTU/H	2560	2192	722	3047	2650	1286	797	1108	2132	1235											
TOTAL HT GAIN x 1.3 BTU/H	3404	1831	219	3384	2979	1972	450	1352	2596	1414											

ROOM USE EXP. WALL CLG. HT.	MUD	DIN	KIT/GR	PDR	FOY	BAS										
FACTORS LOSS GAIN	99	260	660	187	340	996										
GRS.WALL AREA	99	260	660	187	340	996										
GLAZING	0	0	0	0	0	0										
NORTH	21.3 16.9	0 0 0	0 0 0	8 170 135	0 0 0	6 128 101										
EAST	21.3 42.4	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0										
SOUTH	21.3 25.8	0 0 0	0 0 0	0 0 0	0 0 0	3 64 77										
WEST	21.3 42.4	0 0 0	111 2362 4712	0 0 0	0 0 0	0 0 0										
SKYL.T.	21.3 87.5	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0										
DOORS	25.2 5.3	20 505 106	0 0 0	0 0 0	42 1060 223	20 505 106										
NET EXPOSED WALL	4.5 0.9	79 353 74	232 1035 218	179 799 168	298 1330 280	498 1792 377										
NET EXPOSED BSMT WALL ABOVE GR	3.6 0.8	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0										
EXPOSED CLG	1.3 0.6	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0										
NO ATTIC EXPOSED CLG	2.7 1.4	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0										
EXPOSED FLOOR	2.6 0.5	0 0 0	0 0 0	0 0 0	0 0 0	0 0 0										
BASEMENT/CRAWL HEAT LOSS	0	0	0	0	0	0										
SLAB ON GRADE HEAT LOSS	0	0	0	0	0	0										
SUBTOTAL HT LOSS	858	1631	4812	969	2390	5546										
SUB TOTAL HT GAIN	181	940	5228	303	503	8099										
LEVEL FACTOR / MULTIPLIER	0.30 0.43	0.30 0.43	0.30 0.43	0.30 0.43	0.30 0.43	0.50 1.03										
AIR CHANGE HEAT LOSS	372	708	2090	421	1038	8338										
AIR CHANGE HEAT GAIN	14	72	398	23	38	60										
DUCT LOSS	0	0	0	0	0	0										
DUCT GAIN	0	0	0	0	0	0										
HEAT GAIN PEOPLE	240	0	1	0	0	0										
HEAT GAIN APPLIANCES/LIGHTS	599	599	599	0	0	0										
TOTAL HT LOSS BTU/H	1230	2339	6902	1390	3428	16437										
TOTAL HT GAIN x 1.3 BTU/H	1032	2094	8404	424	704	1105										

TOTAL HEAT GAIN BTU/H: 33964 TONS: 2.83 LOSS DUE TO VENTILATION LOAD BTU/H: 2852

STRUCTURAL HEAT LOSS: 49454

TOTAL COMBINED HEAT LOSS BTU/H: 52306

Michael O'Rourke

SITE NAME: KLEINBURG GLEN
BUILDER: GOLD PARK HOMES

TYPE: 38-4 DATE: Mar-17 GFA: 2762 LO# 72988

HEATING CFM	1100	COOLING CFM	1100
TOTAL HEAT LOSS	49,454	TOTAL HEAT GAIN	33,364
AIR FLOW RATE CFM	22.24	AIR FLOW RATE CFM	32.97

AFUE = 96 %
INPUT (BTU/H) = 66,000
OUTPUT (BTU/H) = 64,000

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	9	8	4
R/A	0	0	4	3	1

All S/A diffusers 4"x10" unless noted otherwise on layout.
All S/A runs 5'Ø unless noted otherwise on layout.

RUN #	ROOM NAME	RM LOSS MBH	CFM PER RUN HEAT	RM GAIN MBH	CFM PER RUN COOLING	ADJUSTED PRESSURE	ACTUAL DUCT LGH	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	ROUND DUCT SIZE	HEATING VELOCITY (ft/min)	COOLING VELOCITY (ft/min)	OUTLET GRILL SIZE
1	ENS	2.19	72	68	59	0.17	183	200	259	0.07	3X10	360	441	3X10
2	WIC	1.83	60	7	112	0.17	183	200	259	0.07	3X10	360	441	3X10
3	ENS	2.19	72	68	59	0.17	183	200	259	0.07	3X10	360	441	3X10
4	WIC	1.83	60	7	112	0.17	183	200	259	0.07	3X10	360	441	3X10
5	BED-3	2.65	85	29	31	0.16	183	200	259	0.07	3X10	360	441	3X10
6	BED-4	1.29	45	15	31	0.17	183	200	259	0.07	3X10	360	441	3X10
7	BATH	0.80	25	18	31	0.17	183	200	259	0.07	3X10	360	441	3X10
8	LAUN	1.11	45	15	31	0.17	183	200	259	0.07	3X10	360	441	3X10
9	ENS-2	2.13	72	68	59	0.16	183	200	259	0.07	3X10	360	441	3X10
10	MBR	2.56	85	29	31	0.15	183	200	259	0.07	3X10	360	441	3X10
11	DEN	1.23	45	15	31	0.17	183	200	259	0.07	3X10	360	441	3X10
12	MUD	1.23	45	15	31	0.17	183	200	259	0.07	3X10	360	441	3X10
13	DIN	2.34	85	29	31	0.17	183	200	259	0.07	3X10	360	441	3X10
14	KIT/GRT	2.30	85	29	31	0.16	183	200	259	0.07	3X10	360	441	3X10
15	KIT/GRT	2.30	85	29	31	0.16	183	200	259	0.07	3X10	360	441	3X10
16	KIT/GRT	2.30	85	29	31	0.16	183	200	259	0.07	3X10	360	441	3X10
17	PDR	1.39	45	15	31	0.17	183	200	259	0.07	3X10	360	441	3X10
18	FOY	3.43	110	31	44	0.17	183	200	259	0.07	3X10	360	441	3X10
19	FOY	3.43	110	31	44	0.17	183	200	259	0.07	3X10	360	441	3X10
20	BAS	4.11	140	31	44	0.16	183	200	259	0.07	3X10	360	441	3X10
21	BAS	4.11	140	31	44	0.16	183	200	259	0.07	3X10	360	441	3X10
22	BAS	4.11	140	31	44	0.16	183	200	259	0.07	3X10	360	441	3X10
23	BAS	4.11	140	31	44	0.16	183	200	259	0.07	3X10	360	441	3X10
24	BAS	4.11	140	31	44	0.16	183	200	259	0.07	3X10	360	441	3X10

TEMPERATURE RISE 54 °F

RUN #

ROOM NAME	RM LOSS MBH	CFM PER RUN HEAT	RM GAIN MBH	CFM PER RUN COOLING	ADJUSTED PRESSURE	ACTUAL DUCT LGH	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	ROUND DUCT SIZE	HEATING VELOCITY (ft/min)	COOLING VELOCITY (ft/min)	OUTLET GRILL SIZE
TRUNK	360	184	347	301	213	207	184	345	291	310	374	374	3X10
TRUNK	441	80	571	500	477	172	330	631	571	539	390	469	3X10
TRUNK	3X10	3X10	4X10	4X10	3X10	3X10	3X10	3X10	4X10	3X10	3X10	3X10	3X10

RUN #	ROOM NAME	RM LOSS MBH	CFM PER RUN HEAT	RM GAIN MBH	CFM PER RUN COOLING	ADJUSTED PRESSURE	ACTUAL DUCT LGH	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	ROUND DUCT SIZE	HEATING VELOCITY (ft/min)	COOLING VELOCITY (ft/min)	OUTLET GRILL SIZE
1	TRUNK A	259	0.07	8.7	10	0.15	14	12	18	0.07	10	8	8	10
2	TRUNK B	486	0.07	11.1	14	0.15	14	12	18	0.07	10	8	8	10
3	TRUNK C	409	0.07	10.4	12	0.15	14	12	18	0.07	10	8	8	10
4	TRUNK D	612	0.07	12.1	18	0.15	14	12	18	0.07	10	8	8	10
5	TRUNK E	0	0.00	0	0	0.00	0	0	0	0.00	0	0	0	0
6	TRUNK F	0	0.00	0	0	0.00	0	0	0	0.00	0	0	0	0

SUPPLY AIR TRUNK SIZE

TRUNK	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)
TRUNK A	0.07	8.7	10	466	0	0.00	0	0	0
TRUNK B	0.07	11.1	14	625	0	0.00	0	0	0
TRUNK C	0.07	10.4	12	612	0	0.00	0	0	0
TRUNK D	0.07	12.1	18	614	0	0.00	0	0	0
TRUNK E	0.00	0	0	0	0	0.00	0	0	0
TRUNK F	0.00	0	0	0	0	0.00	0	0	0

RETURN AIR TRUNK SIZE

TRUNK	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)
TRUNK G	0.15	14.80	14.80	14.80	0	0.06	0	0	0
TRUNK H	0.15	14.80	14.80	14.80	0	0.06	0	0	0
TRUNK I	0.15	14.80	14.80	14.80	0	0.06	0	0	0
TRUNK J	0.15	14.80	14.80	14.80	0	0.06	0	0	0
TRUNK K	0.15	14.80	14.80	14.80	0	0.06	0	0	0
TRUNK L	0.15	14.80	14.80	14.80	0	0.06	0	0	0

RETURN AIR #

RETURN AIR #	PLenum PRESSURE	ACTUAL DUCT LGH	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	ROUND DUCT SIZE	INLET GRILL SIZE
1	0.15	41	175	217	0.07	8	14
2	0.15	42	175	217	0.07	8	14
3	0.15	44	175	217	0.07	8	14
4	0.15	44	175	217	0.07	8	14
5	0.15	44	175	217	0.07	8	14
6	0.15	44	175	217	0.07	8	14
7	0.15	44	175	217	0.07	8	14
8	0.15	44	175	217	0.07	8	14
9	0.15	44	175	217	0.07	8	14
10	0.15	44	175	217	0.07	8	14

TYPE: 38-4
SITE NAME: KLEINBURG GLEN

LO # 72988

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	2 @ 21.2 cfm	42.4 cfm
Other Bedrooms	3 @ 10.6 cfm	31.8 cfm
Kitchen & Bathrooms	5 @ 10.6 cfm	53 cfm
Other Rooms	5 @ 10.6 cfm	53.0 cfm
Table 9.32.3.A.	TOTAL	180.2 cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8 cfm	
2 Bedroom	47.7 cfm	
3 Bedroom	63.6 cfm	
4 Bedroom	79.5 cfm	
5 Bedroom	95.4 cfm	
More than 5 - Part 6	TOTAL	79.5 cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	180.2	cfm
Less Principal Ventil. Capacity	139	cfm
Required Supplemental Capacity	41.2	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model: VANEE 60H-V+	Location: BSMT
139.0 cfm	3.0 sonos
☒	HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION			
CFM	ΔT °F	FACTOR	% LOSS
139.0 CFM	76 F	1.08	0.25

SUPPLEMENTAL FANS		NUTONE	
Location	Model	cfm	HVI
ENS	QTXEN050C	50	☒
BATH	QTXEN050C	50	☒
ENS-2	QTXEN050C	50	☒
PDR	QTXEN050C	50	☒

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model: VANEE 60H-V+		
139 cfm high	50 cfm low	
75 % Sensible Efficiency	☒	HVI Approved
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
GOLD PARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	March-17

CSA F280-12 Residential Heat Loss and Heat Gain Calculations									
Formula Sheet (For Air Leakage / Ventilation Calculation)									
LO#: 72988		Model: 38-4		Builder: GOLD PARK HOMES		Date: 3/7/2017			
Volume Calculation				Air Change & Delta T Data					
House Volume									
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)						
Bsmt	1224	9	11016						
First	1224	10	12240						
Second	1547	9	13923						
Third	0	9	0						
Fourth	0	9	0						
Total:			37,179.0 ft³						
Total:			1052.8 m³						
5.2.3.1 Heat Loss due to Air Leakage									
$HL_{airb} = LR_{airb} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$				$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$					
0.330	x	292.44	x	42 °C	x	1.2	=	4887 W	
								=	16676 Btu/h
5.2.3.2 Heat Loss due to Mechanical Ventilation									
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$				$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$					
139 CFM	x	76 °F	x	1.08	x	0.25	=	2852 Btu/h	
								=	600 Btu/h
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)									
$HL_{airr} = Level Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$									
Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)					
1	0.5	16,676	8,099	1.030					
2	0.3		11,521	0.434					
3	0.2		12,374	0.270					
4	0		0	0.000					
5	0		0	0.000					

*HLairbv = Air leakage heat loss + ventilation heat loss

*For a balanced or supply only ventilation system HLairve = 0

HEAT LOSS AND GAIN SUMMARY SHEET**MODEL:** 38-4**SFQT:** 2762**LO#** 72988**BUILDER:** GOLD PARK HOMES**SITE:** KLEINBURG GLEN**DESIGN ASSUMPTIONS**

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-4	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	72

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	37179.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.35	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	6.0 ft
LENGTH: 54.0 ft	WIDTH: 29.0 ft	EXPOSED PERIMETER:	166.0 ft

2012 OBC - COMPLIANCE PACKAGE**Component****Compliance Package
A1****Nominal Min. Eff.**

Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.8
Walls Above Grade Minimum RSI (R)-Value	22	17.03
Basement Walls Minimum RSI (R)-Value	20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	0.28	-
Skylights Maximum U-Value	0.49	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.8	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

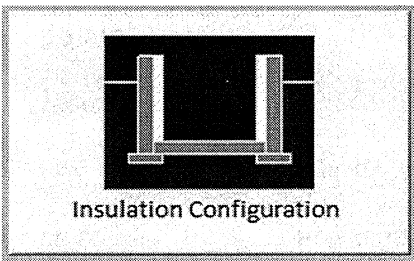Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	16.5	 Insulation Configuration
Floor Width (m):	8.8	
Exposed Perimeter (m):	0.0	
Wall Height (m):	2.7	
Depth Below Grade (m):	1.8	
Window Area (m ²):	1.1	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):	1625	

TYPE: 38-4


LO# 72988

Air Infiltration Residential Load Calculator


Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Vaughan (Woodbridge)			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	6.71			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1052.8			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1403.4 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	65.6	65.6		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.330			
Cooling Air Leakage Rate (ACH/H):	0.121			

TYPE: 38-4
LO# 72988

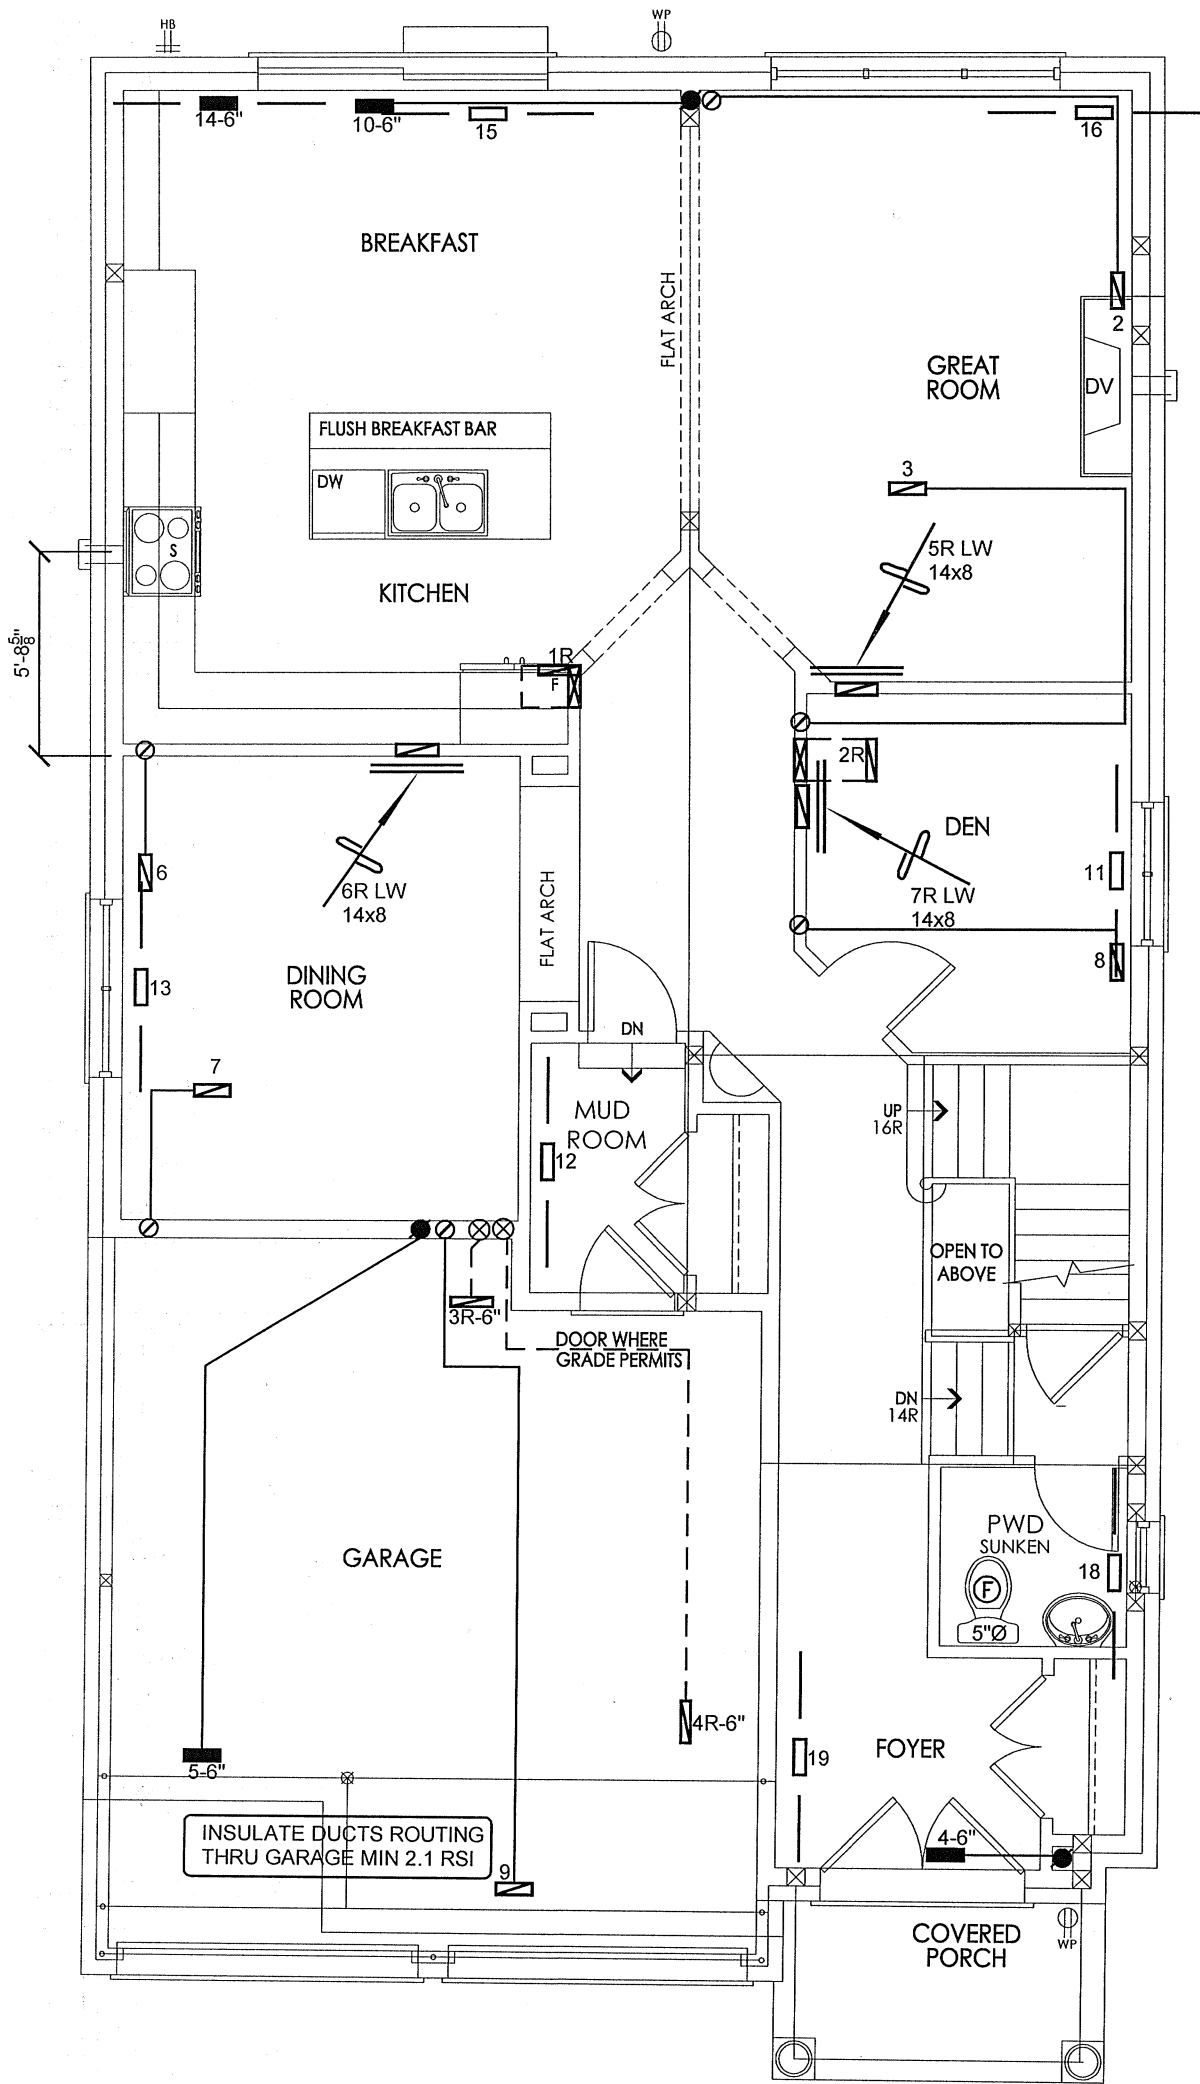

GROUND FLOOR PLAN ELEV. 'A'

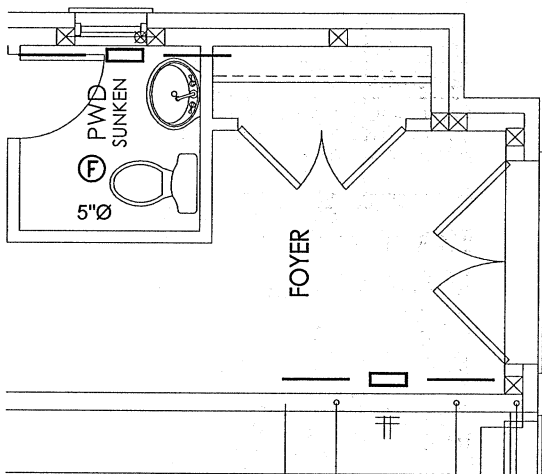

PARTIAL GROUND FLOOR PLAN ELEV. 'B'


1 MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C. 3.2.5 OF THE BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.		
	FLOOR SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.		
	FLOOR SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GOLD PARK HOMES			FIRST FLOOR HEATING LAYOUT	
Project Name			Date	MAR/2017
KLEINBURG GLEN VAUGHAN, ONTARIO			Scale	3/16" = 1'-0"
38-4			BCIN# 19669	
2762 sqft			LO#	72988

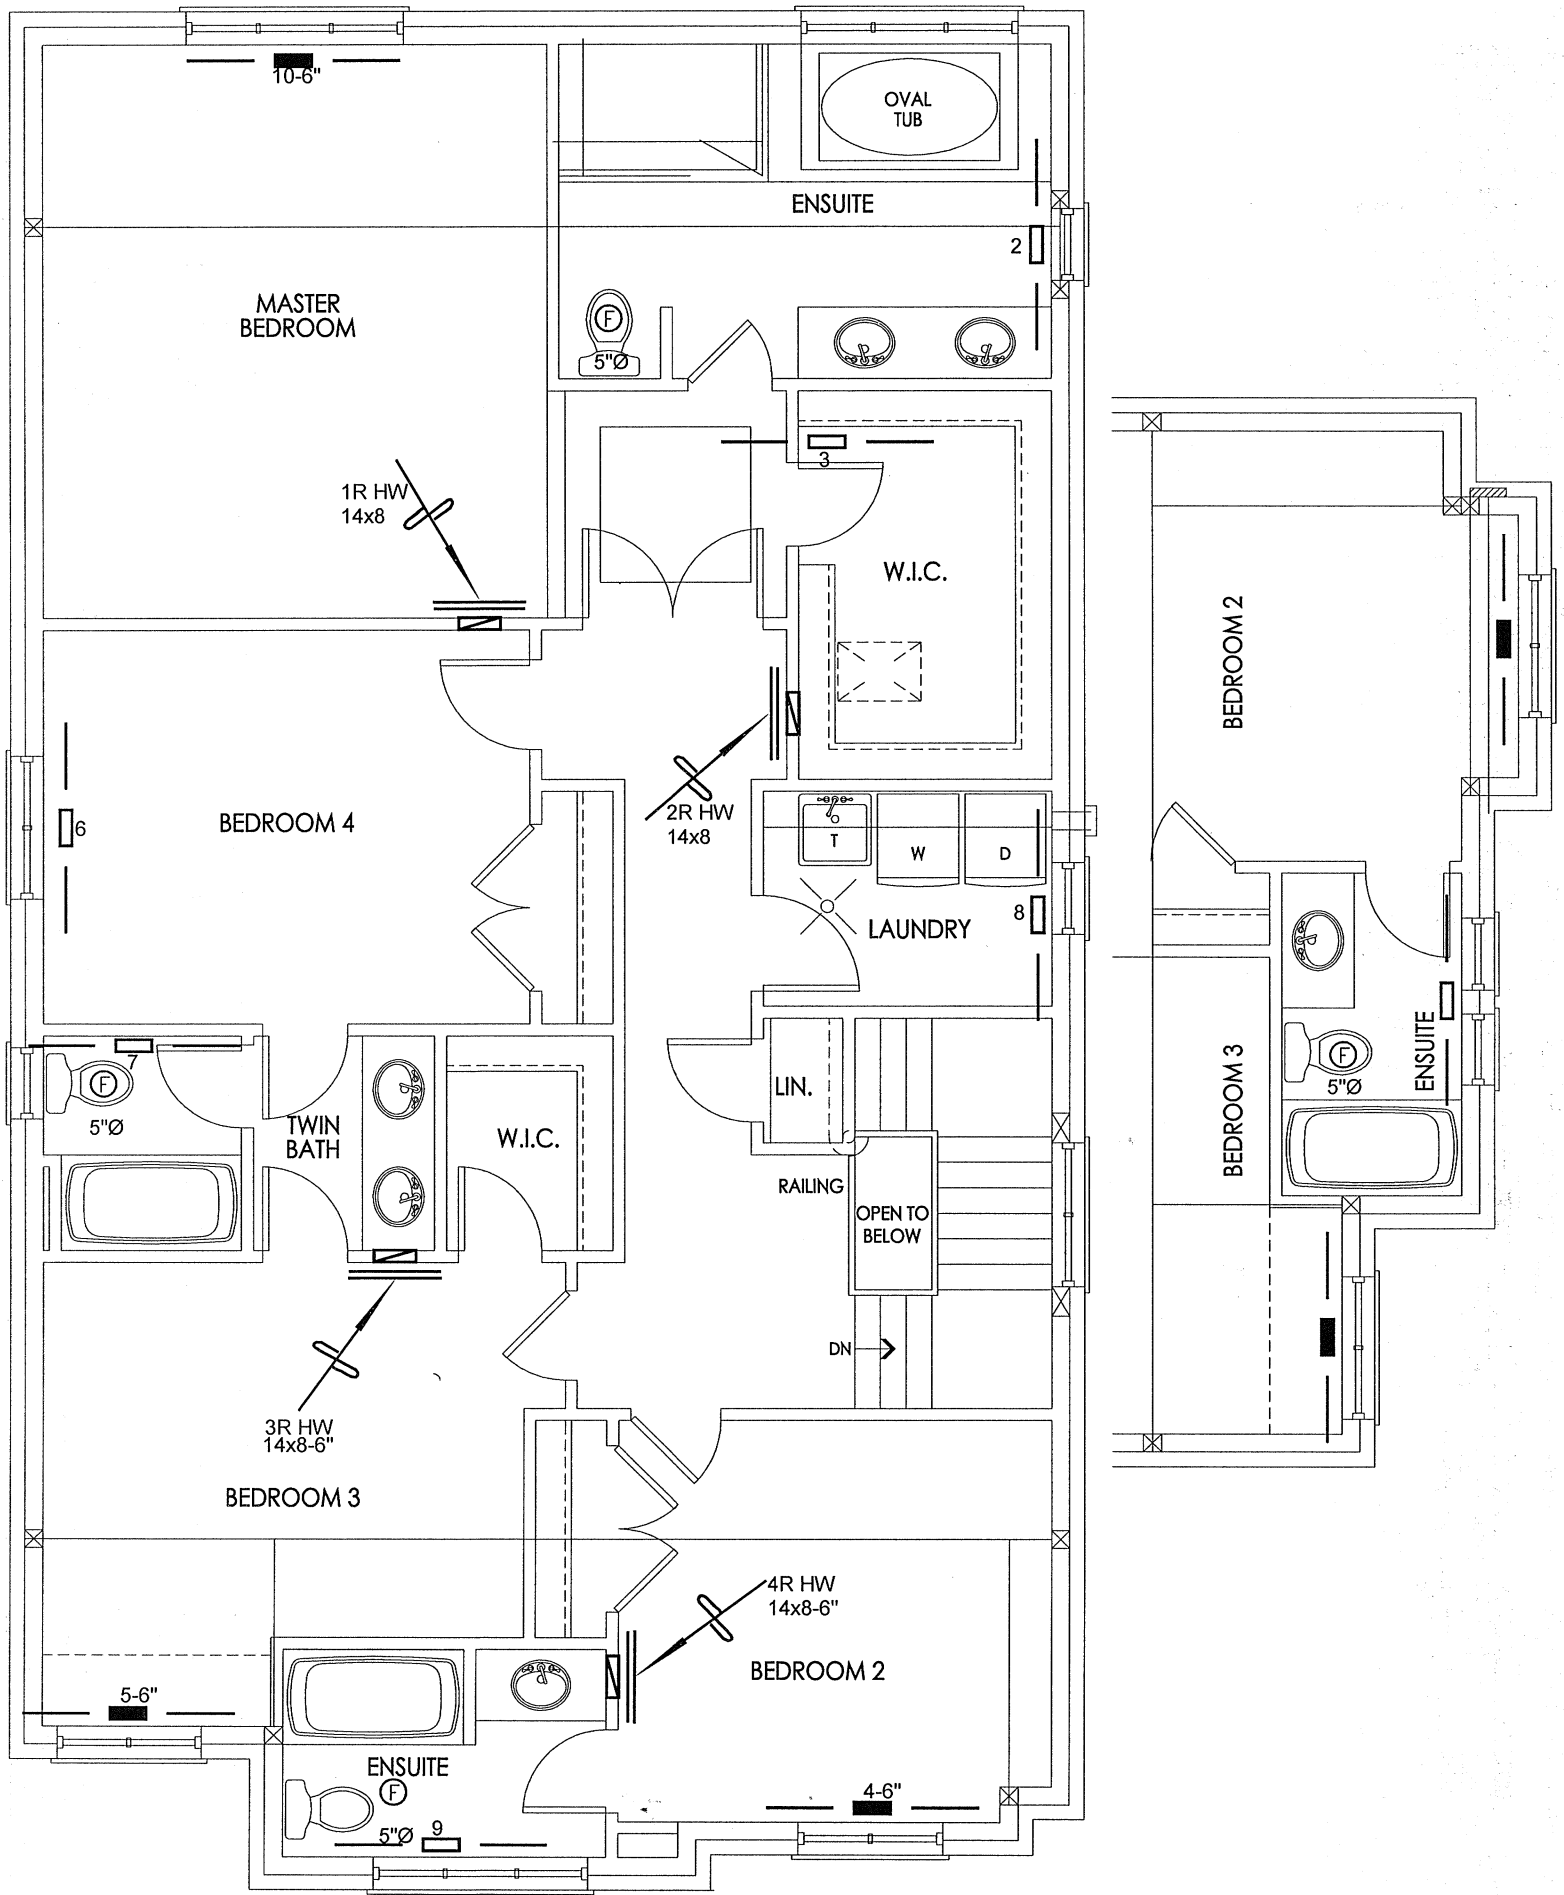

PARTIAL SECOND FLOOR PLAN ELEV. 'B'

SECOND FLOOR PLAN ELEV. 'A'

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C.3.2.5 OF THE BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1

HVAC LEGEND							3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	FLOOR SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	FLOOR SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER		Date

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services	Sheet Title	
GOLD PARK HOMES			SECOND FLOOR HEATING LAYOUT	
Project Name			Date	MAR/2017
KLEINBURG GLEN VAUGHAN, ONTARIO			Scale	3/16" = 1'-0"
			BCIN# 19669	
38-4		LO#		72988
2762 sqft		Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.		