


ALL CORN. FRAMING TO CONFORM WITH PART 8 OF O.C. 2012. ROOF TRUSSES TO BE CROSS-BRACED TO THE TRUSS JOISTS WITH A VERTICAL POST TO THE TRUSS JOIST. POST LONGER THAN 6' TO BE BRACED TO THE TRUSS JOIST. THE DIST. BETWEEN END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

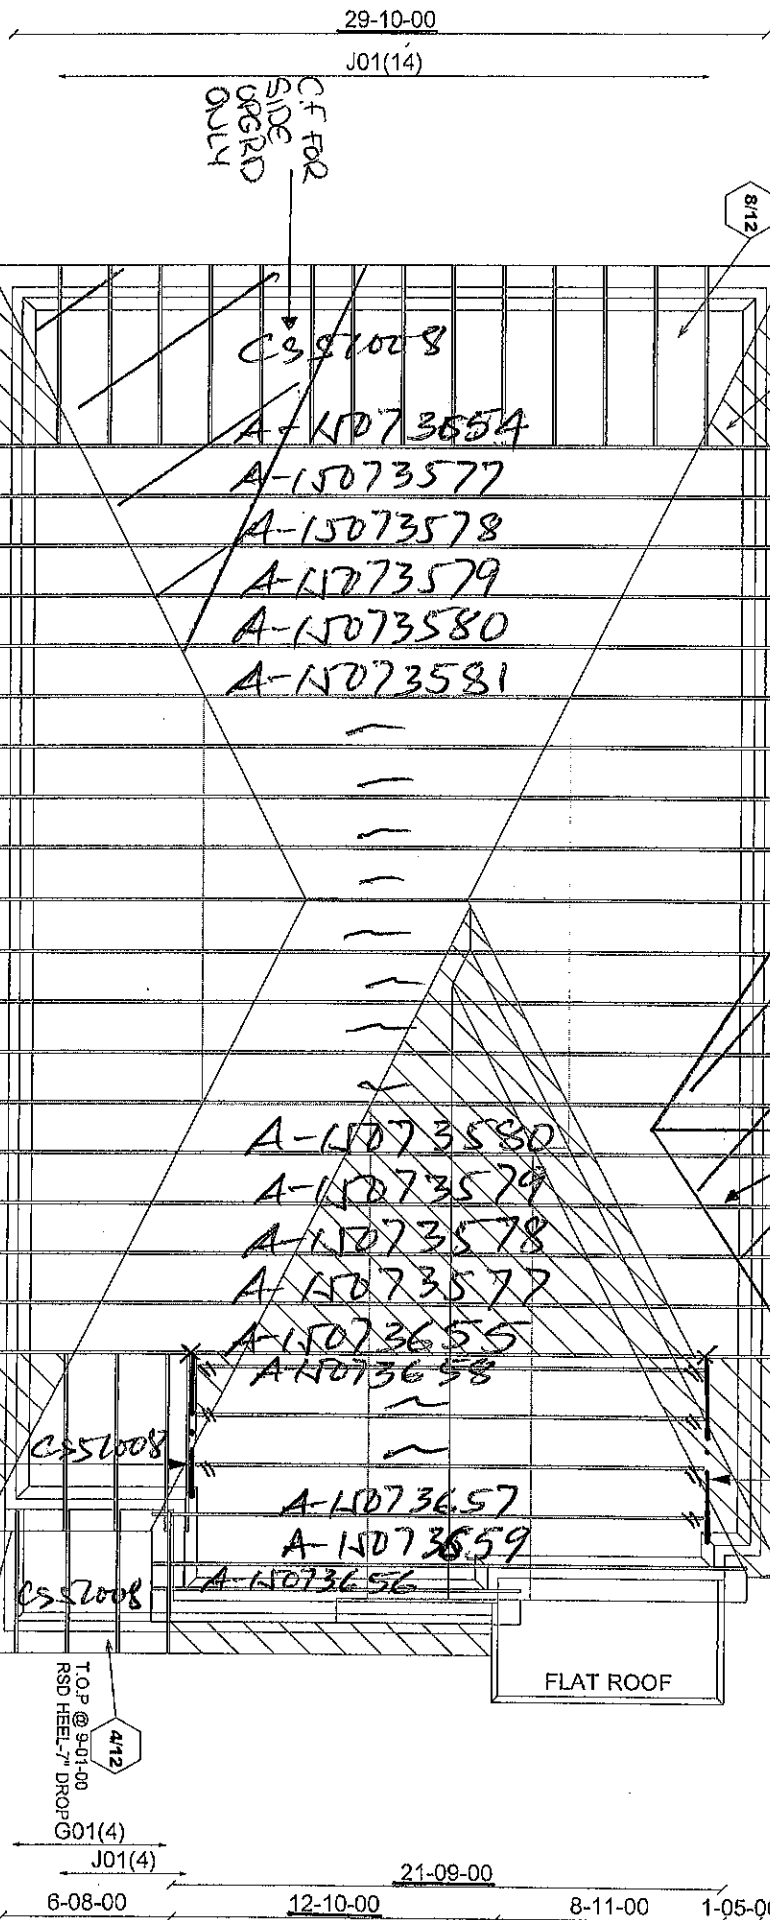

12" FIN. OH.
RSD. HEEL - 0" DROP
(2" x 6" FASCIA) - FM
ASPHALT SHINGLES
2" x 6" BRG/BRICK
PIGTYBACK TRS
PURLINS BY OTHERS

Figgy back (A-15073582)
(A-15073633)
A-15073665
48-10-00

3-08-00

HANGERS
// LUS24
X HHUS26-2

H01
H02
H03
H04
H05

H07
H06(9)
H08(3)
H07

H05
H04
H03
H02
H01

H11
H11SG
H10G

ALPHA-BARRIE

PL 80980, 82444, 85348, 89608

(SIDE URGAD)



Job Track: 40297
Layout ID: 253438
Plan Log: 79711

Builder / Location: GOLD PARK / KLEINBURG

Project: HUNTINGTON & NASHVILLE

Date: 4/22/2015 Designer: cheryle

Model / Elevation: 38-4

/A

STD & SIDE URGAD




Minck Ver 7.5.0

THESE DRAWINGS CONSTITUTE THE PROPERTY OF ALPHA ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY ALPHA ROOF TRUSSES INC AND WILL BE RETRACTED BY ALPHA ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

ALL GUY FRAMING TO CONFORM WITH ALPA ROOF TRUSS MANUFACTURING PRACTICES. ROOF TRUSSES TO BE 2X4 SPF #2 & 2X6 C. WITH A VERT. POST TO THE TRUSS UNDER EACH ANCHOR GROSS PT. TO HAVE LATERAL BRACING SO THAT THE DIST. BETWEEN END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 8'

12" FIN. OH.
RSD. HEEL - 0" DROP
(2" x 6" FASCIA) - FM
ASPHALT SHINGLES
2" x 6" BRG/BRICK
PIGgyBACK TRS.
PURLINS BY OTHERS

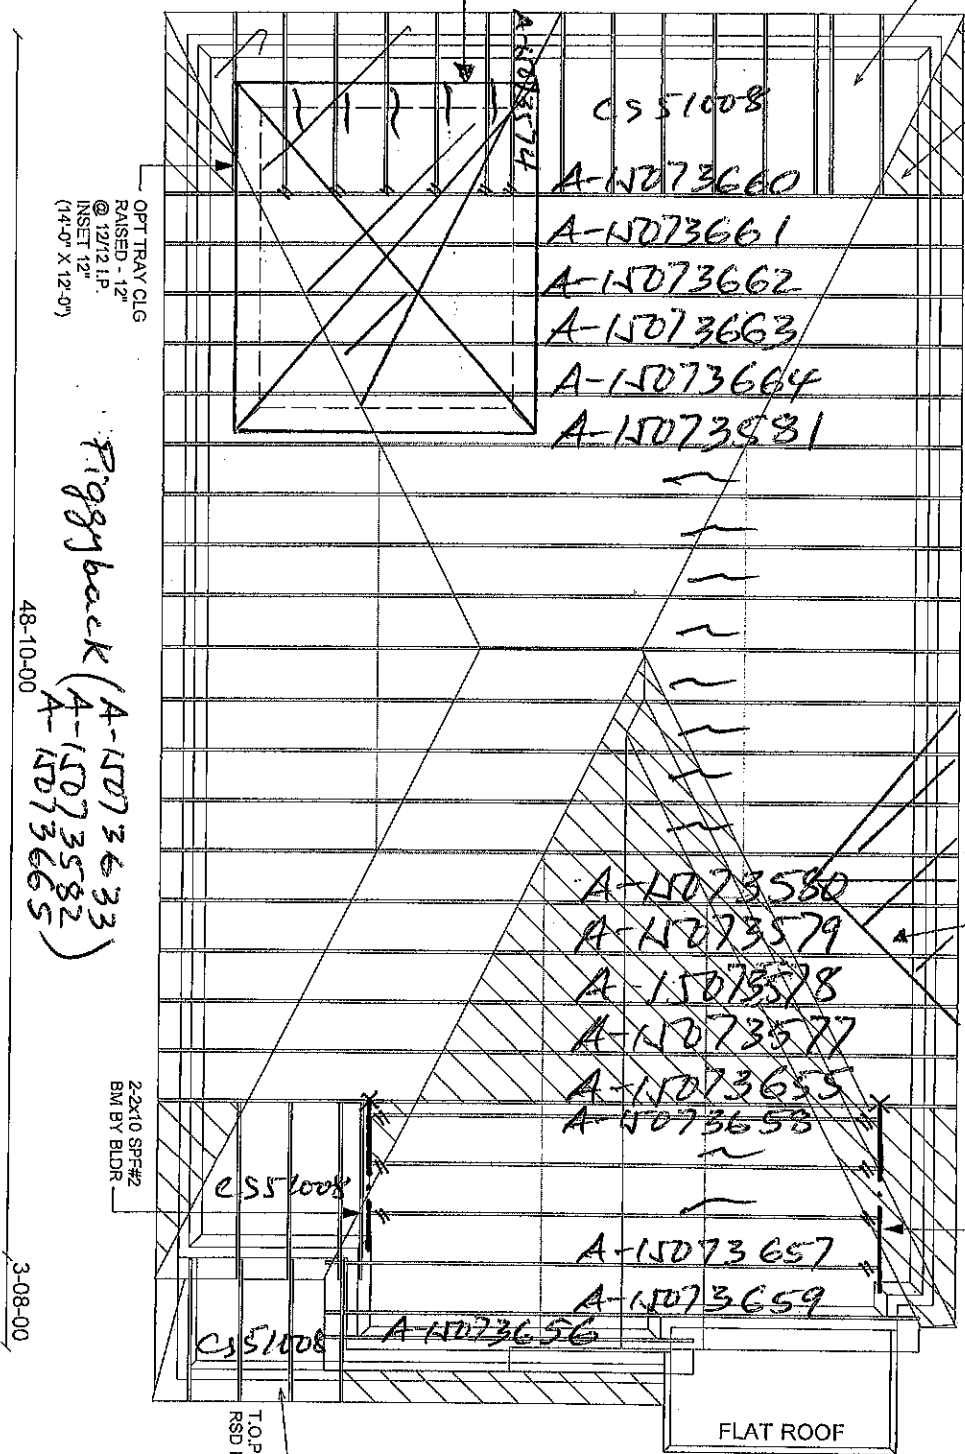

- H01T
- H02T
- H03T
- H04T
- H05T
- H07
- H06(9)
- H08(3)
- H07
- H05
- H04
- H03
- H02
- H01
- H11S(3)
- H12(6)
- H11
- H11SG
- H10G

50-06-00

1-00-00
1-00-00

ALPA-BARRIE

(SIDE UGR'D)

HANGERS
// LUS24
X HHUS26-2

CONVENTIONAL FRAMING BY OTHERS

Milltek Ver 7.5.0



Job Track: 40297
Layout ID: 253439
Plan Log: 79711


Builder / Location: GOLD PARK / KLEINBURG
Project: HUNTINGTON & NASHVILLE
Date: 4/22/2015
Designer: cheryle

Model / Elevation: 38-4 / A OPT TRAY
dt or side UGR'D
THESE DRAWINGS CONSTITUTE THE PROPERTY OF ALPA ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY ALPA ROOF TRUSSES INC AND WILL BE RETRACTED BY ALPA ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

ALL CON. FRAMING TO CONFORM WITH PART 9 OF O.S.C. 2012. ROOF TRUSSES THAT CROSS OVER TRUSSES TO BE 2X4 SP#2 24" O.C. UNDERNEATH AT EACH CROSS JOINT. VERT. POST LONGER THAN 8' TO HAVE LATERAL BRACING SO AS TO NOT EXCEED 8' BETWEEN ROWS OF BRACING. DOES NOT EXCEED 8'.

51-08-00
2-01-00
H01
H02
H03
H04
H05
H06(9)
H07
H08(3)
H09
H10
H11
H11SG
H10G
H11S(3)
H12(5)

ALPA-BARRIE

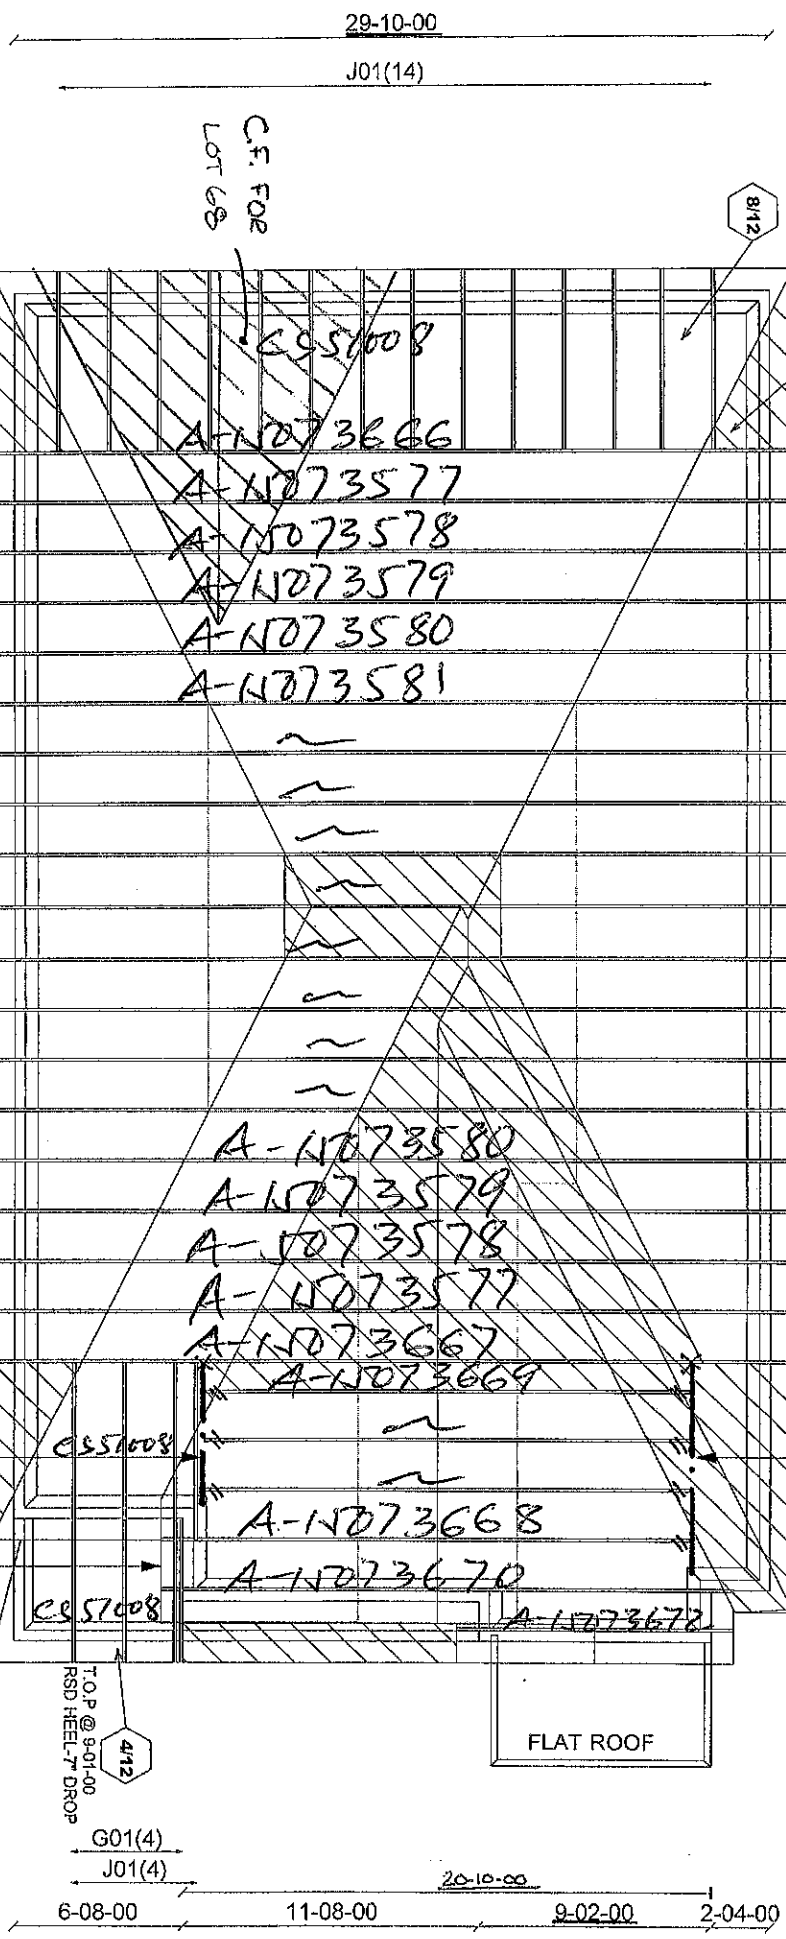

C.F. FOR LOT 68

CS51008
A-N073666
A-N073577
A-N073578
A-N073579
A-N073580
A-N073581

A-N073580
A-N073579
A-N073578
A-N073577
A-N073667
A-N073669

A-N073668
A-N073670
A-N073672

12" FIN. OH.
RSD. HEEL - 0" DROP
(2" x 6" FASCIA) - FM
ASPHALT SHINGLES
2" x 6" BRG/BRICK
PIGGYBACK TRS
PURLINS BY OTHERS

Piggyback (A-N073582)
(A-N073633)
(A-N073671)
48-10-00

3-04-00 1-19

HANGERS
// LUS24
X HHUS26-2



Job Track: 40297
Layout ID: 253440
Plan Log: 79711

Builder / Location: GOLD PARK / KLEINBURG
Project: HUNTINGTON & NASHVILLE
Date: 4/22/2015
Designer: cheryle

Model / Elevation: 38-4 / B
STD OR LOT 68 (REAR VIEWED)
THESE DRAWINGS CONSTITUTE THE PROPERTY OF ALPA ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY ALPA ROOF TRUSSES INC AND WILL BE RETRACTED BY ALPA ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

CONVENTIONAL FRAMING BY OTHERS

Mike Ver 7.5.0

ALL GYM FRAMING TO CONFORM WITH CITY OF MEMPHIS ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2x4 SPS #2 24" O.C. WITH A VERT. POST TO THE TRUSS WITHIN 12" OF THE TRUSS. VERT. POST LONGER THAN 6" TO HAVE LATERAL BRACING SO THAT THE DIST. BETWEEN END PT. & BETWEEN JOINS OF BRACING DOES NOT EXCEED 9'

H01T
H02T
H03T
H04T
H05T

H07
H08(3)
H07


H05
H04
H03
H02
H01

H11S(3)
H12(5)
H11
H11SG
H10G

51-08-00

2-01-00

ALPHA-BARRIE

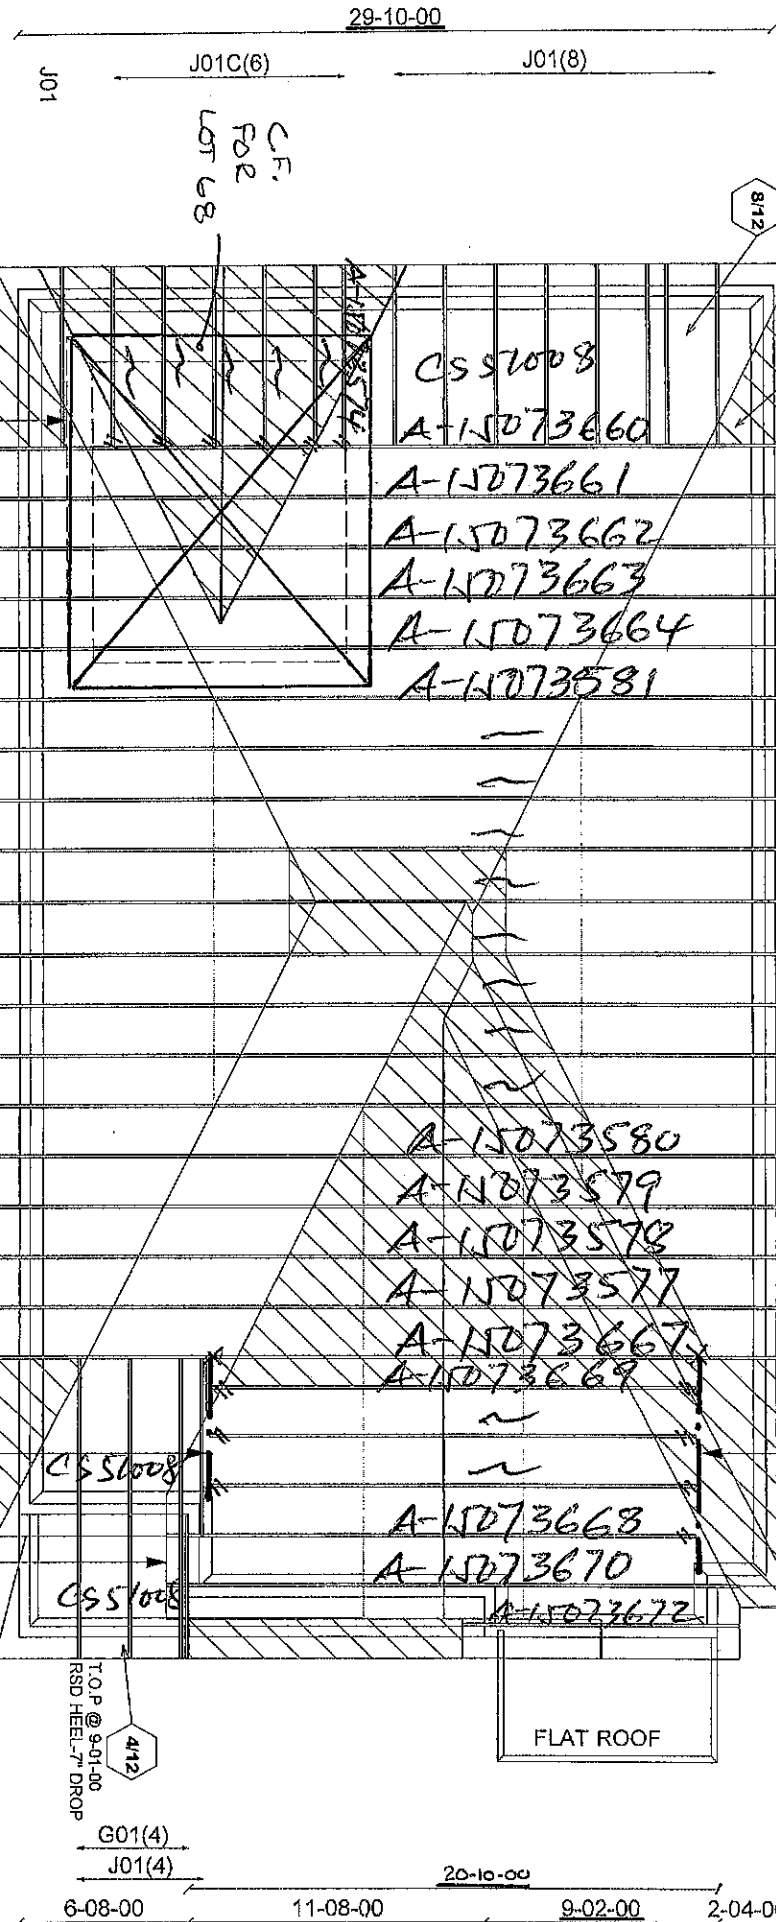

12" FIN. OH.
RSD. HEEL - 0" DROP
(2" x 6" FASCIA) - FM
ASPHALT SHINGLES
2" x 6" BRG/BRICK
PIG/BACK TRS
PURLINS BY OTHERS

Piggyback
(A-15073582)
(A-15073633)
(A-15073671)

HANGERS
// LUS24
X HHUS26-2



Job Track: 40297
Layout ID: 253441
Plan Log: 79711

Builder / Location: GOLD PARK / KLEINBURG
Project: HUNTINGTON & NASHVILLE
Date: 4/22/2015 Designer: cheryle

Model / Elevation: 38-4 / B OPT TRAY
STD 02 LOT 68 (REAR W/END)




Millk Ver: 7.5.0

PL80980, 82444, 85248, 88463, (LOT 68)

THESE DRAWINGS CONSTITUTE THE PROPERTY OF ALPHA ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY ALPHA ROOF TRUSSES INC AND WILL BE RETRACTED BY ALPHA ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Stracon Engineering Inc.

69 Graydon Crescent
Richmond Hill, Ontario
L4B 3W7
(905) 832-2250 Fax (905) 832-0286

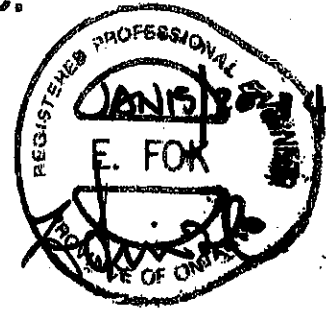

RESPONSIBILITIES

1. Stracon Engineering Inc. is responsible for the design of trusses as individual components.
2. It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities with jurisdictions.
3. All dimensions are to be verified by owner contractor, architect or other authority before manufacture.
4. Stracon Engineering Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Stracon Engineering Inc. drawings is specified for the truss as a component only and forms an integral part of the truss design.
5. It is the truss manufacture's responsibility to ensure that trusses are manufactured in conformance with Stracon Engineering Inc. specifications outlined below.

SPECIFICATIONS

1. Trusses designed by Stracon Engineering Inc. conforms to the relevant section of the Ontario Building Code of Canada (Part 9 or Part 4) or to the Canadian code for farm buildings, whichever applies to the building type indicated on the drawings as well as to the procedures established by the truss plate institute of Canada. Unit stresses used are as per CSA-086-09.
2. Lumber is to be the sizes and grade specified.
3. Moisture content of lumber is not to exceed 19% in service unless otherwise specified.
4. Lumber not to be treated with chemicals unless otherwise specified.
5. Plates shall be applied to both faces of the truss at each joint and shall be positioned as specified.
6. The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals not exceeding 12.5 times in thickness.
7. Where not rigid ceiling is attached directly to the bottom chord, laterally brace the chords at intervals not exceeding 3M (10') o.c.

January 15, 2014



GABLE STUDS SPACED AT 2'-0" O.C.

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per
OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY
APPLIED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED				
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
L-B	-186 / 0	0.0	0.0	0.02 (1)	7.81	J-D	-131 / 0	0.14 (1)
A-B	0 / 40	-70.5	-70.5	0.10 (1)	10.00	K-C	-141 / 0	0.08 (1)
B-C	-18 / 0	-70.5	-70.5	0.04 (1)	6.25	I-E	-141 / 0	0.08 (1)
C-D	-11 / 0	-70.5	-70.5	0.04 (1)	6.25			
D-E	-11 / 0	-70.5	-70.5	0.04 (1)	6.25			
E-F	-18 / 0	-70.5	-70.5	0.04 (1)	6.25			
F-G	0 / 40	-70.5	-70.5	0.10 (1)	10.00			
H-F	-186 / 0	0.0	0.0	0.02 (1)	7.81			
L-K	0 / 11	-17.5	-17.5	0.02 (4)	10.00			
K-J	0 / 7	-17.5	-17.5	0.02 (4)	10.00			
J-I	0 / 7	-17.5	-17.5	0.02 (4)	10.00			
I-H	0 / 11	-17.5	-17.5	0.02 (4)	10.00			

TOTAL WEIGHT = 49 lb

[M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	21.0	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	31.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.10 (A-B:1), BC=0.02 (H-I:4), WB=0.14 (D-J:1), SSI=0.05 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TQL. = 5.0 Deg.

JSI GRIP= 0.17 (F) (INPUT = 0.90)
JSI METAL= 0.06 (F) (INPUT = 1.00)



A-15073672

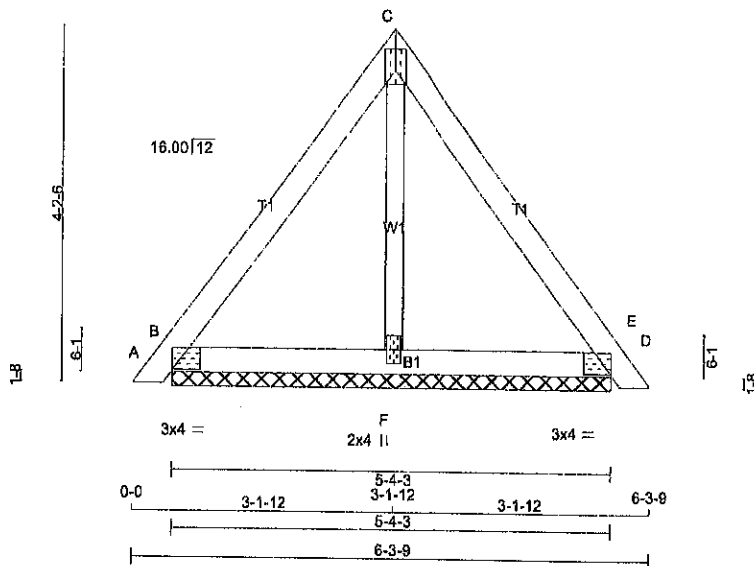

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR.
 A - C 2x4 DRY No.2 SPF
 C - E 2x4 DRY No.2 SPF
 B - D 2x4 DRY No.2 SPF
 ALL WEBS 2x3 DRY No.2 SPF
 DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	1.50	2.75
C	TTW+p	MT20	3.0	5.0	2.00	Edge
D	TMB1-I	MT20	3.0	4.0	1.50	2.75
F	BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)
 1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
B	189	0	189	0	5-4-3	1-8
D	189	0	189	0	5-4-3	1-8
F	143	0	143	0	5-4-3	1-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	130	102 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0
D	130	102 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0
F	104	50 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

LOADING
 TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)			FACTORED VERT. LOAD (PLF)			WEBS MAX. FACTORED FORCE (LBS)		
	FR-TO	FROM	TO	FR-TO	FROM	TO	FR-TO	FROM	TO
A-B	0 / 9	-70.5	-70.5	0.01 (1)	10.00	F-C	-84 / 0	0.02 (1)	
B-C	-64 / 0	-70.5	-70.5	0.09 (1)	6.25				
C-D	-64 / 0	-70.5	-70.5	0.08 (1)	6.25				
D-E	0 / 9	-70.5	-70.5	0.01 (1)	10.00				
B-F	0 / 38	-17.5	-17.5	0.04 (4)	10.00				
F-D	0 / 38	-17.5	-17.5	0.04 (4)	10.00				

TOTAL WEIGHT = 5 X 21 = 104 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 21.0 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09 (B-C:1), BC=0.04 (B-F:4), WB=0.02 (C-F:1), SSI=0.04 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.32 (D) (INPUT = 0.90)
 JSI METAL= 0.05 (D) (INPUT = 1.00)



A-L073671

253440


H11SG

QUANTITY
1PLY
1JOB DESC.
TRUSS DESC.

DRWG NO.

Alpa Roof Truss, Maple

Version 7.620 S Apr 15 2015 MITek Industries, Inc. Wed Jul 15 13:58:41 2015 Page 1

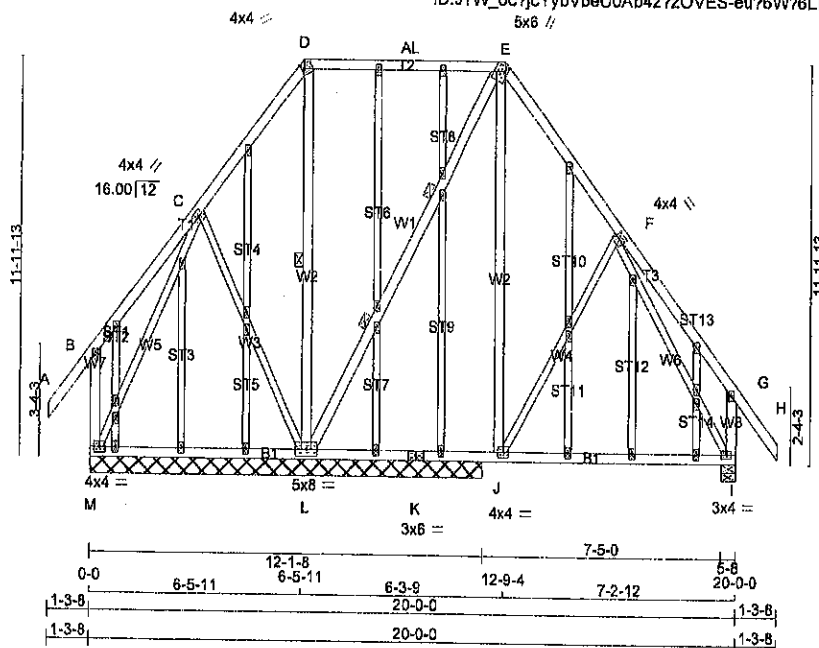ID:9?W_oc?jcybVbeU0Ab4z?zOVES-eu76W76LNCty4IM9bEP0V7fco662kGxnA9PzzbyxpQI
Scale = 1:70.0

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
M - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2

ALL WEBS	2x4	DRY	No.2
EXCEPT			
C - L	2x3	DRY	No.2
J - F	2x3	DRY	No.2
M - C	2x3	DRY	No.2
F - I	2x3	DRY	No.2

ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

GABLE STUDS SPACED AT 2'-0-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	2.0	4.0		
C TMVW+I	MT20	4.0	4.0		
D TTW+m	MT20	4.0	4.0	1.75	1.00
E TTW+m	MT20	5.0	6.0	1.75	1.00
F TMVW+I	MT20	4.0	4.0	2.00	1.75
G TMV+p	MT20	2.0	4.0		
I BMVW+I	MT20	3.0	4.0		
J BMVW+I	MT20	4.0	4.0		
K BS-I	MT20	3.0	6.0		
L BMVW+I	MT20	5.0	8.0		
M BMVW+I	MT20	4.0	4.0		
N O, P, Q, R, S, T, U, V, W, X, Y, Z, AA, AB, AC, AD, AE, AF, AG, AH, AI, AJ, AK, AL	MT20	2.0	4.0		
N NP+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION VERT	FACTORED GROSS REACTION HORZ	MAXIMUM FACTORED GROSS REACTION DOWN	MAXIMUM FACTORED GROSS REACTION HORZ	INPUT BRG UPLIFT	REQD BRG IN-SX
L	952	0	952	0	12-1-8 (10-0-0) 3-8	10-0-0 3-8
M	366	0	366	0	12-1-8 (10-0-0) 3-8	1-8
I	686	0	686	0	6-8	1-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	675	436 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
M	256	167 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0
I	482	335 / 0	0 / 0	0 / 0	0 / 0	148 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, M, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF D-L.
2 LATERAL BRACE(S) REQUIRED AT 1/3 LENGTH OF E-L.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 40	-70.5 -70.5	0.10 (1)	10.00	C-L	-158 / 0	0.22 (1)
B-C	0 / 23	-70.5 -70.5	0.13 (1)	10.00	L-D	-338 / 0	0.26 (1)
C-D	-13 / 0	-70.5 -70.5	0.10 (1)	6.25	L-E	-396 / 0	0.17 (1)
D-A	0 / 11	-78.0 -78.0	0.63 (1)	10.00	J-E	0 / 236	0.04 (1)
AL-E	0 / 11	-78.0 -78.0	0.63 (1)	10.00	J-F	-123 / 0	0.15 (1)
E-F	-312 / 0	-70.5 -70.5	0.12 (1)	6.25	M-C	-146 / 0	0.19 (1)
F-G	0 / 25	-70.5 -70.5	0.15 (1)	10.00	F-I	-497 / 0	0.67 (1)
G-H	0 / 40	-70.5 -70.5	0.10 (1)	10.00			
M-B	-186 / 0	0.0 0.0	0.04 (1)	7.81			
I-G	-193 / 0	0.0 0.0	0.02 (1)	7.81			
M-L	0 / 59	-17.5 -17.5	0.16 (4)	10.00			
L-K	0 / 175	-17.5 -17.5	0.21 (4)	10.00			
K-J	0 / 175	-17.5 -17.5	0.21 (4)	10.00			
J-I	0 / 233	-17.5 -17.5	0.21 (4)	10.00			

TOTAL WEIGHT = 180 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	21.0	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	31.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND 8.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.46")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.46")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: TC=0.53 (D-E:1), BC=0.21 (J-L:4), WB=0.57 (F-I:1), SSI=0.19 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.60

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1667	822
	2284	1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (I) (INPUT = 0.90)

JSI METAL= 0.20 (F) (INPUT = 1.00)



A-15073670

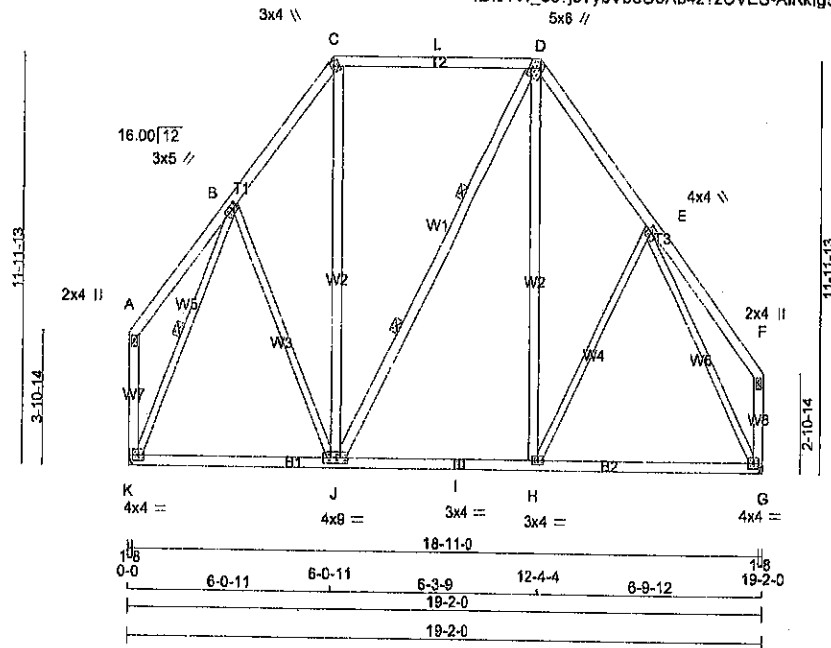

LUMBER
 N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
B - J	2x3	DRY	No.2
H - E	2x3	DRY	No.2
K - B	2x3	DRY	No.2
E - G	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	2.0	4.0		
B	TMVW-t	MT20	3.0	5.0	1.50	2.00
C	TTW+m	MT20	3.0	4.0	1.75	1.00
D	TTW+m	MT20	5.0	6.0	1.75	1.00
E	TMVW-t	MT20	4.0	4.0	1.75	1.25
F	TMV+p	MT20	2.0	4.0		
G	BMVW-t	MT20	4.0	4.0		
H	BMVW-t	MT20	3.0	4.0		
I	BS-t	MT20	3.0	4.0		
J	BMVW-t	MT20	4.0	9.0		
K	BMVW-t	MT20	4.0	4.0		

NOTES: (1)
 1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
K	867	0	867	0	0	0
G	866	0	866	0	0	0

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX/MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE	SNOW	LIVE				
K	813	402 / 0	0 / 0	0 / 0	0 / 0	0 / 0	211 / 0	0 / 0
G	812	402 / 0	0 / 0	0 / 0	0 / 0	0 / 0	210 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

2 LATERAL BRACE(S) REQUIRED AT 1/3 LENGTH OF D-J.
 1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF B-K.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	MAX	MEMB. FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM TO				FR-TO		
A-B	0 / 19	-70.5	-70.5	0.10 (1)	10.00	B-J	0 / 54	0.02 (4)
B-C	-553 / 0	-70.5	-70.5	0.08 (1)	6.25	J-C	0 / 102	0.02 (4)
C-L	-319 / 0	-78.0	-78.0	0.53 (1)	6.25	J-D	-41 / 0	0.02 (1)
L-D	-319 / 0	-78.0	-78.0	0.53 (1)	6.25	H-D	0 / 149	0.03 (4)
D-E	-586 / 0	-70.5	-70.5	0.10 (1)	6.25	H-E	-26 / 31	0.03 (1)
E-F	0 / 22	-70.5	-70.5	0.13 (1)	10.00	K-B	-796 / 0	0.35 (1)
K-A	-85 / 0	0.0	0.0	0.02 (1)	7.81	E-G	-805 / 0	0.98 (1)
G-F	-89 / 0	0.0	0.0	0.01 (1)	7.81			
K-J	0 / 268	-17.5	-17.5	0.17 (4)	10.00			
J-I	0 / 336	-17.5	-17.5	0.21 (4)	10.00			
I-H	0 / 336	-17.5	-17.5	0.21 (4)	10.00			
H-G	0 / 348	-17.5	-17.5	0.21 (4)	10.00			

TOTAL WEIGHT = 3 X 127 = 380 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 21.0 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 096-09
 - TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.64")
 CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
 ALLOWABLE DEFL.(TL)= L/360 (0.64")
 CALCULATED VERT. DEFL.(TL)= L/999 (0.07")

CS1: TC=0.53 (C-D:1), BC=0.21 (H-J:4), WB=0.98 (E-G:1), SSI=0.19 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 616 364 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (H) (INPUT = 0.90)
 JSI METAL= 0.30 (E) (INPUT = 1.00)

A-11073669



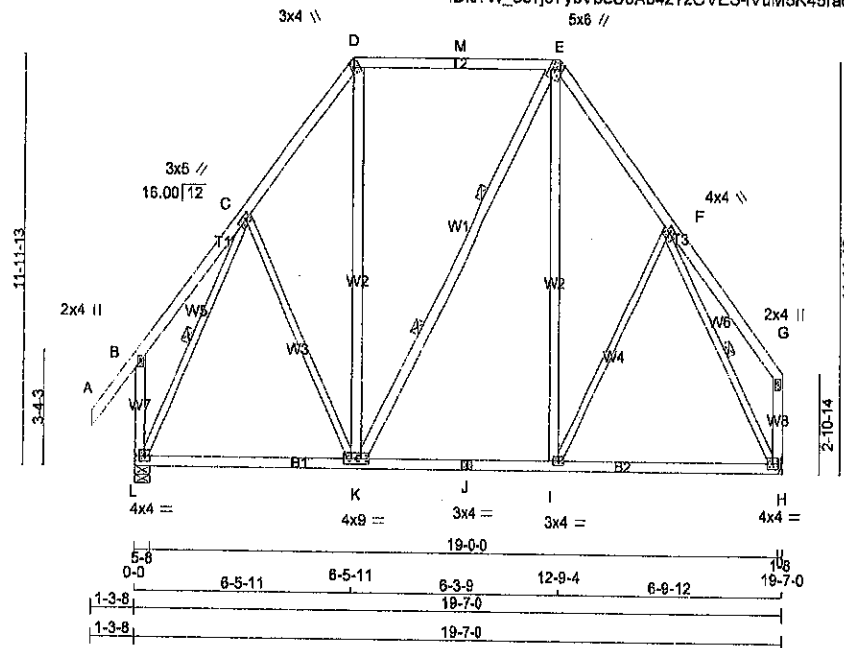

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
C - K	2x3	DRY	No.2
I - F	2x3	DRY	No.2
L - C	2x3	DRY	No.2
F - H	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
C	TMWW-t	MT20	3.0	5.0 1.50 2.00
D	TTW+m	MT20	3.0	4.0 1.75 1.00
E	TTWW+m	MT20	5.0	6.0 1.75 1.00
F	TMWW-t	MT20	4.0	4.0 1.75 1.25
G	TMV+p	MT20	2.0	4.0
H	BMVW1-t	MT20	4.0	4.0
I	BMWW-t	MT20	3.0	4.0
J	BS-t	MT20	3.0	4.0
K	BMWWW-t	MT20	4.0	9.0
L	BMVW1-t	MT20	4.0	4.0

NOTES: (1)
 1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
L	984	0	5-8	1-8
H	884	0	5-8	1-8

HANGER BY OTHERS
MIN. SEAT SIZE: 1-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. SNOW	COMPONENT REACTIONS LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	694	470 / 0	0 / 0	0 / 0	0 / 0	223 / 0	0 / 0
H	825	411 / 0	0 / 0	0 / 0	0 / 0	214 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

2 LATERAL BRACE(S) REQUIRED AT 1/3 LENGTH OF E-K.
 1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF C-L, F-H.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)
FR-TO					FR-TO		
A-B	0 / 40	-70.5	-70.5 0.10 (1)	10.00	C-K	0 / 42	0.01 (4)
B-C	0 / 20	-70.5	-70.5 0.12 (1)	10.00	K-D	0 / 125	0.03 (4)
C-D	-590 / 0	-70.5	-70.5 0.09 (1)	6.25	K-E	-18 / 0	0.01 (1)
D-M	-341 / 0	-78.0	-78.0 0.53 (1)	6.25	I-E	0 / 143	0.03 (4)
M-E	-341 / 0	-78.0	-78.0 0.53 (1)	6.25	I-F	-20 / 32	0.03 (1)
E-F	-604 / 0	-70.5	-70.5 0.10 (1)	6.25	L-C	-619 / 0	0.34 (1)
F-G	0 / 22	-70.5	-70.5 0.13 (1)	10.00	F-H	-826 / 0	0.33 (1)
L-B	-189 / 0	0.0	0.0 0.04 (1)	7.81			
H-G	-89 / 0	0.0	0.0 0.01 (1)	7.81			
L-K	0 / 334	-17.5	-17.5 0.19 (4)	10.00			
K-J	0 / 349	-17.5	-17.5 0.21 (4)	10.00			
J-I	0 / 349	-17.5	-17.5 0.21 (4)	10.00			
I-H	0 / 357	-17.5	-17.5 0.21 (4)	10.00			

TOTAL WEIGHT = 130 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH	LL	= 21.0 PSF
	DL	= 3.0 PSF
BOT CH	LL	= 0.0 PSF
	DL	= 7.0 PSF
TOTAL LOAD		= 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND 6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, CBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(65 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360 (0.85")$
 CALCULATED VERT. DEFL.(LL) = $L/899 (0.01")$
 ALLOWABLE DEFL.(TL) = $L/360 (0.85")$
 CALCULATED VERT. DEFL.(TL) = $L/999 (0.07")$

CSI: TC=0.53 (D-E:1), BC=0.21 (I-K:4), WB=0.34 (C-L:1), SSI=0.19 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.85 (I) (INPUT = 0.90)
 JSI METAL=0.31 (F) (INPUT = 1.00)



A-15073668

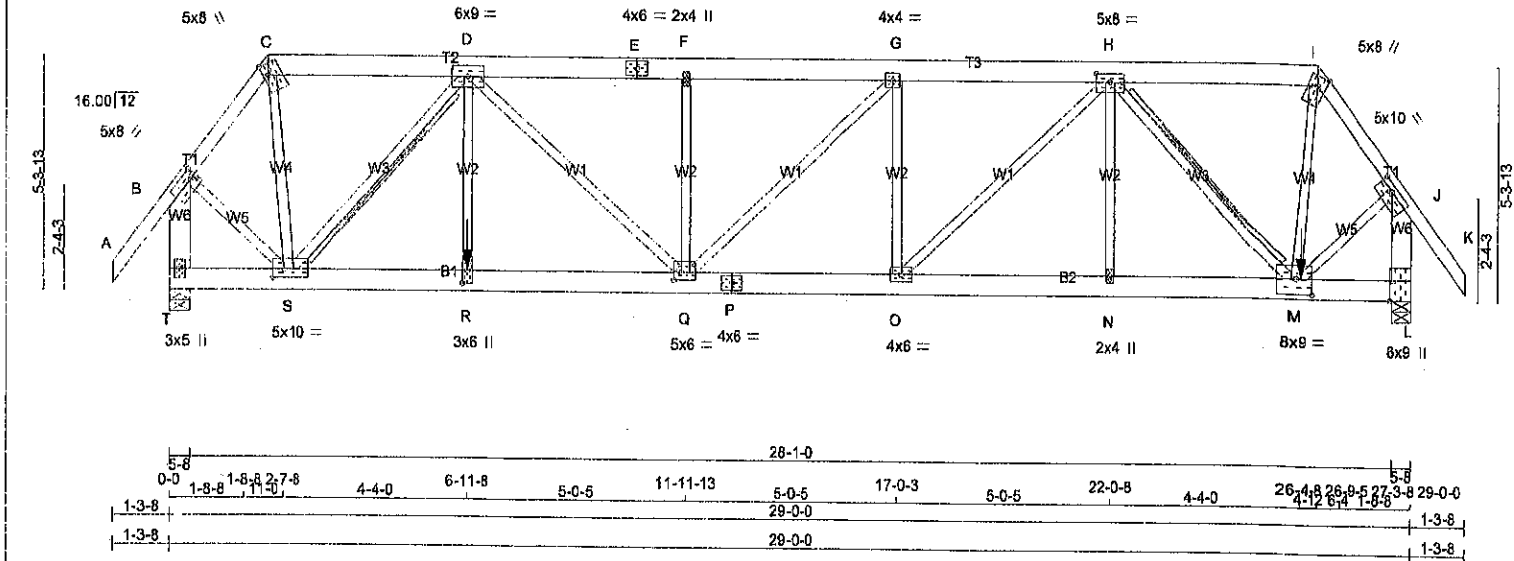

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x6	DRY	No.2
E - I	2x6	DRY	No.2
I - K	2x4	DRY	No.2
T - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
T - P	2x6	DRY	No.2
P - L	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	8.0	2.25 2.00
C	TTW+m	MT20	5.0	8.0	3.00 1.25
D	TMVWW-t	MT20	6.0	9.0	
E	TS-t	MT20	4.0	6.0	
F	TMW+w	MT20	2.0	4.0	
G	TMVWW-t	MT20	4.0	4.0	
H	TMVWW-t	MT20	5.0	8.0	2.25 4.00
I	TTW+m	MT20	5.0	8.0	2.50 2.25
J	TMVW-t	MT20	5.0	10.0	1.50 4.25
L	BMV1+L	MT20	6.0	9.0	Edge 0.60
M	BMVWW-t	MT20	8.0	9.0	4.25 4.50
N	BMW+w	MT20	2.0	4.0	
O	BMVW-t	MT20	4.0	6.0	
P	BS-t	MT20	4.0	6.0	
Q	BMVWW-t	MT20	5.0	6.0	2.00 2.00
R	BMW+w	MT20	3.0	6.0	3.50 1.60
S	BMVWW-t	MT20	5.0	10.0	2.25 3.25
T	BMV1+p	MT20	3.0	5.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
T	2614	0	2614	0	5-8
L	3617	0	3617	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	DOWN	UP	DOWN	UP	DOWN	UP
T	1839	1259 / 0	0 / 0	0 / 0	0 / 0	0 / 0	580 / 0	0 / 0
L	2546	1736 / 0	0 / 0	0 / 0	0 / 0	0 / 0	808 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.89FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

2x4 DRY SPF No.2 T-BRACE REQUIRED AT D-S, H-M
FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3"
COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 40	-70.5	-70.5 0.11 (1)	R-D	0 / 1371
B-C	-2020 / 0	-70.5	-70.5 0.13 (1)	D-Q	0 / 602
C-D	-1360 / 0	-70.5	-70.5 0.13 (1)	Q-F	-358 / 0
D-E	-3519 / 0	-70.5	-70.5 0.18 (1)	Q-G	0 / 195
E-F	-3519 / 0	-70.5	-70.5 0.18 (1)	Q-H	-489 / 0
F-G	-3519 / 0	-70.5	-70.5 0.17 (1)	Q-I	0 / 812
G-H	-3379 / 0	-70.5	-70.5 0.17 (1)	N-H	0 / 102
H-I	-1899 / 0	-70.5	-70.5 0.13 (1)	B-S	0 / 1485
I-J	-2805 / 0	-70.5	-70.5 0.18 (1)	M-J	0 / 2035
J-K	0 / 40	-70.5	-70.5 0.11 (1)	C-S	0 / 1397
T-B	-2621 / 0	0.0	0.0 0.23 (1)	M-I	0 / 2036
L-J	-3571 / 0	0.0	0.0 0.32 (1)	S-D	-2747 / 0
				H-M	-1389 / 0
T-S	0 / 0	-17.5	-17.5 0.06 (1)		
S-R	0 / 3158	-17.5	-17.5 0.49 (1)		
R-Q	0 / 3158	-17.5	-17.5 0.50 (1)		
Q-P	0 / 3379	-17.5	-17.5 0.47 (1)		
P-O	0 / 3379	-17.5	-17.5 0.47 (1)		
O-N	0 / 2796	-17.5	-17.5 0.40 (1)		
N-M	0 / 2796	-17.5	-17.5 0.42 (1)		
M-L	0 / 0	-17.5	-17.5 0.04 (1)		

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
JT								
M	26-4-6	-2115	-2115	---	---	FRONT	VERT	TOTAL
R	6-11-8	-1367	-1367	---	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:						
TOP CH.	LL	=	21.0	PSF		
	DL	=	3.0	PSF		
BOT CH.	LL	=	0.0	PSF		
	DL	=	7.0	PSF		
TOTAL LOAD		=	31.0	PSF		

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(65% OF 23.0 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.32 (J-L:1), BC=0.50 (Q-R:1), WB=0.86 (D-S:1), SSI=0.13 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP(DRY) SHEAR	SECTION
		(PSI)	(PLI)
		MAX MIN	MAX MIN
MT20	618 354	1687 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (S) (INPUT = 0.90)
JSI METAL= 0.83 (P) (INPUT = 1.00)

A-12073667
CONTINUED ON PAGE 2

253440

H01-Cond1

QUANTITY


PLY

JOB DESC.

DRWG NO.

Alpa Roof Truss, Maple

Version 7.620 S Apr 15 2015 MITek Industries, Inc. Wed Jul 15 13:58:38 2015 Page 1
 ID:97W_oc7jYybVbeU0Ab4z7zOVES-EJKzt_4T4HVNDIdav6sJuv18iv_EXILUBAJM GyxpQI
 Scale = 1:53.1

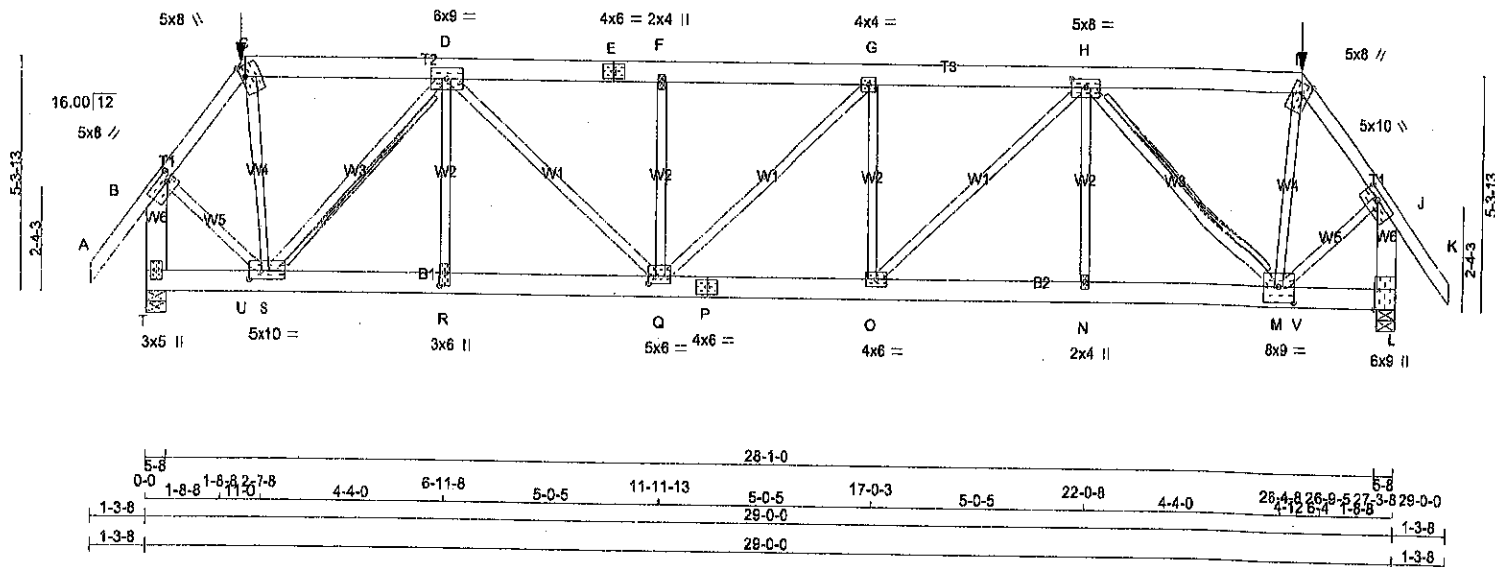

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x6	DRY	No.2
E - I	2x6	DRY	No.2
I - K	2x4	DRY	No.2
T - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
T - P	2x6	DRY	No.2
P - L	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	8.0	2.25	2.00
C	TTW+m	MT20	5.0	8.0	3.00	1.25
D	TMVWV-I	MT20	6.0	9.0		
E	TS-I	MT20	4.0	6.0		
F	TMVW+w	MT20	2.0	4.0		
G	TMVWV-I	MT20	4.0	4.0		
H	TMVWV-I	MT20	5.0	8.0	2.25	4.00
I	TTW+m	MT20	5.0	8.0	2.50	2.25
J	TMVW-I	MT20	5.0	10.0	1.50	4.25
L	BMV1+I	MT20	8.0	9.0	Edges	0.50
M	BMVWV-I	MT20	8.0	9.0	4.25	4.50
N	BMVW+w	MT20	2.0	4.0		
O	BMVWV-I	MT20	4.0	6.0		
P	BS-I	MT20	4.0	6.0		
Q	BMVWV-I	MT20	5.0	6.0	2.00	2.00
R	BMVW+w	MT20	3.0	6.0	3.50	1.50
S	BMVWV-I	MT20	5.0	10.0	2.25	3.25
T	BMV1+P	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
 TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UPLIFT	IN-SX
T	2572	0	5-8	2-14
L	2572	0	5-8	2-14

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE	PERM.LIVE
T	1811	1235 / 0	0 / 0	0 / 0
L	1811	1235 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.16FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

2x4 DRY SPF No.2 T-BRACE REQUIRED AT D-S, H-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
	(LBS)	LC1		(LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 40	-70.5 -70.5	R-D	0 / 176
B-C	-1955 / 0	-70.5 -70.5	D-Q	0 / 1231
C-D	-1291 / 0	-138.7 -138.7	Q-F	-577 / 0
D-E	-3700 / 0	-138.7 -138.7	Q-G	-12 / 0
E-F	-3700 / 0	-138.7 -138.7	Q-H	-682 / 0
F-G	-3700 / 0	-138.7 -138.7	O-H	0 / 1248
G-H	-3709 / 0	-138.7 -138.7	N-H	0 / 176
H-I	-1291 / 0	-138.7 -138.7	B-S	0 / 1418
I-J	-1956 / 0	-70.5 -70.5	M-J	0 / 1418
J-K	0 / 40	-70.5 -70.5	C-S	0 / 1113
T-B	-2542 / 0	0.0 0.0	M-I	0 / 1112
L-J	-2543 / 0	0.0 0.0	S-D	-2329 / 0
			H-M	-2325 / 0
T-U	0 / 0	-34.5 -34.5		
U-S	0 / 0	-34.5 -34.5		
S-R	0 / 2816	-34.5 -34.5		
R-Q	0 / 2816	-34.5 -34.5		
Q-P	0 / 3709	-34.5 -34.5		
P-O	0 / 3706	-34.5 -34.5		
O-N	0 / 2813	-34.5 -34.5		
N-M	0 / 2813	-34.5 -34.5		
M-V	0 / 0	-34.5 -34.5		
V-L	0 / 0	-34.5 -34.5		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	2-2-11	-114	-114		FRONT	VERT	TOTAL
I	26-9-5	-115	-115		FRONT	VERT	TOTAL

TOTAL WEIGHT = 169 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	21.0	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	31.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
 SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip

LEFT SETBACK = 2-2-11

RIGHT SETBACK = 2-2-12

END SETBACK = 6-10-8

END WALL WIDTH = 0-0

CORNER FRAMING TYPE: CONVENTIONAL

END JACK TYPE: CONVENTIONAL

APPLIED TO FRONT SIDE

- ADDTL LOADS BASED ON 55 % OF GSL

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
 OR SMALL BUILDING REQUIREMENTS OF
 PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS
 8.4 P.S.F. RAIN LOAD EQUALS
 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
 CALCULATED VERT. DEFL.(LL) = L/989 (0.12")
 ALLOWABLE DEFL.(TL) = L/360 (0.97")
 CALCULATED VERT. DEFL.(TL) = L/989 (0.22")

CSI: TC=0.33 (D-F:1), BC=0.54 (O-Q:1),
 WB=0.73 (D-S:1), SS=0.26 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT
 RESPONSIBLE FOR QUALITY CONTROL IN
 THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX
MT20	618	354
	1667	822
	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.90)
 JSI METAL= 0.75 (P) (INPUT = 1.00)

A-15073666

CONTINUED ON PAGE 2



JOBS NAME 253440	TRUSS NAME H01-Cond1	QUANTITY 1	PLY 1	JOB DESC. TRUSS DESC.	DRWG NO.
---------------------	-------------------------	---------------	----------	--------------------------	----------

Alpa Roof Truss, Maple

Version 7.620 8 Apr 15 2015 MiTek Industries, Inc. Wed Jul 15 13:58:38 2015 Page 2
ID:9?W oc?jcYybVbeU0Ab4z?zOVES-EJKzt 4T4HVNDIdav6sJuV18iv EXIILUBAJMGypQI

HANGERS NOTES


1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 114.5 lbs FACTORED DOWN AT 26-9-5, AND 114.2 lbs FACTORED DOWN AT 2-2-11 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

NOTES- (1)

1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.



A-N273666(2)

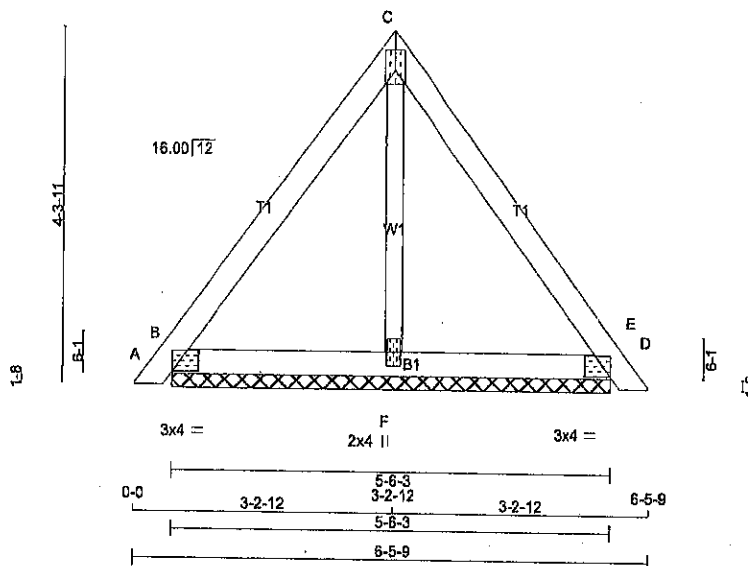**LUMBER****N. L. G. A. RULES**

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
B - D	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	1.50	2.75
C	TTW+p	MT20	3.0	5.0	2.00	Edge
D	TMB1-I	MT20	3.0	4.0	1.50	2.75
F	BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
B	VERT 194	DOWN 194	0	5-6-3
D	HORZ 0	HORZ 0	0	5-6-3
F	UP/LIFT 147	UP/LIFT 147	0	5-6-3

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
B	134	105 / 0	0 / 0	0 / 0	29 / 0	0 / 0
D	134	105 / 0	0 / 0	0 / 0	29 / 0	0 / 0
F	108	62 / 0	0 / 0	0 / 0	58 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED				WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD	LC1	MAX	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM	TO			FR-TO		LENGTH	
A-B	0 / 9	-70.5	-70.5	0.01 (1)	10.00	F-C	-87 / 0	0.02 (1)	
B-C	-86 / 0	-70.5	-70.5	0.09 (1)	6.25				
C-D	-86 / 0	-70.5	-70.5	0.09 (1)	6.25				
D-E	0 / 9	-70.5	-70.5	0.01 (1)	10.00				
B-F	0 / 39	-17.5	-17.5	0.04 (4)	10.00				
F-D	0 / 39	-17.5	-17.5	0.04 (4)	10.00				

TOTAL WEIGHT = 5 X 21 = 107 lb

DESIGN CRITERIA**SPECIFIED LOADS:**

TOP CH.	LL = 21.0 PSF
	DL = 3.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.0 PSF
TOTAL LOAD	= 31.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09 (B-C:1), BC=0.04 (B-F:4), WB=0.02 (C-F:1), SSI=0.04 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX	MIN	MAX MIN
MT20	618	354 1687 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.32 (D) (INPUT = 0.90)
JSI METAL= 0.05 (D) (INPUT = 1.00)



A-11073665

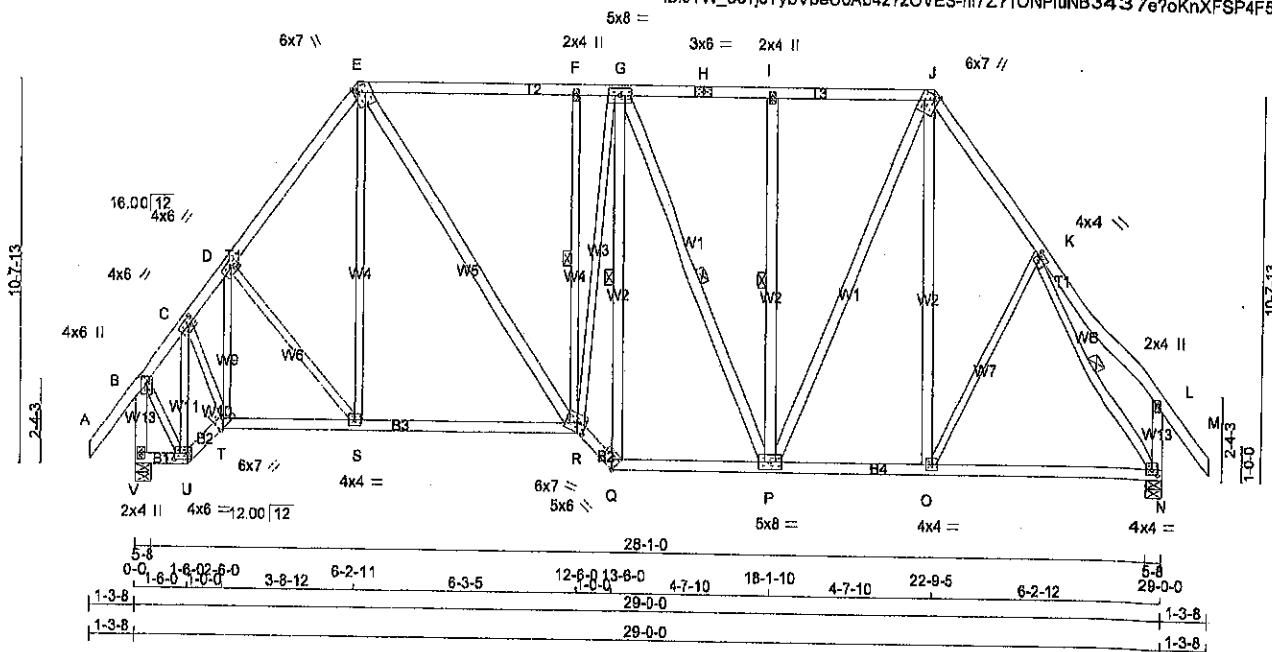

LUMBER

N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
A - E	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - M	2x4	DRY	No.2	SPF
V - B	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
V - U	2x4	DRY	No.2	SPF
U - T	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - Q	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
E - R	2x4	DRY	No.2	SPF
Q - G	2x4	DRY	No.2	SPF
G - P	2x4	DRY	No.2	SPF
P - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
Q - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

J	T	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	8.0	2.00	2.00
C	TMVW-i	MT20	4.0	8.0	2.00	2.50
D	TMVW-i	MT20	4.0	6.0	2.00	2.50
E	TTWV+m	MT20	6.0	7.0	Edge	1.50
F	TWVW+w	MT20	2.0	4.0		
G	TMVWVW-t	MT20	5.0	8.0		
H	TS-i	MT20	3.0	6.0		
I	TMVW+w	MT20	2.0	4.0		
J	TTWVW+m	MT20	6.0	7.0	Edge	1.50
K	TMVW-i	MT20	4.0	4.0	1.50	1.00
L	TMV+p	MT20	2.0	4.0		
N	BMVW-i	MT20	4.0	4.0	1.75	2.00
O	BMVW-i	MT20	4.0	4.0		
P	BMVWVW-t	MT20	5.0	8.0		
Q	BBW-h	MT20	5.0	6.0	Edge	2.50
R	BBVWVW-m	MT20	6.0	7.0	3.00	3.00



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

STEEL-TO-BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQ'D BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
V	1377	0	1377	0	0	5-8	1-8
N	1372	0	1372	0	0	5-8	1-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
V	968	669 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
N	964	666 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V. N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.79FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY
APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF F-R, G-Q, G-P, I-P, K-N.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN
THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MAX UNBRAC	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)			(LBS)	CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0 / 40	-70.5	-70.5	0.10 (1)	10.00	U-C	-948 / 0	0.25 (1)
B-C	-786 / 0	-70.5	-70.5	0.10 (1)	8.25	C-T	0 / 747	0.17 (1)
C-D	-1084 / 0	-70.5	-70.5	0.12 (1)	5.86	T-D	-264 / 0	0.08 (1)
D-E	-1141 / 0	-70.5	-70.5	0.14 (1)	5.80	D-S	-32 / 2	0.02 (1)
E-F	-995 / 0	-70.5	-70.5	0.36 (1)	5.79	S-E	0 / 129	0.04 (4)
F-G	-991 / 0	-70.5	-70.5	0.32 (1)	5.81	E-R	0 / 578	0.09 (1)
G-H	-850 / 0	-70.5	-70.5	0.22 (1)	8.25	R-F	-392 / 0	0.24 (1)
H-I	-950 / 0	-70.5	-70.5	0.22 (1)	8.25	R-G	0 / 881	0.19 (1)
I-J	-850 / 0	-70.5	-70.5	0.22 (1)	8.25	G-Q	-835 / 0	0.48 (1)
J-K	-1041 / 0	-70.5	-70.5	0.12 (1)	8.93	G-P	-119 / 0	0.08 (1)
K-L	0 / 19	-70.5	-70.5	0.10 (1)	10.00	P-I	-356 / 0	0.20 (1)
L-M	0 / 40	-70.5	-70.5	0.10 (1)	10.00	P-J	0 / 588	0.09 (1)
V-B	-1384 / 0	0.0	0.0	0.17 (1)	8.85	O-J	0 / 81	0.02 (4)
N-L	-183 / 0	0.0	0.0	0.02 (1)	7.81	C-K	0 / 84	0.02 (4)
						B-Q	0 / 710	0.16 (1)
V-U	0 / 0	-17.5	-17.5	0.01 (4)	10.00	K-N	-1291 / 0	0.40 (1)
U-T	0 / 579	-17.5	-17.5	0.10 (1)	10.00			
T-S	0 / 690	-17.5	-17.5	0.20 (4)	10.00			
S-R	0 / 671	-17.5	-17.5	0.20 (4)	10.00			
R-Q	0 / 1253	-17.5	-17.5	0.20 (1)	10.00			
Q-P	0 / 897	-17.5	-17.5	0.19 (1)	10.00			
P-O	0 / 810	-17.5	-17.5	0.20 (4)	10.00			
O-N	0 / 578	-17.5	-17.5	0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP CH.	LL	=	21.0	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	31.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TRC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.11")

CSI: TC=0.36 (E-F:1), BC=0.20 (Q-R:1),
WB=0.48 (G-Q:1), SSI=0.20 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1687	822	2284	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (K) (INPUT = 0.90)
JSI METAL= 0.46 (K) (INPUT = 1.00)

A-15073664

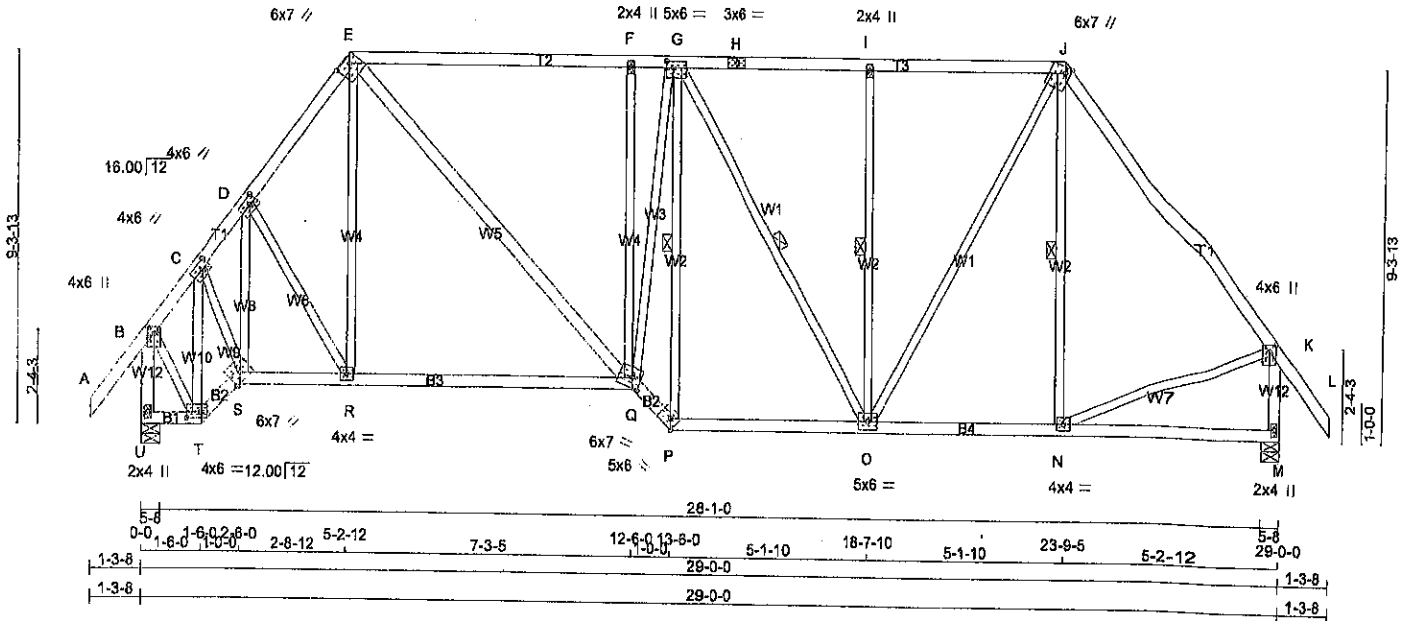

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
J - L	2x4	DRY	No.2
L - B	2x4	DRY	No.2
M - K	2x4	DRY	No.2
U - T	2x4	DRY	No.2
T - S	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
E - Q	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	2.00	2.00
C	TMVW-i	MT20	4.0	6.0	2.00	2.60
D	TMVW-i	MT20	4.0	6.0	2.00	2.60
E	TTVW-h	MT20	6.0	7.0	1.75	4.00
F	TMVW-w	MT20	2.0	4.0		
G	TMVWVW-i	MT20	6.0	6.0	2.00	2.00
H	TS-i	MT20	3.0	6.0		
I	TMVW-w	MT20	2.0	4.0		
J	TTVW+m	MT20	6.0	7.0	Edge	1.50
K	TMVW+p	MT20	4.0	6.0	2.00	2.00
M	BMV1+p	MT20	2.0	4.0		
N	BMVW-i	MT20	4.0	4.0		
O	BMVWVW-i	MT20	5.0	6.0		
P	BBVW-h	MT20	5.0	6.0	Edge	2.60
Q	BBVWVW-m	MT20	6.0	7.0	3.00	2.75
R	BMVW-i	MT20	4.0	4.0		
S	BBVW-h	MT20	6.0	7.0	Edge	
T	BBVW-i	MT20	4.0	6.0	1.75	4.25
U	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
U	1377	0	1377	0	0	5-8	1-8		
M	1372	0	1372	0	0	5-8	1-8		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS					
U	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
U	968	669 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0		
M	964	666 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.16FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF G-P, G-O, I-O, J-N. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 / 40	-70.5	-70.5 0.10 (1)	10.00	T-C	-954 / 0	0.25 (1)
B-C	-784 / 0	-70.5	-70.5 0.10 (1)	6.25	C-S	0 / 714	0.16 (1)
C-D	-1086 / 0	-70.5	-70.5 0.06 (1)	6.01	S-D	-241 / 0	0.08 (1)
D-E	-1167 / 0	-70.5	-70.5 0.06 (1)	6.82	D-R	0 / 22	0.01 (4)
E-F	-1176 / 0	-70.5	-70.5 0.06 (1)	5.16	R-E	0 / 123	0.04 (4)
F-G	-1168 / 0	-70.5	-70.5 0.47 (1)	5.17	E-Q	0 / 720	0.12 (1)
G-H	-963 / 0	-70.5	-70.5 0.28 (1)	5.96	Q-F	-518 / 0	0.70 (1)
H-I	-963 / 0	-70.5	-70.5 0.28 (1)	5.96	F-G	0 / 1079	0.24 (1)
I-J	-962 / 0	-70.5	-70.5 0.28 (1)	5.96	G-O	-967 / 0	0.55 (1)
J-K	-1029 / 0	-70.5	-70.5 0.10 (1)	10.00	O-I	-142 / 0	0.11 (1)
K-L	0 / 40	-70.5	-70.5 0.10 (1)	10.00	I-J	-401 / 0	0.23 (1)
L-M	-1394 / 0	0.0	0.0 0.17 (1)	6.95	C-J	0 / 703	0.16 (1)
M-K	-1336 / 0	0.0	0.0 0.17 (1)	7.01	N-J	-122 / 40	0.07 (1)
					B-T	0 / 714	0.16 (1)
					N-K	0 / 655	0.16 (1)
U-T	0 / 0	-17.5	-17.5 0.01 (4)	10.00			
T-S	0 / 583	-17.5	-17.5 0.10 (1)	10.00			
S-R	0 / 880	-17.5	-17.5 0.25 (4)	10.00			
R-Q	0 / 889	-17.5	-17.5 0.25 (4)	10.00			
Q-P	0 / 1444	-17.5	-17.5 0.24 (1)	10.00			
P-O	0 / 1032	-17.5	-17.5 0.22 (1)	10.00			
O-N	0 / 613	-17.5	-17.5 0.17 (1)	10.00			
N-M	0 / 0	-17.5	-17.5 0.11 (4)	10.00			

TOTAL WEIGHT = 173 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 21.0 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.87")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.87")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.55 (E-F:1), BC=0.25 (Q-R:4), WB=0.70 (F-Q:1), SSI=0.23 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.79 (B) (INPUT = 0.60)
JSI METAL= 0.28 (G) (INPUT = 1.00)



A-15073663

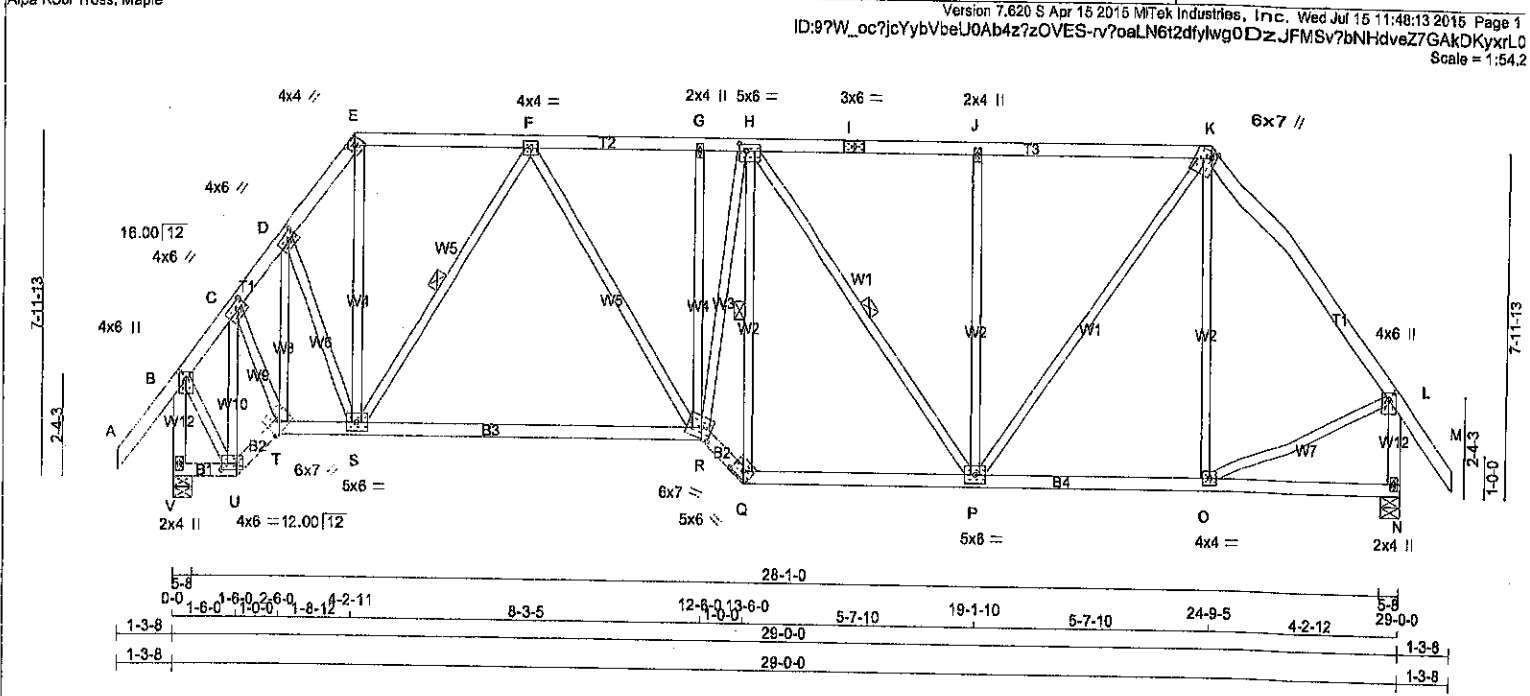

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
I - K	2x4	DRY	No.2	SPF
K - M	2x4	DRY	No.2	SPF
V - B	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
V - U	2x4	DRY	No.2	SPF
U - T	2x4	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - Q	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	2.00	2.00
C	TMVW-t	MT20	4.0	6.0	2.00	2.50
D	TMVW-t	MT20	4.0	6.0	2.00	2.50
E	TTW-h	MT20	4.0	4.0	1.75	2.00
F	TMVW-t	MT20	4.0	4.0		
G	TMVW-t	MT20	2.0	4.0		
H	TMVW-t	MT20	5.0	6.0	2.00	2.00
I	TS-t	MT20	3.0	6.0		
J	TMVW-t	MT20	2.0	4.0		
K	TTWV-m	MT20	6.0	7.0	Edge	1.50
L	TMVW+p	MT20	4.0	6.0	2.00	2.00
N	BMV1+p	MT20	2.0	4.0		
O	BMVW-t	MT20	4.0	4.0		
P	BMVWVW-t	MT20	5.0	6.0		
Q	BBW-h	MT20	5.0	6.0	2.00	3.25
R	BBWVWVW-m	MT20	6.0	7.0	3.00	3.00
S	BMVWVW-t	MT20	5.0	6.0		
T	BBWVW-h	MT20	6.0	7.0	Edge	
U	BBWVW-t	MT20	4.0	6.0	1.75	4.25
V	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
V	1377	0	5-8	1-8
N	1372	0	5-8	1-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
V	968	669 / 0	0 / 0	0 / 0	298 / 0	0 / 0
N	964	665 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, N

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.32FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF F-S, H-Q, H-P.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO	CS1 (LC)		FR-TO			
A-B	0 / 40	-70.5	-70.5	0.10 (1)	10.00	U-C	-960 / 0	0.25 (1)
B-C	-783 / 0	-70.5	-70.5	0.10 (1)	8.25	C-T	0 / 680	0.15 (1)
C-D	-1106 / 0	-70.6	-70.5	0.05 (1)	5.88	T-D	-245 / 0	0.08 (1)
D-E	-1180 / 0	-70.5	-70.5	0.06 (1)	5.83	D-S	0 / 86	0.02 (4)
E-F	-713 / 0	-70.6	-70.5	0.20 (1)	6.25	S-E	0 / 771	0.17 (1)
F-G	-1367 / 0	-70.5	-70.5	0.22 (1)	5.33	S-F	-819 / 0	0.34 (1)
G-H	-1367 / 0	-70.5	-70.6	0.21 (1)	5.32	F-R	0 / 419	0.08 (1)
H-I	-1112 / 0	-70.5	-70.5	0.35 (1)	5.55	R-G	-36 / 8	0.03 (1)
I-J	-1112 / 0	-70.6	-70.5	0.35 (1)	5.55	R-H	0 / 963	0.22 (1)
J-K	-1111 / 0	-70.5	-70.5	0.38 (1)	5.55	Q-H	-1143 / 0	0.46 (1)
K-L	-1022 / 0	-70.5	-70.5	0.26 (1)	5.80	H-P	-177 / 0	0.11 (1)
L-M	0 / 40	-70.6	-70.5	0.10 (1)	10.00	P-J	-440 / 0	0.53 (1)
V-B	-1364 / 0	0.0	0.0	0.17 (1)	6.86	P-K	0 / 850	0.19 (1)
N-L	-1344 / 0	0.0	0.0	0.17 (1)	6.89	O-K	-180 / 14	0.22 (1)
V-U	0 / 0	-17.5	-17.5	0.01 (4)	10.00	B-U	0 / 719	0.16 (1)
U-T	0 / 686	-17.5	-17.5	0.10 (1)	10.00	O-L	0 / 669	0.16 (1)
T-S	0 / 669	-17.5	-17.5	0.33 (4)	10.00			
S-R	0 / 1136	-17.5	-17.5	0.36 (4)	10.00			
R-Q	0 / 1698	-17.5	-17.5	0.28 (1)	10.00			
Q-P	0 / 1215	-17.5	-17.5	0.28 (1)	10.00			
P-O	0 / 607	-17.5	-17.5	0.18 (4)	10.00			
O-N	0 / 0	-17.5	-17.5	0.09 (4)	10.00			

TOTAL WEIGHT = 163 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 21.0 PSF
DL	= 3.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 23.0 P.S.F. G.S.L. PLUS
 8.4 P.S.F. RAIN LOAD EQUALS
 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
 CALCULATED VERT. DEFL.(LL) = L/998 (0.07")
 ALLOWABLE DEFL.(TL) = L/360 (0.97")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CS1: TC=0.36 (J-K:1), BC=0.36 (R-S:4), WB=0.53 (J-P:1), SS=0.19 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1887 822 2284 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.79 (B) (INPUT = 0.80)
 JSI METAL=0.38 (E) (INPUT = 1.00)



A-15073662

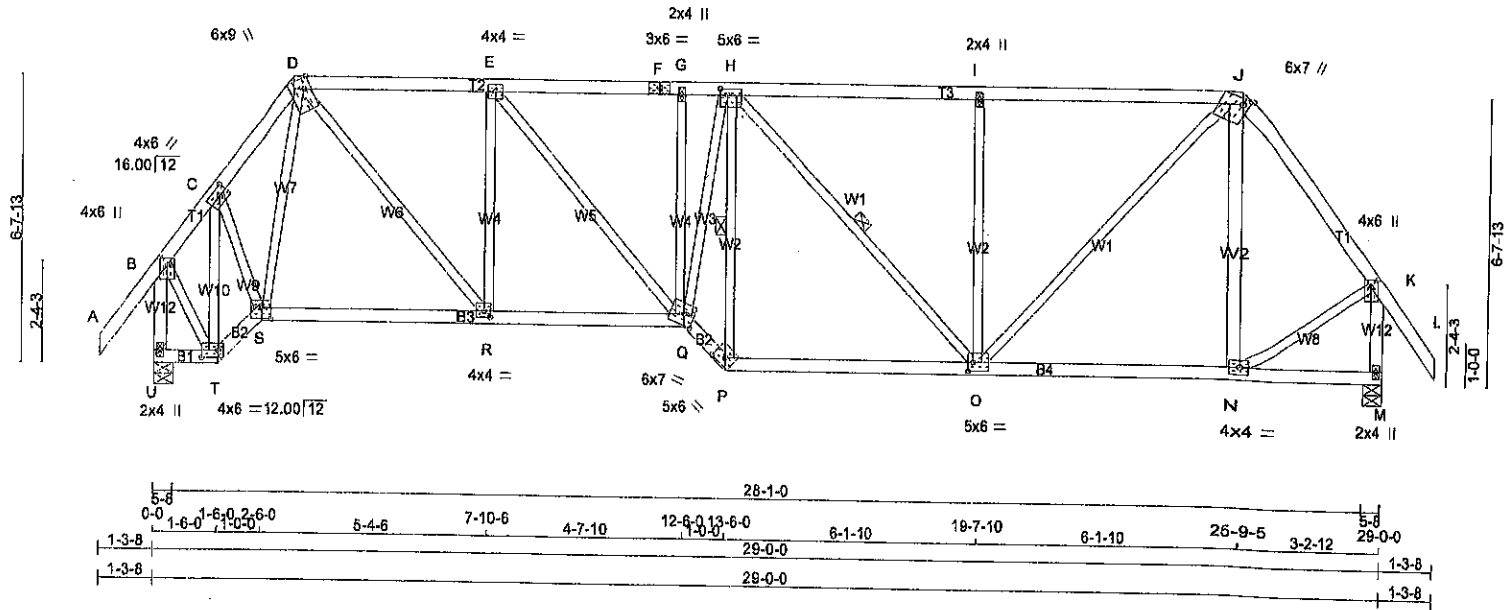

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - J	2x4	DRY	No.2	SPF
J - L	2x4	DRY	No.2	SPF
U - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
U - T	2x4	DRY	No.2	SPF
T - S	2x4	DRY	No.2	SPF
S - Q	2x4	DRY	No.2	SPF
Q - P	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVVW+p	MT20	4.0	6.0	2.00	2.00
C	TMWW-t	MT20	4.0	6.0	2.00	2.50
D	TTWW+m	MT20	6.0	9.0	Edge	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMW+w	MT20	2.0	4.0		
H	TMWWW-t	MT20	6.0	6.0	1.75	2.00
I	TMW+w	MT20	2.0	4.0		
J	TTWW+m	MT20	6.0	7.0	Edge	1.50
K	TMVVW+p	MT20	4.0	6.0	2.00	2.00
M	BMV1+p	MT20	2.0	4.0		
N	BMWW-t	MT20	4.0	4.0		
O	BMWWW-t	MT20	6.0	6.0	2.50	1.50
P	BBW-h	MT20	5.0	6.0	2.00	3.25
Q	BBWWW-m	MT20	6.0	7.0	3.00	3.00
R	BMWW-t	MT20	4.0	4.0	1.75	1.75
S	BBWW-t	MT20	6.0	6.0	3.00	3.00
T	BBWW-t	MT20	4.0	6.0	2.00	4.50
U	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
U	1377	0	1377	0	6-8	1-8
M	1372	0	1372	0	6-8	1-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	PERM. LIVE			
U	988	866 / 0	0 / 0	0 / 0	0 / 0	299 / 0	0 / 0
M	964	666 / 0	0 / 0	0 / 0	0 / 0	288 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.80FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF H-P, H-O.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 MAX CSI (LC)	MAX UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO					FR-TO		
A-B	0 / 40	-70.5	-70.5 0.10 (1)	10.00	T-C	-864 / 0	0.25 (1)
B-C	-782 / 0	-70.5	-70.5 0.10 (1)	6.25	C-S	0 / 853	0.15 (1)
C-D	-1105 / 0	-70.5	-70.5 0.06 (1)	5.97	S-D	-143 / 0	0.07 (1)
D-E	-1395 / 0	-70.5	-70.5 0.27 (1)	6.21	D-R	0 / 1093	0.25 (1)
E-F	-1701 / 0	-70.5	-70.5 0.29 (1)	4.80	R-E	-729 / 0	0.35 (1)
F-G	-1701 / 0	-70.5	-70.5 0.29 (1)	4.80	E-Q	0 / 486	0.10 (1)
G-H	-1700 / 0	-70.5	-70.5 0.25 (1)	4.82	Q-G	-52 / 5	0.03 (1)
H-I	-1320 / 0	-70.5	-70.5 0.44 (1)	5.07	Q-H	0 / 1225	0.26 (1)
I-J	-1320 / 0	-70.5	-70.5 0.45 (1)	5.08	P-H	-1391 / 0	0.40 (1)
J-K	-890 / 0	-70.5	-70.5 0.15 (1)	6.10	H-O	-223 / 0	0.12 (1)
K-L	0 / 40	-70.5	-70.5 0.10 (1)	10.00	O-I	-482 / 0	0.35 (1)
U-B	-1384 / 0	0.0	0.0 0.17 (1)	6.95	O-J	0 / 1054	0.24 (1)
M-K	-1366 / 0	0.0	0.0 0.17 (1)	6.97	N-J	-255 / 0	0.19 (1)
					B-T	0 / 721	0.16 (1)
					N-K	0 / 685	0.15 (1)
U-T	0 / 0	-17.5	-17.5 0.01 (4)	10.00			
T-S	0 / 588	-17.5	-17.5 0.10 (1)	10.00			
S-R	0 / 876	-17.5	-17.5 0.18 (4)	10.00			
R-Q	0 / 1395	-17.5	-17.5 0.29 (1)	10.00			
Q-P	0 / 2052	-17.5	-17.5 0.33 (1)	10.00			
P-O	0 / 1474	-17.5	-17.5 0.32 (1)	10.00			
O-N	0 / 588	-17.5	-17.5 0.21 (4)	10.00			
N-M	0 / 0	-17.5	-17.5 0.09 (4)	10.00			

TOTAL WEIGHT = 149 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 21.0 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/899 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/899 (0.16")

CSI: TC=0.45 (I-J:1), BC=0.33 (P-Q:1), WB=0.40 (H-P:1), SSI=0.20 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 822 2284 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (H) (INPUT = 0.90)
JSI METAL= 0.31 (H) (INPUT = 1.00)



A-15073661



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
253439	H01T	1	1	TRUSS DESC.	

Alpe Roof Truss, Maple

Version 7.820 S Apr 15 2016 MITek Industries, Inc. Wed Jul 15 11:48:11 2015 Page 2
ID:9?W oc?jcYybVbeU0Ab4z?zOVES-vXu29fLsLQNXiSnluoxr9xMaVnXV9wcGfyhd9RyxrLz

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 114.2 lbs FACTORED DOWN AT 2-2-11, AND 114.5 lbs FACTORED DOWN AT 28-9-5 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

NOTES- (1)
1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

CSI: TC=0.29 (E-G:1), BC=0.96 (S-T:1), WB=0.95 (I-P:1), SSI=0.28 (S-T:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00
COMPANION LIVE LOAD FACTOR = 0.50
AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 822 2284 1658
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (N) (INPUT = 0.80)
JSI METAL= 0.68 (S) (INPUT = 1.00)



A-15073660 (2)

253438

H11SG

QUANTITY

PLY


JOB DESC.

DRWG NO.

Alpa Roof Truss, Maple

TRUSS DESC.

Version 7.620 S Apr 16 2015 MiTek Industries, Inc. Wed Jul 15 11:37:56 2015 Page 1
 ID:9?W_oc?jYybVbeU0Ab4z?zOVES-x0fAt1uTQ9mLpnhvpQrOC2rFhtU8qNVb07T2X8yxrUg
 Scale = 1:73.2

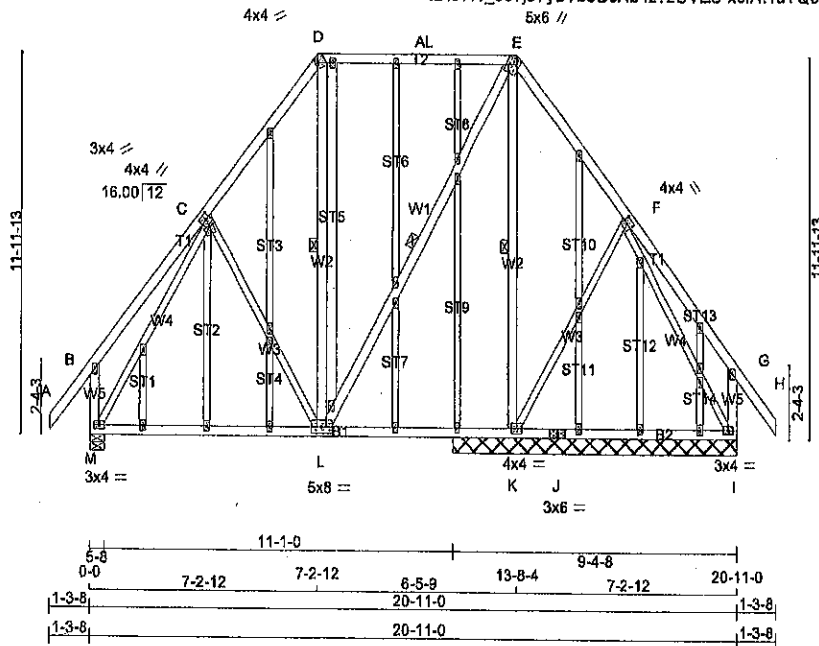

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
M - B	2x4	DRY	No.2
I - G	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2

ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				
C - L	2x3	DRY	No.2	SPF
K - F	2x3	DRY	No.2	SPF
M - C	2x3	DRY	No.2	SPF
F - I	2x3	DRY	No.2	SPF

ALL GABLE WEBS	2x3	DRY	No.2	SPF
EXCEPT				
STB	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMWW+1	MT20	4.0	4.0	2.00	1.75
C	NP+H	MT20	3.0	4.0	1.50	0.25
D	TTW+m	MT20	4.0	4.0	1.75	1.00
E	TTWW+m	MT20	5.0	8.0	1.75	1.00
F	TMWW+1	MT20	4.0	4.0	2.00	1.75
G	TMV+p	MT20	2.0	4.0		
I	BMVW+1	MT20	3.0	4.0		
J	BS-t	MT20	3.0	6.0		
K	BMWW+1	MT20	4.0	4.0		
L	BMWWW+1	MT20	5.0	8.0		
M	BMVW+1	MT20	3.0	4.0		
N, O, P, Q, R, S, T, U, V, W, X, Y, Z, AA, AB, AC, AD, AE, AF, AG, AH, AI, AJ, AK, AL						
N	NP+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
K	787	0	787	0	0	9-4-8 (5-11-0)	1-8
M	762	0	762	0	0	5-8	1-8
I	527	0	527	0	0	9-4-8 (5-11-0)	1-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
K	567	353 / 0	0 / 0	0 / 0	0 / 0	214 / 0	0 / 0	0 / 0
M	535	374 / 0	0 / 0	0 / 0	0 / 0	182 / 0	0 / 0	0 / 0
I	368	289 / 0	0 / 0	0 / 0	0 / 0	99 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, M, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF D-L, E-L, E-K.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC1 MAX)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC1 MAX)
FR-TO				FR-TO			
A-B	0 / 40	-70.5	-70.5 0.10 (1)	10.00	C-L	-109 / 3	0.14 (1)
B-C	0 / 26	-70.5	-70.5 0.15 (1)	10.00	L-D	-67 / 37	0.04 (1)
C-D	-391 / 0	-70.5	-70.5 0.16 (1)	8.26	L-E	0 / 318	0.05 (1)
D-E	-218 / 0	-78.0	-78.0 0.58 (1)	6.25	K-E	-531 / 0	0.42 (1)
AL-E	-218 / 0	-78.0	-78.0 0.58 (1)	6.25	K-F	-154 / 0	0.19 (1)
E-F	-148 / 0	-70.5	-70.5 0.16 (1)	6.25	M-C	-583 / 0	0.67 (1)
F-G	0 / 28	-70.5	-70.5 0.16 (1)	10.00	F-I	-320 / 0	0.37 (1)
G-H	0 / 40	-70.5	-70.5 0.10 (1)	10.00			
M-B	-193 / 0	0.0	0.0 0.02 (1)	7.81			
I-G	-182 / 0	0.0	0.0 0.02 (1)	7.81			
M-L	0 / 273	-17.5	-17.5 0.21 (4)	10.00			
L-K	0 / 67	-17.5	-17.5 0.20 (4)	10.00			
K-J	0 / 150	-17.5	-17.5 0.21 (4)	10.00			
J-I	0 / 150	-17.5	-17.5 0.21 (4)	10.00			

TOTAL WEIGHT = 183 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	21.0	PSF
DL	=	3.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.0	PSF
TOTAL LOAD	=	31.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -8.00/12 AND RESPECTIVE WALL HEIGHTS OF 0'-0" AND 0'-0" AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 088-09
 - TPIC 2011

(65 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.45")
 CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
 ALLOWABLE DEFL.(TL)= L/360 (0.45")
 CALCULATED VERT. DEFL.(TL)= L/999 (0.08")

CSI: TC=0.58 (D-E:1), BC=0.21 (L-M:4), WB=0.87 (C-M:1), SS=0.20 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (I) (INPUT = 0.90)

JSI METAL= 0.23 (C) (INPUT = 1.00)



A-15073659

253438

H11S

QUANTITY

3

PLY

1

JOB DESC.

TRUSS DESC.


DRWG NO.

Alpa Roof Truss, Maple

Version 7.820 S Apr 15 2016 M/Tek Industries, Inc. Wed Jul 15 11:37:54 2015 Page 1

ID:97W_oc7cYybVbeU0Ab4z7zOVES-Tq6oghurfseUBd6IFM9fqJ4348s57NSnTjV_lyxrUh

Scale = 1:70.9

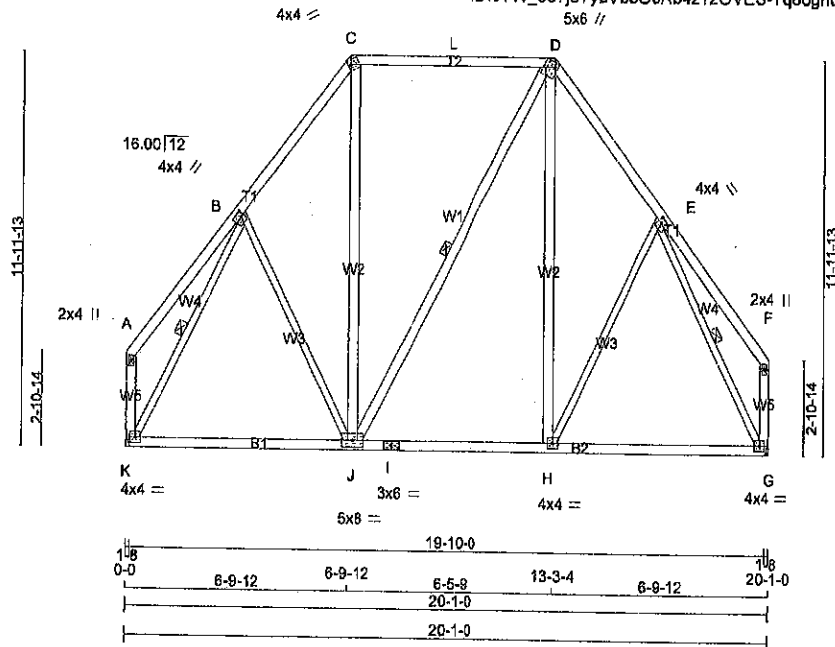

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
K - A	2x4	DRY	No.2
G - F	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2

ALL WEBS EXCEPT	SIZE	LUMBER	DESCR.
B - J	2x3	DRY	No.2
H - E	2x3	DRY	No.2
K - B	2x3	DRY	No.2
E - G	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	2.0	4.0		
B	TMWW-I	MT20	4.0	4.0	1.75	1.25
C	TTW-m	MT20	4.0	4.0	1.75	1.00
D	TTWW+m	MT20	5.0	6.0	1.75	1.00
E	TMWW-t	MT20	4.0	4.0	1.75	1.25
F	TMV+p	MT20	2.0	4.0		
G	BMVW1-I	MT20	4.0	4.0		
H	BMWW-I	MT20	4.0	4.0		
I	BS-t	MT20	3.0	6.0		
J	BMWWW-I	MT20	5.0	8.0		
K	BMVW1-I	MT20	4.0	4.0		

NOTES- (1)

1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
K	907	0	0	0
G	907	0	0	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX MIN COMPONENT REACTIONS	WIND	DEAD	SOIL
K	642	421/0	0/0	220/0	0/0
G	642	421/0	0/0	220/0	0/0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF D-J, B-K, E-G.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX UNBRACED LENGTH	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX
FR-TO		FROM TO			FR-TO		
A-B	0/22	-70.5 -70.5	0.13 (1)	10.00	B-J	-15/34	0.02 (1)
B-C	-627/0	-70.5 -70.5	0.11 (1)	8.25	J-C	0/139	0.03 (4)
C-L	-363/0	-78.0 -78.0	0.58 (1)	8.25	J-D	0/0	0.00 (1)
L-D	-363/0	-78.0 -78.0	0.56 (1)	6.25	H-D	0/139	0.03 (4)
D-E	-827/0	-70.5 -70.5	0.11 (1)	6.25	H-E	-15/34	0.02 (1)
E-F	0/22	-70.5 -70.5	0.13 (1)	10.00	K-B	-851/0	0.34 (1)
K-A	-89/0	0.0	0.01 (1)	7.81	E-G	-851/0	0.34 (1)
G-F	-89/0	0.0	0.01 (1)	7.81			
K-J	0/368	-17.5 -17.5	0.21 (4)	10.00			
J-I	0/363	-17.5 -17.5	0.21 (4)	10.00			
I-H	0/363	-17.5 -17.5	0.21 (4)	10.00			
H-G	0/368	-17.5 -17.5	0.21 (4)	10.00			

TOTAL WEIGHT = 3 X 128 = 384 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 21.0 PSF
DL	= 3.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 31.0 PSF

SPACING = 24.0 IN. C/G

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 23.0 P.S.F. G.S.I. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.67")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.67")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.58 (C-D:1), BC=0.21 (H-J:4), WB=0.34 (B-K:1), SSI=0.20 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1667 622 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (B) (INPUT = 0.90)
JSI METAL= 0.32 (B) (INPUT = 1.00)



A-15073658

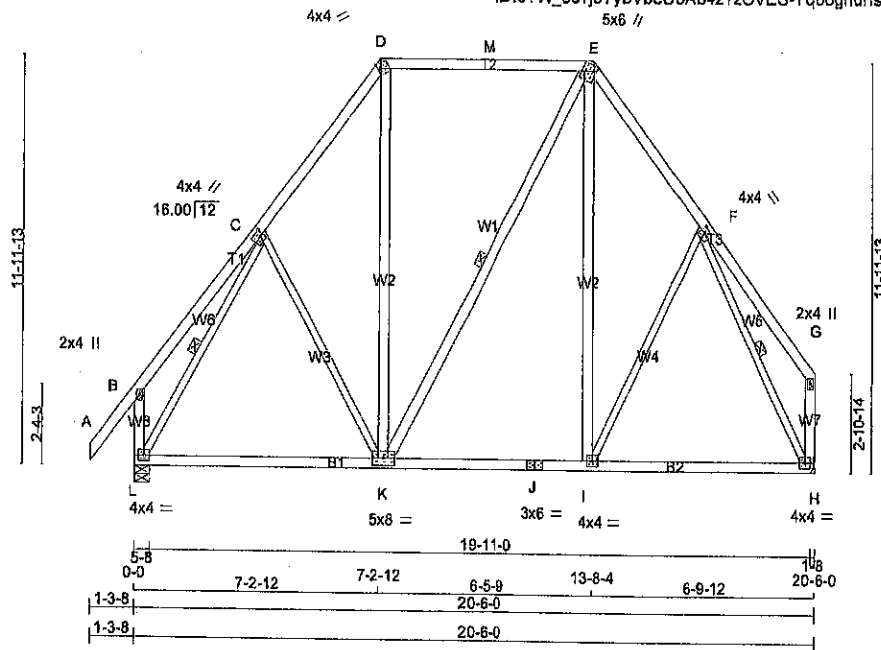

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS			
EXCEPT			
C - K	2x3	DRY	No.2
I - F	2x3	DRY	No.2
L - C	2x3	DRY	No.2
F - H	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
D	TTW-m	MT20	4.0	4.0	1.75	1.00
E	TTWV-m	MT20	5.0	6.0	1.75	1.00
F	TMVW-t	MT20	4.0	4.0	1.75	1.25
G	TMV+p	MT20	2.0	4.0		
H	BMVW-t	MT20	4.0	4.0		
I	BMVW-t	MT20	4.0	4.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-t	MT20	5.0	8.0		
L	BMVW-t	MT20	4.0	4.0		

NOTES- (1)
1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	
	VERT	HORZ	DOWN	HORZ		IN-SX	IN-SX
L	1024	0	1024	0	5-8	1-8	
H	926	0	926	0	0		HANGER BY OTHERS

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM.LIVE	WIND			
L	722	489 / 0	0 / 0	0 / 0	0 / 0	232 / 0	0 / 0
H	855	430 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF E-K, C-L, F-H.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 40	-70.5	-70.5	0.10 (1)	10.00	C-K	-59 / 21
B-C	0 / 24	-70.5	-70.5	0.15 (1)	10.00	K-D	0 / 163
C-D	-666 / 0	-70.5	-70.5	0.12 (1)	6.25	K-E	0 / 23
D-M	-385 / 0	-78.0	-78.0	0.56 (1)	6.25	I-E	0 / 133
M-E	-385 / 0	-78.0	-78.0	0.56 (1)	6.25	I-F	-11 / 36
E-F	-645 / 0	-70.5	-70.5	0.11 (1)	6.25	L-C	-879 / 0
F-G	0 / 22	-70.5	-70.5	0.13 (1)	10.00	F-H	-872 / 0
L-B	-194 / 0	0.0	0.0	0.02 (1)	7.81		
H-G	-90 / 0	0.0	0.0	0.01 (1)	7.81		
L-K	0 / 412	-17.5	-17.5	0.23 (4)	10.00		
K-J	0 / 373	-17.5	-17.5	0.23 (4)	10.00		
J-I	0 / 373	-17.5	-17.5	0.23 (4)	10.00		
I-H	0 / 377	-17.5	-17.5	0.20 (4)	10.00		

TOTAL WEIGHT = 131 lb
[M][F]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	21.0	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	31.0	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND 6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(65 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.68")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.02")
ALLOWABLE DEFL.(TL) = $L/360$ (0.68")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.09")

CSI: TC=0.56 (D-E:1), BC=0.23 (I-K:4), WB=0.35 (F-H:1), SSI=0.20 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR	SECTION (PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667 822 2284 1666

PLATE PLACEMENT TOL. = 0.260 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (C) (INPUT = 0.90)
JSI METAL= 0.33 (C) (INPUT = 1.00)



A-11073657


253438

H10G

QUANTITY
1PLY
1JOB DESC.
TRUSS DESC.

DRWG NO.

Alpa Roof Truss, Maple

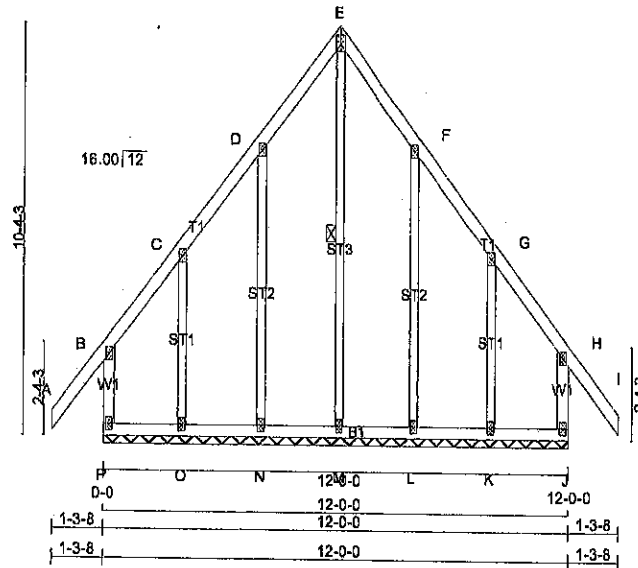Version 7.620 S Apr 15 2015 MiTek Industries, Inc. Wed Jul 15 11:37:53 2015 Page 1
ID:9?W_cc?jcyYbVbeU0Ab4z?zOVES-?eYQSLtCuYWdZTXVh?rw6dm0RgrhMb_Jyp_xSFyxrU
3x5 II
Scale = 1:58.6**LUMBER****N. L. G. A. RULES**

CHORDS	SIZE	LUMBER	DESCR.
P - B	2x4	DRY No.2	SPF
A - E	2x4	DRY No.2	SPF
E - I	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
P - J	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

ALL GABLE WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C, D, F, G						
C	TMW+w	MT20	2.0	4.0		
E	TTW+p	MT20	3.0	5.0	2.00	Edge
H	TMV+p	MT20	2.0	4.0		
J	BMV1+p	MT20	2.0	4.0		
K, L, M, N, O						
K	BMW1+w	MT20	2.0	4.0		
P	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**BEARINGS**

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF E-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	MAX UNBRACED LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
P-B	-178 / 0	0.0	0.0	0.03 (1)	7.81	M-E	-178 / 0	0.12 (1)			
A-B	0 / 40	-70.5	-70.5	0.10 (1)	10.00	N-D	-151 / 0	0.16 (1)			
B-C	-4 / 0	-70.5	-70.5	0.07 (1)	10.00	O-C	-107 / 0	0.04 (1)			
C-D	0 / 21	-70.5	-70.5	0.04 (1)	10.00	L-F	-151 / 0	0.16 (1)			
D-E	0 / 18	-70.5	-70.5	0.04 (1)	10.00	K-G	-107 / 0	0.04 (1)			
E-F	0 / 18	-70.5	-70.5	0.04 (1)	10.00						
F-G	0 / 21	-70.5	-70.5	0.04 (1)	10.00						
G-H	-4 / 0	-70.5	-70.5	0.07 (1)	10.00						
H-I	0 / 40	-70.5	-70.5	0.10 (1)	10.00						
J-H	-178 / 0	0.0	0.0	0.03 (1)	7.81						
P-O	-7 / 0	-17.5	-17.5	0.02 (4)	10.00						
O-N	-9 / 0	-17.5	-17.5	0.02 (4)	10.00						
N-M	-12 / 0	-17.5	-17.5	0.01 (4)	6.25						
M-L	-12 / 0	-17.5	-17.5	0.01 (4)	6.25						
L-K	-9 / 0	-17.5	-17.5	0.02 (4)	10.00						
K-J	-7 / 0	-17.5	-17.5	0.02 (4)	10.00						

TOTAL WEIGHT = 73 lb

[M]

DESIGN CRITERIA**SPECIFIED LOADS:**

TOP CH.	LL	=	21.0	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	31.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011**DESIGN ASSUMPTIONS**

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOADCS1: TC=0.10 (A-B:1), BC=0.02 (J-K:4), WB=0.16
(F-L:1), SS1=0.05 (A-B:1)DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (E) (INPUT = 0.90)

JSI METAL= 0.05 (H) (INPUT = 1.00)



A-H073656

253438

H01-Cond2

QUANTITY
2PLY
1JOB DESC.
TRUSS DESC.


DRWG NO.

Alpa Roof Truss, Maple

Version 7.620 S Apr 15 2015 MITek Industries, Inc. Wed Jul 15 11:37:52 2015 Page 1

ID:97W_oc7jcYybVbeU0Ab4z7zOVES-XR_1F7sa7EOmJyKBIKhaPDncGN4d7S9K9EOwpyxrUJ

Scale = 1:53.5

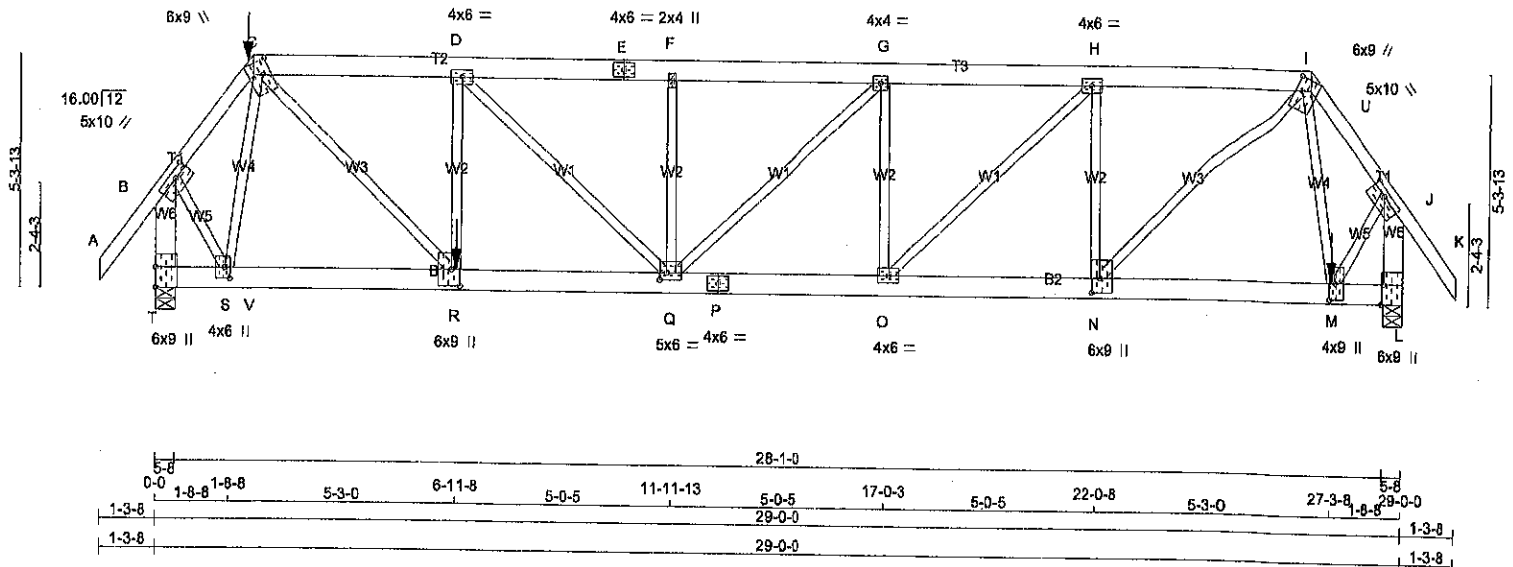**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x6	DRY No.2	SPF
E - I	2x6	DRY No.2	SPF
I - K	2x4	DRY No.2	SPF
T - B	2x6	DRY No.2	SPF
L - J	2x6	DRY No.2	SPF
T - P	2x6	DRY No.2	SPF
P - L	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWW-I	MT20	5.0	10.0	1.75	4.25
C TTWW+m	MT20	6.0	9.0	4.00	2.25
D TMWW-I	MT20	4.0	8.0		
E TS-I	MT20	4.0	6.0		
F TMWW-w	MT20	2.0	4.0		
G TMWW-I	MT20	4.0	4.0		
H TMWW-I	MT20	4.0	6.0		
I TTWW+m	MT20	6.0	9.0	3.75	1.75
J TMWW-I	MT20	5.0	10.0	1.50	4.25
L BMV1-I	MT20	6.0	9.0	Edge	0.50
M BMWW-H	MT20	4.0	9.0	4.50	1.75
N BMWW-H	MT20	6.0	9.0	4.00	2.25
O BMWW-I	MT20	4.0	6.0		
P BS-I	MT20	4.0	6.0		
Q BMWW-W	MT20	5.0	6.0	2.00	2.00
R BMWW-H	MT20	6.0	9.0	4.50	2.25
S BMWW-H	MT20	4.0	6.0	3.00	1.50
T BMV1-p	MT20	8.0	9.0	5.50	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**BEARINGS**

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 2911	DOWN 2811	0	5-8
L	HORZ 3487	HORZ 3487	0	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX	MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE	PERM LIVE WIND DEAD SOIL
T	2150	895 / 0	0 / 0	0 / 0 1255 / 0 0 / 0
L	2631	793 / 0	0 / 0	0 / 0 1836 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T, L

BRACINGTOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRAC LENGTH	WEBS MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO	
A-B	0 / 40	-70.5 -70.5	0.13 (1)	10.00	S-C -1039 / 0	0.43 (1)
B-C	-1896 / 0	-70.5 -70.5	0.14 (1)	4.89	C-R 0 / 2879	0.82 (1)
C-D	-3263 / 0	-138.7 -138.7	0.36 (1)	4.27	R-D -713 / 53	0.29 (1)
D-E	-3427 / 0	-70.5 -70.5	0.26 (1)	4.32	D-Q -133 / 227	0.13 (4)
E-F	-3427 / 0	-70.5 -70.5	0.26 (1)	4.32	Q-F -332 / 0	0.13 (1)
F-G	-3427 / 0	-70.5 -70.5	0.21 (1)	4.37	Q-G 0 / 392	0.14 (4)
G-H	-3144 / 0	-70.5 -70.5	0.21 (1)	4.53	O-G -828 / 0	0.25 (1)
H-I	-2418 / 0	-70.5 -70.5	0.17 (1)	5.08	O-H 0 / 1010	0.29 (1)
I-U	-2161 / 0	-70.5 -70.5	0.26 (1)	4.30	N-H -1074 / 0	0.43 (1)
U-J	-2161 / 0	-168.1 -168.1	0.26 (1)	4.30	N-I 0 / 1665	0.47 (1)
J-K	0 / 40	-70.5 -70.5	0.13 (1)	10.00	I-M 0 / 750	0.29 (4)
T-B	-2988 / 0	0.0 0.0	0.30 (1)	5.98	B-S 0 / 1705	0.49 (1)
L-J	-3431 / 0	0.0 0.0	0.34 (1)	5.80	M-J 0 / 1928	0.57 (4)

T-S	0 / 0	-34.5 -34.5	0.16 (4)	10.00
S-V	0 / 1253	-34.5 -34.5	0.31 (4)	10.00
V-R	0 / 1253	-34.5 -34.5	0.31 (4)	10.00
R-Q	0 / 3263	-17.5 -17.5	0.55 (1)	10.00
Q-P	0 / 3144	-17.5 -17.5	0.52 (1)	10.00
P-O	0 / 3144	-17.5 -17.5	0.52 (1)	10.00
O-N	0 / 2418	-17.5 -17.5	0.40 (1)	10.00
N-M	0 / 1256	-17.5 -17.5	0.27 (4)	10.00
M-L	0 / 0	-41.7 -41.7	0.07 (4)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	2-2-11	-114	-114		FRONT	VERT	TOTAL
M	27-3-8	-1643	-1643		FRONT	VERT	DEAD
R	6-11-8	-1256	-1256		FRONT	VERT	DEAD

TOTAL WEIGHT = 2 X 169 = 338 lb

DESIGN CRITERIA*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE**SPECIFIED LOADS:**

TOP CH.	LL = 21.0	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 31.0	PSF

SPACING = 24.0 IN./CLOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUMGIRDER TYPE: CPPrimeHlp
LEFT SETBACK = 2-2-11
RIGHT SETBACK = 2-2-12
END SETBACK = 5-10-8
END WALL WIDTH = 0-0
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 6-11-8 OF SPAN
MEASURED FROM THE LEFT.GIRDER TYPE: CPPrimeHlp
SIDE SETBACK = 0-0
END SETBACK = 7-6-8
END WALL WIDTH = 0-0
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 1-7-0 OF SPAN
MEASURED FROM THE RIGHT.*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO
ALL LOAD CASES.THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 8, NBCC 2010THIS DESIGN COMPLIES WITH:
- PART 8 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOADALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")CSI: TC=0.38 (C-D:1), BC=0.55 (Q-R:1),
WB=0.82 (C-R:1), SSI=0.28 (C-D:1)DOL LUMBER=0.87 NAIL=0.87 L.S BEND=1.00
CIP=2.00 SP=2.00 TENS=1.00A-NOV-2015
CONTINUED ON PAGE 2

HANGERS NOTES


1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 114.2 lbs FACTORED DOWN AT 2-2-11 ON TOP CHORD, AND 1407.0 lbs FACTORED DOWN AT 6-11-8, AND 1839.8 lbs FACTORED DOWN AT 27-3-8 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

NOTES- (1)
1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

COMPANION LIVE LOAD FACTOR = 0.60
AUTOSOLVE HEELS OFF
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 822 2284 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (J) (INPUT = 0.90)
JSI METAL= 0.73 (P) (INPUT = 1.00)



A-15073655(2)

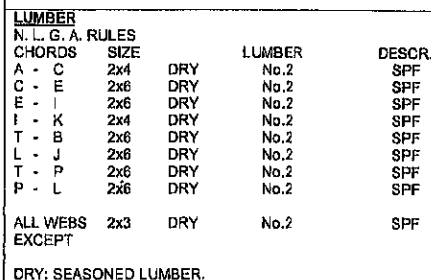

PLATES (table is in inches)					
J	C	T	D	E	F
TYPE	PLATES	W	LEN	Y	X
B	TMWV-I	MT20	5.0	10.0	1.75 4.25
C	TTWW+tm	MT20	6.0	9.0	4.00 2.25
D	TMWV-I	MT20	4.0	6.0	
E	TS-I	MT20	4.0	6.0	
F	TMWV+V	MT20	2.0	4.0	
G	TMWV-I	MT20	4.0	4.0	
H	TMWV-I	MT20	4.0	6.0	
I	TTWW+tm	MT20	6.0	9.0	3.75 1.75
J	TMWV-I	MT20	5.0	10.0	1.50 4.25
K	BMVY-I+	MT20	6.0	9.0	Edge 0.60
L	BMWVW-I	MT20	4.0	9.0	4.50 1.75
M	BMWVW-I	MT20	6.0	9.0	4.00 2.25
N	BMWVW-I	MT20	4.0	6.0	
O	BS-I	MT20	4.0	6.0	
P	BMWVWV-I	MT20	5.0	6.0	2.00 2.00
Q	BMWVW-I	MT20	6.0	9.0	4.50 2.25
R	BMWVW-I	MT20	4.0	6.0	3.00 1.50
S	BMVY-I+	MT20	6.0	9.0	5.60

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

FACTORED		MAXIMUM FACTORED		INPUT	REQRD
GT	GROSS REACTION	GROSS REACTION	BRG	BRG	
	VERT	HORZ	DOWN	UPLIFT	IN-SX
T	2572	0	2572	0	5-8
L	2572	0	2572	0	2-14
					2-14

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
T	1811	1235/0	0/0	0/0	0/0	576/0	0/0
L	1811	1235/0	0/0	0/0	0/0	576/0	0/0

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY
APPLIED

C H O R D S				W E B S				
MAX. FACTORED		FACTORED		MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX	MEMB.	FORCE	MAX
	(LBS)	(PLF)	CSI (LC)	UNBRAC	LENGTH		(LBS)	CSI (LC)
FR-TO		FROM	TO			FR-TO		
A-B	0 / 40	-70.5	-70.5	0.11 (†)	10.00	S-C	-918 / 0	0.36 (†)
B-C	-1651 / 0	-70.5	-70.5	0.11 (†)	6.05	C-R	0 / 2471	0.61 (†)
C-D	-2818 / 0	-138.7	-138.7	0.27 (†)	4.71	R-D	-1595 / 0	0.61 (†)
D-E	-3697 / 0	-138.7	-138.7	0.31 (†)	4.71	D-Q	0 / 1223	0.30 (†)
E-F	-3697 / 0	-138.7	-138.7	0.31 (†)	4.17	Q-F	-681 / 0	0.26 (†)
F-G	-3697 / 0	-138.7	-138.7	0.28 (†)	4.21	C-G	-12 / 0	0.01 (†)
G-H	-3705 / 0	-138.7	-138.7	0.31 (†)	4.17	O-G	-686 / 0	0.26 (†)
H-I	-2818 / 0	-138.7	-138.7	0.27 (†)	4.71	O-H	0 / 1237	0.31 (†)
I-J	-1652 / 0	-70.5	-70.5	0.11 (†)	5.05	N-H	-1598 / 0	0.61 (†)
J-K	0 / 40	-70.5	-70.5	0.11 (†)	10.00	N-I	0 / 2468	0.61 (†)
T-B	-2608 / 0	0.0	0.0	0.23 (†)	6.38	I-M	-816 / 0	0.36 (†)
L-J	-2609 / 0	0.0	0.0	0.23 (†)	6.38	B-S	0 / 1485	0.37 (†)
						M-J	0 / 1486	0.37 (†)
T-S	0 / 0	-34.5	-34.5	0.09 (4)	10.00			
S-U	0 / 1093	-34.5	-34.5	0.22 (†)	10.00			
U-R	0 / 1093	-34.5	-34.5	0.22 (†)	10.00			
R-Q	0 / 2818	-34.5	-34.5	0.43 (†)	10.00			
Q-P	0 / 3706	-34.5	-34.5	0.55 (†)	10.00			
P-O	0 / 3706	-34.5	-34.5	0.55 (†)	10.00			
O-N	0 / 2816	-34.5	-34.5	0.42 (†)	10.00			
N-V	0 / 1093	-34.5	-34.5	0.22 (†)	10.00			
V-M	0 / 1093	-34.5	-34.5	0.22 (†)	10.00			
M-L	0 / 0	-34.5	-34.5	0.09 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	2-2-11	-114	-114	—	FRONT	VERT	TOTAL
I	26-9-6	-115	-115	—	FRONT	VERT	TOTAL

SPECIFIED LOADS:

TOP CH.	LL	=	21.0	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	31.0	PSF

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 2-2-11
RIGHT SETBACK = 2-2-12
END SETBACK = 5-10-8
END WALL WIDTH = 0-0
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.13")
ALLOWABLE DEFL.(TL)= L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.31 (D-F:1), BC=0.55 (O-Q:1),
WB=0.61 (C-R:1), SSI=0.26 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
	GRIP(DRY)		SHEAR		SECTION
	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1867	822	2284

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (Q) (INPUT = 0.90)
JSI METAL= 0.78 (P) (INPUT = 1.00)

A: 15073654 CONTINUED ON PAGE 2



253438

H01-Cond1

2

1

TRUSS DESC.

DRWG NO.

Alpa Roof Truss, Maple

Version 7.620 S Apr 15 2015 MiTek Industries, Inc. Wed Jul 15 11:37:52 2015 Page 2

ID:97W_cc7cYybVbeU0Ab4z?zOVES-XR_1F?sa7EOmxJyKBIKhaPDoNGN1d2i9K9EOwpyxrUj

HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 114.8 lbs FACTORED DOWN AT 26-9-5, AND 114.2 lbs FACTORED DOWN AT 2-2-11 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

NOTES- (1)

- 1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.



A-H073654(2)

253436

H08

QUANTITY

2

PLY

1

JOB DESC.

TRUSS DESC.


DRWG NO.

Alpa Roof Truss, Maple

Version 7.620 S Apr 15 2015 MITek Industries, Inc. Wed Jul 15 09:13:33 2015 Page 1

ID:97W_cc7?cYybVbeU0Ab4z7zOVES-ZbGawB35KmSncdV8NFU77P539m9cylfdBUChWCyxtc0

Scale = 1:24.8

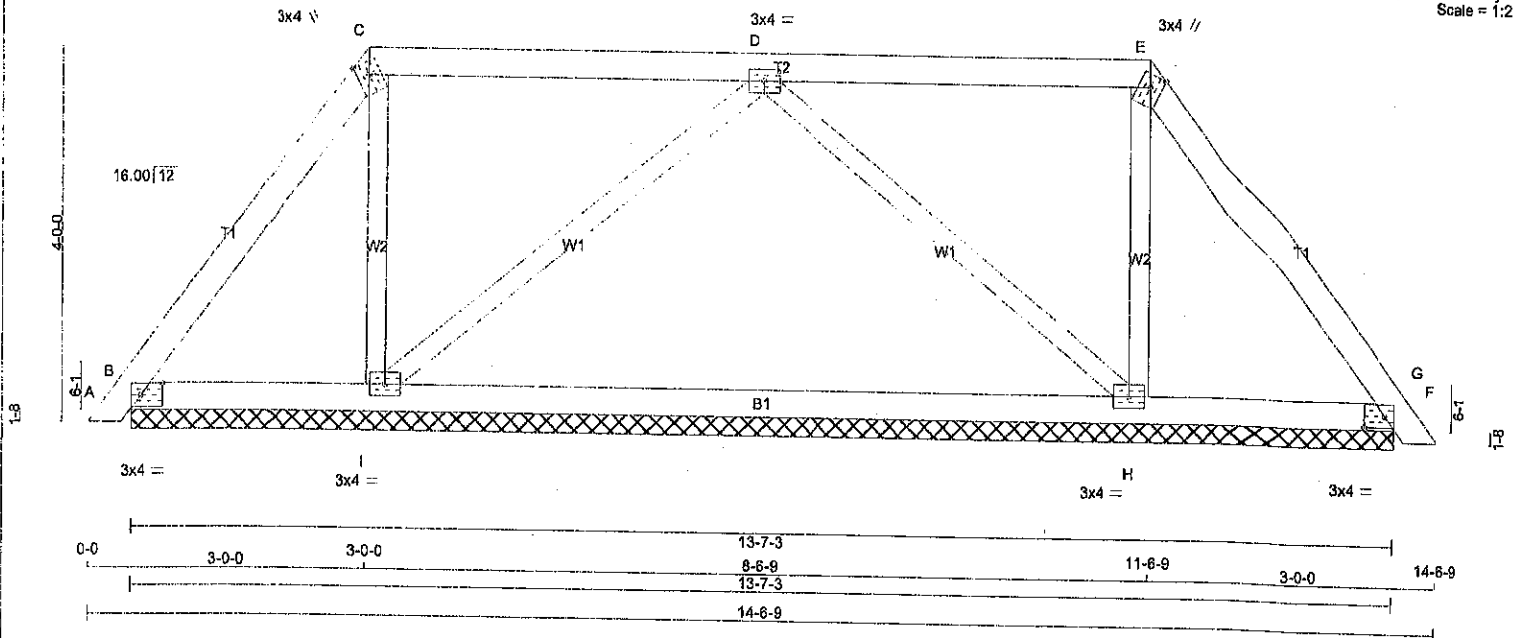**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	1.50	2.75
C	TTW+m	MT20	3.0	4.0	Edge	
D	TMWW-I	MT20	3.0	4.0		
E	TTW+m	MT20	3.0	4.0	Edge	
F	TMB1-I	MT20	3.0	4.0	1.50	2.75
H	BMWW1-I	MT20	3.0	4.0		
I	BMWW1-I	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES: (1)

1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
JT	127	0	127	0	13-7-3	1-8
B	127	0	127	0	13-7-3	1-8
F	496	0	496	0	13-7-3	1-8
H	496	0	496	0	13-7-3	1-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	85	81/0	0/0	0/0	0/0	4/0	0/0
F	85	81/0	0/0	0/0	0/0	4/0	0/0
I	353	219/0	0/0	0/0	0/0	134/0	0/0
H	353	219/0	0/0	0/0	0/0	134/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, I, H

BRACINGTOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.**LOADING**

TOTAL LOAD CASES: (4)

CHORDS			WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX CSI (LC)	MAX UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0/9	-70.5	-70.5	0.01 (1)	10.00	I-C	-180 / 0	0.04 (1)
B-C	-28/0	-70.5	-70.5	0.08 (1)	6.25	I-D	-287 / 0	0.15 (1)
C-D	-11/0	-70.5	-70.5	0.21 (1)	6.25	D-H	-287 / 0	0.15 (1)
D-E	-11/0	-70.5	-70.5	0.21 (1)	6.25	H-E	-180 / 0	0.04 (1)
E-F	-28/0	-70.5	-70.5	0.08 (1)	6.25			
F-G	0/9	-70.5	-70.5	0.01 (1)	10.00			
B-I	0/16	-17.5	-17.5	0.20 (4)	10.00			
I-H	0/229	-17.5	-17.5	0.21 (4)	10.00			
H-F	0/16	-17.5	-17.5	0.20 (4)	10.00			

TOTAL WEIGHT = 2 X 51 = 101 lb

DESIGN CRITERIA**SPECIFIED LOADS:**

TOP CH. LL = 21.0 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.21 (D-E:1), BC=0.21 (H:I:4), WB=0.15 (D:I:1), CSI=0.15 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.38 (I) (INPUT = 0.90)

JSI METAL= 0.08 (H) (INPUT = 1.00)



A-15073633

Alpa Roof Truss, Maple

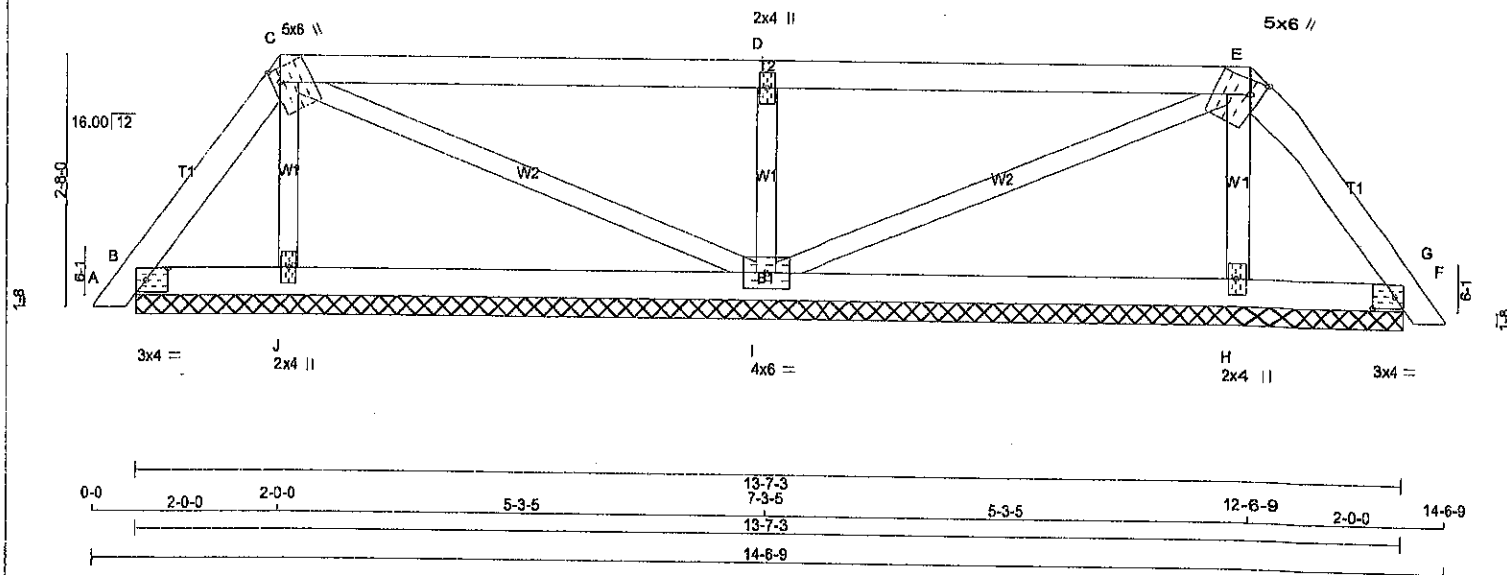

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMB1-I	MT20	3.0	4.0 1.50 2.75
C	TTWW+m	MT20	5.0	6.0 1.75 1.00
D	TMW+m	MT20	2.0	4.0
E	TTWW+m	MT20	5.0	6.0 1.75 1.00
F	TMB1-I	MT20	3.0	4.0 1.50 2.75
H	BMW1+w	MT20	2.0	4.0
I	BMWW1-I	MT20	4.0	6.0
J	BMW1+w	MT20	2.0	4.0

NOTES- (1)
1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
B	129	0	129	0	13-7-3	1-8
F	129	0	129	0	13-7-3	1-8
J	205	0	205	0	13-7-3	1-8
I	578	0	578	0	13-7-3	1-8
H	205	0	205	0	13-7-3	1-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX/MIN. COMPONENT REACTIONS			
	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	87	79 / 0	0 / 0	0 / 0	8 / 0	0 / 0
F	87	79 / 0	0 / 0	0 / 0	8 / 0	0 / 0
J	148	78 / 0	0 / 0	0 / 0	71 / 0	0 / 0
I	405	287 / 0	0 / 0	0 / 0	118 / 0	0 / 0
H	148	78 / 0	0 / 0	0 / 0	71 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F, J, I, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSI (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSI (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 9	-70.5 -70.5	0.01 (1)	J-C	-131 / 0	-70.5 -70.5	0.02 (1)
B-C	-86 / 0	-70.5 -70.5	0.03 (1)	C-I	-23 / 0	-70.5 -70.5	0.01 (1)
C-D	-9 / 0	-70.5 -70.5	0.33 (1)	I-D	-484 / 0	-70.5 -70.5	0.07 (1)
D-E	-9 / 0	-70.5 -70.5	0.33 (1)	I-E	-23 / 0	-70.5 -70.5	0.01 (1)
E-F	-68 / 0	-70.5 -70.5	0.03 (1)	H-E	-131 / 0	-70.5 -70.5	0.02 (1)
F-G	0 / 9	-70.5 -70.5	0.01 (1)				
B-J	0 / 37	-17.5 -17.5	0.07 (4)				
J-I	0 / 31	-17.5 -17.5	0.10 (4)				
I-H	0 / 31	-17.5 -17.5	0.10 (4)				
H-F	0 / 37	-17.5 -17.5	0.07 (4)				

TOTAL WEIGHT = 2 X 48 = 96 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 21.0 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 23.0 P.S.F. G.S.I., PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.33 (D-E:1), BC=0.10 (H-I:4), WB=0.07 (D-I:1), SSI=0.18 (C-D:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.60

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1067 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.25 (F) (INPUT = 0.90)
JSI METAL= 0.09 (D) (INPUT = 1.00)



A-15073582

253428

H06


6

1

TRUSS DESC.

DRWG NO.

Alpa Roof Truss, Maple

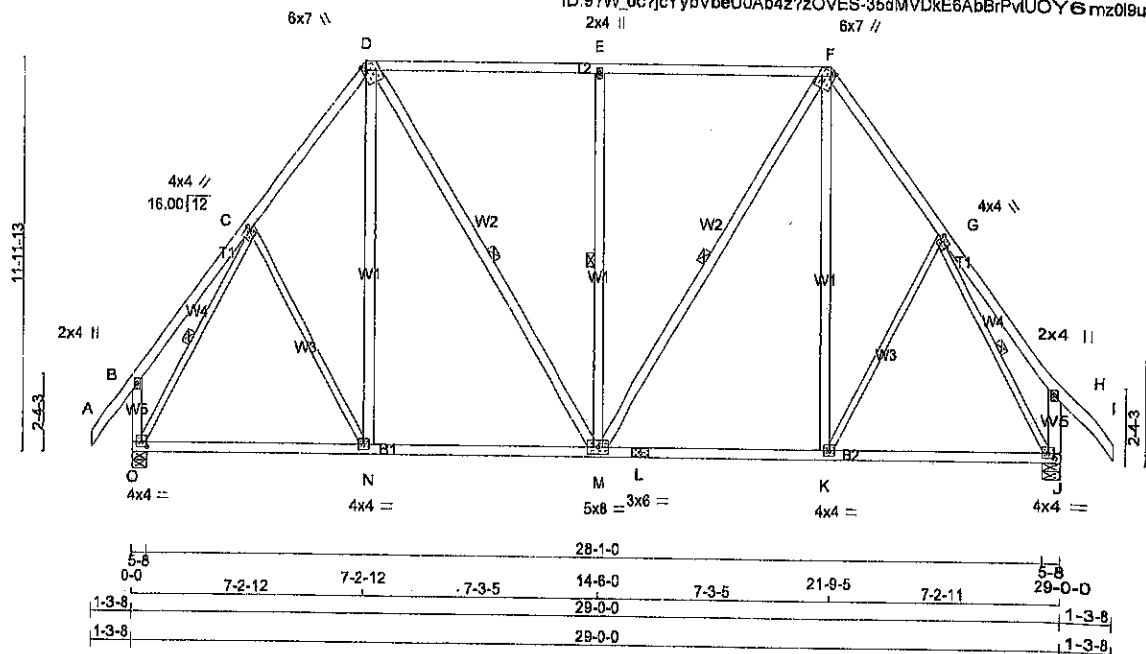Version 7.620 S Apr 15 2016 Mitek Industries, Inc. Tue Jul 14 15:28:32 2016 Page 1
ID:9?W_oc?jcyYbVbeU0Ab4z?zOVES-35dMVDKE6AbBrPwUOY6mz0l9upWhRmzAFRpbVyy7CT
Scale = 1:71.1

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DRY
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x4	DRY	No.2
EXCEPT			
C - N	2x3	DRY	No.2
K - G	2x3	DRY	No.2
O - C	2x3	DRY	No.2
G - J	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	2.0	4.0		
C	TMVW+1	MT20	4.0	4.0	1.50	1.00
D	TTWW+m	MT20	6.0	7.0	Edge	1.50
E	TMV+w	MT20	2.0	4.0		
F	TTWW+m	MT20	6.0	7.0	Edge	1.50
G	TMVW+1	MT20	4.0	4.0	1.50	1.00
H	TMV+p	MT20	2.0	4.0		
J	BMVW+1	MT20	4.0	4.0	1.75	2.00
K	BMVW+1	MT20	4.0	4.0		
L	BS-1	MT20	3.0	6.0		
M	BMVW+1	MT20	5.0	8.0		
N	BMVW+1	MT20	4.0	4.0		
O	BMVW+1	MT20	4.0	4.0	1.75	2.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
O	1428	0	1428	0
J	1428	0	1428	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1010	868 / 0	0 / 0	0 / 0	0 / 0	0 / 0	342 / 0	0 / 0	0 / 0
J	1010	868 / 0	0 / 0	0 / 0	0 / 0	0 / 0	342 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.67FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF D-M, E-M, F-M, C-O, G-J.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO				FR-TO			
A-B	0 / 40	-70.5	-70.5 0.10 (1)	C-N	0 / 51	-70.5	-70.5 0.10 (1)
B-C	0 / 23	-70.5	-70.5 0.14 (1)	D-M	0 / 130	-70.5	-70.5 0.14 (1)
C-D	-1088 / 0	-70.5	-70.5 0.13 (1)	E-M	0 / 477	-70.5	-70.5 0.13 (1)
D-E	-889 / 0	-78.0	-78.0 0.56 (1)	F-M	-886 / 0	-78.0	-78.0 0.56 (1)
E-F	-889 / 0	-78.0	-78.0 0.56 (1)	G-M	0 / 477	-78.0	-78.0 0.56 (1)
F-G	-1088 / 0	-70.5	-70.5 0.13 (1)	H-M	0 / 130	-70.5	-70.5 0.13 (1)
G-H	0 / 23	-70.5	-70.5 0.14 (1)	I-M	0 / 51	-70.5	-70.5 0.14 (1)
H-I	0 / 40	-70.5	-70.5 0.10 (1)	J-M	-1338 / 0	-70.5	-70.5 0.10 (1)
O-B	-195 / 0	0.0	0.0 0.02 (1)	K-G	-1338 / 0	0.0	0.0 0.02 (1)
J-H	-195 / 0	0.0	0.0 0.02 (1)				
O-N	0 / 627	-17.5	-17.5 0.28 (4)				
N-M	0 / 637	-17.5	-17.5 0.28 (4)				
M-L	0 / 637	-17.5	-17.5 0.28 (4)				
L-K	0 / 637	-17.5	-17.5 0.28 (4)				
K-J	0 / 627	-17.5	-17.5 0.28 (4)				

TOTAL WEIGHT = 6 X 181 = 1084 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 21.0 PSF
DL	= 3.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPC 2011

(65 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")CSI: TC=0.55 (D-E:1), BC=0.29 (M-N:4),
WB=0.54 (E-M:1), SS=0.28 (D-E:1)DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 822 2284 1866

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP= 0.85 (G) (INPUT = 0.80)
JSI METAL= 0.49 (G) (INPUT = 1.00)

A-14073581

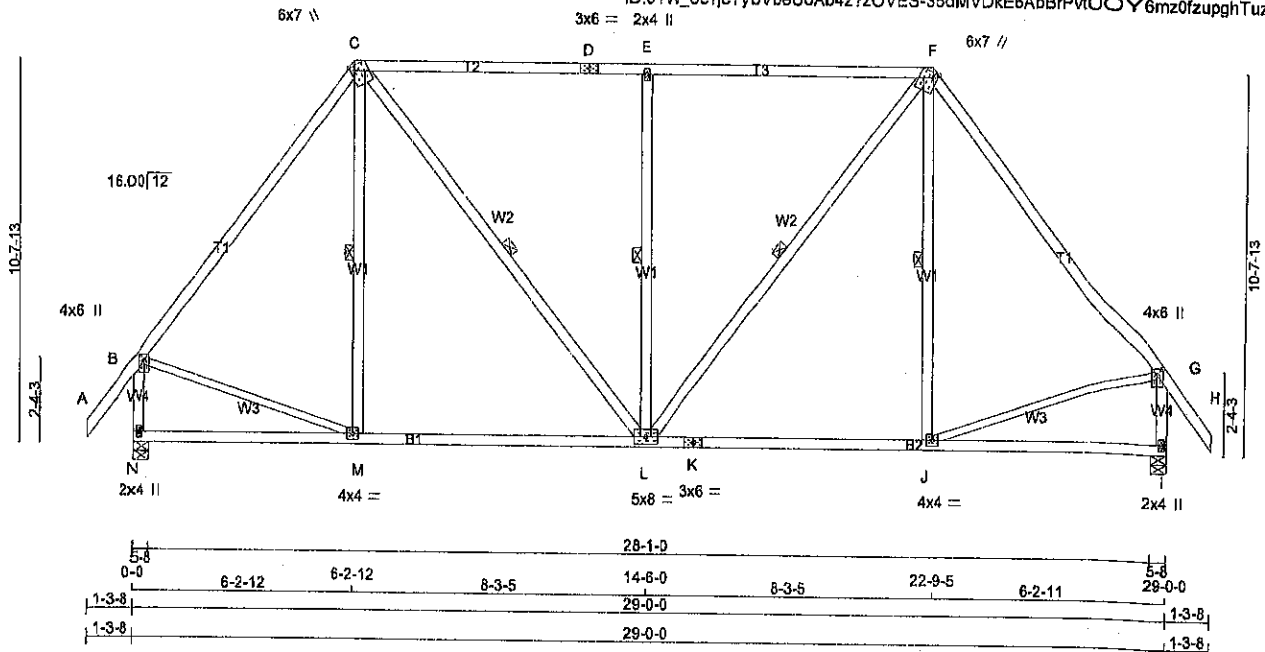

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	2100F 1.8E	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	2100F 1.8E	SPF	
N - B	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT		2x4	DRY	No.2	SPF
B - M	2x3	DRY	No.2	SPF	
J - G	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	2.00	2.00
C	TTWW+m	MT20	6.0	7.0	Edge	1.60
D	TS-I	MT20	3.0	6.0		
E	TMVW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	6.0	7.0	Edge	1.60
G	TMVW+p	MT20	4.0	6.0	2.00	2.00
I	BMV1+p	MT20	2.0	4.0		
J	BMVW-I	MT20	4.0	4.0		
K	BS-I	MT20	3.0	6.0		
L	BMVWW-I	MT20	5.0	8.0		
M	BMVW-I	MT20	4.0	4.0		
N	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
 1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
N	1375	0	1375	0	0	5-8	1-8		
I	1375	0	1375	0	0	5-8	1-8		

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	966	668 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
I	966	668 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.38 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF C-M, C-L, E-L, F-L, F-J.
 END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	LC1 MAX	CS1 (LC)	MEMB.	FORCE (LBS)	MAX	CS1 (LC)
FR-TO		FROM	TO			FR-TO			
A-B	0 / 40	-70.5	-70.5	0.07 (1)	10.00	M-C	-48 / 95	0.03 (1)	
B-C	-1029 / 0	-70.5	-70.5	0.38 (1)	6.25	C-L	0 / 560	0.09 (1)	
C-D	-958 / 0	-70.5	-70.5	0.95 (1)	4.39	L-E	-715 / 0	0.41 (1)	
D-E	-958 / 0	-70.5	-70.5	0.95 (1)	4.39	L-F	0 / 560	0.09 (1)	
E-F	-958 / 0	-70.5	-70.5	0.95 (1)	4.39	J-F	-48 / 95	0.03 (1)	
F-G	-1029 / 0	-70.5	-70.5	0.38 (1)	6.25	B-M	0 / 644	0.14 (1)	
G-H	0 / 40	-70.5	-70.5	0.07 (1)	10.00	J-G	0 / 644	0.14 (1)	
N-B	-1333 / 0	0.0	0.0	0.17 (1)	7.01				
I-G	-1333 / 0	0.0	0.0	0.17 (1)	7.01				
N-M	0 / 0	-17.5	-17.5	0.21 (4)	10.00				
M-L	0 / 615	-17.5	-17.5	0.28 (4)	10.00				
L-K	0 / 615	-17.5	-17.5	0.28 (4)	10.00				
K-J	0 / 615	-17.5	-17.5	0.28 (4)	10.00				
J-I	0 / 0	-17.5	-17.5	0.21 (4)	10.00				

TOTAL WEIGHT = 2 X 160 = 319 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 21.0 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS
 8.4 P.S.F. RAIN LOAD EQUALS
 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
 ALLOWABLE DEFL.(TL) = L/360 (0.97")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.95 (C-E:1), BC=0.28 (L-M:4), WB=0.41 (E-L:1), SS=0.28 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (M) (INPUT = 0.80)
 JSI METAL= 0.26 (B) (INPUT = 1.00)



A-1073580

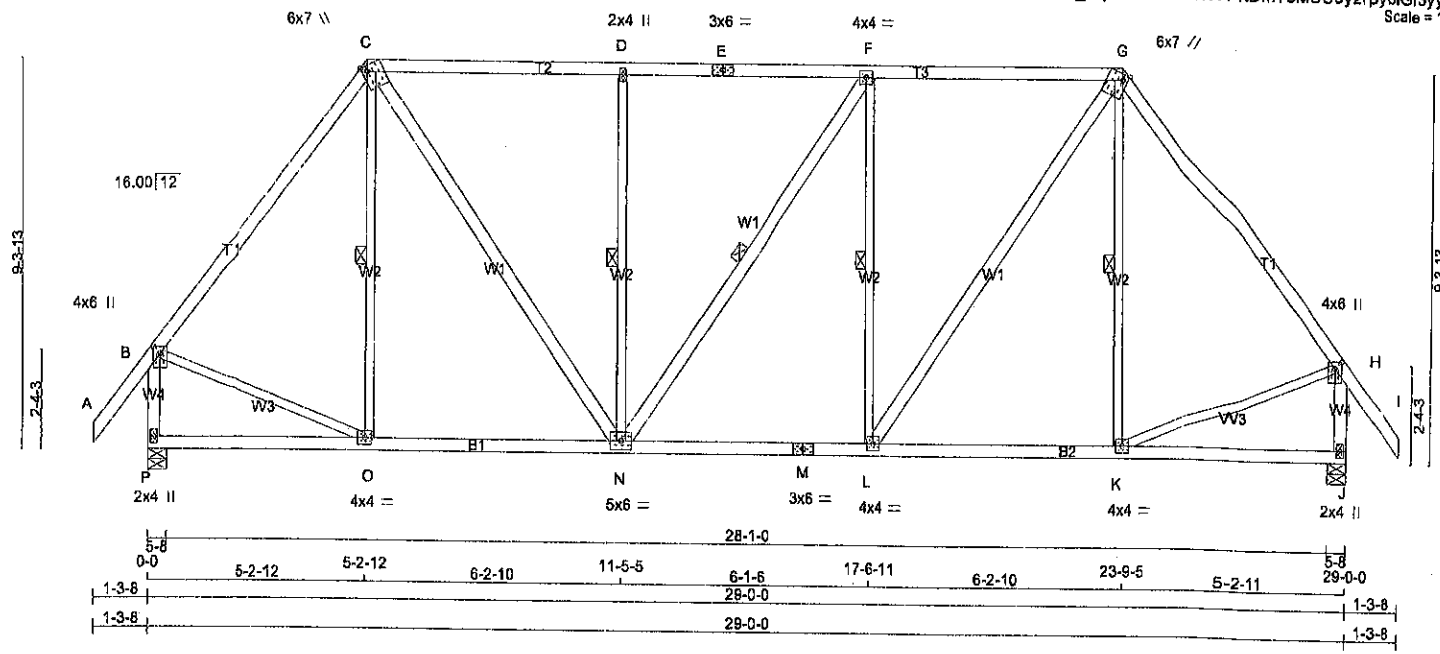

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
C - N	2x4	DRY	No.2	SPF
N - F	2x4	DRY	No.2	SPF
L - G	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	8.0	2.00	2.00
C	TTWW+m	MT20	6.0	7.0	Edge	1.50
D	TMW+w	MT20	2.0	4.0		
E	TS-I	MT20	3.0	6.0		
F	TMWW-I	MT20	4.0	4.0		
G	TTWW+m	MT20	6.0	7.0	Edge	1.50
H	TMVW+p	MT20	4.0	8.0	2.00	2.00
J	BMV1+p	MT20	2.0	4.0		
K, L, O						
K	BMWW-I	MT20	4.0	4.0		
M	BS-I	MT20	3.0	6.0		
N	BMWW-I	MT20	6.0	6.0		
P	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
P	1375	0	1375	0	0	5-8	1-8	
J	1375	0	1375	0	0	5-8	1-8	

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	868	668 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
J	968	668 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.68FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF C-O, D-N, F-N, F-L, G-K.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	UNBRACED LENGTH
FR-TO				FR-TO			
A-B	0 / 40	-70.5	-70.5 0.10 (1)	10.00	O-C	-114 / 51	0.07 (1)
B-C	-1033 / 0	-70.5	-70.5 0.43 (1)	5.68	C-N	0 / 898	0.11 (1)
C-D	-1013 / 0	-70.5	-70.5 0.40 (1)	5.68	N-D	-468 / 0	0.27 (1)
D-E	-1013 / 0	-70.5	-70.5 0.41 (1)	5.68	N-F	-2 / 0	0.00 (1)
E-F	-1013 / 0	-70.5	-70.5 0.41 (1)	5.68	L-F	-468 / 0	0.27 (1)
F-G	-1014 / 0	-70.5	-70.5 0.41 (1)	5.68	L-G	0 / 700	0.11 (1)
G-H	-1033 / 0	-70.5	-70.5 0.43 (1)	5.68	K-G	-116 / 51	0.07 (1)
H-I	0 / 40	-70.5	-70.5 0.10 (1)	10.00	B-O	0 / 657	0.15 (1)
P-B	-1339 / 0	0.0	0.0 0.17 (1)	7.00	K-H	0 / 657	0.15 (1)
J-H	-1338 / 0	0.0	0.0 0.17 (1)	7.00			
P-O	0 / 0	-17.5	-17.5 0.13 (4)	10.00			
O-N	0 / 816	-17.5	-17.5 0.18 (4)	10.00			
N-M	0 / 1014	-17.5	-17.5 0.23 (1)	10.00			
M-L	0 / 1014	-17.5	-17.5 0.23 (1)	10.00			
L-K	0 / 816	-17.5	-17.5 0.18 (4)	10.00			
K-J	0 / 0	-17.5	-17.5 0.13 (4)	10.00			

TOTAL WEIGHT = 2 X 158 = 316 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 21.0 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 568-09
- TPIC 2011

(65 % OF 23.0 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.97")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TO=0.43 (B-C:1), BC=0.23 (L-N:1), WB=0.27 (F-L:1), SSI=0.20 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (B) (INPUT = 0.80)
JSI METAL= 0.28 (M) (INPUT = 1.00)



A-15073579

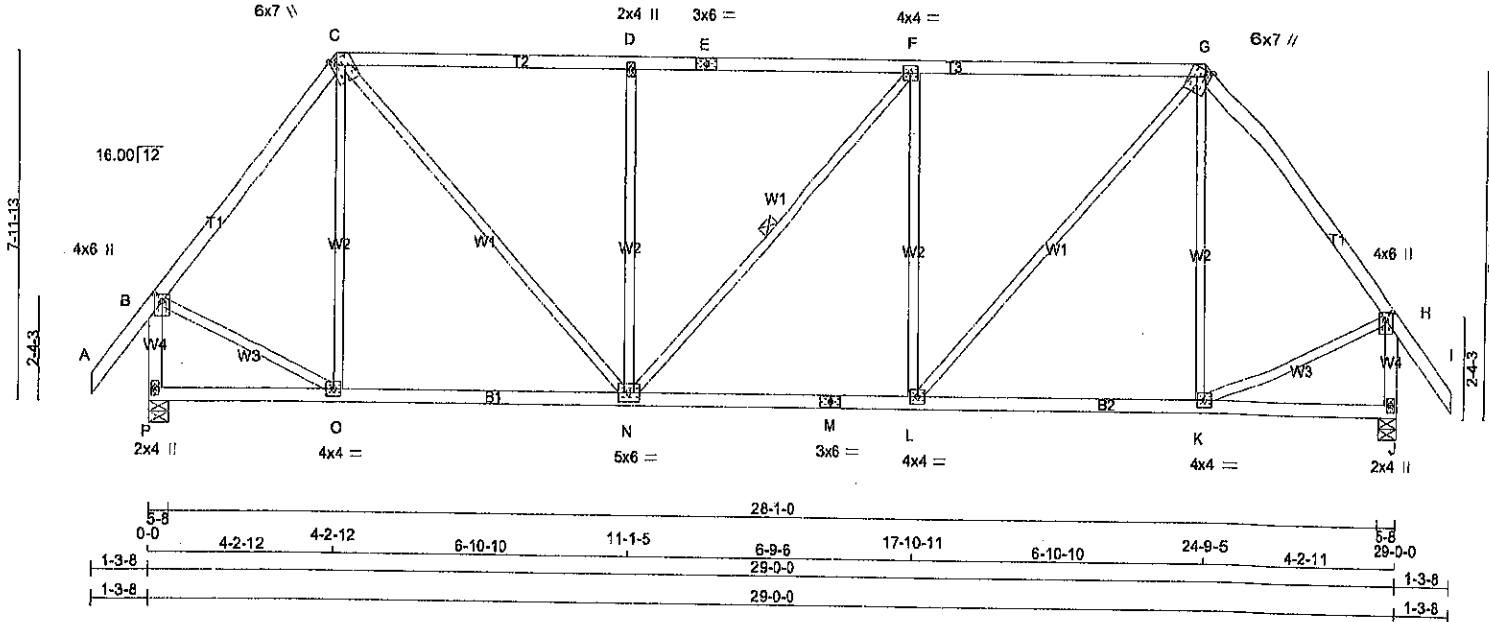

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - K	2x4	DRY No.2	SPF
K - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	2.00	2.00
C	TTWW+m	MT20	6.0	7.0	Edge	1.50
D	TMVW+w	MT20	2.0	4.0		
E	TS-i	MT20	3.0	6.0		
F	TMVW-i	MT20	4.0	4.0		
G	TTWW+m	MT20	6.0	7.0	Edge	1.50
H	TMVW+p	MT20	4.0	6.0	2.00	2.00
J	BMV1+p	MT20	2.0	4.0		
K, L, O						
K	BMVW-i	MT20	4.0	4.0		
M	BS-i	MT20	3.0	6.0		
N	BMVW-i	MT20	5.0	6.0		
P	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
P	1375	0	1375	0	5-B	1-B
J	1375	0	1375	0	5-B	1-B

UNFACTORED REACTIONS

JT	1ST LOASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
P	966	666 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
J	966	666 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.16 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OF F-N.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX CSI (LC)	MAX UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 40	-70.5	-70.5 0.10 (1)	10.00	O-C	-167 / 31	0.20 (1)
B-C	-1027 / 0	-70.5	-70.5 0.26 (1)	6.88	C-N	0 / 859	0.19 (1)
C-D	-1186 / 0	-70.5	-70.5 0.52 (1)	5.18	N-D	-519 / 0	0.63 (1)
D-E	-1186 / 0	-70.5	-70.5 0.62 (1)	5.18	N-F	-1 / 0	0.00 (1)
E-F	-1186 / 0	-70.5	-70.5 0.52 (1)	5.18	L-F	-519 / 0	0.63 (1)
F-G	-1186 / 0	-70.5	-70.5 0.63 (1)	5.18	L-G	0 / 861	0.19 (1)
G-H	-1027 / 0	-70.5	-70.5 0.26 (1)	5.88	K-G	-168 / 31	0.20 (1)
H-I	0 / 40	-70.5	-70.5 0.10 (1)	10.00	B-O	0 / 673	0.16 (1)
P-B	-1350 / 0	0.0	0.0 0.17 (1)	6.88	K-H	0 / 673	0.16 (1)
J-H	-1350 / 0	0.0	0.0 0.17 (1)	6.88			
P-O	0 / 0	-17.5	-17.5 0.13 (4)	10.00			
O-N	0 / 611	-17.5	-17.5 0.21 (4)	10.00			
N-M	0 / 1187	-17.5	-17.5 0.28 (1)	10.00			
M-L	0 / 1187	-17.5	-17.5 0.28 (1)	10.00			
L-K	0 / 611	-17.5	-17.5 0.21 (4)	10.00			
K-J	0 / 0	-17.5	-17.5 0.13 (4)	10.00			

TOTAL WEIGHT = 2 X 138 = 277 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 21.0 PSF

DL = 3.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.0 PSF

TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 23.0 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.97")

CALCULATED VERT. DEFL.(LL) = L/999 (0.65")

ALLOWABLE DEFL.(TL) = L/360 (0.97")

CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CSI: TC=0.53 (F-G:1), BC=0.26 (L-N:1), WB=0.63 (F-L:1), SSI=0.23 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 822 2284 1666

PLATE PLACEMENT TOL. = 0.250 Inche

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (L) (INPUT = 0.90)

JSI METAL= 0.34 (M) (INPUT = 1.00)



A-K1073578

Alpe Roof Truss, Maple

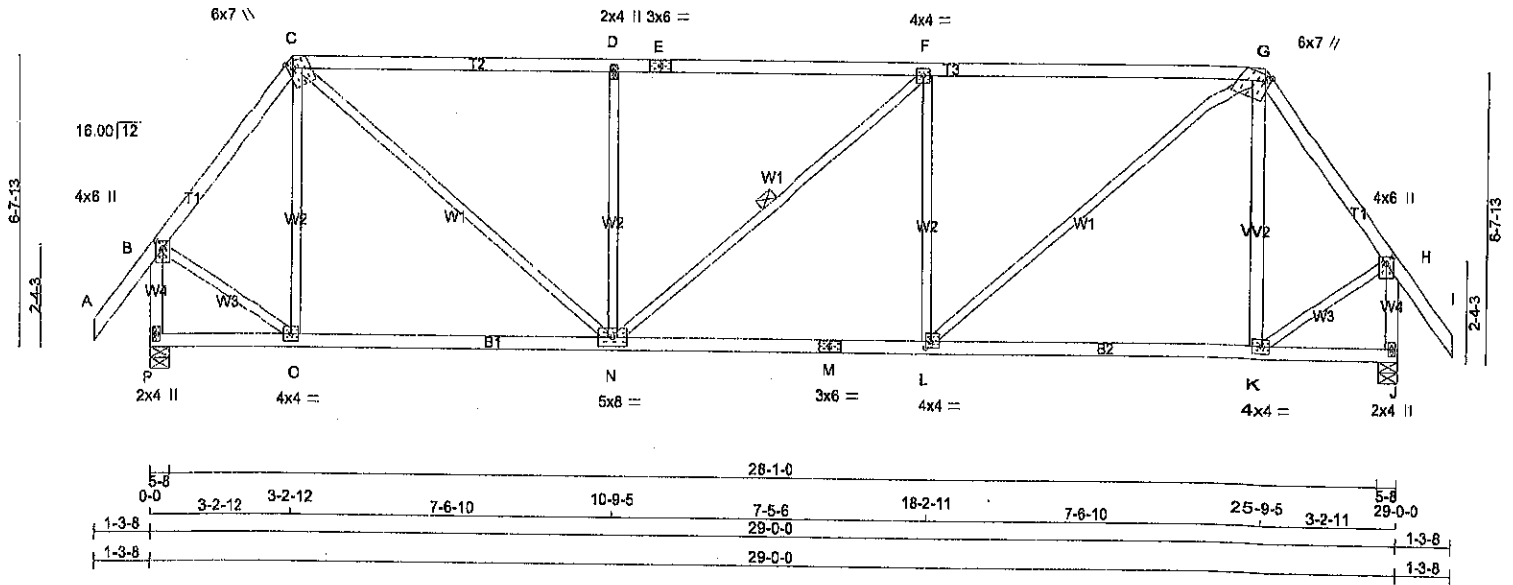

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
P - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	2.00	2.00
C	TTWW+m	MT20	6.0	7.0	Edge	1.50
D	TMW+w	MT20	2.0	4.0		
E	TS-t	MT20	3.0	6.0		
F	TMWW-t	MT20	4.0	4.0		
G	TTWW+m	MT20	6.0	7.0	Edge	1.50
H	TMVW+p	MT20	4.0	6.0	2.00	2.00
J	BMV1+p	MT20	2.0	4.0		
K	BMWW-t	MT20	4.0	4.0		
L	BMWW-t	MT20	4.0	4.0	1.75	1.50
M	BS-t	MT20	3.0	6.0		
N	BMWW-t	MT20	6.0	8.0		
O	BMWW-t	MT20	4.0	4.0		
P	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)

1) Lateral brace(s) shown shall be 1x4 for Part 3 design as per CBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
P	1375	0	1375	0	5-8	1-8
J	1375	0	1375	0	5-8	1-8

UNFACTORED REACTIONS

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
P	986	888 / 0	0 / 0	0 / 0	0 / 0	298 / 0
J	986	888 / 0	0 / 0	0 / 0	0 / 0	298 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00FT. OR RIGID CEILING DIRECTLY APPLIED.

1 LATERAL BRACE(S) REQUIRED AT 1/2 LENGTH OFF-N.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO				FR-TO			
A-B	0 / 40	-70.5	-70.5 0.10 (1)	10.00	O-C	-237 / 8	0.17 (1)
B-C	-989 / 0	-70.5	-70.5 0.15 (1)	6.09	C-N	0 / 1094	0.26 (1)
C-D	-1430 / 0	-70.5	-70.5 0.68 (1)	4.60	N-D	-570 / 0	0.42 (1)
D-E	-1431 / 0	-70.5	-70.5 0.68 (1)	4.59	N-F	-1 / 0	0.00 (1)
E-F	-1431 / 0	-70.5	-70.5 0.68 (1)	4.59	L-F	-570 / 0	0.42 (1)
F-G	-1431 / 0	-70.5	-70.5 0.68 (1)	4.58	L-G	0 / 1086	0.26 (1)
G-H	-998 / 0	-70.5	-70.5 0.15 (1)	8.09	K-G	-238 / 8	0.17 (1)
H-I	0 / 40	-70.5	-70.5 0.10 (1)	10.00	B-O	0 / 890	0.16 (1)
P-B	-1365 / 0	0.0	0.0 0.17 (1)	6.85	K-H	0 / 890	0.16 (1)
J-H	-1365 / 0	0.0	0.0 0.17 (1)	6.85			
P-O	0 / 0	-17.5	-17.5 0.15 (4)	10.00			
O-N	0 / 591	-17.5	-17.5 0.24 (4)	10.00			
N-M	0 / 1432	-17.5	-17.5 0.34 (1)	10.00			
M-L	0 / 1432	-17.5	-17.5 0.34 (1)	10.00			
L-K	0 / 591	-17.5	-17.5 0.24 (4)	10.00			
K-J	0 / 0	-17.5	-17.5 0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 130 = 260 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 21.0 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.97")
CALCULATED VERT. DEFL.(LL) = L/998 (0.06")
ALLOWABLE DEFL.(TL) = L/380 (0.97")
CALCULATED VERT. DEFL.(TL) = L/998 (0.14")

CSI: TC=0.68 (F-G:1), BC=0.34 (L-N:1), WB=0.42 (F-L:1), SI=0.26 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 822 2284 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.81 (E) (INPUT=0.80)
JSI METAL=0.42 (M) (INPUT=1.00)



A-1073577

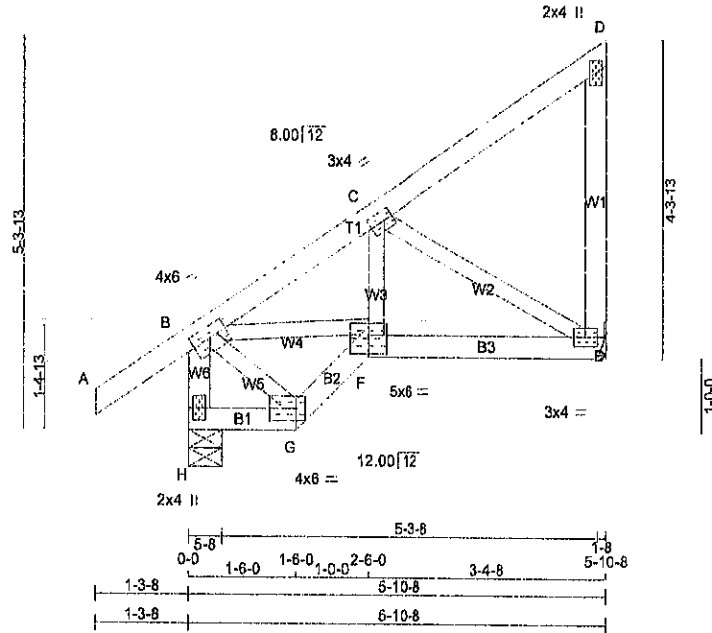

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
H - B	2x4	DRY No.2	SPF
A - D	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
G - F	2x4	DRY No.2	SPF
F - E	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVWW-I	MT20	4.0	6.0	1.75	3.00
C	TMVWW-I	MT20	3.0	4.0	1.50	1.50
D	TMV+p	MT20	2.0	4.0		
E	BMVWW-I	MT20	3.0	4.0		
F	BBWW-I	MT20	5.0	6.0	3.00	3.00
G	BBW-I	MT20	4.0	6.0	2.00	4.50
H	BMV1+p	MT20	2.0	4.0		

NOTES- (1)
1) Lateral brace(s) shown shall be 1x4 for Part 9 design as per OBC 9.23.13.11, and no less than 2x4 for Part 4 design.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
H	355	0	355	0	5-8	1-8
E	258	0	258	0	HANGER BY OTHERS	MIN. SEAT SIZE: 1-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	248	181 / 0	0 / 0	0 / 0	0 / 0	87 / 0	0 / 0
E	182	123 / 0	0 / 0	0 / 0	0 / 0	59 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX	FACTORED CSI (LC)	
FR-TO		FROM TO	CSI (LC)	LENGTH	FR-TO				
H-B	-342 / 0	0.0	0.0	0.04 (1)	7.81	B-G	0 / 18	0.01 (4)	
A-B	0 / 27	-70.5	-70.5	0.09 (1)	10.00	B-F	0 / 238	0.05 (1)	
B-C	-287 / 0	-70.5	-70.5	0.10 (1)	8.25	F-C	0 / 57	0.02 (4)	
C-D	-12 / 0	-70.5	-70.5	0.10 (1)	6.21	C-E	-284 / 0	0.07 (1)	
E-D	-93 / 0	0.0	0.0	0.03 (1)	7.81				
H-G	0 / 0	-17.5	-17.5	0.01 (4)	10.00				
G-F	0 / 20	-17.5	-17.5	0.01 (4)	10.00				
F-E	0 / 248	-17.5	-17.5	0.08 (4)	10.00				

TOTAL WEIGHT = 7 X 30 = 208 lb [M]

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 21.0 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 31.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 23.0 P.S.F. G.S.L. PLUS
8.4 P.S.F. RAIN LOAD EQUALS
21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.10 (B-C:1), BC=0.08 (E-F:4), WB=0.07 (C-E:1), SSI=0.09 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.41 (B) (INPUT = 0.80)
JSI METAL= 0.10 (B) (INPUT = 1.00)



A-15073574

LUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

MATERIAL: 18 gauge

FINISH: G90 galvanized

DESIGN:

- Factored resistances are in accordance with CSA 086-14
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.



INSTALLATION:

- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

OPTIONS:


- These hangers cannot be modified.

Typical LUS
Installation

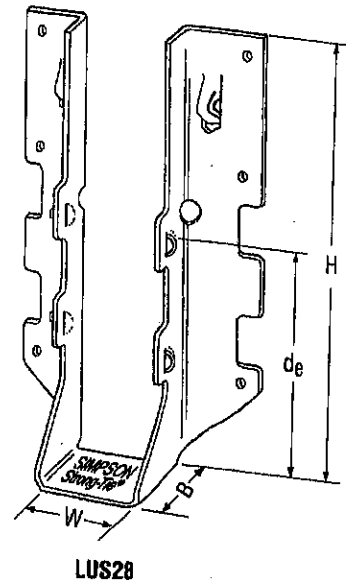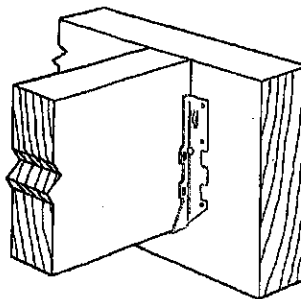


Model No.	Ga	Dimensions (in)				Fasteners		Factored Resistance (lbs)			
		W	H	B	d _g ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _D =1.15)	Normal (K _D =1.00)	Uplift (K _D =1.15)	Normal (K _D =1.00)
LUS24	18	1 1/8	3 1/8	1 3/4	1 15/16	4-10d	2-10d	710	1630	645	1155
LUS24-2	18	3 1/8	3 1/8	2	1 13/16	4-16d	2-16d	835	2020	590	1435
LUS26	18	1 3/8	4 3/8	1 3/4	3 3/8	4-10d	4-10d	1420	2170	1290	1630
LUS26-2	18	3 1/8	4 3/8	2	4	4-16d	4-16d	1720	2595	1545	1920
LUS26-3	18	4 3/8	4 3/8	2	3 1/4	4-16d	4-16d	1720	2595	1545	2340
LUS28	18	1 1/8	6 3/8	1 3/4	3 3/4	6-10d	4-10d	1420	2520	1290	1790
LUS28-2	18	3 1/8	7	2	4	6-16d	4-16d	1720	3325	1545	2575
LUS28-3	18	4 3/8	6 3/4	2	3 1/4	6-16d	4-16d	1720	3325	1545	2375
LUS210	18	1 1/8	7 13/16	1 3/4	3 3/8	8-10d	4-10d	1420	2785	1290	2210
LUS210-2	18	3 1/8	9	2	6	8-16d	6-16d	2580	4500	2320	3195
LUS210-3	18	4 3/8	8 3/4	2	5 1/4	8-16d	6-16d	2580	3345	2320	2375

1. d_g is the distance from the seat of the hanger to the highest joist nail.



Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).

U.S. Patent
5,603,580



Double
Shear
Nailing
Top View.



800-999-5099
www.strongtie.com

HHUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HHUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

MATERIAL: 14 gauge

FINISH: G90 galvanized

DESIGN:


- Factored resistances are in accordance with CSA O86-14
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

INSTALLATION:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

OPTIONS:

- See current catalogue for options

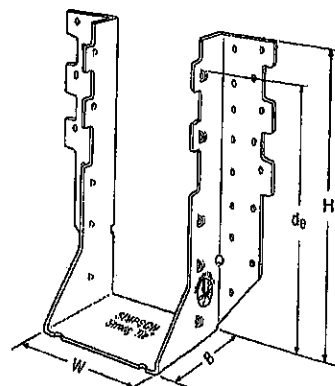


HHUS410

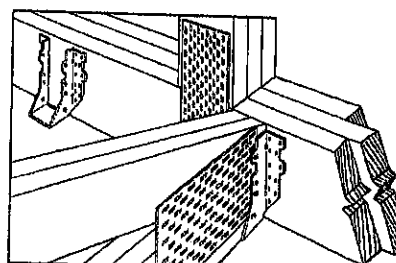

Typical HHUS Installation
(Truss Designer to provide
fastener quantity for connecting
multiple members together)


Model No.	Ga	Dimensions (in)				Fasteners		Factored Resistance (lbs)			
		W	H	B	d _g ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _D =1.15)	Normal (K _D =1.00)	Uplift (K _D =1.15)	Normal (K _D =1.00)
HHUS26-2	14	3 1/8	5 1/16	3	3 15/16	14-16d	6-16d	2850	7335	2065	5205
HHUS28-2	14	3 1/8	7 1/32	3	6 7/32	22-16d	8-16d	3765	8940	2675	6345
HHUS210-2	14	3 1/8	9 1/32	3	8	30-16d	10-16d	4745	9860	4310	7000
HHUS210-3	14	4 1/16	9	3	7 15/16	30-16d	10-16d	4745	10545	4310	7485
HHUS210-4	14	6 1/8	8 29/32	3	7 21/32	30-16d	10-16d	4745	10545	4310	7485
HHUS46	14	3 5/8	5 1/32	3	3 15/16	14-16d	6-16d	2540	7335	2065	5205
HHUS48	14	3 5/8	7 1/8	3	6 1/8	22-16d	8-16d	3765	8945	2675	6345
HHUS410	14	3 5/8	9	3	8	30-16d	10-16d	4745	9855	4310	7000
HHUS5.50/10	14	5 1/2	9	3	8	30-16d	10-16d	4745	10545	4310	7485
HHUS7.25/10	14	7 1/4	9	3 5/16	7 29/32	30-16d	10-16d	4745	10770	4310	7650

1. d_g is the distance from the seat of the hanger to the highest joist nail.




Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).


U.S. Patent
5,603,580




Double
Shear
Nailing
Side
View. Do
not bend
tab back.



Double
Shear
Nailing
Top View.




Typical HHUS
Installation

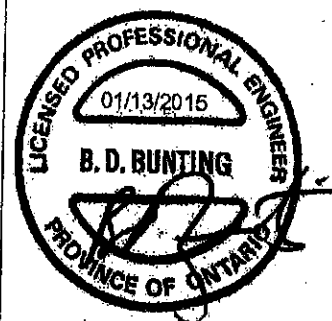

800-999-5099
www.strongtie.com

STRACON ENGINEERING INC.

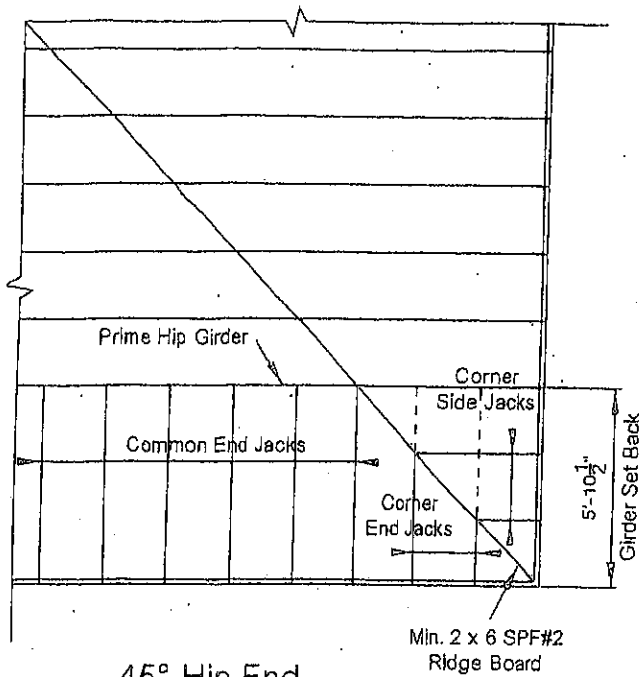



45° Hip End

LUMBER SPECIFICATION


TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN

DESIGN LOAD


TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.
 TOTAL LOAD : 50.5 P.S.F.

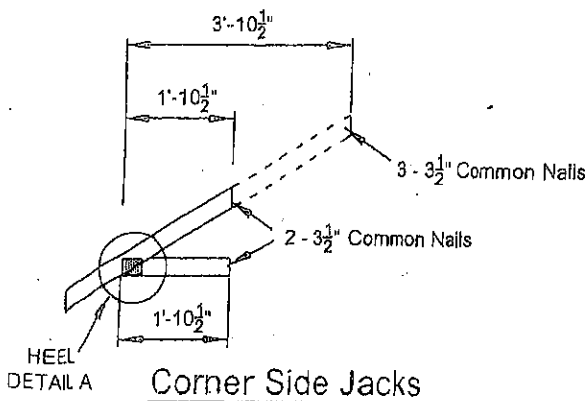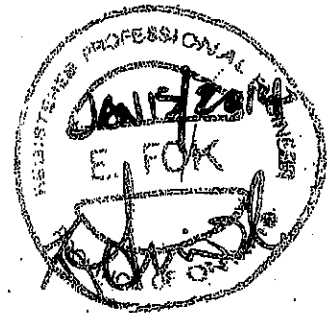


Corner Side Jacks

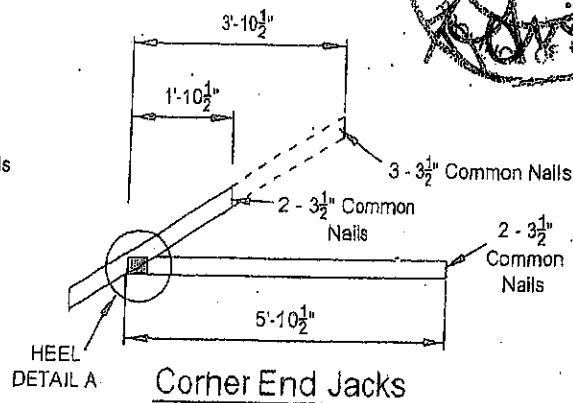

Corner End Jacks

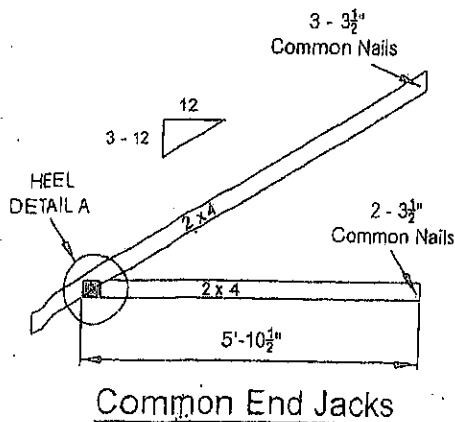

Common End Jacks

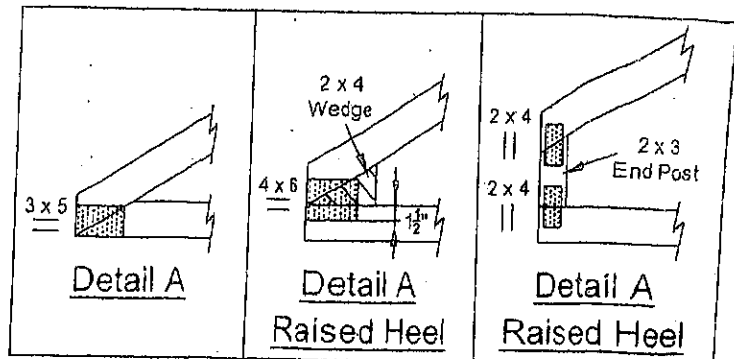

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

CS-51008