


Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality VAUGHAN (WOODBIDGE)	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 5003 - THE OAKGROVE Project: PINE VALLEY & TESTON	
D. Declaration of Designer			
I <u>MICHAEL O'ROURKE</u> (print name) declare that (choose one as appropriate):			
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: 19669 Basis for exemption from registration and qualification: O.B.C SENTENCE 3.2.4.1 (4)			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
January 24, 2018		 Signature of Designer	
Date			

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

56698	TONS: 4.89	LOSS DUE TO VENTILATION LOAD BTU/H: 3181	STRUCTURAL HEAT LOSS: 72355	TOTAL COMBINED HEAT LOSS BTU/H: 75636
TOTAL HEAT GAIN BTU/H:				

TYPE: 5003 - THE OAKGROVE
SITE NAME: PINE VALLEY & TESTON

LO # 77475

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm	<u>42.4</u> cfm
Other Bedrooms	<u>3</u> @ 10.6 cfm	<u>31.8</u> cfm
Kitchen & Bathrooms	<u>5</u> @ 10.6 cfm	<u>53</u> cfm
Other Rooms	<u>7</u> @ 10.6 cfm	<u>74.2</u> cfm
Table 9.32.3.A. TOTAL		<u>201.4</u> cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		<u>79.5</u> cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>201.4</u>	cfm
Less Principal Ventil. Capacity	<u>155</u>	cfm
Required Supplemental Capacity	<u>46.4</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY			
Model: VANEE 65H	Location: BSMT		
<u>155.0</u> cfm	<u>3.0</u> sones ☒ HVI Approved		
PRINCIPAL EXHAUST HEAT LOSS CALCULATION			
CFM	ΔT °F	FACTOR	% LOSS
155.0 CFM	X 76 F	X 1.08	X 0.25

SUPPLEMENTAL FANS		NUTONE	
Location	Model	cfm	HVI
ENS	QTXEN050C	50	☒
BATH	QTXEN050C	50	☒
ENS-2	QTXEN050C	50	☒
PWD	QTXEN050C	50	☒

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model: VANEE 65H		
<u>155</u> cfm high	<u>64</u> cfm low	
<u>75</u> % Sensible Efficiency	☒ HVI Approved	
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
GOLD PARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	January-18

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																									
Formula Sheet (For Air Leakage / Ventilation Calculation)																																									
LO#: 77475		Model: 5003 - THE OAKGROVE		Builder: GOLD PARK HOMES		Date: 2018-01-24																																			
Volume Calculation																																									
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>House Volume Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> <tr> <td>Bsmt</td> <td>1760</td> <td>10</td> <td>17600</td> </tr> <tr> <td>First</td> <td>1760</td> <td>11</td> <td>19360</td> </tr> <tr> <td>Second</td> <td>2125</td> <td>9</td> <td>19125</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td colspan="2">Total:</td> <td></td> <td>56,085.0 ft³</td> </tr> <tr> <td colspan="2">Total:</td> <td></td> <td>1588.2 m³</td> </tr> </table>										House Volume Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	1760	10	17600	First	1760	11	19360	Second	2125	9	19125	Third	0	9	0	Fourth	0	9	0	Total:			56,085.0 ft³	Total:			1588.2 m³
House Volume Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																						
Bsmt	1760	10	17600																																						
First	1760	11	19360																																						
Second	2125	9	19125																																						
Third	0	9	0																																						
Fourth	0	9	0																																						
Total:			56,085.0 ft³																																						
Total:			1588.2 m³																																						
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="4">Design Temperature Difference</th> </tr> <tr> <th>Winter DTDh</th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> </tr> <tr> <td></td> <td>22</td> <td>-20</td> <td>42</td> </tr> <tr> <th>Summer DTDc</th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> </tr> <tr> <td></td> <td>22</td> <td>31</td> <td>9</td> </tr> <tr> <td></td> <td></td> <td></td> <td>16</td> </tr> </table>										Design Temperature Difference				Winter DTDh	Tin °C	Tout °C	ΔT °C		22	-20	42	Summer DTDc	Tin °C	Tout °C	ΔT °C		22	31	9				16								
Design Temperature Difference																																									
Winter DTDh	Tin °C	Tout °C	ΔT °C																																						
	22	-20	42																																						
Summer DTDc	Tin °C	Tout °C	ΔT °C																																						
	22	31	9																																						
			16																																						
6.2.6 Sensible Gain due to Air Leakage																																									
$HG_{satb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$																																									
<table style="width:100%;"> <tr> <td style="width:10%;">0.340</td> <td style="width:10%;">x</td> <td style="width:10%;">441.15</td> <td style="width:10%;">x</td> <td style="width:10%;">9 °C</td> <td style="width:10%;">x</td> <td style="width:10%;">1.2</td> <td style="width:10%;">=</td> <td style="width:10%;">576 W</td> </tr> <tr> <td colspan="8"></td> <td style="text-align: right;">= 1966 Btu/h</td> </tr> </table>										0.340	x	441.15	x	9 °C	x	1.2	=	576 W									= 1966 Btu/h														
0.340	x	441.15	x	9 °C	x	1.2	=	576 W																																	
								= 1966 Btu/h																																	
6.2.7 Sensible heat Gain due to Ventilation																																									
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$																																									
<table style="width:100%;"> <tr> <td style="width:10%;">155 CFM</td> <td style="width:10%;">x</td> <td style="width:10%;">16 °F</td> <td style="width:10%;">x</td> <td style="width:10%;">1.08</td> <td style="width:10%;">x</td> <td style="width:10%;">0.25</td> <td style="width:10%;">=</td> <td style="width:10%;">661 Btu/h</td> </tr> </table>										155 CFM	x	16 °F	x	1.08	x	0.25	=	661 Btu/h																							
155 CFM	x	16 °F	x	1.08	x	0.25	=	661 Btu/h																																	
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																									
$HL_{airr} = Level Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$																																									
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{level})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)</th> </tr> <tr> <td>1</td> <td>0.5</td> <td rowspan="5" style="text-align: center; vertical-align: middle;">25,934</td> <td>10,011</td> <td>1.295</td> </tr> <tr> <td>2</td> <td>0.3</td> <td>17,829</td> <td>0.436</td> </tr> <tr> <td>3</td> <td>0.2</td> <td>17,917</td> <td>0.289</td> </tr> <tr> <td>4</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> <tr> <td>5</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> </table>										Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{level})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)	1	0.5	25,934	10,011	1.295	2	0.3	17,829	0.436	3	0.2	17,917	0.289	4	0	0	0.000	5	0	0	0.000						
Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{level})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																					
1	0.5	25,934	10,011	1.295																																					
2	0.3		17,829	0.436																																					
3	0.2		17,917	0.289																																					
4	0		0	0.000																																					
5	0		0	0.000																																					
*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairbv = 0																																									

HEAT LOSS AND GAIN SUMMARY SHEET**MODEL:** 5003 - THE OAKGROVE**BUILDER:** GOLD PARK HOMES**SFQT:** 3862**LO#** 77475**SITE:** PINE VALLEY & TESTON**DESIGN ASSUMPTIONS**

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-4	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	72

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft³):	56085.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft²):	1.50	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 61.0 ft	WIDTH: 40.0 ft	EXPOSED PERIMETER:	202.0 ft

2012 OBC - COMPLIANCE PACKAGE		Compliance Package A1	
Component		Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value		60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value		31	27.65
Exposed Floor Minimum RSI (R)-Value		31	29.80
Walls Above Grade Minimum RSI (R)-Value		22	17.03
Basement Walls Minimum RSI (R)-Value		20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value		-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value		10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value		10	11.13
Windows and Sliding Glass Doors Maximum U-Value		0.28	-
Skylights Maximum U-Value		0.49	-
Space Heating Equipment Minimum AFUE		0.96	-
HRV Minimum Efficiency		75%	-
Domestic Hot Water Heater Minimum EF		0.8	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

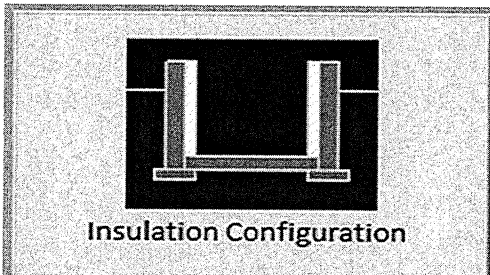Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	18.6	 Insulation Configuration
Floor Width (m):	12.2	
Exposed Perimeter (m):	0.0	
Wall Height (m):	3.0	
Depth Below Grade (m):	2.13	
Window Area (m ²):	1.5	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):	2047	


TYPE: 5003 - THE OAKGROVE
LO# 77475

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Vaughan (Woodbridge)			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	7.01			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1588.2			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	2117.1 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	73.2	73.2		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.340			
Cooling Air Leakage Rate (ACH/H):	0.124			

TYPE: 5003 - THE OAKGROVE
LO# 77475

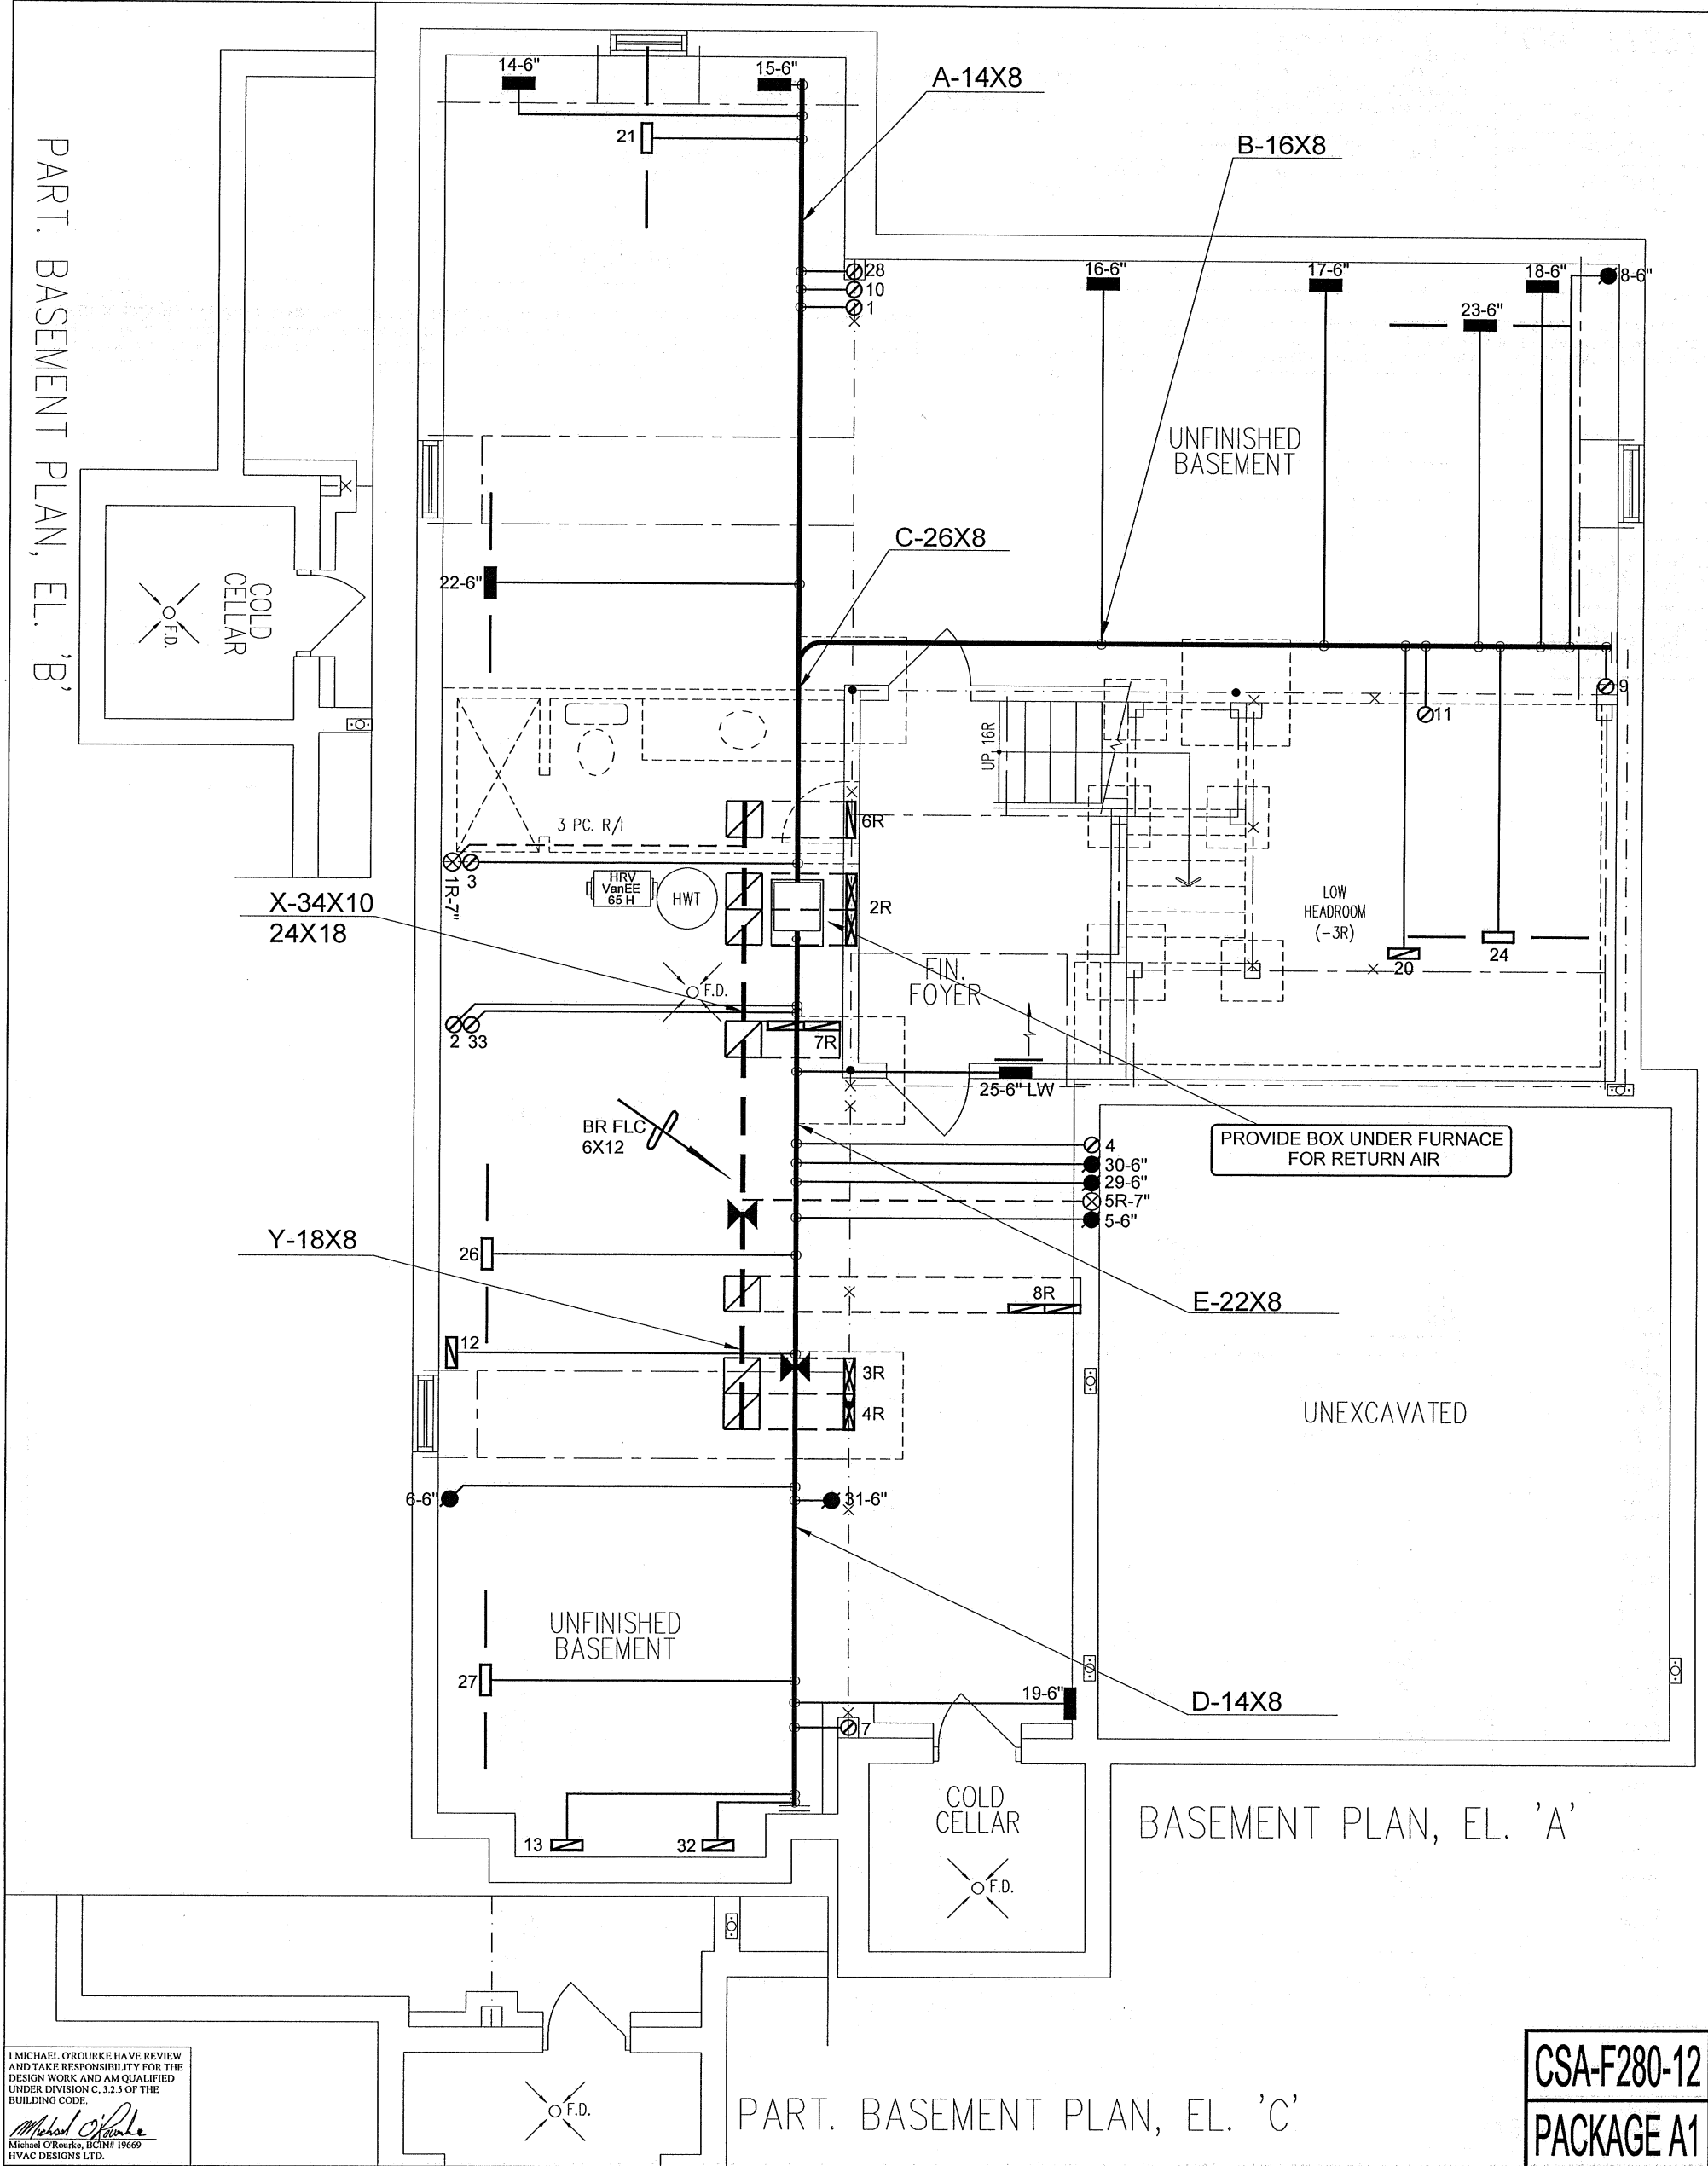

I MICHAEL O'ROURKE HAVE REVIEW AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C.32.5 OF THE BUILDING CODE.

Michael O'Rourke


Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1

HVAC LEGEND							3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		HVACDESIGNS LTD. 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	HEAT LOSS 75536 BTU/H		# OF RUNS S/A R/A FANS				Sheet Title BASEMENT HEATING LAYOUT		
Project Name PINE VALLEY & TESTON VAUGHAN, ONTARIO			UNIT DATA		3RD FLOOR						
			MAKE LENNOX		2ND FLOOR		16	5			4
			MODEL EL296UH110XE60C		1ST FLOOR		10	3	2		
			INPUT 110 MBTU/H		BASEMENT		7	1	0		
			OUTPUT 106 MBTU/H		ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A						
THE OAKGROVE 5003		COOLING 5.0 TONS		Date JAN/2018							
		FAN SPEED 1955 cfm @ 0.8" w.c.		Scale 3/16" = 1'-0"							
3862 sqft				BCIN# 19669							
				LO# 77475							

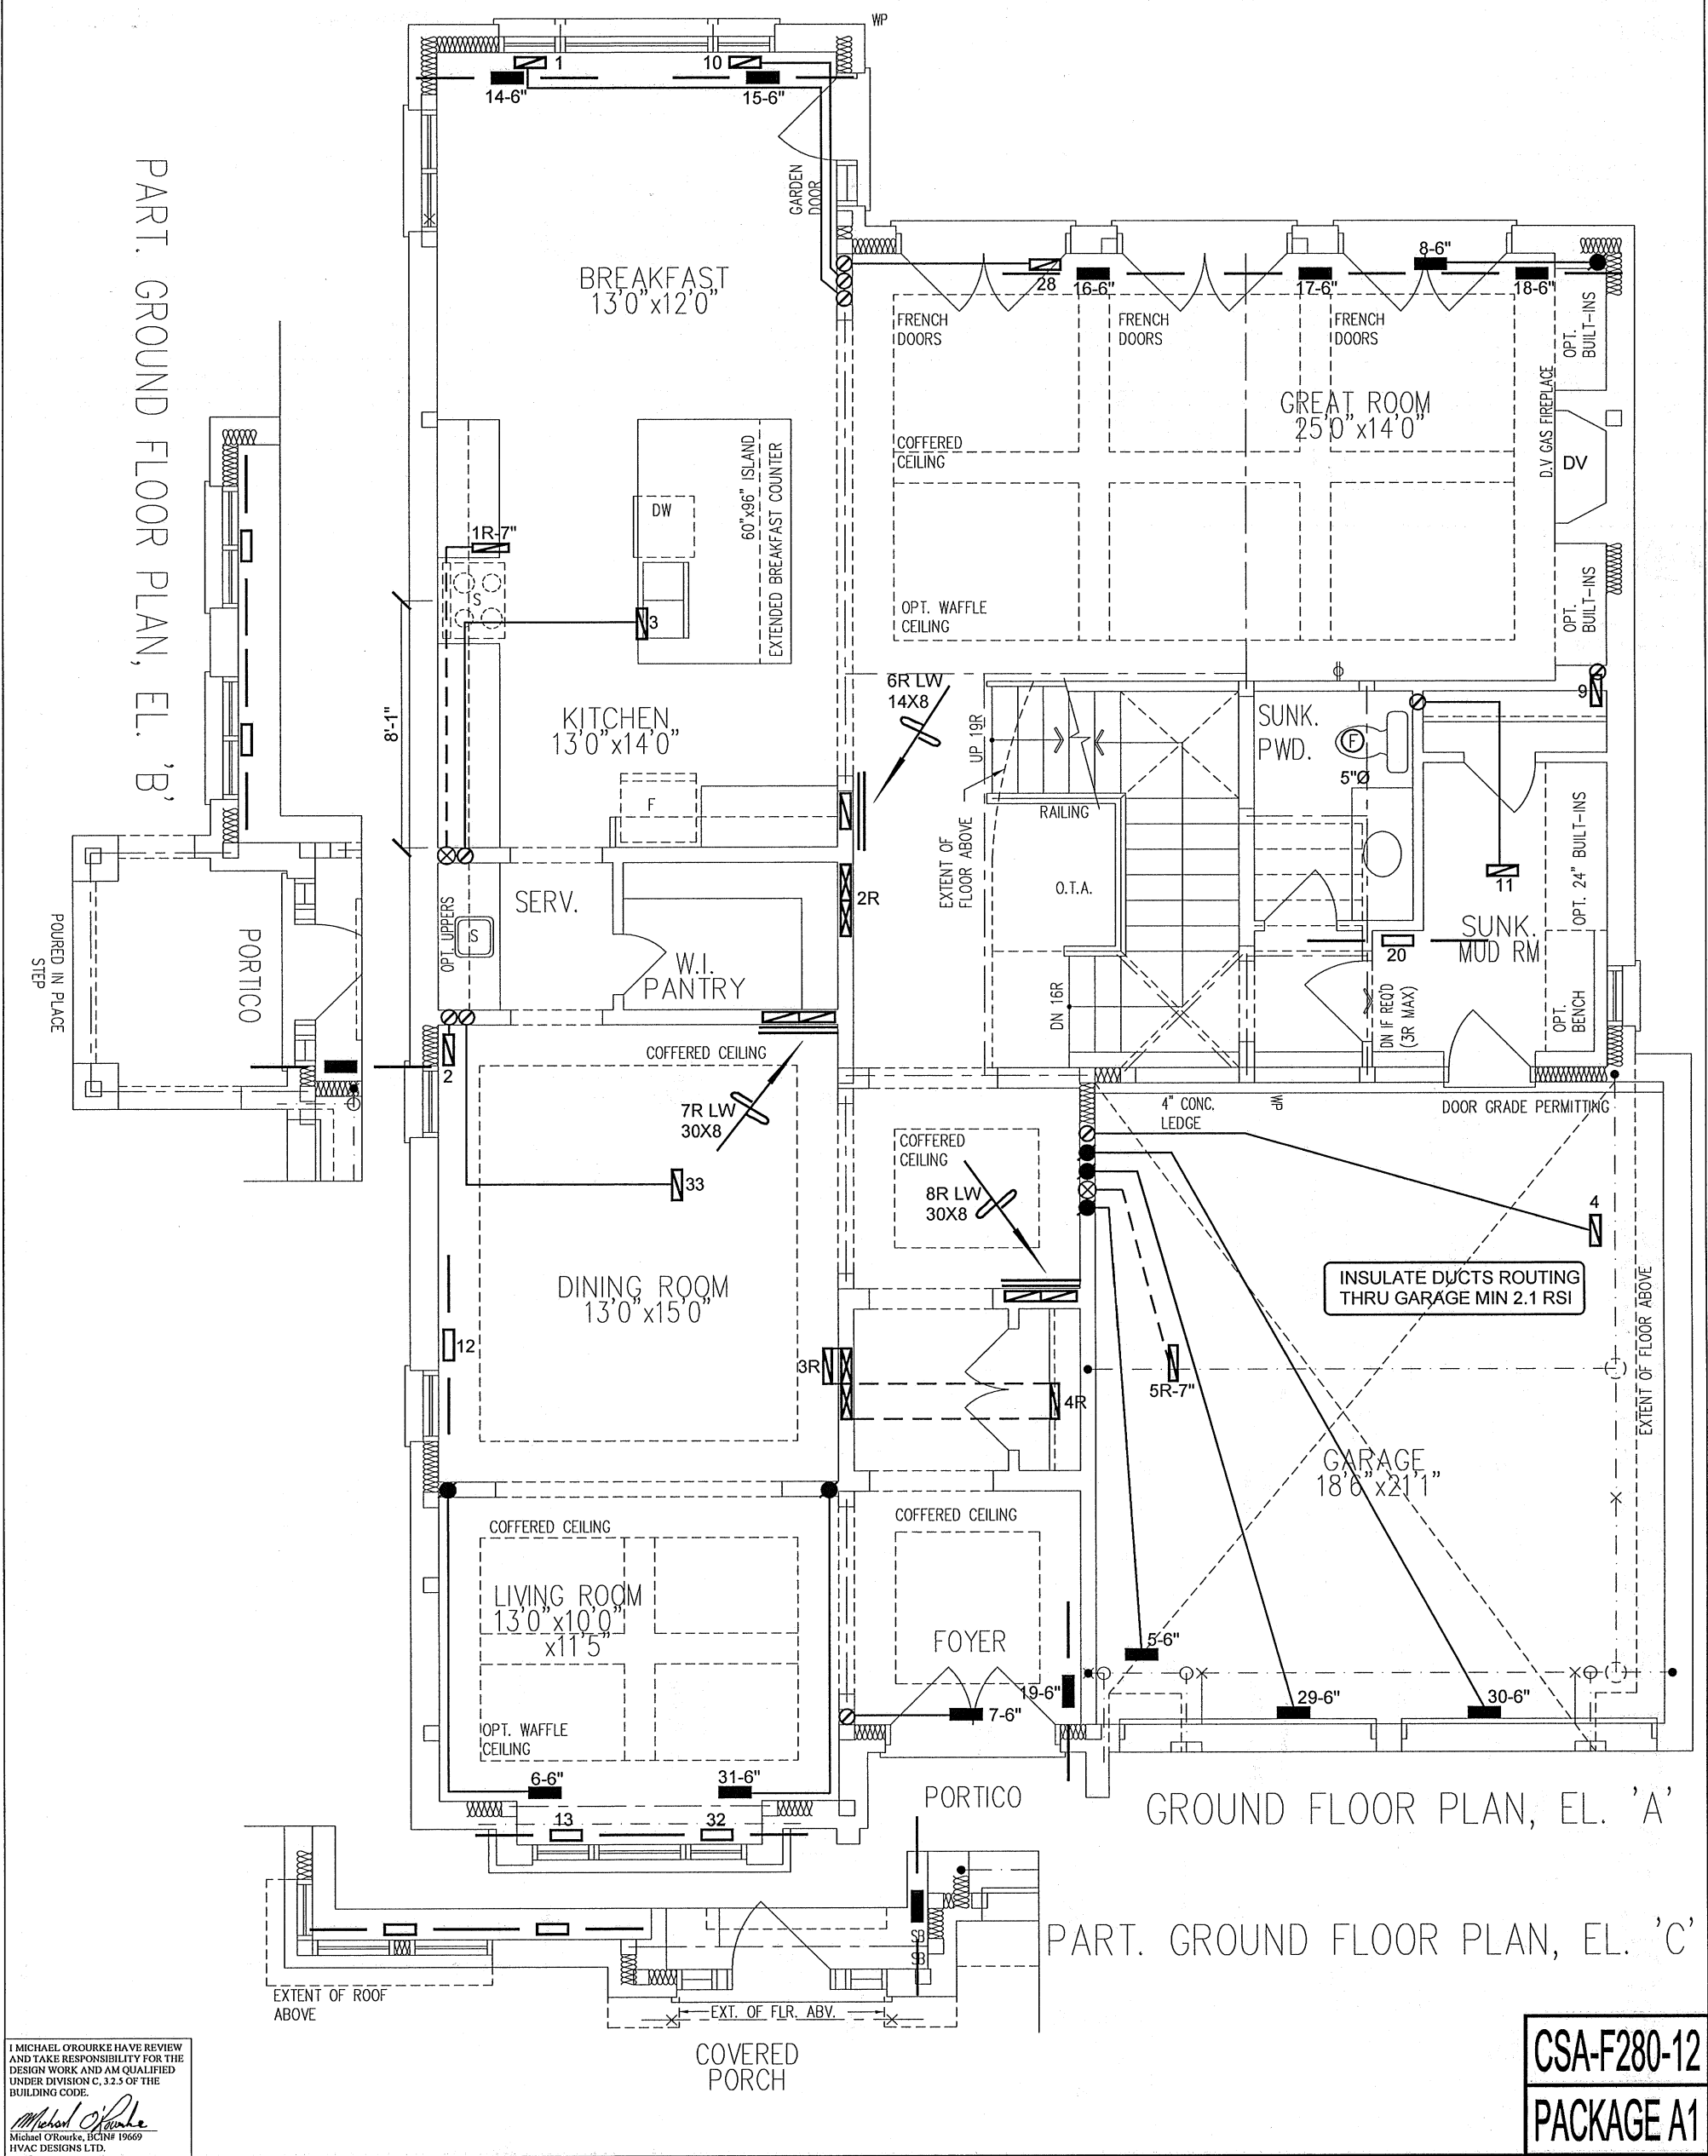

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.



Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1

HVAC LEGEND						3.	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER
						No.	REVISIONS
						Description	Date

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GOLD PARK HOMES			FIRST FLOOR HEATING LAYOUT	
Project Name			Date	JAN/2018
PINE VALLEY & TESTON VAUGHAN, ONTARIO			Scale	3/16" = 1'-0"
THE OAKGROVE 5003		BCIN# 19669		
3862 sqft		LO#	77475	

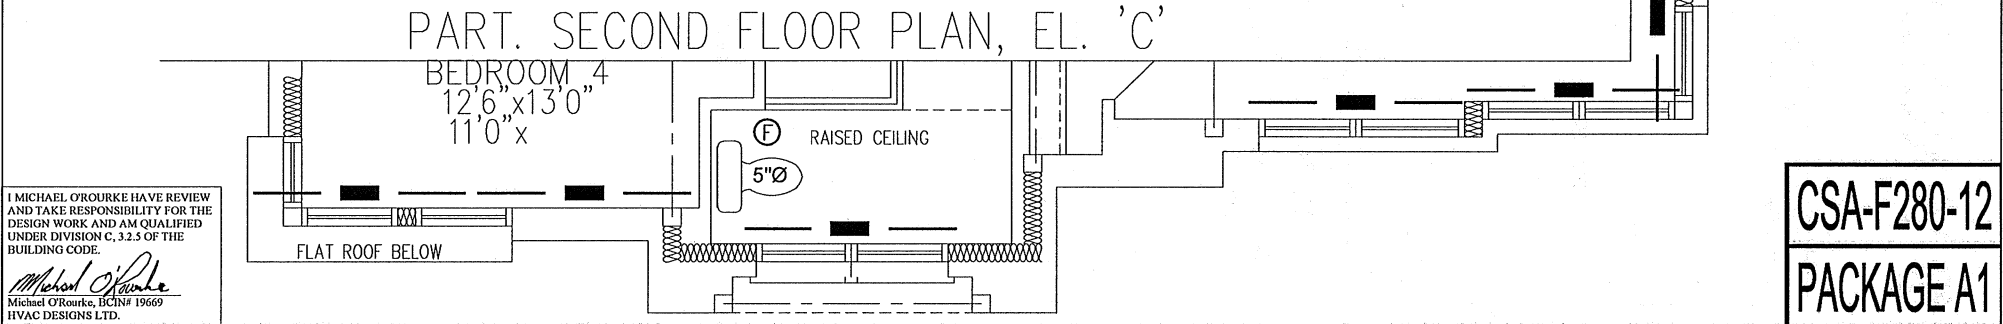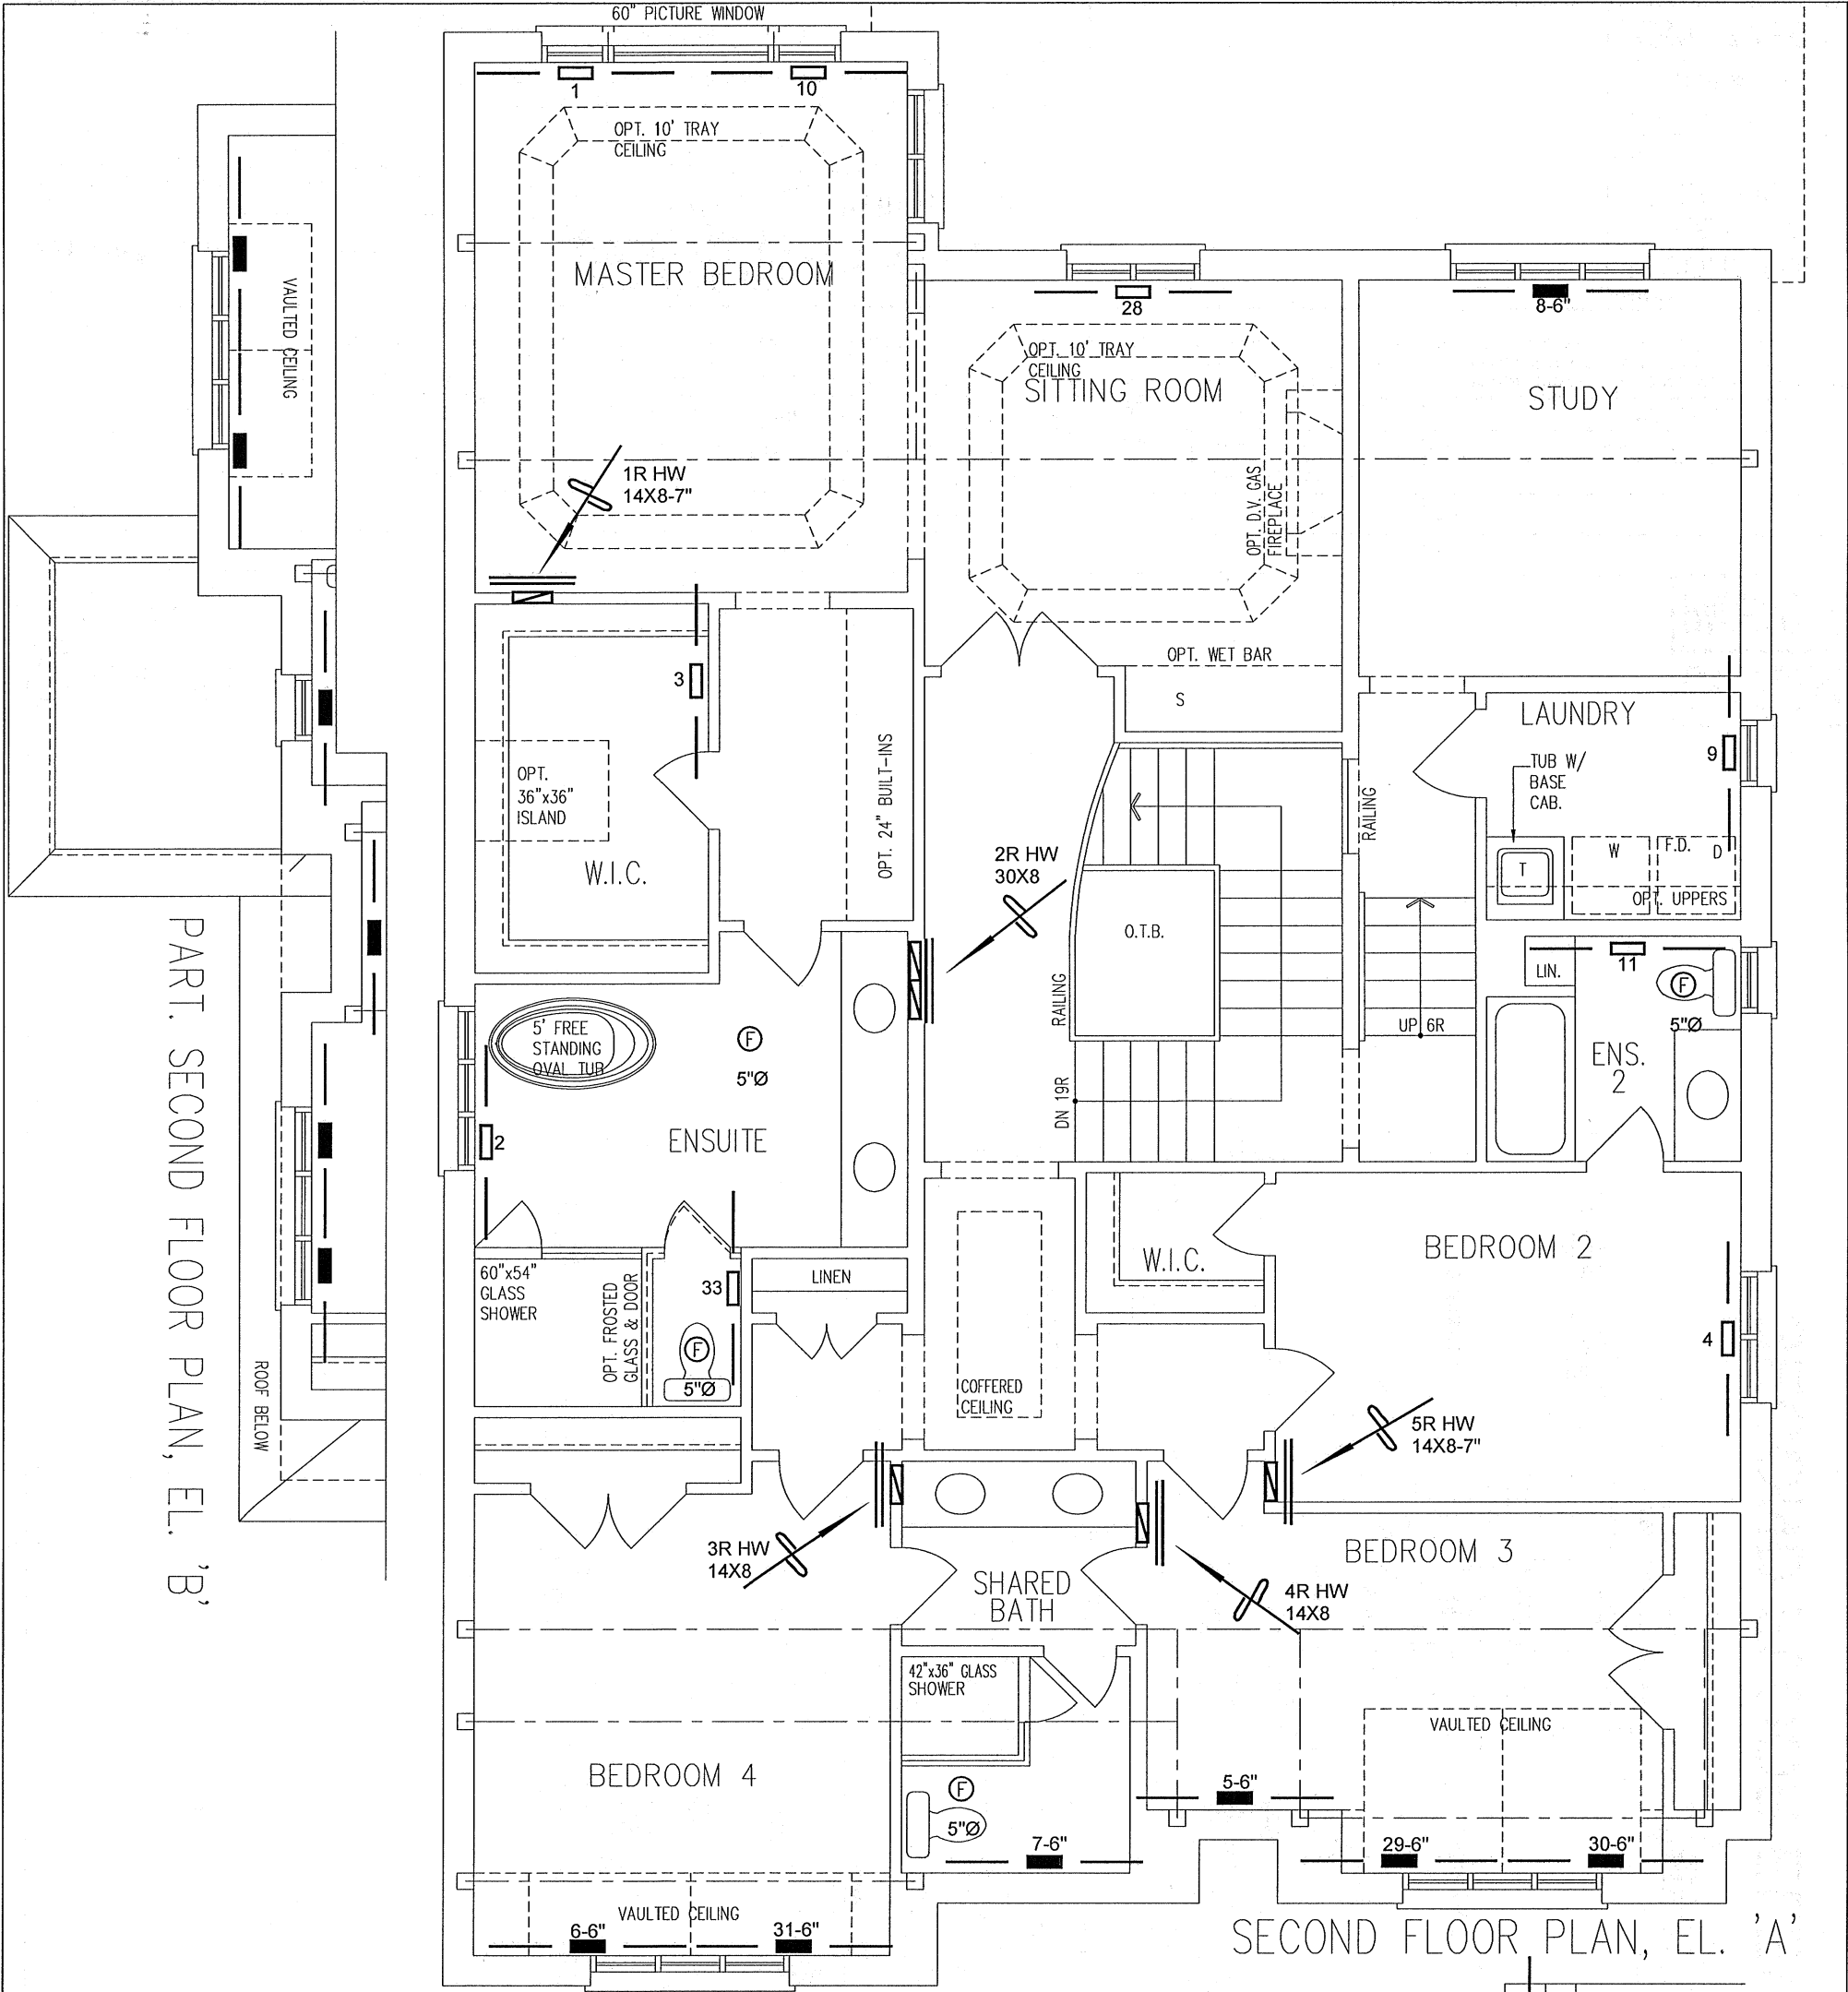

HVAC LEGEND							3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GOLD PARK HOMES			SECOND FLOOR HEATING LAYOUT	
Project Name			Date	JAN/2018
PINE VALLEY & TESTON VAUGHAN, ONTARIO			Scale	3/16" = 1'-0"
THE OAKGROVE			BCIN# 19669	
5003	3862 sqft		LO#	77475