



ELEVATION 'A'

ELEVATION 'B'

UNIT 4201 - 'THE MAPLEWOOD'

SB-12 ENERGY EFFICIENCY DESIGN MATRIX

PRESCRIPTIVE COMPLIANCE	SB-12 (SECTION 3.1.1) TABLE 3.1.1.2.A	
	SPACE HEATING FUEL	
	<input checked="" type="checkbox"/> GAS	<input type="checkbox"/> OIL
	<input type="checkbox"/> ELECTRIC	<input type="checkbox"/> PROPANE
	<input type="checkbox"/> EARTH	<input type="checkbox"/> SOLID FUEL

PACKAGE A1

BUILDING COMPONENT	REQUIRED	PROPOSED
INSULATION RSI (R) VALUE		
CEILING W/ ATTIC SPACE	10.56 (R60)	10.56 (R60)
CEILING W/O ATTIC SPACE	5.46 (R31)	5.46 (R31)
EXPOSED FLOOR	5.46 (R31)	5.46 (R31)
WALLS ABOVE GRADE	3.87 (R22)	3.87 (R22)
BASEMENT WALLS	3.52 ci (R20 ci) *	3.52 ci (R20 ci) *
* PROPOSED VALUES MAY BE SUBSTITUTED W/ 2.11+1.76ci (R12+R10ci)		
BELOW GRADE SLAB ENTIRE SURFACE > 600mm BELOW GRADE	-	-
EDGE OF BELOW GRADE SLAB ≤ 600mm BELOW GRADE	1.76 (R10)	1.76 (R10)
HEATED SLAB OR SLAB ≤ 600mm BELOW GRADE	1.76 (R10)	1.76 (R10)
WINDOWS & DOORS		
WINDOWS/SLIDING GLASS DOORS (MAX U-VALUE)	1.6	1.6
SKYLIGHTS (MAX. U-VALUE)	2.8	2.8
APPLIANCE EFFICIENCY		
SPACE HEATING EQUIP. (AFUE%)	96%	96%
HRV EFFICIENCY (%)	75%	75%
DHW HEATER (EF)	0.8	0.8

AREA CALCULATIONS	EL. 'A'	EL. 'B'
	STD. PLAN	STD. PLAN
GROUND FLOOR AREA	1812 sq. ft. (168.34 sq. m.)	1812 sq. ft. (168.34 sq. m.)
SECOND FLOOR AREA	1588.79 sq. ft. (147.60 sq. m.)	1552.16 sq. ft. (144.20 sq. m.)
SUBTOTAL	3401 sq. ft. (315.94 sq. m.)	3364 sq. ft. (312.54 sq. m.)
DEDUCT ALL OPEN AREAS	739.80 sq. ft. (68.73 sq. m.)	739.80 sq. ft. (68.73 sq. m.)
TOTAL NET AREA	2661 sq. ft. (247.21 sq. m.)	2624 sq. ft. (243.81 sq. m.)
FINISHED BASEMENT AREA	130.50 sq. ft. (12.12 sq. m.)	130.50 sq. ft. (12.12 sq. m.)
COVERAGE W/OUT PORCH	2190.02 sq. ft. (203.46 sq. m.)	2189.42 sq. ft. (203.40 sq. m.)
COVERAGE W/ PORCH	2247.77 sq. ft. (208.82 sq. m.)	2245.33 sq. ft. (208.60 sq. m.)
COVERAGE W/ OPT. LOGGIA	2453.77 sq. ft. (227.96 sq. m.)	2451.33 sq. ft. (227.74 sq. m.)

- 1 - TITLE PAGE
- 2 - BASEMENT PLAN EL 'A'
- 3 - GROUND FLOOR PLAN EL 'A'
- 4 - LOFT FLOOR PLAN EL 'A'
- 5 - PARTIAL PLANS EL 'B'
- 6 - FRONT ELEVATION EL 'A'
- 7 - LEFT SIDE ELEVATION EL 'A'
- 8 - RIGHT SIDE ELEVATION EL 'A'
- 9 - REAR ELEVATION 'A' & 'B'
- 10 - FRONT ELEVATION EL 'B'
- 11 - LEFT SIDE ELEVATION EL 'B'
- 12 - RIGHT SIDE ELEVATION EL 'B'
- 13 - CROSS SECTION 'A-A' & DETAILS
- 14 - CONSTRUCTION NOTES
- W1 - DECK CONDITIONS
- W2 - DECK CONDITIONS
- W3 - DECK DETAILS
- W4 - DECK DETAILS

WINDOW / WALL AREA CALCULATIONS	EL. 'A'	EL. 'A'	EL. 'A'	EL. 'A'
	STD. PLAN	WOD	LOO	WOB
GROSS WALL AREA	4175.97 sq. ft. (387.96 sq. m.)	4210.14 sq. ft. (391.13 sq. m.)	4306.23 sq. ft. (400.06 sq. m.)	4624.41 sq. ft. (429.62 sq. m.)
GROSS WINDOW AREA (INCL. GLASS DOORS & SKYLIGHTS)	365.88 sq. ft. (33.99 sq. m.)	364.21 sq. ft. (33.84 sq. m.)	404.21 sq. ft. (37.55 sq. m.)	466.71 sq. ft. (43.36 sq. m.)
TOTAL WINDOW %	8.76 %	8.65 %	9.39 %	10.09 %
	EL. 'B'	EL. 'B'	EL. 'B'	EL. 'B'
	STD. PLAN	WOD	LOO	WOB
	4175.97 sq. ft. (387.96 sq. m.)	4210.14 sq. ft. (391.13 sq. m.)	4306.23 sq. ft. (400.06 sq. m.)	4624.41 sq. ft. (429.62 sq. m.)
	353.31 sq. ft. (32.82 sq. m.)	351.65 sq. ft. (32.67 sq. m.)	391.65 sq. ft. (36.39 sq. m.)	454.15 sq. ft. (42.19 sq. m.)
	8.46 %	8.35 %	9.09 %	9.82 %

9. REVISED DESIGN AS PER CLIENT COMMENTS	2018/06/14	MC
8. REVISED AS PER ENG. COMMENTS	2018/05/31	MC
7. REVISED AS PER CLIENT COMMENTS	2018/05/14	OF
6. REVISED AS PER ENG. COMMENTS	2018/04/17	MC
5. REVISED AS PER CLIENT/ROOF MANUF. COMMENTS	2017/12/05	MC
4. REVISED AS PER FLOOR MANUF. LAYOUTS	2017/11/28	OF
3. REVISED AS PER ROOF MANUF. LAYOUTS	2017/11/16	MC
2. REVISED AS PER CLIENT COMMENTS	2017/11/03	OF
1. ISSUED FOR CLIENT REVIEW	2017/09/21	OF
REVISIONS		DATE (YYYYMMDD) BY

GOLDPARK
WORTH MORE™



THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION
Orin Fairbairn 20201
NAME SIGNATURE BCIN
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC. 19695

HUNT DESIGN ASSOCIATES INC.
www.huntdesign.ca

GOLDPARK HOMES - 217020
PINE VALLEY, VAUGHAN ONT.

Drawn By Checked By Scale File Number
JB OF 3/16"=1'-0" 217020WS4201

Page Number
1 of 14

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)


TITLE PAGE

UNIT 4201 - THE MAPLEWOOD
REV.2018/06/14

Figure 1: A schematic diagram of a 33'-0" long bridge deck. The diagram shows a top view of the bridge deck with various lane widths and offsets. The total length is 33'-0". The dimensions are as follows:

- Left offset: 10'-0"
- First lane width: 8'-2"
- Second offset: 10'-0"
- Second lane width: 9'-6"
- Third offset: 1'-0"
- Third lane width: 12'-6"
- Fourth offset: 1'-0"
- Fourth lane width: 14'-4"
- Right offset: 10'-0"

The total length of the deck is 33'-0".

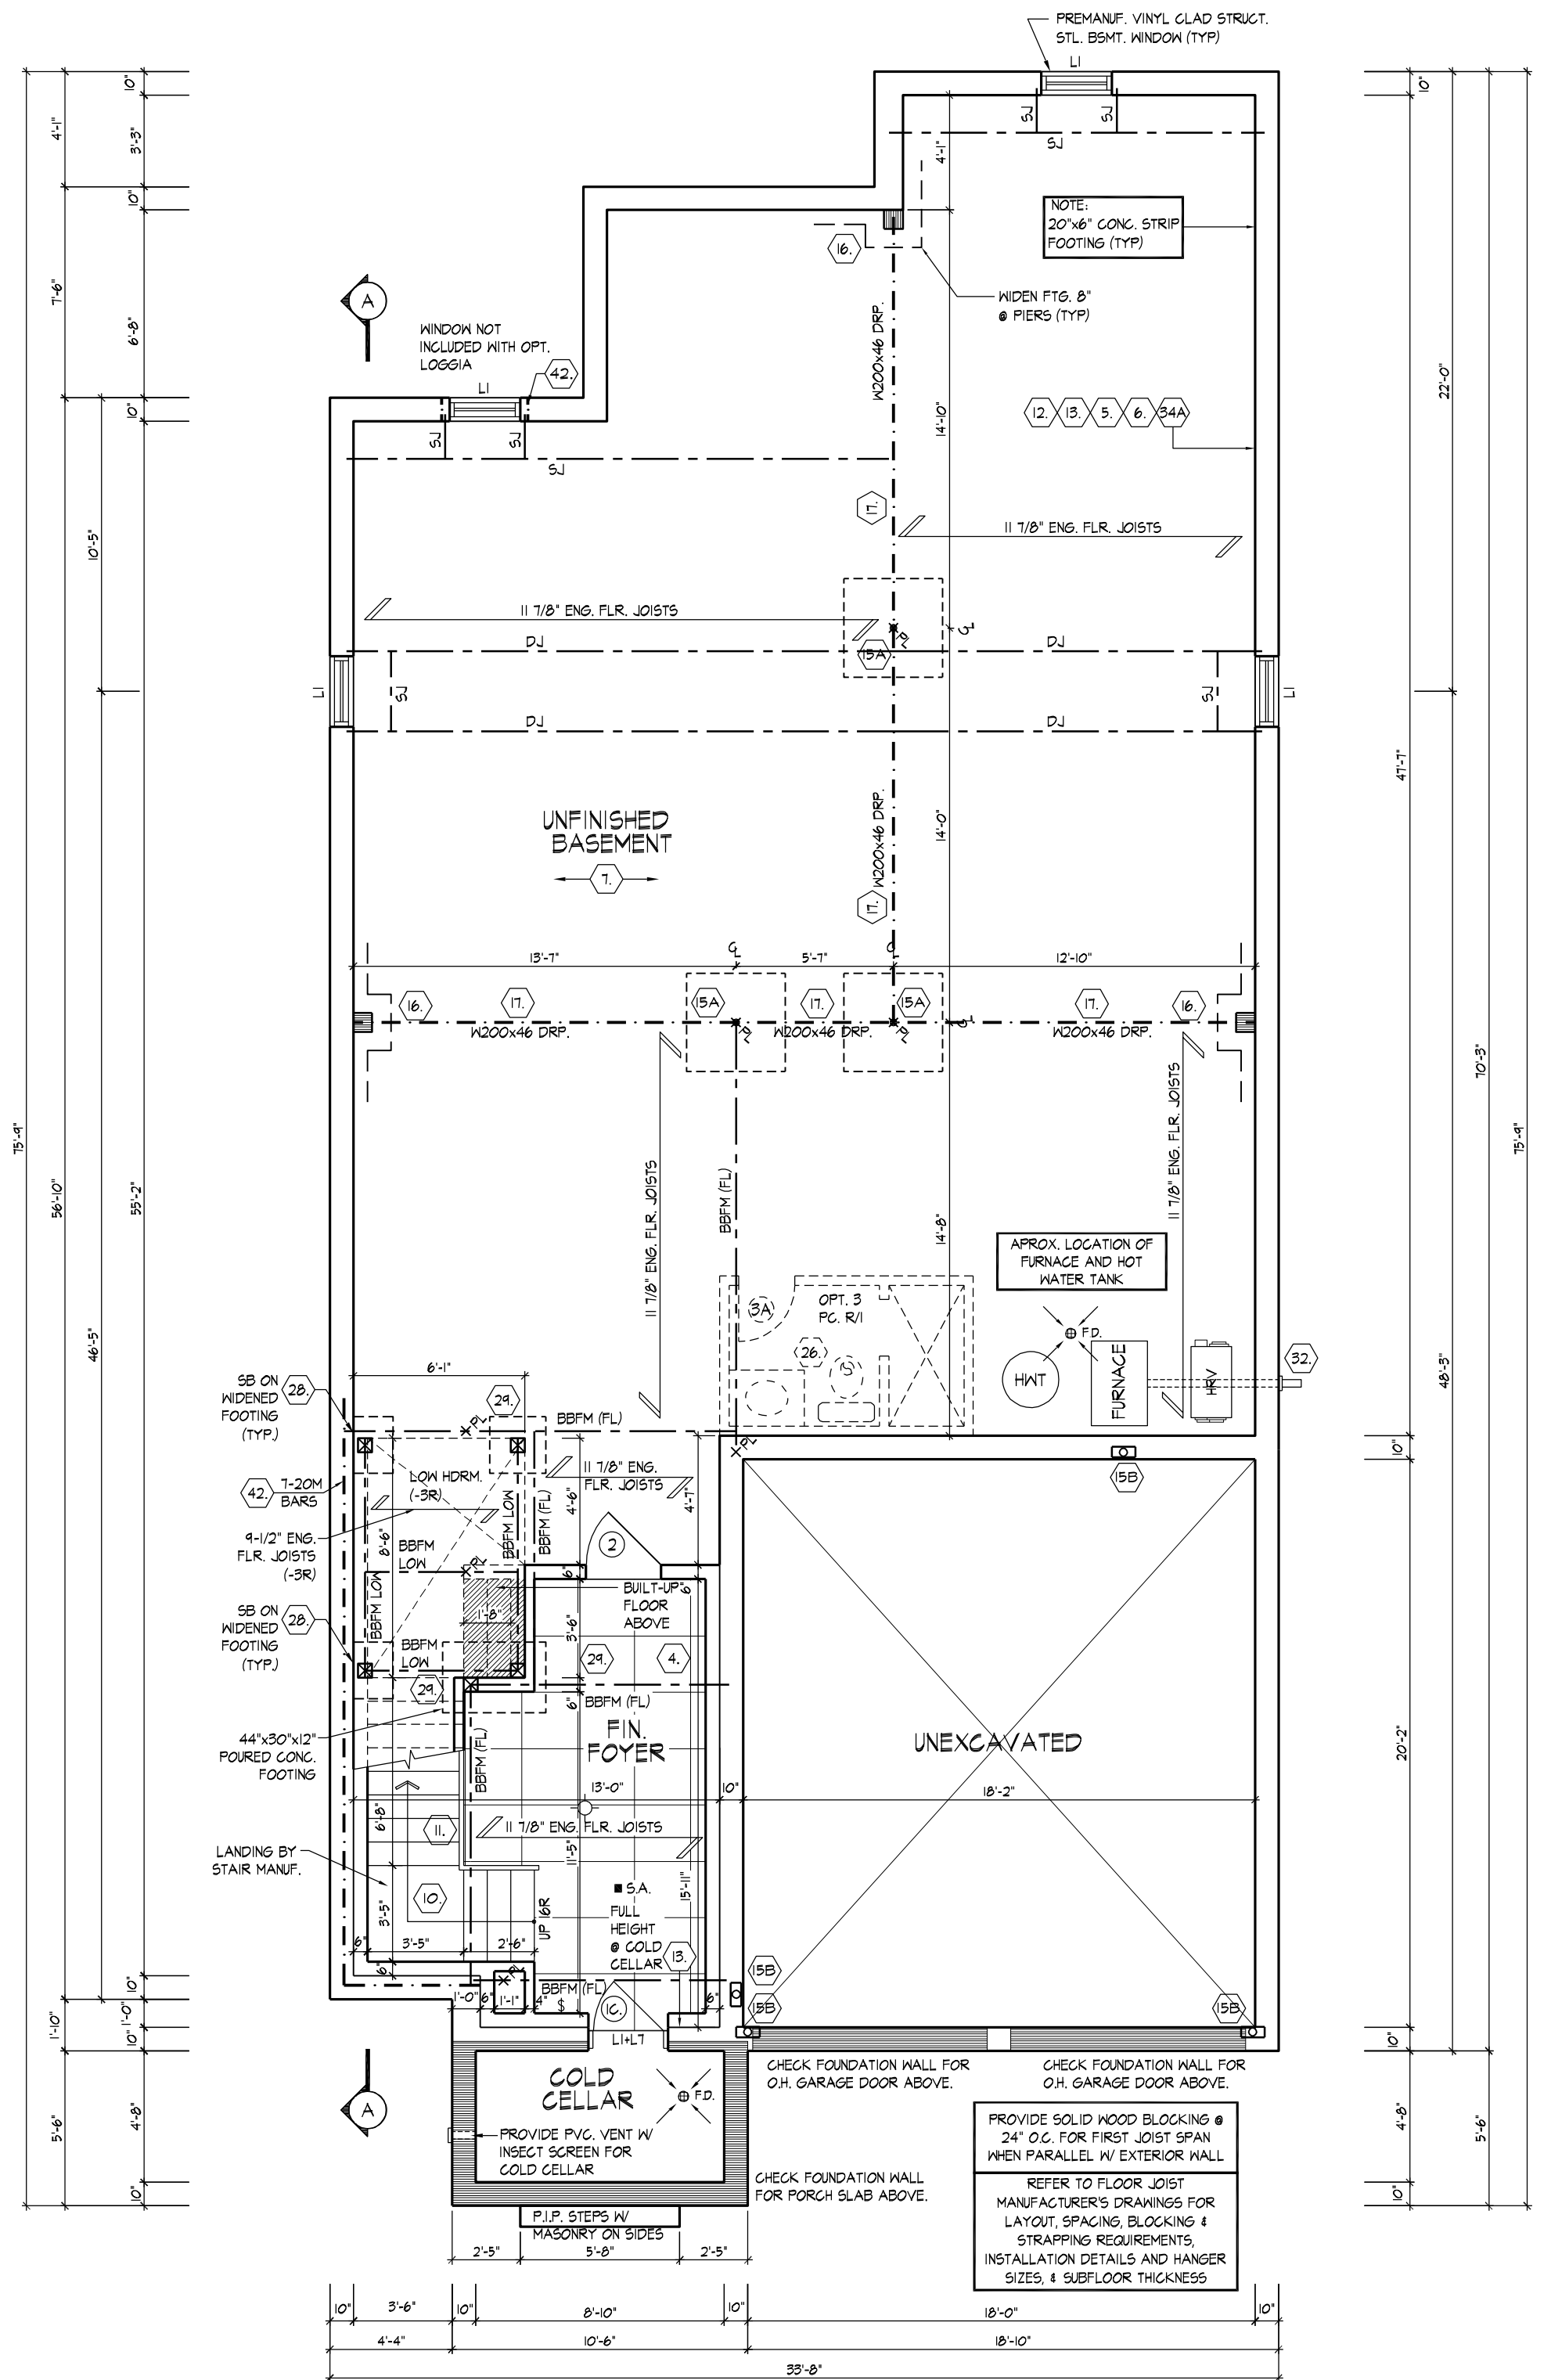

OFAIRBARN | TUE SEP 25/18 11:34 AM | K:\PROJECTS\2017\217020.GOLD\WORKING\SINGLES\42\217020WS4201-MAPLEWOOD.DWG

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VANUHAN.

[illegible]

HUNT  **GOLDPARK HOMES - 2170202**
PINE VALLEY, VAUGHAN ONT.

Drawn By _____ Created By _____ Scale _____


GOLDPARK HOMES - 217020 **UNIT 4201 - THE MAPLEWOOD**
PINE VALLEY, VAUGHAN ONT. **REV.2018/06/14**

Page Number
REV.2018/06/14
Page Number



This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.


This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

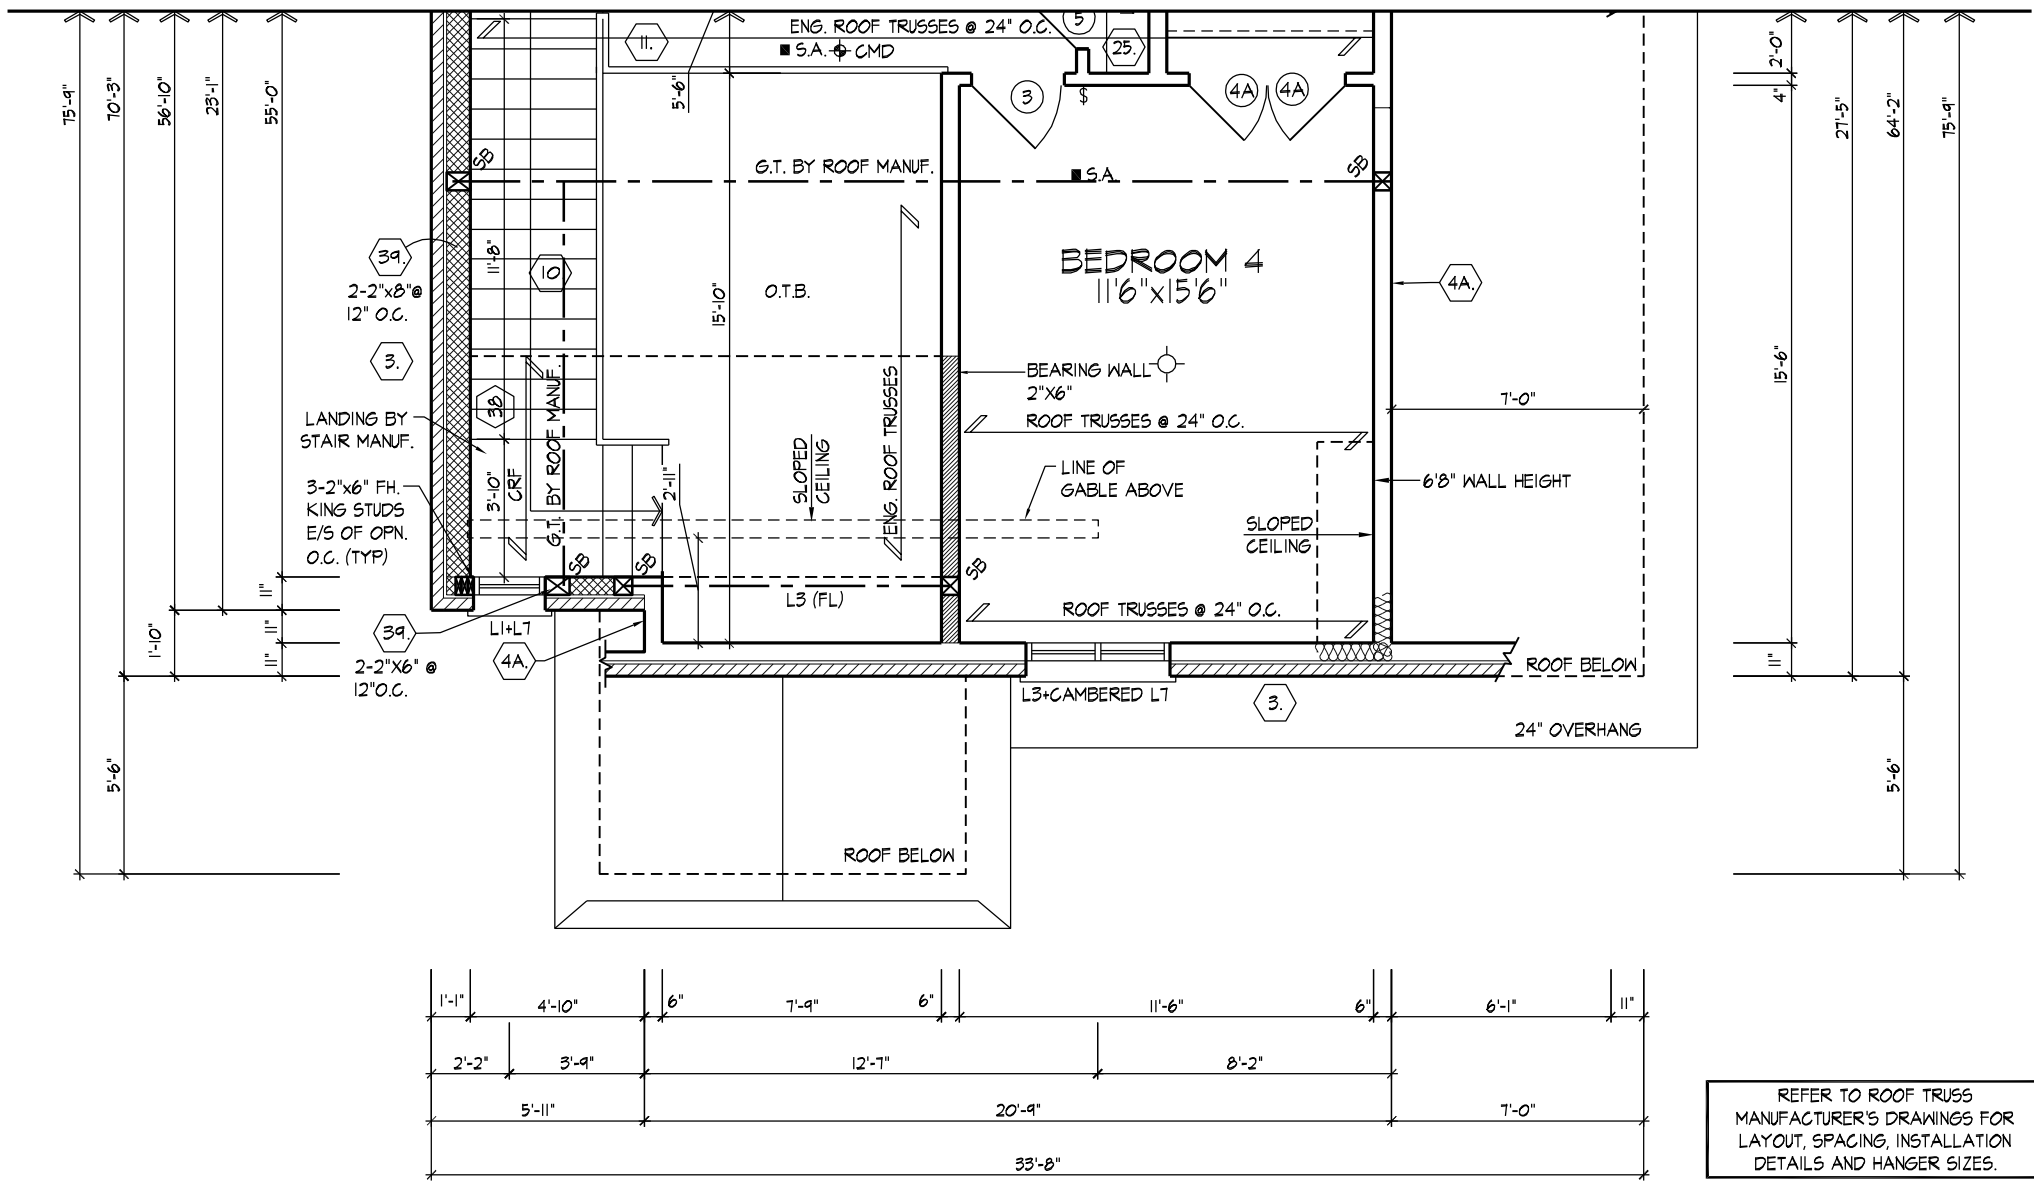

PART LOFT FLOOR PLAN EL. 'B'

REFER TO STANDARD PLAN FOR COMPLETE CONSTRUCTION NOTES & DIMENSIONS

REFER TO ROOF TRUSS MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, INSTALLATION DETAILS AND HANGER SIZES.

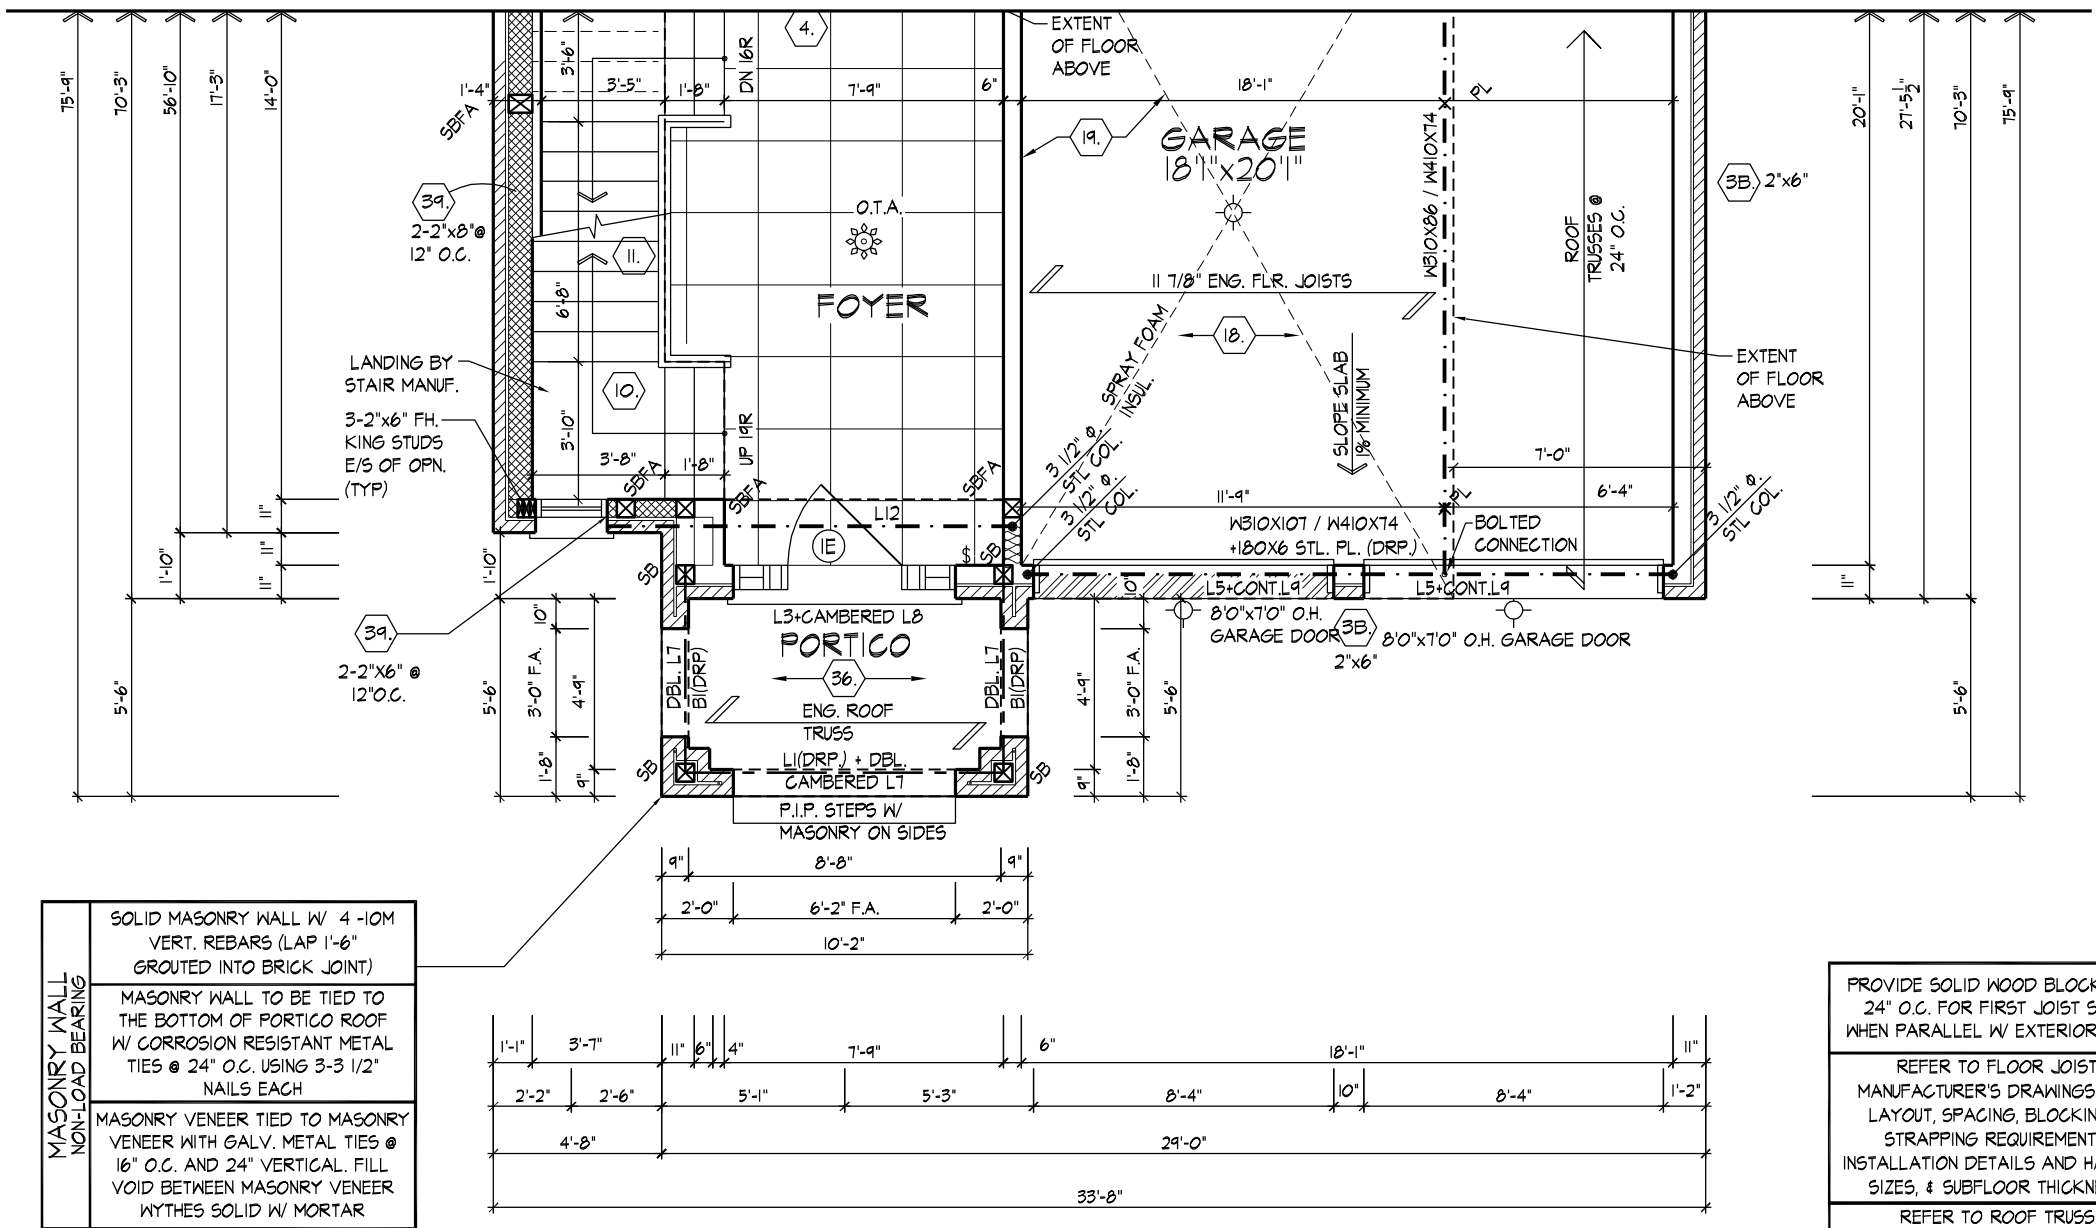


PART. GROUND FLOOR PLAN EL. 'B'

REFER TO STANDARD PLAN FOR COMPLETE CONSTRUCTION NOTES & DIMENSIONS

PROVIDE SOLID WOOD BLOCKING @ 24" O.C. FOR FIRST JOIST SPAN WHEN PARALLEL W/ EXTERIOR WALL.

REFER TO FLOOR JOIST MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, BLOCKING & STRAPPING REQUIREMENTS. INSTALLATION DETAILS AND HANGER SIZES, & SUBFLOOR THICKNESS.

REFER TO ROOF TRUSS MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, INSTALLATION DETAILS AND HANGER SIZES.

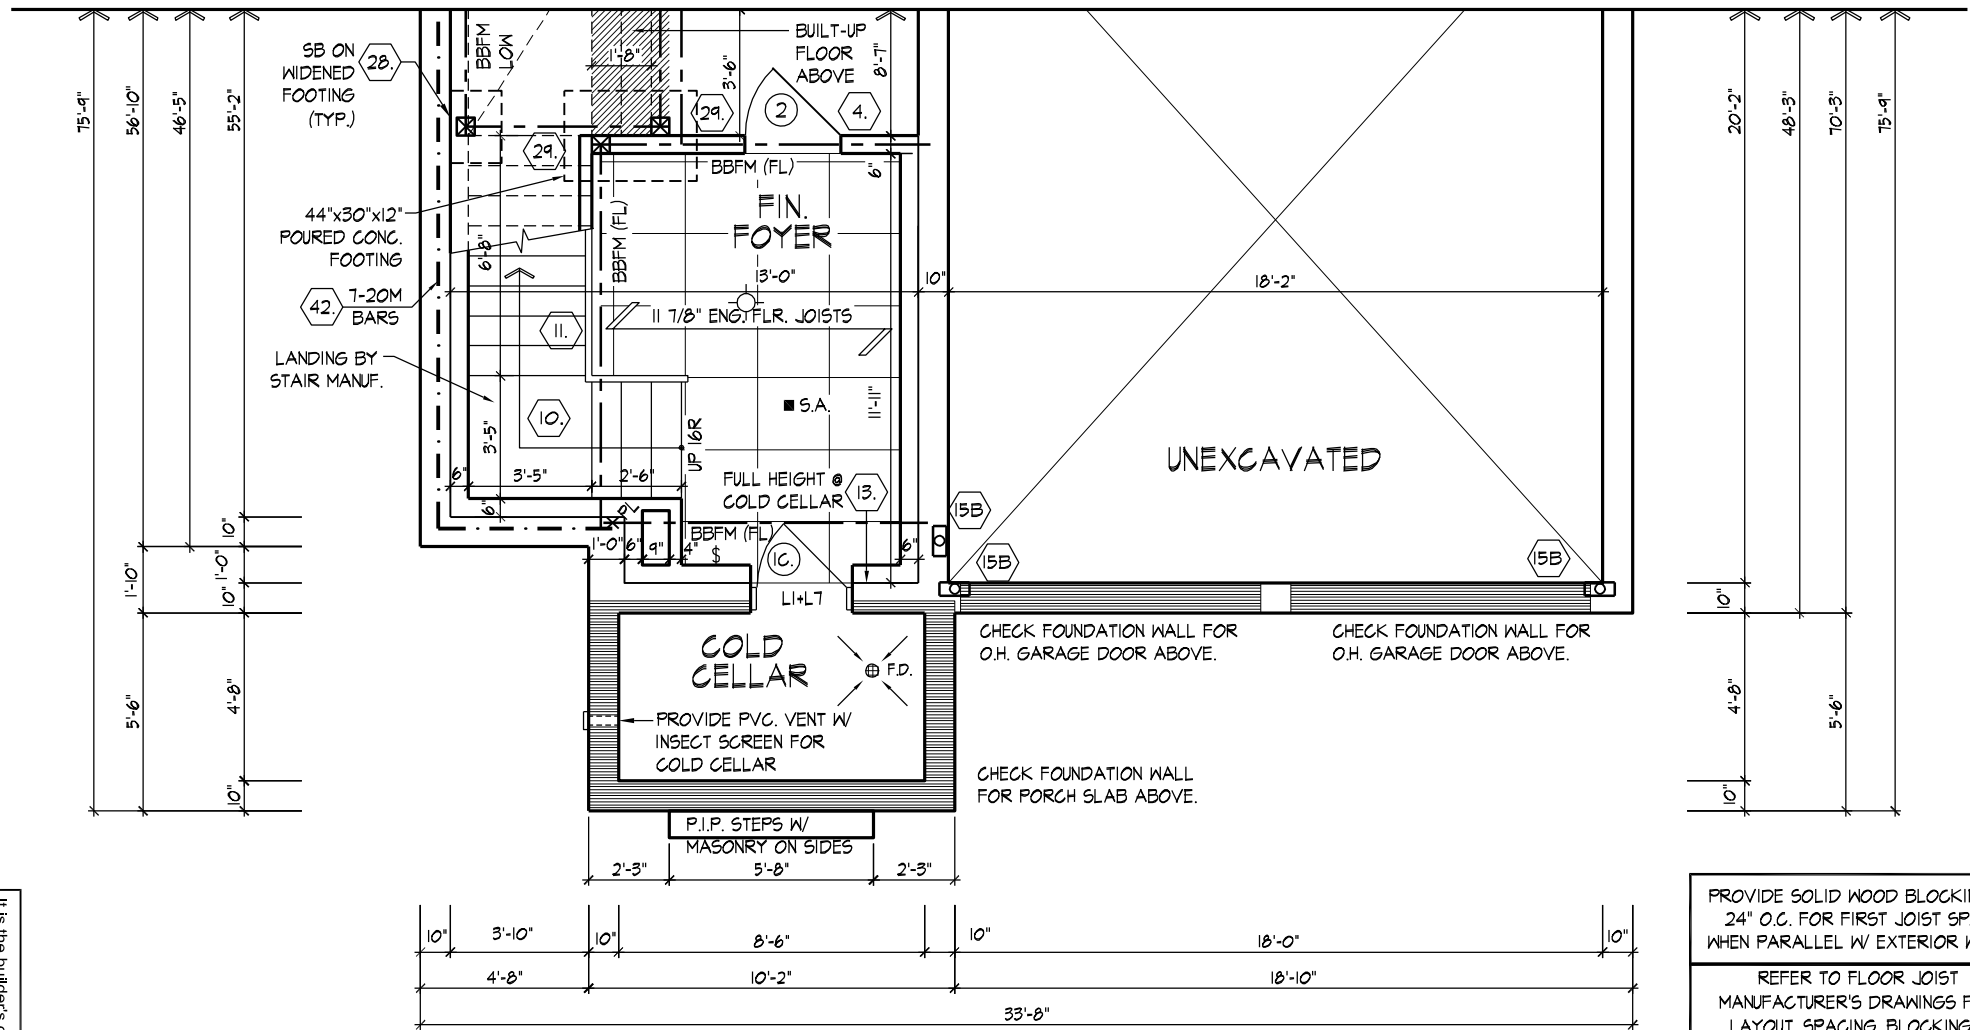

PART. BASEMENT PLAN EL. 'B'


REFER TO STANDARD PLAN FOR COMPLETE CONSTRUCTION NOTES & DIMENSIONS

PROVIDE SOLID WOOD BLOCKING @ 24" O.C. FOR FIRST JOIST SPAN WHEN PARALLEL W/ EXTERIOR WALL.


REFER TO FLOOR JOIST MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, BLOCKING & STRAPPING REQUIREMENTS. INSTALLATION DETAILS AND HANGER SIZES, & SUBFLOOR THICKNESS.

It is the builder's complete responsibility to ensure that all plans submitted for approval and all applicable regulations and requirements in the subdivision agreement. The Control of the project is the responsibility of the builder. The builder is responsible for ensuring that all plans submitted for approval and all applicable regulations and requirements in the subdivision agreement. The Control of the project is the responsibility of the builder. The builder is responsible for ensuring that all plans submitted for approval and all applicable regulations and requirements in the subdivision agreement. The Control of the project is the responsibility of the builder.


ROOF OVERHANGS TO BE 15"
UNLESS NOTED OTHERWISE

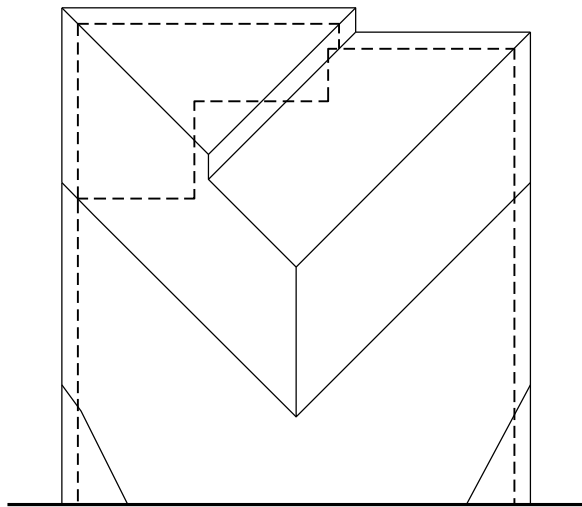

ROOF PLAN 'A' W/
OPT. LOGGIA
N.T.S.

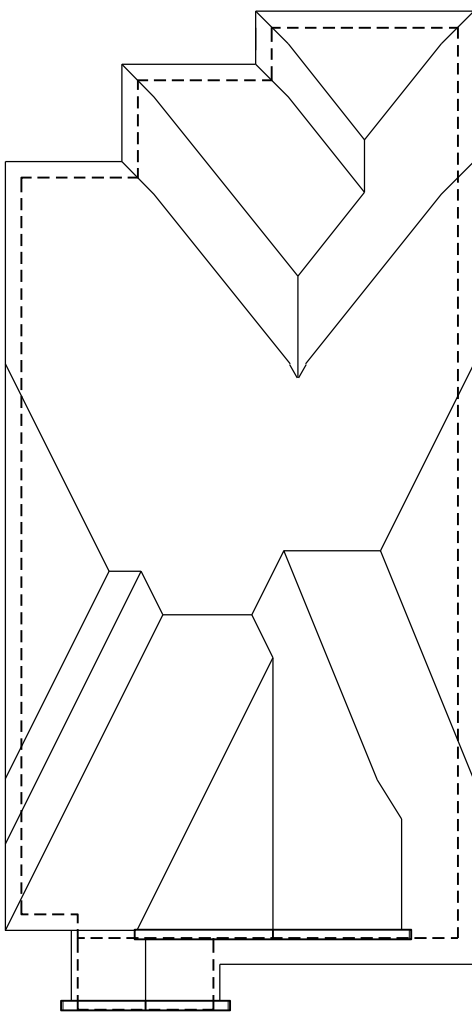

ROOF PLAN 'A'
N.T.S.

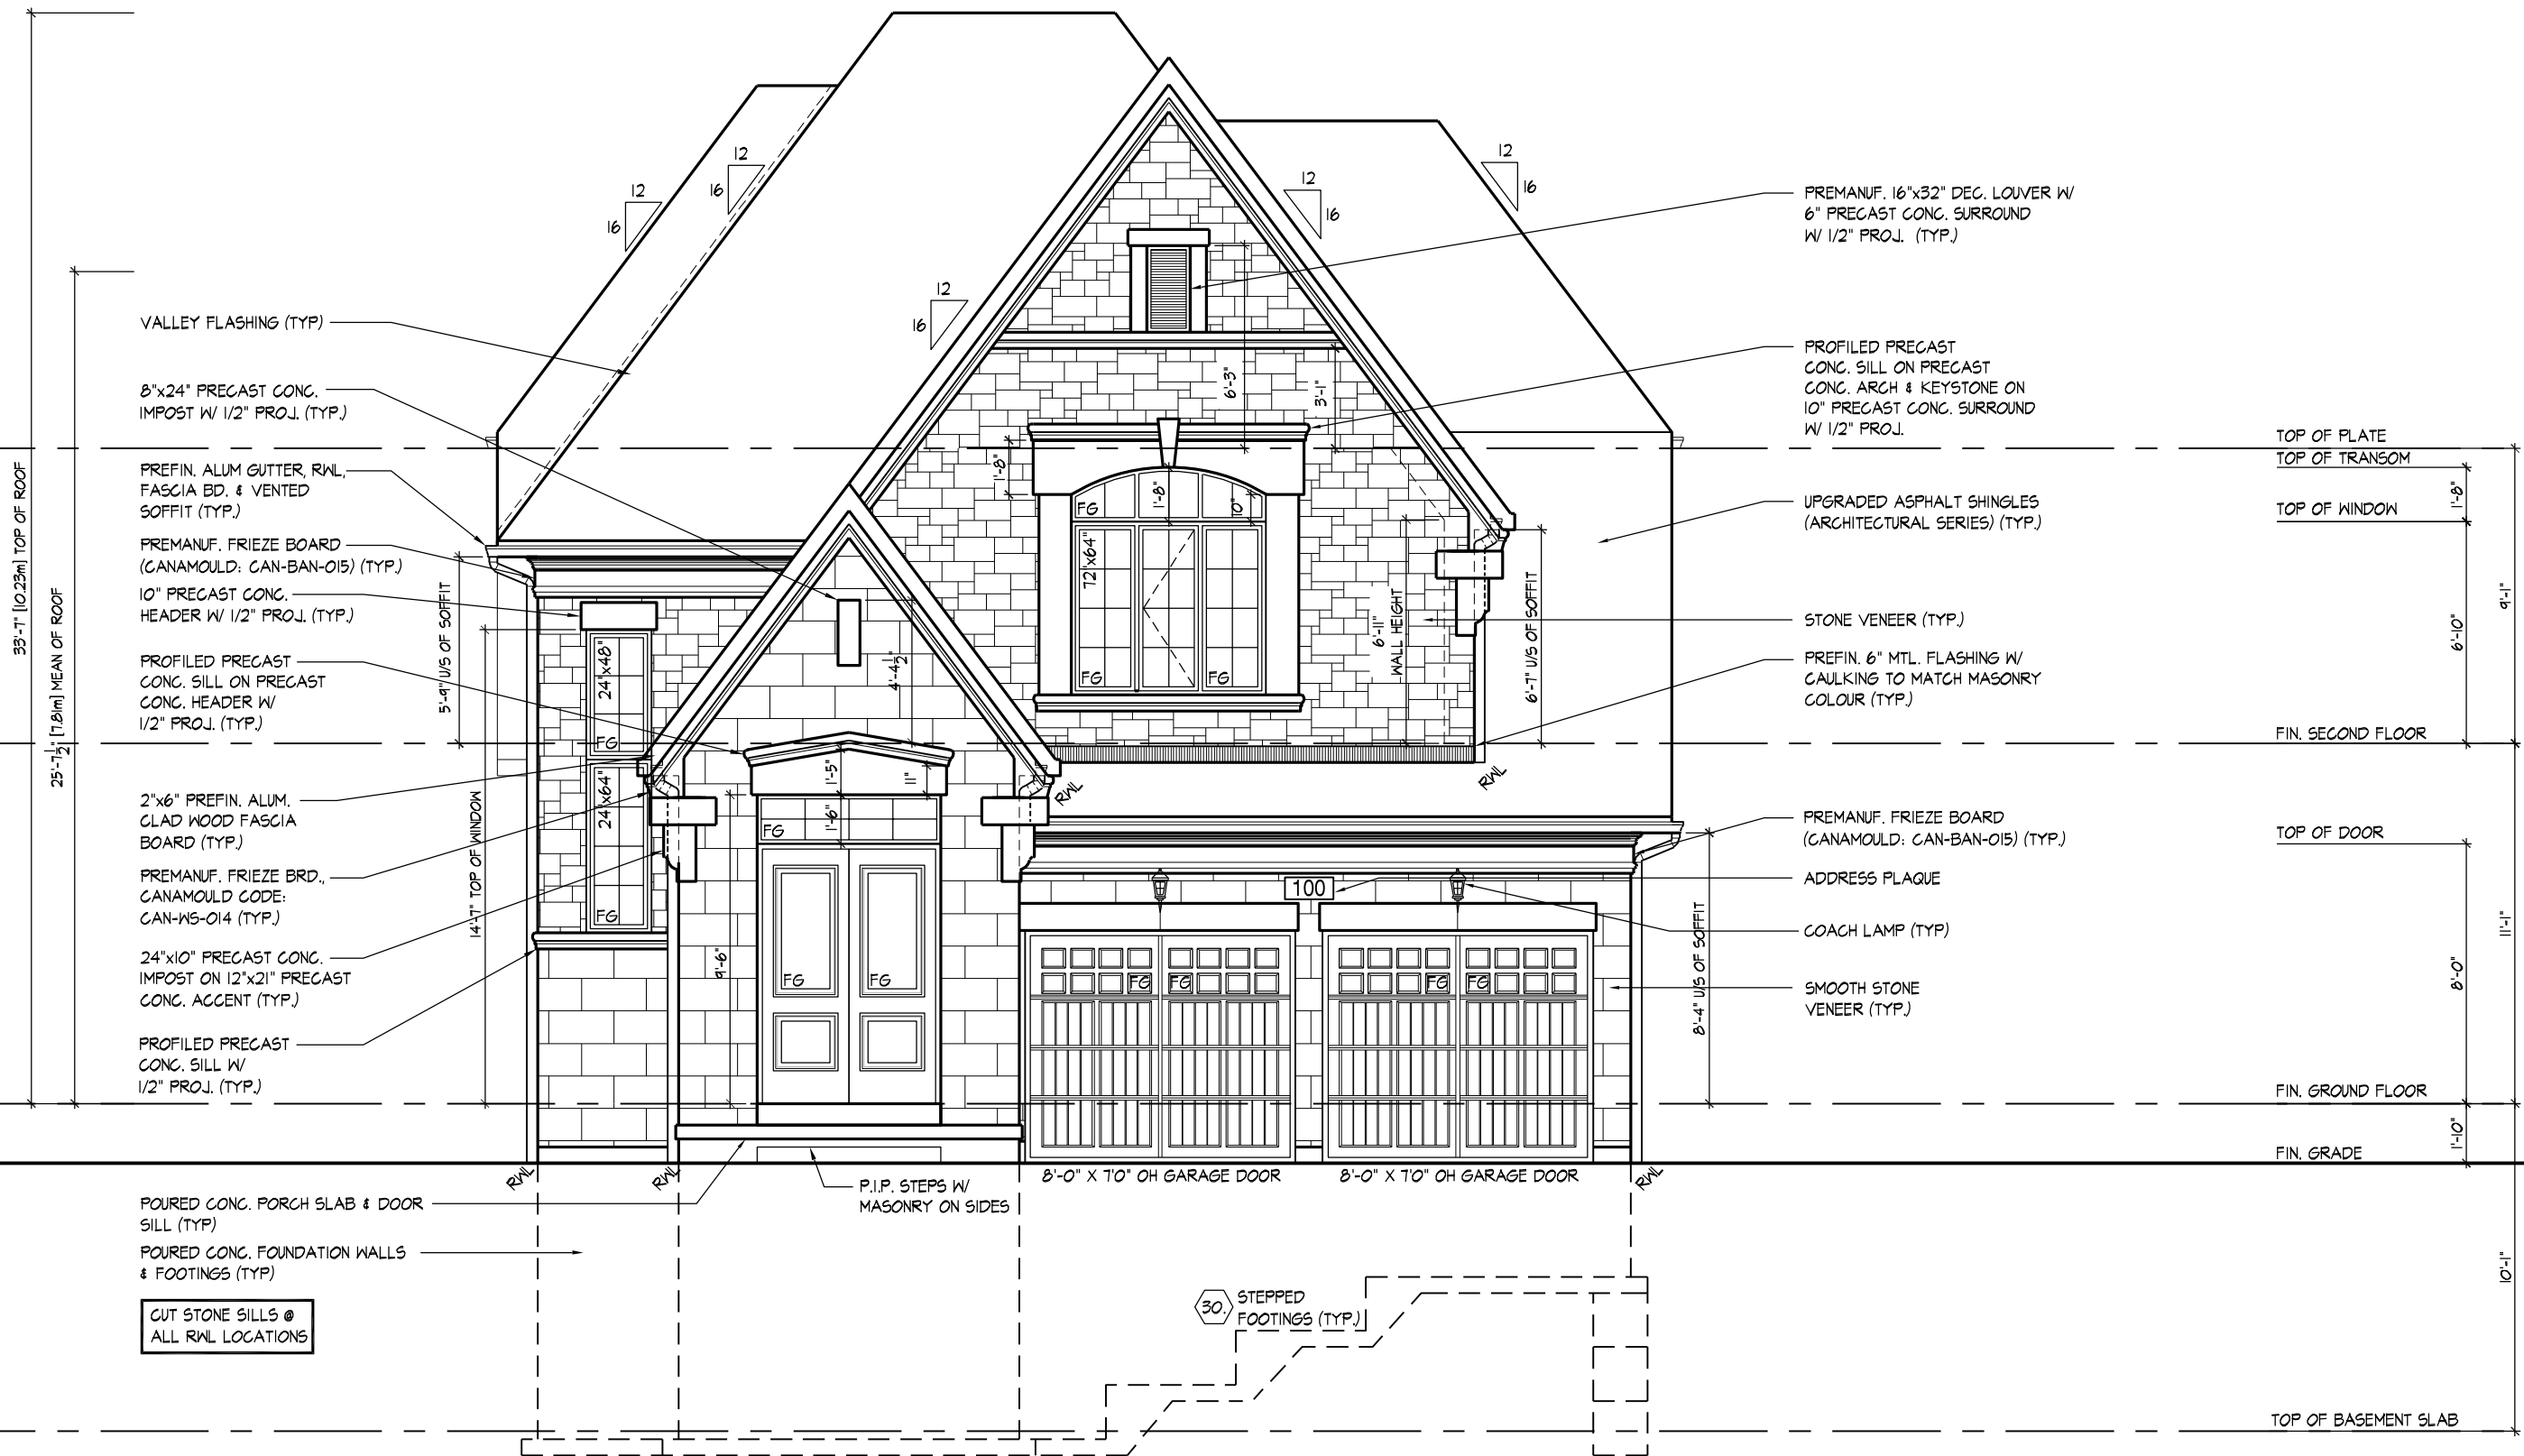

FRONT ELEVATION 'A'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

Olin Fairbairn 20201

NAME SIGNATURE BCIN

REGISTRATION INFORMATION

HUNT DESIGN ASSOCIATES INC. 19695

HUNT

DESIGN ASSOCIATES INC.

www.hunt-design.ca

GOLDPARK HOMES - 217020

PINE VALLEY, VAUGHAN ONT.

Drawn By: JB

Checked By: OF

Scale: 3/16"=1'-0"

8966 Woodbine Ave., Markham, ON L3R 0J7

T 905.737.5133 F 905.737.7326

FRONT ELEVATION EL 'A'


UNIT 4201 - THE MAPLEWOOD

REV.2018/06/14


File Number: 217020WS4201

Page Number: 6 of 14

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

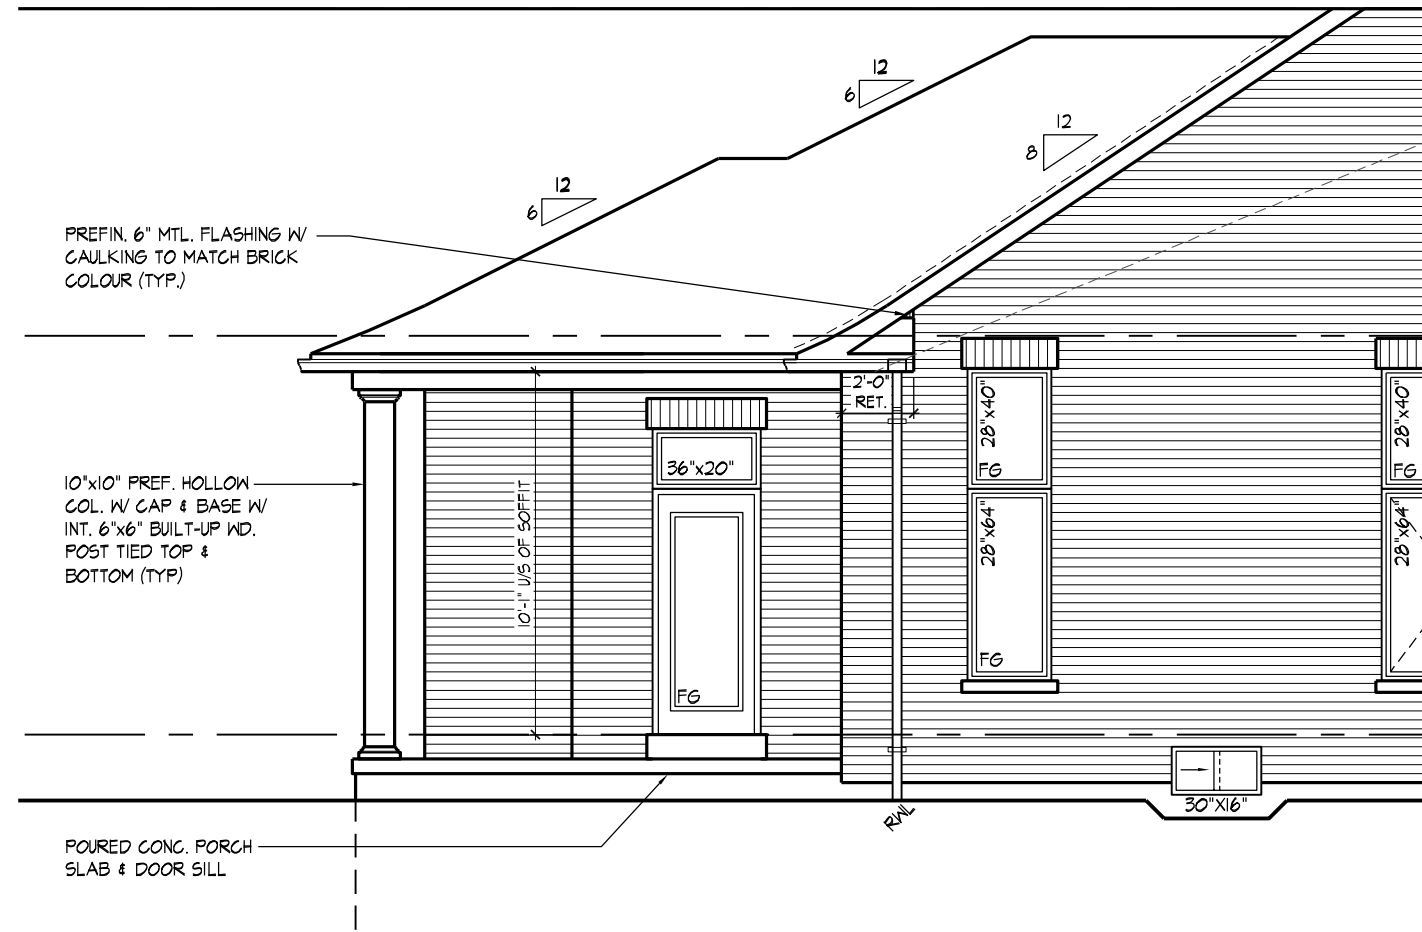

PART. LEFT SIDE ELEVATION 'A' W/ OPT. LOGGIA

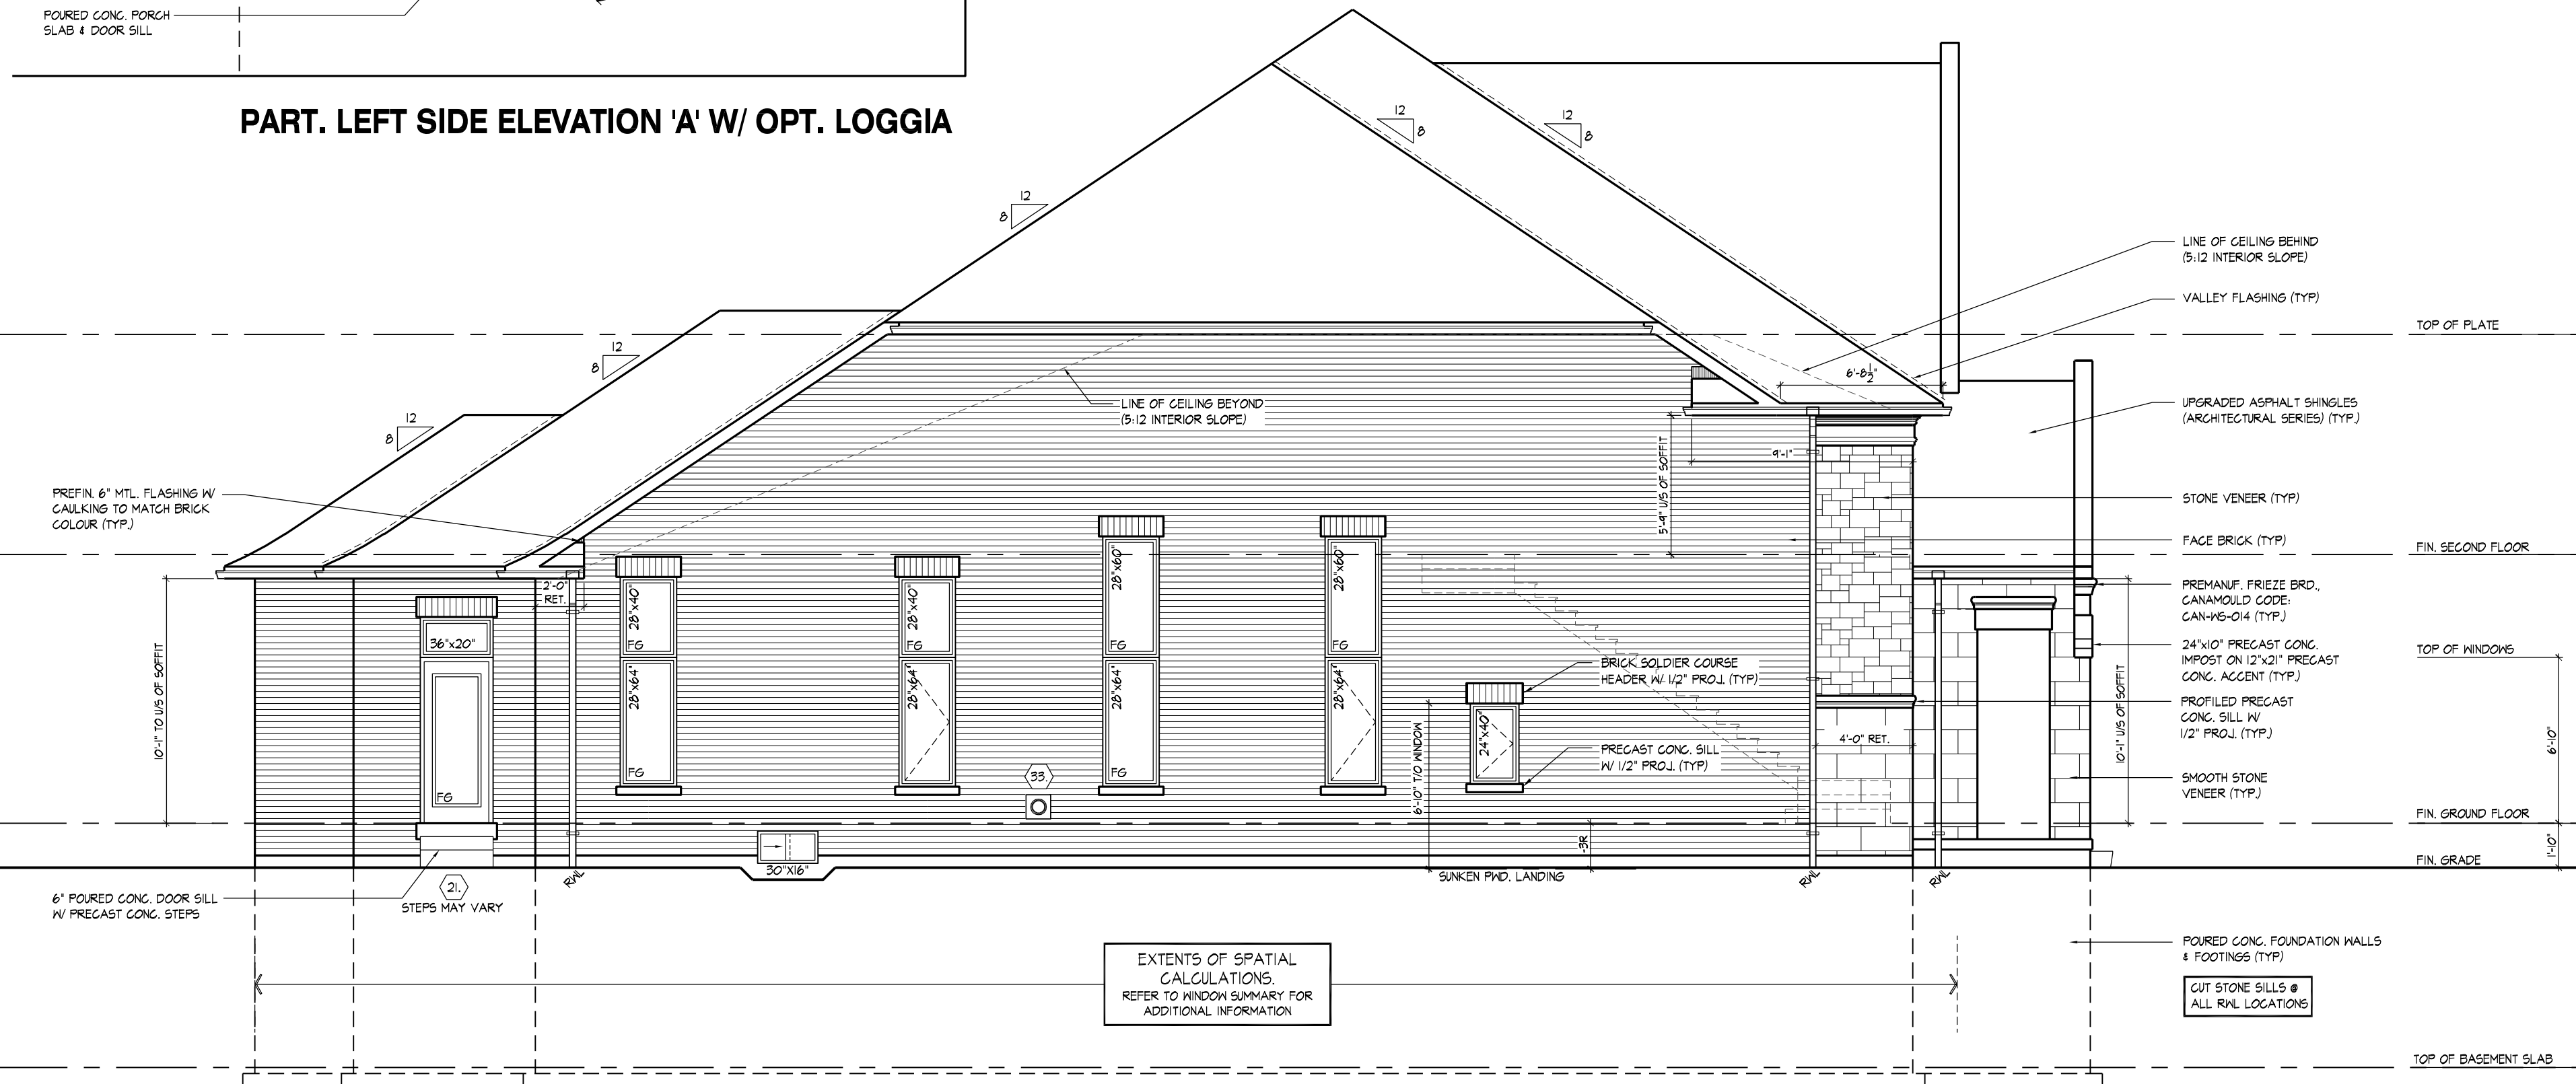

LEFT SIDE ELEVATION 'A'

REFER TO FRONT
ELEVATION FOR TYPICAL
NOTES & INFORMATION

ROOF OVERHANGS TO BE 15"
UNLESS NOTED OTHERWISE

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
LEFT SIDE ELEVATION A				
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)	
4	28"	64"		40.00
2	28"	40"		12.00
1	24"	40"		5.00
1	30"	16"		2.17
1	36"	20"		3.56
2	28"	60"		18.87
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
0	0"	0"		0.00
1	DOOR	8.19		9.19
0	ARCH	0.00		0.00
0	ARCH	0.00		0.00
0	ARCH	0.00		0.00
SPATIAL CALCULATION				
EXPOSING BUILDING	1297.45	S.F.		
FACE AREA	120.54	S.M.		
PORTION WALL AREA	1297.45	S.F.		
PORTION WALL AREA	120.54	S.M.		
LIMITING DISTANCE	7	1.2 m		
MAX. % OPENINGS		%		
OPENINGS ALLOWED	90.82	S.F.		
OPENINGS PROVIDED	90.98	S.F.		
ADDITIONAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION
Otin Fairbairn 20201
NAME
DESIGN ASSOCIATES INC.
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC. 19695

HUNT
DESIGN ASSOCIATES INC.
www.hunt-design.ca

GOLDPARK HOMES - 217020
PINE VALLEY, VAUGHAN ONT.

Down By JB OF 3/16"=1'-0"

8966 Woodbine Ave., Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326


LEFT SIDE ELEVATION EL 'A'
UNIT 4201 - THE MAPLEWOOD
REV.2018/06/14

File Number 217020WS4201 Page Number 7 of 14


All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission. H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.

ROOF OVERHANGS TO BE 15'
UNLESS NOTED OTHERWISE

WINDOW SCHEDULE				
PER O.B.C. TABLE 8/10.15.14				
RIGHT SIDE ELEVATION A				
QUAN.	WIDTH	HEIGHT	WINDOW / DOOR FRAME SIZE (S.F.)	GLAZED AREA (S.F.)
1	48" 50"	50"	15.88	
1	60" 50"	50"	17.11	
1	60" 64"	64"	23.33	
1	50" 16"	16"	2.17	
0	0" 0"	0"	0.00	
0	0" 0"	0"	0.00	
0	0" 0"	0"	0.00	
0	0" 0"	0"	0.00	
0	0" 0"	0"	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
0	ARCH	0.00	0.00	
SPATIAL CALCULATION				
EXPOSING BUILDING FACE AREA		1297.45	S.F.	
PORTION WALL AREA		1297.45	S.F.	
LIMITING DISTANCE		120.54	S.F.	
MAX. % OPENINGS		7	%	
OPENINGS ALLOWED		90.82	S.F.	
OPENINGS PROVIDED		35.53	S.F.	
DOOR SCHEDULE				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER				

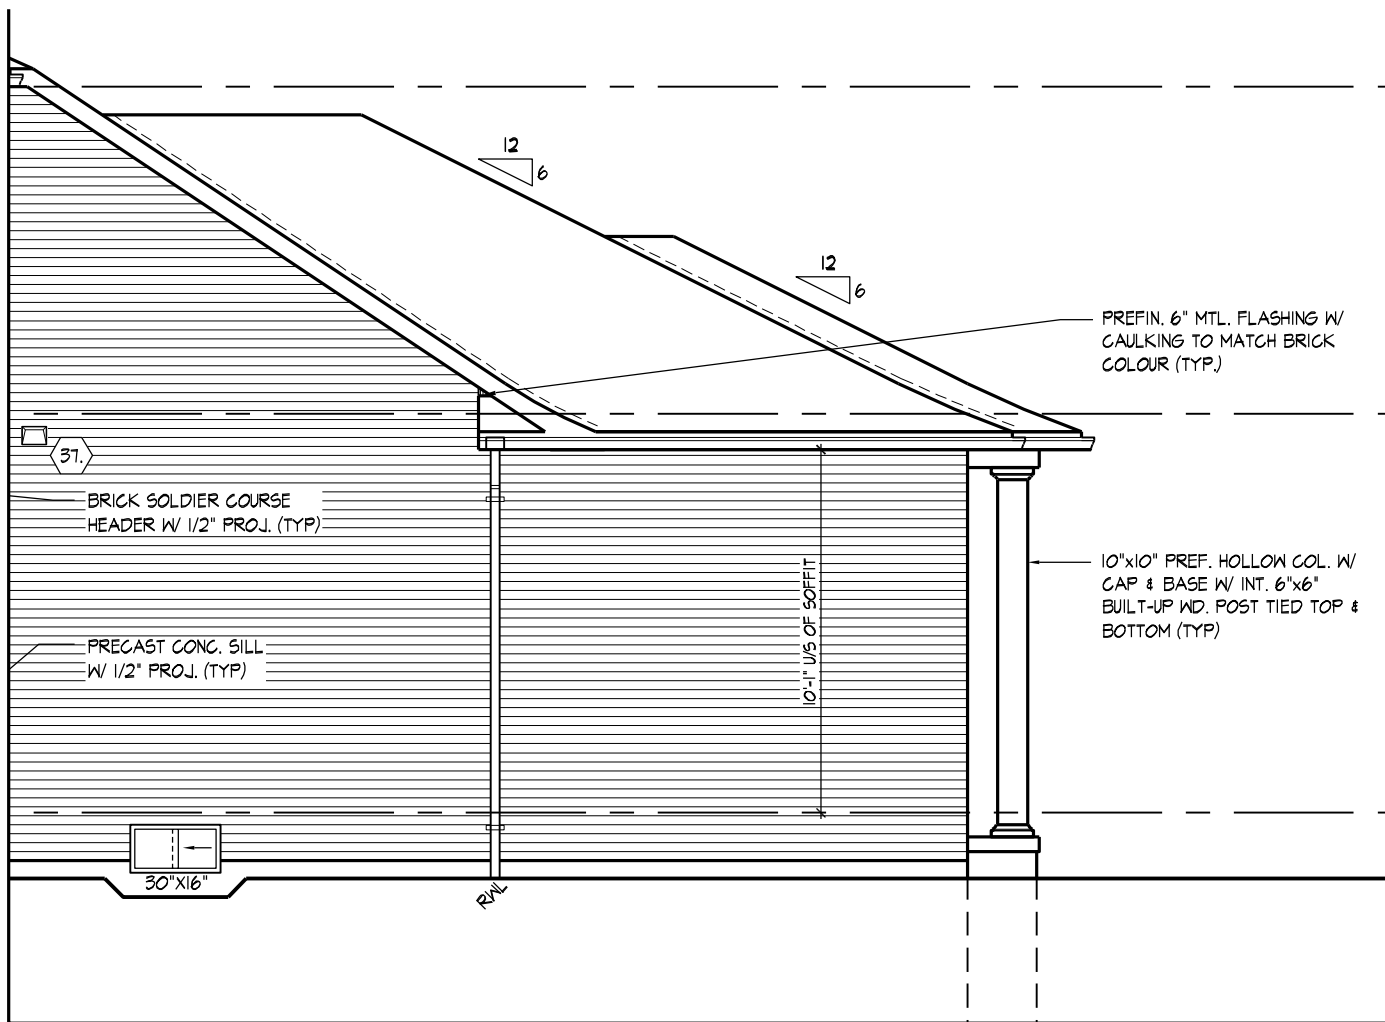

PART. RIGHT SIDE ELEVATION 'A' W/ OPT. LOGGIA

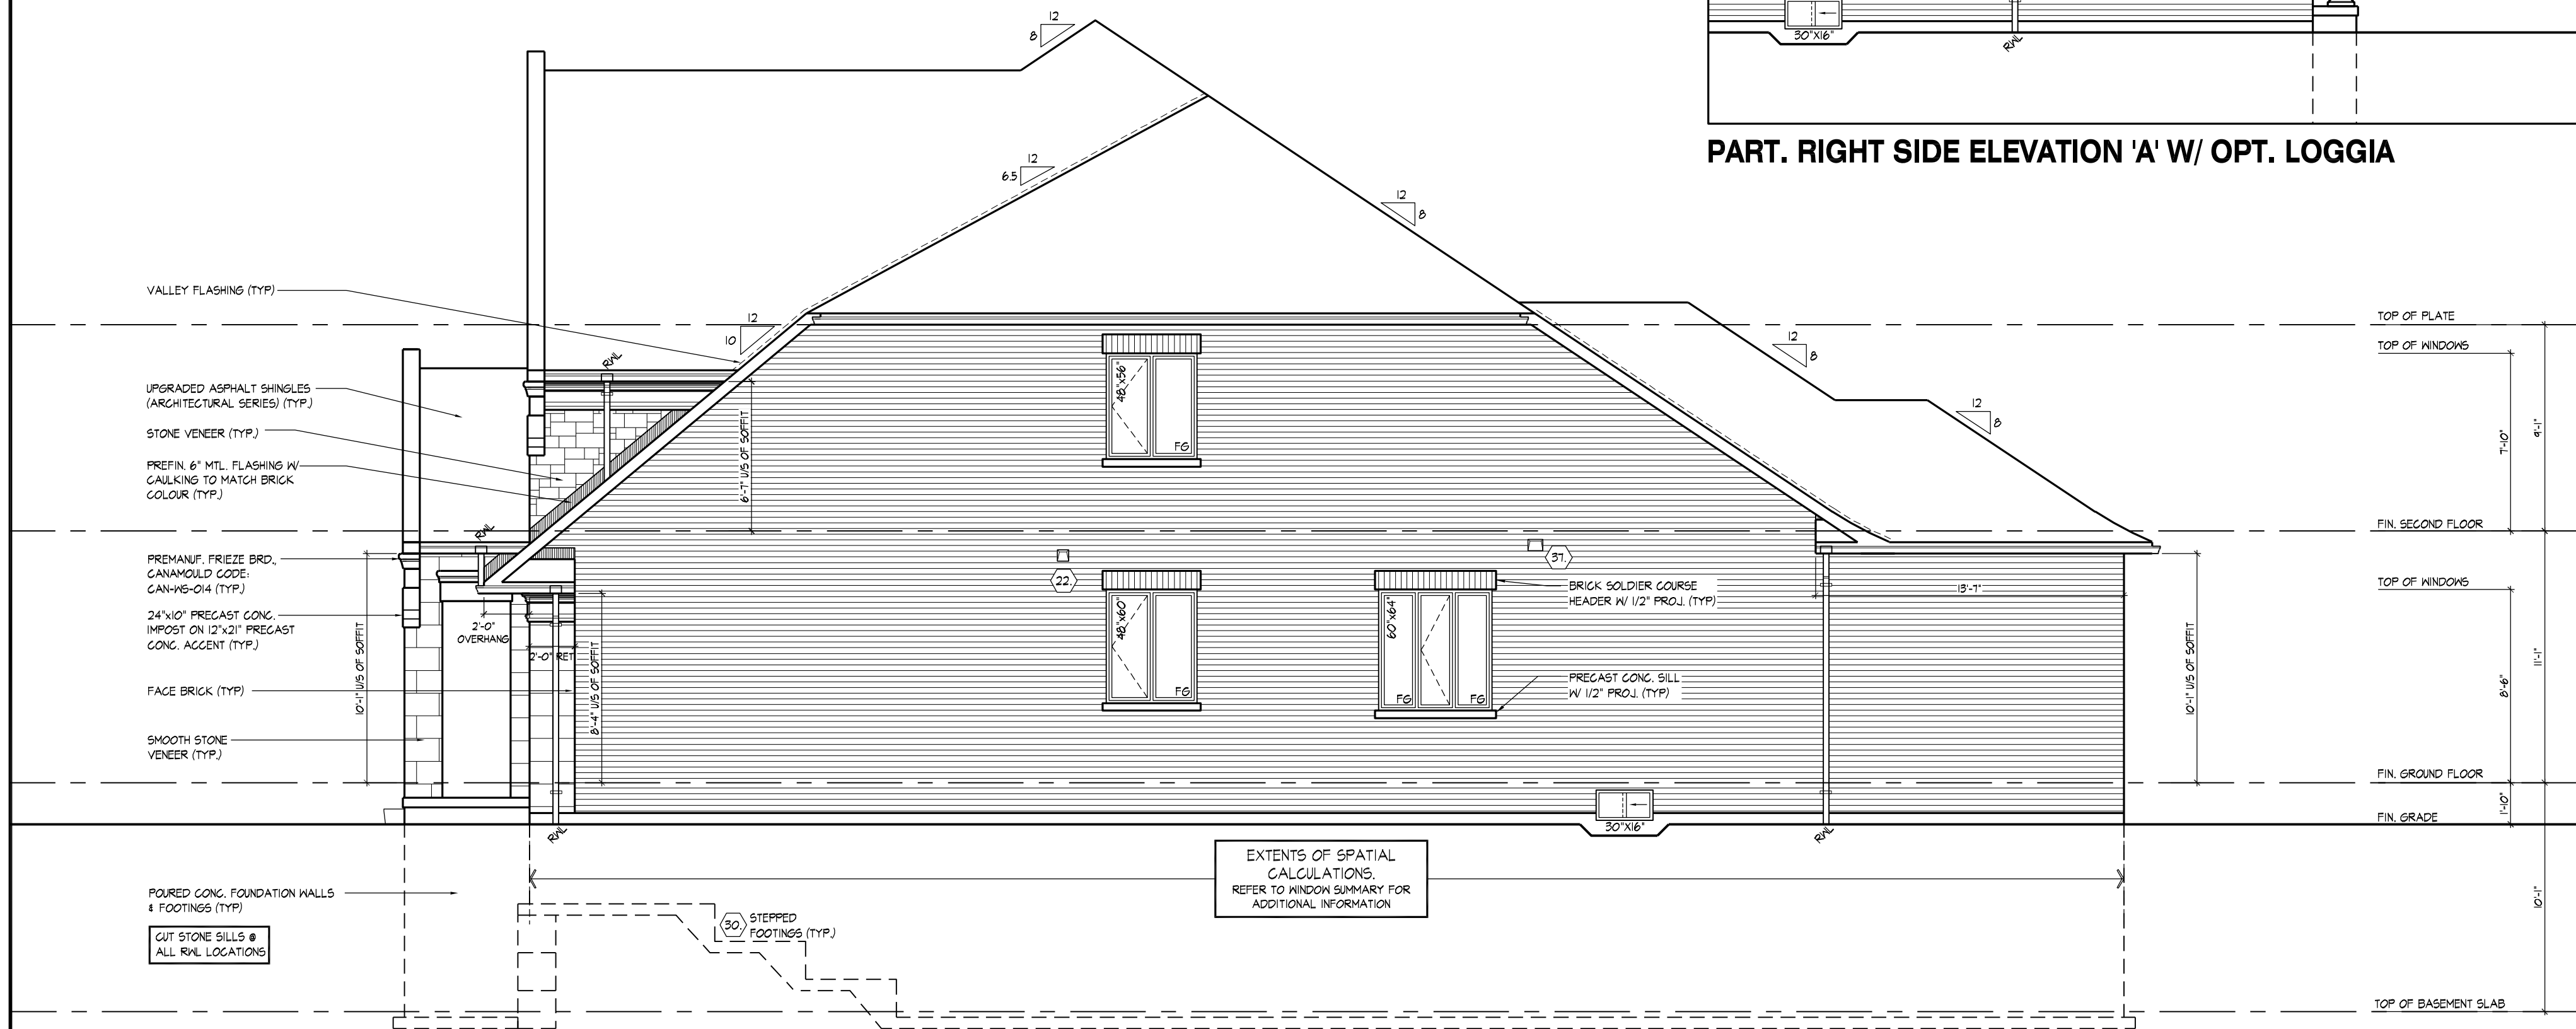

RIGHT SIDE ELEVATION 'A'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

Orin Fairbairn	201
NAME	SIGNATURE
REGISTRATION INFORMATION	
HUNT DESIGN ASSOCIATES INC.	191

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

HUNT 
DESIGN ASSOCIATES INC.
www.huntdesign.ca

GOLDPARK HOMES - 217020
PINE VALLEY, VAUGHAN ONT.

Drawn By
JB

Checked By
OF


Scale
3/16"=1'-0"

RIGHT SIDE ELEVATION EL 'A'
UNIT 4201 - THE MAPLEWOOD
REV.2018/06/14


File Number: 217020WS4201 Page Number: 8 of 14

REFER TO FRONT
ELEVATION FOR TYPICAL
NOTES & INFORMATION

ROOF OVERHANGS TO BE 15"
UNLESS NOTED OTHERWISE

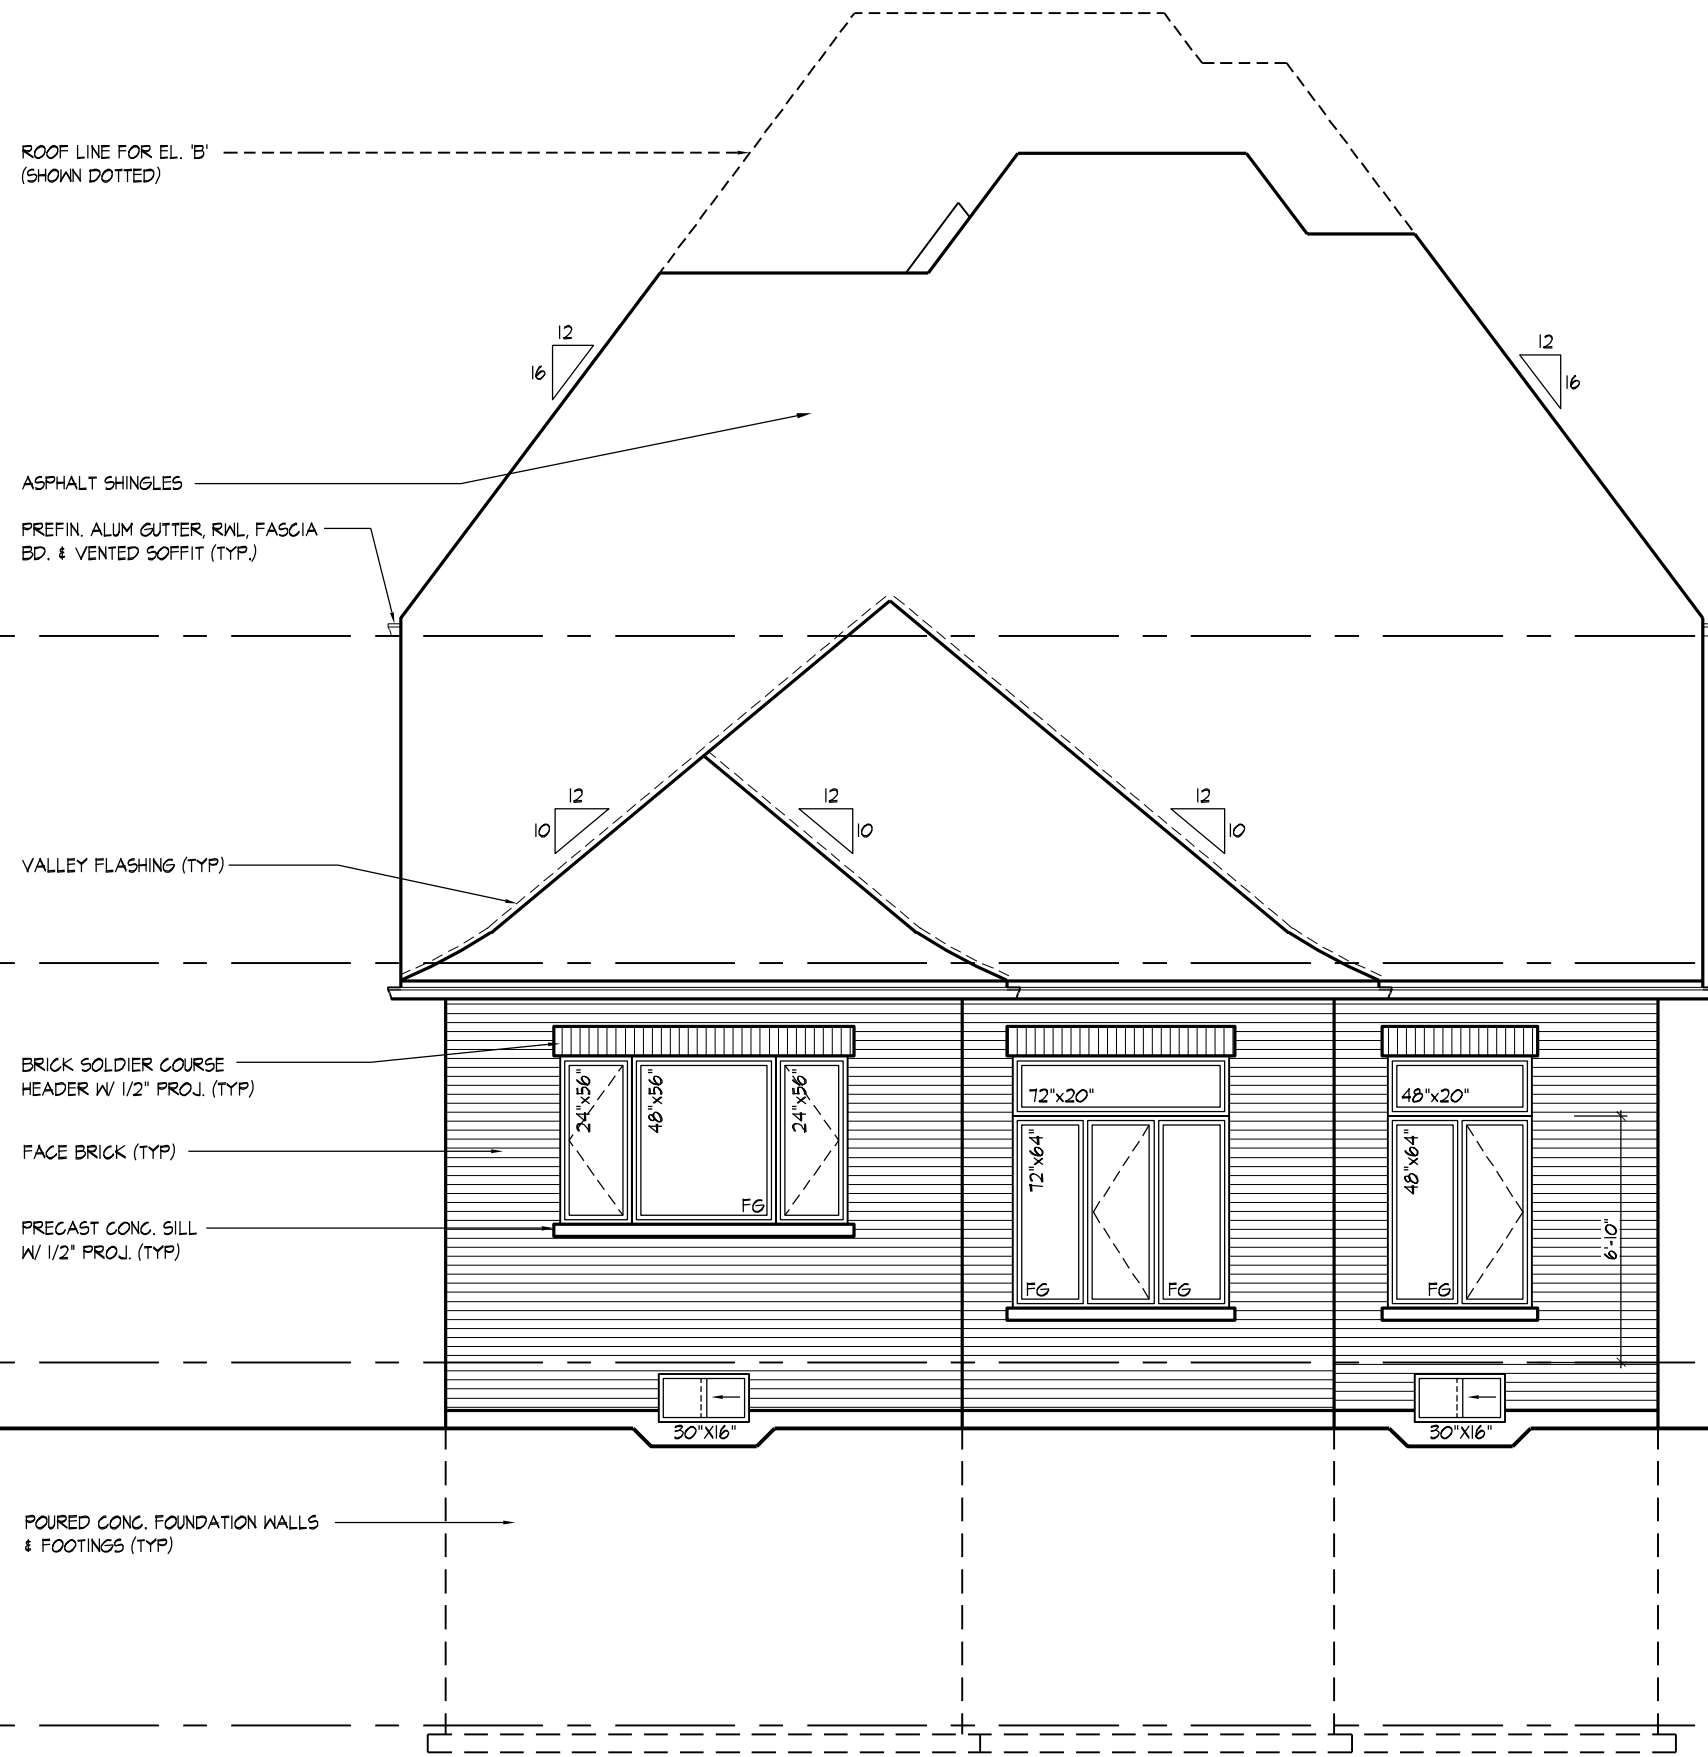

REAR ELEVATION 'A' & 'B'

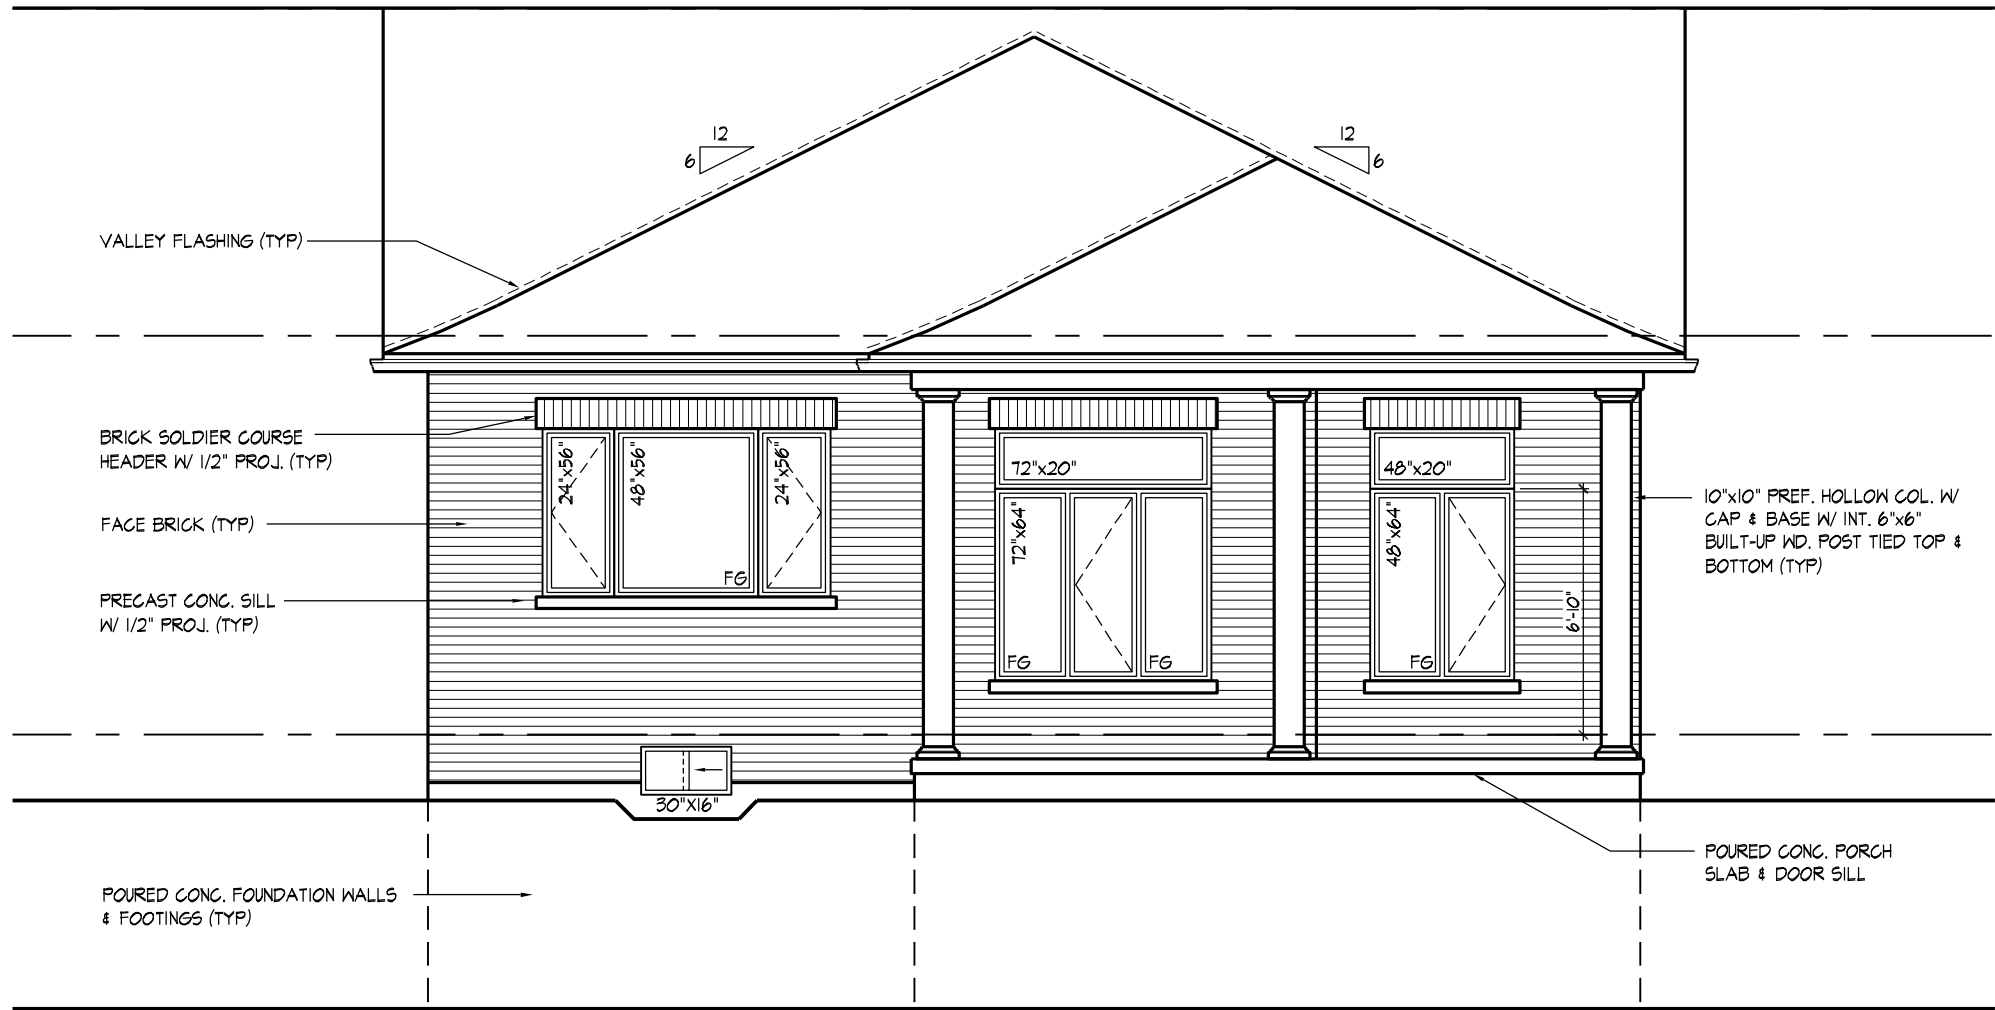

PART. REAR ELEVATION 'A' & 'B' W/ OPT. LOGGIA

WINDOW SUMMARY			
PER O.B.C. TABLE 9.10.15.4			
REAR ELEVATION A & B			
QTY.	WIDTH	HEIGHT	WINDOW / DOOR FRAME SIZE (S.F.)
2	24"	56"	14.44
1	48"	56"	15.89
1	72"	64"	28.33
1	72"	20"	7.56
1	48"	64"	18.33
1	48"	20"	4.89
2	30"	16"	4.33
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
SPATIAL CALCULATION			
EXPOSING BUILDING	740.67	S.F.	
FACE AREA	68.81	S.M.	
PORTION WALL AREA	740.67	S.F.	
LIMITING DISTANCE	68.81	S.M.	
MAX. % OPENINGS	50.50	%	
OPENINGS ALLOWED	374.04	S.F.	
OPENINGS PROVIDED	93.79	S.F.	
ADDITIONAL NOTES			
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER			

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

Otin Fairbairn 20201

NAME SIGNATURE

REGISTRATION INFORMATION BCIN

HUNT DESIGN ASSOCIATES INC. 19695

HUNT

DESIGN ASSOCIATES INC.

www.huntdesign.ca

GOLDPARK HOMES - 217020

PINE VALLEY, VAUGHAN ONT.

Drawn By Checked By Scale

JB OF 3/16"=1'-0"

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

REAR ELEVATION 'A' & 'B'

UNIT 4201 - THE MAPLEWOOD


REV.2018/06/14

File Number Page Number


217020WS4201 9 of 14

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)


ROOF OVERHANGS TO BE 15"
UNLESS NOTED OTHERWISE

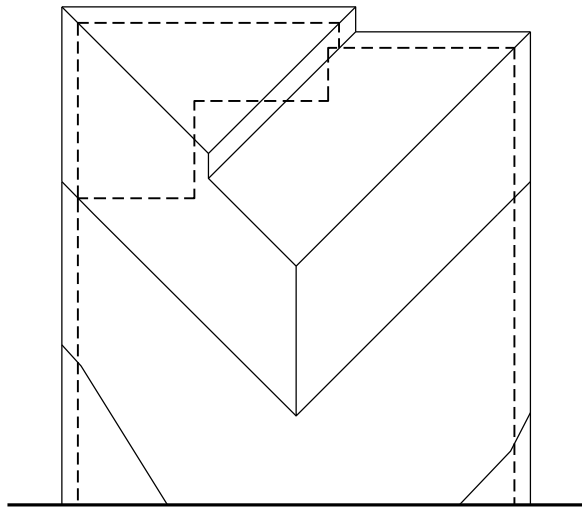

ROOF PLAN 'B' W/
OPT. LOGGIA
N.T.S.

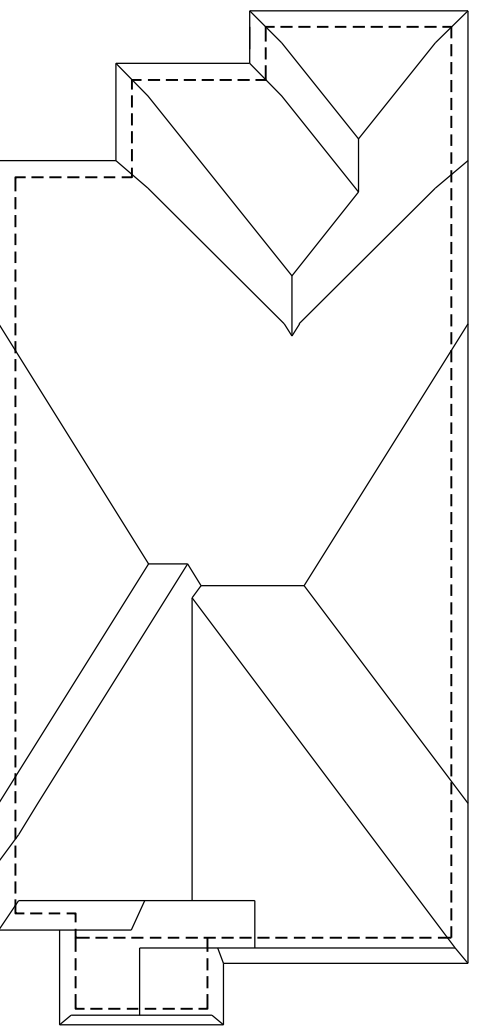

ROOF PLAN 'B'
N.T.S.

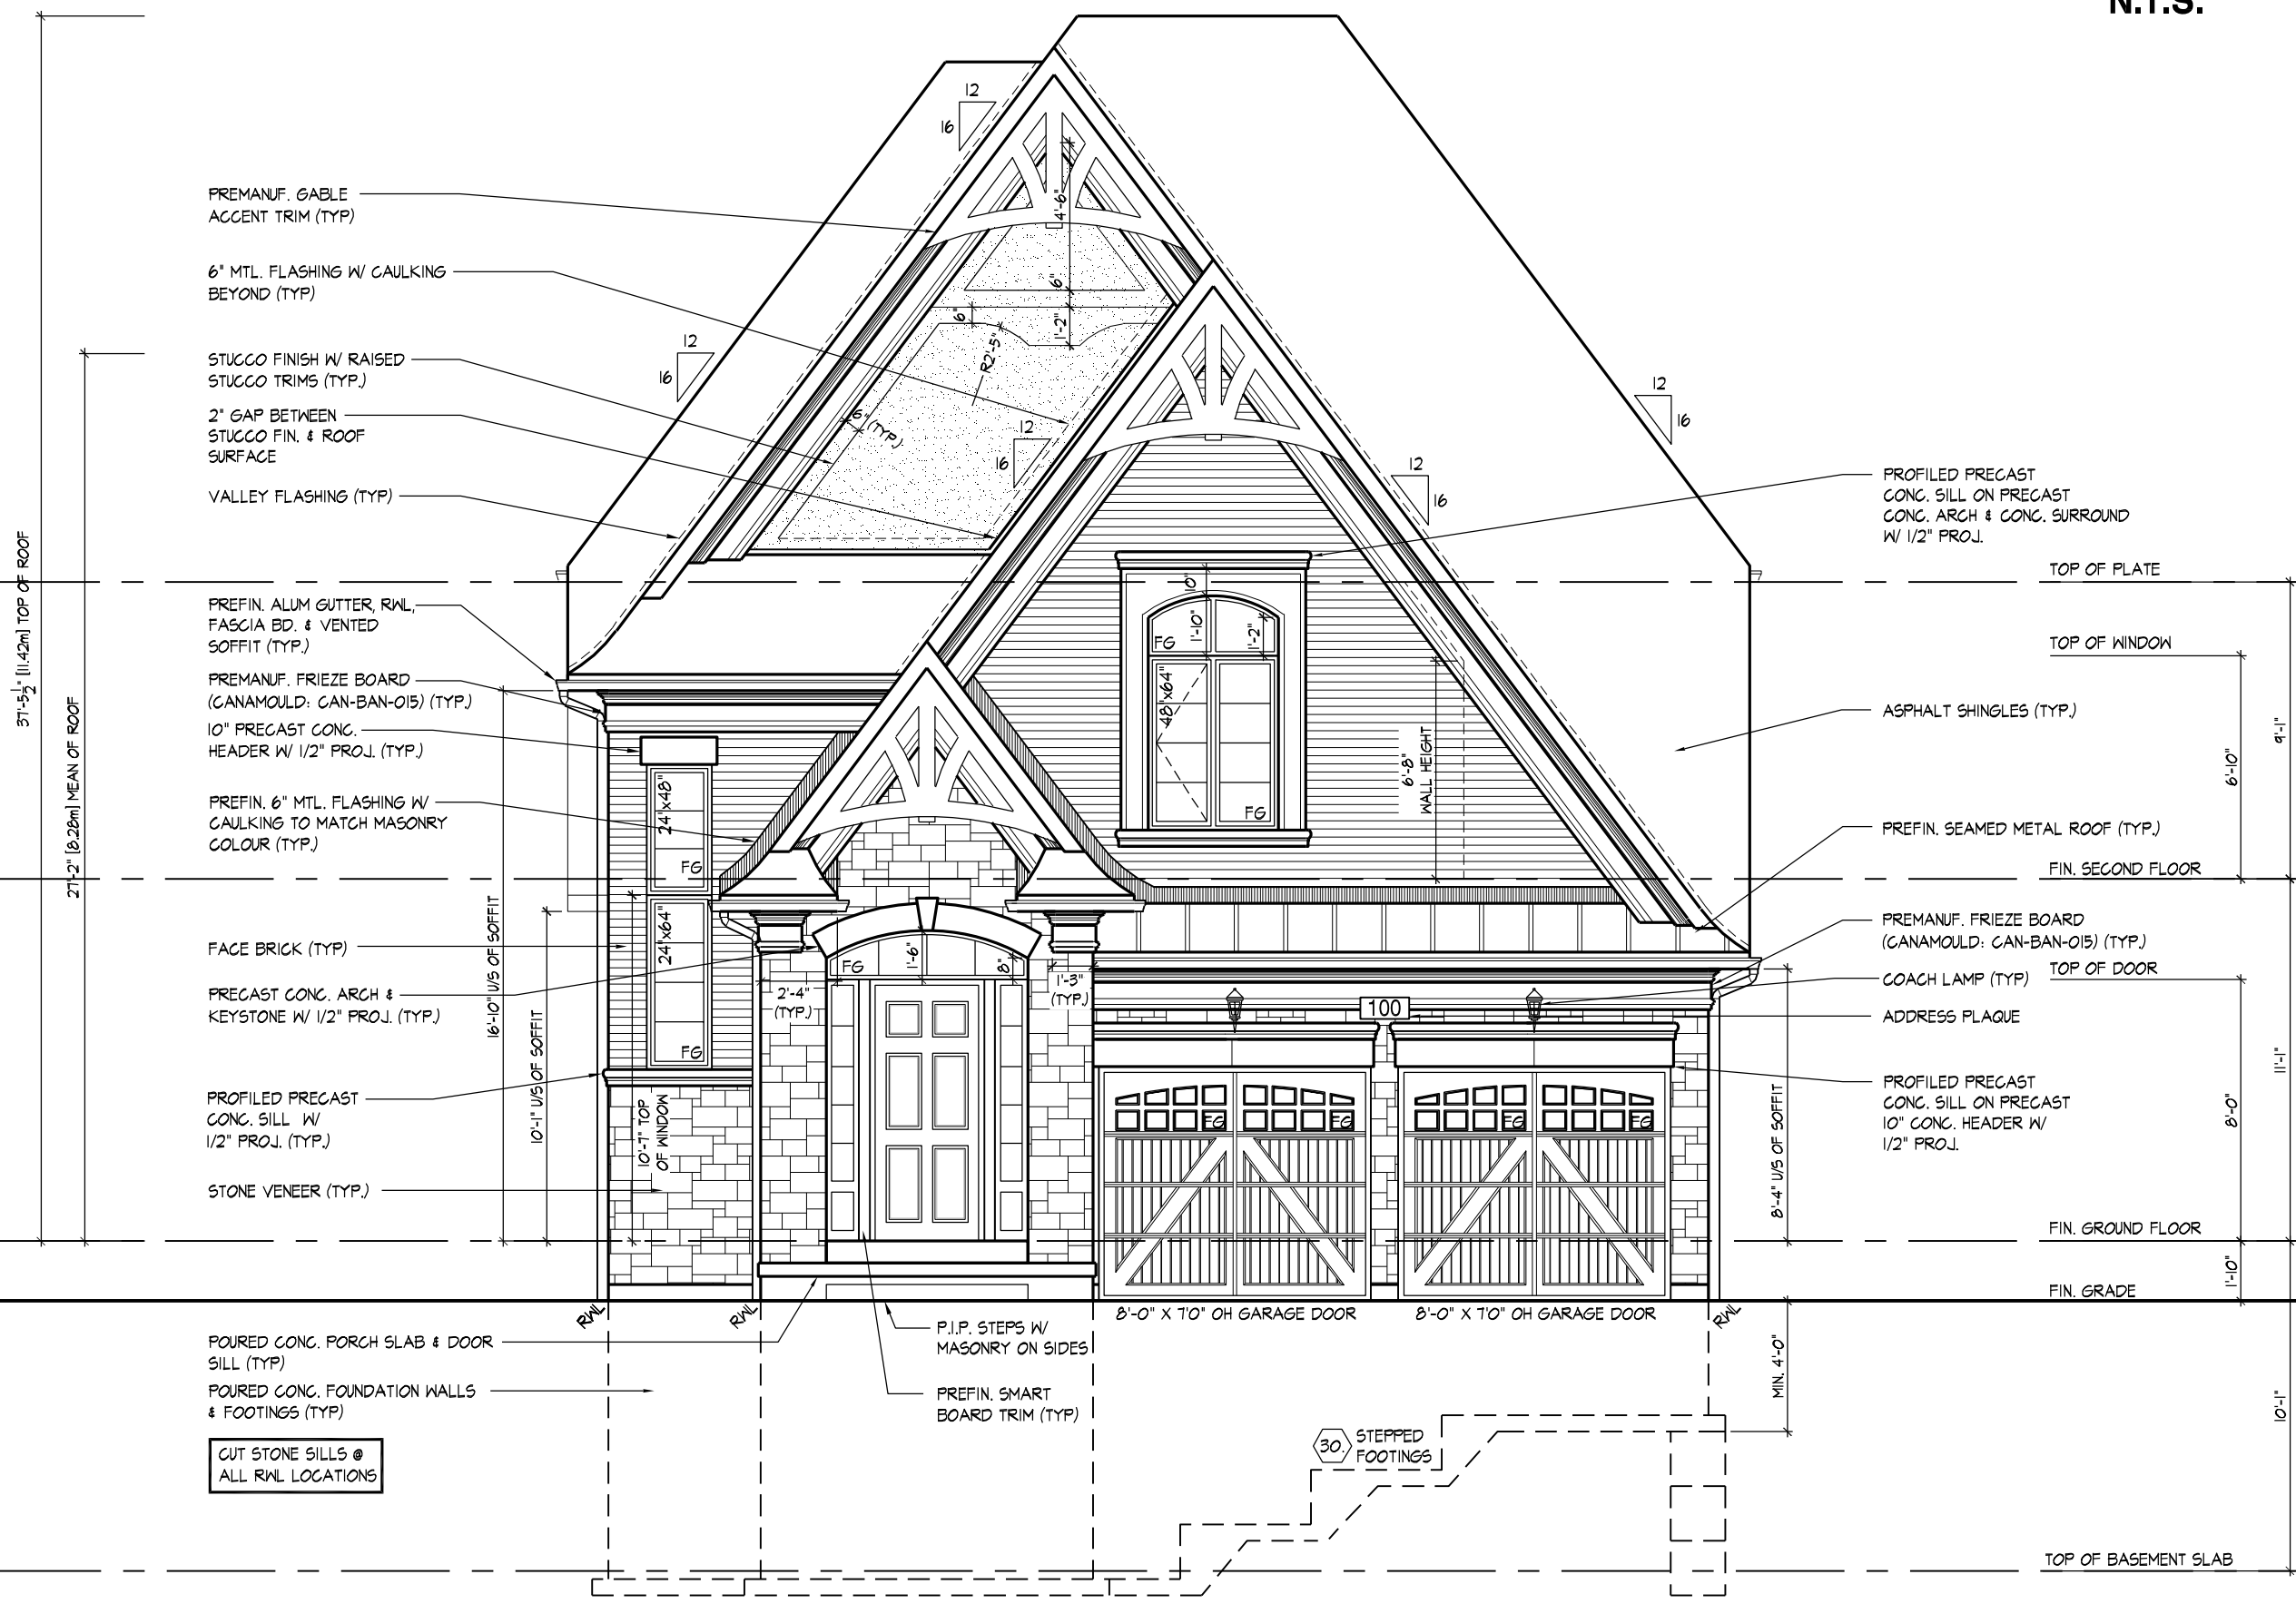

FRONT ELEVATION 'B'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

Orin Fairbairn 20201

NAME SIGNATURE BCIN

REGISTRATION INFORMATION

HUNT DESIGN ASSOCIATES INC. 19695

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature).

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca


GOLDPARK HOMES - 217020
PINE VALLEY, VAUGHAN ONT.

Drawn By: JB
Checked By: OF
Scale: 3/16"=1'-0"


File Number: 217020WS4201
Page Number: 10 of 14

8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

FRONT ELEVATION EL 'B'
UNIT 4201 - THE MAPLEWOOD
REV.2018/06/14

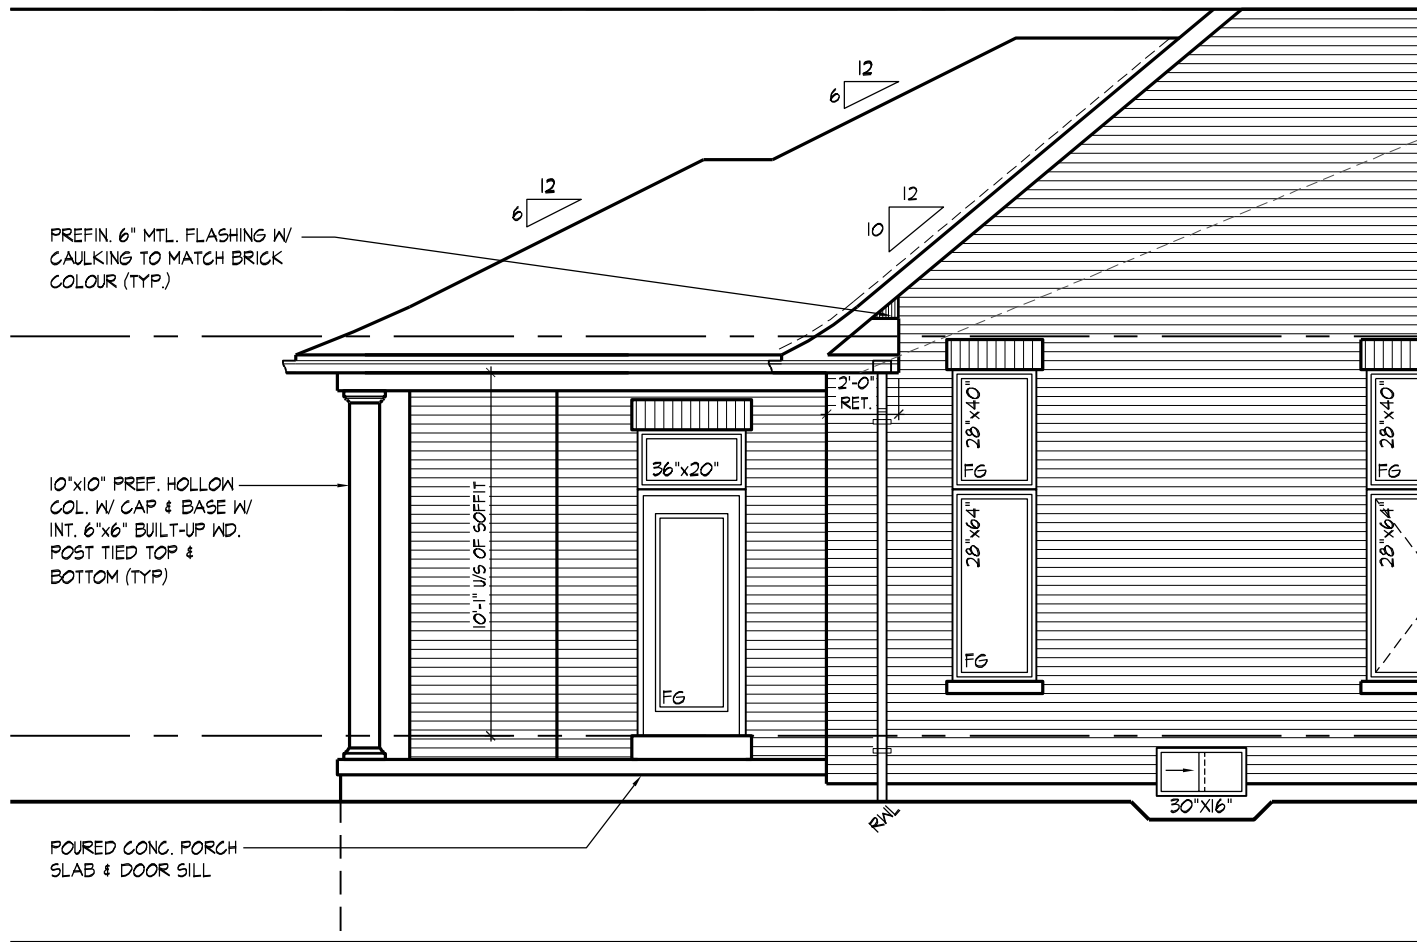

PART. LEFT SIDE ELEVATION 'B' W/ OPT. LOGGIA

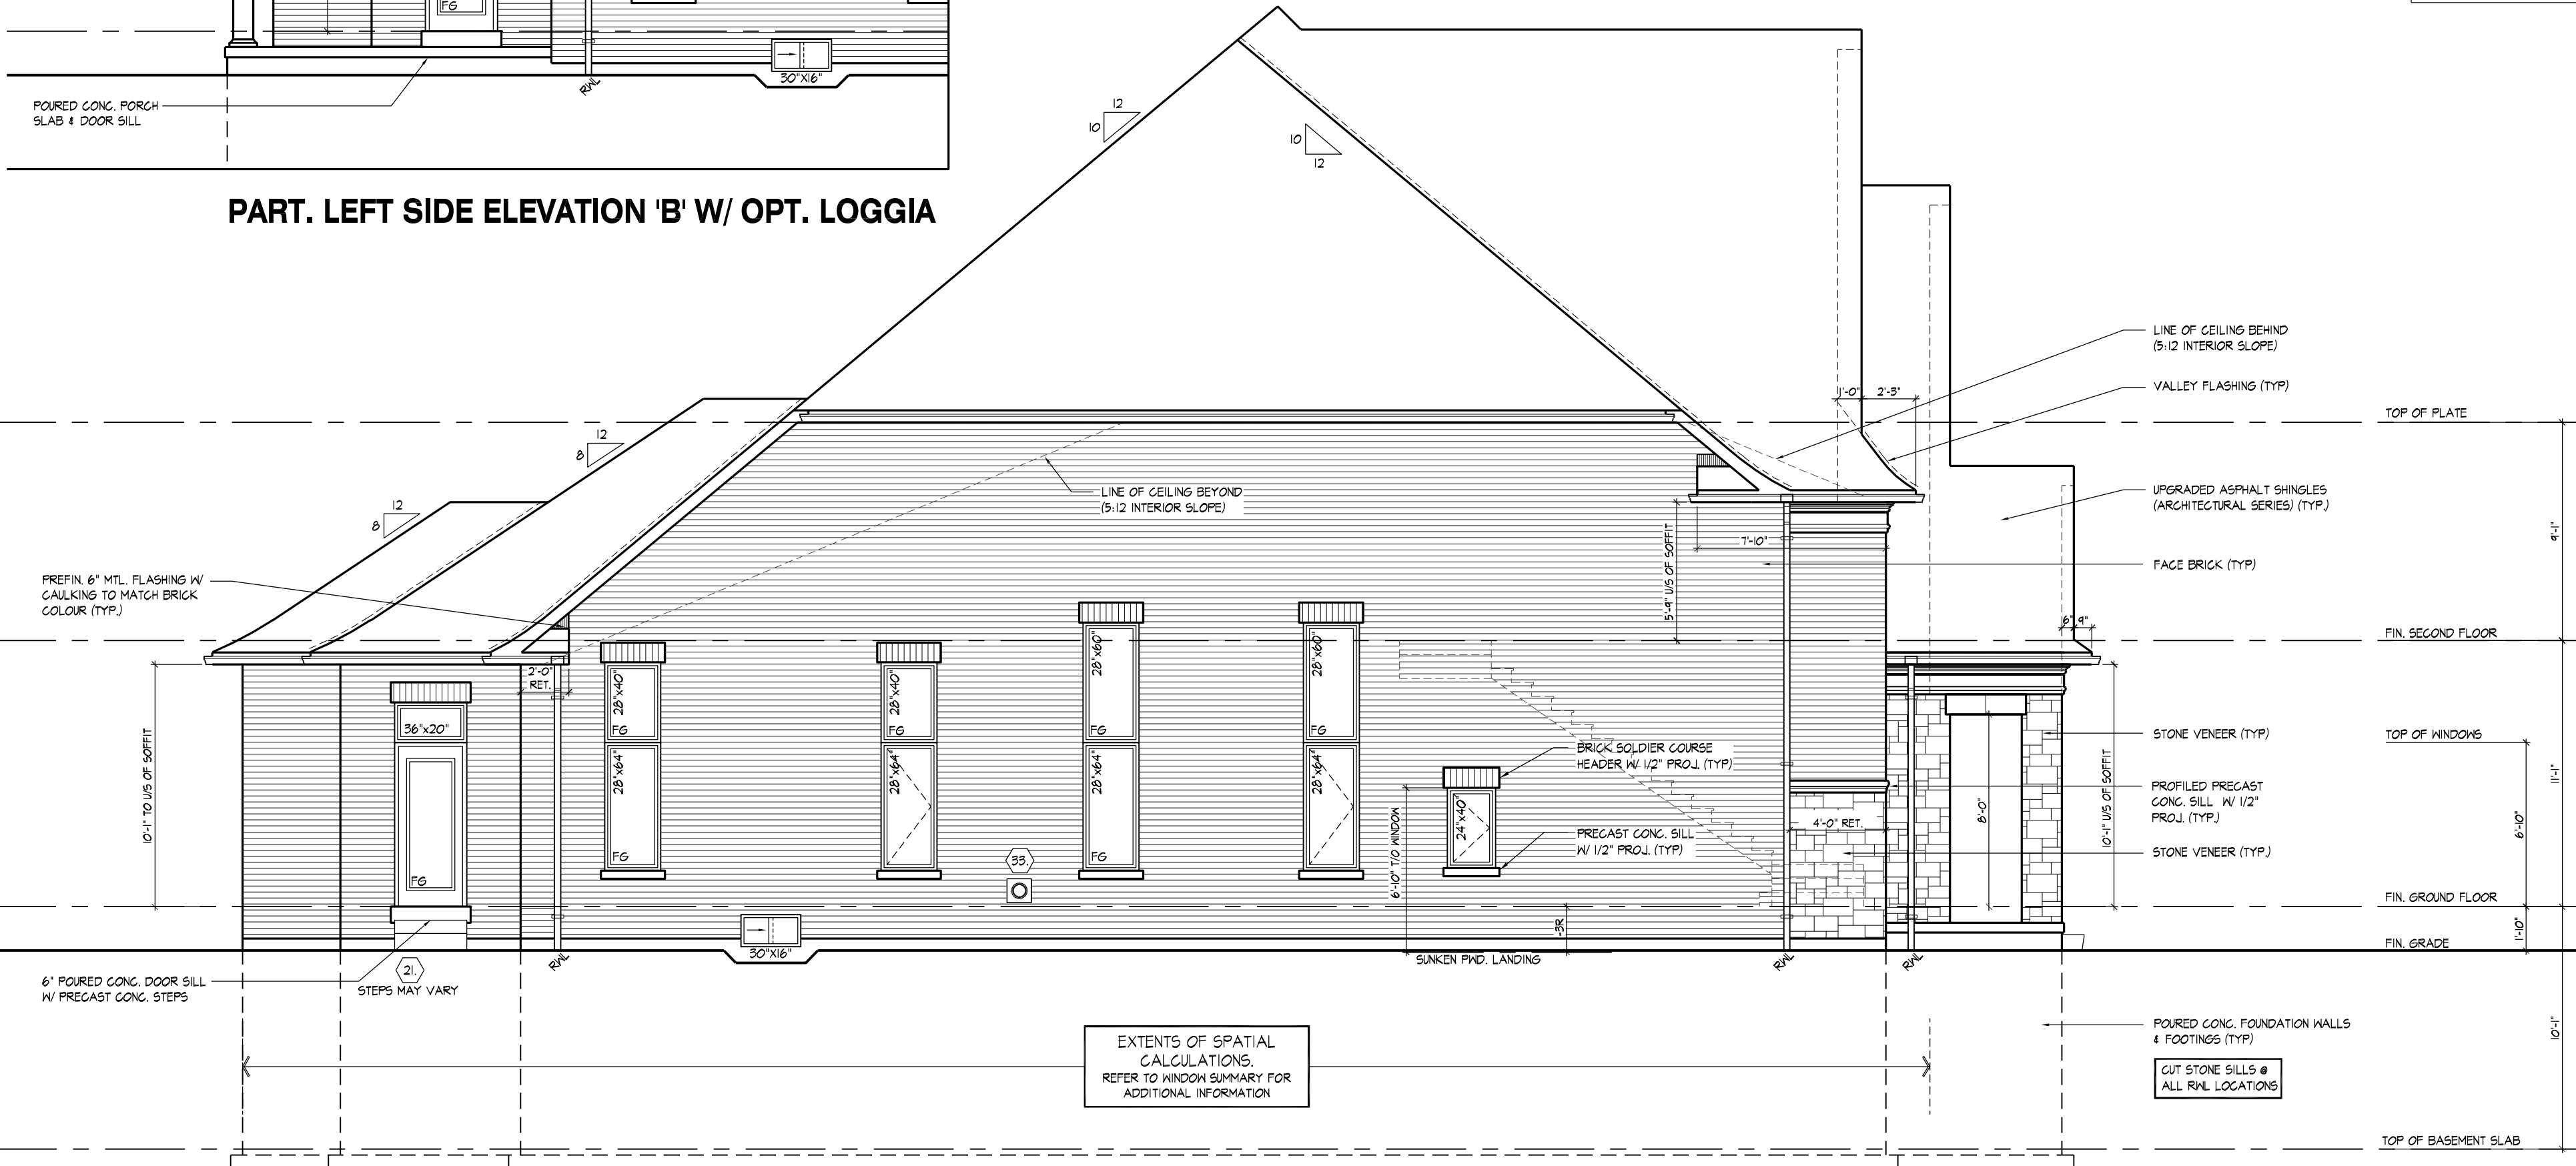

LEFT SIDE ELEVATION 'B'

REFER TO FRONT
ELEVATION FOR TYPICAL
NOTES & INFORMATION

ROOF OVERHANGS TO BE 15"
UNLESS NOTED OTHERWISE

WINDOW SUMMARY			
PER O.B.C. TABLE 8.10.15.4			
LEFT SIDE ELEVATION B			
QUAN.	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)
4	28"	64"	40.00
2	28"	40"	12.00
1	24"	40"	5.00
2	28"	60"	18.67
1	30"	16"	2.17
1	36"	20"	3.56
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
1	DOOR	8.19	9.19
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
SPATIAL CALCULATION			
EXPOSING BUILDING	1297.45	S.F.	
FACE AREA	120.54	S.M.	
PORTION WALL AREA	1297.45	S.F.	
	120.54	S.M.	
LIMITING DISTANCE	7	1.2 m	
MAX. % OPENINGS	7	%	
OPENINGS ALLOWED	90.82	S.F.	
OPENINGS PROVIDED	90.58	S.F.	
ADDITIONAL NOTES			
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER			

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

Orin Fairbairn 20201

NAME SIGNATURE

REGISTRATION INFORMATION BCIN

HUNT DESIGN ASSOCIATES INC. 19695

HUNT

DESIGN ASSOCIATES INC.

www.hunt-design.ca

GOLDPARK HOMES - 217020

PINE VALLEY, VAUGHAN ONT.

Down By Checked By Scale

JB OF 3/16"=1'-0"

LEFT SIDE ELEVATION EL 'B'

UNIT 4201 - THE MAPLEWOOD

REV.2018/06/14


File Number Page Number

217020WS4201 11 of 14


All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

ROOF OVERHANGS TO BE 15'
UNLESS NOTED OTHERWISE

WINDOW SUMMARY				
PER O.B.C. TABLE 9.10.15.4				
RIGHT SIDE ELEVATION B				
QUAN.	WIDTH	HEIGHT	WINDOW / DOOR FRAME SIZE (S.F.)	GLAZED AREA (S.F.)
1	48"	56"	15.8	15.8
1	48"	60"	18.1	18.1
1	48"	60"	18.1	23.3
1	30"	16"	2.17	2.17
0	0"	0"	0.00	0.00
0	0"	0"	0.00	0.00
0	0"	0"	0.00	0.00
0	0"	0"	0.00	0.00
0	0"	0"	0.00	0.00
0	ARCH	0.00	0.00	0.00
0	ARCH	0.00	0.00	0.00
0	ARCH	0.00	0.00	0.00
0	ARCH	0.00	0.00	0.00
SPATIAL CALCULATION				
EXPOSING BUILDING	1297.45	S.F.		
FACE AREA	1297.45	S.F.		
PORTION WALL AREA	126.54	S.F.		
	120.54	S.F.		
LIMITING DISTANCE	7	12 m		
MAX. % OPENINGS		%		
OPENINGS ALLOWED	90.82	S.F.		
OPENINGS PROVIDED	55.50	S.F.		
INTERNAL NOTES				
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2' AROUND ENTIRE PERIMETER				

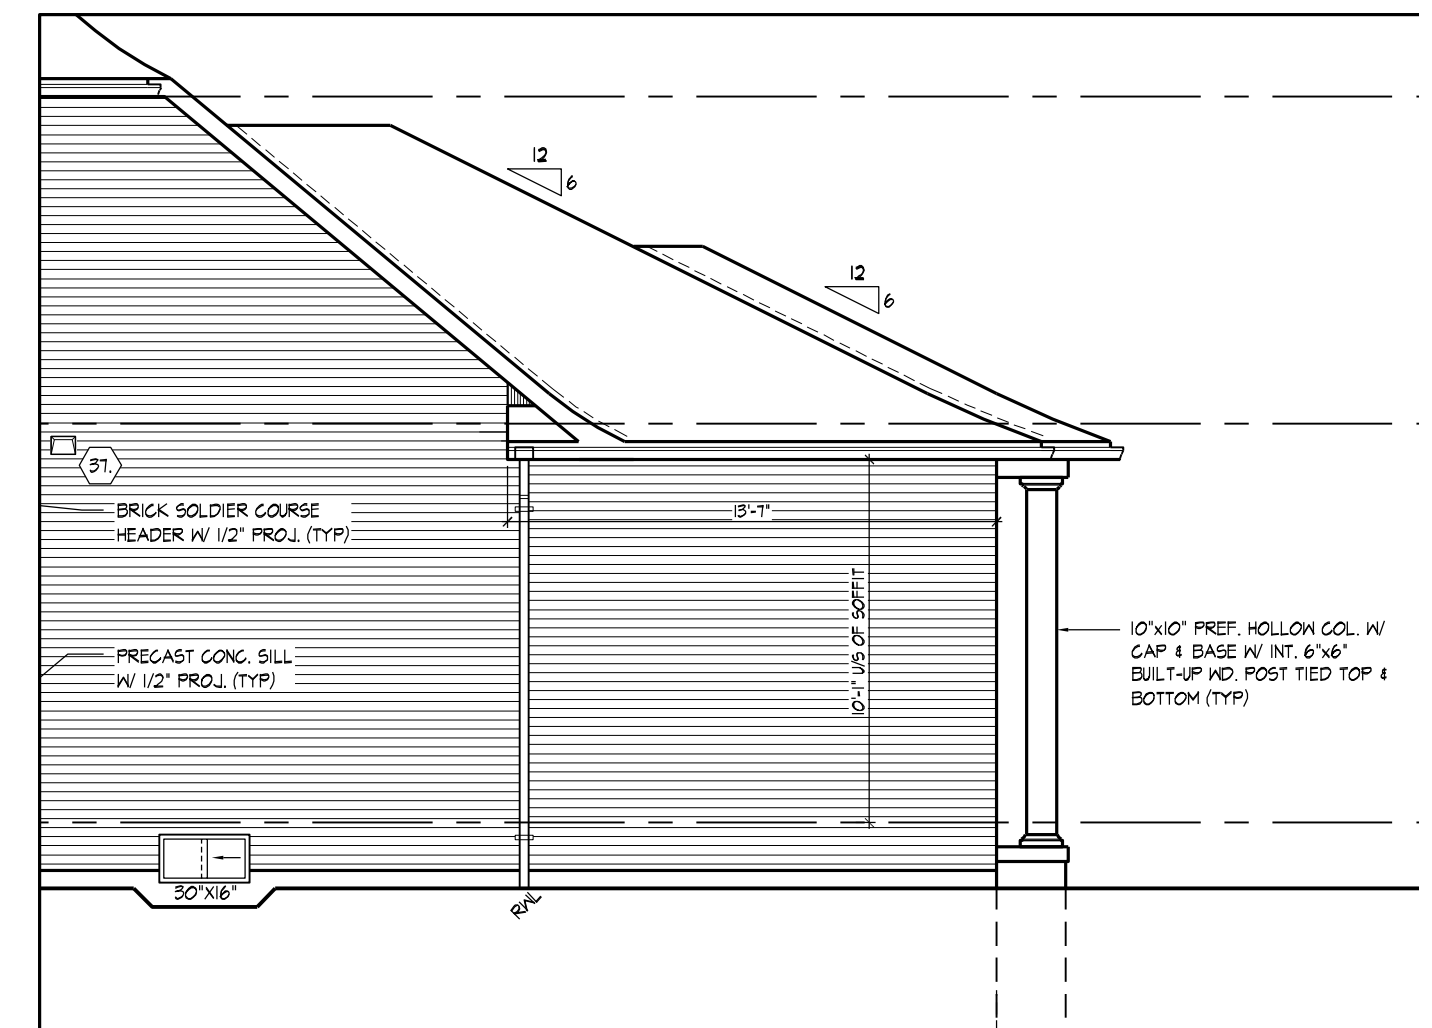

PART. RIGHT SIDE ELEVATION 'B' W/ OPT. LOGGIA

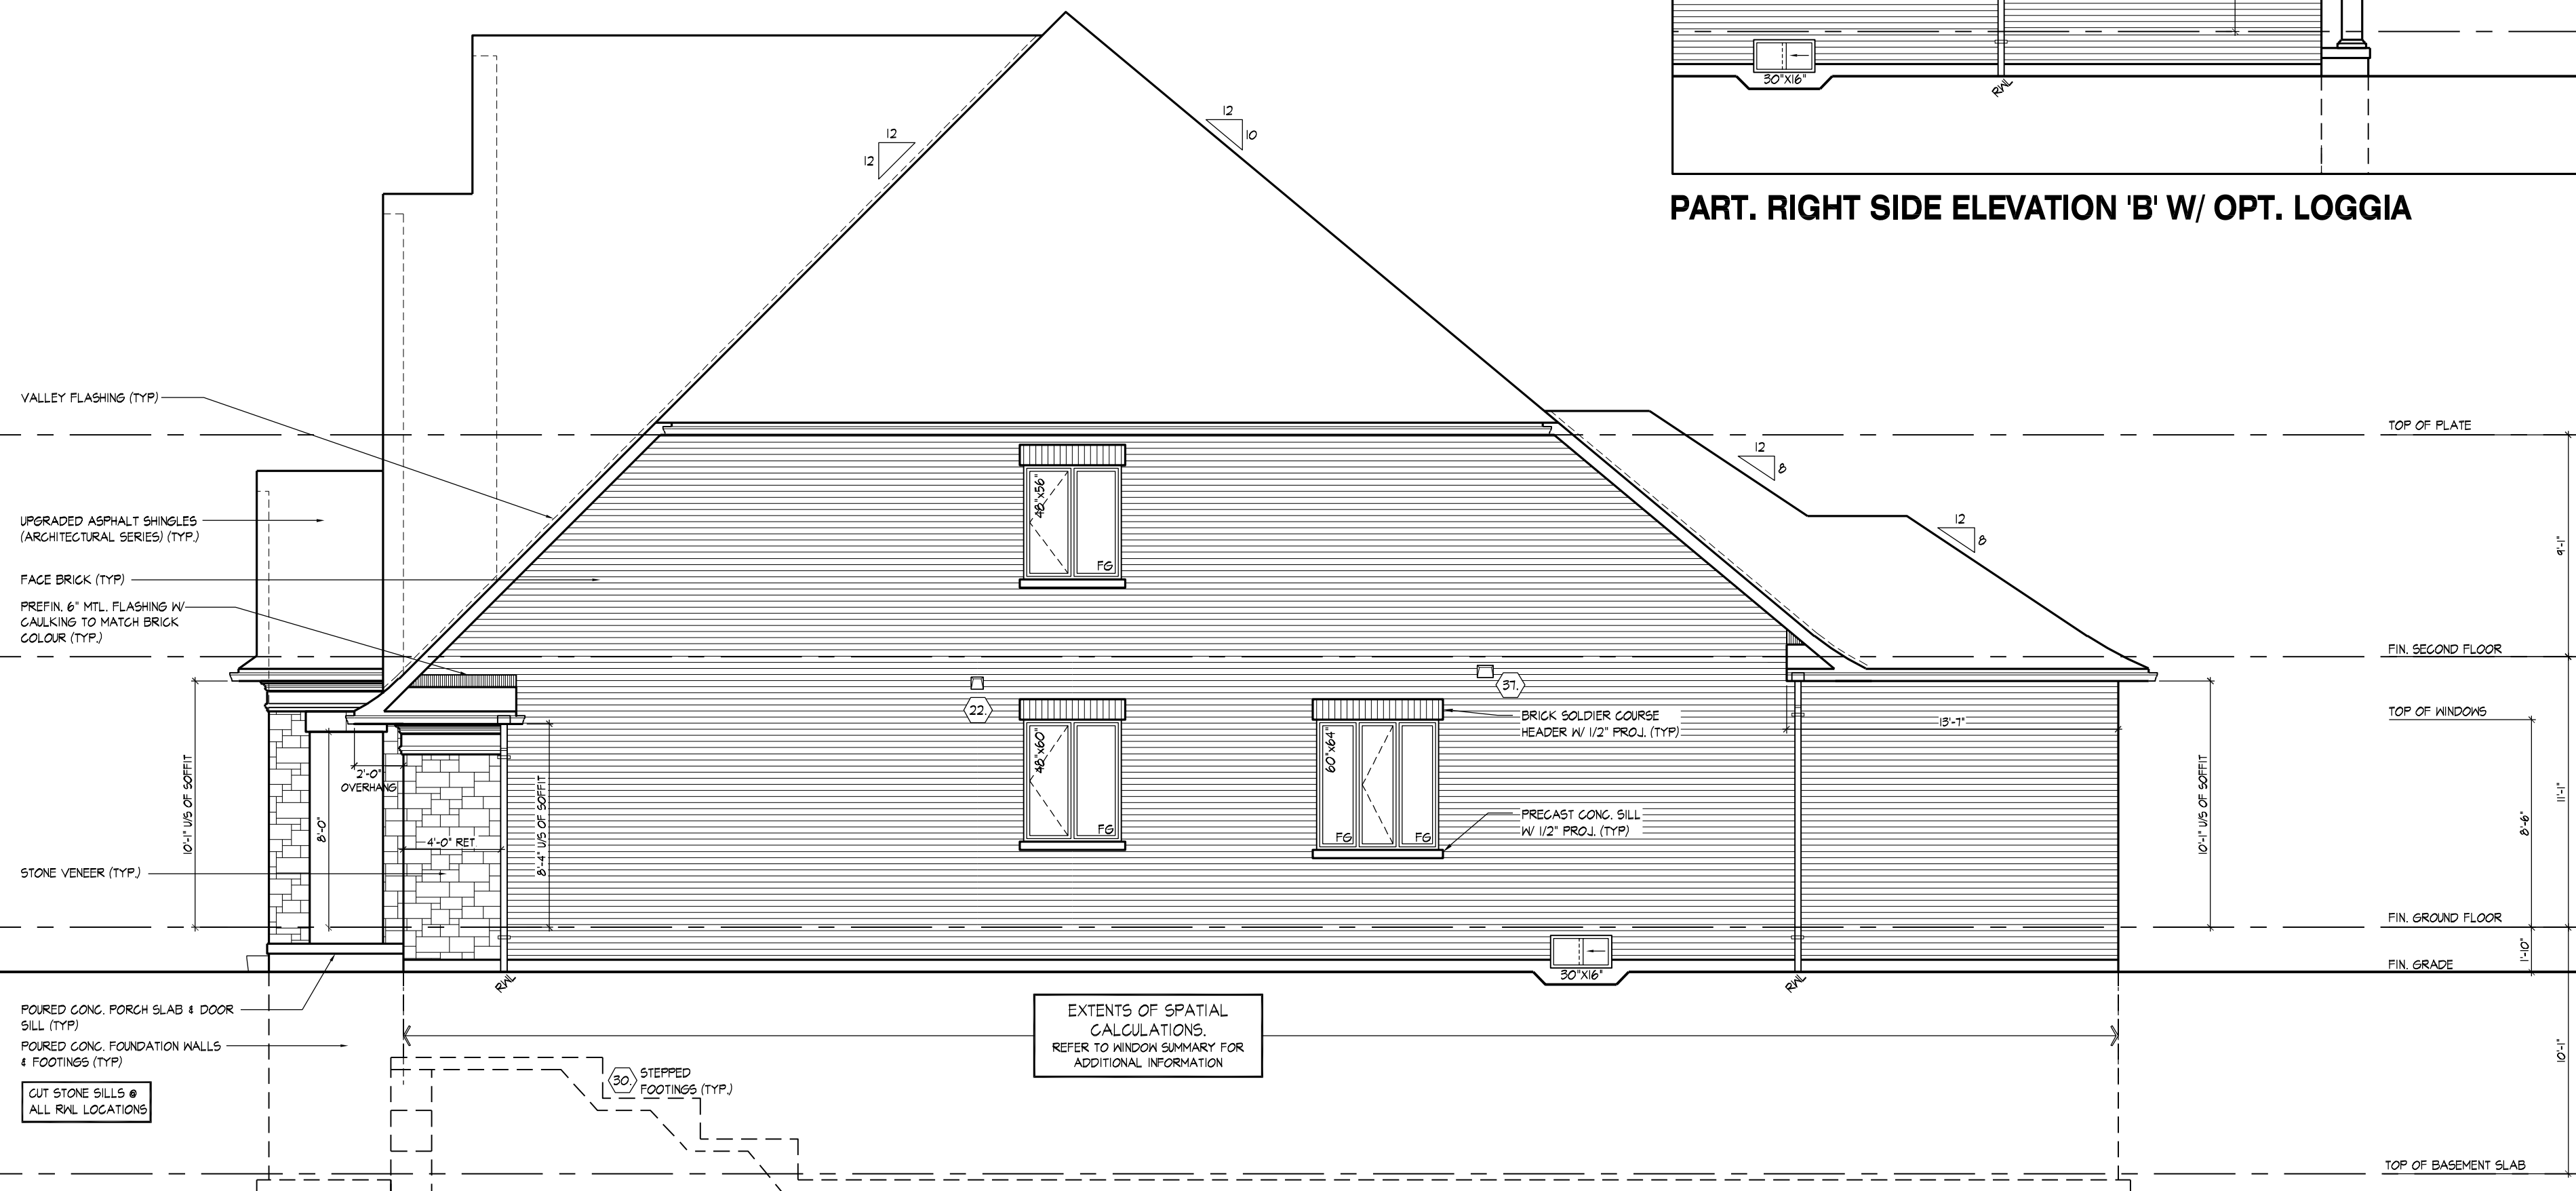

RIGHT SIDE ELEVATION 'B'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION	
Orin Fairbairn	20201
NAME	SIGNATURE
REGISTRATION INFORMATION	
HUNT DESIGN ASSOCIATES INC.	19695


All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

HUNT 
DESIGN ASSOCIATES INC.
www.hunt-design.com

GOLDPARK HOMES - 217020
PINE VALLEY, VAUGHAN ONT.


RIGHT SIDE ELEVATION EL 'B'
UNIT 4201 - THE MAPLEWOOD
 REV.2018/06/14

Drawn By JB	Checked By OF	Scale 3/16"=1'-0"	File Number 217020WS4201	Page Number 12 of 14
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326				

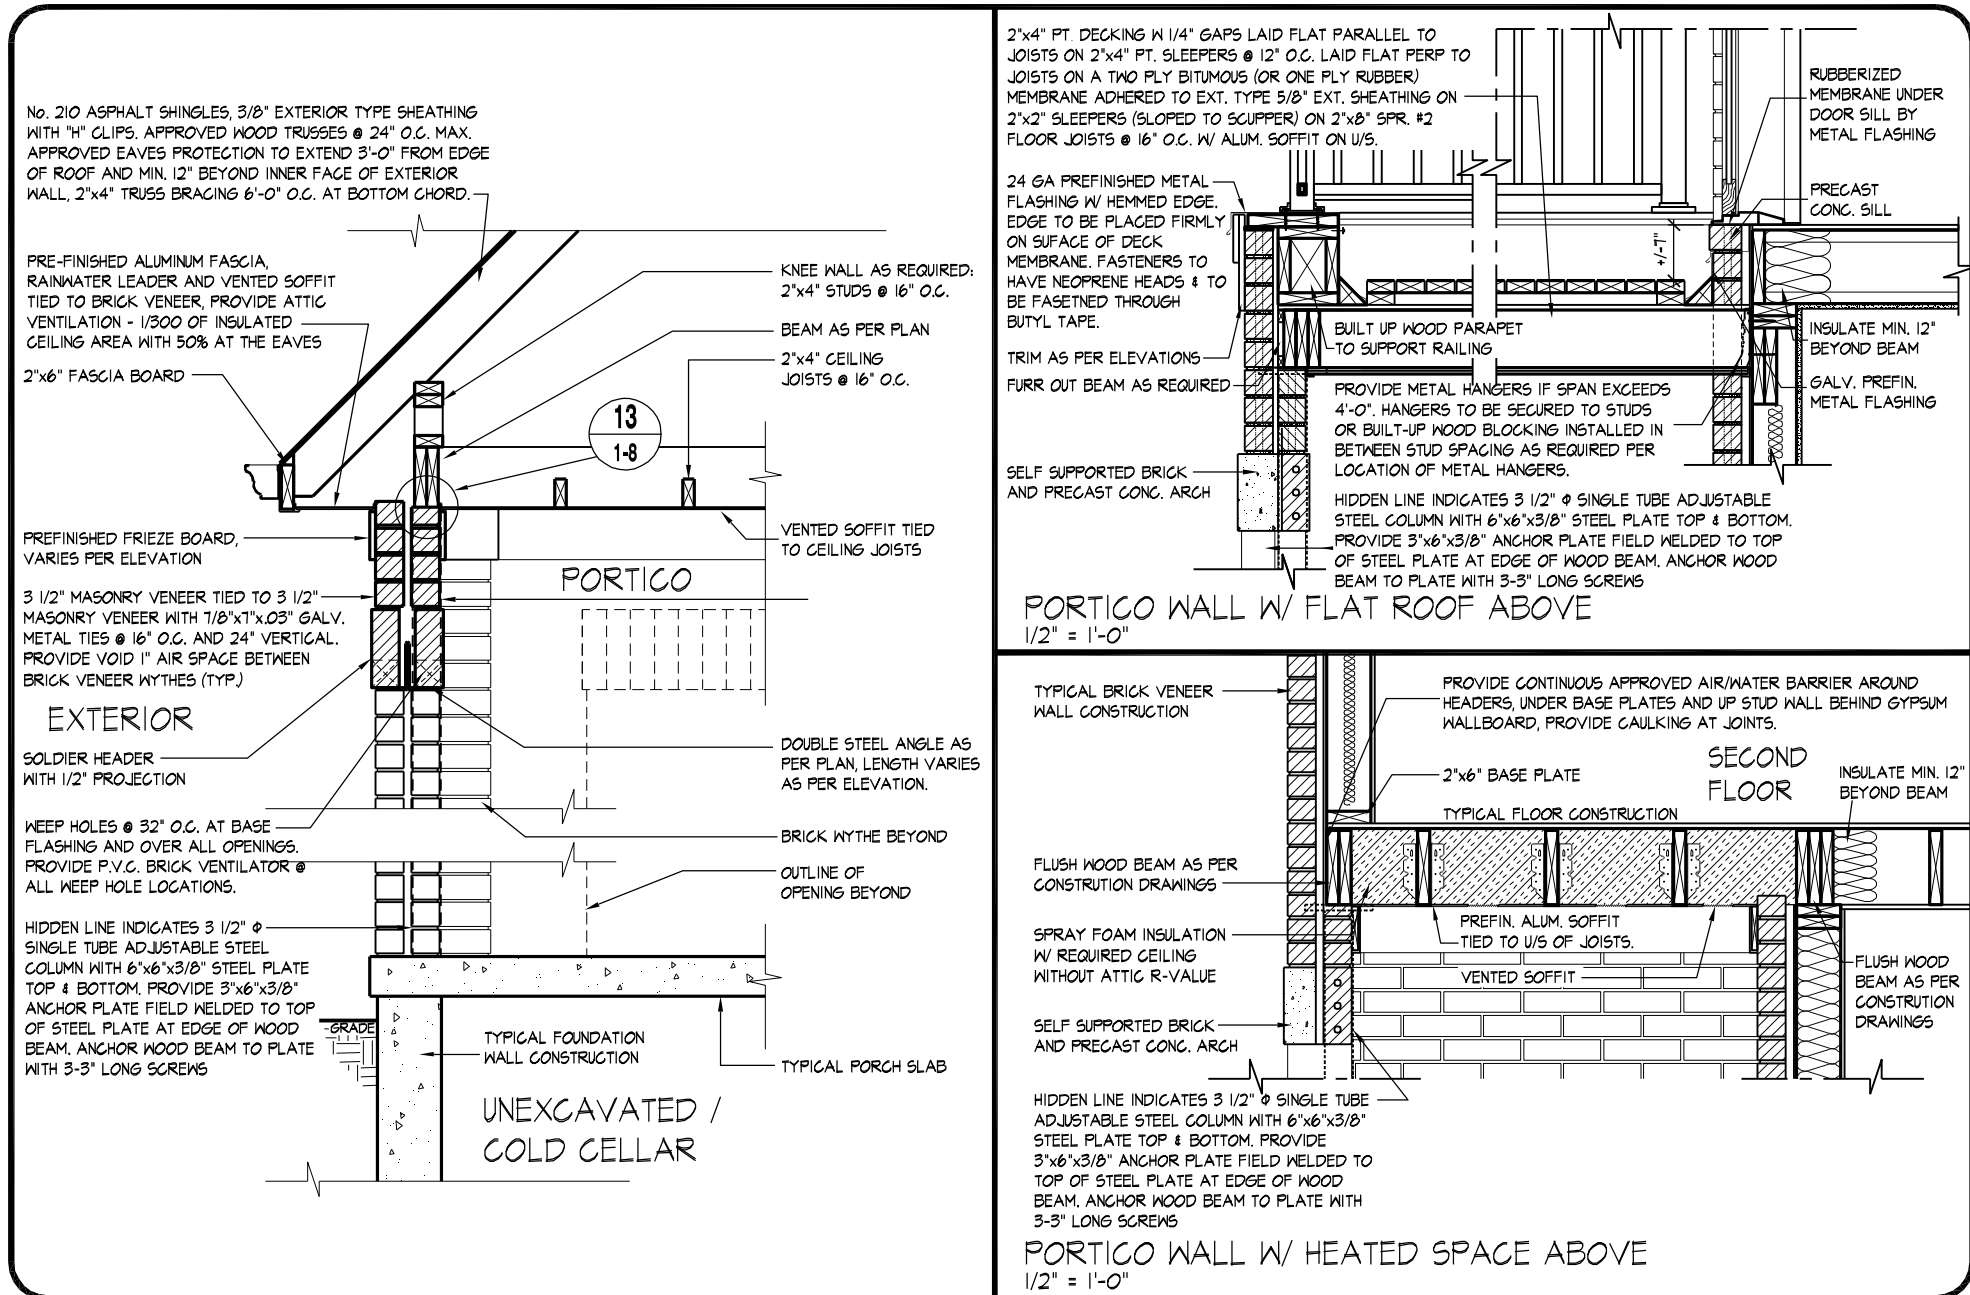

14 TYPICAL BRICK PORTICO WALL (DOUBLE BRICK VENEER WYTHE WALL)

1/2" = 1'-0"

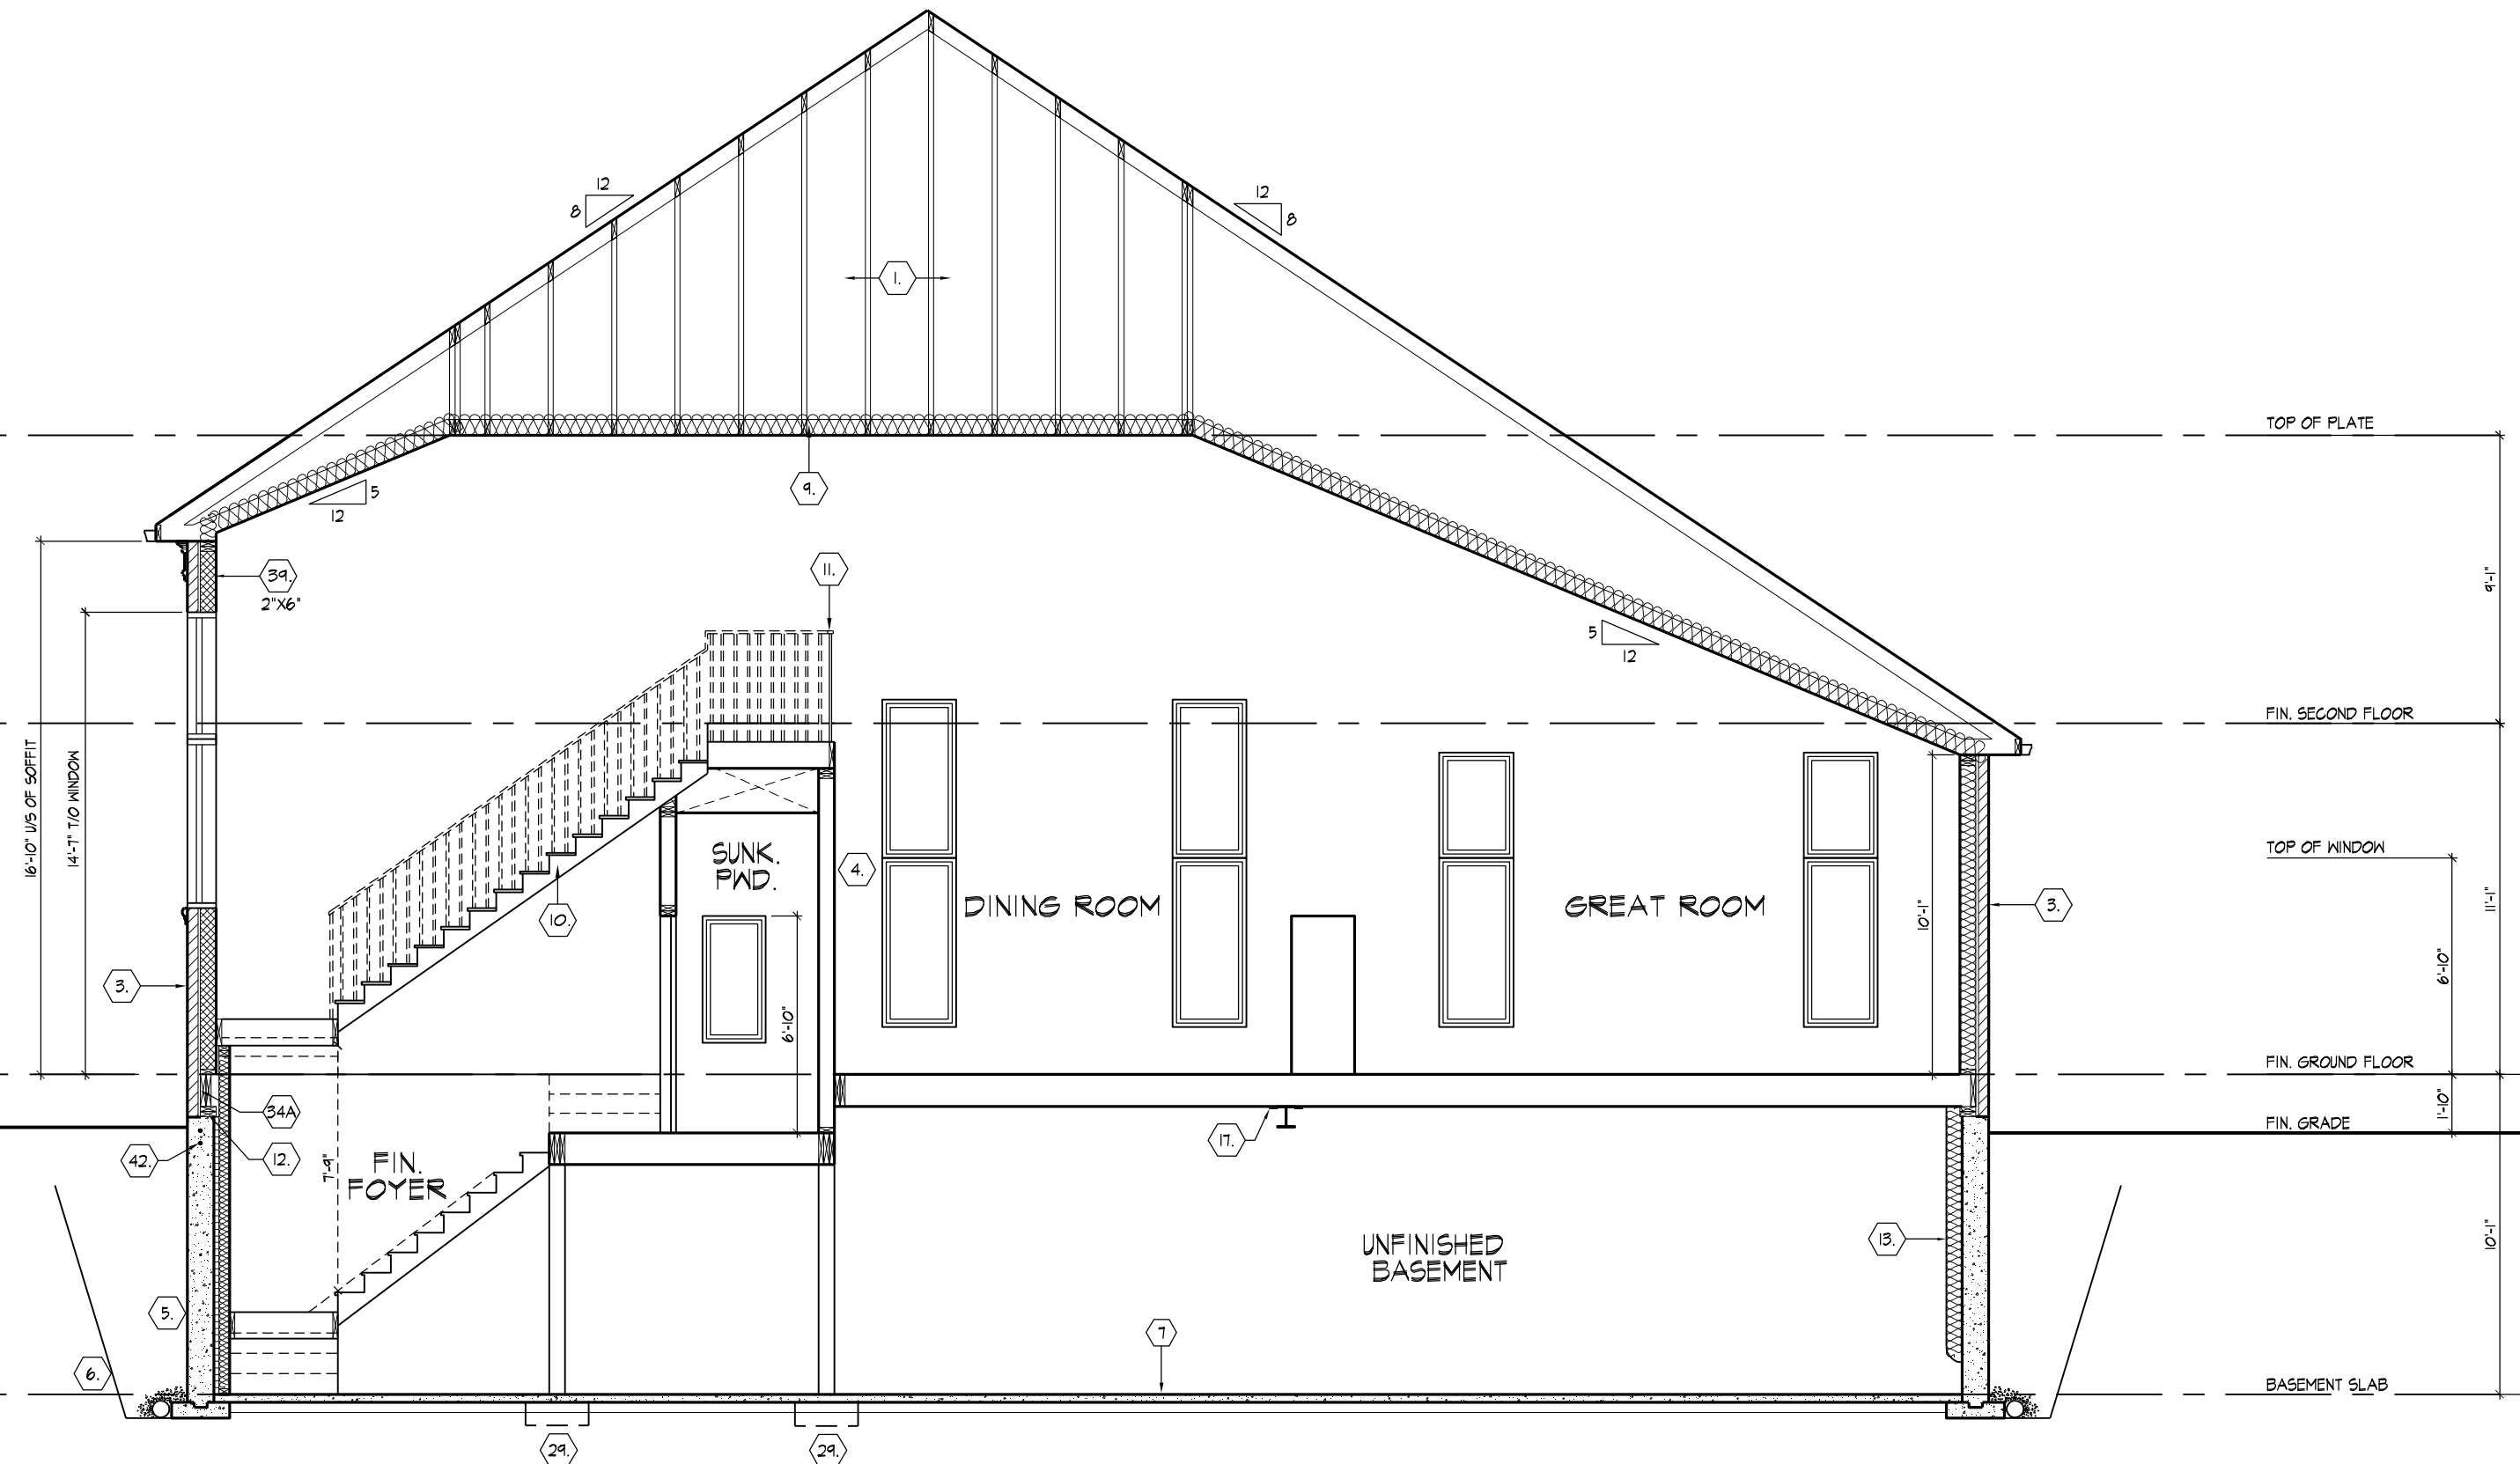

CROSS SECTION 'A-A'

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION

Otin Fairbairn 20201

NAME SIGNATURE BCIN

REGISTRATION INFORMATION

HUNT DESIGN ASSOCIATES INC. 19695

HUNT

DESIGN ASSOCIATES INC.

www.huntdesign.ca

GOLDPARK HOMES - 217020

PINE VALLEY, VAUGHAN ONT.

CROSS SECTION 'A-A' & DETAILS

UNIT 4201 - THE MAPLEWOOD

REV.2018/06/14

Drawn By: JB, Checked By: OF, Scale: 3/16"=1'-0", File Number: 217020WS4201, Page Number: 13 of 14

8966 Woodbine Ave., Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

SECTION 1.0. CONSTRUCTION NOTES

1	ROOF CONSTRUCTION (9.19, 9.23.1.3, 9.23.1.5)	
	NO. 210 (10.25 KG/M2) ASPHALT SHINGLES, 3/8" (9.5) PLYWOOD SHEATHING WITH #4 CLIPS, APPROVED WOOD TRUSSES @ 24" (610) O.C. MAX. APPROVED EAVES PROTECTION TO EXCEED 2'-11" (660) O.C. MAX. BETWEEN FLOOR JOISTS, 12" (305) BEYOND INNER FACE OF EXTERIOR WALL, 2'x4'(38x89) TRUSS BRACING @ 6'-0" (1830) O.C. AT BOTTOM CHORD, PREFIN. ALUM. EAVESTROUGH, FASCO, RWL & VENTED SOFFIT. ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% OF REQUIRED OPENINGS LOCATED AT TOP OF SPACE & MIN. 25% OF REQUIRED OPENINGS LOCATED AT BOTTOM OF SPACE, EAVESTROUGH TO BE 4" MIN. WITH RWL DISCHARGING ONTO 2"X4" (89x125) EAVESTROUGH FROM EXTERIOR WALL. EAVESTROUGHES TO HAVE 5" MIN. EAVESTROUGH WITH ELEC. TRACED HEATER CABLE ALONG EAVESTROUGH AND DOWN RWL.	
1A	ICE AND WATER SHIELD	
	PROVIDE ICE AND WATER SHIELD IN AREAS INDICATED. THE ICE AND WATER SHIELD SHALL BE A SELF-ADHERING AND SELF-SEALING MEMBRANE. SIDE LAPS MUST BE A MINIMUM 3'-12" (90") AND END LAPS A MINIMUM 6" (152) AND TO EXTEND UP DORMER WALLS A MINIMUM 12" (305).	
1B	PROFILED ROOF TRUSSES	
	ROOF TRUSSES SHALL BE PROFILED AND/OR STEPPED AT RAISED COFFER/TRAY CEILINGS, ANGLED TRAY CEILINGS WILL BE SHEATHED W/ 3/8" (9.5) PLYWOOD.	
2	SIDING WALL CONSTRUCTION	
	SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS. FURNISH MEMBERS OR BLOCKING BETWEEN THE FRAMING MEMBERS ON APPROVED SHEATHING PAPER ON 3/8" (9.5) EXT. GAR. SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., INSULATION, APPROVED 6 MIL POLYETHYLENE AIR/VAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INT. FIN. (GYPSUM SHEATHING, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1)) (REFER TO 35 NOTE AS REQ.)	
2A	SIDING WALL CONSTRUCTION W/ CONTIN. INSULATION	
	SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS ON APPROVED AIR/WATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPE) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS ON 3/8" (9.5) EXT. GAR. SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., INSULATION, APPROVED 6 MIL POLYETHYLENE AIR/VAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INT. FIN. (GYPSUM SHEATHING, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1)) (REFER TO 35 NOTE AS REQ.)	
2B	SIDING WALL @ GARAGE CONSTRUCTION	
	SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS. FURNISH MEMBERS OR BLOCKING BETWEEN THE FRAMING MEMBERS ON APPROVED SHEATHING PAPER ON 3/8" (9.5) EXT. GAR. SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1)) (REFER TO 35 NOTE AS REQ.)	
3	BRICK VENEER WALL CONSTRUCTION	
	3-1/2" (90) BRICK VENEER @ 25" (635) AIR SPACE, 7/8"x7/8"x3" (22x180x76) GALV. METAL TIES @ 16" (406) O.C. HORIZ. 24" (610) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.23.9.3. ON APPROVED SHEATHING PAPER, 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., INSULATION, APPROVED 6 MIL POLYETHYLENE AIR/VAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1)) (REFER TO 35 NOTE AS REQ.)	
3A	BRICK VENEER WALL CONSTRUCTION W/ CONTIN. INSULATION	
	3-1/2" (90) BRICK VENEER @ 25" (635) AIR SPACE, 7/8"x7/8"x3" (22x180x76) GALV. METAL TIES @ 16" (406) O.C. HORIZ. 24" (610) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.23.9.3. ON APPROVED AIR/WATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPE) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS, ON 3/8" (9.5) EXTERIOR TYPE SHEATHING, STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., INSULATION, APPROVED 6 MIL POLYETHYLENE AIR/VAPOUR BARRIER, ON 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1)) (REFER TO 35 NOTE AS REQ.)	
3B	BRICK VENEER WALL @ GARAGE CONSTRUCTION	
	3-1/2" (90) BRICK VENEER, MIN. 1" (25) AIR SPACE, 7/8"x7/8"x3" (22x180x76) GALV. METAL TIES @ 16" (406) O.C. HORIZ. 24" (610) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.23.9.3. ON APPROVED SHEATHING PAPER, 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., 1/2" (12.7) GYPSUM WALLBOARD INTERIOR FINISH, RIGID INSULATION, AND FIBERBOARD SHALL NOT BE USED FOR THE ATTACHMENT OF SIDING (9.23.16.3.1.1)) (REFER TO 35 NOTE AS REQ.)	
4	INTERIOR STUD PARTITIONS (9.23.9.8, 9.23.10)	
	BEARING PARTITIONS SHALL BE A MINIMUM 2"x4" (38x89) @ 16" (406) O.C. FOR 2 STORY AND 1/2" (305) O.C. FOR 3 STORY. NON-BEARING PARTITIONS 2"x4" (38x89) @ 24" (610) O.C. FROM TOP OF STUD TO TOP OF STUD. TOP OF STUD TO TOP OF STUD, 1/2" (12.7) INT. DRYWALL, BOTH SIDES OF STUDS, PROVIDE 2"x6" (38x140) STUDS WHERE NOTED. PROVIDE 2"x4" (38x89) @ 24" (610) O.C. LADDER FRAMING WHERE WALLS INTERSECT PERPENDICULAR TO ONE ANOTHER. PROVIDE 2"x4" (38x89) WOOD BLOCKING ON PLAT @ 2'-11" (514) O.C. MAX. BETWEEN FLOOR JOISTS WHEN NON-ADJACENT WALLS ARE PARALLEL TO FLOOR JOISTS.	
4A	EXT. LOFT WALL CONSTRUCTION - NO CLADDING	
	3/8" (9.5) EXTERIOR TYPE SHEATHING, STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., INSULATION AND 6 MIL POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONT. AIR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH, (9.23)	
4B	EXT. LOFT WALL CONSTRUCTION - NO CLADDING W/ CONTINUOUS INSULATION	
	APPROVED AIR/WATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPE) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS, ON 3/8" (9.5) EXTERIOR TYPE SHEATHING, STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., INSULATION AND 6 MIL POLYETHYLENE VAPOUR BARRIER WITH APPROVED CONT. AIR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH, (9.23)	
5	FOUNDATION WALL/FOOTINGS	
	POURED CONC. FOUNDATION WALL AS PER CHART BELOW ON CONTINUOUS KEYED CONCRETE FOOTING. FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150) ABOVE FINISHED GRADE. THE OUTSIDE OF THE FOUNDATION SHALL BE DAMPROOFED FROM THE TOP OF THE FOOTING TO FINISHED GRADE AND BRUSH COAT FROM THE TOP TO 2" BELOW GRADE. PROVIDE A DRAINAGE LAYER ON THE OUTSIDE OF THE FOUNDATION WALL. SEAL THE DRAINAGE LAYER AT THE TOP. THE TOP OF THE CONC. FINISHING SHALL BE DAMPROOFED. CONCRETE FOOTINGS SUPPORTING JOIST SPANS GREATER THAN 16'-1" (4800) SHALL BE SIZED IN ACCORDANCE WITH 9.15.3.4.1 (1) (2) OF THE O.B.C. (REFER TO CHART BELOW FOR RESPECTIVE SIZE). BRACE FOUNDATION WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OF 125KPa S.L.S. OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY OF 125KPa S.L.S. IF SOIL BEARING DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED. ACTUAL SOIL BEARING CAPACITY TO BE VERIFIED WITH SOIL ENGINEERING REPORT. REFER TO CONSTRUCTION DRAWINGS AND DETAILS FOR FOUNDATION WALL STRENGTH AND THICKNESS AND 9.15.4.	
	FOUNDATION WALLS SHALL NOT EXCEED 9'-10" (3.0m) IN UNSUPPORTED HEIGHT UNLESS OTHERWISE NOTED. (9.15.4.2.1, 1)	
	UNREINFORCED SOLID CONCRETE FOUNDATION WALLS @ 15.4.2.1	
	MAX. HEIGHT FROM FIN. SLAB TO GRADE	
	UNSUPPORTED	SUPPORTED AT TOP
	AT TOP	
	≤2.5m	≤2.5m & ≤2.75m
	≤2.75m & ≤3.0m	
	8" 3'-11" (1.20m)	7'-6" (2.15m) 6'-0" (1.75m) 6'-0" (1.75m)
	10" 4'-7" (1.41m)	7'-6" (2.30m) 8'-6" (2.60m) 8'-2" (2.50m)
	12" 4'-11" (1.50m)	7'-6" (2.30m) 8'-6" (2.60m) 9'-2" (2.85m)
	8" 3'-11" (1.20m)	7'-6" (2.30m) 7'-6" (2.30m) 7'-2" (2.20m)
	10" 4'-7" (1.41m)	7'-6" (2.30m) 8'-6" (2.60m) 9'-2" (2.85m)
	12" 4'-11" (1.50m)	7'-6" (2.30m) 8'-6" (2.60m) 9'-2" (2.85m)
	* 9" MIN. THICK. FOUNDATION WALL IS REQUIRED FOR MASONRY VENEER. FINISHED EXTERIOR WALLS WITH CONTINUOUS INSULATION CONDITION. TO MEET MIN. BEARING SLIP PLATES, BEAMS AND FLOOR JOIST AS PER 9.23.2.7, 9.23.8.1, & 9.23.9.1 OF THE O.B.C.	
	MINIMUM STIFF FOOTING SIZES (9.15.3)	
	UNLESS NOTED OTHERWISE ON PLANS	
	NUMBER FLOORS SUPPORTED	SUPPORTING PARTITION
	1	16" WIDE x 6" THICK 16" WIDE x 6" THICK 16" WIDE x 6" THICK
	2	24" WIDE x 14" THICK 20" WIDE x 6" THICK 24" WIDE x 8" THICK
	3	36" WIDE x 14" THICK 20" WIDE x 6" THICK 36" WIDE x 14" THICK

REFER TO SB-12 ENERGY EFFICIENCY DESIGN MATRIX ON THE TITLE PAGE FOR ALL VALUES AS REQUIRED PER 3.1.1., 3.1.2., 3.1.3. OF THE OBC.

5A

FOUNDATION REDUCTION IN THICKNESS FOR MASONRY

WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO PERMIT THE INSTALLATION OF MASONRY EXTERIOR FINISH, THE REDUCED SECTION SHALL BE NOT LESS THAN 3'-12" (90) THICK. THE BRICK VENEER SHALL BE TIED TO THE FOUNDATION WALL WITH CORROSION RESISTANT METAL TIES @ 7'-0" (200) VERTICAL AND 2'-11" (889) HORIZONTAL. FILL VOID WITH MORTAR BETWEEN WALL AND BRICK VENEER @ 15.4, 7.2(1) (9) & 9.20.9.4(9)

5B

FOUNDATION REDUCTION IN THICKNESS FOR JOISTS

WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO PERMIT THE INSTALLATION OF FLOOR JOISTS, THE REDUCED SECTION SHALL BE NOT MORE THAN 13'-3/4" (350) HIGH AND NOT LESS THAN 3'-12" (90) THICK (9.15.4.71)

6

WEEPING TILE (9.14.3)

4" (100) Ø WEEPING TILE W/ FILTER CLOTH W/RAFF & 6" (152) CRUSHED STONE COVER

7

BASEMENT SLAB OR SLAB ON GRADE (9.16.4.3)

3" (80) MIN. 25MPa (3600psi) CONC. SLAB ON 4" (100) COARSE GRANULAR FILL, OR 20MPa (2900psi) CONC. WITH DAMPROOFING BELOW SLAB. PROVIDE 1/2" (12.7) IMPERVIOUS BOARD FOR BOND BREAK AT EDGE. (9.13) WHERE A BASEMENT SLAB IS WITHIN 24" (610) OF THE EXTERIOR GRADE PROVIDE RIGID INSUL. AROUND THE PERIMETER EXTENDING MIN. 24" (610) BELOW GRADE. FOR SLAB ON GRADE CONDITIONS RIGID INSULATION SHALL BE APPLIED TO THE UNDERSIDE OF THE ENTIRE SLAB. (9.8-12) 3.1.1.7, (9) & (6)

8

EXPOSED FLOOR TO EXTERIOR (9.10.17.10, & CANULC-S705.2)

PROVIDE SPRAY FOAM INSULATION BETWEEN CANT. JOIST AND INSTALL FIN. SOFFIT OR CLADDING AS PER ELEVATION TO U/S OF EXPOSED CANT. JOIST.

9

EXPOSED CEILING TO EXTERIOR W/ ATTIC (9.25.2.4)

INSULATION, 6 mil POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM BOARD INTERIOR FINISH OR APPROVED EOC.

10

EXPOSED CEILING TO EXTERIOR w/o ATTIC

JOIST/TRUSSES AS PER PLANS W/ 2"x2" (38x38) PURLINS @ 16" (406) O.C. PERPENDICULAR TO JOISTS (PURLINS NOT REQ. W/ SPRAY FOAM OR ROOF TRUSSES). W/ INSULATION BETWEEN JOISTS, 6 MIL POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM BOARD INT. FINISH OR APPROVED EOC. (CANULC-S705.2 9.19.1, 9.10.17.1)

10A

ALL STAIRS/EXTERIOR STAIRS (9.8.1.2, 9.8.2, 9.8.4)

	MAX. RISE	MIN. RISE	MAX. RUN	MIN. RUN	MAX. TREAD	MIN. TREAD
PRIVATE	7'-7" (200)	7'-12" (225)	14" (355)	8'-14" (210)	14" (355)	9'-14" (235)
PUBLIC	7'-1" (180)	7'-12" (225)	10" (250)	11" (280)	NO LIMIT	11" (280)

	MIN. STAIR WIDTH	CURVED STAIRS	ALL STAIRS
PRIVATE	2'-10" (660)	MIN. AVG. RUN	7'-7" (200)
PUBLIC	2'-11" (680)	MIN. AVG. RUN	7'-7" (200)

** HEIGHT OVER STAIRS (HEADROOM) IS MEASURED VERTICALLY ACROSS WIDTH OF STAIRS FROM A STRAIGHT LINE TO THE TREAD & LANDING NOSING TO LOWEST POINT ABOVE AND NOT LESS THAN 6'-5" (1950) FOR SINGLE DWELLING UNIT & 6'-4" (34" (2050) FOR EVERYTHING ELSE. (9.8.2.2) REQUIRED LANDING IN GARAGE @ 9.8.2.3. FOR AN EXTERIOR STAIR SERVING A GARAGE W/ MORE THAN 3 RISERS, GUARDS, HANDRAILS & STEPS AS PER CONSTRUCTION HIDE 10 & 11.

11

GUARDS/RAILINGS (9.8.7, 9.8.8)

GUARDS TO BE DESIGNED NOT TO FACILITATE CLIMBING AND PROVIDING MAX. OPENING CONFORMING TO O.B.C. 9.8.8.5, & 9.8.8.6, AND BE ABLE TO RESIST LOADS AS PER TABLE 9.8.8.2.

12

SILL PLATES

2"x4" (38x89) SILL PLATE WITH 1/2" (12.7) Ø ANCHOR BOLTS 8" (200) LONG, EMBEDDED MIN. 4" (100) INTO CONC. @ 4'-0" (1220) O.C. CAULKING OR GASKET BETWEEN PLATE AND TOP OF FOUNDATION WALL. USE NON-SHRINK GROUT TO FILL JOINTS. PROVIDE 2"x6" (38x140) STUDS @ 24" (610) O.C. MAX. BETWEEN FLOOR JOISTS WHEN NON-ADJACENT WALLS ARE PARALLEL TO FLOOR JOISTS.

13

BASEMENT INSULATION (9.8-12) 3.1.1.7

PROVIDE CONTINUOUS BLANKET INSULATION W/ BUILT IN 6 MIL POLYETHYLENE VAPOUR BARRIER. INSULATION TO EXTEND NO MORE THAN 8" (200) ABOVE FINISHED BASEMENT FLOOR. DAMPROOFED WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE LEVEL.

14

BEARING STUD PARTITION IN BASEMENT (9.15.3.6, 9.23.10.1)

2"x4" (38x89) STUDS @ 16" (406) O.C., 2"x4" (38x89) SILL PLATE (2"x6" (38x140) AS REQUIRED) ON DAMPROOFING MATERIAL. 2"x4" (38x89) STUDS @ 16" (406) O.C. FOR 2 STORY AND 1/2" (305) O.C. FOR 3 STORY. NON-BEARING PARTITIONS 2"x4" (38x89) @ 24" (610) O.C. FROM TOP OF STUD TO TOP OF STUD. TOP OF STUD TO TOP OF STUD, 1/2" (12.7) INT. DRYWALL, BOTH SIDES OF STUDS, PROVIDE 2"x6" (38x140) STUDS WHERE NOTED. PROVIDE 2"x4" (38x89) WOOD BLOCKING ON PLAT @ 2'-11" (514) O.C. MAX. BETWEEN FLOOR JOISTS WHEN NON-ADJACENT WALLS ARE PARALLEL TO FLOOR JOISTS.

15

ADJUSTABLE STEEL BASEMENT COLUMN (9.15.3.4)

3-1/2" (90) Ø MAX. SPAN BETWEEN COLUMNS, 3'-1/2" (90) Ø SINGLE TUBE ADJUSTABLE STEEL COLUMN CONFORMING TO CAN/C89S7-21, AND WITH 6"x6"x3/8" (152x152x9.5) STEEL TOP PLATE & 6"x6"x3/8" (152x152x9.5) BOTTOM PLATE. COLUMN CONNECTION, POURED CONCRETE FOOTING ON NATURAL UNDISTURBED SOIL, OF 125PA S.L.S. OR COMPACTED ENGINEERED FILL WITH MIN. BEARING CAPACITY OF 125PA S.L.S. AS PER SLOTTED REPORT.

15A

NON-ADJUSTABLE STEEL BASEMENT COLUMN

3-1/2" (90) Ø X 10'-18" (4.78) NON-ADJUSTABLE STEEL COLUMN WITH 6"x6"x3/8" (152x152x9.5) STEEL TOP PLATE & 6"x6"x3/8" (152x152x9.5) BOTTOM PLATE. BASE PLATE 4'-12"x10'x1/2" (120x250x12.7) WITH 2-1/2"x10'x1/2" LONG x 2" HOOK ANCHORS (2-12.70x305x50), FIELD WELD COLUMN TO BASE PLATE & STEEL BM. SUPPORTING 2 STOREY FLR. LOAD PROVIDE 42x48x1/4" (1067x1070x6.3) CONC. FOOTING SUPPORTING 3 STOREY FLR. LOAD PROVIDE 48x48x1/4" (1220x1220x6.3) CONC. FOOTING

15B

NON-ADJUSTABLE STL. COLUMN AT FOUNDATION WALL

3-1/2" (90) Ø X 10'-18" (4.78) NON-ADJUSTABLE STEEL COLUMN WITH 6"x6"x3/8" (152x152x9.5) STEEL TOP PLATE & 6"x6"x3/8" (152x152x9.5) BOTTOM PLATE. BASE PLATE 4'-12"x10'x1/2" (120x250x12.7) WITH 2-1/2"x10'x1/2" LONG x 2" HOOK ANCHORS (2-12.70x305x50), FIELD WELD COLUMN TO BASE PLATE & STEEL BM. SUPPORTING 2 STOREY FLR. LOAD PROVIDE 42x48x1/4" (1067x1070x6.3) CONC. FOOTING SUPPORTING 3 STOREY FLR. LOAD PROVIDE 48x48x1/4" (1220x1220x6.3) CONC. FOOTING

16

STEEL BEAM BEARING AT FOUNDATION WALL (9.23.8.1)

BEAM POCKET OR 8"x8" (200x200) POURED CONC. NB WALLS, MIN. BEARING 3'-12" (90)

17

WOOD STRAPPING AT STEEL BEAMS (9.23.4.3, (3), 9.23.9.3)

1"x3" (19x64) CONTIN. WOOD STRAPPING BOTH SIDES OF STEEL BEAM.

18

GARAGE SLAB (9.16, 9.35)

4" (100) 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 3" (76) COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL, SLOPE TO FRONT @ 1% MIN.

19

GARAGE TO HOUSE WALLS/CEILING (9.10.16.6)

1/2" (12.7) GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE, PLUS REQUIRED INSULATION IN WALLS AND SPRAY FOAM FOR CEILINGS. TAPE AND SEAL ALL JOINTS GAS TIGHT. (9.10.17.10, CANULC-S705.2)

19A

GARAGE TO HOUSE WALLS/CEILING W/ CONTIN. INSULATION

1/2" (12.7) GYPSUM BOARD ON CEILING AND ON WALLS INSTALLED OVER EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPE) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS ON 3/8" EXTERIOR GRADE SHEATHING ON STUDS BETWEEN HOUSE AND GARAGE, PLUS REQUIRED INSULATION IN WALLS & SPRAY FOAM FOR CEILINGS. TAPE AND SEAL ALL JOINTS GAS TIGHT. (9.10.16.6, 9.10.17.10, CANULC-S705.2)

20

GARAGE DOOR TO HOUSE (9.10.13.6, 9.10.13.10, 9.10.13.15)

GAS-PROOF DOOR AND FRAME, DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHER STRIPPING.

21

EXTERIOR AND GARAGE STEPS

PRECAST CONC. STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX. RISE 7'-0" (200), MAX. TREAD 9'-1/4" (235), FOR THE REQUIRED NUMBER OF STEPS REFER TO SITING AND GRADING DRAWINGS. EXTERIOR CONCRETE STAIRS WITH MORE THAN 2 RISERS AND 2 TREADS SHALL BE PROVIDED W/ RIGID INSULATION AS REQUIRED BY ARTICLE 9.8.9.2, OR SHALL BE CANTILEVERED FROM THE FOUNDATION. (9.8.10)

22

DRYER EXHAUST

CAPPED DRYER EXHAUST VENTED TO EXT. CONFORMING TO PART 6, OBC

23

ATTIC ACCESS (9.19.2.1)

ATTIC ACCESS WITH MIN. AREA OF 0.32m² AND NO DIM. LESS THAN 21" (534) WITH WEATHER STRIPPING, HATCHWAYS TO THE ATTIC OR ROOF SPACE WILL BE FITTED WITH DOORS OR COVERS AND WILL BE INSULATED WITH MIN. R20 (3.52) (S56-12) 3.1.1.8, (11)

24

FIREPLACE CHIMNEYS (9.2.1)

TOP OF FIREPLACE CHIMNEY SHALL BE 2'-11" (889) ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 2'-0" (610) ABOVE THE ROOF SURFACE WITH AN HORIZ. DISTANCE OF 10'-4" (3154) FROM THE CHIM.

25

LINEN CLOSET

PROVIDE 4 SHELVES MIN. 14" (356) DEEP.

26

MECHANICAL VENTILATION (9.32.1.3)

MECHANICAL EXHAUST FAN VENTED TO EXTERIOR, TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR. SEE GENERAL NOTE 2.3.

27

PARTY WALL BEARING (9.23.8)

12"x12"x5/8" (305x305x15.9) STEEL PLATE FOR STEEL BEAMS AND 12"x12"x1/2" (305x305x12.7) STEEL PLATE FOR WOOD BEAMS BEARING (MIN. 3'-1/2" (89) O.C. BLOCK PARTY WALL ANCHORED WITH 3-1/4" (219) x 8" (200) LONG G ANCHORS WITHIN SOIL & 2'-11" (889) ABOVE FIN. FLOOR. PROVIDE 2"x4" (38x89) REFER TO NOTE SLOD BEARING (SECTION 3.0) FOR W/OD STUD PARTY WALL.

28

WOOD FRAMING IN CONTACT TO CONCRETE

WOOD BEARING WALLS, THE UNDERSIDE OF BUILT-UP WOOD POSTS AND SILLS SHALL BE WRAPPED WITH 2 mil POLY. STRIP FOOTINGS SUPPORTING THE FOUNDATION WALL SHALL BE WIDENED @ 1/2" (12.7) BELOW THE BEARING WALL AND WOOD POST (9.17.4.3)

29

BUILT-UP WOOD POST AND FOOTING (9.17.4.1, 9.15.3.7)

3-2"x6" (38x140) BUILT-UP WOOD POST (UNLESS OTHERWISE NOTED) ON METAL BASE SHOE ANCHORED TO CONC. WITH 1/2" (12.7) Ø BOLT. 2"x6"x24" (610x160x305) CONC. FOOTING OR AS PROVIDED ON PLAN. REFER TO NOTE SLOD BEARING (SECTION 3.0) FOR W/OD STUD PARTY WALL.

30

STEP FOOTINGS (9.15.3.9)

MIN. HORIZ. STEP = 23'-8" (660), MAX. VERT. STEP = 23'-8" (660).

31

CONC. PORCH SLAB (9.16.4)

MIN. 4" (100) CONCRETE SLAB ON GRADE ON 4" (100) COARSE GRANULAR FILL, REINFORCED WITH 6x6x24x3/8x29 MESH PLAND FROM MID-DEPTH OF SLAB. CONC. STRENGTH 32MPa (4640psi) WITH 5-8% AIR ENTRAINMENT ON CONTACTED SUB-BASE OR NATIVE FILL.

32

FURNACE VENTING (9.32.1)

DIRECT VENT FURNACE EXHAUST 3" (76) (9.15) FROM A GAS REGULATOR UNDER THE 3RD FLOOR, FROM ALL OPENINGS, EXHAUST AND INTAKE VENTS, HRV INTAKE TO BE A MIN. OF 6"-Ø (153) FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.

33

FIREPLACE VENTING (9.32.3)

DIRECT VENT GAS FIREPLACE VENT TO BE A MIN. 1/2" (305) FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

34

FLOOR FRAMING (9.23.3.5, 9.23.3.4, 9.23.14)

T&G SUBFLOOR ON WOOD FLOOR JOISTS. FOR CERAMIC TILE APPLICATION SEE O.B.C. 9.23.6. ALL JOISTS WERE REQUIRED TO BE BRIDGED WITH 2"x2" (38x38) CROSS BRACING OR SOLID BLOCKING @ 2'-0" (610) O.C. MAX. ALL JOISTS TO BE STRAPPED WITH 1"x3" (19x64) @ 6'-11" (2108) O.C. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED.

34A

HEADER CONSTRUCTION

PROVIDE CONTINUOUS APPROVED AIRVAPOUR BARRIER (HEADER WRAP) UNDER THE 3RD FLOOR, ABOVE THE FIRM BOARD AND UNDER THE BOTTOM PLATE. THE HEADER WRAP SHALL EXTEND @ 1/2" (12.7) BELOW THE TOP OF FOUNDATION WALL AND WILL BE SEALED TO THE CONCRETE FOUNDATION WALL. EXTEND HEADER WRAP @ 1/2" (12.7) INTO THE INTERIOR SIDE OF THE STUD WALL AND OVERLAP WITH THE VAPOUR BARRIER AND SEAL THE JOINT. ALL EDGES/JOINTS SHALL BE MECHANICALLY CLAMPED.

35

EXPOSED BUILDING FACE w/ LIMITING DISTANCE <= 3'-11" (1.20m)

WALL ASSEMBLY CONTAINS INSULATION CONFORMING TO CANULC-S705.2 A MASS OF NOT LESS THAN 1.22 KG/M² OF WALL SURFACE AND 1/2" (12.7) TYPE GYPSUM WALLBOARD INTERIOR FINISH. EXTERIOR CLADDING MUST BE NON-FLAMMABLE. MINIMUM CRISTLE WALL ASSEMBLY SHALL BE NOT LESS THAN MINUTES & CONFORMING TO O.B.C. 9.10.14, OR 9.10.15. REFER TO DETAILS FOR TYPE & SPEC. ** AN OPENING IN AN EXPOSING BUILDING FACE NOT MORE THAN 20' (610) (13m²) SHALL NOT BE CONSIDERED AN UNPROTECTED OPENING AS PER 9.10.14

36

COLD CELLAR PORCH SLAB (9.39)

FOR MAX. 8'-2" (250) PORCH DEPTH, 5" (127) 32 MPa (4640psi) CONC. SLAB W/ 5-8% AIR ENTRAINMENT, REIN. WITH 10M BARS @ 7'-0" (200) O.C. EACH DIRECTION, W/ 1'-1/4" (32) CLEAR COVER FROM BOTTOM OF SLAB TO FIRST LAYER OF BARS & SECOND LAYER OF BARS LAD DIRECTLY ON TOP OF LOWER LAYER IN OPPOSITE DIR. 2"x24" (610x610) 10M DOWELS @ 23'-8" (660) O.C. ANCHORED IN EXIST. FLOOR. W/OD CONC. SLAB 1" (25) FROM DOOR.

37

RANGE HOODS AND RANGE-TOO FANS

COOKING APPLIANCE EXHAUST FANS VENTED TO EXTERIOR MUST CONFORM TO OBC 9.10.22, 9.32.3.9, & 9.32.3.10

38

CONVENTIONAL ROOF FRAMING (9.23.13, 9.23.15)

2"x6" (38x140) RAFTERS @ 16" (406) O.C., 2"x8" (38x184) RIDGE BOARD, 2"x4" (38x89) COLLAR TIES AT MID-SPAN, CEILING JOISTS TO BE 2"x4" (38x89) @ 16" (406) O.C. FOR MAX. 9'-3" (2819) SPAN & 2"x6" (38x140) @ 16" (406) O.C. FOR MAX. SPAN 14'-7" (4490) SPAN. PROVIDE BUILT UP ROOF OVER PRE-ENGINEERED ROOF TRUSSES AND OR CONVENTIONAL FRAMING TO BE 2"x4" (38x89) @ 24" (610) O.C. UNLESS OTHERWISE SPECIFIED.

39

TWO STOREY VOLUME SPACES (9.23.10.1, 9.23.1.1, 9.23.16)

WALL ASSEMBLY	WIND LOADS	
	<= 0.5 kPa (HGHT)	> 0.5 kPa (HGHT)
EXTERIOR STUDS	SPACING MAX (HGHT)	SPACING MAX (HGHT)
BRICK (2-38x140)	12" (305) O.C. 18" (458) (5588)	12" (305) O.C. 18" (458) (5588)
SIDING (2-38x140)	16" (406) O.C. 18" (458) (5588)	20" (508) O.C. 18" (458) (5588)
BRICK (2-28x184)	12" (305) O.C. 21" (530) (6400)	12" (305) O.C. 21" (530) (6400)
SIDING (2-38x184) SPR, 42"	16" (406) O.C. 21" (530) (6400)	16" (406) O.C. 21" (530) (6400)

** STUD SIZE & SPACING TO BE VERIFIED BY STRUCTURAL ENGINEER **

40


STUDS ARE TO BE CONTINUOUS, C/W 3/8" (9.5) THICK EXTERIOR PLYWOOD SHEATHING, PROVIDE SOLID WOOD BLOCKING BETWEEN WOOD STUDS @ 4'-0" (1200) O.C. VERTICALLY.

-FOR ROOF, DISTANCES LESS THAN 9'-6" (2886) PROVIDE 2"x6" (38x140) STUDS @ 16" (406) O.C. WITH CONTIN. 2"x6" (38x140) TOP PLATE + 1"x24" (18x140) BOTTOM PLATE. C/W OF 3-2"x8" (38x184) CONT. HEADER AT GROUND FLOOR CEILING LEVEL. TOE-NAILLED & GUSSED AT TOP, BOTTOM PLATES & HEADERS.


STAMP

cont. SECTION 1.0. CONSTRUCTION NOTES


40	1 HR. PARTY WALL (CONC. BLOCK) (9.8-3) WALL TYPE 966 & (B10) 1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2"x2" (38x38) VERTICAL W.D. STRAPPING @ 24" (610) O.C. ON 8" (200) CONC. BLOCK FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE FILL & SAND ALL GYPSUM JOINTS. EXPOSED BLOCK MUST BE SEALED W/ 2 COATS OF PAINT OR FURRED WITH 2"x2" (38x38) WOOD STRAPPING & 1/2" (12.7) GYPSUM SHEATHING.
40 OBS. STUO	1 HR. PARTY WALL (DOUBLE STUD) (9.8-3) WALL TYPE 753(3) 5/8" (15.9) TYPE 'X' GYPSUM SHEATHING ON EXTERIOR SIDE OF 2 ROWS OF 2"x4" (38x89) STUDS @ 16" (406) O.C. MIN. 1 (25) APART ON SEPARATE 2"x4" (38x89) SILL PLATES. 1/2"x6" (38x140) AS REQUIRED) FILL ONE SIDE OF STUD CAVITY WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE FILL AND SAND ALL GYPSUM JOINTS.
40A	2 HR. FIREWALL (9.8-3) WALL TYPE 966 & (B10) 1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2"x2" (38x38) VERTICAL WOOD STRAPPING @ 24" (610) O.C. ON 8" (200) CONC. BLOCK 75% SOLID FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS. TAPE FILL & SAND ALL GYPSUM JOINTS. AT UNFINISHED AREAS, EXTERIOR FACE OF CONC. BLOCK TO BE SEALED WITH 2 COATS OF PAINT. GYPSUM SHEATHING TO BE ATTACHED TO CONC. BLOCK. (REFER TO DETAILS)
41	STUCCO WALL CONSTRUCTION STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28. AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1/2" (38) E.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BOARD ON STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., INSULATION, APPROVED 6 MIL POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED)
41A	STUCCO WALL CONSTRUCTION W/ CONTIN. INSULATION STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28. AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1/2" (38) E.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON APPROVED AIR/WATER BARRIER AS PER O.B.C. 9.27.3. ON EXTERIOR TYPE RIGID INSULATION (JOINTS UNTAPE) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS, ON 7/16" EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., INSULATION, APPROVED 6 MIL POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED)
41B	STUCCO WALL @ GARAGE CONST. STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28. AND APPLIED PER MANUFACTURERS SPECIFICATIONS OVER 1/2" (38) E.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BRD. ON STUDS CONFORMING TO O.B.C. (9.23.10.1) & SECTION 1.1., 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQ.) *** FOR DWELLINGS USING CONTIN. INSULATION CONSTRUCTION, PROVIDE APPROVED DRAINAGE MAT ON 7/16" (11) EXTERIOR TYPE SHEATHING OVER PURFINS (AS REQ.) AND STUDS IN LIEU OF 1/2" (38) E.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENSGLASS GOLD GYPSUM BRD.
42	UNSUPPORTED FOUNDATION WALLS (9.15.4.2) REINFORCING AT STAIRS AND SUNKEN FLOOR AREAS 2-20M BARS IN TOP PORTION OF WALL, UP TO 8'-0" (2438) OPENING 3-20M BARS IN TOP PORTION OF WALL, 8'-0" TO 10'-0" (2438) OPENING 4-20M BARS IN TOP PORTION OF WALL, 10'-0" TO 10'-0" (2438) OPENING - BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL @ 6" O.C. REINFORCING AT BASEMENT FINISH: 2-15M HORIZ. REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL BELOW THE WIN. SILL. EXTEND BARS 24" (610) BEYOND THE OPENING. 2-15M VERTICAL REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL ON EACH SIDE OF THE WINDOW OPENING. - BARS TO HAVE MIN. 2" (50) CONC. COVER - BARS TO EXTEND 24" (610) BEYOND BOTH SIDES OF OPENING
43	STUD WALL REINFORCEMENT PROVIDE STUD WALL REINFORCEMENT IN MAIN BATHROOM CONFORMING TO O.B.C. (9.5.2.3.1) AND 3.8.3.3.(3) (REFER TO DETAILS)
44	WINDOW WELLS WHERE A WINDOW OPENS INTO A WINDOW WELL, A CLEARANCE OF NOT LESS THAN 21 5/8" (550) SHALL BE PROVIDED IN FRONT OF THE WINDOW. EVERY WINDOW WELL SHALL BE DRAINED TO THE FOOTING LEVEL OR OTHER SUITABLE LOCATION WITH A 4" (100) WEEPING TILE C/W A FILTER CLOTH W/RAFF AND FILLED WITH CRUSHED STONE. (9.9.1.0.1) (5), 9.14.6.3.1)
45	SLOPED CEILING CONSTRUCTION (9.8-12) 2.1.1.7, 9.23.4.2 2"x12" (38x26) ROOF JOISTS @ 16" (406) O.C. MAX. (UNLESS OTHERWISE NOTED) W/ 2"x2" (38x38) PURLINS @ 16" (406) O.C. PERPENDICULAR TO ROOF JOIST (PURLINS NOT REQ. W/ SPRAY FOAM). W/ INSULATION BETWEEN JOIST, 6 MIL POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH OR APPROVED EOC. INSULATION VALUE DIRECTLY ABOVE THE INNER SURFACE OF EXTERIOR WALLS SHALL NOT BE LESS THAN R20 (3.52 RSI).
46	FLAT ROOF/BALCONY CONSTRUCTION WATERPROOFING MEMBRANE (9.26.1.1, 9.26.1.5, 9.26.1.6) FULLY ADHERED TO 5/8" (15.9) T&G EXTERIOR GRADE PLYWOOD SHEATHING ON 2"x2" (38x38) PURLINS ANGLED TOWARDS SCUPPER @ 2% MINIMUM LAP PERPENDICULAR TO 2"x6" (38x184) FLOOR JOISTS @ 16" (406) O.C. (UNLESS OTHERWISE NOTED). BUILT UP CURB TO BE 4" (100) MIN. ABOVE FINISHED BALCONY FLOOR. CONTINUOUS 1" TRIM DRAIN EDGE TO BE PROVIDED ON OUTSIDE FACE OF CURB. SCUPPER DRAIN TO BE LOCATED 24" (610) MIN. AWAY FROM HOUSE. PREFINISHED ALUMINUM OR PANEL FLOOR UNDER SOFFIT (9.23.2.3). REMOVE CURB WHERE REQ.
	BALCONY CONDITION SEE FLAT ROOF/BALCONY CONSTRUCTION NOTE. INCLUDE 2"x4" (38x89) PT. DECKING W/ 1/4" (6.4) GAPS LAID PLAT PARALLEL TO JOISTS ON 2"x4" (38x89) PT. SLEEPERS @ 12" (305) O.C. LAP PLAT PERPENDICULAR TO JOISTS
	BALCONY OVER HEATED SPE CONDITION SEE FLAT ROOF/BALCONY CONSTRUCTION NOTE FOR ASSEMBLY. REFER TO FINISH FOR FLOOR JOIST SIZE & REFER TO HEX NOTE 9 FOR INSULATION AND INTERIOR FINISH
47	BARREL WALL CONSTRUCTION CAST/VENTILATED 2"x4" (38x89) SPACERS LAID FLAT ON 2"x10" (38x235) SPR. #2 ROOF JOIST NAILED TO BUILT-UP 3-3/4" (19) PLYWOOD HEADER PROFILED FOR BARREL. SPRAY FOAM INSULATION BETWEEN JOISTS W/ GYPSUM BOARD. INTERIOR FIN. (REFER TO DETAILS)

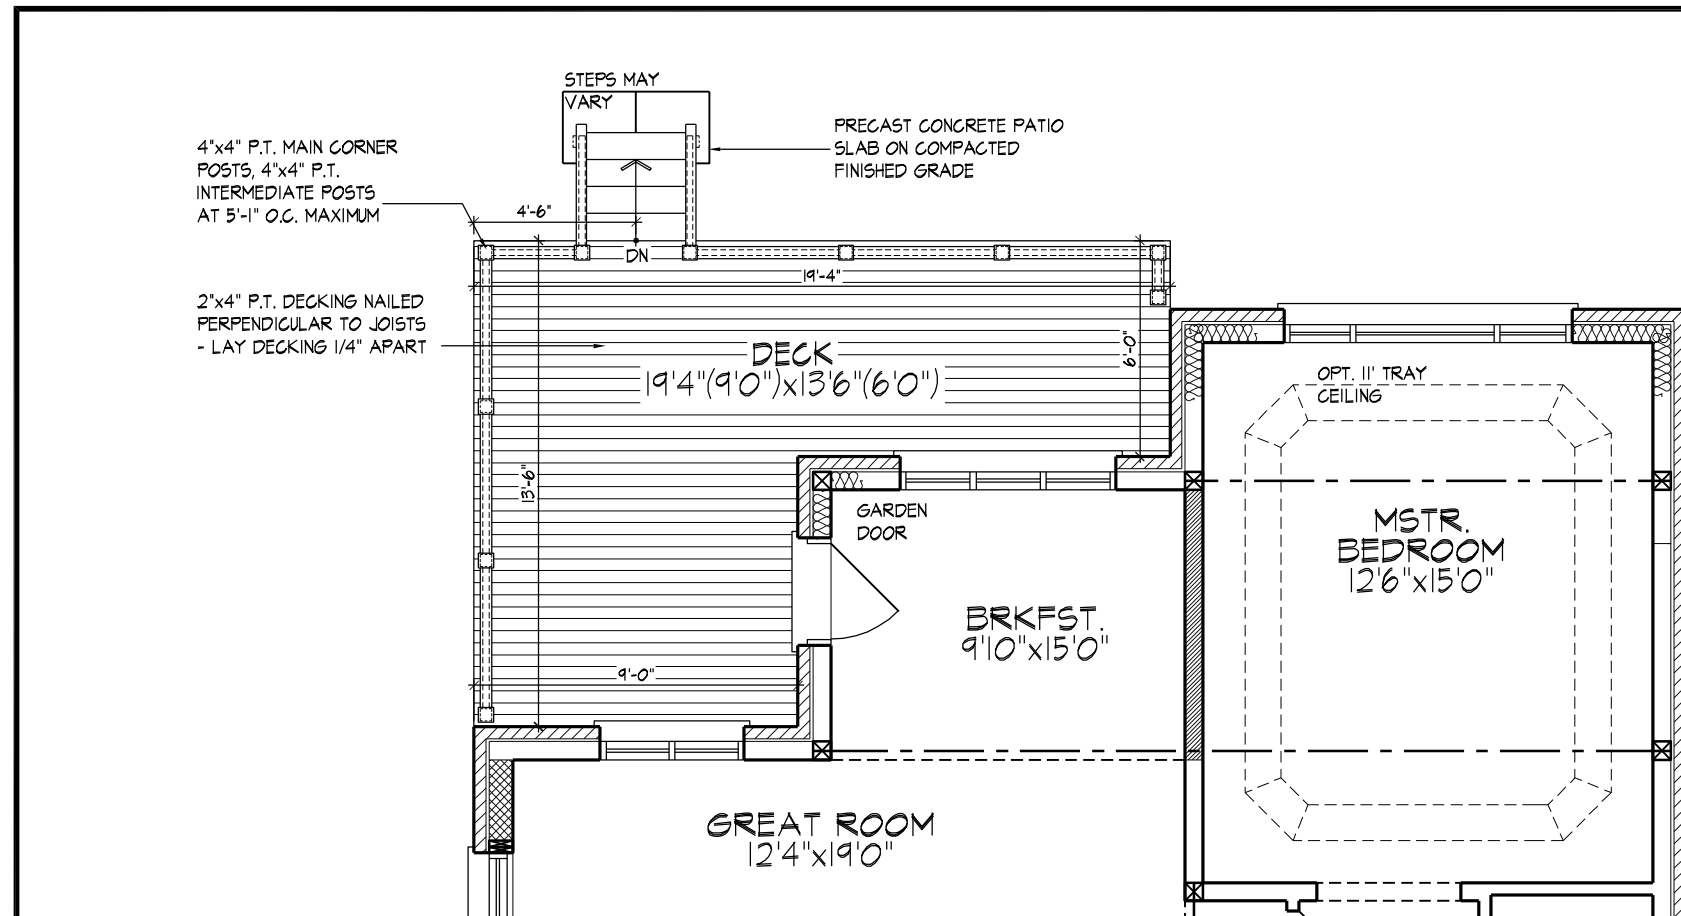


PART. GROUND FLOOR PLAN ELEV. 'A' & 'B' - W.O.D. COND.

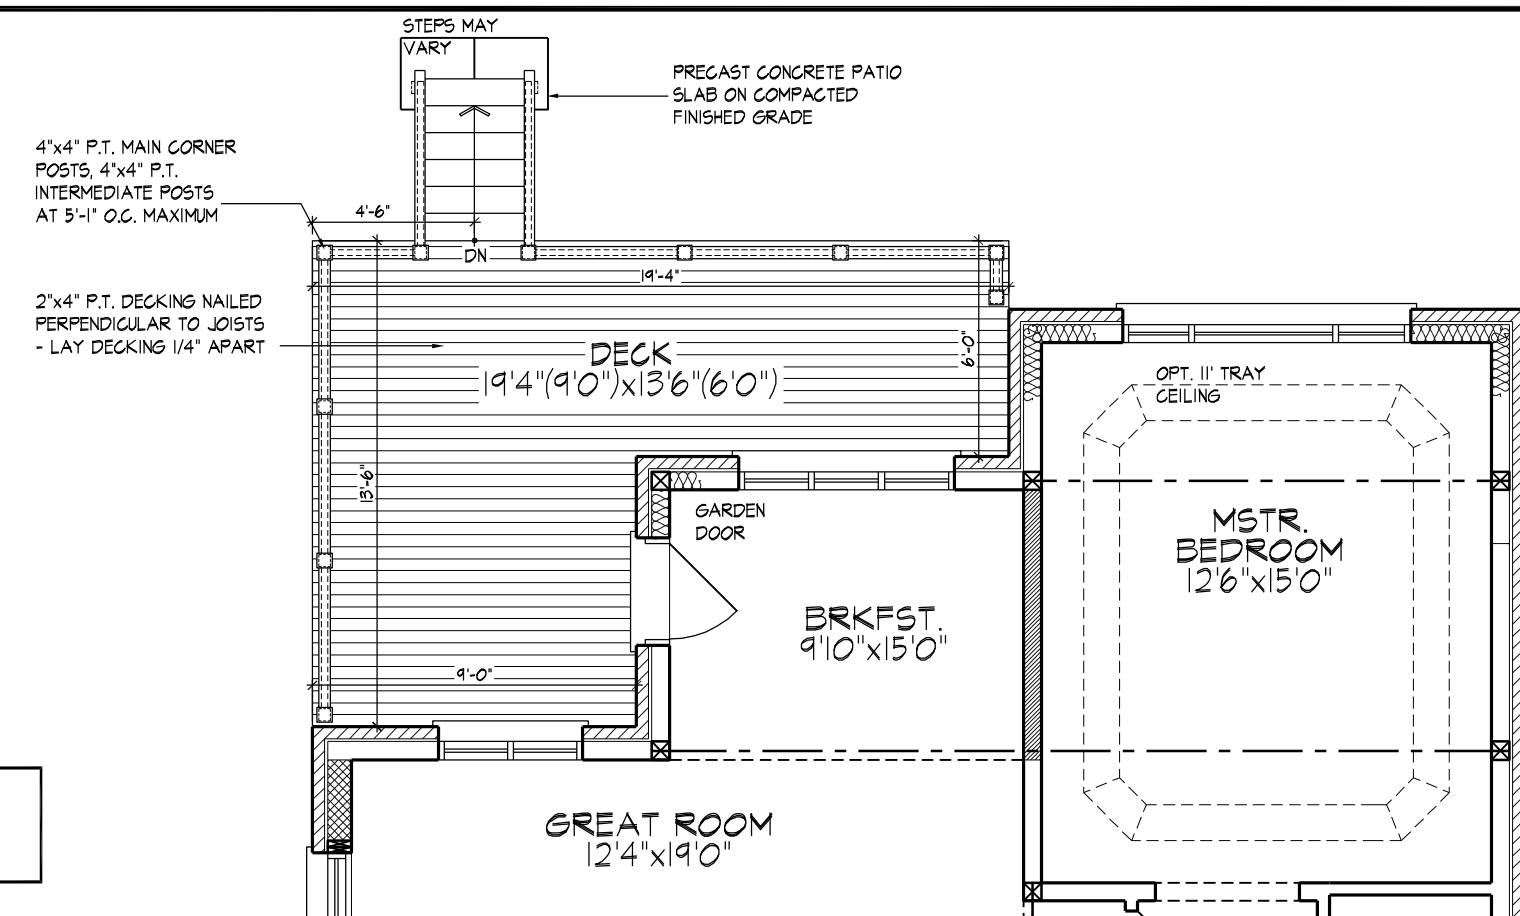

PART. GROUND FLOOR PLAN ELEV. 'A' & 'B' - L.O.D. COND.

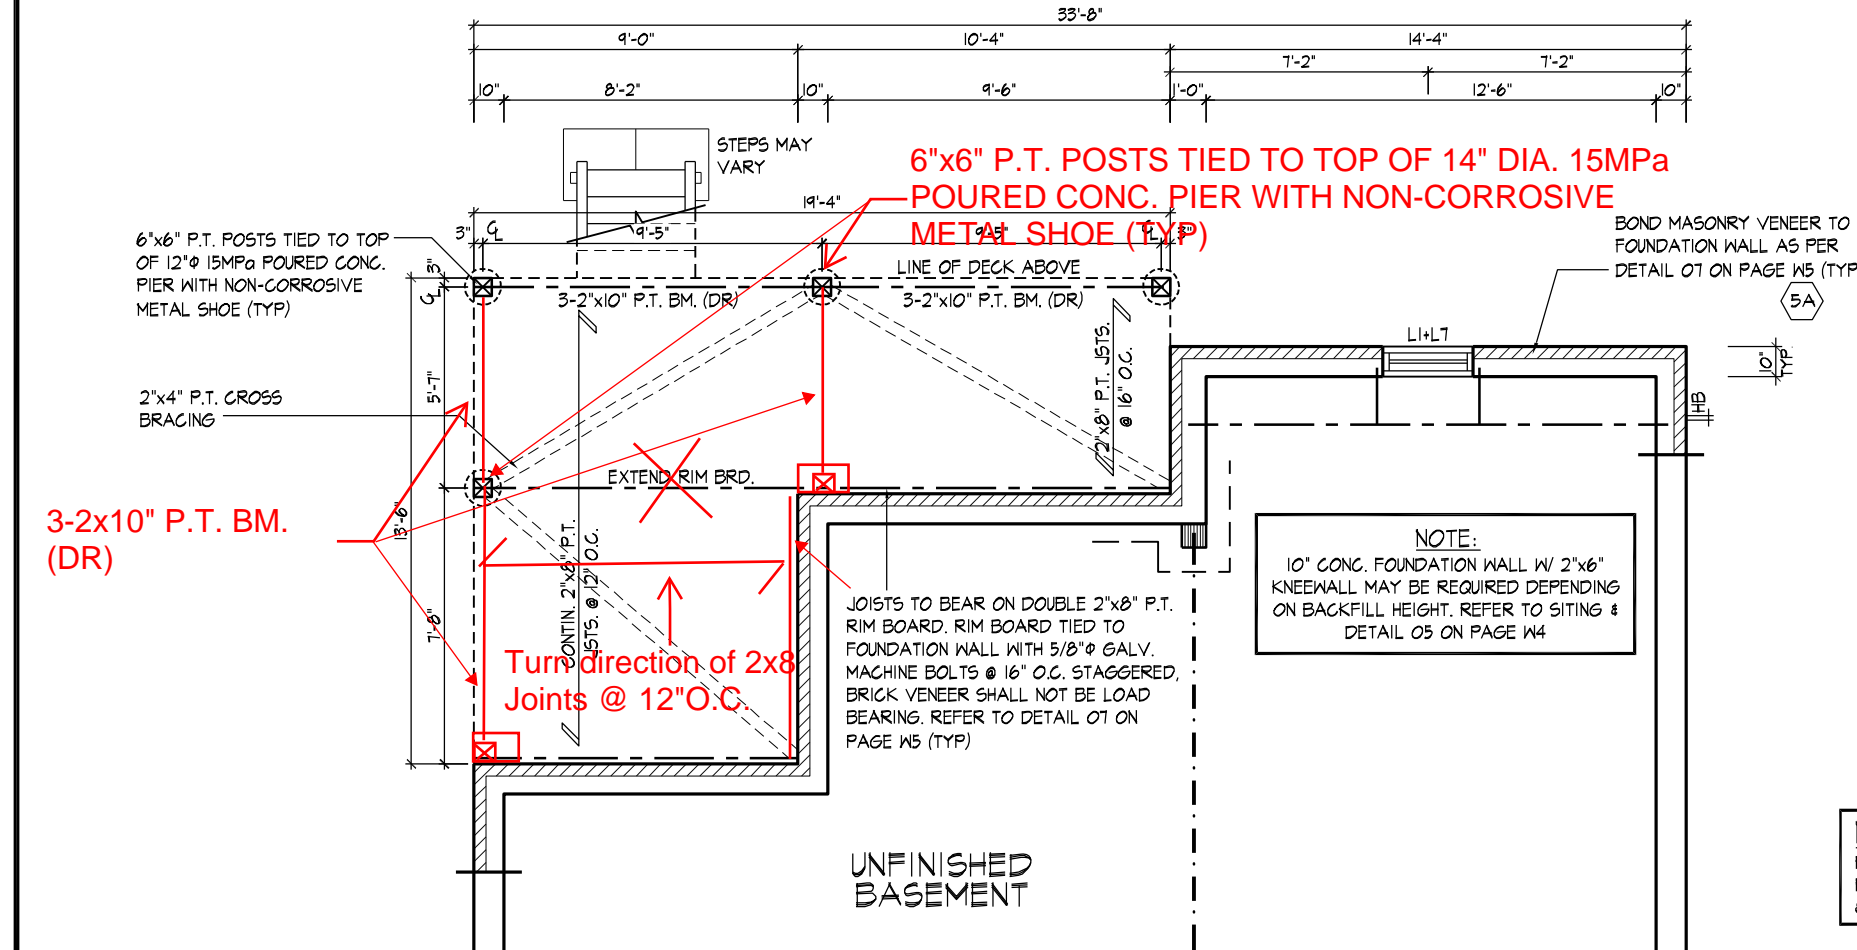

PART. BASEMENT PLAN ELEV. 'A' & 'B' - W.O.D. COND.

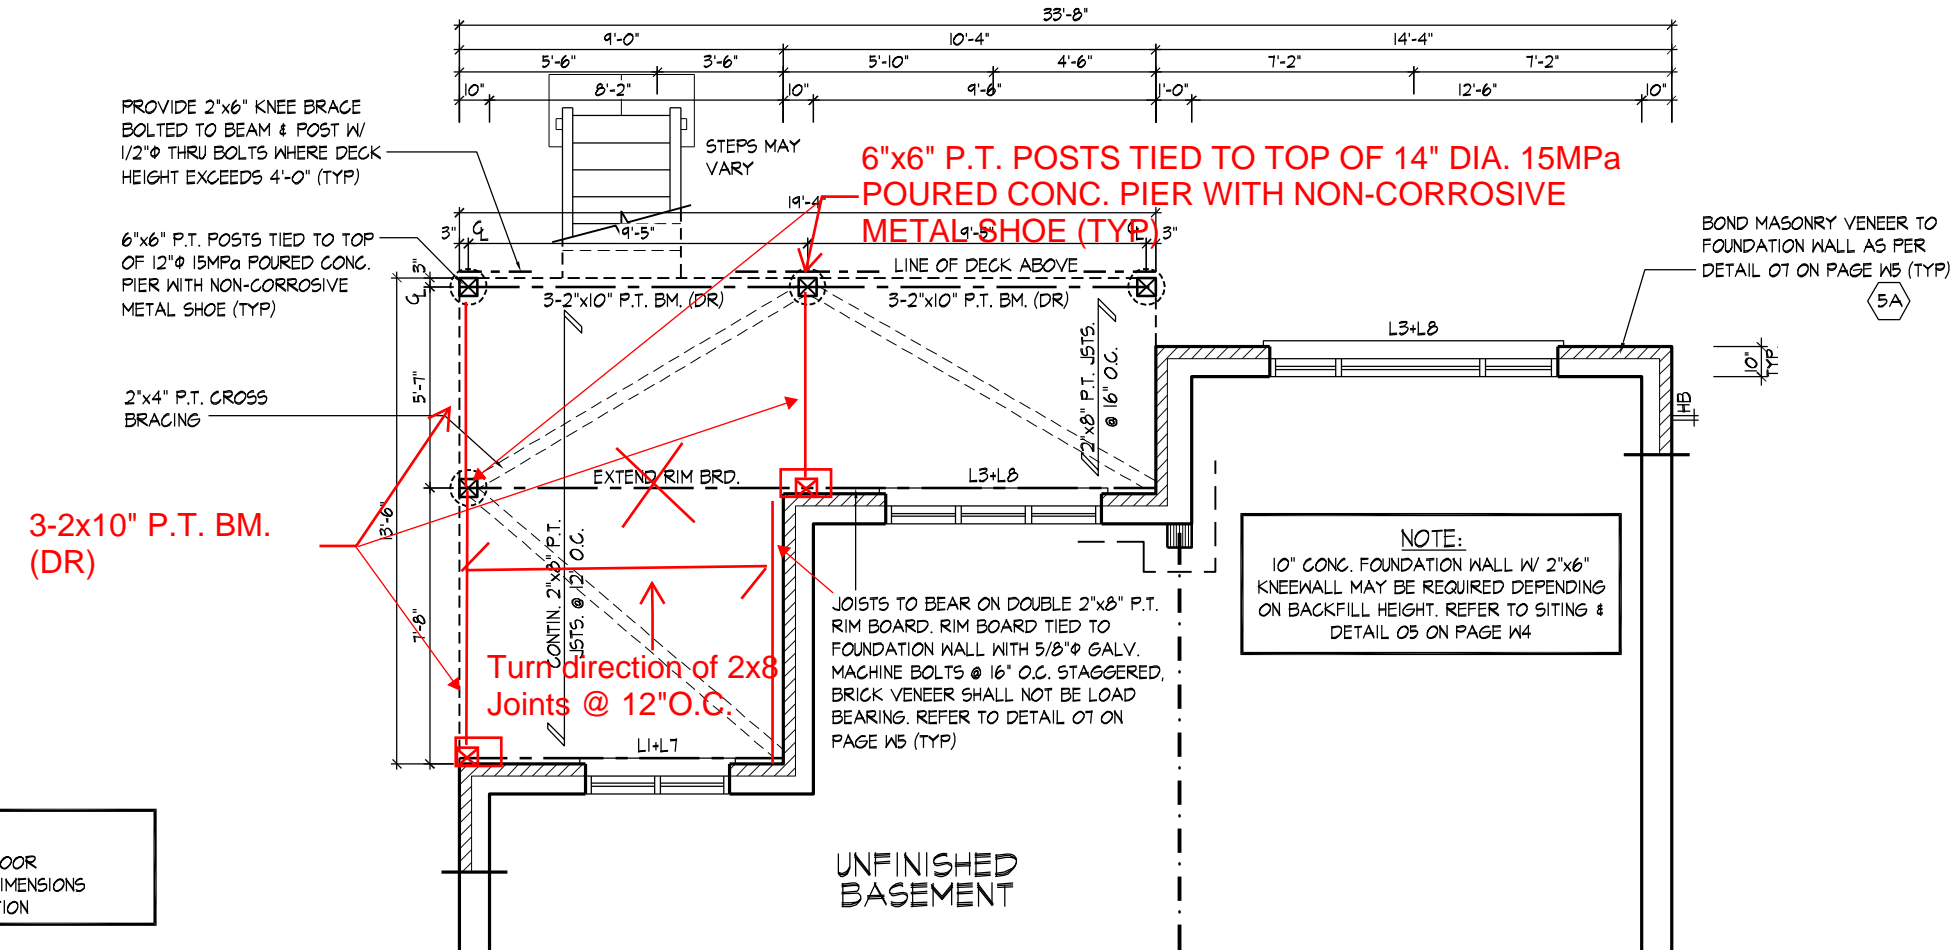

PART. BASEMENT PLAN ELEV. 'A' & 'B' - L.O.D. COND.



PART. REAR ELEVATION 'A' & 'B' - W.O.D. CONDITION



PART. REAR ELEVATION 'A' & 'B' - L.O.D. CONDITION

REFER TO FRONT ELEVATION & STANDARD REAR FOR TYPICAL NOTES & INFO.

REFER TO FRONT ELEVATION & STANDARD REAR FOR TYPICAL NOTES & INFO.

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

NAME: Olin Fairbairn
SIGNATURE: [Signature]
REGISTRATION INFORMATION: BCN
HUNT DESIGN ASSOCIATES INC. 19695

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCN number and original signature).

HUNT
DESIGN ASSOCIATES INC.
www.huntdesign.ca

GOLDPARK HOMES - 217020
PINE VALLEY, VAUGHAN ONT.

Down By: OF
Checked By: OF
Scale: 3/16"=1'-0"

DECK CONDITIONS
UNIT 4201 - THE MAPLEWOOD
REV.2018/06/14


File Number: 217020WS4201
Page Number: W1 of W4

PART. BASEMENT PLAN ELEV. 'A', & 'B' - W.O.B. COND.


PART. GROUND FLOOR PLAN ELEV. 'A', & 'B' - W.O.B. COND.

NOTE:
REFER TO STANDARD FLOOR
PLANS FOR COMPLETE DIMENSIONS
& STRUCTURAL INFORMATION


PART. BASEMENT PLAN ELEV. 'A', & 'B' - W.O.B. COND.

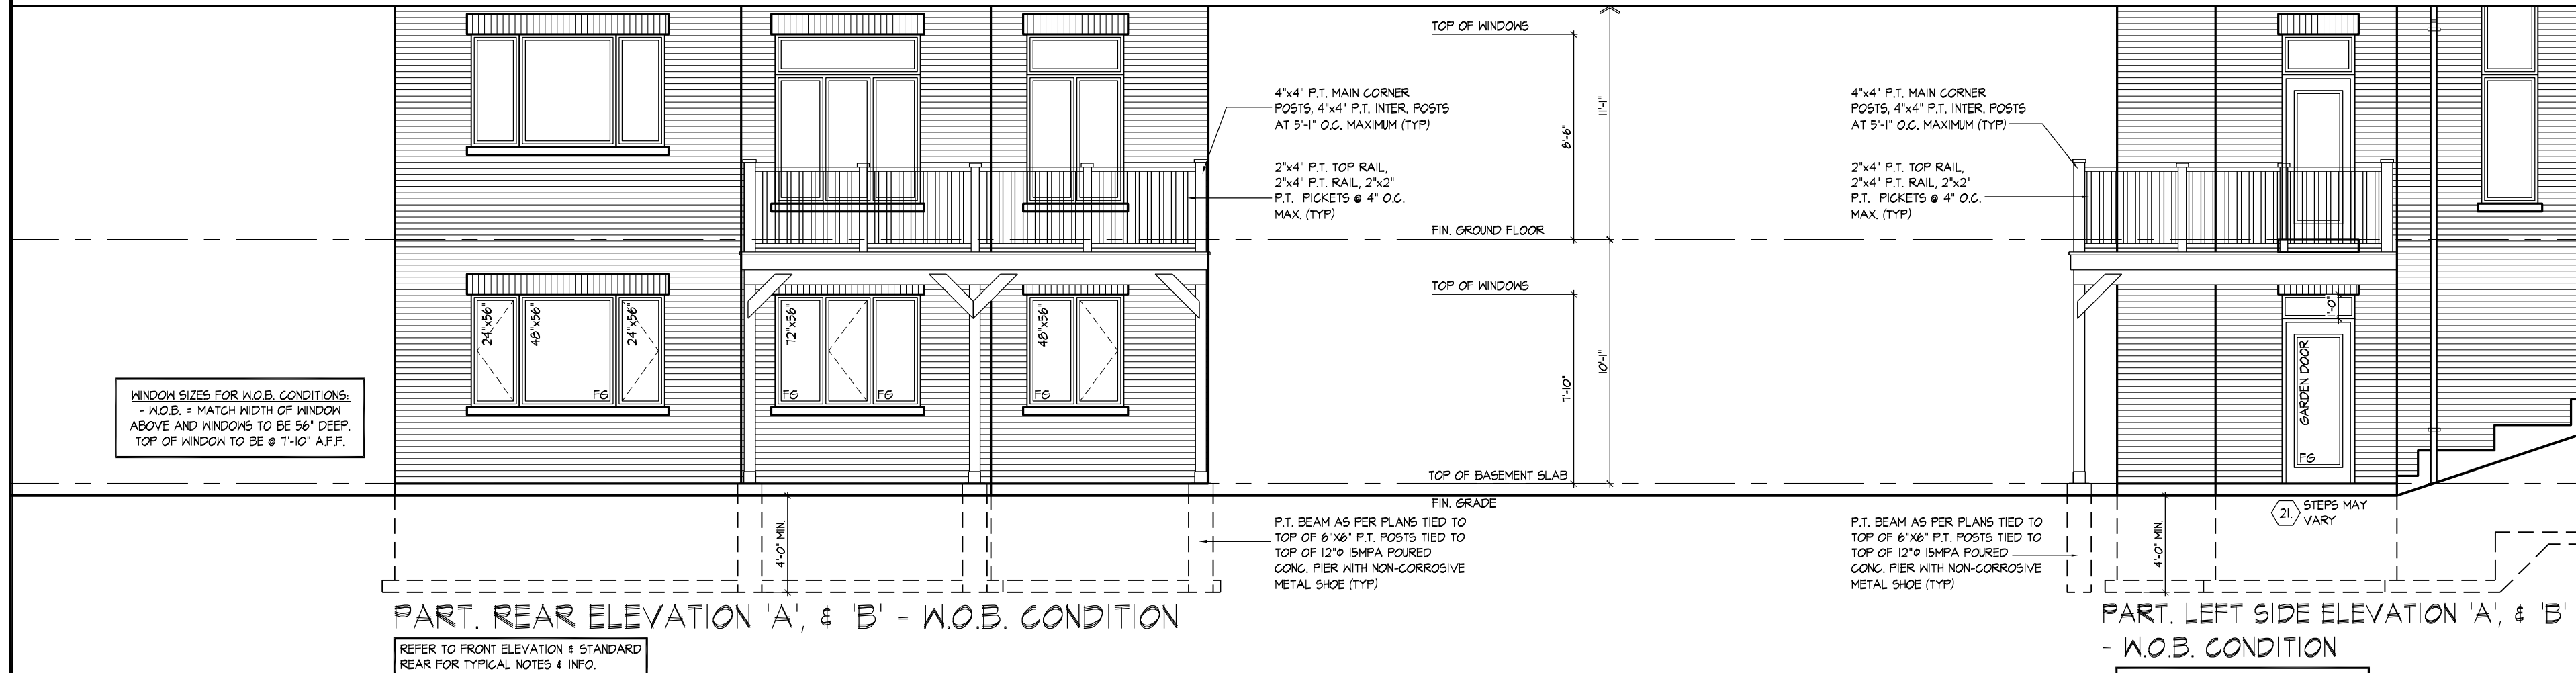


8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

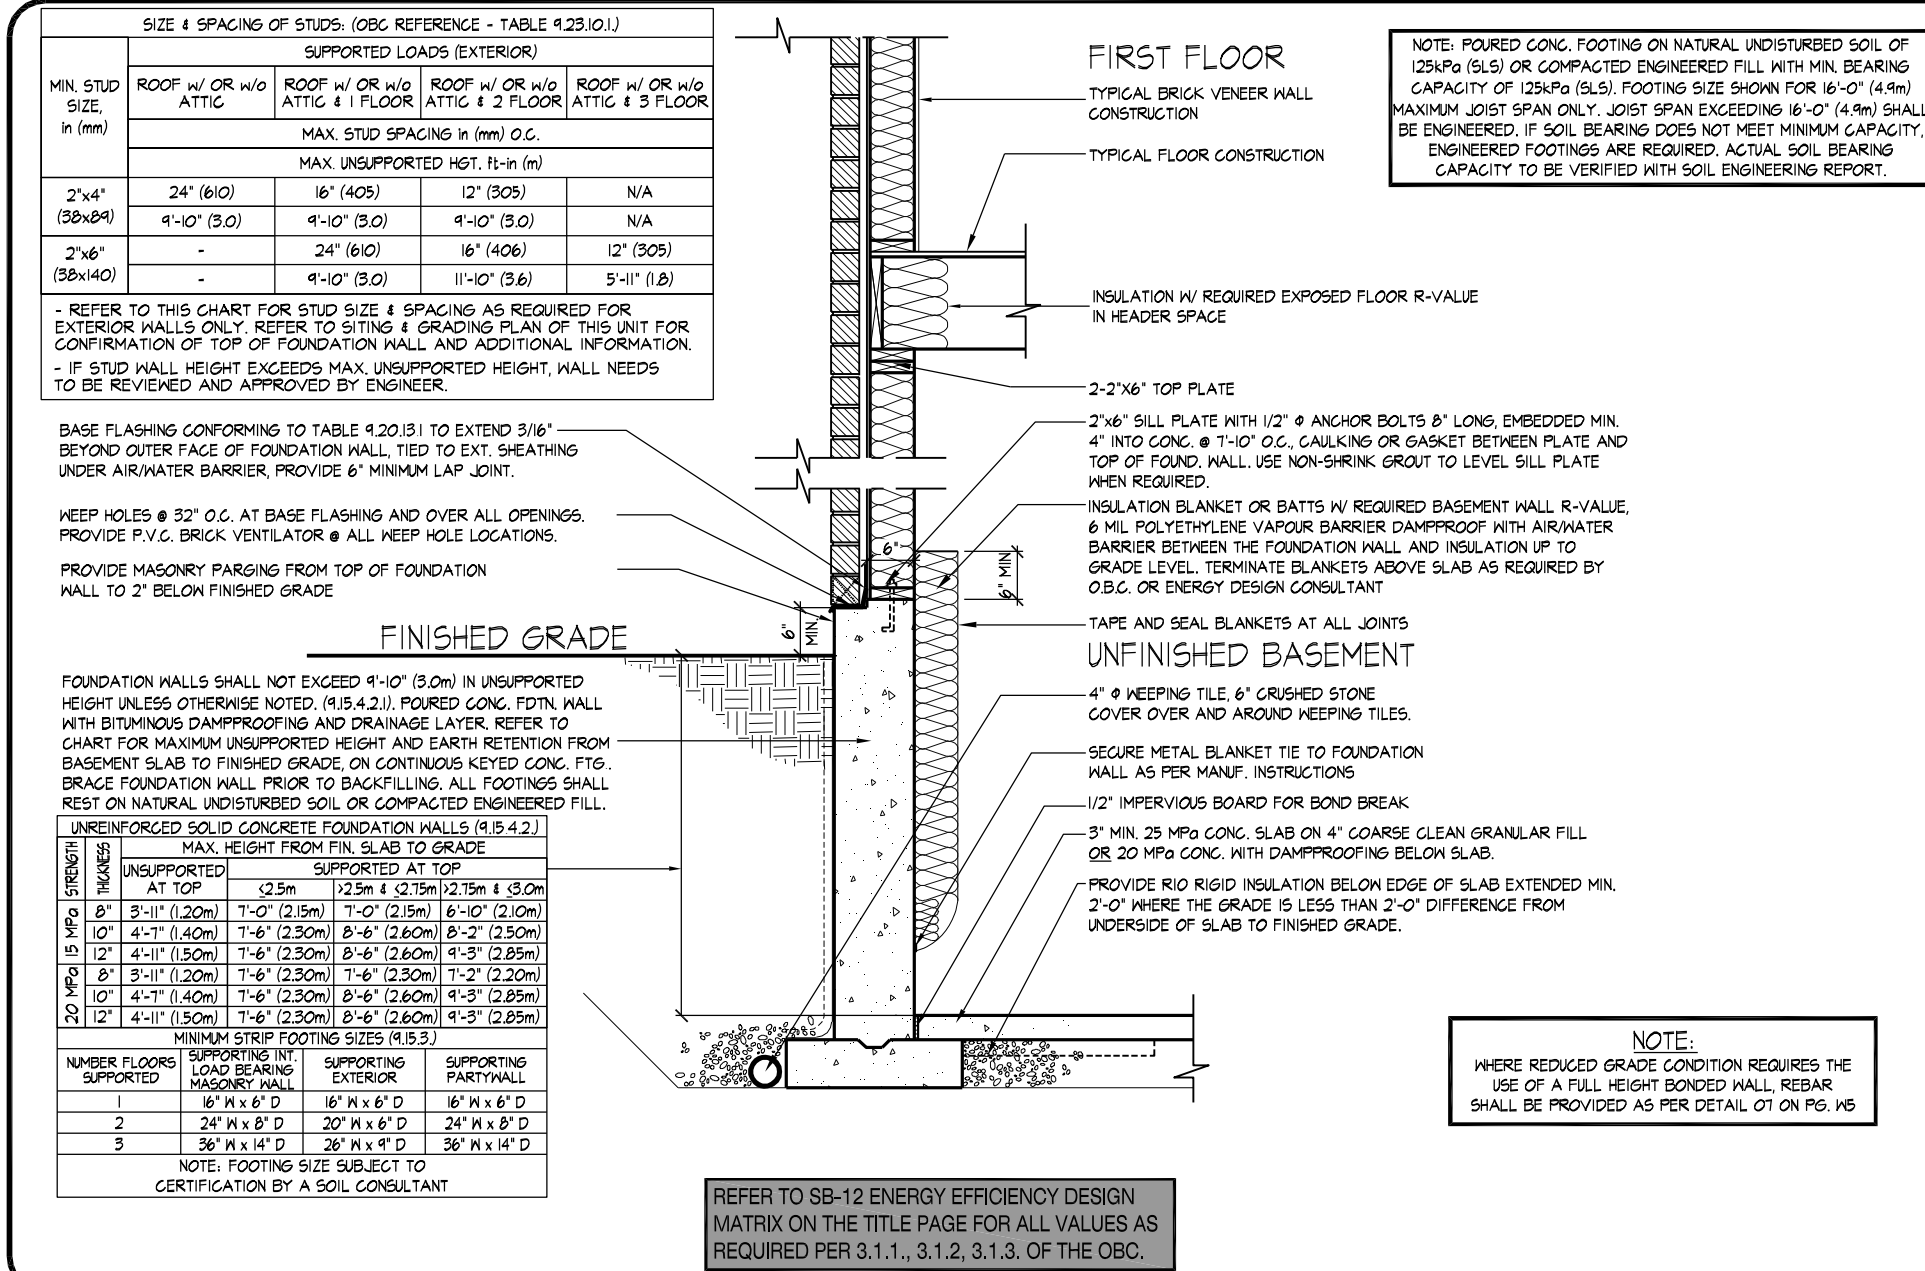


05 MASONRY VENEER, 2"x6" STUDS, 10" FOUNDATION WALL Laterally UNSUPPORTED
1/2" = 1'-0"

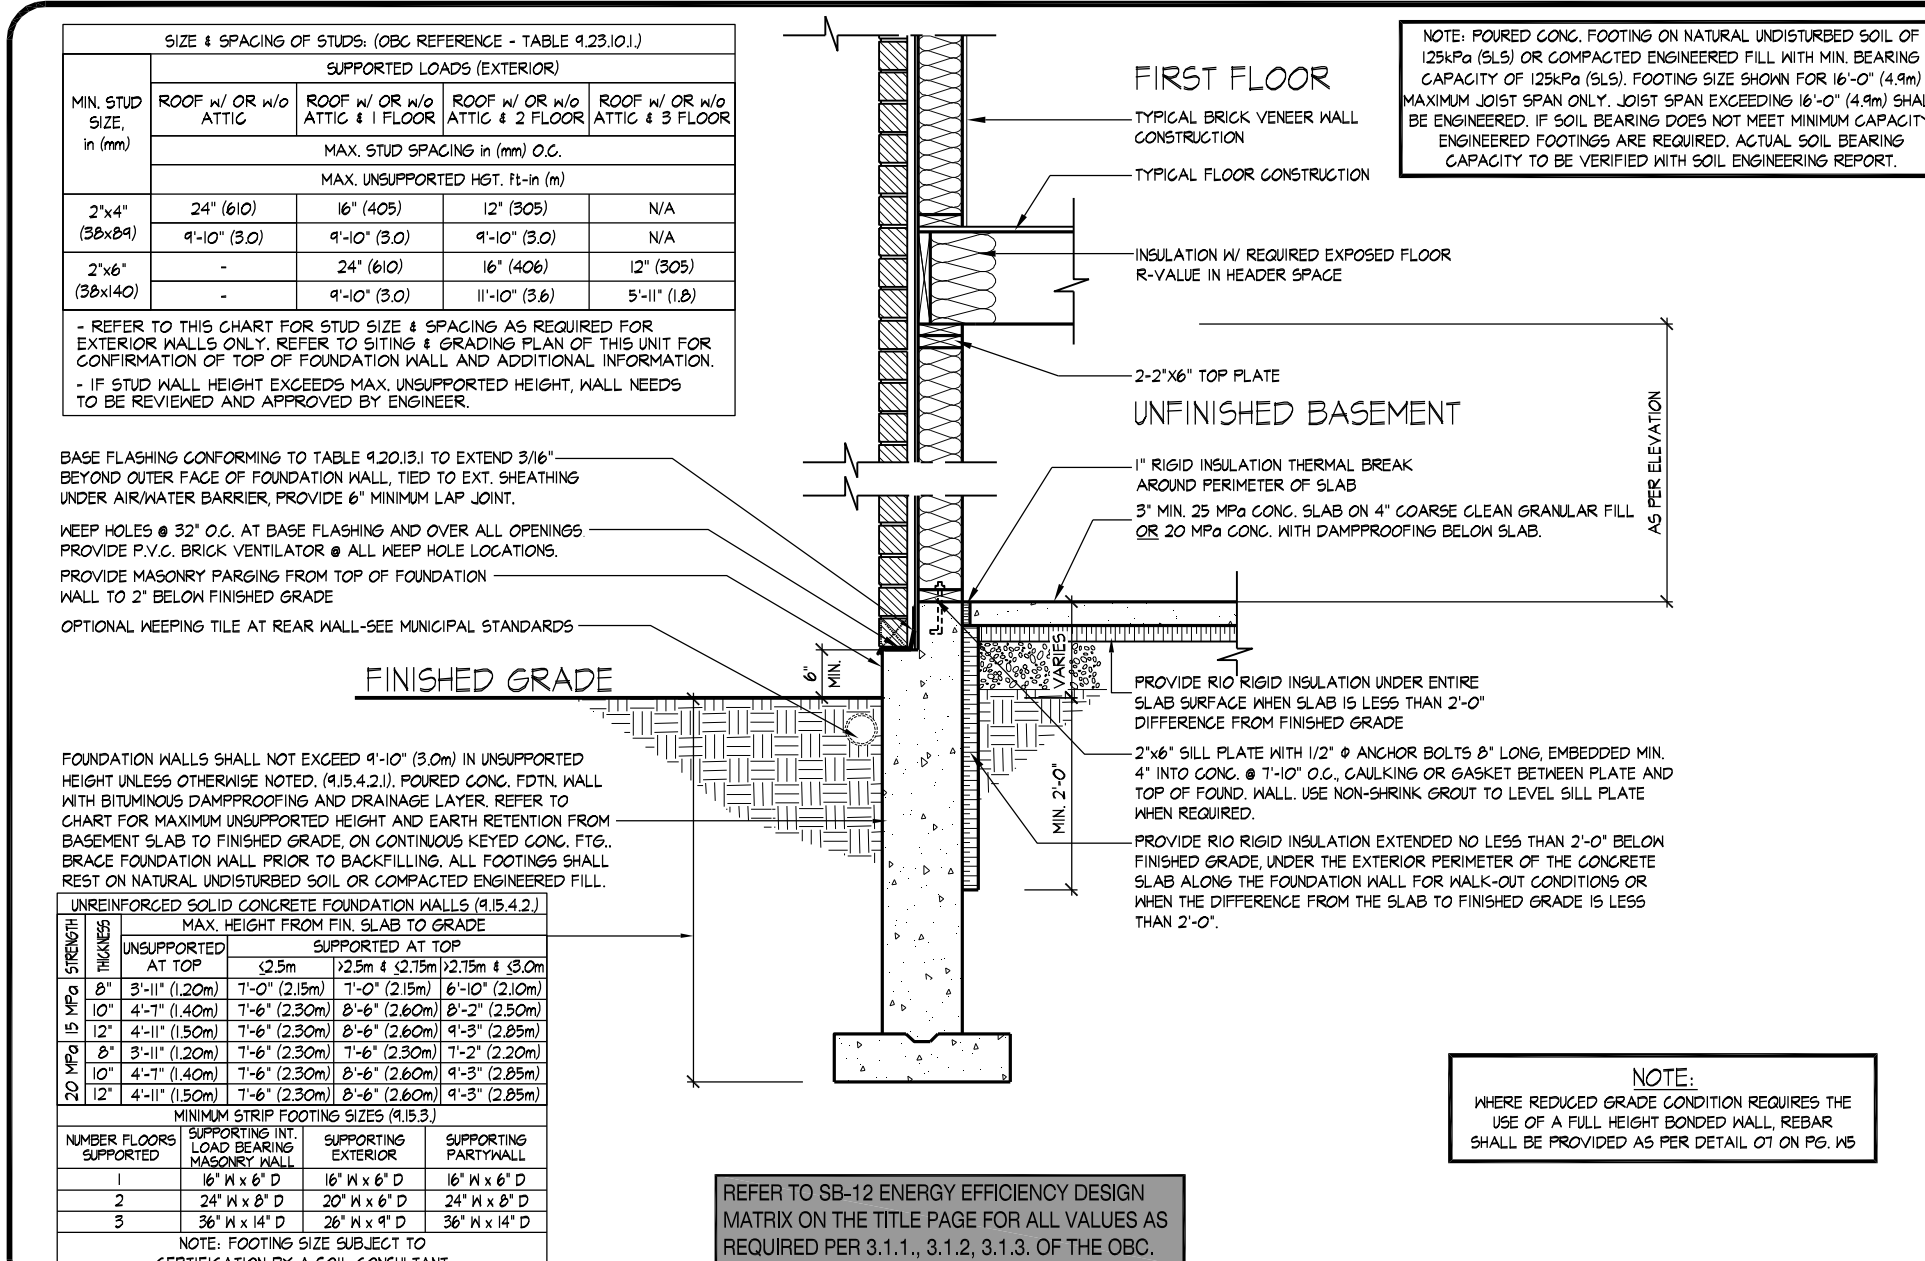


06 MASONRY VENEER, 2"x6" STUDS, SLAB ON GRADE / WALK OUT BASEMENT CONDITION
1/2" = 1'-0"

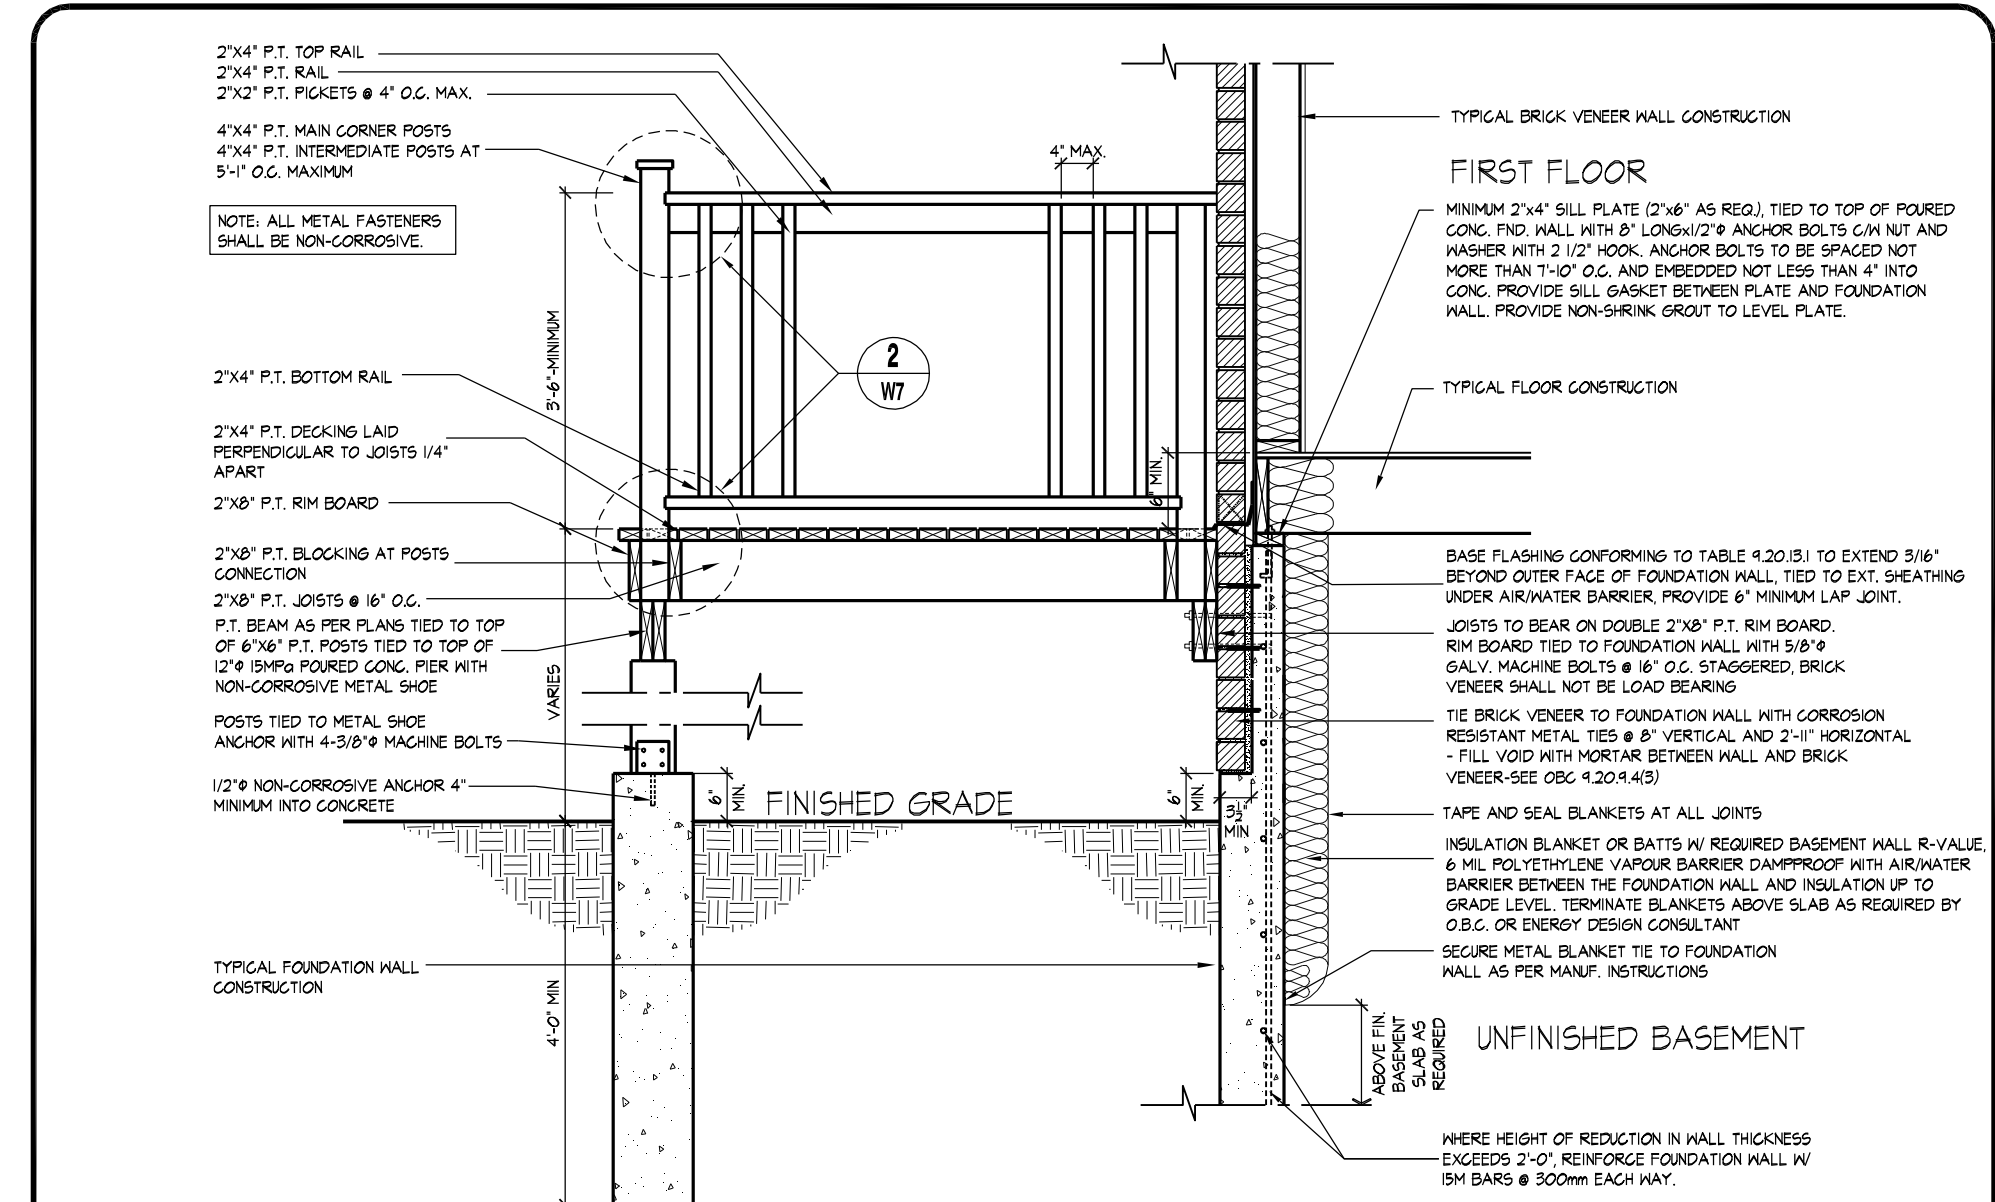


07 MASONRY VENEER, TYPICAL WALK/LOOK OUT WOOD DECK, SOLID MASONRY
1/2" = 1'-0"

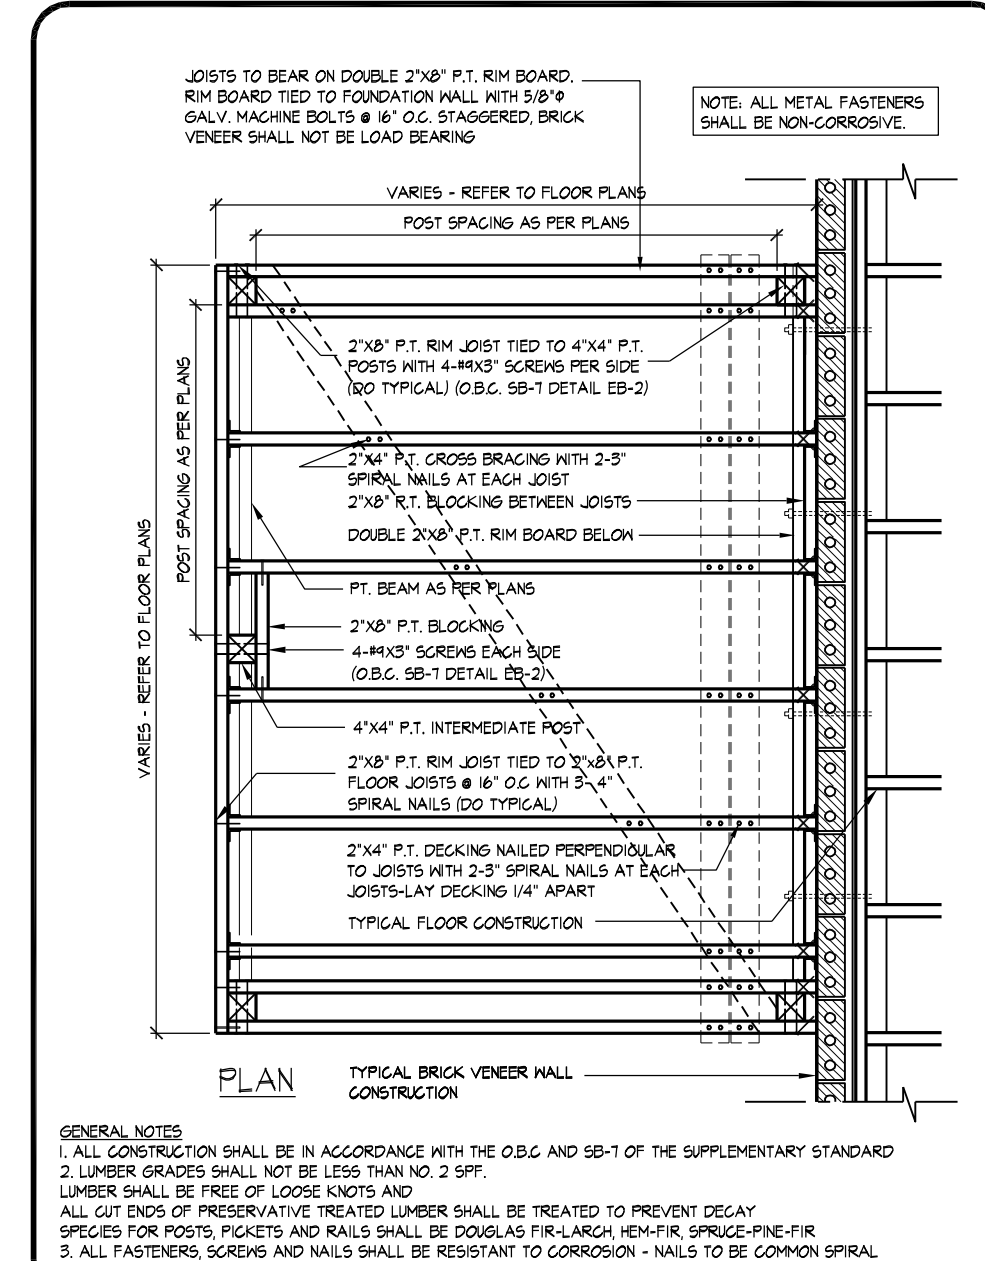

08 TYP. DECK FRAMING ON WOOD LEDGER, BRICK VENEER
1/2" = 1'-0"

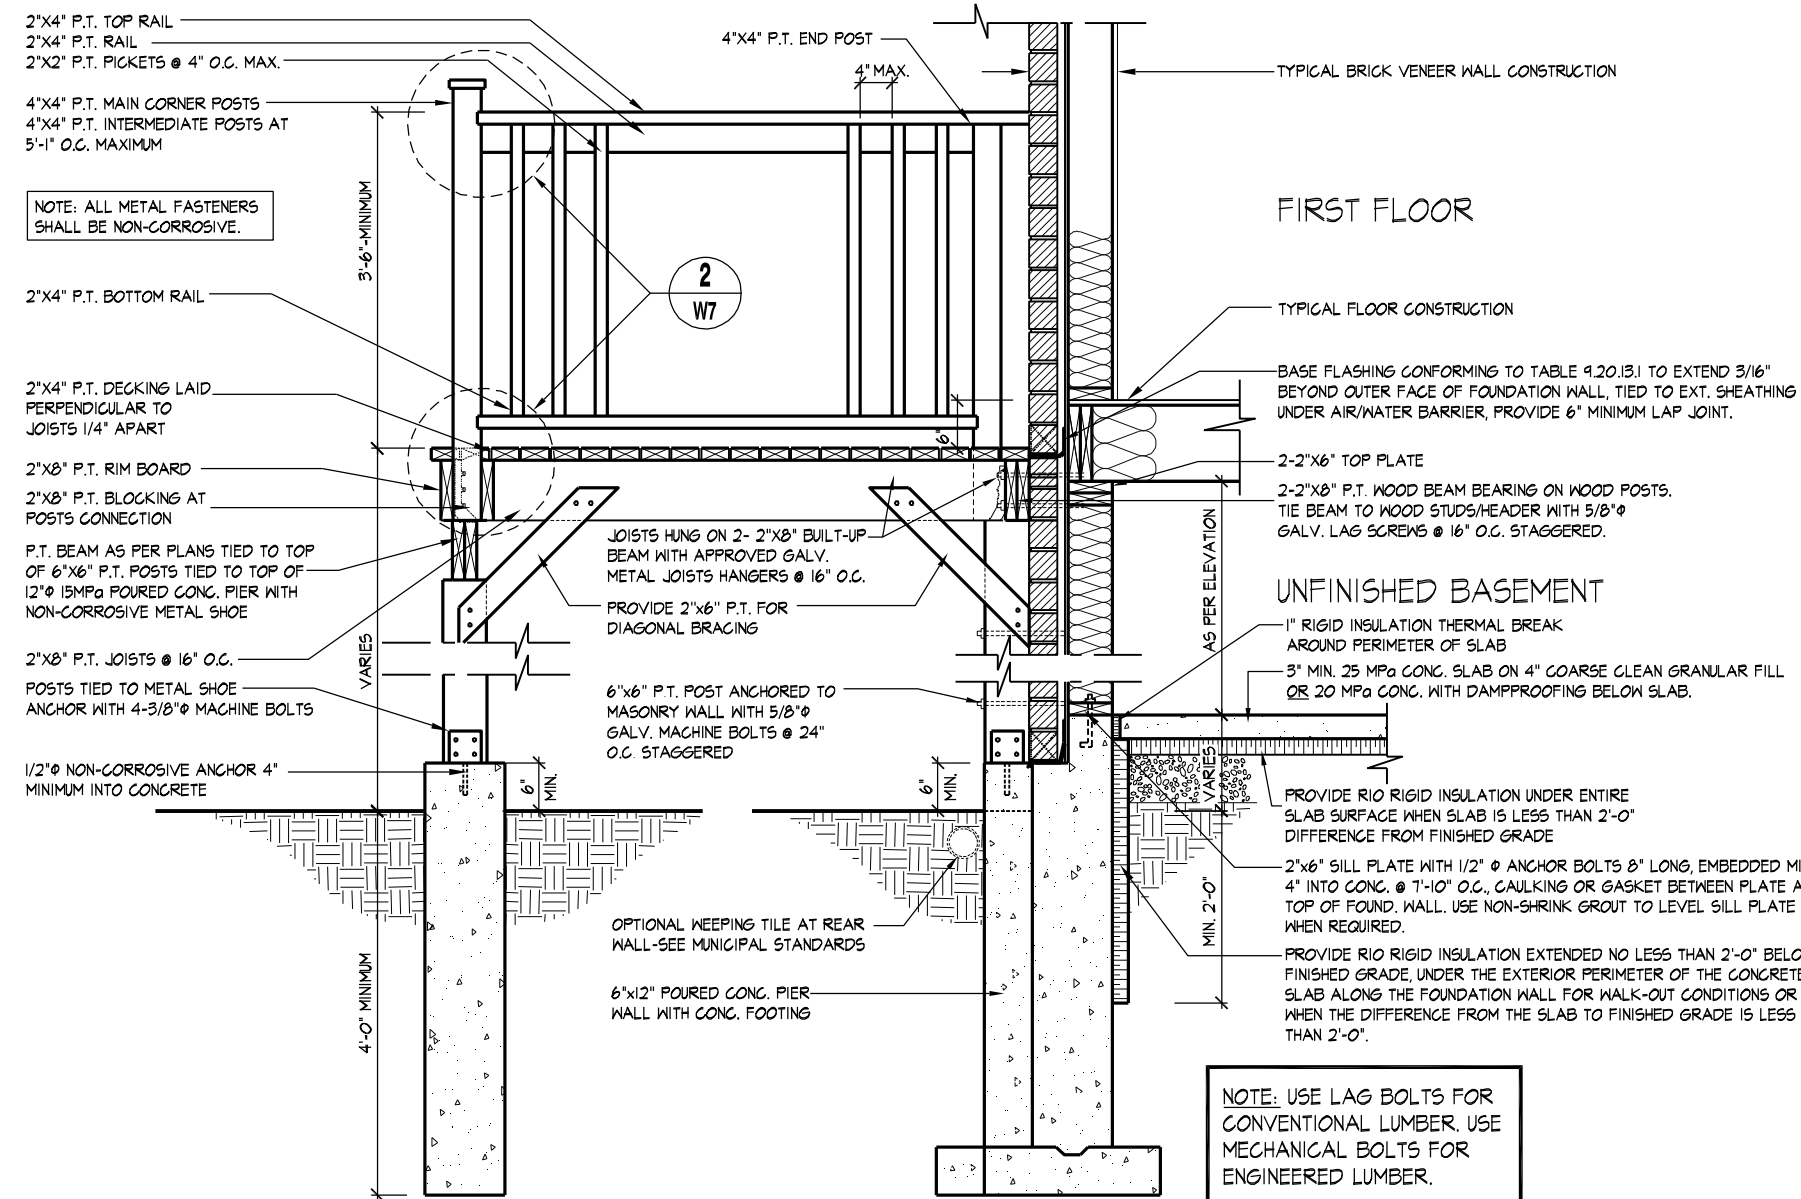


9 MASONRY VENEER, TYPICAL WOOD DECK FOR WALK OUT BASEMENT
1/2" = 1'-0"

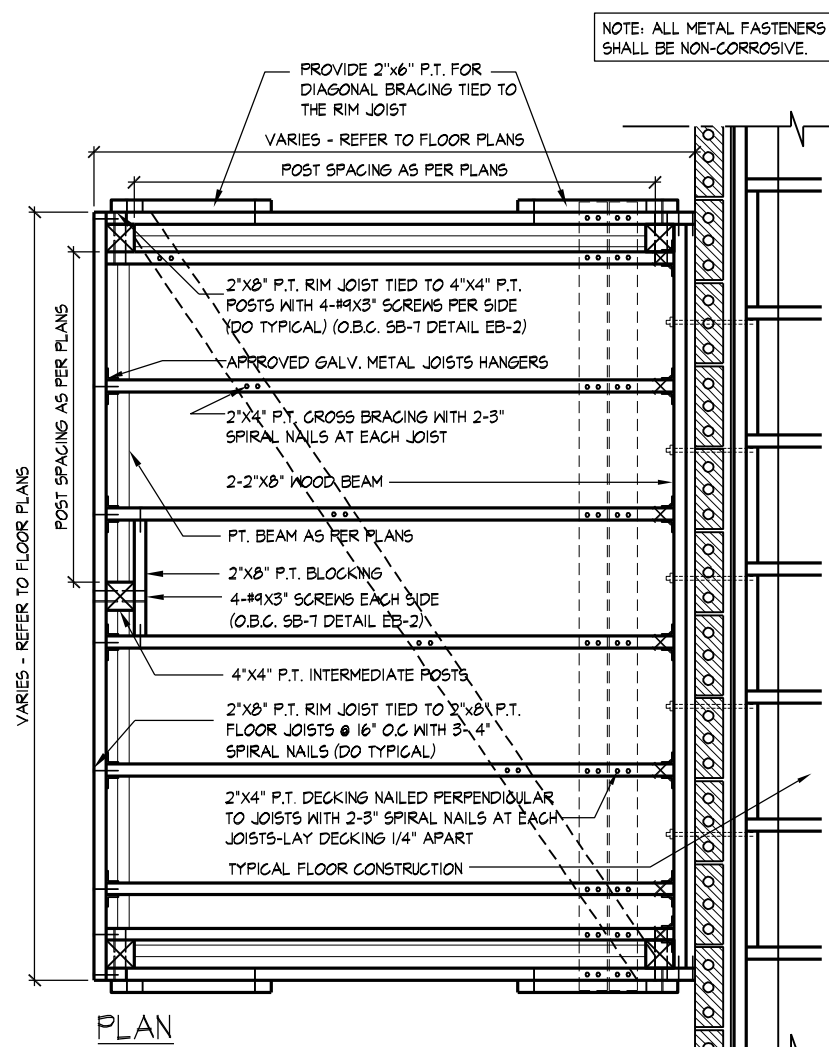


GENERAL NOTES
1. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH THE O.B.C. AND S.B.-7 OF THE SUPPLEMENTARY STANDARD
2. LUMBER GRADES SHALL NOT BE LESS THAN NO. 2 SPF.
LUMBER SHALL BE FREE OF LOOSE KNOTS AND
ALL CUT ENDS OF PRESERVATIVE TREATED LUMBER SHALL BE TREATED TO PREVENT DECAY
SPECIES FOR POSTS, PICKETS AND RAILS SHALL BE DOUGLAS FIR-LARCH, HEM-FIR, SPRUCE-PINE-FIR
3. ALL FASTENERS, SCREWS AND NAILS SHALL BE RESISTANT TO CORROSION - NAILS TO BE COMMON SPIRAL


10 MASONRY VENEER, TYPICAL DECK FRAMING PLAN
1/2" = 1'-0"

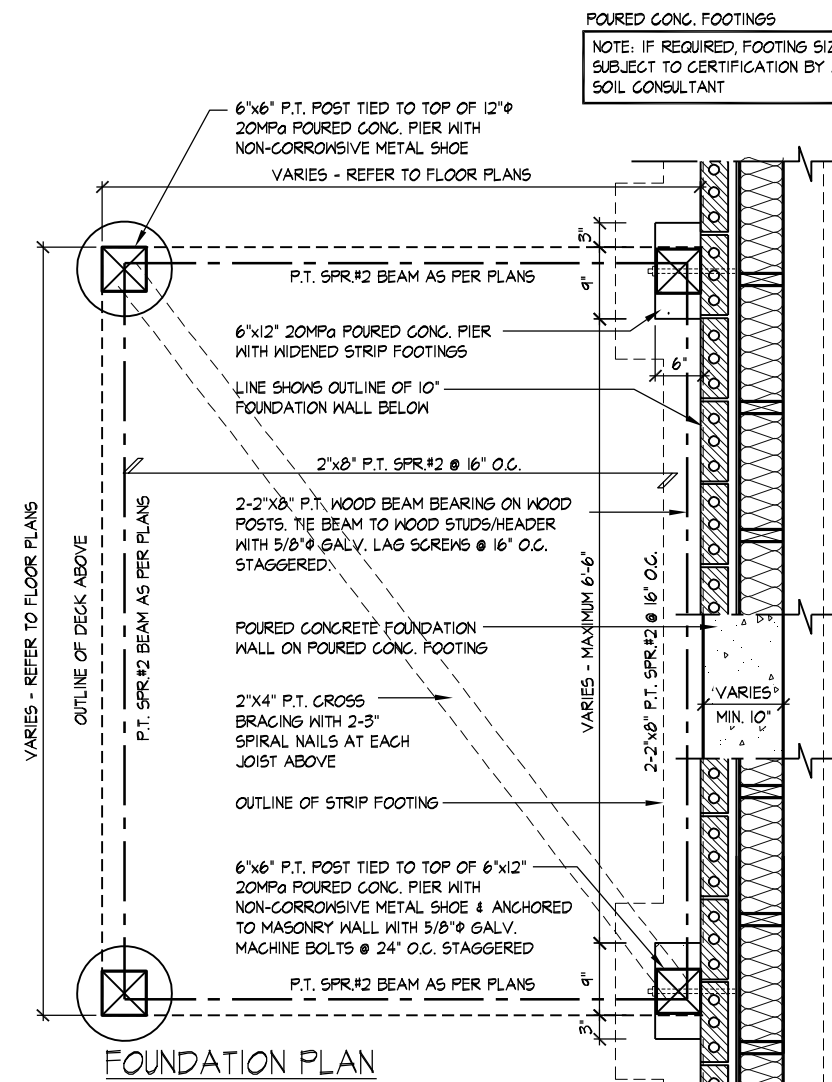


11 MASONRY VENEER, TYPICAL DECK FOUNDATION PLAN
1/2" = 1'-0"

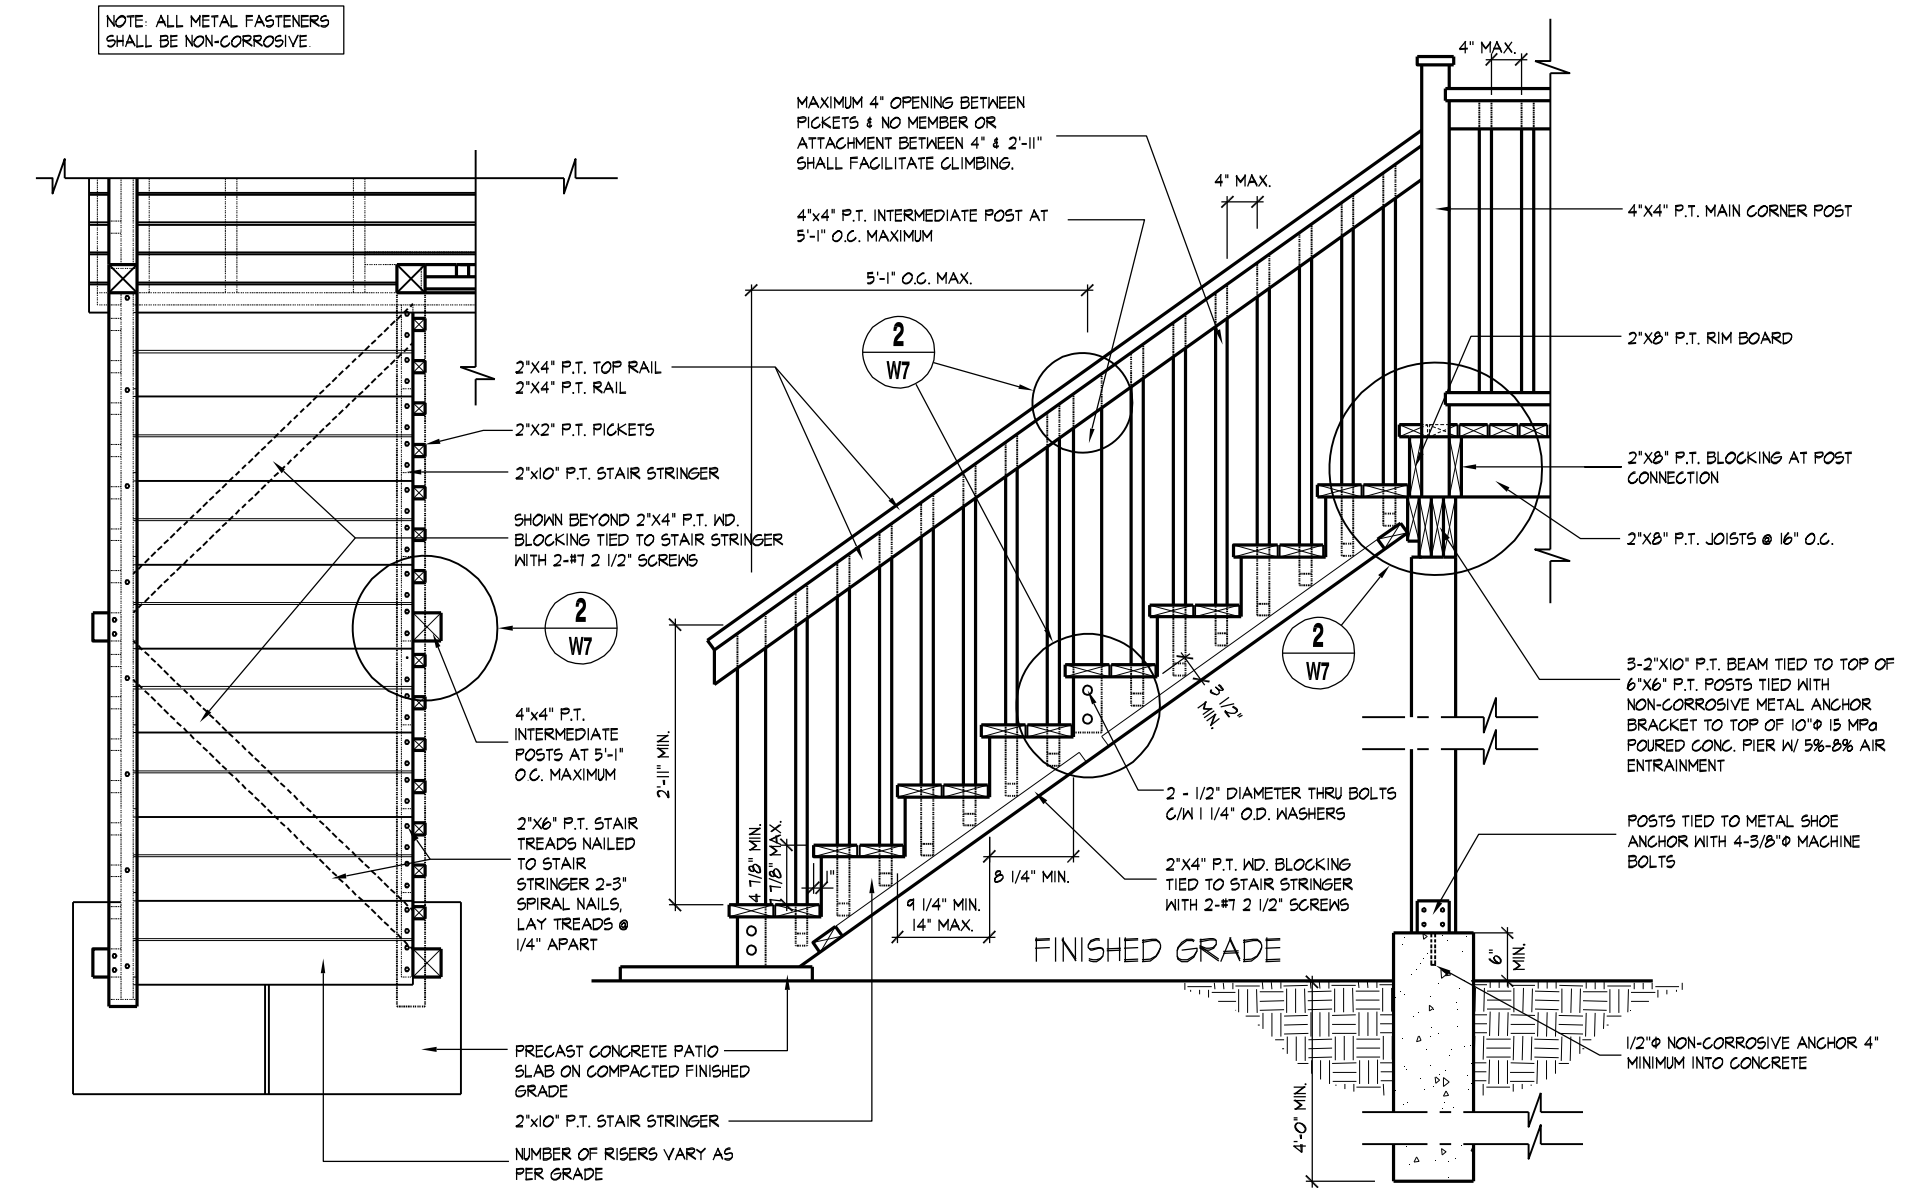

01 TYPICAL WOOD DECK STAIR
1/2" = 1'-0"

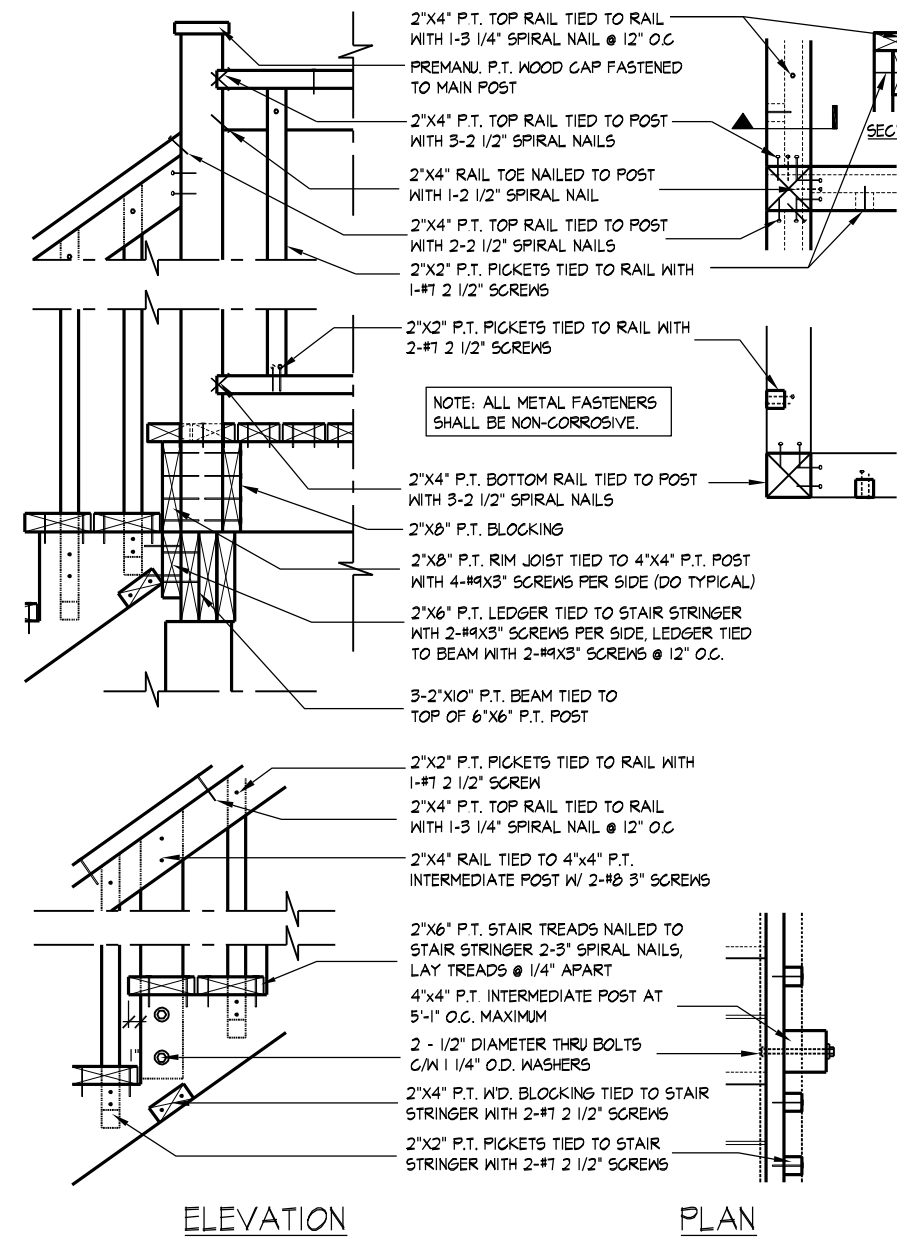

02 TYP. MAIN AND INTERMEDIATE POST ANCHORAGE
3/4" = 1'-0"

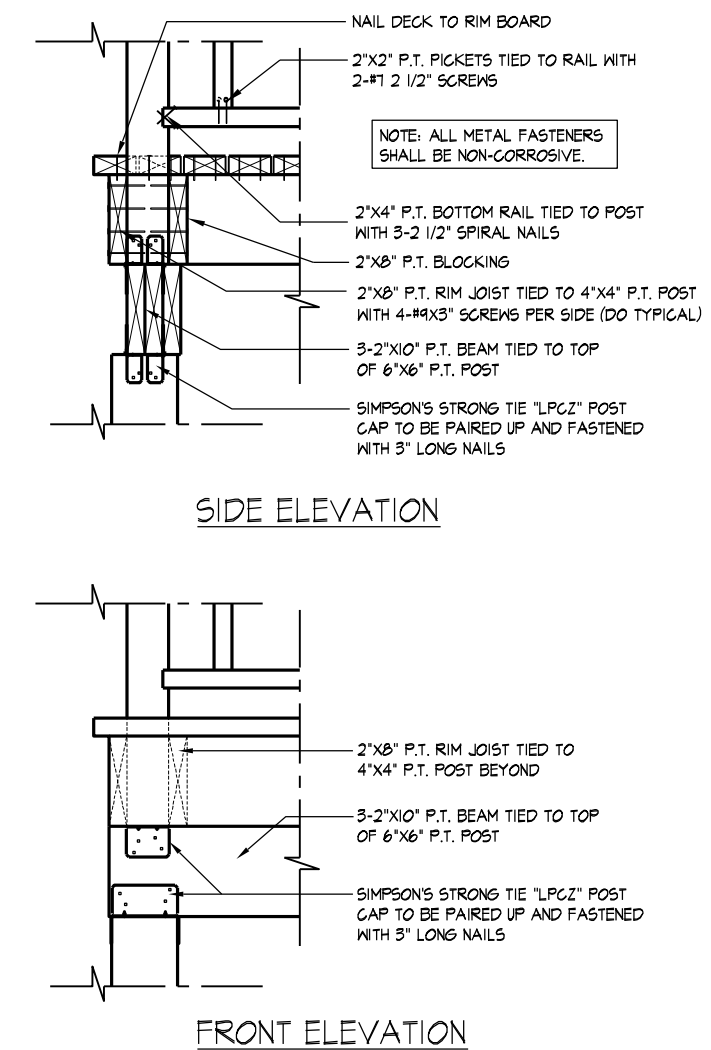

03 TYP. POST & BEAM CONNECTION
3/4" = 1'-0"