COMPLIANCE PACKAGE A1 - OBC 2012 - 2017 ENACTMENT

FOOTINGS / SLABS: TYPICAL STRIP FOOTING:

-BASED ON 16'-1"(4.9m) MAX, SUPPORTED JOIST LENGTH MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
-SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL
W/ MIN. 10.9psi (75KPa) BEARING CAPACITY

-FTG. TO HAVE CONTINUOUS KEY -FTG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT) REFER TO WORKING DRAWINGS FOR SPECIFIC SIZES THAT MAY SUPERSEDE NOTES #1 & #2 FOR FOOTING SIZES

-FTG. TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE BRICK VENEER -1 STOREY -13" X 4" (330mm X 100mm)
-2 STOREY -19" X 6" (485mm X 155mm)
-3 STOREY -26" X 9" (660mm X 230mm) SIDING-

-2 STOREY - 14" X 4" (360mm X 100mm) -3 STOREY - 18" X 5" (460mm X 130mm) 2 TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

-1 STOREY MASONRY - 16" X 4" (410mm X 100mm) -1 STOREY STUD -12" X 4" (450mm X 100mm) -2 STOREY MASONRY -26" X 9" (650mm X 230mm) -3 STOREY MASONRY -36" X 14" (900mm X 360mm) - 24" X 8" (600mm X 200mm)

3 STEP FOOTING: O.B.C. 9.15.3.9. -23 5/8" (600mm) MAX. VERTICAL RISE & 23 5/8" (600mm) MIN. HORIZONTAL

RUN.

DRAINAGE TILE OR PIPE: O.B.C. 9.14.3. nm) MIN, DIA, LAID ON UNDISTURBED OR WELL COMPACTED SOIL W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FLR. SLAB. COVER TOP & SIDES OF TILE OR PIPE W/ 5 7/8" (150mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL.

TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

5 BASEMENT SLAB:

O.B.C. 9.13, & 9.16. -3" (75mm) CONCRETE SLAB
-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMPPROOF BELOW SLAB W/MIN. 0.006" (0.15mm) POLYETHYLENE OR

TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS COMPRESSIVE SIRENCIAL AFTER 28 DATS
4" [100mm] OF COURSE GRANULAR MATERIAL
-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG.
-WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO
O.B.C. 9.13.3.
-FLOOR DRAIN PER O.B.C.9.31.4.4.

-R10 (RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (OBC SB-12

3.1.1.7 (5))

- UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. SB-9)

5a SLAB ON GROUND: -3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.

-2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5. -DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS. DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) -DAMPPROUPING MAY BE OMITIED IF CONCRETE HAS MIN. 360UPSI(25MP COMPRESSIVE STRENGTH AFTER 28 DAYS -R10 (RSI 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE. (OBC SB-12 3.1.1.7.(6)) -4" (100mm) OF COURSE GRANULAR MATERIAL -PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG. WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO C.B.C., 7.13.3.
- FLOOR DRAIN PER O.B.C.9.31.4.4.
- UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY

Standard (O.B.C. SB-9 6 GARAGE SLAB / EXTERIOR SLAB: -4"(100mm) CONCRETE SLAB

-4 (1001111) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.6. -6" X 0" (W2.9 X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB 4" (100mm) OF COURSE GRANULAR MATERIAL -ANY FILL PLACED UNDER SLAB , OTHER THAN COURSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

7 PILASTERS: O.B.C. 9.15.5.3.

PILASTER
-CONCRETE NIB - 4" X 12" (100mm X 300mm)
-BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9.20.11.2. TOP 7 7/8" (200mm) SOLID.

BEAM POCKET -4" (100mm) INTO FDN. WALL W/ WIDTH TO MATCH BEAM SIZE. /2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.) STRUCTURAL COLUMNS

-SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE OAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4kPa).

8 STEEL PIPE COLUMN: O.B.C. 9.15.3.4. & 9.17.3.

-MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS -FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mmX 100mmx 6.35mm) STEEL BTM. PLATE
-FOR WOOD BEAMS, MIN. 4"X4"X1/4" (100mmX 100mm X 6.35mm) STEEL TOP & BTM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM -ADJUSTABLE COLUMNS TO CONFORM TO CAN//CGSB-7.2-M WHERE IMPOSED LOAD DOES NOT EXCEED 36 KN (O.B.C. 9.17.3.4.)

COL. SPACING: 2 STOREY -MAX. 9'-10" (2997mm) - 34" X 34" X 16" (860mmX 860mmX 400mm) -MAX. 16'-0" (4880mm) - 44" X 44" X 21" - (1120mmX 1120mmX 530mm) 3 STOREY

-MAX. 9'-10" (2997mm) - 40" X 40" X 19"

-WHERE COL. SITS ON FDN. WALL, USE 4" X 8" X 5/8" (100mmX 200mmX mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS 9 WOOD COLUMN:

OBC 9.17.4.1 , 9.17.4.2, & 9.17.4.3. -5 ½" x 5 ½" (140mm x 140mm) SOLID WOOD COLUMN - OR -3-2"x6" (38mm x 140mm) BUILT UP COLUMN NAILED TOGETHER N/ 3" (76mm) NAILS SPACED NOT MORE THAN 12" (300mm) APART OR BOLTED TOGETHER W/ 3/8" (9.52mm) DIA BOLTS SPACED AT 18" (450mm) O.C -WRAP COLLIMN BASE W / 6 MIL POLY

- TWAN COLUMN DASE W/ 6 MILE POLT - COLUMN TO SIT DIRECTLY ON CONC PAD (NOT ON CONC SLAB) - 25"x52"x12" (640mm x 640mm x 300mm) CONC PAD (1 FLOOR SUPPORTED W/ 9"-10" COL SPACING) - 34"x34"x14" (860mm x 860mm x 360mm) CONC PAD (2 FLOORS SUPPORTED

10 BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES) -2"X8"X12" LEDGER BOARD FASTENED W/ 2/ 1/2" ANCHOR BOLTS @ 4" O.C. -WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11 WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE BETWEEN AD JACENT BEAMS

| BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM) 12"X11"X 5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH

2- 1/2"Ø x8" ANCHOR BOLTS. WALL ASSEMBLIES: 14 FOUNDATION WALL:

O.B.C. 9.15.4.2 -FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN LATERALLY SUPPORTED HEIGHT -8" (200mm) SOLID 2200psi (15MPa) CONCRETE -MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR -FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATERALLY SUPPORTED HEIGHT -10" (250mm) SOLID 2200psi (15MPa) CONCRETE -MAX. UNSUPPORTED HEIGHT OF 4'-7" (1400mm) & MAX. SUPPORTED HEIGHT OF 8'-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.

-LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS. -FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C.- T.9.15.4.2.A SHALL BE USED OR IT SHALL BE DESIGNED

UNDER O.B.C.- PART 4 EXTEND A MIN. 5 7/8" (150mm) ABOVE GRADE -WALL SHALL EXIEND A MIN. 3 7/0 (13011111) MODY DRADE INSULATE WY R20 (RSI 3.52) CONTINUOUS INSULATION FROM UNDERSIDE O SUBFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1 OBC SB-12 T.3.1.1.2.A.) ALTERNATE INSULATION METHOD: 2" (51mm) R10 (RSI 1.76)RIGID INSULATION W/

2"x4"(38mm X 89mm) WOOD STUD W/ R12 (RŚI 2.11) BATT IŃSULATION -BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

REDUCTION OF THICKNESS:

VERTICALLY O.C. & 2'-11" (900mm) HORIZONTALLY. -FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK <u>DAMPPROOFING & WATERPROOFING:</u>
-DAMPPROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C.

where insulation extends to more than 2'-11" (900mm) below grade, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO A FDN. WALL UKAINAGE ET CL. ...
O.B.C. 9.14.2.1.(2) (3) (4)

CHIEF RASEMENTS SHALL HAVE INTERIOR DAMPPROOFING EXTENDING

CONTRACTOR OF C. 9.13.3.3.(3) -finished basements shall have interior damptroofing extending From Slab To Grade Level & Shall Conform To 0.8 c. 9.13.3.3.(3) -where hydrostatic pressure occurs, fdn. walls shall be WATERPROOFED AS PER O.B.C. 9.13.3. WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMPPROOFING.

$\langle 14 \text{G} \rangle$ FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING) 3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING) 4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING) BARS STACKED VERTICALLY AT INTERIOR FACE APPROX 4" TO 6" APART. BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING

15 FRAME WALL CONSTRUCTION:

CCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED -SIDING OR STOCK AS TEXT ELEVATIONS, MIN. 7/76 (2001) INTO MATRIAGED GRADE (O.B.C. 9.28.1.4. & 9.27.)

-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.

-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. -2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C MIN. R22 (RSI 3.87) INSULATION (ZONE 1. OBC SB-12 T.3.1.1.2.A.) CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4. 1/2" (12.7mm) GYPSUM BOARD

NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO
BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:

-REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE
INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.

-REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:

-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

ALTERNATE FRAME WALL CONSTRUCTION: SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED

-3DING OR STOCK 28-14. & 9.27.)
-1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/TAPED JOINTS (O.B.C. 9.27.3.4.) BRACE W/ CONT. 16 GAUGE STEEL 'T' BRACES FROM TOP PLATE TO BTM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mmX 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR 2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. 2. A 4 (SSITHIN AND STOREYS. DN BOTTOM FLR, WHEN 3 STOREYS. R14 (RSI 2.46) INSULATION CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. &

1/2" (12.7mm) GYPSUM BOARD. NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =

-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE

FOLLOWING MATERIALS:

-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.

-2.3.1.6. BETWEEN RIGID INSULATION AND WOOD STUD.

-REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m. -REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD. REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS). VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER

OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID

(15b) FRAME WALL CONSTRUCTION @ GARAGE: SIDING OR STUCCO AS PER ELEVATIONS, MIN, 7 7/8" (200mm) FROM

FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. 1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE

REQUIRED TO BE SPACED @ 12" (300mm) O.C REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD

IHE FOLLOWING MATERIALS: -ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m. -REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD. REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING

16 BRICK VENEER CONSTRUCTION:

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. -MIN, 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. **VERTICAL SPACING** -PROVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ BTM. COURSE & OVER -BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2)) -BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER -1" (25mm) AIR SPACE -WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.

-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 22) GARAGE WALL & CEILING: 9.23.16 .2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C -MIN. R22 (RSI 3.87) INSULATION (ZONE 1. OBC SB-12 T.3.1.1.2.A.) -CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3.

& 9.25.4. -1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS: -REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/sa.m -REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

160 ALTERNATE BRICK VENEER CONSTRUCTION:

1" (25mm) AIR SPACE

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL

DVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ BTM. COURSE & OVER -BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE -BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER

1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C.

-INSULATION AND OUT AND THE TO MUNICIPAL STANDARDS).
-1/2" (12.7mm) GYPSUM BOARD
-ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH 4 - 3 1/4" (82mm) TOE NAILS BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7 7/8" (200mm) O.C WALLS ADJACENT TO ATTIC SPACE:

IUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.

-2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. -R22 (RSI 3.87) INSULATION 1/2" (12.7mm) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING -ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1. 23 DOUBLE VOLUME WALLS:

-3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING
REFER TO PLAN FOR STUD SPECIFICATION
-STUDS FASTENED AT TOP & BOTTOM WITH 3/ 3-1/4" (82mm) TOE NAILS Double top plates fastened together with 3" (76mm) at 7/8" (200mm) O.C -SOLID BRIDGING AT 3'-11" (1200mm) O.C. -SOLID BRIDGING AT 3-11 (200111) O.:
-MIN, R22 (RSI 3.87) INSULATION (ZONE 1 OBC SB-12 T.3.1.1.2.A.)
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C.
9.25.3. & 9.25.9.

CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4. -R31 (RSI 5.46) INSULATION NTED ALUMINUM SOFFIT

SUNKEN FINISHED AREAS: USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA AT FOUNDATION WALLS. EXTEND FOOTINGS TO SUPPORT POSTS WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION WALLS INSTEAD OF USING BEARING POSTS.

LOOR STRUCTURE AS PER NOTE # 28 25 DOUBLE MASONRY WYTHE WALL:

-3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER STEEL OF THE STATE OF THE STATE

250) AREA. CORBEL MASONRY VENEER:

-MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1) FLOOR ASSEMBLIES:

 $\langle 26 \rangle$ SILL PLATE: -2" X 4" (38mm X 89mm) PLATE /2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FASTENED TO PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4

[100mm] INTO FOUNDATION WALL.

**SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1"
(25mm) THICK BEFORE COMPRESSING, OR FOAM GASKET, OR PLACED ON FULL BED OF MORTAR. 27 BRIDGING & STRAPPING:

-1" X 3" (19mmX 64mm) NAILED TO U/S OF JOISTS @ MAX. 6'-11" (2100mm) O.C. FASTENED TO SILL OR HEADER @ FNDS -1" X 3" (19mmX 64mm) OR 2" X 2" (38mmX 38mm) CROSS BRIDGING @ MAX 6-11" (2100mm) O.C. c) BRIDGING & STRAPPING - a) & b) USED TOGETHER OR -1 1/2" (38mm) SOLID BLOCKING @ MAX. 6-11" (2100mm) O.C. USED WITH

d) FURRING OR PANEL TYPE CEILING STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING FINISH

S ATTACHED DIRECTLY TO JOISTS. 28 FLOOR ASSEMBLY:

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS -BRACE W/ CONT. 16 GAUGE STEEL T' BRACES FROM TOP PLATE TO BTM.

reale for the foll length of wall, or -CON1, 2" x 4" (38mmX 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL

9.25.4. -1/2" (12.7mm) GYPUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)

INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.

-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE

REQUIRED TO BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE

O.B.C. SB-3 WALL = EW ID (SIC = N/A, FIKE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD
THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.
9.23.1.6, BETWEEN RIGID INSULATION AND WOOD STUD.
-REPLACE R14 (RS1.2.46) INSULATION WITH R14 (RS1.2.46) ABSORPTIVE

-REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

O.B.C. 9.23.
-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX.
HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT
STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C.

PROVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ BTM. COURSE & OVER

1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C.

/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =

-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE

 $\underline{\mathsf{REQ}}.\,\mathsf{FOR}\,\,\mathsf{FIRE}\,\,\mathsf{RATING}\,\,\mathsf{(LESS\,THAN\,4'-0''\,LIMITING\,DISTANCE)};$

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR

2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR

- DBL. 2" X 4" OR 2" X 6" TOP PLATE. - 2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPPROOFING MATERIAL.

MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS

TO THE U/S OF ROOF DECK -SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/

MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO PREVEN

-ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE

-1/2" (12.7mm) GYPSUM BOARD -CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3.

O.B.C. 9.10.11. & 3.1.10. & SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)

AND CONSTRUCT OF THE CONTROL OF THE

ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING

-SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY

-EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS -STAGGER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER

-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER

HAN 9'10" (3m), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER

O.B.C. 9.15.4.2. -7 7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa)

COMPRESSIVE STRENGTH AFTER 28 DAYS -FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2

O.B.C. SB-3 WALL = W15c (STC = 61, FIRE = 1 HR)

-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK

-2 LAYERS OF GYSUM ON BOTH SIDES (as follows):
-1st LAYER - 5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/
JOINTS TAPED & FILLED.

2nd LAYER - 1/2" (12mm) REGULAR GYSUM BOARD BOTH SIDES W/

-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38MMX 140MM) STUDS ARI

ON REMAINING FLOORS AT THE STAIR OPENING AT 16" O.C.

IF 2"X6" STUDS ARE USED AT STAIR OPENING CONTINUE TO US

-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)

NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38MMX 89MM) STUDS ARE REQUIRED TO BE SPACED @ 12" (300MM) O.C.

O.B.C. 9.10.9.16.(3) -1/2" (12.7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & U/S OF CEILING BETWEEN HOUSE AND GARAGE

INUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.

INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN

R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE

-ACOUSTIC GREEN GLUE b/w GYPSUM 1st & 2nd LAYERS

REQUIRED TO BE SPACED @ 12" (300MM) O.C.

TAPE AND SEAL ALL JOINTS GAS TIGHT

-R22 (RSI 3.87) INSULATION IN WALLS,

9.25.3. & 9.25.4.. FOR FLOOR ABOVE.

-2 ROWS 2"X4"(38mmX 89mm) STUDS @ 16"(400mm) O.C. W/ SEPARATE

SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF

2" X 4" (38mmX 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4"

O.B.C. 9.10.9.9.(1) & TABLE 2.1.1 SB-2
-ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)
-PROTRUDE PAST FASCIA @ EAVES W/ BRICK CORBELLING
-EXTEND 5.7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/

7 1/2" (190mm) CONC. BLOCK, MIN. 2 HR. FIRE-RESISTANT RATING

THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.(1)

1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES 2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH

7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)

O.B.C. SB-3 WALL = B5c (STC = 51, FIRE = 2 HR)

-2" X 6" (38mmX 140mm) WOOD STRAPPING @ 16" (400mm) O.C.

-R22 (RSI 3.52) RIGID INSULATION -7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE)

-1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEEN

-MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS

PARTY WALL - BLOCK (AGAINST GARAGE):

TAPE AND SEAL ALL JOINTS GAS TIGHT

AREA, O.B.C. T.3.2.2.47.

O.B.C. 3.1.10.4.(2)

20 PARTY WALL - FOUNDATION:

90% OF THE CAVITY.

♦ (21) PARTY WALL - WOOD STUD (TYPICAL):

V 90mm) TOP DI ATE

-STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER O.B.C. 9.10.9.9.(1) & TABLE 2.1.1. SB-2 -ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1)

-2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W.

1/2" (12.7mm) GYPSUM BOARD BOTH SIDES, 1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7'-10" (2400mm) O.C. FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB

O.B.C. SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)

-2. X 4" (S811111A 87111111) WOOD STUDS @ 16" (40011111) O.C. OK
-2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/
-DOUBLE 2"X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE
-1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE

FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD

-ADD R15 (RSI 2.64) ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/

REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

OFENINGS

HASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING

MEMBRANE (O.B.C. 9.20.13.6.(2))

-BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER

-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.

REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQUIRED TO BE SPACED @ 12" (300mm) O.C

" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C.

INUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. &

PLATE FOR THE FULL LENGTH OF WALL, OR

REQUIRED TO BE SPACED @ 12" (300mm) O.C

(16b) BRICK VENEER CONSTRUCTION @ GARAGE:

VERTICAL SPACING

17 INTERIOR STUD WALLS:

19 PARTY WALL - BLOCK:

O.B.C. T.9.23.10.1.

18 BEARING STUD WALL (BASEMENT):

-R14 (RSI 2.46) INSULATION

O.B.C. 9.23.14.3, 9.23.14.4 -5/8" (15.9mm) WAFERBOARD (R-1 GRADE) OR EQUIVALENT -FLOOR JOISTS AS PER FLOOR PLANS

PORCH SLAB:

O.B.C. 9.39.1.4.

-47/8" (125mm) 4550 psi (32 MPa) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT REINFORCE WITH 10M BARS @ 77/8" (200mm) EACH WAY

-1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB -3" (75mm) END BEARING ON FOUNDATION WALL 23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) O.C JE A COLD CELLAR IS LOCATED BELOW THE SLAB SUPPORT ON FOUNDATION

WALLS NOT TO EXCEED 8'-2" 30 EXTERIOR BALCONY ASSEMBLY: -1 1/4" X 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING
-2"X4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED
ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8" (15.9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"X4" WOOD PURLINS CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"X8" ROOF JOISTS @ 12" O.C

(OR AS NOTED ON PLAN) EXTERIOR GUARD AS PER #36a SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER REQUIRED FOR OVER HEATED SPACES: -ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF

-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. D 1/2" (12 7mm) GYPSIIM BOARD W/ PAINTED CEILING OR

-ADD 1/2" (1.5/mm) GYPSUM BOARD W/ PAINTED CEILING OR
-ADD 5/8" (1.5/mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C.-T.9.29.5.3.)

EXTERIOR FLAT ROOF ASSEMBLY:
-SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT INSTALLED PER MANUFACTURER'S SPECIFICATIONS. -1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPERED PURI INS SLOPED MIN. 2% TO ROOF SCUPPER. -3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON -2"X8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)

REQUIRED FOR OVER HEATED SPACES:

-ADD 2"X2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS

US AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3 & Y.Zo.4. -ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.)

ROOF ASSEMBLIES 31 TYPICAL ROOF:

O.B.C. 9.26.
-NO. 210 (30. SKG/m2) ASPHALT SHINGLES
-FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL. -EAVES PROTECTION LAID BENEATH STARTER STRIP. FAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES STARTER STRIP AS PER O.B.C. 9.26.7.2.
STARTER STRIP AS PER O.B.C. 9.26.7.2.
STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3)
3/8" (10mm) PLYWOOD SHEATHING OR OSS (0°2 CRADE) WITH "H" CLIPS
APPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURER'S -TRUSS BRACING AS PER TRUSS MANUFACTURER

EAVESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR TTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT. 32 CEILING: -R60 (RSI 10.56) INSUI ATION

CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3 7.2.4. /2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.)

32a VAULTED OR CATHEDRAL CEILING: NO. 210 (30. 5KG/m2) ASPHALT SHINGLES FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2'-11" (900mm) FROM FDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL -FAVES PROTECTION LAID BENEATH STARTER STRIP TEAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1.
-STARTER STRIP AS PER O.B.C. 9.26.7.2. STARTIER STRIP AS PER O.B.C. 9.28.7.2. STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3) 3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS. -2"x8" (38mm x 184mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 13'-3" (4050mm) OR

-2"x10" (38mm x 235mm) @ 16" O.C. W/ 2"x2" (38mm x 38mm) CROSS PURLINS @ 24" O.C. MAX. SPAN 17'-0" (5180mm CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH

LEGEND

O.B.C. 9.25.3. & 9.25.4.

CARBON MONOXIDE 45

SMOKE ALARM (44)

ALARM (CMA)

VENTS AND INTAKES

COLD CELLAR VENT (50)

WATERPROOF DUPLEX OUTLET

HOSE BIB

(38) EXHAUST FAN

STOVE VENT

SOLID BEARING

Ø
 POINT LOAD

2/ 2" X 8" SPR

2/ 2" X 10" SPR

2/ 2" X 12" SPR

FIRE PLACE VENT

DRYER VENT

FLOOR DRAIN

FLAT ARCH 2 STORY WALI

EXT. LIGHT FIXTURE

(WALL MOUNTED)

PRESSURE TREATED

HYDRO METER

GAS METER

DJ DOUBLE JOIST

GT GIRDER TRUSS

(FL) FLUSH

(DR) DROPPED

L10 4-7/8" X 3-1/2" X 5/16" L L15 5-7/8" X 4" X 1/2" L

L11 4-7/8" X 3-1/2" X 3/8" L L16 7-1/8" X 4" X 3/8" L

UNDER SIDE

GLASS BLOCK

BLACK GLASS

FIXED GLAZING

G

PT

'DO

FG

BG

<u>LINTELS</u>

3-1/2" X 3-1/2" X 1/4" L L12 5 7/8" X 3-1/2" X 5/16" L L17 7-1/8" X 4" X 1/2" L

3 4-7/8" X 3-1/2" X 1/4" L L13 5-7/8" X 3-1/2" X 3/8" L

ONTARIO REGULATION 332/12 OBC. AMMENDMENT O. REG. 139/17 JAN 1, 2018 B 81.5x2030x35 (2'8"x6'8"x1-3/8") 760x2030x35 (2'6"x6'8"x1-3/8 710x2030x35 (2'4"x6'8"x1-3/8" 460x2030x35 (1'6"x6'8"x1-3/8" 610x2030x35 (2'0"x6'8"x1-3/8") STEEL BEAMS

ST1 W 6 X 15 ST3 W 8 X 18 ST4 W 8 X 21 ST5 W 8 X 24 **WOOD BEAMS**

3/ 2" X 8" SPR AFF ABOVE FINISHED FLOOR 4/ 2" X 8" SPR **BBFM** BEAM BY FLOOR MANUF 5/ 2" X 8" SPR 3/ 2" X 10" SPF 4/ 2" X 10" SPR REPEAT SAME JOIST SIZE WD6 5/ 2" X 10" SPR VD7 3/2" X 12" SPR WD8 4/ 2" X 12" SPR WD9 5/2" X 12" SPR VD10 2/ 1 3/4" X7 1/4" (2.0E) L\ WD11 3/ 1 3/4" X7 1/4" (2.0F) I WD12A 1/ 1 3/4" X9 1/2" (2.0E) LV WD12 2/ 1 3/4" X9 1/2" (2.0F) I L9 4" X 3-1/2" X 1/4" L L14 5-7/8" X 3-1/2" X 1/2" WD14A 1/ 1 3/4" X11 7/8" (2.0E) L

WD15 3/ 1 3/4" X11 7/8" (2.0E) L

WD16 2/ 1 3/4" X14" (2.0E) LVL

-MIN, RUN = 5 7/8" (150mm)
-MIN, AVG, RUN = 7 7/8" (200mm)
-FINISHED RAILING ON WOOD PICKETS MAX, 4" BETWEEN PICKETS -EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD & MAX. 7 7/8" (200mm) RISE -FOUND, WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2

(210mm) (235mm) (25mm) (1950mm

FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE <u>HANDRAILS:</u> O.B.C. 9.8.7 -ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm) -TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-7" (1 100m) -ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN DWELLING UNITS

HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR

-2" X 6" (38mm X 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9"

UNLESS OTHERWISE NOTED. -HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON

-CEILING JOISTS TO BE 2" X 6" (38mmX 140mm) @ 16" (400mm) O.C.

HEIGHT: O.B.C. 9.8.7.4 - 2-10" (865mm) MIN. TO 3'-2" (965mm) MAX. - 3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS - MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

WAYS, LANDINGS OR POSTS AT CHANGES IN DIRECTION

PROJECTIONS: O.B.C. 9.8.7.6 -HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED VIDTH OF THE STAIR

35a PUBLIC STAIRS:

(33) CONVENTIONAL FRAMING:

(34) ATTIC ACCESS HATCH:

GENERAL:

O.B.C. 9.8.4.

ANGLED TREADS:

-MIN. TREAD = 9-1/4 -MAX. NOSING = 1" -MIN. HEADROOM = 6'-5"

 $\overline{\left(35\right)}$ PRIVATE STAIRS:

-MAX, RISE

-MIN. RUN

-MIN. WIDTH

O.B.C. TABLE A6 OR A7

RAFTERS & MIN. 1 1/2" (38mm) THICK

2"X4" (38mm X 89mm) COLLAR TIES AT MIDSPANS

OBC 9.19.2.1. & SB-12 3.1.1.8.(1) -19 3/4" X 27 1/2" (500mm X 700mm) ATTIC HATCH WITH

= 8-1/4"

= 9-1/4" = 1"

-MIN. WIDTH = 2'-10" (860mm) (BETWEEN WALL FACES)

(EXIT STAIRS, BETWEEN GUARDS)

WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION

= 7-7/8" (200mm)

= 2'-11" (900mm)

O.B.C. 9.8.4. -MAX. RISE -MIN. RUN -MIN. TREAD = 7-3/32" (180mm) = 11" (280mm) = 11" (280mm) -MAX. NOSING -MIN. HEADROOM = 6'-9"

(EXIT STAIRS, BETWEEN GUARDS)
-FINISHED RAILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS FOUND, WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2 -FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE HANDRAILS:

O.B.C. 9.8.7 -ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm) TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-'7" (1100mm)

TWO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT HERE INTERRUPTED BY DOOR WAYS OR NEWEL POSTS AT CHANGES II HEIGHT: O.B.C. 9.8.7.4 - 2'-10" (865mm) MIN. TO 3'-2" (965mm) MAX. 3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS)

PROJECTIONS:
O.B.C. 9.8.7.6
- HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A

STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

TERMINATION: O.B.C. 9.8.7.3 - ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4" (300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR

FINISH: O.B.C. 9.8.9.6 O.B.C.; 9.8,9.6

-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE FROM DEFECTS PER OBC 9.8.9.6.(4)

-STAIRS AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE VISUAL PATTERN TO DEMARCAET THE LEADING EDGE OF THE TREADS, LANDING AND THE BEGINNING AND END OF A RAMP.

(36) INTERIOR GUARDS: O.B.C. SB-7 & 9.8.8.3.

-GUARDS TO BE 3'-6" (1070mm) HIGH -FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH -INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS -PICKETS TO HAVE 4" (100mm) MAX. SPACING -GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

(360) EXTERIOR GUARDS: O.B.C. SB-7 & 9.8.8.3. -GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN 23 5/8" (600mm) GUARDS TO BE 3'-6" (1070mm) -FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH

-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2-11" (900mm) HIGH -FOR DWELLING UNITS GUARDS TO BE 3-6" (1070mm) HIGH WHERE WALKING SURFACE IS MORE THAN 5'-11" (1800mm) ABOVE ADJACENT GRADE. -PICKETS TO HAVE 4" (100mm) MAX. SPACING -PROVIDE MID-SPAN POSTS AS PER SB-7. -GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

36b EXTERIOR GUARDS @ JULIET BALCONY:

-FOR RAILING SPANNING MAXIMUM OF 6'-0'.
-PROVIDE PREFIN. METAL RAILING W/ 76mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.8.8.5. -GUARDS TO BE 3'-6" (1070mm) -FOR DWELLING UNITS GUARDS TO BE 2'-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C 9.8.8.2. OR -FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO -FOR DWELLING SINIS GUARDS TO BE 3-5 WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C., 9.8.8.2. -VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN.

embedment to studs. -provide same anchor bolts @ 36" o.c. for base plate connection. 37 -LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP

WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE 38 AIR CHANGE PER HOUR, O.B.C.- 9.32.1.3.(3)

39 -CAPPED DRYER VENT

40 -1"X2" (19mmX38mm) BOTH SIDES OF STEEL. WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT 41) WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM

CLIENT SPECIFIC REVISIONS

SECOND FLOOR

TOTAL AREA

SECOND FLOOR OTB

COVERAGE INC PORCH

COVERAGE NOT INC PORCH 1015.8

ELEVATION 'A' | ELEVATION 'B' | ELEVATION 'C' | ELEVATION 'D SF SM SF SM SF SM SF GROUND FLOOR 792.1 73.5 792.1 73.5 792.1 73.5 792.1

959.8

(0.0)

89.1

(0.0)

967.4

(0.0)

160.8 | 1751.9 | 162.7 | 1759.5 | 163.4 | 1746.5 | 162.2

87.2

(0.0)

98.3 1058.3

94.3 1015.8

939.1

(0.0)

1731.2

1058.3

BEAMS MAY BE A MAX. 24" (600mm) FROM LOADBEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS -FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mr

MORE THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 235mm) OR LARGER. WATERPROOF WALLS IN BATHROOMS:

-PRECAST CONC. STEP
-2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND

(45) CARBON MONOXIDE ALARM (CMA), O.B.C.- 9.33.4.

ADJACENT TO EACH SLEEPING AREA.

(7.0m) ABOVE ADJACENT GROUND LEVE

 $\langle 49 \rangle$ EXTERIOR COLUMN W/ MASONRY PIER:

PER O.B.C. 9.20.9.4. -3/4" AIR SPACE AROUND POST.

50 COLD CELLARS:

-PROVIDE 1 IN EACH BEDROOM
-PROVIDE 1 IN EACH HALLWAY SERVICING BEDROOMS

- INSTALLED AT OR NEAR CEILING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL
ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A
VISUAL SIGNALLING COMPONENT
-ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE
THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM

WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED

-CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN

46) -MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY
-PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG.
UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIPHT IS PRESENT.
-R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED

-GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.

-R4 (K3I U./U)

OR
2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN

UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT

AND 21 5/8" (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO

THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0"

-MIN. 6"X6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/

DRAWINGS.

--MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP. REFER TO
ELEVATION DRAWINGS FOR PIER SIZE AND CAP HEIGHT.

--SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED

-MIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR, SURROUND

-MIN. 6 Y6" (140mm X 140mm) WOOD POST CLAD W/ DELOK. SURROUND
(PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
-MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.
REFER TO ELEVATION DRAWINGS FOR PIER SIZE AND CAP HEIGHT.
NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE & Y. 6" POST
PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.

METAL SADDLE NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE

COVER VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.

COVER VENT W/ BUG SCREEN

NSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSL2.11)

O.B.C. 9.5.2.3.
-WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN

REFER TO OBC 9.34.4.1. FOR REQUIRMENTS (EFFECTIVE JANUARY 2018)

<u>@ STAIRS, LANDINGS & RAMPS</u> - OBC 9.8.8.1.(8) WINDOW SILL AT 3'-0" (900mm) OR GREATER DOES NOT REQUIRE GUARDS

IS GREATER THAN 5'-11" (1800mm) REQUIRE A GUARD PER OBC 9.8.8.2.

-ALL FRAMING LUMBER TO BE No.1 AND No. 2 SPF UNLESS NOTED

JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING

-BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING

/INDOWS LESS THAN 1'-7" (480mm) ABOVE FLOORS WHERE ADJACENT GRADE

WINDOW TO BE NON-OPERABLE AND DESIGNED TO WITHSTAND LATERAL LOADS

ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND

DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE

BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mm)
-DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7"

PARALLEL PARTITIONS
-BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE

-FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED

(800mm) AND 6'-7" (2000mm)
-DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING

BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION

OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)(a)&(c) & 3.8.3.13.(2)(f) &

.8.3.13.(4)(c) GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)

ELECTRICAL VEHICLE CHARGING REQUIREMENTS:

@ FLOORS - OBC 9.8.8.1.(6)

490) EXTERIOR COLUMN:
-MIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR, SURROUND

(PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W

FOR COLD CELLARS PROVIDE THE FOLLOWING

-2'-8" X 6'-8" EXTERIOR TYPE DOOR (MIN R-4 RSI 0 7)

-L1+L7 FOR DOOR OPENING

STUD WALL REINFORCEMENT:

53 WINDOW GUARDS:

OTHERWISE.

RAIN LOADS.

PER OBC 9.8.8.1.(8)(b)

FRAME CONSTRUCTION:

-DOUBLE STUDS @ OPENINGS

PARALLEL TO FLOOR JOISTS

PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4

-TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION

I) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY

44 SMOKE ALARM, O.B.C.- 9.10.19.

INSTALLED AT OR NEAR CEILING

REQUIRED AS PER OBC 9.29.2.1. WINDOWS:

-WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF

-FOR GROSS GLAZED AREAS LESS THAN AND EQUAL TO 17%

1.6 W/(m2.K) OR AN ENERGY RATING OF NOT LESS THAN 25 FOR WINDOWS BE DOUBLE GLAZED WITH LOW-E COATING SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF

DRAIN WATER HEAT RECOVERY:

DWHR UNITS TO BE INSTALLED AS PER OBC SB-12 3.1.1.1.(22) & 3.1.1.12. SENTENCES (1) TO (6) - DWHR ARE REQUIRED IN ALL DWELLING UNITS TO RECEIVE DRAIN WATER FROM ALL SHOWERS OR FROM AT LEAST 2 SHOWERS WHERE THERE ARE 2 OR MORE SHOWERS PROVIDED THERE IS A CRAWL SPACE OR STOREY

SM

89.8 954.4

(0.0)

(0.0)

98.3 | 1091.8 | 101.4 | 1091.8 | 101.4

94.3 | 1015.8 | 94.3 | 1015.8 |

73.5

88.6

(0.0)

Gold Park

Mclaughlin and Mayfield

SD-3 Brampton

RN design lmagine 🕨 Inspire 🕨 Create



I JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: 26995 SIGNATURE:

Drawing List:

A1 BASEMENT FLOOR PLAN ELEV. 'A' PARTIAL BASEMENT FLOOR PLAN ELEV. 'B'

A2 GROUND FLOOR PLAN ELEV. 'A' PARTIAL GROUND FLOOR PLAN ELEV. 'B' A3 SECOND FLOOR PLAN ELEV. 'A'

PARTIAL SECOND FLOOR PLAN ELEV. 'B' A4 PART. BASEMENT FLOOR PLAN ELEV. 'C' PART. BASEMENT FLOOR PLAN ELEV. 'D' PART, GROUND FLOOR PLAN ELEV, 'C' PART. GROUND FLOOR PLAN ELEV. 'D' PART. SECOND FLOOR PLAN ELEV. 'C' PART. SECOND FLOOR PLAN ELEV. 'D'

A5 FRONT ELEVATION 'A' FRONT ELEVATION 'B' REAR ELEVATION 'B'&'D' REAR ELEVATION 'A'&'C'

A6 RIGHT SIDE ELEVATION 'B' LEFT SIDE ELEVATION 'A'

A7 FRONT ELEVATION 'C' FRONT ELEVATION 'D' A8 RIGHT SIDE ELEVATION 'D'

LEFT SIDE ELEVATION 'C' TYPICAL CROSS SECTION - SEMI (BRICK) A9 PARTIAL BASEMENT FLOOR PLAN ELEV 'A' & 'B'


> It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans compl with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

 #	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04/07/2014	ng	rpa
2	REVISED AS PER ARCH. CONTROL COMMENTS.	13/08/2014	rpa	djh
3	REVISED AS PER ROOF TRUSS COORDINATION.	14-Aug-14	rpa	djh
4	REVISED AS PER FLOOR COORDINATION.	15-Aug-14	rpa	djh
5	REVISED AS PER ENGINEERING COMM.	27/05/2015	RPA	DJH
6	ISSUED FOR PERMIT	16/06/2015	RPA	DJH
7	REVISED PER 2017 OBC ENACTMENT	21-Feb-17	PM	JP
8	ISSUED FOR PERMIT	2017-08-29	ММ	JM
9	CHANGE PARTY WALLS TO DBL STUD	4-JUNE-19	JM	JM
10				

client	

Homes

13098

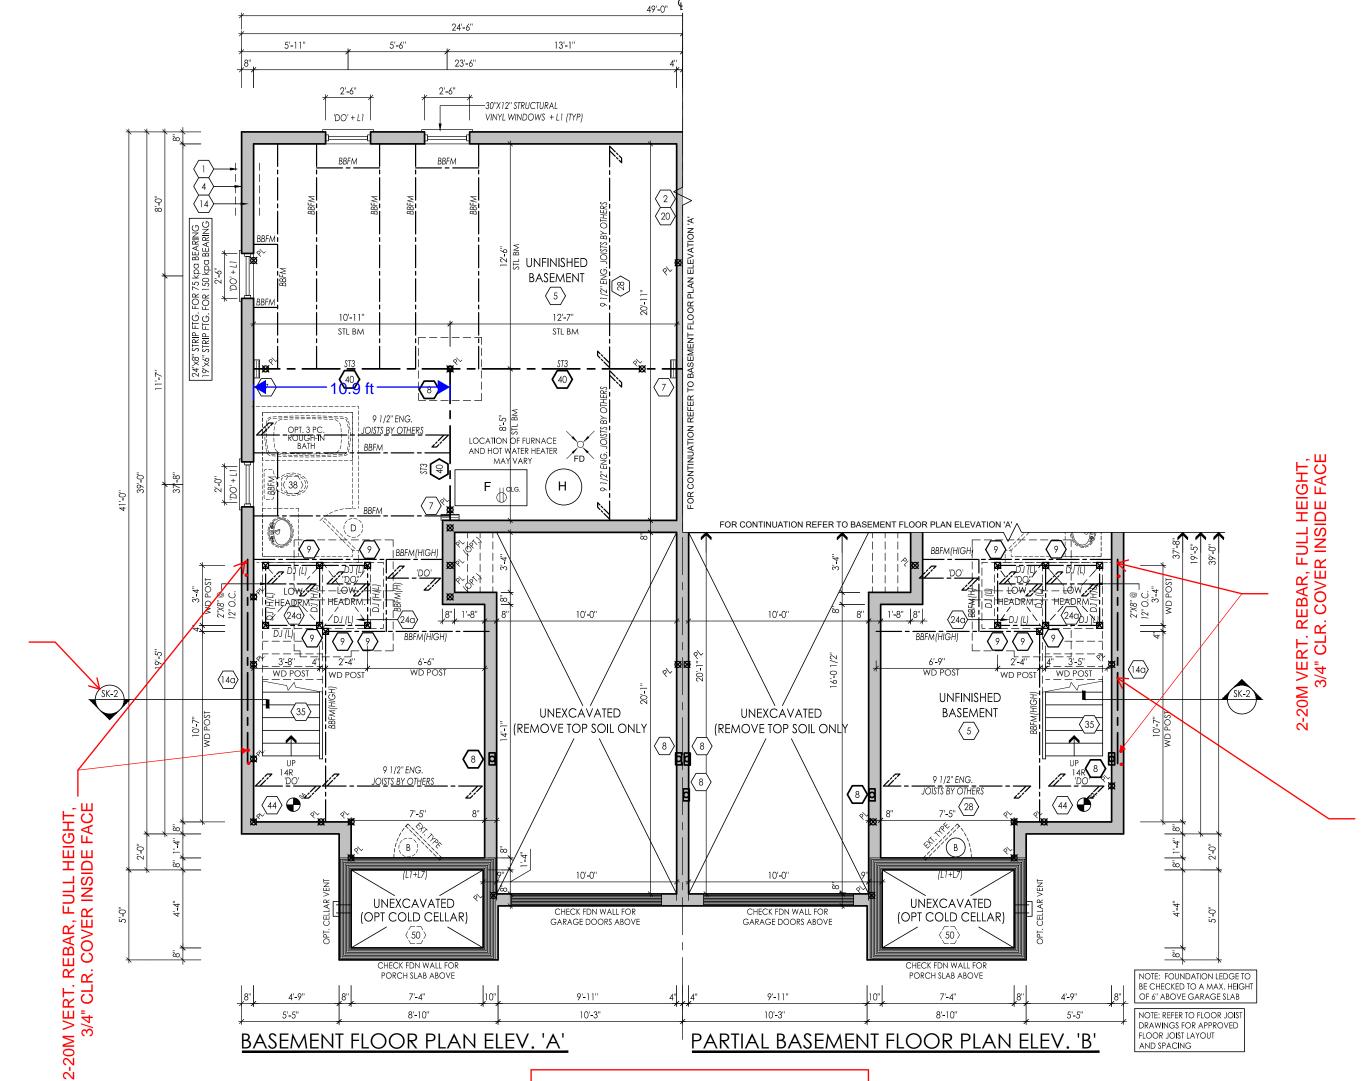

ALL WINDOW LINTELS IN BASEMENT TO

HAVE MIN. 3" BEARING LEGNTH ON

FOUNDATION WALL

REPLACE SECTION SK-2 WITH THE FOLLOWING TEX 4-20M LONG. CONT. BAR @ TOP OF WA 2 EACH FACE, 6" VERT. SPACING, EXT. 2'-0" BEYON OPENIN 2" CLR. COVER OUTSIDE FAC 3/4" CLR. COVER INSIDE FA

REPLACE SECTION SK-2 WITH THE FOLLOWING TEX 4-20M LONG. CONT. BAR @ TOP OF WAI 2 EACH FACE, 6" VERT. SPACING, EXT. 2'-0" BEYON OPENING 2" CLR. COVER OUTSIDE FAC 3/4" CLR. COVER INSIDE FAC RN design

| Imagine | Inspire | Create



I, JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN I**TD, UNDER DIVISION C, PART-3 SUBSECTION-3, 2, 4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN:

SIGNATURE:

47245 26995

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04/07/2014	ng	rpa
2	revised as per roof truss coordination.	14-Aug-14	rpa	djh
3	REVISED AS PER FLOOR COORDINATION.	15/08/2014	RPA	DJH
4	REVISED AS PER ENGINEERING COMM.	27/05/2015	RPA	DJH
5	ISSUED FOR PERMIT	16/06/2015	RPA	DJH
6	REVISED PER 2017 OBC ENACTMENT	23-Mar-17	PM	JP
7	REVISED AS PER FLOOR COORDINATION & ISSUED FOR PERMIT	AUG-10-17	PV	JM
8	CHANGE PARTY WALLS TO DBL STUD	4-JUNE-19	JM	JM
9				
10				
11				
12				

clier

Gold Park Homes

Mclaughlin and Mayfield

model


SD-3 Brampton

roject # 13098

3/16" = 1'0"

.

A1

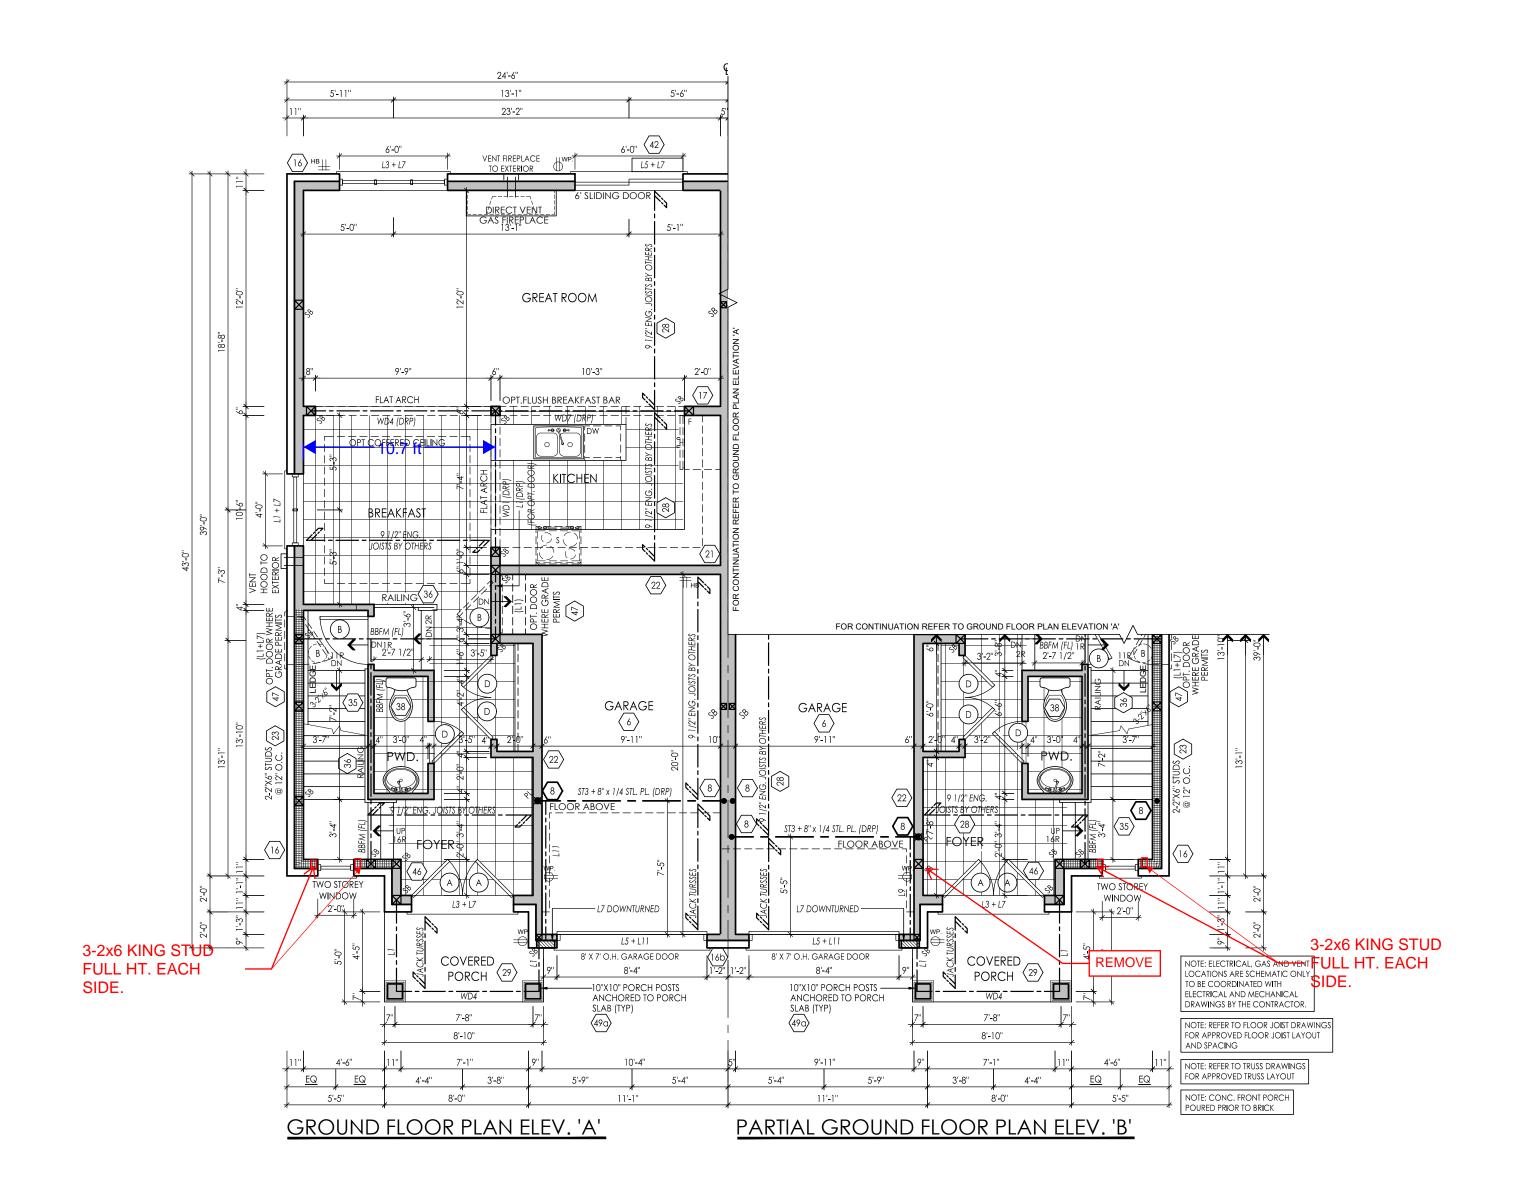





I, JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN I**TD, UNDER DIVISION C, PART-3 SUBSECTION-3, 2, 4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN:

SIGNATURE:

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the populicable Architectural Position

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04/07/2014	ng	rpa
2	REVISED AS PER ROOF TRUSS COORDINATION.	14-Aug-14	rpa	djh
3	REVISED AS PER FLOOR COORDINATION.	15/08/2014	RPA	DJH
4	REVISED AS PER ENGINEERING COMM.	27/05/2015	RPA	DJH
5	ISSUED FOR PERMIT	16/06/2015	RPA	DJH
6	REVISED PER 2017 OBC ENACTMENT	23-Mar-17	PM	JP
7	REVISED AS PER FLOOR COORDINATION & ISSUED FOR PERMIT	AUG-10-17	PV	JM
8	CHANGE PARTY WALLS TO DBL STUD	4-JUNE-19	JM	JM
9				
10				
11				
12				

clier

Gold Park Homes

Mclaughlin and Mayfield

model


SD-3 Brampton

project # 13098

3/16" = 1'0"

lot(s)

A2

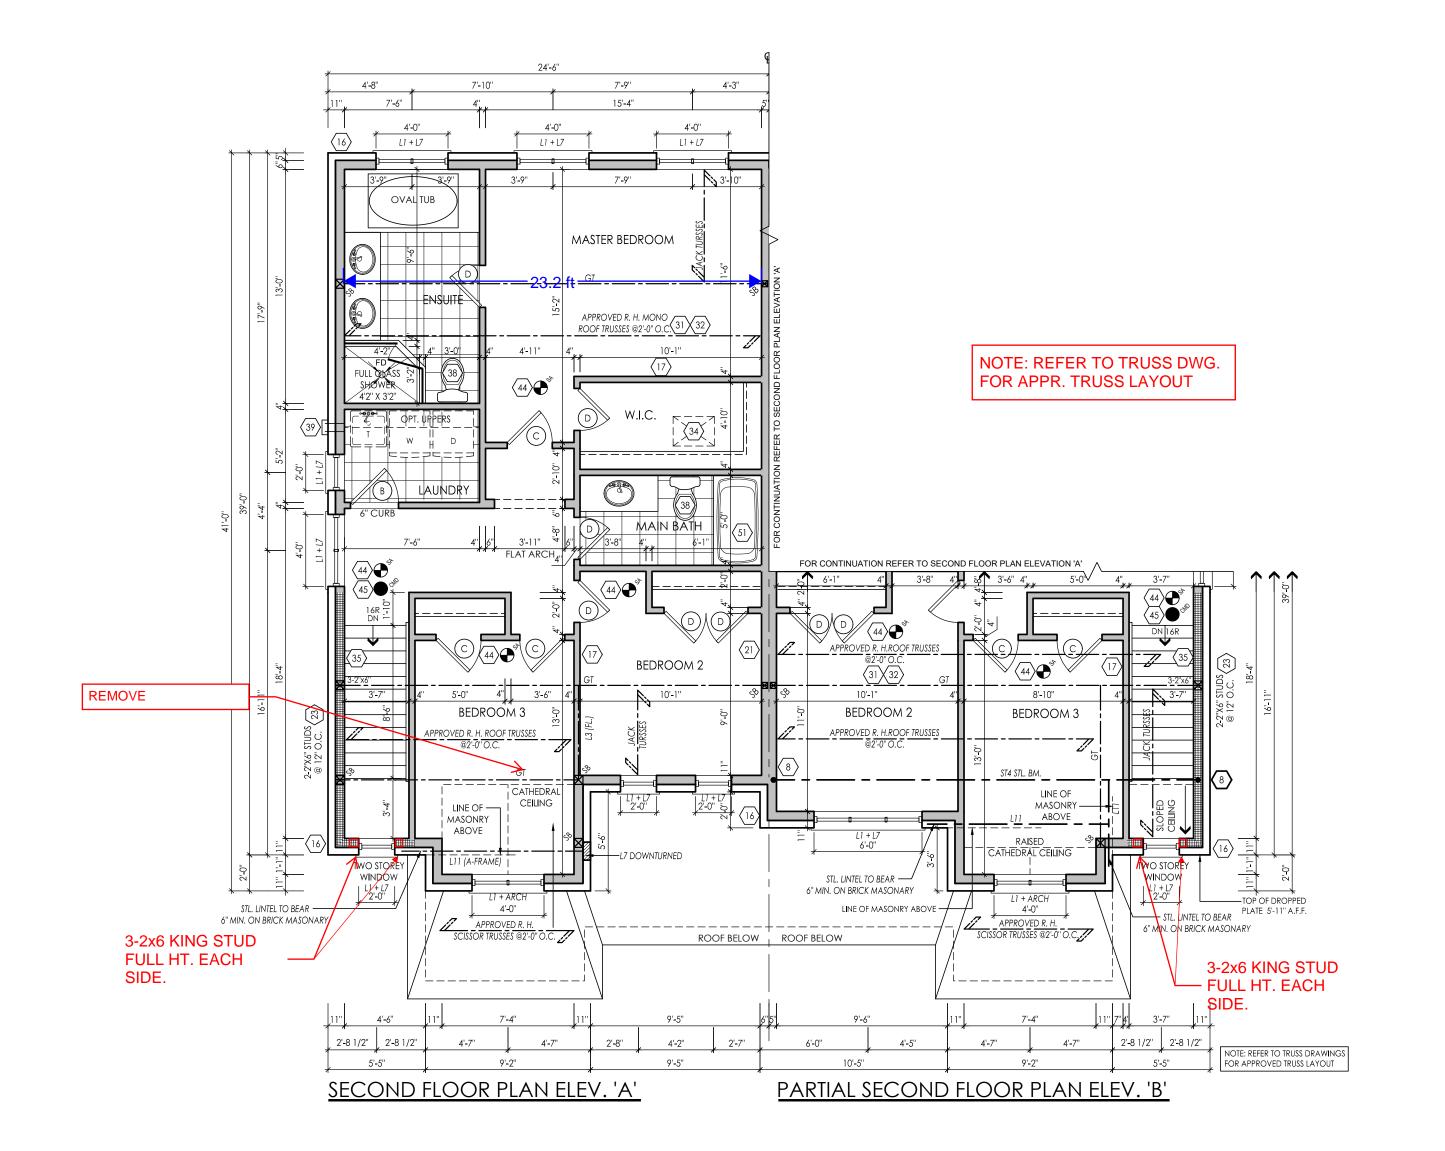

RN design

| magine - Inspire - Create



I, JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS

REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN:

SIGNATURE:

26995

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

	l				
#		revisions	date	dwn	chk
1		ISSUED FOR CLIENT REVIEW	04/07/2014	ng	rpa
2	REVIS	ED AS PER ROOF TRUSS COORDINATION	I. 14-Aug-14	rpa	djh
3	RE	EVISED AS PER ENGINEERING COMM.	27/05/2015	RPA	DJH
4		ISSUED FOR PERMIT	16/06/2015	RPA	DJH
5	f	REVISED PER 2017 OBC ENACTMENT	23-Mar-17	PM	JP
6	REVI	SED AS PER FLOOR COORDINATION & ISSUED FOR PERMIT	AUG-10-17	PV	JM
7	CHANG	GE PARTY WALLS TO DBL STUD	4-JUNE-19	JM	JM
8					
9					
10					
11					
12					

clier

Gold Park Homes

Mclaughlin and Mayfield

model


SD-3 Brampton


13098


3/16" = 1'0"

lot(s)

43

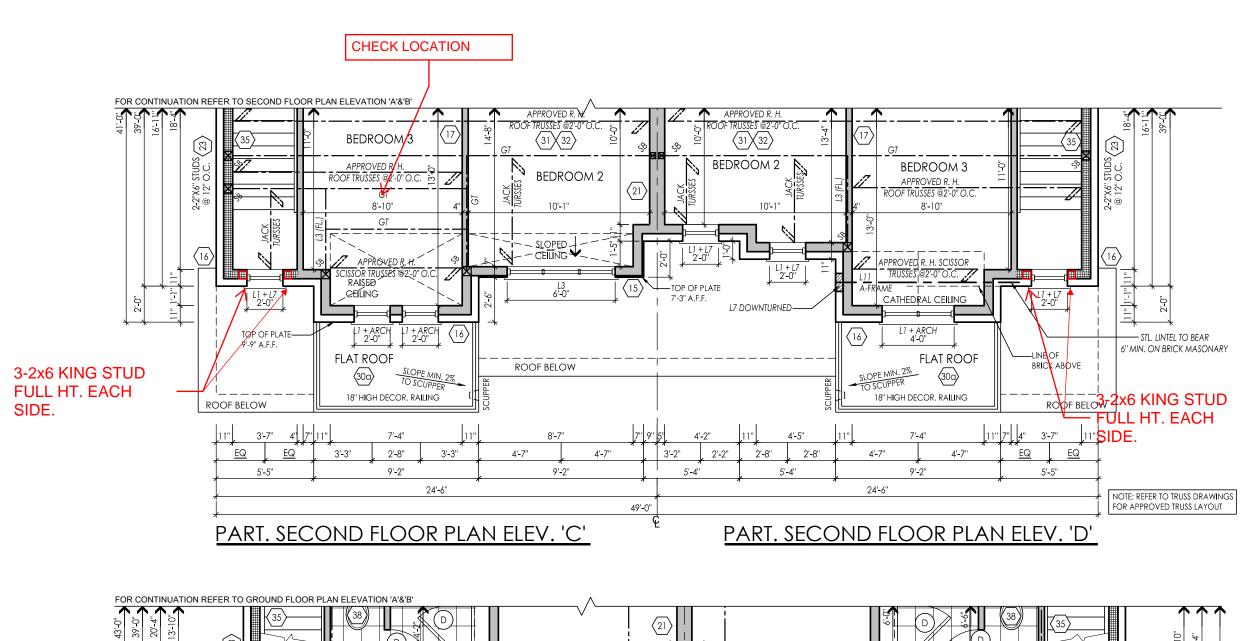

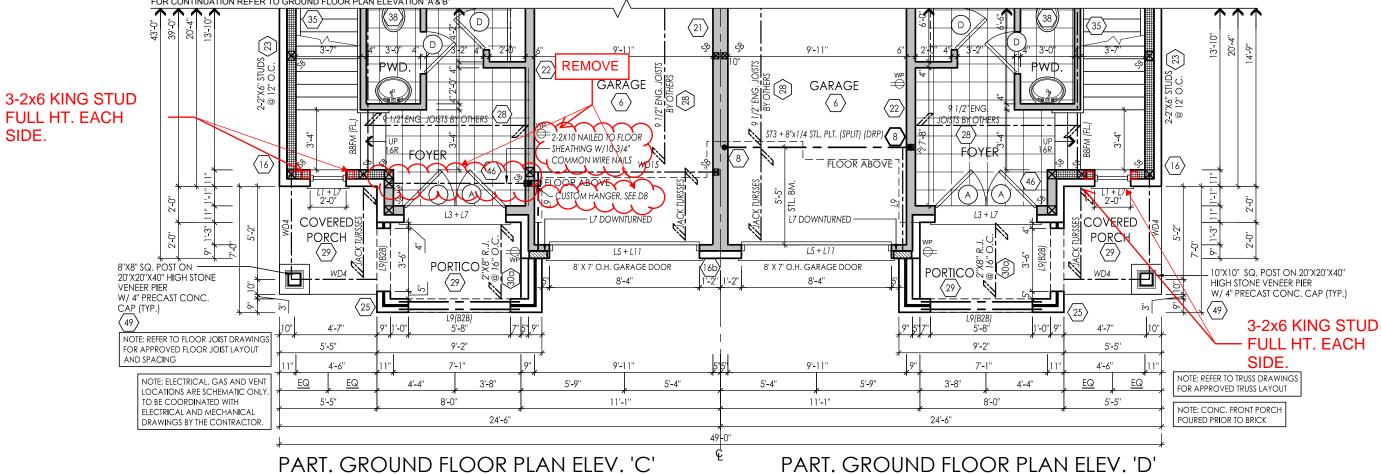

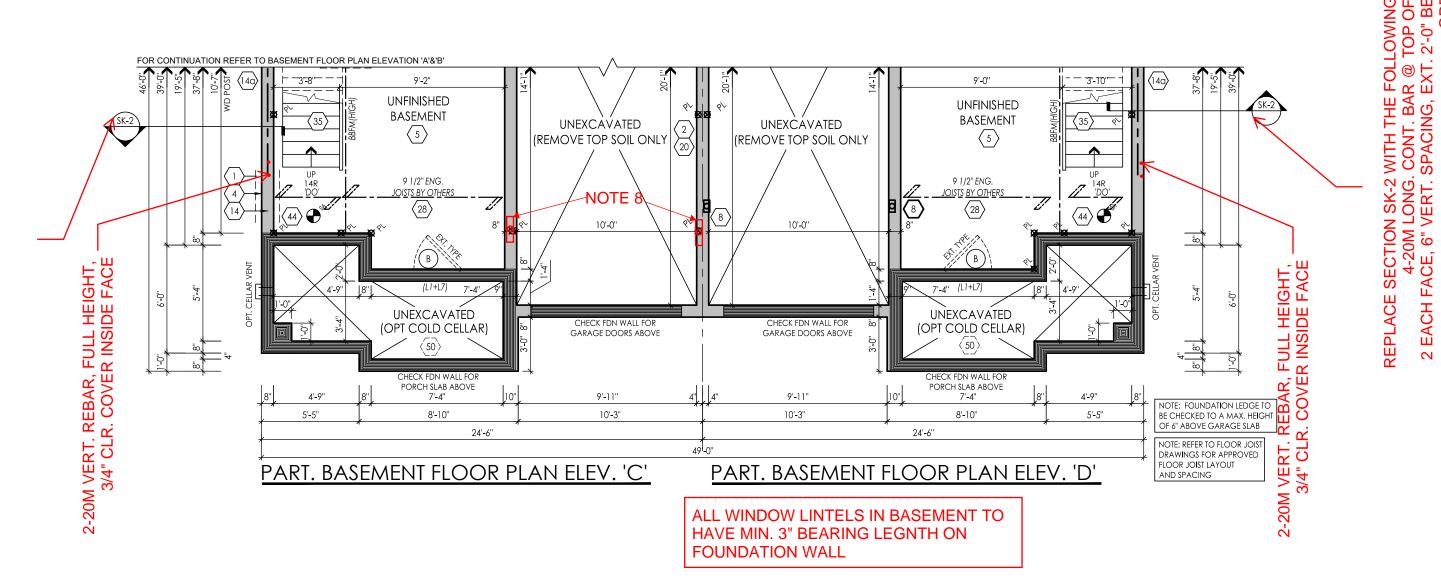

REPLACE SECTION SK-2 WITH THE FOLLOWING 4-20M LONG. CONT. BAR @ TOP OF 2 EACH FACE, 6" VERT. SPACING, EXT. 2'-0" BE OPE 2" CLR. COVER OUTSIDE 3/4" CLR. COVER INSIDE

Imagine - Inspire - Create



I, JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN** ITD, UNDER DIVISION C, PART-3 SUBSECTION-3,2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

SIGNATURE:

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

			_	
#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04/07/2014	ng	rpa
2	REVISED AS PER ROOF TRUSS COORDINATION.	14/08/2014	rpa	djh
3	REVISED AS PER FLOOR COORDINATION.	15/08/2014	RPA	DJH
4	REVISED AS PER ENGINEERING COMM.	27/05/2015	RPA	DJH
5	ISSUED FOR PERMIT	16/06/2015	RPA	DJH
6	REVISED PER 2017 OBC ENACTMENT	23-Mar-17	PM	JP
7	REVISED AS PER FLOOR COORDINATION & ISSUED FOR PERMIT	AUG-10-17	PV	JM
8	REVISED AS PER ENG. COMMENTS, STEEL LINTEL AT GARAGE	18-Apr-10	jm	jm
9	CHANGE PARTY WALLS TO DBL STUD	4-JUNE-19	JM	JM
10				
11				
12				

clie

2" CLR. COVER OL 3/4" CLR. COVER

Gold Park Homes


Mclaughlin and Mayfield

model

SD-3 Brampton

13098 scale 3/16" = 1'0"

Δ

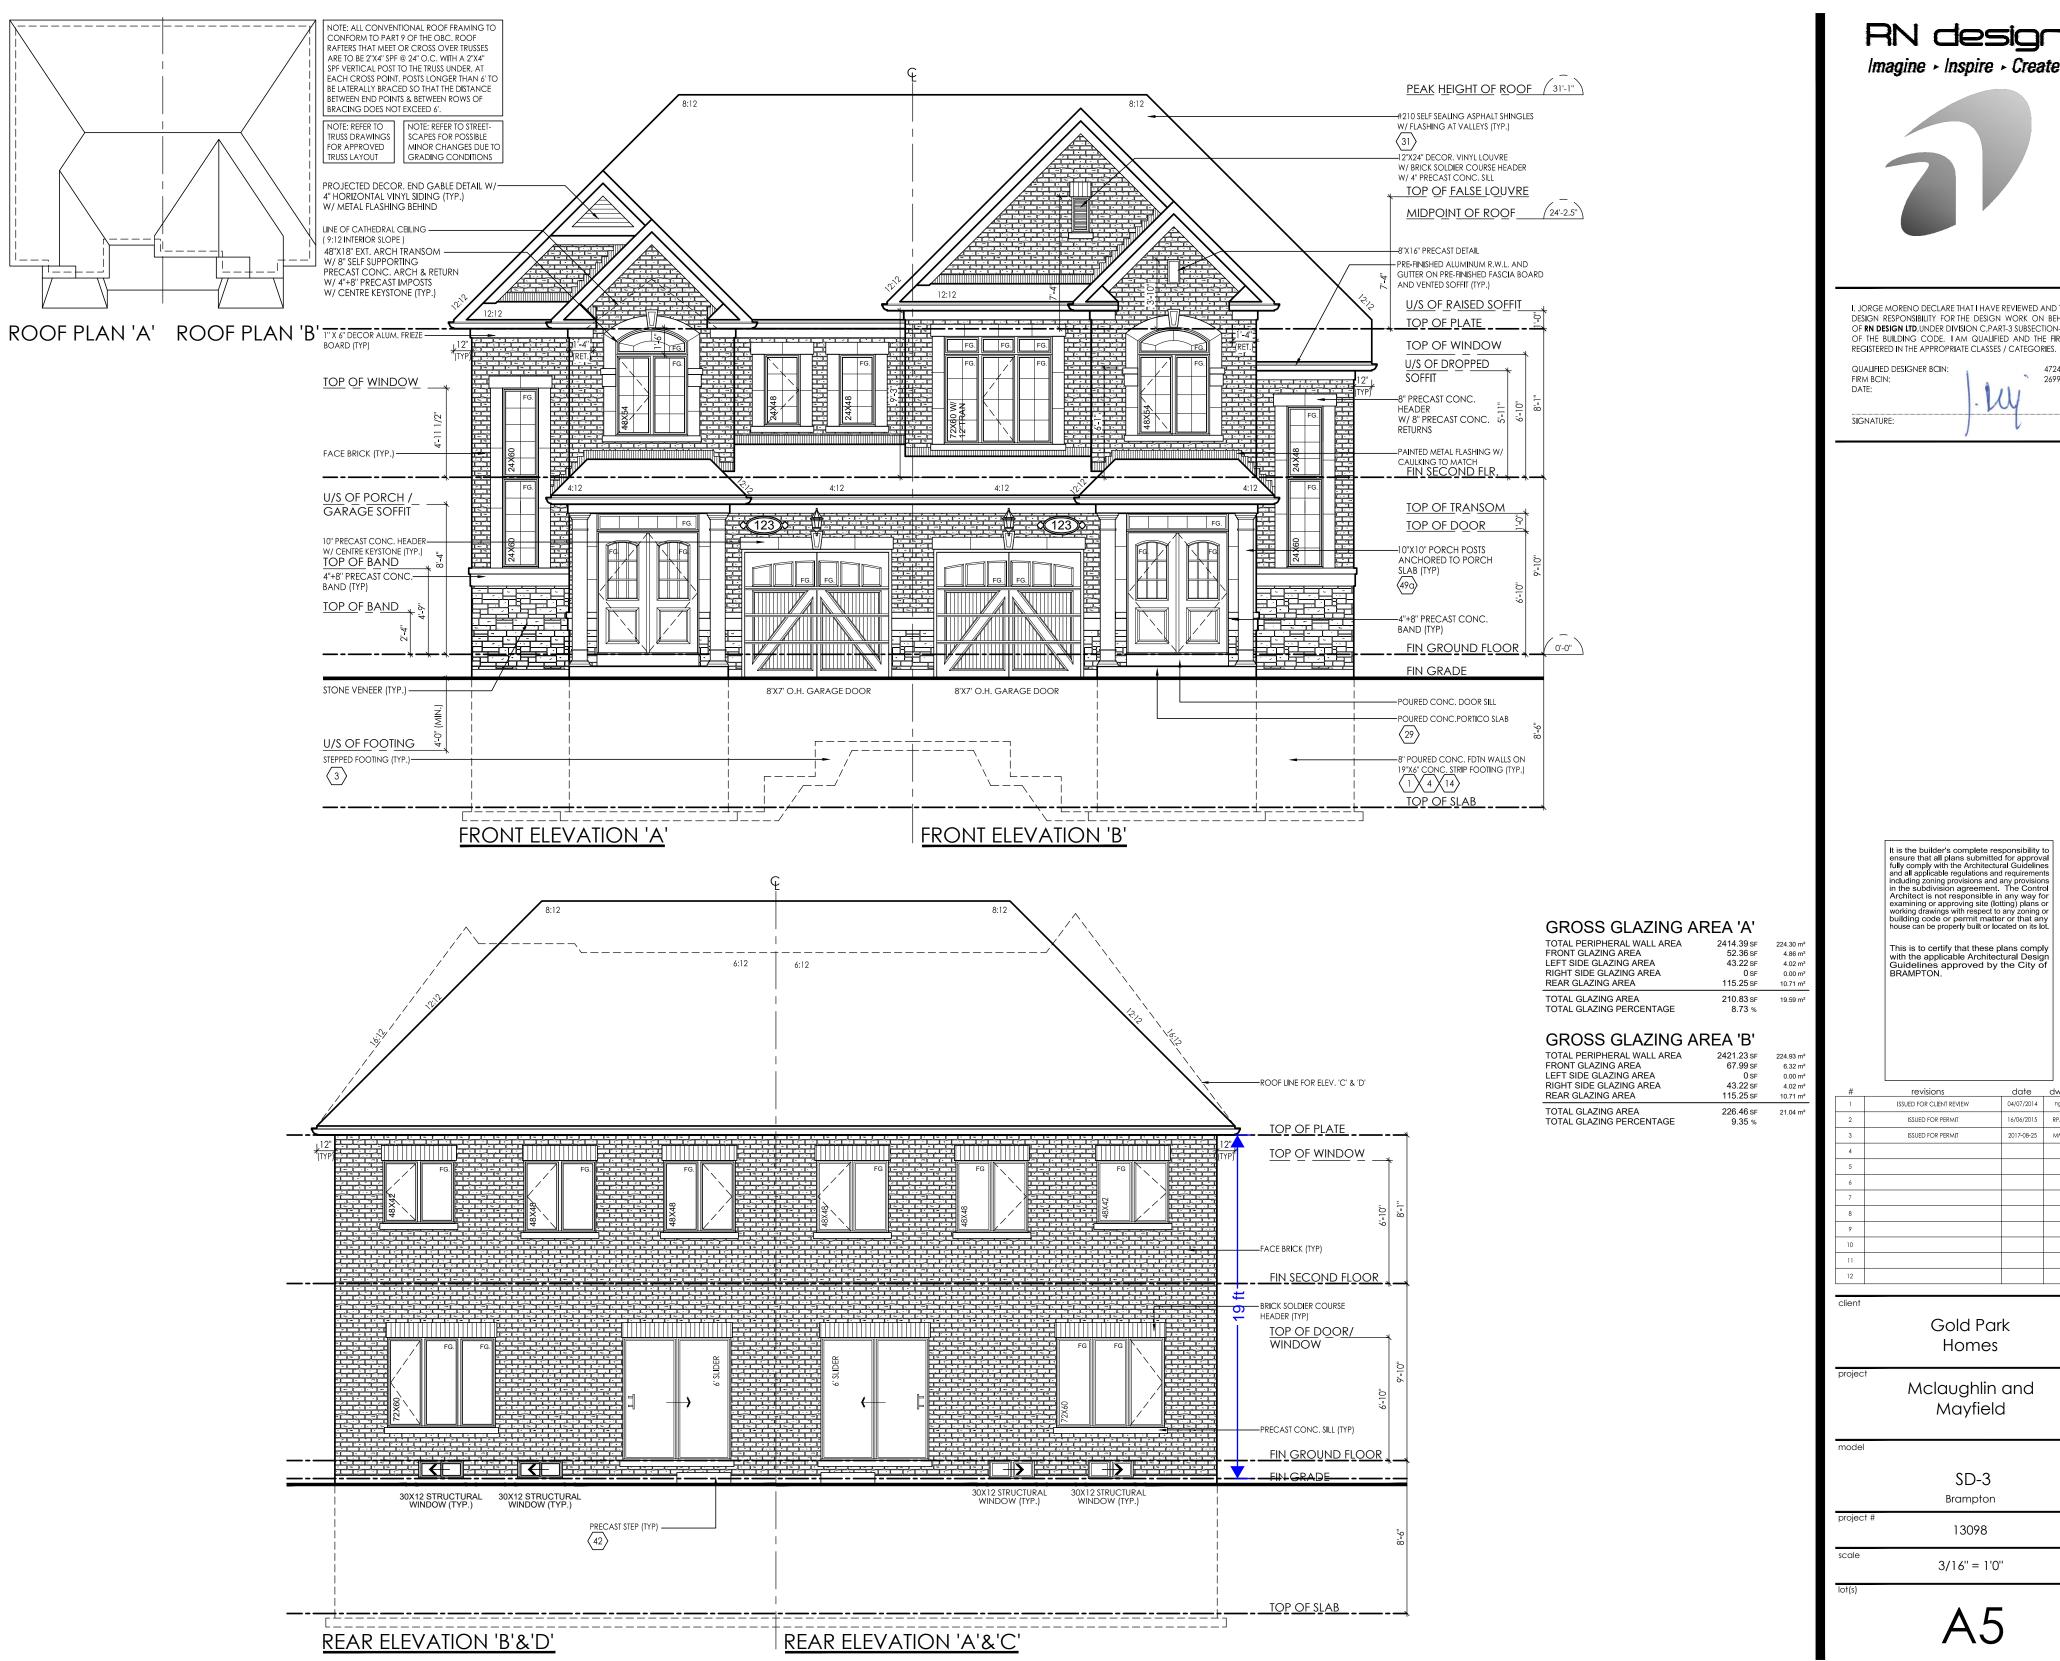

RN design Imagine - Inspire - Create



I, JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS

QUALIFIED DESIGNER BCIN: FIRM BCIN:


It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.


#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04/07/2014	ng	rpa
2	ISSUED FOR PERMIT	16/06/2015	RPA	DJH
3	ISSUED FOR PERMIT	2017-08-25	MM	JM
4				
5				
6				
7				
8				
9				
10				
11				
12				

Gold Park Homes

Mclaughlin and Mayfield

SD-3 Brampton 13098

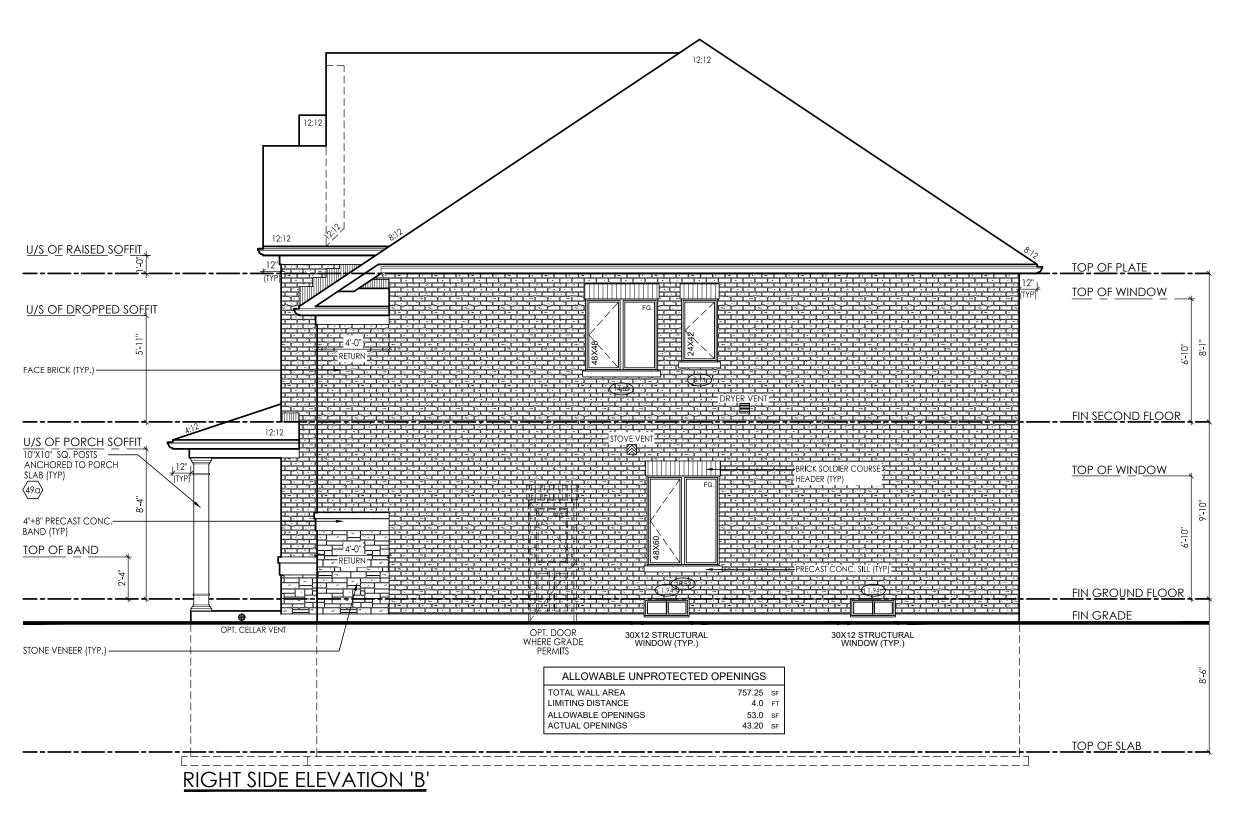

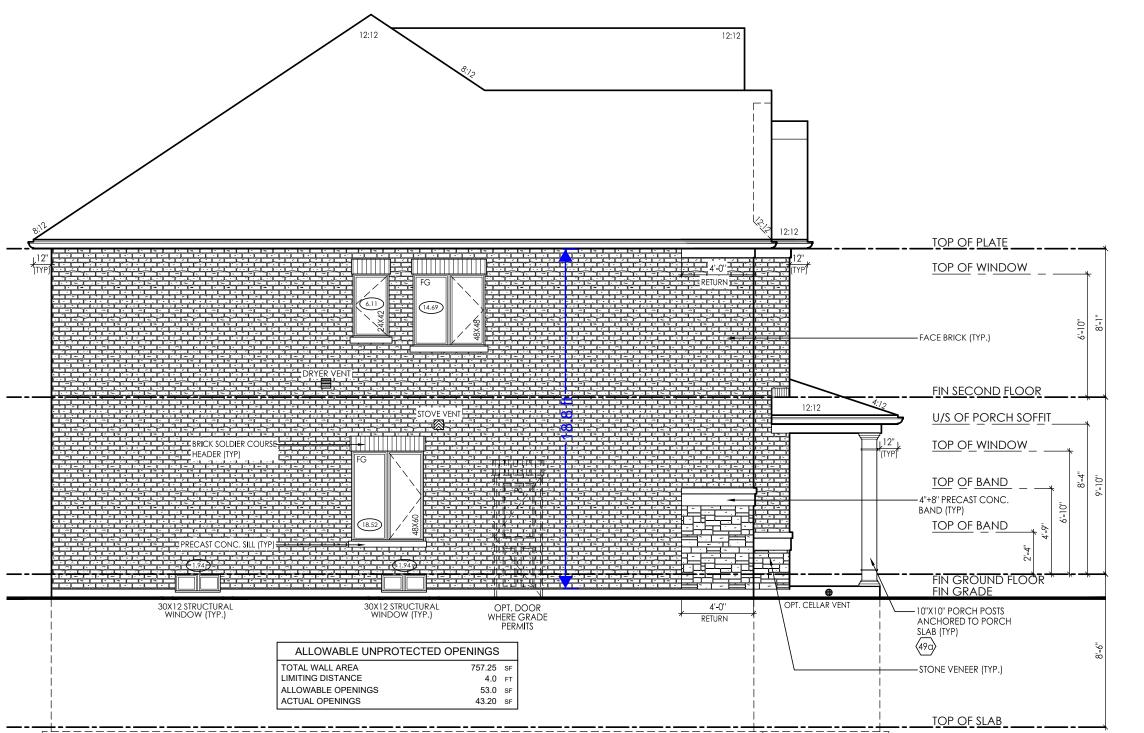

LEFT SIDE ELEVATION 'A'

RN design |magine - |nspire - Create



I, JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN ITD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN: DATE:

SIGNATURE:

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

clien

Gold Park Homes

Mclaughlin and Mayfield

model

SD-3 Brampton

13098

scale 3/16" = 1'0"


Δ

GROSS GLAZING AREA 'C'

TOTAL PERIPHERAL WALL AREA	2414.39 sf	224.30 m ²
FRONT GLAZING AREA	62.54 SF	5.81 m²
LEFT SIDE GLAZING AREA	43.22 SF	4.02 m²
RIGHT SIDE GLAZING AREA	0.0sF	0.00 m ²
REAR GLAZING AREA	115.25 SF	10.71 m²
TOTAL GLAZING AREA	221.01sF	20.53 m²
TOTAL GLAZING PERCENTAGE	9.15 %	

GROSS GLAZING AREA 'D'

TOTAL PERIPHERAL WALL AREA	2414.39 sF	224.30 m
FRONT GLAZING AREA	50.54 SF	4.70 m
LEFT SIDE GLAZING AREA	0.0sF	0.00 m
RIGHT SIDE GLAZING AREA	43.22 SF	4.02 m
REAR GLAZING AREA	115.25 SF	10.71 m
TOTAL GLAZING AREA	209.01 sf	19.42 m
TOTAL GLAZING PERCENTAGE	8.66 %	

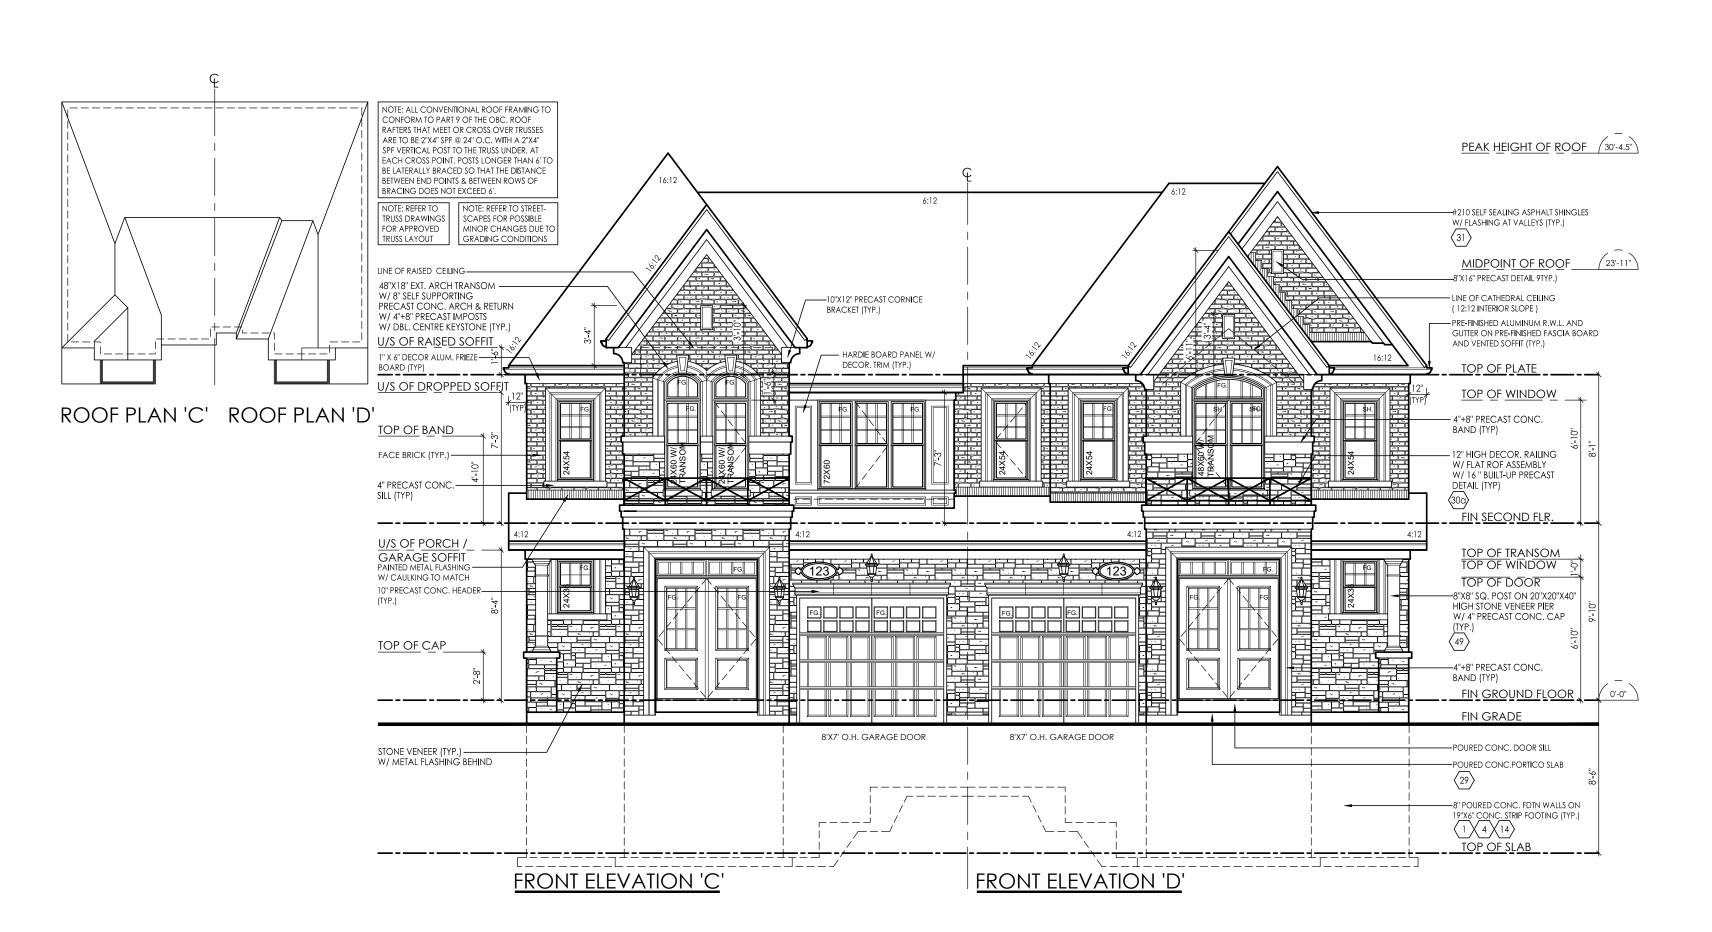



Imagine - Inspire - Create



I, JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF **RN DESIGN LID**, UNDER DIVISION C.P.ART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN; DATE:

SIGNATURE:

47245 26995

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	04/07/2014	ng	rpa
2	REVISED AS PER ARCH, CONTROL COMMENTS.	13/08/2014	rpa	djh
3	ISSUED FOR PERMIT	16/06/2015	RPA	DJH
4	ISSUED FOR PERMIT	2017-08-25	MM	JM
5				
6				
7				
8				
9				
10				
11				
12				

clien

Gold Park Homes

Mclaughlin and Mayfield


model


SD-3 Brampton

13098

3/16" = 1'0"

۸ 7

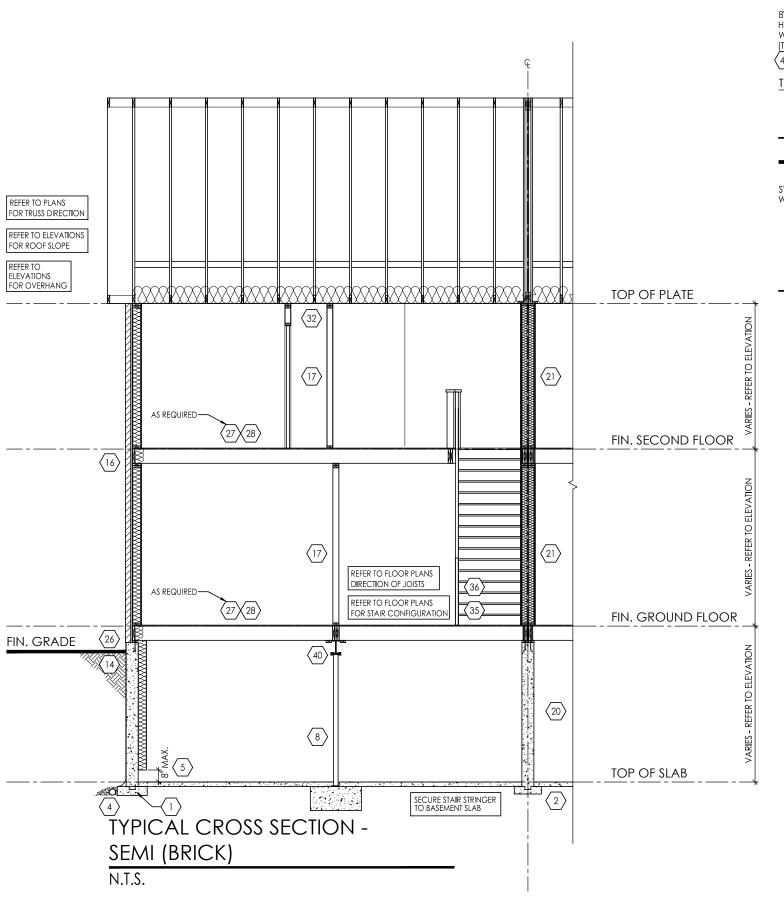

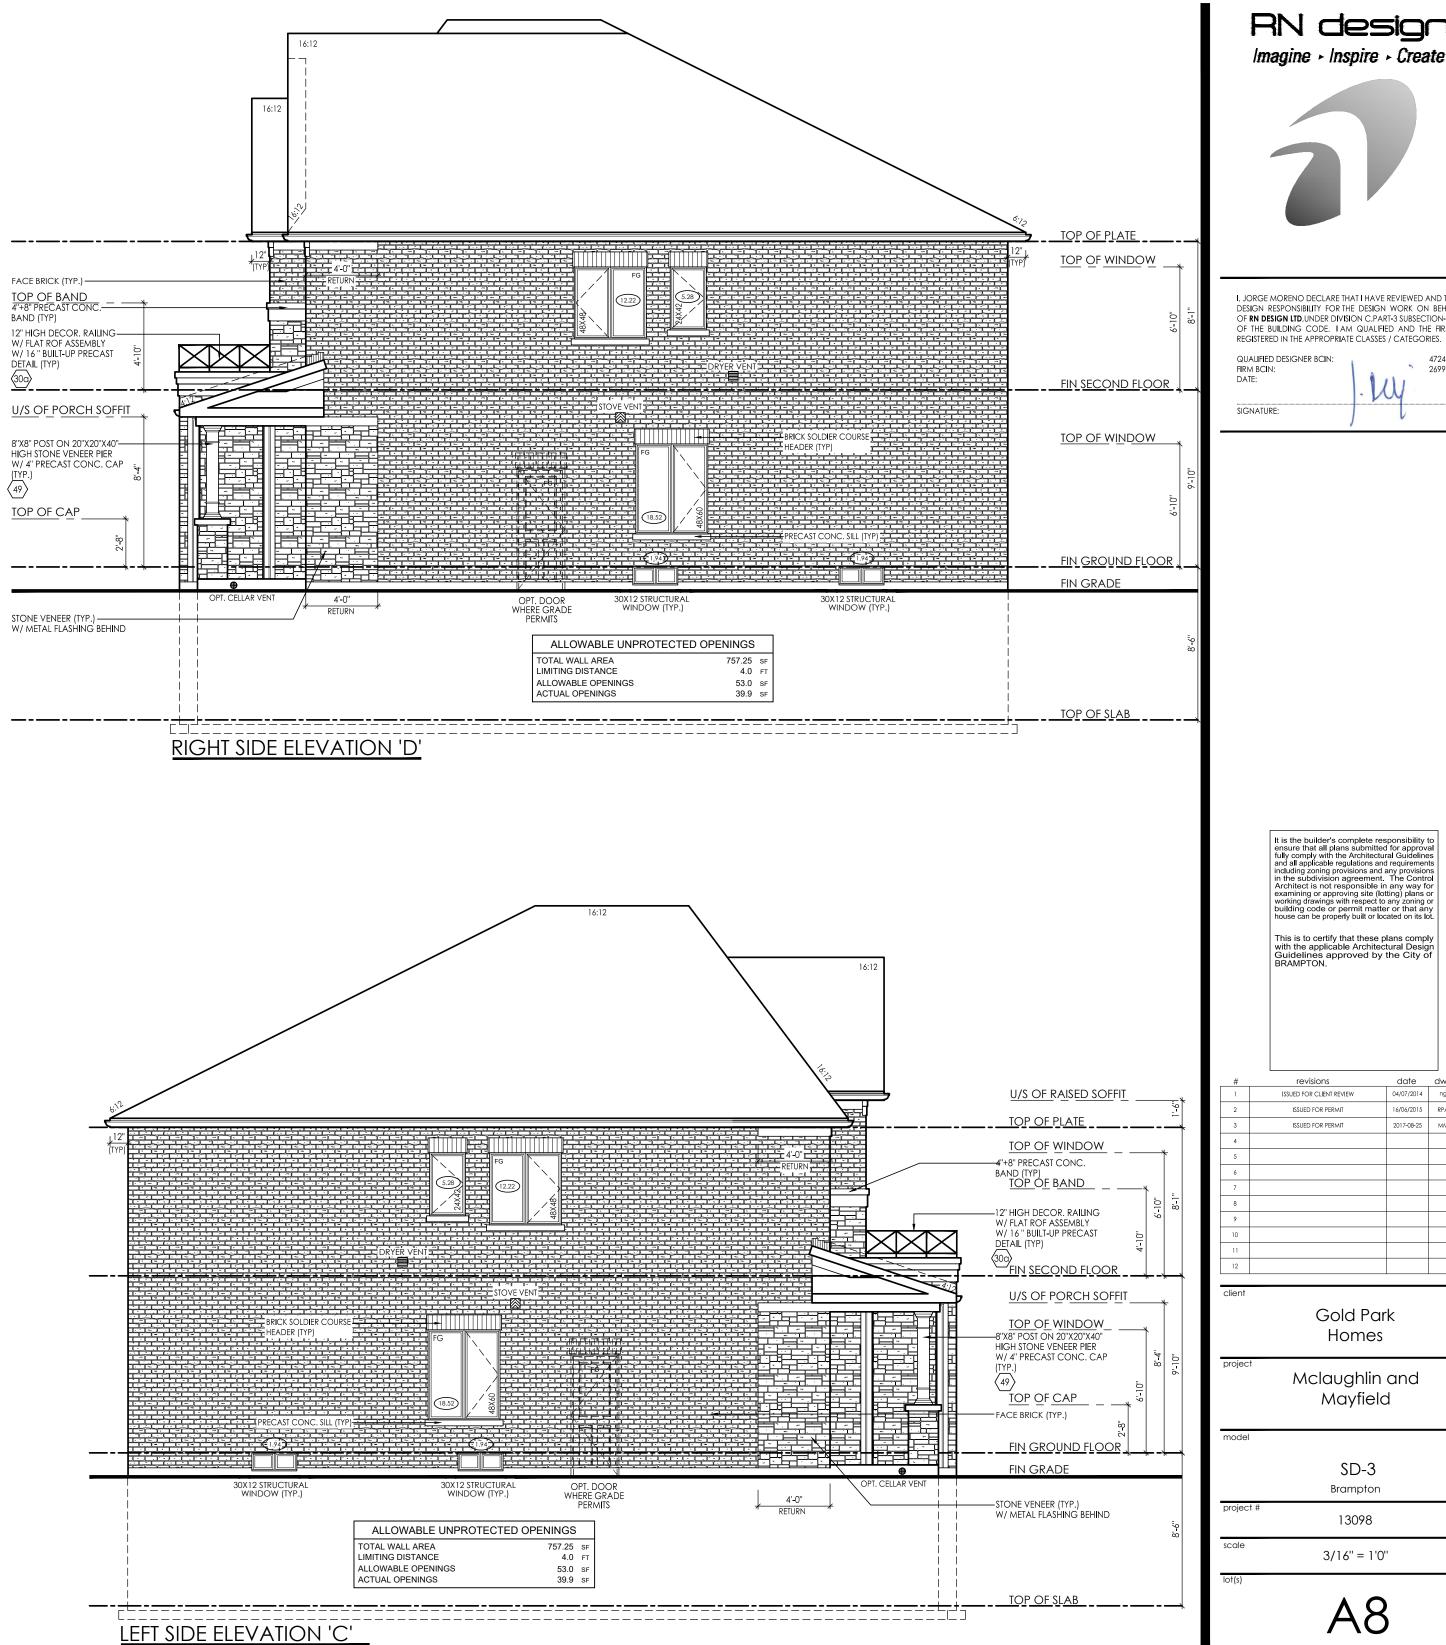

RN design Imagine - Inspire - Create



I, Jorge Moreno Declare that I have reviewed and taken Design Responsibility for the Design Work on Behalf OF RN DESIGN LTD, UNDER DIVISION C.PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS

QUALIFIED DESIGNER BCIN:

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot. This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.


revisions ISSUED FOR CLIENT REVIEW 04/07/2014 ng rpa 16/06/2015 RPA DJH ISSUED FOR PERMIT 2017-08-25 MM JM ISSUED FOR PERMIT


> Gold Park Homes

Mclaughlin and Mayfield


SD-3

Brampton 13098

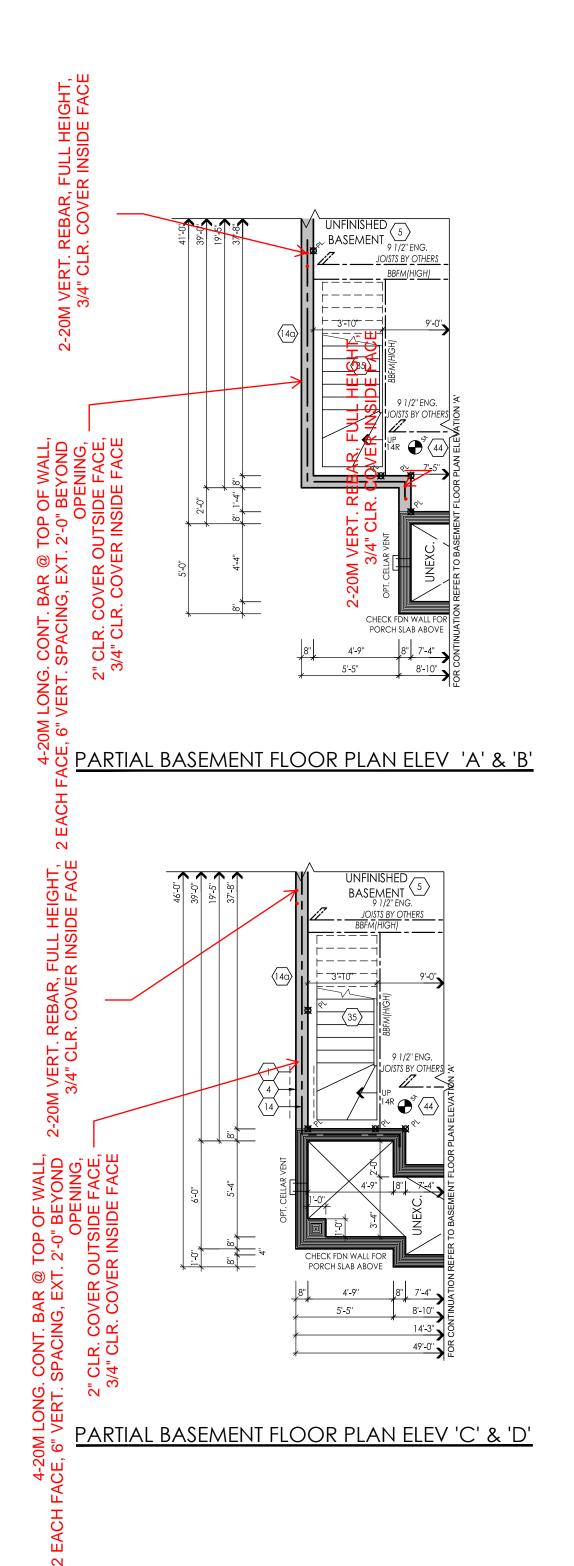

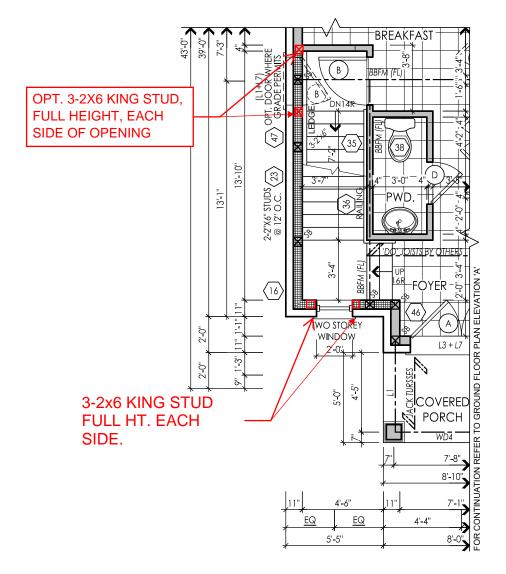

PARTIAL GROUND FLOOR ELEV 'A' & 'B'

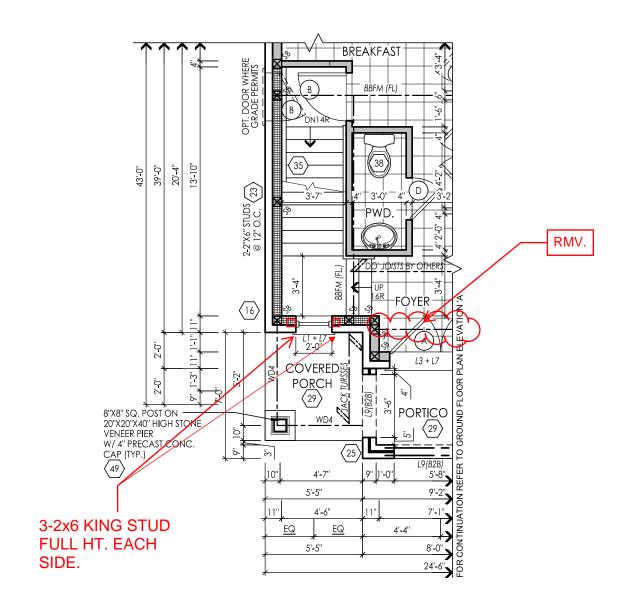

PARTIAL GROUND FLOOR PLAN ELEV 'C' & 'D'

RN design

| magine + | Inspire + Create



I, JORGE MORENO DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD, UNDER DIVISION C, PART-3 SUBSECTION-3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: FIRM BCIN:

SIGNATURE:

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of BRAMPTON.

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	2007-05-19	jm	jm
2				
3				
4				
5				
6				
7				
8				
9				
10				
11				
12				

client

Gold Park Homes

Mclaughlin and Mayfield

model

SD-3 Brampton

13098

scale

A /

49