-ALL DIMENSIONS GIVEN FIRST IN IMPERIAL FOLLOWED BY METRIC.

THERMAL RESISTANCE VALUES BASED ON ZONE 1

FOOTINGS / SLABS: TYPICAL STRIP FOOTING:

O.B.C. 9.15.3.

-BASED ON 16-1"(4.9m) MAX. SUPPORTED JOIST LENGTH

-MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS

-SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL W/ MIN. 10.9psi (75kPa) BEARING CAPACITY -FTG. TO HAVE CONTINUOUS KEY

-TIG. SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY
(AS PER SOILS ENGINEERING REPORT)
-REFER TO WORKING DRAWINGS FOR SPECIFIC SIZES THAT MAY SUPERSEDE
NOTES #1 & #2 FOR FOOTING SIZES

TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

O.B.C. 9.15.3.5.

-FTG. TO EXTEND MIN. 4"-0" (1200mm) BELOW GRADE

BRICK VENEER -1 STOREY -13" X 4" (330mm X 100mm)

-2 STOREY -19" X 6" (485mm X 155mm) -3 STOREY - 26" X 9" (660mm X 230mm)

-1 STOREY - 10" X 4" (255mm X 100mm SIDING--2 STOREY - 14" X 4" (360mm X 100mm) -3 STOREY - 18" X 5" (460mm X 130mm) 2 TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

1 STOREY MASONRY - 16" X 4" (410mm X 100mm) -1 STOREY STUD - 12" X 4" (305mm X 100mm) -2 STOREY MASONRY - 26" X 9" (650mmX 230mm) 2 STOREY STUD - 18" X 5" (450mm X 130mm - 18 X 5 450mm X 130mm 3 STOREY MASONRY - 36" X 14" (900mm X 360mm 3 STOREY STUD - 24" X 8" (600mm X 200mm

3 STEP FOOTING: O.B.C. 9.15.3.9 -23 5/8" (600mm) MAX. VERTICAL RISE & 23 5/8" (600mm) MIN. HORIZONTAL

4 DRAINAGE TILE OR PIPE: O.B.C. 9.14.3.

-4" (100mm) MIN. DIA. LAID ON UNDISTURBED OR WELL COMPACTED SOIL
W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FLR. SLAB.

-3" (75mm) CONCRETE SLAB

COVER TOP & SIDES OF TILE OR PIPE W/ 5 7/8" (150mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL 5 BASEMENT SLAB: O.B.C. 9.13. & 9.16.

-ZZUJOSI (15MFG) AFIEK 28 DAYS - O.B.C. 9, 16.4.5.
DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR
TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa)
COMPRESSIVE STRENGTH AFTER 28 DAYS
-4" (100mm) OF COURSE GRANULAR MATERIAL

-2200psi (15MPg) AFTER 28 DAYS - O.B.C. 9.16.4.5.

-PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG. WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO FLOOR DRAIN PER O.B.C.9.31.4.4.

-FLOOR DRAIN PER O.B.C.,9.31.4.4. -R10 (RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23-1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NO LESS THAN 23-1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (OBC SB-12 -UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTAR'

DARD (O.B.C. SB-9) SLAB ON GROUND:

3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3. -2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
-DAMPPROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
-DAMPPROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi(25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
-R10 (RSI 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23-1/2" (600mm) OF GRADE. (OBC SB-12 3.1.1.7.(6) 4" (100mm) OF COURSE GRANULAR MATERIAL
PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTG,
WHERE SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO

-FLOOR DRAIN PER O.B.C.9.31.4.4. - UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY

NDARD (O.B.C. SB-9) 6 GARAGE SLAB / EXTERIOR SLAB:

-4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR

UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.3.1.6. O'NGLIN ONCED COINC, A W 7-90% AIR ENIKANIMENT - V.B.C. Y.J. 1.6.
-6" X 6" (WC.Y. X W 2.9) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
-4" (100mm) OF COURSE GRANULAR MATERIAL
-ANY FILL PLACED UNDER SLAB, OTHER THAN COURSE CLEAN GRANULAR
MATERIAL, SHALL BE COMPACTED.

7 PILASTERS: O.B.C. 9.15.5.3.

PILASTER -CONCRETE NIB - 4" X 12" (100mm X 300mm) PER O.B.C. 9.20.11.2. TOP 7 7/8" (200mm) SOLID.

BEAM POCKET
4" (100mm) INTO FDN, WALL W/ WIDTH TO MATCH BEAM SIZE. -1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2.) STRUCTURAL COLUMNS -SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM

NOT MORE THAN 2 WOOD FRAME FLOORS. WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-1" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4kPa). 8 STEEL PIPE COLUMN:

O.B.C. 9.15.3.4, & 9.17.3. -FIXED COLUMN -MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS -FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mmX 100mmx 6.35mm) STEEL BTM, PLATE 6.3311111) STEEL BIM. FLATE -FOR WOOD BEAMS, MIN. 4"X4"X1/4" (100mmX 100mm X 6.35mm) STEEL TOP -ADJUSTABLE COLUMNS TO CONFORM TO CANI/CGSB-7.2-M WHERE IMPOSED LOAD DOES NOT EXCEED 36 KN (O.B.C. 9.17.3.4.) COL. SPACING:

- 34" X 34" X 16" -MAX. 9'-10" (2997mm) - (860mmX 860mmX 400mm) - 44" X 44" X 21" - (1120mmX 1120mmX 530mm) -MAX. 16'-0" (4880mm)

- 40" X 40" X 19 (1010mmX 1010mmX 480mm) -MAX, 16'-0" (4880mm) - 51" X 51" X 24" nX 1295mmX 610mm

-WHERE COL. SITS ON FDN. WALL, USE 4"X 8"X 5/8" (100mmX 200mmX 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

(9) WOOD COLUMN: OBC 9.17.4.1 , 9.17.4.2, & 9.17.4.3. -5 1/6" x 5 1/6" (140mm x 140mm) SOLID WOOD COLLIMN - OR -3-2"xx" (38mm x 140mm) BUILT UP COLUMN NAILED TOGETHER W/ 3" (76mm) NAILS SPACED NOT MORE THAN 12" (300mm) APART OR BOLTED TOGETHER W/ 3/8" (9.52mm) DIA BOLTS SPACED AT 18" (450mm) O.C.

-COLUMN TO SIT DIRECTLY ON CONC PAD (NOT ON CONC SLAB) 25"x25"x12" (640mm x 640mm x 300mm) CONC PAD (1 FLOOR SUPPORTED W/ 34"x34"x14" (860mm x 860mm x 360mm) CONC PAD (2 FLOORS SUPPORTED W/

10 BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES) 2"X8"X12" LEDGER BOARD FASTENED W/ 2/ 1/2" ANCHOR BOLTS @ 4" O.C. WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11 WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE

BETWEEN ADJACENT BEAMS $\left\langle \begin{array}{c} 1 \end{array} \right\rangle$ BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM) -12"X11"X 5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2- 1/2 "Ø x8" ANCHOR BOLTS.

WALL ASSEMBLIES: 14 FOUNDATION WALL:

-FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN LATERALLY SUPPORTED HEIGHT. -8" (200mm) SOLID 2200psi (15MPa) CONCRETE NAX. UNSUPPORTED HEIGHT OF 3-11" (1200mm) & MAX. SUPPORTED HEIGHT F 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR. FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATERALLY SUPPORTED HEIGHT -10" (250mm) SQLID 2200nsi (15MPa) CONCRETE -10" (250mm) SOLID ZZUDPS (15MPC) CUNCKETE
-MAX, UNSUPPORTED HEIGHT OF 4-7" (1400mm) & MAX. SUPPORTED HEIGHT
OF 8'-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.

-LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS. -FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IT

-1 OA CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C.- T.9.15.4.2.A SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C.- PART 4 WALL SHALL EXTEND A MIN. 5 7/8" (150mm) ABOVE GRADE -INSULATE W/ R20 (RSI 3.52) CONTINUOUS INSULATION FROM UNDERSIDE OF

SUBFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1 OBC SB-12 T.3.1.1.2.A.)
- ALTERNATE INSULATION MEHOD: 2" (51 mm) R10 (RSI 1.76)RIGID INSULATION W/ 2"X4" (38mm X 89mm) WOOD STUD W/ R12 (RSI 2.11) BATT INSULATION -BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL
THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO RN DESIGN LTD

REDUCTION OF THICKNESS: WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS. HAN 3-1/2" (90mm) THICK. .HAN 3-1/2 (YUMM) I MICK. -TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7 7/8" (200mm) VERTICALLY O.C. & 2-11" (900mm) HORIZONTALLY.

-FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
-WHERE WALL IS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE
MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK DAMPPROOFING & WATERPROOFING:

-DAMPPROOF THE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C 9.13.2. - WHERE INSULATION EXTENDS TO MORE THAN 2'-11" (900mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1.(2) (3) (4)
-FINISHED BASEMENTS SHALL HAVE INTERIOR DAMPPROOFING EXTENDING

FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3.(3)
-WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE
WATERPROOFED AS PER O.B.C. 9.13.3.
-WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMPPROOFING.

FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

-2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING) -2-20M BARS IN TOP PORTION OF WALL (BY 0° TO 10° 0° OPENING) -3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING) -4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING) -BARS STACKED VERTICALLY AT INTERIOR FACE APPROX 4" TO 6" APART. -BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER -BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

15 FRAME WALL CONSTRUCTION:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2. 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. -174 (billin) T two C (Editor T T L) (billin) T two C (1800) (180 -1/2" (12.7mm) GYFSUM BOARD NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO

BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING -REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m. -REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): -REFER TO REQUIREMENTS FOR LESS THAN 4"-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV. ALTERNATE FRAME WALL CONSTRUCTION:

SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-1 1/2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C.

7.27.3.4.) .RRACE W./ CONT. 14.GALIGE STEEL 'T' RRACES FROM TOP PLATE TO RTM. PLATE. -BRACE WY CON1. 16 GAUGE SIEEL 1 BRACES PROM TOP PLATE TO BIM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2"X 4" (38mmX 89mm) SOLID WO BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BIM. PLATE FOR FULL LENGTH OF WALL. -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS. -R14 (RSI 2.46) INSULATION ONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. &

7.23.4.
NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =
-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE

REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE -ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.16. BETWEEN RIGID INSULATION AND WOOD STUD REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE

-REFLACE R 14 (R3) 2-46) INSULATION WITH R 14 (R5) 2-46) ABSOCRETIVE INSULATING MATERIAL WITH A MASS OF AT LEST 2-8 kg/ sq.m. -REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE "X' GYPSUM BD. REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
-NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).

OK -VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID INSULATION

(15b) FRAME WALL CONSTRUCTION @ GARAGE:

O.B.C. 9.23.
-SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
-WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
-1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. '2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. =

-FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS: -ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD. REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE): -REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND NON-COMBUSTABLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO

-VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES

16 BRICK VENEER CONSTRUCTION:

-3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING -PROVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ BTM. COURSE & OVER BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2)) -BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER -1" (25mm) AIR SPACE

WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2. 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C MIN. R22 (RSI 3.87) INSULATION (ZONE 1. OBC SB-12 T.3.1.1.2.A.) CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3.

& 9.25.4. -1/2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE): O.B.C. SB-3 WALL = FW1b (STC = N/A. FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS: -REPLACE R22 (RSL 3.87) INSULATION WITH R22 (RSL 3.87) ARSORPTIVE NSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m. -REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

ALTERNATE BRICK VENEER CONSTRUCTION:

O.B.C. 9.23. -3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. neight – MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL PROVIDE WEEP HOLES @ 2'-7" (800mm)O.C. @ BTM. COURSE & OVER

BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2) BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER 2" (38mm) R8 (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C.

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) -2" X 4" (38mmx 89mm) WOOD \$1UD\$ @ 16" (400mm) O.C. @ 12" (300mm)
O.C. ON BOTTOM FIR. WHEN 3 \$100REY\$
-BRACE W, CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BTM.
PLATE FOR THE FULL LENGTH OF WALL, OR
-CONT. 2" X 4" (38mmx 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY
45 DEG. FROM TOP PLATE TO BTM. PLATE FOR FULL LENGTH OF WALL
-R14 (RS12.46) INSULATION
-CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. - 9.25.3. &
9.25.4 -1/2" (12.7mm) GYPSUM BOARD

NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O B C T 9 23 10 1 = NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. -FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN) FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
-ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23,16, BETWEEN RIGID INSULATION AND WOOD STUD. -REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE ISULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

| BRICK VENEER CONSTRUCTION @ GARAGE: O.B.C. 9.23. -3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36'-1" (11m) MAX. HEIGHT
-MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT
STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C.
VERTICAL SPACING
-PROVIDE WEEP HOLES @ 2-7" (800mm) O.C. @ BTM. COURSE & OVER

-BASE FLASHING UP TO 5 7/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2)) -BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER i (25mm) air space Wall Sheathing membrane as per O.B.C. 9.27.3.2. 1/4" (6mm) Plywood (exterior Type) or equivalent as per O.B.C.

-2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. /2" (12.7mm) GYPSUM BOARD NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mmX 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mmX 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C. REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

O.B.C. SB-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD
THE FOLLOWING MATERIALS:
-ADD R15 (RSI 2.64) ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/

-REPLACE 1/2"(12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD. 17 INTERIOR STUD WALLS:

O.B.C. T.9.23.10.1. -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/ - DOUBLE 2" X 4" OR 2" X 6" TOP PLATES AND SINGLE BOTTOM PLATE -1/2" (12.7mm) GYPSUM BOARD BOTH SIDES.

18 BEARING STUD WALL (BASEMENT): -2" X 4" (38mmX 89mm) WOOD STUDS @ 16" (400mm) O.C. OR -2" X 4" (38mmX 97mm) WOOD STUDS @ 16" (400mm) O.C. OK -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. W/ -DBL, 2" X 4" OR 2" X 6" TOP PLATE. -2" X 4" OR 2" X 6" BOTTOM PLATE ON DAMPPROOFING MATERIAL. -1/2" (12.7mm) GYPSUM BOARD BOTH SIDES. -1/2" (12.7mm) DIA. ANCHOR BOLTS @ 7-10" (2400mm) O.C.

-FOOTING AS PER GENERAL NOTE #2 W/ 4" CONC. CURB 19 PARTY WALL - BLOCK: O.B.C. SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)

-MIN. 1 HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS -SPACE BETWEEN TOP OF WALL & ROOF DECK SHALL BE TIGHTLY FILLED W/
MINERAL WOOL OR NONCOMBUSTIBLE MATERIAL & CAULKED TO PREVENT SMOKE PASSAGE -1/2" (12.7mm) GYPSUM BOARD W/ TAPED JOINTS BOTH SIDES -2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. BOTH -ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF 90% OF THE 7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE) -STAGGER JOISTS & BEAMS MIN. 3 1/2" (90mm) @ PARTY WALLS AS PER O.B.C. 9.10,9.9.(1) & TABLE 2.1.1. SB-2

ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1) PARTY WALL - BLOCK (AGAINST GARAGE): -2" X 6" (38mmX 140mm) WOOD STRAPPING @ 16" (400mm) O.C.

R22 (RSI 3.52) RIGID INSULATION -7 1/2" (190mm) HOLLOW BLOCK (NORMAL WEIGHT AGGREGATE) -1/2" (12.7mm) GYPSUM BOARD @ WALL & U/S OF CEILING BETWEET -TAPE AND SEAL ALL JOINTS GAS TIGHT

O.B.C. 9.10.11. & 3.1.10. & SB-3 WALL = B6e (STC = 57, FIRE = 2 HR)
- ONE FIREWALL IS REQUIRED FOR EVERY 6460 S.F. (600 SQ.M) OF BUILDING
AREA, O.B. C. T.3.2.2.47.
-1/2" (12.7mm) GYPSUM BOARD W/TAPED JOINTS

-2" X 2" (38mmX 38mm) WOOD STRAPPING @ 24" (600mm) O.C. ON BOTH SIDES OF WALL
SOUND ABSORPTIVE MATERIAL EACH SIDE FILLING 90% OF THE CAVITY
-7 1/2" (190mm) CONC. BLOCK, MIN. 2 HR. FIRE-RESISTANT RATING
EVERY FIREWALL SHALL BE CONTINUOUS THROUGH ALL BUILDING STOREYS
-STAGGER JOISTS & BEAMS MIN. 5" (130mm) @ FIRE WALLS AS PER O.B.C. 9.10.9.9.(1) & TABLE 2.1.1 SB-2 ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1) -ACUSSICAL SEALANT AS FER CIB.C. 36-3 (NOTE (2) TO TABLE 1)
-PROTRUDE PAST FASCIA @ EAVES W/ BRICK CORBELLING
-EXTEND 5 7/8" (150mm) ABOVE ROOF SURFACES & HAVE ALUMINUM CAP W/
THROUGH WALL FLASHING PER O.B.C. 3.1.10.4.(1)

-WHERE THE DIFFERENCE IN HEIGHT BETWEEN ADJACENT ROOFS IS GREATER THAN 9'10" (3m), WALL NEED NOT EXTEND PAST UPPER ROOF SURFACE PER O.B.C. 3.1.10.4.(2)

20 PARTY WALL - FOUNDATION:

O.B.C. 9.15.4.2. -7 7/8" (200mm) SOLID CONC. FOUNDATION WALL @ 2200psi (15MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS -FOUNDATION WALL TO REST ON FOOTING PER GENERAL NOTE #2

PARTY WALL - WOOD STUD (TYPICAL): O.B.C. SB-3 WALL = W15c (STC = 61, FIRE = 1 HR) -MIN. 1HR FIRE-RESISTANCE RATING CONTINUOUS FROM TOP OF FOOTINGS TO THE U/S OF ROOF DECK -2 ROWS 2"X4"(38mmX 89mm) STUDS @ 16"(400mm) O.C. W/ SEPARATE 2" X 4" (38mmX 89mm) BOTTOM PLATE & SEPARATE DOUBLE 2" X 4" 38mmX 89mm) TOP PLATES

SOUND ABSORPTIVE MATERIAL ON BOTH SIDES FILLING A MINIMUM OF -2 LAYERS OF GYSUM ON BOTH SIDES (as follows 1st LAYER - 5/8" (16mm) TYPE 'X' GYPSUM BOARD BOTH SIDES W/ JOINTS TAPED & FILLED. -ACOUSTIC GREEN GLUE b/w GYPSUM 1st & 2nd LAYERS 2nd LAYER - 1/2" (12mm) REGULAR GYSUM BOARD BOTH SIDES W/ JOINTS TAPED & FILLED -ACOUSTICAL SEALANT AS PER O.B.C. SB-3 (NOTE (2) TO TABLE 1) NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. T.9.23.10.1. = -FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38MMX 89MM) STUDS ARE REQUIRED TO BE SPACED @ 12" (300MM) O.C.
-FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38MMX 140MM) STUDS ARI
REQUIRED TO BE SPACED @ 12" (300MM) O.C. - IF 2"X6" STUDS ARE USED AT STAIR OPENING CONTINUE TO US

ON REMAINING FLOORS AT THE STAIR OPENING AT 16" O.C.

9.25.3. & 9.25.9.

O.B.C. 9.10.9.16.(3) 1/2" (12 7mm) GYPSUM BOARD ON BOTH SIDES OF WALL & LI/S OF FILING BETWEEN HOUSE AND GARAGE CHILING BEIWEEN HOUSE AND GARAGE
-TAPE AND SEAL ALL JOINTS GAS TIGHT
-R22 (RSI 3.87) INSULATION IN WALLS,
-R31 (RSI 5.41) INSULATION IN CEILINGS W/ FLOOR ABOVE
-CONTINUOUS AIR/WAPOUR BARRIER IN CONFORMANCE W/ O.B.C.9.25.3. & 9.25.4. FOR FLOOR ABOVE.
-INSULATION AROUND DUCTS AND PIPING NOT TO ENCROACH MIN.
-ECUILED C. APLACE A BYEA (PEEER TO MINICIPAL STANDARDS) REQUIRED GARAGE AREA (REFER TO MUNICIPAL STANDARDS). /2" (12.7mm) GYPSUM BOARD ROOF FRAMING MEMBERS ARE FASTENED TO TOP PLATES WITH I- 3 1/4" (82mm) TOE NAILS BOTTOM PLATES ARE FASTENED TO FLOOR JOISTS, BLOCKING OR RIM JOIST WITH 3 1/4" (82mm) NAILS AT 7 7/8" (200mm) O.C.

WALLS ADJACENT TO ATTIC SPACE:

-1/2" (12 7mm) CVPSIII 192 17 12.7mm) GYPSUM BOARD TINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.-9.25.3. & 9.25.4. -2" X 6" (38mmX 140mm) WOOD STUDS @ 16" (400mm) O.C. -R22 (RSI 3.87) INSULATIÓN) GYPSUM BOARD OR 1/4" (6mm) PLYWOOD SHEATHING

23 DOUBLE VOLUME WALLS: -3/8" (9.5mm) PLYWOOD, OSB OR WATERBOARD SHEATHING -REFER TO PLAN FOR STUD SPECIFICATION -STUDS FASTENED AT TOP & BOTTOM WITH 3/ 3-1/4" (82mm) TOE NAILS -DOUBLE TOP PLATES FASTENED TOGETHER WITH 3" (76mm) AT

-MIN. R22 (RSI 3.87) INSULATION (ZONE 1 OBC SB-12 T.3.1.1.2.A.)

CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C.

ATTIC ACCESS TO BE PROVIDED AS PER O.B.C. 9.19.2.1.

EXPOSED FLOOR:

(33) CONVENTIONAL FRAMING: FLOOR AS PER NOTE # 28 CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C.- 9.25.3. & 9.25.4.

O.B.C. TABLE A6 OR A7

GENERAL: $\overline{\left(35\right)}$ PRIVATE STAIRS:

-MIN. RUN

-MIN. TREAD

HANDRAILS:

-MAX. NOSING

ANGLED TREADS:

O.B.C. 9.8.7

HEIGHT: O.B.C. 9.8.7.4

PROJECTIONS: O.B.C. 9.8.7.6

O.B.C. 9.8.4.

MIN. HEADROOM = 6'-9"

350 PUBLIC STAIRS:

-MAX. RISE

-MIN. RUN

-MIN. TREAD

HANDRAILS:

DIRECTION HEIGHT:
O.B.C. 9.8.7.4

O.B.C. 9.8.7

PROJECTIONS: O.B.C. 9.8.7.6

TERMINATION: O.B.C. 9.8.7.3

O.B.C. SB-7 & 9.8.8.3.

-PROVIDE MID-SPAN POSTS AS PER SB-7

-FROVIDE SAME ANCHOR BOLLS & 36 O.C. TOR BA

AIR CHANGE PER HOUR, O.B.C.- 9.32.1.3.(3)

 $\langle 40 \rangle$ -1"X2" (19mmX38mm) BOTH SIDES OF STEEL.

36b EXTERIOR GUARDS @ JULIET BALCONY:

MBEDMENT TO STUDS.

(360) EXTERIOR GUARDS:

-MIN. HEADROOM = 6'-5"

-MIN. WIDTH = 2'-10" (860mm)
(BETWEEN WALL FACES)
-MIN. WIDTH = 2'-11" (900mm)
(EXIT STAIRS, BETWEEN GUARDS)

-MIN. RUN = 5 7/8" (150mm) -MIN. AVG. RUN = 7 7/8" (200mm)

- 2'-10" (865mm) MIN. TO 3'-2" (965mm) MAX.

O.B.C. 9.8.4. -MAX. RISE

-2"X4" (38mm X 89mm) COLLAR TIES AT MIDSPANS

(34) ATTIC ACCESS HATCH:

OBC 9,19,2.1, & SB-12,3.1,1.8,(1)

-19,3/4" X 27,1/2" (500mm X 700mm) ATTIC HATCH WITH

WEATHERSTRIPPING & BACKED W/ R20 (RSI 3.52) INSULATION.

= 8-1/4" = 9-1/4"

-2" X 6" (38mm X 140mm) RAFTERS @ 16" (400mm) O.C. MAX. SPAN 12'-9"

NG JOISTS TO BE 2" X 6" (38mmX 140mm) @ 16" (400mm) O.C.

UNLESS OTHERWISE NOTED.

-HIP & VALLEY RAFTERS TO BE MIN. 2" (50mm) LARGER THAN COMMON RAFTERS & MIN. 1 1/2" (38mm) THICK.

= 7-7/8" (200mm

-MIN. AVG. KUN = 7.7/8 (ZOUTHIN)
FINISHED RALILING ON WOOD PICKETS MAX. 4" BETWEEN PICKETS
-EXTERIOR CONC. STEPS TO HAVE MIN. 9 1/4" (235mm) TREAD &
MAX. 7 7/8" (200mm) RISE
-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2
-FTG. FOR FOUND. WALL TO BE MIN. 4-0" (1220mm) BELOW GRADE

-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)

HANDRAILS ARE TO BE CONTINUOUS EXCEPT WHERE INTERRUPTED BY DOOR

TWO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-'7" (1100mm)

-ONE HANDRAIL IS REQUIRED ON CURVED STAIRS OF ANY WIDTH WITHIN

- 3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS

MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A

STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

= 7-3/32" (180mm)

-FOUND. WALL REQUIRED WHEN NUMBER OF RISERS EXCEEDS 2 -FTG. FOR FOUND. WALL TO BE MIN. 4'-0" (1220mm) BELOW GRADE

-ONE HANDRAIL REQUIRED WHERE STAIR WIDTH IS LESS THAN 3'-7" (1100mm)

TIMO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-7" (1 100m/ - TIMO HANDRAILS REQUIRED WHERE STAIR WIDTH EXCEEDS 3-7" (1 100m/ - TIMO HANDRAILS ARE REQUIRED ON CURVED STAIRS OF ANY WIDTH - HANDRAILS ARE TO BE CONTINUOUS INCLUDING AT LANDINGS EXCEPT WHERE INTERRUPTED BY DOOR WAYS OR NEWEL POSTS AT CHANGES IN

C.D.C. 7.0.7.4

-2-10" (865mm) MIN. TO 3'-2" (965mm) MAX.

-3'-6" (1070mm) WHERE GUARDS ARE REQUIRED ON LANDINGS)

- MEASURED VERTICALLY FROM THE TOP OF THE HANDRAIL TO A

STRAIGHT LINE DRAWN FROM THE TANGENT TO THE TREAD NOSING

- HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP

STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

- ONE HAND RAIL SHALL EXTEND HORIZONTALLY NOT LESS THAN 11 3/4"

-TREADS ARE TO BE WEAR AND SLIP RESISTANT, SMOOTH, EVEN AND FREE

-TREADS ARE TO BE THEAT AT IN SERIOUS TO THE TREAD TO THE TREAD STATES AND RAMPS SHALL HAVE A COLOUR CONTRAST OR DISTINCTIVE VISUAL PATTERN TO DEMARCATE THE LEADING EDGE OF THE TREADS,

-GUARDS TO BE 3'-6" (1070mm) HIGH -FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH

-INCLUDES WINDOWS OVER STAIRS, RAMPS AND LANDINGS
-PICKETS TO HAVE 4" (100mm) MAX. SPACING
-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

-GUARDS ARE REQUIRED WHEN WALKING SURFACE TO GRADE IS GREATER THAN

23 5/8" (600mm).
-GUARDS TO BE 3'-6" (1070mm)
-FOR DWELLING UNITS GUARDS TO BE A MIN. OF 2'-11" (900mm) HIGH
-FOR DWELLING UNITS GUARDS TO BE 3'-6" (1070mm) HIGH WHERE WALKING
SURFACE IS MORE THAN 5'-11" (1800mm) ABOVE ADJACENT GRADE.
-PICKETS TO HAVE 4" (100mm) MAX. SPACING

-FOR RAILING SPANNING MAXIMUM OF 6'-0". -PROVIDE PREFIN. METAL RAILING W/ 76mm VERTICAL OPENING TO

CONFORM WITH O.B.C. APPENDIX A-9.8.8.5.

-GUARDS TO BE 3'-6" (1070mm)

-FOR DWELLING UNITS GUARDS TO BE 2'-11" (900mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C.

9.8.8.2. OR -FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C., 9.8.8.2. -VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3

PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.

◆ CLIENT SPECIFIC REVISIONS

ROWS OF 3/8"Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3" MIN.

-GUARDS FOR FLIGHTS OF STEPS (EXCEPT EXIT STAIRS) TO BE 2'-11" (900mm) HIGH

(300mm) BEYOND THE TOP & BOTTOM OF EACH STAIR

LANDING AND THE BEGINNING AND END OF A RAMP

(280mm) (280mm)

C.D.C. 7.0.1.0 HANDRAILS AND PROJECTIONS BELOW HANDRAILS INCLUDING STEP STRINGERS TO PROJECT A MAXIMUM OF 4" (100mm) INTO THE REQUIRED WIDTH OF THE STAIR

(210mm) (235mm)

-R31 (RSI 5.46) INSULATION

SUNKEN FINISHED AREAS: -USE SOLID BUILT-UP WOOD BEARING POST TO SUPPORT SUNKEN AREA AT FOUNDATION WALLS, EXTEND FOOTINGS TO SUPPORT POSTS.
- WHERE GRADING CONDITIONS WILL ALLOW, CHECK FOUNDATION WALLS INSTEAD OF USING BEARING POSTS.

FLOOR STRUCTURE AS PER NOTE # 28. DOUBLE MASONRY WYTHE WALL:

O.B.C. 9.20.8.2.

-3 1/2" MASONRY VENEER ON 2" MORTAR JOINT ON 3 1/2" MASONRY VENEER
-WYTHES TO BE TIED W/ METAL TIES INSTALLED AS PER O.B.C. 9.20.9.4.

SILL PLATE REQUIRED FOR ROOF AND CEILING FRAMING MEMBERS -6" SILL W/ 2" BEARING ON EACH SIDE & ANCHOR BOLTS @ 4'-0" O.C NOTE: MASONRY TO BE SOLID & MORTAR JOINT FILLED SOLID FOR FLOOR JOISTS BEARING ON WYTHES. FLOOR JOISTS ARE NOT TO PROJECT INTO CAVITY

250 CORBEL MASONRY VENEER:

MASONRY VENEER TO BE CORBELLED AS PER O.B.C. 9.20.12.3.(1) FLOOR ASSEMBLIES: $\langle 26 \rangle$ SILL PLATE: O.B.C. 9.23.7.

O.B.C. 9.23.7. -2" X 4" (38mm X 89mm) PLATE -1/2" (12.7mm) DIA. ANCHOR BOLIS @ 7'-10" (2400mm) O.C. FASTENED TO PLATE W/ NUTS AND WASHERS & SHALL BE EMBEDDED NOT LESS THAN 4" (100mm) INTO FOUNDATION WALL. -SILL PLATE TO BE CAULKED, OR PLACED ON A LAYER NOT LESS THAN 1" (25mm) THICK BEFORE COMPRESSING. OR FOAM GASKET, OR PLACED

ON FULL BED OF MORTAR

 $\langle 27 \rangle$ bridging & strapping: a) STRAPPING -1" X 3" (19mmX 64mm) NAILED TO U/S OF JOISTS @ MAX. 6-11" (2100mm) O.C. STENED TO SILL OR HEADER @ ENDS

1" X 3" (19mmX 64mm) OR 2" X 2" (38mmX 38mm) CROSS BRIDGING @ MAX. 6'-11" (2100mm) O.C. c) BRIDGING & STRAPPING a) & b) USED TOGETHER OR

1 1/2" (38mm) SOLID BLOCKING @ MAX. 6'-11" (2100mm) O.C. USED WITH STRAPPING (a)
d) FURRING OR PANEL TYPE CEILING
-STRAPPING NOT REQUIRED IF FURRING STRIPS OR PANEL TYPE CEILING FINISH
IS ATTACHED DIRECTLY TO JOISTS.

28 FLOOR ASSEMBLY: O.B.C. 9.23.14.3, 9.23.14.4

-5/8" (15.9mm) WAFERBOARD (R-1 GRADE) OR EQUIVALENT -FLOOR JOISTS AS PER FLOOR PLANS

29 PORCH SLAB: -4 7/8" (125mm) 4650 psi (32 MPa) CONC. SLAB WITH 5 TO 8% AIR ENTRAINMENT

-4 //8" (125mm) 4650 psi (32 MPG) CONC. SLAB WITH 5 10 8% AIR ENIRAINM!
-REINFORCE WITH 10M BARS @ 7 776" (200mm) EACH WAY
-1 1/4" (30mm) CLEAR COVER FROM THE BOTTOM OF THE SLAB
-3" (75mm) END BEARING ON FOUNDATION WALL
-23 5/8" (600mm) X 23 5/8" (600mm) 10M DOWELS @ 23 5/8" (600mm) 0.C.
-IF A COLD CELLAR IS LOCATED BELOW THE SLAB, SUPPORT ON FOUNDATION

WALLS NOT TO EXCEED 8'-2" 30) EXTERIOR BALCONY ASSEMBLY: 1 1/4" X 3 1/2" PRESSURE TREATED DECKING W/ 1/4" SPACING -2"X4" WOOD PURLINS (CUT DIAGONALLY) @ 12" O.C. LAYING UNFASTENED ON SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8" ON SINGLE PLY WALERPROOF ROOF MEMBRANE OR EQUIVALENT ON 5/8" (15,9mm) EXTERIOR GRADE PLYWOOD SHEATHING ON 2"X8" WOOD PURLUS (CUT DIAGONALLY) @ 12" O.C. DIRECTLY ON 2"X8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN) - EXTERIOR GUARD AS PER #36a - SLOPE ASSEMBLY MINIMUM 2% TO ROOF SCUPPER

REQUIRED FOR OVER HEATED SPACES: -ADD 2"x2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR VENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS

CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. -ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR

-ADD 5/8" (15.5mm) GYPSUM BOARD W/ TEXTURED CEILING OR EXTERIOR FLAT ROOF ASSEMBLY: -SINGLE PLY WATERPROOF ROOF MEMBRANE OR EQUIVALENT INSTALLED PER MANUFACTURER'S SPECIFICATIONS. -1/4" EXTERIOR GRADE WOOD PANEL TYPE UNDERLAY TAPERED PURLINS SLOPED MIN. 2% TO ROOF SCUPPER. -3/8" EXTERIOR GRADE PLYWOOD SHEATHING ON -2"X8" ROOF JOISTS @ 12" O.C. (OR AS NOTED ON PLAN)

REQUIRED FOR OVER HEATED SPACES: ADD 2"X2" (38mm x 38mm) CROSS PURLINS @ 16" (400mm) O.C. FOR TENTILATION OVER JOISTS (OBC 9.19.1.2. VENTING NOT LESS THAN 1/150 OF VENITIATION OVER JOISTS (OBC 9.19.11.2. VENITING NOT LESS THAN 17150 OF CEILING AREA)

-ADD R31 (RSI 5.46) INSULATION BETWEEN JOISTS

-ADD CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.

ADD 1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR -ADD 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.)

ROOF ASSEMBLIES 31 TYPICAL ROOF:

-NO. 210 (30. 5KG/m2) ASPHALT SHINGLES -FOR ROOFS BETWEEN 4:12 & 8:12 PITCH PROVIDE EAVES PROTECTION TO -FOR ROOFS BEIMEEN 4:12 & 8:12 PILCH PROVIDE EAXES PROJECTION TO EXTEND UP THE ROOF SLOPE MIN. 2:11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAID BENEATH STARTER STRIP.
-EAVE PROTECTION LOT REQUIRED OVER UNHEATED SPACES.
-STARTER STRIP AS PER O.B.C. 9:26.7.2. -STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3) 3/8" (10mm) PLYWOOD SHEATHING OR OSB (0-2 GRADE) WITH "H" CLIPS PPROVED WOOD TRUSSES @ 24" (600mm) O.C. (REFER TO MANUFACTURER'S

RIOSUT) RIUSS BRACING AS PER TRUSS MANUFACTURER EAVESTROUGH ON PREFINISHED FASCIA AND VENTED SOFFIT (VINYL OR -ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH, 50% AT SOFFIT. (32) CEILING:

-R60 (RSI 10.56) INSULATION ITINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3.

1/2" (12.7mm) GYPSUM BOARD W/ PAINTED CEILING OR 5/8" (15.9mm) GYPSUM BOARD W/ TEXTURED CEILING (O.B.C. T.9.29.5.3.) 320 VAULTED OR CATHEDRAL CEILING: O.B.C. 9.26. & TABLE A4 -NO. 210 (30. 5KG/m2) ASPHALT SHINGLES

-RO. 20 (30. 30.97)112/ S3T HALT SHINGUE FAVES PROTECTION TO EXTEND UP THE ROOF SLOPE MIN. 2-11" (900mm) FROM EDGE TO A LINE NOT LESS THAN 12" (300mm) PAST THE INSIDE FACE OF EXTERIOR WALL.
-EAVES PROTECTION LAID BENEATH STARTER STRIP. -EAVE PROTECTION NOT REQUIRED OVER UNHEATED SPACES OR WHERE ROOF SLOPES ARE 8:12 OR GREATER PER O.B.C. 9.26.5.1. -STARTER STRIP AS PER O.B.C. 9.26.7.2. -STARTER STRIP NOT REQUIRED AS PER O.B.C. 9.26.7.2.(3) -31A/IER SIRIF NOT REQUIRED AS FER C. B.C. Y. Z6.7.Z.(3)
-3/B" (10mm) PLYWOOD SHEATHING OR OSB (0.2 GRADE) WITH "H" CLIPS.
-2'x8" (38mm x 184mm) @ 16" O.C. W/ 2'x2" (38mm x 38mm) CROSS
PURLINS @ 24" O.C. MAX. SPAN 13-3" (4050mm) OR
-2'x10" (38mm x 235mm) @ 16" O.C. W/ 2'x2" (38mm x 38mm) CROSS
PURLINS @ 24" O.C. MAX. SPAN 17-0" (5180mm) -R31 (RSI 5.46) INSULATION

MIN. 3" CLEARANCE FROM U/S OF ROOF SHEATHING TO INSULATION CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE WITH O.B.C. 9.25.3. & 9.25.4.

'DO'

U/S

BG

LINTELS

4-7/8" X 3-1/2" X 1/4" L L13 5-7/8" X 3-1/2" X 3/8" L

LEGEND

SMOKE ALARM 44

ALARM (CMA)

_____ VENTS AND INTAKES

COLD CELLAR VENT (50)

WATERPROOF DUPLEX OUTLET

₩ HOSE BIB

(38) EXHAUST FAN

STOVE VENT

DRYER VENT

SOLID BEARING

1 2/2" X 8" SPR

3 2/2" X 10" SPR

2/ 2" X 12" SPR

FIRE PLACE VENT

FLOOR DRAIN

CARBON MONOXIDE 45

-WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE. ONTARIO REGULATION 332/12 OBC. AMMENDMENT O. REG. 139/17 JAN 1, 2018 A 865x2030x45 (2'10"x6'8"x1-3/4" 8 815x2030x35 (2'8"x6'8"x1-3/8" FLAT ARCH 760x2030x35 (2'6"x6'8"x1-3/8" 710x2030x35 (2'4"x6'8"x1-3/8 460x2030x35 (1'6"x6'8"x1-3/8") EXT. LIGHT FIXTURE OVER SIZED EXTERIOR DOO (WALL MOUNTED) STEEL BEAMS HYDRO METER

ST1 W 6 X 15 **(G)** GAS METER ST2 W 6 X 20 ST3 W 8 X 18 DJ DOUBLE JOIST ST4 W 8 X 21 PT PRESSURE TREATED ST5 W 8 X 24 LUMBER WOOD BEAMS GT GIRDER TRUSS 3/ 2" X 8" SPR AFF ABOVE FINISHED FLOOR **BBFM** BEAM BY FLOOR MANUF DROPPED REPEAT SAME JOIST SIZE UNDER SIDE

VD2 4/ 2" X 8" SPR VD3 5/ 2" X 8" SPR 'D4 3/2" X 10" SPR D5 4/ 2" X 10" SPR WD6 5/ 2" X 10" SPR D7 3/ 2" X 12" SPR FIXED GLAZING VD8 4/ 2" X 12" SPR GLASS BLOCK 'D9 5/ 2" X 12" SPR D10 2/ 1 3/4" X7 1/4" (2.0F) I V BLACK GLASS /D12A 1/ 1 3/4" X9 1/2" (2.0F) IV VD13 3/ 1 3/4" X9 1/2" (2.0E) LV L9 4" X 3-1/2" X 1/4" L L14 5-7/8" X 3-1/2" X 1/2" I L10 4-7/8" X 3-1/2" X 5/16" L L15 5-7/8" X 4" X 1/2" L WD14 2/ 1 3/4" X11 7/8" (2.0E) LV L11 4-7/8" X 3-1/2" X 3/8" L L16 7-1/8" X 4" X 3/8" L 7 3-1/2" X 3-1/2" X 1/4" L L12 5 7/8" X 3-1/2" X 5/16" L L17 7-1/8" X 4" X 1/2" L WD16A 1/13/4" X14" (2.0E) LVL

WD17 3/ 1 3/4" X14" (2.0F) LVI

-PRECAST CONC. STEP
-2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND 44) SMOKE ALARM, O.B.C.- 9.10.19.

-PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
-PROVIDE 1 IN EACH BEDROOM
-PROVIDE 1 IN EACH HALLWAY SERVICING BEDROOMS
- INSTALLED AT OR NEAR CEILING
-ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL
ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS AND HAVE A VISUAL SIGNALLING COMPONENT -ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE

THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM CARBON MONOXIDE ALARM (CMA), O.B.C.- 9.33.4. CARBOIN MODIFICATION (CIMA), OSC. 7.33.4.

"HHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.

"CMA TO BE WIRED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN

46) -MAIN DOOR TO BE OPERABLE FROM INSIDE W/OUT KEY -PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDELIGHT IS PRESENT. -R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED

-GARAGE MAN DOORS TO BE GAS PROOFED WITH SELF CLOSER WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15

-R4 (RS10.70)

-R4 (RS10.70)

-R5 (RS10.70)

-R6 (R 2) WHERE THAT ELOOP LEVEL HAS A WINDOW PROVIDING AN

2) WHILE ITHIS A WILLOW TRAVILING AN UNDESTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH; SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23-0" (7.0m) ABOVE ADJACENT GROUND LEVEL. 49 EXTERIOR COLUMN W/ MASONRY PIER:

-MIN. 6"X6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.

-TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION

MASONRY VENEER SURROUND W/ PRECAST CONCRETE CAP. REFER TO ELEVATION DRAWINGS FOR PIER SIZE AND CAP HEIGHT SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4. -3/4" AIR SPACE AROUND POST.

VIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
-MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP. REFER TO ELEVATION DRAWINGS FOR PIER SIZE AND CAP HEIGHT NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17

-MIN. 6"X6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W METAL SADDLE

NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE
PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4. SO COLD CELLARS:

FOR COLD CELLARS PROVIDE THE FOLLOWING:
-VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA. -COVER VENT W/ BUG SCREEN WALL MOUNTED LIGHT FIXTURE -WALL MOUNTLE LIGHT HANDE L1+L7 FOR DOOR OPENING -2'-8" X 6'-8" EXTERIOR TYPE DOOR (MIN.R-4 RSI 0.7) INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)

51 STUD WALL REINFORCEMENT:

O.B.C. 9, 5.2.3.

-WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(3)(c)&(c) & 3.8.3.13.(2)(f) & 3.8.3.13.(4)(c)
-GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.8.7.7.(2)

52 ELECTRICAL VEHICLE CHARGING REQUIREMENTS: - REFER TO OBC 9.34.4.1. FOR REQUIRMENTS (FEFECTIVE JANUARY 2018)

53 WINDOW GUARDS:

@ STAIRS, <u>LANDINGS & RAMPS</u> - OBC 9.8.8.1.(8) WINDOW SILL AT 3'-0" (900mm) OR GREATER DOES NOT REQUIRE GUARDS @ FLOORS - OBC 9.8.8.1.(6) WINDOWS LESS THAN 1'-7" (480mm) ABOVE FLOORS WHERE ADJACENT GRADE IS GREATER THAN 5'-11" (1800mm) REQUIRE A GUARD PER OBC 9.8.8.2.

WINDOW TO BE NON-OPERABLE AND DESIGNED TO WITHSTAND LATERAL LOADS PER OBC 9.8.8.1.(8)(b)

FRAME CONSTRUCTION: -ALL FRAMING LUMBER TO BE No.1 AND No. 2 SPF UNLESS NOTED

-ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN LOADS. -JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING -BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING -DOUBLE STUDS @ OPENINGS -DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE

BETWEEN 3-11" (1200mm) AND 10-6" (3200mm)
-DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 6'-7" (2000mm) DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS -BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE

PARALLEL TO FLOOR JOISTS -BEAMS MAY BE A MAX. 24" (600mm) FROM LOADBEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS
-APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 1.5.3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (38mm X -FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED

MORE THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X $\,$ 235mm) OR LARGER. WATERPROOF WALLS IN BATHROOMS:

-REQUIRED AS PER OBC 9.29.2.1.

WINDOWS: -WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER -WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF

1.6 W/(m2.K) OR -AN ENERGY RATING OF NOT LESS THAN 25 FOR WINDOWS -BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL -BASEMENI WINDOWS WITH LOAD BEARING STRUCTURAL PRAINE SHALL BE DOUBLE GLAZED WITH LOW-E COATING -SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF

FOR GROSS GLAZED AREAS LESS THAN AND EQUAL TO 17% **DRAIN WATER HEAT RECOVERY:**

BELOW THE SHOWERS.

- DWHR UNITS TO BE INSTALLED AS PER OBC SB-12 3.1.1.1.(22) & 3.1.1.12. - DWHR ARE REQUIRED IN ALL DWELLING UNITS TO RECEIVE DRAIN WATER FROM ALL SHOWERS OR FROM AT LEAST 2 SHOWERS WHERE THERE ARE 2 OR MORE SHOWERS PROVIDED THERE IS A CRAWL SPACE OR STOREY

ELEVATION 'B'

Areas: ELEVATION 'A'

	SF	SM	SF	SM
GROUND FLOOR	853.8	79.3	853.8	79.3
SECOND FLOOR	1036.5	96.3	1046.4	97.2
TOTAL AREA	1890.3	175.6	1900.2	176.5
COVERAGE INC PORCH	1145.05	106.4	1145.05	106.4
COVERAGE NOT INC PORCH	1069.5	99.4	1069.5	99.4

	ELEVATION 'C'		ELEVAT	ION 'D'
	SF	SM	SF	SM
GROUND FLOOR	853.8	79.3	863.5	80.2
SECOND FLOOR	1036.5	96.3	1056.2	98.1
TOTAL AREA	1890.3	175.6	1919.7	178.3
COVERAGE INC PORCH	1113.5	103.4	1116	103.7
COVERAGE NOT INC PORCH	1069.5	99.4	1079.3	100.3



WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA

DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DES PRELIMINARY-NOT FOR CONSTRUCTION ES FIRM IS

AO TITLE SHEET A1 BASEMENT FLOOR ELEV 'A' PARTIAL BASEMENT FLOOR ELEV 'B'

A2 GROUND FLOOR ELEV 'A' PARTIAL GROUND FLOOR ELEV 'B' 1a-1 SELF SUPPORTING STAIR LANDING SECOND FLOOR ELEV 'A'

PARTIAL SECOND FLOOR ELEV 'B' PARTIAL SECOND FLOOR ELEV 'D' PARTIAL SECOND FLOOR ELEV 'C' PARTIAL GROUND FLOOR ELEV 'D' PARTIAL GROUND FLOOR ELEV 'C' PARTIAL BASEMENT FLOOR ELEV 'D'

PARTIAL BASEMENT FLOOR ELEV 'C' FRONT ELEVATION 'A' FRONT ELEVATION 'B'

A6 RIGHT SIDE ELEVATION 'B' LEFT SIDE ELEVATION 'A' A7 REAR ELEVATION 'B' & 'D' REAR ELEVATION 'A' & 'C' TYPICAL CROSS SECTION - SEMI (BRICK)

A8 FRONT ELEVATION 'C' FRONT ELEVATION 'D' A9 RIGHT SIDE ELEVATION 'D'

LEFT SIDE ELEVATION 'C'


date dwn chk ISSUED FOR CLIENT REVIEW 20-SEPT-19 KH JM

Gold Park Homes

ENCORE 2 Brampton

> SD-09 THE GERSHWIN

19037 3/16" = 1'-0"

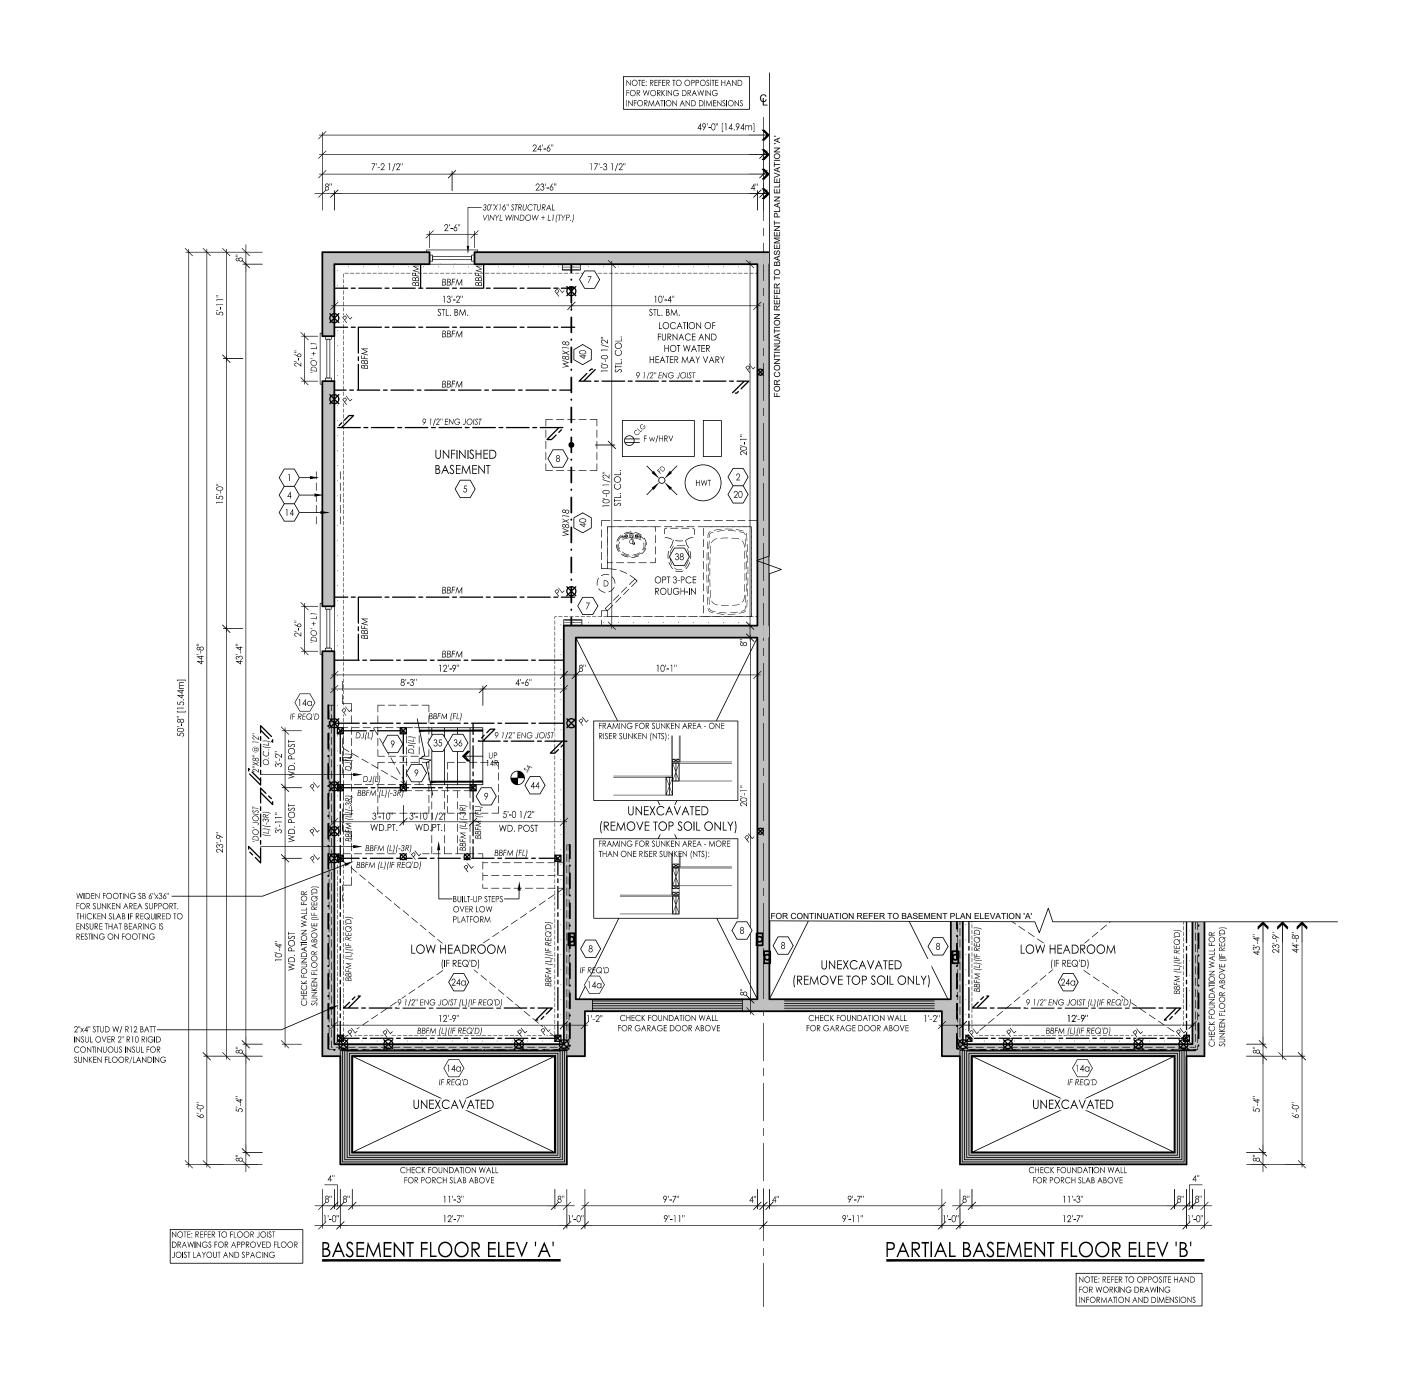




I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN ON BEHALF OF RN DESIGN ITD, UNDER DESIGN OF THE BUILDING REGISTS PRELIMINARY OF THE BUILDING OF

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM
client				

Gold Park Homes

project	ENCORE 2 Brampton
model	
	SD-09
	THE GERSHWIN
project #	19037
scale	3/16" = 1'-0"
page	



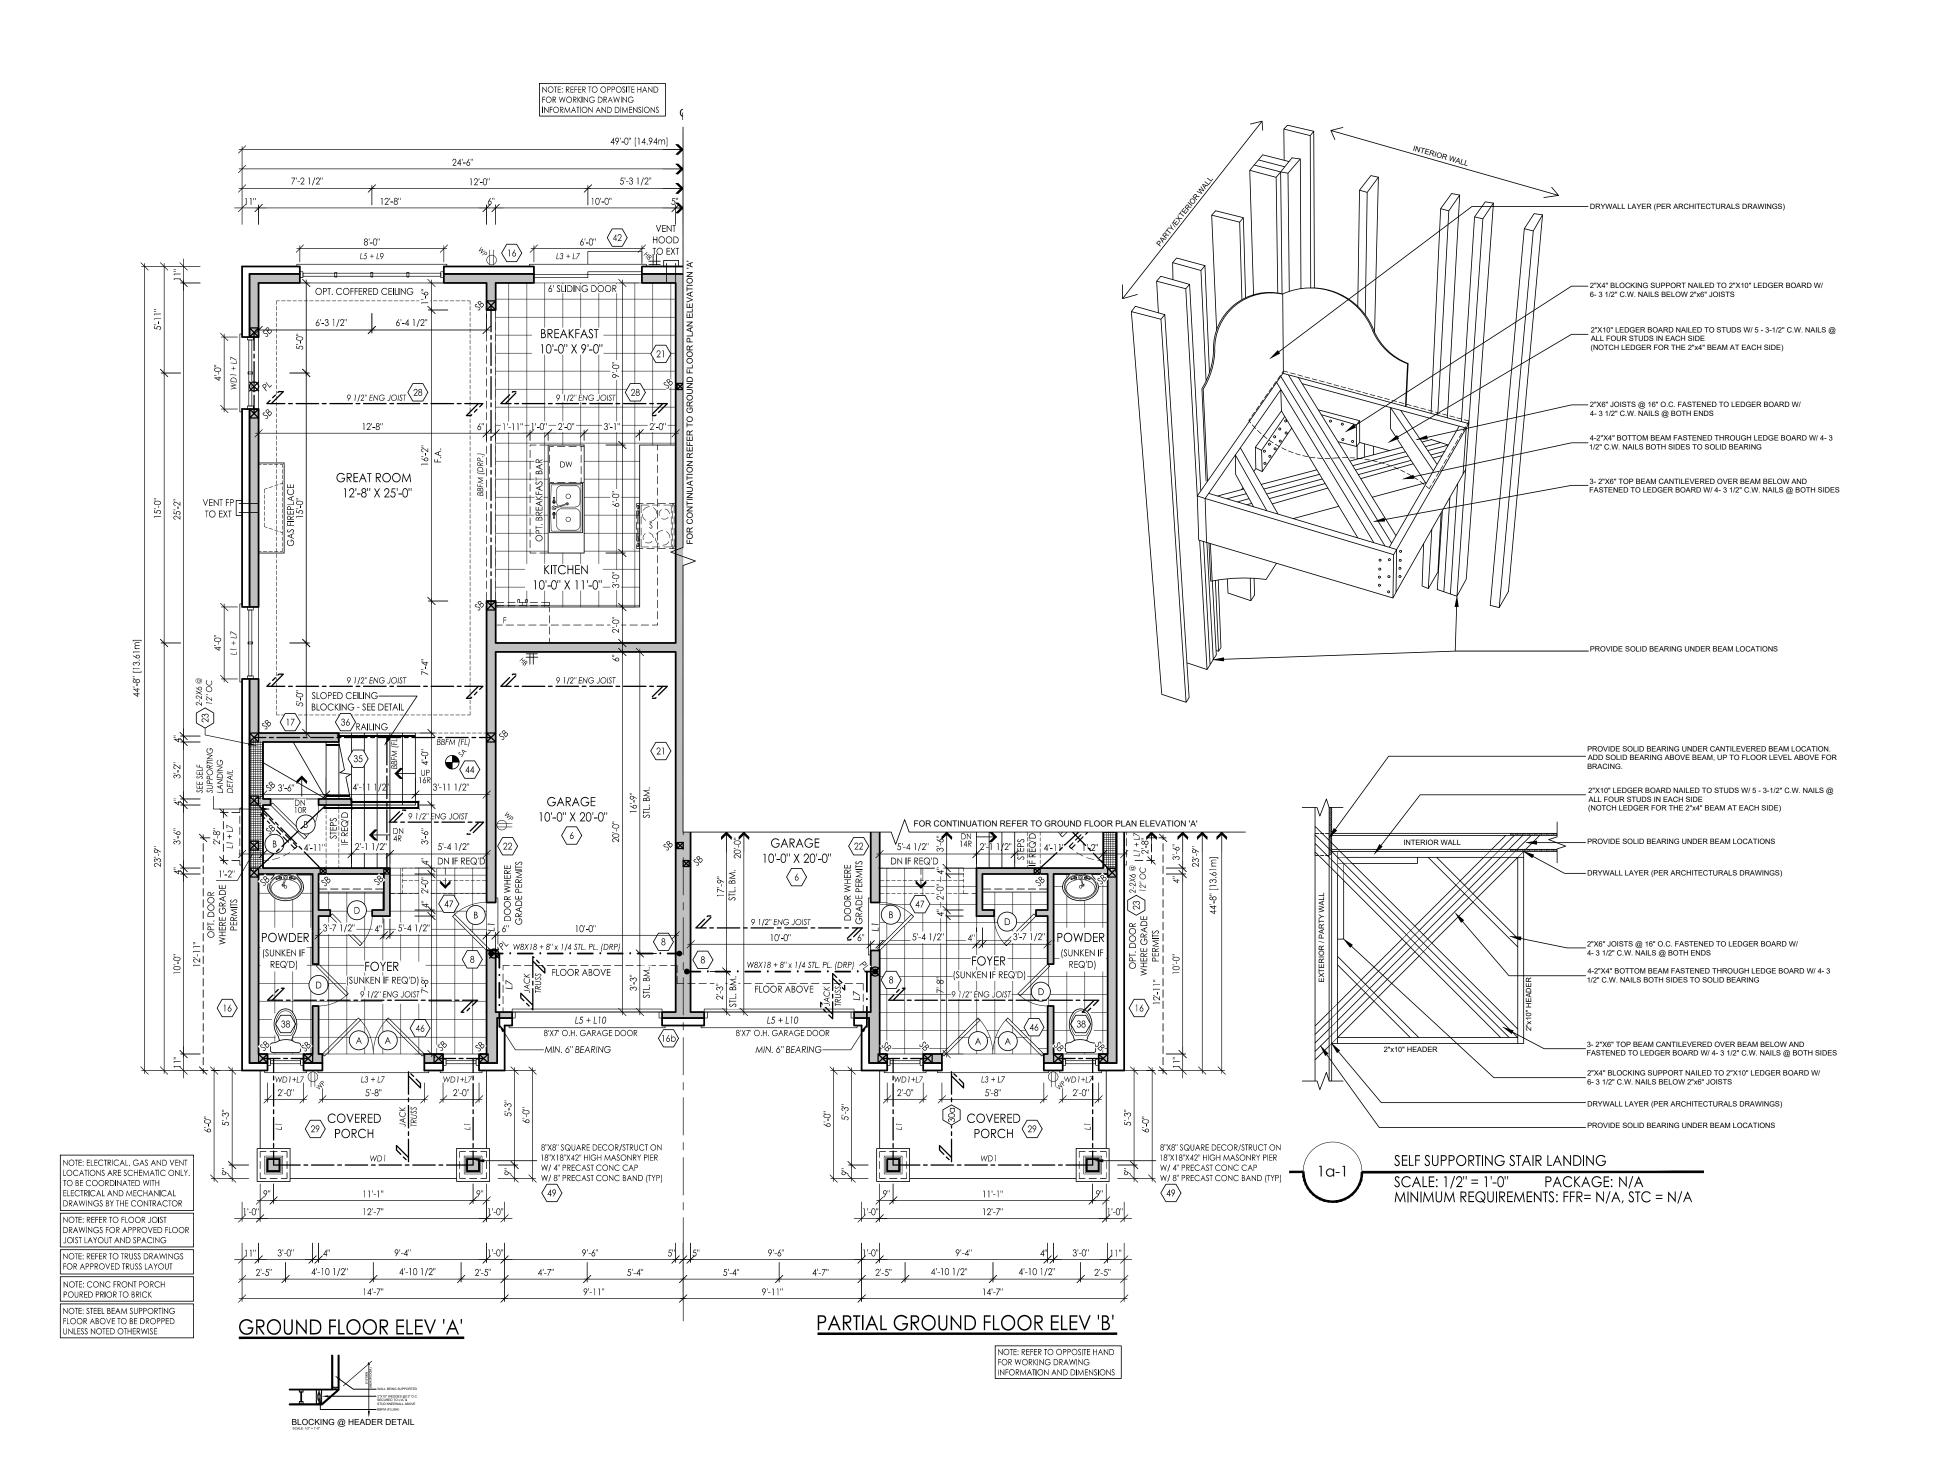



I, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN TO SEE THAT I HAVE REVIEWED AND TAKEN OF RN DESIGN LTD. UNDER DIVIDING THE DIVIDING THE BUILDING THE BUILDING THE BUILDING THE BUILDING THE BUILDING THE FIRM IS REGISTER CONSTRUCTION LIES.


PRELIMINARY DATEOUT

DATEOUT

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM
	L			
client				

Gold Park Homes

project	ENCORE 2
	Brampton
model	SD-09
	THE GERSHWIN
project #	19037
scale	3/16" = 1'-0"
page	

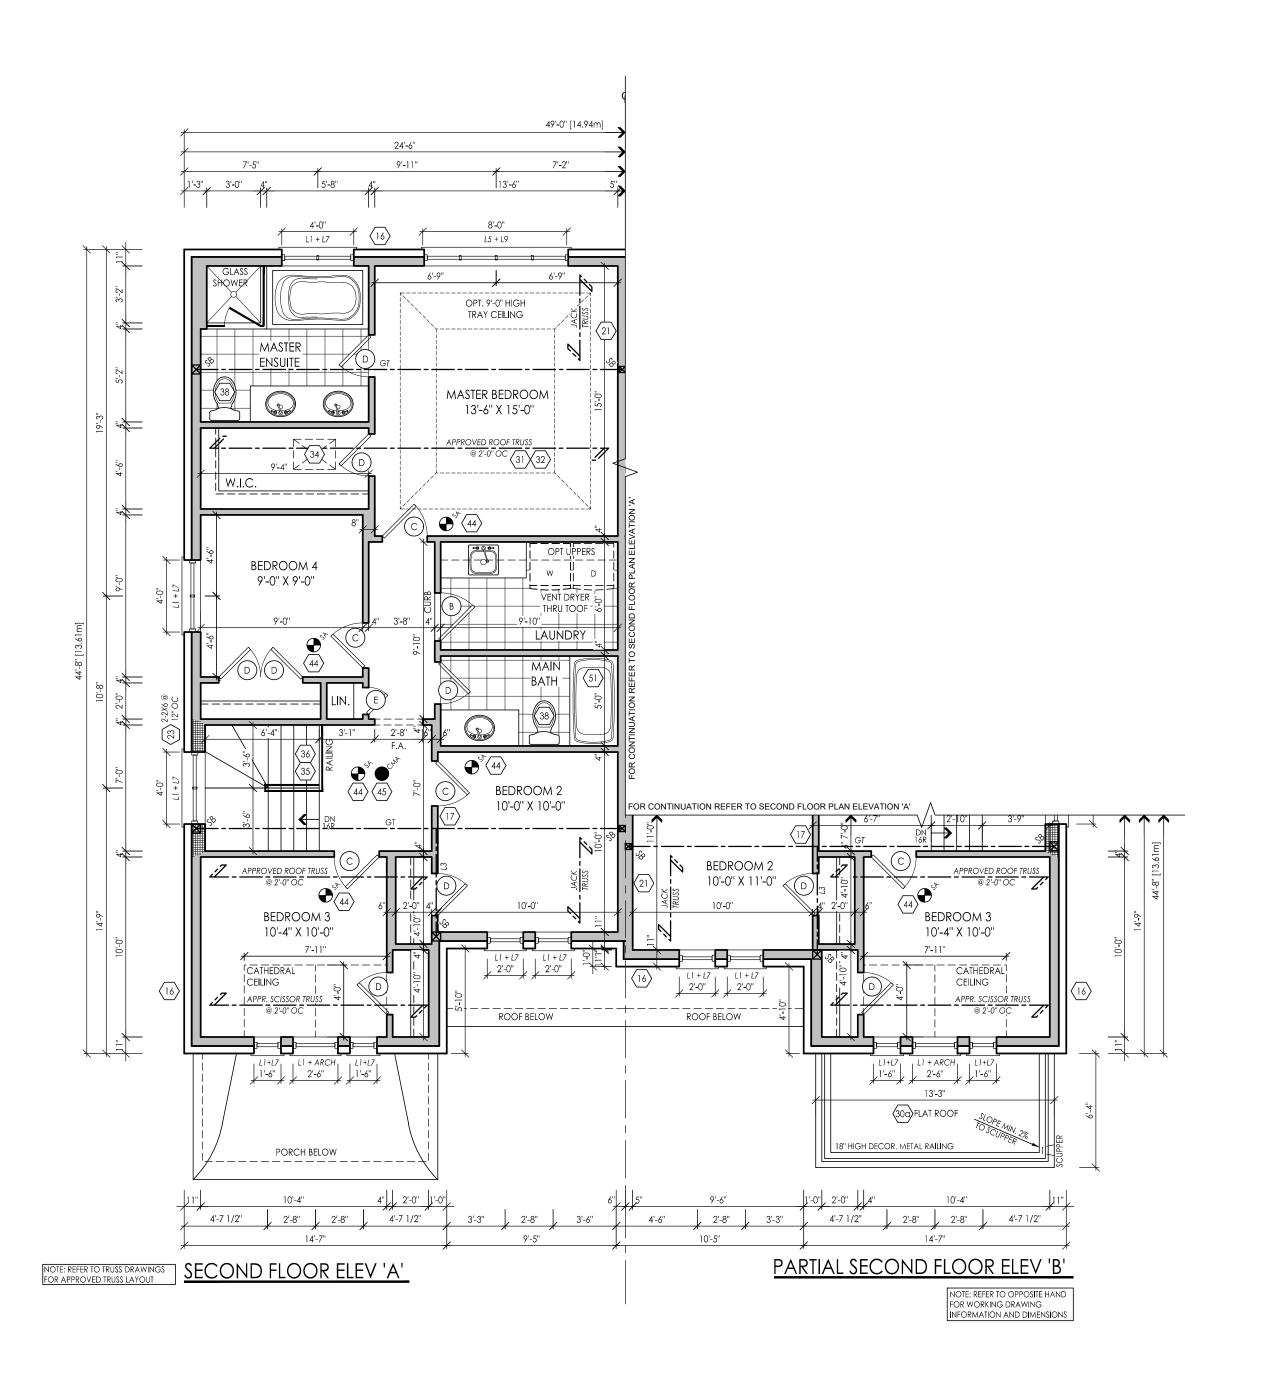







#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM
oliont				

Gold Park Homes

project	ENCORE 2
	Brampton
model	25.00
	SD-09
	THE GERSHWIN
project #	19037
scale	3/16" = 1'-0"

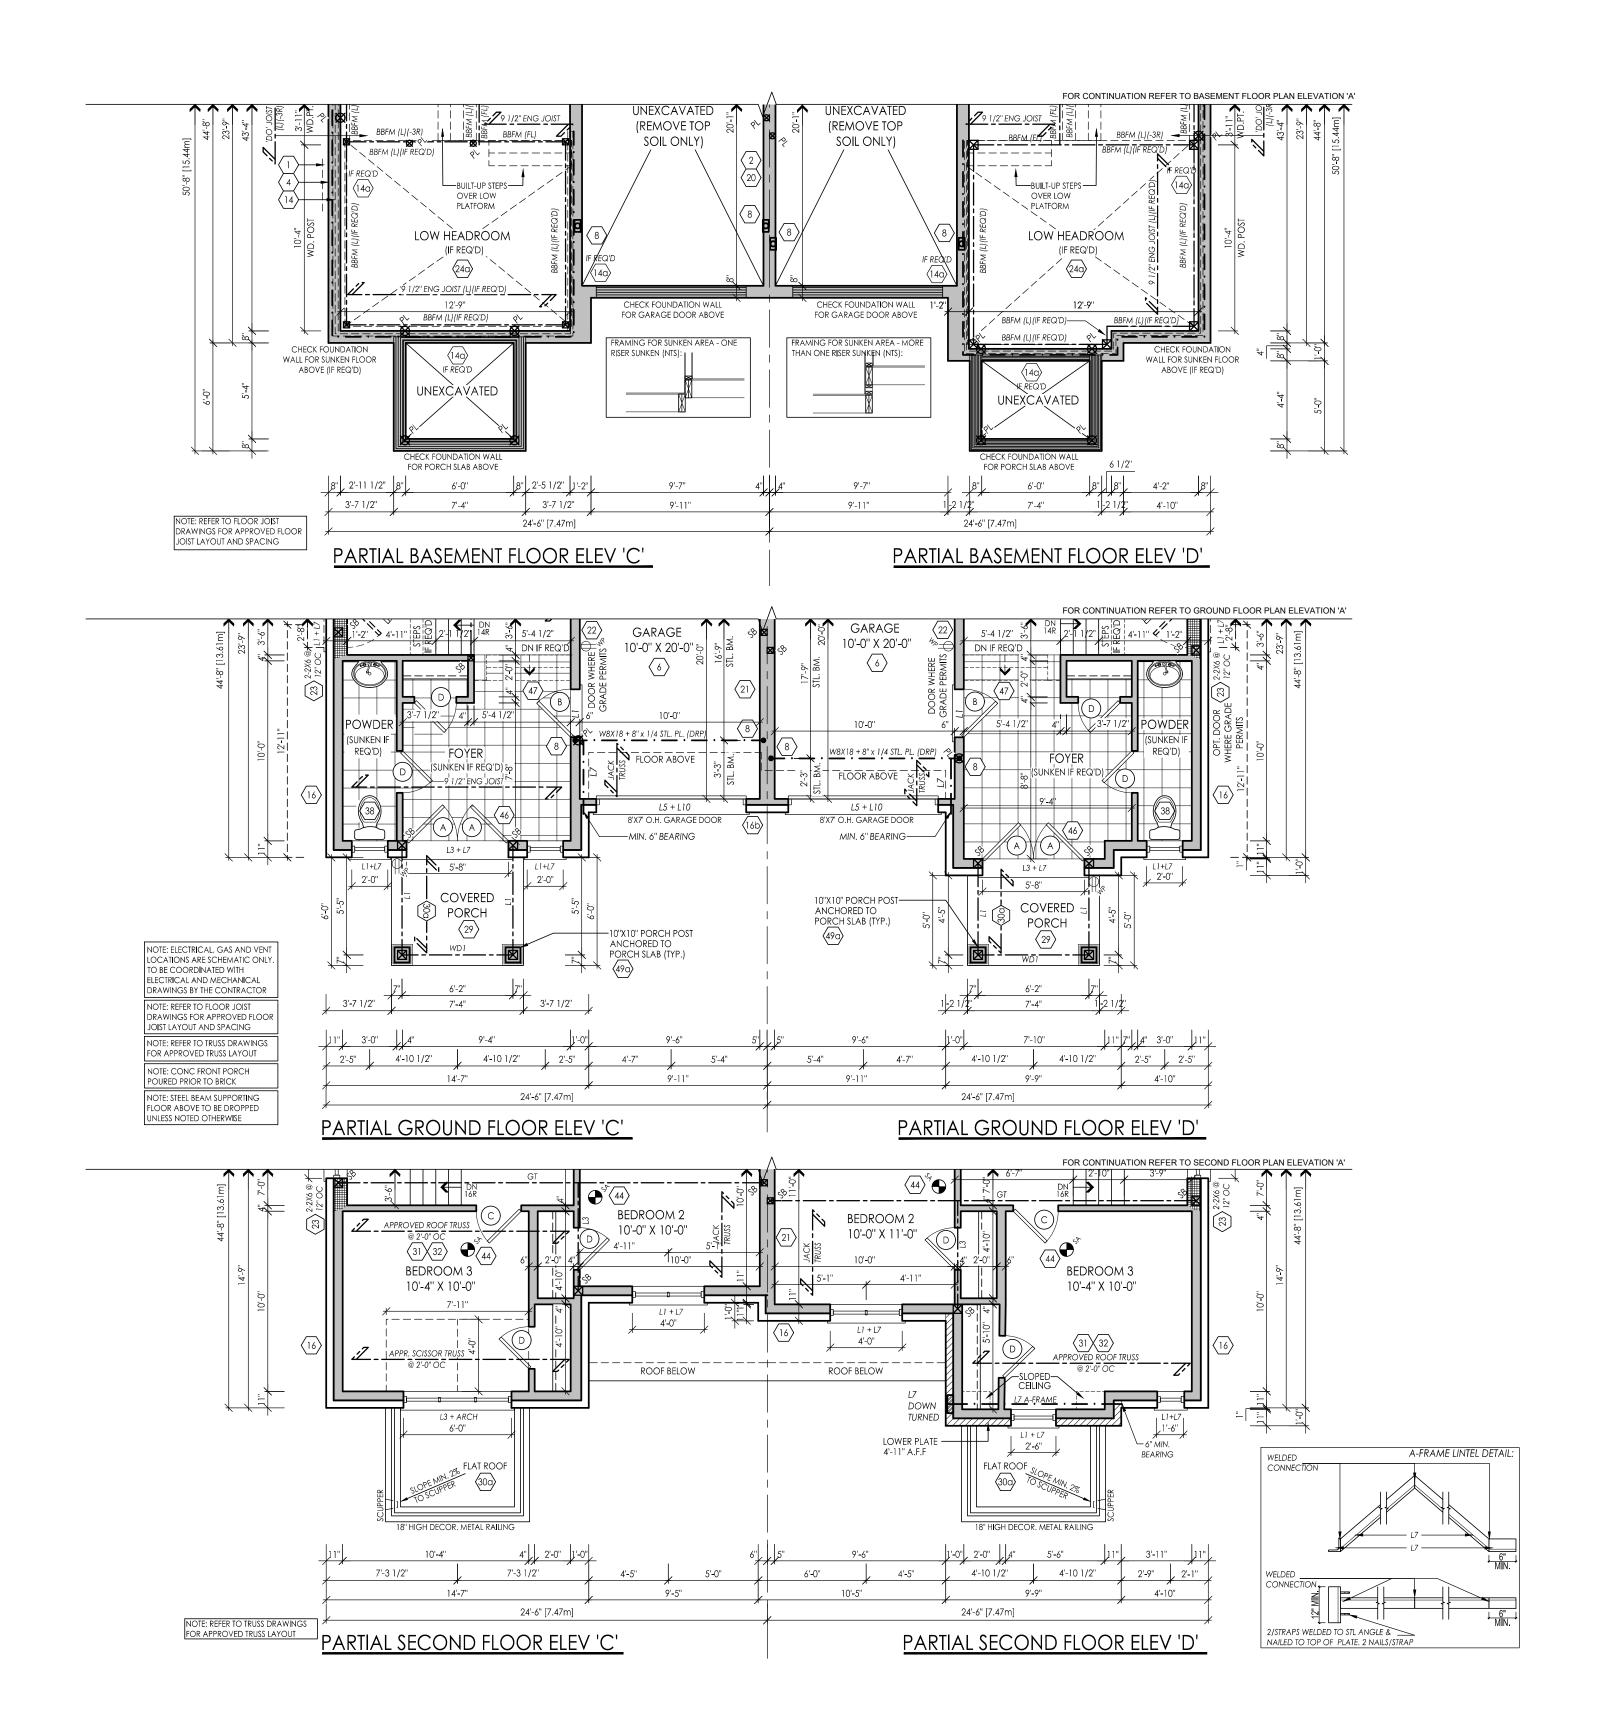






#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM
client				

Gold Park Homes

project	ENCORE 2	
	Brampton	
model	SD-09	
	THE GERSHWIN	
project #	19037	
scale	3/16" = 1'-0"	



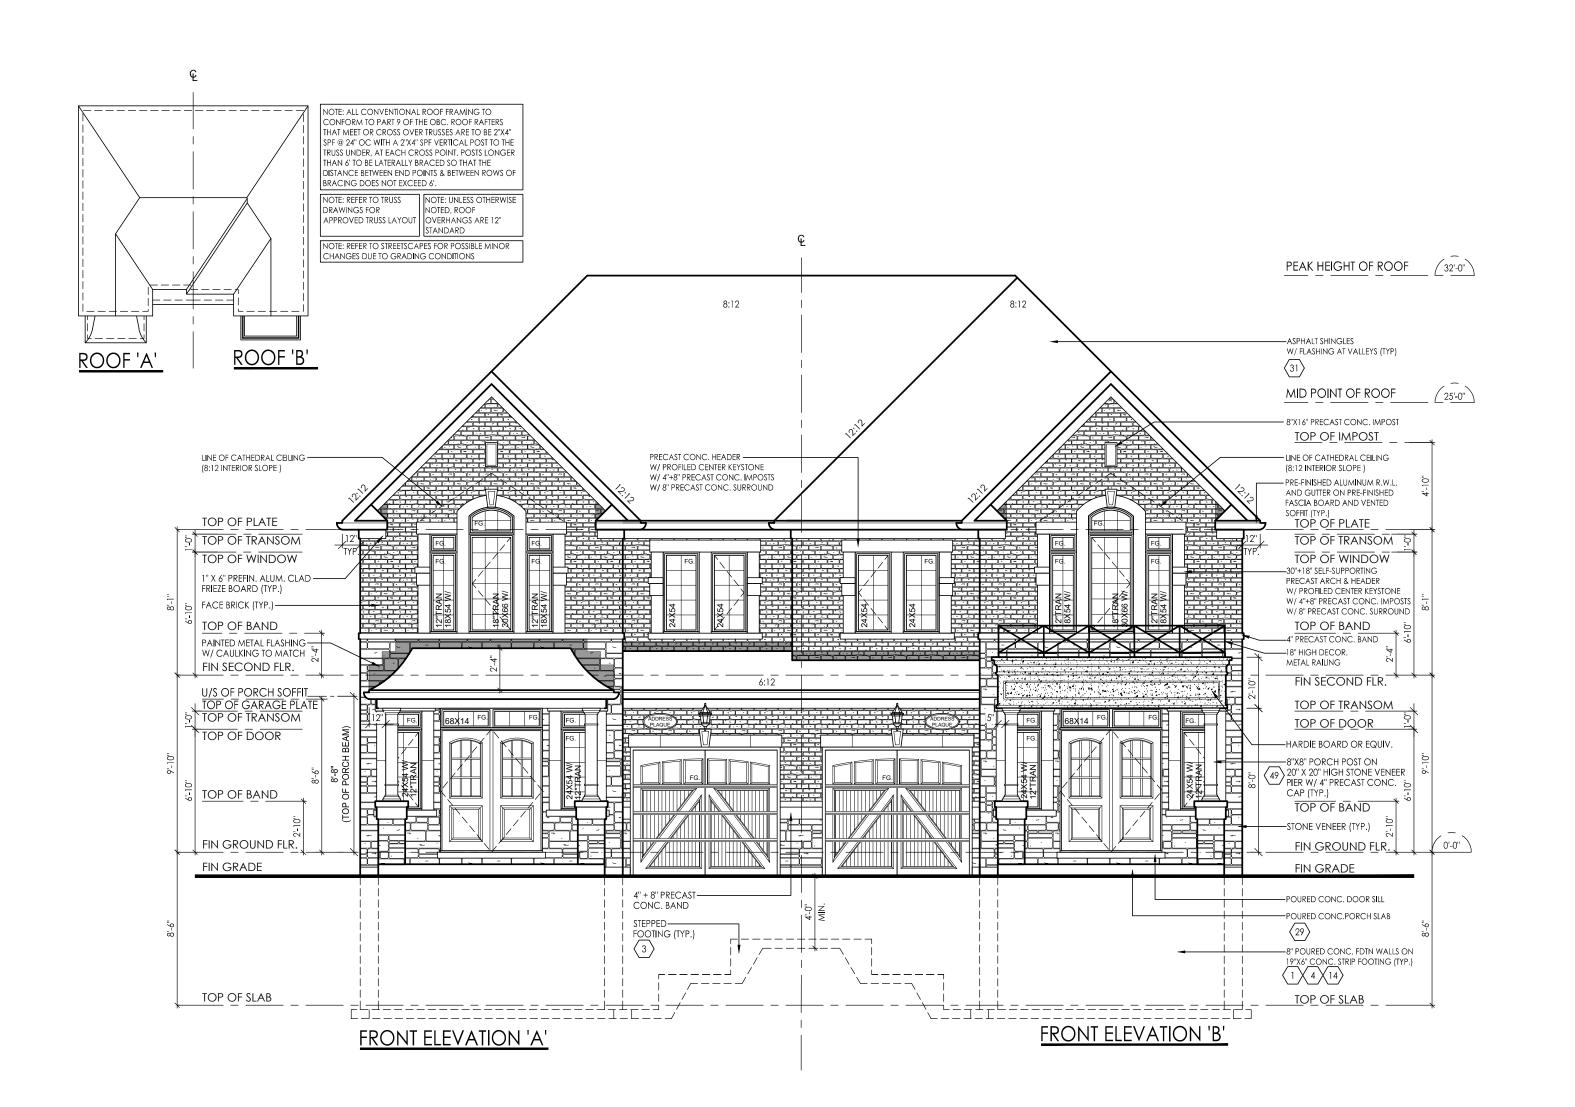



I, DECLARE THAT I HAVE R DESIGN RESPONSIBILITY FOR THE DESIGN OF THE BUILDING REGISTE REGISTE REGISTE RESISTER R	EVIEWED AND TAKEN DN BEHALF OT STION-3.2.4 E FIRM IS LON IES.
FOR CONST	DATEOUT
SIGNATURE:	

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM
client				

Gold Park Homes

project	ENCORE 2	
	Brampton	
model	SD-09	
	THE GERSHWIN	
project #	19037	
scale	3/16" = 1'-0"	
page		



RIGHT SIDE ELEVATION 'B'



LEFT SIDE ELEVATION 'A'




WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA

DECLARE THAT I HAVE DESIGN RESPONSIBILITY FOR THE DESIGN OF RN DESIGN LTD, UNDER DESIGN OF THE BUILDING REGISTE PRELIMINARY—N ON STRUCT	REVIEWED AND TAKEN N BEHALF TION-3.2.4 E FIRM IS TION JES.
FOR CONST.	DATEOUT
SIGNATURE:	

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM

Gold Park Homes

	ENCORE 2	
	Brampton	
model	00.00	
	SD-09	
	THE GERSHWIN	
project #	19037	
scale	3/16" = 1'-0"	

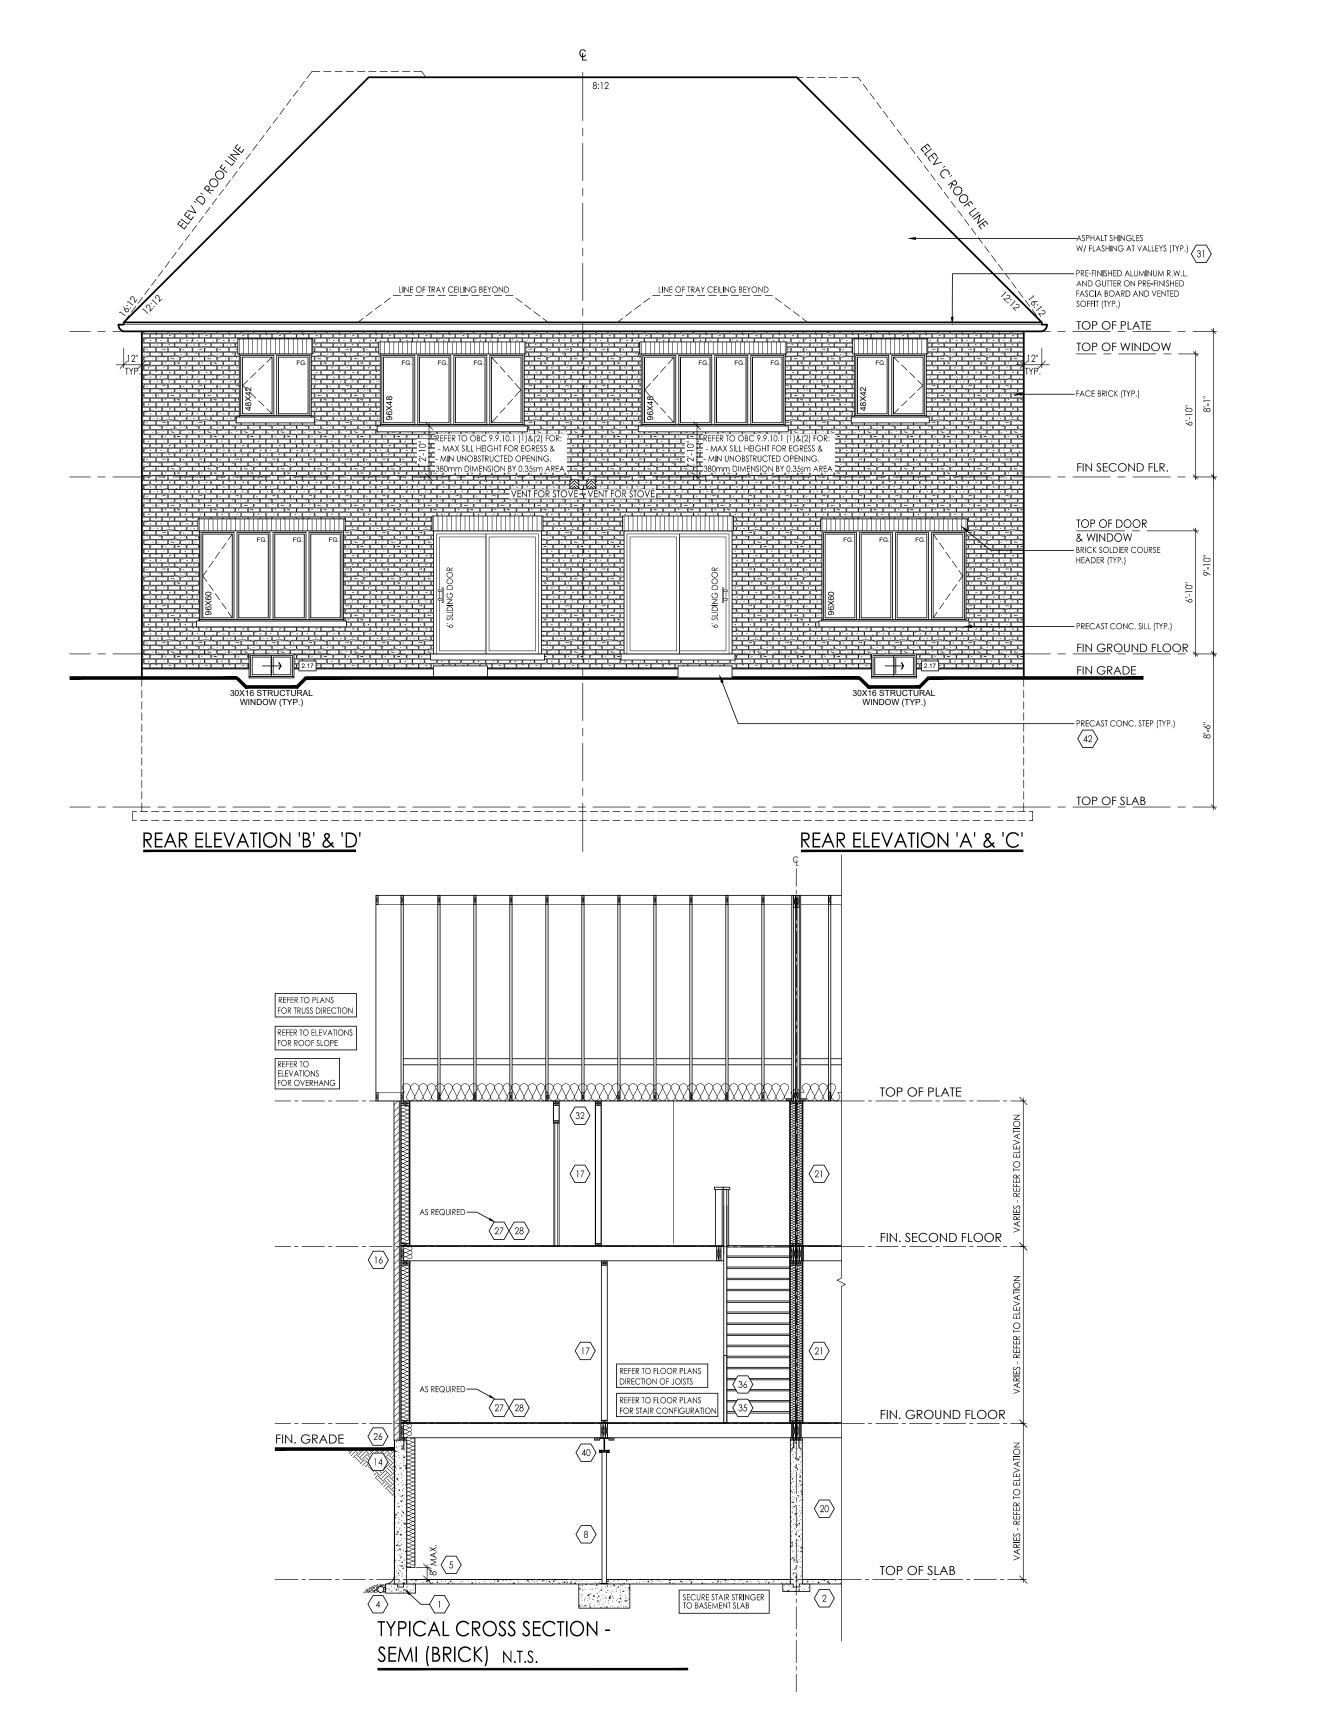




DESIGN RESPONSIBILITY FOR THE DESIGN OF RN DESIGN LTD, UNDER DESIGN OF THE BUILDING REGISTER CONSTRUCTION OF THE BUILDING REGIST REGISTER CONSTRUCTION OF THE BUILDING REGIST REGIST REG	VIEWED AND TAKEN NN BEHALF STION-3.2.4 E FIRM IS NIES. DATEOUT
SIGNATURE:	


#	revisions	date	dwn	chk
J	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM
		•	•	
client				

Gold Park Homes

	ENCORE 2	
	Brampton	
model	00 02	
	SD-09	
	THE GERSHWIN	
project #	19037	
scale	3/16" = 1'-0"	

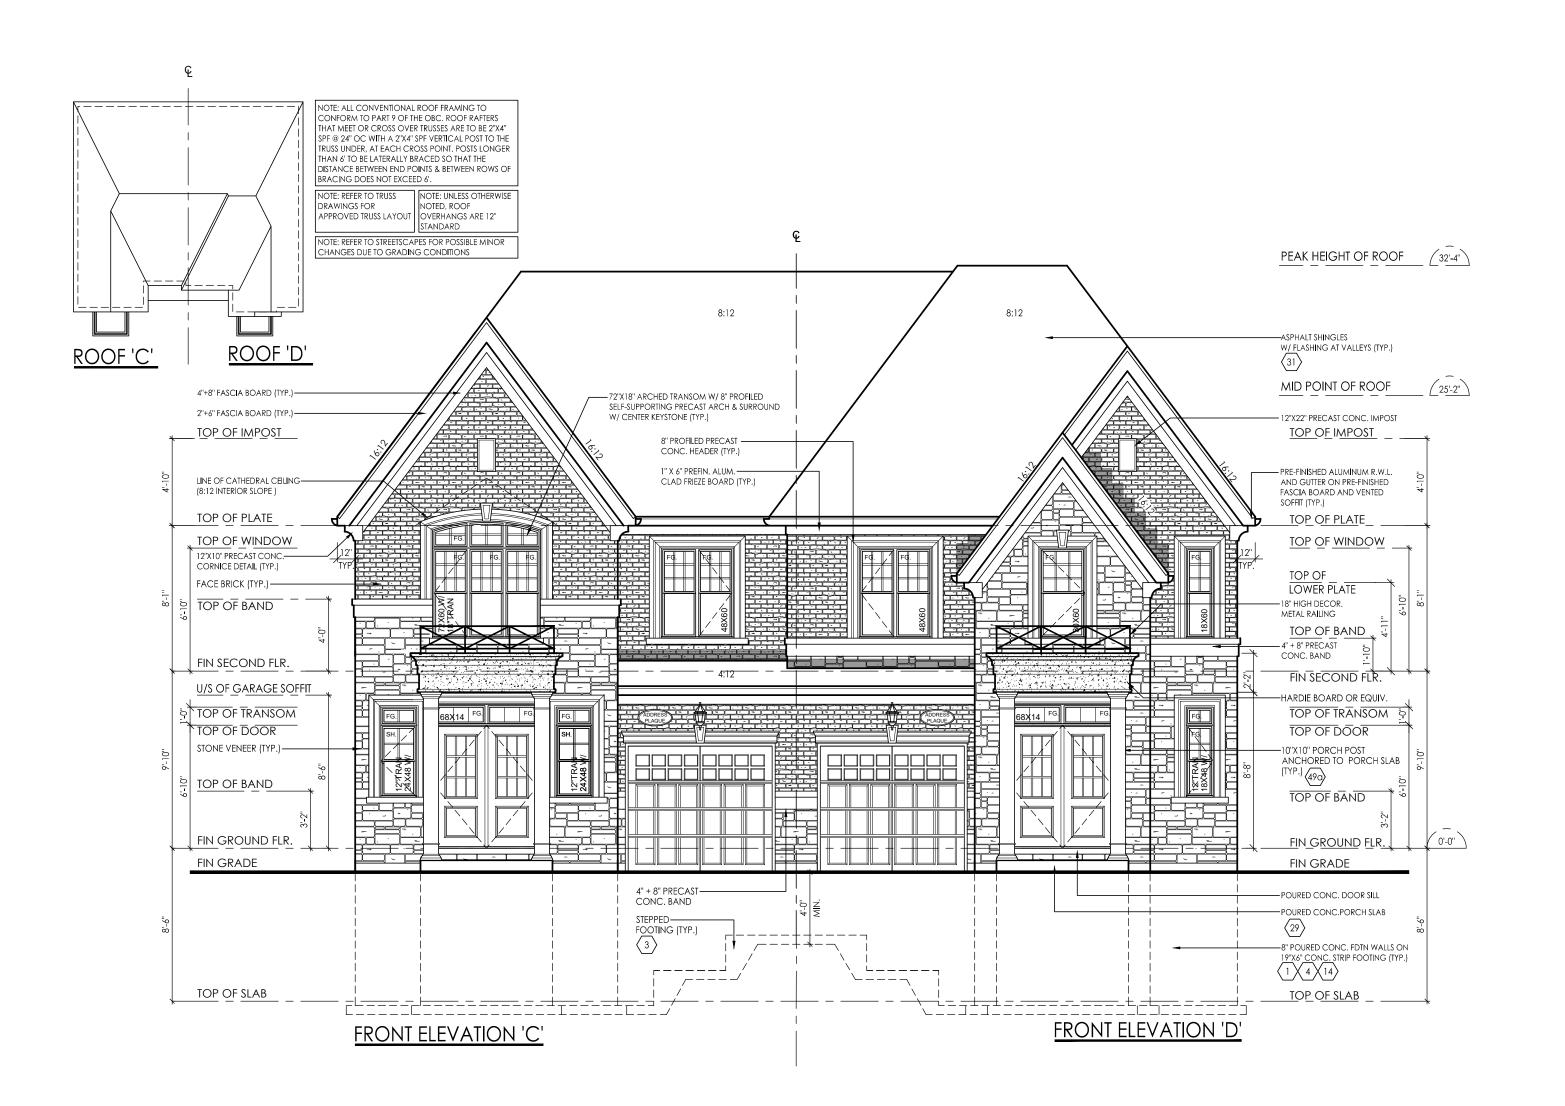





#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM
client				

Gold Park Homes

ENCORE 2	
Brampton	
SD-09	
30-07	
THE GERSHWIN	
19037	
3/16" = 1'-0"	
	SD-09 THE GERSHWIN 19037





859.83 S.F 79.88 S.M

TOP OF SLAB

LEFT SIDE ELEVATION 'C'

TOP OF SLAB



WWW.RNDESIGN.COM Tel: 905-738-3177 WWW.THEPLUSGROUP.CA

I, DECLARE THAT I HAVE DESIGN RESPONSIBILITY FOR THE DESIGN OF RN DESIGN LTD, UNDER DESIGN OF THE BUILDING PREGISTE PRELIMINARY - NEGISTE PRELIMINARY - ONSTRUC	REVIEWED AND TAKEN N BEHALF TION-3.2.4 E FIRM IS TION JES.
FOR COINS	DATEOUT
SIGNATURE:	

#	revisions	date	dwn	chk
1	ISSUED FOR CLIENT REVIEW	20-SEPT-19	KH	JM

Gold Park Homes

	ENCORE 2
	Brampton
model	00 02
	SD-09
	THE GERSHWIN
project #	19037
scale	3/16" = 1'-0"