



FLANKAGE ELEVATION



FRONT ELEVATION

(LOTS 72, 101)
UNIT 5011-CORNER-UPG-TIMBERLAND

SB-12 ENERGY EFFICIENCY DESIGN MATRIX		
PRESCRIPTIVE COMPLIANCE		SB-12 (SECTION 3.1.1) TABLE 3.1.1.2.A
PACKAGE A1		SPACE HEATING FUEL
		☒ GAS ☐ OIL
		☐ ELECTRIC ☐ PROPANE
		☐ EARTH ☐ SOLID FUEL
BUILDING COMPONENT	REQUIRED	PROPOSED
INSULATION RSI (R) VALUE		
CEILING W/ ATTIC SPACE	10.56 (R60)	10.56 (R60)
CEILING W/O ATTIC SPACE	5.46 (R31)	5.46 (R31)
EXPOSED FLOOR	5.46 (R31)	5.46 (R31)
WALLS ABOVE GRADE	3.87 (R22)	3.87 (R22)
BASEMENT WALLS	3.52 ci	3.52 ci
* PROPOSED VALUES MAY BE SUBSTITUTED W/ 2.11+1.76ci (R12+R10ci)	(R20 ci) *	(R20 ci) *
BELOW GRADE SLAB ENTIRE SURFACE > 600mm BELOW GRADE	-	-
EDGE OF BELOW GRADE SLAB ≤ 600mm BELOW GRADE	1.76 (R10)	1.76 (R10)
HEATED SLAB OR SLAB ≤ 600mm BELOW GRADE	1.76 (R10)	1.76 (R10)
WINDOWS & DOORS		
WINDOWS/SLIDING GLASS DOORS (MAX U-VALUE)	1.6	1.6
SKYLIGHTS (MAX. U-VALUE)	2.8	2.8
APPLIANCE EFFICIENCY		
SPACE HEATING EQUIP. (AFUE%)	96%	96%
HRV EFFICIENCY (%)	75%	75%
DHW HEATER (EF)	0.8	0.8
AREA CALCULATIONS		
EL. 'A'		
STD. PLAN		
GROUND FLOOR AREA	2114.67 sq. ft.	
	(196.46 sq. m.)	
SECOND FLOOR AREA	2700.50 sq. ft.	
	(250.88 sq. m.)	
SUBTOTAL	4815 sq. ft.	
	(447.34 sq. m.)	
DEDUCT ALL OPEN AREAS	41.16 sq. ft.	
	(3.82 sq. m.)	
TOTAL NET AREA	4774 sq. ft.	
	(443.52 sq. m.)	
FINISHED BASEMENT AREA	186.10 sq. ft.	
	(17.29 sq. m.)	
COVERAGE W/OUT PORCH	2743.41 sq. ft.	
	(254.87 sq. m.)	
COVERAGE W/ PORCH	2857.08 sq. ft.	
	(265.43 sq. m.)	
COVERAGE W/ OPT. LOGGIA	0 sq. ft.	
	(0.00 sq. m.)	
WINDOW / WALL AREA CALCULATIONS		
EL. 'A'		
STD. PLAN		
GROSS WALL AREA	5265.23 sq. ft.	
	(489.16 sq. m.)	
GROSS WINDOW AREA	655.72 sq. ft.	
(INCL. GLASS DOORS & SKYLIGHTS)	(60.92 sq. m.)	
TOTAL WINDOW %	12.45 %	
		7. -
		6. ISSUED FOR PERMIT
		5. REVISED PER STURCT. ENG. COMMENTS
		4. CO-ORD. W/ FLOOR & TRUSS LAYOUTS
		3. REVISED JOIST DIRECTION OVER LIBRARY, FOYER, DINING
		2. REVISED PER CLIENT DESIGN CHANGES
		1. ISSUED FOR CLIENT REVIEW
		REVISIONS

- 1 - TITLE PAGE
- 2 - BASEMENT PLAN, EL. 'A'
- 3 - GROUND FLOOR PLAN, EL. 'A'
- 4 - SECOND FLOOR PLAN, EL. 'A'
- 5 - BASEMENT PLAN, EL. 'A'
- 6 - UPGRADED LEFT SIDE ELEVATION 'A'
- 7 - RIGHT SIDE ELEVATION 'A'
- 8 - UPGRADED REAR ELEVATION 'A'
- 9 - UPGRADED REAR ELEVATION 'A'
- 10 - CONSTRUCTION NOTES


7. -	-	-
6. ISSUED FOR PERMIT	-	-
5. REVISED PER STURCT. ENG. COMMENTS	2022.08.18	WT
4. CO-ORD. W/ FLOOR & TRUSS LAYOUTS	2022.07.27	WT
3. REVISED JOIST DIRECTION OVER LIBRARY, FOYER, DINING	2022.06.16	AW
2. REVISED PER CLIENT DESIGN CHANGES	2022.06.09	WT
1. ISSUED FOR CLIENT REVIEW	2022.05.16	AW
REVISIONS	DATE (YYYYMMDD)	BY



WSP

180 COMMERCIAL VALLEY DR. W.
THIRD FLOOR
TORONTO, ONT. M5V 2E6
TEL: 1-888-882-4771 FAX: 1-888-522-0898 WWW.WSPGROUP.CA

FOR STRUCTURAL ONLY, EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST, AND FLOOR LVL BEAM DESIGN.

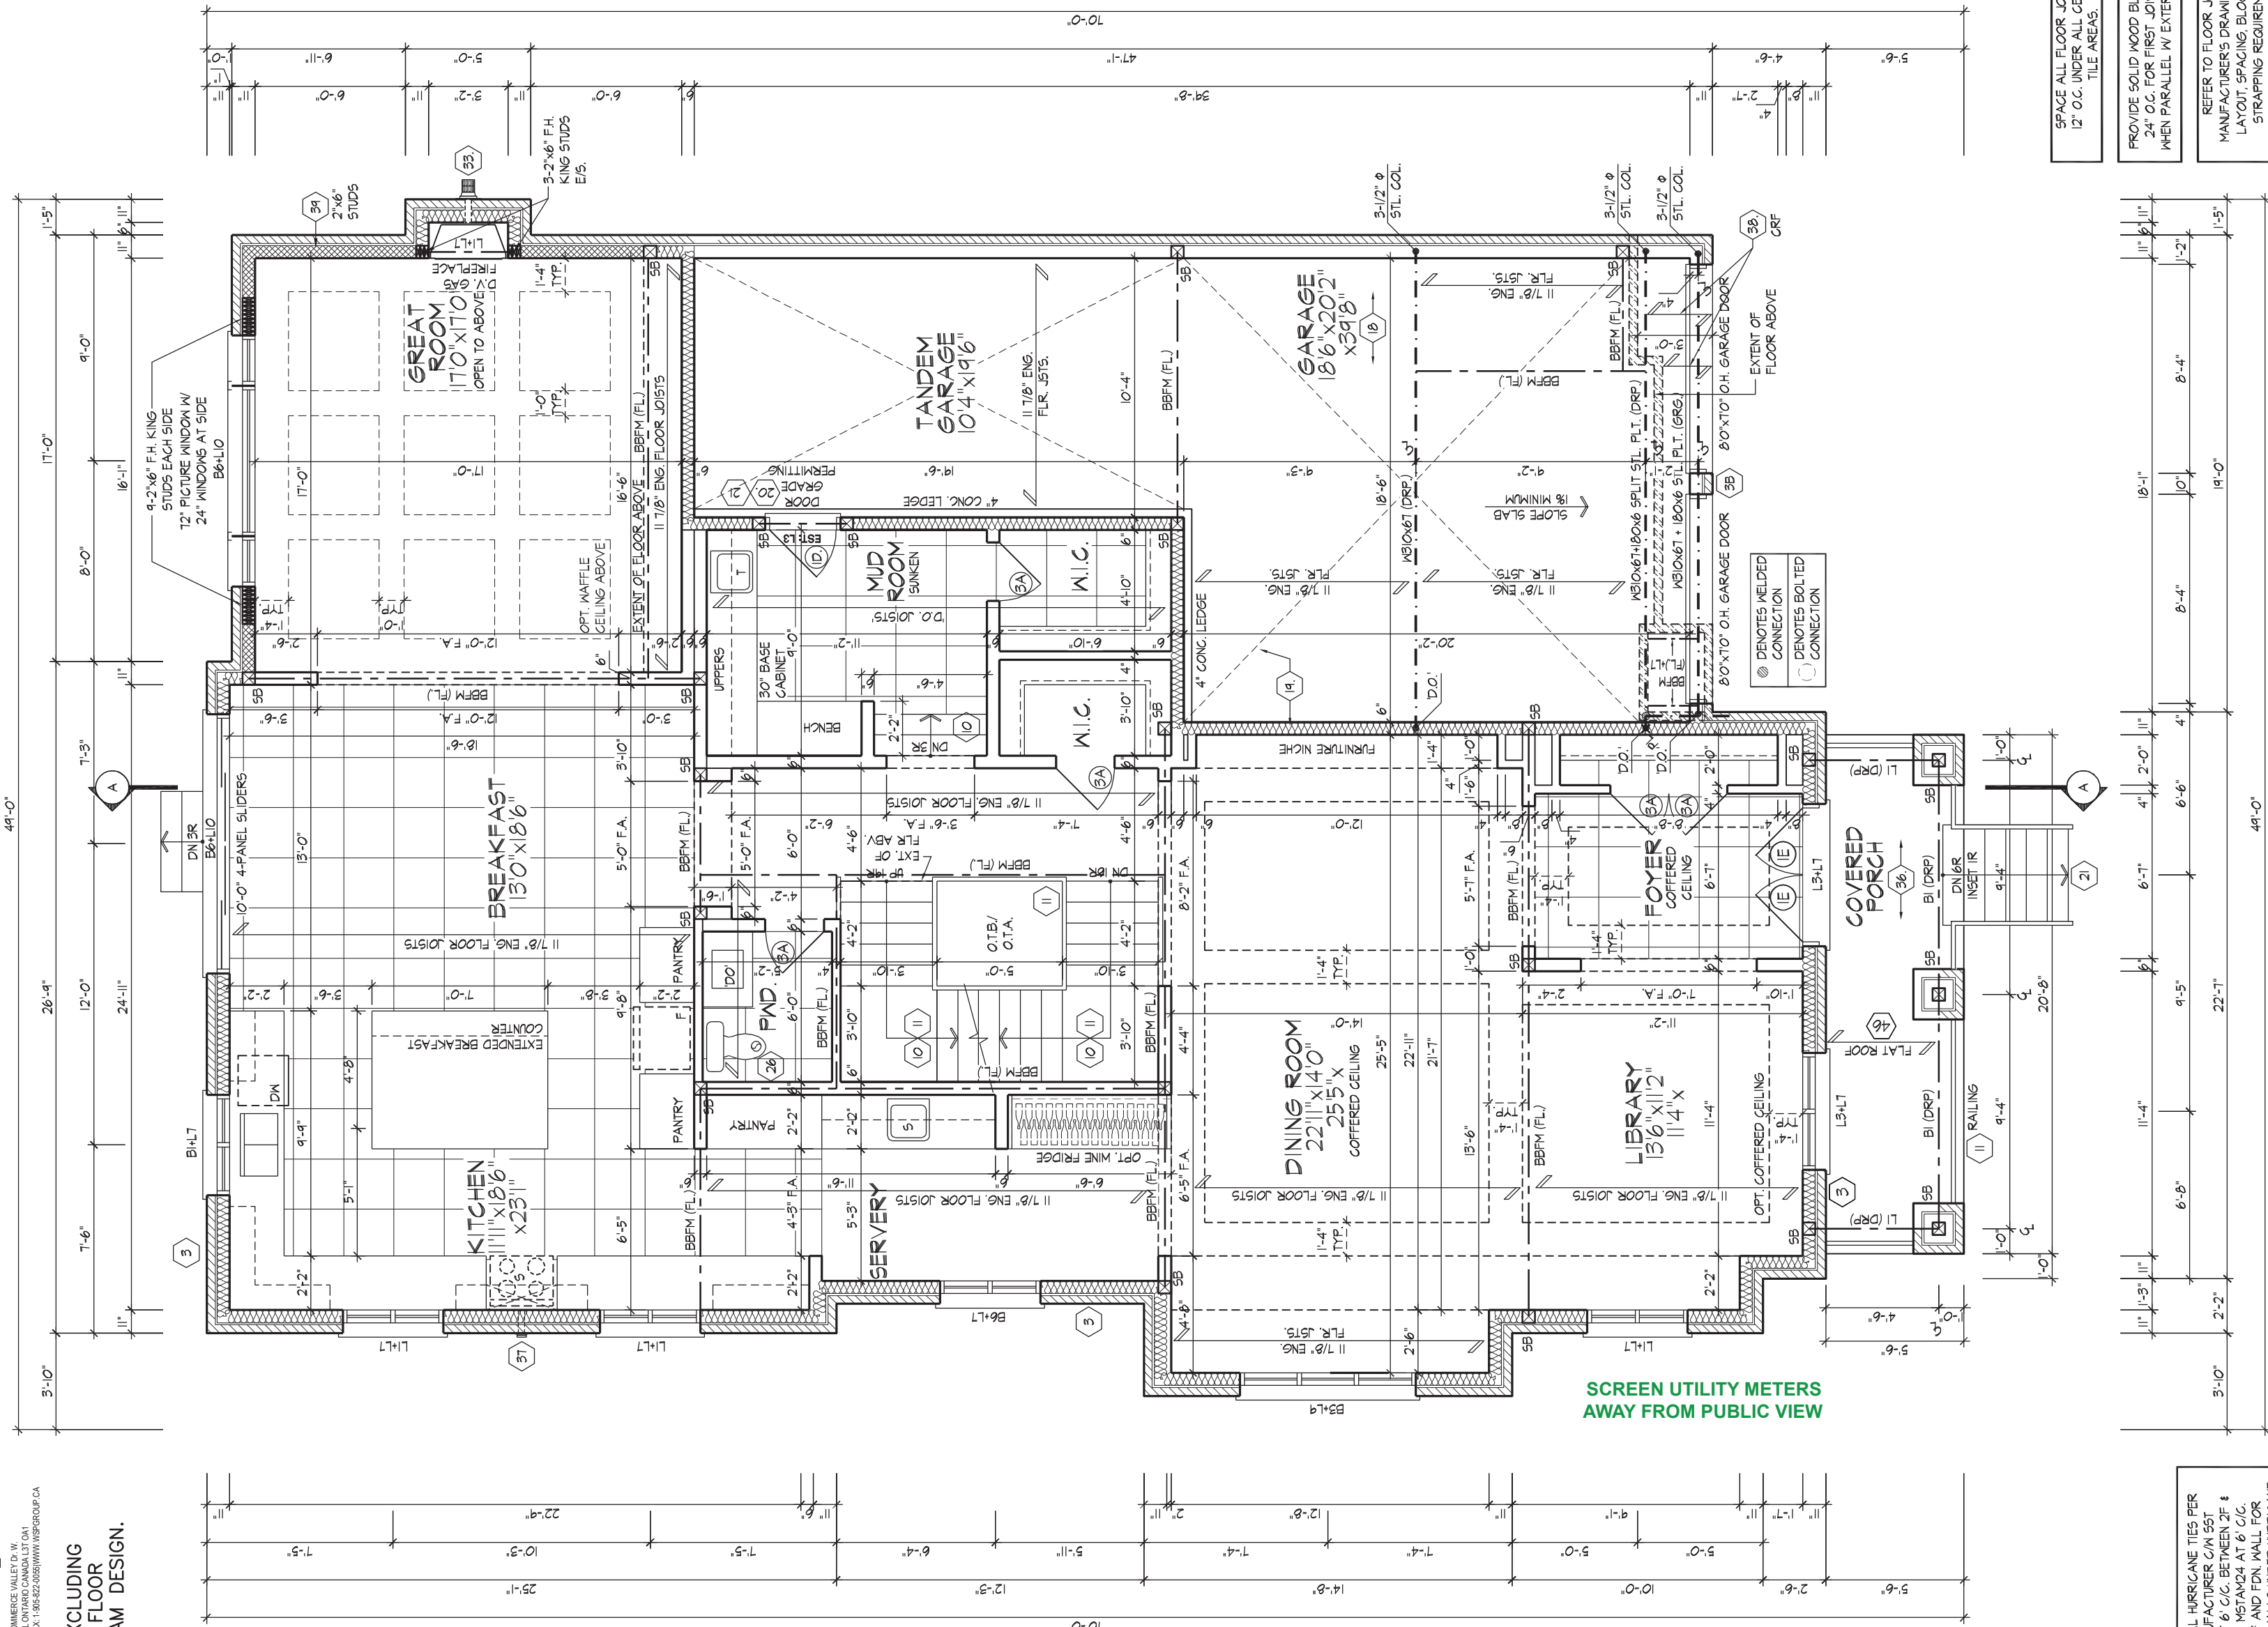

- SPACE ALL FLOOR JOISTS @ 12" O.C. UNDER ALL CERAMIC TILE AREAS.
- PROVIDE SOLID WOOD BLOCKING @ 24" O.C. FOR FIRST JOIST SPAN WHEN PARALLEL W/ EXTERIOR WALL.
- REFER TO FLOOR JOIST MANUFACTURER'S DRAWINGS FOR LAYOUT, SPACING, BEAMING, STRAPPING, BRACING, INSTALLATION DETAILS AND HANGER SIZES, & SUBFLOOR THICKNESS.

GROUND FLOOR PLAN, EL. 'A' - LOT 72/10

INSTALL ALL HURRICANE TIES PER ROOF MANUFACTURER'S INSTRUCTIONS. TIES TO BE LOCATED AT 6" O.C. BETWEEN 2" & 4" FROM EXTERIOR WALLS, AND BETWEEN 1' AND 2' FROM EXTERIOR WALLS UNDER HURRICANE TIES.

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of Vaughan.


JOHN G. WILLIAMS LTD., ARCHITECT
ARCHITECTURAL CONTROL REVIEW AND APPROVAL
APPROVED BY: [Signature]
DATE: AUG 24, 2022
This stamp certifies compliance with the applicable Design Guidelines only and bears no further professional responsibility.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Albin Whiting
SIGNATURE [Signature]
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.
19995

HUNT DESIGN ASSOCIATES INC.
www.huntdesign.ca
8966 Woodbine Ave, Markham, ON L3R 0J7
T 905.737.5133 F 905.737.7326

GROUND FLOOR PLAN, EL. 'A'
GOLDPARK HOMES - 221081 UNIT 5011-COR-UPG-TIMBERLAND
PINE VALLEY, PH.2 VAUGHAN, ONT.
REV.2022.08.18
Down By: WT Scale: 3/16"=1'-0" File Number: 221081WS5011-COR-UPG-TIMBERLAND.dwg Page Number: 3 of 10
Checked By: AW
T 905.737.5133 F 905.737.7326

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission. H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.

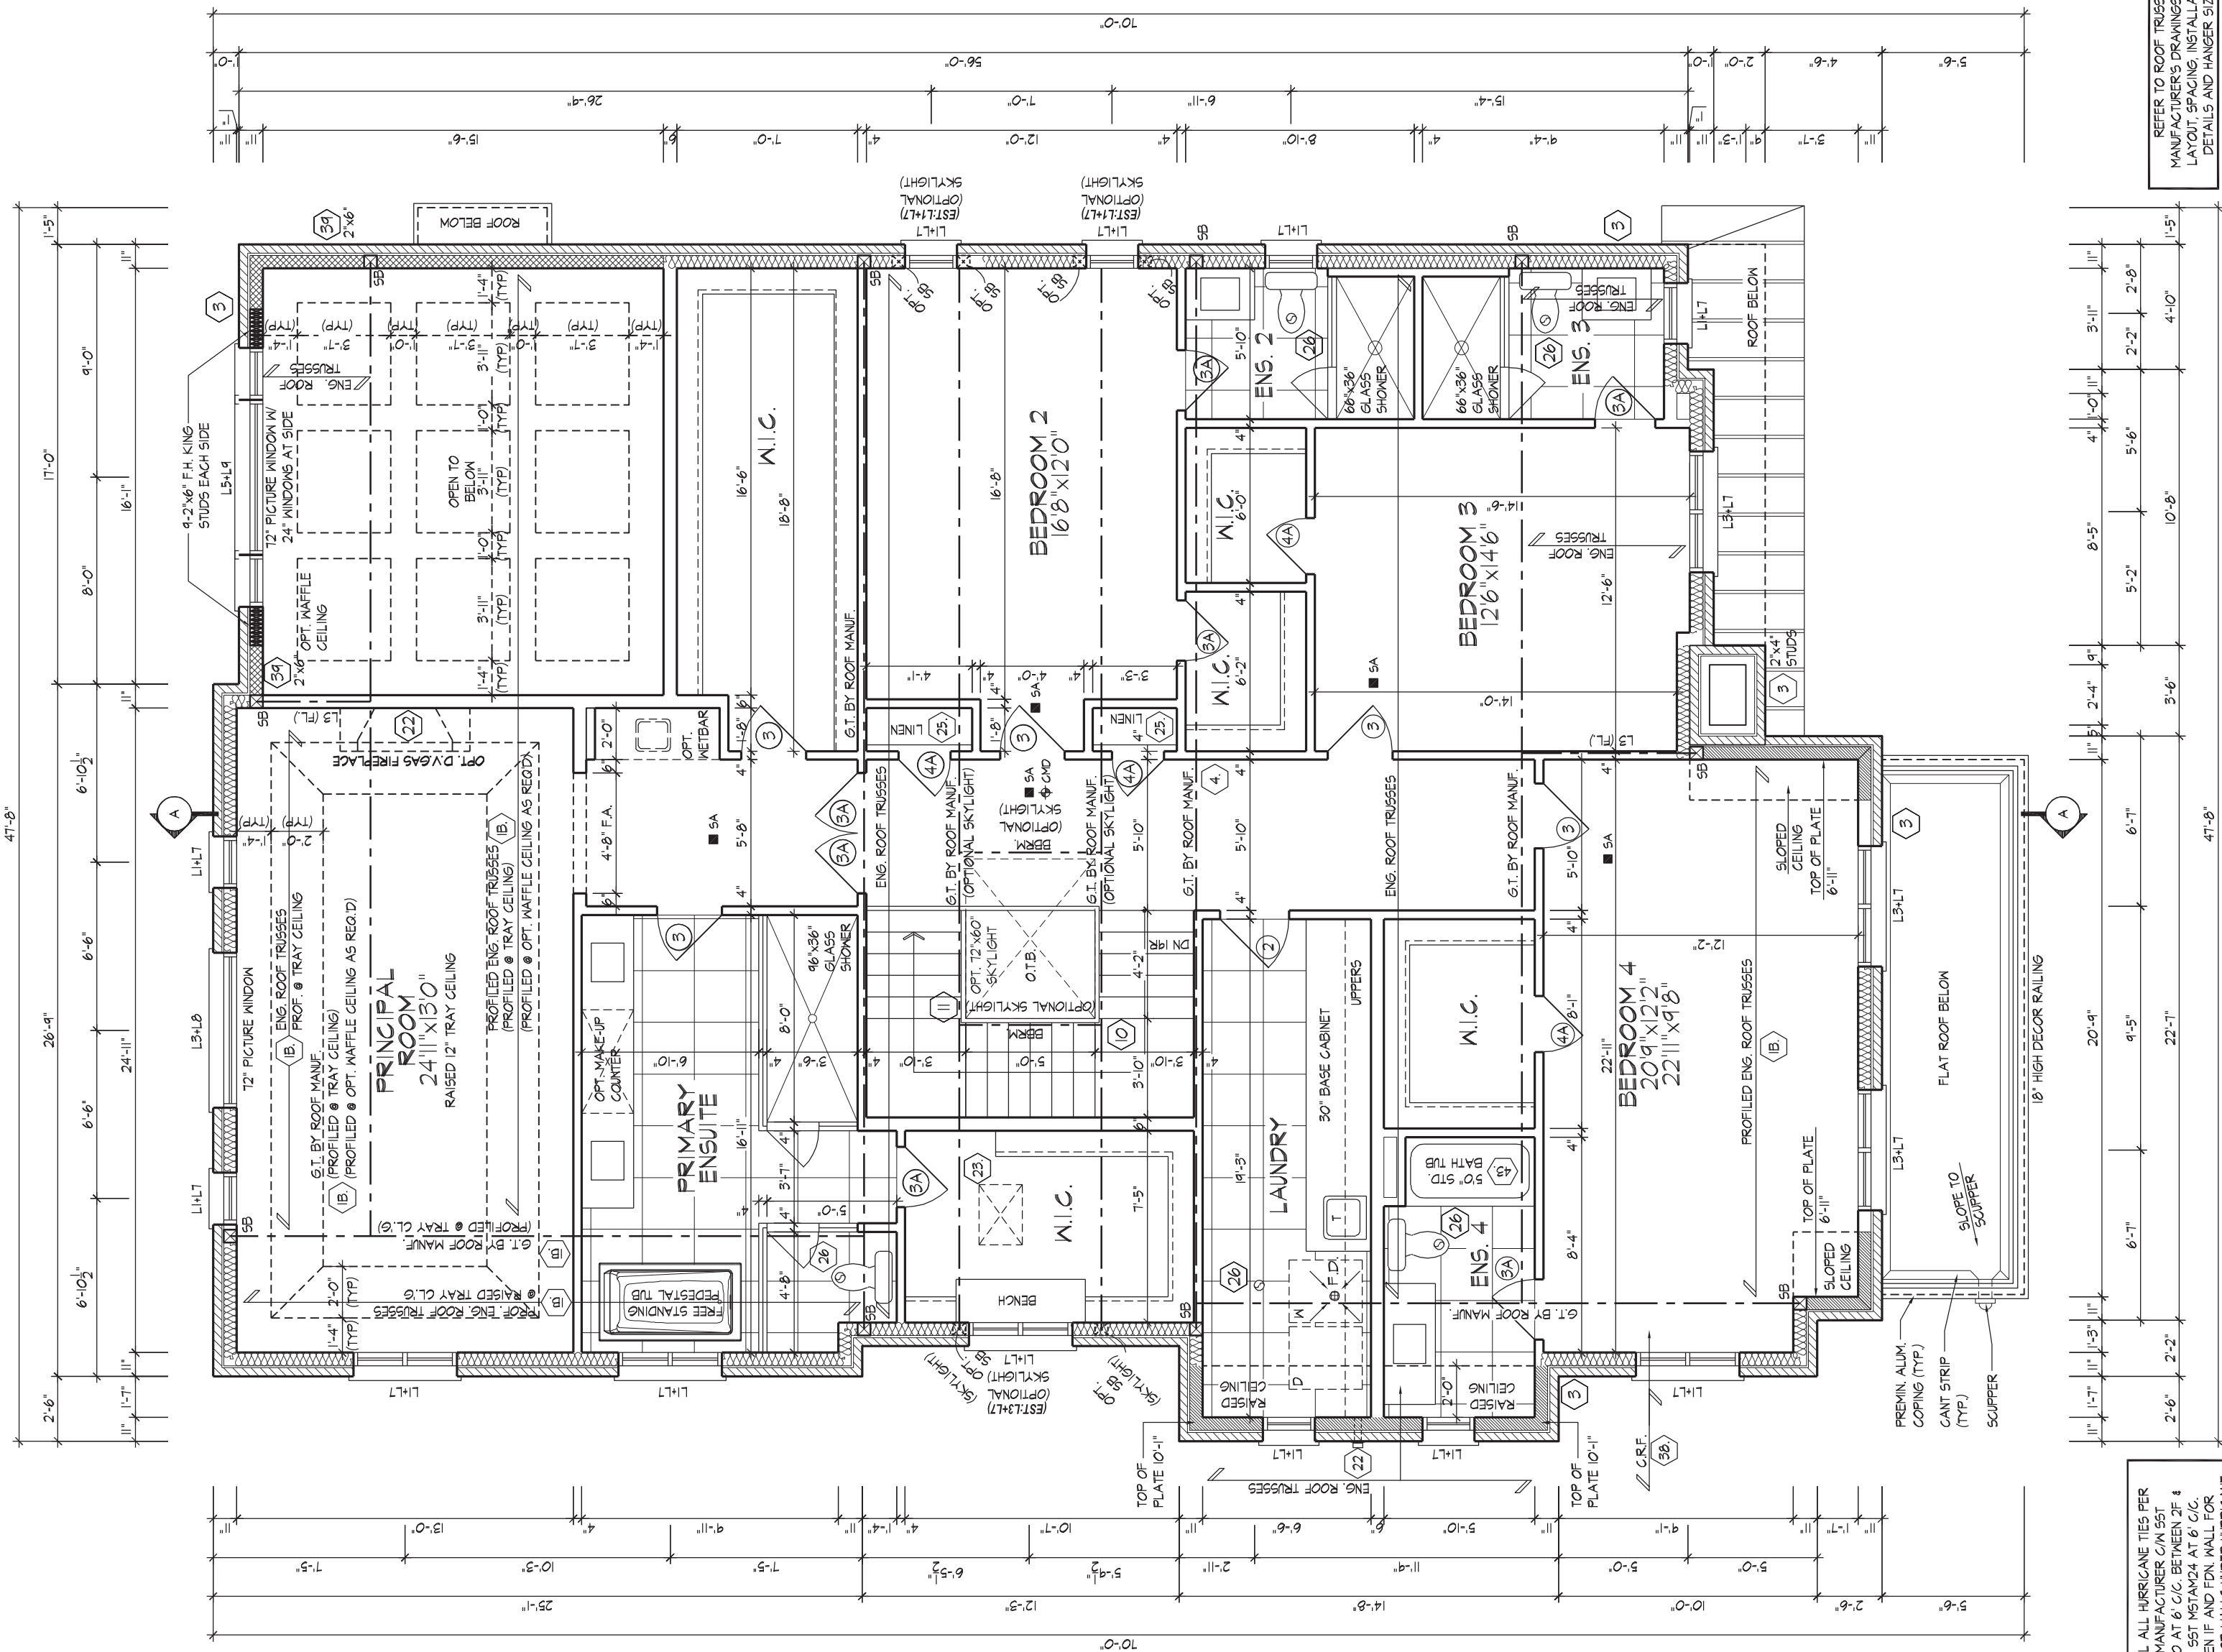

INSTALL ALL HURRICANE TIES PER
ROOF MANUFACTURER'S DRAWINGS FOR
LAYOUT, SPACING, INSTALLATION
DETAILS AND HANGER SIZES.

REFER TO ROOF TRUSSES
MANUFACTURER'S DRAWINGS FOR
LAYOUT, SPACING, INSTALLATION
DETAILS AND HANGER SIZES.

SECOND FLOOR PLAN, EL. 'A'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

JOHN G. WILLIAMS LTD., ARCHITECT
ARCHITECTURAL CONTROL REVIEW
AND APPROVAL
APPROVED BY: _____
DATE: AUG 23, 2022
This stamp certifies compliance with the applicable Design Guidelines only and bears no further professional responsibility.



FOR STRUCTURAL ONLY, EXCLUDING
ENGINEERED ROOF TRUSSES, FLOOR
JOIST, AND FLOOR LVL BEAM DESIGN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS
THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING
CODE TO BE A DESIGNER.

Alton Whiting
SIGNATURE
REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC.
19995

23177
BCIN
8966 Woodbine Ave, Markham, ON L3R 0J7
T 905.737.5133 F 905.737.7326



GOLDPARK HOMES - 221081 UNIT 5011-COR-UPG-TIMBERLAND
PINE VALLEY, PH.2 VAUGHAN, ONT.
REV.2022.08.18

Drawn By: WT
Checked By: AW
Scale: 3/16"=1'-0"
File Number: 221081WS5011-COR-UPG-TIMBERLAND.dwg
Page Number: 4 of 10

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature).

JOHN G. WILLIAMS LTD., ARCHITECT
ARCHITECTURAL CONTROL REVIEW
AND APPROVAL

APPROVED BY: 
DATE: AUG 24, 2022

This stamp certifies compliance with the applicable Design Guidelines only and bears no further professional responsibility.

H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature.)

WINDOW SUMMARY			
PER O.B.C. TABLE 9.10.15.4			
RIGHT SIDE ELEVATION A			
QTY	WIDTH	DEPTH	WINDOW / DOOR FRAME SIZE (S.F.)
6	24"	64"	50.00
3	72"	64"	85.00
1	48"	40"	11.00
2	72"	82"	73.67
2	24"	18"	3.60
1	48"	18"	4.28
2	72"	18"	13.22
0	0"	0"	0.00
0	0"	0"	0.00
0	0"	0"	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
0	ARCH	0.00	0.00
SPATIAL CALCULATION			
EXPOSING BUILDING	962.23	S.F.	
FACE AREA	89.40	S.M.	
PORTION WALL AREA	962.28	S.F.	
	89.40	S.M.	
LIMITING DISTANCE	8.0	m	
MAX. % OPENINGS	34	%	
OPENINGS ALLOWED	327.18	S.F.	
OPENINGS PROVIDED	241.98	S.F.	
ADDITIONAL NOTES			
GLAZED AREA CALCULATED W/ FRAME SIZE MINUS 2" AROUND ENTIRE PERIMETER			



UPGRADED REAR ELEVATION 'A'

It is the builder's complete responsibility to ensure that all plans submitted for approval fully comply with the Architectural Guidelines and all applicable regulations and requirements including zoning provisions and any provisions in the subdivision agreement. The Control Architect is not responsible in any way for examining or approving site (lotting) plans or working drawings with respect to any zoning or building code or permit matter or that any house can be properly built or located on its lot.

This is to certify that these plans comply with the applicable Architectural Design Guidelines approved by the City of VAUGHAN.

JOHN G. WILLIAMS LTD., ARCHITECT
ARCHITECTURAL CONTROL REVIEW
AND APPROVAL
APPROVED BY: *[Signature]*
DATE: AUG 23, 2022
This stamp verifies compliance with the applicable Design Guidelines only and bears no further professional responsibility.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING CODE TO BE A DESIGNER.

QUALIFICATION INFORMATION
NAME: *Albin Whiting* SIGNATURE: *AW* BCIN: 23177



REGISTRATION INFORMATION
HUNT DESIGN ASSOCIATES INC. 19895

HUNT
DESIGN ASSOCIATES INC.
www.hunt-design.ca

GOLDPARK HOMES - 221081 UNIT 5011-COR-UPG-TIMBERLAND
PINE VALLEY, PH.2 VAUGHAN ONT. REV.2022.08.18

Drawn By: WT Checked By: AW Scale: 3/16"=1'-0" File Number: 221081WS5011-COR-UPG-TIMBERLAND.dwg Page Number: 8 of 10

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature).

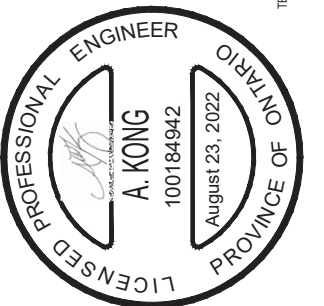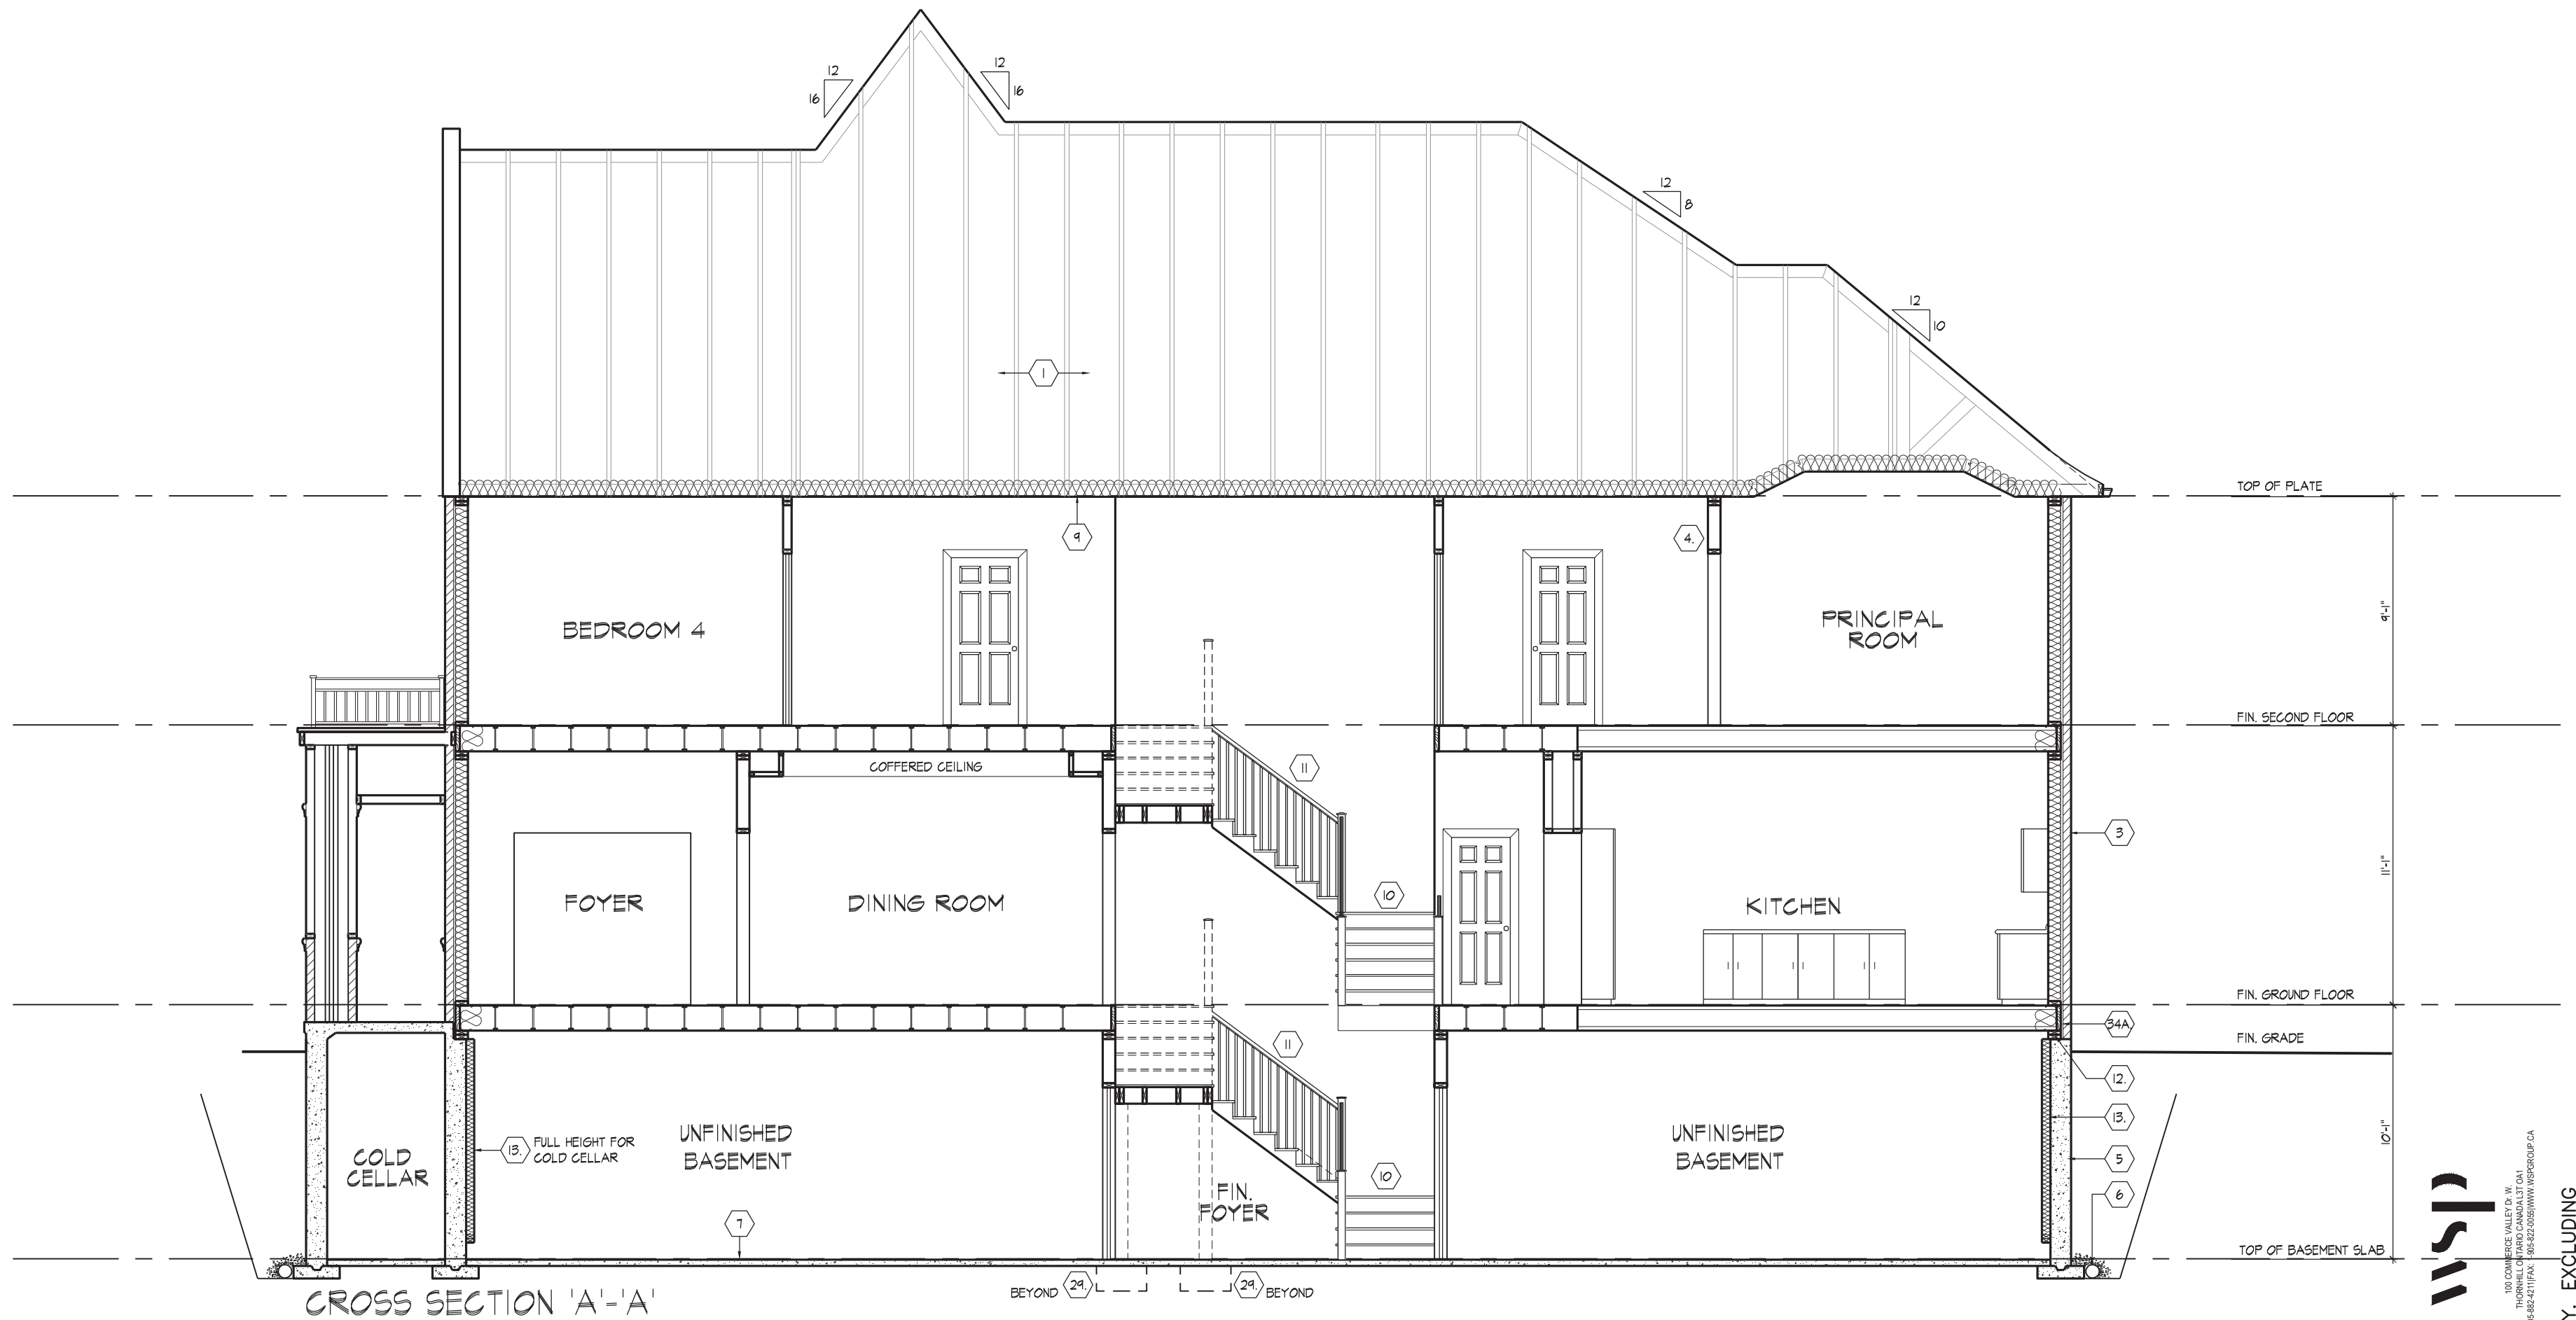

FOR STRUCTURAL ONLY - EXCLUDING
ENGINEERED ROOF TRUSS, FLOOR
JOIST, AND FLOOR LVL BEAM DESIGN.

THE UNDERSIGNED HAS REVIEWED AND TAKES RESPONSIBILITY FOR THIS DESIGN AND HAS
THE QUALIFICATIONS AND MEETS THE REQUIREMENTS SET OUT IN THE ONTARIO BUILDING
CODE TO BE A DESIGNER.
QUALIFICATION INFORMATION
Name: **Albin Whiting**
Signature: *AW*
Registration Number: **23177**
HUNT DESIGN ASSOCIATES INC. **19995**

HUNT
DESIGN ASSOCIATES INC.
www.hunt-design.ca

UPGRADED REAR ELEVATION 'A'
GOLDPARK HOMES - 221081 UNIT 5011-COR-UPG-TIMBERLAND
PINE VALLEY, PH.2 VAUGHAN ONT. **REV.2022.08.18**
Drawn By: **WT** Checked By: **AW** Scale: **3/16"=1'-0"** File Number: **221081WS5011-COR-UPG-TIMBERLAND.dwg** Page Number: **9 of 10**
8966 Woodbine Ave, Markham, ON L3R 0J7 T 905.737.5133 F 905.737.7326

All drawings specifications related documents and design are the copyright property of Hunt Design Associates (H.D.A.). Reproduction of this property in whole or in part is strictly prohibited without H.D.A.'s written permission (H.D.A. assumes no responsibility or liability for this property unless it bears the appropriate BCIN number and original signature).

1 ROOF CONSTRUCTION (R.9, 9.23.13, 9.23.15)
NO. 210 (10% KG2M) ASPHALT SHINGLES /38' (9.5) PL WOOD SHEATHING WITH 1/4" CLIPS, APPROX. 100 STUDS PER S.F. MIN. 2x4 @ 24" O.C. MAX. APPROVED EAVES PROTECTION TO EXTEND 2'-11" (800) FROM EDGE OF ROOF AND MIN. 12" (305) BEYOND INNER FACE OF BOTTOM CHORD. PROVIDE 1"x38x98 TRUSS BRACING @ 6'-0" (1830) O.C. AT BOTTOM CHORD. PREFIN. ALUM. FASTENERS. EAVESTROUGH FASSTON OR EQUIV. ATTIC VENTILATION 1:300 OF INSULATED CEILING AREA WITH MIN. 25% OR REQUIRED OPENINGS LOCATED AT TOP OF SPACE & MIN. 25% OF REQUIRED OPENINGS LOCATED AT BOTTOM WITH 1"x6" EAVESTROUGH. PROVIDE 1"x6" EAVESTROUGH ON ONE SIDE ONLY. CONCRETE SPLASH PADS OR PER MUNICIPAL REQUIREMENTS. TOWNHOUSES TO HAVE 5' MIN. EAVESTROUGH WITH ELEC. TRACED HEATER CABLE ALONG EAVESTROUGH AND DOWN RILL.

1A ICE AND WATER SHEILD
PROVIDE ICE AND WATER SHEILD IN THE AREAS INDICATED. THE ICE AND WATER SHEILD SHALL BE A SELF ADHESIVE MEMBRANE. PROVIDE 1"x6" EAVESTROUGH. SIDE LAPS SHALL BE A MINIMUM 1'-0" (305) AND END LAPS A MINIMUM #6 (152), AND TO EXTEND UP DORMER WALLS A MINIMUM 12" (305).

1B PROFILED ROOF TRUSSES
ROOFS TRUSSES SHALL BE PROFILED AND/OR STEEPED AT RAISED CORNERS/TRAY CEILINGS, ANGLED TRAY CEILINGS WILL BE SHEATHED W/ 3/8" (9.5) PL.WOOD.

2 SIDING WALL CONSTRUCTION (2"x6")
SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS. FURNISH MEMBERS OR BLOCKING BETWEEN THE FRAMING MEMBERS ON APPROVED SHEATHING PAPER ON 3/8" (9.5) EXT. GRADE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1.) & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE AIR/VAPOR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 1/2" (12.7) GYPSSUM WALLBOARD INTERIOR FINISH. PROVIDE WEEP HOLES @ 32" (800) O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING U/ MIN. #6 (150). BEHIND BUILDING PAPER (9.23.16.3.1.) (REFER TO 35 NOTE AS REQ.)

2A SIDING WALL CONSTRUCTION (2"x6") W/ CONTIN. INSULATION
SIDING MATERIAL AS PER ELEVATION ATTACHED TO FURNISH MEMBERS ON APPROVED AIRWATER BARRIER AS PER O.B.C. 9.27.3, ON EXTERIOR TYPE RIDG INSULATION (JOINTS UNATTACHED) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS. ON 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1.) & SECTION 1.1., INSULATION, APPROVED 6 MIL. POLYETHYLENE AIR/VAPOR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 1/2" (12.7) GYPSSUM WALLBOARD INTERIOR FINISH. PROVIDE WEEP HOLES @ 32" (800) O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING U/ MIN. #6 (150). BEHIND BUILDING PAPER (9.23.16.3.1.) (REFER TO 35 NOTE AS REQ.)

2B SIDING WALL @ GARAGE CONSTRUCTION
SIDING MATERIAL AS PER ELEVATION ATTACHED TO FRAMING MEMBERS. FURNISH MEMBERS OR BLOCKING BETWEEN THE FRAMING MEMBERS ON APPROVED SHEATHING PAPER ON 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1.) & SECTION 1.1., 1/2" (12.7) GYPSSUM WALLBOARD INTERIOR FINISH. PROVIDE WEEP HOLES @ 32" (800) O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING U/ MIN. #6 (150). BEHIND BUILDING PAPER (9.23.16.3.1.) (REFER TO 35 NOTE AS REQ.)

3 BRICK VENEER WALL CONSTRUCTION (2"x6")
3 1/2" (90) BRICK VENEER 1" (25) AIR SPACE, 7/8"x7/8"x13 (22x180x76) GALV. METAL TIES @ 16" (400) O.C. HORIZ. 2"x6" (600) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.20.9. ON APPROVED SHEATHING PAPER, 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1.) & SECTION 1.1., INSULATION AND 6 mil POLYETHYLENE AIR/VAPOR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 1/2" (12.7) GYPSSUM WALLBOARD INTERIOR FINISH. PROVIDE WEEP HOLES @ 32" (800) O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING U/ MIN. #6 (150). BEHIND BUILDING PAPER (9.23.16.3.1.) (REFER TO 35 NOTE AS REQUIRED)

3A BRICK VENEER WALL CONSTRUCTION (2"x6") W/ CONTIN. INSULATION
3 1/2" (90) BRICK VENEER 1" (25) AIR SPACE, 7/8"x7/8"x13 (22x180x76) GALV. METAL TIES @ 16" (400) O.C. HORIZ. 2"x6" (600) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.20.9. ON APPROVED SHEATHING PAPER, 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1.) & SECTION 1.1., INSULATION AND 6 mil POLYETHYLENE AIR/VAPOR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 1/2" (12.7) GYPSSUM WALLBOARD INTERIOR FINISH. PROVIDE WEEP HOLES @ 32" (800) O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING U/ MIN. #6 (150). OVER RIDG INSULATION (9.20.13.6.) (REFER TO 35 NOTE AS REQUIRED)

3B BRICK VENEER WALL @ GARAGE CONSTRUCTION
3 1/2" (90) BRICK VENEER, MIN. 1" (25) AIR SPACE, 7/8"x7/8"x13 (22x180x76) GALV. METAL TIES @ 16" (400) O.C. HORIZ. 2"x6" (600) O.C. VERT. BONDING AND FASTENING FOR TIES TO CONFORM WITH 9.20.9. ON APPROVED SHEATHING PAPER, 3/8" (9.5) EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1.) & SECTION 1.1., 1/2" (12.7) GYPSSUM WALLBOARD INTERIOR FINISH. PROVIDE WEEP HOLES @ 32" (800) O.C. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING U/ MIN. #6 (150). BEHIND BUILDING PAPER (9.23.16.3.1.) (REFER TO 35 NOTE AS REQ.)

4 INTERIOR STUD PARTITIONS (9.23.9.8, 9.23.10)
BEARING PARTITIONS SHALL BE A MINIMUM 2"x4" (38x89) @ 16" (400) O.C. FOR 2 STORY AND 12" (305) O.C. FOR 3 STORY. NON-BEARING PARTITIONS 2"x4" (38x89) @ 16" (400) O.C. PROVIDE 1"x4" (38) STUDS @ 24" (610) O.C. MAX. PROVIDE TOP PLATE, 1/2" (12.7) INT. DRYWALL BOTH SIDES OF STUDS. PROVIDE 2"x4" (38x140) STUDS WHERE NOTED. PROVIDE 2"x4" (38x89) @ 24" (610) O.C. LAIDER FRAMING WHERE WALLS INTERECT PERPENDICULAR TO ONE ANOTHER. PROVIDE 2"x4" (38x140) STUDS BLOCKING ON TOP OF 2"x4" (38x140) STUDS. PROVIDE 1"x4" (38) JOISTS WHEN NON-LADDERING WALLS ARE PARALLEL TO FLOOR JOISTS.

4A EXT. LOFT WALL CONSTRUCTION (2"x6") - NO CLADDING
3/8" (9.5) EXTERIOR TYPE SHEATHING. STUDS CONFORMING TO O.B.C.(9.23.10.1.) & SECTION 1.1., INSULATION AND 6 mil POLYETHYLENE VAPOR BARRIER WITH APPROVED CONT. AIR BARRIER, 1/2" (12.7) GYPSSUM WALLBOARD INT. FINISH. (9.23.3)

4B EXT. LOFT WALL CONSTRUCTION (2"x6") - NO CLADDING
EXT. LOFT WALL CONSTRUCTION (2"x6")
APPROVED AIRWATER BARRIER AS PER O.B.C. 9.27.3, ON EXTERIOR TYPE RIDG INSULATION (JOINTS UNATTACHED) MECHANICALLY FASTENED AS PER MANUFACTURERS SPECIFICATIONS. ON 3/8" (9.5) EXTERIOR TYPE SHEATHING STUDS CONFORMING TO O.B.C. (9.23.10.1.) & SECTION 1.1., INSULATION AND 6 MIL. POLYETHYLENE VAPOR BARRIER WITH APPROVED CONTIN. AIR BARRIER, 1/2" (12.7) GYPSSUM WALLBOARD INT. FINISH. (9.23.3)

5 FOUNDATION WALL FOOTINGS
POURED CONC. FOUNDATION WALL AS PER CHART BELOW ON CONTINUOUS REINFORCED CONCRETE FOOTING. FOUNDATION WALLS SHALL EXTEND NOT LESS THAN 6" (150) ABOVE FINISHED GRADE. THE OUTSIDE OF THE FOUNDATION SHALL BE DAMPPROOFED WITH 2 MIL. POLYETHYLENE VAPOR BARRIER, 1/2" (12.7) GYPSSUM WALLBOARD AND BRUSH COAT FROM THE TOP TO 2" BELOW GRADE. PROVIDE A DRAINAGE LAYER ON THE OUTSIDE OF THE FOUNDATION WALL. SEAL THE DRAINAGE LAYER AT THE TOP. THE TOP OF THE CONC. FOOTING SHALL BE DAMPPROOFED.
FOOTING FOOTINGS SHALL BE DAMPPROOFED WITH 2 MIL. POLYETHYLENE VAPOR BARRIER, 1/2" (12.7) GYPSSUM WALLBOARD AND BRUSH COAT FROM THE TOP TO 2" BELOW GRADE. PROVIDE A DRAINAGE LAYER ON THE OUTSIDE OF THE FOUNDATION WALL. SEAL THE DRAINAGE LAYER AT THE TOP. THE TOP OF THE CONC. FOOTING SHALL BE DAMPPROOFED.
SHALL BE SIZED IN ACCORDANCE WITH 9.15.3.1.4 (1),(2) OF THE O.B.C., REFER TO CHART BELOW FOR RESPECTIVE SIZE, BRACE FOUNDATION WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL OF SUFFICIENT S.S. OR COMPACTION SHALL BE PROVIDED TO SUPPORT THE CAPACITY OF 125KPSA S.L.S. IF SOIL BEARINGS DOES NOT MEET MINIMUM CAPACITY, ENGINEERED FOOTINGS ARE REQUIRED. ACTUAL SOIL BEARING CAPACITY TO BE VERIFIED WITH SOIL ENGINEERING REPORT.
FOOTING TO CONSTRUCT TO MATCH DETAIL OF FOUNDATIONS. PROVIDE FOUNDATION WALL STRENGTH AND THICKNESS AND 9.15.4.
FOUNDATION WALLS SHALL NOT EXCEED 9'-0" (3.0m) IN UNSUPPORTED HEIGHT UNLESS OTHERWISE NOTED. (9.15.4.2.1)(1)

		UNREINFORCED SOLID CONCRETE FOUNDATION WALLS (9.15.4.2)			
		MAX. HEIGHT FROM FIN. SLAB TO GRADE			
		UNSUPPORTED AT TOP	SUPPORTED AT TOP		
15 MPa STRENGTH	* 8"	3'-11" (1,200)	< 2.5m	4'-0" (1,219)	3'-7.5m & 3'-10m
	" 10"	4'-7" (1,400)	7'-4" (2,151)	5'-0" (1,524)	6'-10" (2,057)
	" 12"	4'-7" (1,400)	7'-4" (2,300)	6'-4" (2,600)	6'-8" (2,050)
	" 14"	3'-11" (1,200)	7'-4" (2,300)	6'-4" (2,600)	6'-8" (2,050)
20 MPa STRENGTH	* 8"	3'-11" (1,200)	7'-4" (2,300)	7'-4" (2,300)	7'-2" (2,200)
	" 10"	4'-7" (1,400)	7'-4" (2,300)	6'-4" (2,600)	6'-8" (2,050)
	" 12"	4'-7" (1,400)	7'-4" (2,300)	6'-4" (2,600)	6'-8

5A	FOUNDATION REDUCTION IN THICKNESS FOR MASONRY WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO PERMIT THE INSTALLATION OF MASONRY EXTERIOR FINISH, THE REDUCED SECTION SHALL BE NOT LESS THAN 3 1/2" (90) THICK. THE BRICK VENEER SHALL BE TIED TO THE FOUNDATION WALL WITH CORROSION RESISTANT METAL TIES, 7" (178) (200) VERTICAL AND 2'-11" (509) HORIZONTAL. TIE JOINT WITH MORTAR BETWEEN WALL AND BRICK VENEER (9.15.4/2.73) (9.20.9.43)	20	GARAGE DOOR TO HOUSE (9.10.9.16, 9.10.13.10, 9.10.13.15) GAS-PROOF DOOR AND FRAME, DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHER STRIPPING.																														
5B	FOUNDATION REDUCTION IN THICKNESS FOR JOISTS WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO PERMIT THE INSTALLATION OF FLOOR JOISTS, THE REDUCED SECTION SHALL BE NOT MORE THAN 13 3/4" (350) HIGH AND NOT LESS THAN 3 1/2" (90) THICK (9.15.4/7.11)	21	EXTERIOR AND GARAGE STEPS PRECAST CONC. STEP OR WOOD STEP WHERE NOT EXPOSED TO WEATHER. MAX RISE 7 7/8" (200), MIN. TREAD 9 1/4" (235). FOR THE REQUIRED NUMBER OF STEPS REFER TO SITTING AND GRADING DRAWINGS. EXTERIOR CONCRETE STAIRS WITH MORE THAN 2 RISERS AND 2 TREADS SHALL BE PROVIDED WITH FOUNDATION AS REQUIRED BY SECTION 9.8.2.2. OR STAIR SHALL BE CANTILEVER AS PER SUBSECTION 9.8.10.																														
6	WEAVING TILE (9.14.3) 1" (25) @ WEAVING TILE W/ FILTER CLOTH WRAP & #12 CRUSHED STONE COVER	22	DRYER EXHAUST CAPPED DRYER EXHAUST VENT TO EXT. CONFORMING TO PART 6, OBC & 9.10.13.15																														
7	BASEMENT SLAB OR SLAB ON GRADE (9.16.14) (9.13) 3" (76) MIN. 25MPa (3800psi) CONC. SLAB ON 4" (100) COARSE GRANULAR FILL, PERM. (2500psi) (2500psi) WITH DAMPROOFING UNDER SLAB. PROVIDE 1/2" (12.7) IMPERVIOUS BOARD FOR BOND BREAK AT EDGE. WHERE A BASEMENT SLAB IS WITHIN 24" (610) OF THE EXTERIOR GRADE PROVIDE RIGID INSUL. AROUND THE PERIMETER EXTENDING MIN. 24" (610) BELOW GRADE. FOR SLAB ON GRADE CONDITIONS RIGID INSULATION SHALL BE APPLIED TO THE UNDERSIDE OF THE ENTIRE SLAB. (9.15.2/1.73) (5.6) (6)	23	ATTIC ACCESS (9.19.2.1) ATTIC ACCESS HATCH WITH MIN. AREA OF 0.32m² AND NO DIM. LESS THAN 21" (535) WITH (545) WITH WEATHER STRIPPING. HATCHWAYS TO THE ATTIC OR ROOF SPACE SHALL BE FITTED WITH DOORS OR COVERS AND SHALL BE INSULATED WITH MIN. R20 (RSI 3.52) (9.12.3/1.8/1.11)																														
8	EXPOSED FLOOR TO EXTERIOR (9.10.17.10, & CANULC-5705.2) PROVIDE SPRAY FOAM INSULATION BETWEEN CANT. JOIST AND INSTALLED OSB CONFORMING TO 9.2.9.3. FIN. SOFTFOAM CLADDING AS PER ELEVATION TO US OF EXPOSED CANT. JOIST.	24	FIREPLACE CHIMNEYS (9.2.1) TOP OF FIREPLACE CHIMNEY SHALL BE 2'-11" (889) ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 2'-0" (610) ABOVE THE ROOF SURFACE WITHIN A HORZ. DISTANCE OF 10'-4" (3048) FROM THE EDGE OF THE ROOF.																														
9	EXPOSED CEILING TO EXTERIOR W/ ATTIC (9.25.2.4) INSULATION 6 mil POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM BOARD INTERIOR FINISH OR APPROVED EQ. EXPOSED CEILING TO EXTERIOR w/o ATTIC (9.25.2.4) JOISTS/TRUSSES AS PER PLANS W/ 2"x2" (38x38) PURLINS @ 16" (406) O.C. PERPENDICULAR TO JOIST PLANS NOT REQ. W/ SPRAY FOAM OR ROOF TRUSSES, W/ INSULATION BETWEEN JOIST. 6 mil POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM BOARD INT. FINISH OR APPROVED EQ. (CANULC-5705.2, 9.19.1, 9.10.17.10)	25	LINEN CLOSET PROVIDE 4 SHELVES MIN. 14" (356) DEEP.																														
10	ALL STAIRS/EXTERIOR STAIRS (9.8.1.2, 9.8.2, 9.8.6.4) <table border="1"> <thead> <tr> <th>PRIVATE</th> <th>MIN. RISE</th> <th>MIN. RUN</th> <th>MAX. RISE</th> <th>MIN. RUN</th> <th>ALL STAIRS</th> </tr> </thead> <tbody> <tr> <td>PRIVATE</td> <td>7" (178)</td> <td>11" (279)</td> <td>7" (178)</td> <td>11" (279)</td> <td>7" (178)</td> </tr> <tr> <td>PRIVATE</td> <td>7" (178)</td> <td>11" (279)</td> <td>7" (178)</td> <td>11" (279)</td> <td>7" (178)</td> </tr> <tr> <td>PRIVATE</td> <td>7" (178)</td> <td>11" (279)</td> <td>7" (178)</td> <td>11" (279)</td> <td>7" (178)</td> </tr> <tr> <td>PRIVATE</td> <td>7" (178)</td> <td>11" (279)</td> <td>7" (178)</td> <td>11" (279)</td> <td>7" (178)</td> </tr> </tbody> </table> AVERAGE RUN OF TAPERED TREAD MEASURED AT A POINT 300mm FROM THE CENTERLINE OF INTERSECT. H.S. (9.8.3.3) OVER STAIRS TO GARAGE ROOM IS MEASURED VERTICALLY ACROSS WIDTH OF STAIRS FROM A STRAIGHT LINE TO THE TREAD & LANDING SHOWS TO LOWEST POINT ABOVE AND NOT LESS THAN 6'-9" (1960) FOR SINGLE DWELLING UNIT & 6'-8 3/4" (2050) FOR EVERYTHING ELSE. (9.2.3.2) REQUIRED LANDING IN GARAGE (9.8.2, 9.8.6.2/3) FOR AN EXTERIOR STAIR SERVING A GARAGE, W/ MORE THAN 3 RISERS. GARAGES, HANDRAILS & STEPS AS PER CONSTRUCTION HX NOTE 10 & 11.	PRIVATE	MIN. RISE	MIN. RUN	MAX. RISE	MIN. RUN	ALL STAIRS	PRIVATE	7" (178)	11" (279)	7" (178)	11" (279)	7" (178)	PRIVATE	7" (178)	11" (279)	7" (178)	11" (279)	7" (178)	PRIVATE	7" (178)	11" (279)	7" (178)	11" (279)	7" (178)	PRIVATE	7" (178)	11" (279)	7" (178)	11" (279)	7" (178)	26	MECHANICAL VENTILATION (9.32.1.3) MECHANICAL EXHAUST FAN, VENTED TO EXTERIOR, TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR. SEE GENERAL NOTE 2.3.
PRIVATE	MIN. RISE	MIN. RUN	MAX. RISE	MIN. RUN	ALL STAIRS																												
PRIVATE	7" (178)	11" (279)	7" (178)	11" (279)	7" (178)																												
PRIVATE	7" (178)	11" (279)	7" (178)	11" (279)	7" (178)																												
PRIVATE	7" (178)	11" (279)	7" (178)	11" (279)	7" (178)																												
PRIVATE	7" (178)	11" (279)	7" (178)	11" (279)	7" (178)																												
11	GUARDS/RAILINGS (9.8.7, 9.8.8) GUARDS TO BE DESIGNED NOT TO FACILITATE CLIMBING AND PROVIDING MAX. OPENING CONFORMING TO O.B.C., 9.8.7.5, & 9.8.8.6, AND BE ABLE TO RESIST LOADS AS PER TABLE 9.8.8.2 GUARD HEIGHTS - O.B.C. 9.8.8 INTERIOR GUARDS: 2'-11" (900) MIN. EXTERIOR GUARDS: 2'-11" (900) MIN. (LESS THAN 5'-11" (1800) TO GRADE) & 4'-0" (1070) MIN. (MORE THAN 5'-11" (1800) TO GRADE) GUARDS FOR EXIT STAIRS: 3'-0" (910) MIN. GUARDS FOR LANDINGS @ EXIT STAIRS: 3'-0" (910) MIN. GUARDS FOR FLOORS & RAMPS IN GARAGES (SERVICE STAIRS) FLOOR OR RAMP W/ EXTERIOR WALLS THAT IS 23 5/8" (600) OR MORE ABOVE FINISHED SURFACE REQUIRES CANT. CURB MIN. 6" (150) HIGH, AND GUARD MIN. 4'-0" (1070) HIGH REQUIRED GUARDS FROM WALKING SURFACE & ADJACENT SURFACE WITH A DIFFERENCE IN ELEVATION MORE THAN 23 5/8" (600) OR ADJACENT SURFACE WITHIN 3'-11" (1200) TO THE SURFACE WITH A SLOPE MORE THAN 1:12 SHALL BE PROTECTED WITH GUARDS PER CONSTRUCTION HX NOTE 11. HANDRAIL HEIGHTS - O.B.C. 9.8.7 - REQUIRED AS PER 9.8.7.1/3 MIN. HEIGHT AT STAIRS, RAMP AND LANDINGS: 2'-0" (600) MAX. HEIGHT AT STAIRS, RAMP AND LANDINGS: 3'-0" (910)	27	PARTY WALL BEARING (9.23.8) 12" (125x8) 3050x25x15.9" STEEL PLATE FOR STEEL BEAMS AND 12x12x12" (305x305x12) STEEL PLATE FOR WOOD BEAMS BEARING (MIN. 3'-2" (89) O.C. BLOCK PARTY WALL, ANCHORED WITH 24"x24" (2'-9" x 8" (200) LONG G. ANCHORS WITH MIN. SLD BLOCK COURSE. LEVEL W/ NON-SHRINK GROUT. (9.10.6/2.69) (9.10.6/2.69) CONC. FOOTING OR AS PROVIDED ON PLAN. REFER TO 2.4/2.4/2.4																														
12	SILL PLATES 2"x4" (38x89) MIN. PLATE WITH 1/2" (12.7) ANCHOR BOLTS 8" (200) LONG. EMBEDDED MIN. 4" (100) INTO CONC. @ 4'-0" (1220) O.C., CAULKING OR GASKET BETWEEN PLATE AND JOIST. USE NON-SHRINK GROUT. USE 1/2" (12.7) ANCHOR BOLTS SILL PLATE WHEN REQUIRED (9.23.7) BASEMENT INSULATION (9.15.2/1.73) PROVIDE CONTINUOUS BLANKET INSULATION W/ BUILT IN 6 mil POLYETHYLENE VAPOUR BARRIER, INSULATION TO EXTEND NO MORE THAN 2" (50) ABOVE FINISHED BASEMENT FLOOR, DAMPROOFED WITH BUILDING PAPER BETWEEN THE FOUNDATION WALL AND INSULATION UP TO GRADE (9.15.2.4)	28	WOOD FRAMING IN CONTACT TO CONCRETE WOOD BEARING WALLS, THE UNDERSIDE OF BUILT-UP WOOD POSTS AND SILL SHALL BE WRAPPED WITH 2 mil POLY. STEPPED FOOTINGS SUPPORTING THE FOUNDATION WALL SHALL BE WIDENED @ 1/2" (12.7) BELOW THE BEARING WALL AND/OR WOOD POST. (9.17.4/3)																														
13	BEARING STUD PARTITION IN BASEMENT (9.15.3.6, 9.23.10.1) 2"x4" (38x89) STUDS @ 16" (406) O.C. 2"x4" (38x89) SILL PLATE 2"x4" (38x140) AS REQUIRED (NO DAMPROOFING MATERIAL OR 2 mil POLYETHYLENE FILM, 1/2" (12.7) 2" ANCHOR BOLTS 8" (200) LONG, EMBEDDED 4" (100) MIN. INTO CONC. @ 7'-10" (2390) O.C. @ 1' (100) HIGH CONC. CURB ON CONC. FOOTING, FOR SIZE REFER TO 9.2.5.5. AND 9.2.5.6. AND 9.2.5.7. AT MID-HEIGHT IF WALL IS UNFINISHED.	29	CONC. PORCH SLAB (9.16.4) MIN. 4" (100) CONCRETE SLAB ON GRADE ON 4" (100) COARSE GRANULAR FILL, REINFORCED WITH 6x6w/2.5x2																														

TWO STOREY VOLUME SPACES			(9.23.10.1, 9.23.11, 9.23.16)							
39	WALL ASSEMBLY		WIND LOADS							
	EXTERIOR	STUDS	<= 0.5 kPa (350) SPACING MAX HEIGHT SPACING MAX HEIGHT							
	BRICK	2x26" (2-38x140) SPR.#2	12" (305) C	18'-4" (5588)	8" (200) C	18'-4" (5588)				
	SIDING	2x26" (2-38x140) SPR.#2	16" (406) C	18'-4" (5588)	12" (305) C	18'-4" (5588)				
	BRICK	2x26" (2-38x140) SPR.#2	12" (305) C	21'-0" (6400)	12" (305) C	21'-0" (6400)				
	SIDING	2x26" (2-38x140) SPR.#2	16" (406) C	21'-0" (6400)	16" (406) C	21'-0" (6400)				
	** STUD SIZE & SPACING TO BE VERIFIED BY STRUCTURAL ENGINEER **									
STUDS ARE TO BE CONTINUOUS. C/W 3/8" (9.5) THICK EXTERIOR PLYWOOD SHEATHING. PROVIDE SLOD WOOD BLOCKING BETWEEN WOOD STUDS @ 4' (1200) O.C. VERTICALLY.										
* FOR HORIZ. DISTANCES LESS THAN 9'-8" (2886) PROVIDE 2x6" (38x140) STUDS @ 16" (406) C, WITH CORN 2x26" (38x140) TOP PLATE + 1x26" (1x38x140) BOTTOM PLATE & MIN. OF 3-2x6" (38x184) CONT. HEADER AT GROUND FLOOR CEILING LEVEL TOE-NAILLED & GLUED AT TOP. BOTTOM PLATES & HEADERS.										
40	1 HR. PARTY WALL (CONC. BLOCK) (ISB-3) WALL TYPE #66f & 81uf									
	1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE (2x26" (38x140) VERTICAL WD. STRAPPING @ 24" (610) O.C. ON #1 (200) CONC. BLOCK-3/8" FLAT STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS, TAPE, FILL & SAND ALL GYPSUM JOINTS. EXPOSED BLOCK MUST BE SEALED W/ 2 COATS OF PAINT OR FURRED WITH 2x26" (38x140) WD. STRAPPING & 1/2" (12.7) GYPSUM SHEATHING.									
40	1 HR. PARTY WALL (DOUBLE STUD) (ISB-3) WALL TYPE W132f									
	5/8" (15.9) TYPE 'X' GYPSUM SHEATHING ON EACH SIDE OF 2 ROWS OF 2x26" (38x140) STRAPPING @ 16" (406) O.C. MIN. 1/2" (12.7) APART ON SEPARATE 2x4" (38x89) SLT PLATES. (2x6" (38x140) AS REQUIRED) FILL ONE SIDE OF STUD CAVITY WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS, TAPE, FILL AND SAND ALL GYPSUM JOINTS.									
40A	2 HR. FIREWALL (ISB-3) WALL TYPE #66f & 81uf									
	1/2" (12.7) GYPSUM SHEATHING ON EACH SIDE ON 2x26" (38x140) VERTICAL WOOD STRAPPING @ 24" (610) O.C. ON #1 (200) CONC. BLOCK 75% SOLID. FILL STRAPPING CAVITY EACH SIDE WITH AT LEAST 90% OF ABSORPTIVE MATERIAL PROCESSED FROM ROCK, SLAG OR GLASS, TAPE, FILL & SAND ALL GYPSUM JOINTS. AT UNFINISHED AREAS, EXTERIOR FACE OF CONC. BLOCK TO BE SEALED WITH 2 COATS OF PAINT. GYPSUM SHEATHING TO BE ATTACHED TO CONC. BLOCK. (REFER TO DETAILS)									
41	STUCCO WALL CONSTRUCTION (2x6")									
	STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURER'S SPECIFICATIONS OVER 1/2" (38) E.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENGSLASS GOLD GYPSUM BOARD ON STUDS CONFORMING TO O.B.C. (9.23.10.1, & SECTION 1.1, INSULATION APPROVED 6 MIL. POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED)									
41A	STUCCO WALL CONSTRUCTION (2x6") W/ 2x12 IN. INSUL.									
	STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURER'S SPECIFICATIONS OVER 1/2" (38) E.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON APPROVED AIRWATER BARRIER AS PER O.B.C. MATS. ON EXTERIOR TYPE ROD INSULATION JOINTS UNTAPED MECHANICALLY FASTENED AS PER MANUFACTURER'S SPECIFICATIONS, ON 7/16" EXTERIOR TYPE SHEATHING ON STUDS CONFORMING TO O.B.C. (9.23.10.1, & SECTION 1.1, INSULATION APPROVED 6 MIL. POLYETHYLENE VAPOUR BARRIER, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED)									
41B	STUCCO WALL & GARAGE CONCT.									
	STUCCO FINISH CONFORMING TO O.B.C. SECTION 9.28, AND APPLIED PER MANUFACTURER'S SPECIFICATIONS OVER 1/2" (38) E.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENGSLASS GOLD GYPSUM BRD. ON STUDS CONFORMING TO O.B.C. (9.23.10.1, & SECTION 1.1, 1/2" (12.7) GYPSUM WALLBOARD INT. FINISH. (REFER TO 35 NOTE AS REQUIRED) *** FOR DWELLINGS USE CONCT. INSULATION CONSTRUCTION. PROVIDE APPROVED DRAINAGE MAT ON 7/16" (11) EXTERIOR TYPE SHEATHING OVER FURRING (AS REQ) AND STUDS IN LIEU OF 1/2" (38) E.F.S. (MINIMUM) ON APPROVED DRAINAGE MAT ON 1/2" (12.7) DENGSLASS GOLD GYPSUM BRD.									
42	UNSUPPORTED FOUNDATION WALLS (R.15.4.2)									
	REINFORCING AT STAIRS AND SUNKEN FLOOR AREAS: - 2:20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING) - 3:20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING) - 4:20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING) - BARS LAPPED VERTICALLY AT INTERIOR FACE OF WALL @ 6" O.C. REINFORCING AT BASEMENT WINDOWS: - 2:15M HORIZ. REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL BELOW THE WIN. SLIT, EXTEND BARS 2' (610) BEYOND THE OPENING, 2:15M VERTICAL REINFORCING ON THE INSIDE AND OUTSIDE FACE OF THE FOUNDATION WALL BELOW THE WIN. SLIT, EXTEND BARS 2' OF THE WINDOW OPENING. - BARS TO HAVE MIN. 1" (25) CONC. COVER - BARS TO EXTEND 2'-0" (610) BEYOND BOTH SIDES OF OPENING									
43	STUD WALL REINFORCEMENT									
	PROVIDE STUD WALL REINFORCEMENT IN MAIN BATHROOM CONFORMING TO O.B.C. (9.52.3.1) (REFER TO DETAILS)									
44	WINDOW WELLS									
	WHERE A WINDOW OPENS INTO A WINDOW WELL, A CLEARANCE OF NOT LESS THAN 21 5/8" (560) SHALL BE PROVIDED IN FRONT OF THE WINDOW. EVERY WINDOW WELL MUST BE DRAINED TO THE FOOTING LEVEL, OR OTHER SUITABLE LOCATION WITH A #1 (100) WEEFING TILE, C/W A FILTER CLOTH WRAP AND FILLED WITH CRUSHED STONE, 9.10.1.(5), 9.14.6.3) ON DRAINAGE MAT.									
45	SLOPED CEILING CONSTRUCTION									

SECTION 1.1. WALL STUDS						
* REFER TO THIS CHART FOR STUD SIZE & SPACING AS REQUIRED FOR EXTERIOR WALLS ONLY. REFER TO SITING & GRADING PLAN OF THIS UNIT FOR CONFORMATION OF FOOT OF FOUNDATION WALL AND ADDITIONAL INFORMATION. * IF STUD WALL HEIGHT EXCEEDS MAX. UNSUPPORTED HEIGHT, WALL NEEDS TO BE REINFORCED AND APPROVED BY ENGINEER.						
SIZE & SPACING OF STUDS: (OBC REFERENCE - TABLE 9.23.10.1.)						
MIN. STUD SIZE: (in mm)	SUPPORTED LENGTH					
	ROOF w/ OR w/o ATTIC	ROOF w/ OR w/o ATTIC & 1 FLOOR/ATTC & 2 FLOOR/ATTC & 3 FLOOR/ATTC	ROOF w/ OR w/o ATTIC & 1 FLOOR/ATTC & 2 FLOOR/ATTC & 3 FLOOR/ATTC	ROOF w/ OR w/o ATTIC & 1 FLOOR/ATTC & 2 FLOOR/ATTC & 3 FLOOR/ATTC	ROOF w/ OR w/o ATTIC & 1 FLOOR/ATTC & 2 FLOOR/ATTC & 3 FLOOR/ATTC	ROOF w/ OR w/o ATTIC & 1 FLOOR/ATTC & 2 FLOOR/ATTC & 3 FLOOR/ATTC
	MAX. STUD SPACING, IN (mm) O.C.					
	MAX. UNSUPPORTED HGT., R-ft (m)					
2"x4"	24" (610)	16" (405)	12" (305)			
3"x8(9)	9'-10" (3.0)	9'-10" (3.0)	9'-10" (3.0)			N/A
2"x6"	-	24" (610)	16" (406)	12" (305)		
3"x10(4)	-	9'-10" (3.0)	11'-10" (3.6)	5'-11" (1.8)		

SECTION 2.0. GENERAL NOTES										
2.1. WINDOWS										
1) EXCEPT WHERE A DOOR ON THE SAME FLOOR LEVEL AS THE BEDROOM PROVIDES DIRECT ACCESS TO THE EXTERIOR, EVERY FLOOR LEVEL CONTAINING A BEDROOM IS TO HAVE AT LEAST ONE OUTSIDE WINDOW W/ MIN. 0.35%2 UNOBSTRUCTED OPEN PORTION W/ NO DIMENSION LESS THAN 1'-3" (380). CAPABLE OF MAINTAINING THE OPENING AREA TO BE USED FOR ADDITIONAL SUPPORT, CONFORMING TO 9.3.9.10. 2) WINDOW GUARDS: A GUARD OR A WINDOW WITH A MAXIMUM RESTRICTED OPENING WIDTH OF 4" (100) IS REQUIRED WHERE THE TOP OF THE WINDOW SILL IS LOCATED LESS THAN 1'-7" (480) ABOVE FIN. FLOOR AND THE DISTANCE FROM THE FINISHED FLOOR TO THE ADJACENT GRADE IS GREATER THAN 5'-11" (1800). (9.3.8.1, 9.3.9.10) IN CASE OF EXT. STAIRWAYS THAT EXTEND TO LESS THAN 2'-11" (800) (9.3.9.10) FOR ALL OTHER BUILDINGS SHALL BE PROTECTED BY GUARDS IN ACCORDANCE WITH NOTE #2 (ABOVE), OR THE WINDOW SHALL BE NON-OPERABLE AND DESIGNED TO WITHSTAND THE SPECIFIED LOADS FOR BALCONY GUARDS AS PROVIDED IN 4.1.5.1.9.3.9.8.2. 4) REFER TO TITLE PAGE FOR MAX. U-VALUE REQUIREMENTS										
2.2. CEILING HEIGHTS										
THE CEILING HEIGHTS OF ROOMS AND SPACES SHALL CONFORM TO TABLE 9.5.3.1.										
ROOM OR SPACE			MINIMUM HEIGHTS							
BEDROOM			7'-7" OVER 75% OF REQUIRED FLOOR AREA WITH A CLEAR HEIGHT OF 6'-11" AT ANY POINT							
BASEMENT			6'-11" OVER 50% OF REQUIRED FLOOR AREA OR 6'-11" OVER ALL OF THE REQUIRED FLOOR AREA							
BATHROOM, LAUNDRY AREA ABOVE GARAGE			6'-11" OVER AT LEAST 75% OF THE BASEMENT AREA. EXCEPT THAT UNDER BEAMS AND JOISTS THE CLEARANCE IS PERMITTED TO BE REDUCED TO 6'-5".							
FINISHED ROOM NOT MENTIONED ABOVE			6'-11"							
MEZZANINES			6'-11" ABOVE & BELOW FLOOR ASSEMBLY (9.5.3.2)							
STORAGE GARAGE			6'-7" (9.5.3.3)							
2.3. MECHANICAL / PLUMBING										
1) MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 7.0 AIR CHANGE PER HOUR IF NOT AIR CONDITIONED 1 PER HOUR FOR AIR CONDITIONED AREAS. OVER 24 HOURS WHEN A VENTILATION FAN (PRINCIPAL EXHAUST) IS REQUIRED, CONFORM TO 9.5.3.2.1.1. REFER TO MECHANICAL DRAWINGS. 2) REFER TO HOT WATER TANK MANUFACTURER SPECS. CONFORM TO OBC 9.3.1.6. 3) REFER TO TITLE PAGE FOR SPACE HEATING EQUIPMENT, HRV AND DOMESTIC HOT WATER HEATER MINIMUM EFFICIENCIES. 4) DRAIN WATER HEAT RECOVERY UNIT(S) WILL BE INSTALLED CONFORMING TO THE REQUIREMENTS OF 9.5.12.1.1.1.2. OF THE O.B.C.										
2.4. LUMBER										
1) LUMBER SHALL BE SPRUCE No.2 GRADE OR BETTER, UNLESS NOTED OTHERWISE. 2) STUDS SHALL BE STUD GRADE SPRUCE, UNLESS NOTED OTHERWISE. 3) LUMBER EXPOSED TO THE EXTERIOR TO BE SPRUCE No. 2 GRADE PRESSURE TREATED OR CEDAR, UNLESS NOTED OTHERWISE. 4) ALL LAMINATED VENEER LUMBER (LVL) BEAMS, GIRDER TRUSSES, AND METAL BRACING CONNECTIONS SUPPORTING ROOF FRAMING TO BE DESIGNED & CERTIFIED BY FLOOR AND ROOF TRUSS MANUFACTURER. 5) JOIST HANGERS: PROVIDE APPROVED METAL HANGERS FOR ALL JOISTS AND BUILT-UP WOOD MEMBERS INTERSECTING WITH FLUSH BUILT-UP WOOD MEMBERS. 6) WOOD FRAMING NOT TREATED WITH A WOOD PRESERVATIVE. IN CONTACT WITH CONCRETE, SHALL BE SEPARATED FROM THE CONC. BY AT LEAST 2" POLYETHYLENE FILM OR 2" RIGID ROOF OR FLOOR OTHER DAMPPROOFING MATERIAL, EXCEPT WHERE THE WOOD MEMBER IS AT LEAST 6" (152) ABOVE THE GROUND.										
2.5. STEEL (9.23.4.3.)										
1) STRUCTURAL STEEL SHALL CONFORM TO CAN/CSA-G40.21 GRADE 350W. HOLLOW STRUCT. SECTIONS SHALL CONFORM TO CAN/CSA-G40.21 GRADE 350W CLASS "H". 2) REINFORCING STEEL SHALL CONFORM TO CSA-G30.6M GRADE 400R.										
2.6. FLAT ARCHES										
1) FOR 9'-0" (2740) CEILINGS, FLAT ARCHES SHALL BE 16'-0" (2080) A.F.F. 2) FOR 9'-4" (2740) CEILINGS, FLAT ARCHES SHALL BE 7'-0" (2080) A.F.F. 3) FOR 10'-0" (3040) CEILINGS, FLAT ARCHES SHALL BE 8'-16" (2600) A.F.F.										
2.7. ROOF OVERHANGS										
1) ALL ROOF OVERHANGS SHALL BE 1'-0" (305), UNLESS NOTED OTHERWISE.										

3.3. DOOR SCHEDULE					
CONFORMING TO SECTIONS 9.5.11, 9.6, 9.7.2.1, 9.7.5.2, & 9.10.13.10					
1	EXTERIOR	2-8" x 6-8" x 1-3/4" (815 x 2030 x 45) INSULATED MIN. R4 (RSI 0.7)			
1A	EXTERIOR	2-10" x 6-8" x 1-3/4" (865 x 2030 x 45) INSULATED MIN. R4 (RSI 0.7)			
1B	EXTERIOR	3-0" x 6-8" x 1-3/4" (915 x 2030 x 45) INSULATED MIN. R4 (RSI 0.7)			
1C	EXTERIOR	2-6" x 6-8" x 1-3/4" (760 x 2030 x 45) INSULATED MIN. R4 (RSI 0.7)			
1D	EXTERIOR	2-8" x 6-8" x 1-3/4" (815 x 2030 x 45) INS. MIN. R4 (RSI 0.7) (SEE HEX NOTE 20)			
1E	EXTERIOR	3-0" x 8-0" x 1-3/4" (915 x 2440 x 45) INSULATED MIN. R4 (RSI 0.7)			
1F	EXTERIOR	2-8" x 8-0" x 1-3/4" (815 x 2440 x 45) 2 MIN. F.R. DOORFRAME WITH APP. SELF CLOSING DEVICE.			
2	INTERIOR	2-6" x 6-8" x 1-3/8" (815 x 2030 x 35)			
3	INTERIOR	2-6" x 6-8" x 1-3/8" (760 x 2030 x 35)			
3A	INTERIOR	2-4" x 6-8" x 1-3/8" (710 x 2030 x 35)			
4	INTERIOR	2-0" x 6-8" x 1-3/8" (610 x 2030 x 35)			
4A	INTERIOR	2-2" x 6-8" x 1-3/8" (660 x 2030 x 35)			
5	INTERIOR	1-6" x 6-8" x 1-3/8" (460 x 2030 x 35)			
PROVIDE 8-0" HIGH INTERIOR DOORS FOR ALL TO CEILING CONDITIONS					
3.4. ACRONYMS					
AFF	ABOVE FINISHED FLOOR	JST	JOIST		
BFGM	BEAM BY FLOOR MANUFACTURER	LIN	LINEN CLOSET		
BF	FIXED GLASS W/ BLACK BACKING	LVL	LAMINATED VENEER LUMBER		
BM	BEAM	OTBA	OPEN TO BELOW/ABOVE		
BMRM	BEAM BY ROOF MANUFACTURER	PL	POINT LOAD		
CBF	CONVENTIONAL ROOF FRAMING	PLT	PLATE		
CW	COMPLETE WITH	PT	PRESSURE TREATED		
D/J/T/J	DOUBLE JOIST/ TRIPLE JOIST	PTD	PAINTED		
DO	DO OVER	PWD	POWER WOOD		
DHP	DROPPED	RWL	RAIN WATER LEADER		
ENG	ENGINEERED	SB	SOLID BEARING WOOD POST		
EST	ESTIMATED	SBFA	SB FROM ABOVE		
FA	FLAT ARCH	SJ	SINGLE JOIST		
FD	FLOOR DRAIN	SPR	SPRUCE		
FG	FIXED GLASS	STL	STEEL		
FL	FLUSH	T/O	TOP OF		
FLR	FLOOR	TYP	TYPICAL		
GT	GIRDER TRUSS	US	UNDERSIDE		
HB	HOSE BIB	WD	WOOD		
HRV	HEAT RETURN VENTILATION UNIT	WIC	WALK IN CLOSET		
HWT	HOT WATER TANK	WVP	WEATHER PROOF		
3.5. SYMBOLS					
ALL ELECTRICAL FIXTURES SHALL BE INSTALLED IN ACCORDANCE WITH SECTION 9.34.					
	CLASS B VENT		EXHAUST VENT		
	DUPLEX OUTLET (12" HIGH)		DUPLEX OUTLET (HEIGHT AS NOTED A.F.F.)		
	HEAVY DUTY OUTLET		SWITCH (2/3/4 WAY)		
	POT LIGHT		LIGHT FIXTURE (CEILING MOUNTED)		
	LIGHT FIXTURE (PULL CHAIN)		LIGHT FIXTURE (WALL MOUNTED)		
	CABLE T.V. JACK		TELEPHONE JACK		
	CENTRAL VACUUM OUTLET		CHANDELIER (CEILING MOUNTED)		
■ SA SMOKE ALARM (9.10.19)					
PROVIDE ONE PER FLOOR, NEAR THE STAIRS CONNECTING THE FLOOR LEVEL. ALARMS ARE TO BE INSTALLED IN EACH SLEEPING ROOM AND IN A LOCATION BETWEEN SLEEPING ROOMS AND CONNECTING HALLWAYS AND WIRED TO BE INTERCONNECTED TO ACTIVATE ALL ALARMS IF ONE SOUNDS. ALARMS ARE TO BE CONNECTED TO AN ELECTRICAL CIRCUIT AND WITH A BATTERY BACKUP. ALARM SIGNAL SHALL MEET TEMPORAL SOUND PATTERNS MIN. ALARMS SHALL HAVE A VISUAL SIGNALING COMPONENT AS PER THE "NATIONAL FIRE ALARM AND SIGNALING CODE 72".					
◆ CMO CARBON MONOXIDE ALARM (9.33.4)					
** CHECK LOCAL BY-LAWS FOR REQUIREMENTS ** A CARBON MONOXIDE ALARMS CONFORMING TO CAN/CGA-6.19 SHALL BE INSTALLED ON OR NEAR THE CEILING IN EACH DWELLING UNIT ADJACENT TO EACH SLEEPING AREA. CARBON MONOXIDE ALARMS SHALL BE PERMANENTLY WIRED WITH NO DISCONNECT SWITCH, WITH AN ALARM THAT IS AUDIBLE WITHIN SLEEPING ROOMS WHEN THE INTERVENING DOORS ARE CLOSED.					
☒ SB SOLID BEARING (BUILT-UP WOOD COLUMNS AND STUD POSTS)					
THE WIDTH OF A WOOD COLUMN SHALL NOT BE LESS THAN THE WIDTH OF SUPPORTED MEMBER. BUILT-UP WOOD COLUMNS SHALL BE NAILED TOGETHER WITH NOT LESS THAN 3" (76) NAILS SPACED NOT MORE THAN 11 3/4" (300) O.C. THE NUMBER OF STUDS IN A WALL DIRECTLY BELOW A GIRDER TRUSS OR ROOF BEAM SHALL CONFORM TO TABLE A-34 TO A-37. (9.17.4, 9.23.10.7.)					
	TWO STOREY VOLUME SPACE. SEE CONSTRUCTION NOTE 39.				
	VARYING PLATES, BUILT-OUT FLOORS, BEARING WALLS, ICE & WATER SHIELD				
	EXPOSED BUILDING FACE - O.B.C. 9.10.14, 9.10.15, REFER TO HEX NOTE 35, & DETAILS FOR TYPE AND SPECIFICATIONS.				
	1 HR. PARTY WALL REFER TO HEX NOTE 40.		2 HR. FIREWALL REFER TO HEX NOTE 40A.		
SECTION 4.0. CLIMATIC DATA					
DESIGN SNOW LOAD (9.4.2.2.):		1.01 kPa			
WIND PRESSURE (q50) (SB-1.2.):		0.44 kPa			
STAMP					
CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB. REPORT ANY DISCREPANCIES TO HUNT DESIGN ASSOCIATES INC. (H.D.A.) BEFORE PROCEEDING WITH THE WORK. ALL THE DRAWINGS & SPECIFICATIONS ARE THE INSTRUMENTS OF SERVICE AND ARE THE PROPERTY OF H.D.A. ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPECIFICATIONS AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE AGENS MINIMUM SPECIFICATIONS. ONT. REG. 32972					
CONSTRUCTION NOTE REVISION DATE: DECEMBER 15, 2021					

3.1. WOOD LINTELS AND BUILT-UP WOOD (DIVISION B PART 9, TABLES A8 TO A10 AND A12, A15 & A16) FORMING PART OF SENTENCE 9.2.3.2.4(3), 9.2.3.2.4(4), 9.2.3.12.3.1(1), 9.2.3.13.3(2), 9.3.7.3.1(1)						
	2"x6" SPRUCE #2		2"x10" SPRUCE #2		2"x12" SPRUCE #2	
L1	2"x6" (2/3x184)	L3	2"x10" (2/3x235)	L5	2"x12" (2/3x286)	
B1	3"x6" (3/3x184)	B3	3"x10" (3/3x235)	B5	3"x12" (3/3x286)	
B2	4"x6" (4/3x184)	B4	4"x10" (4/3x235)	B6	4"x12" (4/3x286)	
B7	5"x6" (5/3x184)	B8	5"x10" (5/3x235)	B9	5"x12" (5/3x286)	
ENGINEERED LUMBER SCHEDULE - GRADE 2.0E (UNLESS NOTE OTHERWISE)						
	1 3/4" x 9 1/2" LVL		1 3/4" x 11 7/8" LVL		1 3/4" x 14" LVL	
LVL2	1-1 3/4"x9 1/2" LVL	LVL3	1-1 3/4"x11 7/8" LVL	LVL10	1-1 3/4"x14" LVL	
LVL1	2-1 3/4"x9 1/2" LVL	LVL4	2-1 3/4"x11 7/8" LVL	LVL11	2-1 3/4"x14" LVL	
LVL5	3-1 3/4"x9 1/2" LVL	LVL7	3-1 3/4"x11 7/8" LVL	LVL12	3-1 3/4"x14" LVL	
LVL8	4-1 3/4"x9 1/2" LVL	LVL9	4-1 3/4"x11 7/8" LVL	LVL13	4-1 3/4"x14" LVL	
3.2. STEEL LINTELS SUPPORTING MASSORY VENEER (DIVISION B PART 9, TABLE 9.20.5.2.B.) FORMING PART OF SENTENCE 9.2.0.5.2(2) & 9.2.0.5.2(3)						
CODE	SIZE		BRICK		STONE	
L7	3 1/2" x 3 1/2" x 1/4" (89 x 89 x 6.4)		8-1" (2.47m)		7-6" (2.30m)	
L8	4 x 3 1/2" x 1/4" (102 x 89 x 6.4)		8-9" (2.66m)		8-1" (2.47m)	
L9	4 7/8" x 3 1/2" x 5/16" (127 x 89 x 7.9)		10-10" (3.31m)		10-1" (3.03m)	
L10	4 7/8" x 3 1/2" x 3/8" (127 x 89 x 11)		11-5" (3.48m)		10-7" (3.24m)	
L11	5 7/8" x 3 1/2" x 3/8" (152 x 89 x 11)		12-6" (3.82m)		11-7" (3.54m)	

SECTION 4.0: CLIMATE DATA	
DESIGN SNOW LOAD (9.4.2.2.):	1.01 kPa
WIND PRESSURE (q50) (SB-1.2.):	0.44 kPa
STAMP	
CONTRACTOR MUST VERIFY ALL DIMENSIONS ON THE JOB, REPORT ANY DISCREPANCIES TO HUNT DESIGN ASSOCIATES INC. (H.D.A.I.) BEFORE PROCEEDING WITH THE WORK. ALL THE DRAWINGS & SPECIFICATIONS ARE THE INSTRUMENTS OF SERVICE AND ARE THE PROPERTY OF H.D.A.I. ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPECIFICATIONS AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS, ONT. REG. 332/12 CONSTRUCTION NOTE REVISION DATE: DECEMBER 15, 2021	

5011-COR-UPG-TIMBERLAND
REV.2022.08.18