


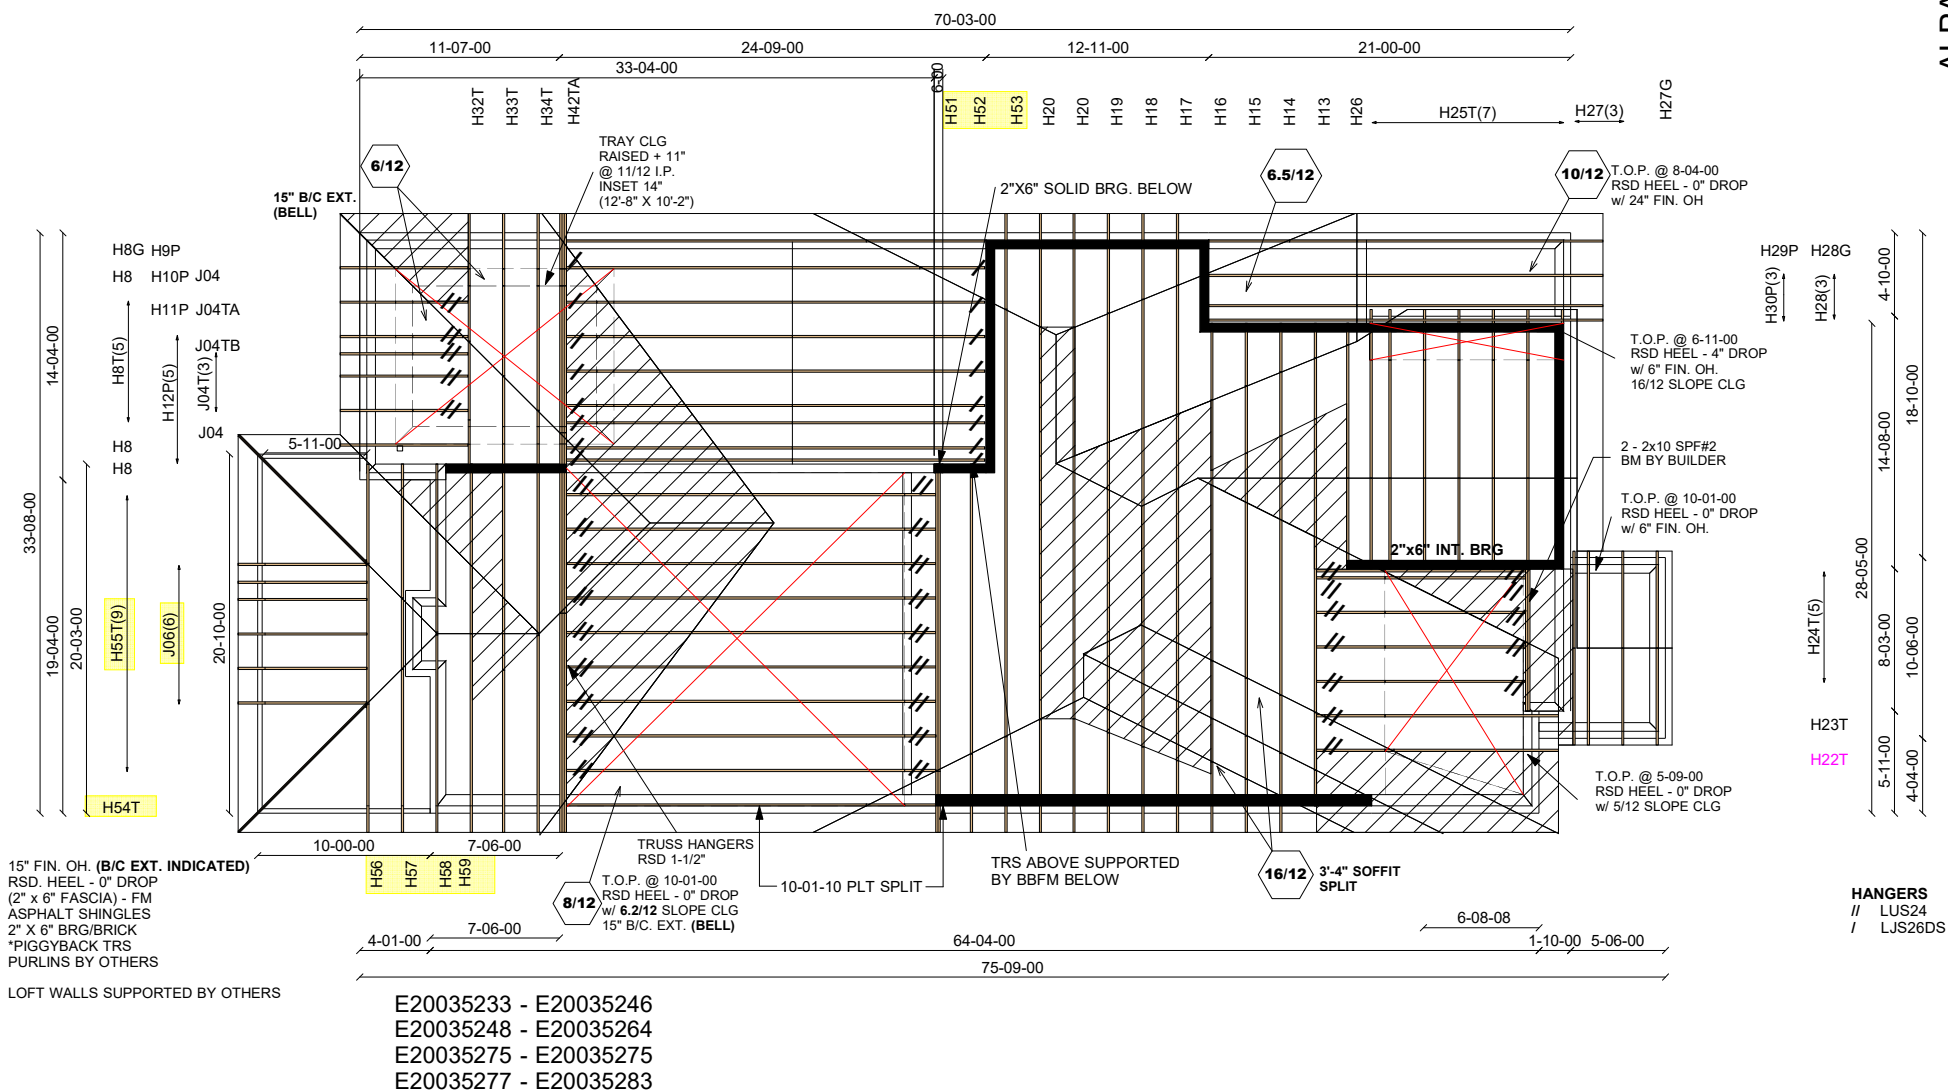

E22052770 - E22052779

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 O.B.C. LATEST EDITION. ROOF RAFTERS THAT CROSS OVER TRUSSES TO BE 2X4 SPF #2 @ 24" O.C WITH A VERT. POST TO THE TRUSS UNDERNEATH AT EACH CROSS POINT. VERT. POSTS LONGER THAN 6' TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN END POINTS & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'

Mitek V. 8.2.0

CONVENTIONAL
FRAMING BY
OTHERS



Job Track: **45147**
Layout ID: **343172**
Plan Log: **116406**

Builder / Location:
GOLD PARK HOMES / VAUGHAN

Model / Elevation: **"MAPLEWOOD"**
4201 REV3 / A LOGGIA W/TRAY

Project: **PINE VALLEY PH 2**

Date: 2022-04-04 Designer: AMANDA REF: 318403

THESE DRAWINGS CONSTITUTE THE PROPERTY OF ALPA ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY ALPA ROOF TRUSSES INC AND WILL BE RETRACTED BY ALPA ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

EWP DESIGN INC.

(905) 832-2250

FAX (905) 832-0286

RESPONSIBILITIES AND SPECIFICATIONS

RESPONSIBILITIES


1. EWP DESIGN INC. is responsible for the design of trusses as individual components.
2. It is the responsibility of others to ascertain that the design loads utilized on each drawing meet or exceed the actual dead load imposed by the structure, the live load imposed by the intended use and the snow load imposed by local building code or authorities with jurisdictions.
3. All dimensions are to be verified by the owner, contractor, architect or other authorities with jurisdictions before truss fabrication.
4. EWP DESIGN INC. bears no responsibility for the erection of trusses. Persons erecting trusses are cautioned to seek professional advice regarding the temporary and permanent bracing for the system. Bracing shown on EWP DESIGN INC. drawing is specified for the truss as a component only and forms an integral part of the truss design.
5. It is the truss manufacturer's responsibility to ensure that trusses are manufactured in conformance with specifications of EWP DESIGN INC. as outlined below.

SPECIFICATIONS


1. Trusses designed by EWP DESIGN INC. conform to the relevant section of the Ontario Building Code of Canada (Part 9 or Part 4) or to the Canadian code for farm buildings, whichever applies to the building type, as indicated on the EWP DESIGN INC. drawings, and conform to the design procedures established by the Truss Plate Institute of Canada. Unit stresses used for truss designs are as per the edition of CSA-O86 shown on EWP DESIGN INC. drawings.
2. Lumber is to be the size, species and grade as specified on EWP DESIGN INC. drawings.
3. Moisture content of lumber shall not exceed 19% in service unless specified otherwise.
4. Metal connector plates shall be applied to both faces of truss at each joint and shall be positioned as specified.
5. Top chords of trusses are assumed to be continuously braced laterally by roof sheathing or by purlins at intervals not exceeding 12.5 times the thickness of top chord member.
6. Bottom chords shall be laterally braced at intervals not exceeding 3M (10') o.c., where rigid ceiling is not applied directly to the underside of chords.

THESE DRAWINGS CONSTITUTE THE PROPERTY OF EWP DESIGN INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY THE ALPA LUMBER GROUP, AND WILL BE RETRACTED BY EWP DESIGN INC. IF UTILIZED FOR ANY OTHER PURPOSE.

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:57:57 2020 Page 1



JSI GRIP= 0.90 (G) (INPUT = 0.90)
JSI METAL= 0.40 (J) (INPUT = 1.00)

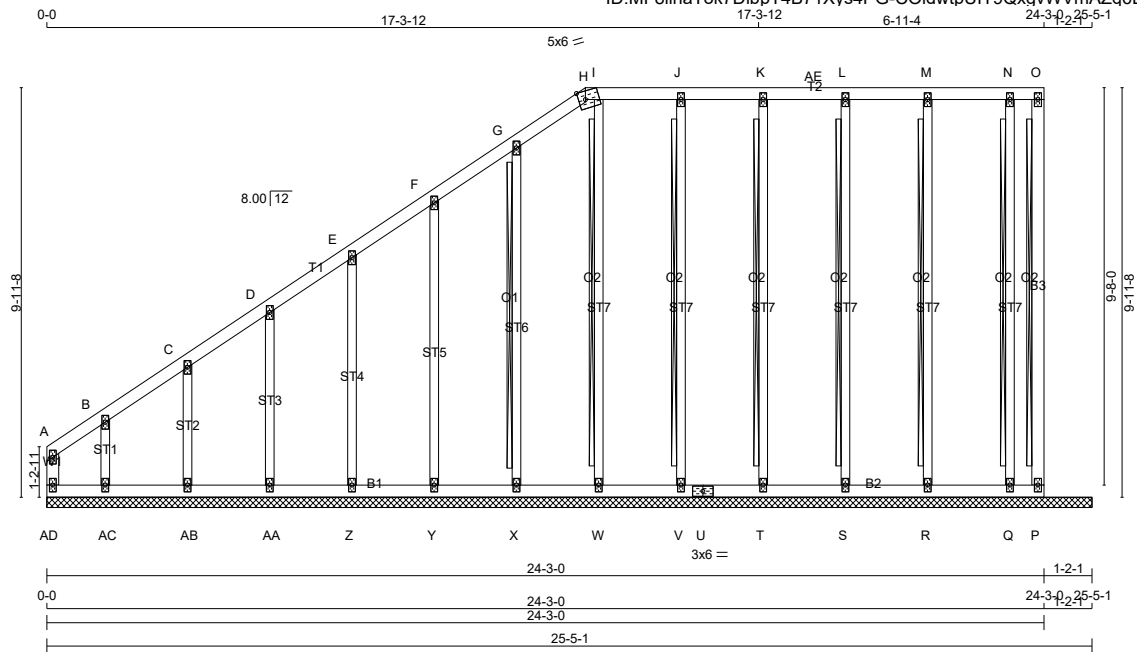

TOTAL WEIGHT = 140 lb

LUMBER				
N. L. G. A. RULES				
CHORDS		SIZE	LUMBER	DESCR
AD-	A	2x4	DRY	No.2
A -	H	2x4	DRY	No.2
H -	O	2x4	DRY	No.2
AD-	U	2x4	DRY	No.2
U -	P	2x4	DRY	No.2
P -	O	2x4	DRY	No.2
ALL WEBS EXCEPT		2x3	DRY	No.2
ALL GABLE WEBS		2x3	DRY	No.2
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2-0-0 OC.				

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	2.0	4.0		
B, C, D, E, F, G, J, K, L, M, N						
B	TMW+w	MT20	2.0	4.0		
H						
H	TTW-m	MT20	5.0	6.0	Edge	2.00
I						
O	TMV+p	MT20	2.0	4.0		
P	BMV1+p	MT20	2.0	4.0		
Q, R, S, T, V, W, X, Y, Z, AA, AB, AC						
Q	BMV1+w	MT20	2.0	4.0		
U	BS-t	MT20	3.0	6.0		
AD	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

LATERAL BRACE(S) SHOWN SHALL BE
2X4 SPF#2



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

FOR SECTION H-O, MAX. PURLIN SPACING = 2.00 FT.

FOR OTHER SECTIONS, TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED

2x4 DRY SPF No.2 T-BRACE AT O-P, N-Q, M-R, L-S, K-T, J-V, I-W, G-X

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
AD-A	-58 / 0	0.0	0.01 (1)	7.81	Q-N	-111 / 0	0.09 (1)
A-B	-19 / 0	-78.0	-78.0 0.03 (1)	6.25	R-M	-182 / 0	0.14 (1)
B-C	-14 / 0	-78.0	-78.0 0.04 (1)	6.25	S-L	-170 / 0	0.13 (1)
C-D	-11 / 0	-78.0	-78.0 0.04 (1)	6.25	T-K	-171 / 0	0.13 (1)
D-E	-7 / 0	-78.0	-78.0 0.04 (1)	10.00	V-J	-171 / 0	0.13 (1)
E-F	-5 / 0	-78.0	-78.0 0.04 (1)	10.00	W-I	-169 / 0	0.13 (1)
F-G	-2 / 0	-78.0	-78.0 0.04 (1)	10.00	X-G	-158 / 0	0.09 (1)
G-H	-8 / 0	-78.0	-78.0 0.04 (1)	10.00	Y-F	-154 / 0	0.16 (1)
H-I	0 / 2	-85.5	-85.5 0.04 (1)	2.00	Z-E	-155 / 0	0.09 (1)
I-J	0 / 0	-85.5	-85.5 0.04 (1)	2.00	AA-D	-153 / 0	0.05 (1)
J-K	0 / 0	-85.5	-85.5 0.04 (1)	2.00	AB-C	-158 / 0	0.03 (1)
K-AE	0 / 0	-85.5	-85.5 0.04 (1)	2.00	AC-B	-130 / 0	0.02 (1)
AE-L	0 / 0	-85.5	-85.5 0.04 (1)	2.00			
L-M	0 / 0	-85.5	-85.5 0.04 (1)	2.00			
M-N	0 / 0	-85.5	-85.5 0.04 (1)	2.00			
N-O	0 / 0	-85.5	-85.5 0.01 (1)	2.00			
AD-AC	0 / 19	-18.5	-18.5 0.01 (4)	10.00			
AC-AB	0 / 13	-18.5	-18.5 0.02 (4)	10.00			
AB-AA	0 / 9	-18.5	-18.5 0.02 (4)	10.00			
AA-Z	0 / 6	-18.5	-18.5 0.01 (4)	10.00			
Z-Y	0 / 4	-18.5	-18.5 0.01 (4)	10.00			
Y-X	0 / 2	-18.5	-18.5 0.01 (4)	10.00			
X-W	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
W-V	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
V-U	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
U-T	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
T-S	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
S-R	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
R-Q	0 / 0	-18.5	-18.5 0.02 (4)	10.00			
Q-P	0 / 0	-18.5	-18.5 0.01 (4)	10.00			
P-O	-22 / 0	0.0	0.01 (1)	7.81			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	21.0	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD			=	34.4	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON
PIGGYBACK TRUSS WITH SLOPES OF 6.00/12
AND -6.00/12 AND RESPECTIVE WALL HEIGHTS
OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD
LOAD OF 3.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF PART
9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.04/1.00 (L-M:1), BC=0.02/1.00
(AB-AC:4), WB=0.16/1.00 (F-Y:1), SSI=0.07/1.00
(M-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PLI)		(PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	650	371	1747	788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.38 (F) (INPUT = 0.90)
JSI METAL= 0.08 (G) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H9P		1	TRUSS DESC. JT 45147	E20035235


Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:57:59 2020 Page 1

ID:MF8iiriaTok7DIbpT4B71Xys4PG-gaG?8Dq63mHHZqUi2UhoMJmbs1ZqsShR?sKzGKzXk\$0c

17-3-1217-5-12-0-019-5-12-0-021-5-12-0-023-5-19-1524-3-01-2-125-5-1

Scale = 1:20.4

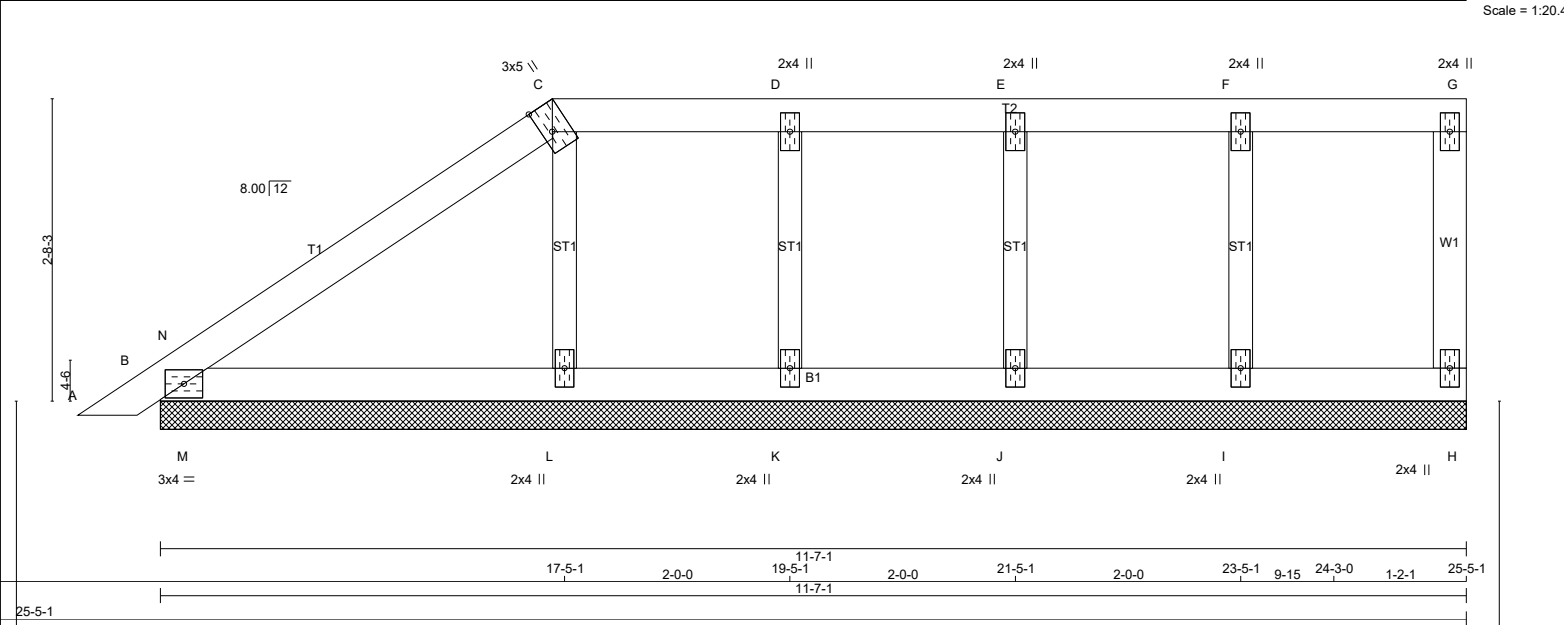

25-5-1


TOTAL WEIGHT = 37 lb

[M]

LUMBER										DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA									
N. L. G. A. RULES										BEARINGS										SPECIFIED LOADS:									
CHORDS SIZE LUMBER DESCR.										THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.										TOP CH. LL = 21.0 PSF									
A - C 2x4 DRY No.2 SPF										THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.										DL = 6.0 PSF									
C - G 2x4 DRY No.2 SPF										BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)										BOT CH. LL = 0.0 PSF									
H - G 2x4 DRY No.2 SPF										BRACING										DL = 7.4 PSF									
B - H 2x4 DRY No.2 SPF										TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.										TOTAL LOAD = 34.4 PSF									
ALL WEBS 2x3 DRY No.2 SPF										MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.										SPACING = 24.0 IN. C/C									
ALL GABLE WEBS 2x3 DRY No.2 SPF										ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.										LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM									
DRY: SEASONED LUMBER.										LOADING										THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015									
GABLE STUDS SPACED AT 2-0-0 OC.										TOTAL LOAD CASES: (4)										THIS DESIGN COMPLIES WITH:									
PLATES (table is in inches)																				- PART 9 OF CBC 2018, ABC 2019									
JT TYPE PLATES W LEN Y X										CHORDS										WEBS									
B TMB1-I MT20 3.0 4.0										MAX. FACTORED										MAX. FACTORED									
C TTW+h MT20 3.0 5.0 Edge 1.00										MEMB. FORCE (LBS)										MEMB. FORCE (LBS)									
D, E, F										FR-TO										FR-TO									
D TMW+w MT20 2.0 4.0										A-B 0 / 13										I-F -176 / 0									
G TMV+p MT20 2.0 4.0										B-N -9 / 43										J-E -145 / 0									
H BMV1+p MT20 2.0 4.0										N-C -14 / 0										K-D -183 / 0									
I, J, K, L										C-D 0 / 0										L-C -175 / 0									
I BMW1+w MT20 2.0 4.0										D-E 0 / 0										M-N -227 / 0									
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.										E-F 0 / 0																			
										F-G 0 / 0																			
										H-G -62 / 0																			
										B-M 0 / 8																			
										M-L 0 / 8																			
										L-K 0 / 0																			
										K-J 0 / 0																			
										J-I 0 / 0																			
										I-H 0 / 0																			
																				CSI: TC=0.12/1.00 (C-N:1), BC=0.10/1.00 (B-M:1), WB=0.03/1.00 (D-K:1), SSI=0.18/1.00 (B-M:1)									
																				DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10									
																				COMPANION LIVE LOAD FACTOR = 1.00									
																				TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .									
																				NAIL VALUES									
																				PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)									
																				MAX MIN MAX MIN MAX MIN									
																				MT20 650 371 1747 788 1987 1873									

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



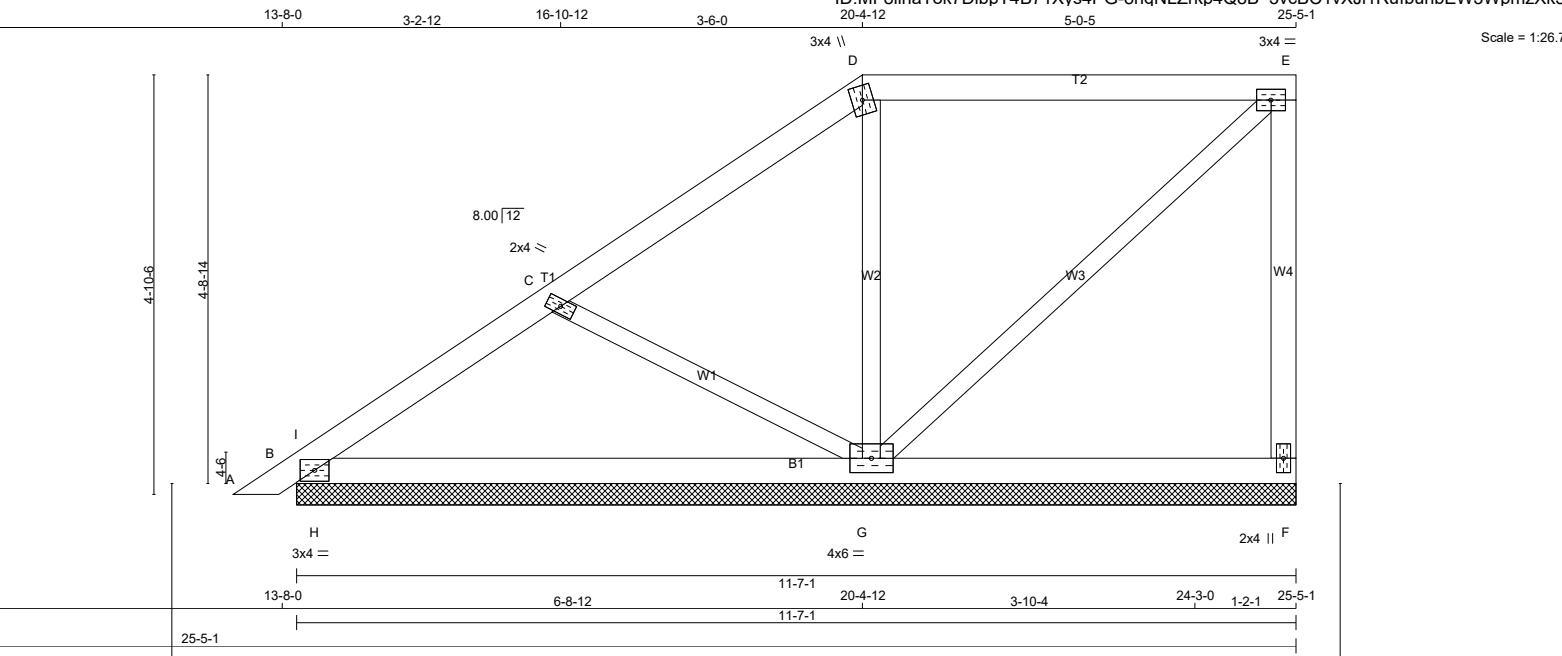

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES				BEARINGS				SPECIFIED LOADS:			
CHORDS	SIZE		LUMBER	DESCR.	FACTORED	MAXIMUM	FACTORED	INPUT	REQRD	TOP	CH.
A - D	2x4	DRY	No.2	SPF	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG	LL	=
D - E	2x4	DRY	No.2	SPF	VERT	HORZ	HORZ	IN-SX	IN-SX	DL	=
F - E	2x4	DRY	No.2	SPF	F	178	0	178	0	0.0	PSF
B - F	2x4	DRY	No.2	SPF	B	328	0	328	0	0.0	PSF
ALL WEBS	2x3	DRY	No.2	SPF	G	663	0	663	0	0.0	PSF
DRY: SEASONED LUMBER.								TOTAL WEIGHT = 45 lb			

PLATES (table is in inches)				UNFACTORED REACTIONS				LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM			
JT	TYPE	PLATES	W	LEN	Y	X	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE
B	TMB1-I	MT20	3.0	4.0			F	127	79 / 0	0 / 0	0 / 0
C	TMW+w	MT20	2.0	4.0			B	233	149 / 0	0 / 0	0 / 0
D	TTW+m	MT20	3.0	4.0			G	473	286 / 0	0 / 0	0 / 0
E	TMVW-t	MT20	3.0	4.0							
F	BMV1+p	MT20	2.0	4.0							
G	BMWWW1-t	MT20	4.0	6.0							

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 13	-78.0	-78.0 0.02 (1)	G-D	-336 / 0	0.11 (1)	
B-I	-382 / 0	-78.0	-78.0 0.11 (4)	G-E	-73 / 0	0.06 (1)	
I-C	-240 / 0	-78.0	-78.0 0.15 (1)	C-G	-312 / 0	0.10 (1)	
C-D	0 / 39	-78.0	-78.0 0.16 (1)	H-I	0 / 179	0.00 (1)	
D-E	0 / 54	-78.0	-78.0 0.34 (1)				
F-E	-147 / 0	0.0	0.0 0.05 (1)				
B-H	0 / 226	-18.5	-18.5 0.09 (4)				
H-G	0 / 226	-18.5	-18.5 0.18 (4)				
G-F	0 / 0	-18.5	-18.5 0.16 (4)				

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2

CS: TC=0.34/1.00 (D-E:1), BC=0.18/1.00 (G-H:4), WB=0.11/1.00 (D-G:1), SSI=0.15/1.00 (B-I:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.37 (D) (INPUT = 0.90)

JSI METAL= 0.13 (C) (INPUT = 1.00)



Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:00 2020 Page 1
ID:MF8iiriaTok7DlbpT4B71Xys4PG-8nqNLZrkp4Q8B 3vcBC1vXJi5RuRbtsbEW3WpmzXk5b



TOTAL WEIGHT = 51 lb


CHORDS					WEB S				
MAX. FACTORED		FACTORED			MAX. FACTORED		FACTORED		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO		LENGTH	FR-TO				
A-B	0 / 13	-78.0	-78.0	0.02 (1)	10.00	G-C	-355 / 0	0.09 (1)	
B-I	-59 / 0	-78.0	-78.0	0.07 (1)	6.25	D-F	-164 / 0	0.16 (1)	
I-C	-129 / 0	-78.0	-78.0	0.34 (1)	6.25	C-F	-120 / 0	0.10 (1)	
C-D	-57 / 0	-78.0	-78.0	0.34 (1)	6.25	H-I	-329 / 0	0.00 (1)	
D-E	0 / 0	-78.0	-78.0	0.01 (1)	10.00				
F-E	-40 / 0	0.0	0.0	0.01 (1)	6.25				
B-H	0 / 124	-18.5	-18.5	0.17 (1)	10.00				
H-G	0 / 124	-18.5	-18.5	0.19 (4)	10.00				
G-F	0 / 124	-18.5	-18.5	0.19 (4)	10.00				



JSI GRIP= 0.42 (C) (INPUT = 0.90)
JSI METAL= 0.08 (C) (INPUT = 1.00)

JSI GRIP= 0.43 (C) (INPUT = 0.90)
JSI METAL= 0.10 (D) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H13		1	TRUSS DESC. JT 45147	E20035239

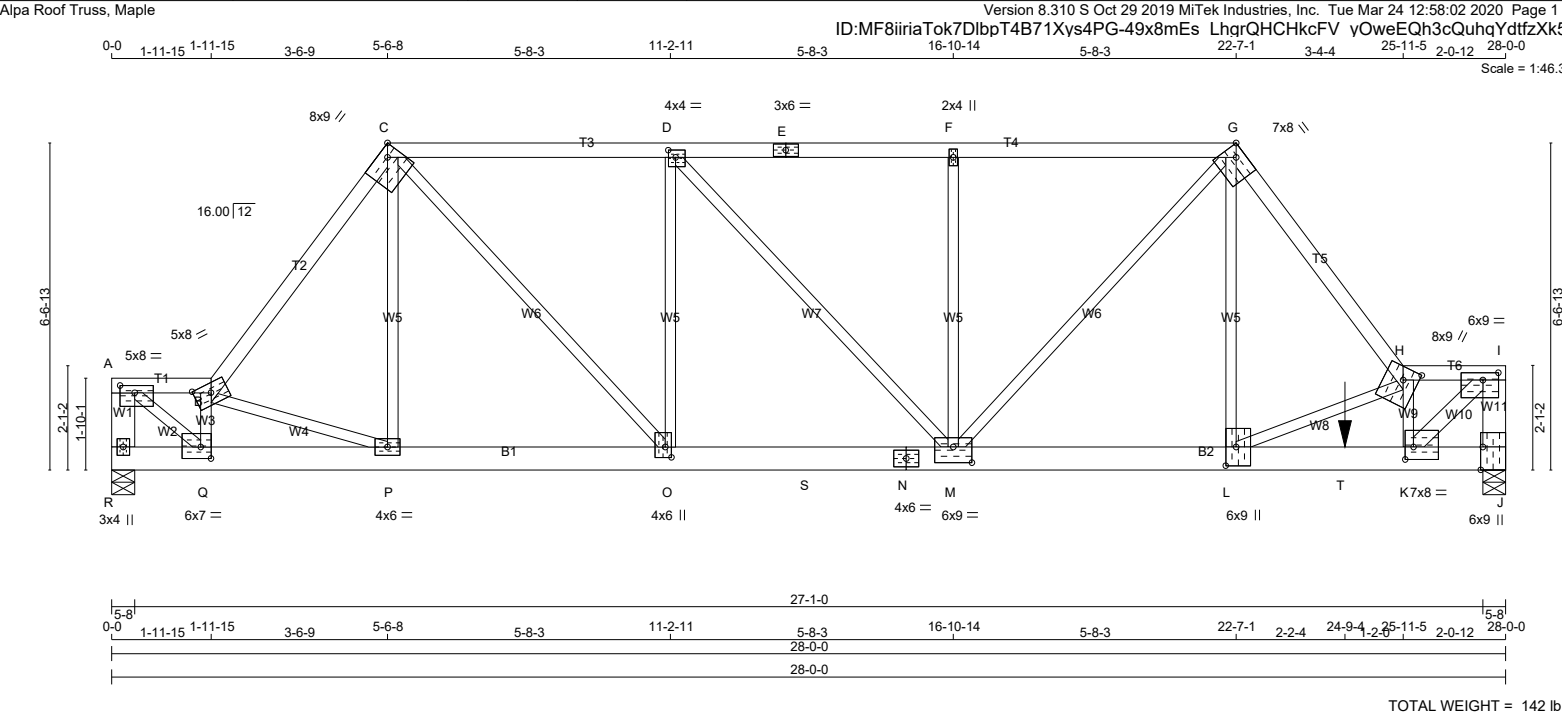


LUMBER N. L. G. A. RULES CHORDS R - A 2x6 DRY No.2 SPF A - B 2x4 DRY No.2 SPF B - C 2x4 DRY No.2 SPF C - E 2x4 DRY No.2 SPF E - G 2x4 DRY No.2 SPF G - H 2x4 DRY No.2 SPF H - I 2x4 DRY No.2 SPF J - I 2x6 DRY No.2 SPF R - N 2x6 DRY 1650F 1.5E SPF N - J 2x6 DRY 1650F 1.5E SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT K - I 2x4 DRY 1650F 1.5E SPF DRY: SEASONED LUMBER.	DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION JT VERT 2285 0 R 3974 0 MAXIMUM FACTORED GROSS REACTION DOWN 2285 0 HORZ 3974 0 UPLIFT 0 0 INPUT BRG IN-SX 5-8 5-8 REQRD BRG IN-SX 2-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL R 1629 995 / 0 0 / 0 0 / 0 635 / 0 0 / 0 J 2833 1729 / 0 0 / 0 0 / 0 1104 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J BEARING SIZE FACTOR = 1.15 AT JNT(S) J (BASED ON SUPPORT DEPTH = 1-8) BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.72 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.	DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 21.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 34.4 PSF SPACING = 24.0 IN. C/C LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 2.00/12 MINIMUM GIRDER TYPE: CStdGirder START DISTANCE = 14-0-0 START SPAN CARRIED = 12-6-0 END DISTANCE = 24-9-4 END SPAN CARRIED = 12-6-0 END WALL WIDTH = 0-0 APPLIED TO FRONT SIDE OF BOTTOM CHORD. - ADDTL LOADS BASED ON 55 % OF GSL. *** NON STANDARD GIRDER *** ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018 , ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 (55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.93") CALCULATED VERT. DEFL.(LL)= L/ 999 (0.16") ALLOWABLE DEFL.(TL)= L/360 (0.93") CALCULATED VERT. DEFL.(TL)= L/ 999 (0.32") CSI: TC=0.79/1.00 (D-F:1), BC=0.78/1.00 (K-L:1), WB=0.86/1.00 (D-O:1), SSI=0.63/1.00 (K-L:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873
PLATES (table is in inches) JT TYPE PLATES W LEN Y X A TMVW-t MT20 5.0 8.0 1.75 3.50 B TTWW-m MT20 5.0 8.0 2.25 4.00 C TTWW-h MT20 8.0 9.0 Edge 2.75 D TMWW-t MT20 4.0 4.0 1.75 1.75 E TS-t MT20 3.0 6.0 F TMW+w MT20 2.0 4.0 G TTWW-h MT20 7.0 8.0 Edge 2.75 H TTWW+m MT20 8.0 9.0 3.00 3.50 I TMVW-t MT20 6.0 9.0 1.75 3.75 J BMV1+t MT20 6.0 9.0 Edge 0.50 K BMWW-t MT20 7.0 8.0 3.00 2.00 L BMWW+t MT20 6.0 9.0 4.50 2.50 M BMWWW-t MT20 6.0 9.0 3.75 4.50 N BS-t MT20 4.0 6.0 O BMWW+t MT20 4.0 6.0 2.50 1.50 P BMWW-t MT20 4.0 6.0 Q BMWW-t MT20 6.0 7.0 2.75 2.50 R BMV1+p MT20 3.0 4.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.	LOADING TOTAL LOAD CASES: (4) CHORDS MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) LC1 MAX. FACTORED VERT. LOAD (PLF) CSI (LC) UNBRAC LENGTH FR-TO FR-TO R-A -2081 / 0 0.0 0.0 0.15 (1) 7.00 A-B -2667 / 0 -78.0 -78.0 0.15 (1) 4.10 B-C -3037 / 0 -78.0 -78.0 0.41 (1) 3.68 C-D -3217 / 0 -78.0 -78.0 0.65 (1) 3.29 D-E -3968 / 0 -78.0 -78.0 0.79 (1) 2.86 E-F -3968 / 0 -78.0 -78.0 0.79 (1) 2.86 F-G -3968 / 0 -78.0 -78.0 0.75 (1) 2.91 G-H -4928 / 0 -78.0 -78.0 0.68 (1) 2.72 H-I -4447 / 0 -78.0 -78.0 0.31 (1) 3.08 J-I -3887 / 0 0.0 0.0 0.29 (1) 5.39 R-Q 0 / 0 -18.5 -18.5 0.18 (1) 10.00 Q-P 0 / 2836 -18.5 -18.5 0.41 (1) 10.00 P-O 0 / 1832 -18.5 -18.5 0.21 (1) 10.00 O-S 0 / 3218 -18.5 -18.5 0.55 (1) 10.00 S-N 0 / 3218 -271.7 -271.7 0.55 (1) 10.00 N-M 0 / 3218 -271.7 -271.7 0.55 (1) 10.00 M-L 0 / 3000 -271.7 -271.7 0.58 (1) 10.00 L-T 0 / 4660 -271.7 -271.7 0.78 (1) 10.00 T-K 0 / 4660 -18.5 -18.5 0.78 (1) 10.00 K-J 0 / 0 -18.5 -18.5 0.07 (1) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE HEEL CONN. T 24-9-4 -830 -830 --- FRONT VERT TOTAL --- C1	CONNECTION REQUIREMENTS 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H14		1	TRUSS DESC. JT 45147	E20035240

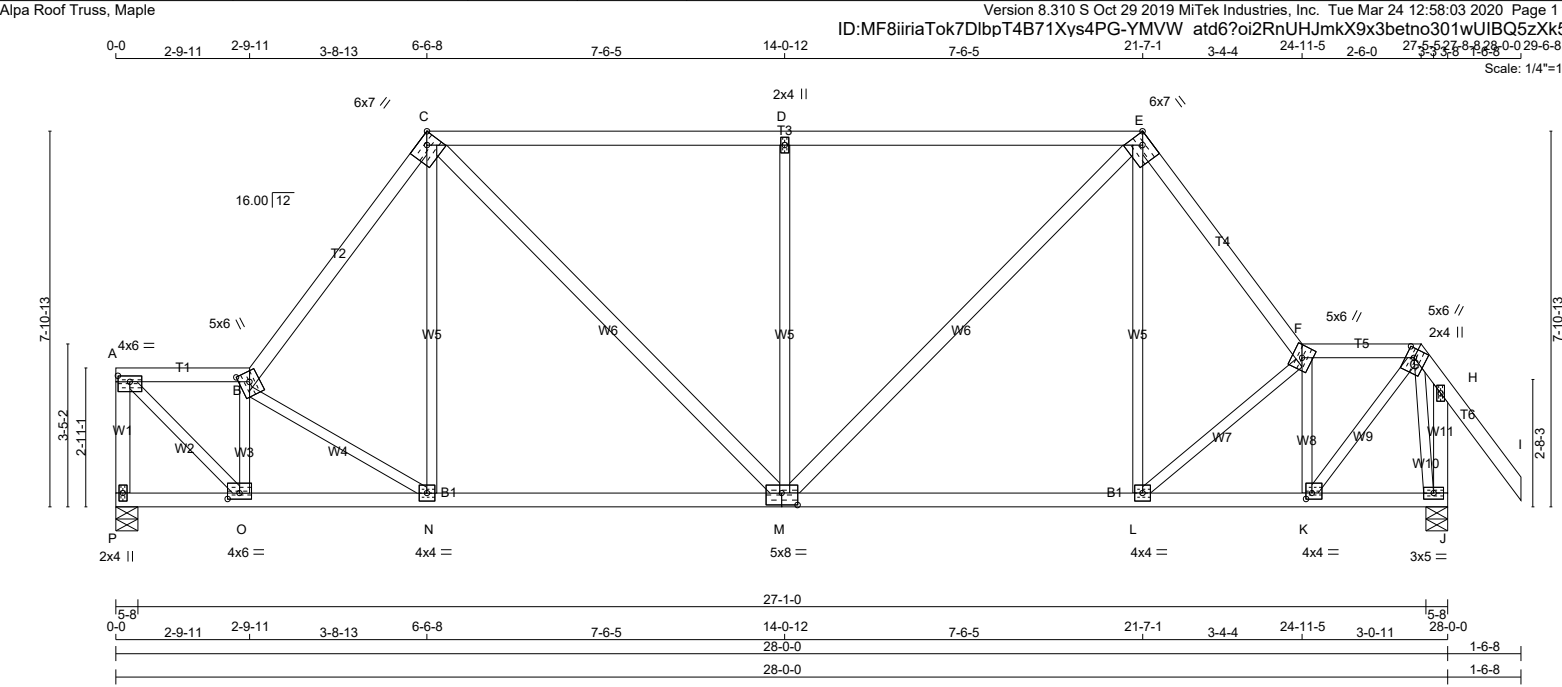

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
P - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
J - H	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
C - M	2x4	DRY	No.2
M - E	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-t	MT20	4.0	6.0	1.50 3.00
B	TTWW+m	MT20	5.0	6.0	2.50 2.50
C	TTWW-h	MT20	6.0	7.0	Edge 2.75
D	TMW+w	MT20	2.0	4.0	
E	TTWW-h	MT20	6.0	7.0	Edge 2.75
F	TTWW+m	MT20	5.0	6.0	
G	TTWW+m	MT20	5.0	6.0	2.25 2.00
H	TMV+p	MT20	2.0	4.0	
J	BMVW1-t	MT20	3.0	5.0	
K	BMWW-t	MT20	4.0	4.0	1.50 1.50
L	BMWW-t	MT20	4.0	4.0	
M	BSWWW-l	MT20	5.0	8.0	3.00 4.00
N	BMWW-t	MT20	4.0	4.0	
O	BMWW-t	MT20	4.0	6.0	1.50 3.00
P	BMV1+p	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM	FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
P	1347	0	1347	0	0	5-8
J	1484	0	1484	0	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN.	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
P	960	586 / 0	0 / 0	0 / 0	0 / 0	375 / 0	0 / 0		
J	1055	659 / 0	0 / 0	0 / 0	0 / 0	396 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.11 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO		FR-TO			
P-A	-1310 / 0	0.0 0.0 0.19 (1)	7.06	A-O	0 / 1752	0.39 (1)	
A-B	-1255 / 0	-78.0 -78.0 0.12 (1)	5.61	O-B	-1205 / 0	0.21 (1)	
B-C	-1499 / 0	-78.0 -78.0 0.25 (1)	5.12	B-N	-487 / 0	0.17 (1)	
C-D	-1303 / 0	-78.0 -78.0 0.90 (1)	4.13	N-C	0 / 420	0.09 (1)	
D-E	-1309 / 0	-78.0 -78.0 0.90 (1)	4.11	C-M	0 / 567	0.09 (1)	
E-F	-1467 / 0	-78.0 -78.0 0.20 (1)	5.21	M-D	-714 / 0	0.84 (1)	
F-G	-1114 / 0	-78.0 -78.0 0.09 (1)	5.90	D-E	0 / 598	0.10 (1)	
G-H	-136 / 0	-78.0 -78.0 0.15 (1)	6.25	L-E	0 / 391	0.09 (1)	
H-I	0 / 52	-78.0 -78.0 0.15 (1)	10.00	L-F	-366 / 0	0.13 (1)	
J-H	-323 / 0	0.0 0.0 0.05 (1)	7.81	K-F	-1179 / 0	0.24 (1)	
				K-G	0 / 1490	0.34 (1)	
				G-J	-1148 / 0	0.23 (1)	
P-O	0 / 0	-18.5 -18.5 0.05 (4)	10.00				
O-N	0 / 1304	-18.5 -18.5 0.34 (4)	10.00				
N-M	0 / 905	-18.5 -18.5 0.31 (4)	10.00				
M-L	0 / 886	-18.5 -18.5 0.31 (4)	10.00				
L-K	0 / 1153	-18.5 -18.5 0.34 (4)	10.00				
K-J	0 / 227	-18.5 -18.5 0.08 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	21.0 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD = 34.4 PSF			

SPACING = 24.0 IN./C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.93")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.93")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.18")

CSI: TC=0.90/1.00 (D-E:1), BC=0.34/1.00 (N-O:4), WB=0.84/1.00 (D-M:1), SSI=0.29/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
(PSI)	(PLI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	650	371	1747	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.36 (M) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H15		1	TRUSS DESC. JT 45147	E20035241

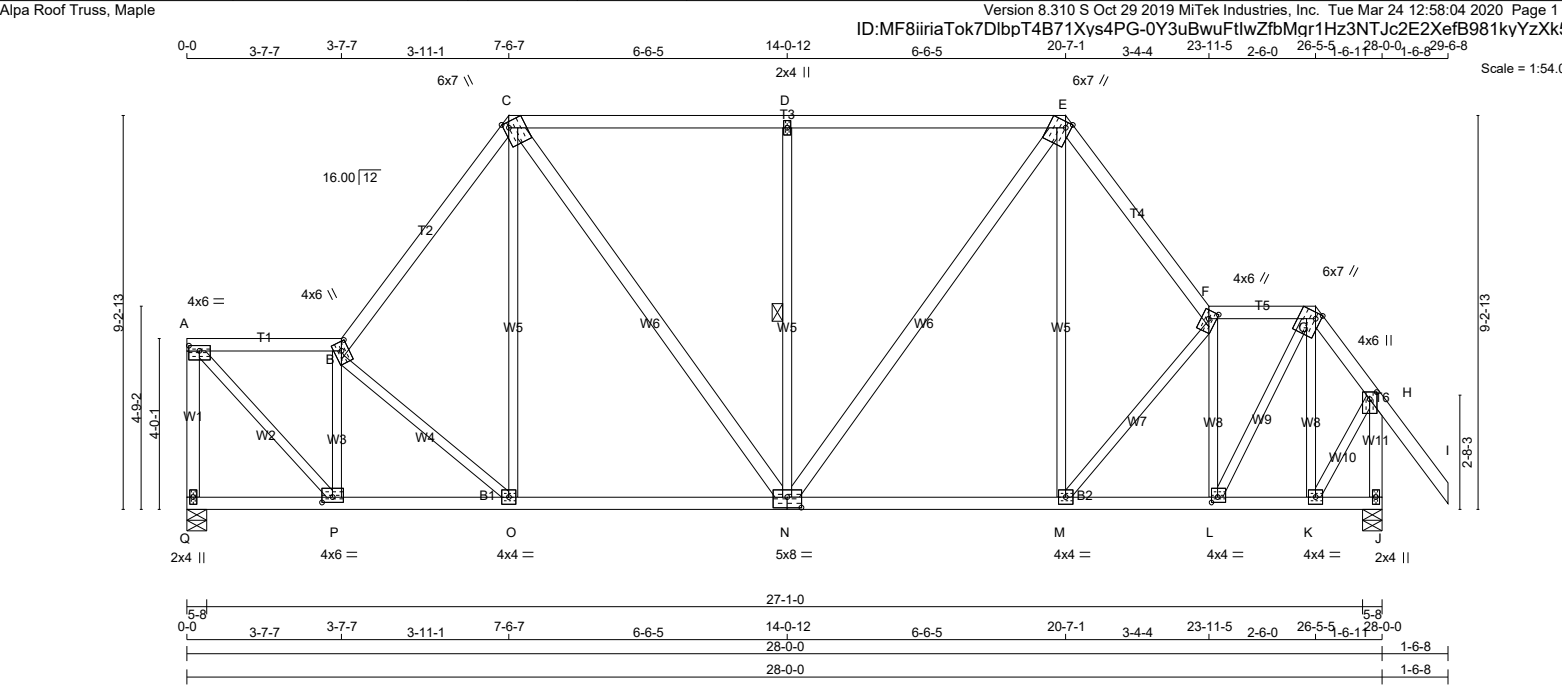

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
Q - A	2x4	DRY	No.2	SPF
A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
C - N	2x4	DRY	No.2	SPF
N - E	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW-t	MT20	4.0	6.0 1.50 3.00
B	TTWW+m	MT20	4.0	6.0 2.50 2.00
C, E, G				
C	TTWW+m	MT20	6.0	7.0 Edge 1.50
D	TMW+w	MT20	2.0	4.0
F	TTWW+m	MT20	4.0	6.0 2.25 2.00
H	TMVW+p	MT20	4.0	6.0 2.00 2.00
J	BMV1+p	MT20	2.0	4.0
K, M, O				
K	BMWW-t	MT20	4.0	4.0
L	BMWW-t	MT20	4.0	4.0 1.50 1.75
N	BSWWW-l	MT20	5.0	8.0 3.00 4.00
P	BMWW-t	MT20	4.0	6.0 1.50 3.00
Q	BMV1+p	MT20	2.0	4.0
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM	FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
Q	1347	0	1347	0	0	5-8
J	1484	0	1484	0	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
Q	960	586 / 0	0 / 0	0 / 0	0 / 0	375 / 0	0 / 0	
J	1055	659 / 0	0 / 0	0 / 0	0 / 0	396 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.07 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF D-N.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING				TOTAL LOAD CASES: (4)			
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO				FR-TO			
Q-A	-1312 / 0	0.0	0.0 0.33 (1)	7.06	A-P	0 / 1633	0.37 (1)
A-B	-1122 / 0	-78.0	-78.0 0.19 (1)	5.75	P-B	-1136 / 0	0.28 (1)
B-C	-1395 / 0	-78.0	-78.0 0.27 (1)	5.24	B-O	-430 / 0	0.21 (1)
C-D	-1096 / 0	-78.0	-78.0 0.63 (1)	5.07	O-C	0 / 415	0.09 (1)
D-E	-1096 / 0	-78.0	-78.0 0.63 (1)	5.07	C-N	0 / 431	0.07 (1)
E-F	-1371 / 0	-78.0	-78.0 0.19 (1)	5.36	N-D	-617 / 0	0.34 (1)
F-G	-1009 / 0	-78.0	-78.0 0.09 (1)	6.12	N-E	0 / 455	0.07 (1)
G-H	-813 / 0	-78.0	-78.0 0.15 (1)	6.25	M-E	0 / 399	0.09 (1)
H-I	0 / 52	-78.0	-78.0 0.15 (1)	10.00	M-F	-342 / 0	0.18 (1)
J-H	-1487 / 0	0.0	0.0 0.21 (1)	6.72	L-F	-1056 / 0	0.35 (1)
					L-G	0 / 1204	0.27 (1)
Q-P	0 / 0	-18.5	-18.5 0.06 (4)	10.00	K-G	-537 / 0	0.18 (1)
P-O	0 / 1154	-18.5	-18.5 0.28 (1)	10.00	K-H	0 / 762	0.17 (1)
O-N	0 / 842	-18.5	-18.5 0.24 (4)	10.00			
N-M	0 / 827	-18.5	-18.5 0.25 (4)	10.00			
M-L	0 / 1033	-18.5	-18.5 0.26 (4)	10.00			
L-K	0 / 435	-18.5	-18.5 0.11 (1)	10.00			
K-J	0 / 0	-18.5	-18.5 0.04 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	21.0 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD = 34.4 PSF			

SPACING = 24.0 IN./C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.93")
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.93")
CALCULATED VERT. DEFL.(TL)= L/999 (0.14")

CSI: TC=0.63/1.00 (C-D:1), BC=0.28/1.00 (O-P:1), WB=0.37/1.00 (A-P:1), SSI=0.25/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (L) (INPUT = 0.90)
JSI METAL= 0.33 (B) (INPUT = 1.00)

Scale = 1:57.7


CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO		LENGTH	FR-TO				
Q-A	-1314 / 0	0.0	0.0	0.58 (1)	7.05	0 / 1552	0.35 (1)		
A-B	-1039 / 0	-78.0	-78.0	0.28 (1)	5.79	P-B	-1077 / 0		
B-C	-1307 / 0	-78.0	-78.0	0.29 (1)	5.35	B-O	-419 / 0		
C-D	-948 / 0	-78.0	-78.0	0.43 (1)	5.75	O-C	0 / 419		
D-E	-948 / 0	-78.0	-78.0	0.43 (1)	5.75	C-N	0 / 335		
E-F	-1297 / 0	-78.0	-78.0	0.19 (1)	5.47	N-D	-518 / 0		
F-G	-952 / 0	-78.0	-78.0	0.09 (1)	6.25	N-E	0 / 348		
G-H	-941 / 0	-78.0	-78.0	0.10 (1)	6.25	M-E	0 / 428		
H-I	0 / 52	-78.0	-78.0	0.15 (1)	10.00	M-F	-372 / 0		
J-H	-1467 / 0	0.0	0.0	0.21 (1)	6.76	L-F	-947 / 0		
						L-G	0 / 1041		
Q-P	0 / 0	-18.5	-18.5	0.07 (4)	10.00	K-G	-402 / 0		
P-O	0 / 1063	-18.5	-18.5	0.23 (1)	10.00	K-H	0 / 738		
O-N	0 / 789	-18.5	-18.5	0.19 (1)	10.00				
N-M	0 / 782	-18.5	-18.5	0.19 (4)	10.00				
M-L	0 / 969	-18.5	-18.5	0.22 (1)	10.00				
L-K	0 / 552	-18.5	-18.5	0.13 (1)	10.00				
K-J	0 / 0	-18.5	-18.5	0.04 (4)	10.00				

Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:07 2020 Page 1

ID:MF8iiriaTok7DlbpT4B71Xys4PG-R7I1pyw7ADI8W35FW9qqh?5nNFDskyadr6GOZszXk5

Scale = 1:57.6

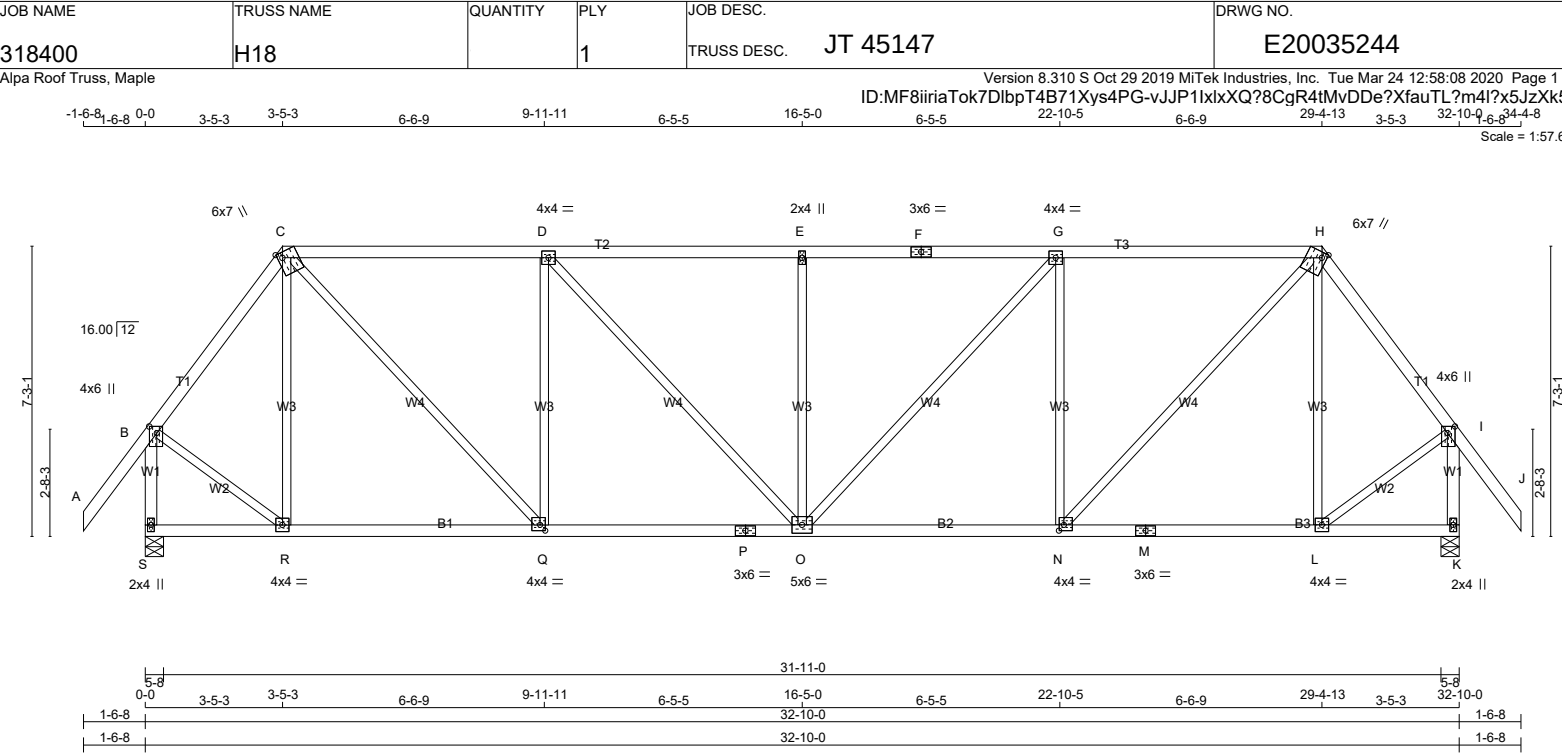


Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:09 2020 Page 1



JSI GRIP= 0.88 (B) (INPUT = 0.90)
JSI METAL= 0.45 (B) (INPUT = 1.00)


Scale = 1:57.6



Q- P	0 / 0	-18.5	-18.5	0.18 (4)	10.00
P- O	0 / 755	-18.5	-18.5	0.28 (4)	10.00
O- N	0 / 755	-18.5	-18.5	0.28 (4)	10.00
N- M	0 / 1407	-18.5	-18.5	0.34 (1)	10.00
M- L	0 / 755	-18.5	-18.5	0.28 (4)	10.00
L- K	0 / 755	-18.5	-18.5	0.28 (4)	10.00
K- J	0 / 0	-18.5	-18.5	0.18 (4)	10.00

JSI GRIP= 0.88 (N) (INPUT = 0.90)
JSI METAL= 0.46 (B) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H22T		1	TRUSS DESC. JT 45147	E20035248

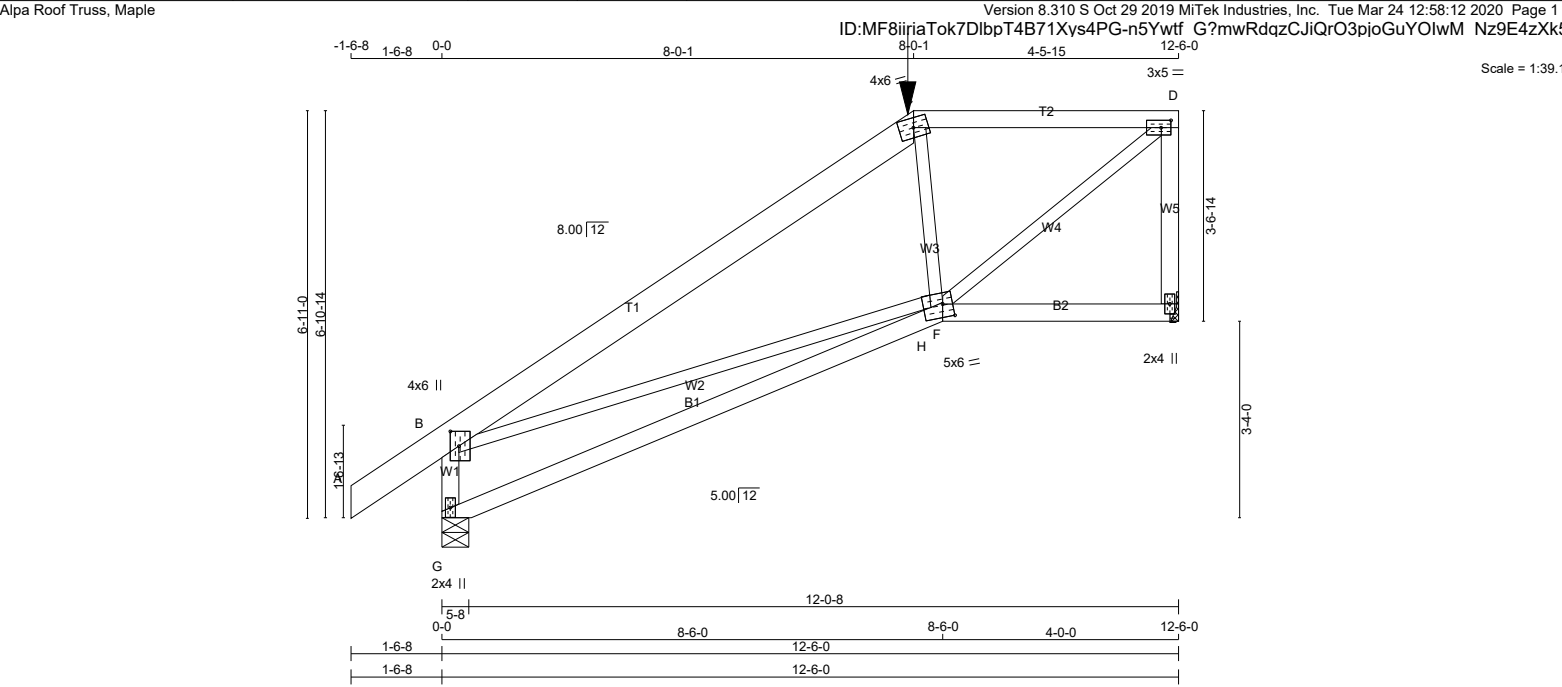

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x6	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	6.0	3.00	1.75
C TTW-m	MT20	4.0	6.0		
D TMVW-t	MT20	3.0	5.0	1.50	2.00
E BMV1+p	MT20	2.0	4.0		
F BBWW-m	MT20	5.0	6.0	2.75	2.00
G BMV1+p	MT20	2.0	4.0		

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM	FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
E	832	0	832	0	0	MECHANICAL
G	847	0	847	0	0	5-8 1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN.	COMPONENT REACTIONS	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND
E	592	367 / 0	0 / 0	0 / 0	0 / 0
G	603	376 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	MAX.	FACTORED	MAX.	FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	UNBRAC	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 / 36	-78.0	-78.0	0.08 (1)	10.00	C-F	-233 / 19
B-C	-879 / 0	-78.0	-78.0	0.49 (1)	6.25	F-D	0 / 896
C-D	-693 / 0	-100.7	-100.7	0.40 (1)	6.25	B-F	0 / 752
E-D	-784 / 0	0.0	0.0	0.16 (1)	7.81		
G-B	-746 / 0	0.0	0.0	0.09 (1)	7.81		
G-H	0 / 0	-23.9	-23.9	0.56 (4)	10.00		
H-F	0 / 0	-23.9	-23.9	0.56 (4)	10.00		
F-E	0 / 0	-23.9	-23.9	0.12 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)		LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
JT		8-0-1	-173	-173	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	21.0 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD	=	34.4	PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 8-0-1
RIGHT SETBACK = 0-0
END SETBACK = 3-2-0
END WALL WIDTH = 0-0
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.42")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.42")
CALCULATED VERT. DEFL.(TL) = L/ 433 (0.35")

CSI: TC=0.49/1.00 (B-C:1) , BC=0.56/1.00 (F-G:4) , WB=0.22/1.00 (D-F:1) , SSI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.85 (D) (INPUT = 0.90)
JSI METAL= 0.52 (B) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H23T		1	TRUSS DESC. JT 45147	E20035249

Alpa Roof Truss, Maple

ID:MF8iiriaTok7DlbpT4B71Xys4PG-FH6I4??um32IE YPtQx4wGLzIqGX7eSVD1jimWzXk50

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:13 2020 Page 1

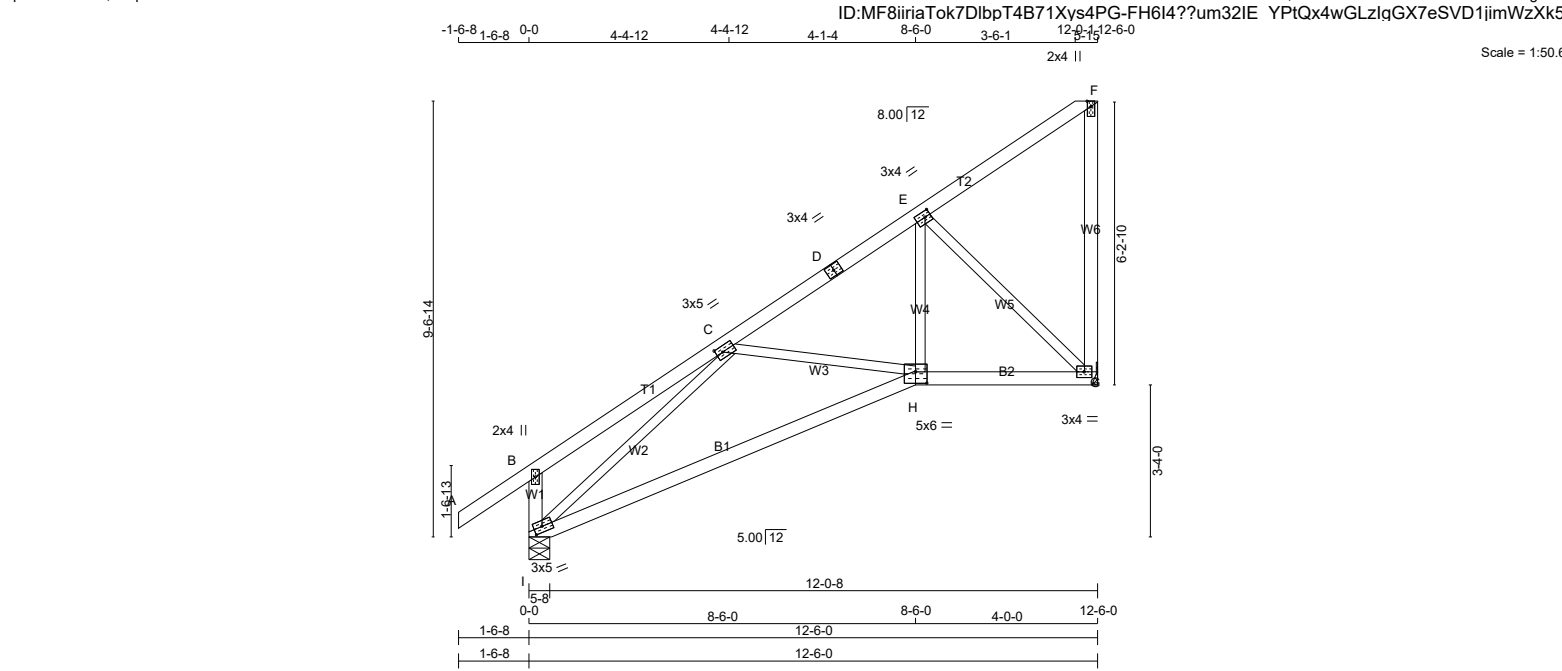

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
G - F	2x4	DRY	No.2
I - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	2.0	4.0
C	TMWW-t	MT20	3.0	5.0 1.50 1.75
D	TS-t	MT20	3.0	4.0
E	TMWW-t	MT20	3.0	4.0 1.50 1.50
F	TMV+p	MT20	2.0	4.0 Edge
G	BMVW1-t	MT20	3.0	4.0
H	BBWW-t	MT20	5.0	6.0 3.00 3.00
I	BMVW1-t	MT20	3.0	5.0 1.50 2.25

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
G	603	0	603	0	0
I	729	0	729	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	PERM.LIVE	WIND	DEAD	SOIL
G	430	262 / 0	0 / 0	0 / 0	168 / 0	0 / 0
I	517	330 / 0	0 / 0	0 / 0	187 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX LC1 CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 35	-78.0 -78.0	0.15 (1)	H-E	0 / 423	0.10 (1)	
B-C	0 / 17	-78.0 -78.0	0.18 (1)	E-G	-654 / 0	0.29 (1)	
C-D	-589 / 0	-78.0 -78.0	0.14 (1)	I-C	-935 / 0	0.59 (1)	
D-E	-589 / 0	-78.0 -78.0	0.14 (1)	C-H	-174 / 0	0.06 (1)	
E-F	-18 / 0	-78.0 -78.0	0.13 (1)				
G-F	-120 / 0	0.0 0.0	0.10 (1)				
I-B	-264 / 0	0.0 0.0	0.03 (1)				
I-H	0 / 716	-18.5 -18.5	0.44 (4)				
H-G	0 / 477	-18.5 -18.5	0.13 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	21.0	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	34.4	PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.42")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.42")
CALCULATED VERT. DEFL.(TL) = L/ 555 (0.27")

CSI: TC=0.18/1.00 (B-C:1) , BC=0.44/1.00 (H-I:4) , WB=0.59/1.00 (C-I:1) , SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	650	371	1747	788	1987

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.28 (I) (INPUT = 1.00)

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H24T		1	TRUSS DESC. JT 45147	E20035250

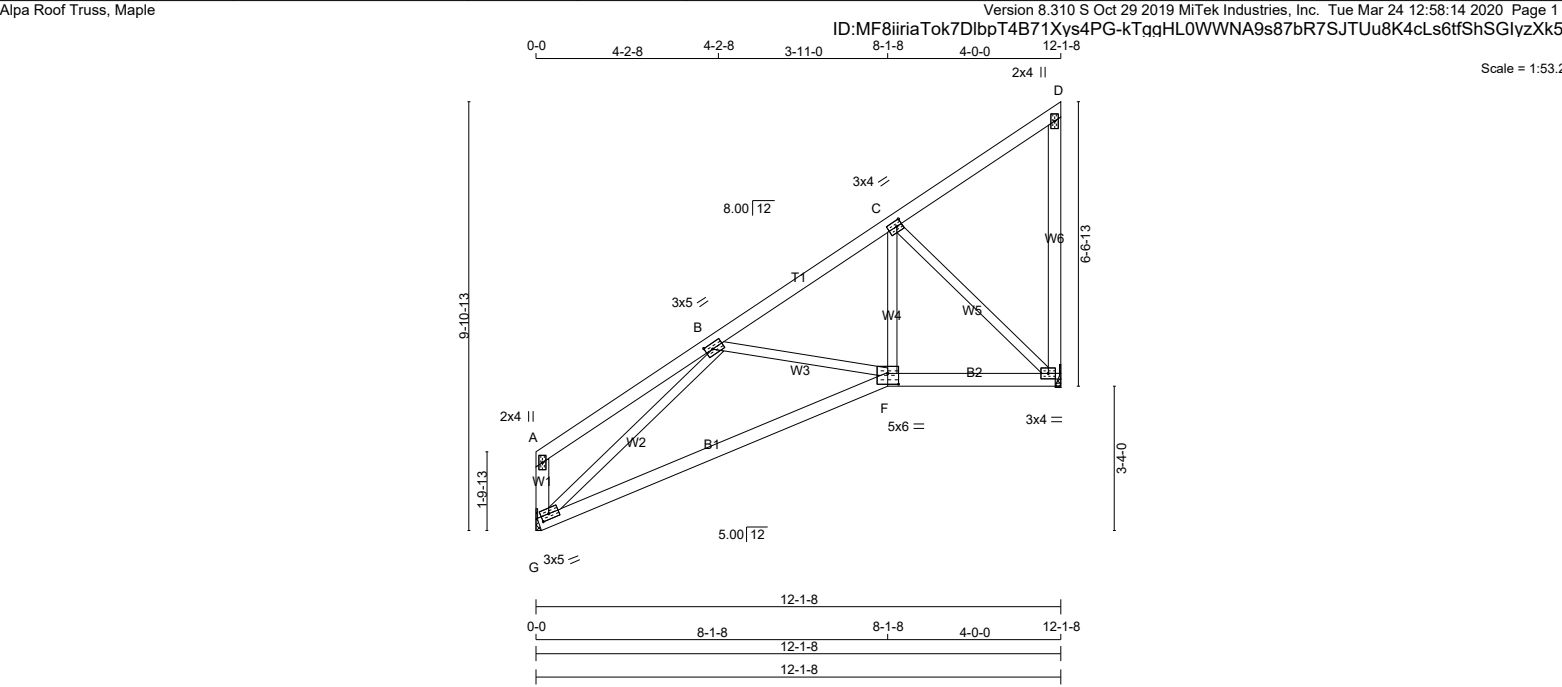

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER G - A 2x4 DRY No.2 A - D 2x4 DRY No.2 E - D 2x4 DRY No.2 G - F 2x4 DRY No.2 F - E 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQD JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX G 585 0 585 0 0 MECHANICAL E 585 0 585 0 0 MECHANICAL A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G, E. MINIMUM BEARING LENGTH AT JOINT G = 1-8, JOINT E = 1-8. UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL G 417 255 / 0 0 / 0 0 / 0 0 / 0 162 / 0 0 / 0 E 417 255 / 0 0 / 0 0 / 0 0 / 0 162 / 0 0 / 0 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) LC1 MAX. UNBRACED LENGTH FR-TO G-A -132 / 0 0.0 0.0 0.01 (1) 7.81 A-B 0 / 16 -78.0 -78.0 0.16 (1) 10.00 B-C -562 / 0 -78.0 -78.0 0.13 (1) 6.25 C-D -17 / 0 -78.0 -78.0 0.13 (1) 6.25 E-D -121 / 0 0.0 0.0 0.10 (1) 7.81 WEBS MEMB. MAX. FACTORED FORCE (LBS) MAX. UNBRACED LENGTH FR-TO F-C 0 / 396 0.09 (1) C-E -626 / 0 0.28 (1) G-B -874 / 0 0.51 (1) B-F -141 / 0 0.05 (1) G-F 0 / 656 -18.5 -18.5 0.41 (4) 10.00 F-E 0 / 457 -18.5 -18.5 0.13 (4) 10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 21.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 34.4 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 (55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.40") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01") ALLOWABLE DEFL.(TL)= L/360 (0.40") CALCULATED VERT. DEFL.(TL) = L/ 641 (0.23") CSI: TC=0.16/1.00 (A-B:1) , BC=0.41/1.00 (F-G:4) , WB=0.51/1.00 (B-G:1) , SSI=0.12/1.00 (A-B:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.83 (G) (INPUT = 0.90) JSI METAL= 0.24 (G) (INPUT = 1.00)			
--	--	--	--	---	--	--	--	---	--	--	--

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:15 2020 Page 1



TOTAL WEIGHT = 7 X 79 = 554 lb


Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

TOTAL LOAD CASES: (4)

J- I	0 / 0	-18.5	-18.5	0.02 (4)	10.00
I- H	0 / 938	-18.5	-18.5	0.29 (4)	10.00
H- G	0 / 0	-18.5	-18.5	0.21 (4)	10.00

JSI GRIP= 0.79 (I) (INPUT = 0.90)
JSI METAL= 0.47 (I) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H26		1	TRUSS DESC. JT 45147	E20035252

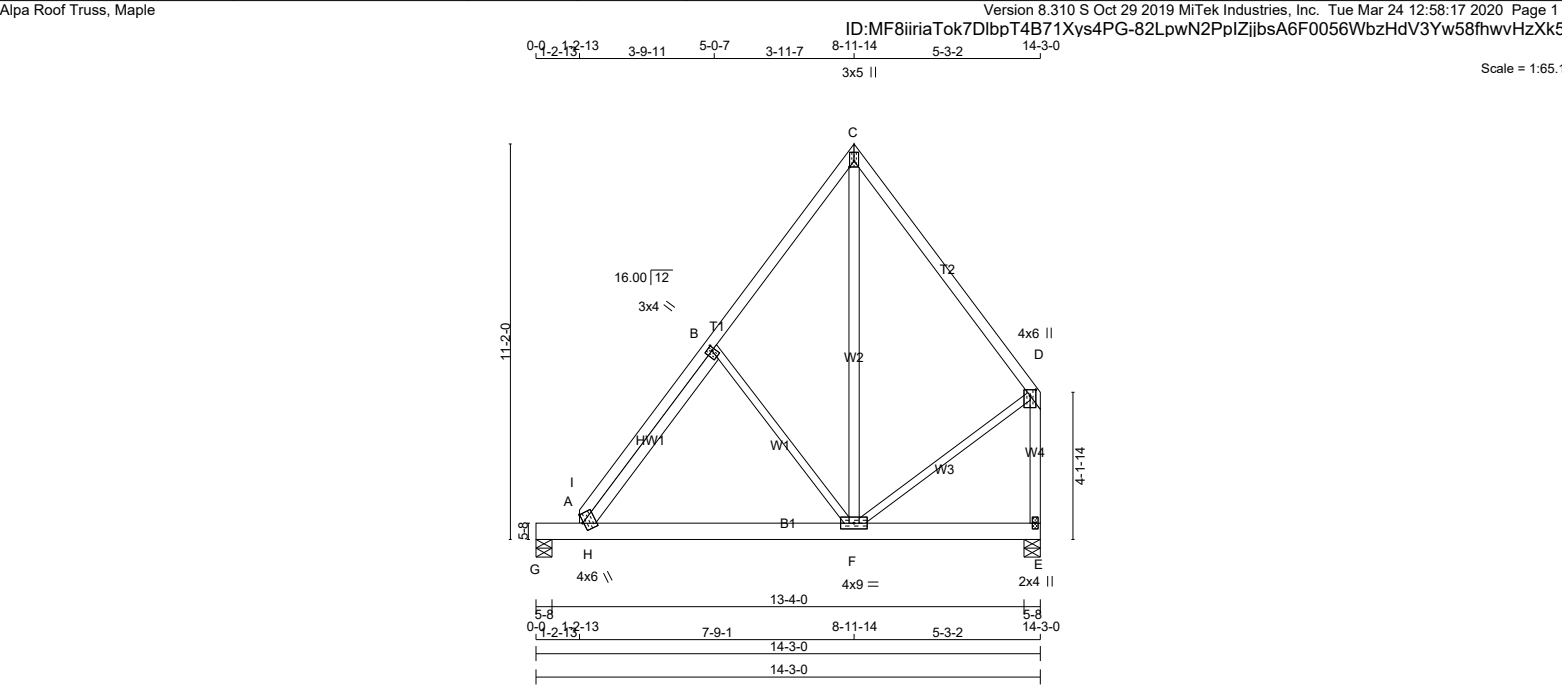


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER A - C 2x4 DRY No.2 C - D 2x4 DRY No.2 E - D 2x4 DRY No.2 G - E 2x6 DRY No.2 REINFORCING MEMBERS HW1 2x4 DRY No.2 ALL WEBS 2x4 DRY No.2 EXCEPT F - D 2x3 DRY No.2 B - F 2x3 DRY No.2 DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION JT VERT 687 G 687 E 687 MAXIMUM FACTORED GROSS REACTION DOWN 687 HORZ 0 UPLIFT 0 INPUT BRG IN-SX 5-8 REQRD BRG IN-SX 1-8 UNFACTORED REACTIONS 1ST LCASE JT COMBINED 490 G 490 E 490 MAX./MIN. COMPONENT REACTIONS SNOW 299 / 0 LIVE 0 / 0 PERM.LIVE 0 / 0 WIND 0 / 0 DEAD 191 / 0 SOIL 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, E BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.35 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MEMB. MAX. FACTORED FORCE (LBS) FR-TO A- I -1427 / 0 I- B -1298 / 0 B- C -414 / 0 C- D -382 / 0 E- D -672 / 0 G- A 0 / 0 A- H 0 / 809 H- F 0 / 405 F- E 0 / 0 FACTORED VERT. LOAD (PLF) -78.0 -78.0 -78.0 -78.0 0.0 MAX. UNBRACED LENGTH 5.35 5.38 6.25 6.25 7.81 WEBS MEMB. MAX. FACTORED FORCE (LBS) FR-TO F- C 0 / 292 F- D 0 / 280 B- F -298 / 0 H- I 0 / 56 H- B 0 / 741 MAX. FACTORED CSI (LC) 0.05 (1) 0.06 (1) 0.24 (1) 0.00 (1) 0.12 (1) MAX. FACTORED CSI (LC) 10.00 10.00 10.00 10.00 10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 21.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 34.4 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 (55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.48") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.06") ALLOWABLE DEFL.(TL)= L/360 (0.48") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.13") CSI: TC=0.39/1.00 (C-D:1) , BC=0.51/1.00 (A-H:1) , WB=0.24/1.00 (B-F:1) , SSI=0.41/1.00 (A-G:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.87 (B) (INPUT = 0.90) JSI METAL= 0.39 (A) (INPUT = 1.00)			
---	--	--	--	--	--	--	--	--	--	--	--

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H27		1	TRUSS DESC. JT 45147	E20035253

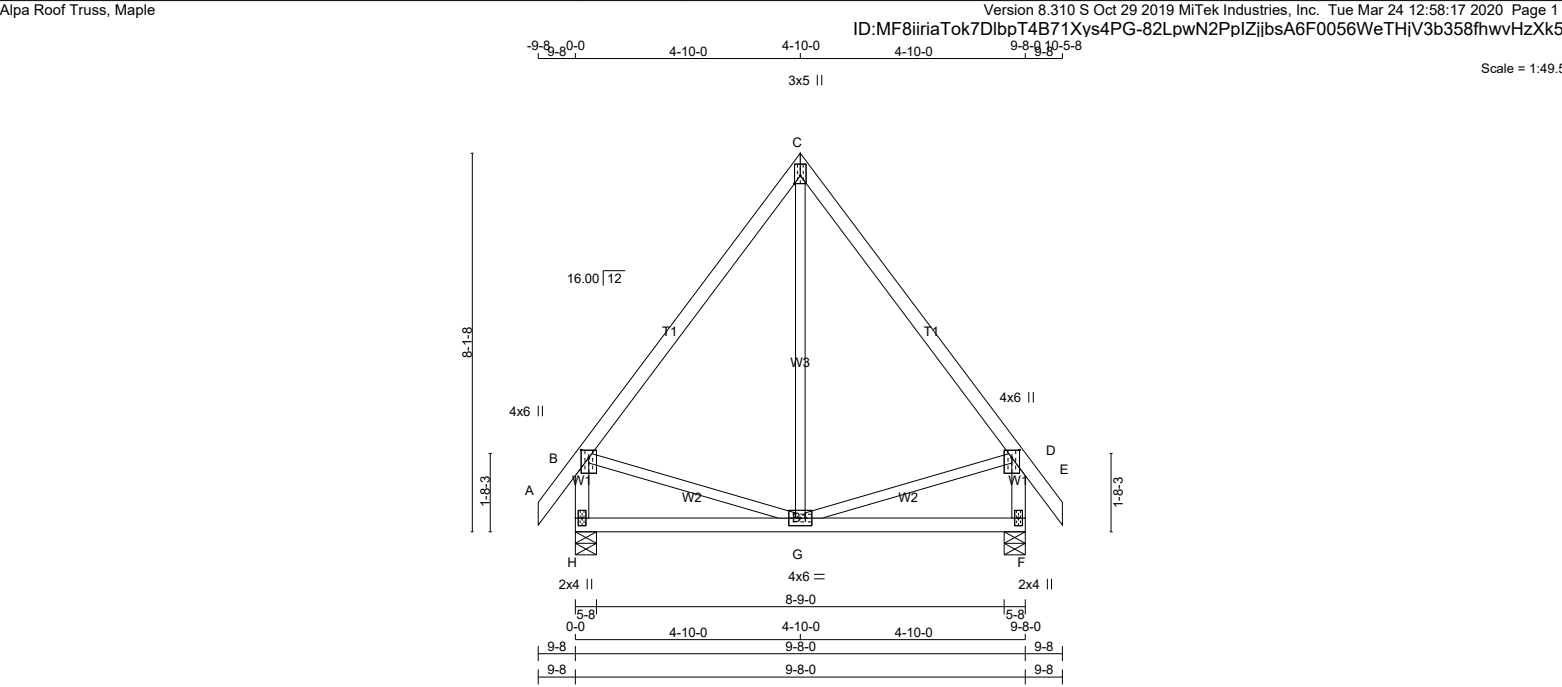


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER A - C 2x4 DRY No.2 C - E 2x4 DRY No.2 H - B 2x4 DRY No.2 F - D 2x4 DRY No.2 H - F 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT DRY: SEASONED LUMBER.					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table><tr><td></td><td>FACTORED GROSS REACTION</td><td>MAXIMUM FACTORED GROSS REACTION</td><td>INPUT BRG</td><td>REQRD BRG</td></tr><tr><td>JT</td><td>VERT HORZ</td><td>DOWN HORZ</td><td>UPLIFT IN-SX</td><td>IN-SX</td></tr><tr><td>H</td><td>537 0</td><td>537 0</td><td>0 5-8</td><td>1-8</td></tr><tr><td>F</td><td>537 0</td><td>537 0</td><td>0 5-8</td><td>1-8</td></tr></table> UNFACTORED REACTIONS <table><tr><td></td><td>1ST LCASE</td><td colspan="6">MAX./MIN. COMPONENT REACTIONS</td></tr><tr><td>JT</td><td>COMBINED</td><td>SNOW</td><td>LIVE</td><td>PERM.LIVE</td><td>WIND</td><td>DEAD</td><td>SOIL</td></tr><tr><td>H</td><td>381</td><td>241 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>140 / 0</td><td>0 / 0</td></tr><tr><td>F</td><td>381</td><td>241 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>140 / 0</td><td>0 / 0</td></tr></table> BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) <table><tr><td colspan="4">CHORDS</td><td colspan="4">WEBS</td></tr><tr><td>MEMB.</td><td>MAX. FACTORED FORCE (LBS)</td><td>FACTORED VERT. LOAD (PLF)</td><td>MAX. FACTORED CSI (LC)</td><td>MEMB.</td><td>MAX. FACTORED FORCE (LBS)</td><td>MAX. FACTORED CSI (LC)</td><td></td></tr><tr><td>FR-TO</td><td></td><td>FROM TO</td><td></td><td>FR-TO</td><td></td><td></td><td></td></tr><tr><td>A- B</td><td>0 / 28</td><td>-78.0 -78.0</td><td>0.05 (1)</td><td>10.00</td><td>G- C</td><td>0 / 90</td><td>0.03 (4)</td></tr><tr><td>B- C</td><td>-254 / 0</td><td>-78.0 -78.0</td><td>0.23 (1)</td><td>6.25</td><td>B- G</td><td>0 / 158</td><td>0.04 (1)</td></tr><tr><td>C- D</td><td>-254 / 0</td><td>-78.0 -78.0</td><td>0.23 (1)</td><td>6.25</td><td>G- D</td><td>0 / 158</td><td>0.04 (1)</td></tr><tr><td>D- E</td><td>0 / 28</td><td>-78.0 -78.0</td><td>0.05 (1)</td><td>10.00</td><td></td><td></td><td></td></tr><tr><td>H- B</td><td>-503 / 0</td><td>0.0 0.0</td><td>0.05 (1)</td><td>7.81</td><td></td><td></td><td></td></tr><tr><td>F- D</td><td>-503 / 0</td><td>0.0 0.0</td><td>0.05 (1)</td><td>7.81</td><td></td><td></td><td></td></tr><tr><td>H- G</td><td>0 / 0</td><td>-18.5 -18.5</td><td>0.12 (4)</td><td>10.00</td><td></td><td></td><td></td></tr><tr><td>G- F</td><td>0 / 0</td><td>-18.5 -18.5</td><td>0.12 (4)</td><td>10.00</td><td></td><td></td><td></td></tr></table>						FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG	JT	VERT HORZ	DOWN HORZ	UPLIFT IN-SX	IN-SX	H	537 0	537 0	0 5-8	1-8	F	537 0	537 0	0 5-8	1-8		1ST LCASE	MAX./MIN. COMPONENT REACTIONS						JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	H	381	241 / 0	0 / 0	0 / 0	0 / 0	140 / 0	0 / 0	F	381	241 / 0	0 / 0	0 / 0	0 / 0	140 / 0	0 / 0	CHORDS				WEBS				MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		FR-TO		FROM TO		FR-TO				A- B	0 / 28	-78.0 -78.0	0.05 (1)	10.00	G- C	0 / 90	0.03 (4)	B- C	-254 / 0	-78.0 -78.0	0.23 (1)	6.25	B- G	0 / 158	0.04 (1)	C- D	-254 / 0	-78.0 -78.0	0.23 (1)	6.25	G- D	0 / 158	0.04 (1)	D- E	0 / 28	-78.0 -78.0	0.05 (1)	10.00				H- B	-503 / 0	0.0 0.0	0.05 (1)	7.81				F- D	-503 / 0	0.0 0.0	0.05 (1)	7.81				H- G	0 / 0	-18.5 -18.5	0.12 (4)	10.00				G- F	0 / 0	-18.5 -18.5	0.12 (4)	10.00			
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG																																																																																																																																																	
JT	VERT HORZ	DOWN HORZ	UPLIFT IN-SX	IN-SX																																																																																																																																																	
H	537 0	537 0	0 5-8	1-8																																																																																																																																																	
F	537 0	537 0	0 5-8	1-8																																																																																																																																																	
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS																																																																																																																																																			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL																																																																																																																																														
H	381	241 / 0	0 / 0	0 / 0	0 / 0	140 / 0	0 / 0																																																																																																																																														
F	381	241 / 0	0 / 0	0 / 0	0 / 0	140 / 0	0 / 0																																																																																																																																														
CHORDS				WEBS																																																																																																																																																	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)																																																																																																																																															
FR-TO		FROM TO		FR-TO																																																																																																																																																	
A- B	0 / 28	-78.0 -78.0	0.05 (1)	10.00	G- C	0 / 90	0.03 (4)																																																																																																																																														
B- C	-254 / 0	-78.0 -78.0	0.23 (1)	6.25	B- G	0 / 158	0.04 (1)																																																																																																																																														
C- D	-254 / 0	-78.0 -78.0	0.23 (1)	6.25	G- D	0 / 158	0.04 (1)																																																																																																																																														
D- E	0 / 28	-78.0 -78.0	0.05 (1)	10.00																																																																																																																																																	
H- B	-503 / 0	0.0 0.0	0.05 (1)	7.81																																																																																																																																																	
F- D	-503 / 0	0.0 0.0	0.05 (1)	7.81																																																																																																																																																	
H- G	0 / 0	-18.5 -18.5	0.12 (4)	10.00																																																																																																																																																	
G- F	0 / 0	-18.5 -18.5	0.12 (4)	10.00																																																																																																																																																	
PLATES (table is in inches) <table><tr><td>JT</td><td>TYPE</td><td>PLATES</td><td>W</td><td>LEN</td><td>Y</td><td>X</td></tr><tr><td>B</td><td>TMVW+p</td><td>MT20</td><td>4.0</td><td>6.0</td><td>2.00</td><td>2.00</td></tr><tr><td>C</td><td>TTW+p</td><td>MT20</td><td>3.0</td><td>5.0</td><td>2.00</td><td>Edge</td></tr><tr><td>D</td><td>TMVW+p</td><td>MT20</td><td>4.0</td><td>6.0</td><td>2.00</td><td>2.00</td></tr><tr><td>F</td><td>BMV1+p</td><td>MT20</td><td>2.0</td><td>4.0</td><td></td><td></td></tr><tr><td>G</td><td>BMWW+t</td><td>MT20</td><td>4.0</td><td>6.0</td><td></td><td></td></tr><tr><td>H</td><td>BMV1+p</td><td>MT20</td><td>2.0</td><td>4.0</td><td></td><td></td></tr></table> Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.					JT	TYPE	PLATES	W	LEN	Y	X	B	TMVW+p	MT20	4.0	6.0	2.00	2.00	C	TTW+p	MT20	3.0	5.0	2.00	Edge	D	TMVW+p	MT20	4.0	6.0	2.00	2.00	F	BMV1+p	MT20	2.0	4.0			G	BMWW+t	MT20	4.0	6.0			H	BMV1+p	MT20	2.0	4.0			DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 21.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 34.4 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018 , ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 (55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.32") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00") ALLOWABLE DEFL.(TL)= L/360 (0.32") CALCULATED VERT. DEFL.(TL)= L/ 999 (0.01") CSI: TC=0.23/1.00 (B-C:1) , BC=0.12/1.00 (G-H:4) , WB=0.04/1.00 (D-G:1) , SSI=0.09/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.28 (B) (INPUT = 0.90) JSI METAL= 0.14 (D) (INPUT = 1.00)																																																																																															
JT	TYPE	PLATES	W	LEN	Y	X																																																																																																																																															
B	TMVW+p	MT20	4.0	6.0	2.00	2.00																																																																																																																																															
C	TTW+p	MT20	3.0	5.0	2.00	Edge																																																																																																																																															
D	TMVW+p	MT20	4.0	6.0	2.00	2.00																																																																																																																																															
F	BMV1+p	MT20	2.0	4.0																																																																																																																																																	
G	BMWW+t	MT20	4.0	6.0																																																																																																																																																	
H	BMV1+p	MT20	2.0	4.0																																																																																																																																																	
LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2																																																																																																																																																					
																																																																																																																																																					

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H27G		1	TRUSS DESC. JT 45147	E20035254

Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:19 2020 Page 1

ID:MF8iiriaTok7DlbpT4B71Xys4PG-4RTZL24flvpRyv0YDq2UAXb0s5PZXTGObzA1 AzXk51

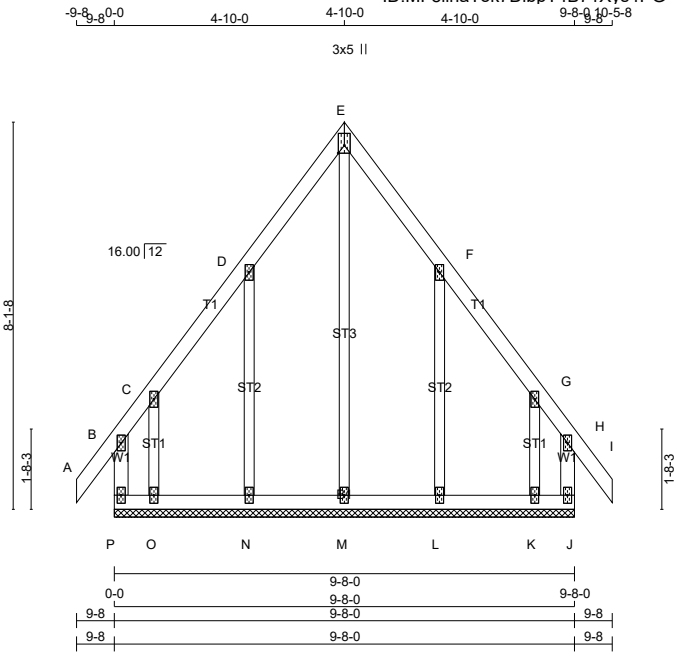

TOTAL WEIGHT = 54 lb

[M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
P - B	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2'-0" OC.				

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	2.0	4.0	
C, D, F, G				
C TMW+w	MT20	2.0	4.0	
E TTW+p	MT20	3.0	5.0	2.00 Edge
H TMV+p	MT20	2.0	4.0	
J BMV1+p	MT20	2.0	4.0	
K, L, M, N, O				
K BMW1+w	MT20	2.0	4.0	
P BMV1+p	MT20	2.0	4.0	
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO				
P-B	-136 / 0	0.0	0.0	0.02 (1)	7.81	M-E	-154 / 0	0.18 (1)	
A-B	0 / 28	-78.0	-78.0	0.05 (1)	10.00	N-D	-164 / 0	0.07 (1)	
B-C	-36 / 0	-78.0	-78.0	0.04 (1)	6.25	O-C	-71 / 0	0.01 (1)	
C-D	-6 / 0	-78.0	-78.0	0.04 (1)	10.00	L-F	-164 / 0	0.07 (1)	
D-E	-7 / 0	-78.0	-78.0	0.04 (1)	10.00	K-G	-71 / 0	0.01 (1)	
E-F	-7 / 0	-78.0	-78.0	0.04 (1)	10.00				
F-G	-6 / 0	-78.0	-78.0	0.04 (1)	10.00				
G-H	-36 / 0	-78.0	-78.0	0.04 (1)	6.25				
H-I	0 / 28	-78.0	-78.0	0.05 (1)	10.00				
J-H	-136 / 0	0.0	0.0	0.02 (1)	7.81				
P-O	0 / 11	-18.5	-18.5	0.02 (1)	10.00				
O-N	0 / 7	-18.5	-18.5	0.02 (4)	10.00				
N-M	0 / 3	-18.5	-18.5	0.02 (4)	10.00				
M-L	0 / 3	-18.5	-18.5	0.02 (4)	10.00				
L-K	0 / 7	-18.5	-18.5	0.02 (4)	10.00				
K-J	0 / 11	-18.5	-18.5	0.02 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	21.0	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	34.4	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.05/1.00 (H-I:1) , BC=0.02/1.00 (J-K:1) , WB=0.18/1.00 (E-M:1) , SSI=0.04/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES				
PLATE	GRIP(DRY)	SHEAR	SECTION	
	(PSI)	(PLI)	(PLI)	
	MAX	MIN	MAX	MIN
MT20	650	371	1747	788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.08 (F) (INPUT = 1.00)

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:20 2020 Page 1
ID:MF8ijriaTok7DlbpT4B71Xvs4PG-Yd1xYO4H6DxIa3bInOZii84bVfOGI XgdvaWczXk5H




JSI GRIP= 0.82 (I) (INPUT = 0.90)
JSI METAL= 0.35 (I) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318400	H28G		1	TRUSS DESC. JT 45147	E20035256

Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:21 2020 Page 1

ID:MF8iiriaTok7DlbpT4B71Xys4PG-0pbJk5vtX39CC9xL54yFyglFv4A?N3h3Hf822zXk5G

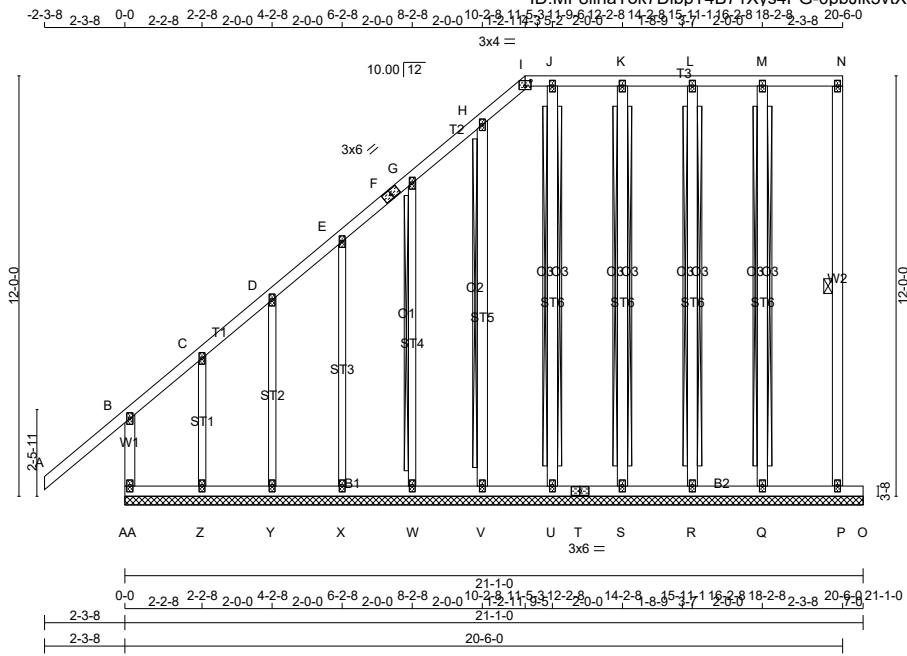

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - F 2x4 DRY No.2 SPF F - I 2x4 DRY No.2 SPF P - N 2x4 DRY No.2 SPF AA- B 2x4 DRY No.2 SPF I - N 2x4 DRY No.2 SPF AA- T 2x4 DRY No.2 SPF T - O 2x4 DRY No.2 SPF ALL WEBS 2x4 DRY No.2 SPF EXCEPT W - G 2x3 DRY No.2 SPF X - E 2x3 DRY No.2 SPF Y - D 2x3 DRY No.2 SPF Z - C 2x3 DRY No.2 SPF ALL GABLE WEBS 2x4 DRY No.2 SPF EXCEPT ST7 2x3 DRY No.2 SPF ST8 2x3 DRY No.2 SPF ST9 2x3 DRY No.2 SPF ST10 2x3 DRY No.2 SPF DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2-0-0 OC.					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS. THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE. <u>PROVIDE ANCHORAGE AT BEARING JOINT O FOR 150 LBS. FACTORED UPLIFT BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)</u> BRACING FOR SECTION I-N, MAX. PURLIN SPACING = 2.00 FT. FOR OTHER SECTIONS, TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. 1 LATERAL BRACE(S) AT 1/2 LENGTH OF N-P. 2x4 DRY SPF No.2 I-BRACE AT M-Q, L-R, K-S, J-U 2x4 DRY SPF No.2 T-BRACE AT H-V, G-W FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4)					DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 21.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 34.4 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON PIGGYBACK TRUSS WITH SLOPES OF 6.00/12 AND -6.00/12 AND RESPECTIVE WALL HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL DEAD LOAD OF 3.0 P.S.F. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018 , ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD CSI: TC=0.31/1.00 (A-B:1) , BC=0.08/1.00 (Z-AA:1) , WB=0.16/1.00 (M-Q:1) , SSI=0.11/1.00 (A-B:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.64 (I) (INPUT = 0.90) JSI METAL= 0.20 (B) (INPUT = 1.00)																																																																																																																																																																																																																																																																																																																																																																																																																																			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMV+p MT20 2.0 4.0 C, D, E, G, H, J, K, L, M C TMW+w MT20 2.0 4.0 F TS-t MT20 3.0 6.0 I TT-i MT20 3.0 4.0 1.75 2.00 N TMV+p MT20 2.0 4.0 P BMV1+p MT20 2.0 4.0 Q, R, S, U, V, W, X, Y, Z Q BMW1+w MT20 2.0 4.0 T BS-t MT20 3.0 6.0 AA BMV1+p MT20 2.0 4.0					<table><tr><th colspan="2">CHORDS</th><th colspan="2">MAX. FACTORED</th><th colspan="2">FACTORED</th><th colspan="2">VERT. LOAD LC1</th><th colspan="2">MAX. UNBRACED</th><th colspan="2">MEMB. FORCE</th><th colspan="2">MAX. FACTORED</th></tr><tr><th>MEMB.</th><th>FORCE (LBS)</th><th>VERT.</th><th>PLF</th><th>FROM</th><th>TO</th><th>CSI (LC)</th><th>MAX.</th><th>LENGTH</th><th>FR-TO</th><th>MEMB.</th><th>FORCE (LBS)</th><th>MAX.</th><th>CSI (LC)</th></tr><tr><td>FR-TO</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>A- B</td><td>0 / 60</td><td>-78.0</td><td>-78.0</td><td>0.31 (1)</td><td>10.00</td><td>Q- M</td><td>-204 / 0</td><td>0.16 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>B- C</td><td>-72 / 0</td><td>-78.0</td><td>-78.0</td><td>0.25 (1)</td><td>6.25</td><td>R- L</td><td>-165 / 0</td><td>0.13 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>C- D</td><td>0 / 4</td><td>-78.0</td><td>-78.0</td><td>0.05 (1)</td><td>10.00</td><td>S- K</td><td>-171 / 0</td><td>0.14 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>D- E</td><td>-9 / 0</td><td>-78.0</td><td>-78.0</td><td>0.05 (1)</td><td>10.00</td><td>U- J</td><td>-173 / 0</td><td>0.14 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>E- F</td><td>-4 / 0</td><td>-78.0</td><td>-78.0</td><td>0.03 (1)</td><td>10.00</td><td>V- H</td><td>-161 / 0</td><td>0.13 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>F- G</td><td>-4 / 0</td><td>-78.0</td><td>-78.0</td><td>0.03 (1)</td><td>10.00</td><td>W- G</td><td>-152 / 0</td><td>0.10 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>G- H</td><td>0 / 0</td><td>-78.0</td><td>-78.0</td><td>0.04 (1)</td><td>10.00</td><td>X- E</td><td>-150 / 0</td><td>0.16 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>H- I</td><td>-20 / 0</td><td>-78.0</td><td>-78.0</td><td>0.04 (1)</td><td>6.25</td><td>Y- D</td><td>-181 / 0</td><td>0.10 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>P- N</td><td>-83 / 0</td><td>0.0</td><td>0.0</td><td>0.01 (1)</td><td>6.25</td><td>Z- C</td><td>-42 / 0</td><td>0.01 (1)</td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>AA- B</td><td>-370 / 0</td><td>0.0</td><td>0.0</td><td>0.08 (1)</td><td>7.81</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>I- J</td><td>0 / 1</td><td>-85.5</td><td>-85.5</td><td>0.04 (1)</td><td>2.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>J- K</td><td>0 / 0</td><td>-85.5</td><td>-85.5</td><td>0.04 (1)</td><td>2.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>K- L</td><td>0 / 0</td><td>-85.5</td><td>-85.5</td><td>0.04 (1)</td><td>2.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>L- M</td><td>0 / 0</td><td>-85.5</td><td>-85.5</td><td>0.05 (1)</td><td>2.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>M- N</td><td>0 / 0</td><td>-85.5</td><td>-85.5</td><td>0.05 (1)</td><td>2.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>AA- Z</td><td>0 / 9</td><td>-18.5</td><td>-18.5</td><td>0.08 (1)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>Z- Y</td><td>0 / 8</td><td>-18.5</td><td>-18.5</td><td>0.02 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>Y- X</td><td>0 / 5</td><td>-18.5</td><td>-18.5</td><td>0.02 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>X- W</td><td>0 / 3</td><td>-18.5</td><td>-18.5</td><td>0.01 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>W- V</td><td>0 / 2</td><td>-18.5</td><td>-18.5</td><td>0.01 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>V- U</td><td>0 / 0</td><td>-18.5</td><td>-18.5</td><td>0.01 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>U- T</td><td>0 / 0</td><td>-18.5</td><td>-18.5</td><td>0.01 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>T- S</td><td>0 / 0</td><td>-18.5</td><td>-18.5</td><td>0.01 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>S- R</td><td>0 / 0</td><td>-18.5</td><td>-18.5</td><td>0.01 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>R- Q</td><td>0 / 0</td><td>-18.5</td><td>-18.5</td><td>0.02 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>Q- P</td><td>0 / 0</td><td>-18.5</td><td>-18.5</td><td>0.02 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr><tr><td>P- O</td><td>0 / 0</td><td>-18.5</td><td>-18.5</td><td>0.02 (4)</td><td>10.00</td><td></td><td></td><td></td><td></td><td></td><td></td><td></td><td></td></tr></table>					CHORDS		MAX. FACTORED		FACTORED		VERT. LOAD LC1		MAX. UNBRACED		MEMB. FORCE		MAX. FACTORED		MEMB.	FORCE (LBS)	VERT.	PLF	FROM	TO	CSI (LC)	MAX.	LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX.	CSI (LC)	FR-TO														A- B	0 / 60	-78.0	-78.0	0.31 (1)	10.00	Q- M	-204 / 0	0.16 (1)						B- C	-72 / 0	-78.0	-78.0	0.25 (1)	6.25	R- L	-165 / 0	0.13 (1)						C- D	0 / 4	-78.0	-78.0	0.05 (1)	10.00	S- K	-171 / 0	0.14 (1)						D- E	-9 / 0	-78.0	-78.0	0.05 (1)	10.00	U- J	-173 / 0	0.14 (1)						E- F	-4 / 0	-78.0	-78.0	0.03 (1)	10.00	V- H	-161 / 0	0.13 (1)						F- G	-4 / 0	-78.0	-78.0	0.03 (1)	10.00	W- G	-152 / 0	0.10 (1)						G- H	0 / 0	-78.0	-78.0	0.04 (1)	10.00	X- E	-150 / 0	0.16 (1)						H- I	-20 / 0	-78.0	-78.0	0.04 (1)	6.25	Y- D	-181 / 0	0.10 (1)						P- N	-83 / 0	0.0	0.0	0.01 (1)	6.25	Z- C	-42 / 0	0.01 (1)						AA- B	-370 / 0	0.0	0.0	0.08 (1)	7.81									I- J	0 / 1	-85.5	-85.5	0.04 (1)	2.00									J- K	0 / 0	-85.5	-85.5	0.04 (1)	2.00									K- L	0 / 0	-85.5	-85.5	0.04 (1)	2.00									L- M	0 / 0	-85.5	-85.5	0.05 (1)	2.00									M- N	0 / 0	-85.5	-85.5	0.05 (1)	2.00									AA- Z	0 / 9	-18.5	-18.5	0.08 (1)	10.00									Z- Y	0 / 8	-18.5	-18.5	0.02 (4)	10.00									Y- X	0 / 5	-18.5	-18.5	0.02 (4)	10.00									X- W	0 / 3	-18.5	-18.5	0.01 (4)	10.00									W- V	0 / 2	-18.5	-18.5	0.01 (4)	10.00									V- U	0 / 0	-18.5	-18.5	0.01 (4)	10.00									U- T	0 / 0	-18.5	-18.5	0.01 (4)	10.00									T- S	0 / 0	-18.5	-18.5	0.01 (4)	10.00									S- R	0 / 0	-18.5	-18.5	0.01 (4)	10.00									R- Q	0 / 0	-18.5	-18.5	0.02 (4)	10.00									Q- P	0 / 0	-18.5	-18.5	0.02 (4)	10.00									P- O	0 / 0	-18.5	-18.5	0.02 (4)	10.00								
CHORDS		MAX. FACTORED		FACTORED		VERT. LOAD LC1		MAX. UNBRACED		MEMB. FORCE		MAX. FACTORED																																																																																																																																																																																																																																																																																																																																																																																																																																	
MEMB.	FORCE (LBS)	VERT.	PLF	FROM	TO	CSI (LC)	MAX.	LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX.	CSI (LC)																																																																																																																																																																																																																																																																																																																																																																																																																																
FR-TO																																																																																																																																																																																																																																																																																																																																																																																																																																													
A- B	0 / 60	-78.0	-78.0	0.31 (1)	10.00	Q- M	-204 / 0	0.16 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
B- C	-72 / 0	-78.0	-78.0	0.25 (1)	6.25	R- L	-165 / 0	0.13 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
C- D	0 / 4	-78.0	-78.0	0.05 (1)	10.00	S- K	-171 / 0	0.14 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
D- E	-9 / 0	-78.0	-78.0	0.05 (1)	10.00	U- J	-173 / 0	0.14 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
E- F	-4 / 0	-78.0	-78.0	0.03 (1)	10.00	V- H	-161 / 0	0.13 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
F- G	-4 / 0	-78.0	-78.0	0.03 (1)	10.00	W- G	-152 / 0	0.10 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
G- H	0 / 0	-78.0	-78.0	0.04 (1)	10.00	X- E	-150 / 0	0.16 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
H- I	-20 / 0	-78.0	-78.0	0.04 (1)	6.25	Y- D	-181 / 0	0.10 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
P- N	-83 / 0	0.0	0.0	0.01 (1)	6.25	Z- C	-42 / 0	0.01 (1)																																																																																																																																																																																																																																																																																																																																																																																																																																					
AA- B	-370 / 0	0.0	0.0	0.08 (1)	7.81																																																																																																																																																																																																																																																																																																																																																																																																																																								
I- J	0 / 1	-85.5	-85.5	0.04 (1)	2.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
J- K	0 / 0	-85.5	-85.5	0.04 (1)	2.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
K- L	0 / 0	-85.5	-85.5	0.04 (1)	2.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
L- M	0 / 0	-85.5	-85.5	0.05 (1)	2.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
M- N	0 / 0	-85.5	-85.5	0.05 (1)	2.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
AA- Z	0 / 9	-18.5	-18.5	0.08 (1)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
Z- Y	0 / 8	-18.5	-18.5	0.02 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
Y- X	0 / 5	-18.5	-18.5	0.02 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
X- W	0 / 3	-18.5	-18.5	0.01 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
W- V	0 / 2	-18.5	-18.5	0.01 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
V- U	0 / 0	-18.5	-18.5	0.01 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
U- T	0 / 0	-18.5	-18.5	0.01 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
T- S	0 / 0	-18.5	-18.5	0.01 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
S- R	0 / 0	-18.5	-18.5	0.01 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
R- Q	0 / 0	-18.5	-18.5	0.02 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
Q- P	0 / 0	-18.5	-18.5	0.02 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
P- O	0 / 0	-18.5	-18.5	0.02 (4)	10.00																																																																																																																																																																																																																																																																																																																																																																																																																																								
LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2																																																																																																																																																																																																																																																																																																																																																																																																																																													

Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:22 2020 Page 1

ID:MF8iiriaTok7DlbpT4B71Xys4PG-V09iz46XeqB0pMk7vpcBoADX?IR3ksSqlxOhaVzXk5F

11-9-6

2-9-10

14-7-0

1-3-10

15-10-10

8-6

16-7-0


2-0-0

18-7-0

2-0-0

20-7-0

Scale = 1:15.3

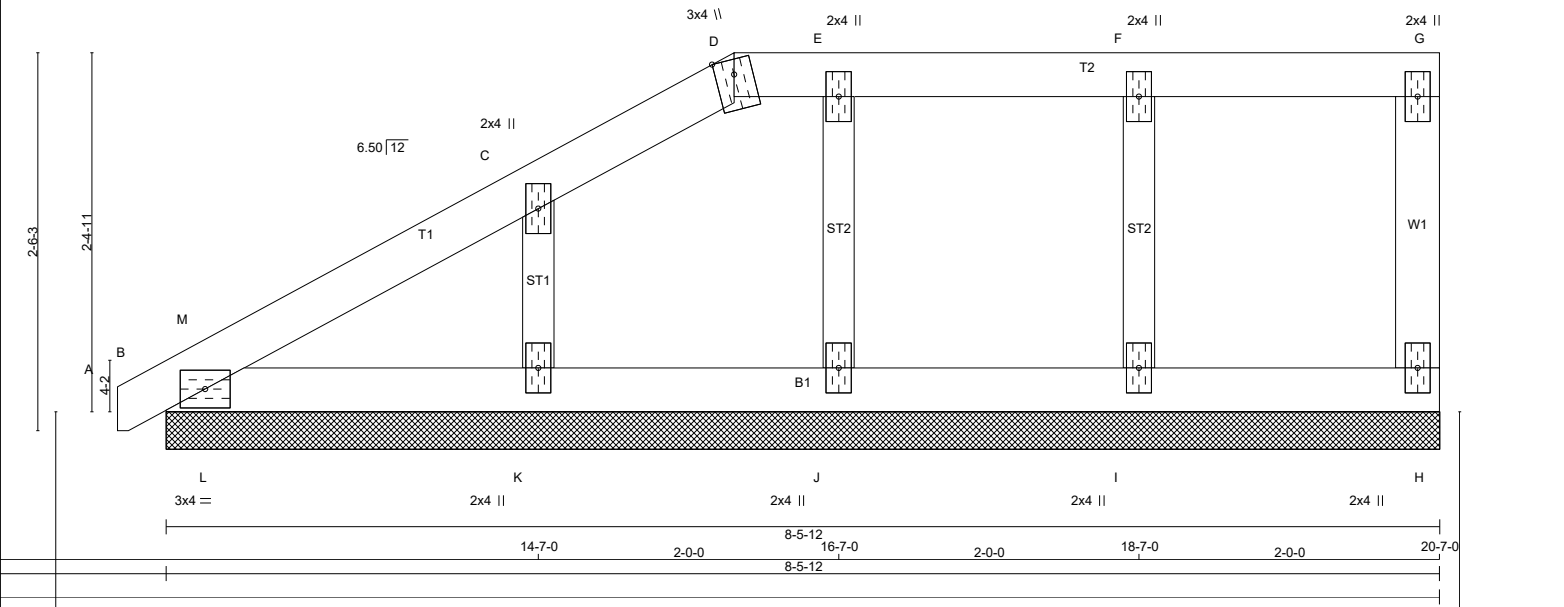


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER A - D 2x4 DRY No.2 D - G 2x4 DRY No.2 H - G 2x4 DRY No.2 B - H 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 EXCEPT ALL GABLE WEBS 2x3 DRY No.2 DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2-0-0 OC.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS. THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE. BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4)				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 21.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 34.4 PSF SPACING = 24.0 IN./C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 (55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD CSI: TC=0.06/1.00 (C-D:1), BC=0.03/1.00 (B-L:1), WB=0.03/1.00 (F-I:1), SSI=0.07/1.00 (F-G:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE RIGHT HEEL ONLY TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.11 (C) (INPUT = 0.90) JSI METAL= 0.08 (C) (INPUT = 1.00)			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMB1-I MT20 3.0 4.0 C, E, F C TMW+w MT20 2.0 4.0 D TT+m MT20 3.0 4.0 Edge G TMV+p MT20 2.0 4.0 H BMV1+p MT20 2.0 4.0 I, J, K I BMW1+w MT20 2.0 4.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				CHORDS MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD LC1 MAX (PLF) MAX. MEMB. FORCE (LBS) MAX. UNBRACED LENGTH FR-TO FROM TO A-B 0 / 6 -78.0 -78.0 0.01 (1) 10.00 B-M -18 / 0 -78.0 -78.0 0.01 (4) 6.25 M-C 0 / 1 -78.0 -78.0 0.06 (1) 10.00 C-D -14 / 0 -78.0 -78.0 0.06 (1) 6.25 D-E 0 / 0 -78.0 -78.0 0.05 (1) 10.00 E-F 0 / 0 -78.0 -78.0 0.05 (1) 10.00 F-G 0 / 0 -78.0 -78.0 0.04 (1) 10.00 H-G -63 / 0 0.0 0.0 0.01 (1) 7.81 B-L 0 / 9 -18.5 -18.5 0.03 (1) 10.00 L-K 0 / 9 -18.5 -18.5 0.03 (1) 10.00 K-J 0 / 0 -18.5 -18.5 0.03 (4) 10.00 J-I 0 / 0 -18.5 -18.5 0.02 (4) 10.00 I-H 0 / 0 -18.5 -18.5 0.02 (4) 10.00				TOTAL WEIGHT = 26 lb [M]			

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



Alpa Roof Truss, Maple



JSI GRIP= 0.64 (E) (INPUT = 0.90)
JSI METAL= 0.23 (C) (INPUT = 1.00)

Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 12:58:25 2020 Page 1



TOTAL WEIGHT = $7 \times 18 = 123 \text{ lb}$

LUMBER

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	2.0	4.0		
D	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
D	487	0	487	0	0	5-8	1-8
B	188	0	188	0	0	1-8	1-8
C	41	0	46	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	348	210 / 0	0 / 0	0 / 0	0 / 0	137 / 0	0 / 0
B	130	101 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0
C	33	0 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

C H O R D S					W E B S				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO						
D- A	-270 / 0	0.0	0.0	0.33 (1)	7.81				
A- B	-23 / 0	-78.0	-78.0	0.33 (1)	6.25				
E- D	0 / 0	-96.5	-96.5	0.16 (1)	10.00				
D- C	0 / 0	-18.5	-18.5	0.19 (4)	10.00				

LATERAL BRACE(S) SHOWN SHALL BE
2X4 SPF#2



DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	21.0	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				=	34.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF PART
9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= $L/120$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL)= $L/120$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.33/1.00 (A-D:1), BC=0.19/1.00 (C-D:4),
WB=0.00/1.00 (n/a:0), SSI=0.18/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (A) (INPUT = 0.90)
JSI METAL= 0.14 (A) (INPUT = 1.00)

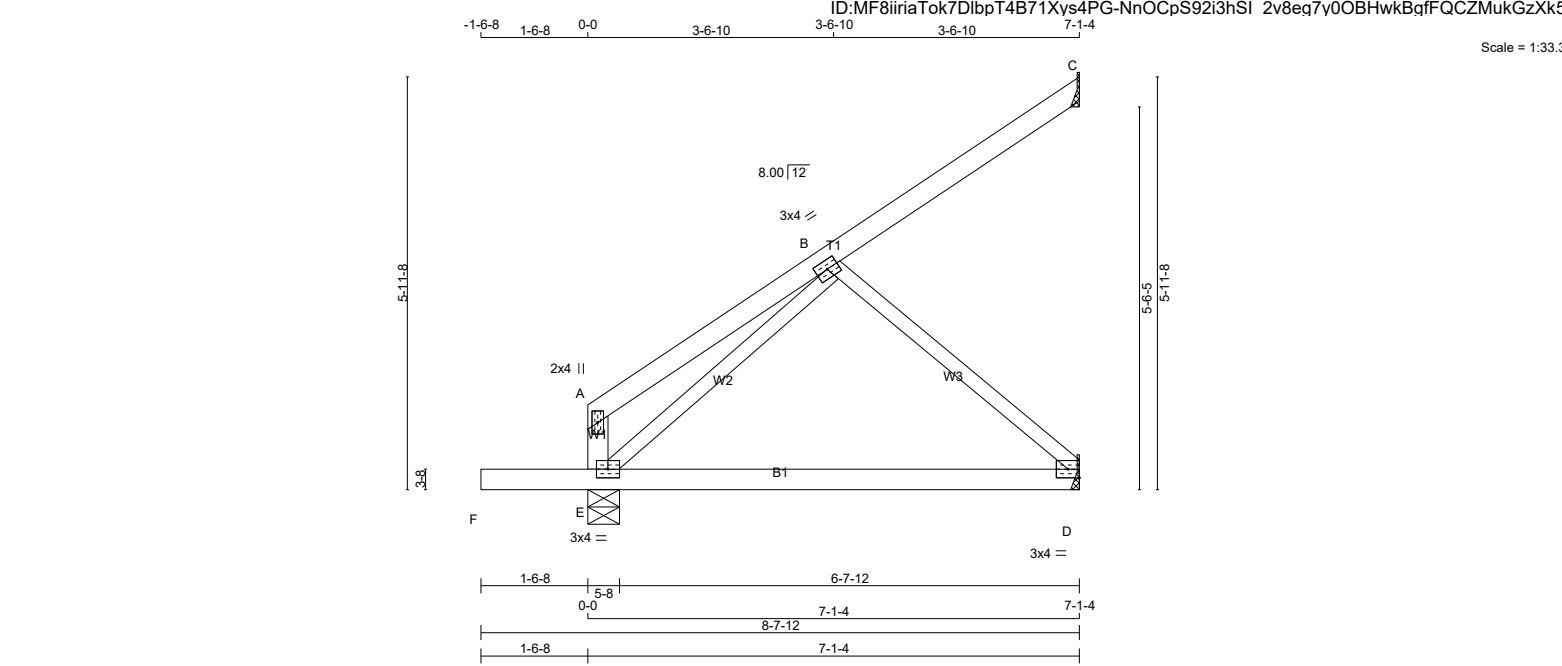

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	DRY	LUMBER	DESCR.
E - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	2.0	4.0	
B	TMWW-t	MT20	3.0	4.0	
D	BMW1-t	MT20	3.0	4.0	Edge
E	BMVW1-t	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT		VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX		
E		489	0	489	0	0	5-8	1-8	
C		110	0	110	0	0	MECHANICAL		
D		233	0	233	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C, D. MINIMUM BEARING LENGTH AT JOINT C = 1-8, JOINT D = 1-8.

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS							
JT	COMBINED	1ST LCASE	SNOW	MAX./MIN.	LIVE	PERM.LIVE	WIND
E	348	213 / 0	0 / 0		0 / 0	0 / 0	136 / 0
C	76	59 / 0	0 / 0		0 / 0	0 / 0	17 / 0
D	169	91 / 0	0 / 0		0 / 0	0 / 0	78 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
FR-TO		FROM	TO	FR-TO			
E-A	-100 / 0	0.0	0.0	0.01 (1)	7.81	E-B	-258 / 0
A-B	0 / 19	-78.0	-78.0	0.16 (1)	10.00	B-D	-253 / 0
B-C	-18 / 0	-78.0	-78.0	0.12 (1)	6.25		
F-E	0 / 0	-96.5	-96.5	0.16 (1)	10.00		
E-D	0 / 189	-18.5	-18.5	0.28 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	21.0 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD = 34.4 PSF			

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.23")
CALCULATED VERT. DEFL.(TL)= L/ 768 (0.11")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.01")

CSI: TC=0.16/1.00 (A-B:1) , BC=0.28/1.00 (D-E:4) ,
WB=0.10/1.00 (B-D:1) , SSI=0.12/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	650	371	1747	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.32 (E) (INPUT = 0.90)
JSI METAL= 0.07 (E) (INPUT = 1.00)

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2

Scale = 1:29.3

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318401	H2T		1	TRUSS DESC. JT 45147	E20035262

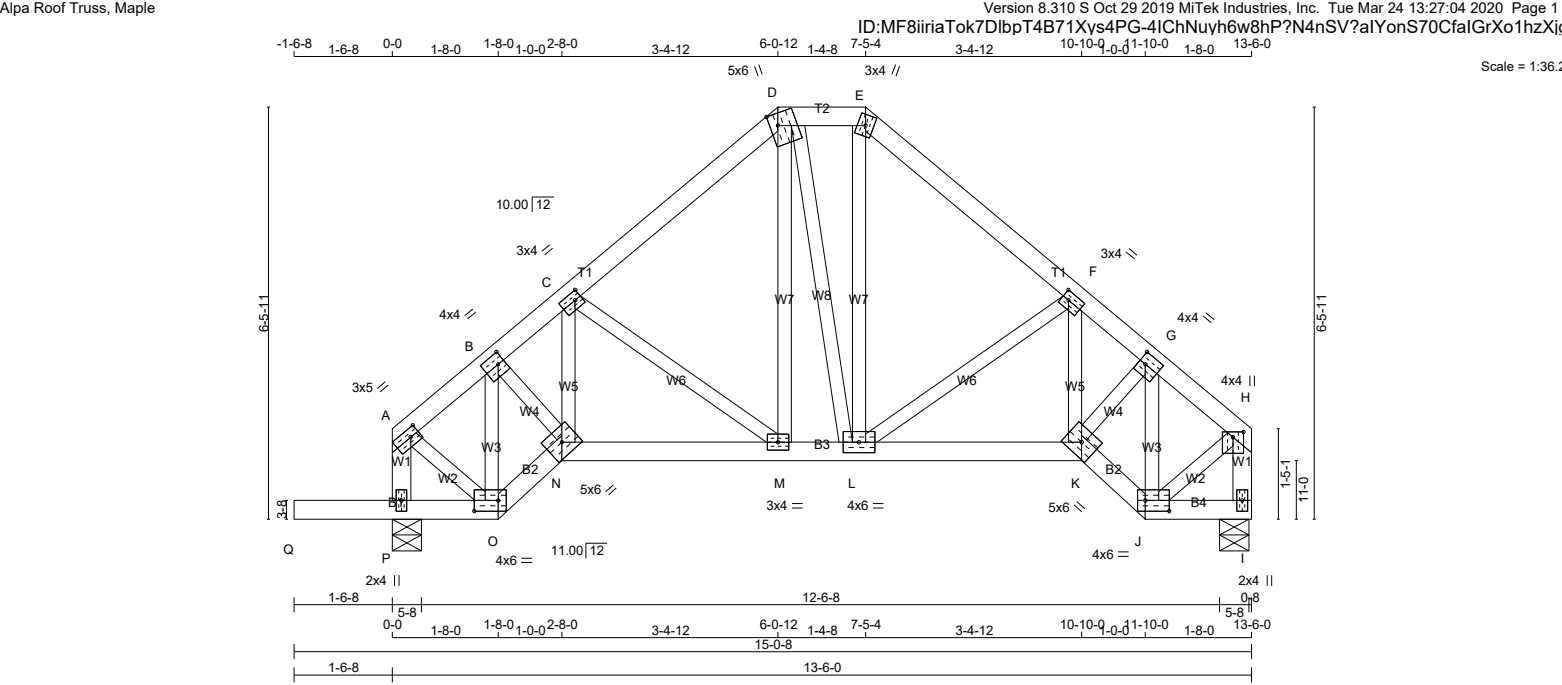

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - H	2x4	DRY	No.2
P - A	2x4	DRY	No.2
I - H	2x4	DRY	No.2
Q - O	2x4	DRY	No.2
O - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW-t	MT20	3.0	5.0 1.50 1.75
B	TMWW-t	MT20	4.0	4.0 2.00 1.25
C	TMWW-t	MT20	3.0	4.0 1.50 1.25
D	TTWW+m	MT20	5.0	6.0 2.25 1.50
E	TTW+m	MT20	3.0	4.0
F	TMWW-t	MT20	3.0	4.0 1.50 1.25
G	TMWW-t	MT20	4.0	4.0 2.00 1.25
H	TMVW+p	MT20	4.0	4.0 1.00 2.00
I	BMV1+p	MT20	2.0	4.0
J	BBWW-l	MT20	4.0	6.0 2.00 4.50
K	BBWW-h	MT20	5.0	6.0
L	BMWWW-t	MT20	4.0	6.0
M	BMWW-t	MT20	3.0	4.0
N	BBWW-h	MT20	5.0	6.0
O	BBWW-l	MT20	4.0	6.0 2.00 4.50
P	BMV1+p	MT20	2.0	4.0

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
I	643	0	643	0	5-8
P	808	0	808	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
I	458	280 / 0	0 / 0	0 / 0	0 / 0	179 / 0	0 / 0	
P	576	352 / 0	0 / 0	0 / 0	0 / 0	225 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, P

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING		TOTAL LOAD CASES: (4)									
		CHORDS					WEBS				
		MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
		FR-TO		FROM	TO	LENGTH	FR-TO				
		A-B	-454 / 0	-78.0	-78.0	0.03 (1)	6.25	O-B	-559 / 0	0.09 (1)	
		B-C	-706 / 0	-78.0	-78.0	0.08 (1)	6.25	B-N	0 / 419	0.09 (1)	
		C-D	-539 / 0	-78.0	-78.0	0.10 (1)	6.25	N-C	0 / 35	0.01 (4)	
		D-E	-409 / 0	-78.0	-78.0	0.02 (1)	6.25	C-M	-215 / 0	0.06 (1)	
		E-F	-544 / 0	-78.0	-78.0	0.10 (1)	6.25	M-D	0 / 161	0.04 (1)	
		F-G	-744 / 0	-78.0	-78.0	0.08 (1)	6.25	D-L	0 / 17	0.00 (1)	
		G-H	-500 / 0	-78.0	-78.0	0.04 (1)	6.25	L-E	0 / 181	0.04 (1)	
		P-A	-575 / 0	0.0	0.0	0.06 (1)	7.81	L-F	-244 / 0	0.07 (1)	
		I-H	-627 / 0	0.0	0.0	0.06 (1)	7.81	K-F	0 / 49	0.02 (4)	
								K-G	0 / 409	0.09 (1)	
		Q-P	0 / 0	-96.5	-96.5	0.16 (1)	10.00	J-G	-545 / 0	0.09 (1)	
		P-O	-1 / 0	-18.5	-18.5	0.12 (1)	10.00	A-O	0 / 410	0.09 (1)	
		O-N	0 / 436	-18.5	-18.5	0.07 (1)	10.00	J-H	0 / 451	0.10 (1)	
		N-M	0 / 575	-18.5	-18.5	0.12 (1)	10.00				
		M-L	0 / 405	-18.5	-18.5	0.10 (1)	10.00				
		L-K	0 / 603	-18.5	-18.5	0.13 (1)	10.00				
		K-J	0 / 484	-18.5	-18.5	0.08 (1)	10.00				
		J-I	0 / 0	-18.5	-18.5	0.02 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL	= 21.0 PSF
	DL	= 6.0 PSF
BOT CH.	LL	= 0.0 PSF
	DL	= 7.4 PSF
TOTAL LOAD = 34.4 PSF		

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.45")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.45")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 829 (0.02")

CSI: TC=0.10/1.00 (E-F:1) , BC=0.16/1.00 (P-Q:1) ,

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
MT20	650	371	1747	788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (A) (INPUT = 0.90)
JSI METAL= 0.14 (J) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318401	H3T		1	TRUSS DESC. JT 45147	E20035263

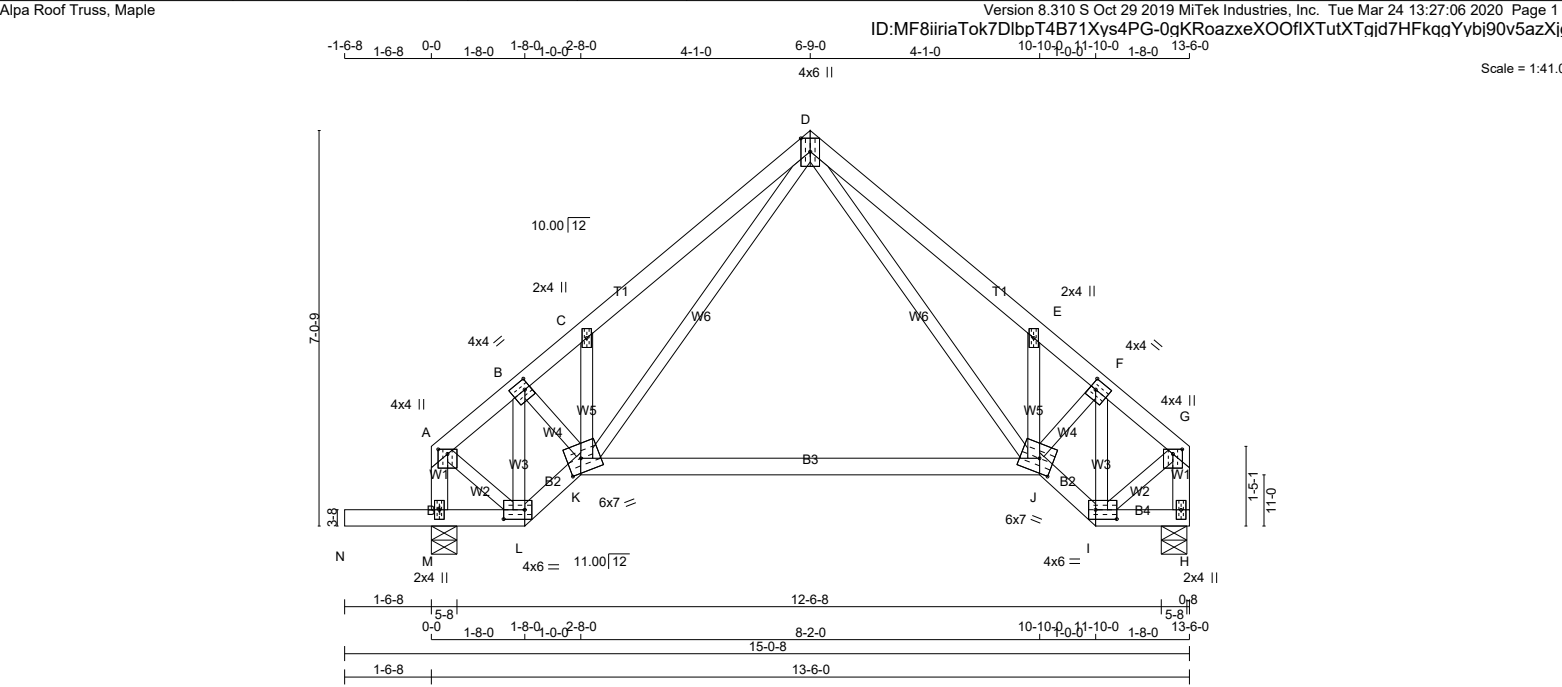

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x4 DRY No.2 SPF D - G 2x4 DRY No.2 SPF M - A 2x4 DRY No.2 SPF H - G 2x4 DRY No.2 SPF N - L 2x4 DRY No.2 SPF L - K 2x4 DRY No.2 SPF K - J 2x4 DRY No.2 SPF J - I 2x4 DRY No.2 SPF I - H 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQD JT VERT HORZ DOWN HORZ UPLIFT IN-SX BRG H 643 0 643 0 0 5-8 1-8 M 808 0 808 0 0 5-8 1-8 UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL H 458 280 / 0 0 / 0 0 / 0 0 / 0 179 / 0 0 / 0 M 576 352 / 0 0 / 0 0 / 0 0 / 0 225 / 0 0 / 0				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 21.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 34.4 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.45") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01") ALLOWABLE DEFL.(TL)= L/360 (0.45") CALCULATED VERT. DEFL.(TL) = L/ 709 (0.23") CANTILEVER DEFLECTION: ALLOWABLE DEFL.(LL)= L/120 (0.19") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01") ALLOWABLE DEFL.(TL)= L/120 (0.19") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02") CSI: TC=0.16/1.00 (D-E:1) , BC=0.39/1.00 (J-K:4) , WB=0.11/1.00 (D-J:1) , SSI=0.12/1.00 (M-N:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.66 (K) (INPUT = 0.90) JSI METAL= 0.18 (E) (INPUT = 1.00)			
--	--	--	--	--	--	--	--	--	--	--	--

DRY: SEASONED LUMBER.

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TMWW-t	MT20	4.0	4.0	2.00	1.25
C	TMW+w	MT20	2.0	4.0		
D	TTWW+p	MT20	4.0	6.0	Edge	
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0	2.00	1.25
G	TMVW+p	MT20	4.0	4.0	1.00	2.00
H	BMV1+p	MT20	2.0	4.0		
I	BBWW-l	MT20	4.0	6.0	2.00	4.50
J	BBWWW-m	MT20	6.0	7.0	3.00	3.00
K	BBWWW-m	MT20	6.0	7.0	3.00	3.00
L	BBWW-l	MT20	4.0	6.0	2.00	4.50
M	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318401	H8T		1	TRUSS DESC. JT 45147	E20035264

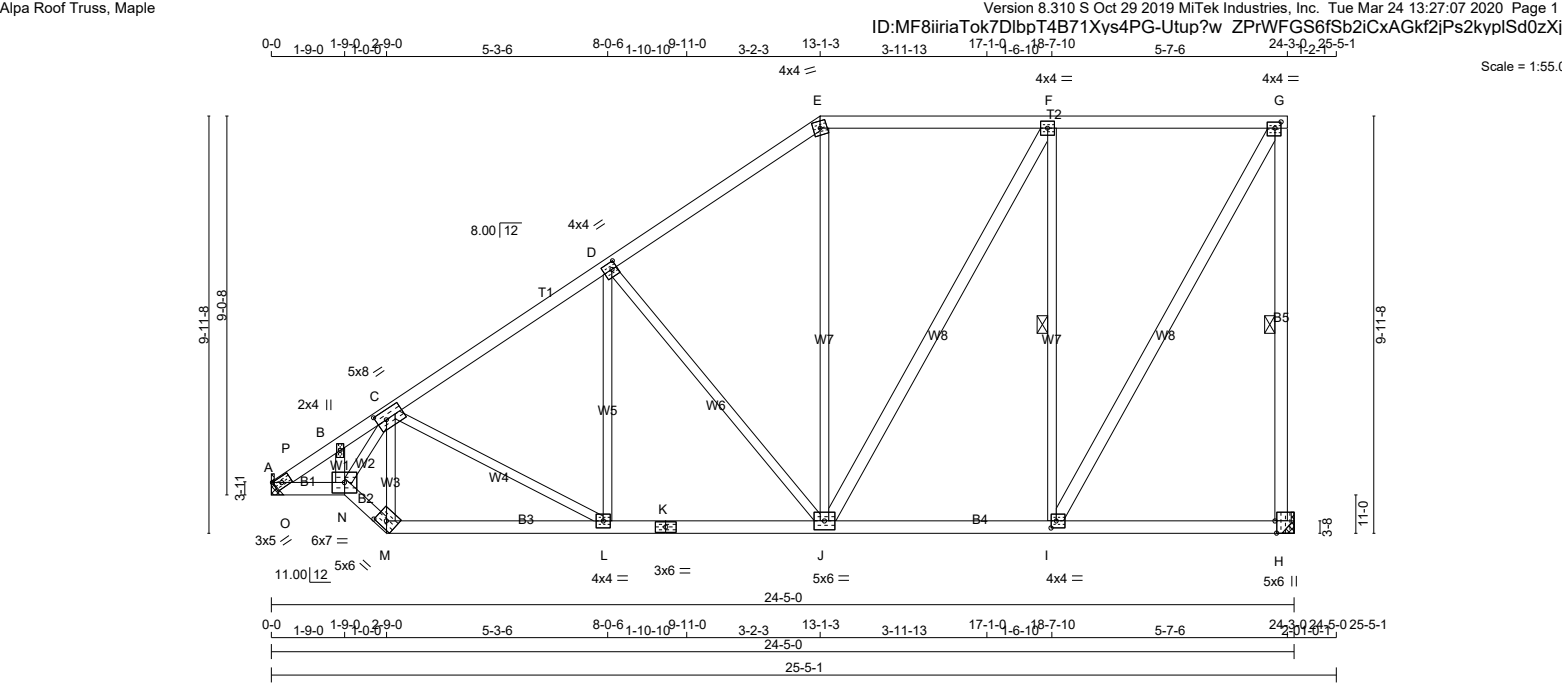

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
A - N	2x4	DRY	No.2
N - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
J - F	2x4	DRY	No.2
I - G	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TBM1-h	MT20	3.0	5.0	Edge 2.25
B	TMW+w	MT20	2.0	4.0	
C	TMWWW-t	MT20	5.0	8.0	2.50 2.75
D	TMWW-t	MT20	4.0	4.0	2.00 1.50
E	TTW-m	MT20	4.0	4.0	
F	TMWW-t	MT20	4.0	4.0	
G	TMVW-t	MT20	4.0	4.0	1.75 1.75
H	BMV1+p	MT20	5.0	6.0	Edge 0.50
I	BMWW-t	MT20	4.0	4.0	2.00 1.50
K	BS-t	MT20	3.0	6.0	
L	BMWW-t	MT20	4.0	4.0	
M	BBW-h	MT20	5.0	6.0	2.00 3.00
N	BBWW-l	MT20	6.0	7.0	
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.					

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM	FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
A	1163	0	1163	0	0	MECHANICAL
H	1163	0	1163	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT A, H. MINIMUM BEARING LENGTH AT JOINT A = 1-8, JOINT H = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	829	506 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0
H	829	506 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.71 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 5.99 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-I.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.		FORCE	VERT. LOAD	MEMB.		FORCE	MAX.
		(LBS)	(PLF)			(LBS)	CS (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A - P		-1858 / 0	-78.0 -78.0 0.04 (1)	N - B		0 / 162	0.04 (1)
P - B		-1939 / 0	-78.0 -78.0 0.15 (1)	N - C		0 / 1055	0.24 (1)
B - C		-1821 / 0	-78.0 -78.0 0.17 (1)	M - C		-919 / 0	0.17 (1)
C - D		-1237 / 0	-78.0 -78.0 0.26 (1)	J - E		0 / 161	0.04 (4)
D - E		-889 / 0	-78.0 -78.0 0.25 (1)	C - L		-67 / 0	0.04 (1)
E - F		-721 / 0	-78.0 -78.0 0.31 (1)	L - D		0 / 134	0.04 (4)
F - G		-544 / 0	-78.0 -78.0 0.30 (1)	D - J		-499 / 0	0.69 (1)
A - O		0 / 1571	-18.5 -18.5 0.33 (1)	J - F		0 / 362	0.06 (1)
O - N		0 / 1572	-18.5 -18.5 0.33 (1)	I - F		-846 / 0	0.57 (1)
N - M		0 / 1441	-18.5 -18.5 0.23 (1)	I - G		0 / 1104	0.18 (1)
M - L		0 / 1096	-18.5 -18.5 0.24 (1)	O - P		-208 / 0	0.00 (1)
L - K		0 / 1037	-18.5 -18.5 0.23 (1)				
K - J		0 / 1037	-18.5 -18.5 0.23 (1)				
J - I		0 / 544	-18.5 -18.5 0.19 (4)				
I - H		0 / 0	-18.5 -18.5 0.14 (4)				
H - G		-1122 / 0	0.0 0.0 0.54 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	21.0	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD		=	34.4	PSF	

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.80")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.80")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.09")

CSI: TC=0.31/1.00 (E-F:1) , BC=0.54/1.00 (G-H:1) , WB=0.69/1.00 (D-J:1) , SSI=0.21/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (A) (INPUT = 0.90)
JSI METAL= 0.62 (A) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318402	J04		1	TRUSS DESC. JT 45147	E20035275

Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 13:44:21 2020 Page 1

ID:MF8iiriaTok7DlbpT4B71Xys4PG-CoMj0TV9uXoYJM901lbB6 yDT27ggtxjhEAW4zXjQ8

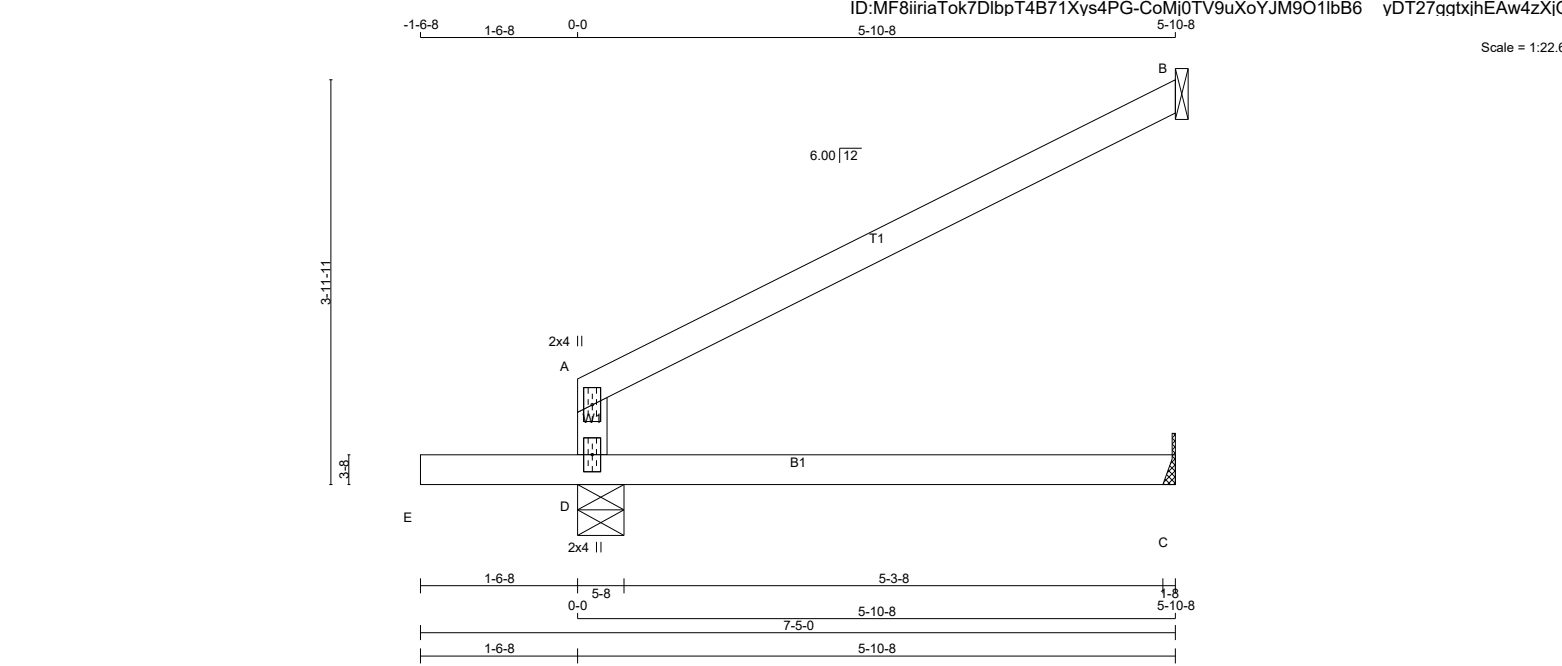

TOTAL WEIGHT = 5 X 17 = 84 lb [M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
D - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
E - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	2.0	4.0
D	BMV1+p	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
JT					IN-SX	IN-SX
D	489	0	489	0	5-8	1-8
B	186	0	186	0	1-8	1-8
C	41	0	46	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT C. MINIMUM BEARING LENGTH AT JOINT C = 1-8.

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) B

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
D	349	211 / 0	0 / 0	0 / 0	0 / 0	138 / 0	0 / 0
B	129	100 / 0	0 / 0	0 / 0	0 / 0	29 / 0	0 / 0
C	33	0 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		MAX. FACTORED		MAX. FACTORED	MEMB.	WEBS		MAX. FACTORED
	FORCE	VERT. LOAD	LC1	MAX	FORCE		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)	UNBRAC	(LBS)		(LBS)	CSI (LC)	
FR-TO		FROM	TO	LENGTH	FR-TO				
D-A	-272 / 0	0.0	0.0	0.34 (1)	7.81				
A-B	-19 / 0	-78.0	-78.0	0.34 (1)	6.25				
E-D	0 / 0	-96.5	-96.5	0.16 (1)	10.00				
D-C	0 / 0	-18.5	-18.5	0.19 (4)	10.00				

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	21.0	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD	=	34.4	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.34/1.00 (A-D:1) , BC=0.19/1.00 (C-D:4) ,
WB=0.00/1.00 (n/a:0) , SSI=0.19/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.15 (A) (INPUT = 0.90)
JSI METAL= 0.11 (A) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318403	H32T		1	TRUSS DESC. JT 45147	E20035277

Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 14:02:16 2020 Page 1

ID:MF8iiriaTok7DlbpT4B71Xys4PG-Ecp6e3VTjqE0nZr?V00HBh0f5plq2ly9wR8Z9GzXj9L

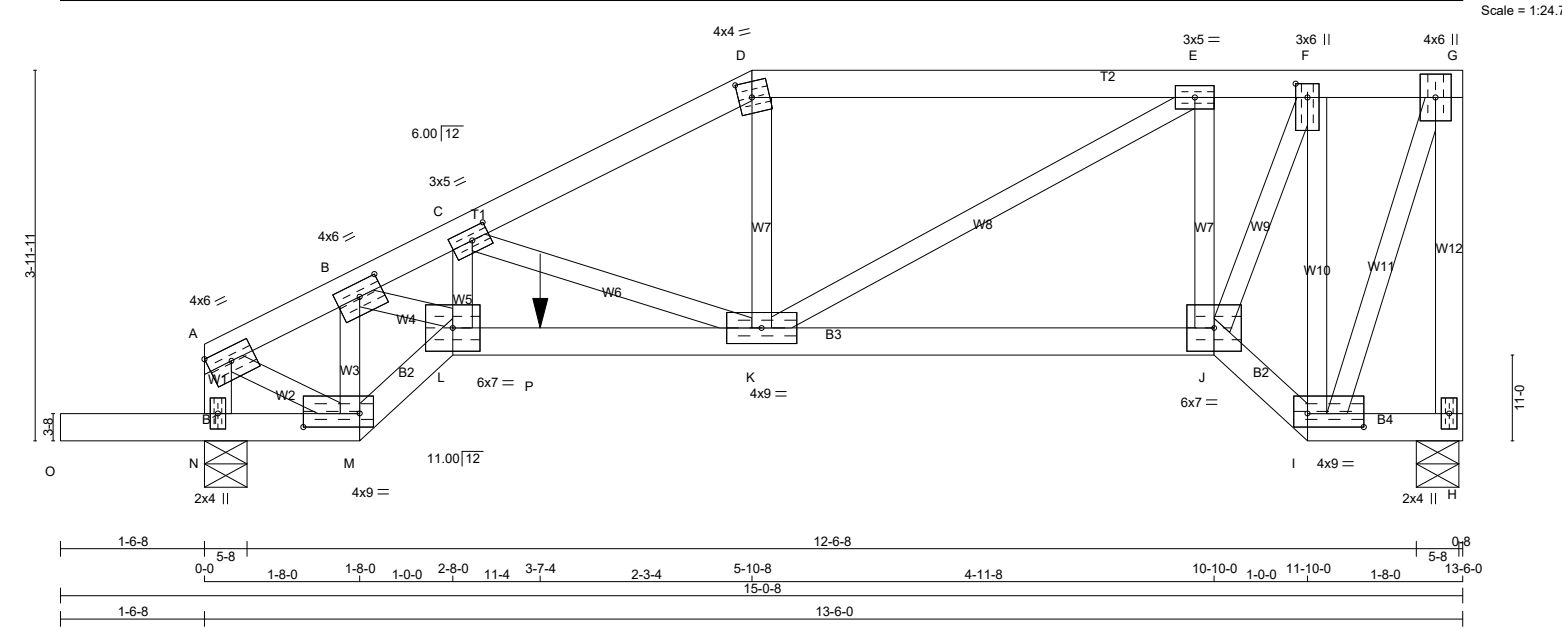

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x4 DRY No.2 SPF D - G 2x4 DRY No.2 SPF H - G 2x4 DRY No.2 SPF N - A 2x4 DRY No.2 SPF O - M 2x4 DRY No.2 SPF M - L 2x4 DRY No.2 SPF L - J 2x4 DRY No.2 SPF J - I 2x4 DRY No.2 SPF I - H 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQD JT VERT HORZ DOWN HORZ UPLIFT IN-SX BRG IN-SX BRG H 1346 0 1346 0 0 5-8 2-0 N 1522 0 1522 0 0 5-8 2-4 UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL H 958 592 / 0 0 / 0 0 / 0 367 / 0 0 / 0 N 1084 665 / 0 0 / 0 0 / 0 419 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, N BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.78 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MEMB. MAX. FACTORED FORCE (LBS) VERT. LOAD (PLF) MAX. FACTORED LOAD LC1 MAX. FACTORED LOAD LC2 MAX. FACTORED LOAD LC3 FR-TO FROM TO LENGTH FR-TO A-B -1449 / 0 -78.0 -78.0 0.10 (1) 5.30 M-B -1636 / 0 0.26 (1) B-C -3109 / 0 -78.0 -78.0 0.19 (1) 3.78 B-L 0 / 1825 0.45 (1) C-D -2038 / 0 -78.0 -78.0 0.21 (1) 4.52 L-C 0 / 625 0.15 (1) D-E -1845 / 0 -78.0 -78.0 0.31 (1) 4.58 C-K -979 / 0 0.23 (1) E-F -1116 / 0 -78.0 -78.0 0.25 (1) 5.64 K-D 0 / 634 0.16 (1) F-G -532 / 0 -153.5 -153.5 0.11 (1) 6.25 K-E 0 / 807 0.20 (1) H-G -1316 / 0 0.0 0.0 0.33 (1) 7.01 J-E -840 / 0 0.16 (1) N-A -1273 / 0 0.0 0.0 0.14 (1) 7.10 J-F 0 / 1680 0.42 (1) O-N 0 / 0 -96.5 -96.5 0.17 (1) 10.00 I-F -1529 / 0 0.39 (1) N-M -1 / 0 -37.2 -37.2 0.17 (1) 10.00 I-G 0 / 1283 0.32 (1) M-L 0 / 1587 -37.2 -37.2 0.29 (1) 10.00 A-M 0 / 1394 0.35 (1) L-P 0 / 2739 -37.2 -37.2 0.94 (1) 10.00 P-K 0 / 2739 -112.0 -112.0 0.94 (1) 10.00 K-J 0 / 1148 -112.0 -112.0 0.66 (1) 10.00 J-I 0 / 663 -112.0 -112.0 0.14 (1) 10.00 I-H 0 / 0 -36.4 -36.4 0.03 (4) 10.00 WEBS MEMB. MAX. FACTORED FORCE (LBS) MAX. FACTORED LOAD LC1 MAX. FACTORED LOAD LC2 MAX. FACTORED LOAD LC3 FR-TO FROM TO LENGTH FR-TO A-B -1449 / 0 -78.0 -78.0 0.10 (1) 5.30 M-B -1636 / 0 0.26 (1) B-C -3109 / 0 -78.0 -78.0 0.19 (1) 3.78 B-L 0 / 1825 0.45 (1) C-D -2038 / 0 -78.0 -78.0 0.21 (1) 4.52 L-C 0 / 625 0.15 (1) D-E -1845 / 0 -78.0 -78.0 0.31 (1) 4.58 C-K -979 / 0 0.23 (1) E-F -1116 / 0 -78.0 -78.0 0.25 (1) 5.64 K-D 0 / 634 0.16 (1) F-G -532 / 0 -153.5 -153.5 0.11 (1) 6.25 K-E 0 / 807 0.20 (1) H-G -1316 / 0 0.0 0.0 0.33 (1) 7.01 J-E -840 / 0 0.16 (1) N-A -1273 / 0 0.0 0.0 0.14 (1) 7.10 J-F 0 / 1680 0.42 (1) O-N 0 / 0 -96.5 -96.5 0.17 (1) 10.00 I-F -1529 / 0 0.39 (1) N-M -1 / 0 -37.2 -37.2 0.17 (1) 10.00 I-G 0 / 1283 0.32 (1) M-L 0 / 1587 -37.2 -37.2 0.29 (1) 10.00 A-M 0 / 1394 0.35 (1) L-P 0 / 2739 -37.2 -37.2 0.94 (1) 10.00 P-K 0 / 2739 -112.0 -112.0 0.94 (1) 10.00 K-J 0 / 1148 -112.0 -112.0 0.66 (1) 10.00 J-I 0 / 663 -112.0 -112.0 0.14 (1) 10.00 I-H 0 / 0 -36.4 -36.4 0.03 (4) 10.00 PLATES (table is in inches) JT TYPE PLATES W LEN Y X A TMVW-t MT20 4.0 6.0 1.75 Edge B TMWW-t MT20 4.0 6.0 1.75 3.00 C TMWW-t MT20 3.0 5.0 1.50 2.25 D TTW-m MT20 4.0 4.0 2.00 1.75 E TMWW-t MT20 3.0 5.0 F TMWW-t MT20 3.0 6.0 1.75 1.50 G TMVW-p MT20 4.0 6.0 H BMV1+p MT20 2.0 4.0 I BBWW-l MT20 4.0 9.0 1.75 7.25 J BBWW-l MT20 6.0 7.0 K BMWWW-t MT20 4.0 9.0 L BBWW-l MT20 6.0 7.0 M BBWW-l MT20 4.0 9.0 1.75 7.25 N BMV1+p MT20 2.0 4.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				DESIGN CRITERIA *** SPECIAL LOADS ANALYSIS *** GEOMETRY AND/OR BASIC LOADS CHANGED BY USER. LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE SPECIFIED LOADS: TOP CH. LL = 21.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 34.4 PSF SPACING = 24.0 IN./C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM GIRDER TYPE: CStdGirder START DISTANCE = 3-7-4 START SPAN CARRIED = 5-10-8 END DISTANCE = 11-10-0 END SPAN CARRIED = 5-10-8 END WALL WIDTH = 0-0 APPLIED TO FRONT SIDE OF BOTTOM CHORD. - ADDTL LOADS BASED ON 55 % OF GSL. GIRDER TYPE: CPrimeHip LEFT SETBACK = 5-10-8 RIGHT SETBACK = 0-0 END SETBACK = 5-10-8 END WALL WIDTH = 0-0 CORNER FRAMING TYPE: CONVENTIONAL END JACK TYPE: CONVENTIONAL APPLIED TO FRONT SIDE - ADDTL LOADS BASED ON 55 % OF GSL. LOADS APPLIED TO FIRST 1-8-0 OF SPAN MEASURED FROM THE RIGHT. *** NON STANDARD GIRDER *** ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018 , ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 DESIGN ASSUMPTIONS - OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.45") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.08") ALLOWABLE DEFL.(TL)= L/360 (0.45") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.16") CANTILEVER DEFLECTION: ALLOWABLE DEFL.(LL)= L/120 (0.19") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01") ALLOWABLE DEFL.(TL)= L/120 (0.19") TOTAL WEIGHT = 62 lb			
---	--	--	--	--	--	--	--	---	--	--	--

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2




CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

Scale = 1:57.3

JSI GRIP= 0.89 (J) (INPUT = 0.90)
JSI METAL= 0.61 (T) (INPUT = 1.00)

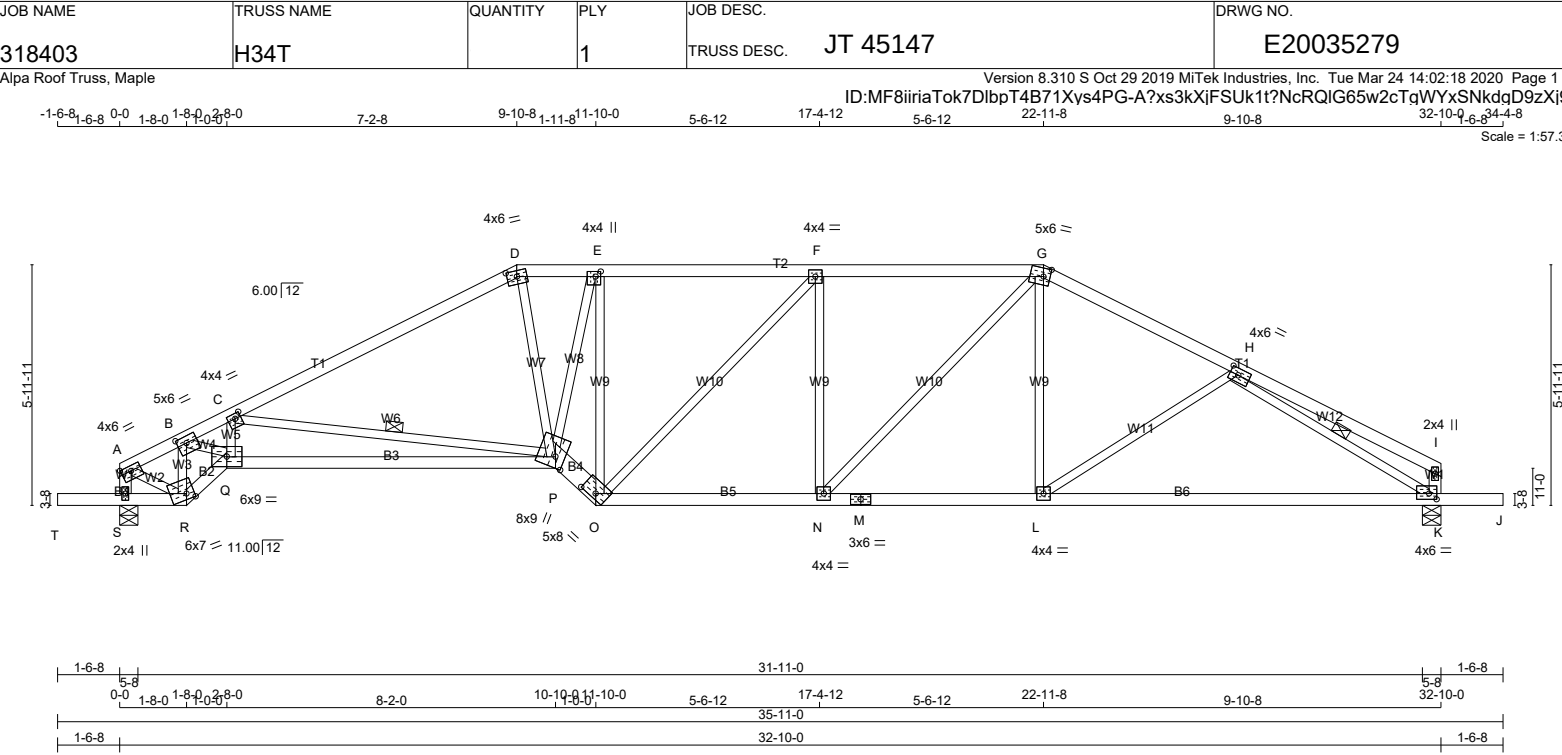

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
S - A	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
T - R	2x4	DRY No.2	SPF
R - Q	2x4	DRY No.2	SPF
Q - P	2x4	DRY No.2	SPF
P - O	2x6	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMVW-t	MT20	4.0	6.0 1.50 3.00
B	TMWW-t	MT20	5.0	6.0 2.00 2.75
C	TMWW-t	MT20	4.0	4.0 1.50 1.75
D	TTW-m	MT20	4.0	6.0 1.75 3.00
E	TMWW-t	MT20	4.0	4.0 1.50 1.50
F	TMWW-t	MT20	4.0	4.0
G	TTWW-m	MT20	5.0	6.0 2.50 2.00
H	TMWW-t	MT20	4.0	6.0 2.00 2.50
I	TMV-p	MT20	2.0	4.0
K	BMVW1-t	MT20	4.0	6.0 1.75 2.25
L	BMWW-t	MT20	4.0	4.0
M	BS-t	MT20	3.0	6.0
N	BMWW-t	MT20	4.0	4.0
O	BBWW-h	MT20	5.0	8.0 1.50 4.50
P	BMBWWW+m	MT20	8.0	9.0 3.25 2.75
Q	BBWW-l	MT20	6.0	9.0
R	BBWW-m	MT20	6.0	7.0 1.75 2.25
S	BMV1+p	MT20	2.0	4.0

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	1736	0	1736	0	0
K	1729	0	1729	0	0

UNFACTORED REACTIONS		1ST LCASE	MAX /MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
S	1238	755 / 0	0 / 0
K	1233	752 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.10 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, H-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED UNBRACED LENGTH (FT)	MAX LC1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	-1692 / 0	-78.0	-78.0 0.16 (1)	4.97	R-B	-1910 / 0	0.28 (1)
B-C	-3891 / 0	-78.0	-78.0 0.49 (1)	3.10	B-Q	0 / 2559	0.58 (1)
C-D	-2554 / 0	-78.0	-78.0 0.69 (1)	3.67	Q-C	0 / 153	0.05 (4)
D-E	-2443 / 0	-78.0	-78.0 0.17 (1)	4.27	C-P	-1362 / 0	0.61 (1)
E-F	-2150 / 0	-78.0	-78.0 0.34 (1)	4.32	D-P	0 / 884	0.20 (1)
F-G	-2319 / 0	-78.0	-78.0 0.36 (1)	4.17	P-E	0 / 1411	0.32 (1)
G-H	-2195 / 0	-78.0	-78.0 0.29 (1)	4.35	O-E	-1681 / 0	0.93 (1)
H-I	0 / 18	-78.0	-78.0 0.28 (1)	10.00	O-F	-240 / 0	0.30 (1)
S-A	-1503 / 0	0.0	0.0 0.15 (1)	6.70	N-F	-330 / 0	0.18 (1)
K-I	-156 / 0	0.0	0.0 0.02 (1)	7.81	N-G	0 / 528	0.12 (1)
					L-G	0 / 281	0.07 (4)
T-S	0 / 0	-96.5	-96.5 0.16 (1)	10.00	L-H	-177 / 10	0.11 (1)
S-R	-1 / 0	-18.5	-18.5 0.12 (1)	10.00	A-R	0 / 1609	0.36 (1)
R-Q	0 / 1830	-18.5	-18.5 0.30 (1)	10.00	H-K	-2489 / 0	0.64 (1)
Q-P	0 / 3615	-18.5	-18.5 0.79 (1)	10.00			
P-O	0 / 2875	-18.5	-18.5 0.34 (1)	10.00			
O-N	0 / 2320	-18.5	-18.5 0.46 (1)	10.00			
N-M	0 / 1950	-18.5	-18.5 0.58 (4)	10.00			
M-L	0 / 1950	-18.5	-18.5 0.58 (4)	10.00			
L-K	0 / 2092	-18.5	-18.5 0.57 (4)	10.00			
K-J	0 / 0	-96.5	-96.5 0.16 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	21.0 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD = 34.4 PSF			

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.09")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.17")
ALLOWABLE DEFL.(TL)= L/360 (1.09")
CALCULATED VERT. DEFL.(TL)= L/ 809 (0.49")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 344 (0.05")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL)= L/ 177 (0.10")

CSI: TC=0.69/1.00 (C-D:1), BC=0.79/1.00 (P-Q:1), WB=0.93/1.00 (E-O:1), SSI=0.29/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	650	371	1747	788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.56 (M) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318403	H42TA		3	TRUSS DESC. JT 45147	E20035280

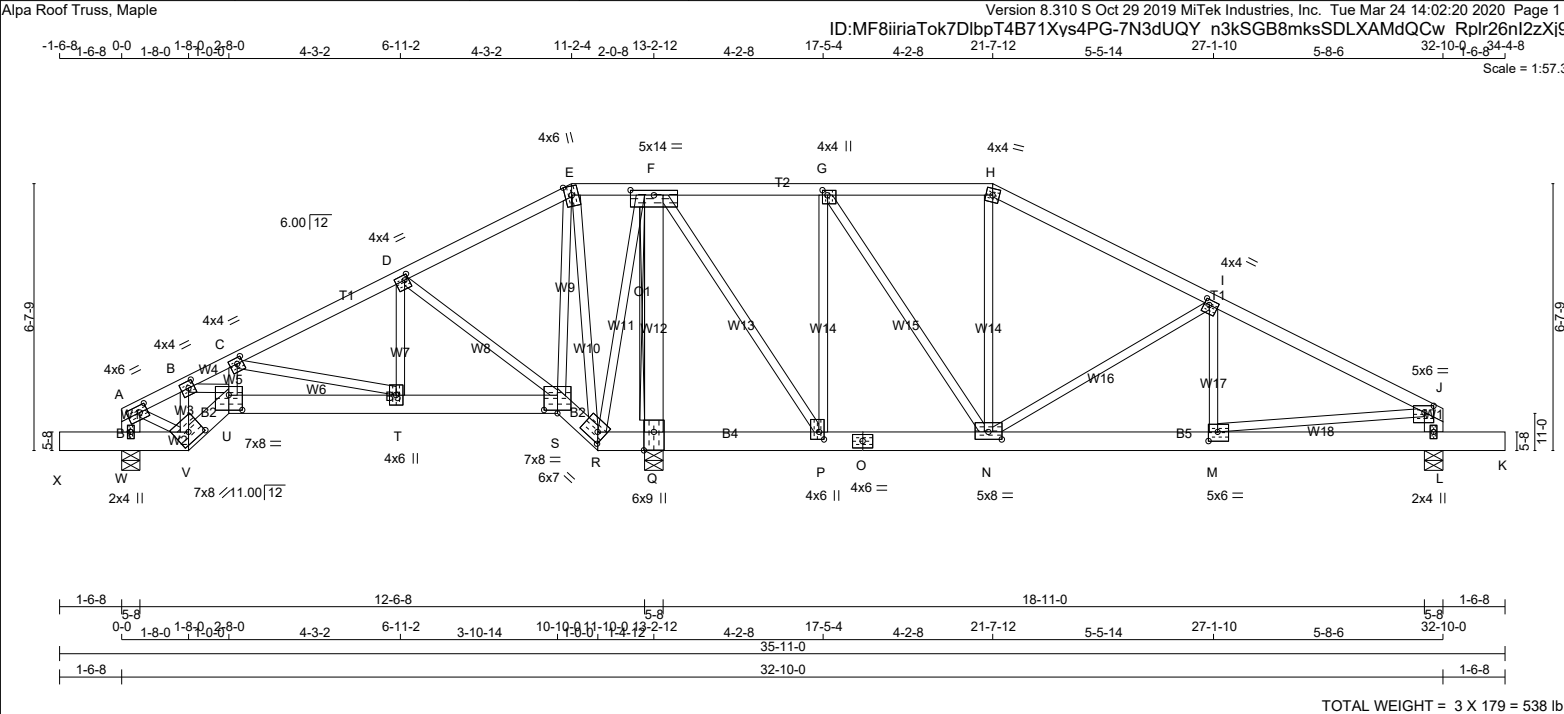

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318403	H42TA		3	TRUSS DESC. JT 45147	E20035280(2)

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	6.0	2.00	2.25
B	TMWW-t	MT20	4.0	4.0	2.00	1.75
C	TMWW-t	MT20	4.0	4.0	1.75	1.75
D	TMWW-t	MT20	4.0	4.0	1.50	1.25
E	TTWW+m	MT20	4.0	6.0	Edge	
F	TMWWW-t	MT20	5.0	14.0	1.50	7.00
G	TMWW+t	MT20	4.0	4.0	1.50	1.50
H	TTW-m	MT20	4.0	4.0		
I	TMWW-t	MT20	4.0	4.0	1.50	1.50
J	TMVW-p	MT20	5.0	6.0	2.00	2.75
L	BMV1+p	MT20	2.0	4.0		
M	BMWW-t	MT20	5.0	6.0	2.75	2.75
N	BMWWW-t	MT20	5.0	8.0	2.25	4.00
O	BS-t	MT20	4.0	6.0		
P	BMWW+t	MT20	4.0	6.0	2.25	1.50
Q	BMW1+t	MT20	6.0	9.0	Edge	3.00
R	BBWW-h	MT20	6.0	7.0	2.75	2.25
S	BBWW-l	MT20	7.0	8.0	1.00	4.00
T	BMWW+t	MT20	4.0	6.0		
U	BBWW-l	MT20	7.0	8.0	4.50	4.00
V	BBWW-h	MT20	7.0	8.0	3.00	4.00
W	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (G) (INPUT = 0.90)

JSI METAL= 0.58 (P) (INPUT = 1.00)

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
318403	J04T		1	TRUSS DESC. JT 45147	E20035281

Alpa Roof Truss, Maple

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 14:02:21 2020 Page 1

ID:MF8iiriaTok7DlbpT4B71Xys4PG-bad?hmZcYNsluKijlZ Sukjacqelj63u3irKqUzXj9G

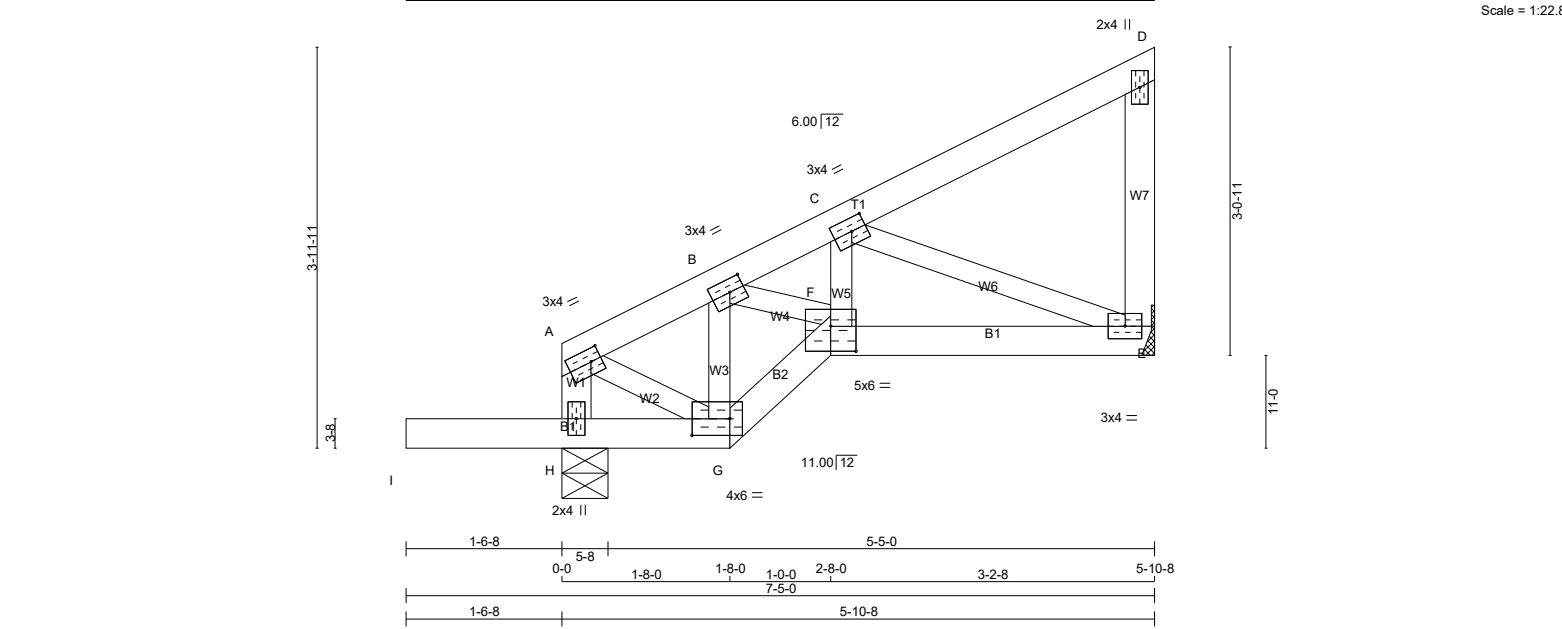

TOTAL WEIGHT = 3 X 26 = 79 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
H - A	2x4	DRY	No.2
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
I - G	2x4	DRY	No.2
G - F	2x4	DRY	No.2
F - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-t	MT20	3.0	4.0	1.50 1.25
B	TMWW-t	MT20	3.0	4.0	1.50 1.75
C	TMWW-t	MT20	3.0	4.0	1.50 1.75
D	TMV+p	MT20	2.0	4.0	
E	BMVW1-t	MT20	3.0	4.0	
F	BBWW-I	MT20	5.0	6.0	3.00 3.00
G	BBWW-I	MT20	4.0	6.0	2.00 4.50
H	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM	FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
H	452	0	452	0	0	5-8
E	264	0	264	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	322	197 / 0	0 / 0	0 / 0	0 / 0	125 / 0	0 / 0
E	188	115 / 0	0 / 0	0 / 0	0 / 0	73 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
H-A	-219 / 0	0.0	0.0	0.02 (1)	7.81	A-G	0 / 184
A-B	-191 / 0	-78.0	-78.0	0.03 (1)	6.25	G-B	-256 / 0
B-C	-376 / 0	-78.0	-78.0	0.08 (1)	6.25	B-F	0 / 230
C-D	-8 / 0	-78.0	-78.0	0.09 (1)	10.00	F-C	0 / 76
E-D	-102 / 0	0.0	0.0	0.02 (1)	7.81	C-E	-375 / 0
I-H	0 / 0	-96.5	-96.5	0.16 (1)	10.00		
H-G	-1 / 0	-18.5	-18.5	0.16 (1)	10.00		
G-F	0 / 206	-18.5	-18.5	0.04 (1)	10.00		
F-E	0 / 350	-18.5	-18.5	0.09 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	21.0 PSF
	DL	=	6.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD = 34.4 PSF			

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= L/120 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/120 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 681 (0.03")

CSI: TC=0.09/1.00 (C-D:1) , BC=0.16/1.00 (G-H:1) ,
WB=0.08/1.00 (C-E:1) , SSI=0.12/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (E) (INPUT = 0.90)
JSI METAL= 0.12 (E) (INPUT = 1.00)

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2



Scale = 1:17.6

CONTINUED ON PAGE 2

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Mar 24 14:02:22 2020 Page 1



TOTAL WEIGHT = 26 lb

DESCR.	SPF	SPF	SPF	SPF	SPF	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

BEARINGS							
FACTORED GROSS REACTION			MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
E	264	0	264	0	0	MECHANICAL	
H	452	0	452	0	0	5-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED				
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A - B	-191 / 0	-78.0	-78.0	0.03 (1)	6.25	G - B	-256 / 0	0.04 (1)	
B - C	-376 / 0	-78.0	-78.0	0.08 (1)	6.25	B - F	0 / 230	0.05 (1)	
C - D	-8 / 0	-78.0	-78.0	0.09 (1)	10.00	F - C	0 / 76	0.02 (4)	
E - D	-102 / 0	0.0	0.0	0.02 (1)	7.81	C - E	-375 / 0	0.08 (1)	
H - A	-219 / 0	0.0	0.0	0.02 (1)	7.81	A - G	0 / 184	0.04 (1)	
I - H	0 / 0	-96.5	-96.5	0.16 (1)	10.00				
H - G	-1 / 0	-18.5	-18.5	0.16 (1)	10.00				
G - F	0 / 206	-18.5	-18.5	0.04 (1)	10.00				
F - E	0 / 350	-18.5	-18.5	0.09 (1)	10.00				

LATERAL BRACE(S) SHOWN SHALL BE
2X4 SPF#2



DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	21.0	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL LOAD				=	34.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF PART
9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CANTILEVER DEFLECTION:
ALLOWABLE DEFL.(LL)= $L/120$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL)= $L/120$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/681$ (0.03")

CSI: TC=0.09/1.00 (C-D:1), BC=0.16/1.00 (G-H:1), WB=0.08/1.00 (C-E:1), SSI=0.12/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (E) (INPUT = 0.90)
JSI METAL= 0.12 (E) (INPUT = 1.00)

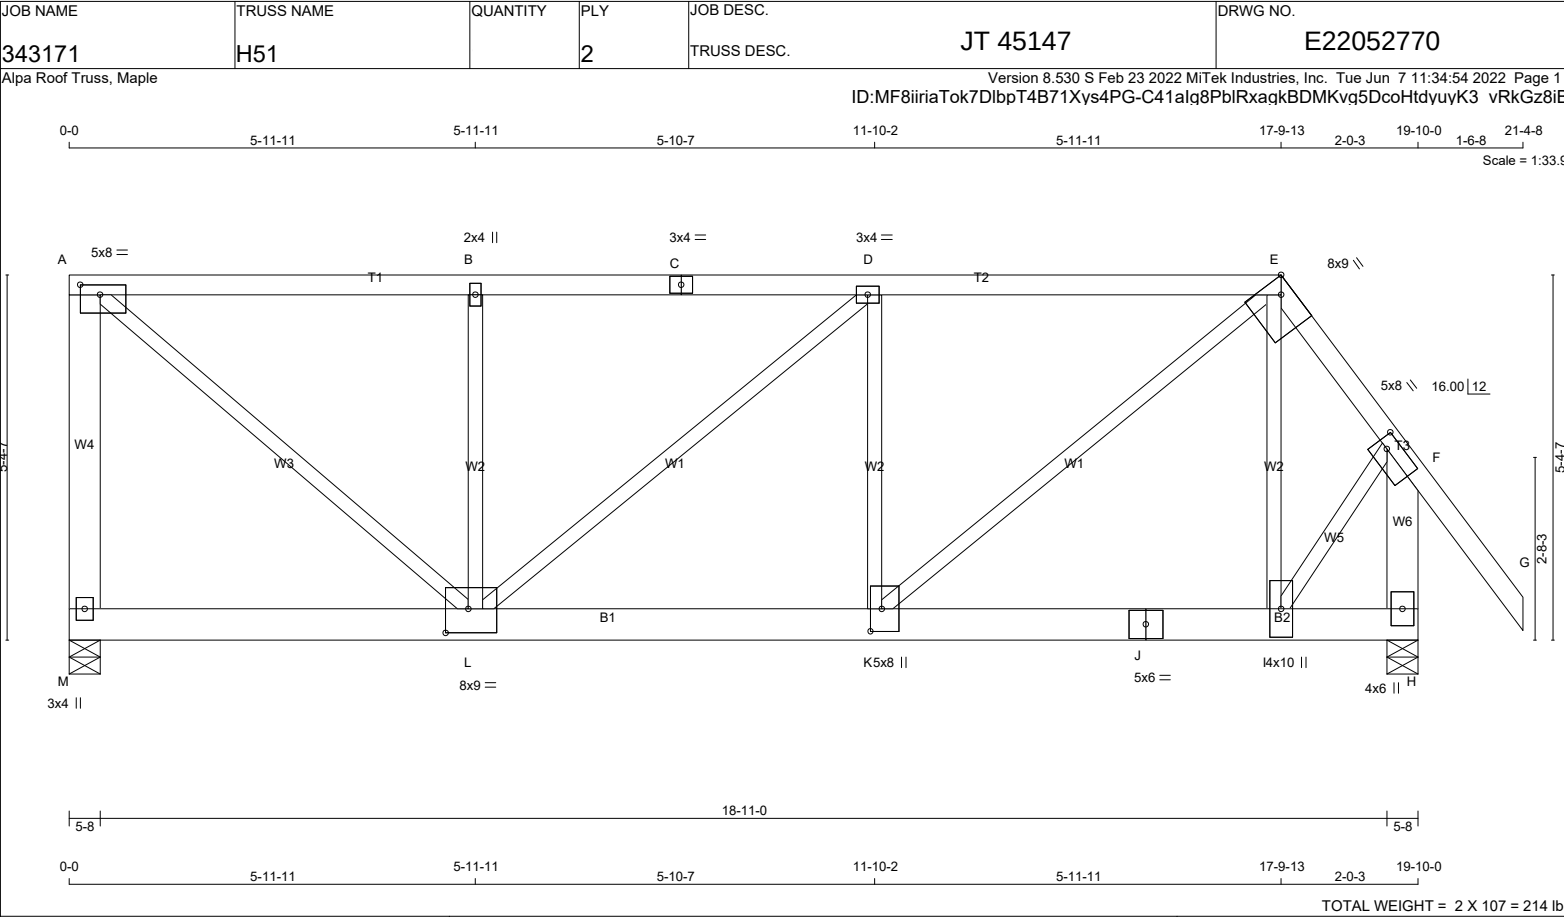

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
343171	H53		1	JT 45147	E22052772

Alpa Roof Truss, Maple

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Jun 7 11:34:57 2022 Page 1
 ID:MF8iiriaTok7DlbpT4B71Xys4PG-dfjixhAHuqpvVR7TmuUtlckr6SU1y9E?mly75Lbz8iE

Scale = 1:56.8

TOTAL WEIGHT = 162 lb

LUMBER		N. L. G. A. RULES		CHORDS		SIZE		LUMBER		DESCR.	
A	-	C	2x4	DRY	No.2	SPF					
C	-	E	2x4	DRY	1650F 1.5E	SPF					
E	-	G	2x4	DRY	1650F 1.5E	SPF					
G	-	I	2x4	DRY	No.2	SPF					
Q	-	B	2x4	DRY	No.2	SPF					
J	-	H	2x4	DRY	No.2	SPF					
Q	-	O	2x4	DRY	No.2	SPF					
O	-	L	2x4	DRY	No.2	SPF					
L	-	J	2x4	DRY	No.2	SPF					
ALL WEBS		2x3	DRY	No.2	SPF						
EXCEPT											
C	-	N	2x4	DRY	No.2	SPF					
N	-	F	2x4	DRY	No.2	SPF					
M	-	G	2x4	DRY	No.2	SPF					
DRY: SEASONED LUMBER.											
PLATES (table is in inches)											
JT	TYPE	PLATES	W	LEN	Y	X					
B	TMWV+p	MT20	4.0	6.0	2.00	2.25					
C	TTWW-h	MT20	6.0	7.0	1.50	3.75					
D	TMW+w	MT20	2.0	4.0							
E	TS-t	MT20	4.0	6.0	Edge	3.00					
F	TMWW-t	MT20	4.0	6.0							
G	TTWW-h	MT20	6.0	7.0	1.50	3.75					
H	TMWV+p	MT20	4.0	6.0	2.00	2.25					
J	BMV1+p	MT20	2.0	4.0							
K, M, P											
K	BMWW-t	MT20	4.0	6.0							
L	BS-t	MT20	4.0	6.0							
N	BMWWV-t	MT20	5.0	6.0	2.50	2.00					
O	BS-t	MT20	4.0	6.0							
Q	BMV1+p	MT20	2.0	4.0							
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.											
DIMENSIONS, SUPPORTS AND LOADS SPECIFIED BY FABRICATOR FOR BUILDING DESIGNER											
BEARINGS											
FACTORED				MAXIMUM FACTORED				INPUT		REQRD	
GROSS REACTION				GROSS REACTION				BRG		BRG	
JT	VERT	HORZ		DOWN	HORZ	UPLIFT		IN-SX		IN-SX	
Q	1713	0		1713	0	0		5-8		2-1	
J	1713	0		1713	0	0		5-8		2-1	
UNFACTORED REACTIONS											
1ST LCASE				MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW		LIVE		PERM.LIVE		WIND		DEAD	SOIL
Q	1219	759 / 0		0 / 0		0 / 0		0 / 0		460 / 0	0 / 0

LATERAL BRACE(S) SHOWN SHALL BE
2X4 SPF#2



[illegible]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE		LUMBER		DESCR.
A - D	2x4	DRY	No.2		SPF
D - E	2x4	DRY	No.2		SPF
E - G	2x4	DRY	No.2		SPF
H - G	2x4	DRY	No.2		SPF
N - A	2x4	DRY	No.2		SPF
N - K	2x4	DRY	No.2		SPF
K - I	2x4	DRY	No.2		SPF
I - H	2x4	DRY	No.2		SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	6.0	1.75	Edge
B, C, F						
B	TMWW-t	MT20	4.0	6.0		
D	TS-t	MT20	4.0	6.0		Edge 3.00
E	TTWW-I	MT20	4.0	6.0		2.00 4.00
G	TMV+p	MT20	2.0	4.0		
H	BMVW1-t	MT20	4.0	6.0		
I	BBWW-I	MT20	5.0	6.0		3.00 3.00
J	BMWWW-t	MT20	4.0	6.0		
K	BS-t	MT20	4.0	6.0		
L	BMWWW-t	MT20	4.0	6.0		
M	BMWWW-t	MT20	4.0	6.0	1.75	2.50
N	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION		BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
H	1033	0	1033	0	0	MECHANICAL
N	1033	0	1033	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H, N. MINIMUM BEARING LENGTH AT JOINT H = 1-8, JOINT N = 3-8.

UNFACTORED REACTIONS

	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	737	450 / 0	0 / 0	0 / 0	0 / 0	287 / 0	0 / 0
N	737	450 / 0	0 / 0	0 / 0	0 / 0	287 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO			FROM TO			FR-TO	
A- B	-3142 / 0		-78.0 -78.0	0.60 (1)	3.50	M- B	-277 / 0
B- C	-2628 / 0		-78.0 -78.0	0.42 (1)	3.96	B- L	-435 / 0
C- D	-1174 / 0		-78.0 -78.0	0.33 (1)	5.51	L- C	0 / 244
D- E	-1174 / 0		-78.0 -78.0	0.33 (1)	5.51	C- J	-1237 / 0
E- F	-724 / 0		-78.0 -78.0	0.05 (1)	6.25	J- E	0 / 644
F- G	0 / 0		-78.0 -78.0	0.04 (1)	10.00	E- I	-367 / 0
H- G	-49 / 0		0.0 0.0	0.01 (1)	7.81	I- F	0 / 790
N- A	-978 / 0		0.0 0.0	0.10 (1)	7.81	F- H	-1191 / 0
						A- M	0 / 2805
N- M	0 / 4		-18.5 -18.5	0.15 (4)	10.00		
M- L	0 / 2947		-18.5 -18.5	0.55 (1)	10.00		
L- K	0 / 2465		-18.5 -18.5	0.45 (1)	10.00		
K- J	0 / 2465		-18.5 -18.5	0.45 (1)	10.00		
J- I	0 / 1088		-18.5 -18.5	0.23 (1)	10.00		
I- H	0 / 689		-18.5 -18.5	0.12 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL	=	21.0	PSF
		DL	=	6.0	PSF
BOT	CH.	LL	=	0.0	PSF
		DL	=	7.4	PSF
TOTAL	LOAD	=	34.4	PSF	

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018 , ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 23.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. (RAIN LOAD) EQUALS 21.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.71")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.19")
ALLOWABLE DEFL.(TL)= L/360 (0.71")
CALCULATED VERT. DEFL.(TL) = L/ 686 (0.37")

CSI: TC=0.60/1.00 (A-B:1) , BC=0.55/1.00 (L-M:1) , WB=0.77/1.00 (C-J:1) , SSI=0.17/1.00 (C-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	650	371	1747
		788	1987
			1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (M) (INPUT = 0.90)
JSI METAL= 0.78 (A) (INPUT = 1.00)

LATERAL BRACE(S) SHOWN SHALL BE 2X4 SPF#2


LICENSED PROFESSIONAL ENGINEER


Y. WIDYA

100225448

06/07/2022

PROVINCE OF ONTARIO

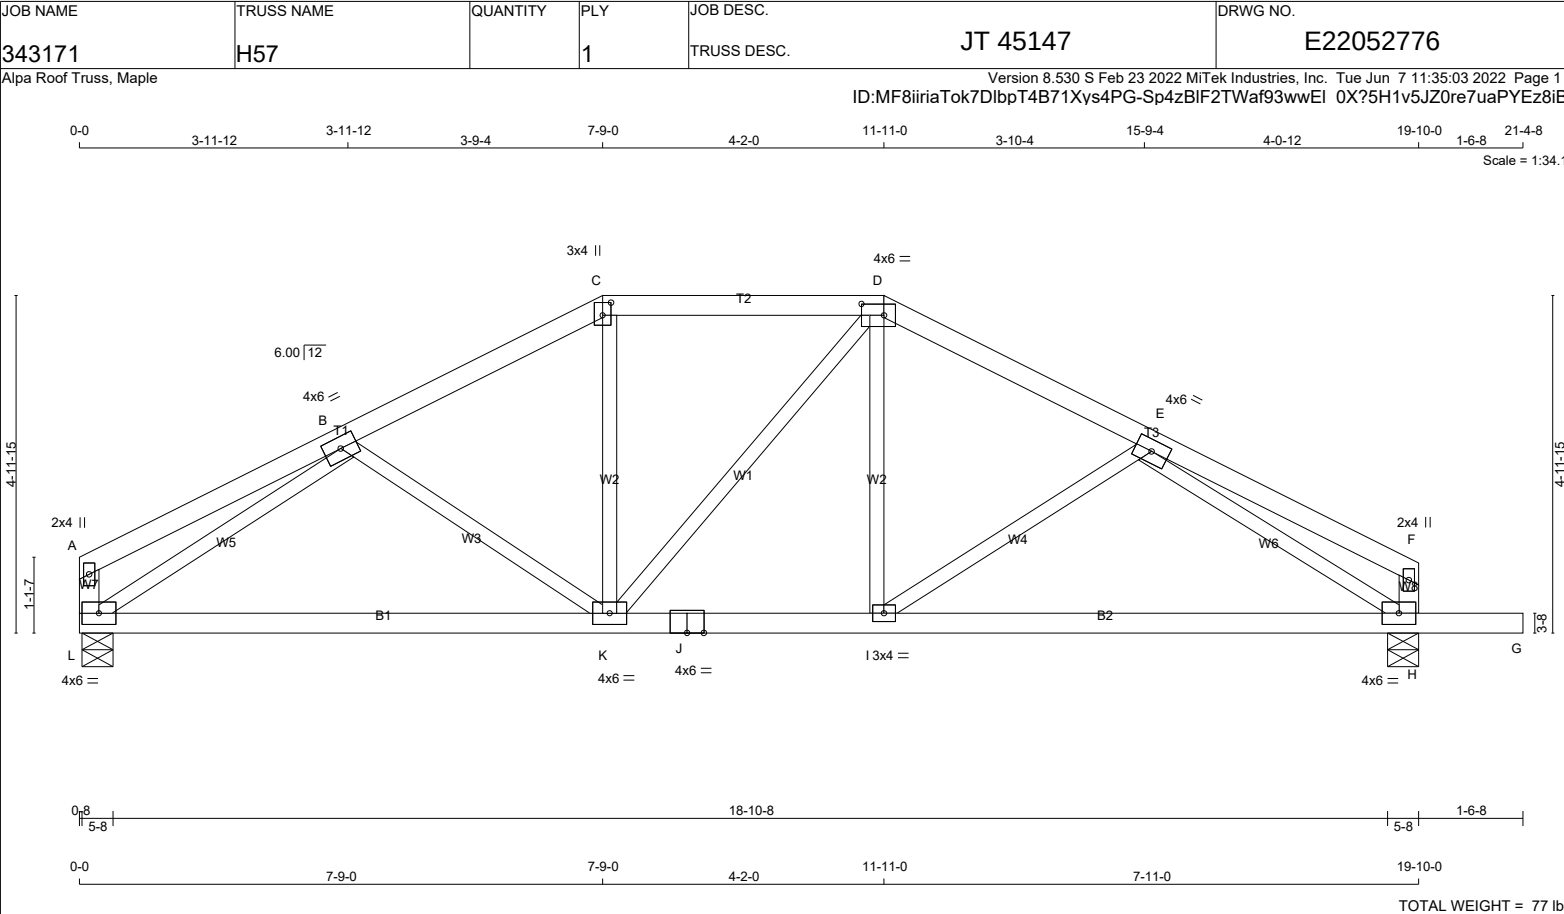

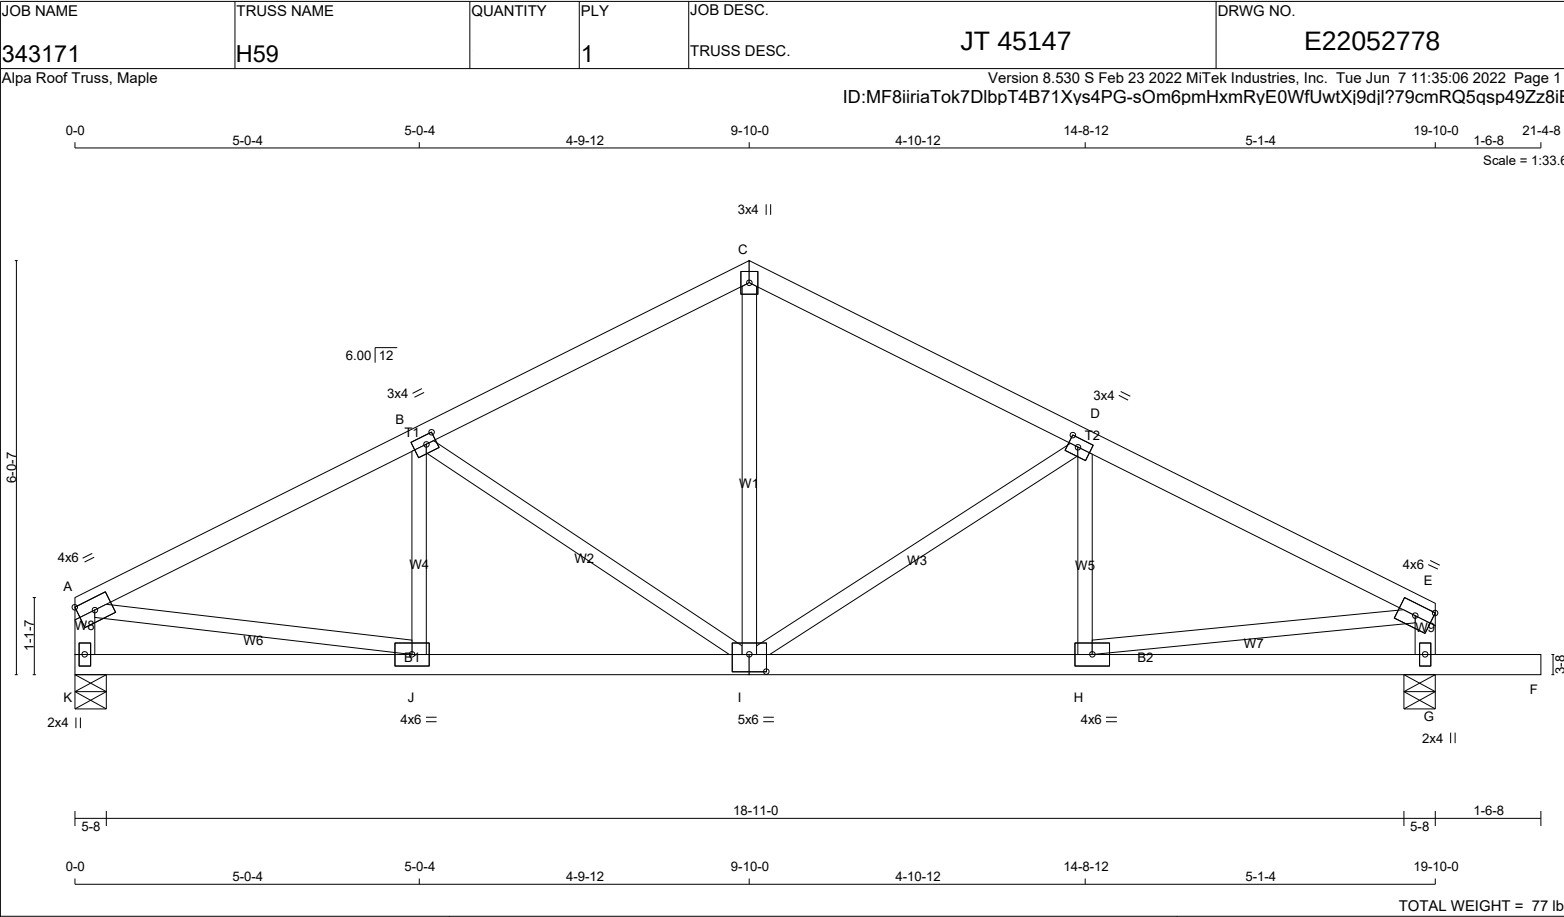

LUS – Double Shear Joist Hangers



All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3½" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.

Options:

- These hangers cannot be modified

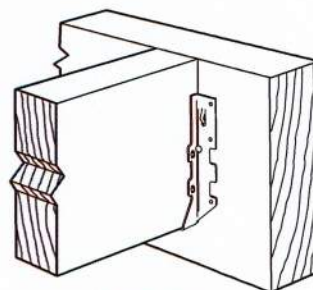

Typical LUS Installation

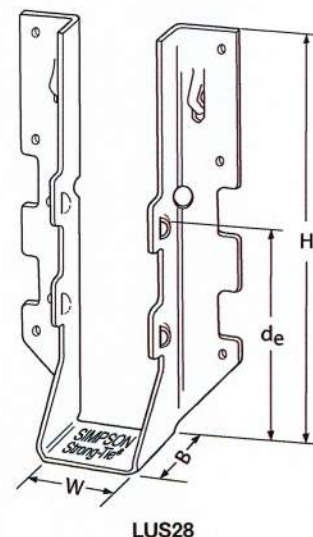

LUS28


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _o =1.15)	Normal (K _o =1.00)	Uplift (K _o =1.15)	Normal (K _o =1.00)
LUS24	18	1½	3½	1¾	1½	(4) 10d	(2) 10d	710	1630	645	1155
LUS24-2	18	3½	3½	2	1½	(4) 16d	(2) 16d	835	2020	590	1435
LUS26	18	1½	4¾	1¾	3½	(4) 10d	(4) 10d	1420	2170	1290	1630
LUS26-2	18	3½	4¾	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
LUS26-3	18	4½	4¾	2	3¼	(4) 16d	(4) 16d	1720	2595	1545	2340
LUS28	18	1½	6½	1¾	3¾	(6) 10d	(6) 10d	1420	2520	1290	1790
LUS28-2	18	3½	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
LUS28-3	18	4½	6¼	2	3¼	(6) 16d	(4) 16d	1720	3325	1545	2375
LUS210	18	1½	7½	1¾	3¾	(8) 10d	(4) 10d	1420	2785	1290	2210
LUS210-2	18	3½	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
LUS210-3	18	4½	8¾	2	5¼	(8) 16d	(6) 16d	2580	3345	2320	2375

1. d_e is the distance from the seat of the hanger to the highest joist nail.



Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent
5,603,580



Double Shear Nailing Top View.



LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECLUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HUS/LJS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86 -14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options




LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation

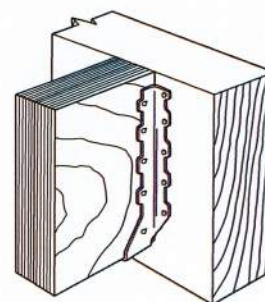

Typical HUS
Installation

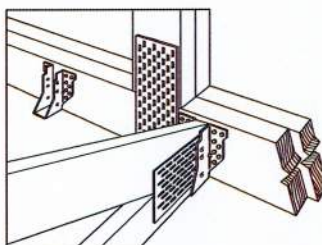

Typical HUS Installation
(Truss Designer to provide fastener
quantity for connecting multiple
members together)


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K ₀ =1.15) lb.	Normal (K ₀ =1.00) lb.	Uplift (K ₀ =1.15) lb.	Normal (K ₀ =1.00) lb.
LJS26DS	18	1½	5	3½	4%	(16) 16d	(6) 16d	2055	4265	1460	4115
HUS26	16	1½	5½	3	3½	(14) 16d	(6) 16d	2705	4940	2065	3875
HUS28	16	1½	7½	3	6½	(22) 16d	(8) 16d	3605	5365	2675	4345
HUS210	16	1½	9½	3	7½	(30) 16d	(10) 16d	4505	5795	4010	4740
HUS1.81/10	16	1½	9	3	8	(30) 16d	(10) 16d	4505	6450	4010	5200

1. d_e is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.




LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

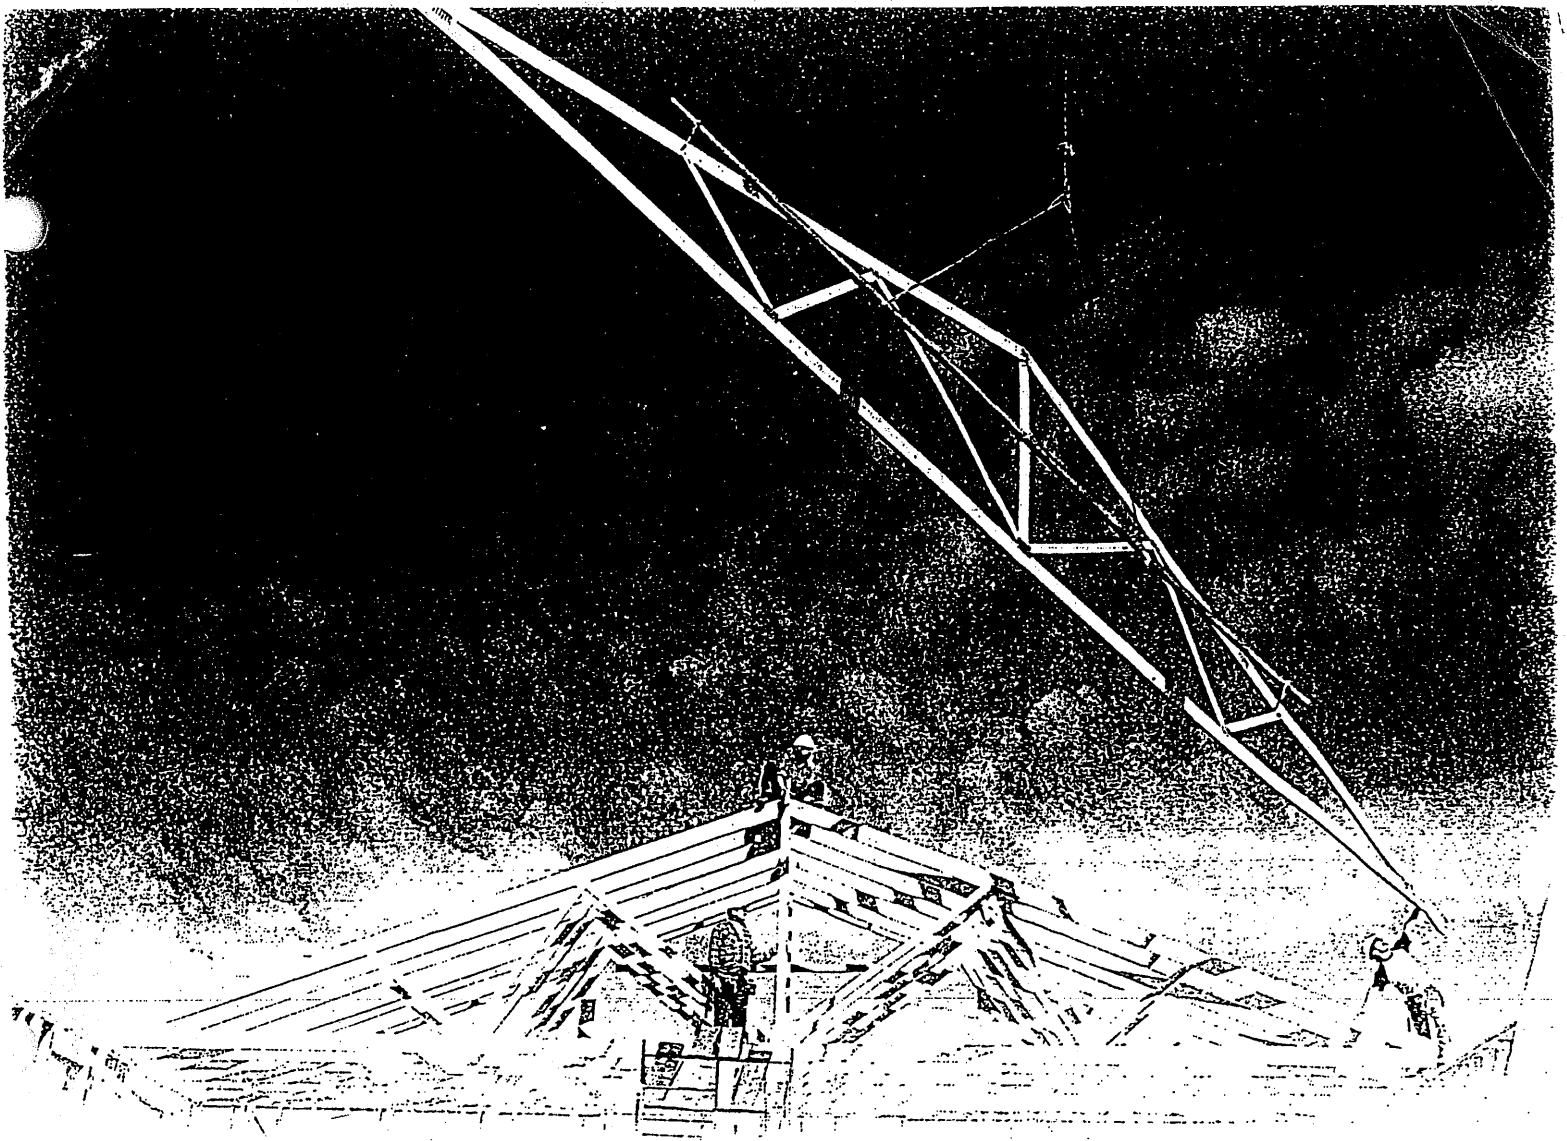


Wood Truss Installation

**A Guide to proper handling, erecting and bracing
metal plate connected wood trusses**

Table of Content

Warning.....	4
1 Unloading & Lifting.....	5
2 Job Site Handling.....	5
3 Hoisting.....	6
4 Beginning the Erection Process.....	7
5 Erection Tolerance.....	8
6 Bracing.....	8
7 Bracing Requirements for 3 Planes of Roof.....	9
8 Stacking Materials.....	10
Caution Notes.....	11

Warning



General

Familiarity with the Construction Design Documents, the Truss Design Drawings, and Truss Placement Plans (if required by the Construction Design Documents) is required to properly erect, brace, and connect the trusses to the building system.

All of the care and quality involved in the design and manufacture of wood trusses can be jeopardized if the trusses are not properly handled, erected, and braced.

The consequences of improper handling, erecting, and bracing may be a collapse of the structure, which at best is a substantial loss of time and materials, and at worst is a loss of life. The majority of truss accidents occur during truss installation and not as a result of improper design or manufacture.

Prior to truss erection, the builder/erector shall meet with the erection crew for a safety and planning meeting, making sure each crew member understands his or her roles and responsibilities during the erection process.

Temporary Erection Bracing

Trusses are not marked in any way to identify the frequency, or location of temporary erection bracing.

All temporary bracing shall comply with the latest edition of *Commentary and Recommendations for Handling, Installing & Bracing Metal Plate Connected Wood Trusses* (HIB), published by the Truss Plate Institute, and/or as specified in the Construction Design Documents prepared by the building designer.

Permanent Truss Bracing

Permanent bracing for the roof or floor trusses is the responsibility of the building designer and should be shown on the Construction Design Documents. Permanent bracing locations for individual compression members of a wood truss are shown on the Truss Design Drawings, and shall be installed by the building or erection contractor. This bracing is needed for the proper performance of individual trusses within the roof or floor system. The design and connection of the bracing to the truss and then to the overall building system is the responsibility of the building designer, and is in addition to the permanent bracing plan, which is also specified by the building designer.

Special Design Requirements


Special design requirements, such as wind bracing, portal bracing, seismic bracing, diaphragms, shear walls, or other load transfer elements and their connections to wood trusses must be considered separately by the building designer, who shall determine size, location, and method of connections for all bracing as needed to resist these forces.

1

Unloading & Lifting

Never handle trusses flat

Beginning with the unloading process, and throughout all phases of construction, care must be taken to avoid lateral bending of trusses, which can cause damage to the lumber and metal connector plates at the joints.


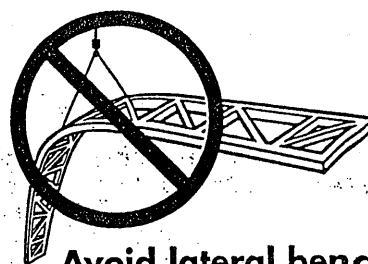


Avoid lateral bending

- Use special care in windy weather.
- If using a crane within 10 feet of an electric line, contact the local power company.
- If using a crane within 5 miles of an airport, contact the airport 30 days prior to erection to learn about any safety regulations that must be followed.


2

Job Site Handling

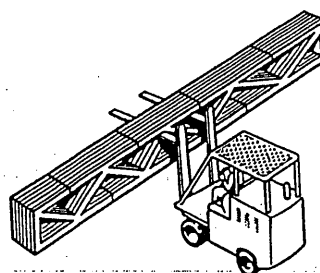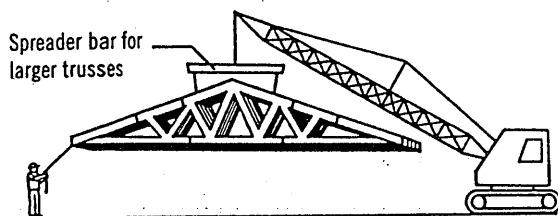


All trusses should be picked up at the top chords in a vertical position only

Proper banding and smooth ground allow for unloading of trusses without damage. This should be done as close to the building site as possible to minimize handling. Do not break banding until installation begins. Hand erection of trusses is allowed, provided excessive lateral bending is prevented.

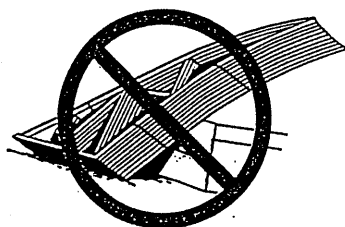


Do not store unbraced bundles upright

If trusses are stored vertically they shall be braced in a manner that will prevent tipping or topping. Generally cutting of the banding is done just prior to installation.



Do not store on uneven ground

If trusses are stored horizontally, blocking should be used on eight to ten foot centers, or as required, to minimize lateral bending and moisture gain.

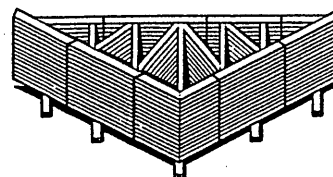


Care should be exercised when removing banding to avoid damaging trusses.


During long term storage, trusses shall be protected from the environment in a manner that provides for adequate ventilation of the trusses. If tarpaulins or other material is used, the ends shall be left open for ventilation. Plastic is not recommended, since it can trap moisture.

3 Hoisting


All trusses that are erected one at a time shall be held safely in position by the erection equipment until such time as all necessary bracing has been installed and the ends of the trusses are securely fastened to the building.

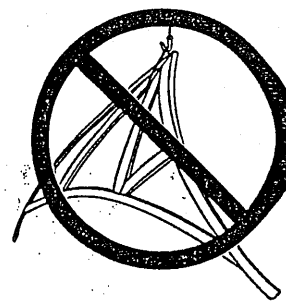


Avoid lateral bending

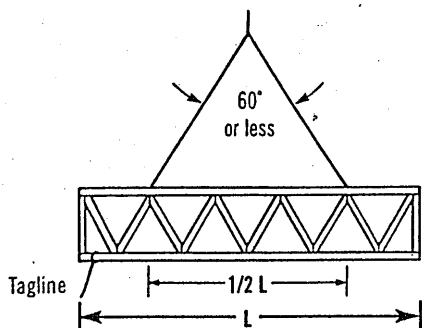


$L \leq 30'$

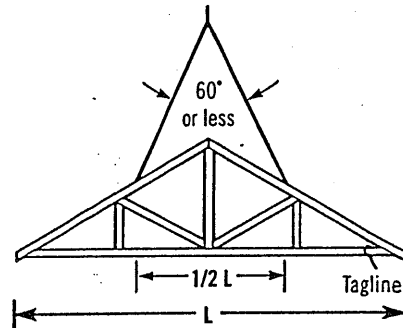


Truss sling is acceptable where these criteria are met.

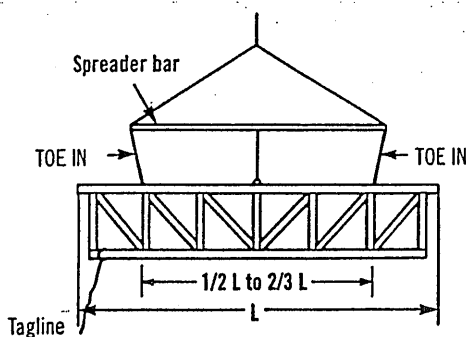


$30' < L \leq 60'$

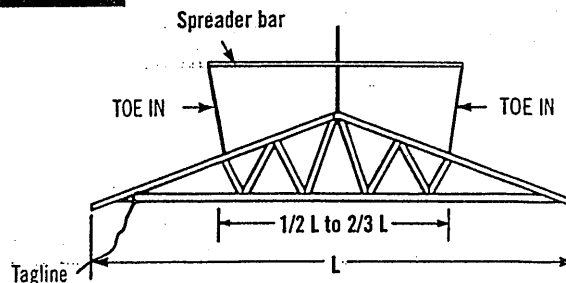

Use spreader bar in all other cases. It should be noted that the lines from the ends of the spreader bar "TOE IN"; if these lines should "TOE OUT" the truss may fold in half.

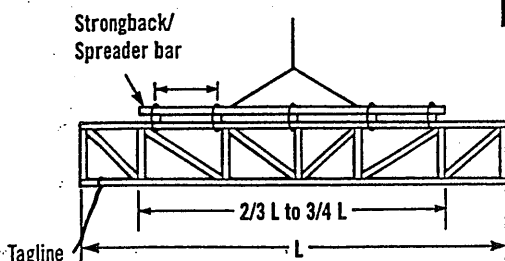

$L > 60'$

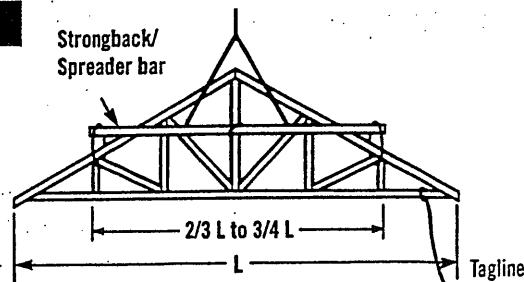


For lifting trusses with spans in excess of 60 feet, it is recommended that a strongback/spreader bar be used as illustrated. The strongback/spreader bar should be attached to the top chord and web members at intervals of approximately 10 feet. Further, the strongback/spreader bar should be at or above the mid-height of the truss to prevent overturning. The strongback/spreader bar can be of any material with sufficient strength to safely carry the weight of the truss and sufficient rigidity to adequately resist bending of the truss.

4 Beginning the Erection Process

It is important for the builder or erection contractor to provide substantial bracing for the first truss erected. The two or more trusses making up the rest of the first set are tied to and rely upon the first truss for stability. Likewise, after this first set of trusses is adequately cross-braced, the remaining trusses installed rely upon this first set for stability. Thus, the performance of the truss bracing system depends to a great extent on how well the first group of trusses is braced.

Ground Brace - Exterior




One satisfactory method ties the first unit of trusses off to a series of braces that are attached to a stake driven into the ground and securely anchored. The ground brace itself should be supported as shown below or it is apt to buckle. Additional ground braces in the opposite direction, inside the building, are also recommended.

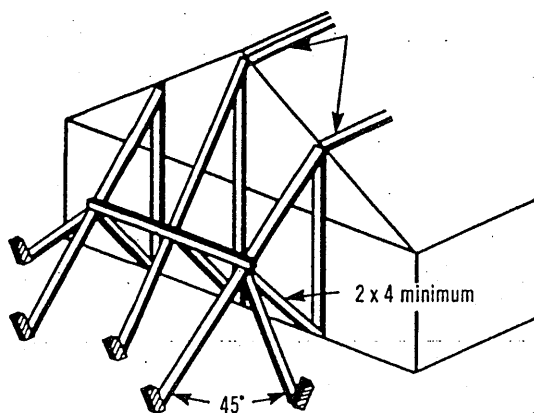

Note: Locate ground braces for first truss directly in line with all rows of top chord continuous lateral bracing (either temporary or permanent).

Ground Brace - Interior

Another satisfactory method where height of building or ground conditions prohibit bracing from the exterior is to tie the first truss rigidly in place from the interior at the floor level, provided the floor is substantially completed and capable of supporting the ground bracing forces. Securely fasten the first truss to the middle of the building. Brace the bracing similar to exterior ground bracing shown at left. Set trusses from the middle toward the end of the building. Properly cross-brace the first set of trusses before removing floor braces and setting remaining trusses.

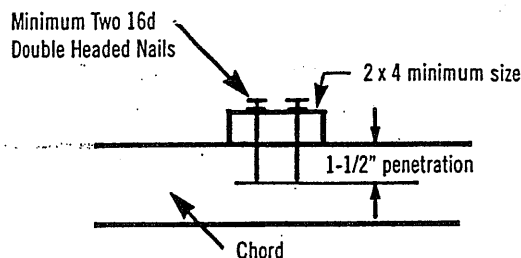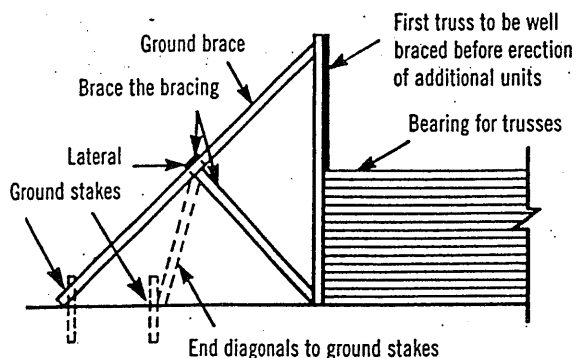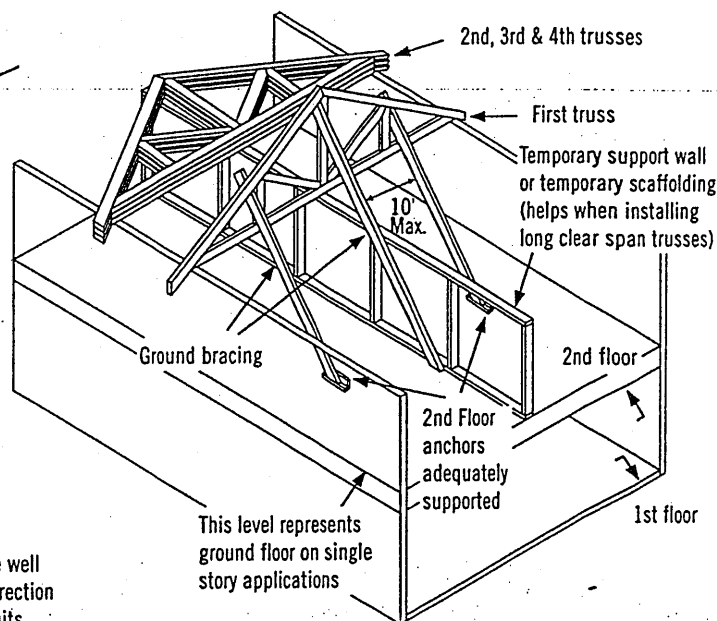


Inadequate size of bracing material or inadequate fastening is a major cause of erection dominoing.


5 Erection Tolerance

Complying with erection tolerances is critical to achieving an acceptable roof or floor line, and to accomplishing effective bracing. Setting trusses within tolerance the first time will prevent the need for the hazardous practice of respacing or adjusting trusses when roof sheathing or roof purlins are installed. Trusses leaning or bowing can cause nails to miss the top chords when sheathing is applied, and create cumulative stresses on the bracing, which is a frequent cause of dominoing.


When sheathing, make sure nails are driven into the top chord of the trusses.

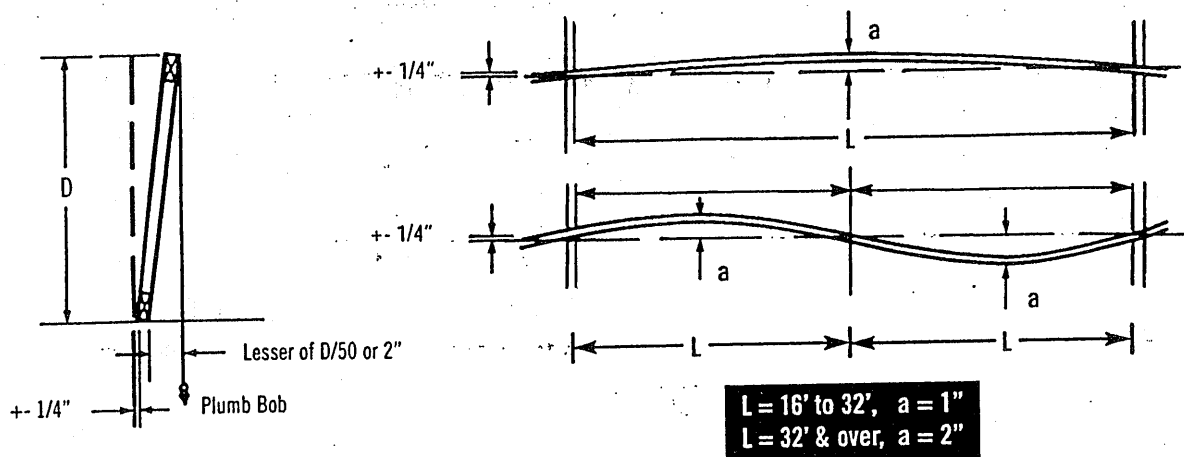

6 Bracing




Do not install trusses on temporarily connected supports



Do not walk on unbraced trusses



Do not walk on trusses or gable ends lying flat




Nails in withdrawal (parallel to force)

All anchors, hangers, tie-downs, seats, bearing ledgers, etc., that are part of the supporting structure shall be accurately and properly placed and permanently attached before truss installation begins. No trusses shall ever be installed on anchors or ties that have temporary connections to the supporting structure.

Nailing scabs to the end of the building to brace the first truss is not recommended.

All nailing of bracing should be done so that nails are driven perpendicular to the direction of force, as shown at right.

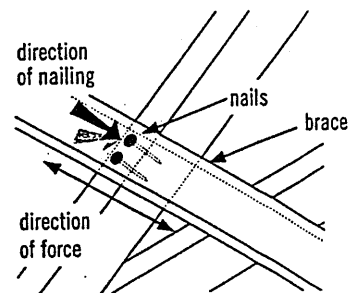


Well nailed (perpendicular to force)

7 Bracing Requirements for 3 Planes of Roof

Temporary erection bracing must be applied to three planes of the roof system to ensure stability: Plane 1) Top Chord (sheathing), Plane 2) Bottom Chord (ceiling plane), and Plane 3) Web Member plane or vertical plane perpendicular to trusses.

1) Top Chord Plane

Most important to the builder or erection contractor is bracing in the plane of the top chord. Truss top chords are susceptible to lateral buckling before they are braced or sheathed.

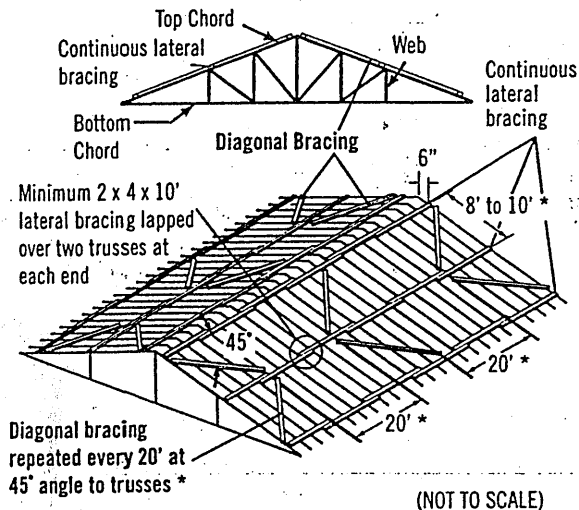


Exact spacing between trusses should be maintained as bracing is installed to avoid the hazardous practice of removing bracing to adjust spacing. This act of "adjusting spacing" can cause trusses to topple if connections are removed at the wrong time.

3) Web Member Plane

"X" bracing, as shown, is critical in preventing trusses from leaning or dominoing. Repeat as shown to create a succession of rigid units.


X-bracing should be installed on vertical web members wherever possible, at or near lateral bracing. Plywood or OSB may be substituted for X-bracing.

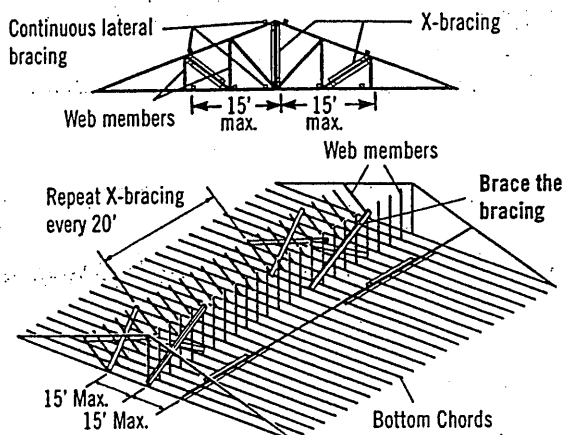

Note: Top chords and some web members are not shown, in order to make drawings more readable.


2) Bottom Chord Plane

In order to hold proper spacing on the bottom chord, temporary bracing is recommended on the top of the bottom chord.

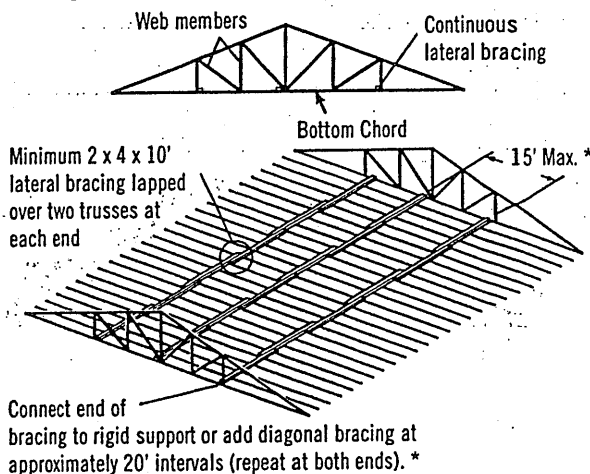


* Long spans, heavy loads or other spacing configurations may require closer spacing between lateral bracing and closer intervals between diagonals. Consult the building designer or HIB and DSB (Recommended Design Specification for Temporary Bracing of Metal-Plate Connected Wood Trusses) for details.

Diagonal or cross-bracing is very important!



Do not use short blocks to brace individual trusses without a specific bracing plan detailing their use


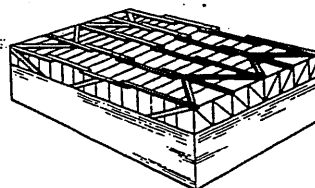


Bracing requirements using the same principles apply to parallel chord trusses

8 Stacking Materials

Do not proceed with building completion until all bracing is securely and properly in place


Never stack materials on unbraced or inadequately braced trusses

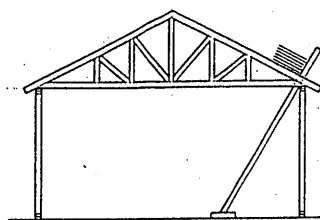


Platform must be rigidly braced

Proper distribution of construction materials is a must during construction.



Never stack materials near a peak

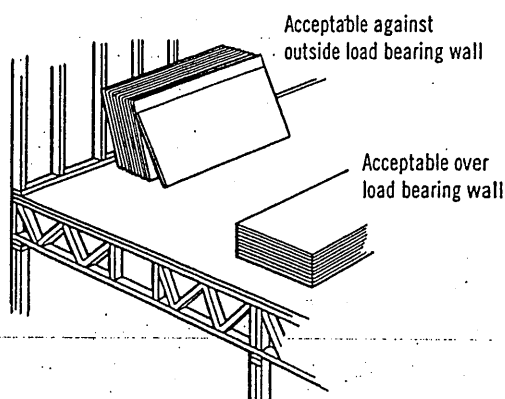

Never stack materials on the cantilever of a truss




Always stack materials over two or more trusses.





Single truss

Never overload small groups or single trusses. Position load over as many trusses as possible.

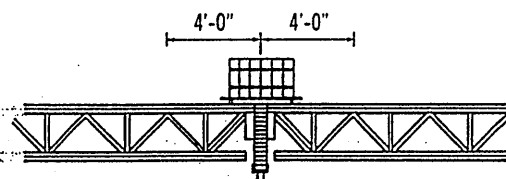

Roofing and mechanical contractors are cautioned to stack materials only along outside supporting members or directly over inside supporting members. Trusses are not designed for dynamic loads (i.e., moving vehicles). Extreme care should be taken when loading and stacking construction materials (rolled roofing, mechanical equipment, etc.) on the roof or floor system.

Never cut any structural member of a truss.

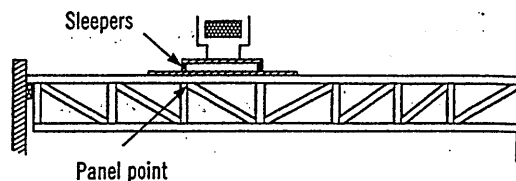

Sleepers for mechanical equipment should be located at panel points (joints) or over main supporting members, and only on trusses that have been designed for such loads.

Caution Notes

Errors in building lines and/or dimensions, or errors by others shall be corrected by the contractor or responsible construction trade subcontractor or supplier before erection of trusses begins.

Cutting of nonstructural overhangs is considered a part of normal erection and shall be done by the builder or erection contractor.

Any field modification that involves the cutting, drilling, or relocation of any structural truss member or connector plate shall not be done without the approval of the truss manufacturer or a licensed design professional.

The methods and procedures outlined are intended to ensure that the overall construction techniques employed will put floor and roof trusses safely in place in a completed structure. These recommendations for bracing wood trusses originate from the collective experience of leading technical personnel in the wood truss industry, but must, due to the nature of responsibilities involved, be presented only as a guide for use by a qualified building designer, builder, or erection contractor. Thus, the Wood Truss Council of America expressly disclaims any responsibility for damages arising from the use, application, or reliance on the recommendations and information contained herein.

[Selected text and figures referenced or reproduced from HIB and DSB by permission of the Truss Plate Institute, Madison, WI.]

THE CANADIAN WOOD TRUSS ASSOCIATION



L'ASSOCIATION CANADIENNE DES FABRICANTS DE FERMES DE BOIS

1400 Blair Place, Suite 210, Ottawa, ON K1J 9B8
Tel.: 613-747-5544 Fax: 613-747-6264



**Wood Truss Council
of America**

One WTCA Center
6300 Enterprise Lane, Madison, WI 53719-1140
Tel.: 608-274-4849 Fax: 608-274-3329
wtca@woodtruss.com www.woodtruss.com