


Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality VAUGHAN (WOODBIDGE)	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
<input type="checkbox"/> House <input type="checkbox"/> Small Buildings <input type="checkbox"/> Large Buildings <input type="checkbox"/> Complex Buildings <input checked="" type="checkbox"/> HVAC – House <input type="checkbox"/> Building Services <input type="checkbox"/> Detection, Lighting and Power <input type="checkbox"/> Fire Protection <input type="checkbox"/> Building Structural <input type="checkbox"/> Plumbing – House <input type="checkbox"/> Plumbing – All Buildings <input type="checkbox"/> On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 4202- ROSEDALE OPT SERV STAIR - WOB Project: PINE VALLEY & TESTON	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u>		declare that (choose one as appropriate):	
(print name)			
<input type="checkbox"/> I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
<input checked="" type="checkbox"/> I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
<input type="checkbox"/> The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
February 25, 2020			
Date		Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d). of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: PINE VALLEY & TESTON OPT SERV STAIR - WOB DATE: Feb-20 WINTER NATURAL AIR CHANGE RATE 0.407 HEAT LOSS ΔT °F. 76 CSA-F280-12
 BUILDER: GOLD PARK HOMES TYPE: 4202-ROSEDALE GFA: 3700 LO# 85450 SUMMER NATURAL AIR CHANGE RATE 0.137 HEAT GAIN ΔT °F. 13 SB-12 PACKAGE A1

ROOM USE	EXP. WALL	CLG. HT.	MBR	ENS	HERS	BED-2	BED-3	BED-4	ENS-2	LOFT	ENS-3	ENS-4					
	47		34	7	18	36	12	9	0	38	9	11					
	10		9	9	9	9	9	9	9	9	9	9					
FACTORS																	
GRS.WALL AREA	LOSS	GAIN	470	306	63	162	324	108	0	342	81	99					
GLAZING	LOSS	GAIN															
NORTH	21.3	16.0	0	0	0	0	0	0	0	0	9	192	144	0	0	0	
EAST	21.3	41.6	0	0	0	0	0	0	0	0	41	872	1704	0	0	0	
SOUTH	21.3	24.9	0	0	0	11	234	274	0	0	20	426	498	0	0	0	
WEST	21.3	41.6	54	1149	2244	18	383	748	0	0	0	0	0	0	0	0	
SKYL.T.	37.2	101.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
DOORS	25.2	4.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
NET EXPOSED WALL	4.5	0.8	416	1856	313	277	1236	208	63	281	47	144	643	108	271	1209	204
NET EXPOSED BSMT WALL ABOVE GR	3.6	0.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG	1.3	0.6	480	616	282	168	216	99	98	126	58	324	416	190	280	359	165
NO A TTIC EXPOSED CLG	2.7	1.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.6	0.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
BA SEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SUB TO TAL HT LOSS			3622		2069	407	1809	3411	1000	160	3116	685	678				
SUB TO TAL HT GAIN				2839	1329	105	648	2691	615	44	2634	244	331				
LEVEL FACTOR / MUL TIPLIER	0.20	0.33															
AIR CHANGE HEAT LOSS			1210		691	136	604	1140	334	53	1041	229	226				
AIR CHANGE HEAT GAIN				244	114	9	56	232	53	4	227	21	28				
DUCT LOSS			0		0	0	241	455	0	21	416	91	0				
DUCT GAIN			0		0	0	163	384	0	5	354	26	0				
HEAT GAIN PEOPLE	240		2	480	0	0	1	240	1	240	0	0	0				
HEAT GAIN APPLIANCES/LIGHTS				682	0	0	682	682	0	0	682	0	0				
TOTAL HT LOSS BTU/H			4832		2760	543	2654	5005	1334	234	4573	1006	904				
TOTAL HT GAIN x 1.3 BTU/H			5518		1876	148	2325	5497	2066	68	5066	378	467				

ROOM USE	EXP. WALL	CLG. HT.	DIN	KT/GT	LAUN	PWD	FOY	MUD	HIS	WOB	BA S						
	17		11	100	0	16	59	17	6	43	159						
	11		11	11	9	12	11	12	9	10	10						
FACTORS																	
GRS.WALL AREA	LOSS	GAIN	187	1100	0	192	649	204	54	430	1113						
GLAZING	LOSS	GAIN															
NORTH	21.3	16.0	0	0	0	0	0	0	0	0	0	26	553	415	0	0	0
EAST	21.3	41.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SOUTH	21.3	24.9	34	724	847	29	617	722	0	0	0	0	0	0	0	0	0
WEST	21.3	41.6	0	0	0	123	2617	5111	0	0	0	98	2085	4072	0	0	0
SKYL.T.	37.2	101.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
DOORS	25.2	4.3	0	0	0	10	252	43	0	0	0	20	505	85	20	505	85
NET EXPOSED WALL	4.5	0.8	153	683	115	928	4141	697	0	0	0	286	1276	215	0	0	0
NET EXPOSED BSMT WALL ABOVE GR	3.6	0.6	0	0	0	0	0	0	0	0	0	0	0	0	477	1716	289
EXPOSED CLG	1.3	0.6	0	0	0	96	123	56	0	0	0	84	108	49	0	0	0
NO A TTIC EXPOSED CLG	2.7	1.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.6	0.4	0	0	0	0	0	0	0	0	0	84	214	36	0	0	0
BA SEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0	0	0	0	552					
SUB TO TAL HT LOSS			1406		7841	123	857	4081	1326	563	126	4972		4787		4782	
SUB TO TAL HT GAIN				962	6733	56	144	687	223	11	374						
LEVEL FACTOR / MUL TIPLIER	0.30	0.57															
AIR CHANGE HEAT LOSS			802		4470	41	488	2326	766	188	14737						
AIR CHANGE HEAT GAIN				83	580	5	12	59	19	11	444						
DUCT LOSS			0		0	0	0	0	0	75	0						
DUCT GAIN			0		0	0	0	0	0	14	0						
HEAT GAIN PEOPLE	240		0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
HEAT GAIN APPLIANCES/LIGHTS				682	682	0	682	682	0	682	682	0	0	0	0	0	682
TOTAL HT LOSS BTU/H			2208		12311	164	1345	6407	2082	826	1951						
TOTAL HT GAIN x 1.3 BTU/H			2244		10393	966	204	970	1202	196	1951						

TOTAL HEAT GAIN BTU/H: 48295 TONS: 4.02 LOSS DUE TO VENTILATION LOAD BTU/H: 3181 STRUCTURAL HEAT LOSS: 74232 TOTAL COMBINED HEAT LOSS BTU/H: 77413

Michael O'Rourke

SITE NAME: PINE VALLEY & TESTON
 BUILDER: GOLD PARK HOMES

OPT SERV STAIR - WOB
 TYPE: 4202-ROSEDALE

DATE: Feb-20

GFA: 3700 LO# 85450

HEATING CFM 1525 COOLING CFM 1525
 TOTAL HEAT LOSS 74,232 TOTAL HEAT GAIN 47,760
 AIR FLOW RATE CFM 20.54 AIR FLOW RATE CFM 31.93

furnace pressure 0.6
 furnace filter 0.05
 a/c coil pressure 0.2
 available pressure
 for s/a & r/a 0.35

LENNOX
EL296UH090XE48C
 FAN SPEED 90
 LOW 0
 MEDLOW 0
 MEDIUM 1105
 MEDIUM HIGH 1255
 HIGH 1525

AFUE = 96 %
 INPUT (BTU/H) = 88,000
 OUTPUT (BTU/H) = **85,000**
 DESIGN CFM = **1525**
 CFM @ 6" E.S.P.
 TEMPERATURE RISE 52 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	17	9	6
R/A	0	0	5	2	1

All S/A diffusers 4"x10" unless noted otherwise on layout.
 All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	MBR	ENS	ENS	BED-2	BED-3	BED-4	ENS-2	LOFT	ENS-3	MBR	ENS-4	DIN	KT/GT	KT/GT	KT/GT	KT/GT	LAUN	PWD	FOY	MUD	BAS	BAS	BAS	BAS
RM LOSS MBH	2.42	1.38	1.38	2.65	1.67	1.33	0.23	2.29	1.01	2.42	0.90	2.21	3.08	3.08	3.08	3.08	0.16	1.35	3.20	2.08	4.17	4.17	4.17	4.17
CFM PER RUN HEAT	50	28	28	55	34	27	5	47	21	50	19	45	63	63	63	63	3	28	66	43	86	86	86	86
RM GAIN MBH	2.76	0.94	0.94	2.32	1.83	2.07	0.07	2.53	0.38	2.76	0.47	2.24	2.60	2.60	2.60	2.60	0.97	0.20	0.49	1.20	1.36	1.36	1.36	1.36
CFM PER RUN COOLING	88	30	30	74	59	66	2	81	12	88	15	72	83	83	83	83	31	7	15	38	44	44	44	44
ADJUSTED PRESSURE	0.16	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.17	0.16	0.17	0.17	0.16	0.16	0.16	0.16	0.17	0.17	0.17	0.17	0.16	0.16	0.16	0.16
ACTUAL DUCT LGH.	62	53	61	60	49	25	48	55	48	67	39	10	43	47	46	57	52	22	42	24	45	65	13	36
EQUIVALENT LENGTH	160	150	130	190	150	140	190	190	160	180	140	150	130	130	130	130	190	160	150	110	170	140	120	130
TOTAL EFFECTIVE LENGTH	222	203	191	250	199	165	238	245	208	247	179	160	173	177	176	187	242	182	192	134	215	205	133	166
ADJUSTED PRESSURE	0.07	0.08	0.09	0.07	0.09	0.1	0.07	0.07	0.08	0.07	0.1	0.11	0.09	0.09	0.09	0.09	0.07	0.09	0.09	0.13	0.08	0.08	0.12	0.1
ROUND DUCT SIZE	6	4	4	5	5	5	4	6	4	6	4	5	5	5	5	5	4	4	5	4	6	6	5	5
HEATING VELOCITY (ft/min)	255	321	321	404	250	198	57	240	241	255	218	330	463	463	463	463	34	321	485	493	438	438	631	631
COOLING VELOCITY (ft/min)	449	344	344	543	433	485	23	413	138	449	172	529	609	609	609	609	356	80	110	436	224	224	323	323
OUTLET GRILL SIZE	4X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	3X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10
TRUNK	C	A	A	E	E	C	E	D	E	C	C	C	A	A	B	B	B	E	D	C	A	B	C	D

RUN #	25	26	27	28	29	30	31	32
ROOM NAME	BED-3	LOFT	BAS	FOY	HERS	HIS	BED-3	BAS
RM LOSS MBH	1.67	2.29	4.17	3.20	0.54	0.83	1.67	4.17
CFM PER RUN HEAT	34	47	86	66	11	17	34	86
RM GAIN MBH	1.83	2.53	1.36	0.49	0.15	0.20	1.83	1.36
CFM PER RUN COOLING	59	81	44	15	5	6	59	44
ADJUSTED PRESSURE	0.17	0.16	0.16	0.17	0.17	0.17	0.17	0.16
ACTUAL DUCT LGH.	45	57	33	40	50	53	58	22
EQUIVALENT LENGTH	140	150	180	150	180	180	160	120
TOTAL EFFECTIVE LENGTH	185	207	213	190	230	233	218	142
ADJUSTED PRESSURE	0.09	0.08	0.08	0.09	0.07	0.07	0.08	0.11
ROUND DUCT SIZE	5	5	6	5	4	4	5	5
HEATING VELOCITY (ft/min)	250	345	438	485	126	195	250	631
COOLING VELOCITY (ft/min)	433	595	224	110	57	69	433	323
OUTLET GRILL SIZE	3X10	3X10	4X10	3X10	3X10	3X10	3X10	3X10
TRUNK	E	D	D	D	B	C	E	C

SUPPLY AIR TRUNK SIZE

	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)
TRUNK A	268	0.08	8.6	8	603
TRUNK B	226	0.07	8.3	8	509
TRUNK C	917	0.07	14	22	750
TRUNK D	398	0.07	10.3	12	597
TRUNK E	609	0.07	12	16	685
TRUNK F	0	0.00	0	0	0

RETURN AIR TRUNK SIZE

	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)
TRUNK O	0	0.06	0	0	8
TRUNK P	0	0.06	0	0	8
TRUNK Q	0	0.06	0	0	8
TRUNK R	0	0.06	0	0	8
TRUNK S	0	0.06	0	0	8
TRUNK T	0	0.06	0	0	8
TRUNK U	0	0.06	0	0	8
TRUNK V	0	0.06	0	0	8
TRUNK W	0	0.06	0	0	8

RETURN AIR #

	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
AIR VOLUME	130	125	130	130	365	300	130	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	61	69	49	53	30	52	56	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
EQUIVALENT LENGTH	175	165	145	185	185	140	150	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
TOTAL EFFECTIVE LH	236	234	194	238	215	192	206	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1	1
ADJUSTED PRESSURE	0.06	0.06	0.08	0.06	0.07	0.08	0.07	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80
ROUND DUCT SIZE	7	6.9	6.5	7	9.9	8.9	6.8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
INLET GRILL SIZE	8	8	8	8	8	8	8	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
INLET GRILL SIZE	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	14	14	14	14	30	30	14	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)
TRUNK X	1525	0.06	17.7	32	686
TRUNK Y	430	0.06	11	14	553
TRUNK Z	925	0.06	14.6	24	694
DROP	1525	0.06	17.7	24	654

TYPE: 4202- ROSEDALE
 SITE NAME: PINE VALLEY & TESTON

LO # 85450
 OPT SERV STAIR - WOB

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES 9.32.3.1(1)

a) Direct vent (sealed combustion) only

b) Positive venting induced draft (except fireplaces)

c) Natural draft, B-vent or induced draft gas fireplace

d) Solid Fuel (including fireplaces)

e) No Combustion Appliances

HEATING SYSTEM

Forced Air Non Forced Air

Electric Space Heat

HOUSE TYPE 9.32.1(2)

I Type a) or b) appliance only, no solid fuel

II Type I except with solid fuel (including fireplaces)

III Any Type c) appliance

IV Type I, or II with electric space heat

Other: Type I, II or IV no forced air

SYSTEM DESIGN OPTIONS O.N.H.W.P.

1 Exhaust only/Forced Air System

2 HRV with Ducting/Forced Air System

3 HRV Simplified/connected to forced air system

4 HRV with Ducting/non forced air system

Part 6 Design

TOTAL VENTILATION CAPACITY 9.32.3.3(1)

Basement + Master Bedroom	2	@ 21.2 cfm	42.4	cfm
Other Bedrooms	3	@ 10.6 cfm	31.8	cfm
Kitchen & Bathrooms	6	@ 10.6 cfm	63.6	cfm
Other Rooms	8	@ 10.6 cfm	84.8	cfm
Table 9.32.3.A.	TOTAL		222.6	cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED 9.32.3.4.(1)

1	Bedroom	31.8	cfm
2	Bedroom	47.7	cfm
3	Bedroom	63.6	cfm
4	Bedroom	79.5	cfm
5	Bedroom	95.4	cfm
TOTAL		79.5	cfm

SUPPLEMENTAL VENTILATION CAPACITY 9.32.3.5.

Total Ventilation Capacity	222.6	cfm
Less Principal Ventil. Capacity	155	cfm
Required Supplemental Capacity	67.6	cfm

PRINCIPAL EXHAUST FAN CAPACITY

Model: VANEE 65H Location: BSMT

155.0 cfm 3.0 sones HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION

CFM	ΔT °F	FACTOR	% LOSS
155.0 CFM	X 76 F	X 1.08	X 0.25

SUPPLEMENTAL FANS NUTONE

Location	Model	cfm	HVI	Sones
ENS	QTXEN050C	50	✓	0.3
ENS-2	QTXEN050C	50	✓	0.3
ENS-4	QTXEN050C	50	✓	0.3
PWD	QTXEN050C	50	✓	0.3

HEAT RECOVERY VENTILATOR 9.32.3.11.

Model: VANEE 65H

155 cfm high 64 cfm low

75 % Sensible Efficiency @ 32 deg F (0 deg C) HVI Approved

LOCATION OF INSTALLATION

Lot: Concession

Township Plan:

Address

Roll # Building Permit #

BUILDER: GOLD PARK HOMES

Name:

Address:

City:

Telephone #: Fax #:

INSTALLING CONTRACTOR

Name:

Address:

City:

Telephone #: Fax #:

DESIGNER CERTIFICATION

I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.

Name: HVAC Designs Ltd.

Signature: *Michael O'Rourke*

HRAI # 001820

Date: February-20

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																																
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																																
LO#: 85450	Model: 4202- ROSEDALE	Builder: GOLD PARK HOMES	Date: 2/25/2020																																																													
Volume Calculation			Air Change & Delta T Data																																																													
<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="4">House Volume</th> </tr> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr> <td>Bsmt</td> <td>1647</td> <td>10</td> <td>16470</td> </tr> <tr> <td>First</td> <td>1647</td> <td>11</td> <td>18117</td> </tr> <tr> <td>Second</td> <td>2076</td> <td>9</td> <td>18684</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>53,271.0 ft³</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>1508.5 m³</td> </tr> </tbody> </table>			House Volume				Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	1647	10	16470	First	1647	11	18117	Second	2076	9	18684	Third	0	9	0	Fourth	0	9	0	Total:			53,271.0 ft³	Total:			1508.5 m³	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width: 70%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 30%;">0.407</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td>0.137</td> </tr> </table> <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th colspan="5">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> </thead> <tbody> <tr> <td>Winter DTDh</td> <td>22</td> <td>-20</td> <td>42</td> <td>76</td> </tr> <tr> <td>Summer DTDc</td> <td>24</td> <td>31</td> <td>7</td> <td>13</td> </tr> </tbody> </table>		WINTER NATURAL AIR CHANGE RATE	0.407	SUMMER NATURAL AIR CHANGE RATE	0.137	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-20	42	76	Summer DTDc	24	31	7	13
House Volume																																																																
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																													
Bsmt	1647	10	16470																																																													
First	1647	11	18117																																																													
Second	2076	9	18684																																																													
Third	0	9	0																																																													
Fourth	0	9	0																																																													
Total:			53,271.0 ft³																																																													
Total:			1508.5 m³																																																													
WINTER NATURAL AIR CHANGE RATE	0.407																																																															
SUMMER NATURAL AIR CHANGE RATE	0.137																																																															
Design Temperature Difference																																																																
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																												
Winter DTDh	22	-20	42	76																																																												
Summer DTDc	24	31	7	13																																																												
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																													
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ <p>0.407 x 419.02 x 42 °C x 1.2 = 8638 W</p> <p style="text-align: right;">= 29473 Btu/h</p>			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ <p>= 0.137 x 419.02 x 7 °C x 1.2 = 488 W</p> <p style="text-align: right;">= 1665 Btu/h</p>																																																													
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																													
$HL_{vaib} = PVC \times DTD_h \times 1.08 \times (1 - E)$ <p>155 CFM x 76 °F x 1.08 x 0.25 = 3181 Btu/h</p>			$HL_{vaib} = PVC \times DTD_h \times 1.08 \times (1 - E)$ <p>155 CFM x 13 °F x 1.08 x 0.25 = 536 Btu/h</p>																																																													
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																																
$HL_{airr} = Level\ Factor \times HL_{airbv} \times \{ (HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel}) \}$																																																																
<table border="1" style="width:100%; border-collapse: collapse; text-align: center;"> <thead> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairve Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{clevel})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>0.5</td> <td rowspan="5">29,473</td> <td>9,753</td> <td>1.511</td> </tr> <tr> <td>2</td> <td>0.3</td> <td>15,512</td> <td>0.570</td> </tr> <tr> <td>3</td> <td>0.2</td> <td>17,643</td> <td>0.334</td> </tr> <tr> <td>4</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> <tr> <td>5</td> <td>0</td> <td>0</td> <td>0.000</td> </tr> </tbody> </table>					Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)	1	0.5	29,473	9,753	1.511	2	0.3	15,512	0.570	3	0.2	17,643	0.334	4	0	0	0.000	5	0	0	0.000																																		
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																												
1	0.5	29,473	9,753	1.511																																																												
2	0.3		15,512	0.570																																																												
3	0.2		17,643	0.334																																																												
4	0		0	0.000																																																												
5	0		0	0.000																																																												
<p>*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0</p>																																																																

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 4202- ROSEDALE	OPT SERV STAIR - WOB	BUILDER: GOLD PARK HOMES
SFQT: 3700	LO# 85450	SITE: PINE VALLEY & TESTON

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-4	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	53271.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 68.0 ft	WIDTH: 33.0 ft	EXPOSED PERIMETER:	159.0 ft
WOB INSULATION CONFIGURATION	SCB_9	WOB EXPOSED PERIMETER	43.0 ft


2012 OBC - COMPLIANCE PACKAGE

Component	Compliance Package A1	
	Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22	17.03
Basement Walls Minimum RSI (R)-Value	20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	0.28	-
Skylights Maximum U-Value	0.49	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.8	-

INDIVIDUAL BCIN: 19669
MICHAEL O'ROURKE

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

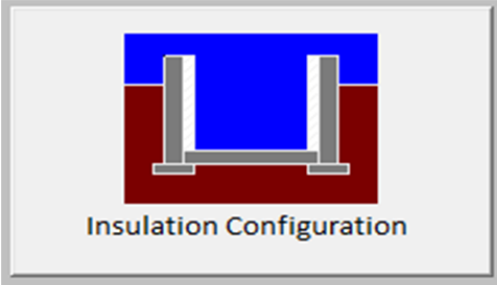Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	4.6	 <p>Insulation Configuration</p>
Floor Width (m):	10.1	
Exposed Perimeter (m):	48.5	
Wall Height (m):	3.0	
Depth Below Grade (m):	1.79	
Window Area (m ²):	0.0	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):	750	

TYPE: 4202- ROSEDALE
 LO# 85450

OPT SERV STAIR - WOB

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Length (m):	1.5	
Width (m):	10.1	
Exposed Perimeter (m):	13.1	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Results		
Heating Load (Watts):	162	

TYPE: 4202- ROSEDALE
 LO# 85450

OPT SERV STAIR - WOB

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description			
Province:	Ontario		
Region:	Vaughan (Woodbridge)		
Weather Station Location:	Open flat terrain, grass		
Anemometer height (m):	10		
Local Shielding			
Building Site:	Suburban, forest		
Walls:	Heavy		
Flue:	Heavy		
Highest Ceiling Height (m):	9.14		
Building Configuration			
Type:	Detached		
Number of Stories:	Two		
Foundation:	Full		
House Volume (m ³):	1508.5		
Air Leakage/Ventilation			
Air Tightness Type:	Present (1961-) (3.57 ACH)		
Custom BDT Data:	ELA @ 10 Pa.	2010.8 cm ²	
	3.57	ACH @ 50 Pa	
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust	
	73.2	73.2	
Flue Size			
Flue #:	#1	#2	#3 #4
Diameter (mm):	0	0	0 0
Natural Infiltration Rates			
Heating Air Leakage Rate (ACH/H):	0.407		
Cooling Air Leakage Rate (ACH/H):	0.137		

TYPE: 4202- ROSEDALE
 LO# 85450

OPT SERV STAIR - WOB


I, MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.
Michael O'Rourke
 Michael O'Rourke, BCIN# 19669
 HVAC DESIGNS LTD.

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	SUPPLY AIR GRILLE		6" SUPPLY AIR STACK ABOVE
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	14"X8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE
	30"X8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR
	FRA- FLOOR RETURN AIR GRILLE		REDUCER

NO.	DESCRIPTION	DATE
1.		
2.		
3.		

HVAC LEGEND

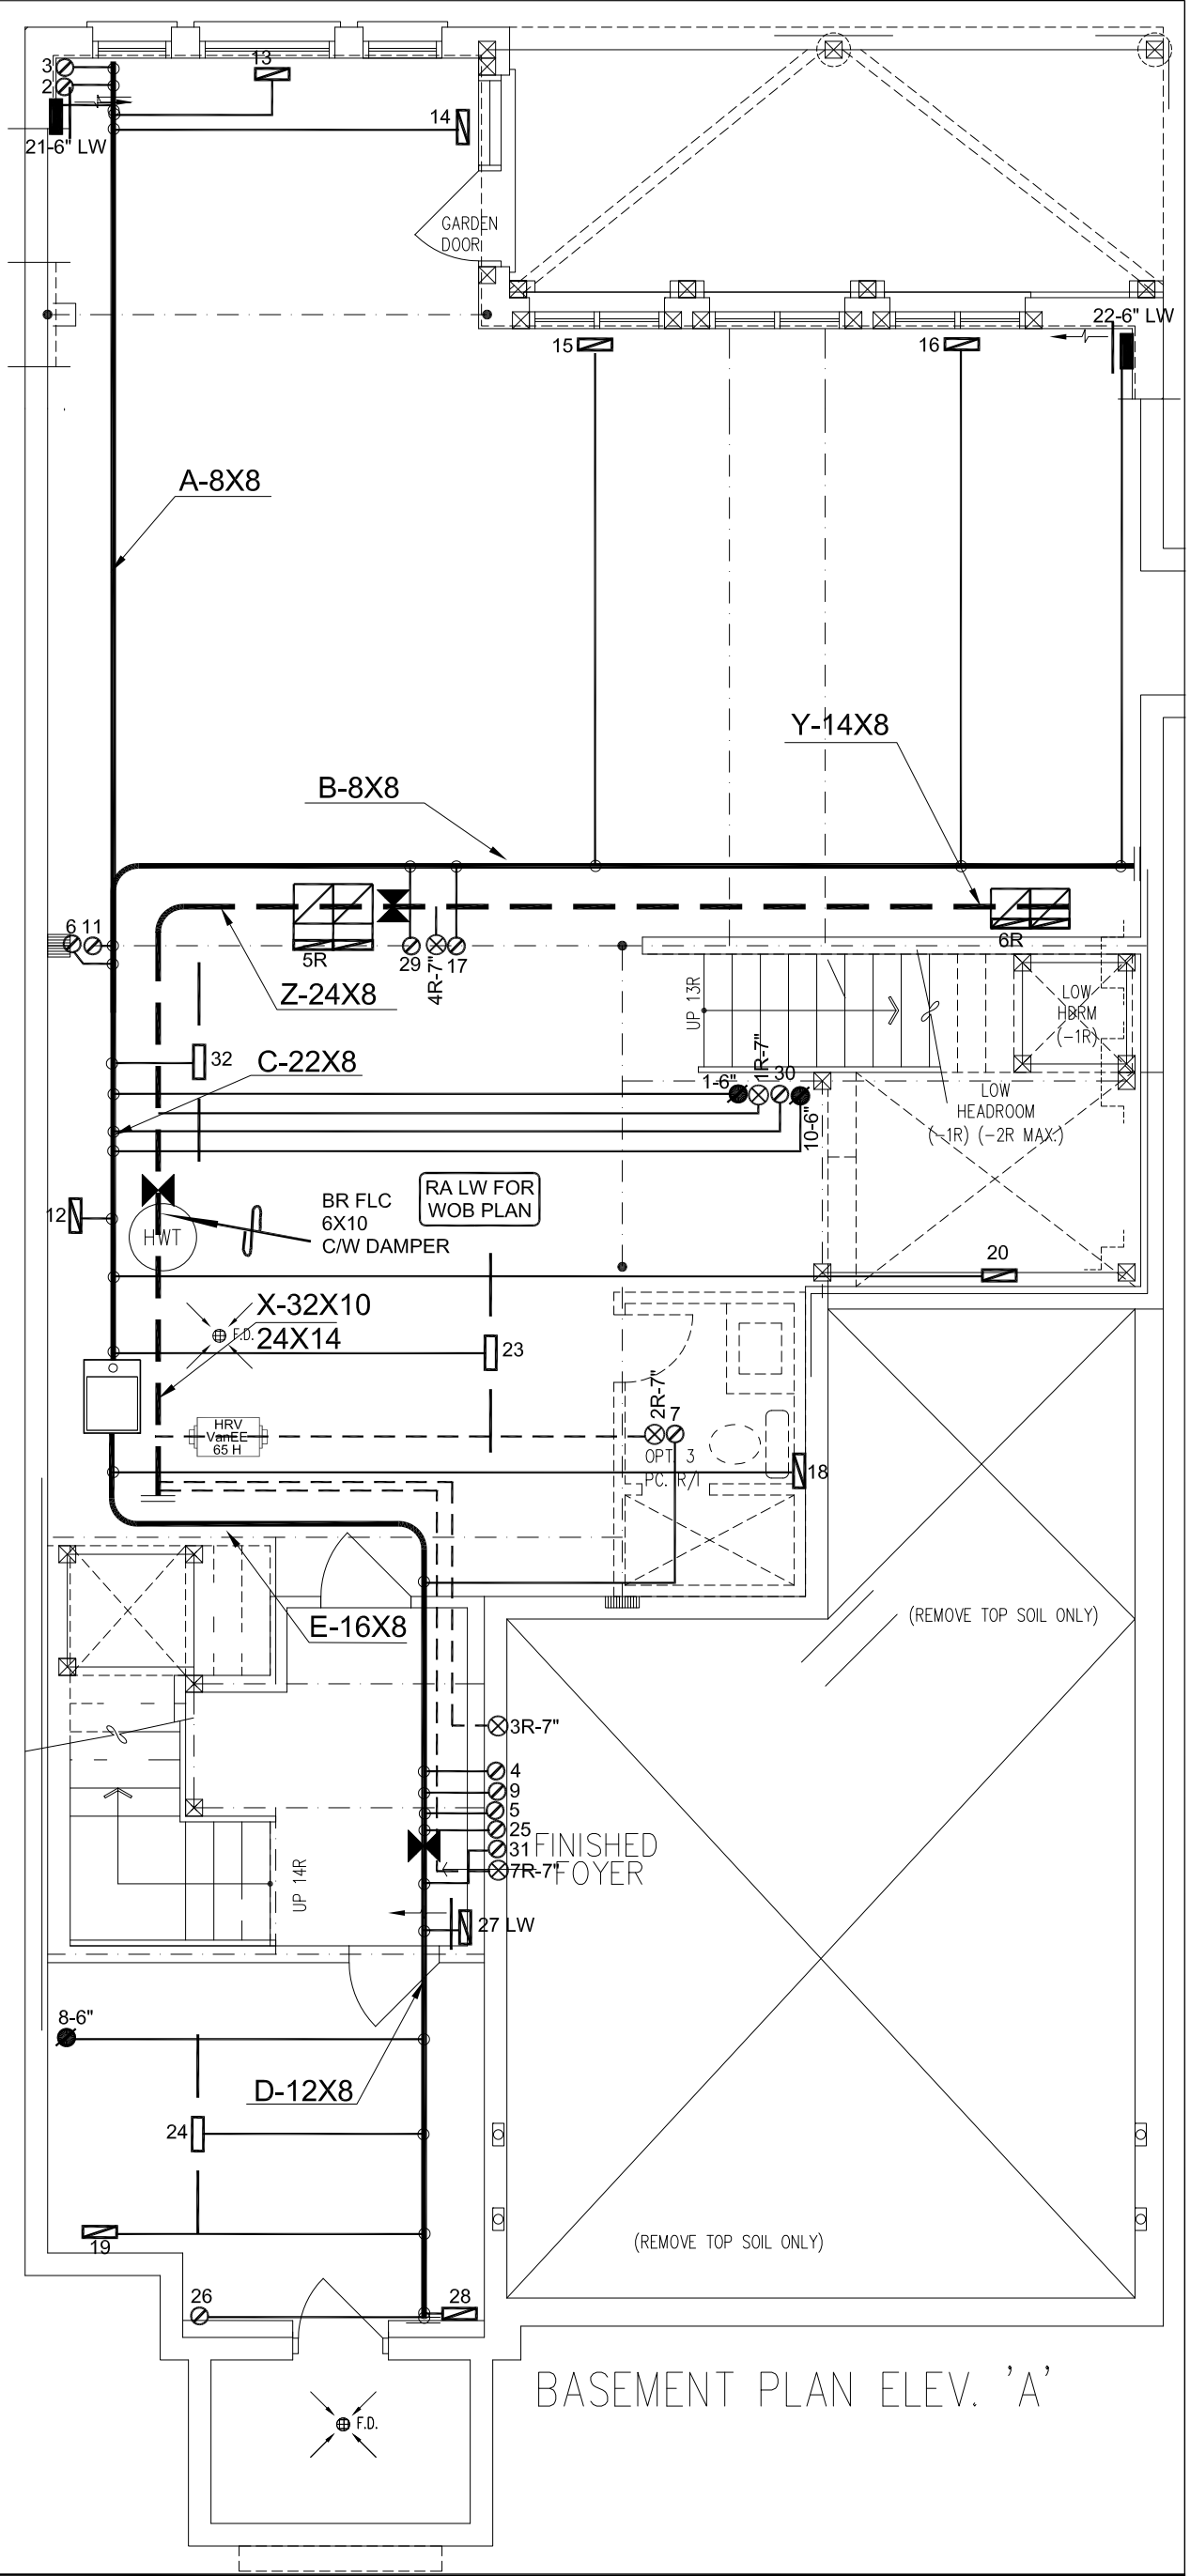

BASEMENT PLAN ELEV. 'A'

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD. © AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client
GOLD PARK HOMES
 Project Name
PINE VALLEY & TESTON VAUGHAN, ONTARIO
OPT SERV STAIR ROSEDALE - WOB
 4202 3700 sqft

HVAC DESIGNS LTD.
 375 Finley Ave. Suite 202 - Ajax, Ontario
 L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
 Email: info@hvacdsgns.ca
 Web: www.hvacdesigns.ca
 Specializing in Residential Mechanical Design Services
 Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.

HEAT LOSS 77413 BTU/H UNIT DATA		# OF RUNS S/A R/A FANS		
MAKE	LENNOX	3RD FLOOR		
MODEL	EL296UH090XE48C	2ND FLOOR	17	5
INPUT	88 MBTU/H	1ST FLOOR	9	2
OUTPUT	85 MBTU/H	BASEMENT	6	1
COOLING	4.0 TONS			
FAN SPEED	1525 cfm @ 0.6" w.c.			


ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A

Sheet Title	
BASEMENT HEATING LAYOUT	Date FEB/2018
	Scale 3/16" = 1'-0"
	BCIN# 19669
LO# 85450	

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.
Michael O'Rourke
 Michael O'Rourke, BCIN# 19669
 HVAC DESIGNS LTD.

HVAC LEGEND	
	DESCRIPTION SUPPLY AIR GRILLE
	DESCRIPTION SUPPLY AIR BOOT ABOVE
	DESCRIPTION 6" SUPPLY AIR STACK ABOVE
	DESCRIPTION 6" SUPPLY AIR STACK FROM 2ND FLOOR
	DESCRIPTION 30" x 30" RETURN AIR GRILLE
	DESCRIPTION FRA-FLOOR RETURN AIR GRILLE
	DESCRIPTION RETURN AIR STACK ABOVE
	DESCRIPTION RETURN AIR STACK 2ND FLOOR
	DESCRIPTION REDUCER

REVISIONS	
No.	Description
1.	
2.	
3.	
Date	

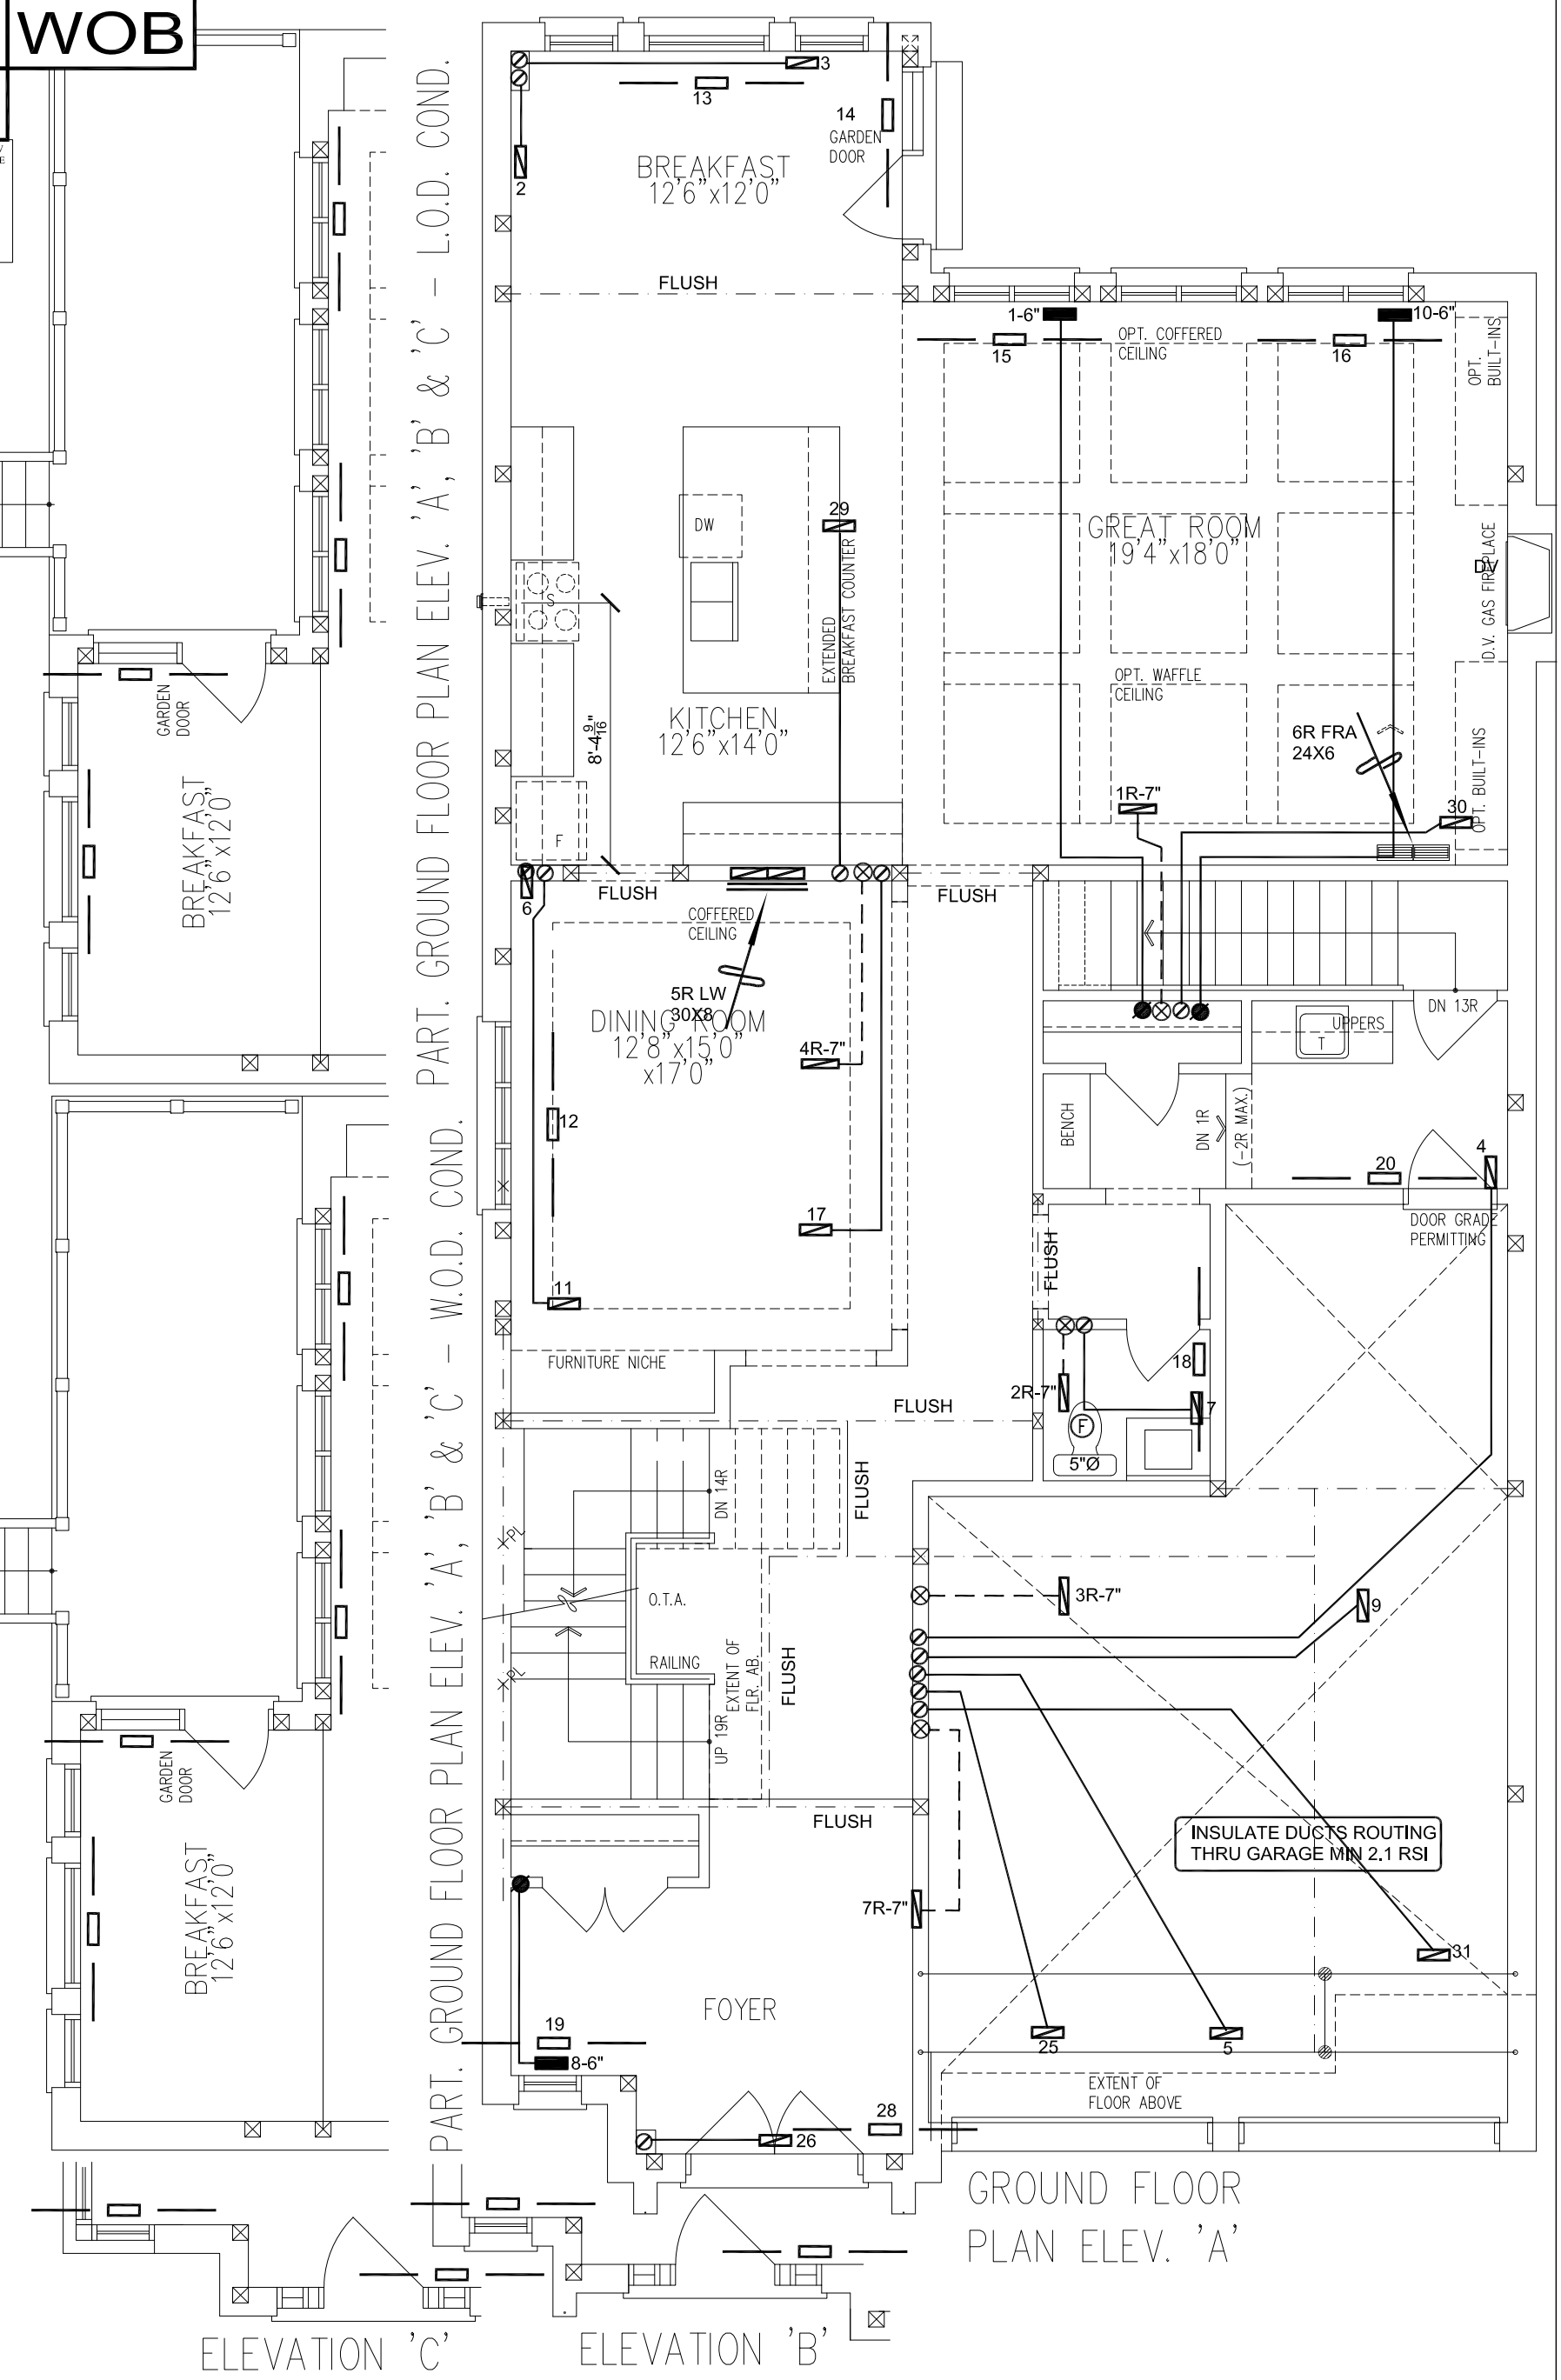

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD. © AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client
GOLD PARK HOMES
 Project Name
PINE VALLEY & TESTON VAUGHAN, ONTARIO
OPT SERV STAIR ROSEDALE - WOB
 4202 3700 sqft

HVAC DESIGNS LTD.
 375 Finley Ave. Suite 202 - Ajax, Ontario
 L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
 Email: info@hvacdsgns.ca
 Web: www.hvacdesigns.ca
 Specializing in Residential Mechanical Design Services
 Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.



Sheet Title	FIRST FLOOR HEATING LAYOUT
Date	FEB/2018
Scale	3/16" = 1'-0"
	BCIN# 19669
LO#	85450

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

PARTIAL SECOND FLOOR PLAN - ELEVATION 'B'

PARTIAL SECOND FLOOR PLAN - ELEVATION 'C'

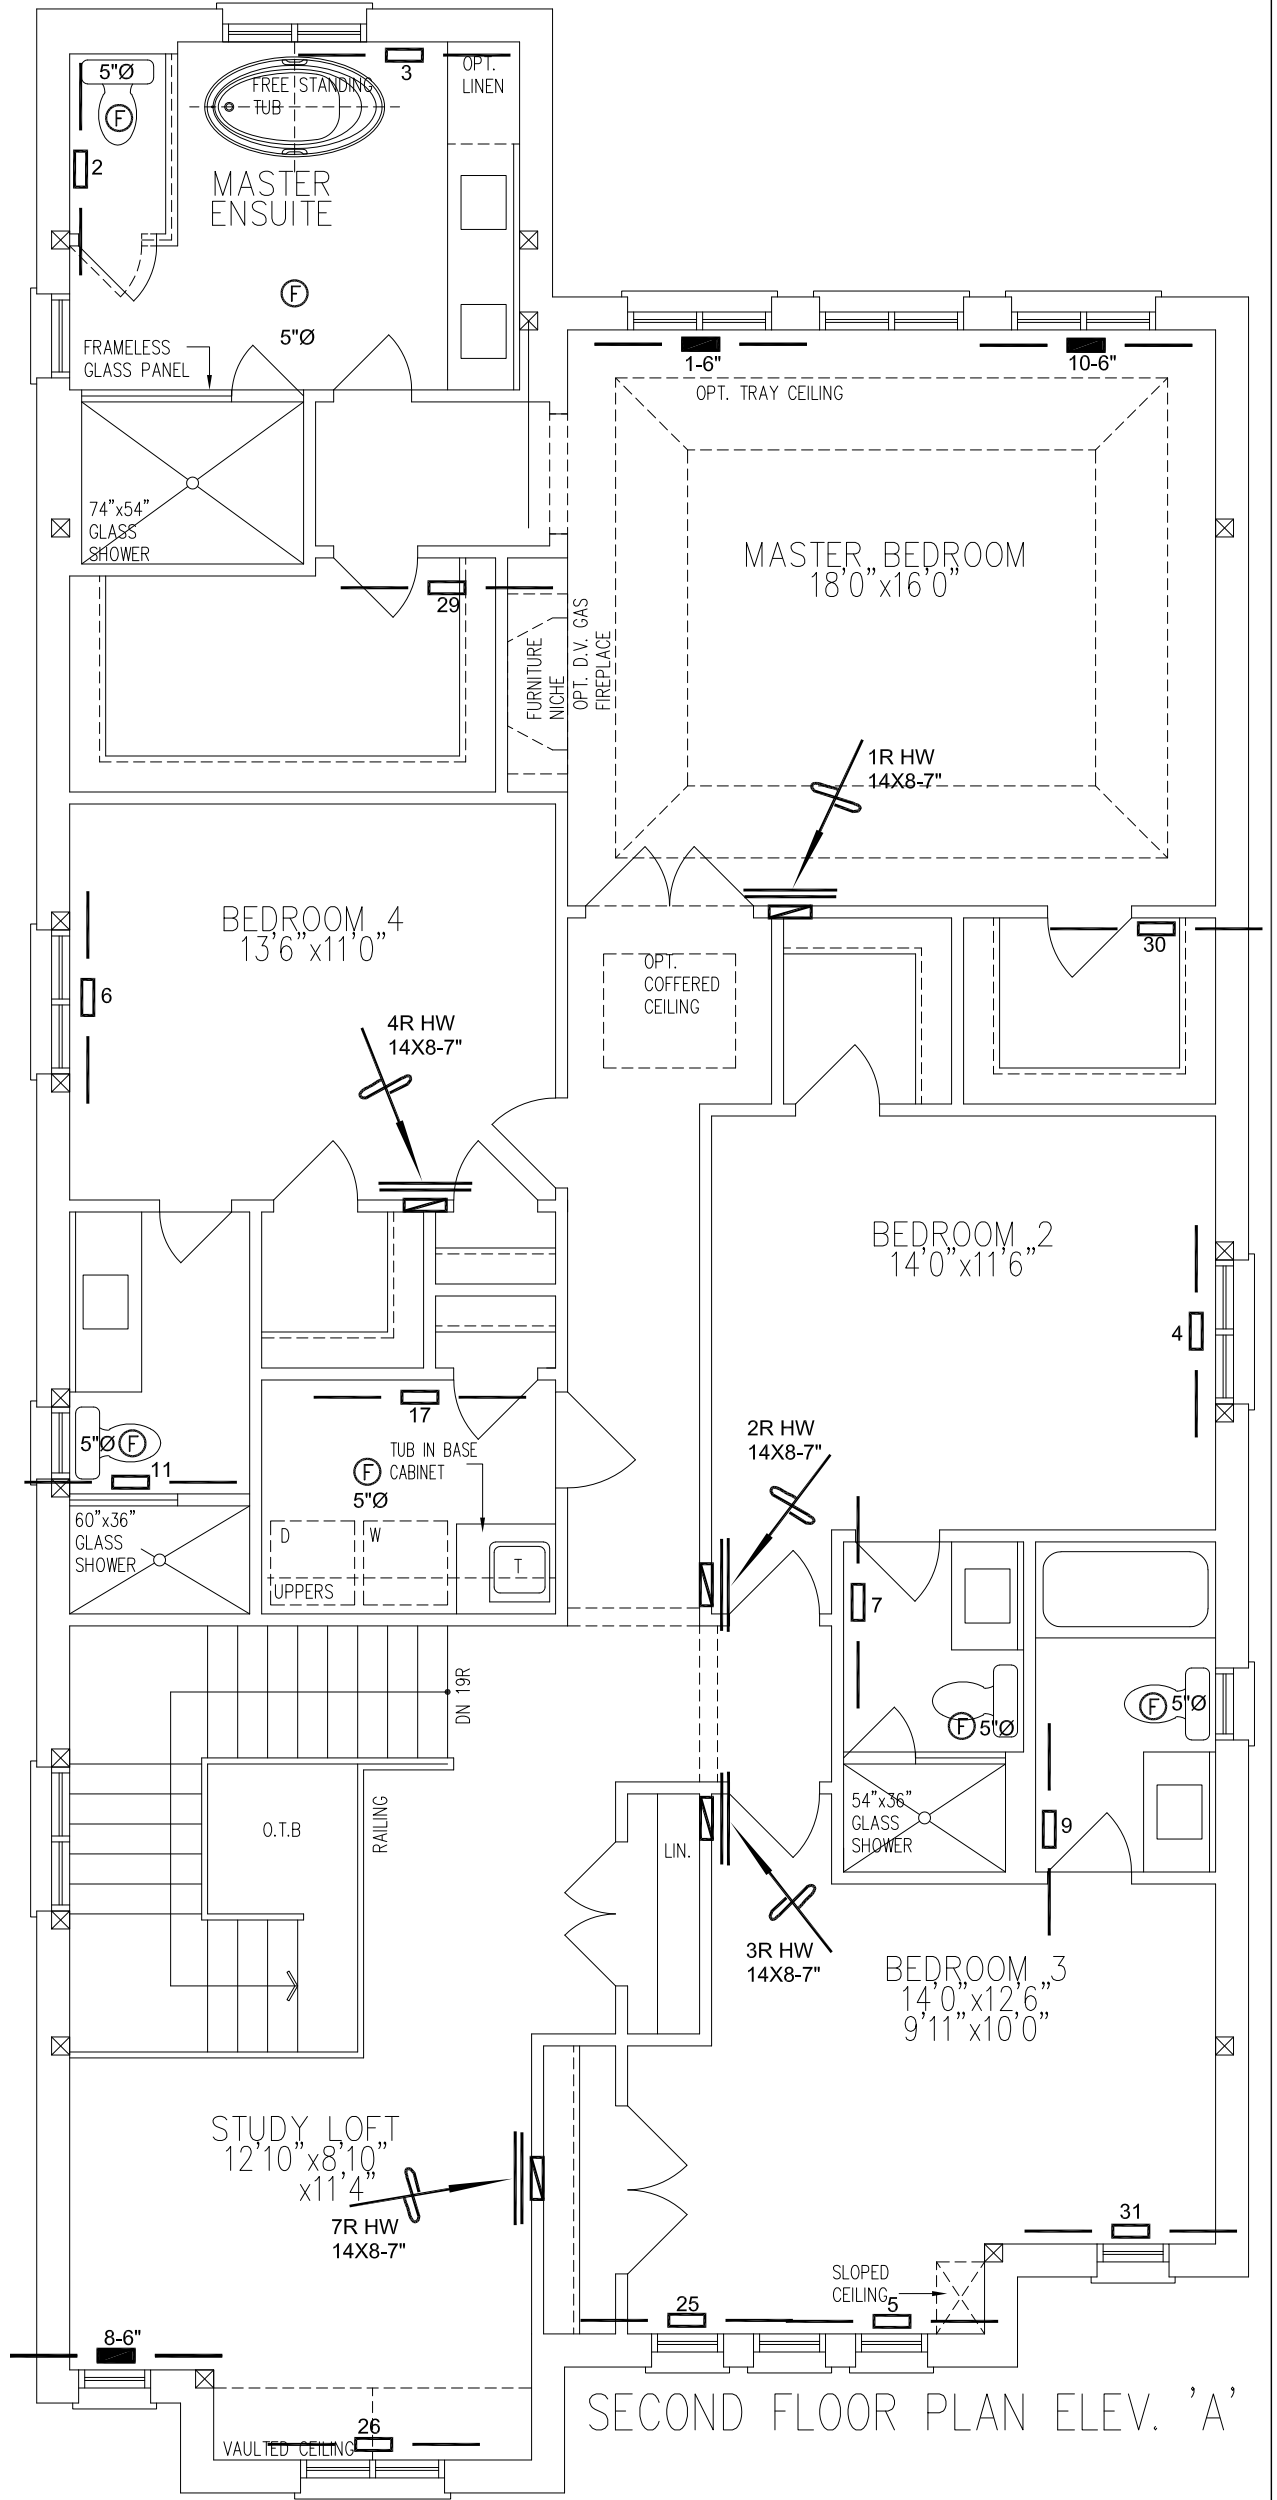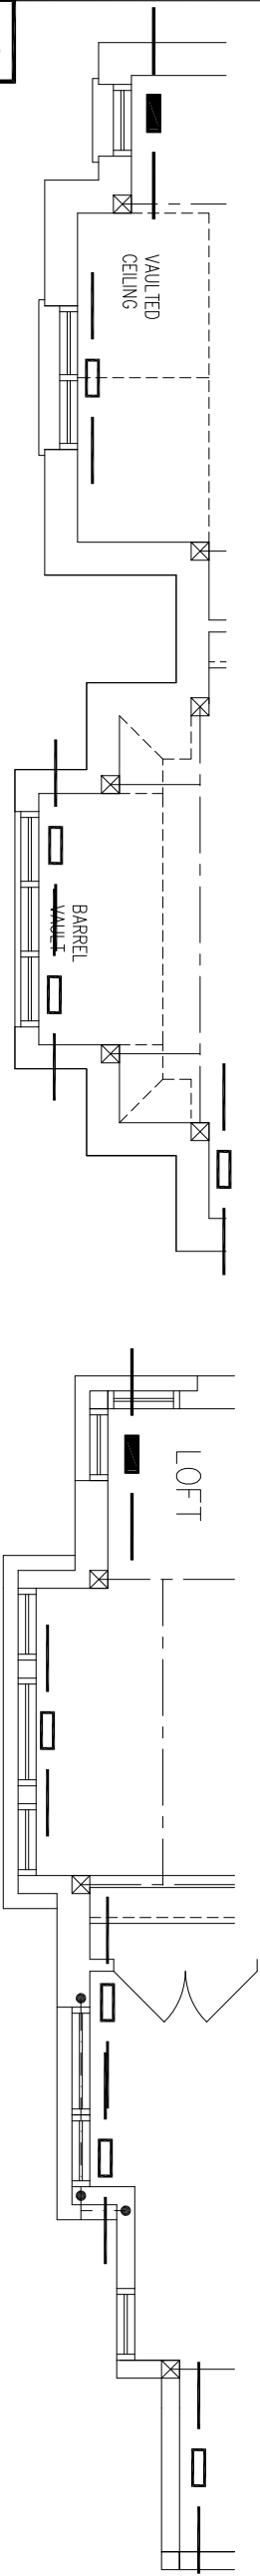

SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRAA-FLOOR RETURN AIR GRILLE

HVAC LEGEND	
	RETURN AIR STACK ABOVE
	RETURN AIR STACK 2nd FLOOR
	REDUCER

NO.	DESCRIPTION	DATE
1.		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD. © AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client
GOLD PARK HOMES

Project Name
PINE VALLEY & TESTON VAUGHAN, ONTARIO
OPT SERV STAIR ROSEDALE - WOB
4202 3700 sqft

HVAC DESIGNS LTD.
375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdsgns.ca
Web: www.hvacdesigns.ca
Specializing in Residential Mechanical Design Services

Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.

Sheet Title	SECOND FLOOR HEATING LAYOUT
Date	FEB/2018
Scale	3/16" = 1'-0"
	BCIN# 19669
LO#	85450