


Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality VAUGHAN (WOODBIDGE)	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 4203- THE FORESTCREST WOB Project: PINE VALLEY & TESTON	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u> declare that (choose one as appropriate): (print name)			
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
February 25, 2020		 Signature of Designer	
Date			

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: PINE VALLEY & TESTON										WOB				DATE: Feb-20				WINTER NATURAL AIR CHANGE RATE 0.407				HEAT LOSS ΔT °F. 76				CSA-F280-12							
BUILDER: GOLD PARK HOMES										TYPE: 4203- THE FORESTCREST				GFA: 3688				LO# 79976				SUMMER NATURAL AIR CHANGE RATE 0.137				HEAT GAIN ΔT °F. 13				SB-12 PACKAGE A1			
ROOM USE			MBR			ENS			HERS			BED-2			BED-3			BED-4			ENS-2			LOFT			ENS-3			ENS-4			
EXP. WALL			38			37			7			12			33			48			6			7			9			8			
CLG. HT.			9			9			9			12			9			9			9			9			9			9			
FACTORS																																	
GRS.WALL AREA			342			333			63			144			297			432			54			63			81			72			
GLAZING			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			
NORTH	21.3	16.0	0	0	0	0	0	0	0	0	0	18	383	288	0	0	0	0	0	0	8	170	128	0	0	0	8	170	128	0	0	0	
EAST	21.3	41.6	0	0	0	0	0	0	0	0	0	0	0	0	61	1298	2535	61	1298	2535	0	0	0	0	0	0	0	0	0	14	298	582	
SOUTH	21.3	24.9	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	18	383	448	0	0	0	0	0	0	0	
WEST	21.3	41.6	44	936	1828	21	447	873	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
SKYLT.	37.2	101.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
DOORS	25.2	4.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
NET EXPOSED WALL	4.5	0.8	298	1330	224	312	1392	235	63	281	47	126	562	95	236	1053	177	371	1656	279	46	205	35	45	201	34	73	326	55	58	259	44	
NET EXPOSED BSMT WALL ABOVE GR	3.6	0.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
EXPOSED CLG	1.3	0.6	357	458	210	280	359	165	91	117	53	252	323	148	204	262	120	210	270	123	120	154	71	100	128	59	100	128	59	100	128	59	
NO ATTIC EXPOSED CLG	2.7	1.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	30	82	38	0	0	0	0	0	0	0	0	0	0	0	0	
EXPOSED FLOOR	2.6	0.4	0	0	0	0	0	0	0	0	0	0	0	0	204	520	88	0	0	0	0	0	0	0	0	0	50	128	21	100	255	43	
BASEMENT/CRAWL HEAT LOSS																																	
SLAB ON GRADE HEAT LOSS																																	
SUBTOTAL HT LOSS				2724			2199			398			1269			3133			3306			530			712			752			940		
SUB TOTAL HT GAIN				2262			1272			101			530			2920			2975			233			541			263			727		
LEVEL FACTOR / MULTIPLIER	0.20	0.38				0.20	0.38			0.20	0.38		0.20	0.38		0.20	0.38		0.20	0.38		0.20	0.38		0.20	0.38		0.20	0.38		0.20	0.38	
AIR CHANGE HEAT LOSS				1022			825			149			476			1176			1240			199			267			282			353		
AIR CHANGE HEAT GAIN				197			111			9			46			254			259			20			47			23			63		
DUCT LOSS				0			0			0			0			431			0			0			0			103			129		
DUCT GAIN				0			0			0			0			400			0			0			0			29			79		
HEAT GAIN PEOPLE	240		2	480		0	0		0	0		1	240		1	240		1	240		0	0		0	0		0	0		0	0	0	
HEAT GAIN APPLIANCES/LIGHTS				588			0			0			588			588			588			0			588			0			0	0	
TOTAL HT LOSS BTU/H				3747			3024			547			1745			4740			4546			728			979			1137			1422		
TOTAL HT GAIN x 1.3 BTU/H				4586			1797			142			1826			5723			5281			329			1529			409			1130		

ROOM USE			DIN			LIV			KT/GT			STUDY			LAUN			PWD			FOY			MUD									WOB			BAS		
EXP. WALL			12			21			75			10			0			6			51			26									43			155		
CLG. HT.			11			20			11			11			9			11			11			12									10			10		
GRS.WALL AREA	FACTORS		132			420			825			110			0			66			561			312									430			1085		
GLAZING	LOSS GAIN		LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN									LOSS GAIN			LOSS GAIN		
NORTH	21.3	16.0	32	681	511	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	4	85	64			
EAST	21.3	41.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
SOUTH	21.3	24.9	0	0	0	74	1575	1843	0	0	0	20	426	498	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	4	85	100					
WEST	21.3	41.6	0	0	0	0	0	0	98	2085	4072	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
SKYLT.	37.2	101.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
DOORS	25.2	4.3	0	0	0	0	0	0	20	505	85	0	0	0	0	0	0	0	0	0	52	1313	221	20	505	85	10	252	43	20	505	85	10	252	43			
NET EXPOSED WALL	4.5	0.8	100	446	75	346	1544	260	707	3155	531	90	402	68	0	0	0	66	295	50	509	2272	383	292	1303	219	319	1424	240	0	0	0	0	0				
NET EXPOSED BSMT WALL ABOVE GR	3.6	0.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	465	1673	282					
EXPOSED CLG	1.3	0.6	0	0	0	231	296	136	0	0	0	0	0	0	130	167	76	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
NO ATTIC EXPOSED CLG	2.7	1.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
EXPOSED FLOOR	2.6	0.4	0	0	0	0	0	0	0	0	0	0	0	0	60	153	26	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
BASEMENT/CRAWL HEAT LOSS			0			0			0			0			0			0			0			0			0			0			0			2509		
SLAB ON GRADE HEAT LOSS			0			0			0			0			0			0			0			0			0			0			552			4858		
SUBTOTAL HT LOSS			1127			3415			5746			827			320			295			3584			1808						4377			4858					
SUB TOTAL HT GAIN			586			2238			4689			566			102			50			604			305						4479			530					
LEVEL FACTOR / MULTIPLIER	0.30	0.55				0.30	0.55		0.30	0.55		0.30	0.55		0.20	0.38		0.30	0.55		0.30	0.55		0.30	0.55		0.30	0.55			0.50	1.65						
AIR CHANGE HEAT LOSS			615			1863			3134			451			120			161			1955			986						15274								
AIR CHANGE HEAT GAIN			51			195			408			49			9			4			53			27						436								
DUCT LOSS			0			0			0			0			44			0			0			0						0								
DUCT GAIN			0			0			0			0			70			0			0			0						0								
HEAT GAIN PEOPLE	240	0	0			0			0			0			0			0			0			0			0			0			0			0		
HEAT GAIN APPLIANCES/LIGHTS			588			588			588			588			588			588			0			588						588								
TOTAL HT LOSS BTU/H			1742			5278			8879			1278			484			455			5540			2794						4929			20132					
TOTAL HT GAIN x 1.3 BTU/H			1593			3928			7391			1564			1000			70			853			1195						5823			202					

TOTAL HEAT GAIN BTU/H:

48727

TONS: 4.06

LOSS DUE TO VENTILATION LOAD BTU/H: 3181

STRUCTURAL HEAT LOSS: 74127

TOTAL COMBINED HEAT LOSS BTU/H: 77308



SITE NAME: PINE VALLEY & TESTON
BUILDER: GOLD PARK HOMES

WOB
TYPE: 4203- THE FORESTCREST

DATE: Feb-20

GFA: 3688

LO# 79976

HEATING CFM 1525 COOLING CFM 1525
TOTAL HEAT LOSS 74,127 TOTAL HEAT GAIN 48,192
AIR FLOW RATE CFM 20.57 AIR FLOW RATE CFM 31.64

furnace pressure 0.6
furnace filter 0.05
a/c coil pressure 0.2
available pressure
for s/a & r/a 0.35

^LENNOX
EL296UH090XE48C

AFUE = 96 %
INPUT (BTU/H) = 88,000
OUTPUT (BTU/H) = 85,000

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	15	10	5
R/A	0	0	5	4	1

plenium pressure s/a 0.18 r/a pressure 0.17
max s/a dif press. loss 0.03 r/a grille press. Loss 0.02
min adjusted pressure s/a 0.15 adjusted pressure r/a 0.15

FAN SPEED 90
LOW 0
MEDLOW 0
MEDIUM 1105
MEDIUM HIGH 1255
HIGH 1525

DESIGN CFM = 1525
CFM @ .6" E.S.P.

All S/A diffusers 4"x10" unless noted otherwise on layout.
All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	MBR	ENS	ENS	BED-2	BED-3	BED-4	ENS-2	LOFT	ENS-3	MBR	ENS-4	DIN	LIV	KT/GT	KT/GT	STUDY	LAUN	PWD	FOY	MUD	BAS	BAS	BAS	BAS
RM LOSS MBH	1.87	1.51	1.51	1.74	2.37	2.27	0.73	0.98	1.14	1.87	1.42	1.74	2.64	2.96	2.96	1.28	0.48	0.46	5.54	2.79	5.01	5.01	5.01	5.01
CFM PER RUN HEAT	39	31	31	36	49	47	15	20	23	39	29	36	54	61	61	26	10	9	114	57	103	103	103	103
RM GAIN MBH	2.29	0.90	0.90	1.83	2.86	2.64	0.33	1.53	0.41	2.29	1.13	1.59	1.96	2.46	2.46	1.56	1.00	0.07	0.85	1.20	1.57	1.57	1.57	1.57
CFM PER RUN COOLING	73	28	28	58	91	84	10	48	13	73	36	50	62	78	78	49	32	2	27	38	50	50	50	50
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.16	0.16	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.15	0.17	0.16	0.16	0.16	0.16
ACTUAL DUCT LGH	46	62	72	29	47	64	21	53	42	41	42	8	28	57	49	35	32	43	55	8	63	43	24	46
EQUIVALENT LENGTH	130	160	140	160	150	170	140	180	190	130	120	90	150	130	120	140	110	140	120	130	180	150	150	110
TOTAL EFFECTIVE LENGTH	176	222	212	189	197	234	161	233	232	171	162	98	178	187	169	175	142	183	175	138	243	193	174	156
ADJUSTED PRESSURE	0.1	0.08	0.08	0.09	0.08	0.07	0.11	0.07	0.07	0.1	0.11	0.18	0.1	0.09	0.1	0.1	0.12	0.09	0.09	0.12	0.07	0.08	0.09	0.1
ROUND DUCT SIZE	5	4	4	5	6	6	4	5	4	5	4	4	5	5	5	4	4	4	6	4	6	6	6	6
HEATING VELOCITY (ft/min)	286	356	356	264	250	240	172	147	264	286	333	413	396	448	448	298	115	103	581	654	525	525	525	525
COOLING VELOCITY (ft/min)	536	321	321	426	464	428	115	352	149	536	413	574	455	573	573	562	367	23	138	436	255	255	255	255
OUTLET GRILL SIZE	3X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	3X10	4X10	4X10	4X10	4X10
TRUNK	C	A	A	D	C	B	D	A	E	E	C	D	B	A	A	A	C	B	B	E	A	D	B	B

RUN #	25	26	27	28	29	30
ROOM NAME	BED-3	BED-4	KT/GT	LIV	HERS	BAS
RM LOSS MBH	2.37	2.27	2.96	2.64	0.55	5.01
CFM PER RUN HEAT	49	47	61	54	11	103
RM GAIN MBH	2.86	2.64	2.46	1.96	0.14	1.57
CFM PER RUN COOLING	91	84	78	62	5	50
ADJUSTED PRESSURE	0.16	0.16	0.17	0.17	0.17	0.16
ACTUAL DUCT LGH	49	66	41	31	73	12
EQUIVALENT LENGTH	170	130	90	130	180	120
TOTAL EFFECTIVE LENGTH	219	196	131	161	253	132
ADJUSTED PRESSURE	0.07	0.08	0.13	0.11	0.07	0.12
ROUND DUCT SIZE	6	6	5	5	4	6
HEATING VELOCITY (ft/min)	250	240	448	396	126	525
COOLING VELOCITY (ft/min)	464	428	573	455	57	255
OUTLET GRILL SIZE	4X10	4X10	3X10	3X10	3X10	4X10
TRUNK	C	B	C	B	A	D

SUPPLY AIR TRUNK SIZE

	TRUNK	STATIC	ROUND	RECT	VELOCITY		TRUNK	STATIC	ROUND	RECT	VELOCITY
	CFM	PRESS.	DUCT	DUCT	(ft/min)		CFM	PRESS.	DUCT	DUCT	(ft/min)
TRUNK A	344	0.07	9.7	12	x 8	516	TRUNK G	0	0.00	0	0 x 8 0
TRUNK B	531	0.07	11.4	16	x 8	597	TRUNK H	0	0.00	0	0 x 8 0
TRUNK C	1112	0.07	15.1	26	x 8	770	TRUNK I	0	0.00	0	0 x 8 0
TRUNK D	293	0.08	8.9	10	x 8	527	TRUNK J	0	0.00	0	0 x 8 0
TRUNK E	1231	0.07	15.7	28	x 8	791	TRUNK K	0	0.00	0	0 x 8 0
TRUNK F	0	0.00	0	0	x 8	0	TRUNK L	0	0.00	0	0 x 8 0

RETURN AIR TRUNK SIZE

	TRUNK	STATIC	ROUND	RECT	VELOCITY
	CFM	PRESS.	DUCT	DUCT	(ft/min)
TRUNK O	0	0.06	0	0	x 8 0
TRUNK P	0	0.06	0	0	x 8 0
TRUNK Q	0	0.06	0	0	x 8 0
TRUNK R	0	0.06	0	0	x 8 0
TRUNK S	0	0.06	0	0	x 8 0
TRUNK T	0	0.06	0	0	x 8 0
TRUNK U	0	0.06	0	0	x 8 0
TRUNK V	0	0.06	0	0	x 8 0
TRUNK W	0	0.06	0	0	x 8 0
TRUNK X	1525	0.06	17.7	32	x 10 686
TRUNK Y	485	0.06	11.5	16	x 8 546
TRUNK Z	915	0.06	14.6	24	x 8 686
DROP	1525	0.06	17.7	24	x 14 654

RETURN AIR #	1	2	3	4	5	6	7	8	9	BR
AIR VOLUME	175	125	125	130	155	175	155	155	125	0 205
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15 0.15
ACTUAL DUCT LGH	48	46	47	56	47	32	23	33	48	1 1 1 1 14
EQUIVALENT LENGTH	165	185	205	145	200	195	205	195	190	0 0 0 0 145
TOTAL EFFECTIVE LH	213	231	252	201	247	227	228	228	238	1 1 1 1 159
ADJUSTED PRESSURE	0.07	0.06	0.06	0.07	0.06	0.07	0.06	0.06	0.06	14.80 14.80 14.80 14.80 14.80 0.09
ROUND DUCT SIZE	7.5	6.9	6.9	6.8	7.5	7.5	7.5	6.9	0	0 0 0 0 7.5
INLET GRILL SIZE	8	8	8	8	8	8	8	8	0	0 0 0 0 8
	X	X	X	X	X	X	X	X	X	X X X X X
INLET GRILL SIZE	14	14	14	14	14	14	14	14	0	0 0 0 0 14

TYPE: 4203- THE FORESTCREST
SITE NAME: PINE VALLEY & TESTON

LO # 79976
WOB

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm	<u>42.4</u> cfm
Other Bedrooms	<u>3</u> @ 10.6 cfm	<u>31.8</u> cfm
Kitchen & Bathrooms	<u>6</u> @ 10.6 cfm	<u>63.6</u> cfm
Other Rooms	<u>8</u> @ 10.6 cfm	<u>84.8</u> cfm
Table 9.32.3.A.	TOTAL	<u>222.6</u> cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		<u>79.5</u> cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>222.6</u>	cfm
Less Principal Ventil. Capacity	<u>155</u>	cfm
Required Supplemental Capacity	<u>67.6</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY			
Model:	VANEE 65H		
Location:	BSMT		
<u>155.0</u> cfm	<u>3.0</u> sones		
☒ HVI Approved			
PRINCIPAL EXHAUST HEAT LOSS CALCULATION			
CFM	ΔT °F	FACTOR	% LOSS
155.0 CFM	X 76 F	X 1.08	X 0.25

SUPPLEMENTAL FANS		NUTONE		
Location	Model	cfm	HVI	Sones
ENS	QTXEN050C	50	☒	0.3
ENS-2	QTXEN050C	50	☒	0.3
ENS-4	QTXEN050C	50	☒	0.3
PWD	QTXEN050C	50	☒	0.3

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE 65H	
<u>155</u> cfm high	<u>64</u> cfm low	
<u>75</u> % Sensible Efficiency @ 32 deg F (0 deg C)	☒ HVI Approved	

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
GOLD PARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	February-20

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																												
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																												
LO#: 79976	Model: 4203- THE FORESTCREST	Builder: GOLD PARK HOMES	Date: 2/25/2020																																																									
Volume Calculation			Air Change & Delta T Data																																																									
House Volume <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr> <td>Bsmt</td> <td>1728</td> <td>10</td> <td>17280</td> </tr> <tr> <td>First</td> <td>1728</td> <td>11</td> <td>19008</td> </tr> <tr> <td>Second</td> <td>2103</td> <td>9</td> <td>18927</td> </tr> <tr> <td>Third</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td>Fourth</td> <td>0</td> <td>9</td> <td>0</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>55,215.0 ft³</td> </tr> <tr> <td colspan="3" style="text-align: right;">Total:</td> <td>1563.5 m³</td> </tr> </tbody> </table>			Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	1728	10	17280	First	1728	11	19008	Second	2103	9	18927	Third	0	9	0	Fourth	0	9	0	Total:			55,215.0 ft³	Total:			1563.5 m³	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td style="width: 80%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 20%; text-align: center;">0.407</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td style="text-align: center;">0.137</td> </tr> </table> <table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td style="text-align: center;">22</td> <td style="text-align: center;">-20</td> <td style="text-align: center;">42</td> <td style="text-align: center;">76</td> </tr> <tr> <td>Summer DTDc</td> <td style="text-align: center;">24</td> <td style="text-align: center;">31</td> <td style="text-align: center;">7</td> <td style="text-align: center;">13</td> </tr> </table>		WINTER NATURAL AIR CHANGE RATE	0.407	SUMMER NATURAL AIR CHANGE RATE	0.137	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-20	42	76	Summer DTDc	24	31	7	13
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																									
Bsmt	1728	10	17280																																																									
First	1728	11	19008																																																									
Second	2103	9	18927																																																									
Third	0	9	0																																																									
Fourth	0	9	0																																																									
Total:			55,215.0 ft³																																																									
Total:			1563.5 m³																																																									
WINTER NATURAL AIR CHANGE RATE	0.407																																																											
SUMMER NATURAL AIR CHANGE RATE	0.137																																																											
Design Temperature Difference																																																												
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																								
Winter DTDh	22	-20	42	76																																																								
Summer DTDc	24	31	7	13																																																								
5.2.3.1 Heat Loss due to Air Leakage			6.2.6 Sensible Gain due to Air Leakage																																																									
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.407 x 434.31 x 42 °C x 1.2 = 8953 W = 30549 Btu/h			$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ = 0.137 x 434.31 x 7 °C x 1.2 = 506 W = 1726 Btu/h																																																									
5.2.3.2 Heat Loss due to Mechanical Ventilation			6.2.7 Sensible heat Gain due to Ventilation																																																									
$HL_{vaib} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 155 CFM x 76 °F x 1.08 x 0.25 = 3181 Btu/h			$HL_{vaib} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 155 CFM x 13 °F x 1.08 x 0.25 = 536 Btu/h																																																									
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																												
$HL_{airr} = Level\ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$ <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairve Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{level})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td>0.5</td> <td rowspan="5" style="text-align: center; vertical-align: middle;">30,549</td> <td style="text-align: center;">9,234</td> <td style="text-align: center;">1.654</td> </tr> <tr> <td>2</td> <td>0.3</td> <td style="text-align: center;">16,802</td> <td style="text-align: center;">0.545</td> </tr> <tr> <td>3</td> <td>0.2</td> <td style="text-align: center;">16,282</td> <td style="text-align: center;">0.375</td> </tr> <tr> <td>4</td> <td>0</td> <td style="text-align: center;">0</td> <td style="text-align: center;">0.000</td> </tr> <tr> <td>5</td> <td>0</td> <td style="text-align: center;">0</td> <td style="text-align: center;">0.000</td> </tr> </tbody> </table> *HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0					Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{level})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)	1	0.5	30,549	9,234	1.654	2	0.3	16,802	0.545	3	0.2	16,282	0.375	4	0	0	0.000	5	0	0	0.000																														
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{level})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																								
1	0.5	30,549	9,234	1.654																																																								
2	0.3		16,802	0.545																																																								
3	0.2		16,282	0.375																																																								
4	0		0	0.000																																																								
5	0		0	0.000																																																								

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 4203- THE FORESTCREST	WOB	BUILDER: GOLD PARK HOMES
SFQT: 3688	LO# 79976	SITE: PINE VALLEY & TESTON

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-4	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	55215.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 66.0 ft	WIDTH: 33.0 ft	EXPOSED PERIMETER:	155.0 ft
WOB INSULATION CONFIGURATION	SCB_9	WOB EXPOSED PERIMETER	43.0 ft

2012 OBC - COMPLIANCE PACKAGE


Component	Compliance Package A1	
	Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22	17.03
Basement Walls Minimum RSI (R)-Value	20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	0.28	-
Skylights Maximum U-Value	0.49	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.8	-

INDIVIDUAL BCIN: 19669
MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

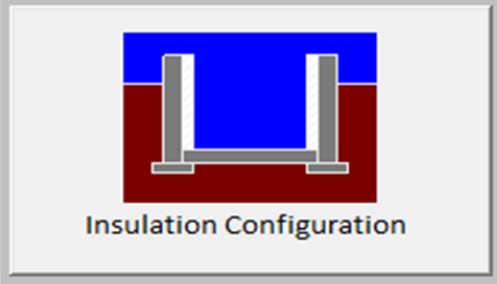
Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	4.6	 Insulation Configuration
Floor Width (m):	10.1	
Exposed Perimeter (m):	47.2	
Wall Height (m):	3.0	
Depth Below Grade (m):	1.79	
Window Area (m ²):	0.7	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		735

TYPE: 4203- THE FORESTCREST
LO# 79976

WOB

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

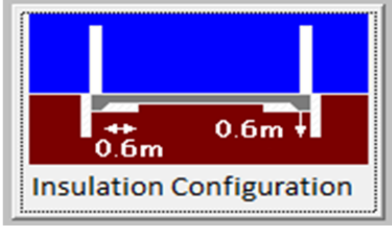Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Length (m):	1.5	
Width (m):	10.1	
Exposed Perimeter (m):	13.1	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Results		
Heating Load (Watts):		162

TYPE: 4203- THE FORESTCREST
LO# 79976

WOB

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Vaughan (Woodbridge)			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	9.14			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1563.5			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	2084.2 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	73.2	73.2		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.407			
Cooling Air Leakage Rate (ACH/H):	0.137			

TYPE: 4203- THE FORESTCREST
LO# 79976

WOB

CSA-F280-12

PACKAGE A1


WOB

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke

Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC LEGEND				
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE	1.
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR	2.
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR	3.
	FRA- FLOOR RETURN AIR GRILLE		14"x8" RETURN AIR GRILLE	
	30"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	
	RETURN AIR STACK 2nd FLOOR		REDUCER	
REVISIONS			No.	Description
				Date

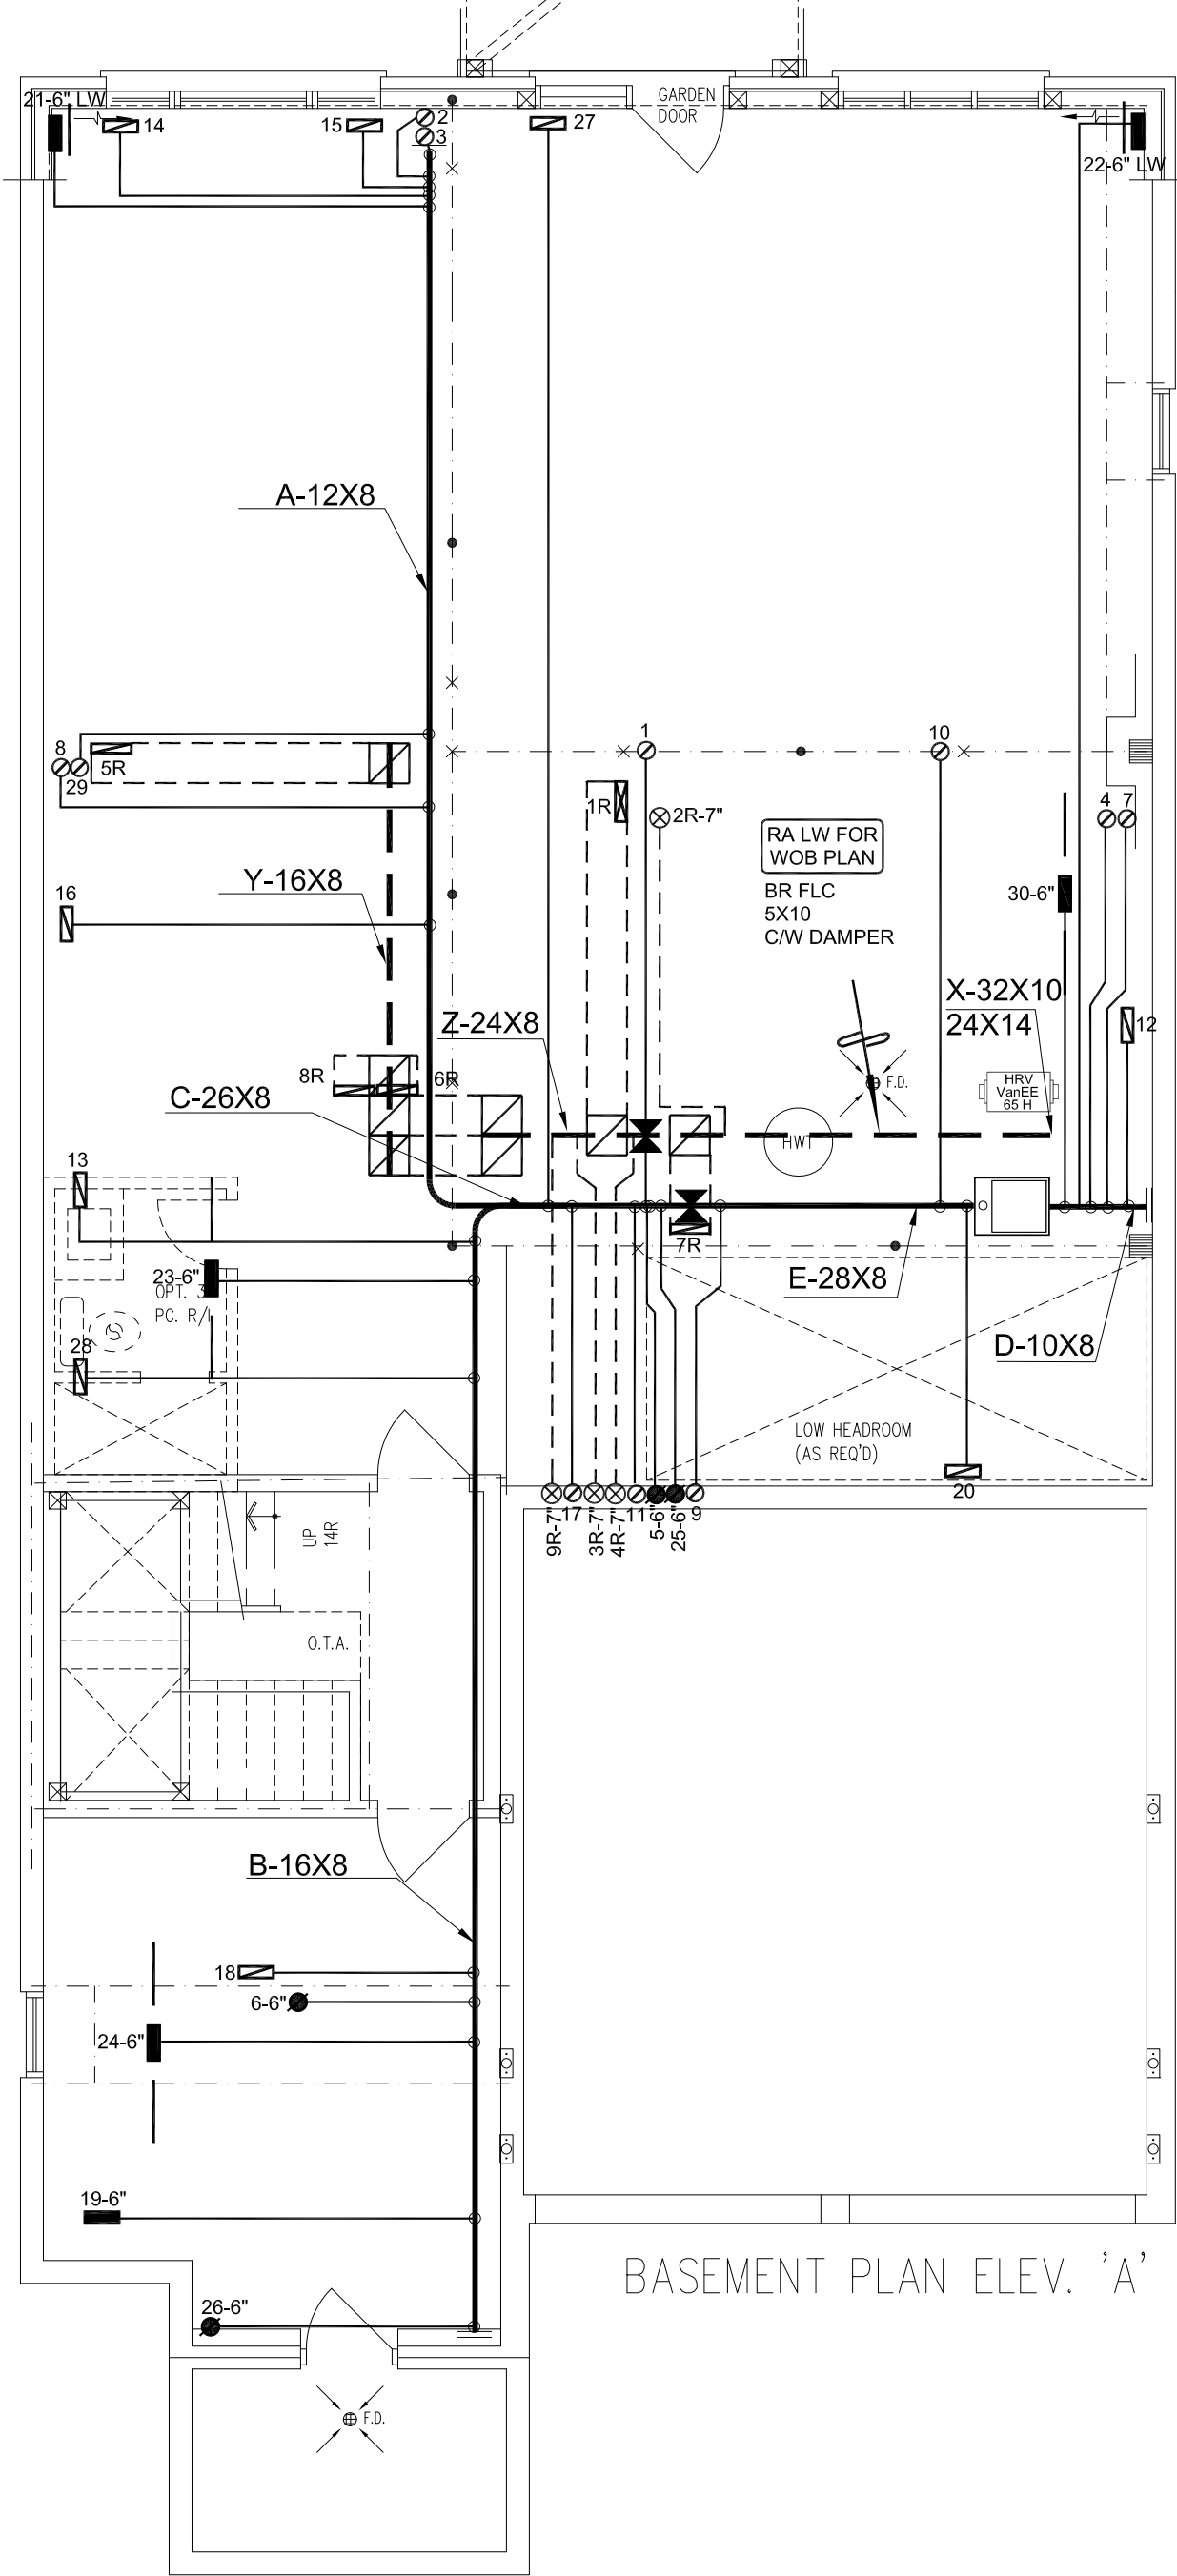

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client	 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services	HEAT LOSS 77308 BTU/H UNIT DATA		# OF RUNS S/A R/A FANS			Sheet Title		
GOLD PARK HOMES		MAKE LENNOX		3RD FLOOR			BASEMENT HEATING LAYOUT		
Project Name		MODEL EL296UH090XE48C		2ND FLOOR	15	5			6
PINE VALLEY & TESTON VAUGHAN, ONTARIO		INPUT 88 MBTU/H		1ST FLOOR	10	4			2
		OUTPUT 85 MBTU/H		BASEMENT	5	1	0	Date	SEPT/2018
	COOLING 4.0 TONS		ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A				Scale	3/16" = 1'-0"	
THE FORESTCREST - WOB 4203 3688 sqft	FAN SPEED 1525 cfm @ 0.6" w.c.						BCIN# 19669		
							LO#	79976	

CSA-F280-12

PACKAGE A1


WOB

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke

Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC LEGEND					
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK FROM 2nd FLOOR
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE
	RETURN AIR GRILLE		RETURN AIR STACK ABOVE		REDUCER
REVISIONS			No.	Description	Date
			1.	REVISED AS PER ARCHITECTURALS	FEB/2020

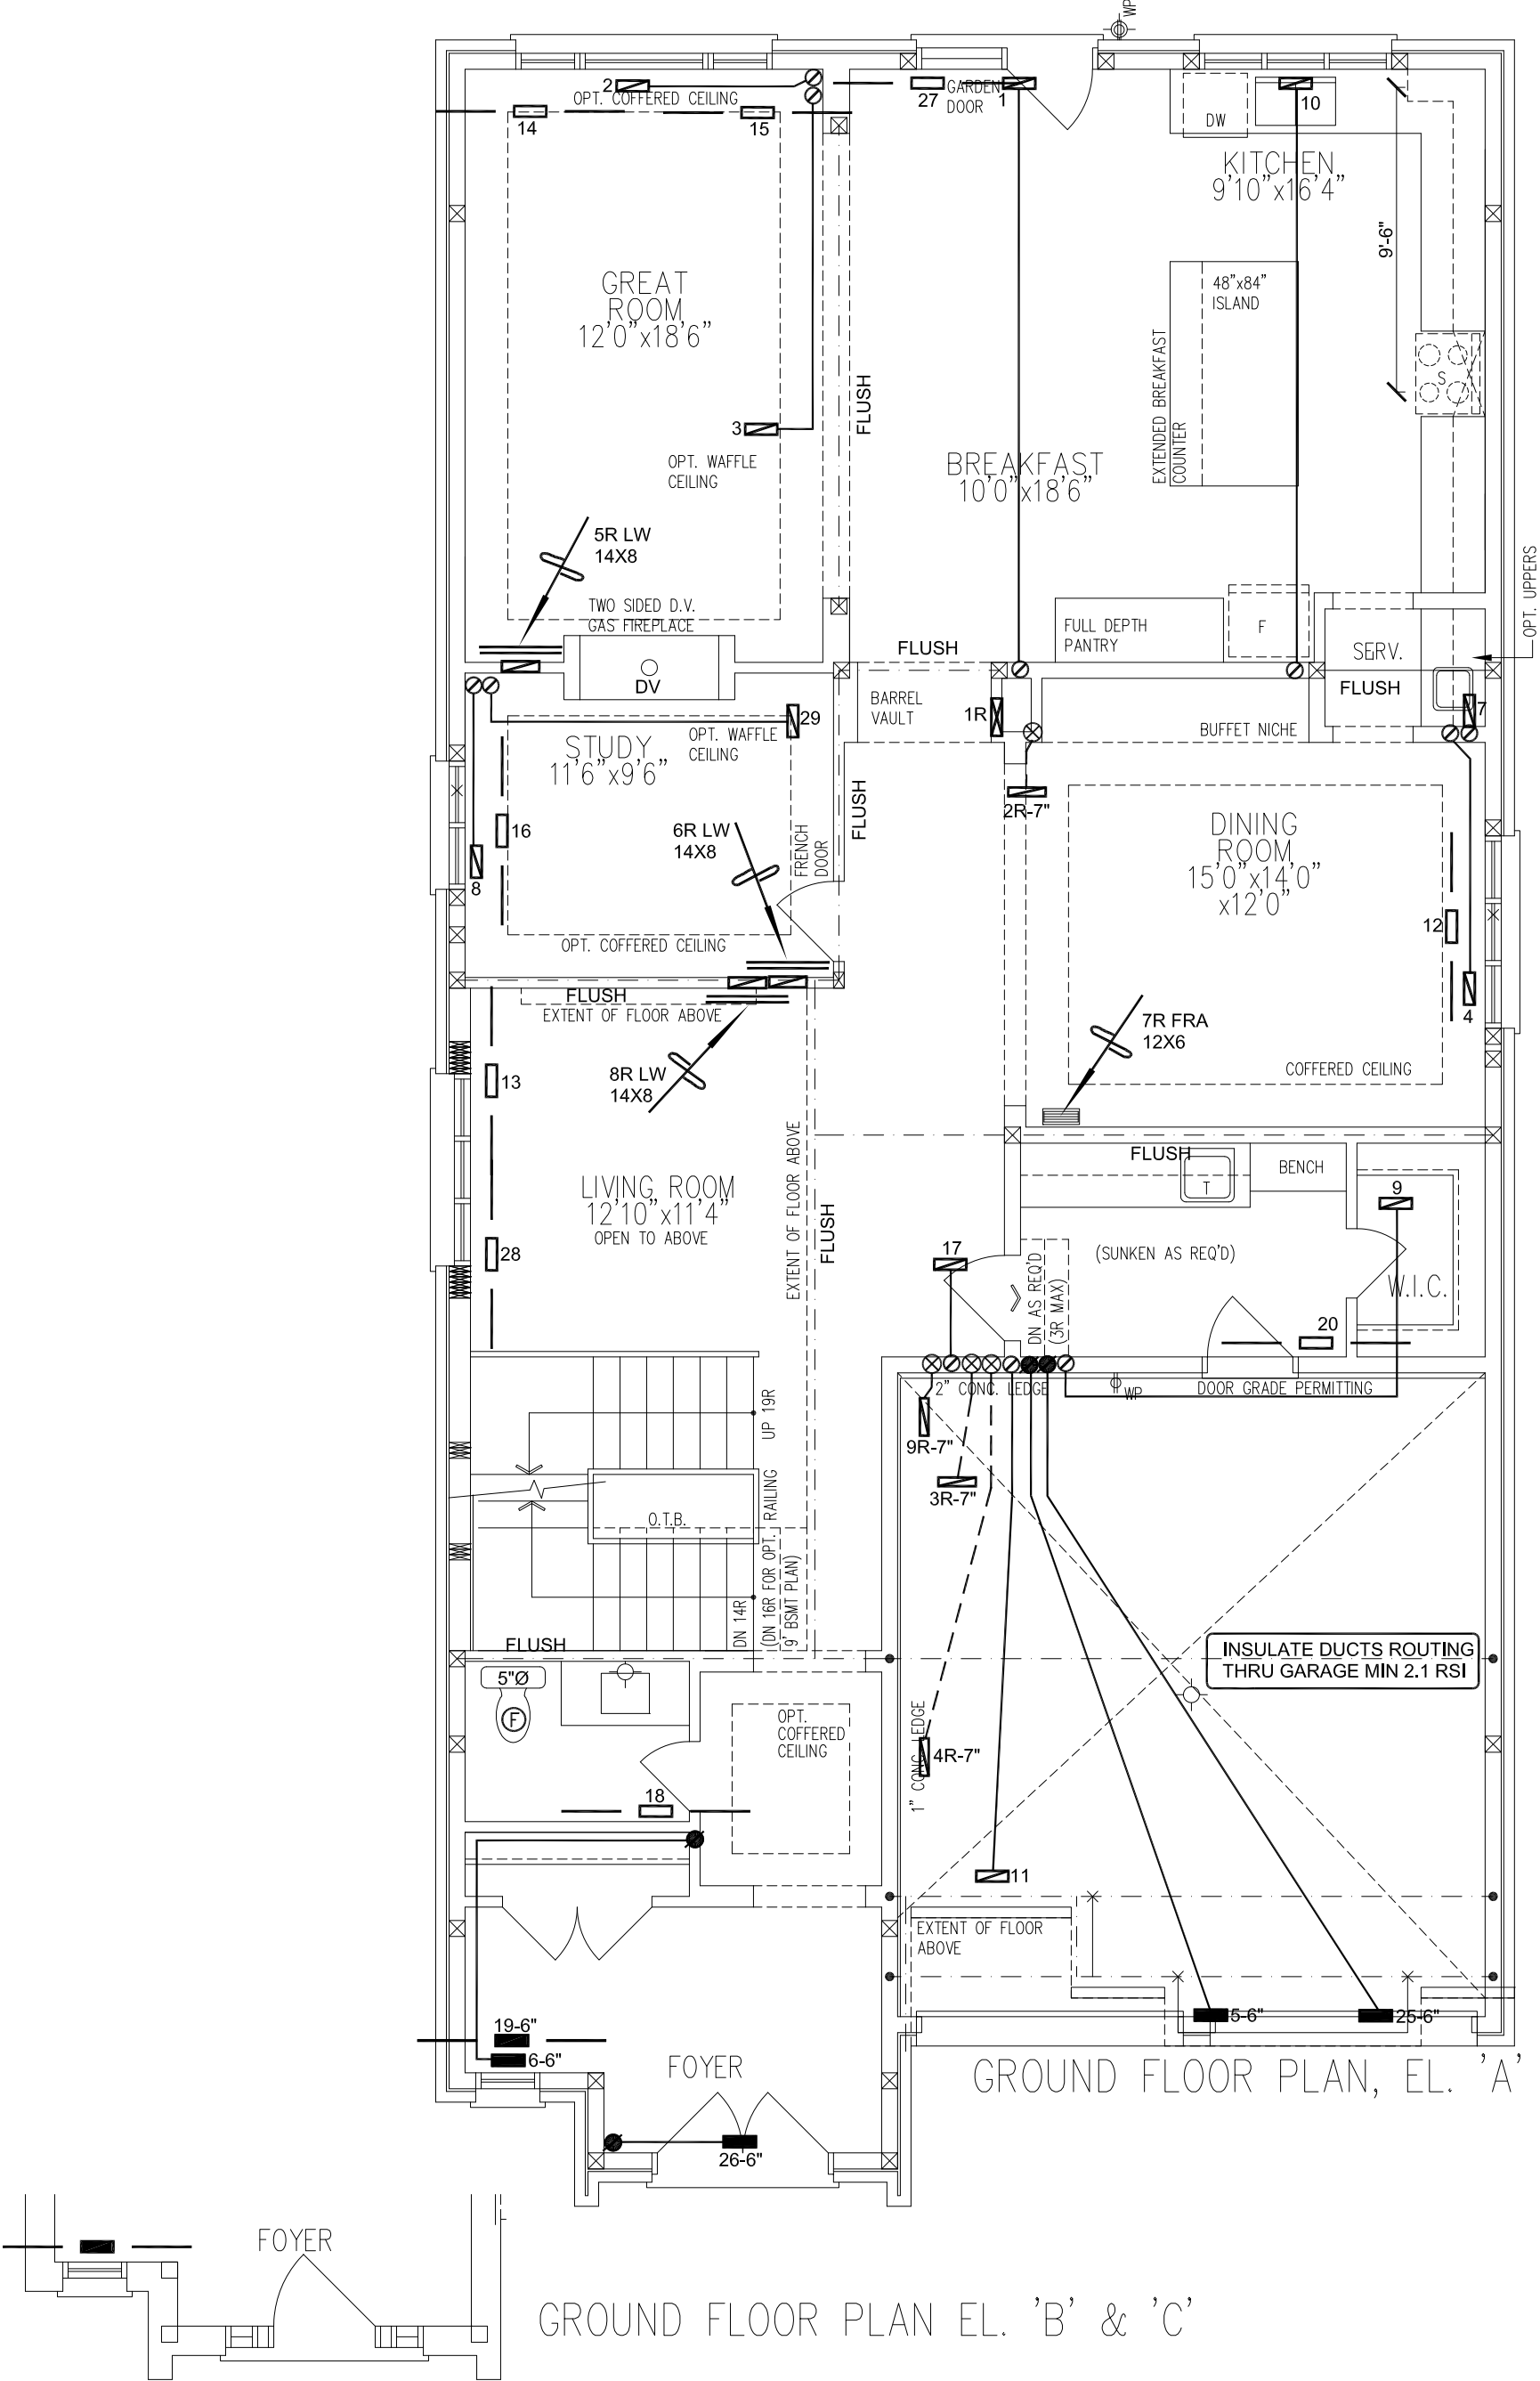

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client	GOLD PARK HOMES
Project Name	PINE VALLEY & TESTON VAUGHAN, ONTARIO
	THE FORESTCREST - WOB 4203 3688 sqft

HVACDESIGNS LTD.

375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdesigns.ca
Web: www.hvacdesigns.ca

Specializing in Residential Mechanical Design Services

Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.


Sheet Title	FIRST FLOOR HEATING LAYOUT
Date	SEPT/2018
Scale	3/16" = 1'-0"
	BCIN# 19669
LO#	79976

CSA-F280-12



PACKAGE A1

WOB

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.


Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

HVAC LEGEND					
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		RETURN AIR STACK ABOVE
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		RETURN AIR STACK 2nd FLOOR
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		REDUCER
			1.	2.	3.
			REVISAS PER ARCHITECTURALS		
			Description		Date
			REVISIONS		

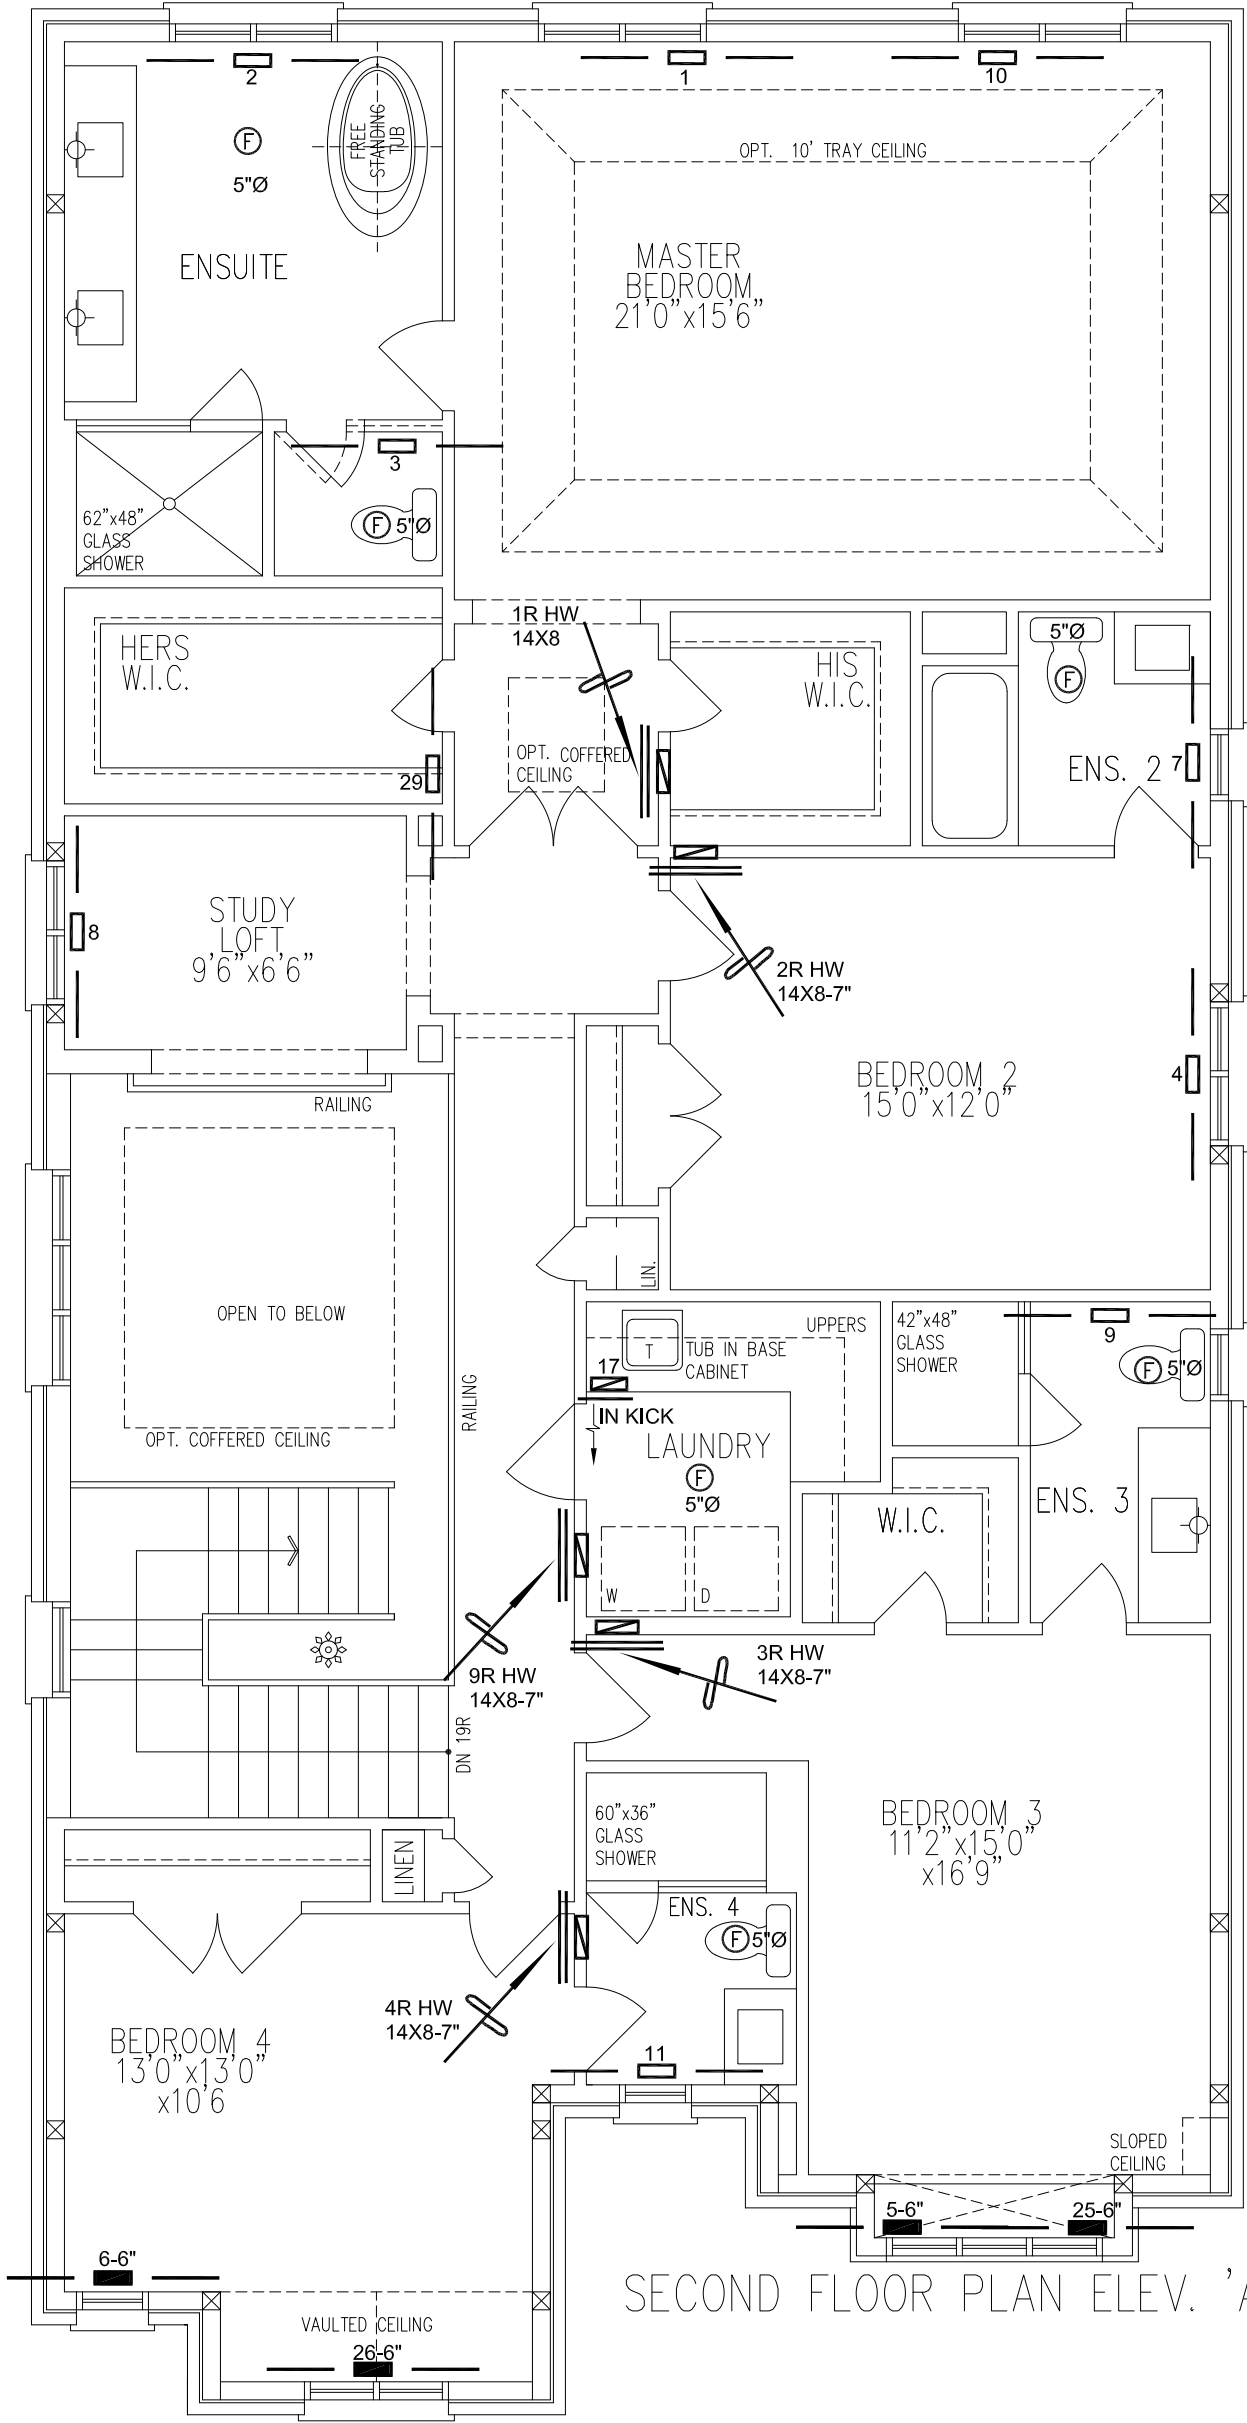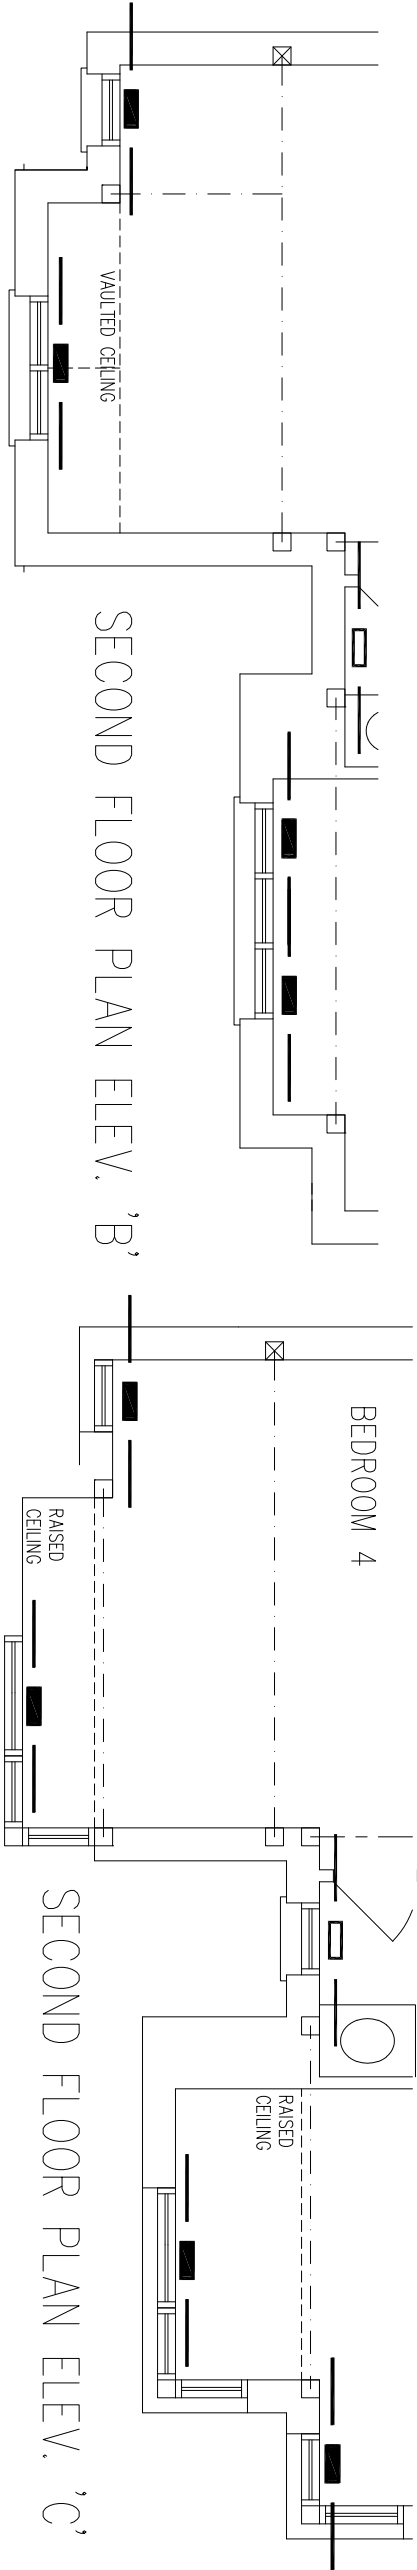

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client

GOLD PARK HOMES

Project Name

PINE VALLEY & TESTON VAUGHAN, ONTARIO

THE FORESTCREST - WOB 4203

3688 sqft



375 Finley Ave. Suite 202 - Ajax, Ontario
L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdsgns.ca
Web: www.hvacdsgns.ca
Specializing in Residential Mechanical Design Services

Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.

Sheet Title

SECOND FLOOR HEATING LAYOUT

Date

SEPT/2018

Scale

3/16" = 1'-0"

BCIN# 19669

LO# 79976