

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information

Building number, street name		Unit no.	Lot/con.
Municipality VAUGHAN (WOODBIDGE)	Postal code	Plan number/ other description	

B. Individual who reviews and takes responsibility for design activities

Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacadesigns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	

C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]

<input type="checkbox"/> House	<input checked="" type="checkbox"/> HVAC – House	<input type="checkbox"/> Building Structural
<input type="checkbox"/> Small Buildings	<input type="checkbox"/> Building Services	<input type="checkbox"/> Plumbing – House
<input type="checkbox"/> Large Buildings	<input type="checkbox"/> Detection, Lighting and Power	<input type="checkbox"/> Plumbing – All Buildings
<input type="checkbox"/> Complex Buildings	<input type="checkbox"/> Fire Protection	<input type="checkbox"/> On-site Sewage Systems

Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12	Model: 4206 Project: PINE VALLEY & TESTON
--	--

D. Declaration of Designer

I MICHAEL O'ROURKE (print name) declare that (choose one as appropriate):

I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories.
Individual BCIN: _____
Firm BCIN: _____


I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code.
Individual BCIN: 19669
Basis for exemption from registration and qualification: O.B.C SENTENCE 3.2.4.1 (4)

The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____

I certify that:

- The information contained in this schedule is true to the best of my knowledge.
- I have submitted this application with the knowledge and consent of the firm.

June 29, 2020
Date


Signature of Designer

NOTE:
1. For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
2. Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

SITE NAME: PINE VALLEY & TESTON
 BUILDER: GOLD PARK HOMES
 TYPE: 4206
 DATE: Jun-20
 WINTER NATURAL AIR CHANGE RATE 0.407
 SUMMER NATURAL AIR CHANGE RATE 0.137
 HEAT LOSS AT "F" 76
 HEAT GAIN AT "F" 13
 CSA-F280-12
 S8-12 PACKAGE A1

ROOM USE	EXP. WALL CLG. HT.	FACTORS	MBR	ENS	WIC	BED-2	BED-3	BED-4	ENS-2	WIC-3	ENS-3	ENS-4	F-WIC
GRS.WALL AREA		LOSS GAIN	342	243	90	279	369	135	90	54	0	144	110
GLAZING		LOSS GAIN	0	0	0	0	0	0	0	0	0	0	0
NORTH	21.3	16.0	0	0	0	0	0	0	0	0	0	0	0
EAST	21.3	41.6	0	0	0	0	0	0	0	0	0	0	0
SOUTH	21.3	24.9	0	0	0	0	0	0	0	0	0	0	0
WEST	21.3	41.6	9	192	224	0	0	0	0	0	0	0	0
SKYL.T.	37.2	57.1	4	426	831	0	0	0	0	0	0	0	0
DOORS	25.2	4.3	0	0	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL	4.5	0.8	233	1308	220	214	985	161	90	402	68	217	361
NET EXPOSED BSMT WALL ABOVE GR	3.6	0.6	0	0	0	0	0	0	0	0	0	0	0
EXPOSED CLG	1.3	0.6	357	458	210	180	231	106	190	244	112	286	367
NO ATTIC EXPOSED CLG	2.7	1.3	0	0	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.6	0.4	0	0	0	0	0	0	0	0	0	0	0
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS			2957	2694	645	3411	3434	1266	689	614	249	1085	693
SUBTOTAL HT LOSS			0.20	0.35	0.20	0.35	0.20	0.35	0.20	0.35	0.20	0.35	0.30
LEVEL FACTOR / MULTIPLIER			1028	627	224	1185	1193	440	239	213	87	377	426
AIR CHANGE HEAT LOSS			0	0	0	0	0	0	0	0	0	0	0
AIR CHANGE HEAT GAIN			221	108	108	266	286	69	22	53	5	51	47
DUCT LOSS			0	0	0	0	0	0	0	0	0	0	0
DUCT GAIN			480	0	0	418	0	0	0	83	34	0	0
HEAT GAIN PEOPLE	240		2	0	0	1	0	1	0	0	0	0	0
HEAT GAIN APPLIANCES/LIGHTS			436	0	0	240	436	436	0	0	0	0	0
TOTAL HT LOSS BTU/H			3985	2430	870	5955	4627	1706	928	911	369	1462	1117
TOTAL HT GAIN x 1.3 BTU/H			4980	2435	2435	5976	5786	2067	942	1003	725	1443	805

ROOM USE	EXP. WALL CLG. HT.	FACTORS	DIN	GRT	KT/BF	STUDY	LAUND	WIR	FOY	MUD	BAS
GRS.WALL AREA		LOSS GAIN	385	385	440	121	0	66	297	288	1330
GLAZING		LOSS GAIN	0	0	0	0	0	0	0	0	0
NORTH	21.3	16.0	0	0	0	0	0	0	0	0	0
EAST	21.3	41.6	0	0	0	0	0	0	0	0	0
SOUTH	21.3	24.9	26	553	647	0	0	0	0	0	0
WEST	21.3	41.6	0	0	0	0	0	0	0	0	0
SKYL.T.	37.2	57.1	0	0	0	0	0	0	0	0	0
DOORS	25.2	4.3	0	0	0	0	0	0	0	0	0
NET EXPOSED WALL	4.5	0.8	359	1602	270	385	1718	289	342	1526	257
NET EXPOSED BSMT WALL ABOVE GR	3.6	0.6	0	0	0	0	0	0	0	0	0
EXPOSED CLG	1.3	0.6	0	0	0	0	0	0	0	0	0
EXPOSED FLOOR	2.7	1.3	0	0	0	0	0	0	0	0	0
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	0	0	0
SLAB ON GRADE HEAT LOSS			2155	1718	3612	4329	126	429	2628	1701	6483
SUBTOTAL HT LOSS			0.30	0.61	0.30	0.61	0.20	0.30	0.61	0.30	0.50
LEVEL FACTOR / MULTIPLIER			1321	1053	2213	558	44	263	1610	1042	14141
AIR CHANGE HEAT LOSS			0	0	0	0	0	0	0	0	0
AIR CHANGE HEAT GAIN			75	0	0	35	5	20	124	24	68
DUCT LOSS			0	0	0	0	0	0	0	0	0
DUCT GAIN			436	0	0	0	0	0	0	0	0
HEAT GAIN PEOPLE	240		2	0	0	0	0	0	0	0	0
HEAT GAIN APPLIANCES/LIGHTS			3476	2771	5825	1468	436	436	436	436	436
TOTAL HT LOSS BTU/H			4855	2771	5825	1468	169	692	4238	2743	23500
TOTAL HT GAIN x 1.3 BTU/H			4855	2771	5825	1468	647	2067	2684	403	436

TOTAL HEAT GAIN BTU/H: 43136 TONS: 3.59
 LOSS DUE TO VENTILATION LOAD BTU/H: 1631
 STRUCTURAL HEAT LOSS: 68343
 TOTAL COMBINED HEAT LOSS BTU/H: 69975

Michael O'Rourke

SITE NAME: PINE VALLEY & TESTON
BUILDER: GOLD PARK HOMES

TYPE: 4206 DATE: Jun-20 GFA: 3536 LO# 86414

HEATING CFM 1340 COOLING CFM 1340
TOTAL HEAT LOSS 68,343 TOTAL HEAT GAIN 42,861
AIR FLOW RATE CFM 19.61 AIR FLOW RATE CFM 31.26

AFUE = 98 %
INPUT (BTU/H) = 88,000
OUTPUT (BTU/H) = 85,600
DESIGN CFM = 1340
CFM @ .6" E.S.P.
TEMPERATURE RISE 59 °F

LENNOX
EL196UH090XE48C 90
FAN SPEED LOW 0
MEDIUM 1080
HIGH 1575

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	14	9	5
R/A	0	0	5	2	1

All S/A diffusers 4"x10" unless noted otherwise on layout.
All R/A runs 5'Ø unless noted otherwise on layout.

ROOM NAME	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	
MBR	1.99	2.43	2.43	2.53	2.31	1.71	0.93	0.91	0.37	1.99	1.46	3.48	2.77	2.91	2.91	1.47	0.17	0.69	4.24	2.74	4.70	4.70	4.70	24	
RM LOSS MBH	39	48	17	50	45	33	18	18	7	39	29	68	54	57	57	29	3	14	83	54	92	92	92	BAS	
CFM PER RUN HEAT	2.49	2.43	0.25	2.99	2.89	2.07	0.94	1.00	0.73	2.49	1.44	1.86	0.97	3.33	3.33	1.17	0.65	0.34	2.68	0.40	0.35	0.35	0.35	BAS	
RM GAIN MBH	78	76	8	93	90	65	29	31	23	78	45	58	30	104	104	36	20	11	84	13	11	11	11	92	
CFM PER RUN COOLING	0.17	0.17	0.17	0.17	0.16	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.17	0.17	0.17	0.16	0.17	0.16	0.16	0.16	92	
ADJUSTED PRESSURE	0.17	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.16	
ACTUAL DUCT LGH.	45	57	23	60	67	46	18	51	41	47	49	29	28	53	40	10	59	47	43	14	44	21	24	31	
EQUIVALENT LENGTH	180	150	150	160	180	170	200	140	150	140	180	160	110	130	120	150	170	150	100	150	130	140	170	100	
TOTAL EFFECTIVE LENGTH	225	207	173	220	247	216	218	191	191	187	229	189	138	183	160	160	229	197	143	164	174	161	194	131	
ADJUSTED PRESSURE	0.08	0.08	0.1	0.07	0.07	0.08	0.08	0.09	0.09	0.09	0.08	0.09	0.12	0.09	0.1	0.11	0.08	0.09	0.11	0.1	0.09	0.1	0.08	0.12	
ROUND DUCT SIZE	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	6	
HEATING VELOCITY (ft/min)	199	245	195	255	229	242	207	207	80	286	213	499	396	291	291	333	34	161	423	396	469	469	469	469	
COOLING VELOCITY (ft/min)	398	388	92	474	459	477	333	356	264	573	330	426	220	530	530	413	229	126	428	95	56	56	56	56	
OUTLET GRILL SIZE	4X10	4X10	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	4X10	4X10	3X10	3X10	3X10	4X10	4X10	4X10	4X10	4X10

RUN #	25	26	27	28
F-WIC	BAS	BED-2	BED-3	BED-3
RM LOSS MBH	1.12	4.70	2.53	2.31
CFM PER RUN HEAT	22	92	50	45
RM GAIN MBH	0.81	0.35	2.99	2.89
CFM PER RUN COOLING	25	11	93	90
ADJUSTED PRESSURE	0.17	0.16	0.16	0.16
ACTUAL DUCT LGH.	53	43	57	62
EQUIVALENT LENGTH	130	140	150	170
TOTAL EFFECTIVE LENGTH	183	183	207	232
ADJUSTED PRESSURE	0.09	0.09	0.08	0.07
ROUND DUCT SIZE	6	6	6	6
HEATING VELOCITY (ft/min)	252	469	255	229
COOLING VELOCITY (ft/min)	287	56	474	459
OUTLET GRILL SIZE	3X10	4X10	4X10	4X10

SUPPLY AIR TRUNK SIZE						RETURN AIR TRUNK SIZE						RETURN AIR #					
TRUNK	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK CFM	TRUNK	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK CFM	TRUNK	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK CFM
TRUNK A	0.07	9.2	10	8	301	TRUNK G	0.00	0	0	8	0	TRUNK O	0.06	0	0	8	0
TRUNK B	0.07	11.9	16	8	590	TRUNK H	0.00	0	0	8	0	TRUNK P	0.06	0	0	8	0
TRUNK C	0.09	9.6	10	8	391	TRUNK I	0.00	0	0	8	0	TRUNK Q	0.06	0	0	8	0
TRUNK D	0.08	12.6	18	8	749	TRUNK J	0.00	0	0	8	0	TRUNK R	0.06	0	0	8	0
TRUNK E	0.00	0	0	8	0	TRUNK K	0.00	0	0	8	0	TRUNK S	0.06	0	0	8	0
TRUNK F	0.00	0	0	8	0	TRUNK L	0.00	0	0	8	0	TRUNK T	0.06	0	0	8	0
												TRUNK U	0.06	0	0	8	0
												TRUNK V	0.06	0	0	8	0
												TRUNK W	0.06	0	0	8	0
												TRUNK X	0.06	16.8	28	10	689
												TRUNK Y	0.06	13.6	22	8	626
												TRUNK Z	0.06	9.2	10	8	486
												DROP	0.06	16.8	24	12	670

TYPE: 4206 LO # 86414
 SITE NAME: PINE VALLEY & TESTON

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES 9.32.3.1(1)

a) Direct vent (sealed combustion) only
 b) Positive venting induced draft (except fireplaces)
 c) Natural draft, B-vent or induced draft gas fireplace
 d) Solid Fuel (including fireplaces)
 e) No Combustion Appliances

HEATING SYSTEM

Forced Air Non Forced Air

Electric Space Heat

HOUSE TYPE 9.32.1(2)

I Type a) or b) appliance only, no solid fuel
 II Type I except with solid fuel (including fireplaces)
 III Any Type c) appliance
 IV Type I, or II with electric space heat
 Other: Type I, II or IV no forced air

SYSTEM DESIGN OPTIONS O.N.H.W.P.

1 Exhaust only/Forced Air System
 2 HRV with Ducting/Forced Air System
 3 HRV Simplified/connected to forced air system
 4 HRV with Ducting/non forced air system
 Part 6 Design

TOTAL VENTILATION CAPACITY 9.32.3.3(1)

Basement + Master Bedroom	2	@ 21.2 cfm	42.4	cfm
Other Bedrooms	3	@ 10.6 cfm	31.8	cfm
Kitchen & Bathrooms	6	@ 10.6 cfm	63.6	cfm
Other Rooms	5	@ 10.6 cfm	53.0	cfm
Table 9.32.3.A.		TOTAL	190.8	cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED 9.32.3.4.(1)

1	Bedroom	31.8	cfm
2	Bedroom	47.7	cfm
3	Bedroom	63.6	cfm
4	Bedroom	79.5	cfm
5	Bedroom	95.4	cfm
	TOTAL	79.5	cfm

SUPPLEMENTAL VENTILATION CAPACITY 9.32.3.5.

Total Ventilation Capacity	190.8	cfm
Less Principal Ventil. Capacity	79.5	cfm
Required Supplemental Capacity	111.3	cfm

PRINCIPAL EXHAUST FAN CAPACITY

Model: VANE 65H Location: BSMT

79.5 cfm 3.0 sones HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION

CFM	ΔT °F	FACTOR	% LOSS
79.5 CFM	X 76 F	X 1.08	X 0.25

SUPPLEMENTAL FANS PANASONIC

Location	Model	cfm	HVI	Sones
ENS	FV-05-11VK1	50	✓	0.3
ENS-2	FV-05-11VK1	50	✓	0.3
ENS-4	FV-05-11VK1	50	✓	0.3
W/R	FV-05-11VK1	50	✓	0.3

HEAT RECOVERY VENTILATOR 9.32.3.11.

Model: VANE 65H

155 cfm high 64 cfm low

75 % Sensible Efficiency @ 32 deg F (0 deg C) HVI Approved

LOCATION OF INSTALLATION

Lot: Concession

Township: Plan:

Address:

Roll # Building Permit #

BUILDER: GOLD PARK HOMES

Name:

Address:

City:

Telephone #: Fax #:

INSTALLING CONTRACTOR

Name:

Address:

City:

Telephone #: Fax #:

DESIGNER CERTIFICATION

I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.

Name: HVAC Designs Ltd.

Signature: *Michael O'Rourke*

HRAI # 001820

Date: June-20

CSA F280-12 Residential Heat Loss and Heat Gain Calculations Formula Sheet (For Air Leakage / Ventilation Calculation)																											
LO#: 86414	Model: 4206																										
Builder: GOLD PARK HOMES																											
Date: 29/06/2020																											
Air Change & Delta T Data																											
	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width: 50%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 50%; text-align: center;">0.407</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td style="text-align: center;">0.137</td> </tr> </table>	WINTER NATURAL AIR CHANGE RATE	0.407	SUMMER NATURAL AIR CHANGE RATE	0.137																						
WINTER NATURAL AIR CHANGE RATE	0.407																										
SUMMER NATURAL AIR CHANGE RATE	0.137																										
<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="4" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <td style="width: 25%;">Tin °C</td> <td style="width: 25%;">Tout °C</td> <td style="width: 25%;">ΔT °C</td> <td style="width: 25%;">ΔT °F</td> </tr> <tr> <td>Winter DTDh</td> <td style="text-align: center;">22</td> <td style="text-align: center;">-20</td> <td style="text-align: center;">42</td> </tr> <tr> <td>Summer DTDc</td> <td style="text-align: center;">24</td> <td style="text-align: center;">31</td> <td style="text-align: center;">7</td> </tr> </table>		Design Temperature Difference				Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-20	42	Summer DTDc	24	31	7										
Design Temperature Difference																											
Tin °C	Tout °C	ΔT °C	ΔT °F																								
Winter DTDh	22	-20	42																								
Summer DTDc	24	31	7																								
6.2.6 Sensible Gain due to Air Leakage																											
$HG_{scalb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$																											
= 0.137 x 402.10 x 7 °C x 1.2 =	= 468 W																										
6.2.7 Sensible heat gain due to Ventilation																											
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$																											
= 80 CFM x 13 °F x 1.08 x 0.25 =	= 275 Btu/h																										
5.2.3.1 Heat Loss due to Air Leakage																											
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$																											
= 0.407 x 402.10 x 42 °C x 1.2 =	= 8289 W																										
5.2.3.2 Heat Loss due to Mechanical Ventilation																											
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$																											
= 80 CFM x 76 °F x 1.08 x 0.25 =	= 1631 Btu/h																										
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																											
$HL_{airr} = Level\ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$																											
	<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{clevel})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)</th> </tr> </thead> <tbody> <tr> <td>1</td> <td style="text-align: center;">0.5</td> <td rowspan="5" style="text-align: center; vertical-align: middle;">28,283</td> <td style="text-align: center;">9,358</td> <td style="text-align: center;">1.511</td> </tr> <tr> <td>2</td> <td style="text-align: center;">0.3</td> <td style="text-align: center;">13,846</td> <td style="text-align: center;">0.613</td> </tr> <tr> <td>3</td> <td style="text-align: center;">0.2</td> <td style="text-align: center;">16,280</td> <td style="text-align: center;">0.347</td> </tr> <tr> <td>4</td> <td style="text-align: center;">0</td> <td style="text-align: center;">0</td> <td style="text-align: center;">0.000</td> </tr> <tr> <td>5</td> <td style="text-align: center;">0</td> <td style="text-align: center;">0</td> <td style="text-align: center;">0.000</td> </tr> </tbody> </table>	Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)	1	0.5	28,283	9,358	1.511	2	0.3	13,846	0.613	3	0.2	16,280	0.347	4	0	0	0.000	5	0	0	0.000
Level	Level Factor (LF)	HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																							
1	0.5	28,283	9,358	1.511																							
2	0.3		13,846	0.613																							
3	0.2		16,280	0.347																							
4	0		0	0.000																							
5	0		0	0.000																							
*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0																											

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 4206

SFQT: 3536

LO# 86414

BUILDER: GOLD PARK HOMES

SITE: PINE VALLEY & TESTON

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-4	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft ³):	51120.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft ²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 61.0 ft	WIDTH: 34.0 ft	EXPOSED PERIMETER:	190.0 ft

2012 OBC - COMPLIANCE PACKAGE

Component	Compliance Package A1	
	Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22	17.03
Basement Walls Minimum RSI (R)-Value	20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	0.28	-
Skylights Maximum U-Value	0.49	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.8	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE

Michael O'Rourke

Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

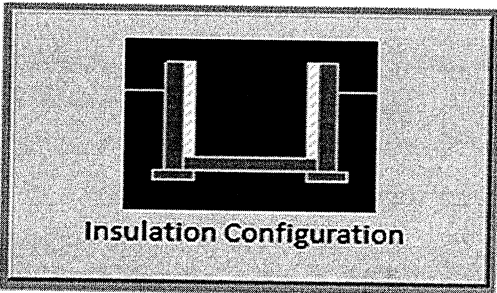Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	18.6	 <p>Insulation Configuration</p>
Floor Width (m):	10.4	
Exposed Perimeter (m):	0.0	
Wall Height (m):	3.0	
Depth Below Grade (m):	2.13	
Window Area (m ²):	1.4	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):	1899	


TYPE: 4206
 LO# 86414

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Vaughan (Woodbridge)			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	9.14			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	1447.6			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1929.6 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	37.5	37.5		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.407			
Cooling Air Leakage Rate (ACH/H):	0.137			

TYPE: 4206
 LO# 86414

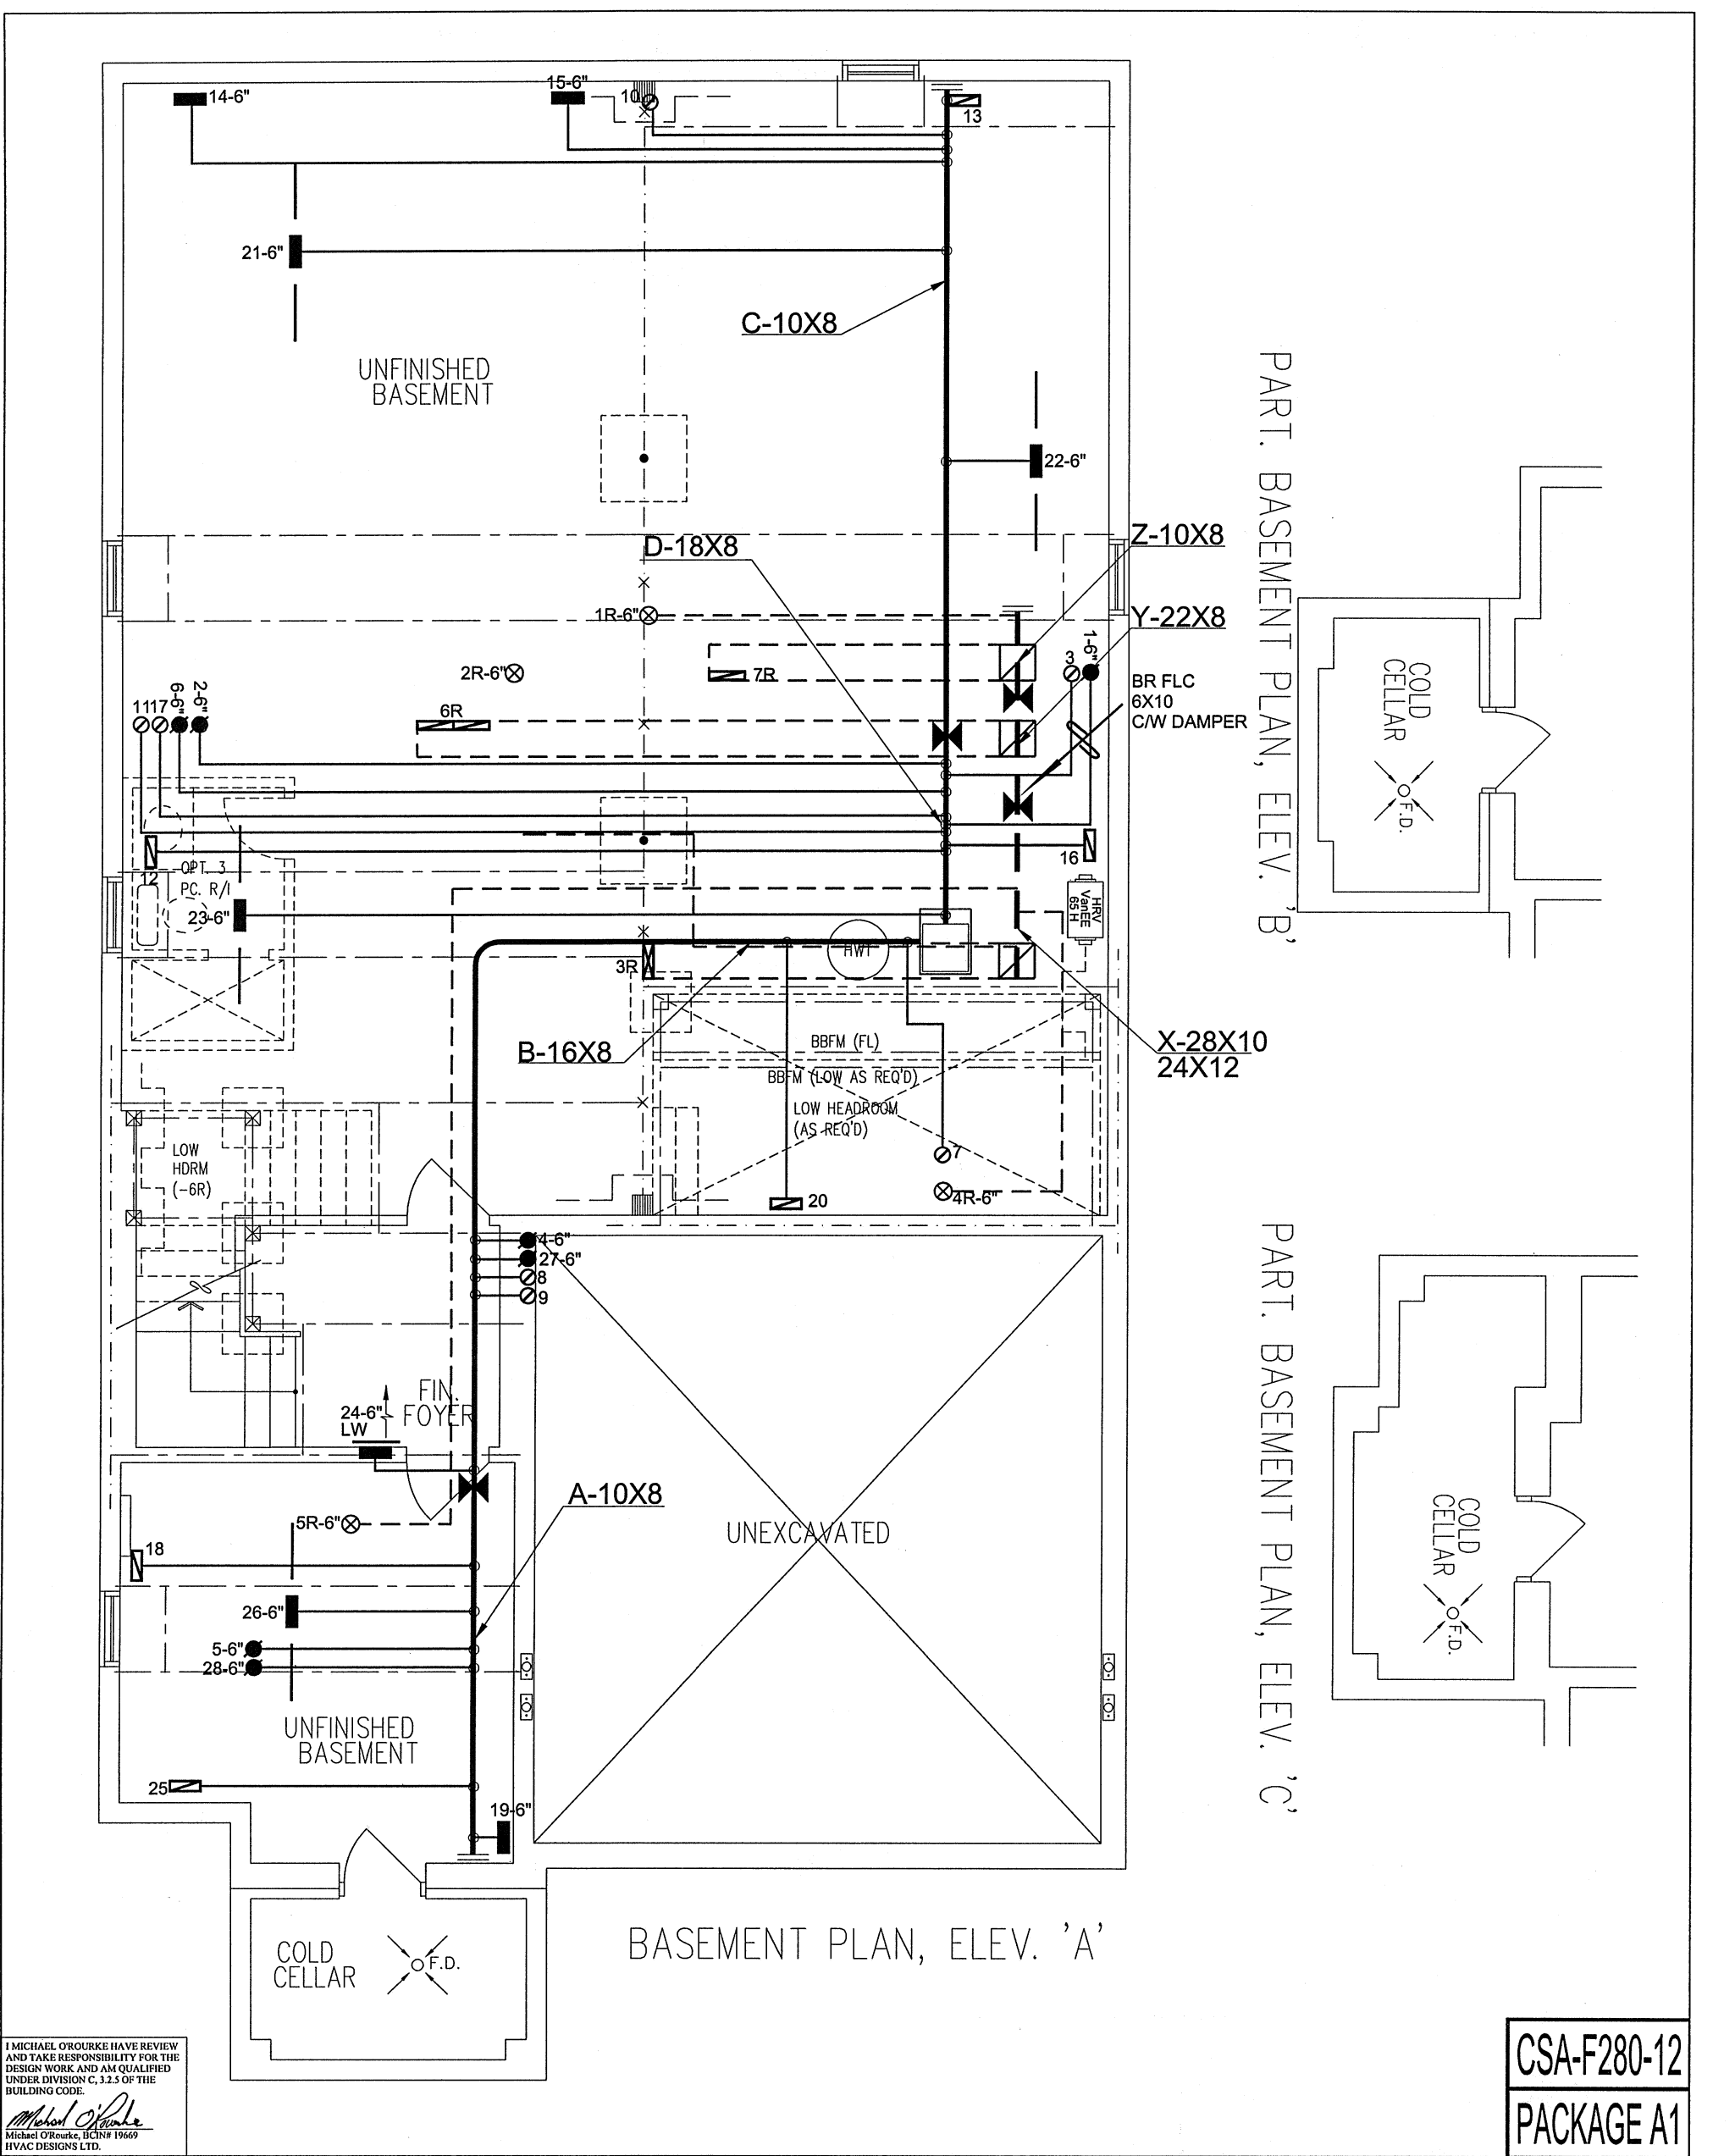

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C.3.2.3 OF THE BUILDING CODE.


Michael O'Rourke
 Michael O'Rourke, BCIN# 19669
 HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1


HVAC LEGEND							3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL			DESCRIPTION
[Symbol]	SUPPLY AIR GRILLE	[Symbol]	6" SUPPLY AIR BOOT ABOVE	[Symbol]	14"x8" RETURN AIR GRILLE	[Symbol]	RETURN AIR STACK ABOVE	2.	
[Symbol]	SUPPLY AIR GRILLE 6" BOOT	[Symbol]	SUPPLY AIR STACK FROM 2nd FLOOR	[Symbol]	30"x8" RETURN AIR GRILLE	[Symbol]	RETURN AIR STACK 2nd FLOOR	1.	
[Symbol]	SUPPLY AIR BOOT ABOVE	[Symbol]	6" SUPPLY AIR STACK 2nd FLOOR	[Symbol]	FRA- FLOOR RETURN AIR GRILLE	[Symbol]	REDUCER	No.	Description Date

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD. AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.


Client GOLD PARK HOMES	Project Name PINE VALLEY & TESTON VAUGHAN, ONTARIO	 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdsgns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services	HEAT LOSS 69975 BTU/H	# OF RUNS S/A R/A FANS	Sheet Title BASEMENT HEATING LAYOUT
			MAKE LENNOX	3RD FLOOR	
4206	3536 sqft	Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	MODEL EL196UH090XE48C	2ND FLOOR 14 5 5	Date JUNE/2020
			INPUT 88 MBTU/H	1ST FLOOR 9 2 2	Scale 3/16" = 1'-0"
			OUTPUT 85.6 MBTU/H	BASEMENT 5 1 0	BCIN# 19669
			COOLING 3.5 TONS		LO# 86414
			FAN SPEED 1340 cfm @ 0.6" w.c.	ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A	

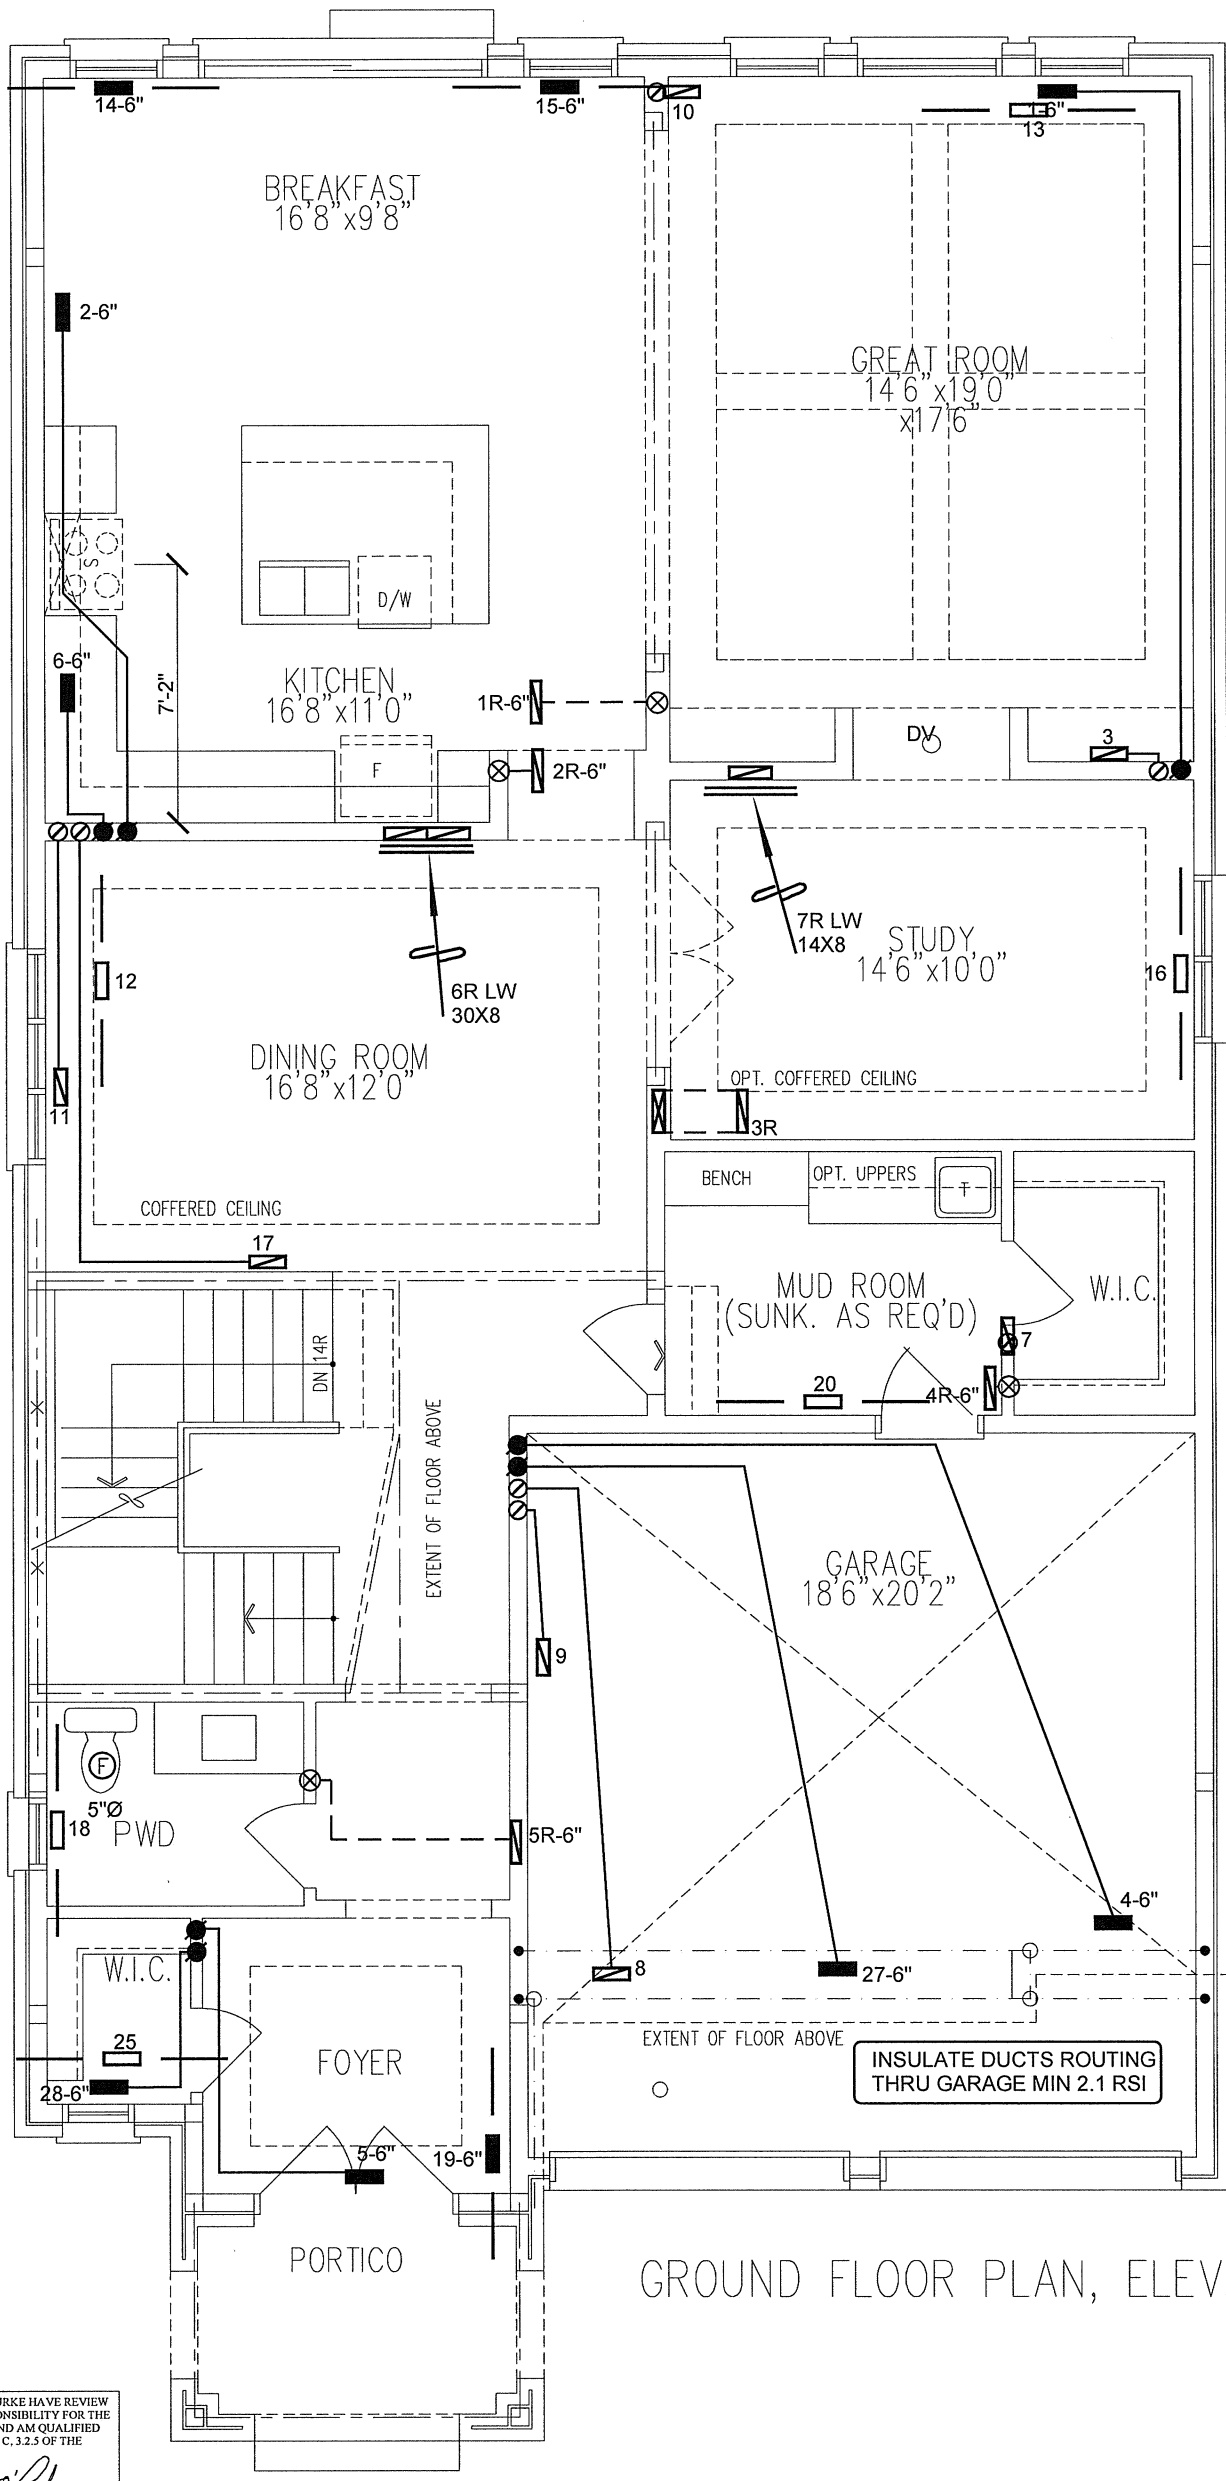

PART. GROUND FLOOR PLAN ELEV. 'C'

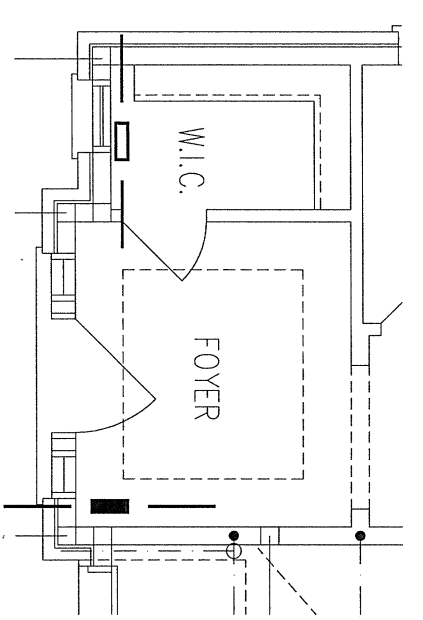

PART. GROUND FLOOR PLAN ELEV. 'B'

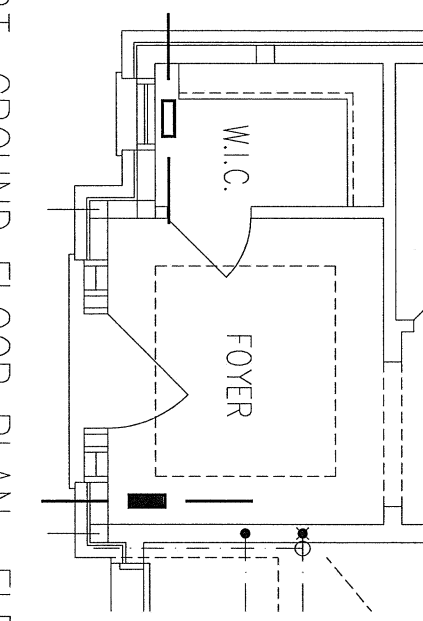

GROUND FLOOR PLAN, ELEV. 'A'

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.
 Michael O'Rourke
 Michael O'Rourke, BCIN# 19669
 HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1



HVAC LEGEND						REVISIONS	
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	No.	Description
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE	3.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE	2.	
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		RETURN AIR STACK ABOVE	1.	
					RETURN AIR STACK 2nd FLOOR	No.	Description
					FRA- FLOOR RETURN AIR GRILLE		Date
					REDUCER		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD. AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client
GOLD PARK HOMES
 Project Name
PINE VALLEY & TESTON VAUGHAN, ONTARIO
 4206 3536 sqft

HVAC DESIGNS LTD.
 375 Finley Ave. Suite 202 - Ajax, Ontario
 L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
 Email: info@hvacdsgns.ca
 Web: www.hvacdsgns.ca
 Specializing in Residential Mechanical Design Services
 Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.

Sheet Title
FIRST FLOOR HEATING LAYOUT
 Date JUNE/2020
 Scale 3/16" = 1'-0"
 BCIN# 19669
LO# 86414

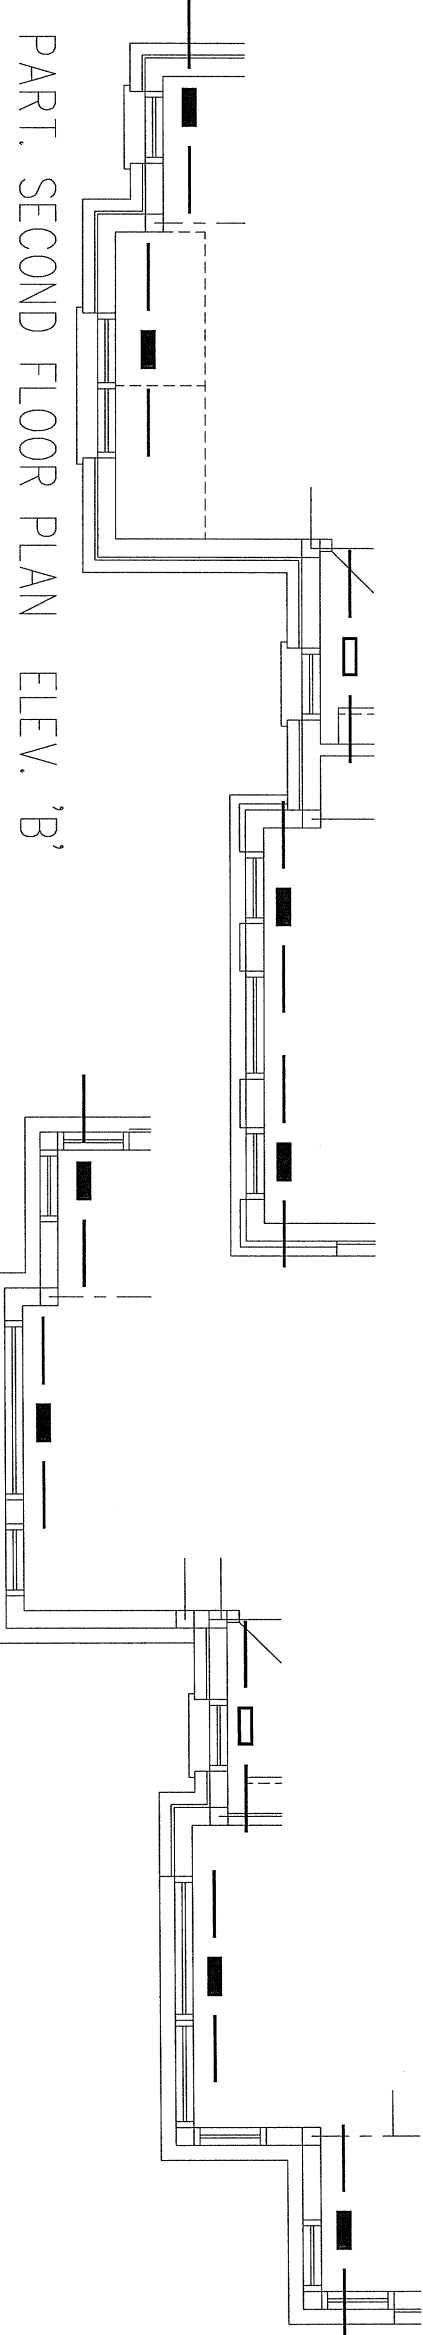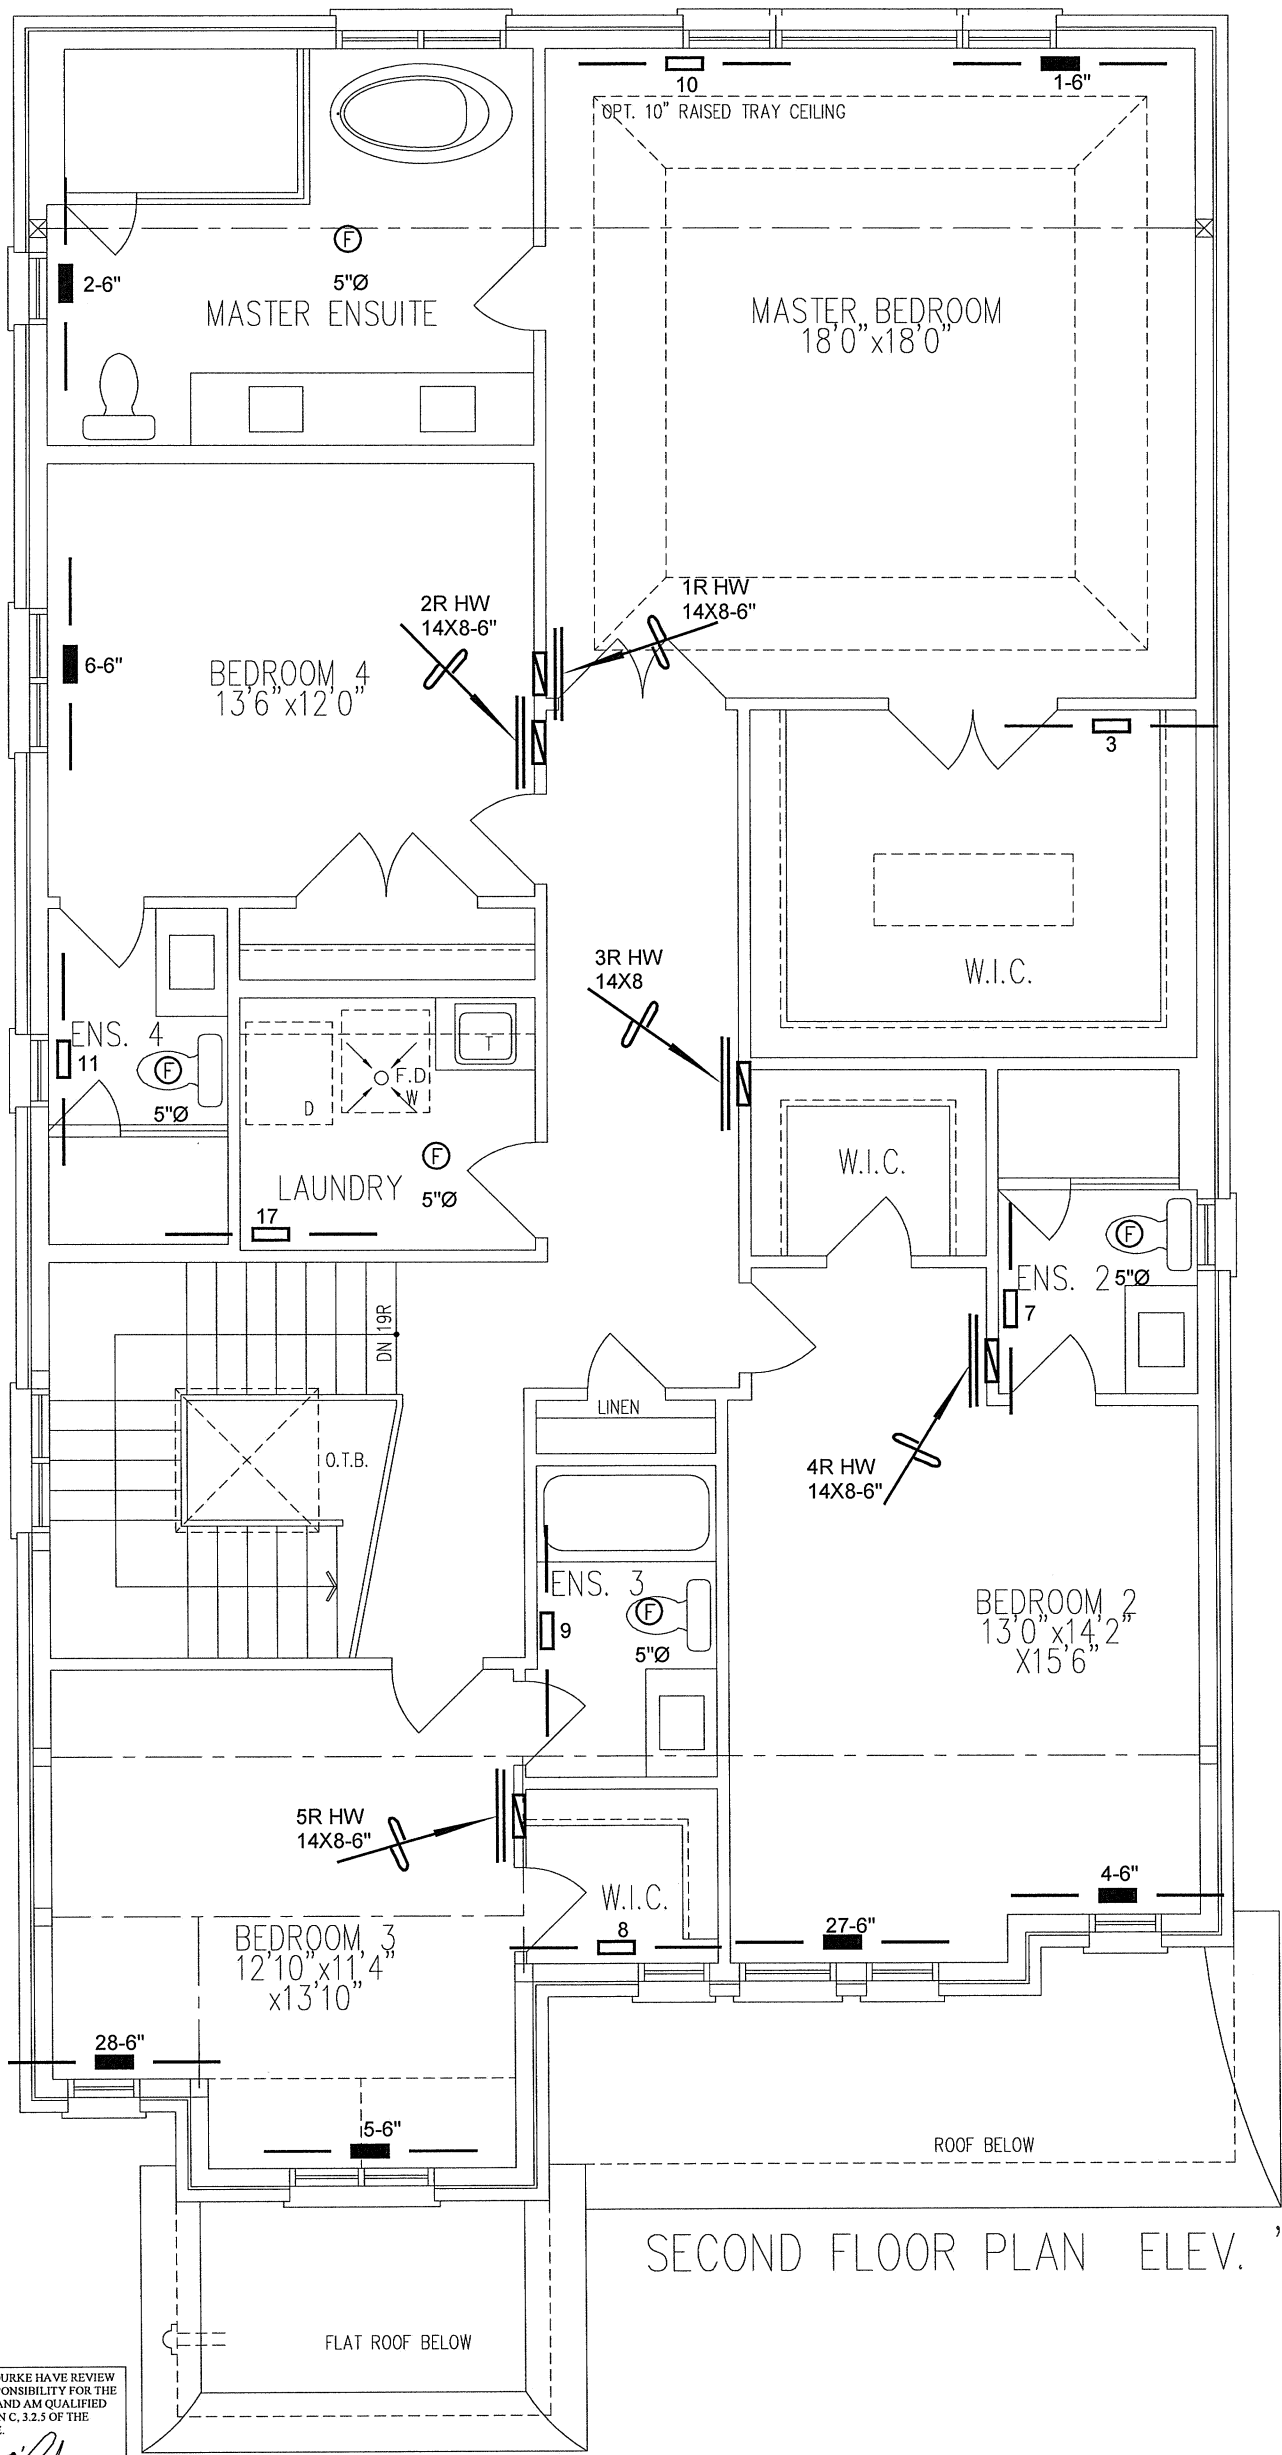

SECOND FLOOR PLAN ELEV. 'A'

I MICHAEL O'ROURKE HAVE REVIEW AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.
 Michael O'Rourke, T.C.N. 19669
 HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1

HVAC LEGEND						REVISIONS	
— □ —	SUPPLY AIR GRILLE	■	6" SUPPLY AIR BOOT ABOVE	— ▨ —	14"x8" RETURN AIR GRILLE	▨	RETURN AIR STACK ABOVE
— ■ —	SUPPLY AIR GRILLE 6" BOOT	○	SUPPLY AIR STACK FROM 2nd FLOOR	— ▨ —	30"x8" RETURN AIR GRILLE	▨	RETURN AIR STACK 2nd FLOOR
— ▨ —	SUPPLY AIR BOOT ABOVE	●	6" SUPPLY AIR STACK 2nd FLOOR	— ▨ —	FRA- FLOOR RETURN AIR GRILLE	▨	REDUCER
						No.	Description
							Date

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client
GOLD PARK HOMES
 Project Name
PINE VALLEY & TESTON VAUGHAN, ONTARIO
 4206 3536 sqft

HVAC DESIGNS LTD.
 375 Finley Ave. Suite 202 - Ajax, Ontario
 L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
 Email: info@hvacdsgns.ca
 Web: www.hvacdsgns.ca
 Specializing in Residential Mechanical Design Services
 Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.

Sheet Title
SECOND FLOOR HEATING LAYOUT
 Date JUNE/2020
 Scale 3/16" = 1'-0"
 BCIN# 19669
LO# 86414