

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality VAUGHAN (WOODBIDGE)	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdesigns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 6001 - QUEENSLAND - ELEV C OPT 2ND - ELEVATOR Project: PINE VALLEY PH 2	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u> declare that (choose one as appropriate): (print name)			
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
April 14, 2022			
Date		Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d) of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: PINE VALLEY PH 2					OPT 2ND - ELEVATOR					DATE Apr-22					WINTER NATURAL AIR CHANGE RATE 0.434					HEAT LOSS AT °F. 76		CSA-F280-12						
BUILDER: GOLD PARK HOMES					TYPE: 6001 - QUEENSLAND - ELEV C					GFA: 5742					LO# 96172					SUMMER NATURAL AIR CHANGE RATE 0.145					HEAT GAIN AT °F. 13		SB-12 PACKAGE A1	
ROOM USE				GREAT		KIT		DIN		LIBR		FOY		MUD														
EXP. WALL				58		56		25		33		43		29														
CLG. HT.				11		11		11		11		11		13														
FACTORS																												
GRS.WALL AREA		LOSS GAIN		638		616		275		363		473		377														
GLAZING				LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN		LOSS GAIN														
NORTH		21.3	16.0	26	553	415	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
EAST		21.3	41.6	0	0	0	0	0	0	0	65	1383	2701	15	319	623	0	0	0	0	0	0	0					
SOUTH		21.3	24.9	0	0	0	0	0	0	41	872	1021	18	383	448	0	0	0	0	0	0	0	0					
WEST		21.3	41.6	78	1660	3241	119	2532	4945	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
SKYLT.		37.2	101.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
DOORS		25.2	4.3	0	0	0	15	379	64	0	0	0	0	40	1010	170	20	505	85									
NET EXPOSED WALL		4.5	0.8	534	2383	401	482	2151	362	234	1044	176	280	1250	210	418	1865	314	357	1593	268							
NET EXPOSED BSMT WALL ABOVE GR		3.6	0.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
EXPOSED CLG		1.3	0.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
NO ATTIC EXPOSED CLG		2.7	1.3	10	27	13	0	0	0	0	0	0	10	27	13	0	0	0	0	0	0	0	0					
EXPOSED FLOOR		2.6	0.4	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0					
BASEMENT/CRAWL HEAT LOSS				0		0		0		0		0		0		0		0		0		0						
SLAB ON GRADE HEAT LOSS				0		0		0		0		0		0		0		0		0		0						
SUBTOTAL HT LOSS				4624		5062		1917		3043		3195		2098														
SUB TOTAL HT GAIN				4070		5371		1197		3372		1108		353														
LEVEL FACTOR / MULTIPLIER		0.30	0.73			0.30	0.73			0.30	0.73			0.30	0.73			0.30	0.73									
AIR CHANGE HEAT LOSS				3395		3717		1407		2234		2345		1540														
AIR CHANGE HEAT GAIN				370		488		109		306		101		32														
DUCT LOSS				0		0		0		0		0		0														
DUCT GAIN				0		0		0		0		0		0														
HEAT GAIN PEOPLE		240		0		0		0		0		0		0		0		0										
HEAT GAIN APPLIANCES/LIGHTS				1376		1376		1376		1376		1376		0		0		0										
TOTAL HT LOSS BTU/H				8018		8779		3324		5278		5540		3639														
TOTAL HT GAIN x 1.3 BTU/H				7560		9404		3485		6570		1571		501														

ROOM USE																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																															
----------	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--	--

TOTAL HEAT GAIN BTU/H:

72520

TONS: 6.04

LOSS DUE TO VENTILATION LOAD BTU/H: 6156

STRUCTURAL HEAT LOSS: 106032

TOTAL COMBINED HEAT LOSS BTU/H: 112188

SITE NAME: PINE VALLEY PH 2										OPT 2ND - ELEVATOR										DATE Apr-22		WINTER NATURAL AIR CHANGE RATE 0.434										HEAT LOSS ΔT °F. 76		CSA-F280-1			
BUILDER: GOLD PARK HOMES										TYPE: 6001 - QUEENSLAND - ELEV C										GFA: 5742		LO# 96172		SUMMER NATURAL AIR CHANGE RATE 0.145										HEAT GAIN ΔT °F. 13		SB-12 PACKAGE A	
ROOM USE			MBR		ENS			BED-2			BED-3			BED-4			BED-5			ENS-2			ENS-3			ENS-4			ENS-5								
EXP. WALL			20		32			18			20			45			16			6			18			6			0								
CLG. HT.			10		9			9			10			10			9			9			9			9			9								
FACTORS																																					
GRS.WALL AREA			LOSS GAIN		200			288			162			200			450			144			54			162			54			0					
GLAZING					LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN			LOSS GAIN					
NORTH			21.3	16.0	0	0	0	0	0	0	38	809	607	18	383	288	0	0	0	0	0	0	8	170	128	0	0	0	0	0	0	0	0	0			
EAST			21.3	41.6	0	0	0	0	0	0	0	0	0	65	1383	2701	65	1383	2701	0	0	0	0	0	0	10	213	416	0	0	0	0	0	0			
SOUTH			21.3	24.9	0	0	0	22	468	548	0	0	0	0	0	0	18	383	448	19	404	473	0	0	0	0	0	0	8	170	199	0	0	0			
WEST			21.3	41.6	42	894	1745	8	170	332	0	0	0	0	0	0	0	383	448	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
SKYLT.			37.2	101.5	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
DOORS			25.2	4.3	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0				
NET EXPOSED WALL			4.5	0.8	158	705	119	258	1151	194	124	553	93	117	522	88	367	1638	276	125	558	94	46	205	35	152	678	114	46	205	35	0	0	0			
NET EXPOSED BSMT WALL ABOVE GR			3.6	0.6	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
EXPOSED CLG			1.3	0.6	380	488	223	240	308	141	438	562	257	323	415	190	348	447	204	232	298	136	66	85	39	72	92	42	84	108	49	72	92	42			
NO ATTIC EXPOSED CLG			2.7	1.3	0	0	0	0	0	0	0	0	0	55	151	69	55	151	69	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
EXPOSED FLOOR			2.6	0.4	0	0	0	0	0	0	200	510	86	228	581	98	0	0	0	0	0	0	66	168	28	72	184	31	0	0	0	0	0	0			
BASEMENT/CRAWL HEAT LOSS					0		0		0		0		0		0		0		0		0		0		0		0		0		0		0				
SLAB ON GRADE HEAT LOSS					0		0		0		0		0		0		0		0		0		0		0		0		0		0		0				
SUBTOTAL HT LOSS			2087		2098			2434			3436			4002			1260			629			1167			483			92								
SUB TOTAL HT GAIN			2087		1215			1044			3433			3699			703			229			603			283			42								
LEVEL FACTOR / MULTIPLIER			0.20	0.41			0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41	0.20	0.41			
AIR CHANGE HEAT LOSS			848		853			989			1396			1626			512			255			474			196			38								
AIR CHANGE HEAT GAIN			189		110			95			312			336			64			21			55			26			4								
DUCT LOSS			0		0			342			483			0			0			88			164			0			0								
DUCT GAIN			0		0			275			536			0			0			25			66			0			0								
HEAT GAIN PEOPLE			240	2	480	0	1	240	1	240	1	240	1	240	1	240	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0			
HEAT GAIN APPLIANCES/LIGHTS			1376		0			1376			1376			1376			1376			1376			0			0			0								
TOTAL HT LOSS BTU/H			2935		2950			3766			5315			5628			1772			972			1806			680			130								
TOTAL HT GAIN x 1.3 BTU/H			5372		1723			3938			7666			7345			3098			358			941			401			60								

ROOM USE			LAUN			HALL			DRESS									
EXP. WALL			0			18			38									
CLG. HT.			9			10			9									
FACTORS																		
GRS.WALL AREA	LOSS	GAIN				180			342									
GLAZING			LOSS	GAIN		LOSS	GAIN		LOSS	GAIN								
NORTH	21.3	16.0	0	0	0	0	0	0	27	575	431							
EAST	21.3	41.6	0	0	0	44	936	1828	0	0	0							
SOUTH	21.3	24.9	0	0	0	0	0	0	0	0	0							
WEST	21.3	41.6	0	0	0	0	0	0	12	255	499							
SKYLT.	37.2	101.5	0	0	0	24	894	2437	0	0	0							
DOORS	25.2	4.3	0	0	0	30	757	128	0	0	0							
NET EXPOSED WALL	4.5	0.8	0	0	0	106	473	80	303	1352	228							
NET EXPOSED BSMT WALL ABOVE GR	3.6	0.6	0	0	0	0	0	0	0	0	0							
EXPOSED CLG	1.3	0.6	84	108	49	212	272	125	440	565	259							
NO ATTIC EXPOSED CLG	2.7	1.3	0	0	0	50	137	63	0	0	0							
EXPOSED FLOOR	2.6	0.4	0	0	0	0	0	0	0	0	0							
BASEMENT/CRAWL HEAT LOSS																		
SLAB ON GRADE HEAT LOSS																		
SUBTOTAL HT LOSS				108			3470			2747								
SUB TOTAL HT GAIN					49			4660			1416							
LEVEL FACTOR / MULTIPLIER			0.20	0.41		0.20	0.41		0.20	0.41								
AIR CHANGE HEAT LOSS				44			1410			1116								
AIR CHANGE HEAT GAIN					4			423			129							
DUCT LOSS				0			0			0								
DUCT GAIN					0			0			0							
HEAT GAIN PEOPLE	240		0		0	0		0	0		0							
HEAT GAIN APPLIANCES/LIGHTS					1376			0			0							
TOTAL HT LOSS BTU/H				152			4880			3863								
TOTAL HT GAIN x 1.3 BTU/H				1858			6608			2008								

TOTAL HEAT GAIN BTU/H: 72520

TONS: 6.04

LOSS DUE TO VENTILATION LOAD BTU/H: 6156

STRUCTURAL HEAT LOSS: 106032

TOTAL COMBINED HEAT LOSS BTU/H: 112188

SITE NAME: PINE VALLEY PH 2
BUILDER: GOLD PARK HOMES

OPT 2ND - ELEVATOR
TYPE: 6001 - QUEENSLAND - ELEV C DATE: Apr-22

GFA: 5742 LO# 96172

FURNACE 1

HEATING CFM 1170 COOLING CFM 1170
TOTAL HEAT LOSS 71,182 TOTAL HEAT GAIN 30,626
AIR FLOW RATE CFM 16.44 AIR FLOW RATE CFM 38.2

furnace pressure 0.6
furnace filter 0.05
a/c coil pressure 0.2
available pressure for s/a & r/a 0.35

**FURNACE HEAT LOSS +
HRV / ERV HEAT LOSS
= 74260 BTUH**
\$LENNOX
ML196UH090XE36C
FAN SPEED 90
LOW 0
MEDLOW 0
MEDIUM 0
MEDIUM HIGH 1170
HIGH 1300

AFUE = 96 %
INPUT (BTU/H) = 88,000
OUTPUT (BTU/H) = **85,600**

DESIGN CFM = **1170**
CFM @ .6" E.S.P.

TEMPERATURE RISE 68 °F

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	0	14	8
R/A	0	0	0	3	1

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	5	6	7	8	9	10	11	12	13	14	15	18	21	22	23	24
ROOM NAME	GREAT	GREAT	GREAT	KIT	KIT	KIT	KIT	DIN	DIN	LIBR	LIBR	LIBR	FOY	MUD	BAS	BAS	BAS	BAS
RM LOSS MBH.	2.67	2.67	2.67	2.19	2.19	2.19	2.19	1.66	1.66	1.76	1.76	1.76	5.54	3.64	4.58	4.58	4.58	4.58
CFM PER RUN HEAT	44	44	44	36	36	36	36	27	27	29	29	29	91	60	75	75	75	75
RM GAIN MBH.	2.52	2.52	2.52	2.35	2.35	2.35	2.35	1.74	1.74	2.19	2.19	2.19	1.57	0.50	0.19	0.19	0.19	0.19
CFM PER RUN COOLING	96	96	96	90	90	90	90	67	67	84	84	84	60	19	7	7	7	7
ADJUSTED PRESSURE	0.16	0.16	0.16	0.16	0.16	0.16	0.16	0.17	0.17	0.16	0.16	0.16	0.16	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	74	89	72	67	59	45	46	46	10	22	27	31	40	48	67	56	65	71
EQUIVALENT LENGTH	140	130	170	160	170	170	110	120	150	150	110	120	140	150	110	120	140	140
TOTAL EFFECTIVE LENGTH	214	219	242	227	229	215	156	166	160	172	137	151	180	198	177	176	205	211
ADJUSTED PRESSURE	0.08	0.07	0.07	0.07	0.07	0.08	0.1	0.1	0.11	0.09	0.12	0.11	0.09	0.09	0.1	0.1	0.08	0.08
ROUND DUCT SIZE	6	6	6	6	6	6	6	5	5	5	5	5	6	5	5	5	6	6
HEATING VELOCITY (ft/min)	224	224	224	184	184	184	184	198	198	213	213	213	464	441	551	551	382	382
COOLING VELOCITY (ft/min)	489	489	489	459	459	459	459	492	492	617	617	617	306	140	51	51	36	36
OUTLET GRILL SIZE	4X10	4X10	4X10	4X10	4X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	4X10	3X10	3X10	3X10	4X10	4X10
TRUNK	A	A	A	A	A	B	C	C	C	D	D	D	D	C	B	B	A	A

RUN #	25	26	27	28
ROOM NAME	BAS	BAS	BAS	BAS
RM LOSS MBH.	4.58	4.58	4.58	4.58
CFM PER RUN HEAT	75	75	75	75
RM GAIN MBH.	0.19	0.19	0.19	0.19
CFM PER RUN COOLING	7	7	7	7
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH.	39	44	23	41
EQUIVALENT LENGTH	140	160	100	130
TOTAL EFFECTIVE LENGTH	179	204	123	171
ADJUSTED PRESSURE	0.1	0.08	0.14	0.1
ROUND DUCT SIZE	5	6	5	5
HEATING VELOCITY (ft/min)	551	382	551	551
COOLING VELOCITY (ft/min)	51	36	51	51
OUTLET GRILL SIZE	3X10	4X10	3X10	3X10
TRUNK	C	D	D	D

SUPPLY AIR TRUNK SIZE														RETURN AIR TRUNK SIZE													
	TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT			VELOCITY (ft/min)		TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT			VELOCITY (ft/min)		TRUNK CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT			VELOCITY (ft/min)				
TRUNK A	354	0.07	9.8	12	x	8	531	TRUNK G	0	0.00	0	0	x	8	0	TRUNK O	0	0.06	0	0	x	8	0				
TRUNK B	186	0.08	7.5	8	x	8	419	TRUNK H	0	0.00	0	0	x	8	0	TRUNK P	0	0.06	0	0	x	8	0				
TRUNK C	765	0.07	13.1	16	x	12	574	TRUNK I	0	0.00	0	0	x	8	0	TRUNK Q	0	0.06	0	0	x	8	0				
TRUNK D	403	0.08	10	12	x	8	605	TRUNK J	0	0.00	0	0	x	8	0	TRUNK R	0	0.06	0	0	x	8	0				
TRUNK E	0	0.00	0	0	x	8	0	TRUNK K	0	0.00	0	0	x	8	0	TRUNK S	0	0.06	0	0	x	8	0				
TRUNK F	0	0.00	0	0	x	8	0	TRUNK L	0	0.00	0	0	x	8	0	TRUNK T	0	0.06	0	0	x	8	0				

RETURN AIR #	1	2	3													BR
AIR VOLUME	275	305	330	0	0	0	0	0	0	0	0	0	0	0	0	260
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	76	47	41	1	1	1	1	1	1	1	1	1	1	1	1	19
EQUIVALENT LENGTH	180	165	140	0	0	0	0	0	0	0	0	0	0	0	0	145
TOTAL EFFECTIVE LH	256	212	181	1	1	1	1	1	1	1	1	1	1	1	1	164
ADJUSTED PRESSURE	0.06	0.07	0.08	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	0.09	
ROUND DUCT SIZE	9.3	9.3	9.3	0	0	0	0	0	0	0	0	0	0	0	0	8.2
INLET GRILL SIZE	8	8	8	0	0	0	0	0	0	0	0	0	0	0	0	8
	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
INLET GRILL SIZE	30	30	30	0	0	0	0	0	0	0	0	0	0	0	0	24

SITE NAME: PINE VALLEY PH 2
BUILDER: GOLD PARK HOMES

OPT 2ND - ELEVATOR
TYPE: 6001 - QUEENSLAND - ELEV C DATE: Apr-22

GFA: 5742 LO# 96172

FURNACE 2

HEATING CFM 1270 COOLING CFM 1270
TOTAL HEAT LOSS 34,849 TOTAL HEAT GAIN 41,376
AIR FLOW RATE CFM 36.44 AIR FLOW RATE CFM 30.69

furnace pressure 0.6
furnace filter 0.05
a/c coil pressure 0.2
available pressure for s/a & r/a 0.35

**FURNACE HEAT LOSS +
HRV / ERV HEAT LOSS
= 37927 BTUH**
**\$*LENNOX
ML196UH070XE48B
FAN SPEED 70**

AFUE = 96 %
INPUT (BTU/H) = 66,000
OUTPUT (BTU/H) = **63,900**

RUN COUNT	4th	3rd	2nd	1st	Bas
S/A	0	0	24	0	0
R/A	0	0	6	0	0

plenium pressure s/a 0.18 r/a pressure 0.17
max s/a dif press. loss 0.02 r/a grille press. Loss 0.02
min adjusted pressure s/a 0.16 adjusted pressure r/a 0.15

LOW 0
MEDLOW 1070
MEDIUM 1270
MEDIUM HIGH 1515
HIGH 1595

DESIGN CFM = **1270**
CFM @ .6" E.S.P.

TEMPERATURE RISE 47 °F

All S/A diffusers 4"x10" unless noted otherwise on layout.

All S/A runs 5"Ø unless noted otherwise on layout.

RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24
ROOM NAME	MBR	MBR	MBR	ENS	ENS	BED-2	BED-2	ENS-2	BED-3	BED-3	BED-3	ENS-3	BED-4	BED-4	BED-4	ENS-5	ENS-4	BED-5	BED-5	LAUN	HALL	HALL	DRESS	DRESS
RM LOSS MBH.	0.98	0.98	0.98	2.21	0.74	1.88	1.88	0.97	1.77	1.77	1.77	1.81	1.88	1.88	1.88	0.13	0.68	0.89	0.89	0.15	2.44	2.44	1.93	1.93
CFM PER RUN HEAT	36	36	36	81	27	69	69	35	65	65	65	66	68	68	68	5	25	32	32	6	89	89	70	70
RM GAIN MBH.	1.79	1.79	1.79	1.29	0.43	1.97	1.97	0.36	2.56	2.56	2.56	0.94	2.45	2.45	2.45	0.06	0.40	1.55	1.55	1.86	3.30	3.30	1.00	1.00
CFM PER RUN COOLING	55	55	55	40	13	60	60	11	78	78	78	29	75	75	75	2	12	48	48	57	101	101	31	31
ADJUSTED PRESSURE	0.17	0.17	0.17	0.16	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.16	0.16	0.17	0.17
ACTUAL DUCT LGH.	67	72	83	75	69	85	95	102	79	85	91	86	37	30	42	32	24	28	67	82	34	48	91	90
EQUIVALENT LENGTH	150	160	220	180	180	160	170	180	170	180	170	160	170	150	140	200	210	180	180	190	110	140	160	170
TOTAL EFFECTIVE LENGTH	217	232	303	255	249	245	265	282	249	265	261	246	207	180	182	232	234	208	247	272	144	188	251	260
ADJUSTED PRESSURE	0.08	0.07	0.06	0.06	0.07	0.07	0.06	0.06	0.07	0.06	0.07	0.07	0.08	0.1	0.09	0.07	0.07	0.08	0.07	0.06	0.11	0.09	0.07	0.07
ROUND DUCT SIZE	6	6	6	6	4	6	6	5	6	6	6	6	5	5	5	4	4	5	5	6	6	6	6	6
HEATING VELOCITY (ft/min)	184	184	184	413	310	352	352	257	331	331	331	337	499	499	499	57	287	235	235	31	454	454	357	357
COOLING VELOCITY (ft/min)	280	280	280	204	149	306	306	81	398	398	398	148	551	551	551	23	138	352	352	291	515	515	158	158
OUTLET GRILL SIZE	4X10	4X10	4X10	4X10	3X10	4X10	4X10	3X10	4X10	4X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	4X10	4X10	4X10	4X10	4X10
TRUNK	B	B	A	B	B	A	A	A	C	C	C	C	D	D	D	C	C	C	B	A	D	D	A	A

RUN #	ROOM NAME	RM LOSS MBH.	CFM PER RUN HEAT	RM GAIN MBH.	CFM PER RUN COOLING	ADJUSTED PRESSURE	ACTUAL DUCT LGH.	EQUIVALENT LENGTH	TOTAL EFFECTIVE LENGTH	ADJUSTED PRESSURE	ROUND DUCT SIZE	HEATING VELOCITY (ft/min)	COOLING VELOCITY (ft/min)	OUTLET GRILL SIZE	TRUNK
1	MBR	0.98	36	1.79	55	0.17	67	150	217	0.08	6	184	280	4X10	B
2	MBR	0.98	36	1.79	55	0.17	72	160	232	0.07	6	184	280	4X10	B
3	MBR	0.98	36	1.79	55	0.17	83	220	303	0.06	6	184	280	4X10	A
4	ENS	2.21	81	1.29	40	0.16	75	180	255	0.06	6	413	204	4X10	B
5	ENS	0.74	27	0.43	13	0.17	69	180	249	0.07	4	310	149	3X10	B
6	BED-2	1.88	69	1.97	60	0.17	85	160	245	0.07	6	352	306	4X10	A
7	BED-2	1.88	69	1.97	60	0.17	95	170	265	0.06	6	352	306	4X10	A
8	ENS-2	0.97	35	0.36	11	0.17	102	180	282	0.06	5	257	81	3X10	A
9	BED-3	1.77	65	2.56	78	0.17	79	170	249	0.07	6	331	398	4X10	C
10	BED-3	1.77	65	2.56	78	0.17	85	180	265	0.06	6	331	398	4X10	C
11	BED-3	1.77	65	2.56	78	0.17	91	170	261	0.07	6	337	398	4X10	C
12	ENS-3	1.81	66	0.94	29	0.17	86	160	246	0.07	5	499	148	3X10	D
13	BED-4	1.88	68	2.45	75	0.17	37	170	207	0.08	5	499	551	3X10	D
14	BED-4	1.88	68	2.45	75	0.17	30	150	180	0.1	5	499	551	3X10	D
15	BED-4	1.88	68	2.45	75	0.17	42	140	182	0.09	4	57	23	3X10	D
16	ENS-5	0.13	5	0.06	2	0.17	32	200	232	0.07	4	287	138	3X10	C
17	ENS-4	0.68	25	0.40	12	0.17	24	210	234	0.07	4	235	352	3X10	C
18	BED-5	0.89	32	1.55	48	0.17	28	180	208	0.08	5	235	352	3X10	C
19	BED-5	0.89	32	1.55	48	0.17	67	190	247	0.07	5	31	291	4X10	B
20	LAUN	0.15	6	1.86	57	0.17	82	190	272	0.06	6	454	515	4X10	A
21	HALL	2.44	89	3.30	101	0.16	34	110	144	0.11	6	454	515	4X10	D
22	HALL	2.44	89	3.30	101	0.16	48	140	188	0.09	6	357	158	4X10	D
23	DRESS	1.93	70	1.00	31	0.17	91	160	251	0.07	6	357	158	4X10	A
24	DRESS	1.93	70	1.00	31	0.17	90	170	260	0.07	6	357	158	4X10	A

SUPPLY AIR TRUNK SIZE													RETURN AIR TRUNK SIZE												
TRUNK	CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT		VELOCITY (ft/min)	TRUNK	CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK	CFM	STATIC PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)							
TRUNK A	355	0.06	10.2	10	x	10	511	TRUNK G	0	0.00	0	0	x	8	0	TRUNK O	0	0.05	0	0	x	8	0		
TRUNK B	567	0.06	12.2	14	x	10	583	TRUNK H	0	0.00	0	0	x	8	0	TRUNK P	0	0.05	0	0	x	8	0		
TRUNK C	890	0.06	14.4	18	x	12	593	TRUNK I	0	0.00	0	0	x	8	0	TRUNK Q	0	0.05	0	0	x	8	0		
TRUNK D	382	0.08	9.8	12	x	8	573	TRUNK J	0	0.00	0	0	x	8	0	TRUNK R	0	0.05	0	0	x	8	0		
TRUNK E	0	0.00	0	0	x	8	0	TRUNK K	0	0.00	0	0	x	8	0	TRUNK S	0	0.05	0	0	x	8	0		
TRUNK F	0	0.00	0	0	x	8	0	TRUNK L	0	0.00	0	0	x	8	0	TRUNK T	0	0.05	0	0	x	8	0		

RETURN AIR #	1	2	3	4	5	6	BR
AIR VOLUME	230	115	260	185	115	365	0
PLENUM PRESSURE	0.15	0.15	0.15	0.15	0.15	0.15	0.15
ACTUAL DUCT LGH.	75	71	71	60	83	65	1
EQUIVALENT LENGTH	230	215	195	185	225	190	0
TOTAL EFFECTIVE LH	305	286	266	245	308	255	1
ADJUSTED PRESSURE	0.05	0.05	0.06	0.06	0.05	0.06	14.80
ROUND DUCT SIZE	9.1	7	9.1	8	7	10.3	0
INLET GRILL SIZE	8	8	8	8	8	8	0
INLET GRILL SIZE	X	X	X	X	X	X	X
INLET GRILL SIZE	30	14	30	24	14	30	0

TYPE: 6001 - QUEENSLAND - ELEV C
SITE NAME: PINE VALLEY PH 2

LO # 96172
OPT 2ND - ELEVATOR

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐ Other:	Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm	<u>42.4</u> cfm
Other Bedrooms	<u>4</u> @ 10.6 cfm	<u>42.4</u> cfm
Kitchen & Bathrooms	<u>6</u> @ 10.6 cfm	<u>63.6</u> cfm
Other Rooms	<u>5</u> @ 10.6 cfm	<u>53.0</u> cfm
Table 9.32.3.A.	TOTAL	<u>201.4</u> cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4.(1)
1 Bedroom	31.8	cfm
2 Bedroom	47.7	cfm
3 Bedroom	63.6	cfm
4 Bedroom	79.5	cfm
5 Bedroom	95.4	cfm
TOTAL		<u>95.4</u> cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>201.4</u>	cfm
Less Principal Ventil. Capacity	<u>150</u>	cfm
Required Supplemental Capacity	<u>51.4</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model:	VANEE V150H
Location:	BSMT
<u>150.0</u> cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
150.0 CFM	X 76 F	X 1.08	X	0.25

SUPPLEMENTAL FANS		BY INSTALLING CONTRACTOR		
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-2	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-3	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-4	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model:	VANEE V150H	INSTALL 2 HRV / ERV's
<u>150</u>	cfm high	<u>35</u> cfm low
<u>75</u>	% Sensible Efficiency @ 32 deg F (0 deg C)	☒ HVI Approved

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
GOLD PARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	April-22

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																																																	
Formula Sheet (For Air Leakage / Ventilation Calculation)																																																																	
LO#: 96172		Model: 6001 - QUEENSLAND - ELEV C			Builder: GOLD PARK HOMES			Date: 4/14/2022																																																									
Volume Calculation					Air Change & Delta T Data																																																												
House Volume <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Floor Area (ft²)</th> <th>Floor Height (ft)</th> <th>Volume (ft³)</th> </tr> </thead> <tbody> <tr><td>Bsmt</td><td>2581</td><td>10</td><td>25810</td></tr> <tr><td>First</td><td>2581</td><td>11</td><td>28391</td></tr> <tr><td>Second</td><td>3175</td><td>9</td><td>28575</td></tr> <tr><td>Third</td><td>0</td><td>9</td><td>0</td></tr> <tr><td>Fourth</td><td>0</td><td>9</td><td>0</td></tr> <tr><td colspan="3" style="text-align: right;">Total:</td><td>82,776.0 ft³</td></tr> <tr><td colspan="3" style="text-align: right;">Total:</td><td>2344.0 m³</td></tr> </tbody> </table>					Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	2581	10	25810	First	2581	11	28391	Second	3175	9	28575	Third	0	9	0	Fourth	0	9	0	Total:			82,776.0 ft³	Total:			2344.0 m³	<table border="1" style="width:100%; border-collapse: collapse;"> <tr> <td style="width: 80%;">WINTER NATURAL AIR CHANGE RATE</td> <td style="width: 20%;">0.434</td> </tr> <tr> <td>SUMMER NATURAL AIR CHANGE RATE</td> <td>0.145</td> </tr> </table> <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th colspan="5" style="text-align: center;">Design Temperature Difference</th> </tr> <tr> <th></th> <th>Tin °C</th> <th>Tout °C</th> <th>ΔT °C</th> <th>ΔT °F</th> </tr> <tr> <td>Winter DTDh</td> <td>22</td> <td>-20</td> <td>42</td> <td>76</td> </tr> <tr> <td>Summer DTDc</td> <td>24</td> <td>31</td> <td>7</td> <td>13</td> </tr> </table>					WINTER NATURAL AIR CHANGE RATE	0.434	SUMMER NATURAL AIR CHANGE RATE	0.145	Design Temperature Difference						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	22	-20	42	76	Summer DTDc	24	31	7	13
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																																														
Bsmt	2581	10	25810																																																														
First	2581	11	28391																																																														
Second	3175	9	28575																																																														
Third	0	9	0																																																														
Fourth	0	9	0																																																														
Total:			82,776.0 ft³																																																														
Total:			2344.0 m³																																																														
WINTER NATURAL AIR CHANGE RATE	0.434																																																																
SUMMER NATURAL AIR CHANGE RATE	0.145																																																																
Design Temperature Difference																																																																	
	Tin °C	Tout °C	ΔT °C	ΔT °F																																																													
Winter DTDh	22	-20	42	76																																																													
Summer DTDc	24	31	7	13																																																													
5.2.3.1 Heat Loss due to Air Leakage					6.2.6 Sensible Gain due to Air Leakage																																																												
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ 0.434 x 651.10 x 42 °C x 1.2 = 14301 W = 48795 Btu/h					$HG_{salb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ = 0.145 x 651.10 x 7 °C x 1.2 = 806 W = 2751 Btu/h																																																												
5.2.3.2 Heat Loss due to Mechanical Ventilation					6.2.7 Sensible heat Gain due to Ventilation																																																												
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E) \times 2 \text{ HRV / ERV's}$ 300 CFM x 76 °F x 1.08 x 0.25 = 6156 Btu/h					$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ 300 CFM x 13 °F x 1.08 x 0.25 = 1,037 Btu/h																																																												
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																																																	
$HL_{airr} = Level \ Factor \times HL_{airbv} \times \{ (HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel}) \}$																																																																	
<table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th>Level</th> <th>Level Factor (LF)</th> <th>HLairve Air Leakage + Ventilation Heat Loss (Btu/h)</th> <th>Level Conductive Heat Loss: (HL_{clevel})</th> <th>Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)</th> </tr> </thead> <tbody> <tr><td>1</td><td>0.5</td><td rowspan="5" style="text-align: center; vertical-align: middle;">48,795</td><td>12,207</td><td>1.999</td></tr> <tr><td>2</td><td>0.3</td><td>19,939</td><td>0.734</td></tr> <tr><td>3</td><td>0.2</td><td>24,012</td><td>0.406</td></tr> <tr><td>4</td><td>0</td><td>0</td><td>0.000</td></tr> <tr><td>5</td><td>0</td><td>0</td><td>0.000</td></tr> </tbody> </table>										Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)	1	0.5	48,795	12,207	1.999	2	0.3	19,939	0.734	3	0.2	24,012	0.406	4	0	0	0.000	5	0	0	0.000																														
Level	Level Factor (LF)	HLairve Air Leakage + Ventilation Heat Loss (Btu/h)	Level Conductive Heat Loss: (HL _{clevel})	Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																																													
1	0.5	48,795	12,207	1.999																																																													
2	0.3		19,939	0.734																																																													
3	0.2		24,012	0.406																																																													
4	0		0	0.000																																																													
5	0		0	0.000																																																													
*HLairbv = Air leakage heat loss + ventilation heat loss *For a balanced or supply only ventilation system HLairve = 0																																																																	
					Michael O'Rourke BCIN# 19669 																																																												

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 6001 - QUEENSLAND - ELEV C	OPT 2ND - ELEVATOR	BUILDER: GOLD PARK HOMES
SFQT: 5742	LO# 96172	SITE: PINE VALLEY PH 2

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-4	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75
		WINDOW SHGC	0.50

BUILDING DATA

ATTACHMENT:	DETACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft³):	82776.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	6
INTERIOR LIGHTING LOAD (Btu/h/ft²):	1.65	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.0 ft
LENGTH: 66.0 ft	WIDTH: 55.0 ft	EXPOSED PERIMETER:	242.0 ft

2012 OBC - COMPLIANCE PACKAGE**Component****Compliance Package
A1****Nominal Min. Eff.**

Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22	17.03
Basement Walls Minimum RSI (R)-Value	20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	0.28	-
Skylights Maximum U-Value	0.49	-
Space Heating Equipment Minimum AFUE	0.96	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.8	-


INDIVIDUAL BCIN: 19669

MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

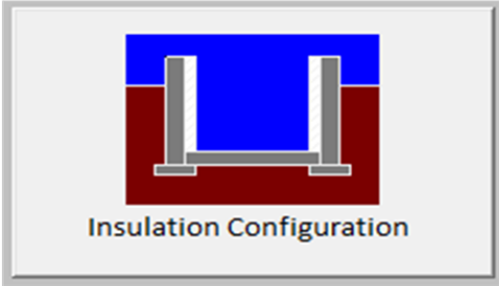Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	20.1	 Insulation Configuration
Floor Width (m):	16.8	
Exposed Perimeter (m):	0.0	
Wall Height (m):	3.0	
Depth Below Grade (m):	2.13	
Window Area (m ²):	1.2	
Door Area (m ²):	3.7	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		2466

TYPE: 6001 - QUEENSLAND - ELEV C
LO# 96172

OPT 2ND - ELEVATOR

Air Infiltration Residential Load Calculator

Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Vaughan (Woodbridge)			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	10.06			
Building Configuration				
Type:	Detached			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	2344.0			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	3124.6 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	70.8	70.8		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.434			
Cooling Air Leakage Rate (ACH/H):	0.145			

TYPE: 6001 - QUEENSLAND - ELEV C OPT 2ND - ELEVATOR
LO# 96172

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.® AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.



INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL SUPPLY BRANCH OUTLETS SHALL BE EQUIPPED WITH MANUAL BALANCING DAMPER. DUCTWORK WHICH PASSES THROUGH THE GARAGE OR UNHEATED SPACES SHALL BE ADEQUATELY INSULATED AND GAS-PROOFED

ALL S/A DIFFUSERS "4x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A

FURNACE 1 (F-1)
LENNOX ML196UH090XE36C
85600 BTU/H OUTPUT
2.5 TONS A/C @ 1170 cfm

FURNACE 2 (F-2)
LENNOX ML196UH070XE48B
63900 BTU/H OUTPUT
3.5 TONS A/C @ 1270 cfm

	S/A	R/A	FANS
2ND	22	6	7
1ST	14	3	2
BAS	8	1	0

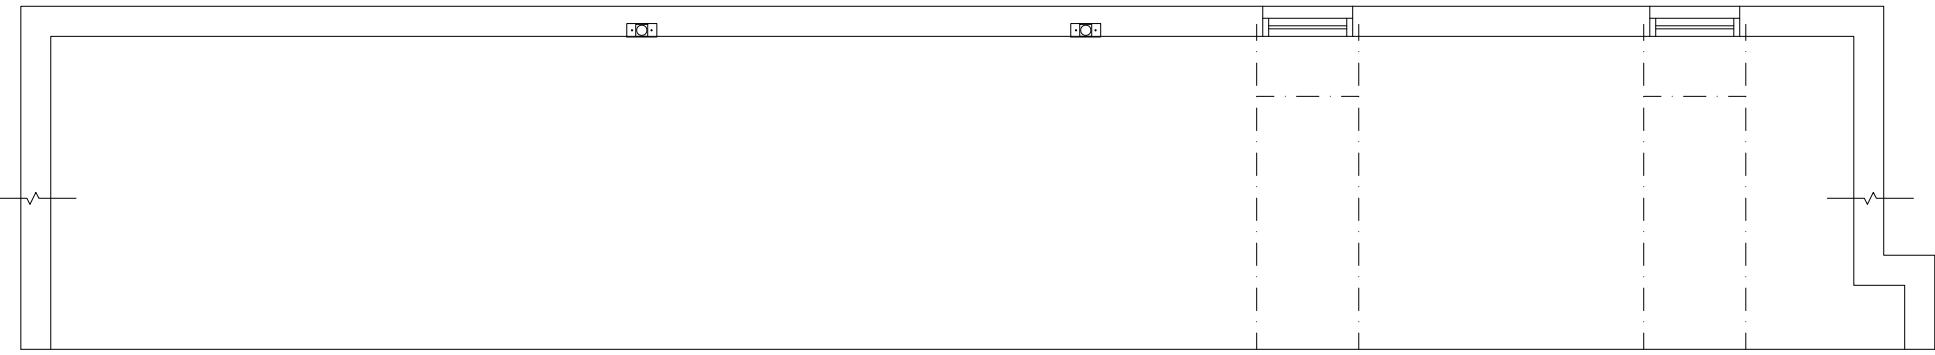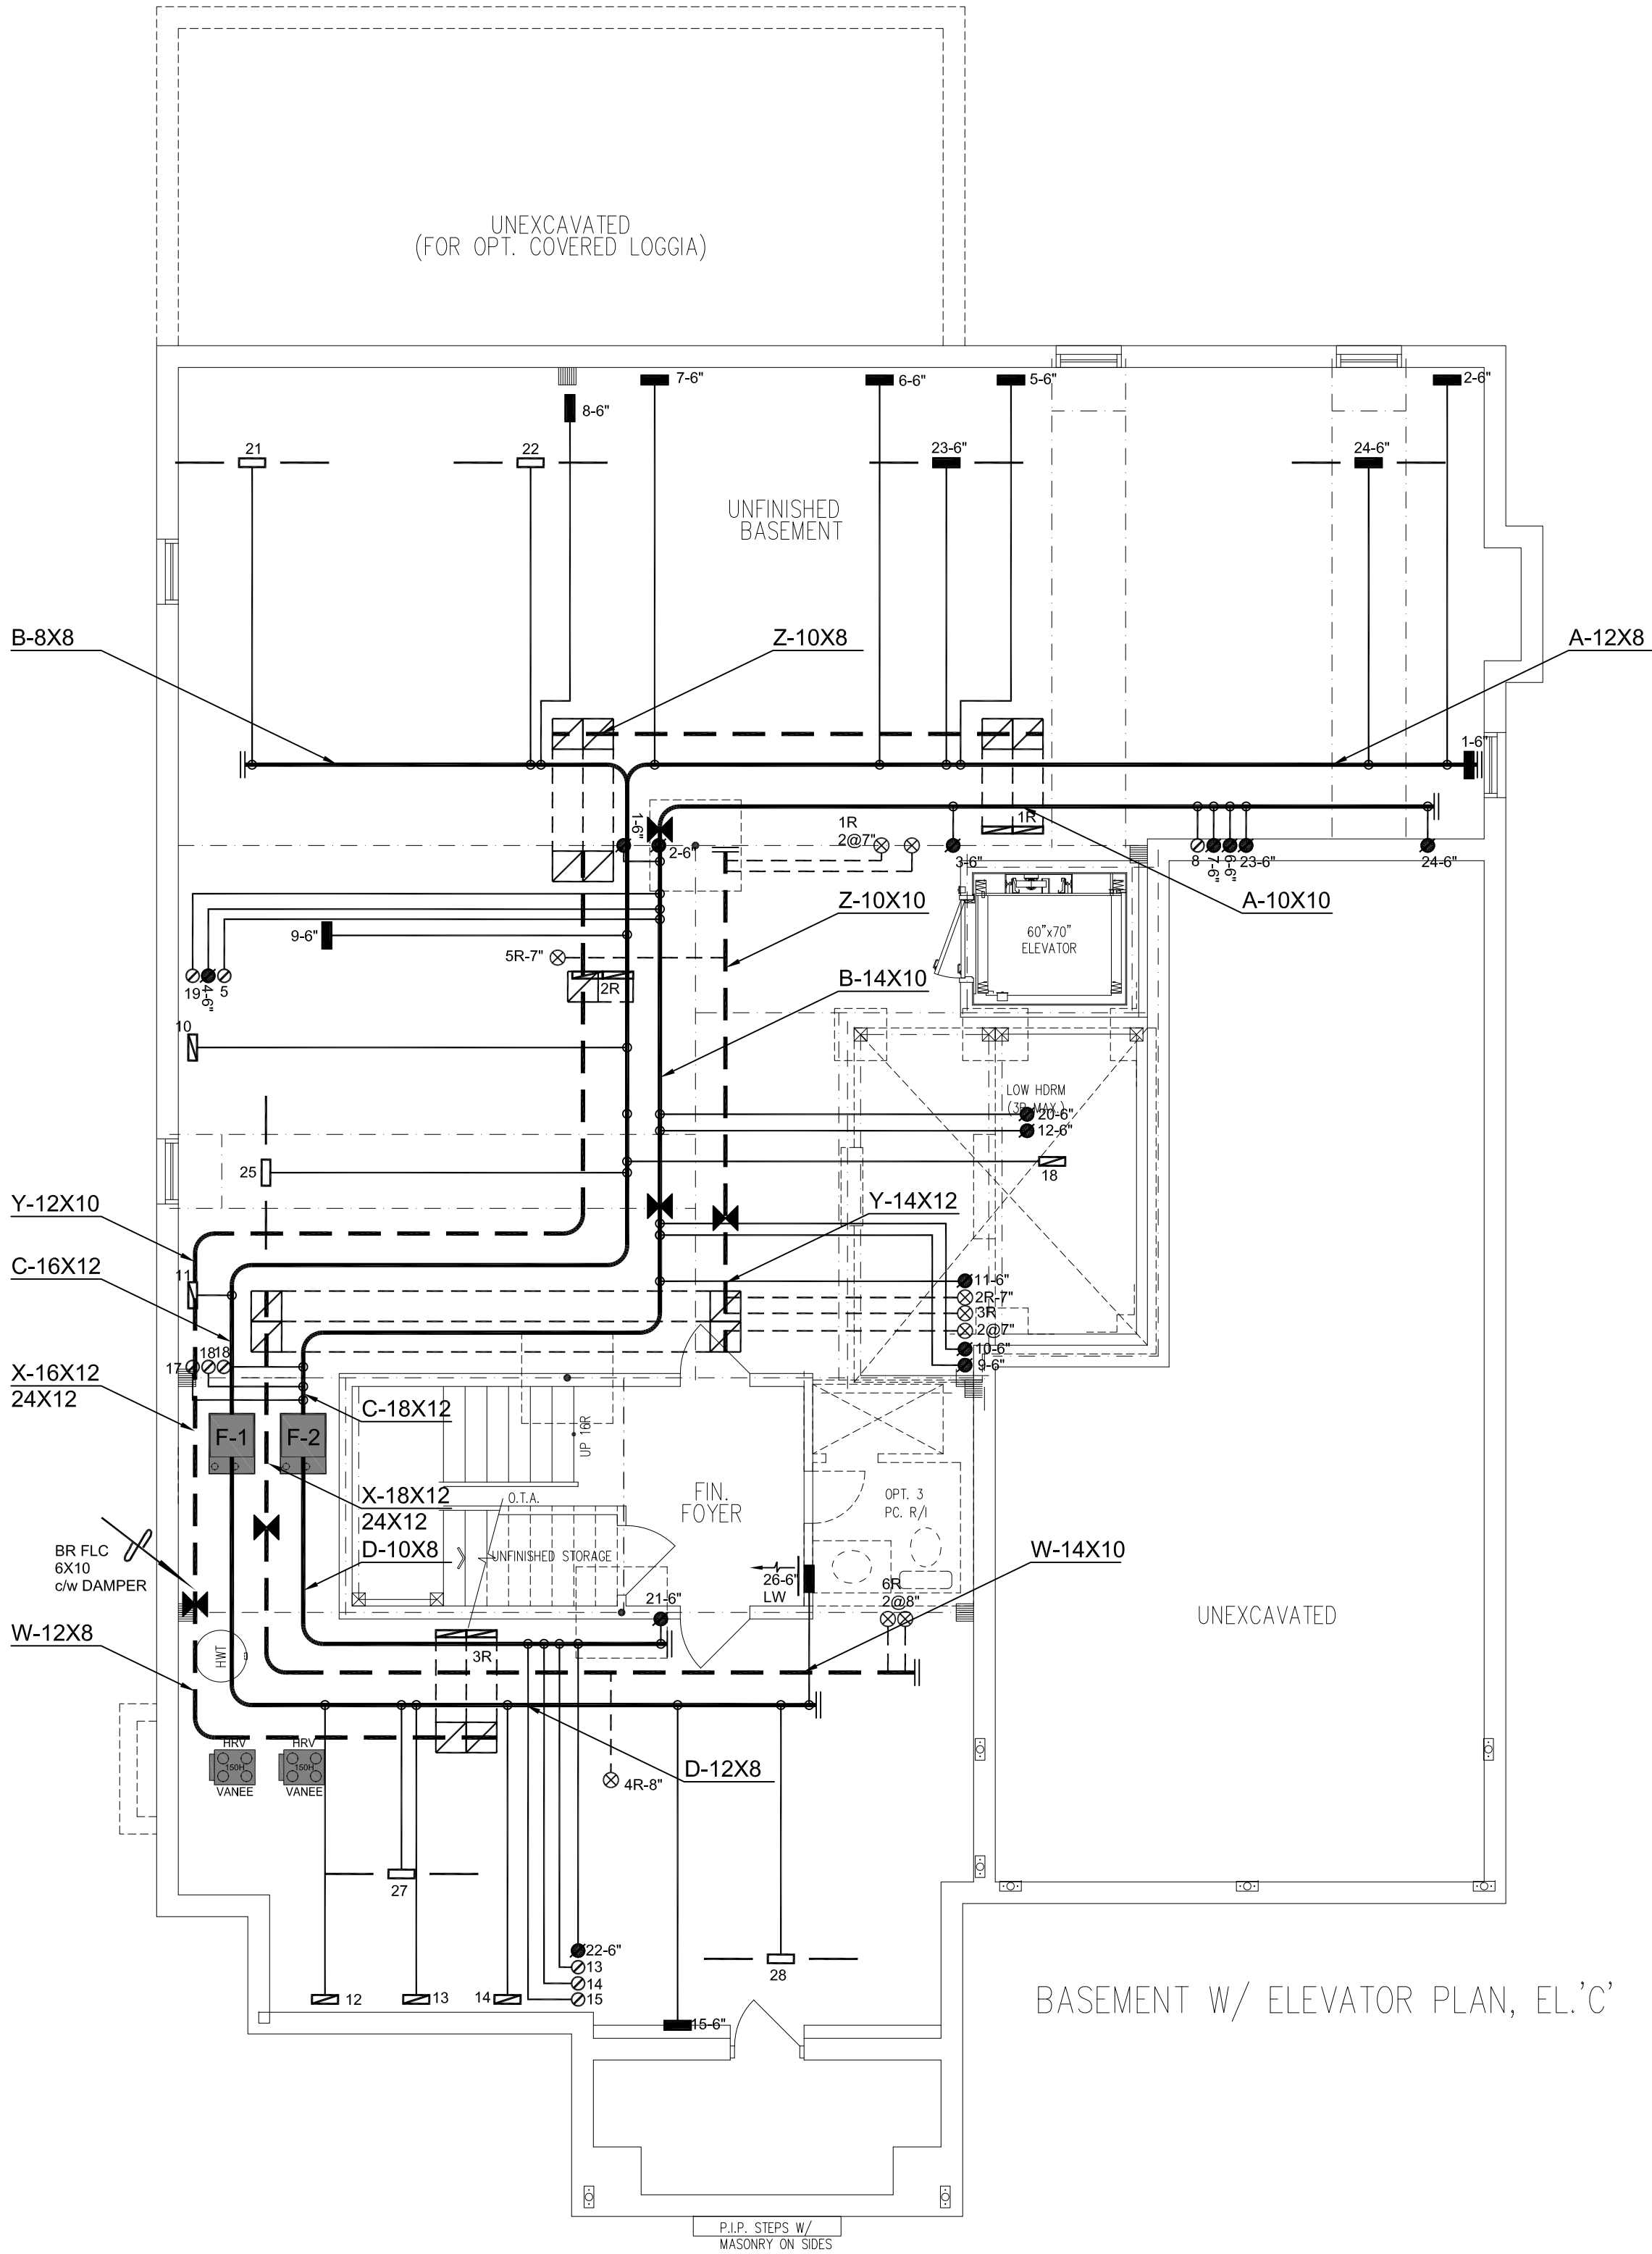

BASEMENT W/ ELEVATOR PLAN, EL.'C'

HVAC LEGEND	
	4X10 SUPPLY GRILLE
	14X8 RETURN GRILLE
	4X10 SUPPLY GRILLE 6\"/>
	30X8 RETURN GRILLE
	SUPPLY DUCTWORK
	RETURN DUCTWORK
	EXHAUST FAN
LW	LOW WALL
HW	HIGH WALL

UNLESS OTHERWISE NOTED, ALL DIMENSIONS ARE IN INCHES. THE DESIGNER SHALL BE RESPONSIBLE FOR THE DESIGN WORK AND ANY NECESSARY PERMITS. THE DESIGNER SHALL BE RESPONSIBLE FOR THE DESIGN WORK AND ANY NECESSARY PERMITS. THE DESIGNER SHALL BE RESPONSIBLE FOR THE DESIGN WORK AND ANY NECESSARY PERMITS.

1	ISSUED FOR PERMIT	APRIL 2022	EG
No.	Revision	Date	By

SB-12 PACKAGE

A1

HVAC DESIGNS LTD.
375 Finley Ave - Unit 202 - Ajax, Ontario L1S 2E2
Tel: 905.619.2300 - 905.420.5300 Fax: 905.619.2375
Email: info@hvacdsgns.ca
Web: www.hvacdsgns.ca
Specializing in Residential Mechanical Design Services

Client: GOLDPARK HOMES
Project: PINE VALLEY PH2
Name: VAUGHAN, ONTARIO
6001 - QUEENSLAND - ELEV C
OPT 2ND - ELEVATOR
5742 SQFT


Sheet Title: BASEMENT HVAC LAYOUT	Checked By: MO	Sheet No: 1
Drawn By: EG	Scale: 3/16"=1'-0"	Date: APRIL 2022
LO #	96172	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

INSTALLATION TO COMPLY WITH THE LATEST ONTARIO BUILDING CODE. ALL SUPPLY BRANCH OUTLETS SHALL BE EQUIPPED WITH MANUAL BALANCING DAMPER. DUCTWORK WHICH PASSES THROUGH THE GARAGE OR UNHEATED SPACES SHALL BE ADEQUATELY INSULATED AND GAS-PROOFED

ALL S/A DIFFUSERS "4x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A

	S/A	R/A	FANS
2ND	22	6	7
1ST	14	3	2
BAS	8	1	0

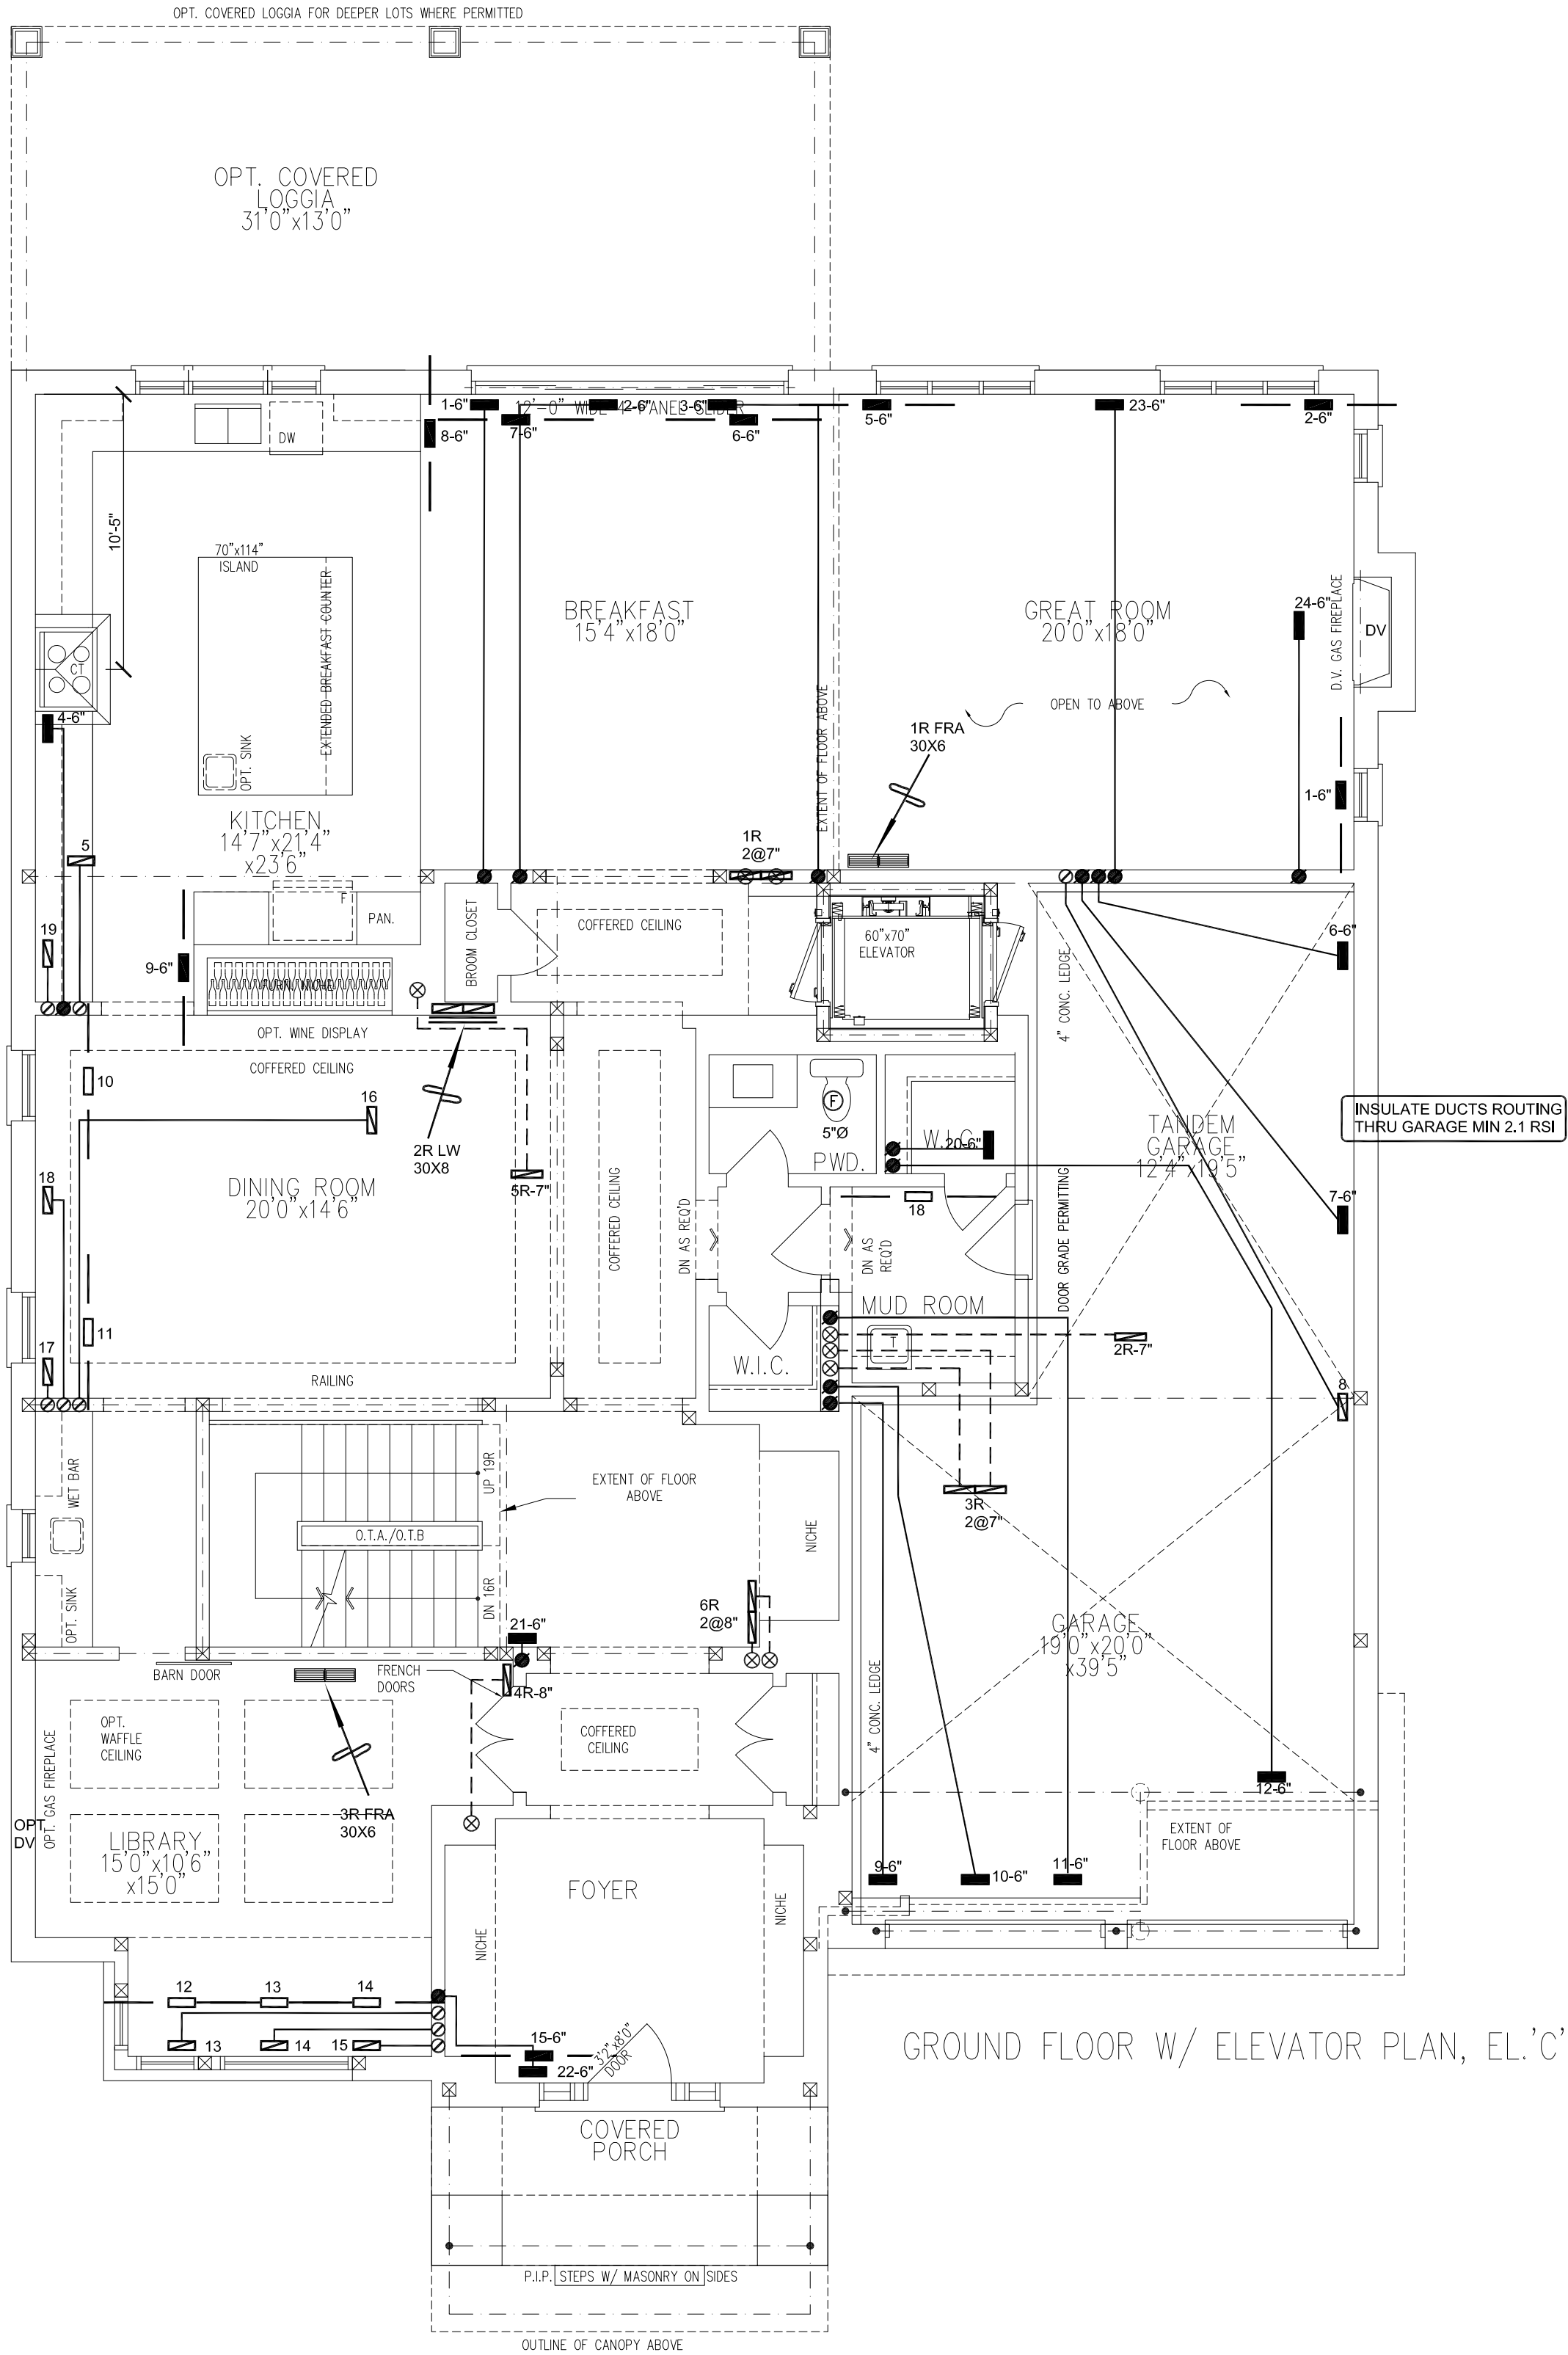

HVAC LEGEND	
	4X10 SUPPLY GRILLE
	14X9 RETURN GRILLE
	4X10 SUPPLY GRILLE 6"Ø BOOT
	30X8 RETURN GRILLE
	SUPPLY DUCTWORK
	RETURN DUCTWORK
	EXHAUST FAN
	LOW WALL
	HIGH WALL

I WARRANT: OWNER SHALL HAVE REVIEW AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND ANY ASSUMPTIONS MADE THEREON. I, I.S. OF THE INFORMATION.

MECHANICAL ENGINEER, P.E. 1969

HVAC DESIGNS LTD.

M. J. O'Neil

1. ISSUED FOR PERMIT	APRIL 2022	EG
No. Revision	Date	By

SB-12 PACKAGE

A1

HVAC DESIGNS LTD.

375 Finley Ave - Unit 202 - Ajax, Ontario L1S 2E2
Tel: 905.619.2300 - 905.420.5300 Fax: 905.619.2375
Email: info@hvacadesigns.ca
Web: www.hvacadesigns.ca
Specializing in Residential Mechanical Design Services

Client: GOLDPARK HOMES
Project Name: PINE VALLEY PH2
VAUGHAN, ONTARIO
6001 - QUEENSLAND - ELEV C
OPT 2ND - ELEVATOR
5742 SQFT

Sheet Title: FIRST FLOOR HVAC LAYOUT	Checked By: MO
Drawn By: EG	Sheet No. 2
Scale: 3/16"=1'-0"	
Date: APRIL 2022	
LO # 96172	

ALL S/A DIFFUSERS "4x10"
UNLESS NOTED OTHERWISE
ON LAYOUT. ALL S/A RUNS 5"Ø
UNLESS NOTED OTHERWISE
ON LAYOUT. UNDERCUT
DOORS 1" min. FOR R/A



	S/A	R/A	FANS
2ND	22	6	7
1ST	14	3	2
BAS	8	1	0

HVAC LEGEND	
	4X10 SUPPLY GRILLE
	14X8 RETURN GRILLE
	4X10 SUPPLY GRILLE 6'X8 BOOT
	30X8 RETURN GRILLE
	SUPPLY DUCTWORK
	RETURN DUCTWORK
	EXHAUST FAN
LW	LOW WALL
HW	HIGH WALL

I, MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.



1	ISSUED FOR PERMIT	APRIL 2022
No.	Revision	Date

SB-12 PACKAGE

A1



375 Finley Ave - Unit 202 - Ajax, Ontario L1S 2E2
Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375
Email: info@hvacdesigns.ca
Web: www.hvacdesigns.ca
Specializing in Residential Mechanical Design Services

Client	GOLDPARK HOMES
Project Name	PINE VALLEY PH2 VAUGHAN, ONTARIO 6001 - QUEENSLAND - ELEV C OPT 2ND - ELEVATOR 5742 SOFT

Sheet Title	SECOND FLOOR HVAC LAYOUT		Sheet No. 3	
Drawn By	EG	Checked By		MO
Scale	3/16"=1'-0"			
Date	APRIL 2022			
LO #	96172			