

Schedule 1: Designer Information

Use one form for each individual who reviews and takes responsibility for design activities with respect to the project.

A. Project Information			
Building number, street name		Unit no.	Lot/con.
Municipality VAUGHAN (WOODBIDGE)	Postal code	Plan number/ other description	
B. Individual who reviews and takes responsibility for design activities			
Name MICHAEL O'ROURKE		Firm HVAC DESIGNS LTD.	
Street address 375 FINLEY AVE		Unit no. 202	Lot/con. N/A
Municipality AJAX	Postal code L1S 2E2	Province ONTARIO	E-mail info@hvacdsgns.ca
Telephone number (905) 619-2300	Fax number (905) 619-2375	Cell number ()	
C. Design activities undertaken by individual identified in Section B. [Building Code Table 3.5.2.1 OF Division C]			
☐ House ☐ Small Buildings ☐ Large Buildings ☐ Complex Buildings ☒ HVAC – House ☐ Building Services ☐ Detection, Lighting and Power ☐ Fire Protection ☐ Building Structural ☐ Plumbing – House ☐ Plumbing – All Buildings ☐ On-site Sewage Systems			
Description of designer's work HEAT LOSS / GAIN CALCULATIONS DUCT SIZING RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY RESIDENTIAL SYSTEM DESIGN per CSA-F280-12		Model: 3103 END 2 - BLK 3 - OPT 4-BED Project: PINE VALLEY DRIVE	
D. Declaration of Designer			
I, <u>MICHAEL O'ROURKE</u> (print name)		declare that (choose one as appropriate):	
☐ I review and take responsibility for the design work on behalf of a firm registered under subsection 3.2.4. of Division C, of the Building Code. I am qualified, and the firm is registered, in the appropriate classes/categories. Individual BCIN: _____ Firm BCIN: _____			
☒ I review and take responsibility for the design and am qualified in the appropriate category as an "other designer" under subsection 3.2.5. of Division C, of the Building Code. Individual BCIN: <u>19669</u> Basis for exemption from registration and qualification: <u>O.B.C SENTENCE 3.2.4.1 (4)</u>			
☐ The design work is exempt from the registration and qualification requirements of the Building Code. Basis for exemption from registration and qualification: _____			
I certify that:			
1. The information contained in this schedule is true to the best of my knowledge. 2. I have submitted this application with the knowledge and consent of the firm.			
May 4, 2021 Date		 Signature of Designer	

NOTE:

- For the purposes of this form, "individual" means the "person" referred to in Clause 3.2.4.7(1) d). of Division C, Article 3.2.5.1. of Division C, and all other persons who are exempt from qualification under Subsections 3.2.4. and 3.2.5. of Division C.
- Schedule 1 is not required to be completed by a holder of a license, temporary license, or a certificate of authorization, issued by the Ontario Association of Architects. Schedule 1 is also not required to be completed by a holder of a license to practise, a limited license to practise, or a certificate of authorization, issued by the Association of Professional Engineers of Ontario.

Application for a Permit Construct or Demolish – Effective January 1, 2015

SITE NAME: PINE VALLEY DRIVE										END 2 - BLK 3 - OPT 4-BED		DATE: May-21		WINTER NATURAL AIR CHANGE RATE		HEAT LOSS AT °F.		CSA-F280-12	
BUILDER: GOLD PARK HOMES										TYPE: 3103		LO# 90631		SUMMER NATURAL AIR CHANGE RATE		HEAT GAIN ΔT °F.		SB-12 PACKAGE A1	
ROOM USE										ENS-4		MBR		BED-3		BED-2		BATH	
EXP. WALL										0		31		25		31		6	
CLG. HT.										9		9		9		9		9	
FACTORS										0		279		225		279		54	
GRS.WALL AREA										LOSS		LOSS		LOSS		LOSS		LOSS	
GLAZING										GAIN		GAIN		GAIN		GAIN		GAIN	
NORTH										0		0		0		0		0	
EAST										0		0		0		0		0	
SOUTH										0		0		0		0		0	
WEST										0		0		0		0		0	
SKYL.T.										0		0		0		0		0	
DOORS										0		0		0		0		0	
NET EXPOSED WALL										4.5		101		177		1093		156	
NET EXPOSED BSMT WALL ABOVE GR										4.3		0		0		0		0	
EXPOSED CLG										1.3		0.6		0.20		0.20		0.20	
NO ATTIC EXPOSED CLG										0		0		0		0		0	
EXPOSED FLOOR										0		0		0		0		0	
BASEMENT/CRAWL HEAT LOSS										0		0		0		0		0	
SLAB ON GRADE HEAT LOSS										0		0		0		0		0	
SUBTOTAL HT LOSS										991		531		2193		2545		860	
SUB TOTAL HT GAIN										832		531		2302		2371		259	
LEVEL FACTOR / MULTIPLIER										0.20		0.20		0.20		0.20		0.50	
AIR CHANGE HEAT LOSS										251		149		555		600		218	
AIR CHANGE HEAT GAIN										51		0		142		128		55	
DUCT LOSS										0		0		0		0		0	
DUCT GAIN										0		0		0		0		0	
HEAT GAIN PEOPLE										240		0		0		0		0	
HEAT GAIN APPLIANCES/LIGHTS										680		2		240		480		0	
TOTAL HT LOSS BTU/H										1242		740		2748		3508		1185	
TOTAL HT GAIN x 1.3 BTU/H										2345		871		4374		4042		1359	

ROOM USE	FACTORS		K/D/G		FOY		BAS		
EXP. WALL	CLG. HT.	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN	LOSS	GAIN
GRS.WALL AREA	GLAZING	891	0	0	0	0	0	750	0
	NORTH	21.3	16.0	0	0	0	0	0	0
	EAST	21.3	41.6	99	2107	4114	0	0	0
	SOUTH	21.3	24.9	48	1021	1195	0	0	0
	WEST	21.3	41.6	0	0	0	21	447	873
	SKYL.T.	37.2	101.5	0	0	0	0	0	0
	DOORS	25.2	4.3	0	0	0	44	1111	187
	NET EXPOSED WALL	4.5	0.8	744	3320	559	286	1276	215
	NET EXPOSED BSMT WALL ABOVE GR	3.6	0.6	0	0	0	0	0	0
	EXPOSED CLG	1.3	0.6	0	0	0	0	0	0
NO ATTIC EXPOSED CLG	2.7	1.3	0	0	0	0	0	0	
EXPOSED FLOOR	2.6	0.4	0	0	0	0	0	0	
BASEMENT/CRAWL HEAT LOSS			0	0	0	0	0	0	
SLAB ON GRADE HEAT LOSS			0	0	0	0	0	0	
SUBTOTAL HT LOSS			6448		5868	2834		4089	
SUB TOTAL HT GAIN			0.30	0.45	0.30	0.45		0.50	1.52
LEVEL FACTOR / MULTIPLIER			2930		1288			6611	
AIR CHANGE HEAT LOSS									
AIR CHANGE HEAT GAIN									
DUCT LOSS			0		0			0	
DUCT GAIN									
HEAT GAIN PEOPLE	240		0		0			0	
HEAT GAIN APPLIANCES/LIGHTS									
TOTAL HT LOSS BTU/H			9379		4122			10699	
TOTAL HT GAIN x 1.3 BTU/H								1860	

SITE NAME: PINE VALLEY DRIVE
BUILDER: GOLD PARK HOMES
TYPE: 3103
END 2 - BLK 3 - OPT 4-BED
DATE: May-21
GFA: 2258
LO# 90631

HEATING CFM	980	COOLING CFM	980	AFUE = 96 %
TOTAL HEAT LOSS	39,400	TOTAL HEAT GAIN	30,801	INPUT (BTU/H) = 44,000
AIR FLOW RATE CFM	24.87	AIR FLOW RATE CFM	31.82	OUTPUT (BTU/H) = 42,800
RUN COUNT	4th	3rd	2nd	1st
S/A	0	0	11	6
R/A	0	0	4	1

ML196UH045XE36B \$LENNOX 45
FAN SPEED LOW 620
MEDIUM 685
HIGH 980
DESIGN CFM = 980
CFM @ .6" E.S.P. = 1110
TEMPERATURE RISE 40 °F

All S/A diffusers 4"x10" unless noted otherwise on layout.														
All S/A runs 5'Ø unless noted otherwise on layout.														
RUN #	1	2	3	4	5	6	7	8	9	10	11	12	13	14
ROOM NAME	BED-1	MBR	BED-2	BED-2	BED-3	BED-3	LAUN	ENS-4	MBR	ENS	BATH	K/D/G	K/D/G	K/D/G
RM LOSS MBH	1.24	1.49	1.75	1.75	1.37	1.37	1.88	0.25	1.49	0.74	1.18	2.34	2.34	2.34
CFM PER RUN HEAT	31	37	44	44	34	34	47	6	37	18	29	58	58	58
RM GAIN MBH	2.34	2.19	2.02	2.02	2.19	2.19	0.69	0.13	2.19	0.87	1.36	2.25	2.25	2.25
CFM PER RUN COOLING	75	70	64	64	70	70	22	4	70	28	43	71	71	71
ADJUSTED PRESSURE	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17	0.17
ACTUAL DUCT LGH	48	54	61	55	59	53	42	36	46	38	50	18	26	37
EQUIVALENT LENGTH	150	130	140	120	150	150	160	160	130	150	160	110	140	160
TOTAL EFFECTIVE LENGTH	198	184	201	175	209	203	202	196	176	188	210	128	166	197
ADJUSTED PRESSURE	0.09	0.09	0.09	0.1	0.08	0.08	0.09	0.09	0.1	0.09	0.08	0.13	0.1	0.09
ROUND DUCT SIZE	6	5	5	5	6	6	5	4	5	4	5	5	5	5
HEATING VELOCITY (ft/min)	158	272	323	323	173	173	345	69	272	207	213	426	426	426
COOLING VELOCITY (ft/min)	382	514	470	470	357	357	162	46	514	321	316	521	521	521
OUTLET GRILL SIZE	4X10	3X10	3X10	3X10	4X10	4X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10	3X10
TRUNK	TRUNK A	TRUNK A	TRUNK A	TRUNK B	TRUNK C	TRUNK C	TRUNK A	TRUNK B	TRUNK B	TRUNK B	TRUNK B	TRUNK D	TRUNK B	TRUNK A

RUN #	25
ROOM NAME	B-BTH
RM LOSS MBH	0.68
CFM PER RUN HEAT	17
RM GAIN MBH	0.01
CFM PER RUN COOLING	0
ADJUSTED PRESSURE	0.17
ACTUAL DUCT LGH	16
EQUIVALENT LENGTH	100
TOTAL EFFECTIVE LENGTH	116
ADJUSTED PRESSURE	0.15
ROUND DUCT SIZE	4
HEATING VELOCITY (ft/min)	195
COOLING VELOCITY (ft/min)	0
OUTLET GRILL SIZE	3X10
TRUNK	TRUNK D

SUPPLY AIR TRUNK SIZE														
TRUNK	CFM	STAT. PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK	CFM	STAT. PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK	CFM	STAT. PRESS.
TRUNK A	378	0.09	9.5	10	8	TRUNK G	0	0.00	0	0	8	TRUNK O	0	0.05
TRUNK B	601	0.08	11.6	16	8	TRUNK H	0	0.00	0	0	8	TRUNK P	0	0.05
TRUNK C	237	0.08	8.2	8	8	TRUNK I	0	0.00	0	0	8	TRUNK Q	0	0.05
TRUNK D	980	0.08	13.9	22	8	TRUNK J	0	0.00	0	0	8	TRUNK R	0	0.05
TRUNK E	0	0.00	0	0	0	TRUNK K	0	0.00	0	0	8	TRUNK S	0	0.05
TRUNK F	0	0.00	0	0	0	TRUNK L	0	0.00	0	0	8	TRUNK T	0	0.05
RETURN AIR TRUNK SIZE														
TRUNK	CFM	STAT. PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK	CFM	STAT. PRESS.	ROUND DUCT	RECT DUCT	VELOCITY (ft/min)	TRUNK	CFM	STAT. PRESS.
TRUNK V	0	0.05	0	0	8	TRUNK U	0	0.05	0	0	8	TRUNK V	0	0.05
TRUNK W	0	0.05	0	0	8	TRUNK X	980	0.05	15.7	28	8	TRUNK W	0	0.05
TRUNK Y	425	0.05	11.5	16	8	TRUNK Z	0	0.05	0	0	8	TRUNK X	980	0.05
DROP	980	0.05	15.7	24	10	588	0	0.05	0	0	8	TRUNK Y	425	0.05
RETURN AIR #														
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15
0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
75	190	85	75	420	0	0	0	0	0	0	0	0	0	0
0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15	0.15
44	42	55	57	42	1	1	1	1	1	1	1	1	1	1
245	165	195	250	185	0	0	0	0	0	0	0	0	0	0
289	207	250	307	227	1	1	1	1	1	1	1	1	1	1
0.05	0.07	0.06	0.05	0.07	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80	14.80
6	7.8	6	6	10.5	0	0	0	0	0	0	0	0	0	0
8	8	8	8	8	0	0	0	0	0	0	0	0	0	0
X	X	X	X	X	X	X	X	X	X	X	X	X	X	X
14	24	14	14	30	0	0	0	0	0	0	0	0	0	0

Michael O'Rourke

TYPE: 3103
SITE NAME: PINE VALLEY DRIVE

LO # 90631
END 2 - BLK 3 - OPT 4-BED

RESIDENTIAL MECHANICAL VENTILATION DESIGN SUMMARY

COMBUSTION APPLIANCES		9.32.3.1(1)
a)	☒ Direct vent (sealed combustion) only	
b)	☐ Positive venting induced draft (except fireplaces)	
c)	☐ Natural draft, B-vent or induced draft gas fireplace	
d)	☐ Solid Fuel (including fireplaces)	
e)	☐ No Combustion Appliances	

HEATING SYSTEM	
☒ Forced Air	☐ Non Forced Air
☐ Electric Space Heat	

HOUSE TYPE		9.32.1(2)
☒ I	Type a) or b) appliance only, no solid fuel	
☐ II	Type I except with solid fuel (including fireplaces)	
☐ III	Any Type c) appliance	
☐ IV	Type I, or II with electric space heat	
☐	Other: Type I, II or IV no forced air	

SYSTEM DESIGN OPTIONS		O.N.H.W.P.
☐ 1	Exhaust only/Forced Air System	
☐ 2	HRV with Ducting/Forced Air System	
☒ 3	HRV Simplified/connected to forced air system	
☐ 4	HRV with Ducting/non forced air system	
☐	Part 6 Design	

TOTAL VENTILATION CAPACITY		9.32.3.3(1)
Basement + Master Bedroom	<u>2</u> @ 21.2 cfm	<u>42.4</u> cfm
Other Bedrooms	<u>3</u> @ 10.6 cfm	<u>31.8</u> cfm
Kitchen & Bathrooms	<u>6</u> @ 10.6 cfm	<u>63.6</u> cfm
Other Rooms	<u>2</u> @ 10.6 cfm	<u>21.2</u> cfm
Table 9.32.3.A.	TOTAL	<u>159.0</u> cfm

PRINCIPAL VENTILATION CAPACITY REQUIRED		9.32.3.4(1)
1	Bedroom	31.8 cfm
2	Bedroom	47.7 cfm
3	Bedroom	63.6 cfm
4	Bedroom	79.5 cfm
5	Bedroom	95.4 cfm
TOTAL		<u>79.5</u> cfm

SUPPLEMENTAL VENTILATION CAPACITY		9.32.3.5.
Total Ventilation Capacity	<u>159</u>	cfm
Less Principal Ventil. Capacity	<u>79.5</u>	cfm
Required Supplemental Capacity	<u>79.5</u>	cfm

PRINCIPAL EXHAUST FAN CAPACITY	
Model: VANEE V150H	Location: BSMT
<u>79.5</u> cfm	☒ HVI Approved

PRINCIPAL EXHAUST HEAT LOSS CALCULATION				
CFM	ΔT °F	FACTOR	% LOSS	
79.5 CFM	X 76 F	X 1.08	X	0.25

SUPPLEMENTAL FANS		BY INSTALLING CONTRACTOR		
Location	Model	cfm	HVI	Sones
ENS	BY INSTALLING CONTRACTOR	50	☒	3.5
ENS-4	BY INSTALLING CONTRACTOR	50	☒	3.5
BATH	BY INSTALLING CONTRACTOR	50	☒	3.5

HEAT RECOVERY VENTILATOR		9.32.3.11.
Model: VANEE V150H		
<u>150</u> cfm high	<u>35</u> cfm low	
<u>75</u> % Sensible Efficiency	☒ HVI Approved	
@ 32 deg F (0 deg C)		

LOCATION OF INSTALLATION	
Lot:	Concession
Township	Plan:
Address	
Roll #	Building Permit #

BUILDER:	
GOLD PARK HOMES	
Name:	
Address:	
City:	
Telephone #:	Fax #:

INSTALLING CONTRACTOR	
Name:	
Address:	
City:	
Telephone #:	Fax #:

DESIGNER CERTIFICATION	
I hereby certify that this ventilation system has been designed in accordance with the Ontario Building Code.	
Name:	HVAC Designs Ltd.
Signature:	<i>Michael O'Rourke</i>
HRAI #	001820
Date:	May-21

CSA F280-12 Residential Heat Loss and Heat Gain Calculations																																															
Formula Sheet (For Air Leakage / Ventilation Calculation)																																															
LO#: 90631		Model: 3103		Builder: GOLD PARK HOMES		Date: 5/4/2021																																									
Volume Calculation				Air Change & Delta T Data																																											
House Volume <table><tr><th>Level</th><th>Floor Area (ft²)</th><th>Floor Height (ft)</th><th>Volume (ft³)</th></tr><tr><td>Bsmt</td><td>920</td><td>9</td><td>8280</td></tr><tr><td>First</td><td>920</td><td>11</td><td>10120</td></tr><tr><td>Second</td><td>1372</td><td>9</td><td>12348</td></tr><tr><td>Third</td><td>0</td><td>9</td><td>0</td></tr><tr><td>Fourth</td><td>0</td><td>9</td><td>0</td></tr><tr><td colspan="3">Total:</td><td>30,748.0 ft³</td></tr><tr><td colspan="3">Total:</td><td>870.7 m³</td></tr></table>				Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)	Bsmt	920	9	8280	First	920	11	10120	Second	1372	9	12348	Third	0	9	0	Fourth	0	9	0	Total:			30,748.0 ft³	Total:			870.7 m³	<table><tr><td colspan="2">WINTER NATURAL AIR CHANGE RATE</td><td>0.336</td></tr><tr><td colspan="2">SUMMER NATURAL AIR CHANGE RATE</td><td>0.109</td></tr></table>						WINTER NATURAL AIR CHANGE RATE		0.336	SUMMER NATURAL AIR CHANGE RATE		0.109
Level	Floor Area (ft²)	Floor Height (ft)	Volume (ft³)																																												
Bsmt	920	9	8280																																												
First	920	11	10120																																												
Second	1372	9	12348																																												
Third	0	9	0																																												
Fourth	0	9	0																																												
Total:			30,748.0 ft³																																												
Total:			870.7 m³																																												
WINTER NATURAL AIR CHANGE RATE		0.336																																													
SUMMER NATURAL AIR CHANGE RATE		0.109																																													
				Design Temperature Difference <table><tr><td>Tin °C</td><td>Tout °C</td><td>ΔT °C</td><td>ΔT °F</td></tr><tr><td>Winter DTDh</td><td>-20</td><td>42</td><td>76</td></tr><tr><td>Summer DTDc</td><td>24</td><td>31</td><td>7</td></tr><tr><td></td><td>24</td><td>31</td><td>7</td></tr><tr><td></td><td></td><td></td><td>13</td></tr></table>						Tin °C	Tout °C	ΔT °C	ΔT °F	Winter DTDh	-20	42	76	Summer DTDc	24	31	7		24	31	7				13																		
Tin °C	Tout °C	ΔT °C	ΔT °F																																												
Winter DTDh	-20	42	76																																												
Summer DTDc	24	31	7																																												
	24	31	7																																												
			13																																												
5.2.3.1 Heat Loss due to Air Leakage				6.2.6 Sensible Gain due to Air Leakage																																											
$HL_{airb} = LR_{airh} \times \frac{V_b}{3.6} \times DTD_h \times 1.2$ <table><tr><td>0.336</td><td>x</td><td>241.86</td><td>x</td><td>42 °C</td><td>x</td><td>1.2</td><td>=</td><td>4121 W</td></tr><tr><td colspan="7"></td><td>=</td><td>14060 Btu/h</td></tr></table>				0.336	x	241.86	x	42 °C	x	1.2	=	4121 W								=	14060 Btu/h	$HG_{satb} = LR_{airc} \times \frac{V_b}{3.6} \times DTD_c \times 1.2$ <table><tr><td>=</td><td>0.109</td><td>x</td><td>241.86</td><td>x</td><td>7 °C</td><td>x</td><td>1.2</td><td>=</td><td>226 W</td></tr><tr><td colspan="7"></td><td>=</td><td>770 Btu/h</td></tr></table>						=	0.109	x	241.86	x	7 °C	x	1.2	=	226 W								=	770 Btu/h	
0.336	x	241.86	x	42 °C	x	1.2	=	4121 W																																							
							=	14060 Btu/h																																							
=	0.109	x	241.86	x	7 °C	x	1.2	=	226 W																																						
							=	770 Btu/h																																							
5.2.3.2 Heat Loss due to Mechanical Ventilation				6.2.7 Sensible heat Gain due to Ventilation																																											
$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ <table><tr><td>80 CFM</td><td>x</td><td>76 °F</td><td>x</td><td>1.08</td><td>x</td><td>0.25</td><td>=</td><td>1631 Btu/h</td></tr></table>				80 CFM	x	76 °F	x	1.08	x	0.25	=	1631 Btu/h	$HL_{vairb} = PVC \times DTD_h \times 1.08 \times (1 - E)$ <table><tr><td>80 CFM</td><td>x</td><td>13 °F</td><td>x</td><td>1.08</td><td>x</td><td>0.25</td><td>=</td><td>275 Btu/h</td></tr></table>						80 CFM	x	13 °F	x	1.08	x	0.25	=	275 Btu/h																				
80 CFM	x	76 °F	x	1.08	x	0.25	=	1631 Btu/h																																							
80 CFM	x	13 °F	x	1.08	x	0.25	=	275 Btu/h																																							
5.2.3.3 Calculation of Air Change Heat Loss for Each Room (Floor Multiplier Section)																																															
$HL_{airr} = Level\ Factor \times HL_{airbv} \times \{(HL_{agcr} + HL_{bgcr}) \div (HL_{agclevel} + HL_{bgclevel})\}$																																															
Level		Level Factor (LF)		HLairbv Air Leakage + Ventilation Heat Loss (Btu/h)		Level Conductive Heat Loss: (HLclevel)		Air Leakage Heat Loss Multiplier (LF x HLairbv / HLlevel)																																							
1		0.5		14,060		4,348		1.617																																							
2		0.3				9,283		0.454																																							
3		0.2				11,112		0.253																																							
4		0				0		0.000																																							
5		0				0		0.000																																							
*HLairbv = Air leakage heat loss + ventilation heat loss																																															
*For a balanced or supply only ventilation system HLairv = 0																																															

HEAT LOSS AND GAIN SUMMARY SHEET

MODEL: 3103	END 2 - BLK 3 - OPT 4-BED	BUILDER: GOLD PARK HOMES
SFQT: 2258	LO# 90631	SITE: PINE VALLEY DRIVE

DESIGN ASSUMPTIONS

HEATING	°F	COOLING	°F
OUTDOOR DESIGN TEMP.	-4	OUTDOOR DESIGN TEMP.	88
INDOOR DESIGN TEMP.	72	INDOOR DESIGN TEMP. (MAX 75°F)	75

BUILDING DATA

ATTACHMENT:	ATTACHED	# OF STORIES (+BASEMENT):	3
FRONT FACES:	EAST	ASSUMED (Y/N):	Y
AIR CHANGES PER HOUR:	3.57	ASSUMED (Y/N):	Y
AIR TIGHTNESS CATEGORY:	AVERAGE	ASSUMED (Y/N):	Y
WIND EXPOSURE:	SHELTERED	ASSUMED (Y/N):	Y
HOUSE VOLUME (ft³):	30748.0	ASSUMED (Y/N):	Y
INTERNAL SHADING:	BLINDS/CURTAINS	ASSUMED OCCUPANTS:	5
INTERIOR LIGHTING LOAD (Btu/h/ft²):	1.27	DC BRUSHLESS MOTOR (Y/N):	Y
FOUNDATION CONFIGURATION	BCIN_1	DEPTH BELOW GRADE:	7.5 ft
LENGTH: 43.0 ft	WIDTH: 33.0 ft	EXPOSED PERIMETER:	108.0 ft


2012 OBC - COMPLIANCE PACKAGE		
Component	Compliance Package A1	
	Nominal	Min. Eff.
Ceiling with Attic Space Minimum RSI (R)-Value	60	59.22
Ceiling Without Attic Space Minimum RSI (R)-Value	31	27.65
Exposed Floor Minimum RSI (R)-Value	31	29.80
Walls Above Grade Minimum RSI (R)-Value	22	17.03
Basement Walls Minimum RSI (R)-Value	20 ci	21.12
Below Grade Slab Entire surface > 600 mm below grade Minimum RSI (R)-Value	-	-
Edge of Below Grade Slab ≤ 600 mm Below Grade Minimum RSI (R)-Value	10	10
Heated Slab or Slab ≤ 600 mm below grade Minimum RSI (R)-Value	10	11.13
Windows and Sliding Glass Doors Maximum U-Value	0.28	-
Skylights Maximum U-Value	0.49	-
Space Heating Equipment Minimum AFUE	96%	-
HRV Minimum Efficiency	75%	-
Domestic Hot Water Heater Minimum EF	0.8	-

INDIVIDUAL BCIN: 19669
MICHAEL O'ROURKE



Residential Foundation Thermal Load Calculator

Supplemental tool for CAN/CSA-F280

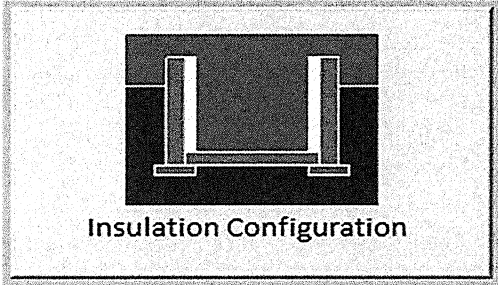Weather Station Description		
Province:	Ontario	
Region:	Vaughan (Woodbridge)	
Site Description		
Soil Conductivity:	Normal conductivity: dry sand, loam, clay	
Water Table:	Normal (7-10 m, 23-33 ft)	
Foundation Dimensions		
Floor Length (m):	13.1	 Insulation Configuration
Floor Width (m):	10.1	
Exposed Perimeter (m):	32.9	
Wall Height (m):	2.7	
Depth Below Grade (m):	2.29	
Window Area (m ²):	1.5	
Door Area (m ²):	1.9	
Radiant Slab		
Heated Fraction of the Slab:	0	
Fluid Temperature (°C):	33	
Design Months		
Heating Month	1	
Foundation Loads		
Heating Load (Watts):		855

TYPE: 3103
LO# 90631

END 2 - BLK 3 - OPT 4-BED

Air Infiltration Residential Load Calculator


Supplemental tool for CAN/CSA-F280

Weather Station Description				
Province:	Ontario			
Region:	Vaughan (Woodbridge)			
Weather Station Location:	Open flat terrain, grass			
Anemometer height (m):	10			
Local Shielding				
Building Site:	Suburban, forest			
Walls:	Heavy			
Flue:	Heavy			
Highest Ceiling Height (m):	6.55			
Building Configuration				
Type:	Semi			
Number of Stories:	Two			
Foundation:	Full			
House Volume (m ³):	870.7			
Air Leakage/Ventilation				
Air Tightness Type:	Present (1961-) (3.57 ACH)			
Custom BDT Data:	ELA @ 10 Pa.	1160.7 cm ²		
	3.57	ACH @ 50 Pa		
Mechanical Ventilation (L/s):	Total Supply	Total Exhaust		
	37.5	37.5		
Flue Size				
Flue #:	#1	#2	#3	#4
Diameter (mm):	0	0	0	0
Natural Infiltration Rates				
Heating Air Leakage Rate (ACH/H):	0.336			
Cooling Air Leakage Rate (ACH/H):	0.109			

TYPE: 3103
LO# 90631

END 2 - BLK 3 - OPT 4-BED

UNEXCAVATED

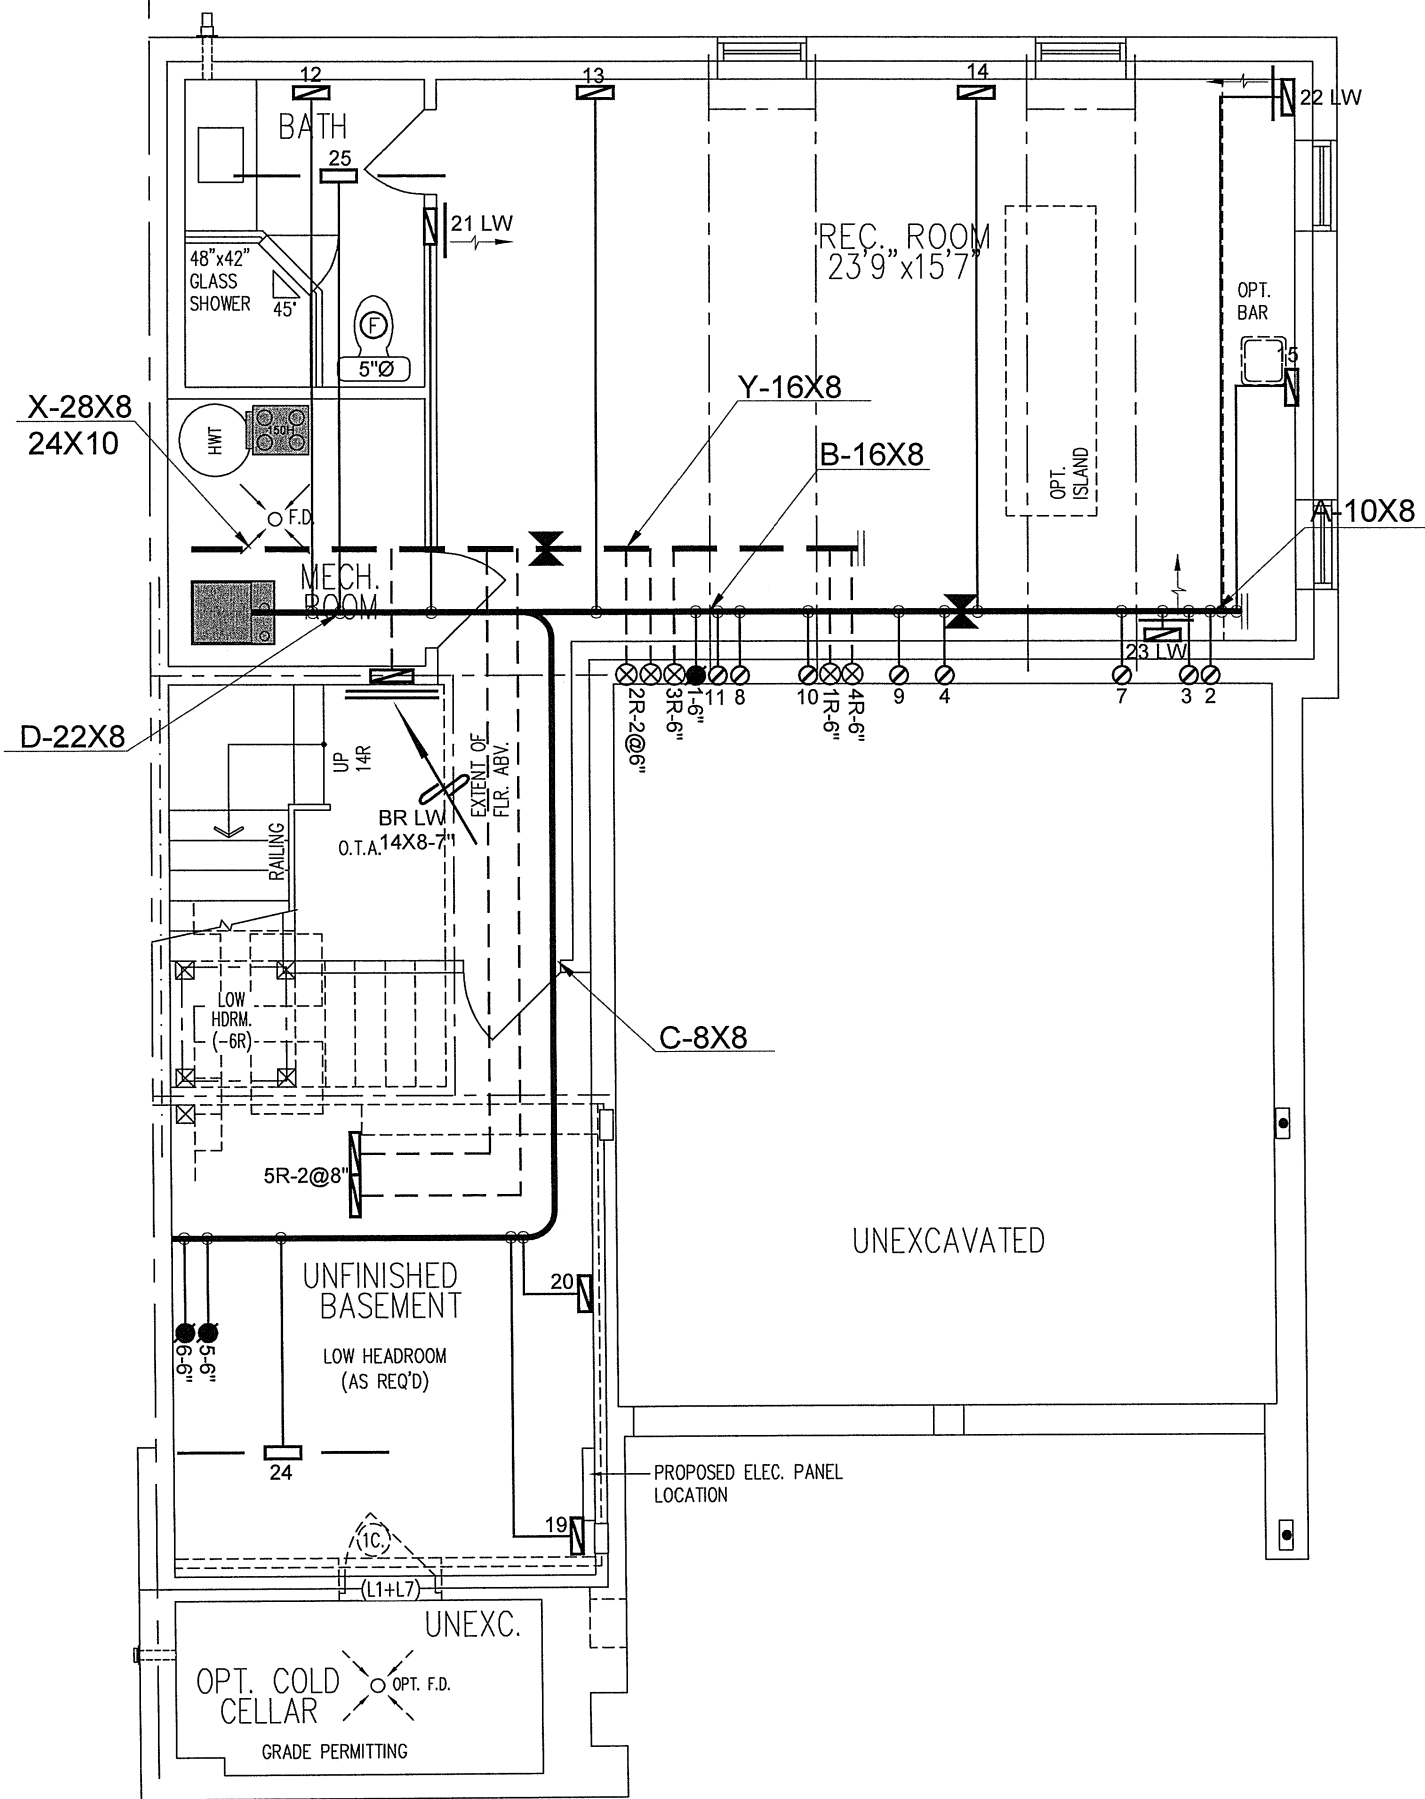

BASEMENT PLAN, ELEV. 'B' – BLOCK 3

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.


CSA-F280-12

PACKAGE A1

HVAC LEGEND							3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		HVACDESIGNS LTD. 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services	HEAT LOSS 41031 BTU/H UNIT DATA		# OF RUNS S/A R/A FANS			Sheet Title BASEMENT HEATING LAYOUT	
Project Name PINE VALLEY DRIVE VAUGHAN, ONTARIO			MAKE LENNOX		3RD FLOOR				
			MODEL ML196UH045XE36B		2ND FLOOR 11 4 4				
			INPUT 44 MBTU/H		1ST FLOOR 6 1 2				
			OUTPUT 42.8 MBTU/H		BASEMENT 5 1 1				
END 2 - BLK 3 - OPT 4-BED 3103 2258 sqft		COOLING 2.5 TONS		ALL S/A DIFFUSERS 4 "x10" UNLESS NOTED OTHERWISE ON LAYOUT. ALL S/A RUNS 5"Ø UNLESS NOTED OTHERWISE ON LAYOUT. UNDERCUT DOORS 1" min. FOR R/A			Date APR/2021		
		FAN SPEED 980 cfm @ 0.6" w.c.					Scale 3/16" = 1'-0"		
		Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.		BCIN# 19669			LO# 90631		

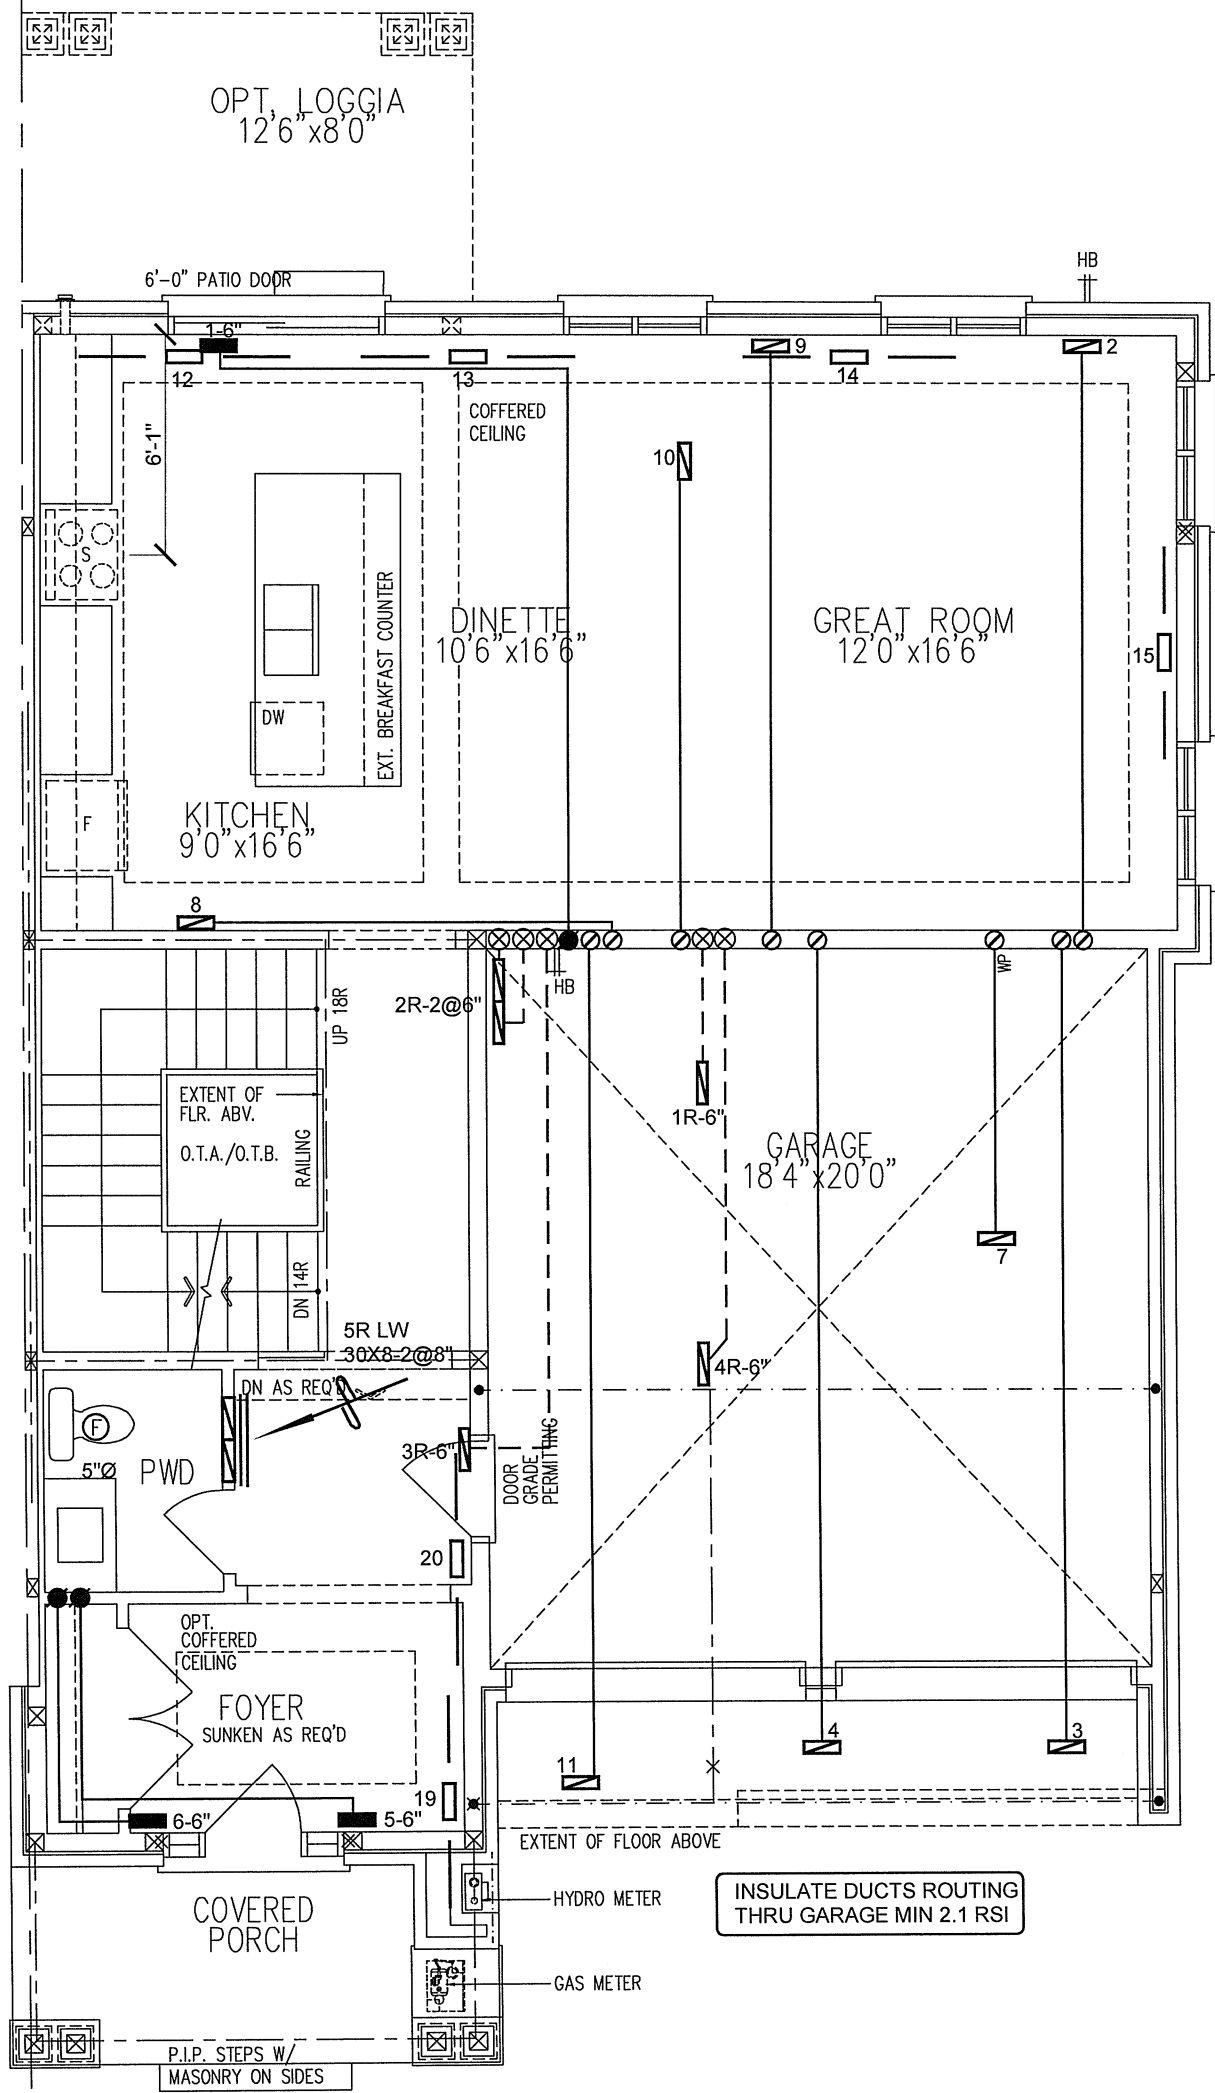

GROUND FLOOR PLAN, ELEV. 'B' – BLOCK 3

I MICHAEL O'ROURKE HAVE REVIEWED AND TAKE RESPONSIBILITY FOR THE DESIGN WORK AND AM QUALIFIED UNDER DIVISION C, 3.2.5 OF THE BUILDING CODE.

Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.


CSA-F280-12

PACKAGE A1

HVAC LEGEND							3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.	
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.	
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS	

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GOLD PARK HOMES			FIRST FLOOR HEATING LAYOUT	
Project Name			Date	APR/2021
PINE VALLEY DRIVE VAUGHAN, ONTARIO			Scale	3/16" = 1'-0"
END 2 - BLK 3 - OPT 4-BED 3103 2258 sqft			BCIN# 19669	
			LO#	90631

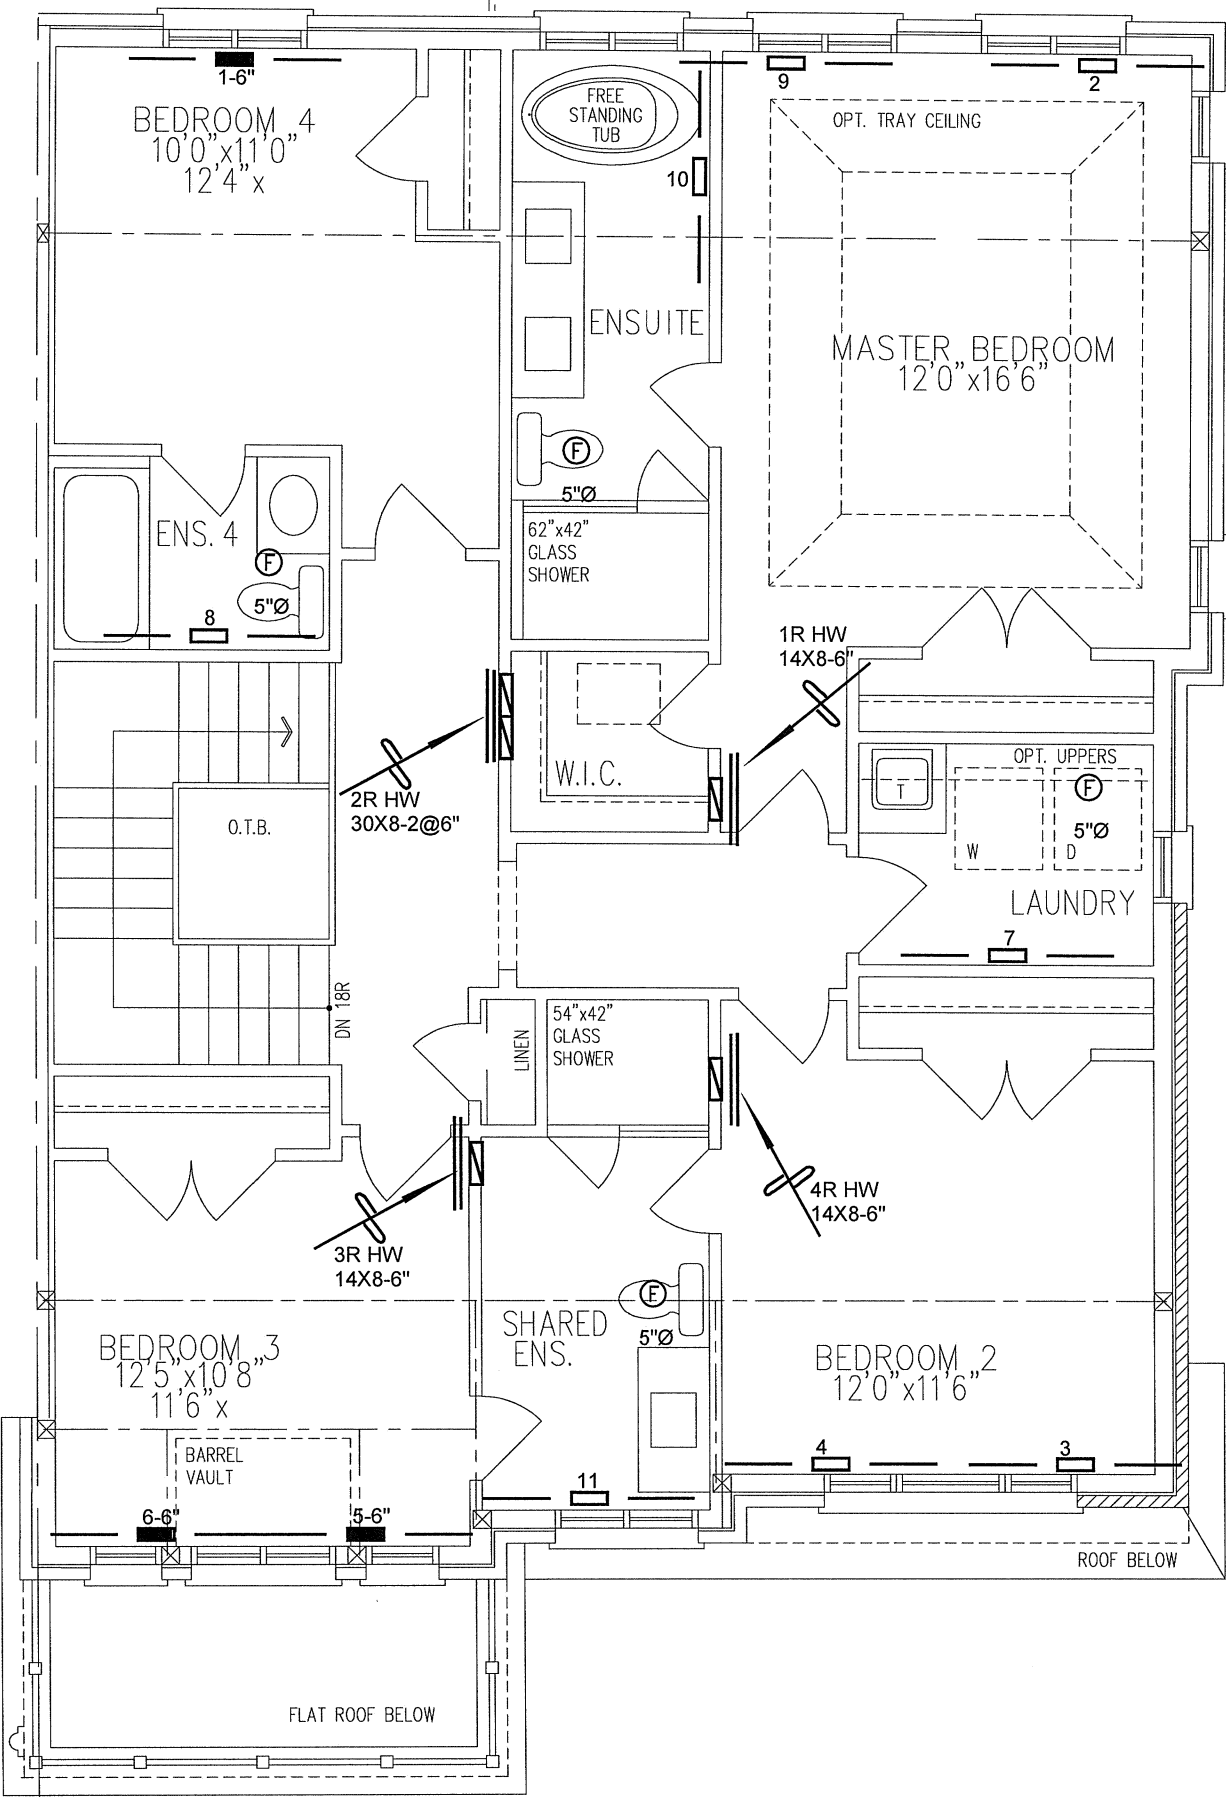

OPT. 4-BEDROOM FLOOR PLAN, ELEV. 'B'
- BLOCK 3

4-BEDROOM
IS STANDARD

I MICHAEL O'ROURKE HAVE REVIEW
AND TAKE RESPONSIBILITY FOR THE
DESIGN WORK AND AM QUALIFIED
UNDER DIVISION C, 3.2.5 OF THE
BUILDING CODE.
Michael O'Rourke
Michael O'Rourke, BCIN# 19669
HVAC DESIGNS LTD.

CSA-F280-12
PACKAGE A1

HVAC LEGEND								3.		
SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	SYMBOL	DESCRIPTION	2.		
	SUPPLY AIR GRILLE		6" SUPPLY AIR BOOT ABOVE		14"x8" RETURN AIR GRILLE		RETURN AIR STACK ABOVE	1.		
	SUPPLY AIR GRILLE 6" BOOT		SUPPLY AIR STACK FROM 2nd FLOOR		30"x8" RETURN AIR GRILLE		RETURN AIR STACK 2nd FLOOR	No.	Description	Date
	SUPPLY AIR BOOT ABOVE		6" SUPPLY AIR STACK 2nd FLOOR		FRA- FLOOR RETURN AIR GRILLE		REDUCER	REVISIONS		

ALL DRAWINGS, CALCULATIONS AND SPECIFICATIONS ARE THE PROPERTY OF HVAC DESIGNS LTD.© AND MAY NOT BE REPRODUCED, MODIFIED OR ALTERED WITHOUT EXPRESSED WRITTEN CONSENT. THE DRAWINGS ARE DATED AND USE OF THESE DRAWINGS AFTER ONE YEAR FROM THE DATED NOTED IS NOT AUTHORIZED. CONTRACTOR SHALL CHECK ALL CONDITIONS BEFORE PROCEEDING WITH WORK. LATEST MUNICIPAL APPROVED DRAWINGS ONLY TO BE USED DURING INSTALLATION OF HEATING SYSTEM. HVAC DESIGNS LTD. IS NOT LIABLE FOR ANY CLAIMS ARISING FROM UNAUTHORIZED USE OF THE DRAWINGS OR FROM ANY CHANGES TO ACCEPTED STANDARDS AND/OR THE ONTARIO BUILDING CODE.

Client		 375 Finley Ave. Suite 202 - Ajax, Ontario L1S 2E2 Tel. 905.619.2300 - 905.420.5300 Fax 905.619.2375 Email: info@hvacdesigns.ca Web: www.hvacdesigns.ca Specializing in Residential Mechanical Design Services Installation to comply with the latest Ontario Building Code. All supply branch outlets shall be equipped with a manual balancing damper. Ductwork which passes through the garage or unheated spaces shall be adequately insulated and be gas-proofed.	Sheet Title	
GOLD PARK HOMES			SECOND FLOOR HEATING LAYOUT	
Project Name			Date	APR/2021
PINE VALLEY DRIVE VAUGHAN, ONTARIO			Scale	3/16" = 1'-0"
END 2 - BLK 3 - OPT 4-BED 3103 2258 sqft			BCIN# 19669	
			LO#	90631