


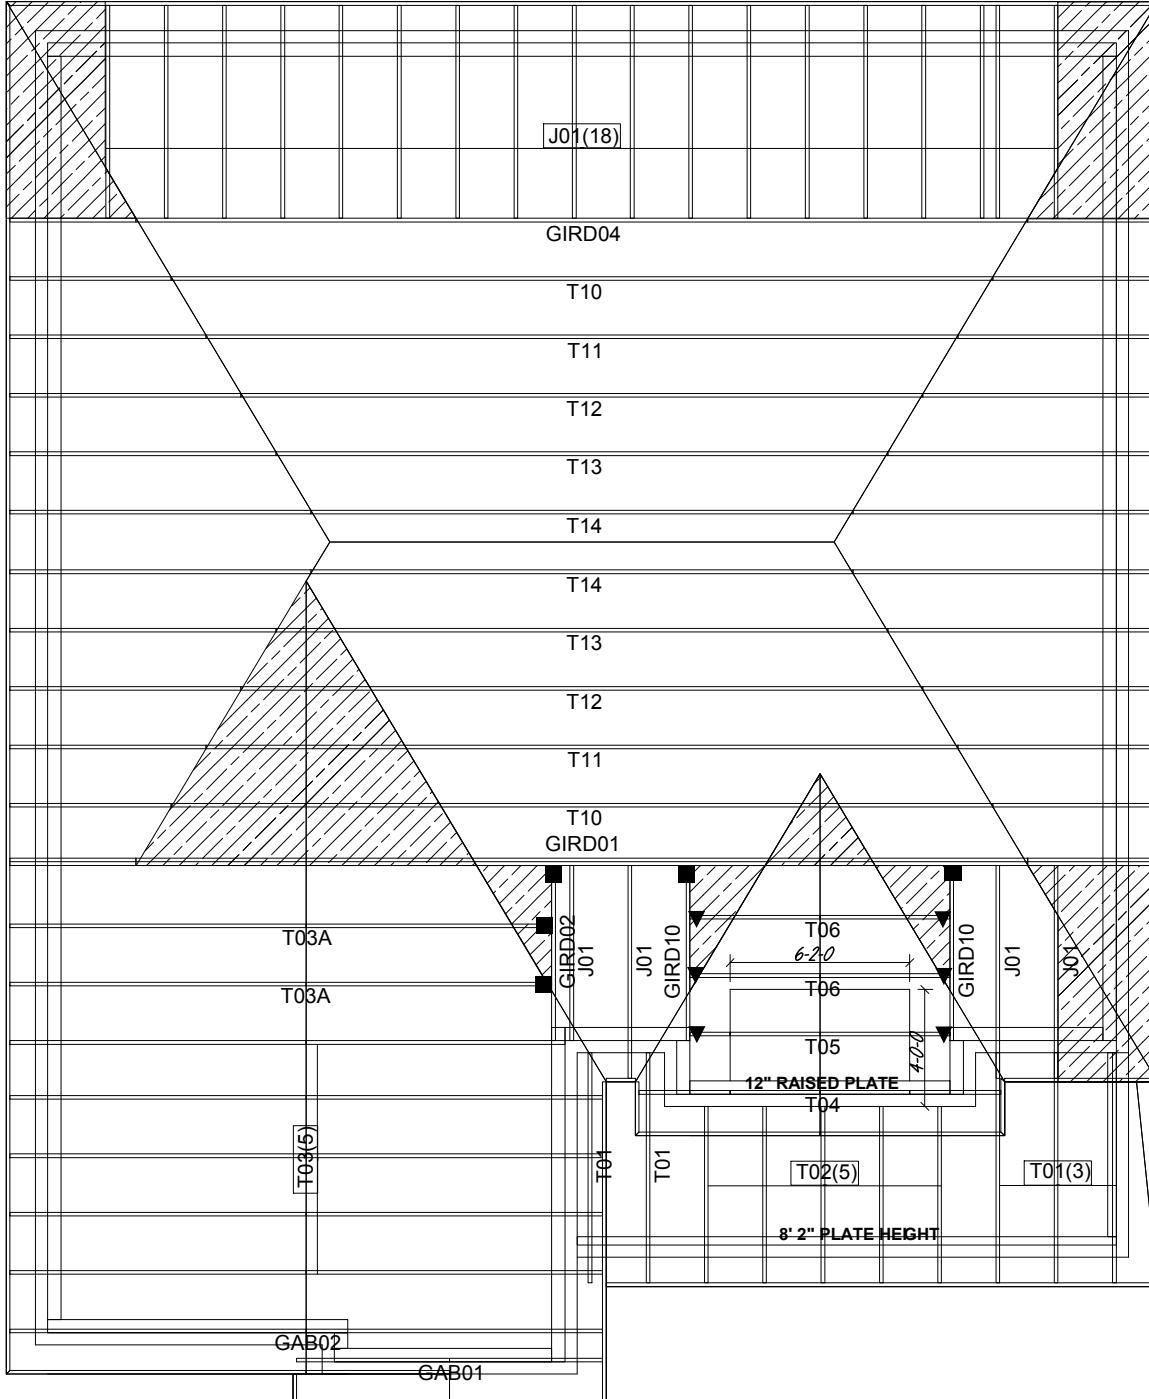

CONVENTIONAL
FRAMING BY OTHERS

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C.
ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2x4 S.P.F. @ 24\"/>

HANGER LEGEND:

▼ LUS24 ■ LJS26DS
● HGUS26 X HGUS26-2

SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

Model: JUNIPER 3 EL 3

Customer: GREENPARK

Project: LECCO RIDGE

Location: MILTON

Date: 10/24/2016 Drawn by: BB

ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.



01/29/2013


BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2017.

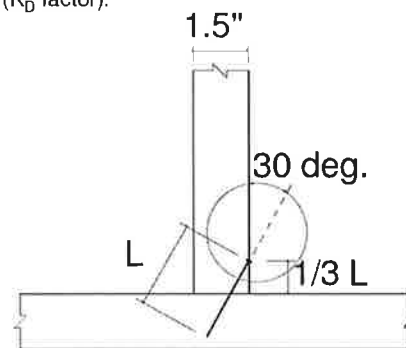

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

PEO
Certificate No. 10889485



April 24, 2015

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING





B37579H2

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.

NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2017

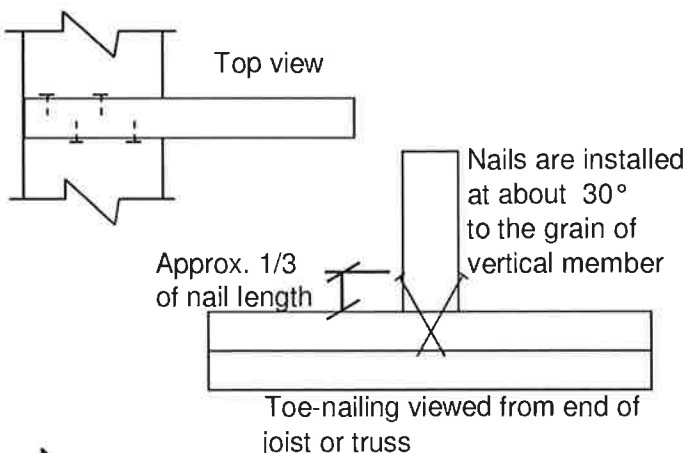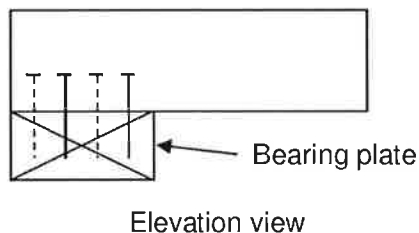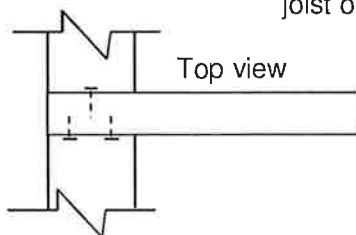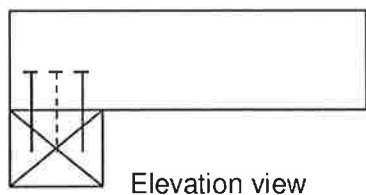Toe-nailing on 2x6 Bearing Plate**Toe-nailing on 2x4 Bearing Plate**


MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7


RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

PEO
Certificate No. 10889485



April 24, 2015

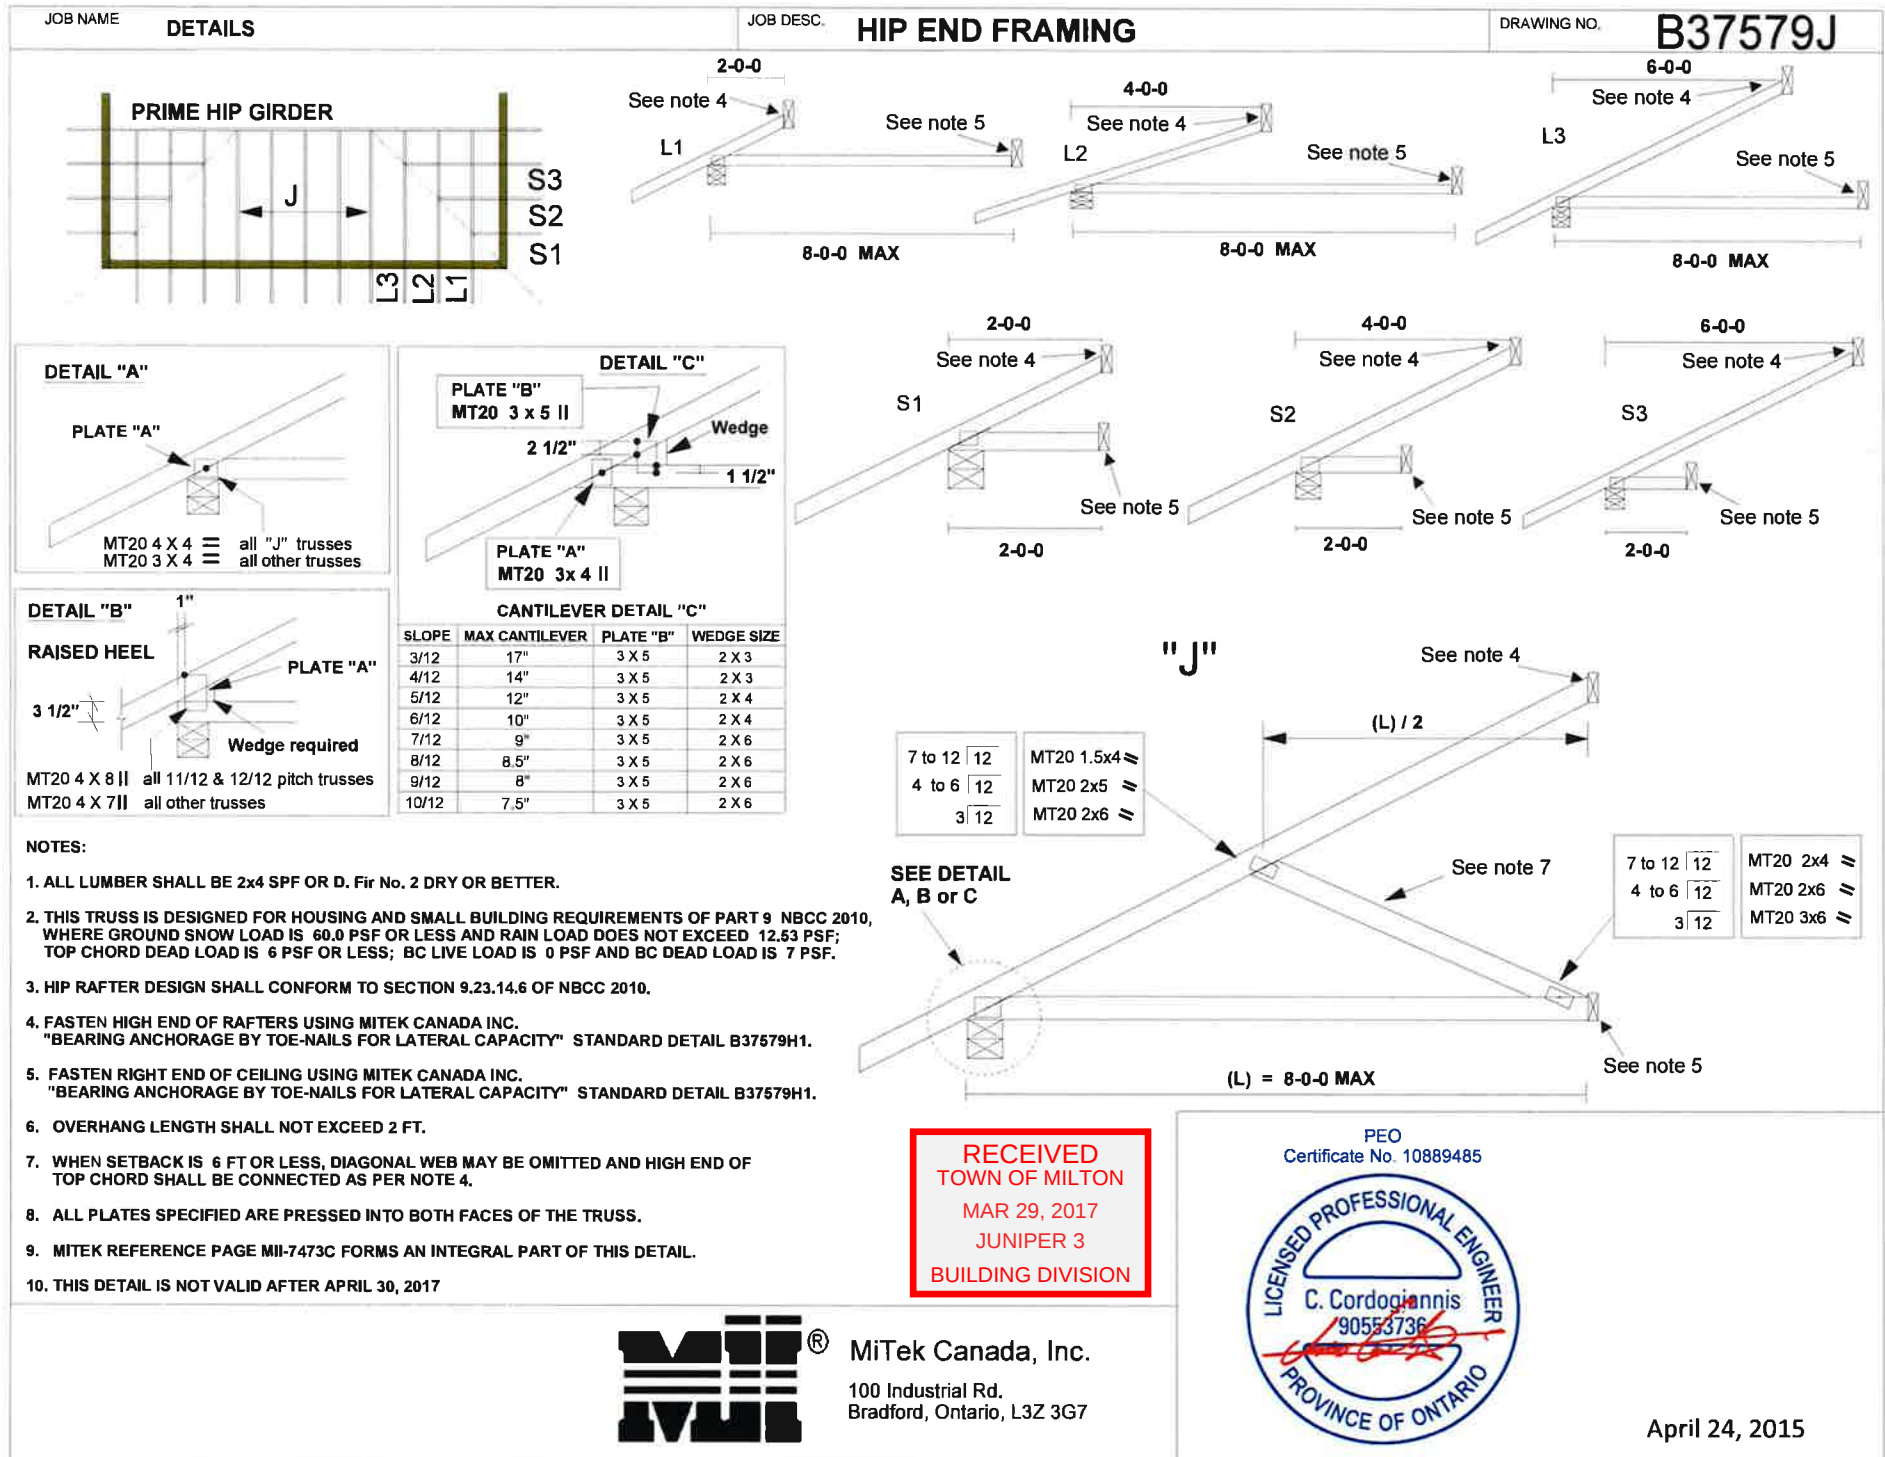

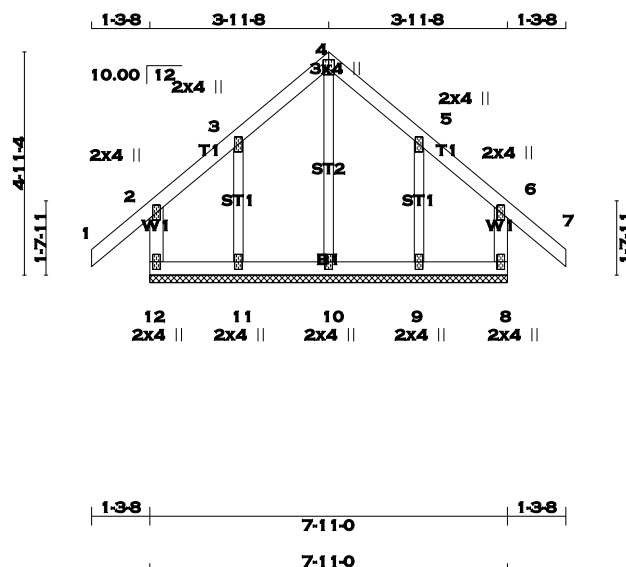

SCALE = 1:51.0

TOTAL WEIGHT = 36 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
12 - 2	2x4	DRY	No.2	SPF
1 - 4	2x4	DRY	No.2	SPF
4 - 7	2x4	DRY	No.2	SPF
8 - 6	2x4	DRY	No.2	SPF
12 - 8	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
ALL GABLE WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2-0-0 OC.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMV+p	MT20	2.0	4.0	
3	TMW+w	MT20	2.0	4.0	
4	TTW+p	MT20	3.0	4.0	2.50 1.50
5	TMW+w	MT20	2.0	4.0	
6	TMV+p	MT20	2.0	4.0	
8	BMV1+p	MT20	2.0	4.0	
9, 10, 11					
9	BMW1+w	MT20	2.0	4.0	
12	BMV1+p	MT20	2.0	4.0	
A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING			
TOTAL LOAD CASES: (4)			
CHORDS			
MEMB. MAX. FACTORED FORCE (LBS)			
VERT. LOAD LC1 MAX (PLF)			
FROM TO			
12-2	-180 / 0	0.0	0.0 0.04 (1)
1-2	0 / 34	-77.3	-77.3 0.11 (1)
2-3	-2 / 13	-77.3	-77.3 0.07 (1)
3-4	0 / 31	-77.3	-77.3 0.04 (1)
4-5	0 / 31	-77.3	-77.3 0.04 (1)
5-6	-2 / 13	-77.3	-77.3 0.07 (1)
6-7	0 / 34	-77.3	-77.3 0.11 (1)
8-6	-180 / 0	0.0	0.0 0.04 (1)
12-11	-17 / 0	-17.5	-17.5 0.02 (4)
11-10	-22 / 0	-17.5	-17.5 0.02 (4)
10-9	-22 / 0	-17.5	-17.5 0.02 (4)
9-8	-17 / 0	-17.5	-17.5 0.02 (4)
WEBS			
MEMB. MAX. FACTORED FORCE (LBS)			
UNBRAC LENGTH FR-TO			
10-4	-207 / 0	0.07	(1)
11-3	-130 / 0	0.02	(1)
9-5	-130 / 0	0.02	(1)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 23.3 PSF

DL = 3.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.0 PSF

TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.11 (1-2:1), BC=0.02 (9-10:4), WB=0.07 (4-10:1), SSI=0.06 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.28 (4) (INPUT = 0.90)

JSI METAL= 0.07 (4) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



21 MAR 2017



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

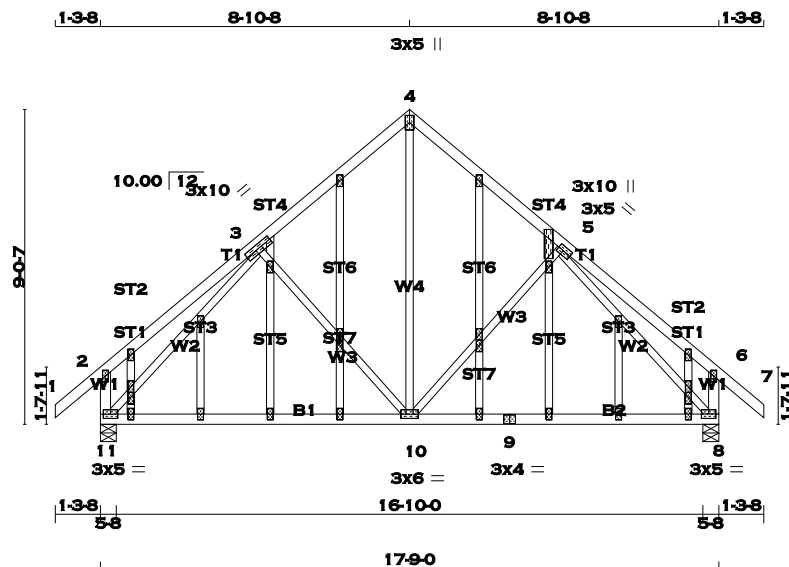

SCALE = 1:66.1

TOTAL WEIGHT = 108 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
1 - 4	2x4	DRY	No.2	SPF
4 - 7	2x4	DRY	No.2	SPF
11 - 2	2x4	DRY	No.2	SPF
8 - 6	2x4	DRY	No.2	SPF
11 - 9	2x4	DRY	No.2	SPF
9 - 8	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMV+p	MT20	2.0	4.0	
3, 3, 5, 15, 25					
3					
3, 5, 12, 13, 14, 16, 17, 18, 19, 20, 21, 22, 23, 24, 26, 27, 28, 29, 30, 31					
3	NP+w	MT20	2.0	4.0	
3	TMWWW-t	MT20	3.0	10.0	1.50 3.75
4	TTW+p	MT20	3.0	5.0	
5	TMWW-t	MT20	3.0	5.0	1.50 2.00
5	TMWW+p	MT20	3.0	10.0	5.75 1.75
6	TMV+p	MT20	2.0	4.0	
8	BMVW1-t	MT20	3.0	5.0	
9	BS-t	MT20	3.0	4.0	
10	BMWWW-t	MT20	3.0	6.0	
11	BMVW1-t	MT20	3.0	5.0	
12, 19, 24, 31					
12	NP+w	MT20	2.0	4.0	1.75 1.00

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
11		949	0	949	0	0	5-8	5-8	
8		949	0	949	0	0	5-8	5-8	

UNFACTORED REACTIONS							
		1ST LCASE	MAX./MIN. COMPONENT REACTIONS				
JT		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
11		664	478 / 0	0 / 0	0 / 0	0 / 0	186 / 0
8		664	478 / 0	0 / 0	0 / 0	0 / 0	186 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 11, 8

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS		WEBS		CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO		FR-TO		FR-TO	
1-2	0 / 34	10-4	0 / 482	1-2	0 / 34	10-4	0 / 482
2-3	0 / 26	10-5	-195 / 0	2-3	0 / 26	10-5	-195 / 0
3-4	-609 / 0	11-3	-872 / 0	3-4	-609 / 0	11-3	-872 / 0
4-5	-609 / 0	5-8	-872 / 0	4-5	-609 / 0	5-8	-872 / 0
5-6	0 / 26			5-6	0 / 26		
6-7	0 / 34			6-7	0 / 34		
11-2	-237 / 0			11-2	-237 / 0		
8-6	-237 / 0			8-6	-237 / 0		
11-10	0 / 578			11-10	0 / 578		
10-9	0 / 578			10-9	0 / 578		
9-8	0 / 578			9-8	0 / 578		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.59")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.59")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.13")

CSI: TC=0.25 (5-6:1) , BC=0.44 (10-11:4) , WB=0.69 (5-8:1) , SSI=0.13 (8-10:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (8) (INPUT = 0.90)
JSI METAL= 0.26 (5) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

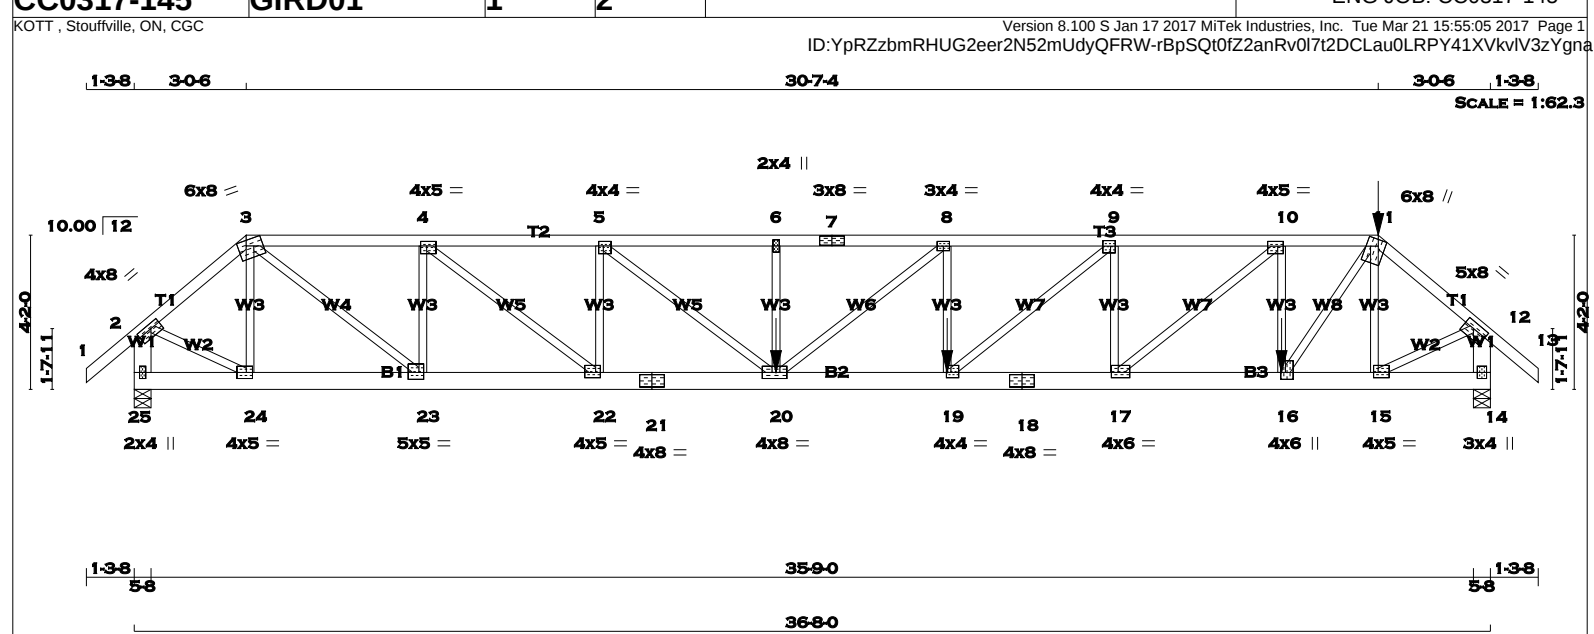

TOTAL WEIGHT = 2 X 176 = 352 lb
[M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2
3 - 7	2x4	DRY	No.2
7 - 11	2x4	DRY	No.2
11- 13	2x4	DRY	No.2
25- 2	2x6	DRY	No.2
14- 12	2x6	DRY	No.2
25- 21	2x6	DRY	No.2
21- 18	2x6	DRY	No.2
18- 14	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
1- 3	12	TOP
3- 7	12	SIDE(34.2)
7- 11	12	SIDE(34.2)
11- 13	12	SIDE(0.0)
25- 2	12	TOP
14- 12	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
25- 21	12	TOP
21- 18	12	SIDE(8.7)
18- 14	12	SIDE(8.7)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
25	3415	0	3415	0	5-8
14	4759	0	4759	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
25	2394	1689 / 0	0 / 0
14	3339	2344 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 25, 14

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.39 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS		WEBS		CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO		FROM	TO	FR-TO		FROM	TO
1-2	0 / 34	-77.3	-77.3	10.00	24-3	-875 / 0	0.11 (1)
2-3	-3393 / 0	-77.3	-77.3	4.99	3-23	0 / 4457	0.55 (1)
3-4	-6072 / 0	-77.3	-77.3	3.77	23-4	-2720 / 0	0.35 (1)
4-5	-9006 / 0	-77.3	-77.3	2.97	4-22	0 / 3747	0.46 (1)
5-6	-11347 / 0	-77.3	-77.3	2.48	22-5	-2204 / 0	0.29 (1)
6-7	-11347 / 0	-145.8	-145.8	2.39	5-20	0 / 2989	0.37 (1)
7-8	-11347 / 0	-145.8	-145.8	2.39	20-6	-513 / 0	0.07 (1)
8-9	-11291 / 0	-145.8	-145.8	2.40	20-8	0 / 72	0.01 (1)
9-10	-9292 / 0	-145.8	-145.8	2.85	19-8	-732 / 0	0.09 (1)
10-11	-6307 / 0	-145.8	-145.8	3.69	19-9	0 / 2610	0.32 (1)
11-12	-4798 / 0	-77.3	-77.3	4.29	17-9	-2347 / 0	0.30 (1)
12-13	0 / 34	-77.3	-77.3	10.00	17-10	0 / 3896	0.48 (1)
25-2	-3420 / 0	0.0	0.0	7.54	16-10	-3023 / 0	0.39 (1)
14-12	-4743 / 0	0.0	0.0	6.65	16-11	0 / 4681	0.58 (1)
25-24	0 / 0	-17.5	-17.5	10.00	15-11	-1233 / 0	0.16 (1)
24-23	0 / 2573	-17.5	-17.5	10.00	2-24	0 / 2788	0.35 (1)
23-22	0 / 6072	-17.5	-17.5	10.00	15-12	0 / 3942	0.49 (1)
22-21	0 / 9006	-17.5	-17.5	10.00			
21-20	0 / 9006	-17.5	-17.5	10.00			
20-19	0 / 11291	-33.0	-33.0	10.00			
19-18	0 / 9292	-33.0	-33.0	10.00			
18-17	0 / 9292	-33.0	-33.0	10.00			
17-16	0 / 6307	-33.0	-33.0	10.00			
16-15	0 / 3639	-33.0	-33.0	10.00			
15-14	0 / 0	-33.0	-33.0	10.00			

FACTORED CONCENTRATED LOADS (LBS)				FACE	DIR.	TYPE
JT	LOC.	LC1	MAX-	MAX+	FRONT	VERT
11	33-7-10	-176	-176	---	FRONT	VERT
16	31-0-4	-777	-777	---	FRONT	VERT
19	21-11-12	-777	-777	---	FRONT	VERT
20	17-4-4	-1339	-1339	---	FRONT	VERT

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.0 PSF
TOTAL LOAD = 33.3 PSF			

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 3-0-6
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADDTL LOADS BASED ON 55 % OF GSL.
LOADS APPLIED TO FIRST 19-3-12 OF SPAN MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.37")
ALLOWABLE DEFL.(TL)= L/360 (1.22")
CALCULATED VERT. DEFL.(TL) = L/670 (0.66")

CSI: TC=0.81 (6-8:1) , BC=0.84 (19-20:1) , WB=0.58 (11-16:1) , SSI=0.15 (6-8:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI)
MAX MIN
MT20 618 35
PLATE PLACEMENT
PLATE ROTATION



PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	4.0	8.0	1.50	3.25
3	TTWW-m	MT20	6.0	8.0	1.75	2.75
4	TMWW-t	MT20	4.0	5.0	1.50	2.00
5	TMWW-t	MT20	4.0	4.0	1.50	1.50
6	TMW+w	MT20	2.0	4.0		
7	TS-t	MT20	3.0	8.0		
8	TMWW-t	MT20	3.0	4.0		
9	TMWW-t	MT20	4.0	4.0	1.75	1.50
10	TMWW-t	MT20	4.0	5.0	1.50	1.75
11	TTWW+m	MT20	6.0	8.0	2.00	2.25
12	TMVW-t	MT20	5.0	8.0	2.00	3.25
14	BMV1+p	MT20	3.0	4.0		
15	BMWW-t	MT20	4.0	5.0	1.75	1.50
16	BMWW+t	MT20	4.0	6.0	2.25	1.50
17	BMWW-t	MT20	4.0	6.0	1.75	2.25
18	BS-t	MT20	4.0	8.0		
19	BMWW-t	MT20	4.0	4.0	1.75	1.50
20	BMWWW-t	MT20	4.0	8.0	2.00	3.25
21	BS-t	MT20	4.0	8.0		
22	BMWW-t	MT20	4.0	5.0	1.75	1.50
23	BMWW-t	MT20	5.0	5.0	2.25	1.50
24	BMWW-t	MT20	4.0	5.0	2.00	2.00
25	BMV1+p	MT20	2.0	4.0		

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 175.8 lbs FACTORED DOWN AT 33-7-10 ON TOP CHORD, AND 1339.4 lbs FACTORED DOWN AT 17-4-4, AND 776.6 lbs FACTORED DOWN AT 21-11-12, AND 776.6 lbs FACTORED DOWN AT 31-0-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




21 MAR 2017



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

JSI GRIP= 0.90 (17) (INPUT = 0.90)
JSI METAL= 0.98 (18) (INPUT = 1.00)

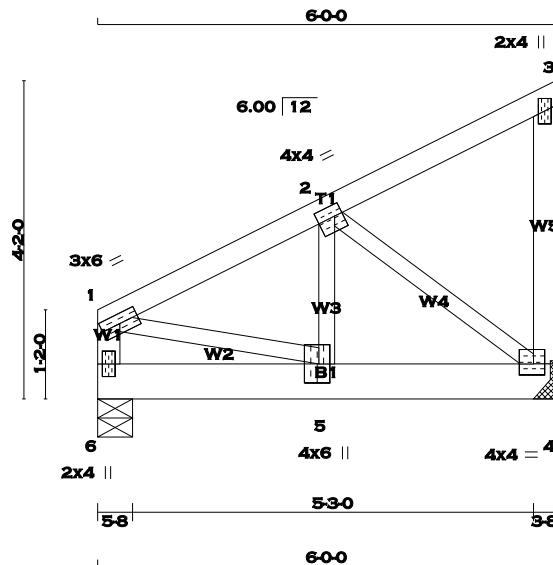

SCALE = 1:30.2

TOTAL WEIGHT = 29 lb

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	SPF	
1 - 3	2x4	DRY	No.2	SPF	
4 - 3	2x4	DRY	No.2	SPF	
6 - 1	2x4	DRY	No.2	SPF	
6 - 4	2x6	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMVW-t	MT20	3.0	6.0		
2	TMVW-t	MT20	4.0	4.0	1.75	1.25
3	TMV+p	MT20	2.0	4.0		
4	BMVW1-t	MT20	4.0	4.0	1.75	1.75
5	BMVW-t	MT20	4.0	6.0	3.00	1.75
6	BMV1+p	MT20	2.0	4.0		

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
4	1340	0	1340	0	0	HANGER BY OTHERS	MIN. SEAT SIZE: 3-8
6	1340	0	1340	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW											
4	940	658 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	282 / 0	0 / 0	282 / 0	0 / 0	0 / 0	0 / 0
6	940	658 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	282 / 0	0 / 0	282 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX. (LC)	MAX. (LC)	UNBRAC. LENGTH	MEMB.	FORCE (LBS)	MAX. (LC)	CS (LC)
FR-TO		FROM	TO			FR-TO			
1-2	-1142 / 0	-77.3	-77.3	0.11 (1)	5.80	5-2	0 / 1021	0.25 (1)	
2-3	-9 / 0	-77.3	-77.3	0.09 (1)	10.00	2-4	-1292 / 0	0.32 (1)	
4-3	-95 / 0	0.0	0.0	0.02 (1)	7.81	1-5	0 / 1063	0.26 (1)	
6-1	-876 / 0	0.0	0.0	0.10 (1)	7.81				
6-5	0 / 0	-369.2	-369.2	0.21 (1)	10.00				
5-4	0 / 1030	-369.2	-369.2	0.35 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 17-3-8
END DISTANCE = 6-0-0
END SPAN CARRIED = 17-3-8
END WALL WIDTH = 5-8
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADDTL LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.11 (1-2:1), BC=0.35 (4-5:1), WB=0.32 (2-4:1), SSI=0.43 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (1) (INPUT = 0.90)
JSI METAL= 0.39 (4) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



21 MAR 2017



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

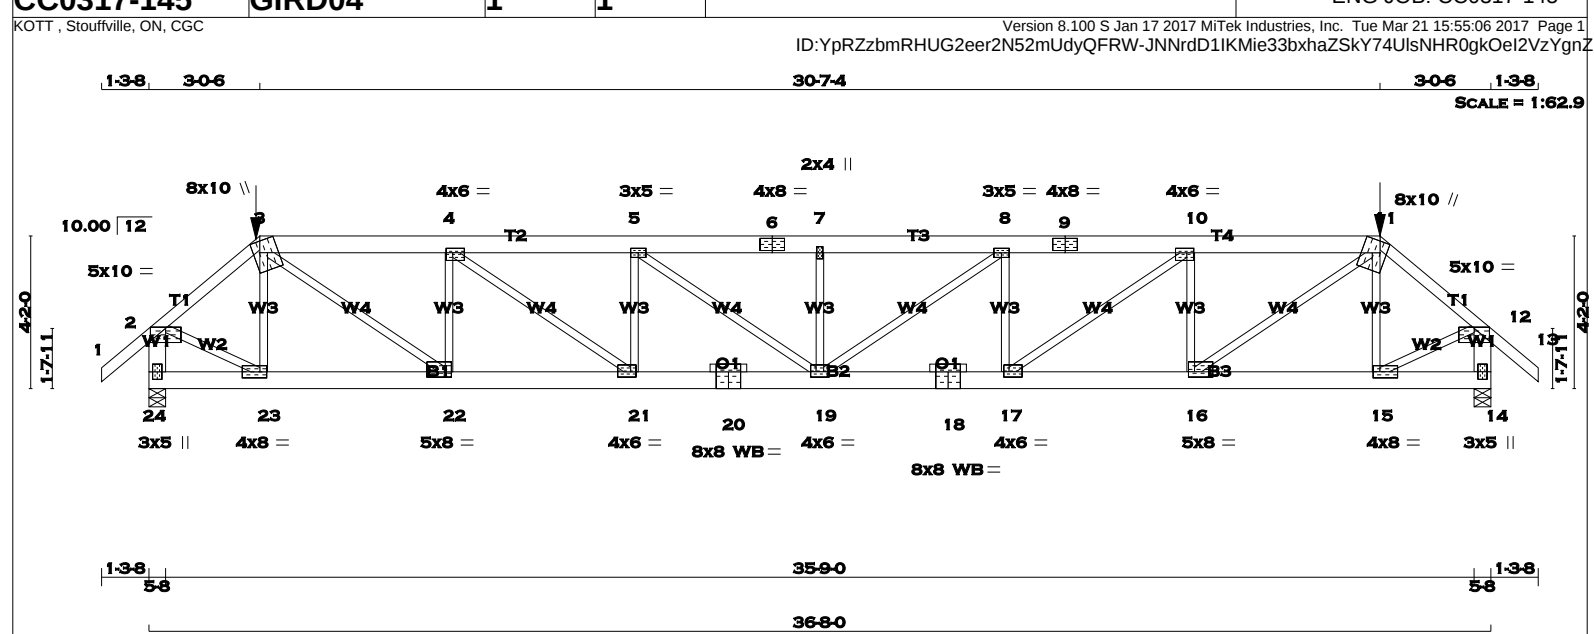

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. 1 - 3 2x4 DRY No.2 SPF 3 - 6 2x6 DRY No.2 SPF 6 - 9 2x6 DRY No.2 SPF 9 - 11 2x6 DRY No.2 SPF 11 - 13 2x4 DRY No.2 SPF 24 - 2 2x6 DRY No.2 SPF 14 - 12 2x6 DRY No.2 SPF 24 - 20 2x6 DRY 2100F 1.8E SPF 20 - 18 2x6 DRY 2100F 1.8E SPF 18 - 14 2x6 DRY 2100F 1.8E SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQRD JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX 24 3354 0 3354 0 0 5-8 5-8 14 3354 0 3354 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL 24 2352 1655 / 0 0 / 0 0 / 0 697 / 0 0 / 0 14 2352 1655 / 0 0 / 0 0 / 0 697 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 24, 14 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.56 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. LC1 (LC) UNBRAC LENGTH FR-TO FR-TO MEMB. MAX. FACTORED FORCE (LBS) MAX. LC1 (LC) 24-23 0 / 0 -33.0 -33.0 0.05 (1) 10.00 23-22 0 / 2544 -33.0 -33.0 0.19 (1) 10.00 22-21 0 / 5755 -33.0 -33.0 0.36 (1) 10.00 21-20 0 / 7589 -33.0 -33.0 0.47 (1) 10.00 20-19 0 / 7589 -33.0 -33.0 0.47 (1) 10.00 19-18 0 / 7589 -33.0 -33.0 0.47 (1) 10.00 18-17 0 / 7589 -33.0 -33.0 0.47 (1) 10.00 17-16 0 / 5755 -33.0 -33.0 0.36 (1) 10.00 16-15 0 / 2544 -33.0 -33.0 0.19 (1) 10.00 15-14 0 / 0 -33.0 -33.0 0.05 (1) 10.00 24-23 0 / 0 -33.0 -33.0 0.05 (1) 10.00 23-22 0 / 2544 -33.0 -33.0 0.19 (1) 10.00 22-21 0 / 5755 -33.0 -33.0 0.36 (1) 10.00 21-20 0 / 7589 -33.0 -33.0 0.47 (1) 10.00 20-19 0 / 7589 -33.0 -33.0 0.47 (1) 10.00 19-18 0 / 7589 -33.0 -33.0 0.47 (1) 10.00 18-17 0 / 7589 -33.0 -33.0 0.47 (1) 10.00 17-16 0 / 5755 -33.0 -33.0 0.36 (1) 10.00 16-15 0 / 2544 -33.0 -33.0 0.19 (1) 10.00 15-14 0 / 0 -33.0 -33.0 0.05 (1) 10.00 FACTORED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE 3 3-0-6 -176 -176 --- FRONT VERT TOTAL 11 33-7-10 -176 -176 --- FRONT VERT TOTAL				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 GIRDER TYPE: CPrimeHip SIDE SETBACK = 3-0-6 END SETBACK = 6-0-0 END WALL WIDTH = 5-8 CORNER FRAMING TYPE: CONVENTIONAL END JACK TYPE: CONVENTIONAL APPLIED TO FRONT SIDE - ADDT'L LOADS BASED ON 55 % OF GSL. THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012 , CBC 2012 , ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (1.22") CALCULATED VERT. DEFL.(LL) = L/999 (0.42") ALLOWABLE DEFL.(TL)= L/360 (1.22") CALCULATED VERT. DEFL.(TL) = L/594 (0.74") CSI: TC=0.70 (5-7:1) , BC=0.47 (19-21:1) , WB=0.98 (3-22:1) , SSI=0.29 (3-4:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.90 (17) (INPUT = 0.90) JSI METAL= 0.93 (20) (INPUT = 1.00) RECEIVED TOWN OF MILTON MAR 29, 2017 JUNIPER 3 BUILDING DIVISION			
---	--	--	--	---	--	--	--	---	--	--	--



HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 175.8 lbs FACTORED DOWN AT 33-7-10, AND 175.8 lbs FACTORED DOWN AT 3-0-6 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.


READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



21 MAR 2017




RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION



[M]

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

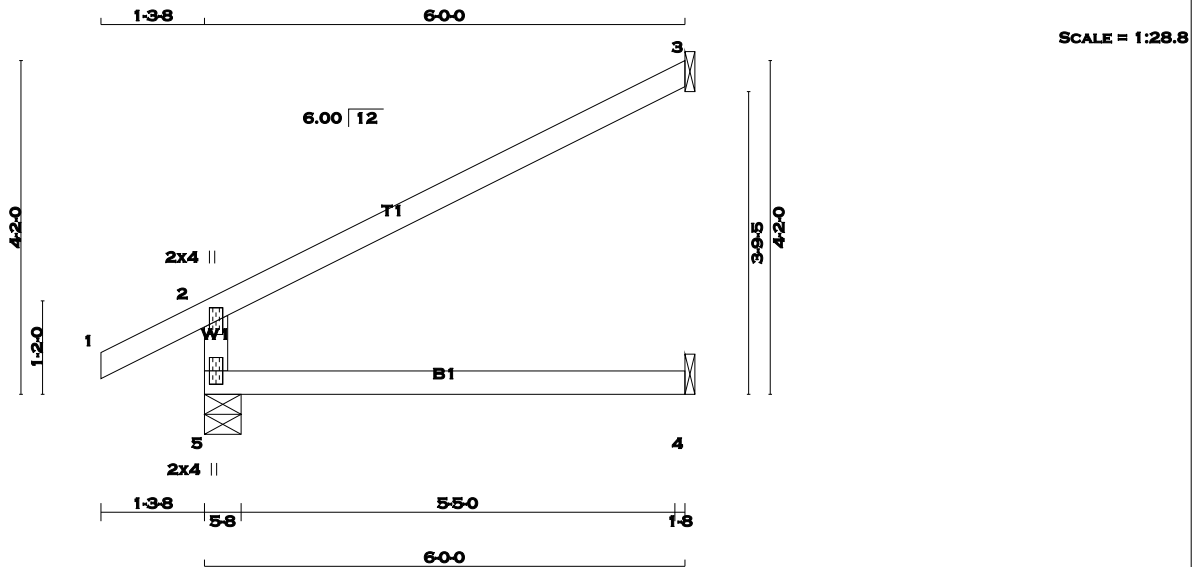

TOTAL WEIGHT = 22 X 17 = 376 lb [M]

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
5 - 2	2x4	DRY	No.2		SPF
1 - 3	2x4	DRY	No.2		SPF
5 - 4	2x4	DRY	No.2		SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
5	457	0	457	0	5-8	5-8
3	174	0	174	0	1-8	1-8
4	43	0	49	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3 , 4

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.	LIVE		
5	318	238 / 0	0 / 0	0 / 0	0 / 0	80 / 0	0 / 0
3	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
4	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED
	MAX. FACTORED	FORCE	VERT. LOAD	LC1 MAX	MAX. UNBRAC	MEMB. FORCE	MAX
	(LBS)	(LBS)	(PLF)	CSI (LC)	LENGTH	(LBS)	CSI (LC)
FR-TO			FROM TO				
5-2	-395 / 0	0.0	0.0	0.13 (4)	7.81		
1-2	0 / 23	-77.3	-77.3	0.10 (1)	10.00		
2-3	-26 / 0	-77.3	-77.3	0.47 (1)	6.25		
5-4	0 / 0	-17.5	-17.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.47 (2-3:1) , BC=0.13 (4-5:4) , WB=0.00 (n/a:0) , SSI=0.20 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (2) (INPUT = 0.90)
JSI METAL= 0.09 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




21 MAR 2017



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

Version 8.100 S Jan 17 2017 MiTek Industries, Inc. Tue Mar 21 15:55:07 2017 Page 1
ID:YpRZzbmRHUG2eer2N52mUdyQFRW-naxDrZ2w5grVgDA7FI4hHmgMc8E_07aqy2OsaxzYgnY

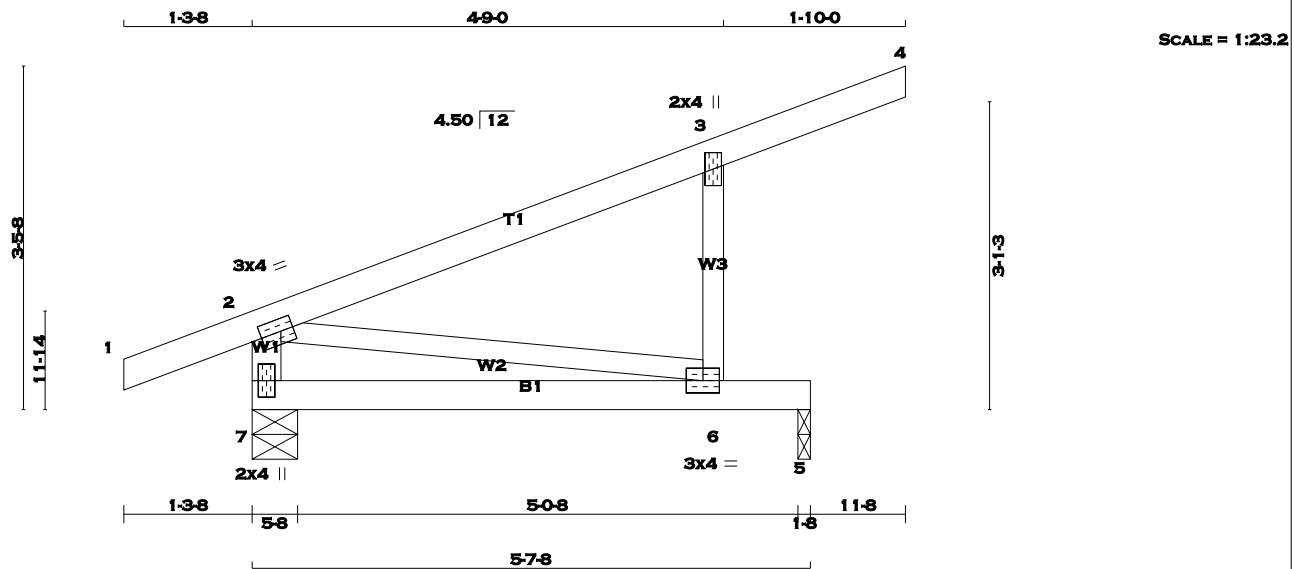

TOTAL WEIGHT = 5 X 22 = 110 lb [M]

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
1 - 4	2x4	DRY	No.2	SPF	
6 - 3	2x3	DRY	No.2	SPF	
7 - 2	2x4	DRY	No.2	SPF	
7 - 5	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2				SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	4.0	1.50	1.50
3	TMV+p	MT20	2.0	4.0		
6	BMVW-t	MT20	3.0	4.0		
7	BMV1+p	MT20	2.0	4.0		

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
7	388	0	388	0	0	5-8	5-8		
5	327	0	327	0	0	1-8	1-8		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	1ST LCASE	MAX/MIN. COMPONENT REACTIONS
7	270	204 / 0	0 / 0	0 / 0
5	228	167 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 7, 5

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	UNBRACED LENGTH
FR-TO		FROM TO		FR-TO			
1-2	0 / 18	-77.3 -77.3	0.10 (1)	10.00	2-6	0 / 0	0.00 (1)
2-3	0 / 0	-77.3 -77.3	0.30 (1)	10.00			
3-4	-26 / 0	-77.3 -77.3	0.19 (1)	6.25			
6-3	-329 / 0	0.0 0.0	0.06 (1)	7.81			
7-2	-288 / 0	0.0 0.0	0.03 (1)	7.81			
7-6	0 / 0	-17.5 -17.5	0.38 (1)	10.00			
6-5	0 / 0	-17.5 -17.5	0.38 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 850 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 427 (0.16")

CSI: TC=0.30 (2-3:1), BC=0.38 (6-7:1), WB=0.00 (2-6:1), SSI=0.26 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.33 (6) (INPUT = 0.90)
JSI METAL= 0.06 (3) (INPUT = 1.00)


READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



21 MAR 2017



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION



A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
1-2	0 / 18	-77.3	-77.3	0.10 (1)	10.00	0 / 0	0.00 (1)
2-3	0 / 0	-77.3	-77.3	0.30 (1)	10.00		
5-3	-184 / 0	0.0	0.0	0.04 (1)	7.81		
6-2	-288 / 0	0.0	0.0	0.03 (1)	7.81		
6-5	0 / 0	-17.5	-17.5	0.24 (1)	10.00		
5-4	0 / 0	-17.5	-17.5	0.23 (1)	10.00		

JSI GRIP= 0.27 (2) (INPUT = 0.90)
JSI METAL= 0.05 (6) (INPUT = 1.00)

21 MAR 2017



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

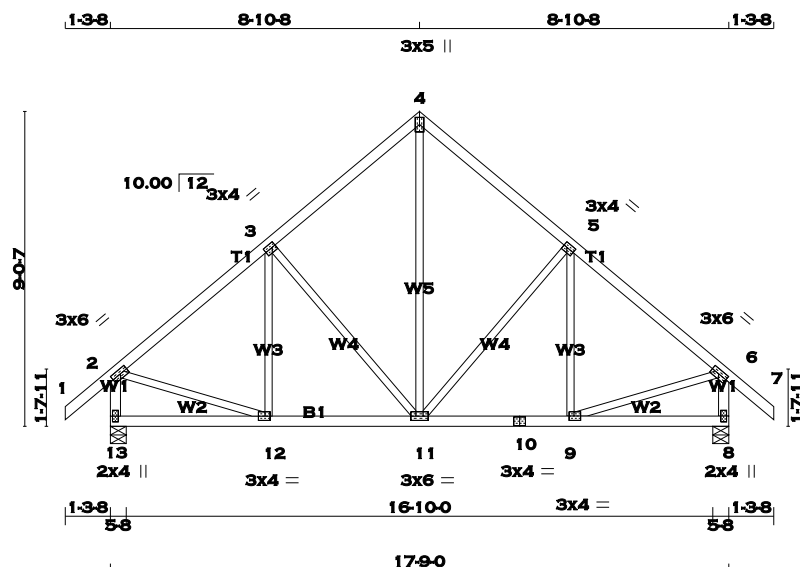

TOTAL WEIGHT = 5 X 86 = 429 lb
[M][F]

<u>LUMBER</u>				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR
1 - 4	2x4	DRY	No.2	SPF
4 - 7	2x4	DRY	No.2	SPF
13- 2	2x4	DRY	No.2	SPF
8 - 6	2x4	DRY	No.2	SPF
13- 10	2x4	DRY	No.2	SPF
10- 8	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMWW-t	MT20	3.0	6.0	1.50	2.75
3	TMWW-t	MT20	3.0	4.0	1.50	1.25
4	TTW+p	MT20	3.0	5.0		
5	TMWW-t	MT20	3.0	4.0	1.50	1.25
6	TMWW-t	MT20	3.0	6.0	1.50	2.75
8	BMV1+p	MT20	2.0	4.0		
9	BMWW-t	MT20	3.0	4.0	1.50	1.75
10	BS-t	MT20	3.0	4.0		
11	BMWW-t	MT20	3.0	6.0		
12	BMWW-t	MT20	3.0	4.0	1.50	1.75
13	BMV1+p	MT20	2.0	4.0		

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
13		949	0	949	0	0	5-8	5-8	
8		949	0	949	0	0	5-8	5-8	

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
13	664	478 / 0	0 / 0	0 / 0	0 / 0	186 / 0	0 / 0
8	664	478 / 0	0 / 0	0 / 0	0 / 0	186 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 13, 8

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS		WEBS		FACTORED		FACTORED	
MEMB.	MAX. FORCE (LBS)	MEMB.	MAX. FORCE (LBS)	MAX. VERT. LOAD (LBS)	MAX. HORIZ. LOAD (LBS)	MAX. VERT. LOAD (LBS)	MAX. HORIZ. LOAD (LBS)
FR-TO		FR-TO		FROM	TO	FROM	TO
1-2	0 / 34	11-4	0 / 469	-77.3	-77.3 0.11 (1)	10.00	11-4
2-3	-756 / 0	11-5	-260 / 0	-77.3	-77.3 0.20 (1)	6.25	11-5
3-4	-589 / 0	9-5	-87 / 48	-77.3	-77.3 0.20 (1)	6.25	9-5
4-5	-589 / 0	3-11	-260 / 0	-77.3	-77.3 0.20 (1)	6.25	3-11
5-6	-756 / 0	12-3	-87 / 48	-77.3	-77.3 0.20 (1)	6.25	12-3
6-7	0 / 34	2-12	0 / 625	-77.3	-77.3 0.11 (1)	10.00	2-12
13-2	-916 / 0	9-6	0 / 625	0.0	0.0 0.10 (1)	7.81	9-6
8-6	-916 / 0			0.0	0.0 0.10 (1)	7.81	
13-12	0 / 0			-17.5	-17.5 0.08 (4)	10.00	
12-11	0 / 601			-17.5	-17.5 0.14 (1)	10.00	
11-10	0 / 601			-17.5	-17.5 0.14 (1)	10.00	
10-9	0 / 601			-17.5	-17.5 0.14 (1)	10.00	
9-8	0 / 0			-17.5	-17.5 0.08 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.59")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.59")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.20 (5-6:1) , BC=0.14 (9-11:1) , WB=0.21 (5-11:1) , SSI=0.13 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (9) (INPUT = 0.90)
JSI METAL= 0.23 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



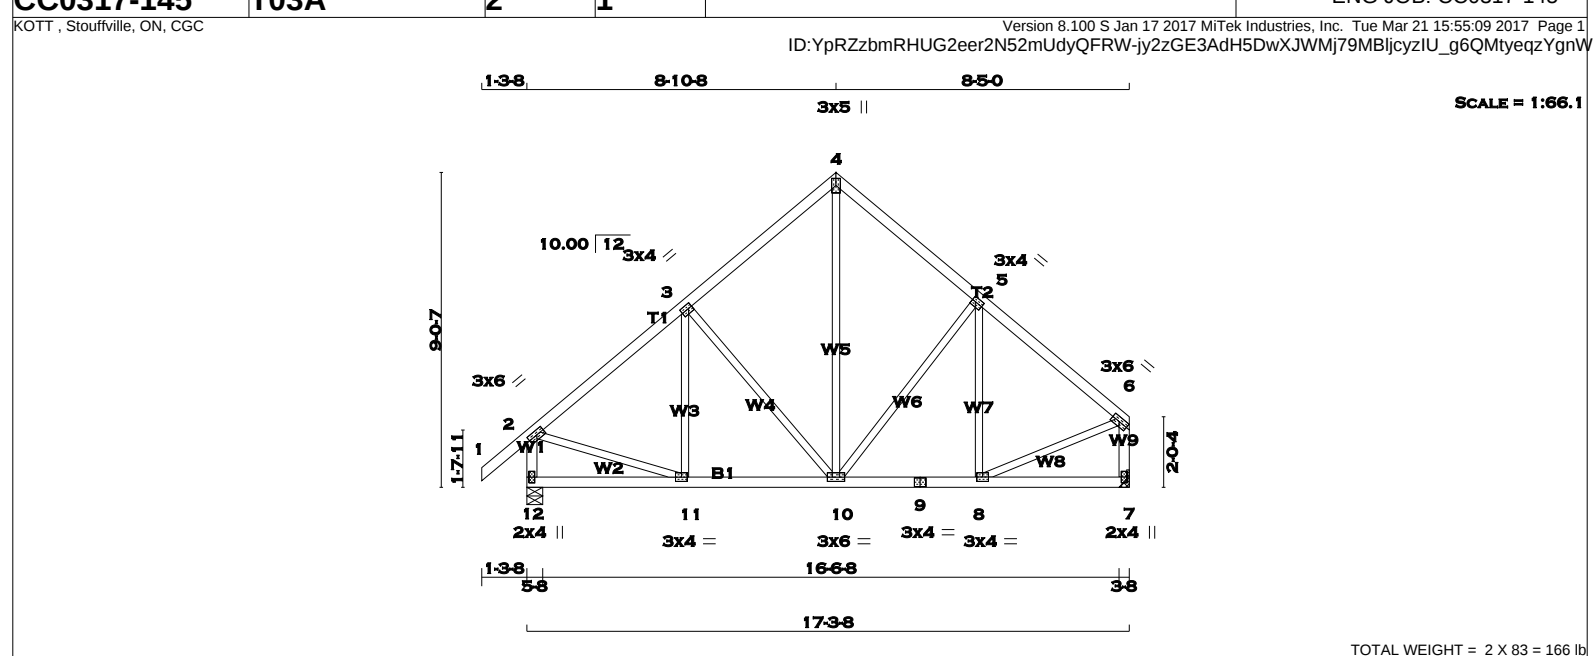

TOTAL WEIGHT = 2 X 83 = 166 lb [M][F]

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
1 - 4	2x4	DRY	No.2		SPF
4 - 6	2x4	DRY	No.2		SPF
12 - 2	2x4	DRY	No.2		SPF
7 - 6	2x4	DRY	No.2		SPF
12 - 9	2x4	DRY	No.2		SPF
9 - 7	2x4	DRY	No.2		SPF
ALL WEBS EXCEPT	2x3	DRY	No.2		SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	6.0	1.50	2.75
3	TMVW-t	MT20	3.0	4.0	1.50	1.25
4	TTW+p	MT20	3.0	5.0		
5	TMVW-t	MT20	3.0	4.0	1.50	1.25
6	TMVW-t	MT20	3.0	6.0	1.50	2.75
7	BMV1+p	MT20	2.0	4.0		
8	BMVW-t	MT20	3.0	4.0		
9	BS-t	MT20	3.0	4.0		
10	BMVW-t	MT20	3.0	6.0		
11	BMVW-t	MT20	3.0	4.0		
12	BMV1+p	MT20	2.0	4.0		

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
12	927	0	927	0	0
7	820	0	820	0	0

HANGER BY OTHERS
MIN. SEAT SIZE: 3-8

UNFACTORED REACTIONS							
JT	1ST LCASE	MAX./MIN.	SNOW	LIVE	PERM.LIVE	WIND	DEAD
12	648	467 / 0	0 / 0	0 / 0	0 / 0	0 / 0	181 / 0
7	576	403 / 0	0 / 0	0 / 0	0 / 0	0 / 0	173 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 12

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LC)	
FR-TO		FROM	TO	FR-TO			
1-2	0 / 34	-77.3	-77.3 0.11 (1)	10.00	11-3	-81 / 50	0.04 (1)
2-3	-731 / 0	-77.3	-77.3 0.20 (1)	6.25	3-10	-265 / 0	0.22 (1)
3-4	-560 / 0	-77.3	-77.3 0.20 (1)	6.25	10-4	0 / 438	0.10 (1)
4-5	-559 / 0	-77.3	-77.3 0.18 (1)	6.25	10-5	-211 / 0	0.17 (1)
5-6	-677 / 0	-77.3	-77.3 0.18 (1)	6.25	8-5	-129 / 31	0.06 (1)
12-2	-894 / 0	0.0	0.0 0.10 (1)	7.81	2-11	0 / 605	0.14 (1)
7-6	-789 / 0	0.0	0.0 0.09 (1)	7.81	8-6	0 / 579	0.13 (1)
12-11	0 / 0	-17.5	-17.5 0.08 (4)	10.00			
11-10	0 / 581	-17.5	-17.5 0.13 (1)	10.00			
10-9	0 / 539	-17.5	-17.5 0.12 (1)	10.00			
9-8	0 / 539	-17.5	-17.5 0.12 (1)	10.00			
8-7	0 / 0	-17.5	-17.5 0.07 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:		
TOP CH.	LL =	23.3 PSF
	DL =	3.0 PSF
BOT CH.	LL =	0.0 PSF
	DL =	7.0 PSF
TOTAL LOAD	=	33.3 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.58")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.58")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.20 (2-3:1) , BC=0.13 (10-11:1) , WB=0.22 (3-10:1) , SS=0.13 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1667	822	2284


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (11) (INPUT = 0.90)
JSI METAL= 0.23 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



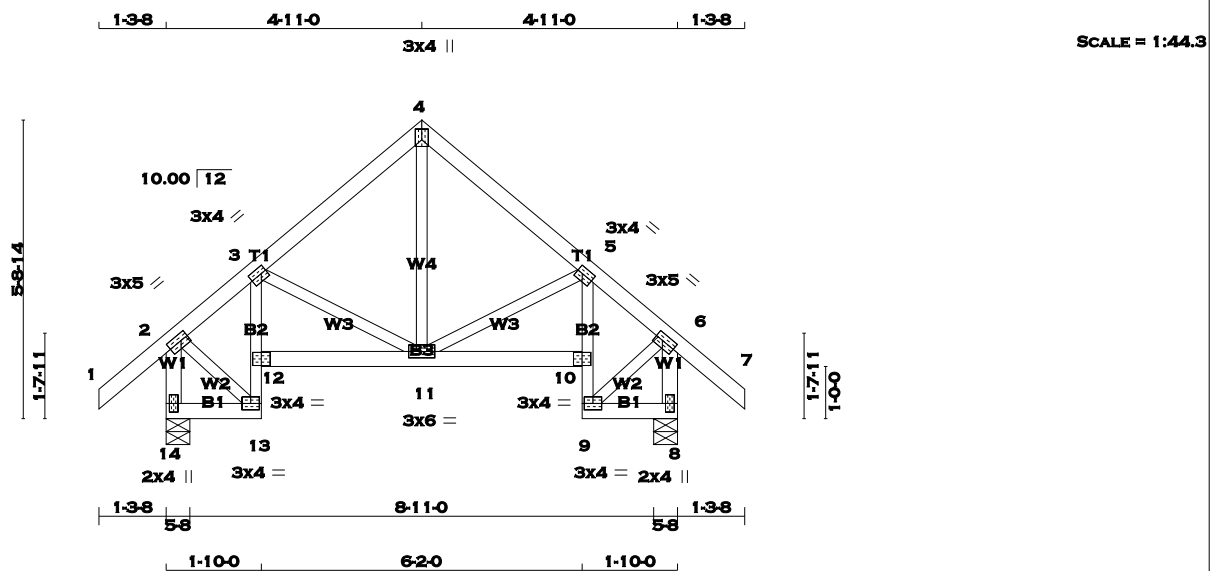

TOTAL WEIGHT = 49 lb [M]

LUMBER					DESCR.
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
1 - 4	2x4	DRY	No.2		SPF
4 - 7	2x4	DRY	No.2		SPF
14 - 2	2x4	DRY	No.2		SPF
8 - 6	2x4	DRY	No.2		SPF
14 - 13	2x4	DRY	No.2		SPF
13 - 3	2x3	DRY	No.2		SPF
12 - 10	2x4	DRY	No.2		SPF
9 - 5	2x3	DRY	No.2		SPF
9 - 8	2x4	DRY	No.2		SPF
ALL WEBS EXCEPT	2x3	DRY	No.2		SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMVW-t	MT20	3.0	5.0	1.50 1.75
3	TMVW-t	MT20	3.0	4.0	1.50 1.25
4	TTW+p	MT20	3.0	4.0	2.50 1.50
5	TMVW-t	MT20	3.0	4.0	1.50 1.25
6	TMVW-t	MT20	3.0	5.0	1.50 1.75
8	BMV1+p	MT20	2.0	4.0	
9	BMVW-t	MT20	3.0	4.0	
10	BVM-I	MT20	3.0	4.0	
11	BMVWW-t	MT20	3.0	6.0	
12	BVM-I	MT20	3.0	4.0	
13	BMVW-t	MT20	3.0	4.0	
14	BMV1+p	MT20	2.0	4.0	

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	HORZ	BRG	IN-SX	BRG	IN-SX
14	573	0	573	0	0	5-8	5-8	5-8	5-8
8	573	0	573	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS							
JT	1ST LCASE	MAX/MIN.	COMPONENT	REACTIONS			
14	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
8	400	293 / 0	0 / 0	0 / 0	0 / 0	107 / 0	0 / 0
8	400	293 / 0	0 / 0	0 / 0	0 / 0	107 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 14, 8

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS		WEBS		CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
1-2	0 / 34	-77.3 -77.3	0.11 (1)	10.00	11-4	0 / 146	0.03 (1)
2-3	-304 / 0	-77.3 -77.3	0.10 (1)	6.25	11-5	-82 / 0	0.02 (1)
3-4	-316 / 0	-77.3 -77.3	0.16 (1)	6.25	3-11	-82 / 0	0.02 (1)
4-5	-316 / 0	-77.3 -77.3	0.16 (1)	6.25	2-13	0 / 254	0.06 (1)
5-6	-304 / 0	-77.3 -77.3	0.10 (1)	6.25	9-6	0 / 254	0.06 (1)
6-7	0 / 34	-77.3 -77.3	0.11 (1)	10.00			
14-2	-558 / 0	0.0 0.0	0.06 (1)	7.81			
8-6	-558 / 0	0.0 0.0	0.06 (1)	7.81			
14-13	0 / 0	-17.5 -17.5	0.02 (4)	10.00			
13-12	-138 / 0	0.0 0.0	0.54 (1)	7.81			
12-3	-116 / 0	0.0 0.0	0.54 (1)	7.81			
12-11	0 / 319	-17.5 -17.5	0.08 (1)	10.00			
11-10	0 / 319	-17.5 -17.5	0.08 (1)	10.00			
9-10	-138 / 0	0.0 0.0	0.54 (1)	7.81			
10-5	-116 / 0	0.0 0.0	0.54 (1)	7.81			
9-8	0 / 0	-17.5 -17.5	0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.33")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.33")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.07")

CSI: TC=0.16 (3-4:1) , BC=0.54 (3-12:1) , WB=0.06 (2-13:1) , SSI=0.22 (12-13:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.55 (13) (INPUT = 0.90)
JSI METAL= 0.12 (6) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



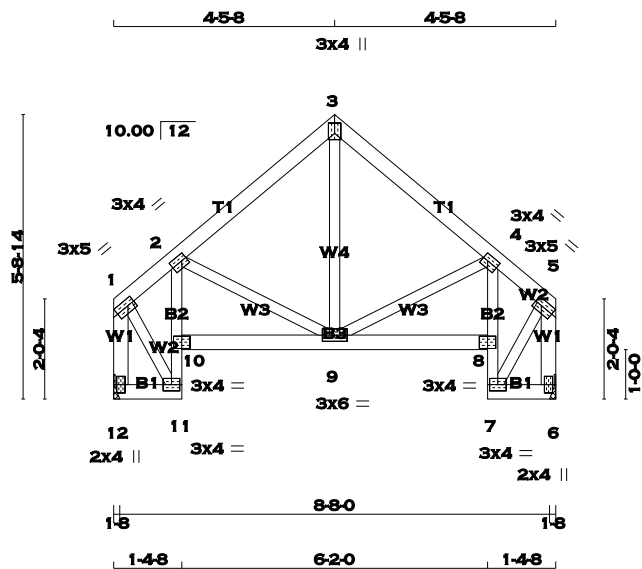

SCALE = 1:46.5

TOTAL WEIGHT = 43 lb [M]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
1 - 3	2x4	DRY	No.2	SPF
3 - 5	2x4	DRY	No.2	SPF
12- 1	2x4	DRY	No.2	SPF
6 - 5	2x4	DRY	No.2	SPF
12- 11	2x4	DRY	No.2	SPF
11- 2	2x3	DRY	No.2	SPF
10- 8	2x4	DRY	No.2	SPF
7 - 4	2x3	DRY	No.2	SPF
7 - 6	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
1	TMVW-t	MT20	3.0	5.0	1.50 1.75
2	TMVW-t	MT20	3.0	4.0	1.50 1.25
3	TTW+p	MT20	3.0	4.0	2.50 1.50
4	TMVW-t	MT20	3.0	4.0	1.50 1.25
5	TMVW-t	MT20	3.0	5.0	1.50 1.75
6	BMV1+p	MT20	2.0	4.0	
7	BMVW-t	MT20	3.0	4.0	
8	BVM-I	MT20	3.0	4.0	
9	BMVWW-t	MT20	3.0	6.0	
10	BVM-I	MT20	3.0	4.0	
11	BMVW-t	MT20	3.0	4.0	
12	BMV1+p	MT20	2.0	4.0	
A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER					
BEARINGS					
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ	
12	423	0	423	0	0
6	423	0	423	0	0
INPUT BRG IN-SX HANGER BY OTHERS MIN. SEAT SIZE: 1-8					

UNFACTORED REACTIONS							
1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
12	297	208 / 0	0 / 0	0 / 0	0 / 0	89 / 0	0 / 0
6	297	208 / 0	0 / 0	0 / 0	0 / 0	89 / 0	0 / 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS		MEMB.		WEBS		MEMB.	
MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED
FORCE (LBS)	VERT. LOAD (PLF)	FORCE (LBS)	VERT. LOAD (PLF)	FORCE (LBS)	VERT. LOAD (PLF)	FORCE (LBS)	VERT. LOAD (PLF)
FR-TO	FROM TO	FR-TO	FROM TO	FR-TO	FROM TO	FR-TO	FROM TO
1-2	-219 / 0	-77.3	-77.3 0.03 (4)	6.25	9-3	0 / 111	0.03 (4)
2-3	-282 / 0	-77.3	-77.3 0.14 (1)	6.25	9-4	-45 / 0	0.01 (1)
3-4	-282 / 0	-77.3	-77.3 0.14 (1)	6.25	2-9	-45 / 0	0.01 (1)
4-5	-219 / 0	-77.3	-77.3 0.03 (4)	6.25	1-11	0 / 273	0.06 (1)
12-1	-412 / 0	0.0	0.0 0.05 (1)	7.81	7-5	0 / 273	0.06 (1)
6-5	-412 / 0	0.0	0.0 0.05 (1)	7.81			
12-11	0 / 0	-17.5	-17.5 0.01 (4)	10.00			
11-10	-207 / 0	0.0	0.0 0.44 (1)	7.81			
10-2	-185 / 0	0.0	0.0 0.44 (1)	7.81			
10-9	0 / 258	-17.5	-17.5 0.07 (1)	10.00			
9-8	0 / 258	-17.5	-17.5 0.07 (1)	10.00			
7-8	-207 / 0	0.0	0.0 0.44 (1)	7.81			
8-4	-185 / 0	0.0	0.0 0.44 (1)	7.81			
7-6	0 / 0	-17.5	-17.5 0.01 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.30")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.30")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.05")

CSI: TC=0.14 (2-3:1) , BC=0.44 (2-10:1) , WB=0.06 (1-11:1) , SSI=0.18 (10-11:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.63 (1) (INPUT = 0.90)
JSI METAL= 0.09 (5) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

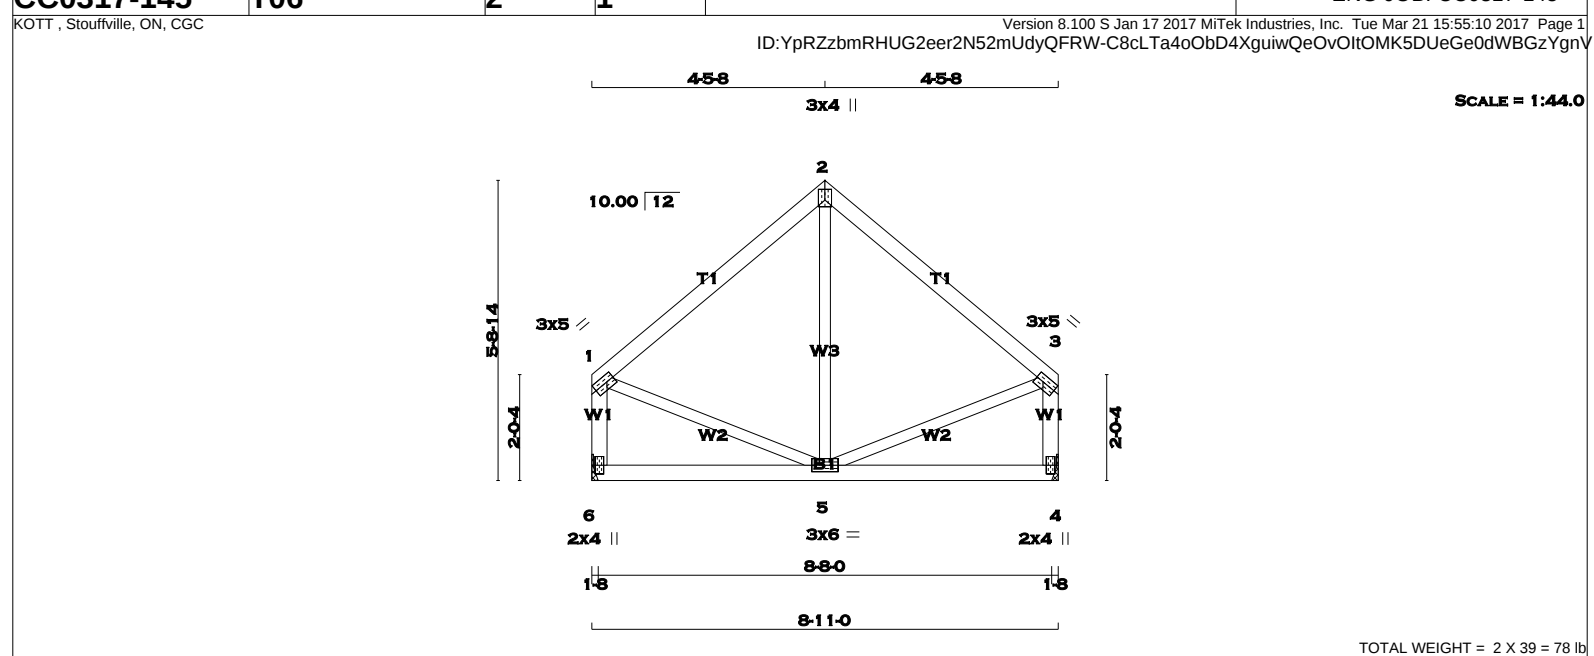

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

LUMBER

DESCR.

1 - 2

2x4

DRY

No.2

SPF

2 - 3

2x4

DRY

No.2

SPF

6 - 1

2x4

DRY

No.2

SPF

4 - 3

2x4

DRY

No.2

SPF

6 - 4

2x4

DRY

No.2

SPF

ALL WEBS

2x3

DRY

No.2

SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT

TYPE

PLATES

W

LEN

Y

X

1

TMVW-t

MT20

3.0

5.0

1.50

1.75

2

TTW+p

MT20

3.0

4.0

2.50

1.50

3

TMVW-t

MT20

3.0

5.0

1.50

1.75

4

BMV1+p

MT20

2.0

4.0

5

BMWWW-t

MT20

3.0

6.0

6

BMV1+p

MT20

2.0

4.0

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

LICENSED PROFESSIONAL ENGINEER

C.G. CARSON

100076892

PROVINCE OF ONTARIO

21 MAR 2017

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED

GROSS REACTION

MAXIMUM FACTORED

INPUT

REQRD

JT

VERT

HORZ

DOWN

HORZ

UPLIFT

IN-SX

IN-SX

6

423

0

423

0

0

HANGER BY OTHERS

MIN. SEAT SIZE: 1-8

4

423

0

423

0

0

HANGER BY OTHERS

MIN. SEAT SIZE: 1-8

UNFACTORED REACTIONS

1ST LCASE

MAX./MIN. COMPONENT REACTIONS

JT

COMBINED

SNOW

LIVE

PERM.LIVE

WIND

DEAD

SOIL

6

297

208 / 0

0 / 0

0 / 0

0 / 0

89 / 0

0 / 0

4

297

208 / 0

0 / 0

0 / 0

0 / 0

89 / 0

0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

WEBS

MAX. FACTORED

FACTORED

MEMB.

FORCE

VERT. LOAD

LC1

MAX

UNBRAC

LENGTH

FR-TO

FORCE

(LBS)

(PLF)

CSI (LC)

UNBRAC

LENGTH

FR-TO

FORCE

(LBS)

MAX

CSI (LC)

FROM

TO

1-2

-237 / 0

-77.3

-77.3

0.20 (1)

6.25

5-2

-42 / 63

0.02 (4)

2-3

-237 / 0

-77.3

-77.3

0.20 (1)

6.25

1-5

0 / 195

0.04 (1)

6-1

-393 / 0

0.0

0.0

0.05 (1)

7.81

5-3

0 / 195

0.04 (1)

4-3

-393 / 0

0.0

0.0

0.05 (1)

7.81

6-5

0 / 0

-17.5

-17.5

0.10 (4)

10.00

5-4

0 / 0

-17.5

-17.5

0.10 (4)

10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP

CH.

LL

=

23.3

PSF

DL

=

3.0

PSF

BOT

CH.

LL

=

0.0

PSF

DL

=

7.0

PSF

TOTAL

LOAD

=

33.3

PSF

SPACING =

24.0

IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014

- CSA 086-09

- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.30")

CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")

ALLOWABLE DEFL.(TL)= L/360 (0.30")

CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.20 (1-2:1) , BC=0.10 (5-6:4) , WB=0.04 (3-5:1) , SSI=0.10 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE

GRIP(DRY)

SHEAR

SECTION

(PSI)

(PLI)

(PLI)

MAX

MIN

MAX

MIN

MAX

MIN

MT20

618

354

1667

822

2284

1656

PLATE PLACEMENT TOL. =

0.250

inches

PLATE ROTATION TOL. =

5.0

Deg.

JSI GRIP=

0.35

(5)

(INPUT = 0.90)

JSI METAL=

0.10

(1)

(INPUT = 1.00)

RECEIVED

TOWN OF MILTON

MAR 29, 2017

JUNIPER 3


BUILDING DIVISION

KOTT

READ ALL NOTES ON THIS PAGE AND ON THE
ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE
IS AN INTEGRAL PART OF THIS DRAWING AS IT
CONTAINS SPECIFICATIONS AND CRITERIA USED
IN THE DESIGN OF THIS COMPONENT.



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

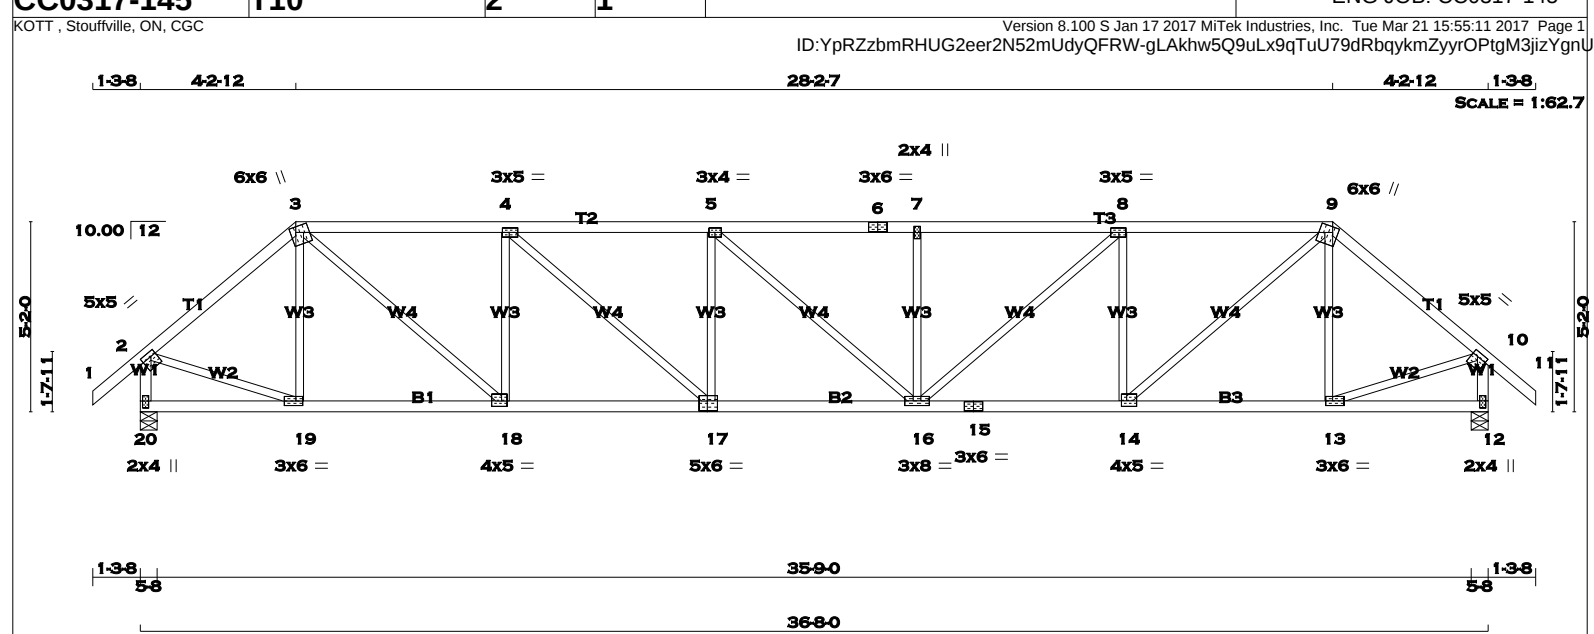

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR.
 1 - 3 2x4 DRY No.2 SPF
 3 - 6 2x4 DRY No.2 SPF
 6 - 9 2x4 DRY No.2 SPF
 9 - 11 2x4 DRY No.2 SPF
 20 - 2 2x4 DRY No.2 SPF
 12 - 10 2x4 DRY No.2 SPF
 20 - 17 2x4 DRY No.2 SPF
 17 - 15 2x4 DRY No.2 SPF
 15 - 12 2x4 DRY No.2 SPF
 ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 23.3 PSF
 DL = 3.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 33.3 PSF

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN.	COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE PERM.LIVE WIND DEAD SOIL
20	1293	918 / 0 0 / 0 0 / 0 0 / 0 375 / 0 0 / 0
12	1293	918 / 0 0 / 0 0 / 0 0 / 0 375 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 20, 12

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.40 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO		FROM TO			FR-TO		
1-2	0 / 34	-77.3	-77.3 0.11 (1)	10.00	19-3	-310 / 0	0.12 (1)
2-3	-1772 / 0	-77.3	-77.3 0.31 (1)	4.71	3-18	0 / 1693	0.38 (1)
3-4	-2641 / 0	-77.3	-77.3 0.53 (1)	3.78	18-4	-1001 / 0	0.40 (1)
4-5	-3237 / 0	-77.3	-77.3 0.61 (1)	3.40	4-17	0 / 790	0.18 (1)
5-6	-3236 / 0	-77.3	-77.3 0.49 (1)	3.55	17-5	-420 / 0	0.17 (1)
6-7	-3236 / 0	-77.3	-77.3 0.49 (1)	3.55	5-16	-2 / 0	0.00 (1)
7-8	-3236 / 0	-77.3	-77.3 0.61 (1)	3.40	16-7	-420 / 0	0.17 (1)
8-9	-2641 / 0	-77.3	-77.3 0.53 (1)	3.78	16-8	0 / 788	0.18 (1)
9-10	-1772 / 0	-77.3	-77.3 0.31 (1)	4.71	14-8	-1001 / 0	0.39 (1)
10-11	0 / 34	-77.3	-77.3 0.11 (1)	10.00	14-9	0 / 1694	0.38 (1)
20-2	-1818 / 0	0.0	0.0 0.19 (1)	6.20	13-9	-310 / 0	0.12 (1)
12-10	-1818 / 0	0.0	0.0 0.19 (1)	6.20	2-19	0 / 1418	0.32 (1)
					13-10	0 / 1418	0.32 (1)
20-19	0 / 0	-17.5	-17.5 0.10 (4)	10.00			
19-18	0 / 1351	-17.5	-17.5 0.28 (1)	10.00			
18-17	0 / 2641	-17.5	-17.5 0.47 (1)	10.00			
17-16	0 / 3237	-17.5	-17.5 0.57 (1)	10.00			
16-15	0 / 2641	-17.5	-17.5 0.47 (1)	10.00			
15-14	0 / 2641	-17.5	-17.5 0.47 (1)	10.00			
14-13	0 / 1351	-17.5	-17.5 0.28 (1)	10.00			
13-12	0 / 0	-17.5	-17.5 0.10 (4)	10.00			

ALLOWABLE DEFL.(LL)= L/360 (1.22")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
 ALLOWABLE DEFL.(TL)= L/360 (1.22")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.61 (7-8:1), BC=0.57 (16-17:1),
 WB=0.40 (4-18:1), SSI=0.21 (8-9:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (19) (INPUT = 0.90)
 JSI METAL= 0.70 (15) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

21 MAR 2017

RECEIVED TOWN OF MILTON MAR 29, 2017 JUNIPER 3 BUILDING DIVISION

KOTT

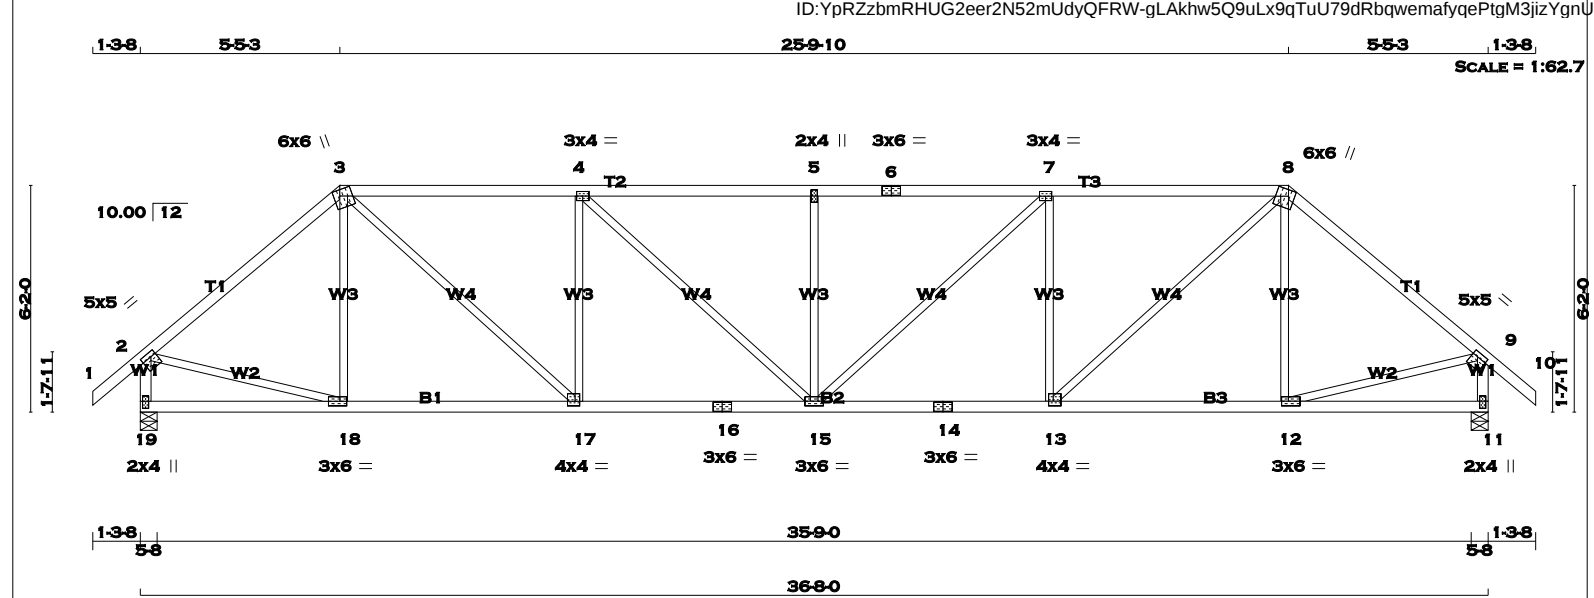

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

LUMBER

DESCR.

1 - 3

2x4

DRY

No.2

SPF

3 - 6

2x4

DRY

No.2

SPF

6 - 8

2x4

DRY

No.2

SPF

8 - 10

2x4

DRY

No.2

SPF

19 - 2

2x4

DRY

No.2

SPF

11 - 9

2x4

DRY

No.2

SPF

19 - 16

2x4

DRY

No.2

SPF

16 - 14

2x4

DRY

No.2

SPF

14 - 11

2x4

DRY

No.2

SPF

ALL WEBS

2x3

DRY

No.2

SPF

EXCEPT

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
19	1846	0	1846	0	0	5-8	5-8	5-8	
11	1846	0	1846	0	0	5-8	5-8	5-8	
UNFACTORED REACTIONS									
		1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
19	1293	918 / 0	0 / 0	0 / 0	0 / 0	0 / 0	375 / 0	0 / 0	
11	1293	918 / 0	0 / 0	0 / 0	0 / 0	0 / 0	375 / 0	0 / 0	

DRY: SEASONED LUMBER.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 19, 11

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.49 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX UNBRACED LENGTH (FR-TO)	MEMB.	MAX. FACTORED FORCE (LBS)

FR-TO		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX UNBRACED LENGTH (FR-TO)	MEMB.	MAX. FACTORED FORCE (LBS)
1-2	0 / 34	-77.3	-77.3	0.11 (1)	10.00	18-3	-210 / 32	0.13 (1)	
2-3	-1813 / 0	-77.3	-77.3	0.54 (1)	4.42	3-17	0 / 1429	0.32 (1)	
3-4	-2448 / 0	-77.3	-77.3	0.70 (1)	3.71	17-4	-845 / 0	0.51 (1)	
4-5	-2757 / 0	-77.3	-77.3	0.74 (1)	3.49	4-15	0 / 420	0.09 (1)	
5-6	-2757 / 0	-77.3	-77.3	0.74 (1)	3.49	15-5	-456 / 0	0.27 (1)	
6-7	-2757 / 0	-77.3	-77.3	0.74 (1)	3.49	15-7	0 / 420	0.09 (1)	
7-8	-2448 / 0	-77.3	-77.3	0.70 (1)	3.71	13-7	-845 / 0	0.51 (1)	
8-9	-1813 / 0	-77.3	-77.3	0.54 (1)	4.42	13-8	0 / 1429	0.32 (1)	
9-10	0 / 34	-77.3	-77.3	0.11 (1)	10.00	12-8	-210 / 32	0.13 (1)	
19-2	-1809 / 0	0.0	0.0	0.19 (1)	6.22	2-18	0 / 1428	0.32 (1)	
11-9	-1809 / 0	0.0	0.0	0.19 (1)	6.22	12-9	0 / 1428	0.32 (1)	
19-18	0 / 0	-17.5	-17.5	0.15 (4)	10.00				
18-17	0 / 1386	-17.5	-17.5	0.31 (1)	10.00				
17-16	0 / 2448	-17.5	-17.5	0.46 (1)	10.00				
16-15	0 / 2448	-17.5	-17.5	0.46 (1)	10.00				
15-14	0 / 2448	-17.5	-17.5	0.46 (1)	10.00				
14-13	0 / 2448	-17.5	-17.5	0.46 (1)	10.00				
13-12	0 / 1386	-17.5	-17.5	0.31 (1)	10.00				
12-11	0 / 0	-17.5	-17.5	0.15 (4)	10.00				

ALLOWABLE DEFL.(LL)= L/360 (1.22")

CALCULATED VERT. DEFL.(LL)= L/ 999 (0.16")

ALLOWABLE DEFL.(TL)= L/360 (1.22")

CALCULATED VERT. DEFL.(TL)= L/ 999 (0.29")

CSI: TC=0.74 (5-7:1), BC=0.46 (15-17:1), WB=0.51 (7-13:1), SSI=0.24 (7-8:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (8) (INPUT = 0.90)

JSI METAL= 0.70 (14) (INPUT = 1.00)

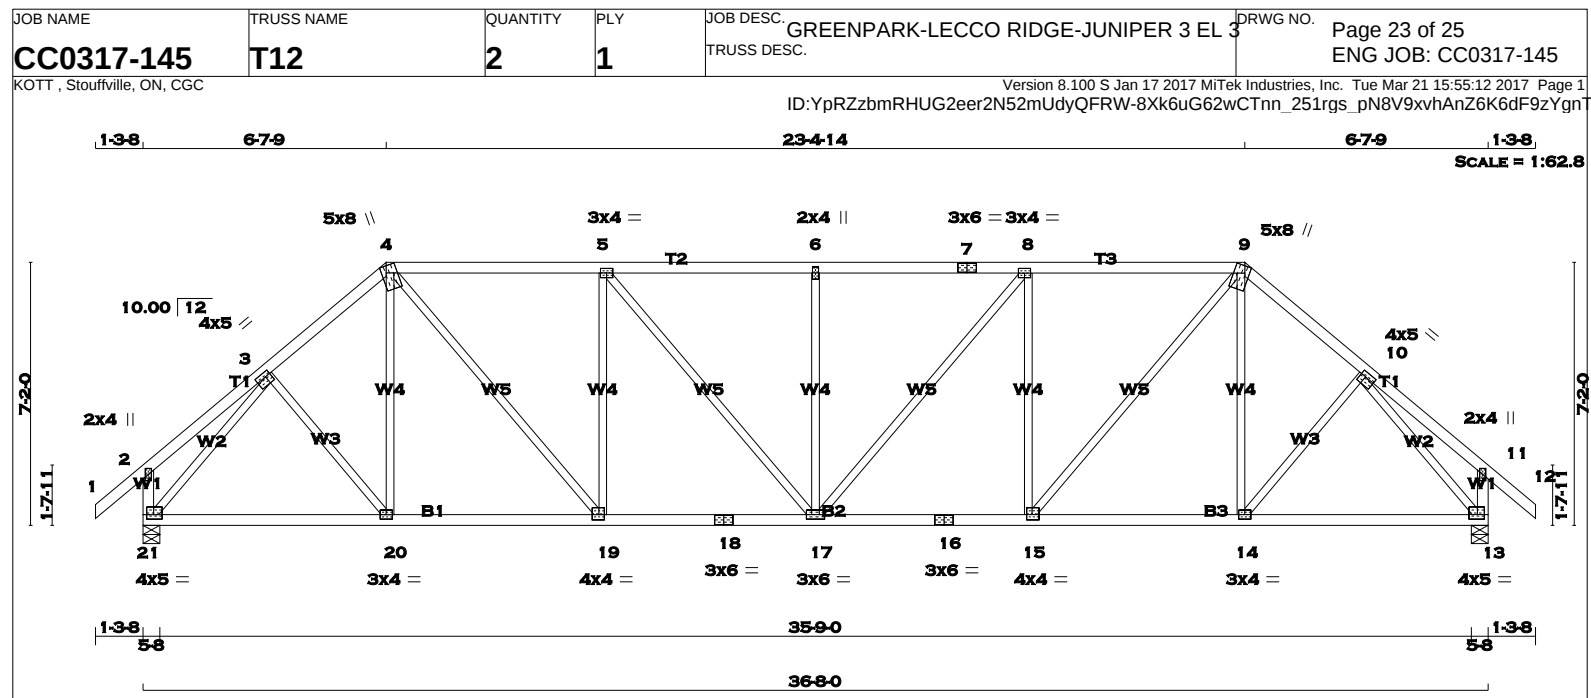


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. 1 - 4 2x4 DRY No.2 SPF 4 - 7 2x4 DRY No.2 SPF 7 - 9 2x4 DRY No.2 SPF 9 - 12 2x4 DRY No.2 SPF 21 - 2 2x4 DRY No.2 SPF 13 - 11 2x4 DRY No.2 SPF 21 - 18 2x4 DRY No.2 SPF 18 - 16 2x4 DRY No.2 SPF 16 - 13 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQRD JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX 21 1846 0 1846 0 0 5-8 5-8 13 1846 0 1846 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL 21 1293 918 / 0 0 / 0 0 / 0 375 / 0 0 / 0 13 1293 918 / 0 0 / 0 0 / 0 375 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 21, 13 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.94 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MEMB. MAX. FACTORED FORCE (LBS) VERT. LOAD LC1 MAX (PLF) CSI (LC) UNBRAC LENGTH FR-TO MEMB. MAX. FACTORED FORCE (LBS) MAX (PLF) CSI (LC) FR-TO FROM TO 1-2 0 / 34 -77.3 -77.3 0.11 (1) 10.00 3-20 0 / 151 0.03 (1) 2-3 0 / 16 -77.3 -77.3 0.12 (1) 10.00 20-4 0 / 78 0.03 (4) 3-4 -1831 / 0 -77.3 -77.3 0.16 (1) 4.81 4-19 0 / 1137 0.26 (1) 4-5 -2132 / 0 -77.3 -77.3 0.52 (1) 4.13 19-5 -767 / 0 0.69 (1) 5-6 -2350 / 0 -77.3 -77.3 0.54 (1) 3.94 5-17 0 / 337 0.08 (1) 6-7 -2350 / 0 -77.3 -77.3 0.54 (1) 3.94 17-6 -413 / 0 0.37 (1) 7-8 -2350 / 0 -77.3 -77.3 0.54 (1) 3.94 17-8 0 / 337 0.08 (1) 8-9 -2132 / 0 -77.3 -77.3 0.52 (1) 4.13 15-8 -767 / 0 0.69 (1) 9-10 -1831 / 0 -77.3 -77.3 0.16 (1) 4.81 15-9 0 / 1137 0.26 (1) 10-11 0 / 16 -77.3 -77.3 0.12 (1) 10.00 14-9 0 / 78 0.03 (4) 11-12 0 / 34 -77.3 -77.3 0.11 (1) 10.00 14-10 0 / 151 0.03 (1) 21-2 -209 / 0 0.0 0.0 0.02 (1) 7.81 21-3 -2048 / 0 0.90 (1) 13-11 -209 / 0 0.0 0.0 0.02 (1) 7.81 10-13 -2048 / 0 0.90 (1) 21-20 0 / 1292 -17.5 -17.5 0.31 (1) 10.00 20-19 0 / 1390 -17.5 -17.5 0.32 (1) 10.00 19-18 0 / 2132 -17.5 -17.5 0.40 (1) 10.00 18-17 0 / 2132 -17.5 -17.5 0.40 (1) 10.00 17-16 0 / 2132 -17.5 -17.5 0.40 (1) 10.00 16-15 0 / 2132 -17.5 -17.5 0.40 (1) 10.00 15-14 0 / 1390 -17.5 -17.5 0.32 (1) 10.00 14-13 0 / 1292 -17.5 -17.5 0.31 (1) 10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (1.22") CALCULATED VERT. DEFL.(LL) = L/999 (0.13") ALLOWABLE DEFL.(TL)= L/360 (1.22") CALCULATED VERT. DEFL.(TL) = L/999 (0.23") CSI: TC=0.54 (5-6:1), BC=0.40 (17-19:1), WB=0.90 (10-13:1), SSI=0.21 (4-5:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.88 (3) (INPUT = 0.90) JSI METAL= 0.60 (18) (INPUT = 1.00)			
---	--	--	--	---	--	--	--	---	--	--	--

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

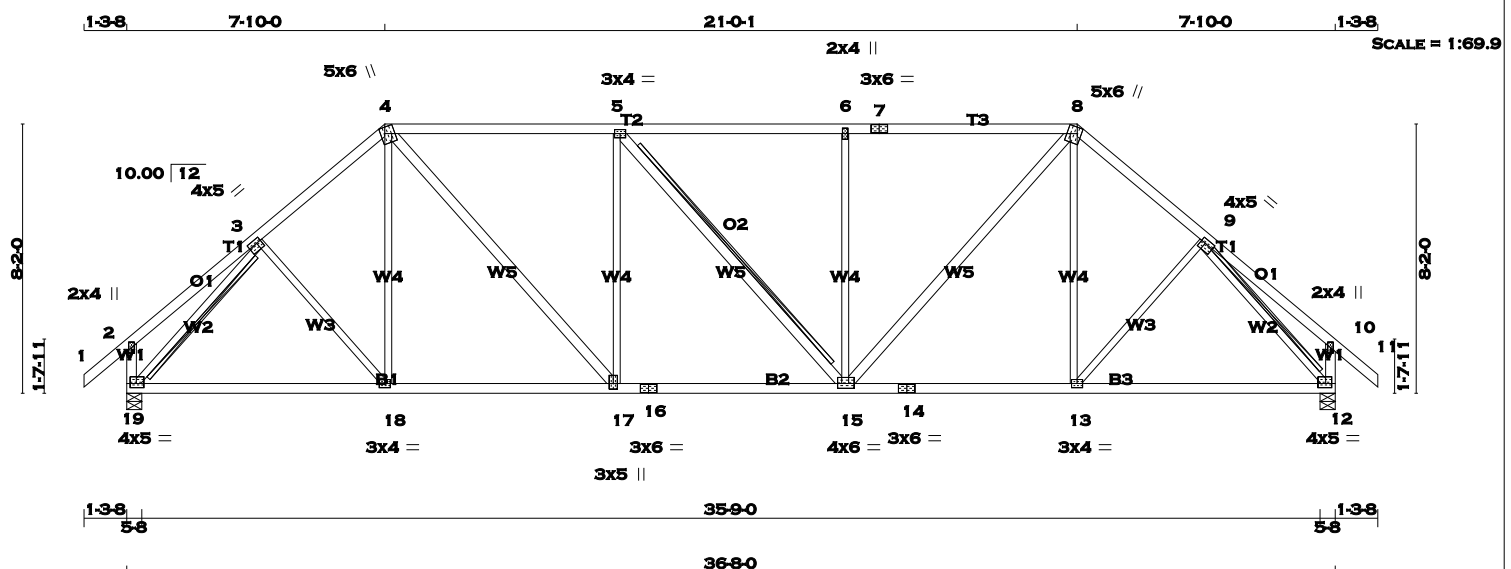

TOTAL WEIGHT = 2 X 174 = 348 lb [M]

LUMBER				N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.	CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	1 - 4	2x4	DRY	No.2
4 - 7	2x4	DRY	No.2	4 - 7	2x4	DRY	No.2
7 - 8	2x4	DRY	No.2	7 - 8	2x4	DRY	No.2
8 - 11	2x4	DRY	No.2	8 - 11	2x4	DRY	No.2
19 - 2	2x4	DRY	No.2	19 - 2	2x4	DRY	No.2
12 - 10	2x4	DRY	No.2	12 - 10	2x4	DRY	No.2
19 - 16	2x4	DRY	No.2	19 - 16	2x4	DRY	No.2
16 - 14	2x4	DRY	No.2	16 - 14	2x4	DRY	No.2
14 - 12	2x4	DRY	No.2	14 - 12	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2	ALL WEBS EXCEPT	2x3	DRY	No.2
4 - 17	2x4	DRY	No.2	4 - 17	2x4	DRY	No.2
5 - 15	2x4	DRY	No.2	5 - 15	2x4	DRY	No.2
15 - 8	2x4	DRY	No.2	15 - 8	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
3	TTWW-t	MT20	4.0	5.0	1.50	1.75
4	TTWW+m	MT20	5.0	6.0	2.25	1.50
5	TMWW-t	MT20	3.0	4.0		
6	TMW+w	MT20	2.0	4.0		
7	TS-t	MT20	3.0	6.0		
8	TTWW+m	MT20	5.0	6.0	2.25	1.50
9	TMWW-t	MT20	4.0	5.0	1.50	1.75
10	TMV+p	MT20	2.0	4.0		
12	BMVW1-t	MT20	4.0	5.0	1.50	2.25
13	BMWW-t	MT20	3.0	4.0		
14	BS-t	MT20	3.0	6.0		
15	BMWWW-t	MT20	4.0	6.0	1.75	1.50
16	BS-t	MT20	3.0	6.0		
17	BMWWW-t	MT20	3.0	5.0	2.00	1.50
18	BMWW-t	MT20	3.0	4.0		
19	BMVW1-t	MT20	4.0	5.0	1.50	2.25

A SIZE FOR SIZE SUBSTITUTION OF MI TEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS				FACTORED				MAXIMUM FACTORED				INPUT				REQRD			
JT	VERT	HORZ	DOWN	GROSS REACTION	FACTORED	DOWN	HORZ	GROSS REACTION	FACTORED	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX	BRG	IN-SX	BRG	IN-SX
19	1846	0	1846	0	1846	0	0	1846	0	1846	0	5-8	5-8	5-8	5-8	5-8	5-8	5-8	5-8
12	1846	0	1846	0	1846	0	0	1846	0	1846	0	5-8	5-8	5-8	5-8	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE				MAX./MIN. COMPONENT REACTIONS			
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
19	1293	918 / 0	0 / 0	0 / 0	0 / 0	375 / 0	0 / 0
12	1293	918 / 0	0 / 0	0 / 0	0 / 0	375 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 19, 12

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 SPF No.2 T-BRACE AT 5-15, 3-19, 9-12

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	FACTORED VERT. LOAD (PLF)
FR-TO		FROM TO		FR-TO		FROM TO	
1-2	0 / 34	-77.3 -77.3	0.11 (1)	10.00	3-18	0 / 65	0.02 (4)
2-3	0 / 21	-77.3 -77.3	0.18 (1)	10.00	18-4	0 / 119	0.04 (4)
3-4	-1817 / 0	-77.3 -77.3	0.24 (1)	4.75	4-17	0 / 943	0.15 (1)
4-5	-2006 / 0	-77.3 -77.3	0.72 (1)	3.99	17-5	-586 / 0	0.76 (1)
5-6	-2005 / 0	-77.3 -77.3	0.71 (1)	3.99	5-15	-2 / 0	0.00 (1)
6-7	-2006 / 0	-77.3 -77.3	0.71 (1)	4.01	15-6	-585 / 0	0.76 (1)
7-8	-2006 / 0	-77.3 -77.3	0.71 (1)	4.01	15-8	0 / 940	0.15 (1)
8-9	-1817 / 0	-77.3 -77.3	0.24 (1)	4.75	13-8	0 / 119	0.04 (4)
9-10	0 / 21	-77.3 -77.3	0.18 (1)	10.00	13-9	0 / 65	0.02 (4)
10-11	0 / 34	-77.3 -77.3	0.11 (1)	10.00	19-3	-2059 / 0	0.56 (1)
19-2	-225 / 0	0.0 0.0	0.02 (1)	7.81	9-12	-2059 / 0	0.56 (1)
12-10	-225 / 0	0.0 0.0	0.02 (1)	7.81			
19-18	0 / 1339	-17.5 -17.5	0.35 (1)	10.00			
18-17	0 / 1377	-17.5 -17.5	0.36 (1)	10.00			
17-16	0 / 2007	-17.5 -17.5	0.40 (1)	10.00			
16-15	0 / 2007	-17.5 -17.5	0.40 (1)	10.00			
15-14	0 / 1378	-17.5 -17.5	0.36 (1)	10.00			
14-13	0 / 1378	-17.5 -17.5	0.36 (1)	10.00			
13-12	0 / 1339	-17.5 -17.5	0.35 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3 PSF
DL = 3.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.0 PSF	
TOTAL LOAD = 33.3 PSF	

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (1.22")
CALCULATED VERT. DEFL.(TL) = L/999 (0.21")

CSI: TC=0.72 (4-5:1), BC=0.40 (15-17:1), WB=0.76 (5-17:1), SSI=0.25 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (12) (INPUT = 0.90)
JSI METAL= 0.61 (9) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 3
BUILDING DIVISION

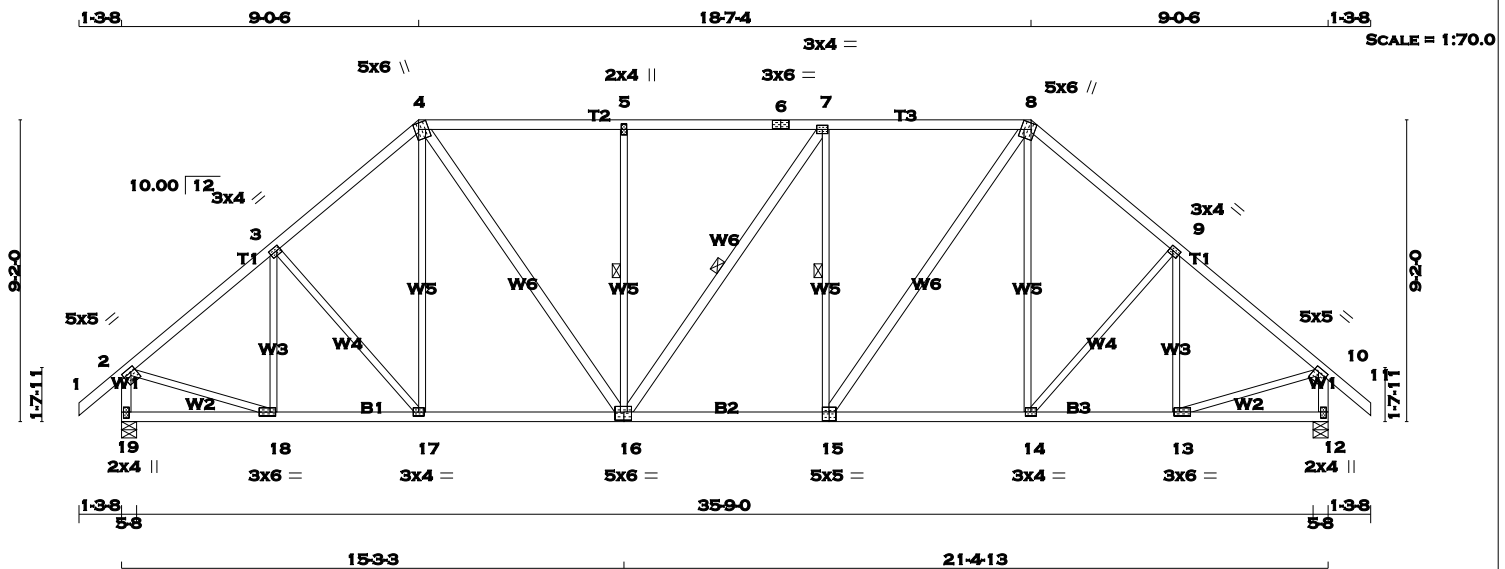

TOTAL WEIGHT = 2 X 186 = 373 lb
[M]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2
4 - 6	2x4	DRY	No.2
6 - 8	2x4	DRY	No.2
8 - 11	2x4	DRY	No.2
19 - 2	2x4	DRY	No.2
12 - 10	2x4	DRY	No.2
19 - 16	2x4	DRY	No.2
16 - 15	2x4	DRY	No.2
15 - 12	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
4 - 16	2x4	DRY	No.2
16 - 7	2x4	DRY	No.2
15 - 8	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	5.0	5.0	1.50	1.75
3	TMWW-t	MT20	3.0	4.0	1.50	1.25
4	TTWW+m	MT20	5.0	6.0	2.25	1.50
5	TMW+w	MT20	2.0	4.0		
6	TS-t	MT20	3.0	6.0		
7	TMWW-t	MT20	3.0	4.0		
8	TTWW+m	MT20	5.0	6.0	2.25	1.50
9	TMWW-t	MT20	3.0	4.0	1.50	1.25
10	TMVW-t	MT20	5.0	5.0	1.50	1.75
12	BMV1+p	MT20	2.0	4.0	2.25	1.00
13	BMWW-t	MT20	3.0	6.0	1.50	2.00
14	BMWW-t	MT20	3.0	4.0		
15	BSWW-I	MT20	5.0	5.0	3.25	2.50
16	BSWWW-I	MT20	5.0	6.0	3.00	2.75
17	BMWW-t	MT20	3.0	4.0		
18	BMWW-t	MT20	3.0	6.0	1.50	2.00
19	BMV1+p	MT20	2.0	4.0	2.25	1.00

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
19	1846	0	1846	0	0
12	1846	0	1846	0	0

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	2ND LCASE SNOW	MAX. LIVE	MIN. LIVE	PERM. LIVE	WIND	DEAD
19	1293	918 / 0	0 / 0	0 / 0	0 / 0	0 / 0	375 / 0
12	1293	918 / 0	0 / 0	0 / 0	0 / 0	0 / 0	375 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 19, 12

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.43 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 2x3 SPF No.2 LATERAL BRACE(S) AT 1/2 LENGTH OF 5-16, 7-16, 7-15. DBS = 20-0-0. CBF = 65 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE. FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
1-2	0 / 34	-77.3 -77.3	0.11 (1)	10.00	18-3	-317 / 0	0.14 (1)
2-3	-1799 / 0	-77.3 -77.3	0.34 (1)	4.66	3-17	-93 / 0	0.08 (1)
3-4	-1776 / 0	-77.3 -77.3	0.33 (1)	4.68	17-4	0 / 168	0.04 (4)
4-5	-1784 / 0	-77.3 -77.3	0.51 (1)	4.44	4-16	0 / 766	0.12 (1)
5-6	-1784 / 0	-77.3 -77.3	0.51 (1)	4.43	16-5	-517 / 0	0.28 (1)
6-7	-1784 / 0	-77.3 -77.3	0.51 (1)	4.43	16-7	-2 / 0	0.00 (1)
7-8	-1785 / 0	-77.3 -77.3	0.52 (1)	4.43	15-7	-518 / 0	0.28 (1)
8-9	-1776 / 0	-77.3 -77.3	0.33 (1)	4.68	15-8	0 / 768	0.12 (1)
9-10	-1800 / 0	-77.3 -77.3	0.34 (1)	4.66	14-8	0 / 166	0.04 (4)
10-11	0 / 34	-77.3 -77.3	0.11 (1)	10.00	14-9	-94 / 0	0.08 (1)
19-2	-1810 / 0	0.0 0.0	0.19 (1)	6.22	13-9	-316 / 0	0.14 (1)
12-10	-1810 / 0	0.0 0.0	0.19 (1)	6.22	2-18	0 / 1457	0.33 (1)
					13-10	0 / 1457	0.33 (1)
19-18	0 / 0	-17.5 -17.5	0.08 (4)	10.00			
18-17	0 / 1402	-17.5 -17.5	0.29 (1)	10.00			
17-16	0 / 1343	-17.5 -17.5	0.28 (1)	10.00			
16-15	0 / 1785	-17.5 -17.5	0.36 (1)	10.00			
15-14	0 / 1342	-17.5 -17.5	0.29 (1)	10.00			
14-13	0 / 1402	-17.5 -17.5	0.28 (1)	10.00			
13-12	0 / 0	-17.5 -17.5	0.08 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.22")
CALCULATED VERT. DEFL.(LL)= L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (1.22")
CALCULATED VERT. DEFL.(TL)= L/999 (0.16")

CSI: TC=0.52 (7-8:1), BC=0.36 (15-16:1), WB=0.33 (10-13:1), SSI=0.22 (7-8:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (15) (INPUT = 0.90)
JSI METAL= 0.59 (10) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

