




RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION

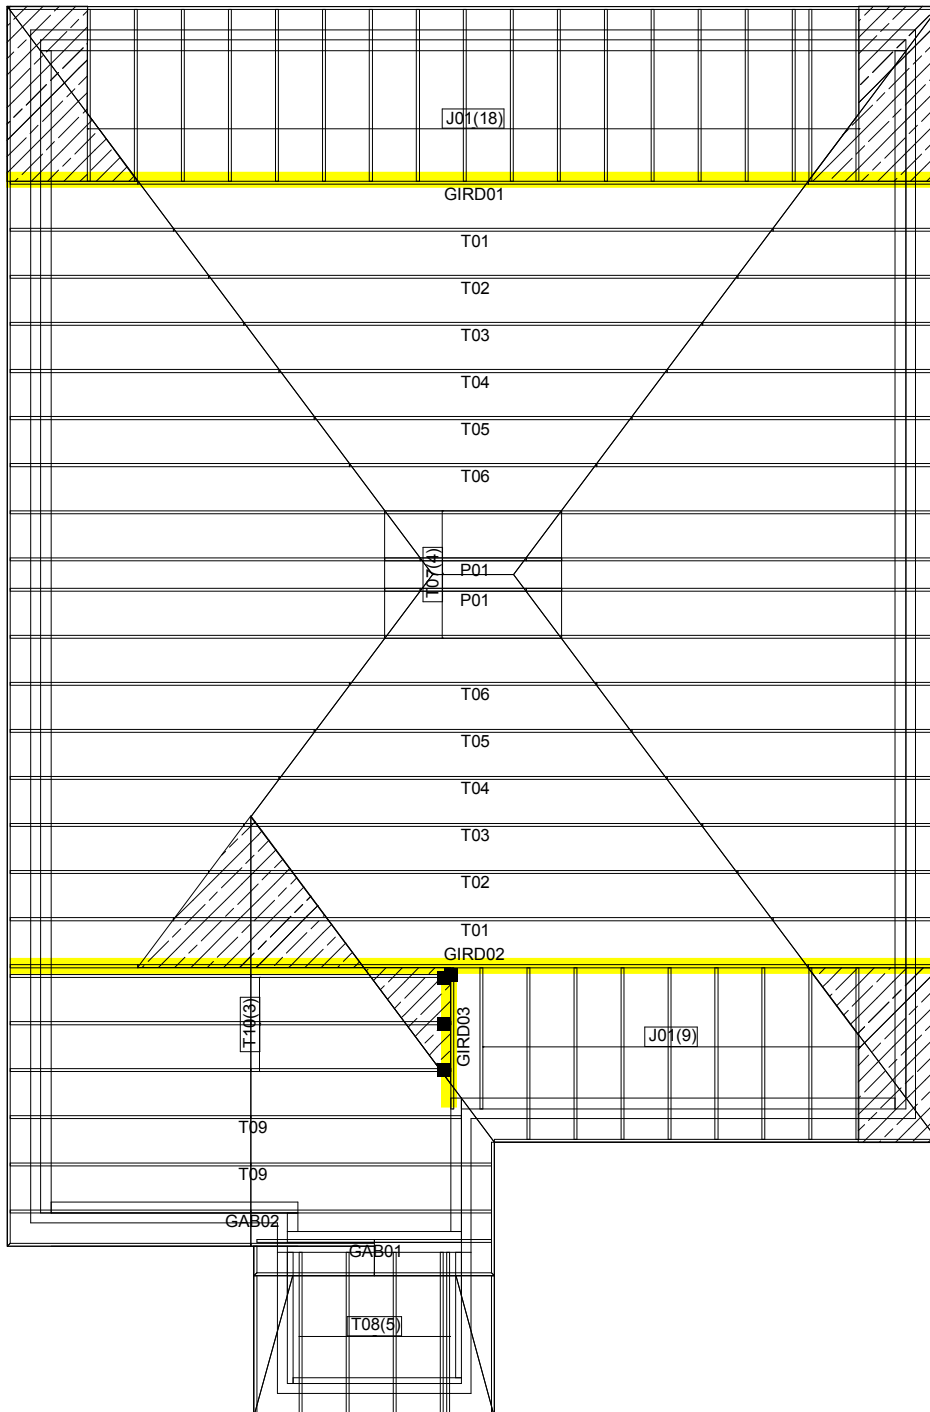

TOWN OF MILTON
PLANNING AND DEVELOPMENT
JUNIPER 8 MODEL

BUILDING: REVIEWED

SCOTT SHERRIFFS MAR 30, 2017

PLANS EXAMINER DATE

Neither the issuance of a permit nor carrying out of inspections by the Town of Milton relieves the owner from full responsibility for compliance with the provisions of the Ontario Building Code Act and the Ontario Building Code, both as amended, as well as other applicable statutes and regulations of the Province of Ontario, By-laws of the Region of Halton and Town of Milton



CONVENTIONAL
FRAMING BY OTHERS

ALL CONVENTIONAL FRAMING TO CONFORM WITH PART 9 OF THE O.B.C.
ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2x4 S.P.F. @ 24"O/C WITH A 2x4 VERTICAL POST TO THE TRUSS UNDERNEATH EACH CROSS POINT. VERTICAL POST LONGER THAN 6' TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN END POINT AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

HANGER LEGEND:

▼ LUS24 ■ LJS26DS
● HGUS26 X HGUS26-2

SIZE AND LOCATION OF CONVENTIONAL FRAMING IS APPROXIMATE. ALL AREAS MAY NOT BE SHOWN. REFER TO ARCHITECTURAL PLANS FOR DETAILS.

Model: JUNIPER 8 EL 2

Customer: GREENPARK

Project: LECCO RIDGE

Location: MILTON

Date: 10/13/2016 Drawn by: BB

ENGINEERING NOTE PAGE (ENP-1)
PLEASE READ PRIOR TO INSTALLATION

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING

- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.


DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

WHERE CONTINUOUS LATERAL BRACING IS REQUIRED FOR WEBS BUT CAN NOT BE PROVIDED SUBSTITUTE EACH WITH ONE SPF #2 2" X 4" T-BRACE COVERING 90% OF WEB LENGTH AND FASTENED TO EDGE OF WEB USING 3 1/4" SPIRAL NAILS @ 6" C/C

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION

01/29/2013

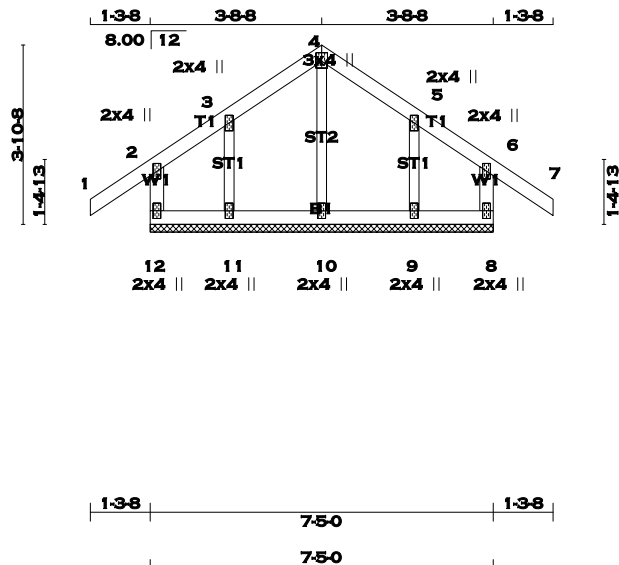

LUMBER				DESCR.	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER		
12 - 2	2x4	DRY	No.2	SPF	
1 - 4	2x4	DRY	No.2	SPF	
4 - 7	2x4	DRY	No.2	SPF	
8 - 6	2x4	DRY	No.2	SPF	
12 - 8	2x4	DRY	No.2	SPF	
ALL WEBS 2x3 DRY No.2				SPF	
ALL GABLE WEBS 2x3 DRY No.2				SPF	
DRY: SEASONED LUMBER.					
GABLE STUDS SPACED AT 2-0-0 OC.					

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMV+p	MT20	2.0	4.0	
3	TMW+w	MT20	2.0	4.0	
4	TTW+p	MT20	3.0	4.0	2.25 1.50
5	TMW+w	MT20	2.0	4.0	
6	TMV+p	MT20	2.0	4.0	
8	BMV1+p	MT20	2.0	4.0	
9, 10, 11					
9	BMW1+w	MT20	2.0	4.0	
12	BMV1+p	MT20	2.0	4.0	

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.




DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.									
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.									
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.									
LOADING									
TOTAL LOAD CASES: (4)									
CHORDS									
MEMB.		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (1)	LC2 MAX (1)	UNBRAC LENGTH	WEBS		
FR-TO			FROM	TO			MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
12-2		-169 / 0	0.0	0.0	0.04 (1)	7.81	10-4	-212 / 0	0.05 (1)
1-2		0 / 29	-77.3	-77.3	0.10 (1)	10.00	11-3	-119 / 0	0.02 (1)
2-3		0 / 21	-77.3	-77.3	0.06 (1)	10.00	9-5	-119 / 0	0.02 (1)
3-4		0 / 38	-77.3	-77.3	0.05 (1)	10.00			
4-5		0 / 38	-77.3	-77.3	0.05 (1)	10.00			
5-6		0 / 21	-77.3	-77.3	0.06 (1)	10.00			
6-7		0 / 29	-77.3	-77.3	0.10 (1)	10.00			
8-6		-169 / 0	0.0	0.0	0.04 (1)	7.81			
12-11		-25 / 0	-17.5	-17.5	0.01 (4)	6.25			
11-10		-29 / 0	-17.5	-17.5	0.01 (4)	6.25			
10-9		-29 / 0	-17.5	-17.5	0.01 (4)	6.25			
9-8		-25 / 0	-17.5	-17.5	0.01 (4)	6.25			

DESIGN CRITERIA	
SPECIFIED LOADS:	
TOP CH. LL =	23.3 PSF
DL =	3.0 PSF
BOT CH. LL =	0.0 PSF
DL =	7.0 PSF
TOTAL LOAD =	33.3 PSF
SPACING = 24.0 IN. C/C	
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010	
THIS DESIGN COMPLIES WITH:	
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014	
- CSA 086-09	
- TPIC 2011	
DESIGN ASSUMPTIONS	
- OVERHANG NOT TO BE ALTERED OR CUT OFF.	
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD	
CSI: TC=0.10 (6-7:1), BC=0.01 (10-11:4), WB=0.05 (4-10:1), SSI=0.07 (6-7:1)	
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10	
COMPANION LIVE LOAD FACTOR = 0.50	
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.	
NAIL VALUES	
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)	
MAX MIN MAX MIN MAX MIN	
MT20 618 354 1667 822 2284 1656	
PLATE PLACEMENT TOL. = 0.250 inches	
PLATE ROTATION TOL. = 5.0 Deg.	
JSI GRIP= 0.14 (4) (INPUT = 0.90)	
JSI METAL= 0.08 (4) (INPUT = 1.00)	

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



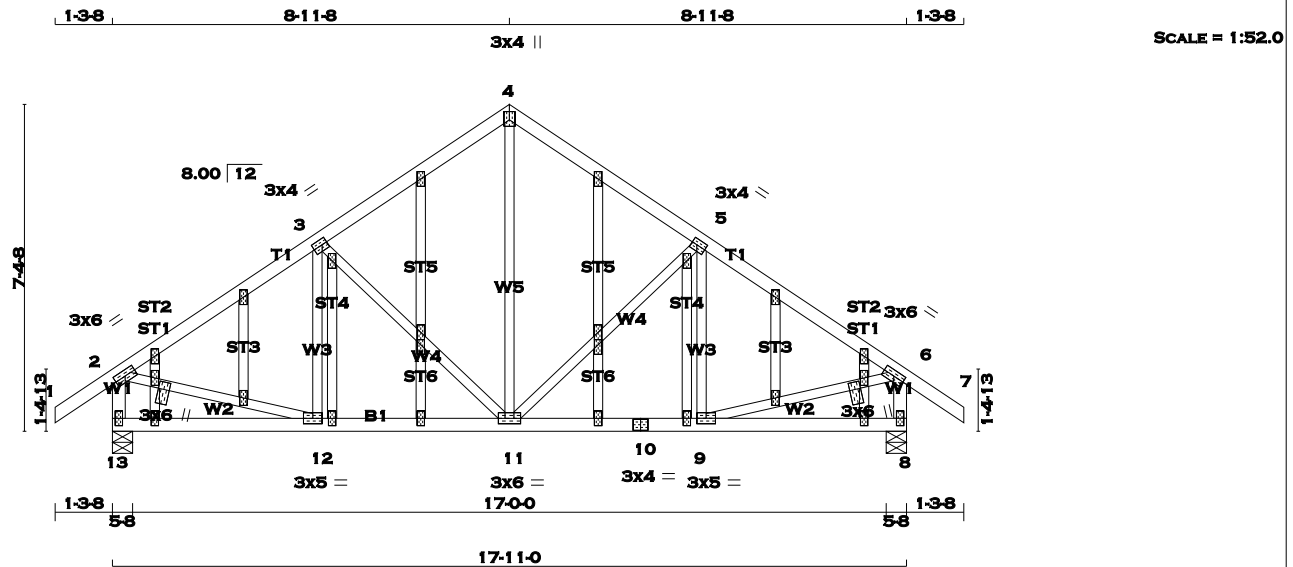

TOTAL WEIGHT = 100 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
1 - 4	2x4	DRY	No.2	SPF
4 - 7	2x4	DRY	No.2	SPF
13 - 2	2x4	DRY	No.2	SPF
8 - 6	2x4	DRY	No.2	SPF
13 - 10	2x4	DRY	No.2	SPF
10 - 8	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2-0-0 OC.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMVW-t	MT20	3.0	6.0	
3	TMVW-t	MT20	3.0	4.0	1.50 1.50
4	TTW+p	MT20	3.0	4.0	2.25 1.50
5	TMVW-t	MT20	3.0	4.0	1.50 1.50
6	TMVW-t	MT20	3.0	6.0	
8	BMV1+p	MT20	2.0	4.0	
9	BMVW-t	MT20	3.0	5.0	
10	BS-t	MT20	3.0	4.0	
11	BMVW-t	MT20	3.0	6.0	
12	BMVW-t	MT20	3.0	5.0	
13	BMV1+p	MT20	2.0	4.0	
14	NP+w	MT20	2.0	4.0	1.50 1.00
14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33					
14	NP+w	MT20	2.0	4.0	
21	NP+t	MT20	3.0	6.0	2.00 0.25
26	NP+w	MT20	2.0	4.0	1.50 1.00
33	NP+t	MT20	3.0	6.0	2.00 0.25
A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG		
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
13		956	0	956	0	0	5-8
8		956	0	956	0	0	5-8

UNFACTORED REACTIONS							
		1ST LCASE COMBINED	MAX/MIN. SNOW	MAX/MIN. LIVE	MAX/MIN. PERM. LIVE	MAX/MIN. WIND	MAX/MIN. DEAD
JT							
13		668	481 / 0	0 / 0	0 / 0	0 / 0	187 / 0
8		668	481 / 0	0 / 0	0 / 0	0 / 0	187 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 13, 8

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING							
TOTAL LOAD CASES: (4)							
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
1-2	0 / 29	-77.3	-77.3 0.10 (1)	10.00	11-4	0 / 474	0.11 (1)
2-3	-881 / 0	-77.3	-77.3 0.21 (1)	6.25	11-5	-289 / 0	0.18 (1)
3-4	-676 / 0	-77.3	-77.3 0.20 (1)	6.25	9-5	-90 / 48	0.03 (1)
4-5	-676 / 0	-77.3	-77.3 0.20 (1)	6.25	3-11	-289 / 0	0.18 (1)
5-6	-881 / 0	-77.3	-77.3 0.21 (1)	6.25	12-3	-90 / 48	0.03 (1)
6-7	0 / 29	-77.3	-77.3 0.10 (1)	10.00	2-12	0 / 771	0.17 (1)
13-2	-921 / 0	0.0	0.0 0.09 (1)	7.81	9-6	0 / 771	0.17 (1)
8-6	-921 / 0	0.0	0.0 0.09 (1)	7.81			
13-12	0 / 0	-17.5	-17.5 0.08 (4)	10.00			
12-11	0 / 751	-17.5	-17.5 0.16 (1)	10.00			
11-10	0 / 751	-17.5	-17.5 0.16 (1)	10.00			
10-9	0 / 751	-17.5	-17.5 0.16 (1)	10.00			
9-8	0 / 0	-17.5	-17.5 0.08 (4)	10.00			

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.0 PSF
TOTAL LOAD = 33.3 PSF			

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.60")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.60")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.04")

CSI: TC=0.21 (2-3:1) , BC=0.16 (11-12:1) , WB=0.18 (3-11:1) , SSI=0.14 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (11) (INPUT = 0.90)
JSI METAL= 0.26 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION





DRY: SEASONED LUMBER.

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

WB - INDICATES BLOCKING REQUIRED

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 23, 13

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.17 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

C H O R D S					W E B S				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO			LENGTH	FR-TO			
1-2	0 / 29	-77.3	-77.3	0.10 (1)	10.00	22-3	-593 / 0	0.15 (1)	
2-3	-4040 / 0	-77.3	-77.3	0.36 (1)	3.72	3-21	0 / 3468	0.86 (1)	
3-4	-6070 / 0	-145.8	-145.8	0.80 (1)	2.66	21-4	-2012 / 0	0.52 (1)	
4-5	-7623 / 0	-145.8	-145.8	0.99 (1)	2.17	4-20	0 / 1992	0.49 (1)	
5-6	-8126 / 0	-145.8	-145.8	0.92 (1)	2.23	20-5	-1069 / 0	0.28 (1)	
6-7	-8126 / 0	-145.8	-145.8	0.92 (1)	2.23	5-18	0 / 644	0.16 (1)	
7-8	-8126 / 0	-145.8	-145.8	0.92 (1)	2.23	18-6	-694 / 0	0.18 (1)	
8-9	-7623 / 0	-145.8	-145.8	0.99 (1)	2.17	18-8	0 / 644	0.16 (1)	
9-10	-6070 / 0	-145.8	-145.8	0.80 (1)	2.66	16-8	-1069 / 0	0.28 (1)	
10-11	-4040 / 0	-77.3	-77.3	0.36 (1)	3.72	16-9	0 / 1992	0.49 (1)	
11-12	0 / 29	-77.3	-77.3	0.10 (1)	10.00	15-9	-2012 / 0	0.52 (1)	
23-2	-3302 / 0	0.0	0.0	0.24 (1)	5.79	15-10	0 / 3468	0.86 (1)	
13-11	-3302 / 0	0.0	0.0	0.24 (1)	5.79	14-10	-593 / 0	0.15 (1)	
						2-22	0 / 3447	0.85 (1)	
23-22	0 / 0	-33.0	-33.0	0.04 (4)	10.00	14-11	0 / 3447	0.85 (1)	
22-21	0 / 3340	-33.0	-33.0	0.22 (1)	10.00				
21-20	0 / 6071	-33.0	-33.0	0.38 (1)	10.00				
20-19	0 / 7623	-33.0	-33.0	0.48 (1)	10.00				
19-18	0 / 7623	-33.0	-33.0	0.48 (1)	10.00				
18-17	0 / 7623	-33.0	-33.0	0.48 (1)	10.00				
17-16	0 / 7623	-33.0	-33.0	0.48 (1)	10.00				
16-15	0 / 6071	-33.0	-33.0	0.38 (1)	10.00				
15-14	0 / 3340	-33.0	-33.0	0.22 (1)	10.00				
14-13	0 / 0	-33.0	-33.0	0.04 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
3	4-1-12	-241	-241	---	FRONT	VERT	TOTAL
10	32-8-4	-241	-241	---	FRONT	VERT	TOTAL

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
3	4-1-12	-241	-241	---	FRONT	VERT	TOTAL
10	32-8-4	-241	-241	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 4-1-12
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , CBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.23")
CALCULATED VERT. DEFL.(LL) = L/ 881 (0.50")
ALLOWABLE DEFL.(TL)= L/360 (1.23")
CALCULATED VERT. DEFL.(TL) = L/ 503 (0.88")

CSI: TC=0.99 (4-5:1) , BC=0.48 (18-20:1) ,
WB=0.86 (3-21:1) , SSI=0.36 (3-4:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (1
JSI METAL= 0.95


RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



**READ ALL NOTES ON THIS PAGE AND ON THE
ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE
IS AN INTEGRAL PART OF THIS DRAWING AS IT
CONTAINS SPECIFICATIONS AND CRITERIA USED
IN THE DESIGN OF THIS COMPONENT.**

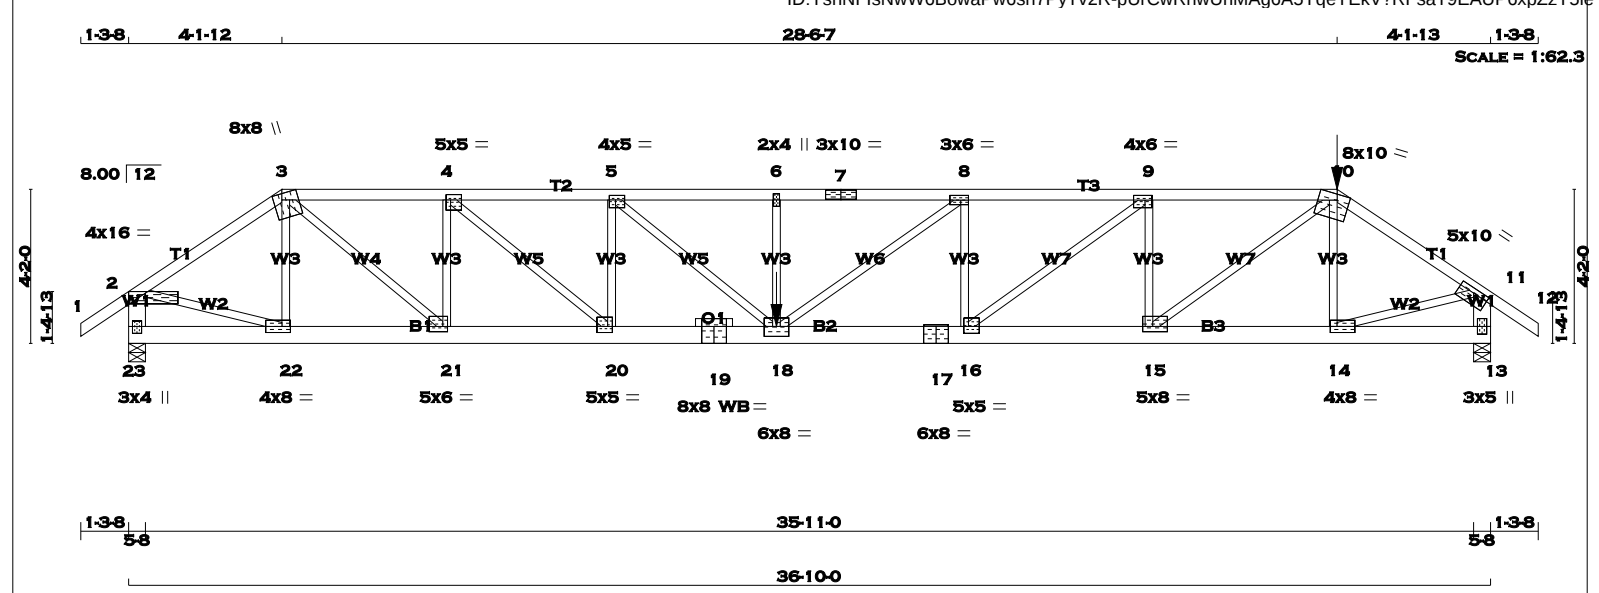

LUMBER N. L. G. A. RULES CHORDS SIZE 1 - 3 2x4 DRY No.2 SPF 3 - 7 2x4 DRY 1650F 1.5E SPF 7 - 10 2x4 DRY 1650F 1.5E SPF 10 - 12 2x4 DRY No.2 SPF 23 - 2 2x6 DRY No.2 SPF 13 - 11 2x6 DRY No.2 SPF 23 - 19 2x6 DRY 2100F 1.8E SPF 19 - 17 2x6 DRY 2100F 1.8E SPF 17 - 13 2x6 DRY 2100F 1.8E SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.			DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION JT VERT HORZ 23 2773 0 13 3066 0 MAXIMUM FACTORED GROSS REACTION DOWN HORZ 23 2773 0 13 3066 0 INPUT BRG UPLIFT IN-SX 5-8 5-8 5-8 REQRD BRG IN-SX 5-8 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL 23 1944 1374 / 0 0 / 0 0 / 0 570 / 0 0 / 0 13 2149 1517 / 0 0 / 0 0 / 0 633 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 23, 13 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.21 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE (LBS) MEMB. FR-TO 1-2 0 / 29 2-3 -3299 / 0 3-4 -5149 / 0 4-5 -7065 / 0 5-6 -8452 / 0 6-7 -8452 / 0 7-8 -8452 / 0 8-9 -7605 / 0 9-10 -5808 / 0 10-11 -3675 / 0 11-12 0 / 29 23-2 -2746 / 0 13-11 -3028 / 0 23-22 0 / 0 22-21 0 / 2726 21-20 0 / 5149 20-19 0 / 7065 19-18 0 / 7065 18-17 0 / 7605 17-16 0 / 7605 16-15 0 / 5809 15-14 0 / 3038 14-13 0 / 0 FACTORED VERT. LOAD (PLF) 1-2 -77.3 2-3 -77.3 3-4 -77.3 4-5 -77.3 5-6 -77.3 6-7 -110.1 7-8 -110.1 8-9 -110.1 9-10 -110.1 10-11 -77.3 11-12 -77.3 23-2 0.0 13-11 0.0 23-22 -17.5 22-21 -17.5 21-20 -17.5 20-19 -17.5 19-18 -17.5 18-17 -24.9 17-16 -24.9 16-15 -24.9 15-14 -24.9 14-13 -24.9 MAX. FACTORED VERT. LOAD (LC1) 1-2 0.11 2-3 0.47 3-4 0.41 4-5 0.60 5-6 0.76 6-7 0.98 7-8 0.98 8-9 0.93 9-10 0.70 10-11 0.52 11-12 0.11 23-2 0.20 13-11 0.22 23-22 0.02 22-21 0.17 21-20 0.31 20-19 0.48 19-18 0.48 18-17 0.51 17-16 0.51 16-15 0.36 15-14 0.20 14-13 0.04 WEBS MAX. FACTORED FORCE (LBS) MEMB. FR-TO 10-11 22-3 -534 / 0 11-12 3-21 0 / 3176 12-13 21-4 -2003 / 0 13-14 4-20 0 / 2516 14-15 20-5 -1500 / 0 15-16 5-18 0 / 1820 16-17 18-6 -450 / 0 17-18 18-8 0 / 1055 18-19 16-8 -1188 / 0 19-20 16-9 0 / 2257 20-21 15-9 -1967 / 0 21-22 14-10 0 / 3451 22-23 14-10 -558 / 0 23-24 2-22 0 / 2815 24-25 14-11 0 / 3136 MAX. FACTORED VERT. LOAD (LC1) 10-11 10.00 11-12 3.42 12-13 3.32 13-14 2.72 14-15 2.36 15-16 2.21 16-17 2.21 17-18 2.33 18-19 2.87 19-20 3.21 20-21 10.00 21-22 6.26 22-23 6.01 23-24 10.00 24-25 10.00 25-26 10.00 26-27 10.00 27-28 10.00 28-29 10.00 29-30 10.00 30-31 10.00 31-32 10.00 32-33 10.00 33-34 10.00 34-35 10.00 35-36 10.00 36-37 10.00 37-38 10.00 38-39 10.00 39-40 10.00 40-41 10.00 41-42 10.00 42-43 10.00 43-44 10.00 44-45 10.00 45-46 10.00 46-47 10.00 47-48 10.00 48-49 10.00 49-50 10.00 50-51 10.00 51-52 10.00 52-53 10.00 53-54 10.00 54-55 10.00 55-56 10.00 56-57 10.00 57-58 10.00 58-59 10.00 59-60 10.00 60-61 10.00 61-62 10.00 62-63 10.00 63-64 10.00 64-65 10.00 65-66 10.00 66-67 10.00 67-68 10.00 68-69 10.00 69-70 10.00 70-71 10.00 71-72 10.00 72-73 10.00 73-74 10.00 74-75 10.00 75-76 10.00 76-77 10.00 77-78 10.00 78-79 10.00 79-80 10.00 80-81 10.00 81-82 10.00 82-83 10.00 83-84 10.00 84-85 10.00 85-86 10.00 86-87 10.00 87-88 10.00 88-89 10.00 89-90 10.00 90-91 10.00 91-92 10.00 92-93 10.00 93-94 10.00 94-95 10.00 95-96 10.00 96-97 10.00 97-98 10.00 98-99 10.00 99-100 10.00 100-101 10.00 101-102 10.00 102-103 10.00 103-104 10.00 104-105 10.00 105-106 10.00 106-107 10.00 107-108 10.00 108-109 10.00 109-110 10.00 110-111 10.00 111-112 10.00 112-113 10.00 113-114 10.00 114-115 10.00 115-116 10.00 116-117 10.00 117-118 10.00 118-119 10.00 119-120 10.00 120-121 10.00 121-122 10.00 122-123 10.00 123-124 10.00 124-125 10.00 125-126 10.00 126-127 10.00 127-128 10.00 128-129 10.00 129-130 10.00 130-131 10.00 131-132 10.00 132-133 10.00 133-134 10.00 134-135 10.00 135-136 10.00 136-137 10.00 137-138 10.00 138-139 10.00 139-140 10.00 140-141 10.00 141-142 10.00 142-143 10.00 143-144 10.00 144-145 10.00 145-146 10.00 146-147 10.00 147-148 10.00 148-149 10.00 149-150 10.00 150-151 10.00 151-152 10.00 152-153 10.00 153-154 10.00 154-155 10.00 155-156 10.00 156-157 10.00 157-158 10.00 158-159 10.00 159-160 10.00 160-161 10.00 161-162 10.00 162-163 10.00 163-164 10.00 164-165 10.00 165-166 10.00 166-167 10.00 167-168 10.00 168-169 10.00 169-170 10.00 170-171 10.00 171-172 10.00 172-173 10.00 173-174 10.00 174-175 10.00 175-176 10.00 176-177 10.00 177-178 10.00 178-179 10.00 179-180 10.00 180-181 10.00 181-182 10.00 182-183 10.00 183-184 10.00 184-185 10.00 185-186 10.00 186-187 10.00 187-188 10.00 188-189 10.00 189-190 10.00 190-191 10.00 191-192 10.00 192-193 10.00 193-194 10.00 194-195 10.00 195-196 10.00 196-197 10.00 197-198 10.00 198-199 10.00 199-200 10.00 200-201 10.00 201-202 10.00 202-203 10.00 203-204 10.00 204-205 10.00 205-206 10.00 206-207 10.00 207-208 10.00 208-209 10.00 209-210 10.00 210-211 10.00 211-212 10.00 212-213 10.00 213-214 10.00 214-215 10.00 215-216 10.00 216-217 10.00 217-218 10.00 218-219 10.00 219-220 10.00 220-221 10.00 221-222 10.00 222-223 10.00 223-224 10.00 224-225 10.00 225-226 10.00 226-227 10.00 227-228 10.00 228-229 10.00 229-230 10.00 230-231 10.00 231-232 10.00 232-233 10.00 233-234 10.00 234-235 10.00 235-236 10.00 236-237 10.00 237-238 10.00 238-239 10.00 239-240 10.00 240-241 10.00 241-242 10.00 242-243 10.00 243-244 10.00 244-245 10.00 245-246 10.00 246-247 10.00 247-248 10.00 248-249 10.00 249-250 10.00 250-251 10.00 251-252 10.00 252-253 10.00 253-254 10.00 254-255 10.00 255-256 10.00 256-257 10.00 257-258 10.00 258-259 10.00 259-260 10.00 260-261 10.00 261-262 10.00 262-263 10.00 263-264 10.00 264-265 10.00 265-266 10.00 266-267 10.00 267-268 10.00 268-269 10.00 269-270 10.00 270-271 10.00 271-272 10.00 272-273 10.00 273-274 10.00 274-275 10.00 275-276 10.00 276-277 10.00 277-278 10.00 278-279 10.00 279-280 10.00 280-281 10.00 281-282 10.00 282-283 10.00 283-284 10.00 284-285 10.00 285-286 10.00 286-287 10.00 287-288 10.00 288-289 10.00 289-290 10.00 290-291 10.00 291-292 10.00 292-293 10.00 293-294 10.00 294-295 10.00 295-296 10.00 296-297 10.00 297-298 10.00 298-299 10.00 299-300 10.00 300-301 10.00 301-302 10.00 302-303 10.00 303-304 10.00 304-305 10.00 305-306 10.00 306-307 10.00 307-308 10.00 308-309 10.00 309-310 10.00 310-311 10.00 311-312 10.00 312-313 10.00 313-314 10.00 314-315 10.00 315-316 10.00 316-317 10.00 317-318 10.00 318-319 10.00 319-320 10.00 320-321 10.00 321-322 10.00 322-323 10.00 323-324 10.00 324-325 10.00 325-326 10.00 326-327 10.00 327-328 10.00 328-329 10.00 329-330 10.00 330-331 10.00 331-332 10.00 332-333 10.00 333-334 10.00 334-335 10.00 335-336 10.00 336-337 10.00 337-338 10.00 338-339 10.00 339-340 10.00 340-341 10.00 341-342 10.00 342-343 10.00 343-344 10.00 344-345 10.00 345-346 10.00 346-347 10.00 347-348 10.00 348-349 10.00 349-350 10.00 350-351 10.00 351-352 10.00 352-353 10.00 353-354 10.00 354-355 10.00 355-356 10.00 356-357 10.00 357-358 10.00 358-359 10.00 359-360 10.00 360-361 10.00 361-362 10.00 362-363 10.00 363-364 10.00 364-365 10.00 365-366 10.00 366-367 10.00 367-368 10.00 368-369 10.00 369-370 10.00 370-371 10.00 371-372 10.00 372-373 10.00 373-374 10.00 374-375 10.00 375-376 10.00 376-377 10.00 377-378 10.00 378-379 10.00 379-380 10.00 380-381 10.00 381-382 10.00 382-383 10.00 383-384 10.00 384-385 10.00 385-386 10.00 386-387 10.00 387-388 10.00 388-389 10.00 389-390 10.00 390-391 10.00 391-392 10.00 392-393 10.00 393-394 10.00 394-395 10.00 395-396 10.00 396-397 10.00 397-398 10.00 398-399 10.00 399-400 10.00 400-401 10.00 401-402 10.00 402-403 10.00 403-404 10.00 404-405 10.00 405-406 10.00 406-407 10.00 407-408 10.00 408-409 10.00 409-410 10.00 410-411 10.00 411-412 10.00 412-413 10.00 413-414 10.00 414-415 10.00 415-416 10.00 416-417 10.00 417-418 10.00 418-419 10.00 419-420 10.00 420-421 10.00 421-422 10.00 422-423 10.00 423-424 10.00 424-425 10.00 425-426 10.00 426-427 10.00 427-428 10.00 428-429 10.00 429-430 10.00 430-431 10.00 431-432 10.00 432-433 10.00 433-434 10.00 434-435 10.00 435-436 10.00 436-437 10.00 437-438 10.00 438-439 10.00 439-440 10.00 440-441 10.00 441-442 10.00 442-443 10.00 443-444 10.00 444-445 10.00 445-446 10.00 446-447 10.00 447-448 10.00 448-449 10.00 449-450 10.00 450-451 10.00 451-452 10.00 452-453 10.00 453-454 10.00 454-455 10.00 455-456 10.00 456-457 10.00 457-458 10.00 458-459 10.00 459-460 10.00 460-461 10.00 461-462 10.00 462-463 10.00 463-464 10.00 464-465 10.00 465-466 10.00 466-467 10.00 467-468 10.00 468-469 10.00 469-470 10.00 470-471 10.00 471-472 10.00 472-473 10.00 473-474 10.00 474-475 10.00 475-476 10.00 476-477 10.00 477-478 10.00 478-479 10.00 479-480 10.00 480-481 10.00 481-482 10.00 482-483 10.00 483-484 10.00 484-485 10.00 485-486 10.00 486-487 10.00 487-488 10.00 488-489 10.00 489-490 10.00 490-491 10.00 491-492 10.00 492-493 10.00 493-494 10.00 494-495 10.00 495-496 10.00 496-497 10.00 497-498 10.00 498-499 10.00 499-500 10.00 500-501 10.00 501-502 10.00 502-503 10.00 503-504 10.00 504-505 10.00 505-506 10.00 506-507 10.00 507-508 10.00 508-509 10.00 509-510 10.00 510-511 10.00 511-512 10.00 512-513 10.00 513-514 10.00 514-515 10.00 515-516 10.00 516-517 10.00 517-518 10.00 518-519 10.00 519-520 10.00 520-521 10.00 521-522 10.00 522-523 10.00 523-524 10.00 524-525 10.00 525-526 10.00 526-527 10.00 527-528 10.00 528-529 10.00 529-530 10.00 530-531 10.00 531-532 10.00 532-533 10.00 533-534 10.00 534-535 10.00 535-536 10.00 536-537 10.00 537-538 10.00 538-539 10.00 539-540 10.00 540-541 10.00 541-542 10.00 542-543 10.00 543-544 10.00 544-545 10.00 545-546 10.00 546-547 10.00 547-548 10.00 548-549 10.00 549-550 10.00 550-551 10.00 551-552 10.00 552-553 10.00 553-554 10.00 554-555 10.00 555-556 10.00 556-557 10.00 557-558 10.00 558-559 10.00 559-560 10.00 560-561 10.00 561-562 10.00 562-563 10.00 563-564 10.00 564-565 10.00 565-566 10.00 566-567 10.00 567-568 10.00 568-569 10.00 569-570 10.00 570-571 10.00 571-572 10.00 572-573 10.00 573-574 10.00 574-575 10.00 575-576 10.00 576-577 10.00 577-578 10.00 578-579 10.00 579-580 10.00 580-581 10.00 581-582 10.00 582-583 10.00 583-584 10.00 584-585 10.00 585-586 10.00 586-587 10.00 587-588 10.00 588-589 10.00 589-590 10.00 590-591 10.00 591-592 10.00 592-593 10.00 593-594 10.00 594-595 10.00 595-596 10.00 596-597 10.00 597-598 10.00 598-599 10.00 599-600 10.00 600-601 10.00 601-602 10.00 602-603 10.00 603-604 10.00 604-605 10.00 605-606 10.00 606-607 10.00 607-608 10.00 608-609 10.00 609-610 10.00 610-611 10.00 611-612 10.00 612-613 10.00 613-614 10.00 614-615 10.00 615-616 10.00 616-617 10.00 617-618 10.00 618-619 10.00 619-620 10.00 620-621 10.00 621-622 10.00 622-623 10.00 623-624 10.00 624-625 10.00 625-626 10.00 626-627 10.00 627-628 10.00 628-629 10.00 629-630 10.00 630-631 10.00 631-632 10.00 632-633 10.00 633-634 10.00 634-635 10.00 635-636 10.00 636-637 10.00 637-638 10.00 638-639 10.00 639-640 10.00 640-641 10.00 641-642 10.00 642-643 10.00 643-644 10.00 644-645 10.00 645-646 10.00 646-647 10.00 647-648 10.00 648-649 10.00 649-650 10.00 650-651 10.00 651-652 10.00 652-653 10.00 653-654 10.00 654-655 10.00 655-656 10.00 656-657 10.00 657-658 10.00 658-659 10.00 659-660 10.00 660-661 10.00 661-662 10.00 662-663 10.00 663-664 10.00 664-665 10.00 665-666 10.00 666-667 10.00 667-668 10.00 668-669 10.00 669-670 10.00 670-671 10.00 671-672 10.00 672-673 10.00 673-674 10.00 674-675 10.00 675-676 10.00 676-677 10.00 677-678 10.00 678-679 1
--	--	--	---



[M]

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

PLATES (table is in inches)

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
4	1352	0	1352	0	0	HANGER BY OTHERS MIN. SEAT SIZE: 3-8	
6	1352	0	1352	0	0	5-8	

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
4	949	664 / 0	0 / 0	0 / 0	0 / 0	285 / 0	0 / 0
6	949	664 / 0	0 / 0	0 / 0	0 / 0	285 / 0	0 / 0

BRACING

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LO. CSI (LC)	MAX. UNBRAC LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO			
1-2	-1152 / 0	-77.3	-77.3	0.11 (1)	5.78	5-2	0 / 1033	0.26 (1)
2-3	-9 / 0	-77.3	-77.3	0.09 (1)	10.00	2-4	-1304 / 0	0.32 (1)
4-3	-95 / 0	0.0	0.0	0.02 (1)	7.81	1-5	0 / 1073	0.27 (1)
6-1	-883 / 0	0.0	0.0	0.10 (1)	7.81			
6-5	0 / 0	-373.2	-373.2	0.22 (1)	10.00			
5-4	0 / 1039	-373.2	-373.2	0.35 (1)	10.00			

MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
R-TO		
5-2	0 / 1033	0.26 (1)
2-4	-1304 / 0	0.32 (1)
1-5	0 / 1073	0.27 (1)

SPECIFIED LOADS:				
TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.0	PSF
TOTAL LOAD		=	33.3	PSF

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 17-5-8
END DISTANCE = 6-0-0
END SPAN CARRIED = 17-5-8
END WALL WIDTH = 5-8
APPLIED TO FRONT SIDE OF BOTTOM CHORD.
- ADD'L LOADS BASED ON 55 % OF GSL.

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (1) (INPUT = 0.90)
JSI METAL= 0.39 (2) (INPUT = 1.00)



RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



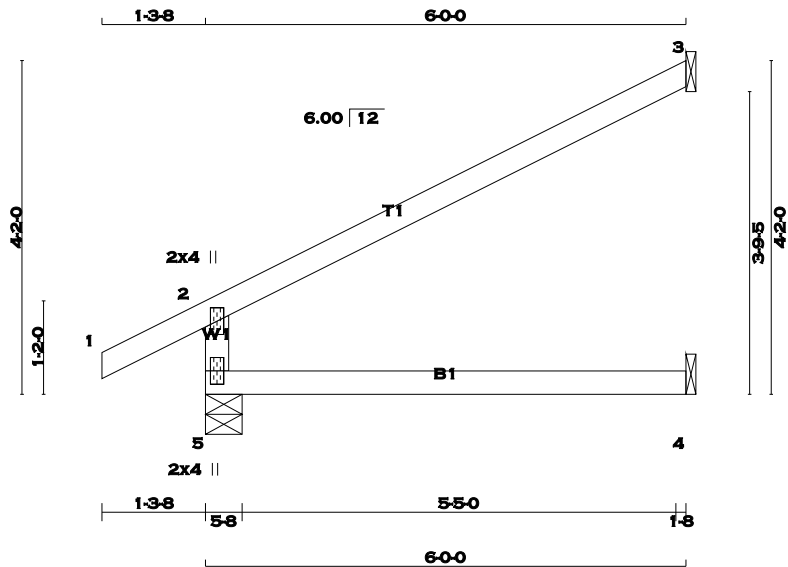

SCALE = 1:28.8

TOTAL WEIGHT = 27 X 17 = 462 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
5 - 2	2x4	DRY	No.2	SPF
1 - 3	2x4	DRY	No.2	SPF
5 - 4	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
5	457	0	457	0	0	5-8	5-8
3	174	0	174	0	0	1-8	1-8
4	43	0	49	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3 , 4

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
5	318	238 / 0	0 / 0	0 / 0	0 / 0	80 / 0	0 / 0
3	118	105 / 0	0 / 0	0 / 0	0 / 0	14 / 0	0 / 0
4	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
5-2	-395 / 0	0.0	0.0	0.13 (4)		7.81	
1-2	0 / 23	-77.3	-77.3	0.10 (1)		10.00	
2-3	-26 / 0	-77.3	-77.3	0.47 (1)		6.25	
5-4	0 / 0	-17.5	-17.5	0.13 (4)		10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03")

CSI: TC=0.47 (2-3:1) , BC=0.13 (4-5:4) , WB=0.00 (n/a:0) , SSI=0.20 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.23 (2) (INPUT = 0.90)
JSI METAL= 0.09 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



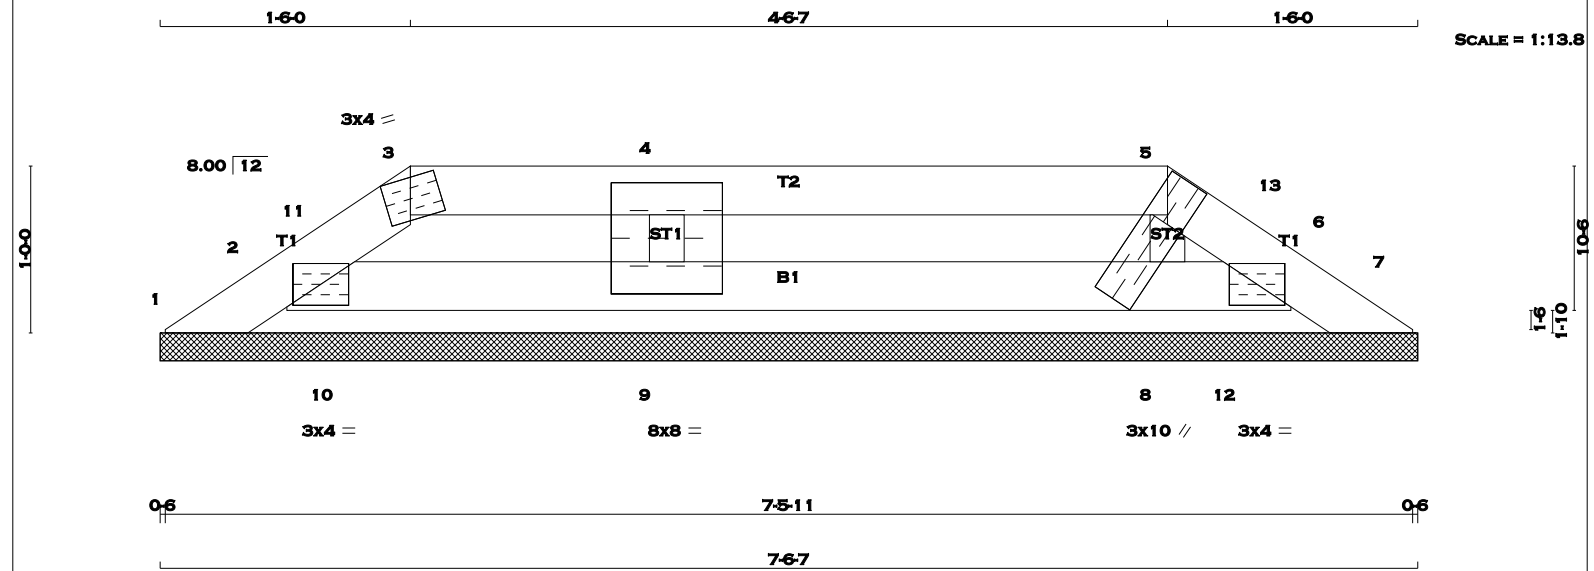

TOTAL WEIGHT = 2 X 17 = 33 lb [M]

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF
3 - 5	2x4	DRY	No.2	SPF
5 - 7	2x4	DRY	No.2	SPF
2 - 6	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 3-0-0 OC.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMB1-l	MT20	3.0	4.0	
3	TT-m	MT20	3.0	4.0	Edge
4, 5, 8, 9					
4					
6	TMB1-l	MT20	3.0	4.0	
8	TTBW1*+h	MT20	3.0	10.0	3.50 3.75
9	TMBMW1-l	MT20	8.0	8.0	
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.					
A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): 8 , 9
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	
FR-TO		FROM TO		FR-TO			
1-2	0 / 10	-94.8 -94.8	0.02 (1)	10.00	8-5	-80 / 0	0.01 (1)
2-11	-62 / 0	-77.3 -77.3	0.02 (1)	6.25	9-4	-240 / 0	0.03 (1)
11-3	-46 / 0	-77.3 -77.3	0.01 (1)	6.25	10-11	-6 / 17	0.00 (1)
3-4	-33 / 0	-77.3 -77.3	0.09 (1)	6.25	12-13	-35 / 0	0.00 (1)
4-5	-33 / 0	-77.3 -77.3	0.09 (1)	6.25			
5-13	-45 / 0	-77.3 -77.3	0.01 (4)	6.25			
13-6	-42 / 0	-77.3 -77.3	0.01 (4)	6.25			
6-7	0 / 2	-94.8 -94.8	0.01 (1)	10.00			
2-10	0 / 33	-17.5 -17.5	0.01 (1)	10.00			
10-9	0 / 33	-17.5 -17.5	0.03 (4)	10.00			
9-8	0 / 33	-17.5 -17.5	0.03 (4)	10.00			
8-12	0 / 33	-17.5 -17.5	0.03 (4)	10.00			
12-6	0 / 33	-17.5 -17.5	0.01 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.09 (4-5:1) , BC=0.03 (9-10:4) , WB=0.03 (4-9:1) , SSI=0.11 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.30 (8) (INPUT = 0.90)
JSI METAL= 0.02 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



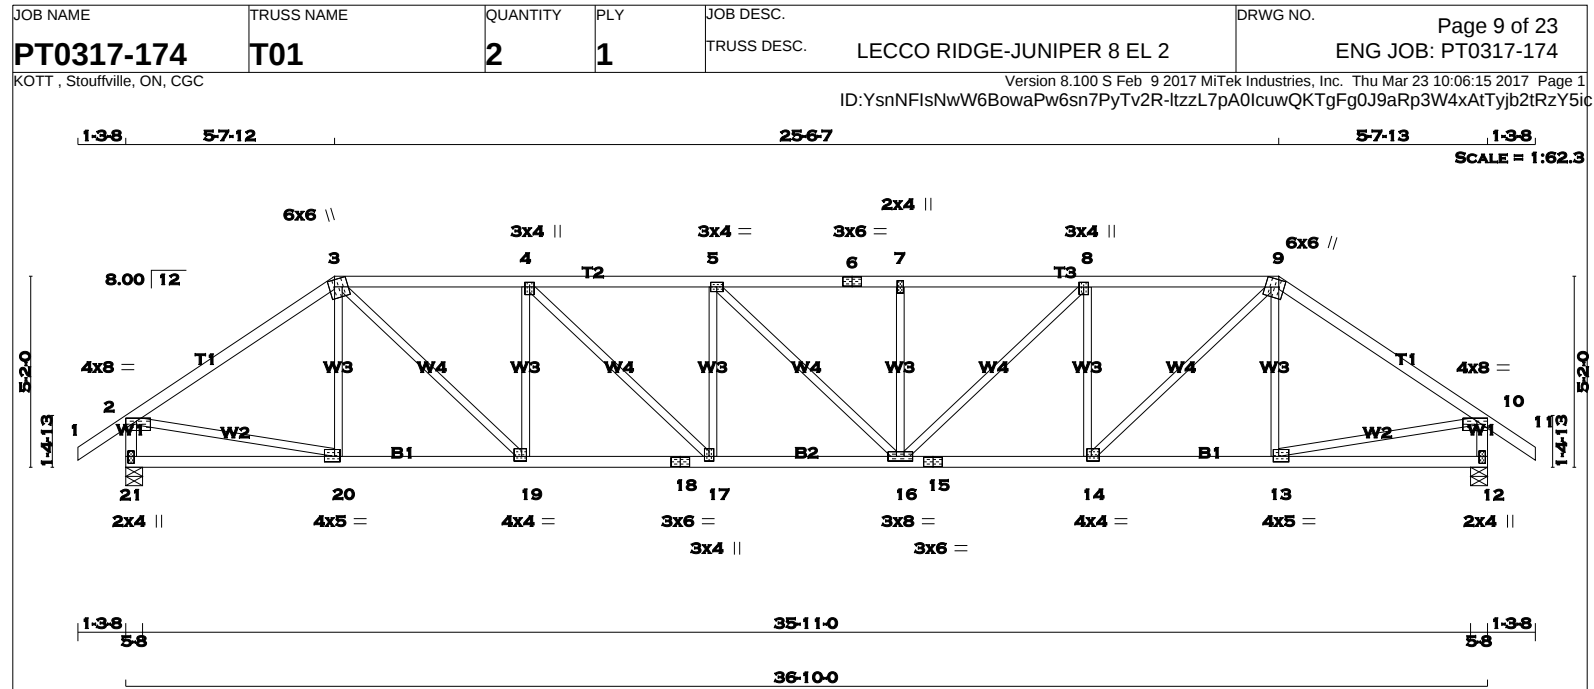


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. 1 - 3 2x4 DRY No.2 SPF 3 - 6 2x4 DRY No.2 SPF 6 - 9 2x4 DRY No.2 SPF 9 - 11 2x4 DRY No.2 SPF 21 - 2 2x4 DRY No.2 SPF 12 - 10 2x4 DRY No.2 SPF 21 - 18 2x4 DRY No.2 SPF 18 - 15 2x4 DRY No.2 SPF 15 - 12 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQRD JT VERT HORZ DOWN HORZ UPLIFT IN-SX BRG IN-SX 21 1853 0 1853 0 0 5-8 5-8 12 1853 0 1853 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL 21 1298 921 / 0 0 / 0 0 / 0 377 / 0 0 / 0 12 1298 921 / 0 0 / 0 0 / 0 377 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 21, 12 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.48 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MAX. FACTORED MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. FORCE MAX. (LBS) (PLF) CSI (LC) UNBRAC (LBS) CSI (LC) FR-TO FROM TO LENGTH FR-TO 1-2 0 / 29 -77.3 -77.3 0.10 (1) 10.00 20-3 -216 / 25 0.09 (1) 2-3 -2088 / 0 -77.3 -77.3 0.60 (1) 4.09 3-19 0 / 1445 0.33 (1) 3-4 -2783 / 0 -77.3 -77.3 0.44 (1) 3.79 19-4 -908 / 0 0.36 (1) 4-5 -3272 / 0 -77.3 -77.3 0.50 (1) 3.48 4-17 0 / 678 0.15 (1) 5-6 -3271 / 0 -77.3 -77.3 0.41 (1) 3.59 17-5 -380 / 0 0.15 (1) 6-7 -3271 / 0 -77.3 -77.3 0.41 (1) 3.59 5-16 -2 / 0 0.00 (1) 7-8 -3271 / 0 -77.3 -77.3 0.50 (1) 3.48 16-7 -380 / 0 0.15 (1) 8-9 -2783 / 0 -77.3 -77.3 0.44 (1) 3.78 16-8 0 / 676 0.15 (1) 9-10 -2088 / 0 -77.3 -77.3 0.60 (1) 4.09 14-8 -907 / 0 0.36 (1) 10-11 0 / 29 -77.3 -77.3 0.10 (1) 10.00 14-9 0 / 1445 0.33 (1) 21-2 -1812 / 0 0.0 0.0 0.19 (1) 6.21 13-9 -216 / 25 0.09 (1) 12-10 -1812 / 0 0.0 0.0 0.19 (1) 6.21 2-20 0 / 1765 0.40 (1) 21-20 0 / 0 -17.5 -17.5 0.13 (4) 10.00 20-19 0 / 1730 -17.5 -17.5 0.35 (1) 10.00 19-18 0 / 2783 -17.5 -17.5 0.49 (1) 10.00 18-17 0 / 2783 -17.5 -17.5 0.49 (1) 10.00 17-16 0 / 3272 -17.5 -17.5 0.57 (1) 10.00 16-15 0 / 2784 -17.5 -17.5 0.49 (1) 10.00 15-14 0 / 2784 -17.5 -17.5 0.49 (1) 10.00 14-13 0 / 1730 -17.5 -17.5 0.35 (1) 10.00 13-12 0 / 0 -17.5 -17.5 0.13 (4) 10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (1.23") CALCULATED VERT. DEFL.(LL)= L/ 999 (0.22") ALLOWABLE DEFL.(TL)= L/360 (1.23") CALCULATED VERT. DEFL.(TL)= L/ 999 (0.38") CSI: TC=0.60 (2-3:1), BC=0.57 (16-17:1), WB=0.40 (2-20:1), SSI=0.19 (8-9:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.88 (4) (INPUT = 0.90) JSI METAL= 0.71 (15) (INPUT = 1.00)			
---	--	--	--	---	--	--	--	--	--	--	--



READ ALL NOTES ON THIS PAGE AND ON THE
ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE
IS AN INTEGRAL PART OF THIS DRAWING AS IT
CONTAINS SPECIFICATIONS AND CRITERIA USED
IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



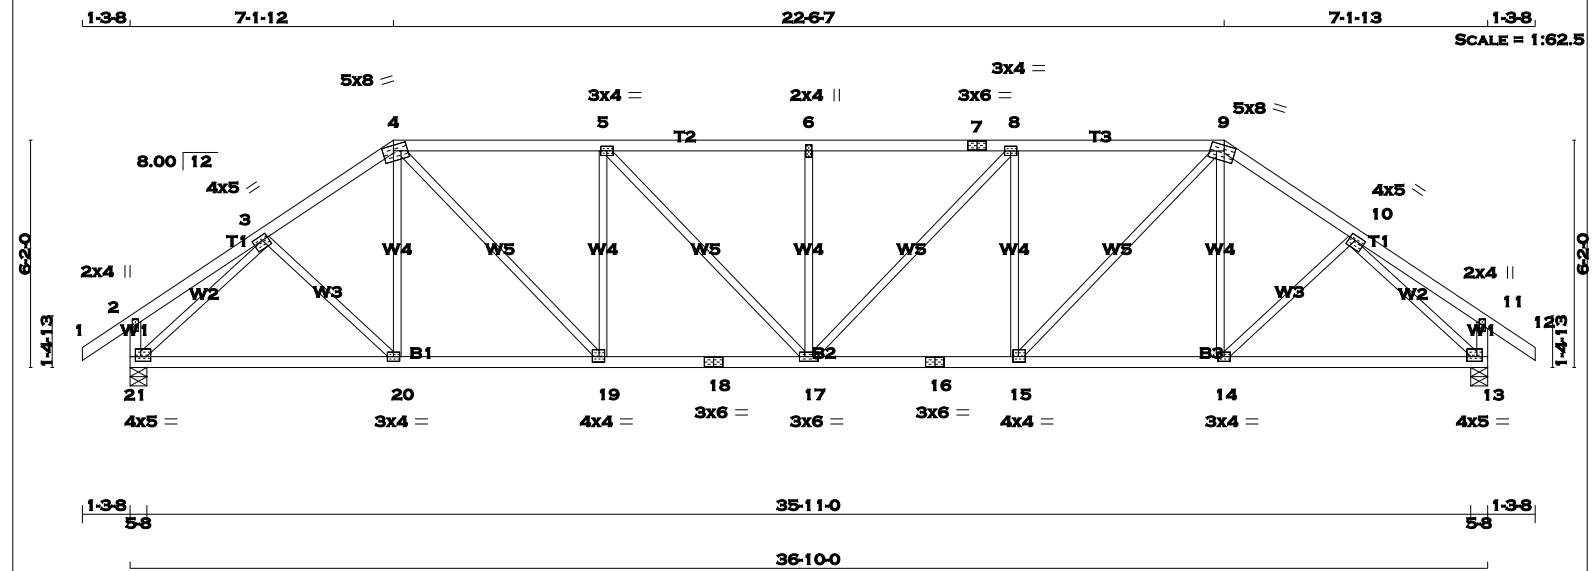


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR.					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA				
					BEARINGS														
					FACTORED					MAXIMUM FACTORED					INPUT REQRD				
					GROSS REACTION					GROSS REACTION					BRG BRG				
					JT VERT HORZ					DOWN HORZ UPLIFT IN-SX IN-SX									
1 - 4 2x4 DRY No.2 SPF					21 1853 0 1853 0 0 5-8 5-8														
4 - 7 2x4 DRY No.2 SPF					13 1853 0 1853 0 0 5-8 5-8														
7 - 9 2x4 DRY No.2 SPF																			
9 - 12 2x4 DRY No.2 SPF																			
21 - 2 2x4 DRY No.2 SPF																			
13 - 11 2x4 DRY No.2 SPF																			
21 - 18 2x4 DRY No.2 SPF																			
18 - 16 2x4 DRY No.2 SPF																			
16 - 13 2x4 DRY No.2 SPF																			
ALL WEBS 2x3 DRY No.2 SPF																			
EXCEPT																			
DRY: SEASONED LUMBER.																			



READ ALL NOTES ON THIS PAGE AND ON THE
ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE
IS AN INTEGRAL PART OF THIS DRAWING AS IT
CONTAINS SPECIFICATIONS AND CRITERIA USED
IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



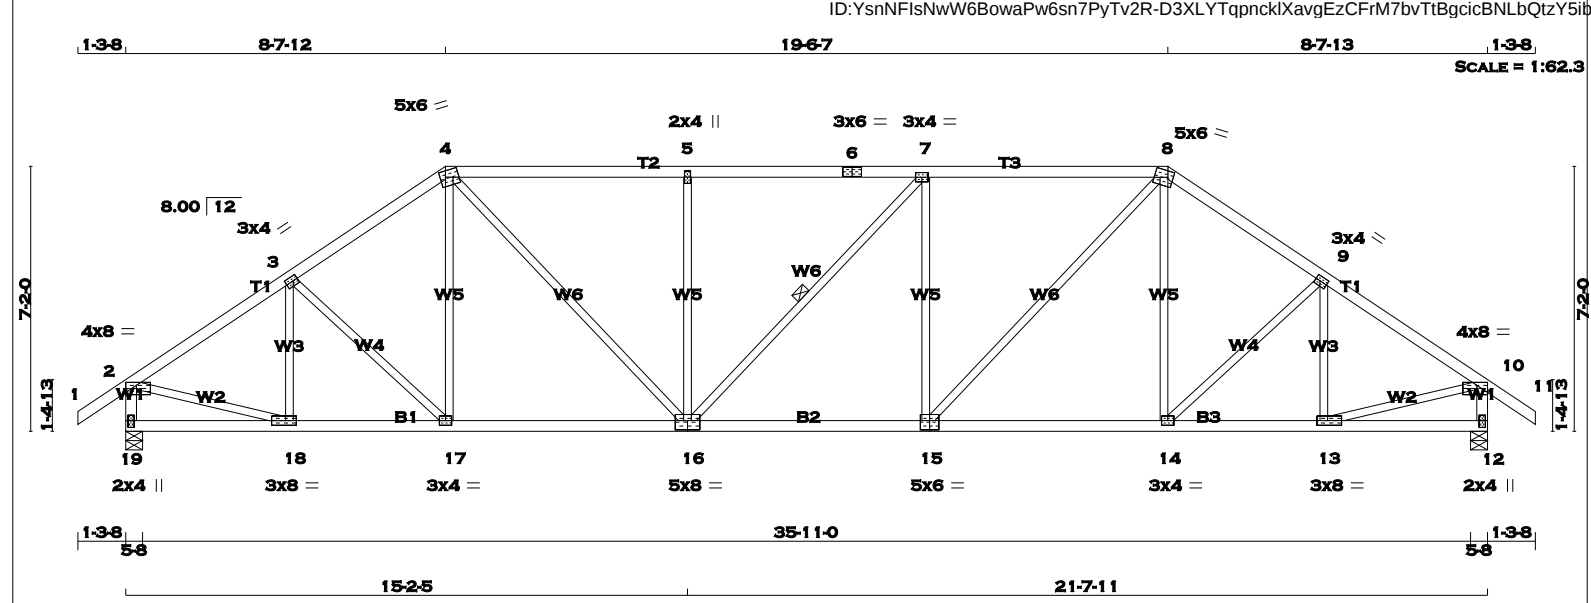


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. 1 - 4 2x4 DRY No.2 SPF 4 - 6 2x4 DRY No.2 SPF 6 - 8 2x4 DRY No.2 SPF 8 - 11 2x4 DRY No.2 SPF 19 - 2 2x4 DRY No.2 SPF 12 - 10 2x4 DRY No.2 SPF 19 - 16 2x4 DRY No.2 SPF 16 - 15 2x4 DRY No.2 SPF 15 - 12 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQRD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX 19 1853 0 1853 0 0 5-8 5-8 12 1853 0 1853 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL 19 1298 921 / 0 0 / 0 0 / 0 377 / 0 0 / 0 12 1298 921 / 0 0 / 0 0 / 0 377 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 19, 12 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. 1 - 2x3 SPF No.2 LATERAL BRACE(S) AT 1/2 LENGTH OF 7-16. DBS = 20-0-0 . CBF = 0 LBS. DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE. FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) C H O R D S MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. LC1 (LC) MAX. UNBRAC LENGTH FR-TO FR-TO 1-2 0 / 29 -77.3 -77.3 0.10 (1) 10.00 18-3 -352 / 0 0.10 (1) 2-3 -2060 / 0 -77.3 -77.3 0.31 (1) 4.43 3-17 -55 / 0 0.03 (1) 3-4 -2057 / 0 -77.3 -77.3 0.31 (1) 4.44 17-4 0 / 140 0.04 (4) 4-5 -2321 / 0 -77.3 -77.3 0.64 (1) 3.87 4-16 0 / 910 0.20 (1) 5-6 -2321 / 0 -77.3 -77.3 0.64 (1) 3.86 16-5 -545 / 0 0.49 (1) 6-7 -2321 / 0 -77.3 -77.3 0.64 (1) 3.86 16-7 -2 / 0 0.00 (1) 7-8 -2322 / 0 -77.3 -77.3 0.65 (1) 3.86 15-7 -545 / 0 0.49 (1) 8-9 -2057 / 0 -77.3 -77.3 0.31 (1) 4.44 15-8 0 / 912 0.21 (1) 9-10 -2060 / 0 -77.3 -77.3 0.31 (1) 4.43 14-8 0 / 139 0.04 (4) 10-11 0 / 29 -77.3 -77.3 0.10 (1) 10.00 14-9 -55 / 0 0.03 (1) 19-2 -1817 / 0 0.0 0.0 0.19 (1) 6.21 13-9 -352 / 0 0.10 (1) 12-10 -1817 / 0 0.0 0.0 0.19 (1) 6.21 2-18 0 / 1782 0.40 (1) 13-10 0 / 1782 0.40 (1) 19-18 0 / 0 -17.5 -17.5 0.07 (4) 10.00 18-17 0 / 1731 -17.5 -17.5 0.35 (1) 10.00 17-16 0 / 1693 -17.5 -17.5 0.34 (1) 10.00 16-15 0 / 2322 -17.5 -17.5 0.45 (1) 10.00 15-14 0 / 1693 -17.5 -17.5 0.35 (1) 10.00 14-13 0 / 1731 -17.5 -17.5 0.34 (1) 10.00 13-12 0 / 0 -17.5 -17.5 0.07 (4) 10.00 W E B S MEMB. MAX. FACTORED FORCE (LBS) MAX. CSI (LC) FR-TO 18-3 -352 / 0 0.10 (1) 3-17 -55 / 0 0.03 (1) 17-4 0 / 140 0.04 (4) 4-16 0 / 910 0.20 (1) 16-5 -545 / 0 0.49 (1) 16-7 -2 / 0 0.00 (1) 15-7 -545 / 0 0.49 (1) 15-8 0 / 912 0.21 (1) 14-8 0 / 139 0.04 (4) 14-9 -55 / 0 0.03 (1) 13-9 -352 / 0 0.10 (1) 2-18 0 / 1782 0.40 (1) 13-10 0 / 1782 0.40 (1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (4) (INPUT = 0.90) JSI METAL= 0.50 (15) (INPUT = 1.00)				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (1.23") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.13") ALLOWABLE DEFL.(TL)= L/360 (1.23") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.24") CSI: TC=0.65 (7-8:1) , BC=0.45 (15-16:1) , WB=0.49 (7-15:1) , SSI=0.24 (7-8:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.89 (4) (INPUT = 0.90) JSI METAL= 0.50 (15) (INPUT = 1.00)
--	--	--	--	---	--	--	--	---




READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION





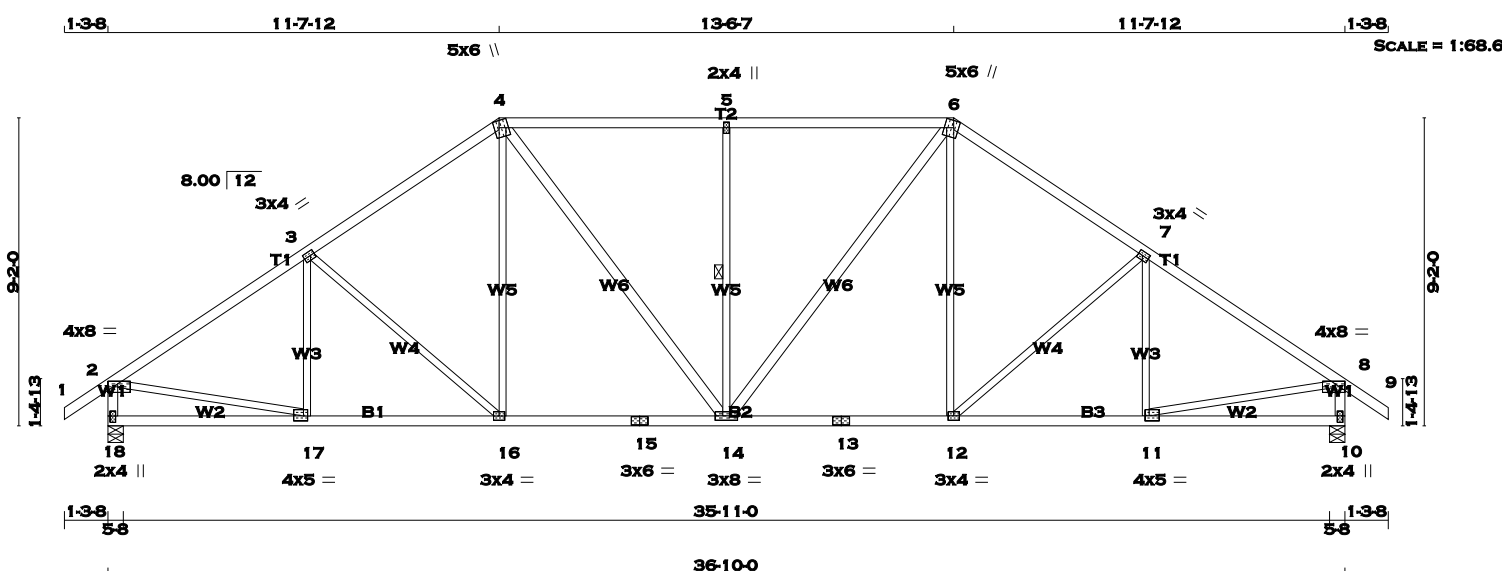

TOTAL WEIGHT = 2 X 170 = 340 lb
[M][F]

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
1 - 4	2x4	DRY	No.2	SPF
4 - 6	2x4	DRY	No.2	SPF
6 - 9	2x4	DRY	No.2	SPF
18 - 2	2x4	DRY	No.2	SPF
10 - 8	2x4	DRY	No.2	SPF
18 - 15	2x4	DRY	No.2	SPF
15 - 13	2x4	DRY	No.2	SPF
13 - 10	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
4 - 14	2x4	DRY	No.2	SPF
14 - 6	2x4	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMVW-p	MT20	4.0	8.0	1.00 3.50
3	TMVW-t	MT20	3.0	4.0	1.50 1.50
4	TTWW+m	MT20	5.0	6.0	Edge 1.75
5	TMVW+w	MT20	2.0	4.0	
6	TTWW+m	MT20	5.0	6.0	Edge 1.75
7	TMVW-t	MT20	3.0	4.0	1.50 1.50
8	TMVW-p	MT20	4.0	8.0	1.00 3.50
10	BMV1+p	MT20	2.0	4.0	2.25 1.00
11	BMVW-t	MT20	4.0	5.0	1.75 1.50
12	BMVW-t	MT20	3.0	4.0	
13	BS-t	MT20	3.0	6.0	
14	BMVW-t	MT20	3.0	8.0	
15	BS-t	MT20	3.0	6.0	
16	BMVW-t	MT20	3.0	4.0	
17	BMVW-t	MT20	4.0	5.0	1.75 1.50
18	BMV1+p	MT20	2.0	4.0	2.25 1.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
18	1853	0	1853	0	5-8
10	1853	0	1853	0	5-8

UNFACTORED REACTIONS						
JT	1ST LCASE	MAX/MIN.	SNOW	LIVE	PERM.LIVE	WIND
18	1298	921 / 0	0 / 0	0 / 0	0 / 0	377 / 0
10	1298	921 / 0	0 / 0	0 / 0	0 / 0	377 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 18, 10

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 - 2x3 SPF No.2 LATERAL BRACE(S) AT 1/2 LENGTH OF 5-14. DBS = 20-0-0 . CBF = 80 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE. FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
1-2	0 / 29	-77.3 -77.3	0.10 (1)	10.00	17-3	-219 / 31	0.09 (1)
2-3	-2131 / 0	-77.3 -77.3	0.44 (1)	4.25	3-16	-296 / 0	0.36 (1)
3-4	-1924 / 0	-77.3 -77.3	0.41 (1)	4.46	16-4	0 / 303	0.07 (1)
4-5	-1868 / 0	-77.3 -77.3	0.53 (1)	4.33	4-14	0 / 480	0.08 (1)
5-6	-1868 / 0	-77.3 -77.3	0.53 (1)	4.33	14-5	-643 / 0	0.35 (1)
6-7	-1924 / 0	-77.3 -77.3	0.41 (1)	4.46	14-6	0 / 480	0.08 (1)
7-8	-2131 / 0	-77.3 -77.3	0.44 (1)	4.25	12-6	0 / 303	0.07 (1)
8-9	0 / 29	-77.3 -77.3	0.10 (1)	10.00	12-7	-296 / 0	0.36 (1)
18-2	-1809 / 0	0.0 0.0	0.19 (1)	6.22	11-7	-219 / 31	0.09 (1)
10-8	-1809 / 0	0.0 0.0	0.19 (1)	6.22	2-17	0 / 1827	0.41 (1)
					11-8	0 / 1827	0.41 (1)
18-17	0 / 0	-17.5 -17.5	0.14 (4)	10.00			
17-16	0 / 1798	-17.5 -17.5	0.36 (1)	10.00			
16-15	0 / 1577	-17.5 -17.5	0.34 (1)	10.00			
15-14	0 / 1577	-17.5 -17.5	0.34 (1)	10.00			
14-13	0 / 1577	-17.5 -17.5	0.34 (1)	10.00			
13-12	0 / 1577	-17.5 -17.5	0.34 (1)	10.00			
12-11	0 / 1798	-17.5 -17.5	0.36 (1)	10.00			
11-10	0 / 0	-17.5 -17.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.23")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (1.23")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.19")

CSI: TC=0.53 (4-5:1) , BC=0.36 (16-17:1) , WB=0.41 (2-17:1) , SSI=0.25 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
(PSI)	(PLI)	(PLI)	(PLI)	MAX	MIN
MT20	618	354	1667	822	2284

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (2) (INPUT = 0.90)
JSI METAL= 0.54 (11) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



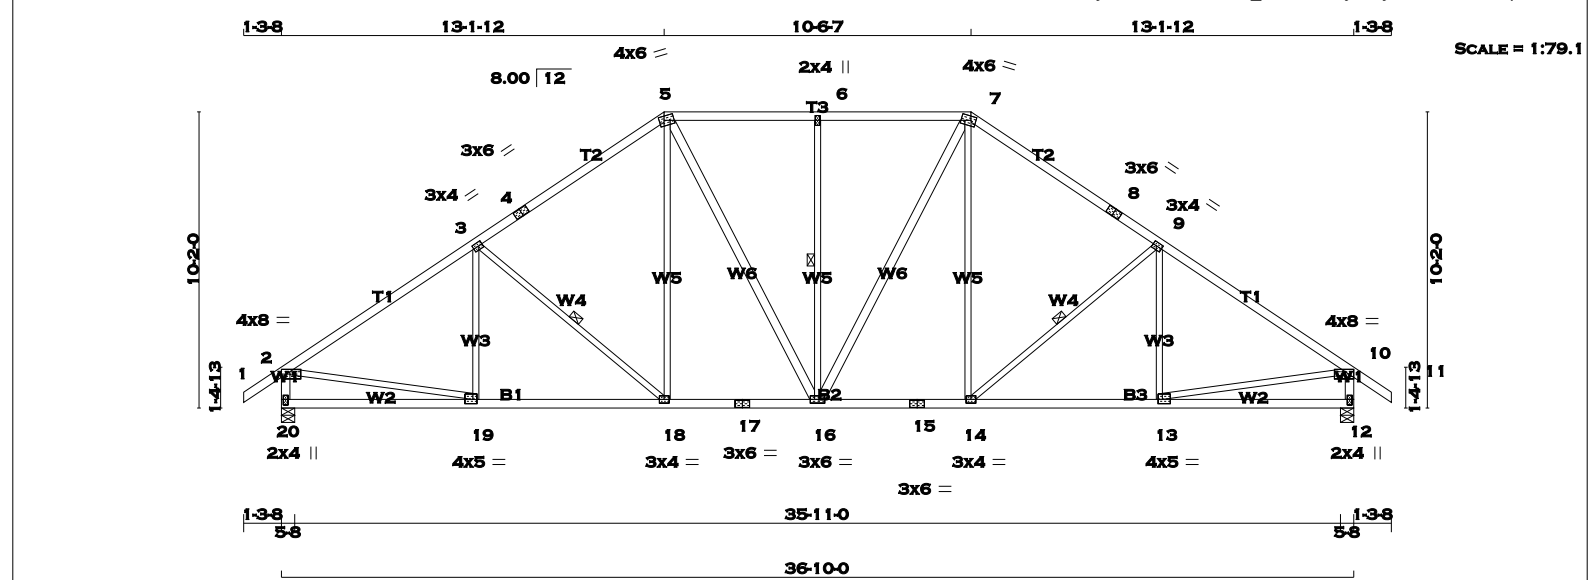


LUMBER
N. L. G. A. RULES
CHORDS SIZE
1 - 4 2x4 DRY No.2
4 - 5 2x4 DRY No.2
5 - 7 2x4 DRY No.2
7 - 8 2x4 DRY No.2
8 - 11 2x4 DRY No.2
20 - 2 2x4 DRY No.2
12 - 10 2x4 DRY No.2
20 - 17 2x4 DRY No.2
17 - 15 2x4 DRY No.2
15 - 12 2x4 DRY No.2
ALL WEBS 2x3 DRY No.2
EXCEPT
5 - 16 2x4 DRY No.2
16 - 7 2x4 DRY No.2
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
FACTORED GROSS REACTION
JT VERT HORZ
20 1853 0
12 1853 0
MAXIMUM FACTORED GROSS REACTION
DOWN HORZ UPLIFT
20 1853 0 0
12 1853 0 0
INPUT BRG IN-SX
5-8 5-8
5-8 5-8
REQRD BRG IN-SX
5-8 5-8
5-8 5-8
UNFACTORED REACTIONS
1ST LCASE MAX/MIN. COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
20 1298 921 / 0 0 / 0 0 / 0 377 / 0 0 / 0
12 1298 921 / 0 0 / 0 0 / 0 377 / 0 0 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 20, 12
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 - 2x3 SPF No.2 LATERAL BRACE(S) AT 1/2 LENGTH OF 3-18, 6-16, 9-14. DBS = 20-0-0. CBF = 62 LBS.
DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE. FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW
LOADING
TOTAL LOAD CASES: (4)
C H O R D S
MAX. FACTORED FORCE (LBS)
MEMB. VERT. LOAD LC1 MAX. FACTORED (PLF) CSI (LC)
W E B S
MAX. FACTORED FORCE (LBS)
MEMB. MAX. FACTORED (PLF) CSI (LC)
FR-TO FROM TO LENGTH FR-TO FROM TO LENGTH
1-2 0 / 29 -77.3 -77.3 0.10 (1) 10.00 19-3 -164 / 63 0.09 (1)
2-3 -2144 / 0 -77.3 -77.3 0.59 (1) 4.08 3-18 -409 / 0 0.21 (1)
3-4 -1838 / 0 -77.3 -77.3 0.53 (1) 4.39 18-5 0 / 366 0.08 (1)
4-5 -1838 / 0 -77.3 -77.3 0.53 (1) 4.39 5-16 0 / 329 0.05 (1)
5-6 -1658 / 0 -77.3 -77.3 0.31 (1) 4.84 16-6 -496 / 0 0.35 (1)
6-7 -1658 / 0 -77.3 -77.3 0.31 (1) 4.84 16-7 0 / 329 0.05 (1)
7-8 -1838 / 0 -77.3 -77.3 0.53 (1) 4.39 14-7 0 / 366 0.08 (1)
8-9 -1838 / 0 -77.3 -77.3 0.53 (1) 4.39 14-9 -409 / 0 0.21 (1)
9-10 -2144 / 0 -77.3 -77.3 0.59 (1) 4.08 13-9 -164 / 63 0.09 (1)
10-11 0 / 29 -77.3 -77.3 0.10 (1) 10.00 2-19 0 / 1836 0.41 (1)
20-2 -1805 / 0 0.0 0.0 0.19 (1) 6.23 13-10 0 / 1836 0.41 (1)
12-10 -1805 / 0 0.0 0.0 0.19 (1) 6.23
20-19 0 / 0 -17.5 -17.5 0.19 (4) 10.00
19-18 0 / 1812 -17.5 -17.5 0.38 (1) 10.00
18-17 0 / 1503 -17.5 -17.5 0.31 (1) 10.00
17-16 0 / 1503 -17.5 -17.5 0.31 (1) 10.00
16-15 0 / 1503 -17.5 -17.5 0.31 (1) 10.00
15-14 0 / 1503 -17.5 -17.5 0.31 (1) 10.00
14-13 0 / 1812 -17.5 -17.5 0.38 (1) 10.00
13-12 0 / 0 -17.5 -17.5 0.19 (4) 10.00
A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010
THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011
(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL)= L/360 (1.23")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (1.23")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")
CSI: TC=0.59 (9-10:1) , BC=0.38 (13-14:1) , WB=0.41 (10-13:1) , SSI=0.21 (9-10:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10
COMPANION LIVE LOAD FACTOR = 0.50
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (10) (INPUT = 0.90)
JSI METAL= 0.54 (19) (INPUT = 1.00)

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION

READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

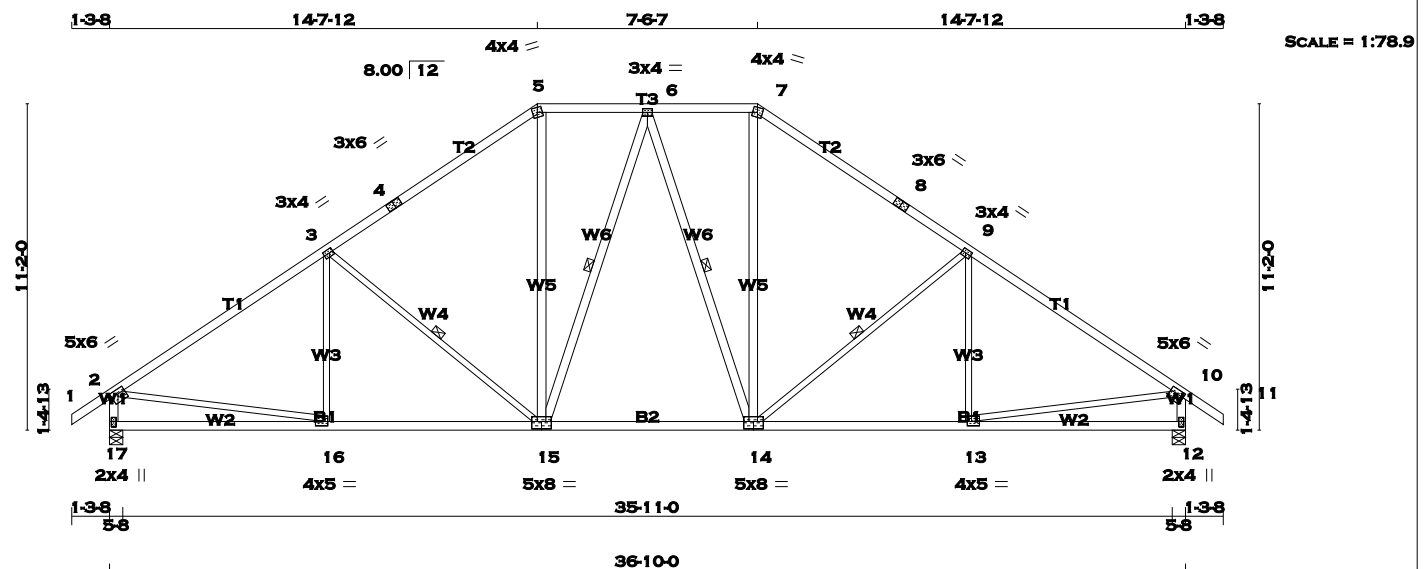

TOTAL WEIGHT = 4 X 182 = 729 lb

LUMBER				
N	L	G	A	RULES
CHORDS	SIZE		LUMBER	DESCR.
1 - 4	2x4	DRY	No.2	SPF
4 - 5	2x4	DRY	No.2	SPF
5 - 7	2x4	DRY	No.2	SPF
7 - 8	2x4	DRY	No.2	SPF
8 - 11	2x4	DRY	No.2	SPF
17 - 2	2x4	DRY	No.2	SPF
12 - 10	2x4	DRY	No.2	SPF
17 - 15	2x4	DRY	No.2	SPF
15 - 14	2x4	DRY	No.2	SPF
14 - 12	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
15 - 5	2x4	DRY	No.2	SPF
15 - 6	2x4	DRY	No.2	SPF
6 - 14	2x4	DRY	No.2	SPF
14 - 7	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	5.0	6.0	1.75	3.00
3	TMVW-t	MT20	3.0	4.0	1.50	1.50
4	TS-t	MT20	3.0	6.0		
5	TTW-m	MT20	4.0	4.0		
6	TMVW-t	MT20	3.0	4.0		
7	TTW-m	MT20	4.0	4.0		
8	TS-t	MT20	3.0	6.0		
9	TMVW-t	MT20	3.0	4.0	1.50	1.50
10	TMVW-t	MT20	5.0	6.0	1.75	3.00
12	BMV1+p	MT20	2.0	4.0	2.25	1.00
13	BMVW-t	MT20	4.0	5.0	1.75	1.75
14	BSWWW-I	MT20	5.0	8.0	3.00	4.00
15	BSWWW-I	MT20	5.0	8.0	3.00	4.00
16	BMVW-t	MT20	4.0	5.0	1.75	1.75
17	BMV1+p	MT20	2.0	4.0	2.25	1.00

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
17	1900	0	1900	0	0	5-8	5-8
12	1900	0	1900	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
17	1336	921/0	0/0	0/0	0/0	414/0	0/0
12	1336	921/0	0/0	0/0	0/0	414/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 17, 12

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 - 2x3 SPF No.2 LATERAL BRACE(S) AT 1/ 2 LENGTH OF 3-15, 6-15, 6-14, 9-14. DBS = 20-0-0 .
CBF = 63 LBS.

DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE. FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
1-2	0 / 29	-77.3	-77.3 0.10 (1)	10.00	16-3	-130 / 76	0.08 (1)
2-3	-2214 / 0	-77.3	-77.3 0.77 (1)	3.80	3-15	-503 / 0	0.32 (1)
3-4	-1825 / 0	-77.3	-77.3 0.68 (1)	4.19	15-5	0 / 646	0.10 (1)
4-5	-1825 / 0	-77.3	-77.3 0.68 (1)	4.19	15-6	-212 / 0	0.16 (1)
5-6	-1493 / 0	-89.8	-89.8 0.17 (1)	5.21	6-14	-212 / 0	0.16 (1)
6-7	-1493 / 0	-89.8	-89.8 0.17 (1)	5.21	14-7	0 / 646	0.10 (1)
7-8	-1825 / 0	-77.3	-77.3 0.68 (1)	4.19	14-9	-503 / 0	0.32 (1)
8-9	-1825 / 0	-77.3	-77.3 0.68 (1)	4.19	13-9	-130 / 76	0.08 (1)
9-10	-2214 / 0	-77.3	-77.3 0.77 (1)	3.80	2-16	0 / 1893	0.43 (1)
10-11	0 / 29	-77.3	-77.3 0.10 (1)	10.00	13-10	0 / 1893	0.43 (1)
17-2	-1847 / 0	0.0	0.0 0.19 (1)	6.16			
12-12	-1847 / 0	0.0	0.0 0.19 (1)	6.16			
17-16	0 / 0	-17.5	-17.5 0.23 (4)	10.00			
16-15	0 / 1874	-17.5	-17.5 0.42 (1)	10.00			
15-14	0 / 1560	-17.5	-17.5 0.35 (1)	10.00			
14-13	0 / 1874	-17.5	-17.5 0.42 (1)	10.00			
13-12	0 / 0	-17.5	-17.5 0.23 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP	CH.	LL =	23.3	PSF
		DL =	3.0	PSF
BOT	CH.	LL =	0.0	PSF
		DL =	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON
PIGGYBACK TRUSS WITH SLOPES OF 6.00/12
AND -6.00/12 AND RESPECTIVE WALL
HEIGHTS OF 0-0 AND 0-0 AND AN ADDITIONAL
DEAD LOAD OF 5.0 P.S.F.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.23")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (1.23")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.20")

CSI: TC=0.77 (9-10:1) , BC=0.42 (13-14:1) ,
WB=0.43 (10-13:1) , SSI=0.23 (9-10:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.90 (16) (INPUT = 0.90)
JSI METAL= 0.61 (10) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON THE
ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE
IS AN INTEGRAL PART OF THIS DRAWING AS IT
CONTAINS SPECIFICATIONS AND CRITERIA USED
IN THE DESIGN OF THIS COMPONENT.**

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



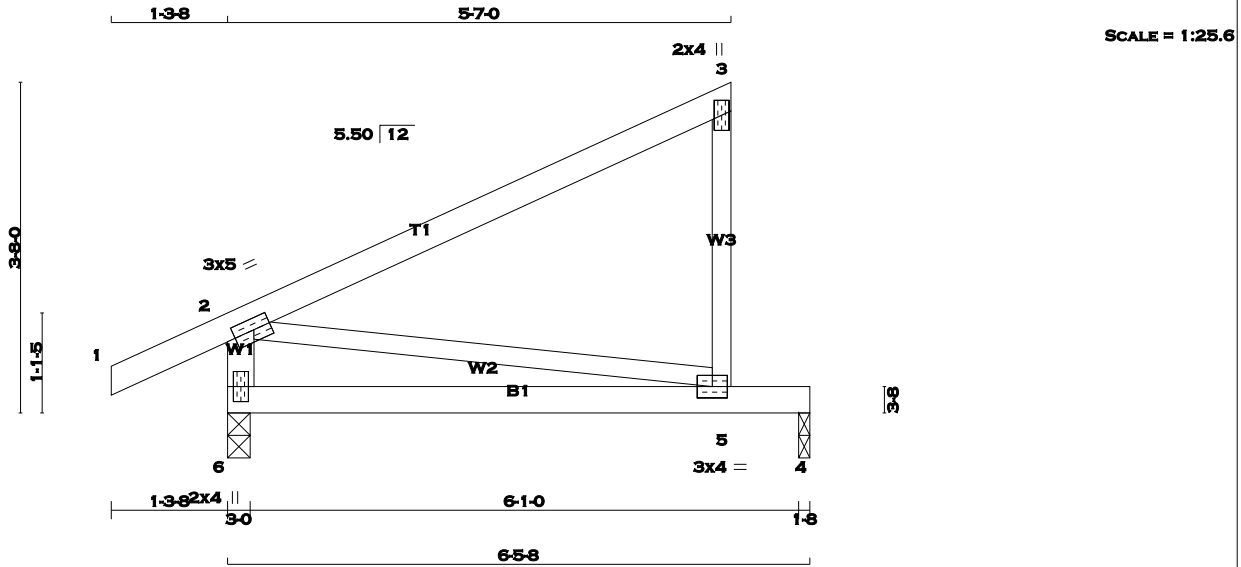

TOTAL WEIGHT = 24 lb

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE		LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF	
5 - 3	2x3	DRY	No.2	SPF	
6 - 2	2x4	DRY	No.2	SPF	
6 - 4	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	5.0	1.50	2.25
3	TMV+p	MT20	2.0	4.0		
5	BMVW-t	MT20	3.0	4.0		
6	BMV1+p	MT20	2.0	4.0		

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
6		406	0	406	0	0	3-0	3-0	
4		243	0	243	0	0	1-8	1-8	

UNFACTORED REACTIONS

		1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
6		283	211 / 0	0 / 0	0 / 0	0 / 0	72 / 0	0 / 0	
4		172	112 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6, 4

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

		CHORDS		WEBS			
		MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED
MEMB.		FORCE	VERT. LOAD	MEMB.		FORCE	VERT. LOAD
		(LBS)	(PLF)			(LBS)	(PLF)
FR-TO			FROM TO	FR-TO			FROM TO
1-2		0 / 22	-77.3 -77.3	2-5		0 / 0	0.00 (1)
2-3		0 / 0	-77.3 -77.3				0.41 (1)
5-3		-216 / 0	0.0 0.0				0.06 (1)
6-2		-321 / 0	0.0 0.0				0.03 (1)
6-5		0 / 0	-17.5 -17.5				0.29 (1)
5-4		0 / 0	-17.5 -17.5				0.28 (1)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	33.3	PSF	

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.22")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.22")
CALCULATED VERT. DEFL.(TL) = L/ 444 (0.17")

CSI: TC=0.41 (2-3:1) , BC=0.29 (5-6:1) , WB=0.00 (2-5:1) , SSI=0.19 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.28 (2) (INPUT = 0.90)
JSI METAL= 0.06 (6) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON THE ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION



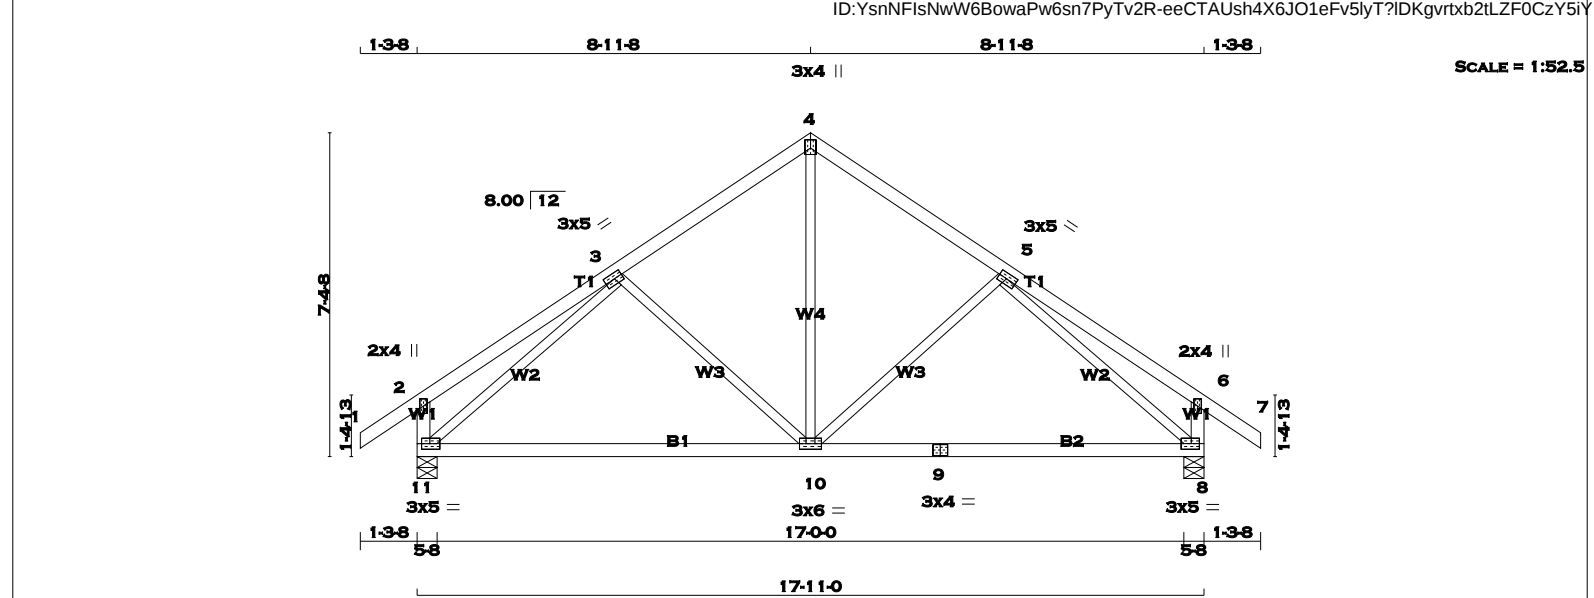

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

LUMBER

DESCR.

1 - 4

2x4

DRY

No.2

SPF

4 - 7

2x4

DRY

No.2

SPF

11 - 2

2x4

DRY

No.2

SPF

8 - 6

2x4

DRY

No.2

SPF

11 - 9

2x4

DRY

No.2

SPF

9 - 8

2x4

DRY

No.2

SPF

ALL WEBS

2x3

DRY

No.2

SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
3	TMVW-t	MT20	3.0	5.0	1.50	2.25
4	TTW+p	MT20	3.0	4.0	2.25	1.50
5	TMVW-t	MT20	3.0	5.0	1.50	2.25
6	TMV+p	MT20	2.0	4.0		
8	BMVW1-t	MT20	3.0	5.0	1.50	2.25
9	BS-t	MT20	3.0	4.0		
10	BMVW-t	MT20	3.0	6.0		
11	BMVW1-t	MT20	3.0	5.0	1.50	2.25

A SIZE FOR SIZE SUBSTITUTION OF MITEK MII20 WITH

TEE-LOK TL20 PLATES IS ALLOWED.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
11	956	0	0	5-8
8	956	0	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. SNOW	MAX/MIN. LIVE	MAX/MIN. PERM. LIVE	MAX/MIN. WIND	MAX/MIN. DEAD	MAX/MIN. SOIL
11	668	481 / 0	0 / 0	0 / 0	0 / 0	187 / 0	0 / 0
8	668	481 / 0	0 / 0	0 / 0	0 / 0	187 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 11, 8

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FORCE (LBS)	FACTORED MAX. (LC)	
FR-TO		FROM	TO	FR-TO			
1-2	0 / 29	-77.3	-77.3 0.10 (1)	10-4	0 / 485	0.11 (1)	
2-3	0 / 22	-77.3	-77.3 0.25 (1)	10-5	-217 / 0	0.14 (1)	
3-4	-700 / 0	-77.3	-77.3 0.20 (1)	6-25	3-10	-217 / 0	0.14 (1)
4-5	-700 / 0	-77.3	-77.3 0.20 (1)	6-25	11-3	-978 / 0	0.61 (1)
5-6	0 / 22	-77.3	-77.3 0.25 (1)	10-00	5-8	-978 / 0	0.61 (1)
6-7	0 / 29	-77.3	-77.3 0.10 (1)	10-00			
11-2	-238 / 0	0.0	0.0 0.02 (1)	7.81			
8-6	-238 / 0	0.0	0.0 0.02 (1)	7.81			
11-10	0 / 724	-17.5	-17.5 0.45 (4)	10.00			
10-9	0 / 724	-17.5	-17.5 0.45 (4)	10.00			
9-8	0 / 724	-17.5	-17.5 0.45 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	33.3	PSF	

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014

- CSA 086-09

- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.60")

CALCULATED VERT. DEFL.(LL) = L/ 999 (0.02")

ALLOWABLE DEFL.(TL)= L/360 (0.60")

CALCULATED VERT. DEFL.(TL) = L/ 999 (0.14")

CSI: TC=0.25 (2-3:1), BC=0.45 (10-11:4), WB=0.61 (3-11:1), SSI=0.14 (3-4:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (5) (INPUT = 0.90)


JSI METAL= 0.28 (9) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON THE
 ENGINEERING NOTE PAGE ENP-1. THE NOTE PAGE
 IS AN INTEGRAL PART OF THIS DRAWING AS IT
 CONTAINS SPECIFICATIONS AND CRITERIA USED
 IN THE DESIGN OF THIS COMPONENT.

RECEIVED
 TOWN OF MILTON
 MAR 29, 2017
 JUNIPER 8
 BUILDING DIVISION







BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to **wind** the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2017.

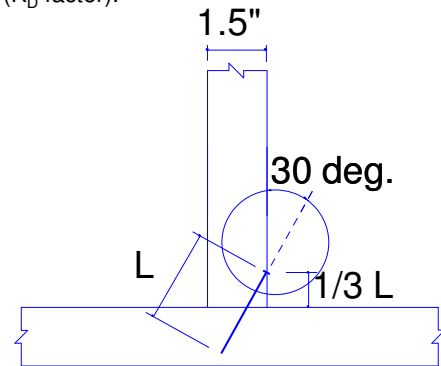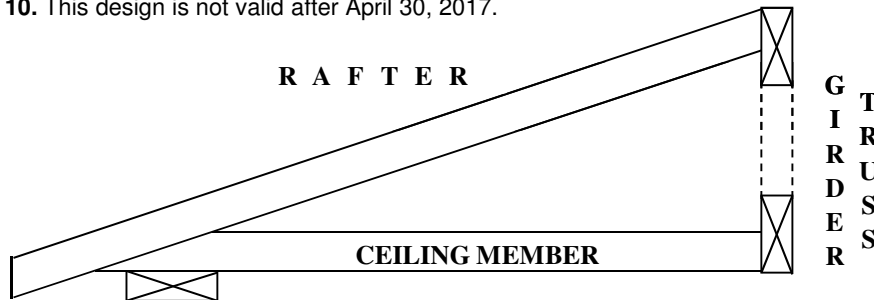

TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION

PEO
Certificate No. 10889485



April 24, 2015

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING





B37579H2

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.

NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind** or **earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2017

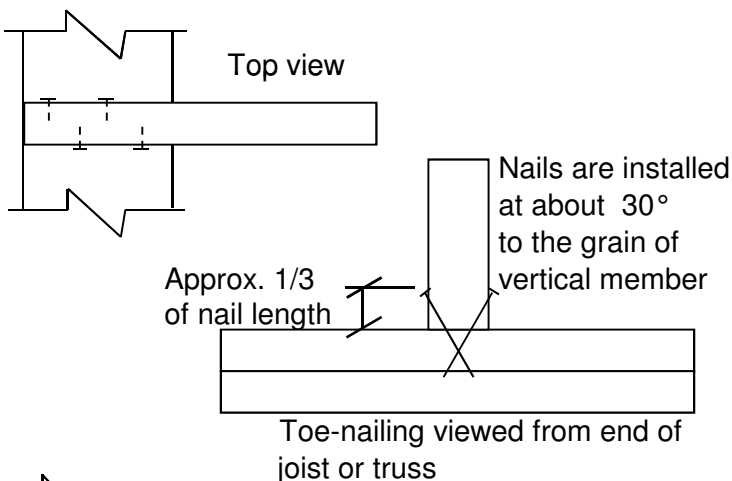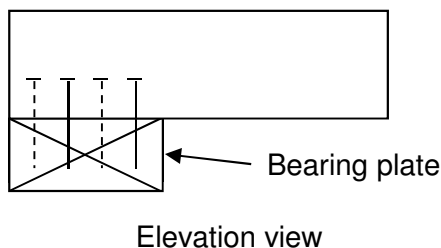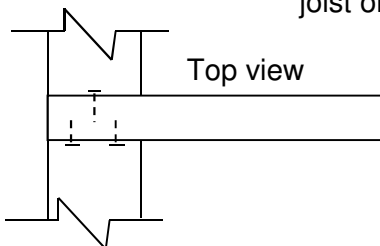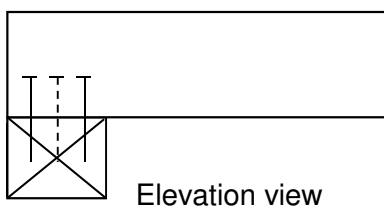Toe-nailing on 2x6 Bearing Plate**Toe-nailing on 2x4 Bearing Plate**

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7



April 24, 2015

JOB NAME

JOB DESC.

LECCO RIDGE-JUNIPER 8 EL 2

DRWG NO.


ENC JOB: PT0317-174

DETAILS

PIGGYBACK TRUSS DETAIL

B375791


FOR SLOPES BETWEEN
4/12 AND 12/12

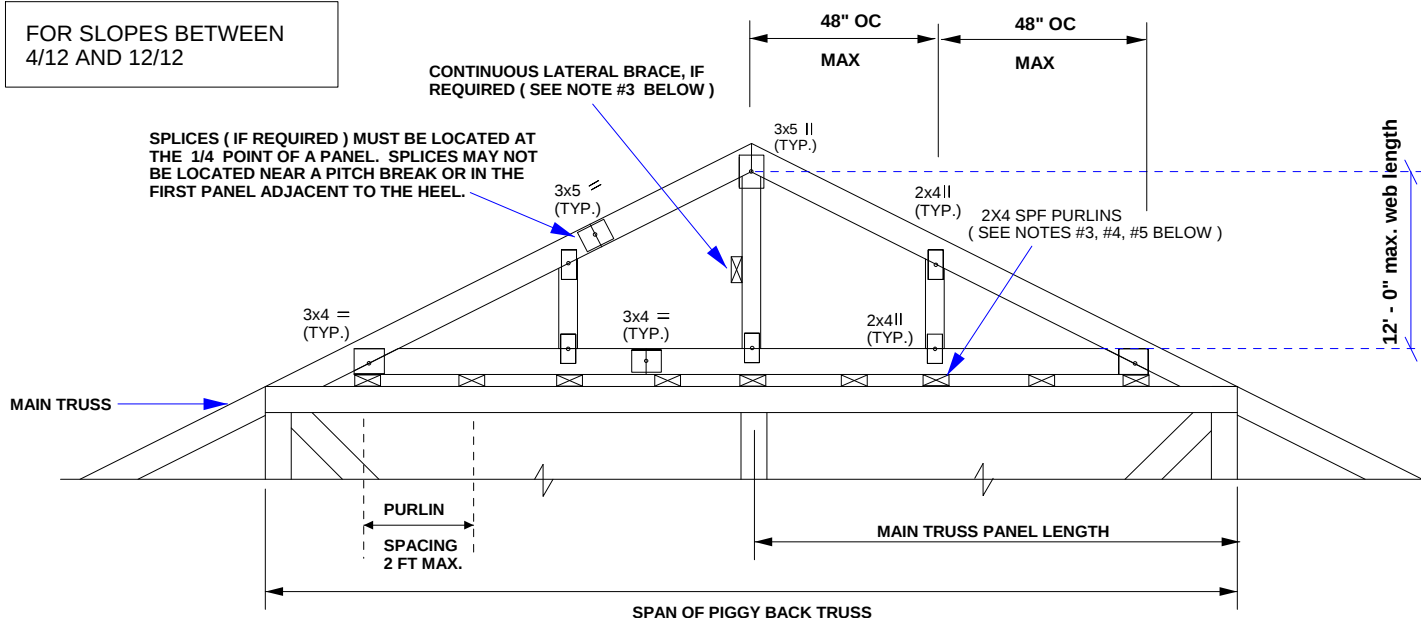

FOR SLOPES BETWEEN
4/12 AND 12/12

SPLICES (IF REQUIRED) MUST BE LOCATED AT
THE 1/4 POINT OF A PANEL. SPLICES MAY NOT
BE LOCATED NEAR A PITCH BREAK OR IN THE
FIRST PANEL ADJACENT TO THE HEEL.

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION

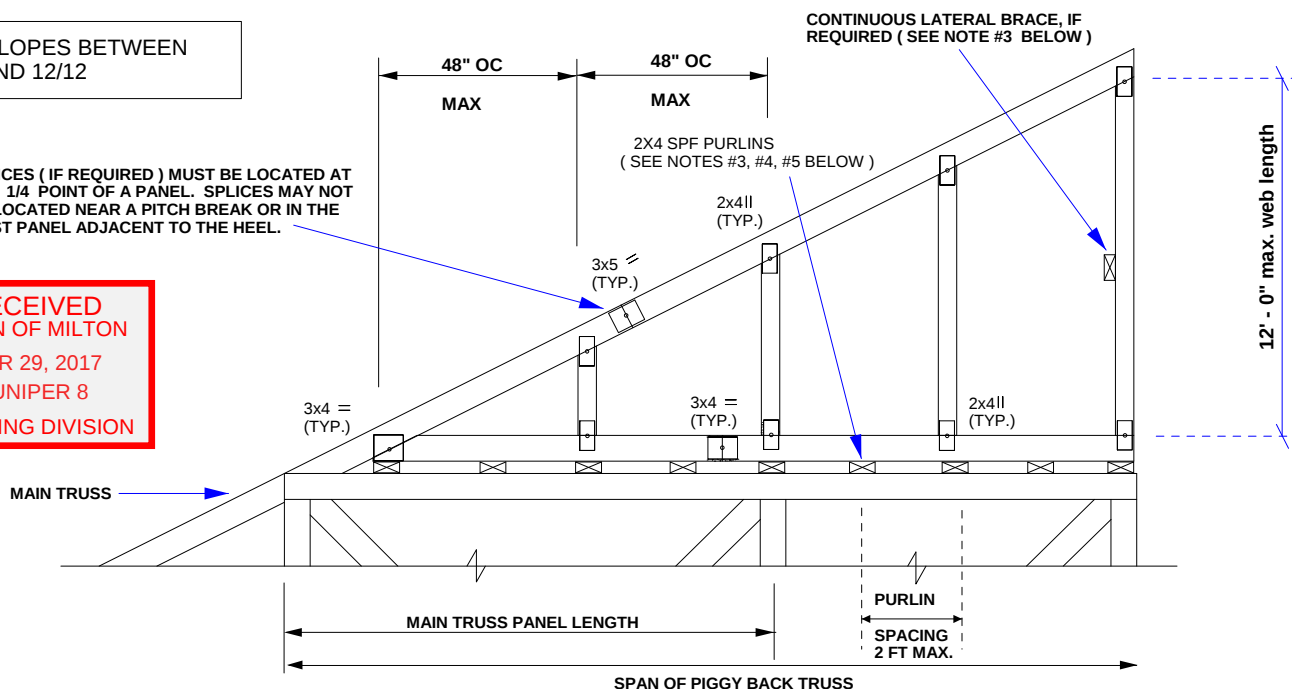

THIS PIGGYBACK DETAIL IS VALID FOR THE
PROJECT DESIGN LOADS LISTED BELOW:

SPECIFIED LOADS:

TOP CHORD	LL =	60.0	PSF OR LESS
	DL =	6.0	PSF OR LESS
BOT CHORD	LL =	0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	73.0	PSF OR LESS

MAX. SPACING OF TRUSSES NOT TO EXCEED 24" C/C



MiTek Canada, Inc.
100 Industrial Rd.
Bradford, Ontario, L3Z 3G7

PEO
Certificate No. 10889485



Notes:

- Piggyback truss lumber : Top chord = 2x4, Webs = 2x3 or 2x4, Bottom chord = 2x3 or 2x4. All chord/web lumber to be SPF or D. Fir species and No. 2 DRY or better grade.
- Maximum web length is not to exceed 12 ft.
- One continuous lateral brace required at 1/2 length of any web that exceeds 6 ft in length. Minimum brace (or purlin) size shall be 1x4 as per NBCC 2010, section 9.23.14.11.4 For L-brace or Scab brace connection details see MiTek details B37337K, B37337P.
- Purlins supporting piggyback trusses, as well as overall roof bracing, are specified by building designer.
- Purlin spacing to be equal to main truss maximum unbraced top chord length (as shown on main truss MiTek engineering drawing), but not to exceed 24" c/c.
- This detail is not valid for projects that require a wind analysis to be incorporated into the truss design.
- Piggyback truss must be installed directly on top of each main truss.
- Maximum span of the piggyback is not to exceed 24'-0" (contact MiTek engineering dept. for spans > 24'-0").
- All plates specified are MiTek MT20, centered at each joint, and pressed into both faces of piggyback truss.
- This detail is not valid after April 30, 2017.

April 24, 2015

JOB NAME DETAILS



JOB DESC.

5000 RIDGE-JUNIPER 8 EL 2


DRAWING NO.

B37579J


EMC JOB # 10317-174

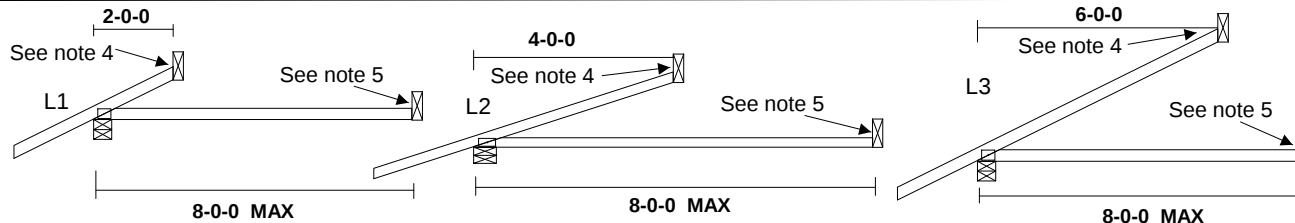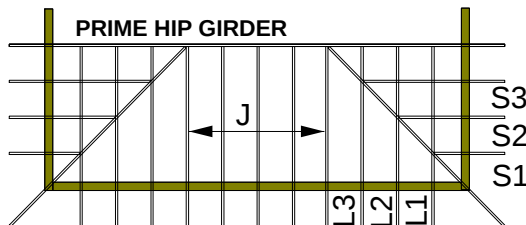

DETAIL "A"

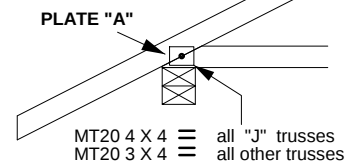


DETAIL "C"

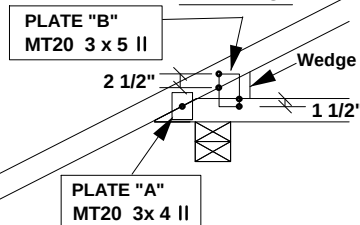

CANTILEVER DETAIL "C"

SLOPE	MAX CANTILEVER	PLATE "B"	WEDGE SIZE
3/12	17"	3 X 5	2 X 3
4/12	14"	3 X 5	2 X 3
5/12	12"	3 X 5	2 X 4
6/12	10"	3 X 5	2 X 4
7/12	9"	3 X 5	2 X 6
8/12	8.5"	3 X 5	2 X 6
9/12	8"	3 X 5	2 X 6
10/12	7.5"	3 X 5	2 X 6


DETAIL "B"

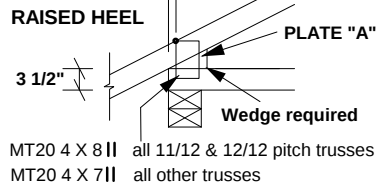

NOTES:

- ALL LUMBER SHALL BE 2x4 SPF OR D. Fir No. 2 DRY OR BETTER.
- THIS TRUSS IS DESIGNED FOR HOUSING AND SMALL BUILDING REQUIREMENTS OF PART 9 NBC 2010, WHERE GROUND SNOW LOAD IS 60.0 PSF OR LESS AND RAIN LOAD DOES NOT EXCEED 12.53 PSF; TOP CHORD DEAD LOAD IS 6 PSF OR LESS; BC LIVE LOAD IS 0 PSF AND BC DEAD LOAD IS 7 PSF.
- HIP RAFTER DESIGN SHALL CONFORM TO SECTION 9.23.14.6 OF NBC 2010.
- FASTEN HIGH END OF RAFTERS USING MITEK CANADA INC. "BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY" STANDARD DETAIL B37579H1.
- FASTEN RIGHT END OF CEILING USING MITEK CANADA INC. "BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY" STANDARD DETAIL B37579H1.
- OVERHANG LENGTH SHALL NOT EXCEED 2 FT.
- WHEN SETBACK IS 6 FT OR LESS, DIAGONAL WEB MAY BE OMITTED AND HIGH END OF TOP CHORD SHALL BE CONNECTED AS PER NOTE 4.
- ALL PLATES SPECIFIED ARE PRESSED INTO BOTH FACES OF THE TRUSS.
- MITEK REFERENCE PAGE MII-7473C FORMS AN INTEGRAL PART OF THIS DETAIL.
- THIS DETAIL IS NOT VALID AFTER APRIL 30, 2017

SEE DETAIL A, B or C

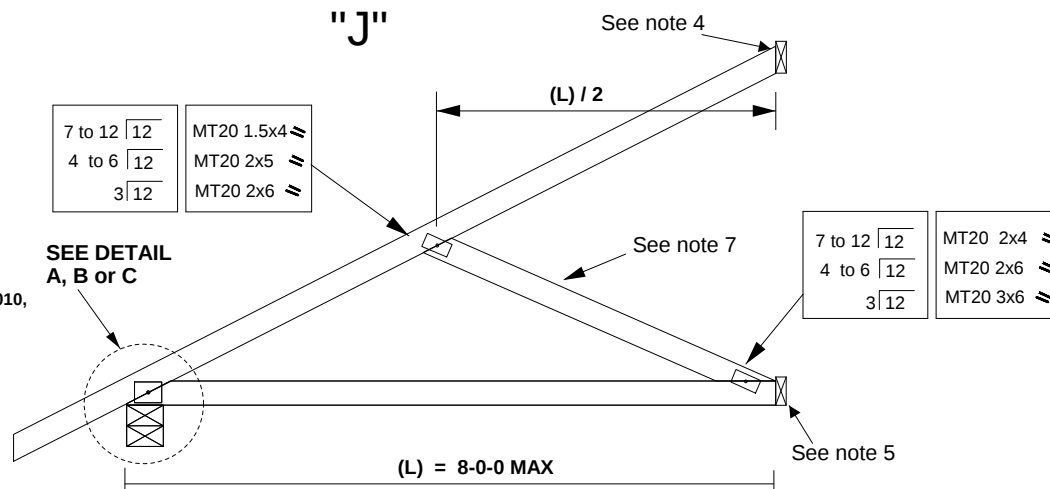

RECEIVED
TOWN OF MILTON
MAR 29, 2017
JUNIPER 8
BUILDING DIVISION

PEO
Certificate No. 10889485



April 24, 2015



MiTek Canada, Inc.
100 Industrial Rd.
Bradford, Ontario, L3Z 3G7


STANDARD GABLE END DETAIL

LECCO RIDGE-JUNIPER 8 EL 2

DRAWING NO.: B37579K

MINIMUM ROOF PITCH: 2/12

MAXIMUM ROOF PITCH: 12/12

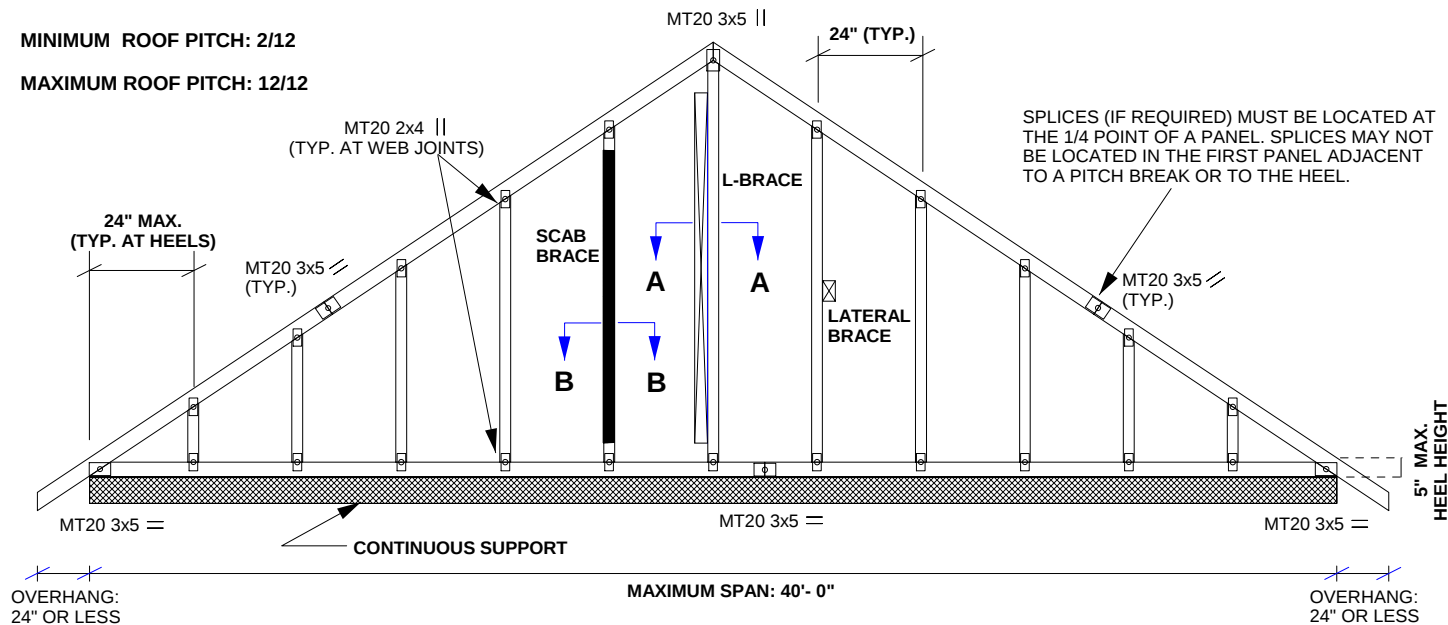

LUMBER

TOP CHORD: 2 X 4 No. 2 DRY SPF or D- Fir
 BOTTOM CHORD: 2 X 3 or 2 X 4 No. 2 DRY SPF or D- Fir
 GABLE WEB: 2 X 3 or 2 X 4 No. 2 DRY SPF or D- Fir

PLATES

JOINT PLATES
 HEELS MT20 3 X 5
 PEAK MT20 3 X 5
 TC SPLICES MT20 3 X 5
 BC SPLICES MT20 3 X 5
 WEB JOINTS MT20 2 X 4

DESIGN CRITERIA

TOP CHORD LL = 60.0 PSF OR LESS
 TOP CHORD DL = 6.0 PSF OR LESS
 BOTTOM CHORD LL = 0 PSF
 BOTTOM CHORD DL = 7.0 PSF


TOTAL LOAD = 73.0 PSF OR LESS

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10 FT. OR RIGID CEILING DIRECTLY APPLIED.
 WEBS MUST BE LATERALLY BRACED, SCAB BRACED OR L-BRACED AS INDICATED IN TABLE BELOW:


WEB LENGTH (L)	SCAB BRACE	L-BRACE	LATERAL BRACE
L < 6 FT.	NOT REQUIRED	NOT REQUIRED	NOT REQUIRED
6 FT. < L < 12 FT.	REQUIRED	2x4 L-BRACE	1 LATERAL AT 1/2 LENGTH OF WEB

SCAB BRACE DETAIL

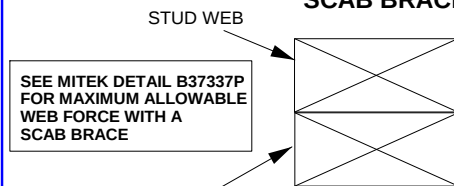

No. 2 DRY SPF OR D. Fir SCAB BRACE, SAME SIZE AS WEB

SECTION B-B

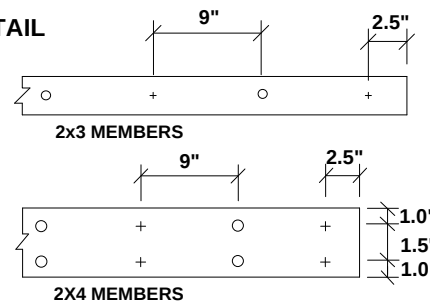


FASTEN SCAB BRACE TO ONE FACE OF WEB WITH 9-3/4 GAUGE 0.122" X 3" COMMON SPIRAL NAILS SPACED @ 9" C/C (MAX) WITH 2.5" MINIMUM END DISTANCE. SCAB BRACE MUST COVER 90% OF WEB LENGTH. DRIVE NAILS ALTERNATELY FROM FRONT AND BACK FACES.


+ NAIL FROM FRONT FACE
 o NAIL FROM BACK FACE

CANTILEVER DETAIL

Note: Gable end may be cantilevered up to 6 inches past end wall as shown. Gable end to be continuously supported by 2x4 SPF No.2 (DRY) members at 12" o.c. along the bottom chord. Roof design loads shall not exceed the loading shown above.

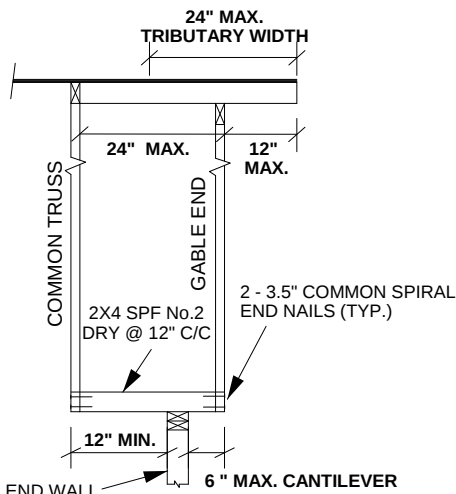

L-BRACE DETAIL

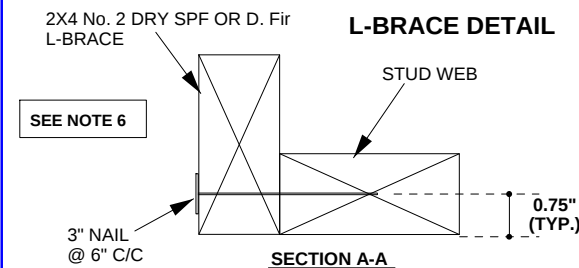

FASTEN L-BRACE TO NARROW EDGE OF WEB WITH ONE ROW OF 9-3/4 GAUGE 0.122" X 3" COMMON SPIRAL NAILS SPACED AT 6" C/C WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

NOTES:

- Gable studs are spaced at 24" C/C (max.) with a max. length of 12 ft.
- All plates specified are MiTek MT20, centered at each joint, and pressed into both faces of truss.
- Truss spacing is 24" C/C, maximum.
- Gable truss is designed for continuous support. Bearing material must be of the same species as chord member and of grade No. 2 or better.
- This truss requires rigid sheathing attached to exposed face.
- 2x3 or 2x4 T-braces shown for gable webs in the MiTek engineering drawings may be replaced by a 2x4 L-brace as shown above.
- This truss is designed for residential or small building requirements, conforming to Part 9, NBCC 2010.
- This detail is not valid after April 30, 2017.

PEO
 Certificate No. 10889485



RECEIVED
 TOWN OF MILTON
 MAR 29, 2017
 JUNIPER 8
 BUILDING DIVISION

April 24, 2015



MiTek Canada, Inc.
 100 Industrial Rd.
 Bradford, Ontario, L3Z 3G7