

FROM PLAN DATED: JUNE 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: DEWBERRY 2E

ELEVATION: 1,2

LOT:

CITY: WATERDOWN



SALESMAN: M D

DESIGNER: AJAJ

REVISION: lbv

NOTES:
REFER TO THE **NORDIC INSTALLATION**
GUIDE FOR PROPER STORAGE AND
INSTALLATION.
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F
REQ'D UNDER INTERIOR UNIFORM LOAD
BEARING WALLS. **MULTIPLE SQUASH**
BLOCKS REQ'D UNDER CONCENTRATED
LOADS. SEE FIGURE 1. **CANTILEVERED**
JOISTS INCLUDING **CANT' OVER BRICK** REQ.
I-JOIST BLOCKING ALONG BEARING AND
RIMBOARD CLOSURE AT ENDS. SEE
FIGURES 4 & 5 FOR REINFORCEMENT
REQUIREMENTS. FOR **HOLES** INCLUDING
DUCT CHASE AND **FIELD CUT OPENINGS**
SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE**
APPLICATION AS PER O.B.C 9.30.6.

1st FLOOR

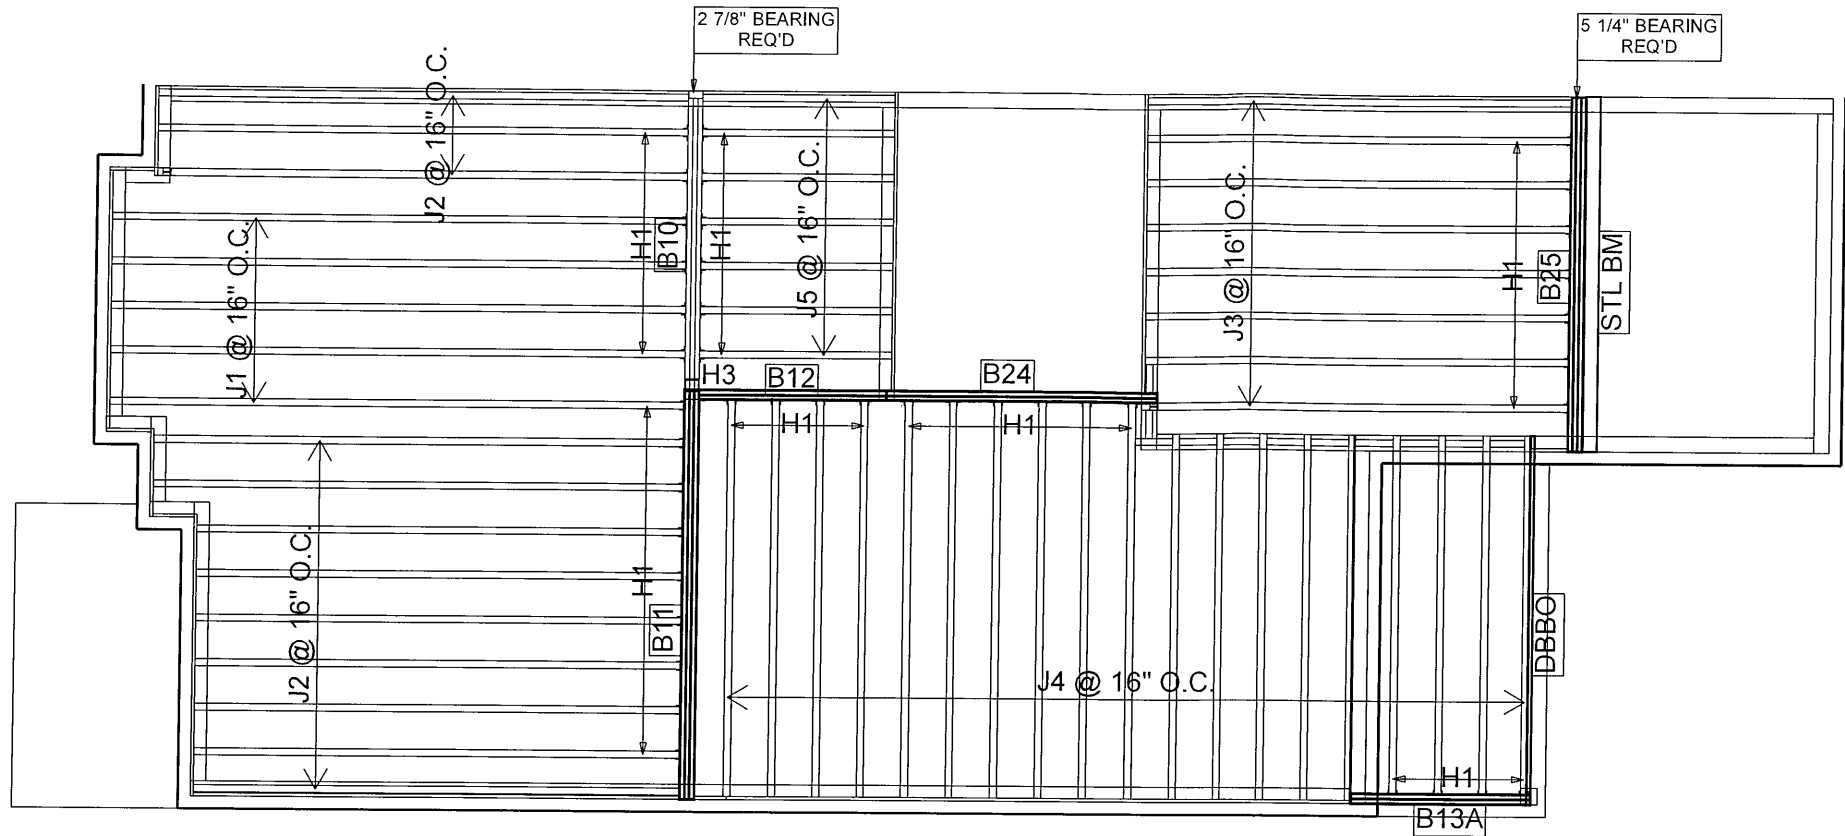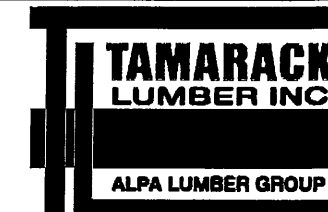

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	11 7/8" NI-40x	1	5
J2	16-00-00	11 7/8" NI-40x	1	12
J3	14-00-00	11 7/8" NI-40x	1	8
J4	12-00-00	11 7/8" NI-40x	1	19
J5	6-00-00	11 7/8" NI-40x	1	7
B11	14-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	3	3
B25	12-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	3	3
B24	10-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2
B10	10-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	3	3
B12	6-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2
B13A	6-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
14	H1	IUS2.56/11.88
28	H1	IUS2.56/11.88
1	H3	HGUS410

FROM PLAN DATED: JUNE 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: DEWBERRY 2E

ELEVATION: 1,2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJAJ

REVISION: lbv


NOTES:
REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2018-03-06

2nd FLOOR

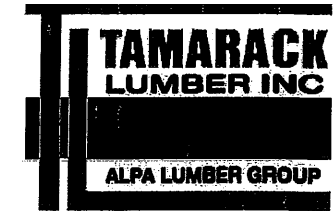

FROM PLAN DATED: JUNE 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: DEWBERRY 2E

ELEVATION: 1,2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ AJ

REVISION: lbv

NOTES:

REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2018-03-02

UPPER FLOOR

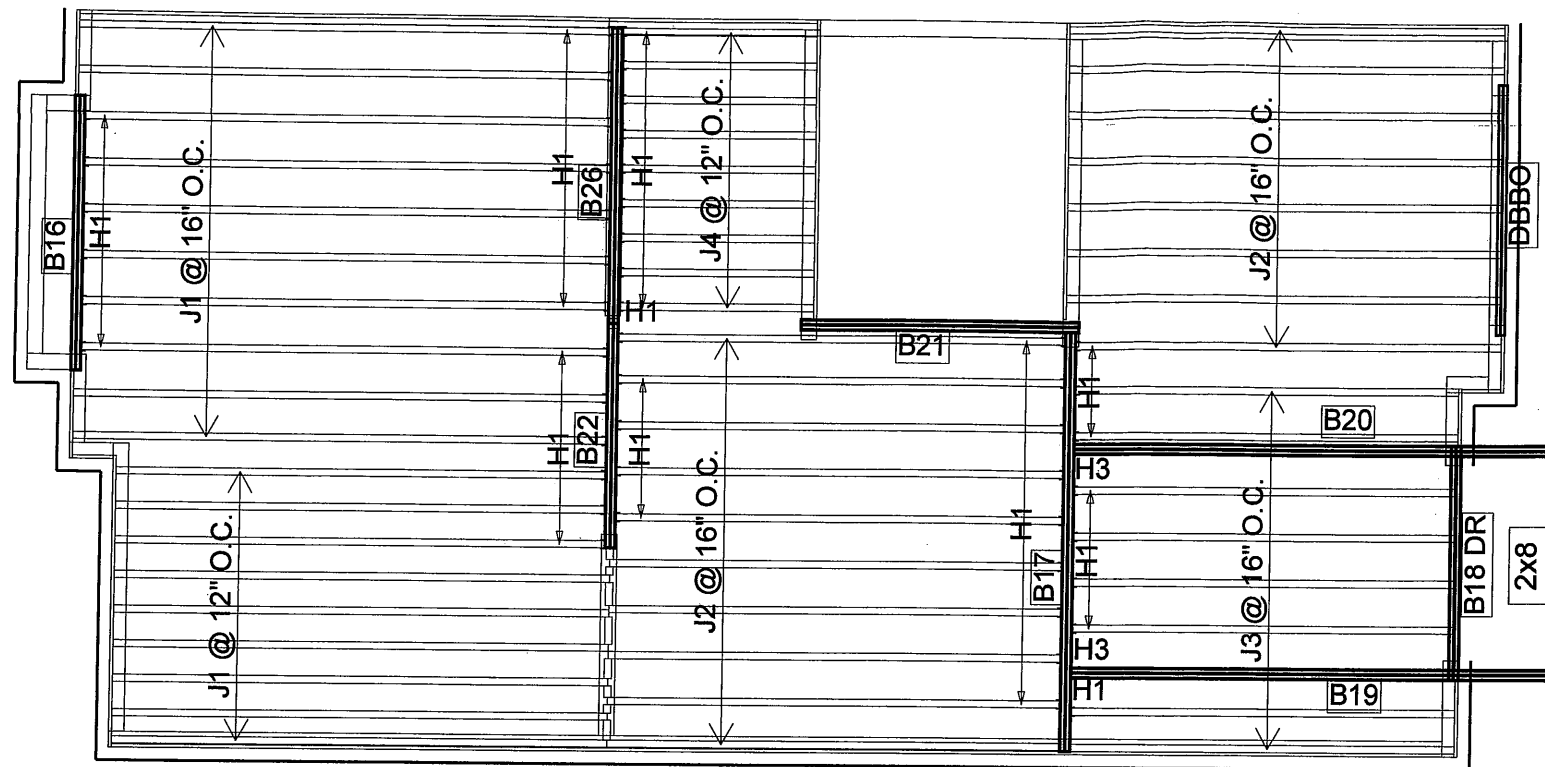

Products					Connector Summary		
PlotID	Length	Product	Plies	Net Qty	Qty	Manuf	Product
J1	16-00-00	11 7/8" NI-40x	1	19	50	H1	IUS2.56/11.88
J2	14-00-00	11 7/8" NI-40x	1	18	2	H3	HGUS410
J3	12-00-00	11 7/8" NI-40x	1	8			
J4	6-00-00	11 7/8" NI-40x	1	9			
B19	16-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2			
B20	16-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2			
B17	14-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2			
B21	10-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2			
B26	10-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2			
B16	8-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2			
B18 DR	8-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2			
B22	8-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	2	2			

NORDIC STRUCTURES

COMPANY
July 10, 2017 12:40


PROJECT
J3 1ST FLOOR
NORDIC SIZER

Design Check Calculation Sheet Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf
Self-weight	Dead	Full UDL			2.9	plf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

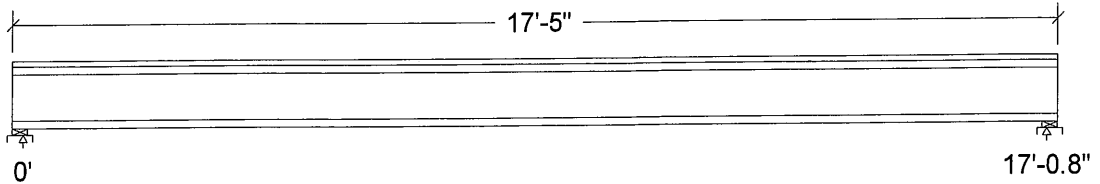

Unfactored:			
Dead	252		252
Live	455		455
Factored:			
Total	997		997
Bearing:			
Resistance			
Joist	2189		2189
Support	5304		5304
Des ratio			
Joist	0.46		0.46
Support	0.19		0.19
Load case	#2		#2
Length	3		3
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.15		1.15

Nordic 11-7/8" NI-40x Floor joist @ 16" o.c.

Supports: All - Lumber Sill plate, No.1/No.2

Total length: 17'-5.0"; 3/4" nailed and glued OSB sheathing

This section PASSES the design code check.

Limit States Design using CSA-O86-09 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 997	Vr = 2336	lbs	Vf/Vr = 0.43
Moment(+)	Mf = 4255	Mr = 6255	lbs-ft	Mf/Mr = 0.68
Perm. Defl'n	0.14 = <L/999	0.57 = L/360	in	0.24
Live Defl'n	0.25 = L/814	0.43 = L/480	in	0.59
Total Defl'n	0.39 = L/524	0.85 = L/240	in	0.46
Bare Defl'n	0.30 = L/672	0.57 = L/360	in	0.54
Vibration	Lmax = 17'-1	Lv = 18'-1		
Defl'n	= 0.031	= 0.037		0.83



pe 1/2
DWG NO. TAM 4499417
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	2336	1.00	1.00	-	-	-	-	-	#2
Mr+	6255	1.00	1.00	-	1.000	-	-	-	#2
EI	371.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: E_Ieff = 460e06 lb-in² K= 6.18e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-09 Engineering Design in Wood standard, which includes Update No.1. **CONFORMS TO NBC 2012**
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 44994-17
STRUCTURAL
COMPONENT ONLY


Design Check Calculation Sheet

Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf
Self-weight	Dead	Full UDL			2.9	plf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

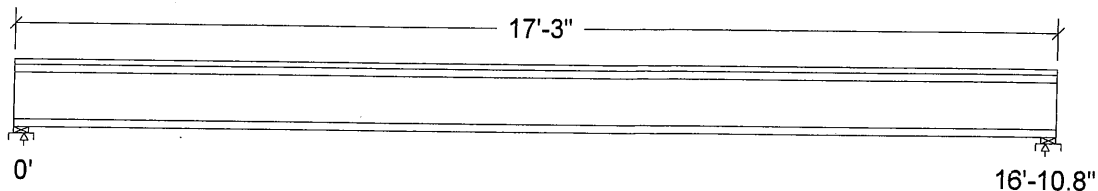

Unfactored:			
Dead	249		249
Live	451		451
Factored:			
Total	988		988
Bearing:			
Resistance			
Joist	2189		2189
Support	5304		5304
Des ratio			
Joist	0.45		0.45
Support	0.19		0.19
Load case	#2		#2
Length	3		3
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.15		1.15

Nordic 11-7/8" NI-40x Floor joist @ 16" o.c.


Supports: All - Lumber Sill plate, No.1/No.2

Total length: 17'-3.0"; 3/4" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section **PASSES** the design code check.

Limit States Design using CSA-O86-09 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 988	Vr = 2336	lbs	Vf/Vr = 0.42
Moment(+)	Mf = 4172	Mr = 6255	lbs-ft	Mf/Mr = 0.67
Perm. Defl'n	0.13 = <L/999	0.56 = L/360	in	0.24
Live Defl'n	0.24 = L/836	0.42 = L/480	in	0.57
Total Defl'n	0.38 = L/538	0.84 = L/240	in	0.45
Bare Defl'n	0.29 = L/691	0.56 = L/360	in	0.52
Vibration	Lmax = 16'-11	Lv = 18'-8	ft	
Defl'n	= 0.028	= 0.037	in	0.75

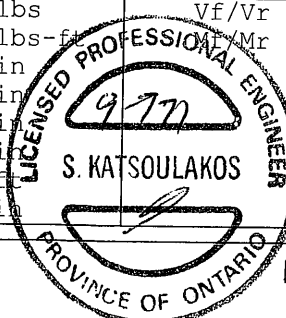

DWG NO. FAM 44993-17
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	2336	1.00	1.00	-	-	-	-	-	#2
Mr+	6255	1.00	1.00	-	1.000	-	-	-	#2
EI	371.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: E_Ieff = 460e06 lb-in² K= 6.18e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-09 Engineering Design in Wood standard, which includes Update No.1. **CONFORMS TO NBC 2012**
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 4499317
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmd


Description: Designs\Flush Beams\Basement\Flush Beams\B1(i4313)

Specifier:

Designer:

Company:

Msc:

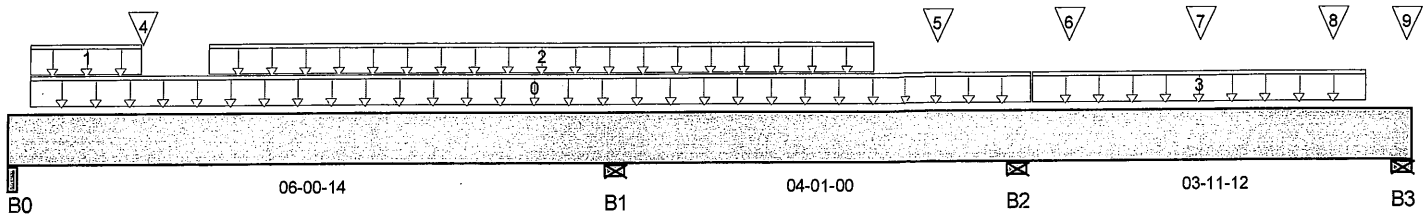

Total Horizontal Product Length = 14-01-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5-1/4"	466 / 26	253 / 0		
B1, 5-1/2"	1,293 / 0	674 / 0		
B2, 3-1/2"	1,171 / 0	526 / 0		
B3, 5-1/2"	584 / 55	299 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	10-03-10	5	3			n/a
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	01-04-00	43	21			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	02-00-00	08-08-00	206	103			n/a
3	User Load	Unf. Lin. (lb/ft)	L	10-03-10	13-08-02	240	120			n/a
4	J5(i4367)	Conc. Pt. (lbs)	L	01-04-00	01-04-00	229	115			n/a
5	J5(i4244)	Conc. Pt. (lbs)	L	09-04-00	09-04-00	251	125			n/a
6	J7(i1493)	Conc. Pt. (lbs)	L	10-08-00	10-08-00	119	59			n/a
7	J7(i1422)	Conc. Pt. (lbs)	L	12-00-00	12-00-00	123	61			n/a
8	J7(i1486)	Conc. Pt. (lbs)	L	13-04-00	13-04-00	98	49			n/a
9	B3(i1433)	Conc. Pt. (lbs)	L	14-00-12	14-00-12	36	30			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,401 ft-lbs	38,727 ft-lbs	3.6%	2	02-08-00
Neg. Moment	-1,455 ft-lbs	-38,727 ft-lbs	3.8%	4	06-00-14
End Shear	914 lbs	14,464 lbs	6.3%	2	01-05-02
Cont. Shear	1,217 lbs	14,464 lbs	8.4%	4	04-10-04
Total Load Defl.	L/999 (0.005")	n/a	n/a	13	03-00-00
Live Load Defl.	L/999 (0.003")	n/a	n/a	18	03-01-00
Total Neg. Defl.	L/999 (-0.001")	n/a	n/a	13	07-09-14
Max Defl.	0.005"	n/a	n/a	13	03-00-00
Span / Depth	5.8	n/a	n/a		00-00-00

Bearing Supports

Dim. (L x W) Demand Support Member Material



BC CALC® Design Report


Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl

Description: Designs\Flush Beams\Basement\Flush Beams\B1(i4313)

Specifier:

Designer:

Company:

Misc:

B0	Beam	5-1/4" x 3-1/2"	1,015 lbs	12.9%	4.5%	Unspecified
B1	Wall/Plate	5-1/2" x 3-1/2"	2,781 lbs	33.8%	11.8%	Unspecified
B2	Wall/Plate	3-1/2" x 3-1/2"	2,414 lbs	46.1%	16.2%	Unspecified
B3	Wall/Plate	5-1/2" x 3-1/2"	1,249 lbs	15.2%	5.3%	Unspecified

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO DBC 2012

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

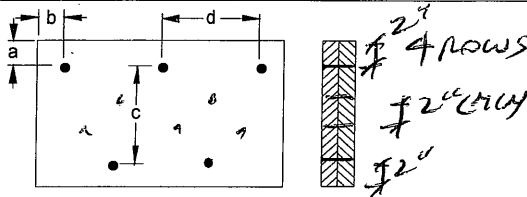Connection Diagram


a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Calculated Side Load = 335.6 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B2(i3039)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 12:31:05

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B2(i3039)

Specifier:

Designer:

Company:

Misc:

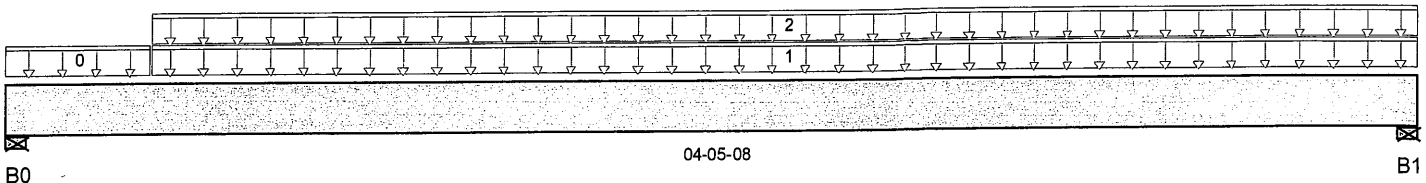

Total Horizontal Product Length = 04-05-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5-1/2"	494 / 0	261 / 0		
B1, 3-1/2"	557 / 0	291 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-05-08	27	13			n/a
1	User Load	Unf. Lin. (lb/ft)	L	00-05-08	04-05-08	240	120			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-05-08	04-05-08	20	10			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,027 ft-lbs	19,364 ft-lbs	5.3%	1	02-03-12
End Shear	484 lbs	7,232 lbs	6.7%	1	01-05-06
Total Load Defl.	L/999 (0.004")	n/a	n/a	4	02-03-12
Live Load Defl.	L/999 (0.003")	n/a	n/a	5	02-03-12
Max Defl.	0.004"	n/a	n/a	4	02-03-12
Span / Depth	3.9	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	5-1/2" x 1-3/4"	1,066 lbs	25.9%	9.1%	Unspecified
B1 Wall/Plate	3-1/2" x 1-3/4"	1,200 lbs	45.8%	16.1%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO DBC 2012





Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B3(i1433)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 12:31:06

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B3(i1433)

Specifier:

Designer:

Company:

Misc:

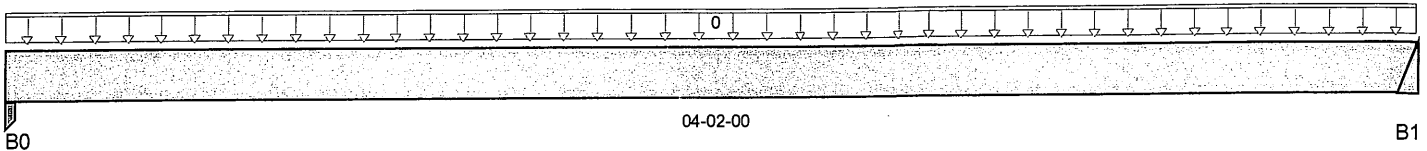

Total Horizontal Product Length = 04-02-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	34 / 0	30 / 0		
B1	32 / 0	28 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
0 FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	04-02-00	16	8			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	76 ft-lbs	19,364 ft-lbs	0.4%	1	02-01-12
End Shear	36 lbs	7,232 lbs	0.5%	1	01-03-06
Total Load Defl.	L/999 (0")	n/a	n/a	4	02-01-12
Live Load Defl.	L/999 (0")	n/a	n/a	5	02-01-12
Max Defl.	0"	n/a	n/a	4	02-01-12
Span / Depth	3.9	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Post	3-1/2" x 1-3/4"	89 lbs	2.2%	1.2%	Unspecified
B1 Hanger	2" x 1-3/4"	84 lbs	n/a	2%	Hanger

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BOI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B4(i1475)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 12:31:06

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B4(i1475)

Specifier:

Designer:

Company:

Misc:

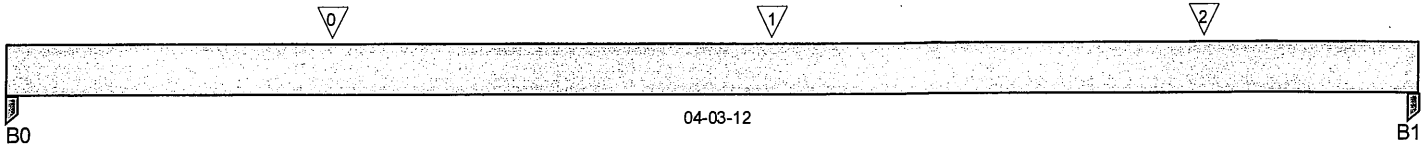

Total Horizontal Product Length = 04-03-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	161 / 0	95 / 0		
B1, 1-3/4"	161 / 0	93 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	J7(i1493)	Conc. Pt. (lbs)	L	00-11-14	00-11-14	115	58			n/a
1	J7(i1422)	Conc. Pt. (lbs)	L	02-03-14	02-03-14	115	58			n/a
2	J7(i1486)	Conc. Pt. (lbs)	L	03-07-14	03-07-14	92	46			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	407 ft-lbs	19,364 ft-lbs	2.1%	1	02-03-14
End Shear	278 lbs	7,232 lbs	3.8%	1	01-03-06
Total Load Defl.	L/999 (0.002")	n/a	n/a	4	02-02-11
Live Load Defl.	L/999 (0.001")	n/a	n/a	5	02-02-11
Max Defl.	0.002"	n/a	n/a	4	02-02-11
Span / Depth	4	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Post	3-1/2" x 1-3/4"	360 lbs	9%	4.8%	Unspecified
B1 Post	1-3/4" x 1-3/4"	358 lbs	18%	9.6%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

CONFORMS TO DBC 2012

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

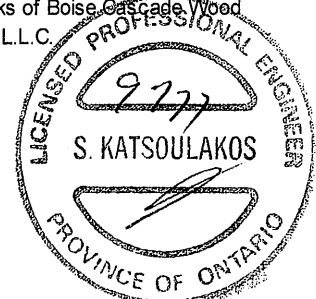



Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B5(i4262)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 12:31:06

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B5(i4262)

Specifier:

Designer:

Company:

Misc:

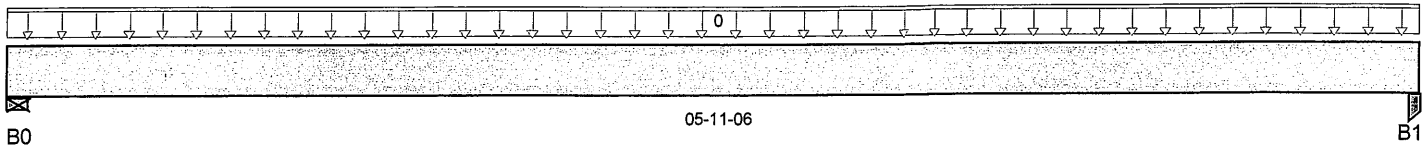

Total Horizontal Product Length = 05-11-06

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/8"	37 / 0	36 / 0		
B1, 3-1/2"	38 / 0	37 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
0 FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-11-06	13	6			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	135 ft-lbs	19,364 ft-lbs	0.7%	1	02-11-02
End Shear	60 lbs	7,232 lbs	0.8%	1	01-02-04
Total Load Defl.	L/999 (0.001")	n/a	n/a	4	02-11-02
Live Load Defl.	L/999 (0.001")	n/a	n/a	5	02-11-02
Max Defl.	0.001"	n/a	n/a	4	02-11-02
Span / Depth	5.6	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	2-3/8" x 1-3/4"	101 lbs	5.7%	2%	Unspecified
B1 Post	3-1/2" x 1-3/4"	104 lbs	2.6%	1.4%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCK®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B6L(i4577)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 11, 2017 10:09:17

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B6L(i4577

Specifier:

Designer:

Company:

Misc:

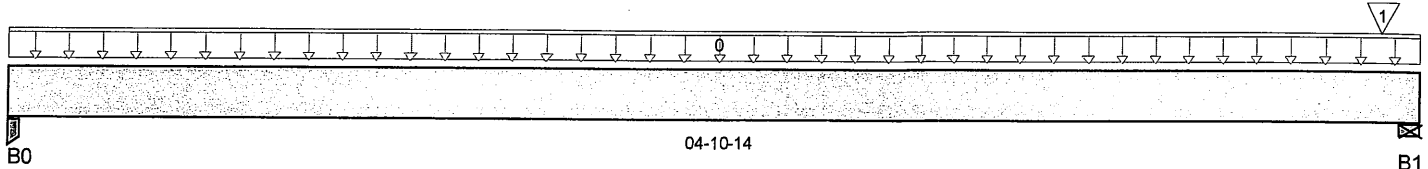

Total Horizontal Product Length = 04-10-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 1-3/4"	62 / 0	43 / 0		
B1, 4-3/8"	222 / 0	195 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
0	FC 1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	04-10-14	27	13			n/a
1	5(i652)	Conc. Pt. (lbs)	L	04-09-04	04-09-04	154	148			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	160 ft-lbs	12,704 ft-lbs	1.3%	1	02-04-02
End Shear	88 lbs	5,785 lbs	1.5%	1	00-11-04
Total Load Defl.	L/999 (0.002")	n/a	n/a	4	02-04-02
Live Load Defl.	L/999 (0.001")	n/a	n/a	5	02-04-02
Max Defl.	0.002"	n/a	n/a	4	02-04-02
Span / Depth	5.7	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Post	1-3/4" x 1-3/4"	147 lbs	5.9%	3.9%	Unspecified
B1 Wall/Plate	4-3/8" x 1-3/4"	577 lbs	14.1%	6.2%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO DBC 2012

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCK®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 11, 2017 10:09:17

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmd


Description: Designs\Flush Beams\Basement\Flush Beams\B7L(i4574

Specifier:

Designer:

Company:

Misc:

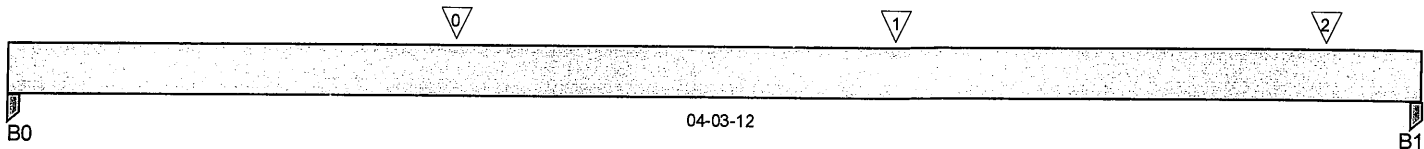

Total Horizontal Product Length = 04-03-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 1-3/4"	173 / 0	97 / 0		
B1, 3-1/2"	314 / 0	169 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	J2(i4437)	Conc. Pt. (lbs)	L	01-04-04	01-04-04	169	85			n/a
1	J2(i4516)	Conc. Pt. (lbs)	L	02-08-04	02-08-04	159	80			n/a
2	J2(i4465)	Conc. Pt. (lbs)	L	04-00-04	04-00-04	159	80			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	492 ft-lbs	12,704 ft-lbs	3.9%	1	02-08-04
End Shear	675 lbs	5,785 lbs	11.7%	1	03-02-12
Total Load Defl.	L/999 (0.004")	n/a	n/a	4	02-00-12
Live Load Defl.	L/999 (0.003")	n/a	n/a	5	02-00-12
Max Defl.	0.004"	n/a	n/a	4	02-00-12
Span / Depth	5.1	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Post	1-3/4" x 1-3/4"	381 lbs	15.3%	10.2%	Unspecified
B1 Post	3-1/2" x 1-3/4"	681 lbs	13.7%	9.1%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 11, 2017 10:09:17

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B8L(i4477

Specifier:

Designer:

Company:

Msc:

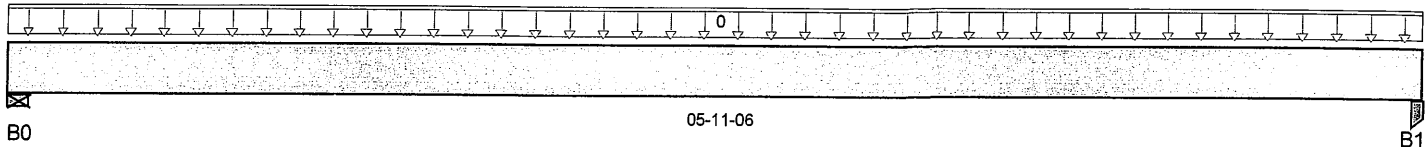

Total Horizontal Product Length = 05-11-06

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/8"	88 / 0	58 / 0		
B1, 3-1/2"	91 / 0	60 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
0	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-11-06	30	15	1.00	1.15	n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	272 ft-lbs	12,704 ft-lbs	2.1%	1	02-11-02
End Shear	135 lbs	5,785 lbs	2.3%	1	00-11-14
Total Load Defl.	L/999 (0.004")	n/a	n/a	4	02-11-02
Live Load Defl.	L/999 (0.003")	n/a	n/a	5	02-11-02
Max Defl.	0.004"	n/a	n/a	4	02-11-02
Span / Depth	7.1	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	2-3/8" x 1-3/4"	204 lbs	9.2%	4%	Unspecified
B1 Post	3-1/2" x 1-3/4"	211 lbs	4.2%	2.8%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO DBC 2012



BC CALC® Design Report

Dry | 1 span | No cant.

March 2, 2018 16:40:01

Build 6215

Job name:

File name: DEWBERRY 2E.mmdl

Address:

Description: 1st Floor\Flush Beams\B10(i10008)

City, Province, Postal Code: WAT...WN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

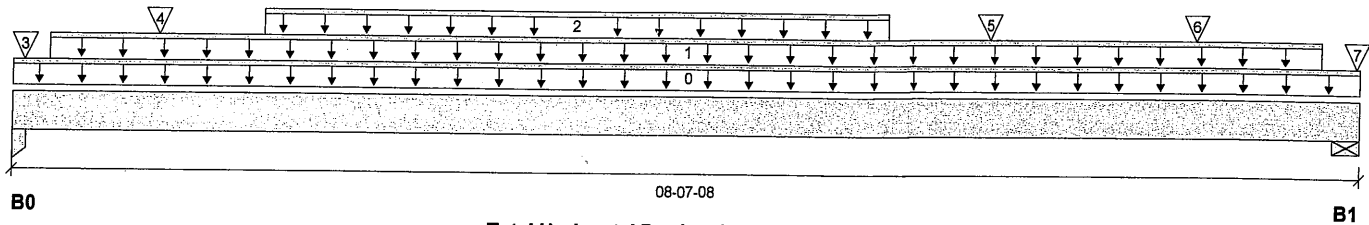

Total Horizontal Product Length = 08-07-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/4"	3,743 / 0	2,364 / 0		
B1, 2-7/8"	3,498 / 0	2,243 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-07-08		18			00-00-00
1	E38(i2051)	Unf. Lin. (lb/ft)	L	00-02-12	08-04-10		81			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	01-07-02	05-07-02	466	233			n/a
3	PBO7(i9503)	Conc. Pt. (lbs)	L	00-00-14	00-00-14	1,857	1,013			n/a
4	-	Conc. Pt. (lbs)	L	00-11-02	00-11-02	652	326			n/a
5	-	Conc. Pt. (lbs)	L	06-03-02	06-03-02	562	279			n/a
6	-	Conc. Pt. (lbs)	L	07-07-02	07-07-02	514	257			n/a
7	E48(i7543)	Conc. Pt. (lbs)	L	08-07-04	08-07-04	1,775	975			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	9,333 ft-lbs	55,212 ft-lbs	16.9%	1	04-02-02
End Shear	3,982 lbs	21,696 lbs	18.4%	1	01-02-10
Total Load Deflection	L/999 (0.057")	n/a	n/a	4	04-03-02
Live Load Deflection	L/999 (0.033")	n/a	n/a	5	04-03-02
Max Defl.	0.057"	n/a	n/a	4	04-03-02
Span / Depth	8.4				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Column 2-3/4" x 5-1/4"	8,570 lbs	73.1%	48.7%	Unspecified
B1	Wall/Plate 2-7/8" x 5-1/4"	8,050 lbs	99.9%	43.7%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume member is fully braced.
 Resistance Factor phi has been applied to all presented results per CSA O86.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 9
 CONFORMS TO OBC 2012
 Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
 Nailing schedule applies to both sides of the member.



DWG NO. TAM 11845-18
 STRUCTURAL
 COMPONENT ONLY



Triple 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

1st Floor\Flush Beams\B10(i10008)

Dry | 1 span | No cant.

March 2, 2018 16:40:01

File name: DEWBERRY 2E.mmdl


Description: 1st Floor\Flush Beams\B10(i10008)

Specifier:

Designer: AJ

Company:

Connection Diagram

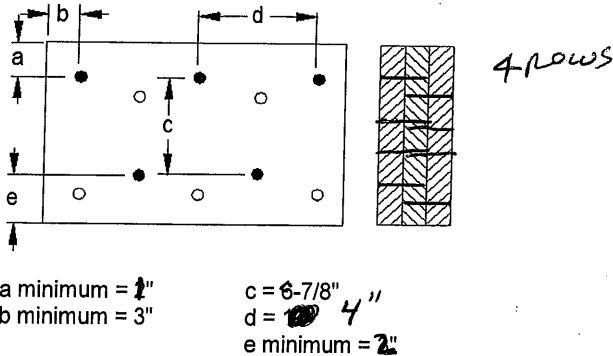

Calculated Side Load = 657.9 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Common Nails

3-1/2" ARDOX SPIRAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®
DWG NO. TAM 11845-18
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B11(i4411)

Specifier:

Designer:

Company:

Misc:

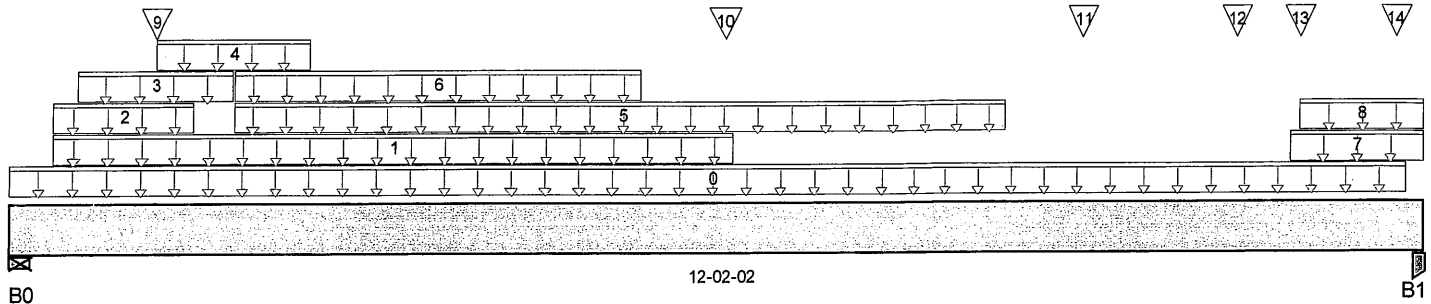

Total Horizontal Product Length = 12-02-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 4-3/8"	4,929 / 0	2,949 / 0		
B1, 3-1/2"	6,148 / 0	3,473 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	12-00-06	24	12			n/a
1	E37(i2050)	Unf. Lin. (lb/ft)	L	00-04-06	06-02-06		81			n/a
2	E37(i2050)	Unf. Lin. (lb/ft)	L	00-04-06	01-06-14	215	108			n/a
3	E37(i2050)	Unf. Lin. (lb/ft)	L	00-06-14	01-10-14	244	122			n/a
4	E37(i2050)	Unf. Lin. (lb/ft)	L	01-02-14	02-06-14	220	110			n/a
5	Smoothed Load	Unf. Lin. (lb/ft)	L	01-10-14	08-06-14	294	147			n/a
6	E37(i2050)	Unf. Lin. (lb/ft)	L	01-10-14	05-04-14	563	282			n/a
7	E38(i2051)	Unf. Lin. (lb/ft)	L	11-00-06	12-02-02	389	276			n/a
8	E38(i2051)	Unf. Lin. (lb/ft)	L	11-01-06	12-02-02	208	104			n/a
9	J1(i4297)	Conc. Pt. (lbs)	L	01-02-14	01-02-14	359	179			n/a
10	E37(i2050)	Conc. Pt. (lbs)	L	06-01-06	06-01-06	1,701	883			n/a
11	J1(i4368)	Conc. Pt. (lbs)	L	09-02-14	09-02-14	428	214			n/a
12	J1(i4273)	Conc. Pt. (lbs)	L	10-06-14	10-06-14	408	204			n/a
13	E38(i2051)	Conc. Pt. (lbs)	L	11-01-06	11-01-06	1,366	716			n/a
14	-	Conc. Pt. (lbs)	L	11-11-03	11-11-03	1,068	566			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	32,991 ft-lbs	60,415 ft-lbs	54.6%	1	06-01-06
End Shear	10,339 lbs	21,696 lbs	47.7%	1	01-04-04
Total Load Defl.	L/374 (0.374")	0.582"	64.2%	4	05-11-04
Live Load Defl.	L/591 (0.237")	0.388"	61%	5	05-11-04
Max Defl.	0.374"	n/a	n/a	4	05-11-04
Span / Depth	11.8	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
------------------	--------------	--------	-----------------------------	----------------------------	----------



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B11(i44

Specifier:

Designer:

Company:

Misc:

B0	Wall/Plate	4-3/8" x 5-1/4"	11,080 lbs	90.3%	39.5%	Unspecified
B1	Post	3-1/2" x 5-1/4"	13,563 lbs	90.9%	60.5%	Unspecified

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO CBC 2012

Connection Diagram

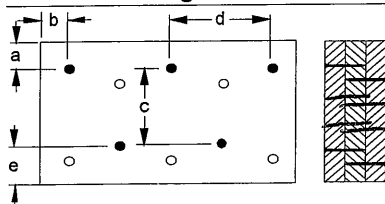

4 rows

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

a minimum = 2" c = 8 7/8"
b minimum = 3" d = 6"
e minimum = 2"

Calculated Side Load = 626.0 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL



DWG NO. TAM 45005-17
**STRUCTURAL
COMPONENT ONLY**

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B12(i4394)

Specifier:

Designer:

Company:

Misc:

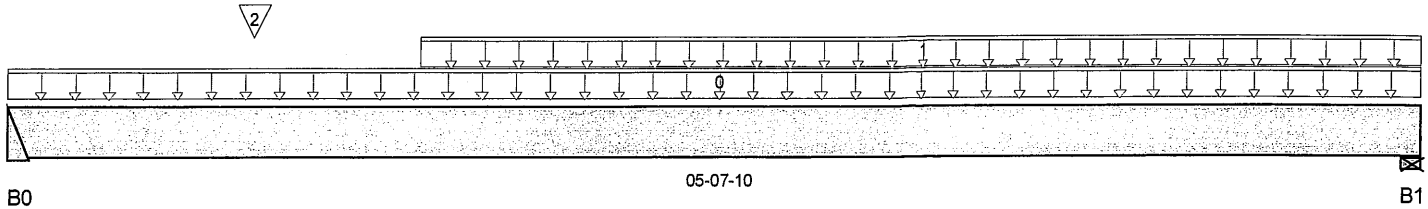

Total Horizontal Product Length = 05-07-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	639 / 0	353 / 0		
B1, 2-3/4"	833 / 0	487 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC3 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-07-10	22	11			n/a
1	Smoothed Load	Unf. Lin. (lb/ft)	L	01-07-10	05-07-10	261	140			n/a
2	J3(i4371)	Conc. Pt. (lbs)	L	00-11-10	00-11-10	300	150			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,061 ft-lbs	38,727 ft-lbs	5.3%	1	02-03-10
End Shear	1,206 lbs	14,464 lbs	8.3%	1	01-01-14
Total Load Defl.	L/999 (0.008")	n/a	n/a	4	02-09-10
Live Load Defl.	L/999 (0.005")	n/a	n/a	5	02-09-10
Max Defl.	0.008"	n/a	n/a	4	02-09-10
Span / Depth	5.4	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	1,400 lbs	n/a	16.4%	Hanger
B1 Wall/Plate	2-3/4" x 3-1/2"	1,857 lbs	45.2%	15.8%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO OBC 2012

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B12(i4394)


Specifier:

Designer:

Company:

Msc:

Connection Diagram

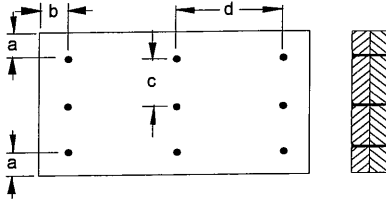

a minimum = 2" c = 3-15/16"
b minimum = 3" d = ~~20~~ 6"

Calculated Side Load = 471.4 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALCO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.




DWG NO. TAM 45006-17
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report


Build 5033
 Job Name:
 Address:
 City, Province, Postal Code: WATERDOWN,
 Customer:
 Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl
 Description: Designs\Flush Beams\1st Floor\Flush Beams\B13A(i5121)
 Specifier:
 Designer:
 Company:
 Misc:

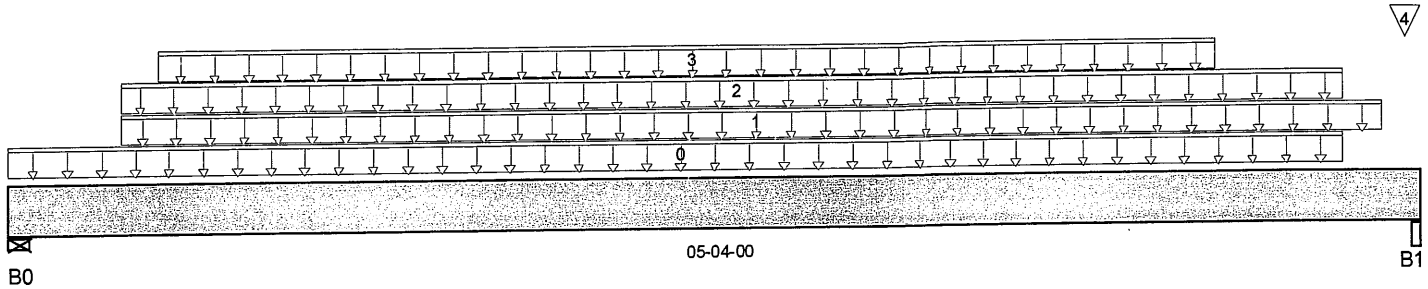

Total Horizontal Product Length = 05-04-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5"	654 / 0	823 / 0	241 / 0	
B1, 3-1/2"	580 / 0	785 / 0	241 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	E36(i1694)	Unf. Lin. (lb/ft)	L	00-00-00	05-00-08	29	101			n/a
1	User Load	Unf. Lin. (lb/ft)	L	00-05-00	05-02-04		80			n/a
2	User Load	Unf. Lin. (lb/ft)	L	00-05-00	05-00-08	44	40	104		n/a
3	Smoothed Load	Unf. Lin. (lb/ft)	L	00-06-12	04-06-12	220	110			n/a
4	E41(i2056)	Conc. Pt. (lbs)	L	05-03-04	05-03-04		28			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,650 ft-lbs	38,727 ft-lbs	6.8%	1	02-06-12
End Shear	1,491 lbs	14,464 lbs	10.3%	1	01-04-14
Total Load Defl.	L/999 (0.008")	n/a	n/a	35	02-08-12
Live Load Defl.	L/999 (0.004")	n/a	n/a	51	02-08-12
Max Defl.	0.008"	n/a	n/a	35	02-08-12
Span / Depth	4.8	n/a	n/a		00-00-00

Bearing Supports

			Demand/ Resistance Support	Demand/ Resistance Member	Material	
Bearing Supports	Dim. (L x W)	Demand				
B0	Wall/Plate	5" x 3-1/2"	2,129 lbs	22.8%	10%	Unspecified
B1	Beam	3-1/2" x 3-1/2"	1,972 lbs	14.8%	13.2%	Unspecified

Notes


DWG NO. TAM 45007-17
 STRUCTURAL
 COMPONENT ONLY

BC CALC® Design Report



Build 5033
Job Name:
Address:
City, Province, Postal Code: WATERDOWN,
Customer:
Code reports: CCMC 12472-R

File Name: DEWBERRY2E.mmdl
Description: Designs\Flush Beams\1st Floor\Flush Beams\B13A(i5
Specifier:
Designer:
Company:
Misc:


Design meets Code minimum (L/240) Total load deflection criteria.
Design meets Code minimum (L/360) Live load deflection criteria.
Calculations assume member is fully braced.
Resistance Factor phi has been applied to all presented results per CSA O86.
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
CONFORMS TO OBC 2012
Unbalanced snow loads determined from building geometry were used in selected product's verification.
Design based on Dry Service Condition.
Importance Factor: Normal Part code: Part 9

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Connection Diagram

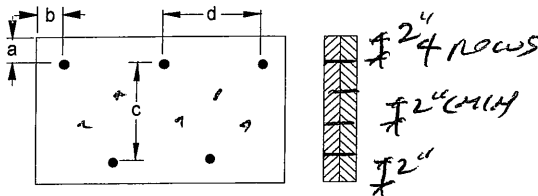

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 4"

Calculated Side Load = 349.8 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL



DW000.TAM 45007-17
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: DEWBERRY 2E.mxd


Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B16

Specifier:

Designer:

Company:

Misc:

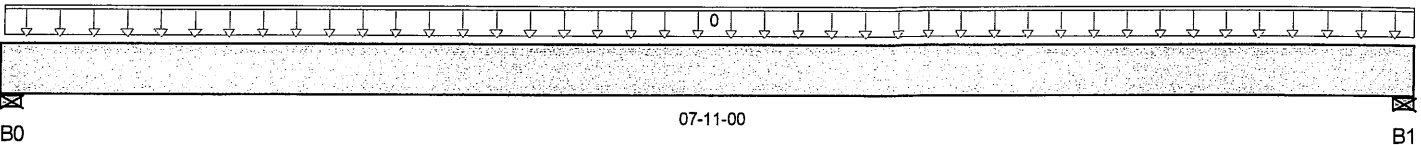

Total Horizontal Product Length = 07-11-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5-1/2"	1,276 / 0	687 / 0		
B1, 5-1/2"	1,322 / 0	710 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
0 Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-04	07-11-00	329	165			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	4,439 ft-lbs	38,727 ft-lbs	11.5%	1	03-04-04
End Shear	2,044 lbs	14,464 lbs	14.1%	1	01-05-06
Total Load Defl.	L/999 (0.03")	n/a	n/a	4	03-11-04
Live Load Defl.	L/999 (0.019")	n/a	n/a	5	03-11-04
Max Defl.	0.03"	n/a	n/a	4	03-11-04
Span / Depth	7.2	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Support Resistance	Demand / Member Resistance	Material
B0 Wall/Plate	5-1/2" x 3-1/2"	2,774 lbs	22.2%	11.8%	Unspecified
B1 Wall/Plate	5-1/2" x 3-1/2"	2,870 lbs	23%	12.2%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO OBC 2012

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9


10/12

DWG NO. TAM 4500817
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2E.mmdl

Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B


Specifier:

Designer:

Company:

Misc:

Connection Diagram

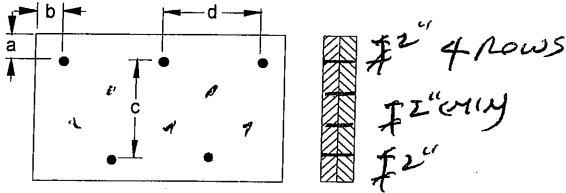

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods.

Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 45008-17
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\2nd Floor\Flush Beams\B17(i4316

Specifier:

Designer:

Company:

Misc:

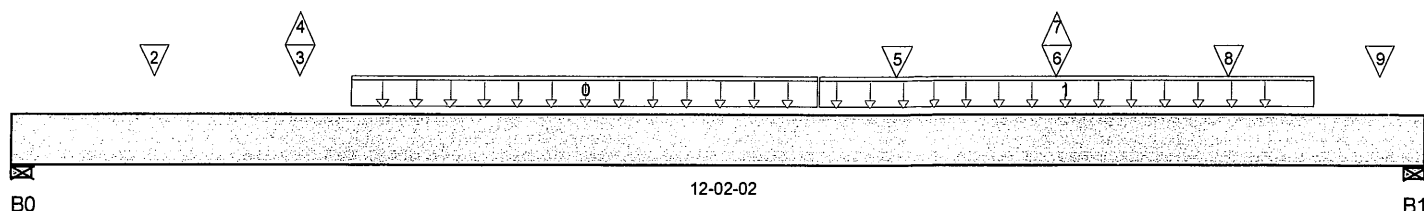

Total Horizontal Product Length = 12-02-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 4-3/8"	2,748 / 16	1,502 / 0	0 / 118	
B1, 4-1/2"	3,185 / 14	1,712 / 0	0 / 98	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	Smoothed Load	Unf. Lin. (lb/ft)	L	02-10-14	06-10-14	508	254			n/a
1	Smoothed Load	Unf. Lin. (lb/ft)	L	06-10-14	11-02-14	250	126			n/a
2	-	Conc. Pt. (lbs)	L	01-02-07	01-02-07	578	289			n/a
3	-	Conc. Pt. (lbs)	L	02-05-08	02-05-08	651	375	-108		n/a
4	-	Conc. Pt. (lbs)	L	02-05-08	02-05-08	-15				n/a
5	J4(i4237)	Conc. Pt. (lbs)	L	07-06-14	07-06-14	298	149			n/a
6	-	Conc. Pt. (lbs)	L	09-00-00	09-00-00	384	242	-108		n/a
7	-	Conc. Pt. (lbs)	L	09-00-00	09-00-00	-15				n/a
8	J4(i3980)	Conc. Pt. (lbs)	L	10-05-14	10-05-14	303	151			n/a
9	-	Conc. Pt. (lbs)	L	11-09-06	11-09-06	601	301			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	18,430 ft-lbs	38,727 ft-lbs	47.6%	21	06-02-14
End Shear	5,792 lbs	14,464 lbs	40%	21	01-04-04
Total Load Defl.	L/433 (0.321")	0.578"	55.4%	56	05-11-14
Live Load Defl.	L/667 (0.208")	0.385"	54%	83	05-11-14
Max Defl.	0.321"	n/a	n/a	56	05-11-14
Span / Depth	11.7	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	4-3/8" x 3-1/2"	5,999 lbs	73.4%	32.1%	Unspecified
B1 Wall/Plate	4-1/2" x 3-1/2"	6,918 lbs	82.3%	36%	Unspecified

Notes



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2E.mmdl

Description: Designs\Flush Beams\2nd Floor\Flush Beams\B17(i43

Specifier:

Designer:

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.


CONFORMS TO OBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection Diagram

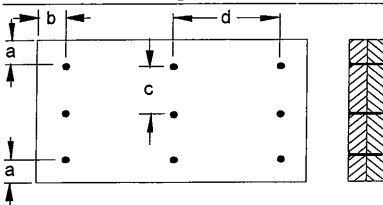

a minimum = 2" c = 3-15/16"
b minimum = 3" d = 6"

Calculated Side Load = 547.6 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 45009-17
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B18

Specifier:

Designer:

Company:

Misc:

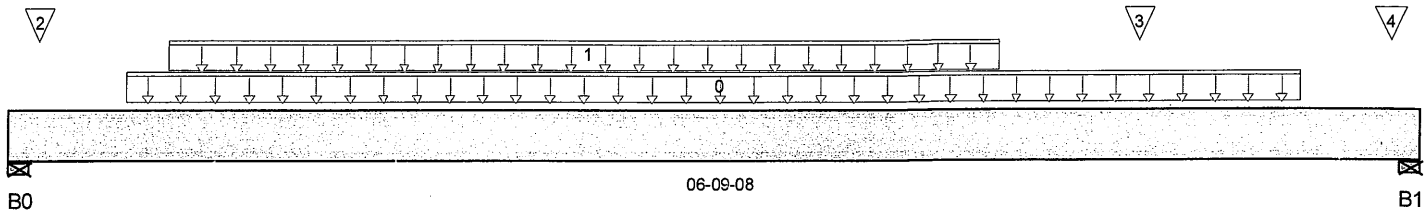

Total Horizontal Product Length = 06-09-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 6-3/4"	1,190 / 0	1,152 / 0	1,457 / 0	
B1, 6-3/4"	1,103 / 0	1,108 / 0	1,457 / 0	

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0 User Load	Unf. Lin. (lb/ft)	L	00-06-12	06-02-12	55	150	180		n/a
1 Smoothed Load	Unf. Lin. (lb/ft)	L	00-09-04	04-09-04	236	118			n/a
2 B19(i3917)	Conc. Pt. (lbs)	L	00-01-12	00-01-12	418	378	947		n/a
3 J4(i4237)	Conc. Pt. (lbs)	L	05-05-04	05-05-04	301	150			n/a
4 B20(i4148)	Conc. Pt. (lbs)	L	06-07-12	06-07-12	320	329	947		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	3,651 ft-lbs	38,727 ft-lbs	9.4%	1	03-04-04
End Shear	1,924 lbs	14,464 lbs	13.3%	1	01-06-10
Total Load Defl.	L/999 (0.017")	n/a	n/a	35	03-04-04
Live Load Defl.	L/999 (0.01")	n/a	n/a	51	03-04-04
Max Defl.	0.017"	n/a	n/a	35	03-04-04
Span / Depth	5.9	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	6-3/4" x 3-1/2"	4,220 lbs	27.5%	14.6%	Unspecified
B1 Wall/Plate	6-3/4" x 3-1/2"	4,122 lbs	26.9%	14.3%	Unspecified

Notes

 DWG NO. TAM 45010-17
 STRUCTURAL
 COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl

Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B

Specifier:

Designer:

Company:

Msc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9


CONFORMS TO OBC 2012

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Connection Diagram

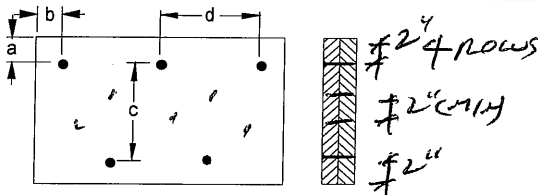

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL



POZ

DWG NO. TAM 45010-17
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\2nd Floor\Flush Beams\B19(i3917

Specifier:

Designer:

Company:

Msc:

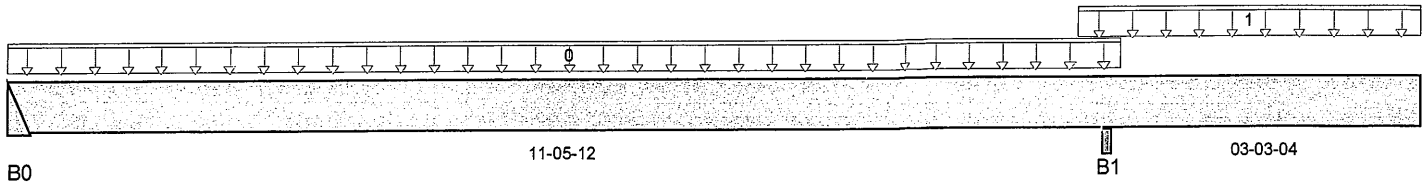

Total Horizontal Product Length = 14-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	280 / 16	190 / 0	0 / 110	
B1, 3-1/2"	416 / 0	376 / 0	947 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC4 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	11-07-08	48	24			n/a
1	User Load	Unf. Lin. (lb/ft)	L	11-02-00	14-09-00	33	30	234		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,768 ft-lbs	36,706 ft-lbs	4.8%	44	05-07-04
Neg. Moment	-2,247 ft-lbs	-36,706 ft-lbs	6.1%	49	11-05-12
End Shear	521 lbs	14,464 lbs	3.6%	44	01-01-14
Cont. Shear	897 lbs	14,464 lbs	6.2%	49	12-07-06
Uplift	1 lbs	n/a	n/a	87	00-00-00
Total Load Defl.	L/999 (0.029")	n/a	n/a	107	05-09-00
Live Load Defl.	2xL/1,998 (0.036")	n/a	n/a	206	14-09-00
Total Neg. Defl.	2xL/1,998 (-0.024")	n/a	n/a	107	14-09-00
Max Defl.	0.029"	n/a	n/a	107	05-09-00
Span / Depth	11.5	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	658 lbs	n/a	7.7%	Hanger
B0 Hanger Uplift	2" x 3-1/2"	1 lbs	n/a	0.00	Hanger
B1 Beam	3-1/2" x 3-1/2"	2,099 lbs	19.6%	14%	Unspecified

Notes


BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: DEWBERRY2E.mmdl

Description: Designs\Flush Beams\2nd Floor\Flush Beams\B19(i39

Specifier:

Designer:

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets User specified (2xL/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 03-01-08, Bottom: 03-01-08.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO CBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Connection Diagram

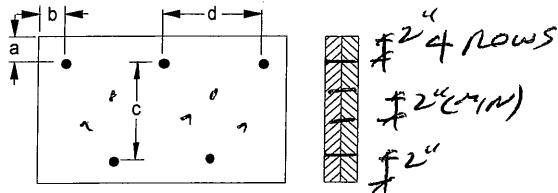

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDDX SPIRAL

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



P62

DWG NO. TAM 45011-17
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report


Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\2nd Floor\Flush Beams\B20(i4148

Specifier:

Designer:

Company:

Misc:

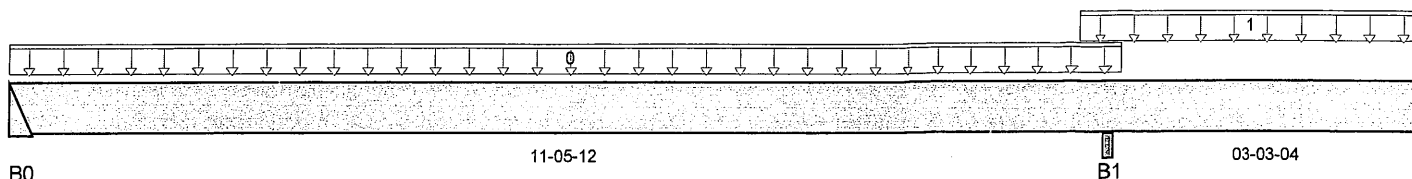

Total Horizontal Product Length = 14-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	184 / 16	142 / 0	0 / 110	
B1, 3-1/2"	318 / 0	327 / 0	947 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC4 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	11-07-08	32	16			n/a
1	User Load	Unf. Lin. (lb/ft)	L	11-02-00	14-09-00	33	30	234		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,197 ft-lbs	36,706 ft-lbs	3.3%	44	05-05-09
Neg. Moment	-2,247 ft-lbs	-36,706 ft-lbs	6.1%	49	11-05-12
End Shear	357 lbs	14,464 lbs	2.5%	44	01-01-14
Cont. Shear	897 lbs	14,464 lbs	6.2%	49	12-07-06
Uplift	45 lbs	n/a	n/a	87	00-00-00
Total Load Defl.	2xL/1,998 (0.032")	n/a	n/a	154	14-09-00
Live Load Defl.	2xL/1,998 (0.036")	n/a	n/a	206	14-09-00
Total Neg. Defl.	2xL/1,998 (-0.015")	n/a	n/a	107	14-09-00
Max Defl.	0.02"	n/a	n/a	107	05-07-04
Span / Depth	11.5	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	453 lbs	n/a	5.3%	Hanger
B0 Hanger Uplift	2" x 3-1/2"	45 lbs	n/a	0.00	Hanger
B1 Beam	3-1/2" x 3-1/2"	1,989 lbs	18.6%	13.3%	Unspecified

Notes


P12



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl

Description: Designs\Flush Beams\2nd Floor\Flush Beams\B20(i41

Specifier:

Designer:

Company:

Msc:

Design meets User specified (2xL/240) Total load deflection criteria.

Design meets User specified (2xL/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 03-01-08, Bottom: 03-01-08.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO OBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Connection Diagram

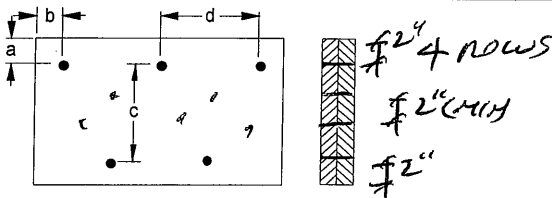

a minimum = 2" c = 7-7/8" 6"
b minimum = 3" d = 6"

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 45012-17
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\2nd Floor\Flush Beams\B21(i4363

Specifier:

Designer:

Company:

Misc:

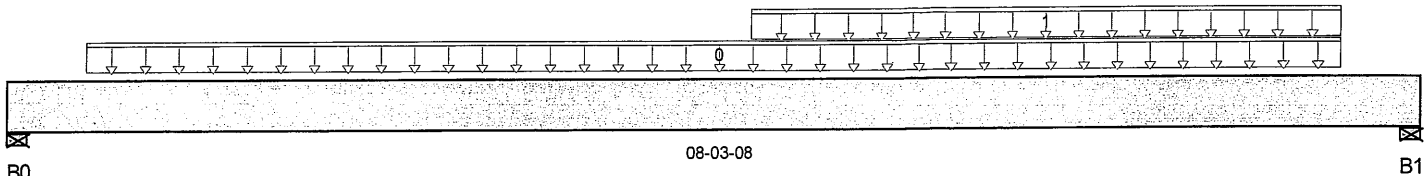

Total Horizontal Product Length = 08-03-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5-1/2"	262 / 0	181 / 0		
B1, 5-1/2"	688 / 0	394 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0 FC4 Floor Material	Unf. Lin. (lb/ft)	L	00-05-08	07-10-00	14	7			n/a
1 User Load	Unf. Lin. (lb/ft)	L	04-04-00	07-10-00	240	120			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,171 ft-lbs	38,727 ft-lbs	5.6%	1	05-01-07
End Shear	968 lbs	14,464 lbs	6.7%	1	06-10-02
Total Load Defl.	L/999 (0.015")	n/a	n/a	4	04-04-15
Live Load Defl.	L/999 (0.009")	n/a	n/a	5	04-04-15
Max Defl.	0.015"	n/a	n/a	4	04-04-15
Span / Depth	7.6	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	5-1/2" x 3-1/2"	619 lbs	7.5%	2.6%	Unspecified
B1 Wall/Plate	5-1/2" x 3-1/2"	1,524 lbs	18.5%	6.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012


BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl

Description: Designs\Flush Beams\2nd Floor\Flush Beams\B21(i43


Specifier:

Designer:

Company:

Misc:

Connection Diagram

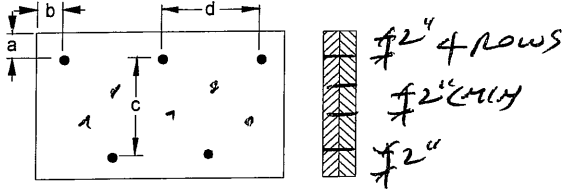

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 4501317
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

2nd Floor Flush Beams B22(i9543)

Dry | 1 span | No cant.

March 2, 2018 16:40:01


File name: DEWBERRY 2E.mmdl

Description: 2nd Floor Flush Beams B22(i9543)

Specifier:

Designer: AJ

Company:

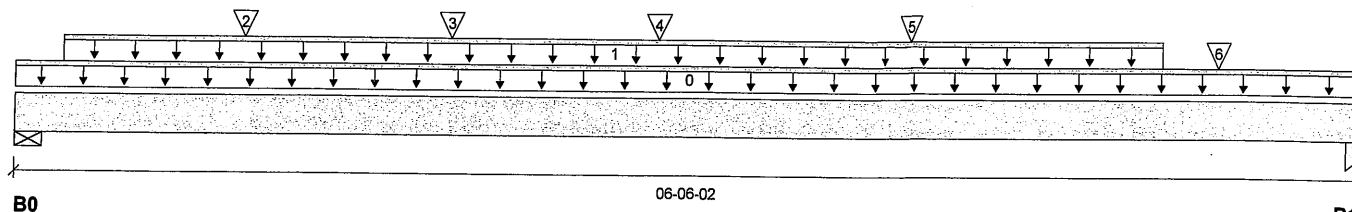

Total Horizontal Product Length = 06-06-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 4-3/4"	1,708 / 0	895 / 0		
B1, 1-3/4"	1,785 / 0	931 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-06-02		12			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-02-12	05-06-12	270	136			n/a
2	J1(i9644)	Conc. Pt. (lbs)	L	01-01-04	01-01-04	293	146			n/a
3	J1(i9557)	Conc. Pt. (lbs)	L	02-01-04	02-01-04	293	146			n/a
4	J1(i9602)	Conc. Pt. (lbs)	L	03-01-04	03-01-04	356	178			n/a
5	J1(i9580)	Conc. Pt. (lbs)	L	04-04-00	04-04-00	409	205			n/a
6	-	Conc. Pt. (lbs)	L	05-10-01	05-10-01	699	350			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	5,904 ft-lbs	35,392 ft-lbs	16.7%	1	03-06-12
End Shear	3,132 lbs	14,464 lbs	21.7%	1	05-04-08
Total Load Deflection	L/999 (0.028")	n/a	n/a	4	03-04-00
Live Load Deflection	L/999 (0.019")	n/a	n/a	5	03-04-00
Max Defl.	0.028"	n/a	n/a	4	03-04-00
Span / Depth	6.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B0	Wall/Plate 4-3/4" x 3-1/2"	3,681 lbs	41.5%	18.1%	Unspecified
B1	Column 1-3/4" x 3-1/2"	3,842 lbs	77.2%	51.4%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

CONFORMS TO OBC 2012


DWG NO. TAM 11846-18
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

2nd Floor\Flush Beams\B22(i9543)

Dry | 1 span | No cant.

March 2, 2018 16:40:01

File name: DEWBERRY 2E.mmdl


Description: 2nd Floor\Flush Beams\B22(i9543)

Specifier:

Designer: AJ

Company:

Connection Diagram

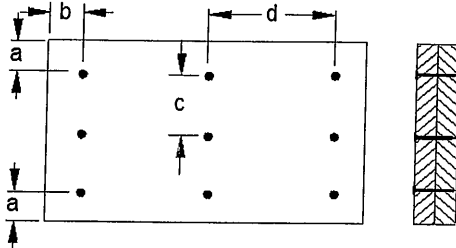

a minimum = 2"

b minimum = 3"

c = 4"

d = 3"

Calculated Side Load = 580.6 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®, DWG NO. TAM 11846-8 10/2 STRUCTURAL COMPONENT ONLY



Double 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP 1st Floor\...\B24(i4279)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 12:31:07

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2E.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B24(i4279)

Specifier:

Designer:

Company:

Misc:

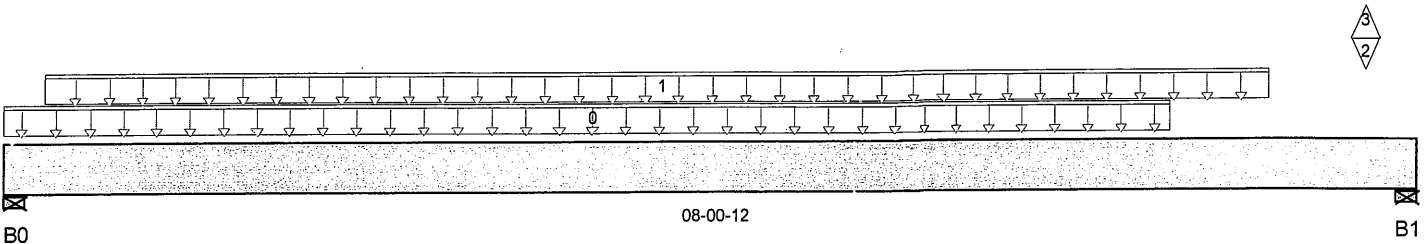

Total Horizontal Product Length = 08-00-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/4"	1,833 / 0	962 / 0		
B1, 5-1/2"	3,547 / 7	1,918 / 0	0 / 50	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-00	06-08-00	243	121			n/a
1	User Load	Unf. Lin. (lb/ft)	L	00-02-12	07-02-12	240	120			n/a
2	-	Conc. Pt. (lbs)	L	07-09-02	07-09-02	2,075	1,133	-50		n/a
3	-	Conc. Pt. (lbs)	L	07-09-02	07-09-02	-7				n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	7,283 ft-lbs	38,727 ft-lbs	18.8%	1	03-10-00
End Shear	3,341 lbs	14,464 lbs	23.1%	1	06-07-06
Total Load Defl.	L/999 (0.054")	n/a	n/a	56	03-11-00
Live Load Defl.	L/999 (0.035")	n/a	n/a	83	03-11-00
Max Defl.	0.054"	n/a	n/a	56	03-11-00
Span / Depth	7.6	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	2-3/4" x 3-1/2"	3,953 lbs	96.1%	33.7%	Unspecified
B1 Wall/Plate	5-1/2" x 3-1/2"	7,718 lbs	93.9%	32.9%	Unspecified

Notes



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2E.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B24(i427

Specifier:

Designer:

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected products verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO CBC 2012

Connection Diagram

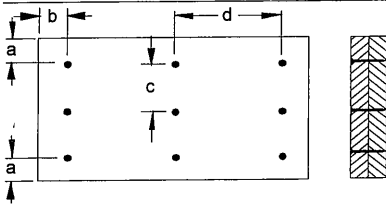

a minimum = 2" c = 3-15/16"
b minimum = 3" d = 6"

Calculated Side Load = 506.6 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 45015-17
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report

1st Floor\Flush Beams\B25(i8026)

Dry | 1 span | No cant.

March 2, 2018 10:43:44

Build 6215

Job name:

File name: DEWBERRY 2E.mmdl

Address:

Description: 1st Floor\Flush Beams\B25(i8026)

City, Province, Postal Code: WAT...WN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

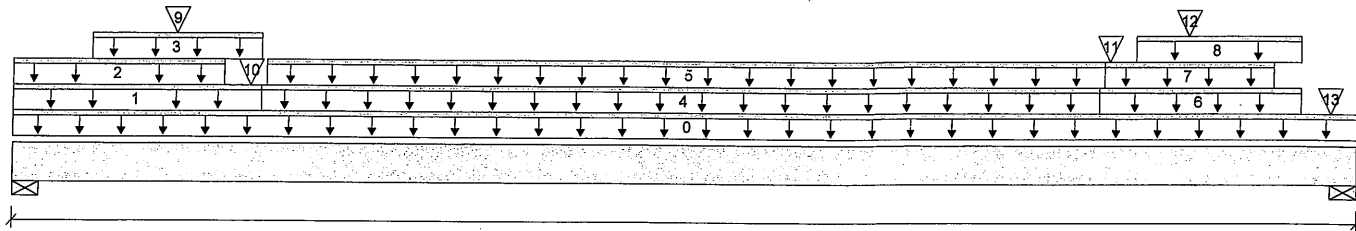

B0

10-07-12

B1

Total Horizontal Product Length = 10-07-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5-1/2"	3,606 / 0	3,399 / 0	3,305 / 0	
B1, 5-1/4"	3,592 / 0	3,393 / 0	3,299 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-07-12		18			00-00-00
1	E45(i5321)	Unf. Lin. (lb/ft)	L	00-00-00	01-11-08		81			n/a
2	E45(i5321)	Unf. Lin. (lb/ft)	L	00-00-00	01-08-00	219	325	619		n/a
3	E45(i5321)	Unf. Lin. (lb/ft)	L	00-07-08	01-11-08	242	121			n/a
4	E44(i5320)	Unf. Lin. (lb/ft)	L	01-11-08	08-07-08		41			n/a
5	Smoothed Load	Unf. Lin. (lb/ft)	L	02-00-00	08-08-00	267	134			n/a
6	E33(i1687)	Unf. Lin. (lb/ft)	L	08-07-08	10-02-08		81			n/a
7	E33(i1687)	Unf. Lin. (lb/ft)	L	08-08-00	10-00-00	245	123			n/a
8	E33(i1687)	Unf. Lin. (lb/ft)	L	08-11-00	10-02-08	219	325	619		n/a
9	J3(i8022)	Conc. Pt. (lbs)	L	01-03-08	01-03-08	278	137			n/a
10	E45(i5321)	Conc. Pt. (lbs)	L	01-10-08	01-10-08	1,660	1,668	2,250		n/a
11	E33(i1687)	Conc. Pt. (lbs)	L	08-08-08	08-08-08	1,673	1,670	2,238		n/a
12	J3(i8033)	Conc. Pt. (lbs)	L	09-04-00	09-04-00	329	164			n/a
13	E48(i7543)	Conc. Pt. (lbs)	L	10-05-04	10-05-04	115	194	284		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	18,090 ft-lbs	55,212 ft-lbs	32.8%	1	05-04-00
End Shear	9,476 lbs	21,696 lbs	43.7%	1	01-05-06
Total Load Deflection	L/665 (0.178")	n/a	36.1%	35	05-04-00
Live Load Deflection	L/999 (0.108")	n/a	n/a	51	05-04-00
Max Defl.	0.178"	n/a	n/a	35	05-04-00
Span / Depth	10.0				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 5-1/2" x 5-1/4"	11,310 lbs	91.7%	32.1%	Unspecified
B1	Wall/Plate 5-1/4" x 5-1/4"	11,277 lbs	95.8%	33.5%	Unspecified


 DWG NO. TAM/11848-8
 STRUCTURAL
 COMPONENT ONLY

1st Floor\Flush Beams\B25(i8026)

Dry | 1 span | No cant.

March 2, 2018 10:43:44

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

File name: DEWBERRY 2E.mmdl

Description: 1st Floor\Flush Beams\B25(i8026)

Specifier:

Designer: AJ

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.


CONFORMS TO OBC 2012

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connection Diagram

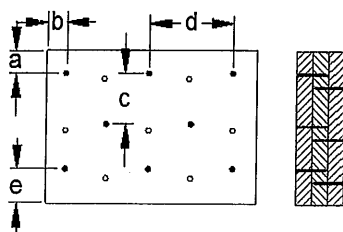

a minimum = 2"

b minimum = 3"

c = 3-1/2"

d = 3"

e minimum = 3"

Calculated Side Load = 476.1 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
DWG NO. TAM 11848-18
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

March 2, 2018 16:40:01


File name: DEWBERRY 2E.mmdl

Description: 2nd Floor\Flush Beams\B26(i9666)

Specifier:

Designer: AJ

Company:

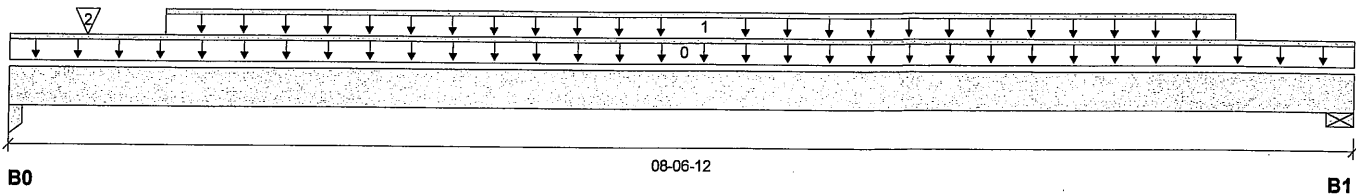

Total Horizontal Product Length = 08-06-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 1-3/4"	1,912 / 0	1,006 / 0		
B1, 2-1/8"	1,583 / 0	841 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-06-12		12			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-11-14	07-09-14	433	216			n/a
2	-	Conc. Pt. (lbs)	L	00-05-14	00-05-14	538	269			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	8,325 ft-lbs	35,392 ft-lbs	23.5%	1	04-05-14
End Shear	3,386 lbs	14,464 lbs	23.4%	1	07-04-12
Total Load Deflection	L/999 (0.075")	n/a	n/a	4	04-02-14
Live Load Deflection	L/999 (0.049")	n/a	n/a	5	04-02-14
Max Defl.	0.075"	n/a	n/a	4	04-02-14
Span / Depth	8.5				

Bearing Supports			Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B0	Column	1-3/4" x 3-1/2"	4,125 lbs	82.9%	55.2%	Unspecified	
B1	Wall/Plate	2-1/8" x 3-1/2"	3,427 lbs	86.3%	37.8%	Unspecified	

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

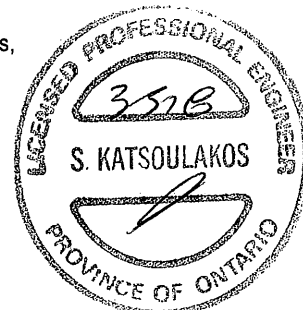
DWG NO. TAM11847-18
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP

PASSED

2nd Floor\Flush Beams\B26(i9666)

Dry | 1 span | No cant.

March 2, 2018 16:40:01

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

File name: DEWBERRY 2E.mmdl


Description: 2nd Floor\Flush Beams\B26(i9666)

Specifier:

Designer: AJ

Company:

Connection Diagram

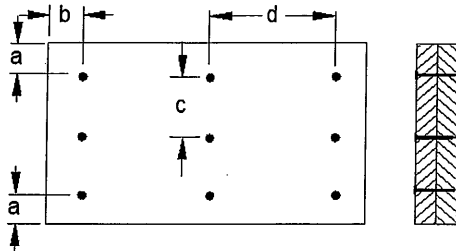

a minimum = 2"

c = 4"

b minimum = 3"

d = 4"

Calculated Side Load = 636.8 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Common Nails

3-1/2" ARDOX SPIRAL

Disclosure



Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. TAM 11B47-18

**STRUCTURAL
COMPONENT ONLY**





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
 Simple Spans, L/480 Deflection Limit
 5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	17'-5"	16'-9"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	22'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

1. Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.


2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.

3. Minimum bearing length shall be 1-3/4 inches for the end bearings.


4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.

5. This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.

6. Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

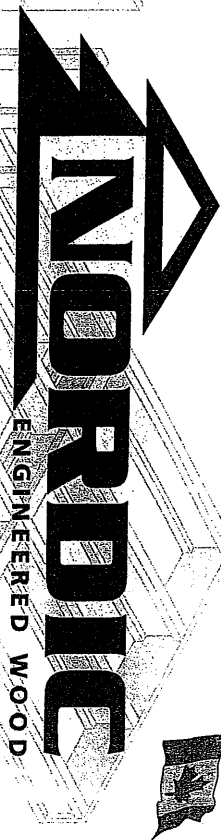

INSTALLATION GUIDE FOR RESIDENTIAL FLOORS

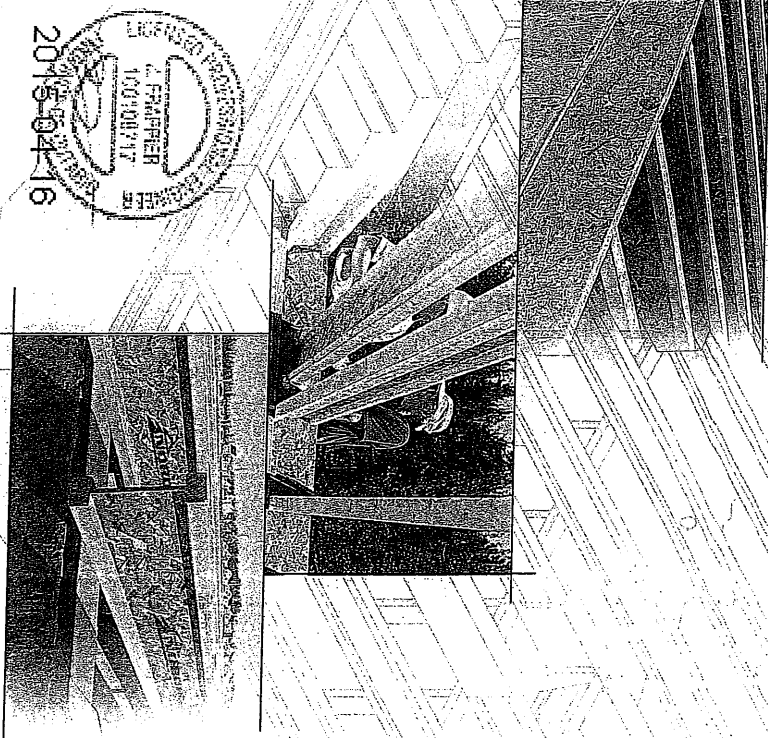

2015-04-16

Distributed by:



N-C301 / November 2014

SAFETY AND CONSTRUCTION PRECAUTIONS

WARNING

I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

Avoid Accidents by Following these Important Guidelines:





1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
 2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
 3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
 4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
 5. Never install a damaged I-joist.
- Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.



Never stack building materials over unsheathed I-joists. Once sheathed, do not over-stress I-joist with concentrated loads from building materials.

STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
 - Pick I-joists in bundles as shipped by the supplier.
 - Orient the bundles so that the webs of the I-joists are vertical.
 - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.



MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to simple-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CGS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit States Design per CAN/CSA O86-09 Standard, and NBC 2010.
7. SI units conversion: 1 inch = 25.4 mm
1 foot = 0.305 m

MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS SIMPLE AND MULTIPLE SPANS

Joist Depth	Joist Series	Simple spans				Multiple spans			
		On centre spacing				On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
12"	NI-20	13.1	12.1	11.9	11.5	14.9	14.2	14.2	14.2
12"	NI-20x	14.1	13.2	13.0	12.6	15.7	15.0	15.0	15.0
12"	NI-20x	15.1	14.1	14.0	13.6	16.7	16.0	16.0	16.0
12"	NI-20x	16.1	15.1	15.0	14.6	17.7	17.0	17.0	17.0
12"	NI-20x	17.1	16.1	16.0	15.6	18.7	18.0	18.0	18.0
12"	NI-20x	18.1	17.1	17.0	16.6	19.7	19.0	19.0	19.0
12"	NI-20x	19.1	18.1	18.0	17.6	20.7	20.0	20.0	20.0
12"	NI-20x	20.1	19.1	19.0	18.6	21.7	21.0	21.0	21.0
12"	NI-20x	21.1	20.1	20.0	19.6	22.7	22.0	22.0	22.0
12"	NI-20x	22.1	21.0	21.0	20.6	23.7	23.0	23.0	23.0
12"	NI-20x	23.1	21.9	21.9	21.0	24.7	24.0	24.0	24.0
12"	NI-20x	24.1	22.8	22.8	21.9	25.7	25.0	25.0	25.0
12"	NI-20x	25.1	23.7	23.7	22.8	26.7	26.0	26.0	26.0
12"	NI-20x	26.1	24.6	24.6	23.7	27.7	27.0	27.0	27.0
12"	NI-20x	27.1	25.5	25.5	24.6	28.7	28.0	28.0	28.0
12"	NI-20x	28.1	26.4	26.4	25.5	29.7	29.0	29.0	29.0
12"	NI-20x	29.1	27.3	27.3	26.4	30.7	30.0	30.0	30.0
12"	NI-20x	30.1	28.2	28.2	27.3	31.7	31.0	31.0	31.0
12"	NI-20x	31.1	29.1	29.1	28.2	32.7	32.0	32.0	32.0
12"	NI-20x	32.1	30.0	30.0	29.1	33.7	33.0	33.0	33.0
12"	NI-20x	33.1	30.9	30.9	30.0	34.7	34.0	34.0	34.0
12"	NI-20x	34.1	31.8	31.8	30.9	35.7	35.0	35.0	35.0
12"	NI-20x	35.1	32.7	32.7	31.8	36.7	36.0	36.0	36.0
12"	NI-20x	36.1	33.6	33.6	32.7	37.7	37.0	37.0	37.0
12"	NI-20x	37.1	34.5	34.5	33.6	38.7	38.0	38.0	38.0
12"	NI-20x	38.1	35.4	35.4	34.5	39.7	39.0	39.0	39.0
12"	NI-20x	39.1	36.3	36.3	35.4	40.7	40.0	40.0	40.0
12"	NI-20x	40.1	37.2	37.2	36.3	41.7	41.0	41.0	41.0
12"	NI-20x	41.1	38.1	38.1	37.2	42.7	42.0	42.0	42.0
12"	NI-20x	42.1	39.0	39.0	38.1	43.7	43.0	43.0	43.0
12"	NI-20x	43.1	39.9	39.9	39.0	44.7	44.0	44.0	44.0
12"	NI-20x	44.1	40.8	40.8	39.9	45.7	45.0	45.0	45.0
12"	NI-20x	45.1	41.7	41.7	40.8	46.7	46.0	46.0	46.0
12"	NI-20x	46.1	42.6	42.6	41.7	47.7	47.0	47.0	47.0
12"	NI-20x	47.1	43.5	43.5	42.6	48.7	48.0	48.0	48.0
12"	NI-20x	48.1	44.4	44.4	43.5	49.7	49.0	49.0	49.0
12"	NI-20x	49.1	45.3	45.3	44.4	50.7	50.0	50.0	50.0
12"	NI-20x	50.1	46.2	46.2	45.3	51.7	51.0	51.0	51.0
12"	NI-20x	51.1	47.1	47.1	46.2	52.7	52.0	52.0	52.0
12"	NI-20x	52.1	48.0	48.0	47.1	53.7	53.0	53.0	53.0
12"	NI-20x	53.1	48.9	48.9	48.0	54.7	54.0	54.0	54.0
12"	NI-20x	54.1	49.8	49.8	48.9	55.7	55.0	55.0	55.0
12"	NI-20x	55.1	50.7	50.7	49.8	56.7	56.0	56.0	56.0
12"	NI-20x	56.1	51.6	51.6	50.7	57.7	57.0	57.0	57.0
12"	NI-20x	57.1	52.5	52.5	51.6	58.7	58.0	58.0	58.0
12"	NI-20x	58.1	53.4	53.4	52.5	59.7	59.0	59.0	59.0
12"	NI-20x	59.1	54.3	54.3	53.4	60.7	60.0	60.0	60.0
12"	NI-20x	60.1	55.2	55.2	54.3	61.7	61.0	61.0	61.0
12"	NI-20x	61.1	56.1	56.1	55.2	62.7	62.0	62.0	62.0
12"	NI-20x	62.1	57.0	57.0	56.1	63.7	63.0	63.0	63.0
12"	NI-20x	63.1	57.9	57.9	57.0	64.7	64.0	64.0	64.0
12"	NI-20x	64.1	58.8	58.8	57.9	65.7	65.0	65.0	65.0
12"	NI-20x	65.1	59.7	59.7	58.8	66.7	66.0	66.0	66.0
12"	NI-20x	66.1	60.6	60.6	59.7	67.7	67.0	67.0	67.0
12"	NI-20x	67.1	61.5	61.5	60.6	68.7	68.0	68.0	68.0
12"	NI-20x	68.1	62.4	62.4	61.5	69.7	69.0	69.0	69.0
12"	NI-20x	69.1	63.3	63.3	62.4	70.7	70.0	70.0	70.0
12"	NI-20x	70.1	64.2	64.2	63.3	71.7	71.0	71.0	71.0
12"	NI-20x	71.1	65.1	65.1	64.2	72.7	72.0	72.0	72.0
12"	NI-20x	72.1	66.0	66.0	65.1	73.7	73.0	73.0	73.0
12"	NI-20x	73.1	66.9	66.9	66.0	74.7	74.0	74.0	74.0
12"	NI-20x	74.1	67.8	67.8	66.9	75.7	75.0	75.0	75.0
12"	NI-20x	75.1	68.7	68.7	67.8	76.7	76.0	76.0	76.0
12"	NI-20x	76.1	69.6	69.6	68.7	77.7	77.0	77.0	77.0
12"	NI-20x	77.1	70.5	70.5	69.6	78.7	78.0	78.0	78.0
12"	NI-20x	78.1	71.4	71.4	70.5	79.7	79.0	79.0	79.0
12"	NI-20x	79.1	72.3	72.3	71.4	80.7	80.0	80.0	80.0
12"	NI-20x	80.1	73.2	73.2	72.3	81.7	81.0	81.0	81.0
12"	NI-20x	81.1	74.1	74.1	73.2	82.7	82.0	82.0	82.0
12"	NI-20x	82.1	75.0	75.0	74.1	83.7	83.0	83.0	83.0
12"	NI-20x	83.1	75.9	75.9	75.0	84.7	84.0	84.0	84.0
12"	NI-20x	84.1	76.8	76.8	75.9	85.7	85.0	85.0	85.0
12"	NI-20x	85.1	77.7	77.7	76.8	86.7	86.0	86.0	86.0
12"	NI-20x	86.1	78.6	78.6	77.7	87.7	87.0	87.0	87.0
12"	NI-20x	87.1	79.5	79.5	78.6	88.7	88.0	88.0	88.0
12"	NI-20x	88.1	80.4	80.4	79.5	89.7	89.0	89.0	89.0
12"	NI-20x	89.1	81.3	81.3	80.4	90.7	90.0	90.0	90.0
12"	NI-20x	90.1	82.2	82.2	81.3	91.7	91.0	91.0	91.0
12"	NI-20x	91.1	83.1	83.1	82.2	92.7	92.0	92.0	92.0
12"	NI-20x	92.1	84.0	84.0	83.1	93.7	93.0	93.0	93.0
12"	NI-20x	93.1	84.9	84.9	84.0	94.7	94.0	94.0	94.0
12"	NI-20x	94.1	85.8	85.8	84.9	95.7	95.0	95.0	95.0
12"	NI-20x	95.1	86.7	86.7	85.8	96.7	96.0	96.0	96.0
12"	NI-20x	96.1	87.6	87.6	86.7	97.7	97.0	97.0	97.0
12"	NI-20x	97.1	88.5	88.5	87.6	98.7	98.0	98.0	98.0
12"	NI-20x	98.1	89.4	89.4	88.5	99.7	99.0	99.0	99.0
12"	NI-20x	99.1	90.3	90.3	89.4	100.7	100.0	100.0	100.0
12"	NI-20x	100.1	91.2	91.2	90.3	101.7	101.0	101.0	101.0
12"	NI-20x	101.1	92.1	92.1	91.2	102.7	102.0	102.0	102.0
12"	NI-20x	102.1	93.0	93.0	92.1	103.7	103.0	103.0	103.0
12"	NI-20x	103.1	93.9	93.9	93.0	104.7	104.0	104.0	104.0
12"	NI-20x	104.1	94.8	94.8	93.9	105.7	105.0	105.0	105.0
12"	NI-20x	105.1	95.7	95.7	94.8	106.7	106.0	106.0	106.0
12"	NI-20x	106.1	96.6	96.6	95.7	107.7	107.0	107.0	107.0
12"	NI-20x	107.1	97.5	97.5	96.6	108.7	108.0	108.0	108.0
12"	NI-20x	108.1	98.4	98.4	97.5	109.7	109.0	109.0	109.0
12"	NI-20x	109.1	99.3	99.3	98.4	110.7	110.0	110.0	110.0
12"	NI-20x	110.1	100.2	100.2	99.3	111.7	111.0	111.0	111.0
12"	NI-20x	111.1	101.1	101.1	100.2	112.7	112.0	112.0	112.0
12"	NI-20x	112.1	102.0	102.0	101.1	113.7	113.0	113.0	113.0
12"	NI-20x	113.1	102.9	102.9	102.0	114.7	114.0	114.0	114.0
12"	NI-20x	114.1	103.8	103.8	102.9	115.7	115.0	115.0	115.0
12"	NI-20x	115.1	104.7	104.7	103.8	116.7	116.0	116.0	116.0
12"	NI-20x	116.1	105.6	105.6	104.7	117.7	117.0	117.0	117.0
12"	NI-20x	117.1	106.5	106.5	105.6	118.7	118.0	118.0	118.0
12"	NI-20x	118.1	107.4	107.4	106.5	119.7	119.0	119.0	119.0
12"	NI-20x	119.1	108.3	108.3	107.4	120.7	120.0	120.0	120.0
12"	NI-20x	120.1	109.2	109.2	108.3	121.7	121.0	121.0	121.0
12"	NI-20x	121.1	110.1	110.1	109.2	122.7	122.0	122.0	122.0
12"	NI-20x	122.1	111.0	111.0	110.1	123.7	123.0	123.0	123.0
12"	NI-20x	123.1	111.9	111.9	111.0	124.7	124.0	124.0	124.0
12"	NI-20x	124.1	112.8	112.8	111.9	125.7	125.0	125.0	125.0
12"	NI-20x	125.1	113.7	113.7	112.8	126.7	126.0	126.0	126.0
12"	NI-20x	126.1	114.6	114.6	113.7	127.7	127.0	127.0	127.0
12"	NI-20x	127.1	115.5	115.5	114.6	128.7	128.0	128.0	128.0
12"	NI-20x	128.1	116.4	116.4	115.5	129.7	129.0	129.0	129.0
12"	NI-20x	129.1	117.3	117.3	116.4	130.7	130.0	130.0	130.0
12"	NI-20x	130.1	118.2	118.2	117.3	131.7	131.0	131.0	131.0
12"	NI-20x	131.1	119.1	119.1	118.2	132.7	132.0	132.0	132.0
12"	NI-20x	132.1	120.0	120.0	119.1	133.7	133.0	133.0	133.0
12"	NI-20x	133.1	120.9	120.9	120.0	134.7	134.0	134.0	134.0
12"	NI-20x	134.1	121.8	121.8	120.9	135.7	135.0	135.0	135.0
12"	NI-20x	135.1	122.7	122.7	121.8	136.7	136.0	136.0	136.0
12"	NI-20x	136.1	123.6	123.6	122.7	137.7	137.0	137.0	137.0
12"	NI-20x	137.1	124.5	124.5	123.6	138.7	138.0	138.0	138.0
12"	NI-20x	138.1	125.4	125.4	124.5	139.7	139.0	139.0	139.0
12"	NI-20x	139.1	126.3	126.3	125.4	140.7	140.0	140.0	140.0
12"	NI-20x	140.1	127.2	127.2	126.3	141.7	141.0	141.0	141

INSTALLING NORDIC I-JOISTS


1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact your supplier.
2. Except for cutting to length, I-joist flanges should **never** be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple-span I-joists must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include rock lighting fixtures, audio equipment and security concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (triple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge **may never** be used as blocking or rim boards. I-joist blocking panels or other engineered wood products – such as rim board – must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.

2015-04-16


2015-04-16

FIGURE 1
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

Some framing requirements such as erection bracing and blocking panels have been omitted for clarity.

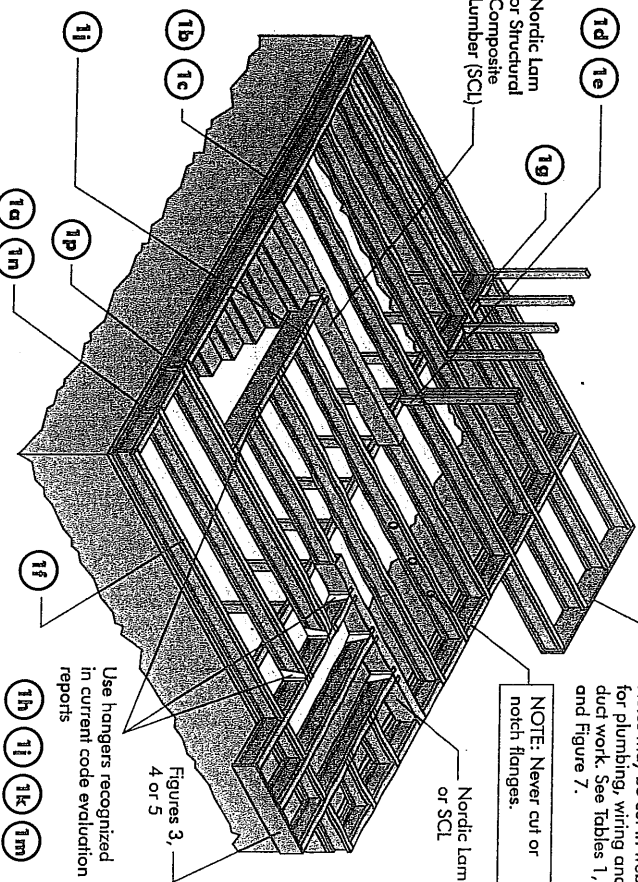


All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

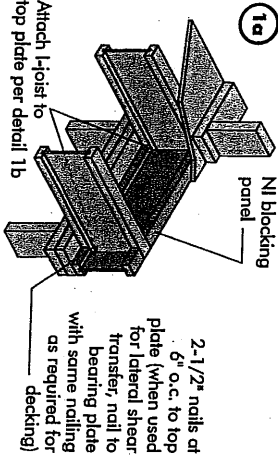


Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
Nl Joists	3,300

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

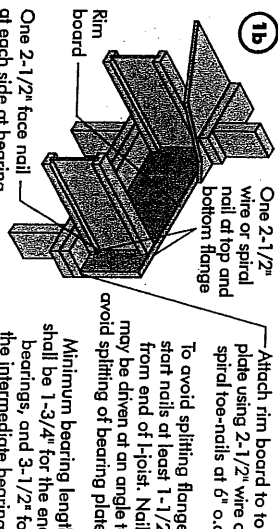


Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
1-1/8" Rim Board Plus	8,090

*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.








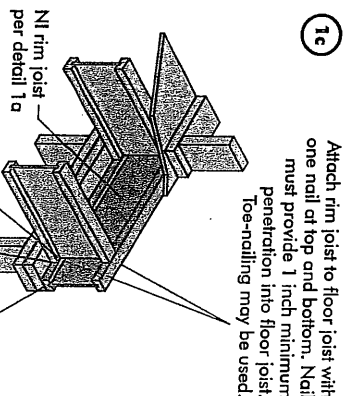


Attach I-joist per detail 1a
Minimum 1-3/4" bearing required

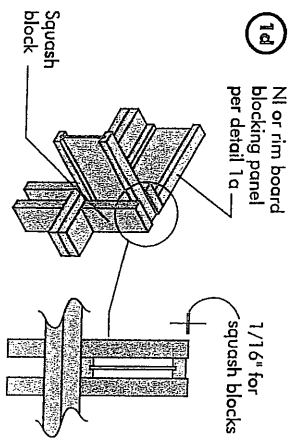

Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (lbs)
2x Lumber	3-1/2" wide 5,500 5-1/2" wide 8,500
1-1/8" Rim Board Plus	4,300 6,600

Provide lateral bracing per detail 1a, 1b, or 1c

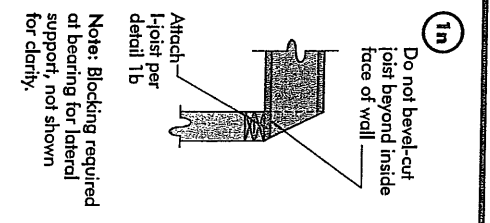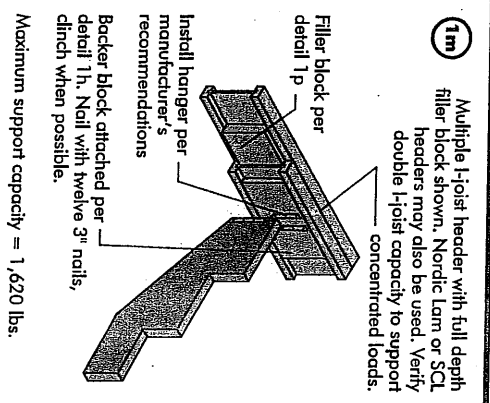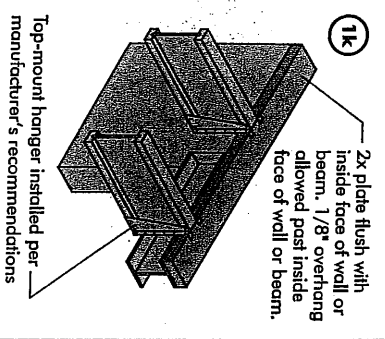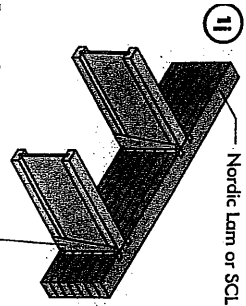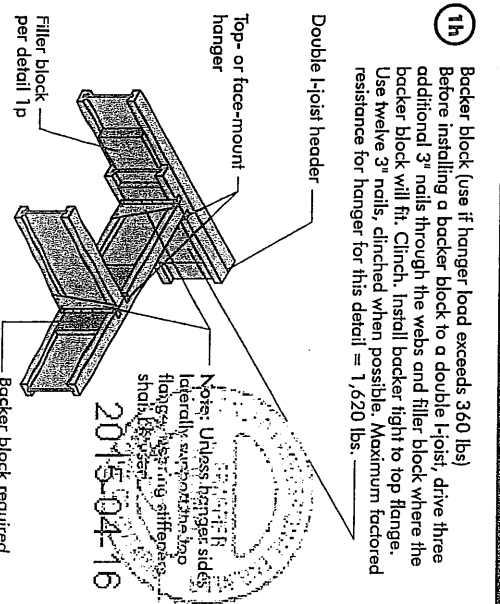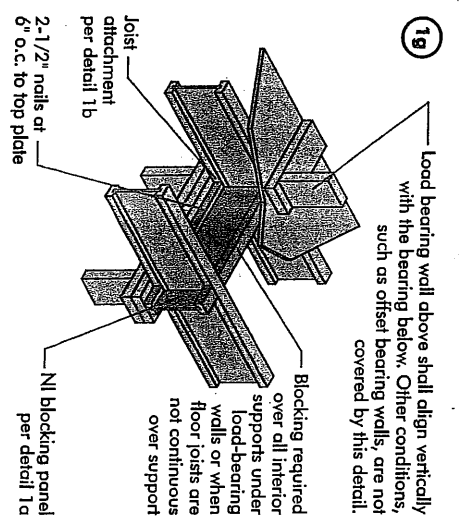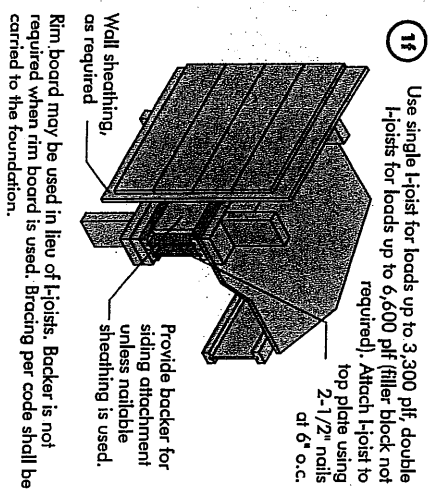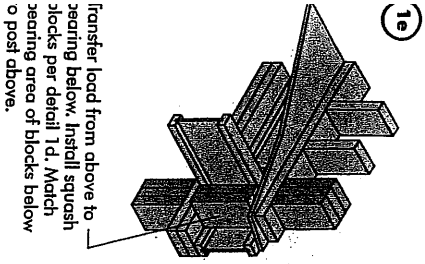

Flange Width	Material Thickness Required*	Minimum Depth**
2-1/2"	1"	5-1/2"
3-1/2"	1-1/2"	7-1/4"

* Minimum grade for backer block material shall be S-P-F No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-Q325 or CAN/CSA-Q437 Standard.

** For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

BACKER BLOCKS (Blocks must be long enough to permit required nailing without splitting)

For hanger capacity see hanger manufacturer's recommendations. Verify double I-joist capacity to support concentrated loads.


Note: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

Notes:


1. Support back of I-joist web during nailing to prevent damage to web/flange connection.
2. Leave a 1/8 to 1/4-inch gap between top flange.
3. Filler block is required between joists for full length of span.
4. Nail joists together with two rows of 3" nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
5. The maximum factored load that may be applied to one side of the double joist using this detail is 860 lb/ft. Verify double I-joist capacity.

FILLER BLOCK REQUIREMENTS FOR DOUBLE I-JOIST CONSTRUCTION

Flange Size	Joist Depth	Filler Block Size
2-1/2" x 1-1/2"	9-1/2" x 14"	2-1/8" x 6"
2-1/2" x 1-1/2"	11-7/8" x 14"	2-1/8" x 8"
3-1/2" x 1-1/2"	11-7/8" x 16"	2-1/8" x 10"
3-1/2" x 2"	11-7/8" x 16"	2-1/8" x 12"
3-1/2" x 2"	11-7/8" x 16"	3" x 6"
3-1/2" x 2"	11-7/8" x 16"	3" x 8"
3-1/2" x 2"	11-7/8" x 16"	3" x 10"
3-1/2" x 2"	11-7/8" x 16"	3" x 12"
3-1/2" x 2"	11-7/8" x 16"	3" x 7"
3-1/2" x 2"	11-7/8" x 16"	3" x 9"
3-1/2" x 2"	11-7/8" x 16"	3" x 11"

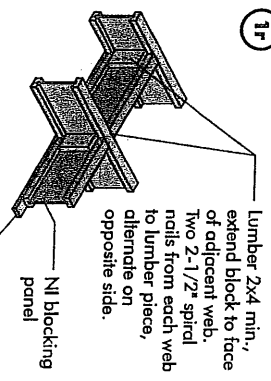


Optional: Minimum 1x4 inch strip applied to underside of joist at blocking line or 1/2 inch minimum gypsum ceiling attached to underside of joists.

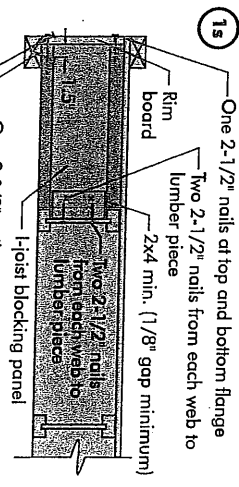


Notes:

- In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.

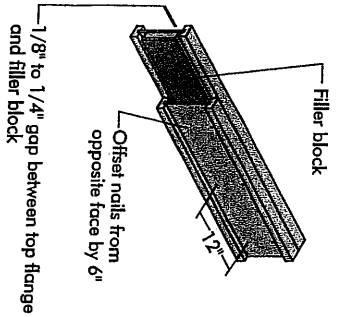


CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

3a) I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

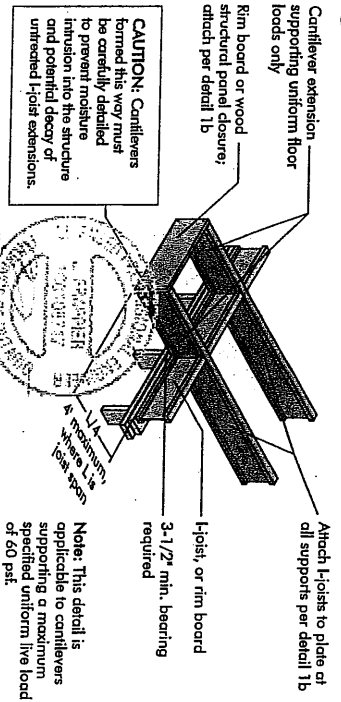


3b) LUMBER CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

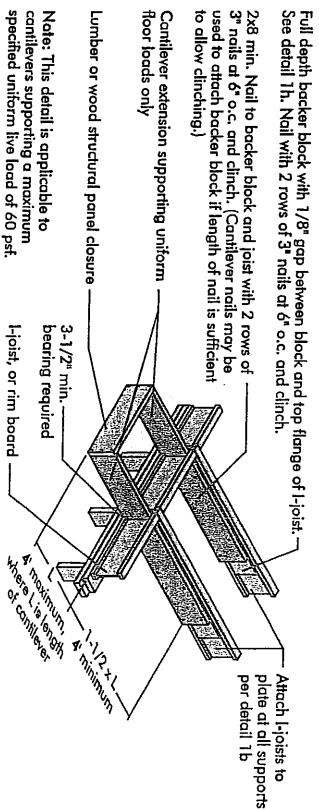


CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

4a) Method 1 — SHEATHING REINFORCEMENT ONE SIDE

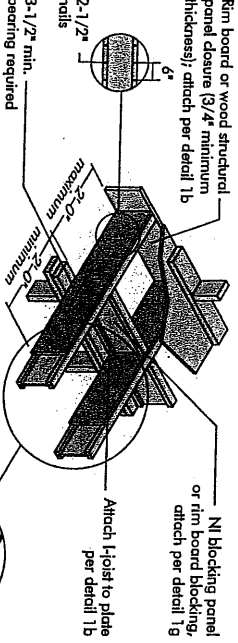

Method 2 — SHEATHING REINFORCEMENT TWO SIDES

- Use same installation as Method 1 but reinforce both sides of I-joist with sheathing.
- Use nailing pattern shown for Method 1 with opposite face nailing offset by 3".



Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

4b) Alternate Method 2 — DOUBLE I-JOIST


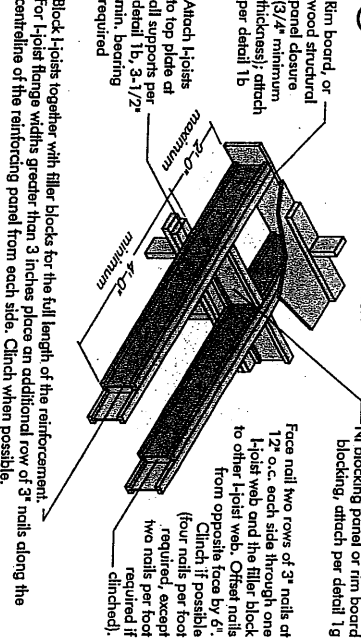


FIGURE 4 (continued)



For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

CANTILEVER REINFORCEMENT METHODS ALLOWED


JOIST DEPTH (in.)	JOIST SPACING (in.)	ROOF TOPPING (UNFACTORED)			
		11 = 30 psf DL = 15 psf	11 = 40 psf DL = 15 psf	11 = 50 psf DL = 15 psf	11 = 60 psf DL = 15 psf
12	16	19.2	24	12	19.2
16	19.2	24	12	19.2	24
20	24	12	19.2	24	12
24	24	12	19.2	24	12
28	24	12	19.2	24	12
32	24	12	19.2	24	12
36	24	12	19.2	24	12
40	24	12	19.2	24	12
44	24	12	19.2	24	12
48	24	12	19.2	24	12
52	24	12	19.2	24	12
56	24	12	19.2	24	12
60	24	12	19.2	24	12

- NI = No reinforcement required.
- 1 = NI reinforced with 3/4" wood structural panel on one side only.
- 2 = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
- X = Try a deeper joist or closer spacing.
2. Maximum design load shall be: 15 psf, dead load, 55 psf floor total load, and 80 psf live load. Wall load is based on 3'-0" maximum width window or door openings.
3. Table applies to joists 12" to 24" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use 12" o.c. requirements for lesser spacing.
4. For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam. When the roof is formed using a ridge board, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
5. Cantilevered joists supporting girder, trusses or roof beams may require additional reinforcing.

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

5d SHEATHING REINFORCEMENT

Provide full depth blocking between joists over support (not shown)

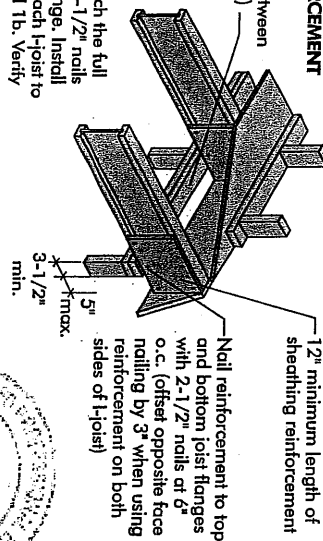


Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

5b SET-BACK DETAIL

Rim board or wood structural panel closure (3/4" minimum thickness), attach per detail 1b.

Notes:

- Provide full depth blocking between joists over support (not shown for clarity)
- Attach I-joist to plate at all supports per detail 1b.
- 3-1/2" minimum I-joist bearing required.

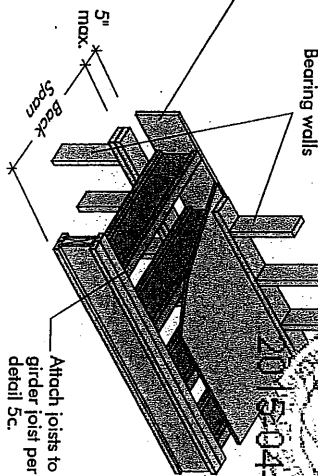

5c SET-BACK CONNECTION

Vertical solid sawn blocks (2x6 S-P-F No. 2 or better) nailed through joist web and web of girder Alternate for opposite side.

Notes:

- Verify girder joist capacity if the back span exceeds the joist spacing.
- Attach double I-joist per detail 1p, if required.


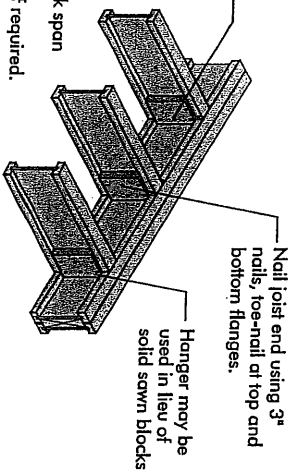


FIGURE 5 (continued)

See table below for NI reinforcement requirements at cantilever.

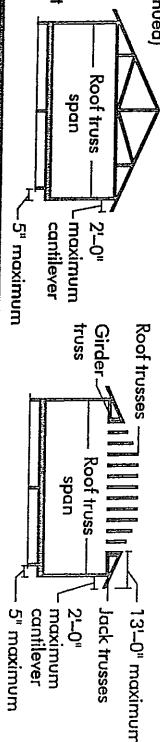

For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS		ROOF LOADING (UNFACORED)				ROOF LOADING (FACORED)			
	SPAN (ft)	LL = 30 psf DL = 15 psf	JOIST SPACING (in.)	LL = 40 psf DL = 15 psf	JOIST SPACING (in.)	LL = 50 psf DL = 15 psf	JOIST SPACING (in.)	LL = 30 psf DL = 15 psf	JOIST SPACING (in.)	LL = 40 psf DL = 15 psf
12	12	16	19.2	24	12	16	19.2	24	12	16
14	12	16	19.2	24	12	16	19.2	24	12	16
16	12	16	19.2	24	12	16	19.2	24	12	16
18	12	16	19.2	24	12	16	19.2	24	12	16
20	12	16	19.2	24	12	16	19.2	24	12	16
22	12	16	19.2	24	12	16	19.2	24	12	16
24	12	16	19.2	24	12	16	19.2	24	12	16
26	12	16	19.2	24	12	16	19.2	24	12	16
28	12	16	19.2	24	12	16	19.2	24	12	16
30	12	16	19.2	24	12	16	19.2	24	12	16
32	12	16	19.2	24	12	16	19.2	24	12	16
34	12	16	19.2	24	12	16	19.2	24	12	16
36	12	16	19.2	24	12	16	19.2	24	12	16
38	12	16	19.2	24	12	16	19.2	24	12	16
40	12	16	19.2	24	12	16	19.2	24	12	16
42	12	16	19.2	24	12	16	19.2	24	12	16

1. N = No reinforcement required.
2. N = NI reinforced with 3/4" wood structural panel on one side only.
3. X = Try a deeper joist or closer spacing.
4. For larger openings, or multiple 3-0" with openings spaced less than 6-0" o.c., additional joists beneath the opening's cripple studs may be required.
5. Table applies to joists 12" to 24" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use 12" o.c. requirements for lesser spacing.

1. Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
2. Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
3. Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
4. Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when tapped into place with a block and sledgehammer.
5. Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
6. Apply two lines of glue on I-joists where panel ends butt to assure proper gluing of each end.
7. After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) than used on I-joist flanges.
8. Tap the second row of panels into place, using a block to protect groove edges.
9. Stagger end joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including T&G edges, is recommended. (Use a spacer tool or an 2-1/2" common nail to assure accurate and consistent spacing.)
10. **Complete all nailing of each panel before glue sets.** Check the manufacturer's recommendations for cure time. (Warm weather accelerates glue setting.) Use 2" ring- or screw-shank nails for panels 3/4-inch thick or less, and 2-1/2" ring- or screw-shank nails for thicker panels. Space nails per the table below. Closer nail spacing may be required by some codes, or for diaphragm construction. The finished deck can be walked on right away and will carry construction loads without damage to the glue bond.

Maximum Joist Spacing (in.)	Minimum Panel Thickness (in.)	Nail Size and Type			Staples	Edges	Maximum Spacing of Fasteners	Intern. Supports
		Common Wire or Spiral Nails	Ring Thread Nails or Screws					
16	5/8	2"	1-3/4"	2"		6"	12"	
20	5/8	2"	1-3/4"	2"		6"	12"	
24	3/4	2"	1-3/4"	2"		6"	12"	

1. Fasteners of sheathing and subflooring shall conform to the above table.
2. Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
3. Flooring screws shall not be less than 1/8-inch in diameter.
4. Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
5. Use only adhesives conforming to CAN/CGSB-71.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues; check with panel manufacturer.


IMPORTANT NOTE:
Floor sheathing must be field glued to the I-joist Ranges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.

8a ATTACHMENT DETAILS WHERE RIM BOARDS ABUT


Rim board Joint Between Floor Joists

2-1/2" nails at 6" o.c. (typical)


Rim board Joint at Corner

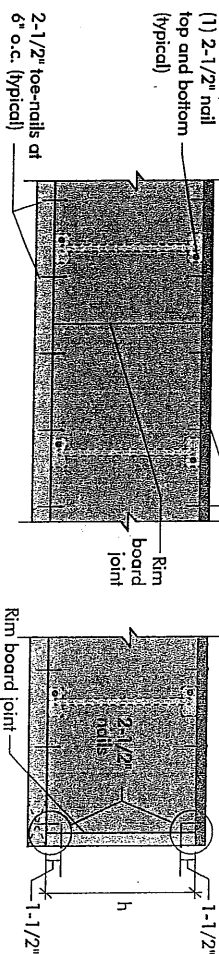

**8b TOE-MAIL CONNECTION
AT RIM BOARD**



2X LEDGER TO RIM BOARD ATTACHMENT DETAIL

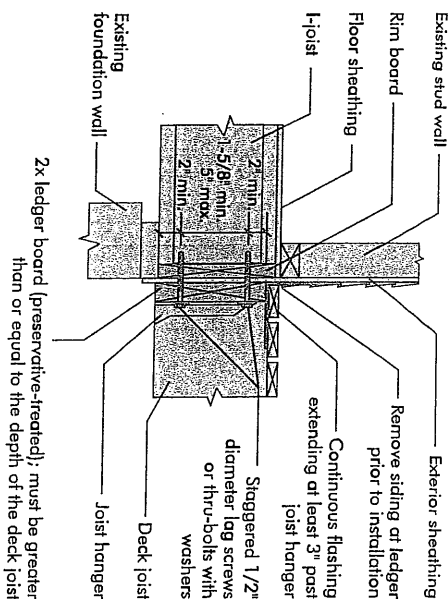


2015-04-16

PRODUCT WARRANTY

Chemtreat Chlorophanes guarantees that, in accordance with our specifications, Nucle products are free from nucleofluoroglyphosate in material and sustainably.

Furthermore, Chemtron's Chibromer contains that self-product, when utilized in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the retainer.

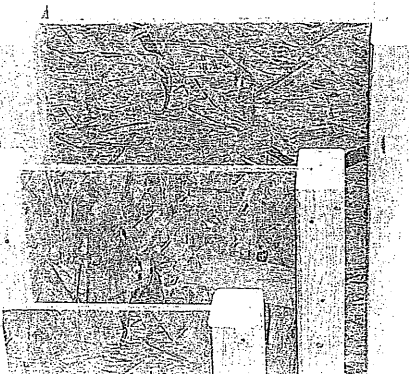


MICRO CITY ENGINEERING SERVICES INC.

TEL: (519) 287 - 2242

R.R. #1, P.O. BOX 61, GLENCOE, ONTARIO, N0L 1M0

LVL HEADER AND CONVENTIONAL LUMBER NAILING DETAILS		
DETAIL NUMBER	NUMBER OF ROWS	SPACING (INCHES o/c) "d"
A	2	12
B	2	8
C	2	6
D	2	4
1A	3	12
1B	3	8
1C	3	6
1D	3	4
2A	4	12
2B	4	8
2C	4	6
2D	4	4
3A	5	12
3B	5	8
3C	5	6
3D	5	4
4A	6	12
4B	6	8
4C	6	6
4D	6	4

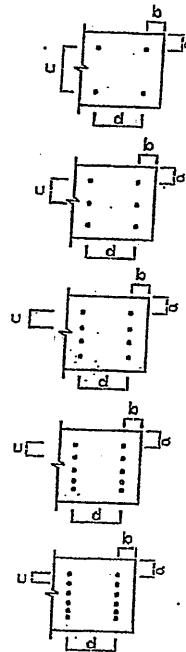

NOTES:

- (1) MINIMUM LUMBER EDGE DISTANCE "a" = 1"
- (2) MINIMUM LUMBER END DISTANCE "b" = 2"
- (3) MINIMUM NAIL ROW SPACING "c" = 2"
- (4) STAGGER NAILS "d/2" BETWEEN PLYS FOR MULTI-PLY MEMBERS (3 PLY OR MORE)
- (5) ALL NAILS ARE 3-1/2" ARDOX SPIRAL NAILS
- (6) DO NOT USE AIR-DRIVEN NAILS



DWG NO TAMN1001.14

STRUCTURAL

COMPONENT ONLY

TO BE USED ONLY
WITH BEAM CALCS
BEARING THE
SEAL BELOW

PROVIDE NAILING

DETAIL NO X SEE

DWG #TAMN1001-14