

FROM PLAN DATED: JUNE 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: DEWBERRY 2ES

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED



DATE: 2018-03-02

1st FLOOR

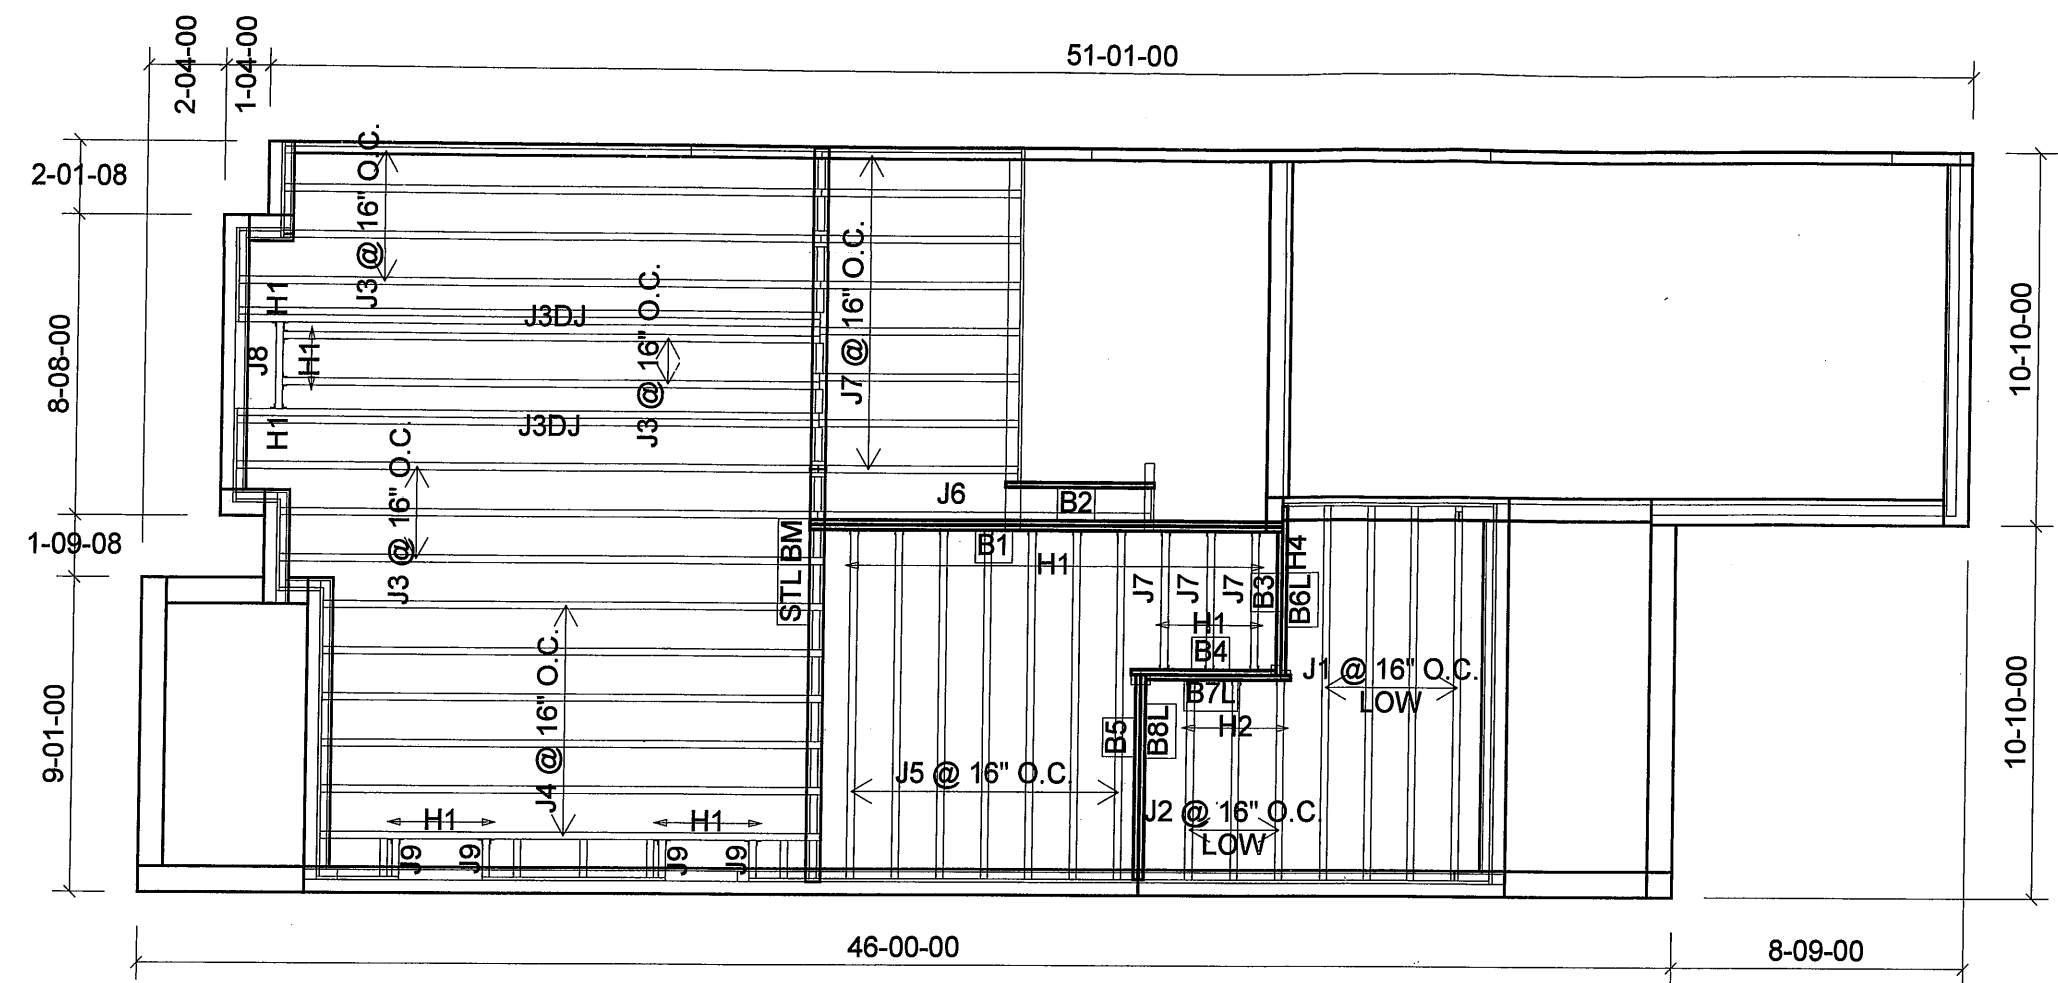

| Products | | | | |
|----------|----------|---|-------|---------|
| PlotID | Length | Product | Plies | Net Qty |
| J1 | 12-00-00 | 9 1/2" NI-40x | 1 | 4 |
| J2 | 6-00-00 | 9 1/2" NI-40x | 1 | 3 |
| J3 | 18-00-00 | 11 7/8" NI-40x | 1 | 9 |
| J3DJ | 18-00-00 | 11 7/8" NI-40x | 2 | 4 |
| J4 | 16-00-00 | 11 7/8" NI-40x | 1 | 6 |
| J5 | 12-00-00 | 11 7/8" NI-40x | 1 | 7 |
| J6 | 10-00-00 | 11 7/8" NI-40x | 1 | 1 |
| J7 | 6-00-00 | 11 7/8" NI-40x | 1 | 11 |
| J8 | 4-00-00 | 11 7/8" NI-40x | 1 | 1 |
| J9 | 2-00-00 | 11 7/8" NI-40x | 1 | 4 |
| B6L | 6-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1 | 1 |
| B7L | 6-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1 | 1 |
| B8L | 6-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1 | 1 |
| B1 | 16-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 |
| B2 | 6-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 1 | 1 |
| B3 | 6-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 1 | 1 |
| B4 | 6-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 1 | 1 |
| B5 | 6-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 1 | 1 |

| Connector Summary | | |
|-------------------|-------|---------------|
| Qty | Manuf | Product |
| 3 | H1 | IUS2.56/11.88 |
| 10 | H1 | IUS2.56/11.88 |
| 2 | H1 | IUS2.56/11.88 |
| 6 | H1 | IUS2.56/11.88 |
| 3 | H2 | IUS2.56/9.5 |
| 1 | H4 | HUS1.81/10 |

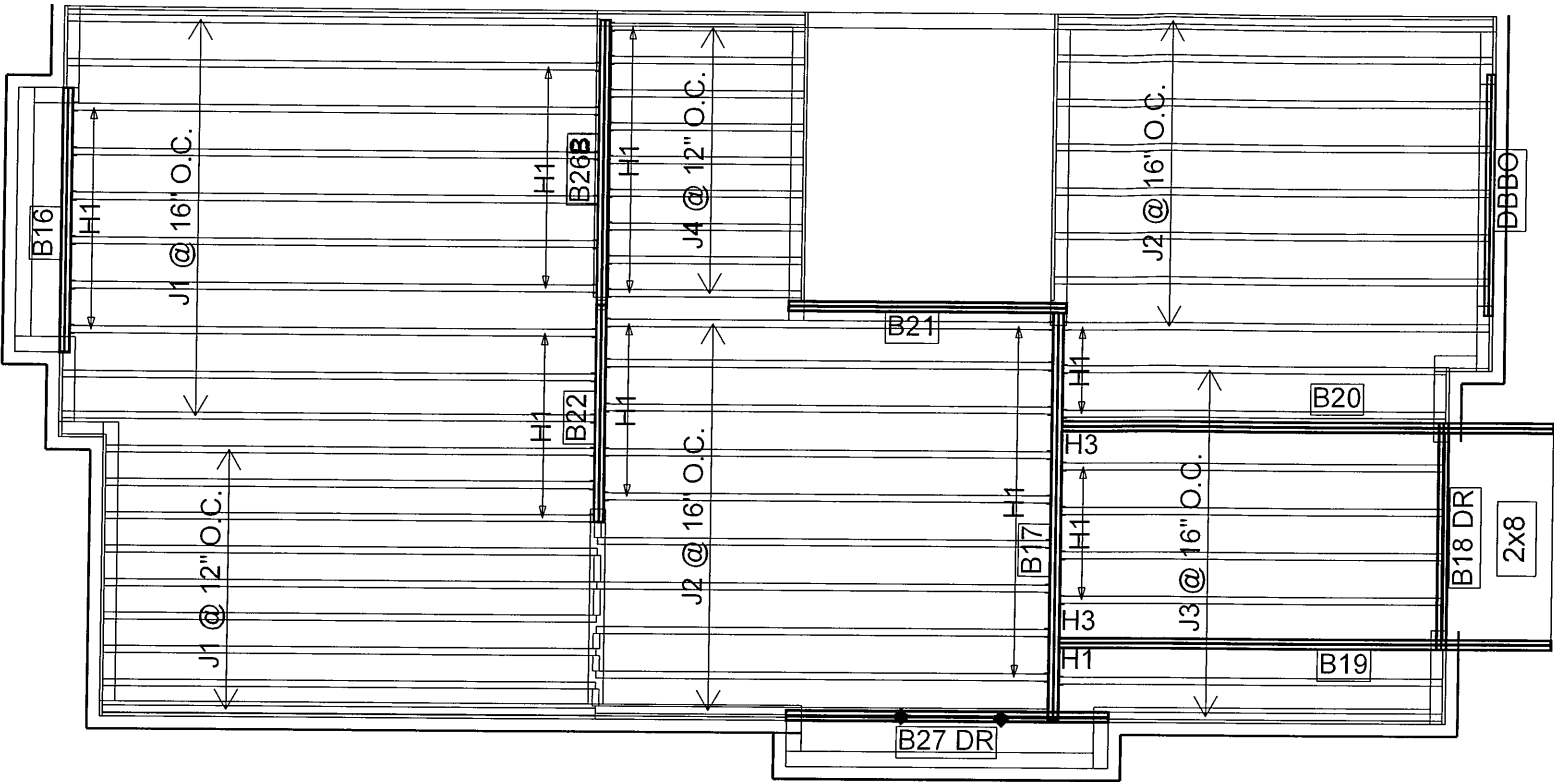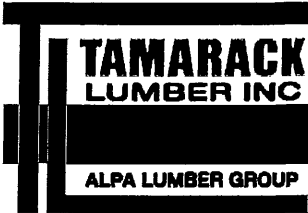

| Products | | | | | Connector Summary | | |
|----------|----------|---|-------|---------|-------------------|-------|---------------|
| PlotID | Length | Product | Plies | Net Qty | Qty | Manuf | Product |
| J1 | 16-00-00 | 11 7/8" NI-40x | 1 | 19 | 49 | H1 | IUS2.56/11.88 |
| J2 | 14-00-00 | 11 7/8" NI-40x | 1 | 18 | 2 | H3 | HGUS410 |
| J3 | 12-00-00 | 11 7/8" NI-40x | 1 | 8 | | | |
| J4 | 6-00-00 | 11 7/8" NI-40x | 1 | 9 | | | |
| B19 | 16-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |
| B20 | 16-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |
| B17 | 14-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |
| B21 | 10-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |
| B26B | 10-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |
| B27 DR | 10-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |
| B16 | 8-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |
| B18 DR | 8-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |
| B22 | 8-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 | | | |

FROM PLAN DATED: JUNE 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: DEWBERRY 2ES

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:



NOTES:
REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2018-03-06

UPPER FLOOR

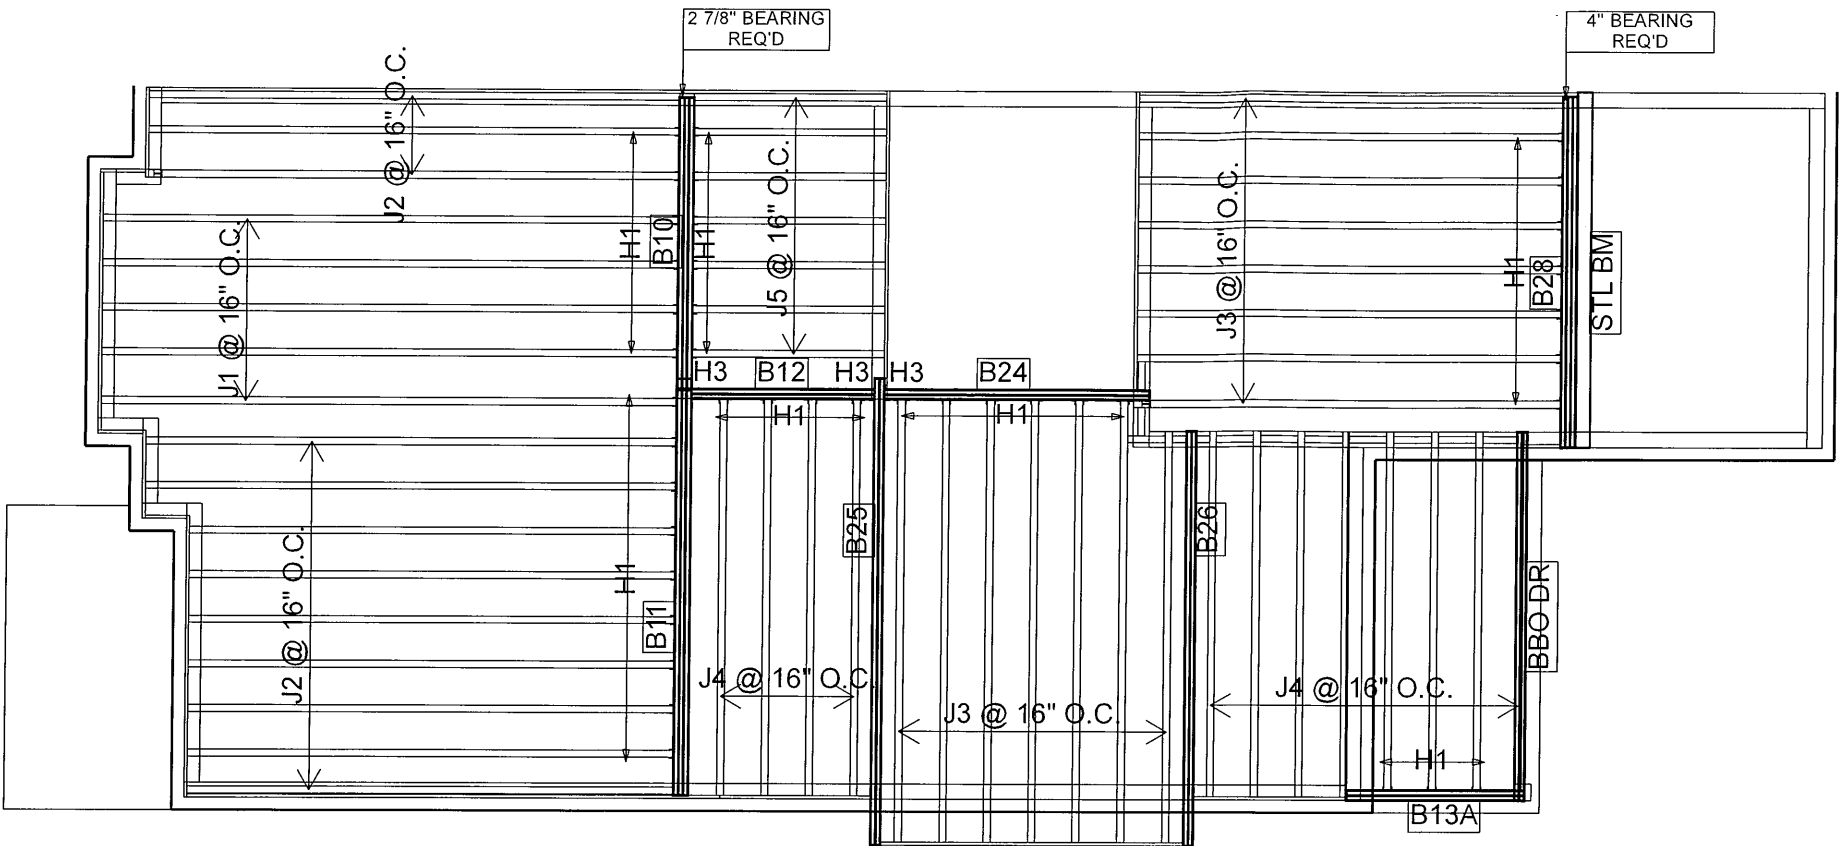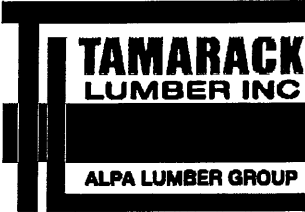

| Products | | | | |
|----------|----------|---|-------|---------|
| PlotID | Length | Product | Plies | Net Qty |
| J1 | 18-00-00 | 11 7/8" NI-40x | 1 | 5 |
| J2 | 16-00-00 | 11 7/8" NI-40x | 1 | 12 |
| J3 | 14-00-00 | 11 7/8" NI-40x | 1 | 15 |
| J4 | 12-00-00 | 11 7/8" NI-40x | 1 | 12 |
| J5 | 6-00-00 | 11 7/8" NI-40x | 1 | 7 |
| B25 | 14-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 |
| B26 | 14-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 |
| B11 | 14-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 3 | 3 |
| B28 | 12-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 3 | 3 |
| B10 | 10-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 3 | 3 |
| B24 | 8-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 |
| B12 | 6-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 |
| B13A | 6-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 2 | 2 |

| Connector Summary | | |
|-------------------|-------|---------------|
| Qty | Manuf | Product |
| 13 | H1 | IUS2.56/11.88 |
| 28 | H1 | IUS2.56/11.88 |
| 2 | H3 | HGUS410 |
| 1 | H3 | HGUS410 |

FROM PLAN DATED: JUNE 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: DEWBERRY 2ES

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

NOTES:
REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft²
SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2018-03-06

2nd FLOOR

NORDIC STRUCTURES

COMPANY
July 10, 2017 12:40


PROJECT
J3 1ST FLOOR
NORDIC SIZER

Design Check Calculation Sheet Nordic Sizer – Canada 6.4

Loads:

| Load | Type | Distribution | Pat- tern | Location [ft] Start End | Magnitude Start End | Unit |
|-------------|------|--------------|--------------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area | | | 20.00 | psf |
| Load2 | Live | Full Area | | | 40.00 | psf |
| Self-weight | Dead | Full UDL | | | 2.9 | plf |

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

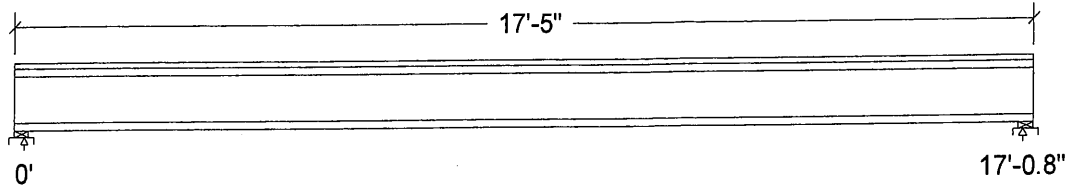

| | | | |
|-------------|-------|--|-------|
| Unfactored: | | | |
| Dead | 252 | | 252 |
| Live | 455 | | 455 |
| Factored: | | | |
| Total | 997 | | 997 |
| Bearing: | | | |
| Resistance | | | |
| Joist | 2189 | | 2189 |
| Support | 5304 | | 5304 |
| Des ratio | | | |
| Joist | 0.46 | | 0.46 |
| Support | 0.19 | | 0.19 |
| Load case | #2 | | #2 |
| Length | 3 | | 3 |
| Min req'd | 1-3/4 | | 1-3/4 |
| Stiffener | No | | No |
| Kd | 1.00 | | 1.00 |
| KB support | 1.00 | | 1.00 |
| fcp sup | 769 | | 769 |
| Kzcp sup | 1.15 | | 1.15 |

Nordic 11-7/8" NI-40x Floor joist @ 16" o.c.


Supports: All - Lumber Sill plate, No.1/No.2

Total length: 17'-5.0"; 3/4" nailed and glued OSB sheathing

This section PASSES the design code check.

Limit States Design using CSA-O86-09 and Vibration Criterion:

| Criterion | Analysis Value | Design Value | Unit | Analysis/Design |
|--------------|----------------|--------------|--------|-----------------|
| Shear | Vf = 997 | Vr = 2336 | lbs | Vf/Vr = 0.43 |
| Moment(+) | Mf = 4255 | Mr = 6255 | lbs-ft | Mf/Mr = 0.68 |
| Perm. Defl'n | 0.14 = <L/999 | 0.57 = L/360 | in | 0.24 |
| Live Defl'n | 0.25 = L/814 | 0.43 = L/480 | in | 0.59 |
| Total Defl'n | 0.39 = L/524 | 0.85 = L/240 | in | 0.46 |
| Bare Defl'n | 0.30 = L/672 | 0.57 = L/360 | in | 0.54 |
| Vibration | Lmax = 17'-1 | Lv = 18'-1 | ft | |
| Defl'n | = 0.031 | = 0.037 | in | 0.83 |

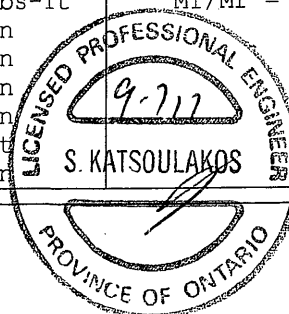

DWYND, TAM 50199-17
STRUCTURAL
COMPONENT ONLY

NORDIC SIZER

Nordic Sizer – Canada 6.4

Page 2

Additional Data:

| FACTORS: | f/E | KD | KH | KZ | KL | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr | 2336 | 1.00 | 1.00 | - | - | - | - | - | #2 |
| Mr+ | 6255 | 1.00 | 1.00 | - | 1.000 | - | - | - | #2 |
| EI | 371.1 million | - | - | - | - | - | - | - | #2 |

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment (+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake

L=live (use, occupancy) Ls=live (storage, equipment) f=fire

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:Deflection: E_Ieff = 460e06 lb-in² K= 6.18e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-09 Engineering Design in Wood standard, which includes Update No.1. **CONFORMS TO NBC 2012**
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 30 (99-17)
 STRUCTURAL
 COMPONENT ONLY


Design Check Calculation Sheet

Nordic Sizer – Canada 6.4

Loads:

| Load | Type | Distribution | Pat-tern | Location [ft] Start End | Magnitude Start End | Unit |
|-------------|------|--------------|----------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area | | | 20.00 | psf |
| Load2 | Live | Full Area | | | 40.00 | psf |
| Self-weight | Dead | Full UDL | | | 2.9 | plf |

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

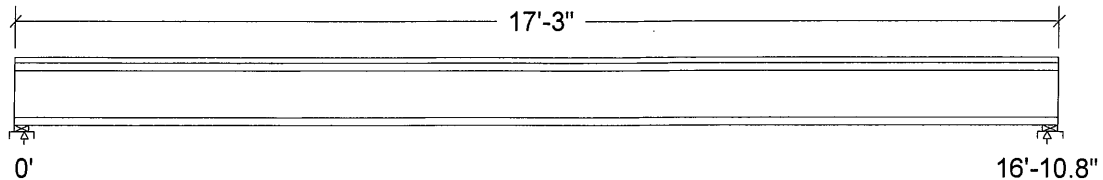

| | | | |
|-------------|-------|--|-------|
| Unfactored: | | | |
| Dead | 249 | | 249 |
| Live | 451 | | 451 |
| Factored: | | | |
| Total | 988 | | 988 |
| Bearing: | | | |
| Resistance | | | |
| Joist | 2189 | | 2189 |
| Support | 5304 | | 5304 |
| Des ratio | | | |
| Joist | 0.45 | | 0.45 |
| Support | 0.19 | | 0.19 |
| Load case | #2 | | #2 |
| Length | 3 | | 3 |
| Min req'd | 1-3/4 | | 1-3/4 |
| Stiffener | No | | No |
| Kd | 1.00 | | 1.00 |
| KB support | 1.00 | | 1.00 |
| fcp sup | 769 | | 769 |
| Kzcp sup | 1.15 | | 1.15 |

Nordic 11-7/8" NI-40x Floor joist @ 16" o.c.


Supports: All - Lumber Sill plate, No.1/No.2

Total length: 17'-3.0"; 3/4" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.

Limit States Design using CSA-O86-09 and Vibration Criterion:

| Criterion | Analysis Value | Design Value | Unit | Analysis/Design |
|--------------|----------------|--------------|--------|-----------------|
| Shear | Vf = 988 | Vr = 2336 | lbs | Vf/Vr = 0.42 |
| Moment (+) | Mf = 4172 | Mr = 6255 | lbs-ft | Mf/Mr = 0.67 |
| Perm. Defl'n | 0.13 = <L/999 | 0.56 = L/360 | in | 0.24 |
| Live Defl'n | 0.24 = L/836 | 0.42 = L/480 | in | 0.57 |
| Total Defl'n | 0.38 = L/538 | 0.84 = L/240 | in | 0.45 |
| Bare Defl'n | 0.29 = L/691 | 0.56 = L/360 | in | 0.52 |
| Vibration | Lmax = 16'-11 | Lv = 18'-8 | ft | |
| Defl'n | = 0.028 | = 0.037 | in | 0.75 |

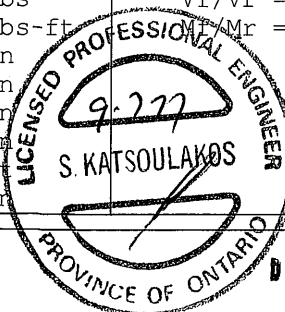

DWG NO. TAM50198-17
STRUCTURAL
COMPONENT ONLY

Additional Data:

| FACTORS: | f/E | KD | KH | KZ | KL | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr | 2336 | 1.00 | 1.00 | - | - | - | - | - | #2 |
| Mr+ | 6255 | 1.00 | 1.00 | - | 1.000 | - | - | - | #2 |
| EI | 371.1 million | - | - | - | - | - | - | - | #2 |

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: $EI_{eff} = 460e06 \text{ lb-in}^2$ $K = 6.18e06 \text{ lbs}$

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-09 Engineering Design in Wood standard, which includes Update No.1. **CONFORMS TO OBC 2012**
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM50198-17
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report


Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B1(i4313)

Specifier:

Designer:

Company:

Misc:

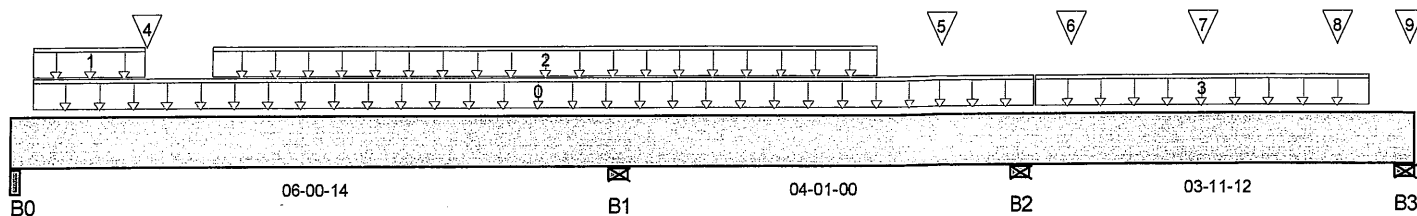

Total Horizontal Product Length = 14-01-10

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|-----------|---------|------|------|
| B0, 5-1/4" | 466 / 26 | 253 / 0 | | |
| B1, 5-1/2" | 1,293 / 0 | 674 / 0 | | |
| B2, 3-1/2" | 1,171 / 0 | 526 / 0 | | |
| B3, 5-1/2" | 584 / 55 | 299 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | FC2 Floor Material | Unf. Lin. (lb/ft) | L | 00-02-10 | 10-03-10 | 5 | 3 | | | n/a |
| 1 | FC2 Floor Material | Unf. Lin. (lb/ft) | L | 00-02-10 | 01-04-00 | 43 | 21 | | | n/a |
| 2 | Smoothed Load | Unf. Lin. (lb/ft) | L | 02-00-00 | 08-08-00 | 206 | 103 | | | n/a |
| 3 | User Load | Unf. Lin. (lb/ft) | L | 10-03-10 | 13-08-02 | 240 | 120 | | | n/a |
| 4 | J5(i4367) | Conc. Pt. (lbs) | L | 01-04-00 | 01-04-00 | 229 | 115 | | | n/a |
| 5 | J5(i4244) | Conc. Pt. (lbs) | L | 09-04-00 | 09-04-00 | 251 | 125 | | | n/a |
| 6 | J7(i1493) | Conc. Pt. (lbs) | L | 10-08-00 | 10-08-00 | 119 | 59 | | | n/a |
| 7 | J7(i1422) | Conc. Pt. (lbs) | L | 12-00-00 | 12-00-00 | 123 | 61 | | | n/a |
| 8 | J7(i1486) | Conc. Pt. (lbs) | L | 13-04-00 | 13-04-00 | 98 | 49 | | | n/a |
| 9 | B3(i1433) | Conc. Pt. (lbs) | L | 14-00-12 | 14-00-12 | 36 | 30 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 1,401 ft-lbs | 38,727 ft-lbs | 3.6% | 2 | 02-08-00 |
| Neg. Moment | -1,455 ft-lbs | -38,727 ft-lbs | 3.8% | 4 | 06-00-14 |
| End Shear | 914 lbs | 14,464 lbs | 6.3% | 2 | 01-05-02 |
| Cont. Shear | 1,217 lbs | 14,464 lbs | 8.4% | 4 | 04-10-04 |
| Total Load Defl. | L/999 (0.005") | n/a | n/a | 13 | 03-00-00 |
| Live Load Defl. | L/999 (0.003") | n/a | n/a | 18 | 03-01-00 |
| Total Neg. Defl. | L/999 (-0.001") | n/a | n/a | 13 | 07-09-14 |
| Max Defl. | 0.005" | n/a | n/a | 13 | 03-00-00 |
| Span / Depth | 5.8 | n/a | n/a | | 00-00-00 |

Bearing Supports

Dim. (L x W) Demand Support Demand / Resistance Member Material


 DWG NO. TAM 5020217
 STRUCTURAL
 COMPONENT ONLY

BC CALC® Design Report


Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Flush Beams\Basement\Flush Beams\B1(i4313)

Specifier:

Designer:

Company:

Msc:

| | | | | | | |
|----|------------|-----------------|-----------|-------|-------|-------------|
| B0 | Beam | 5-1/4" x 3-1/2" | 1,015 lbs | 10.3% | 4.5% | Unspecified |
| B1 | Wall/Plate | 5-1/2" x 3-1/2" | 2,781 lbs | 27.1% | 11.8% | Unspecified |
| B2 | Wall/Plate | 3-1/2" x 3-1/2" | 2,414 lbs | 36.9% | 16.2% | Unspecified |
| B3 | Wall/Plate | 5-1/2" x 3-1/2" | 1,249 lbs | 12.1% | 5.3% | Unspecified |

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods.

Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.


Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

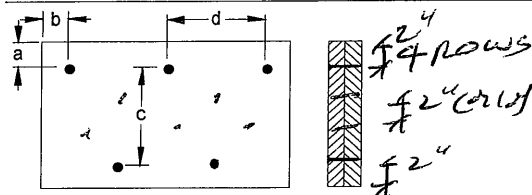CONFORMS TO OBC 2012
Connection Diagram


a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Calculated Side Load = 335.6 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 50202 17
STRUCTURAL
COMPONENT ONLY



Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B2(i3039)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 16:29:34

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B2(i3039)

Specifier:

Designer:

Company:

Msc:

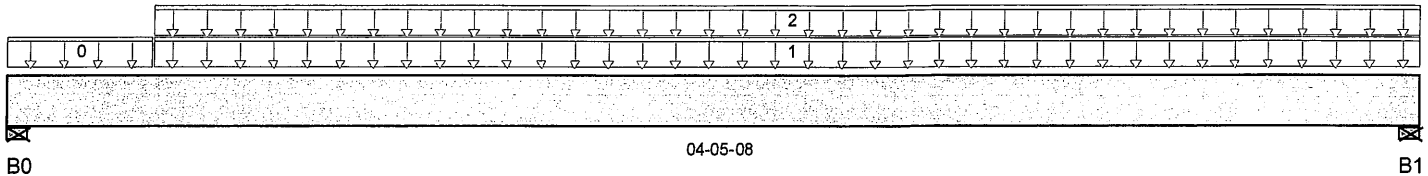

Total Horizontal Product Length = 04-05-08

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 5-1/2" | 494 / 0 | 261 / 0 | | |
| B1, 3-1/2" | 557 / 0 | 291 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|-----------|-----------|-----------|-----------|-------|
| 0 | FC2 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 00-05-08 | 27 | 13 | | | n/a |
| 1 | User Load | Unf. Lin. (lb/ft) | L | 00-05-08 | 04-05-08 | 240 | 120 | | | n/a |
| 2 | FC2 Floor Material | Unf. Lin. (lb/ft) | L | 00-05-08 | 04-05-08 | 20 | 10 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 1,027 ft-lbs | 19,364 ft-lbs | 5.3% | 1 | 02-03-12 |
| End Shear | 484 lbs | 7,232 lbs | 6.7% | 1 | 01-05-06 |
| Total Load Defl. | L/999 (0.004") | n/a | n/a | 4 | 02-03-12 |
| Live Load Defl. | L/999 (0.003") | n/a | n/a | 5 | 02-03-12 |
| Max Defl. | 0.004" | n/a | n/a | 4 | 02-03-12 |
| Span / Depth | 3.9 | n/a | n/a | | 00-00-00 |

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

| | | | | | | |
|----|------------|-----------------|-----------|-------|-------|-------------|
| B0 | Wall/Plate | 5-1/2" x 1-3/4" | 1,066 lbs | 20.7% | 9.1% | Unspecified |
| B1 | Wall/Plate | 3-1/2" x 1-3/4" | 1,200 lbs | 36.7% | 16.1% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCK®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B3(i1433)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 16:29:35

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B3(i1433)

Specifier:

Designer:

Company:

Misc:

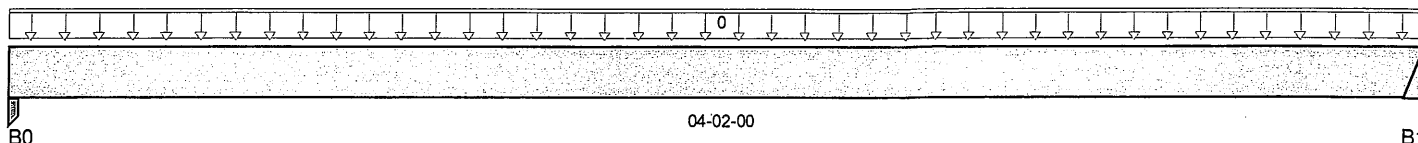

Total Horizontal Product Length = 04-02-00

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|--------|--------|------|------|
| B0, 3-1/2" | 34 / 0 | 30 / 0 | | |
| B1 | 32 / 0 | 28 / 0 | | |

Load Summary

| Tag Description | Load Type | Ref. | Start | End | Live | Dead | Snow | Wind | Trib. |
|----------------------|-------------------|------|----------|----------|------|------|------|------|-------|
| 0 FC2 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 04-02-00 | 16 | 8 | 1.00 | 1.15 | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 76 ft-lbs | 19,364 ft-lbs | 0.4% | 1 | 02-01-12 |
| End Shear | 36 lbs | 7,232 lbs | 0.5% | 1 | 01-03-06 |
| Total Load Defl. | L/999 (0") | n/a | n/a | 4 | 02-01-12 |
| Live Load Defl. | L/999 (0") | n/a | n/a | 5 | 02-01-12 |
| Max Defl. | 0" | n/a | n/a | 4 | 02-01-12 |
| Span / Depth | 3.9 | n/a | n/a | | 00-00-00 |

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|-----------|-----------------|--------|-----------------------------|----------------------------|-------------|
| B0 Post | 3-1/2" x 1-3/4" | 89 lbs | 1.8% | 1.2% | Unspecified |
| B1 Hanger | 2" x 1-3/4" | 84 lbs | n/a | 2% | HUS1.81/10 |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012



DWG NO. TAM 50202-17
STRUCTURAL
COMPONENT ONLY



Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP Basment\Flush Beams\B4(i1475)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 16:29:35

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\Basment\Flush Beams\B4(i1475)

Specifier:

Designer:

Company:

Misc:

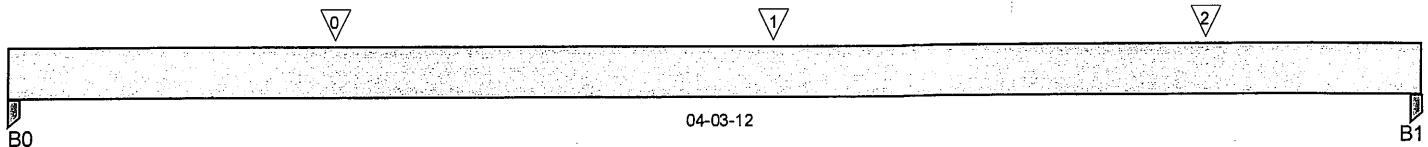

Total Horizontal Product Length = 04-03-12

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|---------|--------|------|------|
| B0, 3-1/2" | 161 / 0 | 95 / 0 | | |
| B1, 1-3/4" | 161 / 0 | 93 / 0 | | |

Load Summary

| Tag Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----------------|-----------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 J7(i1493) | Conc. Pt. (lbs) | L | 00-11-14 | 00-11-14 | 115 | 58 | | | n/a |
| 1 J7(i1422) | Conc. Pt. (lbs) | L | 02-03-14 | 02-03-14 | 115 | 58 | | | n/a |
| 2 J7(i1486) | Conc. Pt. (lbs) | L | 03-07-14 | 03-07-14 | 92 | 46 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 407 ft-lbs | 19,364 ft-lbs | 2.1% | 1 | 02-03-14 |
| End Shear | 278 lbs | 7,232 lbs | 3.8% | 1 | 01-03-06 |
| Total Load Defl. | L/999 (0.002") | n/a | n/a | 4 | 02-02-11 |
| Live Load Defl. | L/999 (0.001") | n/a | n/a | 5 | 02-02-11 |
| Max Defl. | 0.002" | n/a | n/a | 4 | 02-02-11 |
| Span / Depth | 4 | n/a | n/a | | 00-00-00 |

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|---------|-----------------|---------|-----------------------------|----------------------------|-------------|
| B0 Post | 3-1/2" x 1-3/4" | 360 lbs | 7.2% | 4.8% | Unspecified |
| B1 Post | 1-3/4" x 1-3/4" | 358 lbs | 14.4% | 9.6% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

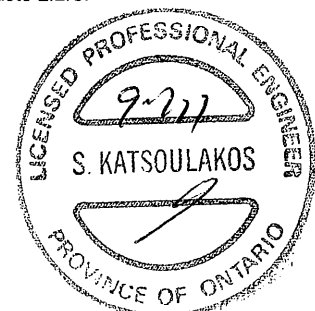

DWG NO. TAM5020317
STRUCTURAL
COMPONENT ONLY



Boise Cascade

Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B5(i4472)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 16:29:35

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mdl


Description: Designs\Flush Beams\Basement\Flush Beams\B5(i4472)

Specifier:

Designer:

Company:

Misc:

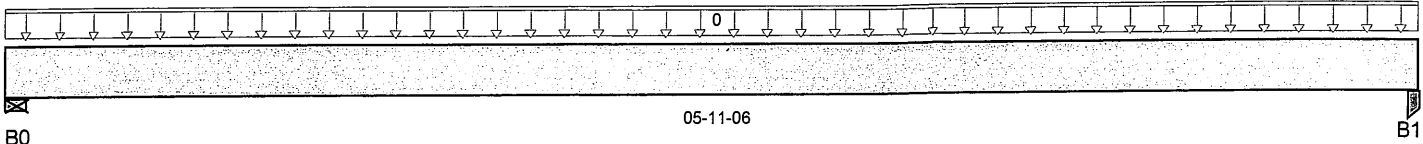

Total Horizontal Product Length = 05-11-06

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|--------|--------|------|------|
| B0, 2-3/8" | 37 / 0 | 36 / 0 | | |
| B1, 3-1/2" | 38 / 0 | 37 / 0 | | |

Load Summary

| Tag Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|----------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 FC2 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 05-11-06 | 13 | 6 | | | n/a |

| Controls Summary | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 135 ft-lbs | 19,364 ft-lbs | 0.7% | 1 | 02-11-02 |
| End Shear | 60 lbs | 7,232 lbs | 0.8% | 1 | 01-02-04 |
| Total Load Defl. | L/999 (0.001") | n/a | n/a | 4 | 02-11-02 |
| Live Load Defl. | L/999 (0.001") | n/a | n/a | 5 | 02-11-02 |
| Max Defl. | 0.001" | n/a | n/a | 4 | 02-11-02 |
| Span / Depth | 5.6 | n/a | n/a | | 00-00-00 |

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

| Bearing Supports | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|---------|-----------------------------|----------------------------|-------------|
| B0 Wall/Plate | 2-3/8" x 1-3/4" | 101 lbs | 4.6% | 2% | Unspecified |
| B1 Post | 3-1/2" x 1-3/4" | 104 lbs | 2.1% | 1.4% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO DBC 2012

BC CALO®, BC FRAMER®, AJIS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B6L(i4911)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 11, 2017 10:21:58

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B6L(i4911

Specifier:

Designer: AJ

Company:

Misc:

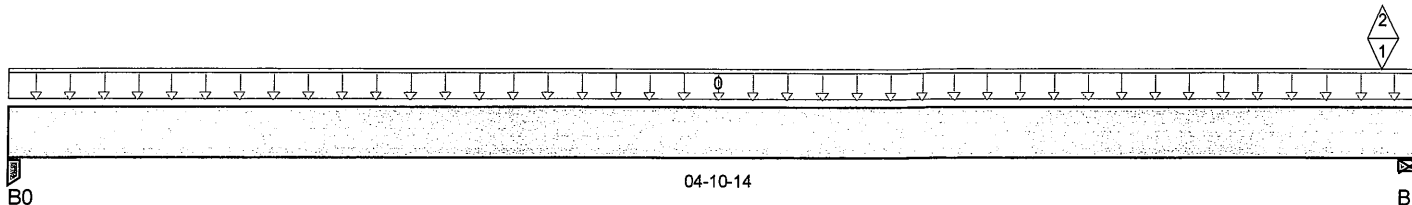

Total Horizontal Product Length = 04-10-14

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|---------|---------|-------|------|
| B0, 1-3/4" | 62 / 0 | 43 / 0 | | |
| B1, 4-3/8" | 206 / 6 | 183 / 0 | 0 / 7 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | FC 1 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 04-10-14 | 27 | 13 | | | n/a |
| 1 | 5(i652) | Conc. Pt. (lbs) | L | 04-09-04 | 04-09-04 | 138 | 136 | -7 | | n/a |
| 2 | 5(i652) | Conc. Pt. (lbs) | L | 04-09-04 | 04-09-04 | -6 | | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 160 ft-lbs | 12,704 ft-lbs | 1.3% | 1 | 02-04-02 |
| End Shear | 88 lbs | 5,785 lbs | 1.5% | 1 | 00-11-04 |
| Total Load Defl. | L/999 (0.002") | n/a | n/a | 56 | 02-04-02 |
| Live Load Defl. | L/999 (0.001") | n/a | n/a | 83 | 02-04-02 |
| Max Defl. | 0.002" | n/a | n/a | 56 | 02-04-02 |
| Span / Depth | 5.7 | n/a | n/a | | 00-00-00 |

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|---------------|-----------------|---------|-----------------------------|----------------------------|-------------|
| B0 Post | 1-3/4" x 1-3/4" | 147 lbs | 5.9% | 3.9% | Unspecified |
| B1 Wall/Plate | 4-3/8" x 1-3/4" | 538 lbs | 13.2% | 5.8% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO OBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.


Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

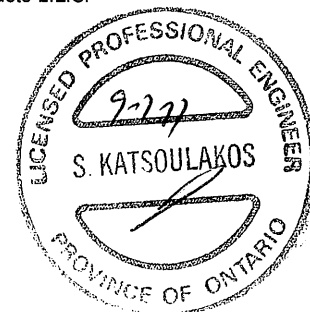



Boise Cascade

Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B7L(i4908)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 11, 2017 10:21:58

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B7L(i4908)

Specifier:

Designer: AJ

Company:

Misc:

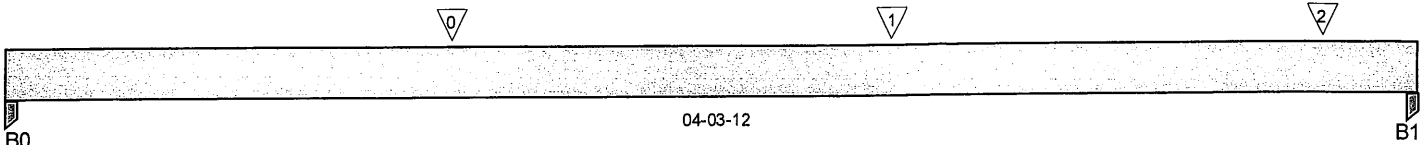

Total Horizontal Product Length = 04-03-12

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 1-3/4" | 173 / 0 | 97 / 0 | | |
| B1, 3-1/2" | 314 / 0 | 169 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|-------------|-----------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | J2(i4904) | Conc. Pt. (lbs) | L | 01-04-04 | 01-04-04 | 169 | 85 | | | n/a |
| 1 | J2(i4864) | Conc. Pt. (lbs) | L | 02-08-04 | 02-08-04 | 159 | 80 | | | n/a |
| 2 | J2(i4824) | Conc. Pt. (lbs) | L | 04-00-04 | 04-00-04 | 159 | 80 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 492 ft-lbs | 12,704 ft-lbs | 3.9% | 1 | 02-08-04 |
| End Shear | 675 lbs | 5,785 lbs | 11.7% | 1 | 03-02-12 |
| Total Load Defl. | L/999 (0.004") | n/a | n/a | 4 | 02-00-12 |
| Live Load Defl. | L/999 (0.003") | n/a | n/a | 5 | 02-00-12 |
| Max Defl. | 0.004" | n/a | n/a | 4 | 02-00-12 |
| Span / Depth | 5.1 | n/a | n/a | | 00-00-00 |

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|---------|-----------------|---------|-----------------------------|----------------------------|-------------|
| B0 Post | 1-3/4" x 1-3/4" | 381 lbs | 15.3% | 10.2% | Unspecified |
| B1 Post | 3-1/2" x 1-3/4" | 681 lbs | 13.7% | 9.1% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B8L(i4836)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 11, 2017 10:21:58

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B8L(i4836

Specifier:

Designer: AJ

Company:

Misc:

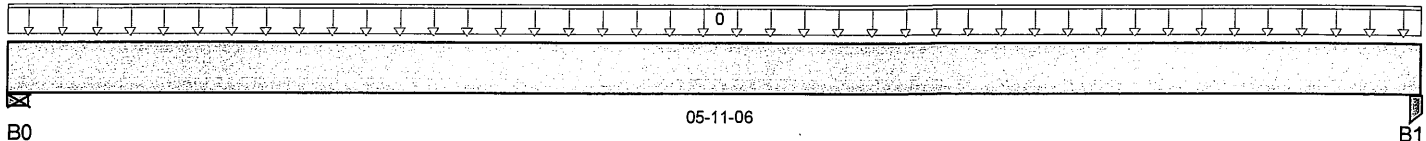

Total Horizontal Product Length = 05-11-06

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|--------|--------|------|------|
| B0, 2-3/8" | 88 / 0 | 58 / 0 | | |
| B1, 3-1/2" | 91 / 0 | 60 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | FC 1 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 05-11-06 | 30 | 15 | | | n/a |

| Controls Summary | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 272 ft-lbs | 12,704 ft-lbs | 2.1% | 1 | 02-11-02 |
| End Shear | 135 lbs | 5,785 lbs | 2.3% | 1 | 00-11-14 |
| Total Load Defl. | L/999 (0.004") | n/a | n/a | 4 | 02-11-02 |
| Live Load Defl. | L/999 (0.003") | n/a | n/a | 5 | 02-11-02 |
| Max Defl. | 0.004" | n/a | n/a | 4 | 02-11-02 |
| Span / Depth | 7.1 | n/a | n/a | | 00-00-00 |

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

| Bearing Supports | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|---------|-----------------------------|----------------------------|-------------|
| B0 Wall/Plate | 2-3/8" x 1-3/4" | 204 lbs | 9.2% | 4% | Unspecified |
| B1 Post | 3-1/2" x 1-3/4" | 211 lbs | 4.2% | 2.8% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



BC CALC® Design Report

1st Floor Flush Beams\B10(i10008)

Dry | 1 span | No cant.

March 2, 2018 16:40:01

Build 6215

Job name:

File name: DEWBERRY 2ES

Address:

Description: 1st Floor Flush Beams\B10(i10008)

City, Province, Postal Code: WAT...WN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

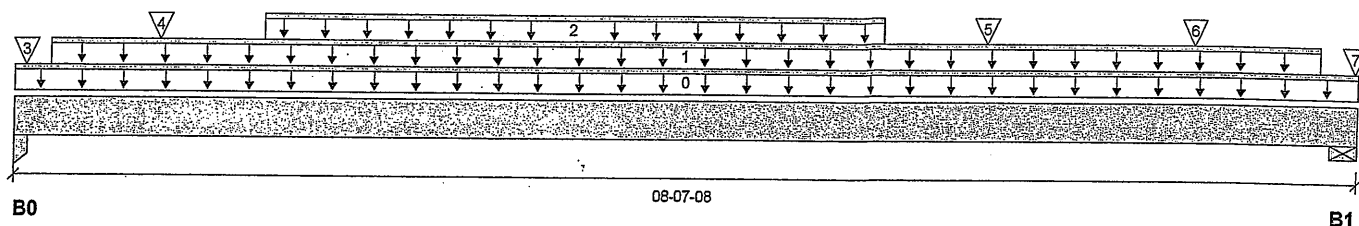

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|-----------|-----------|------|------|
| B0, 2-3/4" | 3,743 / 0 | 2,364 / 0 | | |
| B1, 2-7/8" | 3,498 / 0 | 2,243 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Tributary |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0 | Self-Weight | Unf. Lin. (lb/ft) | L | 00-00-00 | 08-07-08 | | 18 | | | 00-00-00 |
| 1 | E38(i2051) | Unf. Lin. (lb/ft) | L | 00-02-12 | 08-04-10 | | 81 | | | n/a |
| 2 | Smoothed Load | Unf. Lin. (lb/ft) | L | 01-07-02 | 05-07-02 | 466 | 233 | | | n/a |
| 3 | PBO7(i9503) | Conc. Pt. (lbs) | L | 00-00-14 | 00-00-14 | 1,857 | 1,013 | | | n/a |
| 4 | - | Conc. Pt. (lbs) | L | 00-11-02 | 00-11-02 | 652 | 326 | | | n/a |
| 5 | - | Conc. Pt. (lbs) | L | 06-03-02 | 06-03-02 | 562 | 279 | | | n/a |
| 6 | - | Conc. Pt. (lbs) | L | 07-07-02 | 07-07-02 | 514 | 257 | | | n/a |
| 7 | E48(i7543) | Conc. Pt. (lbs) | L | 08-07-04 | 08-07-04 | 1,775 | 975 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment | 9,333 ft-lbs | 55,212 ft-lbs | 16.9% | 1 | 04-02-02 |
| End Shear | 3,982 lbs | 21,696 lbs | 18.4% | 1 | 01-02-10 |
| Total Load Deflection | L/999 (0.057") | n/a | n/a | 4 | 04-03-02 |
| Live Load Deflection | L/999 (0.033") | n/a | n/a | 5 | 04-03-02 |
| Max Defl. | 0.057" | n/a | n/a | 4 | 04-03-02 |
| Span / Depth | 8.4 | | | | |

| Bearing Supports | Dim. (LxW) | Demand | Demand/Resistance Support | Demand/Resistance Member | Material |
|------------------|-----------------|-----------|---------------------------|--------------------------|-------------|
| B0 Column | 2-3/4" x 5-1/4" | 8,570 lbs | 73.1% | 48.7% | Unspecified |
| B1 Wall/Plate | 2-7/8" x 5-1/4" | 8,050 lbs | 99.9% | 43.7% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.



DWG NO. TAM 11845-18
STRUCTURAL
COMPONENT ONLY



Triple 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Design Report
Build 6215

1st Floor Flush Beams B10(i10008)

Dry | 1 span | No cant.

March 2, 2018 16:40:01

Job name:

File name: DEWBERRY 2ES

Address:

Description: 1st Floor Flush Beams B10(i10008)

City, Province, Postal Code: WAT...WN

Specifier:



Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

Connection Diagram

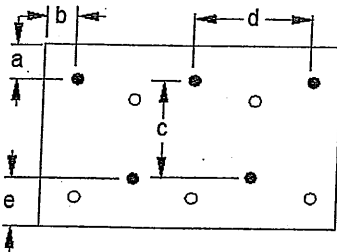

4 rows

a minimum = 1"
b minimum = 3"

c = 6-7/8"
d = 4"
e minimum = 2"

Calculated Side Load = 657.9 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Common Nails

3-1/2" ARDOX SPIRAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BCI®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®
DWG NO. TAM 11845-18
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B11(i4891)

Specifier:

Designer:

Company:

Misc:

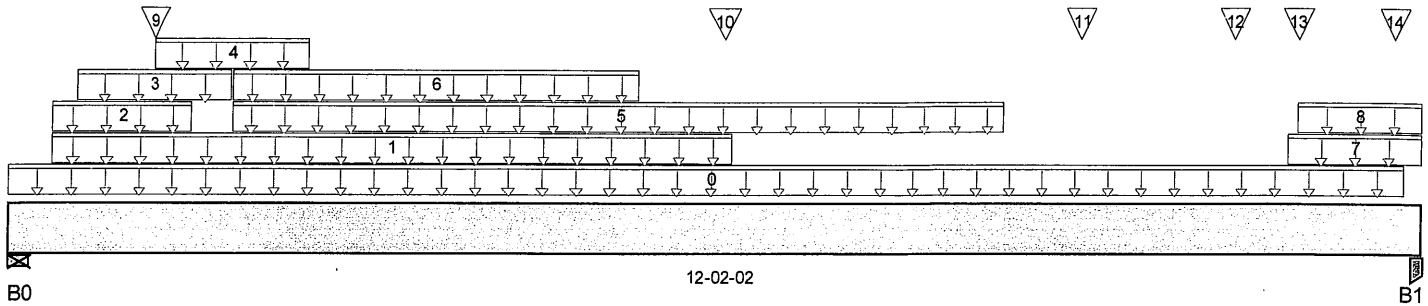

Total Horizontal Product Length = 12-02-02

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|-----------|-----------|------|------|
| B0, 4-3/8" | 4,929 / 0 | 2,949 / 0 | | |
| B1, 3-1/2" | 6,141 / 0 | 3,469 / 0 | | |

Load Summary


| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | FC3 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 12-00-06 | 24 | 12 | | | n/a |
| 1 | E37(i2050) | Unf. Lin. (lb/ft) | L | 00-04-06 | 06-02-06 | | 81 | | | n/a |
| 2 | E37(i2050) | Unf. Lin. (lb/ft) | L | 00-04-06 | 01-06-14 | 215 | 108 | | | n/a |
| 3 | E37(i2050) | Unf. Lin. (lb/ft) | L | 00-06-14 | 01-10-14 | 244 | 122 | | | n/a |
| 4 | E37(i2050) | Unf. Lin. (lb/ft) | L | 01-02-14 | 02-06-14 | 220 | 110 | | | n/a |
| 5 | Smoothed Load | Unf. Lin. (lb/ft) | L | 01-10-14 | 08-06-14 | 294 | 147 | | | n/a |
| 6 | E37(i2050) | Unf. Lin. (lb/ft) | L | 01-10-14 | 05-04-14 | 563 | 282 | | | n/a |
| 7 | E38(i2051) | Unf. Lin. (lb/ft) | L | 11-00-06 | 12-02-02 | 389 | 276 | | | n/a |
| 8 | E38(i2051) | Unf. Lin. (lb/ft) | L | 11-01-06 | 12-02-02 | 208 | 104 | | | n/a |
| 9 | J1(i4884) | Conc. Pt. (lbs) | L | 01-02-14 | 01-02-14 | 359 | 179 | | | n/a |
| 10 | E37(i2050) | Conc. Pt. (lbs) | L | 06-01-06 | 06-01-06 | 1,701 | 883 | | | n/a |
| 11 | J1(i4806) | Conc. Pt. (lbs) | L | 09-02-14 | 09-02-14 | 428 | 214 | | | n/a |
| 12 | J1(i4920) | Conc. Pt. (lbs) | L | 10-06-14 | 10-06-14 | 408 | 204 | | | n/a |
| 13 | E38(i2051) | Conc. Pt. (lbs) | L | 11-01-06 | 11-01-06 | 1,366 | 716 | | | n/a |
| 14 | - | Conc. Pt. (lbs) | L | 11-11-03 | 11-11-03 | 1,061 | 562 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 32,991 ft-lbs | 60,415 ft-lbs | 54.6% | 1 | 06-01-06 |
| End Shear | 10,339 lbs | 21,696 lbs | 47.7% | 1 | 01-04-04 |
| Total Load Defl. | L/374 (0.374") | 0.582" | 64.2% | 4 | 05-11-04 |
| Live Load Defl. | L/591 (0.237") | 0.388" | 61% | 5 | 05-11-04 |
| Max Defl. | 0.374" | n/a | n/a | 4 | 05-11-04 |
| Span / Depth | 11.8 | n/a | n/a | | 00-00-00 |

Bearing Supports

| Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|--------------|--------|-----------------------------|----------------------------|----------|
|--------------|--------|-----------------------------|----------------------------|----------|

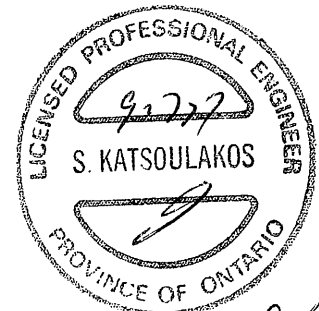

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B11(i489

Specifier:

Designer:

Company:

Misc:

| | | | | | | |
|----|------------|-----------------|------------|-------|-------|-------------|
| B0 | Wall/Plate | 4-3/8" x 5-1/4" | 11,080 lbs | 90.3% | 39.5% | Unspecified |
| B1 | Post | 3-1/2" x 5-1/4" | 13,548 lbs | 90.8% | 60.4% | Unspecified |

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

Connection Diagram

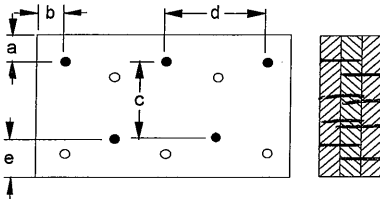

4 rows

a minimum = 2" c = 6-7/8"
b minimum = 3" d = 4"
e minimum = 2"

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Calculated Side Load = 626.0 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL



DWG NO. TAM504217
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report


Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B12(i4443)

Specifier:

Designer:

Company:

Misc:

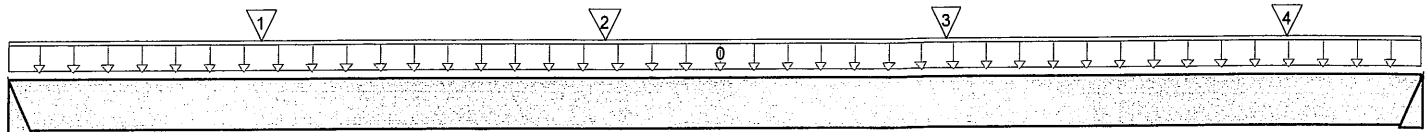

05-05-14

B0

B1

Total Horizontal Product Length = 05-05-14

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|---------|---------|---------|------|------|
| B0 | 621 / 0 | 343 / 0 | | |
| B1 | 674 / 0 | 370 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | FC 3 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 05-05-14 | 23 | 11 | | | n/a |
| 1 | J3(i4452) | Conc. Pt. (lbs) | L | 00-11-10 | 00-11-10 | 300 | 150 | | | n/a |
| 2 | J3(i4468) | Conc. Pt. (lbs) | L | 02-03-10 | 02-03-10 | 317 | 158 | | | n/a |
| 3 | J3(i4425) | Conc. Pt. (lbs) | L | 03-07-10 | 03-07-10 | 317 | 158 | | | n/a |
| 4 | J3(i4463) | Conc. Pt. (lbs) | L | 04-11-10 | 04-11-10 | 238 | 119 | | | n/a |

| Controls Summary | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 1,977 ft-lbs | 38,727 ft-lbs | 5.1% | 1 | 02-03-10 |
| End Shear | 1,168 lbs | 14,464 lbs | 8.1% | 1 | 01-01-14 |
| Total Load Defl. | L/999 (0.007") | n/a | n/a | 4 | 02-08-10 |
| Live Load Defl. | L/999 (0.005") | n/a | n/a | 5 | 02-08-10 |
| Max Defl. | 0.007" | n/a | n/a | 4 | 02-08-10 |
| Span / Depth | 5.3 | n/a | n/a | | 00-00-00 |

| Bearing Supports | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|--------------|-----------|-----------------------------|----------------------------|----------|
| B0 Hanger | 2" x 3-1/2" | 1,361 lbs | n/a | 15.9% | HGUS410 |
| B1 Hanger | 2" x 3-1/2" | 1,473 lbs | n/a | 17.2% | HGUS410 |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO DBC 2012


fb 12

BC CALC® Design Report


Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B12(i444

Specifier:

Designer:

Company:

Msc:

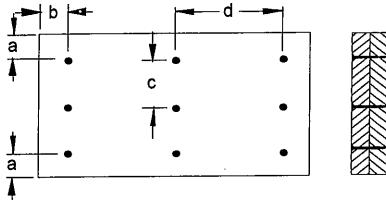Connection Diagram


a minimum = 2" c = 3-15/16"
 b minimum = 3" d = 6"

Calculated Side Load = 453.4 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL
Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 50211-17
 STRUCTURAL
 COMPONENT ONLY



Double 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP 1st Floor\...\B13A(i5113)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 6, 2017 11:31:27

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B13A(i511:

Specifier:

Designer: AJ

Company:

Msc:

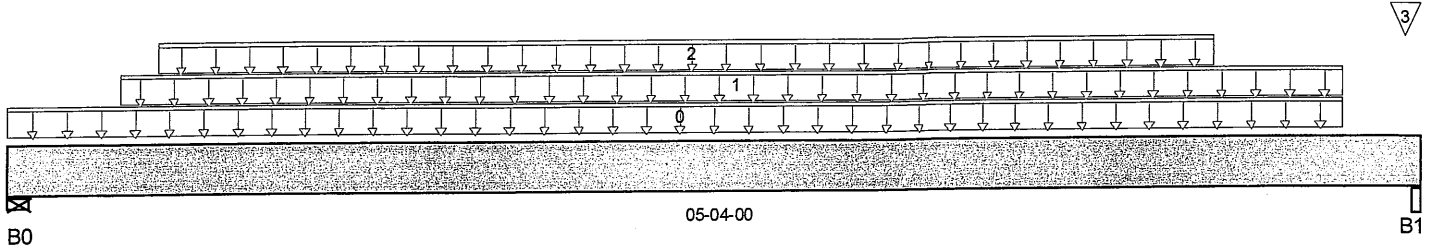

Total Horizontal Product Length = 05-04-00

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|---------|---------|---------|------|
| B0, 5" | 652 / 0 | 821 / 0 | 236 / 0 | |
| B1, 3-1/2" | 580 / 0 | 773 / 0 | 240 / 0 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | E36(i1694) | Unf. Lin. (lb/ft) | L | 00-00-00 | 05-00-08 | 29 | 101 | | | n/a |
| 1 | User Load | Unf. Lin. (lb/ft) | L | 00-05-00 | 05-00-08 | 43 | 119 | 102 | | n/a |
| 2 | Smoothed Load | Unf. Lin. (lb/ft) | L | 00-06-12 | 04-06-12 | 220 | 110 | | | n/a |
| 3 | E41(i2056) | Conc. Pt. (lbs) | L | 05-03-04 | 05-03-04 | | 28 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 2,650 ft-lbs | 38,727 ft-lbs | 6.8% | 1 | 02-06-12 |
| End Shear | 1,650 lbs | 14,464 lbs | 11.4% | 1 | 01-04-14 |
| Total Load Defl. | L/999 (0.008") | n/a | n/a | 35 | 02-08-12 |
| Live Load Defl. | L/999 (0.004") | n/a | n/a | 51 | 02-08-12 |
| Max Defl. | 0.008" | n/a | n/a | 35 | 02-08-12 |
| Span / Depth | 4.8 | n/a | n/a | | 00-00-00 |

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|---------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Wall/Plate | 5" x 3-1/2" | 2,121 lbs | 22.7% | 9.9% | Unspecified |
| B1 Beam | 3-1/2" x 3-1/2" | 1,957 lbs | 14.7% | 13.1% | Unspecified |

Notes





Double 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP 1st Floor\...\B13A(i5113)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 6, 2017 11:31:27

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B13A(i5

Specifier:

Designer: AJ

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

Connection Diagram

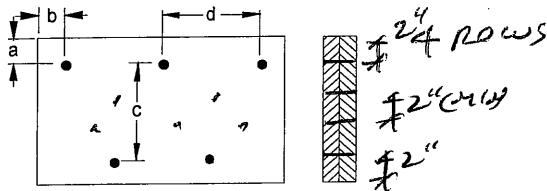

a minimum = 2" c = 7-7/8" 6"
b minimum = 3" d = 6"

Calculated Side Load = 349.8 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWB NO. TAM 50212-17
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP 2nd Floor\...\B16 (i4638)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 16:29:38

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B16

Specifier:

Designer:

Company:

Misc:

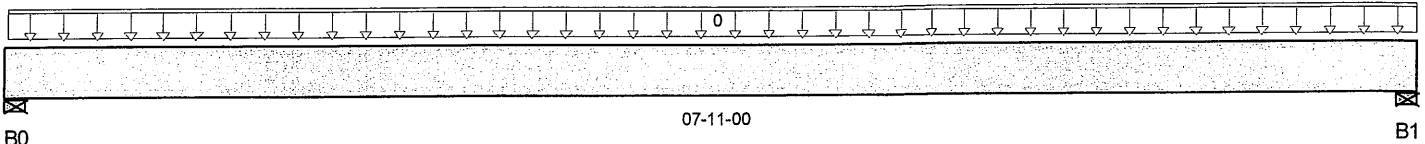

Total Horizontal Product Length = 07-11-00

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|-----------|---------|------|------|
| B0, 5-1/2" | 1,276 / 0 | 687 / 0 | | |
| B1, 5-1/2" | 1,322 / 0 | 710 / 0 | | |

Load Summary

| Tag Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 Smoothed Load | Unf. Lin. (lb/ft) | L | 00-00-04 | 07-11-00 | 329 | 165 | | | n/a |

| Controls Summary | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 4,439 ft-lbs | 38,727 ft-lbs | 11.5% | 1 | 03-04-04 |
| End Shear | 2,044 lbs | 14,464 lbs | 14.1% | 1 | 01-05-06 |
| Total Load Defl. | L/999 (0.03") | n/a | n/a | 4 | 03-11-04 |
| Live Load Defl. | L/999 (0.019") | n/a | n/a | 5 | 03-11-04 |
| Max Defl. | 0.03" | n/a | n/a | 4 | 03-11-04 |
| Span / Depth | 7.2 | n/a | n/a | | 00-00-00 |

| Bearing Supports | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Wall/Plate | 5-1/2" x 3-1/2" | 2,774 lbs | 17.7% | 11.8% | Unspecified |
| B1 Wall/Plate | 5-1/2" x 3-1/2" | 2,870 lbs | 18.4% | 12.2% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO DBC 2012



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B


Specifier:

Designer:

Company:

Misc:

Connection Diagram

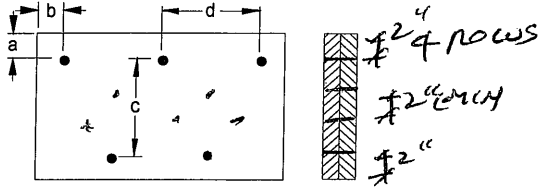
a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



BC CALC® Design Report


Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl


Description: Designs\Flush Beams\2nd Floor\Flush Beams\B17(i4664

Specifier:

Designer:

Company:

Misc:

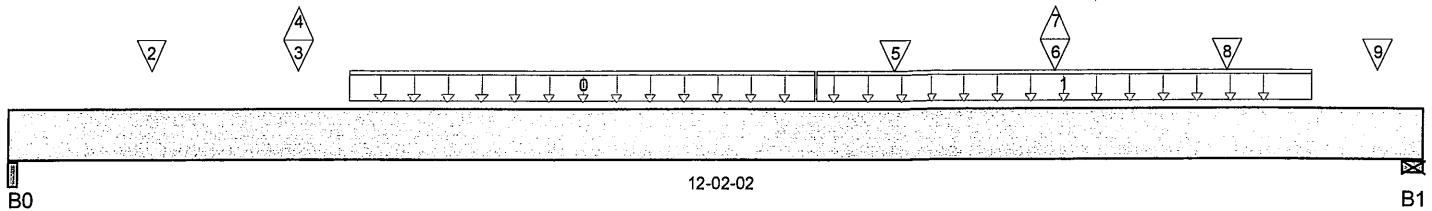

Total Horizontal Product Length = 12-02-02

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|------------|-----------|---------|------|
| B0, 2-3/8" | 2,708 / 16 | 1,481 / 0 | 0 / 117 | |
| B1, 4-1/2" | 3,224 / 14 | 1,734 / 0 | 0 / 99 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | Smoothed Load | Unf. Lin. (lb/ft) | L | 02-10-14 | 06-10-14 | 508 | 254 | | | n/a |
| 1 | Smoothed Load | Unf. Lin. (lb/ft) | L | 06-10-14 | 11-02-14 | 250 | 126 | | | n/a |
| 2 | - | Conc. Pt. (lbs) | L | 01-02-07 | 01-02-07 | 578 | 289 | | | n/a |
| 3 | - | Conc. Pt. (lbs) | L | 02-05-08 | 02-05-08 | 651 | 375 | -108 | | n/a |
| 4 | - | Conc. Pt. (lbs) | L | 02-05-08 | 02-05-08 | -15 | | | | n/a |
| 5 | J4(i4237) | Conc. Pt. (lbs) | L | 07-06-14 | 07-06-14 | 298 | 149 | | | n/a |
| 6 | - | Conc. Pt. (lbs) | L | 09-00-00 | 09-00-00 | 384 | 242 | -108 | | n/a |
| 7 | - | Conc. Pt. (lbs) | L | 09-00-00 | 09-00-00 | -15 | | | | n/a |
| 8 | J4(i3980) | Conc. Pt. (lbs) | L | 10-05-14 | 10-05-14 | 303 | 151 | | | n/a |
| 9 | - | Conc. Pt. (lbs) | L | 11-09-06 | 11-09-06 | 601 | 301 | | | n/a |

| Controls Summary | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 18,909 ft-lbs | 38,727 ft-lbs | 48.8% | 21 | 06-02-14 |
| End Shear | 5,879 lbs | 14,464 lbs | 40.6% | 21 | 01-02-04 |
| Total Load Defl. | L/416 (0.339") | 0.586" | 57.8% | 56 | 05-11-14 |
| Live Load Defl. | L/640 (0.22") | 0.391" | 56.2% | 83 | 05-11-14 |
| Max Defl. | 0.339" | n/a | n/a | 56 | 05-11-14 |
| Span / Depth | 11.9 | n/a | n/a | | 00-00-00 |

| Bearing Supports | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Beam | 2-3/8" x 3-1/2" | 5,914 lbs | 65.3% | 58.3% | Unspecified |
| B1 Wall/Plate | 4-1/2" x 3-1/2" | 7,003 lbs | 83.3% | 36.4% | Unspecified |

Notes


BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 16:29:39

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Flush Beams\2nd Floor\Flush Beams\B17(i46

Specifier:

Designer:

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.


CONFORMS TO OBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection Diagram

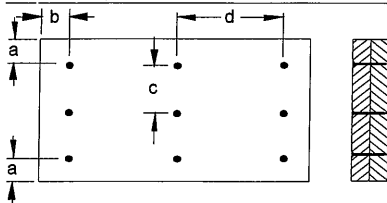

a minimum = 2" c = 3-15/16"
b minimum = 3" d = 6"

Calculated Side Load = 547.6 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B18

Specifier:

Designer:

Company:

Misc:

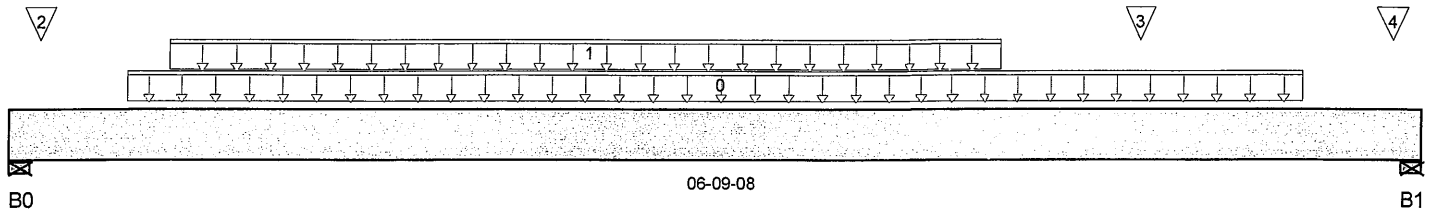

Total Horizontal Product Length = 06-09-08

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|-----------|-----------|-----------|------|
| B0, 6-3/4" | 1,190 / 0 | 1,152 / 0 | 1,457 / 0 | |
| B1, 6-3/4" | 1,103 / 0 | 1,108 / 0 | 1,457 / 0 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | User Load | Unf. Lin. (lb/ft) | L | 00-06-12 | 06-02-12 | 55 | 150 | 180 | | n/a |
| 1 | Smoothed Load | Unf. Lin. (lb/ft) | L | 00-09-04 | 04-09-04 | 236 | 118 | | | n/a |
| 2 | B19(i3917) | Conc. Pt. (lbs) | L | 00-01-12 | 00-01-12 | 418 | 378 | 947 | | n/a |
| 3 | J4(i4237) | Conc. Pt. (lbs) | L | 05-05-04 | 05-05-04 | 301 | 150 | | | n/a |
| 4 | B20(i4148) | Conc. Pt. (lbs) | L | 06-07-12 | 06-07-12 | 320 | 329 | 947 | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 3,651 ft-lbs | 38,727 ft-lbs | 9.4% | 1 | 03-04-04 |
| End Shear | 1,924 lbs | 14,464 lbs | 13.3% | 1 | 01-06-10 |
| Total Load Defl. | L/999 (0.017") | n/a | n/a | 35 | 03-04-04 |
| Live Load Defl. | L/999 (0.01") | n/a | n/a | 51 | 03-04-04 |
| Max Defl. | 0.017" | n/a | n/a | 35 | 03-04-04 |
| Span / Depth | 5.9 | n/a | n/a | | 00-00-00 |

| Bearing Supports | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Wall/Plate | 6-3/4" x 3-1/2" | 4,220 lbs | 22% | 14.6% | Unspecified |
| B1 Wall/Plate | 6-3/4" x 3-1/2" | 4,122 lbs | 21.5% | 14.3% | Unspecified |

Notes



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl

Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B

Specifier:

Designer:

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9


CONFORMS TO DBC 2012

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Connection Diagram

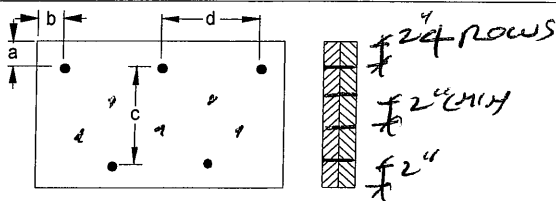

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL



BC CALC® Design Report


Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\2nd Floor\Flush Beams\B19(i3917

Specifier:

Designer:

Company:

Misc:

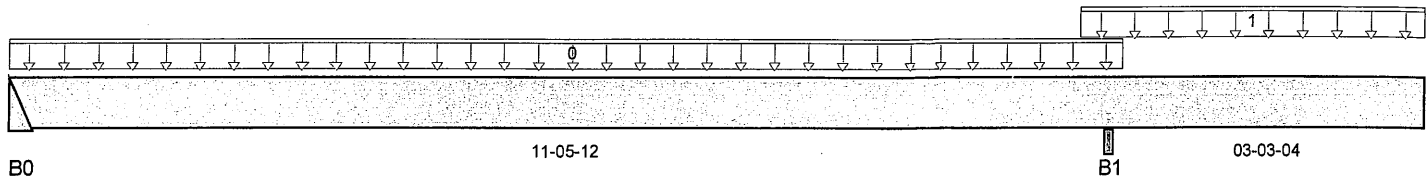
Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|----------|---------|---------|------|
| B0 | 280 / 16 | 190 / 0 | 0 / 110 | |
| B1, 3-1/2" | 416 / 0 | 376 / 0 | 947 / 0 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | FC4 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 11-07-08 | 48 | 24 | | | n/a |
| 1 | User Load | Unf. Lin. (lb/ft) | L | 11-02-00 | 14-09-00 | 33 | 30 | 234 | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|---------------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 1,768 ft-lbs | 36,706 ft-lbs | 4.8% | 44 | 05-07-04 |
| Neg. Moment | -2,247 ft-lbs | -36,706 ft-lbs | 6.1% | 49 | 11-05-12 |
| End Shear | 521 lbs | 14,464 lbs | 3.6% | 44 | 01-01-14 |
| Cont. Shear | 897 lbs | 14,464 lbs | 6.2% | 49 | 12-07-06 |
| Uplift | 1 lbs | n/a | n/a | 87 | 00-00-00 |
| Total Load Defl. | L/999 (0.029") | n/a | n/a | 107 | 05-09-00 |
| Live Load Defl. | 2xL/1,998 (0.036") | n/a | n/a | 206 | 14-09-00 |
| Total Neg. Defl. | 2xL/1,998 (-0.024") | n/a | n/a | 107 | 14-09-00 |
| Max Defl. | 0.029" | n/a | n/a | 107 | 05-09-00 |
| Span / Depth | 11.5 | n/a | n/a | | 00-00-00 |

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Hanger | 2" x 3-1/2" | 658 lbs | n/a | 7.7% | HGUS410 |
| B0 Hanger Uplift | 2" x 3-1/2" | 1 lbs | n/a | 0.00 | HGUS410 |
| B1 Beam | 3-1/2" x 3-1/2" | 2,099 lbs | 15.7% | 14% | Unspecified |

Notes


BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl

Description: Designs\Flush Beams\2nd Floor\Flush Beams\B19(i39

Specifier:

Designer:

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets User specified (2xL/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 03-01-08, Bottom: 03-01-08.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected products verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9


Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Connection Diagram

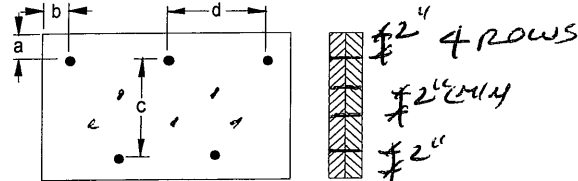

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL



DWG NO. TAM 5024617
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\2nd Floor\Flush Beams\B20(i4148

Specifier:

Designer:

Company:

Msc:

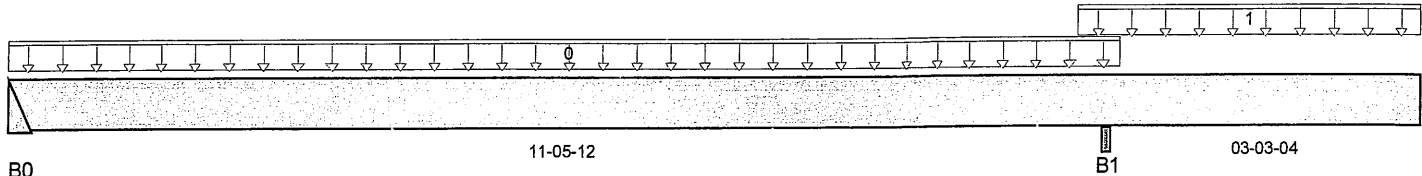

Total Horizontal Product Length = 14-09-00

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|----------|---------|---------|------|
| B0 | 184 / 16 | 142 / 0 | 0 / 110 | |
| B1, 3-1/2" | 318 / 0 | 327 / 0 | 947 / 0 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | FC4 Floor Material | Unf. Lin. (lb/ft) | L | 00-00-00 | 11-07-08 | 32 | 16 | | | n/a |
| 1 | User Load | Unf. Lin. (lb/ft) | L | 11-02-00 | 14-09-00 | 33 | 30 | 234 | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|---------------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 1,197 ft-lbs | 36,706 ft-lbs | 3.3% | 44 | 05-05-09 |
| Neg. Moment | -2,247 ft-lbs | -36,706 ft-lbs | 6.1% | 49 | 11-05-12 |
| End Shear | 357 lbs | 14,464 lbs | 2.5% | 44 | 01-01-14 |
| Cont. Shear | 897 lbs | 14,464 lbs | 6.2% | 49 | 12-07-06 |
| Uplift | 45 lbs | n/a | n/a | 87 | 00-00-00 |
| Total Load Defl. | 2xL/1,998 (0.032") | n/a | n/a | 154 | 14-09-00 |
| Live Load Defl. | 2xL/1,998 (0.036") | n/a | n/a | 206 | 14-09-00 |
| Total Neg. Defl. | 2xL/1,998 (-0.015") | n/a | n/a | 107 | 14-09-00 |
| Max Defl. | 0.02" | n/a | n/a | 107 | 05-07-04 |
| Span / Depth | 11.5 | n/a | n/a | | 00-00-00 |

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Hanger | 2" x 3-1/2" | 453 lbs | n/a | 5.3% | HGUS410 |
| B0 Hanger Uplift | 2" x 3-1/2" | 45 lbs | n/a | 0.00 | HGUS410 |
| B1 Beam | 3-1/2" x 3-1/2" | 1,989 lbs | 14.9% | 13.3% | Unspecified |

Notes



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Flush Beams\2nd Floor\Flush Beams\B20(i41

Specifier:

Designer:

Company:

Misc:

Design meets User specified (2xL/240) Total load deflection criteria.

Design meets User specified (2xL/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 03-01-08, Bottom: 03-01-08.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO CBC 2012

Unbalanced snow loads determined from building geometry were used in selected products verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9


Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Connection Diagram

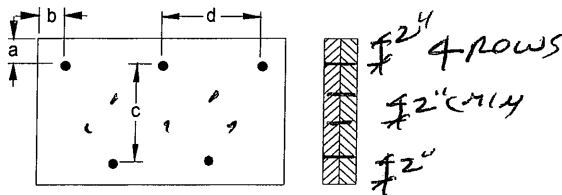

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL





Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\2nd Floor\Flush Beams\B21(i4661

Specifier:

Designer:

Company:

Misc:

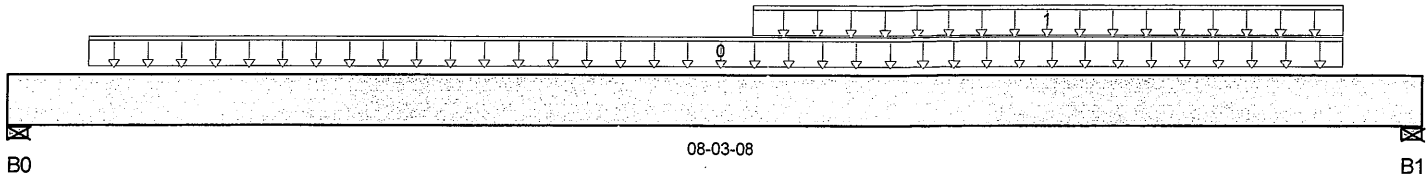

Total Horizontal Product Length = 08-03-08

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 5-1/2" | 262 / 0 | 181 / 0 | | |
| B1, 5-1/2" | 688 / 0 | 394 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | FC4 Floor Material | Unf. Lin. (lb/ft) | L | 00-05-08 | 07-10-00 | 14 | 7 | | | n/a |
| 1 | User Load | Unf. Lin. (lb/ft) | L | 04-04-00 | 07-10-00 | 240 | 120 | | | n/a |

| Controls Summary | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 2,171 ft-lbs | 38,727 ft-lbs | 5.6% | 1 | 05-01-07 |
| End Shear | 968 lbs | 14,464 lbs | 6.7% | 1 | 06-10-02 |
| Total Load Defl. | L/999 (0.015") | n/a | n/a | 4 | 04-04-15 |
| Live Load Defl. | L/999 (0.009") | n/a | n/a | 5 | 04-04-15 |
| Max Defl. | 0.015" | n/a | n/a | 4 | 04-04-15 |
| Span / Depth | 7.6 | n/a | n/a | | 00-00-00 |

| Bearing Supports | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Wall/Plate | 5-1/2" x 3-1/2" | 619 lbs | 6% | 2.6% | Unspecified |
| B1 Wall/Plate | 5-1/2" x 3-1/2" | 1,524 lbs | 14.8% | 6.5% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO CBC 2012

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9



pb 14

DWGD. TAM 50417
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl

Description: Designs\Flush Beams\2nd Floor\Flush Beams\B21(i46


Specifier:

Designer:

Company:

Msc:

Connection Diagram

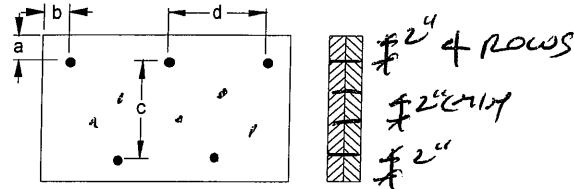

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Member has no side loads.

Connectors are: 16d Nails
3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 504817
STRUCTURAL
COMPONENT ONLY

2nd Floor\Flush Beams\B22(i9543)

BC CALC® Design Report

Dry | 1 span | No cant.

March 2, 2018 16:40:01

Build 6215

Job name:

File name: DEWBERRY 2ES

Address:

Description: 2nd Floor\Flush Beams\B22(i9543)

City, Province, Postal Code: WAT...WN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

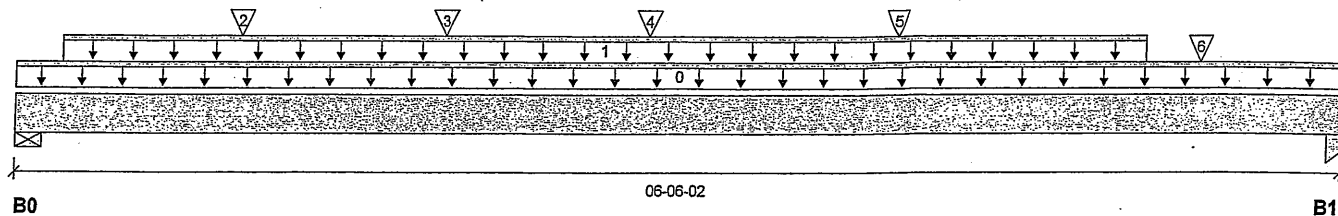

Total Horizontal Product Length = 06-06-02

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|-----------|---------|------|------|
| B0, 4-3/4" | 1,708 / 0 | 895 / 0 | | |
| B1, 1-3/4" | 1,785 / 0 | 931 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Tributary |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0 | Self-Weight | Unf. Lin. (lb/ft) | L | 00-00-00 | 06-06-02 | 12 | | | | 00-00-00 |
| 1 | Smoothed Load | Unf. Lin. (lb/ft) | L | 00-02-12 | 05-06-12 | 270 | 136 | | | n/a |
| 2 | J1(i9644) | Conc. Pt. (lbs) | L | 01-01-04 | 01-01-04 | 293 | 146 | | | n/a |
| 3 | J1(i9557) | Conc. Pt. (lbs) | L | 02-01-04 | 02-01-04 | 293 | 146 | | | n/a |
| 4 | J1(i9602) | Conc. Pt. (lbs) | L | 03-01-04 | 03-01-04 | 356 | 178 | | | n/a |
| 5 | J1(i9580) | Conc. Pt. (lbs) | L | 04-04-00 | 04-04-00 | 409 | 205 | | | n/a |
| 6 | - | Conc. Pt. (lbs) | L | 05-10-01 | 05-10-01 | 699 | 350 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment | 5,904 ft-lbs | 35,392 ft-lbs | 16.7% | 1 | 03-06-12 |
| End Shear | 3,132 lbs | 14,464 lbs | 21.7% | 1 | 05-04-08 |
| Total Load Deflection | L/999 (0.028") | n/a | n/a | 4 | 03-04-00 |
| Live Load Deflection | L/999 (0.019") | n/a | n/a | 5 | 03-04-00 |
| Max Defl. | 0.028" | n/a | n/a | 4 | 03-04-00 |
| Span / Depth | 6.2 | | | | |

Bearing Supports

| | Dim. (LxW) | Demand | Demand/Resistance Support | Demand/Resistance Member | Material |
|----|----------------------------|-----------|---------------------------|--------------------------|-------------|
| B0 | Wall/Plate 4-3/4" x 3-1/2" | 3,681 lbs | 41.5% | 18.1% | Unspecified |
| B1 | Column 1-3/4" x 3-1/2" | 3,842 lbs | 77.2% | 51.4% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

CONFORMS TO OBC 2012

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

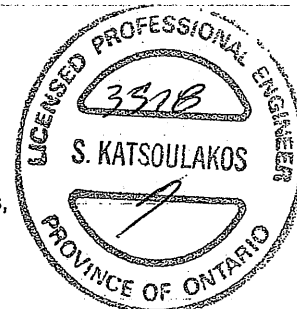

DWG NO. TAM 11846-18
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

2nd Floor Flush Beams B22(i9543)

Dry | 1 span | No cant.

March 2, 2018 16:40:01

File name: DEWBERRY 2E S


Description: 2nd Floor Flush Beams B22(i9543)

Specifier:

Designer: AJ

Company:

Connection Diagram

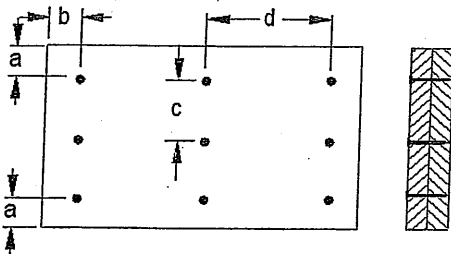

a minimum = 2"

b minimum = 3"

c = 4"

d = 3"

Calculated Side Load = 580.6 lb/ft


Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

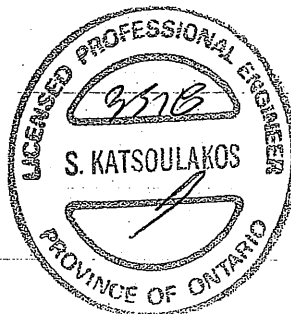

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA RIM PLUS®,
DWG NO. TAM 118468
STRUCTURAL
COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B24(i4447)

Specifier:

Designer:

Company:

Misc:

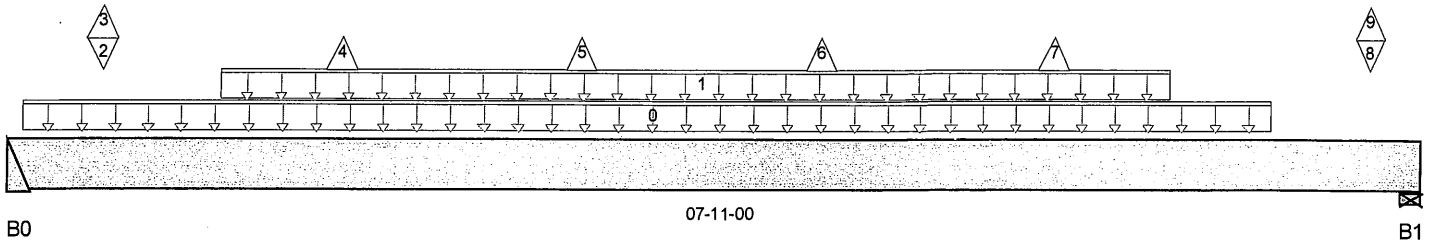

Total Horizontal Product Length = 07-11-00

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|------------|-----------|--------|------|
| B0 | 1,791 / 16 | 897 / 0 | | |
| B1, 5-1/2" | 3,553 / 25 | 1,873 / 0 | 0 / 51 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | User Load | Unf. Lin. (lb/ft) | L | 00-01-00 | 07-01-00 | 240 | 120 | | | n/a |
| 1 | Smoothed Load | Unf. Lin. (lb/ft) | L | 01-02-04 | 06-06-04 | 247 | 111 | | | n/a |
| 2 | J2(i4488) | Conc. Pt. (lbs) | L | 00-06-04 | 00-06-04 | 245 | 111 | | | n/a |
| 3 | J2(i4488) | Conc. Pt. (lbs) | L | 00-06-04 | 00-06-04 | -4 | | | | n/a |
| 4 | J2(i4496) | Conc. Pt. (lbs) | L | 01-10-04 | 01-10-04 | -6 | | | | n/a |
| 5 | J2(i4482) | Conc. Pt. (lbs) | L | 03-02-04 | 03-02-04 | -6 | | | | n/a |
| 6 | J2(i4451) | Conc. Pt. (lbs) | L | 04-06-04 | 04-06-04 | -6 | | | | n/a |
| 7 | J2(i4493) | Conc. Pt. (lbs) | L | 05-10-04 | 05-10-04 | -6 | | | | n/a |
| 8 | - | Conc. Pt. (lbs) | L | 07-07-07 | 07-07-07 | 2,098 | 1,130 | -51 | | n/a |
| 9 | - | Conc. Pt. (lbs) | L | 07-07-07 | 07-07-07 | -13 | | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 7,020 ft-lbs | 38,727 ft-lbs | 18.1% | 1 | 03-09-04 |
| End Shear | 3,260 lbs | 14,464 lbs | 22.5% | 1 | 06-05-10 |
| Total Load Defl. | L/999 (0.05") | n/a | n/a | 56 | 03-09-04 |
| Live Load Defl. | L/999 (0.034") | n/a | n/a | 83 | 03-09-04 |
| Max Defl. | 0.05" | n/a | n/a | 56 | 03-09-04 |
| Span / Depth | 7.5 | n/a | n/a | | 00-00-00 |

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|---------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Hanger | 2" x 3-1/2" | 3,807 lbs | n/a | 44.6% | HGUS410 |
| B1 Wall/Plate | 5-1/2" x 3-1/2" | 7,671 lbs | 74.6% | 32.7% | Unspecified |

Notes



DWB NO. TAM 50220-17
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

July 10, 2017 16:29:37

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B24(i4447

Specifier:

Designer:

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO CBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.


Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Connection Diagram

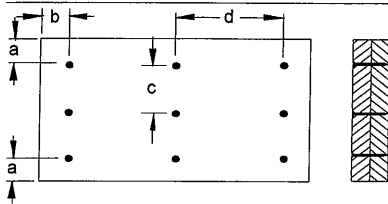

a minimum = 2" c = 3-15/16"
b minimum = 3" d = 6"

Calculated Side Load = 480.1 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d or Nails

3 1/2" ARDOX SPIRAL

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 5022-17
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP 1st Floor...B25(i4692)

Dry | 2 spans | Left cantilever | 0/12 slope (deg)

July 10, 2017 16:35:27

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B25(i4692)

Specifier:

Designer: AJ

Company:

Msc:

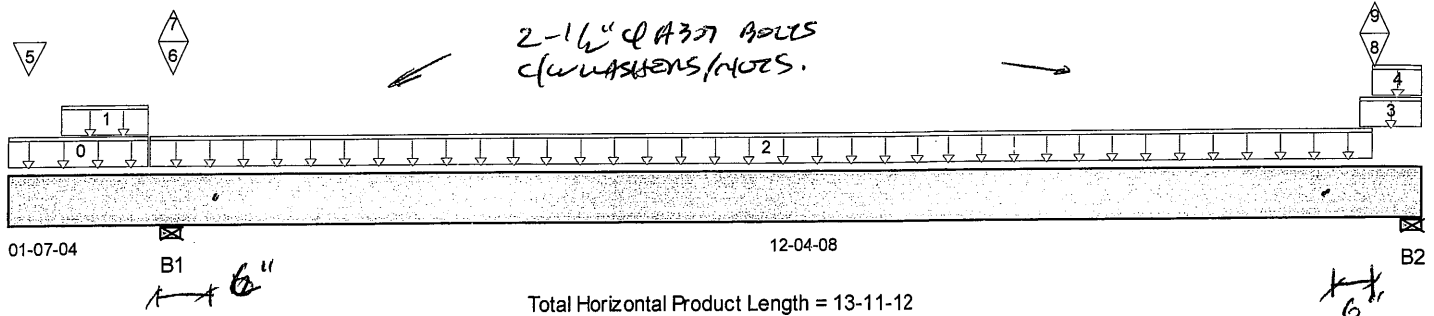

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|------------|-----------|---------|------|
| B1, 5-1/2" | 991 / 2 | 1,402 / 0 | 670 / 0 | |
| B2, 7-1/2" | 2,798 / 36 | 1,562 / 0 | 0 / 35 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|-----------|-----------|-----------|-----------|-------|
| 0 | User Load | Unf. Lin. (lb/ft) | L | 00-00-00 | 01-04-08 | 33 | 30 | 78 | | n/a |
| 1 | E42(i4598) | Unf. Lin. (lb/ft) | L | 00-06-00 | 01-04-08 | | 81 | | | n/a |
| 2 | FC3 Floor Material | Unf. Lin. (lb/ft) | L | 01-04-08 | 13-06-00 | 27 | 13 | | | n/a |
| 3 | E39(i2052) | Unf. Lin. (lb/ft) | L | 13-04-04 | 13-11-12 | 235 | 243 | | | n/a |
| 4 | E39(i2052) | Unf. Lin. (lb/ft) | L | 13-05-12 | 13-11-12 | 87 | | | | n/a |
| 5 | - | Conc. Pt. (lbs) | L | 00-02-06 | 00-02-06 | | 40 | 13 | | n/a |
| 6 | E45(i4603) | Conc. Pt. (lbs) | L | 01-07-04 | 01-07-04 | 748 | 1,047 | 540 | | n/a |
| 7 | E45(i4603) | Conc. Pt. (lbs) | L | 01-07-04 | 01-07-04 | -2 | | | | n/a |
| 8 | - | Conc. Pt. (lbs) | L | 13-06-00 | 13-06-00 | 2,446 | 1,244 | -35 | | n/a |
| 9 | - | Conc. Pt. (lbs) | L | 13-06-00 | 13-06-00 | -30 | | | | n/a |

| Controls Summary | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|---------------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 1,145 ft-lbs | 38,727 ft-lbs | 3% | 4 | 07-09-06 |
| Neg. Moment | -430 ft-lbs | -38,727 ft-lbs | 1.1% | 121 | 01-07-04 |
| End Shear | 330 lbs | 14,464 lbs | 2.3% | 4 | 12-04-06 |
| Cont. Shear | 368 lbs | 14,464 lbs | 2.5% | 17 | 02-09-14 |
| Total Load Defl. | L/999 (0.021") | n/a | n/a | 229 | 07-07-10 |
| Live Load Defl. | L/999 (0.012") | n/a | n/a | 341 | 07-05-14 |
| Total Neg. Defl. | 2xL/1,998 (-0.008") | n/a | n/a | 229 | 00-00-00 |
| Max Defl. | 0.021" | n/a | n/a | 229 | 07-07-10 |
| Span / Depth | 11.9 | n/a | n/a | | 00-00-00 |

| Bearing Supports | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|------------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B1 Wall/Plate | 5-1/2" x 3-1/2" | 3,574 lbs | 34.8% | 15.2% | Unspecified |
| B2 Wall/Plate | 7-1/2" x 3-1/2" | 6,149 lbs | 43.9% | 19.2% | Unspecified |

Notes

Page 1 of 2



DWYND. TAM 502217
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B25(i4692)

Specifier:

Designer: AJ

Company:

Msc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO CBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9


Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Connection Diagram

Concentrated side-load exceeds allowable magnitude for connection design. Please consult a technical representative or Professional Engineer for the design of the connection.

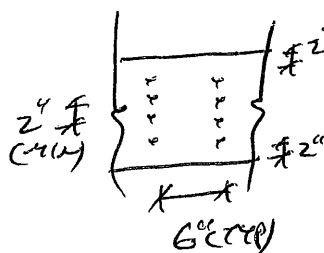

PROVIDE 4 ROWS OF 3 1/2" ARDOX SPIRAL NAILS @ 6" O/C FOR MULTI-PLY NAILING. MAINTAIN A MIN. 2" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

+
BOLTS

OK WITH
NAILING
+
BOLTING

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

March 9, 2018 07:24:18


File name: DEWBERRY 2ES

Description: 2nd Floor\Flush Beams\B26B(i10614)

Specifier:

Designer: AJ

Company:

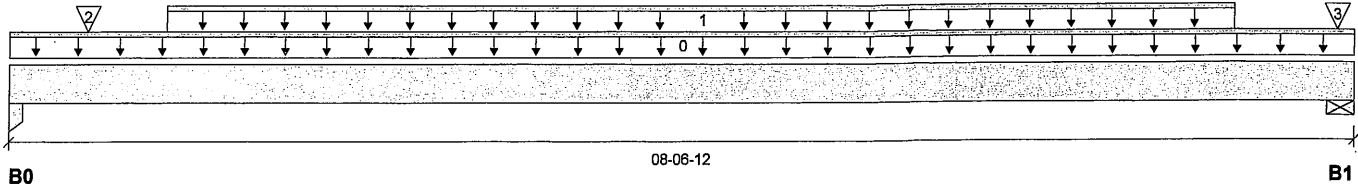

Total Horizontal Product Length = 08-06-12

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|-----------|-----------|------|------|
| B0, 1-3/4" | 1,912 / 0 | 1,005 / 0 | | |
| B1, 2-1/8" | 1,660 / 0 | 881 / 0 | | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Tributary |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0 | Self-Weight | Unf. Lin. (lb/ft) | L | 00-00-00 | 08-06-12 | | 12 | | | 00-00-00 |
| 1 | Smoothed Load | Unf. Lin. (lb/ft) | L | 00-11-14 | 07-09-14 | 432 | 216 | | | n/a |
| 2 | - | Conc. Pt. (lbs) | L | 00-05-14 | 00-05-14 | 538 | 269 | | | n/a |
| 3 | J4(i10152) | Conc. Pt. (lbs) | L | 08-05-08 | 08-05-08 | 79 | 40 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand/ Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-----------------------|------|----------|
| Pos. Moment | 8,323 ft-lbs | 35,392 ft-lbs | 23.5% | 1 | 04-05-14 |
| End Shear | 3,382 lbs | 14,464 lbs | 23.4% | 1 | 07-04-12 |
| Total Load Deflection | L/999 (0.075") | n/a | n/a | 4 | 04-02-14 |
| Live Load Deflection | L/999 (0.049") | n/a | n/a | 5 | 04-02-14 |
| Max Defl. | 0.075" | n/a | n/a | 4 | 04-02-14 |
| Span / Depth | 8.5 | | | | |

| Bearing Supports | Dim. (LxW) | Demand | Demand/ Resistance Support | Demand/ Resistance Member | Material |
|------------------|----------------------------|-----------|----------------------------------|---------------------------------|-------------|
| B0 | Column 1-3/4" x 3-1/2" | 4,124 lbs | 82.9% | 55.2% | Unspecified |
| B1 | Wall/Plate 2-1/8" x 3-1/2" | 3,591 lbs | 90.4% | 39.6% | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

CONFORMS TO OBC 2012

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.



DWG NO. TAM 14176-18
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

2nd Floor\Flush Beams\B26B(i10614)

Dry | 1 span | No cant.

March 9, 2018 07:24:18

File name: DEWBERRY 2E.mmdl


Description: 2nd Floor\Flush Beams\B26B(i10614)

Specifier:

Designer: AJ

Company:

Connection Diagram

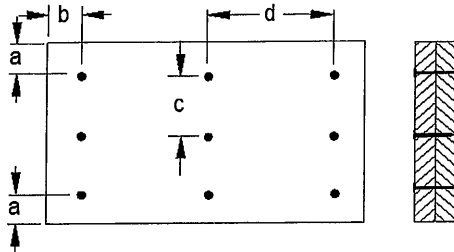

a minimum = 2"

b minimum = 3"

c = 4"

d = 4"

Calculated Side Load = 636.8 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d ^{16d} Nails

3-1/2" ARDOX SPIRAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



DWG NO. TAM 14126-18
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B26(i4803)

Specifier:

Designer: AJ

Company:

Misc:

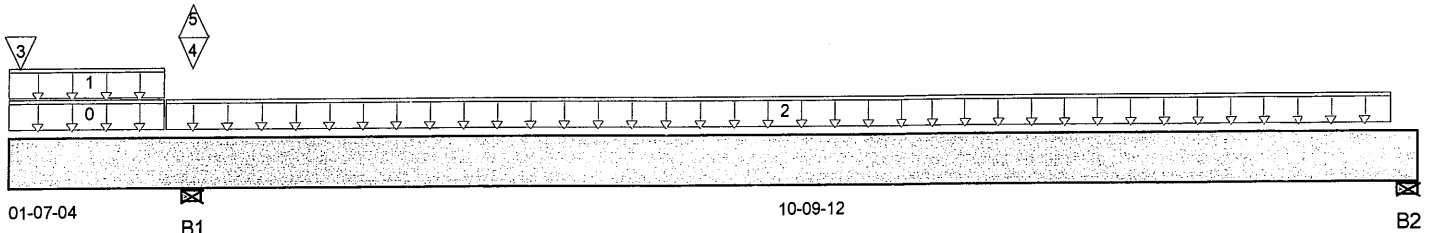

Total Horizontal Product Length = 12-05-00

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|------------|-----------|---------|------|
| B1, 5-1/2" | 2,986 / 14 | 2,493 / 0 | 632 / 0 | |
| B2, 5-1/2" | 143 / 7 | 122 / 0 | 0 / 13 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | User Load | Unf. Lin. (lb/ft) | L | 00-00-00 | 01-04-08 | 33 | 30 | 78 | | n/a |
| 1 | E44(i4596) | Unf. Lin. (lb/ft) | L | 00-00-00 | 01-04-08 | | 81 | | | n/a |
| 2 | FC3 Floor Material | Unf. Lin. (lb/ft) | L | 01-04-08 | 12-02-04 | 27 | 13 | | | n/a |
| 3 | FC3 Floor Material | Conc. Pt. (lbs) | L | 00-01-02 | 00-01-02 | | | 22 | | n/a |
| 4 | E36(i1694) | Conc. Pt. (lbs) | L | 01-07-04 | 01-07-04 | 2,756 | 2,149 | 490 | | n/a |
| 5 | E36(i1694) | Conc. Pt. (lbs) | L | 01-07-04 | 01-07-04 | -14 | | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|---------------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 864 ft-lbs | 38,727 ft-lbs | 2.2% | 44 | 07-01-13 |
| Neg. Moment | -461 ft-lbs | -38,727 ft-lbs | 1.2% | 51 | 01-07-04 |
| End Shear | 277 lbs | 14,464 lbs | 1.9% | 44 | 10-11-10 |
| Cont. Shear | 325 lbs | 14,464 lbs | 2.2% | 1 | 02-09-14 |
| Total Load Defl. | L/999 (0.012") | n/a | n/a | 103 | 06-10-12 |
| Live Load Defl. | L/999 (0.007") | n/a | n/a | 152 | 06-09-04 |
| Total Neg. Defl. | 2xL/1,998 (-0.005") | n/a | n/a | 103 | 00-00-00 |
| Max Defl. | 0.012" | n/a | n/a | 103 | 06-10-12 |
| Span / Depth | 10.5 | n/a | n/a | | 00-00-00 |

Bearing Supports

| | | | | | | |
|----|------------|-----------------|-----------|------|-------|-------------|
| B1 | Wall/Plate | 5-1/2" x 3-1/2" | 7,912 lbs | 77% | 33.7% | Unspecified |
| B2 | Wall/Plate | 5-1/2" x 3-1/2" | 367 lbs | 3.6% | 1.6% | Unspecified |

Notes



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B26(i4803)

Specifier:

Designer: AJ

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected products verification.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Connection Diagram

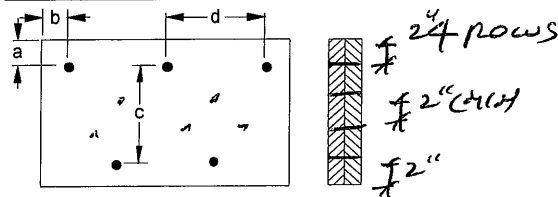

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DW NO. TAM502217
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY 2ES NEW.mmdl


Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B27

Specifier:

Designer:

Company:

Misc:

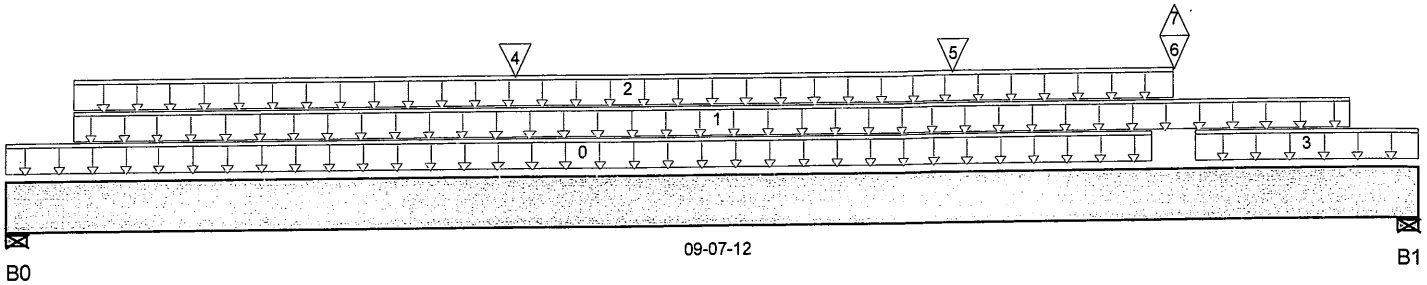

Total Horizontal Product Length = 09-07-12

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|------------|-----------|----------|------|
| B0, 5-1/2" | 774 / 2 | 1,022 / 0 | 555 / 16 | |
| B1, 5-1/2" | 2,705 / 14 | 2,084 / 0 | 589 / 98 | |

Load Summary

| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|-------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0 | J3(i4636) | Unf. Lin. (lb/ft) | L | 00-00-00 | 07-10-00 | 27 | 16 | | | n/a |
| 1 | User Load | Unf. Lin. (lb/ft) | L | 00-05-08 | 09-02-04 | | 100 | | | n/a |
| 2 | R1(i4672) | Unf. Lin. (lb/ft) | L | 00-05-08 | 07-11-12 | 6 | | | | n/a |
| 3 | J4(i4651) | Unf. Lin. (lb/ft) | L | 08-01-08 | 09-07-12 | 25 | | | | n/a |
| 4 | User Load | Conc. Pt. (lbs) | L | 03-05-08 | 03-05-08 | 242 | 220 | 572 | | n/a |
| 5 | R1(i4672) | Conc. Pt. (lbs) | L | 06-05-08 | 06-05-08 | 242 | 220 | 572 | | n/a |
| 6 | B17(i4664) | Conc. Pt. (lbs) | L | 07-11-12 | 07-11-12 | 2,692 | 1,471 | -114 | | n/a |
| 7 | B17(i4664) | Conc. Pt. (lbs) | L | 07-11-12 | 07-11-12 | -16 | | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment | 9,597 ft-lbs | 38,727 ft-lbs | 24.8% | 9 | 06-05-08 |
| End Shear | 6,712 lbs | 14,464 lbs | 46.4% | 9 | 08-02-06 |
| Total Load Defl. | L/999 (0.101") | n/a | n/a | 116 | 05-01-12 |
| Live Load Defl. | L/999 (0.057") | n/a | n/a | 168 | 05-01-12 |
| Max Defl. | 0.101" | n/a | n/a | 116 | 05-01-12 |
| Span / Depth | 8.9 | n/a | n/a | | 00-00-00 |

Bearing Supports

| | Dim. (L x W) | Demand | Demand / Resistance Support | Demand / Resistance Member | Material |
|----|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 | 5-1/2" x 3-1/2" | 2,715 lbs | 17.4% | 11.6% | Unspecified |
| B1 | 5-1/2" x 3-1/2" | 6,956 lbs | 44.5% | 29.6% | Unspecified |

Notes



PSL

 DWG NO. TAM5023-17
 STRUCTURAL
 COMPONENT ONLY



BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: DEWBERRY2ES NEW.mmdl

Description: Designs\Dropped Beams\2nd Floor\Dropped Beams\B

Specifier:

Designer:

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.


CONFORMS TO CBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection Diagram

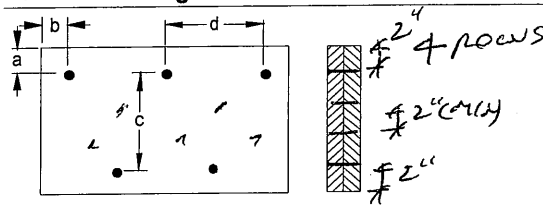

a minimum = 2" c = 7-7/8"
b minimum = 3" d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



**DW6 NO. TAM 502237
STRUCTURAL
COMPONENT ONLY**

1st Floor\Flush Beams\B28(i6349)

Dry | 1 span | No cant.

March 2, 2018 11:25:14

BC CALC® Design Report

Build 6215

Job name:

File name: DEWBERRY 2ES NEW.mmdl

Address:

Description: 1st Floor\Flush Beams\B28(i6349)

City, Province, Postal Code: WAT...WN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

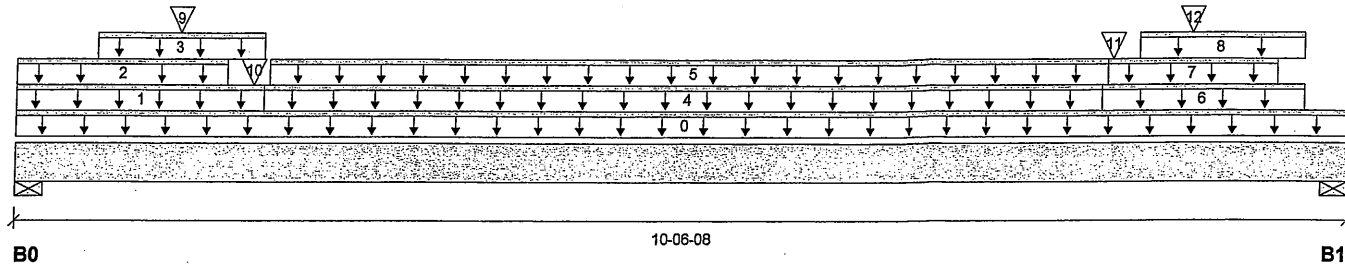

Total Horizontal Product Length = 10-06-08

Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live | Dead | Snow | Wind |
|------------|-----------|-----------|-----------|------|
| B0, 5-1/2" | 3,605 / 0 | 3,399 / 0 | 3,306 / 0 | |
| B1, 4" | 3,476 / 0 | 3,197 / 0 | 3,015 / 0 | |

Load Summary


| Tag | Description | Load Type | Ref. | Start | End | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Tributary |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0 | Self-Weight | Unf. Lin. (lb/ft) | L | 00-00-00 | 10-06-08 | | 18 | | | 00-00-00 |
| 1 | E49(i5854) | Unf. Lin. (lb/ft) | L | 00-00-00 | 01-11-08 | | 81 | | | n/a |
| 2 | E49(i5854) | Unf. Lin. (lb/ft) | L | 00-00-00 | 01-08-00 | 219 | 325 | 619 | | n/a |
| 3 | E49(i5854) | Unf. Lin. (lb/ft) | L | 00-07-08 | 01-11-08 | 242 | 121 | | | n/a |
| 4 | E48(i5853) | Unf. Lin. (lb/ft) | L | 01-11-08 | 08-07-08 | | 41 | | | n/a |
| 5 | Smoothed Load | Unf. Lin. (lb/ft) | L | 02-00-00 | 08-08-00 | 267 | 134 | | | n/a |
| 6 | E33(i1687) | Unf. Lin. (lb/ft) | L | 08-07-08 | 10-02-08 | | 81 | | | n/a |
| 7 | E33(i1687) | Unf. Lin. (lb/ft) | L | 08-08-00 | 10-00-00 | 245 | 123 | | | n/a |
| 8 | E33(i1687) | Unf. Lin. (lb/ft) | L | 08-11-00 | 10-02-08 | 219 | 325 | 619 | | n/a |
| 9 | J3(i6398) | Conc. Pt. (lbs) | L | 01-03-08 | 01-03-08 | 277 | 136 | | | n/a |
| 10 | E49(i5854) | Conc. Pt. (lbs) | L | 01-10-08 | 01-10-08 | 1,660 | 1,668 | 2,250 | | n/a |
| 11 | E33(i1687) | Conc. Pt. (lbs) | L | 08-08-08 | 08-08-08 | 1,673 | 1,670 | 2,238 | | n/a |
| 12 | J3(i6378) | Conc. Pt. (lbs) | L | 09-04-00 | 09-04-00 | 329 | 164 | | | n/a |

Controls Summary

| | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment | 18,089 ft-lbs | 55,212 ft-lbs | 32.8% | 1 | 05-04-00 |
| End Shear | 9,475 lbs | 21,696 lbs | 43.7% | 1 | 01-05-06 |
| Total Load Deflection | L/665 (0.178") | n/a | 36.1% | 35 | 05-04-00 |
| Live Load Deflection | L/999 (0.108") | n/a | n/a | 51 | 05-04-00 |
| Max Defl. | 0.178" | n/a | n/a | 35 | 05-04-00 |
| Span / Depth | 10.0 | | | | |

Bearing Supports

| | Dim. (LxW) | Demand | Demand/Resistance Support | Demand/Resistance Member | Material |
|----|----------------------------|------------|---------------------------|--------------------------|-------------|
| B0 | Wall/Plate 5-1/2" x 5-1/4" | 11,308 lbs | 73.3% | 32.1% | Unspecified |
| B1 | Wall/Plate 4" x 5-1/4" | 10,718 lbs | 95.6% | 41.8% | Unspecified |

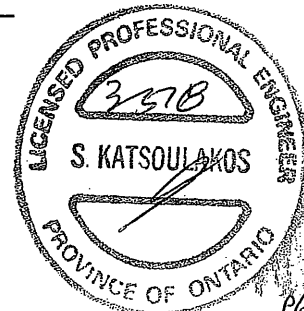

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

1st Floor\Flush Beams\B28(i6349)

Dry | 1 span | No cant.

March 2, 2018 11:25:14

File name: DEWBERRY 2ES NEW.mmdl

Description: 1st Floor\Flush Beams\B28(i6349)

Specifier:

Designer: AJ

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.


CONFORMS TO OBC 2012

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connection Diagram

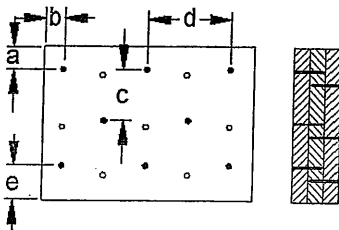

a minimum = 1"

b minimum = 3"

c = 4-1/2"

d = 4"

e minimum = 2"

Calculated Side Load = 480.6 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Common Nails



3-1/2" ARDOX SPIRAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,







Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

| Depth | Series | Bare | | | | 1/2" Gypsum Ceiling | | | |
|---------|--------|-------------------|---------|---------|-----|---------------------|---------|---------|-----|
| | | On Centre Spacing | | | | On Centre Spacing | | | |
| | | 12" | 16" | 19.2" | 24" | 12" | 16" | 19.2" | 24" |
| 9-1/2" | NI-20 | 15'-1" | 14'-2" | 13'-9" | N/A | 15'-7" | 14'-8" | 14'-2" | N/A |
| | NI-40x | 16'-1" | 15'-2" | 14'-8" | N/A | 16'-7" | 15'-7" | 15'-1" | N/A |
| | NI-60 | 16'-3" | 15'-4" | 14'-10" | N/A | 16'-8" | 15'-9" | 15'-3" | N/A |
| | NI-70 | 17'-1" | 16'-1" | 15'-6" | N/A | 17'-5" | 16'-5" | 15'-10" | N/A |
| | NI-80 | 17'-3" | 16'-3" | 15'-8" | N/A | 17'-8" | 16'-7" | 16'-0" | N/A |
| 11-7/8" | NI-20 | 16'-11" | 16'-0" | 15'-5" | N/A | 17'-6" | 16'-6" | 16'-0" | N/A |
| | NI-40x | 18'-1" | 17'-0" | 16'-5" | N/A | 18'-9" | 17'-6" | 16'-11" | N/A |
| | NI-60 | 18'-4" | 17'-3" | 16'-7" | N/A | 19'-0" | 17'-8" | 17'-1" | N/A |
| | NI-70 | 19'-6" | 18'-0" | 17'-4" | N/A | 20'-1" | 18'-7" | 17'-9" | N/A |
| | NI-80 | 19'-9" | 18'-3" | 17'-6" | N/A | 20'-4" | 18'-10" | 17'-11" | N/A |
| 14" | NI-90x | 20'-4" | 18'-9" | 17'-11" | N/A | 20'-10" | 19'-3" | 18'-5" | N/A |
| | NI-40x | 20'-1" | 18'-7" | 17'-10" | N/A | 20'-10" | 19'-4" | 18'-6" | N/A |
| | NI-60 | 20'-5" | 18'-11" | 18'-1" | N/A | 21'-2" | 19'-7" | 18'-9" | N/A |
| | NI-70 | 21'-7" | 20'-0" | 19'-1" | N/A | 22'-3" | 20'-7" | 19'-8" | N/A |
| | NI-80 | 21'-11" | 20'-3" | 19'-4" | N/A | 22'-7" | 20'-11" | 20'-0" | N/A |
| 16" | NI-90x | 22'-7" | 20'-11" | 19'-11" | N/A | 23'-3" | 21'-6" | 20'-6" | N/A |
| | NI-60 | 22'-3" | 20'-8" | 19'-9" | N/A | 23'-1" | 21'-5" | 20'-6" | N/A |
| | NI-70 | 23'-6" | 21'-9" | 20'-9" | N/A | 24'-3" | 22'-5" | 21'-5" | N/A |
| | NI-80 | 23'-11" | 22'-1" | 21'-1" | N/A | 24'-8" | 22'-10" | 21'-9" | N/A |
| | NI-90x | 24'-8" | 22'-9" | 21'-9" | N/A | 25'-4" | 23'-5" | 22'-4" | N/A |

| Depth | Series | Mid-Span Blocking | | | | Mid-Span Blocking and 1/2" Gypsum Ceiling | | | |
|---------|--------|-------------------|---------|---------|-----|---|---------|---------|-----|
| | | On Centre Spacing | | | | On Centre Spacing | | | |
| | | 12" | 16" | 19.2" | 24" | 12" | 16" | 19.2" | 24" |
| 9-1/2" | NI-20 | 16'-8" | 15'-3" | 14'-5" | N/A | 16'-8" | 15'-3" | 14'-5" | N/A |
| | NI-40x | 17'-11" | 16'-11" | 16'-1" | N/A | 18'-5" | 17'-1" | 16'-1" | N/A |
| | NI-60 | 18'-2" | 17'-1" | 16'-4" | N/A | 18'-7" | 17'-4" | 16'-4" | N/A |
| | NI-70 | 19'-2" | 17'-10" | 17'-2" | N/A | 19'-7" | 18'-3" | 17'-7" | N/A |
| | NI-80 | 19'-5" | 18'-0" | 17'-4" | N/A | 19'-10" | 18'-5" | 17'-8" | N/A |
| 11-7/8" | NI-20 | 19'-6" | 18'-1" | 17'-3" | N/A | 19'-11" | 18'-3" | 17'-3" | N/A |
| | NI-40x | 21'-0" | 19'-6" | 18'-8" | N/A | 21'-7" | 20'-2" | 19'-2" | N/A |
| | NI-60 | 21'-4" | 19'-9" | 18'-11" | N/A | 21'-11" | 20'-4" | 19'-6" | N/A |
| | NI-70 | 22'-6" | 20'-10" | 19'-11" | N/A | 23'-0" | 21'-5" | 20'-5" | N/A |
| | NI-80 | 22'-9" | 21'-1" | 20'-1" | N/A | 23'-3" | 21'-7" | 20'-8" | N/A |
| 14" | NI-90x | 23'-4" | 21'-8" | 20'-8" | N/A | 23'-10" | 22'-2" | 21'-2" | N/A |
| | NI-40x | 23'-7" | 21'-11" | 20'-11" | N/A | 24'-3" | 22'-7" | 21'-7" | N/A |
| | NI-60 | 24'-0" | 22'-3" | 21'-3" | N/A | 24'-8" | 22'-11" | 21'-11" | N/A |
| | NI-70 | 25'-3" | 23'-4" | 22'-3" | N/A | 25'-10" | 24'-0" | 22'-11" | N/A |
| | NI-80 | 25'-7" | 23'-8" | 22'-7" | N/A | 26'-2" | 24'-4" | 23'-2" | N/A |
| 16" | NI-90x | 26'-4" | 24'-4" | 23'-3" | N/A | 26'-10" | 24'-11" | 23'-9" | N/A |
| | NI-60 | 26'-5" | 24'-6" | 23'-4" | N/A | 27'-2" | 25'-3" | 24'-2" | N/A |
| | NI-70 | 27'-9" | 25'-8" | 24'-6" | N/A | 28'-5" | 26'-5" | 25'-2" | N/A |
| | NI-80 | 28'-2" | 26'-1" | 24'-10" | N/A | 28'-10" | 26'-9" | 25'-6" | N/A |
| | NI-90x | 29'-0" | 26'-10" | 25'-7" | N/A | 29'-7" | 27'-5" | 26'-2" | N/A |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing



| Depth | Series | Bare | | | | 1/2" Gypsum Ceiling | | | |
|---------|--------|-------------------|---------|---------|---------|---------------------|---------|---------|---------|
| | | On Centre Spacing | | | | On Centre Spacing | | | |
| | | 12" | 16" | 19.2" | 24" | 12" | 16" | 19.2" | 24" |
| 9-1/2" | NI-20 | 15'-10" | 15'-0" | 14'-5" | 13'-5" | 16'-4" | 15'-5" | 14'-6" | 13'-5" |
| | NI-40x | 17'-0" | 16'-0" | 15'-5" | 14'-9" | 17'-5" | 16'-5" | 15'-10" | 15'-2" |
| | NI-60 | 17'-2" | 16'-2" | 15'-7" | 14'-11" | 17'-6" | 16'-7" | 15'-11" | 15'-3" |
| | NI-70 | 18'-0" | 16'-11" | 16'-3" | 15'-7" | 18'-5" | 17'-3" | 16'-7" | 15'-11" |
| | NI-80 | 18'-3" | 17'-1" | 16'-5" | 15'-9" | 18'-8" | 17'-5" | 16'-9" | 16'-1" |
| 11-7/8" | NI-20 | 17'-10" | 16'-10" | 16'-2" | 15'-6" | 18'-6" | 17'-4" | 16'-9" | 16'-1" |
| | NI-40x | 19'-4" | 17'-11" | 17'-3" | 16'-6" | 19'-11" | 18'-6" | 17'-9" | 17'-0" |
| | NI-60 | 19'-7" | 18'-2" | 17'-5" | 16'-9" | 20'-2" | 18'-9" | 17'-11" | 17'-2" |
| | NI-70 | 20'-9" | 19'-2" | 18'-3" | 17'-5" | 21'-4" | 19'-9" | 18'-10" | 17'-10" |
| | NI-80 | 21'-1" | 19'-5" | 18'-6" | 17'-7" | 21'-7" | 20'-0" | 19'-0" | 18'-0" |
| 14" | NI-90x | 21'-8" | 20'-0" | 19'-1" | 18'-0" | 22'-2" | 20'-6" | 19'-6" | 18'-6" |
| | NI-40x | 21'-5" | 19'-10" | 18'-11" | 17'-11" | 22'-1" | 20'-6" | 19'-7" | 18'-7" |
| | NI-60 | 21'-10" | 20'-2" | 19'-3" | 18'-2" | 22'-5" | 20'-10" | 19'-11" | 18'-10" |
| | NI-70 | 23'-0" | 21'-3" | 20'-3" | 19'-2" | 23'-8" | 21'-11" | 20'-10" | 19'-9" |
| | NI-80 | 23'-5" | 21'-7" | 20'-7" | 19'-5" | 24'-0" | 22'-3" | 21'-2" | 20'-0" |
| 16" | NI-90x | 24'-1" | 22'-3" | 21'-2" | 20'-0" | 24'-8" | 22'-10" | 21'-9" | 20'-7" |
| | NI-60 | 23'-9" | 22'-0" | 20'-11" | 19'-10" | 24'-6" | 22'-9" | 21'-8" | 20'-6" |
| | NI-70 | 25'-1" | 23'-2" | 22'-0" | 20'-10" | 25'-9" | 23'-10" | 22'-9" | 21'-6" |
| | NI-80 | 25'-6" | 23'-6" | 22'-4" | 21'-2" | 26'-1" | 24'-2" | 23'-1" | 21'-10" |
| | NI-90x | 26'-4" | 24'-3" | 23'-1" | 21'-10" | 26'-11" | 24'-11" | 23'-8" | 22'-5" |

| Depth | Series | Mid-Span Blocking | | | | Mid-Span Blocking and 1/2" Gypsum Ceiling | | | |
|---------|--------|-------------------|---------|---------|---------|---|---------|---------|---------|
| | | On Centre Spacing | | | | On Centre Spacing | | | |
| | | 12" | 16" | 19.2" | 24" | 12" | 16" | 19.2" | 24" |
| 9-1/2" | NI-20 | 16'-10" | 15'-5" | 14'-6" | 13'-5" | 16'-10" | 15'-5" | 14'-6" | 13'-5" |
| | NI-40x | 18'-8" | 17'-2" | 16'-3" | 15'-2" | 18'-10" | 17'-2" | 16'-3" | 15'-2" |
| | NI-60 | 18'-11" | 17'-6" | 16'-6" | 15'-5" | 19'-2" | 17'-6" | 16'-6" | 15'-5" |
| | NI-70 | 20'-0" | 18'-7" | 17'-9" | 16'-7" | 20'-5" | 18'-11" | 17'-10" | 16'-7" |
| | NI-80 | 20'-3" | 18'-10" | 17'-11" | 16'-10" | 20'-8" | 19'-3" | 18'-2" | 16'-10" |
| 11-7/8" | NI-20 | 20'-1" | 18'-5" | 17'-5" | 16'-2" | 20'-1" | 18'-5" | 17'-5" | 16'-2" |
| | NI-40x | 21'-10" | 20'-4" | 19'-4" | 17'-8" | 22'-5" | 20'-6" | 19'-4" | 17'-8" |
| | NI-60 | 22'-1" | 20'-7" | 19'-7" | 18'-4" | 22'-8" | 20'-10" | 19'-8" | 18'-4" |
| | NI-70 | 23'-4" | 21'-8" | 20'-8" | 19'-7" | 23'-10" | 22'-3" | 21'-2" | 19'-9" |
| | NI-80 | 23'-7" | 21'-11" | 20'-11" | 19'-9" | 24'-1" | 22'-6" | 21'-5" | 20'-0" |
| 14" | NI-90x | 24'-3" | 22'-6" | 21'-6" | 20'-4" | 24'-8" | 23'-0" | 22'-0" | 20'-9" |
| | NI-40x | 24'-5" | 22'-9" | 21'-8" | 19'-5" | 25'-1" | 23'-2" | 21'-9" | 19'-5" |
| | NI-60 | 24'-10" | 23'-1" | 22'-0" | 20'-10" | 25'-6" | 23'-8" | 22'-4" | 20'-10" |
| | NI-70 | 26'-1" | 24'-3" | 23'-2" | 21'-10" | 26'-8" | 24'-11" | 23'-9" | 22'-4" |
| | NI-80 | 26'-6" | 24'-7" | 23'-5" | 22'-2" | 27'-1" | 25'-3" | 24'-1" | 22'-9" |
| 16" | NI-90x | 27'-3" | 25'-4" | 24'-1" | 22'-9" | 27'-9" | 25'-11" | 24'-8" | 23'-4" |
| | NI-60 | 27'-3" | 25'-5" | 24'-2" | 22'-10" | 28'-0" | 26'-2" | 24'-9" | 23'-1" |
| | NI-70 | 28'-8" | 26'-8" | 25'-4" | 23'-11" | 29'-3" | 27'-4" | 26'-1" | 24'-8" |
| | NI-80 | 29'-1" | 27'-0" | 25'-9" | 24'-4" | 29'-8" | 27'-9" | 26'-5" | 25'-0" |
| | NI-90x | 29'-11" | 27'-10" | 26'-6" | 25'-0" | 30'-6" | 28'-5" | 27'-2" | 25'-8" |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

Maximum Floor Spans



Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing



| Depth | Series | Bare | | | | 1/2" Gypsum Ceiling | | | |
|---------|--------|-------------------|---------|---------|-----|---------------------|---------|---------|-----|
| | | On Centre Spacing | | | | On Centre Spacing | | | |
| | | 12" | 16" | 19.2" | 24" | 12" | 16" | 19.2" | 24" |
| 9-1/2" | NI-20 | 15'-1" | 14'-1" | 13'-3" | N/A | 15'-7" | 14'-1" | 13'-3" | N/A |
| | NI-40x | 16'-1" | 15'-2" | 14'-8" | N/A | 16'-7" | 15'-7" | 15'-1" | N/A |
| | NI-60 | 16'-3" | 15'-4" | 14'-10" | N/A | 16'-8" | 15'-9" | 15'-3" | N/A |
| | NI-70 | 17'-1" | 16'-1" | 15'-6" | N/A | 17'-5" | 16'-5" | 15'-10" | N/A |
| | NI-80 | 17'-3" | 16'-3" | 15'-8" | N/A | 17'-8" | 16'-7" | 16'-0" | N/A |
| 11-7/8" | NI-20 | 16'-11" | 16'-0" | 15'-5" | N/A | 17'-6" | 16'-6" | 16'-0" | N/A |
| | NI-40x | 18'-1" | 17'-0" | 16'-5" | N/A | 18'-9" | 17'-6" | 16'-11" | N/A |
| | NI-60 | 18'-4" | 17'-3" | 16'-7" | N/A | 19'-0" | 17'-8" | 17'-1" | N/A |
| | NI-70 | 19'-6" | 18'-0" | 17'-4" | N/A | 20'-1" | 18'-7" | 17'-9" | N/A |
| | NI-80 | 19'-9" | 18'-3" | 17'-6" | N/A | 20'-4" | 18'-10" | 17'-11" | N/A |
| 14" | NI-90x | 20'-4" | 18'-9" | 17'-11" | N/A | 20'-10" | 19'-3" | 18'-5" | N/A |
| | NI-40x | 20'-1" | 18'-7" | 17'-10" | N/A | 20'-10" | 19'-4" | 18'-6" | N/A |
| | NI-60 | 20'-5" | 18'-11" | 18'-1" | N/A | 21'-2" | 19'-7" | 18'-9" | N/A |
| | NI-70 | 21'-7" | 20'-0" | 19'-1" | N/A | 22'-3" | 20'-7" | 19'-8" | N/A |
| | NI-80 | 21'-11" | 20'-3" | 19'-4" | N/A | 22'-7" | 20'-11" | 20'-0" | N/A |
| 16" | NI-90x | 22'-7" | 20'-11" | 19'-11" | N/A | 23'-3" | 21'-6" | 20'-6" | N/A |
| | NI-60 | 22'-3" | 20'-8" | 19'-9" | N/A | 23'-1" | 21'-5" | 20'-6" | N/A |
| | NI-70 | 23'-6" | 21'-9" | 20'-9" | N/A | 24'-3" | 22'-5" | 21'-5" | N/A |
| | NI-80 | 23'-11" | 22'-1" | 21'-1" | N/A | 24'-8" | 22'-10" | 21'-9" | N/A |
| | NI-90x | 24'-8" | 22'-9" | 21'-9" | N/A | 25'-4" | 23'-5" | 22'-4" | N/A |

| Depth | Series | Mid-Span Blocking | | | | Mid-Span Blocking and 1/2" Gypsum Ceiling | | | |
|---------|--------|-------------------|---------|---------|-----|---|---------|--------|-----|
| | | On Centre Spacing | | | | On Centre Spacing | | | |
| | | 12" | 16" | 19.2" | 24" | 12" | 16" | 19.2" | 24" |
| 9-1/2" | NI-20 | 15'-7" | 14'-1" | 13'-3" | N/A | 15'-7" | 14'-1" | 13'-3" | N/A |
| | NI-40x | 17'-9" | 16'-1" | 15'-1" | N/A | 17'-9" | 16'-1" | 15'-1" | N/A |
| | NI-60 | 18'-1" | 16'-4" | 15'-4" | N/A | 18'-1" | 16'-4" | 15'-4" | N/A |
| | NI-70 | 19'-2" | 17'-10" | 16'-9" | N/A | 19'-7" | 17'-10" | 16'-9" | N/A |
| | NI-80 | 19'-5" | 18'-0" | 17'-1" | N/A | 19'-10" | 18'-3" | 17'-1" | N/A |
| 11-7/8" | NI-20 | 18'-9" | 17'-0" | 16'-0" | N/A | 18'-9" | 17'-0" | 16'-0" | N/A |
| | NI-40x | 21'-0" | 19'-3" | 17'-9" | N/A | 21'-3" | 19'-3" | 17'-9" | N/A |
| | NI-60 | 21'-4" | 19'-8" | 18'-5" | N/A | 21'-8" | 19'-8" | 18'-5" | N/A |
| | NI-70 | 22'-6" | 20'-10" | 19'-11" | N/A | 23'-0" | 21'-4" | 20'-0" | N/A |
| | NI-80 | 22'-9" | 21'-1" | 20'-1" | N/A | 23'-3" | 21'-7" | 20'-5" | N/A |
| 14" | NI-90x | 23'-4" | 21'-8" | 20'-8" | N/A | 23'-10" | 22'-2" | 21'-2" | N/A |
| | NI-40x | 23'-7" | 21'-5" | 19'-6" | N/A | 24'-1" | 21'-5" | 19'-6" | N/A |
| | NI-60 | 24'-0" | 22'-3" | 21'-0" | N/A | 24'-8" | 22'-5" | 21'-0" | N/A |
| | NI-70 | 25'-3" | 23'-4" | 22'-3" | N/A | 25'-10" | 24'-0" | 22'-9" | N/A |
| | NI-80 | 25'-7" | 23'-8" | 22'-7" | N/A | 26'-2" | 24'-4" | 23'-2" | N/A |
| 16" | NI-90x | 26'-4" | 24'-4" | 23'-3" | N/A | 26'-10" | 24'-11" | 23'-9" | N/A |
| | NI-60 | 26'-5" | 24'-6" | 23'-4" | N/A | 27'-2" | 24'-10" | 23'-4" | N/A |
| | NI-70 | 27'-9" | 25'-8" | 24'-6" | N/A | 28'-5" | 26'-5" | 25'-2" | N/A |
| | NI-80 | 28'-2" | 26'-1" | 24'-10" | N/A | 28'-10" | 26'-9" | 25'-6" | N/A |
| | NI-90x | 29'-0" | 26'-10" | 25'-7" | N/A | 29'-7" | 27'-5" | 26'-2" | N/A |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.




Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing


| Depth | Series | Bare | | | | 1/2" Gypsum Ceiling | | | |
|---------|--------|-------------------|---------|---------|---------|---------------------|---------|---------|---------|
| | | On Centre Spacing | | | | On Centre Spacing | | | |
| | | 12" | 16" | 19.2" | 24" | 12" | 16" | 19.2" | 24" |
| 9-1/2" | NI-20 | 15'-7" | 14'-2" | 13'-4" | 12'-4" | 15'-7" | 14'-2" | 13'-4" | 12'-4" |
| | NI-40x | 17'-0" | 16'-0" | 15'-1" | 13'-11" | 17'-5" | 16'-1" | 15'-1" | 13'-11" |
| | NI-60 | 17'-2" | 16'-2" | 15'-5" | 14'-3" | 17'-6" | 16'-5" | 15'-5" | 14'-3" |
| | NI-70 | 18'-0" | 16'-11" | 16'-3" | 15'-6" | 18'-5" | 17'-3" | 16'-7" | 15'-6" |
| | NI-80 | 18'-3" | 17'-1" | 16'-5" | 15'-9" | 18'-8" | 17'-5" | 16'-9" | 15'-10" |
| 11-7/8" | NI-20 | 17'-10" | 16'-10" | 16'-0" | 14'-10" | 18'-6" | 17'-1" | 16'-0" | 14'-10" |
| | NI-40x | 19'-4" | 17'-11" | 17'-3" | 15'-10" | 19'-11" | 18'-6" | 17'-9" | 15'-10" |
| | NI-60 | 19'-7" | 18'-2" | 17'-5" | 16'-9" | 20'-2" | 18'-9" | 17'-11" | 17'-1" |
| | NI-70 | 20'-9" | 19'-2" | 18'-3" | 17'-5" | 21'-4" | 19'-9" | 18'-10" | 17'-10" |
| | NI-80 | 21'-1" | 19'-5" | 18'-6" | 17'-7" | 21'-7" | 20'-0" | 19'-0" | 18'-0" |
| 14" | NI-90x | 21'-8" | 20'-0" | 19'-1" | 18'-0" | 22'-2" | 20'-6" | 19'-6" | 18'-6" |
| | NI-40x | 21'-5" | 19'-10" | 18'-11" | 17'-5" | 22'-1" | 20'-6" | 19'-6" | 17'-5" |
| | NI-60 | 21'-10" | 20'-2" | 19'-3" | 18'-2" | 22'-5" | 20'-10" | 19'-11" | 18'-10" |
| | NI-70 | 23'-0" | 21'-3" | 20'-3" | 19'-2" | 23'-8" | 21'-11" | 20'-10" | 19'-9" |
| | NI-80 | 23'-5" | 21'-7" | 20'-7" | 19'-5" | 24'-0" | 22'-3" | 21'-2" | 20'-0" |
| 16" | NI-90x | 24'-1" | 22'-3" | 21'-2" | 20'-0" | 24'-8" | 22'-10" | 21'-9" | 20'-7" |
| | NI-60 | 23'-9" | 22'-0" | 20'-11" | 19'-10" | 24'-6" | 22'-9" | 21'-8" | 20'-6" |
| | NI-70 | 25'-1" | 23'-2" | 22'-0" | 20'-10" | 25'-9" | 23'-10" | 22'-9" | 21'-6" |
| | NI-80 | 25'-6" | 23'-6" | 22'-4" | 21'-2" | 26'-1" | 24'-2" | 23'-1" | 21'-10" |
| | NI-90x | 26'-4" | 24'-3" | 23'-1" | 21'-10" | 26'-11" | 24'-11" | 23'-8" | 22'-5" |

| Depth | Series | Mid-Span Blocking | | | | Mid-Span Blocking and 1/2" Gypsum Ceiling | | | |
|---------|--------|-------------------|---------|--------|---------|---|---------|---------|---------|
| | | On Centre Spacing | | | | On Centre Spacing | | | |
| | | 12" | 16" | 19.2" | 24" | 12" | 16" | 19.2" | 24" |
| 9-1/2" | NI-20 | 15'-7" | 14'-2" | 13'-4" | 12'-4" | 15'-7" | 14'-2" | 13'-4" | 12'-4" |
| | NI-40x | 17'-9" | 16'-1" | 15'-1" | 13'-11" | 17'-9" | 16'-1" | 15'-1" | 13'-11" |
| | NI-60 | 18'-1" | 16'-5" | 15'-5" | 14'-3" | 18'-1" | 16'-5" | 15'-5" | 14'-3" |
| | NI-70 | 19'-10" | 17'-11" | 16'-9" | 15'-6" | 19'-10" | 17'-11" | 16'-9" | 15'-6" |
| | NI-80 | 20'-2" | 18'-3" | 17'-1" | 15'-10" | 20'-2" | 18'-3" | 17'-1" | 15'-10" |
| 11-7/8" | NI-20 | 18'-10" | 17'-1" | 16'-0" | 14'-10" | 18'-10" | 17'-1" | 16'-0" | 14'-10" |
| | NI-40x | 21'-3" | 19'-3" | 17'-9" | 15'-10" | 21'-3" | 19'-3" | 17'-9" | 15'-10" |
| | NI-60 | 21'-9" | 19'-8" | 18'-5" | 17'-1" | 21'-9" | 19'-8" | 18'-5" | 17'-1" |
| | NI-70 | 23'-4" | 21'-5" | 20'-1" | 18'-6" | 23'-8" | 21'-5" | 20'-1" | 18'-6" |
| | NI-80 | 23'-7" | 21'-10" | 20'-5" | 18'-11" | 24'-1" | 21'-10" | 20'-5" | 18'-11" |
| 14" | NI-90x | 24'-3" | 22'-6" | 21'-3" | 19'-7" | 24'-8" | 22'-7" | 21'-3" | 19'-7" |
| | NI-40x | 24'-2" | 21'-5" | 19'-6" | 17'-5" | 24'-2" | 21'-5" | 19'-6" | 17'-5" |
| | NI-60 | 24'-9" | 22'-5" | 21'-0" | 19'-6" | 24'-9" | 22'-5" | 21'-0" | 19'-6" |
| | NI-70 | 26'-1" | 24'-3" | 22'-9" | 21'-0" | 26'-8" | 24'-3" | 22'-9" | 21'-0" |
| | NI-80 | 26'-6" | 24'-7" | 23'-3" | 21'-6" | 27'-1" | 24'-10" | 23'-3" | 21'-6" |
| 16" | NI-90x | 27'-3" | 25'-4" | 24'-1" | 22'-4" | 27'-9" | 25'-10" | 24'-3" | 22'-4" |
| | NI-60 | 27'-3" | 24'-11" | 23'-5" | 21'-7" | 27'-6" | 24'-11" | 23'-5" | 21'-7" |
| | NI-70 | 28'-8" | 26'-8" | 25'-3" | 23'-4" | 29'-3" | 26'-11" | 25'-3" | 23'-4" |
| | NI-80 | 29'-1" | 27'-0" | 25'-9" | 23'-10" | 29'-8" | 27'-6" | 25'-10" | 23'-10" |
| | NI-90x | 29'-11" | 27'-10" | 26'-6" | 24'-10" | 30'-6" | 28'-5" | 26'-11" | 24'-10" |


- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

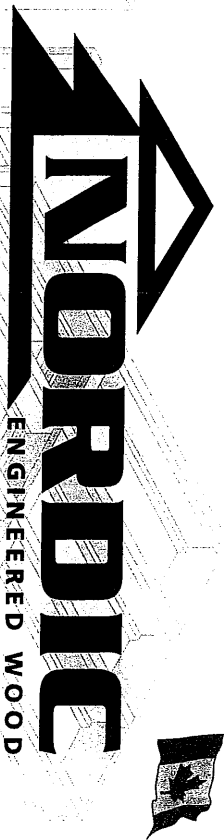

INSTALLATION GUIDE FOR RESIDENTIAL FLOORS



Distributed by:

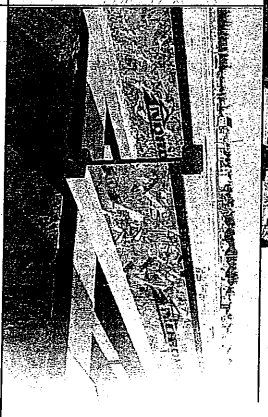

N-C301 / November 2014

SAFETY AND CONSTRUCTION PRECAUTIONS

WARNING

I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

Avoid Accidents by Following these Important Guidelines:

1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stock building materials over beams or walls only.
5. Never install a damaged I-joist.



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.





Never stack building materials over unsheathed I-joists. Once sheathed, do not over-stress I-joist with concentrated loads from building materials.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stock, and handle I-joists vertically and level only.
3. Always stock and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
 - Pick I-joists in bundles as shipped by the supplier.
 - Orient the bundles so that the webs of the I-joists are vertical.
 - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.



MAXIMUM FLOOR SPANS

1. Maximum **clear** spans applicable to simple-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CGS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit States Design per CAN/CSA O86-09 Standard, and NBC 2010.
7. SI units conversion: 1 inch = 25.4 mm
1 foot = 0.305 m

WEB STIFFENERS

RECOMMENDATIONS:

- A **bearing stiffener** is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found of the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.
- A **bearing stiffener** is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A **load stiffener** is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.


SI units conversion: 1 inch = 25.4 mm

MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS SIMPLE AND MULTIPLE SPANS

| Joist Depth | Joist Series | Simple spans On centre spacing | | | | Multiple spans On centre spacing | | | |
|----------------|-----------------|-----------------------------------|-------|-------|-------|-------------------------------------|-------|-------|-------|
| | | 12" | 16" | 19.2 | 24" | 12" | 16" | 19.2" | 24" |
| 12" | NI-20 | 14.5' | 14.2' | 13.9' | 13.6' | 6.8' | 6.5' | 6.2' | 5.9' |
| 12" | NI-24 | 17.1' | 16.7' | 16.4' | 16.1' | 8.2' | 7.9' | 7.6' | 7.3' |
| 12" | NI-28 | 19.7' | 19.3' | 19.0' | 18.7' | 9.6' | 9.3' | 9.0' | 8.7' |
| 12" | NI-32 | 22.3' | 21.9' | 21.6' | 21.3' | 11.0' | 10.7' | 10.4' | 10.1' |
| 12" | NI-36 | 24.9' | 24.5' | 24.2' | 23.9' | 12.4' | 12.1' | 11.8' | 11.5' |
| 12" | NI-40 | 27.5' | 27.1' | 26.8' | 26.5' | 13.8' | 13.5' | 13.2' | 12.9' |
| 16" | NI-20 | 18.1' | 17.7' | 17.4' | 17.1' | 8.8' | 8.5' | 8.2' | 7.9' |
| 16" | NI-24 | 21.7' | 21.3' | 21.0' | 20.7' | 10.2' | 9.9' | 9.6' | 9.3' |
| 16" | NI-28 | 24.3' | 23.9' | 23.6' | 23.3' | 11.6' | 11.3' | 11.0' | 10.7' |
| 16" | NI-32 | 26.9' | 26.5' | 26.2' | 25.9' | 13.0' | 12.7' | 12.4' | 12.1' |
| 16" | NI-36 | 29.5' | 29.1' | 28.8' | 28.5' | 14.4' | 14.1' | 13.8' | 13.5' |
| 16" | NI-40 | 32.1' | 31.7' | 31.4' | 31.1' | 15.8' | 15.5' | 15.2' | 14.9' |
| 19.2" | NI-20 | 20.5' | 20.1' | 19.8' | 19.5' | 10.6' | 10.3' | 10.0' | 9.7' |
| 19.2" | NI-24 | 24.1' | 23.7' | 23.4' | 23.1' | 12.0' | 11.7' | 11.4' | 11.1' |
| 19.2" | NI-28 | 26.7' | 26.3' | 26.0' | 25.7' | 13.4' | 13.1' | 12.8' | 12.5' |
| 19.2" | NI-32 | 29.3' | 28.9' | 28.6' | 28.3' | 14.8' | 14.5' | 14.2' | 13.9' |
| 19.2" | NI-36 | 31.9' | 31.5' | 31.2' | 30.9' | 16.2' | 15.9' | 15.6' | 15.3' |
| 19.2" | NI-40 | 34.5' | 34.1' | 33.8' | 33.5' | 17.6' | 17.3' | 17.0' | 16.7' |
| 24" | NI-20 | 26.1' | 25.7' | 25.4' | 25.1' | 12.4' | 12.1' | 11.8' | 11.5' |
| 24" | NI-24 | 30.7' | 30.3' | 30.0' | 29.7' | 14.8' | 14.5' | 14.2' | 13.9' |
| 24" | NI-28 | 33.3' | 32.9' | 32.6' | 32.3' | 16.2' | 15.9' | 15.6' | 15.3' |
| 24" | NI-32 | 35.9' | 35.5' | 35.2' | 34.9' | 17.6' | 17.3' | 17.0' | 16.7' |
| 24" | NI-36 | 38.5' | 38.1' | 37.8' | 37.5' | 19.0' | 18.7' | 18.4' | 18.1' |
| 24" | NI-40 | 41.1' | 40.7' | 40.4' | 40.1' | 20.4' | 20.1' | 19.8' | 19.5' |

CCMC EVALUATION REPORT 13032-R


FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

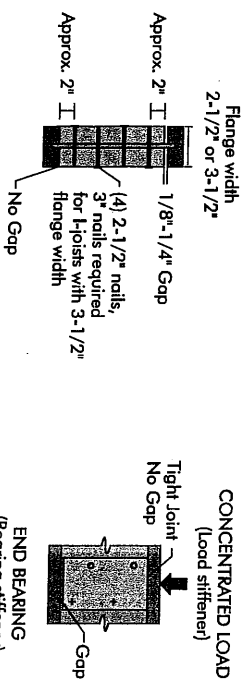

See table below for web stiffener size requirements


STIFFENER SIZE REQUIREMENTS

| Flange Width | Web Stiffener Size Each Side of Web |
|--------------|-------------------------------------|
| 2-1/2" | 1" x 2-5/16" minimum width |
| 3-1/2" | 1-1/2" x 2-5/16" minimum width |



I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the I-joist.

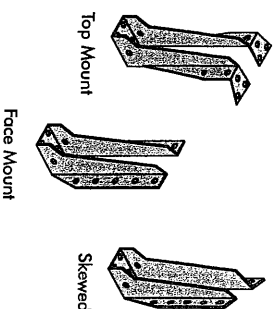

NORDIC I-JOIST SERIES

| S-RF No.2 | 1950f MSR | 2100f MSR | 1950f MSR | 2100f MSR | 2400f MSR | NPG Lumber |
|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|--------------------|
| 33 pieces per unit | 33 pieces per unit | 33 pieces per unit | 23 pieces per unit | 23 pieces per unit | 23 pieces per unit | 23 pieces per unit |
| NI-20 | NI-24 | NI-28 | NI-32 | NI-36 | NI-40 | NI-48 |
| 1-1/2" x 2-5/16" | 1-1/2" x 2-5/16" | 1-1/2" x 2-5/16" | 1-1/2" x 2-5/16" | 1-1/2" x 2-5/16" | 1-1/2" x 2-5/16" | 1-1/2" x 2-5/16" |
| 9-1/2" | 9-1/2" | 9-1/2" | 9-1/2" | 9-1/2" | 9-1/2" | 9-1/2" |
| 11-7/8" | 11-7/8" | 11-7/8" | 11-7/8" | 11-7/8" | 11-7/8" | 11-7/8" |
| 14" | 14" | 14" | 14" | 14" | 14" | 14" |
| 16" | 16" | 16" | 16" | 16" | 16" | 16" |
| 18" | 18" | 18" | 18" | 18" | 18" | 18" |
| 20" | 20" | 20" | 20" | 20" | 20" | 20" |
| 22" | 22" | 22" | 22" | 22" | 22" | 22" |
| 24" | 24" | 24" | 24" | 24" | 24" | 24" |
| 26" | 26" | 26" | 26" | 26" | 26" | 26" |
| 28" | 28" | 28" | 28" | 28" | 28" | 28" |
| 30" | 30" | 30" | 30" | 30" | 30" | 30" |
| 32" | 32" | 32" | 32" | 32" | 32" | 32" |
| 34" | 34" | 34" | 34" | 34" | 34" | 34" |
| 36" | 36" | 36" | 36" | 36" | 36" | 36" |
| 38" | 38" | 38" | 38" | 38" | 38" | 38" |
| 40" | 40" | 40" | 40" | 40" | 40" | 40" |
| 42" | 42" | 42" | 42" | 42" | 42" | 42" |
| 44" | 44" | 44" | 44" | 44" | 44" | 44" |
| 46" | 46" | 46" | 46" | 46" | 46" | 46" |
| 48" | 48" | 48" | 48" | 48" | 48" | 48" |
| 50" | 50" | 50" | 50" | 50" | 50" | 50" |
| 52" | 52" | 52" | 52" | 52" | 52" | 52" |
| 54" | 54" | 54" | 54" | 54" | 54" | 54" |
| 56" | 56" | 56" | 56" | 56" | 56" | 56" |
| 58" | 58" | 58" | 58" | 58" | 58" | 58" |
| 60" | 60" | 60" | 60" | 60" | 60" | 60" |
| 62" | 62" | 62" | 62" | 62" | 62" | 62" |
| 64" | 64" | 64" | 64" | 64" | 64" | 64" |
| 66" | 66" | 66" | 66" | 66" | 66" | 66" |
| 68" | 68" | 68" | 68" | 68" | 68" | 68" |
| 70" | 70" | 70" | 70" | 70" | 70" | 70" |
| 72" | 72" | 72" | 72" | 72" | 72" | 72" |
| 74" | 74" | 74" | 74" | 74" | 74" | 74" |
| 76" | 76" | 76" | 76" | 76" | 76" | 76" |
| 78" | 78" | 78" | 78" | 78" | 78" | 78" |
| 80" | 80" | 80" | 80" | 80" | 80" | 80" |
| 82" | 82" | 82" | 82" | 82" | 82" | 82" |
| 84" | 84" | 84" | 84" | 84" | 84" | 84" |
| 86" | 86" | 86" | 86" | 86" | 86" | 86" |
| 88" | 88" | 88" | 88" | 88" | 88" | 88" |
| 90" | 90" | 90" | 90" | 90" | 90" | 90" |
| 92" | 92" | 92" | 92" | 92" | 92" | 92" |
| 94" | 94" | 94" | 94" | 94" | 94" | 94" |
| 96" | 96" | 96" | 96" | 96" | 96" | 96" |
| 98" | 98" | 98" | 98" | 98" | 98" | 98" |
| 100" | 100" | 100" | 100" | 100" | 100" | 100" |

Chantiers Chibougamau Ltd. harvests its own trees, which enables Nordic products to adhere to strict quality control procedures through every phase of the manufacturing process. Every phase of the operation, from forest to the finished product, reflects our commitment to quality.

Nordic Engineered Wood I-joists use only finger-jointed black spruce lumber in their flanges, ensuring consistent quality, superior strength, and longer span carrying capacity.

2015-04-16


INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact your supplier.
2. Except for cutting to length, I-joist flanges should **never** be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple spans must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge **may never** be used as blocking or rim boards. I-joist blocking panels or other engineered wood products – such as rim board – must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.





2015-04-16

FIGURE 1
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

Some framing requirements such as erection bracing and blocking panels have been omitted for clarity.

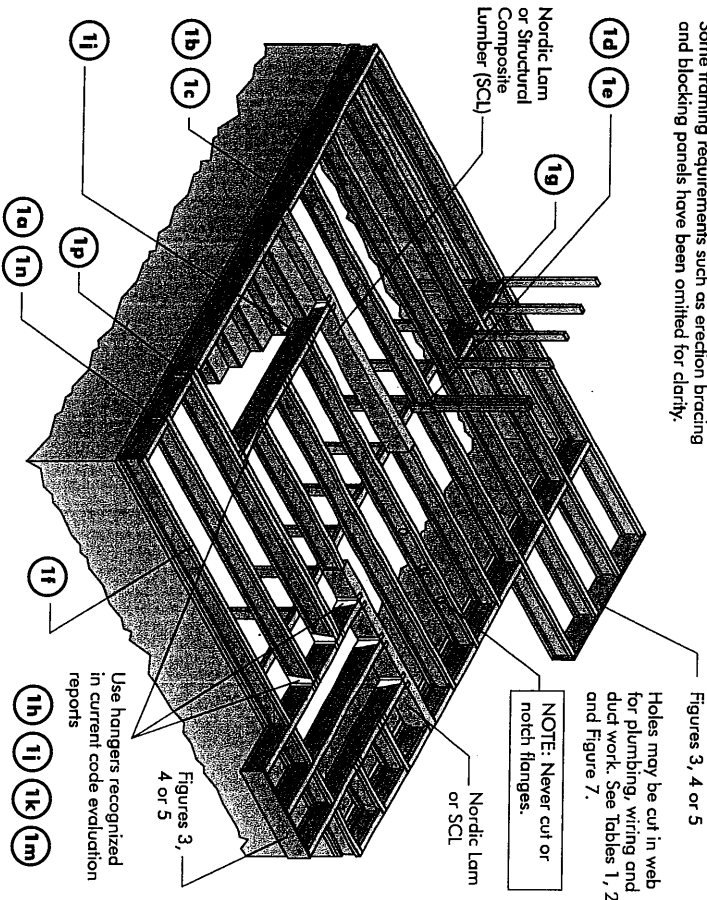

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

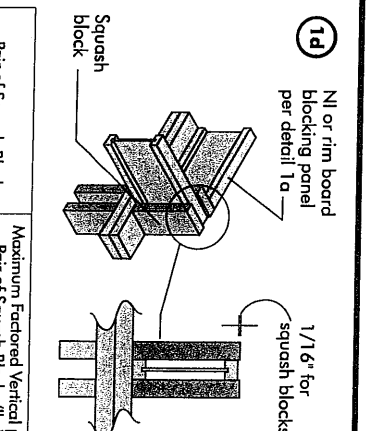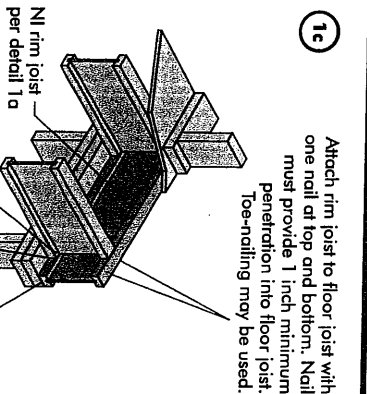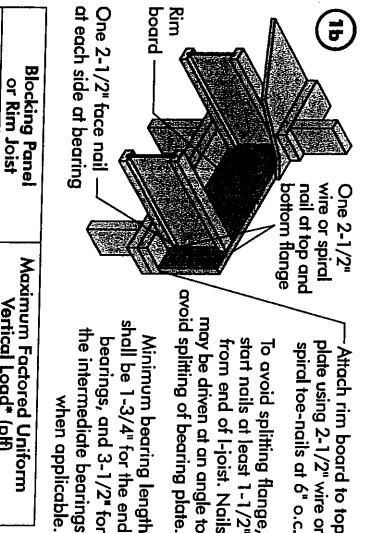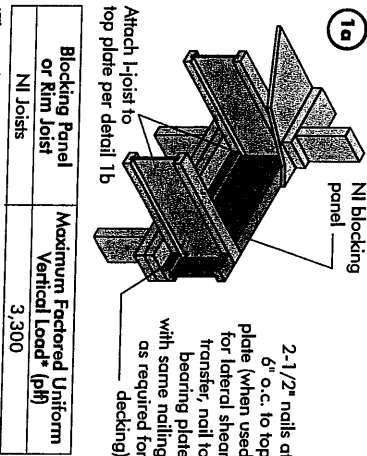

| Blocking Panel or Rim Joist | Maximum Factored Uniform Vertical Load* (plf) |
|-----------------------------|---|
| NI Joists | 3,300 |

| Blocking Panel or Rim Joist | Maximum Factored Uniform Vertical Load* (plf) |
|-----------------------------|---|
| 1-1/8" Rim Board Plus | 8,090 |

| Pair of Squash Blocks | Maximum Factored Vertical per Pair of Squash Blocks (lbs) |
|-----------------------|---|
| 2x Lumber | 3-1/2" wide 5,500 5-1/2" wide 8,500 |
| 1-1/8" Rim Board Plus | 4,300 6,600 |









| Pair of Squash Blocks | Maximum Factored Vertical per Pair of Squash Blocks (lbs) |
|-----------------------|---|
| 2x Lumber | 3-1/2" wide 5,500 5-1/2" wide 8,500 |
| 1-1/8" Rim Board Plus | 4,300 6,600 |

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

Attach I-joist per detail 1a
Minimum 1-3/4" bearing required

Provide lateral bracing per detail 1a, 1b, or 1c

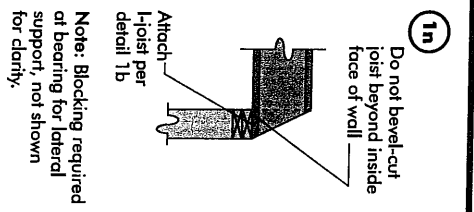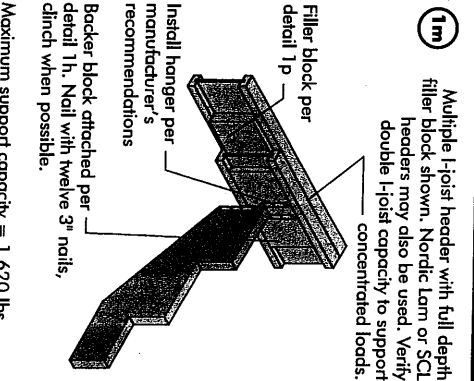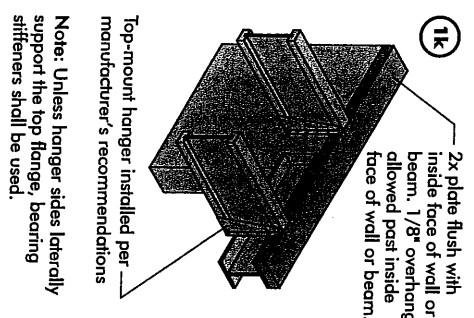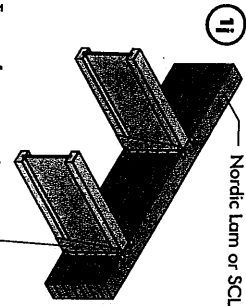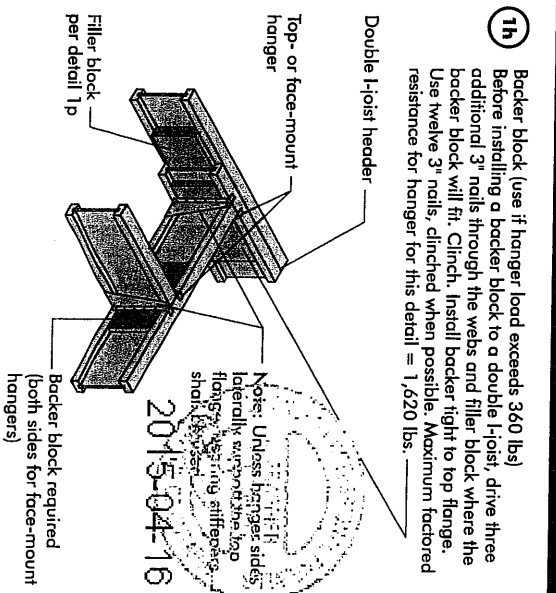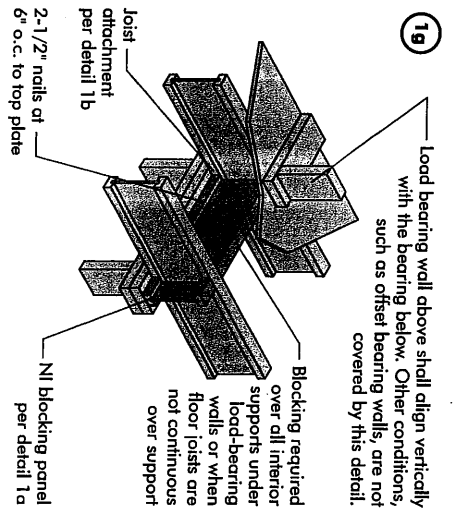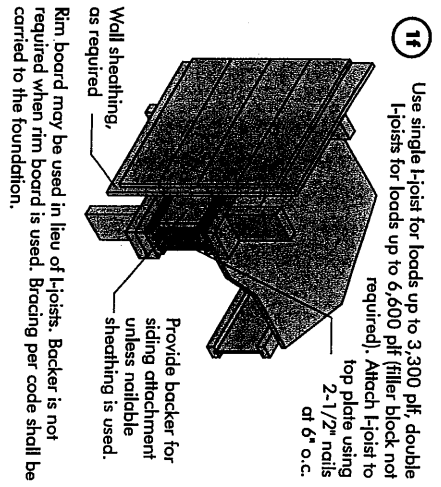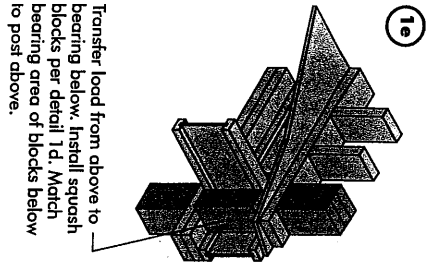

BACKER BLOCKS (Blocks must be long enough to permit required nailing without splitting)

| Flange Width | Material Thickness Required* | Minimum Depth** |
|--------------|------------------------------|-----------------|
| 2-1/2" | 1" | 5-1/2" |
| 3-1/2" | 1-1/2" | 7-1/4" |

* Minimum grade for backer block material shall be S-P-F No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-Q325 or CAN/CSA-Q437 Standard.
 ** For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

top- or face-mount hanger installed per manufacturer's recommendations

For nailing schedules for multiple beams, see the manufacturer's recommendations.

Note: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

Top-mount hanger installed per manufacturer's recommendations

Note: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

Filler block per detail 1p


Install hanger per manufacturer's recommendations

Backer block attached per detail 1h. Nail with twelve 3" nails, clinch when possible.

Maximum support capacity = 1,620 lbs.

Attach I-joist per detail 1b

Note: Blocking required at bearing for lateral support, not shown for clarity.


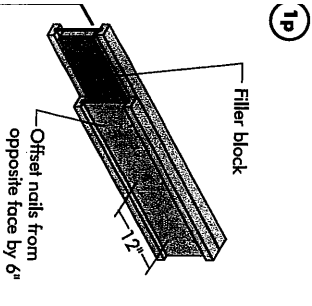


Notes:

1. Support back of I-joist web during nailing to prevent damage to web/flange connection.
2. Leave a 1/8 to 1/4-inch gap between top of filler block and bottom of top I-joist flange.
3. Filler block is required between joists for full length of span.
4. Nail joists together with two rows of 3" nail at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
5. The maximum factored load that may be applied to one side of the double joist using this detail is 860 lbf/ft. Verify double I-joist capacity.

FILLER BLOCK REQUIREMENTS FOR DOUBLE I-JOIST CONSTRUCTION

| Flange Size | Joist Depth | Filler Block Size |
|-----------------|-------------|-------------------|
| 2-1/2" x 1-1/2" | 9-1/2" | 2-1/8" x 6" |
| 2-1/2" x 1-1/2" | 14" | 2-1/8" x 8" |
| 3-1/2" x 1-1/2" | 11-7/8" | 2-1/8" x 10" |
| 3-1/2" x 1-1/2" | 14" | 3" x 12" |
| 3-1/2" x 2" | 9-1/2" | 3" x 6" |
| 3-1/2" x 2" | 11-7/8" | 3" x 8" |
| 3-1/2" x 2" | 14" | 3" x 10" |
| 3-1/2" x 2" | 16" | 3" x 12" |
| 3-1/2" x 2" | 11-7/8" | 3" x 7" |
| 3-1/2" x 2" | 14" | 3" x 9" |
| 3-1/2" x 2" | 16" | 3" x 11" |

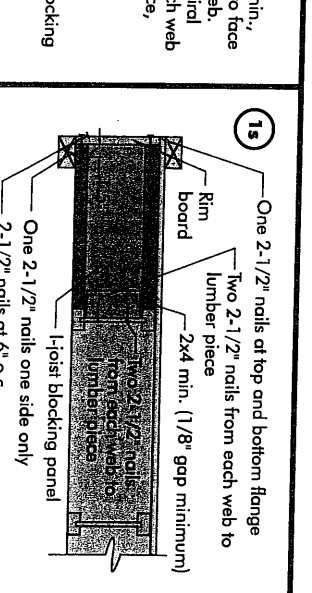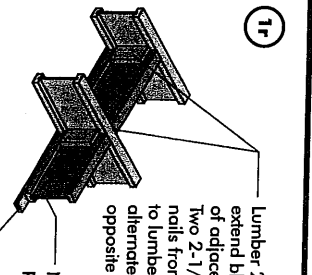

1/8" to 1/4" gap between top flange and filler block

Offset nails from opposite face by 6"


Optional: Minimum 1x4 inch strip applied to underside of joist at blocking line or 1/2 inch minimum gypsum ceiling attached to underside of joists.

NI blocking panel


Notes:

- In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.


3a I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

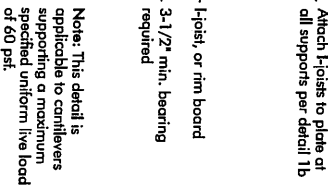


Full depth packer block with 1/8" gap between block and top flange of I-joist.
See detail 1h. Nail with 2 rows of 3" nails at 6" o.c. and clinch.

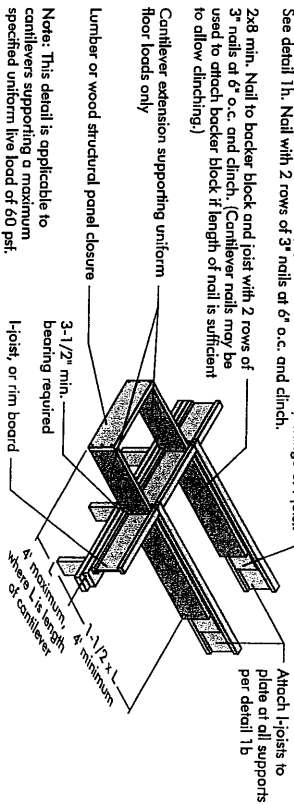

Method 1 — SHEATHING REINFORCEMENT ONE SIDE

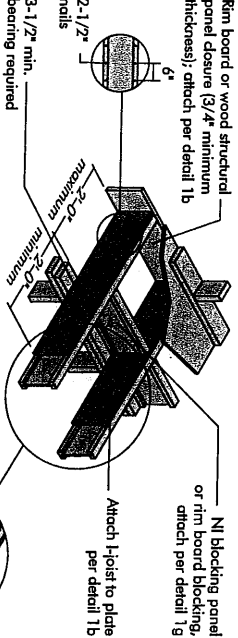


Use same installation as Method 1 but reinforce both sides of I-joist with sheathing.



Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

wood structural

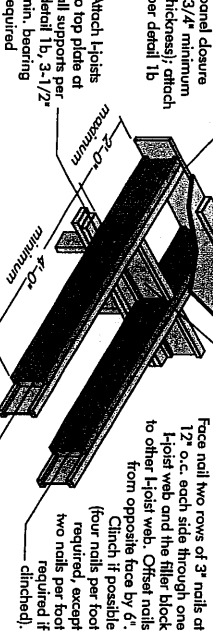

See table below for NI reinforcement requirements at cantilever.

Roof truss — span



For hip roofs with the jack trusses running parallel to the cantilevered floor joists the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

JOIST

ROOF

ROOF LOADING (UNFACTORED)


[illegible]

1. $N = \text{No reinforcement required.}$
1. $N = \text{No reinforcement required.}$
1. $N = \text{N reinforced with 3/4" wood structural panel on one side only.}$
2. $N = \text{N reinforced with 3/4" wood structural panel on both sides, or double 1x6's.}$
- X. $= \text{Try a deeper joist or closer spacing.}$
2. Maximum design load shall be: 15 psf roof dead load, 55 psf floor dead load, and 80 psf wall load. Wall load is based on 3'-0" maximum wall window or door openings.
- For larger openings, or multiple 3'-0" width openings, spaced less than 6'-0" o.c., additional joists between the opening's cripple studs must be required.
3. Table specifies a joist 12" to 24" o.c. that meet the floor requirements for a design live load of 40 psf and dead load of 15 psf, and a live load reduction limit of 1/4/60. Use 12" o.c. requirements for larger spacing.
4. For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam.
- When the roof is formed using a ridge board, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
5. Conditioned joists supporting girdler trusses


or root beams may require additional reinforcing.

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS.

- FIGURE 7**
FIELD-CUT HOLE LOCATOR



Knockouts are prescored holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on centre along the length of the I-joist. Where possible, it is preferable to use knockouts instead of field-cut holes.



For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

[illegible]

1. Above table may be used for joist spacing of 24 inches on centre or less.
2. Hole location distance is measured from inside face of supports to centre of hole
3. Distances in this chart are based on uniformly loaded joists.

The above table is based on the I-joists used at their maximum span. If the I-joists are placed at less than their full maximum span, the minimum distance from the centerline of the hole to the face of any support (D) as given above may be reduced as follows:

Where:

| | | |
|----------------------|---|---|
| D_{reduced} | = | 1 |
| L_{actual} | = | 1 |
| SAF | = | 1 |
| D | = | 1 |

Where:

D_{reduced} = Distance from the inside face of any support to centre of hole, reduced for less-than-maximum distance shall not be less than 6 inches from the face of the support to edge of the hole.

L_{actual} = The actual measured span distance between the inside faces of supports (ft).

SAF = Span Adjustment Factor given in this table.

D = The minimum distance from the inside face of any support to centre of hole from this table if L_{actual} is greater than 1, use 1 in the above calculation for L_{actual} .

SAF_{reduced}

Maximum Fiber Spacing:
 1.5 in. (38 mm)
 Maximum (ft): The reduced
 2015-04-16

TABLE 2
DUCT CHASE OPENING SIZES AND LOCATIONS

| Joist Depth | Joist Series | Minimum distance from inside face of any support to centre of opening (ft-in.) | | | | | | | | | | |
|----------------|-----------------|--|-----|-----|-----|-----|-----|-----|-----|-----|--|--|
| | | 8 | 10 | 12 | 14 | 16 | 18 | 20 | 22 | 24 | | |
| 10 | 101 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 102 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 103 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 104 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 105 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 106 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 107 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 108 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 109 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 110 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| 12 | 121 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 122 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 123 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 124 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 125 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 126 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 127 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 128 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 129 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 130 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| 14 | 141 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 142 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 143 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 144 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 145 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 146 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 147 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 148 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 149 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 150 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| 16 | 161 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 162 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 163 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 164 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 165 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 166 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 167 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 168 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 169 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 170 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| 18 | 181 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 182 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 183 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 184 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 185 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 186 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 187 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 188 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 189 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 190 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| 20 | 201 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 202 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 203 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 204 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 205 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 206 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 207 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 208 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 209 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 210 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| 22 | 221 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 222 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 223 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 224 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 225 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 226 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 227 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 228 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 229 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 230 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| 24 | 241 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 242 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 243 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 244 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 245 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 246 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 247 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 248 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 249 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |
| | 250 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | 4.0 | | |


1. Above table may be used for 1-foot spacing of 24 inches on centre or less.
2. Duct chase opening location distance is measured from inside face of supports to centre of opening.
3. The above table is based on simple-span joists only. For other applications, contact your local distributor.
4. Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of $L/480$. For other applications, contact your local distributor.

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

5d SHEATHING REINFORCEMENT

Provide full depth blocking between joists over support (not shown)

Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

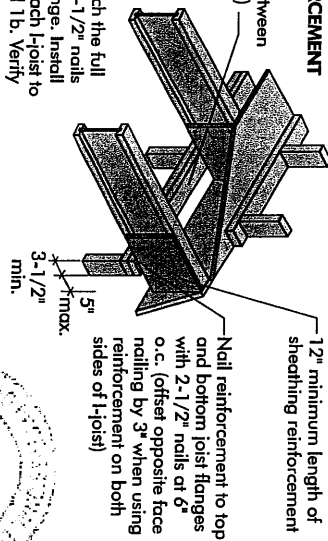


5b SET-BACK DETAIL

Rim board or wood structural panel closure (3/4" minimum thickness), attach per detail 1b.


Notes:

- Provide full depth blocking between joists over support (not shown for clarity)
- Attach I-joist to plate at all supports per detail 1b.
- 3-1/2" minimum I-joist bearing required.

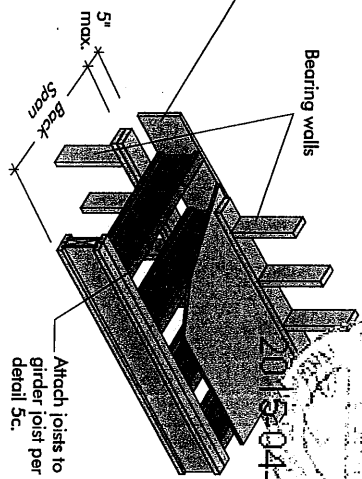


5c SET-BACK CONNECTION

Vertical solid sawn blocks (2x6 S-P-F No. 2 or better) nailed through joist web and web of girder using 2-1/2" nails.

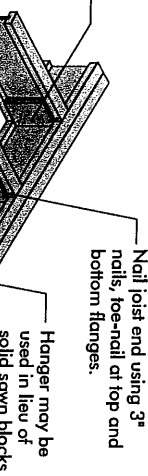

- Notes:
- Verify girder joist capacity if the back span exceeds the joist spacing.
 - Attach double I-joist per detail 1p, if required.

FIGURE 5 (continued)

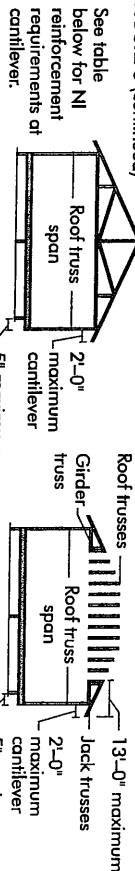

For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

| JOIST DEPTH (in.) | ROOF TRUSS SPAN (ft) | ROOF LOADING (UNFACTORED) | | | | LL = 50 psf, DL = 15 psf | | | |
|-------------------|----------------------|---------------------------|----|------|----|--------------------------|----|------|----|
| | | LL = 30 psf, DL = 15 psf | | | | JOIST SPACING (in.) | | | |
| | | 12 | 16 | 19.2 | 24 | 12 | 16 | 19.2 | 24 |
| 2-1/2" | 26 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 28 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 30 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 32 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 34 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 36 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 38 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 3-1/2" | 26 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 28 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 30 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 32 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 34 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 36 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 38 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 4" | 26 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 28 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 30 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 32 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 34 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 36 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 38 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 4-1/2" | 26 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 28 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 30 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 32 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 34 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 36 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 38 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 5" | 26 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 28 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 30 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 32 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 34 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 36 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 38 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 6" | 26 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 28 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 30 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 32 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 34 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 36 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 38 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| 8" | 26 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 28 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 30 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 32 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 34 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 36 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |
| | 38 | 1 | 1 | 1 | 1 | 1 | 1 | 1 | 1 |

1. N = No reinforcement required.
2. N = NI reinforced with 3/4" wood structural panel on one side only.
3. NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
4. Try a deeper joist or closer spacing.
5. Maximum design load shall be: 15 psf roof dead load, 55 psf floor total load, and 80 psf wall load. Wall load is based on 3'-0" maximum width window or door openings.
6. For larger openings, or multiple 3'-0" width openings spaced less than 6'-0" o.c., additional joists beneath the opening's cripple studs may be required.
7. Table applies to joists 12" to 24" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of 1/480. Use 12" o.c. requirements for lesser spacing.
8. For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam.
9. When the roof is framed using a ridge beam, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
10. Cantilevered joists supporting girder trusses or roof beams may require additional reinforcing.

INSTALLING THE GLUED FLOOR SYSTEM

1. Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
2. Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
3. Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
4. Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when topped into place with a block and sledgehammer.
5. Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
6. Apply two lines of glue on I-joists where panel ends butt to assure proper gluing of each end.
7. After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) than used on I-joist flanges.
8. Top the second row of panels into place, using a block to protect groove edges.
9. Stagger end joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including T&G edges, is recommended. (Use a spacer tool or an 2-1/2" common nail to assure accurate and consistent spacing.)
10. **Complete all nailing of each panel before glue sets.** Check the manufacturer's recommendations for cure time. (Warm weather accelerates glue setting.) Use 2" ring- or screw-shank nails for panels 3/4-inch thick or less, and 2-1/2" ring- or screw-shank nails for thicker panels. Space nails per the table below. Closer nail spacing may be required by some codes, or for diaphragm construction. The finished deck can be walked on right away and will carry construction loads without damage to the glue bond.

FASTENERS FOR SHEATHING AND SUBFLOORING(1)

| Maximum Joist Spacing (in.) | | Minimum Panel Thickness (in.) | | Nail Size and Type | | Maximum Spacing of Fasteners | |
|-----------------------------|--|-------------------------------|--|-----------------------------|-----------------------------|------------------------------|------------------------|
| | | | | Common Wire or Spiral Nails | Ring Thread Nails or Screws | Staples | Edges Intern. Supports |
| 16 | | 5/8 | | 2" | 1-3/4" | 2" | 6" |
| 20 | | 5/8 | | 2" | 1-3/4" | 2" | 6" |
| 24 | | 3/4 | | 2" | 1-3/4" | 2" | 6" |

1. Fasteners of sheathing and subflooring shall conform to the above table.
2. Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
3. Flooring screws shall not be less than 1/8-inch in diameter.
4. Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
5. Use only adhesives conforming to CAN/CGSB-71.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues; check with panel manufacturer.


Ref.: NRC-CNRC, National Building Code of Canada 2010, Table 9.23.3.5.

IMPORTANT NOTE:


Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.

RIM BOARD INSTALLATION DETAILS


8a ATTACHMENT DETAILS WHERE RIM BOARDS ABUT

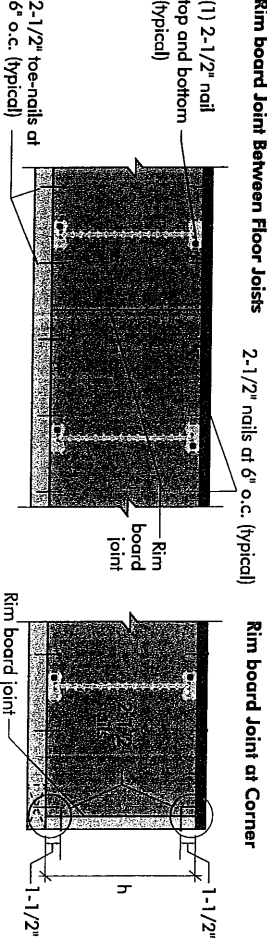

8b TOE-NAIL CONNECTION AT RIM BOARD



8c 2X LEDGER TO RIM BOARD ATTACHMENT DETAIL

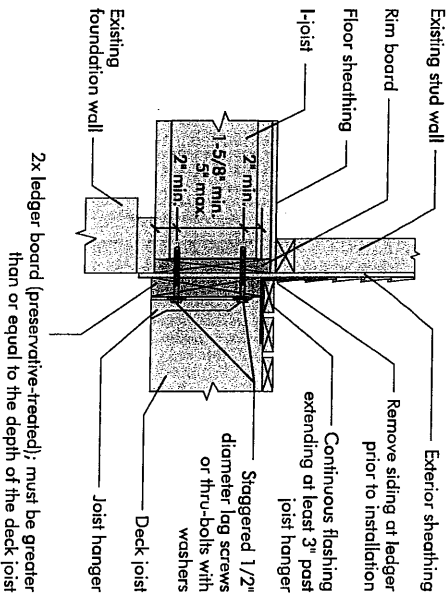


2015-04-16

PRODUCT WARRANTY

Customer Obligations: Customer guarantees that, in accordance with our specifications, Nucleo products are free from manufacturing defects in material and workmanship.

Furthermore, Customer Obligations: Customer warrants that our products, when installed in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the structure.

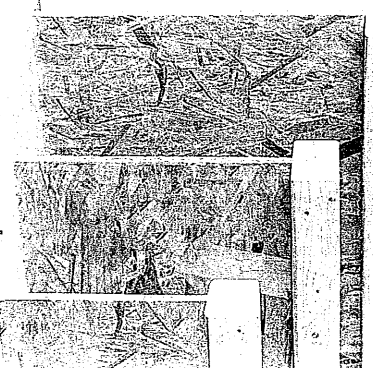


MICRO CITY ENGINEERING SERVICES INC.

TEL: (519) 287 - 2242

R.R. #1, P.O. BOX 61, GLENCOE, ONTARIO, N0L 1M0

| LVL HEADER AND CONVENTIONAL LUMBER NAILING DETAILS | | |
|---|-------------------|--------------------------------|
| DETAIL NUMBER | NUMBER OF ROWS | SPACING (INCHES o/c) "d" |
| A | 2 | 12 |
| B | 2 | 8 |
| C | 2 | 6 |
| D | 2 | 4 |
| 1A | 3 | 12 |
| 1B | 3 | 8 |
| 1C | 3 | 6 |
| 1D | 3 | 4 |
| 2A | 4 | 12 |
| 2B | 4 | 8 |
| 2C | 4 | 6 |
| 2D | 4 | 4 |
| 3A | 5 | 12 |
| 3B | 5 | 8 |
| 3C | 5 | 6 |
| 3D | 5 | 4 |
| 4A | 6 | 12 |
| 4B | 6 | 8 |
| 4C | 6 | 6 |
| 4D | 6 | 4 |

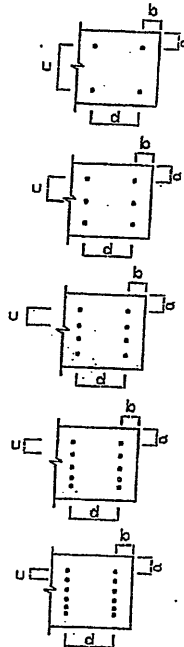

NOTES:

- (1) MINIMUM LUMBER EDGE DISTANCE "a" = 1"
- (2) MINIMUM LUMBER END DISTANCE "b" = 2"
- (3) MINIMUM NAIL ROW SPACING "c" = 2"
- (4) STAGGER NAILS "d/2" BETWEEN PLYS FOR MULTI-PLY MEMBERS (3 PLY OR MORE)
- (5) ALL NAILS ARE 3-1/2" ARDOX SPIRAL NAILS
- (6) DO **NOT** USE AIR-DRIVEN NAILS



DWG NO TAMN1001-14

STRUCTURAL

COMPONENT ONLY

TO BE USED ONLY
WITH BEAM CALCS
BEARING THE
STAMP BELOW

PROVIDE NAILING

DETAIL # X SEE

DWG #TAMN1001-14