

FROM PLAN DATED: APRIL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 2

ELEVATION: 1,3

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

#### NOTES:

REFER TO THE NORDIC  
INSTALLATION GUIDE FOR PROPER  
STORAGE AND INSTALLATION.  
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2  
S.P.F REQ'D UNDER INTERIOR  
UNIFORM LOAD BEARING WALLS.  
MULTIPLE SQUASH BLOCKS REQ'D  
UNDER CONCENTRATED LOADS. SEE  
FIGURE 1. CANTILEVERED JOISTS  
INCLUDING CANT' OVER BRICK REQ.  
I-JOIST BLOCKING ALONG BEARING  
AND RIMBOARD CLOSURE AT ENDS.  
SEE FIGURES 4 & 5 FOR  
REINFORCEMENT REQUIREMENTS.  
FOR HOLES INCLUDING DUCT  
CHASE AND FIELD CUT OPENINGS  
SEE FIGURE 7, TABLES 1 & 2.  
CERAMIC TILE APPLICATION AS PER  
O.B.C 9.30.6.

#### LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 15.0 lb/ft


TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 9/21/2017


## 1st FLOOR

## DECK

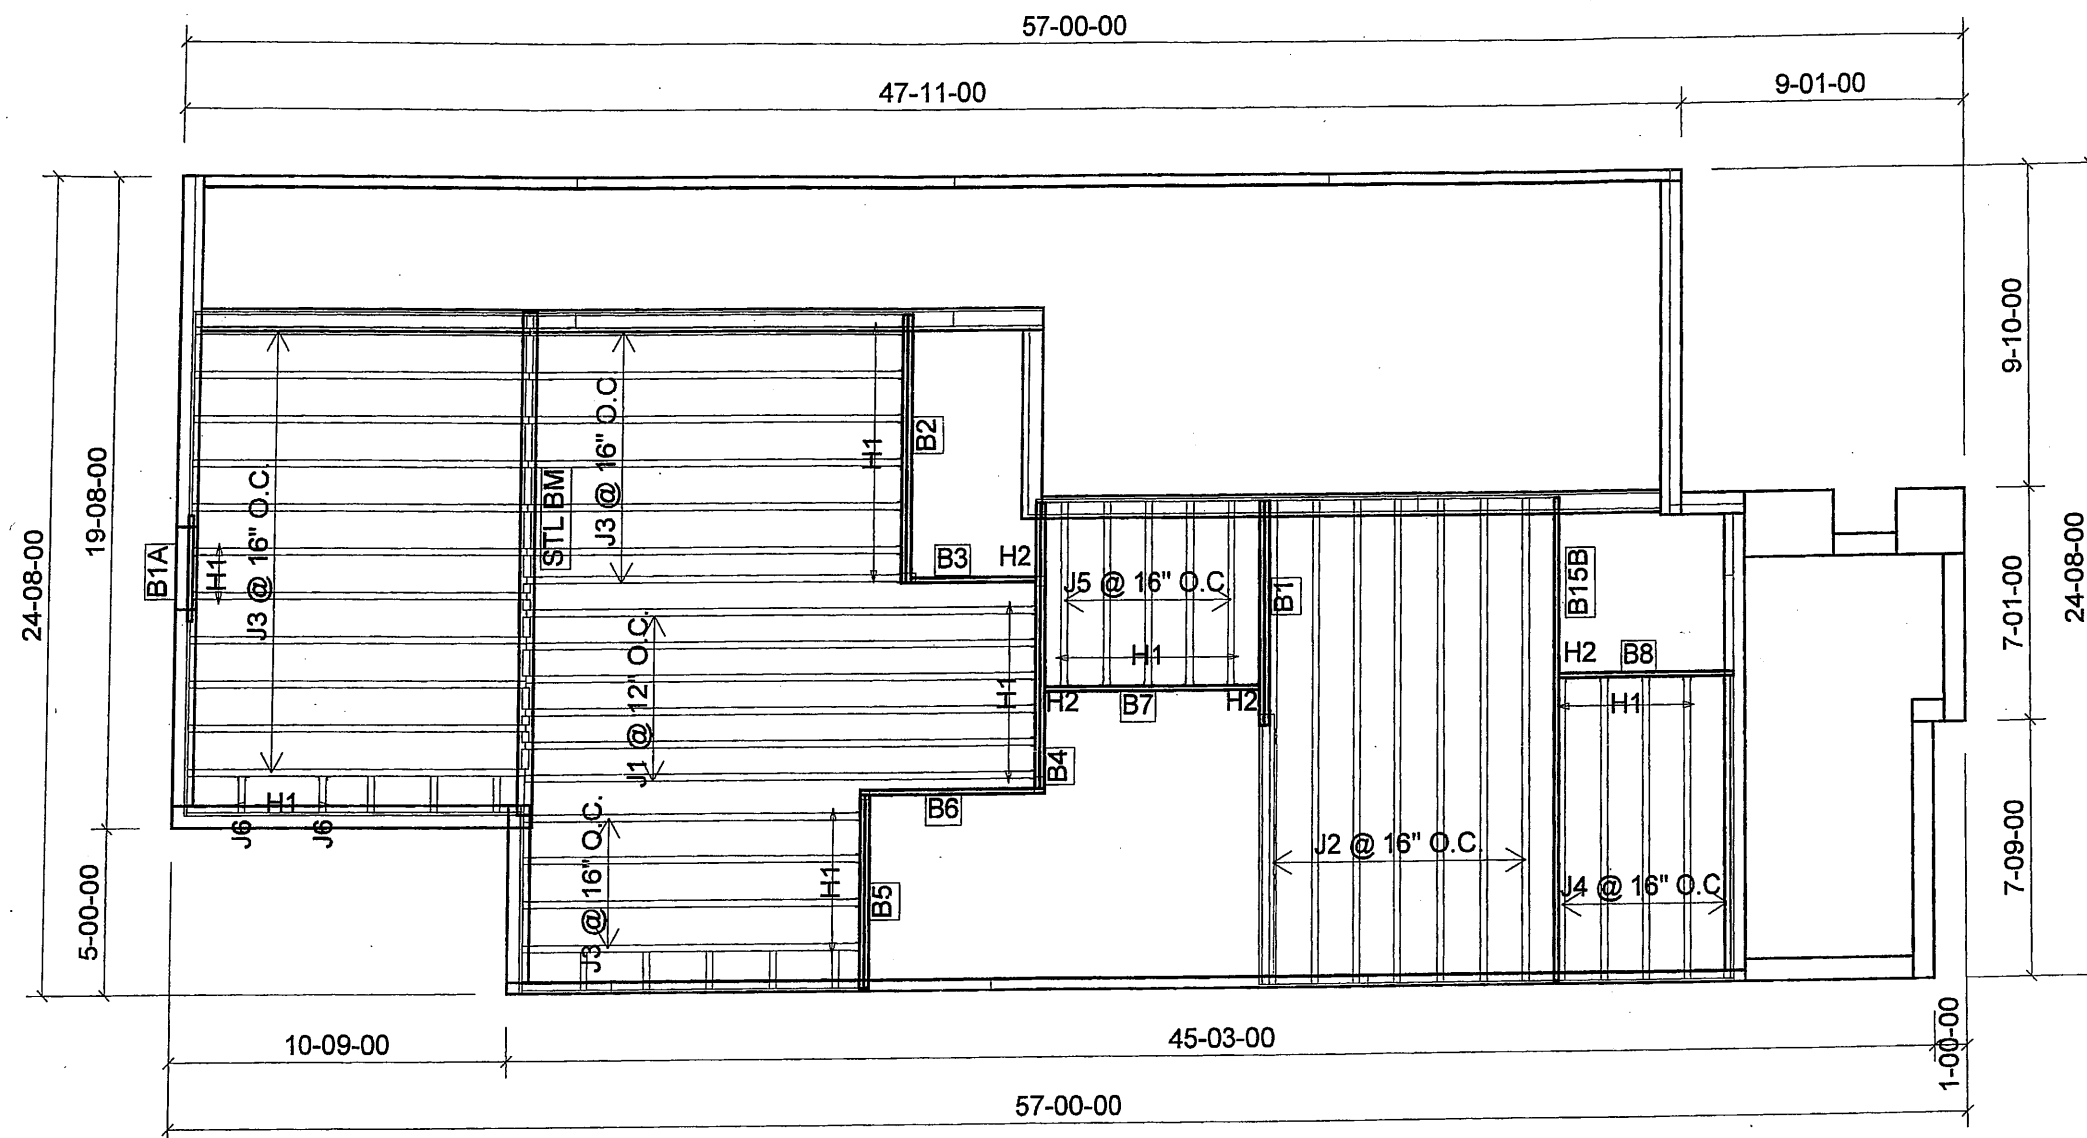

| Products |          |  |       |         |
|----------|----------|--|-------|---------|
| PlotID   | Length   | Product                                | Plies | Net Qty |
| J1       | 18-00-00 | 9 1/2" NI-40x                          | 1     | 6       |
| J2       | 16-00-00 | 9 1/2" NI-40x                          | 1     | 7       |
| J3       | 12-00-00 | 9 1/2" NI-40x                          | 1     | 22      |
| J4       | 10-00-00 | 9 1/2" NI-40x                          | 1     | 5       |
| J5       | 6-00-00  | 9 1/2" NI-40x                          | 1     | 5       |
| J6       | 2-00-00  | 9 1/2" NI-40x                          | 1     | 2       |
| B15B     | 16-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B2       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B4       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B7       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B1       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B6       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B8       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B5       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B1A      | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B3       | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |

| Connector Summary |       |             |
|-------------------|-------|-------------|
| Qty               | Manuf | Product     |
| 11                | H1    | IUS2.56/9.5 |
| 17                | H1    | IUS2.56/9.5 |
| 2                 | H1    | IUS2.56/9.5 |
| 1                 | H2    | HUS1.81/10  |
| 3                 | H2    | HUS1.81/10  |



FROM PLAN DATED: APRIL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 2

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

NOTES:  
REFER TO THE NORDIC  
INSTALLATION GUIDE FOR PROPER  
STORAGE AND INSTALLATION.  
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2  
S.P.F REQ'D UNDER INTERIOR  
UNIFORM LOAD BEARING WALLS.  
MULTIPLE SQUASH BLOCKS REQ'D  
UNDER CONCENTRATED LOADS. SEE  
FIGURE 1. CANTILEVERED JOISTS  
INCLUDING CANT' OVER BRICK REQ.  
I-JOIST BLOCKING ALONG BEARING  
AND RIMBOARD CLOSURE AT ENDS.  
SEE FIGURES 4 & 5 FOR  
REINFORCEMENT REQUIREMENTS.  
FOR HOLES INCLUDING DUCT  
CHASE AND FIELD CUT OPENINGS  
SEE FIGURE 7, TABLES 1 & 2.  
CERAMIC TILE APPLICATION AS PER  
O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 15.0 lb/ft


TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 9/21/2017


1st FLOOR

DECK

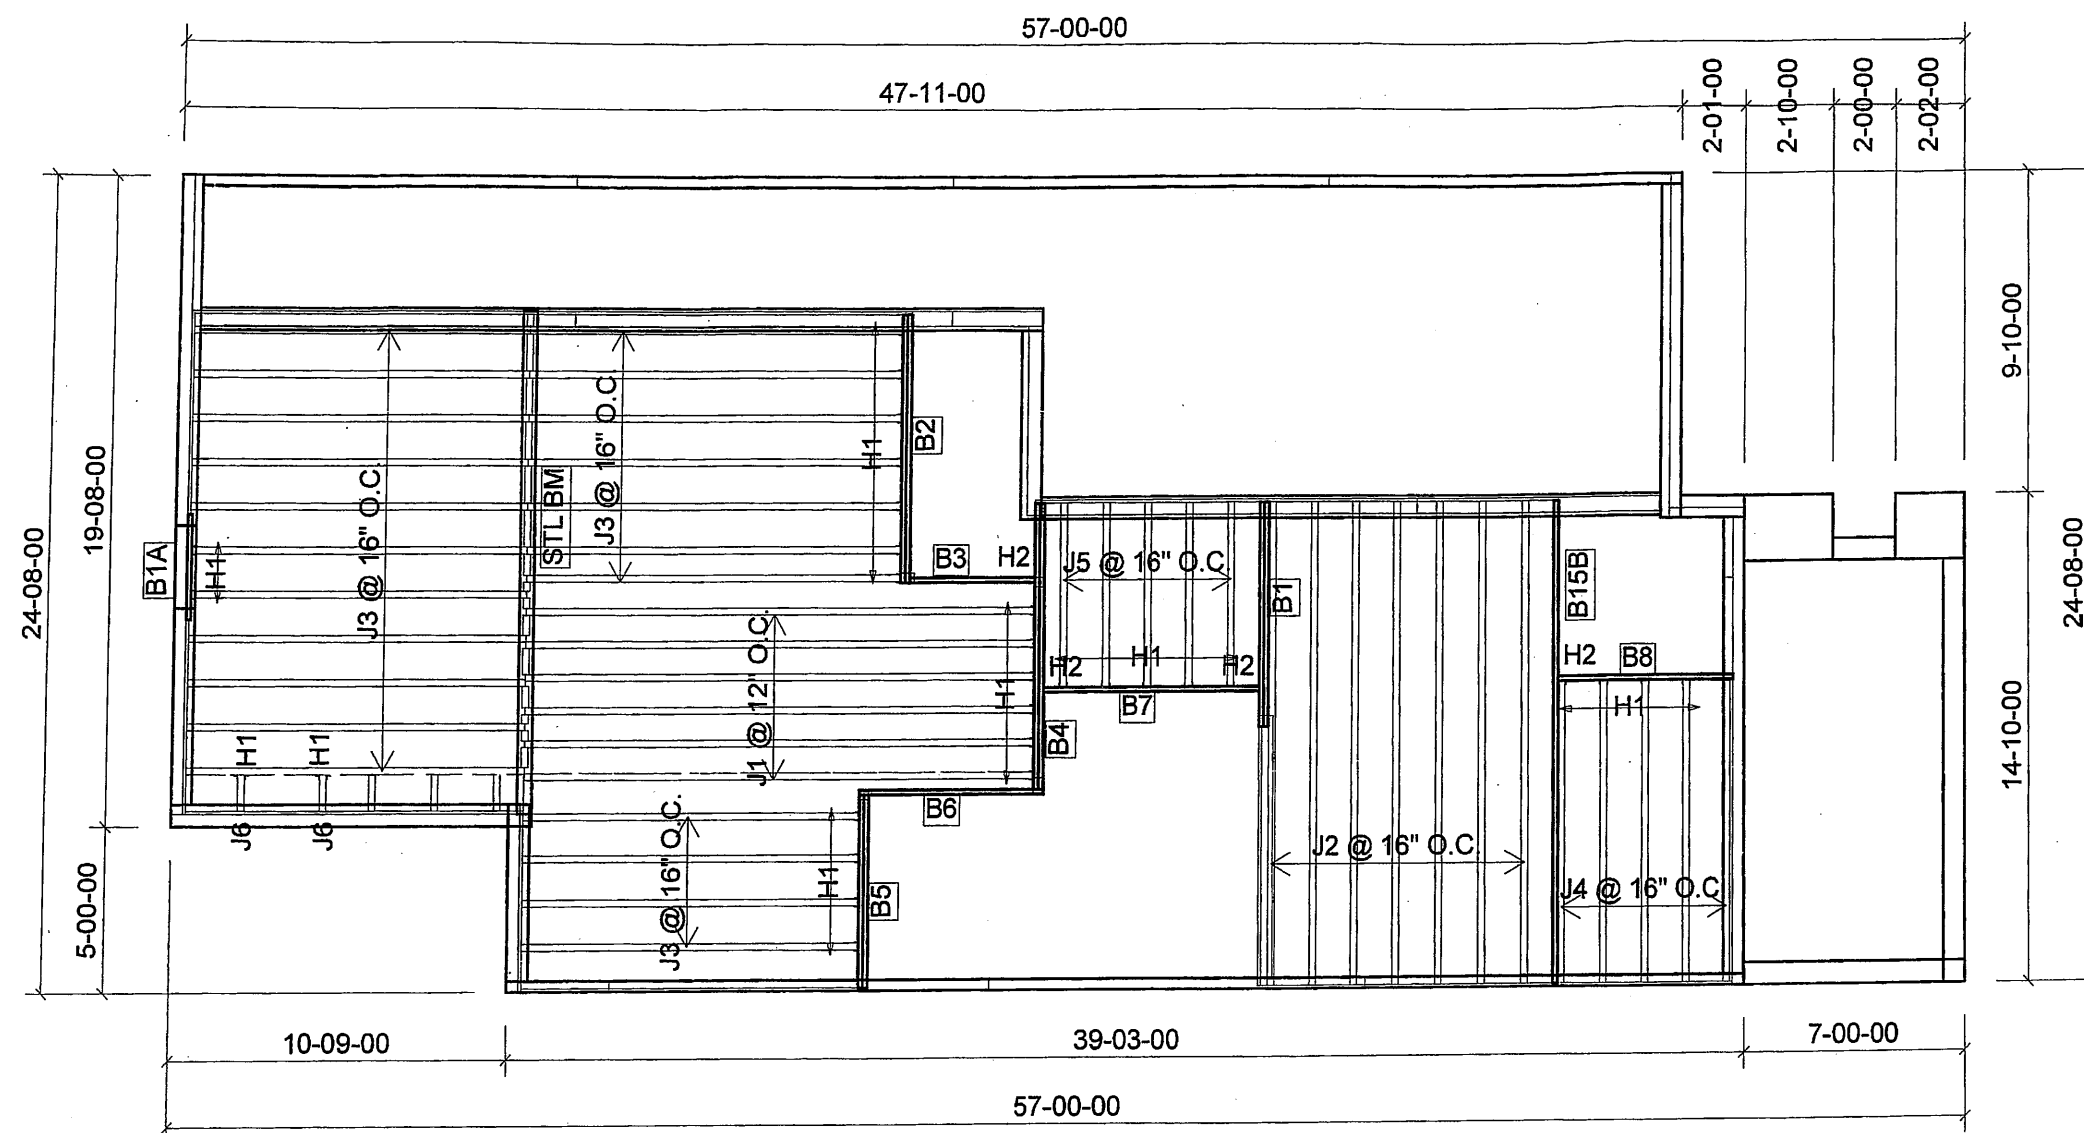


| Products |          |  |       |         |
|----------|----------|--|-------|---------|
| PlotID   | Length   | Product                                | Plies | Net Qty |
| J1       | 18-00-00 | 9 1/2" NI-40x                          | 1     | 6       |
| J2       | 16-00-00 | 9 1/2" NI-40x                          | 1     | 7       |
| J3       | 12-00-00 | 9 1/2" NI-40x                          | 1     | 22      |
| J4       | 10-00-00 | 9 1/2" NI-40x                          | 1     | 5       |
| J5       | 6-00-00  | 9 1/2" NI-40x                          | 1     | 5       |
| J6       | 2-00-00  | 9 1/2" NI-40x                          | 1     | 2       |
| B15B     | 16-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B2       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B4       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B7       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B1       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B6       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B8       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B5       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B1A      | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B3       | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |

| Connector Summary |       |               |
|-------------------|-------|---------------|
| Qty               | Manuf | Product       |
| 11                | H1    | IUS2.56/9.5   |
| 17                | H1    | IUS2.56/9.5   |
| 2                 | H1    | IUS2.56/11.88 |
| 1                 | H2    | HUS1.81/10    |
| 3                 | H2    | HUS1.81/10    |

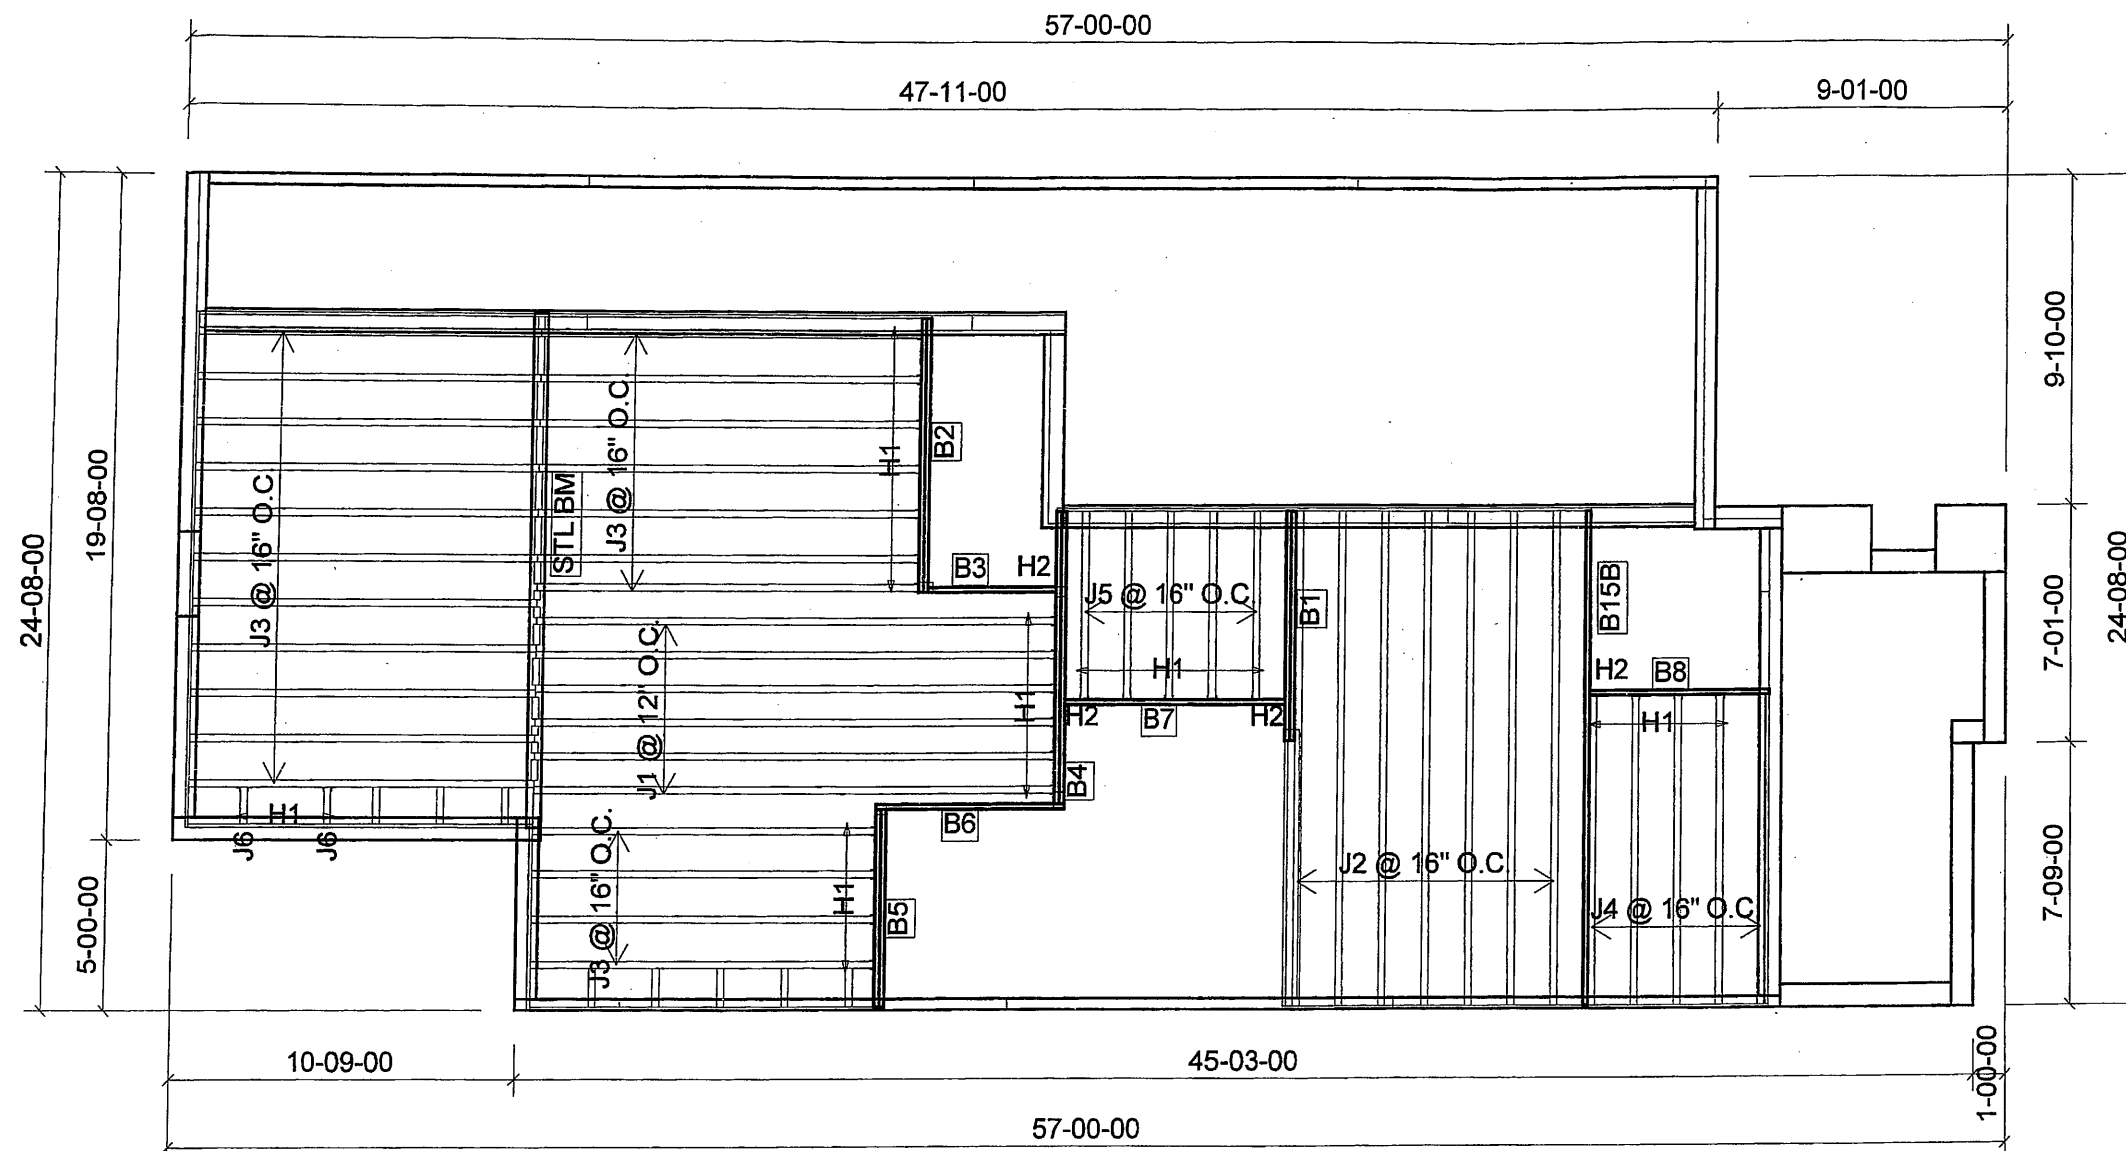

| Products |          |  |       |         |
|----------|----------|--|-------|---------|
| PlotID   | Length   | Product                                | Plies | Net Qty |
| J1       | 18-00-00 | 9 1/2" NI-40x                          | 1     | 6       |
| J2       | 16-00-00 | 9 1/2" NI-40x                          | 1     | 7       |
| J3       | 12-00-00 | 9 1/2" NI-40x                          | 1     | 22      |
| J4       | 10-00-00 | 9 1/2" NI-40x                          | 1     | 5       |
| J5       | 6-00-00  | 9 1/2" NI-40x                          | 1     | 5       |
| J6       | 2-00-00  | 9 1/2" NI-40x                          | 1     | 2       |
| B15B     | 16-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B2       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B4       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B7       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B1       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B6       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B8       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B5       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B3       | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |

| Connector Summary |       |             |
|-------------------|-------|-------------|
| Qty               | Manuf | Product     |
| 9                 | H1    | IUS2.56/9.5 |
| 17                | H1    | IUS2.56/9.5 |
| 2                 | H1    | IUS2.56/9.5 |
| 1                 | H2    | HUS1.81/10  |
| 3                 | H2    | HUS1.81/10  |



FROM PLAN DATED: APRIL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 2

ELEVATION: 1,3

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

NOTES:  
REFER TO THE NORDIC  
INSTALLATION GUIDE FOR PROPER  
STORAGE AND INSTALLATION.  
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2  
S.P.F REQ'D UNDER INTERIOR  
UNIFORM LOAD BEARING WALLS.  
MULTIPLE SQUASH BLOCKS REQ'D  
UNDER CONCENTRATED LOADS. SEE  
FIGURE 1. CANTILEVERED JOISTS  
INCLUDING CANT' OVER BRICK REQ.  
I-JOIST BLOCKING ALONG BEARING  
AND RIMBOARD CLOSURE AT ENDS.  
SEE FIGURES 4 & 5 FOR  
REINFORCEMENT REQUIREMENTS.  
FOR HOLES INCLUDING DUCT  
CHASE AND FIELD CUT OPENINGS  
SEE FIGURE 7, TABLES 1 & 2.  
CERAMIC TILE APPLICATION AS PER  
O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 15.0 lb/ft


TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 9/21/2017


1st FLOOR

W.O.B

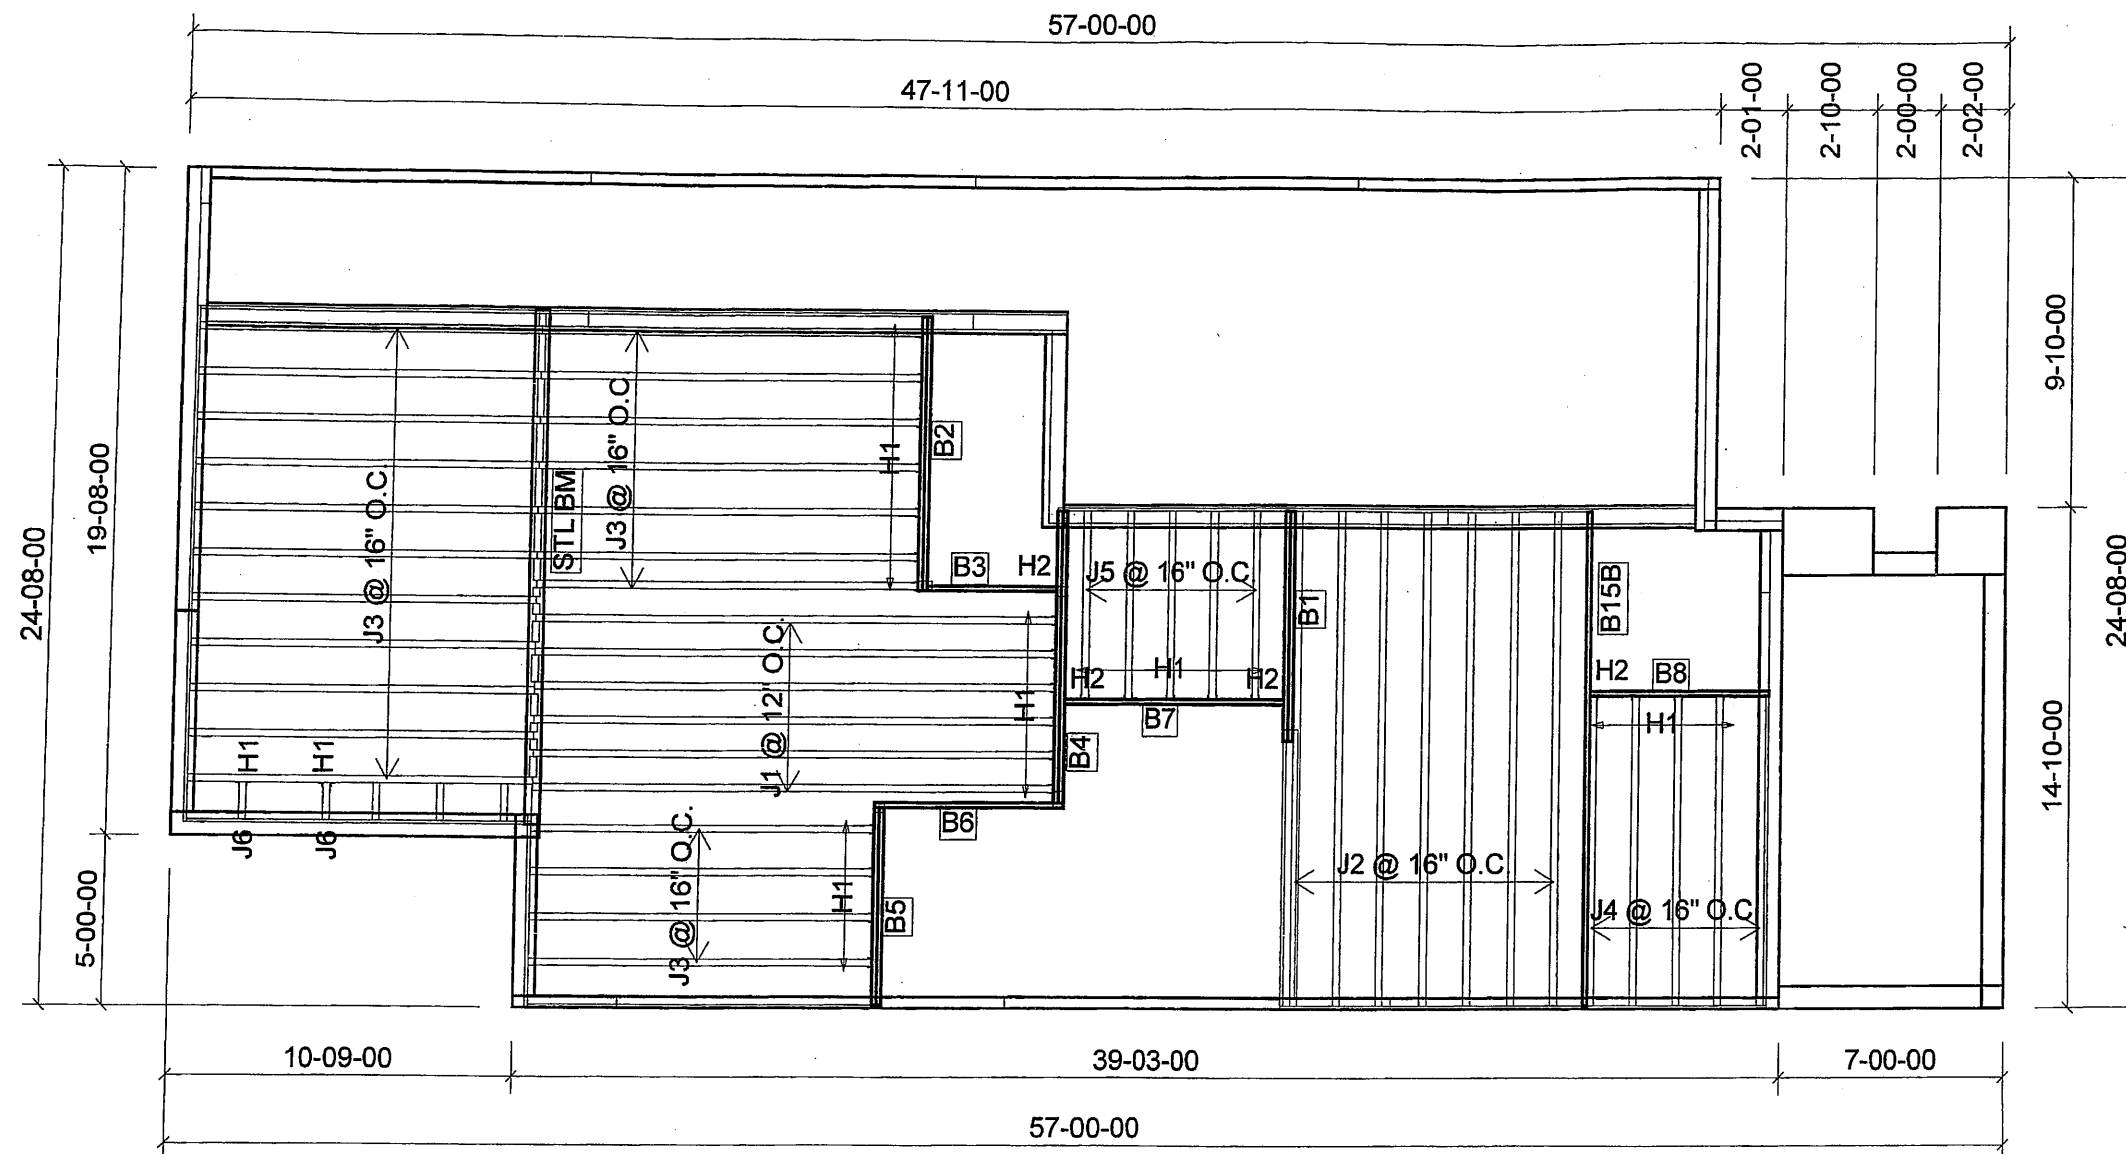

| Products |          |  |       |         |
|----------|----------|--|-------|---------|
| PlotID   | Length   | Product                                | Plies | Net Qty |
| J1       | 18-00-00 | 9 1/2" NI-40x                          | 1     | 6       |
| J2       | 16-00-00 | 9 1/2" NI-40x                          | 1     | 7       |
| J3       | 12-00-00 | 9 1/2" NI-40x                          | 1     | 22      |
| J4       | 10-00-00 | 9 1/2" NI-40x                          | 1     | 5       |
| J5       | 6-00-00  | 9 1/2" NI-40x                          | 1     | 5       |
| J6       | 2-00-00  | 9 1/2" NI-40x                          | 1     | 2       |
| B15B     | 16-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B2       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B4       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B7       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B1       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B6       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B8       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B5       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B3       | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |

| Connector Summary |       |               |
|-------------------|-------|---------------|
| Qty               | Manuf | Product       |
| 9                 | H1    | IUS2.56/9.5   |
| 17                | H1    | IUS2.56/9.5   |
| 2                 | H1    | IUS2.56/11.88 |
| 1                 | H2    | HUS1.81/10    |
| 3                 | H2    | HUS1.81/10    |

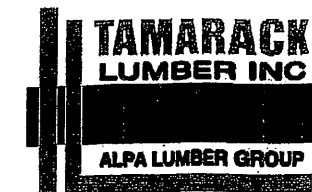

FROM PLAN DATED: APRIL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 2

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

**NOTES:**  
REFER TO THE NORDIC  
INSTALLATION GUIDE FOR PROPER  
STORAGE AND INSTALLATION.  
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2  
S.P.F REQ'D UNDER INTERIOR  
UNIFORM LOAD BEARING WALLS.  
MULTIPLE SQUASH BLOCKS REQ'D  
UNDER CONCENTRATED LOADS. SEE  
FIGURE 1. CANTILEVERED JOISTS  
INCLUDING CANT' OVER BRICK REQ.  
I-JOIST BLOCKING ALONG BEARING  
AND RIMBOARD CLOSURE AT ENDS.  
SEE FIGURES 4 & 5 FOR  
REINFORCEMENT REQUIREMENTS.  
FOR HOLES INCLUDING DUCT  
CHASE AND FIELD CUT OPENINGS  
SEE FIGURE 7, TABLES 1 & 2.  
CERAMIC TILE APPLICATION AS PER  
O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 15.0 lb/ft


TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 9/21/2017

**1st FLOOR**

W.O.B



FROM PLAN DATED: APRIL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 2

ELEVATION: 1,3

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

NOTES:  
REFER TO THE NORDIC  
INSTALLATION GUIDE FOR PROPER  
STORAGE AND INSTALLATION.  
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2  
S.P.F REQ'D UNDER INTERIOR  
UNIFORM LOAD BEARING WALLS.  
MULTIPLE SQUASH BLOCKS REQ'D  
UNDER CONCENTRATED LOADS. SEE  
FIGURE 1. CANTILEVERED JOISTS  
INCLUDING CANT' OVER BRICK REQ.  
I-JOIST BLOCKING ALONG BEARING  
AND RIMBOARD CLOSURE AT ENDS.  
SEE FIGURES 4 & 5 FOR  
REINFORCEMENT REQUIREMENTS.  
FOR HOLES INCLUDING DUCT  
CHASE AND FIELD CUT OPENINGS  
SEE FIGURE 7, TABLES 1 & 2.  
CERAMIC TILE APPLICATION AS PER  
O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft

TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED


DATE: 9/12/2017

1st FLOOR

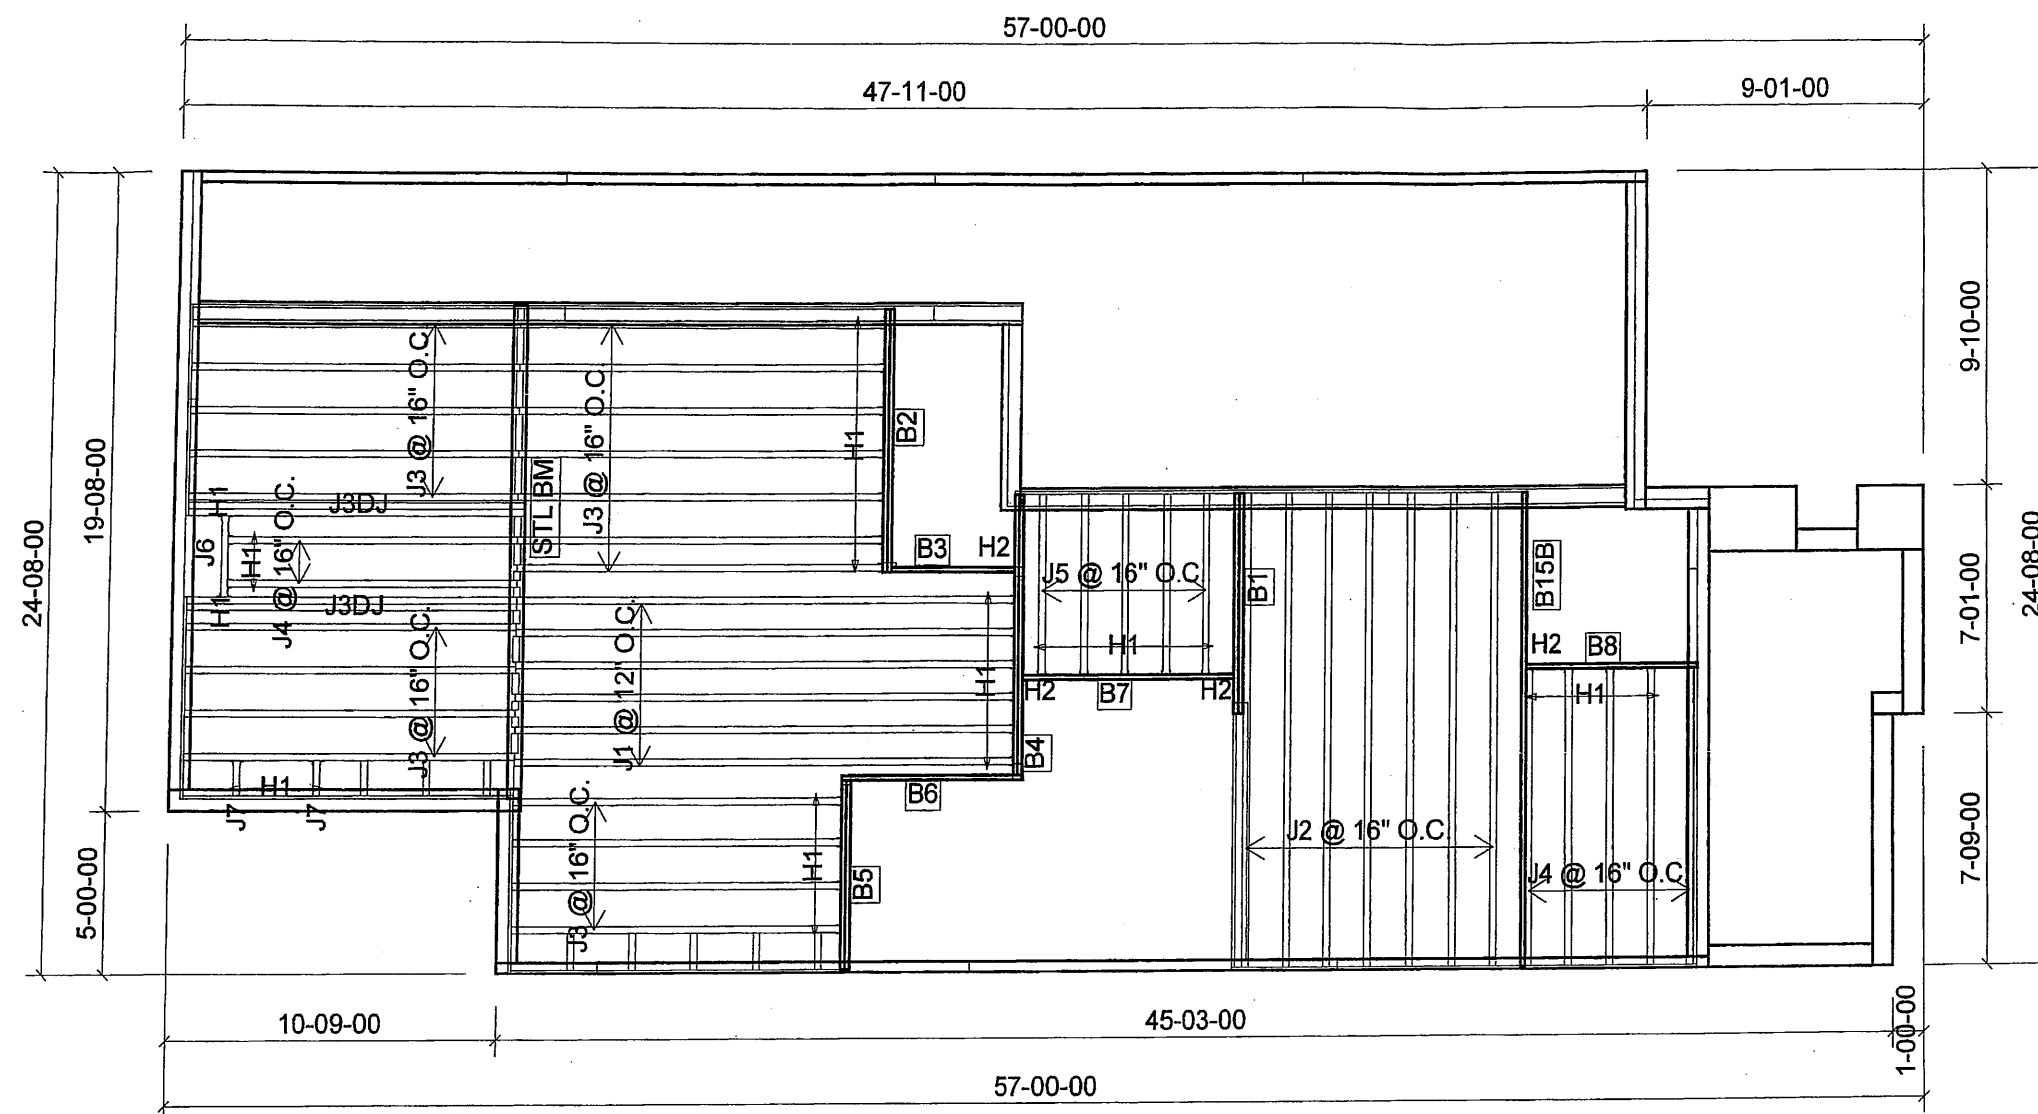

| Products |          |  |       |         |
|----------|----------|--|-------|---------|
| PlotID   | Length   | Product                                | Plies | Net Qty |
| J1       | 18-00-00 | 9 1/2" NI-40x                          | 1     | 6       |
| J2       | 16-00-00 | 9 1/2" NI-40x                          | 1     | 7       |
| J3       | 12-00-00 | 9 1/2" NI-40x                          | 1     | 20      |
| J3DJ     | 12-00-00 | 9 1/2" NI-40x                          | 2     | 4       |
| J4       | 10-00-00 | 9 1/2" NI-40x                          | 1     | 7       |
| J5       | 6-00-00  | 9 1/2" NI-40x                          | 1     | 5       |
| J6       | 4-00-00  | 9 1/2" NI-40x                          | 1     | 1       |
| J7       | 2-00-00  | 9 1/2" NI-40x                          | 1     | 2       |
| B15B     | 16-00-00 | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 1     | 1       |
| B2       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 2     | 2       |
| B4       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 2     | 2       |
| B7       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 1     | 1       |
| B1       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 2     | 2       |
| B6       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 1     | 1       |
| B8       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 1     | 1       |
| B5       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 2     | 2       |
| B3       | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP | 1     | 1       |


| Connector Summary |       |             |
|-------------------|-------|-------------|
| Qty               | Manuf | Product     |
| 9                 | H1    | IUS2.56/9.5 |
| 17                | H1    | IUS2.56/9.5 |
| 2                 | H1    | IUS2.56/9.5 |
| 4                 | H1    | IUS2.56/9.5 |
| 1                 | H2    | HUS1.81/10  |
| 3                 | H2    | HUS1.81/10  |



FROM PLAN DATED: APRIL 2017  
BUILDER: GREENPARK HOMES  
SITE: RUSSELL GARDENS  
MODEL: HIGHGROVE 2  
ELEVATION: 2  
LOT:  
CITY: WATERDOWN  
SALESMAN: M D  
DESIGNER: AJ  
REVISION:  
  
NOTES:  
REFER TO THE NORDIC  
INSTALLATION GUIDE FOR PROPER  
STORAGE AND INSTALLATION.  
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2  
S.P.F REQ'D UNDER INTERIOR  
UNIFORM LOAD BEARING WALLS.  
MULTIPLE SQUASH BLOCKS REQ'D  
UNDER CONCENTRATED LOADS. SEE  
FIGURE 1. CANTILEVERED JOISTS  
INCLUDING CANT' OVER BRICK REQ.  
I-JOIST BLOCKING ALONG BEARING  
AND RIMBOARD CLOSURE AT ENDS.  
SEE FIGURES 4 & 5 FOR  
REINFORCEMENT REQUIREMENTS.  
FOR HOLES INCLUDING DUCT  
CHASE AND FIELD CUT OPENINGS  
SEE FIGURE 7, TABLES 1 & 2.  
CERAMIC TILE APPLICATION AS PER  
O.B.C 9.30.6.  
LOADING:  
DESIGN LOADS: L/480.000  
LIVE LOAD: 40.0 lb/ft²  
DEAD LOAD: 15.0 lb/ft  
TILED AREAS: 20 lb/ft  
SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 9/12/2017

1st FLOOR

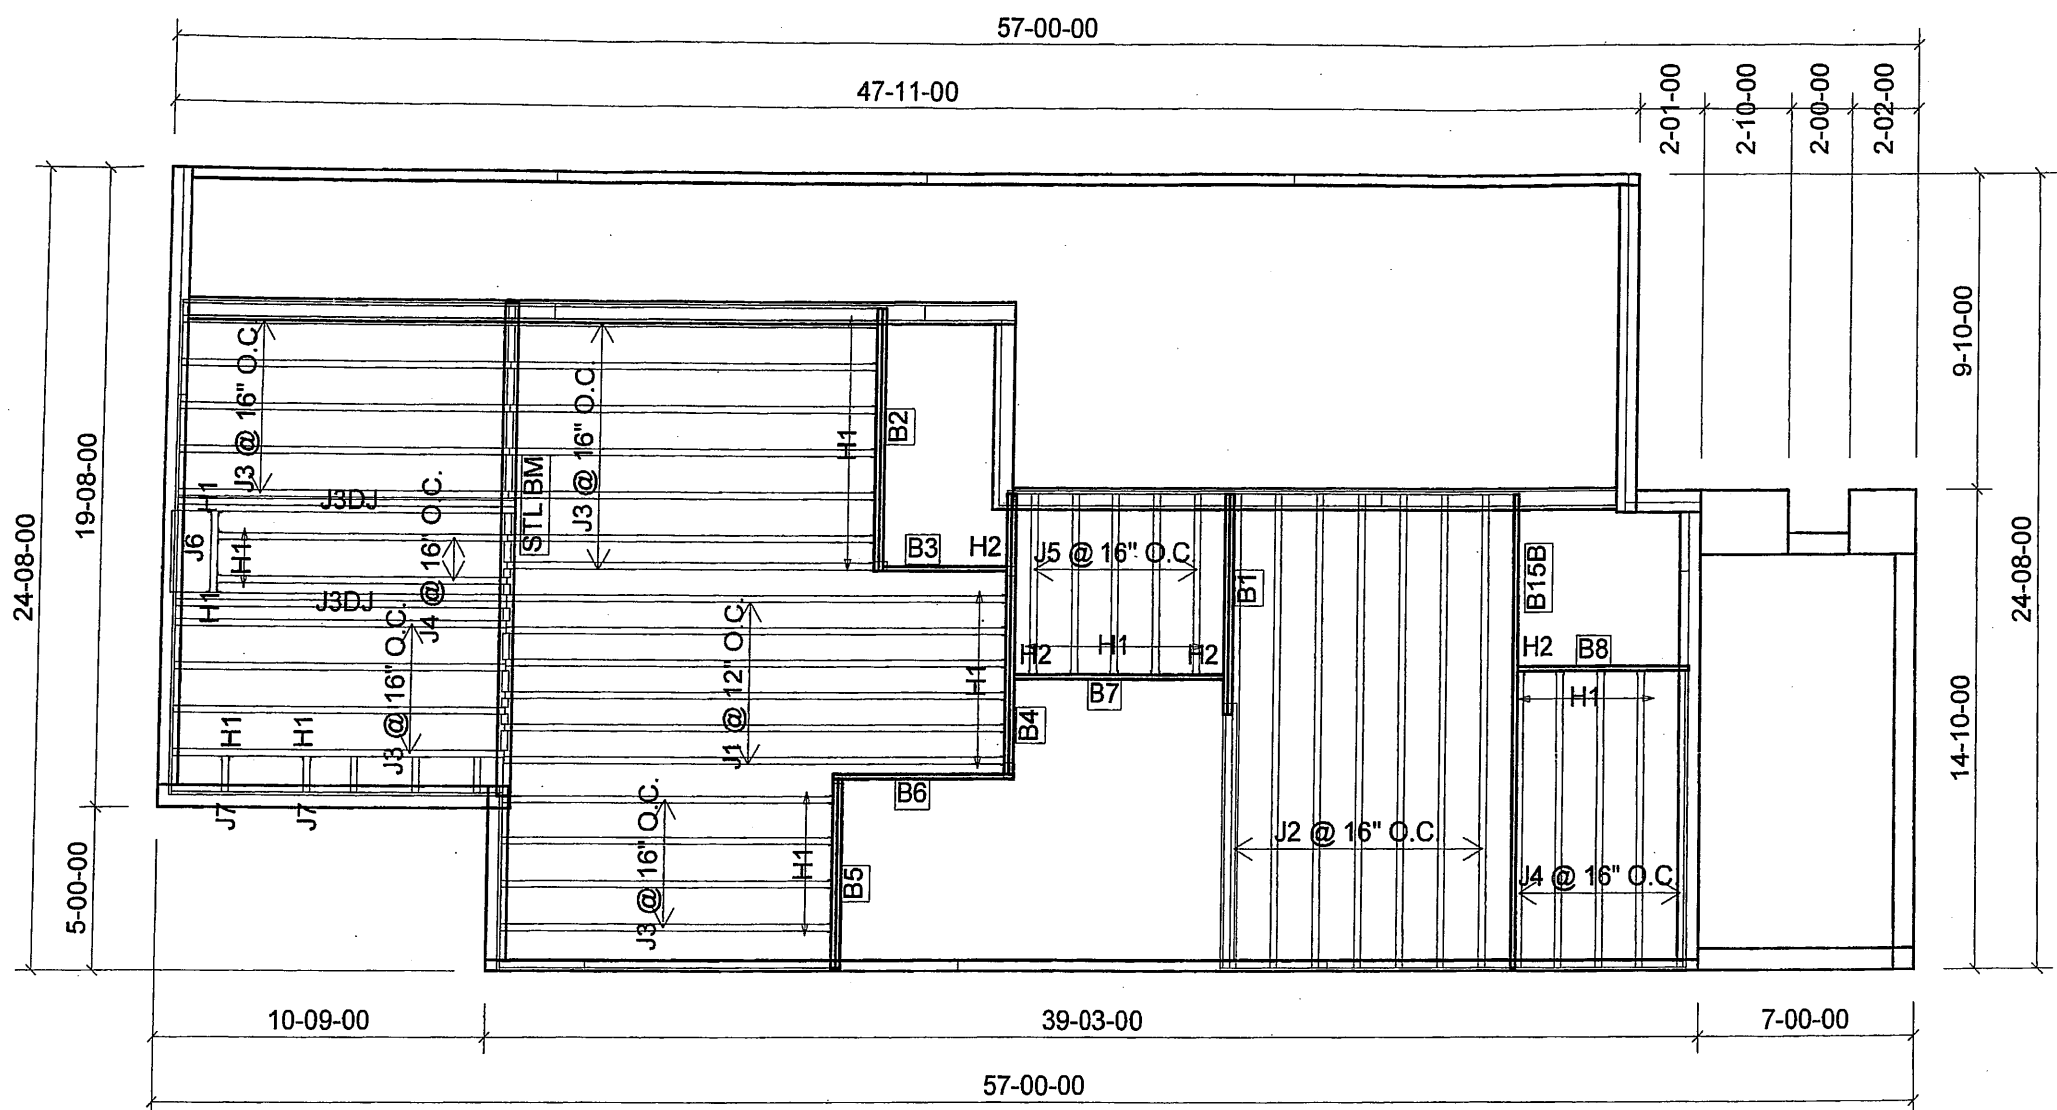

| Products |          |  |       |         |
|----------|----------|--|-------|---------|
| PlotID   | Length   | Product                                | Plies | Net Qty |
| J1       | 18-00-00 | 9 1/2" NI-40x                          | 1     | 6       |
| J2       | 16-00-00 | 9 1/2" NI-40x                          | 1     | 7       |
| J3       | 12-00-00 | 9 1/2" NI-40x                          | 1     | 20      |
| J3DJ     | 12-00-00 | 9 1/2" NI-40x                          | 2     | 4       |
| J4       | 10-00-00 | 9 1/2" NI-40x                          | 1     | 7       |
| J5       | 6-00-00  | 9 1/2" NI-40x                          | 1     | 5       |
| J6       | 4-00-00  | 9 1/2" NI-40x                          | 1     | 1       |
| J7       | 2-00-00  | 9 1/2" NI-40x                          | 1     | 2       |
| B15B     | 16-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B2       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B4       | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B7       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B1       | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B6       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B8       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |
| B5       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 2     | 2       |
| B3       | 4-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP | 1     | 1       |

| Connector Summary |       |               |
|-------------------|-------|---------------|
| Qty               | Manuf | Product       |
| 9                 | H1    | IUS2.56/9.5   |
| 17                | H1    | IUS2.56/9.5   |
| 2                 | H1    | IUS2.56/9.5   |
| 2                 | H1    | IUS2.56/9.5   |
| 2                 | H1    | IUS2.56/11.88 |
| 1                 | H2    | HUS1.81/10    |
| 3                 | H2    | HUS1.81/10    |

FROM PLAN DATED: APRIL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 2

ELEVATION: 1,3

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

**NOTES:**

REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

**LOADING:**

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>


DEAD LOAD: 15.0 lb/ft<sup>2</sup>

TILED AREAS: 20 lb/ft

**SUBFLOOR:** 5/8" GLUED AND NAILED


**DATE:** 2018-02-07

**2nd FLOOR**

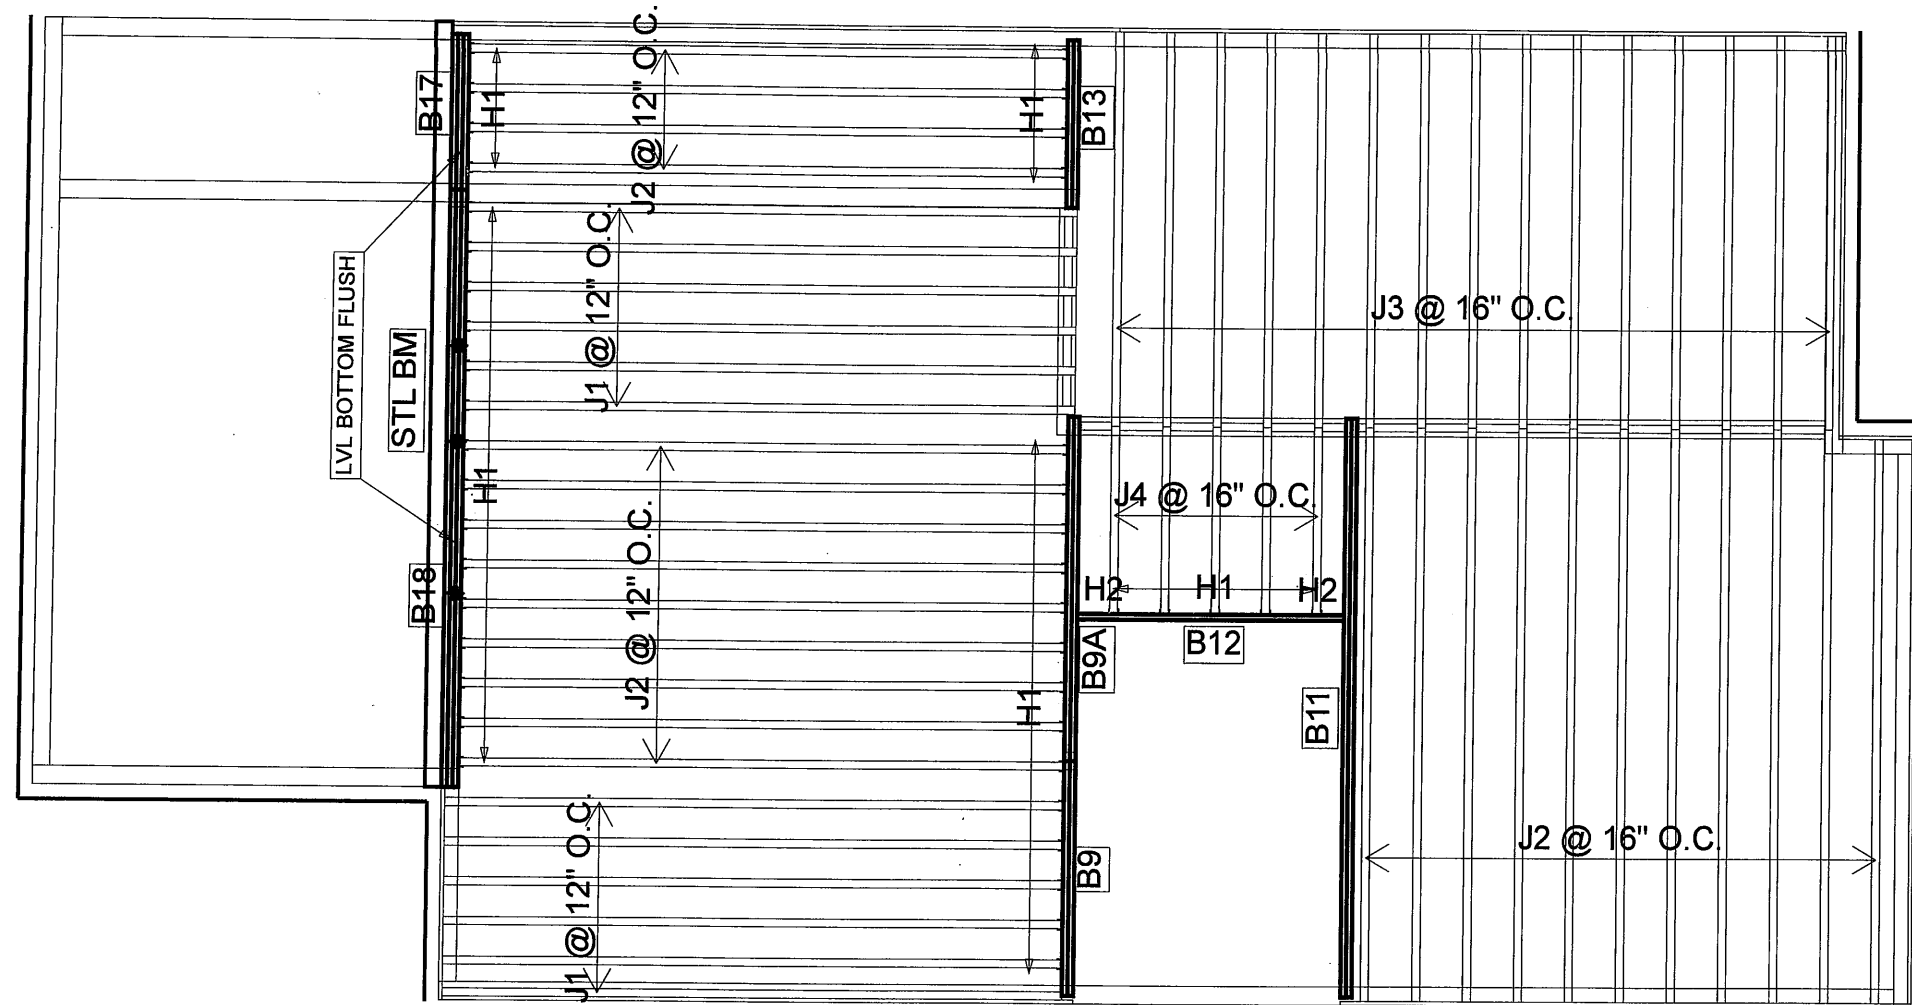

| Products |          |   |       |         |
|----------|----------|---|-------|---------|
| PlotID   | Length   | Product                                 | Plies | Net Qty |
| J1       | 18-00-00 | 9 1/2" NI-40x                           | 1     | 12      |
| J2       | 16-00-00 | 9 1/2" NI-40x                           | 1     | 24      |
| J3       | 10-00-00 | 9 1/2" NI-40x                           | 1     | 15      |
| J4       | 6-00-00  | 9 1/2" NI-40x                           | 1     | 5       |
| B11      | 16-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 2     | 2       |
| B9A      | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 2     | 2       |
| B12      | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 1     | 1       |
| B13      | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 2     | 2       |
| B9       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 2     | 2       |
| B17      | 4-00-00  | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 3     | 3       |
| B18      | 16-00-00 | 1-3/4" x 14" VERSA-LAM® 2.0 3100 SP     | 3     | 3       |

| Connector Summary |       |             |
|-------------------|-------|-------------|
| Qty               | Manuf | Product     |
| 5                 | H1    | IUS2.56/9.5 |
| 18                | H1    | IUS2.56/9.5 |
| 4                 | H1    | IUS2.56/9.5 |
| 15                | H1    | IUS2.56/9.5 |
| 2                 | H2    | HUS1.81/10  |

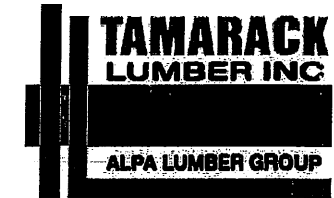

FROM PLAN DATED: APRIL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 2

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>


DEAD LOAD: 15.0 lb/ft<sup>2</sup>

TILED AREAS: 20 lb/ft

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2018-02-07

## 2nd FLOOR

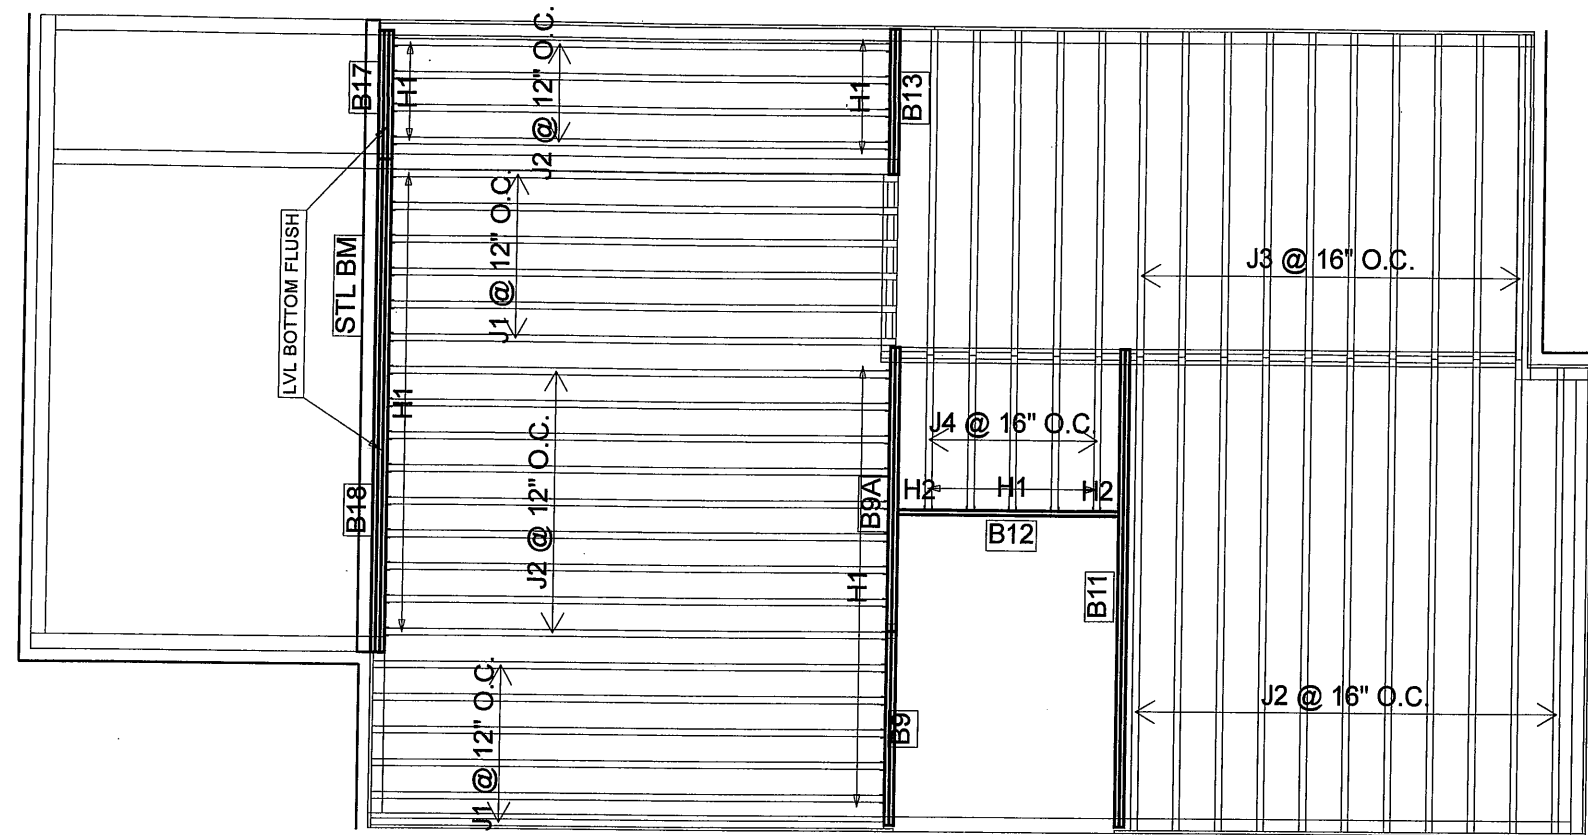

| Products |          |   |       |         |
|----------|----------|---|-------|---------|
| PlotID   | Length   | Product                                 | Plies | Net Qty |
| J1       | 18-00-00 | 9 1/2" NI-40x                           | 1     | 12      |
| J2       | 16-00-00 | 9 1/2" NI-40x                           | 1     | 24      |
| J3       | 10-00-00 | 9 1/2" NI-40x                           | 1     | 15      |
| J4       | 6-00-00  | 9 1/2" NI-40x                           | 1     | 5       |
| B11      | 16-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 2     | 2       |
| B9A      | 10-00-00 | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 2     | 2       |
| B12      | 8-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 1     | 1       |
| B13      | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 2     | 2       |
| B9       | 6-00-00  | 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  | 2     | 2       |
| B18      | 16-00-00 | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 3     | 3       |
| B17      | 4-00-00  | 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP | 3     | 3       |

| Connector Summary |       |             |
|-------------------|-------|-------------|
| Qty               | Manuf | Product     |
| 5                 | H1    | IUS2.56/9.5 |
| 18                | H1    | IUS2.56/9.5 |
| 19                | H1    | IUS2.56/9.5 |
| 2                 | H2    | HUS1.81/10  |



# NORDIC STRUCTURES

**COMPANY**  
TAMARACK LUMBER  
BURLINGTON  
Feb. 7, 2018 17:08


**PROJECT**  
J2 GRD FLR

## Design Check Calculation Sheet Nordic Sizer – Canada 6.4

### Loads:

| Load  | Type | Distribution | Pat-<br>tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|--------------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |              |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |              |                            | 40.00                  | psf  |

### Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

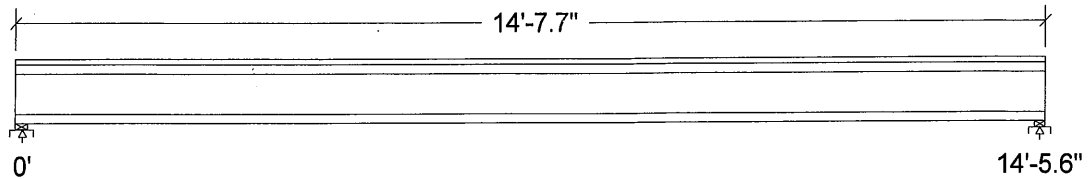

|             |       |  |        |
|-------------|-------|--|--------|
| Unfactored: |       |  |        |
| Dead        | 196   |  | 195    |
| Live        | 391   |  | 390    |
| Factored:   |       |  |        |
| Total       | 832   |  | 828    |
| Bearing:    |       |  |        |
| Resistance  |       |  |        |
| Joist       | 1861  |  | 1854   |
| Support     | 3471  |  | 2758   |
| Des ratio   |       |  |        |
| Joist       | 0.45  |  | 0.45   |
| Support     | 0.24  |  | 0.30   |
| Load case   | #2    |  | #2     |
| Length      | 2-1/8 |  | 1-3/4* |
| Min req'd   | 1-3/4 |  | 1-3/4  |
| Stiffener   | No    |  | No     |
| Kd          | 1.00  |  | 1.00   |
| KB support  | 1.00  |  | 1.00   |
| fcp sup     | 769   |  | 769    |
| Kzcp sup    | 1.06  |  | 1.02   |

\*Minimum bearing length for joists is 1-3/4" for exterior supports

### Nordic 9-1/2" NI-40x Floor joist @ 16" o.c.

Supports: All - Lumber Sill plate, No.1/No.2

Total length: 14'-7.7"; 3/4" nailed and glued OSB sheathing

This section **PASSES** the design code check.

### Limit States Design using CSA O86-14 and Vibration Criterion:

| Criterion    | Analysis Value | Design Value | Unit   | Analysis/Design |
|--------------|----------------|--------------|--------|-----------------|
| Shear        | Vf = 820       | Vr = 1895    | lbs    | Vf/Vr = 0.43    |
| Moment(+)    | Mf = 2966      | Mr = 4824    | lbs-ft | Mf/Mr = 0.61    |
| Perm. Defl'n | 0.11 = <L/999  | 0.48 = L/360 | in     | 0.23            |
| Live Defl'n  | 0.22 = L/796   | 0.36 = L/480 | in     | 0.60            |
| Total Defl'n | 0.33 = L/531   | 0.72 = L/240 | in     | 0.45            |
| Bare Defl'n  | 0.27 = L/647   | 0.48 = L/360 | in     | 0.56            |
| Vibration    | Lmax = 14'-6   | Lv = 16'-2   | ft     |                 |
| Defl'n       | = 0.032        | = 0.046      | in     | 0.70            |



DWG NO. TAM B273-18  
STRUCTURAL  
COMPONENT ONLY

**Additional Data:**

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr       | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| Mr+      | 4824          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 218.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls \_=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**

Deflection: E<sub>I</sub>eff = 276e06 lb-in<sup>2</sup> K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM B273-18  
STRUCTURAL  
COMPONENT ONLY

# NORDIC STRUCTURES

**COMPANY**  
TAMARACK LUMBER  
BURLINGTON  
Feb. 7, 2018 17:08

**PROJECT**  
J4 GRD FLR


## Design Check Calculation Sheet

Nordic Sizer – Canada 6.4

### Loads:

| Load  | Type | Distribution | Pat-<br>tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|--------------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |              |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |              |                            | 40.00                  | psf  |

### Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

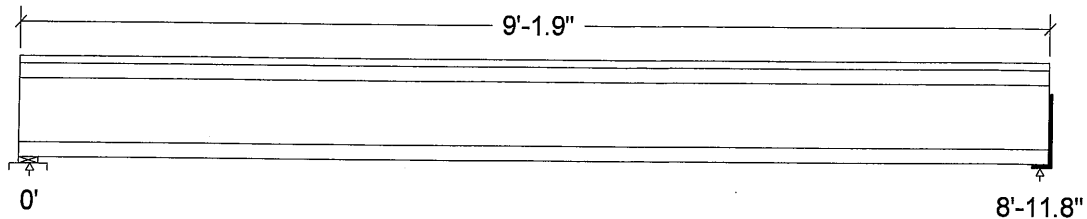


|             |       |  |        |
|-------------|-------|--|--------|
| Unfactored: |       |  |        |
| Dead        | 123   |  | 122    |
| Live        | 245   |  | 243    |
| Factored:   |       |  |        |
| Total       | 521   |  | 517    |
| Bearing:    |       |  |        |
| Resistance  |       |  |        |
| Joist       | 1861  |  | 1854   |
| Support     | 3471  |  | -      |
| Des ratio   |       |  |        |
| Joist       | 0.28  |  | 0.28   |
| Support     | 0.15  |  | -      |
| Load case   | #2    |  | #2     |
| Length      | 2-1/8 |  | 1-3/4* |
| Min req'd   | 1-3/4 |  | 1-3/4  |
| Stiffener   | No    |  | No     |
| Kd          | 1.00  |  | 1.00   |
| KB support  | 1.00  |  | -      |
| fcp sup     | 769   |  | -      |
| Kzcp sup    | 1.06  |  | -      |

\*Minimum bearing length for joists is 1-3/4" for exterior supports

**Nordic 9-1/2" NI-40x Floor joist @ 16" o.c.**  
Supports: 1 - Lumber Sill plate, No.1/No.2; 2 - Hanger;  
Total length: 9'-1.9"; 3/4" nailed and glued OSB sheathing  
**This section PASSES the design code check.**

### Limit States Design using CSA O86-14 and Vibration Criterion:

| Criterion    | Analysis Value | Design Value | Unit   | Analysis/Design |
|--------------|----------------|--------------|--------|-----------------|
| Shear        | Vf = 509       | Vr = 1895    | lbs    | Vf/Vr = 0.27    |
| Moment (+)   | Mf = 1143      | Mr = 4824    | lbs-ft | Mf/Mr = 0.24    |
| Perm. Defl'n | 0.02 = <L/999  | 0.30 = L/360 | in     | 0.06            |
| Live Defl'n  | 0.04 = <L/999  | 0.22 = L/480 | in     | 0.17            |
| Total Defl'n | 0.06 = <L/999  | 0.45 = L/240 | in     | 0.13            |
| Bare Defl'n  | 0.05 = <L/999  | 0.30 = L/360 | in     | 0.15            |
| Vibration    | Lmax = 9'-0    | Lv = 16'-2   | ft     |                 |
| Defl'n       | = 0.013        | = 0.079      | in     | 0.17            |



DWG NO. TAM 0202-18  
STRUCTURAL  
COMPONENT ONLY

**Additional Data:**

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr       | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| Mr+      | 4824          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 218.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls \_=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**

Deflection: E<sub>I</sub>eff = 276e06 lb-in<sup>2</sup> K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 8272-18  
STRUCTURAL  
COMPONENT ONLY

# NORDIC STRUCTURES

**COMPANY**  
TAMARACK LUMBER  
BURLINGTON  
Feb. 7, 2018 16:57


**PROJECT**  
J2 2ND FLR

## Design Check Calculation Sheet Nordic Sizer – Canada 6.4

### Loads:

| Load  | Type | Distribution | Pat-<br>tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|--------------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |              |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |              |                            | 40.00                  | psf  |

### Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

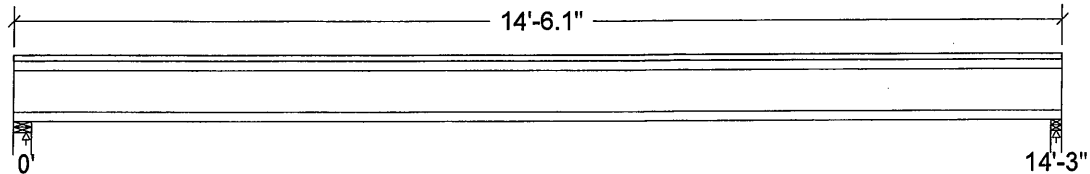

|             |       |  |        |
|-------------|-------|--|--------|
| Unfactored: |       |  |        |
| Dead        | 195   |  | 192    |
| Live        | 390   |  | 384    |
| Factored:   |       |  |        |
| Total       | 829   |  | 816    |
| Bearing:    |       |  |        |
| Resistance  |       |  |        |
| Joist       | 1878  |  | 1854   |
| Support     | 5525  |  | 2758   |
| Des ratio   |       |  |        |
| Joist       | 0.44  |  | 0.44   |
| Support     | 0.15  |  | 0.30   |
| Load case   | #2    |  | #2     |
| Length      | 3-1/8 |  | 1-3/4* |
| Min req'd   | 1-3/4 |  | 1-3/4  |
| Stiffener   | No    |  | No     |
| Kd          | 1.00  |  | 1.00   |
| KB support  | 1.00  |  | 1.00   |
| fcp sup     | 769   |  | 769    |
| Kzcp sup    | 1.15  |  | 1.02   |

\*Minimum bearing length for joists is 1-3/4" for exterior supports

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

### Nordic 9-1/2" NI-40x Floor joist @ 16" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 14'-6.1"; 5/8" nailed and glued OSB sheathing

This section **PASSES** the design code check.

### Limit States Design using CSA O86-14 and Vibration Criterion:

| Criterion    | Analysis Value | Design Value | Unit   | Analysis/Design |
|--------------|----------------|--------------|--------|-----------------|
| Shear        | Vf = 808       | Vr = 1895    | lbs    | Vf/Vr = 0.43    |
| Moment(+)    | Mf = 2877      | Mr = 4824    | lbs-ft | Mf/Mr = 0.60    |
| Perm. Defl'n | 0.11 = <L/999  | 0.48 = L/360 | in     | 0.22            |
| Live Defl'n  | 0.21 = L/809   | 0.36 = L/480 | in     | 0.59            |
| Total Defl'n | 0.32 = L/539   | 0.71 = L/240 | in     | 0.44            |
| Bare Defl'n  | 0.25 = L/675   | 0.48 = L/360 | in     | 0.53            |
| Vibration    | Lmax = 14'-3   | Lv = 15'-4   | ft     |                 |
| Defl'n       | = 0.037        | = 0.047      | in     | 0.79            |



8642  
DWG NO. TAM B274-18  
STRUCTURAL  
COMPONENT ONLY

**Additional Data:**

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr       | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| Mr+      | 4824          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 218.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls \_=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**

Deflection: E<sub>IEff</sub> = 268e06 lb-in<sup>2</sup> K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 8274-18  
STRUCTURAL  
COMPONENT ONLY

# NORDIC STRUCTURES

COMPANY  
TAMARACK LUMBER  
BURLINGTON  
Jan. 23, 2018 07:32


PROJECT  
J3 2ND FLR

## Design Check Calculation Sheet Nordic Sizer – Canada 6.4

### Loads:

| Load  | Type | Distribution | Pat-<br>tern | Location [ft]<br>Start End | Magnitude<br>Start End | Unit |
|-------|------|--------------|--------------|----------------------------|------------------------|------|
| Load1 | Dead | Full Area    |              |                            | 20.00                  | psf  |
| Load2 | Live | Full Area    |              |                            | 40.00                  | psf  |

### Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

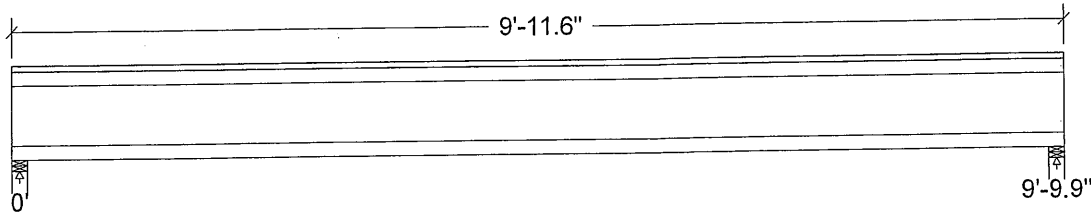

|             |        |  |        |
|-------------|--------|--|--------|
| Unfactored: |        |  |        |
| Dead        | 133    |  | 133    |
| Live        | 266    |  | 266    |
| Factored:   |        |  |        |
| Total       | 565    |  | 565    |
| Bearing:    |        |  |        |
| Resistance  |        |  |        |
| Joist       | 1854   |  | 1854   |
| Support     | 2758   |  | 2758   |
| Des ratio   |        |  |        |
| Joist       | 0.30   |  | 0.30   |
| Support     | 0.20   |  | 0.20   |
| Load case   | #2     |  | #2     |
| Length      | 1-3/4* |  | 1-3/4* |
| Min req'd   | 1-3/4  |  | 1-3/4  |
| Stiffener   | No     |  | No     |
| Kd          | 1.00   |  | 1.00   |
| KB support  | 1.00   |  | 1.00   |
| fcp sup     | 769    |  | 769    |
| Kzcp sup    | 1.02   |  | 1.02   |


\*Minimum bearing length for joists is 1-3/4" for exterior supports  
Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

### Nordic 9-1/2" NI-40x Floor joist @ 16" o.c.

Supports: All - Lumber Wall, No.1/No.2  
Total length: 9'-11.6"; 5/8" nailed and glued OSB sheathing  
This section PASSES the design code check.

### Limit States Design using CSA O86-14 and Vibration Criterion:

| Criterion    | Analysis Value | Design Value | Unit   | Analysis/Design |
|--------------|----------------|--------------|--------|-----------------|
| Shear        | Vf = 557       | Vr = 1895    | lbs    | Vf/Vr = 0.29    |
| Moment(+)    | Mf = 1367      | Mr = 4824    | lbs-ft | Mf/Mr = 0.28    |
| Perm. Defl'n | 0.03 = <L/999  | 0.33 = L/360 | in     | 0.08            |
| Live Defl'n  | 0.05 = <L/999  | 0.25 = L/480 | in     | 0.22            |
| Total Defl'n | 0.08 = <L/999  | 0.49 = L/240 | in     | 0.17            |
| Bare Defl'n  | 0.06 = <L/999  | 0.33 = L/360 | in     | 0.19            |
| Vibration    | Lmax = 9'-10   | Lv = 15'-4   | ft     |                 |
| Defl'n       | = 0.018        | = 0.079      | in     | 0.23            |



DWG NO. TAM827B-18  
STRUCTURAL  
COMPONENT ONLY

**Additional Data:**

| FACTORS: | f/E           | KD   | KH   | KZ | KL    | KT | KS | KN | LC# |
|----------|---------------|------|------|----|-------|----|----|----|-----|
| Vr       | 1895          | 1.00 | 1.00 | -  | -     | -  | -  | -  | #2  |
| Mr+      | 4824          | 1.00 | 1.00 | -  | 1.000 | -  | -  | -  | #2  |
| EI       | 218.1 million | -    | -    | -  | -     | -  | -  | -  | #2  |

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake

L=live(use, occupancy) Ls=live(storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls \_=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**Deflection: E<sub>I</sub>eff = 268e06 lb-in<sup>2</sup> K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).

**CONFORMS TO OBC 2012**

2. Please verify that the default deflection limits are appropriate for your application.

3. Refer to technical documentation for installation guidelines and construction details.

4. Nordic I-joists are listed in CCMC evaluation report 13032-R.

5. Joists shall be laterally supported at supports and continuously along the compression edge.

6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 327B-18  
STRUCTURAL  
COMPONENT ONLY





# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basementl...B1A(i1291)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 21, 2017 12:03:10

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2 EL-1,3 DECK.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B1A(i1291

Specifier:

Designer: AJ

Company:

Misc:

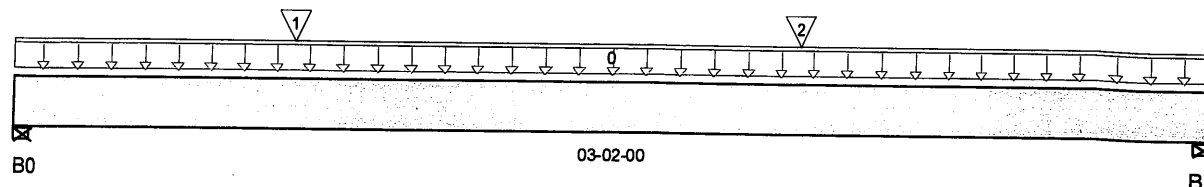

Total Horizontal Product Length = 03-02-00

## Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live    | Dead    | Snow | Wind |
|---------|---------|---------|------|------|
| B0, 4"  | 327 / 0 | 299 / 0 |      |      |
| B1, 4"  | 253 / 0 | 262 / 0 |      |      |

## Load Summary

| Tag | Description | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Trib. |
|-----|-------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0   | E1(i275)    | Unf. Lin. (lb/ft) | L    | 00-00-00 | 03-02-00 |              | 81           |              |              | n/a   |
| 1   | J3(i1263)   | Conc. Pt. (lbs)   | L    | 00-09-00 | 00-09-00 | 290          | 145          |              |              | n/a   |
| 2   | J3(i1285)   | Conc. Pt. (lbs)   | L    | 02-01-00 | 02-01-00 | 290          | 145          |              |              | n/a   |

## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 516 ft-lbs      | 12,704 ft-lbs       | 4.1%                | 1         | 02-01-00 |
| End Shear        | 554 lbs         | 5,785 lbs           | 9.6%                | 1         | 02-00-08 |
| Total Load Defl. | L/999 (0.002")  | n/a                 | n/a                 | 4         | 01-07-00 |
| Live Load Defl.  | L/999 (0.001")  | n/a                 | n/a                 | 5         | 01-07-05 |
| Max Defl.        | 0.002"          | n/a                 | n/a                 | 4         | 01-07-00 |
| Span / Depth     | 3.3             | n/a                 | n/a                 |           | 00-00-00 |

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

|                  |              |             | Demand/<br>Resistance<br>Support | Demand/<br>Resistance<br>Member | Material    |
|------------------|--------------|-------------|----------------------------------|---------------------------------|-------------|
| Bearing Supports | Dim. (L x W) | Demand      |                                  |                                 |             |
| B0               | Wall/Plate   | 4" x 1-3/4" | 865 lbs                          | 23.1%                           | 10.1%       |
| B1               | Wall/Plate   | 4" x 1-3/4" | 707 lbs                          | 18.9%                           | 8.3%        |
|                  |              |             |                                  |                                 | Unspecified |
|                  |              |             |                                  |                                 | Unspecified |

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B1(i895)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:58

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: HIGHGROVE 2.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B1(i895)

Specifier:

Designer: AJ

Company:

Msc:

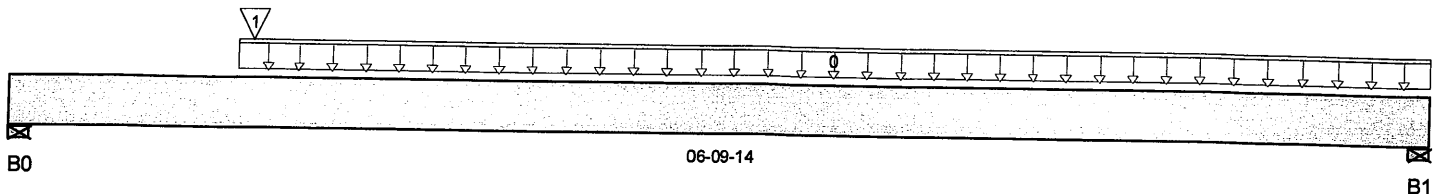

Total Horizontal Product Length = 06-09-14

## Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live      | Dead    | Snow | Wind |
|------------|-----------|---------|------|------|
| B0, 4"     | 1,069 / 0 | 582 / 0 |      |      |
| B1, 4-3/8" | 255 / 0   | 163 / 0 |      |      |

## Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 01-01-00 | 06-09-14 | 27           | 13           |              |              | n/a   |
| 1   | B7(i916)           | Conc. Pt. (lbs)   | L    | 01-01-14 | 01-01-14 | 1,162        | 598          |              |              | n/a   |

## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 2,046 ft-lbs    | 25,408 ft-lbs       | 8.1%                | 1         | 01-01-14 |
| End Shear        | 2,311 lbs       | 11,571 lbs          | 20%                 | 1         | 01-01-08 |
| Total Load Defl. | L/999 (0.016")  | n/a                 | n/a                 | 4         | 03-00-11 |
| Live Load Defl.  | L/999 (0.01")   | n/a                 | n/a                 | 5         | 03-00-11 |
| Max Defl.        | 0.016"          | n/a                 | n/a                 | 4         | 03-00-11 |
| Span / Depth     | 7.9             | n/a                 | n/a                 |           | 00-00-00 |

## Bearing Supports

|               | Dim. (L x W)    | Demand    | Demand / Resistance Support | Demand / Resistance Member | Material    |
|---------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Wall/Plate | 4" x 3-1/2"     | 2,331 lbs | 39%                         | 13.6%                      | Unspecified |
| B1 Wall/Plate | 4-3/8" x 3-1/2" | 586 lbs   | 9%                          | 3.1%                       | Unspecified |

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012



DWG NO. TAM 47762-17  
STRUCTURAL  
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B1(i895)**

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:58

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B1(i895

Specifier:

Designer: AJ

Company:

Misc:

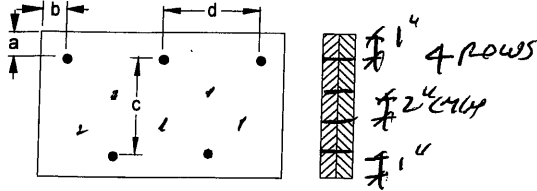**Connection Diagram**

a minimum = 1" c = 1-1/2"  
 b minimum = 3" d = 6"

Calculated Side Load = 365.0 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Spike Nails

**3 1/2" ARDOX SPIRAL****Disclosure**

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 47762-17  
 STRUCTURAL  
 COMPONENT ONLY



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basment\Flush Beams\B2(i875)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:58

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2.mmdl


Description: Designs\Flush Beams\Basment\Flush Beams\B2(i875)

Specifier:

Designer: AJ

Company:

Misc:

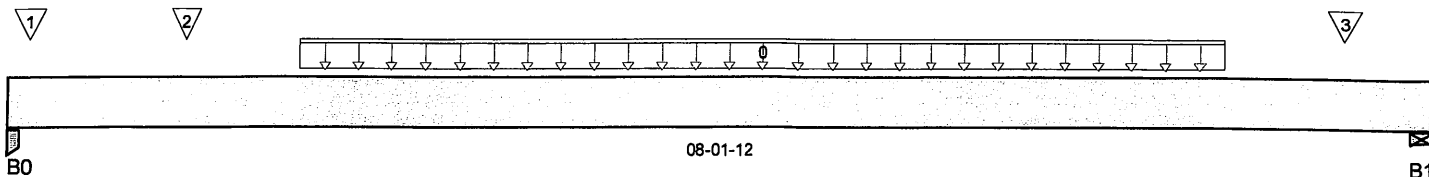

Total Horizontal Product Length = 08-01-12

## Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live      | Dead    | Snow | Wind |
|------------|-----------|---------|------|------|
| B0, 3-1/2" | 1,153 / 0 | 615 / 0 |      |      |
| B1, 4-3/8" | 963 / 0   | 521 / 0 |      |      |

## Load Summary

| Tag | Description   | Load Type         | Ref. | Start    | End      | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------|-------------------|------|----------|----------|-----------|-----------|-----------|-----------|-------|
| 0   | Smoothed Load | Unf. Lin. (lb/ft) | L    | 01-07-14 | 06-11-14 | 246       | 123       |           |           | n/a   |
| 1   | -             | Conc. Pt. (lbs)   | L    | 00-01-07 | 00-01-07 | 293       | 146       |           |           | n/a   |
| 2   | J3(i877)      | Conc. Pt. (lbs)   | L    | 00-11-14 | 00-11-14 | 270       | 135       |           |           | n/a   |
| 3   | J3(i890)      | Conc. Pt. (lbs)   | L    | 07-07-14 | 07-07-14 | 236       | 118       |           |           | n/a   |

## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 3,862 ft-lbs    | 25,408 ft-lbs       | 15.2%               | 1         | 03-07-14 |
| End Shear        | 1,794 lbs       | 11,571 lbs          | 15.5%               | 1         | 01-01-00 |
| Total Load Defl. | L/999 (0.056")  | n/a                 | n/a                 | 4         | 04-00-14 |
| Live Load Defl.  | L/999 (0.037")  | n/a                 | n/a                 | 5         | 04-00-14 |
| Max Defl.        | 0.056"          | n/a                 | n/a                 | 4         | 04-00-14 |
| Span / Depth     | 9.6             | n/a                 | n/a                 |           | 00-00-00 |

| Bearing Supports | Dim. (L x W)    | Demand    | Demand / Resistance Support | Demand / Resistance Member | Material    |
|------------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Post          | 3-1/2" x 3-1/2" | 2,499 lbs | 31.4%                       | 16.7%                      | Unspecified |
| B1 Wall/Plate    | 4-3/8" x 3-1/2" | 2,096 lbs | 32%                         | 11.2%                      | Unspecified |

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012



DWG NO. TAM47763-17  
STRUCTURAL  
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B2(i875)**

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:58

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B2(i875

Specifier:

Designer: AJ

Company:

Misc:

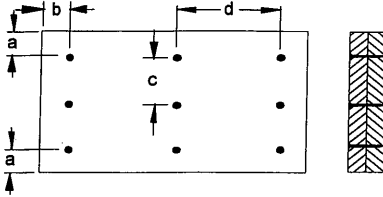**Connection Diagram**

a minimum = 2"      c = 2-3/4"  
 b minimum = 3"      d = 6"

Calculated Side Load = 532.4 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Sinker Nails

**3 1/2" ARDOX SPIRAL****Disclosure**

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 47763-17  
 STRUCTURAL  
 COMPONENT ONLY



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B3(i917)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:58

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B3(i917)

Specifier:

Designer: AJ

Company:

Misc:

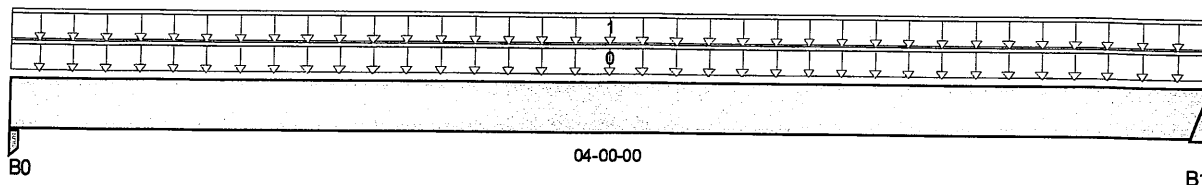

Total Horizontal Product Length = 04-00-00

## Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live    | Dead    | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 1-3/4" | 523 / 0 | 271 / 0 |      |      |
| B1         | 523 / 0 | 271 / 0 |      |      |

## Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0   | User Load          | Unf. Lin. (lb/ft) | L    | 00-00-00 | 04-00-00 | 240          | 120          |              |              | n/a   |
| 1   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 04-00-00 | 20           | 10           |              |              | n/a   |

## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 1,016 ft-lbs    | 12,704 ft-lbs       | 8%                  | 1         | 01-11-14 |
| End Shear        | 588 lbs         | 5,785 lbs           | 10.2%               | 1         | 00-11-04 |
| Total Load Defl. | L/999 (0.008")  | n/a                 | n/a                 | 4         | 01-11-14 |
| Live Load Defl.  | L/999 (0.005")  | n/a                 | n/a                 | 5         | 01-11-14 |
| Max Defl.        | 0.008"          | n/a                 | n/a                 | 4         | 01-11-14 |
| Span / Depth     | 4.8             | n/a                 | n/a                 |           | 00-00-00 |

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

|           | Dim. (L x W)    | Demand    | Demand / Resistance Support | Demand / Resistance Member | Material    |
|-----------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Post   | 1-3/4" x 1-3/4" | 1,124 lbs | 56.5%                       | 30.1%                      | Unspecified |
| B1 Hanger | 2" x 1-3/4"     | 1,124 lbs | n/a                         | 26.3%                      | HUS1.81/10  |

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 47764-17  
STRUCTURAL  
COMPONENT AND V



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B4(i886)

BC CALC® Design Report



Dry | 2 spans | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:58

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B4(i886)

Specifier:

Designer: AJ

Company:

Misc:

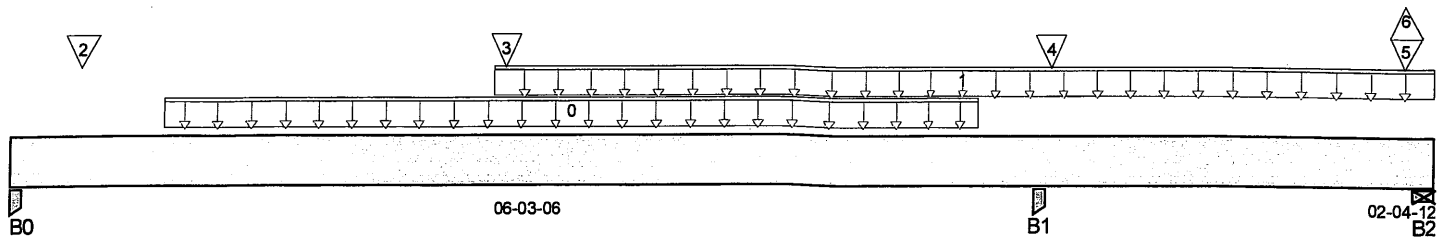

Total Horizontal Product Length = 08-08-02

## Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live          | Dead      | Snow | Wind |
|------------|---------------|-----------|------|------|
| B0, 1-3/4" | 1,331 / 0     | 697 / 0   |      |      |
| B1, 3-1/2" | 3,438 / 0     | 1,809 / 0 |      |      |
| B2, 4-3/8" | 2,555 / 1,174 | 830 / 0   |      |      |

## Load Summary

| Tag | Description         | Load Type         | Ref. | Start    | End      | Live 1.00 | Dead 0.65 | Snow 1.00 | Wind 1.15 | Trib. |
|-----|---------------------|-------------------|------|----------|----------|-----------|-----------|-----------|-----------|-------|
| 0   | Smoothed Load       | Unf. Lin. (lb/ft) | L    | 00-11-00 | 05-11-00 | 327       | 164       |           |           | n/a   |
| 1   | FC 1 Floor Material | Unf. Lin. (lb/ft) | L    | 02-11-04 | 08-08-02 | 15        | 8         |           |           | n/a   |
| 2   | J1(i892)            | Conc. Pt. (lbs)   | L    | 00-05-00 | 00-05-00 | 306       | 153       |           |           | n/a   |
| 3   | B7(i916)            | Conc. Pt. (lbs)   | L    | 03-00-02 | 03-00-02 | 1,180     | 607       |           |           | n/a   |
| 4   | B3(i917)            | Conc. Pt. (lbs)   | L    | 06-04-04 | 06-04-04 | 512       | 266       |           |           | n/a   |
| 5   | 3(i379)             | Conc. Pt. (lbs)   | L    | 08-05-15 | 08-05-15 | 2,528     | 1,355     |           |           | n/a   |
| 6   | 3(i379)             | Conc. Pt. (lbs)   | L    | 08-05-15 | 08-05-15 | -120      |           |           |           | n/a   |


## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 5,110 ft-lbs    | 25,408 ft-lbs       | 20.1%               | 3         | 03-00-02 |
| Neg. Moment      | -4,759 ft-lbs   | -25,408 ft-lbs      | 18.7%               | 1         | 06-03-06 |
| End Shear        | 2,428 lbs       | 11,571 lbs          | 21%                 | 1         | 00-11-04 |
| Cont. Shear      | 3,879 lbs       | 11,571 lbs          | 33.5%               | 1         | 05-04-02 |
| Uplift           | 1,014 lbs       | n/a                 | n/a                 | 7         | 08-08-02 |
| Total Load Defl. | L/999 (0.037")  | n/a                 | n/a                 | 12        | 02-10-07 |
| Live Load Defl.  | L/999 (0.024")  | n/a                 | n/a                 | 16        | 02-10-07 |
| Total Neg. Defl. | L/999 (-0.003") | n/a                 | n/a                 | 12        | 07-02-00 |
| Max Defl.        | 0.037"          | n/a                 | n/a                 | 12        | 02-10-07 |
| Span / Depth     | 7.8             | n/a                 | n/a                 |           | 00-00-00 |

## Bearing Supports

|               | Dim. (L x W)    | Demand    | Demand / Resistance Support | Demand / Resistance Member | Material    |
|---------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Post       | 1-3/4" x 3-1/2" | 2,868 lbs | 72.1%                       | 38.4%                      | Unspecified |
| B1 Post       | 3-1/2" x 3-1/2" | 7,417 lbs | 93.2%                       | 49.6%                      | Unspecified |
| B2 Wall/Plate | 4-3/8" x 3-1/2" | 4,870 lbs | 74.4%                       | 26.1%                      | Unspecified |

## Cautions

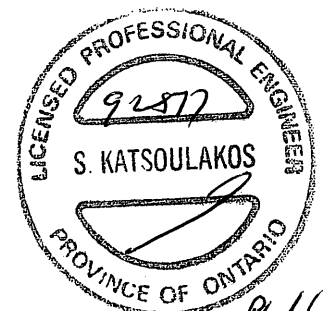

DWG NO. TAM 47765-17  
STRUCTURAL  
COMPONENT ONLY



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B4(i886)

Dry | 2 spans | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:58

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2.mmdl

Description: Designs\Flush Beams\Basement\Flush Beams\B4(i886

Specifier:

Designer: AJ

Company:

Misc:

Uplift of 1,014 lbs found at span 2 - Right. (Simpson 2-brace @ B2)

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

**CONFORMS TO OBC 2012**

## Connection Diagram

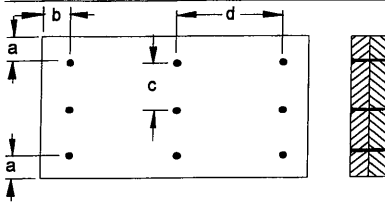

a minimum = 2" c = 2-3/4"  
b minimum = 3" d = 6"

Calculated Side Load = 602.1 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.


Connectors are: 16d <sup>1</sup>/<sub>4</sub>" Nails

**3 1/2" ARDOX SPIRAL**

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

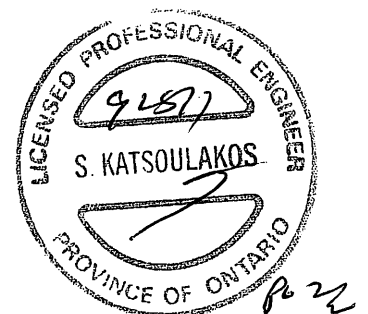

DWG NO. TAM 47765-17  
STRUCTURAL  
COMPONENT ONLY



BC CALC® Design Report

Dry | 1 span | No cant.

February 8, 2018 16:48:32

Build 6215

Job name:

File name: HIGHGROVE 2 EL-1,3.mmdl

Address:

Description: Basement\Flush Beams\B5(i3416)

City, Province, Postal Code: WAT...WN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

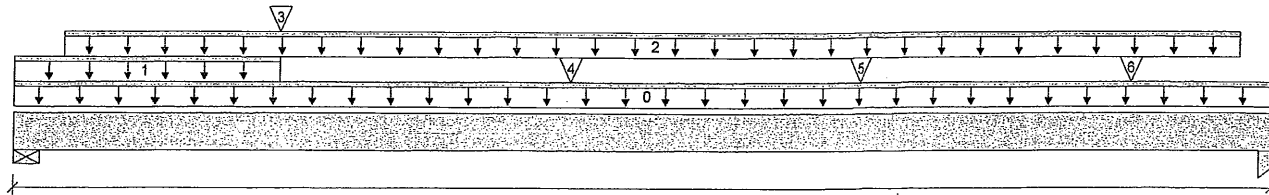

Total Horizontal Product Length = 05-09-10

### Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live    | Dead    | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 2-1/8" | 530 / 0 | 451 / 0 |      |      |
| B1, 2-3/4" | 642 / 0 | 515 / 0 |      |      |

### Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 05-09-10 |              | 10           |              |              | 00-00-00  |
| 1   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 01-02-10 | 21           | 10           |              |              | n/a       |
| 2   | User Load          | Unf. Lin. (lb/ft) | L    | 00-02-10 | 05-07-14 |              | 60           |              |              | n/a       |
| 3   | J3(i3419)          | Conc. Pt. (lbs)   | L    | 01-02-10 | 01-02-10 | 282          | 140          |              |              | n/a       |
| 4   | J3(i3412)          | Conc. Pt. (lbs)   | L    | 02-06-10 | 02-06-10 | 297          | 148          |              |              | n/a       |
| 5   | J3(i3425)          | Conc. Pt. (lbs)   | L    | 03-10-10 | 03-10-10 | 290          | 145          |              |              | n/a       |
| 6   | J3(i3411)          | Conc. Pt. (lbs)   | L    | 05-01-14 | 05-01-14 | 269          | 134          |              |              | n/a       |

### Controls Summary

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 2,168 ft-lbs    | 23,220 ft-lbs       | 9.3%              | 1    | 02-06-10 |
| End Shear             | 1,304 lbs       | 11,571 lbs          | 11.3%             | 1    | 00-11-10 |
| Total Load Deflection | L/999 (0.017")  | n/a                 | n/a               | 4    | 02-10-10 |
| Live Load Deflection  | L/999 (0.009")  | n/a                 | n/a               | 5    | 02-10-10 |
| Max Defl.             | 0.017"          | n/a                 | n/a               | 4    | 02-10-10 |
| Span / Depth          | 7.0             |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand    | Demand/Resistance Support | Demand/Resistance Member | Material    |
|------------------|----------------------------|-----------|---------------------------|--------------------------|-------------|
| B0               | Wall/Plate 2-1/8" x 3-1/2" | 1,359 lbs | 34.2%                     | 15.0%                    | Unspecified |
| B1               | Column 2-3/4" x 3-1/2"     | 1,606 lbs | 20.6%                     | 13.7%                    | Unspecified |

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.


CONFORMS TO OBC 2012

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.



DWG NO. TAM 8658  
STRUCTURAL  
COMPONENT ONLY



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

Basement\Flush Beams\B5(i3416)

Dry | 1 span | No cant.

February 8, 2018 16:48:32

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

File name: HIGHGROVE 2 EL-1,3.mmdl


Description: Basement\Flush Beams\B5(i3416)

Specifier:

Designer: AJ

Company:

## Connection Diagram

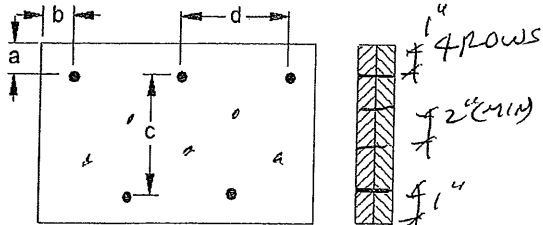

a minimum = 1/2"

b minimum = 3"

c = 1-1/2"

d = 6"

Calculated Side Load = 416.4 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

## Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



DWG NO. TAM 0658  
STRUCTURAL  
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJST®, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B6(i901)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:59

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B6(i901)

Specifier:

Designer: AJ

Company:

Misc:

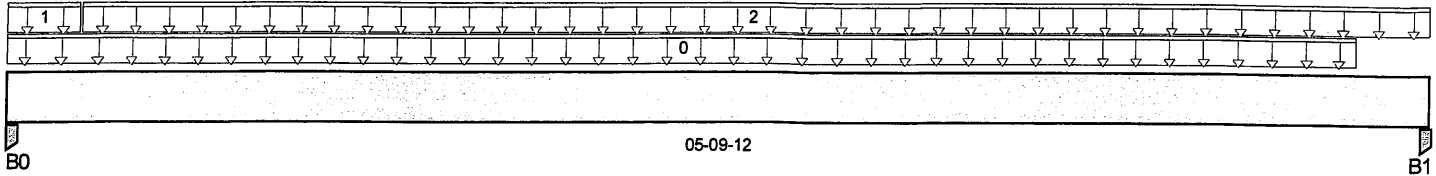

Total Horizontal Product Length = 05-09-12

## Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live   | Dead    | Snow | Wind |
|------------|--------|---------|------|------|
| B0, 3-1/2" | 32 / 0 | 204 / 0 |      |      |
| B1, 3-1/2" | 33 / 0 | 187 / 0 |      |      |

## Load Summary

| Tag | Description         | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Trib. |
|-----|---------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0   | User Load           | Unf. Lin. (lb/ft) | L    | 00-00-00 | 05-06-04 |              | 60           |              |              | n/a   |
| 1   | FC 1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 00-03-08 | 10           |              |              |              | n/a   |
| 2   | FC 1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-03-08 | 05-09-12 | 11           | 6            |              |              | n/a   |

## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 353 ft-lbs      | 8,258 ft-lbs        | 4.3%                | 0         | 02-10-14 |
| End Shear        | 180 lbs         | 3,761 lbs           | 4.8%                | 0         | 01-01-00 |
| Total Load Defl. | L/999 (0.006")  | n/a                 | n/a                 | 4         | 02-10-14 |
| Live Load Defl.  | L/999 (0.001")  | n/a                 | n/a                 | 5         | 02-10-14 |
| Max Defl.        | 0.006"          | n/a                 | n/a                 | 4         | 02-10-14 |
| Span / Depth     | 6.8             | n/a                 | n/a                 |           | 00-00-00 |

## Bearing Supports

|         | Dim. (L x W)    | Demand  | Demand / Resistance Support | Demand / Resistance Member | Material    |
|---------|-----------------|---------|-----------------------------|----------------------------|-------------|
| B0 Post | 3-1/2" x 1-3/4" | 286 lbs | 11.1%                       | 5.9%                       | Unspecified |
| B1 Post | 3-1/2" x 1-3/4" | 262 lbs | 10.1%                       | 5.4%                       | Unspecified |

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

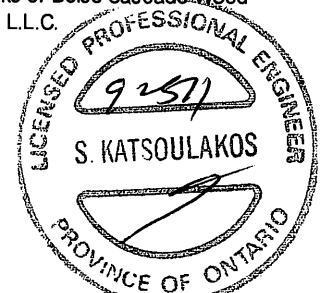

DWG NO. TAM47767-17  
STRUCTURAL  
COMPONENT ONLY



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B7(i916)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:59

BC CALC® Design Report



Build 5033

File Name: HIGHGROVE 2.mmdl

Job Name:

Description: Designs\Flush Beams\Basement\Flush Beams\B7(i916)

Address:

Specifier:

City, Province, Postal Code: WATERDOWN,

Designer: AJ


Customer:

Company:

Code reports:

CCMC 12472-R

Misc:

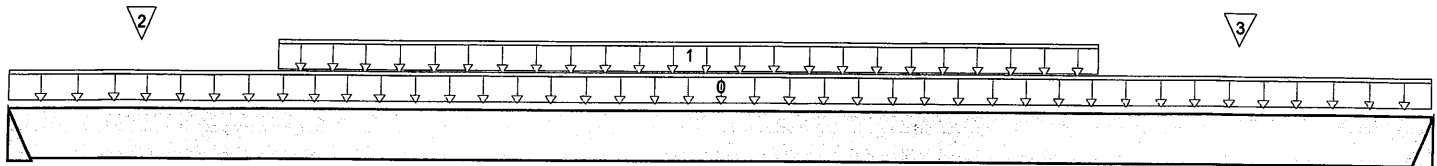

B0

06-10-04

B1

Total Horizontal Product Length = 06-10-04

## Reaction Summary (Down / Uplift) (lbs)

| Bearing | Live      | Dead    | Snow | Wind |
|---------|-----------|---------|------|------|
| B0      | 1,180 / 0 | 607 / 0 |      |      |
| B1      | 1,162 / 0 | 598 / 0 |      |      |

## Load Summary

| Tag | Description   | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Trib. |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0   | User Load     | Unf. Lin. (lb/ft) | L    | 00-00-00 | 06-10-04 | 240          | 120          |              |              | n/a   |
| 1   | Smoothed Load | Unf. Lin. (lb/ft) | L    | 01-03-04 | 05-03-04 | 112          | 56           |              |              | n/a   |
| 2   | J5(i911)      | Conc. Pt. (lbs)   | L    | 00-07-04 | 00-07-04 | 116          | 58           |              |              | n/a   |
| 3   | J5(i898)      | Conc. Pt. (lbs)   | L    | 05-11-04 | 05-11-04 | 134          | 67           |              |              | n/a   |

## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 4,172 ft-lbs    | 12,704 ft-lbs       | 32.8%               | 1         | 03-03-04 |
| End Shear        | 1,981 lbs       | 5,785 lbs           | 34.2%               | 1         | 05-10-12 |
| Total Load Defl. | L/999 (0.093")  | n/a                 | n/a                 | 4         | 03-05-04 |
| Live Load Defl.  | L/999 (0.061")  | n/a                 | n/a                 | 5         | 03-05-04 |
| Max Defl.        | 0.093"          | n/a                 | n/a                 | 4         | 03-05-04 |
| Span / Depth     | 8.4             | n/a                 | n/a                 |           | 00-00-00 |

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

|           | Dim. (L x W) | Demand    | Demand / Resistance Support | Demand / Resistance Member | Material   |
|-----------|--------------|-----------|-----------------------------|----------------------------|------------|
| B0 Hanger | 2" x 1-3/4"  | 2,530 lbs | n/a                         | 59.2%                      | HUS1.81/10 |
| B1 Hanger | 2" x 1-3/4"  | 2,491 lbs | n/a                         | 58.3%                      | HUS1.81/10 |

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

DWG NO. TAM 4176B 17  
STRUCTURAL  
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products LLC.





# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B8(i914)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 10:33:59

Build 5033

File Name: HIGHGROVE 2.mmdl

Job Name:

Description: Designs\Flush Beams\Basement\Flush Beams\B8(i914)

Address:

Specifier:

City, Province, Postal Code: WATERDOWN,

Designer: AJ


Customer:

Company:

Code reports:

CCMC 12472-R

Misc:

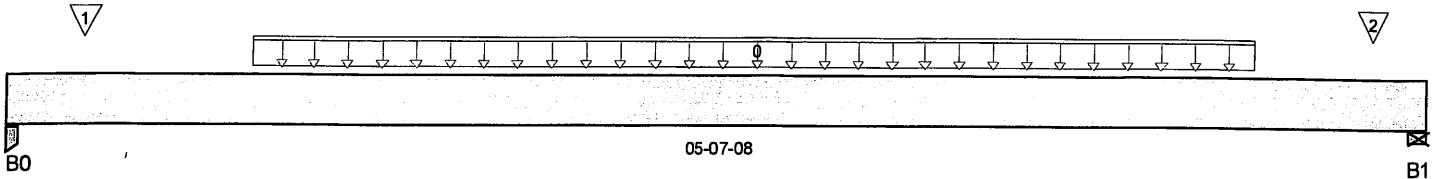

Total Horizontal Product Length = 05-07-08

## Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live    | Dead    | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 3-1/2" | 521 / 0 | 274 / 0 |      |      |
| B1, 3-1/2" | 488 / 0 | 652 / 0 |      |      |

## Load Summary

| Tag | Description   | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Trib. |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0   | Smoothed Load | Unf. Lin. (lb/ft) | L    | 00-11-08 | 04-11-08 | 187          | 93           |              |              | n/a   |
| 1   | J4 (i907)     | Conc. Pt. (lbs)   | L    | 00-03-08 | 00-03-08 | 171          | 86           |              |              | n/a   |
| 2   | E5 (i274)     | Conc. Pt. (lbs)   | L    | 05-04-12 | 05-04-12 | 91           | 441          |              |              | n/a   |

## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 1,368 ft-lbs    | 12,704 ft-lbs       | 10.8%               | 1         | 02-11-08 |
| End Shear        | 852 lbs         | 5,785 lbs           | 14.7%               | 1         | 04-06-08 |
| Total Load Defl. | L/999 (0.018")  | n/a                 | n/a                 | 4         | 02-09-08 |
| Live Load Defl.  | L/999 (0.012")  | n/a                 | n/a                 | 5         | 02-09-08 |
| Max Defl.        | 0.018"          | n/a                 | n/a                 | 4         | 02-09-08 |
| Span / Depth     | 6.5             | n/a                 | n/a                 |           | 00-00-00 |

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

## Bearing Supports

|               | Dim. (L x W)    | Demand    | Demand / Resistance Support | Demand / Resistance Member | Material    |
|---------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Post       | 3-1/2" x 1-3/4" | 1,125 lbs | 28.3%                       | 15.1%                      | Unspecified |
| B1 Wall/Plate | 3-1/2" x 1-3/4" | 1,546 lbs | 59.1%                       | 20.7%                      | Unspecified |

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO DBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 47769-17  
STRUCTURAL  
COMPONENT ONLY

**1st Floor\Flush Beams\B9(i1301)**

Dry | 1 span | No cant.

February 7, 2018 16:58:39

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R


File name: HIGHGROVE 2 EL-2.mmdl

Description: 1st Floor\Flush Beams\B9(i1301)

Specifier:

Designer: AJ

Company:

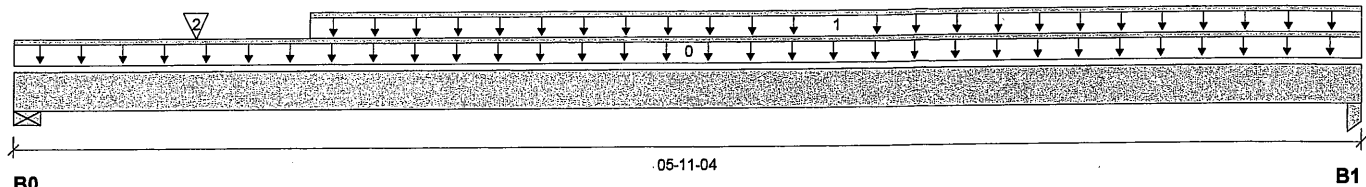

Total Horizontal Product Length = 05-11-04

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live      | Dead    | Snow | Wind |
|------------|-----------|---------|------|------|
| B0, 3-1/8" | 851 / 0   | 455 / 0 |      |      |
| B1, 2-5/8" | 1,095 / 0 | 575 / 0 |      |      |

**Load Summary**

| Tag | Description   | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|---------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight   | Unf. Lin. (lb/ft) | L    | 00-00-00 | 05-11-04 |              | 10           |              |              | 00-00-00  |
| 1   | Smoothed Load | Unf. Lin. (lb/ft) | L    | 01-03-10 | 05-11-04 | 356          | 178          |              |              | n/a       |
| 2   | J1(i1304)     | Conc. Pt. (lbs)   | L    | 00-09-10 | 00-09-10 | 297          | 149          |              |              | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 2,792 ft-lbs    | 23,220 ft-lbs       | 12.0%             | 1    | 02-09-10 |
| End Shear             | 1,651 lbs       | 11,571 lbs          | 14.3%             | 1    | 04-11-02 |
| Total Load Deflection | L/999 (0.022")  | n/a                 | n/a               | 4    | 02-11-14 |
| Live Load Deflection  | L/999 (0.014")  | n/a                 | n/a               | 5    | 02-11-14 |
| Max Defl.             | 0.022"          | n/a                 | n/a               | 4    | 02-11-14 |
| Span / Depth          | 7.1             |                     |                   |      |          |

**Bearing Supports**

|    | Dim. (LxW)                 | Demand    | Demand/Resistance Support | Demand/Resistance Member | Material    |
|----|----------------------------|-----------|---------------------------|--------------------------|-------------|
| B0 | Wall/Plate 3-1/8" x 3-1/2" | 1,845 lbs | 31.6%                     | 13.8%                    | Unspecified |
| B1 | Column 2-5/8" x 3-1/2"     | 2,362 lbs | 31.7%                     | 21.1%                    | Unspecified |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

CONFORMS TO OBC 2012

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.


 DWG NO. TAM B226-18  
 STRUCTURAL  
 COMPONENT ONLY

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

File name: HIGHGROVE 2 EL-2.mmdl


Description: 1st Floor\Flush Beams\B9(i1301)

Specifier:

Designer: AJ

Company:

## Connection Diagram

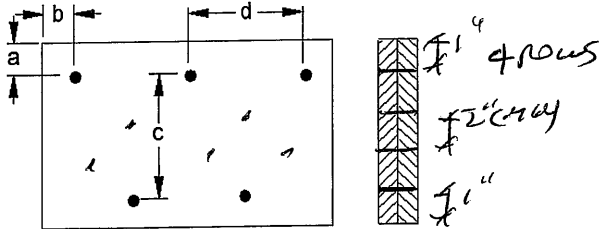

a minimum = 1"  
b minimum = 3"  
c = 1-1/2"  
d = 6"

Calculated Side Load = 696.5 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

## Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. TAM 0276-18 104  
STRUCTURAL  
COMPONENT ONLY





# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\...\B9A(i1096)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 5, 2017 11:21:32

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2 EL-1,3.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B9A(i1096)

Specifier:

Designer: AJ

Company:

Misc:

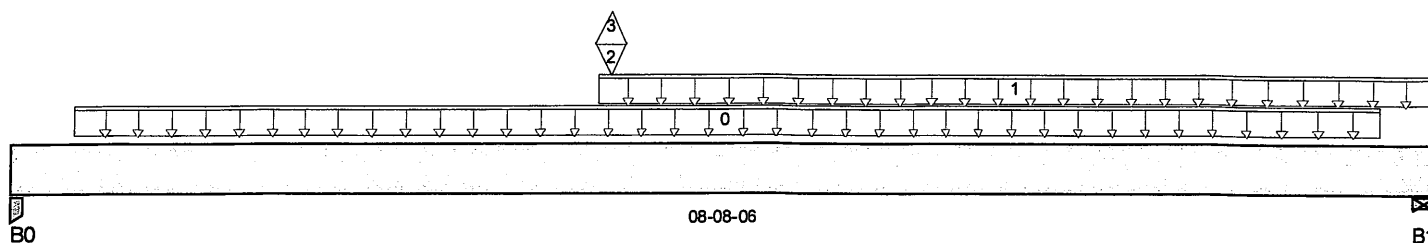

Total Horizontal Product Length = 08-08-06

## Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live        | Dead    | Snow | Wind |
|------------|-------------|---------|------|------|
| B0, 2-5/8" | 1,841 / 129 | 907 / 0 |      |      |
| B1, 5-1/2" | 1,851 / 98  | 928 / 0 |      |      |

## Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Trib. |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-------|
| 0   | Smoothed Load      | Unf. Lin. (lb/ft) | L    | 00-04-06 | 08-04-06 | 326          | 164          |              |              | n/a   |
| 1   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 03-07-00 | 08-08-06 | 22           | 11           |              |              | n/a   |
| 2   | -                  | Conc. Pt. (lbs)   | L    | 03-07-14 | 03-07-14 | 951          | 380          |              |              | n/a   |
| 3   | -                  | Conc. Pt. (lbs)   | L    | 03-07-14 | 03-07-14 | -227         |              |              |              | n/a   |

## Controls Summary

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 9,788 ft-lbs    | 25,408 ft-lbs       | 38.5%               | 1         | 03-07-14 |
| End Shear        | 3,755 lbs       | 11,571 lbs          | 32.4%               | 1         | 01-00-02 |
| Total Load Defl. | L/635 (0.154")  | 0.407"              | 37.8%               | 6         | 04-01-06 |
| Live Load Defl.  | L/999 (0.104")  | n/a                 | n/a                 | 8         | 04-01-06 |
| Max Defl.        | 0.154"          | n/a                 | n/a                 | 6         | 04-01-06 |
| Span / Depth     | 10.3            | n/a                 | n/a                 |           | 00-00-00 |

## Bearing Supports

|               | Dim. (L x W)    | Demand    | Demand / Resistance Support | Demand / Resistance Member | Material    |
|---------------|-----------------|-----------|-----------------------------|----------------------------|-------------|
| B0 Post       | 2-5/8" x 3-1/2" | 3,896 lbs | 52.2%                       | 34.8%                      | Unspecified |
| B1 Wall/Plate | 5-1/2" x 3-1/2" | 3,937 lbs | 38.3%                       | 16.8%                      | Unspecified |

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012



DWG NO. TAM 47760 17  
STRUCTURAL  
COMPONENT ONLY





# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\...\B9A(i1096)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 5, 2017 11:21:32

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2 EL-1,3.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B9A(i1096)


Specifier:

Designer: AJ

Company:

Misc:

## Connection Diagram

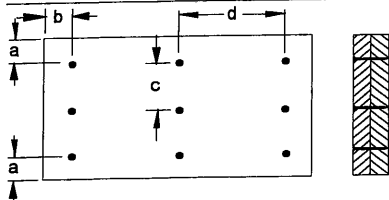

a minimum = 2"    c = 2-3/4"  
b minimum = 3"    d = 4"

Calculated Side Load = 638.8 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails  
3 1/2" ARDOX SPIRAL

## Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 47760-17  
STRUCTURAL  
COMPONENT ONLY

1st Floor\Flush Beams\B11(i1203)

Dry | 1 span | No cant.

February 7, 2018 16:58:49

BC CALC® Design Report

Build 6215

Job name:

File name: HIGHGROVE 2 EL-2.mmdl

Address:

Description: 1st Floor\Flush Beams\B11(i1203)

City, Province, Postal Code: WAT...WN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

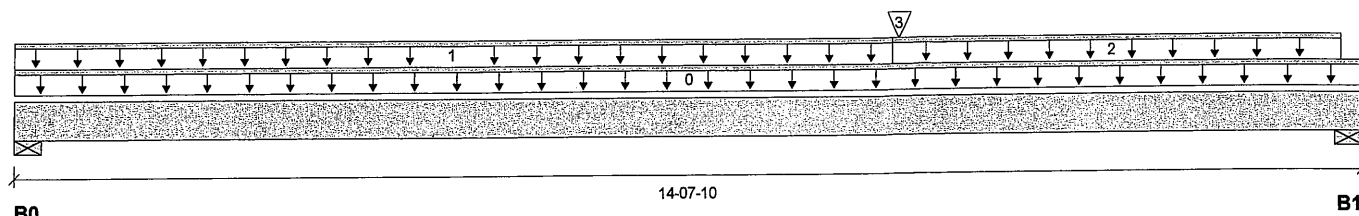

Total Horizontal Product Length = 14-07-10

Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live    | Dead    | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 3-1/8" | 265 / 0 | 207 / 0 |      |      |
| B1, 5-1/2" | 478 / 0 | 321 / 0 |      |      |

Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 14-07-10 |              | 10           |              |              | 00-00-00  |
| 1   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 09-06-04 | 13           | 6            |              |              | n/a       |
| 2   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 09-06-04 | 14-04-14 | 27           | 13           |              |              | n/a       |
| 3   | B12(i1176)         | Conc. Pt. (lbs)   | L    | 09-07-02 | 09-07-02 | 494          | 263          |              |              | n/a       |

Controls Summary

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 4,392 ft-lbs    | 23,220 ft-lbs       | 18.9%             | 1    | 09-07-02 |
| End Shear             | 1,046 lbs       | 11,571 lbs          | 9.0%              | 1    | 13-04-10 |
| Total Load Deflection | L/897 (0.188")  | n/a                 | 26.8%             | 4    | 07-08-00 |
| Live Load Deflection  | L/999 (0.112")  | n/a                 | n/a               | 5    | 07-09-10 |
| Max Defl.             | 0.188"          | n/a                 | n/a               | 4    | 07-08-00 |
| Span / Depth          | 17.7            |                     |                   |      |          |

Bearing Supports

|    | Dim. (LxW)                 | Demand    | Demand/Resistance Support | Demand/Resistance Member | Material    |
|----|----------------------------|-----------|---------------------------|--------------------------|-------------|
| B0 | Wall/Plate 3-1/8" x 3-1/2" | 656 lbs   | 11.2%                     | 4.9%                     | Unspecified |
| B1 | Wall/Plate 5-1/2" x 3-1/2" | 1,119 lbs | 10.9%                     | 4.8%                     | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

CONFORMS TO OBC 2012

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.



DWG NO. TAM B225-18  
STRUCTURAL  
COMPONENT ONLY



BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

File name: HIGHGROVE 2 EL-2.mmdl


Description: 1st Floor Flush Beams\B11(i1203)

Specifier:

Designer: AJ

Company:

## Connection Diagram

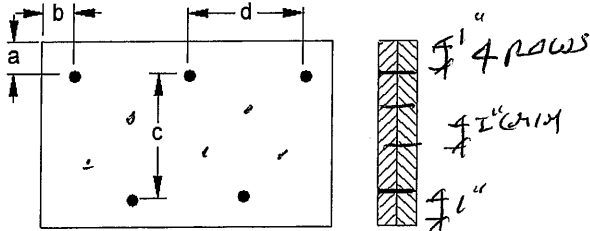

a minimum = 1"  
b minimum = 3"

c = 1-1/2"  
d = 6"

Calculated Side Load = 73.1 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: Nails

3-1/2" ARDOX SPIRAL

## Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®  
DWG NO. TAM 8275-18  
STRUCTURAL COMPONENT ONLY



Boise Cascade

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\Flush Beams\B12(i1131)**

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 12, 2017 15:30:18

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 2 EL-1,3.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B12(i1131)

Specifier:

Designer: AJ

Company:

Misc:

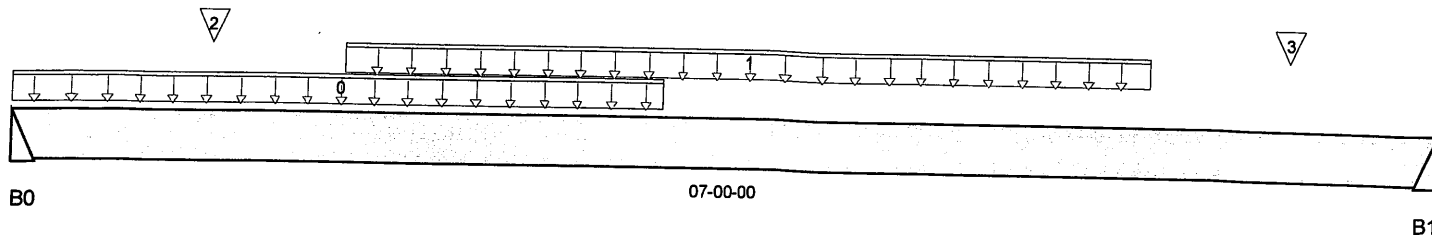

Total Horizontal Product Length = 07-00-00

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing | Live    | Dead    | Snow | Wind |
|---------|---------|---------|------|------|
| B0      | 901 / 0 | 467 / 0 |      |      |
| B1      | 485 / 0 | 259 / 0 |      |      |

**Load Summary**

| Tag | Description   | Load Type         | Ref. | Start    | End      | Live | Dead | Snow | Wind | Trib. |
|-----|---------------|-------------------|------|----------|----------|------|------|------|------|-------|
| 0   | User Load     | Unf. Lin. (lb/ft) | L    | 00-00-00 | 03-02-08 | 240  | 120  | 1.00 | 1.15 | n/a   |
| 1   | Smoothed Load | Unf. Lin. (lb/ft) | L    | 01-07-08 | 05-07-08 | 98   | 49   |      |      | n/a   |
| 2   | J4(i1154)     | Conc. Pt. (lbs)   | L    | 00-11-08 | 00-11-08 | 119  | 59   |      |      | n/a   |
| 3   | J4(i1132)     | Conc. Pt. (lbs)   | L    | 06-03-08 | 06-03-08 | 107  | 53   |      |      | n/a   |

**Controls Summary**

|                  | Factored Demand | Factored Resistance | Demand / Resistance | Load Case | Location |
|------------------|-----------------|---------------------|---------------------|-----------|----------|
| Pos. Moment      | 2,593 ft-lbs    | 12,704 ft-lbs       | 20.4%               | 1         | 02-09-00 |
| End Shear        | 1,441 lbs       | 5,785 lbs           | 24.9%               | 1         | 00-11-08 |
| Total Load Defl. | L/999 (0.058")  | n/a                 | n/a                 | 4         | 03-03-12 |
| Live Load Defl.  | L/999 (0.038")  | n/a                 | n/a                 | 5         | 03-03-12 |
| Max Defl.        | 0.058"          | n/a                 | n/a                 | 4         | 03-03-12 |
| Span / Depth     | 8.6             | n/a                 | n/a                 |           | 00-00-00 |

**Bearing Supports**

|           | Dim. (L x W) | Demand    | Demand / Resistance Support | Demand / Resistance Member | Material   |
|-----------|--------------|-----------|-----------------------------|----------------------------|------------|
| B0 Hanger | 2" x 1-3/4"  | 1,935 lbs | n/a                         | 45.3%                      | HUS1.81/10 |
| B1 Hanger | 2" x 1-3/4"  | 1,051 lbs | n/a                         | 24.6%                      | HUS1.81/10 |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

**CONFORMS TO DBC 2012****Disclosure**

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



1st Floor\Flush Beams\B13(i3264)

Dry | 1 span | No cant.

January 23, 2018 10:39:41

BC CALC® Design Report

Build 6215

Job name:

File name: HIGHGROVE 2 EL-1,3.mmdl

Address:

Description: 1st Floor\Flush Beams\B13(i3264)

City, Province, Postal Code: WAT...WN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

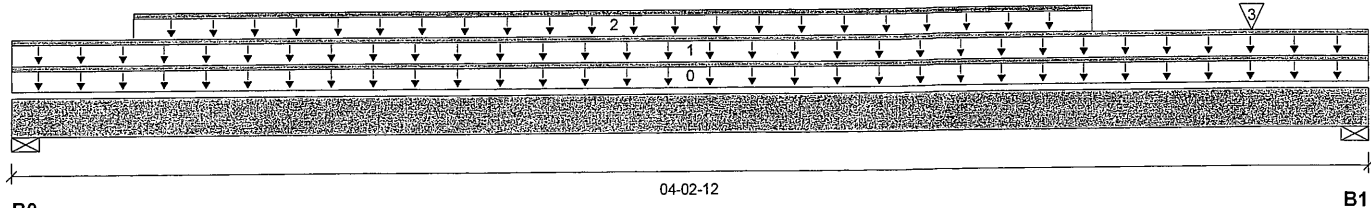

Total Horizontal Product Length = 04-02-12

Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live    | Dead    | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 5-1/2" | 663 / 0 | 353 / 0 |      |      |
| B1, 1-3/4" | 674 / 0 | 356 / 0 |      |      |

Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 04-02-12 | 10           |              |              |              | 00-00-00  |
| 1   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 04-02-12 | 25           | 12           |              |              | n/a       |
| 2   | Smoothed Load      | Unf. Lin. (lb/ft) | L    | 00-04-08 | 03-04-08 | 320          | 160          |              |              | n/a       |
| 3   | J2(i3255)          | Conc. Pt. (lbs)   | L    | 03-10-08 | 03-10-08 | 267          | 134          |              |              | n/a       |

Controls Summary

|                       | Factored Demand | Factored Resistance | Demand/<br>Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-----------------------|------|----------|
| Pos. Moment           | 1,315 ft-lbs    | 23,220 ft-lbs       | 5.7%                  | 1    | 01-10-08 |
| End Shear             | 1,019 lbs       | 11,571 lbs          | 8.8%                  | 1    | 01-03-00 |
| Total Load Deflection | L/999 (0.005")  | n/a                 | n/a                   | 4    | 02-03-00 |
| Live Load Deflection  | L/999 (0.003")  | n/a                 | n/a                   | 5    | 02-03-00 |
| Max Defl.             | 0.005"          | n/a                 | n/a                   | 4    | 02-03-00 |
| Span / Depth          | 4.7             |                     |                       |      |          |

Bearing Supports

|    | Dim. (LxW)                 | Demand    | Demand/<br>Resistance<br>Support | Demand/<br>Resistance<br>Member | Material    |
|----|----------------------------|-----------|----------------------------------|---------------------------------|-------------|
| B0 | Wall/Plate 5-1/2" x 3-1/2" | 1,436 lbs | 14.0%                            | 6.1%                            | Unspecified |
| B1 | Wall/Plate 1-3/4" x 3-1/2" | 1,457 lbs | 44.6%                            | 19.5%                           | Unspecified |

Notes

Design meets Code minimum (L/240) Total load deflection criteria.  
 Design meets Code minimum (L/360) Live load deflection criteria.  
 Calculations assume member is fully braced.  
 Resistance Factor phi has been applied to all presented results per CSA O86.  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.  
 Design based on Dry Service Condition.  
 Importance Factor : Normal Part code : Part 9  
 Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

CONFORMS TO OBC 2012



BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

File name: HIGHGROVE 2 EL-1,3.mmdl


Description: 1st Floor\Flush Beams\B13(i3264)

Specifier:

Designer: AJ

Company:

## Connection Diagram

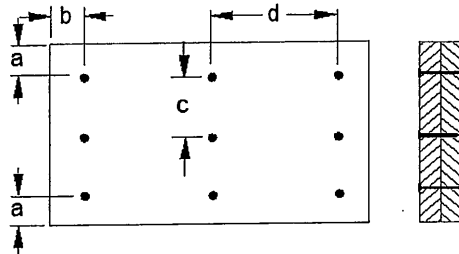

a minimum = 2"

b minimum = 3"

c = 2-3/4"

d = 6"

Calculated Side Load = 616.0 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

## Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. TAM 8277-18  
STRUCTURAL  
COMPONENT ONLY



BC CALC® Design Report

Dry | 1 span | No cant.

February 7, 2018 17:10:09

Build 6215

Job name:

File name: HIGHGROVE 2 EL-1,3.mmdl

Address:

Description: Basement\Flush Beams\B15B(i3271)

City, Province, Postal Code: WAT...WN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

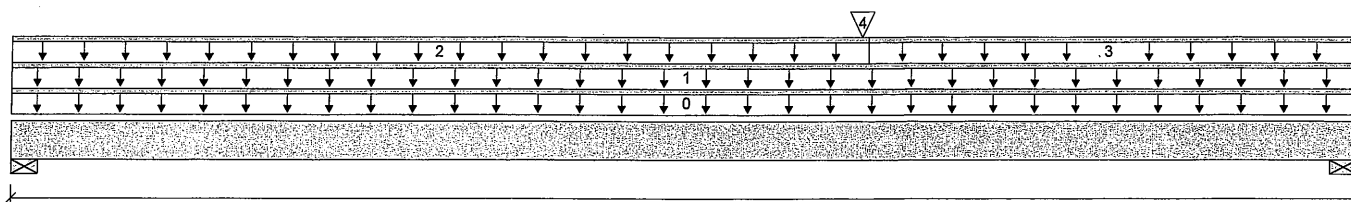

Total Horizontal Product Length = 14-07-08

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live    | Dead    | Snow | Wind |
|------------|---------|---------|------|------|
| B0, 2-1/8" | 347 / 0 | 212 / 0 |      |      |
| B1, 4-3/8" | 490 / 0 | 288 / 0 |      |      |

**Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 14-07-08 |              | 5            |              |              | 00-00-00  |
| 1   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 14-07-08 | 19           | 10           |              |              | n/a       |
| 2   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 09-03-06 | 4            | 2            |              |              | n/a       |
| 3   | FC1 Floor Material | Unf. Lin. (lb/ft) | L    | 09-03-06 | 14-07-08 | 3            | 1            |              |              | n/a       |
| 4   | B8(i3291)          | Conc. Pt. (lbs)   | L    | 09-02-08 | 09-02-08 | 505          | 264          |              |              | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 4,821 ft-lbs    | 11,610 ft-lbs       | 41.5%             | 1    | 09-02-08 |
| End Shear             | 1,034 lbs       | 5,785 lbs           | 17.9%             | 1    | 13-05-10 |
| Total Load Deflection | L/399 (0.428")  | n/a                 | 60.2%             | 4    | 07-07-15 |
| Live Load Deflection  | L/630 (0.271")  | n/a                 | 57.1%             | 5    | 07-07-15 |
| Max Defl.             | 0.428"          | n/a                 | n/a               | 4    | 07-07-15 |
| Span / Depth          | 17.9            |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand    | Demand/Resistance Support | Demand/Resistance Member | Material    |
|------------------|----------------------------|-----------|---------------------------|--------------------------|-------------|
| B0               | Wall/Plate 2-1/8" x 1-3/4" | 785 lbs   | 39.5%                     | 17.3%                    | Unspecified |
| B1               | Wall/Plate 4-3/8" x 1-3/4" | 1,095 lbs | 26.8%                     | 11.7%                    | Unspecified |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

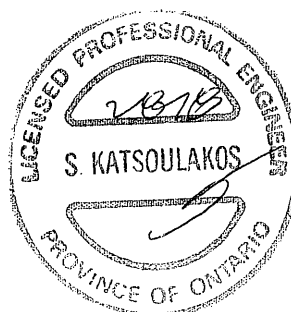
**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM B279-18  
STRUCTURAL  
COMPONENT ONLY

**BC CALC® Design Report**

Dry | 1 span | No cant.

February 8, 2018 16:48:32

Build 6215

Job name:

File name: HIGHGROVE 2 EL-1,3.mmdl

Address:

Description: 1st Floor\Flush Beams\B17(i3409)

City, Province, Postal Code: WAT...WN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

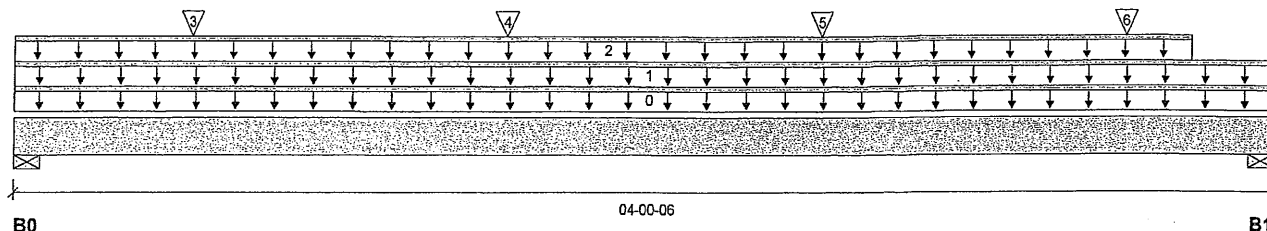

Total Horizontal Product Length = 04-00-06

**Reaction Summary (Down / Uplift) (lbs)**

| Bearing    | Live      | Dead    | Snow    | Wind |
|------------|-----------|---------|---------|------|
| B0, 1-3/4" | 1,003 / 0 | 888 / 0 | 964 / 0 |      |
| B1, 3-1/8" | 1,028 / 0 | 887 / 0 | 960 / 0 |      |

**Load Summary**

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 04-00-06 |              | 18           |              |              | 00-00-00  |
| 1   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 04-00-06 | 9            |              |              |              | n/a       |
| 2   | WALL               | Unf. Lin. (lb/ft) | L    | 00-00-00 | 03-09-04 |              | 100          |              |              | n/a       |
| 3   | J2(i3413)          | Conc. Pt. (lbs)   | L    | 00-06-12 | 00-06-12 | 520          | 340          | 500          |              | n/a       |
| 4   | J2(i3410)          | Conc. Pt. (lbs)   | L    | 01-06-12 | 01-06-12 | 532          | 352          | 532          |              | n/a       |
| 5   | J2(i3422)          | Conc. Pt. (lbs)   | L    | 02-06-12 | 02-06-12 | 532          | 352          | 532          |              | n/a       |
| 6   | J2(i3420)          | Conc. Pt. (lbs)   | L    | 03-06-12 | 03-06-12 | 411          | 263          | 360          |              | n/a       |

**Controls Summary**

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 2,923 ft-lbs    | 55,212 ft-lbs       | 5.3%              | 1    | 01-06-12 |
| End Shear             | 2,065 lbs       | 21,696 lbs          | 9.5%              | 1    | 01-01-10 |
| Total Load Deflection | L/999 (0.004")  | n/a                 | n/a               | 35   | 01-11-04 |
| Live Load Deflection  | L/999 (0.002")  | n/a                 | n/a               | 51   | 01-11-04 |
| Max Defl.             | 0.004"          | n/a                 | n/a               | 35   | 01-11-04 |
| Span / Depth          | 3.8             |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand    | Demand/Resistance Support | Demand/Resistance Member | Material    |
|------------------|----------------------------|-----------|---------------------------|--------------------------|-------------|
| B0               | Wall/Plate 1-3/4" x 5-1/4" | 3,096 lbs | 63.1%                     | 27.6%                    | Unspecified |
| B1               | Wall/Plate 3-1/8" x 5-1/4" | 3,130 lbs | 35.7%                     | 15.6%                    | Unspecified |

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

**CONFORMS TO OBC 2012**

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.


 DWG NO. TAM 8656 -18  
 STRUCTURAL  
 COMPONENT ONLY





# Triple 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

1st Floor\Flush Beams\B17(i3409)

Dry | 1 span | No cant.

February 8, 2018 16:48:32

File name: HIGHGROVE 2 EL-1,3.mmdl


Description: 1st Floor\Flush Beams\B17(i3409)

Specifier:

Designer: AJ

Company:

## Connection Diagram

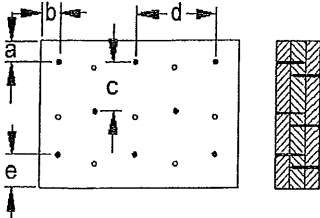

a minimum = 6"  
b minimum = 3"

c = 4 7/8"  
d = 5 1/4"  
e minimum = 3"

Calculated Side Load = 1,386.2 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

## Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



DWG NO. TAM0656-18  
STRUCTURAL  
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

BC CALC® Design Report  
Build 6215

1st Floor/Flush Beams\B18(i3424)

Dry | 1 span | No cant.

February 8, 2018 16:48:32

Job name:

File name: HIGHGROVE 2 EL-1,3.mmdl

Address:

Description: 1st Floor/Flush Beams\B18(i3424)

City, Province, Postal Code: WAT...WN


Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

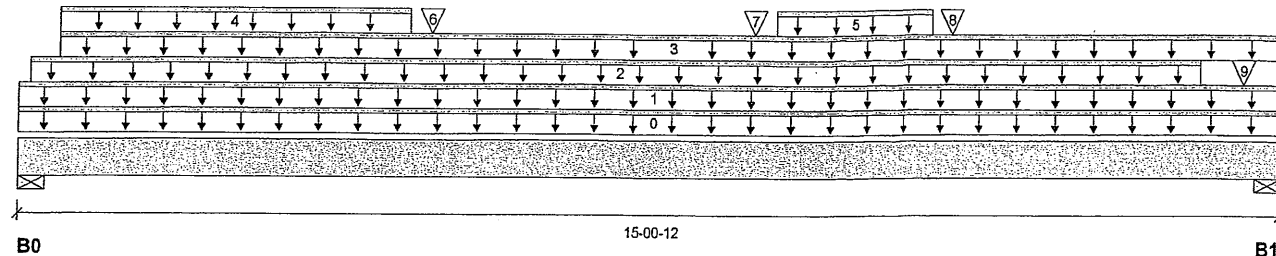

Total Horizontal Product Length = 15-00-12

### Reaction Summary (Down / Uplift) (lbs)

| Bearing    | Live      | Dead      | Snow      | Wind |
|------------|-----------|-----------|-----------|------|
| B0, 5-1/2" | 3,870 / 0 | 3,470 / 0 | 3,666 / 0 |      |
| B1, 5-1/4" | 3,600 / 0 | 3,268 / 0 | 2,875 / 0 |      |

### Load Summary

| Tag | Description        | Load Type         | Ref. | Start    | End      | Live<br>1.00 | Dead<br>0.65 | Snow<br>1.00 | Wind<br>1.15 | Tributary |
|-----|--------------------|-------------------|------|----------|----------|--------------|--------------|--------------|--------------|-----------|
| 0   | Self-Weight        | Unf. Lin. (lb/ft) | L    | 00-00-00 | 15-00-12 |              | 21           |              |              | 00-00-00  |
| 1   | FC2 Floor Material | Unf. Lin. (lb/ft) | L    | 00-00-00 | 15-00-12 | 9            |              |              |              | n/a       |
| 2   | Smoothed Load      | Unf. Lin. (lb/ft) | L    | 00-01-08 | 14-01-08 | 326          | 162          |              |              | n/a       |
| 3   | WALL               | Unf. Lin. (lb/ft) | L    | 00-05-08 | 15-00-12 |              | 100          |              |              | n/a       |
| 4   | ROOF               | Unf. Lin. (lb/ft) | L    | 00-05-08 | 04-07-08 | 209          | 190          | 532          |              | n/a       |
| 5   | ROOF               | Unf. Lin. (lb/ft) | L    | 08-11-08 | 10-10-08 | 209          | 190          | 532          |              | n/a       |
| 6   | User Load          | Conc. Pt. (lbs)   | L    | 04-10-08 | 04-10-08 | 380          | 418          | 1,064        |              | n/a       |
| 7   | User Load          | Conc. Pt. (lbs)   | L    | 08-08-08 | 08-08-08 | 380          | 418          | 1,064        |              | n/a       |
| 8   | User Load          | Conc. Pt. (lbs)   | L    | 11-01-08 | 11-01-08 | 380          | 418          | 1,064        |              | n/a       |
| 9   | J1(i3415)          | Conc. Pt. (lbs)   | L    | 14-07-08 | 14-07-08 | 369          | 203          | 113          |              | n/a       |

### Controls Summary

|                       | Factored Demand | Factored Resistance | Demand/Resistance | Case | Location |
|-----------------------|-----------------|---------------------|-------------------|------|----------|
| Pos. Moment           | 40,953 ft-lbs   | 75,349 ft-lbs       | 54.4%             | 1    | 08-07-08 |
| End Shear             | 10,207 lbs      | 25,578 lbs          | 39.9%             | 1    | 01-07-08 |
| Total Load Deflection | L/353 (0.485")  | n/a                 | 67.9%             | 35   | 07-07-08 |
| Live Load Deflection  | L/573 (0.299")  | n/a                 | 62.9%             | 51   | 07-07-08 |
| Max Defl.             | 0.485"          | n/a                 | n/a               | 35   | 07-07-08 |
| Span / Depth          | 12.3            |                     |                   |      |          |

| Bearing Supports | Dim. (LxW)                 | Demand     | Demand/Resistance Support | Demand/Resistance Member | Material    |
|------------------|----------------------------|------------|---------------------------|--------------------------|-------------|
| B0               | Wall/Plate 5-1/2" x 5-1/4" | 11,975 lbs | 77.7%                     | 34.0%                    | Unspecified |
| B1               | Wall/Plate 5-1/4" x 5-1/4" | 10,923 lbs | 74.2%                     | 32.5%                    | Unspecified |



DWG NO. TAM 0657  
STRUCTURAL  
COMPONENT ONLY



# Triple 1-3/4" x 14" VERSA-LAM® 2.0 3100 SP

**PASSED**

BC CALC® Design Report  
Build 6215

1st Floor\Flush Beams\B18(i3424)

Dry | 1 span | No cant.

February 8, 2018 16:48:32

Job name:

File name: HIGHGROVE 2 EL-1,3.mmdl

Address:

Description: 1st Floor\Flush Beams\B18(i3424)

City, Province, Postal Code: WAT...WN

Specifier:

Customer:

Designer: AJ

Code reports: CCMC 12472-R

Company:

## Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

**CONFORMS TO OBC 2012**


Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

## Connection Diagram

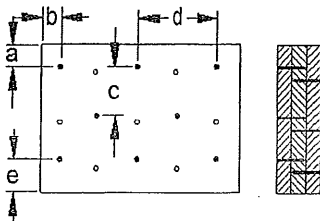

a minimum = 1"  
b minimum = 3"

c = 5 1/2"  
d = 4"  
e minimum = 2"

Calculated Side Load = 700.2 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d x Nails

**3-1/2" ARDOX SPIRAL**



## Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.



DWG NO. TAM 0657  
STRUCTURAL  
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®



## Maximum Floor Spans



Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing

| Depth   | Series | Bare              |         |         |     | 1/2" Gypsum Ceiling |         |         |     |
|---------|--------|-------------------|---------|---------|-----|---------------------|---------|---------|-----|
|         |        | On Centre Spacing |         |         |     | On Centre Spacing   |         |         |     |
|         |        | 12"               | 16"     | 19.2"   | 24" | 12"                 | 16"     | 19.2"   | 24" |
| 9-1/2"  | NI-20  | 15'-1"            | 14'-2"  | 13'-9"  | N/A | 15'-7"              | 14'-8"  | 14'-2"  | N/A |
|         | NI-40x | 16'-1"            | 15'-2"  | 14'-8"  | N/A | 16'-7"              | 15'-7"  | 15'-1"  | N/A |
|         | NI-60  | 16'-3"            | 15'-4"  | 14'-10" | N/A | 16'-8"              | 15'-9"  | 15'-3"  | N/A |
|         | NI-70  | 17'-1"            | 16'-1"  | 15'-6"  | N/A | 17'-5"              | 16'-5"  | 15'-10" | N/A |
|         | NI-80  | 17'-3"            | 16'-3"  | 15'-8"  | N/A | 17'-8"              | 16'-7"  | 16'-0"  | N/A |
| 11-7/8" | NI-20  | 16'-11"           | 16'-0"  | 15'-5"  | N/A | 17'-6"              | 16'-6"  | 16'-0"  | N/A |
|         | NI-40x | 18'-1"            | 17'-0"  | 16'-5"  | N/A | 18'-9"              | 17'-6"  | 16'-11" | N/A |
|         | NI-60  | 18'-4"            | 17'-3"  | 16'-7"  | N/A | 19'-0"              | 17'-8"  | 17'-1"  | N/A |
|         | NI-70  | 19'-6"            | 18'-0"  | 17'-4"  | N/A | 20'-1"              | 18'-7"  | 17'-9"  | N/A |
|         | NI-80  | 19'-9"            | 18'-3"  | 17'-6"  | N/A | 20'-4"              | 18'-10" | 17'-11" | N/A |
|         | NI-90x | 20'-4"            | 18'-9"  | 17'-11" | N/A | 20'-10"             | 19'-3"  | 18'-5"  | N/A |
| 14"     | NI-40x | 20'-1"            | 18'-7"  | 17'-10" | N/A | 20'-10"             | 19'-4"  | 18'-6"  | N/A |
|         | NI-60  | 20'-5"            | 18'-11" | 18'-1"  | N/A | 21'-2"              | 19'-7"  | 18'-9"  | N/A |
|         | NI-70  | 21'-7"            | 20'-0"  | 19'-1"  | N/A | 22'-3"              | 20'-7"  | 19'-8"  | N/A |
|         | NI-80  | 21'-11"           | 20'-3"  | 19'-4"  | N/A | 22'-7"              | 20'-11" | 20'-0"  | N/A |
|         | NI-90x | 22'-7"            | 20'-11" | 19'-11" | N/A | 23'-3"              | 21'-6"  | 20'-6"  | N/A |
| 16"     | NI-60  | 22'-3"            | 20'-8"  | 19'-9"  | N/A | 23'-1"              | 21'-5"  | 20'-6"  | N/A |
|         | NI-70  | 23'-6"            | 21'-9"  | 20'-9"  | N/A | 24'-3"              | 22'-5"  | 21'-5"  | N/A |
|         | NI-80  | 23'-11"           | 22'-1"  | 21'-1"  | N/A | 24'-8"              | 22'-10" | 21'-9"  | N/A |
|         | NI-90x | 24'-8"            | 22'-9"  | 21'-9"  | N/A | 25'-4"              | 23'-5"  | 22'-4"  | N/A |

| Depth   | Series | Mid-Span Blocking |         |         |     | Mid-Span Blocking and 1/2" Gypsum Ceiling |         |         |     |
|---------|--------|-------------------|---------|---------|-----|---|---------|---------|-----|
|         |        | On Centre Spacing |         |         |     | On Centre Spacing                         |         |         |     |
|         |        | 12"               | 16"     | 19.2"   | 24" | 12"                                       | 16"     | 19.2"   | 24" |
| 9-1/2"  | NI-20  | 16'-8"            | 15'-3"  | 14'-5"  | N/A | 16'-8"                                    | 15'-3"  | 14'-5"  | N/A |
|         | NI-40x | 17'-11"           | 16'-11" | 16'-1"  | N/A | 18'-5"                                    | 17'-1"  | 16'-1"  | N/A |
|         | NI-60  | 18'-2"            | 17'-1"  | 16'-4"  | N/A | 18'-7"                                    | 17'-4"  | 16'-4"  | N/A |
|         | NI-70  | 19'-2"            | 17'-10" | 17'-2"  | N/A | 19'-7"                                    | 18'-3"  | 17'-7"  | N/A |
|         | NI-80  | 19'-5"            | 18'-0"  | 17'-4"  | N/A | 19'-10"                                   | 18'-5"  | 17'-8"  | N/A |
| 11-7/8" | NI-20  | 19'-6"            | 18'-1"  | 17'-3"  | N/A | 19'-11"                                   | 18'-3"  | 17'-3"  | N/A |
|         | NI-40x | 21'-0"            | 19'-6"  | 18'-8"  | N/A | 21'-7"                                    | 20'-2"  | 19'-2"  | N/A |
|         | NI-60  | 21'-4"            | 19'-9"  | 18'-11" | N/A | 21'-11"                                   | 20'-4"  | 19'-6"  | N/A |
|         | NI-70  | 22'-6"            | 20'-10" | 19'-11" | N/A | 23'-0"                                    | 21'-5"  | 20'-5"  | N/A |
|         | NI-80  | 22'-9"            | 21'-1"  | 20'-1"  | N/A | 23'-3"                                    | 21'-7"  | 20'-8"  | N/A |
|         | NI-90x | 23'-4"            | 21'-8"  | 20'-8"  | N/A | 23'-10"                                   | 22'-2"  | 21'-2"  | N/A |
| 14"     | NI-40x | 23'-7"            | 21'-11" | 20'-11" | N/A | 24'-3"                                    | 22'-7"  | 21'-7"  | N/A |
|         | NI-60  | 24'-0"            | 22'-3"  | 21'-3"  | N/A | 24'-8"                                    | 22'-11" | 21'-11" | N/A |
|         | NI-70  | 25'-3"            | 23'-4"  | 22'-3"  | N/A | 25'-10"                                   | 24'-0"  | 22'-11" | N/A |
|         | NI-80  | 25'-7"            | 23'-8"  | 22'-7"  | N/A | 26'-2"                                    | 24'-4"  | 23'-2"  | N/A |
|         | NI-90x | 26'-4"            | 24'-4"  | 23'-3"  | N/A | 26'-10"                                   | 24'-11" | 23'-9"  | N/A |
| 16"     | NI-60  | 26'-5"            | 24'-6"  | 23'-4"  | N/A | 27'-2"                                    | 25'-3"  | 24'-2"  | N/A |
|         | NI-70  | 27'-9"            | 25'-8"  | 24'-6"  | N/A | 28'-5"                                    | 26'-5"  | 25'-2"  | N/A |
|         | NI-80  | 28'-2"            | 26'-1"  | 24'-10" | N/A | 28'-10"                                   | 26'-9"  | 25'-6"  | N/A |
|         | NI-90x | 29'-0"            | 26'-10" | 25'-7"  | N/A | 29'-7"                                    | 27'-5"  | 26'-2"  | N/A |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of  $1.50L + 1.25D$ . The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing

| Depth   | Series | Bare              |         |         |         | 1/2" Gypsum Ceiling |         |         |         |
|---------|--------|-------------------|---------|---------|---------|---------------------|---------|---------|---------|
|         |        | On Centre Spacing |         |         |         | On Centre Spacing   |         |         |         |
|         |        | 12"               | 16"     | 19.2"   | 24"     | 12"                 | 16"     | 19.2"   | 24"     |
| 9-1/2"  | NI-20  | 15'-10"           | 15'-0"  | 14'-5"  | 13'-5"  | 16'-4"              | 15'-5"  | 14'-6"  | 13'-5"  |
|         | NI-40x | 17'-0"            | 16'-0"  | 15'-5"  | 14'-9"  | 17'-5"              | 16'-5"  | 15'-10" | 15'-2"  |
|         | NI-60  | 17'-2"            | 16'-2"  | 15'-7"  | 14'-11" | 17'-6"              | 16'-7"  | 15'-11" | 15'-3"  |
|         | NI-70  | 18'-0"            | 16'-11" | 16'-3"  | 15'-7"  | 18'-5"              | 17'-3"  | 16'-7"  | 15'-11" |
|         | NI-80  | 18'-3"            | 17'-1"  | 16'-5"  | 15'-9"  | 18'-8"              | 17'-5"  | 16'-9"  | 16'-1"  |
| 11-7/8" | NI-20  | 17'-10"           | 16'-10" | 16'-2"  | 15'-6"  | 18'-6"              | 17'-4"  | 16'-9"  | 16'-1"  |
|         | NI-40x | 19'-4"            | 17'-11" | 17'-3"  | 16'-6"  | 19'-11"             | 18'-6"  | 17'-9"  | 17'-0"  |
|         | NI-60  | 19'-7"            | 18'-2"  | 17'-5"  | 16'-9"  | 20'-2"              | 18'-9"  | 17'-11" | 17'-2"  |
|         | NI-70  | 20'-9"            | 19'-2"  | 18'-3"  | 17'-5"  | 21'-4"              | 19'-9"  | 18'-10" | 17'-10" |
|         | NI-80  | 21'-1"            | 19'-5"  | 18'-6"  | 17'-7"  | 21'-7"              | 20'-0"  | 19'-0"  | 18'-0"  |
| 14"     | NI-90x | 21'-8"            | 20'-0"  | 19'-1"  | 18'-0"  | 22'-2"              | 20'-6"  | 19'-6"  | 18'-6"  |
|         | NI-40x | 21'-5"            | 19'-10" | 18'-11" | 17'-11" | 22'-1"              | 20'-6"  | 19'-7"  | 18'-7"  |
|         | NI-60  | 21'-10"           | 20'-2"  | 19'-3"  | 18'-2"  | 22'-5"              | 20'-10" | 19'-11" | 18'-10" |
|         | NI-70  | 23'-0"            | 21'-3"  | 20'-3"  | 19'-2"  | 23'-8"              | 21'-11" | 20'-10" | 19'-9"  |
|         | NI-80  | 23'-5"            | 21'-7"  | 20'-7"  | 19'-5"  | 24'-0"              | 22'-3"  | 21'-2"  | 20'-0"  |
| 16"     | NI-90x | 24'-1"            | 22'-3"  | 21'-2"  | 20'-0"  | 24'-8"              | 22'-10" | 21'-9"  | 20'-7"  |
|         | NI-60  | 23'-9"            | 22'-0"  | 20'-11" | 19'-10" | 24'-6"              | 22'-9"  | 21'-8"  | 20'-6"  |
|         | NI-70  | 25'-1"            | 23'-2"  | 22'-0"  | 20'-10" | 25'-9"              | 23'-10" | 22'-9"  | 21'-6"  |
|         | NI-80  | 25'-6"            | 23'-6"  | 22'-4"  | 21'-2"  | 26'-1"              | 24'-2"  | 23'-1"  | 21'-10" |
|         | NI-90x | 26'-4"            | 24'-3"  | 23'-1"  | 21'-10" | 26'-11"             | 24'-11" | 23'-8"  | 22'-5"  |

| Depth   | Series | Mid-Span Blocking |         |         |         | Mid-Span Blocking and 1/2" Gypsum Ceiling |         |         |         |
|---------|--------|-------------------|---------|---------|---------|---|---------|---------|---------|
|         |        | On Centre Spacing |         |         |         | On Centre Spacing                         |         |         |         |
|         |        | 12"               | 16"     | 19.2"   | 24"     | 12"                                       | 16"     | 19.2"   | 24"     |
| 9-1/2"  | NI-20  | 16'-10"           | 15'-5"  | 14'-6"  | 13'-5"  | 16'-10"                                   | 15'-5"  | 14'-6"  | 13'-5"  |
|         | NI-40x | 18'-8"            | 17'-2"  | 16'-3"  | 15'-2"  | 18'-10"                                   | 17'-2"  | 16'-3"  | 15'-2"  |
|         | NI-60  | 18'-11"           | 17'-6"  | 16'-6"  | 15'-5"  | 19'-2"                                    | 17'-6"  | 16'-6"  | 15'-5"  |
|         | NI-70  | 20'-0"            | 18'-7"  | 17'-9"  | 16'-7"  | 20'-5"                                    | 18'-11" | 17'-10" | 16'-7"  |
|         | NI-80  | 20'-3"            | 18'-10" | 17'-11" | 16'-10" | 20'-8"                                    | 19'-3"  | 18'-2"  | 16'-10" |
| 11-7/8" | NI-20  | 20'-1"            | 18'-5"  | 17'-5"  | 16'-2"  | 20'-1"                                    | 18'-5"  | 17'-5"  | 16'-2"  |
|         | NI-40x | 21'-10"           | 20'-4"  | 19'-4"  | 17'-8"  | 22'-5"                                    | 20'-6"  | 19'-4"  | 17'-8"  |
|         | NI-60  | 22'-1"            | 20'-7"  | 19'-7"  | 18'-4"  | 22'-8"                                    | 20'-10" | 19'-8"  | 18'-4"  |
|         | NI-70  | 23'-4"            | 21'-8"  | 20'-8"  | 19'-7"  | 23'-10"                                   | 22'-3"  | 21'-2"  | 19'-9"  |
|         | NI-80  | 23'-7"            | 21'-11" | 20'-11" | 19'-9"  | 24'-1"                                    | 22'-6"  | 21'-5"  | 20'-0"  |
| 14"     | NI-90x | 24'-3"            | 22'-6"  | 21'-6"  | 20'-4"  | 24'-8"                                    | 23'-0"  | 22'-0"  | 20'-9"  |
|         | NI-40x | 24'-5"            | 22'-9"  | 21'-8"  | 19'-5"  | 25'-1"                                    | 23'-2"  | 21'-9"  | 19'-5"  |
|         | NI-60  | 24'-10"           | 23'-1"  | 22'-0"  | 20'-10" | 25'-6"                                    | 23'-8"  | 22'-4"  | 20'-10" |
|         | NI-70  | 26'-1"            | 24'-3"  | 23'-2"  | 21'-10" | 26'-8"                                    | 24'-11" | 23'-9"  | 22'-4"  |
|         | NI-80  | 26'-6"            | 24'-7"  | 23'-5"  | 22'-2"  | 27'-1"                                    | 25'-3"  | 24'-1"  | 22'-9"  |
| 16"     | NI-90x | 27'-3"            | 25'-4"  | 24'-1"  | 22'-9"  | 27'-9"                                    | 25'-11" | 24'-8"  | 23'-4"  |
|         | NI-60  | 27'-3"            | 25'-5"  | 24'-2"  | 22'-10" | 28'-0"                                    | 26'-2"  | 24'-9"  | 23'-1"  |
|         | NI-70  | 28'-8"            | 26'-8"  | 25'-4"  | 23'-11" | 29'-3"                                    | 27'-4"  | 26'-1"  | 24'-8"  |
|         | NI-80  | 29'-1"            | 27'-0"  | 25'-9"  | 24'-4"  | 29'-8"                                    | 27'-9"  | 26'-5"  | 25'-0"  |
|         | NI-90x | 29'-11"           | 27'-10" | 26'-6"  | 25'-0"  | 30'-6"                                    | 28'-5"  | 27'-2"  | 25'-8"  |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing

| Depth   | Series | Bare              |         |         |     | 1/2" Gypsum Ceiling |         |         |     |
|---------|--------|-------------------|---------|---------|-----|---------------------|---------|---------|-----|
|         |        | On Centre Spacing |         |         |     | On Centre Spacing   |         |         |     |
|         |        | 12"               | 16"     | 19.2"   | 24" | 12"                 | 16"     | 19.2"   | 24" |
| 9-1/2"  | NI-20  | 15'-1"            | 14'-1"  | 13'-3"  | N/A | 15'-7"              | 14'-1"  | 13'-3"  | N/A |
|         | NI-40x | 16'-1"            | 15'-2"  | 14'-8"  | N/A | 16'-7"              | 15'-7"  | 15'-1"  | N/A |
|         | NI-60  | 16'-3"            | 15'-4"  | 14'-10" | N/A | 16'-8"              | 15'-9"  | 15'-3"  | N/A |
|         | NI-70  | 17'-1"            | 16'-1"  | 15'-6"  | N/A | 17'-5"              | 16'-5"  | 15'-10" | N/A |
|         | NI-80  | 17'-3"            | 16'-3"  | 15'-8"  | N/A | 17'-8"              | 16'-7"  | 16'-0"  | N/A |
| 11-7/8" | NI-20  | 16'-11"           | 16'-0"  | 15'-5"  | N/A | 17'-6"              | 16'-6"  | 16'-0"  | N/A |
|         | NI-40x | 18'-1"            | 17'-0"  | 16'-5"  | N/A | 18'-9"              | 17'-6"  | 16'-11" | N/A |
|         | NI-60  | 18'-4"            | 17'-3"  | 16'-7"  | N/A | 19'-0"              | 17'-8"  | 17'-1"  | N/A |
|         | NI-70  | 19'-6"            | 18'-0"  | 17'-4"  | N/A | 20'-1"              | 18'-7"  | 17'-9"  | N/A |
|         | NI-80  | 19'-9"            | 18'-3"  | 17'-6"  | N/A | 20'-4"              | 18'-10" | 17'-11" | N/A |
|         | NI-90x | 20'-4"            | 18'-9"  | 17'-11" | N/A | 20'-10"             | 19'-3"  | 18'-5"  | N/A |
| 14"     | NI-40x | 20'-1"            | 18'-7"  | 17'-10" | N/A | 20'-10"             | 19'-4"  | 18'-6"  | N/A |
|         | NI-60  | 20'-5"            | 18'-11" | 18'-1"  | N/A | 21'-2"              | 19'-7"  | 18'-9"  | N/A |
|         | NI-70  | 21'-7"            | 20'-0"  | 19'-1"  | N/A | 22'-3"              | 20'-7"  | 19'-8"  | N/A |
|         | NI-80  | 21'-11"           | 20'-3"  | 19'-4"  | N/A | 22'-7"              | 20'-11" | 20'-0"  | N/A |
|         | NI-90x | 22'-7"            | 20'-11" | 19'-11" | N/A | 23'-3"              | 21'-6"  | 20'-6"  | N/A |
| 16"     | NI-60  | 22'-3"            | 20'-8"  | 19'-9"  | N/A | 23'-1"              | 21'-5"  | 20'-6"  | N/A |
|         | NI-70  | 23'-6"            | 21'-9"  | 20'-9"  | N/A | 24'-3"              | 22'-5"  | 21'-5"  | N/A |
|         | NI-80  | 23'-11"           | 22'-1"  | 21'-1"  | N/A | 24'-8"              | 22'-10" | 21'-9"  | N/A |
|         | NI-90x | 24'-8"            | 22'-9"  | 21'-9"  | N/A | 25'-4"              | 23'-5"  | 22'-4"  | N/A |

| Depth   | Series | Mid-Span Blocking |         |         |     | Mid-Span Blocking and 1/2" Gypsum Ceiling |         |        |     |
|---------|--------|-------------------|---------|---------|-----|---|---------|--------|-----|
|         |        | On Centre Spacing |         |         |     | On Centre Spacing                         |         |        |     |
|         |        | 12"               | 16"     | 19.2"   | 24" | 12"                                       | 16"     | 19.2"  | 24" |
| 9-1/2"  | NI-20  | 15'-7"            | 14'-1"  | 13'-3"  | N/A | 15'-7"                                    | 14'-1"  | 13'-3" | N/A |
|         | NI-40x | 17'-9"            | 16'-1"  | 15'-1"  | N/A | 17'-9"                                    | 16'-1"  | 15'-1" | N/A |
|         | NI-60  | 18'-1"            | 16'-4"  | 15'-4"  | N/A | 18'-1"                                    | 16'-4"  | 15'-4" | N/A |
|         | NI-70  | 19'-2"            | 17'-10" | 16'-9"  | N/A | 19'-7"                                    | 17'-10" | 16'-9" | N/A |
|         | NI-80  | 19'-5"            | 18'-0"  | 17'-1"  | N/A | 19'-10"                                   | 18'-3"  | 17'-1" | N/A |
| 11-7/8" | NI-20  | 18'-9"            | 17'-0"  | 16'-0"  | N/A | 18'-9"                                    | 17'-0"  | 16'-0" | N/A |
|         | NI-40x | 21'-0"            | 19'-3"  | 17'-9"  | N/A | 21'-3"                                    | 19'-3"  | 17'-9" | N/A |
|         | NI-60  | 21'-4"            | 19'-8"  | 18'-5"  | N/A | 21'-8"                                    | 19'-8"  | 18'-5" | N/A |
|         | NI-70  | 22'-6"            | 20'-10" | 19'-11" | N/A | 23'-0"                                    | 21'-4"  | 20'-0" | N/A |
|         | NI-80  | 22'-9"            | 21'-1"  | 20'-1"  | N/A | 23'-3"                                    | 21'-7"  | 20'-5" | N/A |
|         | NI-90x | 23'-4"            | 21'-8"  | 20'-8"  | N/A | 23'-10"                                   | 22'-2"  | 21'-2" | N/A |
| 14"     | NI-40x | 23'-7"            | 21'-5"  | 19'-6"  | N/A | 24'-1"                                    | 21'-5"  | 19'-6" | N/A |
|         | NI-60  | 24'-0"            | 22'-3"  | 21'-0"  | N/A | 24'-8"                                    | 22'-5"  | 21'-0" | N/A |
|         | NI-70  | 25'-3"            | 23'-4"  | 22'-3"  | N/A | 25'-10"                                   | 24'-0"  | 22'-9" | N/A |
|         | NI-80  | 25'-7"            | 23'-8"  | 22'-7"  | N/A | 26'-2"                                    | 24'-4"  | 23'-2" | N/A |
|         | NI-90x | 26'-4"            | 24'-4"  | 23'-3"  | N/A | 26'-10"                                   | 24'-11" | 23'-9" | N/A |
| 16"     | NI-60  | 26'-5"            | 24'-6"  | 23'-4"  | N/A | 27'-2"                                    | 24'-10" | 23'-4" | N/A |
|         | NI-70  | 27'-9"            | 25'-8"  | 24'-6"  | N/A | 28'-5"                                    | 26'-5"  | 25'-2" | N/A |
|         | NI-80  | 28'-2"            | 26'-1"  | 24'-10" | N/A | 28'-10"                                   | 26'-9"  | 25'-6" | N/A |
|         | NI-90x | 29'-0"            | 26'-10" | 25'-7"  | N/A | 29'-7"                                    | 27'-5"  | 26'-2" | N/A |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



## Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing

| Depth   | Series | Bare              |         |         |         | 1/2" Gypsum Ceiling |         |         |         |
|---------|--------|-------------------|---------|---------|---------|---------------------|---------|---------|---------|
|         |        | On Centre Spacing |         |         |         | On Centre Spacing   |         |         |         |
|         |        | 12"               | 16"     | 19.2"   | 24"     | 12"                 | 16"     | 19.2"   | 24"     |
| 9-1/2"  | NI-20  | 15'-7"            | 14'-2"  | 13'-4"  | 12'-4"  | 15'-7"              | 14'-2"  | 13'-4"  | 12'-4"  |
|         | NI-40x | 17'-0"            | 16'-0"  | 15'-1"  | 13'-11" | 17'-5"              | 16'-1"  | 15'-1"  | 13'-11" |
|         | NI-60  | 17'-2"            | 16'-2"  | 15'-5"  | 14'-3"  | 17'-6"              | 16'-5"  | 15'-5"  | 14'-3"  |
|         | NI-70  | 18'-0"            | 16'-11" | 16'-3"  | 15'-6"  | 18'-5"              | 17'-3"  | 16'-7"  | 15'-6"  |
|         | NI-80  | 18'-3"            | 17'-1"  | 16'-5"  | 15'-9"  | 18'-8"              | 17'-5"  | 16'-9"  | 15'-10" |
| 11-7/8" | NI-20  | 17'-10"           | 16'-10" | 16'-0"  | 14'-10" | 18'-6"              | 17'-1"  | 16'-0"  | 14'-10" |
|         | NI-40x | 19'-4"            | 17'-11" | 17'-3"  | 15'-10" | 19'-11"             | 18'-6"  | 17'-9"  | 15'-10" |
|         | NI-60  | 19'-7"            | 18'-2"  | 17'-5"  | 16'-9"  | 20'-2"              | 18'-9"  | 17'-11" | 17'-1"  |
|         | NI-70  | 20'-9"            | 19'-2"  | 18'-3"  | 17'-5"  | 21'-4"              | 19'-9"  | 18'-10" | 17'-10" |
|         | NI-80  | 21'-1"            | 19'-5"  | 18'-6"  | 17'-7"  | 21'-7"              | 20'-0"  | 19'-0"  | 18'-0"  |
|         | NI-90x | 21'-8"            | 20'-0"  | 19'-1"  | 18'-0"  | 22'-2"              | 20'-6"  | 19'-6"  | 18'-6"  |
| 14"     | NI-40x | 21'-5"            | 19'-10" | 18'-11" | 17'-5"  | 22'-1"              | 20'-6"  | 19'-6"  | 17'-5"  |
|         | NI-60  | 21'-10"           | 20'-2"  | 19'-3"  | 18'-2"  | 22'-5"              | 20'-10" | 19'-11" | 18'-10" |
|         | NI-70  | 23'-0"            | 21'-3"  | 20'-3"  | 19'-2"  | 23'-8"              | 21'-11" | 20'-10" | 19'-9"  |
|         | NI-80  | 23'-5"            | 21'-7"  | 20'-7"  | 19'-5"  | 24'-0"              | 22'-3"  | 21'-2"  | 20'-0"  |
|         | NI-90x | 24'-1"            | 22'-3"  | 21'-2"  | 20'-0"  | 24'-8"              | 22'-10" | 21'-9"  | 20'-7"  |
| 16"     | NI-60  | 23'-9"            | 22'-0"  | 20'-11" | 19'-10" | 24'-6"              | 22'-9"  | 21'-8"  | 20'-6"  |
|         | NI-70  | 25'-1"            | 23'-2"  | 22'-0"  | 20'-10" | 25'-9"              | 23'-10" | 22'-9"  | 21'-6"  |
|         | NI-80  | 25'-6"            | 23'-6"  | 22'-4"  | 21'-2"  | 26'-1"              | 24'-2"  | 23'-1"  | 21'-10" |
|         | NI-90x | 26'-4"            | 24'-3"  | 23'-1"  | 21'-10" | 26'-11"             | 24'-11" | 23'-8"  | 22'-5"  |


| Depth   | Series | Mid-Span Blocking |         |        |         | Mid-Span Blocking and 1/2" Gypsum Ceiling |         |         |         |
|---------|--------|-------------------|---------|--------|---------|---|---------|---------|---------|
|         |        | On Centre Spacing |         |        |         | On Centre Spacing                         |         |         |         |
|         |        | 12"               | 16"     | 19.2"  | 24"     | 12"                                       | 16"     | 19.2"   | 24"     |
| 9-1/2"  | NI-20  | 15'-7"            | 14'-2"  | 13'-4" | 12'-4"  | 15'-7"                                    | 14'-2"  | 13'-4"  | 12'-4"  |
|         | NI-40x | 17'-9"            | 16'-1"  | 15'-1" | 13'-11" | 17'-9"                                    | 16'-1"  | 15'-1"  | 13'-11" |
|         | NI-60  | 18'-1"            | 16'-5"  | 15'-5" | 14'-3"  | 18'-1"                                    | 16'-5"  | 15'-5"  | 14'-3"  |
|         | NI-70  | 19'-10"           | 17'-11" | 16'-9" | 15'-6"  | 19'-10"                                   | 17'-11" | 16'-9"  | 15'-6"  |
|         | NI-80  | 20'-2"            | 18'-3"  | 17'-1" | 15'-10" | 20'-2"                                    | 18'-3"  | 17'-1"  | 15'-10" |
| 11-7/8" | NI-20  | 18'-10"           | 17'-1"  | 16'-0" | 14'-10" | 18'-10"                                   | 17'-1"  | 16'-0"  | 14'-10" |
|         | NI-40x | 21'-3"            | 19'-3"  | 17'-9" | 15'-10" | 21'-3"                                    | 19'-3"  | 17'-9"  | 15'-10" |
|         | NI-60  | 21'-9"            | 19'-8"  | 18'-5" | 17'-1"  | 21'-9"                                    | 19'-8"  | 18'-5"  | 17'-1"  |
|         | NI-70  | 23'-4"            | 21'-5"  | 20'-1" | 18'-6"  | 23'-8"                                    | 21'-5"  | 20'-1"  | 18'-6"  |
|         | NI-80  | 23'-7"            | 21'-10" | 20'-5" | 18'-11" | 24'-1"                                    | 21'-10" | 20'-5"  | 18'-11" |
|         | NI-90x | 24'-3"            | 22'-6"  | 21'-3" | 19'-7"  | 24'-8"                                    | 22'-7"  | 21'-3"  | 19'-7"  |
| 14"     | NI-40x | 24'-2"            | 21'-5"  | 19'-6" | 17'-5"  | 24'-2"                                    | 21'-5"  | 19'-6"  | 17'-5"  |
|         | NI-60  | 24'-9"            | 22'-5"  | 21'-0" | 19'-6"  | 24'-9"                                    | 22'-5"  | 21'-0"  | 19'-6"  |
|         | NI-70  | 26'-1"            | 24'-3"  | 22'-9" | 21'-0"  | 26'-8"                                    | 24'-3"  | 22'-9"  | 21'-0"  |
|         | NI-80  | 26'-6"            | 24'-7"  | 23'-3" | 21'-6"  | 27'-1"                                    | 24'-10" | 23'-3"  | 21'-6"  |
|         | NI-90x | 27'-3"            | 25'-4"  | 24'-1" | 22'-4"  | 27'-9"                                    | 25'-10" | 24'-3"  | 22'-4"  |
| 16"     | NI-60  | 27'-3"            | 24'-11" | 23'-5" | 21'-7"  | 27'-6"                                    | 24'-11" | 23'-5"  | 21'-7"  |
|         | NI-70  | 28'-8"            | 26'-8"  | 25'-3" | 23'-4"  | 29'-3"                                    | 26'-11" | 25'-3"  | 23'-4"  |
|         | NI-80  | 29'-1"            | 27'-0"  | 25'-9" | 23'-10" | 29'-8"                                    | 27'-6"  | 25'-10" | 23'-10" |
|         | NI-90x | 29'-11"           | 27'-10" | 26'-6" | 24'-10" | 30'-6"                                    | 28'-5"  | 26'-11" | 24'-10" |

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





# INSTALLATION GUIDE

## FOR RESIDENTIAL FLOORS



Distributed by:

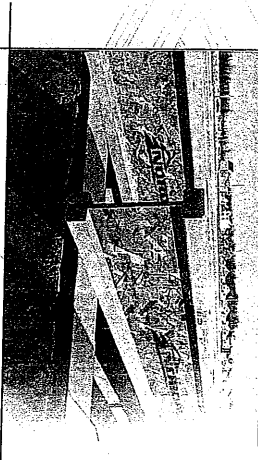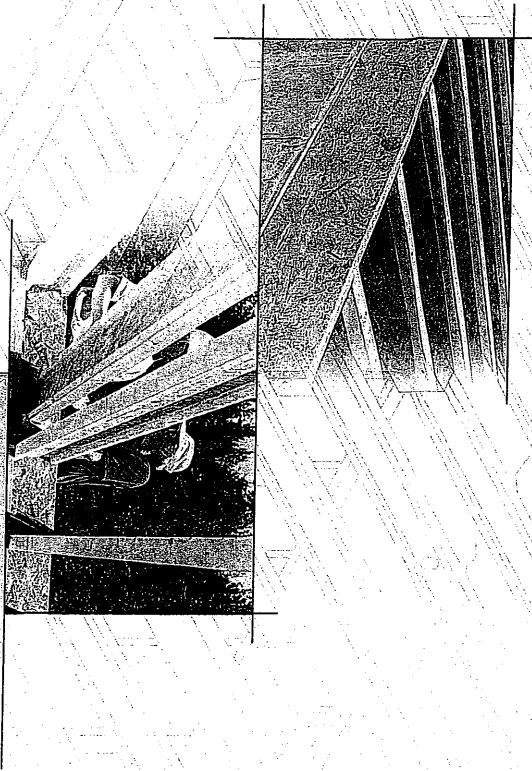

N-C301 / November 2014

### SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.



Never stack building materials over unsheathed I-joists. Once sheathed, do not over-stress I-joist with concentrated loads from building materials.

#### WARNING

I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.


#### Avoid Accidents by Following these Important Guidelines:

1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-briding at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
  - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
  - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-briding.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged I-joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

### STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
  - Pick I-joists in bundles as shipped by the supplier.
  - Orient the bundles so that the webs of the I-joists are vertical.
  - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.




The mark of responsible forestry



1. Maximum **clear** spans applicable to simple-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 1.5 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CGBS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit States Design per CAN/CSA A88-09 Standard, and NBC 2010.
7. SI units conversion: 1 inch = 25.4 mm  
1 foot = 0.305 m

[illegible]

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the I-joist.

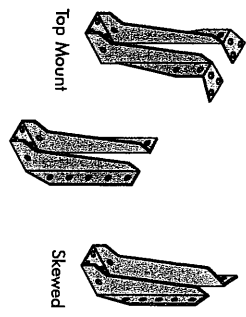


**RECOMMENDATIONS:**

- A **bearing stiffener** is required in all engineered applications with factored reactions greater than shown in the I-Joist properties table found of the *I-Joist Construction Guide* (C101). The gap between the stiffener and the flange is at the top.
- A **bearing stiffener** is required when the I-Joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.

Diagram illustrating a concentrated load on a beam with a stiffener. The beam is labeled "CONCENTRATED LOAD (Load stiffener)". The stiffener is labeled "Tight Joint No Gap". The beam is supported by "END BEARING" and "GAP". The stiffener is labeled "No Gap". The beam is labeled "Approx. 2' I" and "Approx. 2' I". The stiffener is labeled "Approx. 2' I". The beam is labeled "Approx. 2' I". The stiffener is labeled "Approx. 2' I".

### STIFFENER SIZE REQUIREMENTS

| Flange Width | Web Stiffener Size Each Side of Web |
|--------------|-------------------------------------|
| 2-1/2"       | 1" x 2-5/16" minimum width          |
| 3-1/2"       | 1-1/2" x 2-5/16" minimum width      |



| 33 pieces<br>per unit | 33 pieces<br>per unit | 33 pieces<br>per unit | 23 pieces<br>per unit | 23 pieces<br>per unit | 23 pieces<br>per unit | 23 pieces<br>per unit | 23 pieces<br>per unit | 23 pieces<br>per unit |
|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|-----------------------|
| 5-RF No.2             | 1950f MSR             | 2100f MSR             | 1950f MSR             | 2100f MSR             | 2400f MSR             | NPG Lumber            |                       |                       |
|                       |                       |                       |                       |                       |                       |                       |                       |                       |
|                       |                       |                       |                       |                       |                       |                       | NI-60                 | NI-70                 |
|                       |                       |                       |                       |                       |                       |                       |                       |                       |
|                       |                       |                       |                       |                       |                       |                       | NI-80                 | NI-90                 |
|                       |                       |                       |                       |                       |                       |                       |                       |                       |
|                       |                       |                       |                       |                       |                       |                       | NI-90x                |                       |
|                       |                       |                       |                       |                       |                       |                       |                       |                       |

Chemtrens Chibougoumau Ltd. harvests its own trees, which enables Nordic products to adhere to strict quality control procedures throughout the manufacturing process. Every phase of the operation, from forest to the finished product, reflects our commitment to quality.

lumber in their flanges, ensuring longer span carrying capacity.

2015-04-16


# INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact your supplier.
2. Except for cutting to length, I-joist flanges should **never** be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple span joists must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rafter. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge **may never** be used as blocking or rim boards. I-joist blocking panels or other engineered wood products – such as rim board – must be cut to fit between the I-joists, and on I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.




FIGURE 1  
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

Some framing requirements such as erection bracing and blocking panels have been omitted for clarity.

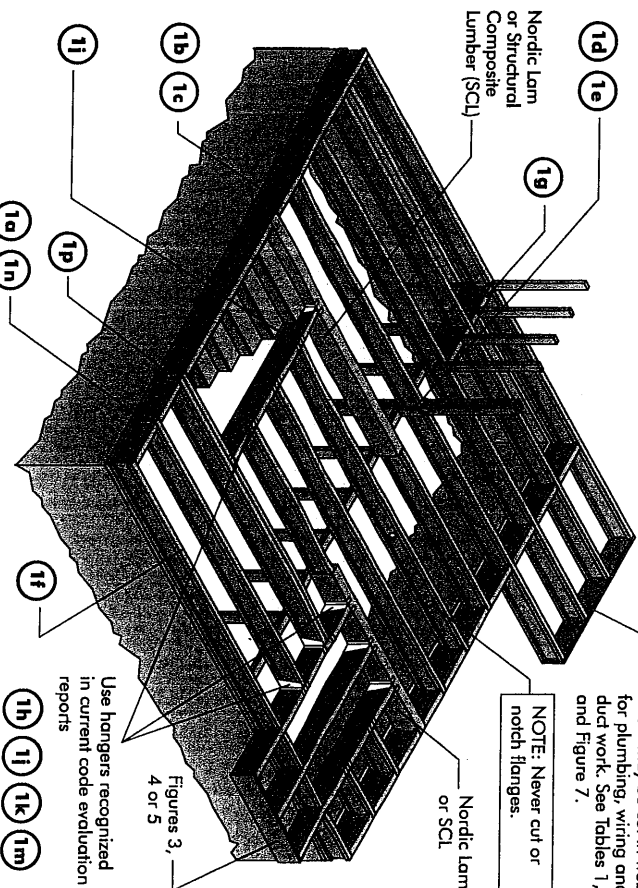


All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

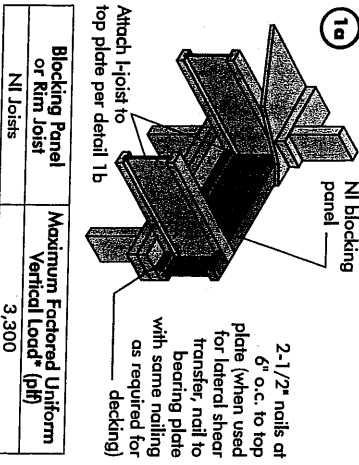



| Blocking Panel or Rim Joist | Maximum Factored Uniform Vertical Load* (pf) |
|-----------------------------|--|
| N Joists                    | 3,300  |

\*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

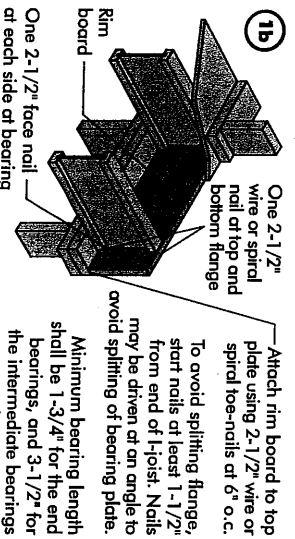









| Blocking Panel or Rim Joist | Maximum Factored Uniform Vertical Load* (pf) |
|-----------------------------|--|
| 1-1/8" Rim Board Plus       | 8,090  |

\*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

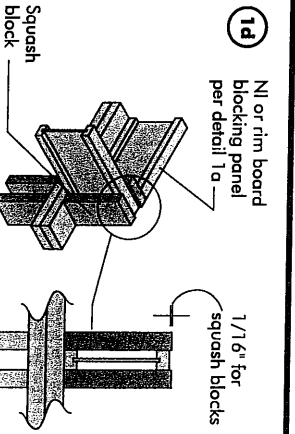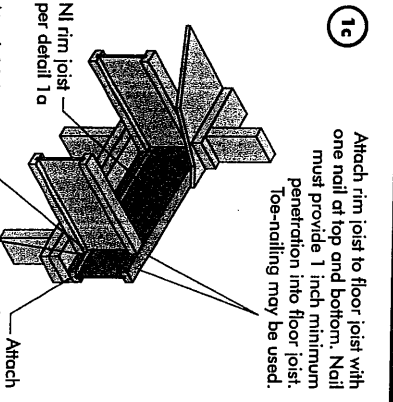

| Pair of Squash Blocks | Maximum Factored Vertical per Pair of Squash Blocks (lbs) |
|-----------------------|---|
| 2x Lumber             | 3-1/2" wide 5,500<br>5-1/2" wide 8,500                    |
| 1-1/8" Rim Board Plus | 4,300 6,600   |





Provide lateral bracing per detail 1a, 1b, or 1c

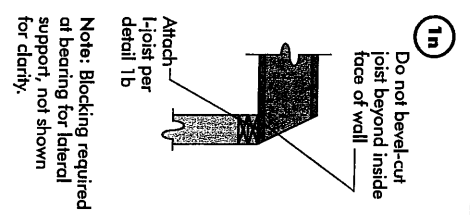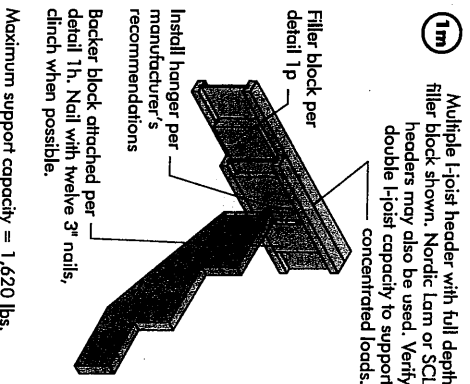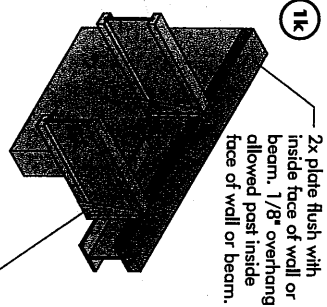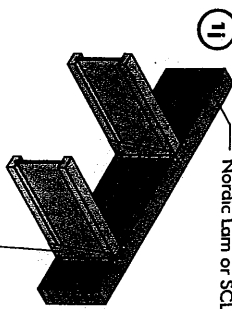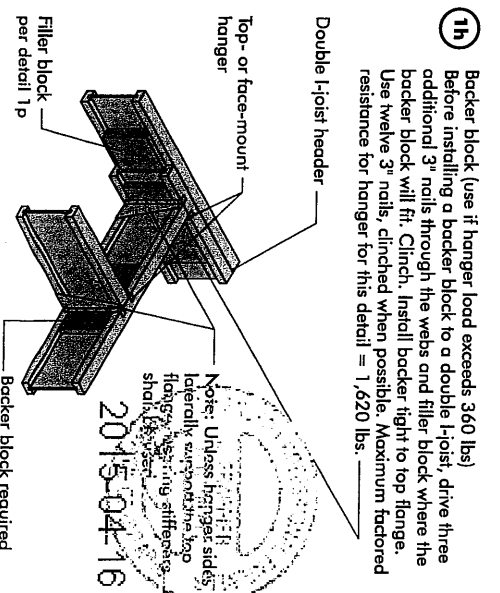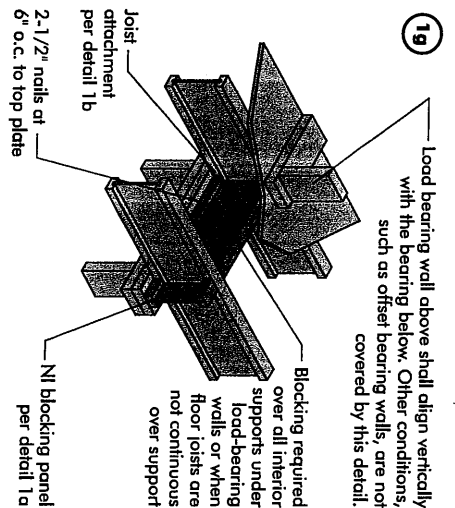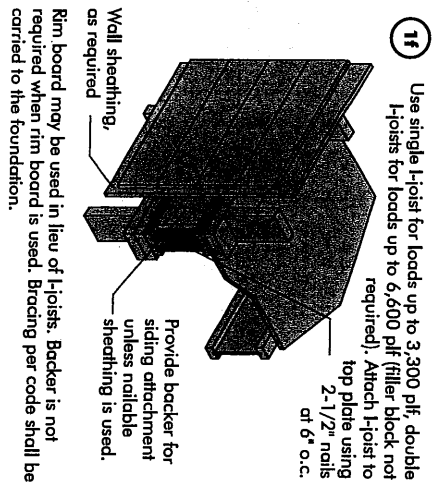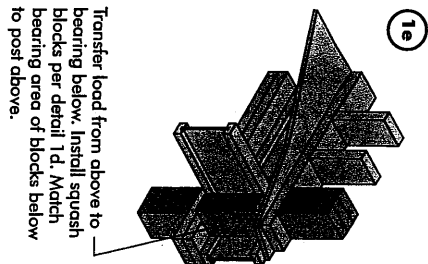

**BACKER BLOCKS** (Blocks must be long enough to permit required nailing without splitting)


| Flange Width | Material Thickness Required* | Minimum Depth** |
|--------------|------------------------------|-----------------|
| 2-1/2"       | 1"                           | 5-1/2"          |
| 3-1/2"       | 1-1/2"                       | 7-1/4"          |

\* Minimum grade for backer block material shall be S-P-F No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-Q325 or CAN/CSA-Q437 Standard.  
 \*\* For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

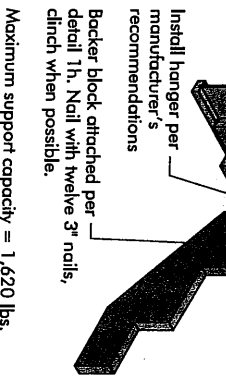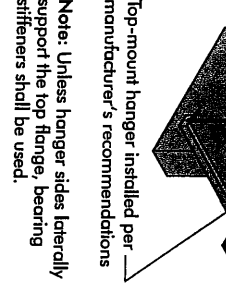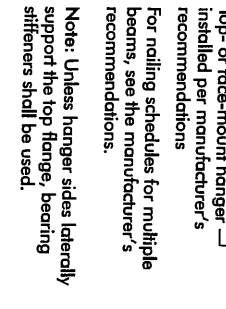





**Notes:**

1. Support back of I-joist web during nailing to prevent damage to web/flange connection.
2. Leave a 1/8" to 1/4-inch gap between top of filler block and bottom of top I-joist flange.
3. Filler block is required between joists for full length of span.
4. Nail joists together with two rows of 3" nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
5. The maximum factored load that may be applied to one side of the double joist using this detail is 860 lb/ft. Verify double I-joist capacity.







**Notes:**

1. In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.

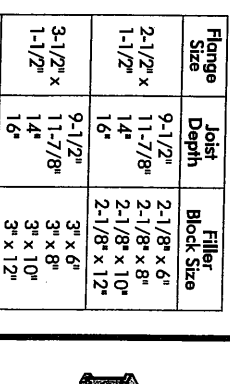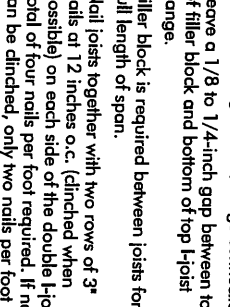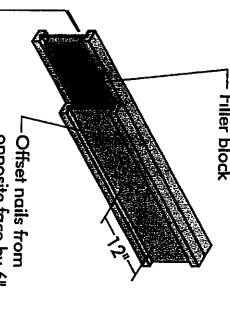

**Notes:**

1. In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.




**Notes:**


1. In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.

## CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

### 3a I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

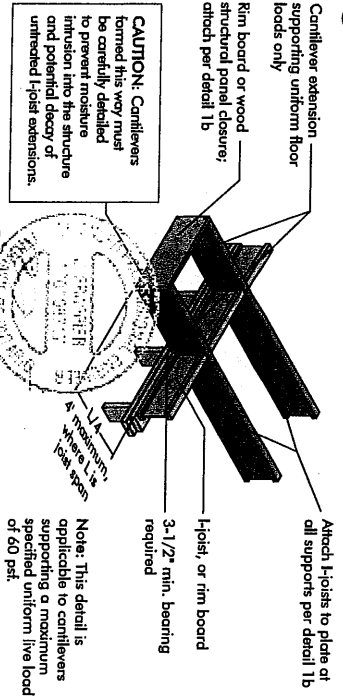


### 3b LUMBER CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

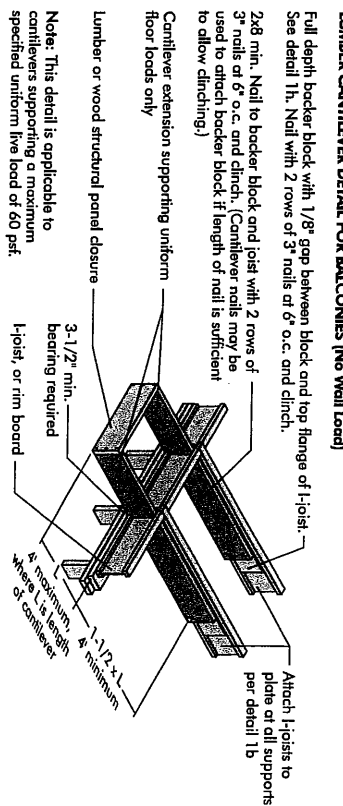


## CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

### 4a Method 1 — SHEATHING REINFORCEMENT ONE SIDE

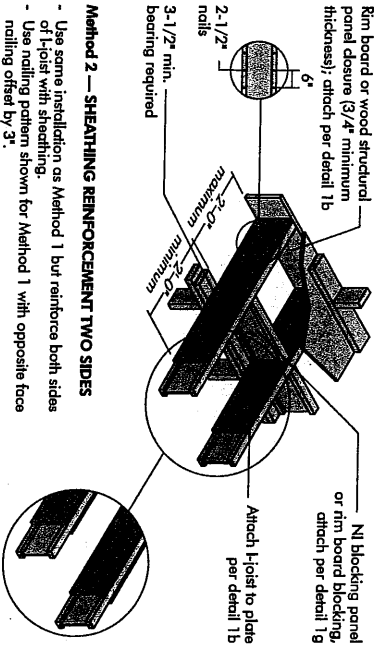


### Method 2 — SHEATHING REINFORCEMENT TWO SIDES




Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

### 4b Alternate Method 2 — DOUBLE I-JOIST

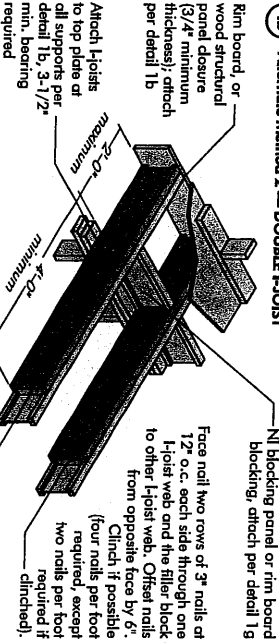

Block I-joists together with filler blocks for the full length of the reinforcement. For I-joist flange widths greater than 3 inches place an additional row of 3" nails along the centreline of the reinforcing panel from each side. Clinch when possible.

## CANTILEVER REINFORCEMENT METHODS ALLOWED

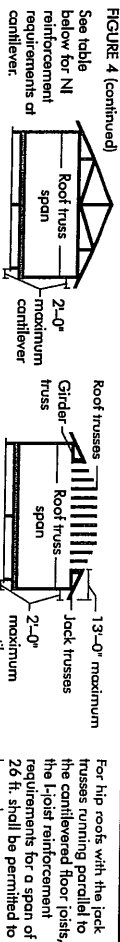

| JOIST DEPTH (in.) | ROOF TRUSS SPAN (ft.) |    | ROOF TRUSS JOIST SPACING (in.) |      | ROOF TRUSS JOIST SPACING (in.) |    | ROOF TRUSS JOIST SPACING (in.) |      | ROOF TRUSS JOIST SPACING (in.) |    | ROOF TRUSS JOIST SPACING (in.) |      |
|-------------------|-----------------------|----|--------------------------------|------|--------------------------------|----|--------------------------------|------|--------------------------------|----|--------------------------------|------|
|                   | 11                    | 12 | 16                             | 19.2 | 24                             | 12 | 16                             | 19.2 | 24                             | 12 | 16                             | 19.2 |
| 12                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 14                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 16                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 18                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 20                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 22                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 24                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 26                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 28                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 30                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 32                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 34                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 36                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 38                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 40                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 42                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 44                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 46                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 48                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 50                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 52                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 54                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 56                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 58                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |
| 60                |                       |    |                                |      |                                |    |                                |      |                                |    |                                |      |


1. N = No reinforcement required.
2. NI = Reinforced with 3/4" wood structural panel on one side only.
3. X = Try a deeper joist or closer spacing.
4. For larger openings, or multiple 3'-0" wide openings spaced less than 6'-0" o.c., additional joists beneath the opening's cripple studs may be required.
5. Table applies to joists 12" to 24" o.c. that meet the roof span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use maximum width window or door openings.
6. For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam.
7. When the roof is framed using a ridge beam, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
8. Cantilevered joists supporting girder trusses or roof beams may require additional reinforcing.

# WEB HOLES

## RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

1. The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
2. I-joist top and bottom flanges must NEVER be cut, notched, or otherwise modified.
3. Whenever possible, field-cut holes should be centred on the middle of the web.
4. The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
5. The sides of square holes or largest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
6. Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the longest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
7. A knockout is **not** considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
8. Holes measuring 1-1/2 inches or smaller shall be permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
9. A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
10. All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
11. Limit three maximum size holes per span, of which one may be a duct chase opening.
12. A group of round holes at approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

FIGURE 7  
FIELD-CUT HOLE LOCATOR

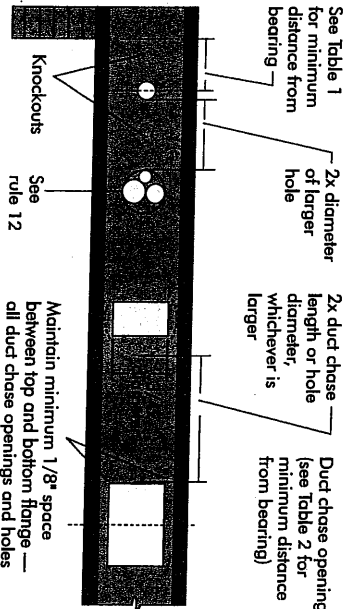

A knockout is **NOT** considered a hole, may be utilized wherever it occurs and may be ignored for purposes of calculating minimum distances between holes.

TABLE 1  
LOCATION OF CIRCULAR HOLES IN JOIST WEBS  
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

| Joist Depth   | Joist Series | 2 | 3 | 4 | 5 | 6 | 6-1/4 | 7 | 8 | 8-5/8 | 9 | 10 | 10-3/4 | 11 | 12 | 12-3/4 | Span adjustment Factor |
|---|--------------|---|---|---|---|---|-------|---|---|-------|---|----|--------|----|----|--------|------------------------|
| Minimum distance from inside face of any support to centre of hole (ft.-in.)          |              |   |   |   |   |   |       |   |   |       |   |    |        |    |    |        |                        |
| Round hole diameter (in.)   |              |   |   |   |   |   |       |   |   |       |   |    |        |    |    |        |                        |
| 1. Above table may be used for I-joist spacing of 24 inches on centre or less.        |              |   |   |   |   |   |       |   |   |       |   |    |        |    |    |        |                        |
| 2. Hole location distance is measured from inside face of supports to centre of hole. |              |   |   |   |   |   |       |   |   |       |   |    |        |    |    |        |                        |
| 3. Distances in this chart are based on uniformly loaded joists.                      |              |   |   |   |   |   |       |   |   |       |   |    |        |    |    |        |                        |

### OPTIONAL:

The above table is based on the I-joists used at their maximum span. If the I-joists are placed at less than their full maximum span (see Maximum Floor Spacing), the minimum distance from the centreline of the hole to the face of any support (D) as given above may be reduced as follows:

Where:

$$D_{\text{reduced}} = \frac{L_{\text{actual}}}{L_{\text{span}}} \times D$$

$L_{\text{actual}}$  = Distance from the inside face of any support to centre of hole, reduced for less-than-maximum span applications (ft.). The reduced distance shall not be less than 6 inches from the face of the support to edge of the hole.

$L_{\text{span}}$  = The actual measured span distance between the inside faces of supports (ft.).

$D$  = Span Adjustment Factor given in this table.

$D_{\text{actual}}$  = The minimum distance from the inside face of any support to centre of hole from this table.

If  $L_{\text{actual}}$  is greater than 1, use 1 in the above calculation for  $L_{\text{actual}}$ .

2015-04-16

TABLE 2  
DUCT CHASE OPENING SIZES AND LOCATIONS — Simple Span Only

| Joist Depth  | Joist Series | 8 | 10 | 12 | 14 | 16 | 18 | 20 | 22 | 24 |
|--|--------------|---|----|----|----|----|----|----|----|----|
| Minimum distance from inside face of any support to centre of opening (ft.-in.)  |              |   |    |    |    |    |    |    |    |    |
| Duct chase length (in.)  |              |   |    |    |    |    |    |    |    |    |
| 1. Above table may be used for I-joist spacing of 24 inches on centre or less.   |              |   |    |    |    |    |    |    |    |    |
| 2. Duct chase opening location distance is measured from inside face of supports to centre of opening.   |              |   |    |    |    |    |    |    |    |    |
| 3. The above table is based on simple-span joists only. For other applications, contact your local distributor.  |              |   |    |    |    |    |    |    |    |    |
| 4. Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. For other applications, contact your local distributor. |              |   |    |    |    |    |    |    |    |    |



**Never drill, cut or notch the flange, or over-cut the web.**  
Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.




# BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

## 5d SHEATHING REINFORCEMENT

Provide full depth blocking between joists over support (not shown)


Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

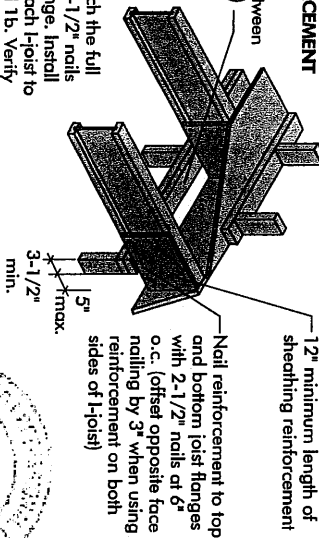

## 5b SET-BACK DETAIL

Rim board or wood structural panel closure (3/4" minimum thickness), attach per detail 1b.


Notes:  
- Provide full depth blocking between joists over support (not shown for clarity)  
- Attach I-joist to plate at all supports per detail 1b.  
- 3-1/2" minimum I-joist bearing required.

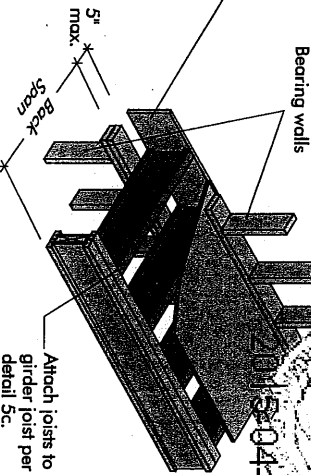

## 5c SET-BACK CONNECTION

Vertical solid sawn blocks (2x6 S-P-F No. 2 or better) nailed through joist web and web of girder using 2-1/2" nails.



Alternate for opposite side.

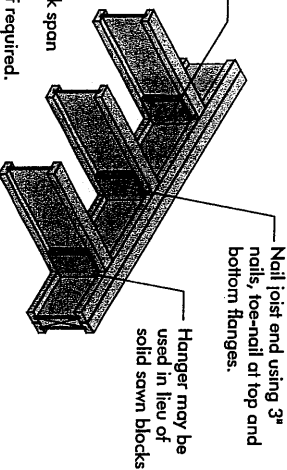

Notes:  
- Verify girder joist capacity if the back span exceeds the joist spacing.  
- Attach double I-joist per detail 1p, if required.

FIGURE 5 (continued)

See table below for NI reinforcement requirements at cantilever.

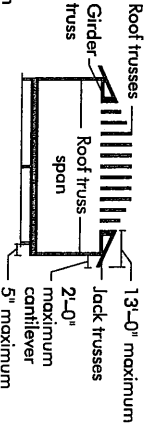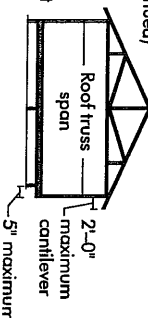

For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

## BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

| JOIST DEPTH<br>(in.) | ROOF TRUSS   |   | ROOF LOADING (UNFACTORED) |      |      |     | ROOF LOADING (UNFACTORED) |      |      |     |      |      |      |     |      |      |
|----------------------|--------------|---|---------------------------|------|------|-----|---------------------------|------|------|-----|------|------|------|-----|------|------|
|                      | SPAN<br>(ft) | LL = 30 psf, DL = 15 psf<br>JOIST SPACING (in.) | 12                        | 16   | 19.2 | 24  | 12                        | 16   | 19.2 | 24  | 12   | 16   | 19.2 | 24  |      |      |
| 12                   | 12           | 16  | 19.2                      | 24   | 12   | 16  | 19.2                      | 24   | 12   | 16  | 19.2 | 24   | 12   | 16  | 19.2 | 24   |
| 16                   | 16           | 24  | 32                        | 48   | 16   | 24  | 32                        | 48   | 16   | 24  | 32   | 48   | 16   | 24  | 32   | 48   |
| 20                   | 20           | 32  | 48                        | 72   | 20   | 32  | 48                        | 72   | 20   | 32  | 48   | 72   | 20   | 32  | 48   | 72   |
| 24                   | 24           | 48  | 72                        | 96   | 24   | 48  | 72                        | 96   | 24   | 48  | 72   | 96   | 24   | 48  | 72   | 96   |
| 28                   | 28           | 56  | 84                        | 112  | 28   | 56  | 84                        | 112  | 28   | 56  | 84   | 112  | 28   | 56  | 84   | 112  |
| 32                   | 32           | 64  | 96                        | 128  | 32   | 64  | 96                        | 128  | 32   | 64  | 96   | 128  | 32   | 64  | 96   | 128  |
| 36                   | 36           | 72  | 104                       | 144  | 36   | 72  | 104                       | 144  | 36   | 72  | 104  | 144  | 36   | 72  | 104  | 144  |
| 40                   | 40           | 80  | 112                       | 160  | 40   | 80  | 112                       | 160  | 40   | 80  | 112  | 160  | 40   | 80  | 112  | 160  |
| 44                   | 44           | 88  | 120                       | 176  | 44   | 88  | 120                       | 176  | 44   | 88  | 120  | 176  | 44   | 88  | 120  | 176  |
| 48                   | 48           | 96  | 128                       | 192  | 48   | 96  | 128                       | 192  | 48   | 96  | 128  | 192  | 48   | 96  | 128  | 192  |
| 52                   | 52           | 104   | 136                       | 208  | 52   | 104 | 136                       | 208  | 52   | 104 | 136  | 208  | 52   | 104 | 136  | 208  |
| 56                   | 56           | 112   | 144                       | 224  | 56   | 112 | 144                       | 224  | 56   | 112 | 144  | 224  | 56   | 112 | 144  | 224  |
| 60                   | 60           | 120   | 152                       | 240  | 60   | 120 | 152                       | 240  | 60   | 120 | 152  | 240  | 60   | 120 | 152  | 240  |
| 64                   | 64           | 128   | 160                       | 256  | 64   | 128 | 160                       | 256  | 64   | 128 | 160  | 256  | 64   | 128 | 160  | 256  |
| 68                   | 68           | 136   | 168                       | 272  | 68   | 136 | 168                       | 272  | 68   | 136 | 168  | 272  | 68   | 136 | 168  | 272  |
| 72                   | 72           | 144   | 176                       | 288  | 72   | 144 | 176                       | 288  | 72   | 144 | 176  | 288  | 72   | 144 | 176  | 288  |
| 76                   | 76           | 152   | 184                       | 304  | 76   | 152 | 184                       | 304  | 76   | 152 | 184  | 304  | 76   | 152 | 184  | 304  |
| 80                   | 80           | 160   | 192                       | 320  | 80   | 160 | 192                       | 320  | 80   | 160 | 192  | 320  | 80   | 160 | 192  | 320  |
| 84                   | 84           | 168   | 200                       | 336  | 84   | 168 | 200                       | 336  | 84   | 168 | 200  | 336  | 84   | 168 | 200  | 336  |
| 88                   | 88           | 176   | 208                       | 352  | 88   | 176 | 208                       | 352  | 88   | 176 | 208  | 352  | 88   | 176 | 208  | 352  |
| 92                   | 92           | 184   | 216                       | 368  | 92   | 184 | 216                       | 368  | 92   | 184 | 216  | 368  | 92   | 184 | 216  | 368  |
| 96                   | 96           | 192   | 224                       | 384  | 96   | 192 | 224                       | 384  | 96   | 192 | 224  | 384  | 96   | 192 | 224  | 384  |
| 100                  | 100          | 200   | 232                       | 400  | 100  | 200 | 232                       | 400  | 100  | 200 | 232  | 400  | 100  | 200 | 232  | 400  |
| 104                  | 104          | 208   | 240                       | 416  | 104  | 208 | 240                       | 416  | 104  | 208 | 240  | 416  | 104  | 208 | 240  | 416  |
| 108                  | 108          | 216   | 248                       | 432  | 108  | 216 | 248                       | 432  | 108  | 216 | 248  | 432  | 108  | 216 | 248  | 432  |
| 112                  | 112          | 224   | 256                       | 448  | 112  | 224 | 256                       | 448  | 112  | 224 | 256  | 448  | 112  | 224 | 256  | 448  |
| 116                  | 116          | 232   | 264                       | 464  | 116  | 232 | 264                       | 464  | 116  | 232 | 264  | 464  | 116  | 232 | 264  | 464  |
| 120                  | 120          | 240   | 272                       | 480  | 120  | 240 | 272                       | 480  | 120  | 240 | 272  | 480  | 120  | 240 | 272  | 480  |
| 124                  | 124          | 248   | 280                       | 496  | 124  | 248 | 280                       | 496  | 124  | 248 | 280  | 496  | 124  | 248 | 280  | 496  |
| 128                  | 128          | 256   | 288                       | 512  | 128  | 256 | 288                       | 512  | 128  | 256 | 288  | 512  | 128  | 256 | 288  | 512  |
| 132                  | 132          | 264   | 296                       | 528  | 132  | 264 | 296                       | 528  | 132  | 264 | 296  | 528  | 132  | 264 | 296  | 528  |
| 136                  | 136          | 272   | 304                       | 544  | 136  | 272 | 304                       | 544  | 136  | 272 | 304  | 544  | 136  | 272 | 304  | 544  |
| 140                  | 140          | 280   | 312                       | 560  | 140  | 280 | 312                       | 560  | 140  | 280 | 312  | 560  | 140  | 280 | 312  | 560  |
| 144                  | 144          | 288   | 320                       | 576  | 144  | 288 | 320                       | 576  | 144  | 288 | 320  | 576  | 144  | 288 | 320  | 576  |
| 148                  | 148          | 296   | 328                       | 592  | 148  | 296 | 328                       | 592  | 148  | 296 | 328  | 592  | 148  | 296 | 328  | 592  |
| 152                  | 152          | 304   | 336                       | 608  | 152  | 304 | 336                       | 608  | 152  | 304 | 336  | 608  | 152  | 304 | 336  | 608  |
| 156                  | 156          | 312   | 344                       | 624  | 156  | 312 | 344                       | 624  | 156  | 312 | 344  | 624  | 156  | 312 | 344  | 624  |
| 160                  | 160          | 320   | 352                       | 640  | 160  | 320 | 352                       | 640  | 160  | 320 | 352  | 640  | 160  | 320 | 352  | 640  |
| 164                  | 164          | 328   | 360                       | 656  | 164  | 328 | 360                       | 656  | 164  | 328 | 360  | 656  | 164  | 328 | 360  | 656  |
| 168                  | 168          | 336   | 368                       | 672  | 168  | 336 | 368                       | 672  | 168  | 336 | 368  | 672  | 168  | 336 | 368  | 672  |
| 172                  | 172          | 344   | 376                       | 688  | 172  | 344 | 376                       | 688  | 172  | 344 | 376  | 688  | 172  | 344 | 376  | 688  |
| 176                  | 176          | 352   | 384                       | 704  | 176  | 352 | 384                       | 704  | 176  | 352 | 384  | 704  | 176  | 352 | 384  | 704  |
| 180                  | 180          | 360   | 392                       | 720  | 180  | 360 | 392                       | 720  | 180  | 360 | 392  | 720  | 180  | 360 | 392  | 720  |
| 184                  | 184          | 368   | 400                       | 736  | 184  | 368 | 400                       | 736  | 184  | 368 | 400  | 736  | 184  | 368 | 400  | 736  |
| 188                  | 188          | 376   | 408                       | 752  | 188  | 376 | 408                       | 752  | 188  | 376 | 408  | 752  | 188  | 376 | 408  | 752  |
| 192                  | 192          | 384   | 416                       | 768  | 192  | 384 | 416                       | 768  | 192  | 384 | 416  | 768  | 192  | 384 | 416  | 768  |
| 196                  | 196          | 392   | 424                       | 784  | 196  | 392 | 424                       | 784  | 196  | 392 | 424  | 784  | 196  | 392 | 424  | 784  |
| 200                  | 200          | 400   | 432                       | 800  | 200  | 400 | 432                       | 800  | 200  | 400 | 432  | 800  | 200  | 400 | 432  | 800  |
| 204                  | 204          | 408   | 440                       | 816  | 204  | 408 | 440                       | 816  | 204  | 408 | 440  | 816  | 204  | 408 | 440  | 816  |
| 208                  | 208          | 416   | 448                       | 832  | 208  | 416 | 448                       | 832  | 208  | 416 | 448  | 832  | 208  | 416 | 448  | 832  |
| 212                  | 212          | 424   | 456                       | 848  | 212  | 424 | 456                       | 848  | 212  | 424 | 456  | 848  | 212  | 424 | 456  | 848  |
| 216                  | 216          | 432   | 464                       | 864  | 216  | 432 | 464                       | 864  | 216  | 432 | 464  | 864  | 216  | 432 | 464  | 864  |
| 220                  | 220          | 440   | 472                       | 880  | 220  | 440 | 472                       | 880  | 220  | 440 | 472  | 880  | 220  | 440 | 472  | 880  |
| 224                  | 224          | 448   | 480                       | 896  | 224  | 448 | 480                       | 896  | 224  | 448 | 480  | 896  | 224  | 448 | 480  | 896  |
| 228                  | 228          | 456   | 488                       | 912  | 228  | 456 | 488                       | 912  | 228  | 456 | 488  | 912  | 228  | 456 | 488  | 912  |
| 232                  | 232          | 464   | 496                       | 928  | 232  | 464 | 496                       | 928  | 232  | 464 | 496  | 928  | 232  | 464 | 496  | 928  |
| 236                  | 236          | 472   | 504                       | 944  | 236  | 472 | 504                       | 944  | 236  | 472 | 504  | 944  | 236  | 472 | 504  | 944  |
| 240                  | 240          | 480   | 512                       | 960  | 240  | 480 | 512                       | 960  | 240  | 480 | 512  | 960  | 240  | 480 | 512  | 960  |
| 244                  | 244          | 488   | 520                       | 976  | 244  | 488 | 520                       | 976  | 244  | 488 | 520  | 976  | 244  | 488 | 520  | 976  |
| 248                  | 248          | 496   | 528                       | 992  | 248  | 496 | 528                       | 992  | 248  | 496 | 528  | 992  | 248  | 496 | 528  | 992  |
| 252                  | 252          | 504   | 536                       | 1008 | 252  | 504 | 536                       | 1008 | 252  | 504 | 536  | 1008 | 252  | 504 | 536  | 1008 |
| 256                  | 256          | 512   | 544                       | 1024 | 256  | 512 | 544                       | 1024 | 256  | 512 | 544  | 1024 | 256  | 512 | 544  | 1024 |
| 260                  | 260          | 520   | 552                       | 1040 | 260  | 520 | 552                       | 1040 | 260  | 520 | 552  | 1040 | 260  | 520 | 552  | 1040 |
| 264                  | 264          | 528   | 560                       | 1056 | 264  | 528 | 560                       | 1056 | 264  | 528 | 560  | 1056 | 264  | 528 | 560  | 1056 |
| 268                  | 268          | 536   | 568                       | 1072 | 268  | 536 | 568                       | 1072 | 268  | 536 | 568  | 1072 | 268  | 536 | 568  | 1072 |
| 272                  | 272          | 544   | 576                       | 1088 | 272  | 544 | 576                       | 1088 | 272  | 544 | 576  | 1088 | 272  | 544 | 576  | 1088 |
| 276                  | 276          | 552   | 584                       | 1104 | 276  | 552 | 584                       | 1104 | 276  | 552 | 584  | 1104 | 276  | 552 | 584  | 1104 |
| 280                  | 280          | 560   | 592                       | 1120 | 280  | 560 | 592                       | 1120 | 280  | 560 | 592  | 1120 | 280  | 560 | 592  | 1120 |
| 284                  | 284          | 568   | 600                       | 1136 | 284  | 568 | 600                       | 1136 | 284  | 568 | 600  | 1136 | 284  | 568 | 600  | 1136 |
| 288                  | 288          | 576   | 608                       | 1152 | 288  | 576 | 608                       | 1152 | 288  | 576 | 608  | 1152 | 288  | 576 | 608  | 1152 |
| 292                  | 292          | 584   | 616                       | 1168 | 292  | 584 | 616                       | 1168 | 292  | 584 | 616  | 1168 | 292  | 584 | 616  | 1168 |
| 296                  | 296          | 592   | 624                       | 1184 | 296  | 592 | 624                       | 1184 | 296  | 592 | 624  | 1184 | 296  | 592 | 624  | 1184 |
| 300                  | 300          | 600   | 632                       | 1200 | 300  | 600 | 632                       | 1200 | 300  | 600 | 632  | 1200 | 300  | 600 | 632  | 1200 |
| 304                  | 304          | 608   | 640                       | 1216 | 304  | 608 | 640                       | 1216 | 304  | 608 | 640  | 1216 | 304  | 608 | 640  | 1216 |
| 308                  | 308          | 616   | 648                       | 1232 | 308  | 616 | 648                       | 1232 | 308  | 616 | 648  | 1232 | 308  | 616 | 648  | 1232 |
| 312                  | 312          | 624   | 656                       | 1248 | 312  | 624 | 656                       | 1248 | 312  | 624 | 656  | 1248 | 312  | 624 | 656  | 1248 |
| 316                  | 316          | 632   | 664                       | 1264 | 316  | 632 | 664                       | 1264 | 316  | 632 | 664  | 1264 | 316  | 632 | 664  | 1264 |
| 320                  | 320          | 640   | 672                       | 1280 | 320  | 640 | 672                       | 1280 | 320  | 640 | 672  | 1280 | 320  | 640 | 672  | 1280 |
| 324                  | 324          | 648   | 680                       | 1296 | 324  | 648 | 680                       | 1296 | 324  | 648 | 680  | 1296 | 324  | 648 | 680  | 1296 |
| 328                  | 328          | 656   | 688                       | 1312 | 328  | 656 | 688                       | 1312 | 328  | 656 | 688  | 1312 | 328  | 656 | 688  | 1312 |
| 332                  | 332          | 664   | 696                       | 1328 | 332  | 664 | 696                       | 1328 | 332  | 664 | 696  | 1328 | 332  | 664 | 696  | 1328 |
| 336                  | 336          | 672   | 704                       | 1344 | 336  | 672 | 704                       | 1344 | 336  | 672 | 704  | 1344 | 336  | 672 | 704  | 1344 |
| 340                  | 340          | 680   | 712                       | 1360 | 340  | 680 | 712                       | 1360 | 340  | 680 | 712  | 1360 | 340  | 680 | 712  | 1360 |
| 344                  | 344          | 688   | 720                       | 1376 | 344  | 688 | 720                       | 1376 | 344  | 688 | 720  | 1376 | 344  | 688 | 720  | 1376 |
| 348                  | 348          | 696   | 728                       | 1392 | 348  | 696 | 728                       | 1392 | 348  | 696 | 728  | 1392 | 348  | 696 | 728  | 1392 |
| 352                  | 352          | 704   | 736                       | 1408 | 352  | 704 | 736                       | 1408 | 352  | 704 | 736  | 1408 | 352  | 704 | 736  | 1408 |
| 356                  | 356          | 712   | 744                       | 1424 | 356  | 712 | 744                       | 1424 | 356  | 712 | 744  | 1424 | 356  | 712 | 744  | 1424 |
| 360                  | 360          | 720   | 752                       | 1440 | 360  | 720 | 752                       | 1440 |      |     |      |      |      |     |      |      |

## INSTALLING THE GLUED FLOOR SYSTEM

1. Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
2. Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
3. Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
4. Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when tapped into place with a block and sledgehammer.
5. Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
6. Apply two lines of glue on I-joists where panel ends butt to assure proper gluing of each end.
7. After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) than used on I-joist flanges.
8. Tap the second row of panels into place, using a block to protect groove edges.
9. Stagger end joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including T&G edges, is recommended. (Use a spacer tool or an 2-1/2" common nail to assure accurate and consistent spacing.)
10. Complete all nailing of each panel before glue sets. Check the manufacturer's recommendations for cure time. Warm weather accelerates glue setting. Use 2" ring- or screw-shank nails for panels 3/4-inch thick or less, and 2-1/2" ring- or screw-shank nails for thicker panels. Space nails per the table below. Closer nail spacing may be required by some codes, or for diaphragm construction. The finished deck can be walked on right away and will carry construction loads without damage to the glue bond.

### FASTENERS FOR SHEATHING AND SUBFLOORING(1)

| Maximum Joist Spacing (in.) | Minimum Panel Thickness (in.) | Common Wire or Spiral Nails | Nail Size and Type | Maximum Spacing of Fasteners | Staples | Edges | Internal Supports |
|-----------------------------|-------------------------------|-----------------------------|--------------------|------------------------------|---------|-------|-------------------|
| 16                          | 5/8                           | 2"                          | 1-3/4"             | 2"                           |         | 6"    | 12"               |
| 20                          | 5/8                           | 2"                          | 1-3/4"             | 2"                           |         | 6"    | 12"               |
| 24                          | 3/4                           | 2"                          | 1-3/4"             | 2"                           |         | 6"    | 12"               |

1. Fasteners of sheathing and subflooring shall conform to the above table.
2. Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
3. Flooring screws shall not be less than 1/8-inch in diameter.
4. Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
5. Use only adhesives conforming to CAN/CGSB-71.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues, check with panel manufacturer.

Ref.: NRC-CNRC, National Building Code of Canada 2010, Table 9.23.3.5.


**IMPORTANT NOTE:**  
Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.

## RIM BOARD INSTALLATION DETAILS


### 8a ATTACHMENT DETAILS WHERE RIM BOARDS ABOUT

#### Rim board Joint Between Floor Joists


2-1/2" nails at 6" o.c. (typical)

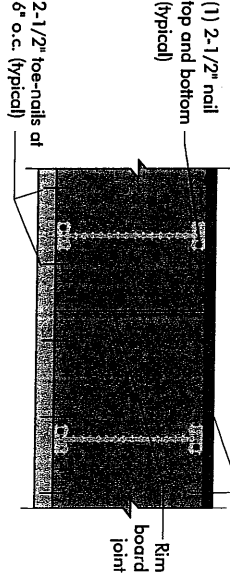


#### Rim board Joint at Corner

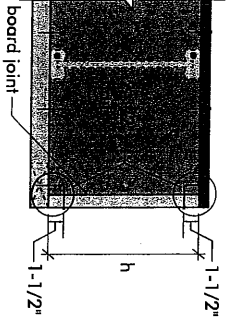

### 8b TOE-NAIL CONNECTION AT RIM BOARD



### 8c 2X LEDGER TO RIM BOARD ATTACHMENT DETAIL

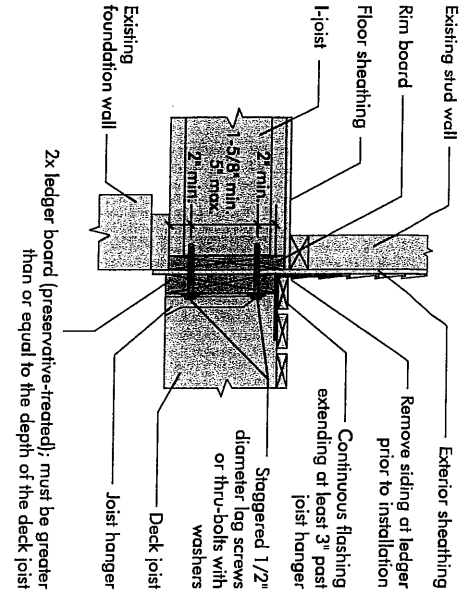


2015-04-16

## PRODUCT WARRANTY


Champion Challenge Furniture line is confident with our performance. Needs products are free from manufacturing defects in materials and workmanship.

Champion Challenge Furniture line is confident with our performance. Needs products are free from manufacturing defects in materials and workmanship.

Champion Challenge Furniture line is confident with our performance. Needs products are free from manufacturing defects in materials and workmanship.

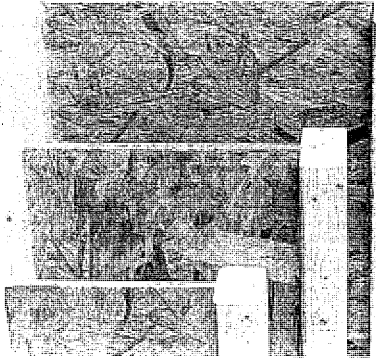

| LVL HEADER AND CONVENTIONAL LUMBER NAILING DETAILS |                |                          |
|--|----------------|--------------------------|
| DETAIL NUMBER                                      | NUMBER OF ROWS | SPACING (INCHES o/c) "d" |
| A  | 2              | 12                       |
| B  | 2              | 8                        |
| C  | 2              | 6                        |
| D  | 2              | 4                        |
| 1A   | 3              | 12                       |
| 1B   | 3              | 8                        |
| 1C   | 3              | 6                        |
| 1D   | 3              | 4                        |
| 2A   | 4              | 12                       |
| 2B   | 4              | 8                        |
| 2C   | 4              | 6                        |
| 2D   | 4              | 4                        |
| 3A   | 5              | 12                       |
| 3B   | 5              | 8                        |
| 3C   | 5              | 6                        |
| 3D   | 5              | 4                        |
| 4A   | 6              | 12                       |
| 4B   | 6              | 8                        |
| 4C   | 6              | 6                        |
| 4D   | 6              | 4                        |

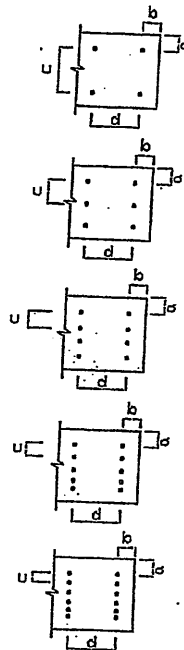

### NOTES:

- (1) MINIMUM LUMBER EDGE DISTANCE "a" = 1"
- (2) MINIMUM LUMBER END DISTANCE "b" = 2"
- (3) MINIMUM NAIL ROW SPACING "c" = 2"
- (4) STAGGER NAILS "d/2" BETWEEN PLYS FOR MULTI-PLY MEMBERS (3 PLY OR MORE)
- (5) ALL NAILS ARE 3-1/2" ARDOX SPIRAL NAILS
- (6) DO NOT USE AIR-DRIVEN NAILS



DWG NO TAMN1001.14

STRUCTURAL  
COMPONENT ONLY

TO BE USED ONLY  
WITH BEAM CALCS  
BEARING THE  
STAMP BELOW

PROVIDE NAILING  
DETAIL # X SEE  
DWG # TAMN1001-14