

FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED


DATE: 2018-02-14

1st FLOOR

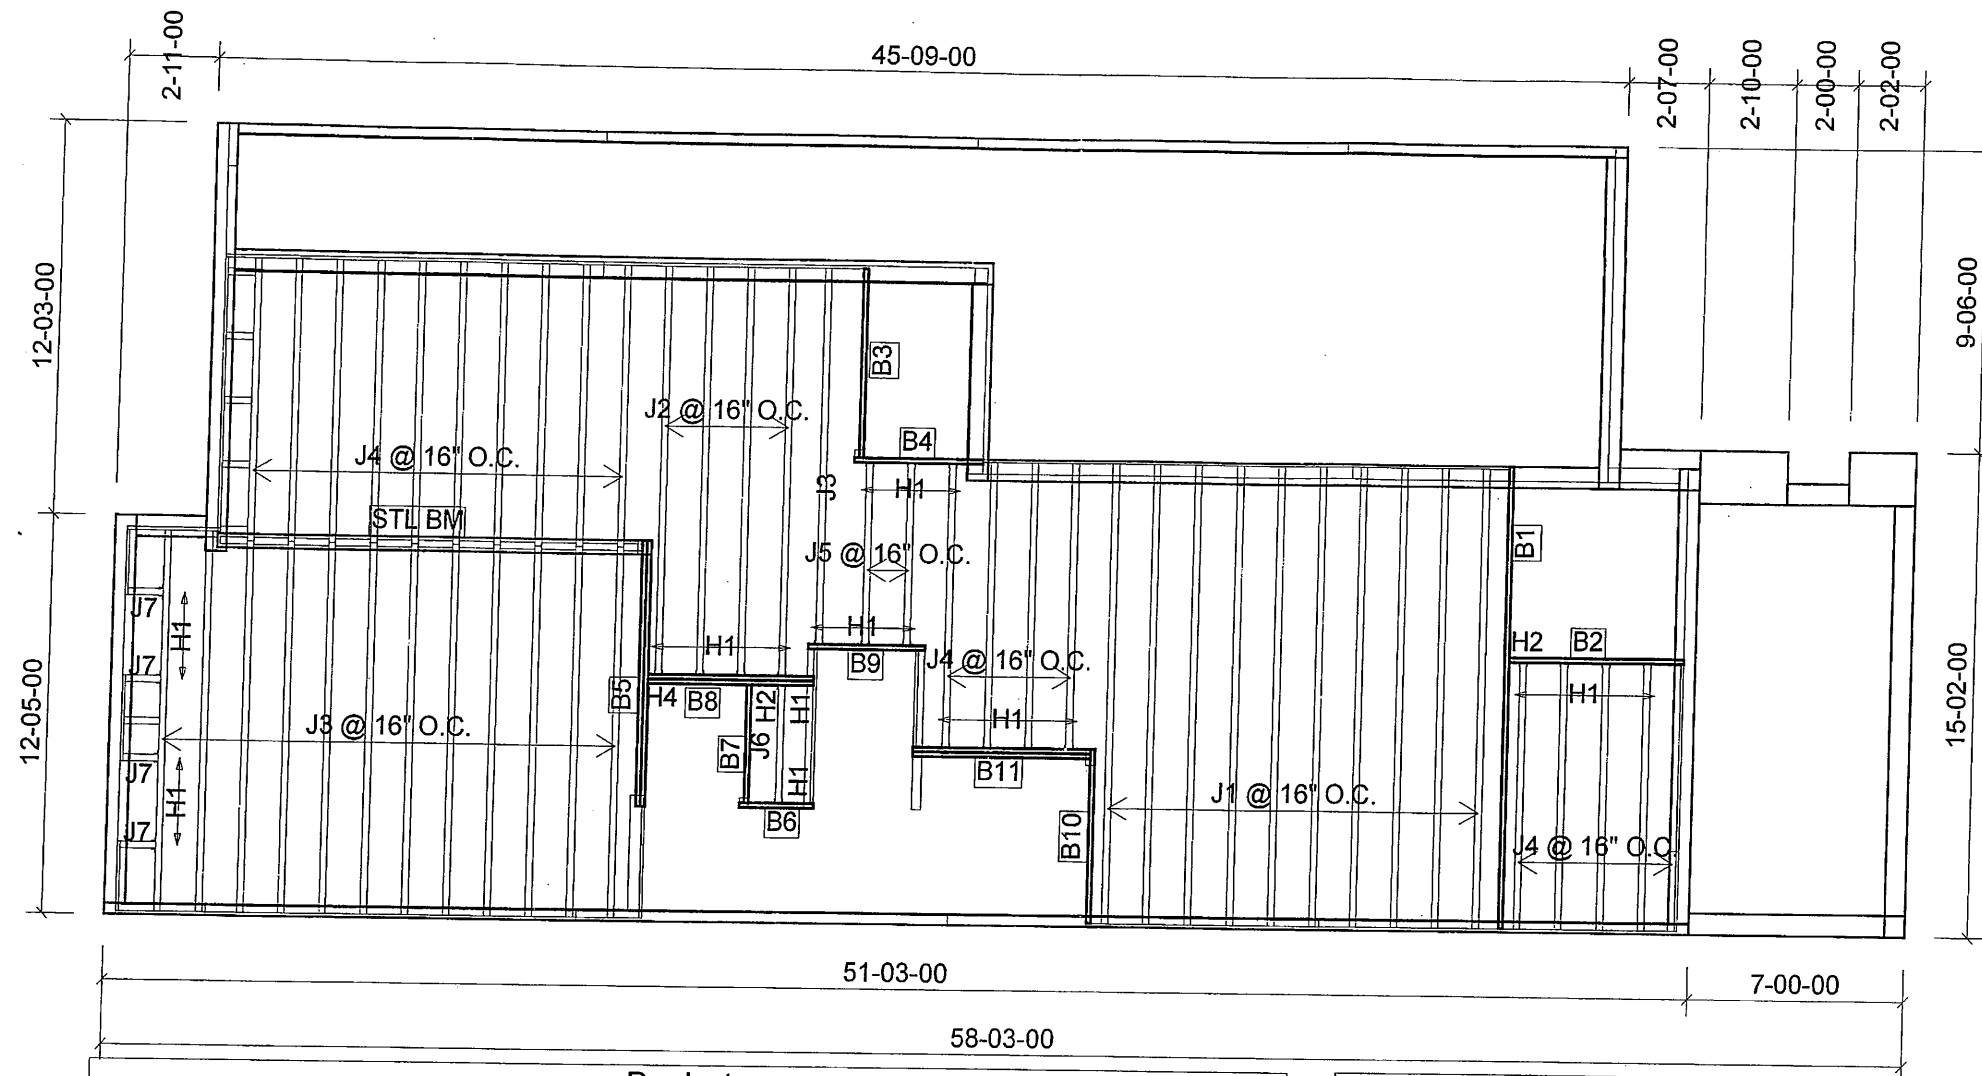

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	10
J2	14-00-00	9 1/2" NI-40x	1	4
J3	12-00-00	9 1/2" NI-40x	1	13
J4	10-00-00	9 1/2" NI-40x	1	19
J5	6-00-00	9 1/2" NI-40x	1	2
J6	4-00-00	9 1/2" NI-40x	1	1
J7	2-00-00	9 1/2" NI-40x	1	4
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B5	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B7	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B9	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
9	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10
1	H4	HGUS410

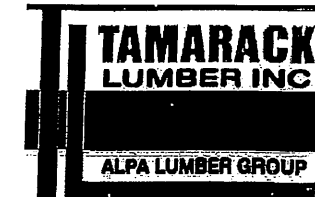

FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:
REFER TO THE **NORDIC INSTALLATION**
GUIDE FOR PROPER STORAGE AND
INSTALLATION.
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F
REQ'D UNDER INTERIOR UNIFORM LOAD
BEARING WALLS. **MULTIPLE SQUASH**
BLOCKS REQ'D UNDER CONCENTRATED
LOADS. SEE FIGURE 1. **CANTILEVERED**
JOISTS INCLUDING **CANT' OVER BRICK** REQ.
I-JOIST BLOCKING ALONG BEARING AND
RIMBOARD CLOSURE AT ENDS. SEE
FIGURES 4 & 5 FOR REINFORCEMENT
REQUIREMENTS. FOR **HOLES** INCLUDING
DUCT CHASE AND **FIELD CUT OPENINGS**
SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE**
APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED


DATE: 2018-02-14

1st FLOOR

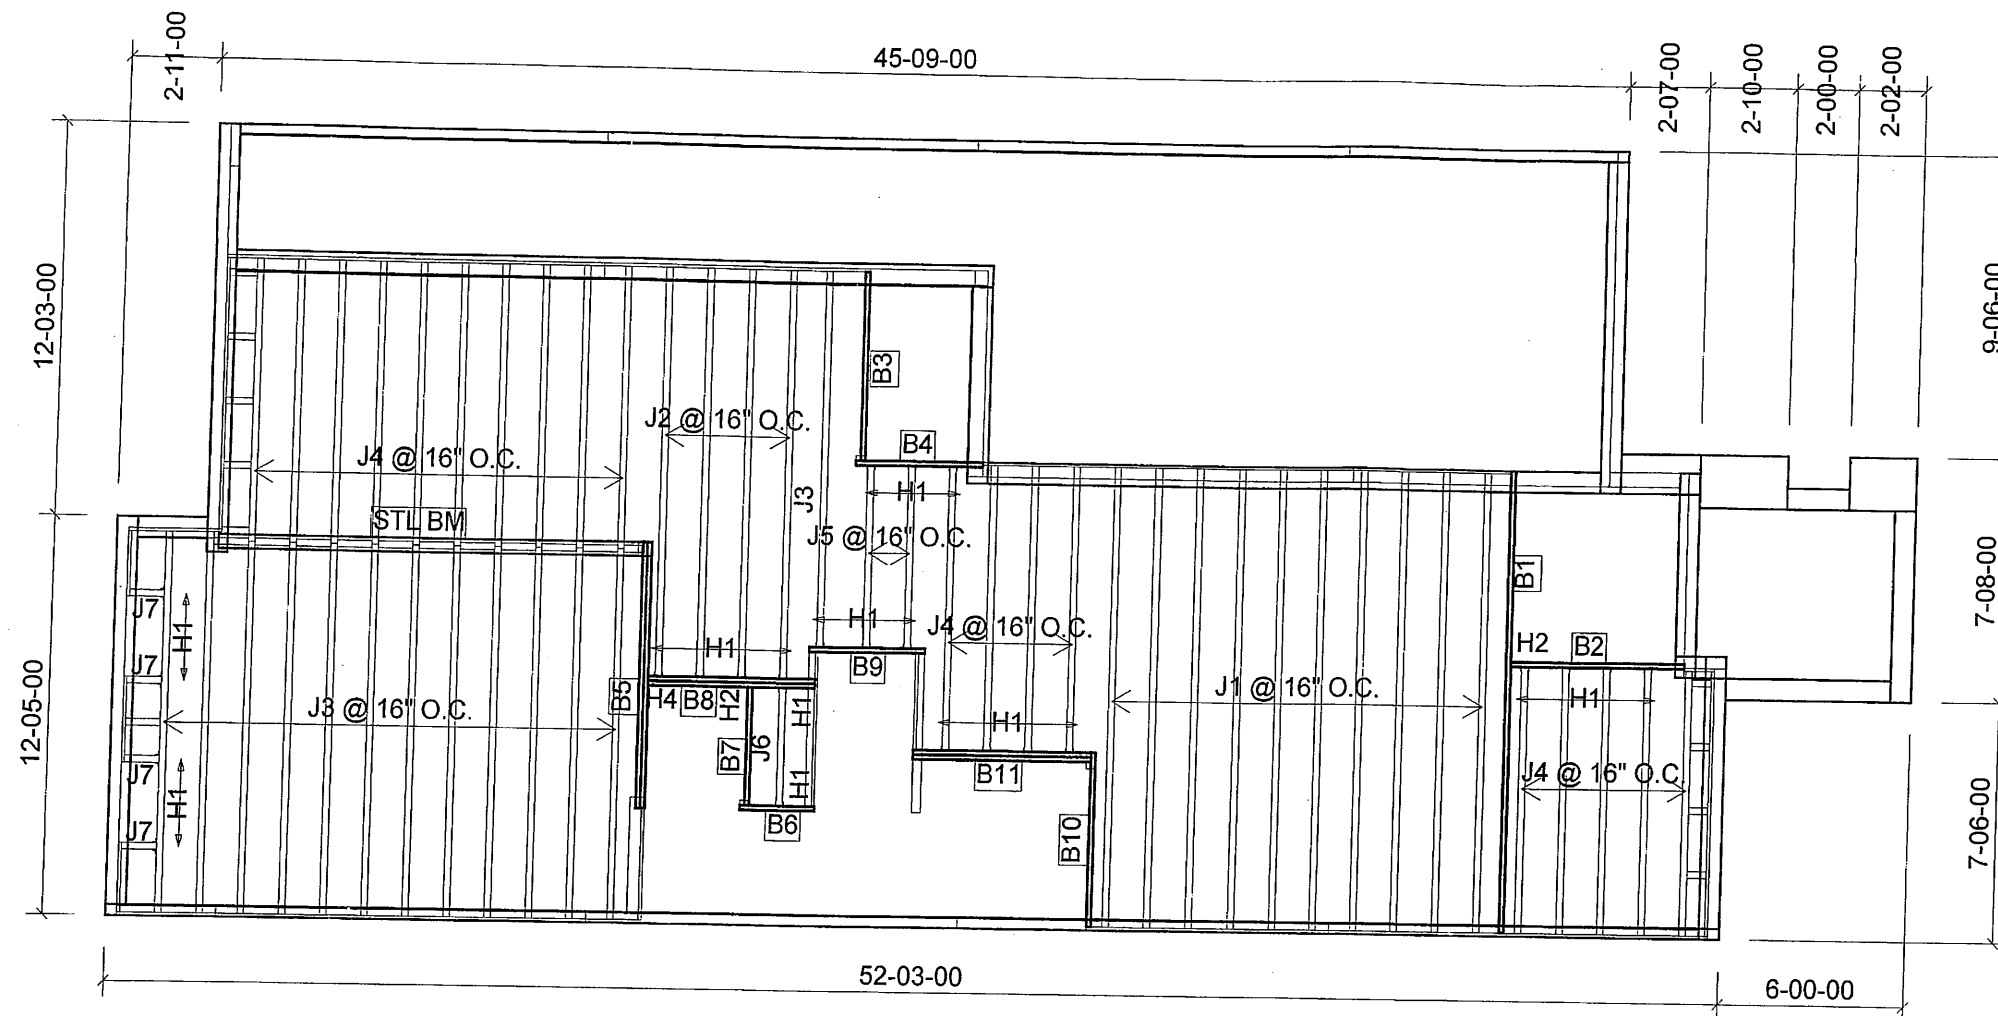

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	10
J2	14-00-00	9 1/2" NI-40x	1	4
J3	12-00-00	9 1/2" NI-40x	1	13
J4	10-00-00	9 1/2" NI-40x	1	19
J5	6-00-00	9 1/2" NI-40x	1	2
J6	4-00-00	9 1/2" NI-40x	1	1
J7	2-00-00	9 1/2" NI-40x	1	4
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B5	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B7	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B9	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
9	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10
1	H4	HGUS410

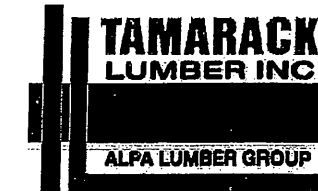

FROM PLAN DATED: SEPTL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 3

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:

REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH**

BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED**

JOISTS INCLUDING **CANT' OVER BRICK** REQ.

I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE

FIGURES 4 & 5 FOR REINFORCEMENT

REQUIREMENTS. FOR **HOLES** INCLUDING

DUCT CHASE AND **FIELD CUT OPENINGS**

SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE**

APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED


DATE: 2018-02-14


1st FLOOR

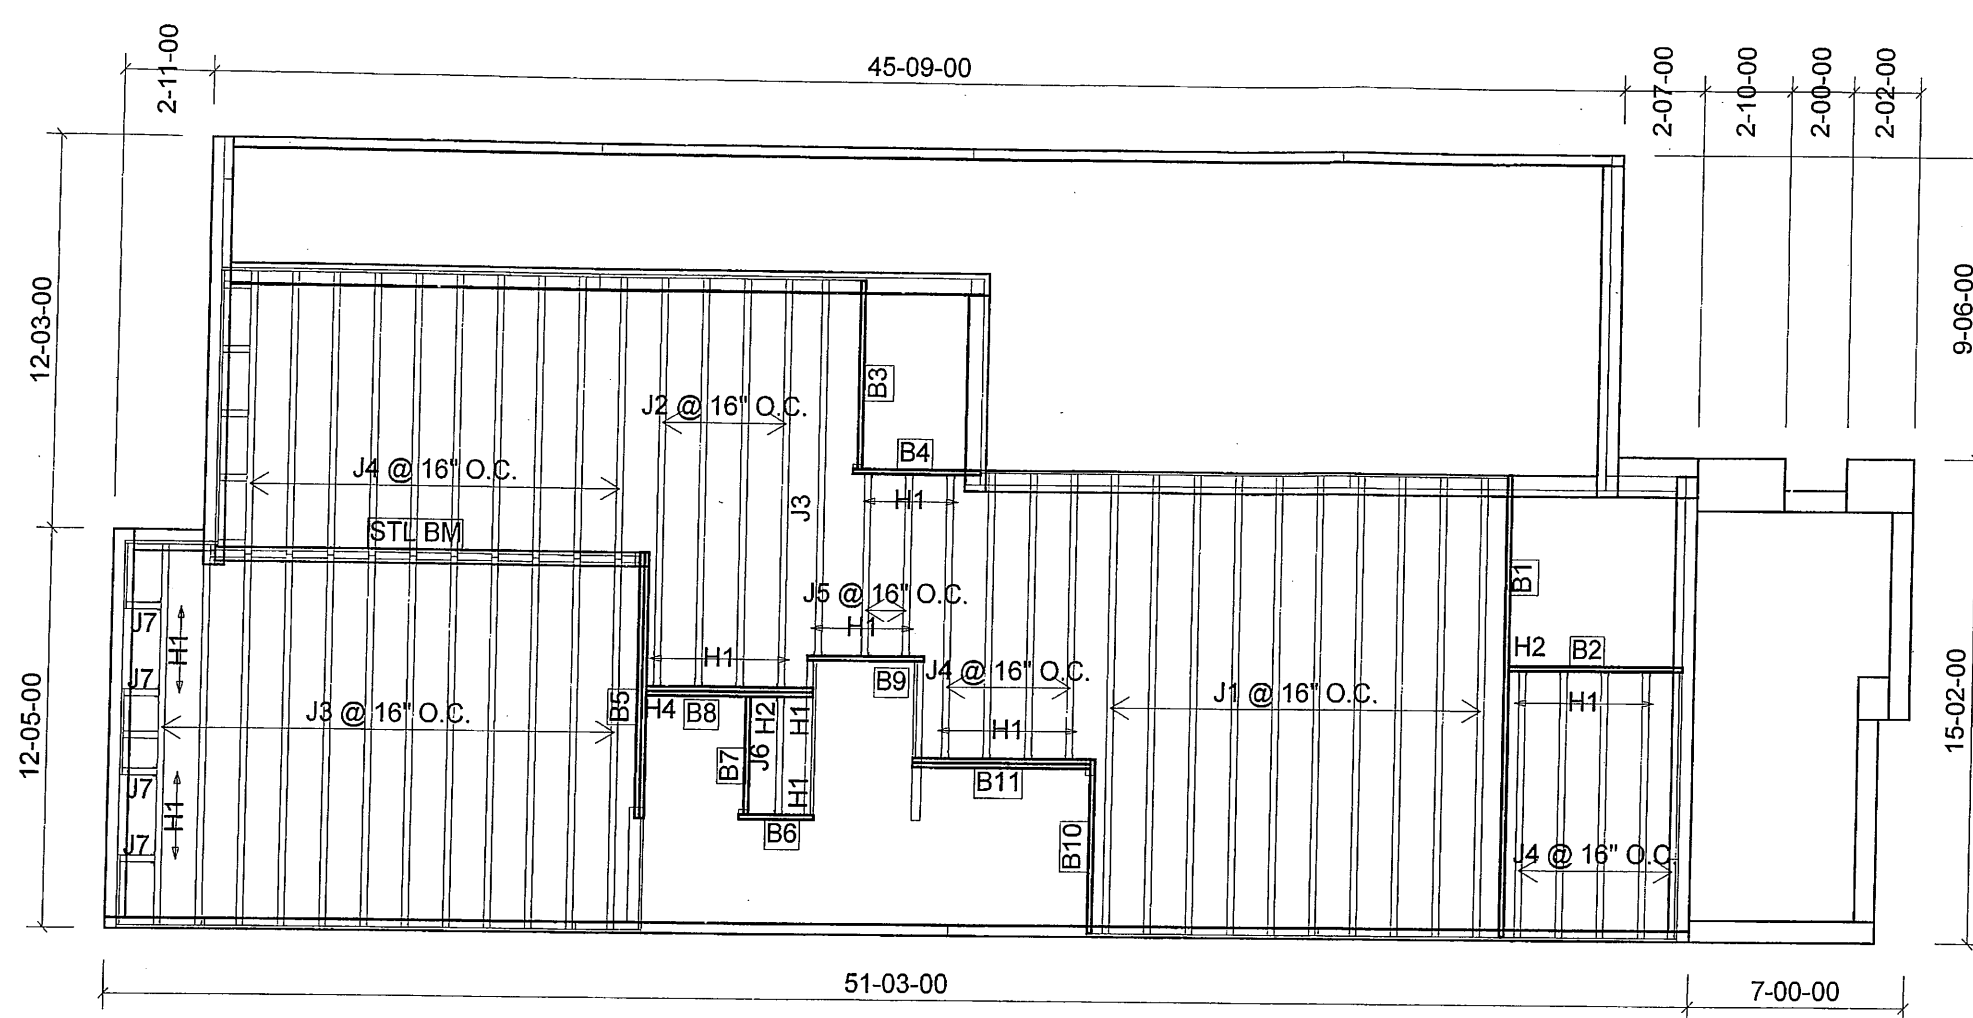

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	10
J2	14-00-00	9 1/2" NI-40x	1	4
J3	12-00-00	9 1/2" NI-40x	1	13
J4	10-00-00	9 1/2" NI-40x	1	19
J5	6-00-00	9 1/2" NI-40x	1	2
J6	4-00-00	9 1/2" NI-40x	1	1
J7	2-00-00	9 1/2" NI-40x	1	4
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B5	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B7	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B9	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
9	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
1	H2	HUS1.81/9.5
1	H2	HUS1.81/10
1	H4	HGUS410

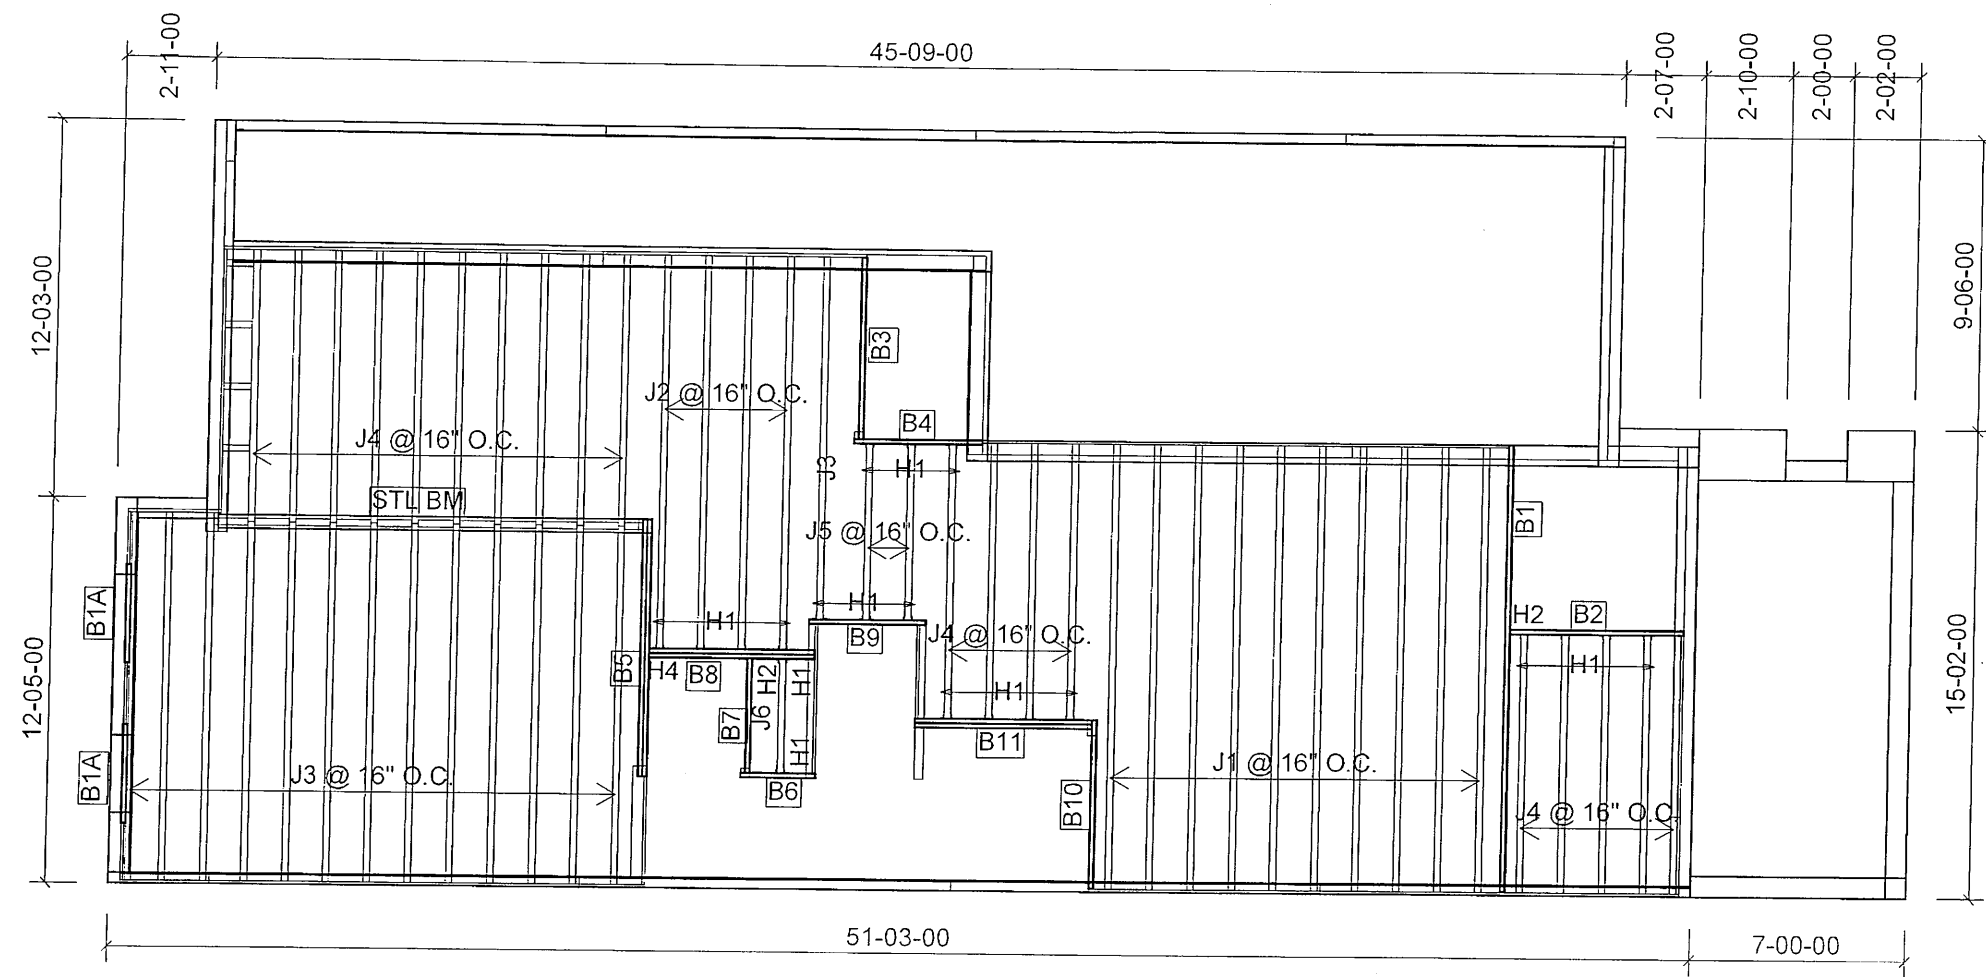DECK CONDITION

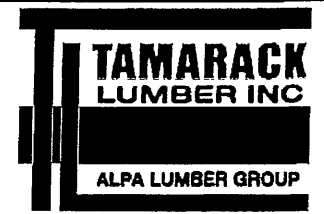

FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 3

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:

REFER TO THE **NORDIC INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 15.0 lb/ft²


TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2018-02-22


1st FLOOR

DECK CONDITION

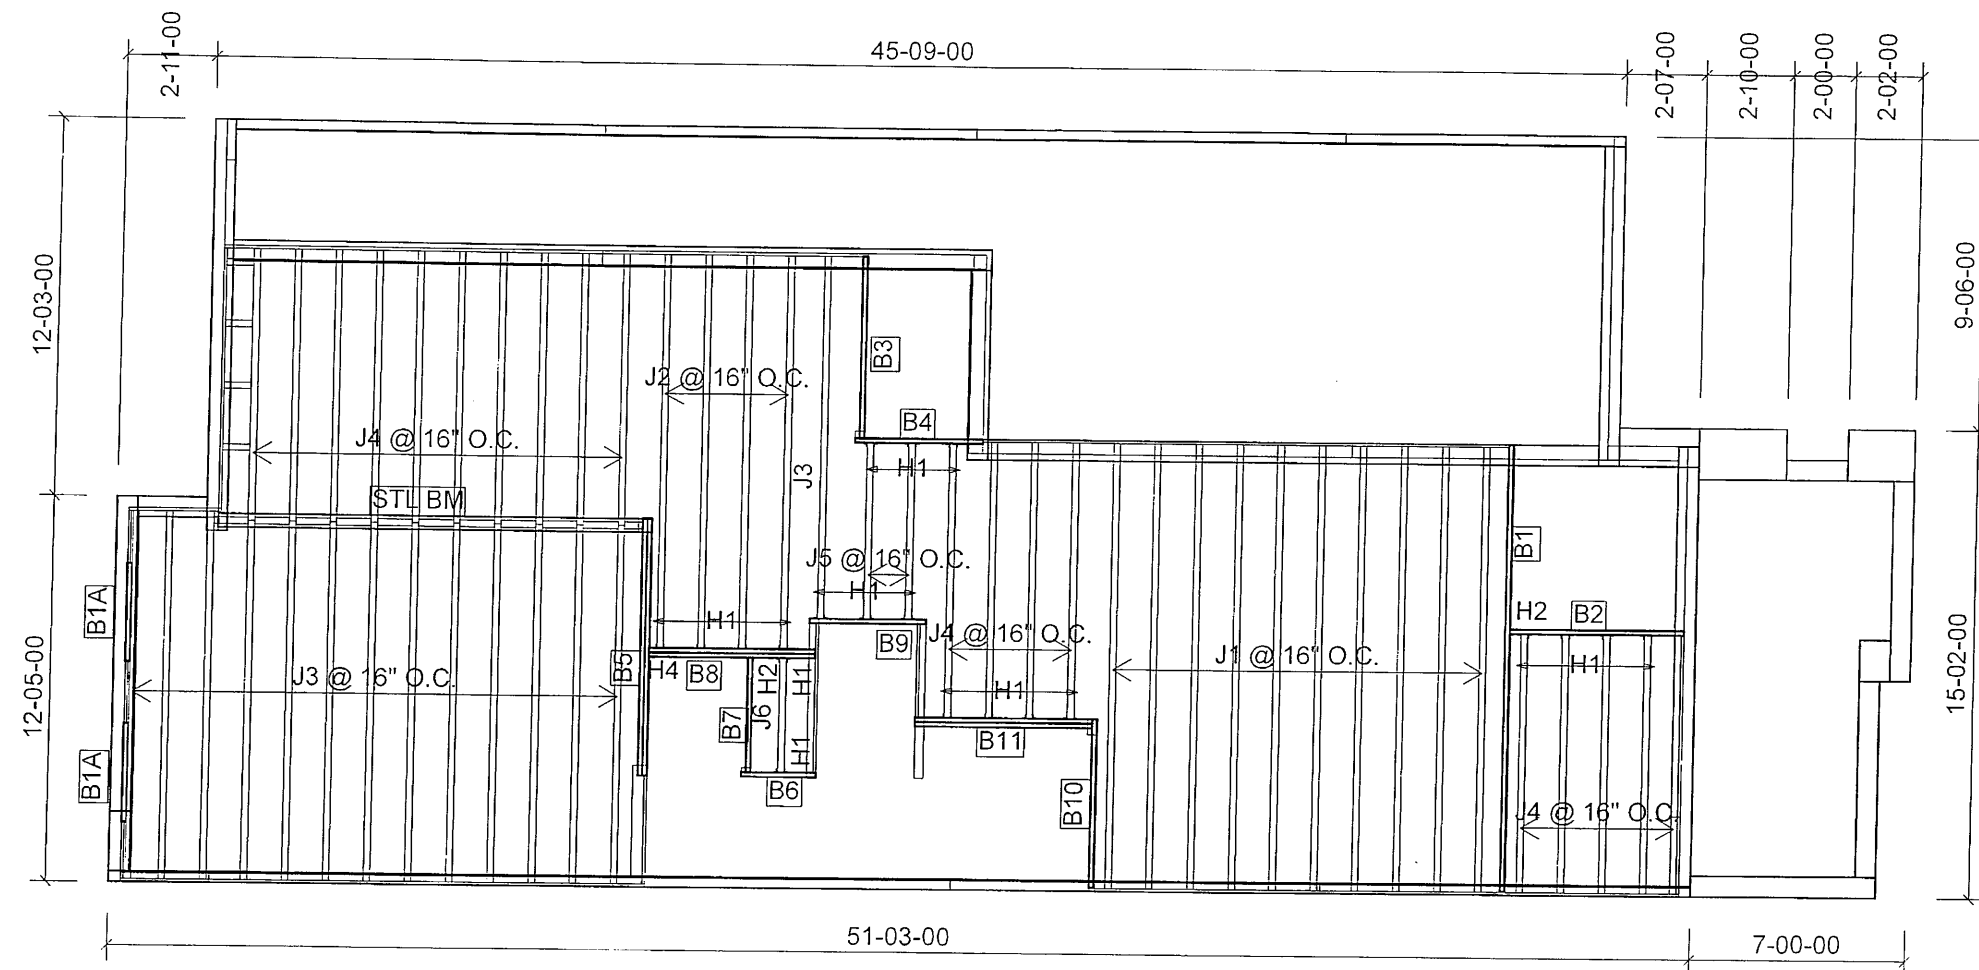

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	10
J2	14-00-00	9 1/2" NI-40x	1	4
J3	12-00-00	9 1/2" NI-40x	1	14
J4	10-00-00	9 1/2" NI-40x	1	19
J5	6-00-00	9 1/2" NI-40x	1	2
J6	4-00-00	9 1/2" NI-40x	1	1
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B5	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	2
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B7	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B9	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
9	H1	IUS2.56/9.5
1	H2	HUS1.81/9.5
1	H2	HUS1.81/10
1	H4	HGUS410

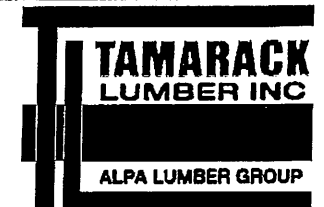

FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:

REFER TO THE **NORDIC INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 15.0 lb/ft²


TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2018-02-22


1st FLOOR

DECK CONDITION

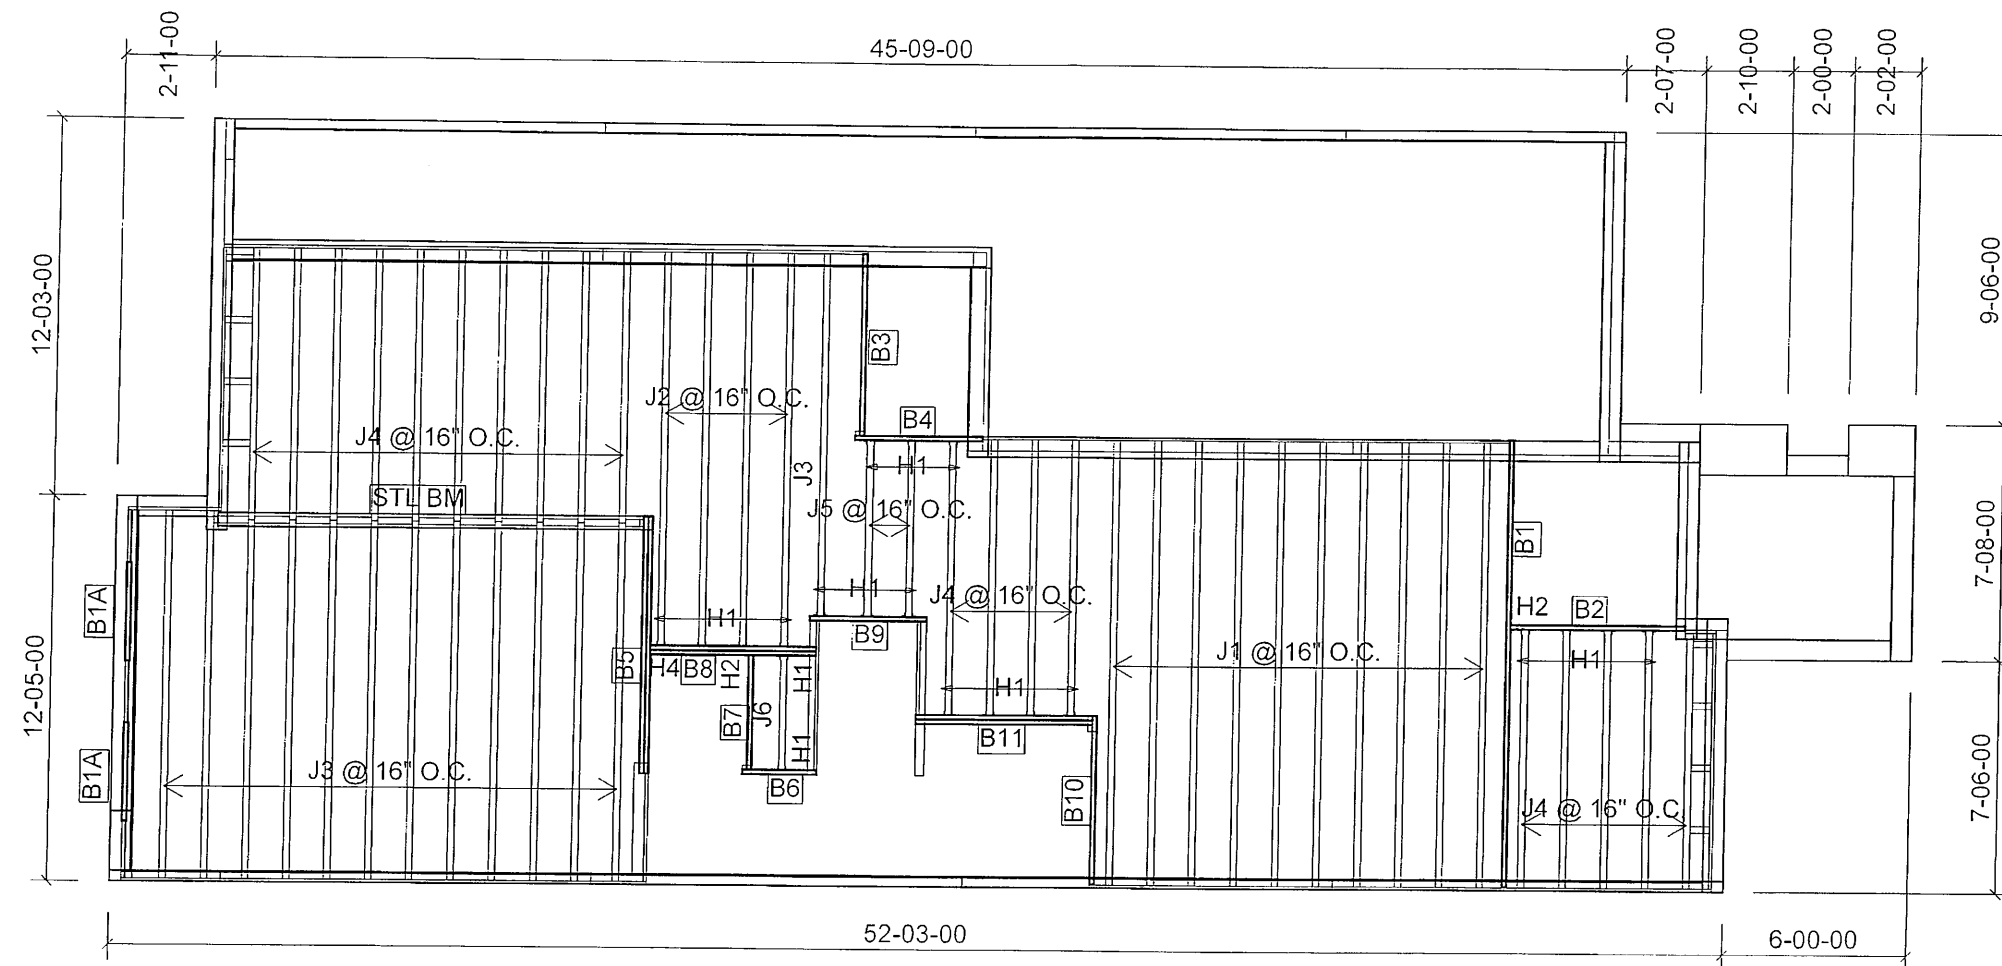

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	10
J2	14-00-00	9 1/2" NI-40x	1	4
J3	12-00-00	9 1/2" NI-40x	1	14
J4	10-00-00	9 1/2" NI-40x	1	19
J5	6-00-00	9 1/2" NI-40x	1	2
J6	4-00-00	9 1/2" NI-40x	1	1
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B5	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	2
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B7	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B9	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
9	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10
1	H4	HGUS410



FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 3

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. CERAMIC TILE APPLICATION AS PER O.B.C 9.30.6.


LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2018-02-22


1st FLOOR

WALK-OUT BASEMENT

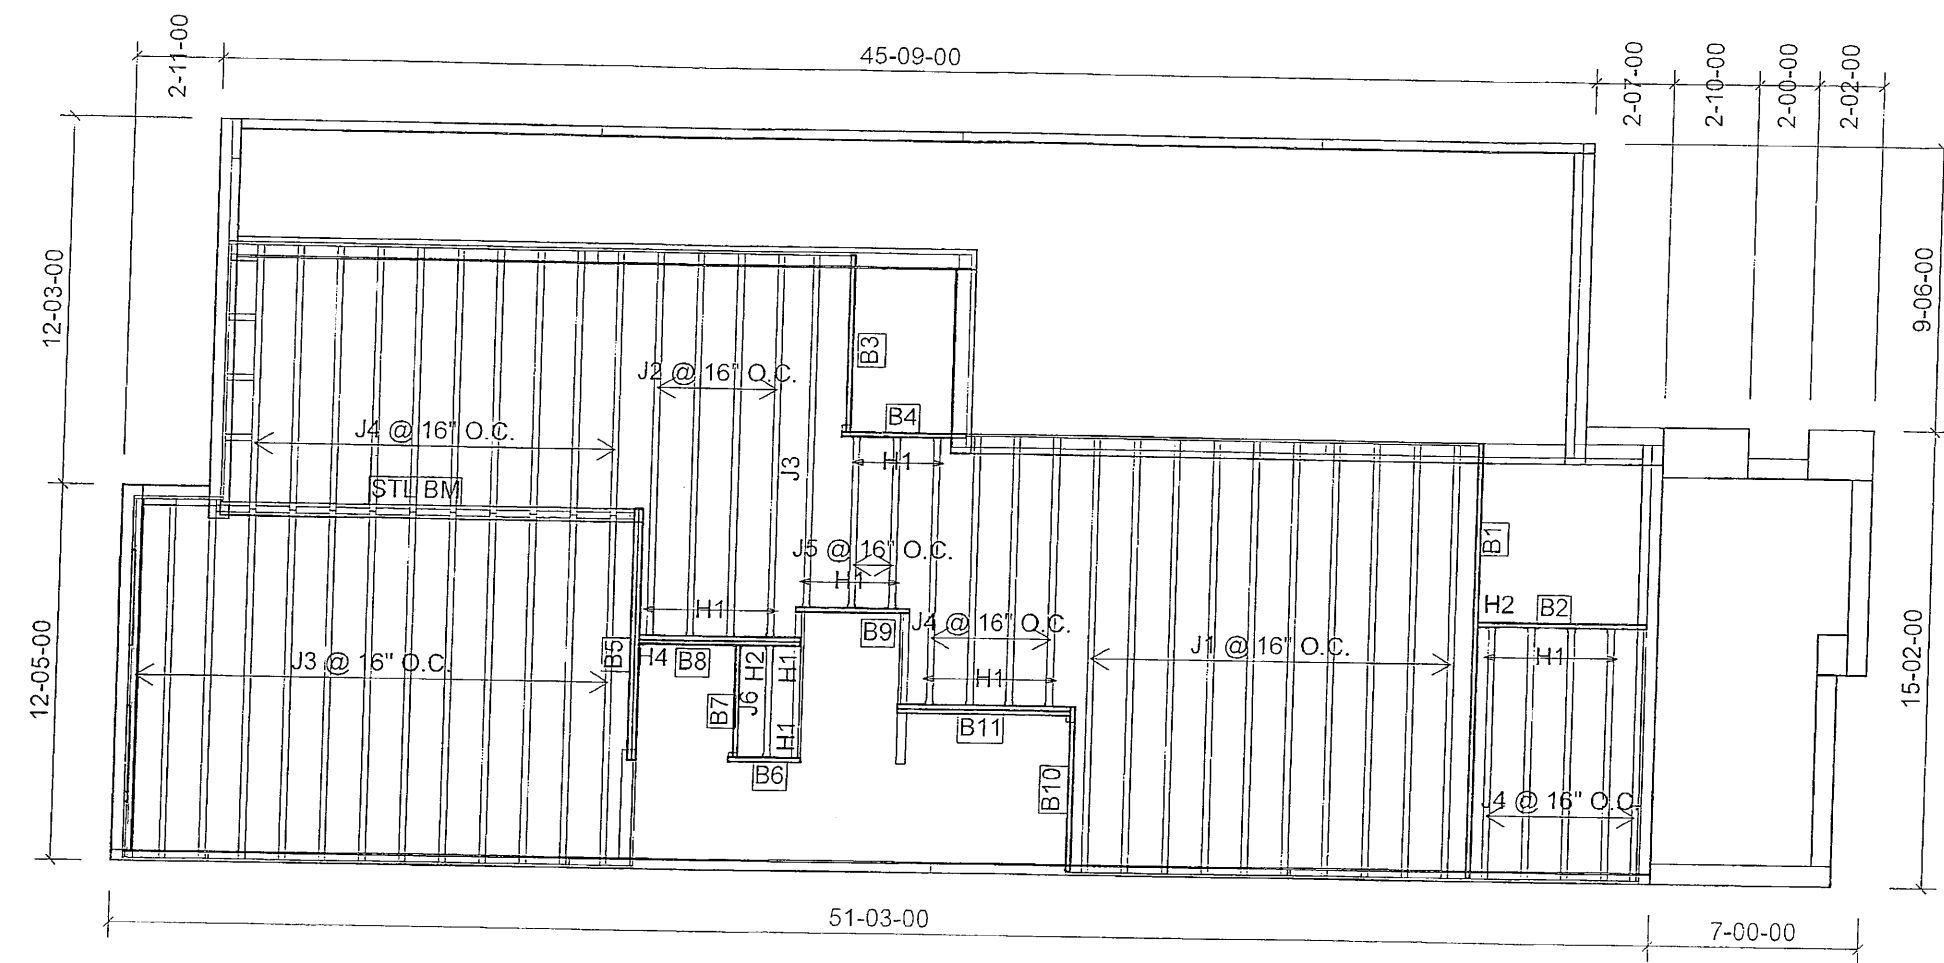

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	10
J2	14-00-00	9 1/2" NI-40x	1	4
J3	12-00-00	9 1/2" NI-40x	1	14
J4	10-00-00	9 1/2" NI-40x	1	19
J5	6-00-00	9 1/2" NI-40x	1	2
J6	4-00-00	9 1/2" NI-40x	1	1
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B5	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B7	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B9	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
9	H1	IUS2.56/9.5
1	H2	HUS1.81/9.5
1	H2	HUS1.81/10
1	H4	HGUS410



FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. MULTIPLE SQUASH BLOCKS REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. CERAMIC TILE APPLICATION AS PER O.B.C 9.30.6.


LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2018-02-22


1st FLOOR

WALK-OUT BASEMENT

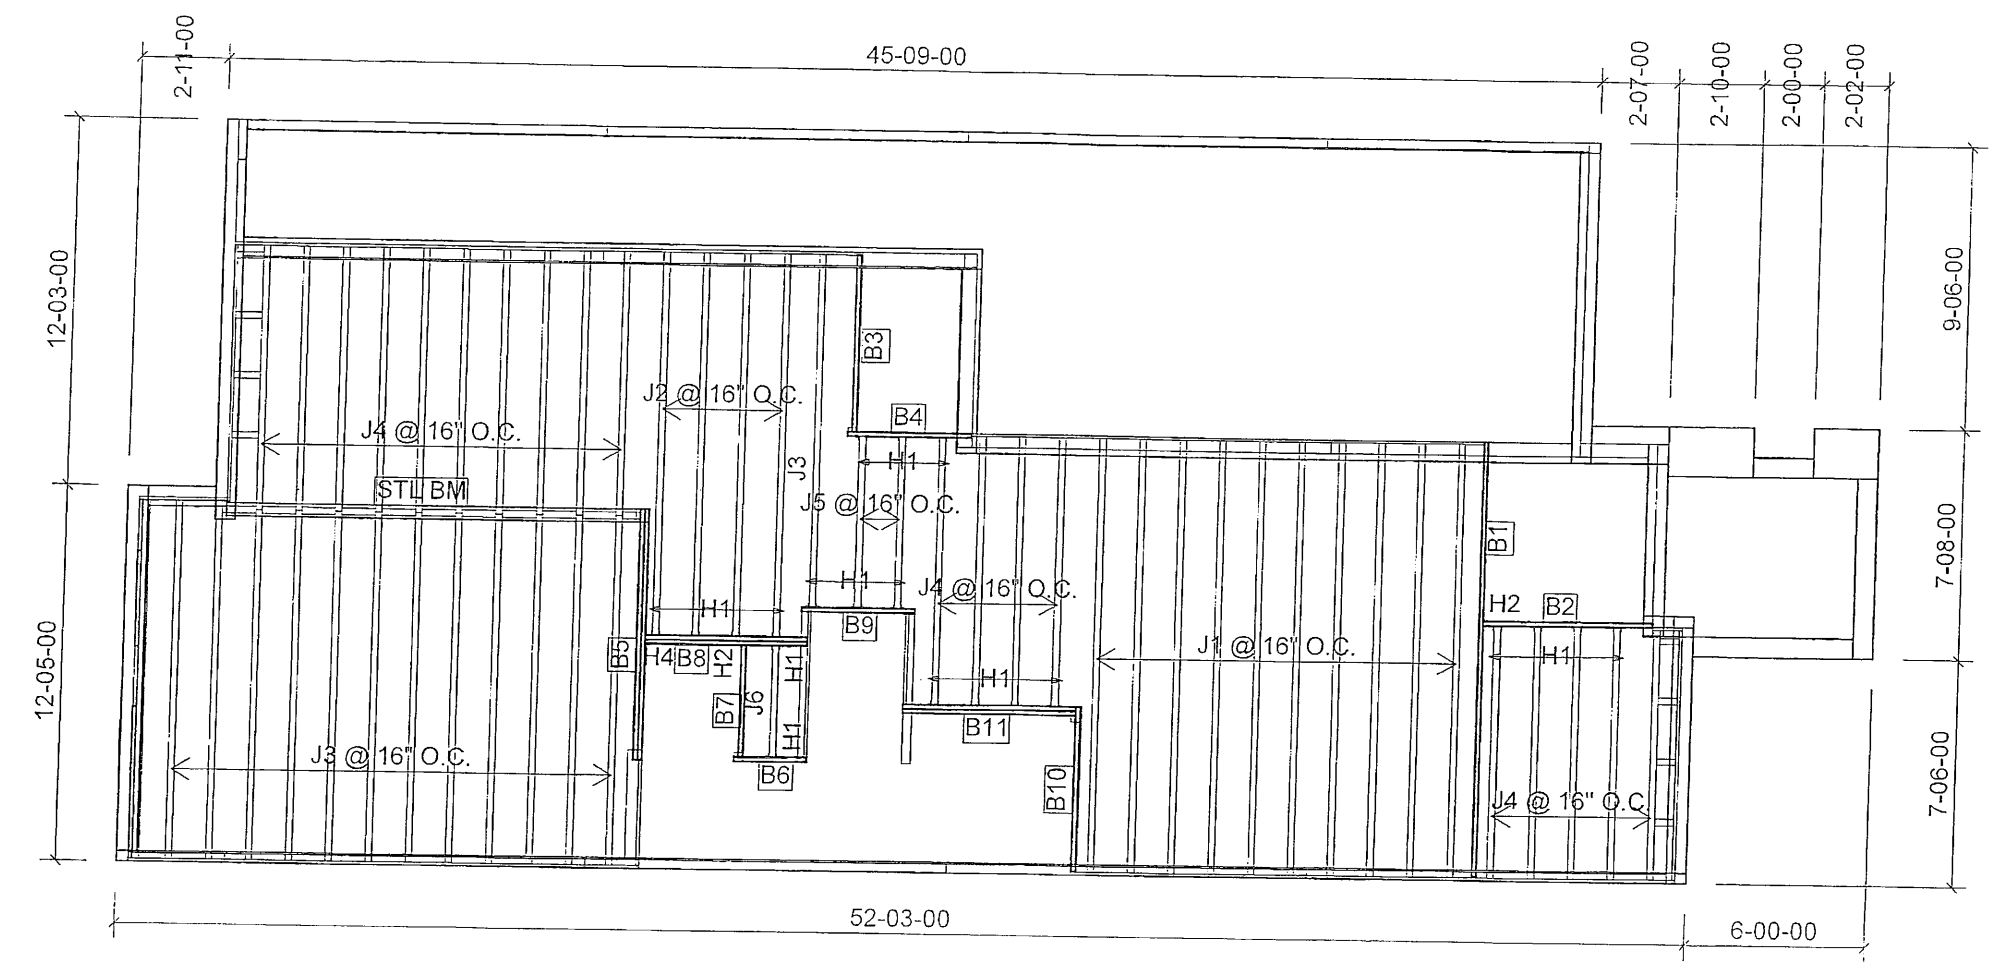

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	10
J2	14-00-00	9 1/2" NI-40x	1	4
J3	12-00-00	9 1/2" NI-40x	1	14
J4	10-00-00	9 1/2" NI-40x	1	19
J5	6-00-00	9 1/2" NI-40x	1	2
J6	4-00-00	9 1/2" NI-40x	1	1
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B5	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B7	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B9	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
9	H1	IUS2.56/9.5
1	H2	HUS1.81/10
1	H2	HUS1.81/10
1	H4	HGUS410



FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:

REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 15.0 lb/ft²


TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED


DATE: 2018-02-22

1st FLOOR

WALK-OUT BASEMENT

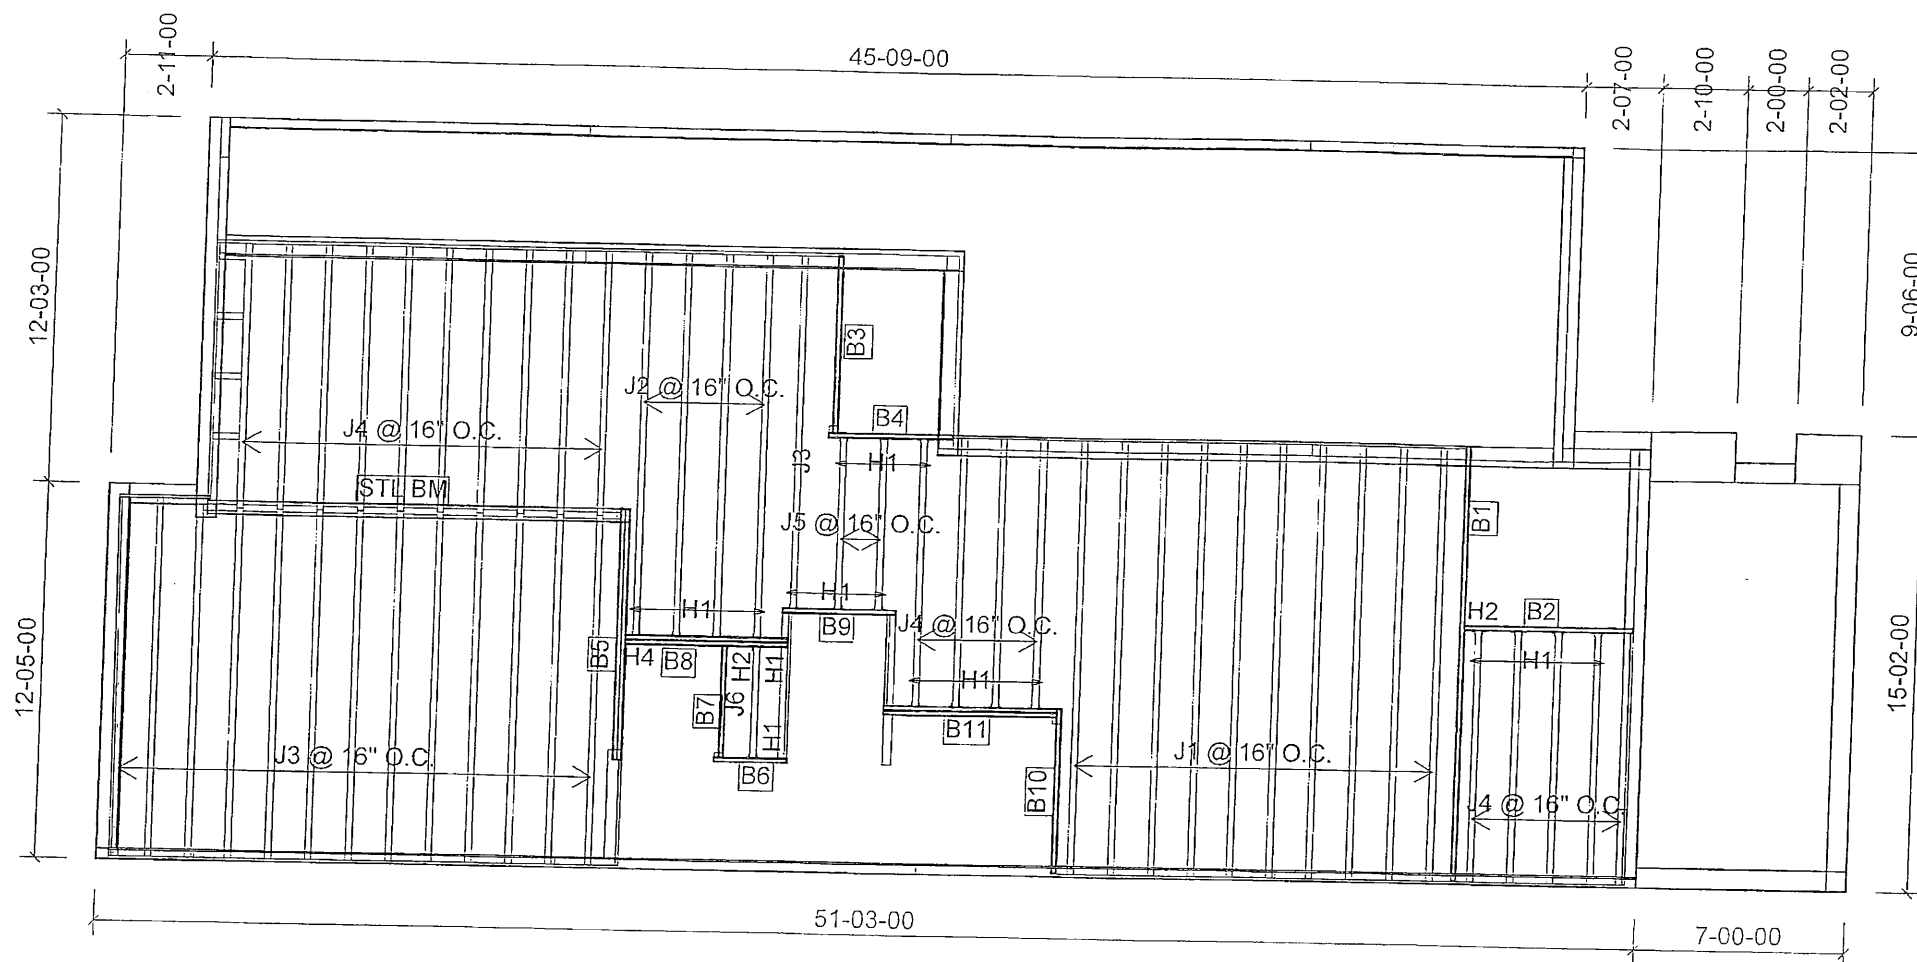

Products					Connector Summary		
PlotID	Length	Product	Plies	Net Qty	Qty	Manuf	Product
J1	16-00-00	9 1/2" NI-40x	1	10	11	H1	IUS2.56/9.5
J2	14-00-00	9 1/2" NI-40x	1	4	9	H1	IUS2.56/9.5
J3	12-00-00	9 1/2" NI-40x	1	14	1	H2	HUS1.81/10
J4	10-00-00	9 1/2" NI-40x	1	19	1	H2	HUS1.81/10
J5	6-00-00	9 1/2" NI-40x	1	2	1	H4	HGUS410
J6	4-00-00	9 1/2" NI-40x	1	1			
B1	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B5	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B8	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B6	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B7	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B9	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			

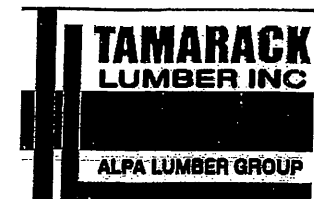

FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 1

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft

SUBFLOOR: 5/8" GLUED AND NAILED


DATE: 2018-02-14

2nd FLOOR

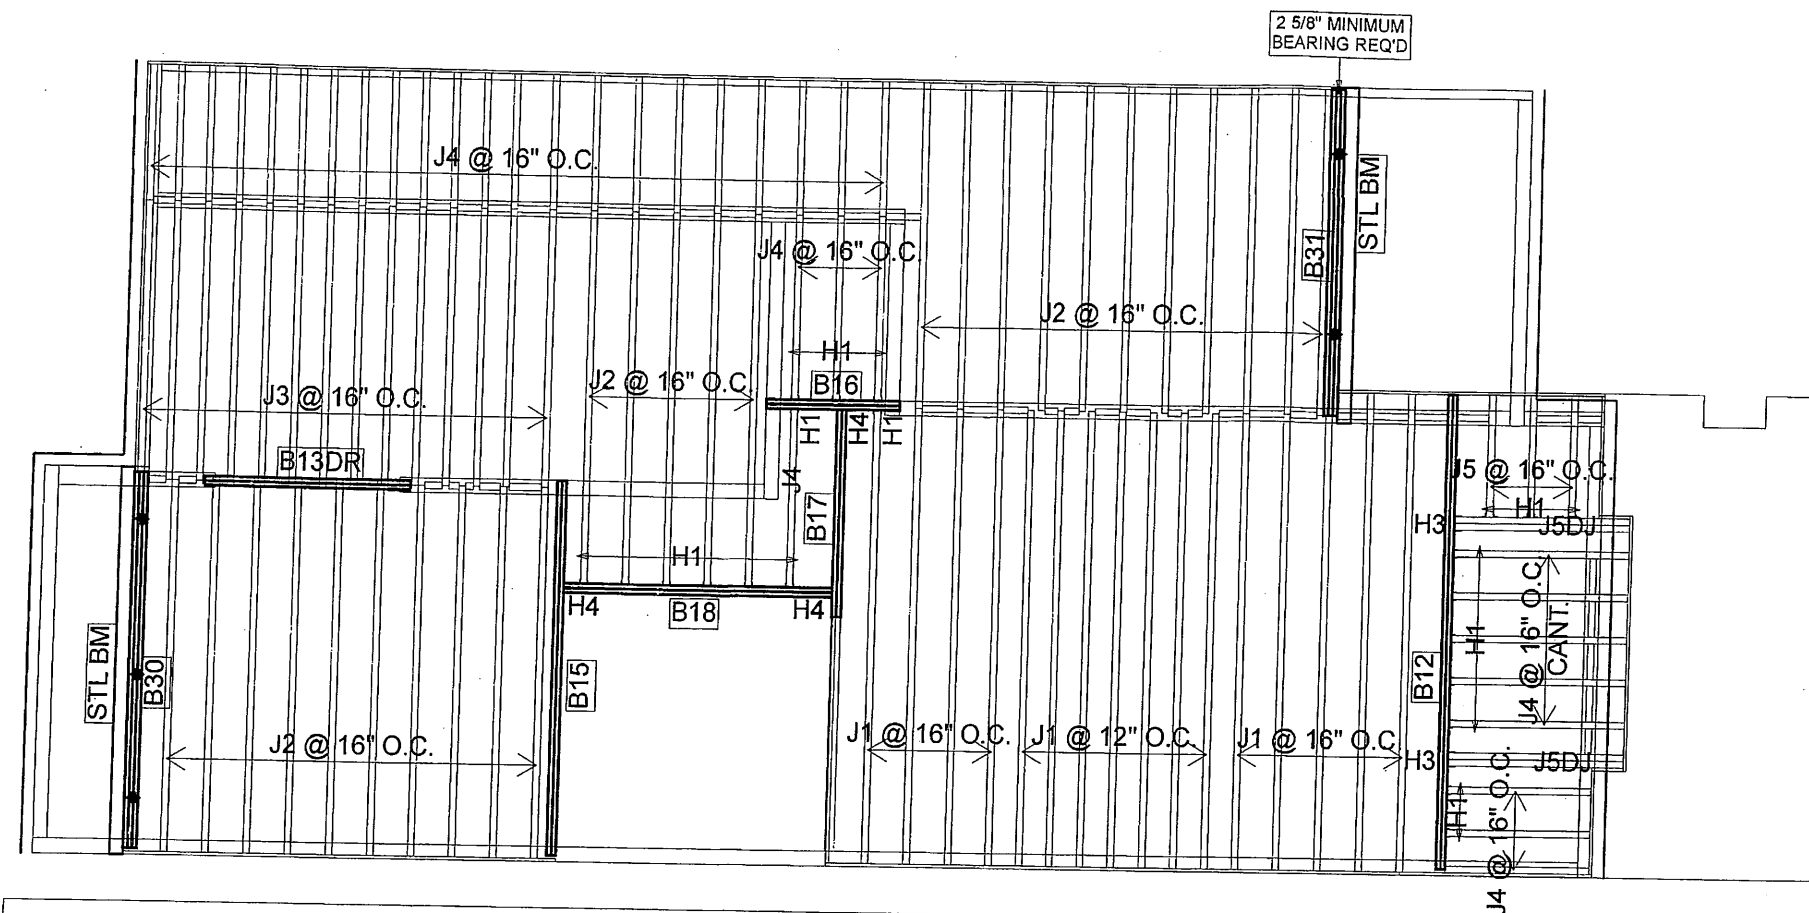

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	16
J2	12-00-00	9 1/2" NI-40x	1	26
J3	10-00-00	9 1/2" NI-40x	1	14
J4	6-00-00	9 1/2" NI-40x	1	34
J5DJ	6-00-00	9 1/2" NI-40x	2	4
J5	4-00-00	9 1/2" NI-40x	1	3
B12	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B15	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B30	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B31	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B18	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B13DR	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B17	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B16	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
18	H1	IUS2.56/9.5
3	H1	IUS2.56/9.5
2	H3	HU310-2
3	H4	HGUS410

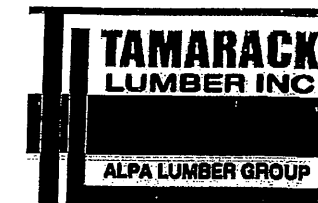

FROM PLAN DATED: SEPT 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 2

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED


DATE: 2018-02-14

2nd FLOOR

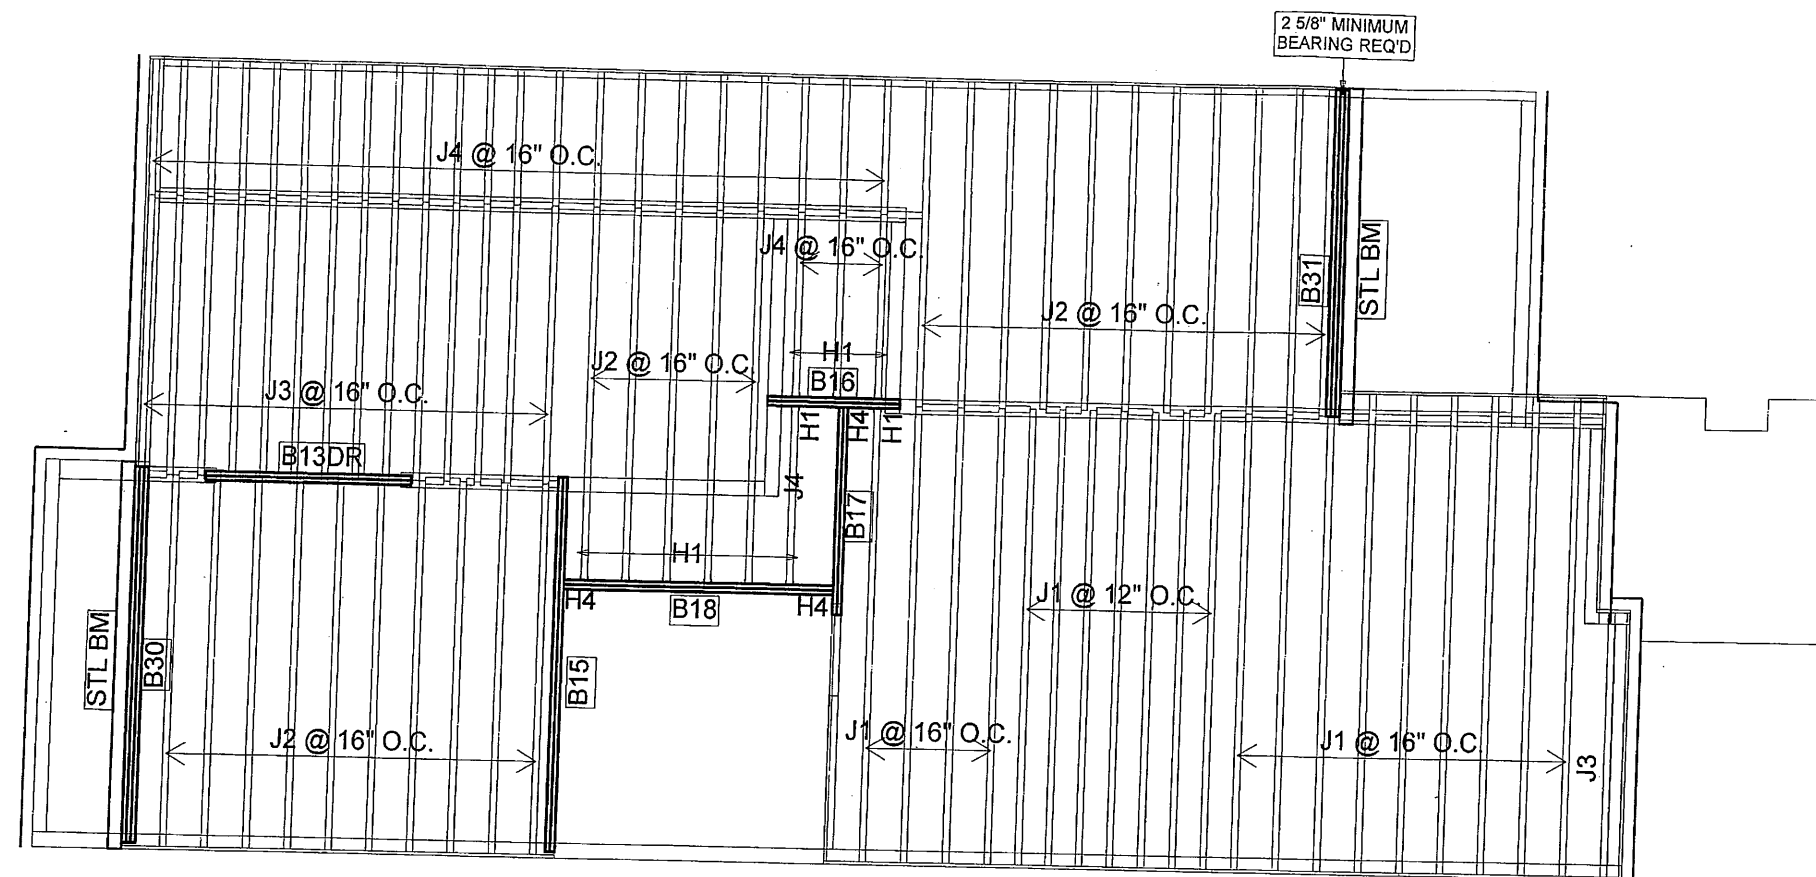

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	20
J2	12-00-00	9 1/2" NI-40x	1	26
J3	10-00-00	9 1/2" NI-40x	1	15
J4	6-00-00	9 1/2" NI-40x	1	26
B15	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B31	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B18	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B13DR	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B17	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B16	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B30	12-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	3	3

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
3	H4	HGUS410

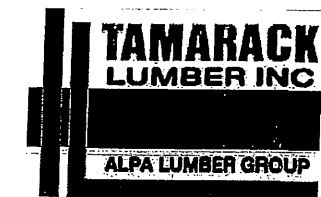

FROM PLAN DATED: SEPTL 2017

BUILDER: GREENPARK HOMES

SITE: RUSSELL GARDENS

MODEL: HIGHGROVE 4

ELEVATION: 3

LOT:

CITY: WATERDOWN

SALESMAN: M D

DESIGNER: AJ

REVISION: lbv

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2018-02-14

2nd FLOOR

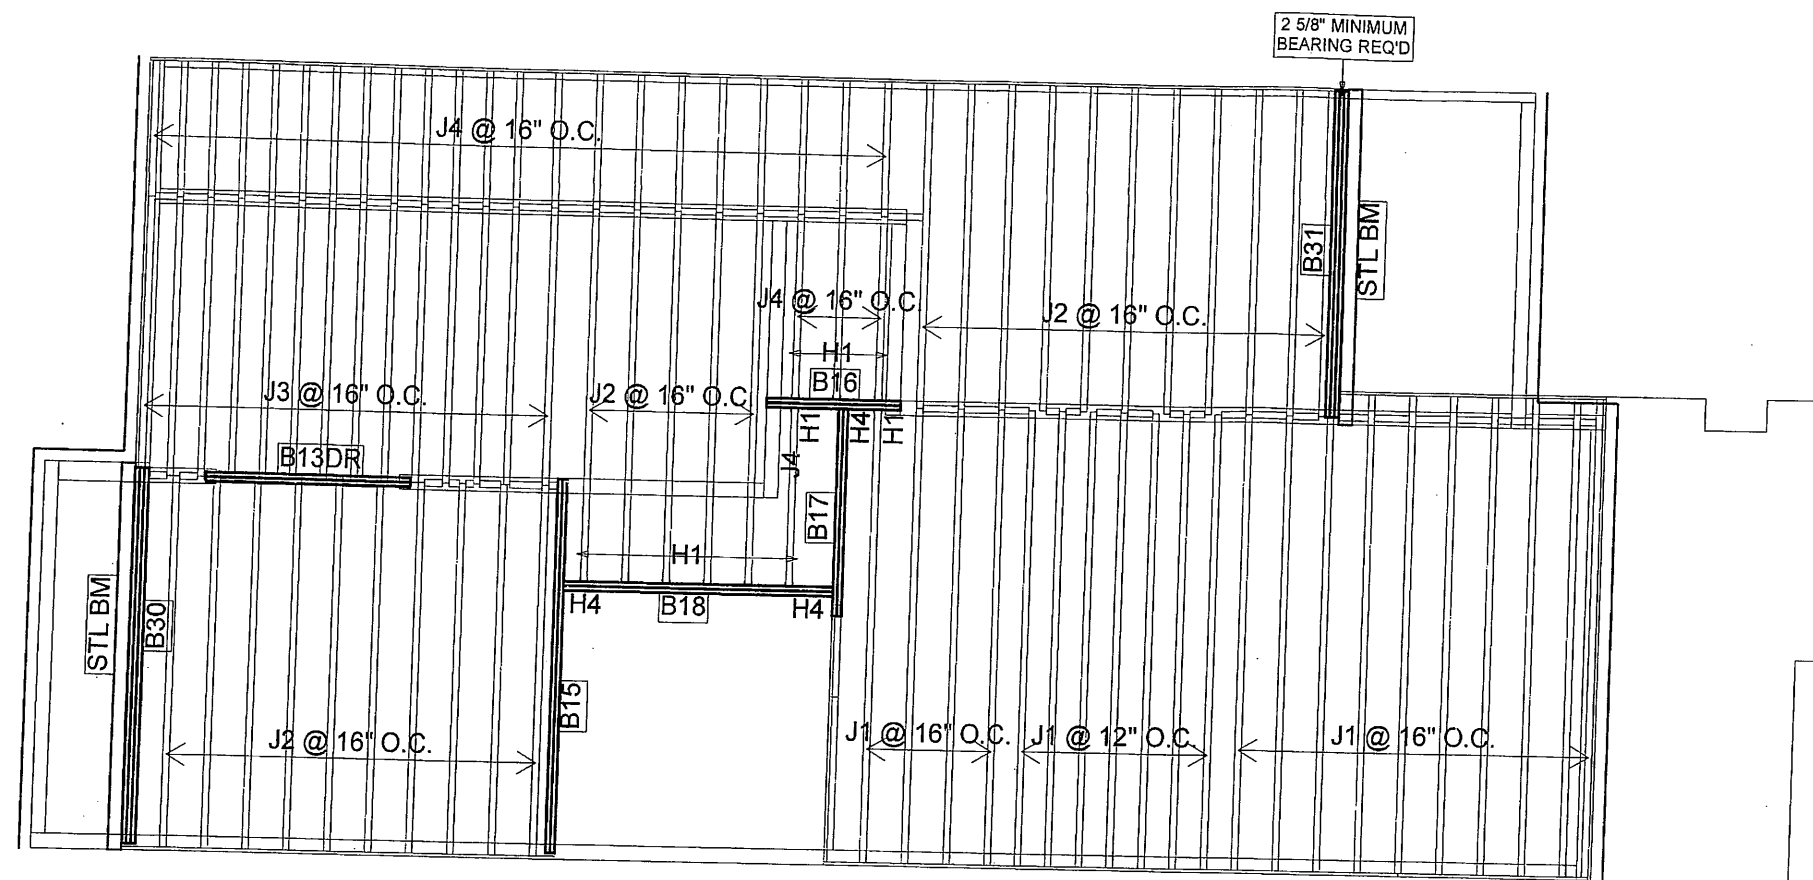

Products					Connector Summary		
PlotID	Length	Product	Plies	Net Qty	Qty	Manuf	Product
J1	16-00-00	9 1/2" NI-40x	1	21	11	H1	IUS2.56/9.5
J2	12-00-00	9 1/2" NI-40x	1	26	3	H4	HGUS410
J3	10-00-00	9 1/2" NI-40x	1	14			
J4	6-00-00	9 1/2" NI-40x	1	26			
B15	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B30	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3			
B31	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3			
B18	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B13DR	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B17	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B16	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER
BURLINGTON
Feb. 22, 2018 15:43


PROJECT
J4 1ST FLR

Design Check Calculation Sheet Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat- tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

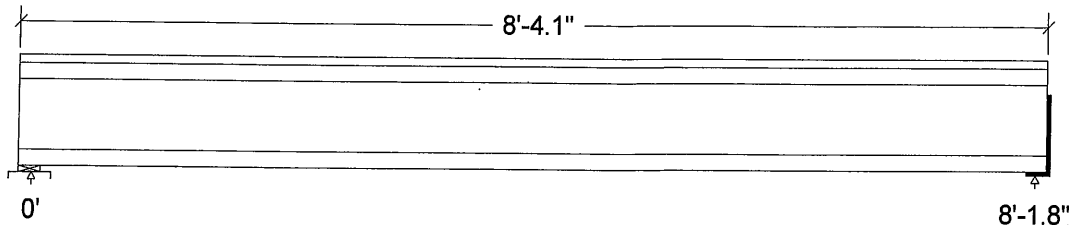

Unfactored:			
Dead	111		111
Live	223		222
Factored:			
Total	473		472
Bearing:			
Resistance			
Joist	1861		1859
Support	2694		-
Des ratio			
Joist	0.25		0.25
Support	0.18		-
Load case	#2		#2
Length	2-1/8		2
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		-
fcp sup	551		-
Kzcp sup	1.15		-

Nordic Joist 9-1/2" NI-40x Floor joist @ 16" o.c.

Supports: 1 - Nordic Lam Sill plate, 24F-1.9E; 2 - Hanger;
Total length: 8'-4.1"; 3/4" nailed and glued OSB sheathing

This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 462	Vr = 1895	lbs	Vf/Vr = 0.24
Moment (+)	Mf = 940	Mr = 4824	lbs-ft	Mf/Mr = 0.19
Perm. Defl'n	0.01 = <L/999	0.27 = L/360	in	0.05
Live Defl'n	0.03 = <L/999	0.20 = L/480	in	0.14
Total Defl'n	0.04 = <L/999	0.41 = L/240	in	0.10
Bare Defl'n	0.03 = <L/999	0.27 = L/360	in	0.12
Vibration	Lmax = 8'-2	Lv = 16'-2	ft	
Defl'n	= 0.011	= 0.079	in	0.14



DWG NO. TAM 84/2-18
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
 Moment(+) : LC #2 = 1.25D + 1.5L
 Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)
 Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L
 Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
 L=live(use,occupancy) Ls=live(storage,equipment) f=fire
 Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: E_Ieff = 276e06 lb-in² K= 4.94e06 lbs
 "Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM B410-18
 STRUCTURAL
 COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER
BURLINGTON
Feb. 14, 2018 07:40


PROJECT
J1 GRD FLR

Design Check Calculation Sheet Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

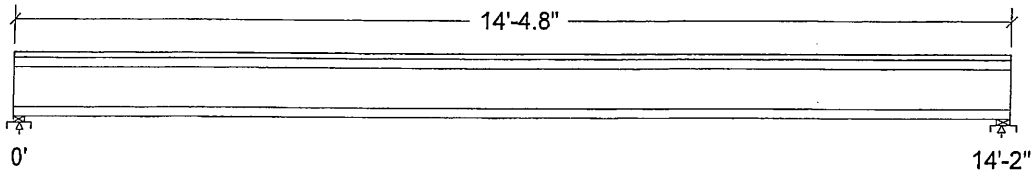

Unfactored:			
Dead	192		192
Live	383		384
Factored:			
Total	815		817
Bearing:			
Resistance			
Joist	1861		1865
Support	3267		3651
Des ratio			
Joist	0.44		0.44
Support	0.25		0.22
Load case	#2		#2
Length	2-1/8		2-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.00		1.00

Nordic Joist 9-1/2" NI-40x Floor joist @ 16" o.c.

Supports: All - Lumber Sill plate, No.1/No.2

Total length: 14'-4.8"; 3/4" nailed and glued OSB sheathing

This section **PASSES** the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 803	Vr = 1895	lbs	Vf/Vr = 0.42
Moment(+)	Mf = 2844	Mr = 4824	lbs-ft	Mf/Mr = 0.59
Perm. Defl'n	0.10 = <L/999	0.47 = L/360	in	0.21
Live Defl'n	0.20 = L/844	0.35 = L/480	in	0.57
Total Defl'n	0.30 = L/562	0.71 = L/240	in	0.43
Bare Defl'n	0.25 = L/686	0.47 = L/360	in	0.52
Vibration	Lmax = 14'-2	Lv = 16'-2	ft	
Defl'n	= 0.031	= 0.047	in	0.66



DWG NO. TAM 9644-8
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
 Moment(+) : LC #2 = 1.25D + 1.5L
 Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake
 L=live(use, occupancy) Ls=live(storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: E_{IEff} = 276e06 lb-in² K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 9644
 STRUCTURAL
 COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER
BURLINGTON
Feb. 14, 2018 07:39


PROJECT
J3 GRD FLR

Design Check Calculation Sheet Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat- tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

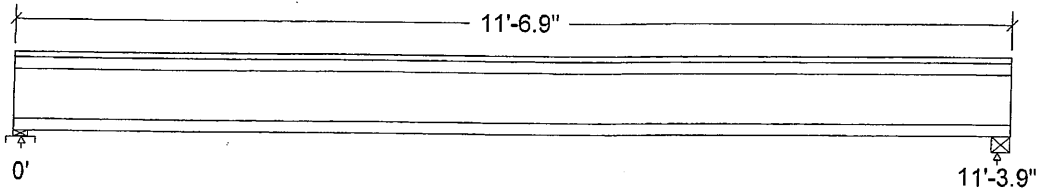


Unfactored:			
Dead	154		155
Live	308		310
Factored:			
Total	653		658
Bearing:			
Resistance			
Joist	1861		1869
Support	3267		-
Des ratio			
Joist	0.35		0.35
Support	0.20		-
Load case	#2		#2
Length	2-1/8		2-5/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		-
fcp sup	769		-
Kzcp sup	1.00		-

Nordic Joist 9-1/2" NI-40x Floor joist @ 16" o.c.
 Supports: 1 - Lumber Sill plate, No.1/No.2; 2 - Steel Beam, W;
 Total length: 11'-6.9"; 3/4" nailed and glued OSB sheathing
This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 642	Vr = 1895	lbs	Vf/Vr = 0.34
Moment(+)	Mf = 1817	Mr = 4824	lbs-ft	Mf/Mr = 0.38
Perm. Defl'n	0.04 = <L/999	0.38 = L/360	in	0.12
Live Defl'n	0.09 = <L/999	0.28 = L/480	in	0.31
Total Defl'n	0.13 = <L/999	0.57 = L/240	in	0.23
Bare Defl'n	0.11 = <L/999	0.38 = L/360	in	0.28
Vibration	Lmax = 11'-4	Lv = 16'-2	in	
Defl'n	= 0.020	= 0.063		0.32

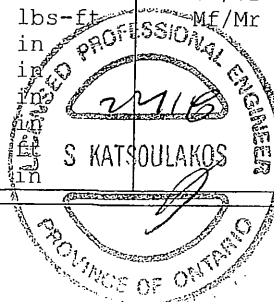

DWG NO. TAM 9645-8
 STRUCTURAL
 COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment(+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span


All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:Deflection: E_{IEff} = 276e06 lb-in² K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

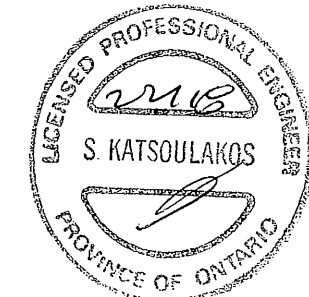

DWG NO. TAM 9645-8
STRUCTURAL
COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER
BURLINGTON
Feb. 14, 2018 07:54

PROJECT
J1 2ND FLR


Design Check Calculation Sheet

Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

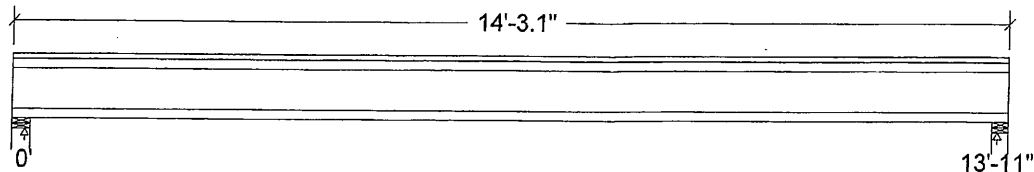

Unfactored:			
Dead	191		190
Live	381		379
Factored:			
Total	810		806
Bearing:			
Resistance			
Joist	1878		1871
Support	5525		4756
Des ratio			
Joist	0.43		0.43
Support	0.15		0.17
Load case	#2		#2
Length	3-1/8		2-3/4
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.15		1.13

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic Joist 9-1/2" NI-40x Floor joist @ 16" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 14'-3.1"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 789	Vr = 1895	lbs	Vf/Vr = 0.42
Moment(+)	Mf = 2744	Mr = 4824	lbs-ft	Mf/Mr = 0.57
Perm. Defl'n	0.10 = <L/999	0.46 = L/360	in	0.21
Live Defl'n	0.19 = L/863	0.35 = L/480	in	0.56
Total Defl'n	0.29 = L/575	0.70 = L/240	in	0.42
Bare Defl'n	0.23 = L/721	0.46 = L/360	in	0.50
Vibration	Lmax = 13'-11"	Lv = 15'-9"	ft	
Defl'n	= 0.033	= 0.048	in	0.67

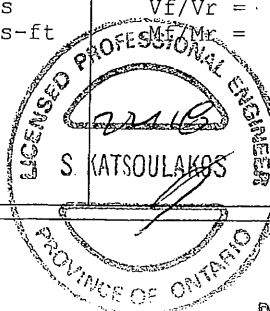

DWG NO. TAM 9646-8
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
 Moment(+) : LC #2 = 1.25D + 1.5L
 Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)
 Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L
 Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
 L=live(use,occupancy) Ls=live(storage,equipment) f=fire
 Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: E_{IEff} = 268e06 lb-in² K= 4.94e06 lbs
 "Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 9646-8
 STRUCTURAL
 COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER
BURLINGTON
Feb. 14, 2018 07:57


PROJECT
J2 2ND FLR

Design Check Calculation Sheet Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

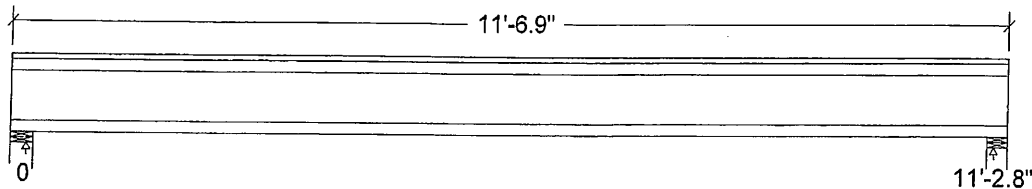

Unfactored:			
Dead	155		154
Live	309		308
Factored:			
Total	658		654
Bearing:			
Resistance			
Joist	1878		1871
Support	5525		4756
Des ratio			
Joist	0.35		0.35
Support	0.12		0.14
Load case	#2		#2
Length	3-1/8		2-3/4
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.15		1.13

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic Joist 9-1/2" NI-40x Floor joist @ 16" o.c.

Supports: All - Lumber Wall, No.1/No.2

Total length: 11'-6.9"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section **PASSES** the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 636	Vr = 1895	lbs	Vf/Vr = 0.34
Moment(+)	Mf = 1787	Mr = 4824	lbs-ft	Mf/Mr = 0.37
Perm. Defl'n	0.04 = <L/999	0.37 = L/360	in	0.12
Live Defl'n	0.09 = <L/999	0.28 = L/480	in	0.31
Total Defl'n	0.13 = <L/999	0.56 = L/240	in	0.23
Bare Defl'n	0.10 = <L/999	0.37 = L/360	in	0.28
Vibration	Lmax = 11'-3	Lv = 15'-9	ft	
Defl'n	= 0.022	= 0.064	in	0.34



DWG NO. TAM 9641
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
 Moment(+) : LC #2 = 1.25D + 1.5L
 Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)
 Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L
 Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
 L=live(use,occupancy) Ls=live(storage,equipment) f=fire
 Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: E_Ieff = 268e06 lb-in² K= 4.94e06 lbs
 "Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 9647
 STRUCTURAL
 COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER
BURLINGTON
Feb. 14, 2018 07:53

PROJECT
J2 2ND FLR GARAGE


Design Check Calculation Sheet

Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

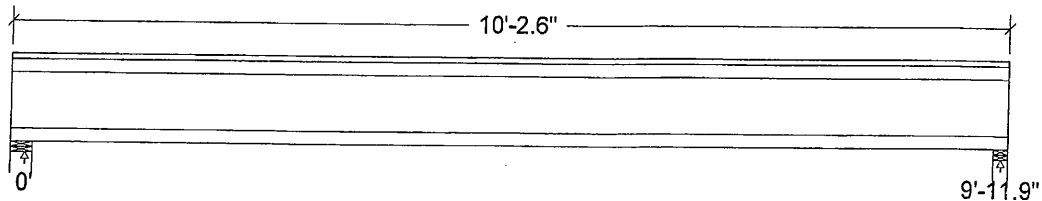

Unfactored:			
Dead	137		135
Live	275		270
Factored:			
Total	584		574
Bearing:			
Resistance			
Joist	1871		1854
Support	4756		2758
Des ratio			
Joist	0.31		0.31
Support	0.12		0.21
Load case	#2		#2
Length	2-3/4		1-3/4*
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.13		1.02

*Minimum bearing length for joists is 1-3/4" for exterior supports
Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic Joist 9-1/2" NI-40x Floor joist @ 16" o.c.


Supports: All - Lumber Wall, No.1/No.2

Total length: 10'-2.6"; 5/8" nailed and glued OSB sheathing

This section **PASSES** the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 566	Vr = 1895	lbs	Vf/Vr = 0.30
Moment (+)	Mf = 1414	Mr = 4824	lbs	Mf/Mr = 0.29
Perm. Defl'n	0.03 = <L/999	0.33 = L/360	in	0.09
Live Defl'n	0.06 = <L/999	0.25 = L/480	in	0.23
Total Defl'n	0.09 = <L/999	0.50 = L/240		0.17
Bare Defl'n	0.07 = <L/999	0.33 = L/360		0.20
Vibration	Lmax = 10'-0	Lv = 15'-4		
Defl'n	= 0.018	= 0.074	in	0.25



DWG NO. TAM 9648-18
STRUCTURAL
COMPONENT ONLY

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
 Moment(+) : LC #2 = 1.25D + 1.5L
 Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)
 Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L
 Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
 L=live(use,occupancy) Ls=live(storage,equipment) f=fire
 Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: E_{IEff} = 268e06 lb-in² K= 4.94e06 lbs
 "Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 9648-18
 STRUCTURAL
 COMPONENT ONLY

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER
BURLINGTON
Feb. 14, 2018 07:58

PROJECT
J4 2ND FLR


Design Check Calculation Sheet

Nordic Sizer – Canada 6.4

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

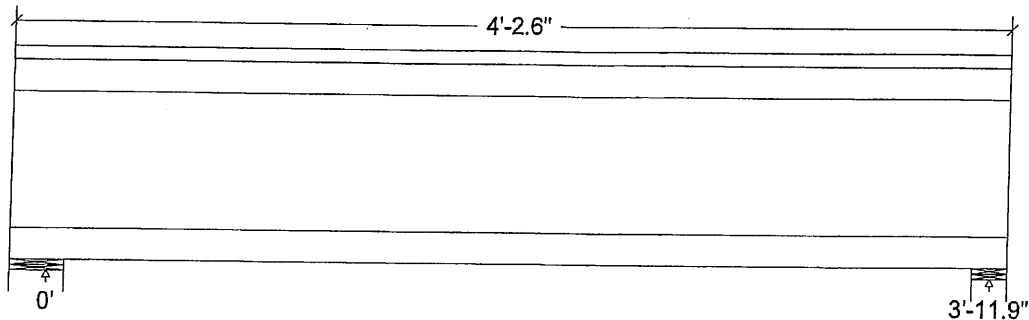

Unfactored:			
Dead	57		55
Live	115		110
Factored:			
Total	244		234
Bearing:			
Resistance			
Joist	1871		1854
Support	4756		2758
Des ratio			
Joist	0.13		0.13
Support	0.05		0.08
Load case	#2		#2
Length	2-3/4		1-3/4*
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.13		1.02

*Minimum bearing length for joists is 1-3/4" for exterior supports

Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic Joist 9-1/2" NI-40x Floor joist @ 16" o.c.

Supports: All - Lumber Wall, No.1/No.2

Total length: 4'-2.6"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.



DWG NO. TAM 9649-18
STRUCTURAL
COMPONENT ONLY

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 226	Vr = 1895	lbs	Vf/Vr = 0.12
Moment(+)	Mf = 226	Mr = 4824	lbs-ft	Mf/Mr = 0.05
Perm. Defl'n	0.00 = <L/999	0.13 = L/360	in	0.00
Live Defl'n	0.00 = <L/999	0.10 = L/480	in	0.01
Total Defl'n	0.00 = <L/999	0.20 = L/240	in	0.01
Bare Defl'n	0.00 = <L/999	0.13 = L/360	in	0.01
Vibration	Lmax = 4'-0	Lv = 15'-9	ft	
Defl'n	= 0.002	= 0.079	in	0.03

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
 Moment(+) : LC #2 = 1.25D + 1.5L
 Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake
 L=live(use,occupancy) Ls=live(storage,equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output


CALCULATIONS:

Deflection: E_Ieff = 268e06 lb-in² K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 9649-78
 STRUCTURAL
 COMPONENT ONLY



Boise Cascade



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

Basement Flush Beams B1 (i2733)

Dry | 1 span | No cant.

February 14, 2018 07:41:34


File name: HIGHGROVE 4 EL 1.mmdl

Description: Basement Flush Beams B1 (i2733)

Specifier:

Designer: AJ

Company:

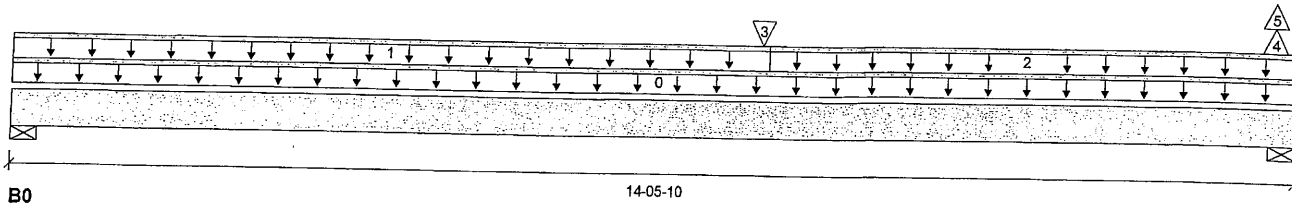

Total Horizontal Product Length = 14-05-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-1/8"	354 / 0	217 / 0		
B1, 5-1/2"	465 / 60	497 / 0	0 / 81	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-05-10		5			00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	08-05-10	27	13			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	08-05-10	14-05-10	17	9			n/a
3	B2(i2714)	Conc. Pt. (lbs)	L	08-04-12	08-04-12	431	229			n/a
4	6(i386)	Conc. Pt. (lbs)	L	14-02-14	14-02-14	57	250	-81		n/a
5	6(i386)	Conc. Pt. (lbs)	L	14-02-14	14-02-14	-60				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	4,434 ft-lbs	11,610 ft-lbs	38.2%	1	08-04-12
End Shear	867 lbs	5,785 lbs	15.0%	1	13-02-10
Total Load Deflection	L/437 (0.383")	n/a	54.9%	56	07-02-13
Live Load Deflection	L/695 (0.241")	n/a	51.8%	83	07-02-13
Max Defl.	0.383"	n/a	n/a	56	07-02-13
Span / Depth	17.6				

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B0	Wall/Plate 2-1/8" x 1-3/4"	802 lbs	40.4%	17.7%	Unspecified
B1	Wall/Plate 5-1/2" x 1-3/4"	1,319 lbs	25.7%	11.2%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

CONFORMS TO OBC 2012

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM 9640-18
STRUCTURAL
COMPONENT ONLY



Boise Cascade



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSEDBC CALC® Design Report
Build 6215

Basement/Flush Beams/B10(i2704)

Dry | 1 span | No cant.

February 14, 2018 07:41:34

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R


File name: HIGHGROVE 4 EL 1.mmdl

Description: Basement/Flush Beams/B10(i2704)

Specifier:

Designer: AJ

Company:

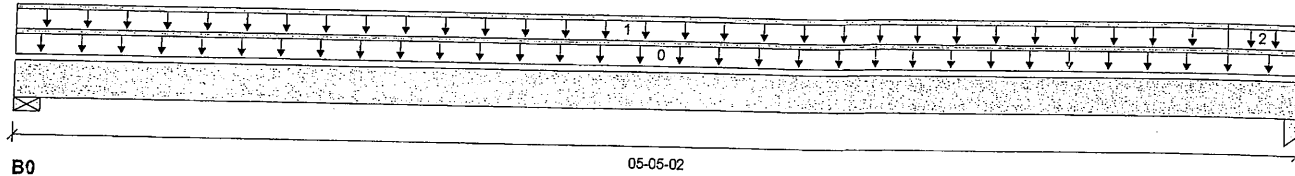

Total Horizontal Product Length = 05-05-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-1/8"	32 / 0	28 / 0		
B1, 6"	36 / 0	32 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-05-02	1.00	0.65	1.00	1.15	
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-01-10	12	6			00-00-00
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	05-01-10	05-05-02	11	6			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	97 ft-lbs	11,610 ft-lbs	0.8%	1	02-06-10
End Shear	52 lbs	5,785 lbs	0.9%	1	00-11-10
Total Load Deflection	L/999 (0.001")	n/a	n/a	4	02-06-10
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	02-06-10
Max Defl.	0.001"	n/a	n/a	4	02-06-10
Span / Depth	6.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 2-1/8" x 1-3/4"	83 lbs	4.2%	1.8%	Unspecified
B1	Column 6" x 1-3/4"	93 lbs	1.1%	0.7%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume member is fully braced.
 Resistance Factor phi has been applied to all presented results per CSA O86.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
 DWG NO. TAM 9641-18
 STRUCTURAL
 COMPONENT ONLY

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 18, 2017 10:02:34

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1 WOD.mmdl


Description: Designs\Flush Beams\Basment\Flush Beams\B1A(i2041

Specifier:

Designer: AJ

Company:

Misc:

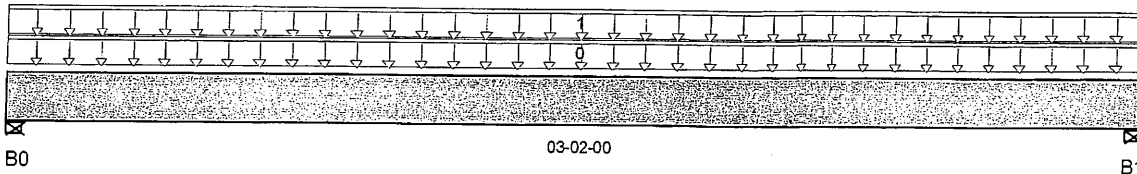

Total Horizontal Product Length = 03-02-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 4"	42 / 0	157 / 0		
B1, 4"	42 / 0	157 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
0	E1 (i290)	Unf. Lin. (lb/ft)	L	00-00-00	03-02-00	1.00	0.65	1.00	1.15	n/a
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-02-00	27	13			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	119 ft-lbs	8,258 ft-lbs	1.4%	0	01-07-00
End Shear	64 lbs	3,761 lbs	1.7%	0	01-01-08
Total Load Defl.	L/999 (0.001")	n/a	n/a	4	01-07-00
Live Load Defl.	L/999 (0")	n/a	n/a	5	01-07-00
Max Defl.	0.001"	n/a	n/a	4	01-07-00
Span / Depth	3.3	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	4" x 1-3/4"	220 lbs	9%	4%	Unspecified
B1 Wall/Plate	4" x 1-3/4"	220 lbs	9%	4%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCK®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

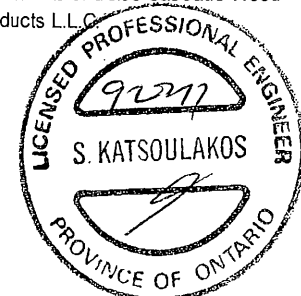



Boise Cascade

Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0-3100 SP Basement\Flush Beams\B2(i1958)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 18, 2017 09:22:54

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B2(i1958)

Specifier:

Designer: AJ

Company:

Misc:

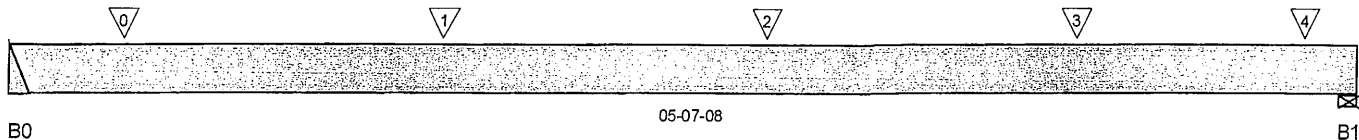

Total Horizontal Product Length = 05-07-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	438 / 0	232 / 0	0 / 0	
B1, 3-1/2"	553 / 0	858 / 0	90 / 0	

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0 J4(i1978)	Conc. Pt. (lbs)	L	00-05-08	00-05-08	159	79			n/a
1 J4(i1974)	Conc. Pt. (lbs)	L	01-09-08	01-09-08	227	114			n/a
2 J4(i1986)	Conc. Pt. (lbs)	L	03-01-08	03-01-08	227	114			n/a
3 J4(i1973)	Conc. Pt. (lbs)	L	04-05-08	04-05-08	213	106			n/a
4 E10(i1576)	Conc. Pt. (lbs)	L	05-04-12	05-04-12	165	650	90		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,290 ft-lbs	12,704 ft-lbs	10.2%	1	03-01-08
End Shear	835 lbs	5,785 lbs	14.4%	1	04-06-08
Total Load Defl.	L/999 (0.018")	n/a	n/a	35	02-09-08
Live Load Defl.	L/999 (0.012")	n/a	n/a	51	02-09-08
Max Defl.	0.018"	n/a	n/a	35	02-09-08
Span / Depth	6.7	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 1-3/4"	948 lbs	n/a	22.2%	HUS1.81/10
B1 Wall/Plate	3-1/2" x 1-3/4"	1,946 lbs	59.5%	26%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO OBC 2012

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9



DWG NO. TAM 4762-17
STRUCTURAL
COMPONENT ONLY



Boise Cascade

Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B2(i1958)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 18, 2017 09:22:54

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl

Description: Designs\Flush Beams\Basement\Flush Beams\B2(i195

Specifier:

Designer: AJ

Company:

Misc:

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods.

Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM47627-17
STRUCTURAL
COMPONENT ONLY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100-SP Basement\Flush Beams\B3(i2031)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 18, 2017 09:22:53

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B3(i2031)

Specifier:

Designer: AJ

Company:

Misc:

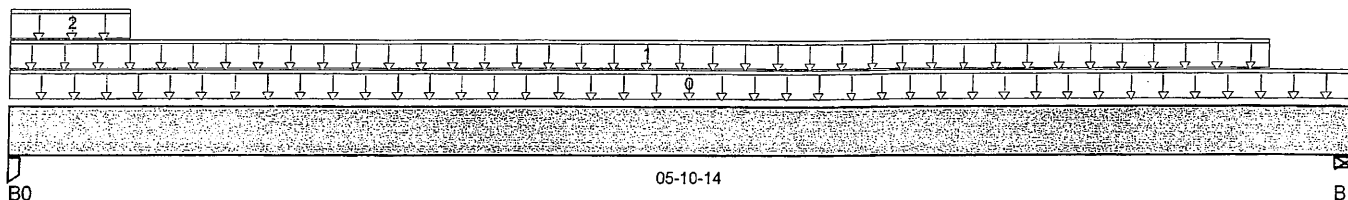

Total Horizontal Product Length = 05-10-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/4"	266 / 0	393 / 0		
B1, 4-3/8"	82 / 0	271 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-10-14	26	13			n/a
1	10 (i407)	Unf. Lin. (lb/ft)	L	00-00-00	05-06-08		81			n/a
2	10 (i407)	Unf. Lin. (lb/ft)	L	00-00-00	00-06-04	373	212			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	520 ft-lbs	8,258 ft-lbs	6.3%	0	02-10-10
End Shear	533 lbs	5,785 lbs	9.2%	1	01-00-04
Total Load Defl.	L/999 (0.01")	n/a	n/a	4	02-10-10
Live Load Defl.	L/999 (0.002")	n/a	n/a	5	02-09-15
Max Defl.	0.01"	n/a	n/a	4	02-10-10
Span / Depth	6.9	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Post	2-3/4" x 1-3/4"	890 lbs	22.8%	15.2%	Unspecified
B1 Wall/Plate	4-3/8" x 1-3/4"	379 lbs	14.3%	6.2%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

DWG NO. TAM 47624-17
STRUCTURAL
COMPONENT ONLY





Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B4(i1055)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:18

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B4(i1055)

Specifier:

Designer: AJ

Company:

Misc:

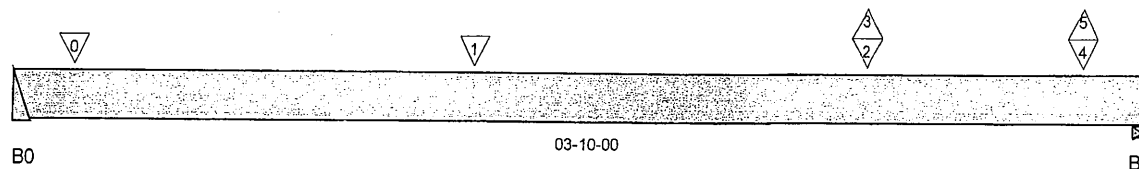

Total Horizontal Product Length = 03-10-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	255 / 2	140 / 0		
B1, 5-1/2"	887 / 19	951 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	J4(i1232)	Conc. Pt. (lbs)	L	00-02-08	00-02-08	101	51			n/a
1	J4(i993)	Conc. Pt. (lbs)	L	01-06-08	01-06-08	160	80			n/a
2	J3(i1234)	Conc. Pt. (lbs)	L	02-10-08	02-10-08	395	217			n/a
3	J3(i1234)	Conc. Pt. (lbs)	L	02-10-08	02-10-08	-12				n/a
4	5(i384)	Conc. Pt. (lbs)	L	03-07-04	03-07-04	486	725			n/a
5	5(i384)	Conc. Pt. (lbs)	L	03-07-04	03-07-04	-9				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	508 ft-lbs	12,704 ft-lbs	4%	1	01-06-08
End Shear	558 lbs	5,785 lbs	9.7%	1	02-07-00
Total Load Defl.	L/999 (0.003")	n/a	n/a	6	01-10-00
Live Load Defl.	L/999 (0.002")	n/a	n/a	8	01-10-00
Max Defl.	0.003"	n/a	n/a	6	01-10-00
Span / Depth	4.2	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 1-3/4"	558 lbs	n/a	13.1%	HUS1.81/10
B1 Wall/Plate	5-1/2" x 1-3/4"	2,519 lbs	61.3%	21.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO OBC 2012

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

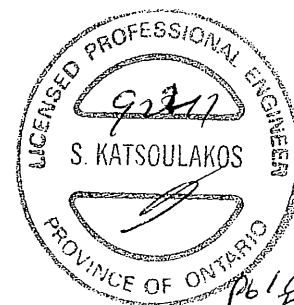

DWG NO. TAM4762B-17
STRUCTURAL
COMPONENT ONLY



Boise Cascade

Single 1-3/4" x 9-1/2" VERSA-LAM® 2:0 3100 SP Basement\Flush Beams\B4(i1055)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope(deg)

June 3, 2017 11:40:18

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports:

CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl

Description: Designs\Flush Beams\Basement\Flush Beams\B4(i105

Specifier:

Designer: AJ


Company:

Msc:

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

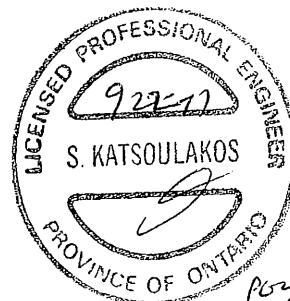

DWG NO. TAM 47628-17
STRUCTURAL
COMPONENT ONLY



Boise Cascade

Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B5(i985)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:18

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B5(i985)

Specifier:

Designer: AJ

Company:

Misc:

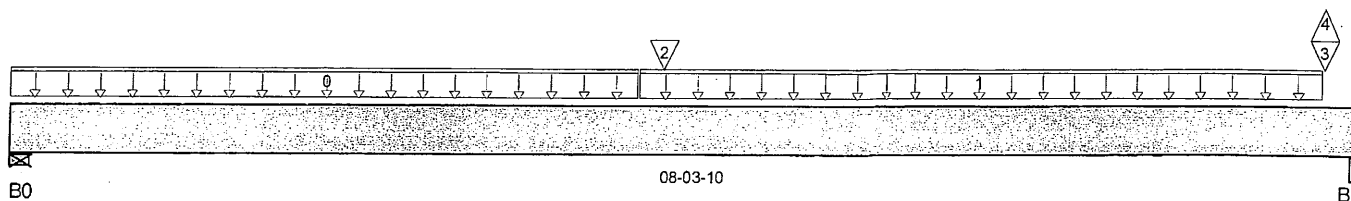

Total Horizontal Product Length = 08-03-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 4"	504 / 0	307 / 0		
B1, 5-1/4"	2,809 / 212	1,596 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-10-00	20	10			n/a
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	03-10-00	08-01-00	27	13			n/a
2	B8(i1039)	Conc. Pt. (lbs)	L	03-11-12	03-11-12	805	432			n/a
3	-	Conc. Pt. (lbs)	L	08-01-00	08-01-00	2,319	1,296			n/a
4	-	Conc. Pt. (lbs)	L	08-01-00	08-01-00	-212				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	3,798 ft-lbs	25,408 ft-lbs	14.9%	1	03-11-12
End Shear	1,079 lbs	11,571 lbs	9.3%	1	01-01-08
Total Load Defl.	L/999 (0.047")	n/a	n/a	6	04-00-15
Live Load Defl.	L/999 (0.03")	n/a	n/a	8	04-00-15
Max Defl.	0.047"	n/a	n/a	6	04-00-15
Span / Depth	9.7	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	4" x 3-1/2"	1,140 lbs	19.1%	6.7%	Unspecified
B1 Beam	5-1/4" x 3-1/2"	6,209 lbs	79.1%	27.7%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.


Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

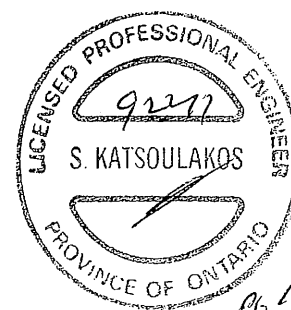

DWG NO. TAM 47629-17
STRUCTURAL
COMPONENT ONLY



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B5(i985)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:18

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl

Description: Designs\Flush Beams\Basement\Flush Beams\B5(i985

Specifier:


Designer: AJ

Company:

Misc:

Connection Diagram

Concentrated side-load exceeds allowable magnitude for connection design. Please consult a technical representative or Professional Engineer for the design of the connection. *OK WITH MATERIAL*




PROVIDE 4 ROWS OF 3 1/2" ARDOX SPIRAL NAILS @ 4" O/C FOR MULTI-PLY NAILING, MAINTAIN A MIN. 1" LUMBER EDGE/END DISTANCE. DO NOT USE AIR NAILS

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

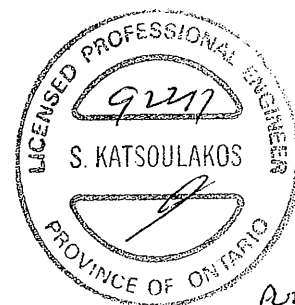

DWG NO. TAM 47629-17
STRUCTURAL
COMPONENT ONLY



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B6(i959)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:18

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B6(i959)

Specifier:

Designer: AJ

Company:

Misc:

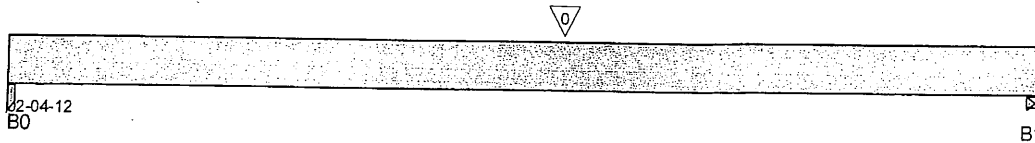

Total Horizontal Product Length = 02-04-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	42 / 0	27 / 0		
B1, 3-1/2"	48 / 0	30 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
0 J5(i1096)	Conc. Pt. (lbs)	L	01-03-04	01-03-04	90	45	1.00	1.15	n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	95 ft-lbs	12,704 ft-lbs	0.7%	1	01-03-04
End Shear	103 lbs	5,785 lbs	1.8%	1	01-03-12
Total Load Defl.	L/999 (0")	n/a	n/a	4	01-02-11
Live Load Defl.	L/999 (0")	n/a	n/a	5	01-02-11
Max Defl.	0"	n/a	n/a	4	01-02-11
Span / Depth	2.4	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Post	3-1/2" x 1-3/4"	96 lbs	2.4%	1.3%	Unspecified
B1 Wall/Plate	3-1/2" x 1-3/4"	110 lbs	4.2%	1.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-01-12, Bottom: 00-01-12.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





Boise Cascade

Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B7(i1107)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:18

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B7(i1107)

Specifier:

Designer: AJ

Company:

Misc:

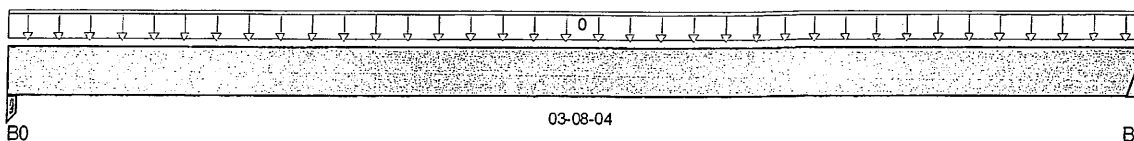

Total Horizontal Product Length = 03-08-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 1-3/4"	41 / 0	29 / 0		
B1	42 / 0	30 / 0		

Load Summary

Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0 FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-08-04	22	11			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	82 ft-lbs	12,704 ft-lbs	0.6%	1	01-10-00
End Shear	48 lbs	5,785 lbs	0.8%	1	00-11-04
Total Load Defl.	L/999 (0.001")	n/a	n/a	4	01-10-00
Live Load Defl.	L/999 (0")	n/a	n/a	5	01-10-00
Max Defl.	0.001"	n/a	n/a	4	01-10-00
Span / Depth	4.4	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Post	1-3/4" x 1-3/4"	99 lbs	5%	2.6%	Unspecified
B1 Hanger	2" x 1-3/4"	100 lbs	n/a	2.3%	HUS1.81/10

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.





Boise Cascade

Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basment\Flush Beams\B8(i1039)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:18

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basment\Flush Beams\B8(i1039)

Specifier:

Designer: AJ

Company:

Misc:

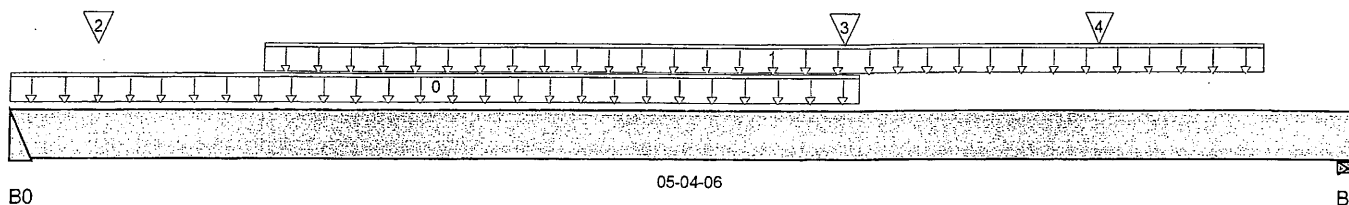

B0

05-04-06

B1

Total Horizontal Product Length = 05-04-06

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	817 / 0	438 / 0		
B1, 2-3/8"	545 / 0	304 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	User Load	Unf. Lin. (lb/ft)	L	00-00-00	03-04-04	240	120			n/a
1	Smoothed Load	Unf. Lin. (lb/ft)	L	01-00-00	05-00-00	86	43			n/a
2	J5(i1116)	Conc. Pt. (lbs)	L	00-04-00	00-04-00	80	40			n/a
3	B7(i1107)	Conc. Pt. (lbs)	L	03-03-06	03-03-06	41	29			n/a
4	J5(i1096)	Conc. Pt. (lbs)	L	04-04-00	04-04-00	86	43			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,047 ft-lbs	25,408 ft-lbs	8.1%	1	02-07-00
End Shear	1,185 lbs	11,571 lbs	10.2%	1	04-04-08
Total Load Defl.	L/999 (0.013")	n/a	n/a	4	02-08-00
Live Load Defl.	L/999 (0.009")	n/a	n/a	5	02-08-00
Max Defl.	0.013"	n/a	n/a	4	02-08-00
Span / Depth	6.5	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	1,774 lbs	n/a	20.8%	HGUS410
B1 Wall/Plate	2-3/8" x 3-1/2"	1,197 lbs	33.7%	11.8%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

p6/4

DWG NO. TAM 47632-17
STRUCTURAL
COMPONENT ONLY



Boise Cascade

Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B8(i1039)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:18

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B8(i103

Specifier:

Designer: AJ

Company:

Misc:

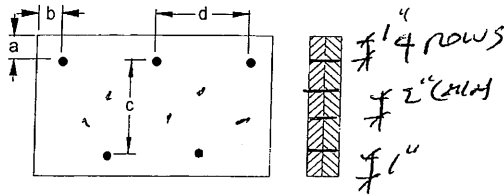Connection Diagram

a minimum = 8" c = 2-1/2"
 b minimum = 3" d = 8"

Calculated Side Load = 167.4 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: Nails

3 1/2" ARDOX SPIRAL**Disclosure**

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 4763217
 STRUCTURAL
 COMPONENT ONLY



Boise Cascade

Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B9(i1992)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

September 18, 2017 09:22:54

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B9(i1992)

Specifier:

Designer: AJ

Company:

Misc:

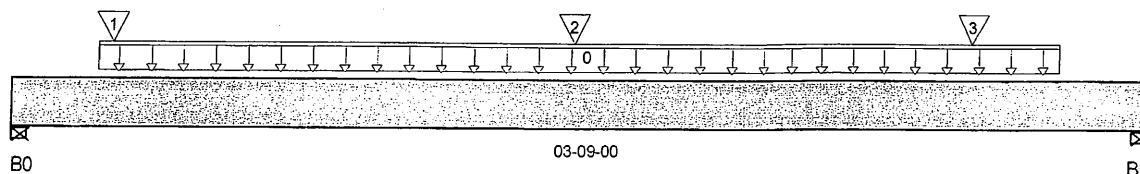

Total Horizontal Product Length = 03-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	823 / 0	575 / 0		
B1, 3-1/2"	622 / 0	346 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	User Load	Unf. Lin. (lb/ft)	L	00-03-08	03-05-08	240	120			n/a
1	J3(i2032)	Conc. Pt. (lbs)	L	00-04-00	00-04-00	344	307			n/a
2	J5(i2016)	Conc. Pt. (lbs)	L	01-10-00	01-10-00	181	136			n/a
3	J5(i1994)	Conc. Pt. (lbs)	L	03-02-00	03-02-00	158	79			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,167 ft-lbs	12,704 ft-lbs	9.2%	1	01-10-00
End Shear	741 lbs	5,785 lbs	12.8%	1	02-08-00
Total Load Defl.	L/999 (0.006")	n/a	n/a	4	01-10-10
Live Load Defl.	L/999 (0.004")	n/a	n/a	5	01-10-10
Max Defl.	0.006"	n/a	n/a	4	01-10-10
Span / Depth	4.2	n/a	n/a		00-00-00

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	3-1/2" x 1-3/4"	1,953 lbs	59.7%	26.1%	Unspecified
B1 Wall/Plate	3-1/2" x 1-3/4"	1,366 lbs	41.8%	18.3%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

DWG NO. TAM 47625-17
STRUCTURAL
COMPONENT ONLY





Boise Cascade

Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP Basement\Flush Beams\B11(i980)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:19

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basement\Flush Beams\B11(i980)

Specifier:

Designer: AJ

Company:

Misc:

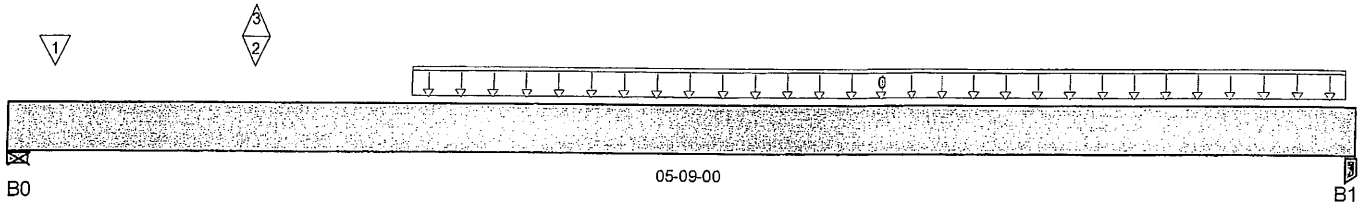

Total Horizontal Product Length = 05-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/2"	725 / 20	752 / 0		
B1, 1-3/4"	531 / 3	296 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	Smoothed Load	Unf. Lin. (lb/ft)	L	01-08-08	05-08-08	184	92			n/a
1	11(i414)	Conc. Pt. (lbs)	L	00-02-04	00-02-04	127	404			n/a
2	J3(i1234)	Conc. Pt. (lbs)	L	01-00-08	01-00-08	391	220			n/a
3	J3(i1234)	Conc. Pt. (lbs)	L	01-00-08	01-00-08	-23				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,679 ft-lbs	25,408 ft-lbs	6.6%	1	02-04-08
End Shear	1,275 lbs	11,571 lbs	11%	1	01-01-00
Total Load Defl.	L/999 (0.013")	n/a	n/a	6	02-11-00
Live Load Defl.	L/999 (0.008")	n/a	n/a	8	02-11-00
Max Defl.	0.013"	n/a	n/a	6	02-11-00
Span / Depth	6.9	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	3-1/2" x 3-1/2"	2,028 lbs	38.8%	13.6%	Unspecified
B1 Post	1-3/4" x 3-1/2"	1,166 lbs	29.3%	15.6%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA

O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012





Boise Cascade

Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100.SP Basment\Flush Beams\B11(i980)

BC CALC® Design Report



Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:19

Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\Basment\Flush Beams\B11(i980)

Specifier:

Designer: AJ

Company:

Msc:

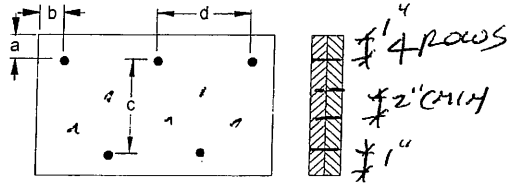Connection Diagram

a minimum = 1" c = 1-1/2"
 b minimum = 3" d = 6"

Calculated Side Load = 416.6 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails
 3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWONG TAM 47634-17
 STRUCTURAL
 COMPONENT ONLY

BC CALC® Design Report

1st Floor\Flush Beams\B12(i5733)

Dry | 2 spans | R cant.

February 14, 2018 09:16:15

Build 6215

Job name:

File name: HIGHGROVE 4 EL 1.mmdl

Address:

Description: 1st Floor\Flush Beams\B12(i5733)

City, Province, Postal Code: WAT...WN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

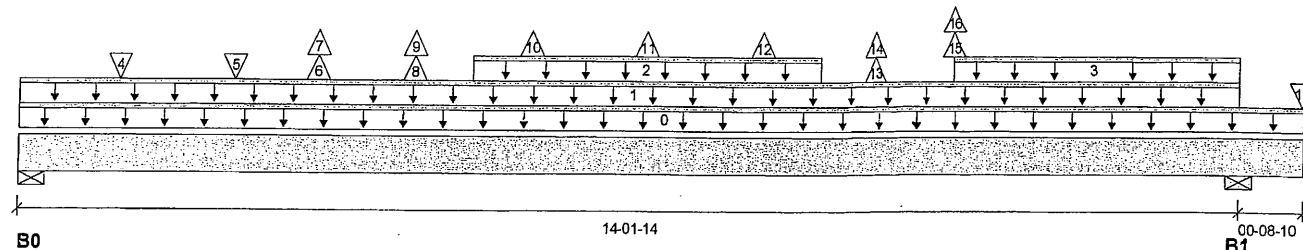

Total Horizontal Product Length = 14-10-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/8"	823 / 62	351 / 0	0 / 83	
B1, 5-1/2"	766 / 60	329 / 0	0 / 81	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-10-08		10			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	14-01-14	27	13			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	05-02-10	09-02-10	97	20			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	10-10-00	14-01-14	26	13			n/a
4	J4(i5795)	Conc. Pt. (lbs)	L	01-01-10	01-01-10	115	58			n/a
5	J4(i5826)	Conc. Pt. (lbs)	L	02-05-10	02-05-10	108	54			n/a
6	J5DJ(i5901)	Conc. Pt. (lbs)	L	03-05-04	03-05-04	101	14	-25		n/a
7	J5DJ(i5901)	Conc. Pt. (lbs)	L	03-05-04	03-05-04	-15				n/a
8	J4(i5905)	Conc. Pt. (lbs)	L	04-06-10	04-06-10	118	23	-23		n/a
9	J4(i5905)	Conc. Pt. (lbs)	L	04-06-10	04-06-10	-18				n/a
10	J4(i5796)	Conc. Pt. (lbs)	L	05-10-10	05-10-10	-19		-24		n/a
11	J4(i5887)	Conc. Pt. (lbs)	L	07-02-10	07-02-10	-19		-24		n/a
12	J4(i5853)	Conc. Pt. (lbs)	L	08-06-10	08-06-10	-19		-24		n/a
13	J4(i5918)	Conc. Pt. (lbs)	L	09-10-10	09-10-10	110	21	-21		n/a
14	J4(i5918)	Conc. Pt. (lbs)	L	09-10-10	09-10-10	-16				n/a
15	J5DJ(i5709)	Conc. Pt. (lbs)	L	10-10-00	10-10-00	164	47	-23		n/a
16	J5DJ(i5709)	Conc. Pt. (lbs)	L	10-10-00	10-10-00	-14				n/a
17	FC2 Floor Material	Conc. Pt. (lbs)	L	14-10-04	14-10-04	21	11			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	5,894 ft-lbs	23,220 ft-lbs	25.4%	43	07-02-10
Neg. Moment	-35 ft-lbs	-23,220 ft-lbs	0.1%	1	14-01-14
End Shear	1,602 lbs	11,571 lbs	13.8%	43	01-00-10
Cont. Shear	1,380 lbs	11,571 lbs	11.9%	41	13-01-10
Total Load Deflection	L/583 (0.287")	n/a	41.2%	102	07-02-10
Live Load Deflection	L/801 (0.209")	n/a	44.9%	151	07-02-10
Total Neg. Defl.	2xL/1,998 (-0.047")	n/a	n/a	102	14-10-08
Max Defl.	0.287"	n/a	n/a	102	07-02-10
Span / Depth	17.6				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/8" x 3-1/2"	1,674 lbs	28.7%	12.5%	Unspecified



DWG NO. TAM9642-18
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1st Floor\Flush Beams\B12(i5733)**

Dry | 2 spans | R cant.

February 14, 2018 09:16:15

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports:

CCMC 12472-R

File name: HIGHGROVE 4 EL 1.mmdl

Description: 1st Floor\Flush Beams\B12(i5733)

Specifier:

Designer: AJ

Company:

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	1,560 lbs	15.2%	6.6%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.


CONFORMS TO OBC 2012

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

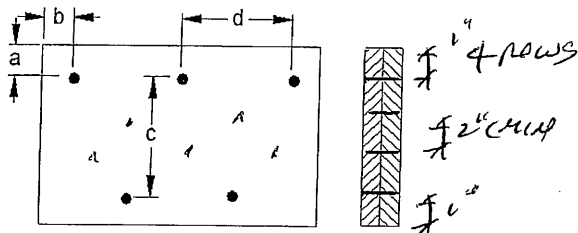Connection Diagrama minimum = 1"
b minimum = 3"c = 2-1/2"
d = 8"

Calculated Side Load = 115.4 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 3-1/2" ARDOX SPIRAL Nails

3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. TAM 9642-08
STRUCTURAL
COMPONENT ONLY





Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Dropped Beams\1st Floor\Dropped Beams\B13

Specifier:

Designer: AJ

Company:

Misc:

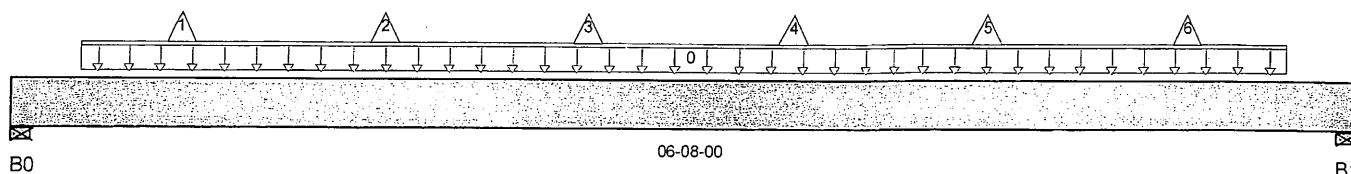

Total Horizontal Product Length = 06-08-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 4"	1,262 / 9	659 / 0		
B1, 4"	1,118 / 9	587 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	Smoothed Load	Unf. Lin. (lb/ft)	L	00-04-00	06-04-00	397	197			n/a
1	J2(i1178)	Conc. Pt. (lbs)	L	00-10-00	00-10-00	-3				n/a
2	J2(i1177)	Conc. Pt. (lbs)	L	01-10-00	01-10-00	-3				n/a
3	J2(i1176)	Conc. Pt. (lbs)	L	02-10-00	02-10-00	-3				n/a
4	J2(i1175)	Conc. Pt. (lbs)	L	03-10-00	03-10-00	-3				n/a
5	J2(i1174)	Conc. Pt. (lbs)	L	04-10-00	04-10-00	-3				n/a
6	J2(i1173)	Conc. Pt. (lbs)	L	05-10-00	05-10-00	-3				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	3,793 ft-lbs	25,408 ft-lbs	14.9%	1	03-00-08
End Shear	2,149 lbs	11,571 lbs	18.6%	1	05-06-08
Total Load Defl.	L/999 (0.036")	n/a	n/a	6	03-04-01
Live Load Defl.	L/999 (0.024")	n/a	n/a	8	03-04-01
Max Defl.	0.036"	n/a	n/a	6	03-04-01
Span / Depth	7.7	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	4" x 3-1/2"	2,716 lbs	29.9%	15.9%	Unspecified
B1 Wall/Plate	4" x 3-1/2"	2,410 lbs	26.5%	14.1%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-03-02, Bottom: 00-03-02.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO DBC 2012

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9



1042
 DWG NO. TAM 42635.17
 STRUCTURAL
 COMPONENT ONLY



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl

Description: Designs\Dropped Beams\1st Floor\Dropped Beams\B1


Specifier:

Designer: AJ

Company:

Misc:

Connection Diagram

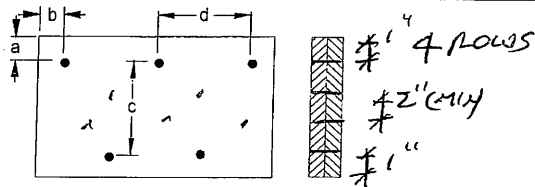

a minimum = 1" c = 3-1/2"
b minimum = 3" d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods.

Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 4163517
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1st Floor\Flush Beams\B15(i5861)**

BC CALC® Design Report

Dry | 1 span | No cant.

February 14, 2018 09:16:15

Build 6215

Job name:

File name: HIGHGROVE 4 EL 1.mmdl

Address:

Description: 1st Floor\Flush Beams\B15(i5861)

City, Province, Postal Code: WAT...WN

Specifier:


Customer:

Designer: AJ

Code reports:

CCMC 12472-R

Company:

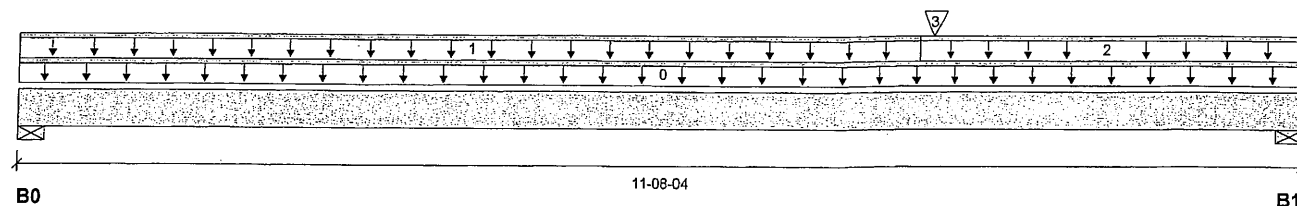

Total Horizontal Product Length = 11-08-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/8"	390 / 0	261 / 0		
B1, 5-3/8"	962 / 0	568 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-08-04		10			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	08-02-06	14	7			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	08-02-06	11-08-04	27	13			n/a
3	B18(i5772)	Conc. Pt. (lbs)	L	08-04-02	08-04-02	1,146	614			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	5,989 ft-lbs	23,220 ft-lbs	25.8%	1	08-04-02
End Shear	2,068 lbs	11,571 lbs	17.9%	1	10-05-06
Total Load Deflection	L/887 (0.15")	n/a	27.1%	4	06-03-09
Live Load Deflection	L/999 (0.094")	n/a	n/a	5	06-03-09
Max Defl.	0.15"	n/a	n/a	4	06-03-09
Span / Depth	14.0				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B0	Wall/Plate 3-1/8" x 3-1/2"	911 lbs	15.6%	6.8%	Unspecified
B1	Wall/Plate 5-3/8" x 3-1/2"	2,153 lbs	21.4%	9.4%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.



DWG NO. TAM 9643
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

1st Floor\Flush Beams\B15(i5861)

Dry | 1 span | No cant.

February 14, 2018 09:16:15

File name: HIGHGROVE 4 EL 1.mmdl


Description: 1st Floor\Flush Beams\B15(i5861)

Specifier:

Designer: AJ

Company:

Connection Diagram

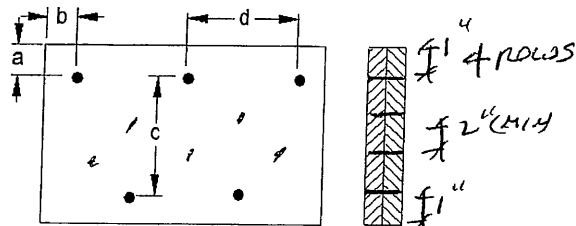

a minimum = 1"
b minimum = 3"

c = 1-1/2"
d = 6"

Calculated Side Load = 212.7 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 3-1/2" ARDOX SPIRAL

3-1/2" ARDOX SPIRAL

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. TAM 9643-8
STRUCTURAL
COMPONENT ONLY





Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B16(i1217)

Specifier:

Designer: AJ

Company:

Misc:

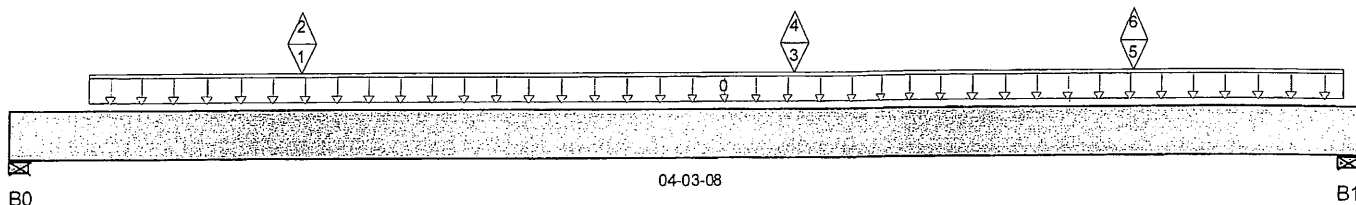

Total Horizontal Product Length = 04-03-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 5-1/2"	465 / 14	259 / 0		
B1, 5-1/2"	707 / 17	384 / 0		

Load Summary


Tag Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0 Smoothed Load	Unf. Lin. (lb/ft)	L	00-03-00	04-03-00	104	49			n/a
1 -	Conc. Pt. (lbs)	L	00-11-00	00-11-00	171	85			n/a
2 -	Conc. Pt. (lbs)	L	00-11-00	00-11-00	-7				n/a
3 -	Conc. Pt. (lbs)	L	02-05-11	02-05-11	229	142			n/a
4 -	Conc. Pt. (lbs)	L	02-05-11	02-05-11	-17				n/a
5 -	Conc. Pt. (lbs)	L	03-07-00	03-07-00	351	175			n/a
6 -	Conc. Pt. (lbs)	L	03-07-00	03-07-00	-7				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,006 ft-lbs	25,408 ft-lbs	4%	1	02-05-12
End Shear	811 lbs	11,571 lbs	7%	1	03-00-08
Total Load Defl.	L/999 (0.003")	n/a	n/a	6	02-02-04
Live Load Defl.	L/999 (0.002")	n/a	n/a	8	02-02-04
Max Defl.	0.003"	n/a	n/a	6	02-02-04
Span / Depth	4.4	n/a	n/a		00-00-00

Bearing Supports

	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	5-1/2" x 3-1/2"	1,022 lbs	12.4%	4.4%	Unspecified
B1 Wall/Plate	5-1/2" x 3-1/2"	1,541 lbs	18.7%	6.6%	Unspecified

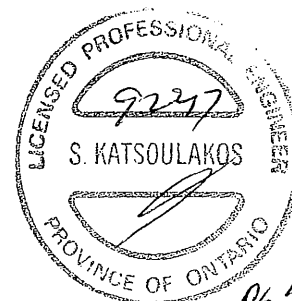Notes

 DWG NO. TAM 42637-17
 STRUCTURAL
 COMPONENT ONLY

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B16(i1217

Specifier:

Designer: AJ

Company:

Misc:

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO CBC 2012

Design based on Dry Service Condition.


Importance Factor : Normal Part code : Part 9

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Connection Diagram

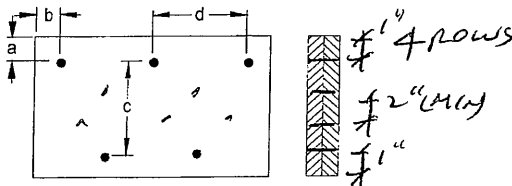

a minimum = 1" c = 1-1/2"
b minimum = 3" d = 6"

Calculated Side Load = 376.1 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Common Nails

3 1/2" ARDOX SPIRAL




DWG NO. TAM 4263217
STRUCTURAL
COMPONENT ONLY

BC CALC® Design Report


Build 5033
 Job Name:
 Address:
 City, Province, Postal Code: WATERDOWN,
 Customer:
 Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl
 Description: Designs\Flush Beams\1st Floor\Flush Beams\B17(i1011)
 Specifier:
 Designer: AJ
 Company:
 Misc:

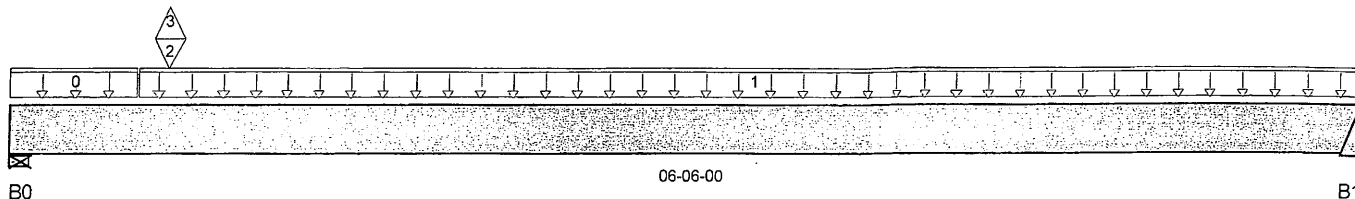

Total Horizontal Product Length = 06-06-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 4"	1,059 / 166	518 / 0		
B1	245 / 14	149 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Trib.
0	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-07-04	25	12			n/a
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-07-04	06-06-00	53	27			n/a
2	B18(i961)	Conc. Pt. (lbs)	L	00-09-00	00-09-00	974	440			n/a
3	B18(i961)	Conc. Pt. (lbs)	L	00-09-00	00-09-00	-180				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	1,166 ft-lbs	25,408 ft-lbs	4.6%	1	02-01-02
End Shear	1,252 lbs	11,571 lbs	10.8%	1	01-01-08
Total Load Defl.	L/999 (0.011")	n/a	n/a	6	03-01-08
Live Load Defl.	L/999 (0.007")	n/a	n/a	8	03-01-08
Max Defl.	0.011"	n/a	n/a	6	03-01-08
Span / Depth	7.7	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Wall/Plate	4" x 3-1/2"	2,236 lbs	37.4%	13.1%	Unspecified
B1 Hanger	2" x 3-1/2"	554 lbs	n/a	6.5%	HGUS410

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned


Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO OBC 2012

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

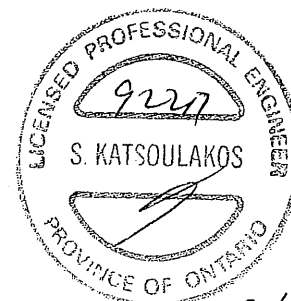

DWG NO. TAM 47638-17
 STRUCTURAL
 COMPONENT ONLY

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B17(i1011)


Specifier:

Designer: AJ

Company:

Misc:

Connection Diagram

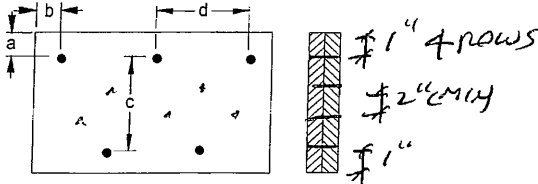

a minimum = 2" c = 1-1/2"
b minimum = 3" d = 6"

Calculated Side Load = 267.8 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: Nails

3 1/2" ARDOX SPIRAL

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.



DWG NO. TAM 47638-17
STRUCTURAL
COMPONENT ONLY



Boise Cascade

Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100-SP 1st Floor\Flush Beams\B18(i961)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:22

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl


Description: Designs\Flush Beams\1st Floor\Flush Beams\B18(i961)

Specifier:

Designer: AJ

Company:

Misc:

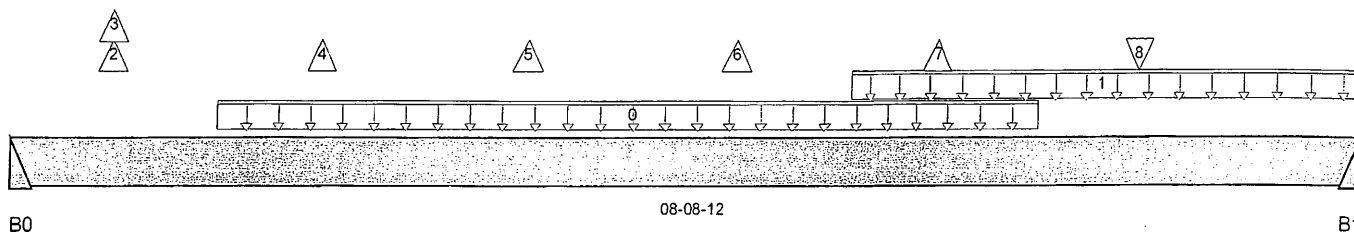

Total Horizontal Product Length = 08-08-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0	451 / 296	120 / 0		
B1	980 / 179	443 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live	Dead	Snow	Wind	Trib.
0	Smoothed Load	Unf. Lin. (lb/ft)	L	01-03-12	06-07-12	70				n/a
1	User Load	Unf. Lin. (lb/ft)	L	05-04-12	08-08-12	240	120			n/a
2	J1(i1218)	Conc. Pt. (lbs)	L	00-07-12	00-07-12	76	-9			n/a
3	J1(i1218)	Conc. Pt. (lbs)	L	00-07-12	00-07-12	-95				n/a
4	J1(i1135)	Conc. Pt. (lbs)	L	01-11-12	01-11-12	-95				n/a
5	J1(i1136)	Conc. Pt. (lbs)	L	03-03-12	03-03-12	-95				n/a
6	J1(i1137)	Conc. Pt. (lbs)	L	04-07-12	04-07-12	-95				n/a
7	J1(i1138)	Conc. Pt. (lbs)	L	05-11-12	05-11-12	-95				n/a
8	J5(i1139)	Conc. Pt. (lbs)	L	07-03-12	07-03-12	179	90			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand / Resistance	Load Case	Location
Pos. Moment	2,882 ft-lbs	25,408 ft-lbs	11.3%	1	05-10-00
Neg. Moment	-534 ft-lbs	-25,408 ft-lbs	2.1%	4	03-03-12
End Shear	1,524 lbs	11,571 lbs	13.2%	1	07-09-04
Uplift	336 lbs	n/a	n/a	4	00-00-00
Total Load Defl.	L/999 (0.049")	n/a	n/a	6	04-07-12
Live Load Defl.	L/999 (0.036")	n/a	n/a	8	04-07-12
Total Neg. Defl.	L/999 (-0.003")	n/a	n/a	7	02-11-12
Max Defl.	0.049"	n/a	n/a	6	04-07-12
Span / Depth	10.8	n/a	n/a		00-00-00

Bearing Supports	Dim. (L x W)	Demand	Demand / Resistance Support	Demand / Resistance Member	Material
B0 Hanger	2" x 3-1/2"	826 lbs	n/a	9.7%	HGUS4 10
B0 Hanger Uplift	2" x 3-1/2"	336 lbs	n/a	0.03	HGUS4 10
B1 Hanger	2" x 3-1/2"	2,025 lbs	n/a	23.7%	HGUS4 10

Cautions



DWG NO. TAM 42639.17
 STRUCTURAL
 COMPONENT ONLY



Boise Cascade

Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 1st Floor\Flush Beams\B18(i961)

Dry | 1 span | No cantilevers | 0/12 slope (deg)

June 3, 2017 11:40:22

BC CALC® Design Report



Build 5033

Job Name:

Address:

City, Province, Postal Code: WATERDOWN,

Customer:

Code reports: CCMC 12472-R

File Name: HIGHGROVE 4 EL-1.mmdl

Description: Designs\Flush Beams\1st Floor\Flush Beams\B18(i961

Specifier:

Designer: AJ

Company:

Misc:

Uplift of 336 lbs found at span 1 - Left.

Hanger B0 cannot handle uplift of -336 lbs.) - (SIMPSON HANGERS B0)

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

CONFORMS TO CBC 2012


Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Disclosure

Completeness and accuracy of input must be verified by anyone who would rely on output as evidence of suitability for particular application. Output here based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call 1-800-964-6999 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, SIMPLE FRAMING SYSTEM®, VERSA-LAM®, VERSA-RIM PLUS®, VERSA-RIM®, VERSA-STRAND®, VERSA-STUD® are trademarks of Boise Cascade Wood Products L.L.C.

Connection Diagram

1" 4 rows
2" (min)
1"

a minimum = 1" c = 1-1/2"
b minimum = 3" d = 12"

Calculated Side Load = 38.2 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: Nails

3 1/2" ARDOX SPIRAL

DW000.TAM 42639.17
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED**

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports:

CCMC 12472-R

Dry | 1 span | No cant.

February 14, 2018 09:38:13


File name: HIGHGROVE 4 EL 1.mmdl

Description: 1st Floor\Flush Beams\B30(i6115)

Specifier:

Designer: AJ

Company:

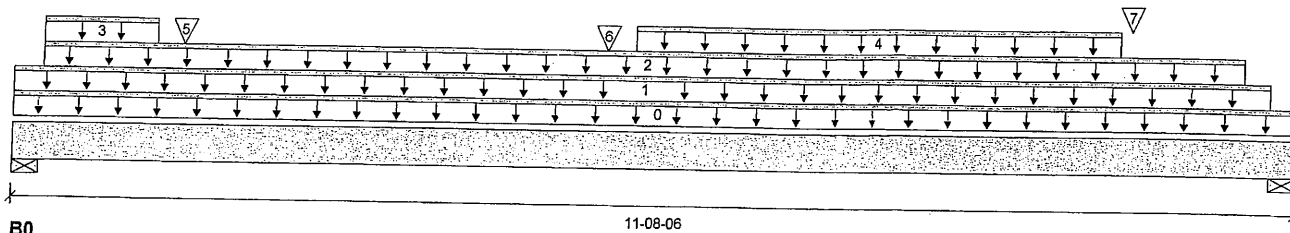

Total Horizontal Product Length = 11-08-06

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 3-1/8"	1,339 / 0	1,786 / 0	3,018 / 0	
B1, 5-1/2"	1,507 / 0	1,940 / 0	3,436 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-08-06		14			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	11-05-10	27	13			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-03-02	11-02-14		100			n/a
3	User Load	Unf. Lin. (lb/ft)	L	00-03-02	01-03-10	220	200	560		n/a
4	User Load	Unf. Lin. (lb/ft)	L	05-07-10	10-01-06	220	200	560		n/a
5	PL	Conc. Pt. (lbs)	L	01-06-10	01-06-10	440	400	1,120		n/a
6	PL	Conc. Pt. (lbs)	L	05-04-10	05-04-10	440	400	1,120		n/a
7	PL	Conc. Pt. (lbs)	L	10-02-10	10-02-10	440	400	1,120		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	21,418 ft-lbs	36,222 ft-lbs	59.1%	13	05-11-00
End Shear	8,176 lbs	17,356 lbs	47.1%	13	10-05-06
Total Load Deflection	L/292 (0.456")	n/a	82.1%	45	05-11-00
Live Load Deflection	L/433 (0.308")	n/a	83.1%	61	05-11-00
Max Defl.	0.456"	n/a	n/a	45	05-11-00
Span / Depth	14.0				

Bearing Supports

	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B0	Wall/Plate 3-1/8" x 5-1/4"	7,429 lbs	84.8%	37.1%	Unspecified
B1	Wall/Plate 5-1/2" x 5-1/4"	8,333 lbs	54.0%	23.7%	Unspecified



DWG NO. TAM 9638-18
STRUCTURAL
COMPONENT ONLY



Boise Cascade

**Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1st Floor\Flush Beams\B30(i6115)**

Dry | 1 span | No cant.

February 14, 2018 09:38:13

BC CALC® Design Report

Build 6215

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports: CCMC 12472-R

File name: HIGHGROVE 4 EL 1.mmdl

Description: 1st Floor\Flush Beams\B30(i6115)

Specifier:

Designer: AJ

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.



CONFORMS TO OBC 2012

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

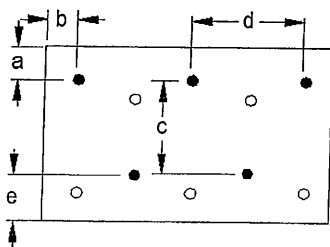Connection Diagram

4 rows

a minimum = 1"

b minimum = 3"

c = 6 1/2"

d = 4"

e minimum = 2"

Calculated Side Load = 0.7 lb/ft

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

DWG NO. TAM 9638
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJST®, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



Boise Cascade



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSEDBC CALC® Design Report
Build 6215

1st Floor\Flush Beams\B31(i5763)

Dry | 1 span | No cant.

February 14, 2018 09:38:13

Job name:

Address:

City, Province, Postal Code: WAT...WN

Customer:

Code reports:

CCMC 12472-R


File name: HIGHGROVE 4 EL 1.mmdl

Description: 1st Floor\Flush Beams\B31(i5763)

Specifier:

Designer: AJ

Company:

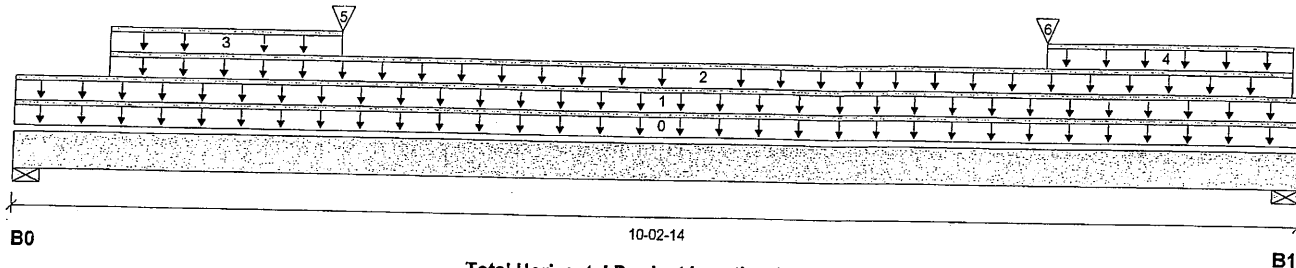

Total Horizontal Product Length = 10-02-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B0, 2-3/4"	1,002 / 0	1,494 / 0	2,565 / 0	
B1, 2-5/8"	1,119 / 0	1,677 / 0	2,913 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-02-14	14				00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	10-02-14	15	7			n/a
2	WALL	Unf. Lin. (lb/ft)	L	00-08-10	10-02-00		100			n/a
3	ROOF	Unf. Lin. (lb/ft)	L	00-08-10	02-06-12	200	204	560		n/a
4	ROOF	Unf. Lin. (lb/ft)	L	08-02-12	10-02-00	200	204	560		n/a
5	User Load	Conc. Pt. (lbs)	L	02-06-12	02-06-12	600	612	1,680		n/a
6	User Load	Conc. Pt. (lbs)	L	08-02-12	08-02-12	600	612	1,680		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	12,540 ft-lbs	36,222 ft-lbs	34.6%	13	03-02-03
End Shear	6,185 lbs	17,356 lbs	35.6%	13	01-00-04
Total Load Deflection	L/504 (0.236")	n/a	47.6%	45	05-00-08
Live Load Deflection	L/774 (0.154")	n/a	46.5%	61	05-00-08
Max Defl.	0.236"	n/a	n/a	45	05-00-08
Span / Depth	12.5				

Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B0	Wall/Plate 2-3/4" x 5-1/4"	6,216 lbs	80.6%	35.3%	Unspecified
B1	Wall/Plate 2-5/8" x 5-1/4"	7,026 lbs	95.5%	41.8%	Unspecified

DWG NO. TAM 9639
STRUCTURAL
COMPONENT ONLY



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Design Report
Build 6215

1st Floor\Flush Beams\B31(i5763)

Dry | 1 span | No cant.

February 14, 2018 09:38:13

Job name:
Address:
City, Province, Postal Code: WAT...WN
Customer:
Code reports: CCMC 12472-R

File name: HIGHGROVE 4 EL 1.mmdl
Description: 1st Floor\Flush Beams\B31(i5763)
Specifier:
Designer: AJ
Company:


Notes

Design meets Code minimum (L/240) Total load deflection criteria.
Design meets Code minimum (L/360) Live load deflection criteria.
Calculations assume member is fully braced.
Resistance Factor phi has been applied to all presented results per CSA O86.
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
Unbalanced snow loads determined from building geometry were used in selected product's verification.

CONFORMS TO OBC 2012

Design based on Dry Service Condition.
Importance Factor : Normal Part code : Part 9
Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
Nailing schedule applies to both sides of the member.
Member has no side loads.

Connection Diagram

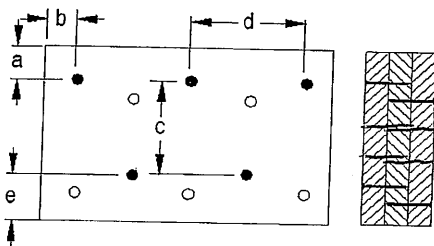

4 rows

a minimum = 1"
b minimum = 3"
c = 1 1/2"
d = 4"
e minimum = 2"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
Nailing schedule applies to both sides of the member.
Member has no side loads.
Connectors are: 16d SPIRAL Nails

3-1/2" ARDOX SPIRAL



Disclosure



Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM 9639-8
STRUCTURAL
COMPONENT ONLY

Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing





Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
14"	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
16"	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
14"	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
16"	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

Maximum Floor Spans



Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing



Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.






Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
14"	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
16"	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
14"	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
16"	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of $1.50L + 1.25D$. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing



Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
14"	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
16"	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
14"	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
16"	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



INSTALLATION GUIDE FOR RESIDENTIAL FLOORS

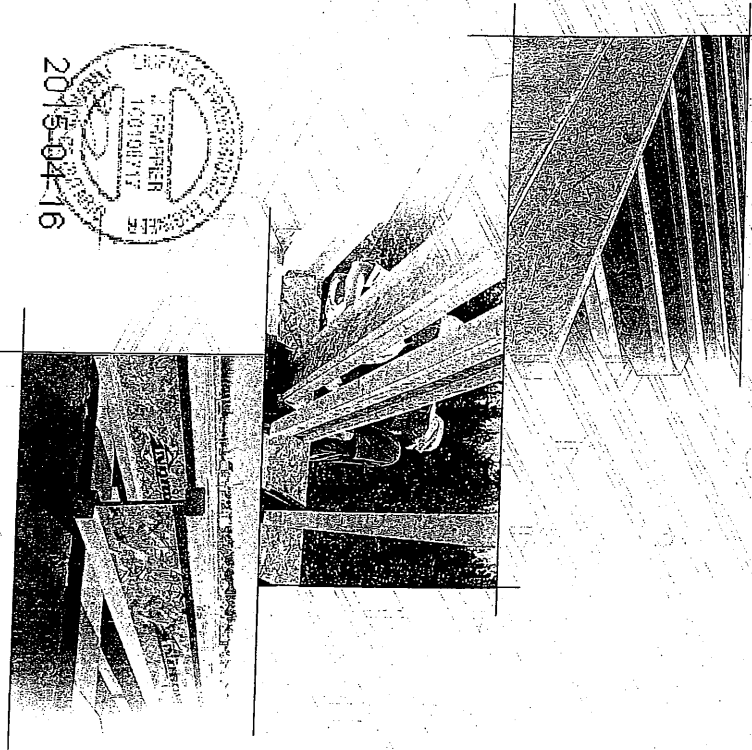

Distributed by:



N-C301 / November 2014

SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.



Never stack building materials over unsheathed I-joists. Once sheathed, do not over-stress I-joist with concentrated loads from building materials.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.


WARNING
I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

Avoid Accidents by Following these Important Guidelines:

1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends or adjoining bracing over at least two I-joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged I-joist.

STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
 - Pick I-joists in bundles as shipped by the supplier.
 - Orient the bundles so that the webs of the I-joists are vertical.
 - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.

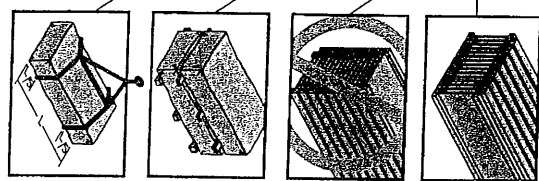

MAXIMUM FLOOR SPANS

1. Maximum **clear** spans applicable to simple-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CGS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit States Design per CAN/CSA O86-09 Standard, and NBC 2010.
7. SI units conversion: 1 inch = 25.4 mm
1 foot = 0.305 m


**MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS
SIMPLE AND MULTIPLE SPANS**

Joist Depth	Joist Series	Simple spans				Multiple spans			
		On centre spacing				On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
12"	12S	15.3	17.3	18.3	19.3	15.3	17.3	18.3	19.3
16"	16S	17.3	19.3	20.3	21.3	17.3	19.3	20.3	21.3
19.2"	19.2S	19.3	21.3	22.3	23.3	19.3	21.3	22.3	23.3
24"	24S	21.3	23.3	24.3	25.3	21.3	23.3	24.3	25.3
12"	12S	15.3	17.3	18.3	19.3	15.3	17.3	18.3	19.3
16"	16S	17.3	19.3	20.3	21.3	17.3	19.3	20.3	21.3
19.2"	19.2S	19.3	21.3	22.3	23.3	19.3	21.3	22.3	23.3
24"	24S	21.3	23.3	24.3	25.3	21.3	23.3	24.3	25.3
12"	12S	15.3	17.3	18.3	19.3	15.3	17.3	18.3	19.3
16"	16S	17.3	19.3	20.3	21.3	17.3	19.3	20.3	21.3
19.2"	19.2S	19.3	21.3	22.3	23.3	19.3	21.3	22.3	23.3
24"	24S	21.3	23.3	24.3	25.3	21.3	23.3	24.3	25.3

CCMC EVALUATION REPORT 13032-R

I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the I-joist.




WEB STIFFENERS

RECOMMENDATIONS:

- A **bearing stiffener** is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.
- A **bearing stiffener** is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A **load stiffener** is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm


**FIGURE 2
WEB STIFFENER INSTALLATION DETAILS**

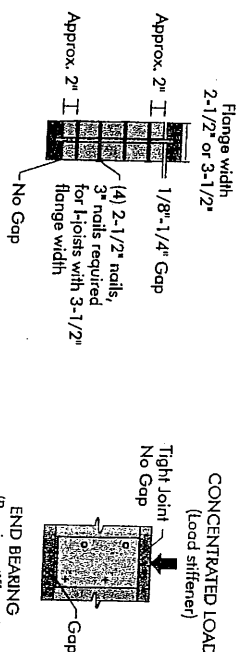

See table below for web stiffener size requirements

STIFFENER SIZE REQUIREMENTS

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width



NORDIC I-JOIST SERIES

5-PF No.2	1950F MSR	2100F MSR	1950F MSR	2100F MSR	2400F MSR	NFG Lumber
33 pieces per unit	33 pieces per unit	33 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit	23 pieces per unit
NI-20	NI-40x	NI-60	NI-70	NI-80	NI-90	NI-10x
OSB 3/8" x 11-7/8"	OSB 3/8" x 11-7/8"	OSB 3/8" x 11-7/8"	OSB 3/8" x 11-7/8"	OSB 3/8" x 11-7/8"	OSB 3/8" x 11-7/8"	OSB 3/8" x 11-7/8"
1-1/2"	1-1/2"	1-1/2"	1-1/2"	1-1/2"	1-1/2"	1-1/2"
11-7/8"	11-7/8"	11-7/8"	11-7/8"	11-7/8"	11-7/8"	11-7/8"
14"	14"	14"	14"	14"	14"	14"
16"	16"	16"	16"	16"	16"	16"

Chaniers Chibougama Ltd. harvests its own trees, which enable Nordic products to adhere to strict quality control procedures through every phase of the operation, from forest to the finished product, reflects our commitment to quality.

Nordic Engineered Wood I-joists use only finger-jointed back spruce lumber in their flanges, ensuring consistent quality, superior strength, and longer span carrying capacity.

2015-04-16

INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, consult your supplier.
2. Except for cutting to length, I-joist flanges should **never** be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple spans must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge **may never** be used as blocking or rim boards. I-joist blocking panels or other engineered wood products – such as rim board – must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.









FIGURE 1
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS
Some framing requirements such as erection bracing and blocking panels have been omitted for clarity.

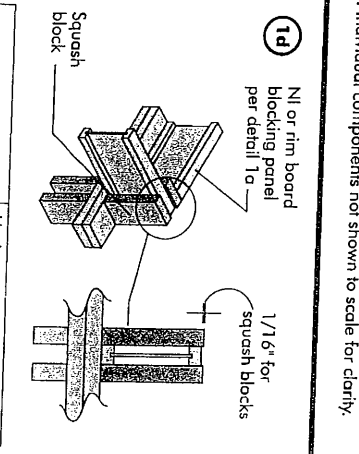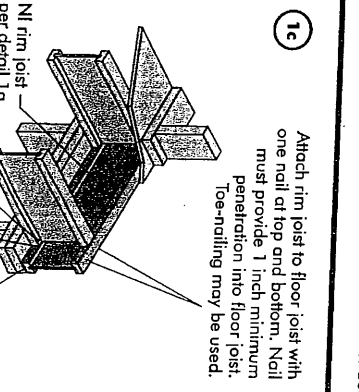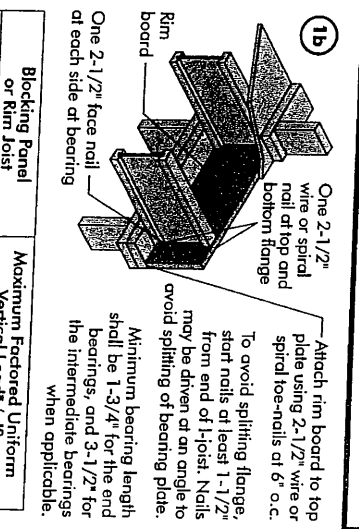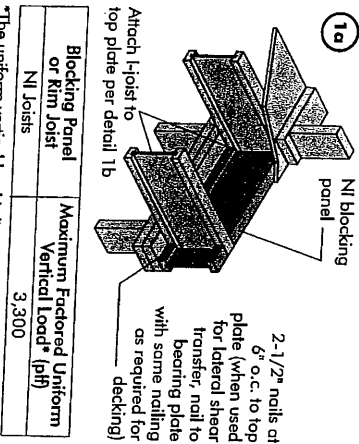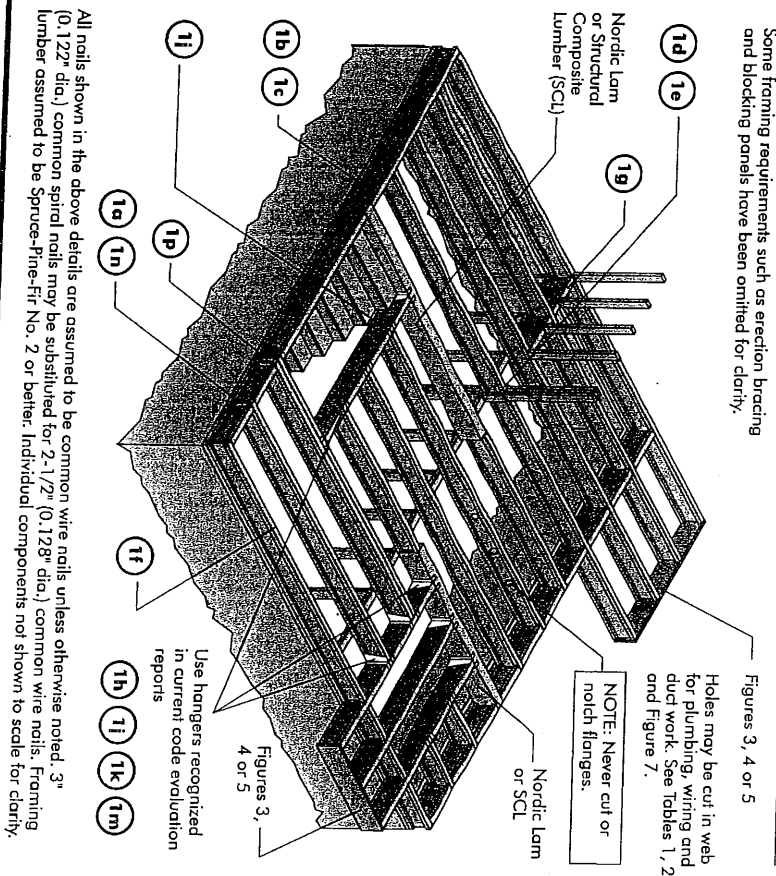

Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
NI Joists	3,300

Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
1-1/8" Rim Board Plus	8,090

Pair of Squash Blocks	Maximum Factored Vertical Per Pair of Squash Blocks (lbs)
2x Lumber	5,500
1-1/8" Rim Board Plus	4,300









Pair of Squash Blocks	Maximum Factored Vertical Per Pair of Squash Blocks (lbs)
2x Lumber	5,500
1-1/8" Rim Board Plus	4,300

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

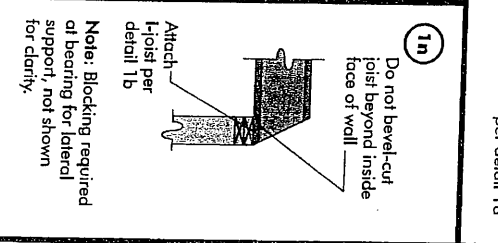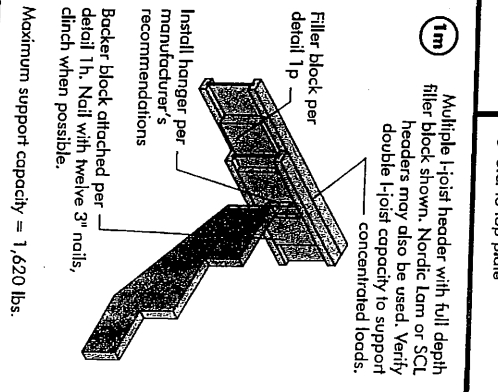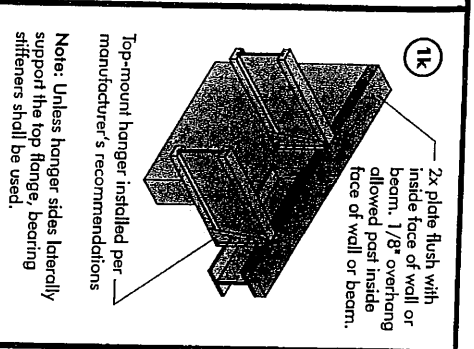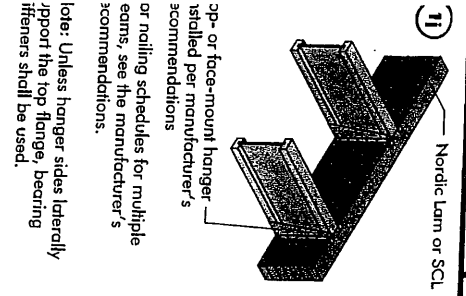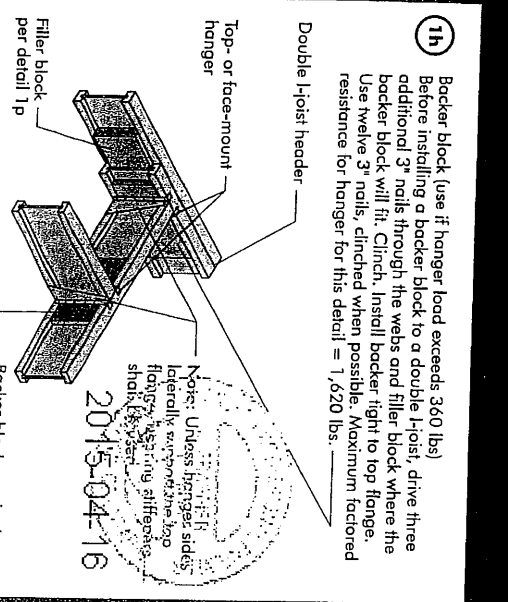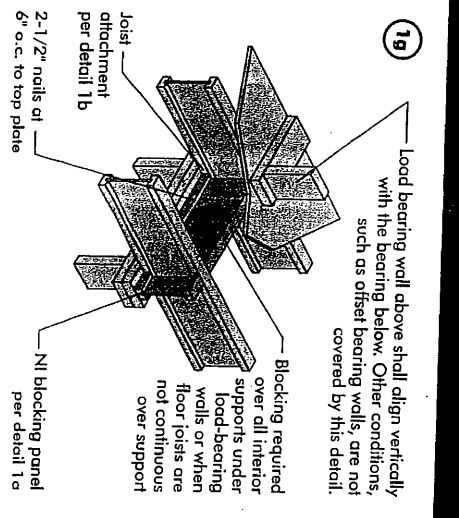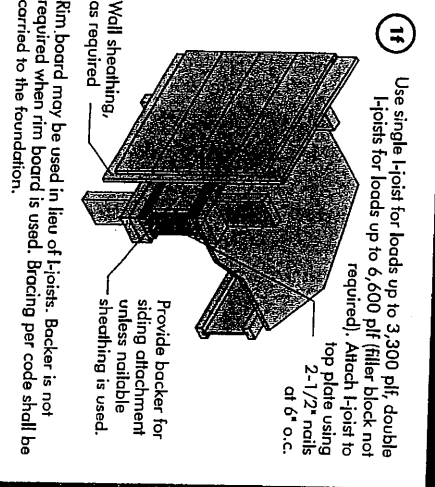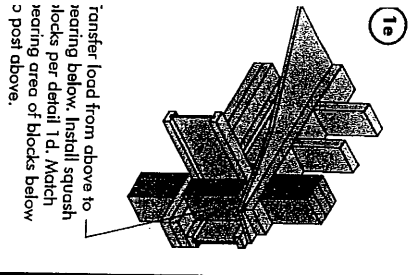

For hanger capacity see hanger manufacturer's recommendations. Verify double I-joist capacity to support concentrated loads.

BACKER BLOCKS (Blocks must be long enough to permit required nailing without splitting)

Flange Width	Material Thickness Required*	Minimum Depth**
2-1/2"	1"	5-1/2"
3-1/2"	1-1/2"	7-1/4"

* Minimum grade for backer block material shall be S-P-F No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-C0825 or CAN/CSA-Q437 Standard.




** For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

Notes:

1. Support back of I-joist web during nailing to prevent damage to web/flange connection.
2. Leave a 1/8 to 1/4-inch gap between top of filler block and bottom of top I-joist flange.
3. Filler block is required between joists for full length of span.
4. Nail joists together with two rows of 3" nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
5. The maximum factored load that may be applied to one side of the double I-joist using this detail is 860 lb/ft. Verify double I-joist capacity.

FILLER BLOCK REQUIREMENTS FOR DOUBLE I-JOIST CONSTRUCTION

Flange Size	Joist Depth	Filler Block Size
2-1/2" x 1-1/2"	9-1/2"	2-1/8" x 6"
2-1/2" x 1-1/2"	11-7/8"	2-1/8" x 8"
2-1/2" x 1-1/2"	14"	2-1/8" x 10"
2-1/2" x 1-1/2"	16"	2-1/8" x 12"
3-1/2" x 1-1/2"	9-1/2"	3" x 6"
3-1/2" x 1-1/2"	11-7/8"	3" x 8"
3-1/2" x 1-1/2"	14"	3" x 10"
3-1/2" x 1-1/2"	16"	3" x 12"
3-1/2" x 2"	11-7/8"	3" x 7"
3-1/2" x 2"	14"	3" x 9"
3-1/2" x 2"	16"	3" x 11"

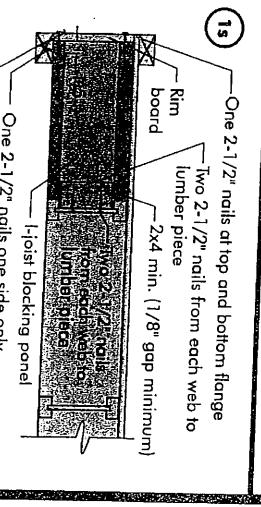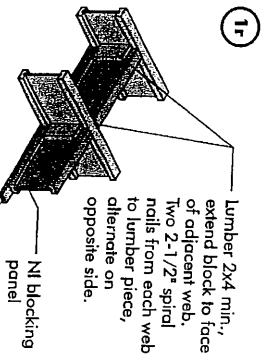

Optional: Minimum 1x4 inch strap applied to underside of joist at blocking line or 1/2 inch minimum gypsum ceiling attached to underside of joists.

Notes:

- In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.

3a I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

Block I-joists together with filler blocks for the full length of the reinforcement. For I-joist flange widths greater than 3 inches place an additional row of 3" x 6" x 1/2" concrete of the reinforcing panel from each side. Clinch when possible.

For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.


1. *is* reinforced with #4 wood structural steel on one side only.
2. *N* is the nominal axial load on the column.
3. *X* = Try a deeper wall or a double lateral point on each side of the supporting column.
4. For conventional wall construction using a ridge board, the roof *S*pan column joints are equivalent to the *S*pan column joints. For ridge board construction, the supporting wall and the ridge board, when the roof is formed using a ridge board, the roof *Truss* *S*pan is equivalent to the roof *Truss* *S*pan. For ridge board construction, the distance between the supporting walls as if a *Cont* is used.

WEB HOLES

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

1. The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
2. I-joint top and bottom flanges must NEVER be cut, notched, or otherwise modified.
3. Whenever possible, field-cut holes should be centred on the middle of the web.
4. The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joint web shall equal the clear distance between the flanges of the top or bottom of the hole or opening and the adjacent I-joint flange.
5. The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
6. Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively).
7. A knockout is **not** considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
8. Holes measuring 1-1/2 inches or smaller shall be permitted anywhere in a continuous section of a joist. Holes of greater size may be permitted subject to verification.
9. A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
10. All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
11. Limit three maximum size holes per span, of which one may be a duct chase opening.
12. A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

FIGURE 7
FIELD-CUT HOLE LOCATOR

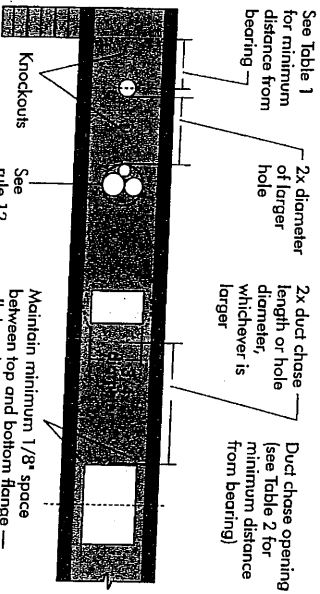

A knockout is **NOT** considered a hole, may be utilized wherever it occurs and may be ignored for purposes of calculating minimum distances between holes.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Minimum distance from inside face of any support to centre of hole (ft-in.)																	
Joist Depth	Joist Series	2	3	4	5	6	6-1/4	7	8	8-5/8	9	10	10-3/4	11	12	12-3/4	Span adjustment Factor
10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10	10
12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12	12
14	14	14	14	14	14	14	14	14	14	14	14	14	14	14	14	14	14
16	16	16	16	16	16	16	16	16	16	16	16	16	16	16	16	16	16
18	18	18	18	18	18	18	18	18	18	18	18	18	18	18	18	18	18
20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20	20
22	22	22	22	22	22	22	22	22	22	22	22	22	22	22	22	22	22
24	24	24	24	24	24	24	24	24	24	24	24	24	24	24	24	24	24
26	26	26	26	26	26	26	26	26	26	26	26	26	26	26	26	26	26
28	28	28	28	28	28	28	28	28	28	28	28	28	28	28	28	28	28
30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30	30
32	32	32	32	32	32	32	32	32	32	32	32	32	32	32	32	32	32
34	34	34	34	34	34	34	34	34	34	34	34	34	34	34	34	34	34
36	36	36	36	36	36	36	36	36	36	36	36	36	36	36	36	36	36
38	38	38	38	38	38	38	38	38	38	38	38	38	38	38	38	38	38
40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40	40

1. Above table may be used for light spacing of 24 inches on centre or less.
Hole location

OPTIONAL:

1. Above table may be used for light spacing of 24 inches on centre or less.
2. Hole location distance is measured from inside face of supports to centre of hole.
3. Distances in this chart are based on uniformly loaded joists.

The above table is based on the I-joists used of their maximum span. If the I-joists are placed at less than their full maximum span (see Maximum Clear Spans, Table 1), the minimum distance from the centreline of the hole to the face of any support [D] as given above may be reduced as follows:

$$\text{Reduced } D = \frac{\text{Actual } D}{\text{Lateral } D} \times D$$

Where:

- Reduced = Distance from the inside face of any support to centre of hole, reduced for less-than-maximum span application (ft).
 Lateral = The actual measured span distance between the inside faces of supports (ft).
 Actual = Span Adjustment Factor given in this table.
 D = The minimum distance from the inside face of any support to centre of hole from this table.
 If Lateral is greater than 1, use 1 in the above calculation for Lateral.

2015-04-16

TABLE 2
DUCT CHASE OPENING SIZES AND LOCATIONS — Simple Span Only

Minimum distance from inside face of any support to centre of opening (ft-in.)										
Joist Depth	Joist Series	8	10	12	14	16	18	20	22	24
10	10	10	10	10	10	10	10	10	10	10
12	12	12	12	12	12	12	12	12	12	12
14	14	14	14	14	14	14	14	14	14	14
16	16	16	16	16	16	16	16	16	16	16
18	18	18	18	18	18	18	18	18	18	18
20	20	20	20	20	20	20	20	20	20	20
22	22	22	22	22	22	22	22	22	22	22
24	24	24	24	24	24	24	24	24	24	24
26	26	26	26	26	26	26	26	26	26	26
28	28	28	28	28	28	28	28	28	28	28
30	30	30	30	30	30	30	30	30	30	30
32	32	32	32	32	32	32	32	32	32	32
34	34	34	34	34	34	34	34	34	34	34
36	36	36	36	36	36	36	36	36	36	36
38	38	38	38	38	38	38	38	38	38	38
40	40	40	40	40	40	40	40	40	40	40

Always table may be used for 4-1/2" to 4-1/2"

1. Above table may be used for light spacing of 24 inches on centre or less.
2. Duct chase opening location distance is measured from inside face of supports to centre of opening.
3. The above table is based on simple-span joists only. For other applications, contact your local distributor.
4. Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. For other applications, contact your local distributor.



Never drill, cut or notch the flange, or over-cut the web.
 Holes in webs should be cut with a sharp saw.


For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

5a SHEATHING REINFORCEMENT

Provide full depth blocking between joists over support (not shown)

Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4") required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2" nails at 6" o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

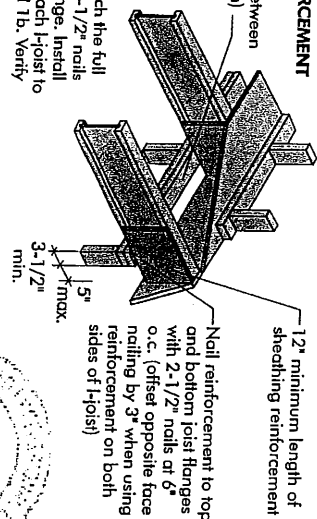


5b SET-BACK DETAIL

Run board or wood structural panel closure (3/4" minimum thickness), attach per detail 1b.


Notes:

- Provide full depth blocking between joists over support (not shown for clarity)
- Attach I-joist to plate at all supports per detail 1b.
- 3-1/2" minimum I-joist bearing required.

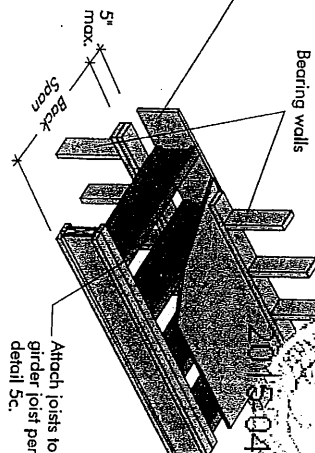

5c SET-BACK CONNECTION

Vertical solid sawn blocks (2x6 S.P.F. No. 2 or better) nailed through joist web and web of girder Alternate for opposite side.

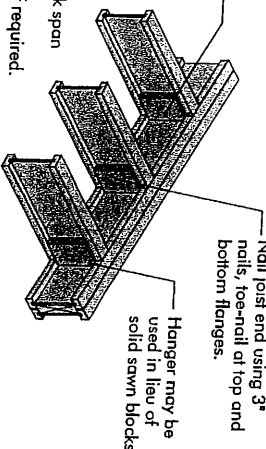


Notes:

- Verify girder joist capacity if the back span exceeds the joist spacing.
- Attach double I-joist per detail 1p, if required.

FIGURE 5 (continued)

See table below for NI reinforcement requirements at cantilever.

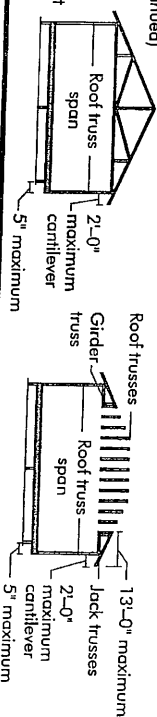

BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft)	LL = 30 psf, DL = 15 psf				LL = 40 psf, DL = 15 psf				LL = 50 psf, DL = 15 psf			
		JOIST SPACING (in.)				JOIST SPACING (in.)				JOIST SPACING (in.)			
12	12	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
14	14	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
16	16	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
18	18	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
20	20	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
22	22	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
24	24	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
26	26	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
28	28	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
30	30	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
32	32	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
34	34	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
36	36	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
38	38	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
40	40	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
42	42	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
44	44	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
46	46	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
48	48	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24
50	50	16	19.2	24	24	12	16	19.2	24	12	16	19.2	24

1. NI = NI reinforcement required.
2. NI = NI reinforcement with 3/4" wood structural panel on one side only.
3. NI = NI reinforcement with 3/4" wood structural panel on both sides, or double I-joist.
4. NI = NI reinforcement with 3/4" wood structural panel on one side only.
5. NI = NI reinforcement with 3/4" wood structural panel on both sides, or double I-joist.

1. For larger openings, or multiple 3'-0" width openings spaced less than 6'-0" o.c., additional joists beneath the opening's cripple studs may be required.
2. NI = NI reinforcement with 3/4" wood structural panel on one side only.
3. NI = NI reinforcement with 3/4" wood structural panel on both sides, or double I-joist.
4. NI = NI reinforcement with 3/4" wood structural panel on one side only.
5. NI = NI reinforcement with 3/4" wood structural panel on both sides, or double I-joist.

1. For larger openings, or multiple 3'-0" width openings spaced less than 6'-0" o.c., additional joists beneath the opening's cripple studs may be required.
2. NI = NI reinforcement with 3/4" wood structural panel on one side only.
3. NI = NI reinforcement with 3/4" wood structural panel on both sides, or double I-joist.
4. NI = NI reinforcement with 3/4" wood structural panel on one side only.
5. NI = NI reinforcement with 3/4" wood structural panel on both sides, or double I-joist.

INSTALLING THE GLUED FLOOR SYSTEM

1. Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
2. Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
3. Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
4. Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when topped into place with a block and sledgehammer.
5. Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
6. Apply two lines of glue on I-joists where panel ends butt to assure proper gluing of each end.
7. After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) than used on I-joist flanges.
8. Tap the second row of panels into place, using a block to protect groove edges.
9. Stagger end joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including T&G edges, is recommended. (Use a spacer tool or an 2-1/2" common nail to assure accurate and consistent spacing.)
10. **Complete all nailing of each panel before glue sets.** Check the manufacturer's recommendations for cure time. (Warm weather accelerates glue setting.) Use 2" ring- or screw-shank nails for panels 3/4-inch thick or less, and 2-1/2" ring- or screw-shank nails for thicker panels. Space nails per the table below. Closer nail spacing may be required by some codes, or for diaphragm construction. The finished deck can be walked on right away and will carry construction loads without damage to the glue bond.

FASTENERS FOR SHEATHING AND SUBFLOORING(1)

Maximum Joist Spacing (in.)	Minimum Panel Thickness (in.)	Common Wire or Spiral Nails	Nail Size and Type	Staples	Edges	Maximum Spacing of Fasteners	Intern. Supports
20	5/8	2 ⁿ	1-3/4"	2 ⁿ	6"	12"	
16	5/8	2 ⁿ	1-3/4"	2 ⁿ	6"	12"	
12	5/8	2 ⁿ	1-3/4"	2 ⁿ	6"	12"	
8	5/8	2 ⁿ	1-3/4"	2 ⁿ	6"	12"	
4	5/8	2 ⁿ	1-3/4"	2 ⁿ	6"	12"	


1. Fasteners of sheathing and subflooring shall conform to the above table.
2. Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
3. Flooring screws shall not be less than 1/8-inch in diameter.
4. Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
5. Use only adhesives conforming to CAN/CGSB-71.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues; check with panel manufacturer.

Ref.: NRC-CNRC, National Building Code of Canada 2010, Table 2.23.3.5.


IMPORTANT NOTE:
Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.

RIM BOARD INSTALLATION DETAILS


8a ATTACHMENT DETAILS WHERE RIM BOARDS ABUT

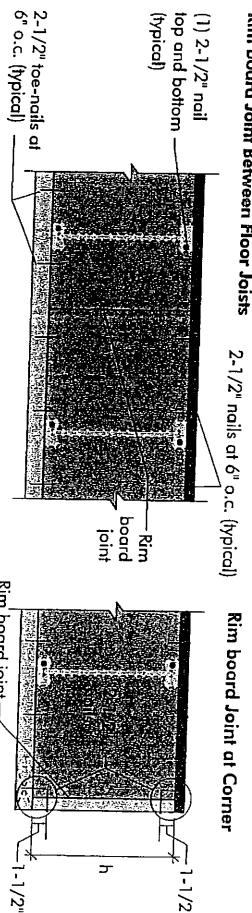

8b TOE-NAIL CONNECTION AT RIM BOARD




8c 2X LEDGER TO RIM BOARD ATTACHMENT DETAIL

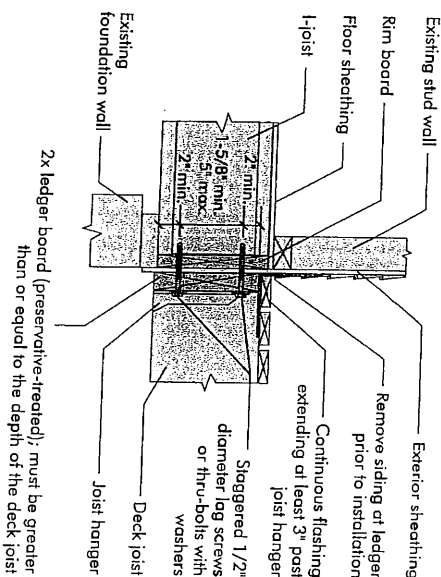

2015-04-16

PRODUCT WARRANTY

Champion Composite products are made from recycled materials and are designed to last for many years. We warrant that our products are free from manufacturing defects in material and workmanship. This warranty is limited to the original purchaser and is not transferable. For more information, please contact your local distributor or visit our website at www.championcomposite.com.

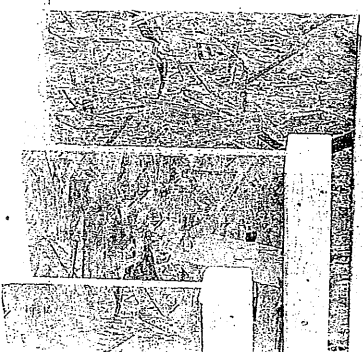


MICRO CITY ENGINEERING SERVICES INC.

TEL: (519) 287 - 2242

R.R. #1, P.O. BOX 61, GLENCOE, ONTARIO, N0L 1M0

LVL HEADER AND CONVENTIONAL LUMBER NAILING DETAILS		
DETAIL NUMBER	NUMBER OF ROWS	SPACING (INCHES o/c) "d"
A	2	12
B	2	8
C	2	6
D	2	4
1A	3	12
1B	3	8
1C	3	6
1D	3	4
2A	4	12
2B	4	8
2C	4	6
2D	4	4
3A	5	12
3B	5	8
3C	5	6
3D	5	4
4A	6	12
4B	6	8
4C	6	6
4D	6	4

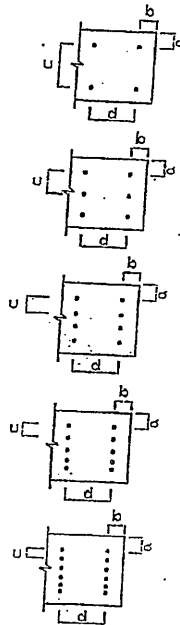

NOTES:

- (1) MINIMUM LUMBER EDGE DISTANCE "a" = 1"
- (2) MINIMUM LUMBER END DISTANCE "b" = 2"
- (3) MINIMUM NAIL ROW SPACING "c" = 2"
- (4) STAGGER NAILS "d/2" BETWEEN PLYS FOR MULTI-PLY MEMBERS (3 PLY OR MORE)
- (5) ALL NAILS ARE 3-1/2" ARDOX SPIRAL NAILS
- (6) DO **NOT** USE AIR-DRIVEN NAILS



DWG NO TAMN1001.14

STRUCTURAL

COMPONENT ONLY

TO BE USED ONLY
WITH BEAM CLOS
BEARING THE
STAMP BELOW

PROVIDE NAILING
DETAIL # X SEE
DWG #TAMN1001-14