

ASPHALT SHINGLES
12" FINISH O.H.
R.T.M.C
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:

HGUS26-2 (XX)
LJS26DS (V)
LUS24 (O)



8/12 PITCHES (TYP.)
UNLESS NOTED

DENOTES:

H -2'-0"-0 HIGHER PLATE
H2 -1'-6"-0 RAISED CEILING
F -12" HIGHER FASCIA ONLY
ALL D- 2-2X10 BEAMS (FLUSH)

T-170534

DENOTES:
CONVENTIONAL
FRAMING

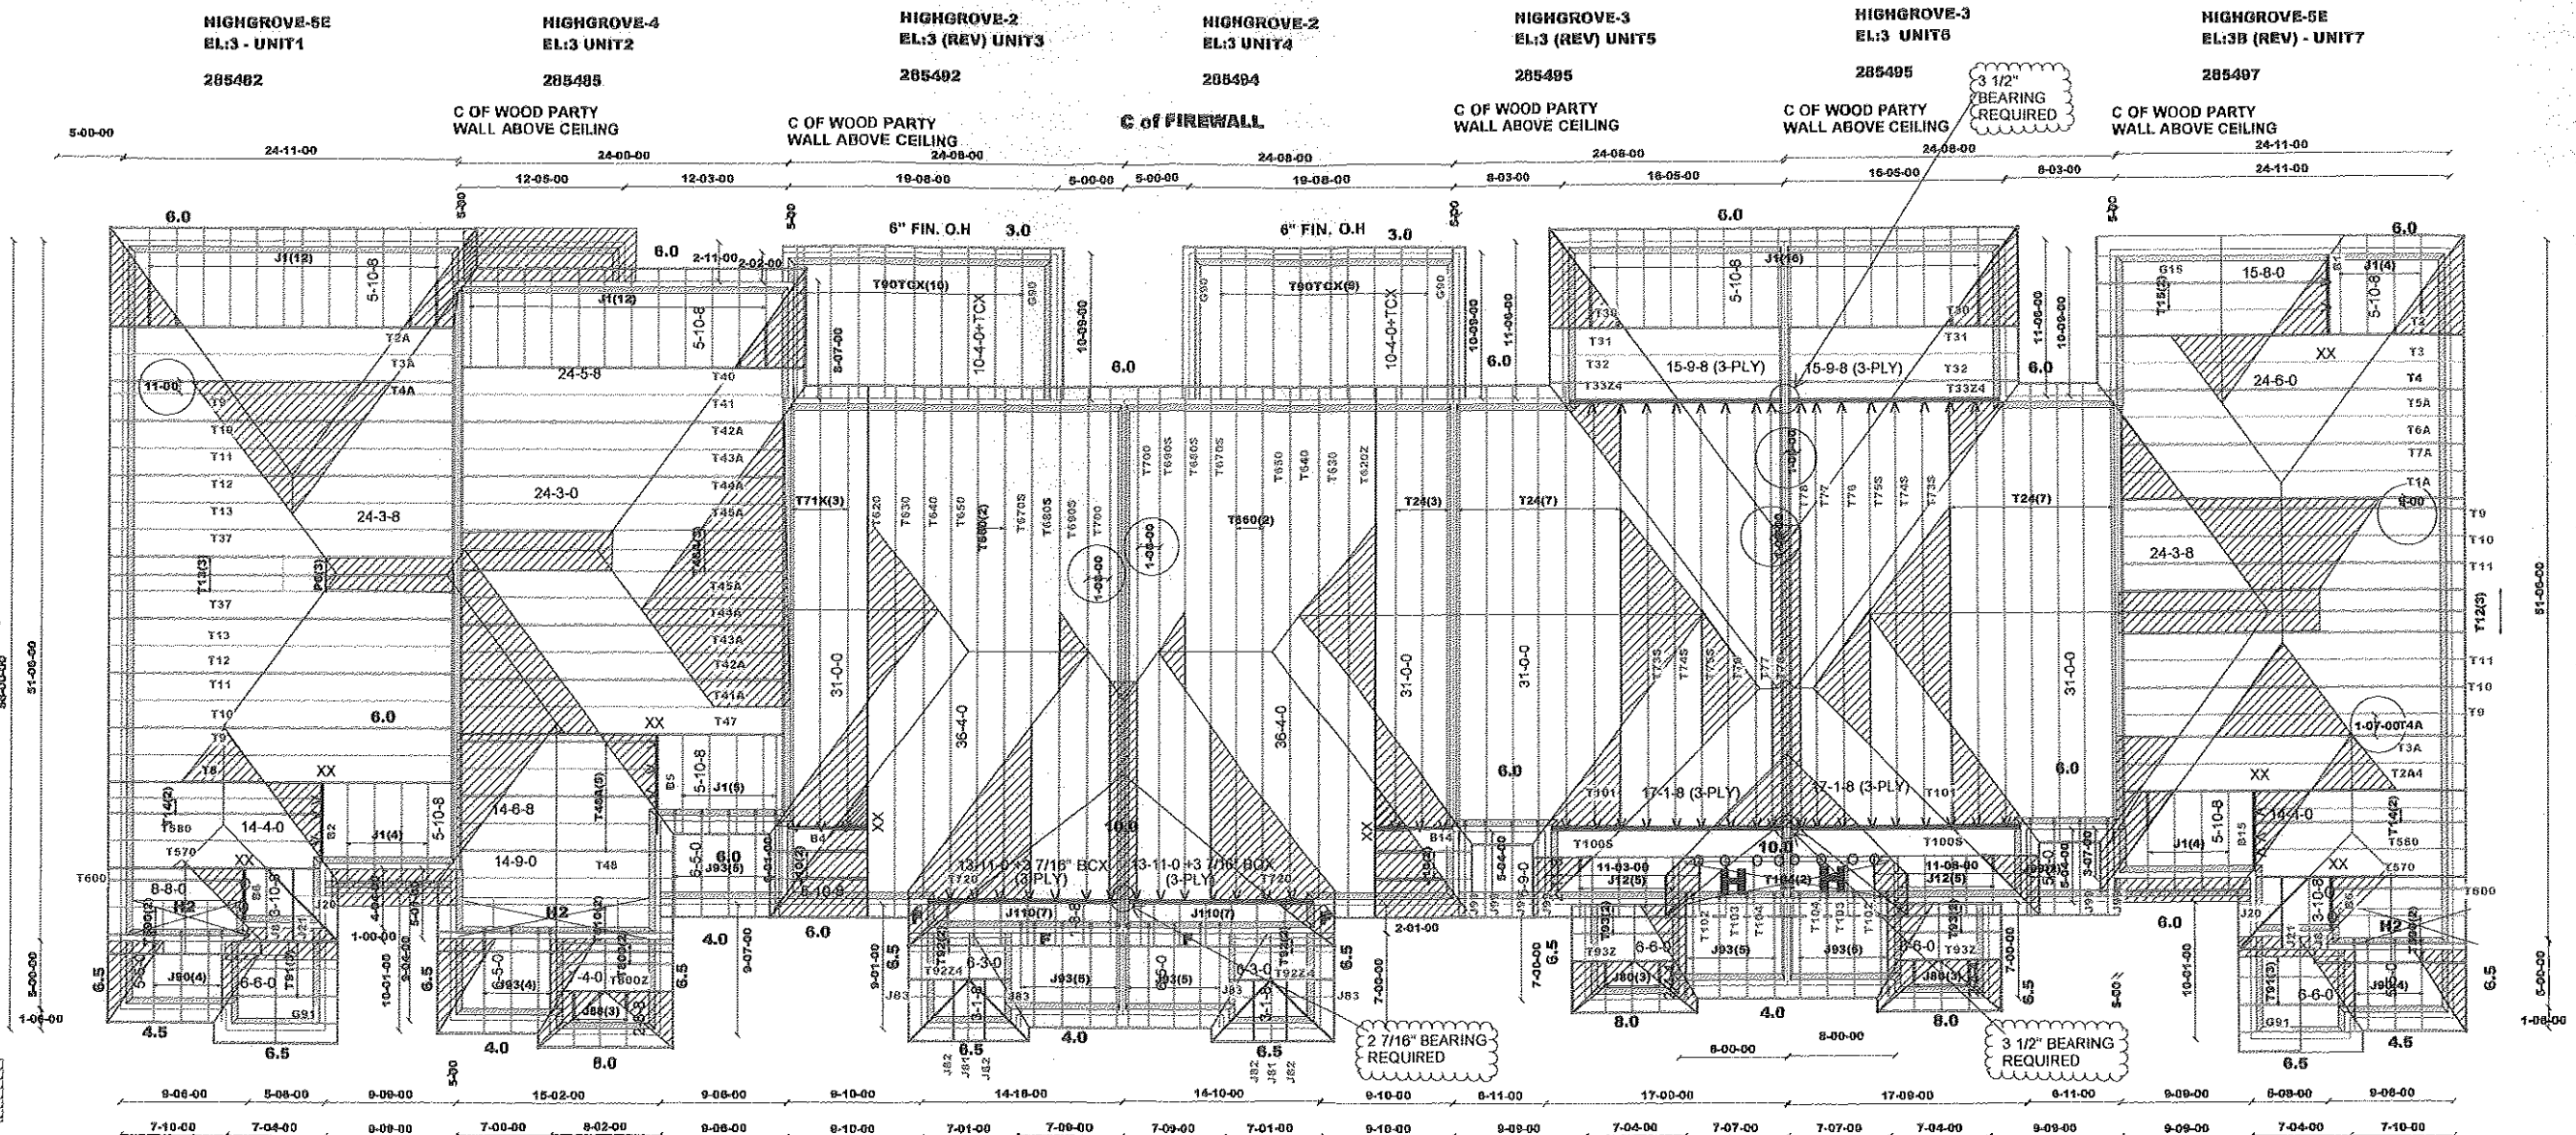

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC LATEST EDITION
ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c.
WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER AT EACH CROSS POINT.
POSTS LONGER THAN 6' TO BE Laterally BRACED SO THAT THE DISTANCE
BETWEEN END POINTS AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

DESIGN LOADS:

SNOW LOAD 25.6 PSF
TC DEAD 3 PSF
BC LIVE 10.5 PSF
BC DEAD 7 PSF



Job Track: 43954
Layout ID: 285481
Plan Log: 93446

Builder / Location:

GREENPARK HOMES / WATERDOWN

Project:

RUSSEL GARDENS PHASE 2

Date: 06/26/18


Designer: sonny

Model / Elevation:

BLOCK202/ UNIT1 TO7 (REVISED)

Milek ver 7.5.0

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR
REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY
TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

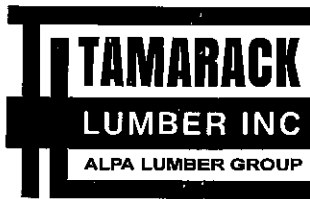

Delivery Shiplist

DATE	04/18/18
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285482 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH 2 SUB-BUILDER:
 MODEL: HIGHGROVE 5E ELEVATION: 3- UNIT1

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY PLY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
						TOP	BOT					
	1	T2A HIP GIRDER	8.00 0.00	24-03-08	04-01-04	2 X 6	2 X 6	01-03-08 00-00-00	01-04-13 01-06-08	142.48 87.67		
	1	T3A HIP	8.00 0.00	24-03-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	94.81 60.17		
	1	T4A HIP	8.00 0.00	24-03-08	06-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	103.53 66.33		
	1	T8 HALF HIP	8.00 0.00	24-03-08	04-01-04	2 X 6	2 X 6	01-03-08 00-00-00	01-04-13 04-01-04	143.26 88.34		
	2	T9 HALF HIP	8.00 0.00	24-03-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 05-01-04	197.10 123.66		
	2	T10 HALF HIP	8.00 0.00	24-03-08	06-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 06-01-04	212.66 133.34		
	2	T11 HALF HIP	8.00 0.00	24-03-08	07-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 07-01-04	225.56 142.68		
	2	T12 HALF HIP	8.00 0.00	24-03-08	08-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 08-01-04	234.64 146.34		
	5	T13 HALF HIP	8.00 0.00	24-03-08	09-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 09-01-04	614.40 379.15		
	2	T37 HALF HIP	8.00 0.00	24-03-08	10-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 10-01-04	257.54 159.34		
	2	T14 COMMON	8.00 0.00	14-04-00	06-02-02	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	123.52 78.00		
	1	T570 HIP GIRDER	8.00 0.00	14-04-00	03-11-13	2 X 4	2 X 6	01-03-08 01-03-08	01-04-13 01-04-13	70.63 46.34		
	1	T580 HIP	8.00 0.00	14-04-00	05-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	62.73 39.33		
	2	T590 ROOF	8.00 8.00	08-08-00	04-03-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	82.28 56.00		
	1	T600 COMMON	8.00 0.00	08-08-00	04-03-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	37.48 23.67		
	3	T91 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	66.60 45.00		
	1	G91 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	23.39 16.00		
	3	P6 PIGGYBACK	8.00 0.00	11-11-15	01-10-08	2 X 4	2 X 4	00-00-00 00-00-00	00-04-07 01-10-08	120.33 77.01		



Delivery Shiplist

DATE	04/18/18
SALES REP	Mario

JOB TRACK:43954 LAYOUT ID: 285482 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH 2 SUB-BUILDER:
 MODEL: HIGHGROVE 5E ELEVATION: 3- UNIT1

ROOF TRUSSES

ROOF TRUSS SPACING:24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	16	J1 JACK-OPEN	6.00 0.00	05-10-08	04-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-01-04	268.64 170.72		
	1	J8 JACK-OPEN	8.00 0.00	03-10-08	03-11-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 03-11-13	12.81 8.00		
	1	J20 JACK-OPEN	8.00 0.00	01-10-08	02-07-02	2 X 4	2 X 4	01-03-08 -00-01-01	01-04-13 00-03-08	9.17 5.67		
	1	J21 JACK-OPEN	8.00 0.00	03-10-08	02-07-02	2 X 4	2 X 4	01-03-08 -02-01-01	01-04-13 00-03-08	12.97 8.00		
	4	J90 JACK	4.50 0.00	05-05-00	02-05-00	2 X 4	2 X 4	01-03-08 00-00-00	00-04-10 02-05-00	57.88 37.32		

TOTAL # TRUSS= 56.00

TOTAL BFT OF ALL TRUSSES=

1998.08 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3174.41 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
2	Hangers	HGUS26-2	
2	Hangers	LUS24	
3	Hangers	LJS26DS	

TOTAL # ITEMS= 7.00



Delivery Shiplist

DATE	09/05/17
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285485 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH 2 SUB-BUILDER:
 MODEL: HIGHGROVE 4 ELEVATION: 3- UNIT2

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	1	T40 HALF HIP	8.00 0.00	24-05-08	04-01-04	2 X 6	2 X 6	01-03-08 00-00-00	01-04-13 04-01-04	136.90 84.33		
	1	T41 HALF HIP	8.00 0.00	24-05-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 05-01-04	99.05 61.83		
	1	T41A HALF HIP	8.00 0.00	24-03-00	05-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 05-01-04	96.77 61.17		
	2	T42A HALF HIP	8.00 0.00	24-03-00	06-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 06-01-04	209.24 132.00		
	2	T43A HALF HIP	8.00 0.00	24-03-00	07-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 07-01-04	222.10 141.34		
	2	T44A HALF HIP	8.00 0.00	24-03-00	08-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 08-01-04	231.32 146.34		
	2	T45A HALF HIP	8.00 0.00	24-03-00	09-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 09-01-04	242.42 150.34		
	3	T46A HALF HIP	8.00 0.00	24-03-00	10-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 10-01-04	381.24 237.00		
	1	T47 FLAT GIRDER	0.00 0.00	24-03-00	04-01-04	2 X 6	2 X 6	00-00-00 00-00-00	04-01-04 04-01-04	145.78 90.67		
	1	T48 COMMON	8.00 0.00	14-09-00	06-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	63.33 39.00		
	5	T48A COMMON	8.00 0.00	14-06-08	06-03-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	305.35 191.65		
	2	T610 ROOF	8.00 8.00	14-09-00	06-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	125.70 83.66		
	2	T800 COMMON	6.50 0.00	07-04-00	02-07-04	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	48.84 31.34		
	1	T800Z COMMON	6.50 0.00	07-04-00	02-07-04	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	24.42 15.67		
	17	J1 JACK-OPEN	6.00 0.00	05-10-08	04-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-01-04	285.43 181.39		
	3	J88 JACK-OPEN	8.00 0.00	02-08-08	02-07-05	2 X 4	2 X 4	01-03-08 00-00-00	00-09-10 02-07-05	27.57 18.00		
	9	J93 MONOPITCH	4.00 0.00	06-05-00	02-05-10	2 X 4	2 X 4	01-03-08 00-00-00	00-03-15 02-05-10	163.44 105.03		

TOTAL # TRUSS= 55.00

TOTAL BFT OF ALL TRUSSES=

1770.76 BFT. TOTAL WEIGHT OF ALL TRUSSES= 2808.90 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
-----	-----------	-------	--------------------



Delivery Shiplist


DATE	09/05/17
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285485 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH2 SUB-BUILDER:
 MODEL: HIGHGROVE 4 ELEVATION: 3- UNIT2

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
1	Hangers	HGUS26-2	
3	Hangers	LJS26DS	

TOTAL # ITEMS= 4.00

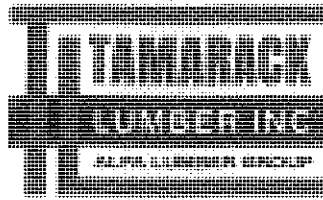

Delivery Shiplist


DATE	06/26/18
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285492 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH SUB-BUILDER:
 MODEL: HIGHGROVE 2 ELEVATION: 3 (REV)-UNIT3

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	3	T71X COMMON	6.00 0.00	31-00-00	08-08-12	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 00-09-08	368.61 229.50		
	10	T90TCX MONOPITCH	3.00 0.00	10-04-00	03-05-09	2 X 6	2 X 4	00-09-08 00-00-00	00-08-04 03-05-09	449.90 303.30		
	1	G90 MONOPITCH	3.00 0.00	10-04-00	03-03-04	2 X 4	2 X 4	00-09-08 00-00-00	00-08-04 03-03-04	59.06 38.33		
	2	T92 COMMON	6.50 0.00	06-03-00	02-03-12	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	43.08 30.00		
	1	T92Z4 COMMON	6.50 0.00	06-03-00	02-03-12	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	21.54 15.00		
	1	T620 HIP GIRDER	6.00 0.00	36-04-00	05-03-13	2 X 4	2 X 6	01-03-08 01-03-08	01-02-00 01-02-00	213.66 131.66		
	1	T630 HIP	6.00 0.00	36-04-00	06-07-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	146.04 92.83		
	1	T640 HIP	6.00 0.00	36-04-00	08-01-04	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	246.52 153.33		
	1	T650 HIP	6.00 0.00	36-04-00	09-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	156.18 98.00		
	2	T660 COMMON	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	293.96 180.00		
	1	T670S ROOF	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	161.65 100.67		
	1	T680S ROOF	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	173.83 108.67		
	1	T690S ROOF	6.00 0.00	36-04-00	10-01-13	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	178.48 109.83		
	1	T700 ROOF	6.00 0.00	36-04-00	11-03-02	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	188.58 116.33		
	1 3 Ply	T720 HALF HIP	8.00 0.00	13-11-00	04-00-12	2 X 4	2 X 6	00-00-00 00-00-00	02-04-13 00-00-04	247.65 161.01		
	2	J10 JACK-OPEN	8.00 0.00	05-10-08	05-03-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 00-05-03	35.66 21.34		
	1	J81 JACK-OPEN	6.50 0.00	03-01-08	02-03-12	2 X 4	2 X 4	01-03-08 00-00-00	00-07-07 02-03-12	10.08 7.33		
	2	J82 JACK-OPEN	6.50 0.00	03-01-08	01-07-01	2 X 4	2 X 4	01-03-08 -01-04-01	00-07-07 00-03-08	16.70 12.00		

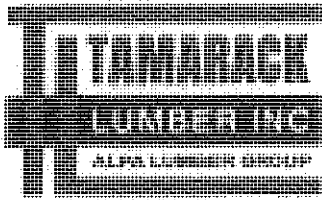

Delivery Shiplist

DATE	06/26/18
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285492 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH SUB-BUILDER:
 MODEL: HIGHGROVE 2 ELEVATION: 3 (REV)-UNIT3

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	2	J83 JACK-OPEN	6.50 0.00	01-10-08	01-07-01	2 X 4	2 X 4	01-03-08 -00-01-01	00-07-07 00-03-08	13.84 9.34		
	5	J93 MONOPITCH	4.00 0.00	08-05-00	02-05-10	2 X 4	2 X 4	01-03-08 00-00-00	00-03-15 02-05-10	90.80 58.35		
	7	J110 JACK-OPEN	10.00 0.00	01-08-08	04-00-12	2 X 4	2 X 4	01-03-08 00-00-00	02-07-11 04-00-12	64.40 46.69		

TOTAL # TRUSS= 49


TOTAL BFT OF ALL TRUSSES=

2023.51 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3180.22 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
10	Hangers	LJS26DS	
1	Hangers	HGUS26-2	

TOTAL # ITEMS= 11

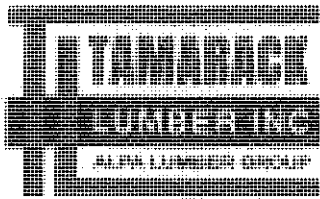

Delivery Shiplist


DATE	06/26/18
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285494 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH SUB-BUILDER:
 MODEL: HIGHGROVE2 ELEVATION: 3-UNIT4 OR 3-UNIT 3,4

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	3	T24 COMMON	6.00 0.00	31-00-00	08-11-00	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	364.65 229.50		
	9	T90TCX MONOPITCH	3.00 0.00	10-04-00	03-05-09	2 X 6	2 X 4	00-09-08 00-00-00	00-08-04 03-05-09	404.91 272.97		
	2	G90 MONOPITCH	3.00 0.00	10-04-00	03-03-04	2 X 6	2 X 4	00-09-08 00-00-00	00-08-04 03-03-04	81.80 53.34		
	2	T92 COMMON	6.50 0.00	06-03-00	02-03-12	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	43.08 30.00		
	1	T92Z4 COMMON	6.50 0.00	06-03-00	02-03-12	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	21.54 15.00		
	1	T620Z HIP GIRDER	6.00 0.00	36-04-00	05-03-13	2 X 4	2 X 6	01-03-08 01-03-08	01-02-00 01-02-00	213.66 131.66		
	1	T630 HIP	6.00 0.00	36-04-00	06-07-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	146.04 92.83		
	1	T640 HIP	6.00 0.00	36-04-00	07-11-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	148.64 93.00		
	1	T650 HIP	6.00 0.00	36-04-00	09-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	156.18 98.00		
	2	T660 COMMON	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	293.96 180.00		
	1	T670S ROOF	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	161.65 100.67		
	1	T680S ROOF	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	173.83 108.67		
	1	T690S ROOF	6.00 0.00	36-04-00	10-01-13	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	178.48 109.83		
	1	T700 ROOF	6.00 0.00	36-04-00	11-03-02	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	188.58 116.33		
	1 3 Ply	T720 HALF HIP	8.00 0.00	13-11-00	04-00-12	2 X 4	2 X 6	00-00-00 00-00-00	02-04-13 00-00-04	247.65 161.01		
	2	J10 JACK-OPEN	8.00 0.00	05-10-08	05-03-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 00-05-03	35.66 21.34		
	1	J81 JACK-OPEN	6.50 0.00	03-01-08	02-03-12	2 X 4	2 X 4	01-03-08 00-00-00	00-07-07 02-03-12	10.08 7.33		
	2	J82 JACK-OPEN	6.50 0.00	03-01-08	01-07-01	2 X 4	2 X 4	01-03-08 -01-04-01	00-07-07 00-03-08	16.70 12.00		

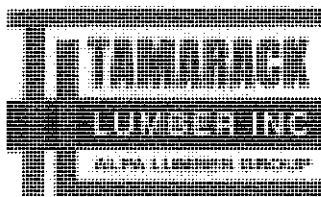

Delivery Shiplist

DATE	06/26/18
SALES REP	Mario

JOB TRACK:43954	LAYOUT ID: 285494	LOCATION:
BUILDER: GREENPARK - RUSSELL GARDENS PH	SUB-BUILDER:	
MODEL: HIGHGROVE2	ELEVATION: 3-UNIT4 OR 3-UNIT 3,4	

ROOF TRUSSES

ROOF TRUSS SPACING:24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	2	J83 JACK-OPEN	6.50 0.00	01-10-08	01-07-01	2 X 4	2 X 4	01-03-08 -00-01-01	00-07-07 00-03-08	13.84 9.34		
	5	J93 MONOPITCH	4.00 0.00	06-05-00	02-05-10	2 X 4	2 X 4	01-03-08 00-00-00	00-03-15 02-05-10	90.80 58.35		
	7	J110 JACK-OPEN	10.00 0.00	01-08-08	04-00-12	2 X 4	2 X 4	01-03-08 00-00-00	02-07-11 04-00-12	64.40 46.69		

TOTAL # TRUSS= 49


TOTAL BFT OF ALL TRUSSES=

1947.86 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3056.13 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
10	Hangers	LJS26DS	
1	Hangers	HGUS26-2	

TOTAL # ITEMS= 11

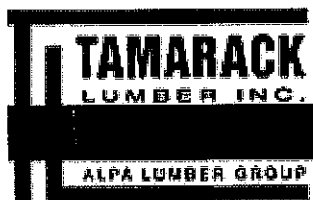

Delivery Shiplist


DATE	09/01/17
SALES REP	Mario

JOB TRACK:43954 LAYOUT ID: 285495 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH 2 SUB-BUILDER:
 MODEL: HIGHGROVE3 ELEVATION: 3- UNIT5 OR UNIT6

ROOF TRUSSES

ROOF TRUSS SPACING:24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	7	T24 COMMON	6.00 0.00	31-00-00	08-11-00	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	850.85 535.50		
	1	T73S ROOF	6.00 0.00	31-00-00	06-01-02	2 X 4	2 X 4	00-00-00 00-00-00	05-02-08 04-11-08	141.76 90.33		
	1	T74S ROOF	6.00 0.00	31-00-00	07-05-02	2 X 4	2 X 4	00-00-00 00-00-00	06-06-08 04-11-08	158.68 99.33		
	1	T75S ROOF	6.00 0.00	31-00-00	08-09-02	2 X 4	2 X 4	00-00-00 00-00-00	06-11-00 04-11-08	170.86 111.00		
	1	T76 ROOF	6.00 0.00	31-00-00	09-02-08	2 X 4	2 X 4	00-00-00 00-00-00	06-11-00 04-11-08	168.45 104.67		
	1	T77 ROOF	6.00 0.00	31-00-00	10-06-08	2 X 4	2 X 4	00-00-00 00-00-00	06-11-00 04-11-08	184.15 115.33		
	1	T78 ROOF	6.00 0.00	31-00-00	11-03-13	2 X 4	2 X 4	00-00-00 00-00-00	06-11-00 04-11-08	185.48 114.00		
	1	T100S ROOF	8.00 0.00	17-01-08	06-01-04	2 X 4	2 X 6	01-03-08 00-00-00	01-04-13 06-01-04	101.23 63.67		
	1 3 Ply	T101 HALF HIP	8.00 0.00	17-01-08	04-08-08	2 X 6	2 X 6	00-00-00 00-00-00	01-04-13 04-08-08	323.49 201.99		
	1	T30 HALF HIP	8.00 0.00	15-09-08	04-01-04	2 X 4	2 X 6	01-03-08 00-00-00	01-04-13 04-01-04	77.31 47.50		
	1	T31 HALF HIP	8.00 0.00	15-09-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 05-01-04	67.94 43.00		
	1	T32 HALF HIP	8.00 0.00	15-09-08	06-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 06-01-04	74.63 46.67		
	1 3 Ply	T33Z4 HALF HIP	8.00 0.00	15-09-08	06-08-12	2 X 6	2 X 6	00-00-00 00-00-00	01-04-13 06-08-12	341.19 201.00		
	1	T102 HALF HIP	10.00 0.00	02-11-08	02-01-08	2 X 4	2 X 4	01-03-08 00-00-00	01-07-11 04-01-08	17.90 12.50		
	1	T103 HALF HIP	10.00 0.00	02-11-08	03-05-08	2 X 4	2 X 4	01-03-08 00-00-00	01-07-11 05-05-08	21.03 14.33		
	2	T104 MONO TRUSS	10.00 0.00	02-11-08	04-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-07-11 06-01-04	39.42 25.66		
	2	T93 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	44.40 30.00		
	1	T93Z COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	22.20 15.00		

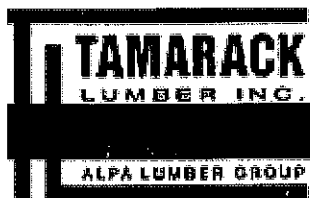



Delivery Shiplist

DATE	09/01/17
SALES REP	Mario

JOB TRACK:43954 LAYOUT ID: 285495 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH2 SUB-BUILDER:
 MODEL: HIGHGROVE3 ELEVATION: 3- UNIT5 OR UNIT6

ROOF TRUSSES

ROOF TRUSS SPACING:24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	8	J1 JACK-OPEN	6.00 0.00	05-10-08	04-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-01-04	134.32 85.36		
	5	J12 JACK	8.00 0.00	02-11-08	03-04-08	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 03-04-08	52.55 33.35		
	3	J80 JACK-OPEN	8.00 0.00	02-04-04	02-04-07	2 X 4	2 X 4	01-03-08 00-00-00	00-09-10 02-04-07	24.93 18.00		
	5	J93 MONOPITCH	4.00 0.00	06-05-00	02-05-10	2 X 4	2 X 4	01-03-08 00-00-00	00-03-15 02-05-10	90.80 58.35		
	4	J99 MONOPITCH	4.00 0.00	05-09-00	02-02-15	2 X 4	2 X 4	01-03-08 00-00-00	00-03-15 02-02-15	60.52 37.32		

TOTAL # TRUSS= 55.00

TOTAL BFT OF ALL TRUSSES=

2103.86 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3354.09 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
4	Hangers	LUS24	
17	Hangers	LJS26DS	

TOTAL # ITEMS= 21.00



Delivery Shiplist

DATE	04/18/18
SALES REP	Mario

JOB TRACK: 43954	LAYOUT ID: 285497	LOCATION:
BUILDER: GREENPARK - RUSSELL GARDENS PH2	SUB-BUILDER:	
MODEL: HIGHGROVE 5E	ELEVATION: 3B (REV)--UNIT7	

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	1	T1A COMMON	8.00 0.00	24-03-08	09-06-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	102.41 64.00		
	1	T2 HIP GIRDER	8.00 0.00	24-06-00	04-01-04	2 X 6	2 X 6	01-03-08 01-01-00	01-04-13 01-04-13	145.59 89.67		
	1	T2A4 HIP GIRDER	8.00 0.00	24-03-08	04-01-04	2 X 6	2 X 6	01-03-08 00-00-00	01-04-13 01-06-08	142.48 87.67		
	1	T3 HIP	8.00 0.00	24-06-00	05-01-04	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	97.09 60.83		
	1	T3A HIP	8.00 0.00	24-03-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	94.81 60.17		
	1	T4 HIP	8.00 0.00	24-06-00	06-01-04	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	105.79 67.00		
	1	T4A HIP	8.00 0.00	24-03-08	06-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	103.53 66.33		
	1	T5A HIP	8.00 0.00	24-03-08	07-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	104.32 67.00		
	1	T6A HIP	8.00 0.00	24-03-08	08-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	108.82 69.50		
	1	T7A HIP	8.00 0.00	24-03-08	09-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	114.67 72.50		
	2	T9 HALF HIP	8.00 0.00	24-03-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 05-01-04	197.10 123.66		
	2	T10 HALF HIP	8.00 0.00	24-03-08	06-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 06-01-04	212.66 133.34		
	2	T11 HALF HIP	8.00 0.00	24-03-08	07-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 07-01-04	225.56 142.68		
	3	T12 HALF HIP	8.00 0.00	24-03-08	08-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 08-01-04	351.96 219.51		
	2	T15 COMMON	8.00 0.00	15-08-00	06-07-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	133.52 84.00		
	1	G15 COMMON	8.00 0.00	15-08-00	06-07-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	69.72 45.00		
	2	T14 COMMON	8.00 0.00	14-04-00	06-02-02	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	123.52 78.00		
	1	T570 HIP GIRDER	8.00 0.00	14-04-00	03-11-13	2 X 4	2 X 6	01-03-08 01-03-08	01-04-13 01-04-13	70.63 46.34		



Delivery Shiplist

DATE	04/18/18
SALES REP	Mario

JOB TRACK:43954 LAYOUT ID: 285497 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH2 SUB-BUILDER:
 MODEL: HIGHGROVE 5E ELEVATION: 3B (REV)--UNIT7

ROOF TRUSSES

ROOF TRUSS SPACING:24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	1	T580 HIP	8.00 0.00	14-04-00	05-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	62.73 39.33		
	2	T590 ROOF	8.00 8.00	08-08-00	04-03-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	82.28 56.00		
	1	T600 COMMON	8.00 0.00	08-08-00	04-03-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	37.48 23.67		
	3	T91 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	66.60 45.00		
	1	G91 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	23.39 16.00		
	8	J1 JACK-OPEN	6.00 0.00	05-10-08	04-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-01-04	134.32 85.36		
	1	J8 JACK-OPEN	8.00 0.00	03-10-08	03-11-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 03-11-13	12.81 8.00		
	1	J20 JACK-OPEN	8.00 0.00	01-10-08	02-07-02	2 X 4	2 X 4	01-03-08 -00-01-01	01-04-13 00-03-08	9.17 5.67		
	1	J21 JACK-OPEN	8.00 0.00	03-10-08	02-07-02	2 X 4	2 X 4	01-03-08 -02-01-01	01-04-13 00-03-08	12.97 8.00		
	4	J90 JACK	4.50 0.00	05-05-00	02-05-00	2 X 4	2 X 4	01-03-08 00-00-00	00-04-10 02-05-00	57.88 37.32		

TOTAL # TRUSS= 48.00


TOTAL BFT OF ALL TRUSSES=

1901.55 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3003.81 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
3	Hangers	HGUS26-2	
5	Hangers	LJS26DS	
2	Hangers	LUS24	

TOTAL # ITEMS= 10.00

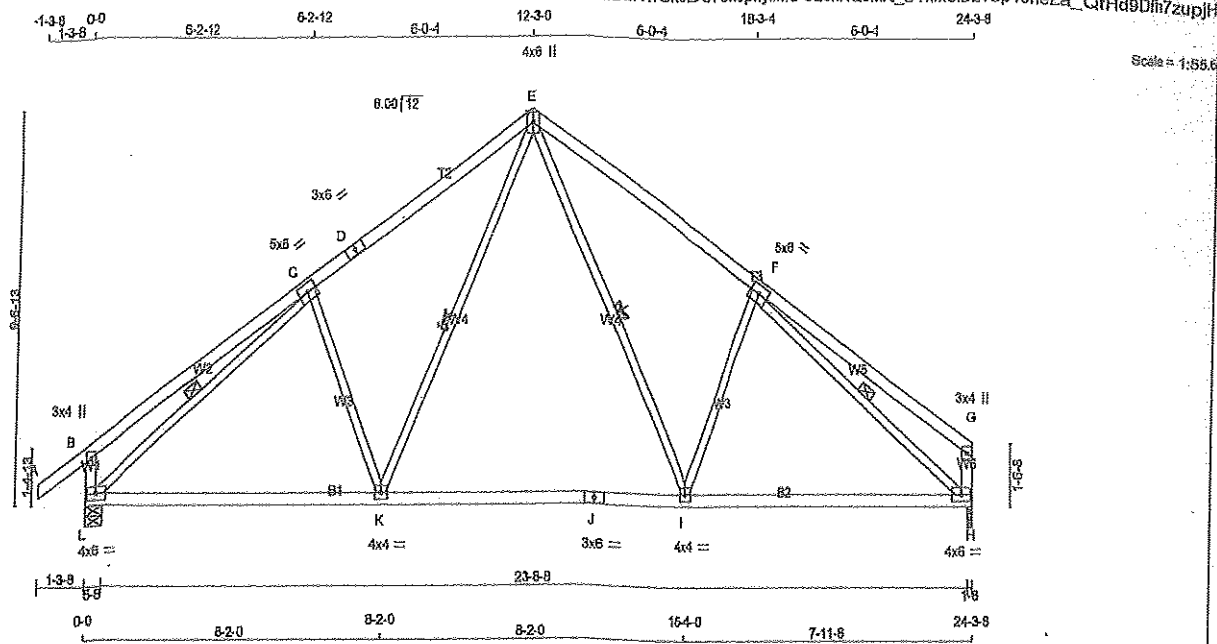

TOTAL WEIGHT = 102 lb

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
L - B	2x4	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
	VERT	HORIZ	DOWN	UP
JT	1479	0	1479	0
H	1383	0	1383	0

UNFACTORED REACTIONS

	1ST CASE	MAX MIN. COMPONENT REACTIONS
	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
L	1188	692 / 0 255 / 0 0 / 0 0 / 0 281 / 0 0 / 0
H	1119	621 / 0 255 / 0 0 / 0 0 / 0 243 / 0 0 / 0

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF

BOT CH. LL = 10.5 PSF
DL = 7.0 PSF

TOTAL LOAD = 49.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF ORC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.81")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.17")
ALLOWABLE DEFL.(TL) = $L/360$ (0.81")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.29")

CSI: TC=0.52/1.00 (B-C:1), GC=0.59/1.00 (K-L:2),
WB=0.71/1.00 (C-L:1), SSI=0.21/1.00 (C-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1667	822
	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (L) (INPUT = 0.90)
JSI METAL= 0.43 (C) (INPUT = 1.00)

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMWW-I	MT20	5.0	8.0		
D TS-I	MT20	3.0	8.0		
E TTWW+p	MT20	4.0	6.0	Edge	
F TMWW-I	MT20	5.0	6.0		
G TMV+p	MT20	3.0	4.0		
H BMWW-I	MT20	4.0	6.0		
I BMWW-I	MT20	4.0	4.0		
J BS-I	MT20	3.0	6.0		
K BMWW-I	MT20	4.0	4.0		
L BMWW-I	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF CL, F-H. *E-K, E-J*

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)


CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC	LC1 MAX	
FR-TO		FROM TO		LENGTH	FR-TO				
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	C-K	-352 / 44	0.19 (1)	
B-C	0 / 34	-84.3	-84.3	0.52 (1)	10.00	K-E	0 / 632	0.14 (1)	
C-D	-1409 / 0	-84.3	-84.3	0.45 (1)	4.98	E-I	0 / 589	0.13 (1)	
D-E	-1409 / 0	-84.3	-84.3	0.45 (1)	4.98	I-F	-316 / 59	0.17 (1)	
E-F	-1388 / 0	-84.3	-84.3	0.44 (1)	5.01	L-C	-1069 / 0	0.71 (1)	
F-G	0 / 34	-84.3	-84.3	0.50 (1)	10.00	F-H	-1653 / 0	0.67 (1)	
L-B	-311 / 0	0.0	0.0	0.03 (1)	7.81				
H-G	-186 / 0	0.0	0.0	0.02 (1)	7.81				
L-K	0 / 1275	-28.0	-28.0	0.58 (2)	10.00				
K-J	0 / 889	-28.0	-28.0	0.54 (2)	10.00				
J-I	0 / 889	-28.0	-28.0	0.54 (2)	10.00				
I-H	0 / 1245	-28.0	-28.0	0.58 (2)	10.00				



DRWG NO. TAM3984-18
STRUCTURAL
COMPONENT ONLY



DWG NO. TAM 21173 -18
STRUCTURAL
COMPONENT ONLY

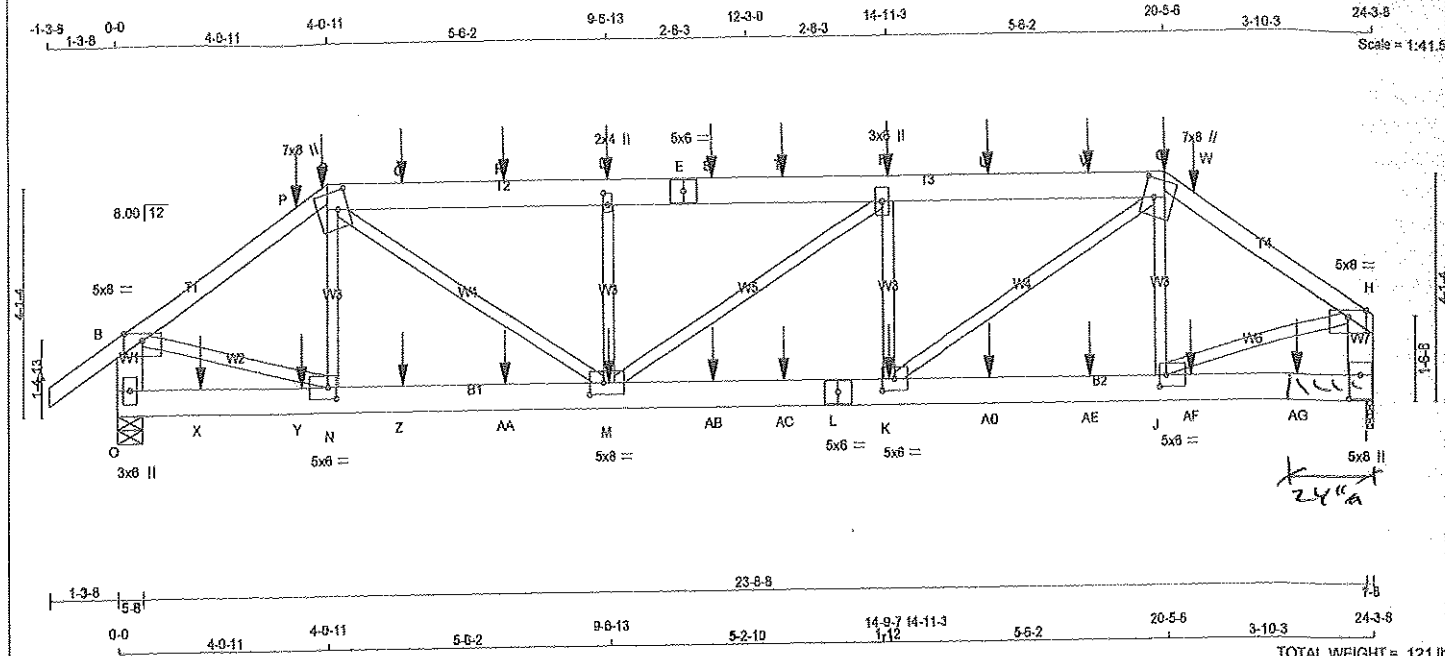

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - E	2x8	DRY	No.2	SPF
E - G	2x8	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
O - B	2x8	DRY	No.2	SPF
I - H	2x6	DRY	No.2	SPF
O - L	2x6	DRY	No.2	SPF
L - I	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWV-p	MT20	5.0	8.0 Edge
C	TTWW+m	MT20	7.0	8.0 4.00 2.50
D	TMW+m	MT20	2.0	4.0 2.50 1.00
E	TS-I	MT20	5.0	6.0
F	TMWVH	MT20	3.0	6.0
G	TTWW+m	MT20	7.0	8.0 4.00 2.50
H	TMWV-p	MT20	5.0	8.0 Edge
I	BMV1+p	MT20	5.0	8.0 5.25 2.50
J	BMWV-I	MT20	5.0	6.0 2.50 1.50
K	BMWV-I	MT20	5.0	6.0 2.50 2.75
L	BS-I	MT20	5.0	6.0
M	BMWVW-I	MT20	5.0	8.0 2.50 3.25
N	BMWV-I	MT20	5.0	6.0 2.50 2.00
O	BMV1+p	MT20	3.0	6.0

Edge - INDICATES REFERENCE CORNER OF FLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 122.8 lbs FACTORED DOWN AT 3-6-12, 101.4 lbs FACTORED DOWN AT 5-6-12, 101.4 lbs FACTORED DOWN AT 7-6-12, 101.4 lbs FACTORED DOWN AT 9-6-12, 101.4 lbs FACTORED DOWN AT 11-6-12, 101.4 lbs FACTORED DOWN AT 12-11-4, 101.4 lbs FACTORED DOWN AT 14-11-4, 101.4 lbs FACTORED DOWN AT 16-11-4, 101.4 lbs FACTORED DOWN AT 18-11-4, 122.8 lbs FACTORED DOWN AT 20-11-4, AND 244.5 lbs FACTORED DOWN AT 4-0-11, AND 244.5 lbs FACTORED DOWN AT 20-5-6 ON TOP CHORD, AND 69.9 lbs FACTORED DOWN AT 1-8-12, 69.9 lbs FACTORED DOWN AT 3-6-12, 69.9 lbs FACTORED DOWN AT 5-6-12, 69.9 lbs FACTORED DOWN AT 7-6-12, 69.9 lbs FACTORED DOWN AT 9-6-12, 69.9 lbs FACTORED DOWN AT 11-6-12, 69.9 lbs FACTORED DOWN AT 12-11-4, 69.9 lbs FACTORED DOWN AT 14-11-4, 69.9 lbs FACTORED DOWN AT 16-11-4, 69.9 lbs FACTORED DOWN AT 18-11-4, AND 69.9 lbs FACTORED DOWN AT 20-11-4, AND 69.9 lbs FACTORED DOWN AT 22-11-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS				
	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
O	2483	0	2483	0
I	2385	0	2385	0

UNFACTORED REACTIONS				
	1ST CASE	MAX. MIN. COMPONENT REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM.LIVE
O	2015	1157 / 0	433 / 0	0 / 0
I	1951	1094 / 0	426 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.66 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED CS1 (LC)	MAX. FACTORED CS1 (LC)	MEMB.	FORCE (LBS)	MAX. FACTORED CS1 (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0/32	-84.3 -84.3	0.12 (1)	10.00	N-C	-300 / 167	0.07 (1)		
B-P	-2793 / 0	-84.3 -84.3	0.47 (1)	3.68	C-M	0 / 1912	0.47 (1)		
P-C	-2793 / 0	-84.3 -84.3	0.47 (1)	3.66	M-D	-625 / 0	0.20 (1)		
C-Q	-3935 / 0	-84.3 -84.3	0.38 (1)	3.97	K-F	-848 / 0	0.20 (1)		
Q-R	-3935 / 0	-84.3 -84.3	0.38 (1)	3.97	K-G	0 / 1995	0.49 (1)		
R-D	-3935 / 0	-84.3 -84.3	0.38 (1)	3.97	J-N	-392 / 118	0.09 (1)		
D-E	-3935 / 0	-84.3 -84.3	0.35 (1)	4.01	B-G	0 / 2419	0.60 (1)		
E-S	-3935 / 0	-84.3 -84.3	0.35 (1)	4.01	J-H	0 / 2356	0.58 (1)		
S-T	-3935 / 0	-84.3 -84.3	0.35 (1)	4.01	M-F	0 / 26	0.01 (1)		
T-F	-3035 / 0	-84.3 -84.3	0.35 (1)	4.01					
F-U	-3914 / 0	-84.3 -84.3	0.37 (1)	3.99					
U-V	-3914 / 0	-84.3 -84.3	0.37 (1)	3.99					
V-G	-3914 / 0	-84.3 -84.3	0.37 (1)	3.99					
G-W	-2687 / 0	-84.3 -84.3	0.43 (1)	3.78					
W-H	-2687 / 0	-84.3 -84.3	0.43 (1)	3.78					
O-B	-2418 / 0	0.0	0.0	17 (1)	8.59				
I-H	-2322 / 0	0.0	0.0	17 (1)	6.70				

O-X	0 / 0	-28.0	-28.0	0.13 (3)	10.00
X-Y	0 / 0	-28.0	-28.0	0.13 (3)	10.00
Y-N	0 / 0	-28.0	-28.0	0.13 (3)	10.00
N-Z	0 / 2344	-28.0	-28.0	0.39 (1)	10.00
Z-AA	0 / 2344	-28.0	-28.0	0.39 (1)	10.00
AA-M	0 / 2344	-28.0	-28.0	0.35 (1)	10.00
M-AB	0 / 3913	-28.0	-28.0	0.62 (1)	10.00
AB-AC	0 / 3913	-28.0	-28.0	0.62 (1)	10.00
AC-L	0 / 3913	-28.0	-28.0	0.62 (1)	10.00
L-K	0 / 3913	-28.0	-28.0	0.62 (1)	10.00
K-AD	0 / 2253	-28.0	-28.0	0.37 (1)	10.00
AD-AE	0 / 2253	-28.0	-28.0	0.37 (1)	10.00
AE-J	0 / 2253	-28.0	-28.0	0.37 (1)	10.00
J-AF	0 / 0	-28.0	-28.0	0.13 (3)	10.00
AF-AG	0 / 0	-28.0	-28.0	0.13 (3)	10.00
AG-I	0 / 0	-28.0	-28.0	0.13 (3)	10.00

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:		
TOP CH. LL	=	25.6 PSF
DL	=	3.0 PSF
BOT CH. LL	=	10.5 PSF
DL	=	7.0 PSF
TOTAL LOAD	=	46.1 PSF

SPACING = 24.0 IN. C/C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC0 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 5.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.81")
CALCULATED VERT. DEFL.(LL)= L/999 (0.15")
ALLOWABLE DEFL.(TL)= L/360 (0.81")
CALCULATED VERT. DEFL.(TL)= L/999 (0.24")

CSI: TC=0.47/1.00 (B-C:1), EC=0.62/1.00 (K-M:1), WB=0.60/1.00 (B-N:1), SSI=0.25/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BENT=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PS)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	616	354	1667	622	2284

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

DWG NO. TAM B092-08
STRUCTURAL
COMPONENT ONLY

CONTINUED ON PAGE 12

JOB NAME 285349	TRUSS NAME T2A	QUANTITY 1	PLY 1	JOB DESC. TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------	----------

Version 8.200 S Dec 12 2017 M/Tek Industries, Inc. Tue Feb 6 11:30:42 2018 Page 2
 ID:w3K2IB2K4fGk9ID07SkJphylMC-wH0RdyVdLxh4LcOJO8nFCZcgG8QBBsci7NHYbznu5B

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	4-0-11	-23	-25	—	FRONT	VERT	DEAD
C	4-0-11	-222	-222	—	FRONT	VERT	SNOW
D	9-6-12	-101	-101	—	BACK	VERT	TOTAL
F	14-11-4	-101	-101	—	BACK	VERT	TOTAL
G	20-5-6	-23	-25	—	FRONT	VERT	DEAD
G	20-5-6	-222	-222	—	FRONT	VERT	SNOW
K	14-11-4	-40	-70	—	BACK	VERT	TOTAL
M	9-6-12	-40	-70	—	BACK	VERT	TOTAL
P	3-6-12	-123	-123	—	BACK	VERT	TOTAL
Q	5-6-12	-101	-101	—	BACK	VERT	TOTAL
R	7-6-12	-101	-101	—	BACK	VERT	TOTAL
S	11-6-12	-101	-101	—	BACK	VERT	TOTAL
T	12-11-4	-101	-101	—	BACK	VERT	TOTAL
U	16-11-4	-101	-101	—	BACK	VERT	TOTAL
V	18-11-4	-101	-101	—	BACK	VERT	TOTAL
W	20-11-4	-123	-123	—	BACK	VERT	TOTAL
X	1-6-12	-40	-70	—	BACK	VERT	TOTAL
Y	3-6-12	-40	-70	—	BACK	VERT	TOTAL
Z	5-6-12	-40	-70	—	BACK	VERT	TOTAL
AA	7-6-12	-40	-70	—	BACK	VERT	TOTAL
AB	11-6-12	-40	-70	—	BACK	VERT	TOTAL
AC	12-11-4	-40	-70	—	BACK	VERT	TOTAL
AD	16-11-4	-40	-70	—	BACK	VERT	TOTAL
AE	18-11-4	-40	-70	—	BACK	VERT	TOTAL
AF	20-11-4	-40	-70	—	BACK	VERT	TOTAL
AG	22-11-4	-40	-70	—	BACK	VERT	TOTAL

JSI GRIP= 0.90 (N) (INPUT = 0.90)
 JSI METAL= 0.63 (L) (INPUT = 1.00)

SCAB JOINT # I-8 WITH 2 X 6 X 12
 SPF 24" LONG 1 SIDE(S) USING 2
 ROW(S) 3/4" ARDOX SPIRAL SCAB JOINT WIRE
 NAILS AT 3" O/C STAGGERED (15 NAILS/SCAB).
 REQUIRED FOR 1/2" DRG PROVISION.




DWG NO. TAM BO92-08
 STRUCTURAL
 COMPONENT ONLY

Tamarack Roof Truss, Burlington

Version 8.200.5 Dec 12 2017 Mitek Industries, Inc. Tue Jan 16 11:14:25 2018 Page 1

ID: w3K2IB2K4fGk9tD07SkJphyfMC-1YM1oWnNAUjb7pXSqHY9kuabRmWUJn0r?Sne?S5zup1S

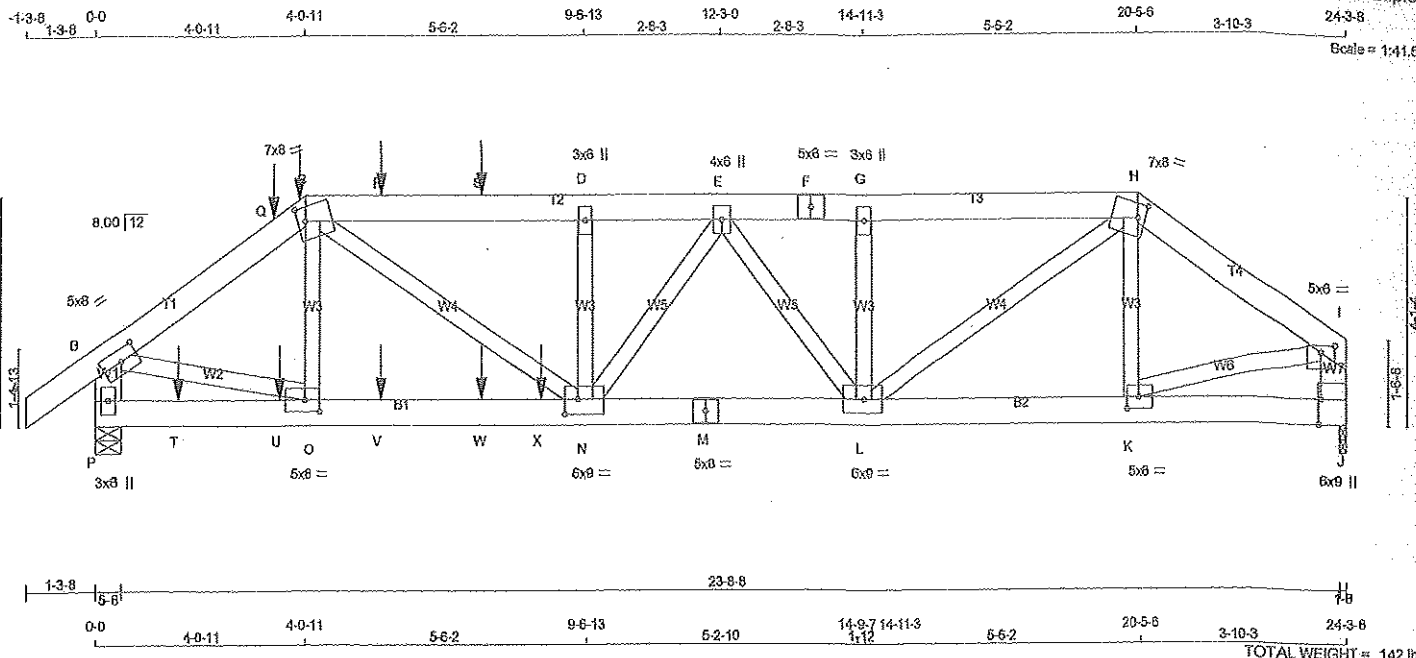


JOB NAME 285481	TRUSS NAME T3	QUANTITY 1	PLY 1	JOB DESC. TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	--------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Fri Sep 01 17:31:50 2017 Page 1

ID:W3K21B2K4fGk9tDO7SkJphylfMC-LmCzTSEh8mrbXYzL9GnEKDJ5xyJkg8wmAnPslQyhxt

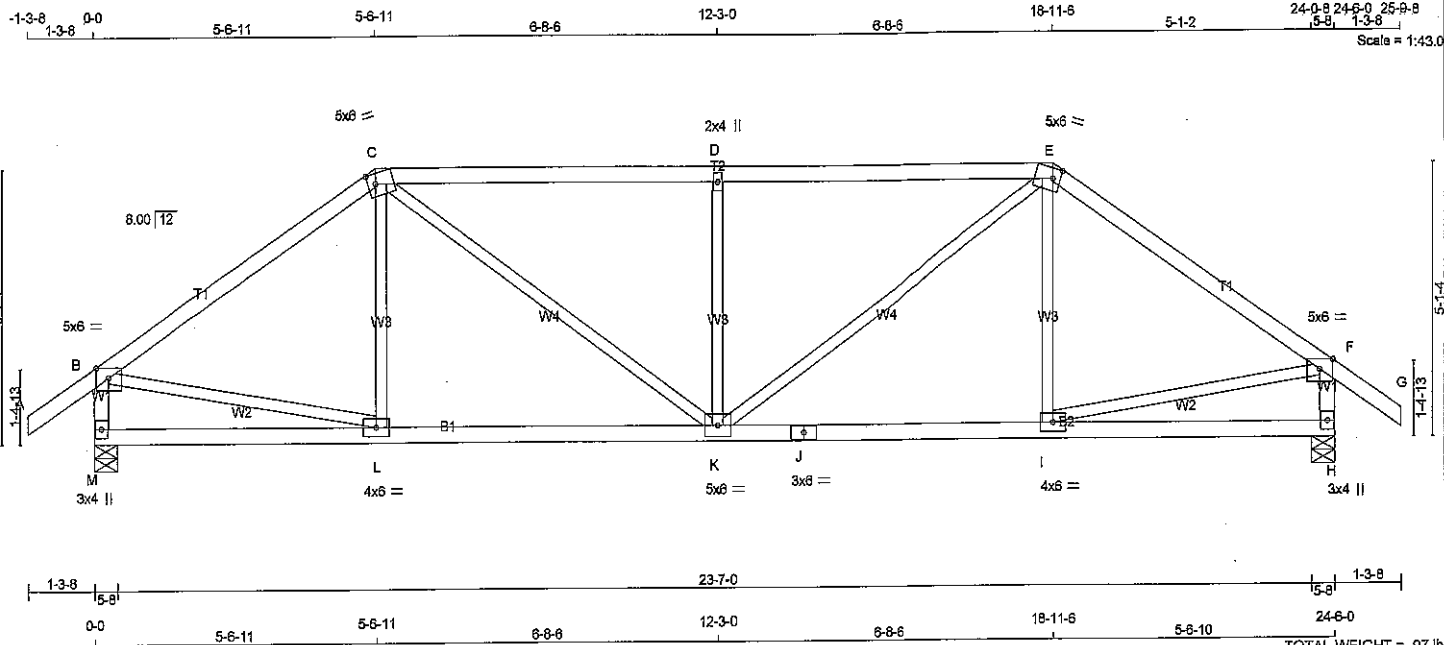

TOTAL WEIGHT = 97 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TTWW-m	MT20	5.0	6.0	2.25	1.75
D	TMVW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	2.25	1.75
F	TMVW-p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-w	MT20	5.0	6.0		
L	BMVW-t	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
M	1491	0	1491	0
H	1491	0	1491	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
M	1208	897 / 0	257 / 0	0 / 0	0 / 0	253 / 0	0 / 0
H	1208	897 / 0	257 / 0	0 / 0	0 / 0	253 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	UNBRACED LENGTH
FR-TO		FROM	TO	FR-TO			
A-B	0 / 32	-84.3	-84.3 0.11 (1)	10.00	L-C	-47 / 210	0.05 (3)
B-C	-1511 / 0	-84.3	-84.3 0.55 (1)	4.67	C-K	0 / 747	0.17 (1)
C-D	-1862 / 0	-84.3	-84.3 0.80 (1)	3.85	K-D	-892 / 0	0.27 (1)
D-E	-1862 / 0	-84.3	-84.3 0.80 (1)	3.85	K-E	0 / 747	0.17 (1)
E-F	-1511 / 0	-84.3	-84.3 0.55 (1)	4.67	I-E	-47 / 210	0.05 (3)
F-G	0 / 32	-84.3	-84.3 0.11 (1)	10.00	B-L	0 / 1278	0.29 (1)
M-B	-1430 / 0	0.0	0.0 0.15 (1)	6.83	I-F	0 / 1278	0.29 (1)
H-F	-1430 / 0	0.0	0.0 0.15 (1)	6.83			
M-L	0 / 0	-28.0	-28.0 0.25 (3)	10.00			
L-K	0 / 1255	-28.0	-28.0 0.40 (2)	10.00			
K-J	0 / 1255	-28.0	-28.0 0.40 (2)	10.00			
J-I	0 / 1255	-28.0	-28.0 0.40 (2)	10.00			
I-H	0 / 0	-28.0	-28.0 0.25 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	46.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.82")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (0.82")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.80 (C-D:1), BC=0.40 (K-L:2), WB=0.29 (B-L:1), SSI=0.27 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

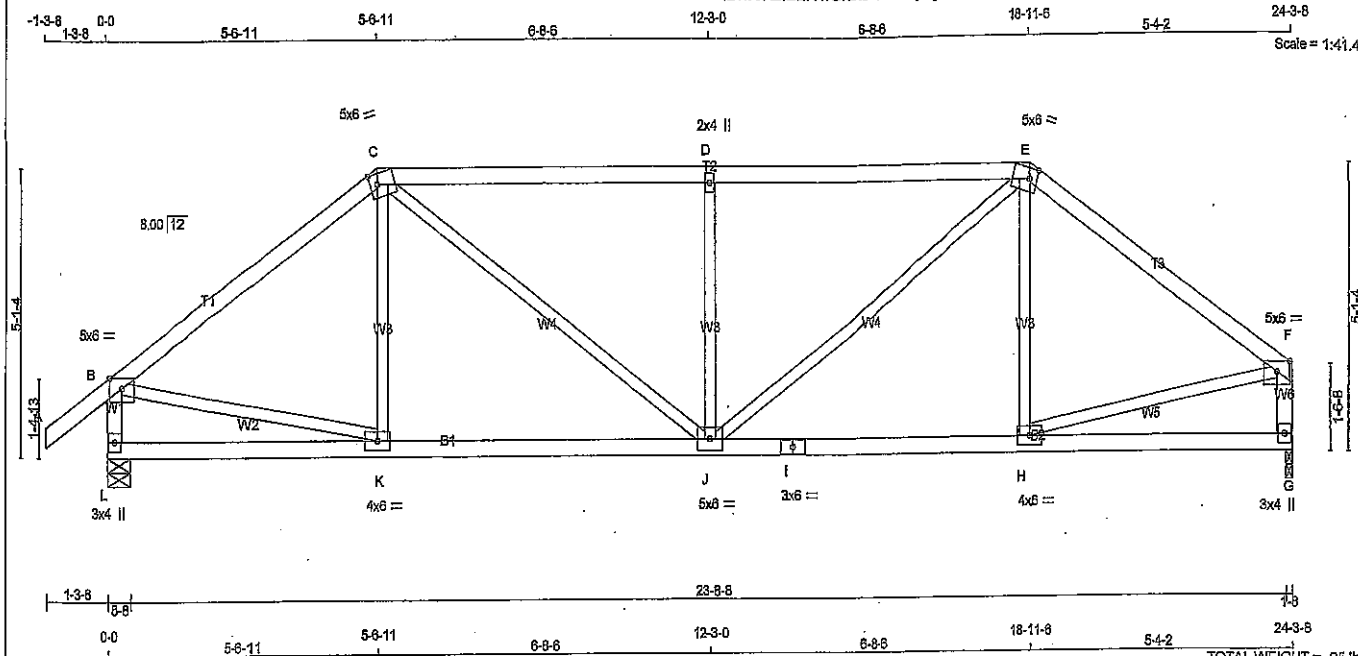
PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (L) (INPUT = 0.90)
JSI METAL= 0.37 (J) (INPUT = 1.00)



DWG NO. TAW4523-17
STRUCTURAL
COMPONENT ONLY

**LUMBER****N. L. G. A. RULES**

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
L - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
L - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TTWW-m	MT20	5.0	8.0	2.25	1.75
D	TMW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	2.25	1.75
F	TMVW-p	MT20	5.0	8.0	Edge	
G	BMV1-p	MT20	3.0	4.0		
H	BMWW-t	MT20	4.0	6.0		
I	BS-t	MT20	3.0	6.0		
J	BMWW-t	MT20	5.0	8.0		
K	BMWW-t	MT20	4.0	6.0		
L	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY**BUILDING DESIGNER****BEARINGS**

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
L	1479	0	1479	0
G	1363	0	1363	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	1198	692/0	255/0	0/0	0/0	251/0	0/0	0/0
G	1119	621/0	255/0	0/0	0/0	243/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, G

BRACINGTOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FACTORED	VERT. LOAD	MAX	MEMB.	FACTORED	VERT. LOAD	MAX
	(LBS)	(PLF)	CSI (LC)		(LBS)	(PLF)	CSI (LC)
FR-TO				FR-TO			
A-B	0/32	-84.3	-84.3 0.11 (1)	10.00	K-C	-45/211	0.05 (3)
B-C	-1495/0	-84.3	-84.3 0.55 (1)	4.69	C-J	0/728	0.16 (1)
C-D	-1833/0	-84.3	-84.3 0.80 (1)	3.88	J-D	-692/0	0.27 (1)
D-E	-1833/0	-84.3	-84.3 0.80 (1)	3.88	E-F	0/769	0.17 (1)
E-F	-1456/0	-84.3	-84.3 0.50 (1)	4.81	H-E	-91/187	0.04 (3)
L-B	-1418/0	0.0	0.0 0.15 (1)	6.85	B-K	0/1265	0.28 (1)
G-F	-1305/0	0.0	0.0 0.14 (1)	7.08	H-F	0/1239	0.28 (1)
L-K	0/0	-28.0	-28.0 0.25 (3)	10.00			
K-J	0/1241	-28.0	-28.0 0.40 (2)	10.00			
J-I	0/1208	-28.0	-28.0 0.39 (2)	10.00			
I-H	0/1208	-28.0	-28.0 0.39 (2)	10.00			
H-G	0/0	-28.0	-28.0 0.24 (3)	10.00			

DESIGN CRITERIA**SPECIFIED LOADS:**

TOP CH.	LL = 25.8	PSF
DL	3.0	PSF
BOT CH.	LL = 10.5	PSF
DL	7.0	PSF
TOTAL LOAD	48.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPC 2011

(65% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")CSI: TC=0.80/1.00 (D-E:1), BC=0.40/1.00 (J-K:2),
WB=0.28/1.00 (B-K:1), SS=0.27/1.00 (C-D:1)DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1687 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 Inches


PLATE ROTATION TOL. = 5.0 Deg.

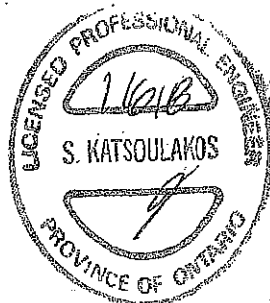JSI GRIP= 0.85 (E) (INPUT = 0.80)
JSI METAL= 0.35 (I) (INPUT = 1.00)DWG NO. TAM 4008-13
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285497	T4	1	1	TRUSS DESC.	

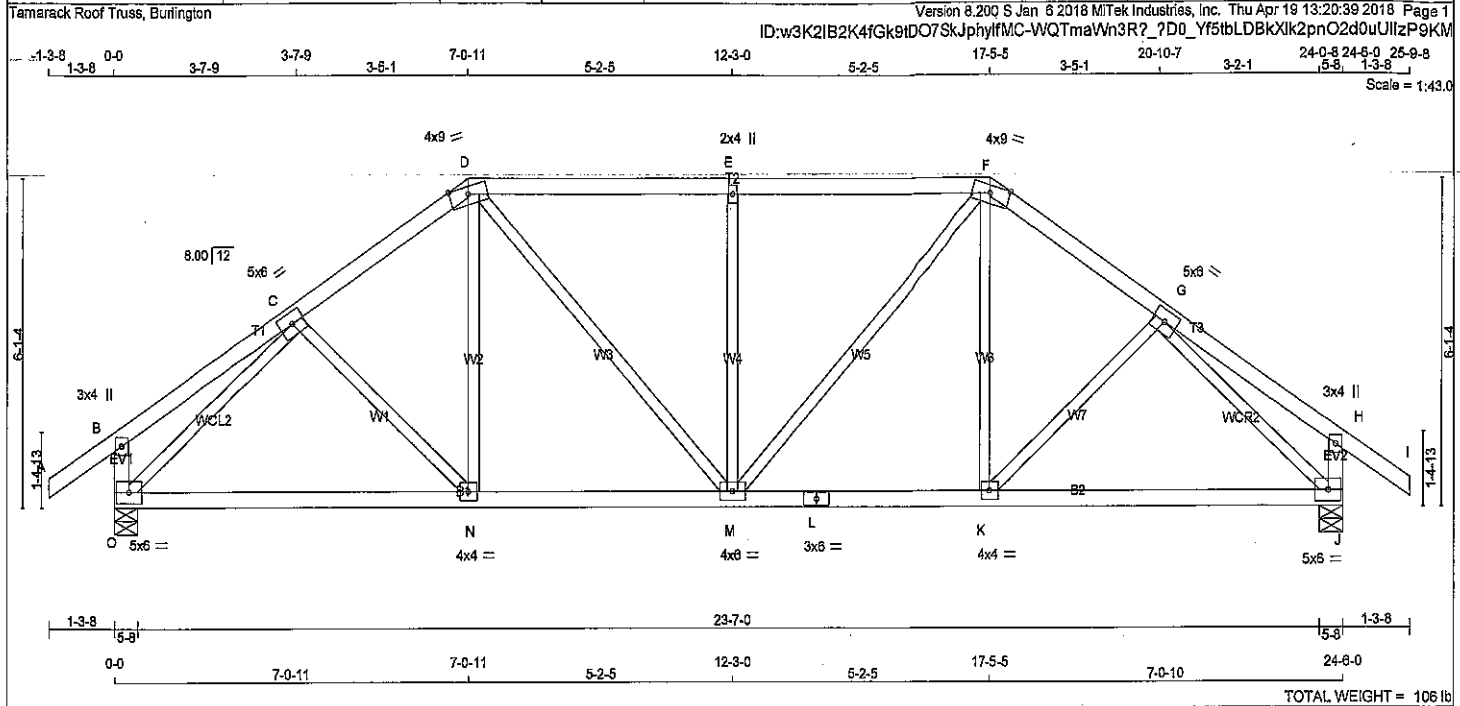

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x4 DRY No.2 SPF D - F 2x4 DRY No.2 SPF F - I 2x4 DRY No.2 SPF O - B 2x4 DRY No.2 SPF J - H 2x4 DRY No.2 SPF O - L 2x4 DRY No.2 SPF L - J 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF EXCEPT DRY: SEASONED LUMBER.				PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMV+p MT20 3.0 4.0 C TMWW-t MT20 5.0 6.0 D TTWW-m MT20 4.0 9.0 Edge E TMW+w MT20 2.0 4.0 F TTWW-m MT20 4.0 9.0 Edge G TMWW-t MT20 5.0 6.0 H TMV+p MT20 3.0 4.0 J BMVW-t MT20 5.0 6.0 K BMWW-t MT20 4.0 4.0 L BS-t MT20 3.0 6.0 M BMWW-t MT20 4.0 6.0 N BMWW-t MT20 4.0 4.0 O BMVW-t MT20 5.0 6.0 Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 3.0 PSF BOT CH. LL = 10.5 PSF DL = 7.0 PSF TOTAL LOAD = 46.1 PSF SPACING = 24.0 IN. C/C LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.82") CALCULATED VERT. DEFL.(LL) = L/999 (0.11") ALLOWABLE DEFL.(TL)= L/360 (0.82") CALCULATED VERT. DEFL.(TL) = L/999 (0.19") CSI: TC=0.32/1.00 (D-E:1), BC=0.47/1.00 (M-N:2) WB=0.65/1.00 (C-O:1), SS=0.21/1.00 (D-E:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1887 822 2284 1658 PLATE PLACEMENT TOL = 0.250 inches PLATE ROTATION TOL = 5.0 Deg. JSI GRIP= 0.88 (D) (INPUT = 0.90) JSI METAL= 0.41 (C) (INPUT = 1.00)				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT REQ'D BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX O 1491 0 1491 0 0 5-8 5-8 J 1491 0 1491 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST LCASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL O 1208 697 / 0 257 / 0 0 / 0 0 / 0 253 / 0 0 / 0 J 1208 697 / 0 257 / 0 0 / 0 0 / 0 253 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.02 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS FACTORED WEBS MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD LC1 MAX UNBRAC LENGTH FR-TO MEMB. MAX. FACTORED FORCE (LBS) MAX. FACTORED CSI (LC) FR-TO FROM TO A-B 0 / 32 -84.3 -84.3 0.11 (1) 10.00 C-N 0 / 119 0.03 (3) B-C 0 / 17 -84.3 -84.3 0.15 (1) 10.00 N-D 0 / 304 0.07 (2) C-D -1476 / 0 -84.3 -84.3 0.14 (1) 5.27 D-M 0 / 424 0.10 (1) D-E -1498 / 0 -84.3 -84.3 0.32 (1) 5.02 M-E -533 / 0 0.31 (1) E-F -1498 / 0 -84.3 -84.3 0.32 (1) 5.02 M-F 0 / 424 0.10 (1) F-G -1476 / 0 -84.3 -84.3 0.14 (1) 5.27 K-F 0 / 304 0.07 (2) G-H 0 / 17 -84.3 -84.3 0.15 (1) 10.00 K-G 0 / 119 0.03 (3) H-I 0 / 32 -84.3 -84.3 0.11 (1) 10.00 O-C -1686 / 0 0.65 (1) O-B -233 / 0 0.0 0.0 0.02 (1) 7.81 G-J -1686 / 0 0.65 (1) J-H -233 / 0 0.0 0.0 0.02 (1) 7.81 O-N 0 / 1208 -28.0 -28.0 0.45 (2) 10.00 N-M 0 / 1216 -28.0 -28.0 0.47 (2) 10.00 M-L 0 / 1216 -28.0 -28.0 0.47 (2) 10.00 L-K 0 / 1216 -28.0 -28.0 0.47 (2) 10.00 K-J 0 / 1208 -28.0 -28.0 0.45 (2) 10.00				 DRWG NO. TAM 21175-98 STRUCTURAL COMPONENT ONLY			
---	--	--	--	---	--	--	--	--	--	--	--	---	--	--	--	--	--	--	--

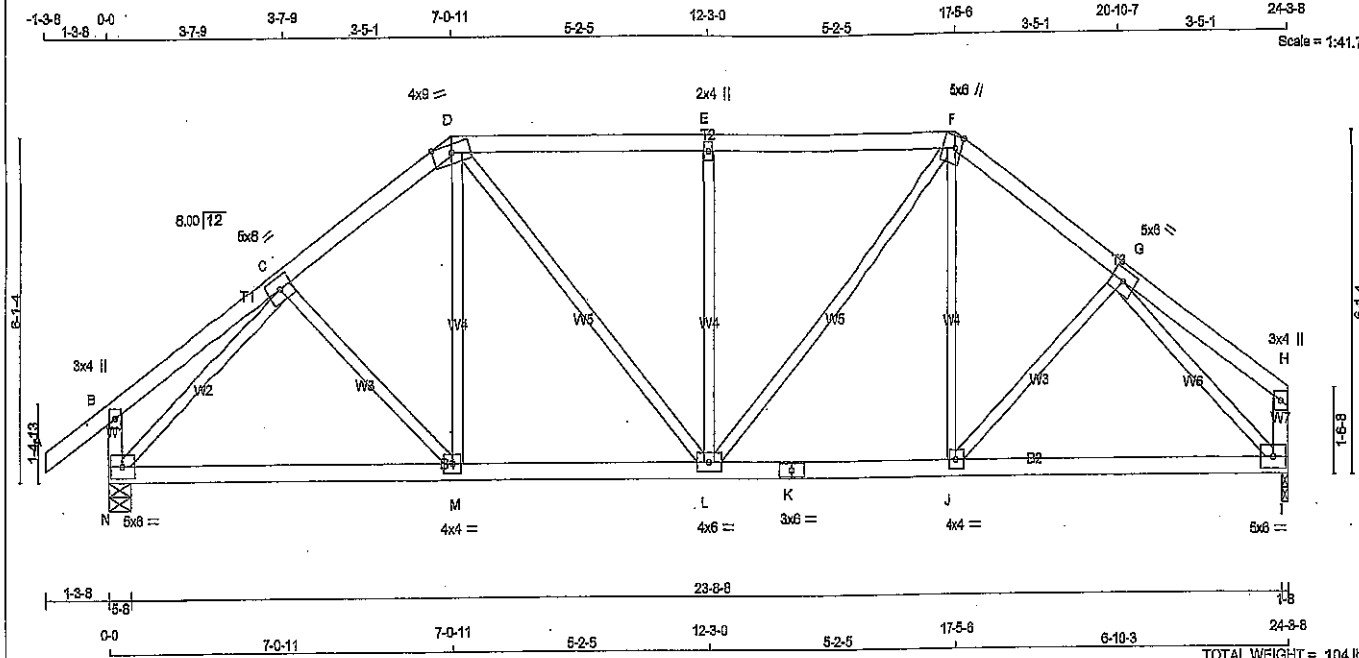**LUMBER****N. L. G. A. RULES**

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
N - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0		
D	TTWW-m	MT20	4.0	6.0	Edge	
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.50	1.50
G	TMWW-t	MT20	5.0	6.0		
H	TMV+p	MT20	3.0	4.0		
I	BMVW1-t	MT20	5.0	6.0		
J	BMWW-t	MT20	4.0	4.0		
K	BS-t	MT20	3.0	6.0		
L	BMWWW-t	MT20	4.0	6.0		
M	BMWW-t	MT20	4.0	4.0		
N	BMVW1-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY**BUILDING DESIGNER****BEARINGS**

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	UP/LIFT
JT				
N	1478	0	1478	0
I	1363	0	1363	0

UNFACTORED REACTIONS

	1ST LOASE	MAX	MIN	COMPONENT REACTIONS
	JT	COMBINED	SNOW	LIVE
N	1186	692	0	255
I	1119	621	0	255

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, I

BRACINGTOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.05 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX	MEMB.	MAX. FACTORED	FACTORED	MAX
	FORCE	VERT. LOAD	LC1 MAX		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/32	-84.3	-84.3	0.11 (1)	10.00	C-M	0/117
B-C	0/17	-84.3	-84.3	0.15 (1)	10.00	M-D	0/805
C-D	-1459/0	-84.3	-84.3	0.14 (1)	5.29	D-L	0/408
D-E	-1474/0	-84.3	-84.3	0.31 (1)	5.05	L-E	-534/0
E-F	-1474/0	-84.3	-84.3	0.31 (1)	5.05	L-F	0/442
F-G	-1433/0	-84.3	-84.3	0.14 (1)	5.33	J-F	0/273
G-H	0/17	-84.3	-84.3	0.14 (1)	10.00	J-G	0/138
H-I	-235/0	0.0	0.0	0.02 (1)	7.81	N-C	-1689/0
I-H	-108/0	0.0	0.0	0.01 (1)	7.81	G-I	-1635/0
N-M	0/1196	-28.0	-28.0	0.45 (2)	10.00		
M-L	0/1201	-28.0	-28.0	0.46 (2)	10.00		
L-K	0/1179	-28.0	-28.0	0.45 (2)	10.00		
K-J	0/1179	-28.0	-28.0	0.45 (2)	10.00		
J-I	0/1136	-28.0	-28.0	0.43 (2)	10.00		

DESIGN CRITERIA**SPECIFIED LOADS:**

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF

TOTAL LOAD = 45.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.31/1.00 (D-E:1), BC=0.48/1.00 (L-M:2),

WB=0.64/1.00 (C-N:1), SS=0.21/1.00 (D-E:1)

DOLLUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	816	354	1667

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

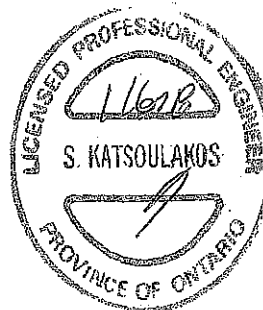JSI GRIP=0.84 (D) (INPUT = 0.80)
JSI METAL=0.41 (C) (INPUT = 1.00)DWG NO. TAM 4009-18
STRUCTURAL
COMPONENT ONLY

285994

T5A


1

1

TRUSS DESC.

Version 8.200 8 Dec 12 2017 Mitek Industries, Inc. Tue Jan 18 10:45:48 2018 Page 1
ID:w3K2IB2K4fGk9DO7SkJphyfMC-oE6xRQ0MXI_DVxmSIBEv1E4eZg_N7Hd9Dfh7zup]H

Tamarack Roof Truss, Burlington

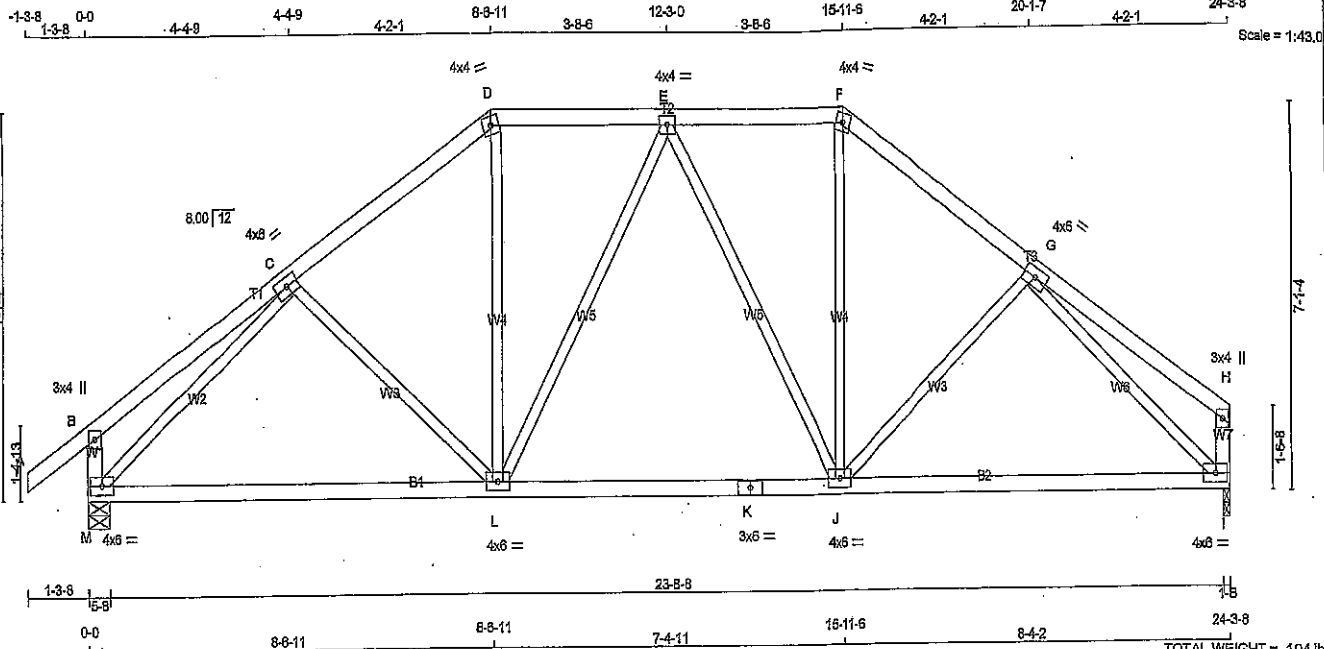

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESGR
A - D	2x4	DRY	No.2
B - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
M - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTW-m	MT20	4.0	4.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTW-m	MT20	4.0	4.0		
G	TMWW-t	MT20	4.0	6.0		
H	TMV+p	MT20	3.0	4.0		
I	BMVW1-t	MT20	4.0	6.0		
J	BMVWW1-t	MT20	4.0	6.0		
K	BS-t	MT20	3.0	6.0		
L	BMVWW-t	MT20	4.0	6.0		
M	BMVW1-t	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
M	1479	0	1479	0
I	1383	0	1383	0

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1196	882/0	255/0	0/0	0/0	251/0	0/0
I	1119	621/0	255/0	0/0	0/0	243/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.32 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY

APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MAX.	MEMB.	MAX. FACTORED	MAX.
	FORCE	VERT. LOAD LC1	MAX.	MAX.		FORCE	MAX.
	(LBS)	(PLF)	CSI (LC)	LENGTH		(LBS)	CSI (LC)
FR-TO					FR-TO		
A-B	0/32	-84.3	-84.3 0.11 (1)	10.00	C-L	-117/85	0.07 (1)
B-C	0/22	-84.3	-84.3 0.24 (1)	10.00	L-D	0/495	0.11 (1)
C-D	-1388/0	-84.3	-84.3 0.21 (1)	5.32	L-E	-195/0	0.24 (1)
D-E	-1142/0	-84.3	-84.3 0.15 (1)	5.79	E-J	-225/0	0.27 (1)
E-F	-1128/0	-84.3	-84.3 0.15 (1)	5.62	J-F	0/484	0.11 (1)
F-G	-1371/0	-84.3	-84.3 0.20 (1)	5.35	J-G	-70/102	0.04 (1)
G-H	0/22	-84.3	-84.3 0.23 (1)	10.00	M-C	-1680/0	0.93 (1)
M-B	-255/0	0.0	0.0 0.03 (1)	7.81	G-I	-1632/0	0.86 (1)
I-H	-131/0	0.0	0.0 0.01 (1)	7.81			
M-L	0/1222	-28.0	-28.0 0.57 (2)	10.00			
L-K	0/1233	-28.0	-28.0 0.56 (2)	10.00			
K-J	0/1233	-28.0	-28.0 0.56 (2)	10.00			
J-I	0/1173	-28.0	-28.0 0.54 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 3.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 6.00/12THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBC 2010THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F.
RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED
ROOF LIVE LOADALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/889 (0.29")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/781 (0.38")CSI TC=0.24/1.00 (B-C:1), BC=0.68/1.00 (J-L:2),
WB=0.93/1.00 (C-M:1), SS=0.19/1.00 (L-M:3)DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1667


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

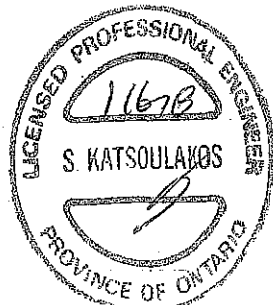JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.40 (C) (INPUT = 1.00)DWG NO. TAM 3985-18
STRUCTURAL
COMPONENT ONLY

Tamarack Roof Truss, Burlington

ID:W3K2IB2K4fGk9DO7SkJphyfMCOEBxRQ0MX_DVxmSiBEVep1D?edf_X1Hd9Dfh7zupjH

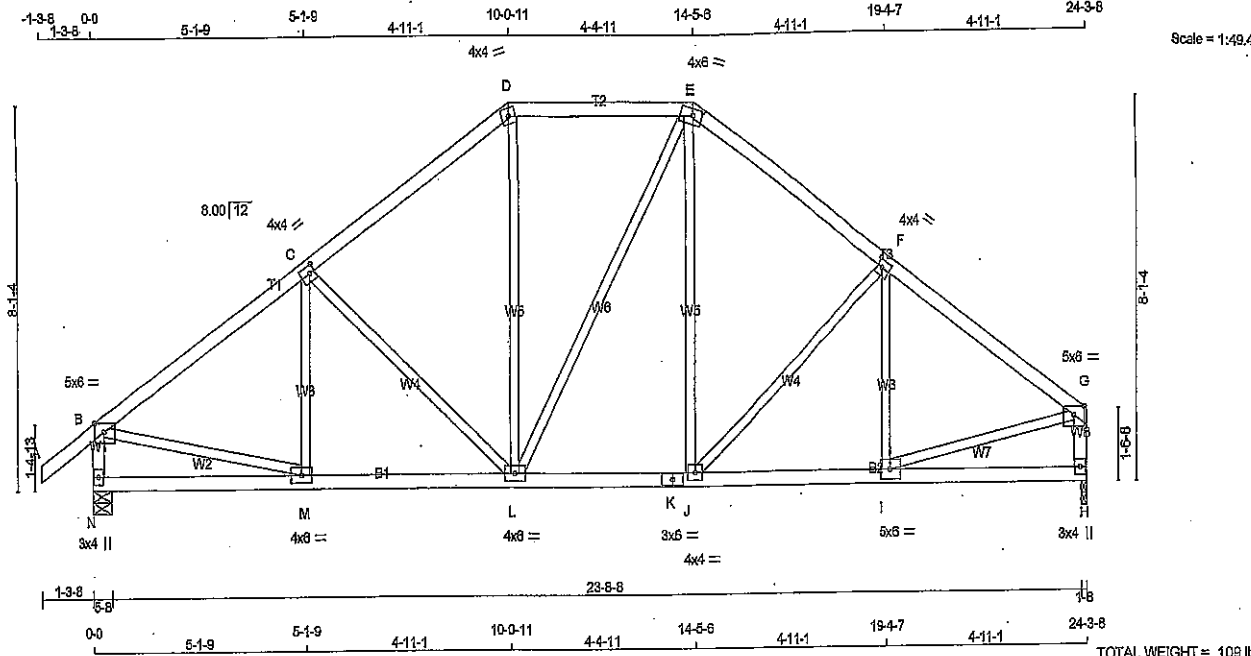

Scale = 1/4\"/>

TOTAL WEIGHT = 109 lb

(M/F)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT				
N	1479	0	0	5-8
H	1363	0	0	1-8

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
JT COMBINED		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1193	692/0	255/0	0/0	0/0	251/0	0/0
H	1119	621/0	235/0	0/0	0/0	243/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO				FR-TO			
A-B	0/32	-84.3	-84.3 0.11 (1)	10.00	M-C	-115/147	0.04 (1)
B-C	-1531/0	-84.3	-84.3 0.31 (1)	5.00	C-L	-354/0	0.30 (1)
C-D	-1271/0	-84.3	-84.3 0.29 (1)	5.39	L-D	0/374	0.08 (2)
D-E	-1037/0	-84.3	-84.3 0.22 (1)	5.91	L-E	0/15	0.00 (1)
E-F	-1262/0	-84.3	-84.3 0.28 (1)	5.42	J-F	0/360	0.08 (2)
F-G	-1483/0	-84.3	-84.3 0.29 (1)	5.08	J-F	-310/0	0.23 (1)
N-B	-1420/0	0.0	0.0 0.15 (1)	6.84	I-F	-158/122	0.05 (1)
H-G	-1307/0	0.0	0.0 0.14 (1)	7.06	B-M	0/1325	0.30 (1)
					I-G	0/1284	0.29 (1)
N-M	0/0	-28.0	-28.0 0.18 (3)	10.00			
M-L	0/1296	-28.0	-28.0 0.32 (2)	10.00			
L-K	0/1030	-28.0	-28.0 0.23 (2)	10.00			
K-J	0/1030	-28.0	-28.0 0.23 (2)	10.00			
J-I	0/1257	-28.0	-28.0 0.31 (2)	10.00			
I-H	0/0	-28.0	-28.0 0.17 (3)	10.00			

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWW-p	MT20	5.0	6.0	Edge	
C TMWW-t	MT20	4.0	4.0	2.00	1.50
D TTW-m	MT20	4.0	4.0		
E TTWW-m	MT20	4.0	6.0	1.75	2.50
F TMWW-t	MT20	4.0	4.0	2.00	1.50
G TMWW-p	MT20	5.0	6.0	Edge	
H BMV1+p	MT20	3.0	4.0		
I BMWW-t	MT20	5.0	6.0		
J BMWW-t	MT20	4.0	4.0		
K BS-t	MT20	3.0	6.0		
L BMWW-t	MT20	4.0	6.0		
M BMWW-t	MT20	4.0	6.0		
N BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE DF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CS1 TC=0.31/1.00 (B-C:1), BC=0.32/1.00 (L-M:2),
WB=0.30/1.00 (C-L:1), SS1=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 L.S. BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 619 354 1687 822 2284 1356

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.32 (M) (INPUT = 1.00)

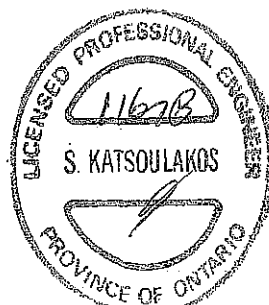

DWG NO. TAM 3986-13
STRUCTURAL
COMPONENT ONLY

285994

T7A

1


1

TRUSS DESC.

Tamarack Roof Truss, Burlington

Version 8.200 5 Dec 12 2017 Mitek Industries, Inc. Tue Jan 16 10:45:49 2018 Page 1

ID:w3K2[B2K4fGk9ID07Sk.phylfMC-HQgJem0_136475LeulKBoaM21ymjw5QsozCDZupjG

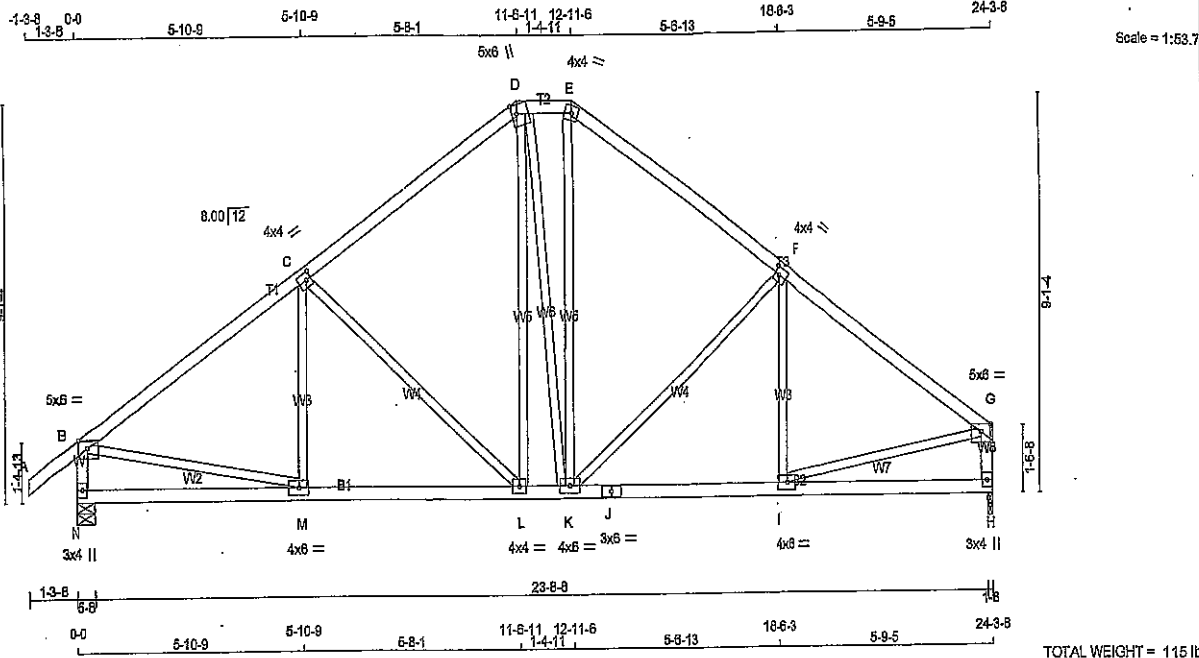

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESOR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
N - B	2x4	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
N - J	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ
N	1479	0	1479	0
H	1393	0	1393	0

UNFACTORED REACTIONS

	1ST CASE	MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1198	682/0	255/0	0/0	0/0	251/0	0/0
H	1119	621/0	255/0	0/0	0/0	243/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. FACTORED (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED (LBS)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/32	-84.3	-84.3 0.11 (1)	M-C	-50/214	0.05 (8)	
B-C	-1533/0	-84.3	-84.3 0.42 (1)	C-L	-461/0	0.57 (1)	
C-D	-1163/0	-84.3	-84.3 0.38 (1)	L-D	0/377	0.08 (1)	
D-E	-945/0	-84.3	-84.3 0.03 (1)	D-K	0/17	0.02 (2)	
E-F	-1184/0	-84.3	-84.3 0.37 (1)	K-E	0/390	0.09 (1)	
F-G	-1491/0	-84.3	-84.3 0.39 (1)	K-F	-433/0	0.51 (1)	
G-H	-1413/0	0.0	0.0 0.15 (1)	L-F	-84/185	0.04 (3)	
H-G	-1299/0	0.0	0.0 0.14 (1)	B-M	0/1324	0.30 (1)	
				I-G	0/1296	0.29 (1)	
N-M	0/0	-28.0	-28.0 0.25 (3)				
M-L	0/1302	-28.0	-28.0 0.40 (2)				
L-K	0/943	-28.0	-28.0 0.26 (2)				
K-J	0/1266	-28.0	-28.0 0.37 (2)				
J-I	0/1288	-28.0	-28.0 0.37 (2)				
I-H	0/0	-28.0	-28.0 0.23 (3)				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TTVW+m	MT20	5.0	6.0	2.50	1.50
E	TTVW-m	MT20	4.0	4.0		
F	TMVW-t	MT20	4.0	4.0	2.00	1.50
G	TMVW-p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMVW-t	MT20	4.0	6.0		
L	BMVW-t	MT20	4.0	4.0		
M	BMVW-t	MT20	4.0	6.0		
N	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 3.0 PSF
BOT CH.	LL	= 10.5 PSF
	DL	= 7.0 PSF
TOTAL LOAD		= 46.1 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OSC 2012, BCBC 2012, ABC 2014
- CSA 098-09
- TPIC 2011

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.81")
CALCULATED VERT. DEFL.(LL) = 1/899 (0.06")
ALLOWABLE DEFL.(TL) = 1/360 (0.81")
CALCULATED VERT. DEFL.(TL) = 1/989 (0.11")CSI: TC=0.42/1.00 (B-C-1), BC=0.40/1.00 (L-M-2),
WB=0.57/1.00 (C-L-1), SS=0.20/1.00 (B-C-1)DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1657
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

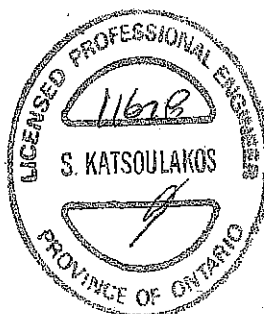
JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.33 (M) (INPUT = 1.00)DWG NO. TAM 3967-18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285482	T8	1	1	TRUSS DESC.		

Tamareck Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MITek Industries, Inc. Thu Apr 19 13:19:08 2018 Page 1

ID:PFehc1Ba2cOYemTQTAYm6Oy1tEX-hwTMUPh_s1Vwo1X3qUkF90w9m3dr_c4fhMLAbXzPgLn

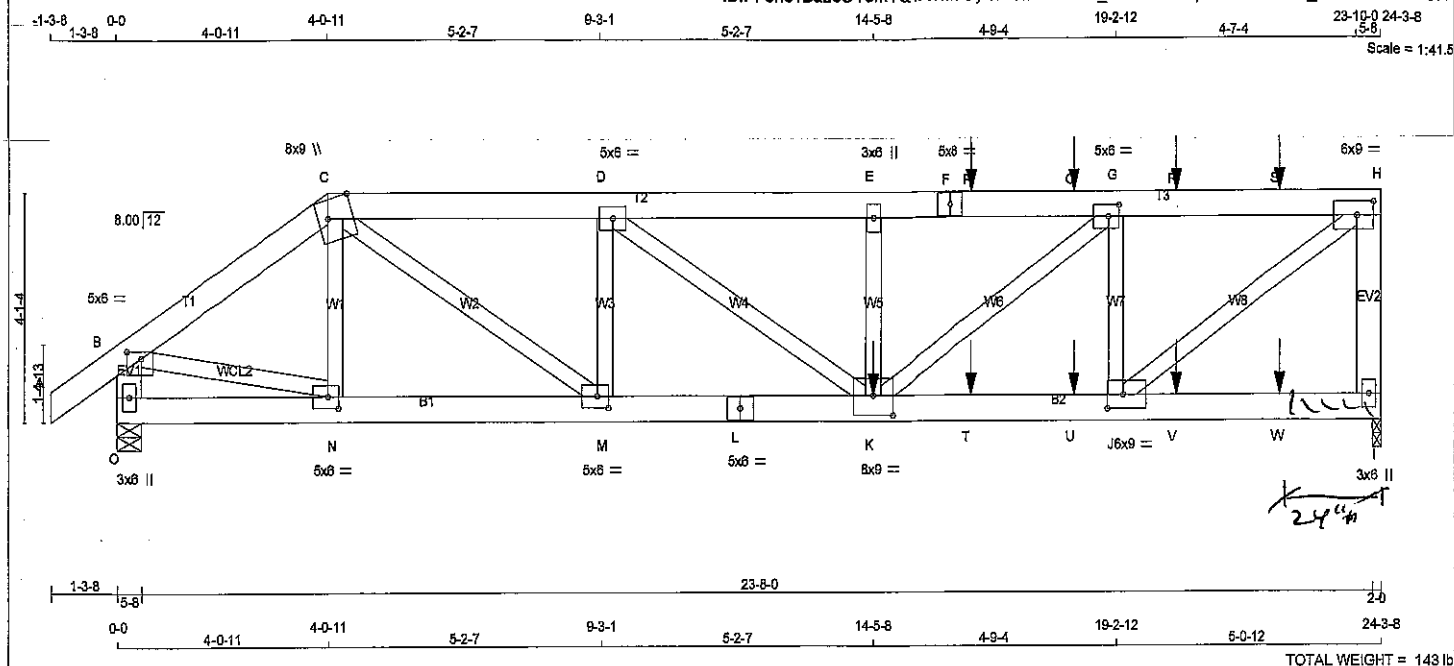

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x8	DRY	No.2
C - F	2x8	DRY	No.2
F - H	2x8	DRY	No.2
I - H	2x8	DRY	No.2
O - B	2x6	DRY	No.2
O - L	2x6	DRY	No.2
L - I	2x6	DRY	No.2

ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.50	3.25
C	TTWW+m	MT20	8.0	9.0	Edge	5.75
D	TMWW-I	MT20	5.0	6.0		
E	TMW+u	MT20	3.0	6.0		
F	TS-I	MT20	5.0	6.0		
G	TMWW-I	MT20	5.0	6.0	2.50	2.50
H	TMWV-I	MT20	6.0	9.0	3.00	3.75
I	BMW1+p	MT20	3.0	6.0		
J	BMWW-I	MT20	6.0	9.0	3.00	3.75
K	BMWWV-I	MT20	8.0	9.0	4.25	4.50
L	BS-I	MT20	5.0	6.0		
M	BMWW-I	MT20	5.0	6.0	2.50	2.50
N	BMWV-I	MT20	5.0	6.0	2.50	2.50
O	BMW1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 101.4 lbs FACTORED DOWN AT 18'-4-12, 101.4 lbs FACTORED DOWN AT 18'-4-12, AND 101.4 lbs FACTORED DOWN AT 20'-4-12, AND 101.4 lbs FACTORED DOWN AT 22'-4-12 ON TOP CHORD, AND 1735.2 lbs FACTORED DOWN AT 14'-5-6, 69.9 lbs FACTORED DOWN AT 16'-4-12, 69.9 lbs FACTORED DOWN AT 18'-4-12, AND 69.9 lbs FACTORED DOWN AT 20'-4-12, AND 69.9 lbs FACTORED DOWN AT 22'-4-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

SCAB JOINT # 1 WITH 2 X 6 #2 SPF 24" LONG 1 SIDE(S) USING ROW(S) 3 ARDOX SPIRAL COMMON WIRE NAILS AT 3" O/C STAGGERED (1" NAILS/SCAB). REQUIRED FOR 2" BRG PROVISION.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQRD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
I	2848	0	2848	0	0	2-0	2-0	5-8	5-8
O	2299	0	2299	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	2328	1309 / 0	519 / 0	0 / 0	0 / 0	500 / 0	0 / 0
O	1860	1078 / 0	394 / 0	0 / 0	0 / 0	389 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.40 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 33	-84.3 -84.3	0.07 (1)	10.00	N-C	-322 / 22	0.08 (1)
B-C	-2672 / 0	-84.3 -84.3	0.17 (1)	4.92	C-M	0 / 2536	0.45 (1)
C-D	-4294 / 0	-84.3 -84.3	0.28 (1)	3.94	M-D	-1280 / 0	0.22 (1)
D-E	-5419 / 0	-84.3 -84.3	0.34 (1)	3.51	D-K	0 / 1379	0.24 (1)
E-F	-5419 / 0	-84.3 -84.3	0.43 (1)	3.40	K-E	-416 / 0	0.07 (1)
F-P	-5419 / 0	-84.3 -84.3	0.43 (1)	3.40	X-G	0 / 2413	0.43 (1)
P-Q	-5419 / 0	-84.3 -84.3	0.43 (1)	3.40	J-G	-2234 / 0	0.38 (1)
Q-G	-5419 / 0	-84.3 -84.3	0.43 (1)	3.40	J-H	0 / 4314	0.78 (1)
G-R	-3503 / 0	-84.3 -84.3	0.32 (1)	4.25	B-N	0 / 2267	0.40 (1)
R-S	-3503 / 0	-84.3 -84.3	0.32 (1)	4.25			
S-H	-3503 / 0	-84.3 -84.3	0.32 (1)	4.25			
I-H	-2759 / 0	0.0 0.0	0.40 (1)	6.25			
Q-B	-2254 / 0	0.0 0.0	0.16 (1)	6.77			
O-N	0 / 0	-28.0 -28.0	0.08 (3)	10.00			
N-M	0 / 2204	-28.0 -28.0	0.33 (1)	10.00			
M-L	0 / 4294	-28.0 -28.0	0.65 (1)	10.00			
L-K	0 / 4294	-28.0 -28.0	0.65 (1)	10.00			
K-T	0 / 3503	-28.0 -28.0	0.56 (1)	10.00			
T-U	0 / 3503	-28.0 -28.0	0.56 (1)	10.00			
U-J	0 / 3503	-28.0 -28.0	0.56 (1)	10.00			
J-V	0 / 0	-28.0 -28.0	0.15 (3)	10.00			
V-W	0 / 0	-28.0 -28.0	0.15 (3)	10.00			
W-I	0 / 0	-28.0 -28.0	0.15 (3)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TOTAL
K	14-5-8	-1735	-1735	FRONT	VERT	TOTAL
P	18-4-12	-101	-101	FRONT	VERT	TOTAL
Q	18-4-12	-101	-101	FRONT	VERT	TOTAL
R	20-4-12	-101	-101	FRONT	VERT	TOTAL
S	22-4-12	-101	-101	FRONT	VERT	TOTAL
T	18-4-12	-40	-70	FRONT	VERT	TOTAL
U	18-4-12	-40	-70	FRONT	VERT	TOTAL
V	20-4-12	-40	-70	FRONT	VERT	TOTAL
W	22-4-12	-40	-70	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL)= L/360 (0.61")
CALCULATED VERT. DEFL.(TL) = L/999 (0.27")

CSI: TC=0.43/1.00 (E-G:1), BC=0.65/1.00 (K-M:1), WS=0.76/1.00 (H-J:1), SS=0.28/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.74 (L) (INPUT = 1.00)

DWG NO. TAM 2(177) -18
STRUCTURAL
COMPONENT ONLY

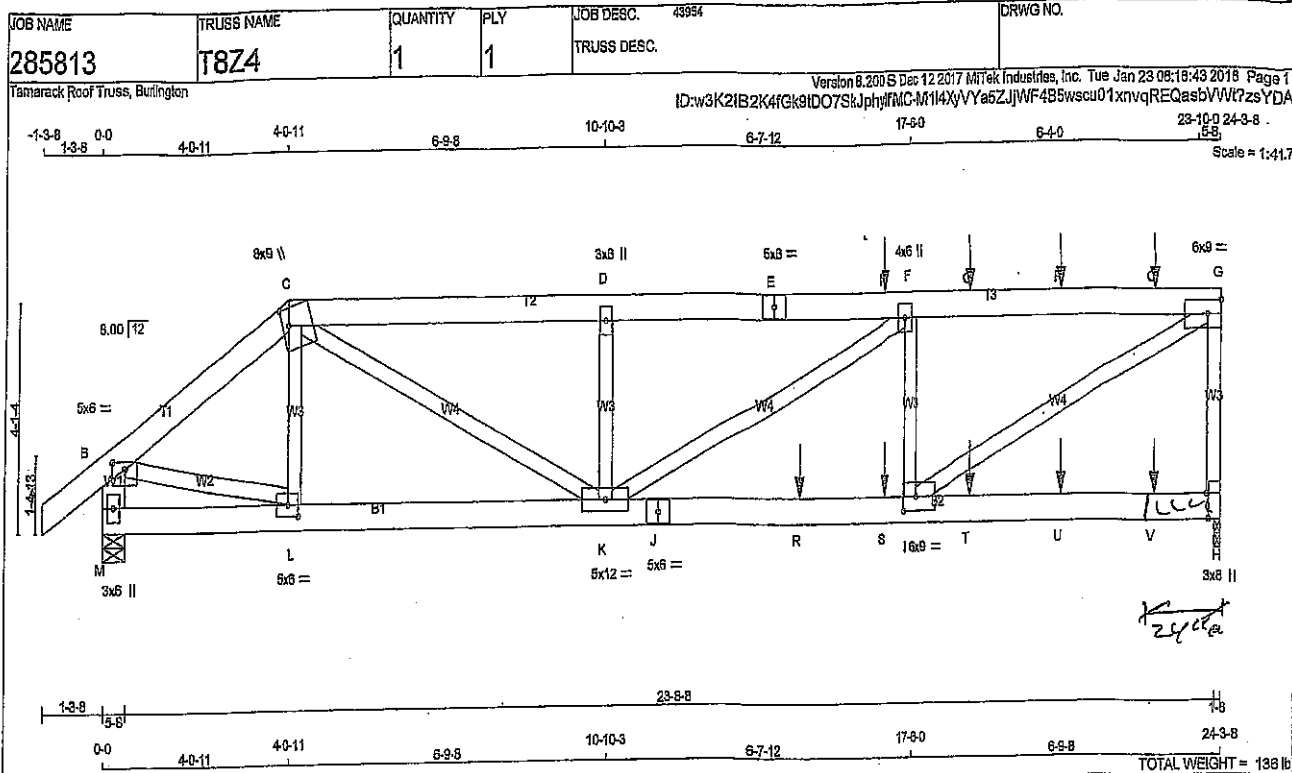

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY No.2	SPF
C - E	2x6	DRY No.2	SPF
E - G	2x6	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
M - B	2x6	DRY No.2	SPF
M - J	2x6	DRY 2100F 1.8E	SPF
J - H	2x6	DRY 2100F 1.8E	SPF

ALL WEBS 2x4 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWV-p	MT20	5.0	6.0	1.50	3.00
C TMWV+m	MT20	8.0	9.0	3.75	1.75
D TMWV+w	MT20	3.0	6.0		
E TS-t	MT20	5.0	6.0		
F TMWV-h	MT20	4.0	6.0		
G TMWV-l	MT20	6.0	9.0		Edge
H BMV1-p	MT20	3.0	8.0	5.50	0.50
I BMWV-h	MT20	6.0	9.0	3.00	3.75
J BS-t	MT20	5.0	6.0		
K BMWV-h	MT20	5.0	12.0		
L BMWV-l	MT20	5.0	6.0	2.50	2.75
M BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 101.4 lbs FACTORED DOWN AT 16'-10"-12, 101.4 lbs FACTORED DOWN AT 18'-10"-12, AND 101.4 lbs FACTORED DOWN AT 20'-10"-12, AND 101.4 lbs FACTORED DOWN AT 22'-10"-12 ON TOP CHORD, AND 1340.4 lbs FACTORED DOWN AT 14'-11"-8, 69.9 lbs FACTORED DOWN AT 16'-10"-12, 69.9 lbs FACTORED DOWN AT 18'-10"-12, AND 69.9 lbs FACTORED DOWN AT 20'-10"-12, AND 69.9 lbs FACTORED DOWN AT 22'-10"-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

SCAB JOINT # 4 WITH 2X6 #2
SPF 24" LONG / SIDE(S) USING 2
ROWS(S) 2 1/2" ARDOX SPIRAL COMMON WIRE
NAILS AT 2" O/C STAGGERED (IF NAILS/SCAB)
REQUIRED FOR 1/4" BRG PROVISION.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 2652	DOWN 2652	0	1-8
H	2652	0	0	1-8
M	2100	0	0	6-8

UNFACTORED REACTIONS

	1ST CASE	MAX MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	2178	1208 / 0	488 / 0	0 / 0	0 / 0	473 / 0	0 / 0
M	1704	979 / 0	366 / 0	0 / 0	0 / 0	359 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 3.61 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/33	-84.3 -84.3	0.07 (1)	10.00	L-C	-873/28	0.08 (1)
B-C	-2385/0	-84.3 -84.3	0.16 (1)	5.17	C-K	0/2679	0.47 (1)
C-D	-4311/0	-84.3 -84.3	0.43 (1)	3.79	K-D	-571/0	0.10 (1)
D-E	-4311/0	-84.3 -84.3	0.51 (1)	3.68	K-F	0/157	0.03 (1)
E-N	-4311/0	-84.3 -84.3	0.51 (1)	3.68	I-F	-984/0	0.17 (1)
N-F	-4311/0	-84.3 -84.3	0.51 (1)	3.68	I-G	0/4735	0.84 (1)
F-O	-4173/0	-84.3 -84.3	0.59 (1)	3.61	B-L	0/2007	0.35 (1)
O-P	-4173/0	-84.3 -84.3	0.59 (1)	3.61			
P-Q	-4173/0	-84.3 -84.3	0.59 (1)	3.61			
Q-G	-4173/0	-84.3 -84.3	0.59 (1)	3.61			
H-G	-2609/0	0.0	0.0	0.80 (1)	5.26		
M-B	-2029/0	0.0	0.0	0.14 (1)	7.06		

MEMB.	LOC.	LC1	MAX.	MAX+	FACE	BR	TYPE
JT	16-10-12	-101	-101	-	FRONT	VERT	TOTAL
N	16-10-12	-101	-101	-	FRONT	VERT	TOTAL
O	16-10-12	-101	-101	-	FRONT	VERT	TOTAL
P	20-10-12	-101	-101	-	FRONT	VERT	TOTAL
Q	22-10-12	-101	-101	-	FRONT	VERT	TOTAL
R	14-11-8	-1340	-1340	-	FRONT	VERT	TOTAL
S	16-10-12	-40	-70	-	FRONT	VERT	TOTAL
T	18-10-12	-40	-70	-	FRONT	VERT	TOTAL
U	20-10-12	-40	-70	-	FRONT	VERT	TOTAL
V	22-10-12	-40	-70	-	FRONT	VERT	TOTAL

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR	TYPE
J	16-10-12	-101	-101	-	FRONT	VERT	TOTAL
N	16-10-12	-101	-101	-	FRONT	VERT	TOTAL
O	20-10-12	-101	-101	-	FRONT	VERT	TOTAL
P	20-10-12	-101	-101	-	FRONT	VERT	TOTAL
Q	22-10-12	-101	-101	-	FRONT	VERT	TOTAL
R	14-11-8	-1340	-1340	-	FRONT	VERT	TOTAL
S	16-10-12	-40	-70	-	FRONT	VERT	TOTAL
T	18-10-12	-40	-70	-	FRONT	VERT	TOTAL
U	20-10-12	-40	-70	-	FRONT	VERT	TOTAL
V	22-10-12	-40	-70	-	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
CL = 3.0 PSF
BOT CH. LL = 10.5 PSF
CL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA C88-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/860 (0.81")
CALCULATED VERT. DEFL.(LL) = L/989 (0.27")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/684 (0.43")

CSI: TO=0.60/1.00 (G-H), BC=0.85/1.00 (I-K), WB=0.84/1.00 (G-H), SS=0.60/1.00 (I-K)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVER RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 822 2284 1685

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.66 (1) (INPUT=0.90)
JSI METAL= 0.70 (1) (INPUT=1.00)

DRWG NO. TAM 5089
STRUCTURAL
COMPONENT ONLY

285994

T9

2


1

TRUSS DESC.

Tamarack Roof Truss, Burlington

Version 8.200 6 Dec 12 2017 Mitek Industries, Inc. Tue Jan 16 10:45:49 2018 Page 1

ID:w3K2B2K4fGk9tD07SkJphyfMC-HQgJem0_136475LelulkB0aKe1y8JyhQsozCDZzupjG

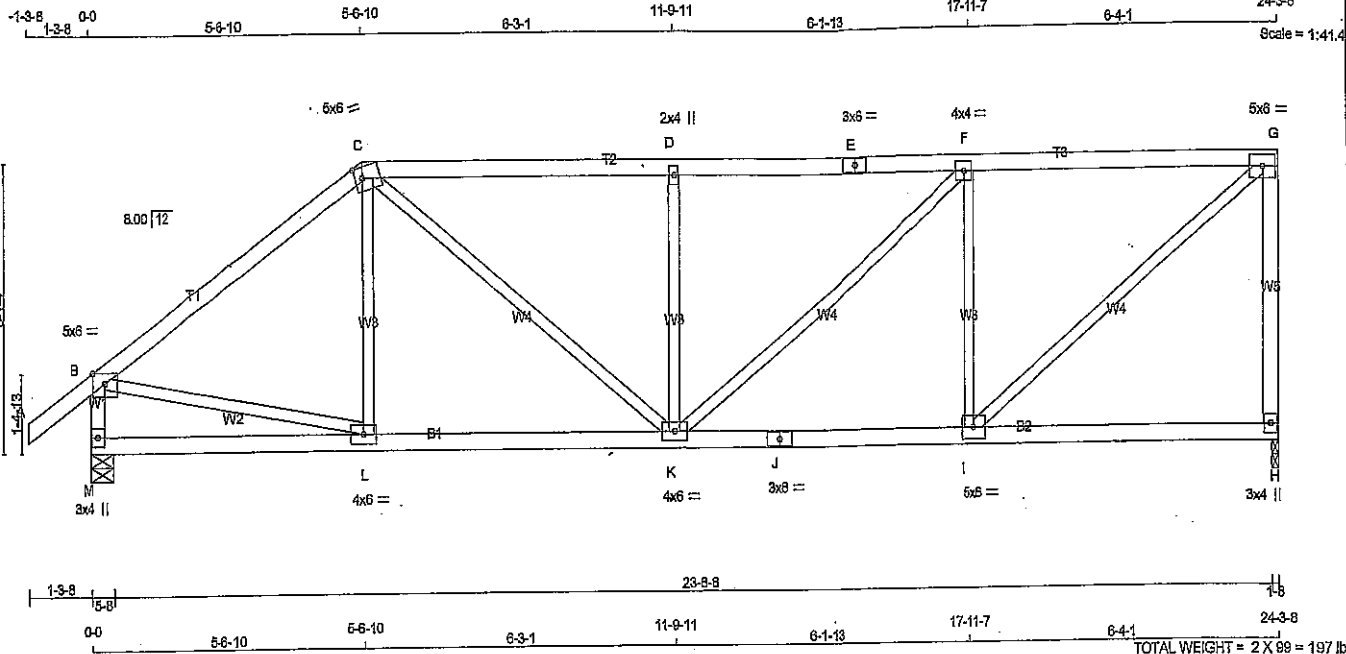**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
E - G	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
M - B	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
J - H	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY; SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TTWW-m	MT20	5.0	6.0	2.25	1.75
D	TMVW-w	MT20	2.0	4.0		
E	TS4	MT20	3.0	6.0		
F	TMVW-l	MT20	4.0	4.0		
G	TMVW-l	MT20	5.0	6.0		
H	BMV1+p	MT20	3.0	4.0		
I	BMVW-l	MT20	5.0	6.0		
J	BS4	MT20	3.0	6.0		
K	BMVW-l	MT20	4.0	6.0		
L	BMVW-l	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**BEARINGS**

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
H	1363	0	1363	0
M	1479	0	1479	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	1119	621 / 0	255 / 0	0 / 0	0 / 0	0 / 0	243 / 0	0 / 0
M	1198	692 / 0	255 / 0	0 / 0	0 / 0	0 / 0	251 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.34 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC2 MAX	UNBRAC	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 MAX	LC2 MAX
FR-TO							FR-TO				
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	L-C	-49 / 204	0.05 (3)			
B-C	-1493 / 0	-84.3	-84.3	0.55 (1)	4.69	B-L	0 / 1283	0.28 (1)			
C-D	-1797 / 0	-84.3	-84.3	0.55 (1)	4.37	I-G	0 / 1778	0.40 (1)			
D-E	-1797 / 0	-84.3	-84.3	0.55 (1)	4.34	C-K	0 / 702	0.16 (1)			
E-F	-1797 / 0	-84.3	-84.3	0.55 (1)	4.34	I-F	-877 / 0	0.34 (1)			
F-G	-1416 / 0	-84.3	-84.3	0.55 (1)	4.81	K-D	-566 / 0	0.22 (1)			
H-G	-1292 / 0	0.0	0.0	0.57 (1)	7.10	K-F	0 / 484	0.11 (1)			
M-B	-1417 / 0	0.0	0.0	0.15 (1)	6.85						
M-L	0 / 0	-28.0	-28.0	0.24 (3)	10.00						
L-K	0 / 1240	-28.0	-28.0	0.39 (2)	10.00						
K-J	0 / 1418	-28.0	-28.0	0.44 (2)	10.00						
J-I	0 / 1416	-28.0	-28.0	0.44 (2)	10.00						
I-H	0 / 0	-28.0	-28.0	0.27 (3)	10.00						

DESIGN CRITERIA**SPECIFIED LOADS:**

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 240 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (0.81")
CALCULATED VERT. DEF. (LL) = L/899 (0.09")
ALLOWABLE DEF. (TL) = L/360 (0.81")
CALCULATED VERT. DEF. (TL) = L/999 (0.14")

CSI: TC=0.57/1.00 (G-H:1), BC=0.44/1.00 (I-K:2),
WB=0.40/1.00 (G-H:1), SSI=0.25/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 822 2284 1858


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (K) (INPUT = 0.90)
JSI METAL= 0.44 (J) (INPUT = 1.00)

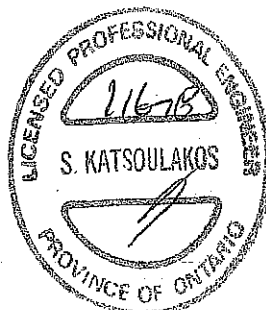

DWG NO. TAM 3900-12
STRUCTURAL
COMPONENT ONLY

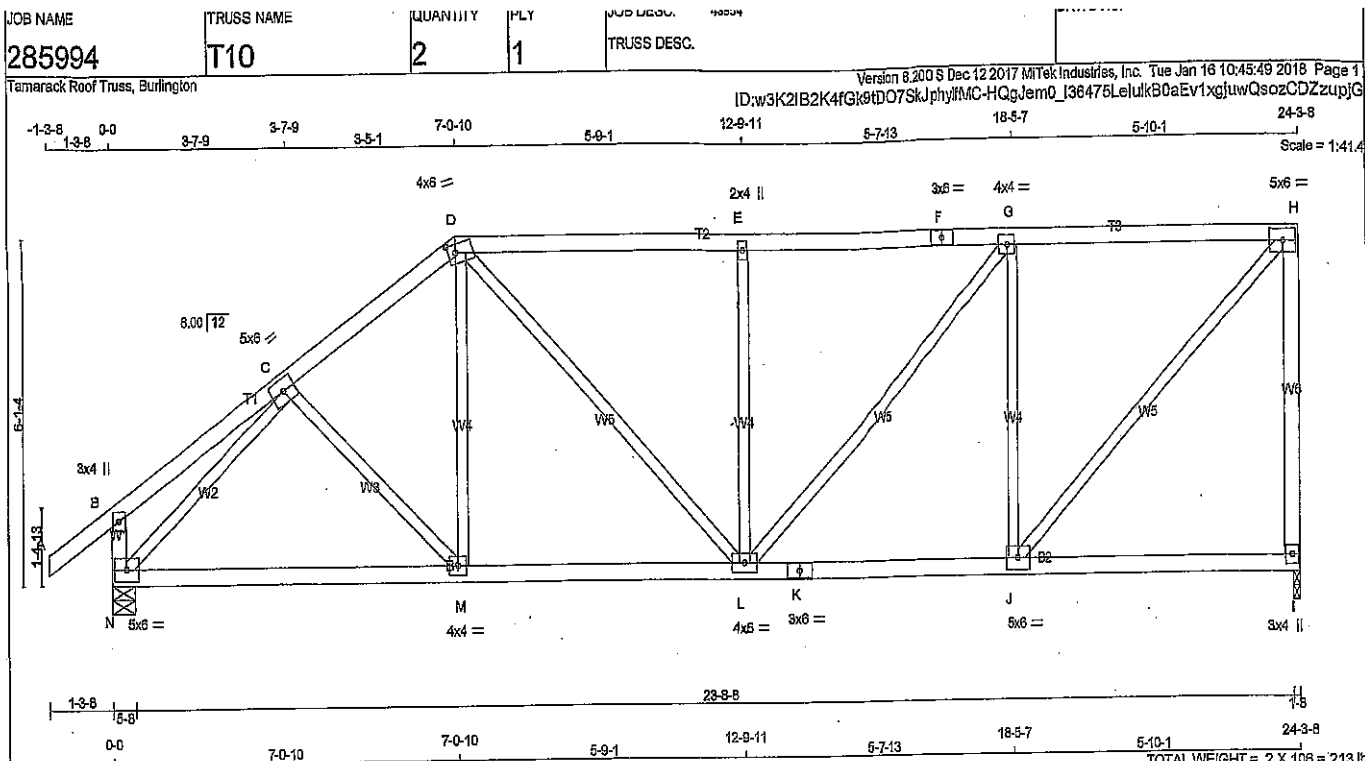

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
N - B	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0		
D	TTWV-m	MT20	4.0	8.0	1.75	1.75
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TMVW-t	MT20	5.0	6.0		
I	BMV1+p	MT20	3.0	4.0		
J	BMVW-t	MT20	5.0	6.0		
K	BS-t	MT20	3.0	6.0		
L	BMVWV-t	MT20	4.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ UPLIFT		
I	1363	0	1363	0	1-8	1-8
N	1479	0	1479	0	5-8	5-8

UNFACTORED REACTIONS

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	1119	621 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0
N	1198	692 / 0	255 / 0	0 / 0	0 / 0	251 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (CSI (LC))	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (CSI (LC))
FR-TO		FROM	TO		FR-TO		
A-B	0 / 32	-84.3	-84.3 0.11 (1)	10.00	C-M	0 / 118	0.03 (3)
B-C	0 / 17	-84.3	-84.3 0.15 (1)	10.00	M-D	0 / 307	0.07 (2)
C-D	-1460 / 0	-84.3	-84.3 0.18 (1)	5.22	N-C	-1869 / 0	0.64 (1)
D-E	-1473 / 0	-84.3	-84.3 0.43 (1)	4.86	J-H	0 / 1557	0.35 (1)
E-F	-1473 / 0	-84.3	-84.3 0.44 (1)	4.86	D-L	0 / 385	0.09 (1)
F-G	-1473 / 0	-84.3	-84.3 0.44 (1)	4.86	J-G	-912 / 0	0.53 (1)
G-H	-1103 / 0	-84.3	-84.3 0.42 (1)	5.46	L-E	-520 / 0	0.30 (1)
H-I	-1258 / 0	0.0	0.0 0.94 (1)	7.08	L-G	0 / 530	0.12 (1)
N-B	-233 / 0	0.0	0.0 0.02 (1)	7.81			
N-M	0 / 1198	-28.0	-28.0 0.45 (2)	10.00			
M-L	0 / 1202	-28.0	-28.0 0.47 (2)	10.00			
L-K	0 / 1103	-28.0	-28.0 0.37 (2)	10.00			
K-J	0 / 1103	-28.0	-28.0 0.37 (2)	10.00			
J-I	0 / 0	-28.0	-28.0 0.24 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 3.0 PSF
BOT CH. LL	= 10.5 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
-PART 9 OF OBC 2012, BCBC 2012, ABC 2014
-CSA 088-09
-TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.19")

CSI: TC=0.94/1.00 (H-I:1), BC=0.47/1.00 (L-M:2),
WB=0.64/1.00 (C-N:1), SS=0.23/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	622	2264	1855


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.80 (D) (INPUT = 0.90)
JSI METAL= 0.41 (C) (INPUT = 1.00)



DWG NO. TAM 3909-18
STRUCTURAL
COMPONENT ONLY

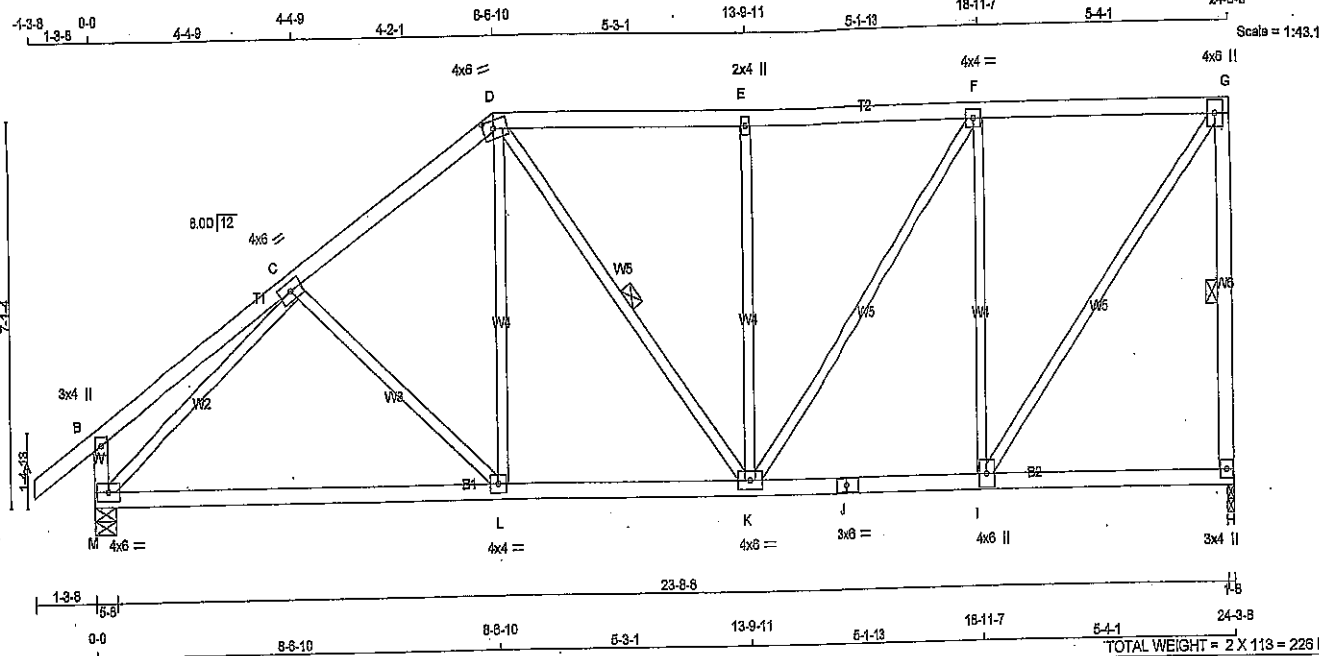

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY, SEASONED LUMBER.			

PLATES (table is in inches)			
JT TYPE	PLATES	W	LEN Y X
B TMV+p	MT20	3.0	4.0
C TMVW+1	MT20	4.0	6.0
D TMVW+m	MT20	4.0	6.0 1.75 2.50
E TMVW+w	MT20	2.0	4.0
F TMVW+1	MT20	4.0	4.0
G TMVW+p	MT20	4.0	6.0
H BMV+1+p	MT20	3.0	4.0
I BMVW+1	MT20	4.0	6.0
J BS+1	MT20	3.0	6.0
K BMVW+1	MT20	4.0	6.0
L BMVW+1	MT20	4.0	4.0
M BMVW+1	MT20	4.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORIZ	DOWN	HORIZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
H	1383	0	1383	0	0	1-8	1-8	1-8	1-8
M	1479	0	1479	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE		MAX/MIN COMPONENT REACTIONS		LIVE		PERM/LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM/LIVE	WIND	DEAD	SOIL	PERM/LIVE	WIND	DEAD	SOIL	PERM/LIVE	WIND	DEAD	SOIL
H	1119	821/0	255/0	0/0	0/0	243/0	0/0	0/0	0/0	243/0	0/0	0/0	0/0	0/0	0/0
M	1198	892/0	255/0	0/0	0/0	251/0	0/0	0/0	0/0	251/0	0/0	0/0	0/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, D-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0/32	C-L	-117/85
B-C	0/23	L-D	0/1414
C-D	-1390/0	M-C	-1661/0
D-E	-1226/0	I-G	0/1426
E-F	-1227/0	D-K	-8/141
F-G	-879/0	J-F	-946/0
G-H	-1305/0	K-E	-474/0
H-M	-255/0	K-F	0/1578
M-L	0/1223		
L-K	0/1141		
K-J	0/879		
J-I	0/879		
I-H	0/0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 3.0 PSF
BOT CH. LL	= 10.5 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 45.1 PSF

SPACING = 240 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
-PART 9 OF NBC 2012, BOBC 2012, ABC 2014
-CSA 086-09
-TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/779 (0.37")

CSI: TC=0.35/1.00 (E-F-1), BC=0.58/1.00 (K-L-2),
WB=0.93/1.00 (C-M-1), SS=0.21/1.00 (F-G-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PS)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	619 354	1667 822	2284 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.90 (M) (INPUT = 0.90)
JSI METAL=0.40 (C) (INPUT = 1.00)

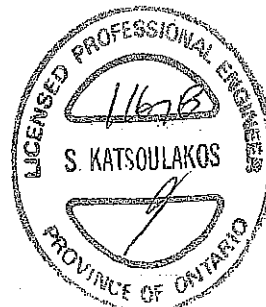

DWG NO. TAM 3990-18
STRUCTURAL
COMPONENT ONLY

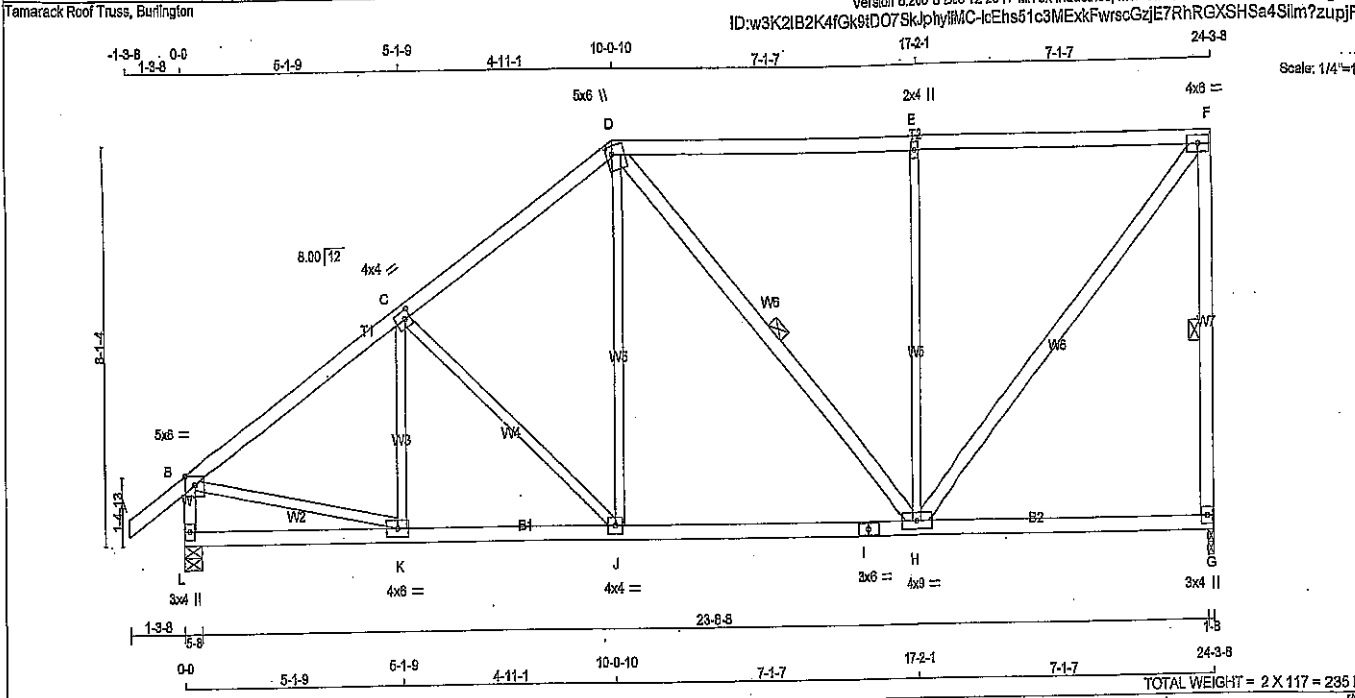

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - D 2x4 DRY No.2 SPF
D - F 2x4 DRY No.2 SPF
G - F 2x4 DRY No.2 SPF
L - B 2x4 DRY No.2 SPF
L - I 2x4 DRY No.2 SPF
I - G 2x4 DRY No.2 SPF

ALL WEBS EXCEPT
D - H 2x4 DRY No.2 SPF
H - F 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMVW-p MT20 5.0 6.0 Edge
C TMVW-l MT20 4.0 4.0 2.00 1.50
D TTWW+m MT20 5.0 6.0 2.00 1.50
E TMVW+w MT20 2.0 4.0
F TMVW-l MT20 4.0 6.0
G BMV-l+p MT20 3.0 4.0
H BMVWW-l MT20 4.0 9.0
I BS-l MT20 3.0 6.0
J BMVWW-l MT20 4.0 4.0
K BMVWW-l MT20 4.0 6.0
L BMV-l+p MT20 3.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS & LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
FACTORED GROSS REACTION
JT VERT HORZ
G 1363 0 1363 0 0 1-8 1-8
L 1479 0 1479 0 0 5-8 5-8

UNFACTORED REACTIONS
1ST LCASE MAX MIN COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
G 1119 621 / 0 255 / 0 0 / 0 0 / 0 243 / 0 0 / 0
L 1198 622 / 0 253 / 0 0 / 0 0 / 0 251 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.81 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H.
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW


LOADING
TOTAL LOAD CASES: (4)

CHORDS
MAX. FACTORED MEMB. FORCE (LBS)
PR-TO
A-B 0 / 32
B-C -1528 / 0
C-D -1275 / 0
D-E -967 / 0
E-F -967 / 0
G-F -1284 / 0
L-B -1418 / 0
L-K 0 / 0
K-J 0 / 1295
J-I 0 / 1041
I-H 0 / 1041
H-G 0 / 0

WEBS
MAX. FACTORED MEMB. FORCE (LBS)
K-C -123 / 133
C-J -347 / 0
J-D 0 / 436
D-H -110 / 0
H-E -745 / 0
E-F 0 / 1432
F-K 0 / 1323
L-K 0 / 0
K-J 0 / 1295
J-I 0 / 1041
I-H 0 / 1041
H-G 0 / 0

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010
THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011
(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL. (LL) = L/360 (0.81")
CALCULATED VERT. DEFL. (LL) = L/999 (0.10")
ALLOWABLE DEFL. (TL) = L/360 (0.81")
CALCULATED VERT. DEFL. (TL) = L/999 (0.16")
CSI: TO=0.81/1.00 (E-F:1), BC=0.49/1.00 (H-J:2), WB=0.94/1.00 (E-H:1), SS=0.29/1.00 (E-F:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10
COMPANION LIVE LOAD FACTOR = 0.50
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.89 (K) (INPUT = 0.90)
JSI METAL= 0.35 (I) (INPUT = 1.00)

DWG NO. TAM 3991-18
STRUCTURAL COMPONENT ONLY

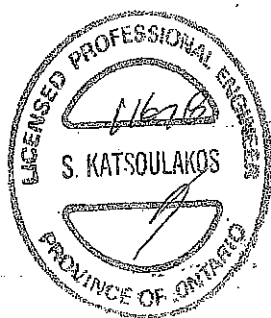

DWG NO. TAM 3991-18
STRUCTURAL
COMPONENT ONLY

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
<u>BEARINGS</u>									
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG UPLIFT	REQ'D BRG		IN-SX	IN-SX
	VERT	HORZ	DOWN	HORZ					
G	1363	0	1353	0	0	1-8			
L	1478	0	1478	0	0	5-8			

<u>UNFACTORED REACTIONS</u>									
1ST LOAGE		MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
G	1119	621 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0		
L	1198	692 / 0	255 / 0	0 / 0	0 / 0	251 / 0	0 / 0		

LEAVING NO MATERIAL TO BE BEING NO OR BETTER AT JOINT(S) G I

BEARING MATERIAL TO BE SUFFICIENT ON BOTH ENDS OF CHORD(S).

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.61 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H, E-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 6.00/12

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

ALLOWABLE DEFL.(LL) = $L/360$ (0.81")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.07")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.81")
 CALCULATED VERT. DEFL.(TL) = $L/999$ (0.11")

CSI: TC=0.62/1.00 (E-F:1), BC=0.40/1.00 (H-J:2),
WB=0.56/1.00 (C-J:1), SS=0.26/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

	NAIL VALUES		SHEAR		SECTION	
	PLATE (PSI)	GRIP (PSI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1687	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (H) (INPUT = 0.90)
JSI METAL= 0.92 (K) (INPUT = 1.00)

Figure 1. The effect of the concentration of the *Agaricus bisporus* spores on the growth of *Agaricus bisporus* on the substrate.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285482	T14	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MiTek Industries, Inc. Thu Apr 19 13:19:09 2018 Page 1

ID:Uer6HFwTUstfndkBu50kHylEuR-961khlicdLenQB5FOCFuHESoyTOj9pow05j7zzP9Lm

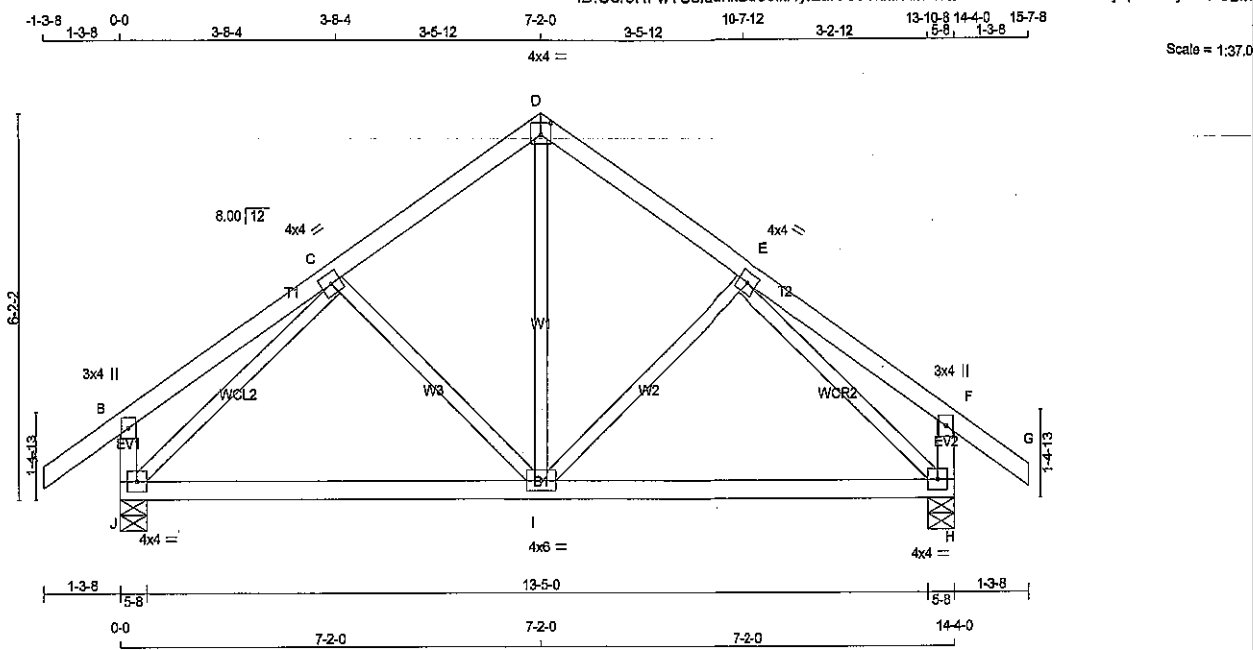

TOTAL WEIGHT = 2 X 62 = 124 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	4.0		
I	BMWW-t	MT20	4.0	6.0		
J	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
J	920	0	920	0	5-8	5-8
H	920	0	920	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	739	437 / 0	151 / 0	0 / 0	0 / 0	152 / 0	0 / 0
H	739	437 / 0	151 / 0	0 / 0	0 / 0	152 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	LC1 (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	I-D	0 / 480	0.10 (1)	
B-C	0 / 19	-84.3	-84.3	0.17 (1)	10.00	I-E	-152 / 44	0.06 (1)	
C-D	-845 / 0	-84.3	-84.3	0.13 (1)	6.25	C-I	-152 / 44	0.06 (1)	
D-E	-845 / 0	-84.3	-84.3	0.13 (1)	6.25	J-C	-879 / 0	0.35 (1)	
E-F	0 / 19	-84.3	-84.3	0.17 (1)	10.00	E-H	-879 / 0	0.35 (1)	
F-G	0 / 32	-84.3	-84.3	0.11 (1)	10.00				
J-B	-232 / 0	0.0	0.0	0.02 (1)	7.81				
H-F	-232 / 0	0.0	0.0	0.02 (1)	7.81				
J-I	0 / 631	-28.0	-28.0	0.49 (2)	10.00				
I-H	0 / 631	-28.0	-28.0	0.49 (2)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.48")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.48")
CALCULATED VERT. DEFL.(TL) = L/898 (0.13")

CSI: TC=0.17/1.00 (E-F:1), BC=0.49/1.00 (H-I:2), WB=0.35/1.00 (E-H:1), SSI=0.17/1.00 (H-I:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (D) (INPUT = 0.90)
JSI METAL= 0.31 (C) (INPUT = 1.00)




DWG NO. TAM 21178-13
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T15	2	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Fri Sep 01 17:31:54 2017 Page 1

ID:w3K2IB2K4fGk9ID07SkJphylfMC-EXSUJpHCC?L079H8Q6sAU3UvJZaucvHL5PN4Ubyhxop

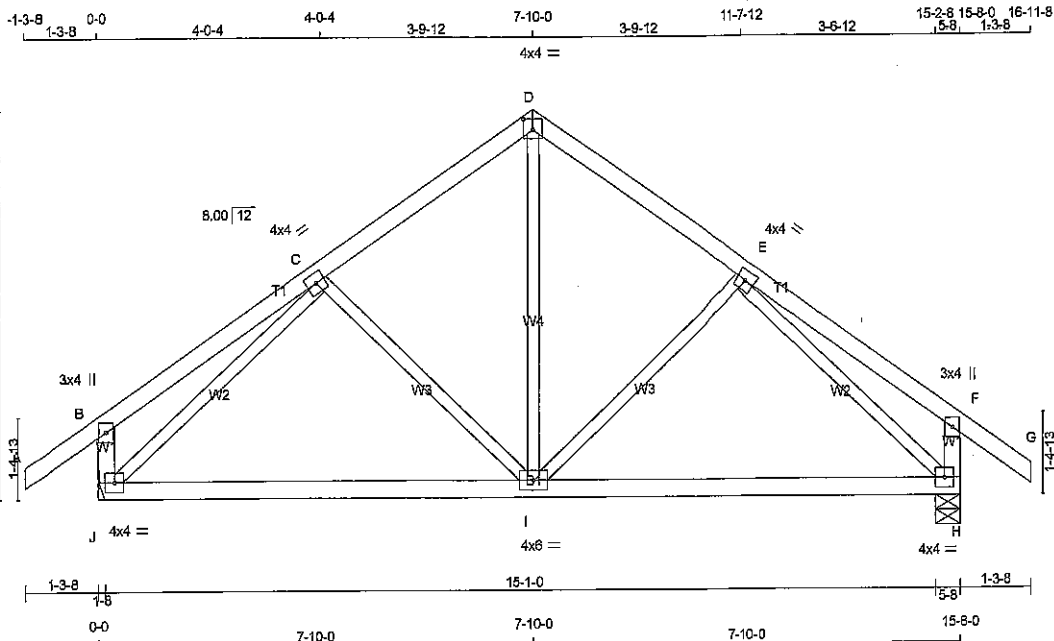

Scale = 1:39.6

TOTAL WEIGHT = 2 X 67 = 134 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	4.0		
I	BMWWW-t	MT20	4.0	6.0		
J	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	UPLIFT
J	995	0	995	0
H	995	0	995	0

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	800	471 / 0	165 / 0	0 / 0	0 / 0	165 / 0	0 / 0
H	800	471 / 0	165 / 0	0 / 0	0 / 0	165 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 32	-84.3 -84.3	0.11 (1)	I-D	0 / 516	0.12 (1)	
B-C	0 / 21	-84.3 -84.3	0.20 (1)	I-E	-179 / 43	0.09 (1)	
C-D	-717 / 0	-84.3 -84.3	0.16 (1)	C-I	-179 / 43	0.09 (1)	
D-E	-717 / 0	-84.3 -84.3	0.16 (1)	J-C	-975 / 0	0.46 (1)	
E-F	0 / 21	-84.3 -84.3	0.20 (1)	E-H	-975 / 0	0.46 (1)	
F-G	0 / 32	-84.3 -84.3	0.11 (1)				
J-B	-243 / 0	0.0 0.0	0.02 (1)				
H-F	-243 / 0	0.0 0.0	0.02 (1)				
J-I	0 / 709	-28.0 -28.0	0.58 (2)				
I-H	0 / 709	-28.0 -28.0	0.58 (2)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	46.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(56 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.52")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (0.52")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.18")

CSI: TC=0.20 (B-C:1), BC=0.58 (H-I:2), WB=0.48 (C-J:1), SSI=0.19 (J-I:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 822 2284 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (D) (INPUT = 0.90)
JSI METAL= 0.35 (C) (INPUT = 1.00)

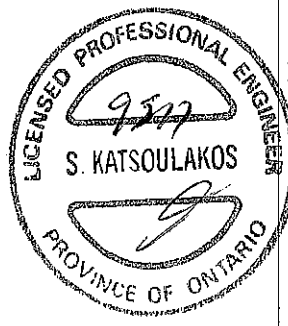


DWG NO. TAM 44536-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	G15	1	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Fri Sep 01 17:31:47 2017 Page 1

ID:w3K2IB2K4fGk9lDO7SkJphylfMC-xBXqrQCprT0g5FmU8EXlahlUkOtTqFJUpBCKVyhXow

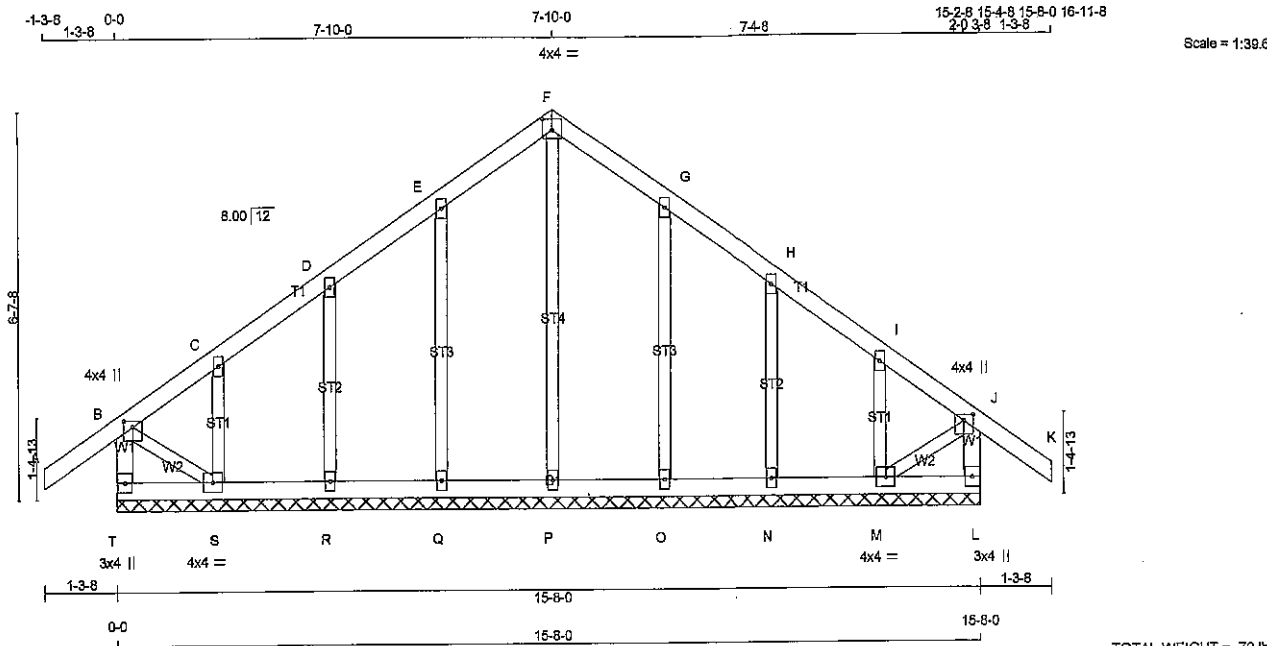

TOTAL WEIGHT = 70 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
T - B	2x4	DRY	No.2	SPF
A - F	2x4	DRY	No.2	SPF
F - K	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
T - L	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C, D, E, G, H, I						
C	TMW+w	MT20	2.0	4.0		
F	TTW+p	MT20	4.0	4.0	2.25	2.00
J	TMVW+p	MT20	4.0	4.0	1.25	2.00
L	BMV1+p	MT20	3.0	4.0		
M	BMVW1-t	MT20	4.0	4.0		
N, O, P, Q, R						
N	BMV1+w	MT20	2.0	4.0		
S	BMVW1-t	MT20	4.0	4.0		
T	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	UNBRACED LENGTH
FR-TO				FR-TO			
T-B	-253 / 0	0.0	0.0 0.03 (1)	7.81	P-F	-129 / 0	0.09 (1)
A-B	0 / 32	-84.3	-84.3 0.11 (1)	10.00	Q-E	-189 / 0	0.08 (1)
B-C	-46 / 0	-84.3	-84.3 0.11 (1)	6.25	R-D	-172 / 0	0.04 (1)
C-D	-15 / 0	-84.3	-84.3 0.04 (1)	6.25	S-C	-108 / 0	0.02 (1)
D-E	-14 / 0	-84.3	-84.3 0.05 (1)	6.25	O-G	-189 / 0	0.08 (1)
E-F	-21 / 0	-84.3	-84.3 0.05 (1)	6.25	N-H	-172 / 0	0.04 (1)
F-G	-21 / 0	-84.3	-84.3 0.05 (1)	6.25	M-I	-108 / 0	0.02 (1)
G-H	-14 / 0	-84.3	-84.3 0.05 (1)	6.25	B-S	0 / 23	0.01 (1)
H-I	-15 / 0	-84.3	-84.3 0.04 (1)	6.25	M-J	0 / 23	0.01 (1)
I-J	-46 / 0	-84.3	-84.3 0.11 (1)	6.25			
J-K	0 / 32	-84.3	-84.3 0.11 (1)	10.00			
L-J	-253 / 0	0.0	0.0 0.03 (1)	7.81			
T-S	0 / 0	-28.0	-28.0 0.03 (2)	10.00			
S-R	0 / 16	-28.0	-28.0 0.03 (2)	10.00			
R-Q	0 / 12	-28.0	-28.0 0.02 (2)	10.00			
Q-P	0 / 9	-28.0	-28.0 0.02 (2)	10.00			
P-O	0 / 9	-28.0	-28.0 0.02 (2)	10.00			
O-N	0 / 12	-28.0	-28.0 0.02 (2)	10.00			
N-M	0 / 16	-28.0	-28.0 0.03 (2)	10.00			
M-L	0 / 0	-28.0	-28.0 0.03 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	46.1	PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.11 (J-K:1), BC=0.03 (R-S:2), WB=0.09 (F-P:1), SSI=0.08 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	818	354	1667
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.80)
JSI METAL= 0.05 (G) (INPUT = 1.00)



DRWG NO. TAM 44590-17
STRUCTURAL
COMPONENT ONLY



DWG NO. TAM 44537-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T30	2	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Fri Sep 01 17:31:54 2017 Page 2

ID:w3K2IB2K4fGk9tD07SkJphyfMC-EXSUJpHCC?L079H6O6sAU3UtgZkQcqlL5PN4Ubyhxop

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
T	7-6-12	-40	-70	—	FRONT	VERT	TOTAL
U	9-6-12	-40	-70	—	FRONT	VERT	TOTAL
V	13-6-12	-40	-70	—	FRONT	VERT	TOTAL




162
DWG NO. TAM44538-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T31	2	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Fri Sep 01 17:31:55 2017 Page 1
ID:w3K2IB2K4fGk9iDO7SkJphyfMC-ik0sW9lqzJTtdJslpNP1G00cz3rLQFVJ37d01yhxo0

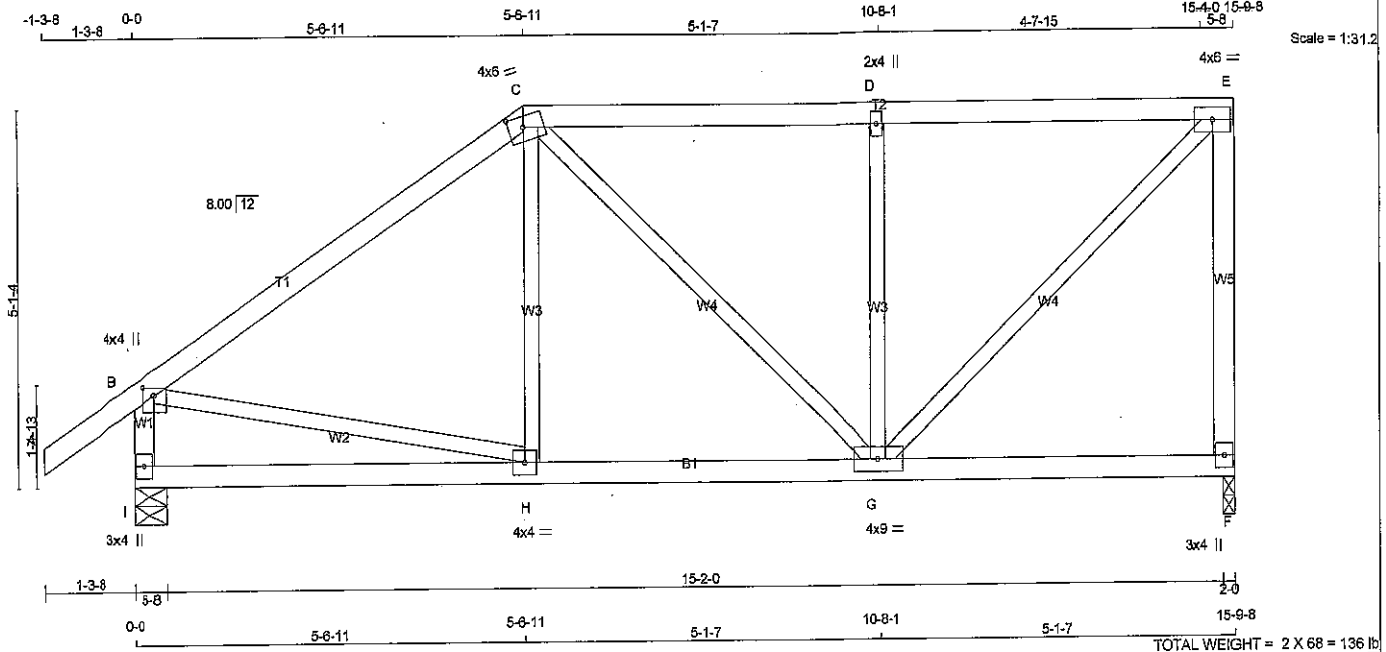

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - B	2x4	DRY	No.2
I - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTWW-m	MT20	4.0	6.0	1.75	2.50
D	TMVW-w	MT20	2.0	4.0		
E	TMVW-l	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMVWW-l	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
F	886	0	886	0	0	2-0	2-0	2-0	2-0
I	1002	0	1002	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
F	728	404 / 0	156 / 0	0 / 0	0 / 0	156 / 0	0 / 0
I	806	474 / 0	166 / 0	0 / 0	0 / 0	166 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.96 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 (LC)	MAX. UNBRACED LENGTH	FR-TO	MEMB.	FORCE (LBS)	MAX. UNBRACED LENGTH	FR-TO
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	H-C	0 / 222	0.05 (3)	
B-C	-821 / 0	-84.3	-84.3	0.49 (1)	5.96	C-G	-23 / 33	0.02 (3)	
C-D	-707 / 0	-84.3	-84.3	0.38 (1)	6.25	G-D	-532 / 0	0.20 (1)	
D-E	-707 / 0	-84.3	-84.3	0.38 (1)	6.25	G-E	0 / 987	0.22 (1)	
F-E	-826 / 0	0.0	0.0	0.36 (1)	7.81	B-H	0 / 695	0.16 (1)	
I-B	-937 / 0	0.0	0.0	0.10 (1)	7.81				
I-H	0 / 0	-28.0	-28.0	0.19 (3)	10.00				
H-G	0 / 683	-28.0	-28.0	0.28 (2)	10.00				
G-F	0 / 0	-28.0	-28.0	0.16 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/699 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/699 (0.07")

CSI: TC=0.49 (B-C:1), BC=0.28 (G-H:2), WB=0.22 (E-G:1), SSI=0.21 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.90)
JSI METAL= 0.28 (H) (INPUT = 1.00)

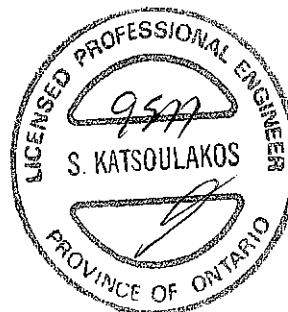


DWG NO. TAM 44539-17
STRUCTURAL
COMPONENT ONLY

JOB NAME 285481	TRUSS NAME T32	QUANTITY 2	PLY 1	JOB DESC. TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mittek Industries, Inc. Fri Sep 01 17:31:55 2017 Page 1
ID:w3K2IB2K4fGk8DO7SkJphyfMC-k0sV9lqzJTtdJsljypNP1G0_tz2HLOjVJ37d01yhxoo

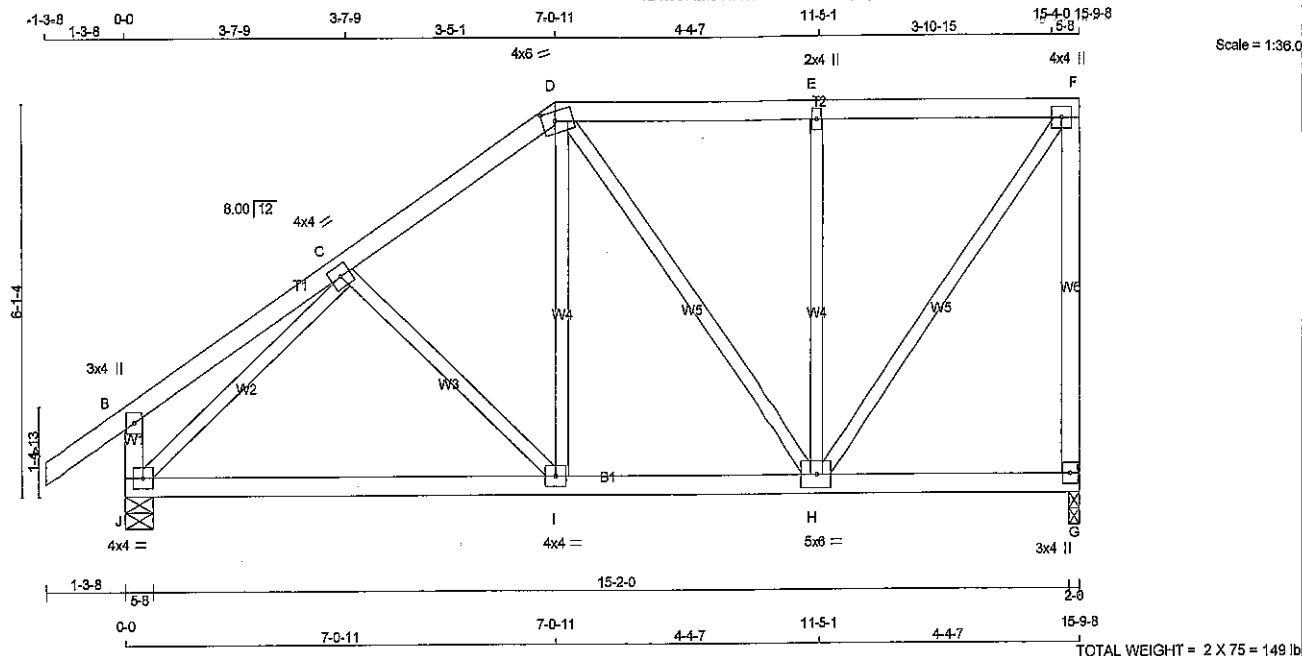

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTWW-m	MT20	4.0	6.0	1.75	2.50
E	TMV+w	MT20	2.0	4.0		
F	TMVW+p	MT20	4.0	4.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMWWW-t	MT20	5.0	6.0		
I	BMWW-t	MT20	4.0	4.0		
J	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
G	886	0	886	0	0	2-0	2-0	5-8	5-8
J	1002	0	1002	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX / MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
G	728	404 / 0	166 / 0	0 / 0	158 / 0	0 / 0
J	806	474 / 0	166 / 0	0 / 0	166 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CS1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 32	-84.3	-84.3 0.11 (1)	10.00	C-I	-127 / 52	0.05 (1)
B-C	0 / 18	-84.3	-84.3 0.16 (1)	10.00	I-D	0 / 348	0.08 (2)
C-D	-758 / 0	-84.3	-84.3 0.17 (1)	6.25	D-H	-188 / 0	0.17 (2)
D-E	-522 / 0	-84.3	-84.3 0.27 (1)	6.25	H-E	-453 / 0	0.27 (1)
E-F	-522 / 0	-84.3	-84.3 0.27 (1)	6.25	H-F	0 / 864	0.19 (1)
G-F	-831 / 0	0.0	0.0 0.60 (1)	7.81	J-C	-987 / 0	0.38 (1)
J-B	-231 / 0	0.0	0.0 0.02 (1)	7.81			
J-I	0 / 707	-28.0	-28.0 0.38 (2)	10.00			
I-H	0 / 619	-28.0	-28.0 0.38 (2)	10.00			
H-G	0 / 0	-28.0	-28.0 0.13 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 085-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.80 (F-G), BC=0.38 (H-I), WB=0.38 (C-J), SI=0.18 (E-F)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 615 354 1667 822 2284 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (F) (INPUT = 0.90)
JSI METAL= 0.35 (C) (INPUT = 1.00)



BOWN. TAM 4454017
STRUCTURAL
COMPONENT ONLY

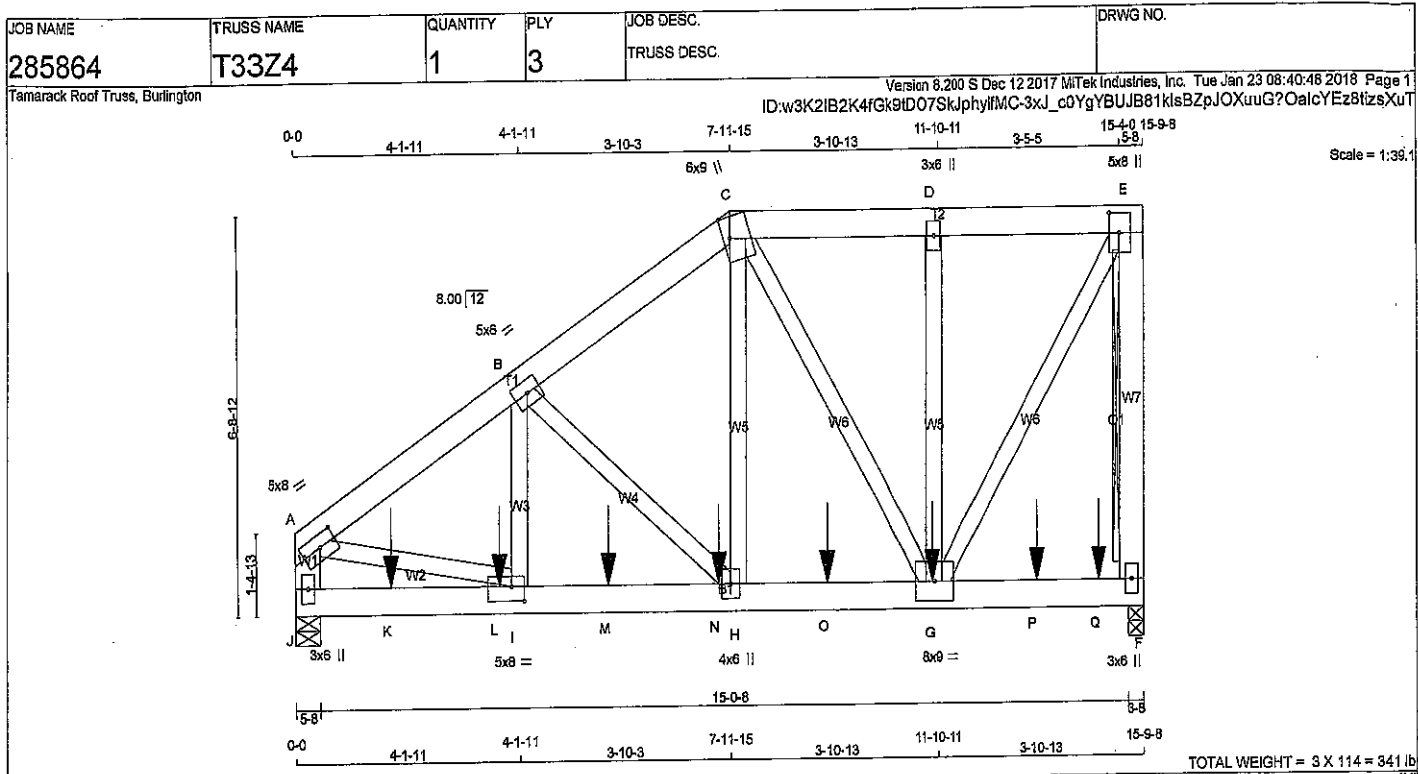

LUMBER				DESCR.	
N. L. G. A. RULES					
CHORDS	SIZE	DRY	LUMBER	SPF	
A - C	2x8	DRY	No.2	SPF	
C - E	2x6	DRY	No.2	SPF	
F - E	2x6	DRY	No.2	SPF	
J - A	2x8	DRY	No.2	SPF	
J - F	2x6	DRY	2100F 1.8E	SPF	
ALL WEBS 2x4 DRY No.2				SPF	
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - C	2 12	TOP
C - E	2 12	TOP
E - F	2 12	TOP
J - A	2 12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
J - F	2 7	SIDE (893.7)
WEBS: (0.122"x3") SPIRAL NAILS		
2x4	1 6	

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	3.0	8.0	2.50	3.75
B	TMVW-I	MT20	5.0	6.0		
C	TTVW+m	MT20	8.0	9.0	4.25	1.50
D	TMVW+w	MT20	3.0	6.0		
E	TMVW+p	MT20	5.0	8.0	4.00	2.25
F	BMV1+p	MT20	3.0	6.0		
G	BMVWV-I	MT20	8.0	9.0		
H	BMVWV-I	MT20	4.0	6.0		
I	BMVW-I	MT20	5.0	8.0	3.00	2.75
J	BMV1+p	MT20	3.0	6.0		

HANGERS NOTES

1)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG UPLIFT	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
F	8425	0	8425	0	3-8	3-8
J	7250	0	7250	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM.LIVE	WIND			
F	6863	3898 / 0	1505 / 0	0 / 0	1480 / 0	0 / 0	0 / 0
J	5882	3379 / 0	1264 / 0	0 / 0	1239 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.97 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x8 DRY SPF No.2 T-BRACE AT E-F

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.
FR-TO		FROM TO		FR-TO			
A-B	-8297 / 0	-84.3 -84.3	0.09 (1)	4.97	I-B	0 / 2688	0.14 (1)
B-C	-8004 / 0	-84.3 -84.3	0.07 (1)	5.65	B-H	-2573 / 0	0.28 (1)
C-D	-4034 / 0	-84.3 -84.3	0.05 (1)	6.25	H-C	0 / 4732	0.25 (1)
D-E	-4034 / 0	-84.3 -84.3	0.04 (1)	6.25	C-G	-2055 / 0	0.46 (1)
E-F	-6509 / 0	0.0 0.0	0.28 (1)	7.81	G-D	-276 / 20	0.04 (1)
J-A	-6286 / 0	0.0 0.0	0.13 (1)	7.01	G-E	0 / 7355	0.39 (1)
					A-I	0 / 7052	0.38 (1)
J-K	0 / 0	-28.0 -28.0	0.20 (1)	10.00			
K-L	0 / 0	-28.0 -28.0	0.20 (1)	10.00			
L-I	0 / 0	-28.0 -28.0	0.20 (1)	10.00			
I-M	0 / 6892	-28.0 -28.0	0.26 (1)	10.00			
M-N	0 / 6892	-28.0 -28.0	0.26 (1)	10.00			
N-H	0 / 6892	-28.0 -28.0	0.26 (1)	10.00			
H-O	0 / 5105	-28.0 -28.0	0.24 (1)	10.00			
O-G	0 / 5105	-28.0 -28.0	0.24 (1)	10.00			
G-P	0 / 302	-28.0 -28.0	0.23 (1)	10.00			
P-Q	0 / 302	-28.0 -28.0	0.23 (1)	10.00			
Q-F	0 / 302	-28.0 -28.0	0.23 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TOTAL
G	11-9-4	-1712	-1712	FRONT	VERT	TOTAL
K	1-9-4	-1826	-1826	FRONT	VERT	TOTAL
L	3-9-4	-1826	-1826	FRONT	VERT	TOTAL
M	5-9-4	-1712	-1712	FRONT	VERT	TOTAL
N	7-9-4	-1712	-1712	FRONT	VERT	TOTAL
O	9-9-4	-1712	-1712	FRONT	VERT	TOTAL
P	13-9-4	-1712	-1712	FRONT	VERT	TOTAL
Q	14-11-4	-1714	-1714	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 3.0	PSF
BOT CH.	LL	= 10.5	PSF
	DL	= 7.0	PSF
TOTAL LOAD		= 46.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.53")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.53")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.26/1.00 (E-F:1), BC=0.26/1.00 (H-I:1), WB=0.46/1.00 (C-G:1), SSI=0.59/1.00 (J-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	818	354
MT20	1667	822
MT20	2284	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.52 (A) (INPUT = 1.00)

DWG NO. TAM 5091-18
STRUCTURAL
COMPONENT ONLY

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285864	T33Z4	1	3	TRUSS DESC.	

Tamarack Roof Truss, Burlington


Version 8.200 8 Dec 12 2017 MiTek Industries, Inc. Tue Jan 23 09:40:49 2018 Page 2
ID:w3K2IB2K4fGk9tD07SkJphylfMC-X8tMqMYUJvCaoIcwsajomVWxlelcE71YmnuihQ8zsXus

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1826.2 lbs FACTORED DOWN AT 1-9-4, 1826.2 lbs FACTORED DOWN AT 3-9-4, 1711.9 lbs FACTORED DOWN AT 5-9-4, 1711.9 lbs FACTORED DOWN AT 7-9-4, 1711.9 lbs FACTORED DOWN AT 9-9-4, 1711.9 lbs FACTORED DOWN AT 11-9-4, AND 1711.9 lbs FACTORED DOWN AT 13-9-4, AND 1714.0 lbs FACTORED DOWN AT 14-11-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

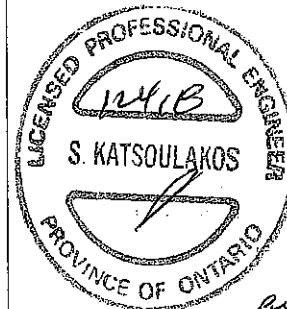

DWG NO. TAM 5091 -88
STRUCTURAL
COMPONENT ONLY

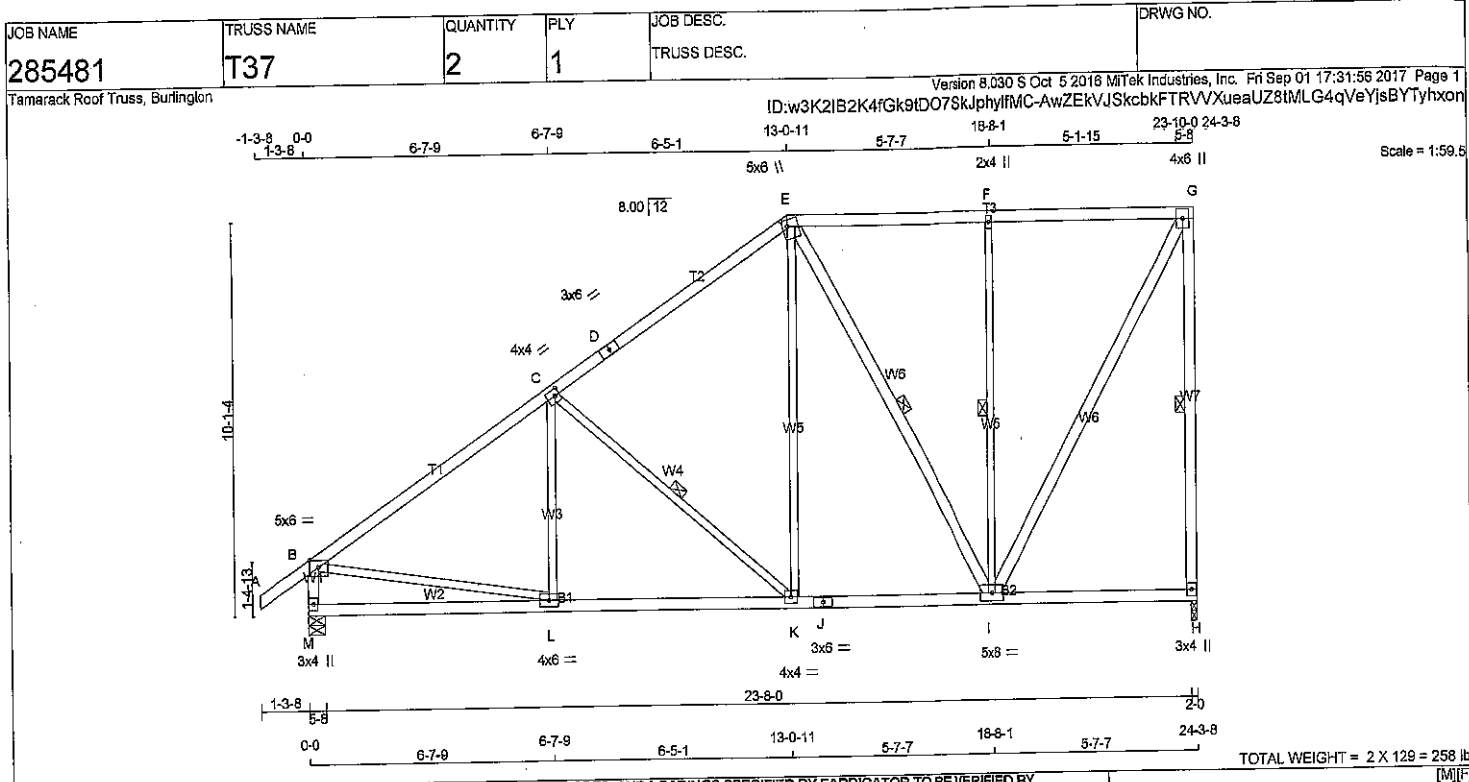

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

EXCEPT

E - I 2x4 DRY No.2

I - G 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMVW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTWW+m	MT20	5.0	6.0	2.00	1.50
F	TMVW-w	MT20	2.0	4.0		
G	TMVW+p	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		
I	BMVWW-t	MT20	5.0	8.0		
J	BS-t	MT20	3.0	6.0		
K	BMVWW-t	MT20	4.0	4.0		
L	BMVWW-t	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
			DOWN	UP	DOWN	UP		
H	1363	0	1363	0	0	2-0	2-0	5-8
M	1479	0	1479	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE			
H	1119	621 / 0	255 / 0	0 / 0	243 / 0	0 / 0
M	1198	692 / 0	255 / 0	0 / 0	251 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.66 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, C-K, E-I, F-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LC)	FACTORED HORZ. LOAD (LC)
FR-TO				FR-TO			
A-B	0 / 32	-84.3	-84.3 0.11 (1)	L-C	-1 / 267	0.06 (3)	0.30 (1)
B-C	-1522 / 0	-84.3	-84.3 0.55 (1)	C-K	-594 / 0	0.12 (2)	0.29 (1)
C-D	-1051 / 0	-84.3	-84.3 0.49 (1)	K-E	0 / 545	0.12 (2)	0.29 (1)
D-E	-1051 / 0	-84.3	-84.3 0.49 (1)	E-I	-412 / 0	0.21 (1)	0.41 (1)
E-F	-844 / 0	-84.3	-84.3 0.34 (1)	I-F	-586 / 0	0.21 (1)	0.30 (1)
F-G	-845 / 0	-84.3	-84.3 0.34 (1)	I-G	0 / 1290	0.21 (1)	0.30 (1)
G-H	-1299 / 0	0.0	0.0 0.65 (1)	B-L	0 / 1314	0.30 (1)	
M-B	-1404 / 0	0.0	0.0 0.14 (1)				
M-L	0 / 0	-28.0	-28.0 0.31 (3)				
L-K	0 / 1296	-28.0	-28.0 0.46 (2)				
K-J	0 / 848	-28.0	-28.0 0.31 (2)				
J-I	0 / 848	-28.0	-28.0 0.31 (2)				
I-H	0 / 0	-28.0	-28.0 0.21 (3)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. G/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.81")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.08")
ALLOWABLE DEFL.(TL) = $L/360$ (0.81")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.14")

CSI: TC=0.65 (G-H:1), BC=0.46 (K-L:2), WB=0.41 (F-I:1), SSI=0.23 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	518	354	1667
	822	2284	1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.83 (L) (INPUT = 0.90)
JSI METAL= 0.32 (L) (INPUT = 1.00)



DWG NO. TAN 44542-17
STRUCTURAL
COMPONENT ONLY



100% 90% 80% 70% 60% 50% 40% 30% 20% 10% 0%

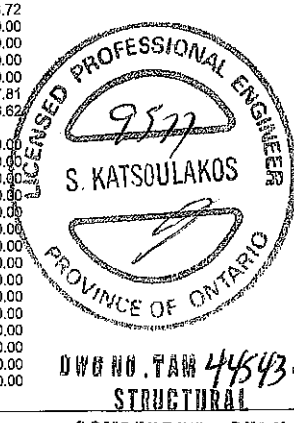

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T40	1	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MITek Industries, Inc. Fri Sep 01 17:31:56 2017 Page 2

ID:w3K2IB2K4fGk9tD07SkJphyfMC-AwZEKvJSkcbkFTRVVXueaUZAHMJD4nFeYjsBYTyhxn

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	4-0-11	-23	-25	---	FRONT	VERT	DEAD
C	4-0-11	-222	-222	---	FRONT	VERT	SNOW
E	13-8-12	-101	-101	---	FRONT	VERT	TOTAL
F	17-8-12	-101	-101	---	FRONT	VERT	TOTAL
I	17-8-12	-40	-70	---	FRONT	VERT	TOTAL
J	15-8-12	-40	-70	---	FRONT	VERT	TOTAL
N	3-8-12	-130	-130	---	FRONT	VERT	TOTAL
O	5-8-12	-101	-101	---	FRONT	VERT	TOTAL
P	7-8-12	-101	-101	---	FRONT	VERT	TOTAL
Q	9-8-12	-101	-101	---	FRONT	VERT	TOTAL
R	11-8-12	-101	-101	---	FRONT	VERT	TOTAL
S	15-8-12	-101	-101	---	FRONT	VERT	TOTAL
T	19-8-12	-101	-101	---	FRONT	VERT	TOTAL
U	21-8-12	-101	-101	---	FRONT	VERT	TOTAL
V	23-8-12	-113	-113	---	FRONT	VERT	TOTAL
W	1-8-12	-40	-70	---	FRONT	VERT	TOTAL
X	3-8-12	-40	-70	---	FRONT	VERT	TOTAL
Y	5-8-12	-40	-70	---	FRONT	VERT	TOTAL
Z	7-8-12	-40	-70	---	FRONT	VERT	TOTAL
AA	9-8-12	-40	-70	---	FRONT	VERT	TOTAL
AB	11-8-12	-40	-70	---	FRONT	VERT	TOTAL
AC	13-8-12	-40	-70	---	FRONT	VERT	TOTAL
AD	19-8-12	-40	-70	---	FRONT	VERT	TOTAL
AE	21-8-12	-40	-70	---	FRONT	VERT	TOTAL
AF	23-8-12	-44	-77	---	FRONT	VERT	TOTAL



DWG NO. TAM 44543-17
STRUCTURAL
COMPONENT ONLY

DRWG NO.

ID:w3K2iB2K4fGk9ID07SkJphylfMC-AwZEKvJSkcbkFTRVWXueaUZA?MMU4qaeYjsBYTyhxon



JSI GRIP= 0.89 (K) (INPUT = 0.90)
JSI METAL= 0.44 (J) (INPUT = 1.00)

DWG NO. TAM 44544-17
STRUCTURAL
COMPONENT ONLY


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T41A	1	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Fri Sep 01 17:31:57 2017 Page 1

ID:w3K2IB2K4fGk9tDO7SkJphyfMC-e67cxrK4Vwjsd0h3EPt8h6LnmikpHuonNck5wyhxm

23-9-8 24-3-0

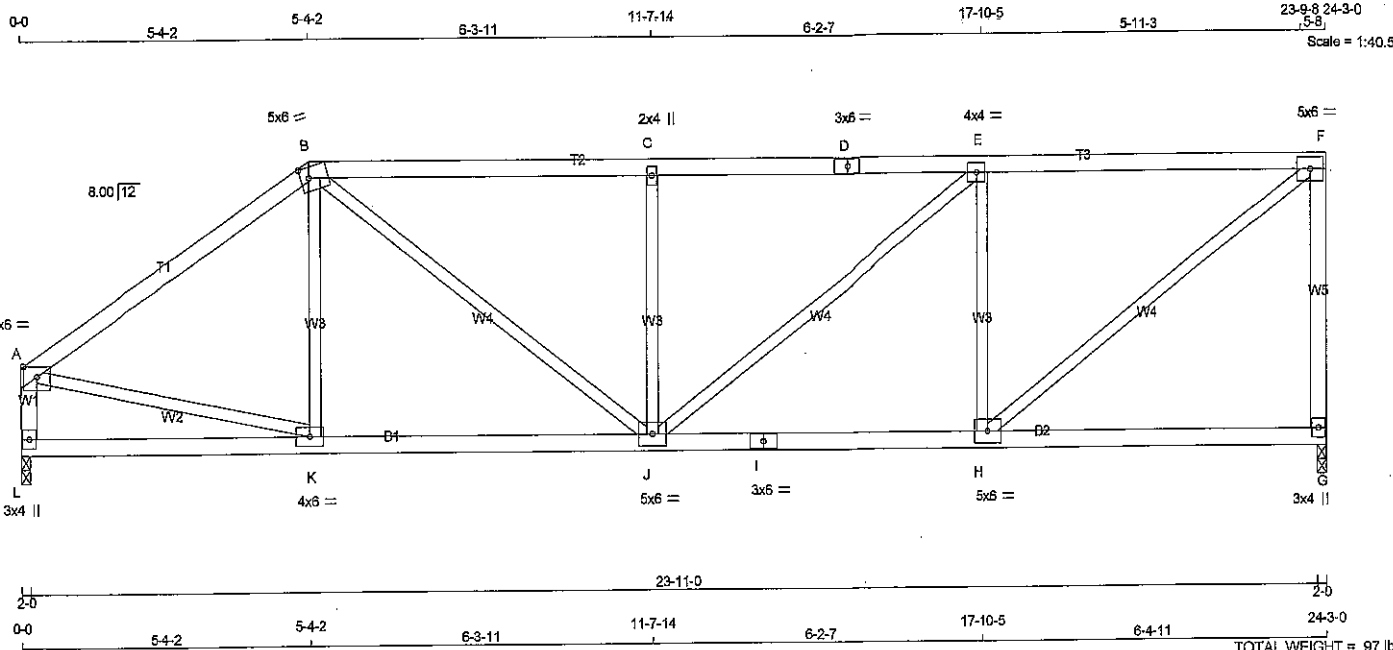

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
L - A	2x4	DRY	No.2	SPF	
L - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	6.0	Edge	
B	TTWW-m	MT20	5.0	6.0	2.25	1.75
C	TMW+w	MT20	2.0	4.0		
D	TS-t	MT20	3.0	6.0		
E	TMVW-t	MT20	4.0	4.0		
F	TMVW-t	MT20	5.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMVW-t	MT20	5.0	6.0		
I	BS-t	MT20	3.0	6.0		
J	BMVW-t	MT20	5.0	6.0		
K	BMVW-t	MT20	4.0	6.0		
L	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
G	1361	0	1361	0
L	1361	0	1361	0

UNFACTORED REACTIONS

JT	1ST LGASE	MAX./MIN.	COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	1118	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0
L	1118	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.33 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	-1451 / 0	-84.3	-84.3 0.50 (1)	4.82	K-B	-85 / 181	0.04 (3)
B-C	-1791 / 0	-84.3	-84.3 0.56 (1)	4.36	A-K	0 / 1235	0.28 (1)
C-D	-1792 / 0	-84.3	-84.3 0.57 (1)	4.33	H-F	0 / 1780	0.40 (1)
D-E	-1792 / 0	-84.3	-84.3 0.57 (1)	4.33	B-J	0 / 738	0.17 (1)
E-F	-1422 / 0	-84.3	-84.3 0.54 (1)	4.79	H-E	-870 / 0	0.33 (1)
G-F	-1269 / 0	0.0	0.0 0.57 (1)	7.10	J-C	-571 / 0	0.22 (1)
L-A	-1302 / 0	0.0	0.0 0.14 (1)	7.08	J-E	0 / 468	0.11 (1)
L-K	0 / 0	-28.0	-28.0 0.23 (3)	10.00			
K-J	0 / 1204	-28.0	-28.0 0.38 (2)	10.00			
J-I	0 / 1422	-28.0	-28.0 0.44 (2)	10.00			
I-H	0 / 1422	-28.0	-28.0 0.44 (2)	10.00			
H-G	0 / 0	-28.0	-28.0 0.28 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6	PSF
	DL	= 3.0	PSF
BOT CH.	LL	= 10.5	PSF
	DL	= 7.0	PSF
TOTAL LOAD		= 48.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/989 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/998 (0.14")

CSI: TC=0.57 (C-E:1), BC=0.44 (H-J:2), WB=0.40 (F-H:1), SSI=0.25 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1657
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (K) (INPUT = 0.90)

JSI METAL= 0.44 (I) (INPUT = 1.00)




DRWG. TAM 44545-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285815	T42A	1	1	TRUSS DESC.	

Tamara Roof Truss, Burlington

Version 8.2008 Dec 12 2017 MITek Industries, Inc. Tue Jan 23 08:29:10 2018 Page 1
ID:w3K2IB2K4fGk9D07SkJphY6MC-V767L5rwkYLRtgaPGuX9U6SX7nr3t2eIC09zsY3N

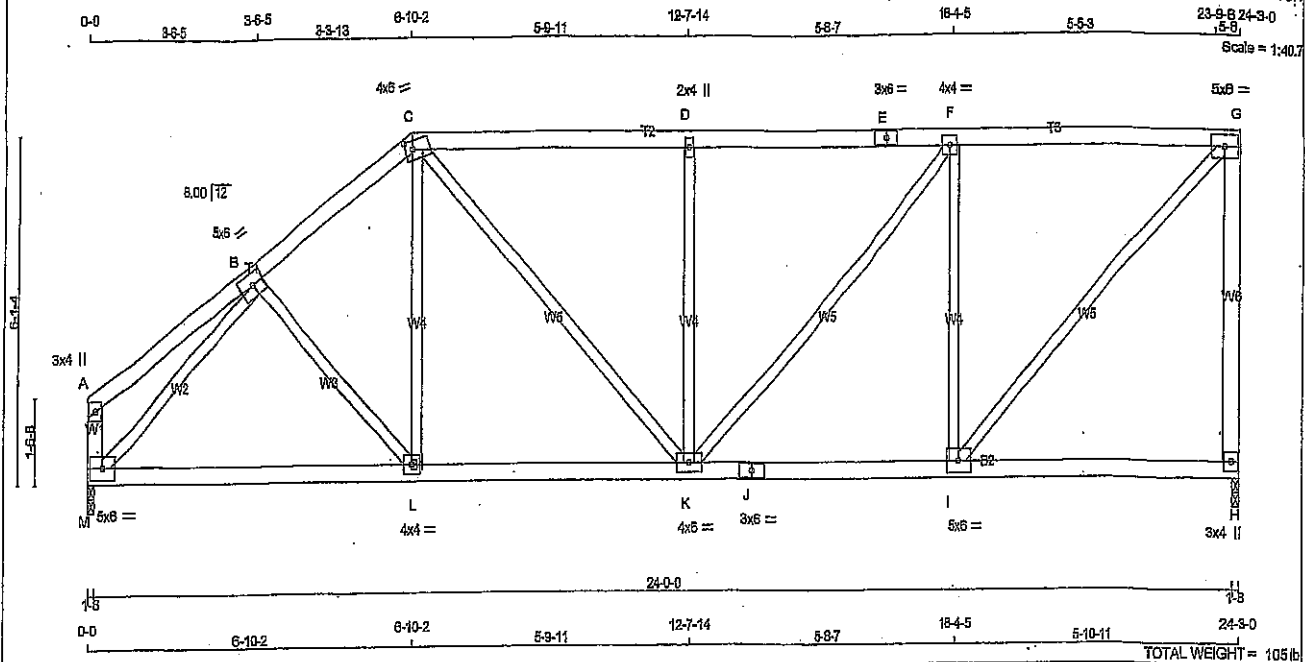

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - A	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY, SEASONED LUMBER.			

PLATES (table in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
B	TMWW-1	MT20	5.0	6.0
C	TTWW-m	MT20	4.0	6.0
D	TMWW-w	MT20	2.0	4.0
E	TS-t	MT20	3.0	6.0
F	TMWW-1	MT20	4.0	4.0
G	TMWW-1	MT20	5.0	6.0
H	BMV1+p	MT20	3.0	4.0
I	BMWW-1	MT20	5.0	6.0
J	BS-1	MT20	3.0	6.0
K	BMWWWW-1	MT20	4.0	6.0
L	BMWW-1	MT20	4.0	4.0
M	BMWW1-1	MT20	5.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
H	1391	0	1391	0	0	1-3	1-3	1-3	1-3
M	1391	0	1391	0	0	1-3	1-3	1-3	1-3

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	1118	620/0	255/0	0/0	0/0	242/0	0/0
M	1118	620/0	255/0	0/0	0/0	242/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/17	-84.3	-84.3 0.14 (1)	10.00	B-L	0/134	0.03 (3)
B-C	-1430/0	-84.3	-84.3 0.17 (1)	5.28	L-C	0/279	0.05 (2)
C-D	-1471/0	-84.3	-84.3 0.44 (1)	4.88	M-B	-1633/0	0.82 (1)
D-E	-1471/0	-84.3	-84.3 0.45 (1)	4.85	I-G	0/1558	0.35 (1)
E-F	-1471/0	-84.3	-84.3 0.45 (1)	4.85	C-K	0/415	0.09 (1)
F-G	-1109/0	-84.3	-84.3 0.43 (1)	5.43	I-F	-908/0	0.53 (1)
H-G	-1285/0	0.0	0.0 0.93 (1)	7.10	K-D	-525/0	0.31 (1)
M-A	-114/0	0.0	0.0 0.01 (1)	7.81	K-F	0/517	0.12 (1)
M-L	0/1141	-28.0	-28.0 0.43 (2)	10.00			
L-K	0/1177	-28.0	-28.0 0.45 (2)	10.00			
K-J	0/1109	-28.0	-28.0 0.37 (2)	10.00			
J-I	0/1109	-28.0	-28.0 0.37 (2)	10.00			
I-H	0/0	-28.0	-28.0 0.24 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2012, CBC 2012, ABC 2014
- CSA 066-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 9.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFLL (LL) = 1/360 (0.81")
CALCULATED VERT. DEFLL (LL) = 1/999 (0.10")
ALLOWABLE DEFLL (TL) = 1/360 (0.81")
CALCULATED VERT. DEFLL (TL) = 1/699 (0.17")

CS: TC=0.63/1.00 (G-H:1), BC=0.45/1.00 (K-L:2), WB=0.62/1.00 (B-M:1), SS=0.23/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.60

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1887
	822	2284	1858


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.86 (C) (INPUT = 0.80)
JSI METAL= 0.40 (B) (INPUT = 1.00)

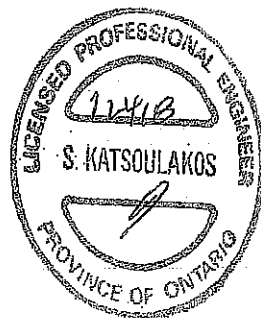

DRWG NO. TAM 5073 -18
STRUCTURAL
COMPONENT ONLY

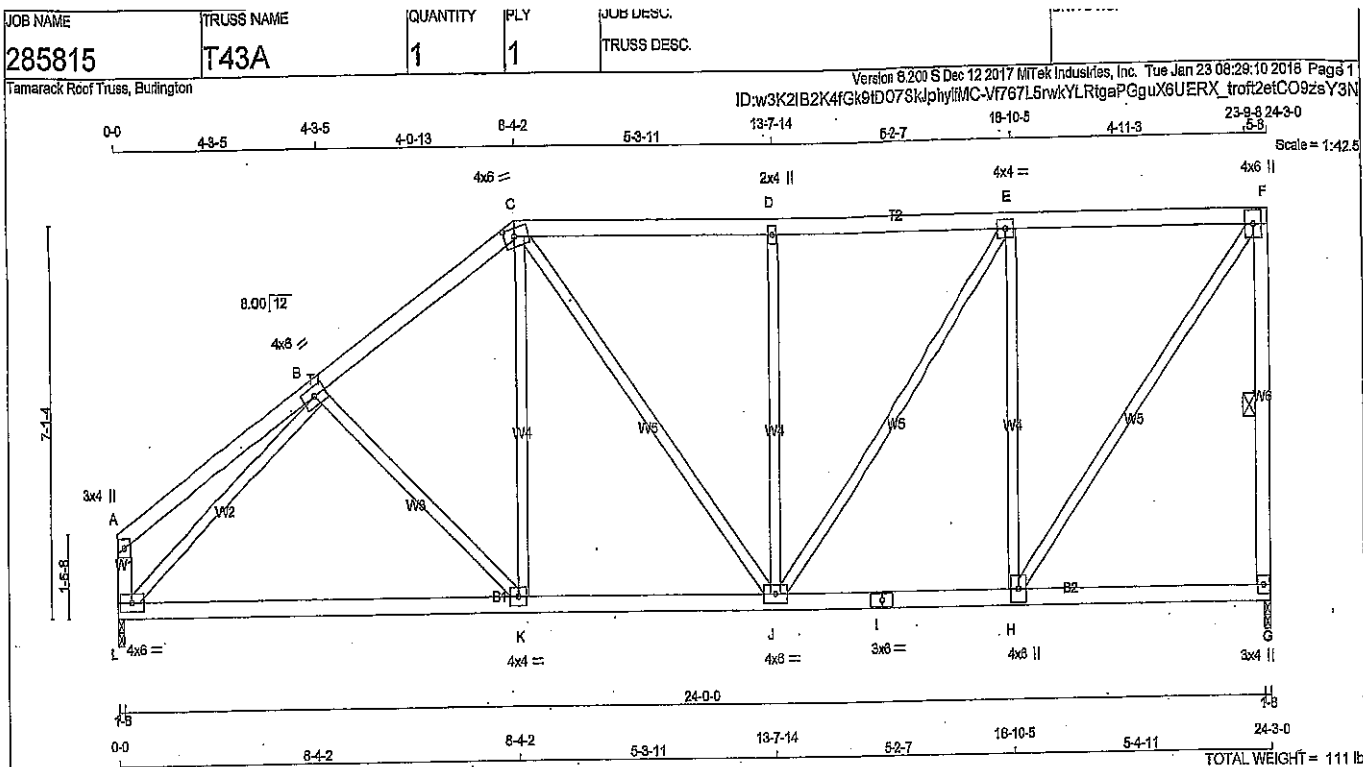

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
A - C	2x4 DRY	No.2	SPF	
C - F	2x4 DRY	No.2	SPF	
G - F	2x4 DRY	No.2	SPF	
L - A	2x4 DRY	No.2	SPF	
L - I	2x4 DRY	No.2	SPF	
I - G	2x4 DRY	No.2	SPF	
ALL WEBS	2x3 DRY	No.2	SPF	
EXCEPT				
DRY, SEASONED LUMBER.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
B	TMWW-t	MT20	4.0	8.0
C	TTWW-m	MT20	4.0	8.0 1.75 2.50
D	TMWW-w	MT20	2.0	4.0
E	TMWW-t	MT20	4.0	4.0
F	TMWW-p	MT20	4.0	6.0
G	BMV1+p	MT20	3.0	4.0
H	BMWW-t	MT20	4.0	8.0
I	BS-t	MT20	3.0	6.0
J	BMWW-t	MT20	4.0	8.0
K	BMWW-t	MT20	4.0	4.0
L	BMWW-t	MT20	4.0	8.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
G	1361	0	1361	0	1-8
L	1361	0	1361	0	1-8

UNFACTORED REACTIONS		1ST CASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
G	1118	620 / 0	255 / 0
L	1118	620 / 0	255 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)
MEMB.	FR-TO				
A-B	0 / 22	-84.3	-84.3	0.23 (1)	10.00
B-C	-1369 / 0	-84.3	-84.3	0.27 (1)	5.25
C-D	-1227 / 0	-84.3	-84.3	0.35 (1)	5.36
D-E	-1227 / 0	-84.3	-84.3	0.36 (1)	5.33
E-F	-684 / 0	-84.3	-84.3	0.34 (1)	6.05
G-F	-1302 / 0	0.0	0.0	0.30 (1)	5.66
L-A	-136 / 0	0.0	0.0	0.01 (1)	7.61
L-K	0 / 1176	-28.0	-28.0	0.56 (2)	10.00
K-J	0 / 1124	-28.0	-28.0	0.57 (2)	10.00
J-I	0 / 884	-28.0	-28.0	0.32 (2)	10.00
I-H	0 / 884	-28.0	-28.0	0.32 (2)	10.00
H-G	0 / 0	-28.0	-28.0	0.21 (3)	10.00



DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-08
- TFC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.81")
CALCULATED VERT. DEFL.(LL) = 1/899 (0.21")
ALLOWABLE DEFL.(TL) = 1/360 (0.81")
CALCULATED VERT. DEFL.(TL) = 1/853 (0.34")

CSI: TC=0.36/1.00 (D-E:1), BC=0.57/1.00 (J-K:2),
WB=0.60/1.00 (B-L:1), SS=0.21/1.00 (E-F:1)

DDL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	616	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.90)
JSI METAL= 0.40 (B) (INPUT = 1.00)

DWG NO. TAM5074-B
STRUCTURAL
COMPONENT ONLY

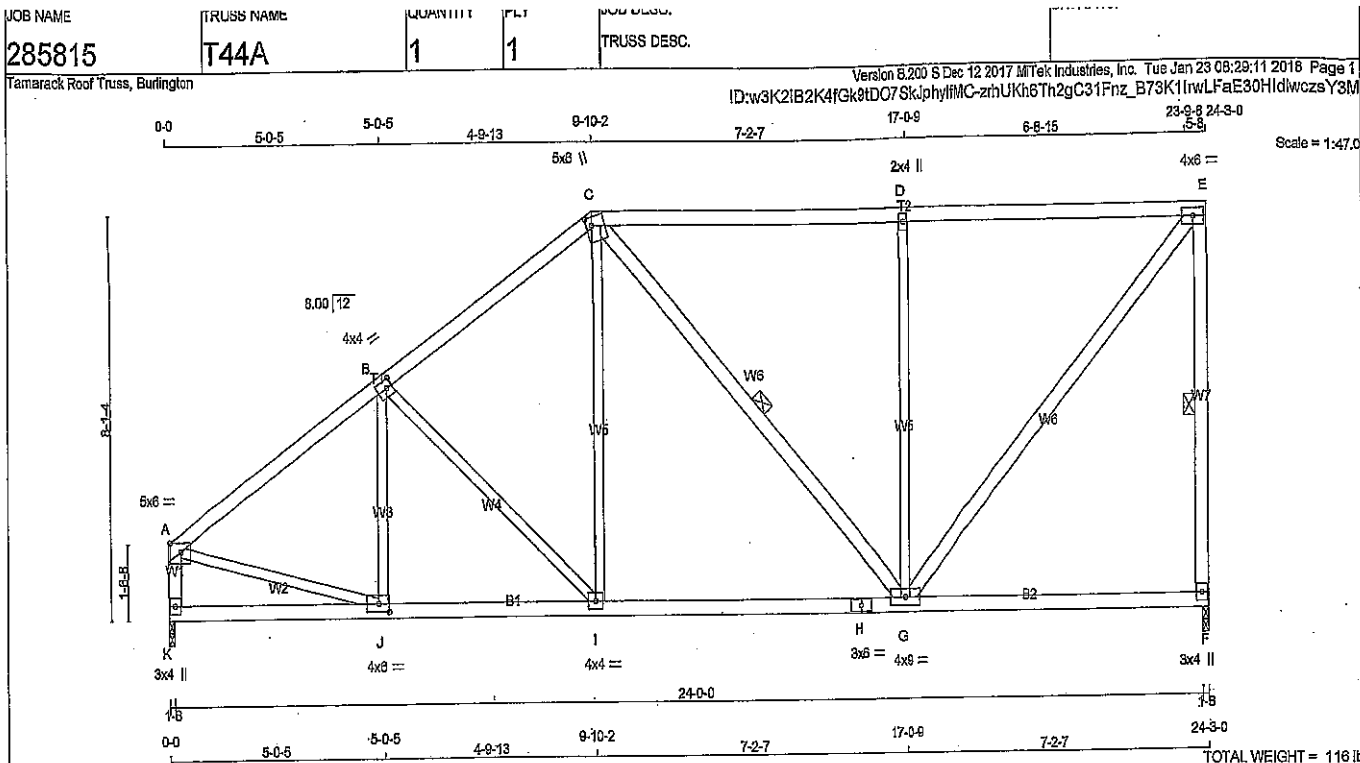

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
K - A	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
C - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	5.0	8.0	Edge	
B	TMVW-l	MT20	4.0	4.0	2.00	1.50
C	TTWW+m	MT20	5.0	6.0	2.00	1.50
D	TMVW+w	MT20	2.0	4.0		
E	TMVW-l	MT20	4.0	6.0		
F	BMVl+hp	MT20	3.0	4.0		
G	BMVWW-l	MT20	4.0	9.0		
H	BS-l	MT20	3.0	6.0		
I	BMVW-l	MT20	4.0	4.0		
J	BMVW-l	MT20	4.0	8.0	2.00	2.75
K	BMVl+hp	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
F	1381	0	1-8	1-8
K	1381	0	1-8	1-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
F	1118	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0
K	1118	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.74 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, C-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

FR-TO	CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRACED LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	LC1
A-B	-1477 / 0		-84.3	-84.3	0.40 (1)	4.93	J-B	-158 / 110		0.06 (1)	
B-C	-1264 / 0		-84.3	-84.3	0.38 (1)	5.24	B-I	-307 / 0		0.28 (1)	
C-D	-973 / 0		-84.3	-84.3	0.83 (1)	4.74	I-C	0 / 419		0.09 (2)	
D-E	-973 / 0		-84.3	-84.3	0.83 (1)	4.74	C-G	-87 / 0		0.05 (1)	
F-E	-1281 / 0		0.0	0.0	0.38 (1)	5.70	G-D	-754 / 0		0.95 (1)	
K-A	-1301 / 0		0.0	0.0	0.14 (1)	7.08	G-E	0 / 1431		0.23 (1)	
							A-J	0 / 1268		0.29 (1)	
K-J	0 / 0		-28.0	-28.0	0.15 (3)	10.00					
J-I	0 / 1252		-28.0	-28.0	0.33 (2)	10.00					
I-H	0 / 1032		-28.0	-28.0	0.50 (2)	10.00					
H-G	0 / 1032		-28.0	-28.0	0.50 (2)	10.00					
G-F	0 / 0		-28.0	-28.0	0.38 (3)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/380 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.63/1.00 (D-E:1), BC=0.50/1.00 (G-I:2), WB=0.85/1.00 (D-G:1), GS=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 822 2284 1655


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.41 (H) (INPUT = 1.00)



DWG NO. TAM 5075 -18
STRUCTURAL
COMPONENT ONLY

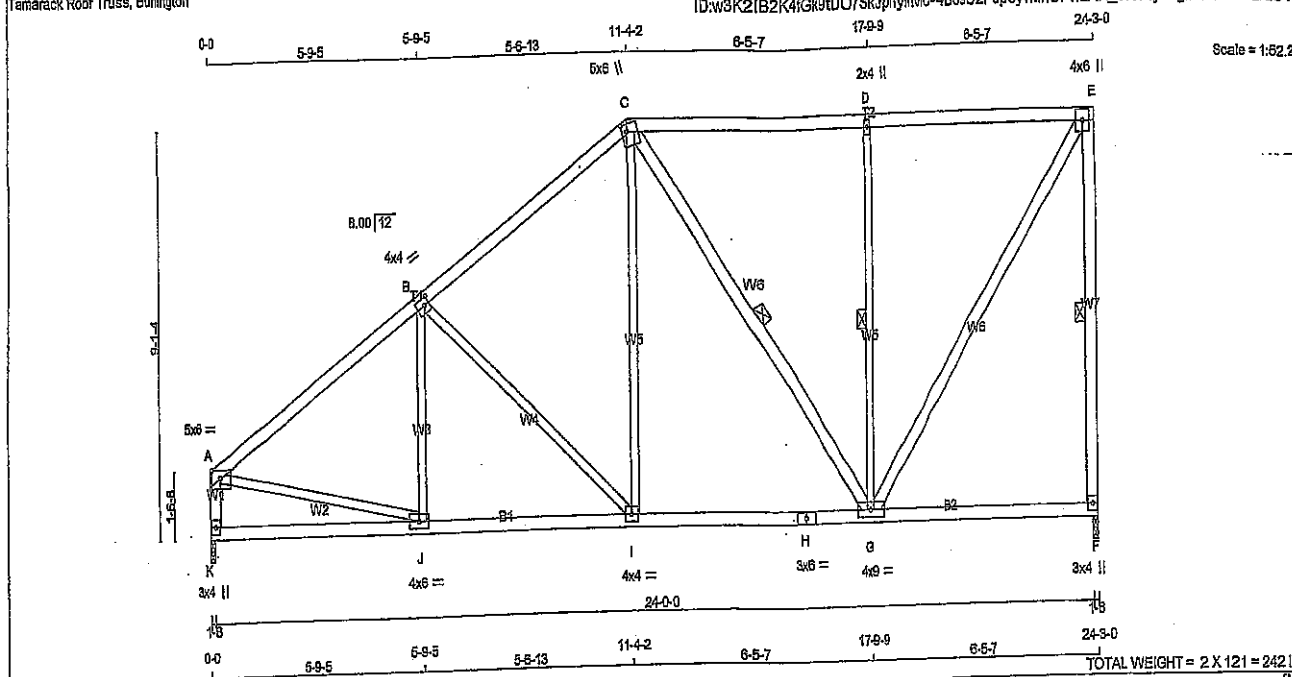

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
A - C	2x4	DRY	No.2		SPF
C - E	2x4	DRY	No.2		SPF
F - E	2x4	DRY	No.2		SPF
K - A	2x4	DRY	No.2		SPF
K - H	2x4	DRY	No.2		SPF
H - F	2x4	DRY	No.2		SPF
ALL WEBS			No.2		SPF
EXCEPT					
C - G	2x4	DRY	No.2		SPF
G - E	2x4	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWV-p	MT20	5.0	6.0	Edge	
B	TMWW-4	MT20	4.0	4.0	2.00	1.50
C	TTWW+m	MT20	5.0	8.0	2.00	1.50
D	TMW-w	MT20	2.0	4.0		
E	TMW+p	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMWWW-4	MT20	4.0	9.0		
H	BS-1	MT20	3.0	6.0		
I	BMWW-4	MT20	4.0	4.0		
J	BMWW-4	MT20	4.0	6.0		
K	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQRD
		GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	UPLIFT	IN-SX
JT	1381	0	1381	0	1-8
F	1381	0	1381	0	1-8
K	1381	0	1381	0	1-8

UNFACTORED REACTIONS

	1ST LCASE	MAX MIN. COMPONENT REACTIONS	DEAD	SOIL
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND
F	1118	620 / 0	255 / 0	0 / 0
K	1118	620 / 0	255 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, C-G, D-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-1468 / 0	-84.3 -84.3	0.58 (1)	4.70	J-B	-89 / 183	0.04 (3)
B-C	-1181 / 0	-84.3 -84.3	0.52 (1)	5.20	B-I	-435 / 0	0.51 (1)
C-D	-798 / 0	-84.3 -84.3	0.63 (1)	5.86	I-C	0 / 1475	0.11 (2)
D-E	-765 / 0	-84.3 -84.3	0.83 (1)	5.85	C-G	-249 / 0	0.16 (1)
E-F	-1288 / 0	0.0 0.0	0.50 (1)	5.69	G-D	-675 / 0	0.38 (1)
F-K	-1295 / 0	0.0 0.0	0.14 (1)	7.10	G-E	0 / 1343	0.22 (1)
					A-J	0 / 1250	0.28 (1)
K-J	0 / 0	-28.0 -28.0	0.22 (3)	10.00			
J-I	0 / 1262	-28.0 -28.0	0.37 (2)	10.00			
I-H	0 / 943	-28.0 -28.0	0.41 (2)	10.00			
H-G	0 / 943	-28.0 -28.0	0.41 (2)	10.00			
G-F	0 / 0	-28.0 -28.0	0.30 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.81")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.07")
ALLOWABLE DEFL.(TL) = $L/360$ (0.81")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.12")

CSI: TC=0.63/1.00 (D-E:1), BC=0.41/1.00 (G-I:2), WB=0.51/1.00 (B-I:1), SB=0.26/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 922 2284 1688


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.89 (3) (INPUT = 0.90)
JSI METAL=0.92 (3) (INPUT = 1.00)

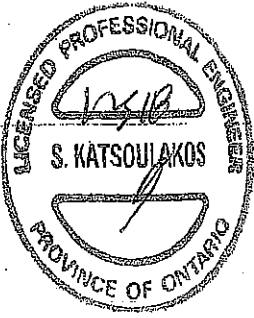

DWG NO. TAM 5984-8
STRUCTURAL
COMPONENT ONLY

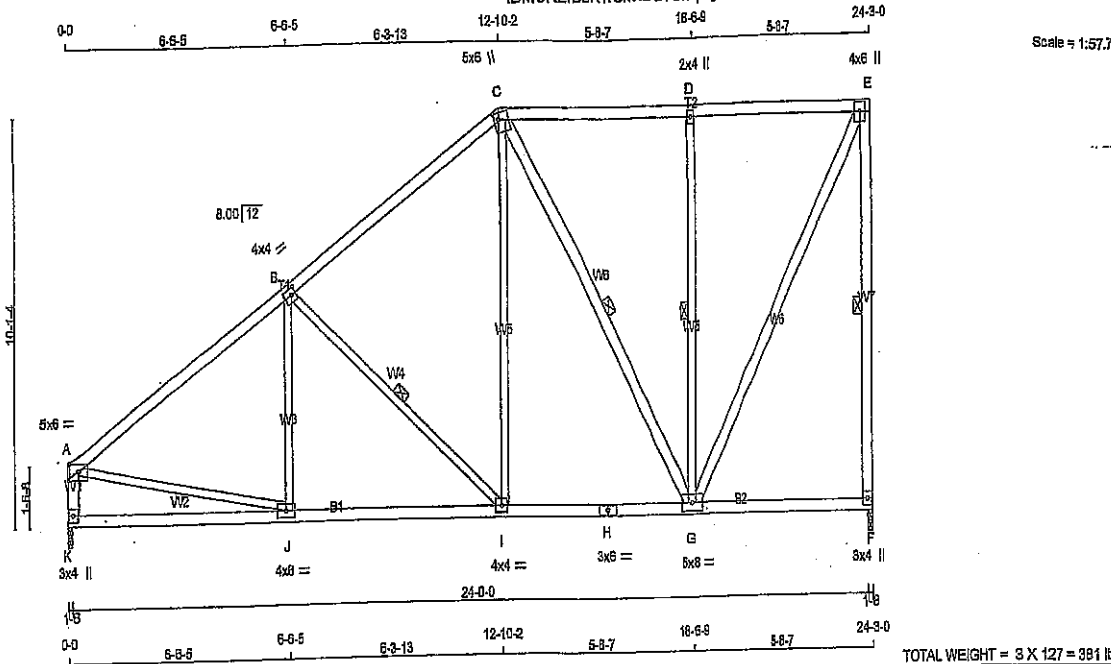

LUMBER	SIZE	DRY	No.2
N. L. G. A. RULES			
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS	SIZE	DRY	No.2
EXCEPT			
C - G	2x4	DRY	No.2
G - E	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)	TYPE	PLATES	W	LEN	Y	X
JT	TMVW-p	MT20	5.0	6.0	Edge	
A	TMVW-p	MT20	5.0	6.0	2.00	1.50
B	TMVW-p	MT20	5.0	6.0	2.00	1.50
C	TTVW+m	MT20	5.0	6.0	2.00	1.50
D	TMVW-p	MT20	5.0	6.0	2.00	1.50
E	TMVW-p	MT20	5.0	6.0	2.00	1.50
F	BMV1+p	MT20	5.0	6.0	2.00	1.50
G	BMVW-w	MT20	5.0	6.0	2.00	1.50
H	BS-1	MT20	5.0	6.0	2.00	1.50
I	BMVW-w	MT20	5.0	6.0	2.00	1.50
J	BMVW-w	MT20	5.0	6.0	2.00	1.50
K	BMV1+p	MT20	5.0	6.0	2.00	1.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
F	1351	0	1351	0	0	1-8	1-8	1-8	1-8
K	1351	0	1351	0	0	1-8	1-8	1-8	1-8

UNFACTORED REACTIONS		MAX/MIN. COMPONENT REACTIONS		LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	JT	COMBINED	SNOW	LIVE
F	1118	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0	F	1118	620 / 0	255 / 0
K	1118	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0	K	1118	620 / 0	255 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.


ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, B-I, C-G, D-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	-1481 / 0	J-B	-29 / 248
B-C	-1050 / 0	B-I	-357 / 0
C-D	-843 / 0	I-C	0 / 831
D-E	-843 / 0	C-G	-393 / 0
E-F	-1298 / 0	G-D	-595 / 0
K-A	-1298 / 0	D-E	0 / 1288
K-J	0 / 0	E-F	0 / 1284
J-I	0 / 1282		
I-H	0 / 847		
H-G	0 / 847		
G-F	0 / 0		

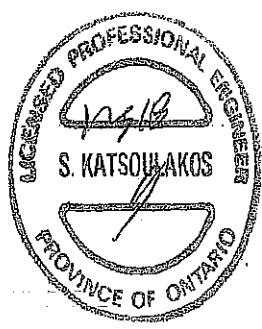

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 596-09
- TPIC 2011

(65 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.81")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.81")
CALCULATED VERT. DEFL. (TL) = L/999 (0.13")

CSI: TC=0.65/1.00 (E-F:1), BC=0.44/1.00 (I-J:2), WB=0.42/1.00 (D-G:1), SB=0.23/1.00 (D-E:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2264 1656

PLATE PLACEMENT TOL = 0.250 Inches

PLATE ROTATION TOL = 5.0 Deg.

ISI GRIP= 0.85 (J) (INPUT = 0.90)
ISI METAL= 0.32 (J) (INPUT = 1.00)

DWG NO. TARA 5985-18
STRUCTURAL
COMPONENT ONLY

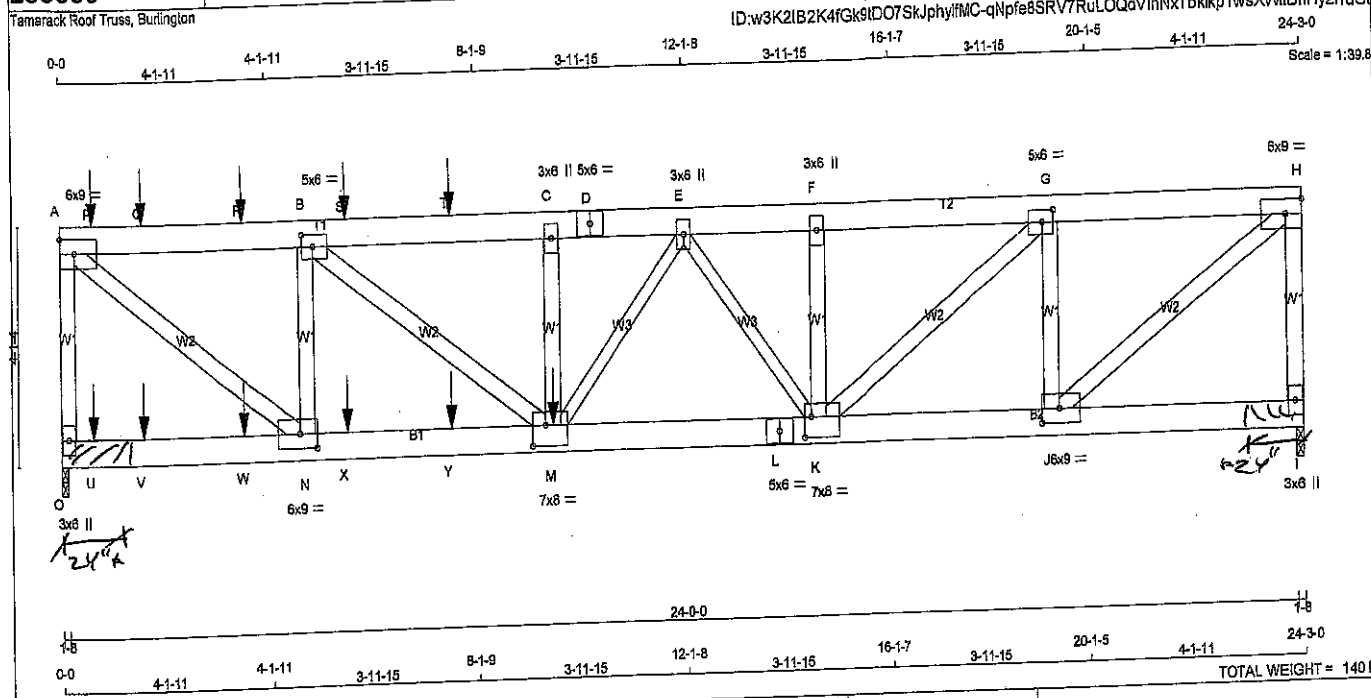

LUMBER				DESOR.	
N. L. G. A. RULES	SIZE	LUMBER		SPF	
CHORDS				SPF	
O - A	2x4	DRY	No.2	SPF	
A - D	2x6	DRY	No.2	SPF	
D - H	2x8	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
O - L	2x6	DRY	No.2	SPF	
L - I	2x8	DRY	No.2	SPF	
ALL WEBS	2x4	DRY	No.2	SPF	
EXCEPT				SPF	
M - E	2x3	DRY	No.2	SPF	
E - K	2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWV-1	MT20	6.0	9.0		Edge
B	TMWV-1	MT20	5.0	6.0	2.50	2.50
C	TMWV-1	MT20	3.0	8.0		
D	TS-1	MT20	5.0	6.0		
E	TMWV-1	MT20	3.0	8.0		
F	TMWV-1	MT20	3.0	6.0		
G	TMWV-1	MT20	5.0	6.0	2.50	2.50
H	TMWV-1	MT20	6.0	9.0		Edge
I	BMV1+p	MT20	3.0	8.0		
J	BMWV-1	MT20	8.0	9.0	3.00	4.00
K	BMWV-1	MT20	7.0	8.0	4.25	1.50
L	BS-1	MT20	5.0	6.0		
M	BMWV-1	MT20	7.0	8.0	4.25	3.00
N	BMWV-1	MT20	6.0	9.0	3.00	4.00
O	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 116.3 lbs FACTORED DOWN AT 7-12, 101.4 lbs FACTORED DOWN AT 1-7-12, 101.4 lbs FACTORED DOWN AT 3-7-12, AND 101.4 lbs FACTORED DOWN AT 5-7-12, AND 101.4 lbs FACTORED DOWN AT 7-7-12 ON TOP CHORD, AND 78.8 lbs FACTORED DOWN AT 7-12, 69.9 lbs FACTORED DOWN AT 1-7-12, 69.9 lbs FACTORED DOWN AT 3-7-12, 69.9 lbs FACTORED DOWN AT 5-7-12, AND 69.9 lbs FACTORED DOWN AT 7-7-12 ON TOP CHORD, AND 1628.2 lbs FACTORED DOWN AT 9-7-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

SCAB JOINT #2 & #1 WITH 2X6 #2
SPF 24" LONG 1 SIDE(S) USING 2
ROWS OF 2X6 ARDOX SPIRAL CONNECTION WIRE
NAILS AT 3" O/C STAGGERED (5 NAILS/SCAB)
REQUIRED FOR 1/2 BRG PROVISION.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	
	VERT	HORZ	DOWN	HORZ		IN-SX	IN-SX
O	2880	0	2880	0	1-8	1-8	1-8
I	2117	0	2117	0	1-8	1-8	1-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
	SNOW	LIVE	DOWN	HORZ				
O	2427	1352/0	550/0	0/0	0/0	0/0	372/0	0/0
I	1731	973/0	387/0	0/0	0/0	0/0	372/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)		FROM TO	FACTORED VERT. LOAD LC1 MAX. (PLF)		MAX. UNBRACED LENGTH	FR-TO	WEBS MAX. FACTORED FORCE (LBS)	
FR-TO									
O-A	-2832/0		0.0	0.0	0.85 (1)	5.05	A-N	0/4167	0.74 (1)
A-P	-3335/0		-84.3	-84.3	0.32 (1)	4.34	N-B	-2221/0	0.38 (1)
P-Q	-3335/0		-84.3	-84.3	0.32 (1)	4.34	B-M	0/2341	0.41 (1)
Q-R	-3335/0		-84.3	-84.3	0.32 (1)	4.34	M-C	-315/0	0.05 (1)
R-B	-3335/0		-84.3	-84.3	0.32 (1)	4.34	K-F	-288/0	0.05 (1)
B-S	-5187/0		-84.3	-84.3	0.43 (1)	3.47	K-G	0/2088	0.37 (1)
S-T	-5187/0		-84.3	-84.3	0.43 (1)	3.47	J-G	-1741/0	0.30 (1)
T-C	-5187/0		-84.3	-84.3	0.43 (1)	3.47	J-H	0/3140	0.58 (1)
C-D	-5187/0		-84.3	-84.3	0.23 (1)	3.69	M-E	0/775	0.19 (1)
D-E	-5187/0		-84.3	-84.3	0.23 (1)	3.89	E-K	-1013/0	0.33 (1)
E-F	-4185/0		-84.3	-84.3	0.15 (1)	4.13			
F-G	-4185/0		-84.3	-84.3	0.25 (1)	4.04			
G-H	-2512/0		-84.3	-84.3	0.17 (1)	5.05			
H-I	-2633/0		0.0	0.0	0.47 (1)	5.85			

O-U	0/0	-28.0	-28.0	0.15 (2)	10.00
U-V	0/0	-28.0	-28.0	0.15 (2)	10.00
V-W	0/0	-28.0	-28.0	0.15 (2)	10.00
W-N	0/0	-28.0	-28.0	0.15 (2)	10.00
N-X	0/3335	-28.0	-28.0	0.54 (1)	10.00
X-Y	0/3335	-28.0	-28.0	0.54 (1)	10.00
Y-M	0/3335	-28.0	-28.0	0.54 (1)	10.00
M-L	0/4744	-28.0	-28.0	0.71 (1)	10.00
L-K	0/4744	-28.0	-28.0	0.71 (1)	10.00
K-J	0/2512	-28.0	-28.0	0.37 (1)	10.00
J-I	0/0	-28.0	-28.0	0.03 (2)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
M	9-7-0	-1628	-1628	—	BACK	VERT	TOTAL
P	7-12	-116	-116	—	BACK	VERT	TOTAL
Q	1-7-12	-101	-101	—	BACK	VERT	TOTAL
R	3-7-12	-101	-101	—	BACK	VERT	TOTAL
S	5-7-12	-101	-101	—	BACK	VERT	TOTAL
T	7-7-12	-101	-101	—	BACK	VERT	TOTAL
U	7-12	-45	-79	—	BACK	VERT	TOTAL
V	1-7-12	-40	-70	—	BACK	VERT	TOTAL
W	3-7-12	-40	-70	—	BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	46.1	PSF	

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
ALLOWABLE DEFL.(TL) = L/380 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.28")

CSI: TC=0.85/1.00 (A-O-1), BC=0.71/1.00 (K-M-1),
WB=0.74/1.00 (A-N-1), SSI=0.28/1.00 (A-B-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT:

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SSI GRIP= 0.90 (M) (INPUT = 0.90)
SSI METAL= 0.78 (L) (INPUT = 1.00)

DWG NO. TAM 0091-8
STRUCTURAL
COMPONENT ONLY


CONTINUED ON PAGE

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285350	T47	1	1	TRUSS DESC.	

Version 8.200 S Dec 12 2017 Mittek Industries, Inc. Tue Feb 6 11:18:14 2018 Page 2
 ID:w3K2IB2K4fGk9ID07SkJbhytMC-gNofe8SRV7RuLOQdV/hNxTbk1kp1wsXVilBhHyznuGt

Tamarack Roof Truss, Burlington

FACTORED CONCENTRATED LOADS (LBS)						
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.
X	5-7-12	-40	-70	—	BACK	VERT
Y	7-7-12	-40	-70	—	BACK	VERT
						TOTAL

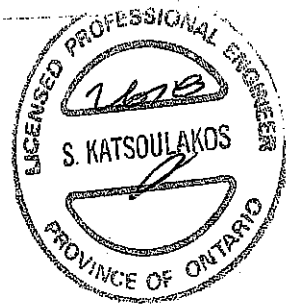


DWG NO. TAM 8091-18
 STRUCTURAL
 COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T48	1	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mittek Industries, Inc. Fri Sep 01 17:31:59 2017 Page 1

ID:w3K2IB2K4fGk9tD07SkJphyfMC-aVFNMWLK0XzJ6x94BfSLB6BnRaM1HCk4Eh5r9ayhxok

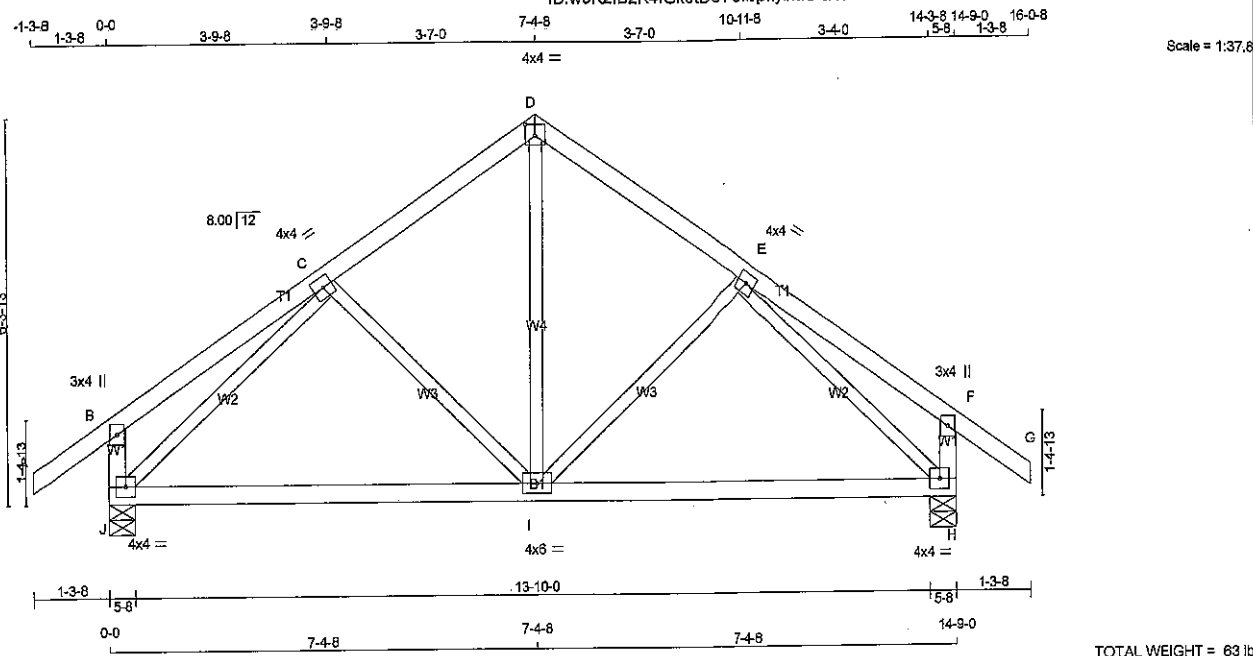

TOTAL WEIGHT = 63 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	4.0		
I	BMWW-t	MT20	4.0	6.0		
J	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
J	944	0	944	0	0	5-8	5-8	5-8	5-8
H	944	0	944	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX	MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
J	758	448 / 0	155 / 0	0 / 0	0 / 0	156 / 0	0 / 0
H	758	448 / 0	155 / 0	0 / 0	0 / 0	156 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	FORCE (LBS)	MAX (LBS)	CS1 (LC)
FR-TO		FROM	TO	FR-TO			
A-B	0 / 32	-84.3	-84.3 0.11 (1)	10.00	I-D	0 / 478	0.11 (1)
B-C	0 / 19	-84.3	-84.3 0.18 (1)	10.00	I-E	-161 / 43	0.07 (1)
C-D	-868 / 0	-84.3	-84.3 0.14 (1)	6.25	C-I	-161 / 44	0.07 (1)
D-E	-868 / 0	-84.3	-84.3 0.14 (1)	6.25	J-C	-909 / 0	0.38 (1)
E-F	0 / 19	-84.3	-84.3 0.18 (1)	10.00	E-H	-909 / 0	0.38 (1)
F-G	0 / 32	-84.3	-84.3 0.11 (1)	10.00			
J-B	-235 / 0	0.0	0.0 0.02 (1)	7.81			
H-F	-235 / 0	0.0	0.0 0.02 (1)	7.81			
J-I	0 / 655	-28.0	-28.0 0.52 (2)	10.00			
I-H	0 / 655	-28.0	-28.0 0.52 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
OL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPC 2011

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.49")
CALCULATED VERT. DEFL.(LL)= L/999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.49")
CALCULATED VERT. DEFL.(TL)= L/999 (0.15")

CSI: TC=0.18 (B-C:1), BC=0.52 (I-J:2), WB=0.38 (C-J:1), SSI=0.18 (I-J:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (D) (INPUT = 0.90)
JSI METAL= 0.32 (C) (INPUT = 1.00)



DWG NO. TAM 44552-17
STRUCTURAL
COMPONENT ONLY

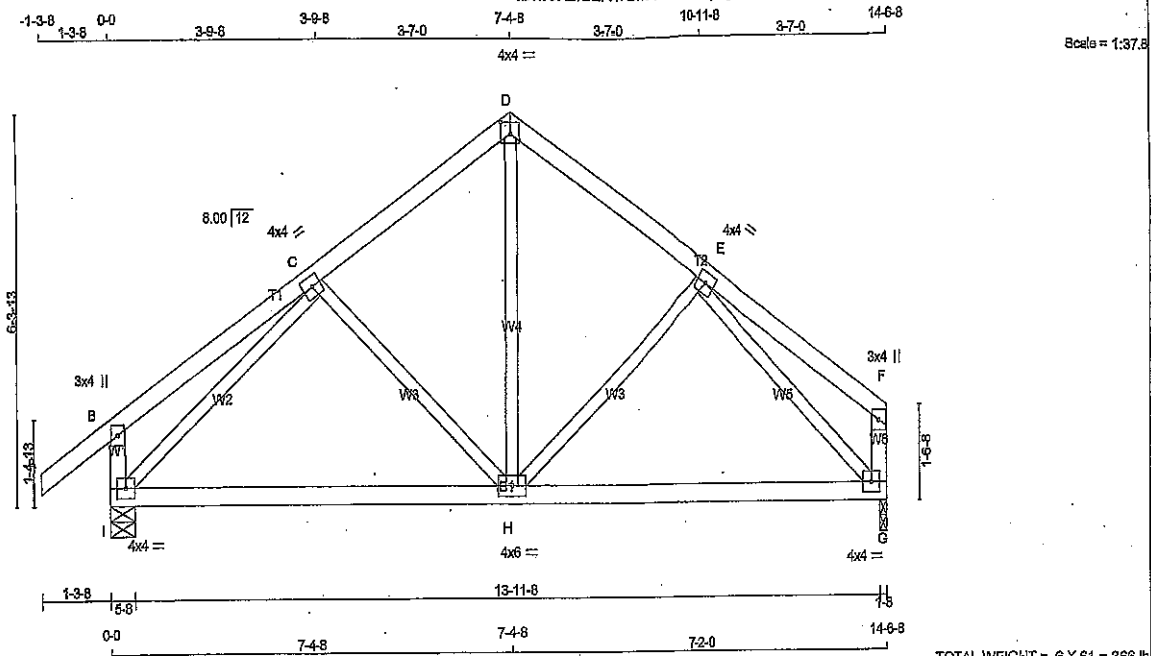

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
I - B	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-1	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVW-1	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
G	BMVW-1	MT20	4.0	4.0		
H	BMVW-1	MT20	4.0	8.0		
I	BMVW-1	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
I	932	0	892	0
G	818	0	818	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM.LIVE	
I	748	442/0	153/0	0/0	154/0
G	870	372/0	153/0	0/0	145/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	MEMB.	FORCE	MAX.
MEMB.	FORCE	VERT.	LOAD	LC1	MAX	MAX.	MEMB.	FORCE	MAX.
(LBS)	(LBS)	(PLF)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)
FR-TO	FROM	TO	LENGTH	FR-TO	FROM	TO	LENGTH	FR-TO	FROM
A-B	0/32	-84.3	-84.3	0.11 (1)	10.00	H-D	0/455	0.10 (1)	
B-C	0/20	-84.3	-84.3	0.18 (1)	10.00	H-E	-130/53	0.08 (1)	
C-D	-649/0	-84.3	-84.3	0.14 (1)	8.25	C-H	-164/42	0.07 (1)	
D-E	-648/0	-84.3	-84.3	0.13 (1)	6.25	I-C	-891/0	0.37 (1)	
E-F	0/20	-84.3	-84.3	0.17 (1)	10.00	E-G	-882/0	0.34 (1)	
I-B	-235/0	0.0	0.0	0.02 (1)	7.81				
G-F	-111/0	0.0	0.0	0.01 (1)	7.81				
I-H	0/643	-28.0	-28.0	0.50 (2)	10.00				
H-G	0/618	-28.0	-28.0	0.50 (2)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	46.1	PSF

SPACING = 24.0 IN./C/G

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 086-08
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.48")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.09")
ALLOWABLE DEFL.(TL) = $L/360$ (0.48")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.15")

CSI: TC=0.18/1.00 (B-C:1), BC=0.50/1.00 (H-I:2),
WB=0.37/1.00 (C-I:1), SS=0.17/1.00 (H-I:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 .618 .354 .667 .822 .2284 .1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (E) (INPUT = 0.90)
JSI METAL= 0.32 (C) (INPUT = 1.00)

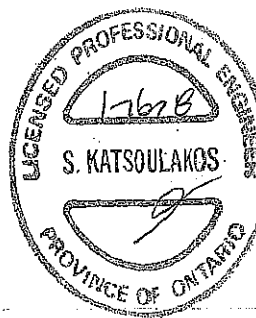

DWG NO. TAM 3903 -18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T71X	3	1	TRUSS DESC.	


Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Fri Sep 01 17:31:59 2017 Page 1

ID:PFhc1Ba2cOYemTQTAYm6Oyi1EX-avFNMWLK0xJ6x94BfSLB6BjxaLGH2c4Eh5r9oyhxok

30-6-8 31-0-0

Scale = 1:52.9

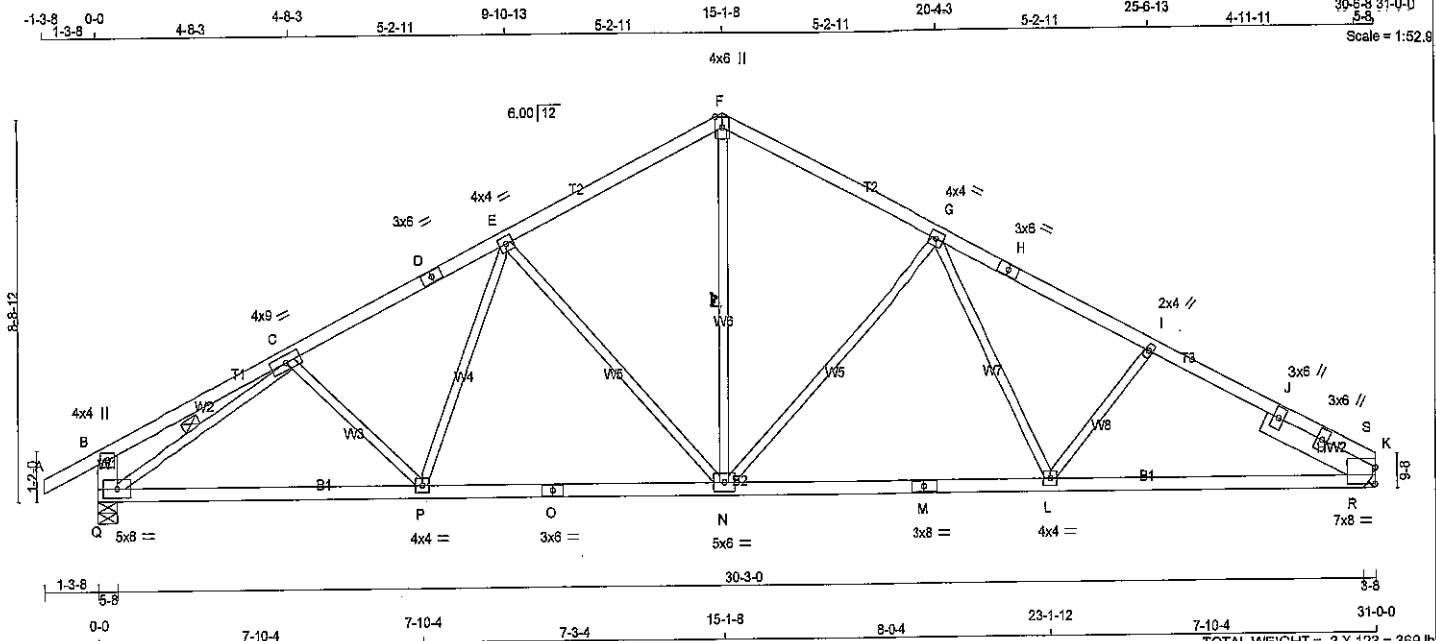

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2 SPF
D - F	2x4	DRY	No.2 SPF
F - H	2x4	DRY	No.2 SPF
H - K	2x4	DRY	No.2 SPF
Q - B	2x8	DRY	No.2 SPF
Q - O	2x4	DRY	No.2 SPF
O - M	2x4	DRY	No.2 SPF
M - K	2x4	DRY	No.2 SPF

REINFORCING MEMBERS			
HW2	2x6	DRY	No.2 SPF
ALL WEBS EXCEPT			
	2x3	DRY	No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	4.0	4.0
C	TMVW-t	MT20	4.0	9.0
D	TS-t	MT20	3.0	6.0
E	TMVW-t	MT20	4.0	4.0
F	TTW+p	MT20	4.0	6.0
G	TMVW-t	MT20	4.0	4.0
H	TS-t	MT20	3.0	6.0
I	TMVW-t	MT20	2.0	4.0
K	TMBMR-t	MT20	7.0	8.0
K	RT-t	MT20	3.0	6.0
K	RT-t	MT20	3.0	6.0
L	BMVW-t	MT20	4.0	4.0
M	BS-t	MT20	3.0	6.0
N	BMVW-t	MT20	5.0	6.0
O	BS-t	MT20	3.0	6.0
P	BMVW-t	MT20	4.0	4.0
Q	BMVW-t	MT20	5.0	8.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
Q	1854	0	1854	0	0	5-8	5-8		
K	1740	0	1740	0	0				

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	DEAD	SOIL	DEAD	SOIL
Q	1908	863 / 0	326 / 0	0 / 0	0 / 0	318 / 0	0 / 0				
K	1429	783 / 0	326 / 0	0 / 0	0 / 0	310 / 0	0 / 0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-Q. *F-NP*

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	UNBRAC LENGTH FR-TO
FR-TO		FROM	TO	FR-TO			
A-B	0 / 28	-84.3	-84.3 0.11 (1)	C-P	-33 / 148	0.03 (3)	10.00
B-C	0 / 16	-84.3	-84.3 0.23 (1)	P-E	0 / 357	0.08 (2)	10.00
C-D	-2398 / 0	-84.3	-84.3 0.35 (1)	E-N	-860 / 0	0.83 (1)	4.15
D-E	-2398 / 0	-84.3	-84.3 0.35 (1)	N-F	0 / 1274	0.29 (1)	4.15
E-F	-1828 / 0	-84.3	-84.3 0.32 (1)	F-G	-762 / 0	0.98 (1)	4.66
F-G	-1831 / 0	-84.3	-84.3 0.34 (1)	G-L	0 / 455	0.10 (2)	4.62
G-H	-2552 / 0	-84.3	-84.3 0.40 (1)	L-I	-205 / 32	0.06 (1)	3.98
H-I	-2552 / 0	-84.3	-84.3 0.40 (1)	I-Q	-2835 / 0	0.59 (1)	3.98
I-J	-2053 / 0	-84.3	-84.3 0.39 (1)	J-S	0 / 1452	0.00 (1)	4.35
J-S	-2053 / 0	-84.3	-84.3 0.39 (1)	S-K	-1518 / 0	0.12 (1)	4.35
S-K	-2410 / 0	-84.3	-84.3 0.14 (1)	K-Q			4.33
K-Q	-271 / 0	0.0	0.0 0.02 (1)				7.81
Q-P	0 / 2172	-28.0	-28.0 0.63 (2)				10.00
P-O	0 / 2058	-28.0	-28.0 0.62 (2)				10.00
O-N	0 / 2058	-28.0	-28.0 0.62 (2)				10.00
N-M	0 / 2126	-28.0	-28.0 0.56 (2)				10.00
M-L	0 / 2126	-28.0	-28.0 0.56 (2)				10.00
L-R	0 / 2429	-28.0	-28.0 0.61 (1)				10.00
R-K	0 / 1301	-28.0	-28.0 0.47 (2)				10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCSC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.19")
ALLOWABLE DEFL.(TL)= L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.33")

CSI: TC=0.40 (G-I:1), BC=0.63 (P-Q:2), WB=0.96 (G-N:1), SSI=0.35 (K-R:2)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 522 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.69 (C) (INPUT = 0.90)
JSI METAL = 0.74 (M) (INPUT = 1.00)




DWG NO. TAM 44554-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T73S	2	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2018 Mitek Industries, Inc. Fri Sep 01 17:32:00 2017 Page 1

ID:PFehc1Ba2cOYemTQTAYm6Oy1EX-2hplZsMznr6AJ4kGkNzakKkoy_g70a9ETLqOhFyhxoJ

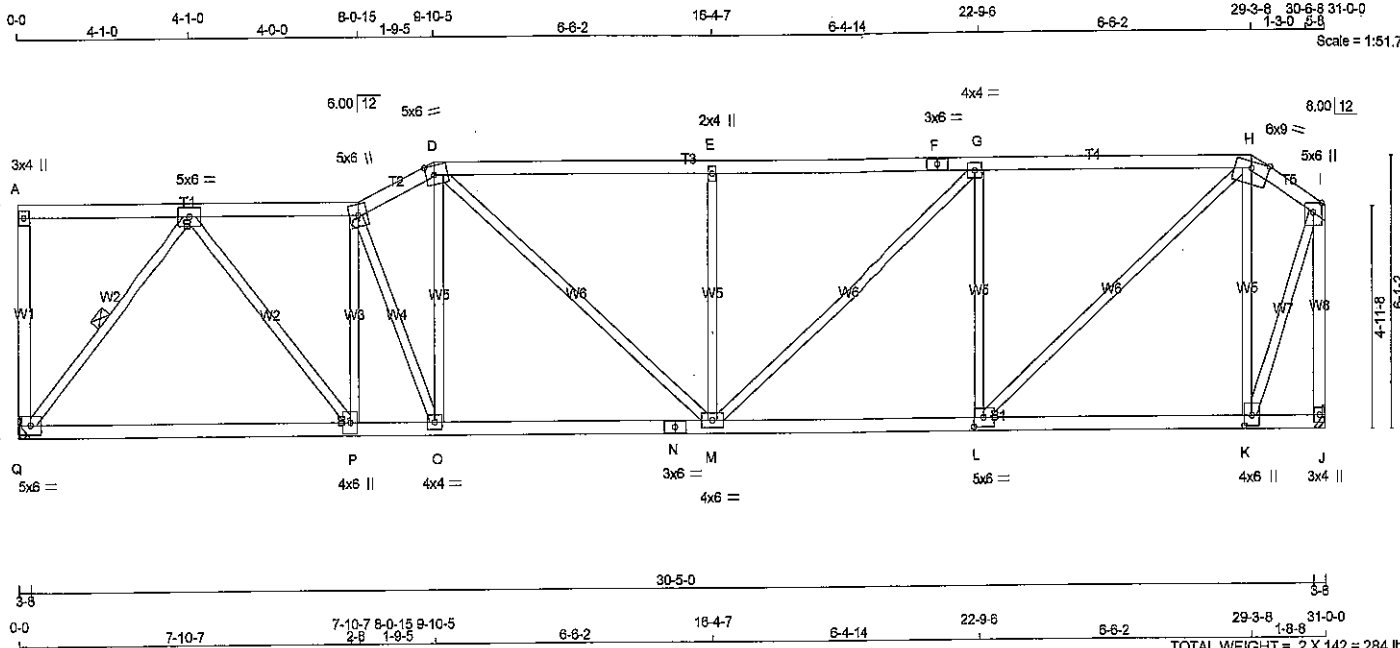

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
Q - A	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - I	2x4	DRY	No.2	SPF	
J - I	2x4	DRY	No.2	SPF	
Q - N	2x4	DRY	No.2	SPF	
N - J	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0			
B	TMVW-t	MT20	5.0	6.0			
C	TTWW+m	MT20	5.0	6.0			
D	TTWW-m	MT20	5.0	6.0	2.50	2.25	
E	TMV+w	MT20	2.0	4.0			
F	TS-t	MT20	3.0	6.0			
G	TMVW-t	MT20	4.0	4.0			
H	TTWW-m	MT20	6.0	9.0	Edge		
I	TMVW+p	MT20	5.0	6.0	Edge		
J	BMV1+p	MT20	3.0	4.0			
K	BMVW-t	MT20	4.0	6.0	2.75	2.00	
L	BMVW-t	MT20	5.0	6.0	2.50	2.75	
M	BMVWW-t	MT20	4.0	6.0			
N	BS-t	MT20	3.0	6.0			
O	BMVW-t	MT20	4.0	4.0			
P	BMVW-t	MT20	4.0	6.0			
Q	BMVW-t	MT20	5.0	6.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	MIN. SEAT SIZE: 3-8	HANGER BY OTHERS
Q	1740	0	1740	0	0				
J	1740	0	1740	0	0				

UNFACTORED REACTIONS		1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL				
Q	1429	793 / 0	328 / 0	0 / 0	0 / 0	310 / 0	0 / 0				
J	1429	793 / 0	328 / 0	0 / 0	0 / 0	310 / 0	0 / 0				

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.74 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

CHORDS		FACTORED		MEMB.		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS1 (L/C)	MEMB.	FORCE (LBS)	CS1 (L/C)	MEMB.	FORCE (LBS)	CS1 (L/C)
FR-TO		FROM	TO	FR-TO		FROM	TO		
Q-A	-131 / 0	0.0	0.0	0.06 (1)	7.81	P-C	-882 / 0	0.35 (1)	
A-B	0 / 0	-84.3	-84.3	0.23 (1)	10.00	C-O	-359 / 0	0.16 (1)	
B-C	-2131 / 0	-84.3	-84.3	0.30 (1)	4.38	O-D	0 / 399	0.09 (2)	
C-D	-2280 / 0	-84.3	-84.3	0.10 (1)	4.48	K-H	-1178 / 0	0.69 (1)	
D-E	-2390 / 0	-84.3	-84.3	0.69 (1)	3.75	K-I	0 / 1430	0.32 (1)	
E-F	-2391 / 0	-84.3	-84.3	0.69 (1)	3.74	L-H	0 / 1854	0.42 (1)	
F-G	-2391 / 0	-84.3	-84.3	0.69 (1)	3.74	D-M	0 / 485	0.11 (1)	
G-H	-1885 / 0	-84.3	-84.3	0.62 (1)	4.19	L-G	-1051 / 0	0.81 (1)	
H-I	-628 / 0	-84.3	-84.3	0.05 (1)	6.25	M-E	-582 / 0	0.35 (1)	
J-I	-1758 / 0	0.0	0.0	0.77 (1)	6.29	M-G	0 / 682	0.15 (1)	
						Q-B	-1972 / 0	0.55 (1)	
						B-P	0 / 1402	0.32 (1)	
Q-P	0 / 1280	-28.0	-28.0	0.54 (2)	10.00				
P-O	0 / 2150	-28.0	-28.0	0.66 (2)	10.00				
O-N	0 / 2028	-28.0	-28.0	0.48 (2)	10.00				
N-M	0 / 2028	-28.0	-28.0	0.48 (2)	10.00				
M-L	0 / 1885	-28.0	-28.0	0.46 (2)	10.00				
L-K	0 / 500	-28.0	-28.0	0.29 (2)	10.00				
K-J	0 / 0	-28.0	-28.0	0.18 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.18")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.77 (I-J:1), BC=0.66 (O-P:2), WB=0.69 (H-K:1), SSI=0.26 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 822 2284 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.55 (N) (INPUT = 1.00)

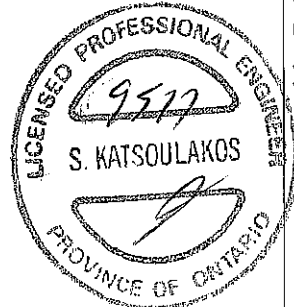

DRWG NO. TAM 44555 - 17
STRUCTURAL
COMPONENT ONLY

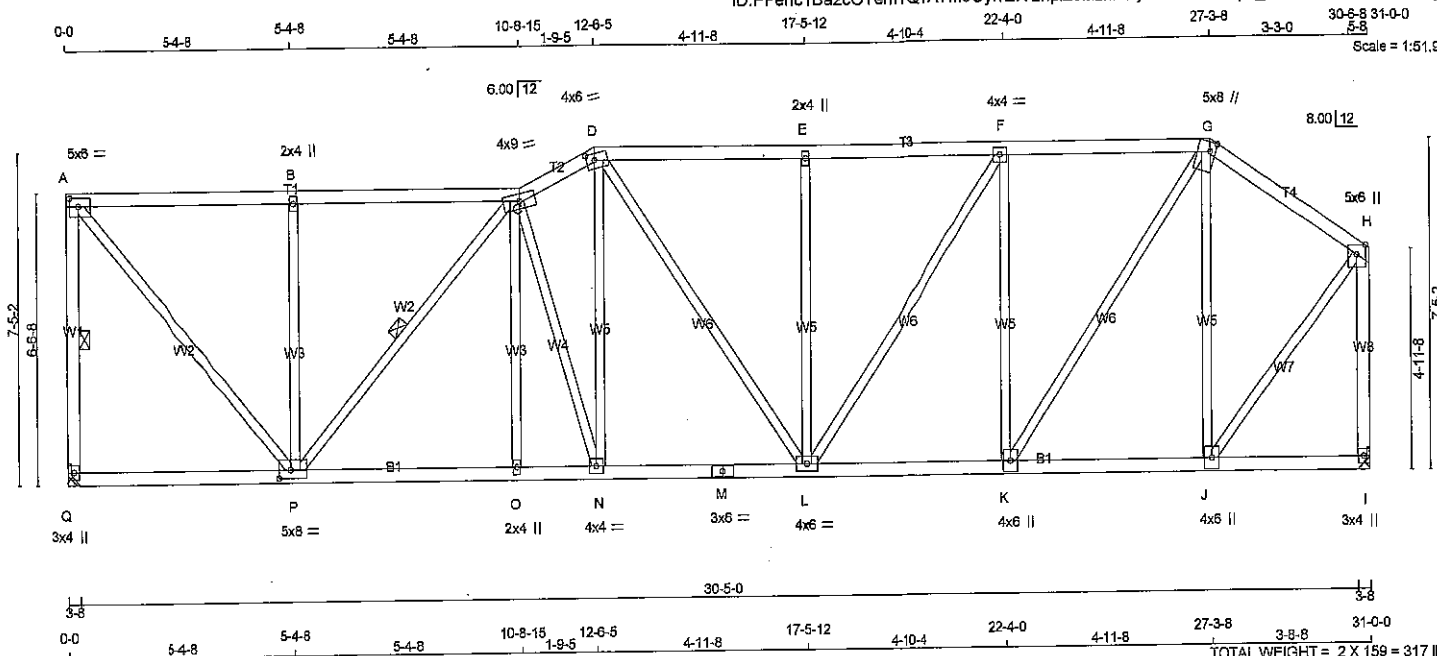

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2	DESCR.
Q - A	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF
Q - M	2x4	DRY	No.2	SPF
M - I	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW-t	MT20	5.0	6.0	2.25	2.50
B	TMWW-w	MT20	2.0	4.0		
C	TTWWWW-m	MT20	4.0	9.0		
D	TTWW-m	MT20	4.0	6.0	1.75	2.25
E	TMWW-w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TTWW+m	MT20	5.0	6.0	2.50	1.50
H	TMWW+p	MT20	5.0	6.0		Edge
I	BMV1+p	MT20	3.0	4.0		
J	BMWW+t	MT20	4.0	6.0		
K	BMWW+t	MT20	4.0	6.0		
L	BMWWWW-t	MT20	4.0	6.0		
M	BS-t	MT20	3.0	6.0		
N	BMWW-t	MT20	4.0	4.0		
O	BMWW-w	MT20	2.0	4.0		
P	BMWWWW-t	MT20	5.0	8.0	2.25	3.50
Q	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
Q	1740	0	1740	0	0	IN-SX
I	1740	0	1740	0	0	IN-SX

MIN. SEAT SIZE: 3-8
HANGER BY OTHERS

UNFACTORED REACTIONS

JT	1ST CASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
Q	1429	793 / 0	328 / 0	0 / 0	0 / 0	310 / 0	0 / 0
I	1429	793 / 0	328 / 0	0 / 0	0 / 0	310 / 0	0 / 0

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.53 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-Q, C-P.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
 TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	FR-TO	WEBS	
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	LC2			MAX. FACTORED FORCE (LBS)	CS1 (LC)
FR-TO								
Q-A	-1679 / 0	0.0	0.0	0.33 (1)	5.13	A-P	0 / 1991	0.45 (1)
A-B	-1304 / 0	-84.3	-84.3	0.45 (1)	5.06	P-B	-559 / 0	0.39 (1)
B-C	-1304 / 0	-84.3	-84.3	0.45 (1)	5.06	P-C	-1011 / 0	0.45 (1)
C-D	-2035 / 0	-84.3	-84.3	0.09 (1)	4.69	O-C	0 / 148	0.03 (3)
D-E	-1892 / 0	-84.3	-84.3	0.33 (1)	4.55	C-N	-484 / 0	0.37 (1)
E-F	-1892 / 0	-84.3	-84.3	0.34 (1)	4.53	N-D	0 / 570	0.13 (1)
F-G	-1556 / 0	-84.3	-84.3	0.32 (1)	4.93	J-G	-858 / 0	0.85 (1)
G-H	-986 / 0	-84.3	-84.3	0.22 (1)	6.01	J-H	0 / 1280	0.29 (1)
H-I	-1702 / 0	0.0	0.0	0.75 (1)	8.37	K-G	0 / 1312	0.30 (1)
						D-L	0 / 111	0.03 (1)
Q-P	0 / 0	-28.0	-28.0	0.21 (3)	10.00	K-F	-943 / 0	0.93 (1)
P-O	0 / 1881	-28.0	-28.0	0.44 (2)	10.00	L-E	-448 / 0	0.44 (1)
O-N	0 / 1960	-28.0	-28.0	0.37 (1)	10.00	L-F	0 / 598	0.13 (1)
N-M	0 / 1829	-28.0	-28.0	0.36 (1)	10.00			
M-L	0 / 1829	-28.0	-28.0	0.36 (1)	10.00			
L-K	0 / 1556	-28.0	-28.0	0.32 (1)	10.00			
K-J	0 / 807	-28.0	-28.0	0.23 (2)	10.00			
J-I	0 / 0	-28.0	-28.0	0.13 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 3.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. OC

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.03")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.12")
 ALLOWABLE DEFL. (TL) = L/360 (1.03")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.19")

CSI: TC=0.75 (H-I), BC=0.44 (O-P), WB=0.93 (F-K), SSI=0.22 (A-B-I)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 818 354 1687 822 2284 1658


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (P) (INPUT = 0.90)
 JSI METAL= 0.62 (C) (INPUT = 1.00)

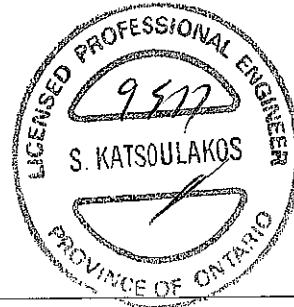

DRWG NO. TAM 4456-17
STRUCTURAL COMPONENT ONLY

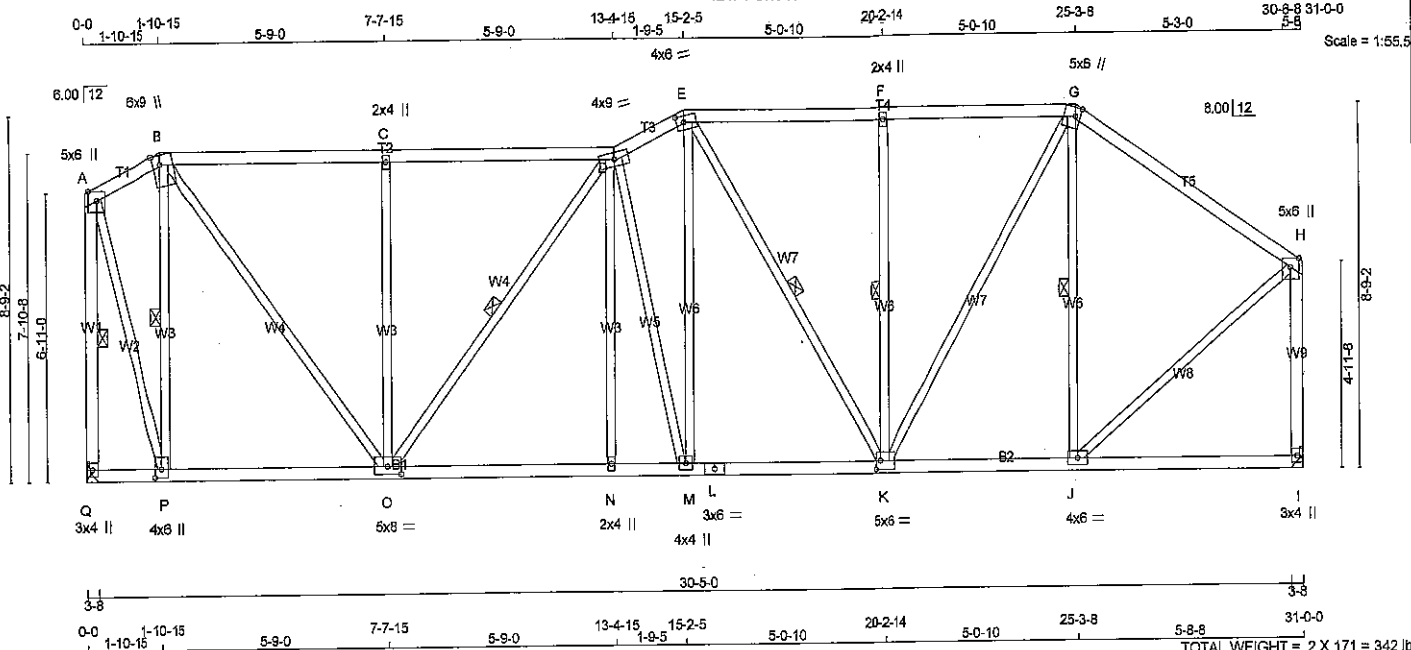

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY No.2	SPF
B - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
G - H	2x4	DRY No.2	SPF
Q - A	2x4	DRY No.2	SPF
I - H	2x4	DRY No.2	SPF
Q - L	2x4	DRY No.2	SPF
L - I	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
Q	1740	0	1740	0	0	0
I	1740	0	1740	0	0	0

MIN. SEAT SIZE: 3-8
HANGER BY OTHERS
MIN. SEAT SIZE: 3-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
Q	1428	793 / 0	328 / 0	0 / 0	0 / 0	310 / 0	0 / 0
I	1428	793 / 0	326 / 0	0 / 0	0 / 0	310 / 0	0 / 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.83 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-P, D-O, E-K, F-K, G-J, A-Q.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED		MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSX (LC)		
		VERT. LOAD (PLF)	CS1 (LC)						
FR-TO		FROM	TO		FR-TO				
A-B	-490 / 0	-84.3	-84.3	0.06 (1)	5.25	P-B	-1310 / 0	0.51 (1)	
B-C	-1379 / 0	-84.3	-84.3	0.53 (1)	4.83	B-O	0 / 1587	0.36 (1)	
C-D	-1379 / 0	-84.3	-84.3	0.53 (1)	4.83	O-C	-597 / 0	0.70 (1)	
D-E	-1777 / 0	-84.3	-84.3	0.08 (1)	4.96	O-D	-619 / 0	0.39 (1)	
E-F	-1478 / 0	-84.3	-84.3	0.40 (1)	4.90	N-D	0 / 1174	0.04 (3)	
F-G	-1478 / 0	-84.3	-84.3	0.40 (1)	4.90	D-M	-673 / 0	0.85 (1)	
G-H	-1177 / 0	-84.3	-84.3	0.55 (1)	5.13	M-E	0 / 1757	0.17 (1)	
Q-A	-1733 / 0	0.0	0.0	0.39 (1)	5.06	E-K	-238 / 0	0.16 (1)	
I-H	-1675 / 0	0.0	0.0	0.73 (1)	6.41	K-F	-520 / 0	0.26 (1)	
						K-G	0 / 990	0.22 (1)	
Q-P	0 / 0	-28.0	-28.0	0.12 (3)	10.00	J-G	-603 / 0	0.30 (1)	
P-O	0 / 419	-28.0	-28.0	0.25 (2)	10.00	A-P	0 / 1487	0.34 (1)	
O-N	0 / 1753	-28.0	-28.0	0.41 (2)	10.00	J-H	0 / 1251	0.28 (1)	
N-M	0 / 1752	-28.0	-28.0	0.34 (1)	10.00				
M-L	0 / 1599	-28.0	-28.0	0.32 (1)	10.00				
L-K	0 / 1599	-28.0	-28.0	0.32 (1)	10.00				
K-J	0 / 1970	-28.0	-28.0	0.33 (2)	10.00				
J-I	0 / 0	-28.0	-28.0	0.22 (2)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.03")
CALCULATED VERT. DEFL.(LL)= L/999 (0.12")
ALLOWABLE DEFL.(TL)= L/360 (1.03")
CALCULATED VERT. DEFL.(TL)= L/999 (0.19")

CSI: TC=0.73 (H-I), BC=0.41 (N-O), WB=0.85 (D-M-1), SSI=0.23 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (G) (INPUT = 0.90)
JSI METAL= 0.48 (D) (INPUT = 1.00)




DRWG NO. TAM44557 -17
STRUCTURAL
COMPONENT ONLY




Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	MAX	MAX.	MEMB.	FORCE	MAX	
	(LBS)	LC1	CSI (LC)	UNBRAC		(LBS)	CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	-676 / 0	-84.3	-84.3	0.33 (1)	5.09	N-B	-931 / 0	0.52 (1)
B-C	-1453 / 0	-84.3	-84.3	0.61 (1)	4.63	B-M	0 / 1128	0.18 (1)
C-D	-1453 / 0	-84.3	-84.3	0.62 (1)	4.61	M-C	-613 / 0	0.34 (1)
D-E	-1453 / 0	-84.3	-84.3	0.62 (1)	4.61	M-E	-126 / 0	0.08 (1)
E-F	-1528 / 0	-84.3	-84.3	0.63 (1)	4.52	K-E	-513 / 0	0.28 (1)
F-G	-1232 / 0	-84.3	-84.3	0.15 (1)	5.61	K-F	0 / 868	0.14 (1)
G-H	0 / 16	-84.3	-84.3	0.13 (1)	10.00	J-F	-349 / 1	0.19 (1)
Q-A	-1694 / 0	0.0	0.0	0.38 (1)	5.11	J-G	0 / 816	0.14 (1)
I-H	-108 / 0	0.0	0.0	0.05 (1)	7.81	A-N	0 / 1357	0.31 (1)
						G-I	-1730 / 0	0.64 (1)
Q-N	0 / 0	-28.0	-28.0	0.21 (2)	10.00			
N-M	0 / 774	-28.0	-28.0	0.34 (2)	10.00			
M-L	0 / 1528	-28.0	-28.0	0.43 (2)	10.00			
L-K	0 / 1528	-28.0	-28.0	0.43 (2)	10.00			
K-J	0 / 1005	-28.0	-28.0	0.42 (2)	10.00			
J-I	0 / 743	-28.0	-28.0	0.38 (2)	10.00			

JSI GRIP= 0.87 (K) (INPUT = 0.90)
JSI METAL= 0.49 (L) (INPUT = 1.00)

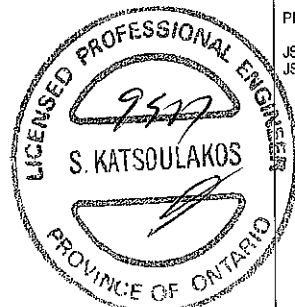

DWG NO. TAM 4455B-17
STRUCTURAL
COMPONENT ONLY

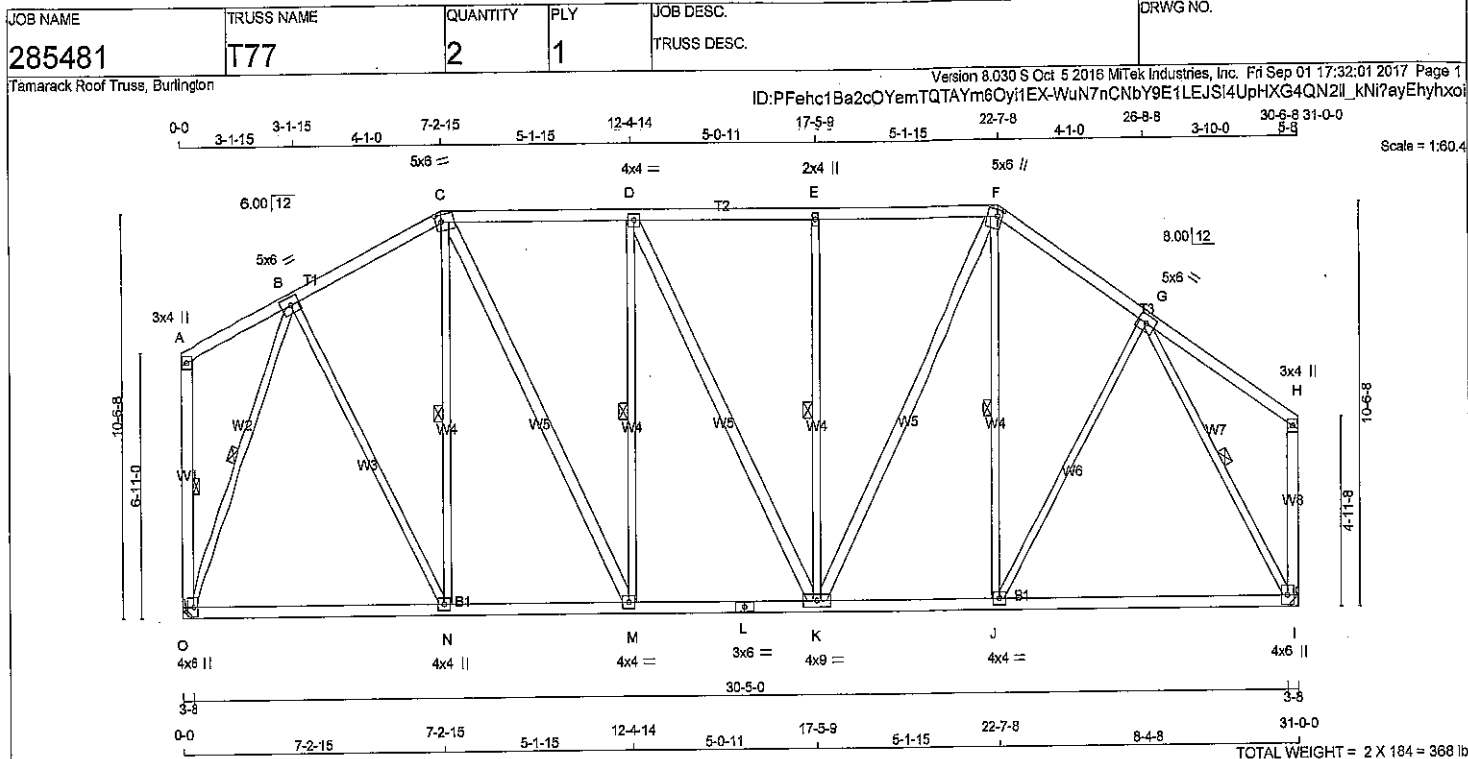

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
O - A	2x4	DRY No.2	SPF
I - H	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF
L - I	2x4	DRY No.2	SPF

ALL WEBS EXCEPT			
CHORDS	SIZE	LUMBER	DESCR.
C - M	2x4	DRY No.2	SPF
D - K	2x4	DRY No.2	SPF
K - F	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
A	TMV+p	MT20	3.0	4.0
B	TMWW-t	MT20	5.0	6.0
C	TTWW-m	MT20	5.0	6.0
D	TMWW-t	MT20	4.0	4.0
E	TMW+w	MT20	2.0	4.0
F	TTWW+m	MT20	5.0	6.0
G	TMWW-t	MT20	5.0	6.0
H	TMV+p	MT20	3.0	4.0
I	BMVW1+p	MT20	4.0	6.0
J	BMVW-t	MT20	4.0	4.0
K	BMVW-t	MT20	4.0	4.0
L	BS-t	MT20	3.0	6.0
M	BMVW-t	MT20	4.0	4.0
N	BMVW-t	MT20	4.0	4.0
O	BMVW1+p	MT20	4.0	6.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT REQRD BRG	
JT	VERT	SNOW	HORIZ	DOWN	HORIZ	IN-SX	IN-SX
O	1740	0	0	1740	0	0	0
I	1740	0	0	1740	0	0	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMBINED	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1429	793 / 0	328 / 0	0 / 0	0 / 0	310 / 0	0 / 0	0 / 0
I	1429	793 / 0	328 / 0	0 / 0	0 / 0	310 / 0	0 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, D-M, E-K, F-J, A-O, B-O, G-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0 / 20	-84.3	-84.3	B-N	0 / 793
B-C	-1092 / 0	-84.3	-84.3	N-C	-493 / 0
C-D	-1289 / 0	-84.3	-84.3	C-M	0 / 735
D-E	-1317 / 0	-84.3	-84.3	M-D	-530 / 0
E-F	-1317 / 0	-84.3	-84.3	D-K	0 / 65
F-G	-1296 / 0	-84.3	-84.3	K-E	-466 / 0
G-H	0 / 23	-84.3	-84.3	E-F	0 / 576
O-A	-86 / 0	0.0	0.0	F-J	-118 / 138
I-H	-137 / 0	0.0	0.0	J-G	0 / 415
				O-B	-1879 / 0
				G-I	-1731 / 0
O-N	0 / 596	-28.0	-28.0		
N-M	0 / 968	-28.0	-28.0		
M-L	0 / 1289	-28.0	-28.0		
L-K	0 / 1289	-28.0	-28.0		
K-J	0 / 1058	-28.0	-28.0		
J-I	0 / 853	-28.0	-28.0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TC=0.34 (D-E:1), BC=0.56 (J-K:2), WB=0.86 (B-O:1), SSI=0.20 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 822 2284 1655


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.84 (N) (INPUT = 0.80)
JSI METAL= 0.44 (L) (INPUT = 1.00)



DWG NO. TAM 44559-19
STRUCTURAL
COMPONENT ONLY

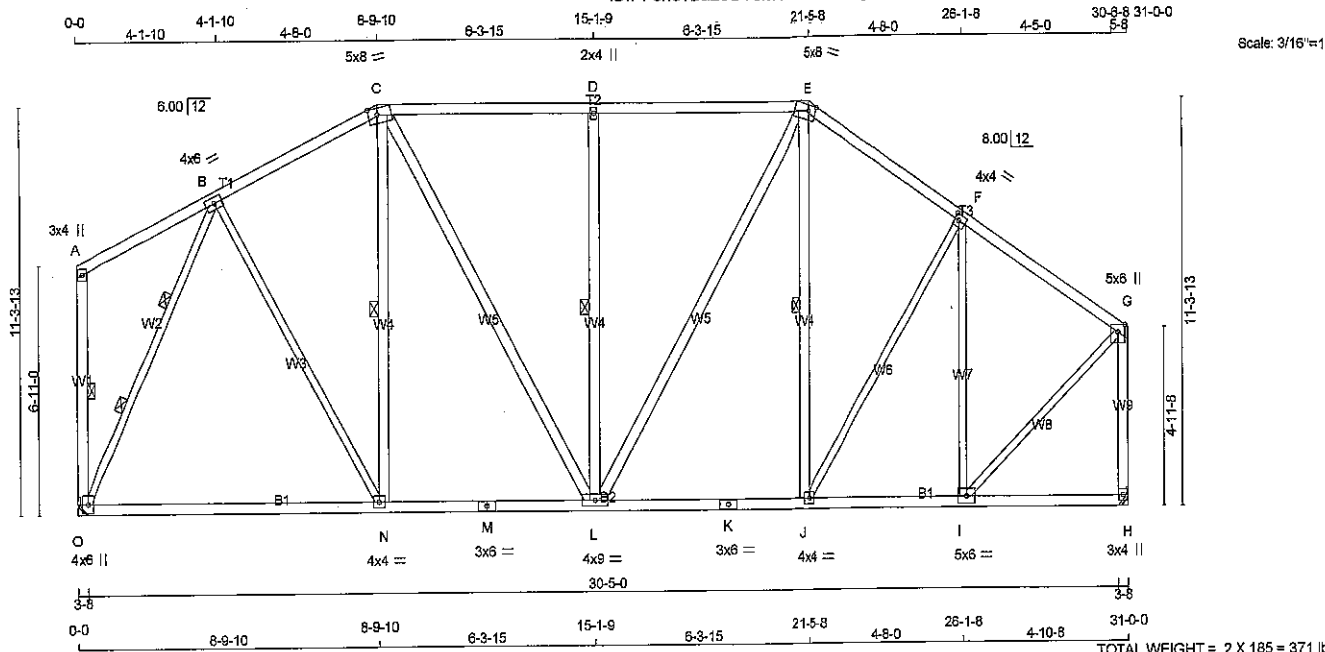

LUMBER				N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF			
C - E	2x4	DRY	No.2	SPF			
E - G	2x4	DRY	No.2	SPF			
O - A	2x4	DRY	No.2	SPF			
H - G	2x4	DRY	No.2	SPF			
O - M	2x4	DRY	No.2	SPF			
M - K	2x4	DRY	No.2	SPF			
K - H	2x4	DRY	No.2	SPF			
ALL WEBS	2x4	DRY	No.2	SPF			
EXCEPT							
B - N	2x3	DRY	No.2	SPF			
J - F	2x3	DRY	No.2	SPF			
I - F	2x3	DRY	No.2	SPF			
O - B	2x3	DRY	No.2	SPF			
I - G	2x3	DRY	No.2	SPF			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TMWW-t	MT20	4.0	6.0		
C	TTWW-m	MT20	5.0	8.0	2.25	3.00
D	TMWW-m	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	2.00	3.00
F	TMWW-t	MT20	4.0	4.0	2.00	1.50
G	TMVV+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMWW-t	MT20	5.0	6.0		
J	BMWW-t	MT20	4.0	4.0		
K	BS-t	MT20	3.0	6.0		
L	BMWW-t	MT20	4.0	9.0		
M	BS-t	MT20	3.0	6.0		
N	BMWW-t	MT20	4.0	4.0		
O	BMWW1+p	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		GROSS REACTION		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	BRG	BRG	IN-SX	IN-SX	HANGER BY OTHERS	HANGER BY OTHERS
O	1740	0	1740	0	0	0	0	0	0	MIN. SEAT SIZE: 3-8	MIN. SEAT SIZE: 3-8
H	1740	0	1740	0	0	0	0	0	0	MIN. SEAT SIZE: 3-8	MIN. SEAT SIZE: 3-8

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1429	793 / 0	326 / 0	0 / 0	0 / 0	310 / 0	0 / 0
H	1429	793 / 0	326 / 0	0 / 0	0 / 0	310 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

- 1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, D-L, E-J, A-O.
- 2 LATERAL BRACE(S) AT 1/3 LENGTH OF B-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 22	-84.3	-84.3 0.27 (1)	10.00	B-N	0 / 823	0.14 (1)
B-C	-1159 / 0	-84.3	-84.3 0.23 (1)	5.66	N-C	-284 / 75	0.19 (1)
C-D	-1265 / 0	-84.3	-84.3 0.46 (1)	5.13	C-L	0 / 501	0.08 (1)
D-E	-1265 / 0	-84.3	-84.3 0.46 (1)	5.13	L-D	-659 / 0	0.44 (1)
E-F	-1294 / 0	-84.3	-84.3 0.27 (1)	5.39	L-E	0 / 427	0.07 (1)
F-G	-1107 / 0	-84.3	-84.3 0.26 (1)	5.71	J-E	-17 / 173	0.03 (3)
O-A	-123 / 0	0.0	0.0 0.03 (1)	6.25	J-F	0 / 209	0.05 (1)
H-G	-1684 / 0	0.0	0.0 0.74 (1)	6.40	I-F	-753 / 0	0.99 (1)
					O-B	-1674 / 0	0.96 (1)
					I-G	0 / 1302	0.29 (1)
O-N	0 / 713	-28.0	-28.0 0.57 (2)	10.00			
N-M	0 / 1015	-28.0	-28.0 0.61 (2)	10.00			
M-L	0 / 1015	-28.0	-28.0 0.61 (2)	10.00			
L-K	0 / 1052	-28.0	-28.0 0.31 (2)	10.00			
K-J	0 / 1052	-28.0	-28.0 0.31 (2)	10.00			
J-I	0 / 943	-28.0	-28.0 0.30 (2)	10.00			
I-H	0 / 0	-28.0	-28.0 0.14 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, SCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.03")
CALCULATED VERT. DEFL.(LL)= L/999 (0.25")
ALLOWABLE DEFL.(TL)= L/360 (1.03")
CALCULATED VERT. DEFL.(TL)= L/801 (0.41")

CSI: TC=0.74 (G-H:1), BC=0.61 (L-N:2), WB=0.99 (F-I:1), SSI=0.28 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

ISI GRIP= 0.87 (B) (INPUT = 0.80)
ISI METAL= 0.41 (K) (INPUT = 1.00)




DWG NO. TAM44560-17
STRUCTURAL
COMPONENT ONLY

JOB NAME 285481	TRUSS NAME T90TCX	QUANTITY 19	PLY 1	JOB DESC. TRUSS DESC.	DRWG NO.
---------------------------	-----------------------------	-----------------------	-----------------	--------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Fri Sep 01 17:32:01 2017 Page 1

ID:w3K2IB2K4fGk9tD7SkJphylfMC-WuN7nCNbY9E1LEJSH4UpHXG4ON6E174N17ayEhyhxo

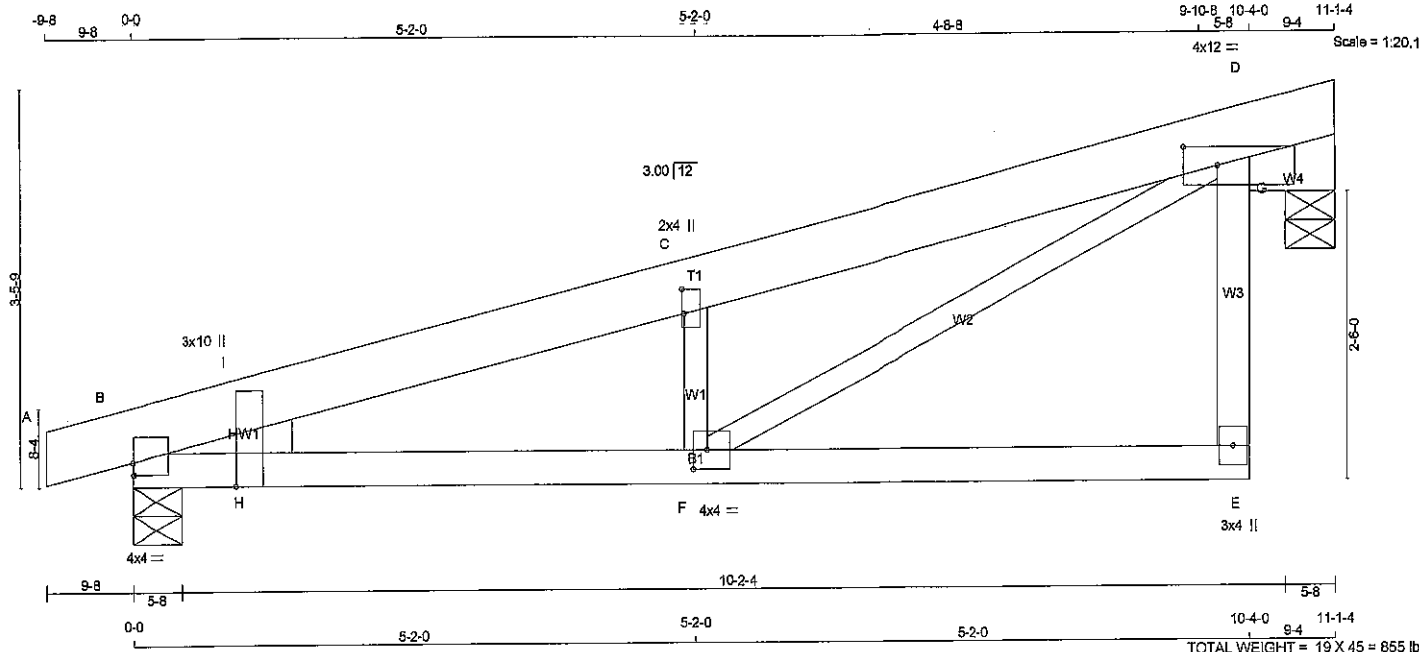

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x8	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF
B - E	2x4	DRY No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMB1-I	MT20	4.0	4.0	1.25	
B WPH	MT20	3.0	10.0	Edge	11.50
C TMW+u	MT20	2.0	4.0	2.50	0.25
D TMVWW1-p	MT20	4.0	12.0	2.00	3.75
E BMV+p	MT20	3.0	4.0		
F BMWW-I	MT20	4.0	4.0	2.00	1.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG		HEEL WEDGE
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
J(D)	551	0	551	0	0	5-8	5-8		
B	680	0	680	0	0	5-8	5-8	2x4 L	

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
J(D)	452	251 / 0	103 / 0	0 / 0	0 / 0	98 / 0	0 / 0
B	548	321 / 0	114 / 0	0 / 0	0 / 0	114 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J(D), B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-4 / 0	-84.3 -84.3	0.02 (1)	10.00	F-C	-420 / 0	0.06 (1)
B-I	-1258 / 0	-84.3 -84.3	0.03 (1)	6.25	F-D	0 / 1157	0.26 (1)
I-C	-1158 / 0	-84.3 -84.3	0.07 (1)	6.25	H-I	0 / 131	0.00 (1)
C-D	-1152 / 0	-84.3 -84.3	0.17 (1)	6.25	D-J	-785 / 0	0.03 (1)
E-G	0 / 106	0.0 0.0	0.34 (1)	10.00	G-J	0 / 558	0.00 (1)
G-D	0 / 106	0.0 0.0	0.34 (1)	10.00			
B-H	0 / 1128	-28.0 -28.0	0.20 (1)	10.00			
H-F	0 / 1128	-28.0 -28.0	0.28 (2)	10.00			
F-E	0 / 103	-28.0 -28.0	0.17 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 3.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.0 PSF
TOTAL LOAD	= 48.1 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.34")
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.34")
CALCULATED VERT. DEFL.(TL)= L/999 (0.09")

CSI: TC=0.34 (E-G:1), BC=0.28 (F-H:2), WB=0.26 (D-F:1), SS=0.15 (D-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE LEFT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (F) (INPUT = 0.90)
JSI METAL= 0.40 (B) (INPUT = 1.00)

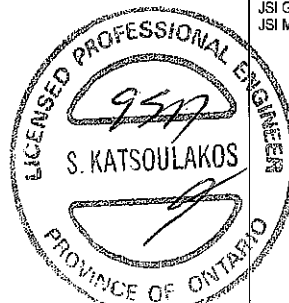


DWG NO. TAM 44561-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	G90	3	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 5 Oct 5 2016 Mitek Industries, Inc. Fri Sep 01 17:31:47 2017 Page 1

ID:w3K2iB2K4fGk9tD07SkJphyfMC-xBXqrQCprT0g5FmU8EXlahmqOrTrCJUUpBCKVyhXow

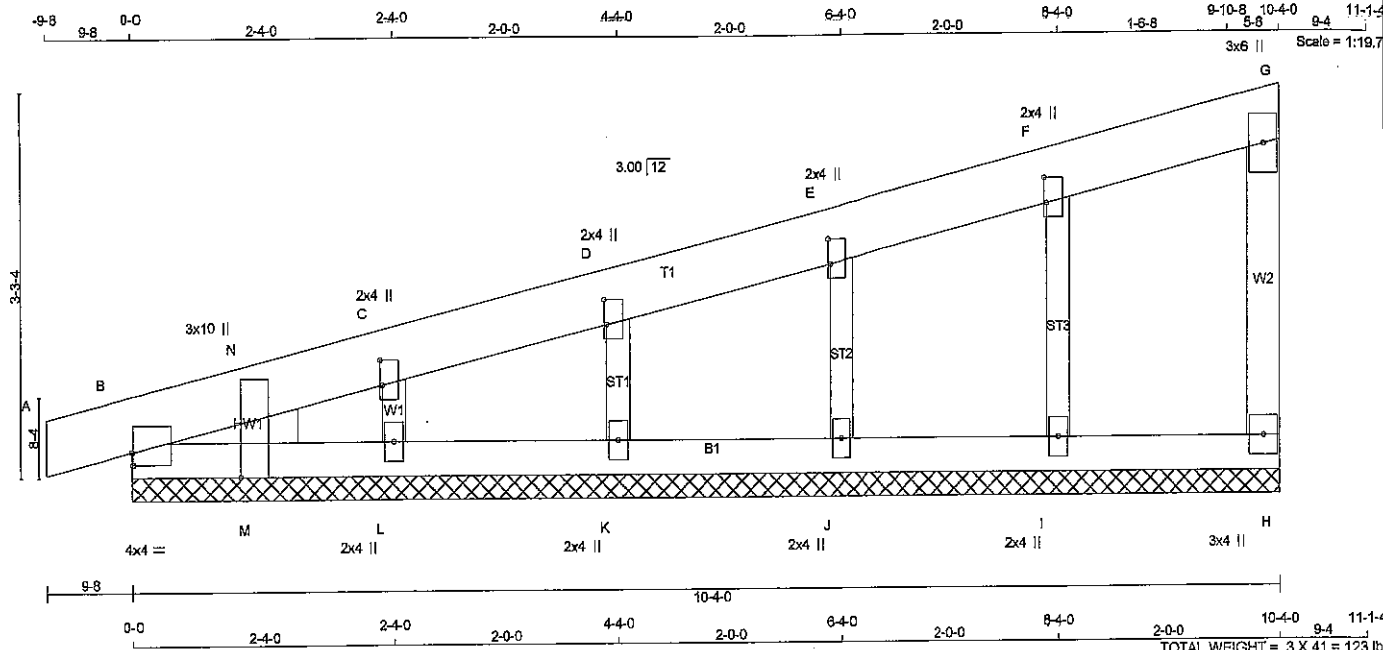

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - G	2x6	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
B - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2'-0" O.C.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	4.0	4.0	1.25
B	WP4	MT20	3.0	10.0	Edge 11.50
C, D, E, F					
C	TMW+w	MT20	2.0	4.0	2.50 0.25
G	TMV+p	MT20	3.0	6.0	
H	BMV1+p	MT20	3.0	4.0	
I, J, K, L					
I	BMW1+w	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

HEEL
WEDGE
2x4 L
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	-41/0	-84.3 -84.3	0.02 (1)	10.00	I-F	-166/0	0.03 (1)
B-N	-46/0	-84.3 -84.3	0.02 (1)	6.25	J-E	-168/0	0.03 (1)
N-C	-14/3	-84.3 -84.3	0.03 (1)	6.25	K-D	-158/0	0.02 (1)
C-D	-18/0	-84.3 -84.3	0.03 (1)	6.25	L-C	-201/0	0.03 (1)
D-E	-9/0	-84.3 -84.3	0.02 (1)	10.00	M-N	0/41	0.00 (1)
E-F	-4/0	-84.3 -84.3	0.02 (1)	10.00			
F-G	-4/0	-84.3 -84.3	0.02 (1)	10.00			
H-G	-72/0	0.0 0.0	0.01 (1)	7.81			
B-M	0/28	-28.0 -28.0	0.02 (1)	10.00			
M-L	0/28	-28.0 -28.0	0.03 (2)	10.00			
L-K	0/16	-28.0 -28.0	0.02 (2)	10.00			
K-J	0/9	-28.0 -28.0	0.02 (2)	10.00			
J-I	0/4	-28.0 -28.0	0.03 (2)	10.00			
I-H	0/0	-28.0 -28.0	0.03 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. GIC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03 (C-D:1), BC=0.03 (I-J:2), WB=0.03 (F-I:1), SSI=0.07 (C-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE LEFT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.16 (C) (INPUT = 0.80)
JSI METAL = 0.04 (L) (INPUT = 1.00)

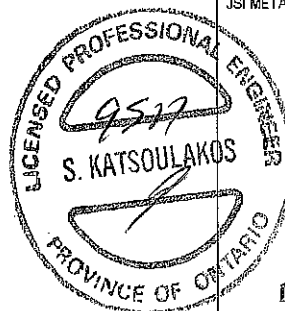

DWG NO. TAM 44591-17
STRUCTURAL
COMPONENT ONLY

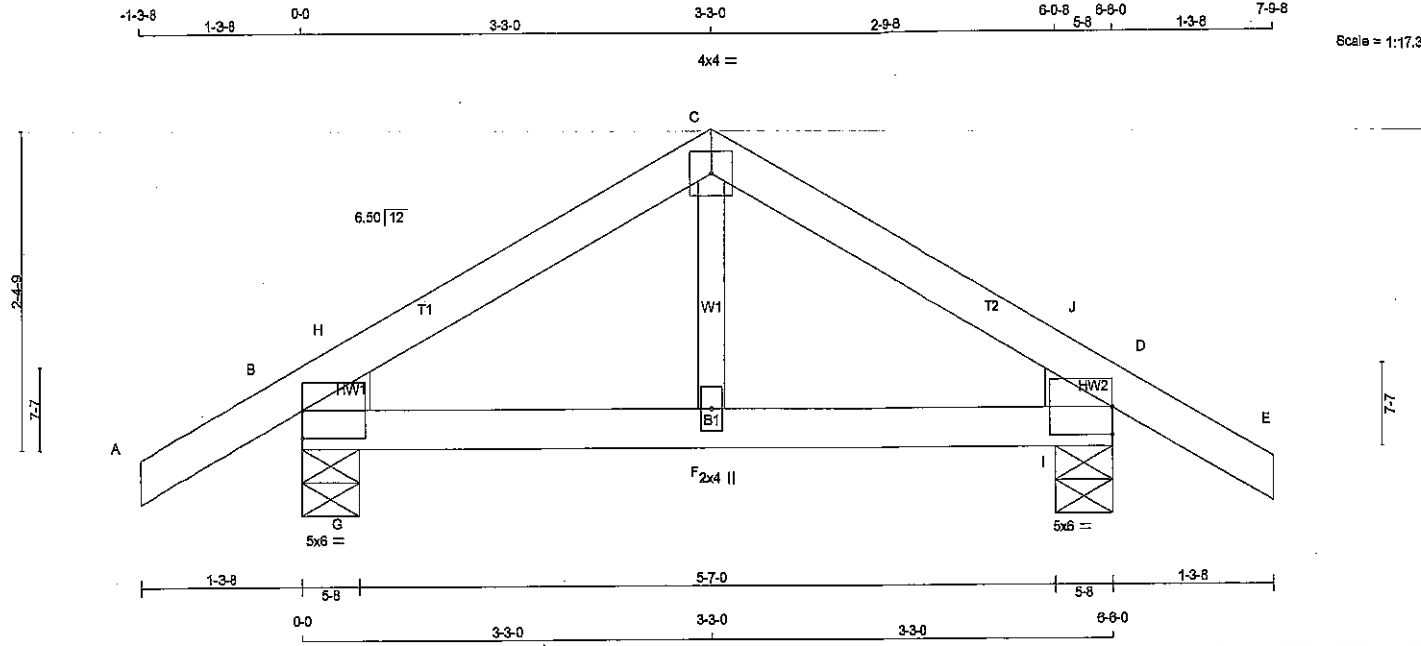

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	No.2	SPF
C - E	2x4	No.2	SPF
B - D	2x4	No.2	SPF
ALL WEBS	2x3	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-I	MT20	5.0	6.0	2.50
C	TTW-p	MT20	4.0	4.0	
D	TMBH1-I	MT20	5.0	6.0	2.50
F	BMW-w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
B	480	0	480	0	5-8	5-8	2x4 L
D	480	0	480	0	5-8	5-8	2x4 R

UNFACTORED REACTIONS

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS				
		1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND
B	377	238 / 0	68 / 0	0 / 0	0 / 0	73 / 0
D	377	238 / 0	68 / 0	0 / 0	0 / 0	73 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 (LC)	MAX. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)
FR-TO		FROM TO			FR-TO	
A-B	0 / 17	-84.3 -84.3	0.11 (1)	10.00	F-C	0 / 185
B-H	-411 / 0	-84.3 -84.3	0.05 (1)	6.25	G-H	-34 / 113
H-C	-355 / 0	-84.3 -84.3	0.08 (1)	6.25	I-J	-33 / 114
C-J	-355 / 0	-84.3 -84.3	0.08 (1)	6.25		
J-D	-412 / 0	-84.3 -84.3	0.05 (1)	6.25		
D-E	0 / 17	-84.3 -84.3	0.11 (1)	10.00		
B-G	0 / 305	-28.0 -28.0	0.08 (1)	10.00		
G-F	0 / 305	-28.0 -28.0	0.10 (1)	10.00		
F-I	0 / 305	-28.0 -28.0	0.10 (1)	10.00		
I-D	0 / 305	-28.0 -28.0	0.08 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF

BOT CH. LL = 10.5 PSF
DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/380 (0.22")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.11/1.00 (A-B:1), BC=0.10/1.00 (F-G:1), WB=0.04/1.00 (C-F:2), SSI=0.09/1.00 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1667
	822	2264	1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (D) (INPUT = 0.80)
JSI METAL= 0.10 (B) (INPUT = 1.00)




DRWG NO. TAM 21179-18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285482	G91	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.200 8 Jan 6 2018 M/Tek Industries, Inc. Thu Apr 19 13:19:08 2018 Page 1

ID:sGqP1V7k717Mm8E9Sg?w1yg0Fn-hwTMUPh_s1Vwo1X3qUkF90wEj3mM_nTfhMLAbXzPgLn

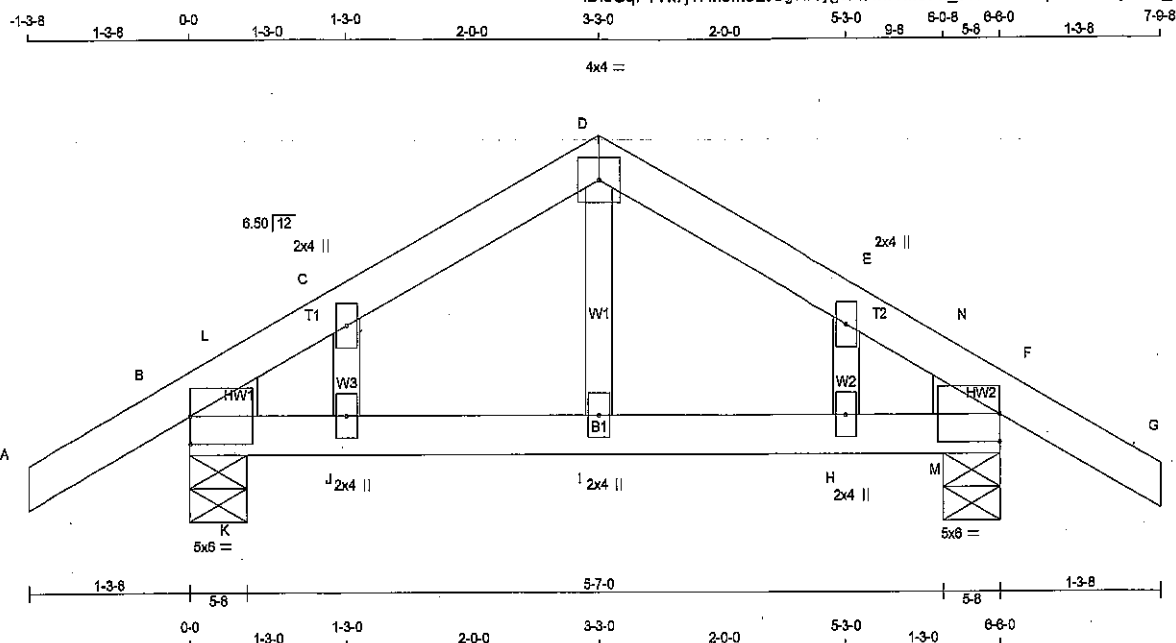

Scale = 1:17.3

TOTAL WEIGHT = 23 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - D	2x4	DRY	No.2	SPF			
D - G	2x4	DRY	No.2	SPF			
B - F	2x4	DRY	No.2	SPF			
ALL WEBS	2x3	DRY	No.2	SPF			
DRY: SEASONED LUMBER.							

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMBH1-I	MT20	5.0	6.0	2.50
C TMW+w	MT20	2.0	4.0	
D TTW-p	MT20	4.0	4.0	
E TMW+w	MT20	2.0	4.0	
F TMBH1-I	MT20	5.0	6.0	2.50
H, I, J				
H BMW+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG	HEEL
JT	VERT	HORZ	DOWN	HORZ	WEDGE
B	480	0	480	0	2x4 L
F	480	0	480	0	2x4 R

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	377	238 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0
F	377	238 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1	MAX	MEMB.	FORCE
FR-TO	(LBS)	(PLF)	CSI (LC)	FR-TO	(LBS)
A-B	0 / 17	-84.3	-84.3 0.11 (1)	I-D	0 / 151
B-L	-525 / 0	-84.3	-84.3 0.11 (1)	H-E	-81 / 26
L-C	-322 / 0	-84.3	-84.3 0.05 (1)	J-C	-81 / 26
C-D	-298 / 0	-84.3	-84.3 0.06 (1)	K-L	0 / 225
D-E	-298 / 0	-84.3	-84.3 0.06 (1)	M-N	0 / 227
E-N	-322 / 0	-84.3	-84.3 0.05 (1)		
N-F	-527 / 0	-84.3	-84.3 0.11 (1)		
F-G	0 / 17	-84.3	-84.3 0.11 (1)		
B-K	0 / 267	-28.0	-28.0 0.11 (1)		
K-J	0 / 287	-28.0	-28.0 0.11 (1)		
J-I	0 / 261	-28.0	-28.0 0.08 (1)		
I-H	0 / 281	-28.0	-28.0 0.08 (1)		
H-M	0 / 267	-28.0	-28.0 0.11 (1)		
M-F	0 / 267	-28.0	-28.0 0.11 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
DL = 3.0 PSF	
BOT CH.	LL = 10.5 PSF
DL = 7.0 PSF	
TOTAL LOAD = 46.1 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.22")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.11/1.00 (F-N:1), SC=0.11/1.00 (H-M:1),
WB=0.03/1.00 (D-I:2), SS=0.10/1.00 (F-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1867
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (F) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)



DWG NO. TAM 21176-18
STRUCTURAL
COMPONENT ONLY




DWG NO. TAM 44563-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T92Z4	2	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MITek Industries, Inc. Fri Sep 01 17:32:02 2017 Page 1

ID:w3K2IB2K4fGk9tDO7SkJphylfMC-74xV_YODJSMuzQuesn?2pIpJcnTcUdIXwfJVm7yhxoh

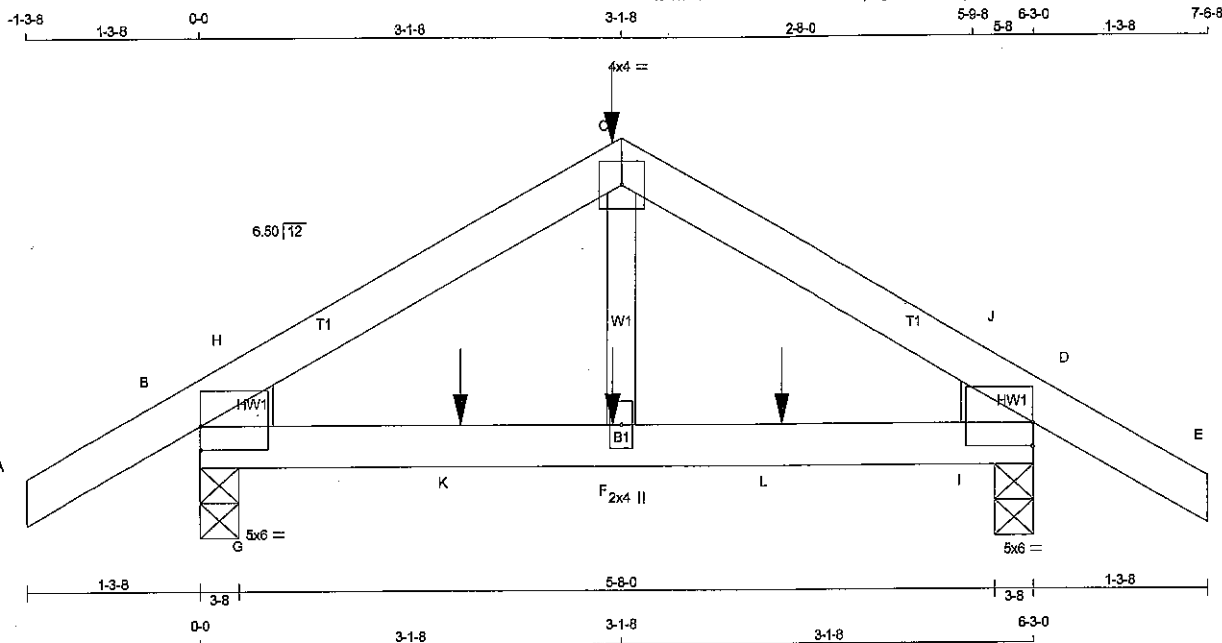

TOTAL WEIGHT = 2 X 22 = 43 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMBH1-I	MT20	5.0	6.0 2.00
C	TTW-p	MT20	4.0	4.0
D	TMBH1-I	MT20	5.0	6.0 2.00
F	BMW+w	MT20	2.0	4.0

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 372.3 lbs FACTORED DOWN AT 3-1-8 ON TOP CHORD, AND 11.9 lbs FACTORED DOWN AND 2.9 lbs FACTORED UP AT 1-11-4, AND 31.5 lbs FACTORED DOWN AT 3-0-12, AND 11.9 lbs FACTORED DOWN AND 2.9 lbs FACTORED UP AT 4-3-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQ'D		HEEL	
JT	VERT	HORZ	DOWN	DOWN	UP/LIFT	BRG	IN-SX	BRG	IN-SX	WEDGE	
B	664	0	664	0	0	3-8	3-8	3-8	3-8	2x4 L	
D	664	0	664	0	0	3-8	3-8	3-8	3-8	2x4 R	

UNFACTORED REACTIONS

1ST LOSE		MAX./MIN. COMPONENT REACTIONS									
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL				
B	519	333 / 0	90 / 0	0 / 0	0 / 0	96 / 0	0 / 0				
D	519	333 / 0	90 / 0	0 / 0	0 / 0	96 / 0	0 / 0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (CSI) (LC)	MEMB.	FORCE (LBS)	MAX (LBS)	MAX (LC)
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 17	-84.3 -84.3	0.12 (1) 10.00	F-C	0 / 162	0.04 (3)	
B-H	-821 / 0	-84.3 -84.3	0.11 (1) 6.25	G-H	0 / 167	0.00 (1)	
H-C	-674 / 0	-84.3 -84.3	0.11 (1) 6.25	I-J	0 / 167	0.00 (1)	
C-J	-674 / 0	-84.3 -84.3	0.11 (1) 6.25				
J-D	-821 / 0	-84.3 -84.3	0.11 (1) 6.25				
D-E	0 / 17	-84.3 -84.3	0.12 (1) 10.00				
B-G	0 / 582	-28.0 -28.0	0.14 (1) 10.00				
G-K	0 / 582	-28.0 -28.0	0.14 (1) 10.00				
K-F	0 / 582	-28.0 -28.0	0.14 (1) 10.00				
F-L	0 / 582	-28.0 -28.0	0.14 (1) 10.00				
L-I	0 / 582	-28.0 -28.0	0.14 (1) 10.00				
I-D	0 / 582	-28.0 -28.0	0.14 (1) 10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	3-1-8	-372	-372	—	FRONT	VERT	TOTAL
F	3-0-12	-31	-31	—	FRONT	VERT	TOTAL
K	1-11-4	3	-12	3	FRONT	VERT	TOTAL
L	4-3-12	3	-12	3	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12 (D-E:1), BC=0.14 (D:1), WB=0.04 (C-F:3), SSI=0.11 (C-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 622 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.80 (D) (INPUT = 0.80)
JSI METAL = 0.15 (D) (INPUT = 1.00)

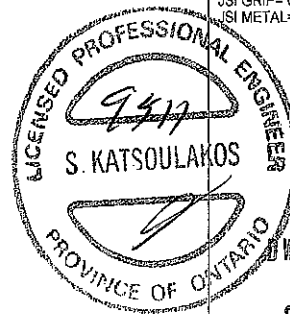

DRWG NO. TAM 44564-17
STRUCTURAL
COMPONENT ONLY

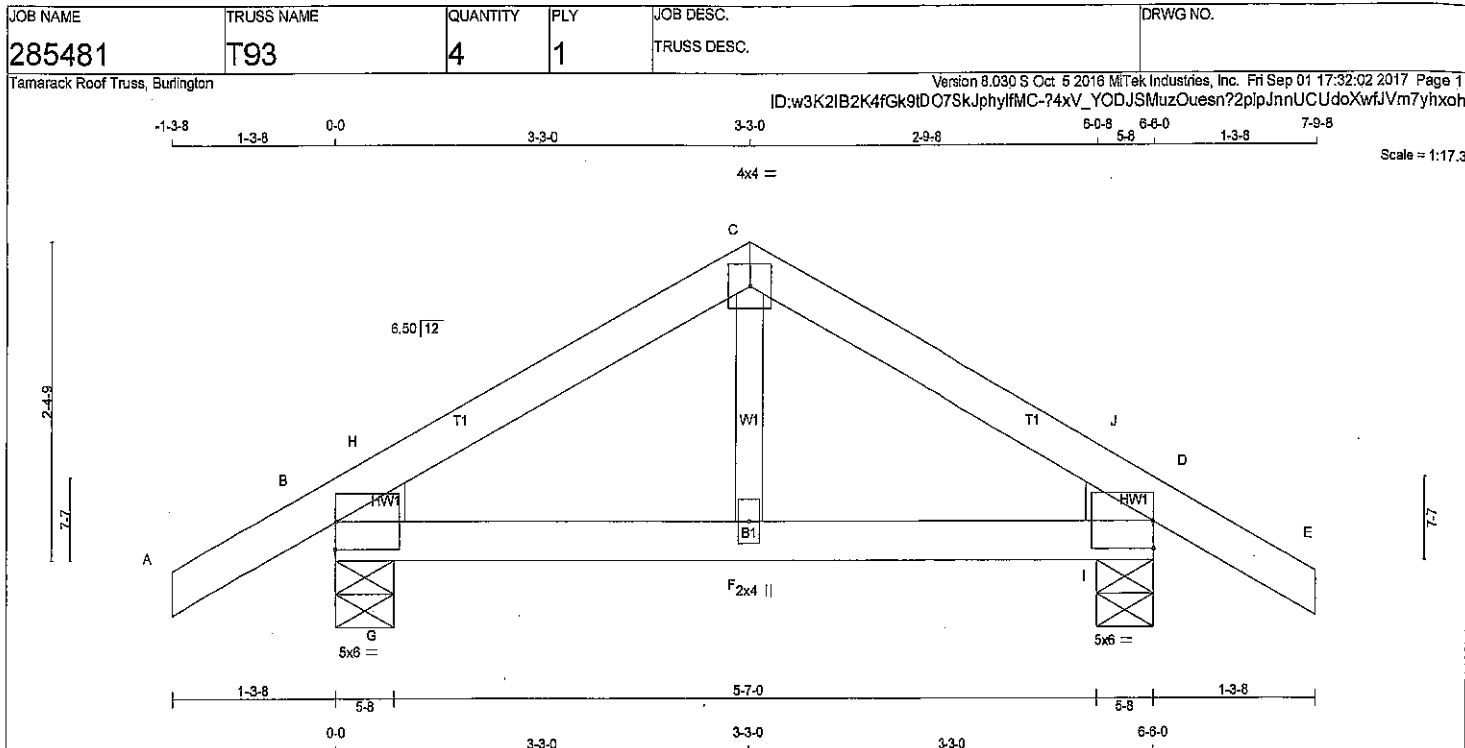

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMBH1-I	MT20	5.0	6.0		
C	TTW-p	MT20	4.0	4.0		
D	TMBH1-I	MT20	5.0	6.0		
F	BMW+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
B	480	0	480	0	5-8	5-8	2x4 L
D	480	0	480	0	5-8	5-8	2x4 R

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	377	236 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0
D	377	236 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 17	-84.3	-84.3	0.11 (1)	10.00	F-C	0 / 155	0.04 (2)	
B-H	-412 / 0	-84.3	-84.3	0.05 (1)	6.25	G-H	-34 / 113	0.00 (1)	
H-C	-355 / 0	-84.3	-84.3	0.08 (1)	6.25	I-J	-34 / 113	0.00 (1)	
C-J	-355 / 0	-84.3	-84.3	0.08 (1)	6.25				
J-D	-412 / 0	-84.3	-84.3	0.05 (1)	6.25				
D-E	0 / 17	-84.3	-84.3	0.11 (1)	10.00				
B-G	0 / 305	-28.0	-28.0	0.08 (1)	10.00				
G-F	0 / 305	-28.0	-28.0	0.10 (1)	10.00				
F-I	0 / 305	-28.0	-28.0	0.10 (1)	10.00				
I-D	0 / 305	-28.0	-28.0	0.08 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.22")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.11 (A-B:1), BC=0.10 (F-G:1), WB=0.04 (C-F:2), SSI=0.09 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 922 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (D) (INPUT = 0.90)
JSI METAL= 0.10 (D) (INPUT = 1.00)




WIND NO. TAMA44565-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T93Z	2	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2018 MitTek Industries, Inc. Fri Sep 01 17:32:02 2017 Page 1

ID:w3K2IB2K4fGk9ID07SkJphyfMC-74xV_YODJSMuzOuesn72plpJcnU2UdIXwJm7yhxoh

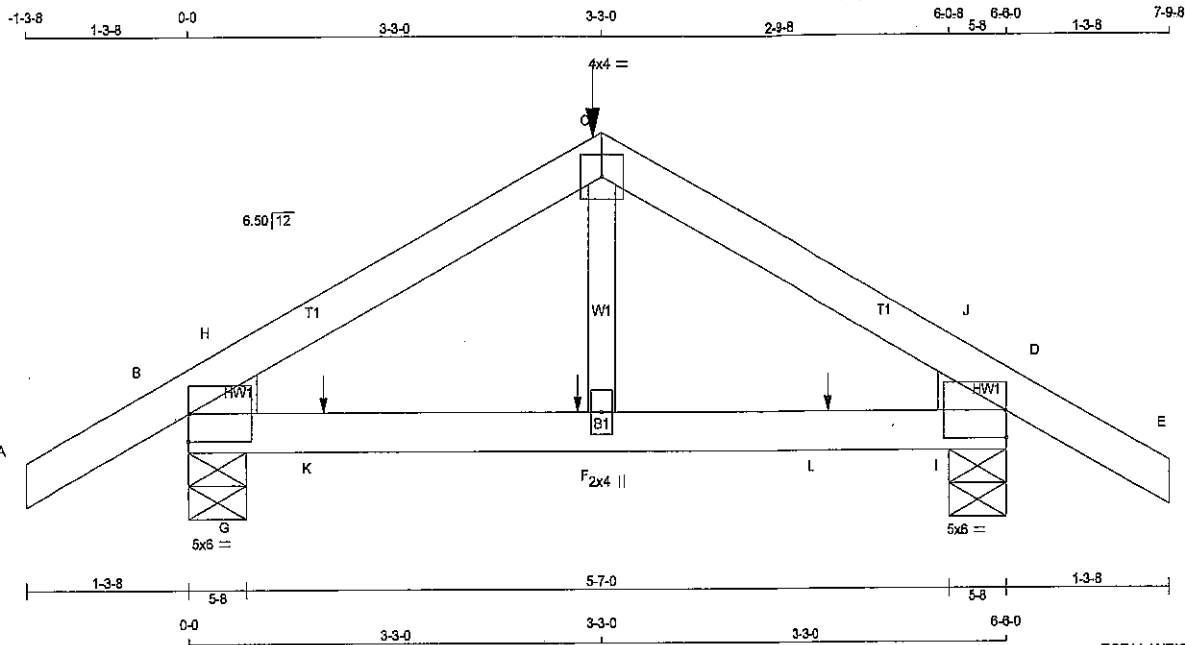

Scale = 1:17.3

TOTAL WEIGHT = 2 X 22 = 44 lb

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMBH1-I	MT20	5.0	6.0		
C	TTW-p	MT20	4.0	4.0		
D	TMBH1-I	MT20	5.0	6.0		
F	BMW-w	MT20	2.0	4.0		

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 2.4 lbs FACTORED DOWN AT 3-3-0 ON TOP CHORD, AND AT 1-0-12, AND AT 3-0-12, AND AT 5-0-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
B	481	0	481	0	5-8	5-8	2x4 L
D	481	0	481	0	5-8	5-8	2x4 R

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE		
B	378	236 / 0	69 / 0	0 / 0	74 / 0	0 / 0
D	378	236 / 0	69 / 0	0 / 0	74 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 (PLF)	MAX. (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. (LBS)	CSI (LC)
FR-TO		FROM	TO			FR-TO			
A-B	0 / 17	-84.3	-84.3	0.12 (1)	10.00	F-C	0 / 165	0.04 (2)	
B-H	-414 / 0	-84.3	-84.3	0.07 (1)	6.25	G-H	-33 / 114	0.00 (1)	
H-C	-357 / 0	-84.3	-84.3	0.10 (1)	6.25	I-J	-33 / 114	0.00 (1)	
C-J	-357 / 0	-84.3	-84.3	0.10 (1)	6.25				
J-D	-414 / 0	-84.3	-84.3	0.07 (1)	6.25				
D-E	0 / 17	-84.3	-84.3	0.12 (1)	10.00				
B-G	0 / 307	-28.0	-28.0	0.09 (1)	10.00				
G-K	0 / 307	-28.0	-28.0	0.11 (1)	10.00				
K-F	0 / 307	-28.0	-28.0	0.11 (1)	10.00				
F-L	0 / 307	-28.0	-28.0	0.11 (1)	10.00				
L-I	0 / 307	-28.0	-28.0	0.11 (1)	10.00				
I-D	0 / 307	-28.0	-28.0	0.09 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
C	3-3-0	-2	-2	---	FRONT	VERT	TOTAL
F	3-0-12	---	---	---	FRONT	VERT	TOTAL
K	1-0-12	---	---	---	FRONT	VERT	TOTAL
L	5-0-12	---	---	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	46.1	PSF	

SPACING = 24.0 IN. C/C

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCSC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.22")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.22")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12 (A-B:1), BC=0.11 (F-G:1), WB=0.04 (C-F:2), CSI=0.10 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES		PLATE GRIP(DRY) SHEAR		SECTION	
(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
MT20	618	354	1687	622	2284


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (D) (INPUT = 0.90)
JSI METAL= 0.10 (D) (INPUT = 1.00)

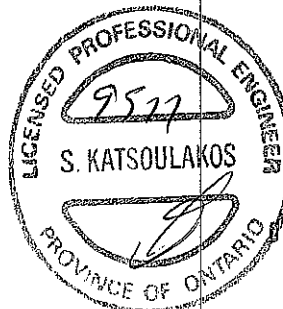

DRWG NO. TAM 44566-17
STRUCTURAL
COMPONENT ONLY



HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 75.0 lbs FACTORED DOWN AT 2'-11" 9.4 lbs FACTORED DOWN AT 4'-0" 12, 9.4 lbs FACTORED DOWN AT 5'-0" 12, AND 9.4 lbs FACTORED DOWN AT 7'-0" 12, AND 24.5 lbs FACTORED DOWN AT 9'-0" 12 ON TOP CHORD, AND 14.8 lbs FACTORED DOWN AT 2'-0" 12, 14.8 lbs FACTORED DOWN AT 4'-0" 12, 14.8 lbs FACTORED DOWN AT 5'-0" 12, 14.8 lbs FACTORED DOWN AT 7'-0" 12, 14.8 lbs FACTORED DOWN AT 9'-0" 12, 110.7 lbs FACTORED DOWN AT 10'-10" 12, 138.0 lbs FACTORED DOWN AT 12'-10" 12, AND 138.0 lbs FACTORED DOWN AT 14'-10" 12, AND 148.8 lbs FACTORED DOWN AT 17'-4" 8 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

N-S	0/0	-28.0	-28.0	0.04 (3)	10.00
S-M	0/0	-28.0	-28.0	0.04 (3)	10.00
M-T	0/1011	-28.0	-28.0	0.17 (1)	10.00
T-U	0/1011	-28.0	-28.0	0.17 (1)	10.00
U-L	0/1011	-28.0	-28.0	0.17 (1)	10.00
L-V	0/1796	-28.0	-28.0	0.27 (1)	10.00
V-W	0/1796	-28.0	-28.0	0.27 (1)	10.00
W-K	0/1796	-28.0	-28.0	0.27 (1)	10.00
K-X	0/1784	-28.0	-28.0	0.33 (1)	10.00
X-J	0/1784	-28.0	-28.0	0.33 (1)	10.00
J-Y	0/1784	-28.0	-28.0	0.33 (1)	10.00
Y-I	0/1784	-28.0	-28.0	0.33 (1)	10.00
I-Z	0/0	-28.0	-28.0	0.08 (7)	10.00
Z-H	0/0	-28.0	-28.0	0.08 (7)	10.00

MEMB.	WEBS	
	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		
M-C	-195 / 48	0.03 (1)
C-L	0 / 838	0.15 (1)
L-D	-358 / 0	0.05 (1)
L-E	-209 / 0	0.05 (1)
K-E	0 / 270	0.05 (2)
E-I	-1427 / 0	0.46 (1)
I-F	0 / 160	0.03 (2)
I-G	0 / 1277	0.23 (1)
B-M	0 / 1072	0.19 (1)

A circular professional seal for a Licensed Professional Engineer in the Province of Ontario. The outer ring contains the text "LICENSED PROFESSIONAL ENGINEER" at the top and "PROVINCE OF ONTARIO" at the bottom. In the center, the license number "268" is written in a stylized script above the name "S. KATSOULAKOS" in a bold, sans-serif font. A diagonal line is drawn across the bottom half of the seal.

JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.38 (J) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285495	T100S	1	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 MiTek Industries, Inc. Tue Feb 6 11:03:31 2018 Page 2

ID:PFehc1Ba2cOYemTQTAym6Qv11EX-AVzrkCmZRpbAvhQwGMLiFWnQoXHXaEYIsnTodznuUg

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
T	4-0-12	-8	-15	---	BACK	VERT	TOTAL
U	5-0-12	-8	-15	---	BACK	VERT	TOTAL
V	7-0-12	-8	-15	---	BACK	VERT	TOTAL
W	9-0-12	-8	-15	---	BACK	VERT	TOTAL
X	10-10-12	-111	-111	---	BACK	VERT	TOTAL
Y	12-10-12	-138	-138	---	BACK	VERT	TOTAL
Z	14-10-12	-138	-138	---	BACK	VERT	TOTAL




DWG NO. TAM 9108.8
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285495	T101	1	3	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 MITek Industries, Inc. Tue Feb 6 11:03:31 2018 Page 1

ID:PFehc1Ba2cOYemTQTAYm6Oy1EX-AVzrKCmZRpAvhQwGMLIFWtcoX9XZHYisnTodznuUg

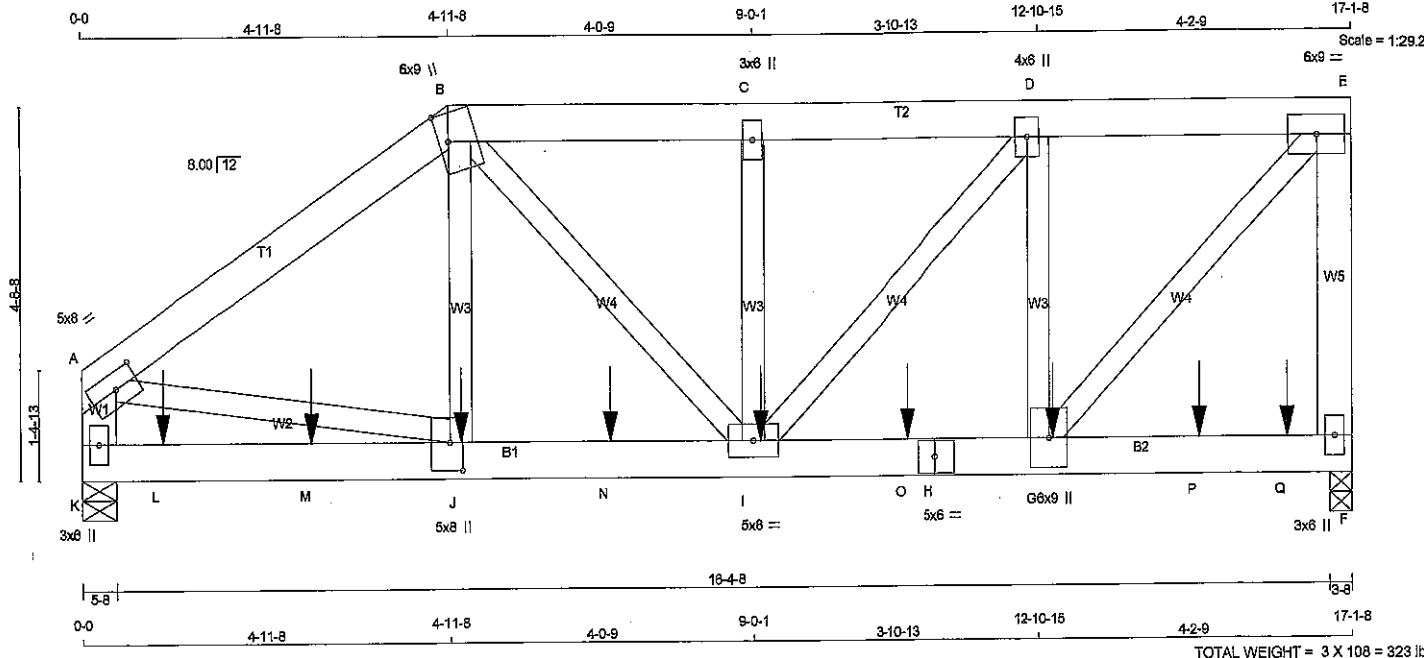

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - B	2x6	DRY No.2	SPF
B - E	2x6	DRY No.2	SPF
F - E	2x6	DRY No.2	SPF
K - A	2x6	DRY No.2	SPF
K - H	2x6	DRY 2100F 1.8E	SPF
H - F	2x6	DRY 2100F 1.8E	SPF

ALL WEBS 2x4 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - B 2	12	TOP
B - E 2	12	TOP
E - F 2	12	TOP
K - A 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
K - H 2	8	SIDE (582.4)
H - F 2	7	SIDE (593.7)
WEBS: (0.122"x3") SPIRAL NAILS		
2x4 1	6	

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	6.0	2.50	3.75
B	TTWW+m	MT20	6.0	9.0	4.25	1.50
C	TMW+w	MT20	3.0	6.0		
D	TMW+t	MT20	4.0	6.0		
E	TMVW-t	MT20	6.0	9.0		
F	BMV1+p	MT20	3.0	6.0		
G	BMW+t	MT20	6.0	9.0		
H	BS-t	MT20	5.0	6.0		
I	BMW+t	MT20	5.0	8.0		
J	BMW+t	MT20	5.0	8.0	4.25	2.00
K	BMV1+p	MT20	3.0	6.0		

HANGERS NOTES

1)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
F	9104	0	8104	0	3-8	3-8		
K	8571	0	8571	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
F	7410	4219 / 0	1618 / 0	0 / 0	0 / 0	1573 / 0	0 / 0
K	6946	4004 / 0	1483 / 0	0 / 0	0 / 0	1458 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.75 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX.		WEBS		MAX.	
	FORCE (LBS)	VERT. (PLF)	LC1 (PLF)	MAX (PLF)	CS1 (LC)	MAX (LC)	MEMB. FORCE (LBS)	MAX (LBS)	CS1 (LC)	MAX (LC)
FR-TO										
A-B	-9235 / 0	-84.3	-84.3	0.11 (1)	4.75	J-B	0 / 3699	0.20 (1)		
B-C	-8777 / 0	-84.3	-84.3	0.08 (1)	4.87	A-J	0 / 7785	0.42 (1)		
C-D	-8777 / 0	-84.3	-84.3	0.08 (1)	4.87	G-E	0 / 9745	0.52 (1)		
D-E	-6964 / 0	-84.3	-84.3	0.07 (1)	5.36	B-I	0 / 1420	0.08 (1)		
F-E	-7109 / 0	0.0	0.0	0.45 (1)	6.68	G-D	-2402 / 0	0.18 (1)		
K-A	-8703 / 0	0.0	0.0	0.14 (1)	6.84	I-C	-258 / 2	0.02 (1)		
						I-D	0 / 2628	0.15 (1)		
K-L	0 / 0	-28.0	-28.0	0.25 (1)	10.00					
L-M	0 / 0	-28.0	-28.0	0.25 (1)	10.00					
M-J	0 / 0	-28.0	-28.0	0.25 (1)	10.00					
J-N	0 / 7795	-28.0	-28.0	0.34 (1)	10.00					
N-I	0 / 7795	-28.0	-28.0	0.34 (1)	10.00					
I-O	0 / 6864	-28.0	-28.0	0.27 (1)	10.00					
O-H	0 / 6864	-28.0	-28.0	0.27 (1)	10.00					
H-G	0 / 6864	-28.0	-28.0	0.27 (1)	10.00					
G-P	0 / 0	-28.0	-28.0	0.24 (1)	10.00					
P-Q	0 / 0	-28.0	-28.0	0.24 (1)	10.00					
Q-F	0 / 0	-28.0	-28.0	0.24 (1)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
G	13-1-4	-1712	-1712		FRONT	VERT	TOTAL
I	9-1-4	-1712	-1712		FRONT	VERT	TOTAL
J	5-1-4	-1826	-1826		FRONT	VERT	TOTAL
L	1-1-4	-1826	-1826		FRONT	VERT	TOTAL
M	3-1-4	-1826	-1826		FRONT	VERT	TOTAL
N	7-1-4	-1712	-1712		FRONT	VERT	TOTAL
O	11-1-4	-1712	-1712		FRONT	VERT	TOTAL
P	15-1-4	-1712	-1712		FRONT	VERT	TOTAL
Q	16-3-4	-1714	-1714		FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	3.0	PSF
BOT CH. LL	=	10.5	PSF
DL	=	7.0	PSF
TOTAL LOAD	=	48.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")
CALCULATED VERT. DEFL.(LL)= L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.57")
CALCULATED VERT. DEFL.(TL)= L/999 (0.11")

CS1: TC=0.45/1.00 (E-F:1), BC=0.34/1.00 (J-I:1),
WB=0.52/1.00 (E-G:1), SI=0.40/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667	822	2284	1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.86 (E) (INPUT = 0.90)
JSI METAL= 0.86 (J) (INPUT = 1.00)

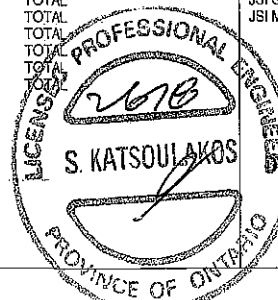

DRWG NO. TAM 8109
STRUCTURAL COMPONENT ONLY


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285495	T101	1	3	TRUSS DESC.	
Version 8.200 S Dec 12 2017 Mitek Industries, Inc. Tue Feb 6 11:03:31 2018 Page 2					
Tamarack Roof Truss, Burlington					
ID:PFehc1Ba2cOYemTQTAYm8QvifEX-AVzrKcmZRpbAvhQwGMLiffWtcoX9XZHYIsnTadznuUg					

HANGERS NOTES
 1) SPECIAL HANGER(S) OR CONNECTION(S)
 REQUIRED TO SUPPORT CONCENTRATED
 LOAD(S) 1826.2 lbs FACTORED DOWN AT 1-1-4,
 1826.2 lbs FACTORED DOWN AT 3-1-4, 1826.2
 lbs FACTORED DOWN AT 5-1-4, 1711.9 lbs
 FACTORED DOWN AT 7-1-4, 1711.9 lbs
 FACTORED DOWN AT 9-1-4, 1711.9 lbs
 FACTORED DOWN AT 11-1-4, 1711.9 lbs
 FACTORED DOWN AT 13-1-4, AND 1711.9 lbs
 FACTORED DOWN AT 15-1-4, AND 1714.0 lbs
 FACTORED DOWN AT 16-3-4 ON BOTTOM
 CHORD. DESIGN FOR UNSPECIFIED
 CONNECTION(S) IS DELEGATED TO THE
 BUILDING DESIGNER.

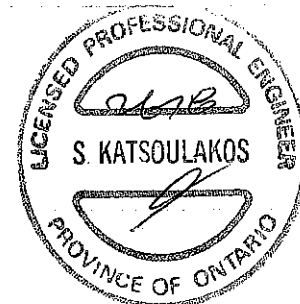


DWG NO. TAM 9109-38
 STRUCTURAL
 COMPONENT ONLY

ID:PFehc1Ba2cOYemTQTAYm6Oyi1EX-TGVuCuOr4mUlaYTrQVWHMyLUPBqsD4Gg9J33layhxog



TOTAL WEIGHT = $2 \times 18 = 36$ lb

DWG NO. TAM 44569-17
STRUCTURAL
COMPONENT ONLY



TOTAL WEIGHT = $2 \times 21 = 42$ lb

ALL WEBS	2x3	DRY	No.2	SPF
----------	-----	-----	------	-----

DRY-SEASONED LUMBER

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-m	MT20	4.0	4.0		
D	TMV+p	MT20	3.0	4.0		
E	BVMWW-i	MT20	4.0	9.0	2.00	3.00
F	BMV1+p	MT20	3.0	4.0		

BEARINGS

BEARINGS			MAXIMUM FACTORED			INPUT	REQ'D
FACTORED			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
G	166	0	166	0	0	HANGER BY OTHERS	
						MIN. SEAT SIZE: 18	
E	283	0	283	0	0	5-8	5-8

1ST CASE MAX./MIN. COMPONENT REACTIONS

1ST LEASE		MAXIMUM COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
G	136	78/0	31/0	0/0	0/0	30/0	0/0
E	216	147/0	31/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

TOTAL LOAD CASES: (5)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-B	0/37	-84.3	-84.3	0.12 (1)	10.00	C-E	-106/0	0.02 (1)	
B-C	-33/0	-84.3	-84.3	0.07 (1)	6.25	B-E	0/28	0.01 (1)	
C-D	0/0	-84.3	-84.3	0.01 (1)	10.00				
G-E	-166/0	0.0	0.0	0.02 (1)	7.81				
E-D	-33/0	0.0	0.0	0.01 (1)	7.81				
F-B	-241/0	0.0	0.0	0.03 (1)	7.81				
F-E	0/0	-28.0	-28.0	0.07 (3)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

SPECIFIED LOADS:

SPECIFIED LOADS:			
TOP	CH.	LL =	25.6 PSF
		DL =	3.0 PSF
BOT	CH.	LL =	10.5 PSF
		DL =	7.0 PSF
TOTAL LOAD		=	46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 088-09
- TPIG 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.12 (A-B:1), BC=0.07 (E-F:3), WB=0.02 (C-F:1), SSI=0.07 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	616	354	1667	822	2284	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOI = 5.0 Deg

ISI GRIP= 0.18 (B) (INPUT = 0.90)
ISI METAL= 0.04 (B) (INPUT = 1.00)

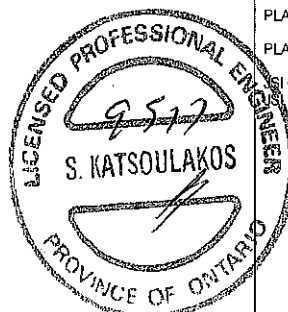


DWG NO. TAM 44570-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T104	4	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Fri Sep 01 17:32:03 2017 Page 1

ID:PFehc1Ba2cOYemTQTAYm6Oyi1EX-TGVuCuOr4mUlaYrQVWHMyLUFBqsD4dg9J33layhxog

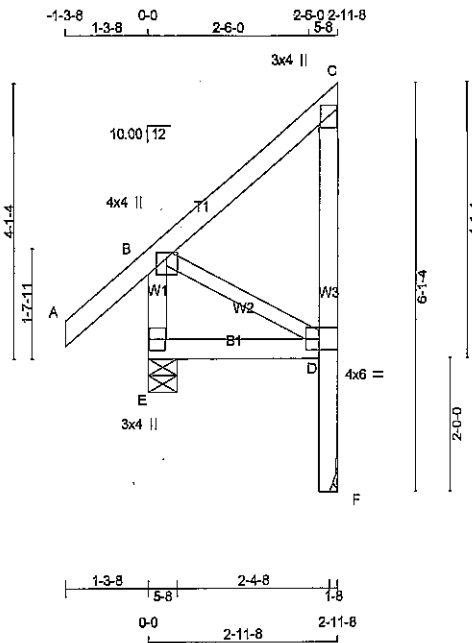


Scale = 1:34.5

TOTAL WEIGHT = 4 X 20 = 79 lb

LUMBER N. L. G. A. RULES CHORDS SIZE A - C 2x4 DRY No.2 F - C 2x4 DRY No.2 E - B 2x4 DRY No.2 E - D 2x4 DRY No.2 ALL WEBS 2x3 DRY No.2 DRY: SEASONED LUMBER.				DESCR. SPF SPF SPF SPF SPF				PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMVW+p MT20 4.0 4.0 1.00 2.00 C TMV+p MT20 3.0 4.0 D BVMW-I MT20 4.0 6.0 2.00 2.50 E BMV1+p MT20 3.0 4.0			
BEARINGS FACTORED GROSS REACTION JT VERT HORZ F 166 0 E 283 0 MAXIMUM FACTORED GROSS REACTION DOWN HORZ 166 0 283 0 INPUT BRG IN-SX 5-8 5-8 REQD BRG IN-SX HANGER BY OTHERS MIN. SEAT SIZE: 1-8				UNFACTORED REACTIONS 1ST LCASE JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL F 138 76/0 31/0 0/0 0/0 30/0 0/0 E 216 147/0 31/0 0/0 0/0 38/0 0/0				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 3.0 PSF BOT CH. LL = 10.5 PSF DL = 7.0 PSF TOTAL LOAD = 46.1 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, CBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 (55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.19") CALCULATED VERT. DEFL.(LL) = L/999 (0.01") ALLOWABLE DEFL.(TL)= L/360 (0.19") CALCULATED VERT. DEFL.(TL) = L/999 (0.01") CSI: TC=0.13 (B-C:1), BC=0.07 (D-E:3), WB=0.00 (B-D:1), SSI=0.07 (B-C:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 AUTOSOLVE RIGHT HEEL ONLY TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.19 (B) (INPUT = 0.90) JSI METAL= 0.04 (B) (INPUT = 1.00)			
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.				LOADING TOTAL LOAD CASES: (5) CHORDS MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. FACTORED VERT. LOAD (PLF) MAX. FACTORED VERT. LOAD (PLF) MAX. FACTORED VERT. LOAD (PLF) MAX. FACTORED VERT. LOAD (PLF) FR-TO FROM TO LENGTH FR-TO A-B 0/37 -84.3 -84.3 0.12 (1) 10.00 B-D 0/0 0.00 (1) B-C 0/0 -84.3 -84.3 0.13 (1) 10.00 F-D -166/0 0.0 0.0 0.02 (1) 7.81 D-C -125/0 0.0 0.0 0.04 (1) 7.81 E-B -241/0 0.0 0.0 0.03 (1) 7.81 E-D 0/0 -28.0 -28.0 0.07 (3) 10.00				CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN			



DWG NO. TAM 44576-17
STRUCTURAL
COMPONENT ONLY

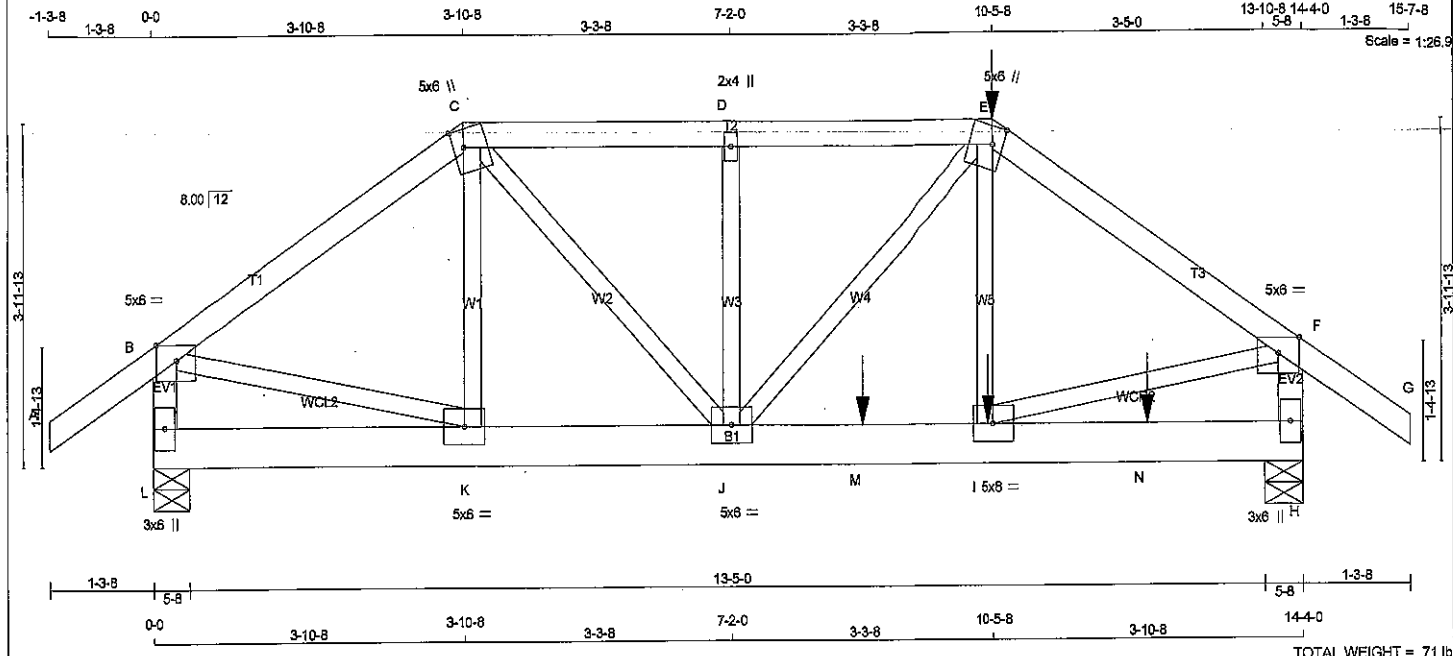

TOTAL WEIGHT = 71 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TTWW+m	MT20	5.0	6.0	2.50	1.50
D	TMW+w	MT20	2.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.50	1.50
F	TMVW-p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	6.0		
I	BMWW-t	MT20	5.0	6.0		
J	BMWW-t	MT20	5.0	6.0		
K	BMWW-t	MT20	5.0	6.0		
L	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 218.0 lbs FACTORED DOWN AT 10-5-8 ON TOP CHORD, AND 686.2 lbs FACTORED DOWN AT 8-9-8, AND 33.0 lbs FACTORED DOWN AT 10-4-12, AND 41.0 lbs FACTORED DOWN AT 12-4-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	UP		
L	1253	0	1253	0	5-8	5-8
H	1534	0	1534	0	5-8	5-8

UNFACTORED REACTIONS

JT	MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	998	602 / 0	198 / 0	0 / 0	0 / 0	202 / 0	0 / 0
H	1223	737 / 0	238 / 0	0 / 0	0 / 0	247 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)	MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX CSI (LC)
FR-TO		FROM		FR-TO		FROM	
A-B	0 / 32	-84.3	-84.3 0.12 (1)	K-C	-190 / 60	0.05 (1)	
B-C	-1200 / 0	-84.3	-84.3 0.27 (1)	C-J	0 / 783	0.19 (1)	
C-D	-1520 / 0	-84.3	-84.3 0.17 (1)	J-D	-320 / 0	0.08 (1)	
D-E	-1520 / 0	-84.3	-84.3 0.17 (1)	J-E	0 / 274	0.07 (1)	
E-F	-1601 / 0	-84.3	-84.3 0.29 (1)	I-E	0 / 261	0.07 (2)	
F-G	0 / 32	-84.3	-84.3 0.12 (1)	B-K	0 / 1028	0.25 (1)	
L-B	-1197 / 0	0.0	0.0 0.13 (1)	I-F	0 / 1371	0.34 (1)	
H-F	-1503 / 0	0.0	0.0 0.17 (1)				
L-K	0 / 0	-28.0	-28.0 0.08 (2)				
K-J	0 / 991	-28.0	-28.0 0.22 (1)				
J-M	0 / 1335	-28.0	-28.0 0.50 (1)				
M-I	0 / 1335	-28.0	-28.0 0.50 (1)				
I-N	0 / 0	-28.0	-28.0 0.11 (1)				
N-H	0 / 0	-28.0	-28.0 0.11 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
E	10-5-8	-218	-218	-	FRONT	VERT	TOTAL
I	10-4-12	-19	-33	-	FRONT	VERT	TOTAL
M	8-9-8	-686	-686	-	FRONT	VERT	TOTAL
N	12-4-12	-23	-41	-	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.5 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.48")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.48")
CALCULATED VERT. DEFL.(TL) = L/998 (0.06")

CSI: TC=0.29/1.00 (E-F:1), BC=0.50/1.00 (I-J:1), WB=0.34/1.00 (F-I:1), SI=0.27/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	618	354	1887 822 2264 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (B) (INPUT = 0.90)
JSI METAL= 0.33 (K) (INPUT = 1.00)




DWG NO. TAM 21180-18
STRUCTURAL COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285482	T580	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 6.200 S Jan 6 2018 MITek Industries, Inc. Thu Apr 18 13:19:09 2018 Page 1

ID:w3K2lB2K4fGk9lDO7SkJphylfMC-961khldLenQB5FOCFUheSLCT33jCCow05j7zzP9Lm

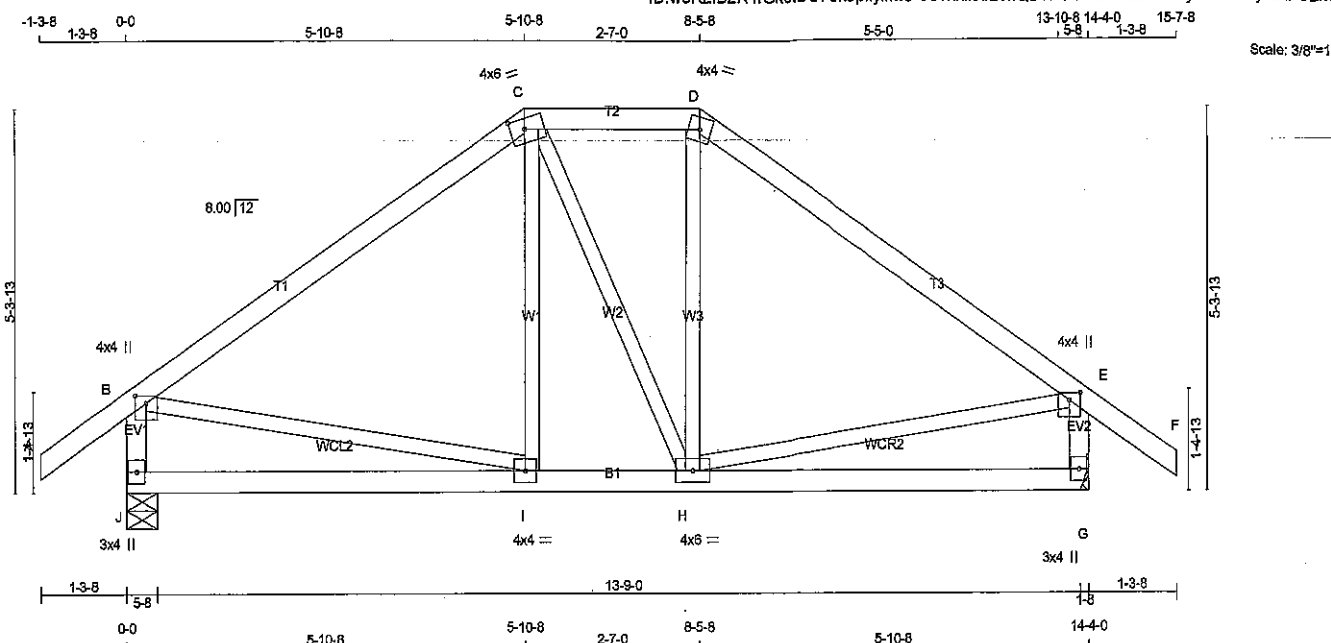

TOTAL WEIGHT = 63 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
J - G	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVV+p	MT20	4.0	4.0	1.25	2.00
C	TTWW-m	MT20	4.0	6.0	1.75	2.50
D	TTW-m	MT20	4.0	4.0		
E	TMVV+p	MT20	4.0	4.0	1.25	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMWWW-t	MT20	4.0	6.0		
I	BMWWW-t	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
J	920	0	920	0	5-8	5-8
G	920	0	920	0	HANGER BY OTHERS	MIN. SEAT SIZE: 1-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
J	739	437 / 0	151 / 0	0 / 0	0 / 0	152 / 0	0 / 0
G	739	437 / 0	151 / 0	0 / 0	0 / 0	152 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM	TO	LENGTH	FR-TO				
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	I-C	0 / 169	0.04 (3)	
B-C	-688 / 0	-84.3	-84.3	0.38 (1)	6.25	C-H	0 / 5	0.00 (3)	
C-D	-574 / 0	-84.3	-84.3	0.08 (1)	6.25	H-D	0 / 173	0.04 (3)	
D-E	-689 / 0	-84.3	-84.3	0.38 (1)	6.25	B-I	0 / 591	0.13 (1)	
E-F	0 / 32	-84.3	-84.3	0.11 (1)	10.00	H-E	0 / 592	0.13 (1)	
J-B	-849 / 0	0.0	0.0	0.09 (1)	7.81				
G-E	-849 / 0	0.0	0.0	0.09 (1)	7.81				
J-I	0 / 0	-28.0	-28.0	0.21 (2)	10.00				
I-H	0 / 573	-28.0	-28.0	0.27 (2)	10.00				
H-G	0 / 0	-28.0	-28.0	0.21 (2)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.8 PSF
DL	= 3.0 PSF	
BOT CH.	LL	= 10.5 PSF
DL	= 7.0 PSF	
TOTAL LOAD	= 46.1 PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC0 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.48")
CALCULATED VERT. DEFL.(LL)= L/999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.48")
CALCULATED VERT. DEFL.(TL)= L/999 (0.10")

CSI: TC=0.38/1.00 (D-E:1), BC=0.27/1.00 (H-I:2),
WB=0.13/1.00 (E-H:1), SS=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.79 (H) (INPUT = 0.90)
JSI METAL= 0.21 (I) (INPUT = 1.00)




DWG NO. TAM21101-18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43964	DRWG NO.
285482	T590	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MiTek Industries, Inc. Thu Apr 19 13:19:10 2018 Page 1

ID:w3K2IB2K4fGk9ID07SkJphyfMC-dJb7u5IEOfnefLgRxvmjER?a8sRPSf4y9gqhPzP9L

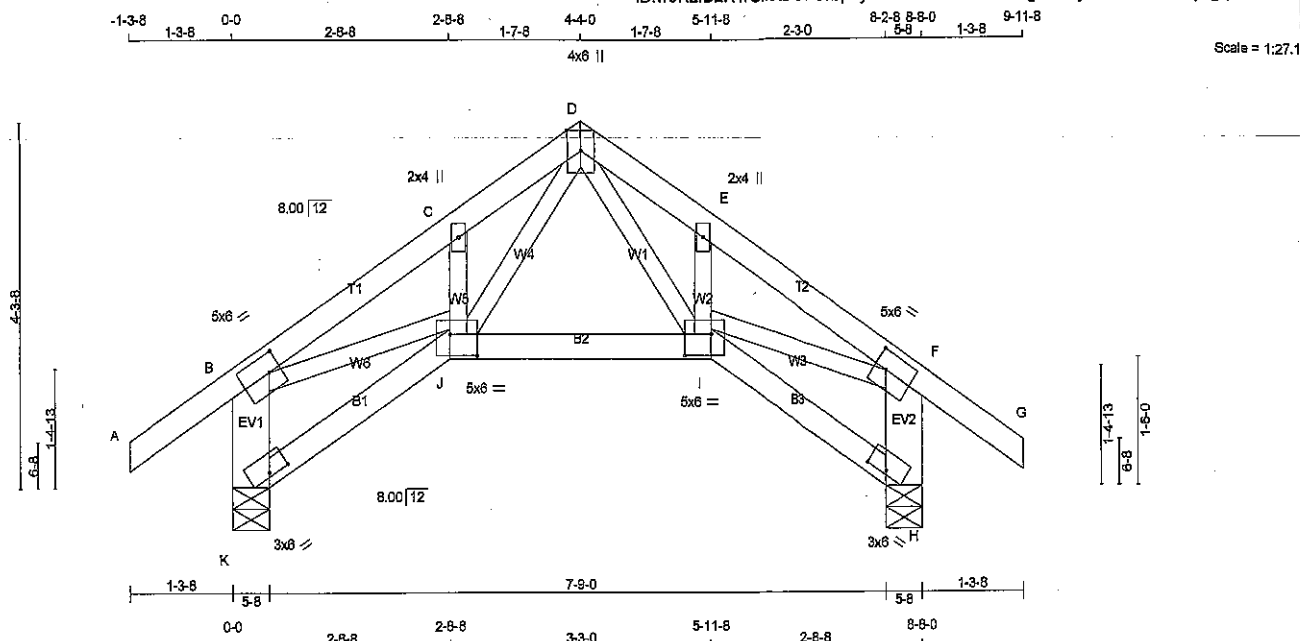

Scale = 1:27.1

TOTAL WEIGHT = 2 X 41 = 82 lb

LUMBER			
N. L. G. A. RULES	SIZE	DRY	DESCR.
CHORDS			
K - B	2x6	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x6	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-t	MT20	5.0	6.0	2.50 1.75
C	TMW+w	MT20	2.0	4.0	
D	TTWW+p	MT20	4.0	6.0	Edge
E	TMW+w	MT20	2.0	4.0	
F	TMVW-t	MT20	5.0	6.0	2.50 1.75
H	BVM1-I	MT20	3.0	6.0	0.50 3.00
I	BBWWW-p	MT20	5.0	6.0	3.00 4.00
J	BBWWW-p	MT20	5.0	6.0	3.00 4.00
K	BVM1-I	MT20	3.0	6.0	0.50 3.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
K	802	0	802	0	5-8	5-8
H	602	0	602	0	5-8	5-8

UNFACTORED REACTIONS						
JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS			
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
K	478	292 / 0	91 / 0	0 / 0	0 / 0	95 / 0
H	478	292 / 0	91 / 0	0 / 0	0 / 0	95 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING					
TOTAL LOAD CASES: (4)					
MEMB.	CHORDS		WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO	
K-B	-584 / 0	0.0 0.0 0.04 (1)	7.81	D-I	0 / 480 0.11 (1)
A-B	0 / 32	-84.3 -84.3 0.11 (1)	10.00	I-E	-209 / 0 0.03 (1)
B-C	-808 / 0	-84.3 -84.3 0.09 (1)	6.25	I-F	0 / 685 0.15 (1)
C-D	-825 / 0	-84.3 -84.3 0.03 (1)	6.25	J-D	0 / 480 0.11 (1)
D-E	-825 / 0	-84.3 -84.3 0.03 (1)	6.25	J-C	-209 / 0 0.03 (1)
E-F	-808 / 0	-84.3 -84.3 0.09 (1)	6.25	B-J	0 / 685 0.15 (1)
F-G	0 / 32	-84.3 -84.3 0.11 (1)	10.00		
H-F	-584 / 0	0.0 0.0 0.04 (1)	7.81		
K-J	0 / 0	-28.0 -28.0 0.06 (3)	10.00		
J-I	0 / 414	-28.0 -28.0 0.13 (2)	10.00		
I-H	0 / 0	-28.0 -28.0 0.06 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.11/1.00 (F-G:1), BC=0.13/1.00 (I-J:2), WB=0.15/1.00 (B-J:1), SS=0.08/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	818	354	1867	822	2284 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.23 (B) (INPUT = 1.00)

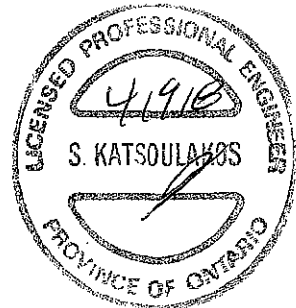


DRWG NO. TAM 4182-18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285482	T600	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MITek Industries, Inc. Thu Apr 19 13:19:10 2018 Page 1
ID:w3K2IB2K4fGK9tDO7SkJphyIMC-dJb7u5iEOne1LgRxvmJER?YksR7SgTy9gqHfPzP9L

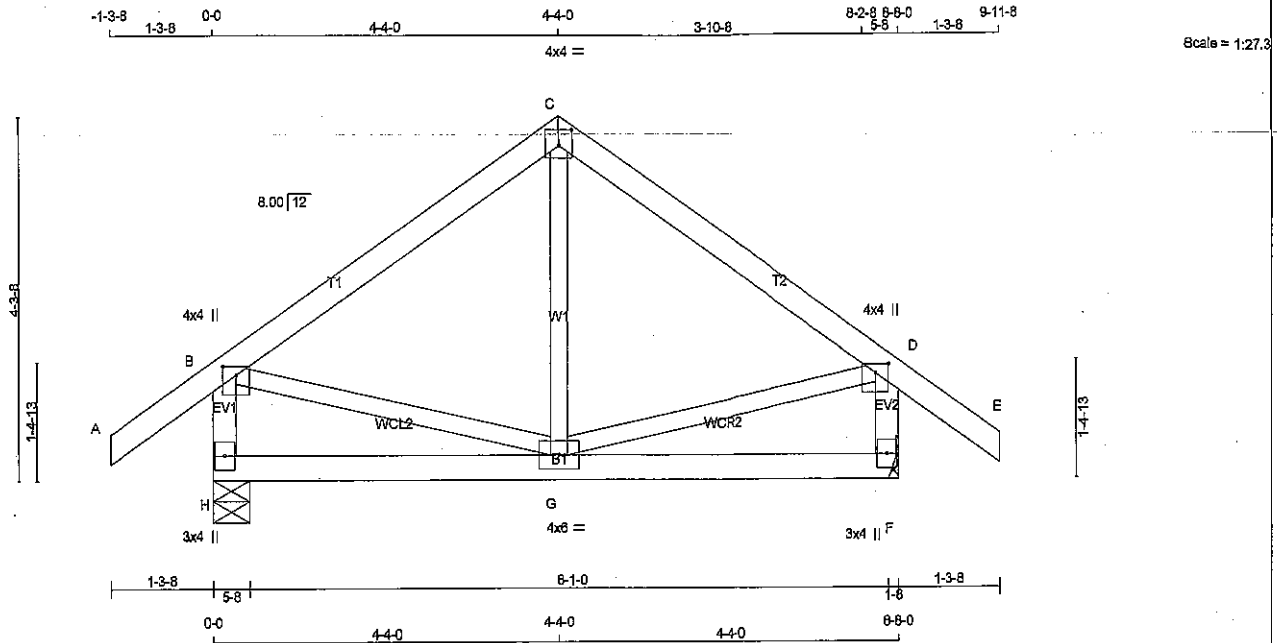

LUMBER	SIZE	DESCR.
N. L. G. A. RULES		
CHORDS		
A - C	2x4 DRY	No.2
C - E	2x4 DRY	No.2
H - B	2x4 DRY	No.2
F - D	2x4 DRY	No.2
H - F	2x4 DRY	No.2
ALL WEBS EXCEPT	2x3 DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTW-p	MT20	4.0	4.0	2.25	2.00
D	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	UP	DOWN	UP	IN-SX	IN-SX	
H	602	0	602	0	0	5-8	5-8		
F	602	0	602	0	0				HANGER BY OTHERS
									MIN. SEAT SIZE: 1-8

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	478	292 / 0	91 / 0	0 / 0	0 / 0	95 / 0	0 / 0
F	478	292 / 0	91 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	0 / 32	-84.3	-84.3 0.11 (1)	10.00	G-C	0 / 183	0.04 (3)
B-C	-337 / 0	-84.3	-84.3 0.20 (1)	6.25	B-G	0 / 289	0.07 (1)
C-D	-337 / 0	-84.3	-84.3 0.20 (1)	6.25	G-D	0 / 289	0.07 (1)
D-E	0 / 32	-84.3	-84.3 0.11 (1)	10.00			
H-B	-555 / 0	0.0	0.0 0.08 (1)	7.81			
F-D	-555 / 0	0.0	0.0 0.08 (1)	7.81			
H-G	0 / 0	-28.0	-28.0 0.15 (3)	10.00			
G-F	0 / 0	-28.0	-28.0 0.15 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.29")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.29")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.02")

CSI: TC=0.20/1.00 (C-D:1), BC=0.15/1.00 (F-G:3), WB=0.07/1.00 (B-G:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 822 2284 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.41 (G) (INPUT = 0.90)
JSI METAL= 0.12 (B) (INPUT = 1.00)




DRWG NO. TAM 21103-18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T610	2	1	TRUSS DESC.	


Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Fri Sep 01 17:32:05 2017 Page 1

ID:w3K2IB2K4fGk9tDO7SkJphyfMC-PfecaQ5cNkSqsDXwZIRNRcC?SHhv5zddY9NSyhxoE

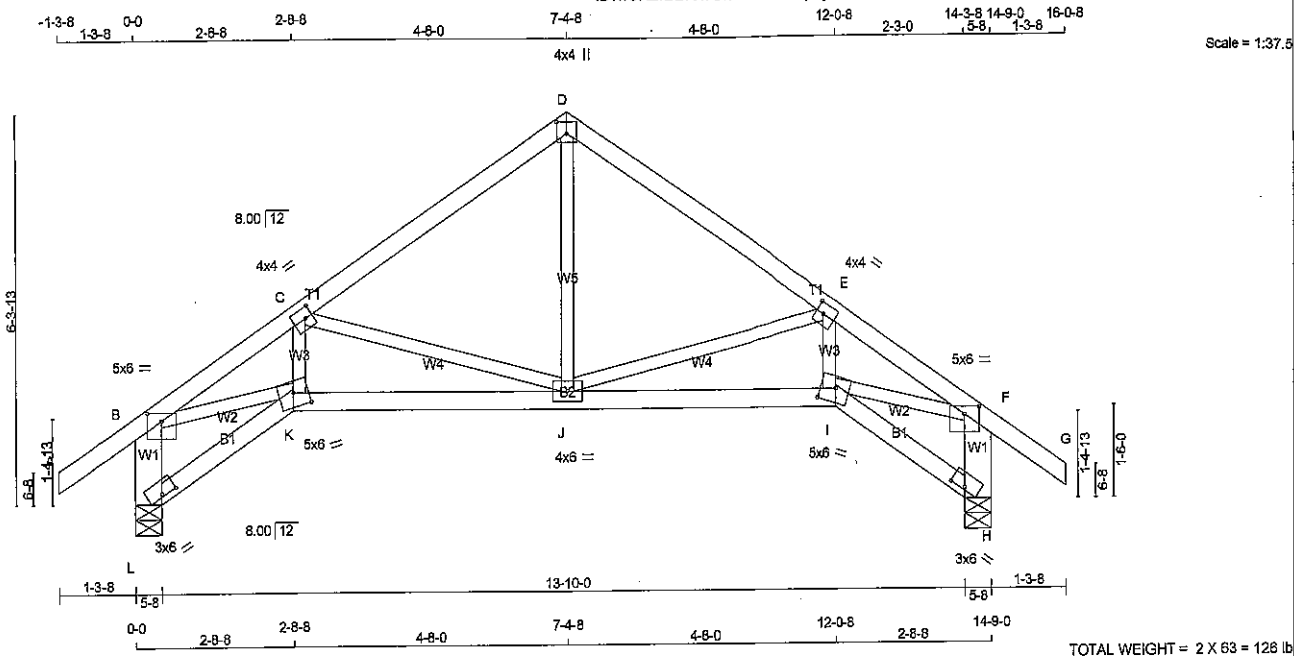


LUMBER N. L. G. A. RULES CHORDS SIZE L - B 2x6 DRY No.2 SPF A - D 2x4 DRY No.2 SPF D - G 2x4 DRY No.2 SPF H - F 2x6 DRY No.2 SPF L - K 2x4 DRY No.2 SPF K - I 2x4 DRY No.2 SPF I - H 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 25.8 PSF DL = 3.0 PSF BOT CH. LL = 10.5 PSF DL = 7.0 PSF TOTAL LOAD = 48.1 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 088-09 - TPIC 2011 (55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.49") CALCULATED VERT. DEFL.(LL) = L/999 (0.05") ALLOWABLE DEFL.(TL)= L/360 (0.49") CALCULATED VERT. DEFL.(TL) = L/999 (0.09") CSI: TC=0.22 (C-D:1), BC=0.33 (H-J:2), WB=0.32 (F-I:1), SSI=0.14 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.82 (B) (INPUT = 0.90) JSI METAL= 0.35 (I) (INPUT = 1.00)				BEARINGS FACTORED GROSS REACTION JT VERT HORZ L 944 0 H 944 0 UNFACTORED REACTIONS 1ST LCASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL L 758 448 / 0 155 / 0 0 / 0 0 / 0 158 / 0 0 / 0 H 758 448 / 0 155 / 0 0 / 0 0 / 0 158 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.99 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MEMB. MAX. FACTORED FORCE (LBS) FACTORED VERT. LOAD (PLF) MAX. LOAD LC1 MAX. MAX. UNBRAC LENGTH FR-TO FR-TO L-B -908 / 0 0.0 0.0 0.06 (1) 7.81 J-D 0 / 598 0.13 (1) A-B 0 / 32 -84.3 -84.3 0.11 (1) 10.00 J-E -732 / 0 0.28 (1) B-C -1676 / 0 -84.3 -84.3 0.16 (1) 4.99 I-E 0 / 320 0.07 (1) C-D -851 / 0 -84.3 -84.3 0.22 (1) 6.25 I-F 0 / 1434 0.32 (1) D-E -851 / 0 -84.3 -84.3 0.22 (1) 6.25 C-J -732 / 0 0.28 (1) E-F -1676 / 0 -84.3 -84.3 0.16 (1) 4.99 K-C 0 / 320 0.07 (1) F-G 0 / 32 -84.3 -84.3 0.11 (1) 10.00 B-K 0 / 1434 0.32 (1) H-F -908 / 0 0.0 0.0 0.06 (1) 7.81 L-K 0 / 0 -28.0 -28.0 0.06 (2) 10.00 K-J 0 / 1392 -28.0 -28.0 0.33 (2) 10.00 J-I 0 / 1392 -28.0 -28.0 0.33 (2) 10.00 I-H 0 / 0 -28.0 -28.0 0.06 (2) 10.00			
---	--	--	--	--	--	--	--	--	--	--	--

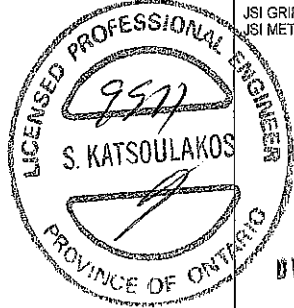

DRWG NO. TAM 44576-17

STRUCTURAL COMPONENT ONLY

Tamarack Roof Truss, Burlington Scale = 1:61.8

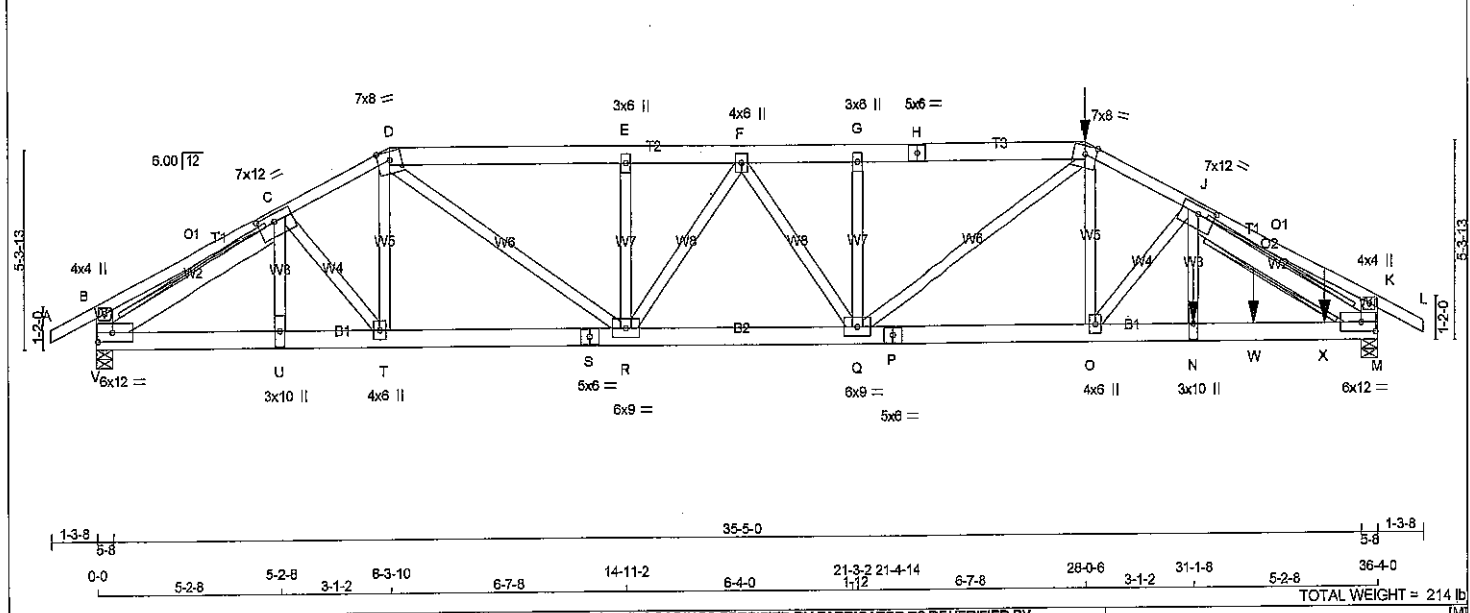

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
D - H	2x6	DRY	No.2	SPF
H - I	2x6	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
V - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
V - S	2x6	DRY	2100F 1.8E	SPF
S - P	2x6	DRY	2100F 1.8E	SPF
P - M	2x6	DRY	2100F 1.8E	SPF

ALL WEBS 2x4 DRY No.2 SPF

EXCEPT

V - C 2x6 DRY No.2 SPF

J - M 2x6 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	4.0	4.0		
C TMVWW+1	MT20	7.0	12.0	2.50	5.75
D TTWW-m	MT20	7.0	8.0	Edge	
E TMV+w	MT20	3.0	6.0		
F TMVWW+1	MT20	4.0	6.0		
G TMV+w	MT20	3.0	6.0		
H TS-1	MT20	5.0	6.0		
I TTWW-m	MT20	7.0	8.0	Edge	
J TMVWW+1	MT20	7.0	12.0	2.50	5.75
K TMV+p	MT20	4.0	4.0		
M BMVW+1	MT20	6.0	12.0	3.00	5.00
N BMV+w	MT20	3.0	10.0		
O BMVWW+1	MT20	4.0	6.0		
P BS-1	MT20	5.0	6.0		
Q BMVWW+1	MT20	6.0	9.0		
R BMVWW+1	MT20	6.0	9.0		
S BS-1	MT20	5.0	6.0		
T BMVWW+1	MT20	4.0	8.0		
U BMV+w	MT20	3.0	10.0		
V BMVW+1	MT20	6.0	12.0	3.00	5.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 499.5 lbs FACTORED DOWN AT 28-0.6 ON TOP CHORD, AND 237.4 lbs FACTORED DOWN AT 31-1.8, AND 71.7 lbs FACTORED DOWN AT 32-10.4, AND 71.7 lbs FACTORED DOWN AT 34-10.4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	2614	0	2614	0
JT HORZ	0	2614	0	5-8
M VERT	4849	0	4849	0
M HORZ	0	4849	0	5-8

UNFACTORED REACTIONS

	1ST CASE	MAX / MIN	COMPONENT REACTIONS
JT COMBINED	2118	1223 / 0	450 / 0
M COMBINED	3782	2155 / 0	824 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.12 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT C-V

2x4 DRY SPF No.2 I-BRACE AT J-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	
FR-TO		FROM TO	CS1 (LC)	MAX. UNBRAC LENGTH	FR-TO	CS1 (LC)	
A-B	0 / 26	-84.3 -84.3	0.12 (1)	10.00	U-C	0 / 169	
B-C	0 / 16	-84.3 -84.3	0.30 (1)	10.00	C-T	0 / 167	
C-D	-3695 / 0	-84.3 -84.3	0.51 (1)	3.04	T-D	0 / 243	
D-E	-5163 / 0	-84.3 -84.3	0.47 (1)	3.46	D-R	0 / 2104	
E-F	-5162 / 0	-84.3 -84.3	0.36 (1)	3.53	R-E	-578 / 0	
F-G	-5784 / 0	-84.3 -84.3	0.43 (1)	3.28	Q-G	-594 / 0	
G-H	-5783 / 0	-84.3 -84.3	0.54 (1)	3.22	Q-I	0 / 573	
H-I	-5783 / 0	-84.3 -84.3	0.54 (1)	3.22	O-I	0 / 1501	
I-J	-5998 / 0	-84.3 -84.3	0.75 (1)	2.12	O-J	-1640 / 0	
J-K	-1 / 13	-84.3 -84.3	0.32 (1)	10.00	N-J	0 / 2381	
K-L	0 / 26	-84.3 -84.3	0.12 (1)	10.00	V-C	-4095 / 0	
V-B	-297 / 0	0.0 0.0	0.02 (1)	7.81	J-M	-7684 / 0	
M-K	-304 / 0	0.0 0.0	0.02 (1)	7.81	R-F	-502 / 0	
V-U	0 / 3436	-28.0 -28.0	0.24 (1)	10.00	F-Q	0 / 378	
U-T	0 / 3436	-28.0 -28.0	0.22 (1)	10.00			
T-S	0 / 3470	-28.0 -28.0	0.23 (1)	10.00			
S-R	0 / 3470	-28.0 -28.0	0.23 (1)	10.00			
R-Q	0 / 5498	-28.0 -28.0	0.34 (1)	10.00			
Q-P	0 / 5323	-28.0 -28.0	0.32 (1)	10.00			
P-O	0 / 5323	-28.0 -28.0	0.32 (1)	10.00			
O-N	0 / 6445	-28.0 -28.0	0.44 (1)	10.00			
N-W	0 / 6447	-28.0 -28.0	0.46 (1)	10.00			
W-X	0 / 6447	-28.0 -28.0	0.46 (1)	10.00			
X-M	0 / 6447	-28.0 -28.0	0.46 (1)	10.00			

9517

S. KATSOUKAKOS

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	OR DEAD	TYPE
I	28-0.6	-45	-50		FRONT	VERT	
I	28-0.6	-455	-455		FRONT	VERT	

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")

CALCULATED VERT. DEFL.(LL) = L/999 (0.27")

ALLOWABLE DEFL.(TL) = L/360 (1.21")

CALCULATED VERT. DEFL.(TL) = L/999 (0.43")

CSI: TC=0.75 (I-J), BC=0.46 (M-N), WB=0.98 (J-M), SS=0.23 (G-H)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1687
	822	2284	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (P) (INPUT = 0.90)

JSI METAL= 0.98 (C) (INPUT = 1.00)

DRWG NO. TAM 44577-17

STRUCTURAL

COMPONENT ONLY

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T620	1	1	TRUSS DESC.	


Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc.
Fri Sep 01 17:32:05 2017
Page 2
ID:PFehc1Ba2cOYemTQTAYm6Oyl1EX-PfecaQ5cNkSqsDXwZIRNRg ?QEhlzddY9NSyhxoe

FACTORED CONCENTRATED LOADS (LBS)						
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.
N	31-1-8	-2373	-2373	—	FRONT	VERT
W	32-10-4	-41	-72	—	FRONT	VERT
X	34-10-4	-41	-72	—	FRONT	VERT
						TOTAL
						TOTAL
						TOTAL



DWG NO. TAM 44577.19
STRUCTURAL
COMPONENT ONLY

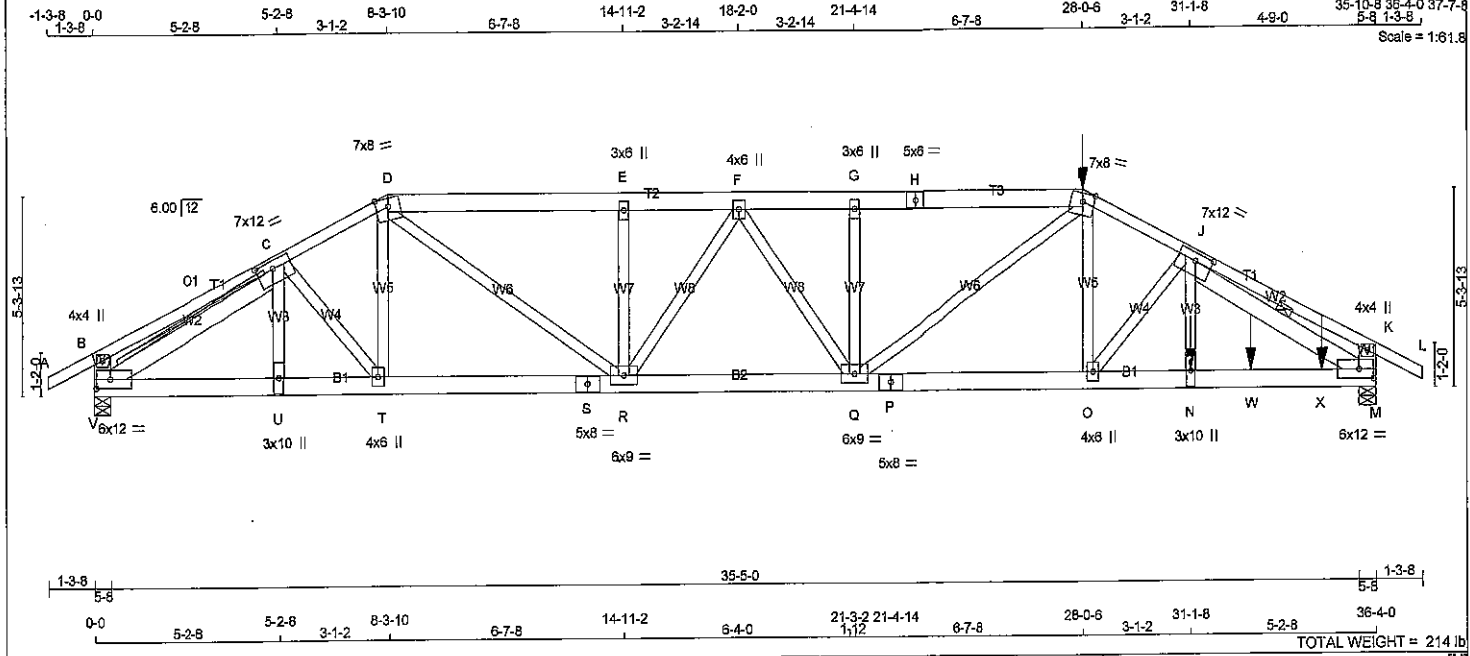

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2 SPF
D - H	2x6	DRY	No.2 SPF
H - I	2x6	DRY	No.2 SPF
I - L	2x4	DRY	No.2 SPF
V - B	2x6	DRY	No.2 SPF
M - K	2x6	DRY	No.2 SPF
V - S	2x6	DRY	2100F 1.8E SPF
S - P	2x6	DRY	2100F 1.8E SPF
P - M	2x6	DRY	2100F 1.8E SPF

ALL WEBS EXCEPT	2x4	DRY	No.2 SPF
V - C	2x6	DRY	No.2 SPF
J - M	2x6	DRY	No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	4.0	4.0		
C	TMVWW-t	MT20	7.0	12.0	2.50	5.75
D	TTWW-m	MT20	7.0	8.0		Edge
E	TMW+w	MT20	3.0	8.0		
F	TMW+t	MT20	4.0	6.0		
G	TMW+w	MT20	3.0	8.0		
H	TS-t	MT20	5.0	8.0		
I	TTWW-m	MT20	7.0	8.0		Edge
J	TMVWW-t	MT20	7.0	12.0	2.50	5.75
K	TMV+p	MT20	4.0	4.0		
M	BMVWW-t	MT20	6.0	12.0	3.00	4.75
N	BMW+w	MT20	3.0	10.0		
O	BMW+t	MT20	4.0	6.0		
P	BS-t	MT20	5.0	8.0		
Q	BMVWW-t	MT20	6.0	9.0		
R	BMVWW-t	MT20	6.0	9.0		
S	BS-t	MT20	5.0	8.0		
T	BMVWW-t	MT20	4.0	6.0		
U	BMW+w	MT20	3.0	10.0		
V	BMVWW-t	MT20	6.0	12.0	3.00	4.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 499.5 lbs FACTORED DOWN AT 28'-0" ON TOP CHORD, AND 2516.4 lbs FACTORED DOWN AT 31'-8" AND 71.7 lbs FACTORED DOWN AT 32'-10.4" AND 71.7 lbs FACTORED DOWN AT 34'-10.4" ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	HORZ
V	2634	0	2634	0
M	4771	0	4771	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
V	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
V	2130	1236 / 0	450 / 0	0 / 0	0 / 0	445 / 0	0 / 0
M	3863	2233 / 0	821 / 0	0 / 0	0 / 0	809 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.06 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF J-M.
2x4 DRY SPF No.2 T-BRACE AT C-V

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 8" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1) (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1) (LBS)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 26	-84.3	-84.3	0.12 (1)	10.00	U-C	0 / 169
B-C	0 / 18	-84.3	-84.3	0.30 (1)	10.00	C-T	0 / 86
C-D	-3934 / 0	-84.3	-84.3	0.52 (1)	3.02	T-D	0 / 242
D-E	-5225 / 0	-84.3	-84.3	0.48 (1)	3.44	D-R	0 / 2139
E-F	-5225 / 0	-84.3	-84.3	0.37 (1)	3.51	R-E	-578 / 0
F-G	-5874 / 0	-84.3	-84.3	0.43 (1)	3.25	Q-G	-565 / 0
G-H	-5873 / 0	-84.3	-84.3	0.55 (1)	3.18	Q-I	0 / 538
H-I	-5873 / 0	-84.3	-84.3	0.55 (1)	3.18	O-I	0 / 1580
I-J	-6131 / 0	-84.3	-84.3	0.77 (1)	2.08	O-J	-1737 / 0
J-K	-1 / 13	-84.3	-84.3	0.32 (1)	10.00	N-J	0 / 2497
K-L	0 / 26	-84.3	-84.3	0.12 (1)	10.00	V-C	-4132 / 0
V-B	-297 / 0	0.0	0.0	0.02 (1)	7.81	J-M	-7904 / 0
M-K	-304 / 0	0.0	0.0	0.02 (1)	7.81	R-F	-627 / 0
V-U	0 / 3487	-28.0	-28.0	0.24 (1)	10.00	F-Q	0 / 257
U-T	0 / 3467	-28.0	-28.0	0.23 (1)	10.00		
T-S	0 / 3504	-28.0	-28.0	0.23 (1)	10.00		
S-R	0 / 3504	-28.0	-28.0	0.23 (1)	10.00		
R-Q	0 / 5973	-28.0	-28.0	0.34 (1)	10.00		
Q-P	0 / 5441	-28.0	-28.0	0.33 (1)	10.00		
P-O	0 / 5441	-28.0	-28.0	0.33 (1)	10.00		
O-N	0 / 6829	-28.0	-28.0	0.45 (1)	10.00		
N-W	0 / 6631	-28.0	-28.0	0.48 (1)	10.00		
W-X	0 / 6631	-28.0	-28.0	0.48 (1)	10.00		
X-M	0 / 6631	-28.0	-28.0	0.48 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.
I	28-0-6	-45	-50		FRONT	VERT
I	28-0-6	-455	-455		FRONT	VERT

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 3.0 PSF

BOT CH. LL = 10.5 PSF

DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, SBCB 2012, ABC 2014

- CSA 086-09

- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.21")

CALCULATED VERT. DEFL.(LL) = L/999 (0.27")

ALLOWABLE DEFL.(TL)= L/360 (1.21")

CALCULATED VERT. DEFL.(TL) = L/999 (0.44")

CSI: TC=0.77 (L-I:1), BC=0.48 (M-N:1), WB=0.93 (J-M:1), SSI=0.23 (G-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1867 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)


JSI METAL= 0.99 (C) (INPUT = 1.00)

66 1/2

4578-17

STRUCTURAL

CONTINUED ON PAGE 2

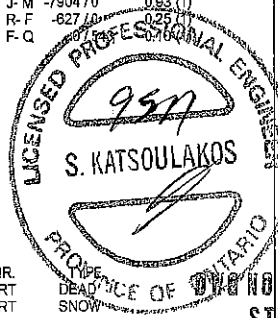


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T620Z	1	1	TRUSS DESC.	

Version 8.030 S Oct 5 2016 MITek Industries, Inc. Fri Sep 01 17:32:05 2017 Page 2
 ID:PFehc1Ba2cOYemTQTAYm8Oyi1EX-PfecaQ5cNkSgsdDXwZIRNRfh?Q1hmfzddY9NSyhxoe


FACTORED CONCENTRATED LOADS (LBS)						
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.
N	31-1-8	-2516	-2516	—	BACK	VERT
W	32-10-4	-41	-72	—	BACK	VERT
X	34-10-4	-41	-72	—	BACK	VERT
						TYPE
						TOTAL
						TOTAL
						TOTAL



DWG NO. TAM 44578-17
 STRUCTURAL
 COMPONENT ONLY



OWO NO. TAM 44579-17
STRUCTURAL
COMPONENT ONLY

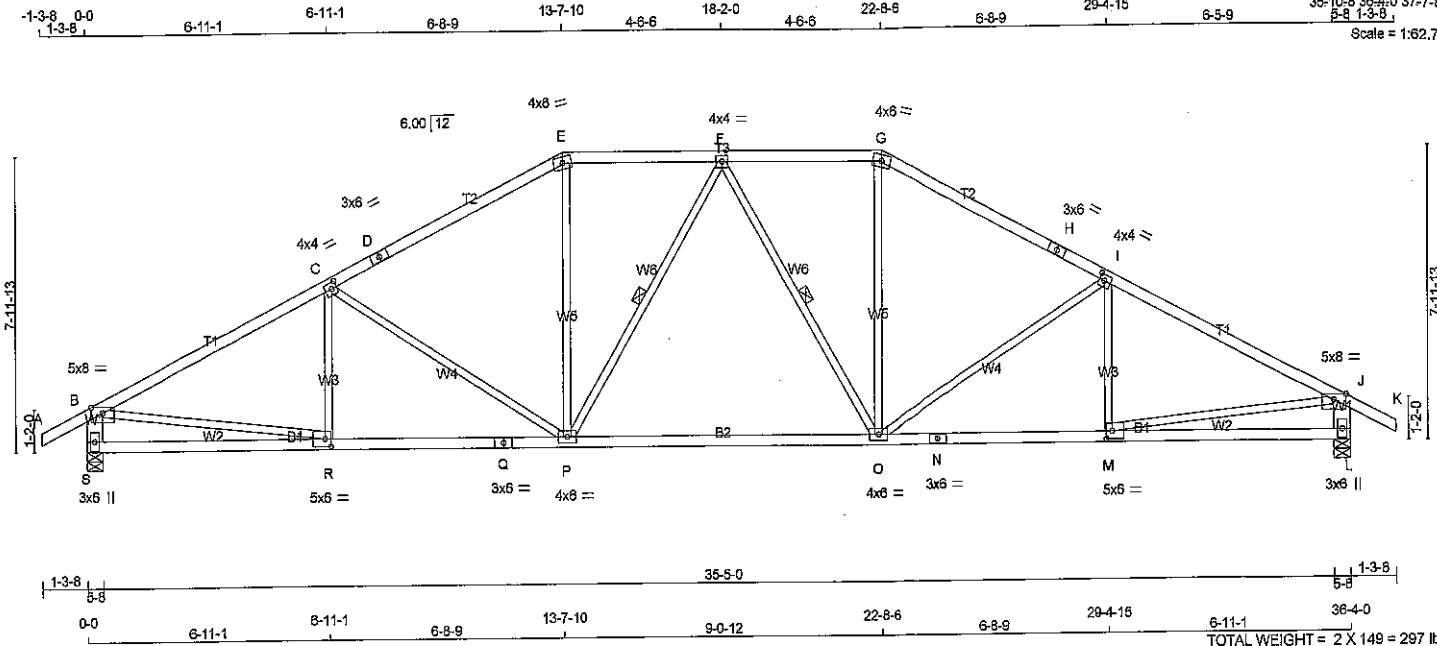

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
L - J	2x6	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	8.0	Edge
C	TMWV-t	MT20	4.0	4.0	2.00 1.75
D	TS-t	MT20	3.0	6.0	
E	TTW-m	MT20	4.0	6.0	
F	TMWV-t	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	6.0	
H	TS-t	MT20	3.0	6.0	
I	TMWV-t	MT20	4.0	4.0	2.00 1.75
J	TMWV-p	MT20	5.0	8.0	Edge
L	BMV-t+p	MT20	3.0	6.0	
M	BMWV-t	MT20	5.0	6.0	2.50 2.00
N	BS-t	MT20	3.0	6.0	
O	BMWVW-t	MT20	4.0	6.0	
P	BMWVW-t	MT20	4.0	6.0	
Q	BS-t	MT20	3.0	6.0	
R	BMWV-t	MT20	5.0	6.0	2.50 2.00
S	BMV-t+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BRG
S	2154	0	2154	0	0	5-8	5-8		
L	2154	0	2154	0	0	5-8	5-8		

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0
L	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P, F-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 28	-84.3 -84.3	0.11 (1)	10.00	R-C	-148 / 185	0.05 (1)
B-C	-3074 / 0	-84.3 -84.3	0.78 (1)	3.28	C-P	-593 / 0	0.82 (1)
C-D	-2576 / 0	-84.3 -84.3	0.87 (1)	3.54	P-E	0 / 775	0.17 (1)
D-E	-2576 / 0	-84.3 -84.3	0.87 (1)	3.84	P-F	-265 / 0	0.15 (1)
E-F	-2285 / 0	-84.3 -84.3	0.27 (1)	4.29	F-O	-265 / 0	0.15 (1)
F-G	-2285 / 0	-84.3 -84.3	0.27 (1)	4.29	O-G	0 / 775	0.17 (1)
G-H	-2576 / 0	-84.3 -84.3	0.87 (1)	3.54	O-I	-593 / 0	0.82 (1)
H-I	-2576 / 0	-84.3 -84.3	0.87 (1)	3.64	M-I	-148 / 185	0.05 (1)
I-J	-3074 / 0	-84.3 -84.3	0.78 (1)	3.28	B-R	0 / 2797	0.63 (1)
J-K	0 / 28	-84.3 -84.3	0.11 (1)	10.00	M-J	0 / 2797	0.63 (1)
S-B	-2071 / 0	0.0 0.0	0.13 (1)	7.05			
L-J	-2071 / 0	0.0 0.0	0.13 (1)	7.05			
S-R	0 / 0	-28.0 -28.0	0.28 (3)	10.00			
R-Q	0 / 2776	-28.0 -28.0	0.89 (2)	10.00			
Q-P	0 / 2776	-28.0 -28.0	0.89 (2)	10.00			
P-O	0 / 2418	-28.0 -28.0	0.65 (2)	10.00			
O-N	0 / 2776	-28.0 -28.0	0.69 (2)	10.00			
N-M	0 / 2776	-28.0 -28.0	0.69 (2)	10.00			
M-L	0 / 0	-28.0 -28.0	0.28 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, 8CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.21")
CALCULATED VERT. DEFL.(LL)= L/999 (0.27")
ALLOWABLE DEFL.(TL)= L/360 (1.21")
CALCULATED VERT. DEFL.(TL)= L/985 (0.44")

CSI: TC=0.78 (B-C:1), BC=0.69 (P-R:2), WB=0.82 (C-P:1), SSI=0.25 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1667 822 2264 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

SSI GRIP= 0.89 (B) (INPUT = 0.90)
SSI METAL= 0.71 (N) (INPUT = 1.00)



DRWG NO. TAM 44580.17
STRUCTURAL
COMPONENT ONLY

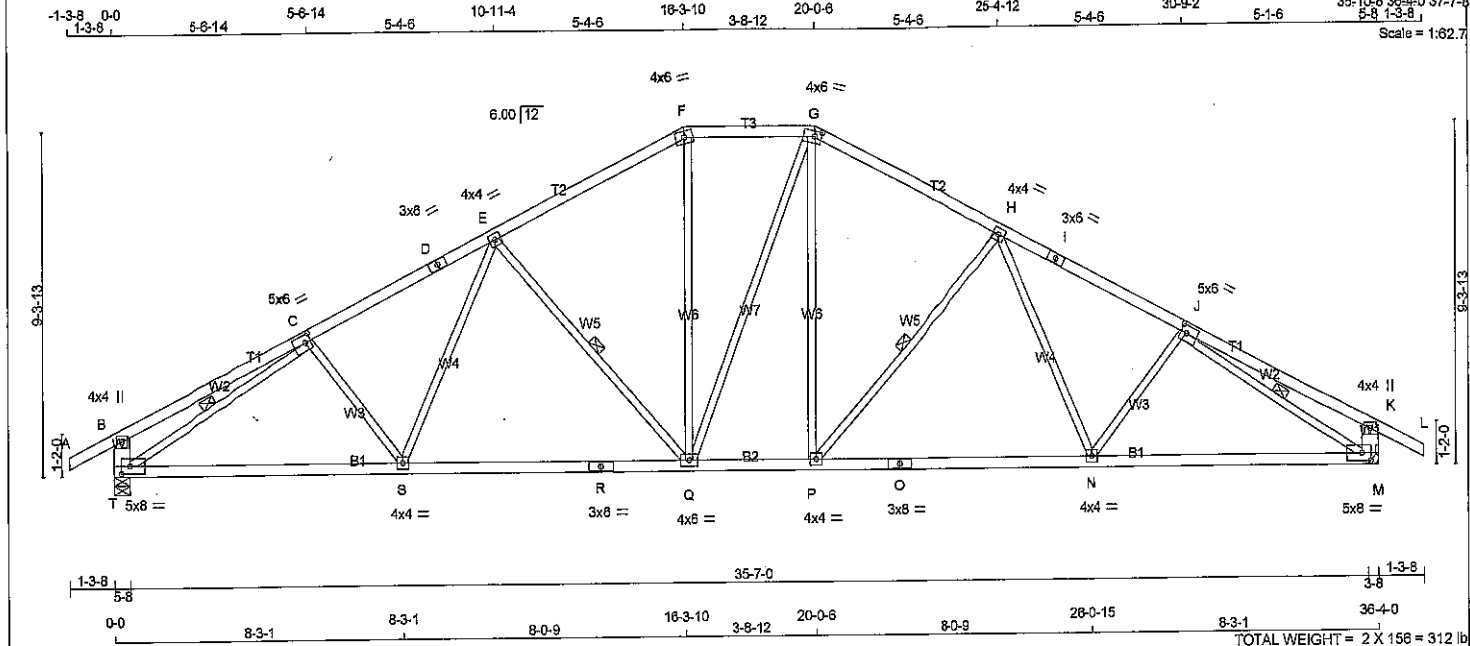

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF
T - B	2x6	DRY	No.2	SPF
M - K	2x6	DRY	No.2	SPF
T - R	2x4	DRY	No.2	SPF
R - O	2x4	DRY	No.2	SPF
O - M	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	4.0	4.0		
C	TMWW-t	MT20	5.0	6.0	2.50	2.00
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTW-m	MT20	4.0	6.0		
G	TTWW-m	MT20	4.0	6.0	1.75	2.25
H	TMWW-t	MT20	4.0	4.0		
I	TS-t	MT20	3.0	6.0		
J	TMWW-t	MT20	5.0	6.0	2.50	2.00
K	TMV+p	MT20	4.0	4.0		
M	BMVW1-t	MT20	5.0	6.0	2.50	3.00
N, P, S						
N	BMWW-t	MT20	4.0	4.0		
O	BS-t	MT20	3.0	6.0		
Q	BMWWW-t	MT20	4.0	6.0		
R	BS-t	MT20	3.0	6.0		
T	BMVW1-t	MT20	5.0	6.0	2.50	3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 2154	DOWN 2154	0	0
T	HORZ 0	HORZ 0	5-8	5-8
M	0	0	0	0

HANGER BY OTHERS
MIN. SEAT SIZE: 3-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
T	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0
M	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO			FR-TO		
A-B	0 / 28	-84.3	C-S	-72 / 148	0.03 (3)
B-C	0 / 18	-84.3	S-E	0 / 424	0.10 (2)
C-D	-2939 / 0	-84.3	E-Q	-701 / 0	0.34 (1)
D-E	-2939 / 0	-84.3	Q-F	0 / 683	0.15 (1)
E-F	-2298 / 0	-84.3	F-G	0 / 4	0.00 (1)
F-G	-2044 / 0	-84.3	G-H	0 / 879	0.15 (1)
G-H	-2298 / 0	-84.3	H-N	-703 / 0	0.34 (1)
H-I	-2940 / 0	-84.3	N-J	0 / 426	0.10 (2)
I-J	-2940 / 0	-84.3	J-M	-71 / 148	0.03 (3)
J-K	0 / 18	-84.3	T-C	-3199 / 0	0.80 (1)
K-L	0 / 28	-84.3	C-M	-3200 / 0	0.90 (1)
L-M	-305 / 0	0.0			
M-K	-305 / 0	0.0			
T-S	0 / 2674	-28.0			
S-R	0 / 2494	-28.0			
R-Q	0 / 2494	-28.0			
Q-P	0 / 2042	-28.0			
P-O	0 / 2494	-28.0			
O-N	0 / 2494	-28.0			
N-M	0 / 2674	-28.0			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.22")
ALLOWABLE DEFL.(TL) = L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.41 (H-J:1), BC=0.79 (M-N:2), WB=0.80 (J-M:1), SSI=0.19 (M-N:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.80 (O) (INPUT = 1.00)




DWG NO. TAM 44581-17
STRUCTURAL COMPONENT ONLY

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Fri Sep 01 17:32:07 2017 Page 1

ID:w3K2IB2K4fGk9ID075kphylfMC-L2kO1GSM8?_A39mcfLbDWoW4Lo0E9f_G4x1GRlyhxc

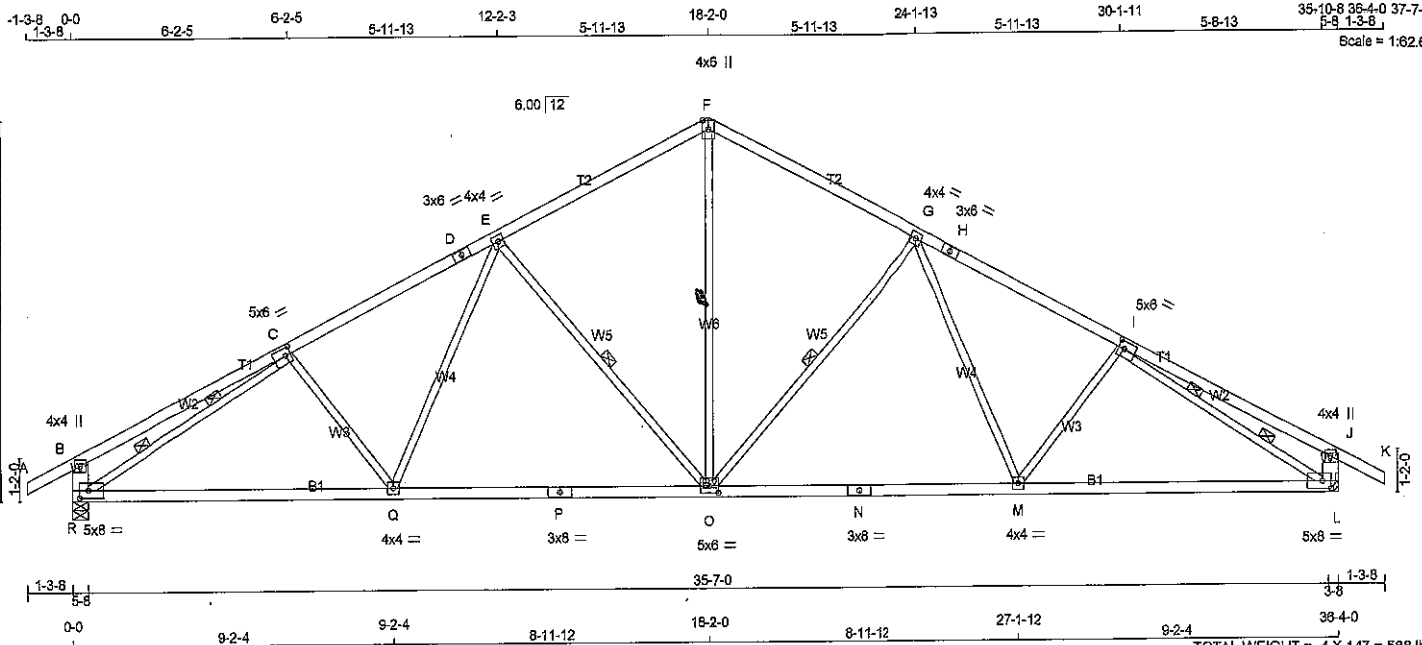

TOTAL WEIGHT = 4 X 147 = 588 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
H - K	2x4	DRY No.2	SPF
R - B	2x6	DRY No.2	SPF
L - J	2x6	DRY No.2	SPF
P - P	2x4	DRY No.2	SPF
P - N	2x4	DRY No.2	SPF
N - L	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	4.0	4.0	
C	TMVW-t	MT20	5.0	6.0	2.50 2.00
D	TS-t	MT20	3.0	6.0	
E	TMVW-t	MT20	4.0	4.0	
F	TTW+p	MT20	4.0	6.0	Edge
G	TMVW-t	MT20	4.0	4.0	
H	TS-t	MT20	3.0	6.0	
I	TMVW-t	MT20	5.0	6.0	2.50 2.00
J	TMV+p	MT20	4.0	4.0	
L	BMVW1-t	MT20	5.0	6.0	2.50 3.00
M	BMVW-t	MT20	4.0	4.0	
N	BS-t	MT20	3.0	6.0	
O	BMVW-t	MT20	5.0	6.0	2.25 3.00
P	BS-t	MT20	3.0	6.0	
Q	BMVW-t	MT20	4.0	4.0	
R	BMVW1-t	MT20	5.0	6.0	2.50 3.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
R	2154	0	2154	0	5-8
L	2154	0	2154	0	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
R	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0
L	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

- 1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-O, E-O. *F.O.I.*
2 LATERAL BRACE(S) AT 1/3 LENGTH OF C-R, I-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (I.C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (I.C)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 26	-84.3 -84.3	0.11 (1)	10.00	O-F	0 / 1475	0.33 (1)
B-C	0 / 21	-84.3 -84.3	0.39 (1)	10.00	C-G	-816 / 0	0.48 (1)
C-D	-2896 / 0	-84.3 -84.3	0.50 (1)	3.70	G-M	0 / 509	0.11 (2)
D-E	-2896 / 0	-84.3 -84.3	0.50 (1)	3.70	M-I	-183 / 124	0.07 (1)
E-F	-2124 / 0	-84.3 -84.3	0.45 (1)	4.25	E-O	-816 / 0	0.48 (1)
F-G	-2124 / 0	-84.3 -84.3	0.45 (1)	4.25	Q-E	0 / 509	0.11 (2)
G-H	-2896 / 0	-84.3 -84.3	0.50 (1)	3.70	C-Q	-183 / 124	0.07 (1)
H-I	-2896 / 0	-84.3 -84.3	0.50 (1)	3.70	R-C	-3197 / 0	1.00 (1)
I-J	0 / 21	-84.3 -84.3	0.39 (1)	10.00	I-L	-3197 / 0	1.00 (1)
J-K	0 / 26	-84.3 -84.3	0.11 (1)	10.00			
R-B	-325 / 0	0.0 0.0	0.02 (1)	7.81			
L-J	-325 / 0	0.0 0.0	0.02 (1)	7.81			
R-Q	0 / 2892	-28.0 -28.0	0.88 (2)	10.00			
Q-P	0 / 2413	-28.0 -28.0	0.85 (2)	10.00			
P-O	0 / 2413	-28.0 -28.0	0.85 (2)	10.00			
O-N	0 / 2413	-28.0 -28.0	0.85 (2)	10.00			
N-M	0 / 2413	-28.0 -28.0	0.85 (2)	10.00			
M-L	0 / 2692	-28.0 -28.0	0.88 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.31")
ALLOWABLE DEFL.(TL) = L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = L/863 (0.51")

CSI: TC=0.50 (G-I:1), BC=0.88 (Q-R:2), WB=1.00 (I-L:1), SSI=0.21 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (FLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (L) (INPUT = 0.80)
JSI METAL= 0.80 (N) (INPUT = 1.00)

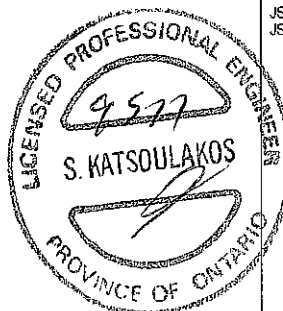

DWG NO. TAN 4458217
STRUCTURAL
COMPONENT ONLY

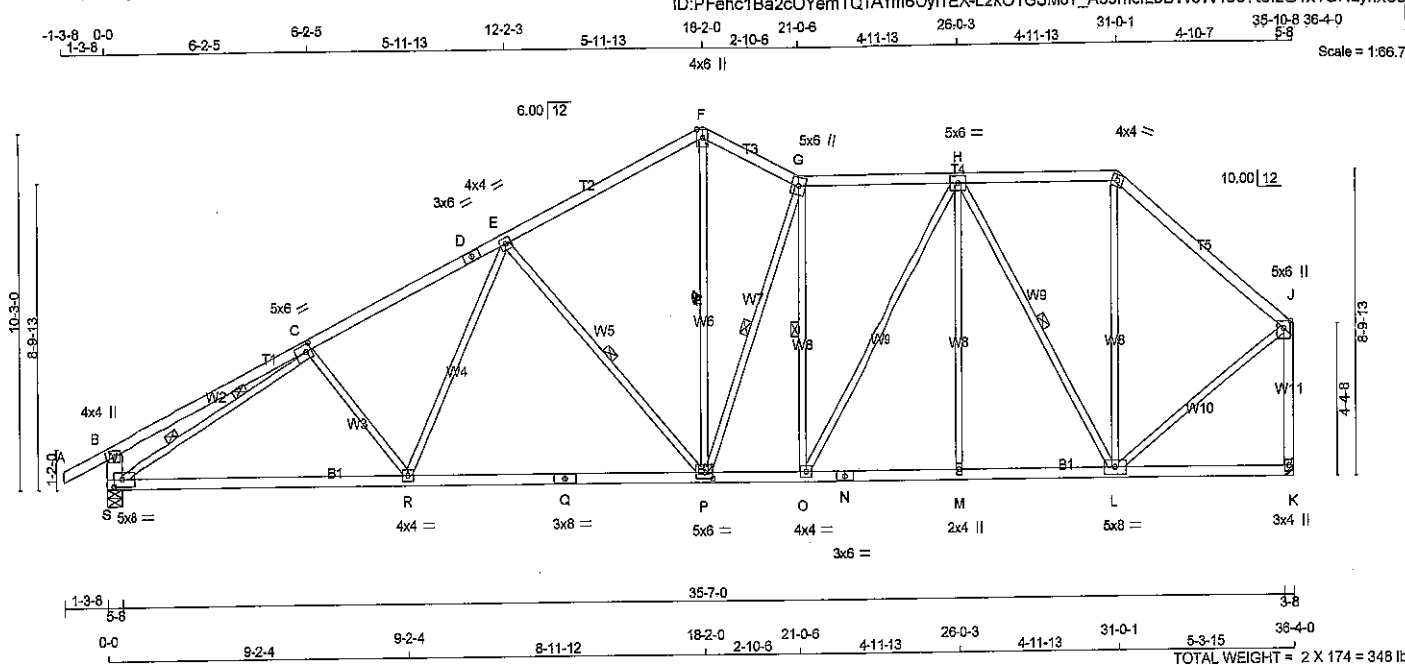

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
S - B	2x6	DRY	No.2
K - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - K	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	4.0	4.0
C	TMWW-t	MT20	5.0	8.0 2.50 2.00
D	TS-t	MT20	3.0	6.0
E	TMWW-t	MT20	4.0	4.0
F	TTW+p	MT20	4.0	6.0 Edge
G	TTWW+m	MT20	5.0	6.0
H	TMWW-t	MT20	5.0	8.0
I	TTW-m	MT20	4.0	4.0
J	TMWW+p	MT20	5.0	6.0 Edge
K	BMV1+p	MT20	3.0	4.0
L	BMWW-t	MT20	5.0	8.0
M	BMW-w	MT20	2.0	4.0
N	BS-t	MT20	3.0	6.0
O	BMWW-t	MT20	4.0	4.0
P	BMWW-t	MT20	5.0	6.0 2.25 3.00
Q	BS-t	MT20	3.0	8.0
R	BMWW-t	MT20	4.0	4.0
S	BMWW-t	MT20	5.0	8.0 2.50 3.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
S	2154	0	2154	0	5-8
K	2039	0	2039	0	0

MIN. SEAT SIZE: 3-8

UNFACTORED REACTIONS							
	1ST LCASE	MAX / MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0
K	1674	930 / 0	352 / 0	0 / 0	0 / 0	363 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P, G-P, G-O, H-L *E-P*
2 LATERAL BRACE(S) AT 1/3 LENGTH OF C-S.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 26	C-R	-193 / 124
B-C	0 / 21	R-E	0 / 521
C-D	-2898 / 0	E-P	-821 / 0
D-E	-2898 / 0	P-F	0 / 1547
E-F	-2119 / 0	F-G	-772 / 0
F-G	-2095 / 0	G-H	-484 / 0
G-H	-2116 / 0	H-I	0 / 631
H-I	-1115 / 0	I-J	0 / 242
I-J	-1446 / 0	J-K	-1382 / 0
J-K	-325 / 0	K-L	0 / 540
K-L	-1978 / 0	L-M	-3199 / 0
		M-N	0 / 1382
S-R	0 / 2894		
R-Q	0 / 2412		
Q-P	0 / 2412		
P-O	0 / 2122		
O-N	0 / 1802		
N-M	0 / 1802		
M-L	0 / 1802		
L-K	0 / 0		



DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2012, SBCB 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.29")
ALLOWABLE DEFL.(TL) = L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = L/904 (0.48")

CSI: TC=0.65 (J-K:1), BC=0.80 (R-S:2), WB=1.00 (C-S:1), SSI=0.21 (R-S:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 822 2284 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (S) (INPUT = 0.90)
JSI METAL = 0.84 (Q) (INPUT = 1.00)

DRWG NO. TAM 44584/17
STRUCTURAL
COMPONENT ONLY

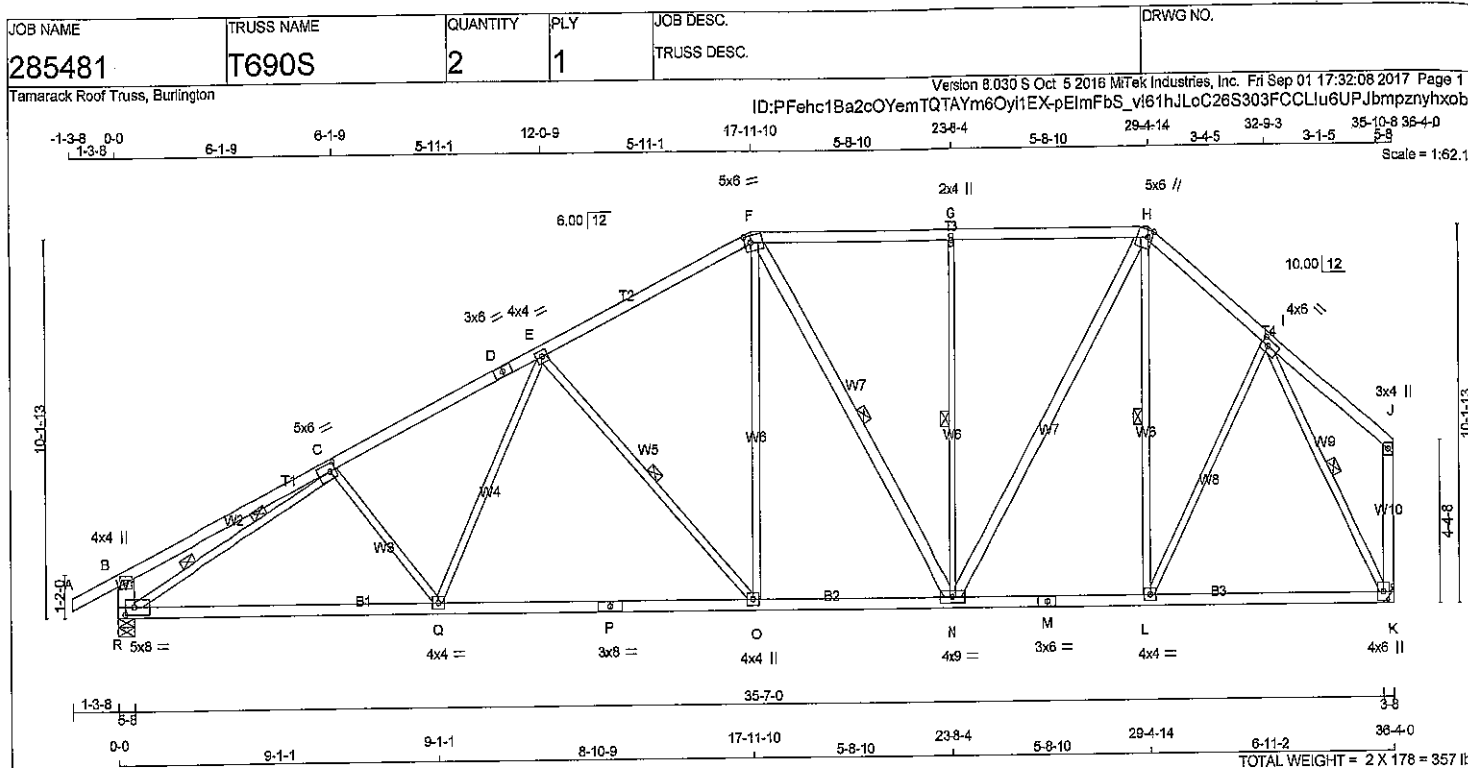

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - J	2x4	DRY	No.2
R - B	2x6	DRY	No.2
K - J	2x4	DRY	No.2
R - P	2x4	DRY	No.2
P - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
F - N	2x4	DRY	No.2
N - H	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	4.0	4.0		
C	TMWW-t	MT20	5.0	8.0	2.50	2.00
D	TS-t	MT20	3.0	8.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTWW-m	MT20	5.0	6.0	2.25	2.00
G	TMWW-w	MT20	2.0	4.0		
H	TTWW-m	MT20	5.0	8.0	2.25	1.50
I	TMWW-t	MT20	4.0	6.0	2.00	2.25
J	TMV+p	MT20	3.0	4.0		
K	BMWW1+p	MT20	4.0	6.0		
L	BMWW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	8.0		
N	BMWW-t	MT20	4.0	9.0		
O	BMWW-t	MT20	4.0	4.0		
P	BS-t	MT20	3.0	8.0		
Q	BMWW-t	MT20	4.0	4.0		
R	BMWW-t	MT20	5.0	8.0	2.50	3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	
	VERT	HORZ	DOWN	HORZ		IN-SX	IN-SX
R	2154	0	2154	0	5-8	5-8	
K	2039	0	2039	0			

HANGER BY OTHERS
MIN. SEAT SIZE: 3-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
R	1752	899 / 0	362 / 0	0 / 0	0 / 0	371 / 0	0 / 0
K	1674	930 / 0	362 / 0	0 / 0	0 / 0	363 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.71 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED

- 1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O, F-N, G-N, H-L, I-K.
- 2 LATERAL BRACE(S) AT 1/3 LENGTH OF C-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO				FR-TO			
A-B	0 / 26	-84.3	-84.3 0.11 (1)	10.00	C-Q	-153 / 127	0.06 (1)
B-C	0 / 20	-84.3	-84.3 0.38 (1)	10.00	Q-E	0 / 511	0.11 (2)
C-D	-2903 / 0	-84.3	-84.3 0.50 (1)	3.71	E-O	-813 / 0	0.48 (1)
D-E	-2903 / 0	-84.3	-84.3 0.50 (1)	3.71	O-F	0 / 821	0.18 (1)
E-F	-2132 / 0	-84.3	-84.3 0.44 (1)	4.25	F-N	-301 / 0	0.21 (1)
F-G	-1743 / 0	-84.3	-84.3 0.40 (1)	4.63	N-G	-588 / 0	0.42 (1)
G-H	-1743 / 0	-84.3	-84.3 0.40 (1)	4.63	N-H	0 / 1126	0.18 (1)
H-I	-1562 / 0	-84.3	-84.3 0.15 (1)	5.15	L-H	-284 / 36	0.20 (1)
I-J	0 / 20	-84.3	-84.3 0.16 (1)	10.00	L-I	0 / 557	0.13 (1)
R-B	-323 / 0	0.0	0.0 0.02 (1)	7.81	R-C	-3200 / 0	0.98 (1)
K-J	-118 / 0	0.0	0.0 0.04 (1)	7.81	I-K	-2064 / 0	0.82 (1)
R-Q	0 / 2892	-28.0	-28.0 0.89 (2)	10.00			
Q-P	0 / 2421	-28.0	-28.0 0.86 (2)	10.00			
P-O	0 / 2421	-28.0	-28.0 0.86 (2)	10.00			
O-N	0 / 1894	-28.0	-28.0 0.53 (2)	10.00			
N-M	0 / 1177	-28.0	-28.0 0.46 (2)	10.00			
M-L	0 / 1177	-28.0	-28.0 0.46 (2)	10.00			
L-K	0 / 928	-28.0	-28.0 0.42 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/899 (0.28")
ALLOWABLE DEFL.(TL) = L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = L/950 (0.48")

CSI: TC=0.50 (C-E:1), BC=0.89 (Q-R:2), WB=0.98 (C-R:1), SSI=0.23 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1657	822
	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.84 (P) (INPUT = 1.00)

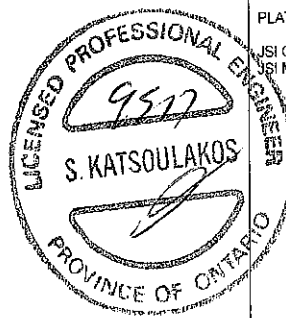

DWG NO. TAM 44585-17
STRUCTURAL
COMPONENT ONLY

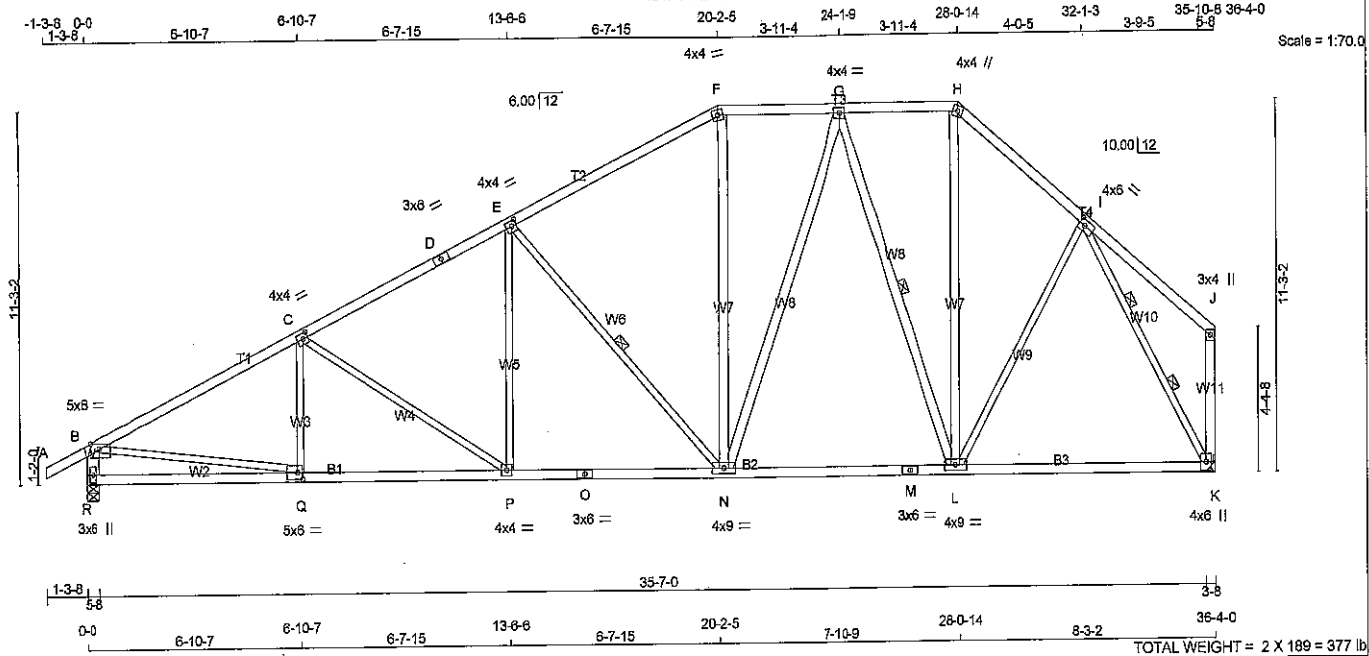

LUMBER			LUMBER			DESCR.		
N. L. G. A. RULES								
CHORDS	SIZE							
A - D	2x4	DRY	No.2		SPF			
D - F	2x4	DRY	No.2		SPF			
F - H	2x4	DRY	No.2		SPF			
H - J	2x4	DRY	No.2		SPF			
R - B	2x6	DRY	No.2		SPF			
K - J	2x4	DRY	No.2		SPF			
R - O	2x4	DRY	No.2		SPF			
O - M	2x4	DRY	No.2		SPF			
M - K	2x4	DRY	No.2		SPF			
ALL WEBS	2x3	DRY	No.2		SPF			
EXCEPT								
N - F	2x4	DRY	No.2		SPF			
N - G	2x4	DRY	No.2		SPF			
G - L	2x4	DRY	No.2		SPF			
L - H	2x4	DRY	No.2		SPF			

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	4.0	2.00	1.75
F	TTW-m	MT20	4.0	4.0		
G	TMWW-t	MT20	4.0	4.0		
H	TTW-m	MT20	4.0	4.0		
I	TMWW-t	MT20	4.0	6.0	2.00	2.25
J	TMV+p	MT20	3.0	4.0		
K	BMVW1+p	MT20	4.0	6.0		
L	BMWW-t	MT20	4.0	9.0		
M	BS-t	MT20	3.0	6.0		
N	BMWW-t	MT20	4.0	9.0		
O	BS-t	MT20	3.0	6.0		
P	BMWW-t	MT20	4.0	4.0		
Q	BMWW-t	MT20	5.0	6.0	2.50	2.00
R	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY THE BUILDING DESIGNER									
BEARINGS									
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	2154	0	2154	0	0	5-8	5-8		
K	2039	0	2039	0	0	HANGER BY OTHERS			
						MIN. SEAT SIZE: 3-8			

UNFACTORED REACTIONS								
	1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	
R	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0	
K	1674	930 / 0	382 / 0	0 / 0	0 / 0	363 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N, G-L.
2 LATERAL BRACE(S) AT 1/3 LENGTH OF I-K

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (L/C)	UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (L/C)		
FR-TO		FROM TO							
A-B	0 / 26	-84.3 -84.3	0.11 (1)	10.00	Q-C	-137 / 199	0.04 (3)		
B-C	-3058 / 0	-84.3 -84.3	0.75 (1)	3.37	C-P	-508 / 0	0.66 (1)		
C-D	-2607 / 0	-84.3 -84.3	0.57 (1)	3.80	P-E	0 / 523	0.12 (2)		
D-E	-2607 / 0	-84.3 -84.3	0.57 (1)	3.80	E-N	-968 / 0	0.76 (1)		
E-F	-1890 / 0	-84.3 -84.3	0.53 (1)	4.33	N-F	0 / 478	0.08 (1)		
F-G	-1674 / 0	-84.3 -84.3	0.19 (1)	4.96	N-G	0 / 485	0.08 (1)		
G-H	-1220 / 0	-84.3 -84.3	0.17 (1)	5.62	G-L	-904 / 0	0.69 (1)		
H-I	-1604 / 0	-84.3 -84.3	0.21 (1)	5.04	L-H	0 / 746	0.12 (1)		
I-J	0 / 25	-84.3 -84.3	0.22 (1)	10.00	L-I	0 / 422	0.09 (1)		
R-B	-2073 / 0	0.0 0.0	0.13 (1)	7.04	B-Q	0 / 2778	0.63 (1)		
K-J	-137 / 0	0.0 0.0	0.04 (1)	7.81	I-K	-2067 / 0	0.93 (1)		
R-Q	0 / 0	-28.0 -28.0	0.30 (3)	10.00					
Q-P	0 / 2757	-28.0 -28.0	0.62 (2)	10.00					
P-O	0 / 2332	-28.0 -28.0	0.53 (2)	10.00					
O-N	0 / 2332	-28.0 -28.0	0.53 (2)	10.00					
N-M	0 / 1515	-28.0 -28.0	0.65 (2)	10.00					
M-L	0 / 1515	-28.0 -28.0	0.65 (2)	10.00					
L-K	0 / 1002	-28.0 -28.0	0.58 (2)	10.00					

DESIGN CRITERIA:			
SPECIFIED LOADS:			
TOP CH.	LL =	25.6	PSF
	DL =	3.0	PSF
BOT CH.	LL =	10.5	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	48.1	PSF

SPACING = 24.0 IN.C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.21")
CALCULATED VERT. DEFL.(LL)= L/999 (0.20")
ALLOWABLE DEFL.(TL)= L/360 (1.21")
CALCULATED VERT. DEFL.(TL)= L/999 (0.33")

CSI: TC=0.75 (B-C:1), BC=0.65 (L-N:2), WB=0.93 (I-K:1), SS=0.24 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
MT20	618	354	1667	822	2284 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.89 (I) (INPUT = 0.90)
SI METAL= 0.69 (O) (INPUT = 1.00)

DWG NO. TAM 44586 17
STRUCTURAL
COMPONENT ONLY



DRWG NO. FAM 44586 17
STRUCTURAL
COMPONENT ONLY

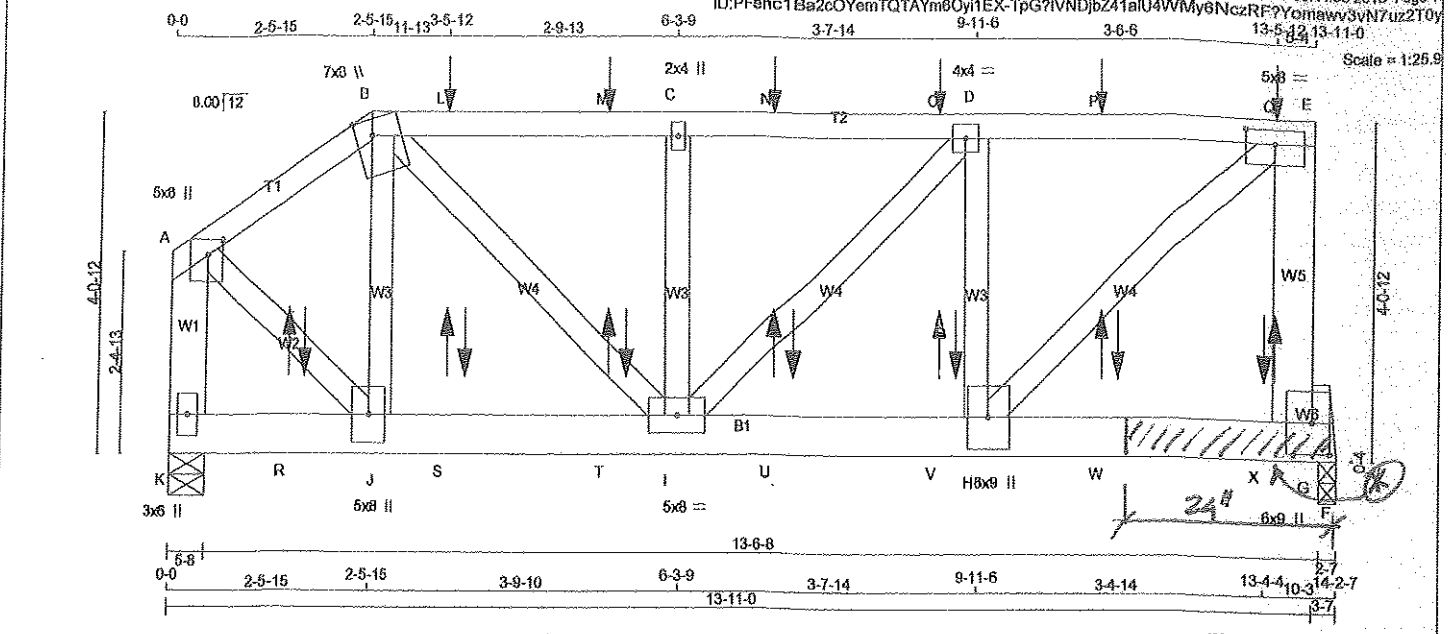

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF
G - E	2x6	DRY	No.2	SPF
K - A	2x6	DRY	No.2	SPF
K - F	2x6	DRY	2100F 1.8E	SPF
G - F	2x6	DRY	No.2	SPF
ALL WEBS EXCEPT	2x4	DRY	No.2	SPF

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B	12	TOP
B-E	12	SIDE (01.5)
E-G	2	TOP
K-A	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K-F	7	SIDE (503.4)
WEBS : (0.122"x3") SPIRAL NAILS		
2x4	6	
2x6	6	

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWW+p	MT20	5.0	8.0	2.25	2.25
B	TTWW+m	MT20	7.0	8.0	Edge	2.50
C	TMWW+w	MT20	2.0	4.0		
D	TMWW-l	MT20	4.0	4.0		
E	TMWW-l	MT20	5.0	8.0	2.00	4.00
G	BMWW+p	MT20	6.0	8.0	4.50	2.50
H	BMWW+l	MT20	6.0	8.0		
I	BMWWW-l	MT20	5.0	8.0		
J	BMWWW+l	MT20	5.0	8.0		
K	BMW1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) DWG NO. TAM 11800651 STRUCTURAL COMPONENT ONLY 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT 7721	HORZ 0	0	5-8
K	VERT 8235	HORZ 0	0	5-8
F	VERT 8235	HORZ 0	0	2-7

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED	6258	3508 / 0	1348 / 0	0 / 0	0 / 0	1321 / 0	0 / 0
K	COMBINED	6715	3804 / 0	1479 / 0	0 / 0	0 / 0	1432 / 0	0 / 0
F	COMBINED							

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.18 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS				WEBS			
MEMB.	FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (IN)	MEMB.	FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (IN)	CSF (LC)
FR-TO				FR-TO			
A-B	-8013 / 0	-84.3	0.07 (1)	J-B	-14 / 238	0.01 (1)	
B-L	-7833 / 0	-84.3	0.14 (1)	A-J	0 / 6255	0.34 (1)	
L-M	-7833 / 0	-84.3	0.14 (1)	H-E	0 / 9725	0.52 (1)	
M-C	-7833 / 0	-84.3	0.14 (1)	D-I	0 / 4081	0.22 (1)	
C-N	-7833 / 0	-84.3	0.12 (1)	H-D	-1157 / 0	0.07 (1)	
N-O	-7833 / 0	-84.3	0.12 (1)	I-C	-297 / 0	0.02 (1)	
O-D	-7833 / 0	-84.3	0.12 (1)	I-D	0 / 1157	0.07 (1)	
D-P	-7121 / 0	-84.3	0.13 (1)				
P-Q	-7121 / 0	-84.3	0.13 (1)				
Q-E	-7121 / 0	-84.3	0.13 (1)				
E-G	-8775 / 0	0.0	0.0 34 (1)				
G-A	-7233 / 0	0.0	0.0 19 (1)				
K-R	0 / 0	-28.0	0.15 (1)				
R-J	0 / 0	-28.0	0.15 (1)				
J-S	0 / 4999	-28.0	0.23 (1)				
S-T	0 / 4999	-28.0	0.23 (1)				
T-U	0 / 4999	-28.0	0.23 (1)				
U-V	0 / 7121	-28.0	0.36 (1)				
V-W	0 / 7121	-28.0	0.36 (1)				
W-X	0 / 0	-28.0	0.36 (1)				
X-G	0 / 0	-28.0	0.36 (1)				
G-F	0 / 0	-28.0	0.22 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
L	3-5-12	-1	-1	73	FRONT	VERT	TOTAL
M	5-5-12	-1	-1	74	FRONT	VERT	TOTAL
N	7-5-12	-1	-1	74	FRONT	VERT	TOTAL
O	9-5-12	-1	-1	74	FRONT	VERT	TOTAL
P	11-5-12	-1	-1	74	FRONT	VERT	TOTAL
Q	13-5-12	-1	-1	59	FRONT	VERT	TOTAL
R	1-5-12	4	1	4	FRONT	VERT	TOTAL
R	1-8-4	-1717	-1717		BACK	VERT	TOTAL
S	3-5-12	4	1	4	FRONT	VERT	TOTAL
S	3-8-4	-1717	-1717		BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 3.0 PSF

BOT CH. LL = 10.5 PSF

DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 685-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.47")

CALCULATED VERT. DEFL.(LL) = 1/999 (0.07")

ALLOWABLE DEFL.(TL) = 1/360 (0.47")

CALCULATED VERT. DEFL.(TL) = 1/990 (0.11")

CSI: TC=0.34/1.00 (E-G:1), BC=0.38/1.00 (G-H:1), WB=0.52/1.00 (E-H:1), SS=0.83/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	SECTION (PLI)
MT20	618	354	1667	822
	MAX	MIN	MAX	MIN

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)

JSI METAL= 0.52 (H) (INPUT = 1.00)

PROVIDE 24" LONG SCAB 2X6 SPF #2 ALONG MEMBERS (V-W), ON ONE SIDE, USING 2 ROWS OF 3 1/2" SPIRAL NAILS @ 4" C/C. (2 NAILS MIN)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285492	T720	1	3	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.210 S May 18 2018 Mitek Industries, Inc. Tue Jun 26 09:44:33 2018 Page 2

ID:PFehc1Ba2cOYemTQTAYm6Oyi1EX-TpG?IVNDJbZ41alU4WMY6NczRF?Yomawv3vN/uz2T0v

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1.1 lbs FACTORED DOWN AND 110.2 lbs FACTORED UP AT 3-5-12, 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 5-5-12, 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 7-5-12, 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 9-5-12, AND 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 11-5-12, AND 1.1 lbs FACTORED DOWN AND 89.2 lbs FACTORED UP AT 13-5-12 ON TOP CHORD, AND 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 1-5-12, 2125.6 lbs FACTORED DOWN AT 1-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 3-5-12, 2125.6 lbs FACTORED DOWN AT 3-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 5-5-12, 2125.6 lbs FACTORED DOWN AT 5-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 7-5-12, 2011.3 lbs FACTORED DOWN AT 7-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 9-5-12, 2011.3 lbs FACTORED DOWN AT 9-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 11-5-12, 2011.3 lbs FACTORED DOWN AT 11-8-4, AND 2013.4 lbs FACTORED DOWN AT 13-4-4, AND 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 13-5-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
T	5-5-12	4	1	4	FRONT	VERT	TOTAL
T	5-8-4	-1717	-1717	—	BACK	VERT	TOTAL
U	7-5-12	4	1	4	FRONT	VERT	TOTAL
U	7-8-4	-1639	-1639	—	BACK	VERT	TOTAL
V	9-5-12	4	1	4	FRONT	VERT	TOTAL
V	9-8-4	-1639	-1639	—	BACK	VERT	TOTAL
W	11-5-12	4	1	4	FRONT	VERT	TOTAL
W	11-8-4	-1639	-1639	—	BACK	VERT	TOTAL
X	13-4-4	-1642	-1642	—	BACK	VERT	TOTAL
X	13-5-12	4	1	4	FRONT	VERT	TOTAL



DWG NO. TAM 718 000651
STRUCTURAL
COMPONENT ONLY


7/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285481	T800	2	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MitTek Industries, Inc. Fri Sep 01 17:32:09 2017 Page 1

ID:PFehc1Ba2oOYemTQTAYm6Oy1EX-HQs9SxTgcEulTw?mmdhbDbV0csPdoRZXFWNWdyhxo

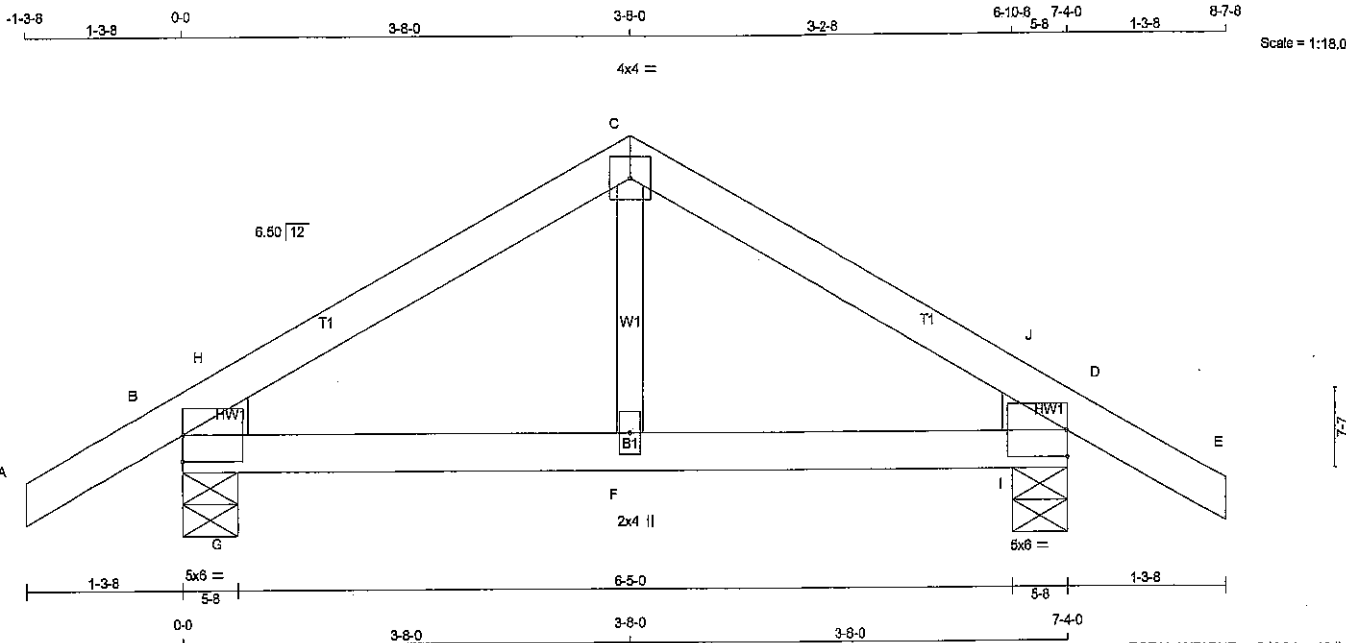

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMBH1-I	MT20	5.0	6.0
C	TTW-p	MT20	4.0	4.0
D	TMBH1-I	MT20	5.0	6.0
F	BMW+w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	DOWN	HORZ	BRG	IN-SX	IN-SX	HEEL
B	526	0	526	0	0	5-8	5-8	5-8	2x4 L
D	526	0	526	0	0	5-8	5-8	5-8	2x4 R

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	416	257 / 0	77 / 0	0 / 0	0 / 0	82 / 0	0 / 0
D	416	257 / 0	77 / 0	0 / 0	0 / 0	82 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 17	-84.3 -84.3	0.11 (1)	10.00	F-C	0 / 192	0.04 (2)
B-H	-459 / 0	-84.3 -84.3	0.07 (1)	6.25	G-H	-55 / 132	0.00 (1)
H-C	-410 / 0	-84.3 -84.3	0.11 (1)	6.25	I-J	-55 / 132	0.00 (1)
C-J	-410 / 0	-84.3 -84.3	0.11 (1)	6.25			
J-D	-459 / 0	-84.3 -84.3	0.07 (1)	6.25			
D-E	0 / 17	-84.3 -84.3	0.11 (1)	10.00			
B-G	0 / 352	-28.0 -28.0	0.10 (1)	10.00			
G-F	0 / 352	-28.0 -28.0	0.13 (1)	10.00			
F-I	0 / 352	-28.0 -28.0	0.13 (1)	10.00			
I-D	0 / 352	-28.0 -28.0	0.10 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.01")

CSI: TC=0.11 (A-B:1), BC=0.13 (F-G:1), WB=0.04 (C-F:2), SSI=0.11 (C-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)




DRWG NO. TAN44588-17
STRUCTURAL
COMPONENT ONLY

JOB NAME 285481	TRUSS NAME T800Z	QUANTITY 1	PLY 1	JOB DESC. TRUSS DESC.	DRWG NO.
---------------------------	----------------------------	----------------------	-----------------	--------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Fri Sep 01 17:32:09 2017 Page 1

ID:PFehc1Ba2cOYemTQTAYm6Oyi1EX-HQs9SxTgcEulTw?mmdhbDbUacs7doKZXFVNWdYhxo

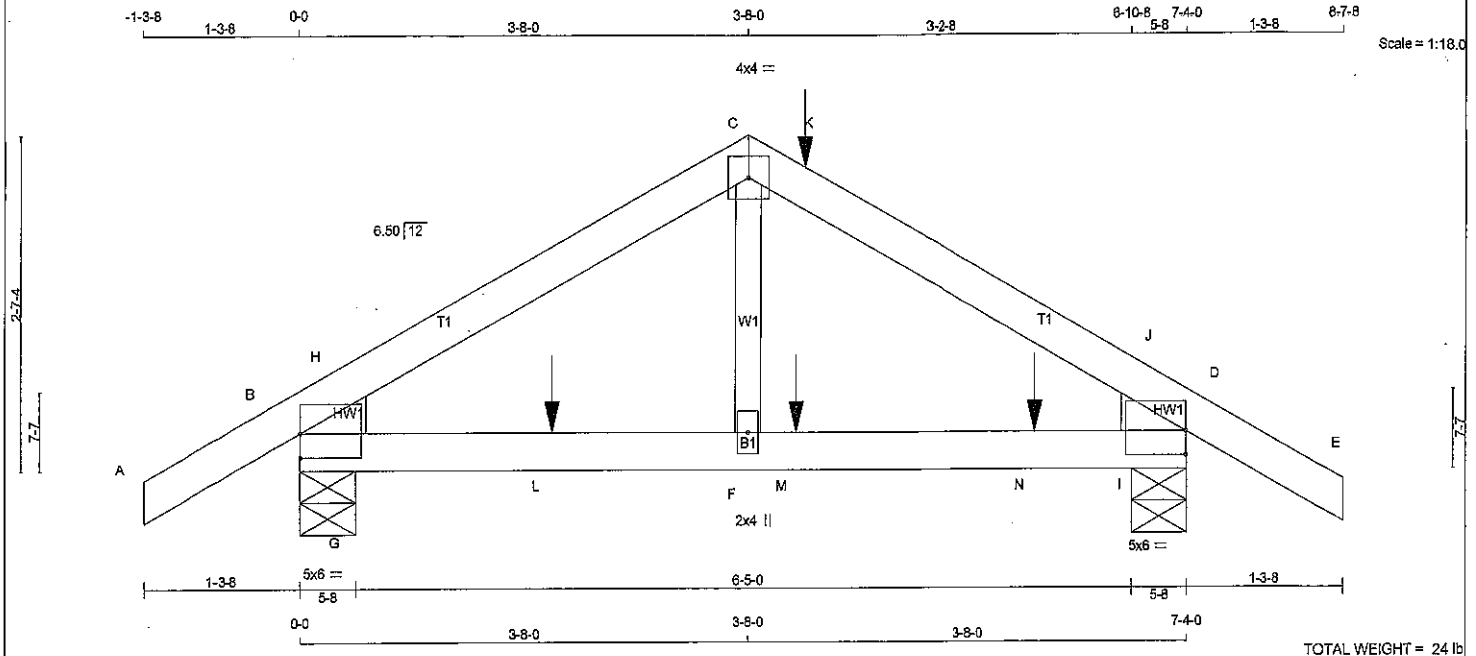

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMBH-I	MT20	5.0	6.0	2.25
C	TTW-p	MT20	4.0	4.0	
D	TMBH-I	MT20	5.0	6.0	2.25
F	BMW-w	MT20	2.0	4.0	

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 26.9 lbs FACTORED DOWN AT 4-0-12 ON TOP CHORD, AND 6.5 lbs FACTORED DOWN AT 2-0-12, AND 6.5 lbs FACTORED DOWN AT 4-0-12, AND 6.5 lbs FACTORED DOWN AT 6-0-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
B	543	0	543	0	0	5-8
D	547	0	547	0	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	1ST CASE	MAX/MIN	SNOW	LIVE	PERM	WIND	DEAD	SOIL
B	430	255	10	81	10	0	0	85	10
D	434	268	10	82	10	0	0	88	10

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED VERT. LOAD LC1	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO			FROM	TO		FR-TO		
A-B	0/17	-84.3	-84.3	0.12 (1)	10.00	F-C	0/203	0.05 (2)
B-H	-498/0	-84.3	-84.3	0.10 (1)	6.25	G-H	-43/141	0.00 (1)
H-C	-438/0	-84.3	-84.3	0.13 (1)	8.25	I-J	-50/142	0.00 (1)
C-K	-433/0	-84.3	-84.3	0.14 (1)	6.25			
K-J	-433/0	-84.3	-84.3	0.14 (1)	6.25			
J-D	-493/0	-84.3	-84.3	0.10 (1)	8.25			
D-E	0/17	-84.3	-84.3	0.12 (1)	10.00			
B-G	0/377	-28.0	-28.0	0.11 (1)	10.00			
G-L	0/377	-28.0	-28.0	0.15 (1)	10.00			
L-F	0/377	-28.0	-28.0	0.15 (1)	10.00			
F-M	0/377	-28.0	-28.0	0.15 (1)	10.00			
M-N	0/377	-28.0	-28.0	0.15 (1)	10.00			
N-I	0/377	-28.0	-28.0	0.15 (1)	10.00			
I-D	0/377	-28.0	-28.0	0.11 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
K	4-0-12	-27	-	-	BACK	VERT	TOTAL
L	2-0-12	-4	-	-	BACK	VERT	TOTAL
M	4-0-12	-4	-	-	BACK	VERT	TOTAL
N	6-0-12	-4	-	-	BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	48.1	PSF	

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.24")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.24")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.14 (C-J:1), BC=0.15 (F-G:1), WB=0.05 (C-F:2), SSI=0.12 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1987	622	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.76 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)

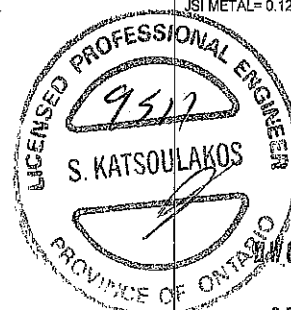

DRWG NO. TAM 44589-17
STRUCTURAL
COMPONENT ONLY

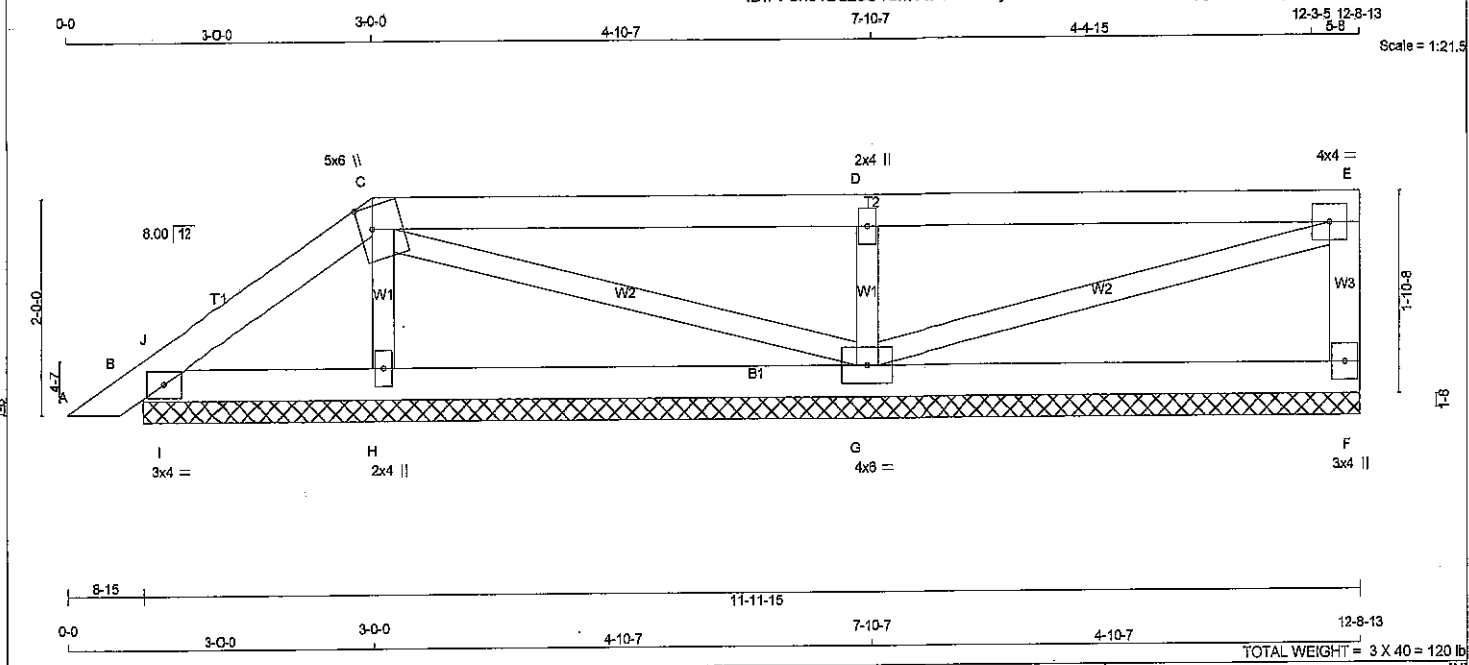

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
B - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMB1-I	MT20	3.0	4.0	
C	TTWW+m	MT20	5.0	6.0	2.50 1.50
D	TMW+w	MT20	2.0	4.0	
E	TMVW-t	MT20	4.0	4.0	
F	BMV1+p	MT20	3.0	4.0	
G	BMW1W1-I	MT20	4.0	6.0	
H	BMW1+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	
F	210	0	210	0	0	11-11-15	
B	194	0	194	0	0	11-11-15	
H	321	0	321	0	0	11-11-15	
G	677	0	677	0	0	11-11-15	

UNFACTORED REACTIONS							
JT	COMBINED	MAX./MIN. COMPONENT REACTIONS		PERM. LIVE	WIND	DEAD	SOIL
		SNOW	LIVE				
F	173	95 / 0	40 / 0	0 / 0	0 / 0	38 / 0	0 / 0
B	142	106 / 0	14 / 0	0 / 0	0 / 0	22 / 0	0 / 0
H	278	131 / 0	79 / 0	0 / 0	0 / 0	68 / 0	0 / 0
G	550	315 / 0	119 / 0	0 / 0	0 / 0	116 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, B, H, G

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 14	-84.3 -84.3	0.03 (1)	H-C	-198 / 0	0.03 (1)	
B-J	-32 / 0	-84.3 -84.3	0.01 (1)	C-G	-27 / 0	0.01 (1)	
J-C	-49 / 0	-84.3 -84.3	0.05 (1)	G-D	-512 / 0	0.07 (1)	
C-D	0 / 0	-84.3 -84.3	0.34 (1)	G-E	0 / 0	0.00 (1)	
D-E	0 / 0	-84.3 -84.3	0.34 (1)	I-J	-121 / 0	0.00 (1)	
F-E	-158 / 0	0.0 0.0	0.02 (1)				
B-I	0 / 38	-28.0 -28.0	0.05 (1)				
I-H	0 / 38	-28.0 -28.0	0.09 (2)				
H-G	0 / 25	-28.0 -28.0	0.17 (2)				
G-F	0 / 0	-28.0 -28.0	0.17 (3)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.34 (C-D:1), BC=0.17 (G-H:2), WB=0.07 (D-G:1), SS=0.20 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1557 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.27 (D) (INPUT = 0.90)
JSI METAL= 0.09 (D) (INPUT = 1.00)

DWG NO. TAM 4459317
STRUCTURAL
COMPONENT ONLY



DWG NO. TAM 4459317
STRUCTURAL
COMPONENT ONLY

LUS - Double Shear Joist Hangers



All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

MATERIAL: 18 gauge

FINISH: G90 galvanized

DESIGN:

- Factored resistances are in accordance with CSA O86-14
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.



INSTALLATION:

- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/4" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

OPTIONS:

- These hangers cannot be modified.


Typical LUS Installation

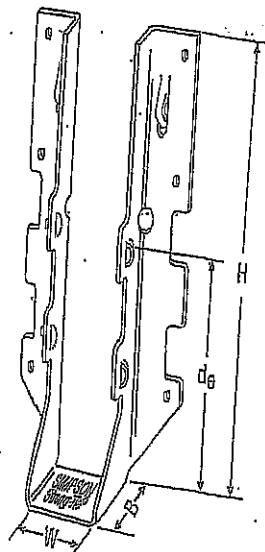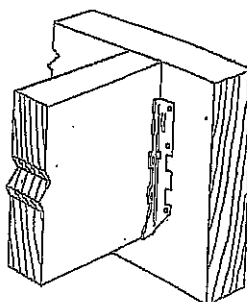

LUS28


Model No.	Ga	Dimensions (in)				Fasteners		Factored Resistances (lbs)			
		W	H	B	dg ¹	Face	Joist	D-FR-L		S-P-F	
								Uplift (K _U =1.15)	Normal (K _N =1.00)	Uplift (K _U =1.15)	Normal (K _N =1.00)
LUS24	18	1 1/8	3 1/4	1 1/4	1 1/8	4-10d	2-10d	710	1630	645	1155
LUS24-2	18	3 1/4	3 1/4	2	1 1/8	4-10d	2-10d	835	2020	590	1435
LUS26	18	1 1/8	4 1/4	1 1/4	3/8	4-10d	4-10d	1420	2170	1290	1880
LUS26-2	18	3 1/4	4 1/4	2	4	4-10d	4-10d	1720	2595	1545	1920
LUS26-3	18	4 1/4	4 1/4	2	3/4	4-10d	4-10d	1720	2595	1545	2340
LUS28	18	1 1/8	6 1/4	1 1/4	3/8	6-10d	4-10d	1420	2520	1290	1790
LUS28-2	18	3 1/4	7	2	4	6-10d	4-10d	1720	3325	1645	2575
LUS28-3	18	4 1/4	6 1/4	2	3/4	6-10d	4-10d	1720	3325	1645	2875
LUS210	18	1 1/8	7 1/4	1 1/4	3/8	8-10d	4-10d	1420	2785	1290	2210
LUS210-2	18	3 1/4	9	2	6	8-10d	6-10d	2580	4500	2320	3195
LUS210-3	18	4 1/4	8 1/4	2	5 1/4	8-10d	6-10d	2580	3345	2320	2975

1. dg is the distance from the seat of the hanger to the highest joist nail.




Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent
5,603,580



Double Shear Nailing
Top View

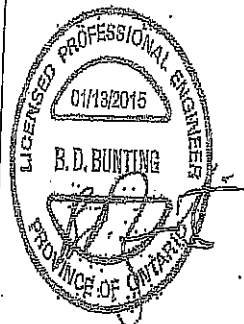

HUS/LJS - Double Shear Joist Hangers



All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

MATERIAL: See table

FINISH: G90 galvanized

DESIGN:


- Factored resistances are in accordance with CSA 086-14
- Uplift resistances have been increased 15%. No further increase is permitted
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

INSTALLATION:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

OPTIONS:


- See current catalogue for options




LJS26DS

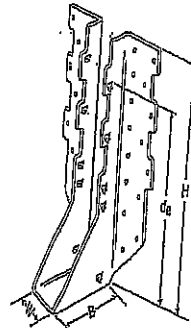


HUS210
(HUS24, HUS28, similar)



Typical LJS26DS
Installation

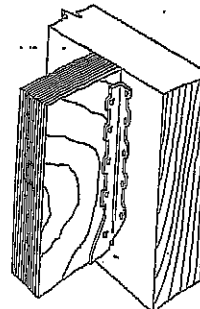


Typical HUS
Installation




Typical HUS Installation
(Truss Designer to provide fastener
quantity for connecting multiple
members together)

Model No.	Ra	Dimensions (in)				Fasteners		Factored Resistance (lbs)			
		W	H	B	d _g ¹	Face	Joist	D.F.P-L		S-P-F	
								Uplift (K _u =1.16)	Normal (K _n =1.00)	Uplift (K _u =1.16)	Normal (K _n =1.00)
LJS26DS	18	1 7/8	5	3 1/2	4 3/4	16-16d	6-16d	2055	4265	1450	4115
HUS26	16	1 5/8	5 1/2	3	3 1/4	14-16d	6-16d	2705	4940	2065	3875
HUS28	16	1 5/8	7 1/2	3	6 1/4	22-16d	8-16d	3605	5365	2875	4940
HUS210	18	1 5/8	6 1/2	3	7 1/4	30-16d	10-16d	4505	6795	4010	4740
HUS181/10	18	1 1/2	9	3	8	30-16d	10-16d	4505	6450	4010	5200


1. d_g is the distance from the seat of the hanger to the highest joist nail.




Double Shear Nailing prevents tabs breaking off (available on splice models).
U.S. Patent 5,603,560



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

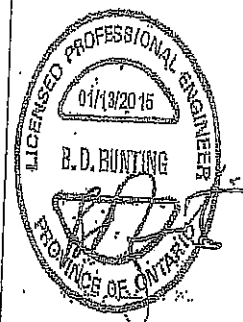


DESIGN

© 2015 Simpson Strong-Tie Company. All rights reserved. This document is the property of Simpson Strong-Tie Company and is not to be reproduced without written permission. The information in this document is for informational purposes only and does not constitute a contract. The user of this document is responsible for obtaining the correct information for their specific application. The user of this document is responsible for obtaining the correct information for their specific application. The user of this document is responsible for obtaining the correct information for their specific application.

800-999-5099
WWW.SIMPSONSTRONGTIE.COM

HGUS - Double Shear Joist Hangers



All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

MATERIAL: 12 gauge

FINISH: G90 galvanized

DESIGN:



- Factored resistances are in accordance with CSA O86-14
- Uplift resistances have been increased 15%.
No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

INSTALLATION:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3 1/4" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailing applications

OPTIONS:

- See current catalogue for options.




Typical HGUS Installation



Typical HGUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga	Dimensions (in)					Fasteners		Factored Resistance (lbs)			
		W	H	B	d ₁	Face	Joist		D.F.T.L.		S-P-F	
									Uplift (K _u =1.16)	Normal (K _n =1.00)	Uplift (K _u =1.16)	Normal (K _n =1.00)
HGUS26	12	1 1/2	5 1/2	5	4 1/2	20-16d	8-16d		2685	6625	2685	6700
HGUS26-2	12	3 3/8	5 1/2	4	4 1/2	20-16d	8-16d		4385	8950	5100	6355
HGUS26-3	12	4 3/8	5 1/2	4	4 1/2	20-16d	8-16d		4385	8950	5100	6355
HGUS26-4	12	6 3/8	5 1/2	4	4 1/2	20-16d	8-16d		4385	8950	5100	6355
HGUS28	12	1 1/2	7 1/2	5	6 1/2	36-16d	12-16d		3310	7675	3100	6800
HGUS28-2	12	3 3/8	7 1/2	4	6 1/2	36-16d	12-16d		6070	12980	4910	9215
HGUS28-3	12	4 3/8	7 1/2	4	6 1/2	36-16d	12-16d		6070	12980	4910	9215
HGUS28-4	12	6 3/8	7 1/2	4	6 1/2	36-16d	12-16d		6070	12980	4910	9215
HGUS210-2	12	3 3/8	9 1/2	4	8 1/2	48-16d	16-16d		8840	14645	4855	10400
HGUS210-3	12	4 3/8	9 1/2	4	8 1/2	48-16d	16-16d		8840	14645	4855	10400
HGUS210-4	12	6 3/8	9 1/2	4	8 1/2	48-16d	16-16d		8840	14645	4855	10400
HGUS212-4	12	6 3/8	10 1/2	4	10 1/2	60-16d	20-16d		7640	14895	5425	10645
HGUS214-4	12	6 3/8	12 1/2	4	11 1/2	66-16d	22-16d		10130	16400	7185	11645

1. d₂ is the distance from the seat of the hanger to the highest joist nail.




Double Double Shear Nailing prevents tabs breaking out (available on some models).


U.S. Patent 5,603,590



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

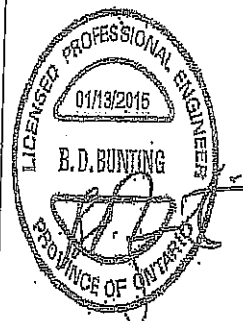

DESIGN


1. The Simpson Strong-Tie Company is not responsible for the design of the connection. The designer is responsible for the design of the connection. The Simpson Strong-Tie Company is not responsible for the design of the connection. The designer is responsible for the design of the connection.

800-999-5899
www.strongtie.com

MICRO CITY

ENGINEERING SERVICES INC.

TEL: (619) 287-2242

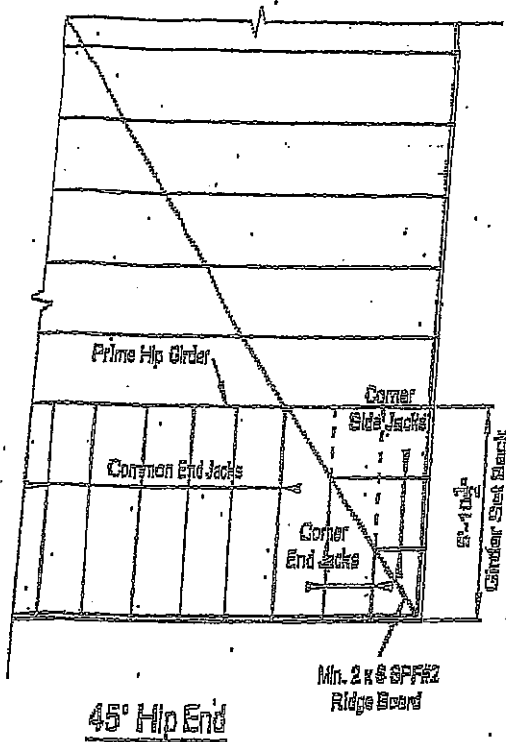

LUMBER SPECIFICATION

TOP CHORD : 2x4 SPF#2

BOTTOM CHORD : 2x4 SPF#2

WEBS : 2x3 SPF#2

UNLESS OTHERWISE SHOWN

DESIGN LOAD:

TOP CHORD LIVE LOAD : 39.4 P.S.F.





TOP CHORD DEAD LOAD : 3.0 P.S.F.

BOTTOM CHORD LIVE LOAD : 10.5 P.S.F.

BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.

TOTAL LOAD : 59.9 P.S.F.

DWG NO. T11-2495.11
STRUCTURAL
COMPONENT ONLY

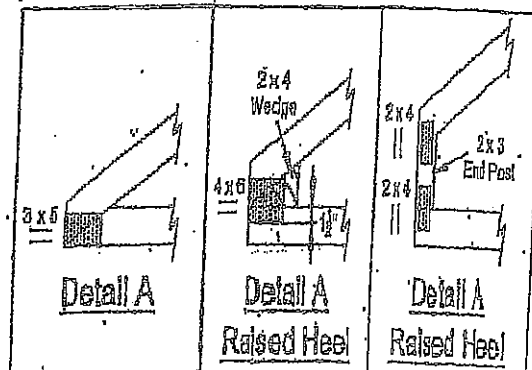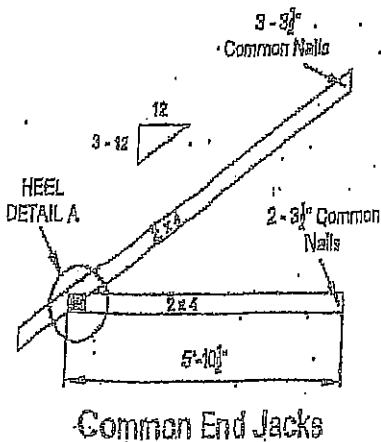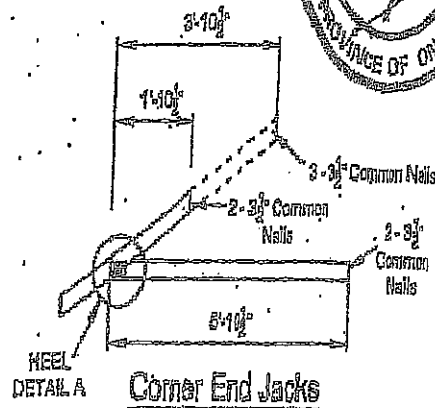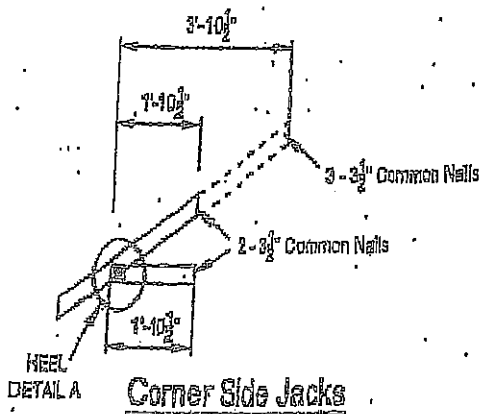


LUMBER SPECIFICATION

TOP CHORD : 2x4 SPF#2
 BOTTOM CHORD : 2x4 SPF#2
 WEBS : 2x3 SPF#2
 UNLESS OTHERWISE SHOWN



DESIGN LOAD:

TOP CHORD LIVE LOAD : 34.8 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.
TOTAL LOAD : 44.8 P.S.F.

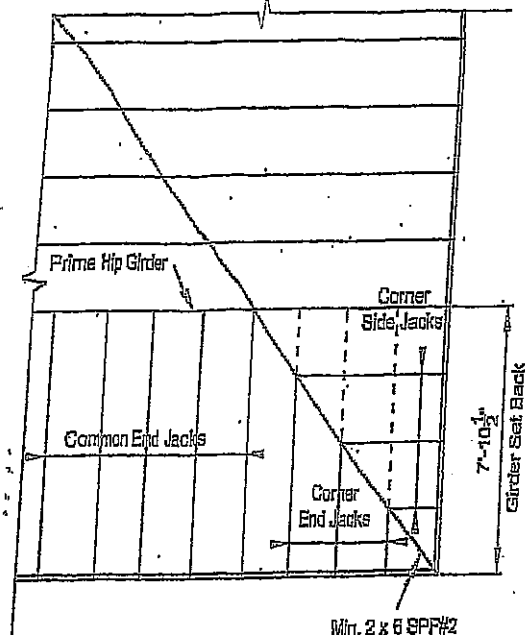


45° Hip End


OWN NO. 350314
**STRUCTURAL
 COMPONENT ONLY**

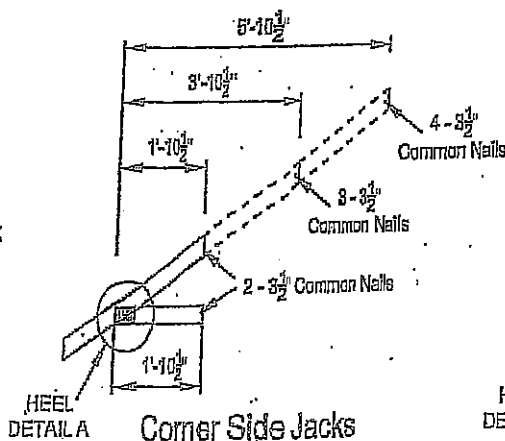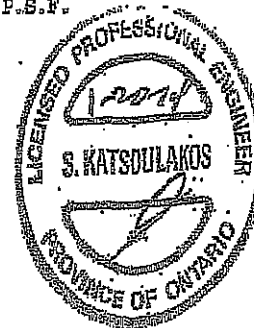


Corner Side Jacks

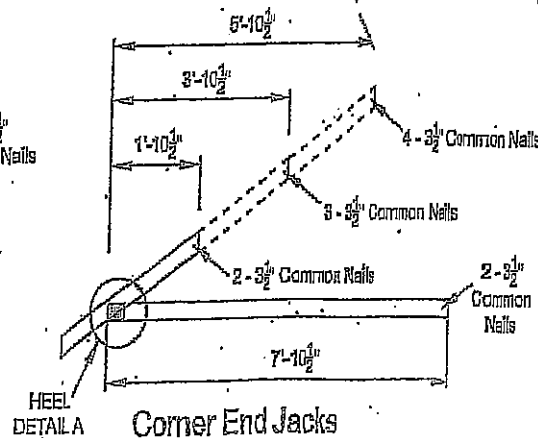

Corner End Jacks

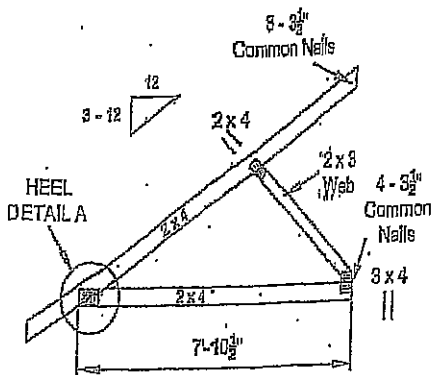


Common End Jacks

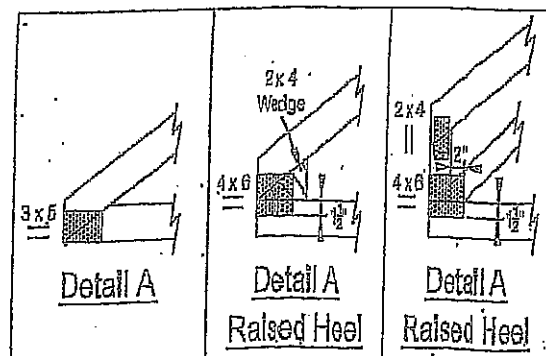

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated.
Dimensions are in ft-in-sixteenths or mm.
Apply plates to both sides of truss and fully embed teeth.

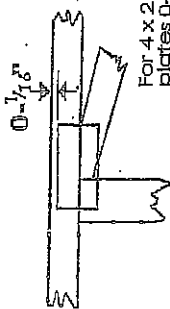

For 4 x 2 orientation, locate plates 0-1/2" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in Mitek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TFC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

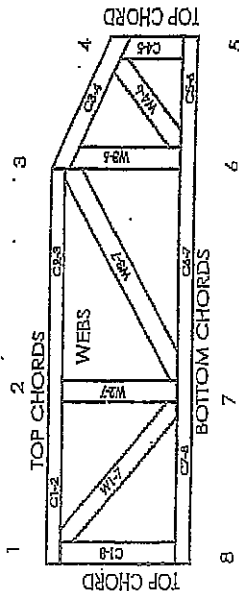

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FURTHEST TO THE LEFT.


CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 Mitek® All Rights Reserved



Mitek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loadings shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and waste at joint locations are regulated by TFC.
7. Design assumes trusses will be suitably protected from the environment in accord with TFC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TFC Quality Criteria.

Micro City Engineering Services Inc.
(BCIN: 26064; FIRM BCIN: 29991)

RR #1, Po Box 61
Glencoe, Ontario

N0L 1M0

(519) 287 - 2242; Fax: (519) 287 - 5750 (Call)

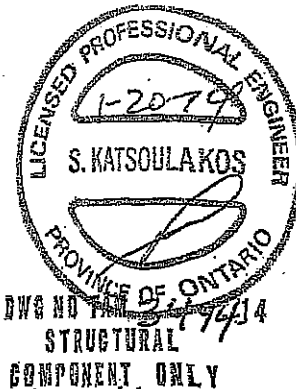

Responsibilities:

Micro City Engineering Services is responsible for the design of trusses as individual components.

It is the responsibilities of others to ascertain that the design loads utilized on this (these) drawing(s) meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdiction over such decisions.

All dimensions are to be verified by the owner, contractor, architect, or other authority having input over such decisions prior to truss component manufacture. At no time shall Micro City Engineering Services Inc. or its employees be responsible for dimension errors.

Micro City Engineering Services Inc. bears no responsibility for the erection of any truss components. Persons erecting truss components are cautioned to seek professional advice regarding temporary and permanent bracing systems and to be totally familiar with all aspects of truss erection prior to proceeding on any truss component erection job. Any bracing shown on Micro City Engineering Services Inc. or Tamarack Roof Trusses Inc. sealed or unsealed truss component drawings is specified for the single truss component in question and is identified as an integral part of the design for that particular truss component but is not meant to represent the only required bracing for that particular truss component when installed as a component in a series of truss components in a roof truss system.

~~It is the truss manufacturer's responsibility to ensure that trusses are manufactured in accordance with Micro City Engineering Services Inc. specifications outlined below:~~

SPECIFICATIONS:

Truss components sealed by Micro City Engineering Services Inc. must conform to the relevant sections of the current Building Code of Ontario and Canada (Part 4 or Part 9) or the current Farm Building Code of Canada in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the Truss Plate Institute of Canada (TPIC). All unit lumber and nailing stresses identified on truss component design drawings and/or used in the design of individual truss components shall conform to the current CSA Wood Design standard identified in the current Building Code and TPIC Design Standards.

The lumber used to manufacture any truss component is to conform to the specified size and grade identified on the truss drawing.

The lumber used in the manufacture of any truss component is not to exceed 19% during its service use unless specifically noted on the truss drawing.

The lumber used in the manufacture of any truss component is not to be treated with any chemicals during its service life unless specifically noted on the truss drawing.

Connector plates shall be applied to both faces of the truss component at each joint and shall be positioned exactly as specified.

The top chord of any truss component is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the sealed truss component drawing but not exceeding 24" o/c (Part 9 design) and not exceeding 48" o/c (Part 4 or Agricultural design).

When a truss component is to be installed with no rigid ceiling attached directly to the bottom chord, then the bottom chord is to be laterally braced at intervals not exceeding 3m (or 10'-0").

All sealed or unsealed truss component drawings provided by Micro City Engineering Services Inc. Or Tamarack Roof Trusses Inc. should be read in conjunction with the following:

Warning-Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473C rev 10-'08 BEFORE USE. Design valid for use only with Mitek connectors. This design is based only upon parameters shown, and is for individual building component. Applicability of design parameters and proper incorporation of component is the responsibility of the building designer - not the truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection, and bracing, consult TPIC Appendix G - Minimum Quality Manufacturing Criteria available from www.tpica.ca and BCSI Building Component Safety Information available from the Truss Plate Institute, 781 N. Lee Street, Suite 312, Alexandria, VA, 22314.