

ASPHALT SHINGLES
12" FINISH O.H.
R.T.M.C
2X6 EXTERIOR WALLS
2X6 FASCIA BOARD

HARDWARE:

HGUS26-2 -(XX)
LJS26DS -(V)

8/12 PITCHES (TYP.)
UNLESS NOTED

DENOTES:

H -2'-0" HIGHER PLATE


H2 -1'-6" RAISED CEILING

F -12" HIGHER FASCIA ONLY


ALL B- 2-2X10 BEAMS (FLUSH)

T-170534

DENOTES:
CONVENTIONAL
FRAMING



ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PARTS OF THE OBSOLETE EDITION
OF THE NATIONAL BUILDING CODE. ROOF FRAMING SHALL BE DESIGNED TO
RESIST A 2X6 VERTICAL POST TO THE TRUSS UNDER AT EACH CROSS POINT.
POSTS LONGER THAN 6' TO BE LATERALLY BRACED SO THAT THE DISTANCE
BETWEEN END POINTS AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.
DESIGN LOADS:
SNOW LOAD 25.6 PSF
TC DEAD 3 PSF
BC LIVE 10.5 PSF
BC DEAD 7 PSF

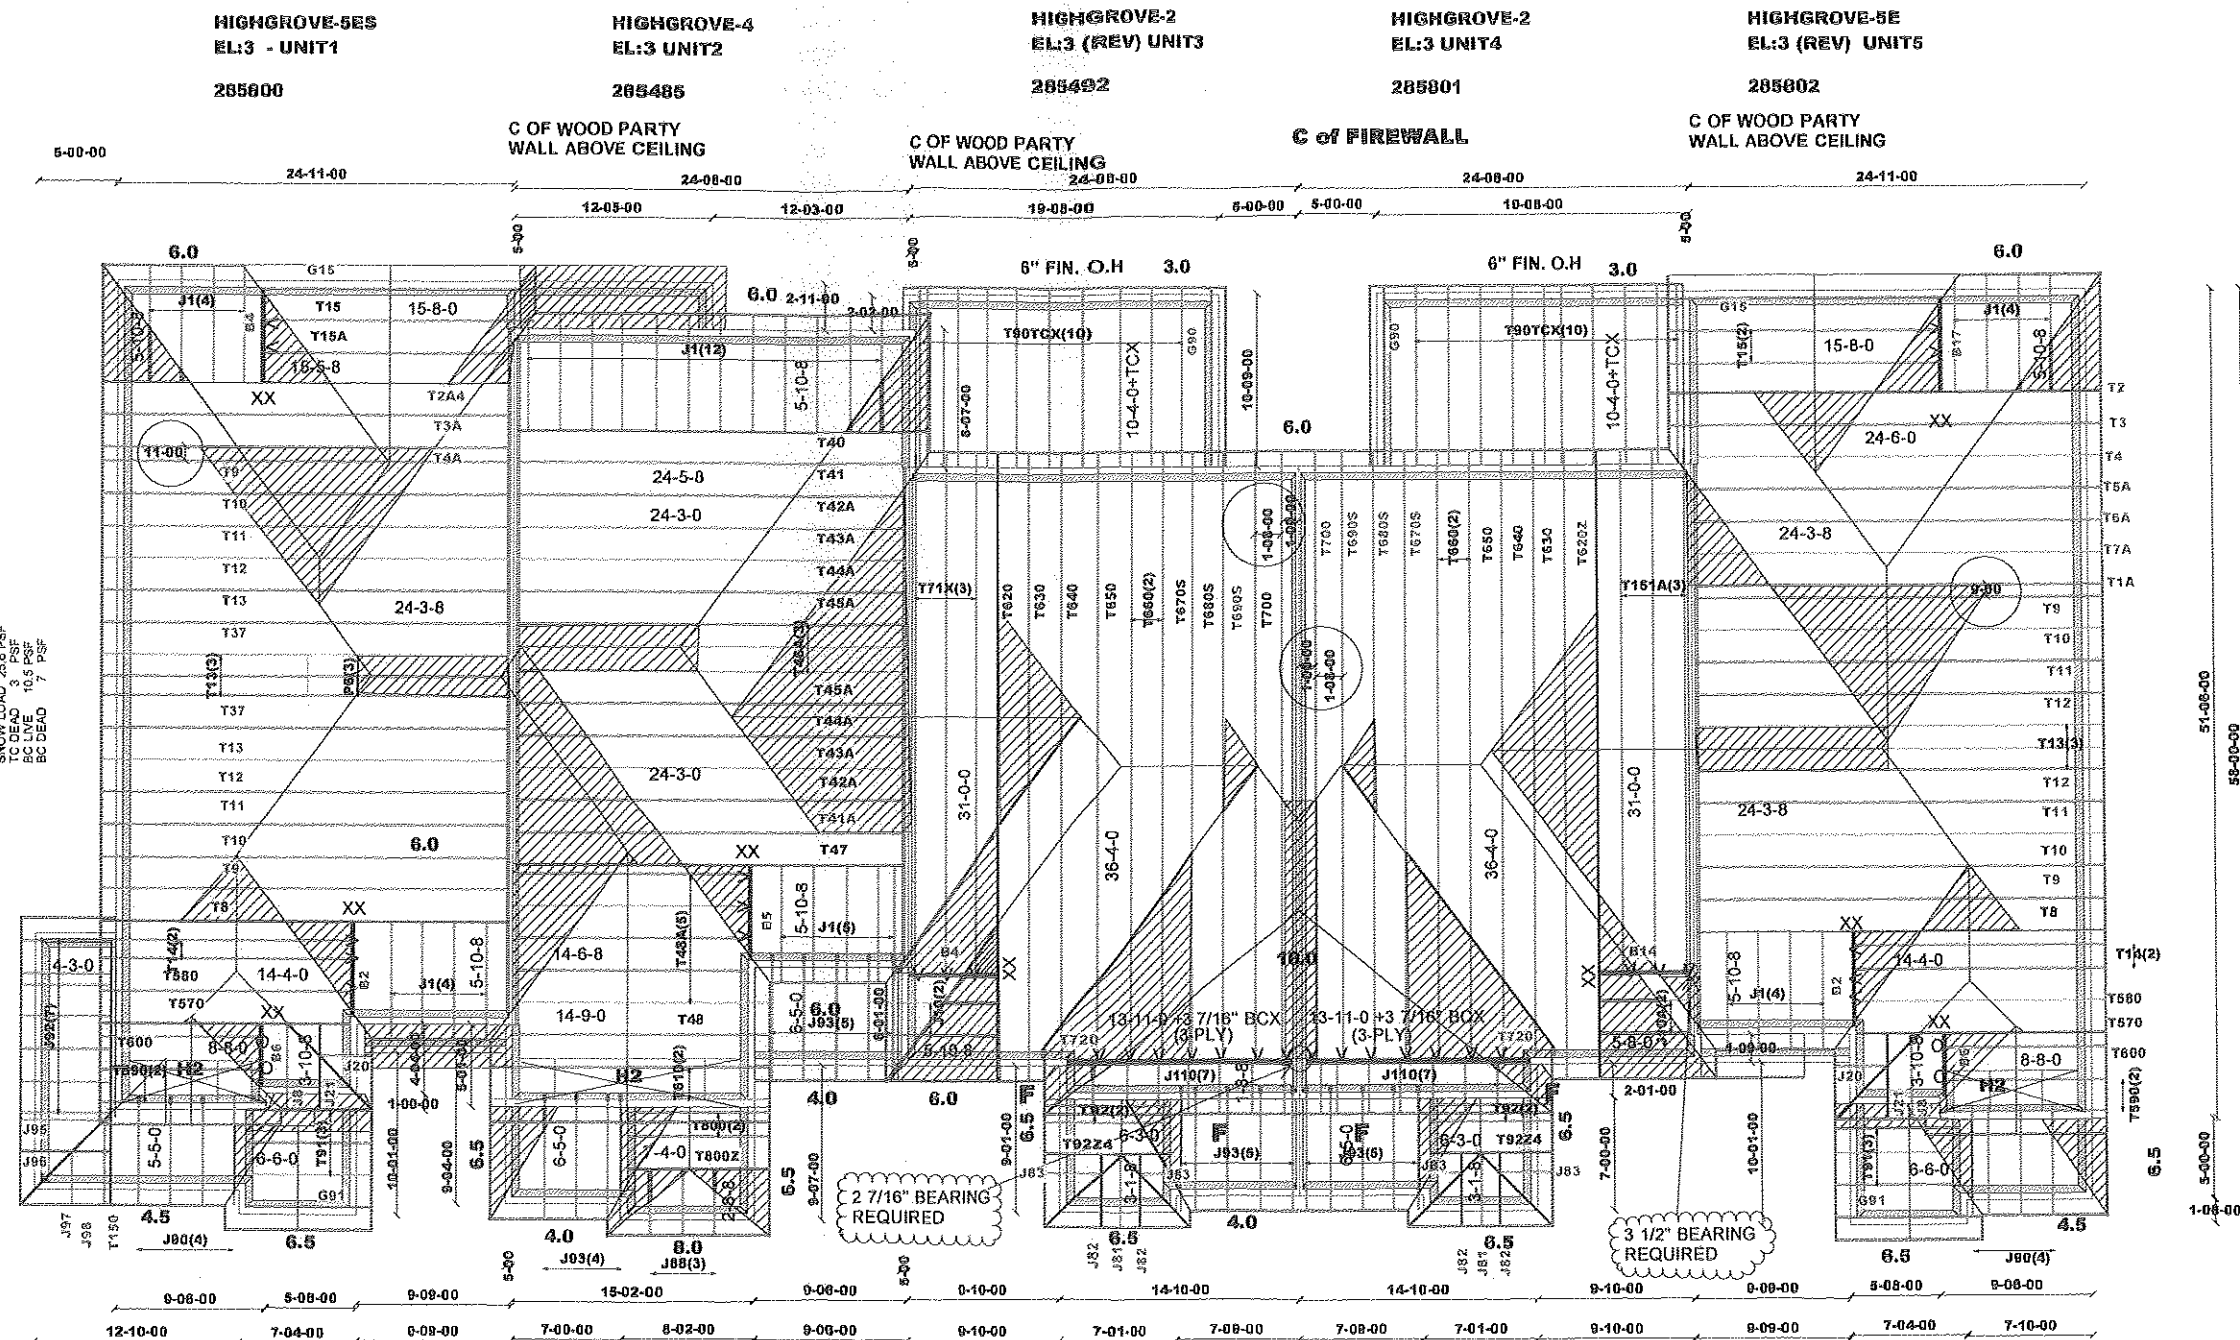

Job Track: 43954
Layout ID: 285799
Plan Log: 93446

Builder / Location:
GREENPARK HOMES / WATERDOWN
Project: **RUSSEL GARDENS PHASE 2**
Date: 06/26/18 Designer: sonny

Model / Elevation:
BLOCK205/ UNIT1 TO5 (REVISED)

Milek ver 7.5.0

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR
REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY
TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.



Delivery Shiplist

DATE	04/18/18
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285800 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH2 SUB-BUILDER:
 MODEL: HIGHGROVE 5ES ELEVATION: 3-UNIT1

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY PLY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
						TOP	BOT					
	1	T2A4 HIP GIRDER	8.00 0.00	24-03-08	04-01-04	2 X 6	2 X 6	01-03-08 00-00-00	01-04-13 01-06-08	142.19 87.67		
	1	T3A HIP	8.00 0.00	24-03-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	94.81 60.17		
	1	T4A HIP	8.00 0.00	24-03-08	06-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	103.53 66.33		
	1	T8 HALF HIP	8.00 0.00	24-03-08	04-01-04	2 X 6	2 X 6	01-03-08 00-00-00	01-04-13 04-01-04	143.26 88.34		
	2	T9 HALF HIP	8.00 0.00	24-03-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 05-01-04	197.10 123.66		
	2	T10 HALF HIP	8.00 0.00	24-03-08	06-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 06-01-04	212.66 133.34		
	2	T11 HALF HIP	8.00 0.00	24-03-08	07-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 07-01-04	225.56 142.68		
	2	T12 HALF HIP	8.00 0.00	24-03-08	08-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 08-01-04	234.64 146.34		
	5	T13 HALF HIP	8.00 0.00	24-03-08	09-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 09-01-04	614.40 379.15		
	2	T37 HALF HIP	8.00 0.00	24-03-08	10-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 10-01-04	257.54 159.34		
	1	T15 COMMON	8.00 0.00	15-08-00	06-07-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	66.76 42.00		
	1	G15 COMMON	8.00 0.00	15-08-00	06-07-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	69.72 45.00		
	1	T15A COMMON	8.00 0.00	15-05-08	06-07-08	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	64.50 41.33		
	2	T14 COMMON	8.00 0.00	14-04-00	06-02-02	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	123.52 78.00		
	1	T570 HIP GIRDER	8.00 0.00	14-04-00	03-11-13	2 X 4	2 X 6	01-03-08 01-03-08	01-04-13 01-04-13	70.63 46.34		
	1	T580 HIP	8.00 0.00	14-04-00	05-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	62.73 39.33		
	2	T590 ROOF	8.00 8.00	08-08-00	04-03-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	83.72 58.68		
	1	T600 COMMON	8.00 0.00	08-08-00	04-03-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	37.48 23.67		



Delivery Shiplist

DATE	04/18/18
SALES REP	Mario

JOB TRACK:43954 LAYOUT ID: 285800 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH-2 SUB-BUILDER:
 MODEL: HIGHGROVE 5ES ELEVATION: 3- UNIT1

ROOF TRUSSES

ROOF TRUSS SPACING:24.0 IN. O.C. (TYP.)

PROFILE	QTY PLY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER TOP BOT	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	1	T150 HALF HIP	4.50 0.00	15-01-00	01-11-12	2 X 4 2 X 4	01-03-08 00-00-00	00-04-10 01-11-12	48.83 32.00		
	3	T91 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4 2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	66.60 45.00		
	1	G91 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4 2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	23.39 16.00		
	3	P6 PIGGYBACK	8.00 0.00	11-11-15	01-10-08	2 X 4 2 X 4	00-00-00 00-00-00	00-04-07 01-10-08	120.33 77.01		
	8	J1 JACK-OPEN	6.00 0.00	05-10-08	04-01-04	2 X 4 2 X 4	01-03-08 00-00-00	01-02-00 04-01-04	134.32 85.36		
	1	J8 JACK-OPEN	8.00 0.00	03-10-08	03-11-13	2 X 4 2 X 4	01-03-08 00-00-00	01-04-13 03-11-13	12.81 8.00		
	1	J20 JACK-OPEN	8.00 0.00	01-10-08	02-07-02	2 X 4 2 X 4	01-03-08 -00-01-01	01-04-13 00-03-08	9.17 5.67		
	1	J21 JACK-OPEN	8.00 0.00	03-10-08	02-07-02	2 X 4 2 X 4	01-03-08 -02-01-01	01-04-13 00-03-08	12.97 8.00		
	4	J90 MONOPITCH	4.50 0.00	05-05-00	02-05-00	2 X 4 2 X 4	01-03-08 00-00-00	00-04-10 02-05-00	57.88 37.32		
	7	J92 JACK-OPEN	4.50 0.00	04-03-00	01-11-12	2 X 4 2 X 4	01-03-08 00-00-00	00-04-10 01-11-12	82.04 56.00		
	1	J95 JACK-OPEN	4.50 0.00	04-03-00	01-09-11	2 X 4 2 X 4	01-03-08 -00-05-09	00-04-10 00-03-08	11.15 7.33		
	1	J96 JACK-OPEN	4.50 0.00	04-03-00	01-00-11	2 X 4 2 X 4	01-03-08 -02-05-09	00-04-10 00-03-08	8.72 6.00		
	1	J97 JACK-OPEN	4.50 0.00	01-10-08	01-00-11	2 X 4 2 X 4	01-03-08 -00-01-01	00-04-10 00-03-08	6.01 4.00		
	1	J98 JACK-OPEN	4.50 0.00	01-10-08	01-09-11	2 X 4 2 X 4	01-03-08 01-10-15	00-04-10 00-04-05	8.45 5.33		

TOTAL # TRUSS= 63.00

TOTAL BFT OF ALL TRUSSES=

2154.39 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3407.42 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
3	Hangers	HGUS26-2	
2	Hangers	LUS24	
5	Hangers	LJS26DS	

TOTAL # ITEMS= 10.00



Delivery Shiplist

DATE	09/06/17
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285485 D LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH2 SUB-BUILDER:
 MODEL: HIGHGROVE 4 ELEVATION: 3- UNIT2

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	1	T40 HALF HIP	8.00 0.00	24-05-08	04-01-04	2 X 6	2 X 6	01-03-08 00-00-00	01-04-13 04-01-04	136.90 84.33		
	1	T41 HALF HIP	8.00 0.00	24-05-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 05-01-04	99.05 61.83		
	1	T41A HALF HIP	8.00 0.00	24-03-00	05-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 05-01-04	96.77 61.17		
	2	T42A HALF HIP	8.00 0.00	24-03-00	06-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 06-01-04	209.24 132.00		
	2	T43A HALF HIP	8.00 0.00	24-03-00	07-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 07-01-04	222.10 141.34		
	2	T44A HALF HIP	8.00 0.00	24-03-00	08-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 08-01-04	231.32 146.34		
	2	T45A HALF HIP	8.00 0.00	24-03-00	09-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 09-01-04	242.42 150.34		
	3	T46A HALF HIP	8.00 0.00	24-03-00	10-01-04	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 10-01-04	381.24 237.00		
	1	T47 FLAT GIRDER	0.00 0.00	24-03-00	04-01-04	2 X 6	2 X 6	00-00-00 00-00-00	04-01-04 04-01-04	145.78 90.67		
	1	T48 COMMON	8.00 0.00	14-09-00	06-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	63.33 39.00		
	5	T48A COMMON	8.00 0.00	14-06-08	06-03-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	305.35 191.65		
	2	T610 ROOF	8.00 8.00	14-09-00	06-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	125.70 83.66		
	2	T800 COMMON	6.50 0.00	07-04-00	02-07-04	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	48.84 31.34		
	1	T800Z COMMON	6.50 0.00	07-04-00	02-07-04	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	24.42 15.67		
	17	J1 JACK-OPEN	6.00 0.00	05-10-08	04-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-01-04	285.43 181.39		
	3	J88 JACK-OPEN	8.00 0.00	02-08-08	02-07-05	2 X 4	2 X 4	01-03-08 00-00-00	00-09-10 02-07-05	27.57 18.00		
	9	J93 MONOPITCH	4.00 0.00	06-05-00	02-05-10	2 X 4	2 X 4	01-03-08 00-00-00	00-03-15 02-05-10	163.44 105.03		

TOTAL # TRUSS= 55.00

TOTAL BFT OF ALL TRUSSES=

1770.76 BFT. TOTAL WEIGHT OF ALL TRUSSES= 2808.90 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
-----	-----------	-------	--------------------



Delivery Shiplist


DATE	09/06/17
SALES REP	Mario

JOB TRACK: 43954	LAYOUT ID: 285485D	LOCATION:
BUILDER: GREENPARK - RUSSELL GARDENS PH 2	SUB-BUILDER:	
MODEL: HIGHGROVE 4	ELEVATION: 3- UNIT2	

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
1	Hangers	HGUS26-2	
3	Hangers	LJS26DS	

TOTAL # ITEMS= 4.00

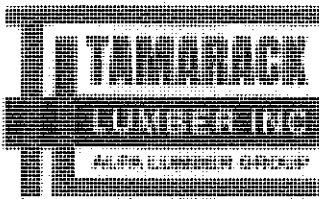

Delivery Shiplist


DATE	06/26/18
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285492 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH SUB-BUILDER:
 MODEL: HIGHGROVE 2 ELEVATION: 3 (REV)-UNIT3

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	3	T71X COMMON	6.00 0.00	31-00-00	08-08-12	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 00-09-08	368.61 229.50		
	10	T90TCX MONOPITCH	3.00 0.00	10-04-00	03-05-09	2 X 6	2 X 4	00-09-08 00-00-00	00-08-04 03-05-09	449.90 303.30		
	1	G90 MONOPITCH	3.00 0.00	10-04-00	03-03-04	2 X 4	2 X 4	00-09-08 00-00-00	00-08-04 03-03-04	59.06 38.33		
	2	T92 COMMON	6.50 0.00	06-03-00	02-03-12	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	43.08 30.00		
	1	T9224 COMMON	6.50 0.00	06-03-00	02-03-12	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	21.54 15.00		
	1	T620 HIP GIRDER	6.00 0.00	36-04-00	05-03-13	2 X 4	2 X 6	01-03-08 01-03-08	01-02-00 01-02-00	213.66 131.66		
	1	T630 HIP	6.00 0.00	36-04-00	06-07-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	146.04 92.83		
	1	T640 HIP	6.00 0.00	36-04-00	08-01-04	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	246.52 153.33		
	1	T650 HIP	6.00 0.00	36-04-00	09-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	156.18 98.00		
	2	T660 COMMON	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	293.96 180.00		
	1	T670S ROOF	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	161.65 100.67		
	1	T680S ROOF	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	173.83 108.67		
	1	T690S ROOF	6.00 0.00	36-04-00	10-01-13	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	178.48 109.83		
	1	T700 ROOF	6.00 0.00	36-04-00	11-03-02	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	188.58 116.33		
	1 3 Ply	T720 HALF HIP	8.00 0.00	13-11-00	04-00-12	2 X 4	2 X 6	00-00-00 00-00-00	02-04-13 00-00-04	247.65 161.01		
	2	J10 JACK-OPEN	8.00 0.00	05-10-08	05-03-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 00-05-03	35.66 21.34		
	1	J81 JACK-OPEN	6.50 0.00	03-01-08	02-03-12	2 X 4	2 X 4	01-03-08 00-00-00	00-07-07 02-03-12	10.08 7.33		
	2	J82 JACK-OPEN	6.50 0.00	03-01-08	01-07-01	2 X 4	2 X 4	01-03-08 -01-04-01	00-07-07 00-03-08	16.70 12.00		

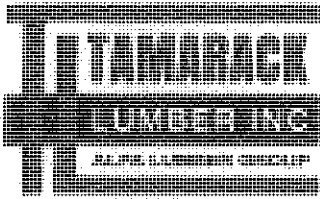

Delivery Shiplist

DATE	06/26/18
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285492 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH SUB-BUILDER:
 MODEL: HIGHGROVE 2 ELEVATION: 3 (REV)-UNIT3

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	2	J83 JACK-OPEN	6.50 0.00	01-10-08	01-07-01	2 X 4	2 X 4	01-03-08 -00-01-01	00-07-07 00-03-08	13.84 9.34		
	5	J93 MONOPITCH	4.00 0.00	06-05-00	02-05-10	2 X 4	2 X 4	01-03-08 00-00-00	00-03-15 02-05-10	90.80 58.35		
	7	J110 JACK-OPEN	10.00 0.00	01-08-08	04-00-12	2 X 4	2 X 4	01-03-08 00-00-00	02-07-11 04-00-12	64.40 46.69		

TOTAL # TRUSS= 49.00


TOTAL BFT OF ALL TRUSSES=

2023.51 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3180.22 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
10	Hangers	LJS26DS	
1	Hangers	HGUS26-2	

TOTAL # ITEMS= 11.00

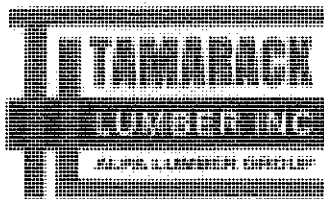

Delivery Shiplist

DATE	06/26/18
SALES REP	Mario

JOB TRACK: 43954

LAYOUT ID: 285801

LOCATION:

BUILDER: GREENPARK - RUSSELL GARDENS PH

SUB-BUILDER:


MODEL: HIGHGROVE2

ELEVATION: 3-UNIT4

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY PLY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
						TOP	BOT					
	10	T90TCX MONOPITCH	3.00 0.00	10-04-00	03-05-09	2 X 6	2 X 4	00-09-08 00-00-00	00-08-04 03-05-09	449.90 303.30		
	1	G90 MONOPITCH	3.00 0.00	10-04-00	03-03-04	2 X 6	2 X 4	00-09-08 00-00-00	00-08-04 03-03-04	40.90 26.67		
	2	T92 COMMON	6.50 0.00	06-03-00	02-03-12	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	43.08 30.00		
	1	T92Z4 COMMON	6.50 0.00	06-03-00	02-03-12	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	21.54 15.00		
	3	T151A COMMON	6.00 0.00	31-00-00	09-09-12	2 X 4	2 X 4	01-05-00 00-00-00	01-02-00 02-11-08	382.05 239.49		
	1	T620Z HIP GIRDER	6.00 0.00	36-04-00	05-03-13	2 X 4	2 X 6	01-03-08 01-03-08	01-02-00 01-02-00	213.66 131.66		
	1	T630 HIP	6.00 0.00	36-04-00	06-07-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	146.04 92.83		
	1	T640 HIP	6.00 0.00	36-04-00	07-11-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	148.64 93.00		
	1	T650 HIP	6.00 0.00	36-04-00	09-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	156.18 98.00		
	2	T660 COMMON	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 01-03-08	01-02-00 01-02-00	293.96 180.00		
	1	T670S ROOF	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	161.65 100.67		
	1	T680S ROOF	6.00 0.00	36-04-00	10-03-00	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	173.83 108.67		
	1	T690S ROOF	6.00 0.00	36-04-00	10-01-13	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	178.48 109.83		
	1	T700 ROOF	6.00 0.00	36-04-00	11-03-02	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-04-08	188.58 116.33		
	1 3 Ply	T720 HALF HIP	8.00 0.00	13-11-00	04-00-12	2 X 4	2 X 6	00-00-00 00-00-00	02-04-13 00-00-04	247.65 161.01		
	2	J10A JACK-OPEN	8.00 0.00	05-08-00	05-03-13	2 X 4	2 X 4	00-00-00 00-00-00	01-06-08 00-05-03	31.40 21.34		
	1	J81 JACK-OPEN	6.50 0.00	03-01-08	02-03-12	2 X 4	2 X 4	01-03-08 00-00-00	00-07-07 02-03-12	10.08 7.33		
	2	J82 JACK-OPEN	6.50 0.00	03-01-08	01-07-01	2 X 4	2 X 4	01-03-08 -01-04-01	00-07-07 00-03-08	16.70 12.00		

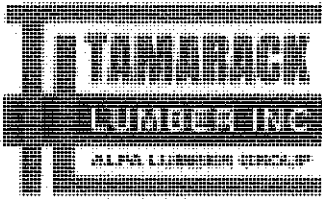

Delivery Shiplist

DATE	06/26/18
SALES REP	Mario

JOB TRACK: 43954 LAYOUT ID: 285801 LOCATION:
 BUILDER: GREENPARK - RUSSELL GARDENS PH SUB-BUILDER:
 MODEL: HIGHGROVE2 ELEVATION: 3-UNIT4

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	2	J83 JACK-OPEN	6.50 0.00	01-10-08	01-07-01	2 X 4	2 X 4	01-03-08 -00-01-01	00-07-07 00-03-08	13.84 9.34		
	5	J93 MONOPITCH	4.00 0.00	06-05-00	02-05-10	2 X 4	2 X 4	01-03-08 00-00-00	00-03-15 02-05-10	90.80 58.35		
	7	J110 JACK-OPEN	10.00 0.00	01-08-08	04-00-12	2 X 4	2 X 4	01-03-08 00-00-00	02-07-11 04-00-12	64.40 46.69		

TOTAL # TRUSS= 49.00

TOTAL BFT OF ALL TRUSSES=

1961.51 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3073.36 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
1	Hangers	HGUS26-2	
10	Hangers	LJS26DS	

TOTAL # ITEMS= 11.00



Delivery Shiplist

DATE	04/18/18
SALES REP	Mario

JOB TRACK: 43954	LAYOUT ID: 285802	LOCATION:
BUILDER: GREENPARK - RUSSELL GARDENS PH 2	SUB-BUILDER:	
MODEL: HIGHGROVE5E	ELEVATION: 3(REV)- UNIT5	

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	1	T1A COMMON	8.00 0.00	24-03-08	09-06-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	102.41 64.00		
	1	T2 HIP GIRDER	8.00 0.00	24-06-00	04-01-04	2 X 6	2 X 6	01-03-08 01-01-00	01-04-13 01-04-13	145.29 89.67		
	1	T3 HIP	8.00 0.00	24-06-00	05-01-04	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	97.09 60.83		
	1	T4 HIP	8.00 0.00	24-06-00	06-01-04	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	105.79 67.00		
	1	T5A HIP	8.00 0.00	24-03-08	07-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	104.32 67.00		
	1	T6A HIP	8.00 0.00	24-03-08	08-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	108.82 69.50		
	1	T7A HIP	8.00 0.00	24-03-08	09-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 01-06-08	114.67 72.50		
	1	T888 HALF HIP	8.00 0.00	24-03-08	04-01-04	2 X 6	2 X 6	01-03-08 00-00-00	01-04-13 04-01-04	143.26 88.34		
	2	T9 HALF HIP	8.00 0.00	24-03-08	05-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 05-01-04	197.10 123.66		
	2	T10 HALF HIP	8.00 0.00	24-03-08	06-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 06-01-04	212.66 133.34		
	2	T11 HALF HIP	8.00 0.00	24-03-08	07-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 07-01-04	225.56 142.68		
	2	T12 HALF HIP	8.00 0.00	24-03-08	08-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 08-01-04	234.64 146.34		
	3	T13 HALF HIP	8.00 0.00	24-03-08	09-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 09-01-04	368.64 227.49		
	2	T15 COMMON	8.00 0.00	15-08-00	06-07-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	133.52 84.00		
	1	G15 COMMON	8.00 0.00	15-08-00	06-07-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	69.72 45.00		
	2	T14 COMMON	8.00 0.00	14-04-00	06-02-02	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	123.52 78.00		
	1	T570 HIP GIRDER	8.00 0.00	14-04-00	03-11-13	2 X 4	2 X 6	01-03-08 01-03-08	01-04-13 01-04-13	70.63 46.34		
	1	T580 HIP	8.00 0.00	14-04-00	05-03-13	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	62.73 39.33		



Delivery Shiplist

DATE	04/18/18
SALES REP	Mario

JOB TRACK: 43954	LAYOUT ID: 285802	LOCATION:
BUILDER: GREENPARK - RUSSELL GARDENS PH 2	SUB-BUILDER:	
MODEL: HIGHGROVE5E	ELEVATION: 3(REV)- UNIT5	

ROOF TRUSSES

ROOF TRUSS SPACING: 24.0 IN. O.C. (TYP.)

PROFILE	QTY	MARK TYPE	PITCH TC BC	SPAN	TRUSS HEIGHT	LUMBER		OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY: REMARKS
	PLY					TOP	BOT					
	2	T590 ROOF	8.00 8.00	08-08-00	04-03-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	83.72 58.68		
	1	T600 COMMON	8.00 0.00	08-08-00	04-03-08	2 X 4	2 X 4	01-03-08 01-03-08	01-04-13 01-04-13	37.48 23.67		
	3	T91 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	66.60 45.00		
	1	G91 COMMON	6.50 0.00	06-06-00	02-04-09	2 X 4	2 X 4	01-03-08 01-03-08	00-07-07 00-07-07	23.39 16.00		
	8	J1 JACK-OPEN	6.00 0.00	05-10-08	04-01-04	2 X 4	2 X 4	01-03-08 00-00-00	01-02-00 04-01-04	134.32 85.36		
	1	J8 JACK-OPEN	8.00 0.00	03-10-08	03-11-13	2 X 4	2 X 4	01-03-08 00-00-00	01-04-13 03-11-13	12.81 8.00		
	1	J20 JACK-OPEN	8.00 0.00	01-10-08	02-07-02	2 X 4	2 X 4	01-03-08 -00-01-01	01-04-13 00-03-08	9.17 5.67		
	1	J21 JACK-OPEN	8.00 0.00	03-10-08	02-07-02	2 X 4	2 X 4	01-03-08 -02-01-01	01-04-13 00-03-08	12.97 8.00		
	4	J90 MONOPITCH	4.50 0.00	05-05-00	02-05-00	2 X 4	2 X 4	01-03-08 00-00-00	00-04-10 02-05-00	57.88 37.32		

TOTAL # TRUSS= 48.00


TOTAL BFT OF ALL TRUSSES=

1932.72 BFT. TOTAL WEIGHT OF ALL TRUSSES= 3058.71 LBS.

HARDWARE

QTY	ITEM TYPE	MODEL	LENGTH FT-IN-16
3	Hangers	HGUS26-2	
5	Hangers	LJS26DS	
2	Hangers	LUS24	

TOTAL # ITEMS= 10.00

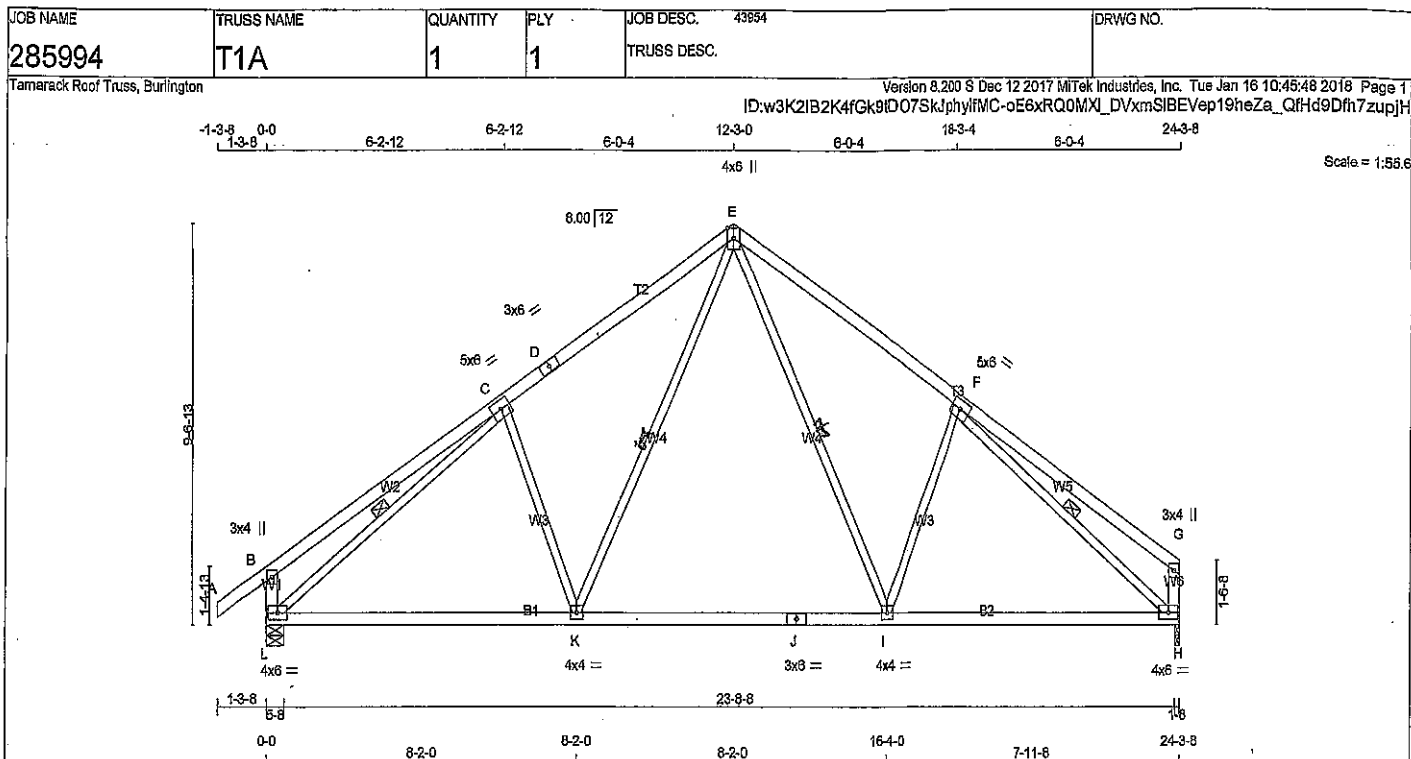

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2 SPF
D - E	2x4	DRY	No.2 SPF
E - G	2x4	DRY	No.2 SPF
L - B	2x4	DRY	No.2 SPF
H - G	2x4	DRY	No.2 SPF
L - J	2x4	DRY	No.2 SPF
J - H	2x4	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0		
D	TS-t	MT20	3.0	6.0		
E	TTWW+p	MT20	4.0	6.0	Edge	
F	TMWW-t	MT20	5.0	6.0		
G	TMV+p	MT20	3.0	4.0		
H	BMVW-t	MT20	4.0	6.0		
I	BMWW-t	MT20	4.0	4.0		
J	BS-t	MT20	3.0	6.0		
K	BMWW-t	MT20	4.0	4.0		
L	BMVW-t	MT20	4.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ UPLIFT		
L	1479	0	1479	0	5-8	5-8
H	1393	0	1393	0	1-8	1-8

UNFACTORED REACTIONS

JT	1ST LGASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	1196	692/0	255/0	0/0	0/0	251/0	0/0
H	1119	621/0	255/0	0/0	0/0	243/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-L, F-H. *E-K, E-I*

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			MEMB.	WEBS		
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)		MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO			
A-B	0/32	-84.3	-84.3 0.11 (1)	10.00	C-K	-352/44	0.19 (1)
B-C	0/34	-84.3	-84.3 0.52 (1)	10.00	K-E	0/632	0.14 (1)
C-D	-1409/0	-84.3	-84.3 0.45 (1)	4.98	E-I	0/689	0.13 (1)
D-E	-1409/0	-84.3	-84.3 0.45 (1)	4.98	I-F	-316/58	0.17 (1)
E-F	-1388/0	-84.3	-84.3 0.44 (1)	5.01	L-C	-1669/0	0.71 (1)
F-G	0/34	-84.3	-84.3 0.50 (1)	10.00	F-H	-1653/0	0.67 (1)
L-B	-311/0	0.0	0.0 0.03 (1)	7.81			
H-G	-186/0	0.0	0.0 0.02 (1)	7.81			
L-K	0/1275	-28.0	-28.0 0.56 (2)	10.00			
K-J	0/889	-28.0	-28.0 0.54 (2)	10.00			
J-I	0/889	-28.0	-28.0 0.54 (2)	10.00			
I-H	0/1245	-28.0	-28.0 0.56 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.61")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.17")
ALLOWABLE DEFL.(TL) = $L/360$ (0.61")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.28")

CSI: TC=0.52/1.00 (B-C:1), BC=0.58/1.00 (K-L:2), WS=0.71/1.00 (C-L:1), SS=0.21/1.00 (C-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(FS)	(PL)	(PL)	(PL)
MT20	918	354	1667
	822	2284	1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (L) (INPUT = 0.90)
JSI METAL= 0.43 (C) (INPUT = 1.00)




DRWG NO. TAM 3984-18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Wed Sep 06 15:07:29 2017 Page 1

ID:w3K2lB2K4fGk9lD07SkJphylfMC-dEva2kVNDh5jQgpiNwGoUsEo1TDrD3MZqUhcJyygKSC

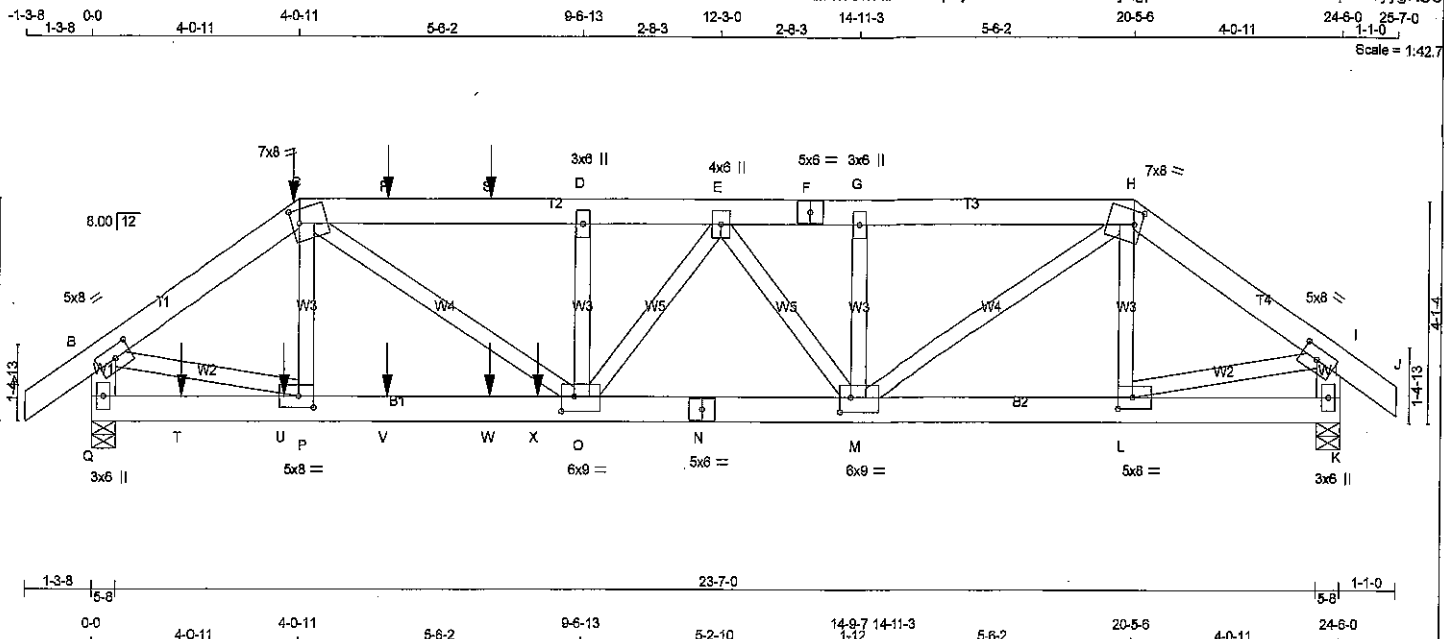

TOTAL WEIGHT = 145 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x8	DRY	No.2
C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2
H - J	2x6	DRY	No.2
O - B	2x6	DRY	No.2
K - I	2x8	DRY	No.2
O - N	2x6	DRY	No.2
N - K	2x8	DRY	No.2

ALL WEBS	SIZE	LUMBER	DESCR.
EXCEPT	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.50 3.75
C	TTWW-m	MT20	7.0	8.0	3.00 1.75
D	TMW-w	MT20	3.0	6.0	
E	TMWW-t	MT20	4.0	6.0	
F	TS-t	MT20	5.0	8.0	
G	TMW-w	MT20	3.0	6.0	
H	TTWW-m	MT20	7.0	8.0	3.00 1.75
J	TMVW-t	MT20	5.0	8.0	2.50 3.75
K	BMV1+p	MT20	3.0	6.0	
L	BMWW-t	MT20	5.0	8.0	2.50 3.50
M	BMWWW-t	MT20	6.0	9.0	3.25 2.50
N	BS-t	MT20	5.0	6.0	
O	BMWWW-t	MT20	6.0	9.0	3.25 3.00
P	BMWW-t	MT20	5.0	8.0	2.50 3.50
Q	BMV1+p	MT20	3.0	6.0	

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 348.6 lbs FACTORED DOWN AT 4-0-11, AND 101.4 lbs FACTORED DOWN AT 5-9-4, AND 101.4 lbs FACTORED DOWN AT 7-9-4 ON TOP CHORD, AND 89.9 lbs FACTORED DOWN AT 1-9-4, 69.9 lbs FACTORED DOWN AT 3-9-4, 69.9 lbs FACTORED DOWN AT 5-9-4, AND 89.9 lbs FACTORED DOWN AT 7-9-4, AND 1198.5 lbs FACTORED DOWN AT 8-8-8 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX	BRG
Q	2827	0	2827	0	0	5-8	5-8	5-8	5-8
K	2044	0	2044	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
Q	2283	1328 / 0	478 / 0	0 / 0	0 / 0	477 / 0	0 / 0
K	1853	959 / 0	349 / 0	0 / 0	0 / 0	345 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.59 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (LBS)	MAX. CSI (LC)	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 33	-84.3 -84.3	0.07 (1)	10.00	P-C	-139 / 257	0.05 (3)
B-C	-3423 / 0	-84.3 -84.3	0.20 (1)	4.42	C-O	0 / 2214	0.39 (1)
C-R	-4686 / 0	-84.3 -84.3	0.45 (1)	3.59	O-D	-575 / 0	0.10 (1)
R-S	-4686 / 0	-84.3 -84.3	0.45 (1)	3.59	M-G	-441 / 0	0.08 (1)
S-D	-4686 / 0	-84.3 -84.3	0.45 (1)	3.59	M-H	0 / 2102	0.37 (1)
D-E	-4686 / 0	-84.3 -84.3	0.30 (1)	3.75	L-H	-227 / 73	0.04 (1)
E-F	-3708 / 0	-84.3 -84.3	0.20 (1)	4.27	B-P	0 / 2905	0.51 (1)
F-G	-3708 / 0	-84.3 -84.3	0.20 (1)	4.27	L-I	0 / 2003	0.35 (1)
G-H	-3708 / 0	-84.3 -84.3	0.28 (1)	4.20	O-E	0 / 804	0.14 (1)
H-I	-2360 / 0	-84.3 -84.3	0.16 (1)	5.18	E-M	-848 / 0	0.20 (1)
I-J	0 / 28	-84.3 -84.3	0.05 (1)	10.00			
Q-B	-2807 / 0	0.0 0.0	0.20 (1)	6.20			
K-I	-2008 / 0	0.0 0.0	0.14 (1)	7.10			

Q-T	0 / 0	-28.0 -28.0	0.23 (2)	10.00
T-U	0 / 0	-28.0 -28.0	0.23 (2)	10.00
U-P	0 / 0	-28.0 -28.0	0.23 (2)	10.00
P-V	0 / 2835	-28.0 -28.0	0.80 (1)	10.00
V-W	0 / 2835	-28.0 -28.0	0.80 (1)	10.00
W-X	0 / 2835	-28.0 -28.0	0.80 (1)	10.00
X-O	0 / 2835	-28.0 -28.0	0.80 (1)	10.00
O-N	0 / 4209	-28.0 -28.0	0.82 (1)	10.00
N-M	0 / 4209	-28.0 -28.0	0.82 (1)	10.00
M-L	0 / 1950	-28.0 -28.0	0.34 (1)	10.00
L-K	0 / 0	-28.0 -28.0	0.10 (2)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	DEAD
C	4-0-11	-23	-25	---	FRONT	VERT	TOTAL
C	4-0-11	-104	-104	---	FRONT	VERT	TOTAL
C	4-0-11	-222	-222	---	FRONT	VERT	TOTAL
R	5-9-4	-101	-101	---	FRONT	VERT	TOTAL
S	7-9-4	-101	-101	---	FRONT	VERT	TOTAL
T	1-9-4	-40	-70	---	FRONT	VERT	TOTAL
U	3-9-4	-40	-70	---	FRONT	VERT	TOTAL
V	5-9-4	-40	-70	---	FRONT	VERT	TOTAL
W	7-9-4	-40	-70	---	FRONT	VERT	TOTAL
X	8-8-8	-1189	-1189	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.82")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL)= L/360 (0.82")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.45 (C-D:1), BC=0.82 (M-O:1),

WB=0.51 (B-P:1), SSI=0.75 (O-P:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618 354 1887 822 2284 1656	


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.88 (N) (INPUT = 1.00)

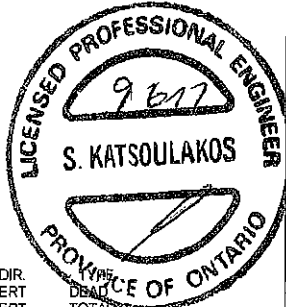

DRWG NO. TAM 50027-17
STRUCTURAL
COMPONENT ONLY

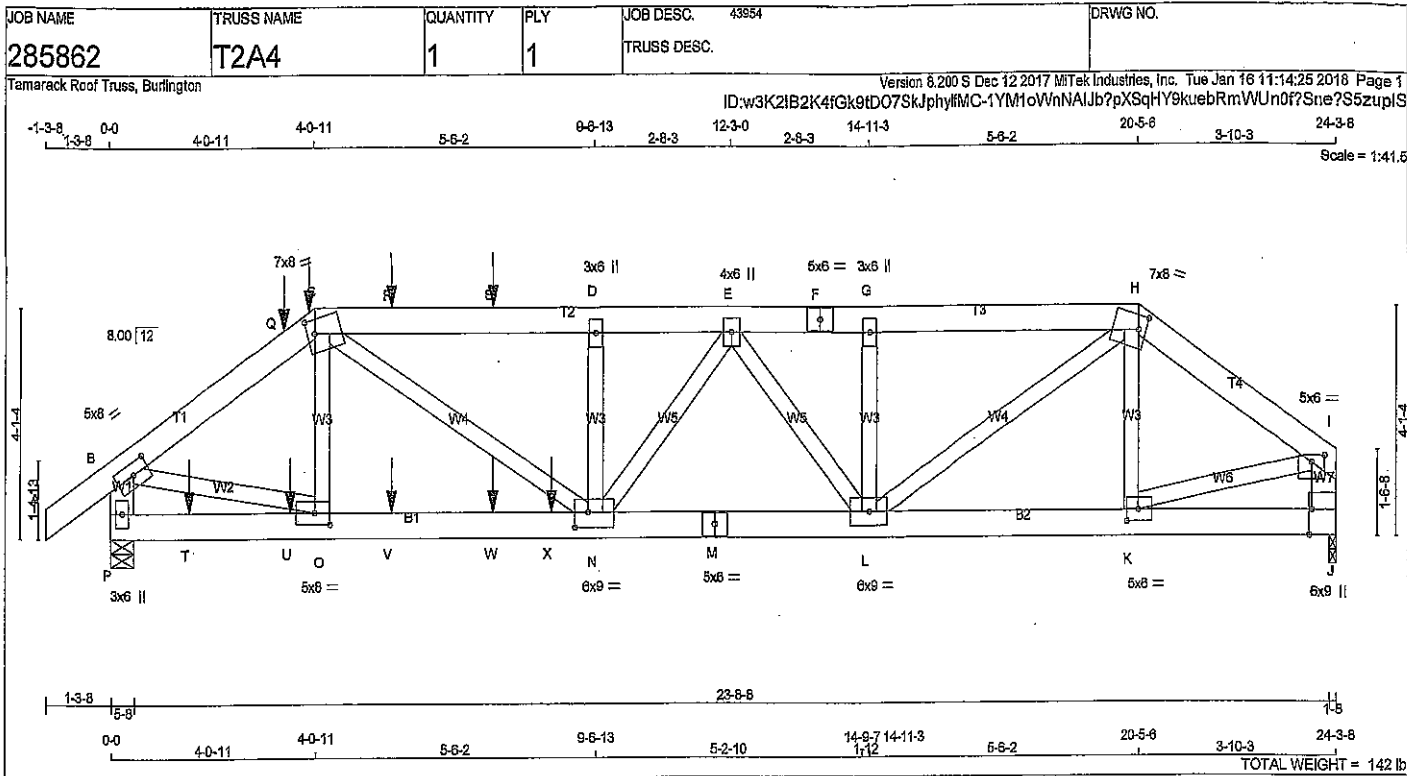

LUMBER				N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY	No.2	A - C	2x6	DRY	No.2
C - F	2x6	DRY	No.2	C - F	2x6	DRY	No.2
F - H	2x6	DRY	No.2	F - H	2x6	DRY	No.2
H - I	2x6	DRY	No.2	H - I	2x6	DRY	No.2
I - J	2x6	DRY	No.2	I - J	2x6	DRY	No.2
J - K	2x6	DRY	No.2	J - K	2x6	DRY	No.2
K - L	2x6	DRY	No.2	K - L	2x6	DRY	No.2
L - M	2x6	DRY	No.2	L - M	2x6	DRY	No.2
M - J	2x6	DRY	No.2	M - J	2x6	DRY	No.2

ALL WEBS 2x4 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-t	MT20	5.0	8.0	2.50	3.75
C	TTWVW-m	MT20	7.0	8.0	3.00	1.75
D	TMWV-w	MT20	3.0	8.0		
E	TMWVW-t	MT20	4.0	6.0		
F	TS-t	MT20	5.0	6.0		
G	TMWV-w	MT20	3.0	8.0		
H	TTWVW-m	MT20	7.0	8.0	3.00	1.75
I	TMWV-p	MT20	5.0	6.0	1.50	3.00
J	BMV1+p	MT20	6.0	9.0	5.50	0.50
K	BMWVW-t	MT20	5.0	6.0	2.50	2.75
L	BMWVW-t	MT20	6.0	9.0		
M	BS-t	MT20	5.0	6.0		
N	BMWVW-t	MT20	6.0	9.0	3.25	3.00
O	BMWVW-t	MT20	5.0	8.0	2.50	3.50
P	BMV1+p	MT20	3.0	6.0		

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 122.8 lbs FACTORED DOWN AT 3-6-12, 101.4 lbs FACTORED DOWN AT 5-6-12, AND 101.4 lbs FACTORED DOWN AT 7-6-12, AND 244.5 lbs FACTORED DOWN AT 4-0-11 ON TOP CHORD, AND 69.9 lbs FACTORED DOWN AT 1-6-12, 69.9 lbs FACTORED DOWN AT 3-6-12, 69.9 lbs FACTORED DOWN AT 5-6-12, AND 69.9 lbs FACTORED DOWN AT 7-6-12, AND 1245.8 lbs FACTORED DOWN AT 8-8-8 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
P	2868	0	2868	0	5-8	5-8
J	1954	0	1954	0	1-8	1-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
P	2308	1357 / 0	474 / 0	0 / 0	0 / 0	479 / 0	0 / 0
J	1689	908 / 0	348 / 0	0 / 0	0 / 0	337 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	FACTORED FORCE (LBS)	MAX. CS1 (LC)	MEMB.
FR-TO				FR-TO			
A-B	0 / 33	-84.3	-84.3 0.07 (1)	10.00	C-C	-135 / 261	0.05 (3)
B-Q	-3431 / 0	-84.3	-84.3 0.22 (1)	4.39	C-N	0 / 2219	0.39 (1)
Q-C	-3431 / 0	-84.3	-84.3 0.22 (1)	4.39	N-D	-564 / 0	0.10 (1)
C-R	-4718 / 0	-84.3	-84.3 0.45 (1)	3.58	L-G	-441 / 0	0.08 (1)
R-S	-4718 / 0	-84.3	-84.3 0.45 (1)	3.58	L-H	0 / 2162	0.38 (1)
S-D	-4718 / 0	-84.3	-84.3 0.45 (1)	3.58	K-H	-298 / 37	0.05 (1)
D-E	-4718 / 0	-84.3	-84.3 0.30 (1)	3.75	B-O	0 / 2934	0.52 (1)
E-F	-3683 / 0	-84.3	-84.3 0.20 (1)	4.28	K-I	0 / 1981	0.34 (1)
F-G	-3683 / 0	-84.3	-84.3 0.20 (1)	4.28	N-E	0 / 850	0.15 (1)
G-H	-3683 / 0	-84.3	-84.3 0.28 (1)	4.21	E-L	-896 / 0	0.21 (1)
H-I	-2276 / 0	-84.3	-84.3 0.14 (1)	5.27			
P-B	-2047 / 0	0.0	0.0 0.20 (1)	6.16			
J-I	-1922 / 0	0.0	0.0 0.14 (1)	7.22			

JT	LOC.	LC1	FACTORED CONCENTRATED LOADS (LBS)		FACE	DIR.
			MAX-	MAX+		
C	4-0-11	-23	-25		FRONT	VERT
C	4-0-11	-222			FRONT	VERT
Q	3-6-12	-123			BACK	VERT
R	5-6-12	-101			BACK	VERT
S	7-6-12	-101			BACK	VERT
T	1-6-12	-40			BACK	VERT
U	3-6-12	-40			BACK	VERT
V	5-6-12	-40			BACK	VERT
W	7-6-12	-40			BACK	VERT
X	8-8-8	-1246			BACK	VERT

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/989 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CS1 TC=0.45/1.00 (C-D:1), BC=0.83/1.00 (L-N:1),
WB=0.52/1.00 (B-O:1), SS1=0.78/1.00 (N-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 522 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.88 (M) (INPUT = 1.00)

DWG NO. TAM 1007-18
STRUCTURAL
COMPONENT ONLY






DW000.TAM50029-17
STRUCTURAL
COMPONENT ONLY

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 Mittek Industries, Inc. Tue Jan 16 10:32:00 2018 Page 1

ID:w3K2IB2K4fGk9ID07SkJphyfMC-2x4wft_XLgiAhTJEINL4CkbGs0m_3GPEKfQd6zupwD

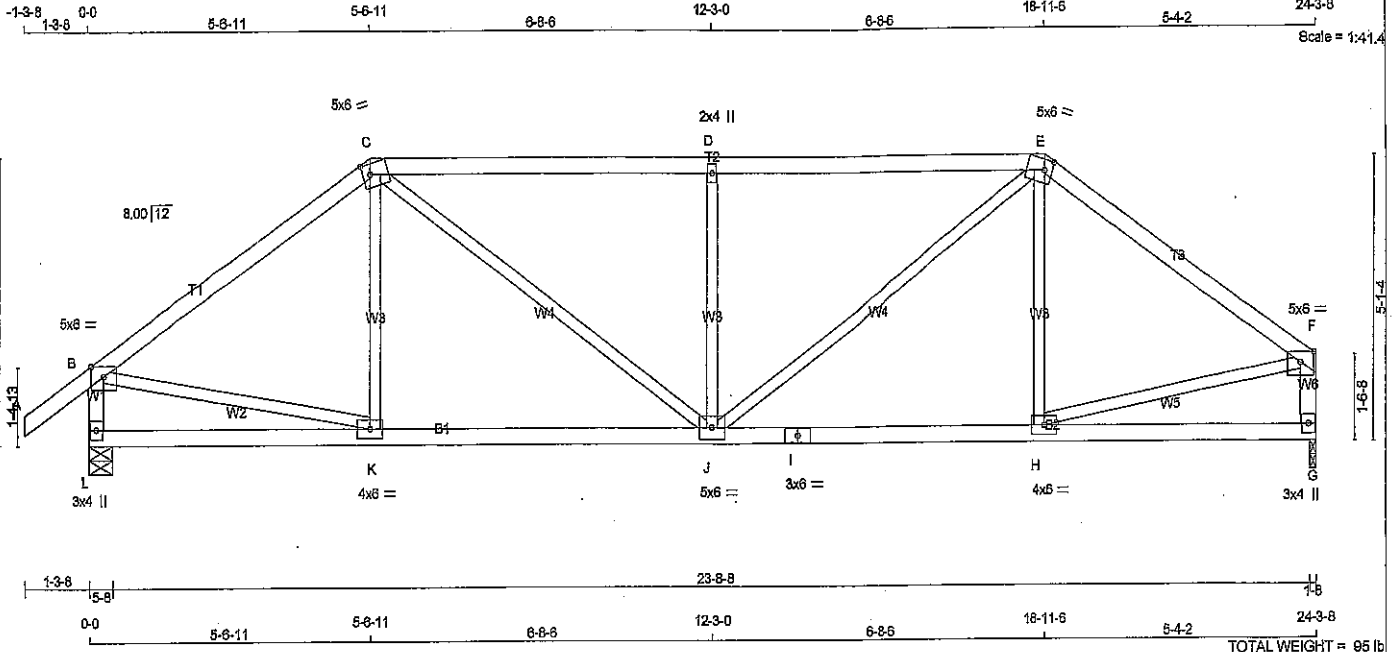

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
L - B	2x4	DRY	No.2
G - F	2x4	DRY	No.2
L - I	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
L	1479	0	1479	0	0	5-8	5-8		
G	1363	0	1363	0	0	1-8	1-8		

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS								
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
L	1168	892/0	255/0	0/0	0/0	251/0	0/0		
G	1119	621/0	255/0	0/0	0/0	243/0	0/0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MEMB.	FORCE	MAX	LC1
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0/32	-84.3	-84.3 0.11 (1)	K-C	-45/211	0.05 (3)	
B-C	-1485/0	-84.3	-84.3 0.55 (1)	C-J	0/728	0.18 (1)	
C-D	-1833/0	-84.3	-84.3 0.80 (1)	J-D	-692/0	0.27 (1)	
D-E	-1833/0	-84.3	-84.3 0.80 (1)	J-E	0/769	0.17 (1)	
E-F	-1455/0	-84.3	-84.3 0.50 (1)	H-E	-81/187	0.04 (3)	
L-B	-1418/0	0.0	0.0 0.15 (1)	B-K	0/1265	0.28 (1)	
G-F	-1305/0	0.0	0.0 0.14 (1)	H-F	0/1239	0.28 (1)	
L-K	0/0	-28.0	-28.0 0.25 (3)				
K-J	0/1241	-28.0	-28.0 0.40 (2)				
J-I	0/1208	-28.0	-28.0 0.39 (2)				
I-H	0/1208	-28.0	-28.0 0.39 (2)				
H-G	0/0	-28.0	-28.0 0.24 (3)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	3.0	PSF
BOT CH. LL	=	10.5	PSF
DL	=	7.0	PSF
TOTAL LOAD	=	46.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 089-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.80/1.00 (D-E-1), BC=0.40/1.00 (J-K-2), WB=0.28/1.00 (B-K-1), SSI=0.27/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1687
		822	2284
			1658


PLATE PLACEMENT TOL. = 0.250 Inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.35 (I) (INPUT = 1.00)

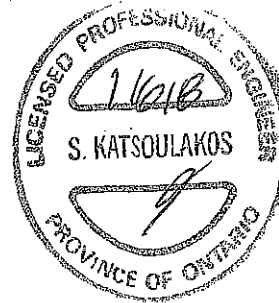

DRWG NO. TAM 4008-13
STRUCTURAL
COMPONENT ONLY

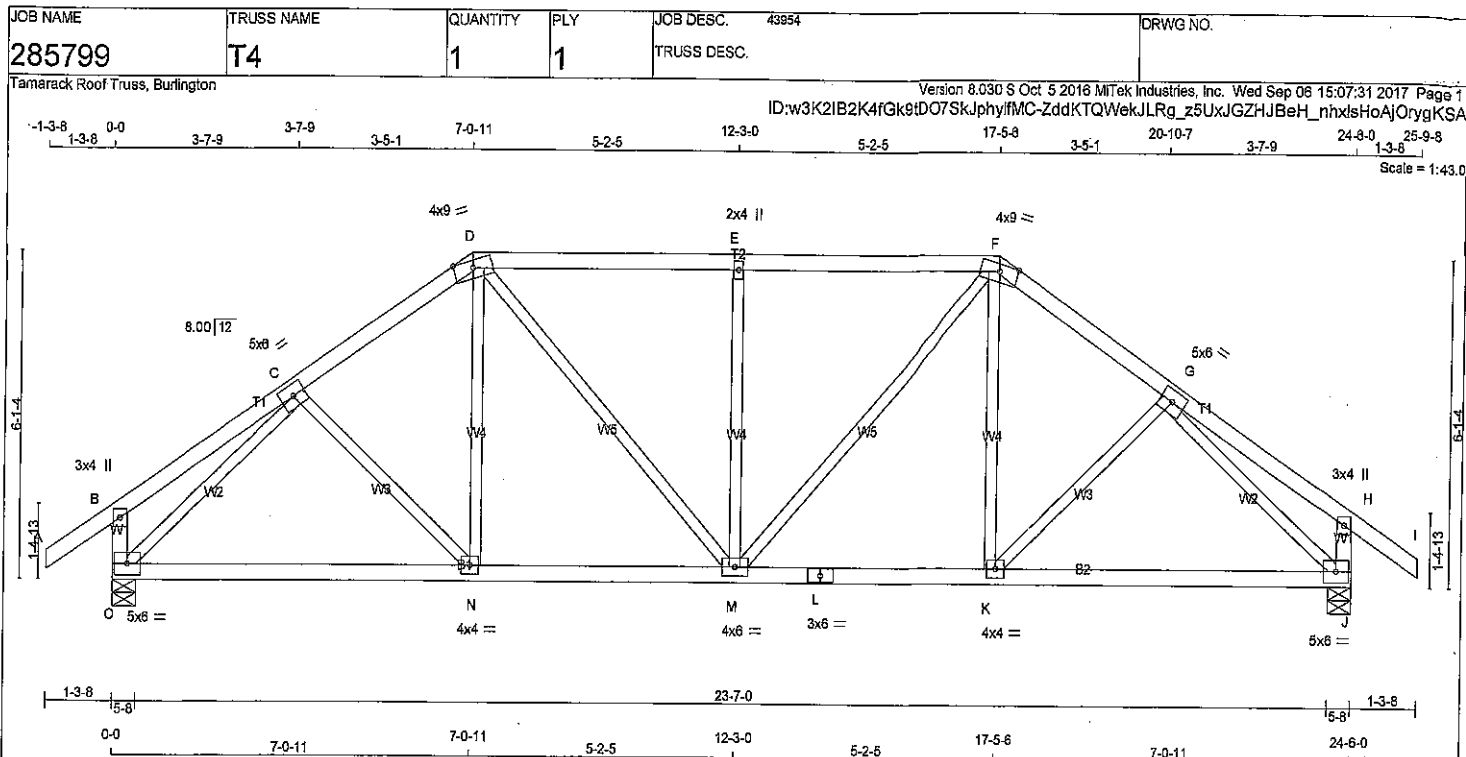

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
O - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
O - L	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0		
D	TTWW-m	MT20	4.0	9.0	Edge	
E	TMW+w	MT20	2.0	4.0		
F	TTWW-m	MT20	4.0	9.0	Edge	
G	TMWW-l	MT20	5.0	6.0		
H	TMV+p	MT20	3.0	4.0		
J	BMVW1-t	MT20	5.0	6.0		
K	BMWW-l	MT20	4.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMWWW-t	MT20	4.0	6.0		
N	BMWW-t	MT20	4.0	4.0		
O	BMVW1-t	MT20	5.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
O	1491	0	1491	0	5-8	5-8
J	1491	0	1491	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SC
O	1208	697 / 0	257 / 0	0 / 0	0 / 0	253 / 0	0 / 0
J	1208	697 / 0	257 / 0	0 / 0	0 / 0	253 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.02 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX CS1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	C-N	0 / 119	0.03 (3)	
B-C	0 / 17	-84.3	-84.3	0.15 (1)	10.00	N-D	0 / 304	0.07 (2)	
C-D	-1476 / 0	-84.3	-84.3	0.14 (1)	5.27	D-M	0 / 424	0.10 (1)	
D-E	-1498 / 0	-84.3	-84.3	0.32 (1)	5.02	M-E	-533 / 0	0.31 (1)	
E-F	-1498 / 0	-84.3	-84.3	0.32 (1)	5.02	M-F	0 / 424	0.10 (1)	
F-G	-1476 / 0	-84.3	-84.3	0.14 (1)	5.27	K-F	0 / 304	0.07 (2)	
G-H	0 / 17	-84.3	-84.3	0.15 (1)	10.00	K-G	0 / 119	0.03 (3)	
H-I	0 / 32	-84.3	-84.3	0.11 (1)	10.00	O-C	-1686 / 0	0.65 (1)	
O-B	-233 / 0	0.0	0.0	0.02 (1)	7.81	G-J	-1686 / 0	0.65 (1)	
J-H	-233 / 0	0.0	0.0	0.02 (1)	7.81				
O-N	0 / 1208	-28.0	-28.0	0.45 (2)	10.00				
N-M	0 / 1216	-28.0	-28.0	0.47 (2)	10.00				
M-L	0 / 1216	-28.0	-28.0	0.47 (2)	10.00				
L-K	0 / 1216	-28.0	-28.0	0.47 (2)	10.00				
K-J	0 / 1208	-28.0	-28.0	0.45 (2)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.82")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.82")
CALCULATED VERT. DEFL.(TL) = L/999 (0.19")

CSI: TC=0.32 (D-E:1), BC=0.47 (M-N:2), WB=0.65 (C-O:1), SSI=0.21 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 615 354 1667 822 2284 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.88 (F) (INPUT = 0.90)
JSI METAL= 0.41 (C) (INPUT = 1.00)

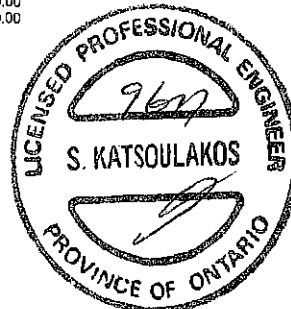

DRWG NO. TAM 5004-17
STRUCTURAL
COMPONENT ONLY




DWG NO. TAM 4009-18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43854	DRWG NO.
285994	T5A	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 Mitek Industries, Inc. Tue Jan 16 10:45:48 2018 Page 1
ID:w3K2IB2K4fGk9tDO7SkJphylfMC-oE6xRQ0MXI_DVxmSIBEvP1E4eZg_N7Hd9Dfh7zupjH

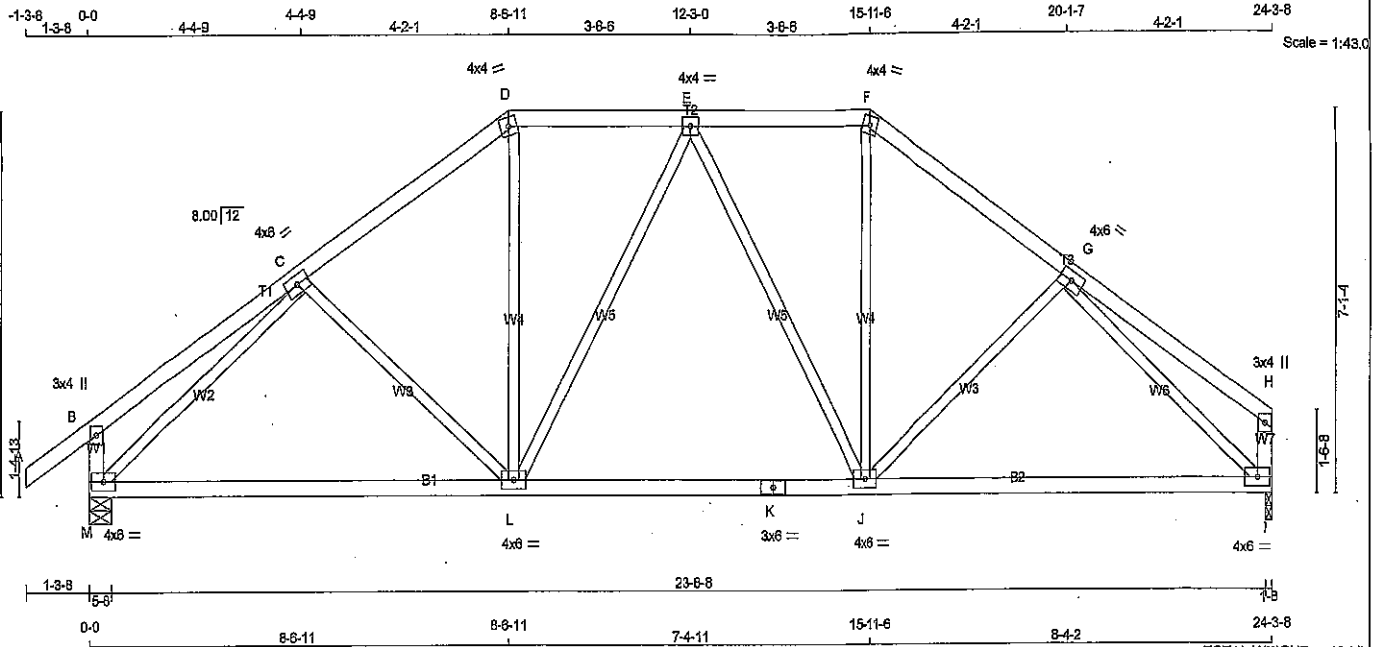

TOTAL WEIGHT = 104 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
M - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
M - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
SPF			
DRY, SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	JT	DOWN	JT	IN-SX	JT	IN-SX
M	1479	0	1479	0	5-8	5-8	
I	1363	0	1363	0	1-8	1-8	

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND		DEAD		SOIL	
JT	COMBINED	JT	LIVE	JT	PERM	JT	LIVE	JT	PERM
M	1196	892 / 0	255 / 0	0 / 0	0 / 0	251 / 0	0 / 0	0 / 0	0 / 0
I	1119	821 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.32 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
A-B	0 / 32	C-L	-117 / 85
B-C	0 / 22	L-D	0 / 495
C-D	-1368 / 0	D-E	-195 / 0
D-E	-1142 / 0	E-F	-225 / 0
E-F	-1128 / 0	F-G	0 / 484
F-G	-1371 / 0	G-H	-70 / 102
G-H	0 / 22	H-I	-1690 / 0
H-I	-255 / 0	I-J	-1632 / 0
I-J	-131 / 0	J-K	0 / 0
J-K	0 / 1222	K-L	0 / 0
K-L	0 / 1233	L-M	0 / 0
L-M	0 / 1233	M-N	0 / 0
M-N	0 / 1173	N-O	0 / 0

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	46.1	PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.23")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/761 (0.38")

CSI: TC=0.24/1.00 (B-C:1), BC=0.58/1.00 (J-L:2),
WB=0.93/1.00 (C-M:1), SSI=0.19/1.00 (L-M:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)
MAX	MIN	MAX
MT20	818	354
	1667	822
	2284	1856


PLATE PLACEMENT TOL. = 0.25Q inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.40 (C) (INPUT = 1.00)



DRWG NO. TAM 3985-18
STRUCTURAL
COMPONENT ONLY

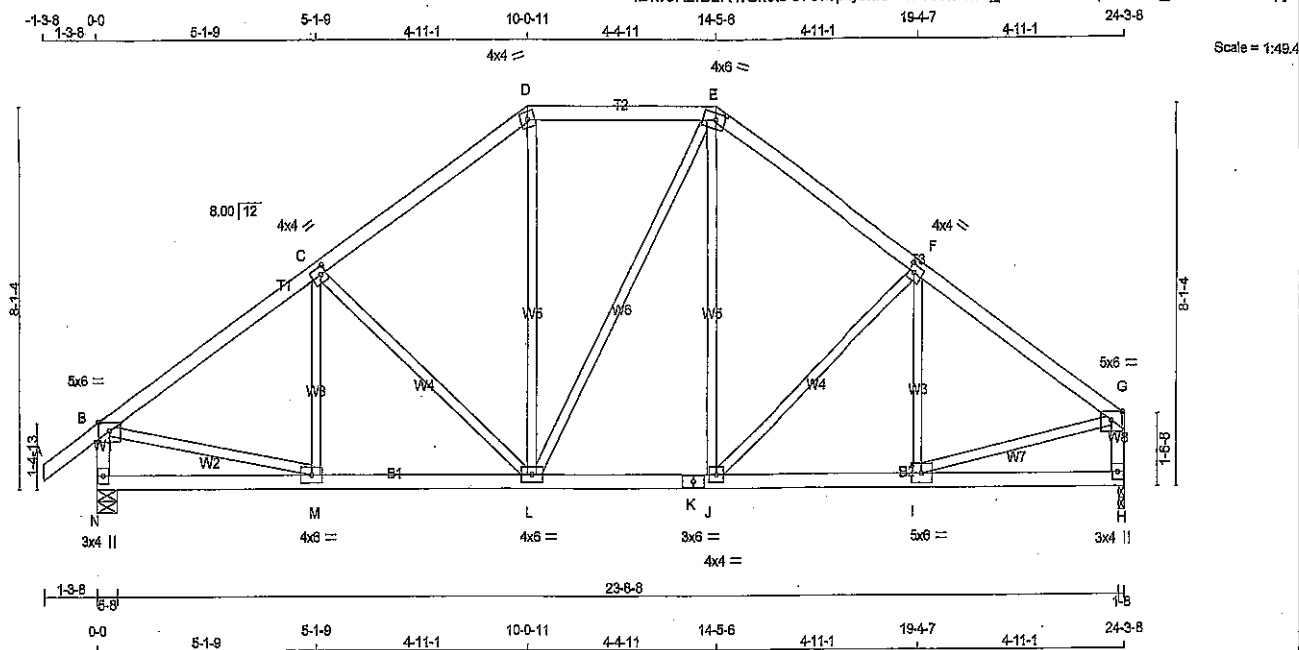

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR. LUMBER DESCR.
 A - D 2x4 DRY No.2 SPF
 D - E 2x4 DRY No.2 SPF
 E - G 2x4 DRY No.2 SPF
 N - B 2x4 DRY No.2 SPF
 H - G 2x4 DRY No.2 SPF
 N - K 2x4 DRY No.2 SPF
 K - H 2x4 DRY No.2 SPF
 ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT
 DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TTWW-m	MT20	4.0	6.0	1.75	2.50
F	TMWW-t	MT20	4.0	4.0	2.00	1.50
G	TMVW-p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	4.0		
I	BMWW-t	MT20	5.0	6.0		
J	BMWW-t	MT20	4.0	4.0		
K	BS-t	MT20	3.0	6.0		
L	BMWW-t	MT20	4.0	6.0		
M	BMWW-t	MT20	4.0	6.0		
N	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
N	1479	0	1479	0	5-8	5-8
H	1363	0	1363	0	1-8	1-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1198	692 / 0	255 / 0	0 / 0	0 / 0	251 / 0	0 / 0
H	1119	621 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORZ. LOAD (LBS)
A-B	0 / 32	-84.3	-84.3 0.11 (1)	10.00	M-C	-115 / 147	0.04 (1)
B-C	-1531 / 0	-84.3	-84.3 0.31 (1)	5.00	C-L	-354 / 0	0.30 (1)
C-D	-1271 / 0	-84.3	-84.3 0.29 (1)	5.39	L-D	0 / 374	0.03 (2)
D-E	-1037 / 0	-84.3	-84.3 0.22 (1)	5.81	L-E	0 / 15	0.03 (1)
E-F	-1262 / 0	-84.3	-84.3 0.28 (1)	5.42	J-E	0 / 360	0.03 (2)
F-G	-1483 / 0	-84.3	-84.3 0.29 (1)	5.08	J-F	-310 / 0	0.28 (1)
N-B	-1420 / 0	0.0	0.0 0.15 (1)	6.84	I-F	-195 / 122	0.05 (1)
H-G	-1307 / 0	0.0	0.0 0.14 (1)	7.06	B-M	0 / 1325	0.30 (1)
					I-G	0 / 1284	0.28 (1)
N-M	0 / 0	-28.0	-28.0 0.18 (3)	10.00			
M-L	0 / 1296	-28.0	-28.0 0.32 (2)	10.00			
L-K	0 / 1030	-28.0	-28.0 0.23 (2)	10.00			
K-J	0 / 1030	-28.0	-28.0 0.23 (2)	10.00			
J-I	0 / 1257	-28.0	-28.0 0.31 (2)	10.00			
I-H	0 / 0	-28.0	-28.0 0.17 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 3.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2012, CBC 2012, ABC 2014
 - CSA 085-09
 - TPIC 2011

(55 % OF 31.3 P.S.F. G.S.I. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
 ALLOWABLE DEFL.(TL) = L/360 (0.81")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.31/1.00 (B-C:1), BC=0.32/1.00 (L-M:2), WB=0.30/1.00 (C-L:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)
 JSI METAL= 0.32 (M) (INPUT = 1.00)

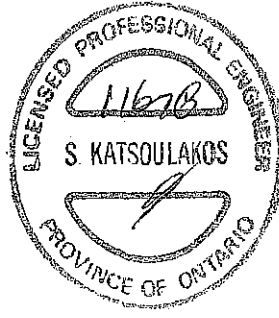


DRWG NO. TAM 3986-18
 STRUCTURAL
 COMPONENT ONLY

JOB NAME 285994	TRUSS NAME T7A	QUANTITY 1	PLY 1	JOB DESC. 43954	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------	----------

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 MTEK Industries, Inc. Tue Jan 16 10:45:49 2018 Page 1
ID:w3K2IB2K4fGk9ID07SkJphyfMC-HQgJem0_136476LeulKBoaM21ymjw5QsozCDZzupjG

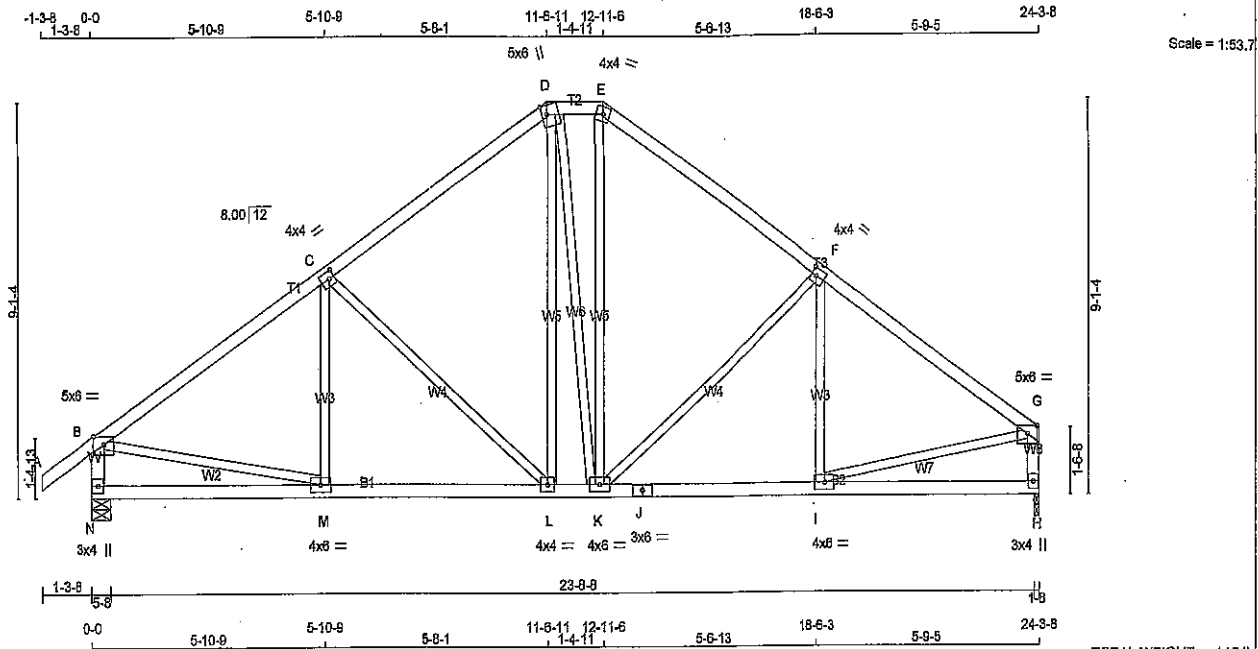

Scale = 1:53.7

TOTAL WEIGHT = 115 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESOR.
A - D	2x4	DRY	No.2 SPF
D - E	2x4	DRY	No.2 SPF
E - G	2x4	DRY	No.2 SPF
N - B	2x4	DRY	No.2 SPF
H - G	2x4	DRY	No.2 SPF
N - J	2x4	DRY	No.2 SPF
J - H	2x4	DRY	No.2 SPF
ALL WEBS EXCEPT	2x3	DRY	No.2 SPF
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMWW-p	MT20	5.0	6.0 Edge
C	TMWW-t	MT20	4.0	4.0 2.00 1.50
D	TTWW+m	MT20	5.0	6.0 2.50 1.50
E	TTW-m	MT20	4.0	4.0
F	TMWW-t	MT20	4.0	4.0 2.00 1.50
G	TMWW-p	MT20	5.0	6.0 Edge
H	BMV1+p	MT20	3.0	4.0
I	BMWW-t	MT20	4.0	6.0
J	BS-t	MT20	3.0	6.0
K	BMWWH-t	MT20	4.0	6.0
L	BMWW-t	MT20	4.0	4.0
M	BMWW-t	MT20	4.0	6.0
N	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
N	1478	0	0	1478	0	0	0	5-8	5-8
H	1363	0	0	1363	0	0	0	1-8	1-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1193	692 / 0	255 / 0	0 / 0	0 / 0	251 / 0	0 / 0
H	1119	621 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	0 / 32	M-C	-50 / 214
B-C	-1533 / 0	C-L	-481 / 0
C-D	-1163 / 0	L-D	0 / 377
D-E	-945 / 0	D-K	0 / 17
E-F	-1184 / 0	K-E	0 / 390
F-G	-1491 / 0	K-F	-433 / 0
N-B	-1413 / 0	I-F	-94 / 185
H-G	-1299 / 0	B-M	0 / 1324
		I-G	0 / 1298
N-M	0 / 0		
M-L	0 / 1302		
L-K	0 / 943		
K-J	0 / 1268		
J-I	0 / 1268		
I-H	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 3.0 PSF
BOT CH.	LL	= 10.5 PSF
	DL	= 7.0 PSF
TOTAL LOAD		= 48.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, CBC 2012, ABC 2014
- CSA 098-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.81")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.06")
ALLOWABLE DEFL.(TL) = $L/360$ (0.81")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.11")

CSI: TC=0.42/1.00 (B-C:1), BC=0.40/1.00 (L-M:2),
WB=0.57/1.00 (C-L:1), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX	MIN	MAX	MIN
MT20	618	354	1887
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.80)
JSI METAL= 0.33 (M) (INPUT = 1.00)

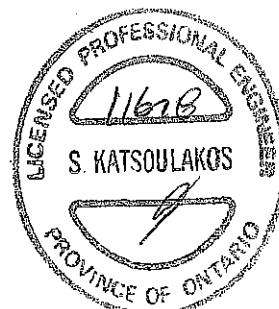

DRWG NO. TAM 3987-12
STRUCTURAL
COMPONENT ONLY

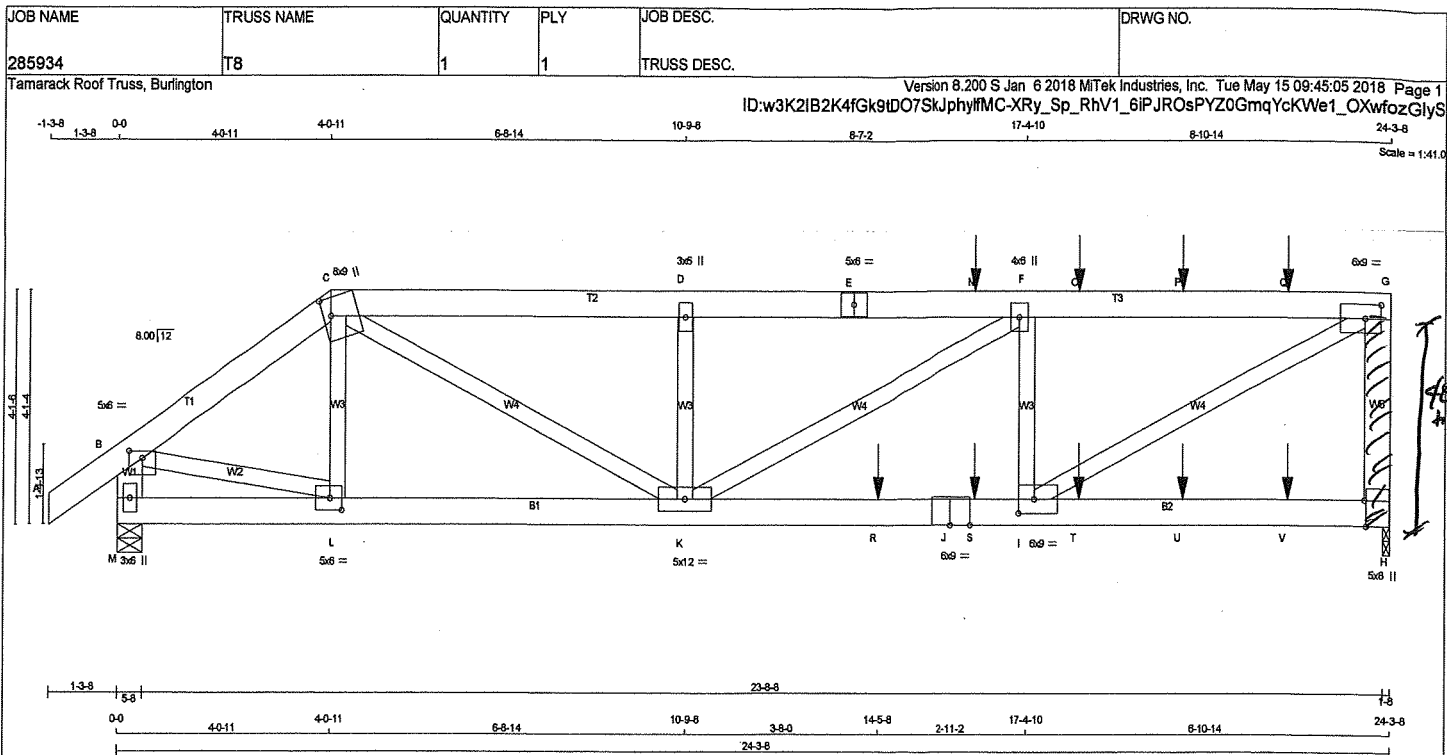

TOTAL WEIGHT = 138 lb

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY No.2	SPF
C - E	2x6	DRY No.2	SPF
E - G	2x6	DRY No.2	SPF
H - G	2x6	DRY No.2	SPF
M - B	2x6	DRY No.2	SPF
M - J	2x6	DRY 2100F 1.8E	SPF
J - H	2x6	DRY 2100F 1.8E	SPF
ALL WEBS EXCEPT	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	1.50	3.00
C	TTVW+m	MT20	8.0	9.0	3.75	1.75
D	TMVW+w	MT20	3.0	6.0		
E	TS-t	MT20	5.0	6.0		
F	TMVW+t	MT20	4.0	6.0		
G	TMVW-t	MT20	6.0	9.0	3.00	3.50
H	BMV1+p	MT20	5.0	8.0	Edge	0.25
I	BMVW-t	MT20	6.0	9.0	3.00	3.50
J	BS-t	MT20	6.0	9.0		
K	BMVW-t	MT20	5.0	12.0		
L	BMVW-t	MT20	5.0	6.0	2.50	2.75
M	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SCAB JOINT # 11 WITH 2 X 4#2 SPF 2" LONG 1 SIDE(S) USING 2 ROW(S) 2 1/2" ARDOX SPIRAL COMMONWIRE NAILS AT 3" O/C STAGGERED (2" NAILS/SCAB), REQUIRED FOR 1 1/2" BRG PROVISION.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT 2719	DOWN 2719	0	0
M VERT 2212	DOWN 2212	0	0

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
H 2211	1262 / 0 480 / 0 0 / 0 0 / 0 488 / 0 0 / 0
M 1781	1046 / 0 367 / 0 0 / 0 0 / 0 368 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 33	-84.3 -84.3	0.07 (1)	10.00	L-C	-437 / 17	0.07 (1)
B-C	-2504 / 0	-84.3 -84.3	0.17 (1)	5.05	B-L	0 / 2124	0.38 (1)
C-D	-4685 / 0	-84.3 -84.3	0.45 (1)	3.64	I-G	0 / 5007	0.89 (1)
D-E	-4685 / 0	-84.3 -84.3	0.55 (1)	3.50	C-K	0 / 2958	0.52 (1)
E-N	-4685 / 0	-84.3 -84.3	0.55 (1)	3.50	I-F	-1063 / 0	0.18 (1)
N-F	-4685 / 0	-84.3 -84.3	0.55 (1)	3.50	K-D	-564 / 0	0.10 (1)
F-O	-4428 / 0	-84.3 -84.3	0.61 (1)	3.50	K-F	0 / 272	0.05 (1)
O-P	-4428 / 0	-84.3 -84.3	0.61 (1)	3.50			
P-Q	-4428 / 0	-84.3 -84.3	0.61 (1)	3.50			
Q-G	-4428 / 0	-84.3 -84.3	0.61 (1)	3.50			
H-G	-2691 / 0	0.0 0.0	0.39 (1)	6.32			
M-B	-2131 / 0	0.0 0.0	0.15 (1)	6.93			

J	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TOTAL
N	18-4-12	-69	-69		BACK	VERT	TOTAL
O	18-4-12	-69	-69		BACK	VERT	TOTAL
P	20-4-12	-69	-69		BACK	VERT	TOTAL
Q	22-4-12	-69	-69		BACK	VERT	TOTAL
R	14-5-8	-1197	-1197		BACK	VERT	TOTAL
S	18-4-12	-50	-50		BACK	VERT	TOTAL
T	18-4-12	-50	-50		BACK	VERT	TOTAL
U	20-4-12	-50	-50		BACK	VERT	TOTAL
V	22-4-12	-50	-50		BACK	VERT	TOTAL

SPECIFIED CONCENTRATED LOADS (LBS)

J	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TOTAL
N	18-4-12	-69	-69		BACK	VERT	TOTAL
O	18-4-12	-69	-69		BACK	VERT	TOTAL
P	20-4-12	-69	-69		BACK	VERT	TOTAL
Q	22-4-12	-69	-69		BACK	VERT	TOTAL
R	14-5-8	-1197	-1197		BACK	VERT	TOTAL
S	18-4-12	-50	-50		BACK	VERT	TOTAL
T	18-4-12	-50	-50		BACK	VERT	TOTAL
U	20-4-12	-50	-50		BACK	VERT	TOTAL
V	22-4-12	-50	-50		BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/968 (0.30")
ALLOWABLE DEFL.(TL)= L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/615 (0.47")

CSI: TC=0.61/1.00 (F-G:1), BC=0.98/1.00 (I-K:1), WB=0.89/1.00 (G-I:1), SS=0.68/1.00 (I-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (L) (INPUT = 0.90)
JSI METAL= 0.91 (J) (INPUT = 1.00)

CONTINUED ON PAGE 2

DWG NO. TAM 21/54-18 R1
STRUCTURAL COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285934	T8	1	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MiTek Industries, Inc. Tue May 15 09:45:05 2018 Page 2
ID:w3K2lB2K4fGk9tD07SkJphyfMC-XRy_Sp_RhV1_6iPJROsPYZ0GmqYcKWe1_OXwfozGlyS

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S)
REQUIRED TO SUPPORT CONCENTRATED
LOAD(S) 101.4 lbs FACTORED DOWN AT
16-4-12, 101.4 lbs FACTORED DOWN AT
18-4-12, AND 101.4 lbs FACTORED DOWN AT
20-4-12, AND 101.4 lbs FACTORED DOWN AT
22-4-12 ON TOP CHORD, AND 1519.0 lbs
FACTORED DOWN AT 14-5-8, 69.9 lbs
FACTORED DOWN AT 16-4-12, 69.9 lbs
FACTORED DOWN AT 18-4-12, AND 69.9 lbs
FACTORED DOWN AT 20-4-12, AND 69.9 lbs
FACTORED DOWN AT 22-4-12 ON BOTTOM
CHORD. DESIGN FOR UNSPECIFIED
CONNECTION(S) IS DELEGATED TO THE
BUILDING DESIGNER.




for

DWG NO. TAM 21154 -18 R1
STRUCTURAL
COMPONENT ONLY

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 Mitek Industries, Inc. Tue Jan 16 10:45:49 2018 Page 1
ID:w3K2lB2K4fGk9tD07SkJphyfMC-HQgJem0_l36475LeulKB0aEv1xgiuWQsozCDZzupjG

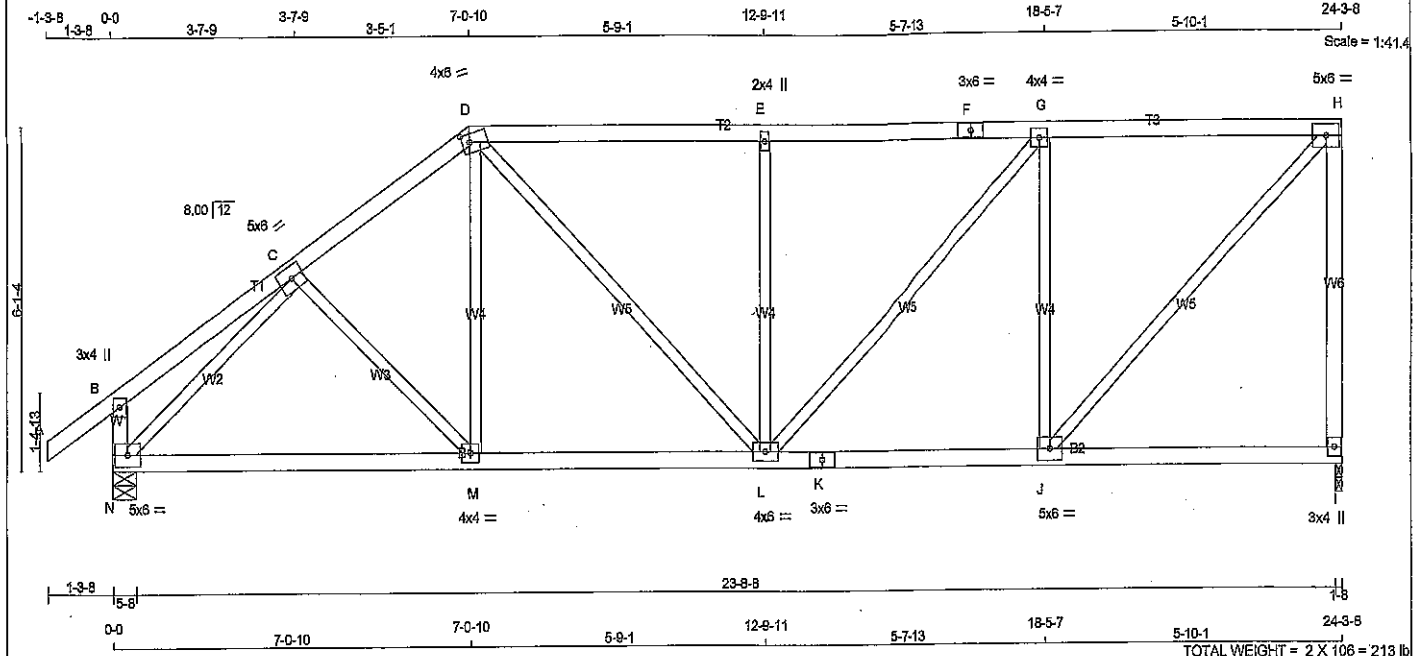

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
I - H	2x4	DRY	No.2
N - B	2x4	DRY	No.2
N - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0		
D	TTWW-m	MT20	4.0	6.0	1.75	1.75
E	TMVW-w	MT20	2.0	4.0		
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	4.0	4.0		
H	TMVW-t	MT20	5.0	6.0		
I	BMV1+p	MT20	3.0	4.0		
J	BMVW-t	MT20	5.0	6.0		
K	BS-t	MT20	3.0	6.0		
L	BMVW-w-t	MT20	4.0	6.0		
M	BMVW-t	MT20	4.0	4.0		
N	BMVW-t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

<u>BEARINGS</u>							
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT	REQRD	
	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG
I	1363	0	1363	0	0	1-8	1-8
N	1479	0	1479	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
I	1119	621 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0
N	1198	892 / 0	255 / 0	0 / 0	0 / 0	251 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, N

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.66 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS						WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	C-M	0 / 118	0.03 (3)	
B-C	0 / 17	-84.3	-84.3	0.15 (1)	10.00	M-D	0 / 307	0.07 (2)	
C-D	-1460 / 0	-84.3	-84.3	0.18 (1)	5.22	N-C	-1889 / 0	0.84 (1)	
D-E	-1473 / 0	-84.3	-84.3	0.43 (1)	4.88	J-H	0 / 1557	0.35 (1)	
E-F	-1473 / 0	-84.3	-84.3	0.44 (1)	4.88	D-L	0 / 385	0.09 (1)	
F-G	-1473 / 0	-84.3	-84.3	0.44 (1)	4.88	J-G	-912 / 0	0.53 (1)	
G-H	-1103 / 0	-84.3	-84.3	0.42 (1)	5.46	L-E	-520 / 0	0.30 (1)	
H-I	-1298 / 0	0.0	0.0	0.94 (1)	7.08	L-G	0 / 530	0.12 (1)	
N-B	-233 / 0	0.0	0.0	0.02 (1)	7.81				
N-M	0 / 1198	-28.0	-28.0	0.45 (2)	10.00				
M-L	0 / 1202	-28.0	-28.0	0.47 (2)	10.00				
L-K	0 / 1103	-28.0	-28.0	0.37 (2)	10.00				
K-J	0 / 1103	-28.0	-28.0	0.37 (2)	10.00				
J-I	0 / 0	-28.0	-28.0	0.24 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.81")
CALCULATED VERT. DEFL.(LL) = L/899 (0.11")
ALLOWABLE DEFL.(TL) = L/380 (0.81")
CALCULATED VERT. DEFL.(TL) = L/899 (0.19")

CSI: TC=0.94/1.00 (H-1), BC=0.47/1.00 (L-M-2),
WB=0.84/1.00 (C-N-1), SSI=0.23/1.00 (G-H-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (D) (INPUT = 0.80)
JSI METAL= 0.41 (C) (INPUT = 1.00)



DRWG NO. TAM 3989-18
STRUCTURAL
COMPONENT ONLY

Tamarrack Roof Truss, Burlington

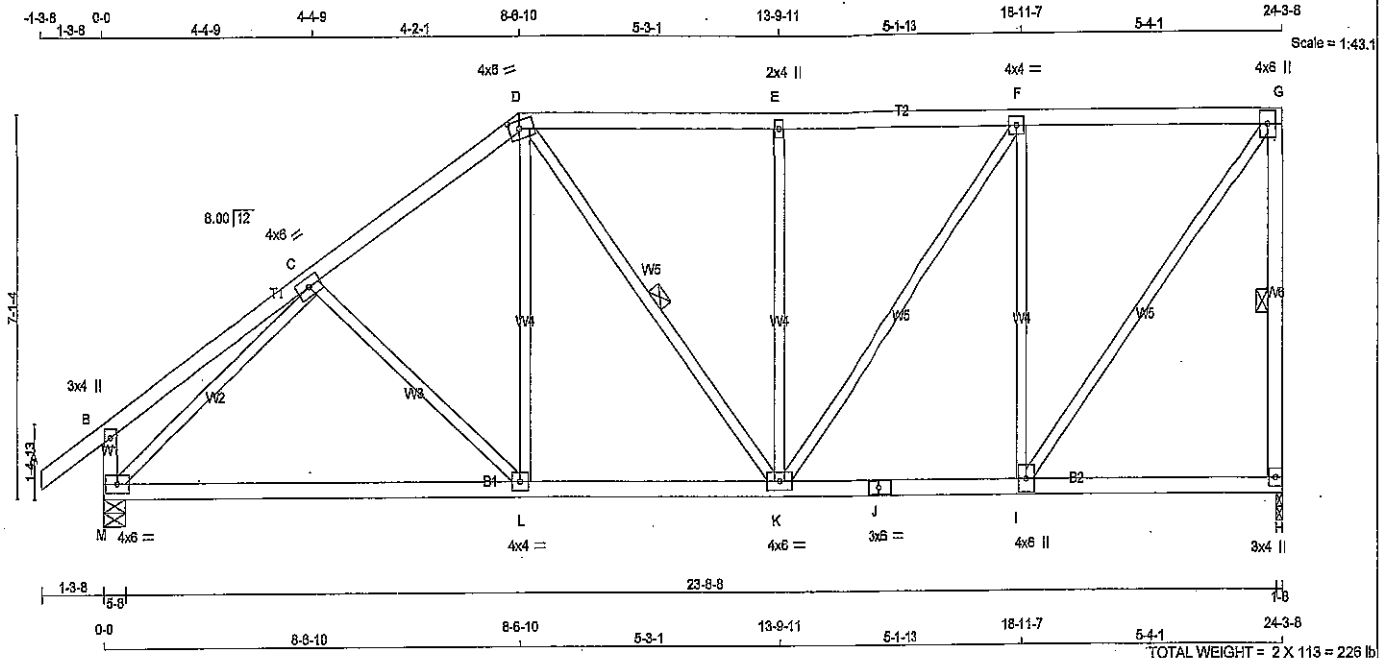

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
M - B	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTWW-m	MT20	4.0	6.0	1.75	2.50
E	TMW+w	MT20	2.0	4.0		
F	TMWW-t	MT20	4.0	4.0		
G	TMWW+p	MT20	4.0	6.0		
H	BMV-t+p	MT20	3.0	4.0		
I	BMWW-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	6.0		
K	BMWW-t	MT20	4.0	6.0		
L	BMWW-t	MT20	4.0	4.0		
M	BMWW-t	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	DOWN	UP	IN-SX
H 1363	0	1363	0
M 1479	0	1479	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H 1119	621 / 0 255 / 0 0 / 0 0 / 0 243 / 0 0 / 0
M 1198	692 / 0 255 / 0 0 / 0 0 / 0 251 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.20 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, D-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 32	-84.3 -84.3	0.11 (1)	C-L	-117 / 85	0.07 (1)	
B-C	0 / 23	-84.3 -84.3	0.24 (1)	L-D	0 / 414	0.09 (2)	
C-D	-1390 / 0	-84.3 -84.3	0.28 (1)	M-C	-1661 / 0	0.93 (1)	
D-E	-1226 / 0	-84.3 -84.3	0.34 (1)	I-G	0 / 1426	0.32 (1)	
E-F	-1227 / 0	-84.3 -84.3	0.35 (1)	D-K	-8 / 141	0.03 (1)	
F-G	-876 / 0	-84.3 -84.3	0.34 (1)	I-F	-946 / 0	0.83 (1)	
H-G	-1805 / 0	0.0 0.0	0.30 (1)	K-E	-474 / 0	0.41 (1)	
M-B	-255 / 0	0.0 0.0	0.03 (1)	K-F	0 / 576	0.13 (1)	
M-L	0 / 1223	-28.0 -28.0	0.59 (2)	10.00			
L-K	0 / 1141	-28.0 -28.0	0.59 (2)	10.00			
K-J	0 / 879	-28.0 -28.0	0.31 (2)	10.00			
J-I	0 / 879	-28.0 -28.0	0.31 (2)	10.00			
I-H	0 / 0	-28.0 -28.0	0.21 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 3.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, CBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.81")
 CALCULATED VERT. DEFL.(LL) = $L/989$ (0.23")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.81")
 CALCULATED VERT. DEFL.(TL) = $L/779$ (0.37")

CS1: TD=0.35/1.00 (E-F:1), BC=0.59/1.00 (K-L:2), WB=0.93/1.00 (C-M:1), SS1=0.21/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 822


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (M) (INPUT = 0.80)
 JSI METAL= 0.40 (C) (INPUT = 1.00)

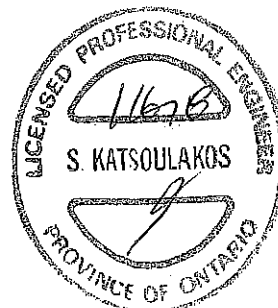

DWG NO. TAM 3990-18
 STRUCTURAL
 COMPONENT ONLY



DRY: SEASONED LUMBER.

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

A circular professional seal for a Licensed Professional Engineer in the Province of Ontario. The outer ring contains the text "LICENSED PROFESSIONAL ENGINEER" at the top and "PROVINCE OF ONTARIO" at the bottom. In the center, the name "S. KATSOULAKOS" is printed. Above the name is a horizontal oval containing the handwritten license number "11626". Below the name is another horizontal oval containing a handwritten signature.


DWG NO. TAM 399.1-12
STRUCTURAL
COMPONENT ONLY

JOB NAME 285800	TRUSS NAME T14	QUANTITY 2	PLY 1	JOB DESC. 43954	TRUSS DESC.	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	---------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MiTek Industries, Inc. Thu Apr 19 13:29:17 2018 Page 1

ID:Uer6HFwTUsfudnkBu50IKHyIEuR-L4mbie3_R9FWMDa57u93KSeI6YXuA8KIkNtTjzP9CG

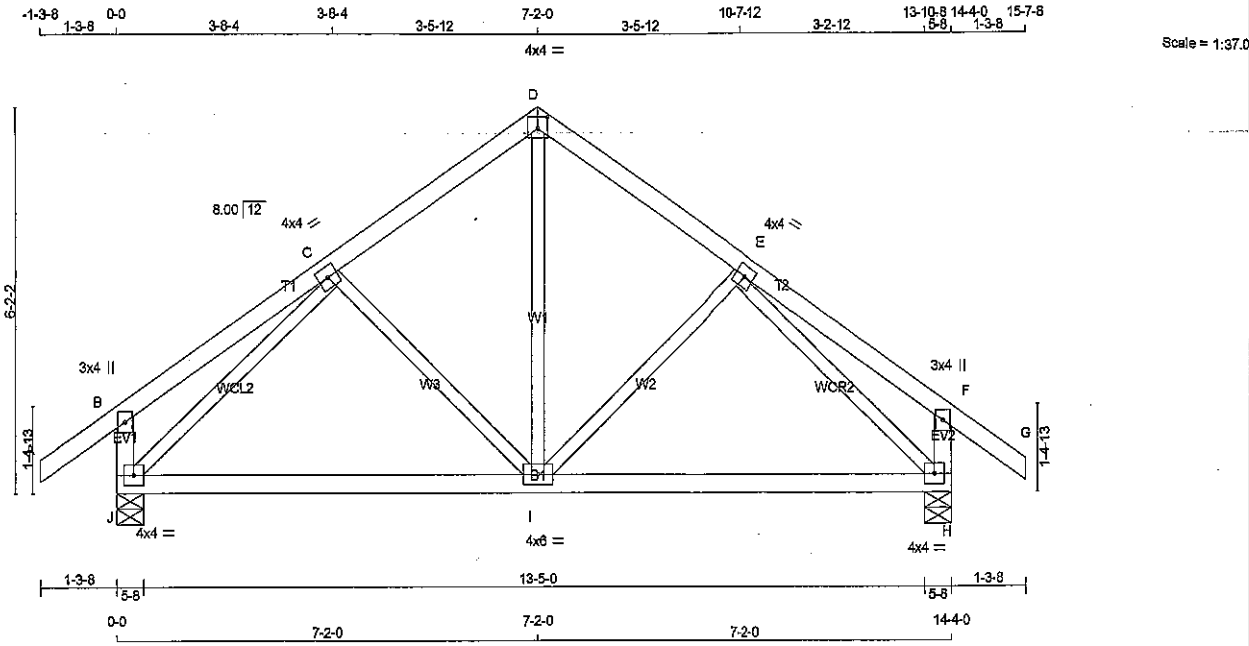

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMVW1-t	MT20	4.0	4.0		
I	BMWW-t	MT20	4.0	6.0		
J	BMVW1-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
J	920	0	920	0
H	920	0	920	0

UNFACTORED REACTIONS							
	1ST LCASE	MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	739	437 / 0	151 / 0	0 / 0	0 / 0	152 / 0	0 / 0
H	739	437 / 0	151 / 0	0 / 0	0 / 0	152 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 32	-84.3 -84.3	0.11 (1)	10.00	I-D	0 / 460	0.10 (1)
B-C	0 / 19	-84.3 -84.3	0.17 (1)	10.00	I-E	-152 / 44	0.06 (1)
C-D	-845 / 0	-84.3 -84.3	0.13 (1)	6.25	C-I	-152 / 44	0.06 (1)
D-E	-845 / 0	-84.3 -84.3	0.13 (1)	6.25	J-C	-879 / 0	0.35 (1)
E-F	0 / 19	-84.3 -84.3	0.17 (1)	10.00	E-H	-879 / 0	0.35 (1)
F-G	0 / 32	-84.3 -84.3	0.11 (1)	10.00			
J-B	-232 / 0	0.0 0.0	0.02 (1)	7.81			
H-F	-232 / 0	0.0 0.0	0.02 (1)	7.81			
J-I	0 / 631	-28.0 -28.0	0.49 (2)	10.00			
I-H	0 / 631	-28.0 -28.0	0.49 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6 PSF
	DL = 3.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.0 PSF
TOTAL LOAD	= 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.48")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.48")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.17/1.00 (E-F:1), BC=0.49/1.00 (H-I:2), WB=0.35/1.00 (E-H:1), SS=0.17/1.00 (H-I:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (D) (INPUT = 0.90)
JSI METAL= 0.31 (C) (INPUT = 1.00)



DRWG NO. TAM 21191-13
STRUCTURAL
COMPONENT ONLY

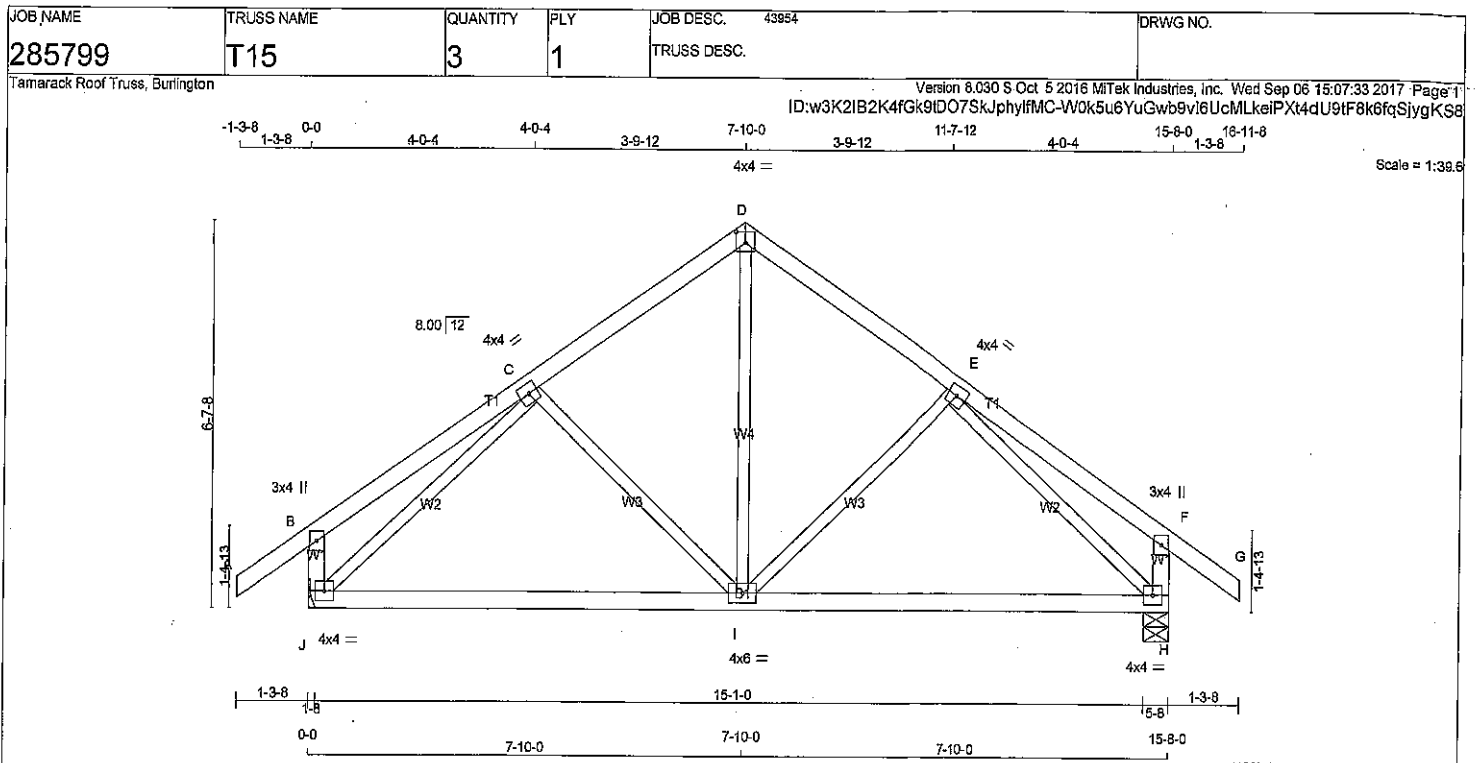

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMWW-t	MT20	4.0	4.0		
F	TMV+p	MT20	3.0	4.0		
H	BMWWH-t	MT20	4.0	4.0		
I	BMWWH-t	MT20	4.0	6.0		
J	BMWWH-t	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
J	HORZ	UPLIFT	HANGER BY OTHERS	
H			MIN. SEAT SIZE: 1-8	

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT	COMBINED
J	SNOW
H	LIVE
	PERM. LIVE
	WIND
	DEAD
	SOIL

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/32	-84.3 -84.3	0.11 (1)	I-D	0/516	0.12 (1)	
B-C	0/21	-84.3 -84.3	0.20 (1)	I-E	-179/43	0.09 (1)	
C-D	-717/0	-84.3 -84.3	0.16 (1)	C-I	-179/43	0.09 (1)	
D-E	-717/0	-84.3 -84.3	0.16 (1)	J-C	-975/0	0.46 (1)	
E-F	0/21	-84.3 -84.3	0.20 (1)	E-H	-975/0	0.46 (1)	
F-G	0/32	-84.3 -84.3	0.11 (1)				
J-B	-243/0	0.0	0.02 (1)				
H-F	-243/0	0.0	0.02 (1)				
J-I	0/709	-28.0 -28.0	0.58 (2)				
I-H	0/709	-28.0 -28.0	0.58 (2)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 3.0 PSF
BOT CH. LL	= 10.5 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 46.1 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.52")

CALCULATED VERT. DEFL.(LL) = $L/999$ (0.11")

ALLOWABLE DEFL.(TL) = $L/360$ (0.52")

CALCULATED VERT. DEFL.(TL) = $L/999$ (0.18")

CSI: TC=0.20 (B-C:1), BC=0.58 (H-I:2), WB=0.48 (C-J:1), SS=0.19 (I-J:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1867 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (D) (INPUT = 0.90)

JSI METAL= 0.35 (C) (INPUT = 1.00)



DWG NO. TAM 50043-17


STRUCTURAL

COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	G15	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Wed Sep 06 15:07:28 2017 - Page 1
ID:w3K2IB2K4fGk9tD07SkJphylfMC-92xCqOUI5OzspXEWpplZxehjY33xUjJPbqx3nWygKSD

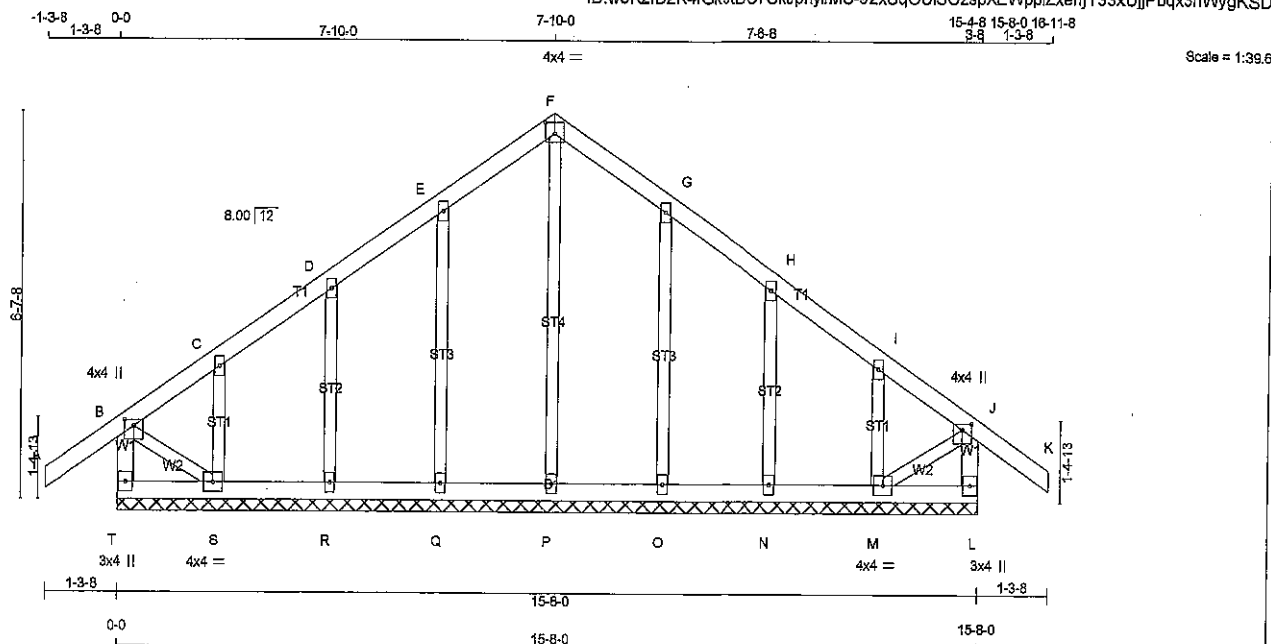

Scale = 1:39.6

LUMBER	N. L. G. A. RULES
CHORDS	SIZE
T - B	2x4 DRY No.2
A - F	2x4 DRY No.2
F - K	2x4 DRY No.2
L - J	2x4 DRY No.2
T - L	2x4 DRY No.2

ALL WEBS	2x3 DRY No.2
ALL GABLE WEBS	2x3 DRY No.2
DRY: SEASONED LUMBER.	

GABLE STUDS SPACED AT 2'-0" OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.25	2.00
C, D, E, G, H, I					
C TMVW+w	MT20	2.0	4.0		
F TTW+p	MT20	4.0	4.0	2.25	2.00
J TMVW+p	MT20	4.0	4.0	1.25	2.00
L BMW1+p	MT20	3.0	4.0		
M BMWW1-I	MT20	4.0	4.0		
N, O, P, Q, R					
N BMW1+w	MT20	2.0	4.0		
S BMWW1-I	MT20	4.0	4.0		
T BMW1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	CS1 (LC)	UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX	CS1 (LC)
FR-TO			FROM	TO				FR-TO				
T-B	-253 / 0	0.0	0.0	0.03 (1)	7.81			P-F	-129 / 0	0.09 (1)		
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00			Q-E	-189 / 0	0.08 (1)		
B-C	-46 / 0	-84.3	-84.3	0.11 (1)	8.25			R-D	-172 / 0	0.04 (1)		
C-D	-15 / 0	-84.3	-84.3	0.04 (1)	6.25			S-C	-108 / 0	0.02 (1)		
D-E	-14 / 0	-84.3	-84.3	0.05 (1)	6.25			O-G	-189 / 0	0.08 (1)		
E-F	-21 / 0	-84.3	-84.3	0.05 (1)	6.25			N-H	-172 / 0	0.04 (1)		
F-G	-21 / 0	-84.3	-84.3	0.05 (1)	6.25			M-I	-108 / 0	0.02 (1)		
G-H	-14 / 0	-84.3	-84.3	0.05 (1)	6.25			B-S	0 / 23	0.01 (1)		
H-I	-15 / 0	-84.3	-84.3	0.04 (1)	6.25			M-J	0 / 23	0.01 (1)		
I-J	-46 / 0	-84.3	-84.3	0.11 (1)	6.25							
J-K	0 / 32	-84.3	-84.3	0.11 (1)	10.00							
L-J	-253 / 0	0.0	0.0	0.03 (1)	7.81							
T-S	0 / 0	-28.0	-28.0	0.03 (2)	10.00							
S-R	0 / 16	-28.0	-28.0	0.03 (2)	10.00							
R-Q	0 / 12	-28.0	-28.0	0.02 (2)	10.00							
Q-P	0 / 9	-28.0	-28.0	0.02 (2)	10.00							
P-O	0 / 9	-28.0	-28.0	0.02 (2)	10.00							
O-N	0 / 12	-28.0	-28.0	0.02 (2)	10.00							
N-M	0 / 16	-28.0	-28.0	0.03 (2)	10.00							
M-L	0 / 0	-28.0	-28.0	0.03 (2)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	3.0	PSF
BOT CH. LL	=	10.5	PSF
DL	=	7.0	PSF
TOTAL LOAD	=	46.1	PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.11 (J-K:1), BC=0.03 (R-S:2), WB=0.09 (F-P:1), SS=0.08 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.80)
JSI METAL= 0.05 (G) (INPUT = 1.00)



DWG NO. TAM5008217
STRUCTURAL
COMPONENT ONLY

JOB NAME 286039	TRUSS NAME T37	QUANTITY 2	PLY 1	JOB DESC. 43994	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington						

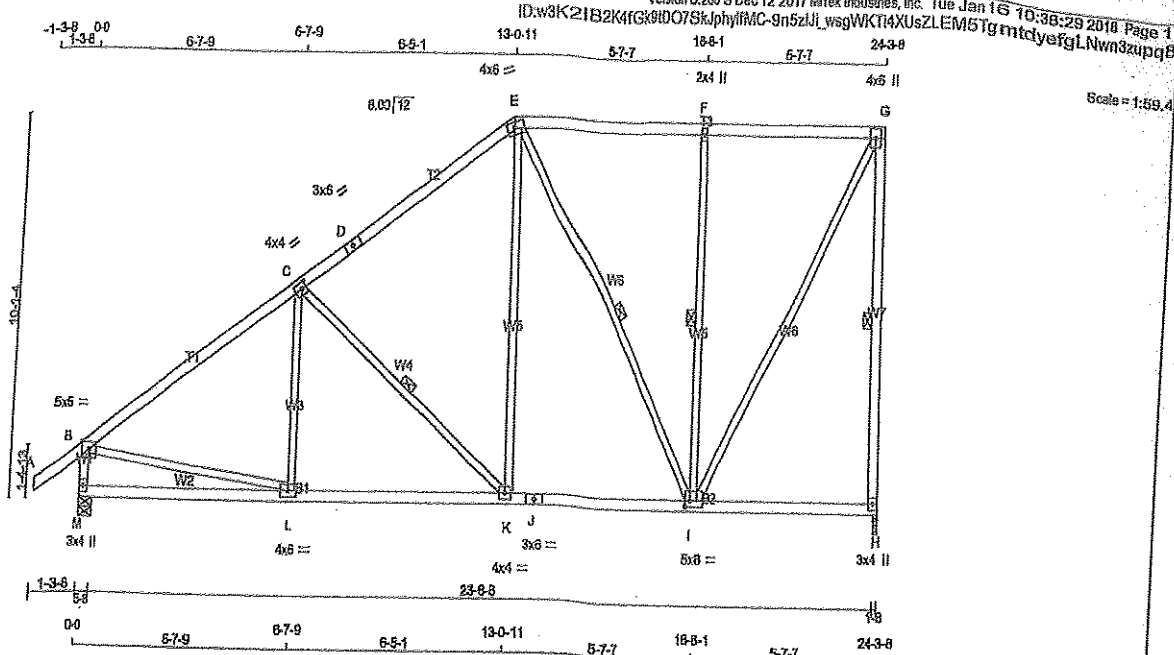

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR
A - D	2x4 DRY	No.2	SPF
D - E	2x4 DRY	No.2	SPF
E - G	2x4 DRY	No.2	SPF
H - G	2x4 DRY	No.2	SPF
M - B	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
J - H	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

CRY: SEASONED LUMBER

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-p	MT20	5.0	6.0	Edge	
C	TMWW-t	MT20	4.0	4.0	2.00	1.50
D	TS-t	MT20	3.0	6.0		
E	TTWW-m	MT20	4.0	0.0	1.75	2.50
F	TMWW-w	MT20	2.0	4.0		
G	TMWW-p	MT20	4.0	0.0		
H	BMV1+p	MT20	3.0	4.0		
I	BMWWV-t	MT20	5.0	6.0	2.00	1.50
J	BS-t	MT20	3.0	6.0		
K	BMWW-t	MT20	4.0	4.0		
L	BMWW-t	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERY	GROSS REACTION	GROSS REACTION	BRG	BRG
H	1353	0	1353	0	1-8
M	1479	0	1479	0	1-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
H	1119	621 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0
M	1198	692 / 0	255 / 0	0 / 0	0 / 0	251 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.69 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, C-K, E-I, F-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX.		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LC1 (LBS)	MAX. (LBS)	UNBRACED LENGTH (LBS)	MEMB.	FORCE (LBS)	MAX. (LBS)	CSI (LC)
FR-TO		FROM	TO			FR-TO			
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	L-C	-1 / 267	0.08 (3)	
B-C	-1522 / 0	-84.3	-84.3	0.55 (1)	4.69	C-K	-594 / 0	0.30 (1)	
C-D	-1051 / 0	-84.3	-84.3	0.49 (1)	5.46	K-E	0 / 145	0.12 (2)	
D-E	-1051 / 0	-84.3	-84.3	0.49 (1)	5.46	E-I	-413 / 0	0.40 (1)	
E-F	-644 / 0	-84.3	-84.3	0.34 (1)	6.25	I-F	-566 / 0	0.41 (1)	
F-G	-644 / 0	-84.3	-84.3	0.34 (1)	6.25	L-G	0 / 1289	0.29 (1)	
H-G	-1289 / 0	0.0	0.0	0.85 (1)	5.66	B-L	0 / 1314	0.30 (1)	
M-B	-1404 / 0	0.0	0.0	0.14 (1)	5.87				
M-L	0 / 0	-28.0	-28.0	0.31 (3)	10.00				
L-K	0 / 1286	-28.0	-28.0	0.46 (2)	10.00				
K-J	0 / 848	-28.0	-28.0	0.31 (2)	10.00				
J-I	0 / 848	-28.0	-28.0	0.31 (2)	10.00				
I-H	0 / 0	-28.0	-28.0	0.21 (3)	10.00				

TOTAL WEIGHT = 2 X 122 = 243 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 240 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.81")
CALCULATED VERT. DEFL.(LL) = 1/899 (0.08")
ALLOWABLE DEFL.(TL) = 1/360 (0.81")
CALCULATED VERT. DEFL.(TL) = 1/899 (0.14")

CSI: TC=0.85/1.00 (G-H:1), BC=0.46/1.00 (K-L:2), WB=0.41/1.00 (F-I:1), SS=0.23/1.00 (F-G:1)

COL LUMBER=1.00 NAIL=1.00 LG BEAD=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 854 1687 822 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

SSI GRIP = 0.83 (L) (INPUT = 0.90)
SSI METAL = 0.32 (L) (INPUT = 1.00)

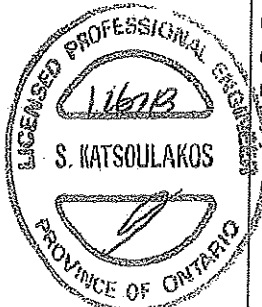

DWG NO. TAW 3894
STRUCTURAL


JOB NAME: 285956 TRUSS NAME: T40 QUANTITY: 1 PLY: 1 JOB DESC.: TRUSS DESC. DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.206 5 Dec 12 2017 Mitek Industries, Inc. Thu Jan 25 08:19:26 2018 Page 1

ID: w3K2IB2K4fGk9DO7SkJphylfMC-4B5sUzFup8yvMnC71iLAK_9gHr2QLIFZ2370sCzru0V

Scale = 1:42.0

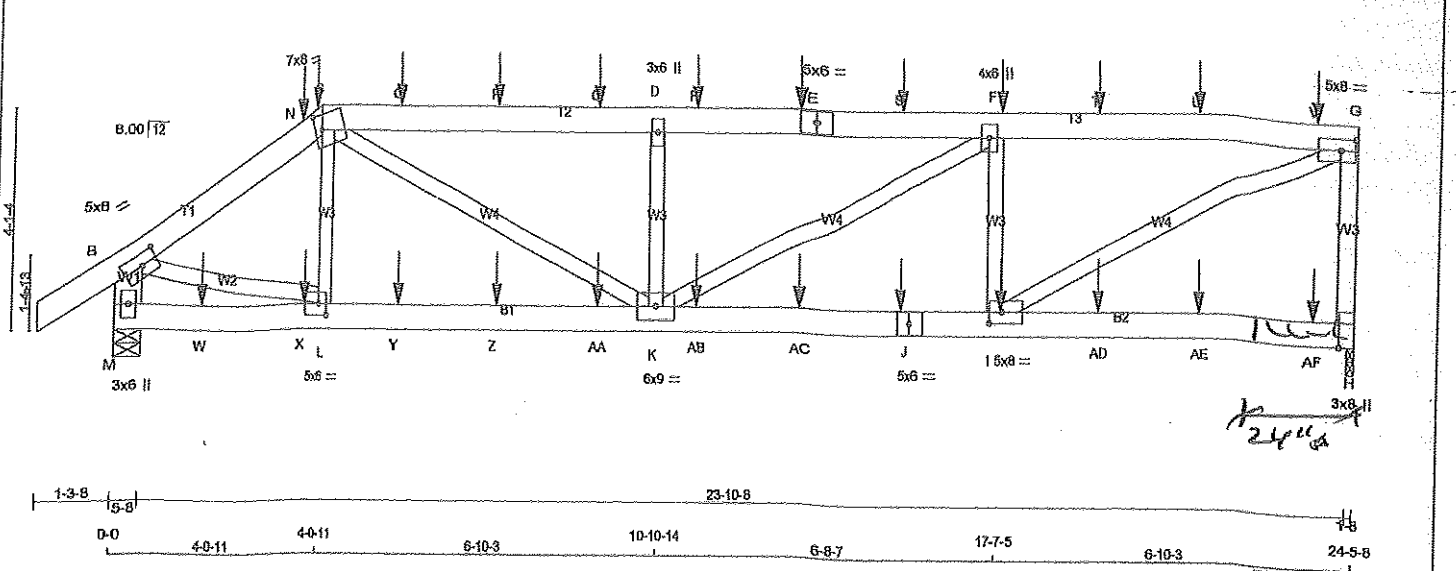

TOTAL WEIGHT = 137 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6	DRY	No.2 SPF
C - E	2x6	DRY	No.2 SPF
E - G	2x6	DRY	No.2 SPF
H - G	2x4	DRY	No.2 SPF
M - B	2x6	DRY	No.2 SPF
M - J	2x6	DRY	No.2 SPF
J - H	2x6	DRY	No.2 SPF
ALL WEBS EXCEPT	2x4	DRY	No.2 SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
VERT	DOWN	IN-SX	IN-SX
JT 2309	2309	1-8	5-8
M 2439	2439	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H 1907	1040 / 0 447 / 0 0 / 0 0 / 0 420 / 0 0 / 0
M 1982	1134 / 0 429 / 0 0 / 0 0 / 0 420 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 3.0 PSF

BOT CH. LL = 10.5 PSF

DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 240 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014

- CSA 088-09

- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.02")

CALCULATED VERT. DEFL.(LL) = 1/999 (0.15")

ALLOWABLE DEFL.(TL) = 1/360 (0.02")

CALCULATED VERT. DEFL.(TL) = 1/999 (0.24")

CSI: TC=0.58/1.00 (C-D:1), EC=0.57/1.00 (H-K:2), WB=0.66/1.00 (G-I:1), SS=0.35/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (C) (INPUT = 0.90)

JSI METAL= 0.62 (G) (INPUT = 1.00)

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	5.0	8.0	2.50 3.75
C	TMVW-m	MT20	7.0	8.0	3.25 2.00
D	TMVW-w	MT20	3.0	6.0	
E	TS-1	MT20	5.0	6.0	
F	TMVW-t	MT20	4.0	6.0	
G	TMVW-1	MT20	5.0	8.0	2.50 3.00
H	BMV1+p	MT20	3.0	8.0	Edge 0.50
I	BMVW-1	MT20	5.0	8.0	2.50 3.00
J	BS-1	MT20	5.0	6.0	
K	BMVW-w-1	MT20	0.0	0.0	
L	BMVW-1	MT20	5.0	6.0	2.50 2.25
M	BMV1+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 244.5 lbs FACTORED DOWN AT 4-0-11, 129.8 lbs FACTORED DOWN AT 3-6-12, 101.4 lbs FACTORED DOWN AT 5-8-12, 101.4 lbs FACTORED DOWN AT 7-8-12, 101.4 lbs FACTORED DOWN AT 9-8-12, 101.4 lbs FACTORED DOWN AT 11-8-12, 101.4 lbs FACTORED DOWN AT 13-8-12, 101.4 lbs FACTORED DOWN AT 15-8-12, 101.4 lbs FACTORED DOWN AT 17-8-12, 101.4 lbs FACTORED DOWN AT 19-8-12, AND 101.4 lbs FACTORED DOWN AT 21-8-12, AND 112.8 lbs FACTORED DOWN AT 23-8-12 ON TOP CHORD, AND 69.9 lbs FACTORED DOWN AT 1-8-12, 69.9 lbs FACTORED DOWN AT 3-8-12, 69.9 lbs FACTORED DOWN AT 5-8-12, 69.9 lbs FACTORED DOWN AT 7-8-12, 69.9 lbs FACTORED DOWN AT 9-8-12, 69.9 lbs FACTORED DOWN AT 11-8-12, 69.9 lbs FACTORED DOWN AT 13-8-12, 69.9 lbs FACTORED DOWN AT 15-8-12, 69.9 lbs FACTORED DOWN AT 17-8-12, 69.9 lbs FACTORED DOWN AT 19-8-12, AND 69.9 lbs FACTORED DOWN AT 21-8-12, AND 76.6 lbs FACTORED DOWN AT 23-8-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.72 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	FACTORED	WEBS	FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. UNBRACED LENGTH FR-TO
FR-TO			
A-B	0/33	-84.3 -84.3 0.07 (1)	10.00
B-N	-2810 / 0	-84.3 -84.3 0.19 (1)	4.80
N-C	-2810 / 0	-84.3 -84.3 0.19 (1)	4.80
C-O	-4019 / 0	-84.3 -84.3 0.56 (1)	3.72
O-P	-4018 / 0	-84.3 -84.3 0.56 (1)	3.72
P-Q	-4018 / 0	-84.3 -84.3 0.56 (1)	3.72
Q-D	-4018 / 0	-84.3 -84.3 0.56 (1)	3.72
D-R	-4018 / 0	-84.3 -84.3 0.56 (1)	3.72
R-E	-4018 / 0	-84.3 -84.3 0.56 (1)	3.72
E-S	-4018 / 0	-84.3 -84.3 0.56 (1)	3.72
S-F	-4018 / 0	-84.3 -84.3 0.56 (1)	3.72
F-T	-3301 / 0	-84.3 -84.3 0.53 (1)	4.08
T-U	-3301 / 0	-84.3 -84.3 0.53 (1)	4.08
U-V	-3301 / 0	-84.3 -84.3 0.53 (1)	4.08
V-G	-3301 / 0	-84.3 -84.3 0.53 (1)	4.08
H-G	-2160 / 0	0.0 0.0 0.50 (1)	5.72
M-B	-2388 / 0	0.0 0.0 0.17 (1)	6.62
M-W	0 / 0	-28.0 -28.0 0.19 (2)	10.00
W-X	0 / 0	-28.0 -28.0 0.19 (2)	10.00
X-L	0 / 0	-28.0 -28.0 0.19 (2)	10.00
L-Y	0 / 2349	-28.0 -28.0 0.42 (1)	10.00
Y-Z	0 / 2349	-28.0 -28.0 0.42 (1)	10.00
Z-AA	0 / 2349	-28.0 -28.0 0.42 (1)	10.00
AA-K	0 / 2349	-28.0 -28.0 0.42 (1)	10.00
K-AB	0 / 3301	-28.0 -28.0 0.57 (2)	10.00
AB-AC	0 / 3301	-28.0 -28.0 0.57 (2)	10.00
AC-J	0 / 3301	-28.0 -28.0 0.57 (2)	10.00
J-I	0 / 3301	-28.0 -28.0 0.57 (2)	10.00
I-AD	0 / 0	-28.0 -28.0 0.28 (3)	10.00
AD-AE	0 / 0	-28.0 -28.0 0.26 (3)	10.00
AE-AF	0 / 0	-28.0 -28.0 0.26 (3)	10.00
AF-H	0 / 0	-28.0 -28.0 0.26 (3)	10.00

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE
C	4-0-11	-23	-25	FRONT	VERT	DEAD
C	4-0-11	-222	-222	FRONT	VERT	SNOW
E	13-8-12	-101	-101	BACK	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 3.0 PSF

BOT CH. LL = 10.5 PSF

DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 240 IN. C/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014

- CSA 088-09

- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.02")

CALCULATED VERT. DEFL.(LL) = 1/999 (0.15")

ALLOWABLE DEFL.(TL) = 1/360 (0.02")

CALCULATED VERT. DEFL.(TL) = 1/999 (0.24")

CSI: TC=0.58/1.00 (C-D:1), EC=0.57/1.00 (H-K:2), WB=0.66/1.00 (G-I:1), SS=0.35/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN


MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (C) (INPUT = 0.90)

JSI METAL= 0.62 (G) (INPUT = 1.00)

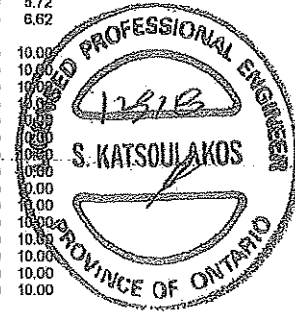


DRWG NO. T40

STRUCTURAL COMPONENT ONLY


CONTINUED ON PAGE 2

FACTORED CONCENTRATED LOADS (LBS)						
JT	LCC	LC1	MAX	MAX*	FACE	DIR.
F	17-8-12	-101	-101	---	BACK	VERT
I	17-8-12	-40	-70	---	BACK	VERT
J	15-8-12	-40	-70	---	BACK	VERT
N	3-8-12	-130	-130	---	BACK	VERT
O	5-8-12	-101	-101	---	BACK	VERT
P	7-8-12	-101	-101	---	BACK	VERT
Q	9-8-12	-101	-101	---	BACK	VERT
R	11-8-12	-101	-101	---	BACK	VERT
S	15-8-12	-101	-101	---	BACK	VERT
T	19-8-12	-101	-101	---	BACK	VERT
U	21-8-12	-101	-101	---	BACK	VERT
V	23-8-12	-113	-113	---	BACK	VERT
W	1-8-12	-40	-70	---	BACK	VERT
X	3-8-12	-40	-70	---	BACK	VERT
Y	5-8-12	-40	-70	---	BACK	VERT
Z	7-8-12	-40	-70	---	BACK	VERT
AA	9-8-12	-40	-70	---	BACK	VERT
AB	11-8-12	-40	-70	---	BACK	VERT
AC	13-8-12	-40	-70	---	BACK	VERT
AD	19-8-12	-40	-70	---	BACK	VERT
AE	21-8-12	-40	-70	---	BACK	VERT
AF	23-8-12	-44	-77	---	BACK	VERT

SCAB JOINT # 4 WITH 2 X 6 #2
SPF 24" LONG 1 SIDE(S) USING 2
ROW(S) 3/4" COMMON WIRE NAILS
AT 2 " O/C STAGGERED (18 NAILS/SCAB)
REQUIRED FOR 1 1/2 " BRG PROVISION.

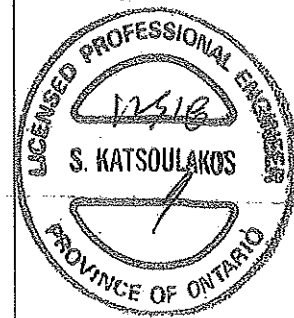

DWG NO. TAM 5982-18
STRUCTURAL
COMPONENT ONLY

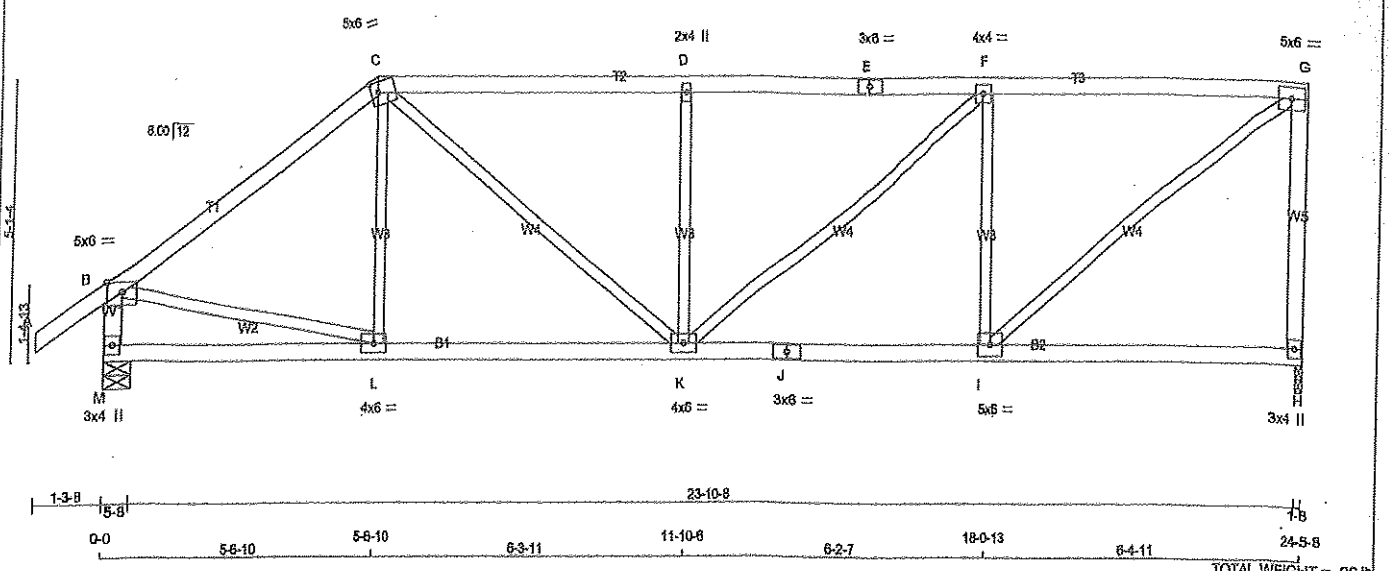

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge
C	TTWW-m	MT20	5.0	6.0	2.25 1.75
D	TMVW-w	MT20	2.0	4.0	
E	TS-t	MT20	3.0	8.0	
F	TMVW-t	MT20	4.0	4.0	
G	TMVW-t	MT20	5.0	6.0	
H	BMV1+p	MT20	3.0	4.0	
I	BMVW-t	MT20	5.0	6.0	
J	BS-t	MT20	3.0	6.0	
K	BMVWV-t	MT20	4.0	8.0	
L	BMVW-t	MT20	4.0	6.0	
M	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	HORZ	UPLIFT
H	1373	0	1373	0
M	1488	0	1488	0

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERALIVE	WIND	DEAD	SOIL
JT	COMBINED					
H	1127	626 / 0	257 / 0	0 / 0	245 / 0	0 / 0
M	1206	699 / 0	257 / 0	0 / 0	253 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.30 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED L.C1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (FT)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 32	-84.3	-84.3 0.11 (1)	10.00	L-C	-50 / 204	0.05 (3)
B-C	-1607 / 0	-84.3	-84.3 0.55 (1)	4.88	B-L	0 / 1275	0.29 (1)
C-D	-1822 / 0	-84.3	-84.3 0.58 (1)	4.33	I-G	0 / 1799	0.40 (1)
D-E	-1822 / 0	-84.3	-84.3 0.58 (1)	4.30	C-K	0 / 717	0.16 (1)
E-F	-1822 / 0	-84.3	-84.3 0.58 (1)	4.30	I-F	-882 / 0	0.34 (1)
F-G	-1437 / 0	-84.3	-84.3 0.54 (1)	4.77	K-D	-571 / 0	0.22 (1)
H-G	-1360 / 0	0.0	0.0 0.57 (1)	7.08	K-F	0 / 487	0.11 (1)
M-B	-1427 / 0	0.0	0.0 0.15 (1)	6.84			
M-L	0 / 0	-28.0	-28.0 0.24 (3)	10.00			
L-K	0 / 1251	-28.0	-28.0 0.39 (2)	10.00			
K-J	0 / 1437	-28.0	-28.0 0.44 (2)	10.00			
J-I	0 / 1437	-28.0	-28.0 0.44 (2)	10.00			
I-H	0 / 0	-28.0	-28.0 0.28 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.82")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.82")
CALCULATED VERT. DEFL. (TL) = L/999 (0.15")

CSI: TC=0.58/1.00 (D-F:1), BC=0.44/1.00 (I-K:2), WB=0.40/1.00 (G-I:1), SS=0.25/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1687	822	2284	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (K) (INPUT = 0.90)
JSI METAL = 0.44 (J) (INPUT = 1.00)




DWG NO. T4M3363.18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285815	T42A	1	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 Mitak Industries, Inc. Tue Jan 23 08:29:10 2018 Page 1

ID: w3K2IB2K4fGk9ID078k9p9yIMC-V767L5wKYLRTgaPGguX6U5SX?nrt312etCO8zeY3

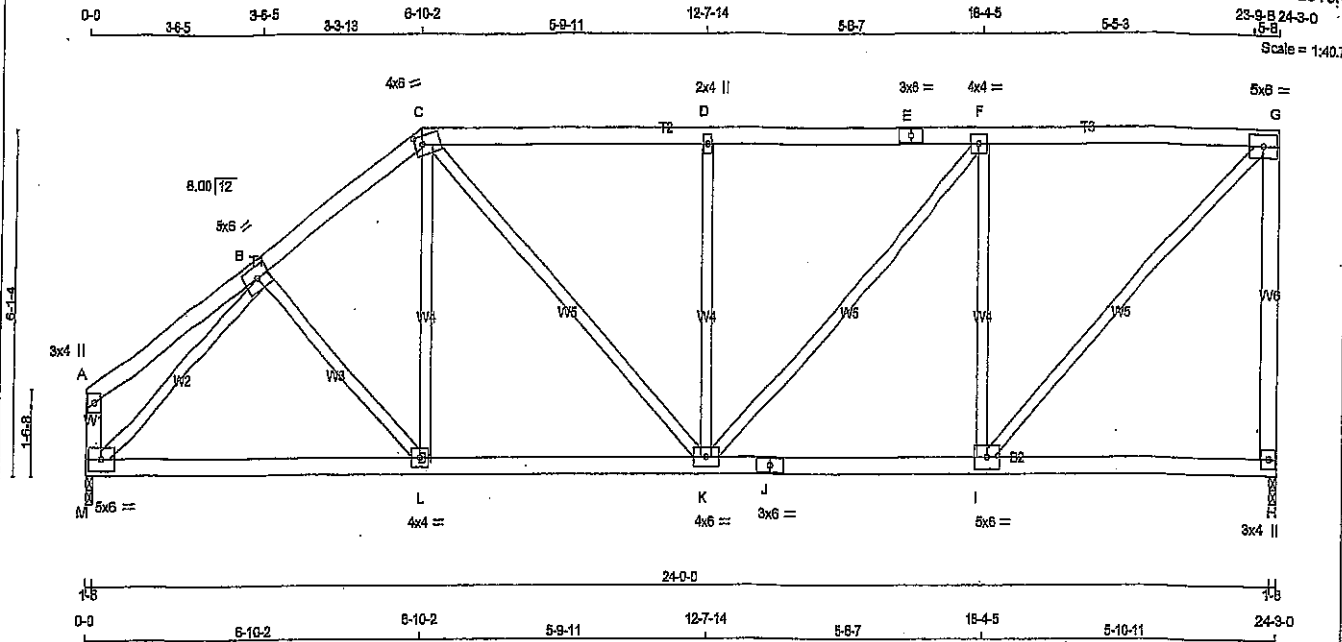

TOTAL WEIGHT = 105 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
H - G	2x4	DRY	No.2	SPF	
M - A	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
J - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY, SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	BRG	BRG
		HORZ				IN-SX	IN-SX
H	1861	0	1361	0	0	1-8	1-8
M	1361	0	1361	0	0	1-8	1-8

UNFACTORED REACTIONS							
1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	1118	620 / 0	255 / 0	0 / 0	0 / 0	242 / 0	0 / 0
M	1118	620 / 0	255 / 0	0 / 0	0 / 0	242 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 17	-84.3	-84.3 0.14 (1)	10.00	B-L	0 / 134	0.03 (3)
B-C	-1430 / 0	-84.3	-84.3 0.17 (1)	5.26	L-C	0 / 279	0.05 (2)
C-D	-1471 / 0	-84.3	-84.3 0.44 (1)	4.88	M-B	-1633 / 0	0.62 (1)
D-E	-1471 / 0	-84.3	-84.3 0.45 (1)	4.85	I-G	0 / 1558	0.35 (1)
E-F	-1471 / 0	-84.3	-84.3 0.45 (1)	4.85	C-K	0 / 1415	0.09 (1)
F-G	-1109 / 0	-84.3	-84.3 0.43 (1)	5.43	I-F	-908 / 0	0.33 (1)
H-G	-1295 / 0	0.0	0.0 0.93 (1)	7.10	K-D	-525 / 0	0.31 (1)
M-A	-114 / 0	0.0	0.0 0.01 (1)	7.81	K-F	0 / 517	0.12 (1)
M-L	0 / 1141	-28.0	-28.0 0.43 (2)	10.00			
L-K	0 / 1177	-28.0	-28.0 0.45 (2)	10.00			
K-J	0 / 1109	-28.0	-28.0 0.37 (2)	10.00			
J-I	0 / 1109	-28.0	-28.0 0.37 (2)	10.00			
I-H	0 / 0	-28.0	-28.0 0.24 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	46.1	PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
- CSA C89-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.61")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.10")
ALLOWABLE DEFL.(TL) = $L/360$ (0.61")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.17")

CSI: TC=0.93/1.00 (G-H:1), SC=0.45/1.00 (K-L:2),
WB=0.62/1.00 (B-M:1), SSI=0.23/1.00 (F-G:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 822	2284 1655


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (C) (INPUT = 0.80)
JSI METAL= 0.40 (B) (INPUT = 1.00)



DRWG NO. TAM 5073 -18
STRUCTURAL
COMPONENT ONLY

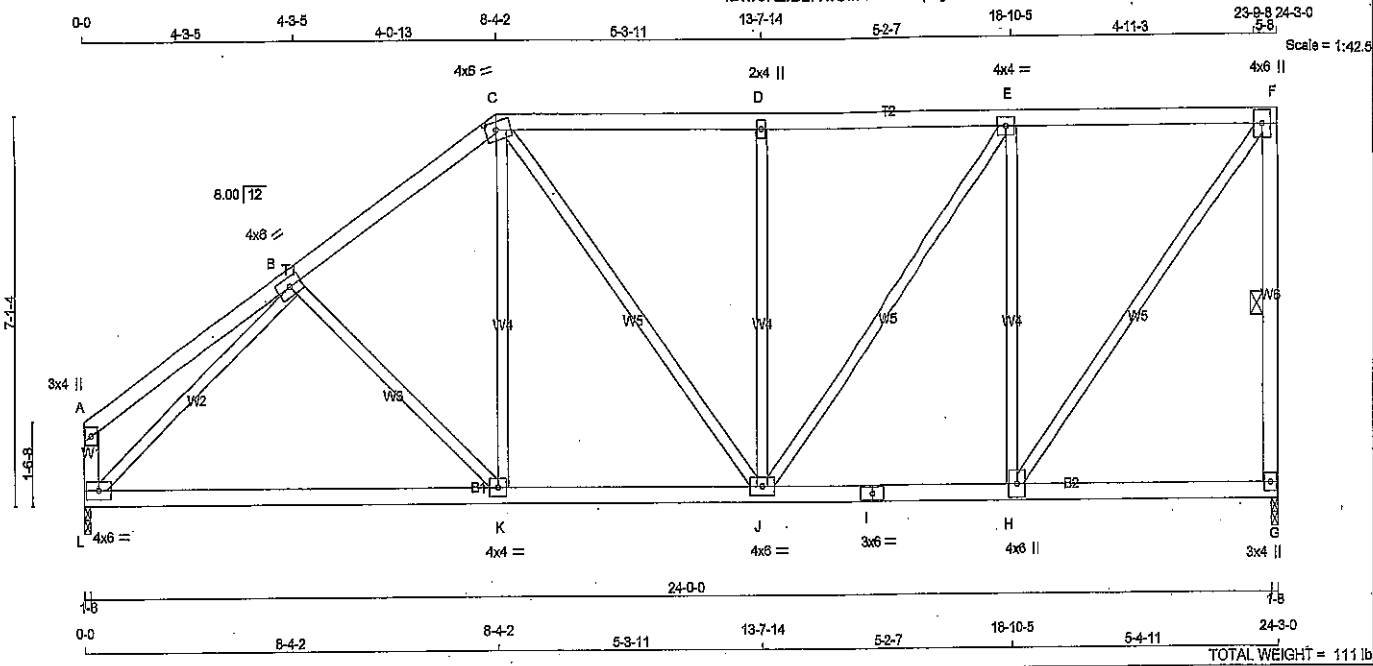

LUMBER				
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	
CHORDS				
A - C	2x4	DRY	No.2	SPF
C - F	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
L - A	2x4	DRY	No.2	SPF
L - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	4.0	
B	TMWW-t	MT20	4.0	6.0	
C	TTWW-m	MT20	4.0	6.0	1.75 2.50
D	TMWW-w	MT20	2.0	4.0	
E	TMWW-t	MT20	4.0	4.0	
F	TMWW+p	MT20	4.0	6.0	
G	BMV1+p	MT20	3.0	4.0	
H	BMWW-t	MT20	4.0	6.0	
I	BS-t	MT20	3.0	5.0	
J	BMWWW-t	MT20	4.0	6.0	
K	BMWW-t	MT20	4.0	4.0	
L	BMVVW-t	MT20	4.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED			MAXIMUM FACTORED			INPUT	REQD
GROSS REACTION			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
G	1361	0	1361	0	0	1-8	1-8
L	1361	0	1361	0	0	1-8	1-8

UNFACTORED REACTIONS						
1ST LCASE	MAX	MIN	COMPONENT	REACTIONS		
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND
G	1118	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0
L	1118	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1 MAX	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD	LC1 MAX
	FORCE (LBS)	(PLF)		CSI (LC)		FORCE (LBS)	(PLF)		CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		FROM TO		LENGTH
A-B	0 / 22	-84.3 -84.3	0.23 (1)	10.00	B-K	-77 / 99	0.05 (1)		
B-C	-1369 / 0	-84.3 -84.3	0.27 (1)	5.25	K-C	0 / 387	0.09 (2)		
C-D	-1227 / 0	-84.3 -84.3	0.35 (1)	5.36	L-B	-1629 / 0	0.80 (1)		
D-E	-1227 / 0	-84.3 -84.3	0.36 (1)	5.33	H-F	0 / 1425	0.32 (1)		
E-F	-884 / 0	-84.3 -84.3	0.34 (1)	6.05	C-J	0 / 168	0.04 (1)		
G-F	-1302 / 0	0.0 0.0	0.30 (1)	5.66	H-E	-940 / 0	0.82 (1)		
L-A	-135 / 0	0.0 0.0	0.01 (1)	7.81	J-D	-479 / 0	0.42 (1)		
					J-E	0 / 565	0.13 (1)		
L-K	0 / 1176	-28.0 -28.0	0.56 (2)	10.00					
K-J	0 / 1124	-28.0 -28.0	0.57 (2)	10.00					
J-I	0 / 884	-28.0 -28.0	0.32 (2)	10.00					
I-H	0 / 884	-28.0 -28.0	0.32 (2)	10.00					
H-G	0 / 0	-28.0 -28.0	0.21 (3)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. O.C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 085-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.61")
CALCULATED VERT. DEFL.(LL) = L/999 (0.21")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/853 (0.34")

CSI: TC=0.36/1.00 (D-E:1), BC=0.57/1.00 (J-K:2), WB=0.90/1.00 (B-L:1), SS=0.21/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 918 354 1667 622 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (B) (INPUT = 0.90)
JSI METAL= 0.40 (B) (INPUT = 1.00)

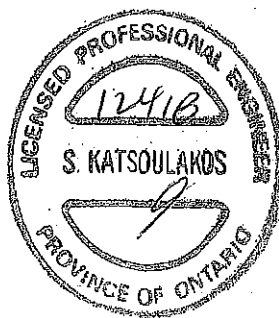

DRWG NO. TAM 5074 -B
STRUCTURAL
COMPONENT ONLY

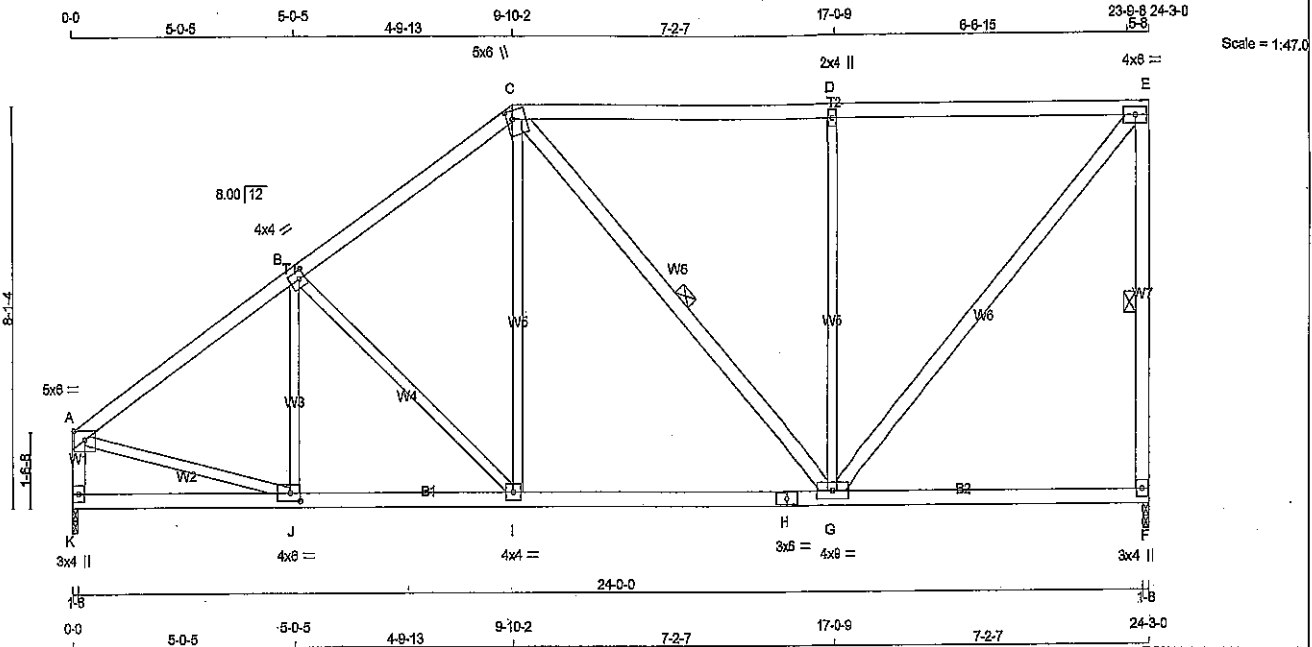

Scale = 1:47.0

TOTAL WEIGHT = 116 lb

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
K - A	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

ALL WEBS EXCEPT				
	SIZE	LUMBER	DESCR.	
C - G	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMWV-p	MT20	5.0	6.0	Edge	
B	TMWV-t	MT20	4.0	4.0	2.00	1.50
C	TTWV+H	MT20	5.0	6.0	2.00	1.50
D	TMWV-w	MT20	2.0	4.0		
E	TMWV-t	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMWVW-t	MT20	4.0	9.0		
H	BS-t	MT20	3.0	6.0		
I	BMWV-t	MT20	4.0	4.0		
J	BMWV-t	MT20	4.0	6.0	2.00	2.75
K	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
JT				
F	1361	0	1361	0
K	1361	0	1361	0

UNFACTORED REACTIONS

	1ST LCASE	MAX / MIN COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	1116	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0
K	1116	620 / 0	255 / 0	0 / 0	0 / 0	243 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.74 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, C-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	-1477 / 0	-84.3	-84.3	0.40 (1)	J-B	-158 / 110	0.08 (1)
B-C	-1264 / 0	-84.3	-84.3	0.38 (1)	B-I	-307 / 0	0.26 (1)
C-D	-873 / 0	-84.3	-84.3	0.63 (1)	I-C	0 / 419	0.09 (2)
D-E	-873 / 0	-84.3	-84.3	0.83 (1)	C-G	-87 / 0	0.05 (1)
F-E	-1261 / 0	0.0	0.0	0.38 (1)	G-D	-754 / 0	0.95 (1)
K-A	-1301 / 0	0.0	0.0	0.14 (1)	G-E	0 / 1431	0.23 (1)
					A-J	0 / 1288	0.29 (1)
K-J	0 / 0	-28.0	-28.0	0.15 (3)			
J-I	0 / 1252	-28.0	-28.0	0.33 (2)			
I-H	0 / 1032	-28.0	-28.0	0.50 (2)			
H-G	0 / 1032	-28.0	-28.0	0.50 (2)			
G-F	0 / 0	-28.0	-28.0	0.38 (3)			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
DL = 3.0	PSF	
BOT CH.	LL = 10.5	PSF
DL = 7.0	PSF	
TOTAL LOAD = 46.1	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.81")
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")
ALLOWABLE DEFL.(TL) = L/360 (0.81")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.83/1.00 (D-E:1), BC=0.50/1.00 (G-I:2), WB=0.65/1.00 (D-G:1), SS=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2294 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (E) (INPUT = 0.90)
JSI METAL= 0.41 (H) (INPUT = 1.00)




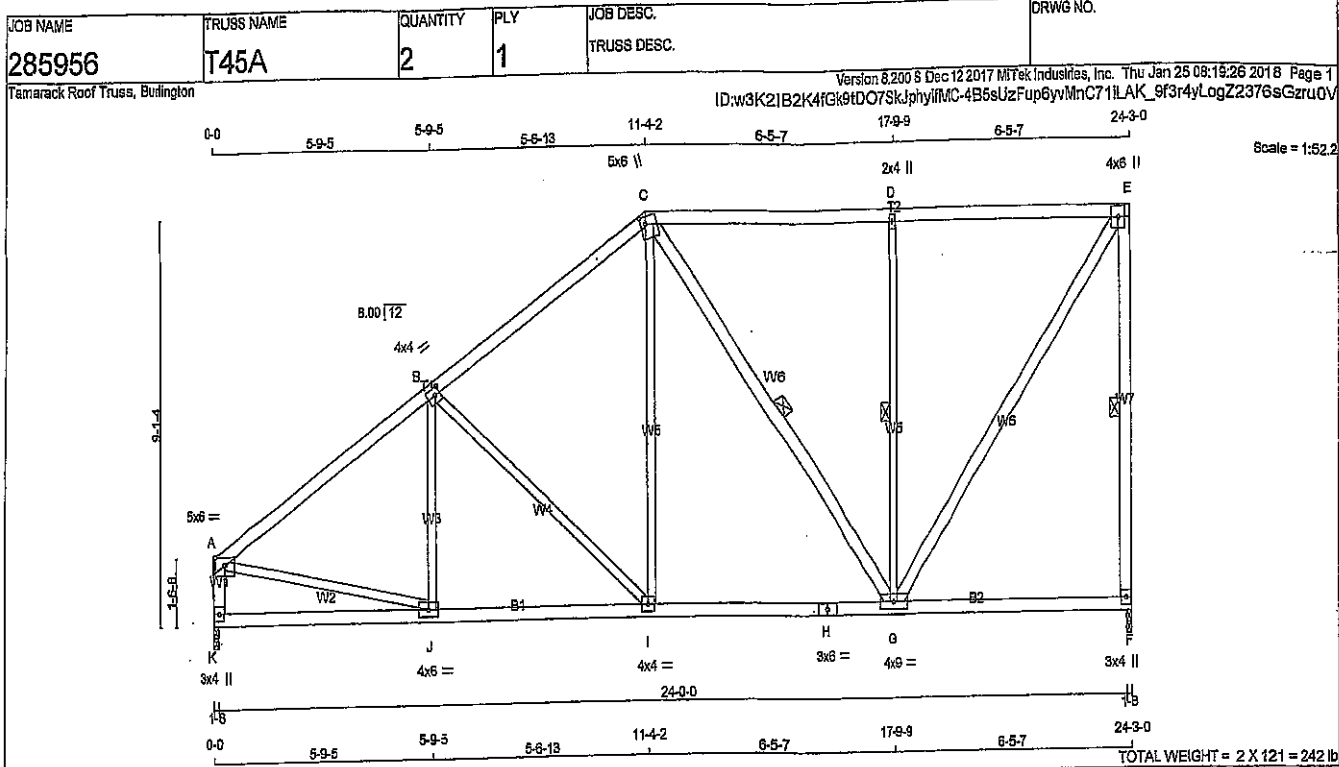

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER						DESIGN CRITERIA	
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	SPF	BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQRD	SPECIFIED LOADS:
A - C	2x4	DRY	No.2	SPF		GROSS REACTION	DOWN	GROSS REACTION	BRG	BRG	TOP CH. LL = 25.6 PSF
C - E	2x4	DRY	No.2	SPF		VERT	0	DOWN	IN-SX	IN-SX	DL = 3.0 PSF
F - E	2x4	DRY	No.2	SPF		VERT	1361	DOWN	0	0	BOT CH. LL = 10.5 PSF
K - A	2x4	DRY	No.2	SPF		VERT	1361	DOWN	0	0	DL = 7.0 PSF
K - H	2x4	DRY	No.2	SPF		VERT	1361	DOWN	0	0	TOTAL LOAD = 46.1 PSF
H - F	2x4	DRY	No.2	SPF		VERT	1361	DOWN	0	0	SPACING = 24.0 IN./C
ALL WEBS	2x3	DRY	No.2	SPF		UNFACTORED REACTIONS	1ST CASE	MAX./MIN. COMPONENT REACTIONS			LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
EXCEPT											THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010
C - G	2x4	DRY	No.2	SPF							THIS DESIGN COMPLIES WITH:
G - E	2x4	DRY	No.2	SPF							- PART 9 OF CBC 2012, BCBC 2012, ABC 2014
											- CSA 088-09
											- TPIC 2011
											(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD
											ALLOWABLE DEFL.(LL) = 1/380 (0.81")
											CALCULATED VERT. DEFL.(LL) = 1/989 (0.07")
											ALLOWABLE DEFL.(TL) = 1/380 (0.81")
											CALCULATED VERT. DEFL.(TL) = 1/999 (0.12")
											CSI: TC=0.63/1.00 (D-E:1), BC=0.41/1.00 (G-I:2),
											WB=0.51/1.00 (B-I:1), SS=0.26/1.00 (D-E:1)
											DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10
											COMP=1.10 SHEAR=1.10 TENS=1.10
											COMPANION LIVE LOAD FACTOR = 0.50
											TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
											NAIL VALUES
											PLATE GRIP(DRY) SHEAR SECTION
											(PSI) (PLI) (PLI)
											MAX MIN MAX MIN MAX MIN
											M20 616 354 1667 822 2284 1656
											PLATE PLACEMENT TOL. = 0.250 inches
											PLATE ROTATION TOL. = 5.0 Deg.
											JSI GRIP= 0.89 (G) (INPUT = 0.90)
											JSI METAL= 0.32 (J) (INPUT = 1.00)

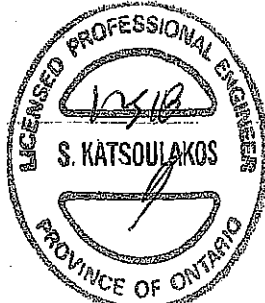

DRWG NO. TAM 5984-B
STRUCTURAL
COMPONENT ONLY

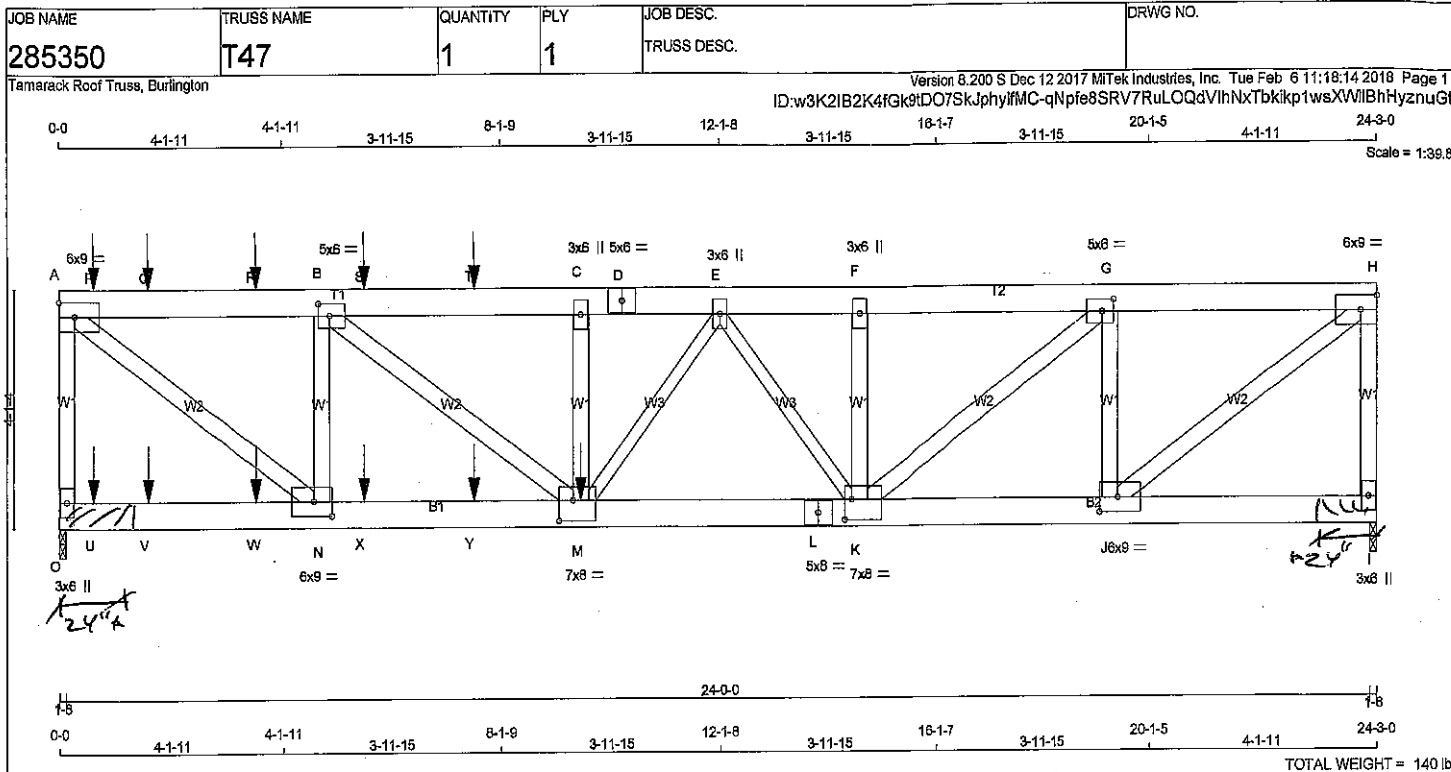

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
O - A	2x4	DRY No.2	SPF
A - D	2x6	DRY No.2	SPF
D - H	2x6	DRY No.2	SPF
I - H	2x4	DRY No.2	SPF
O - L	2x6	DRY No.2	SPF
L - I	2x6	DRY No.2	SPF

ALL WEBS 2x4 DRY No.2 SPF EXCEPT

M - E	2x3	DRY No.2	SPF
E - K	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (Table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	6.0	9.0		Edge
B	TMVW-t	MT20	5.0	6.0	2.50	2.50
C	TMVW-t	MT20	3.0	6.0		
D	TS-t	MT20	5.0	6.0		
E	TMVW-t	MT20	3.0	6.0		
F	TMVW-t	MT20	3.0	6.0		
G	TMVW-t	MT20	5.0	6.0	2.50	2.50
H	TMVW-t	MT20	6.0	9.0		Edge
I	BMV1+p	MT20	3.0	6.0		
J	BMVW-t	MT20	6.0	9.0	3.00	4.00
K	BMVW-t	MT20	7.0	8.0	4.25	1.50
L	BS-t	MT20	5.0	6.0		
M	BMVW-t	MT20	7.0	8.0	4.25	3.00
N	BMVW-t	MT20	6.0	9.0	3.00	4.00
O	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 116.3 lbs FACTORED DOWN AT 7-12, 101.4 lbs FACTORED DOWN AT 1-7-12, 101.4 lbs FACTORED DOWN AT 3-7-12, AND 101.4 lbs FACTORED DOWN AT 5-7-12, AND 101.4 lbs FACTORED DOWN AT 7-7-12 ON TOP CHORD, AND 78.6 lbs FACTORED DOWN AT 7-12, 69.9 lbs FACTORED DOWN AT 1-7-12, 69.9 lbs FACTORED DOWN AT 3-7-12, AND 69.9 lbs FACTORED DOWN AT 5-7-12, AND 69.9 lbs FACTORED DOWN AT 7-7-12, AND 162.8 lbs FACTORED DOWN AT 9-7-0 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

SCAB JOINT #0 & #I WITH 2X6 #2 SPF 24" LONG 1 SIDE(S) USING 2 ROWS(3) ARDOX SPIRAL COMMON WIRE NAILS AT 3" O/C STAGGERED (5 NAILS/SCAB) REQUIRED FOR 1 1/2" BRG PROVISION.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION VERT	FACTORED GROSS REACTION HORZ	MAXIMUM FACTORED GROSS REACTION VERT	MAXIMUM FACTORED GROSS REACTION HORZ	INPUT BRG UPLIFT IN-SX	REQD BRG IN-SX
O	2980	0	2980	0	1-8	1-8
I	2117	0	2117	0	1-8	1-8

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX MIN. COMPONENT REACTIONS SNOW	MAX MIN. COMPONENT REACTIONS LIVE	MAX MIN. COMPONENT REACTIONS PERM. LIVE	MAX MIN. COMPONENT REACTIONS WIND	MAX MIN. COMPONENT REACTIONS DEAD	MAX MIN. COMPONENT REACTIONS SOIL
O	2427	1352 / 0	550 / 0	0 / 0	0 / 0	525 / 0	0 / 0
I	1731	973 / 0	387 / 0	0 / 0	0 / 0	372 / 0	0 / 0

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM		FR-TO			
O-A	-2832 / 0	0.0	0.0 0.65 (1)	5.05	A-N	0 / 4167	0.74 (1)
A-P	-3335 / 0	-84.3	-84.3 0.32 (1)	4.34	N-B	-2221 / 0	0.38 (1)
P-Q	-3335 / 0	-84.3	-84.3 0.32 (1)	4.34	B-M	0 / 2341	0.41 (1)
Q-R	-3335 / 0	-84.3	-84.3 0.32 (1)	4.34	M-C	-315 / 0	0.05 (1)
R-S	-3335 / 0	-84.3	-84.3 0.32 (1)	4.34	K-F	-298 / 0	0.05 (1)
S-T	-5187 / 0	-84.3	-84.3 0.43 (1)	3.47	K-G	0 / 2089	0.37 (1)
T-U	-5187 / 0	-84.3	-84.3 0.43 (1)	3.47	J-G	-1741 / 0	0.30 (1)
U-V	-5187 / 0	-84.3	-84.3 0.43 (1)	3.47	J-H	0 / 3140	0.58 (1)
V-W	-5187 / 0	-84.3	-84.3 0.43 (1)	3.47	M-E	0 / 775	0.19 (1)
W-X	-5187 / 0	-84.3	-84.3 0.43 (1)	3.47	E-K	-1013 / 0	0.33 (1)
X-Y	-4165 / 0	-84.3	-84.3 0.15 (1)	4.13			
Y-Z	-4165 / 0	-84.3	-84.3 0.25 (1)	4.04			
Z-I	-2512 / 0	-84.3	-84.3 0.17 (1)	5.05			
I-H	-2053 / 0	0.0	0.0 0.47 (1)	5.85			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
O	9-7-0	-1628	-1628		BACK	VERT	TOTAL
A	7-12	-116	-116		BACK	VERT	TOTAL
P	1-7-12	-101	-101		BACK	VERT	TOTAL
Q	3-7-12	-101	-101		BACK	VERT	TOTAL
R	5-7-12	-101	-101		BACK	VERT	TOTAL
S	7-7-12	-101	-101		BACK	VERT	TOTAL
T	7-12	-45	-79		BACK	VERT	TOTAL
U	1-7-12	-40	-70		BACK	VERT	TOTAL
V	3-7-12	-40	-70		BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. G/G

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.81")
CALCULATED VERT. DEFL. (LL) = L/999 (0.17")
ALLOWABLE DEFL. (TL) = L/360 (0.81")
CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CSI: TC=0.65/1.00 (A-O:1), BC=0.71/1.00 (K-M:1), WB=0.74/1.00 (A-N:1), SS=0.28/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 822 2284 1858

PLATE PLACEMENT TOL = 0.250 inches
PLATE ROTATION TOL = 5.0 Deg.

GRIP=0.90 (M) (INPUT = 0.90)
METAL=0.78 (L) (INPUT = 1.00)

DWG NO. TAM 0091-8
STRUCTURAL COMPONENT ONLY

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285350	T47	1	1	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 MiTek Industries, Inc. Tue Feb 6 11:18:14 2018 Page 2

ID:w3K2IB2K4fGk9tDO7SkJphylfMC-qNpfe8SRV7RuLOQdVlhNxTbk1wsXWlBhHyznuG8

FACTORED CONCENTRATED LOADS (LBS)						
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.
X	5-7-12	-40	-70	—	BACK	VERT
Y	7-7-12	-40	-70	—	BACK	VERT
						TOTAL




DWG NO. TAM 8091-18
STRUCTURAL
COMPONENT ONLY

JOB NAME 285814	TRUSS NAME T48A	QUANTITY 6	PLY 1	JOB DESC. 43954 TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	-----------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.200 S Dec 12 2017 MiTek Industries, Inc. Tue Jan 16 10:36:35 2018 Page 1

ID:w3K2IB2K4fGk9tD07SkJphyIMC-VrCtNKJUmRhhy_ArYpqkBdkYjsVwQ_tTcmumgzuprw

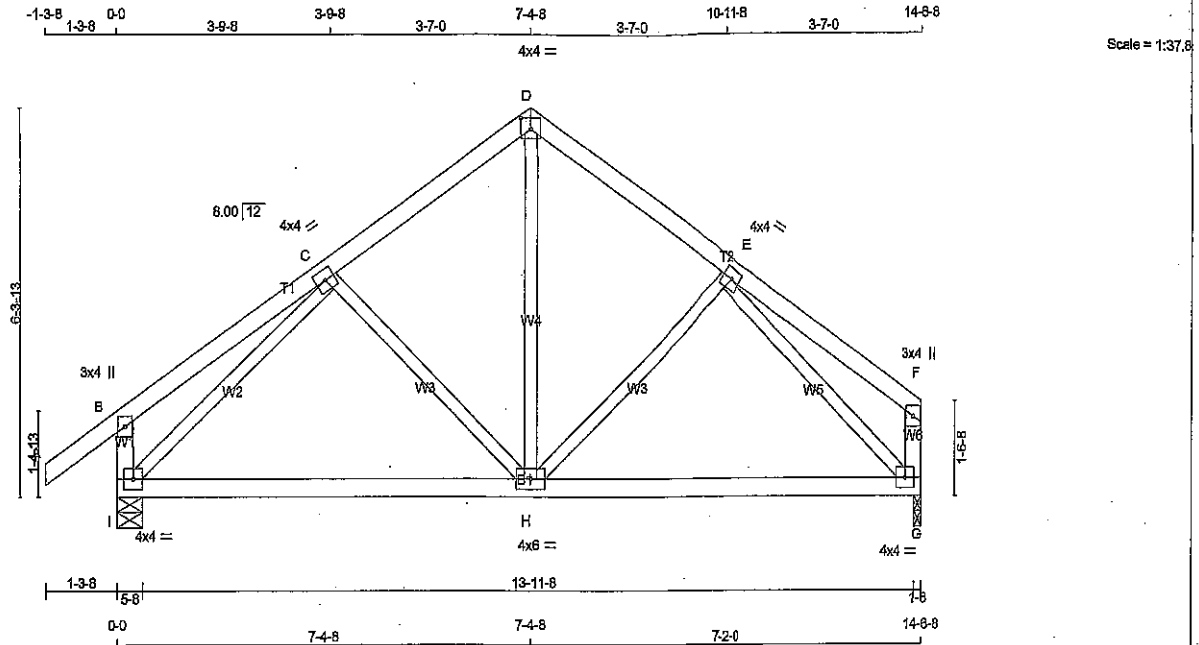

TOTAL WEIGHT = 6 X 61 = 366 lb

LUMBER

N. L. G. A. RULES

CHORDS

SIZE

LUMBER

DESCR.

SPF

A - D

2x4

DRY

No.2

SPF

D - F

2x4

DRY

No.2

SPF

I - B

2x4

DRY

No.2

SPF

G - F

2x4

DRY

No.2

SPF

I - G

2x4

DRY

No.2

SPF

ALL WEBS

2x3

DRY

No.2

SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT

TYPE

PLATES

W

LEN

Y

X

B

TMV+p

MT20

3.0

4.0

C

TMWW+1

MT20

4.0

4.0

D

TTW+p

MT20

4.0

4.0

2.25

2.00

E

TMWW+1

MT20

4.0

4.0

F

TMV+p

MT20

3.0

4.0

G

BMVW+1

MT20

4.0

4.0

H

BMVWW+1

MT20

4.0

6.0

I

BMVW+1

MT20

4.0

4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED

MAXIMUM FACTORED

INPUT

REQD

GROSS REACTION

GROSS REACTION

BRG

BRG

JT

VERT

HORZ

DOWN

HORZ

UPLIFT

IN-SX

IN-SX

I

932

0

832

0

0

5-8

5-8

G

816

0

816

0

0

1-8

1-8

UNFACTORED REACTIONS

1ST LCASE

MAX./MIN. COMPONENT REACTIONS

JT

COMBINED

SNOW

LIVE

PERM.LIVE

WIND

DEAD

SOIL

I

749

442 / 0

153 / 0

0 / 0

0 / 0

154 / 0

0 / 0

G

670

372 / 0

153 / 0

0 / 0

0 / 0

145 / 0

0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS

MEMB.

MAX. FACTORED FORCE (LBS)

FACTORED VERT. LOAD (PLF)

LC1

MAX

MAX.

MEMB.

MAX. FACTORED FORCE (LBS)

CS1 (LC)

UNBRAC LENGTH

FR-TO

A-B

0 / 32

-84.3

-84.3

0.11 (1)

10.00

H-D

0 / 455

0.10 (1)

B-C

0 / 20

-84.3

-84.3

0.18 (1)

10.00

H-E

-130 / 53

0.06 (1)

C-D

-649 / 0

-84.3

-84.3

0.14 (1)

6.25

C-H

-164 / 42

0.07 (1)

D-E

-648 / 0

-84.3

-84.3

0.13 (1)

6.25

I-C

-891 / 0

0.37 (1)

E-F

0 / 20

-84.3

-84.3

0.17 (1)

10.00

E-G

-882 / 0

0.34 (1)

I-B

-235 / 0

0.0

0.0

0.02 (1)

7.81

G-F

-111 / 0

0.0

0.0

0.01 (1)

7.81

I-H

0 / 843

-28.0

-28.0

0.50 (2)

10.00

H-G

0 / 618

-28.0

-28.0

0.50 (2)

10.00

WEBS

MEMB.

MAX. FACTORED FORCE (LBS)

CS1 (LC)

H-D

0 / 455

0.10 (1)

H-E

-130 / 53

0.06 (1)

C-H

-164 / 42

0.07 (1)

I-C

-891 / 0

0.37 (1)

E-G

-882 / 0

0.34 (1)

CS1: TC=0.18/1.00 (B-C:1), BC=0.50/1.00 (H-I:2), WB=0.37/1.00 (C-I:1), SSI=0.17/1.00 (H-I:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1867 822 2284 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (E) (INPUT = 0.80)

JSI METAL= 0.32 (C) (INPUT = 1.00)

LICENSED PROFESSIONAL ENGINEER

17628

S. KATSOUKAKOS

PROVINCE OF ONTARIO

DWG NO. TAM3983-13

STRUCTURAL


COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T71X	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed Sep 08 15:07:37 2017 Page:1

ID:PFhc1Ba2cOYemTQTAYm6Oyi1EX-On_bjTbPK96aOvQFrCPgoYZAmi?g5Zikfd1bUygKS4

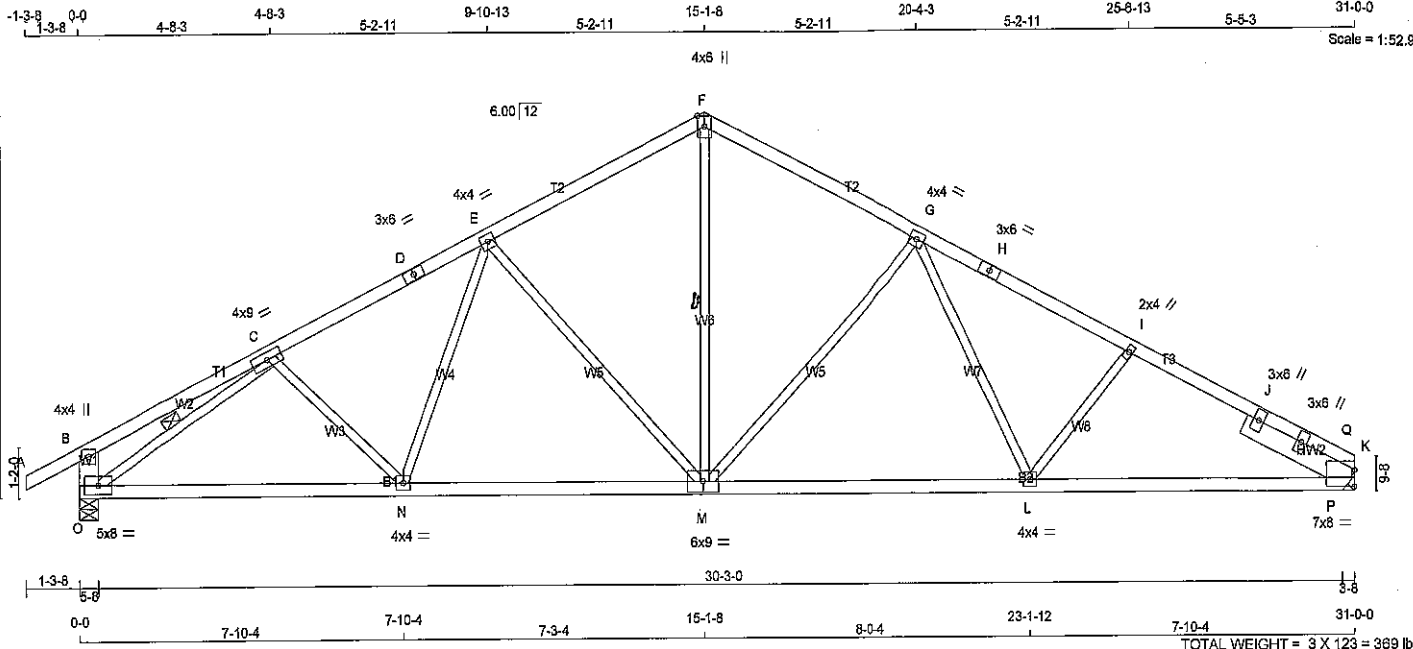

TOTAL WEIGHT = 3 X 123 = 369 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
O - B	2x8	DRY	No.2
O - M	2x4	DRY	No.2
M - K	2x4	DRY	No.2

REINFORCING MEMBERS			
HW2	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	4.0	4.0		
C	TMWW-t	MT20	4.0	9.0		
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTW+p	MT20	4.0	6.0	Edge	
G	TMWW-t	MT20	4.0	4.0		
H	TS-t	MT20	3.0	6.0		
I	TMW+w	MT20	2.0	4.0		
K	TMBMR-t	MT20	7.0	8.0	4.50	
K	RT-t	MT20	3.0	6.0		
K	RT-t	MT20	3.0	6.0		
L	BMWW-t	MT20	4.0	4.0		
M	BSWWW-t	MT20	6.0	9.0		
N	BMWW-t	MT20	4.0	4.0		
O	BMWW-t	MT20	5.0	6.0		

Edge - INICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	
O	1854	0	1854	0	0	5-8	
K	1740	0	1740	0	0	5-8	

HANGER BY OTHERS
MIN. SEAT SIZE: 3-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE				
O	1508	863 / 0	328 / 0	0 / 0	0 / 0	318 / 0	0 / 0
K	1429	793 / 0	326 / 0	0 / 0	0 / 0	310 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-O. *F-M*

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.3 -84.3	0.11 (1)	C-N	-33 / 148	0.03 (3)	
B-C	0 / 16	-84.3 -84.3	0.23 (1)	N-E	0 / 356	0.06 (2)	
C-D	-2396 / 0	-84.3 -84.3	0.35 (1)	E-M	-659 / 0	0.83 (1)	
D-E	-2398 / 0	-84.3 -84.3	0.35 (1)	M-F	0 / 1274	0.29 (1)	
E-F	-1831 / 0	-84.3 -84.3	0.32 (1)	M-G	-783 / 0	0.96 (1)	
F-G	-1827 / 0	-84.3 -84.3	0.34 (1)	G-L	0 / 456	0.10 (2)	
G-H	-2552 / 0	-84.3 -84.3	0.40 (1)	L-I	-205 / 32	0.08 (1)	
H-I	-2552 / 0	-84.3 -84.3	0.40 (1)	O-C	-2635 / 0	0.59 (1)	
I-J	-2052 / 0	-84.3 -84.3	0.39 (1)	P-Q	0 / 1451	0.00 (1)	
J-Q	-2052 / 0	-84.3 -84.3	0.39 (1)	P-J	-1519 / 0	0.12 (1)	
Q-K	-2408 / 0	-84.3 -84.3	0.14 (1)				
O-B	-271 / 0	0.0 0.0	0.02 (1)				
O-N	0 / 2172	-28.0 -28.0	0.63 (2)				
N-M	0 / 2058	-28.0 -28.0	0.62 (2)				
M-L	0 / 2126	-28.0 -28.0	0.56 (2)				
L-P	0 / 2429	-28.0 -28.0	0.61 (1)				
P-K	0 / 1300	-28.0 -28.0	0.47 (2)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.03")
CALCULATED VERT. DEFL.(LL) = L/999 (0.19")
ALLOWABLE DEFL.(TL) = L/360 (1.03")
CALCULATED VERT. DEFL.(TL) = L/998 (0.34")

CSI: TC=0.40 (G-I:1), BC=0.63 (N-O:2), WB=0.96 (G-M:1), SS=0.35 (K-P:2)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	616	354	1887
	822	2284	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.80)
JSI METAL= 0.67 (K) (INPUT = 1.00)

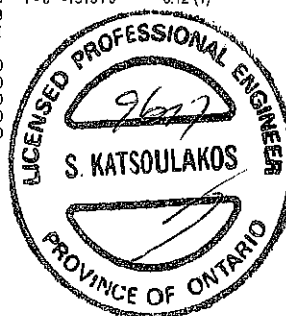


DWG NO. TAM 50057-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T90TCX	20	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed Sep 06 15:07:37 2017 Page 1
ID:w3K2lB2K4fGk9tDO7SkJphyfMC-On_bjTbPK96aOvQFrCPgoYZBjI485klkfjd1bUygKS4

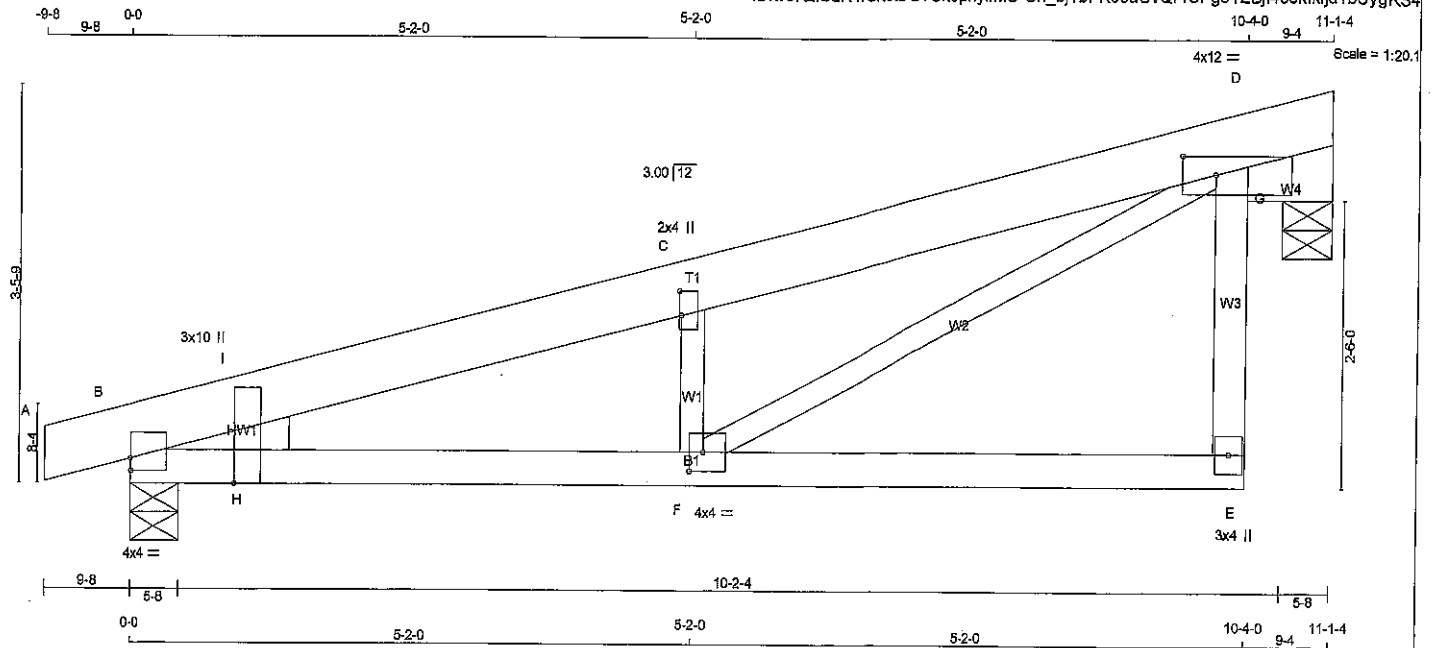

<u>LUMBER</u>				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - D	2x5	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
B - E	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE				
B TMB1-I	MT20	4.0	4.0	1.25
B WP+I	MT20	3.0	10.0	Edge 11.50
C TMW+w	MT20	2.0	4.0	2.50 0.25
D TMVWw1-p	MT20	4.0	12.0	2.00 3.75
E BMV+p	MT20	3.0	4.0	
F BMVW+I	MT20	4.0	4.0	2.00 1.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
J(D)	551	0	551	0	0
B	680	0	680	0	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED						
J(D)	452	251 / 0	103 / 0	0 / 0	0 / 0	98 / 0	0 / 0
B	548	321 / 0	114 / 0	0 / 0	0 / 0	114 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J(D), B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LG1 MAX CS1 (LC)	MAX. FACTORED UNBRAC LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO						FR-TO			
A-B		-4 / 0	-84.3	-84.3	0.02 (1)	10.00	F-C	-420 / 0	0.06 (1)
B-I		-1258 / 0	-84.3	-84.3	0.03 (1)	8.25	F-D	0 / 1157	0.26 (1)
I-C		-1158 / 0	-84.3	-84.3	0.07 (1)	6.25	H-I	0 / 131	0.03 (1)
C-D		-1152 / 0	-84.3	-84.3	0.17 (1)	6.25	C-J	-785 / 0	0.03 (1)
E-G		0 / 106	0.0	0.0	0.34 (1)	10.00	G-J	0 / 558	0.00 (1)
G-D		0 / 106	0.0	0.0	0.34 (1)	10.00			
B-H		0 / 1128	-28.0	-28.0	0.20 (1)	10.00			
H-F		0 / 1128	-28.0	-28.0	0.26 (2)	10.00			
F-E		0 / 103	-28.0	-28.0	0.17 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	=	25.6	PSF
DL	=	3.0	PSF
BOT CH. LL	=	10.5	PSF
DL	=	7.0	PSF
TOTAL LOAD	=	46.1	PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.34")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.34")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CS1: TC=0.34 (E-G:1), BC=0.26 (F-H:2), WB=0.26 (D-F:1), SS1=0.15 (D-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	616	354	1667
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (F) (INPUT = 0.90)
JSI METAL= 0.40 (B) (INPUT = 1.00)



DWG NO. TAM 5005B-17
STRUCTURAL
COMPONENT ONLY

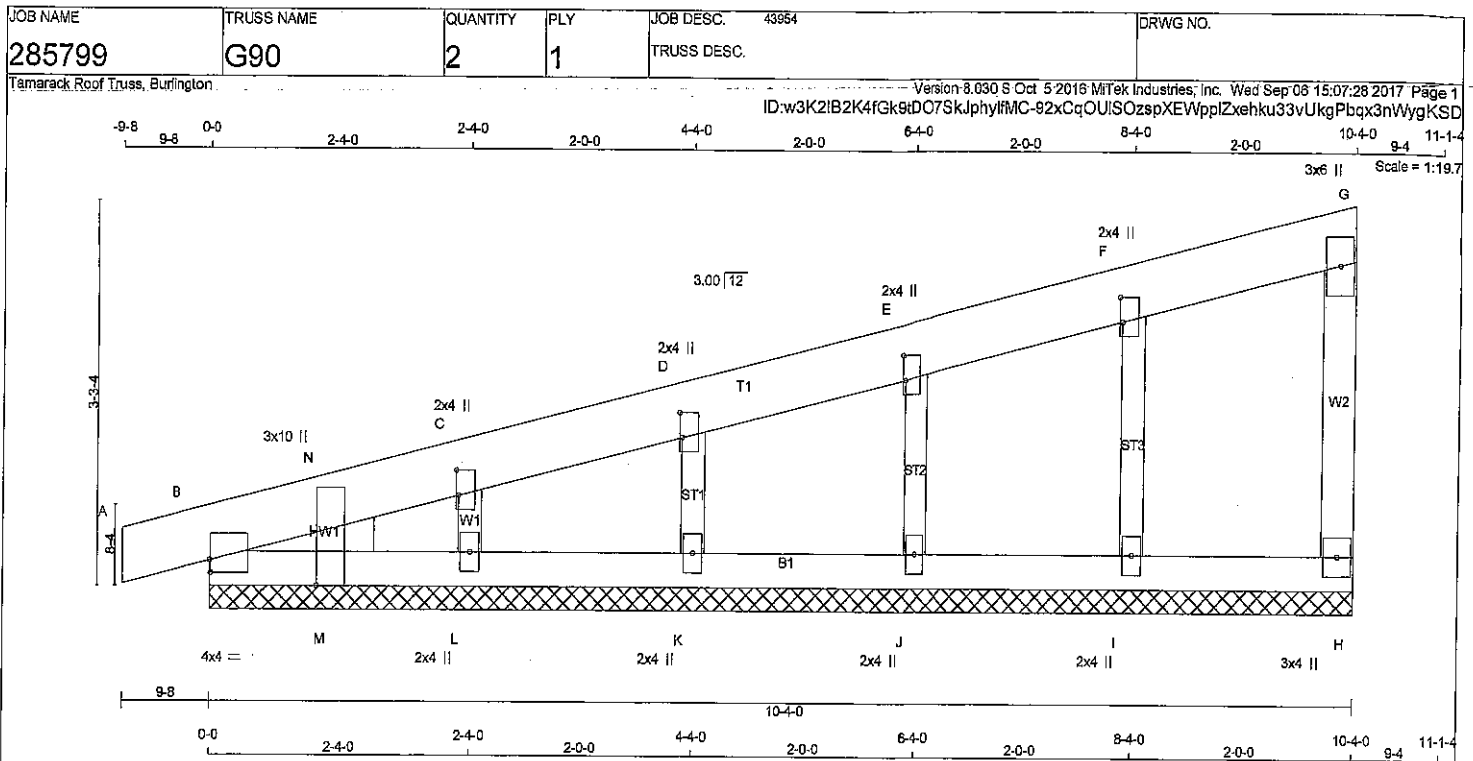

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - G	2x6	DRY No.2	SPF
H - G	2x4	DRY No.2	SPF
B - H	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

ALL GABLE WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TM81-I	MT20	4.0	4.0	1.25	
B	WPH	MT20	3.0	10.0	Edge	11.50
C, D, E, F						
C	TMW+w	MT20	2.0	4.0	2.50	0.25
G	TMV+p	MT20	3.0	6.0		
H	BMV1+p	MT20	3.0	4.0		
I, J, K, L						
I	BMW1+w	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

HEEL
WEDGE
2x4 L
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED LENGTH FR-TO	FACTORED LC1 CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	-47.0	-84.3 -84.3	0.02 (1)	10.00	I-F	-186.0	0.03 (1)
B-N	-46.0	-84.3 -84.3	0.02 (1)	6.25	J-E	-168.0	0.03 (1)
N-C	-14.3	-84.3 -84.3	0.03 (1)	6.25	K-D	-158.0	0.02 (1)
C-D	-18.0	-84.3 -84.3	0.03 (1)	6.25	L-C	-201.0	0.03 (1)
D-E	-9.0	-84.3 -84.3	0.02 (1)	10.00	M-N	0.41	0.00 (1)
E-F	-47.0	-84.3 -84.3	0.02 (1)	10.00			
F-G	-47.0	-84.3 -84.3	0.02 (1)	10.00			
H-G	-72.0	0.0 0.0	0.01 (1)	7.81			
B-M	0.28	-28.0 -28.0	0.02 (1)	10.00			
M-L	0.28	-28.0 -28.0	0.03 (2)	10.00			
L-K	0.16	-28.0 -28.0	0.02 (2)	10.00			
K-J	0.19	-28.0 -28.0	0.02 (2)	10.00			
J-I	0.14	-28.0 -28.0	0.03 (2)	10.00			
I-H	0.0	-28.0 -28.0	0.03 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF

BOT CH. LL = 10.5 PSF
DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.03 (C-D:1), BC=0.03 (I-J:2), WB=0.03 (F-I:1), SSI=0.07 (C-N:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1867
	822	2264	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (C) (INPUT = 0.90)
JSI METAL= 0.04 (L) (INPUT = 1.00)




DWG NO. TAM50083-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285800	T91	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MitTek Industries, Inc. Thu Apr 18 13:29:17 2018 Page 1

ID:sGqP1vk7j17Momm8E9Sg?w1yg0Fn-L4mble3_R9FWMDa5?u93KSeJ2YdwADAlkcN!TjzP9CG

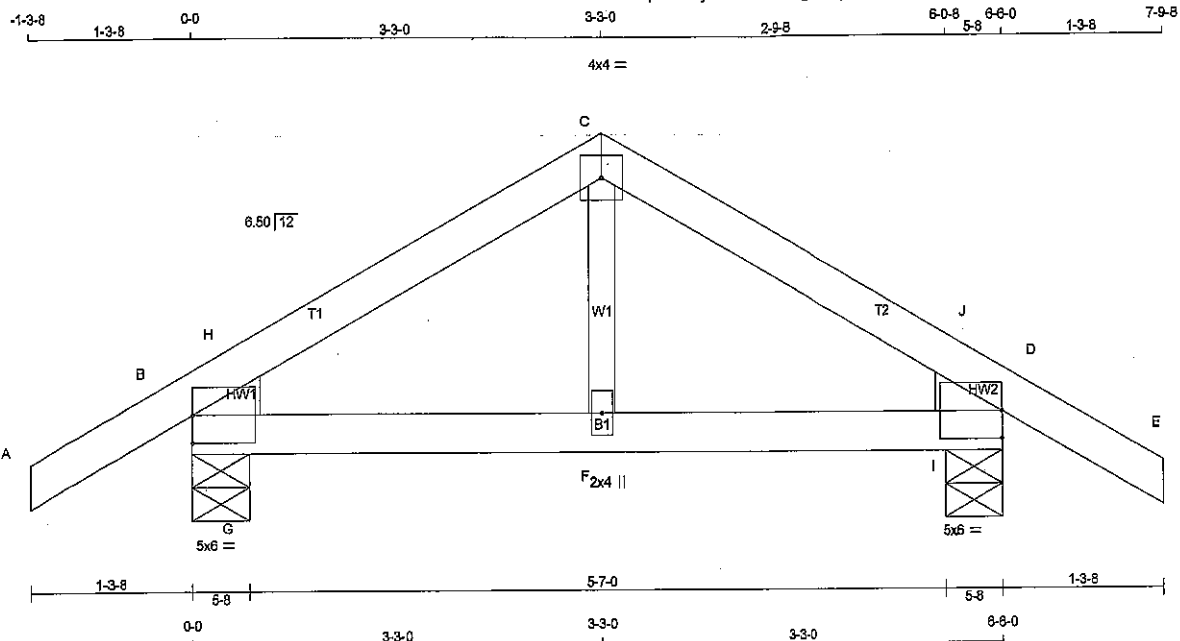

TOTAL WEIGHT = 3 X 22 = 67 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL
	VERT	HORZ	DOWN	HORZ	UPLIFT
JT	480	0	480	0	0
B	480	0	480	0	0
D	480	0	480	0	0

UNFACTORED REACTIONS

	1ST LCASE	MAX/MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	377	236 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0
B	377	236 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0
D	377	236 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 17	-84.3 -84.3	0.11 (1)	10.00	F-C	0 / 165	0.04 (2)
B-H	-411 / 0	-84.3 -84.3	0.05 (1)	6.25	G-H	-34 / 113	0.00 (1)
H-C	-355 / 0	-84.3 -84.3	0.08 (1)	6.25	I-J	-33 / 114	0.00 (1)
C-J	-355 / 0	-84.3 -84.3	0.08 (1)	6.25			
J-D	-412 / 0	-84.3 -84.3	0.05 (1)	6.25			
D-E	0 / 17	-84.3 -84.3	0.11 (1)	10.00			
B-G	0 / 305	-28.0 -28.0	0.08 (1)	10.00			
G-F	0 / 305	-28.0 -28.0	0.10 (1)	10.00			
F-I	0 / 305	-28.0 -28.0	0.10 (1)	10.00			
I-D	0 / 305	-28.0 -28.0	0.08 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.22")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.22")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.11/1.00 (A-B:1), BC=0.10/1.00 (F-G:1), WB=0.04/1.00 (C-F:2), SS=0.09/1.00 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1687 822 2284 1656


PLATE PLACEMENT TOL = 0.250 Inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.82 (D) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)



DWG NO. TAM 21192-18
STRUCTURAL
COMPONENT ONLY

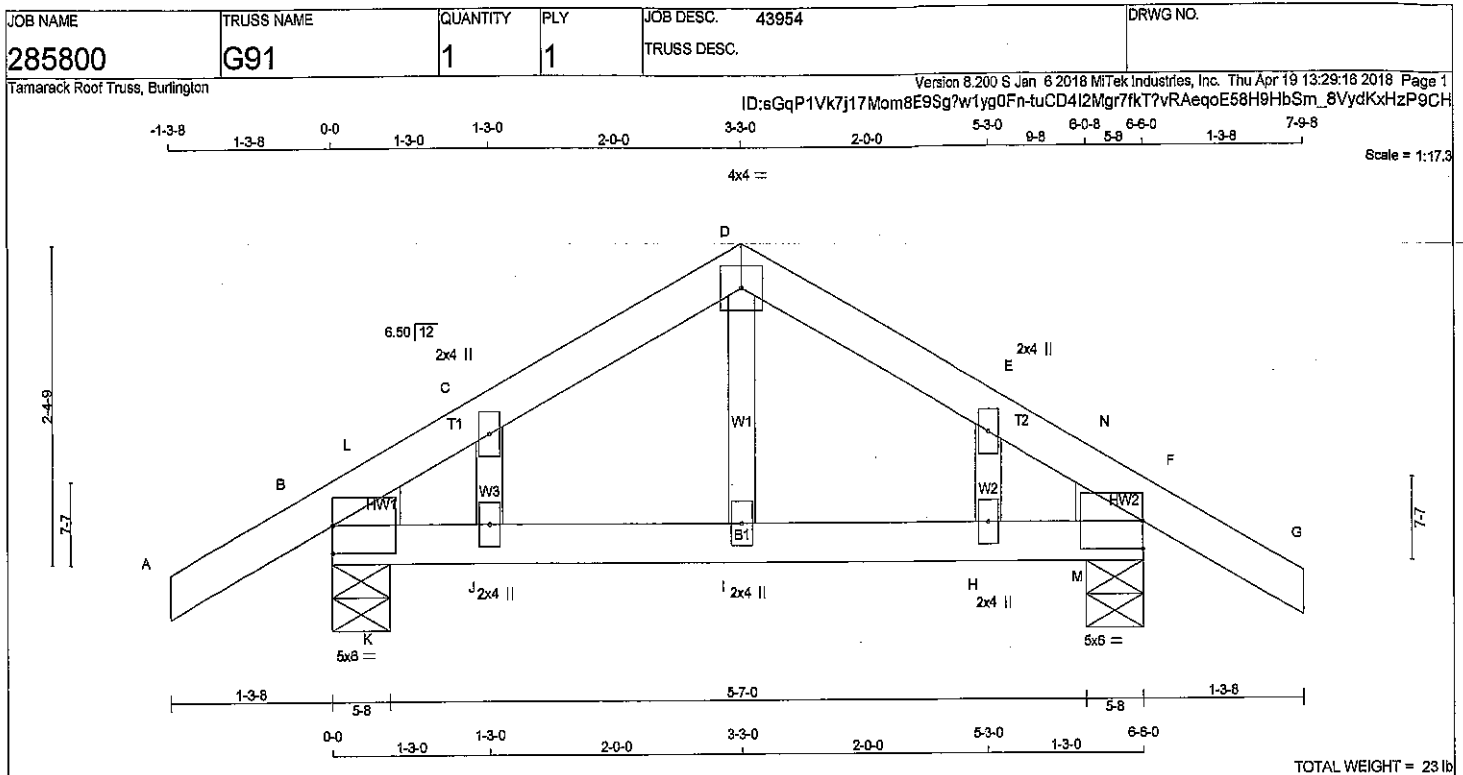

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR.
 A - D 2x4 DRY No.2 SPF
 B - G 2x4 DRY No.2 SPF
 D - F 2x4 DRY No.2 SPF
 ALL WEBS 2x3 DRY No.2 SPF
 DRY, SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMBH1-I	MT20	5.0	6.0	2.50	
C	TMW+w	MT20	2.0	4.0		
D	TTW-p	MT20	4.0	4.0		
E	TMW+w	MT20	2.0	4.0		
F	TMBH1-I	MT20	5.0	6.0	2.50	
H, I, J						
H	BMW+w	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
B	480	0	480	0	5-8	5-8	2x4 L
F	480	0	480	0	5-8	5-8	2x4 R

UNFACTORED REACTIONS

1ST LCASE MAX/MIN. COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	377	236 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0
F	377	236 / 0	68 / 0	0 / 0	0 / 0	73 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
A-B	0 / 17	-84.3	-84.3 0.11 (1)	10.00	I-D	0 / 151	0.03 (2)
B-L	-525 / 0	-84.3	-84.3 0.11 (1)	6.25	H-E	-81 / 28	0.01 (1)
L-C	-322 / 0	-84.3	-84.3 0.05 (1)	6.25	J-C	-81 / 26	0.01 (1)
C-D	-288 / 0	-84.3	-84.3 0.06 (1)	6.25	K-L	0 / 225	0.00 (1)
D-E	-288 / 0	-84.3	-84.3 0.06 (1)	6.25	M-N	0 / 227	0.00 (1)
E-N	-322 / 0	-84.3	-84.3 0.05 (1)	6.25			
N-F	-527 / 0	-84.3	-84.3 0.11 (1)	6.25			
F-G	0 / 17	-84.3	-84.3 0.11 (1)	10.00			
B-K	0 / 257	-28.0	-28.0 0.11 (1)	10.00			
K-J	0 / 257	-28.0	-28.0 0.11 (1)	10.00			
J-I	0 / 251	-28.0	-28.0 0.08 (1)	10.00			
I-H	0 / 251	-28.0	-28.0 0.08 (1)	10.00			
H-M	0 / 287	-28.0	-28.0 0.11 (1)	10.00			
M-F	0 / 257	-28.0	-28.0 0.11 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.5 PSF
 LL = 3.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 48.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
 - PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 088-09
 - TPIC 2011

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.22")
 CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.22")
 CALCULATED VERT. DEFL.(TL) = $L/989$ (0.01")

CSI: TO=0.11/1.00 (F-N:1), BC=0.11/1.00 (H-M:1), WB=0.03/1.00 (D-I:2), SSI=0.10/1.00 (F-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1657 522 2284 1655

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.66 (F) (INPUT = 0.90)
 JSI METAL= 0.09 (B) (INPUT = 1.00)




DWG NO. TAM 21197-18
 STRUCTURAL
 COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T92	4	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2018 Mittek Industries, Inc. Wed Sep 06 15:07:37 2017 Page 1
ID:w3K2IB2K4fGk9tD07SkJphylfMC-On_bjTbPK96aOvQFrCPgoYZFMi775opkjd1bUygKS4

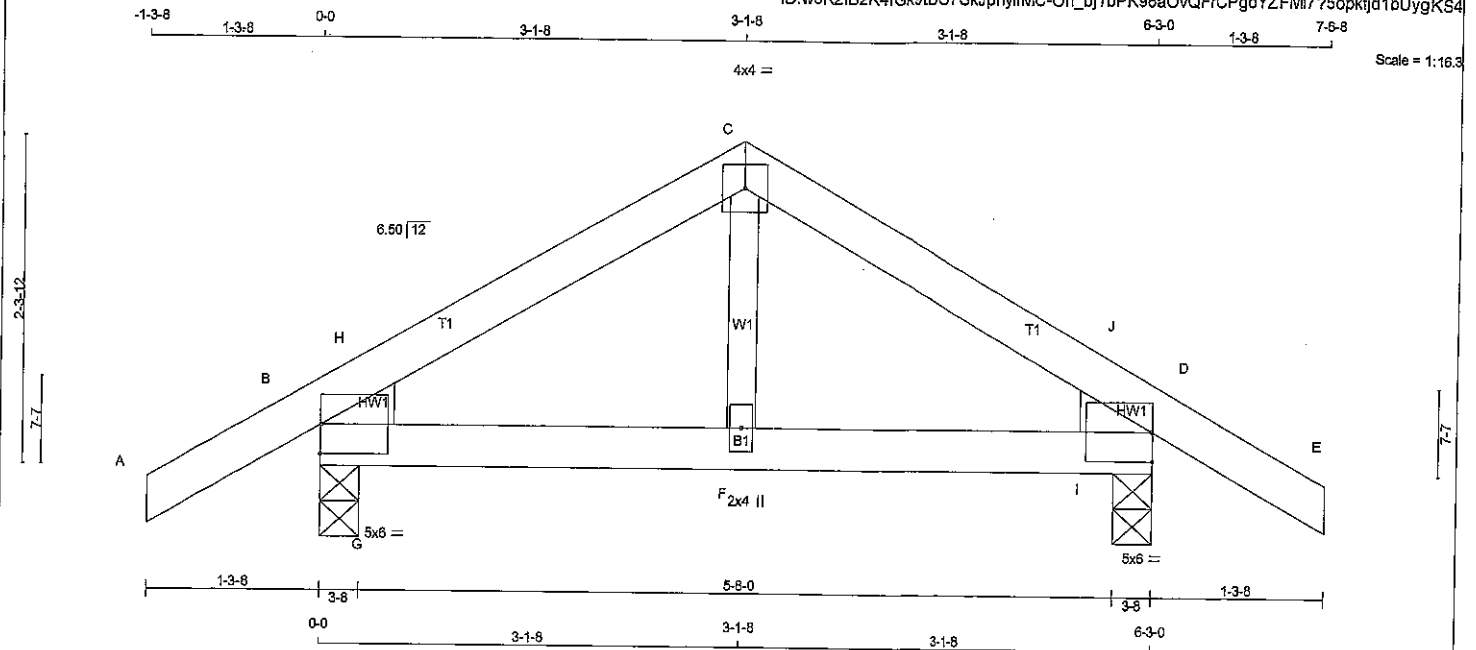

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
B - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y
B	TM9H1-I	MT20	5.0	6.0	
C	TTW-p	MT20	4.0	4.0	
D	TM9H1-I	MT20	5.0	6.0	
F	8MW+w	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG		HEEL WEDGE	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	2x4 L	2x4 R
B	465	0	465	0	0	3-8	3-8		
D	465	0	465	0	0	3-8	3-8		

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	366	230 / 0	66 / 0	0 / 0	0 / 0	71 / 0	0 / 0	0 / 0
D	366	230 / 0	66 / 0	0 / 0	0 / 0	71 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED VERT. LOAD (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 17	-84.3	-84.3	0.11 (1)	10.00	F-C	0 / 157
B-H	-397 / 0	-84.3	-84.3	0.04 (1)	6.25	G-H	-28 / 107
H-C	-338 / 0	-84.3	-84.3	0.07 (1)	6.25	I-J	-28 / 107
C-J	-338 / 0	-84.3	-84.3	0.07 (1)	6.25		
J-D	-397 / 0	-84.3	-84.3	0.04 (1)	6.25		
D-E	0 / 17	-84.3	-84.3	0.11 (1)	10.00		
B-G	0 / 291	-28.0	-28.0	0.08 (1)	10.00		
G-F	0 / 291	-28.0	-28.0	0.09 (1)	10.00		
F-I	0 / 291	-28.0	-28.0	0.09 (1)	10.00		
I-D	0 / 291	-28.0	-28.0	0.08 (1)	10.00		

TOTAL WEIGHT = 4 X 22 = 88 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.11 (D-E:1), BC=0.08 (F-G:1), WB=0.04 (C-F:2), SSI=0.09 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.76 (B) (INPUT = 0.90)
JSI METAL= 0.10 (D) (INPUT = 1.00)



DWG NO. T92 50062-17
STRUCTURAL
COMPONENT ONLY

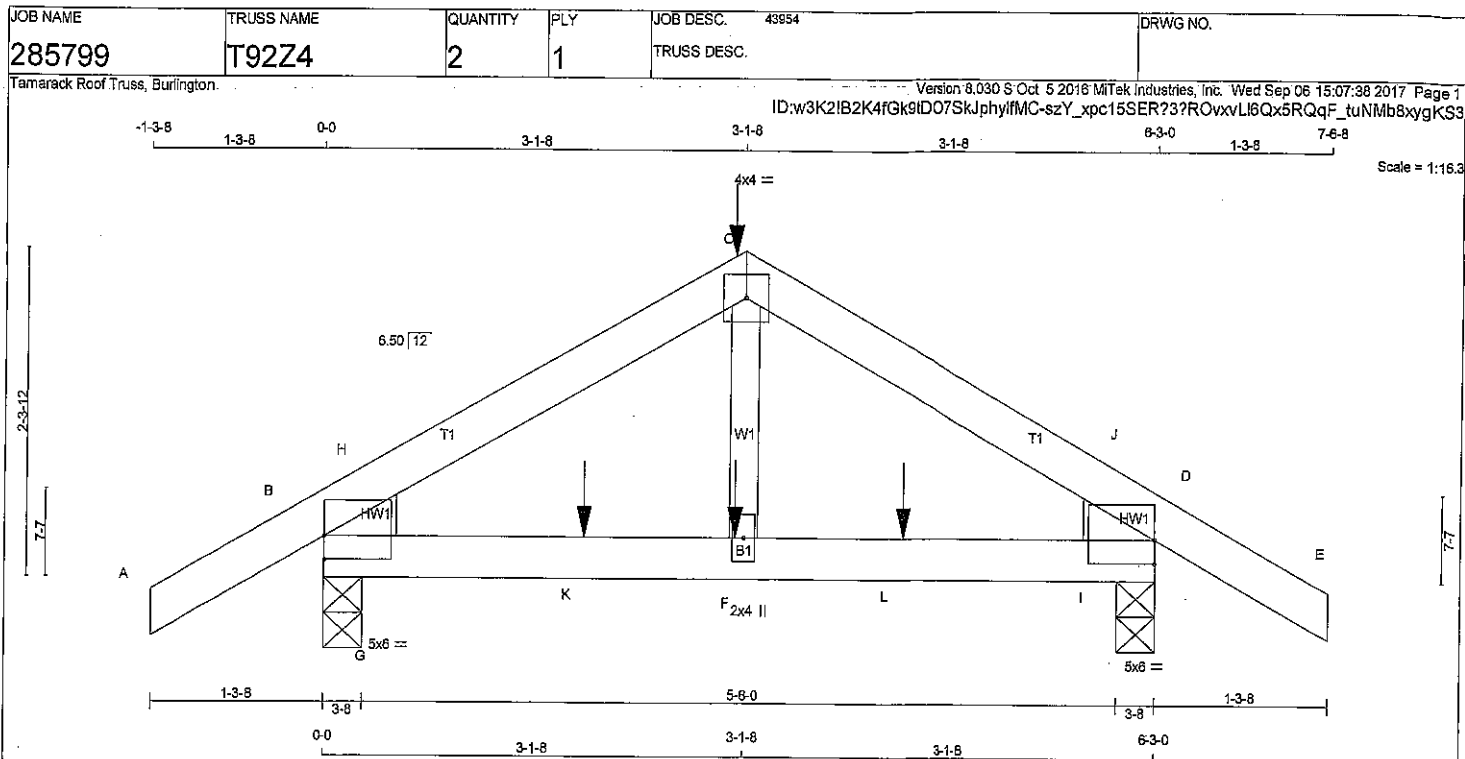

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-I	MT20	5.0	6.0	2.00
C	TTW-p	MT20	4.0	4.0	
D	TMBH1-I	MT20	5.0	6.0	2.00
F	BMW+w	MT20	2.0	4.0	

HANGERS NOTES

- 1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 389.8 lbs FACTORED DOWN AT 3-1-8 ON TOP CHORD, AND 11.9 lbs FACTORED DOWN AND 2.9 lbs FACTORED UP AT 1-11-4, AND 31.5 lbs FACTORED DOWN AT 3-0-12, AND 11.9 lbs FACTORED DOWN AND 2.9 lbs FACTORED UP AT 4-3-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	HEEL WEDGE
B	673	0	673	0	2x4 L
D	673	0	673	0	2x4 R

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	525	339 / 0	90 / 0	0 / 0	0 / 0	96 / 0	0 / 0	
D	525	339 / 0	90 / 0	0 / 0	0 / 0	96 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MEMB.
FR-TO				FR-TO			
A-B	0 / 17	-84.3	-84.3 0.12 (1)	10.00	F-C	0 / 182	0.04 (3)
B-H	-839 / 0	-84.3	-84.3 0.11 (1)	6.25	G-H	0 / 189	0.00 (1)
H-C	-839 / 0	-84.3	-84.3 0.11 (1)	6.25	I-J	0 / 169	0.00 (1)
C-J	-839 / 0	-84.3	-84.3 0.11 (1)	6.25			
J-D	-839 / 0	-84.3	-84.3 0.11 (1)	6.25			
D-E	0 / 17	-84.3	-84.3 0.12 (1)	10.00			
B-G	0 / 595	-28.0	-28.0 0.15 (1)	10.00			
G-K	0 / 595	-28.0	-28.0 0.15 (1)	10.00			
K-F	0 / 595	-28.0	-28.0 0.15 (1)	10.00			
F-L	0 / 595	-28.0	-28.0 0.15 (1)	10.00			
L-I	0 / 595	-28.0	-28.0 0.15 (1)	10.00			
I-D	0 / 595	-28.0	-28.0 0.15 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	3-1-8	-390	-390	---	FRONT	VERT	TOTAL
F	3-0-12	-31	-31	---	FRONT	VERT	TOTAL
K	1-11-4	3	-12	3	FRONT	VERT	TOTAL
L	4-3-12	3	-12	3	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 48.1	PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12 (D-E:1), BC=0.15 (F-I:1), WB=0.04 (C-F:3), SSI=0.11 (C-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	818	354	1667
	822	2284	1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.81 (D) (INPUT = 0.90)
JSI METAL= 0.15 (D) (INPUT = 1.00)

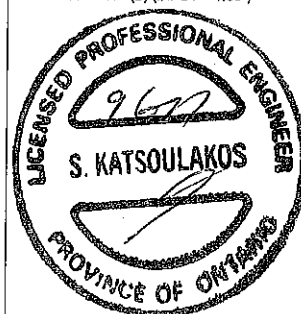


DRWG NO. TAM 50061-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T150	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Wed Sep 06 15:07:38 2017 Page 1

ID:mmPq44amR115u4jHDy0wQ2ygNv9-szY_xpc15SER?3?ROVxvLi6De5J0q2EtuNMb8xygKS3

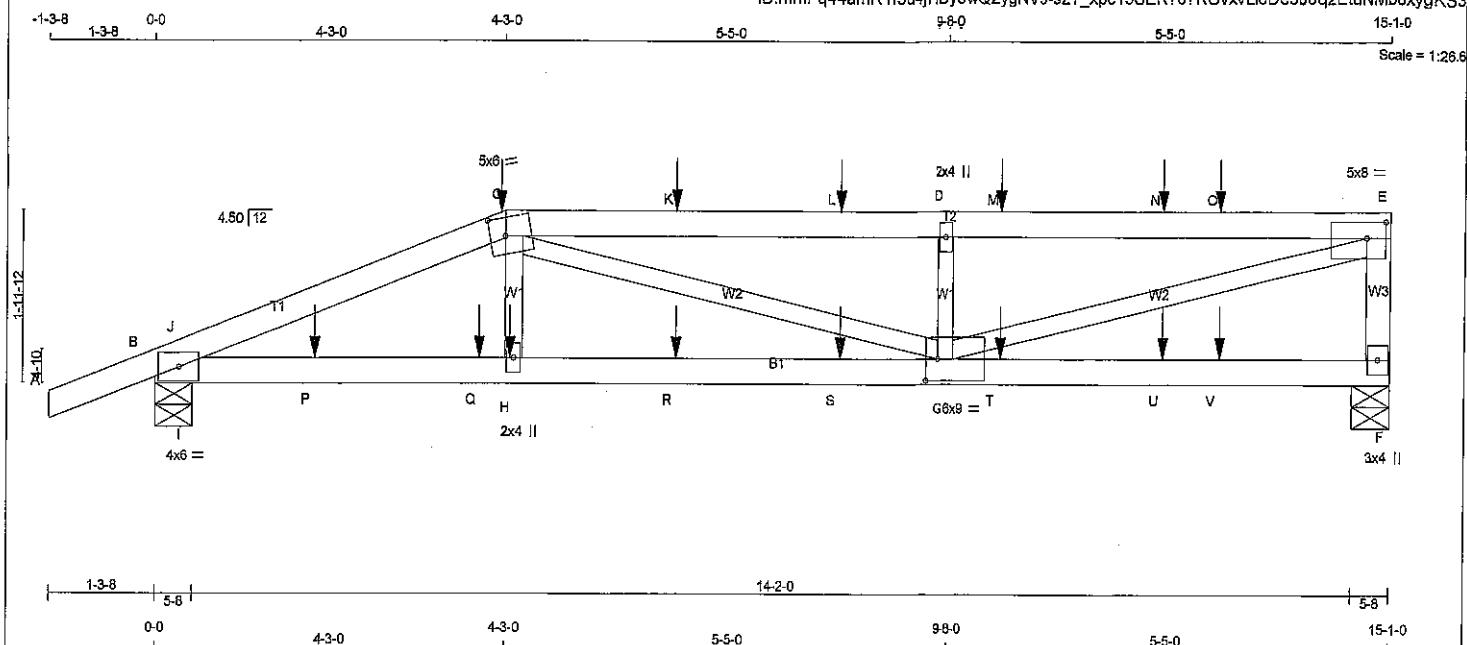

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
F - F	2x4	DRY No.2	SPF
B - F	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TM81-I	MT20	4.0	6.0		
C	TTWW-m	MT20	5.0	6.0	2.50	2.25
D	TMW+w	MT20	2.0	4.0		
E	TMVW-t	MT20	5.0	6.0	2.25	2.75
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	6.0	9.0	3.00	1.75
H	BMW+w	MT20	2.0	4.0		

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 318.6 lbs FACTORED DOWN AT 4-3-0, 75.5 lbs FACTORED DOWN AT 8-3-12, 75.5 lbs FACTORED DOWN AT 8-3-12, 75.5 lbs FACTORED DOWN AT 10-3-12, AND 75.5 lbs FACTORED DOWN AT 12-3-12, AND 75.5 lbs FACTORED DOWN AT 13-0-4 ON TOP CHORD, AND 83.8 lbs FACTORED DOWN AT 1-11-4, 47.1 lbs FACTORED DOWN AT 3-11-4, 50.9 lbs FACTORED DOWN AT 4-3-12, 50.9 lbs FACTORED DOWN AT 6-3-12, 50.9 lbs FACTORED DOWN AT 8-3-12, 50.9 lbs FACTORED DOWN AT 10-3-12, AND 50.9 lbs FACTORED DOWN AT 12-3-12, AND 50.9 lbs FACTORED DOWN AT 13-0-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	REQD
F	1394	0	1394	0	0	5-8	5-8
B	1540	0	1540	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	1141	639 / 0	258 / 0	0 / 0	0 / 0	246 / 0	0 / 0
B	1240	728 / 0	258 / 0	0 / 0	0 / 0	256 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.75 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 / 17	-84.3 -84.3	0.12 (1)	10.00	H-C	0 / 381	0.08 (2)
B-J	-3251 / 0	-84.3 -84.3	0.25 (1)	3.63	C-G	0 / 396	0.10 (1)
J-C	-3118 / 0	-84.3 -84.3	0.33 (1)	3.65	G-D	-816 / 0	0.13 (1)
C-K	-3307 / 0	-84.3 -84.3	0.90 (1)	2.75	G-E	0 / 3482	0.36 (1)
K-L	-3307 / 0	-84.3 -84.3	0.90 (1)	2.75	I-J	0 / 289	0.00 (1)
L-D	-3307 / 0	-84.3 -84.3	0.90 (1)	2.75			
D-M	-3307 / 0	-84.3 -84.3	0.91 (1)	2.75			
M-N	-3307 / 0	-84.3 -84.3	0.91 (1)	2.75			
N-O	-3307 / 0	-84.3 -84.3	0.91 (1)	2.75			
O-E	-3307 / 0	-84.3 -84.3	0.91 (1)	2.75			
F-E	-1275 / 0	0.0 0.0	0.15 (1)	7.10			
B-I	0 / 2911	-28.0 -28.0	0.55 (1)	10.00			
I-P	0 / 2911	-28.0 -28.0	0.65 (1)	10.00			
P-Q	0 / 2911	-28.0 -28.0	0.66 (1)	10.00			
Q-H	0 / 2911	-28.0 -28.0	0.66 (1)	10.00			
H-R	0 / 2929	-28.0 -28.0	0.68 (1)	10.00			
R-S	0 / 2929	-28.0 -28.0	0.68 (1)	10.00			
S-G	0 / 2929	-28.0 -28.0	0.68 (1)	10.00			
G-T	0 / 0	-28.0 -28.0	0.34 (2)	10.00			
T-U	0 / 0	-28.0 -28.0	0.34 (2)	10.00			
U-V	0 / 0	-28.0 -28.0	0.34 (2)	10.00			
V-F	0 / 0	-28.0 -28.0	0.34 (2)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
C	4-3-0	-319	-319	—	BACK	VERT	TOTAL
H	4-3-12	-51	-51	—	BACK	VERT	TOTAL
K	6-3-12	-75	-75	—	BACK	VERT	TOTAL
L	8-3-12	-75	-75	—	BACK	VERT	TOTAL
M	10-3-12	-75	-75	—	BACK	VERT	TOTAL
N	12-3-12	-75	-75	—	BACK	VERT	TOTAL
O	13-0-4	-75	-75	—	BACK	VERT	TOTAL
P	1-11-4	-84	-84	—	BACK	VERT	TOTAL
Q	3-11-4	-43	-47	—	BACK	VERT	TOTAL
R	6-3-12	-51	-51	—	BACK	VERT	TOTAL
S	8-3-12	-51	-51	—	BACK	VERT	TOTAL
T	10-3-12	-51	-51	—	BACK	VERT	TOTAL
U	12-3-12	-51	-51	—	BACK	VERT	TOTAL
V	13-0-4	-51	-51	—	BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 3.0 PSF

BOT CH. LL = 10.5 PSF

DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. GIC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.50")

CALCULATED VERT. DEFL.(LL) = L/590 (0.17")

ALLOWABLE DEFL.(TL) = L/360 (0.50")

CALCULATED VERT. DEFL.(TL) = L/653 (0.28")

CSI: TC=0.91 (D-E:1), BC=0.68 (G-H:1), WB=0.86 (E-G:1), SS=0.37 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.69 (E) (INPUT = 0.90)

JSI METAL= 0.67 (B) (INPUT = 1.00)

DWG NO. TAM 5006217

STRUCTURAL

COMPONENT ONLY

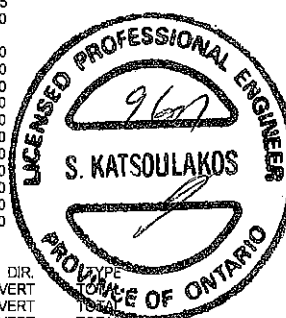


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T151A	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MITek Industries, Inc. Wed Sep 06 15:07:38 2017 Page 1

ID:mmPq44amR115u4jHDyOwQ2ygNv9-szY_xpc15SER73?ROVxvLI6IF5HQq2LtuNMb8xygKS3

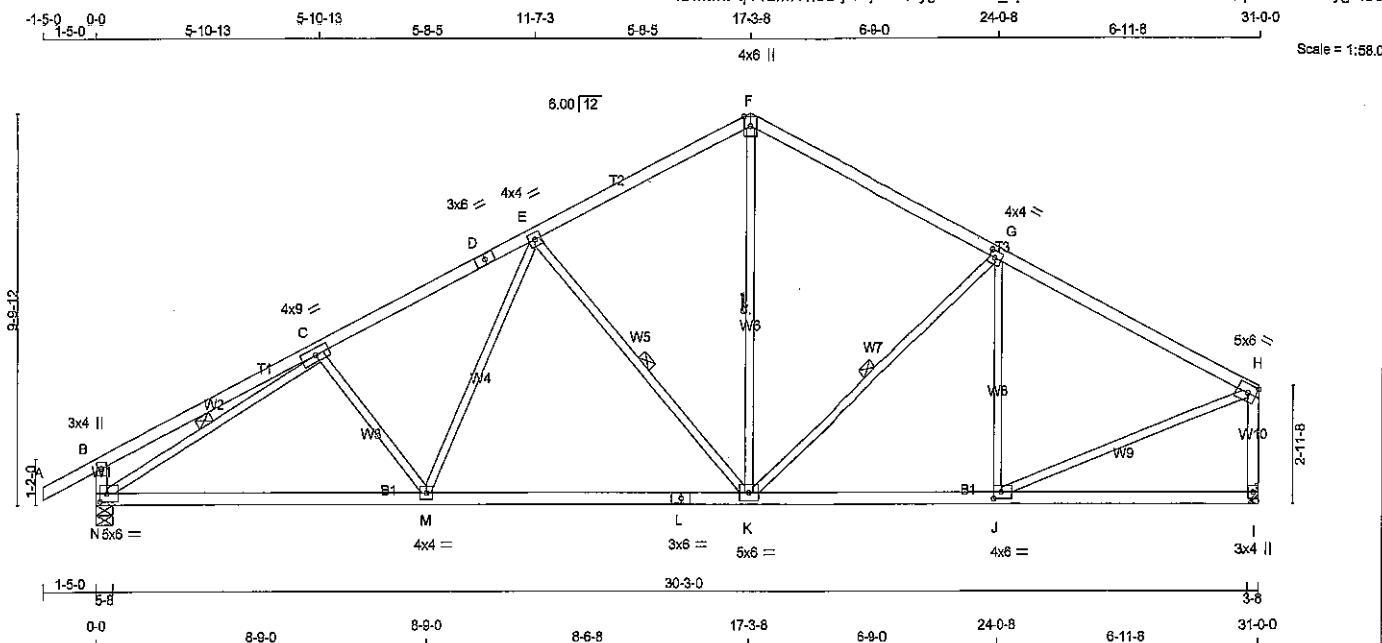

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
N - B	2x4	DRY	No.2
I - H	2x4	DRY	No.2
L - L	2x4	DRY	No.2
L - I	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	9.0		
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTW+p	MT20	4.0	6.0	Edge	
G	TMWW-t	MT20	4.0	4.0	2.00	1.75
H	TMVV-t	MT20	5.0	6.0	Edge	
I	BMV1+p	MT20	3.0	4.0		
J	BMWW-t	MT20	4.0	6.0	2.00	2.50
K	BMWW-t	MT20	5.0	6.0		
L	BS-t	MT20	3.0	6.0		
M	BMWW-t	MT20	4.0	4.0		
N	BMVV-t	MT20	5.0	6.0	2.50	2.25

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
N	1885	0	0	5-8
I	1740	0	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
N	1513	889 / 0	326 / 0	0 / 0	0 / 0	0 / 0	319 / 0	0 / 0
I	1429	793 / 0	326 / 0	0 / 0	0 / 0	0 / 0	310 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-K, G-K, C-N. *F-12*

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-84.3 -84.3	0.13 (1)	C-M	-184 / 103	0.07 (1)	
B-C	0 / 20	-84.3 -84.3	0.35 (1)	M-E	0 / 511	0.11 (2)	
C-D	-2360 / 0	-84.3 -84.3	0.40 (1)	E-K	-797 / 0	0.42 (1)	
D-E	-2360 / 0	-84.3 -84.3	0.40 (1)	K-F	0 / 1007	0.23 (1)	
E-F	-1601 / 0	-84.3 -84.3	0.36 (1)	G-K	-294 / 0	0.17 (1)	
F-G	-1611 / 0	-84.3 -84.3	0.58 (1)	J-G	-411 / 62	0.28 (1)	
G-H	-1762 / 0	-84.3 -84.3	0.81 (1)	N-C	-2651 / 0	0.85 (1)	
N-B	-325 / 0	0.0 0.0	0.03 (1)	J-H	0 / 1745	0.39 (1)	
I-H	-1660 / 0	0.0 0.0	0.26 (1)				
N-M	0 / 2225	-28.0 -28.0	0.79 (2)				
M-L	0 / 1931	-28.0 -28.0	0.76 (2)				
L-K	0 / 1931	-28.0 -28.0	0.76 (2)				
K-J	0 / 1930	-28.0 -28.0	0.50 (2)				
J-I	0 / 0	-28.0 -28.0	0.31 (3)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6	PSF
DL	= 3.0	PSF
BOT CH. LL	= 10.5	PSF
DL	= 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN/CI

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.24")
ALLOWABLE DEFL.(TL) = $L/360$ (1.03")
CALCULATED VERT. DEFL.(TL) = $L/954$ (0.39")

CSI: TC=0.61 (G-H:1), BC=0.79 (M-N:2),
WB=0.85 (C-N:1), SSI=0.25 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (N) (INPUT = 0.90)
JSI METAL= 0.56 (N) (INPUT = 1.00)

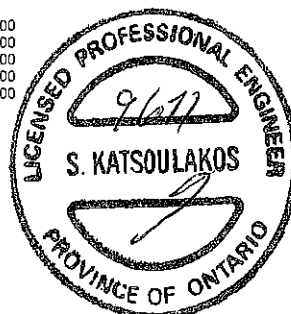

DWG NO. TAN 50063-17
STRUCTURAL
COMPONENT ONLY

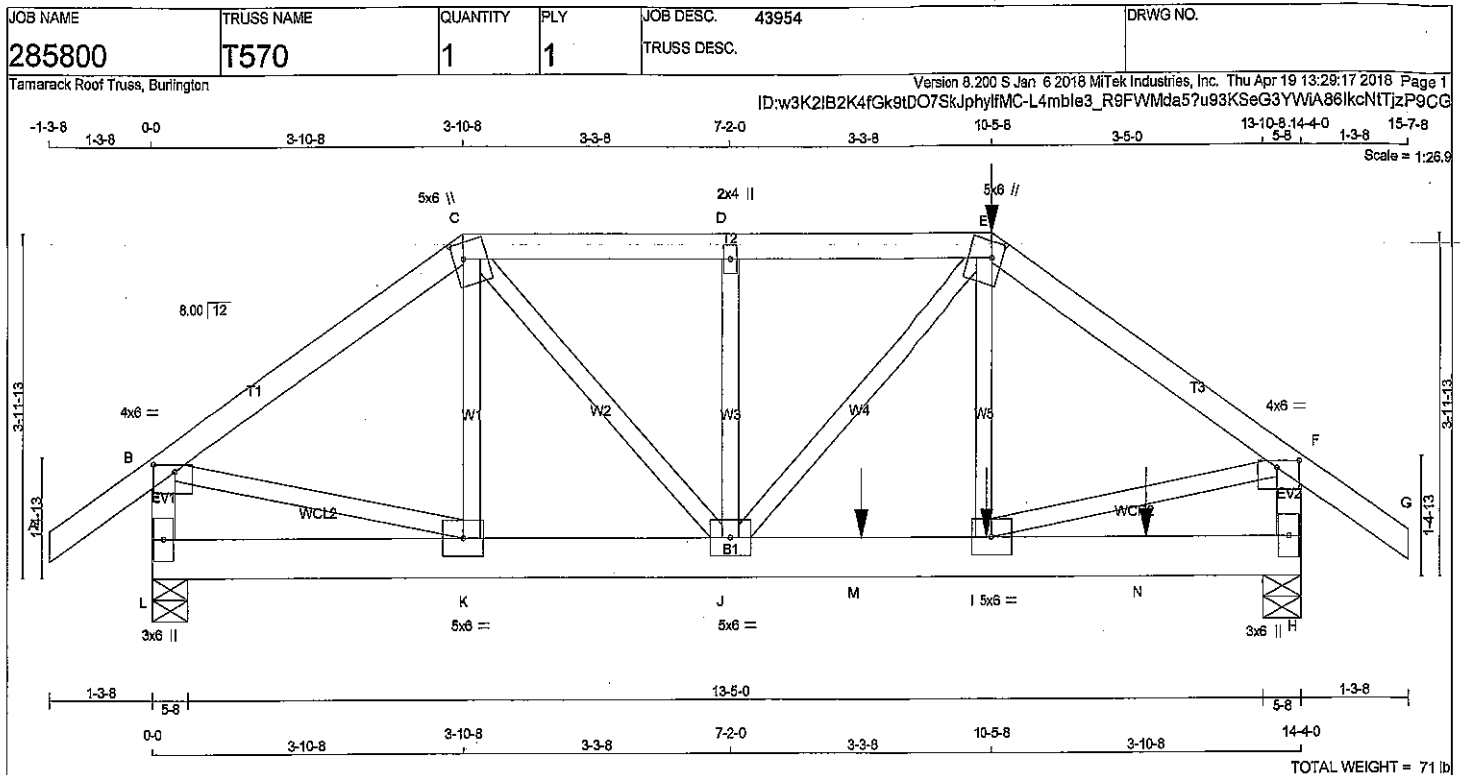

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
L - H	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.25
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMW+w	MT20	2.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.25	1.50
F	TMVW-p	MT20	4.0	6.0	1.00	3.25
H	BMV1+p	MT20	3.0	6.0		
I	BMVW-t	MT20	5.0	6.0		
J	BMVW-t	MT20	5.0	6.0		
K	BMVW-t	MT20	5.0	6.0		
L	BMV1+p	MT20	3.0	6.0		

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 225.2 lbs FACTORED DOWN AT 10-5-8 ON TOP CHORD, AND 802.7 lbs FACTORED DOWN AT 8-9-8, AND 33.0 lbs FACTORED DOWN AT 10-4-12, AND 41.0 lbs FACTORED DOWN AT 12-4-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
L	1300	0	0	5-8
H	1611	0	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	1030	632 / 0	194 / 0	0 / 0	0 / 0	204 / 0	0 / 0
H	1272	787 / 0	235 / 0	0 / 0	0 / 0	251 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.74 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM		FR-TO			
A-B	0 / 32	-84.3	-84.3 0.12 (1)	10.00	K-C	-213 / 60	0.05 (1)
B-C	-1260 / 0	-84.3	-84.3 0.27 (1)	5.38	C-J	0 / 858	0.21 (1)
C-D	-1620 / 0	-84.3	-84.3 0.18 (1)	4.99	J-D	-318 / 0	0.08 (1)
D-E	-1620 / 0	-84.3	-84.3 0.18 (1)	4.99	J-E	0 / 288	0.07 (1)
E-F	-1708 / 0	-84.3	-84.3 0.30 (1)	4.74	I-E	0 / 293	0.07 (2)
F-G	0 / 32	-84.3	-84.3 0.12 (1)	10.00	B-K	0 / 1079	0.27 (1)
L-B	-1243 / 0	0.0	0.0 0.14 (1)	7.17	I-F	0 / 1462	0.36 (1)
H-F	-1585 / 0	0.0	0.0 0.18 (1)	6.52			
L-K	0 / 0	-28.0	-28.0 0.06 (2)	10.00			
K-J	0 / 1040	-28.0	-28.0 0.25 (1)	10.00			
J-M	0 / 1425	-28.0	-28.0 0.56 (1)	10.00			
M-I	0 / 1425	-28.0	-28.0 0.56 (1)	10.00			
I-N	0 / 0	-28.0	-28.0 0.12 (1)	10.00			
N-H	0 / 0	-28.0	-28.0 0.12 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
E	10-5-8	-225	-225	---	FRONT	VERT	TOTAL
I	10-4-12	-19	-33	---	FRONT	VERT	TOTAL
M	8-9-8	-803	-803	---	FRONT	VERT	TOTAL
N	12-4-12	-23	-41	---	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.I. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.48")
CALCULATED VERT. DEFL.(LL)= L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.48")
CALCULATED VERT. DEFL.(TL)= L/999 (0.07")

CSI: TC=0.30/1.00 (E-F:1), BC=0.56/1.00 (I-J:1), WB=0.36/1.00 (F-I:1), SSI=0.30/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1837
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (C) (INPUT = 0.90)
JSI METAL= 0.38 (B) (INPUT = 1.00)




DRWG NO. TAM 2193-18
STRUCTURAL
COMPONENT ONLY

JOB NAME 285800	TRUSS NAME T580	QUANTITY 1	PLY 1	JOB DESC. 43954	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	---------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 8 2018 Mitek Industries, Inc. Thu Apr 19 13:29:18 2018 Page 1

ID:w3K2IB2K4fGk9tDO7SkJphyfMC-qHKzV_3cCSNN_n9lZbhtfBQWYwXvezRzG6R0AzP9CF

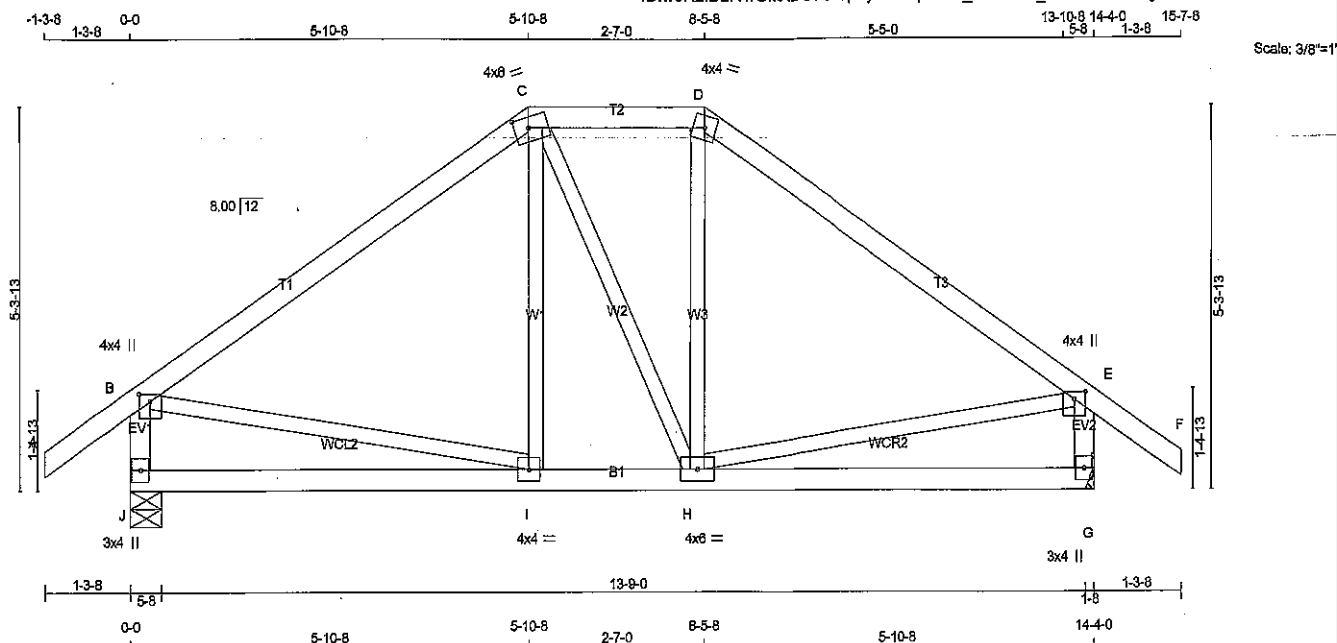

TOTAL WEIGHT = 63 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTWW-m	MT20	4.0	6.0	1.75	2.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMWW-t	MT20	4.0	6.0		
I	BMWW-t	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
J	920	0	920	0	0	5-8	5-8
G	920	0	920	0	0	HANGER BY OTHERS	
							MIN. SEAT SIZE: 1-8

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	739	437/0	151/0	0/0	0/0	152/0	0/0
G	739	437/0	151/0	0/0	0/0	152/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	UNBRACED LENGTH (FT)
FR-TO		FROM	TO	FR-TO			
A-B	0/32	-84.3	-84.3	0.11 (1)	I-C	0/169	0.04 (3)
B-C	-689/0	-84.3	-84.3	0.38 (1)	C-H	0/5	0.00 (3)
C-D	-574/0	-84.3	-84.3	0.08 (1)	H-D	0/173	0.04 (3)
D-E	-689/0	-84.3	-84.3	0.38 (1)	B-I	0/581	0.13 (1)
E-F	0/32	-84.3	-84.3	0.11 (1)	H-E	0/582	0.13 (1)
J-B	-849/0	0.0	0.0	0.09 (1)			
G-E	-849/0	0.0	0.0	0.09 (1)			
J-I	0/0	-28.0	-28.0	0.21 (2)			
I-H	0/573	-28.0	-28.0	0.27 (2)			
H-G	0/0	-28.0	-28.0	0.21 (2)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.48")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.48")
CALCULATED VERT. DEFL.(TL) = L/999 (0.10")

CS: TC=0.38/1.00 (D-E:1), BC=0.27/1.00 (H-I:2),
WB=0.13/1.00 (E-H:1), SS=0.16/1.00 (D-E:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.79 (H) (INPUT = 0.90)
JSI METAL= 0.21 (I) (INPUT = 1.00)




DRWG NO. TAM 21194-08
STRUCTURAL
COMPONENT ONLY

JOB NAME 285800	TRUSS NAME T590	QUANTITY 2	PLY 1	JOB DESC. 43954	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	---------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MiTek Industries, Inc. Thu Apr 19 13:29:18 2018 Page 1

ID:w3K2IB2K4fGk9tDO7SkJphylfMC-qHKzV_3cCSNN_n9IZbhlFBUjyyevebRzG6R0AzP9CF

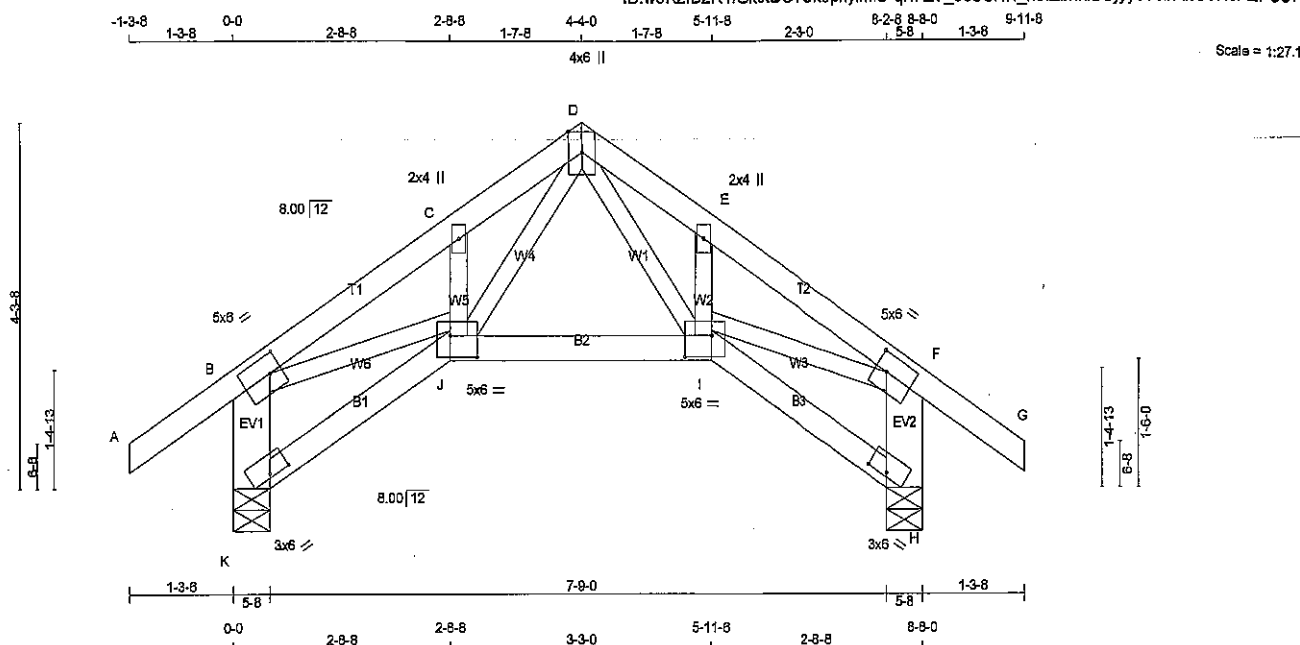

TOTAL WEIGHT = 2 X 41 = 82 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
K - B	2x6	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x6	DRY	No.2
K - J	2x4	DRY	No.2
J - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	5.0	6.0	2.50	1.75
C	TMVW-w	MT20	2.0	4.0		
D	TTWW+p	MT20	4.0	6.0	Edge	
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-I	MT20	5.0	6.0	2.50	1.75
H	BVM1-I	MT20	3.0	6.0	0.50	3.00
I	BBWWW-p	MT20	5.0	6.0	3.00	4.00
J	BBWWW-p	MT20	5.0	6.0	3.00	4.00
K	BVM1-I	MT20	3.0	6.0	0.50	3.00

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
K	802	0	602	0
H	602	0	602	0

UNFACTORED REACTIONS

	1ST LCASE	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
JT	COMBINED						
K	478	292 / 0	91 / 0	0 / 0	0 / 0	95 / 0	0 / 0
H	478	292 / 0	91 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED MEMB. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)	MAX. FACTORED VERT. LOAD LC2 (LC)	MAX. FACTORED VERT. LOAD LC3 (LC)	MAX. FACTORED VERT. LOAD LC4 (LC)	MAX. FACTORED VERT. LOAD LC5 (LC)	MAX. FACTORED VERT. LOAD LC6 (LC)	MAX. FACTORED VERT. LOAD LC7 (LC)	MAX. FACTORED VERT. LOAD LC8 (LC)	MAX. FACTORED VERT. LOAD LC9 (LC)	MAX. FACTORED VERT. LOAD LC10 (LC)
FR-TO		FROM	TO									
K-B	-564 / 0	0.0	0.0	0.04 (1)	7.81	D-I	0 / 480	0.11 (1)				
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	I-E	-209 / 0	0.03 (1)				
B-C	-808 / 0	-84.3	-84.3	0.09 (1)	6.25	I-F	0 / 685	0.15 (1)				
C-D	-825 / 0	-84.3	-84.3	0.03 (1)	6.25	J-D	0 / 480	0.11 (1)				
D-E	-825 / 0	-84.3	-84.3	0.03 (1)	6.25	J-C	-209 / 0	0.03 (1)				
E-F	-808 / 0	-84.3	-84.3	0.09 (1)	6.25	B-J	0 / 685	0.15 (1)				
F-G	0 / 32	-84.3	-84.3	0.11 (1)	10.00							
H-F	-564 / 0	0.0	0.0	0.04 (1)	7.81							
K-J	0 / 0	-28.0	-28.0	0.06 (3)	10.00							
J-I	0 / 414	-28.0	-28.0	0.13 (2)	10.00							
I-H	0 / 0	-28.0	-28.0	0.06 (3)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.8	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/899 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.11/1.00 (F-G:1), BC=0.13/1.00 (I-J:2), WB=0.15/1.00 (B-J:1), SS=0.09/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.23 (B) (INPUT = 1.00)

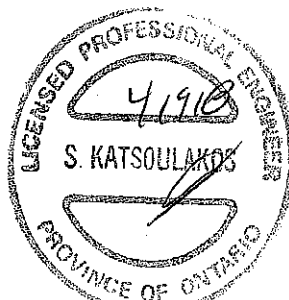


DRWG NO. TAM 21195-012
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285800	T600	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.200 S Jan 6 2018 MITek Industries, Inc. Thu Apr 19 13:29:18 2018 Page 1
ID:w3K2IB2K4fGk9ID07SkJphylfMC-qHKzV_3cCSNN_n9I2bhl#BSJyyMvf_RzG6R0AzP9CF

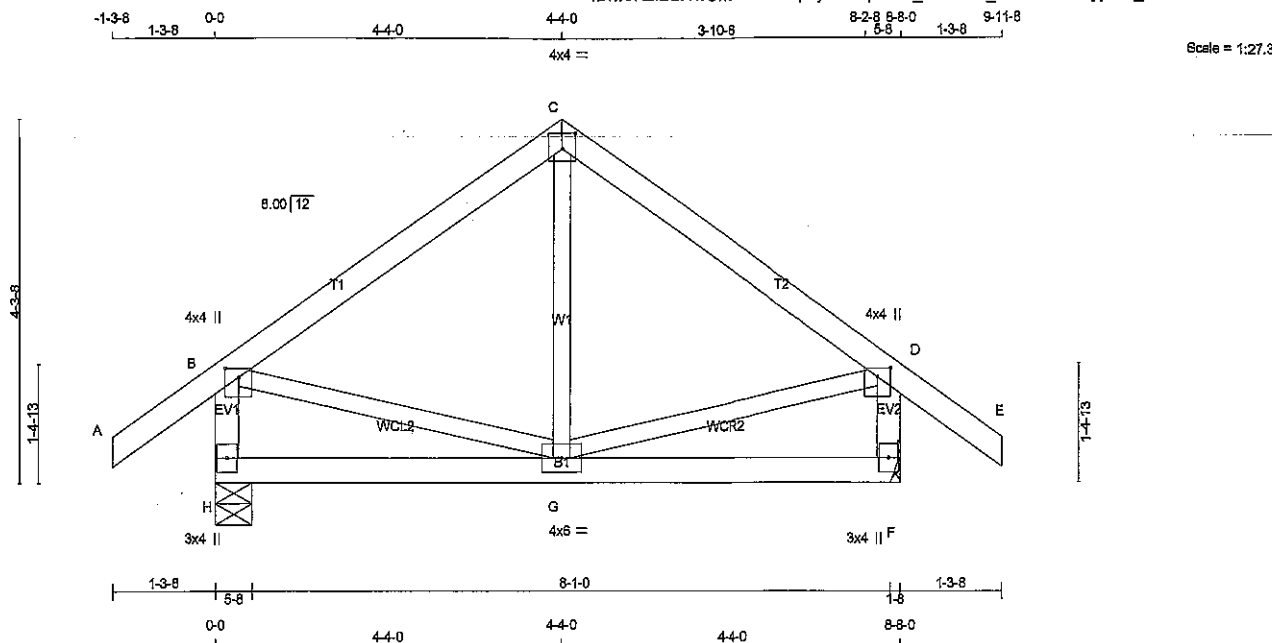

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
C	TTW-p	MT20	4.0	4.0	2.25 2.00
D	TMVW+p	MT20	4.0	4.0	1.25 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMVW+1	MT20	4.0	6.0	
H	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED			MAXIMUM FACTORED			INPUT	REQD
JT	GROSS REACTION		GROSS REACTION			BRG	BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	602	0	602	0	0	5-8	5-8
F	602	0	602	0	0	HANGER BY OTHERS	
						MIN. SEAT SIZE: 1-8	

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	478	292 / 0	91 / 0	0 / 0	0 / 0	95 / 0	0 / 0	0 / 0
F	478	292 / 0	91 / 0	0 / 0	0 / 0	95 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		MAX. FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX	MAX. UNBRAC	LENGTH	MEMB.	FORCE (LBS)	MAX. UNBRAC	LENGTH
FR-TO		FROM	TO	CS1 (LC)		FR-TO		FROM	TO
A-B	0 / 32	-84.3	-84.3	0.11 (1)	10.00	G-C	0 / 183	0.04 (3)	
B-C	-337 / 0	-84.3	-84.3	0.20 (1)	6.25	B-G	0 / 289	0.07 (1)	
C-D	-337 / 0	-84.3	-84.3	0.20 (1)	6.25	G-D	0 / 289	0.07 (1)	
D-E	0 / 32	-84.3	-84.3	0.11 (1)	10.00				
H-B	-555 / 0	0.0	0.0	0.08 (1)	7.81				
F-D	-555 / 0	0.0	0.0	0.08 (1)	7.81				
H-G	0 / 0	-28.0	-28.0	0.15 (3)	10.00				
G-F	0 / 0	-28.0	-28.0	0.15 (3)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 48.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 085-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.20/1.00 (C-D:1), BC=0.15/1.00 (F-G:3),
WB=0.07/1.00 (B-G:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.41 (G) (INPUT = 0.80)
JSI METAL= 0.12 (B) (INPUT = 1.00)




DWG NO. TAM 21196-18
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43854	DRWG NO.
285799	T610	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed Sep 06 15:07:39 2017 Page 1
ID:w3K2IB2K4fGk9tDO7SkJphylfMC-K96M89cfsmMldDadydS8tzeZ1VkjZdq17188gNygKS2

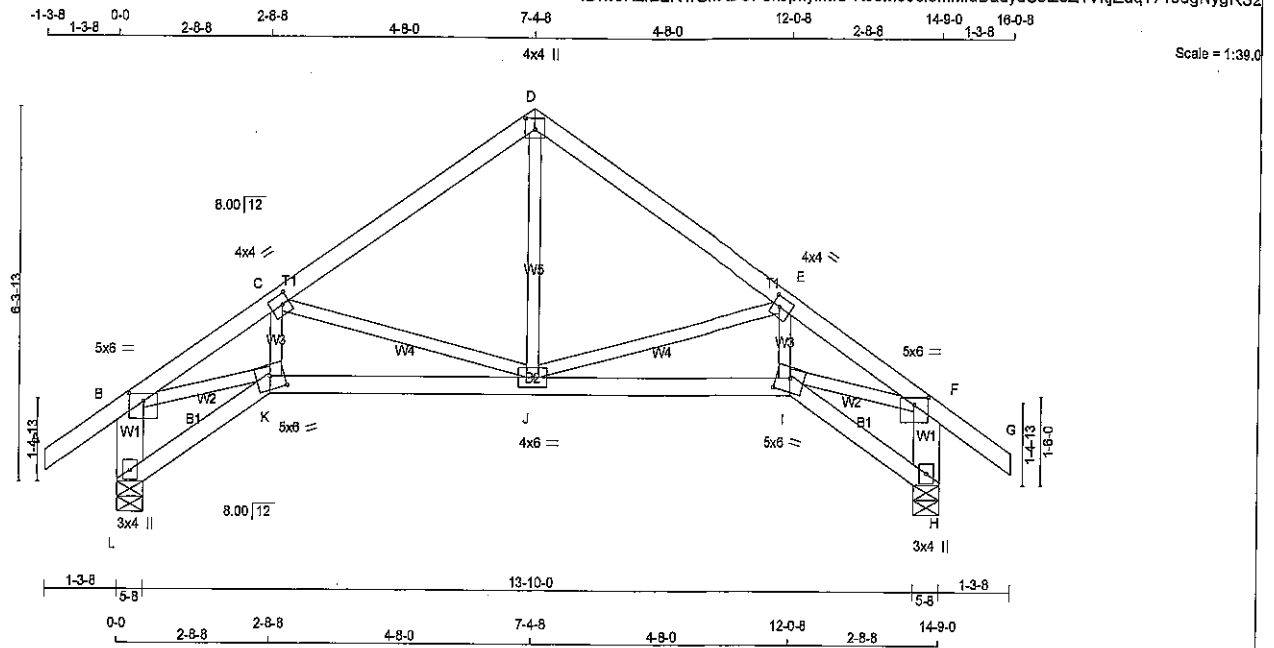

TOTAL WEIGHT = 2 X 64 = 127 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
L - B	2x6	DRY	No.2
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
H - F	2x6	DRY	No.2
L - K	2x4	DRY	No.2
K - I	2x4	DRY	No.2
I - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	6.0	1.50 3.00
C	TMWW-t	MT20	4.0	4.0	2.00 1.50
D	TTW+p	MT20	4.0	4.0	2.25 2.00
E	TMWW-t	MT20	4.0	4.0	2.00 1.50
F	TMWV-p	MT20	5.0	6.0	1.50 3.00
H	BMV1+p	MT20	3.0	4.0	
I	BBWW-m	MT20	5.0	6.0	2.75 3.00
J	BMWWV-t	MT20	4.0	6.0	
K	BBWW-m	MT20	5.0	6.0	2.75 3.00
L	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	BRG	IN-SX	IN-SX	
L	944	0	944	0	0	5-8	5-8	5-8	
H	944	0	944	0	0	5-8	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN	COMPONENT REACTIONS						
L	758	448 / 0	155 / 0	0 / 0	0 / 0	158 / 0	0 / 0	0 / 0	
H	758	448 / 0	155 / 0	0 / 0	0 / 0	158 / 0	0 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
L-B	-908 / 0	0.0	0.0 0.06 (1)	J-D	0 / 598	0.13 (1)	
A-B	0 / 32	-84.3	-84.3 0.11 (1)	J-E	-732 / 0	0.28 (1)	
B-C	-1676 / 0	-84.3	-84.3 0.16 (1)	I-E	0 / 320	0.07 (1)	
C-D	-851 / 0	-84.3	-84.3 0.22 (1)	I-F	0 / 1434	0.32 (1)	
D-E	-851 / 0	-84.3	-84.3 0.22 (1)	C-J	-732 / 0	0.28 (1)	
E-F	-1676 / 0	-84.3	-84.3 0.16 (1)	K-C	0 / 320	0.07 (1)	
F-G	0 / 32	-84.3	-84.3 0.11 (1)	B-K	0 / 1434	0.32 (1)	
H-F	-908 / 0	0.0	0.0 0.06 (1)				
L-K	0 / 0	-28.0	-28.0 0.06 (2)				
K-J	0 / 1392	-28.0	-28.0 0.33 (2)				
J-I	0 / 1392	-28.0	-28.0 0.33 (2)				
I-H	0 / 0	-28.0	-28.0 0.06 (2)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.49")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.49")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.22 (C-D:1), BC=0.33 (I-J:2), WB=0.32 (F-I:1), SSI=0.14 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (B) (INPUT = 0.90)
JSI METAL= 0.35 (I) (INPUT = 1.00)




DWG NO. TAM 50068-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T620	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MITek Industries, Inc. Wed Sep 08 15:07:40 2017 - Page 1

ID:PFehc1Ba2cOYemTQTAYm6Oyl1EX-oMgkMVdHd4U9FN9qWkzNQABefv4XlwRALhrhCpygKS1

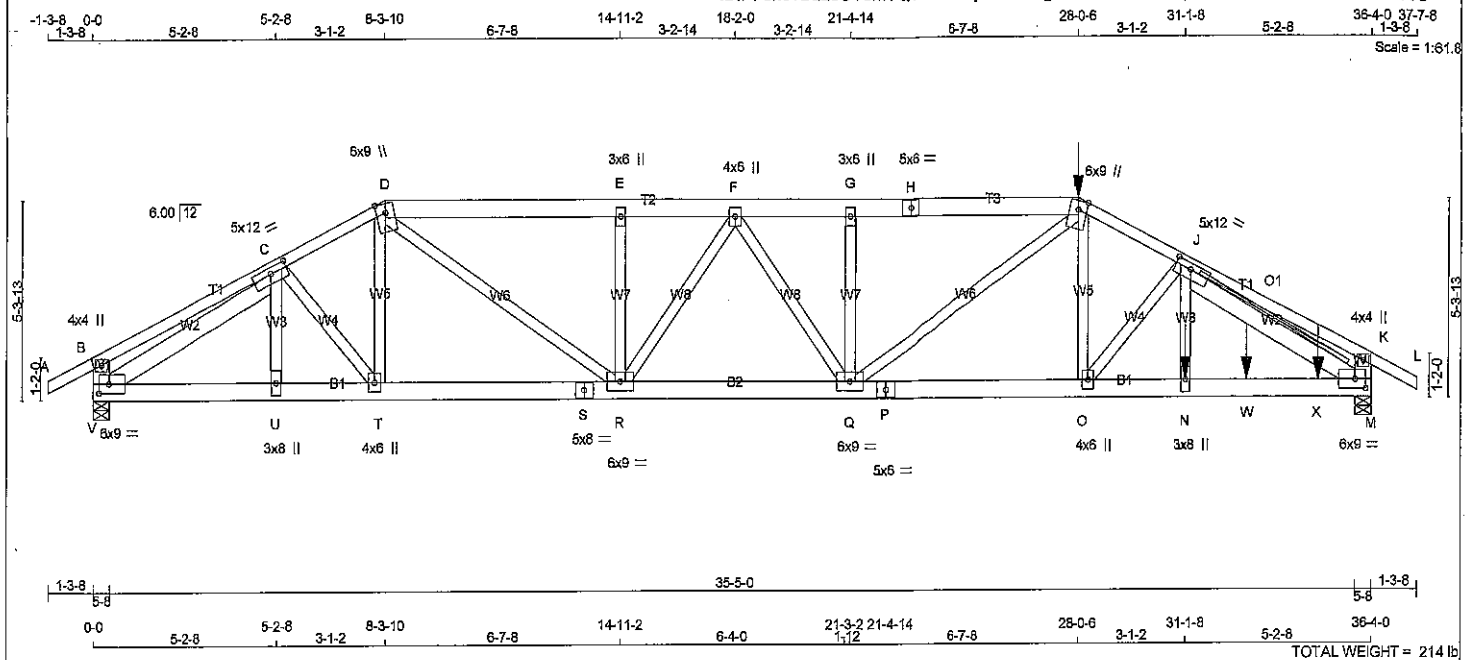

TOTAL WEIGHT = 214 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - H	2x6	DRY	No.2
H - I	2x6	DRY	No.2
I - L	2x4	DRY	No.2
V - B	2x6	DRY	No.2
M - K	2x6	DRY	No.2
V - S	2x6	DRY	2100F 1.8E
S - P	2x6	DRY	2100F 1.8E
P - M	2x6	DRY	2100F 1.8E
ALL WEBS EXCEPT	2x4	DRY	No.2
V - C	2x6	DRY	No.2
J - M	2x6	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	4.0	4.0	
C	TMVWW+I	MT20	5.0	12.0	2.00 5.50
D	TTWW+m	MT20	6.0	9.0	Edge
E	TMV+w	MT20	3.0	8.0	
F	TMVWW+I	MT20	4.0	6.0	
G	TMV+w	MT20	3.0	6.0	
H	TS-I	MT20	5.0	6.0	
I	TTWW+m	MT20	6.0	9.0	Edge
J	TMVWW+I	MT20	5.0	12.0	2.00 5.50
K	TMV+p	MT20	4.0	4.0	
M	BMVW+I	MT20	6.0	9.0	3.00 3.50
N	BMV+w	MT20	3.0	6.0	
O	BMVWW+I	MT20	4.0	6.0	
P	BS-I	MT20	5.0	6.0	
Q	BMVWW+I	MT20	6.0	9.0	
R	BMVWW+I	MT20	6.0	9.0	
S	BS-I	MT20	5.0	6.0	
T	BMVWW+I	MT20	4.0	8.0	
U	BMV+w	MT20	3.0	8.0	
V	BMVW+I	MT20	6.0	9.0	3.00 3.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

- SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 498.5 lbs FACTORED DOWN AT 28'-0.6 ON TOP CHORD, AND 1243.8 lbs FACTORED DOWN AT 31'-1.8, AND 71.7 lbs FACTORED DOWN AT 32'-10.4, AND 71.7 lbs FACTORED DOWN AT 34'-10.4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
V	2452	0	2452	0
M	3681	0	3681	0

UNFACTORED REACTIONS

	1ST LCASE	MAX / MIN	COMPONENT REACTIONS				
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
V	1978	1154 / 0	413 / 0	0 / 0	0 / 0	411 / 0	0 / 0
M	2956	1748 / 0	602 / 0	0 / 0	0 / 0	605 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.56 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT J-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 8" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.3 -84.3	0.12 (1)	U-C	0 / 173	0.03 (3)	
B-C	0 / 16	-84.3 -84.3	0.30 (1)	C-T	0 / 32	0.01 (3)	
C-D	-3589 / 0	-84.3 -84.3	0.48 (1)	T-D	0 / 264	0.05 (2)	
D-E	-4668 / 0	-84.3 -84.3	0.43 (1)	D-R	0 / 1833	0.32 (1)	
E-F	-4668 / 0	-84.3 -84.3	0.34 (1)	R-E	-578 / 0	0.16 (1)	
F-G	-5072 / 0	-84.3 -84.3	0.38 (1)	Q-G	-591 / 0	0.18 (1)	
G-H	-5071 / 0	-84.3 -84.3	0.47 (1)	Q-I	0 / 845	0.15 (1)	
H-I	-5071 / 0	-84.3 -84.3	0.47 (1)	C-I	0 / 877	0.18 (1)	
I-J	-4944 / 0	-84.3 -84.3	0.62 (1)	O-J	-688 / 0	0.20 (1)	
J-K	0 / 15	-84.3 -84.3	0.31 (1)	N-J	0 / 1291	0.23 (1)	
K-L	0 / 28	-84.3 -84.3	0.12 (1)	V-C	-3801 / 0	1.00 (1)	
V-B	-297 / 0	0.0 0.0	0.02 (1)	J-M	-5948 / 0	0.92 (1)	
M-K	-301 / 0	0.0 0.0	0.02 (1)	R-F	-405 / 0	0.16 (1)	
				F-Q	0 / 323	0.05 (1)	
V-U	0 / 3189	-28.0 -28.0	0.22 (1)				
U-T	0 / 3189	-28.0 -28.0	0.21 (1)				
T-S	0 / 3194	-28.0 -28.0	0.21 (1)				
S-R	0 / 3194	-28.0 -28.0	0.21 (1)				
R-Q	0 / 4893	-28.0 -28.0	0.30 (1)				
Q-P	0 / 4393	-28.0 -28.0	0.27 (1)				
P-O	0 / 4393	-28.0 -28.0	0.27 (1)				
O-N	0 / 4988	-28.0 -28.0	0.32 (1)				
N-W	0 / 4990	-28.0 -28.0	0.36 (1)				
W-X	0 / 4980	-28.0 -28.0	0.36 (1)				
X-M	0 / 4990	-28.0 -28.0	0.36 (1)				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
I	28'-0.6	-45	-50		FRONT	VERT	DEAD
I	28'-0.6	-455	-455		FRONT	VERT	SNOW
N	31'-1.8	-1244	-1244		FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	48.1	PSF

SPACING = 24.0 IN. GIC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = U/999 (0.24")
ALLOWABLE DEFL.(TL) = L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = U/999 (0.38")

CSI: TC=0.62 (I-J:1), BC=0.36 (M-N:1), WB=1.00 (C-V:1), SSI=0.23 (G-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR	SECTION
(PSI)	(PLI)
MAX MIN	MAX MIN
MT20	618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)
JSI METAL= 0.98 (C) (INPUT = 1.00)

OWN NO. TAM 50069-17

STRUCTURAL
COMPONENT ONLY

CONTINUED ON PAGE 2




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T620	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington


Version 8.030 S.Oct 5 2016 Mittek Industries, Inc. Wed Sep 06 15:07:40 2017 Page 2

ID:PFehc1Ba2cOYemTQTAYm6Oyl1EX-oMgkMvDhd4U9FN9qWKzNQABefv4XlwRALhrhCpygKS1

FACTORED CONCENTRATED LOADS (LBS)						
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.
W	32-10-4	-41	-72	---	FRONT	VERT
X	34-10-4	-41	-72	---	FRONT	VERT
						TYPE
						TOTAL
						TOTAL

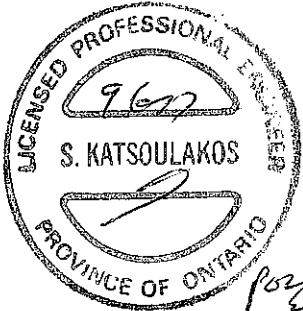

DWG NO. TAM 50069-17
 STRUCTURAL
 COMPONENT ONLY

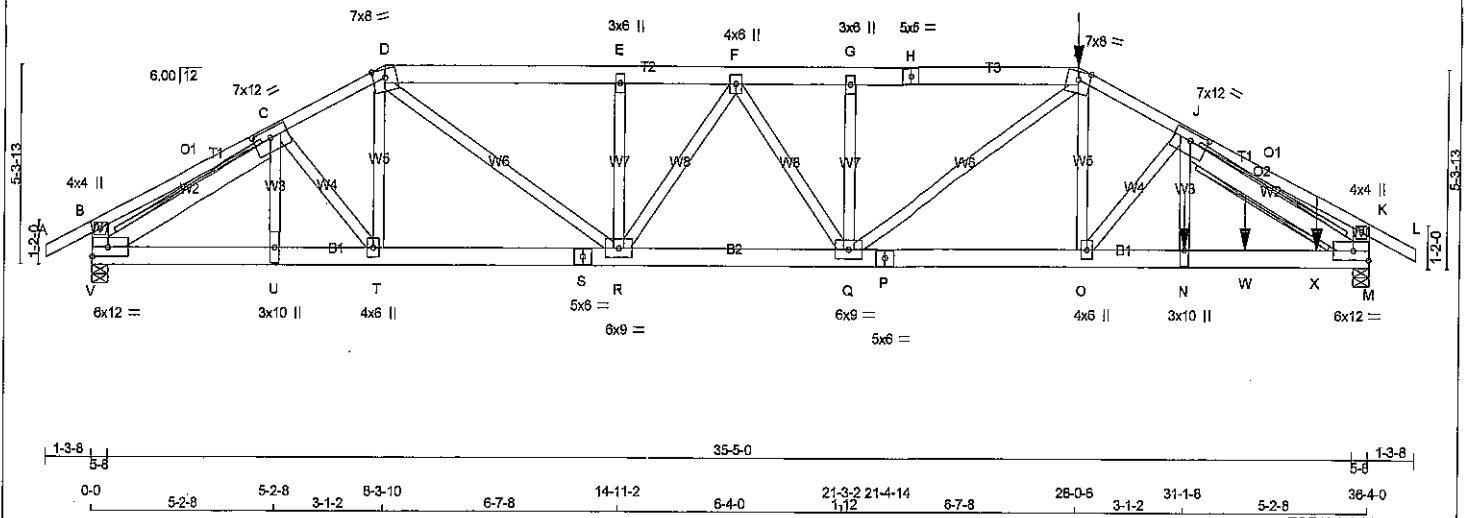

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - H	2x8	DRY No.2	SPF
H - I	2x8	DRY No.2	SPF
I - L	2x4	DRY No.2	SPF
V - B	2x6	DRY No.2	SPF
M - K	2x8	DRY No.2	SPF
V - S	2x6	DRY 2100F 1.8E	SPF
S - P	2x8	DRY 2100F 1.8E	SPF
P - M	2x6	DRY 2100F 1.8E	SPF
ALL WEBS EXCEPT	2x4	DRY No.2	SPF
V - C	2x8	DRY No.2	SPF
J - M	2x6	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	4.0	4.0		
C	TMVWW-t	MT20	7.0	12.0	2.75	5.75
D	TTWW-m	MT20	7.0	8.0	Edge	
E	TMV+w	MT20	3.0	6.0		
F	TMVWW-t	MT20	4.0	6.0		
G	TMV+w	MT20	3.0	6.0		
H	TS-t	MT20	5.0	6.0		
I	TTWW-m	MT20	7.0	8.0	Edge	
J	TMVWW-t	MT20	7.0	12.0	2.75	5.75
K	TMV+p	MT20	4.0	4.0		
M	BMVW1-t	MT20	6.0	12.0	3.00	5.25
N	BMV+w	MT20	3.0	10.0		
O	BMVWW-t	MT20	4.0	6.0		
P	BS-t	MT20	5.0	6.0		
Q	BMVWW-t	MT20	6.0	9.0		
R	BMVWW-t	MT20	6.0	9.0		
S	BS-t	MT20	5.0	6.0		
T	BMVWW-t	MT20	4.0	6.0		
U	BMV+w	MT20	3.0	10.0		
V	BMVW1-t	MT20	6.0	12.0	3.00	5.25

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 499.5 lbs FACTORED DOWN AT 28-0-6 ON TOP CHORD, AND 2301.0 lbs FACTORED DOWN AT 31-1-8, AND 87.5 lbs FACTORED DOWN AT 32-10-4, AND 87.5 lbs FACTORED DOWN AT 34-10-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE FABRICATOR.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
V	2607	0	2607	0	5-8	5-8
M	4840	0	4840	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
V	2108	1225 / 0	442 / 0	0 / 0	0 / 0	439 / 0	0 / 0	0 / 0
M	3743	2186 / 0	780 / 0	0 / 0	0 / 0	777 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.14 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT C-V

2x4 DRY SPF No.2 I-BRACE AT J-M

FASTEN T AND I-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0 / 26	-84.3	-84.3	0.12 (1)	10.00	U-C	0 / 189	0.03 (3)	
B-C	0 / 16	-84.3	-84.3	0.30 (1)	10.00	C-T	0 / 62	0.01 (2)	
C-D	-3883 / 0	-84.3	-84.3	0.51 (1)	3.05	T-D	0 / 245	0.04 (2)	
D-E	-5143 / 0	-84.3	-84.3	0.47 (1)	3.47	D-R	0 / 2094	0.37 (1)	
E-F	-5143 / 0	-84.3	-84.3	0.36 (1)	3.54	R-E	-578 / 0	0.16 (1)	
F-G	-5758 / 0	-84.3	-84.3	0.42 (1)	3.29	Q-G	-594 / 0	0.18 (1)	
G-H	-5755 / 0	-84.3	-84.3	0.54 (1)	3.22	Q-I	0 / 585	0.10 (1)	
H-I	-5755 / 0	-84.3	-84.3	0.54 (1)	3.22	O-I	0 / 1475	0.26 (1)	
I-J	-5955 / 0	-84.3	-84.3	0.74 (1)	2.14	O-J	-1624 / 0	0.38 (1)	
J-K	0 / 13	-84.3	-84.3	0.32 (1)	10.00	N-J	0 / 2336	0.41 (1)	
K-L	0 / 26	-84.3	-84.3	0.12 (1)	10.00	V-C	-4084 / 0	0.63 (1)	
V-B	-297 / 0	0.0	0.0	0.02 (1)	7.81	J-M	-7625 / 0	0.98 (1)	
M-K	-304 / 0	0.0	0.0	0.02 (1)	7.81	R-F	-594 / 0	0.24 (1)	
						F-Q	0 / 511	0.09 (1)	
V-U	0 / 3428	-28.0	-28.0	0.23 (1)	10.00				
U-T	0 / 3426	-28.0	-28.0	0.22 (1)	10.00				
T-S	0 / 3459	-28.0	-28.0	0.23 (1)	10.00				
S-R	0 / 3459	-28.0	-28.0	0.23 (1)	10.00				
R-Q	0 / 5472	-28.0	-28.0	0.33 (1)	10.00				
Q-P	0 / 5285	-28.0	-28.0	0.32 (1)	10.00				
P-O	0 / 5285	-28.0	-28.0	0.32 (1)	10.00				
O-N	0 / 6398	-28.0	-28.0	0.42 (1)	10.00				
N-W	0 / 6397	-28.0	-28.0	0.47 (1)	10.00				
W-X	0 / 8397	-28.0	-28.0	0.47 (1)	10.00				
X-M	0 / 6397	-28.0	-28.0	0.47 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
I	28-0-6	-45	-50	---	FRONT	VERT	DEAD
I	28-0-6	-455	-455	---	FRONT	VERT	SNOW

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF

DL = 3.0 PSF

BOT CH. LL = 10.5 PSF

DL = 7.0 PSF

TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2012, CBC 2012, A9C 2014

- CSA 086-09

- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")

CALCULATED VERT. DEFL.(LL) = L/999 (0.27")

ALLOWABLE DEFL.(TL) = L/360 (1.21")

CALCULATED VERT. DEFL.(TL) = L/999 (0.43")

CSI: TO=0.74 (I-J:1), BC=0.47 (M-N:1), WB=0.88 (J-M:1), SS=0.23 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618	354	1887 822 2284 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (M) (INPUT = 0.90)

JSI METAL= 0.99 (C) (INPUT = 1.00)

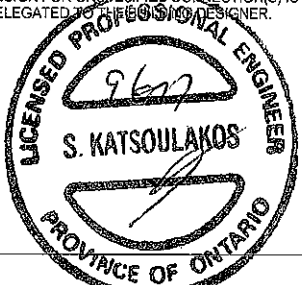


DRW NO. TAM 50070-17

STRUCTURAL

COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T620Z	1	1	TRUSS DESC.		
Tamarack Roof Truss, Burlington				Version 8.030 S Oct 5 2018 MITek Industries, Inc. Wed Sep 06 15:07:40 2017 Page 2		
ID:PFehc1Ba2cOYemTQTAYm6Oyi1EX-oMgkMVdHd4U9FN9qWkzNQABcgv2olwsALhnhCpygKS1						

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
N	31-1-8	-2301	-2301	---	BACK	VERT	TOTAL
W	32-10-4	-70	-88	---	BACK	VERT	TOTAL
X	34-10-4	-70	-88	---	BACK	VERT	TOTAL

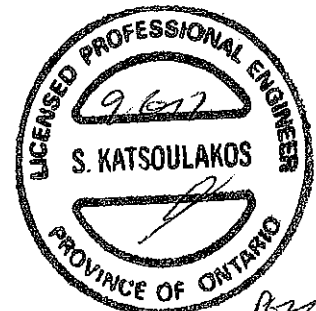


DWG NO. TAM 50070-17
 STRUCTURAL
 COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T630	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed Sep 06 15:07:40 2017...Page 1

ID:w3K2IB2K4fGk9tD07SkJphylfMC-oMgkMVdHd4U9FN9qVKzNQABb9v0xIOALhthCpygKS1

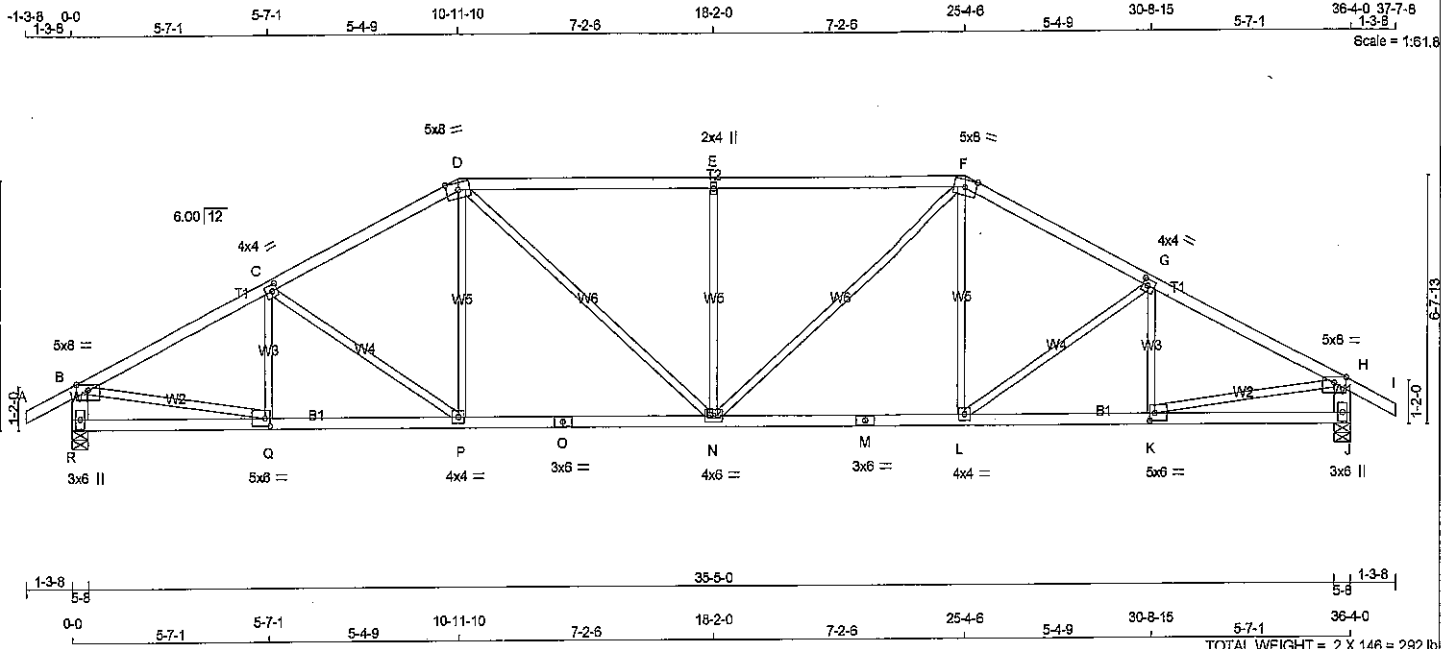

TOTAL WEIGHT = 2 X 146 = 292 lb [M/F]

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
R - B	2x6	DRY No.2	SPF
J - H	2x6	DRY No.2	SPF
R - O	2x4	DRY No.2	SPF
O - M	2x4	DRY No.2	SPF
M - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	
C	TMWW-t	MT20	4.0	4.0	2.00 1.75	
D	TTWW-m	MT20	5.0	8.0	Edge	
E	TMW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	Edge	
G	TMWW-t	MT20	4.0	4.0	2.00 1.75	
H	TMVW-p	MT20	5.0	8.0	Edge	
J	BMV1+p	MT20	3.0	8.0		
K	BMWW-t	MT20	5.0	6.0	2.50 1.75	
L	BMWW-t	MT20	4.0	4.0		
M	BS-t	MT20	3.0	6.0		
N	BMWWH-t	MT20	4.0	6.0		
O	BS-t	MT20	3.0	6.0		
P	BMWW-t	MT20	4.0	4.0		
Q	BMWW-t	MT20	5.0	6.0	2.50 1.75	
R	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2154	0	2154	0
J	2154	0	2154	0

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1752	998 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0
J	1752	998 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.3 -84.3	0.11 (1)	10.00	Q-C	-283 / 80	0.06 (1)
B-C	-3033 / 0	-84.3 -84.3	0.48 (1)	3.83	C-P	-317 / 0	0.25 (1)
C-D	-2787 / 0	-84.3 -84.3	0.44 (1)	3.80	P-D	0 / 422	0.10 (2)
D-E	-3013 / 0	-84.3 -84.3	0.78 (1)	3.22	D-N	0 / 718	0.16 (1)
E-F	-3013 / 0	-84.3 -84.3	0.78 (1)	3.22	N-E	-746 / 0	0.55 (1)
F-G	-2787 / 0	-84.3 -84.3	0.44 (1)	3.80	N-F	0 / 718	0.16 (1)
G-H	-3033 / 0	-84.3 -84.3	0.48 (1)	3.83	L-F	0 / 422	0.10 (2)
H-I	0 / 26	-84.3 -84.3	0.11 (1)	10.00	L-G	-317 / 0	0.25 (1)
R-B	-2085 / 0	0.0 0.0	0.13 (1)	7.03	K-G	-283 / 80	0.06 (1)
J-H	-2085 / 0	0.0 0.0	0.13 (1)	7.03	B-Q	0 / 2765	0.82 (1)
					K-H	0 / 2765	0.82 (1)
R-Q	0 / 0	-28.0 -28.0	0.18 (2)	10.00			
Q-P	0 / 2733	-28.0 -28.0	0.57 (1)	10.00			
P-O	0 / 2475	-28.0 -28.0	0.59 (2)	10.00			
O-N	0 / 2475	-28.0 -28.0	0.59 (2)	10.00			
N-M	0 / 2475	-28.0 -28.0	0.59 (2)	10.00			
M-L	0 / 2475	-28.0 -28.0	0.59 (2)	10.00			
L-K	0 / 2733	-28.0 -28.0	0.57 (1)	10.00			
K-J	0 / 0	-28.0 -28.0	0.18 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 25.6 PSF
	DL	= 3.0 PSF
BOT CH.	LL	= 10.5 PSF
	DL	= 7.0 PSF
TOTAL LOAD		= 46.1 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.22")
ALLOWABLE DEFL.(TL)= L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.36")

CSI: TC=0.78 (D-E:1), BC=0.59 (N-P:2), WB=0.62 (B-Q:1), SS=0.29 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (N) (INPUT = 0.90)
JSI METAL= 0.76 (M) (INPUT = 1.00)

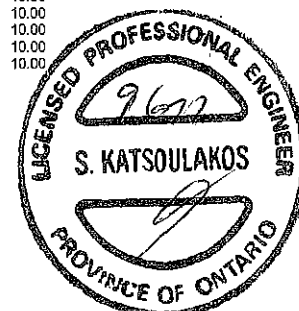


DRWG NO. TAM 50071-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T640	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MiTek Industries, Inc. Wed Sep 06 15:07:41 2017. Page 1

ID:w3K2IB2K4fGk9DO7SkJphyfMC-HYD6ZrevONc0tWj042UczOkmuJLa1QcKaLbFkFygKSO

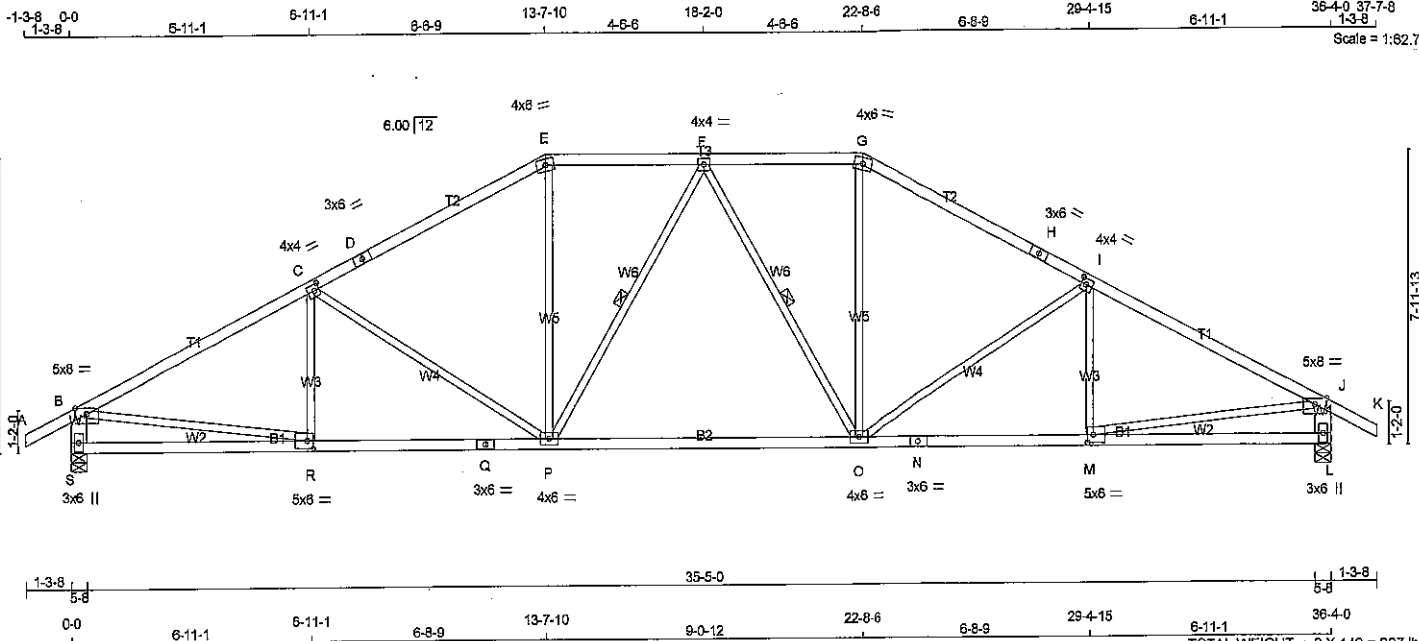

Scale = 1:62.7

TOTAL WEIGHT = 2 X 149 = 297 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x6	DRY	No.2
L - J	2x8	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge
C	TMVW-t	MT20	4.0	4.0	2.00 1.75
D	TS-t	MT20	3.0	6.0	
E	TTW-m	MT20	4.0	6.0	
F	TMVW-t	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	6.0	
H	TS-t	MT20	3.0	6.0	
I	TMVW-t	MT20	4.0	4.0	2.00 1.75
J	TMVW-p	MT20	5.0	8.0	Edge
L	BMV1+p	MT20	3.0	6.0	
M	BMVW-t	MT20	5.0	6.0	2.50 2.00
N	BS-t	MT20	3.0	6.0	
O	BMVW-t	MT20	4.0	6.0	
P	BMVW-t	MT20	4.0	6.0	
Q	BS-t	MT20	3.0	6.0	
R	BMVW-t	MT20	5.0	6.0	2.50 2.00
S	BMV1+p	MT20	3.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD IN-SX	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
S	2154	0	2154	0	0	5-8	5-8	
L	2154	0	2154	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LCASE		MAX /MIN. COMPONENT REACTIONS		LIVE	PERM.LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	SNOW	LIVE					
S	1752	999 / 0	382 / 0	0 / 0	0 / 0	0 / 0	371 / 0	0 / 0	0 / 0
L	1752	999 / 0	382 / 0	0 / 0	0 / 0	0 / 0	371 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-P, F-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

FR-TO	CHORDS		FACTORED		MAX. FACTORED		MEMB.		WEB S		MAX. FACTORED	
	MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (PLF)	CS1 (LC)	UNBRAC LENGTH	MEMB.	FORCE (LBS)	CS1 (LC)	MEMB.	FORCE (LBS)	CS1 (LC)
A-B	0 / 26	-84.3	-84.3	0.11 (1)	10.00	R-C	-148 / 185	0.05 (1)		R-C	-148 / 185	0.05 (1)
B-C	-3074 / 0	-84.3	-84.3	0.78 (1)	3.28	C-P	-593 / 0	0.82 (1)		C-P	-593 / 0	0.82 (1)
C-D	-2576 / 0	-84.3	-84.3	0.67 (1)	3.64	P-E	0 / 775	0.17 (1)		P-E	0 / 775	0.17 (1)
D-E	-2576 / 0	-84.3	-84.3	0.67 (1)	3.64	F-F	-285 / 0	0.15 (1)		F-F	-285 / 0	0.15 (1)
E-F	-2285 / 0	-84.3	-84.3	0.27 (1)	4.29	F-O	-285 / 0	0.15 (1)		F-O	-285 / 0	0.15 (1)
F-G	-2285 / 0	-84.3	-84.3	0.27 (1)	4.29	O-G	0 / 775	0.17 (1)		O-G	0 / 775	0.17 (1)
G-H	-2576 / 0	-84.3	-84.3	0.67 (1)	3.64	O-I	-593 / 0	0.82 (1)		O-I	-593 / 0	0.82 (1)
H-I	-2576 / 0	-84.3	-84.3	0.67 (1)	3.64	M-I	-148 / 185	0.05 (1)		M-I	-148 / 185	0.05 (1)
I-J	-3074 / 0	-84.3	-84.3	0.78 (1)	3.28	B-R	0 / 2797	0.63 (1)		B-R	0 / 2797	0.63 (1)
J-K	0 / 26	-84.3	-84.3	0.11 (1)	10.00	M-J	0 / 2797	0.63 (1)		M-J	0 / 2797	0.63 (1)
S-B	-2071 / 0	0.0	0.0	0.13 (1)	7.05							
L-J	-2071 / 0	0.0	0.0	0.13 (1)	7.05							
S-R	0 / 0	-28.0	-28.0	0.28 (3)	10.00							
R-Q	0 / 2776	-28.0	-28.0	0.69 (2)	10.00							
Q-P	0 / 2776	-28.0	-28.0	0.69 (2)	10.00							
P-O	0 / 2418	-28.0	-28.0	0.65 (2)	10.00							
O-N	0 / 2776	-28.0	-28.0	0.69 (2)	10.00							
N-M	0 / 2776	-28.0	-28.0	0.69 (2)	10.00							
M-L	0 / 0	-28.0	-28.0	0.28 (3)	10.00							

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. GIC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.27")
ALLOWABLE DEFL.(TL)= L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = 1/985 (0.44")

CSI: TC=0.78 (B-C:1), BC=0.69 (P-R:2), WB=0.82 (C-P:1), SSI=0.25 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)
JSI METAL= 0.71 (N) (INPUT = 1.00)




DWG NO. TAN 50072-17
STRUCTURAL
COMPONENT ONLY

JOB NAME 285799	TRUSS NAME T650	QUANTITY 2	PLY 1	JOB DESC. 43954	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 Mitek Industries, Inc. Wed Sep 06 15:07:41 2017 Page 1

ID: w3K2lB2K4fGk9DO7SkJphylfMC-HYD6ZrevONc0Wj042UczOksaJJ01OJKaLbFkFygKSO

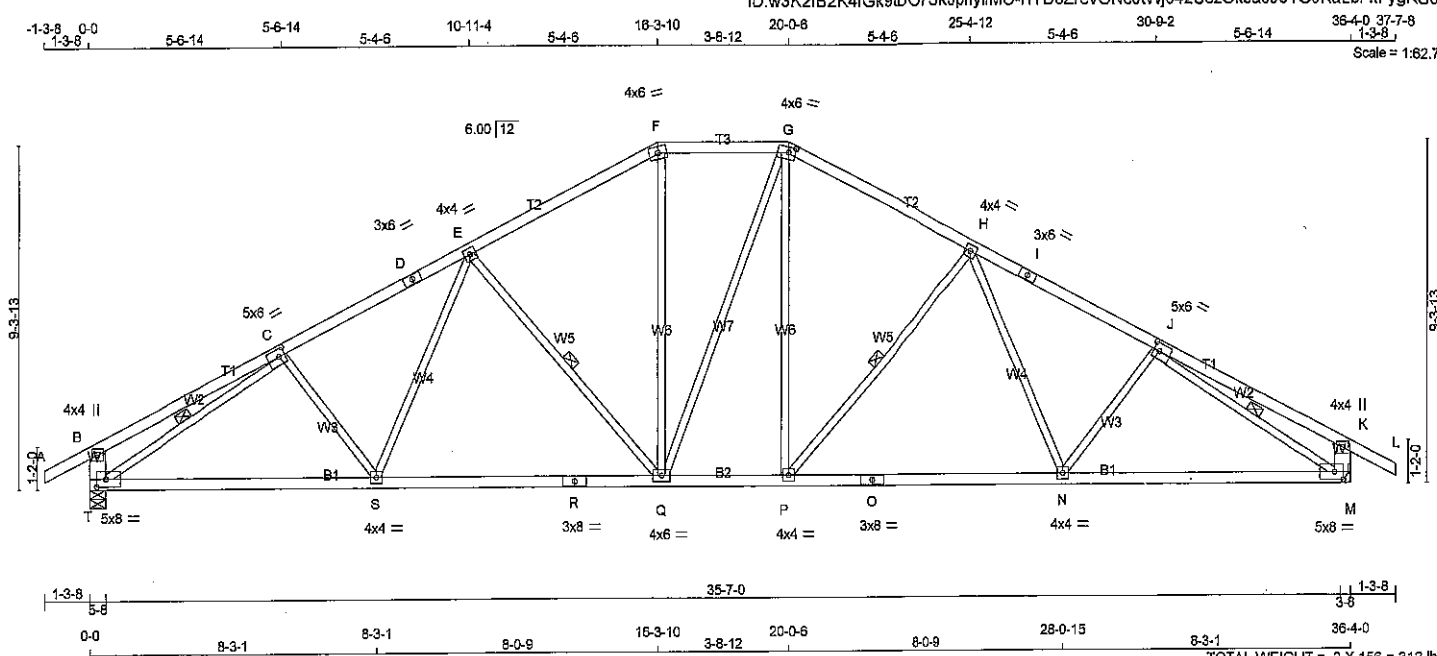

TOTAL WEIGHT = 2 X 156 = 312 lb

LUMBER		CHORDS		SIZE		LUMBER	
A - D	2x4	DRY	No.2	SPF			
D - F	2x4	DRY	No.2	SPF			
F - G	2x4	DRY	No.2	SPF			
G - I	2x4	DRY	No.2	SPF			
I - L	2x4	DRY	No.2	SPF			
T - B	2x6	DRY	No.2	SPF			
M - K	2x6	DRY	No.2	SPF			
T - R	2x4	DRY	No.2	SPF			
R - O	2x4	DRY	No.2	SPF			
O - M	2x4	DRY	No.2	SPF			

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY, SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	4.0	4.0		
C	TMWW-t	MT20	5.0	6.0	2.50	2.00
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTW-m	MT20	4.0	6.0		
G	TTWW-m	MT20	4.0	6.0	1.75	2.25
H	TMWW-t	MT20	4.0	4.0		
I	TS-t	MT20	3.0	6.0		
J	TMWW-t	MT20	5.0	6.0	2.50	2.00
K	TMV+p	MT20	4.0	4.0		
M	BMVW1-t	MT20	5.0	8.0	2.50	3.00

DWG NO. TAN 50073-17
STRUCTURAL
COMPONENT ONLY

BUILDING DESIGNER							
BEARINGS							
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG			
JT	VERT	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
T	2154	0	2154	0	5-8	5-8	
M	2154	0	2154	0	HANGER BY OTHERS		
					MIN. SEAT SIZE: 3-8		

UNFACTORED REACTIONS							
	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED						
T	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0
M	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) T

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-Q, H-P, C-T, J-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.3 -84.3	0.11 (1)	10.00	C-S	-72 / 148	0.03 (3)
B-C	0 / 18	-84.3 -84.3	0.30 (1)	10.00	S-E	0 / 424	0.10 (2)
C-D	-2939 / 0	-84.3 -84.3	0.41 (1)	3.76	E-Q	-701 / 0	0.34 (1)
D-E	-2939 / 0	-84.3 -84.3	0.41 (1)	3.76	Q-F	0 / 683	0.15 (1)
E-F	-2298 / 0	-84.3 -84.3	0.37 (1)	4.20	Q-G	0 / 4	0.00 (1)
F-G	-2044 / 0	-84.3 -84.3	0.20 (1)	4.57	P-G	0 / 679	0.15 (1)
G-H	-2296 / 0	-84.3 -84.3	0.37 (1)	4.20	P-H	-703 / 0	0.34 (1)
H-I	-2940 / 0	-84.3 -84.3	0.41 (1)	3.76	H-N	0 / 426	0.10 (2)
I-J	-2940 / 0	-84.3 -84.3	0.41 (1)	3.76	N-J	-71 / 148	0.03 (3)
J-K	0 / 18	-84.3 -84.3	0.30 (1)	10.00	T-C	-3199 / 0	0.80 (1)
K-L	0 / 26	-84.3 -84.3	0.11 (1)	10.00	J-M	-3200 / 0	0.90 (1)
T-B	-305 / 0	0.0 0.0	0.02 (1)	7.81			
M-K	-305 / 0	0.0 0.0	0.02 (1)	7.81			
T-S	0 / 2674	-28.0 -28.0	0.79 (2)	10.00			
S-R	0 / 2494	-28.0 -28.0	0.77 (2)	10.00			
R-Q	0 / 2494	-28.0 -28.0	0.77 (2)	10.00			
Q-P	0 / 2042	-28.0 -28.0	0.48 (2)	10.00			
P-O	0 / 2494	-28.0 -28.0	0.78 (2)	10.00			
O-N	0 / 2494	-28.0 -28.0	0.78 (2)	10.00			
N-M	0 / 2674	-28.0 -28.0	0.79 (2)	10.00			

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.22")
ALLOWABLE DEFL.(TL)= L/380 (1.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.38")

CSI: TC=0.41 (H-J:1), BC=0.79 (M-N:2), WB=0.80 (J-M:1), SS=0.19 (M-N:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)		
	MAX	MIN	MAX	MIN	MAX
MT20	618	354	1687	822	2284

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.80 (O) (INPUT = 1.00)



DWG NO. TAM 50073-17
STRUCTURAL COMPONENT ONLY

JOB NAME 285799	TRUSS NAME T660	QUANTITY 4	PLY 1	JOB DESC. 43954	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.030 S Oct 5 2016 MITek Industries, Inc. Wed Sep 06 15:07:41 2017 Page 1
ID:w3K2IB2K4fGk9tD07SkJphyfMC-HYD6ZrevONc0tWj042UczOkrAJig1NjKaLbFkFygKs0

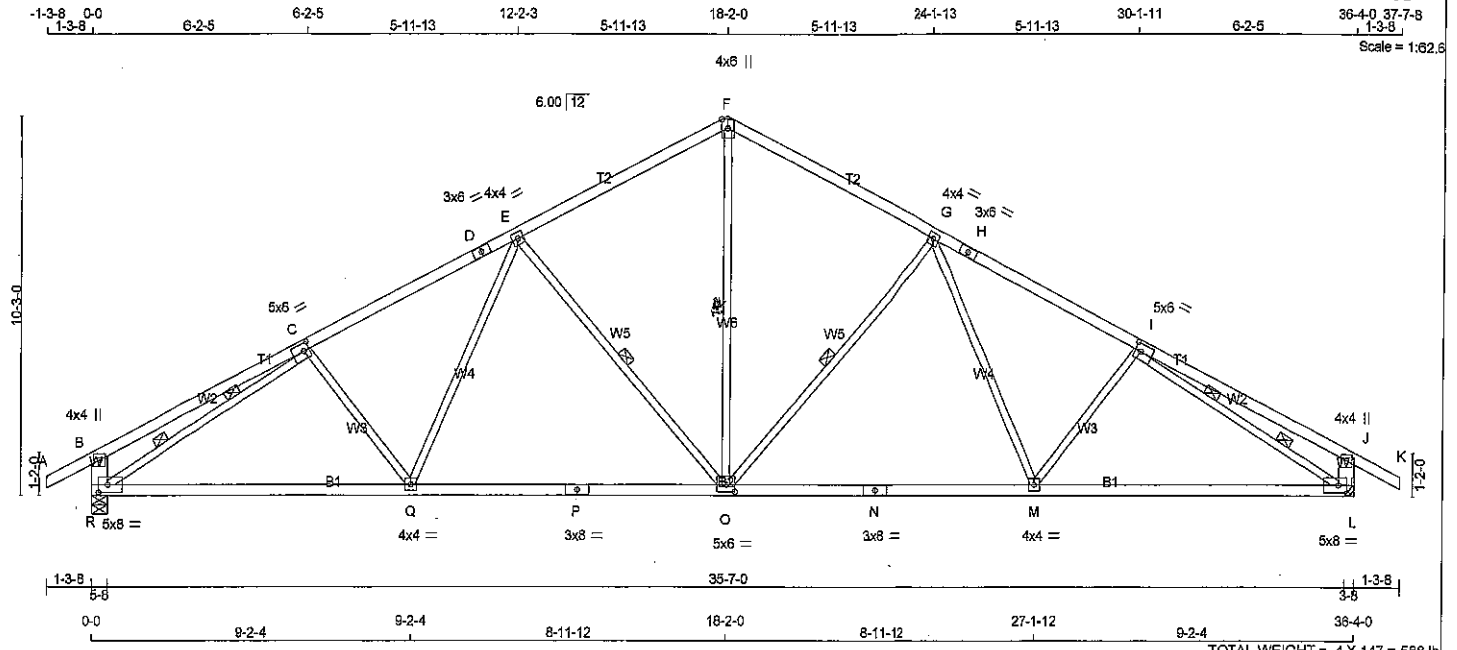

TOTAL WEIGHT = 4 X 147 = 588 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
R - B	2x6	DRY	No.2
L - J	2x6	DRY	No.2
R - P	2x4	DRY	No.2
P - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	4.0	4.0	
C	TMWW-t	MT20	5.0	6.0	2.50 2.00
D	TS-t	MT20	3.0	6.0	
E	TMWW-t	MT20	4.0	4.0	
F	TTW+p	MT20	4.0	6.0	Edge
G	TMWW-t	MT20	4.0	4.0	
H	TS-t	MT20	3.0	6.0	
I	TMWW-t	MT20	5.0	6.0	2.50 2.00
J	TMV+p	MT20	4.0	4.0	
L	BMWW-t	MT20	5.0	8.0	2.50 3.00
M	BMWW-t	MT20	4.0	4.0	
N	BS-t	MT20	3.0	8.0	
O	BMWW-t	MT20	5.0	6.0	2.25 3.00
P	BS-t	MT20	3.0	8.0	
Q	BMWW-t	MT20	4.0	4.0	
R	BMWW-t	MT20	5.0	8.0	2.50 3.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
R	2154	0	2154	0	5-8
L	2154	0	2154	0	5-8

UNFACTORED REACTIONS		1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
R	1752	999 / 0	382 / 0
L	1752	999 / 0	382 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-O, E-O. **F-D**
2 LATERAL BRACE(S) AT 1/3 LENGTH OF C-R, L-L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)
FR-TO		FROM TO		FR-TO		FROM TO	
A-B	0 / 28	-84.3 -84.3	0.11 (1)	O-F	0 / 1475	0.33 (1)	
B-C	0 / 21	-84.3 -84.3	0.39 (1)	O-G	-818 / 0	0.48 (1)	
C-D	-2896 / 0	-84.3 -84.3	0.50 (1)	G-M	0 / 509	0.11 (2)	
D-E	-2896 / 0	-84.3 -84.3	0.50 (1)	M-I	-163 / 124	0.07 (1)	
E-F	-2124 / 0	-84.3 -84.3	0.45 (1)	E-O	-818 / 0	0.48 (1)	
F-G	-2124 / 0	-84.3 -84.3	0.45 (1)	Q-E	0 / 509	0.11 (2)	
G-H	-2896 / 0	-84.3 -84.3	0.50 (1)	C-Q	-163 / 124	0.07 (1)	
H-I	-2896 / 0	-84.3 -84.3	0.50 (1)	R-C	-3197 / 0	1.00 (1)	
I-J	0 / 21	-84.3 -84.3	0.39 (1)	I-L	-3197 / 0	1.00 (1)	
J-K	0 / 28	-84.3 -84.3	0.11 (1)				
R-B	-325 / 0	0.0 0.0	0.02 (1)				
L-J	-325 / 0	0.0 0.0	0.02 (1)				
R-Q	0 / 2692	-28.0 -28.0	0.88 (2)				
Q-P	0 / 2413	-28.0 -28.0	0.85 (2)				
P-O	0 / 2413	-28.0 -28.0	0.85 (2)				
O-N	0 / 2413	-28.0 -28.0	0.85 (2)				
N-M	0 / 2413	-28.0 -28.0	0.85 (2)				
M-L	0 / 2692	-28.0 -28.0	0.88 (2)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.31")
ALLOWABLE DEFL.(TL)= L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = L/863 (0.51")

CSI: TC=0.50 (G-I:1), BC=0.88 (Q-R:2), WB=1.00 (I-L:1), SSI=0.21 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (L) (INPUT = 0.90)
JSI METAL= 0.80 (N) (INPUT = 1.00)



DWG NO. TAM50074-17
STRUCTURAL
COMPONENT ONLY

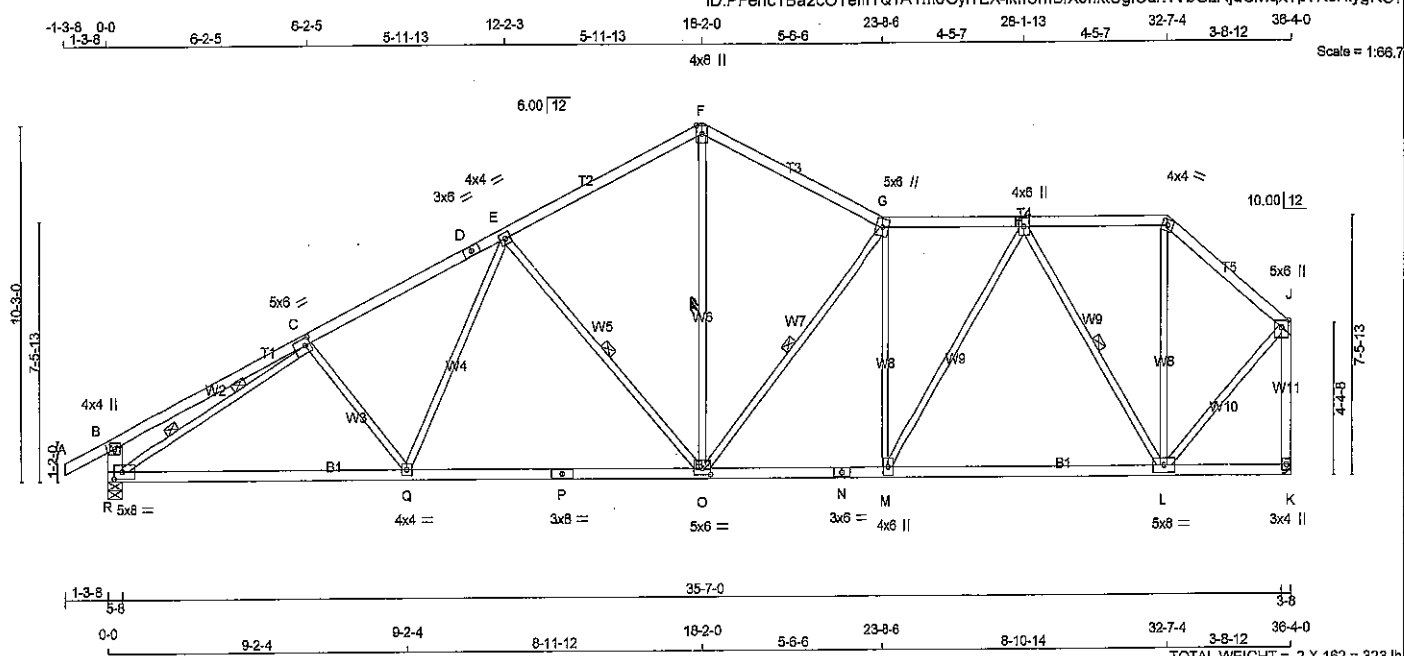

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - G	2x4	DRY No.2	SPF
G - I	2x4	DRY No.2	SPF
I - J	2x4	DRY No.2	SPF
R - B	2x6	DRY No.2	SPF
K - J	2x4	DRY No.2	SPF
R - P	2x4	DRY No.2	SPF
P - N	2x4	DRY No.2	SPF
N - K	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	4.0	4.0		
C	TMWW-t	MT20	5.0	6.0	2.50	2.00
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTW+p	MT20	4.0	6.0	Edge	
G	TTWW+m	MT20	5.0	8.0		
H	TMWW+t	MT20	4.0	6.0		
I	TTW-m	MT20	4.0	4.0		
J	TMVW+p	MT20	5.0	6.0	Edge	
K	BMV1+p	MT20	3.0	4.0		
L	BMWWW-t	MT20	5.0	8.0		
M	BMWWW-t	MT20	4.0	6.0		
N	BS-t	MT20	3.0	6.0		
O	BMWWW-t	MT20	5.0	6.0	2.25	3.00
P	BS-t	MT20	3.0	8.0		
Q	BMWW-t	MT20	4.0	4.0		
R	BMWW1-t	MT20	5.0	8.0	2.50	3.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2154	0	2154	0
K	2039	0	2039	0

UPLIFT IN-SX 5-8
HANGER BY OTHERS
MIN. SEAT SIZE: 3-8

UNFACTORED REACTIONS

	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERMLIVE	WIND	DEAD	SOIL
JT	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0	0 / 0
K	1674	930 / 0	362 / 0	0 / 0	0 / 0	363 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

- 1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O, G-O, H-L. *Fro*
- 2 LATERAL BRACE(S) AT 1/3 LENGTH OF C-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO					C-Q	-163 / 124	0.07 (1)
A-B	0 / 26	-84.3	-84.3 0.11 (1)	10.00	Q-E	0 / 524	0.12 (2)
B-C	0 / 21	-84.3	-84.3 0.39 (1)	10.00	E-O	-822 / 0	0.49 (1)
C-D	-2898 / 0	-84.3	-84.3 0.50 (1)	3.70	O-F	0 / 1436	0.32 (1)
D-E	-2898 / 0	-84.3	-84.3 0.50 (1)	3.70	O-G	-788 / 0	0.45 (1)
E-F	-2118 / 0	-84.3	-84.3 0.44 (1)	4.25	M-G	-690 / 0	0.70 (1)
F-G	-2095 / 0	-84.3	-84.3 0.41 (1)	4.30	M-H	0 / 1039	0.23 (1)
G-H	-2345 / 0	-84.3	-84.3 0.28 (1)	4.24	H-L	-1572 / 0	0.76 (1)
H-I	-994 / 0	-84.3	-84.3 0.22 (1)	6.00	L-I	0 / 523	0.12 (1)
I-J	-1286 / 0	-84.3	-84.3 0.17 (1)	5.51	R-C	-3200 / 0	1.00 (1)
R-B	-325 / 0	0.0	0.0 0.02 (1)	7.81	L-J	0 / 1433	0.32 (1)
K-J	-2025 / 0	0.0	0.0 0.66 (1)	5.94			
R-Q	0 / 2894	-28.0	-28.0 0.91 (2)	10.00			
Q-P	0 / 2411	-28.0	-28.0 0.88 (2)	10.00			
P-O	0 / 2411	-28.0	-28.0 0.88 (2)	10.00			
C-N	0 / 2355	-28.0	-28.0 0.59 (2)	10.00			
N-M	0 / 2355	-28.0	-28.0 0.59 (2)	10.00			
M-L	0 / 1807	-28.0	-28.0 0.57 (2)	10.00			
L-K	0 / 0	-28.0	-28.0 0.38 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/699 (0.26")
ALLOWABLE DEFL.(TL) = L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = L/907 (0.48")

CSI: TC=0.66 (J-K-1), BC=0.91 (Q-R-2), WB=1.00 (C-R-1), SSI=0.21 (Q-R-3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1667	822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (R) (INPUT = 0.90)
JSI METAL= 0.85 (P) (INPUT = 1.00)




DWG NO. TAM 50075-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T680S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MITek Industries, Inc. Wed Sep 06 15:07:42 2017 Page 1

ID:PFehc1Ba2cOYemTQTAYm6Oy1EX-lknUmBfX9hktUglCd?rVbGzgdYmqxTp?KoHlygKS?

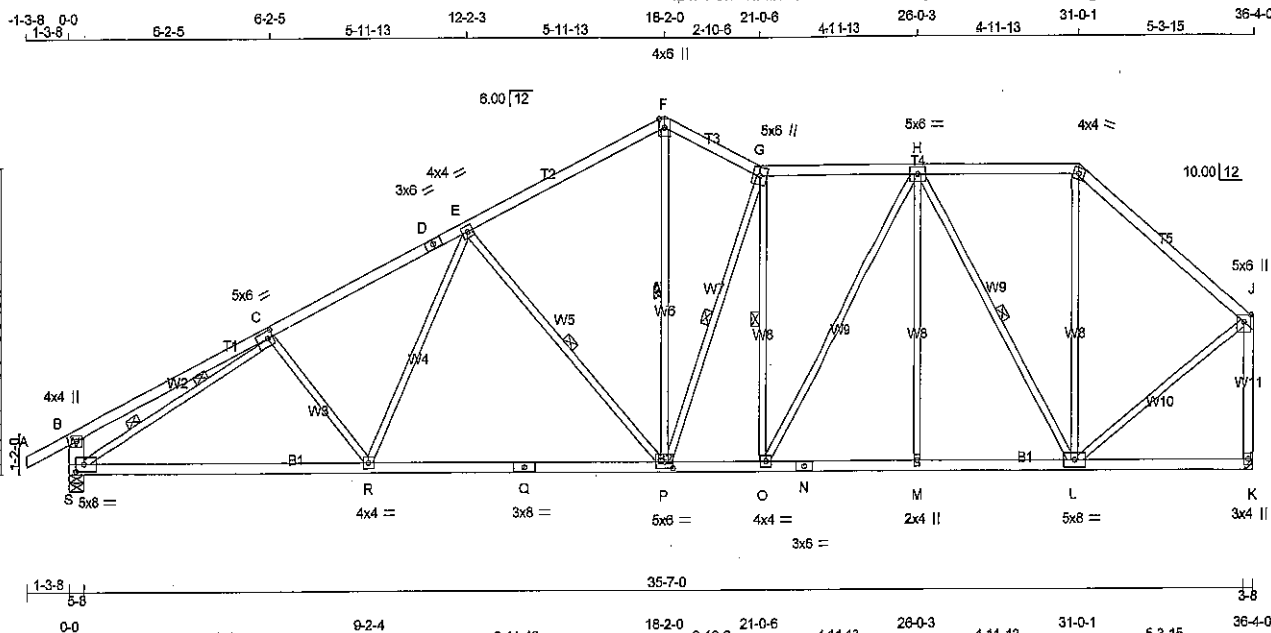

Scale = 1:66.7

LUMBER	N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - J	2x4	DRY	No.2	SPF
S - B	2x6	DRY	No.2	SPF
K - J	2x4	DRY	No.2	SPF
S - Q	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - K	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	4.0	4.0		
C	TMWW-t	MT20	5.0	6.0	2.50	2.00
D	TS-t	MT20	3.0	6.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTW+p	MT20	4.0	8.0	Edge	
G	TTWW+m	MT20	5.0	6.0		
H	TMWW-t	MT20	5.0	6.0		
I	TTW-m	MT20	4.0	4.0		
J	TMWW+p	MT20	5.0	8.0	Edge	
K	BMV1+p	MT20	3.0	4.0		
L	BMWW-t	MT20	5.0	8.0		
M	BMWW-w	MT20	2.0	4.0		
N	BS-t	MT20	3.0	6.0		
O	BMWW-t	MT20	4.0	4.0		
P	BMWW-t	MT20	5.0	6.0	2.25	3.00
Q	BS-t	MT20	3.0	6.0		
R	BMWW-t	MT20	4.0	4.0		
S	BMWW-t	MT20	5.0	8.0	2.50	3.00

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
S	2154	0	2154	0
K	2039	0	2039	0

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
S	1752	999 / 0	382 / 0	0 / 0	0 / 0	371 / 0	0 / 0
K	1674	930 / 0	382 / 0	0 / 0	0 / 0	363 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-P, G-P, G-O, H-L
2 LATERAL BRACE(S) AT 1/3 LENGTH OF C-S.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 26	-84.3 -84.3	0.11 (1)	C-R	-163 / 124	0.07 (1)	
B-C	0 / 21	-84.3 -84.3	0.39 (1)	R-E	0 / 521	0.12 (2)	
C-D	-2898 / 0	-84.3 -84.3	0.50 (1)	E-P	-821 / 0	0.49 (1)	
D-E	-2898 / 0	-84.3 -84.3	0.50 (1)	P-F	0 / 1547	0.35 (1)	
E-F	-2119 / 0	-84.3 -84.3	0.44 (1)	F-G	-772 / 0	0.43 (1)	
F-G	-2095 / 0	-84.3 -84.3	0.14 (1)	G-H	-484 / 0	0.24 (1)	
G-H	-2116 / 0	-84.3 -84.3	0.33 (1)	H-I	0 / 631	0.14 (1)	
H-I	-1115 / 0	-84.3 -84.3	0.26 (1)	I-J	0 / 242	0.05 (2)	
I-J	-1446 / 0	-84.3 -84.3	0.35 (1)	J-K	-1382 / 0	0.95 (1)	
S-B	-325 / 0	0.0 0.0	0.02 (1)	K-L	0 / 540	0.12 (1)	
K-J	-1978 / 0	0.0 0.0	0.85 (1)	L-J	-3199 / 0	1.00 (1)	
S-R	0 / 2694	-28.0 -28.0	0.90 (2)				
R-Q	0 / 2412	-28.0 -28.0	0.97 (2)				
Q-P	0 / 2412	-28.0 -28.0	0.87 (2)				
P-O	0 / 2122	-28.0 -28.0	0.54 (2)				
O-N	0 / 1802	-28.0 -28.0	0.38 (1)				
N-M	0 / 1802	-28.0 -28.0	0.38 (1)				
M-L	0 / 1802	-28.0 -28.0	0.40 (2)				
L-K	0 / 0	-28.0 -28.0	0.19 (3)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	3.0	PSF
BOT CH.	LL =	10.5	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	46.1	PSF

SPACING = 24.0 IN. G/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.29")
ALLOWABLE DEFL.(TL) = L/360 (1.21")
CALCULATED VERT. DEFL.(TL) = L/804 (0.48")

CS: TC=0.85 (J-K:1), BC=0.90 (R-S:2), WB=1.00 (C-S:1), SS=0.21 (R-S:3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354 1667 822 2284 1656	


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (S) (INPUT = 0.90)
JSI METAL= 0.84 (Q) (INPUT = 1.00)



DRW NO. TAM 50076-17
STRUCTURAL
COMPONENT ONLY



DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

UNFACTORED REACTIONS

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.71 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-O, F-N, G-N, H-L, I-K.

2 LATERAL BRACE(S) AT 1/3 LENGTH OF C-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED			MAX. FACTORED		FACTORED		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX. UNBRAC	MEMB.	FORCE (LBS)	LC1	MAX. UNBRAC	
FR-TO		FROM TO	CSI (LC)	LENGTH	FR-TO		CSI (LC)	LENGTH	
A-B	0/26	-84.3	-84.3	0.11 (1)	10.00	C-Q	-153/127	0.06 (1)	
B-C	0/20	-84.3	-84.3	0.38 (1)	10.00	Q-E	0/511	0.11 (2)	
C-D	-2903/0	-84.3	-84.3	0.50 (1)	3.71	E-O	-813/0	0.48 (1)	
D-E	-2903/0	-84.3	-84.3	0.50 (1)	3.71	O-F	0/821	0.18 (1)	
E-F	-2132/0	-84.3	-84.3	0.44 (1)	4.25	F-N	-301/0	0.21 (1)	
F-G	-1743/0	-84.3	-84.3	0.40 (1)	4.63	N-G	-588/0	0.42 (1)	
G-H	-1743/0	-84.3	-84.3	0.40 (1)	4.63	N-H	0/1126	0.18 (1)	
H-I	-1562/0	-84.3	-84.3	0.15 (1)	5.15	L-H	-264/36	0.20 (1)	
I-J	0/20	-84.3	-84.3	0.16 (1)	10.00	L-I	0/557	0.13 (1)	
R-B	-323/0	0.0	0.0	0.02 (1)	7.81	R-C	-3200/0	0.98 (1)	
K-J	-116/0	0.0	0.0	0.04 (1)	7.81	I-K	-2064/0	0.62 (1)	
R-Q	0/2692	-28.0	-28.0	0.89 (2)	10.00				
Q-P	0/2421	-28.0	-28.0	0.88 (2)	10.00				
P-O	0/2421	-28.0	-28.0	0.86 (2)	10.00				
O-N	0/1894	-28.0	-28.0	0.53 (2)	10.00				
N-M	0/1177	-28.0	-28.0	0.46 (2)	10.00				
M-L	0/1177	-28.0	-28.0	0.46 (2)	10.00				
L-K	0/928	-28.0	-28.0	0.42 (2)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	25.6	PSF
	DL =	3.0	PSF
BOT CH.	LL =	10.5	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	46.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.21")
CALCULATED VERT. DEFL.(LL)= L/999 (0.28")
ALLOWABLE DEFL.(TL)= L/360 (1.21")
CALCULATED VERT. DEFL.(TL)= L/950 (0.46")

CSI: TC=0.50 (C-E:1), BC=0.89 (Q-R:2), WB=0.98 (C-R:1), SSI=0.23 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS 8END=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.84 (P) (INPUT = 1.00)




DWG NO. TAM50077-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	43954	DRWG NO.
285799	T700	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2018 MITek Industries, Inc. Wed Sep 06 15:07:43 2017 Page 1

ID:PFehc1Ba2cOYemTQTAYm8Oyi1EX-DxLt_X79w?sk6qtPBTW42pp7t61VInd2f4Mp8ygKS

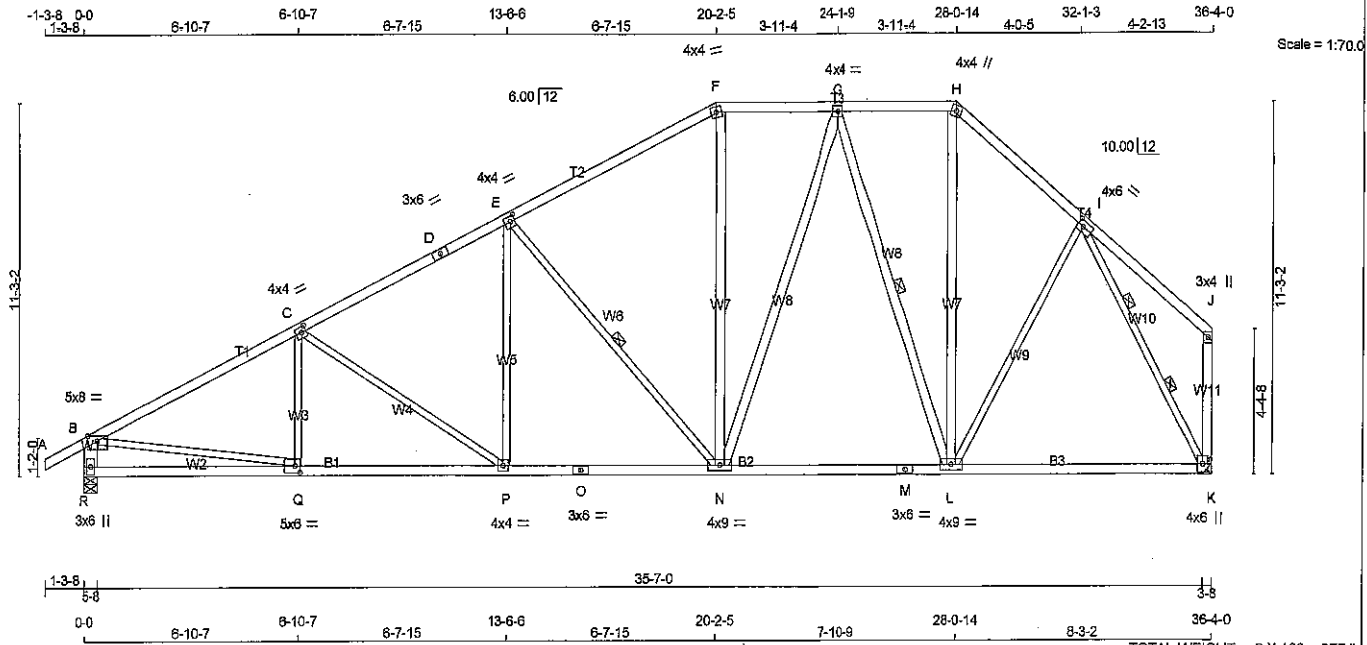

TOTAL WEIGHT = 2 X 189 = 377 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - H	2x4	DRY	No.2	SPF	
H - J	2x4	DRY	No.2	SPF	
R - B	2x6	DRY	No.2	SPF	
K - J	2x4	DRY	No.2	SPF	
R - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	
N - G	2x4	DRY	No.2	SPF	
G - L	2x4	DRY	No.2	SPF	
L - H	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	
C TMVW-t	MT20	4.0	4.0	2.00	1.75
D TS-t	MT20	3.0	6.0		
E TMVW-t	MT20	4.0	4.0	2.00	1.75
F TTW-m	MT20	4.0	4.0		
G TMVW-t	MT20	4.0	4.0		
H TTW-m	MT20	4.0	4.0		
I TMVW-t	MT20	4.0	6.0	2.00	2.25
J TMV-p	MT20	3.0	4.0		
K BMVW-t+p	MT20	4.0	6.0		
L BMVW-t	MT20	4.0	9.0		
M BS-t	MT20	3.0	6.0		
N BMVW-t	MT20	4.0	9.0		
O BS-t	MT20	3.0	6.0		
P BMVW-t	MT20	4.0	4.0		
Q BMVW-t	MT20	5.0	6.0	2.50	2.00
R BMV-t+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2154	0	2154	0
K	2039	0	2039	0

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
R	1752	999 / 0	392 / 0	0 / 0	371 / 0	0 / 0
K	1674	930 / 0	382 / 0	0 / 0	363 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.37 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

- 1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N, G-L.
- 2 LATERAL BRACE(S) AT 1/3 LENGTH OF K-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 28	-84.3 -84.3	0.11 (1)	Q-C	-137 / 199	0.04 (3)	
B-C	-3059 / 0	-84.3 -84.3	0.75 (1)	C-P	-506 / 0	0.86 (1)	
C-D	-2607 / 0	-84.3 -84.3	0.57 (1)	P-E	0 / 523	0.12 (2)	
D-E	-2807 / 0	-84.3 -84.3	0.57 (1)	E-N	-996 / 0	0.76 (1)	
E-F	-1890 / 0	-84.3 -84.3	0.53 (1)	N-F	0 / 478	0.08 (1)	
F-G	-1874 / 0	-84.3 -84.3	0.19 (1)	G-N	0 / 485	0.08 (1)	
G-H	-1220 / 0	-84.3 -84.3	0.17 (1)	G-L	-904 / 0	0.89 (1)	
H-I	-1804 / 0	-84.3 -84.3	0.21 (1)	L-H	0 / 746	0.12 (1)	
I-J	0 / 25	-84.3 -84.3	0.22 (1)	L-I	0 / 422	0.09 (1)	
R-B	-2073 / 0	0.0 0.0	0.13 (1)	B-Q	0 / 2778	0.63 (1)	
K-J	-137 / 0	0.0 0.0	0.04 (1)	I-K	-2067 / 0	0.93 (1)	
R-Q	0 / 0	-28.0 -28.0	0.30 (3)	10.00			
Q-P	0 / 2757	-28.0 -28.0	0.62 (2)	10.00			
P-O	0 / 2332	-28.0 -28.0	0.53 (2)	10.00			
O-N	0 / 2332	-28.0 -28.0	0.53 (2)	10.00			
N-M	0 / 1515	-28.0 -28.0	0.65 (2)	10.00			
M-L	0 / 1515	-28.0 -28.0	0.65 (2)	10.00			
L-K	0 / 1002	-28.0 -28.0	0.58 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 3.0 PSF
BOT CH. LL	= 10.5 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 46.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (1.21")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.20")
ALLOWABLE DEFL.(TL) = 1/560 (1.21")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.33")

CSI: TC=0.75 (B-C:1), BC=0.65 (L-N:2), WB=0.93 (I-K:1), SSI=0.24 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1867
	622	2284	1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.89 (O) (INPUT = 1.00)

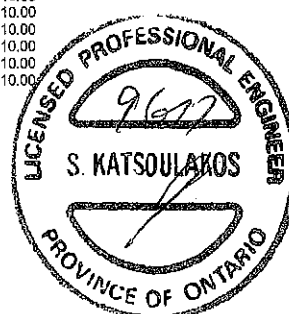


DWG NO. TAM50078-17
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285492	T720	1	3	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.210 S May 18 2018 Hitek Industries, Inc. Tue Jun 26 08:44:33 2018 Page 1

ID:PFehc1Ba2cOYemTQTAym8OyifEX-TpG?IVNDjB241aiJ4VWMy8NczRF?Yomaww3vN7uz2T0y

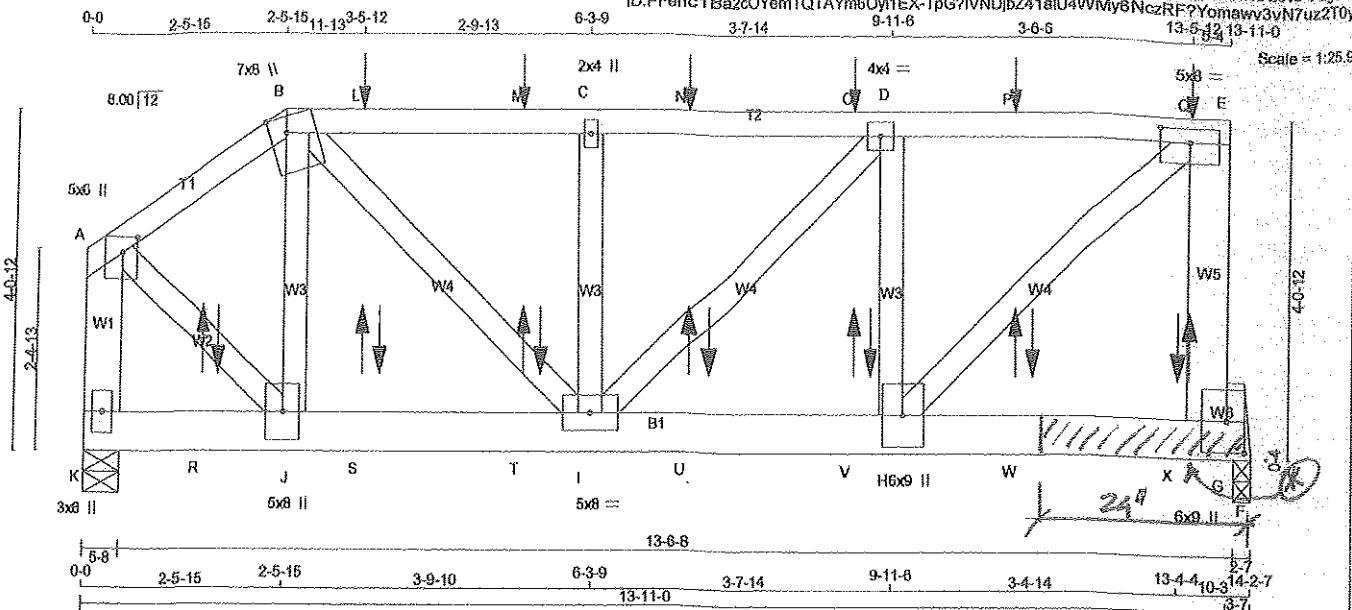

TOTAL WEIGHT = 3 X 83 = 249 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SPF	
B - E	2x4	DRY	No.2	SPF	
G - E	2x6	DRY	No.2	SPF	
K - A	2x6	DRY	No.2	SPF	
K - F	2x6	DRY	2100F 1.8E	SPF	
G - F	2x8	DRY	No.2	SPF	

ALL WEBS	2x4	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B	1	12
B-E	1	12
E-G	2	12
K-A	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
K-F	2	7
WEBS : (0.122"x3") SPIRAL NAILS		
2x4	1	6
2x6	2	6

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	5.0	8.0	2.25	2.25
B	TTWW+m	MT20	7.0	8.0	Edge	2.50
C	TMVW+w	MT20	2.0	4.0		
D	TMVW-t	MT20	4.0	4.0		
E	TMVW-t	MT20	5.0	8.0	2.00	4.00
G	BMVW+p	MT20	6.0	9.0	4.50	2.50
H	BMVW+t	MT20	6.0	9.0		
I	BMVW-t	MT20	5.0	8.0		
J	BMVW-t	MT20	5.0	8.0		
K	BMVW+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DWG NO. TAM 71800657
STRUCTURAL
COMPONENT ONLY 1/2

HANGERS NOTES

1)

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
7721	0	7721	0	5-8
8235	0	8235	0	2-7

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	0268	3588 / 0	1349 / 0	0 / 0	0 / 0	0 / 0	1321 / 0	0 / 0
F	8715	3804 / 0	1479 / 0	0 / 0	0 / 0	0 / 0	1432 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.10 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX.	UNBRAC	MEMB.	FORCE	MAX
MEMB.	FORCE	(LBS)	(PLF)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)	(LBS)
FR-TO										
A-B	-6013 / 0	-84.3	-84.3	0.07 (1)	4.74	J-B	-14 / 238	0.01 (1)		
B-L	-7933 / 0	-84.3	-84.3	0.14 (1)	4.16	A-J	0 / 8255	0.34 (1)		
L-M	-7933 / 0	-84.3	-84.3	0.14 (1)	4.10	H-E	0 / 8725	0.52 (1)		
M-C	-7933 / 0	-84.3	-84.3	0.14 (1)	4.16	B-I	0 / 4081	0.22 (1)		
C-N	-7933 / 0	-84.3	-84.3	0.12 (1)	4.19	H-D	-1157 / 0	0.07 (1)		
N-O	-7933 / 0	-84.3	-84.3	0.12 (1)	4.19	I-C	-297 / 0	0.02 (1)		
O-D	-7933 / 0	-84.3	-84.3	0.12 (1)	4.19	I-D	0 / 1152	0.08 (1)		
D-P	-7121 / 0	-84.3	-84.3	0.13 (1)	4.36					
P-Q	-7121 / 0	-84.3	-84.3	0.13 (1)	4.36					
Q-E	-7121 / 0	-84.3	-84.3	0.13 (1)	4.36					
G-E	-8775 / 0	0.0	0.0	0.34 (1)	6.81					
K-A	-7233 / 0	0.0	0.0	0.19 (1)	6.64					
K-R	0 / 0	-28.0	-28.0	0.15 (1)	10.00					
R-J	0 / 0	-28.0	-28.0	0.15 (1)	10.00					
J-S	0 / 4999	-28.0	-28.0	0.23 (1)	10.00					
S-T	0 / 4999	-28.0	-28.0	0.23 (1)	10.00					
T-U	0 / 4999	-28.0	-28.0	0.23 (1)	10.00					
I-I	0 / 7121	-28.0	-28.0	0.36 (1)	10.00					
U-V	0 / 7121	-28.0	-28.0	0.36 (1)	10.00					
V-H	0 / 7121	-28.0	-28.0	0.36 (1)	10.00					
H-W	0 / 0	-28.0	-28.0	0.36 (1)	10.00					
W-X	0 / 0	-28.0	-28.0	0.36 (1)	10.00					
X-G	0 / 0	-28.0	-28.0	0.36 (1)	10.00					
G-F	0 / 0	-28.0	-28.0	0.22 (1)	10.00					

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
L	3-5-12	-1	-1	73	FRONT	VERT	TOTAL
M	5-5-12	-1	-1	74	FRONT	VERT	TOTAL
N	7-5-12	-1	-1	74	FRONT	VERT	TOTAL
O	9-5-12	-1	-1	74	FRONT	VERT	TOTAL
P	11-5-12	-1	-1	74	FRONT	VERT	TOTAL
Q	13-5-12	-1	-1	59	FRONT	VERT	TOTAL
R	1-5-12	4	1	4	FRONT	VERT	TOTAL
R	1-9-4	-1717	-1717	-	BACK	VERT	TOTAL
S	3-5-12	4	1	4	FRONT	VERT	TOTAL
S	3-8-4	-1717	-1717	-	BACK	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.6	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	48.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2012, BCBC 2012, ABC 2014
- CSA 088-09
- TPIC 2011

(55% OF 31.3 P.S.F. G.S.I. PLUS 0.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.47")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.07")
ALLOWABLE DEFL.(TL) = $L/360$ (0.47")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.11")

CSI: TC=0.34/1.00 (E-G:1), BC=0.38/1.00 (G-H:1).

WD=0.52/1.00 (E-H:1), SS=0.03/1.00 (F-G:1).

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)	(PLI)
MT20	610	354	1687	622 2284 1850

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.86 (E) (INPUT = 0.00)

JSI METAL= 0.52 (H) (INPUT = 1.00)

PROVIDE 24" LONG SCAB 2X6 SPF #2 ALONG MEMBERS (V-A), ON ONE SIDE, USING 2 ROWS OF 3 1/2" SPIRAL NAILS @ 4" C/C. (2 NAILS MIN)

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
285492	T720	1	3	TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.210 S May 18 2018 Mitel Industries, Inc. Tue Jun 26 09:44:33 2018 Page 2

ID:PFehc1Ba2cOYemTQTAYm6Qy1EX-TpG7IVNDjbZ41aIU4WVMY6NczRF?Yomawv3yN7uz2T0v

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1.1 lbs FACTORED DOWN AND 110.2 lbs FACTORED UP AT 3-5-12, 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 5-5-12, 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 7-5-12, 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 9-5-12, 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 11-5-12, AND 1.1 lbs FACTORED DOWN AND 110.8 lbs FACTORED UP AT 13-5-12 ON TOP CHORD, AND 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 1-5-12, 2125.6 lbs FACTORED DOWN AT 1-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 3-5-12, 2125.6 lbs FACTORED DOWN AT 3-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 5-5-12, 2125.6 lbs FACTORED DOWN AT 5-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 7-5-12, 2011.3 lbs FACTORED DOWN AT 7-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 9-5-12, 2011.3 lbs FACTORED DOWN AT 9-8-4, 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 11-5-12, 2011.3 lbs FACTORED DOWN AT 11-8-4, AND 2013.4 lbs FACTORED DOWN AT 13-4-4, AND 1.0 lbs FACTORED DOWN AND 5.8 lbs FACTORED UP AT 13-5-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
T	5-5-12	4	1	4	FRONT	VERT	TOTAL
T	5-8-4	-1717	-1717	—	BACK	VERT	TOTAL
U	7-5-12	4	1	4	FRONT	VERT	TOTAL
U	7-8-4	-1639	-1639	—	BACK	VERT	TOTAL
V	9-5-12	4	1	4	FRONT	VERT	TOTAL
V	9-8-4	-1639	-1639	—	BACK	VERT	TOTAL
W	11-5-12	4	1	4	FRONT	VERT	TOTAL
W	11-8-4	-1639	-1639	—	BACK	VERT	TOTAL
X	13-4-4	-1642	-1642	—	BACK	VERT	TOTAL
X	13-5-12	4	1	4	FRONT	VERT	TOTAL



DWG NO. TAM 718 00651
STRUCTURAL
COMPONENT ONLY


2/2

JOB NAME 285799	TRUSS NAME T800	QUANTITY 2	PLY 1	JOB DESC. 43954 TRUSS DESC.	DRWG NO.
---------------------------	---------------------------	----------------------	-----------------	-----------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.030 S Oct 5 2016 MTek Industries, Inc. Wed Sep 06 15:07:43 2017 Page.1

ID:PFehc1Ba2cOYemTQTAYm6Oyi1EX-DxLt_Xf9w?sk6qtPBTW42ppHr69rVWAd2f4Mp8ygKs

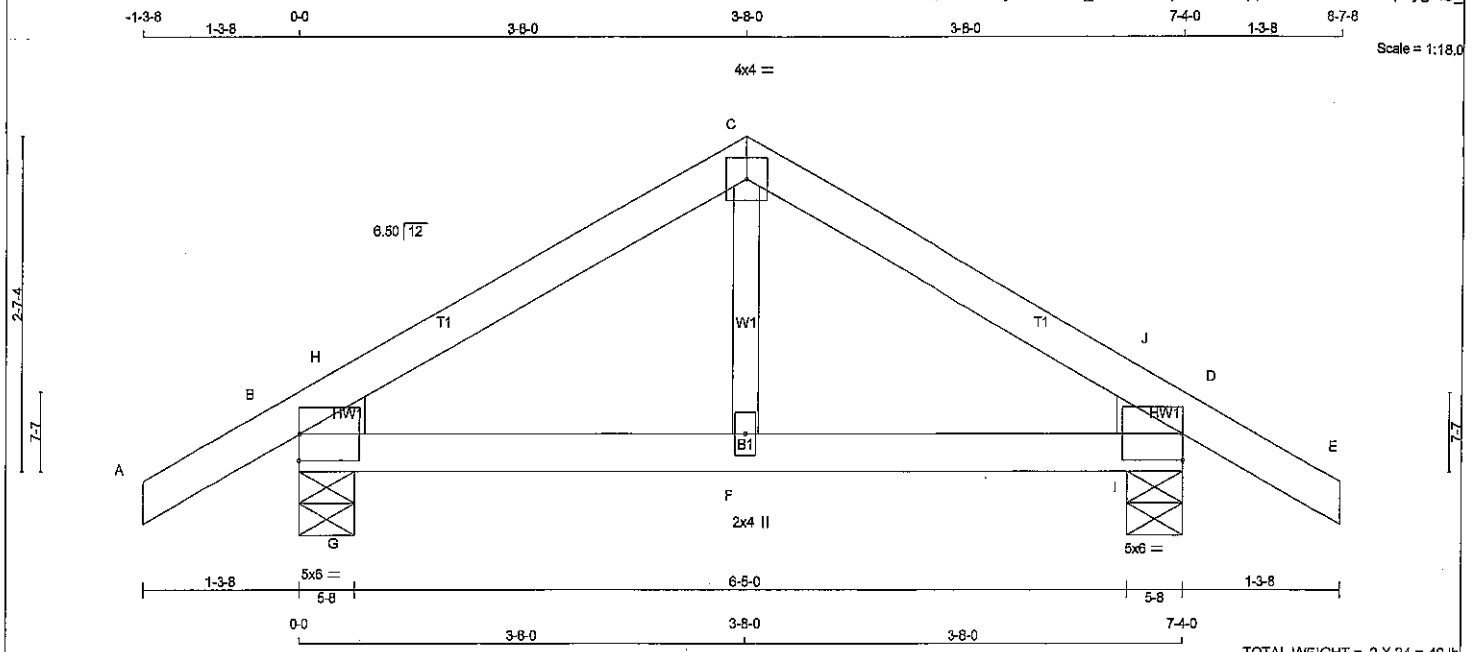

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER	DESCR.	
A - C	2x4 DRY	No.2	SPF	
C - E	2x4 DRY	No.2	SPF	
B - D	2x4 DRY	No.2	SPF	
ALL WEBS	2x3 DRY	No.2	SPF	
DRY: SEASONED LUMBER.				

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMBH1-I	MT20	5.0	6.0
C	TTW-p	MT20	4.0	4.0
D	TMBH1-I	MT20	5.0	6.0
F	BMW+w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG	HEEL WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	
B	526	0	526	0	0	5-8 2x4 L
D	526	0	526	0	0	5-8 2x4 R

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	416	257 / 0	77 / 0	0 / 0	0 / 0	82 / 0	0 / 0
D	416	257 / 0	77 / 0	0 / 0	0 / 0	82 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
A-B	0 / 17	-84.3 -84.3	0.11 (1)	10.00	F-C	0 / 192	0.04 (2)
B-H	-459 / 0	-84.3 -84.3	0.07 (1)	6.25	G-H	-55 / 132	0.00 (1)
H-C	-410 / 0	-84.3 -84.3	0.11 (1)	6.25	I-J	-55 / 132	0.00 (1)
C-J	-410 / 0	-84.3 -84.3	0.11 (1)	6.25			
J-D	-459 / 0	-84.3 -84.3	0.07 (1)	6.25			
D-E	0 / 17	-84.3 -84.3	0.11 (1)	10.00			
B-G	0 / 352	-28.0 -28.0	0.10 (1)	10.00			
G-F	0 / 352	-28.0 -28.0	0.13 (1)	10.00			
F-I	0 / 352	-28.0 -28.0	0.13 (1)	10.00			
I-D	0 / 352	-28.0 -28.0	0.10 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 3.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 46.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.11 (A-B:1), BC=0.13 (F-G:1), WB=0.04 (C-F:2), SS=0.11 (C-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (D) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)



DWG NO. TAM 5008017
STRUCTURAL
COMPONENT ONLY

JOB NAME 285799	TRUSS NAME T800Z	QUANTITY 1	PLY 1	JOB DESC. 43954	DRWG NO.
TRUSS DESC.					

Tamareck Roof Truss, Burlington Version 8.030.5 Oct 5 2016 Mitek Industries, Inc. Wed Sep 08 15:07:44 2017 Page 1
ID:PFehc1Ba2cOYemTQTAYm6Oy1EX-h7vFBtgogL_bk_SbIA1Ja0MR9VWvEzJmGJpvKaygKRz

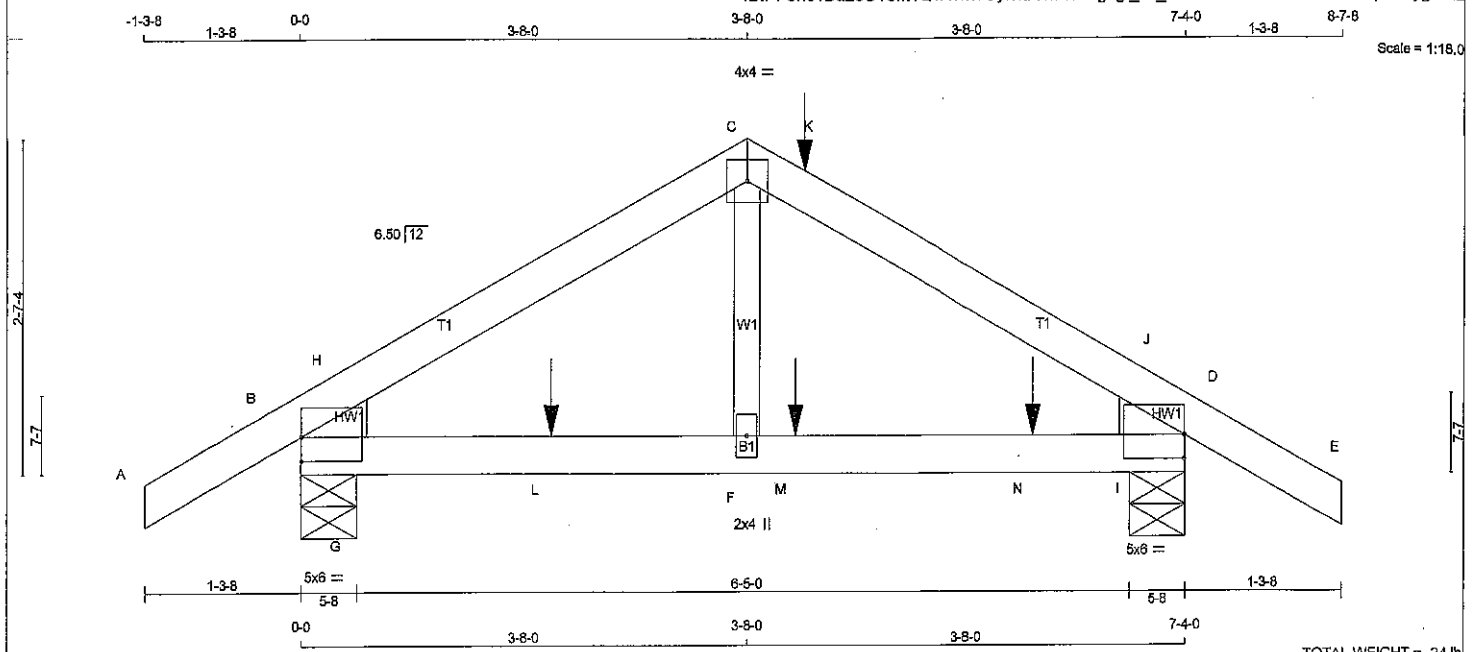

TOTAL WEIGHT = 24 lb

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2 SPF
C - E	2x4	DRY	No.2 SPF
B - D	2x4	DRY	No.2 SPF
ALL WEBS	2x3	DRY	No.2 SPF
DRY: SEASONED LUMBER.			

PLATES (table in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMBH1-I	MT20	5.0	6.0	2.25	
C	TTW-p	MT20	4.0	4.0		
D	TMBH1-I	MT20	5.0	6.0	2.25	
F	BMW+w	MT20	2.0	4.0		

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 26.9 lbs FACTORED DOWN AT 4-0-12 ON TOP CHORD, AND 6.5 lbs FACTORED DOWN AT 2-0-12, AND 6.5 lbs FACTORED DOWN AT 4-0-12, AND 6.5 lbs FACTORED DOWN AT 6-0-12 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER							
BEARINGS							
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG	HEEL		
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	WEDGE
B	543	0	543	0	0	5-8	2x4 L
D	547	0	547	0	0	5-8	2x4 R

UNFACTORED REACTIONS								
JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
B	430	285 / 0	81 / 0	0 / 0	0 / 0	85 / 0	0 / 0	
D	434	286 / 0	82 / 0	0 / 0	0 / 0	86 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH FR-TO		
FR-TO		FROM	TO		FR-TO				
A-B	0 / 17	-84.3	-84.3 0.12 (1)	10.00	F-C	0 / 203	0.05 (2)		
B-H	-498 / 0	-84.3	-84.3 0.10 (1)	6.25	G-H	-43 / 141	0.00 (1)		
H-C	-438 / 0	-84.3	-84.3 0.13 (1)	6.25	I-J	-50 / 142	0.00 (1)		
C-K	-433 / 0	-84.3	-84.3 0.14 (1)	6.25					
K-J	-433 / 0	-84.3	-84.3 0.14 (1)	8.25					
J-D	-493 / 0	-84.3	-84.3 0.10 (1)	6.25					
D-E	0 / 17	-84.3	-84.3 0.12 (1)	10.00					
B-G	0 / 377	-28.0	-28.0 0.11 (1)	10.00					
G-L	0 / 377	-28.0	-28.0 0.15 (1)	10.00					
L-F	0 / 377	-28.0	-28.0 0.15 (1)	10.00					
F-M	0 / 377	-28.0	-28.0 0.15 (1)	10.00					
M-N	0 / 377	-28.0	-28.0 0.15 (1)	10.00					
N-I	0 / 377	-28.0	-28.0 0.15 (1)	10.00					
I-D	0 / 377	-28.0	-28.0 0.11 (1)	10.00					

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
K	4-0-12	-27	-27	---	BACK	VERT	TOTAL
L	2-0-12	-4	-7	---	BACK	VERT	TOTAL
M	4-0-12	-4	-7	---	BACK	VERT	TOTAL
N	6-0-12	-4	-7	---	BACK	VERT	TOTAL

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL	=	25.6 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	10.5 PSF
	DL	=	7.0 PSF
TOTAL LOAD	=	46.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.24")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.24")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.14 (C-J:1), BC=0.15 (F-G:1), WB=0.05 (C-F:2), SSI=0.12 (C-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX MIN	MAX MIN	MAX MIN		
MT20	518 354	1667 822	2284 1655		

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.76 (D) (INPUT = 0.80)
JSI METAL= 0.12 (D) (INPUT = 1.00)


DWG NO. TAM5008-17
STRUCTURAL
COMPONENT ONLY

DRWG NO. TAM5008-17
STRUCTURAL
COMPONENT ONLY

JOB NAME 285799	TRUSS NAME P6	QUANTITY 3	PLY 1	JOB DESC. 43954	TRUSS DESC.	DRWG NO.
---------------------------	-------------------------	----------------------	-----------------	---------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.030 5 Oct 5 2016 Mitek Industries, Inc. Wed Sep 06 15:07:28 2017 Page 1
ID:PFehc1Ba2cOYemTQTAYm6Oy1EX-92xCqOUISOzspXEWpplZxehf131dUj_Pbqx3nVygKSD

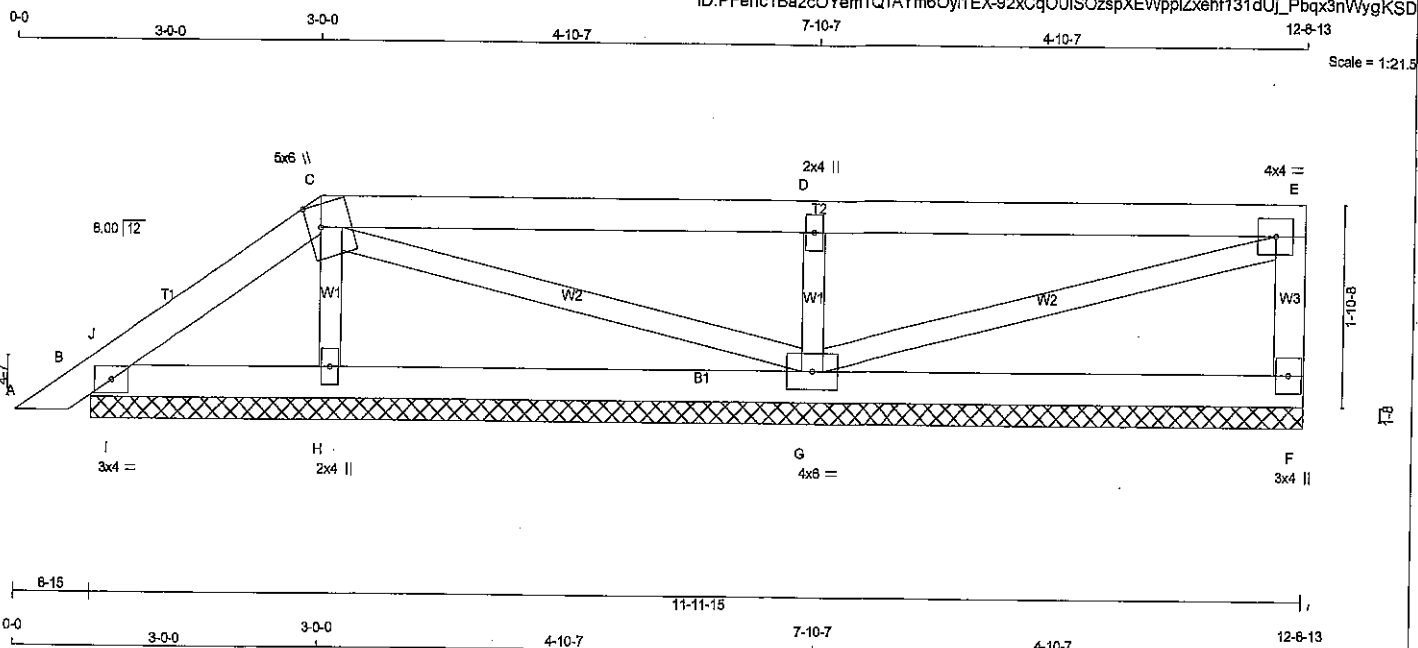

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - I	2x4	DRY	No.2
I - K	2x4	DRY	No.2
K - M	2x4	DRY	No.2
M - O	2x4	DRY	No.2
O - Q	2x4	DRY	No.2
Q - S	2x4	DRY	No.2
S - U	2x4	DRY	No.2
U - W	2x4	DRY	No.2
W - Y	2x4	DRY	No.2
Y - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
Z - A	2x4	DRY	No.2
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - I	2x4	DRY	No.2
I - J	2x4	DRY	No.2
J - K	2x4	DRY	No.2
K - L	2x4	DRY	No.2
L - M	2x4	DRY	No.2
M - N	2x4	DRY	No.2
N - O	2x4	DRY	No.2
O - P	2x4	DRY	No.2
P - Q	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
R - S	2x4	DRY	No.2
S - T	2x4	DRY	No.2
T - U	2x4	DRY	No.2
U - V	2x4	DRY	No.2
V - W	2x4	DRY	No.2
W - X	2x4	DRY	No.2
X - Y	2x4	DRY	No.2
Y - Z	2x4	DRY	No.2
Z - A	2x4	DRY	No.2

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMB1-I	MT20	3.0	4.0
C	TTWW+m	MT20	5.0	6.0 2.50 1.50
D	TMW+w	MT20	2.0	4.0
E	TMW+t	MT20	4.0	4.0
F	BMV1+p	MT20	3.0	4.0
G	BMWWW1+t	MT20	4.0	6.0
H	BMW1+w	MT20	2.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX
F	210	0	210	0	11-11-15	11-11-15
B	194	0	194	0	11-11-15	11-11-15
H	321	0	321	0	11-11-15	11-11-15
G	877	0	877	0	11-11-15	11-11-15

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	173	95 / 0	40 / 0	0 / 0	0 / 0	38 / 0	0 / 0
B	142	106 / 0	14 / 0	0 / 0	0 / 0	22 / 0	0 / 0
H	278	131 / 0	79 / 0	0 / 0	0 / 0	68 / 0	0 / 0
G	550	315 / 0	119 / 0	0 / 0	0 / 0	116 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, B, H, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED	FACTORED	MAX. FACTORED	FACTORED
FR-TO	FORCE (LBS)	VERT. LOAD (PLF)	MEMB. FORCE (LBS)	MEMB. FORCE (LBS)
		FROM TO	FR-TO	FR-TO
A-B	0/14	-84.3 -84.3 0.03 (1)	10.00	H-C -198/0 0.03 (1)
B-J	-32/0	-84.3 -84.3 0.01 (1)	6.25	C-G -27/0 0.01 (1)
J-C	-49/0	-84.3 -84.3 0.05 (1)	6.25	G-D -512/0 0.07 (1)
C-D	0/0	-84.3 -84.3 0.34 (1)	10.00	D-E 0/0 0.00 (1)
D-E	0/0	-84.3 -84.3 0.34 (1)	10.00	E-F -121/0 0.00 (1)
E-F	-156/0	0.0 0.0 0.02 (1)	7.81	
B-I	0/36	-28.0 -28.0 0.05 (1)	10.00	
I-H	0/38	-28.0 -28.0 0.05 (2)	10.00	
H-G	0/25	-28.0 -28.0 0.17 (2)	10.00	
G-F	0/0	-28.0 -28.0 0.17 (3)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 25.6	PSF
	DL = 3.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 46.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.34 (C-D:1), BC=0.17 (G-H:2), WB=0.07 (D-G:1), SSI=0.20 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MT20	618	354	1687
	822	2264	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.27 (D) (INPUT = 0.90)
JSI METAL= 0.09 (D) (INPUT = 1.00)

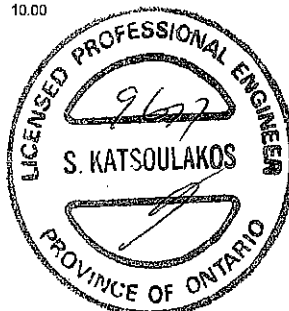

DRWG NO. TAM5008517
STRUCTURAL
COMPONENT ONLY

LUS - Double Shear Joist Hangers

SIMPSON

Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

MATERIAL: 18 gauge

FINISH: G90 galvanized

DESIGN:

- Factored resistances are in accordance with CSA 086-14
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.



INSTALLATION:

- Use all specified fasteners
- Nails: 10d = 0.162" dia. x 3 1/2" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

OPTIONS:

- These hangers cannot be modified.


Typical LUS Installation

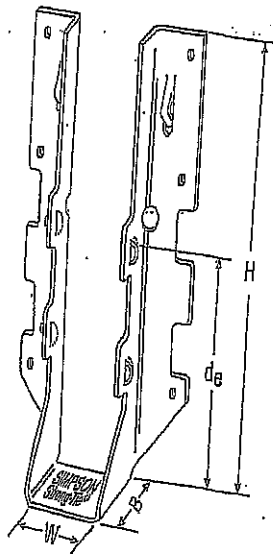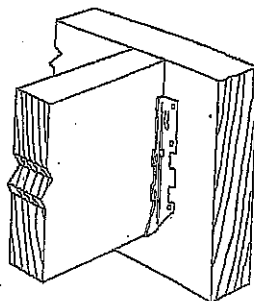

LUS28


Model No.	Ga	Dimensions (in)				Fasteners		Factored Resistances (lbs)			
		W	H	B	d _g	Face	Joist	D-Fir-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
LUS24	18	1 1/4	3 1/4	1 1/4	1 1/4	4-10d	2-10d	710	1680	645	1155
LUS24-2	18	3 1/4	3 1/4	2	1 1/4	4-10d	2-10d	885	2020	590	1435
LUS26	18	1 1/4	4 1/4	1 1/4	3/8	4-10d	4-10d	1420	2170	1290	1630
LUS26-2	18	3 1/4	4 1/4	2	4	4-10d	4-10d	1720	2595	1545	1920
LUS26-3	18	4 1/4	4 1/4	2	3/4	4-10d	4-10d	1720	2595	1545	2340
LUS28	18	1 1/4	6 1/4	1 1/4	3/8	8-10d	4-10d	1420	2520	1280	1760
LUS28-2	18	3 1/4	7	2	4	8-10d	4-10d	1720	3325	1545	2575
LUS28-3	18	4 1/4	6 1/4	2	3/4	8-10d	4-10d	1720	3325	1545	2375
LUS210	18	1 1/4	7 1/4	1 1/4	3/8	8-10d	4-10d	1420	2785	1290	2210
LUS210-2	18	3 1/4	9	2	6	8-10d	8-10d	2580	4500	2320	3195
LUS210-3	18	4 1/4	8 1/4	2	5 1/4	8-10d	8-10d	2580	3345	2320	2375

1. d_g is the distance from the seat of the hanger to the highest joist nail.




Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent
6,803,580



Double Shear Nailing Top View.

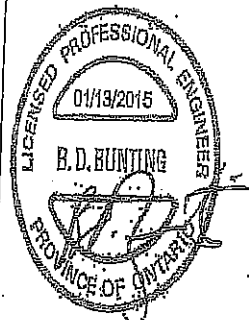

HUS/LJS - Double Shear Joist Hangers



All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

MATERIAL: See table

FINISH: G90 galvanized

DESIGN:


- Factored resistances are in accordance with CSA 086-14
- Uplift resistances have been increased 15%
No further increase is permitted
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

INSTALLATION:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/4" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

OPTIONS:


- See current catalogue for options




LJS26DS

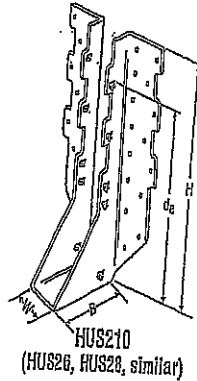


HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation

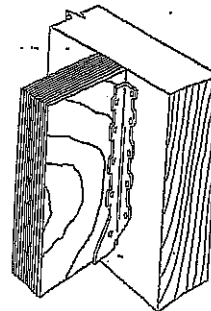


Typical HUS
Installation



Typical HUS Installation
(Truss Designer to provide fastener
quantity for connecting multiple
members together)


Model No.	Ba	Dimensions (in)			Fasteners		Factored Resistance (lbs)			
		W	H	B	d _g ¹	Face	D-Fir-L		S-P-F	
						Joist	Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
LJS26DS	18	1 1/4	6	3 1/2	4 1/2	18-16d	2065	4265	1460	4116
HUS28	18	1 1/4	6 1/2	3	3 1/4	14-16d	2705	4940	2065	3875
HUS28	16	1 1/4	7 1/2	3	6 1/2	22-16d	3605	5365	2875	4345
HUS210	18	1 1/4	8 1/2	3	7 1/4	30-16d	4505	5795	4010	4740
HUS1.81/10	18	1 1/4	9	3	8	30-16d	4605	6450	4010	5200

1. d_g is the distance from the seat of the hanger to the highest joist nail.




Double Shear Nailing prevents tabs breaking off (available on some models).


U.S. Patent
5,603,560



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

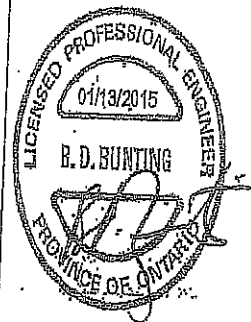

U.S. PATENT
DESIGN


© 2016 Simpson Strong-Tie Company. All rights reserved. This document is for informational purposes only and should not be used as a substitute for engineering design. For more information, visit www.simpsonstrongtie.com. SPEC-HUS16-115-EXD-12/16

800-999-5099
www.simpsonstrongtie.com

MICRO CITY

ENGINEERING SERVICES INC.

TEL: (519) 287-2242

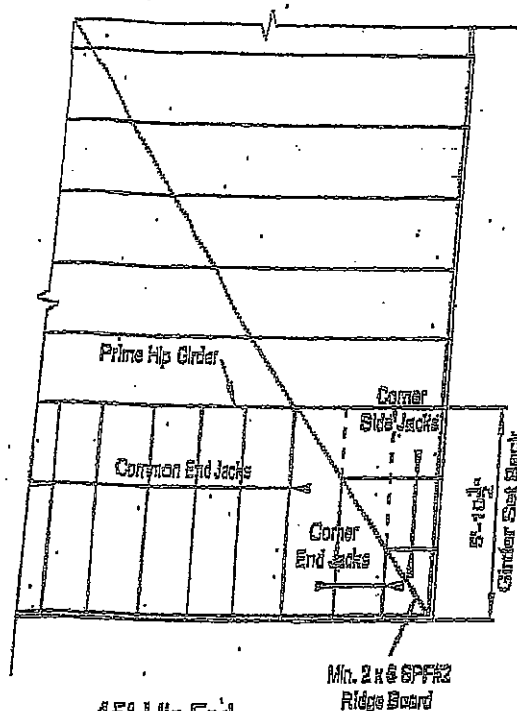

LUMBER SPECIFICATION

TOP CHORD : 2x4 SPF#2

BOTTOM CHORD : 2x4 SPF#2

WEBS : 2x8 SPF#2

UNLESS OTHERWISE SHOWN

DESIGN LOAD:

TOP CHORD LIVE LOAD : 39.4 P.S.F.





TOP CHORD DEAD LOAD : 3.0 P.S.F.

BOTTOM CHORD LIVE LOAD : 10.5 P.S.F.

BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.

TOTAL LOAD : 59.9 P.S.F.

DWG NO. T1W2495.10
STRUCTURAL
COMPONENT ONLY

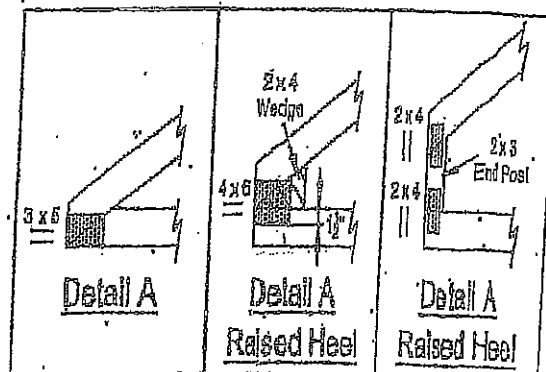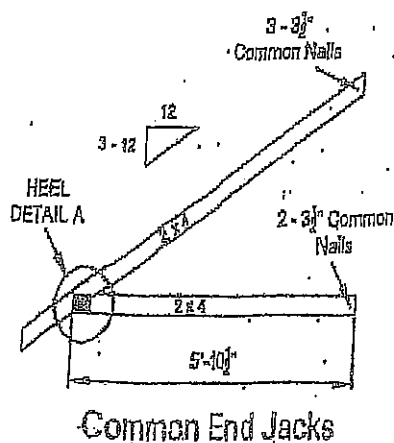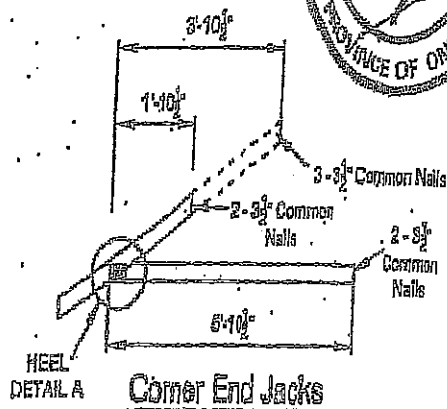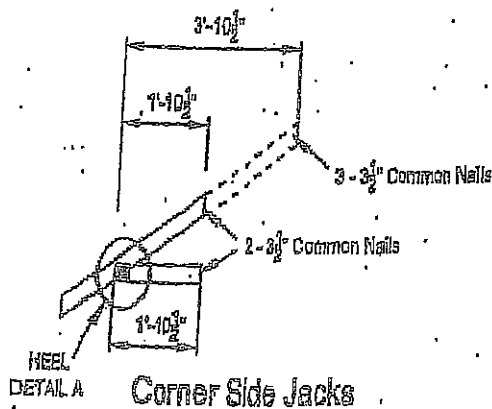


NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (LIMIT STATES DESIGN)

LUMBER SPECIFICATION

TOP CHORD : 2x4 SPF#2
 BOTTOM CHORD : 2x4 SPF#2
 WEBS : 2x3 SPF#2
 UNLESS OTHERWISE SHOWN



DESIGN LOAD:

TOP CHORD LIVE LOAD : 34.8 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.
 TOTAL LOAD : 44.8 P.S.F.

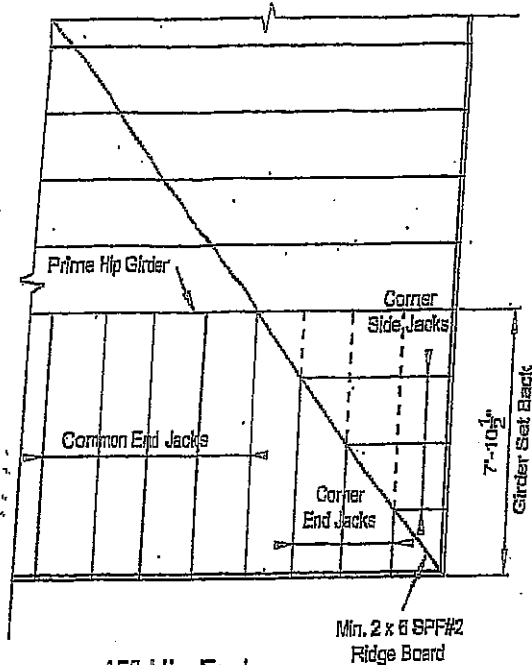


45° Hip End


DWG NO YAM 3503 14
 STRUCTURAL
 COMPONENT ONLY

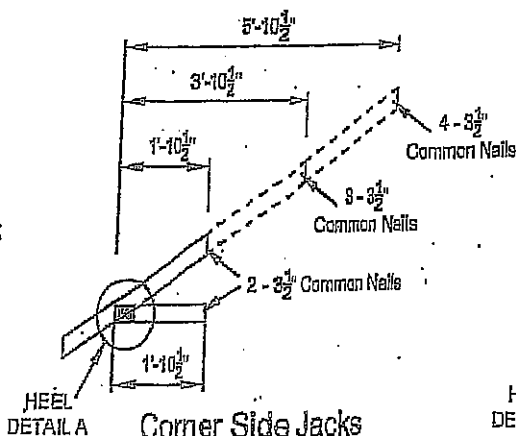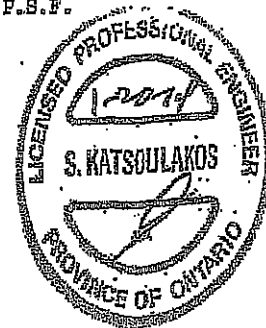


Corner Side Jacks

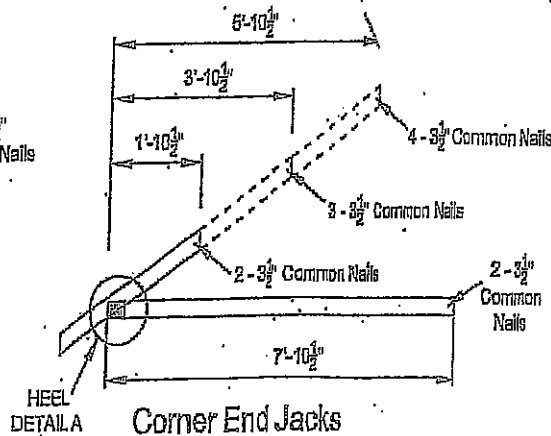

Corner End Jacks

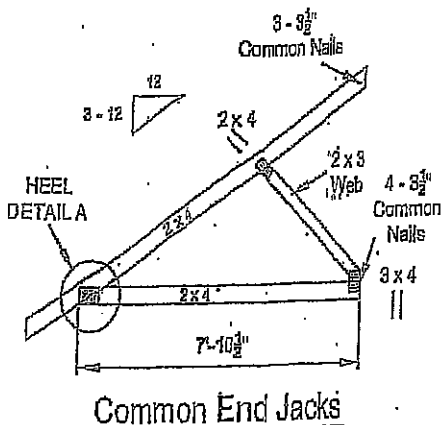

Common End Jacks

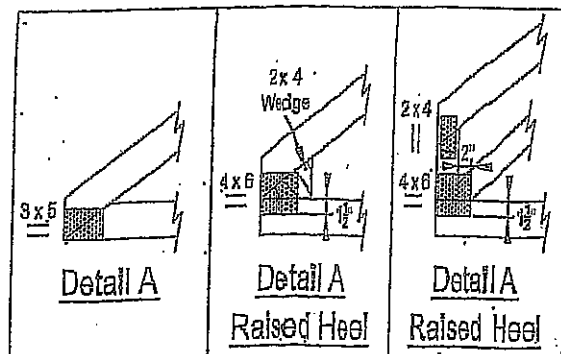


NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (LIMIT STATES DESIGN)
 (TO BE INCLUDED AND USED AS PART OF A FULL TRUSS ENGINEERING PACKAGE)

Symbols

PLATE LOCATION AND ORIENTATION

Center plate on joint unless x, y offsets are indicated.
Dimensions are in ft-in-sixteenths or mm.
Apply plates to both sides of truss and fully embed teeth.

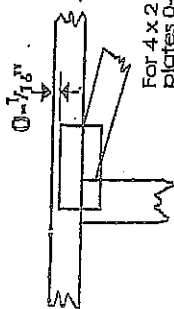

For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.

This symbol indicates the required direction of slots in connector plates.

*Plate location details available in Mitek software or upon request.

PLATE SIZE

4 x 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

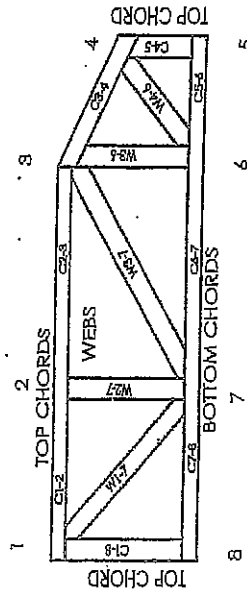

JOINTS ARE GENERALLY NUMBERED/LETTERED COUNTERCLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.


CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 Mitek® All Rights Reserved



Mitek Engineering Reference Sheet: MJD-7473C rev. 10-08

General Safety Notes


Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative 1:1, or Eliminator bracing should be considered.
3. Never exceed the design loadings shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and waste at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Micro City Engineering Services Inc.
(BCIN: 26064; FIRM BCIN: 29991)

RR #1, Po Box 61
Glencoe, Ontario
N0L 1M0

(519) 287 - 2242; Fax: (519) 287 - 5750 (Call)

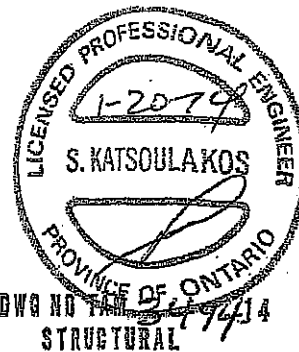

Responsibilities:

Micro City Engineering Services is responsible for the design of trusses as individual components.

It is the responsibilities of others to ascertain that the design loads utilized on this (these) drawing(s) meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdiction over such decisions.

All dimensions are to be verified by the owner, contractor, architect, or other authority having input over such decisions prior to truss component manufacture. At no time shall Micro City Engineering Services Inc. or its employees be responsible for dimension errors.

Micro City Engineering Services Inc. bears no responsibility for the erection of any truss components. Persons erecting truss components are cautioned to seek professional advice regarding temporary and permanent bracing systems and to be **totally** familiar with all aspects of truss erection prior to proceeding on **any** truss component erection job. Any bracing shown on Micro City Engineering Services Inc. or Tamarack Roof Trusses Inc. sealed or unsealed truss component drawings is specified for the single truss component in question and is identified as an integral part of the design for that particular truss component but is **not** meant to represent the only required bracing for that particular truss component when installed as a component in a series of truss components in a roof truss system.

~~It is the truss manufacturer's responsibility to ensure that trusses are manufactured in accordance with Micro City Engineering Services Inc. specifications outlined below:~~

SPECIFICATIONS:

Truss components sealed by Micro City Engineering Services Inc. must conform to the relevant sections of the current Building Code of Ontario and Canada (Part 4 or Part 9) or the current Farm Building Code of Canada in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the Truss Plate Institute of Canada (TPIC). All unit lumber and nailing stresses identified on truss component design drawings and/or used in the design of individual truss components shall conform to the current CSA Wood Design standard identified in the current Building Code and TPIC Design Standards.

The lumber used to manufacture any truss component is to conform to the specified size and grade identified on the truss drawing.

The lumber used in the manufacture of any truss component is not to exceed 19% during its service use unless specifically noted on the truss drawing.

The lumber used in the manufacture of any truss component is not to be treated with any chemicals during its service life unless specifically noted on the truss drawing.

Connector plates shall be applied to both faces of the truss component at each joint and shall be positioned exactly as specified.

The top chord of any truss component is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the sealed truss component drawing but not exceeding 24" o/c (Part 9 design) and not exceeding 48" o/c (Part 4 or Agricultural design).

When a truss component is to be installed with no rigid ceiling attached directly to the bottom chord, then the bottom chord is to be laterally braced at intervals not exceeding 3m (or 10'-0").

All sealed or unsealed truss component drawings provided by Micro City Engineering Services Inc. Or Tamarack Roof Trusses Inc. should be read in conjunction with the following:

Warning-Verify design parameters and READ NOTES ON THIS AND INCLUDED MITEK REFERENCE PAGE MII-7473C rev 10-'08 BEFORE USE. Design valid for use only with Mitek connectors. This design is based only upon parameters shown, and is for individual building component. Applicability of design parameters and proper incorporation of component is the responsibility of the building designer - not the truss designer. Bracing shown is for lateral support of individual web members only. Additional temporary bracing to insure stability during construction is the responsibility of the erector. Additional permanent bracing of the overall structure is the responsibility of the building designer. For general guidance regarding fabrication, quality control, storage, delivery, erection, and bracing, consult TPIC Appendix G - Minimum Quality Manufacturing Criteria available from www.tpica.ca and BCSI Building Component Safety Information available from the Truss Plate Institute, 781 N. Lee Street, Suite 312, Alexandria, VA, 22314.