

CONSTRUCTION NOTES (UNLESS OTHERWISE NOTED)
ALL CONSTRUCTION TO ADHERE TO THESE PLANS AND SPEC'S AND TO CONFORM TO THE ONTARIO BUILDING CODE AND ALL OTHER APPLICABLE CODES AND AUTHORITIES HAVING JURISDICTION. THESE REQUIREMENTS ARE TO BE TAKEN AS MINIMUM SPECIFICATIONS. ONT. REG. 332/12 - 2012 OBC.

1 ROOF CONSTRUCTION (*SEE OBC 9.19.)

NO. 210 (10.25kg/m²) ASPHALT SHINGLES. 10mm (3/8") PLYWOOD SHEATHING WITH "H" CLIPS. APPROVED WOOD TRUSSES @600mm (24") o.c. MAX. APPROVED EAVE PROTECTION TO EXTEND 900mm (3'-0") FROM EDGE OF ROOF AND MIN. 300mm (12") BEYOND INNER FACE OF EXTERIOR WALL. 38x84 (2"x4") TRUSS BRACING @ 1030mm (6'-0") o.c. AT BOTTOM CHORD. PREFIN. ALUM. EAVESTROUGH, FASCIA, RAIL & VENTED SOFFIT. PROVIDE ICE & WATER SHIELD TO ALL ROOF / WALL SURFACES SUSCEPTIBLE TO DAMPING. ROOF SHEATHING TO BE FASTENED 150 (6") o.c. ALONG EDGES & INTERMEDIATE SUPPORTS WHEN TRUSSES SPACED GREATER THAN 406 (16"). ATTIC VENTILATION 1:800 OF INSULATED CEILING AREA WITH 50% AT EAVES.

2 FRAME WALL CONSTRUCTION (2"x6")

SIDING, HARDIE BOARD, STUCCO BOARD OR EQUAL AS PER ELEVATION. 19x64 (1"x3") VERTICAL WOOD FURRING. APPROVED SHEATHING PAPER, 1/16" O.S.B. EXTERIOR SHEATHING. 38x140 (2"x6") STUDS @ 400mm (16") o.c. W/APPROVED DIAGONAL WALL BRACING, RSI 3.81 (R22) INSUL. APPROVED VAPOUR BARRIER AND APPROVED CONT. AIR BARRIER. 13mm (1/2") INT. DRYWALL FINISH.

3 BRICK VENEER CONSTRUCTION (2"x6")

40mm (4") FACE BRICK 25mm (1") AIR SPACE. 22x150x0.16mm (1/8"x1"x0.03") GALV. METAL TIES @ 400mm (16") o.c. HORIZONTAL 600mm (24") o.c. VERTICAL APPROVED SHEATHING PAPER, 1/16" O.S.B. EXTERIOR SHEATHING. 38x140 (2"x6") STUDS @ 400mm (16") o.c. W/APPROVED DIAGONAL WALL BRACING, RSI 3.81 (R22) INSUL. APPROVED VAPOUR BARRIER AND APPROVED CONT. AIR BARRIER. 13mm (1/2") INT. DRYWALL FINISH. PROVIDE KEEPS HOLES @ 800mm (32") o.c. BOTTOM COURSE AND OVER OPENINGS. PROVIDE BASE FLASHING UP MIN. 150mm (6") BEHIND BUILDING PAPER.

3A STUCCO WALL CONSTRUCTION (2"x6")

STUCCO CLADDING SYSTEM CONFORMING TO OBC 9.21.1.2.2) & 9.28 THAT EMPLOY A MINIMUM 6mm (1/4") DRAINAGE CAVITY BEHIND THE CLADDING WITH POSITIVE DRAINAGE TO THE EXTERIOR AND APPLIED AS PER MANUFACTURERS SPECIFICATION ON 25mm (1") MINIMUM EXTRUDED OR EXPANDED RIGID INSULATION, APPROVED SHEATHING PAPER, 1/16" O.S.B. EXTERIOR SHEATHING. 38x140 (2"x6") STUDS @ 400mm (16") o.c. W/APPROVED DIAGONAL WALL BRACING, RSI 3.81 (R22) INSUL. APPROVED VAPOUR BARRIER AND APPROVED CONT. AIR BARRIER. 13mm (1/2") INT. DRYWALL FINISH. STUCCO TO BE MIN. 200mm (8") ABOVE FINISH GRADE.

4 INTERIOR STUD PARTITIONS

(*SEE OBC 9.23.10. & 9.23.11.)
BEARING PARTITION 38x84 (2"x4") @ 400mm (16") o.c. FOR 2 STOREYS AND 300mm (12") o.c. FOR 3 STOREYS. NON-BEARING PARTITIONS 38x84 (2"x4") @ 600mm (24") o.c. PROVIDE 38x84 (2"x4") BOTTOM PLATE AND 2/38x84 (2"x4") TOP PLATE. 13mm (1/2") INTERIOR DRYWALL. BOTH SIDES OF STUD, PROVIDE 38x140 (2"x6") STUDS/PLATES WHERE NOTED.

5 FOUNDATION WALL/FOOTINGS:

(*SEE OBC 9.15.3 & 9.15.4.)
MIN. 200mm (8") POURED CONC. FDN. WALL 15MPa (2200psi) WITH BITUMENOUS DAMPROOFING AND DRAINAGE LAYER. MIN. 480x155 (19"x6") CONTIN. KEYED CONC. FTG. BRACE FOUNDATION WALL PRIOR TO BACKFILLING. ALL FOOTINGS SHALL REST ON NATURAL UNDISTURBED SOIL WITH MINIMUM BEARING CAPACITY OF 120KPa (11.4 psi) OR GREATER.

6 WEeping TILE (*SEE OBC 9.14.3.)

100mm (4") DIA. WEEPING TILE 150mm (6") CRUSHED STONE OVER AND AROUND WEEPING TILES.

7 BASEMENT SLAB (*SEE OBC 9.16.)

90mm (3") MIN. 25MPa (3600psi) CONC. SLAB ON 100mm (4") COARSE GRANULAR FILL, OR 15MPa (2200psi) CONC. WITH DAMPROOFING BELOW SLAB.

8 WOOD SUBFLOORS (*SEE OBC 9.23.14. & 9.30.2.)

19mm (3/4") T&G SUBFLOOR UNDER GROUND FLOOR FINISH FLOOR. 16mm (5/8") T&G SUBFLOOR UNDER SECOND FLOOR FINISH FLOOR. 16mm (5/8") PANEL-TYPE UNDERLAY FOR CERAMIC TILE APPLICATION. 6mm (1/4") PANEL-TYPE UNDERLAY UNDER RESILIENT & PARQUET FLOORINGS.

9 ROOF INSULATION (*SEE SB12 - 2.1.1.2.A & 2.1.1.7)

RSI 10.51 (R60) ROOF INSULATION AND APPROVED VAPOUR BARRIER. 16mm (5/8") INT. DRYWALL FINISH OR APPROVED EQUAL.

10 ALL STAIRS/EXTERIOR STAIRS (*SEE OBC 9.8.)

MAX. RISE = 200 (7'-10")
MIN. RUN = 210 (6'-10")
MIN. TREAD = 235 (7'-10")
MAX. NOSING = 25 (1")
MIN. HEADROOM = 1950 (6'-5")
RAIL @ LANDING = 900 (2'-11")
RAIL @ STAIR = 865 (2'-10") TO 965 (3'-2")
MIN. STAIR WIDTH = 860 (2'-10")

FOR CURVED STAIRS
MIN. AVG. RUN = 200 (8")
MIN. RUN = 150 (6")

11 RAILING (*SEE OBC 9.8.8.)

FINISHED RAILING ON PICKETS SPACED MAXIMUM 100mm (4") BETWEEN PICKETS.

INTERIOR GUARDS = 900mm (2'-11") MIN.
EXTERIOR GUARDS = 1070mm (3'-6") MIN.

12 SILL PLATE (*SEE OBC 9.23.6 & 9.23.7.)

38x84 (2"x4") SILL PLATE WITH 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") o.c. CAULKING OR 25 (1") MIN. MINERAL WOOL BETWEEN PLATE AND TOP OF FDN. WALL. USE MORTAR TO LEVEL SILL PLATE WHEN REQUIRED.

13 BASEMENT INSULATION (*SEE OBC 12.3.)

FOUNDATION WALLS ENCLOSING HEATED SPACE SHALL BE INSULATED FROM THE UNDERSIDE OF THE SUBFLOOR TO NOT MORE THAN 152mm (6") ABOVE THE FINISHED FLOOR OF THE BASEMENT AND NOT LESS THAN 50mm (2") TO THE SLAB. FOUNDATION WALL INSULATION SHALL BE MINIMUM RSI 3.52 (R20) BLANKET INSULATION, APPROVED VAPOUR BARRIER, DAMPROOFING WELDS. PAPER BETWEEN THE FDN. AND INSUL.

14 BASEMENT BEARING STUD PARTITION (*SEE OBC 9.23.10.)

38x84 (2"x4") STUDS @ 400mm (16") o.c. 38x84 (2"x4") SILL PLATE ON DAMPROOFING MATERIAL, 13mm (1/2") DIA. ANCHOR BOLTS 200mm (8") LONG, EMBEDDED MIN. 100mm (4") INTO CONC. @ 2400mm (7'-10") o.c. (4") HIGH CONC. CURB ON 305x155 (12"x6") CONC. FOOTING. ADD HORIZ. BLOCKING AT MID-HEIGHT IF WALL IS UNFINISHED.

15 STEEL BASEMENT COLUMN (*SEE OBC 9.17.3.)

40mm (3-1/2") DIA. x 4.78mm (186) STL. COL. WITH 150x150x4.5mm (6"x6"x3/8") STL. TOP & BOTTOM PLATE.

15A STEEL COLUMN (*SEE OBC 9.17.3.)

40mm (3-1/2") DIA. x 4.78mm (186) STL. COLUMN WITH 100x100x6.4mm (4"x4"x1/4") STEEL TOP & BOTTOM PLATE. FIELD HELD BOTTOM PLATE TO 250x100x12.5mm (10"x4"x1/2") BASE PLATE C/W 2-13mm (1/2") DIA. x 300mm (12") LONG x 50mm (2") HOOK ANCHORS.

16 NIB WALLS (*SEE OBC 9.23.8.)

BEAM POCKET OR 200x200 (8"x8") POURED CONCRETE NIB WALLS. MINIMUM BEARING 90mm (3-1/2")

17 STEEL BEAM STRAPPING (*SEE OBC 9.23.4.3.(3)(C))

19x36 (1"x2") CONTINUOUS WOOD STRAPPING BOTH SIDES OF STEEL BEAM.

18 GARAGE SLAB (*SEE OBC 9.16.)

100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. SLOPE TO FRONT 1% MIN.

19 INTERIOR GARAGE WALLS & CEILING (*SEE OBC 9.10.9.16.)

13mm (1/2") GYPSUM BOARD ON WALL AND CEILING BETWEEN HOUSE AND GARAGE, RSI 3.81 (R22) IN WALLS, RSI 5.46 (R31) IN CEILING. TAPE AND SEAL ALL JOINTS GAS TIGHT.

20 GARAGE DOOR GASPROOFING (*SEE OBC 9.10.13.15.)

DOOR AND FRAME GASPROOFING. DOOR EQUIPPED WITH SELF CLOSING DEVICE AND WEATHER STRIPPING.

21 EXTERIOR STEP

(*SEE OBC 9.8.9.2, 9.8.9.3 & 9.8.10.)
PRECAST CONCRETE STEP OR MD. STEP WHERE NOT EXPOSED TO WEATHER MAX. RISE 200mm (7'-10") MINIMUM TREAD 250mm (9'-1/2")

22 DRYER VENT (*SEE OBC 6.2.3.8.(7))

CAPPED DRYER EXHAUST VENTED TO EXTERIOR. USE 1000mm (4") DIA. SMOOTH WALL VENT PIPE.

23 ATTIC ACCESS (*SEE OBC 9.19.2.)

ATTIC ACCESS HATCH 545x100 (22"x28") WITH WEATHERSTRIPPING, RSI 5.46 (R31) RIGID INSULATION BACKING.

24 FIREPLACE CHIMNEYS (*OBC 9.21.)

TOP OF FIREPLACE CHIMNEY SHALL BE 915mm (3'-0") ABOVE THE HIGHEST POINT AT WHICH IT COMES IN CONTACT WITH THE ROOF AND 610mm (2'-0") ABOVE THE ROOF SURFACE WITHIN A HORIZ. DISTANCE OF 3050mm (10'-0") FROM THE CHIMNEY.

25 LINEN CLOSET

4 SHELVES MIN. 350mm (14") DEEP.

26 MECHANICAL EXHAUST (*SEE OBC 9.32.3.5, 9.32.3.10.)

MECHANICAL EXHAUST FAN VENTED TO EXTERIOR.

27 STEEL BEARING PLATE FOR MASONRY WALLS

280x280x16 (11"x11"x5/8") STL. PLATE FOR STL. BEAMS AND 280x280x12 (11"x11"x1/2") STL. PLATE FOR WOOD BEAMS BEARING ON CONC. BLOCK PARTYWALL. ANCHORED W/ 2-19mm (3/4") x200mm (8") LONG GALV. ANCHORS WITHIN SOLID BLOCK COURSE. LEVEL WITH NON-SHRINK GROUT.

28 CLASS 'B' VENT

ULC. RATED CLASS 'B' VENT 610mm (2'-0") ABOVE THE JLT. IN CONTACT WITH THE ROOF FOR SLOPES UP TO 1/12, REFER TO THE ONTARIO GAS UTILIZATION CODE.

29 WOOD BASEMENT POST (*OBC 9.17.4.)

3-58x140 (3-2"x6") BUILT-UP POST ON METAL BASE SHOE ANCHORED TO CONC. WITH 12.7 (1/2") DIA. BOLT ON 406x406x203 (16"x16"x8") CONC. FOOTING.

30 STEP FOOTINGS (*OBC 9.15.3.9.)

MIN. HORIZ. STEP = 610mm (24"). MAX. VERT. STEP = 610mm (24")

31 SLAB ON GRADE (*SEE OBC 9.16.)

100mm (4") 32MPa (4640psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT ON OPT. 100 (4") COARSE GRANULAR FILL WITH COMPACTED SUB-BASE OR COMPACTED NATIVE FILL. REINFORCED W/ 6x6x4.5mm (2"x2"x1/4") MESH PLACED NEAR MID-DEPTH OF SLAB.

32 DIRECT VENT FURNACE

DIRECT VENT FURNACE TERMINAL MIN. 900mm (36") FROM A GAS REGULATOR, MIN. 300mm (12") ABOVE FIN. GRADE, FROM ALL OPENINGS, EXHAUST & INTAKE VENTS. HRV INTAKE TO BE A MIN. OF 1830mm (6'-0") FROM ALL EXHAUST TERMINALS. REFER TO GAS UTILIZATION CODE.

33 DIRECT VENT GAS FIREPLACE

DIRECT VENT GAS FIREPLACE VENT TO BE A MINIMUM 300mm (12") FROM ANY OPENING AND ABOVE FIN. GRADE. REFER TO GAS UTILIZATION CODE.

34 JOIST STRAPPING & BRIDGING (*SEE OBC 23.9.4.)

ALL FLOOR JOISTS TO BE BRIDGED WITH 38x36 (2"x2") CROSS BRACING OR SOLID BLOCKING @2100mm (6'-11") o.c. MAX. 19x64 (1"x3") @2100mm (6'-11") o.c. UNLESS A PANEL TYPE CEILING FINISH IS APPLIED.

35 EXPOSED BUILDING FACE (*SEE OBC 9.10.15.)

EXTERIOR WALLS TO HAVE A FIRE RESISTANCE RATING OF NOT LESS THAN 45min. WHERE LIMITING DISTANCE IS LESS THAN 1.2M (3'-11") WHERE THE LIMITING DISTANCE IS LESS THAN 600mm (1'-11") THE EXPOSING FACE SHALL BE GLAD IN NON-COMBUSTIBLE MATERIAL.

36 GOLF CELLAR PORCH SLAB (*SEE OBC 9.40.)

FOR MAX. 2500mm (8'-2") PORCH DEPTH, 125mm (5") 32MPa (4640 psi) CONC. SLAB WITH 5-8% AIR ENTRAINMENT. REINF. WITH 10M BARS @200mm (8") o.c. EACH WAY IN BOTTOM THIRD OF SLAB, ANCHORED IN PERIMETER FDN. WALLS W/ 610x610 (24"x24") 10M @600mm (24") o.c. DOVELS. SLOPE SLAB MIN. 1.0% FROM DOOR. SLAB TO HAVE A MIN. 75mm (3") BEARING ON FDN. WALLS. PROVIDE (4x10) LINTELS OVER CELLAR DOOR.

37 FDN. WALL REDUCTION IN THICKNESS (*SEE OBC 9.15.4.7.)

FDN. WALL SHALL NOT BE REDUCED TO LESS THAN 90mm (3-1/2") THICK TO A MAX. DEPTH OF 660mm (26") FOR 8" FDN. WALL. 10" FDN. WALL WHEN REDUCTION IN THICKNESS IS GREATER THAN 26". FDN. WALL SHALL BE TIED TO THE FACING MATERIAL WITH METAL TIES SPACED 200mm (8") o.c. VERTICALLY AND 900mm (36") o.c. HORIZONTALLY. FILL SPACE BETWEEN WALL AND FACING SOLID WITH MORTAR.

38 CONVENTIONAL ROOF FRAMING (*SEE OBC 9.23.4.2.(1))

FOR MAX. 2240mm (7'-4") SPAN, 38x84 (2"x4") RAFTERS @400mm (16") o.c. FOR MAX. 3530mm (11'-7") SPAN, 38x140 (2"x6") RAFTERS @400mm (16") o.c. RIDGE BOARD TO BE 51mm (2") DEEPER, 38x84 (2"x4") COLLAR TIES AT MIDSPANS. CEILING JOISTS TO BE 38x84 (2"x4") @400mm (16") o.c. FOR MAX. 2530mm (8'-3") SPAN & 38x140 (2"x6") @ 400 (16") o.c. FOR MAX. 4450mm (14'-7") SPAN. RAFTERS FOR BUILT-UP ROOF TO BE 38x84 (2"x4") @600mm (24") o.c. WITH A 38x84 (2"x4") CENTER POST TO THE TRUSS BELOW, LATERALLY BRACED @1800mm (6'-0") o.c. VERTICALLY.

39 TWO STOREY VOLUME SPACES

FOR A MAXIMUM 5440mm (18'-0") HEIGHT, PROVIDE 2-38x140 (2-2"x6") CONTINUOUS STUDS @300mm (12") o.c. FOR BRICK AND 400mm (16") o.c. FOR SIDING. PROVIDE SOLID WOOD BLOCKING BETWEEN STUDS @1220mm (4'-0") o.c. VERT. 1/16" EXT. PLYWOOD.

40 EXPOSED FLOOR TO EXTERIOR (*SB12 - 2.1.1.2.A)

PROVIDE RSI 5.46 (R31) INSULATION, APPROVED VAPOUR BARRIER AND CONTINUOUS AIR BARRIER, FINISHED SOFFIT.

41 PARTYWALLS

TYPICAL 1 HOUR RATED PARTYWALL. REFER TO DETAILS FOR TYPE AND SPECIFICATIONS.

42 EXTERIOR WALLS FOR WALK-OUT CONDITION

THE EXTERIOR BASEMENT STUD WALL TO BE 38x140mm (2"x6") STUDS @400mm (16") o.c. MATCH FLOOR JOIST SPACING WHEN PARALLEL WITH FLOOR JOISTS.

43 SMOKE ALARM (*OBC 9.10.19)

WITHIN DWELLING UNITS, SUFFICIENT SMOKE ALARMS SHALL BE INSTALLED SO THAT:
a. THERE IS AT LEAST ONE SMOKE ALARM INSTALLED ON EACH STOREY, INCLUDING BASEMENTS AND
b. ON ANY STOREY OF A DWELLING UNIT CONTAINING SLEEPING ROOMS, A SMOKE ALARM IS INSTALLED,
1. IN EACH SLEEPING ROOM, AND
2. IN A LOCATION BETWEEN THE SLEEPING ROOMS AND THE REMAINDER OF THE STOREY, AND IF THE SLEEPING ROOMS ARE SERVED BY A HALLWAY, THE SMOKE ALARM SHALL BE LOCATED IN THE HALLWAY.

A SMOKE ALARM SHALL HAVE A VISUAL SIGNALING COMPONENT CONFORMING TO THE REQUIREMENTS IN 10.5.5. (LIGHT, COLOR AND PULSE CHARACTERISTIC) OF NFPA 72, "NATIONAL FIRE ALARM AND SIGNALING CODE".

A SMOKE ALARM SHALL BE INSTALLED IN CONFORMANCE WITH CANULC-5553, "INSTALLATION OF SMOKE ALARMS".

SMOKE ALARMS SHALL BE INSTALLED ON OR NEAR THE CEILING.

44 CARBON MONOXIDE ALARM (*OBC 9.33.4.)

WHERE A FUEL-BURNING APPLIANCE IS INSTALLED IN A SUITE OF RESIDENTIAL OCCUPANCY, A CARBON MONOXIDE ALARM SHALL BE INSTALLED TO EACH SLEEPING AREA IN THE SUITE.

THE CARBON MONOXIDE ALARM SHALL

- BE PERMANENTLY CONNECTED TO AN ELECTRICAL CIRCUIT AND SHALL HAVE NO DISCONNECT SWITCH BETWEEN THE OVERCURRENT DEVICE AND THE CARBON MONOXIDE ALARM.
- BE EQUIPPED WITH AN ALARM THAT IS AUDIBLE IN ALL BEDROOMS WHEN THE INTERVENING DOORS ARE CLOSED, WHERE LOCATED ADJACENT TO A SLEEPING AREA, AND
- CONFORM TO
 - CANULC-6.9, "RESIDENTIAL CARBON MONOXIDE ALARMING DEVICES", OR
 - UL2034, "SINGLE AND MULTIPLE STATION CARBON MONOXIDE ALARMS"

45 SOIL GAS CONTROL (*OBC 9.13.4.)

PROVIDE CONSTRUCTION TO PREVENT LEAKAGE OF SOIL GAS INTO THE BUILDING AS REQUIRED.



REVISIONS	
5.	
4.	
3.	
2.	
1. ISSUED FOR PERMIT	JUL 30, 2018

The undersigned has reviewed and takes responsibility for this design and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required: See design is exempt under Division C, Subsection 3.2.5 of the Building Code

VIKAS SAJJAR
NAME
SIGNATURE
28770
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4098
F (905) 660-0746

REGION DESIGN INC.

SHEET TITLE
GENERAL NOTES

SCALE
N.T.S.

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.
1

Greenpark.

PROJECT NAME
MINNISLAE HOMES CORP.

15-611388000000
2012 CODE
COMPLIANCE PACKAGE "A1"

BUY OF BRAMPTON BUILDING DIVISION REVIEWED
JAN 08 2019
BY MARK DERKSEN

WINDOWS - CANADA ZONE C

- (1) **MINIMUM BEDROOM WINDOW** (*OBC 9.9.10.1.)
AT LEAST ONE BEDROOM WINDOW ON A GIVEN FLOOR IS
TO HAVE MIN. 0.35m² (3.8 SQFT.) UNOBSTRUCTED GLAZED
OPENABLE AREA WITH MIN. CLEAR WIDTH OF 380mm (1'-3")
GLASS AREA NOT MORE THAN 17% OF GROSS
PERIPHERAL WALL AREA.
MAXIMUM U-VALUE 0.28
- (2) **WINDOW GUARDS** (*OBC 9.8.8.1(6))
A GUARD IS REQUIRED WHERE THE TOP OF THE WINDOW
SILL IS LOCATED LESS THAN 400mm (1'-6") ABOVE FIN.
FLOOR AND THE DISTANCE FROM THE FIN. FLOOR TO THE
ADJACENT GRADE IS GREATER THAN 1800mm (5'-11")

GENERAL:

- (1) **MECHANICAL VENTILATION**
MECHANICAL VENTILATION IS REQUIRED TO PROVIDE 0.3
AIR CHANGES PER HOUR, AVERAGED OVER 24 HOURS.
SEE MECHANICAL DRAWINGS.
- (2) **REINFORCEMENT FOR GRAB BARS** (*OBC 9.5.2.3.)
REINFORCEMENT OF STUD WALLS FOR FUTURE GRAB
BARS SHALL BE INSTALLED ADJACENT TO WATER
CLOSETS AND SHOWER OR BATHTUB IN MAIN BATHROOM.
SEE DETAIL ON PAGE 11.

LUMBER:

- 1) ALL LUMBER SHALL BE SPRUCE-PINE-FIR No.1&2 GRADE,
UNLESS NOTED OTHERWISE.
- 2) LUMBER EXPOSED TO THE EXTERIOR TO BE
SPRUCE-PINE-FIR No.1&2 GRADE PRESSURE TREATED OR
CEDAR, UNLESS NOTED OTHERWISE.
- 3) ALL BEAMS, GIRDER TRUSSES, AND METAL HANGER
CONNECTIONS SUPPORTING ROOF FRAMING TO BE
DESIGNED & CERTIFIED BY TRUSS MANUFACTURER.
- 4) LVL BEAMS SHALL BE 2.0E (E=28000psi MIN.). NAIL
EACH PLY OF LVL WITH 89mm (3-1/2") LONG COMMON
WIRE NAILS @ 300mm (12") O.C. STAGGERED IN 2 ROWS
FOR 1B4, 240, & 300mm (1-1/4", 1-1/2", 1-1/8") DEPTHS AND
STAGGERED IN 3 ROWS FOR GREATER DEPTHS AND FOR
4 PLY MEMBERS ADD 1/2" (13mm) DIA. GALVANIZED
BOLTS BOLTED AT MID-DEPTH OF BEAM @ 915mm
(3'-0") O.C.
- 5) PROVIDE TOP MOUNT BEAM HANGERS FOR ALL LVL BEAM
TO BEAM CONNECTIONS UNLESS NOTED OTHERWISE.
- 6) PROVIDE METAL JOIST HANGERS FOR ALL JOISTS AND
BUILT-UP WOOD MEMBERS INTERSECTING FLUSH BUILT-UP
WOOD MEMBERS.
- 7) WOOD FRAMING NOT TREATED WITH A WOOD
PRESERVATIVE, IN CONTACT WITH CONCRETE, SHALL BE
SEPARATED FROM THE CONC. BY AT LEAST 2mil.
POLYETHYLENE FILM, No.50 (45lbs) ROLL ROOFING OR
OTHER DAMPROOFING MATERIAL, EXCEPT WHERE THE
WOOD MEMBER IS AT LEAST 150mm (6") ABOVE THE
GROUND.

STEEL:

STRUCTURAL STEEL AND HOLLOW STRUCTURAL SECTIONS
SHALL CONFORM TO CAN/CSA-G40-21 GRADE 350H.

REINFORCING STEEL SHALL CONFORM TO CSA-G30-18M
GRADE 400R.

ELECTRIC VEHICLE CHARGING SYSTEM (EVCS):

ROUGH-IN FOR FUTURE VEHICLE SUPPLY EQUIPMENT
(CHARGING SYSTEM) TO BE INSTALLED. ROUGH-IN SHALL
INCLUDE:

- A MINIMUM 200amp PANEL BOARD,
- CONDUIT THAT IS NOT LESS THAN 1 1/16" (27mm)
TRADE SIZE,
- A SQUARE 4 11/16" (119mm) TRADE SIZE ELECTRICAL
OUTLET BOX,
- FUME-PROOFED ELECTRICAL OUTLET BOX TO BE
INSTALLED IN THE GARAGE OR CARPORT OR
ADJACENT TO DRIVEWAY.

REFER TO 2012 O.B.C. 9.34.4

STABILITY OF NARROW (20'-25') & TALL (±30') HOUSES

BUILDER TO PROVIDE SUFFICIENT TEMPORARY BRACING
TO RESIST WIND LOADING WHEN UNDER CONSTRUCTION.
FURTHER RECOMMENDATIONS:

- 1) REDUCE THE FOUNDATION WALL SILL PLATE ANCHOR
BOLT SPACINGS FROM 2400mm o.c. (7'-10") TO 1220mm o.c.
(4'-0") FOR STANDARD CONDITIONS.
- 2) USE 95mm (3/8") THICK PLYWOOD OR WAFFERBOARD FOR
THE EXTERIOR WALL SHEATHING.
- 3) TO STIFFEN THE STRUCTURE IN TRANSVERSE DIRECTION
USE 45mm (3/8") THICK PLYWOOD NAILED TO THE
INTERIOR PARTITIONS ON EACH FLOOR FOR A MINIMUM 2
INTERIOR PARTITION WALLS ON BOTH SIDES AND
PERPENDICULAR TO THE LONG WALLS.

BRICK VENEER LINTELS

WL1 = 3-1/2"x3-1/2"x1/4" (40x40x6.0L) + 2-2"x8" SPR. No.2
WL2 = 4"x3-1/2"x5/16" (100x40x8.0L) + 2-2"x8" SPR. No.2
WL3 = 5"x3-1/2"x5/16" (125x40x8.0L) + 2-2"x10" SPR. No.2
WL4 = 6"x3-1/2"x3/8" (150x40x10.0L) + 2-2"x12" SPR. No.2
WL5 = 6"x4"x3/8" (150x100x10.0L) + 2-2"x12" SPR. No.2
WL6 = 5"x3-1/2"x5/16" (125x40x8.0L) + 2-2"x12" SPR. No.2
WL7 = 5"x3-1/2"x5/16" (125x40x8.0L) + 3-2"x10" SPR. No.2
WL8 = 5"x3-1/2"x5/16" (125x40x8.0L) + 3-2"x12" SPR. No.2
WL9 = 6"x4"x3/8" (150x100x10.0L) + 3-2"x12" SPR. No.2

WOOD LINTELS AND BEAMS

WB1 = 2-2"x8" SPR. No.2 (2-38x184 SPR. No.2)
WB2 = 3-2"x8" SPR. No.2 (3-38x184 SPR. No.2)
WB3 = 2-2"x10" SPR. No.2 (2-38x235 SPR. No.2)
WB4 = 3-2"x10" SPR. No.2 (3-38x235 SPR. No.2)
WB5 = 2-2"x12" SPR. No.2 (2-38x286 SPR. No.2)
WB6 = 3-2"x12" SPR. No.2 (3-38x286 SPR. No.2)
WB7 = 5-2"x12" SPR. No.2 (5-38x286 SPR. No.2)
WB8 = 4-2"x10" SPR. No.2 (4-38x235 SPR. No.2)
WB12 = 4-2"x12" SPR. No.2 (4-38x286 SPR. No.2)

LOOSE STEEL LINTELS

L1 = 3-1/2"x3-1/2"x1/4" (40x40x6.0L)
L2 = 4"x3-1/2"x5/16" (100x40x8.0L)
L3 = 5"x3-1/2"x5/16" (125x40x8.0L)
L4 = 6"x3-1/2"x3/8" (150x40x10.0L)
L5 = 6"x4"x3/8" (150x100x10.0L)
L6 = 7"x4"x3/8" (175x100x10.0L)

LAMINATED VENEER LUMBER (LVL) BEAMS

LVL1A = 1-1 3/4" x 7 1/4" (1-45x184)
LVL1 = 2-1 3/4" x 7 1/4" (2-45x184)
LVL2 = 3-1 3/4" x 7 1/4" (3-45x184)
LVL3 = 4-1 3/4" x 7 1/4" (4-45x184)
LVL4A = 1-1 3/4" x 9 1/2" (1-45x240)
LVL4 = 2-1 3/4" x 9 1/2" (2-45x240)
LVL5 = 3-1 3/4" x 9 1/2" (3-45x240)
LVL5A = 4-1 3/4" x 9 1/2" (4-45x240)
LVL6A = 1-1 3/4" x 11 7/8" (1-45x300)
LVL6 = 2-1 3/4" x 11 7/8" (2-45x300)
LVL7 = 3-1 3/4" x 11 7/8" (3-45x300)
LVL7A = 4-1 3/4" x 11 7/8" (4-45x300)
LVL8 = 2-1 3/4" x 14" (2-45x356)
LVL9 = 3-1 3/4" x 14" (3-45x356)
LVL10 = 2-1 3/4" x 16" (2-45x456)

DOOR SCHEDULE

1 = 2'-10" x 6'-8" (865x2033) - INSULATED ENTRANCE DOOR
1a = 2'-8" x 6'-8" (815x2033) - INSULATED FRONT DOORS
2 = 2'-8" x 6'-8" (815x2033) - WOOD & GLASS DOOR
3 = 2'-8" x 6'-8" x 1-3/4" (815x2033x45) - EXTERIOR SLAB DOOR
4 = 2'-8" x 6'-8" x 1-3/8" (815x2033x35) - INTERIOR SLAB DOOR
5 = 2'-6" x 6'-8" x 1-3/8" (760x2033x35) - INTERIOR SLAB DOOR
6 = 2'-2" x 6'-8" x 1-3/8" (660x2033x35) - INTERIOR SLAB DOOR
7 = 1'-6" x 6'-8" x 1-3/8" (460x2033x35) - INTERIOR SLAB DOOR

LEGEND

DJ	DOUBLE JOIST
TJ	TRIPLE JOIST
GT	GIRDER TRUSS
X	POINT LOAD
□	SOLID WOOD BEARING. SOLID BEARING TO BE WIDE AT LEAST AS SUPPORTED MEMBER. MIN. 3 PIECES.
///	LOAD-BEARING WALL
XXX	TWO-STORY WALL. SEE NOTE 39
— — —	FLAT ARCH
F.D.	FLOOR DRAIN
SA	SMOKE ALARM. SEE NOTE 43
SA ORA	SMOKE ALARM & CARBON MONOXIDE ALARM. SEE NOTE 44




2012 CODE COMPLIANCE PACKAGE "A1"


5.		The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code. VIKAS GAJJAR NAME SIGNATURE 28770 BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S6 P (416) 736-4096 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE GENERAL NOTES	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.		
4.					SCALE N.T.S.	PAGE No. 2		
3.					DATE JULY 2018	PROJECT NAME MINNISLAE HOMES CORP.		
2.								
1.	ISSUED FOR PERMIT JAN 31, 2015							
REVISIONS								



A FIREWALL SHALL EXTEND FROM THE GROUND CONTINUOUSLY THROUGH, OR ADJACENT TO, ALL STOREYS OF A BUILDING. (O.B.C. 3.1.10.3 (1))



WALL TYPE
SEE SUPPLEMENTARY
STANDARDS 505 TABLE 1.
(WALL NO. B6E) 8"(190MM)
CONCRETE BLOCK WALL, WITH
1/2" x 1/2" STRAPPING & 1/2"
DRYWALL FILLED W/ SOUND
ABSORPTIVE MATERIAL EACH
SIDE. (PRR 2H)(3TG 57)

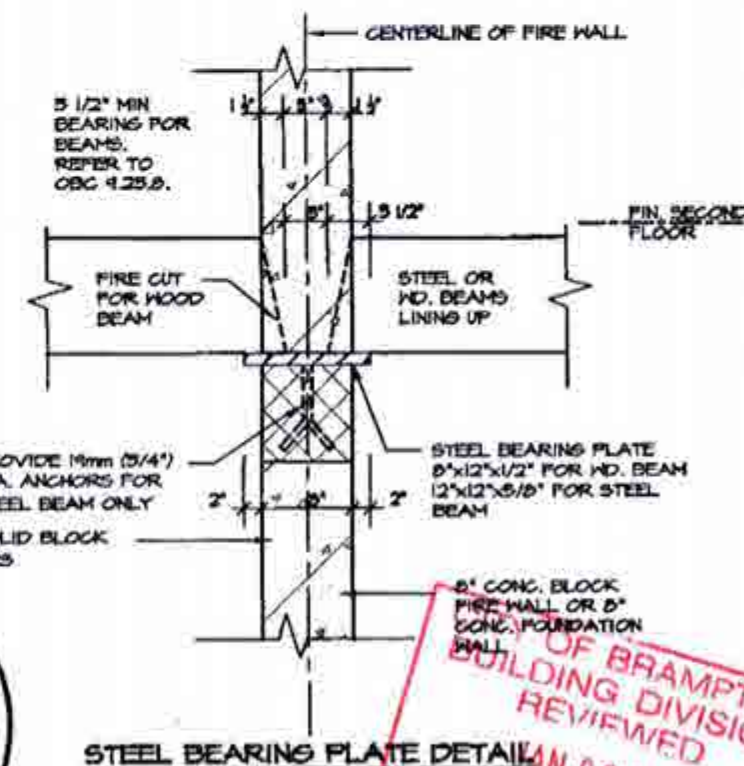

STEEL BEARING PLATE DETAIL

OF BRAMPTON
BUILDING DIVISION
REVIEWED
AN 08 2019

MARK BY
DERKSEA

2012 CODE

COMPLIANCE PACKAGE "A1"

5.		The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR  28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S8 P (416) 736-4096 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	 Greenpark™ PROJECT NAME MINNISALE HOMES CORP.	
4.					FIRE WALL			
3.					SCALE			3/4"=1'-0"
2.					DATE			JULY 2018
1.	ISSUED FOR PERMIT				JUL 30, 2018			PAGE NO.
REVISIONS								

A circular professional engineer seal for the Province of Ontario. The outer ring contains the text "REGISTERED PROFESSIONAL ENGINEER" at the top and "PROVINCE OF ONTARIO" at the bottom. In the center, the name "B. MARINKOVIC" is printed. Below the name is a stylized signature. The seal is stamped over the bottom portion of the letter "A" in the word "AMERICAN" on the resume page.

CONG. FTO. C/M 2"x4"
KEYWAY ON NATURAL
UNDISTURBED SOIL FOR S
SEE ARCHITECTURAL
DRAWINGS


PARTY WALL

3 ROWS (TOP, MIDDLE AND BOTTOM
OF 1"x4" STRAPPING TO RESTRAIN
INSULATION FROM FALLING OUT.


PROJECT NAME
MINNISALE HOMES CORP.

 **Greenpark.**


PRODUCT NAME
MINNISALE HOMES CORP.

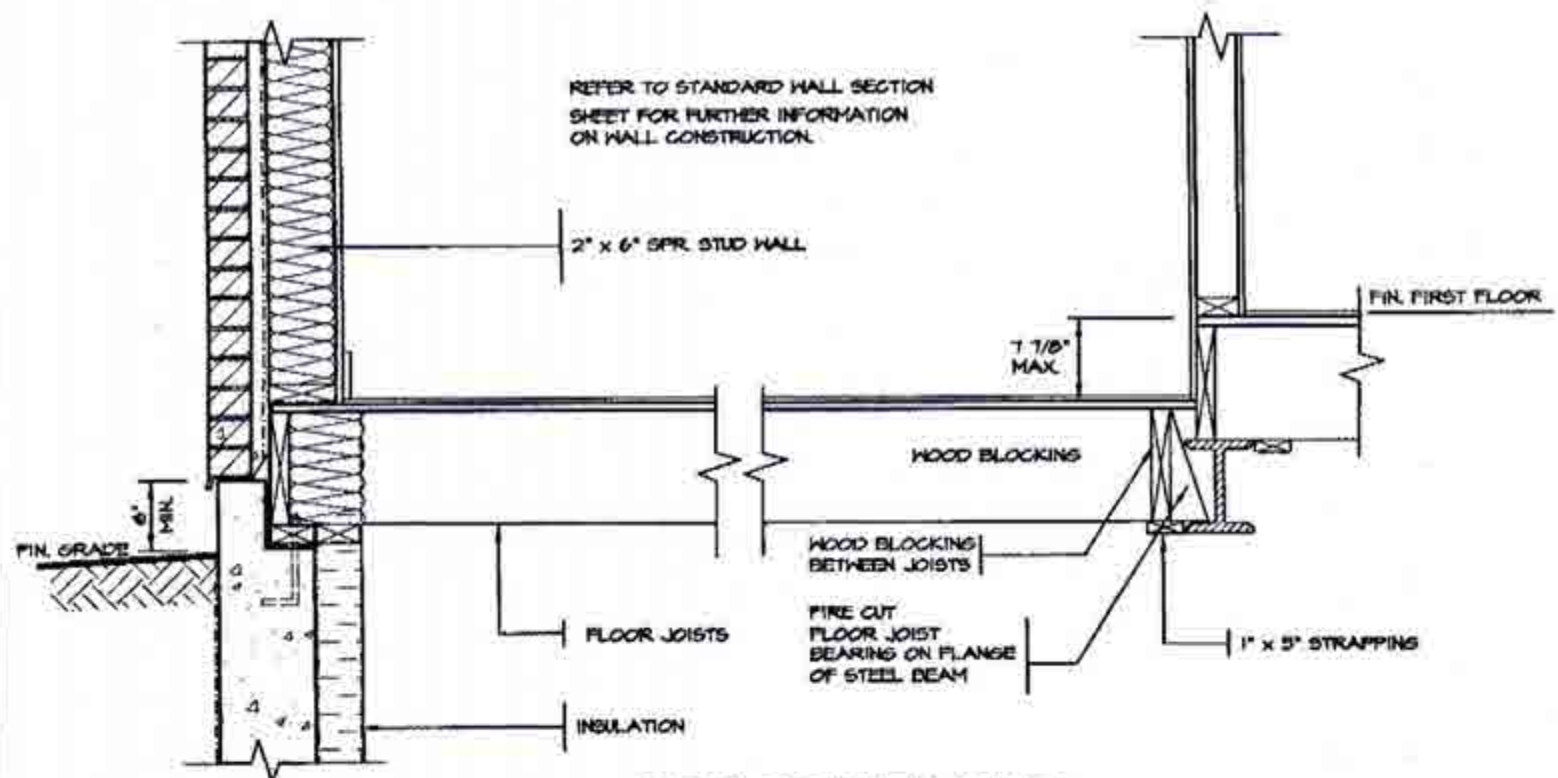

DETAIL OF SUNKEN LAUNDRY
(ONE RISER)

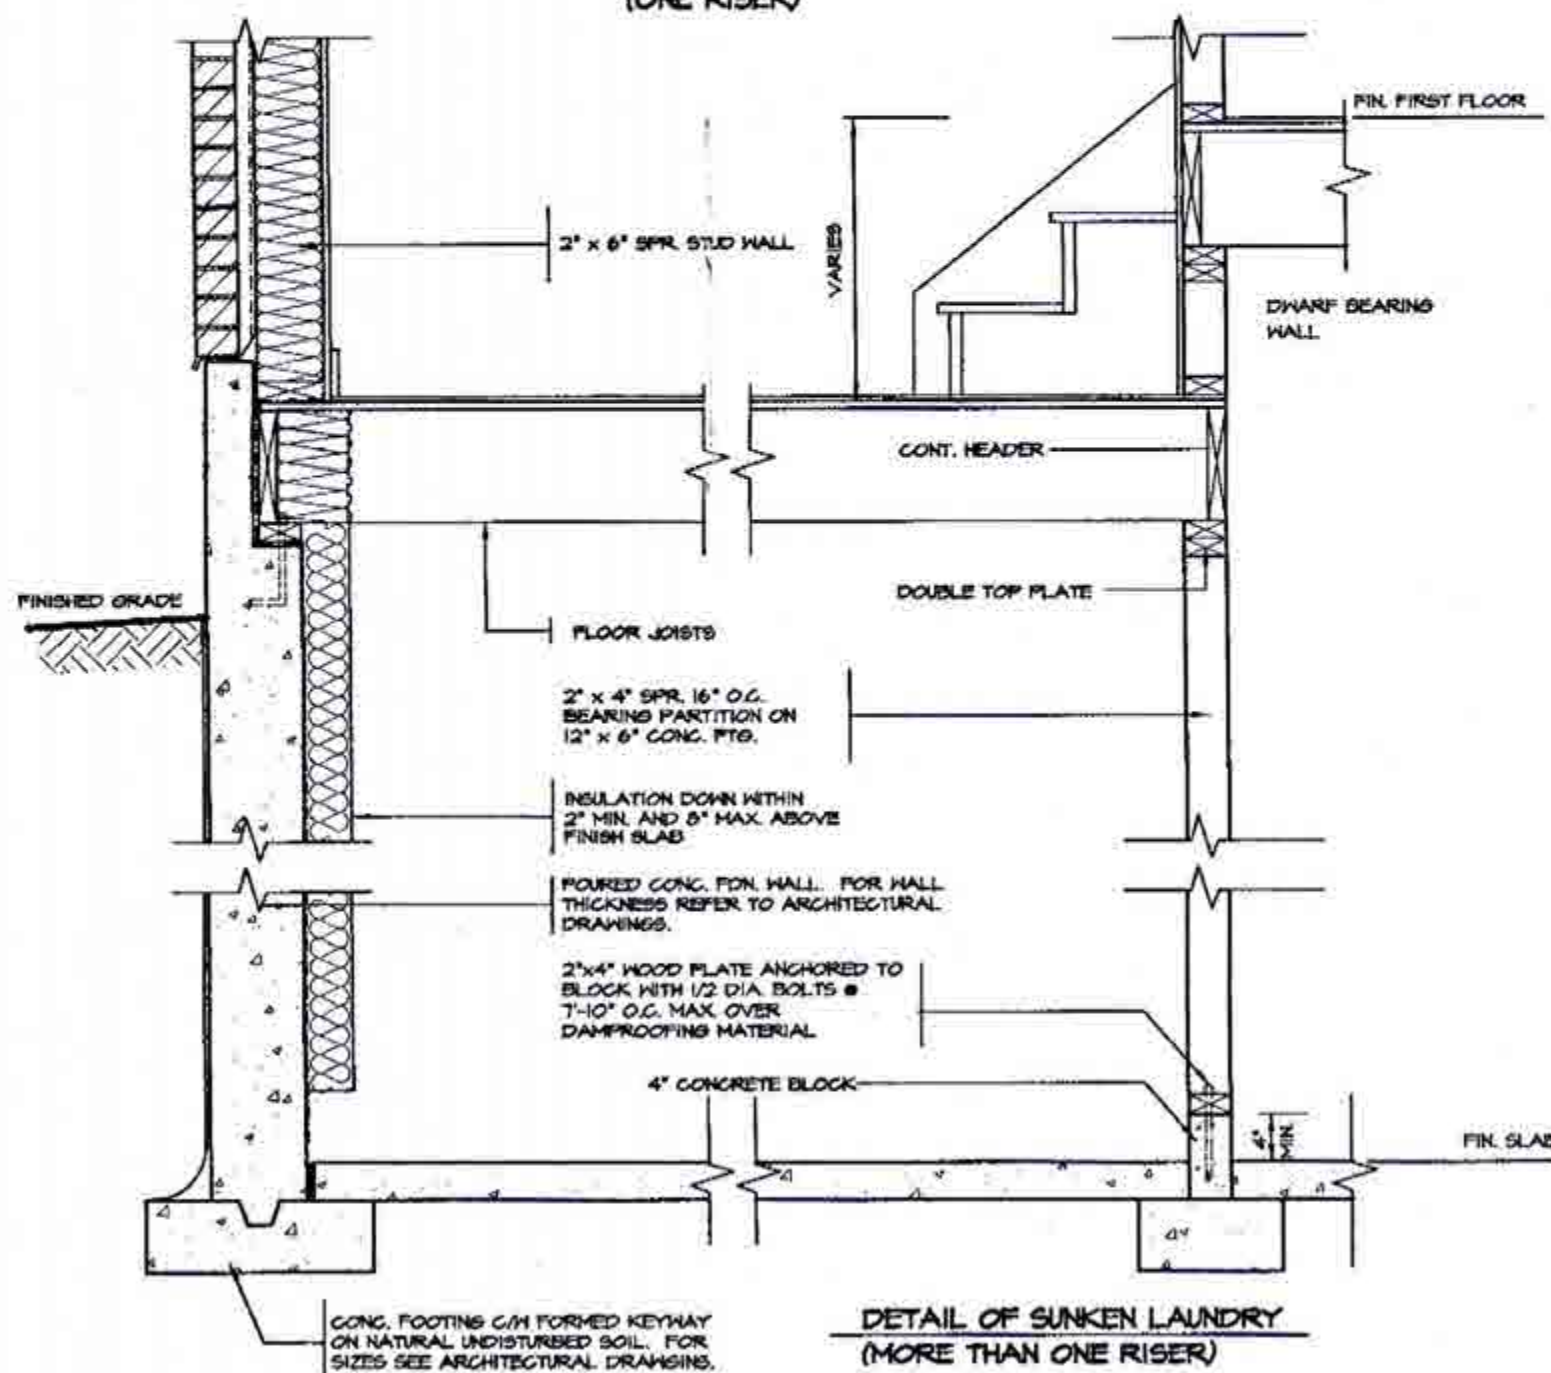

DETAIL OF SUNKEN LAUNDRY
(MORE THAN ONE RISER)

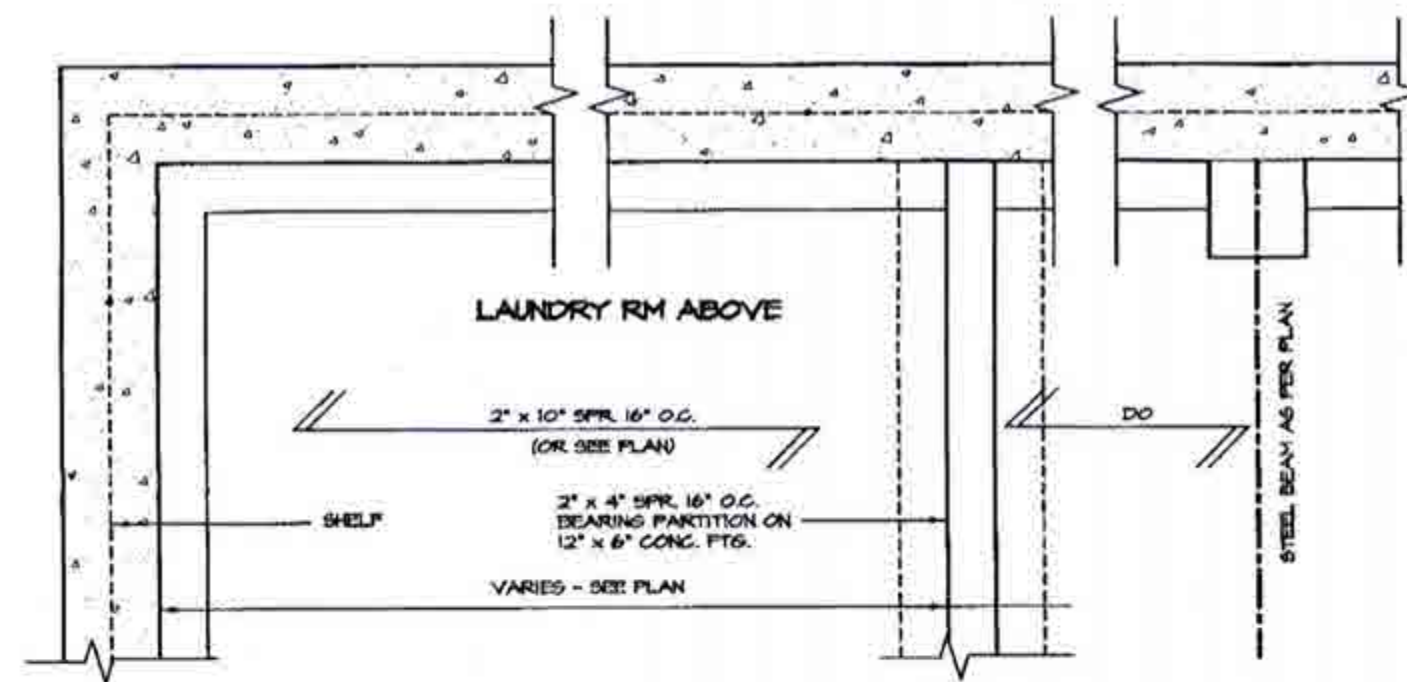

PARTIAL PLAN



FOR STRUCTURE ONLY

2012 CODE
COMPLIANCE PACKAGE "A1"

REVISIONS	
5.	
4.	
3.	
2.	
1. ISSUED FOR PERMIT	JUL 30, 2018

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME

28770
BCIN

SIGNATURE

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4098
F (905) 860-0746

**REGION
DESIGN
INC.**

SHEET TITLE
**LAUNDRY DETAILS
SUNKEN**

SCALE
3/4"=1'-0"

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.
5

Greenpark.

PROJECT NAME
MINNISALE HOMES CORP.

EAVER PROTECTION SHALL BE PROVIDED FROM THE EDGE OF ROOF A MIN. 3'-0" (900mm) UP FROM THE ROOF SLOPE TO A LINE NOT LESS THAN 1'-0" (300mm) INSIDE THE INNER FACE OF THE EXTERIOR WALL. EAVER PROTECTION SHALL BE LAID BENEATH THE STARTER STRIP AND SHALL CONSIST OF TYPE "H" OR TYPE "S" ASPHALT COATED ROOFING SHEETS.

210 ASPHALT SHINGLES ON 5/8" PLYWOOD SHEATHING USE "H" CLIPS FOR TRUSSES

BAFFLES AS REQUIRED FOR ROOF VENTILATION

PROVIDE ROOF VENTILATION @ A RATE OF 1:500 OF INSULATED CEILING AREA UNIFORMLY DISTRIBUTED

ROOF TRUSSES @ 24" O.C. MAX. RAISED HEEL TO MATCH PLATE

STARTER STRIP OF ROOF SHINGLES REQUIRED

SEE PLAN FOR ROOF SLOPE

2"x5" FASCIA BOARD PREFINISHED METAL GUTTER, FASCIA AND VENTED SOFFIT

1/2" (13mm) DRYWALL FINISH OVER CONT. 6 MIL. POLY VAPOR/AIR BARRIER & MIN. R-60 INSULATION

MIN. R-22 INSULATION (6") ABOVE INNER FACE OF EXTERIOR WALL

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

2"x6" BOTTOM PLATE

1/2" VAPOR AND AIR BARRIER 4" AND SECURE TO PLATE

FIN. FLOORING ON 5/8" T&G PLYWOOD

4" FACE BRICK TIED TO STUDS WITH GALVANIZED 1/8" WIDE METAL TIES @ 16" O.C. HORIZONTAL AND 24" O.C. VERTICAL

1" AIR SPACE

#15 BUILDING PAPER OVER 1/8" O.S.B. EXTERIOR SHEATHING, 2"x6" SPR. STUDS @ 16" O.C. FILLED WITH R-22 INSULATION AND 6 MIL. POLY VAPOR BARRIER

1/2" GYPSUM BOARD CEILING FINISH

CONTINUOUS TIMBERSTRAND

AIR BARRIER RUN BETWEEN DOUBLE TOP PLATE AND UP UNDER FLOOR PLATE

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

SINGLE CONTIN. TIMBERSTRAND

FIN. FLOORING ON 3/4" T&G PLYWOOD

FINISHED FIRST FLOOR

CONTINUOUS HEADER JOIST W/ R-22 INSULATION W/ 6 MIL. VAPOR BARRIER AND SEAL TO JOIST AND SUBFLOOR

SCREENED WEEPING HOLES 5/8" DIA. AT 24" O.C. AT BOTTOM OF CAVITY & MIL. POLYETHYLENE BASE FLASHING BENEATH WEEPING AND 6" UP BEHIND BUILDING PAPER

FIN. GRADE

SLOPE

MIN. 4'-0" PROTECT COVERAGE

HEAVY COAT OF BITUMEN OVER CONG. WALL

FOUNDATION WALLS TO BE WATER PROOFED OR PROVIDE A DRAINAGE LAYER ADJACENT TO EXT. SURFACE OF FOUNDATION WALL AND EXTEND TO FOOTING LAYER OR PROVIDE "SYSTEM PLANTON AIR GAP MEMBRANE"

CEMENT COVE

4" DIA. WEEPING TILES W/ 1/2" CRUSHED STONE COVER

FIN. SLAB

FINISHED SLAB

CAULK OR SEAL WITH GASKET

AIR BARRIER SECURED TO PLATE

2"x4" HOOD PLATE ANCHORED TO FOUNDATION WALLS WITH 1/2" DIA. BOLTS AT T-10" O.C. MIN. 4" INTO FOUNDATION WALL

R-20 BLANKET INSULATION DOWN WITHIN 2" MIN. AND 6" MAX. ABOVE FINISH SLAB WITH MOISTURE & VAPOR BARRIER SEALED AT TOP & BOTTOM

POURED CONG. FDN. WALL FOR WALL THICKNESS SEE ARCHITECTURAL DRAWINGS

CONTINUOUS WATERSTOP (BITUMEN CAULKING)

3" CONCRETE SLAB 25 MPa ON 4" MIN. COMPACT GRAVEL

CONG. FOOTING CAN FORMED KEYWAY ON NATURAL UNDISTURBED SOIL. FOR FOOTING SIZES SEE ARCHITECTURAL DRAWINGS.


2 STOREY WALL SECTION

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY S. HANNA
JAN 26 2019
ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH L.C.O.


1/2" (13mm) DRYWALL FINISH OVER CONT. 6 MIL. POLY VAPOR/AIR BARRIER & MIN. R-31 INSULATION (DRYWALL ON THE CEILING ONLY WHEN THERE IS NO SECOND FLOOR ABOVE GARAGE)

FIN. FLOORING ON 5/8" T&G PLYWOOD

FINISHED SECOND FLOOR

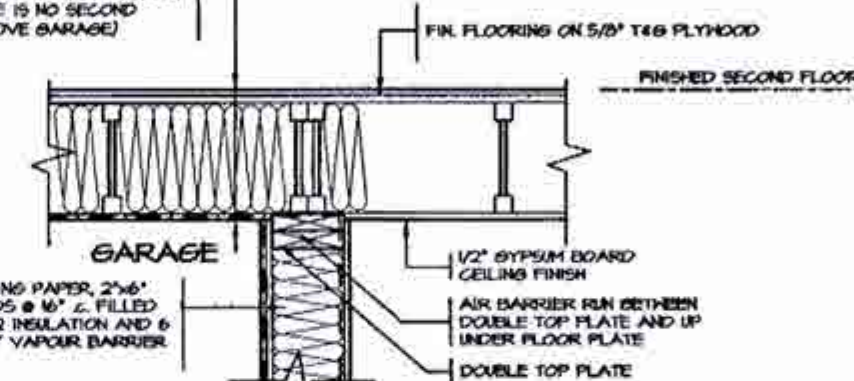

DETAIL FOR INTERIOR GARAGE WALLS & CEILINGS

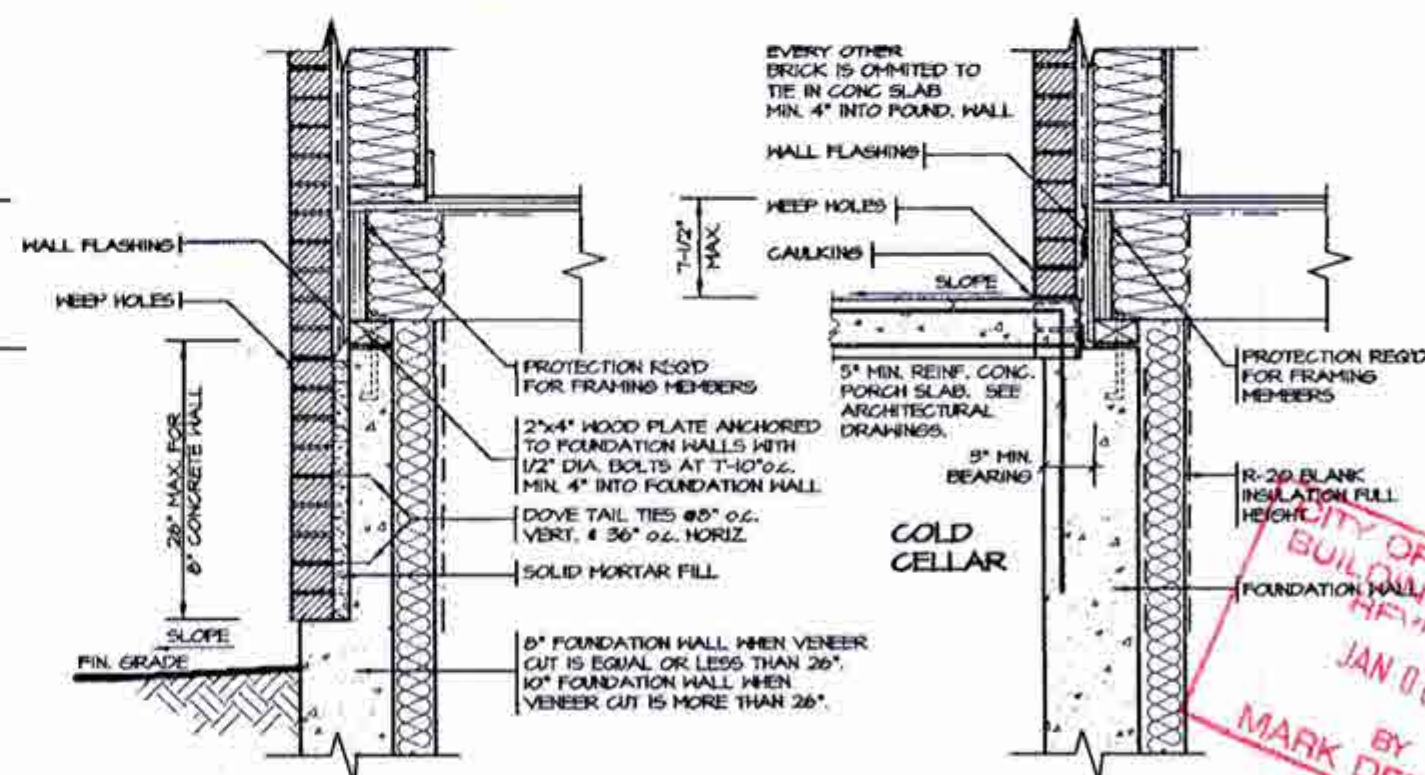

DETAIL FOR CONCRETE VENEER DROPPED GRADE

DETAIL FOR COLD CELLAR PORCH SLAB

2012 CODE
COMPLIANCE PACKAGE "A1"

Greenpark.

PROJECT NAME
MINNISALE HOMES CORP.

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME

28770
BCIN

SIGNATURE

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S0
P (416) 736-4098
F (905) 660-0746

**REGION
DESIGN
INC.**

SHEET TITLE
2"x6" BRICK VENEER
2 STOREY SECTION

SCALE
3/4"=1'-0"

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.
6

REVISIONS	
5.	
4.	
3.	
2.	
1. ISSUED FOR PERMIT	JUL 30, 2018

EAVE PROTECTION SHALL BE PROVIDED FROM THE EDGE OF ROOF A MIN. 3'-0" (900mm) UP FROM THE ROOF SLOPE TO A LINE NOT LESS THAN 1'-0" (300mm) INSIDE THE INNER FACE OF THE EXTERIOR WALL. EAVE PROTECTION SHALL BE LAID BENEATH THE STARTER STRIP AND SHALL CONSIST OF TYPE 'M' OR TYPE 'S' ASPHALT COATED ROOFING SHEETS.

210 ASPHALT SHINGLES ON 5/8" PLYWOOD SHEATHING USE 1" CLIPS FOR TRUSSES

STARTER STRIP OF ROOF SHINGLES REQUIRED

2"x6" FASCIA BOARD PREFINISHED METAL GUTTER, FASCIA AND VENTED SOFFIT

1 1/2"x8" RAISED STUCCO FRIEZE BOARD (TYP.)

MESH BACKRAPPED

- FIN. COAT OF EXTERIOR ACRYLIC STUCCO
- FIBER MESH EMBEDDED IN PREP. COAT
- INSULATION BOARD, (MIN. R5) W/ GEOMETRICALLY DEFINED DRAINAGE CAVITY HAVING A MIN. CAVITY DEPTH OF 1/4"
- AIR/MOISTURE BARRIER
- 7/16" EXTERIOR GRADE OSB SHEATHING
- 2" X 6" STUDS
- MIN. R-22 BATT INSULATION
- CONT. VAPOUR / AIR BARRIER
- 1/2" DRYWALL

(EIPS APPROVED SYSTEM, ALL MATERIALS AND SYSTEMS SHALL CONFORM TO CANULC-5716.1)

CONCRETE SILL

CONTINUOUS HEADER JOIST W/ R-22 INSULATION W/ 6 MIL. VAPOUR BARRIER AND SEAL TO JOIST AND SUBFLOOR

4" FACE BRICK TIED TO STUDS WITH GALVANIZED 1/8" WIDE METAL TIES @ 16" O.C. HORIZONTAL AND 24" O.C. VERTICAL

SCREENED WEEDING HOLES 3/8" DIA. AT 24" O.C. AT BOTTOM OF CAVITY 6 MIL. POLYETHYLENE BASE FLASHING BENEATH WEEDING AND 6" UP BEHIND BUILDING PAPER

HEAVY COAT OF BITUMEN OVER CONC. WALL

FOUNDATION WALLS TO BE WATER PROOFED OR PROVIDE A DRAINAGE LAYER ADJACENT TO EXT. SURFACE OF FOUNDATION WALL AND EXTEND TO FOOTING LAYER OR PROVIDE "SYSTEM PLANTION AIR GAP MEMBRANE"

CEMENT COVE

4" DIA. WEEDING TILES W/6" CRUSHED STONE COVER

FIN. SLAB

CONC. FOOTING CAN FORMED KEYWAY ON NATURAL UNDISTURBED SOIL. FOR FOOTING SIZES SEE ARCHITECTURAL DRAWINGS.

2 STOREY WALL SECTION

BAFFLES AS REQUIRED FOR ROOF VENTILATION

PROVIDE ROOF VENTILATION @ A RATE OF 1:300 OF INSULATED CEILING AREA UNIFORMLY DISTRIBUTED

ROOF TRUSSES @ 24" O.C. MAX. RAISED HEEL TO MATCH PLATE

TOP OF WOOD PLATE

1/2" (10mm) DRYWALL FINISH OVER CONT. 6 MIL. POLY VAPOUR/AIR BARRIER & MIN. R-50 INSULATION

MIN. R22 INSULATION ABOVE INNER FACE OF EXTERIOR WALL

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

2"x6" BOTTOM PLATE

LAP VAPOUR AND AIR BARRIER 4" AND SECURE TO PLATE

FIN. FLOORING ON 5/8" T&G PLYWOOD

FINISHED SECOND FLOOR

PARALLEL JOISTS: T&G WOOD BLOCKING @ 36" O.C.

FLOOR JOISTS SEE PLAN

1/2" GYPSUM BOARD

SINGLE CONT. TIMBERSTRAND

AIR BARRIER RUN BETWEEN DOUBLE TOP PLATE AND UP UNDER FLOOR PLATE

DOUBLE TOP PLATE

1/2" GYPSUM BOARD

SINGLE CONTIN. TIMBERSTRAND

FIN. FLOORING ON 5/8" T&G PLYWOOD

FINISHED FIRST FLOOR

GAULK OR SEAL WITH GASKET

AIR BARRIER SECURED TO PLATE

2"x4" WOOD PLATE ANCHORED TO FOUNDATION WALLS WITH 1/2" DIA. BOLTS AT 7'-10" O.C. MIN. 4" INTO FOUNDATION WALL

R-20 BLANKET INSULATION DOWN WITHIN 2" MIN. AND 8" MAX. ABOVE FINISH SLAB WITH MOISTURE & VAPOUR BARRIER SEALED AT TOP & BOTTOM

POURED CONC. FDN. WALL. FOR WALL THICKNESS SEE ARCHITECTURAL DRAWINGS.

CONTINUOUS WATERSTOP (BITUMEN CAULKING)

3" CONCRETE SLAB 25 MFS ON 4" MIN. COMPACT GRAVEL

FINISHED SLAB



CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED BY: S. HANNA
JAN 26 2019
ATTACHED NOTES ARE PART
OF REVIEWED DRAWINGS
ALL WORK MUST COMPLY WITH CODE

WOOD SHEATHING

AIR/MOISTURE BARRIER

FIBRE MESH EMBEDDED IN PREP. COAT

INSULATION BOARD (R-5) W/ GEOMETRICALLY DEFINED DRAINAGE CAVITY HAVING A MIN. CAVITY DEPTH OF 1/4"

STARTER MESH (BACKRAPPED)

CAULK WITH BEAD VENT



FLASHING

CONCRETE SILL

MASONRY CLADDING AS PER ELEVATION

A. TERMINATION AT MASONRY CLADDING WITH SEALANT

1 1/2" = 1'0"

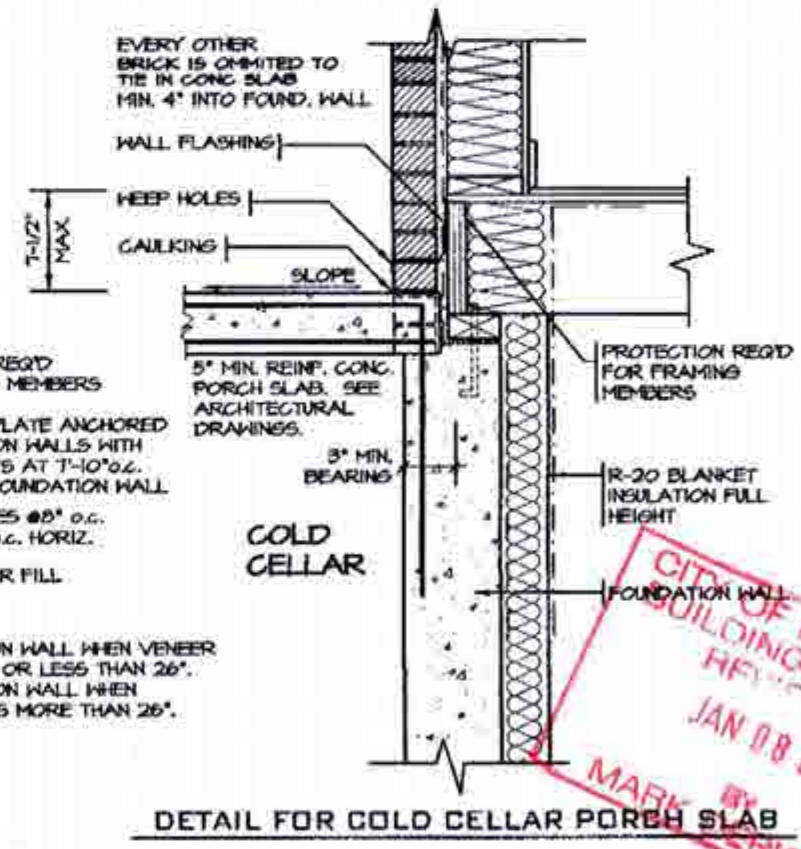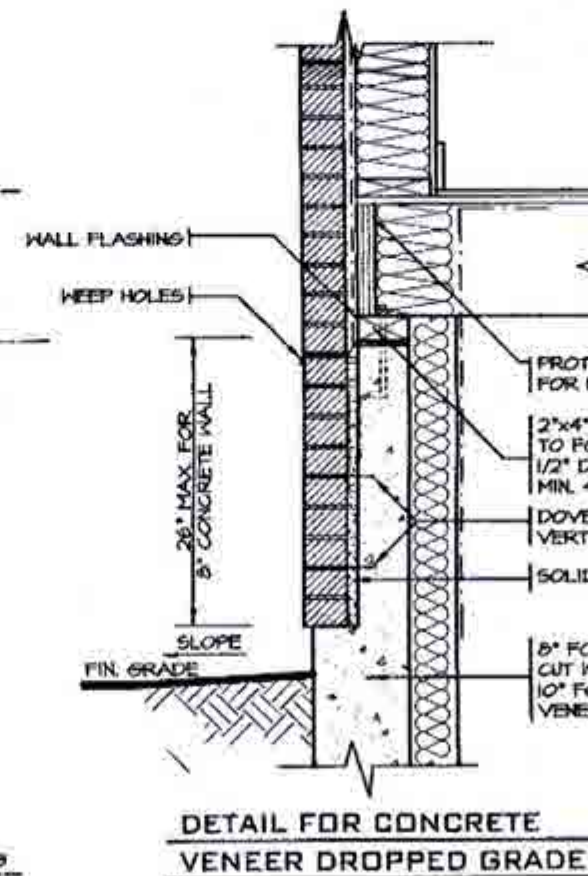

2012 CODE
COMPLIANCE PACKAGE "A1"

5.	
4.	
3.	
2.	
1.	ISSUED FOR PERMIT JUL 30, 2018
REVISIONS	

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION

Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR 28770
NAME SIGNATURE BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S8
P (416) 736-4096
F (905) 680-0746

REGION
DESIGN
INC.

SHEET TITLE
2"x6" STUCCO WALL
2 STOREY SECTION

SCALE
AS NOTED



DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE NO.
6-2

Greenpark.

PROJECT NAME
MINNISALE HOMES CORP.

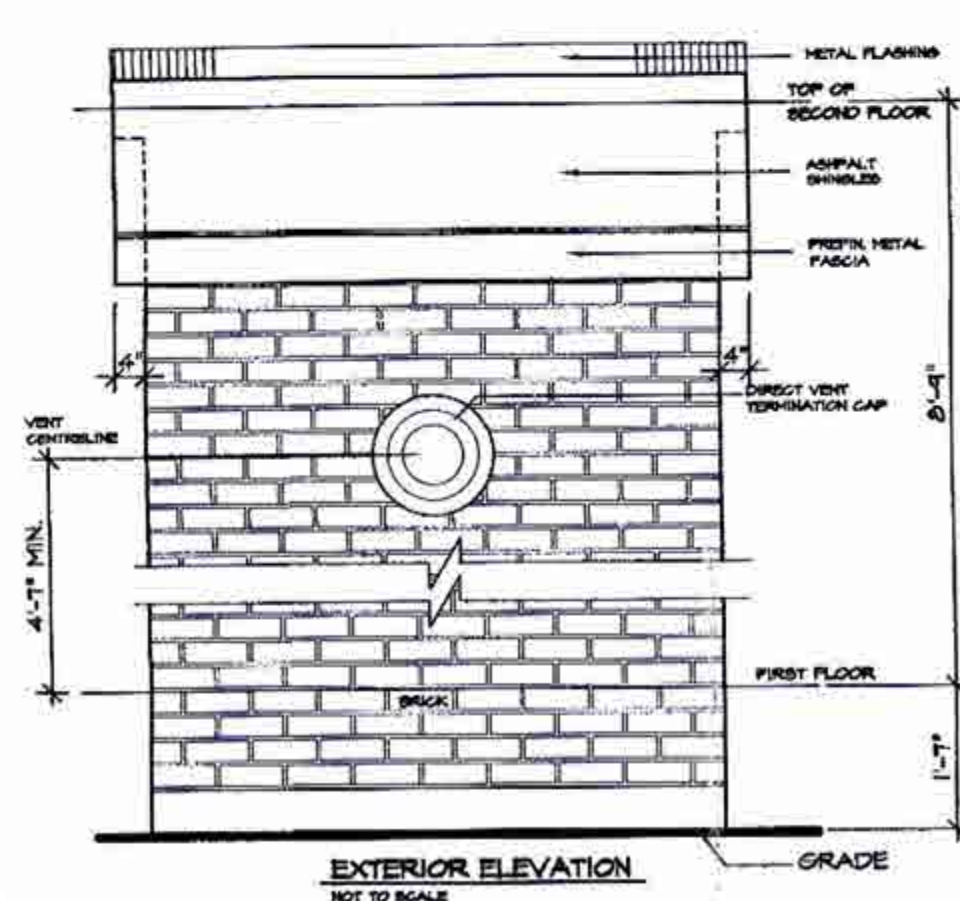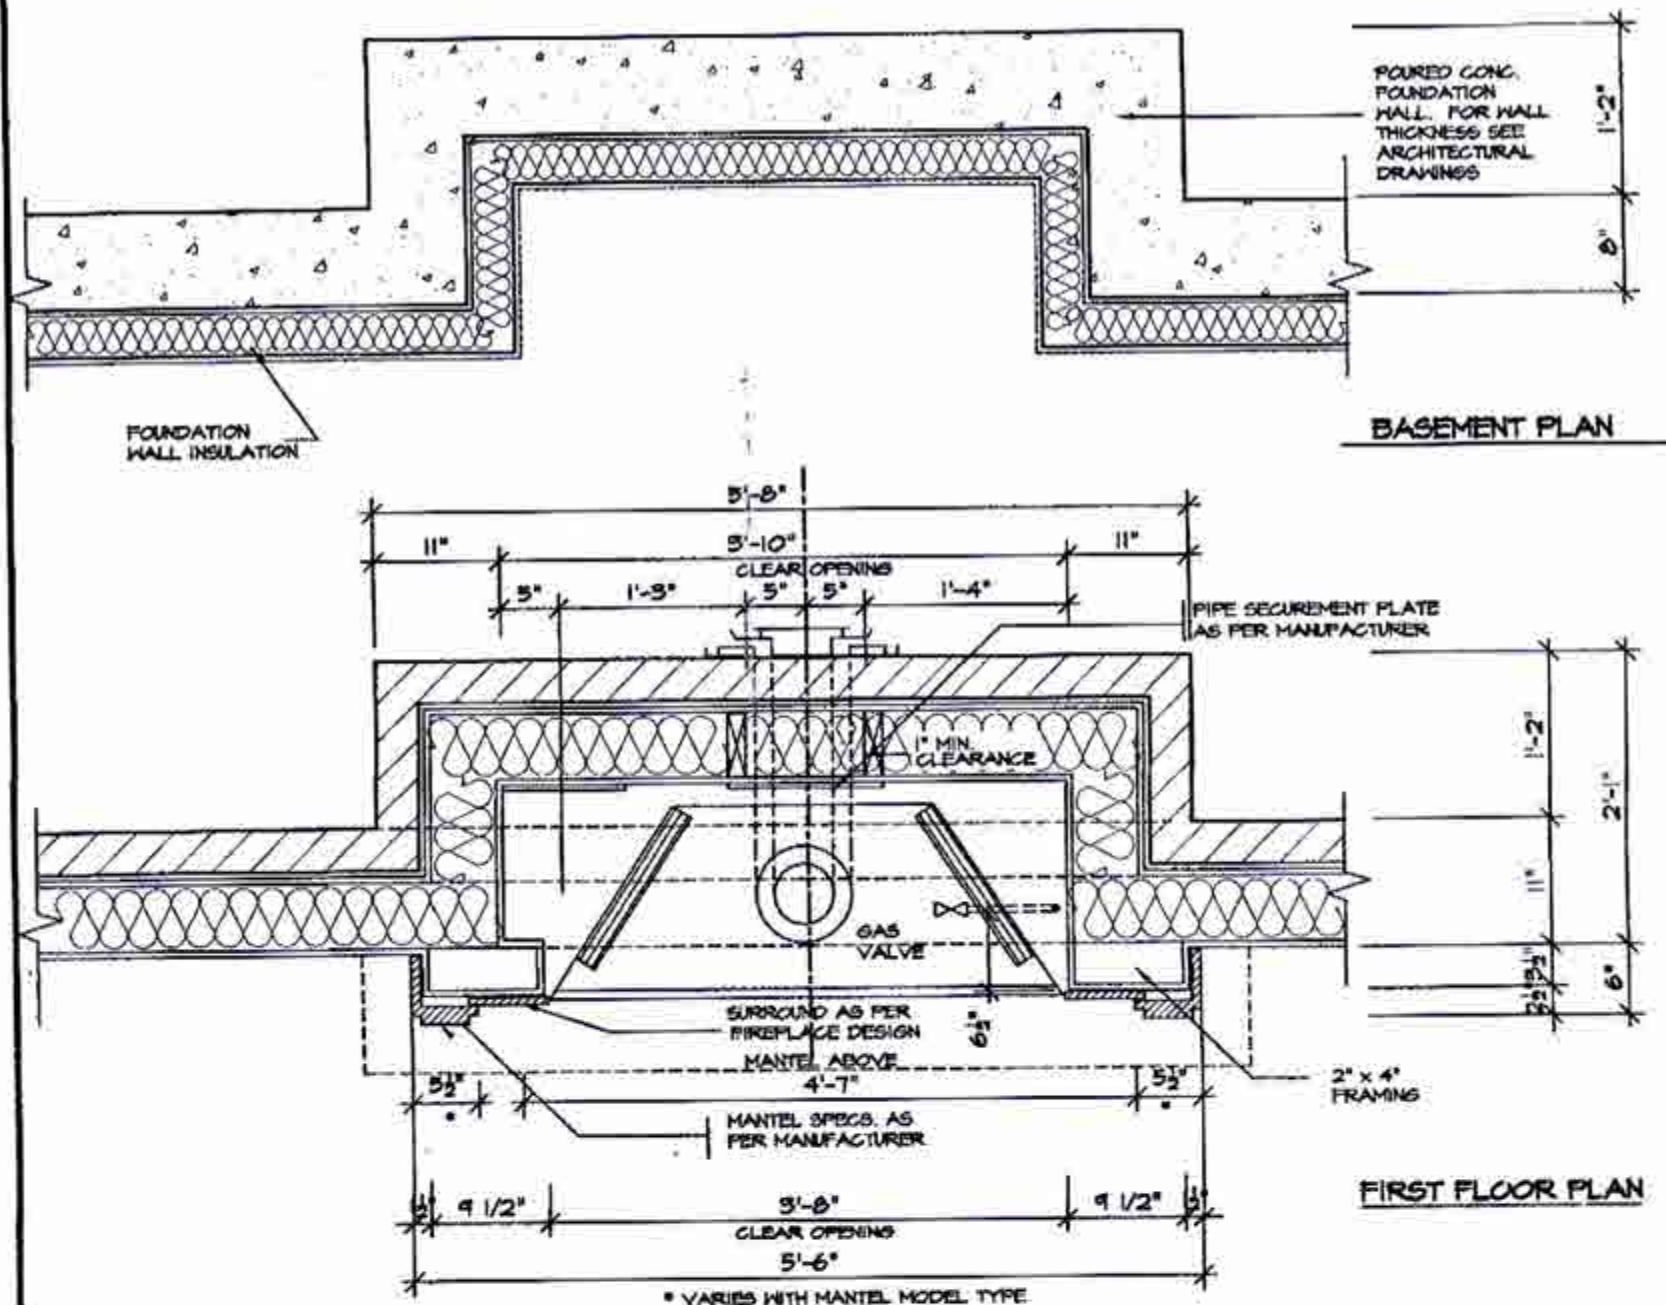


FRONT/SIDE ELEVATION


NOT TO SCALE

GENERAL INSTALLATION NOTES

- 1.0 UNIT INSTALLATION TO STRICTLY CONFORM TO MANUFACTURERS INSTALLATION MANUAL AND ALL APPLICABLE CODES OF LOCAL AUTHORITIES HAVING JURISDICTION INCLUDING CAN/CSA-514.1 & 2.
- 2.0 INSTALL WITH THE FOLLOWING MINIMUM CLEARANCES TO COMBUSTIBLES:
 - FROM TOP OF UNIT 0"
 - FROM BACK OF UNIT 1/2"
 - FROM SIDES OF UNIT 1/2"
 - FROM TOP OF HORIZ. VENT 5"
 - FROM SIDES TO VENT 1"
- 3.0 THE DIRECT VENT UNIT ILLUSTRATED IS THE GC150 MODEL AS MANUFACTURED BY HEATILATOR.
- 4.0 THE MANTEL ILLUSTRATED IS THE S-2 68 AS SUPPLIED BY GREATER TORONTO FIREPLACE.

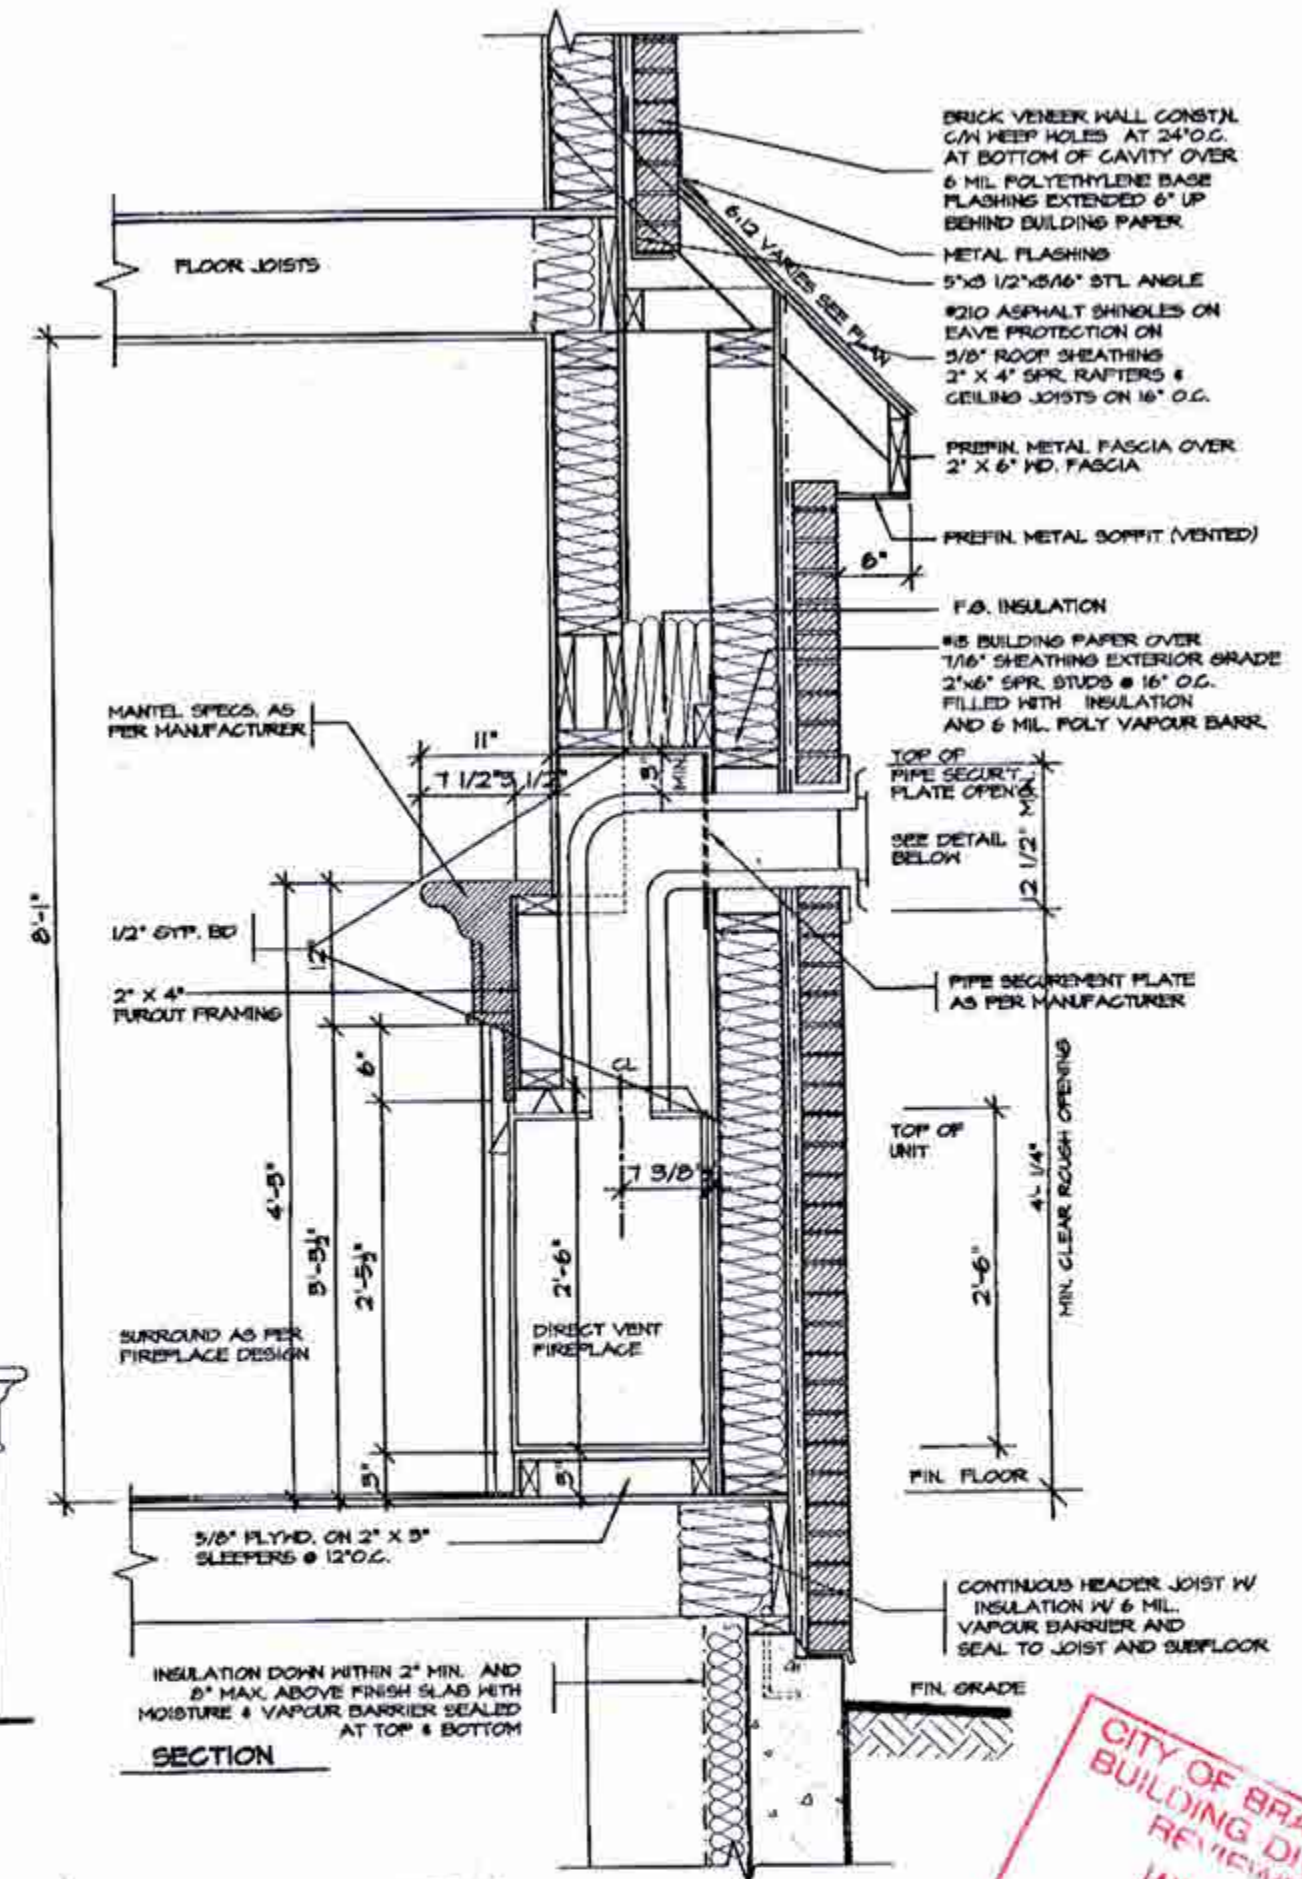

SECTION

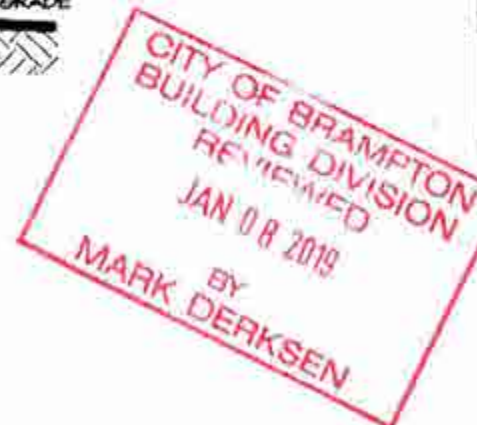

2012 CODE COMPLIANCE PACKAGE "A1"

REVISIONS	DATE
1. ISSUED FOR PERMIT	JULY 30, 2018

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION

Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME

28770
BCIN

SIGNATURE

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746

REGION DESIGN INC.

SHEET TITLE
VENT FIREPLACE DIRECT

SCALE
3/4"=1'-0"



DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.
7

Greenpark.

PROJECT NAME
MINNISALE HOMES CORP.

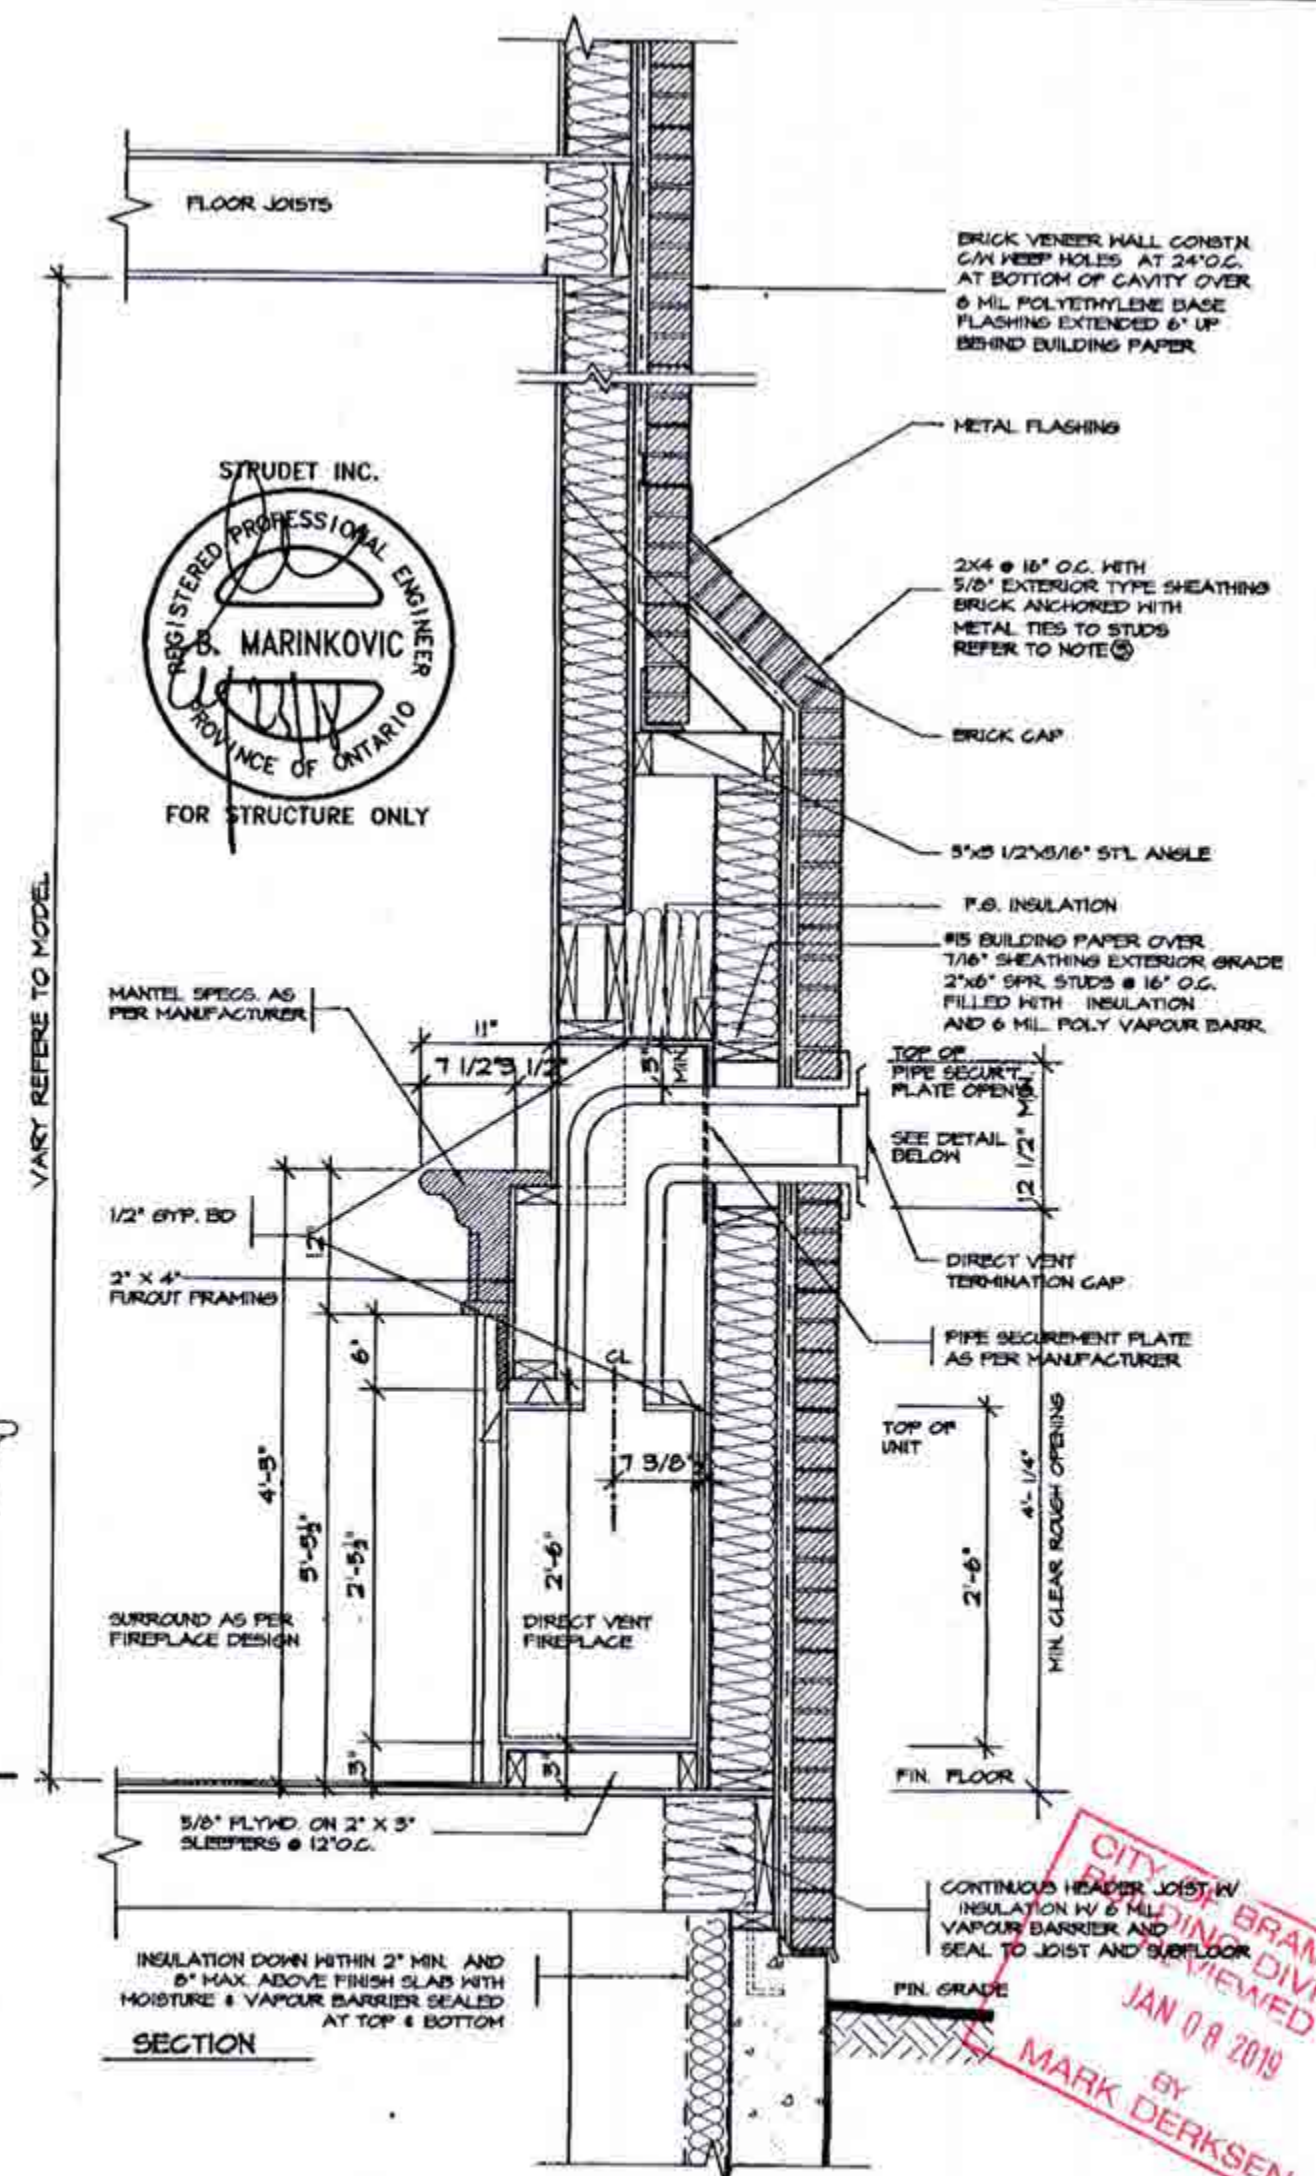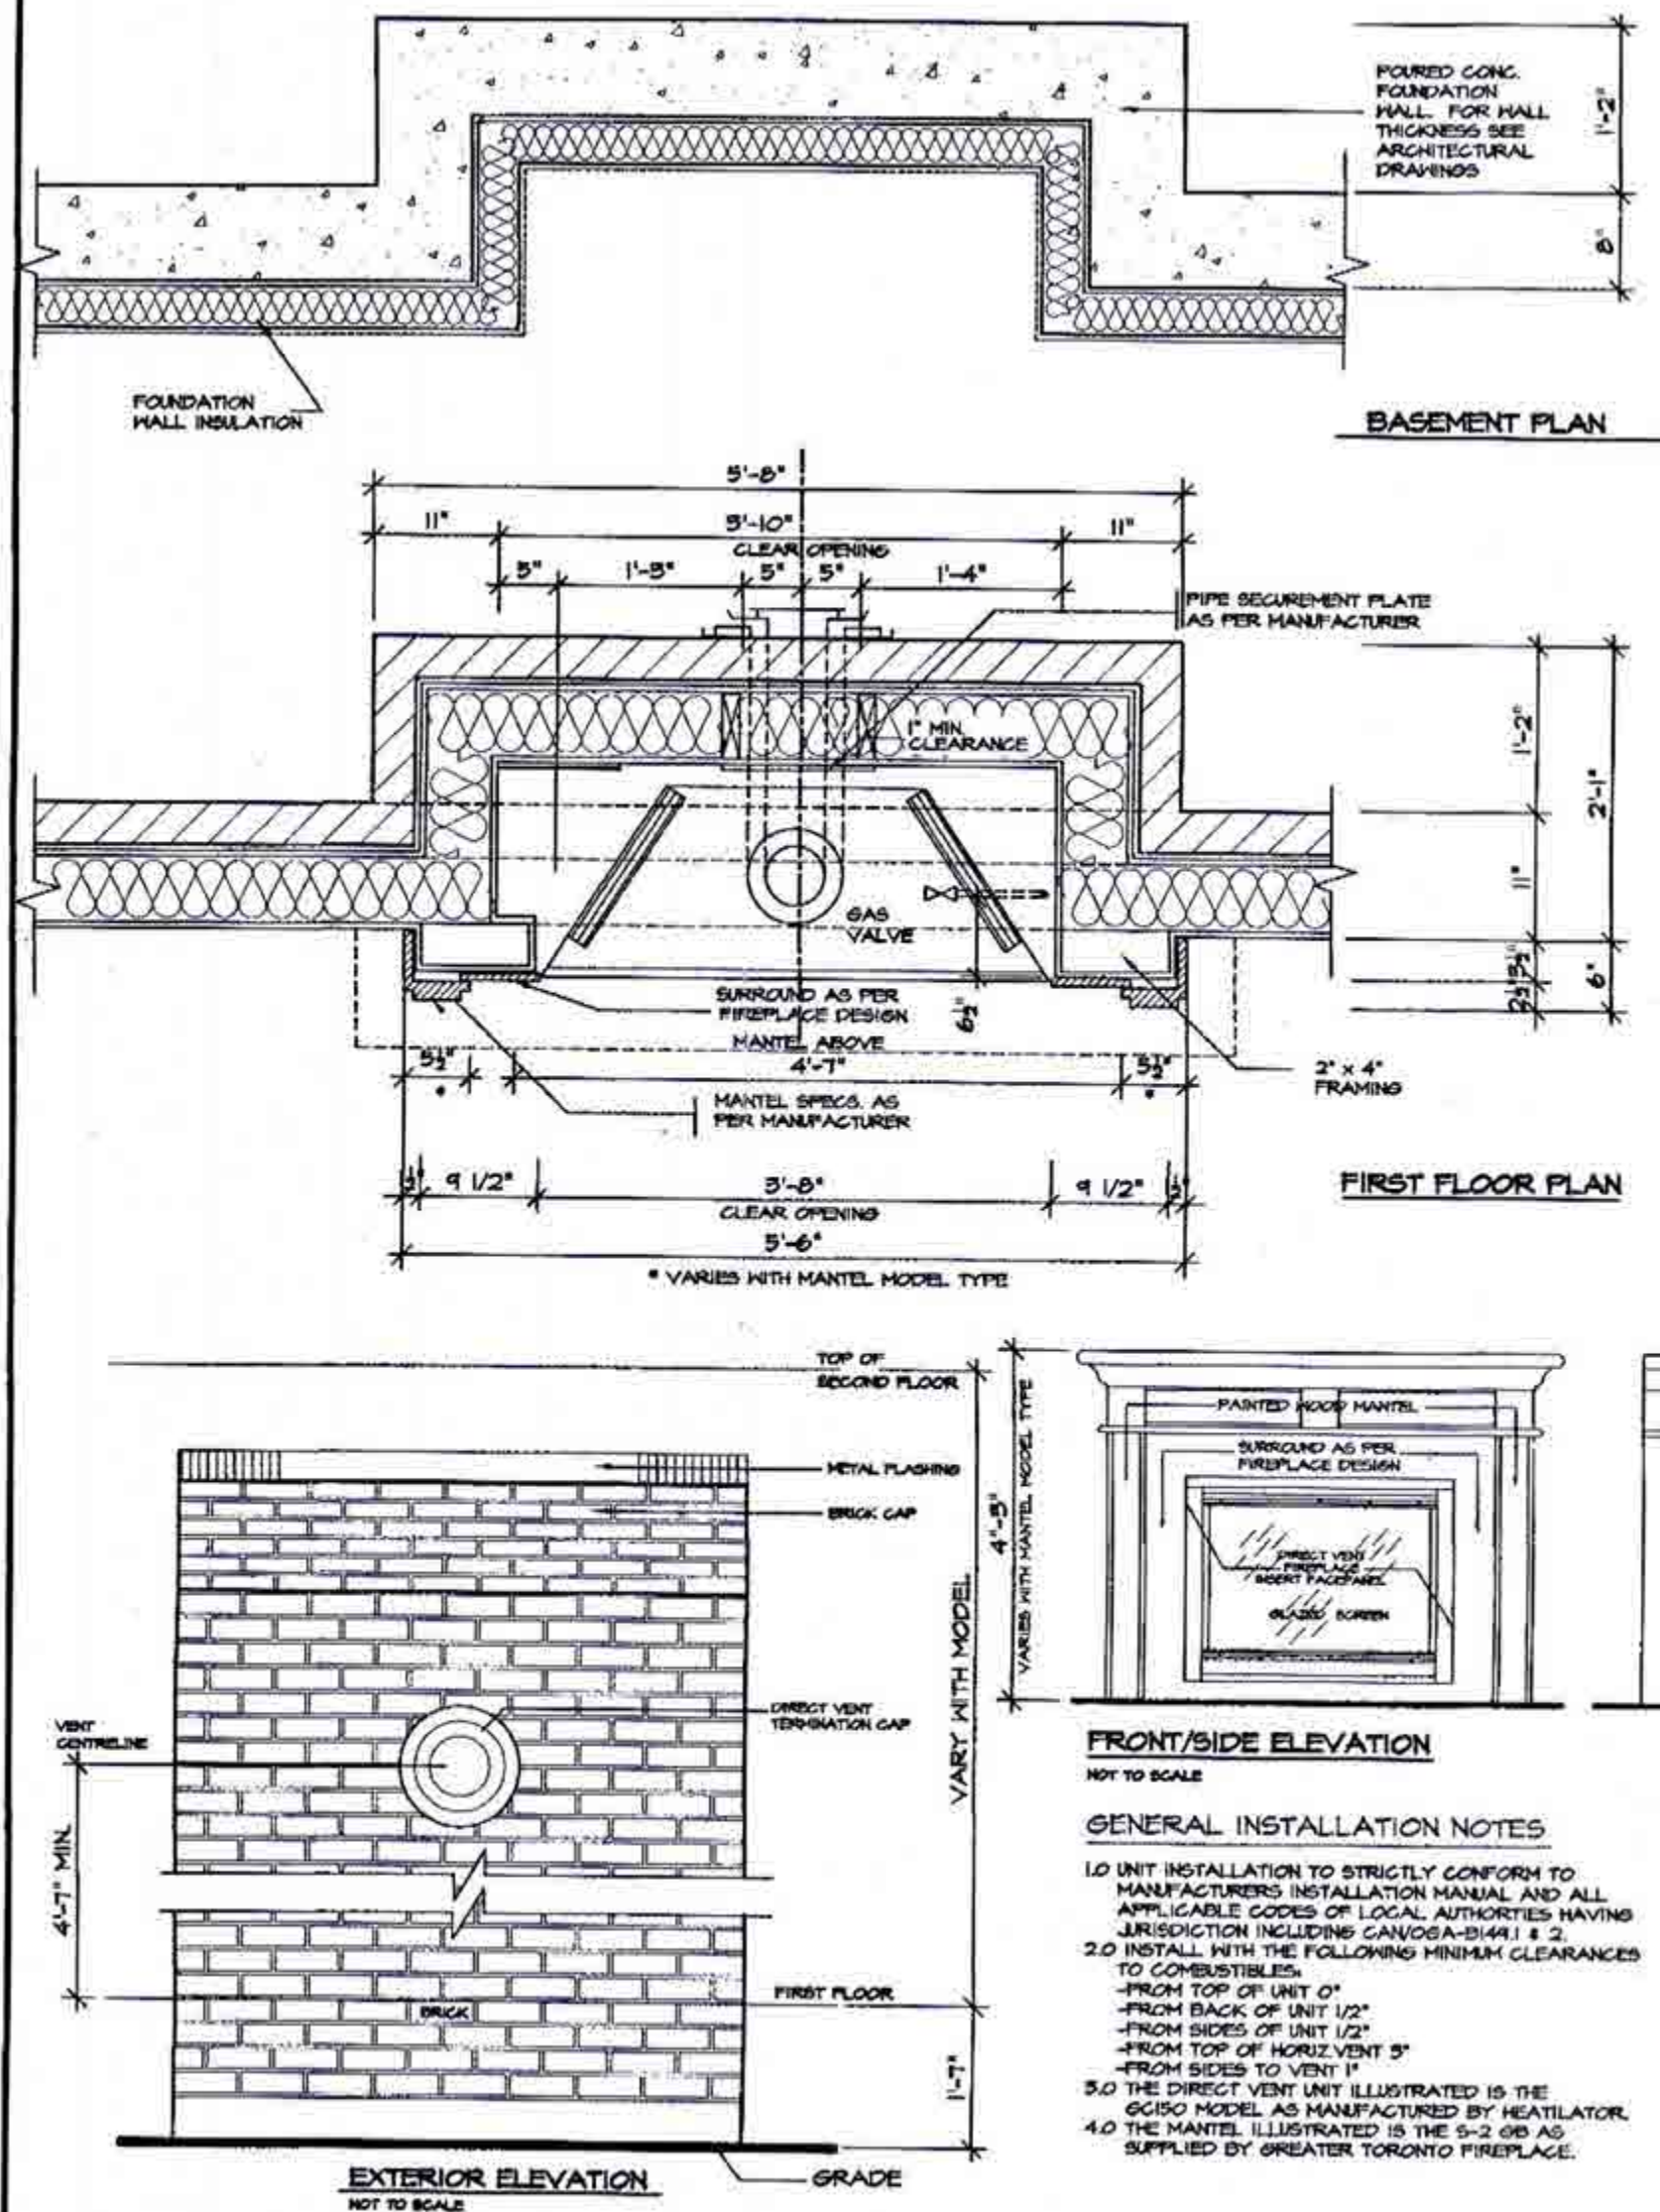

2012 CODE
COMPLIANCE PACKAGE "A1"

Greenpark

PROJECT NAME
MINNISALE HOMES CORP.

SHEET TITLE
VENT FIREPLACE
DIRECT

SCALE
3/4"=1'-0"

DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.

7-2

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4098
F (905) 860-0746

**REGION
DESIGN
INC.**


The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code


VIKAS GAJAR
NAME
SIGNATURE
28770
BCIN

REVISIONS

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JUL 30, 2018

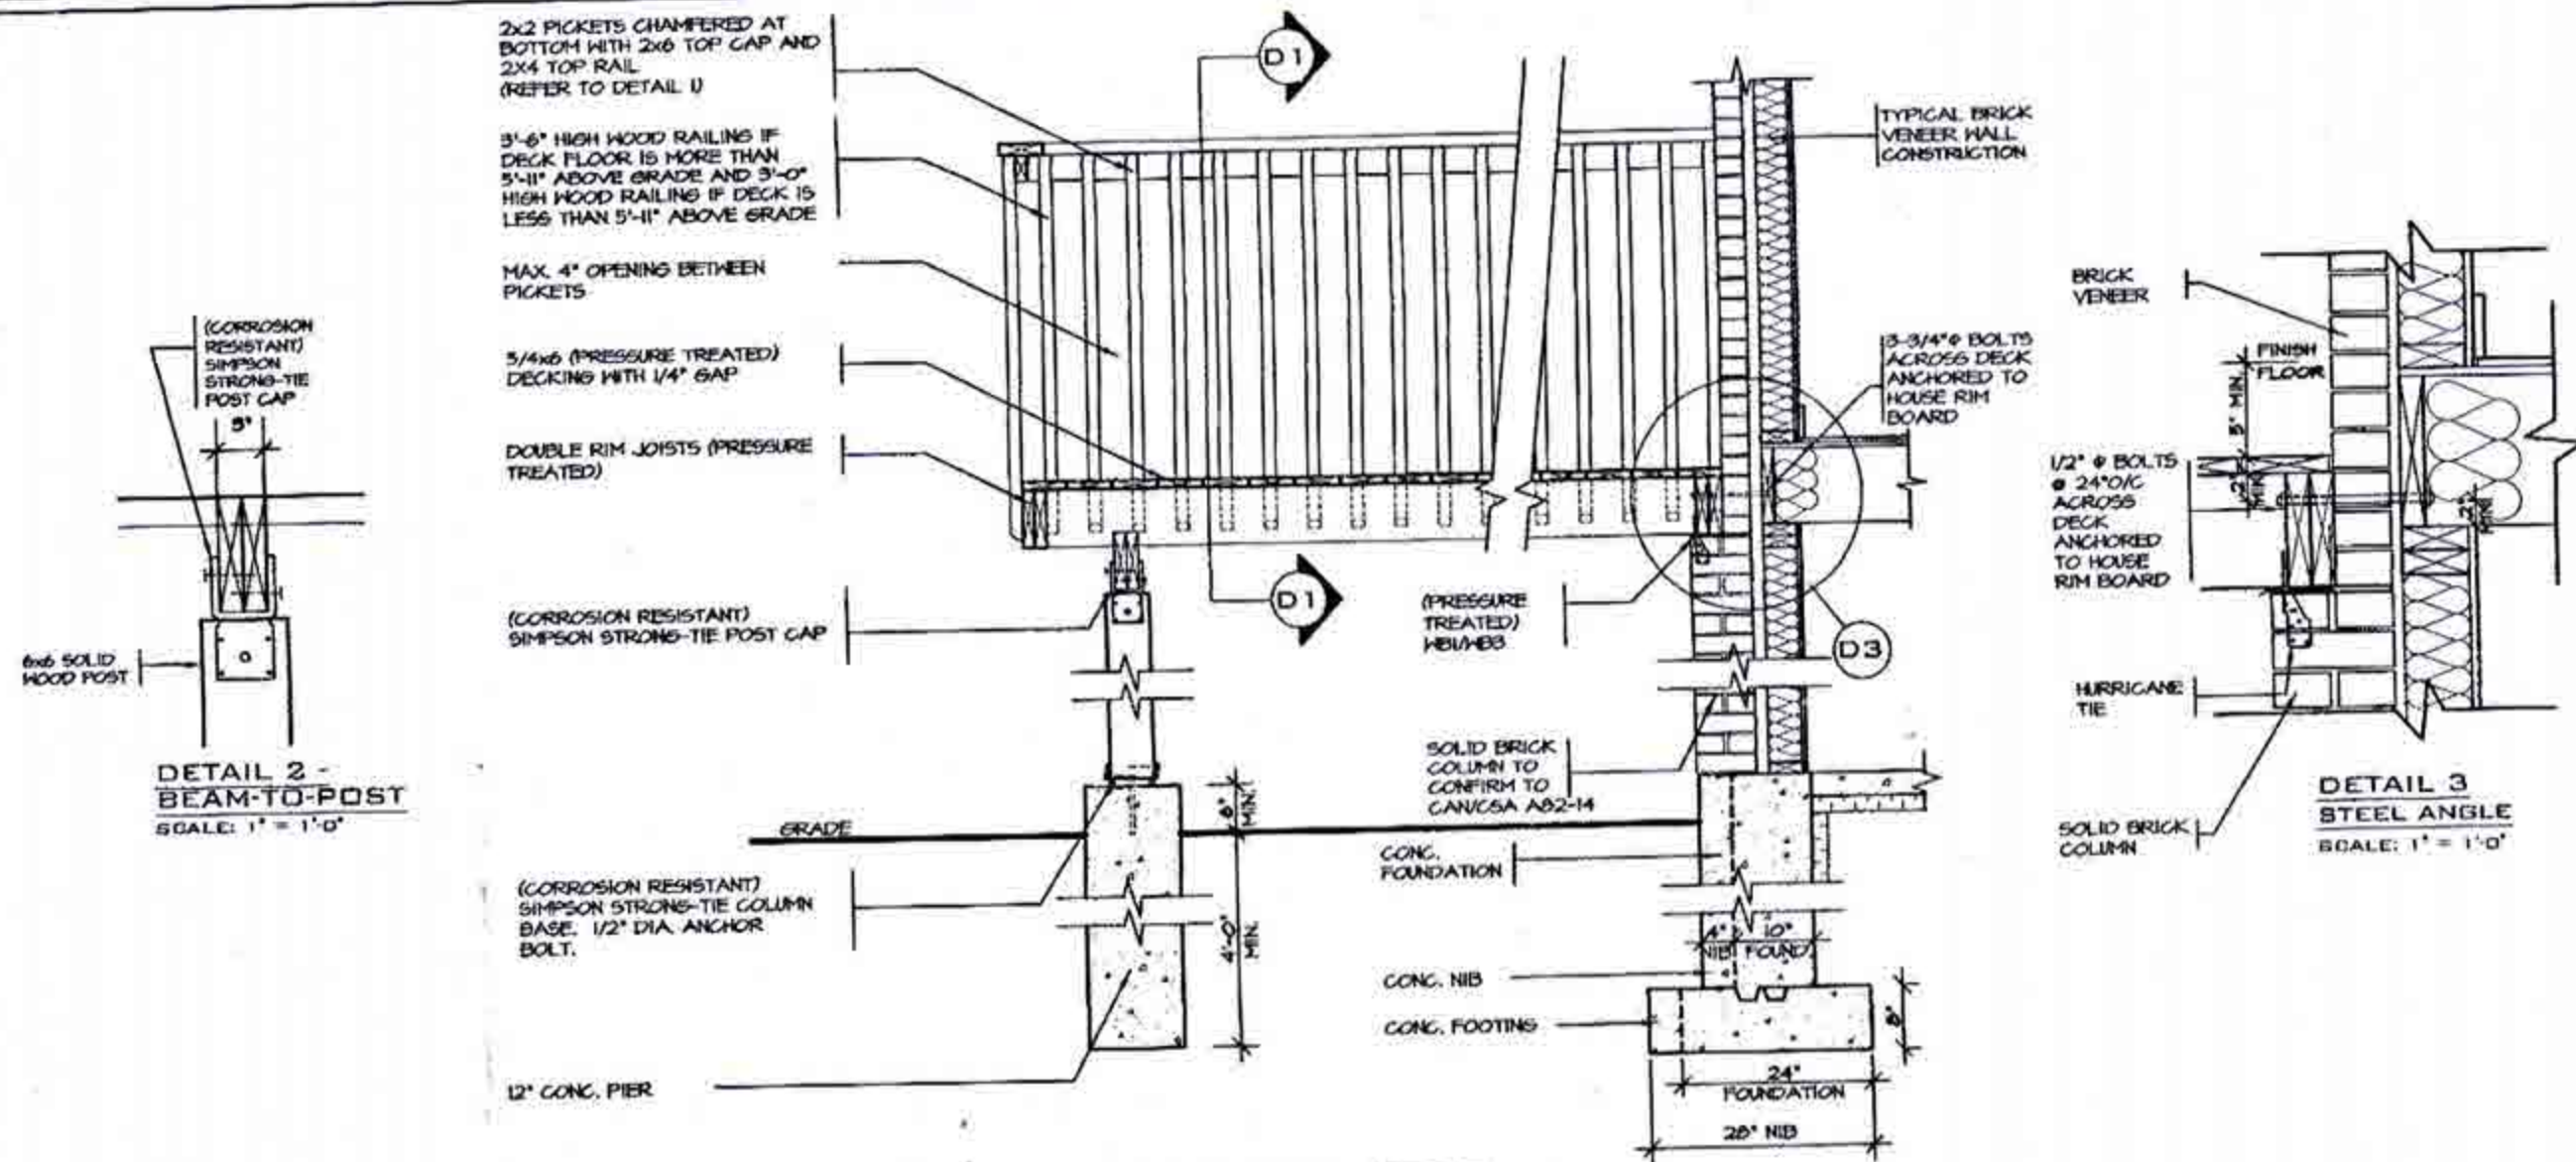

DECK SECTION WITH BRICK VENEER
SCALE: 1/2" = 1'-0"

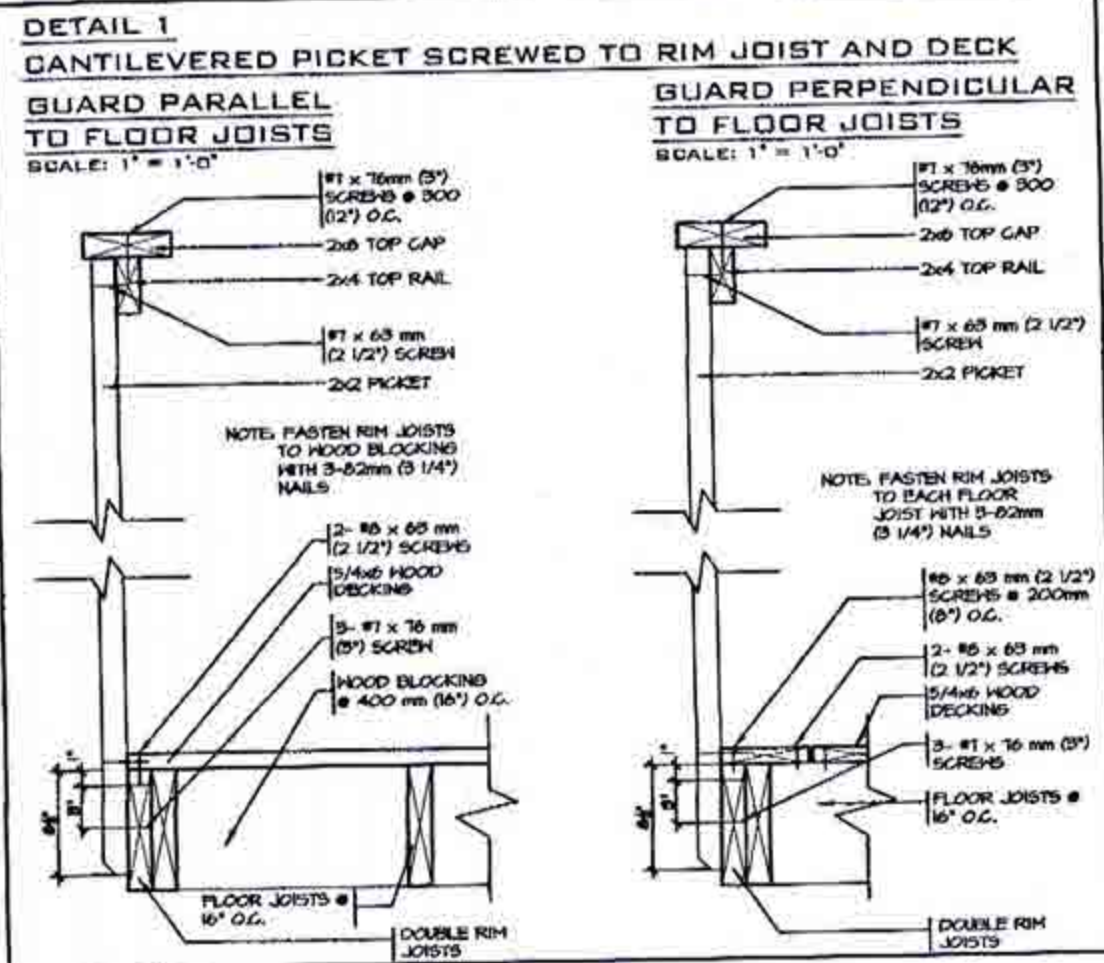

GENERAL NOTES

1. BRICK TO BE COMPRESSIVE STRENGTH OF 15MPa (2200 p.s.i.) MIN. UNITS TO BE LAID WITH FULL HEAD AND BED JOINTS.
2. MORTAR TO BE TYPE S WITH JOINT THICKNESS OF 10mm (3/8") MIN. AND 20mm (3/4") MAX.
3. ALL NAILS AND SCREWS TO BE GALVANIZED.
4. WOOD FOR CANTILEVERED PICKETS SHALL BE DOUGLAS FIR-LARCH, SPRUCE-PINE-FIR, OR HEM-FIR SPECIES.
5. THE DECK HAS BEEN DESIGNED TO SAFELY SUPPORT A SUPERIMPOSED LOAD OF 1.9kPa (40psf).
6. CONCRETE SHALL HAVE COMPRESSIVE STRENGTH OF 20MPa AT 28 DAYS AND 5-8% AIR ENTRAINMENT.
7. FOOTINGS TO BE PLACED ON UNDISTURBED SOIL WITH MIN. BEARING PRESSURE OF 150kPa (3150psf).



FOR STRUCTURE ONLY
2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JULY 30, 2018

REVISIONS

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME

SIGNATURE

28770
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S5
P (416) 736-4096
F (905) 680-0746

**REGION
DESIGN
INC.**

SHEET TITLE
**WALK-OUT
DECK DETAILS**
SCALE
AS SHOWN
DATE
JULY 2018


CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.

8-2

Greenpark.

PROJECT NAME
MINNISALE HOMES CORP.

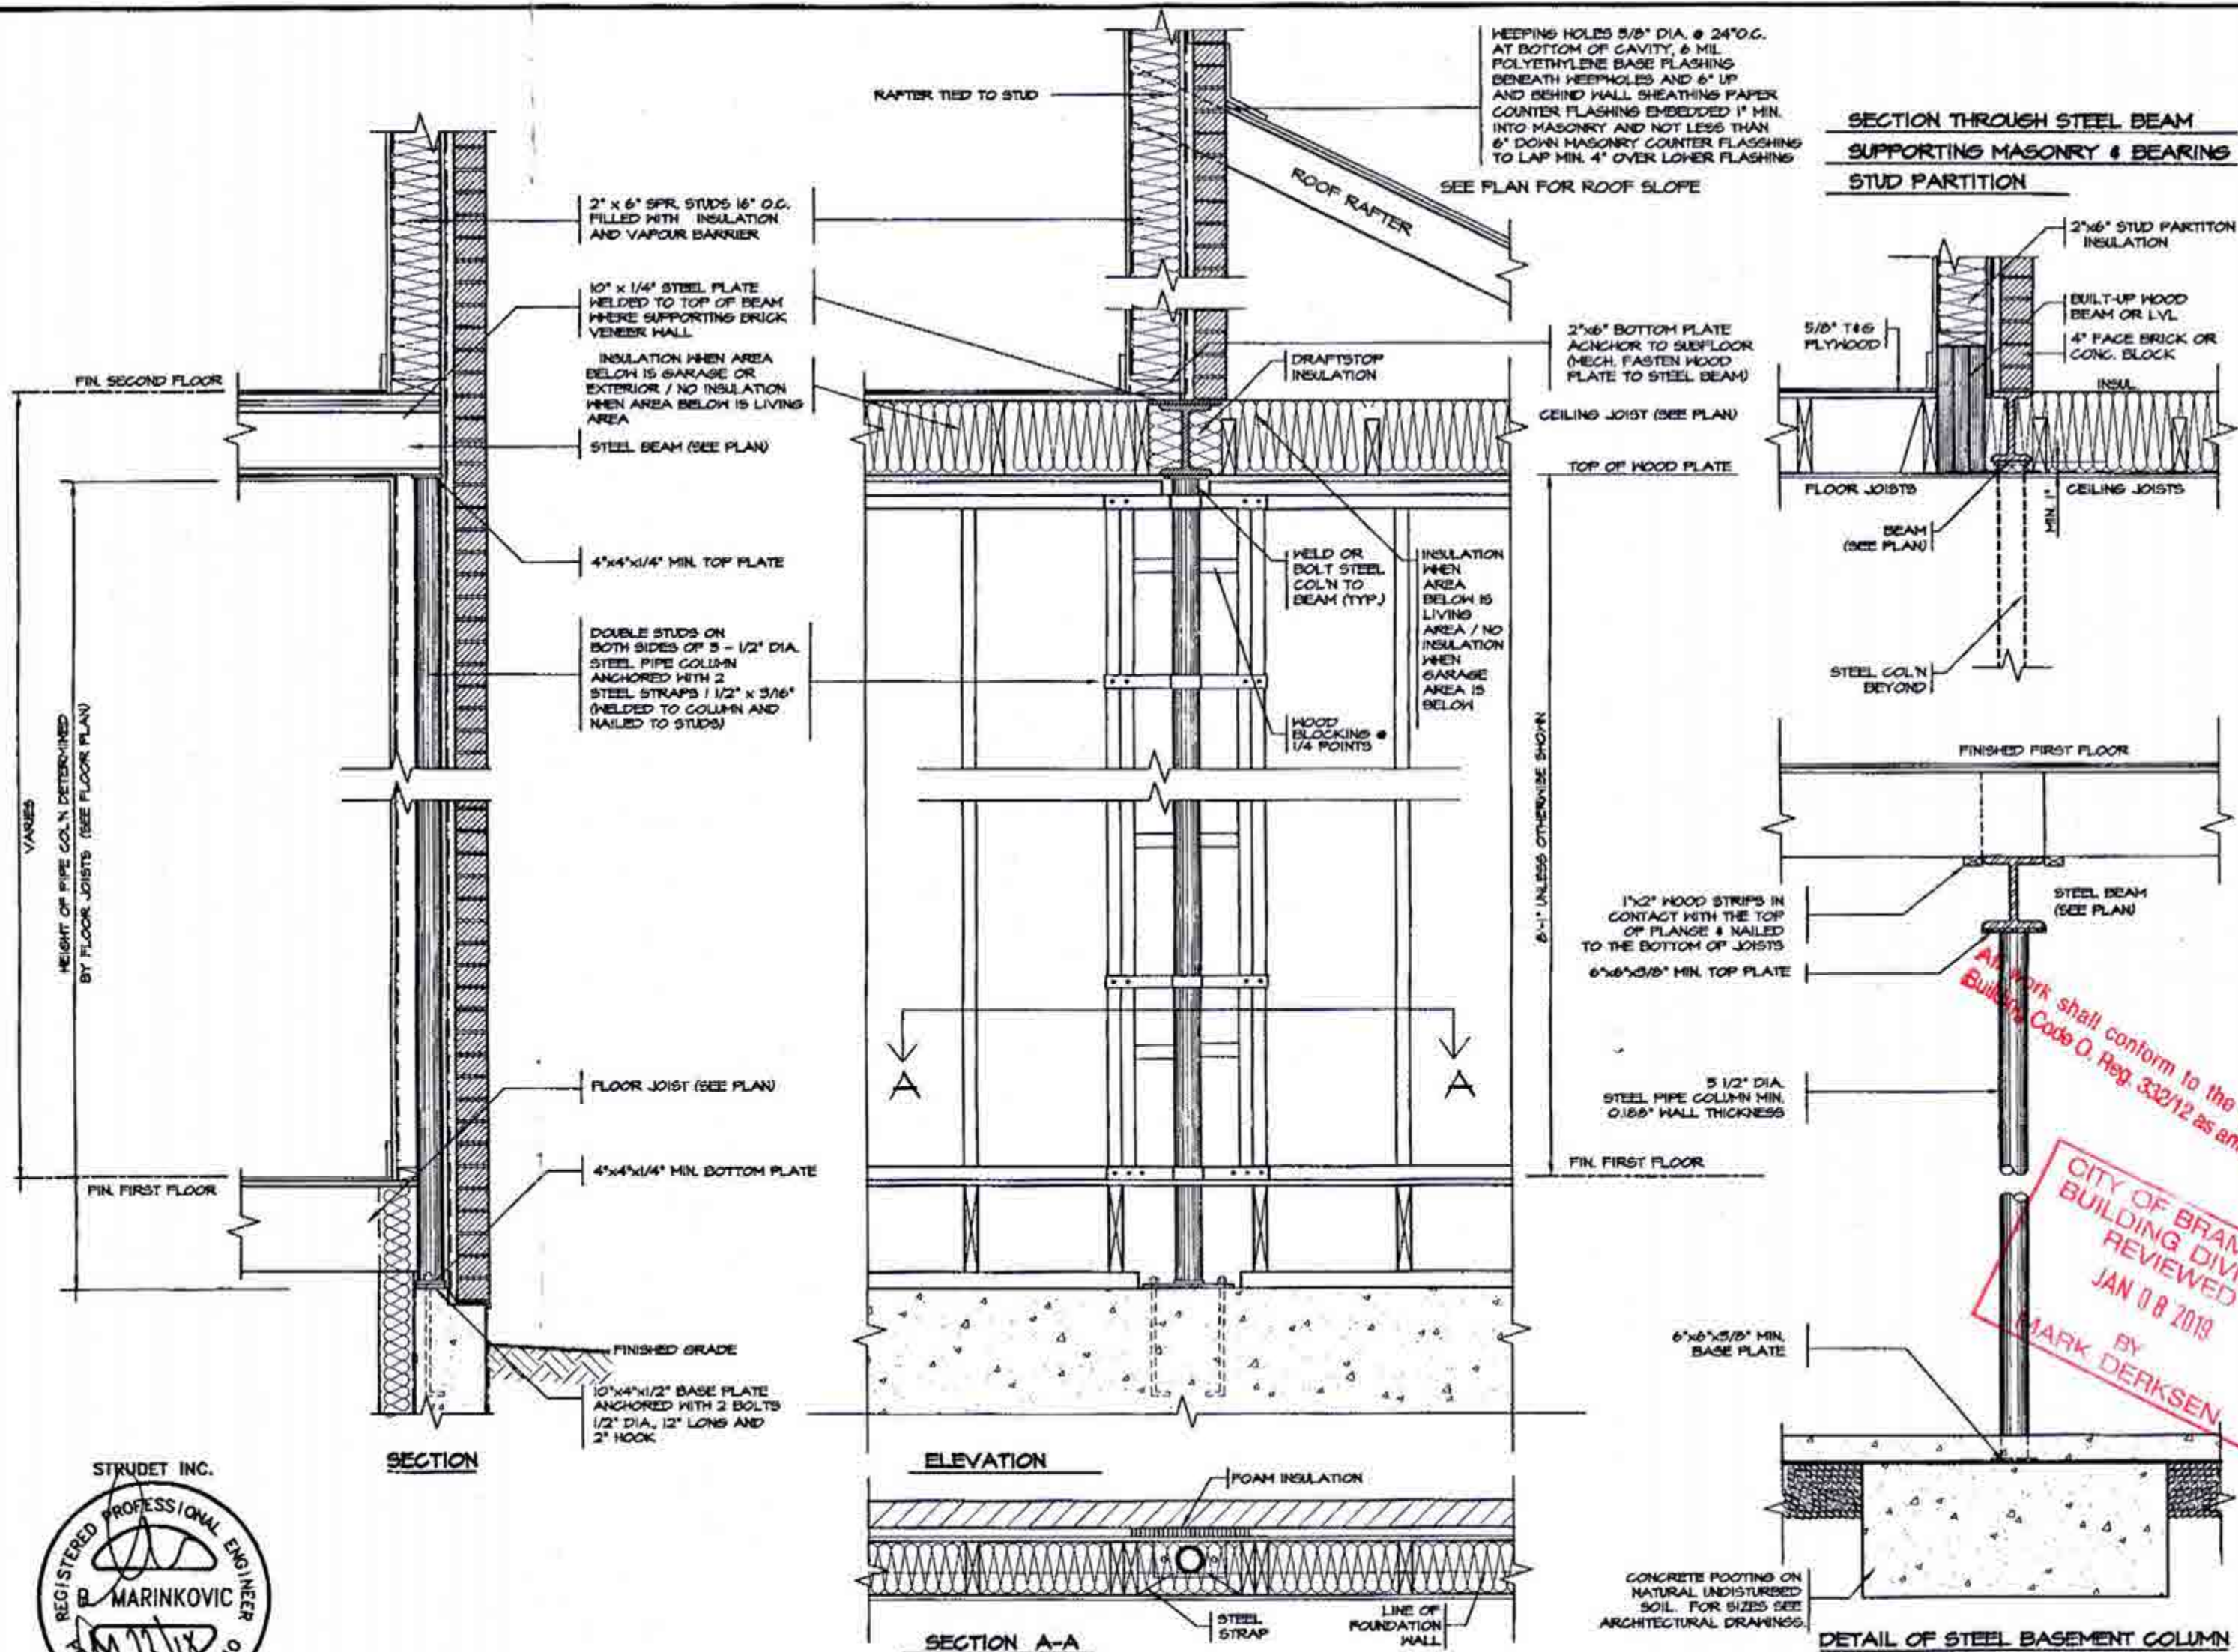

5.	
4.	
3.	
2.	
1.	ISSUED FOR PERMIT JUL 30, 2018
REVISIONS	

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJJAR
NAME SIGNATURE

28770
BCIN

REGION DESIGN INC.
8700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 756-4096
F (905) 660-0746

**REGION
DESIGN
INC.**

SHEET TITLE
**COLUMN DETAILS
STEEL**

SCALE
3/4"=1'-0"

DATE
JULY 2018


CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.
9

Greenpark.


PROJECT NAME
MINNISALE HOMES CORP.

**2012 CODE
COMPLIANCE PACKAGE "A1"**

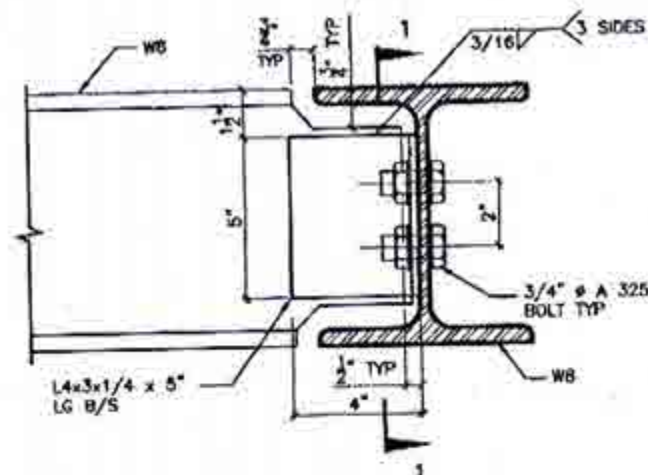


DETAIL 1.

W8
TO
W8
CONNECTION

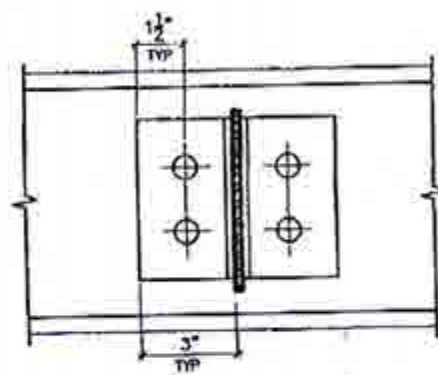


SECTION 1-1

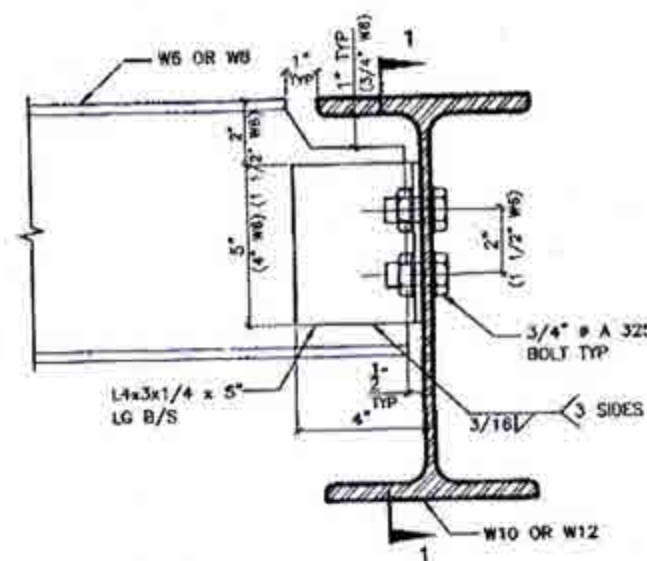


DETAIL 2.

W6(W8)
TO
W10(W12)
CONNECTION

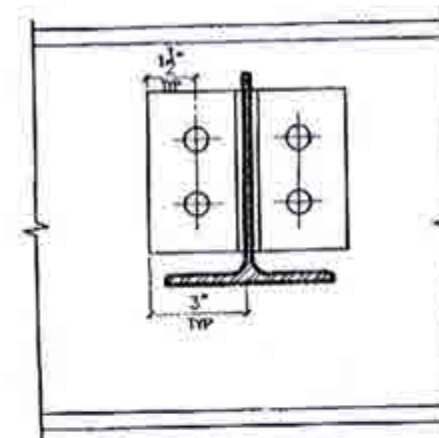


SECTION 1-1

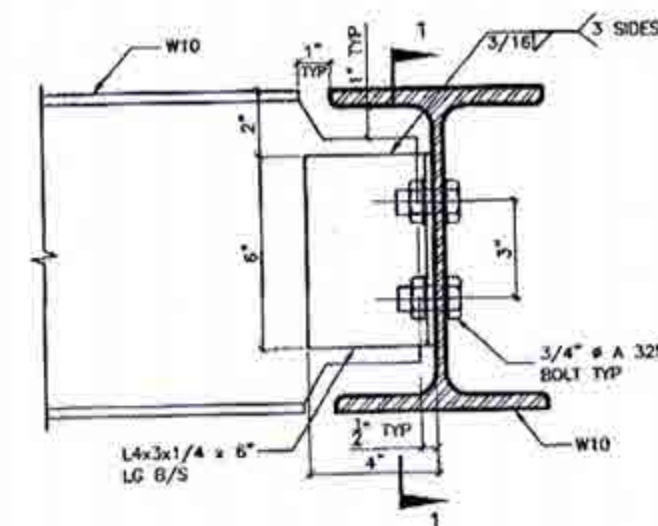


DETAIL 3.

W10
TO
W10
CONNECTION

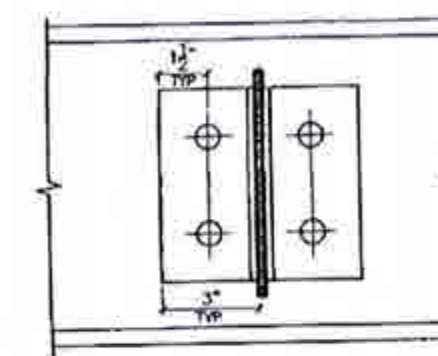


SECTION 1-1

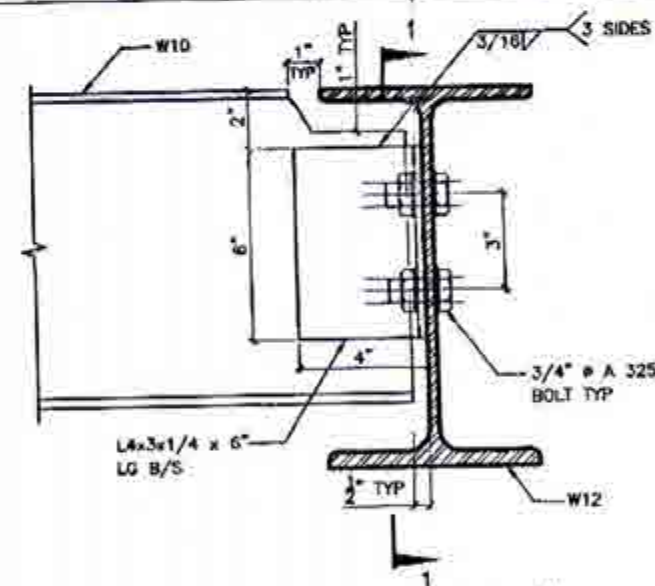


DETAIL 4.

W10
TO
W12
CONNECTION

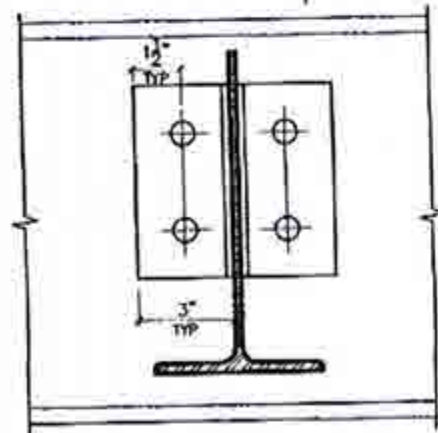


SECTION 1-1

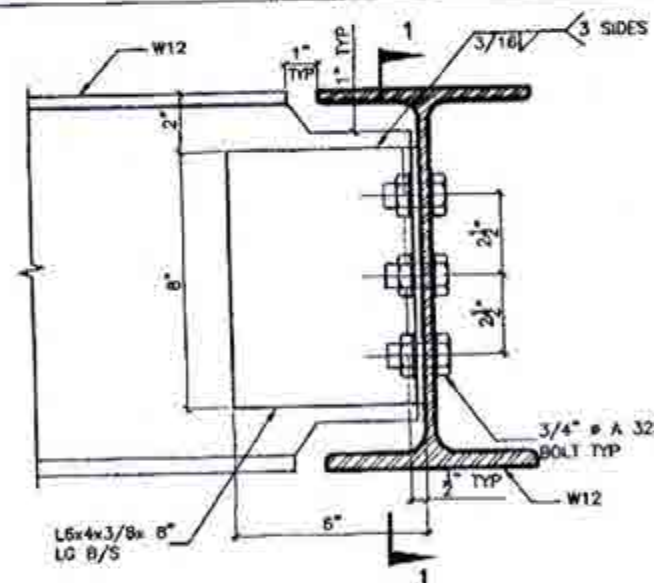

DETAIL 5.

W12
TO
W12
CONNECTION

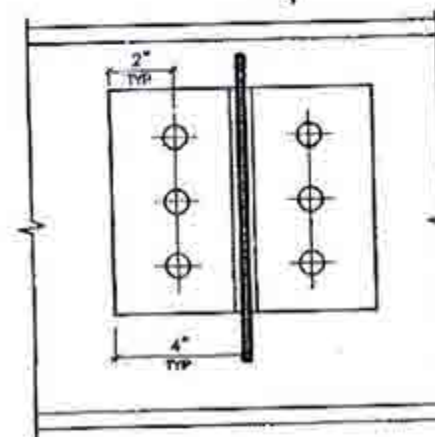

SECTION 1-1




DETAIL 6.

ANGLE
TO
BEAM
CONNECTION



PLAN VIEW

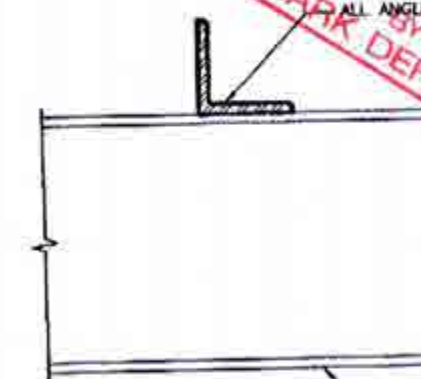

SECTION 1-1 ALL BEAM SIZES

2012 CODE
COMPLIANCE PACKAGE "A1"

5.		
4.		
3.		
2.		
1.	ISSUED FOR PERMIT	JULY 30, 2018
REVISIONS		

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.

QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code

VIKAS GAJAR
NAME
SIGNATURE

28770
BCIN

REGION DESIGN INC.
8700 GUYER ST.
CONCORD, ONTARIO
L4K 4S6
P (416) 736-4096
F (905) 660-0746

**REGION
DESIGN
INC.**

SHEET TITLE
**BEAM DETAILS
STEEL**

SCALE
N.T.S.

DATE
JULY 2018


CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.

PAGE No.


10

Greenpark.


PROJECT NAME
MINNISALE HOMES CORP.

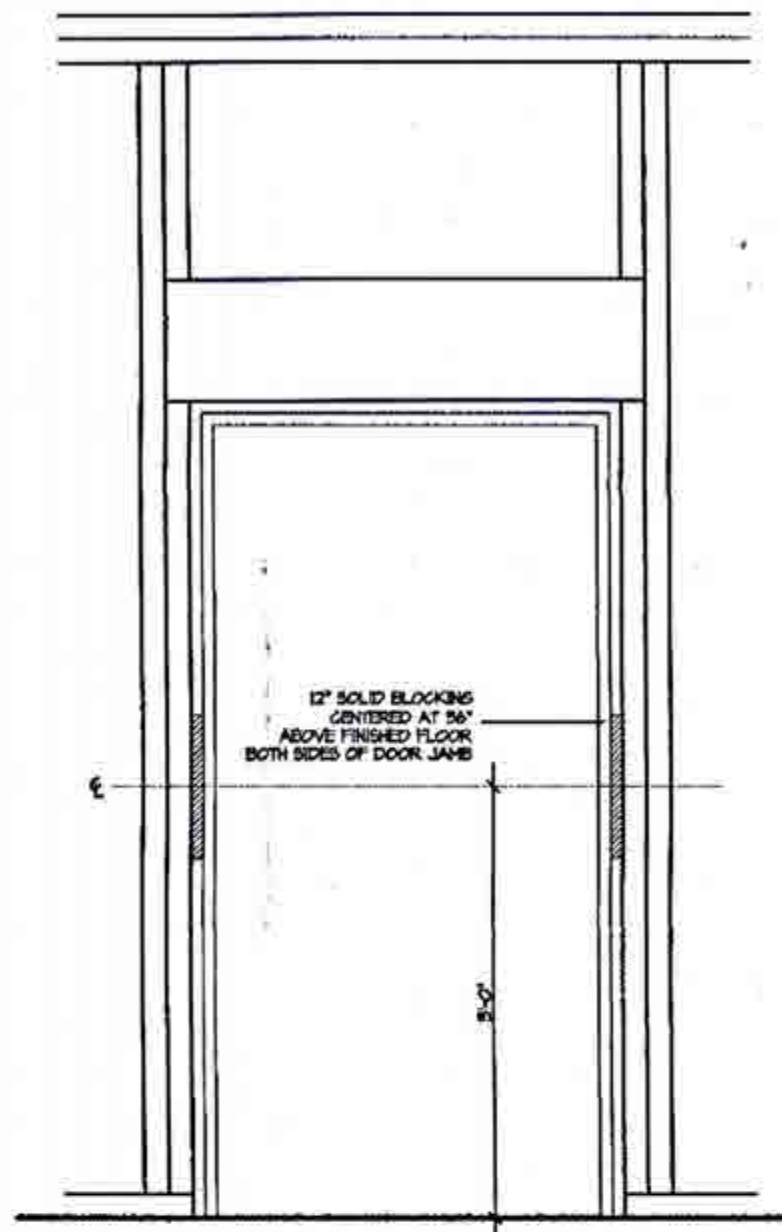


RESISTANCE TO FORCED ENTRY (OBC 4.5.2)

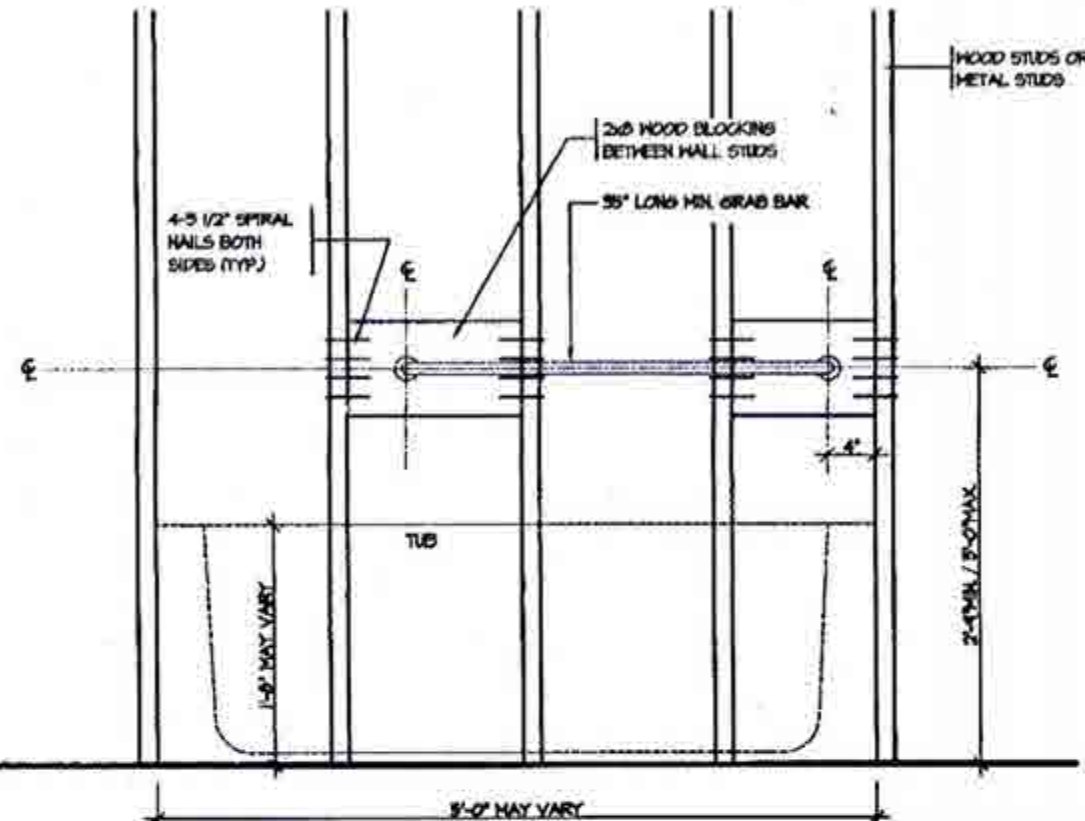

BATH TUB FRONT ELEVATION

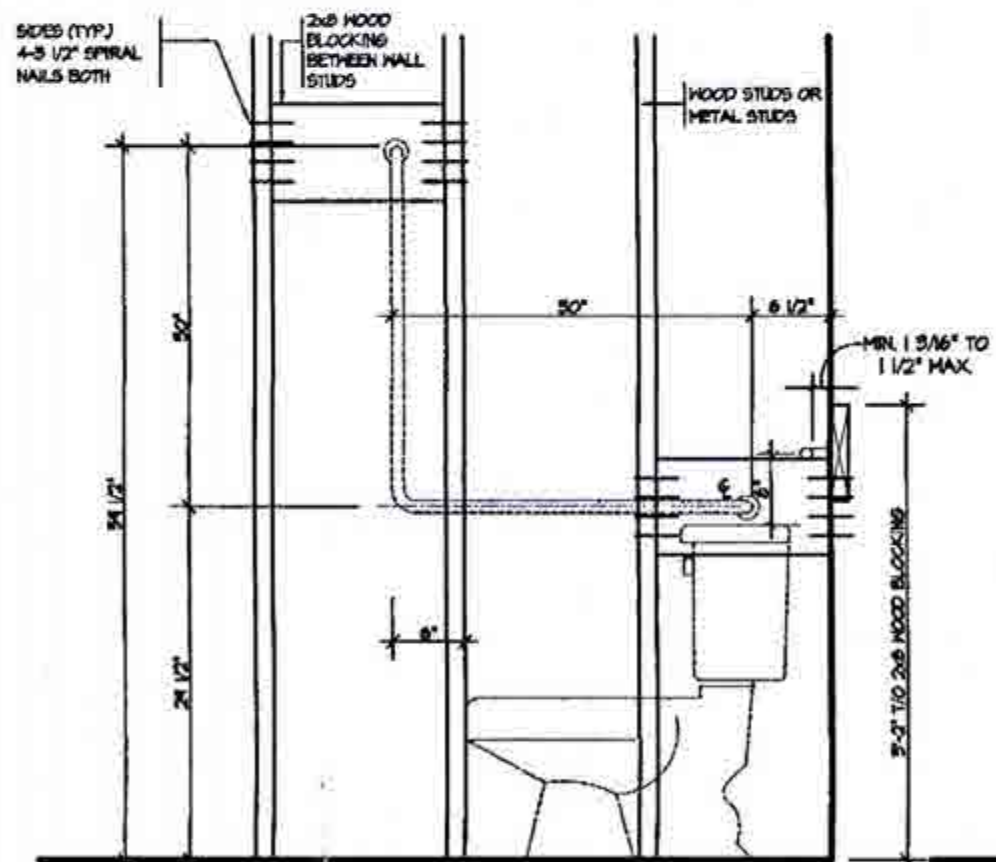

TOILET SIDE ELEVATION

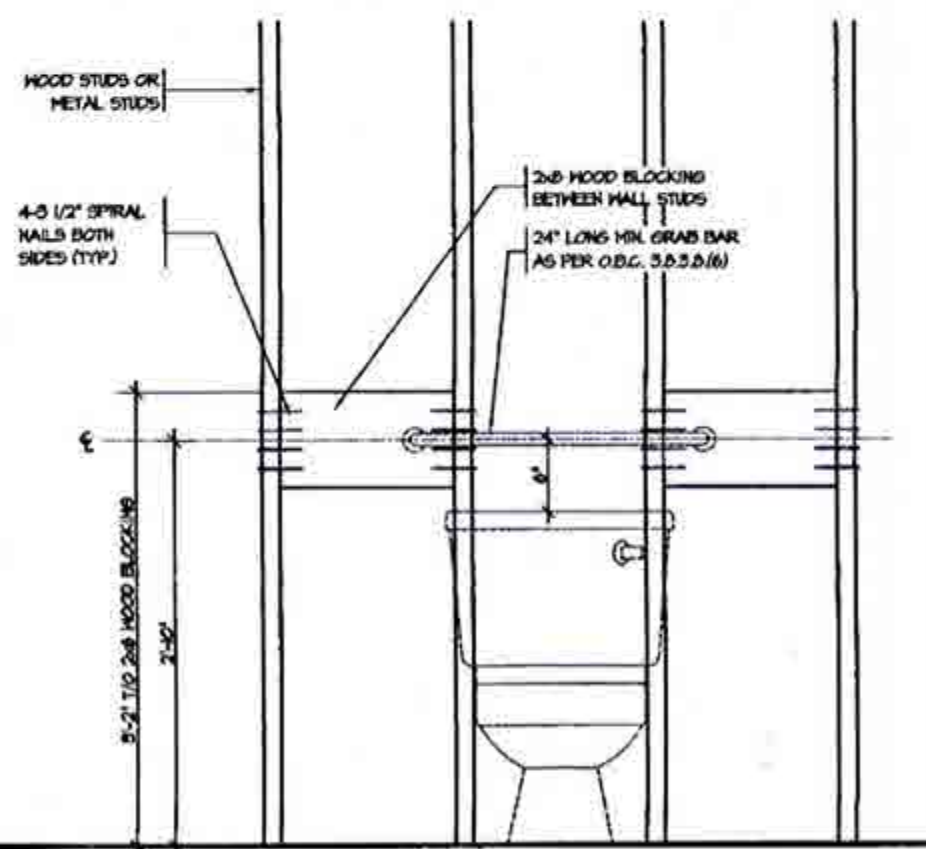

TOILET FRONT ELEVATION

STRUCTURAL REINFORCEMENT FOR GRAB BAR (OBC 4.5.2.3)

CITY OF BRAMPTON
BUILDING DIVISION
REVIEWED
JAN 08 2018
BY
MARK DERKSEN



2012 CODE
COMPLIANCE PACKAGE "A1"

REVISIONS	
5.	
4.	
3.	
2.	
1. ISSUED FOR PERMIT	JUL 30, 2018


The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.
QUALIFICATION INFORMATION
 Required unless design is exempt under Division C, Subsection 3.2.5 of the building code
VIKAS GAJJAR
 NAME SIGNATURE
28770
 BCIN

REGION DESIGN INC.
 8700 DUFFERIN ST.
 CONCORD, ONTARIO
 L4K 4S8
 P (416) 736-4095
 F (905) 660-0746

SHEET TITLE
**BLOCKING
 FORCED ENTRY & GRAB BAR**
 SCALE
 3/4"=1'-0"
 DATE
 JULY 2018


CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.
 PAGE No.
11

Greenpark.
 PROJECT NAME
 MINNISALE HOMES CORP.

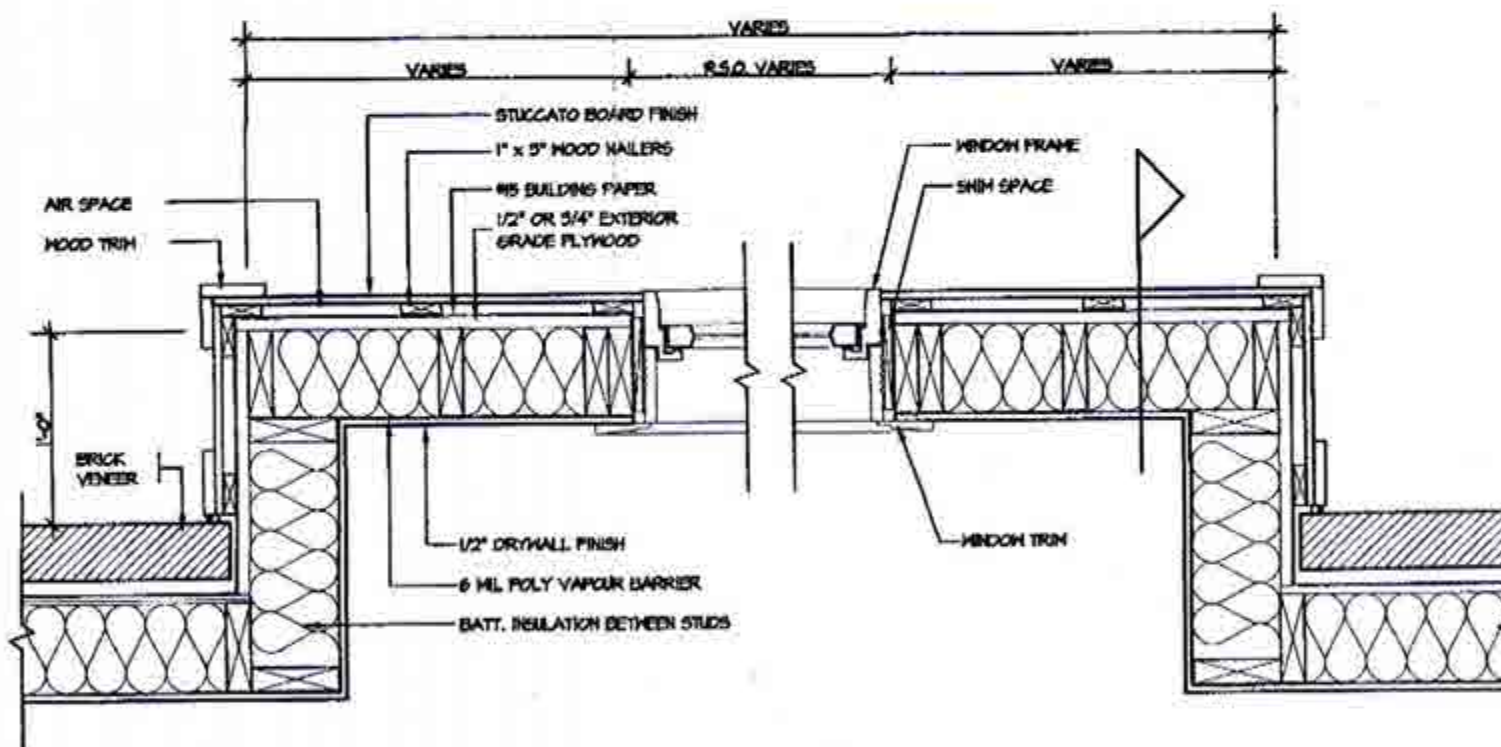


PLAN VIEW

STUCCO BOARD FINISH CLADDING (OBC 9.27.)

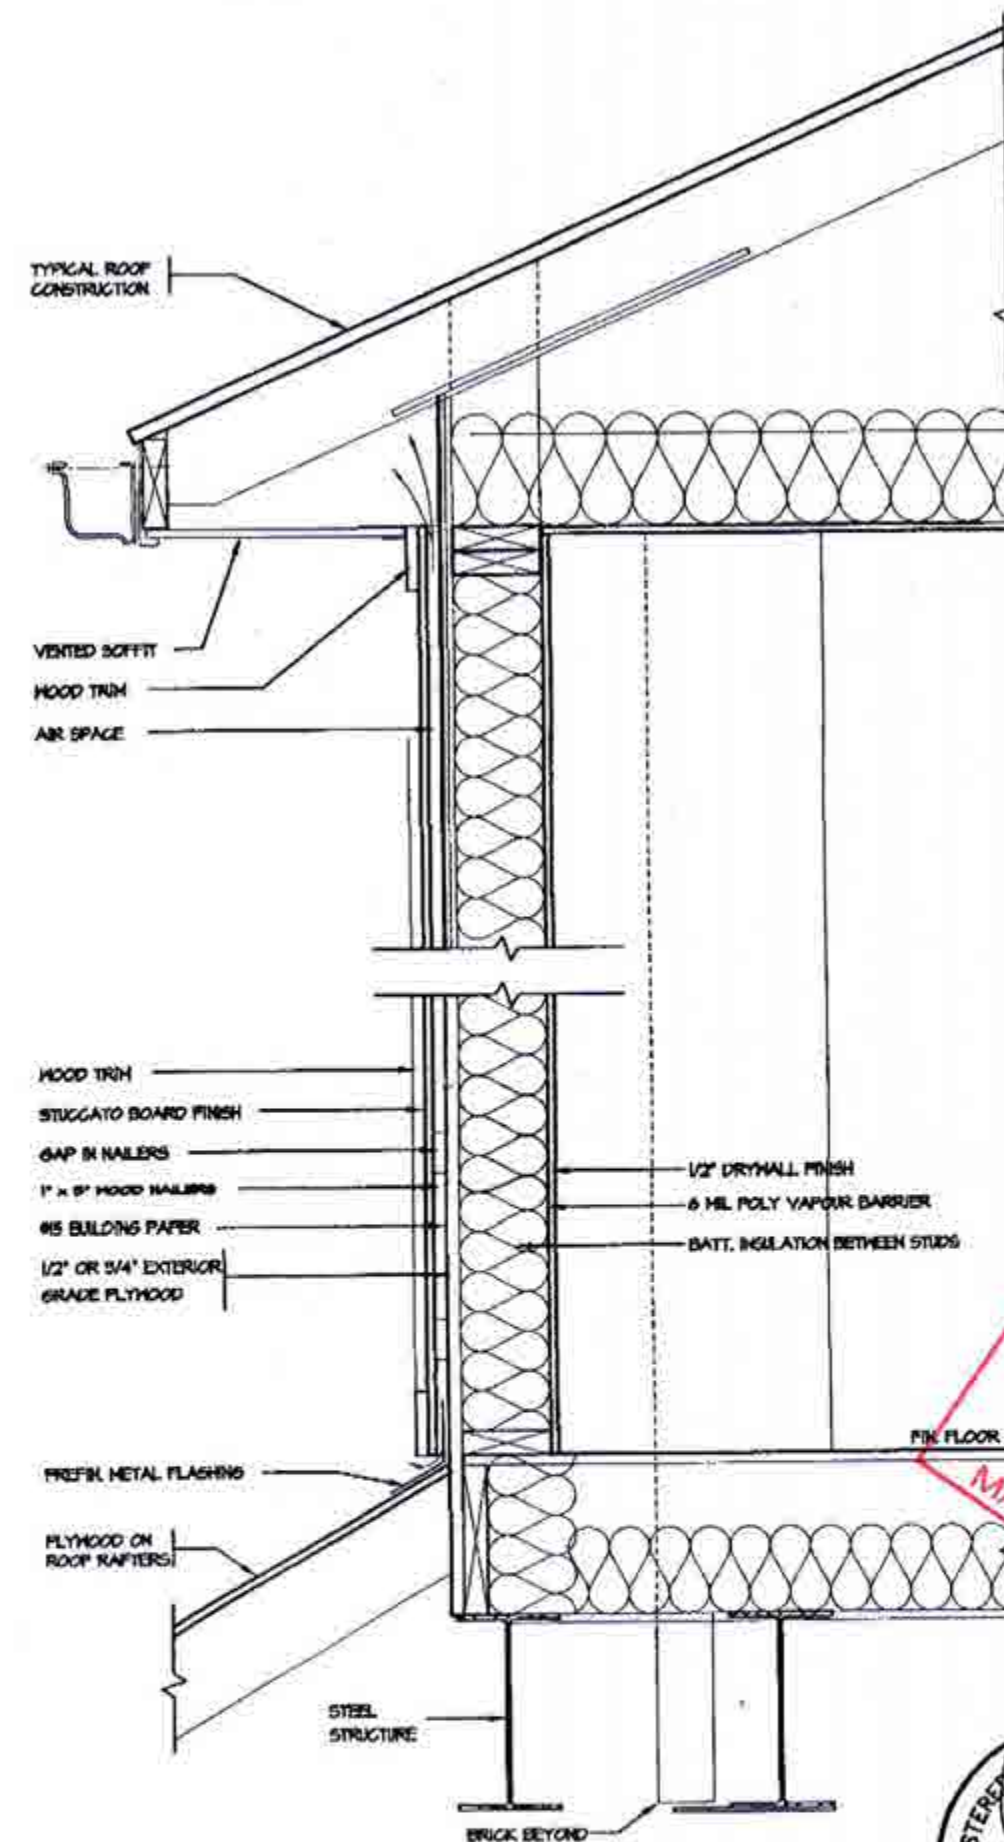

CROSS SECTION

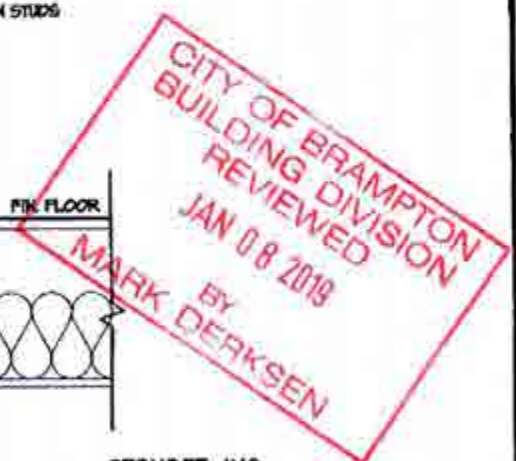


FOR STRUCTURE ONLY


2012 CODE
COMPLIANCE PACKAGE "A1"

5. 4. 3. 2. 1. ISSUED FOR PERMIT JUL 30, 2018 REVISIONS	The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR 28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO L4K 4S6 P (416) 736-4006 F (905) 860-0746	REGION DESIGN INC.	SHEET TITLE STUCCO BOARD FINISH CLADDING SCALE 1/2"=1'-0" DATE JULY 2018	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED. PAGE No. 12	Greenpark™ PROJECT NAME MINNISALE HOMES CORP.
---	--	---	----------------------------------	---	---	---

11:06:38 AM MUSTARD DETAIL/SP/ERMIT SET/2017/1 PACKAGE (MINNISALE)P 12 - STUCCO BOARD PACKAGE A1.DWG July 30, 2018

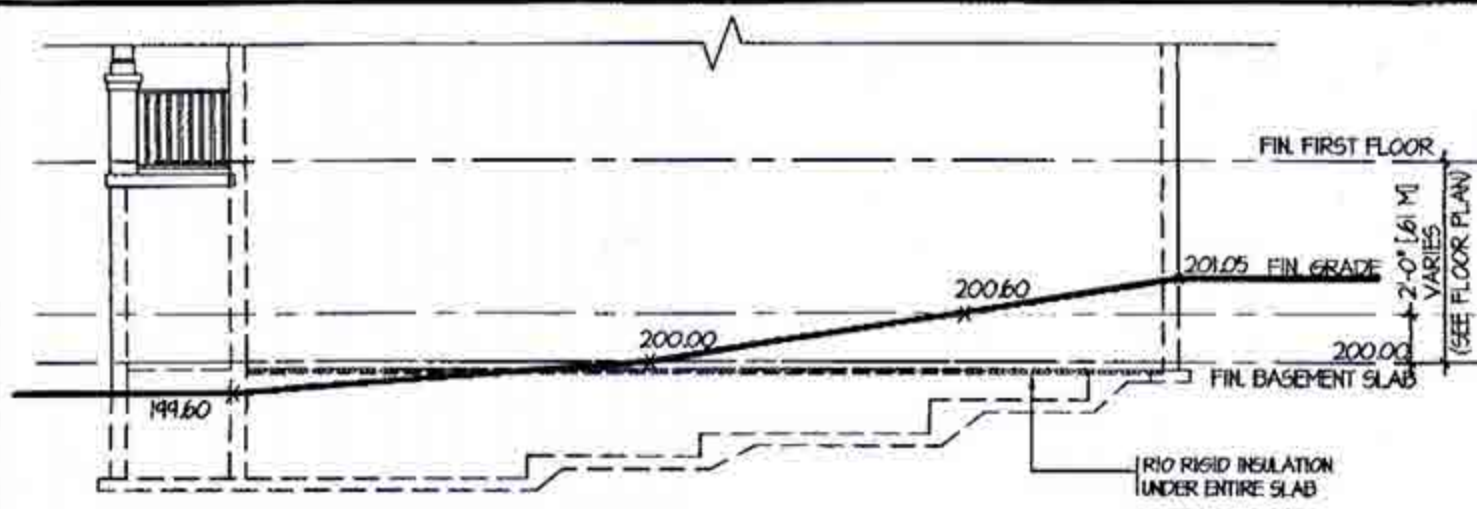


TYPICAL RIGHT SIDE ELEVATION

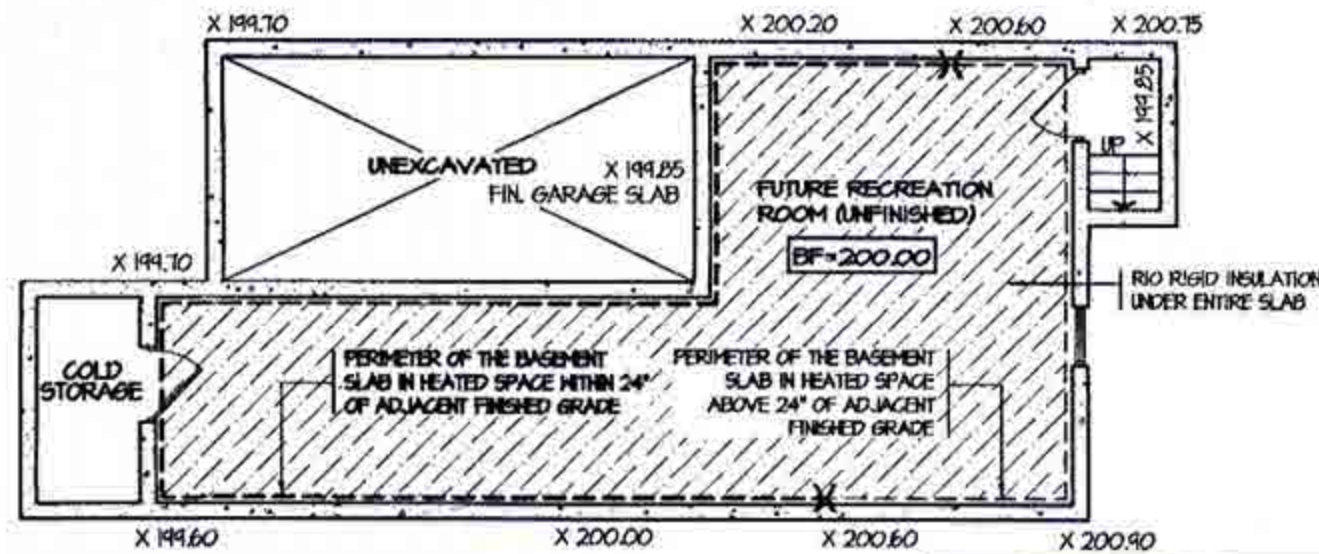


TYPICAL BASEMENT PLAN

SLAB ON GRADE CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS.
2. ALL LEVELS ARE SHOWN IN METRIC.

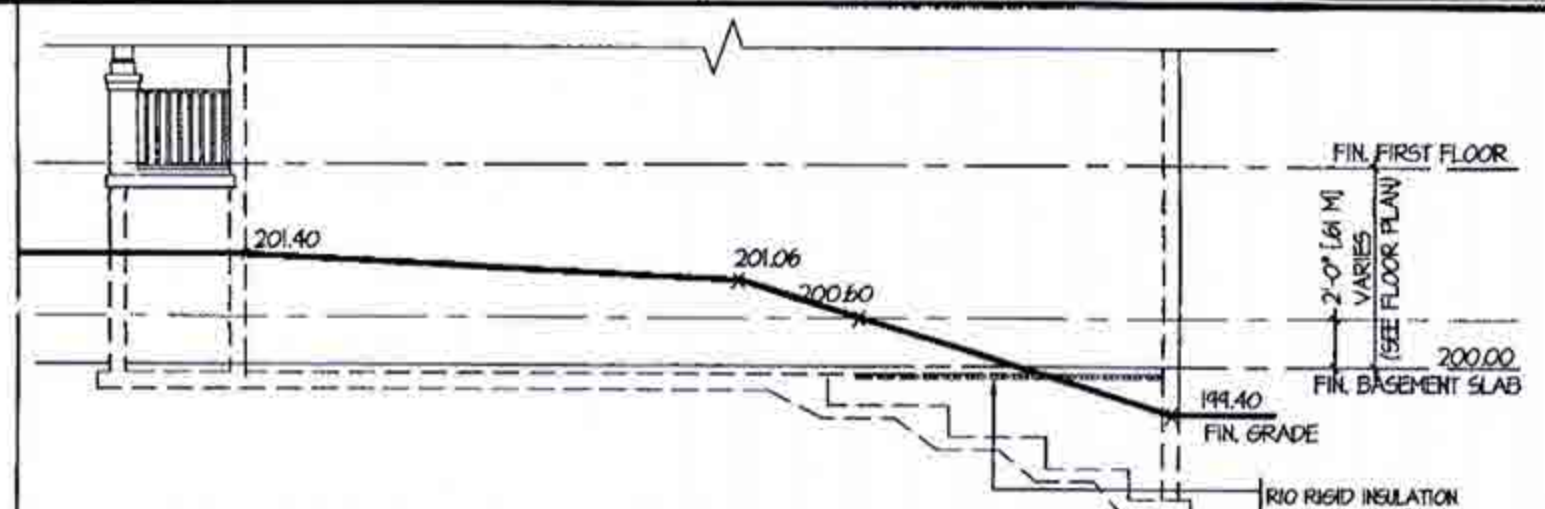


TYPICAL RIGHT SIDE ELEVATION

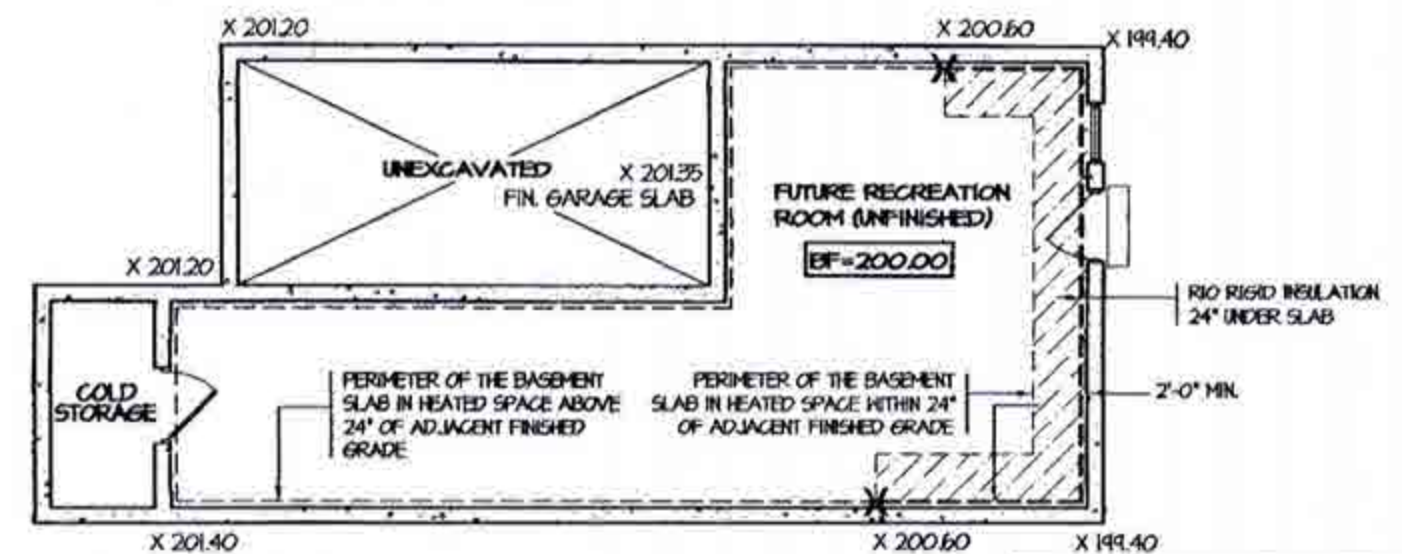

TYPICAL BASEMENT PLAN


WALK OUT BASEMENT CONDITION

NOTES:
1. LEVELS SHOWN ON THE PLANS ARE FOR ILLUSTRATION PURPOSE ONLY, SEE FINAL GRADING PLAN FOR ACTUAL LEVELS.
2. ALL LEVELS ARE SHOWN IN METRIC.

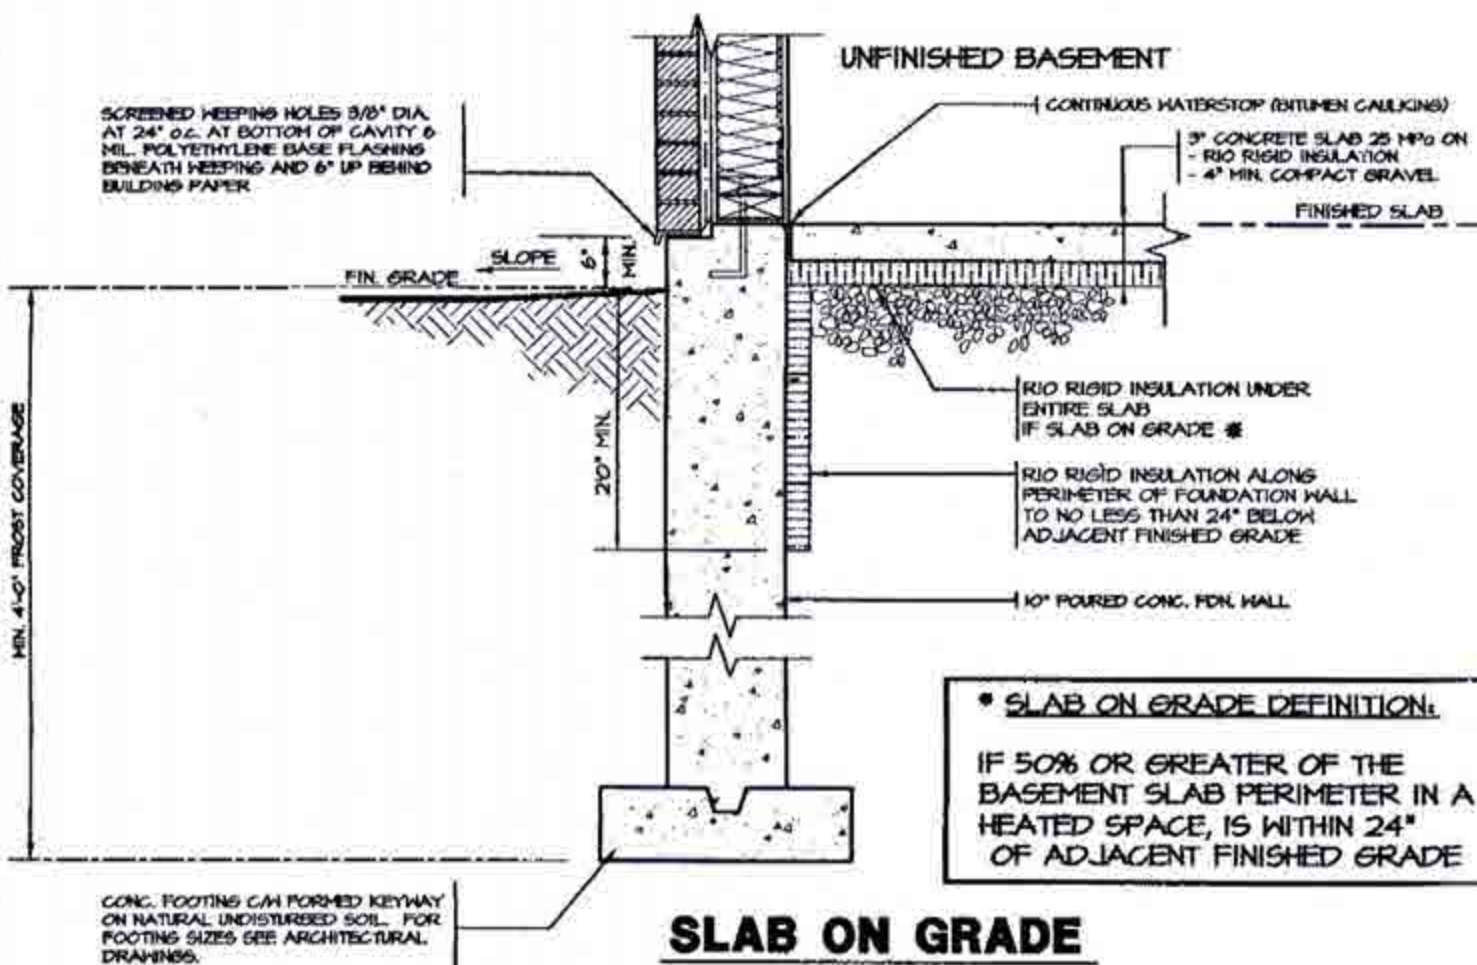

SLAB ON GRADE

* **SLAB ON GRADE DEFINITION:**
IF 50% OR GREATER OF THE BASEMENT SLAB PERIMETER IN A HEATED SPACE, IS WITHIN 24" OF ADJACENT FINISHED GRADE

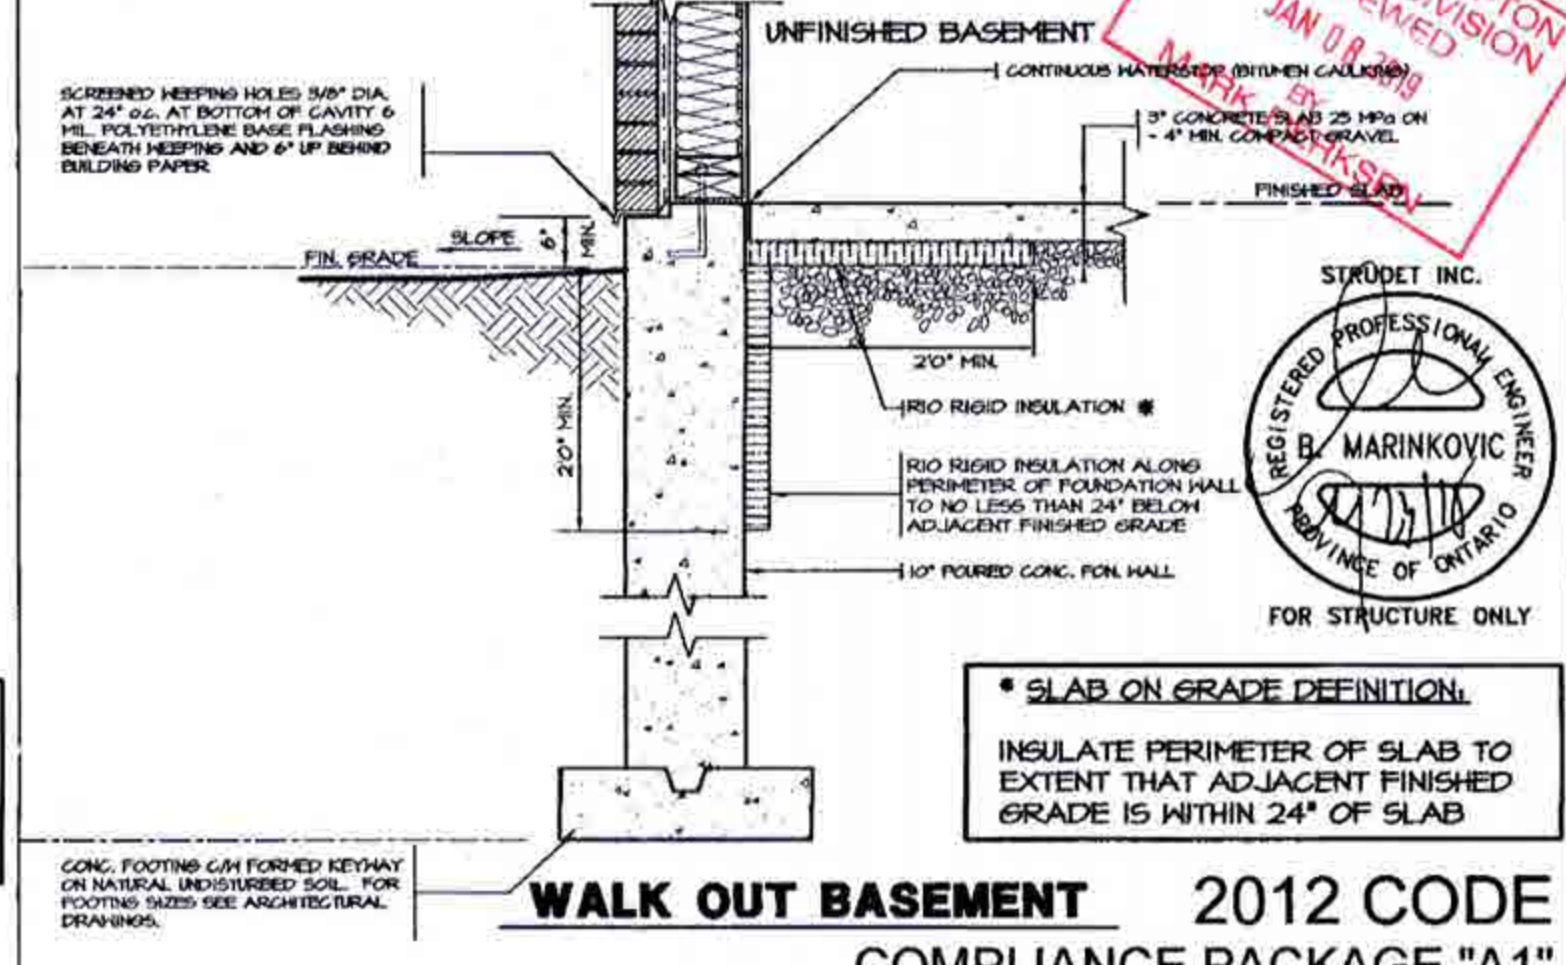

WALK OUT BASEMENT 2012 CODE COMPLIANCE PACKAGE "A1"

* **SLAB ON GRADE DEFINITION:**
INSULATE PERIMETER OF SLAB TO EXTENT THAT ADJACENT FINISHED GRADE IS WITHIN 24" OF SLAB



FOR STRUCTURE ONLY

NO.	REVISIONS	DATE
1.	ISSUED FOR PERMIT	JUL 30, 2018

The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer.
QUALIFICATION INFORMATION
Required unless design is exempt under Division C, Subsection 3.2.5 of the building code
VIKAS GAJJAR
NAME
28770
BCIN
SIGNATURE


REGION DESIGN INC.
1700 DUFFERIN ST.
CONCORD, ONTARIO
L4K 4S8
P (416) 736-4098
F (905) 660-0740

REGION
DESIGN
INC.

SHEET TITLE
SLAB ON GRADE WALKOUT BASEMENT
SCALE
N.T.S.
DATE
JULY 2018

CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.
PAGE No.
13

Greenpark
PROJECT NAME
MINNISALE HOMES CORP.

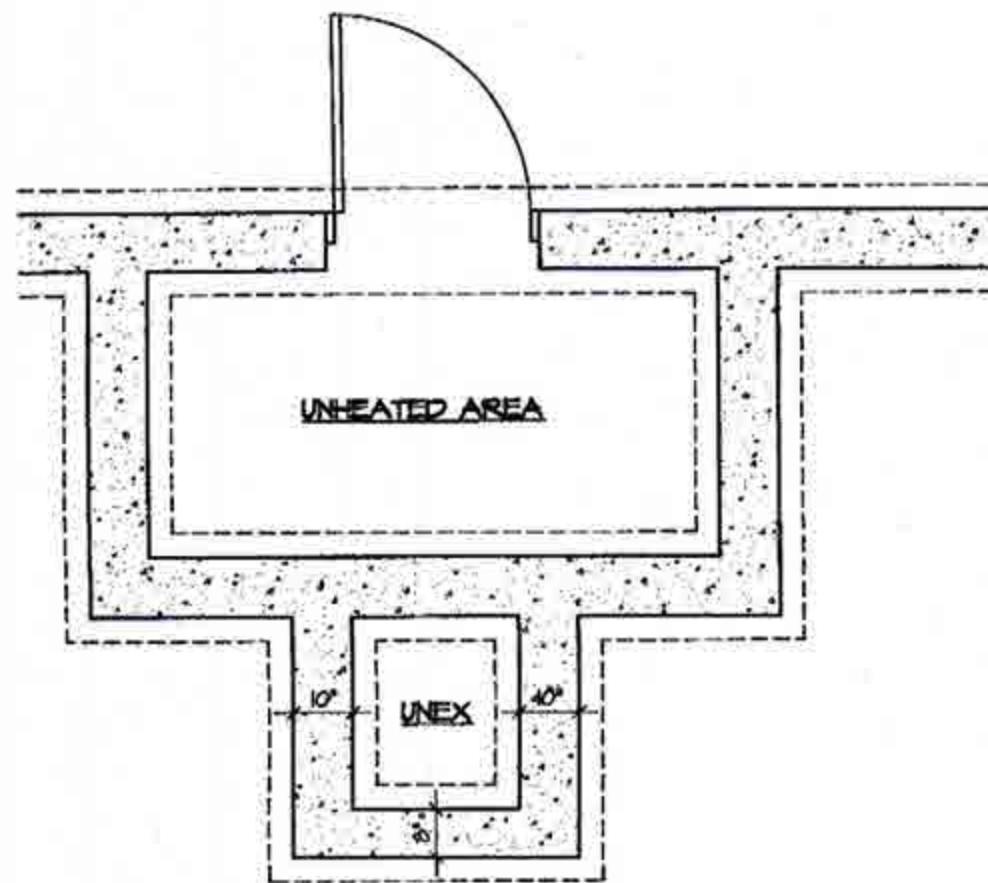

FOUNDATION PLAN

FOR POURED CONCRETE
SLAB STRUCTURE REFER
TO ARCHITECTURAL
DRAWINGS

GUARD &
HANDRAIL

NOSING
REINF. W/
10M BARS

GROUND FLOOR PLAN

CLEAR SPACING
BETWEEN PICKETS TO
BE 4" MAX. NO
MEMBER BETWEEN 4" &
2'-11" ABOVE SLAB

NOSING
REINF. W/
10M BARS

MASONRY EXTERIOR
FACING, FILL SPACE
BETWEEN WALL &
FACING W/ MORTAR
& PROVIDE METAL
TIES SEE NOTE 2

10M #8" O.C.
DOWELS TO
MATCH BOTTOM
REINF.

POURED FOR. WALL

6" X16"
POURED
CONC.
FOOTING

FOR POURED CONCRETE
SLAB STRUCTURE REFER
TO ARCHITECTURAL
DRAWINGS

SECTION 'A'

NOTE: FOR MORE THAN 8 RISERS


SECTION 'B'

GENERAL NOTES

- EXTERIOR STAIRS**
7 7/8" RISE MAXIMUM
8 1/4" RUN MINIMUM
1 1/4" TREAD MINIMUM
- MASONRY TIES**
WHEN BRICK FACING IS USED ABOVE
GROUND LEVEL, PROVIDE 5/16" DIA.
CORROSION RESISTANT METAL TIES @ 36"
HORIZONTAL & 8" VERTICAL
- GUARDS**
ARE REQUIRED AROUND CONCRETE SLAB
IF MORE THAN 2'-0" ABOVE GRADE & ON
BOTH SIDES OF STAIRS CONTAINING MORE
THAN 6 RISERS. MINIMUM 31" HIGH FOR
STAIRS MINIMUM 35" HIGH FOR PORCHES
UP TO 5'-11" ABOVE GRADE. MINIMUM 42"
HIGH FOR GREATER HTS.
- HANDRAIL**
ARE REQUIRED WHERE STEPS HAVE MORE
THAN 3 RISERS. HANDRAIL HEIGHT 31" -
35"
- FOUNDATION WALLS**
THICKNESS OF FOUNDATION WALLS IS
DEPENDANT UPON VENEER CUT 8" FOR UP
TO 26" VENEER CUT HEIGHT 10" FOR
VENEER CUT OVER 26" HIGH
- CONCRETE**
MINIMUM CONCRETE STRENGTH SHALL BE
4650 PSI (32MPa) W/ 5%-8% AIR
ENTRAINMENT MINIMUM CONCRETE SLAB
THICKNESS 5"
- CONCRETE COVERS**
PROVIDE MINIMUM 3/4" CLEAR CONCRETE
COVER TO REINFORCING BARS



FOR STRUCTURE ONLY
2012 CODE
COMPLIANCE PACKAGE "A1"

5.			The undersigned has reviewed and takes responsibility for this design, and has the qualifications and meets the requirements set out in the Ontario Building Code to be a designer. QUALIFICATION INFORMATION Required unless design is exempt under Division C, Subsection 3.2.5 of the building code VIKAS GAJJAR  28770 NAME SIGNATURE BCIN	REGION DESIGN INC. 8700 DUFFERIN ST. CONCORD, ONTARIO P (416) 736-4086 F (905) 660-0746	REGION DESIGN INC.	SHEET TITLE	POURED CONCRETE STAIRS	CONTRACTOR SHALL CHECK ALL DIMENSIONS AND ELEVATIONS BEFORE COMMENCING WITH WORK AND REPORT ANY DISCREPANCIES TO THE DESIGNER. PRINTS ARE NOT TO BE SCALED.	 Greenpark.		
4.						SCALE	3/8"=1'-0"	PAGE No.		14	PROJECT NAME MINNISALE HOMES CORP.
3.						DATE	JULY 2018				
2.											
1.	ISSUED FOR PERMIT	JUL 30, 2018									
REVISIONS											