

19-440067-000-00 KR
M2060

RESPONSIBILITIES

THIS DESIGN IS FOR AN INDIVIDUAL BUILDING COMPONENT AND HAS BEEN BASED ON INFORMATION PROVIDED BY THE DESIGN OFFICE OF KOTT LUMBER. THE UNDERSIGNED ENGINEER DISCLAIMS ANY RESPONSIBILITY FOR DAMAGES AS A RESULT OF FAULTY OR INCORRECT INFORMATION, SPECIFICATION AND/OR DESIGNS FURNISHED TO THE ENGINEER. THE UNDERSIGNED ENGINEER IS ONLY RESPONSIBLE FOR THE STRUCTURAL INTEGRITY OF THIS BUILDING COMPONENT FOR THE CONDITIONS AND LOADS SHOWN ON THIS DRAWING. THE STRUCTURAL INTEGRITY OF THE BUILDING AND THE VERIFICATION OF THE DIMENSIONS AND THE DESIGN LOADS USED ARE THE RESPONSIBILITY OF THE BUILDING DESIGNER.

TRUSSES ARE DESIGNED IN CONFORMANCE WITH THE RELEVANT SECTIONS OF THE NATIONAL BUILDING CODE OF CANADA OR THE CANADIAN CODE FOR FARM BUILDINGS, WHICHEVER APPLIES TO THE BUILDING TYPE INDICATED ON THE DRAWING

IT IS THE RESPONSIBILITY OF KOTT LUMBER TO ENSURE THAT TRUSSES ARE MANUFACTURED IN CONFORMANCE WITH THESE DESIGNS AND WITH THE SPECIFICATIONS OUTLINED BELOW. THE UNDERSIGNED ENGINEER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

USE AND OCCUPANCY

- The building is of the type indicated on the drawing

LOADING

- The truss loading intensity and distribution as well as load transfer mechanism is that indicated on the drawing
- No buildings, trees, parapets or other projections higher than the roof for which the trusses are used are located within a distance less than ten (10) times the difference in height, or five metres (16 ft) whichever is greater, unless the drawing indicates that the snow drifting has been taken into account

HANDLING, INSTALLATION AND BRACING


- The trusses must be handled and installed by a qualified professional as per the supplied document titled *Information for Truss Installers* and the BCSI-B1 and BCSI-B3 Summary Sheets
- The compression chords are laterally braced by continuous rigid diaphragm sheathing or as specified on the drawing
- Temporary and permanent bracing must be installed as indicated on the truss drawing and according to the BCSI-B1 and BCSI-B3 Summary Sheets. Bracing for the lateral stability of the truss is to be provided by the building designer
- **It is recommended that a Professional Engineer's advice be obtained for the bracing of trusses spanning more than 12.37m (40'-7")**

SUPPORTS

- The trusses are to be supported at the bearing points indicated and anchored to the supports where considered necessary by the designer of the overall structure
- Bearing sizes shown are the minimum required to prevent crushing of the truss members and do not necessarily take into account stability of the overall building structure
- Elevation of bearings must be carefully checked and shimmed to alignment for solid bearings
- Adequate wood truss bearing is the responsibility of the building designer.

DIMENSIONS

- Geometry of the truss and dimensions indicated on the drawing are identical to those of the installed truss.

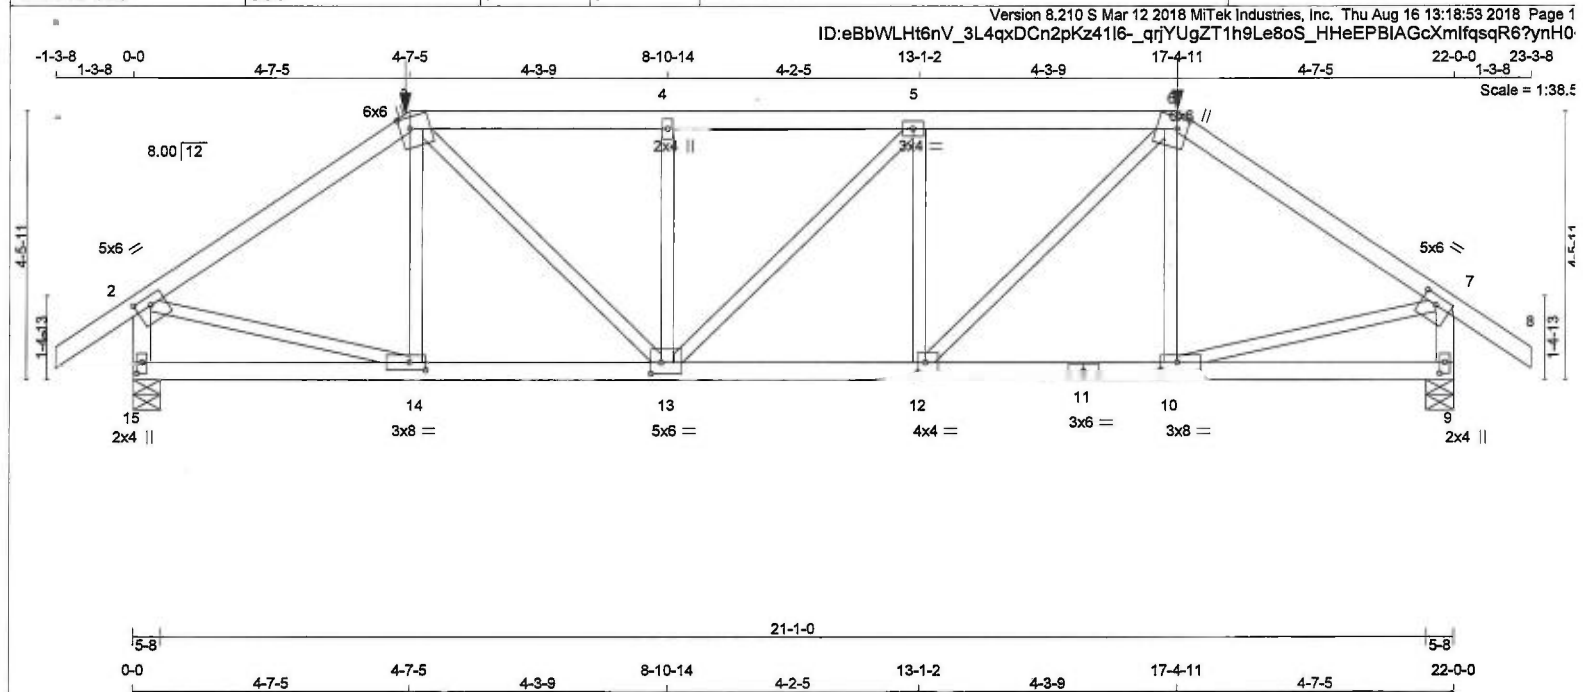

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF
3 - 6	2x4	DRY	No.2	SPF
6 - 8	2x4	DRY	No.2	SPF
15- 2	2x4	DRY	No.2	SPF
9 - 7	2x4	DRY	No.2	SPF
15- 11	2x4	DRY	No.2	SPF
11- 9	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
DRY; SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMVVW-t	MT20	5.0	6.0	1.75 3.00
3	TTVVW+m	MT20	6.0	6.0	2.25 2.00
4	TMVVW+w	MT20	2.0	4.0	
5	TMVVW-t	MT20	3.0	4.0	
6	TTVVW+m	MT20	6.0	6.0	2.25 2.00
7	TMVVW-t	MT20	5.0	6.0	1.75 3.00
9	BMV1+p	MT20	2.0	4.0	2.25 1.00
10	BMVVW-t	MT20	3.0	8.0	1.50 3.25
11	BS-t	MT20	3.0	6.0	
12	BMVVW-t	MT20	4.0	4.0	2.00 1.50
13	BMVVWV-t	MT20	5.0	6.0	2.25 2.00
14	BMVVW-t	MT20	3.0	8.0	1.50 3.25
15	BMV1+p	MT20	2.0	4.0	2.25 1.00

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 267.4 lbs FACTORED DOWN AT 17-4-11, AND 267.4 lbs FACTORED DOWN AT 4-7-5 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BOILING BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
15	2025	0	2025	0	0	5-8	5-8
9	2025	0	2025	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
15	1420	1001/0	0/0	0/0	0/0	419/0	0/0
9	1420	1001/0	0/0	0/0	0/0	419/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 15, 9

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.64 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MAX. FACTORED		FACTORED		MAX. FACTORED		FACTORED		
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MAX. UNBRAC	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)	LENGTH		(LBS)	CSI (LC)	
FR-TO		FROM TO			FR-TO			
1-2	0 / 29	-77.4	-77.4	0.11 (1)	10.00	14-3	-257 / 65	0.08 (1)
2-3	-2245 / 0	-77.4	-77.4	0.44 (1)	4.09	3-13	0 / 1141	0.28 (1)
3-4	-2677 / 0	-145.9	-145.9	0.50 (1)	3.66	13-4	-664 / 0	0.21 (1)
4-5	-2677 / 0	-145.9	-145.9	0.51 (1)	3.64	13-5	-4 / 0	0.00 (1)
5-6	-2680 / 0	-145.9	-145.9	0.51 (1)	3.64	12-5	-666 / 0	0.21 (1)
6-7	-2245 / 0	-77.4	-77.4	0.44 (1)	4.09	12-6	0 / 1145	0.28 (1)
7-8	0 / 29	-77.4	-77.4	0.11 (1)	10.00	10-6	-259 / 65	0.08 (1)
15-2	-1961 / 0	0.0	0.0	0.22 (1)	5.97	2-14	0 / 1914	0.47 (1)
9-7	-1961 / 0	0.0	0.0	0.22 (1)	5.97	10-7	0 / 1913	0.47 (1)
15-14	0 / 0	-33.0	-33.0	0.18 (4)	10.00			
14-13	0 / 1859	-33.0	-33.0	0.43 (1)	10.00			
13-12	0 / 2680	-33.0	-33.0	0.54 (1)	10.00			
12-11	0 / 1858	-33.0	-33.0	0.42 (1)	10.00			
11-10	0 / 1858	-33.0	-33.0	0.42 (1)	10.00			
10-9	0 / 0	-33.0	-33.0	0.18 (4)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
3	4-7-5	-267	-267	—	FRONT	VERT	TOTAL
6	17-4-11	-267	-267	—	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 4-7-5
END SETBACK = 6-0-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIQ 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.16")

CSI: TC=0.51/1.00 (5-6:1) , BC=0.54/1.00 (12-13:1)
WB=0.47/1.00 (2-14:1) . SSI=0.32/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

CONTINUED ON PAGE 2




**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (12) (INPUT = 0.90)
JSI METAL= 0.60 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



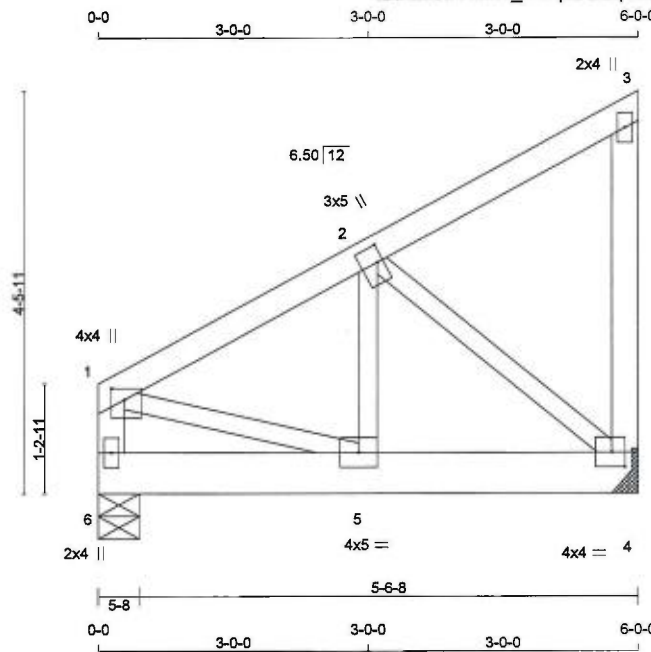

TOTAL WEIGHT = 30 lb

[M]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
6 - 1	2x4	DRY	No.2	SPF
1 - 3	2x4	DRY	No.2	SPF
4 - 3	2x4	DRY	No.2	SPF
6 - 4	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMVW+p	MT20	4.0	4.0	1.50	1.75
2	TMWW+t	MT20	3.0	5.0	2.25	0.75
3	TMV+p	MT20	2.0	4.0		
4	BMVW1-t	MT20	4.0	4.0	2.00	1.75
5	BMWW-t	MT20	4.0	5.0		
6	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
VERT	HORZ	DOWN	HORZ	UPLIFT
6	1144	0	1144	0
4	1144	0	1144	0

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 4 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS
COMBINED	SNOW	LIVE
6	803	562 / 0
4	803	562 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO				FR-TO			
6-1	-763 / 0	0.0	0.0	1-5	0 / 850	0.21 (1)	0.21 (1)
1-2	-921 / 0	-77.4	-77.4	5-2	0 / 836	0.21 (1)	0.21 (1)
2-3	-11 / 0	-77.4	-77.4	2-4	-1059 / 0	0.27 (1)	0.27 (1)
4-3	-93 / 0	0.0	0.0				
6-5	0 / 0	-304.1	-304.1				
5-4	0 / 819	-304.1	-304.1				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 33.3	PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder

START DISTANCE = 0-0

END DISTANCE = 14-6-8

END DISTANCE = 6-0-0

END SPAN CARRIED = 14-6-8

END WALL WIDTH = 5-8

APPLIED TO FRONT SIDE OF BOTTOM CHORD.

- ADDTL LOADS BASED ON 55 % OF GSL

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014

- CSA 086-09

- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")

CALCULATED VERT. DEFL.(LL) = L/999 (0.01")

ALLOWABLE DEFL.(TL)= L/360 (0.20")

CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.12/1.00 (1-2:1), BC=0.28/1.00 (4-5:1), WB=0.27/1.00 (2-4:1), SSI=0.35/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

CONTINUED ON PAGE 2




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



JSI GRIP= 0.85 (2) (INPUT = 0.90)
JSI METAL= 0.36 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



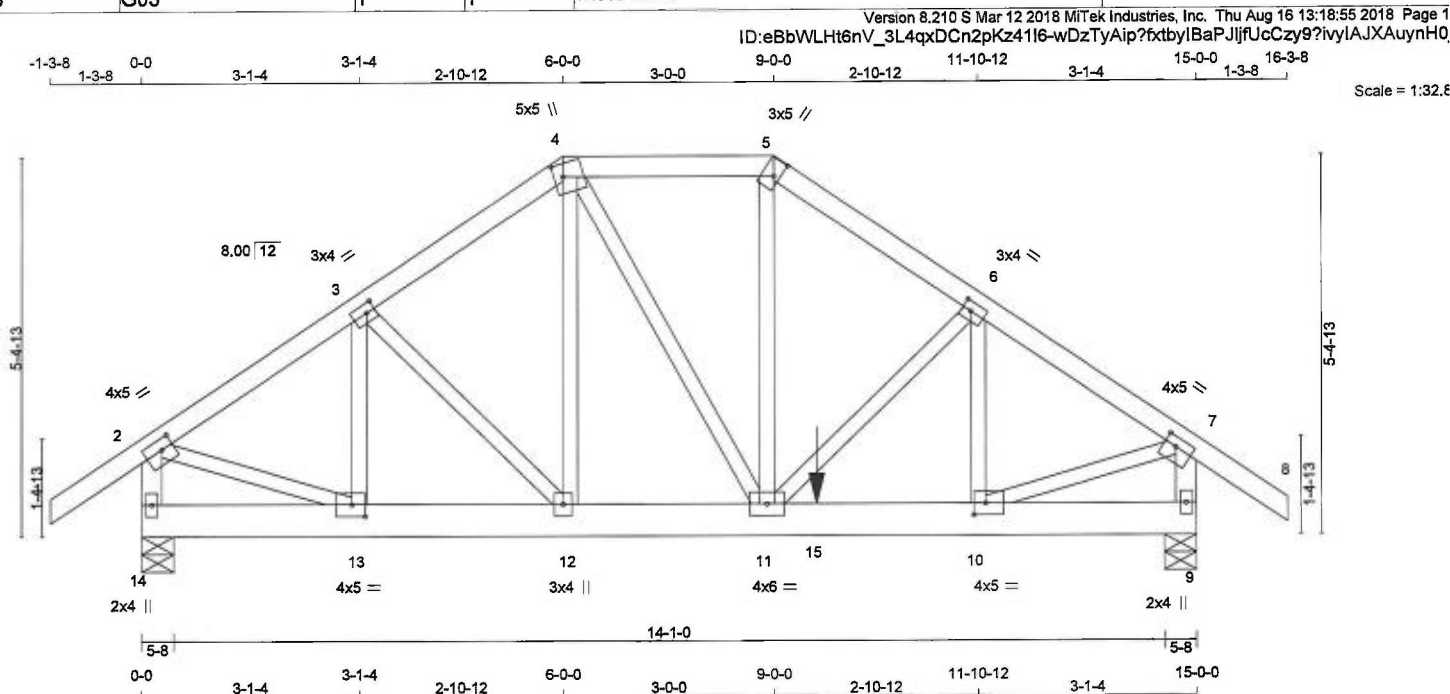

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	NO.2	SPF
4 - 5	2x4	NO.2	SPF
5 - 8	2x4	NO.2	SPF
14- 2	2x4	NO.2	SPF
9 - 7	2x4	NO.2	SPF
14- 9	2x6	NO.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMWV-t	MT20	4.0	5.0	1.75 2.00
3	TMWV-t	MT20	3.0	4.0	1.50 1.50
4	TTWV+m	MT20	5.0	5.0	2.25 1.50
5	TTW+h	MT20	3.0	5.0	2.75 1.00
6	TMWV-t	MT20	3.0	4.0	1.50 1.50
7	TMWV-t	MT20	4.0	5.0	1.50 2.00
9	BMV1+p	MT20	2.0	4.0	
10	BMWV-t	MT20	4.0	5.0	2.00 2.00
11	BMWVWV-t	MT20	4.0	6.0	
12	BMWVW+t	MT20	3.0	4.0	
13	BMWVW-t	MT20	4.0	5.0	2.00 2.25
14	BMV1+p	MT20	2.0	4.0	

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 1058.7 lbs FACTORED DOWN AT 9-7.4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
14	1198	0	1198	0	0	5-8	5-8
9	1495	0	1495	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
14	839	600 / 0	0 / 0	0 / 0	0 / 0	239 / 0	0 / 0
9	1047	746 / 0	0 / 0	0 / 0	0 / 0	301 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 14, 9

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.13 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
1-2	0 / 29	-77.4	-77.4 0.11 (1)	10.00	13-3	-287 / 0	0.06 (1)
2-3	-1157 / 0	-77.4	-77.4 0.14 (1)	5.74	3-12	-17 / 0	0.01 (1)
3-4	-1173 / 0	-77.4	-77.4 0.13 (1)	5.71	12-4	-19 / 31	0.01 (4)
4-5	-1229 / 0	-77.4	-77.4 0.15 (1)	5.59	4-11	0 / 535	0.13 (1)
5-6	-1478 / 0	-77.4	-77.4 0.13 (1)	5.24	11-5	0 / 612	0.15 (1)
6-7	-1552 / 0	-77.4	-77.4 0.14 (1)	5.13	11-6	-121 / 0	0.04 (1)
7-8	0 / 29	-77.4	-77.4 0.11 (1)	10.00	10-6	-140 / 8	0.03 (1)
14-2	-1164 / 0	0.0	0.0 0.13 (1)	7.35	2-13	0 / 1023	0.25 (1)
9-7	-1490 / 0	0.0	0.0 0.17 (1)	6.68	10-7	0 / 1366	0.34 (1)
14-13	0 / 0	-17.5	-17.5 0.03 (1)	10.00			
13-12	0 / 974	-17.5	-17.5 0.16 (1)	10.00			
12-11	0 / 961	-17.5	-17.5 0.28 (1)	10.00			
11-15	0 / 1301	-17.5	-17.5 0.47 (1)	10.00			
15-10	0 / 1301	-17.5	-17.5 0.47 (1)	10.00			
10-9	0 / 0	-17.5	-17.5 0.05 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
15	9-7-4	-1059	-1059	—	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED
BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO
ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(LL)= L/360 (0.50")
CALCULATED VERT. DEFL(LL) = L/ 999 (0.03")
ALLOWABLE DEFL(TL)= L/360 (0.50")
CALCULATED VERT. DEFL(TL) = L/ 999 (0.05")

CSI: TC=0.17/1.00 (7-9:1) , BC=0.47/1.00 (10-11:1)
WB=0.34/1.00 (7-10:1) , SS=0.58/1.00 (10-11:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PSI)	(PLI)	(PSI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

CONTINUED ON PAGE 2



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**




PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.90 (7) (INPUT = 0.90)
JSI METAL= 0.50 (7) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu Aug 16 13:18:55 2018 Page 1
ID:eBbWLHt6nV_3L4qxDCn2pKz41l6-wDzTyAip?fxtbylBaPJlfUaXz0F?kkylAJXAuynH0.

Scale = 1:30.5

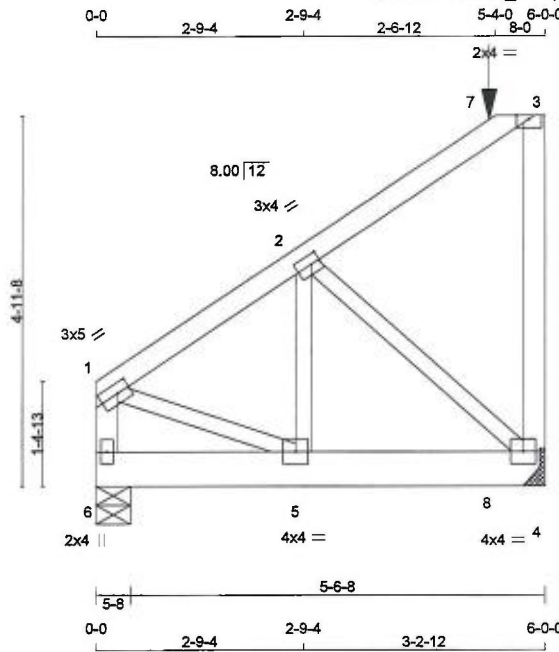

TOTAL WEIGHT = 32 lb [M]

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2
4 - 3	2x4	DRY	No.2
6 - 1	2x4	DRY	No.2
6 - 4	2x6	DRY	No.2

ALL WEBS EXCEPT 2x3 DRY No.2

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMVW-t	MT20	3.0	5.0	1.50	2.00
2	TMVW-t	MT20	3.0	4.0	1.50	1.50
3	TMV-p	MT20	2.0	4.0	Edge	
4	BMVW1-t	MT20	4.0	4.0		
5	BMVW1-t	MT20	4.0	4.0		
6	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

HANGERS NOTES
1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 263.6 lbs FACTORED DOWN AT 5-4-0 ON TOP CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
4	1061	0	1061	0	0	MECHANICAL	
6	856	0	856	0	0	5-8	5-8

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 4 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
4	743	528 / 0	0 / 0	0 / 0	0 / 0	215 / 0	0 / 0
6	603	405 / 0	0 / 0	0 / 0	0 / 0	199 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	UNBRACED LENGTH
FR-TO		FROM TO		FR-TO			
1-2	-646 / 0	-77.4 -77.4	0.19 (1)	6.25	5-2	0 / 494	0.12 (1)
2-7	0 / 22	-77.4 -77.4	0.27 (1)	6.25	2-4	-744 / 0	0.22 (1)
7-3	0 / 22	-77.4 -77.4	0.27 (1)	6.25	1-5	0 / 593	0.15 (1)
4-3	-296 / 0	0.0 0.0	0.13 (1)	7.81			
6-1	-635 / 0	0.0 0.0	0.07 (1)	7.81			
6-5	0 / 0	-198.1 -198.1	0.11 (1)	10.00			
5-8	0 / 558	-198.1 -198.1	0.21 (1)	10.00			
8-4	0 / 558	-198.1 -198.1	0.21 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
7	5-4-0	-264	-264	—	FRONT	VERT	TOTAL

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

GIRDER TYPE: CStdGirder
START DISTANCE = 0-0
START SPAN CARRIED = 9-6-8
END DISTANCE = 6-0-0
END SPAN CARRIED = 9-6-8
END WALL WIDTH = 5-8
APPLIED TO BACK SIDE OF BOTTOM CHORD.
- ADD'L LOADS BASED ON 55 % OF GSL.

GIRDER TYPE: CPrimeHip
LEFT SETBACK = 5-4-0
RIGHT SETBACK = 0-0
END SETBACK = 5-4-0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.27/1.00 (2-3:1), BC=0.21/1.00 (4-5:1), WB=0.22/1.00 (2-4:1), SSI=0.24/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

CONTINUED ON PAGE 2



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (2) (INPUT = 0.90)
JSI METAL= 0.21 (1) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu Aug 16 13:18:56 2018 Page 1
ID:eBbWl-Ht6nV 3L4qxDCn2pKz4116-OPXsAWlRmV3kC5tN86r Gs1kNlIk6T5Wp25hKvynH?

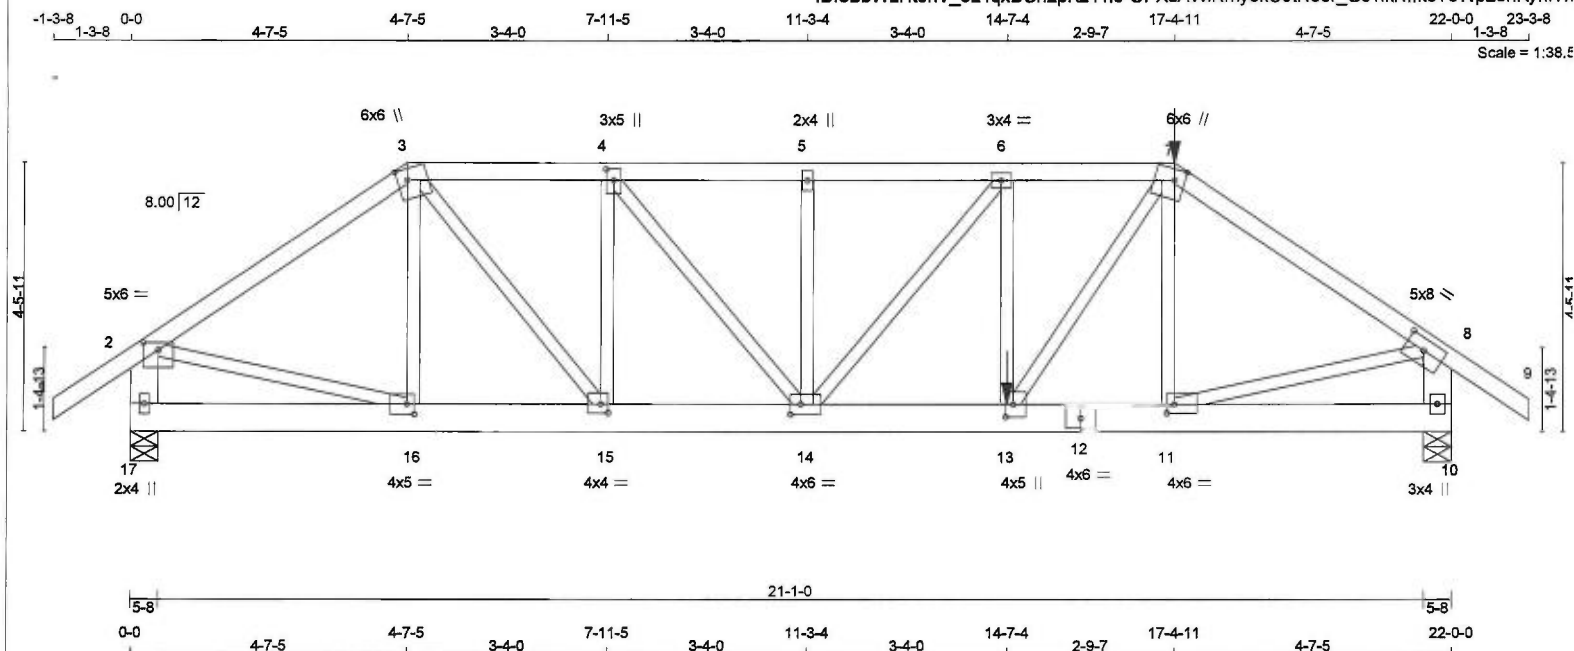

TOTAL WEIGHT = 111 lb

LUMBER

N. L. G. A. RULES					
CHORDS	SIZE		LUMBER		DESCR.
1 - 3	2x4	DRY	No.2		SPF
3 - 7	2x4	DRY	No.2		SPF
7 - 9	2x4	DRY	No.2		SPF
17- 2	2x6	DRY	No.2		SPF
10- 8	2x6	DRY	No.2		SPF
17- 12	2x6	DRY	No.2		SPF
12- 10	2x6	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVV+p	MT20	5.0	6.0	1.50	3.00
3	TMVV+m	MT20	6.0	6.0	2.25	2.00
4	TMVV+t	MT20	3.0	5.0	2.25	1.50
5	TMV+w	MT20	2.0	4.0		
6	TMVW+t	MT20	3.0	4.0		
7	TMVV+m	MT20	6.0	6.0	2.25	2.00
8	TMVW-t	MT20	5.0	8.0	2.25	3.75
10	BMV1+p	MT20	3.0	4.0		
11	BMVVW-t	MT20	4.0	6.0	1.75	1.50
12	BS-t	MT20	4.0	6.0		
13	BMVVW+t	MT20	4.0	5.0	2.50	1.50
14	BMVVWV-t	MT20	4.0	6.0	2.00	2.00
15	BMVW-t	MT20	4.0	4.0	1.75	1.50
16	BMVW-t	MT20	4.0	5.0	2.00	1.50
17	BMV1+p	MT20	2.0	4.0		

HANGERS NOTES

1) SPECIAL HANGER(S) OR CONNECTION(S) REQUIRED TO SUPPORT CONCENTRATED LOAD(S) 267.4 lbs FACTORED DOWN AT 17-4-11 ON TOP CHORD, AND 1142.8 lbs FACTORED DOWN AT 14-7-4 ON BOTTOM CHORD. DESIGN FOR UNSPECIFIED CONNECTION(S) IS DELEGATED TO THE BUILDING DESIGNER.



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
17	1661	0	1661	0	0	5-8	5-8
10	2354	0	2354	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
17	1163	830 / 0	0 / 0	0 / 0	0 / 0	333 / 0	0 / 0
10	1651	1160 / 0	0 / 0	0 / 0	0 / 0	492 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 17. 10

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

C H O R D S					W E B S				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO			FR-TO				
1-2	0 / 29	-77.4	-77.4 0.11 (1)	10.00	16-3	-239 / 0	0.07 (1)		
2-3	-1829 / 0	-77.4	-77.4 0.40 (1)	4.49	3-15	0 / 1243	0.31 (1)		
3-4	-2299 / 0	-77.4	-77.4 0.19 (1)	4.32	15-4	-907 / 0	0.26 (1)		
4-5	-2809 / 0	-77.4	-77.4 0.23 (1)	3.92	4-14	0 / 808	0.20 (1)		
5-6	-2809 / 0	-77.4	-77.4 0.23 (1)	3.92	14-5	-239 / 0	0.07 (1)		
6-7	-3066 / 0	-145.9	-145.9 0.28 (1)	3.70	14-6	-408 / 0	0.19 (1)		
7-8	-2732 / 0	-77.4	-77.4 0.50 (1)	3.70	13-6	-38 / 51	0.02 (4)		
8-9	0 / 29	-77.4	-77.4 0.11 (1)	10.00	13-7	0 / 1425	0.35 (1)		
17-2	-1624 / 0	0.0	0.0 0.12 (1)	7.69	11-7	-294 / 41	0.09 (1)		
10-8	-2285 / 0	0.0	0.0 0.16 (1)	6.74	2-16	0 / 1553	0.38 (1)		
					11-8	0 / 2320	0.57 (1)		
17-16	0 / 0	-17.5	-17.5 0.04 (4)	10.00					
16-15	0 / 1513	-17.5	-17.5 0.21 (1)	10.00					
15-14	0 / 2299	-17.5	-17.5 0.34 (1)	10.00					
14-13	0 / 3066	-17.5	-17.5 0.48 (1)	10.00					
13-12	0 / 2262	-33.0	-33.0 0.37 (1)	10.00					
12-11	0 / 2262	-33.0	-33.0 0.37 (1)	10.00					
11-10	0 / 0	-33.0	-33.0 0.08 (4)	10.00					

FACTORED CONCENTRATED LOADS (LBS)

FACTORY	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE
7	17-4-11	-267	-267	—	FRONT	VERT	TOTAL
13	14-7-4	-1143	-1143	—	FRONT	VERT	TOTAL

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED
BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A
SLOPE OF 2.00/12 MINIMUM

GIRDER TYPE: CPrimeHip
SIDE SETBACK = 4-7.5
END SETBACK = 6-0.0
END WALL WIDTH = 5-8
CORNER FRAMING TYPE: CONVENTIONAL
END JACK TYPE: CONVENTIONAL
APPLIED TO FRONT SIDE
- ADD'L LOADS BASED ON 55 % OF GSL
LOADS APPLIED TO FIRST 7-4-12 OF SPAN
MEASURED FROM THE RIGHT.

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO
ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIQ 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.09")
ALLOWABLE DEFL.(TL)= L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.15")

CSI: TC=0.50/1.00 (7-8:1), BC=0.48/1.00 (13-14:1)
WB=0.57/1.00 (8-11:1), SSI=0.20/1.00 (6-7:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 0.50

CONTINUED ON PAGE 2

**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (11) (INPUT = 0.90)
JSI METAL= 0.57 (11) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




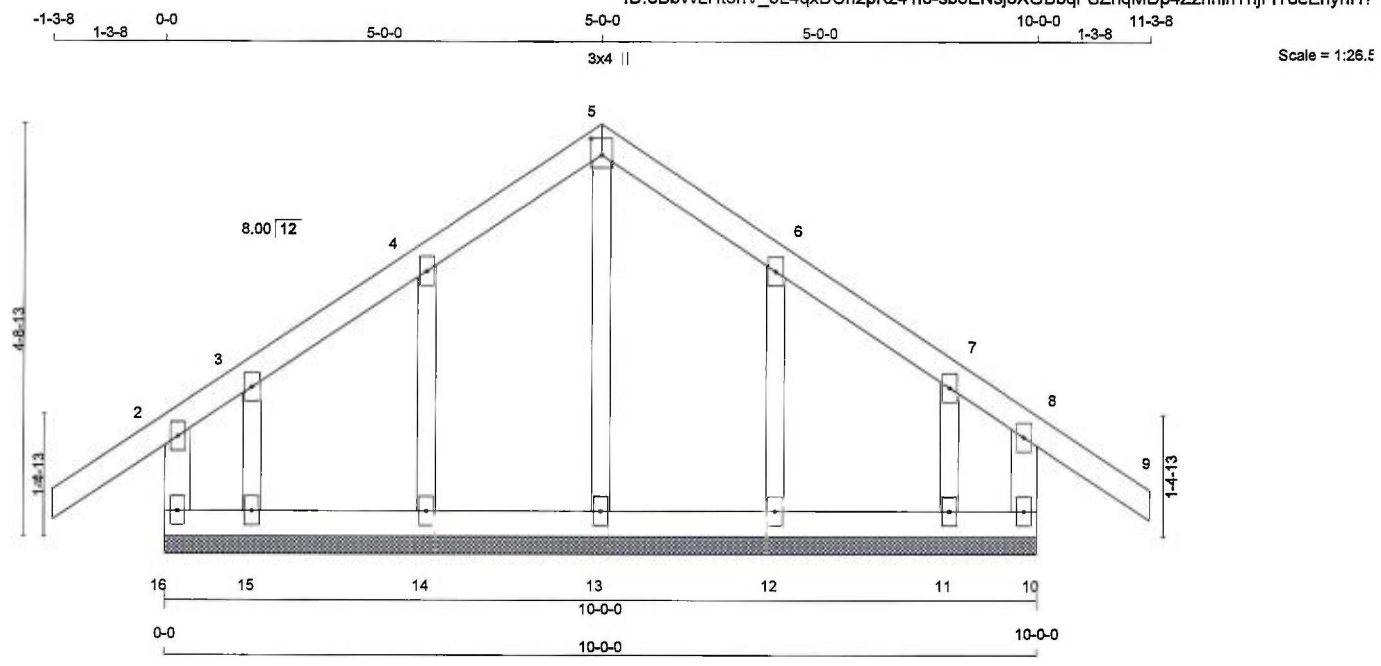

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. SPF					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS					DESIGN CRITERIA				
16 - 2	2x4	DRY	No.2	SPF	THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.					SPECIFIED LOADS:				
1 - 5	2x4	DRY	No.2	SPF	THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.					TOP CH. LL = 23.3 PSF				
5 - 9	2x4	DRY	No.2	SPF	BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)					DL = 3.0 PSF				
10 - 8	2x4	DRY	No.2	SPF	BRACING					BOT CH. LL = 0.0 PSF				
16 - 10	2x4	DRY	No.2	SPF	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.					DL = 7.0 PSF				
ALL WEBS	2x3	DRY	No.2	SPF	MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.					TOTAL LOAD = 33.3 PSF				
ALL GABLE WEBS	2x3	DRY	No.2	SPF	ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.					SPACING = 24.0 IN. C/C				
DRY: SEASONED LUMBER.					LOADING					THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010				
GABLE STUDS SPACED AT 2-0-0 OC.					TOTAL LOAD CASES: (4)					THIS DESIGN COMPLIES WITH:				
					CHORDS					- PART 9 OF OBC 2012, BCBC 2012, ABC 2014				
					MEMB. MAX. FACTORED FORCE (LBS) VERT. LOAD LC1 (PLF) MAX. UNBRACED LENGTH (FT)					- CSA 086-09				
					FR-TO 16-2 -165 / 0 0.0 0.0 0.04 (1) 7.81					- TPIC 2011				
					1-2 0 / 29 -77.4 -77.4 0.10 (1) 10.00					DESIGN ASSUMPTIONS				
					2-3 0 / 5 -77.4 -77.4 0.06 (1) 10.00					- OVERHANG NOT TO BE ALTERED OR CUT OFF.				
					3-4 0 / 34 -77.4 -77.4 0.05 (1) 10.00					(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD				
					4-5 0 / 33 -77.4 -77.4 0.05 (1) 10.00					CSI: TC=0.10/1.00 (8-9:1), BC=0.01/1.00 (13-14:4)				
					5-6 0 / 33 -77.4 -77.4 0.05 (1) 10.00					, WB=0.06/1.00 (5-13:1), SSI=0.07/1.00 (8-9:1)				
					6-7 0 / 34 -77.4 -77.4 0.05 (1) 10.00					DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10				
					7-8 0 / 5 -77.4 -77.4 0.06 (1) 10.00					COMP=1.10 SHEAR=1.10 TENS= 1.10				
					8-9 0 / 29 -77.4 -77.4 0.10 (1) 10.00					COMPANION LIVE LOAD FACTOR = 0.50				
					10-8 -165 / 0 0.0 0.0 0.04 (1) 7.81					TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.				
					16-15 -21 / 0 -17.5 -17.5 0.01 (4) 6.25					NAIL VALUES				
					15-14 -24 / 0 -17.5 -17.5 0.01 (4) 6.25					PLATE GRIP(DRY) SHEAR SECTION				
					14-13 -29 / 0 -17.5 -17.5 0.01 (4) 6.25					(PSI) (PLI) (PLI)				
					13-12 -29 / 0 -17.5 -17.5 0.01 (4) 6.25					MAX MIN MAX MIN MAX MIN				
					12-11 -24 / 0 -17.5 -17.5 0.01 (4) 6.25					MT20 618 354 1667 822 2284 1656				
					11-10 -21 / 0 -17.5 -17.5 0.01 (4) 6.25					PLATE PLACEMENT TOL. = 0.250 inches				
										PLATE ROTATION TOL. = 5.0 Deg.				
										JSI GRIP= 0.13 (5) (INPUT = 0.90)				
										JSI METAL= 0.06 (5) (INPUT = 1.00)				

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



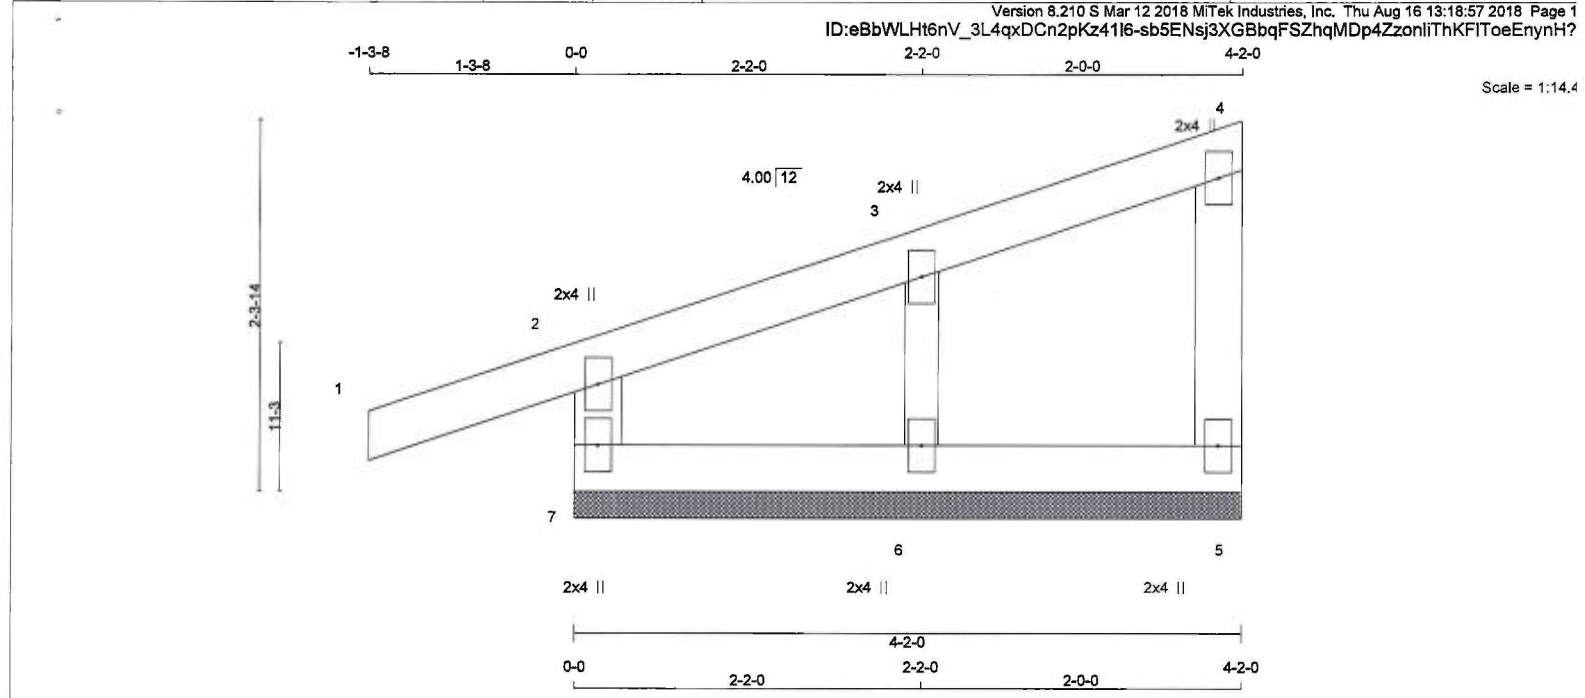

TOTAL WEIGHT = 2 X 15 = 30 LB [M]

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS	SIZE	DRY	No.2
7 - 2	2x4	DRY	No.2
1 - 4	2x4	DRY	No.2
5 - 4	2x4	DRY	No.2
7 - 5	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0-0 OC.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
2	TMV+p	MT20	2.0	4.0	
3	TMW+w	MT20	2.0	4.0	
4	TMV+p	MT20	2.0	4.0	
5	BMV1+p	MT20	2.0	4.0	
6	BMV1+w	MT20	2.0	4.0	
7	BMV1+p	MT20	2.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	UNBRAC LENGTH FR-TO	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO			
7-2	-190 / 0	0.0	0.0 0.01 (4)	7.81	6-3	-167 / 0	0.02 (1)
1-2	0 / 16	-77.4	-77.4 0.10 (1)	10.00			
2-3	-17 / 0	-77.4	-77.4 0.04 (1)	6.25			
3-4	-13 / 0	-77.4	-77.4 0.04 (1)	6.25			
5-4	-68 / 0	0.0	0.0 0.02 (1)	7.81			
7-6	0 / 16	-17.5	-17.5 0.02 (4)	10.00			
6-5	0 / 10	-17.5	-17.5 0.02 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.10/1.00 (1-2:1) , BC=0.02/1.00 (6-7:4) , WB=0.02/1.00 (3-6:1) , SSI=0.08/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX MIN	MAX MIN	MAX MIN		
MT20	618 354	1667 822	2284 1656		

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.10 (2) (INPUT = 0.90)
JSI METAL= 0.04 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



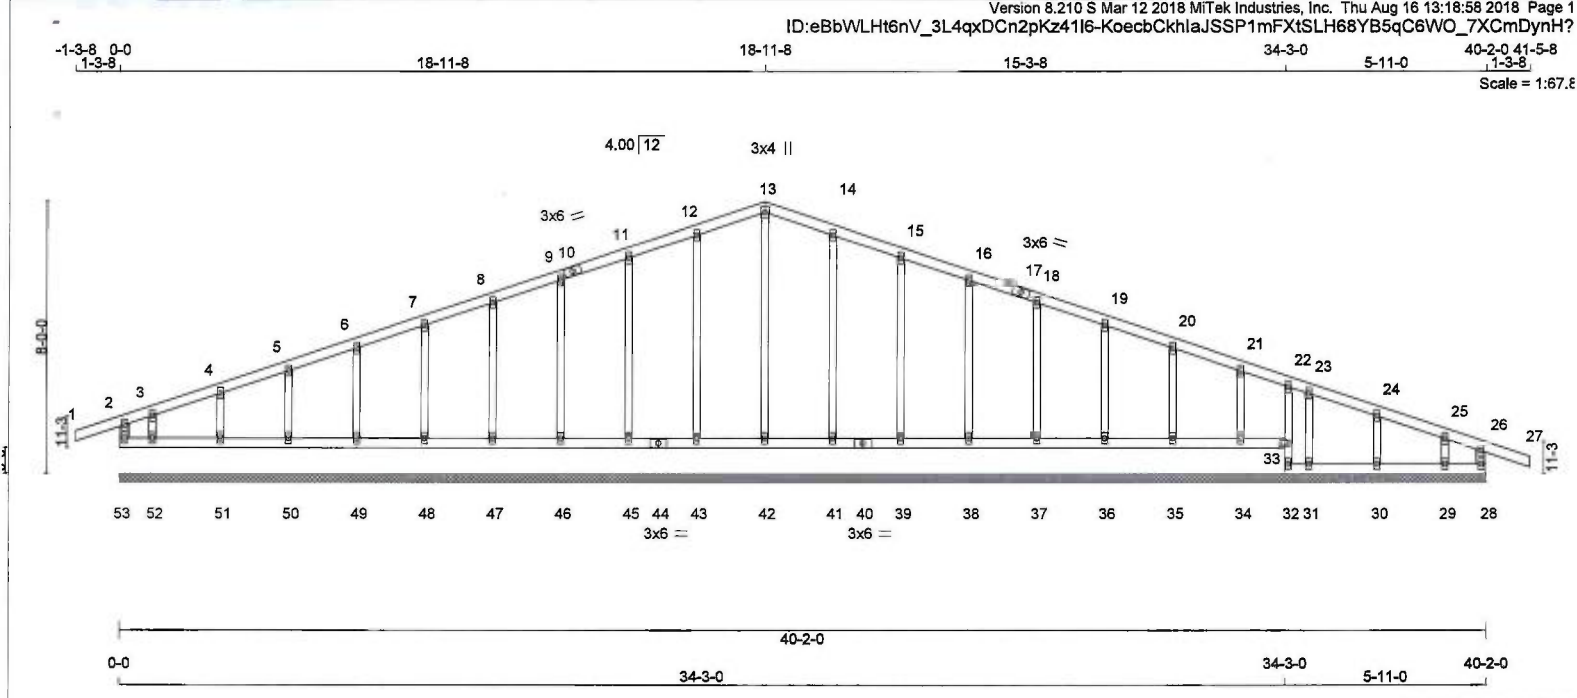

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. 53- 2 2x4 DRY No.2 SPF 1 - 10 2x4 DRY No.2 SPF 10- 13 2x4 DRY No.2 SPF 13- 17 2x4 DRY No.2 SPF 17- 27 2x4 DRY No.2 SPF 28- 26 2x4 DRY No.2 SPF 53- 44 2x4 DRY No.2 SPF 44- 40 2x4 DRY No.2 SPF 40- 33 2x4 DRY No.2 SPF 32- 22 2x3 DRY No.2 SPF 32- 28 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF ALL GABLE WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER. GABLE STUDS SPACED AT 2'-0" OC.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS. THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE. BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): 53, 42, 43, 45, 46, 47, 48, 49, 50, 51, 52, 41, 39, 38, 37, 36, 35, 34 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 DESIGN ASSUMPTIONS - OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD CSI: TC=0.10/1.00 (26-27:1), BC=0.03/1.00 (28-29:1), WB=0.16/1.00 (13-42:1), SSI=0.08/1.00 (26-27:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.82 (13) (INPUT = 0.90) JSI METAL= 0.07 (13) (INPUT = 1.00)			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X 2, 22, 26 2 TMV+p MT20 2.0 4.0 3, 4, 5, 6, 7, 8, 9, 11, 12, 14, 15, 16, 18, 19, 20, 21, 23, 24, 25 3 TMW+w MT20 2.0 4.0 10 TS-t MT20 3.0 6.0 13 TTW+p MT20 3.0 4.0 17 TS-t MT20 3.0 6.0 28, 32, 53 28 BMV1+p MT20 2.0 4.0 29, 30, 31, 34, 35, 36, 37, 38, 39, 41, 42, 43, 45, 46, 47, 48, 49, 50, 51, 52 29 BMW1+w MT20 2.0 4.0 33 BVW-I MT20 2.0 4.0 40 BS-t MT20 3.0 6.0 44 BS-t MT20 3.0 6.0				LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED FORCE VERT. LOAD LC1 MAX FACTORED (LBS) (PLF) CSI (LC) WEBS MAX. MEMB. MAX. FACTORED FORCE MAX (LBS) CSI (LC) UNBRACED LENGTH FR-TO FR-TO 53-2 -185 / 0 0.0 0.0 0.03 (1) 7.81 42-13 -169 / 0 0.16 (1) 1-2 0 / 16 -77.4 -77.4 0.10 (1) 10.00 43-12 -157 / 0 0.11 (1) 2-3 -17 / 0 -77.4 -77.4 0.07 (1) 6.25 45-11 -154 / 0 0.08 (1) 3-4 0 / 3 -77.4 -77.4 0.04 (1) 10.00 46-9 -154 / 0 0.06 (1) 4-5 0 / 4 -77.4 -77.4 0.04 (1) 10.00 47-8 -154 / 0 0.05 (1) 5-6 0 / 8 -77.4 -77.4 0.04 (1) 10.00 48-7 -154 / 0 0.04 (1) 6-7 0 / 11 -77.4 -77.4 0.04 (1) 10.00 49-6 -154 / 0 0.03 (1) 7-8 0 / 13 -77.4 -77.4 0.04 (1) 10.00 50-5 -151 / 0 0.02 (1) 8-9 0 / 15 -77.4 -77.4 0.04 (1) 10.00 51-4 -164 / 0 0.02 (1) 9-10 0 / 16 -77.4 -77.4 0.04 (1) 6.25 52-3 -58 / 0 0.01 (1) 10-11 0 / 16 -77.4 -77.4 0.04 (1) 6.25 41-14 -157 / 0 0.11 (1) 11-12 0 / 18 -77.4 -77.4 0.04 (1) 10.00 39-15 -154 / 0 0.08 (1) 12-13 0 / 18 -77.4 -77.4 0.04 (1) 10.00 38-16 -154 / 0 0.06 (1) 13-14 0 / 18 -77.4 -77.4 0.04 (1) 10.00 37-18 -154 / 0 0.05 (1) 14-15 0 / 18 -77.4 -77.4 0.04 (1) 10.00 36-19 -153 / 0 0.04 (1) 15-16 0 / 16 -77.4 -77.4 0.04 (1) 10.00 35-20 -158 / 0 0.03 (1) 16-17 0 / 15 -77.4 -77.4 0.04 (1) 6.25 34-21 -135 / 0 0.02 (1) 17-18 0 / 15 -77.4 -77.4 0.04 (1) 6.25 31-23 -109 / 0 0.02 (1) 18-19 0 / 13 -77.4 -77.4 0.04 (1) 10.00 30-24 -171 / 0 0.03 (1) 19-20 0 / 10 -77.4 -77.4 0.04 (1) 10.00 29-25 -75 / 0 0.01 (1) 20-21 0 / 9 -77.4 -77.4 0.04 (1) 10.00 21-22 0 / 8 -77.4 -77.4 0.03 (1) 10.00 22-23 0 / 2 -77.4 -77.4 0.02 (1) 10.00 23-24 0 / 3 -77.4 -77.4 0.04 (1) 10.00 24-25 0 / 4 -77.4 -77.4 0.04 (1) 10.00 25-26 -14 / 0 -77.4 -77.4 0.07 (1) 6.25 26-27 0 / 16 -77.4 -77.4 0.10 (1) 10.00 28-26 -185 / 0 0.0 0.0 0.03 (1) 7.81 53-52 0 / 3 -17.5 -17.5 0.03 (1) 10.00 52-51 0 / 0 -17.5 -17.5 0.01 (4) 10.00 51-50 -5 / 0 -17.5 -17.5 0.01 (4) 10.00 50-49 -8 / 0 -17.5 -17.5 0.01 (4) 10.00 49-48 -10 / 0 -17.5 -17.5 0.01 (4) 6.25 48-47 -12 / 0 -17.5 -17.5 0.01 (4) 6.25 47-46 -14 / 0 -17.5 -17.5 0.01 (4) 6.25 46-45 -15 / 0 -17.5 -17.5 0.01 (4) 6.25 45-44 -16 / 0 -17.5 -17.5 0.01 (4) 6.25 44-43 -16 / 0 -17.5 -17.5 0.01 (4) 6.25 43-42 -18 / 0 -17.5 -17.5 0.01 (4) 6.25 42-41 -18 / 0 -17.5 -17.5 0.01 (4) 6.25 41-40 -16 / 0 -17.5 -17.5 0.01 (4) 6.25 40-39 -16 / 0 -17.5 -17.5 0.01 (4) 6.25 39-38 -15 / 0 -17.5 -17.5 0.01 (4) 6.25 38-37 -14 / 0 -17.5 -17.5 0.01 (4) 6.25 37-36 -12 / 0 -17.5 -17.5 0.01 (4) 6.25							

LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI

PROVINCIAL ENGINEER

Aug 16, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

CONTINUED ON PAGE 2

KOTT

LICENSED PROFESSIONAL ENGINEER
N.A. EL-MASRI
Aug 16, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



LOADING


TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
36-35	-10 / 0	-17.5 -17.5	0.01 (4)	6.25			
35-34	-8 / 0	-17.5 -17.5	0.01 (4)	10.00			
34-33	-5 / 0	-17.5 -17.5	0.01 (4)	10.00			
32-33	-67 / 0	0.0 0.0	0.01 (1)	7.81			
33-22	-54 / 0	0.0 0.0	0.01 (1)	7.81			
32-31	-7 / 0	-17.5 -17.5	0.01 (4)	10.00			
31-30	-5 / 0	-17.5 -17.5	0.02 (4)	10.00			
30-29	0 / 0	-17.5 -17.5	0.02 (4)	10.00			
29-28	0 / 3	-17.5 -17.5	0.03 (1)	10.00			

READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



Scale = 1:23.4

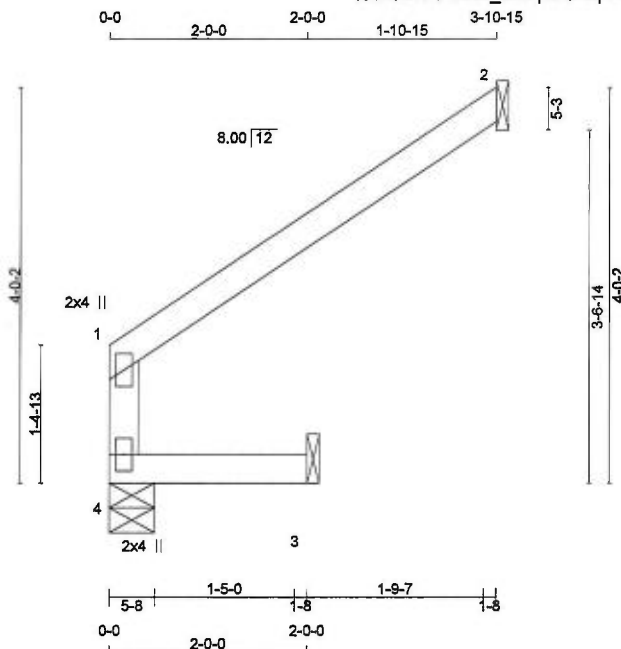

TOTAL WEIGHT = 9 lb [M]F

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
4 - 1	2x4	DRY	No.2	SPF
1 - 2	2x4	DRY	No.2	SPF
4 - 3	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
1	TMV+p	MT20	2.0	4.0		
4	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
4	152	0	152	0	0	5-8	5-8
2	134	0	134	0	0	1-8	1-8
3	52	0	52	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 2, 3

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
4	106	81 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
2	91	80 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0
3	37	21 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 4

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	FR-TO
4-1	-169 / 0	0.0	0.0 0.08 (1)	7.81			
1-2	-10 / 0	-77.4	-77.4 0.15 (1)	10.00			
4-3	0 / 0	-17.5	-17.5 0.09 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 23.3	PSF
	DL = 3.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.15/1.00 (1-2:1), BC=0.09/1.00 (3-4:1),
WB=0.00/1.00 (n/a:0), SSI=0.11/1.00 (1-2:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (1) (INPUT = 0.90)
JSI METAL= 0.04 (1) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu Aug 16 13:18:59 2018 Page 1
ID:eBbWLHt6nV 3L4qxDCn2pKz416-o C oXIK3tRl3ZbypFOhuVfJBbR xbAXCnHllfynH?

Scale = 1:16.5

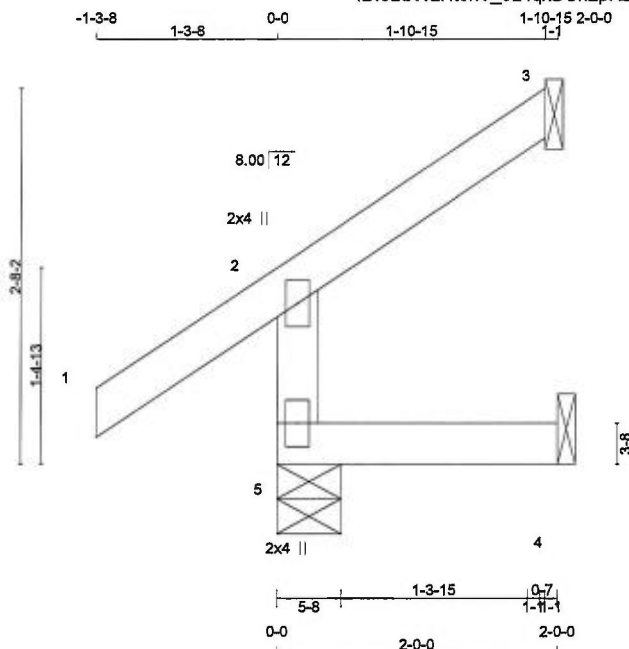

TOTAL WEIGHT = 8 lb

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
5 - 2	2x4	DRY No.2	SPF
1 - 3	2x4	DRY No.2	SPF
5 - 4	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACT

JT	GROSS REACTION		GROSS REACTION			BRG	BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
5	235	0	235	0	0	5-8	5-8
3	43	0	43	0	-21	1-8	1-8
4	10	0	18	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

PROVIDE ANCHORAGE AT BEARING JOINT 3 FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
5	162	131/0	0/0	0/0	0/0	31/0	0/0
3	30	25/-16	0/0	0/0	0/0	4/0	0/0
4	9	0/-7	0/0	0/0	0/0	13/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5, 3

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)


CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
5-2	-211 / 0	0.0	0.0	0.03 (5)	7.81		
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00		
2-3	-17 / 0	-77.4	-77.4	0.08 (1)	6.25		
5-4	0 / 0	-17.5	-17.5	0.03 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



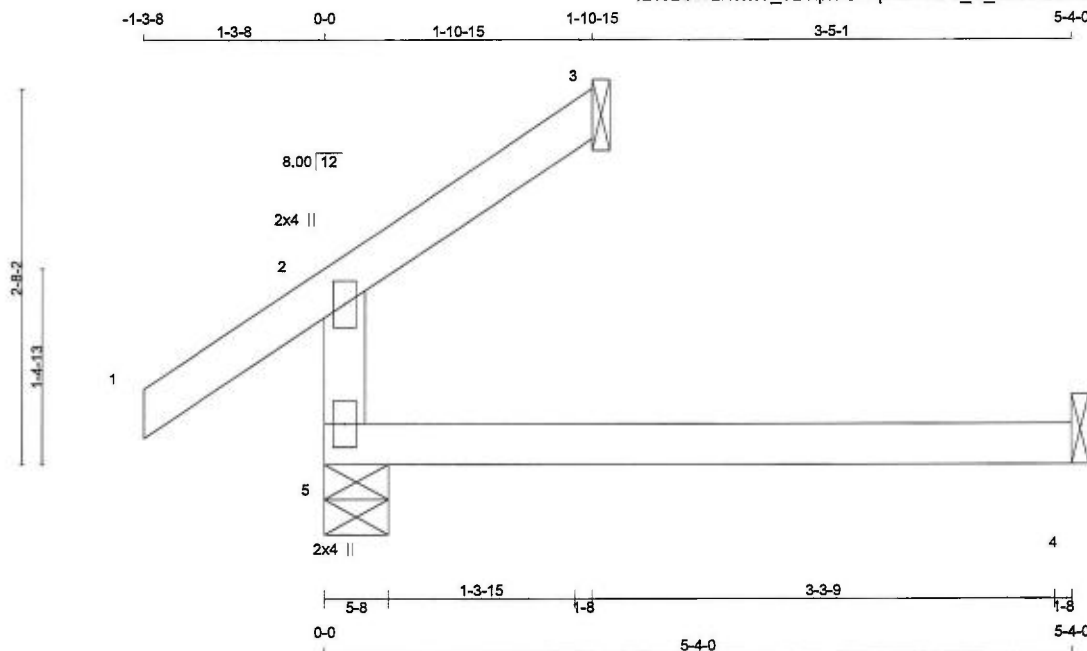

TOTAL WEIGHT = 12 lb [M]

LUMBER

N. L. G. A. RULES					
CHORDS		SIZE		LUMBER	DESCR.
5	- 2	2x4	DRY	No.2	SPF
1	- 3	2x4	DRY	No.2	SPF
5	- 4	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
5	252	252	5-8	5-8
3	56	56	1-8	1-8
4	39	46	1-8	1-8

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
5	176	130 / 0	0 / 0	0 / 0	0 / 0	0 / 0	46 / 0	0 / 0
3	40	24 / 0	0 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0
4	32	0 / -1	0 / 0	0 / 0	0 / 0	0 / 0	33 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5, 3

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)	WEBS	MAX. FACTORED FORCE (LBS)	FACTORED MAX (LC)
FR-TO			FROM	TO	LENGTH	FR-TO	
5-2	-198 / 0	0.0	0.0	0.07 (4)	7.81		
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00		
2-3	-10 / 8	-77.4	-77.4	0.06 (4)	10.00		
5-4	0 / 0	-17.5	-17.5	0.11 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	23.3	PSF
	DL	=	3.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.0	PSF
TOTAL LOAD	=	33.3	PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.10/1.00 (1-2:1), BC=0.11/1.00 (4-5:4), WB=0.00/1.00 (n/a:0), SSI=0.07/1.00 (4-5:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (2) (INPUT = 0.90)
JSI METAL= 0.05 (2) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



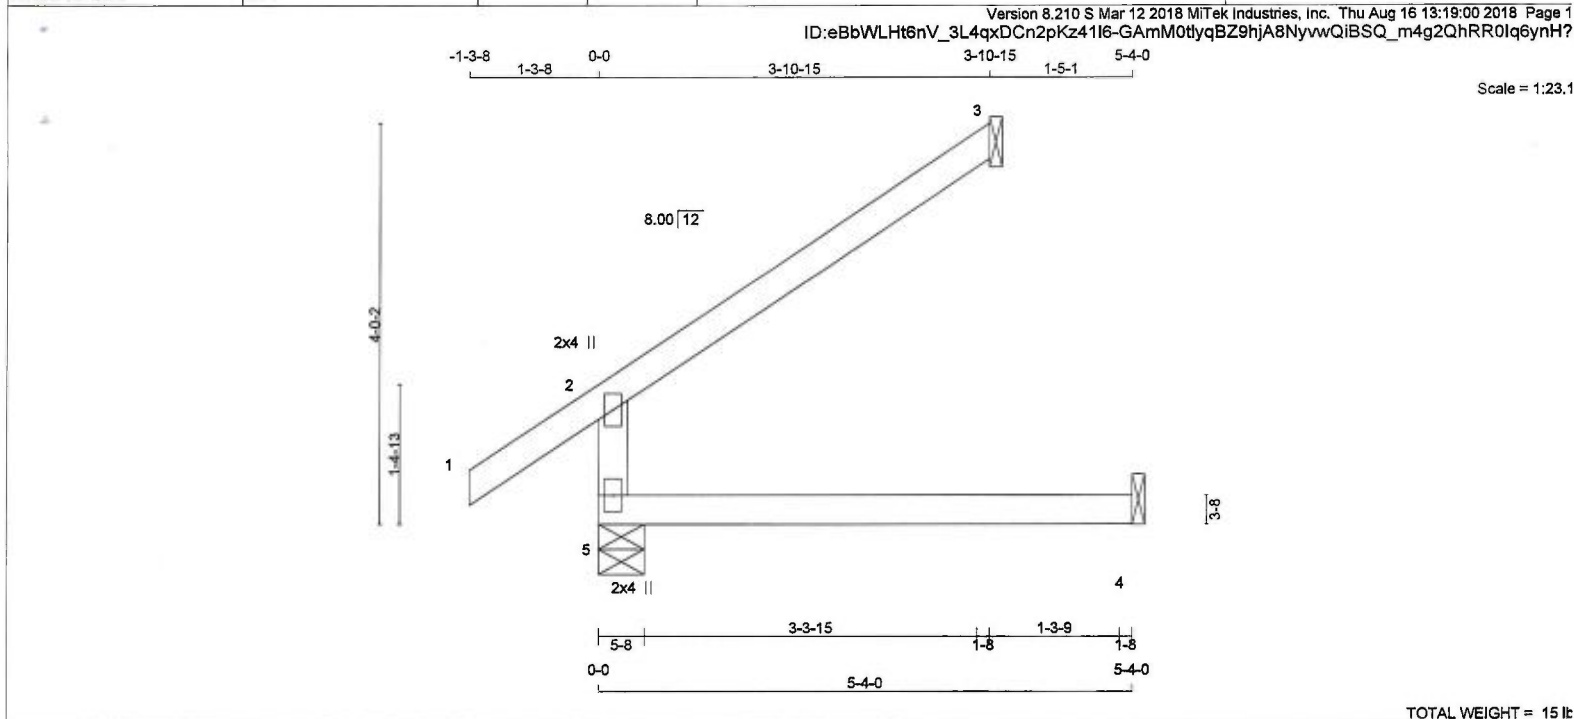

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER 5 - 2 2x4 DRY No.2 1 - 3 2x4 DRY No.2 5 - 4 2x4 DRY No.2 DRY: SEASONED LUMBER.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(TL)= L/360 (0.19") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02") CSI: TC=0.20/1.00 (2-3:1), BC=0.10/1.00 (4-5:4), WB=0.00/1.00 (n/a:0), SSI=0.12/1.00 (2-3:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.19 (2) (INPUT = 0.90) JSI METAL= 0.07 (2) (INPUT = 1.00)				BEARINGS FACTORED GROSS REACTION JT VERT HORZ DOWN HORZ UPLIFT IN-SX BRG IN-SX 5 349 0 349 0 0 5-8 5-8 3 114 0 114 0 0 1-8 1-8 4 39 0 44 0 0 1-8 1-8 SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3 , 4 UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL 5 244 178 / 0 0 / 0 0 / 0 66 / 0 0 / 0 3 77 68 / 0 0 / 0 0 / 0 9 / 0 0 / 0 4 32 0 / 0 0 / 0 0 / 0 32 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5, 3 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) C H O R D S W E B S MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX MAX. MEMB. FORCE MAX (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO 5-2 -295 / 0 0.0 0.0 0.09 (4) 7.81 1-2 0 / 29 -77.4 -77.4 0.10 (1) 10.00 2-3 -21 / 0 -77.4 -77.4 0.20 (1) 6.25 5-4 0 / 0 -17.5 -17.5 0.10 (4) 10.00				TOTAL WEIGHT = 15 lb [M]			
---	--	--	--	--	--	--	--	---	--	--	--	-----------------------------	--	--	--

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

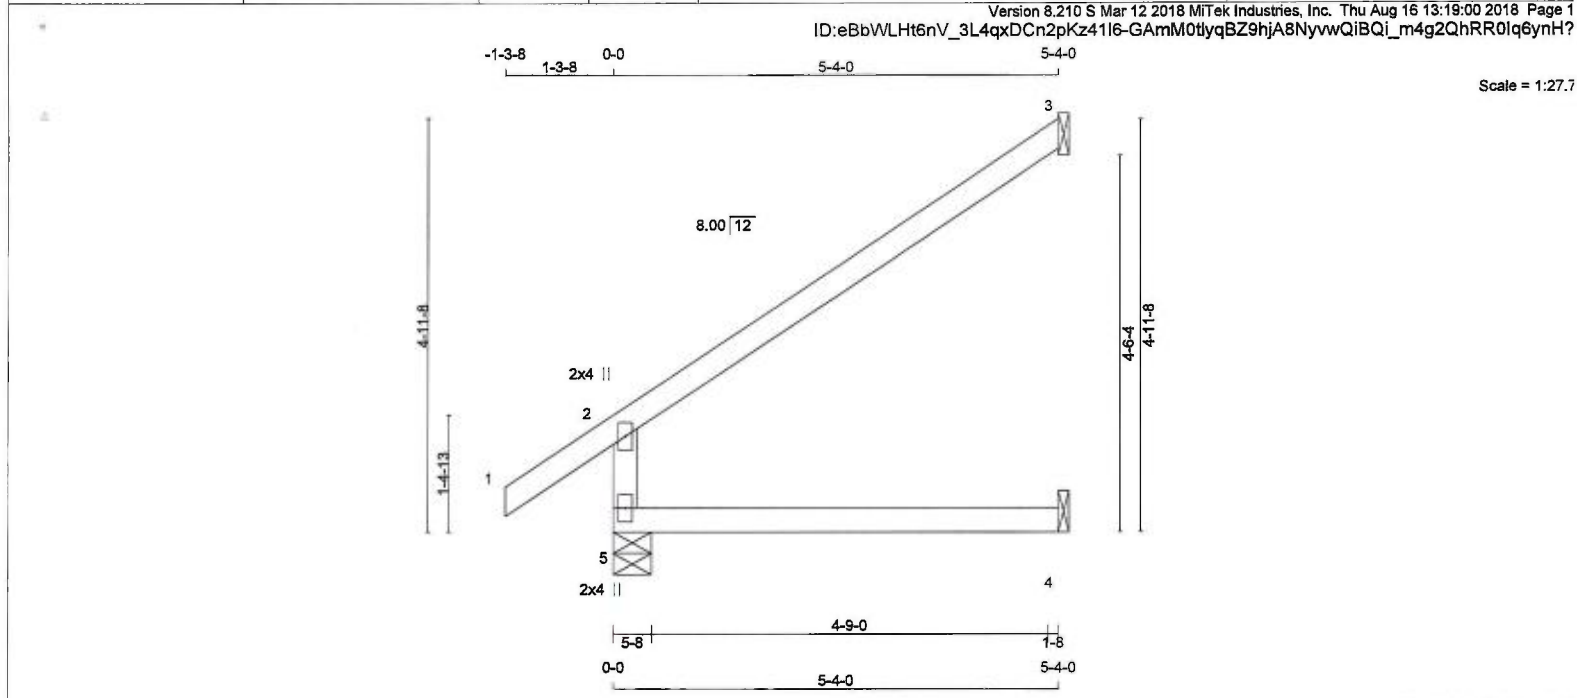

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
5 - 2	2x4	DRY	No.2
1 - 3	2x4	DRY	No.2
5 - 4	2x4	DRY	No.2

DESCR. SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
5	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
5	418	418	0	0
3	155	155	0	0
4	39	44	0	0

SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3, 4

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS
5	291	219 / 0
3	105	93 / 0
4	32	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)
5-2	-364 / 0	0.0	0.09 (4)	5-2	-364 / 0	0.0	0.09 (4)
1-2	0 / 29	-77.4	-77.4 0.10 (1)	1-2	0 / 29	-77.4	-77.4 0.10 (1)
2-3	-29 / 0	-77.4	-77.4 0.37 (1)	2-3	-29 / 0	-77.4	-77.4 0.37 (1)
5-4	0 / 0	-17.5	-17.5 0.10 (4)	5-4	0 / 0	-17.5	-17.5 0.10 (4)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.37/1.00 (2-3:1) , BC=0.10/1.00 (4-5:4) , WB=0.00/1.00 (n/a:0) , SSI=0.17/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (2) (INPUT = 0.90)
JSI METAL= 0.09 (2) (INPUT = 1.00)




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



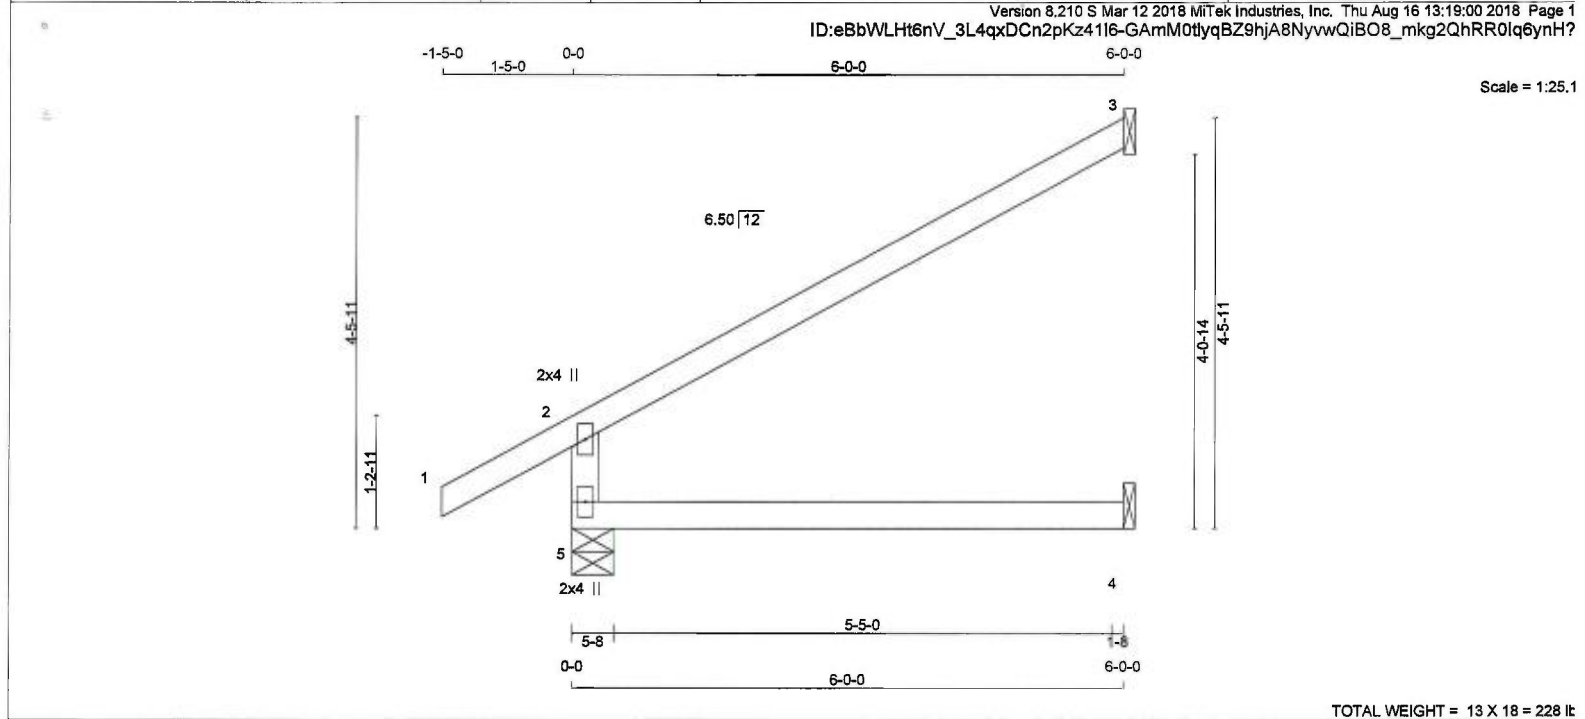

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER 5 - 2 2x4 DRY No.2 1 - 3 2x4 DRY No.2 5 - 4 2x4 DRY No.2 DRY: SEASONED LUMBER.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.20") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00") ALLOWABLE DEFL.(TL)= L/360 (0.20") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.03") CSI: TC=0.47/1.00 (2-3:1), BC=0.13/1.00 (4-5:4), WB=0.00/1.00 (n/a:0), SSI=0.20/1.00 (2-3:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (P.S.I) (P.LI) (P.LI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.24 (2) (INPUT = 0.90) JSI METAL= 0.09 (2) (INPUT = 1.00)				PLATES (table is in inches) JT TYPE PLATES W LEN Y X 2 TMV+p MT20 2.0 4.0 5 BMV1+p MT20 2.0 4.0				BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT BRG REQD BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX 5 467 0 467 0 0 5-8 5-8 3 174 0 174 0 0 1-8 1-8 4 43 0 49 0 0 1-8 1-8 SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 3 , 4 UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL 5 324 244 / 0 0 / 0 0 / 0 81 / 0 0 / 0 3 118 105 / 0 0 / 0 0 / 0 14 / 0 0 / 0 4 35 0 / 0 0 / 0 0 / 0 0 / 0 35 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 5 BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) C H O R D S W E B S MAX. FACTORED MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX MEMB. FORCE MAX (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO 5-2 -405 / 0 0.0 0.0 0.13 (4) 7.81 1-2 0 / 27 -77.4 -77.4 0.12 (1) 10.00 2-3 -28 / 0 -77.4 -77.4 0.47 (1) 6.25 5-4 0 / 0 -17.5 -17.5 0.13 (4) 10.00				READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.			
---	--	--	--	---	--	--	--	---	--	--	--	---	--	--	--	--	--	--	--



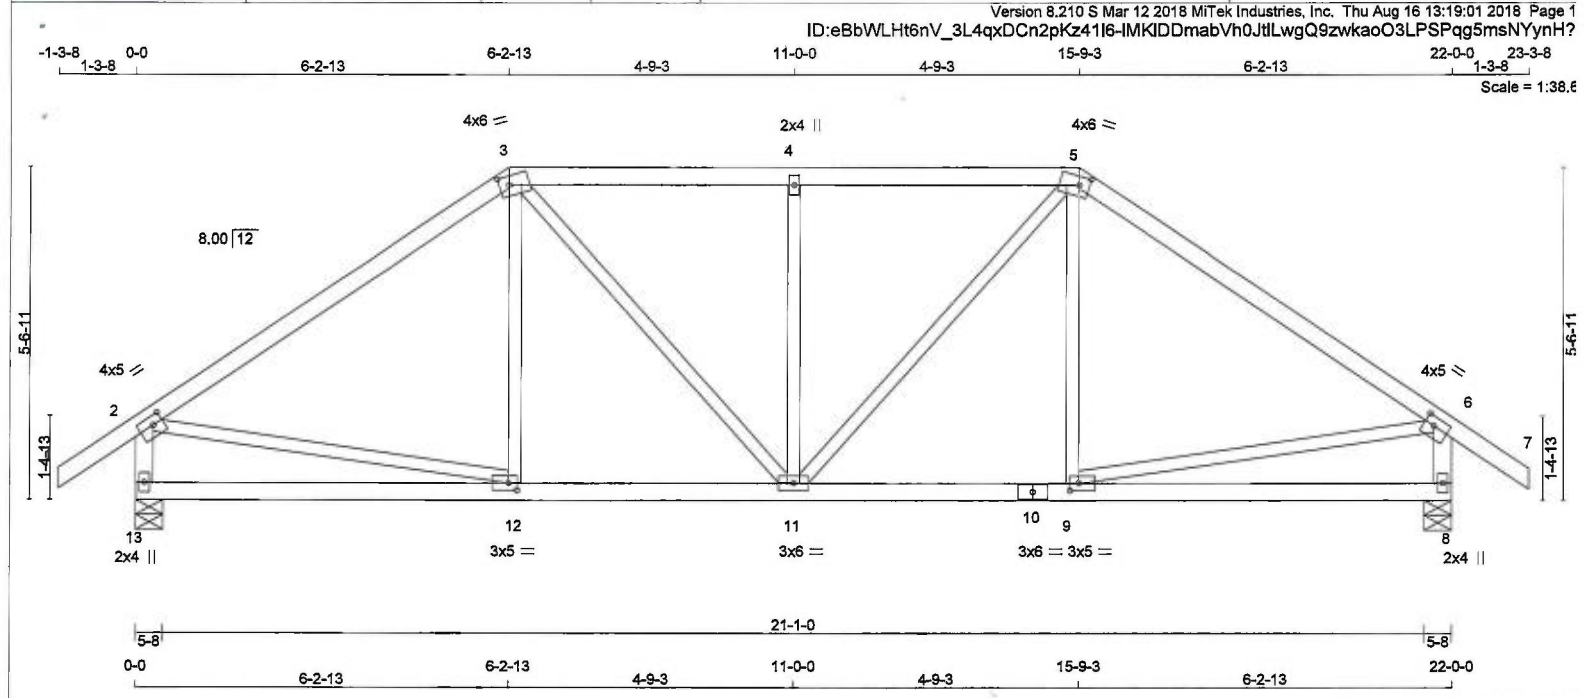

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2
3 - 5	2x4	DRY	No.2
5 - 7	2x4	DRY	No.2
13 - 2	2x4	DRY	No.2
8 - 6	2x4	DRY	No.2
13 - 10	2x4	DRY	No.2
10 - 8	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	4.0	5.0	1.75	2.00
3	TTWW-m	MT20	4.0	6.0	1.75	2.00
4	TMW-t	MT20	2.0	4.0		
5	TTWW-m	MT20	4.0	6.0	1.75	2.00
6	TMVW-t	MT20	4.0	5.0	1.75	2.00
8	BMV1+p	MT20	2.0	4.0		
9	BMWW-t	MT20	3.0	5.0	1.50	1.75
10	BS-t	MT20	3.0	6.0		
11	BMWWW-t	MT20	3.0	6.0		
12	BMWW-t	MT20	3.0	5.0	1.50	1.75
13	BMV1+p	MT20	2.0	4.0		



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	REQRD
13	1150	0	1150	0	0	5-8	5-8	
8	1150	0	1150	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
13	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0
8	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 13, 8

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC) (1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC) (1)	
FR-TO		FROM	TO	FR-TO		FROM	TO
1-2	0 / 29	-77.4	-77.4	10.00	12-3	-35 / 85	0.03 (4)
2-3	-1085 / 0	-77.4	-77.4	0.42 (1)	5.54	3-11	0 / 342
3-4	-1131 / 0	-77.4	-77.4	0.23 (1)	5.71	11-4	-449 / 0
4-5	-1131 / 0	-77.4	-77.4	0.23 (1)	5.71	11-5	0 / 342
5-6	-1085 / 0	-77.4	-77.4	0.42 (1)	5.54	9-5	-35 / 85
6-7	0 / 29	-77.4	-77.4	0.10 (1)	10.00	2-12	0 / 915
13-2	-1104 / 0	0.0	0.0	0.11 (1)	7.54	9-6	0 / 915
8-6	-1104 / 0	0.0	0.0	0.11 (1)	7.54		
13-12	0 / 0	-17.5	-17.5	0.15 (4)	10.00		
12-11	0 / 901	-17.5	-17.5	0.23 (1)	10.00		
11-10	0 / 901	-17.5	-17.5	0.23 (1)	10.00		
10-9	0 / 901	-17.5	-17.5	0.23 (1)	10.00		
9-8	0 / 0	-17.5	-17.5	0.15 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.42/1.00 (5-6:1), BC=0.23/1.00 (9-11:1), WB=0.21/1.00 (4-11:1), SSI=0.18/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (12) (INPUT = 0.90)
JSI METAL= 0.38 (2) (INPUT = 1.00)



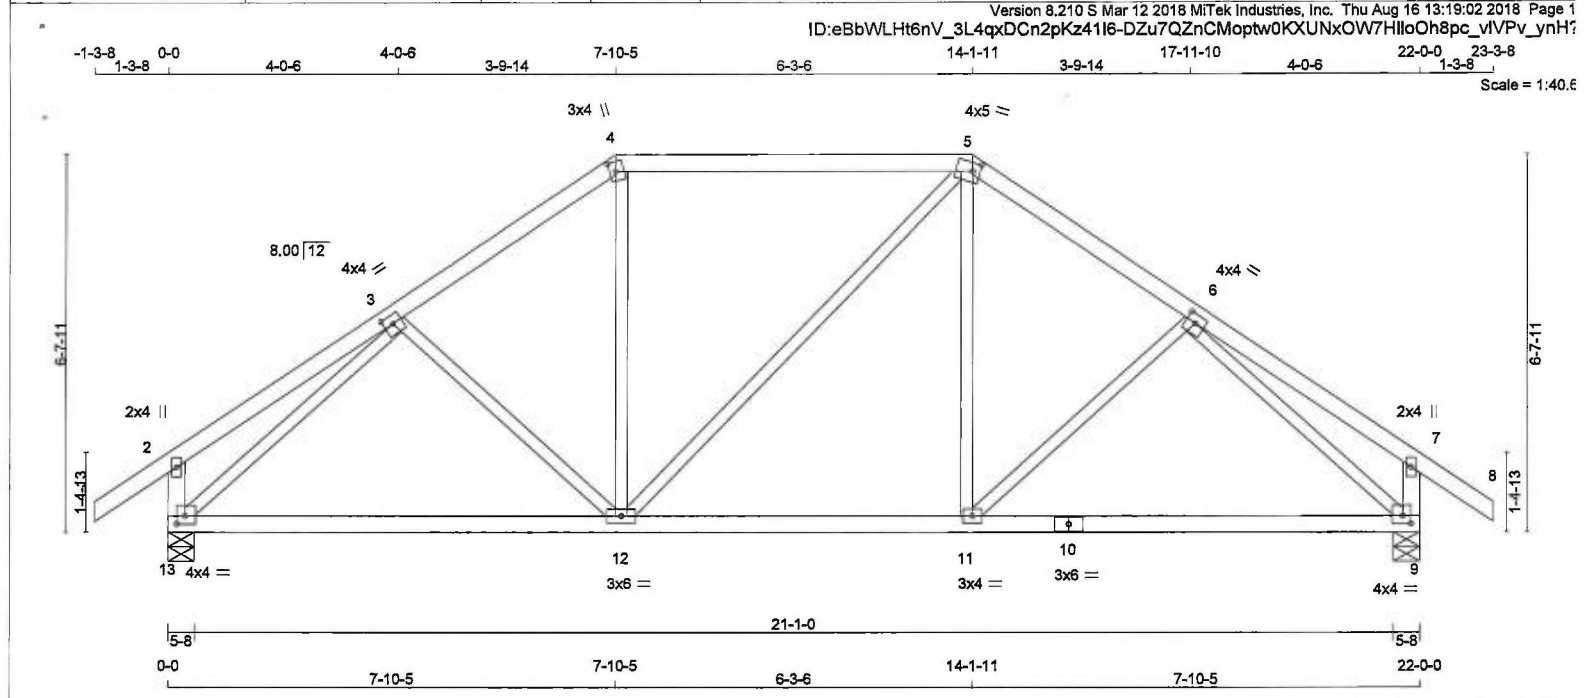

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 4	2x4	DRY	No.2
4 - 5	2x4	DRY	No.2
5 - 8	2x4	DRY	No.2
13 - 2	2x4	DRY	No.2
9 - 7	2x4	DRY	No.2
13 - 10	2x4	DRY	No.2
10 - 9	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
3	TMVW-t	MT20	4.0	4.0	1.75	2.00
4	TTW+m	MT20	3.0	4.0	2.00	1.25
5	TTWW-m	MT20	4.0	5.0	1.75	1.50
6	TMVW-t	MT20	4.0	4.0	1.75	2.00
7	TMV+p	MT20	2.0	4.0		
9	BMVW1-t	MT20	4.0	4.0	1.75	1.75
10	BS-t	MT20	3.0	6.0		
11	BMVW-t	MT20	3.0	4.0		
12	BMVW-t	MT20	3.0	6.0		
13	BMVW1-t	MT20	4.0	4.0	1.75	1.75



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	REQRD
13	1150	0	1150	0	0	5-8	5-8
9	1150	0	1150	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
13	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0
9	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 13, 9

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.01 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	
FR-TO		FROM TO		FR-TO			
1-2	0 / 29	-77.4 -77.4	0.10 (1)	3-12	-104 / 23	0.05 (1)	
2-3	0 / 19	-77.4 -77.4	0.19 (1)	10-0	12-4	0 / 204	0.05 (4)
3-4	-1035 / 0	-77.4 -77.4	0.15 (1)	6-01	12-5	0 / 0	0.00 (1)
4-5	-847 / 0	-77.4 -77.4	0.40 (1)	6-07	11-5	0 / 204	0.05 (4)
5-6	-1034 / 0	-77.4 -77.4	0.15 (1)	6-01	11-6	-104 / 23	0.05 (1)
6-7	0 / 19	-77.4 -77.4	0.19 (1)	10-0	13-3	-1265 / 0	0.60 (1)
7-8	0 / 29	-77.4 -77.4	0.10 (1)	10-0	6-9	-1265 / 0	0.60 (1)
13-2	-224 / 0	0.0	0.02 (1)	7.81			
9-7	-224 / 0	0.0	0.02 (1)	7.81			
13-12	0 / 921	-17.5 -17.5	0.29 (4)	10.00			
12-11	0 / 847	-17.5 -17.5	0.28 (4)	10.00			
11-10	0 / 920	-17.5 -17.5	0.29 (4)	10.00			
10-9	0 / 920	-17.5 -17.5	0.29 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.40/1.00 (4-5:1), BC=0.29/1.00 (9-11:4), WB=0.60/1.00 (3-13:1), SSI=0.19/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX MIN
MT20	618	354	1667 822 2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (3) (INPUT = 0.90)
JSI METAL= 0.46 (3) (INPUT = 1.00)



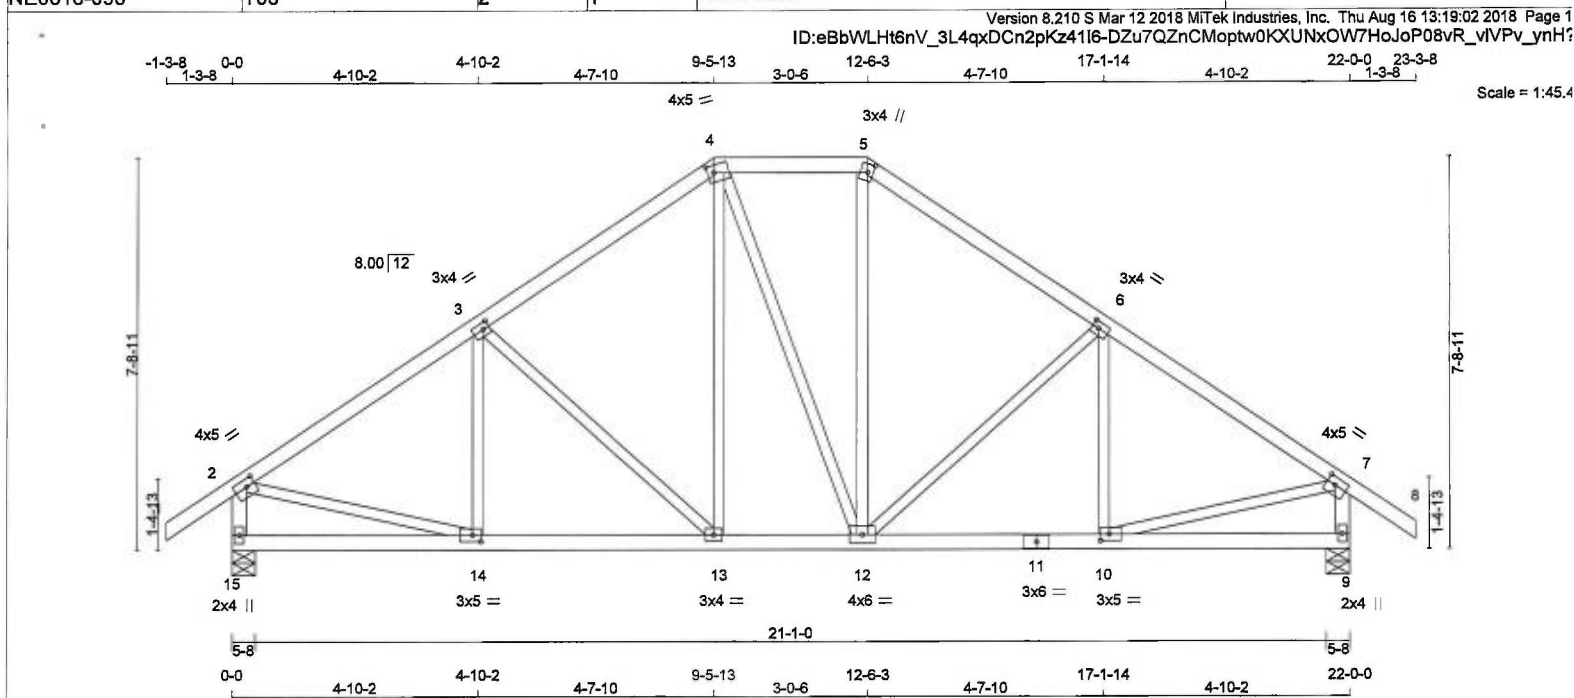

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										DESIGN CRITERIA			
N. L. G. A. RULES					CHORDS					DESCR.					SPECIFIED LOADS:			
SIZE					LUMBER					BEARINGS					TOP CH. LL = 23.3 PSF			
1 - 4					2x4 DRY No.2					SPF					DL = 3.0 PSF			
4 - 5					2x4 DRY No.2					SPF					BOT CH. LL = 0.0 PSF			
5 - 8					2x4 DRY No.2					SPF					DL = 7.0 PSF			
15- 2					2x4 DRY No.2					SPF					TOTAL LOAD = 33.3 PSF			
9 - 7					2x4 DRY No.2					SPF								
15- 11					2x4 DRY No.2					SPF								
11- 9					2x4 DRY No.2					SPF								
ALL WEBS EXCEPT					2x3 DRY No.2					SPF					SPACING = 24.0 IN. C/C			
DRY: SEASONED LUMBER.															LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM			
PLATES (table is in inches)															THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010			
JT TYPE PLATES W L E N Y X															THIS DESIGN COMPLIES WITH:			
1 TMVW-t MT20 4.0 5.0 1.75 2.00															- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014			
2 TMWW-t MT20 3.0 4.0 1.50 1.50															- CSA 086-09			
3 TTWW-m MT20 4.0 5.0 1.75 1.50															- TPIC 2011			
5 TTW+m MT20 3.0 4.0 2.00 1.25															(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD			
6 TMWW-t MT20 3.0 4.0 1.50 1.50															ALLOWABLE DEFL.(LL)= L/360 (0.73")			
7 TMVW-t MT20 4.0 5.0 1.75 2.00															CALCULATED VERT. DEFL.(LL)= L/ 999 (0.03")			
9 BMV1+p MT20 2.0 4.0															ALLOWABLE DEFL.(TL)= L/360 (0.73")			
10 BMWW-t MT20 3.0 5.0 1.50 2.00															CALCULATED VERT. DEFL.(TL)= L/ 999 (0.06")			
11 BS-t MT20 3.0 6.0															CSI: TC=0.24/1.00 (2-3:1) , BC=0.20/1.00 (13-14:1) , WB=0.22/1.00 (2-14:1) , SSI=0.15/1.00 (2-3:1)			
12 BMWWW-t MT20 4.0 6.0															DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10			
13 BMWW-t MT20 3.0 4.0															COMP=1.10 SHEAR=1.10 TENS= 1.10			
14 BMWW-t MT20 3.0 5.0 1.50 2.00															COMPANION LIVE LOAD FACTOR = 0.50			
15 BMV1+p MT20 2.0 4.0															TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .			
															NAIL VALUES			
															PLATE GRIP(DRY) SHEAR SECTION			


LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI

Aug 16, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

KOTT

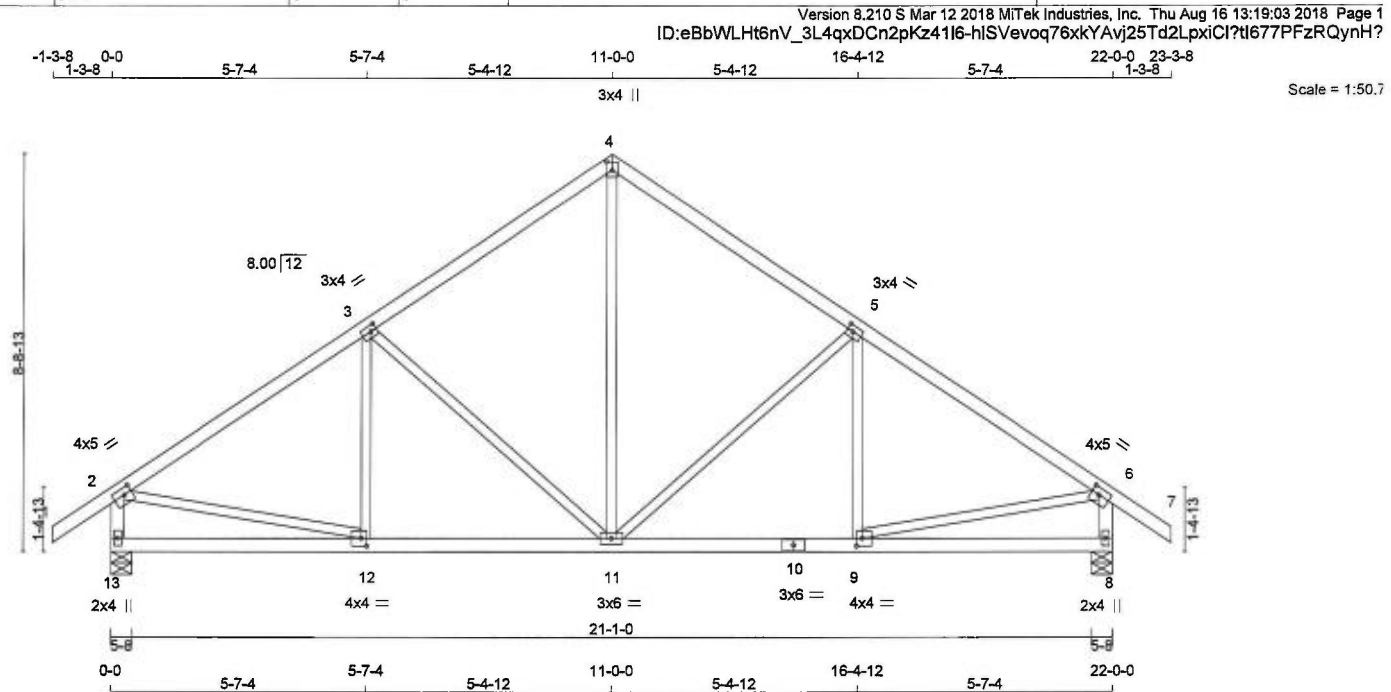

TOTAL WEIGHT = $4 \times 95 = 381$ lb

LUMBER		N. L. G. A. RULES			
CHORDS	SIZE		LUMBER		DESCR.
1 - 4	2x4	DRY	No.2		SPF
4 - 7	2x4	DRY	No.2		SPF
13- 2	2x4	DRY	No.2		SPF
8 - 6	2x4	DRY	No.2		SPF
13- 10	2x4	DRY	No.2		SPF
10- 8	2x4	DRY	No.2		SPF

ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
--------------------	-----	-----	------	-----

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMVVW-t	MT20	4.0	5.0	1.75	2.00
3	TMVVW-t	MT20	3.0	4.0	1.50	1.50
4	TTVW+p	MT20	3.0	4.0	2.25	1.50
5	TMVVW-t	MT20	3.0	4.0	1.50	1.50
6	TMVVW-t	MT20	4.0	5.0	1.75	2.00
8	BMV1+p	MT20	2.0	4.0		
9	BMVVW-t	MT20	4.0	4.0	2.00	1.50
10	BS-t	MT20	3.0	6.0		
11	BMVVWW-t	MT20	3.0	6.0		
12	BMVVW-t	MT20	4.0	4.0	2.00	1.50
13	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
13	1150	0	1150	0	0	5-8	5-8
8	1150	0	1150	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
13	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0
8	804	576 / 0	0 / 0	0 / 0	0 / 0	228 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 13. 8

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.57 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00	11-4	0 / 602	0.14 (1)
2-3	-1141 / 0	-77.4	-77.4	0.33 (1)	5.57	11-5	-384 / 0	0.39 (1)
3-4	-854 / 0	-77.4	-77.4	0.31 (1)	6.22	9-5	-82 / 67	0.03 (1)
4-5	-854 / 0	-77.4	-77.4	0.31 (1)	6.22	3-11	-384 / 0	0.39 (1)
5-6	-1141 / 0	-77.4	-77.4	0.33 (1)	5.57	12-3	-82 / 67	0.03 (1)
6-7	0 / 29	-77.4	-77.4	0.10 (1)	10.00	2-12	0 / 991	0.22 (1)
13-2	-1109 / 0	0.0	0.0	0.11 (1)	7.52	9-6	0 / 991	0.22 (1)
8-6	-1109 / 0	0.0	0.0	0.11 (1)	7.52			
13-12	0 / 0	-17.5	-17.5	0.13 (4)	10.00			
12-11	0 / 973	-17.5	-17.5	0.22 (1)	10.00			
11-10	0 / 973	-17.5	-17.5	0.22 (1)	10.00			
10-9	0 / 973	-17.5	-17.5	0.22 (1)	10.00			
9-8	0 / 0	-17.5	-17.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.06")

CSI: TC=0.33/1.00 (5-6:1), BC=0.22/1.00 (9-11:1),
WB=0.39/1.00 (5-11:1), SSI=0.17/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES						
PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PLI)	(PLI)	(PLI)	(PLI)
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (11) (INPUT = 0.90)
JSI METAL= 0.40 (2) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



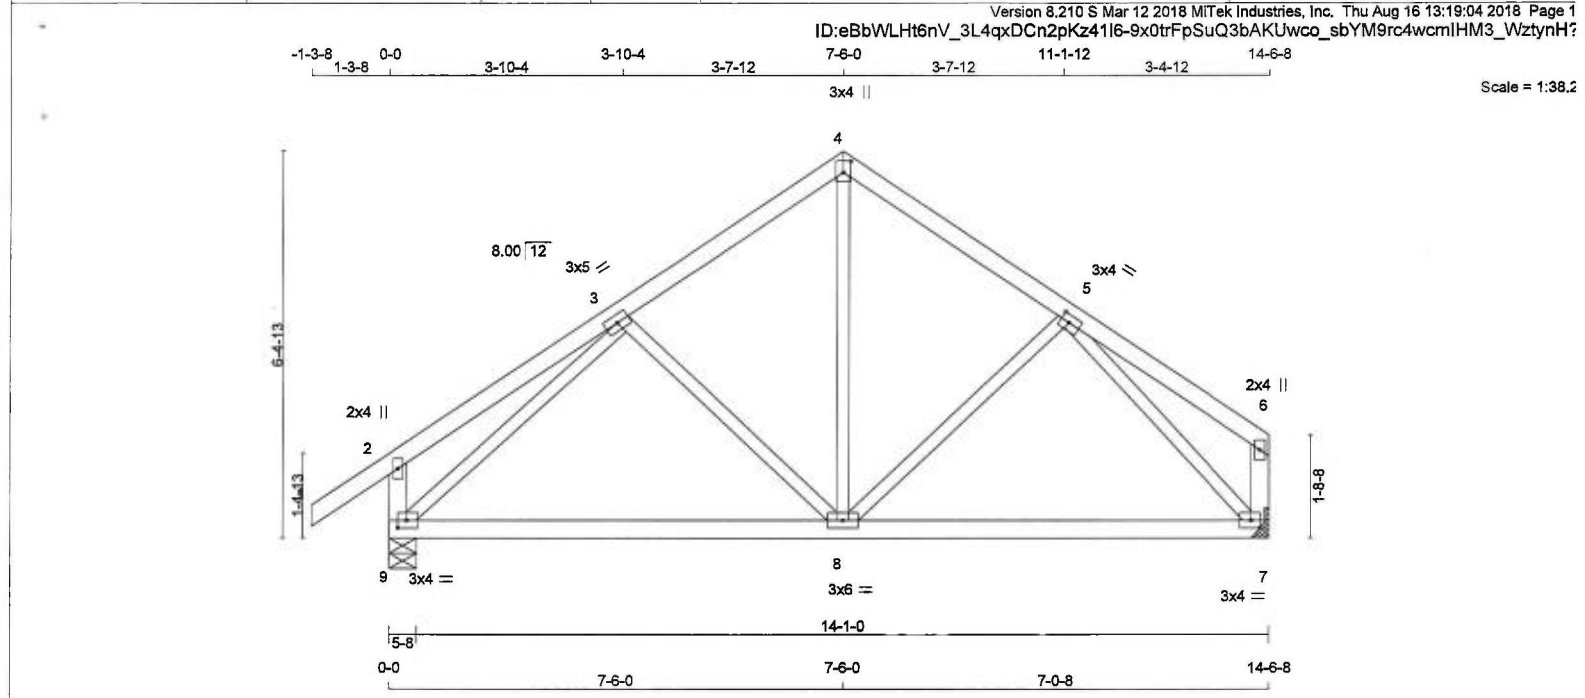

TOTAL WEIGHT = 3 X 61 = 184 lb
[M][F]

LUMBER				DESCR.
N. L. G. A. RULES				
CHORDS	SIZE	LUMBER		
1 - 4	2x4	DRY	No.2	SPF
4 - 6	2x4	DRY	No.2	SPF
9 - 2	2x4	DRY	No.2	SPF
7 - 6	2x4	DRY	No.2	SPF
9 - 7	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMV+p	MT20	2.0	4.0		
3	TMWW-t	MT20	3.0	5.0		
4	TTW+p	MT20	3.0	4.0	2.25	1.50
5	TMWW-t	MT20	3.0	4.0	1.50	1.75
6	TMV+p	MT20	2.0	4.0		
7	BMVW1-t	MT20	3.0	4.0	1.50	1.75
8	BMWW-t	MT20	3.0	6.0		
9	BMVW1-t	MT20	3.0	4.0	1.50	1.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER					
BEARINGS					
	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT IN-SX
9	796	0	796	0	5-8
7	690	0	690	0	5-8 MECHANICAL

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 7 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS							
JT	1ST LCASE COMBINED	MAX/MIN. SNOW	MAX/MIN. LIVE	MAX/MIN. PERM. LIVE	WIND	DEAD	SOIL
9	556	403 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0
7	484	339 / 0	0 / 0	0 / 0	0 / 0	145 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 9

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00	3-8	-168 / 3
2-3	0 / 18	-77.4	-77.4	0.17 (1)	10.00	8-4	0 / 345
3-4	-535 / 0	-77.4	-77.4	0.13 (1)	6.25	8-5	-104 / 17
4-5	-533 / 0	-77.4	-77.4	0.12 (1)	6.25	9-3	-763 / 0
5-6	0 / 19	-77.4	-77.4	0.15 (1)	10.00	5-7	-747 / 0
9-2	-218 / 0	0.0	0.0	0.02 (1)	7.81		
7-6	-94 / 0	0.0	0.0	0.01 (1)	7.81		
9-8	0 / 552	-17.5	-17.5	0.30 (4)	10.00		
8-7	0 / 505	-17.5	-17.5	0.30 (4)	10.00		

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL	=	23.3 PSF
	DL	=	3.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.0 PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.48")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.48")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.17/1.00 (2-3:1) , BC=0.30/1.00 (8-9:4) , WB=0.33/1.00 (3-9:1) , SSI=0.12/1.00 (3-4:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES					
PLATE	GRIP(DRY)	SHEAR	SECTION		
	(PSI)	(PLI)	(PLI)		
	MAX MIN	MAX MIN	MAX MIN		
MT20	618 354	1667 822	2284 1656		

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (9) (INPUT = 0.90)
JSI METAL= 0.26 (5) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.




READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu Aug 16 13:19:04 2018 Page 1

ID:eBbWLHt6nV_3L4qxDCn2pKz41l6-9x0trFpSuQ3bAKUwco_sbYM8fc7icqQHm3_WztnH?

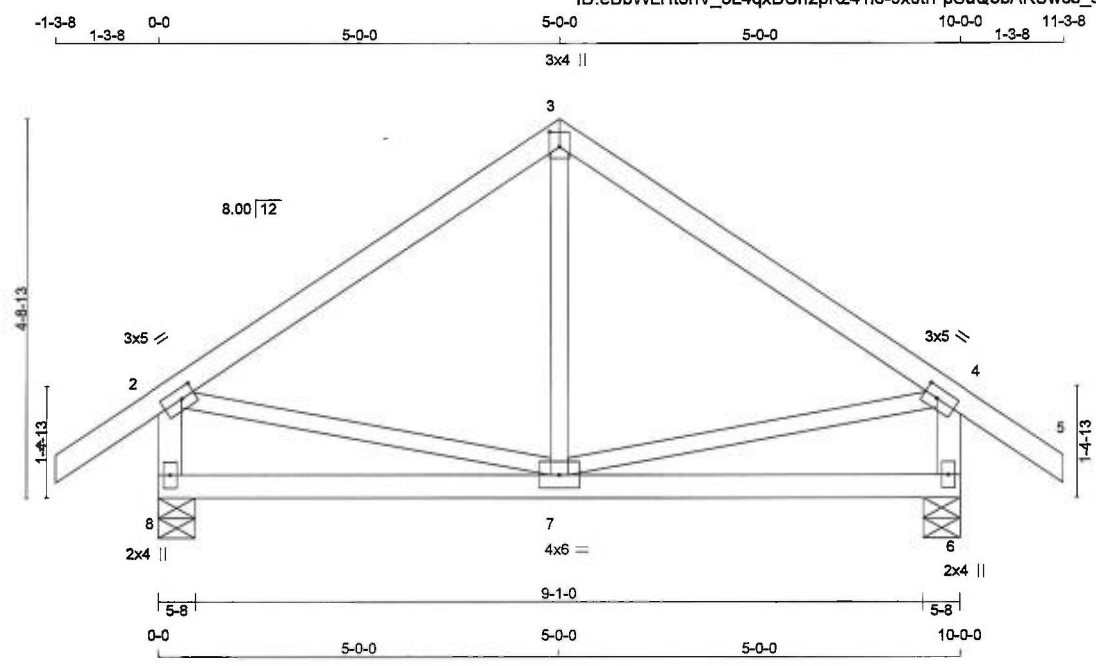

Scale = 1:28.8

TOTAL WEIGHT = 42 lb [M]F

LUMBER
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY No.2	SPF
3 - 5	2x4	DRY No.2	SPF
8 - 2	2x4	DRY No.2	SPF
6 - 4	2x4	DRY No.2	SPF
8 - 6	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	5.0	1.50	2.00
3	TTW+p	MT20	3.0	4.0	2.25	1.50
4	TMVW-t	MT20	3.0	5.0	1.50	2.00
6	BMV1+p	MT20	2.0	4.0		
7	BMVWW-t	MT20	4.0	6.0		
8	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
8	580	0	580	0
6	580	0	580	0

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
8	405	297 / 0	0 / 0	0 / 0	0 / 0	0 / 0	108 / 0	0 / 0
6	405	297 / 0	0 / 0	0 / 0	0 / 0	0 / 0	108 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 8, 6

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH FR-TO	
1-2	0 / 29	-77.4	-77.4 0.10 (1)	10.00	7-3	-13 / 82	0.03 (4)		
2-3	-336 / 0	-77.4	-77.4 0.25 (1)	6.25	2-7	0 / 286	0.06 (1)		
3-4	-336 / 0	-77.4	-77.4 0.25 (1)	6.25	7-4	0 / 286	0.06 (1)		
4-5	0 / 29	-77.4	-77.4 0.10 (1)	10.00					
8-2	-547 / 0	0.0	0.0 0.06 (1)	7.81					
6-4	-547 / 0	0.0	0.0 0.06 (1)	7.81					
8-7	0 / 0	-17.5	-17.5 0.12 (4)	10.00					
7-6	0 / 0	-17.5	-17.5 0.12 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.0 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.33")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.33")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.25/1.00 (3-4:1), BC=0.12/1.00 (7-8:4), WB=0.06/1.00 (2-7:1), SSI=0.13/1.00 (3-4:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (4) (INPUT = 0.90)
JSI METAL= 0.15 (2) (INPUT = 1.00)



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



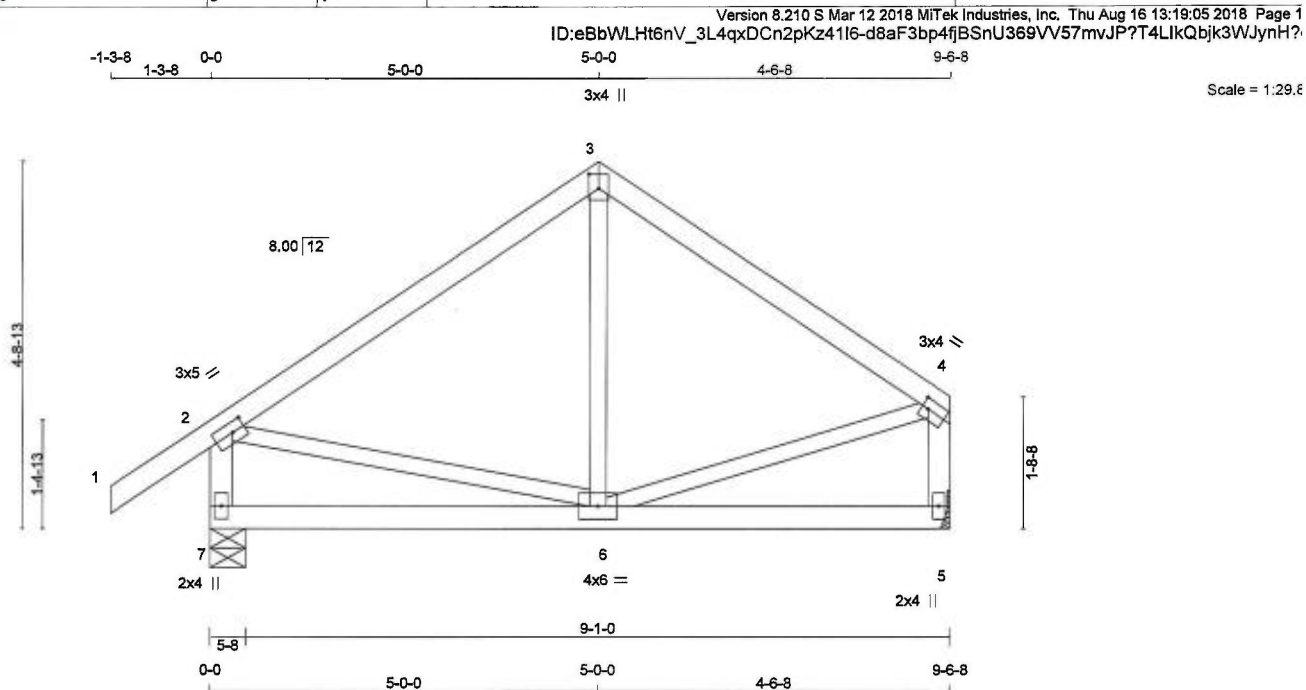

TOTAL WEIGHT = $3 \times 39 = 118 \text{ lb}$

LUMBER				
N. L. G. A. RULES				
CHORDS	SIZE		LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF
3 - 4	2x4	DRY	No.2	SPF
7 - 2	2x4	DRY	No.2	SPF
5 - 4	2x4	DRY	No.2	SPF
7 - 5	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMWV-t	MT20	3.0	5.0	1.50	2.00
3	TTW+p	MT20	3.0	4.0	2.25	1.50
4	TMWV-t	MT20	3.0	4.0	1.50	1.00
5	BMV1+p	MT20	2.0	4.0		
6	BMWWWV-t	MT20	4.0	6.0		
7	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			MAXIMUM FACTORED			INPUT	REQ'D
FACTORED			GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
7	559	0	559	0	0	5-8	5-8
5	453	0	453	0	0	MECHANICAL	

A SUITABLE MECHANICAL CONNECTION IS REQUIRED AT JOINT 5 TO RESIST THE MAX FACTORED REACTIONS.

UNFACTORED REACTIONS

UNFACTORED REACTIONS		MAX./MIN. COMPONENT REACTIONS					
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
7	390	286 / 0	0 / 0	0 / 0	0 / 0	104 / 0	0 / 0
5	318	222 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 7

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)		
FR-TO		FROM TO			FR-TO				
1-2	0 / 29	-77.4	-77.4	0.10 (1)	10.00	6-3	-30 / 72	0.03 (4)	
2-3	-306 / 0	-77.4	-77.4	0.25 (1)	6.25	2-6	0 / 280	0.06 (1)	
3-4	-304 / 0	-77.4	-77.4	0.20 (1)	6.25	6-4	0 / 286	0.06 (1)	
7-2	-522 / 0	0.0	0.0	0.05 (1)	7.81				
5-4	-425 / 0	0.0	0.0	0.05 (1)	7.81				
7-6	0 / 0	-17.5	-17.5	0.12 (4)	10.00				
6-5	0 / 0	-17.5	-17.5	0.12 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD =		33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL(LL)= L/360 (0.32")
CALCULATED VERT. DEFL(LL) = L/ 999 (0.00")
ALLOWABLE DEFL(TL)= L/360 (0.32")
CALCULATED VERT. DEFL(TL) = L/ 999 (0.02")

CSI: TC=0.25/1.00 (2-3:1) , BC=0.12/1.00 (6-7:4) ,
WB=0.06/1.00 (4-6:1) , SSI=0.13/1.00 (2-3:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (4) (INPUT = 0.90)
JSI METAL= 0.15 (4) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



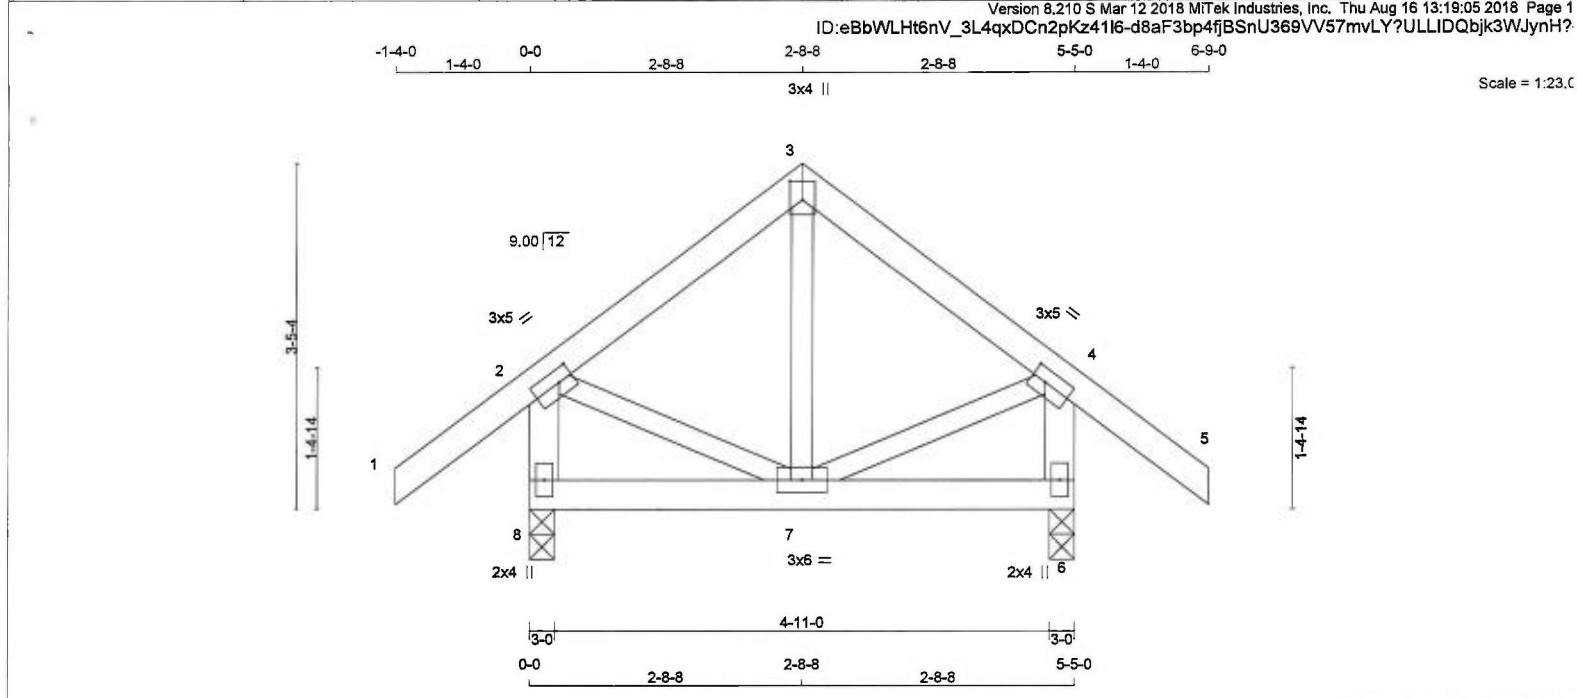

LUMBER										DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER										TOTAL WEIGHT = 2 X 27 = 54 lb [M]									
N. L. G. A. RULES										BEARINGS										DESIGN CRITERIA									
CHORDS SIZE LUMBER DESCR.																				SPECIFIED LOADS:									
1 - 3 2x4 DRY No.2 SPF										FACTORED MAXIMUM FACTORED INPUT REQD										TOP CH. LL = 23.3 PSF									
3 - 5 2x4 DRY No.2 SPF										GROSS REACTION GROSS REACTION BRG BRG										DL = 3.0 PSF									
8 - 2 2x4 DRY No.2 SPF										JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX										BOT CH. LL = 0.0 PSF									
6 - 4 2x4 DRY No.2 SPF										8 367 0 367 0 0 3-0 3-0										DL = 7.0 PSF									
8 - 6 2x4 DRY No.2 SPF										6 367 0 367 0 0 3-0 3-0										TOTAL LOAD = 33.3 PSF									
ALL WEBS 2x3 DRY No.2 SPF										UNFACTORED REACTIONS										SPACING = 24.0 IN. C/C									
EXCEPT										1ST LCASE MAX./MIN. COMPONENT REACTIONS										THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010									
DRY: SEASONED LUMBER.										JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL										THIS DESIGN COMPLIES WITH:									
										8 255 192 / 0 0 / 0 0 / 0 0 / 0 63 / 0 0 / 0										- PART 9 OF OBC 2012, BCBC 2012, ABC 2014									
										6 255 192 / 0 0 / 0 0 / 0 0 / 0 63 / 0 0 / 0										- CSA 086-09									
																				- TPIC 2011									
										BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 8, 6										(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD									
PLATES (table is in inches)										BRACING										ALLOWABLE DEFL.(LL)= L/360 (0.19")									
JT TYPE PLATES W LEN Y X										TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.										CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")									
2 TMVW-t MT20 3.0 5.0 1.50 1.75										MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.										ALLOWABLE DEFL.(TL)= L/360 (0.19")									
3 TTW+p MT20 3.0 4.0 2.25 1.50										ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.										CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00")									
4 TMVW-t MT20 3.0 5.0 1.50 1.75																				CSI: TC=0.11/1.00 (1-2:1), BC=0.03/1.00 (7-8:4), WB=0.03/1.00 (2-7:1), SSI=0.07/1.00 (1-2:1)									
6 BMV1+p MT20 2.0 4.0																				DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10									
7 BMWWW-t MT20 3.0 6.0																				COMP=1.10 SHEAR=1.10 TENS= 1.10									
8 BMV1+p MT20 2.0 4.0																				COMPANION LIVE LOAD FACTOR = 0.50									
										LOADING										TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .									
										TOTAL LOAD CASES: (4)										NAIL VALUES									
										CHORDS										PLATE GRIP(DRY) SHEAR SECTION									
										MEMB. MAX. FACTORED FORCE (LBS)										(PSI) (PLI) (PLI)									
										FACTORED VERT. LOAD (PLF)										MAX MIN MAX MIN MAX MIN									
										LC1 MAX LC										MT20 618 354 1667 822 2284 1656									
										MAX. UNBRAC LENGTH																			
										FR-TO																			
										1-2 0 / 33 -77.4 -77.4 0.11 (1) 10.00 7-3 -36 / 35 0.01 (4)																			
										2-3 -145 / 0 -77.4 -77.4 0.10 (1) 6.25 2-7 0 / 125 0.03 (1)																			
										3-4 -145 / 0 -77.4 -77.4 0.10 (1) 6.25 7-4 0 / 125 0.03 (1)																			
										4-5 0 / 33 -77.4 -77.4 0.11 (1) 10.00																			
										8-2 -348 / 0 0.0 0.0 0.04 (1) 7.81																			
										6-4 -348 / 0 0.0 0.0 0.04 (1) 7.81																			
										8-7 0 / 0 -17.5 -17.5 0.03 (4) 10.00																			
										7-6 0 / 0 -17.5 -17.5 0.03 (4) 10.00																			

LICENSED PROFESSIONAL ENGINEER

N.A. EL-MASRI

N.A. El-Masri

PROVINCE OF ONTARIO

Aug 16, 2018

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.

KOTT

LICENSED PROFESSIONAL ENGINEER

N. A. EL-MASRI


Aug 16, 2018

PROVINCIAL ENGINEER

PROVINCIAL ENGINEER

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



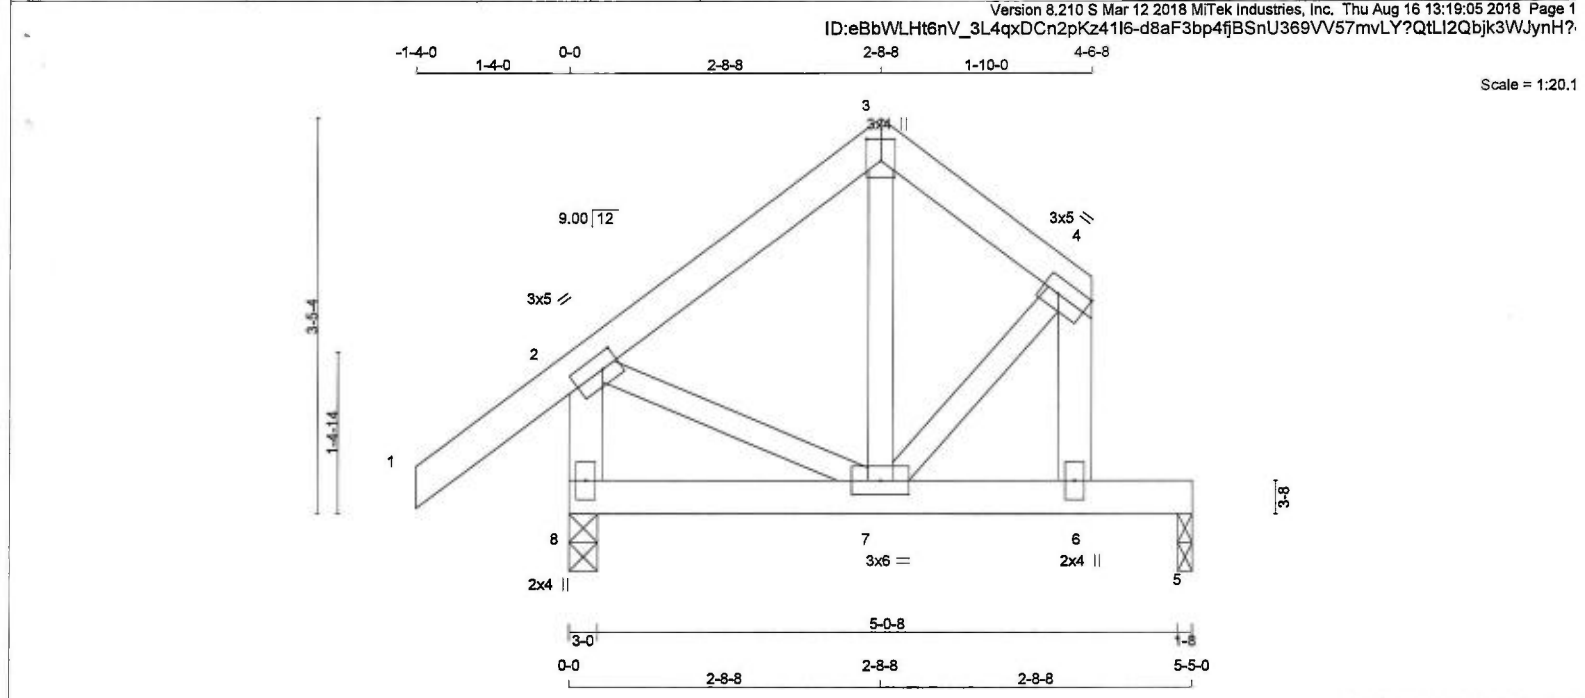

TOTAL WEIGHT = 2 X 24 = 48 lb

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
1 - 3	2x4	DRY	No.2	SPF
3 - 4	2x4	DRY	No.2	SPF
8 - 2	2x4	DRY	No.2	SPF
6 - 4	2x4	DRY	No.2	SPF
8 - 5	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	5.0	1.50	1.75
3	TTW+p	MT20	3.0	4.0	2.25	1.50
4	TMVW-t	MT20	3.0	5.0	1.50	Edge
6	BMV+p	MT20	2.0	4.0		
7	BMVW-t	MT20	3.0	6.0		
8	BMV1+p	MT20	2.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

BUILDING DESIGNER	BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX	IN-SX
8	367	0	367	0	0	3-0	3-0			
5	257	0	257	0	0	1-8	1-8			

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
8	255	192 / 0	0 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0
5	180	126 / 0	0 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 8, 5

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO	FROM	TO	FROM	TO	FR-TO	FR-TO	FROM	TO	FR-TO
1-2	0 / 33	-77.4	-77.4	0.11 (1)	10.00	7-3	0 / 42	0.01 (4)	
2-3	-158 / 0	-77.4	-77.4	0.10 (1)	6.25	2-7	0 / 136	0.03 (1)	
3-4	-158 / 0	-77.4	-77.4	0.04 (1)	6.25	7-4	0 / 174	0.04 (1)	
8-2	-360 / 0	0.0	0.0	0.04 (1)	7.81				
6-4	-285 / 0	0.0	0.0	0.03 (1)	7.81				
8-7	0 / 0	-17.5	-17.5	0.06 (1)	10.00				
7-6	0 / 0	-17.5	-17.5	0.26 (1)	10.00				
6-5	0 / 0	-94.9	-94.9	0.26 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL =	23.3	PSF
DL =	3.0	PSF
BOT CH. LL =	0.0	PSF
DL =	7.0	PSF
TOTAL LOAD =	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:

- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
 - CSA 086-09
 - TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
 ALLOWABLE DEFL.(TL)= L/360 (0.19")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.11/1.00 (1-2:1), BC=0.26/1.00 (6-7:1), WB=0.04/1.00 (4-7:1), SSI=0.20/1.00 (5-6:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	(PLI)	(PLI)
MT20	618	354	1667	822	2284 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.39 (4) (INPUT = 0.90)
 JSI METAL= 0.09 (2) (INPUT = 1.00)

READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



READ ALL NOTES ON THIS PAGE AND ON ENGINEERING NOTE PAGE ENP-1. THIS NOTE PAGE IS AN INTEGRAL PART OF THIS DRAWING AS IT CONTAINS SPECIFICATIONS AND CRITERIA USED IN THE DESIGN OF THIS COMPONENT.



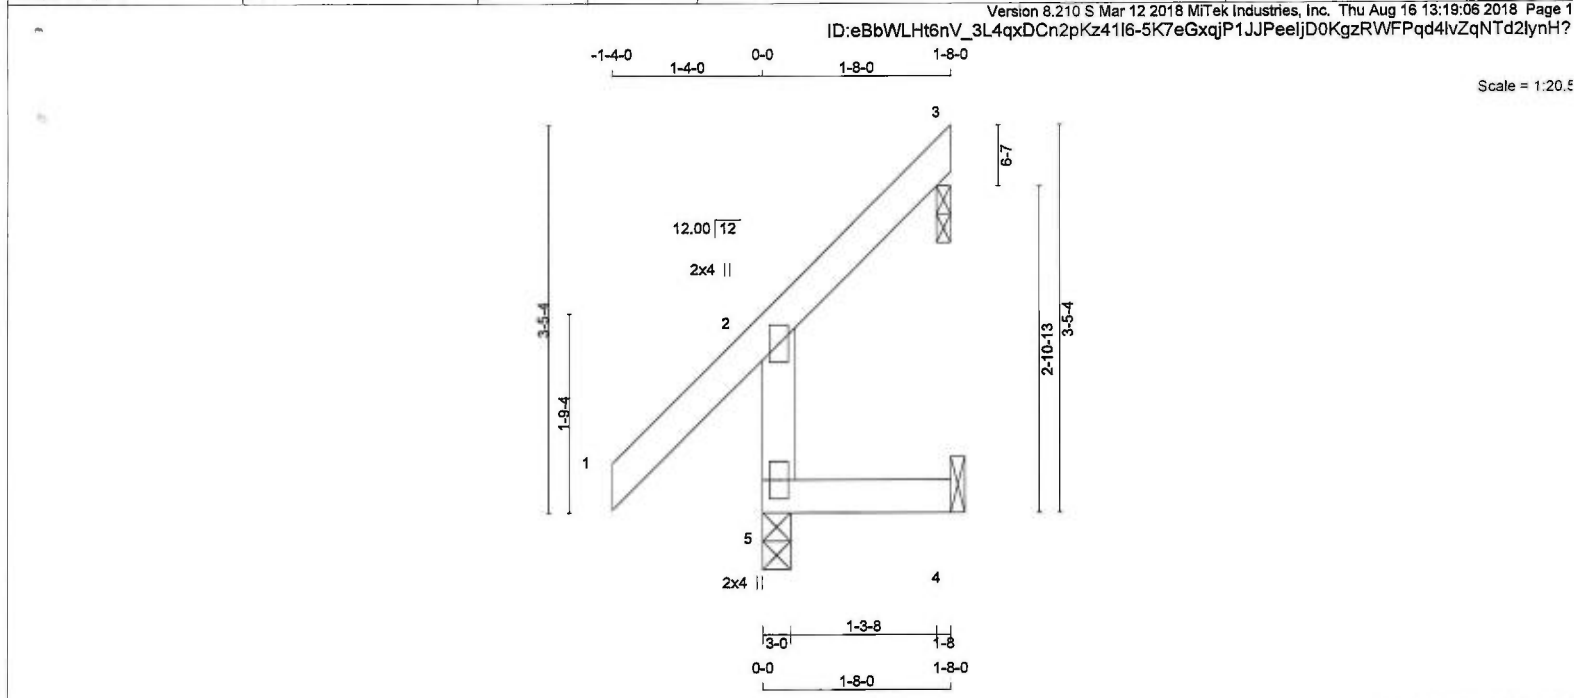


LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER 5 - 2 2x4 DRY No.2 1 - 3 2x4 DRY No.2 5 - 4 2x4 DRY No.2 DRY: SEASONED LUMBER.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 23.3 PSF DL = 3.0 PSF BOT CH. LL = 0.0 PSF DL = 7.0 PSF TOTAL LOAD = 33.3 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010 THIS DESIGN COMPLIES WITH: - PART 9 OF OBC 2012, BCBC 2012, ABC 2014 - CSA 086-09 - TPIC 2011 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.19") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00") ALLOWABLE DEFL.(TL)= L/360 (0.19") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00") CSI: TC=0.11/1.00 (1-2:1) , BC=0.03/1.00 (4-5:5) , WB=0.00/1.00 (n/a:0) , SSI=0.06/1.00 (1-2:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 0.50 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (Psi) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 618 354 1667 822 2284 1656 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.17 (2) (INPUT = 0.90) JSI METAL= 0.06 (2) (INPUT = 1.00)			
PLATES (table is in inches) JT TYPE PLATES W LEN Y X 2 TMV+p MT20 2.0 4.0 5 BMV1+p MT20 2.0 4.0				BEARINGS FACTORED GROSS REACTION MAXIMUM FACTORED GROSS REACTION INPUT BRG REQD BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX 5 238 0 238 0 0 3-0 3-0 3 27 0 27 0 -29 1-8 1-8 4 4 0 14 0 -4 1-8 1-8 BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): 3 SEE MITEK STANDARD DETAIL B37579H FOR CONNECTION TO JOINT(S) 4 PROVIDE ANCHORAGE AT BEARING JOINT 3 FOR 150 LBS. FACTORED UPLIFT PROVIDE ANCHORAGE AT BEARING JOINT 4 FOR 150 LBS. FACTORED UPLIFT			
UNFACTORED REACTIONS 1ST LCASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL 5 164 135 / 0 0 / 0 0 / 0 29 / 0 0 / 0 3 18 16 / -20 0 / 0 0 / 0 0 / 0 3 / 0 0 / 0 4 5 0 / -8 0 / 0 0 / 0 0 / 0 10 / 0 0 / 0				LOADING TOTAL LOAD CASES: (5) CHORDS WEBS MEMB. MAX. FACTORED VERT. LOAD LC1 MAX. FACTORED MEMB. MAX. FACTORED (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO 5-2 -213 / 0 0.0 0.0 0.03 (5) 7.81 1-2 0 / 39 -77.4 -77.4 0.11 (1) 10.00 2-3 -27 / 0 -77.4 -77.4 0.09 (1) 6.25 5-4 0 / 0 -17.5 -17.5 0.03 (5) 10.00			
CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN							



READ ALL NOTES ON THIS PAGE AND ON
 ENGINEERING NOTE PAGE ENP-1. THIS
 NOTE PAGE IS AN INTEGRAL PART OF
 THIS DRAWING AS IT CONTAINS
 SPECIFICATIONS AND CRITERIA USED IN
 THE DESIGN OF THIS COMPONENT.



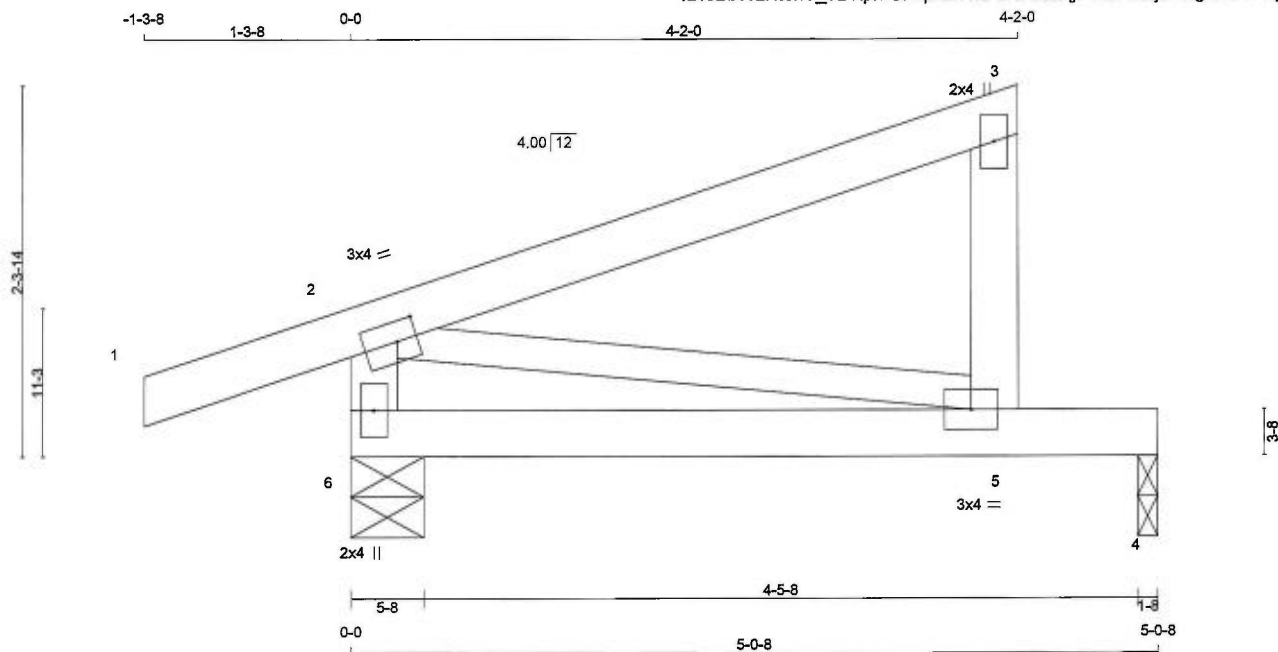

TOTAL WEIGHT = $5 \times 18 = 89 \text{ lb}$

LUMBER				LUMBER	
N. L. G. A.	RULES				
CHORDS	SIZE				DESCR.
1 - 3	2x4	DRY	No.2		SPF
5 - 3	2x4	DRY	No.2		SPF
6 - 2	2x4	DRY	No.2		SPF
6 - 4	2x4	DRY	No.2		SPF
ALL WEBS	2x3	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	4.0	1.50	1.50
3	TMV+p	MT20	2.0	4.0		
5	BMVW-t	MT20	3.0	4.0		
6	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX
6	337	0	337	0	0	5-8
4	177	0	177	0	0	1-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
6	234	176 / 0	0 / 0	0 / 0	0 / 0	58 / 0	0 / 0
4	126	80 / 0	0 / 0	0 / 0	0 / 0	46 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6, 4

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LOAC MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
1-2	0/16	-77.4	-77.4	0.10 (1)	10.00		
2-3	0/0	-77.4	-77.4	0.23 (1)	10.00	2-5	0/0 0.00 (1)
5-3	-161/0	0.0	0.0	0.02 (1)	7.81		
6-2	-265/0	0.0	0.0	0.03 (1)	7.81		
6-5	0/0	-17.5	-17.5	0.20 (1)	10.00		
5-4	0/0	-17.5	-17.5	0.20 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD =		33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012 , BCBC 2012 , ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL)= $L/999$ (0.03")
ALLOWABLE DEFL.(TL)= $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL)= $L/835$ (0.07")

CSI: TC=0.23/1.00 (2-3:1), BC=0.20/1.00 (5-6:1),
WB=0.00/1.00 (2-5:1), SSI=0.14/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (2) (INPUT = 0.90)
JSI METAL= 0.05 (6) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**



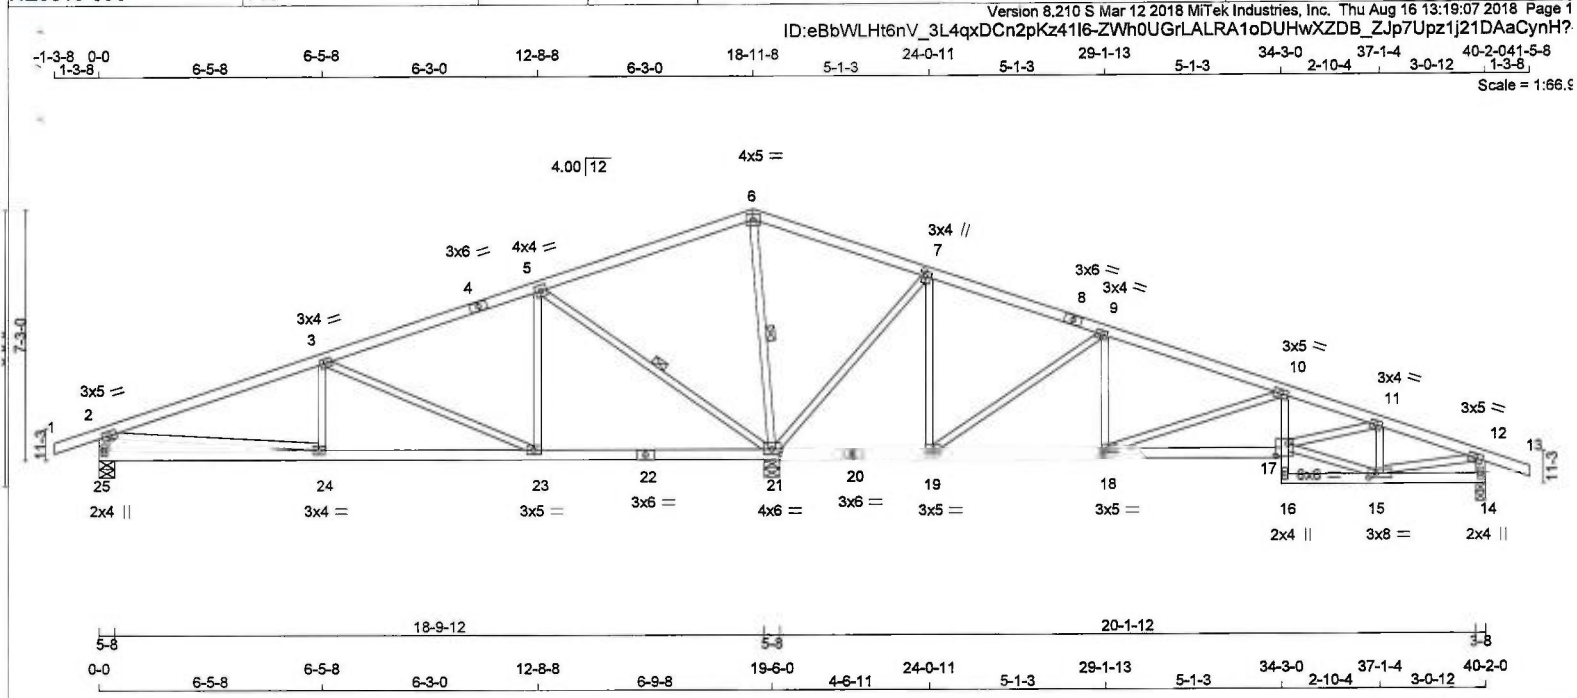

LUMBER				N. L. G. A. RULES				CHORDS				DESCR.			
1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
1 - 4	2x4	DRY	No.2	SPF											
4 - 6	2x4	DRY	No.2	SPF											
6 - 8	2x4	DRY	No.2	SPF											
8 - 13	2x4	DRY	No.2	SPF											
25 - 2	2x4	DRY	No.2	SPF											
14 - 12	2x4	DRY	No.2	SPF											
25 - 22	2x4	DRY	No.2	SPF											
22 - 20	2x4	DRY	No.2	SPF											
20 - 17	2x4	DRY	No.2	SPF											
16 - 10	2x3	DRY	No.2	SPF											
16 - 14	2x4	DRY	No.2	SPF											
ALL WEBS	2x3	DRY	No.2	SPF											
EXCEPT															

DRY: SEASONED LUMBER.

PLATES (table is in inches)										BRACING																			
JT	TYPE	PLATES	W	LEN	Y	X	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.80 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.										(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD												
2, 10, 12							ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.										ALLOWABLE DEFL.(LL)= L/360 (0.69") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05") ALLOWABLE DEFL.(TL)= L/360 (0.69") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.10")												
3, 9, 11							1 - 1x4 LATERAL BRACE(S) AT 1/2 LENGTH OF 5-21, 6-21. DBS = 20-0-0 . CBF = 145 LBS.																						
3	TMVW-t	MT20	3.0	4.0			DBS = DIAGONAL BRACE SPACING (MAX). CBF = CUMULATIVE BRACING FORCE (PER BRACE). FASTEN LATERAL BRACE(S) USING (0.122"x3") SPIRAL NAILS : 1 NAIL FOR 2x3 BRACE(S), 2 FOR 1x4, 2x4, 2x5, 3 FOR 2x6, 4 FOR 2x8, 5 FOR 2x10, AND 6 FOR 2x12.										CSI: TC=0.61/1.00 (5-6:1) , BC=0.25/1.00 (17-18:1) , WB=0.97/1.00 (7-21:1) , SSI=0.22/1.00 (2-3:1)												
4	TS-t	MT20	3.0	6.0			END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW										DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10												
5	TMVW-t	MT20	4.0	4.0			LOADING										COMPANION LIVE LOAD FACTOR = 0.50												
6	TTW-p	MT20	4.0	5.0			TOTAL LOAD CASES: (4)																						
7	TMVW-t	MT20	3.0	4.0	1.75	1.00																							
8	TS-t	MT20	3.0	6.0																									
14	BMV1+p	MT20	2.0	4.0																									
15	BMVW-t	MT20	3.0	8.0	1.50	2.50																							
16	BMV+p	MT20	2.0	4.0																									
17	BVMW-t	MT20	6.0	6.0	4.25	4.25																							
18	BMVW-t	MT20	3.0	5.0	1.50	2.25																							
19	BMVW-t	MT20	3.0	5.0																									
20	BS-t	MT20	3.0	6.0																									
21	BMVW-t	MT20	4.0	6.0	1.75	3.00																							
22	BS-t	MT20	3.0	6.0																									
23	BMVW-t	MT20	3.0	5.0																									
24	BMVW-t	MT20	3.0	4.0																									
25	BMV1+p	MT20	2.0	4.0																									

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
1-2	0 / 16	-77.4 -77.4	0.10 (1)	10.00	24- 3	0 / 122	0.04 (4)
2-3	-584 / 0	-77.4 -77.4	0.38 (1)	6.25	3-23	-849 / 0	0.75 (1)
3-4	0 / 219	-77.4 -77.4	0.45 (1)	10.00	23- 5	0 / 456	0.10 (1)
4-5	0 / 219	-77.4 -77.4	0.45 (1)	10.00	5-21	-1159 / 0	0.55 (1)
				0.00		49 / 0	0.35 (1)

NAIL VALUES			
PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 822	2284 1656

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.

LICENSED PROFESSIONAL ENGINEER
N.A. EL-MASRI
Aug 16, 2018

CONTINUED ON PAGE 2

KOTT

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREENPARK-MINNISALE HOMES-HEMLOCK 3 EL 1	DRWG NO.
NE0818-098	T19	2	1	TRUSS DESC.		PAGE 35 OF 38


Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu Aug 16 13:19:07 2018 Page 2
ID:eBbWLHt6nV_3L4qxDCn2pKz4116-ZWh0UGrLALRA1oDUHwXZDB_ZJp7Upz1j21DAaCynH?

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.

The logo for KOTT, featuring a stylized green 'K' with a blue square containing a white house icon, followed by the word 'KOTT' in bold blue capital letters.

Version 8.210 S Mar 12 2018 MiTek Industries, Inc. Thu Aug 16 13:19:08 2018 Page 1
ID:eBbWLHt6nV_3L4qxDCn2pKz41l6-1jFOhcszxeZ1exnhre2oLOXmKDRnYfPsHhyk6eynH?

Scale = 1:17.5

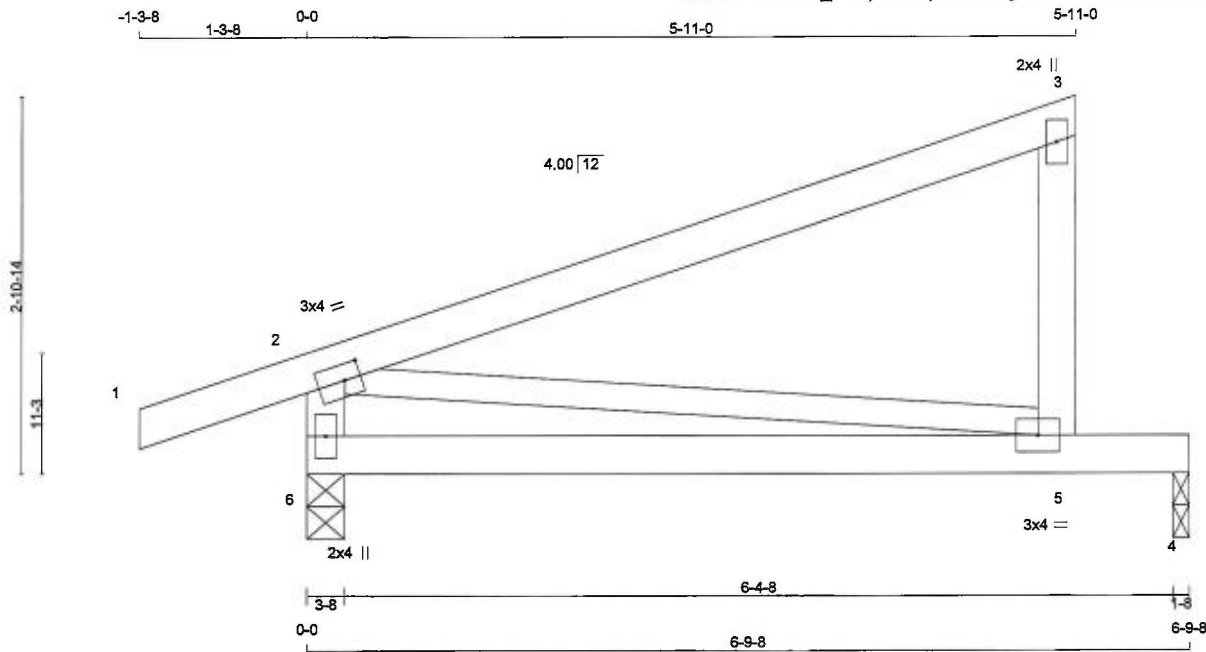

TOTAL WEIGHT = $4 \times 24 = 96$ lb

LUMBER

N. L. G. A. RULES					
CHORDS	SIZE		LUMBER		DESCR.
1 - 3	2x4	DRY	No.2		SPF
5 - 3	2x4	DRY	No.2		SPF
6 - 2	2x4	DRY	No.2		SPF
6 - 4	2x4	DRY	No.2		SPF
ALL WEBS 2x3		DRY	No.2		SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
2	TMVW-t	MT20	3.0	4.0	1.50	1.50
3	TMV+p	MT20	2.0	4.0		
5	BMVW-t	MT20	3.0	4.0		
6	BMV1+p	MT20	2.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
6	421	0	421	0	0	3-8	3-8
4	259	0	259	0	0	1-8	1-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
6	293	218 / 0	0 / 0	0 / 0	0 / 0	76 / 0	0 / 0
4	183	120 / 0	0 / 0	0 / 0	0 / 0	63 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) 6, 4

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	MAX FACTORED CSI (LC)
FR-TO		FROM TO					
1-2	0 / 16	-77.4	-77.4 0.10 (1)	10.00	2-5	0 / 0	0.00 (1)
2-3	0 / 0	-77.4	-77.4 0.46 (1)	10.00			
5-3	-229 / 0	0.0	0.0 0.03 (1)	7.81			
6-2	-332 / 0	0.0	0.0 0.03 (1)	7.81			
6-5	0 / 0	-17.5	-17.5 0.31 (1)	10.00			
5-4	0 / 0	-17.5	-17.5 0.30 (1)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	23.3	PSF
	DL =	3.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.0	PSF
TOTAL LOAD	=	33.3	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, BCBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

(55 % OF 27.2 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 23.3 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.23")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.08")
ALLOWABLE DEFL.(TL)= L/360 (0.23")
CALCULATED VERT. DEFL.(TL) = L/ 391 (0.21")

CSI: TC=0.46/1.00 (2-3:1), BC=0.31/1.00 (5-6:1),
WB=0.00/1.00 (2-5:1), SS=0.20/1.00 (4-5:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 0.50

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	822	2284	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.30 (2) (INPUT = 0.90)
JSI METAL= 0.06 (6) (INPUT = 1.00)



**READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF—
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.**




BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B37579H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.4.1.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-09, section 10.9.4
10. This design is not valid after April 30, 2019.

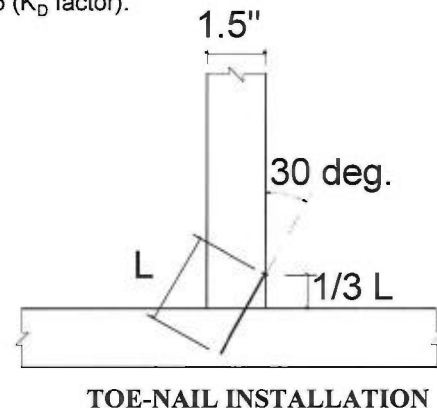

Nail type	Common wire	Common spiral	Common wire
Nail dia. (in)	0.160	0.152	0.144
	(3.5" nail)		(3" and 3.25" nail)
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS		
2X4 SPF	2	2	3
2X4 D. Fir	2	2	2
2X6 SPF	4	4	4
2X6 D. Fir	3	3	3



MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485



April 26, 2017

BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B37579H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-09, section 10.9.5.2.
3. For 9- 3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-09, section 10.9.5
9. This design is not valid after April 30, 2019

Toe-nailing on 2x6 Bearing Plate

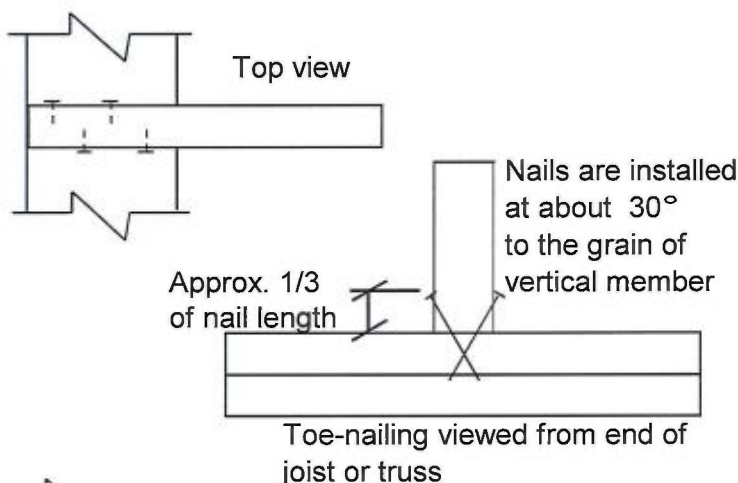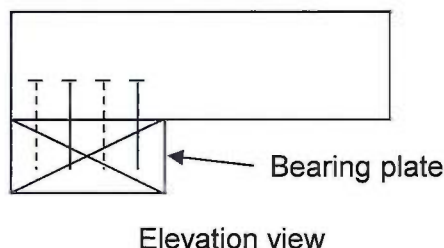

Toe-nailing on 2x4 Bearing Plate

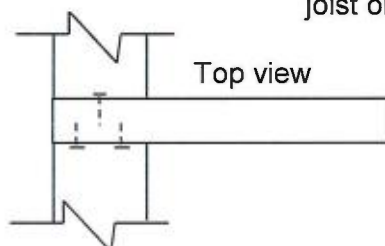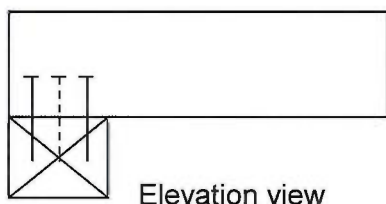

MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

PEO
Certificate No. 10889485




April 26, 2017

READ ALL NOTES ON THIS PAGE AND ON
ENGINEERING NOTE PAGE ENP-1. THIS
NOTE PAGE IS AN INTEGRAL PART OF
THIS DRAWING AS IT CONTAINS
SPECIFICATIONS AND CRITERIA USED IN
THE DESIGN OF THIS COMPONENT.



All work shall conform to the Ontario
Building Code O. Reg. 332/12 as amended
For conventional framing roof / ceilings
framing shall conform to OBC.9.28

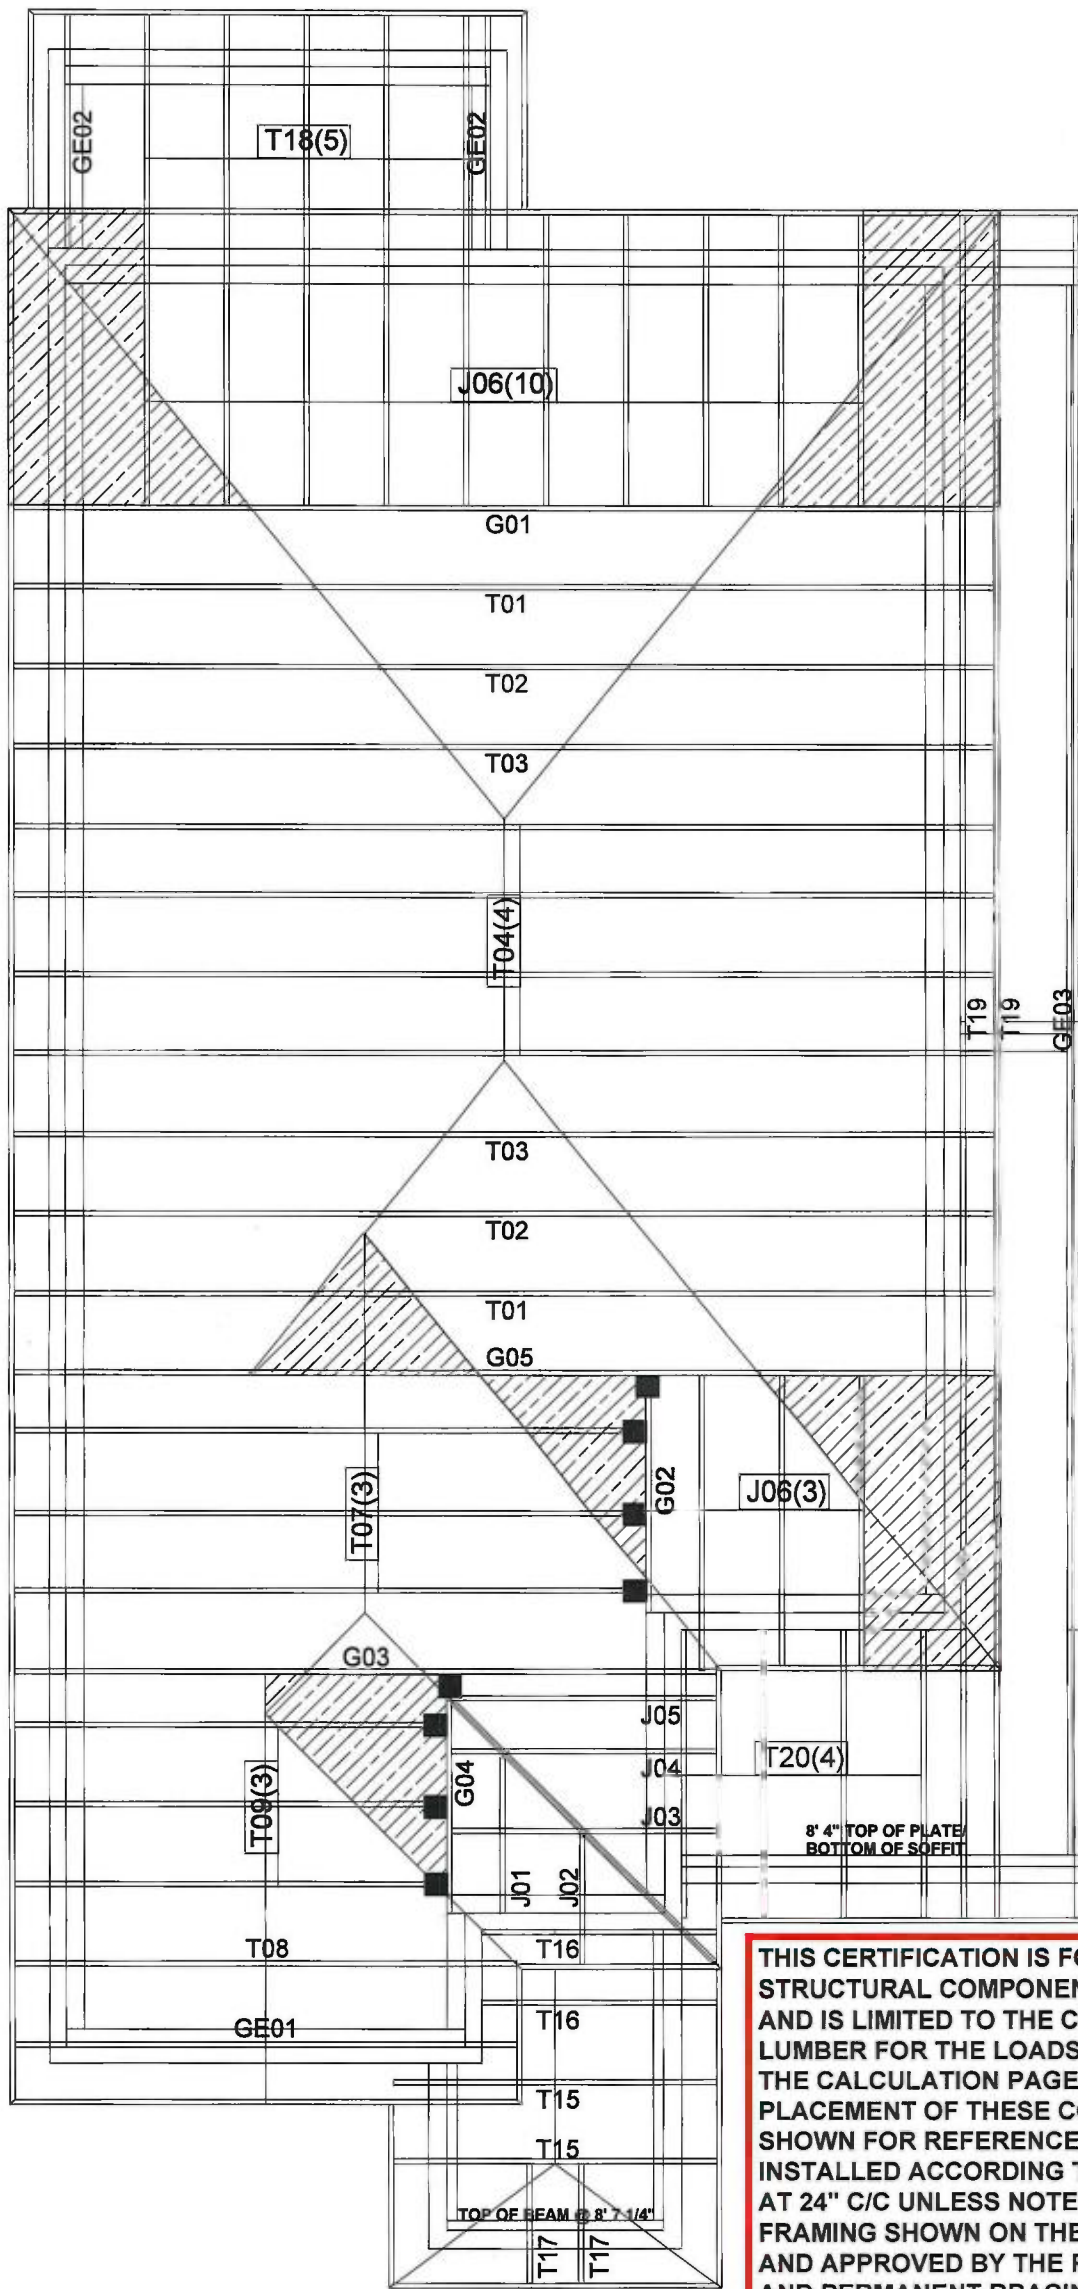

THIS CERTIFICATION IS FOR THE ENGINEERING REVIEW OF
STRUCTURAL COMPONENTS SHOWN ON THIS DRAWING
AND IS LIMITED TO THE COMPONENTS SUPPLIED BY KOTT
LUMBER FOR THE LOADS AND CONDITIONS SHOWN ON
THE CALCULATION PAGE OF EACH COMPONENT. THE
PLACEMENT OF THESE COMPONENTS ON THIS LAYOUT IS
SHOWN FOR REFERENCE ONLY. ROOF TRUSSES MUST BE
INSTALLED ACCORDING TO MANUFACTURER'S GUIDELINES
AT 24" C/C UNLESS NOTED OTHERWISE. CONVENTIONAL
FRAMING SHOWN ON THE LAYOUT MUST BE DESIGNED
AND APPROVED BY THE PROJECT ENGINEER. TEMPORARY
AND PERMANENT BRACINGS OF THE ROOF AND BUILDING
ARE THE RESPONSIBILITY OF THE PROJECT ENGINEER
AND TO CONFORM TO BCSI GUIDELINES.

M2060

12R-Lot

Architectural Drawing Info:
Date: JULY 23, 2018
Project number: 18012
Model: HEMLOCK 3

REV.



**CONVENTIONAL
FRAMING BY OTHERS**

ALL CONVENTIONAL FRAMING TO CONFORM WITH
PART 9 OF THE O.B.C.
ROOF RAFTERS THAT CROSS MEET OVER TRUSSES
TO BE 2x4 S.P.F. @ 24" O/C WITH A 2x4 VERTICAL
POST TO THE TRUSS UNDERNEATH EACH CROSS
POINT. VERTICAL POST LONGER THAN 8' TO HAVE
LATERAL BRACING SO THAT THE DISTANCE BETWEEN
END POINT AND BETWEEN ROWS OF BRACING
DOES NOT EXCEED 8'.

SIZE AND LOCATION OF CONVENTIONAL FRAMING
IS APPROXIMATE. ALL AREAS MAY NOT BE SHOWN.
REFER TO ARCHITECTURAL PLANS FOR DETAILS.

HANGER LEGEND:

- ▼ LUS24
- LJS26DS
- HGUS26
- ✕ HGUS26-2

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 23.3 PSF
DL = 3 PSF
BOT CH. LL = 0 PSF
DL = 7 PSF
TOTAL LOAD = 33.3 PSF

SPACING = 24" O/C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010

THIS DESIGN COMPLIES WITH:
- PART 9 OF OBC 2012, CBC 2012, ABC 2014
- CSA 086-09
- TPIC 2011

Model: **HEMLOCK 3 EL 1**
Customer: **GREENPARK**
Project: **MINNISALE HOMES**
Location: **BRAMPTON**
Date: **6/22/2018** Drawn by: **BB**