




FRONT ELEVATION 'A'
(INT CONDITION)

Drawing List:

- A0 TITLE SHEET
- A1 FOUNDATION PLAN ELEVATION 'A'
- A2 LOWER LEVEL ELEVATION 'A'
- A3 MAIN FLOOR ELEVATION 'A'
- A4 UPPER FLOOR ELEVATION 'A'
- A5 FRONT ELEVATION ELEV. 'A' (INT CONDITION)
- A6 REAR ELEVATION ELEV. 'A' (INT CONDITION)
- A7 TYPICAL CROSS SECTION
- D1 CONSTRUCTION NOTES
- D2 CONSTRUCTION NOTES
- D3 CONSTRUCTION NOTES

Areas:

	ELEVATION 'A'	
	SF	SM
LOWER LEVEL	503.1	46.7
MAIN FLOOR	830.3	77.1
UPPER FLOOR	830.3	77.1
TOTAL AREA	2163.7	201.0
COVERAGE INC PORCH	1101.1	102.3
COVERAGE NOT INC PORCH	1055.4	98.0

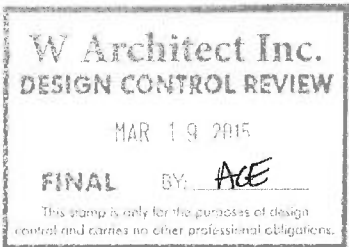

BATHURST 9130

Madison



I, ERIC SCHNEIDER DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF W ARCHITECT INC. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES. QUALIFIED DESIGNER BCIN: 30840 25993 MAR-13-15 DATE:

SIGNATURE

client
Senator Homes

project
BATHURST 9130

location
Vaughan

marketing name
Madison

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4-Sep-14	kh	sh	3				
2	ISSUED FINAL	13-Apr-15	sh	sh	6				
3					7				
4					8				

AN design
Imagine • Inspire • Create




model
TH -23-2

scale
3/16" = 1'0"

project #
12073


page

A0

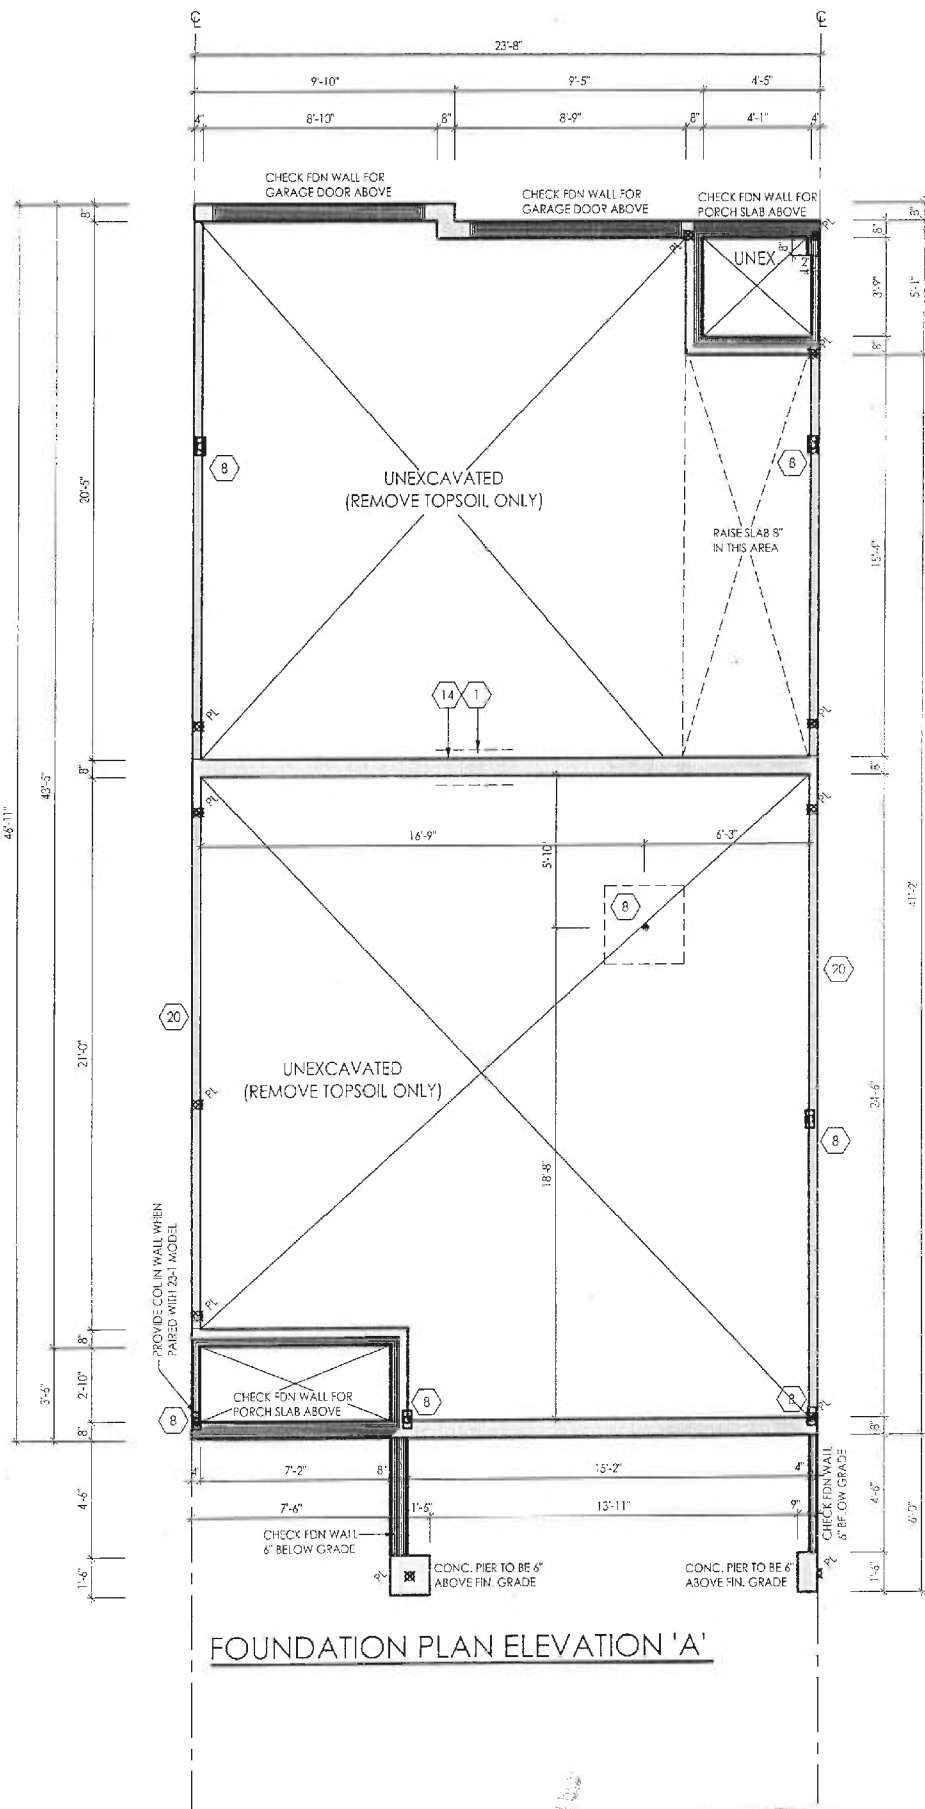

FOUNDATION PLAN ELEVATION 'A'

MAR 13 2015



I, THOMAS SCHNEIDER, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF R.N. DESIGN LTD. UNDER DIVISION C PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES. QUALIFIED DESIGNER BCIN: 30640 26995 DATE: MAR-13-15

SIGNATURE

client
Senator Homes
project
BATHURST 9130

location
Vaughan
marketing name
Madison

company
R.N. design
Imagine • Inspire • Create

model
TH-23-2


scale
3/16" = 1'0"

project #
12073

page

A1

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4-Sep-14	ch	sh	5				
2	ISSUED FINAL	13-Mar-15	sh	sh	6				
3					7				
4					8				

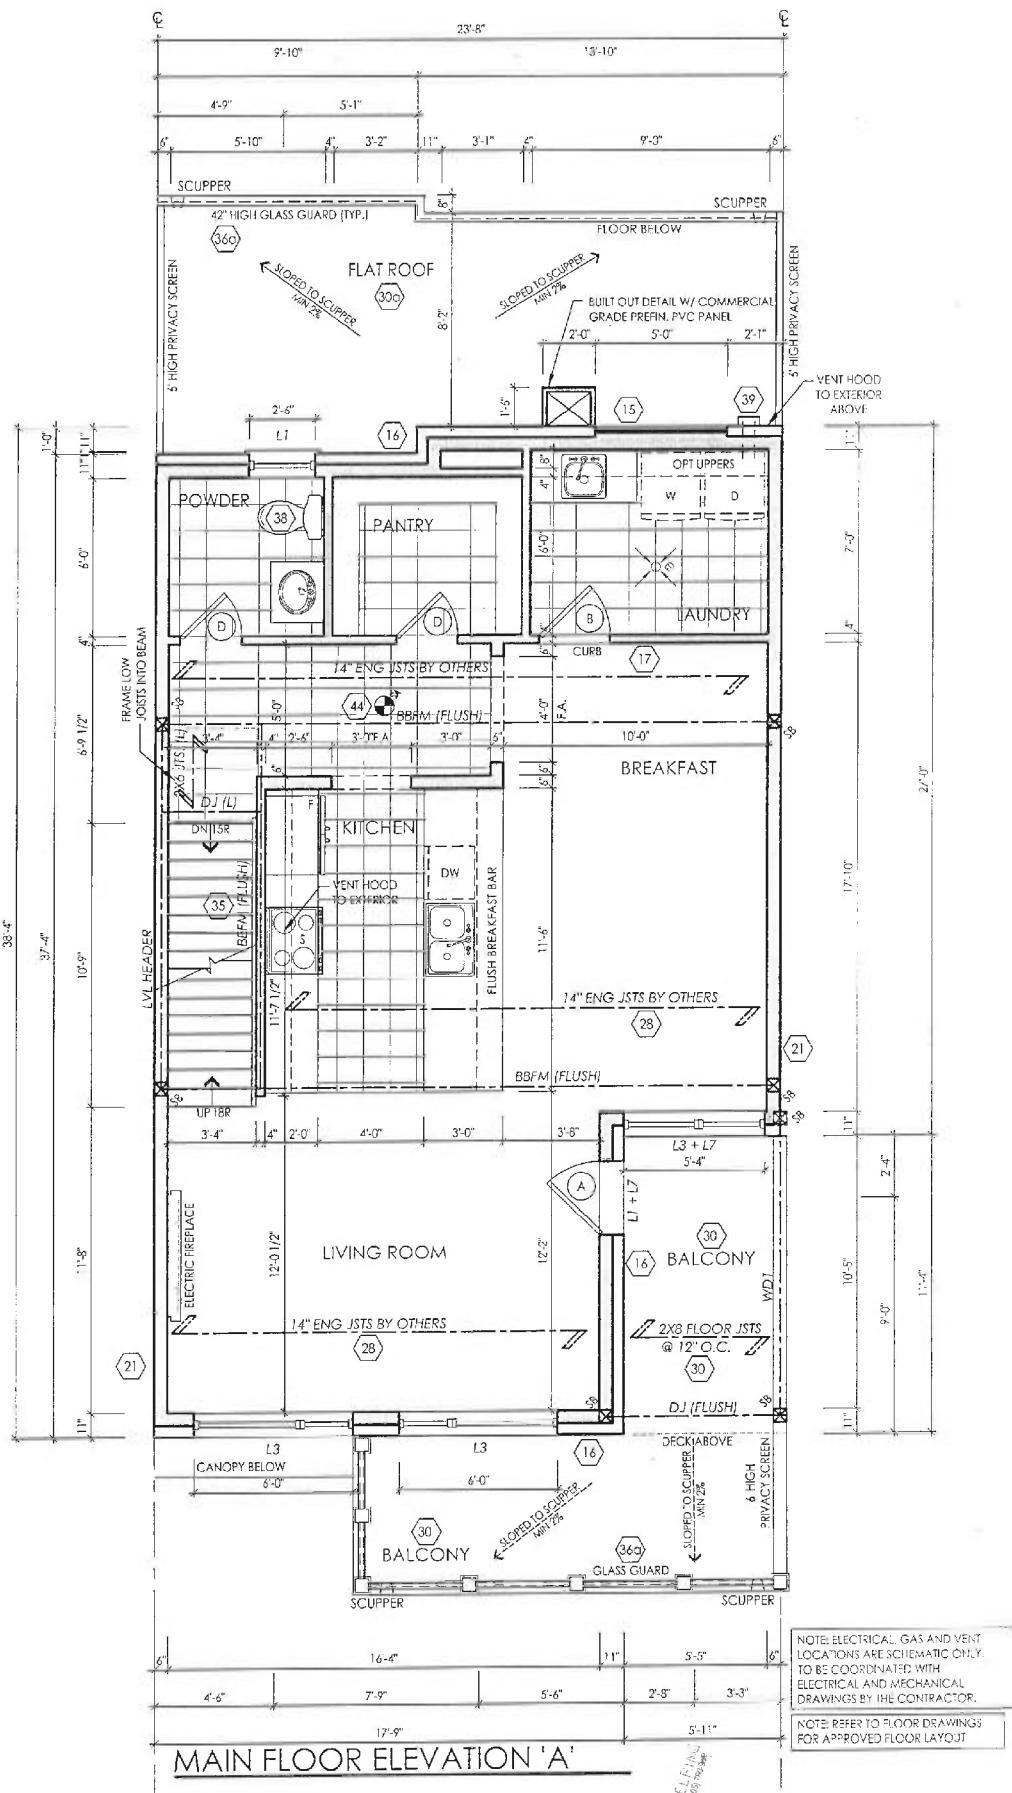

I, ERIC SCHNIDER, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES. QUALIFIED DESIGNER BCIN: 30840 26995 MAR-13-15 DATE: *E. Schneider*

SIGNATURE:

client
Senator Homes
project
BATHURST 9130

location
Vaughan
marketing name
Madison

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4-Sep-14	th	st	5				
2	ISSUED FINAL	13-Mar-15	st	st	6				
3					7				
4					8				


AN design
Imagine • Inspire • Create



model
TH-23-2
scale
3/16" = 1'0"
project #
12073

page

A3

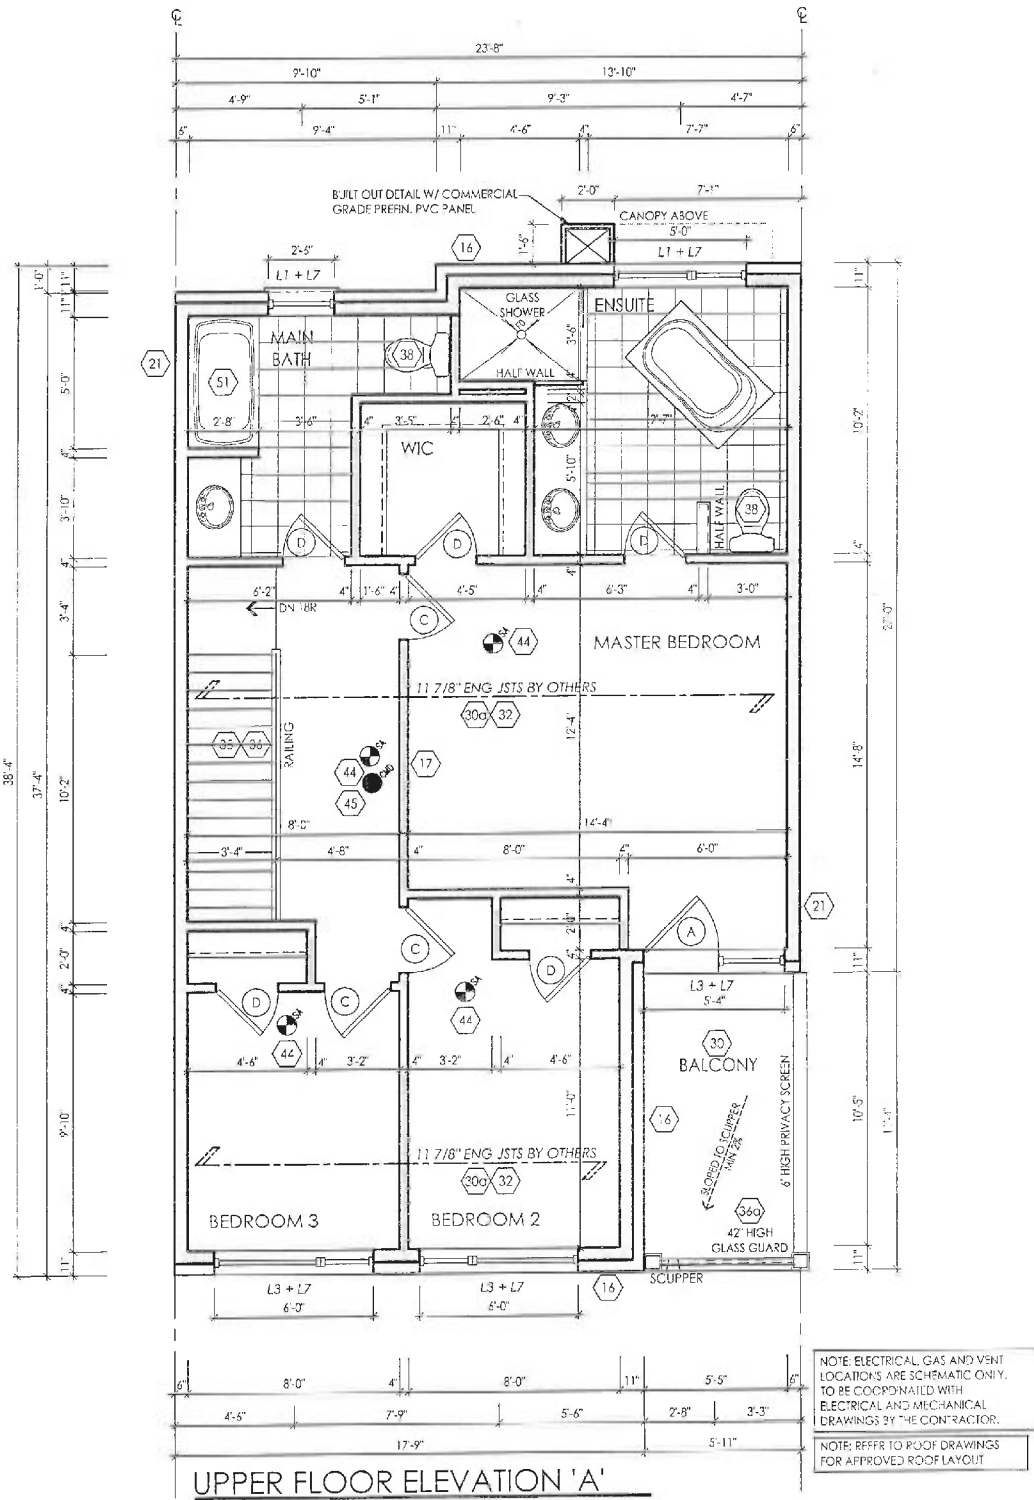

I, ERIC SCHNEIDER DO, DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RIN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 26993
DATE: MAR-13-15

E. Schneider

SIGNATURE:


client
Senator Homes
project
BATHURST 9130

location
Vaughan
marketing name
Madison

model
TH-23-2
scale
3/16" = 1'0"


project #
12073

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4-Sep-14	kh	sh	5				
2	ISSUED FINAL	13-Mar-15	sh	ph	6				
3					7				
4					8				

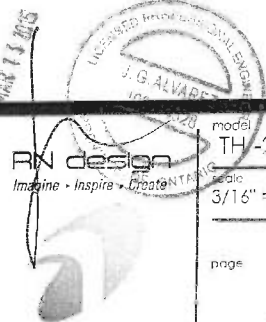

page


A4

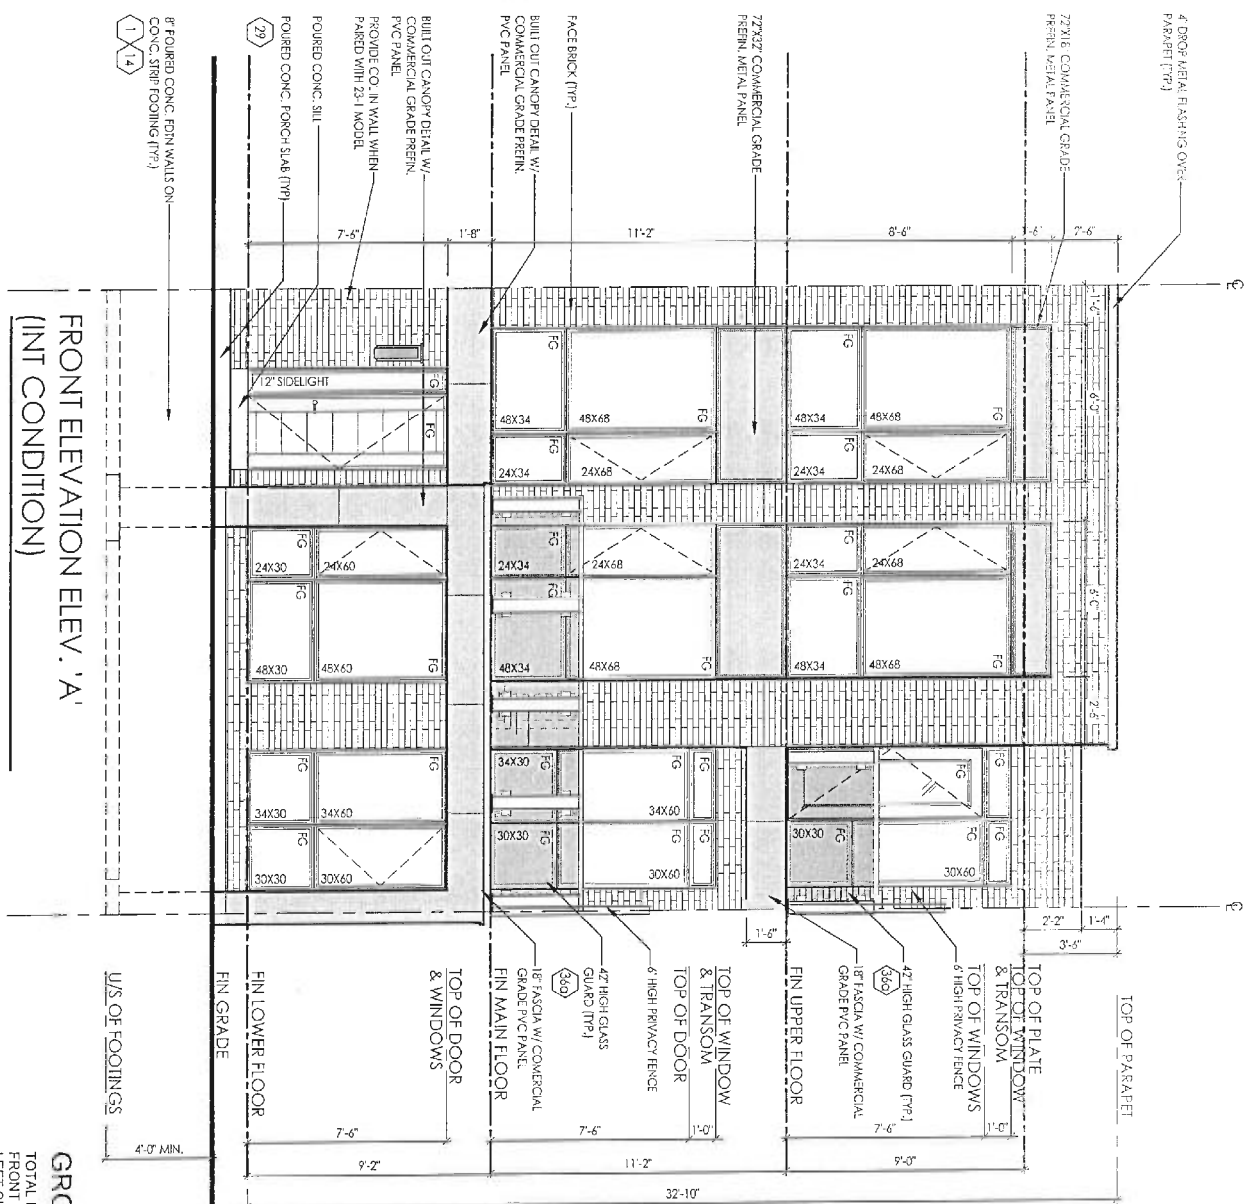

FRONT ELEVATION ELEV. 'A'
(INT CONDITION)

GROSS GLAZING AREA - ELEV. 'A'

TOTAL GLAZING AREA	3365.93 SF	26.55 m ²
TOTAL GLAZING PERCENTAGE	11.64 %	

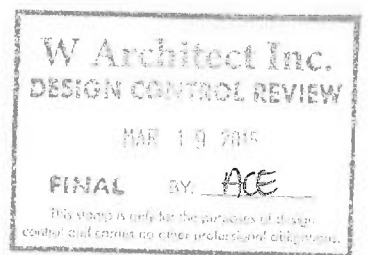

I, ERIC SCHNEIDER DECLARE THAT I HAVE REVIEWED AND TAKEN
DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF
OF AN DESIGN LTD, UNDER DIVISION C, PART 3 SUBSECTION 3.2.4
OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS
REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 26995
DATE: Feb 13 2013 MAR-13-15

SIGNATURE _____

client
Senator Homes
project
BATHURST 9130

location
Vaughan
marketing name
Madison

AN design
Imagine • Inspire • Create



model
TH-23-2
scale
 $3/16" = 1'0"$

project #
12073

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4Sep-14	kh	sh	5				
2	ISSUED FINAL	13Apr-15	th	sh	6				
3					7				
4					8				

page

A5

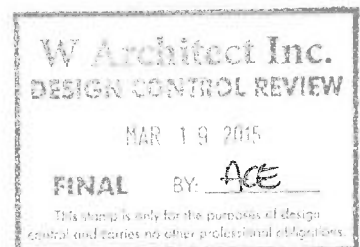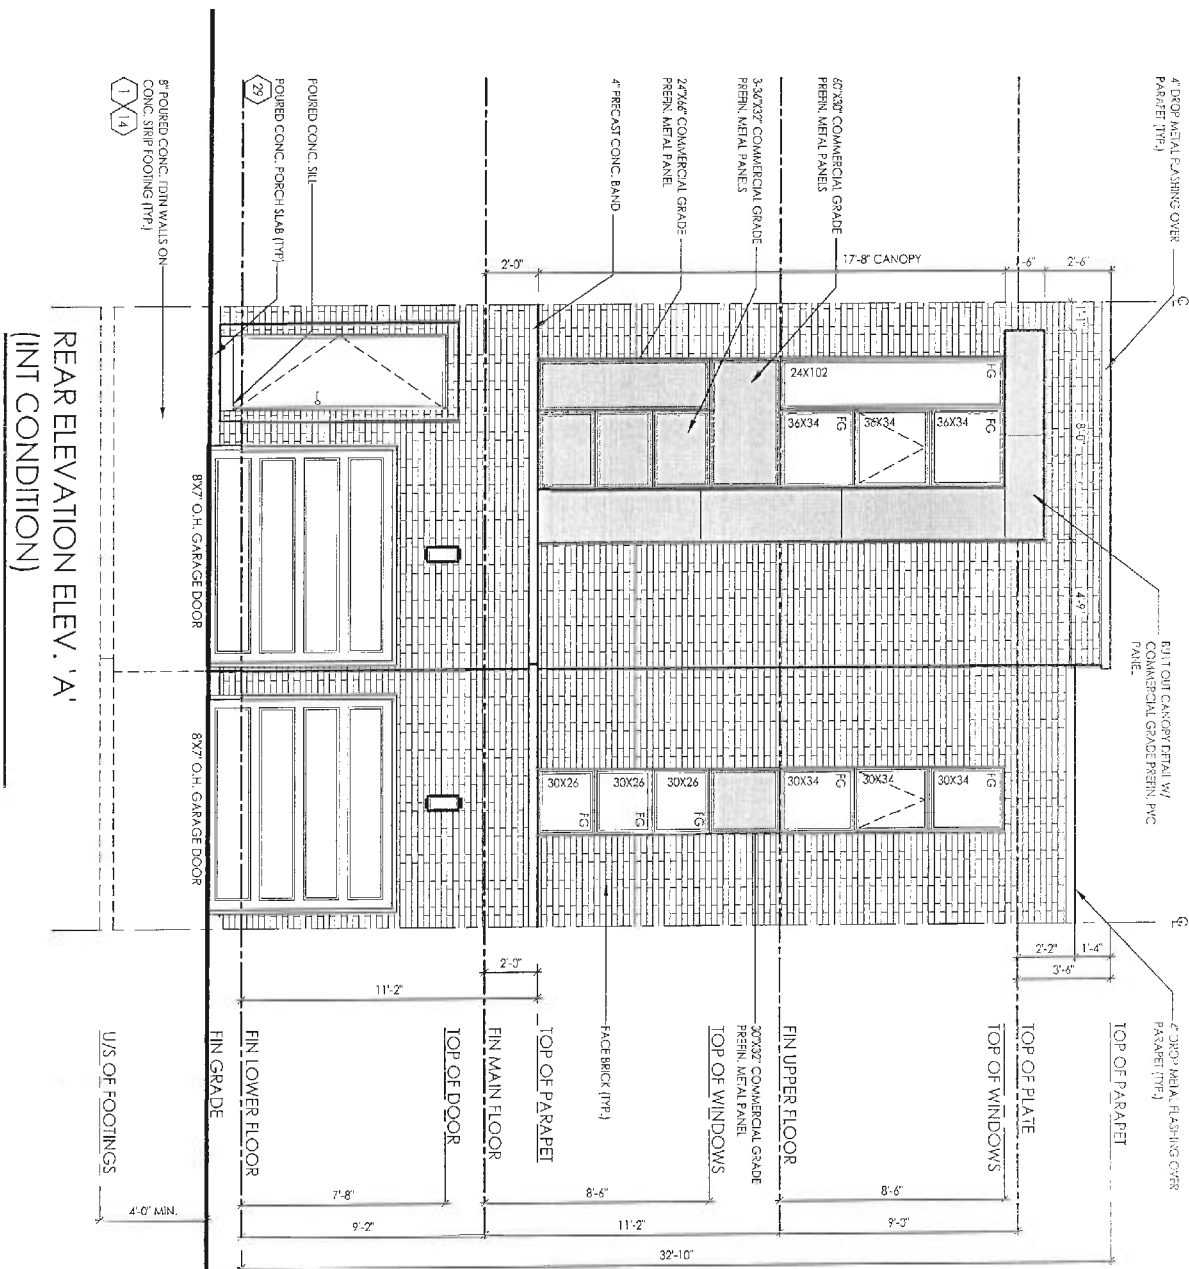

I, ERIC SCHNEIDER DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF PN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES. QUALIFIED DESIGNER BCIN: 30840 26795 DATE: MAR-13-15

SIGNATURE

client
Senator Homes
project
BATHURST 9130

location
Vaughan
marketing name
Madison

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4-Sep-14	th	th	5				
2	ISSUED FINAL	13-Mar-15	th	th	6				
3					7				
4					8				

PN design
Imagine • Inspire • Create


model
TH -23-2
scale
3/16" = 1'0"

project #
12073

page

A6

TYPICAL CROSS SECTION
N.T.S.

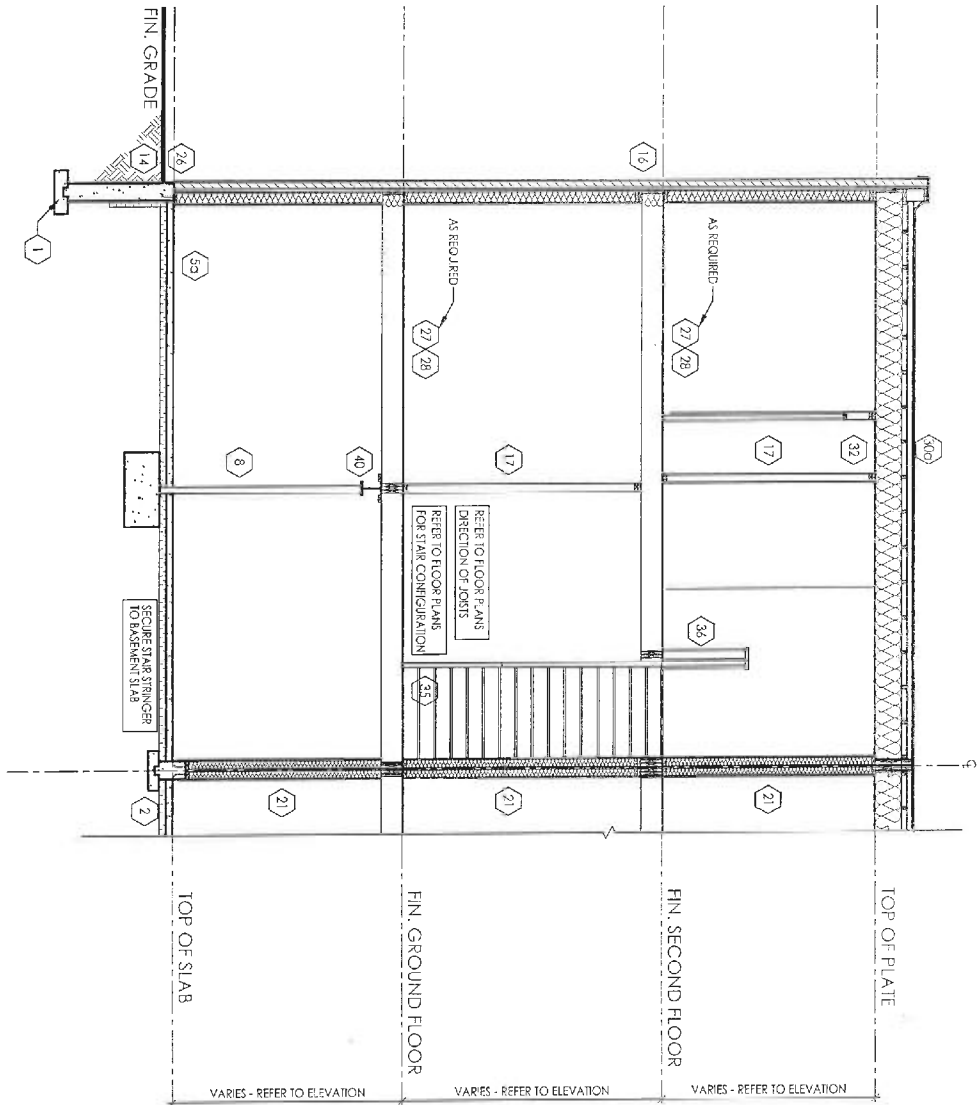

I, ERIC SCHNIEDER DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF AN DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.
QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 26995
DATE: MAR-13-15

SIGNATURE:

E. Schneider

Client
Senator Homes
project
BATHURST 9130

location
Vaughan
marketing name
Madison

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4-Sep-14	kh	sh	5				
2	ISSUED FINAL	13-Mar-15	sh	sh	6				
3					7				
4					8				



AN design
Imagine • Inspire • Create

model
TH -23-2

scale
3/16" = 1'0"

project #
12073

page

A7

CONSTRUCTION NOTES:

COMPLIANCE PACKAGE J - O.B.C. 2012 - 2014 ENACTMENT

(UNLESS OTHERWISE NOTED)

- ALL CONSTRUCTION TO CONFORM TO THE ONTARIO BUILDING CODE (O.B.C.) AND ALL OTHER CODES AND LOCAL AUTHORITIES HAVING JURISDICTION.
- ALL DIMENSIONS GIVEN FIRST IN IMPERIAL, FOLLOWED BY METRIC.
- THERMAL RESISTANCE: VALUES BASED ON ZONE 1

FOOTINGS / SLABS:

TYPICAL STRIP FOOTING:

- O.B.C. 9.13.3.
- PAILED ON 16" (419mm) MAX. SUPPORTED JOIST LENGTH
- MIN. 2200psi (15MPa) CONCRETE AFTER 28 DAYS
- SHALL REST ON UNDISTURBED SOIL, ROCK OR COMPACTED GRANULAR FILL
- W/ MIN. 50,000psi (758KPa) BEARING CAPACITY
- FTGL TO HAVE CONTINUOUS KEY
- FTGL SIZES MAY BE REDUCED FOR SOILS W/ GREATER BEARING CAPACITY (AS PER SOILS ENGINEERING REPORT)

TYPICAL STRIP FOOTING: (EXTERIOR WALLS)

- O.B.C. 9.13.3.5.
- FTGL TO EXTEND MIN. 4'-0" (1200mm) BELOW GRADE
- BRICK VENEER
 - 1 STOREY - 13" X 4" (330mm X 100mm)
 - 2 STOREY - 19" X 6" (485mm X 155mm)
 - 3 STOREY - 26" X 9" (660mm X 230mm)
- SIDING:
 - 1 STOREY - 10" X 4" (255mm X 100mm)
 - 2 STOREY - 14" X 4" (360mm X 100mm)
 - 3 STOREY - 18" X 5" (460mm X 130mm)

TYPICAL STRIP FOOTING: (INTERIOR BEARING WALLS)

- O.B.C. 9.13.3.6.
- 1 STOREY MASONRY - 16" X 4" (410mm X 100mm)
- 1 STOREY STUD - 12" X 4" (305mm X 100mm)
- 2 STOREY MASONRY - 26" X 9" (660mm X 230mm)
- 2 STOREY STUD - 18" X 5" (450mm X 130mm)
- 3 STOREY MASONRY - 36" X 14" (900mm X 360mm)
- 3 STOREY STUD - 24" X 8" (600mm X 200mm)

STEP FOOTING:

- O.B.C. 9.13.3.9.
- 23 1/8" (600mm) MAX. VERTICAL RISE & 23 5/8" (600mm) MIN. HORIZONTAL RUN

DRAINAGE TILE OR PIPE:

- O.B.C. 9.14.3.
- 4" (100mm) MIN. DIA. LAID ON UNDISTURBED OR WELL COMPACTED SOIL
- W/ TOP OF TILE OR PIPE TO BE BELOW BOTTOM OF FLR. SLAB.
- COVER TOP & SIDES OF TILE OR PIPE W/ 5/8" (150mm) OF CRUSHED STONE OR OTHER COURSE CLEAN GRANULAR MATERIAL.
- TILE SHALL DRAIN TO A SEWER, DRAINAGE DITCH, OR DRY WELL.

BASEMENT SLAB:

- O.B.C. 9.13. & 9.16.
- 3" (75mm) CONCRETE SLAB
- 2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.14.4.5.
- DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
- DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
- 4" (100mm) OF COURSE GRANULAR MATERIAL
- PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTGL
- W/ REF. SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
- FLOOR DRAIN PER O.B.C. 9.31.4.4.
- R10 (RSI 1.76) INSULATION AT PERIMETER OF SLAB WHERE GRADE IS WITHIN 23 1/2" (600mm) OF BASEMENT SLAB EDGE. INSULATION TO EXTEND TO NOT LESS THAN 23 1/2" (600mm) BELOW EXTERIOR GRADE LEVEL (O.B.C. 9.23.12 - 2.1.1.6 (5))
- UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. 9.23.9)

SLAB ON JOIST:

- 3" (75mm) CONCRETE SLAB - O.B.C. 9.16.4.3.
- 2200psi (15MPa) AFTER 28 DAYS - O.B.C. 9.16.4.5.
- DAMP-PROOF BELOW SLAB W/ MIN. 0.006" (0.15mm) POLYETHYLENE OR TYPE 'S' ROLL ROOFING W/ 4" (100mm) LAPPED JOINTS.
- DAMP-PROOFING MAY BE OMITTED IF CONCRETE HAS MIN. 3600psi (25MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS
- R10 (RSI 1.76) INSULATION UNDER ENTIRE SLAB WHERE THE ENTIRE SLAB IS WITHIN 23 1/2" (600mm) OF GRADE.
- 4" (100mm) OF COURSE GRANULAR MATERIAL
- PROVIDE BOND BREAKING MATERIAL BETWEEN SLAB & FTGL
- W/ REF. SLAB IS REQUIRED TO BE WATERPROOFED IT SHALL CONFORM TO O.B.C. 9.13.3.
- FLOOR DRAIN PER O.B.C. 9.31.4.4.
- UNLESS IT CAN BE DEMONSTRATED THAT SOIL GAS DOES NOT CONSTITUTE A PROBLEM, SOIL GAS CONTROL SHALL CONFORM TO SUPPLEMENTARY STANDARD (O.B.C. 9.23.9)

GARAGE SLAB / EXTERIOR SLAB:

- 4" (100mm) CONCRETE SLAB
- 4650psi (32MPa) COMPRESSIVE STRENGTH AFTER 28 DAYS FOR UNREINFORCED CONC. & W/ 5-8% AIR ENTRAINMENT - O.B.C. 9.31.6.
- 6" X 6" (152 X 152mm) WIRE MESH LOCATED NEAR MID-DEPTH OF SLAB
- 4" (100mm) OF COURSE GRANULAR MATERIAL
- ANY FILL PLACED UNDER SLAB, OTHER THAN COURSE CLEAN GRANULAR MATERIAL, SHALL BE COMPACTED.

PILASTERS:

- O.B.C. 9.15.3.3.
- PILASTER
 - CONCRETE RIS - 4" X 12" (100mm X 300mm)
 - BLOCK NIB - 4" X 12" (100mm X 300mm) BONDED & TIED TO WALL AS PER O.B.C. 9.20.11.2, TOP 7/8" (200mm) SOLID.
- OR
- BEAM POCKET
 - 4" (100mm) INTO FIN. WALL W/ WIDTH TO MATCH BEAM SIZE.
 - 1/2" (13mm) SPACE AROUND WOOD BEAMS (O.B.C. 9.23.2.2)

STRUCTURAL COLUMNS:

- SIZES BASED ON COLUMN SUPPORTING BEAMS CARRYING LOADS FROM NOT MORE THAN 2 WOOD FRAME FLOORS, WHERE THE LENGTHS OF JOISTS CARRIED BY SUCH BEAMS DO NOT EXCEED 16'-11" (4.9m) AND THE LIVE LOAD ON ANY FLOOR DOES NOT EXCEED 50psf (2.4Kpa).

STEEL PIPE COLUMN:

- O.B.C. 9.15.3.4. & 9.17.3.
- FIXED COLUMN
 - MIN. 3 1/2" (90mm) DIA. W/ 3/16" (4.76mm) WALL THICKNESS
 - FOR STEEL BEAMS, CLIPS @ TOP & MIN. 6" X 4" X 1/4" (152mm X 100mm X 6.35mm) STEEL BLM. PLATE
 - FOR WOOD BEAMS, MIN. 4" X 4" X 1/4" (100mm X 100mm X 6.35mm) STEEL TOP & BLM. PLATES, OR TOP PLATE TO EXTEND MIN. WIDTH OF BEAM
 - ALL LISTABLE COLUMNS TO CONFORM TO CAN/CSA C308-7.2.4.4 WHERE IMPOSED LOAD DOES NOT EXCEED 36 kN (O.B.C. 9.17.3.4)
 - CON. SPACING: FTG SIZE:
 - 2 STOREY
 - MAX. 9'-10" (2997mm)
 - 34" X 34" X 16"
 - 160mm X 860mm X 400mm
 - MAX. 6'-0" (4880mm)
 - 44" X 44" X 21"
 - 1120mm X 1120mm X 530mm
 - 3 STOREY
 - MAX. 9'-10" (2997mm)
 - 40" X 40" X 19"
 - 1010mm X 1010mm X 490mm
 - MAX. 6'-0" (4880mm)
 - 51" X 51" X 24"
 - 1295mm X 1295mm X 610mm
- WHERE COL. SITS ON FDN. WALL, USE 4" X 8" X 5/8" (100mm X 200mm X 16mm) STEEL PLATE WITH 2-5/8" (16mm) ANCHOR BOLTS

WOOD COLUMN:

- O.B.C. 9.17.4.1.
- 5 1/2" X 5 1/2" (140mm X 140mm) SOLID WOOD COLUMN
- METAL SHOE ANCHORED TO FOOTING
- 25" X 25" X 12" (640mm X 640mm X 300mm) CONC. PAD (1 FLOOR SUPPORTED W/ 9'-10" COL SPACING)
- 34" X 34" X 14" (860mm X 860mm X 360mm) CONC. PAD (2 FLOORS SUPPORTED W/ 9'-10" COL SPACING)

BLOCK PARTY WALL BEAM END BEARING: (WOOD BEAM / GIRDER TRUSSES)

- 2'X8"X12" LEDGER BOARD FASTENED W/ 2" 1/2" ANCHOR BOLTS @ 4" O.C.
- WHERE WOOD BEAMS BEAR ON FIREWALLS USE GENERAL NOTE 11 WHERE REQUIRED TO OBTAIN 5" SEPARATION DISTANCE BETWEEN ADJACENT BEAMS

BLOCK PARTY WALL BEAM END BEARING: (STEEL BEAM)

- 12"X11"X5/8" STL. PLATE ON TOP OF SOLID CONCRETE BLOCK WITH 2" 1/2"X8" ANCHOR BOLTS.

WALL ASSEMBLIES:

FOUNDATION WALL:

- O.B.C. 9.15.4.2.
- FOR WALLS NOT EXCEEDING 8'-2" (2500mm) IN LATRALLY SUPPORTED HEIGHT.
- 8" (200mm) SOLID 2200psi (15MPa) CONCRETE
- MAX. UNSUPPORTED HEIGHT OF 3'-11" (1200mm) & MAX. SUPPORTED HEIGHT OF 7'-0" (2150mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
- FOR WALLS NOT EXCEEDING 9'-0" (2750mm) IN LATRALLY SUPPORTED HEIGHT:
 - 10" (250mm) SOLID 2200psi (15MPa) CONCRETE
 - MAX. UNSUPPORTED HEIGHT OF 4'-7" (1400mm) & MAX. SUPPORTED HEIGHT OF 8'-6" (2600mm) MEASURED FROM GRADE TO FINISHED BASEMENT FLOOR.
 - LATERAL SUPPORT PROVIDED BY ANCHORED SILL PLATE TO JOISTS.
 - FOR CONDITIONS EXCEEDING THESE MAXIMUMS AN ALTERNATIVE IN CONFORMANCE TO O.B.C. 1.9.15.4.1 SHALL BE USED OR IT SHALL BE DESIGNED UNDER O.B.C. PART 7.
- WALL SHALL EXTEND A MIN. 5/8" (150mm) ABOVE GRADE
- INSULATE W/ R22 (RSI 2.11) FROM UNDERSIDE OF SUBFLOOR TO NOT MORE THAN 8" (200mm) ABOVE FINISHED FLOOR OF BASEMENT (ZONE 1, O.B.C. T.2.1.1.2.A)
- BACK FILL W/ NON-FROST SUSCEPTIBLE SOIL

REDUCTION OF THICKNESS:

- O.B.C. 9.15.4.7.
- WHERE THE TOP OF THE FOUNDATION WALL IS REDUCED IN THICKNESS TO ALLOW MASONRY FACING, THE MIN. REDUCED THICKNESS SHALL NOT BE LESS THAN 3-1/2" (90mm) THICK.
- TIE TO FACING MATERIAL WITH METAL TIES SPACED MAX. @ 7/8" (200mm) VERTICALLY O.C. & 2-1/1" (90mm) HORIZONTALLY.
- FILL SPACE BETWEEN WALL AND FACING SOLID W/ MORTAR
- WHERE WALLS REDUCED FOR JOISTS, THE REDUCED THICKNESS SHALL BE MAX. 13-3/4" (350mm) HIGH & MIN. 3-1/2" (90mm) THICK

DAMP-PROOFING & WATERPROOFING:

- DAMP-PROOF TIE EXTERIOR FACE OF WALL BELOW GRADE AS PER O.B.C. 9.13.2.
- WHERE INSULATION EXTENDS TO MORE THAN 4'-0" (1450mm) BELOW GRADE, A FDN. WALL DRAINAGE LAYER SHALL BE PROVIDED IN CONFORMANCE TO O.B.C. 9.14.2.1 (3) (4)
- FINISHED BASEMENTS SHALL HAVE INTERIOR DAMP-PROOFING EXTENDING FROM SLAB TO GRADE LEVEL & SHALL CONFORM TO O.B.C. 9.13.3.3 (3)
- WHERE HYDROSTATIC PRESSURE OCCURS, FDN. WALLS SHALL BE WATERPROOFED AS PER O.B.C. 9.13.3.
- WALLS THAT ARE WATERPROOFED DO NOT REQUIRE DAMP-PROOFING.

FOUNDATION WALLS @ UNSUPPORTED OPENINGS:

- 2-20M BARS IN TOP PORTION OF WALL (UP TO 8'-0" OPENING)
- 3-20M BARS IN TOP PORTION OF WALL (8'-0" TO 10'-0" OPENING)
- 4-20M BARS IN TOP PORTION OF WALL (10'-0" TO 15'-0" OPENING)
- BARS STACKED VERTICALLY AT INTERIOR FACE OF WALL
- BARS TO HAVE MIN. 2" (50mm) CONCRETE COVER
- BARS TO EXTEND 2'-0" (600mm) BEYOND BOTH SIDES OF OPENING.

FRAME WALL CONSTRUCTION:

- O.B.C. 9.23.
- SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27)
- WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
- 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
- 2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
- MIN. R22 (RSI 3.87) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A)
- CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. 58-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE THE FOLLOWING MATERIALS:
 - REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) INTERIOR GYPSUM BOARD WITH 1/2" (12.7mm) TYPE 'X' GYPSUM BOARD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

- REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
 - NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
- OR
- VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

ALTERNATE FRAME WALL CONSTRUCTION:

- O.B.C. 9.23
- SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27.)
- 1 1/2" (38mm) RB (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4)
- BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BLM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BLM. PLATE FOR FULL LENGTH OF WALL.
- 2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS.
- R14 (RSI 2.46) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A.)
- CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
- 1/2" (12.7mm) GYPSUM BOARD.
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. 58-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
 - ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6. BETWEEN RIGID INSULATION AND WOOD STUD.
 - REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

- REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
 - NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
- OR
- VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING ON EXTERIOR SIDE OF RIGID INSULATION

FRAME WALL CONSTRUCTION @ GARAGE:

- O.B.C. 9.23.
- SIDING OR STUCCO AS PER ELEVATIONS, MIN. 7/8" (200mm) FROM FINISHED GRADE (O.B.C. 9.28.1.4. & 9.27)
- WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
- 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6.
- 2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. 58-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
 - ADD ABSORPTIVE MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

REQ. FOR FIRE RATING (LESS THAN 2'-0" LIMITING DISTANCE):

- REFER TO REQUIREMENTS FOR LESS THAN 4'-0" LIMITING DISTANCE AND ADD/REPLACE THE FOLLOWING:
 - NON-COMBUSTIBLE SIDING OR STUCCO AS PER ELEVATIONS (REFER TO MANUFACTURER'S SPECIFICATIONS).
- OR
- VINYL SIDING IS PERMITTED PER O.B.C. 9.10.15.5.(3). OVER SHEATHING PAPER OVER 1/2" (12.7mm) GYPSUM EXTERIOR SHEATHING WHICH REPLACES EXTERIOR PLYWOOD OR EQUIV.

BRICK VENEER CONSTRUCTION:

- O.B.C. 9.23.
- 3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
- MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
- PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BLM. COURSE & OVER OPENINGS
- BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
- BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
- 1" (25mm) AIR SPACE
- WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
- 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6
- 2" X 6" (38mm X 140mm) WOOD STUDS @ 16" (400mm) O.C.
- MIN. R22 (RSI 3.87) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A)
- CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 3 + 1 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. 58-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
 - REPLACE R22 (RSI 3.87) INSULATION WITH R22 (RSI 3.87) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 4.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

ALTERNATE BRICK VENEER CONSTRUCTION:

- O.B.C. 9.23.
- 3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
- MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
- PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BLM. COURSE & OVER OPENINGS
- BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
- BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
- 1" (25mm) AIR SPACE
- 1 1/2" (38mm) RB (RSI 1.41) RIGID INSULATION W/ TAPED JOINTS (O.B.C. 9.27.3.4)
- 2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C. @ 12" (300mm) O.C. ON BOTTOM FLR. WHEN 3 STOREYS
- BRACE W/ CONT. 16 GAUGE STEEL T BRACES FROM TOP PLATE TO BLM. PLATE FOR THE FULL LENGTH OF WALL, OR CONT. 2" X 4" (38mm X 89mm) SOLID WOOD BLOCKING @ APPROXIMATELY 45 DEG. FROM TOP PLATE TO BLM. PLATE FOR FULL LENGTH OF WALL
- R14 (RSI 2.46) INSULATION (ZONE 1, O.B.C. T.2.1.1.2.A.)
- CONTINUOUS AIR/VAPOUR BARRIER IN CONFORMANCE W/ O.B.C. 9.25.3. & 9.25.4.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

REQ. FOR FIRE RATING (LESS THAN 4'-0" LIMITING DISTANCE):

- O.B.C. 58-3 WALL = EW1b (STC = N/A, FIRE = 45 MIN)
- FOR 45 MINUTE FIRE RATED WALL REQUIREMENTS SUBSTITUTE AND/OR ADD THE FOLLOWING MATERIALS:
 - ADD 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6. BETWEEN RIGID INSULATION AND WOOD STUD.
 - REPLACE R14 (RSI 2.46) INSULATION WITH R14 (RSI 2.46) ABSORPTIVE INSULATING MATERIAL WITH A MASS OF AT LEAST 2.8 kg/ sq.m.
 - REPLACE 1/2" (12.7mm) GYPSUM BD. W/ 1/2" (12.7mm) TYPE 'X' GYPSUM BD.

BRICK VENEER CONSTRUCTION @ GARAGE:

- O.B.C. 9.23.
- 3-1/2" (90mm) FACE BRICK OR 4" (100mm) STONE @ 36-1" (11m) MAX. HEIGHT
- MIN. 0.03" (0.76mm) THICK, 7/8" (22mm) WIDE CORROSION RESISTANT STRAPS @ MAX. 15 3/4" (400mm) O.C. HORIZONTAL & 23 5/8" (600mm) O.C. VERTICAL SPACING
- PROVIDE WEEP HOLES @ 2'-7" (800mm) O.C. @ BLM. COURSE & OVER OPENINGS
- BASE FLASHING UP TO 5/8" (150mm) BEHIND WALL SHEATHING MEMBRANE (O.B.C. 9.20.13.6.(2))
- BRICK OR STONE SILLS UNDER OPENINGS, FLASHING UNDER
- 1" (25mm) AIR SPACE
- WALL SHEATHING MEMBRANE AS PER O.B.C. 9.27.3.2.
- 1/4" (6mm) PLYWOOD (EXTERIOR TYPE) OR EQUIVALENT AS PER O.B.C. 9.23.1.6
- 2" X 4" (38mm X 89mm) WOOD STUDS @ 16" (400mm) O.C.
- 1/2" (12.7mm) GYPSUM BOARD
- NOTE - SUPPORT FOR 2 + 3 FLOORS ABOVE - O.B.C. 1.9.23.10.1. =
- FOR 2 FLOORS SUPPORTED ABOVE, 2" X 4" (38mm X 89mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.
- FOR 3 FLOORS SUPPORTED ABOVE, 2" X 6" (38mm X 140mm) STUDS ARE REQUIRED TO BE SPACED @ 12" (300mm) O.C.

THESE DRAWINGS ARE NOT TO BE SCALED. ALL DIMENSIONS MUST BE VERIFIED BY THE CONTRACTOR PRIOR TO COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE REPORTED DIRECTLY TO THE DESIGN LTD.

CLIENT SPECIFIC REVISIONS

I, ERIC SCHNEIDER DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RM DESIGN LTD. UNDER DIVISION C, PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 26955
DATE: MAR-13-15

SIGNATURE:

client
Senator Homes

project
BATHURST 9130

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4-Sep-14	kh	sh	5				
2	ISSUED FINAL	13-Mar-15	gh	sh	6				
3					7				
4					8				

location
Vaughan

marketing name
Madison

RM design
Imagine • Inspire • Create

model
TH -23-2

scale
3/4" = 1'-0"

project #
12073

page

D1

- 43) **EXTERIOR GUARDS @ JULIET BALCONY:**
- FOR RAILING SPANNING MAXIMUM OF 6'-0".
 - PROVIDE PREFIN. METAL RAILING W/ 75mm VERTICAL OPENING TO CONFORM WITH O.B.C. APPENDIX A-9.B.3.
 - FOR DWELLING UNITS GUARDS TO BE 2'-11" (660mm) WHERE FLOOR TO GRADE DIFFERENCE IS LESS THAN 5'-11" (1800mm) AS PER O.B.C. 9.B.3.2. OR
 - FOR DWELLING UNITS GUARDS TO BE 3'-6" WHERE FLOOR TO GRADE DIFFERENCE IS 5'-11" (1800mm) OR GREATER AS PER O.B.C. 9.B.3.2.
 - VERTICAL END RAILING ANCHORED TO CORNER DOUBLE STUDS USING 3 ROWS OF 3/8" Ø MIN. ANCHOR BOLTS EQUALLY SPACED WITH 3' MIN. SPACING TO STUDS.
 - PROVIDE SAME ANCHOR BOLTS @ 36" O.C. FOR BASE PLATE CONNECTION.
- 43) LINEN CLOSET 4 SHELVES MIN. 1'-2" (350mm) DEEP
- 43) WASHROOMS TO BE MECHANICALLY VENTED TO PROVIDE AT LEAST ONE AIR CHANGE PER HOUR, O.B.C. 9.32.1.3.(3)
- 43) CAPPED DRYER VENT
- 43) 1"x2" (19mmx38mm) BOTH SIDES OF STEEL
- 43) WOOD FRAMING MEMBERS SUPPORTED ON CONCRETE IN CONTACT WITH GROUND OR FILL SHALL BE PRESSURE TREATED OR SEPARATED FROM CONCRETE W/ 6 mil POLYETHYLENE
- 43) PRECAST CONCRETE STEP
- 43) 2 RISERS MAXIMUM PERMITTED TO BE LAID ON GROUND
- 43) SMOKE ALARM, O.B.C. 9.10.19.
- 43) PROVIDE 1 ON EACH FLOOR INCLUDING BASEMENTS
- 43) PROVIDE 1 IN EACH BEDROOM
- 43) PROVIDE 1 IN EACH HALLWAY SERVING BEDROOMS
- 43) ALARMS TO BE CONNECTED IN CIRCUIT AND INTERCONNECTED SO ALL ALARMS WILL BE ACTIVATED IF ANY ONE OF THEM SOUNDS.
- 43) ALARMS MUST BE HARDWIRED AND HAVE AN ALTERNATE POWER SOURCE THAT CAN POWER ALARM FOR 7 DAYS, FOLLOWED BY 4 MINUTES OF ALARM
- 43) CARBON MONOXIDE ALARM (CMA), O.B.C. 9.33.4.
- 43) WHERE THERE IS A FUEL BURNING APPLIANCE A CMA SHALL BE PROVIDED ADJACENT TO EACH SLEEPING AREA.
- 43) CMA TO BE WIRLED IN CIRCUIT TO SOUND SMOKE ALARMS WHEN ACTIVATED.
- 43) MAIN DOOR TO BE OPERABLE FROM INSIDE W/O UT KEY
- 43) PROVIDE A VIEWER WITH A VIEWING ANGLE OF NOT LESS THAN 160 DEG. UNLESS GLAZING IS PROVIDED IN DOOR OR A SIDE LIGHT IS PRESENT.
- 43) R4 (RSI 0.70) WHERE A STORM DOOR IS NOT PROVIDED
- 43) GARAGE MAIN DOORS TO BE GAS PROOFED WITH SELF CLOSER, WEATHERSTRIPPING, THRESHOLD & DEAD BOLT PER O.B.C. 9.10.13.15.
- 43) R4 (RSI 0.70)
- 43) TRAVEL FROM A FLOOR LEVEL TO AN EXIT OR EGRESS DOOR SHALL BE LIMITED TO ONE FLOOR EXCEPT:
- 43) 1) WHERE THAT FLOOR LEVEL HAS ACCESS TO A BALCONY OR
- 43) 2) WHERE THAT FLOOR LEVEL HAS A WINDOW PROVIDING AN UNOBSTRUCTED OPENING OF NOT LESS THAN 3'-3" (1000mm) IN HEIGHT AND 21 5/8" (550mm) IN WIDTH. SUCH WINDOW SHALL BE LOCATED SO THAT THE SILL IS NOT MORE THAN 3'-3" (1000mm) ABOVE FLOOR AND 23'-0" (7000mm) ABOVE ADJACENT GROUND LEVEL.

- 49) **EXTERIOR COLUMN W/ MASONRY PIER:**
- MIN. 6"x6" (140mm X 140mm) WOOD POST ANCHORED TO PORCH SLAB W/ METAL SADDLE.
 - TOP PORTION OF POST CLAD W/ DECOR. SURROUND PER ELEVATION DRAWINGS.
 - 14" X 14" MASONRY VENER SURROUND W/ PRECAST CONCRETE CAP.
 - REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
 - SURROUND TO BE TIED W/ METAL TIES @ 16" (400mm) O.C. VERT. INSTALLED PER O.B.C. 9.20.9.4.
 - 3/4" AIR SPACE AROUND POST.
 - OR
 - MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO CONC. CAP W/ METAL SADDLE.
 - 14" X 14" MASONRY PIER TO BE CONSTRUCTED SOLID W/ PRECAST CONCRETE CAP.
 - REFER TO ELEVATION DRAWINGS FOR HEIGHT OF CAP.
 - NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" POST PROVIDED THAT THEY ARE IN CONFORMANCE WITH O.B.C. 9.17.4.
- 49) **EXTERIOR COLUMN:**
- MIN. 6"x6" (140mm X 140mm) WOOD POST CLAD W/ DECOR. SURROUND (PER ELEVATION DRAWINGS) ANCHORED TO PORCH SLAB W/ METAL SADDLE
 - NOTE: DECORATIVE STRUCTURAL COLUMNS MAY REPLACE 6" X 6" ABOVE PROVIDED THAT THEY ARE IN ACCORDANCE WITH O.B.C. 9.17.4.
- 50) **COLD CELLARS:**
- FOR COLD CELLARS PROVIDE THE FOLLOWING:
- VENTING AREA TO BE EQUIVALENT TO 0.2% OF COLD CELLAR AREA.
 - COVER VENT W/ BUG SCREEN
 - WALL MOUNTED LIGHT FIXTURE
 - 11"x7" FOR DOOR OPENING
 - 2'-8" X 4'-8" EXTERIOR TYPE DOOR (MIN. R-4 RSI 0.7)
 - INSULATE FULL HEIGHT OF INTERIOR BASEMENT WALL W/ MIN. R12 (RSI 2.11)
- 51) **STUD WALL REINFORCEMENT:**
- O.B.C. 9.3.2.3.
- WALL STUDS ADJACENT TO WATER CLOSETS & SHOWER BATH TUBS IN MAIN BATHROOM ARE TO BE REINFORCED TO PERMIT THE FUTURE INSTALLATION OF GRAB BARS AS PER O.B.C. 3.8.3.8.(1)(d) & 3.8.3.13.(1)(f)
 - GRAB BARS TO BE INSTALLED AS PER O.B.C. 9.B.7.7.(2)

- BEAMS MAY BE A MAX. 2" (50mm) FROM LOADBEARING WALLS WHEN WALLS ARE PERPENDICULAR TO FLOOR JOISTS
- APPROVED METAL HANGERS TO BE USED FOR JOISTS AND BEAMS WHEN THEY FRAME INTO SIDES OF BEAMS, TRIMMERS AND HEADERS
- FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 15 3/4" (400mm) BEYOND SUPPORTS FOR 2" X 8" (58mm X 184mm)
- FLOOR JOISTS SUPPORTING ROOF LOADS SHALL NOT BE CANTILEVERED MORE THAN 23 5/8" (600mm) BEYOND SUPPORTS FOR 2" X 10" (38mm X 235mm) OR LARGER.

- WINDOWS:**
- WINDOWS TO BE SEALED TO THE AIR & VAPOR BARRIER
 - WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 1.8 W/(m2.K) OR
 - AN ENERGY RATING OF NOT LESS THAN 21 FOR OPERABLE WINDOWS & 31 FOR FIXED WINDOWS
 - BASEMENT WINDOWS WITH LOAD BEARING STRUCTURAL FRAME SHALL BE DOUBLE GLAZED WITH LOW-E COATINGS
 - SKYLIGHTS SHALL HAVE AN OVERALL COEFFICIENT OF HEAT TRANSFER OF 2.8 W/(m2.K)
 - FOR GROSS GLAZED AREAS LESS THAN 17%

- ADDITIONAL COMPLIANCE ALTERNATIVES FOR PACKAGE 1:**
- a) THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT THE THERMAL INSULATION VALUE IN BASEMENT WALLS HAS A MINIMUM R20 (RSI 3.52).
 - OR
 - WHERE BLOWN-IN INSULATION OR SPRAY-APPLIED FOAM INSULATION IS USED, THE MINIMUM R (RSI) VALUE FOR THERMAL INSULATION IN EXPOSED ABOVE GRADE WALLS IS PERMITTED TO BE NO LESS THAN R20 (RSI 3.52) PROVIDED THAT:
 - c) THE THERMAL INSULATION VALUE IN A CEILING WITH AN ATTIC SPACE IS NOT LESS THAN R20 (RSI 3.52).
 - b) THE MINIMUM EFFICIENCY OF THE HRV IS INCREASED BY NOT LESS THAN 8 PERCENTAGE POINTS.
 - c) THE MINIMUM AFUE OF THE SPACE HEATING EQUIPMENT IS INCREASED BY NOT LESS THAN 2 PERCENTAGE POINTS.
 - d) THE MINIMUM EFF. OF THE DOMESTIC HOT WATER HEATER IS INCREASED BY NOT LESS THAN 4 PERCENTAGE POINTS.

FRAME CONSTRUCTION:

- ALL FRAMING LUMBER TO BE No.1 AND No. 2 SPF UNLESS NOTED OTHERWISE.
- ROOF LOADING IS BASED ON 1.5kPa SPECIFIED COMPOSITE SNOW AND RAIN LOADS.
- JOISTS TO HAVE MIN. 1-1/2" (38mm) END BEARING
- BEAMS TO HAVE MIN. 3-1/2" (89mm) END BEARING
- DOUBLE STUDS @ OPENINGS
- DOUBLE HEADER JOISTS AROUND FLOOR OPENINGS WHEN THEY ARE BETWEEN 3'-11" (1200mm) AND 10'-6" (3200mm)
- DOUBLE TRIMMER JOISTS WHEN HEADER JOIST LENGTH IS BETWEEN 2'-7" (800mm) AND 4'-7" (1400mm)
- DOUBLE JOISTS OR SOLID BLOCKING UNDER NON-LOAD BEARING PARALLEL PARTITIONS
- BEAMS TO BE PLACED UNDER LOADBEARING WALLS WHEN WALLS ARE PARALLEL TO FLOOR JOISTS

CLIENT SPECIFIC REVISIONS

DOORS 44) 47)	
A	865/2030x45 (2'10"x6'8"x1-3/4")
B	815/2030x35 (2'8"x6'8"x1-3/8")
C	760/2030x35 (2'6"x6'8"x1-3/8")
D	710/2030x35 (2'4"x6'8"x1-3/8")
E	460/2030x35 (1'6"x6'8"x1-3/8")
F	610/2030x35 (2'0"x6'8"x1-3/8")
G	COVER SIZED EXTERIOR DOOR

STEEL BEAMS	
S1	W 6 X 15
S2	W 6 X 20
S3	W 8 X 18
S4	W 8 X 21
S5	W 8 X 24

SCHEDULES

WOOD BEAMS	
WD1	3/2" X 8" SPR
WD2	4/2" X 8" SPR
WD3	5/2" X 8" SPR
WD4	3/2" X 10" SPR
WD5	4/2" X 10" SPR
WD6	5/2" X 10" SPR
WD7	3/2" X 12" SPR
WD8	4/2" X 12" SPR

LINTELS	
L1	2/2" X 8" SPR
L2	2/2" X 10" SPR
L3	2/2" X 12" SPR
L4	3-1/2" X 3-1/2" X 1/4" L
L5	4" X 3-1/2" X 1/4" L
L6	4-7/8" X 3-1/2" X 5/16" L
L7	4-7/8" X 3-1/2" X 3/8" L
L8	4-7/8" X 3-1/2" X 1/2" L
L9	5-7/8" X 3-1/2" X 3/8" L
L10	5-7/8" X 3-1/2" X 1/2" L
L11	4-7/8" X 3-1/2" X 3/8" L
L12	4-7/8" X 3-1/2" X 1/2" L
L13	5-7/8" X 3-1/2" X 3/8" L
L14	5-7/8" X 3-1/2" X 1/2" L

- SMOKE ALARM 44)
- WATERPROOF DUPLEX OUTLET
- VENTS AND INTAKES
- HOSE BIB
- EXHAUST FAN
- COLD CELLAR VENT 50)
- STOVE VENT
- FIRE PLACE VENT
- DRYER VENT

PLAN/ELEVATION LEGEND

- CARBON MONOXIDE ALARM (CMA) 45)
- D.J. DOUBLE JOIST
- P.T. PRESSURE TREATED LUMBER
- G.T. GIRDER TRUSS
- A.F.F. ABOVE FINISHED FLOOR
- EXT. LIGHT FIXTURE (WALL MOUNTED)
- HYDRO TUBER
- GLAZED VENT
- FLOOR DRAIN
- SOLID BEARING (NOT ALLOWED AS SUPPORTED ELEMENT)
- POINT LOAD
- FLAT ARCH
- 2 STORY WALL
- U/S UNDER SIDE
- FG FIXED GLAZING
- GB GLASS BLOCK
- BG BLACK GLASS

I, FRANK SCHNEIDER DECLARE THAT I HAVE REVIEWED AND TAKEN DESIGN RESPONSIBILITY FOR THE DESIGN WORK ON BEHALF OF RN DESIGN LTD. UNDER DIVISION C PART 3 SUBSECTION 3.2.4 OF THE BUILDING CODE. I AM QUALIFIED AND THE FIRM IS REGISTERED IN THE APPROPRIATE CLASSES / CATEGORIES.

QUALIFIED DESIGNER BCIN: 30840
FIRM BCIN: 26995
DATE: MAR-13-15

SIGNATURE

Client
Senator Homes

project
BATHURST 9130

#	revisions	date	dwn	chk	#	revisions	date	dwn	chk
1	REVISED FLOOR HEIGHTS	4-Sep-14	kh	sh	5				
2	ISSUED FINAL	13-Mar-15	sh	sh	6				
3					7				
4					8				

location
Vaughan

marketing name
Madison

RN design
Imagine • Inspire • Create

model
TH -23-2

scale
3/16" = 1'0"

project #
12073

page

D3