

FROM PLAN DATED: OCT 2018

BUILDER: GREENPARK

SITE: SECONDO VALES ESTATES

MODEL: GLENWAY 12A

ELEVATION: 2

LOT: 12

CITY: EAST GWILLIMBURY

SALESMAN: M D

DESIGNER: CF

REVISION: lbv

NOTES:

REFER TO THE **NORDIC INSTALLATION** GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²


DEAD LOAD: 15.0 lb/ft²

TILED AREAS: 20 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED


DATE: 2019-01-07

1st FLOOR

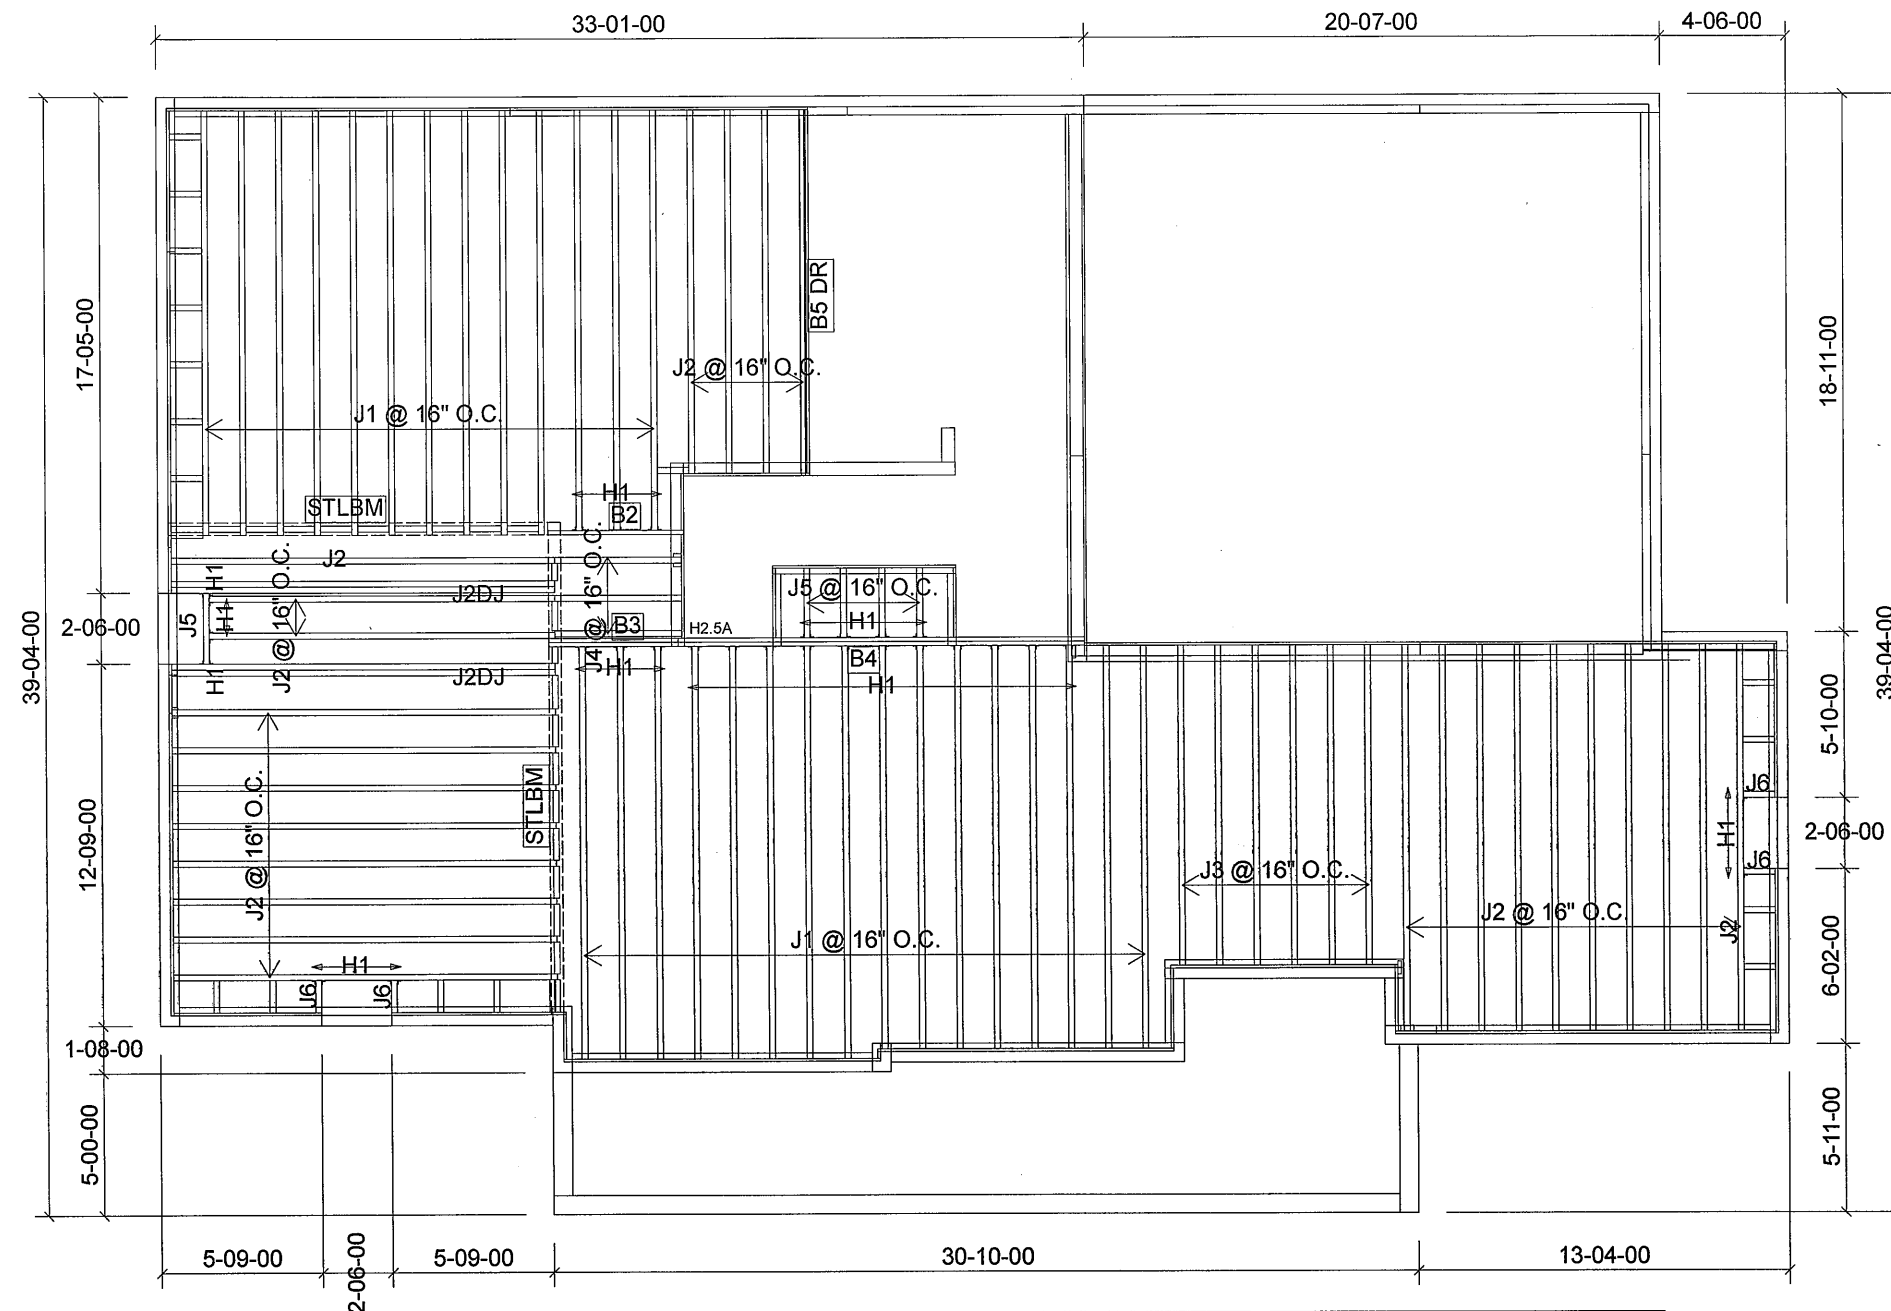

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	29
J2	14-00-00	9 1/2" NI-40x	1	25
J2DJ	14-00-00	9 1/2" NI-40x	2	4
J3	12-00-00	9 1/2" NI-40x	1	6
J4	6-00-00	9 1/2" NI-40x	1	3
J5	4-00-00	9 1/2" NI-40x	1	5
J6	2-00-00	9 1/2" NI-40x	1	4
B4	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B5 DR	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
3	H1	IUS2.56/9.5
18	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
6	H1	IUS2.56/9.5
1	H2.5A	H2.5A*

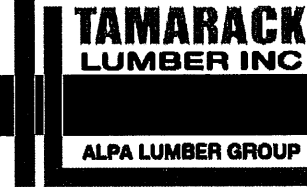

FROM PLAN DATED: OCT 2018

BUILDER: GREENPARK

SITE: SECONDO VALES ESTATES

MODEL: GLENWAY 12A

ELEVATION: 2

LOT: 12

CITY: EAST GWILLIMBURY

SALESMAN: M D

DESIGNER: CF

REVISION: lbv


NOTES:
REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2019-01-07

2nd FLOOR

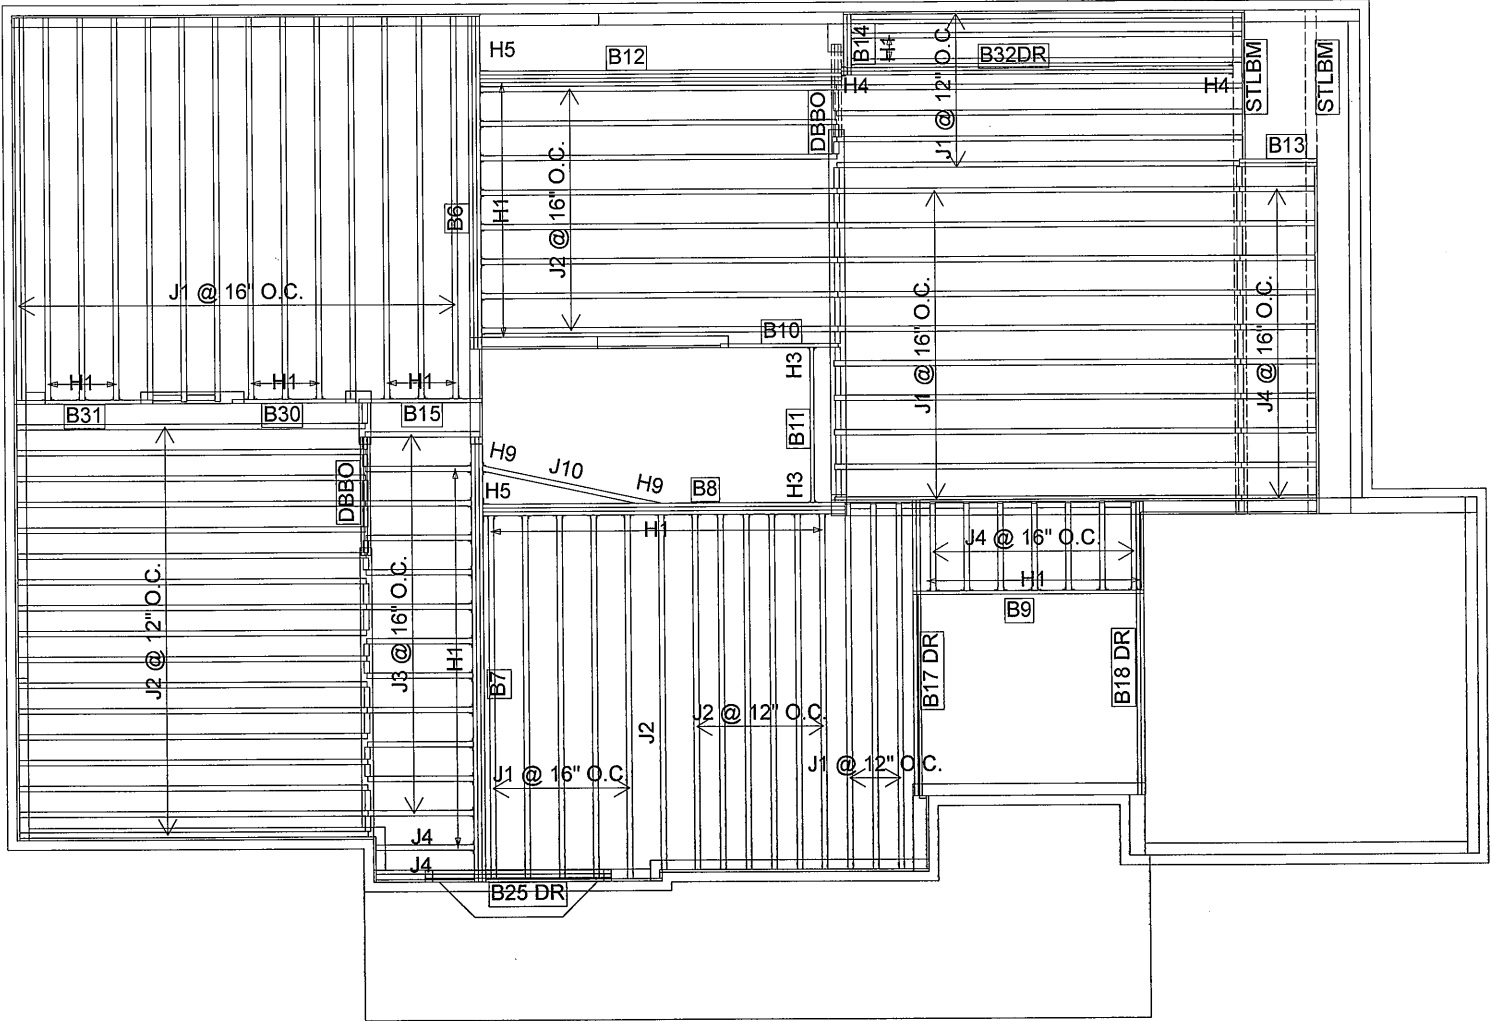


Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	39
J2	14-00-00	9 1/2" NI-40x	1	32
J10	8-00-00	9 1/2" NI-40x	1	1
J3	6-00-00	9 1/2" NI-40x	1	12
J4	4-00-00	9 1/2" NI-40x	1	19
B7	18-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B32DR	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B12	16-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	4	4
B6	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B17 DR	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B18 DR	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B9	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B25 DR	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B11	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B15	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B30	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B31	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B13	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B14	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
16	H1	IUS2.56/9.5
2	H1	IUS2.56/9.5
32	H1	IUS2.56/9.5
1	H3	HUS1.81/10
1	H3	HUS1.81/10
1	H4	HGUS410
1	H4	HGUS410
1	H5	HGUS5.50/10
1	H5	HGUS5.50/10
1	H9	LS90
1	H9	LS90



INSTALLATION GUIDE FOR RESIDENTIAL FLOORS

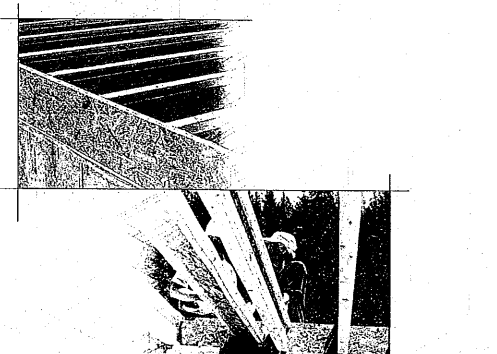


Distributed by:



SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.



Never stack building materials over unbraced I-joists. Once sheathed, do not over-stress I-joist with concentrated loads from building materials.

WARNING

I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

Avoid Accidents by Following these Important Guidelines:

1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Top ends of adjoining bracing over at least two I-joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged I-joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to simple-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CBCS-71.26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit States Design per CAN/CSA O86-09 Standard, and NBC 2010.
7. SI units conversion: 1 inch = 25.4 mm
1 foot = 0.305 m


MAXIMUM FLOOR SPANS FOR NORDIC I-JOISTS SIMPLE AND MULTIPLE SPANS

Joist Depth	Joist Series	Simple spans On centre spacing				Multiple spans On centre spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	Ni-20	15'-1"	14'-2"	13'-9"	13'-5"	16'-3"	15'-4"	14'-10"	14'-7"
	Ni-40x	16'-1"	15'-2"	14'-9"	14'-5"	17'-5"	16'-5"	15'-10"	15'-5"
	Ni-60	16'-3"	15'-4"	14'-10"	14'-11"	17'-7"	16'-7"	16'-0"	16'-1"
	Ni-70	17'-1"	16'-1"	15'-6"	15'-7"	18'-7"	17'-4"	16'-5"	16'-10"
	Ni-80	17'-3"	16'-3"	15'-8"	15'-9"	18'-10"	17'-6"	16'-11"	17'-0"
11-7/8"	Ni-20	16'-11"	16'-0"	15'-5"	15'-4"	18'-4"	17'-3"	16'-8"	16'-7"
	Ni-40x	18'-1"	17'-0"	16'-5"	16'-4"	20'-0"	18'-6"	17'-9"	17'-7"
	Ni-60	18'-4"	17'-3"	16'-7"	16'-9"	20'-3"	18'-9"	18'-0"	18'-1"
	Ni-70	19'-6"	18'-0"	17'-4"	17'-5"	21'-6"	19'-11"	19'-0"	19'-1"
	Ni-80	19'-9"	18'-3"	17'-6"	17'-7"	21'-9"	20'-2"	19'-3"	19'-4"
14"	Ni-90	20'-2"	18'-7"	17'-10"	17'-11"	22'-3"	20'-7"	19'-8"	19'-9"
	Ni-90x	20'-4"	18'-9"	17'-11"	18'-0"	22'-5"	20'-9"	19'-10"	19'-11"
	Ni-40x	20'-1"	18'-7"	17'-10"	17'-11"	22'-2"	20'-6"	19'-8"	19'-4"
	Ni-60	20'-5"	18'-11"	18'-1"	18'-2"	22'-7"	20'-11"	20'-0"	20'-1"
	Ni-70	21'-7"	20'-0"	19'-1"	19'-2"	23'-10"	22'-1"	21'-1"	21'-2"
16"	Ni-80	21'-11"	20'-3"	19'-4"	19'-5"	24'-3"	22'-5"	21'-5"	21'-6"
	Ni-90	22'-5"	20'-9"	19'-9"	19'-10"	24'-9"	22'-10"	21'-10"	21'-10"
	Ni-90x	22'-7"	21'-1"	19'-11"	20'-0"	25'-0"	22'-1"	22'-0"	22'-2"
	Ni-60	22'-3"	20'-8"	19'-9"	19'-10"	24'-7"	22'-9"	21'-9"	21'-10"
	Ni-70	23'-6"	21'-9"	20'-9"	20'-10"	26'-0"	24'-0"	22'-11"	23'-0"

CCMC EVALUATION REPORT 13032-R


I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the I-joist.



STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
 - Pick I-joists in bundles as shipped by the supplier.
 - Orient the bundles so that the webs of the I-joists are vertical.
 - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.

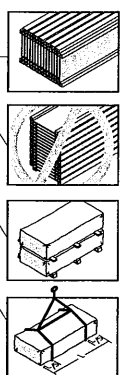

WEB STIFFENERS

RECOMMENDATIONS:


■ A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.

■ A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.

■ A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm

FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

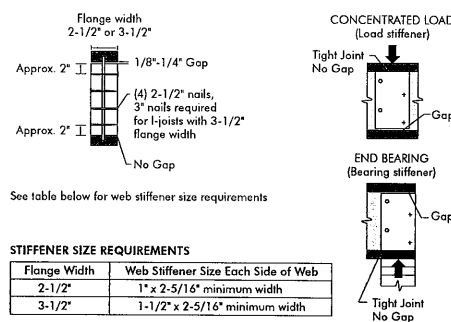


See table below for web stiffener size requirements

STIFFENER SIZE REQUIREMENTS

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width

NORDIC I-JOIST SERIES

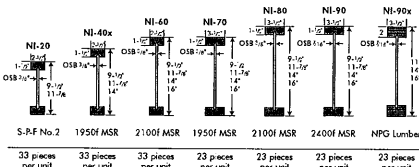



Chantiers Chibougamau Ltd. harvests its own trees, which enables Nordic products to adhere to strict quality control procedures throughout the manufacturing process. Every phase of the operation, from forest to the finished product, reflects our commitment to quality.

Nordic Engineered Wood I-joists use only finger-jointed lumber in their flanges, ensuring consistent quality, superior strength and longer span carrying capacity.

INSTALLING NORDIC I-JOISTS


1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, supplier.
2. Except for cutting to length, I-joist flanges should **never** be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple-span applications must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge **may never** be used as blocking or rim boards. I-joist blocking panels or other engineered wood products—such as rim board—must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.

FIGURE 1
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

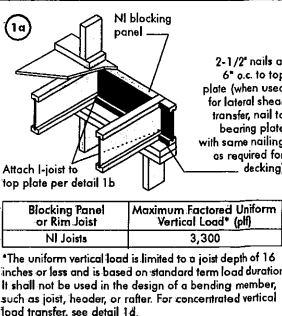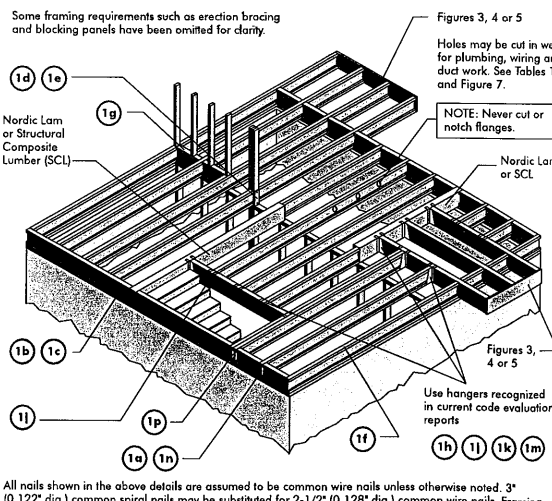



Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
Ni Joists	3,300

*The uniform vertical load is limited to a joist depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

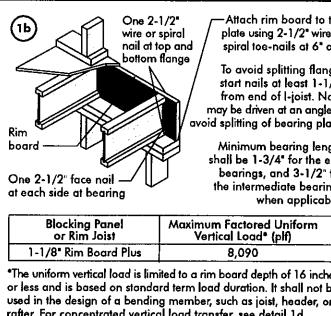













Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
1-1/8" Rim Board Plus	8,090

*The uniform vertical load is limited to a rim board depth of 16 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

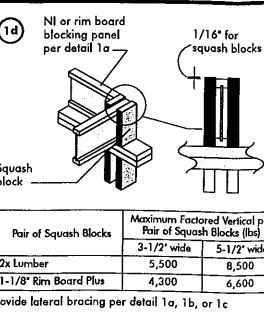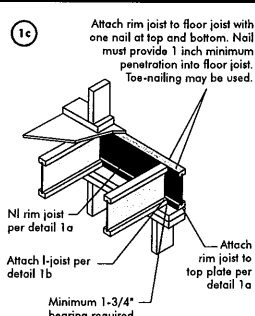

Pair of Squash Blocks	Maximum Factored Vertical per Pair of Squash Blocks (lbs)
2x Lumber	5,500
1-1/8" Rim Board Plus	4,300


Provide lateral bracing per detail 1a, 1b, or 1c

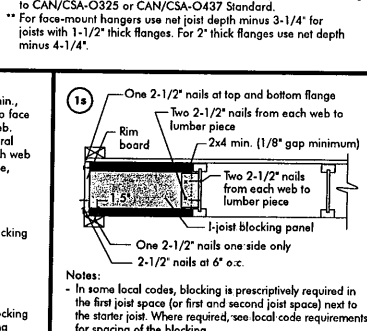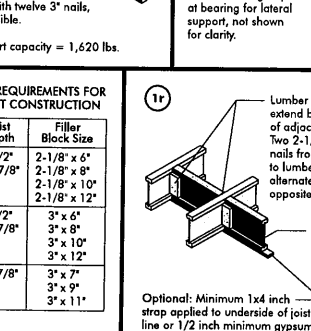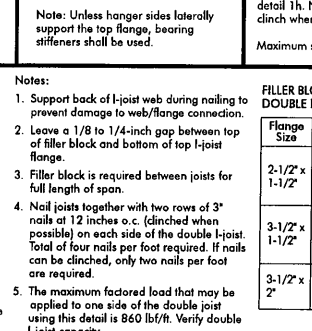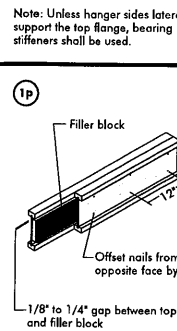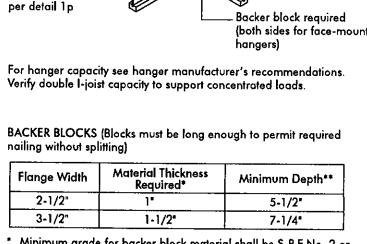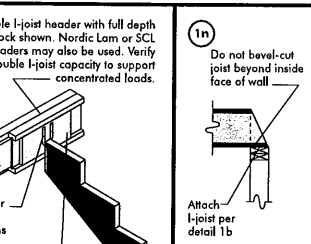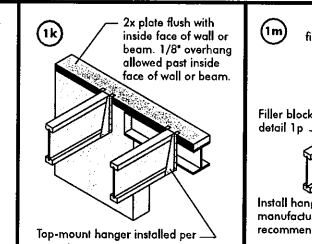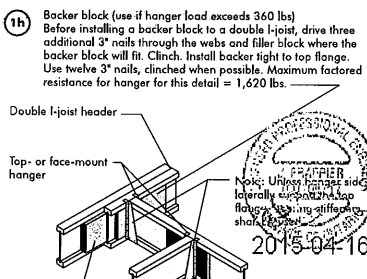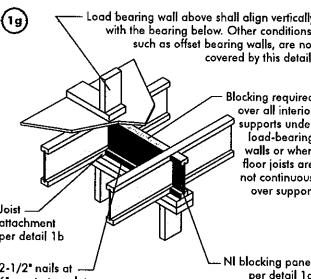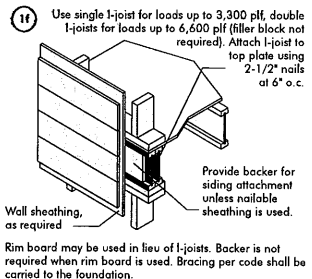


Notes:
- In some local codes, blocking is prescriptively required in the first joist space (or first and second joist space) next to the starter joist. Where required, see local code requirements for spacing of the blocking.
- All nails are common spiral in this detail.

CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

3a I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

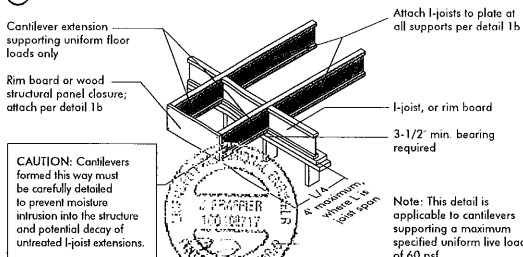


3b LUMBER CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

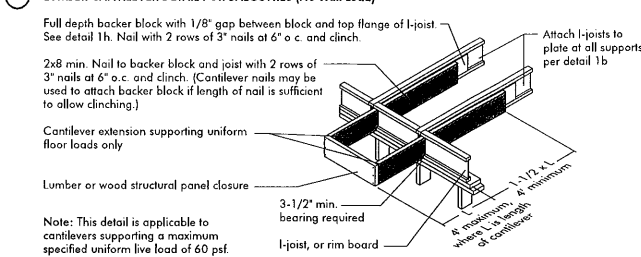

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

4a Method 1 — SHEATHING REINFORCEMENT ONE SIDE

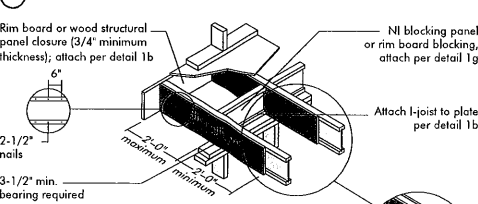


Method 2 — SHEATHING REINFORCEMENT TWO SIDES

- Use same installation as Method 1 but reinforce both sides of I-joist with sheathing.
- Use nailing pattern shown for Method 1 with opposite face nailing offset by 3 inches.

Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4 inch) required on sides of joist. Depth shall match the full height of the joist. Nail with 2-1/2 inch nails at 6 inch o.c., top and bottom flange. Install with face grain horizontal. Attach I-joist to plate at all supports per detail 1b. Verify reinforced I-joist capacity.

4b Alternate Method 2 — DOUBLE I-JOIST

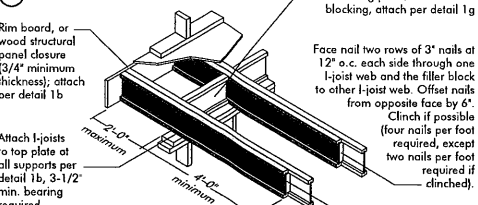

Block I-joists together with filler blocks for the full length of the reinforcement. For I-joist flange widths greater than 3 inches place an additional row of 3 inch nails along the centreline of the reinforcing panel from each side. Clinch when possible.

FIGURE 4 (continued)




CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft)	LL = 30 psf, DL = 15 psf				LL = 40 psf, DL = 15 psf				LL = 50 psf, DL = 15 psf			
		12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
9-1/2"	26	N	N	1	2	N	1	2	X	N	2	X	X
	28	N	N	1	X	N	1	2	X	N	2	X	X
	30	N	1	1	X	N	1	2	X	N	2	X	X
	32	N	1	2	X	N	2	X	X	N	2	X	X
	34	N	1	2	X	N	2	X	X	N	2	X	X
11-7/8"	26	N	N	1	2	N	1	2	X	N	2	X	X
	28	N	N	1	1	N	N	1	2	N	1	1	2
	30	N	N	1	1	N	N	1	2	N	1	2	X
	32	N	N	1	1	N	N	1	2	N	1	2	X
	34	N	N	1	1	N	N	1	2	N	1	2	X
14"	26	N	N	1	2	N	1	2	X	N	2	X	X
	28	N	N	1	1	N	N	1	1	N	N	1	1
	30	N	N	1	1	N	N	1	1	N	N	1	2
	32	N	N	1	1	N	N	1	1	N	N	1	2
	34	N	N	1	1	N	N	1	1	N	N	1	2
16"	26	N	N	1	2	N	1	2	X	N	2	X	X
	28	N	N	1	1	N	N	1	1	N	N	1	1
	30	N	N	1	1	N	N	1	1	N	N	1	2
	32	N	N	1	1	N	N	1	1	N	N	1	2
	34	N	N	1	1	N	N	1	1	N	N	1	2


- N = No reinforcement required.
- = NI reinforced with 3/4" wood structural panel on one side only.
- = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
- X = Try a deeper joist or closer spacing.
- Maximum design load shall be: 15 psf roof dead load, 55 psf floor total load, and 80 psf wall load. Wall load is based on 3'-0" maximum width window or door openings.
- For larger openings, or multiple 3'-0" width openings spaced less than 6'-0" o.c., additional joists beneath the opening's cripple studs may be required.
- Table applies to joists 12" to 24" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use 12" o.c. requirements for lesser spacing.
- For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam. When the roof is framed using a ridge beam, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
- Cantilevered joists supporting girder trusses or roof beams may require additional reinforcing.

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

5a SHEATHING REINFORCEMENT

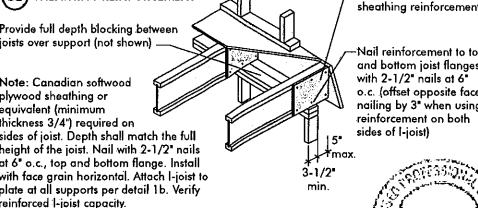

5b SET-BACK DETAIL

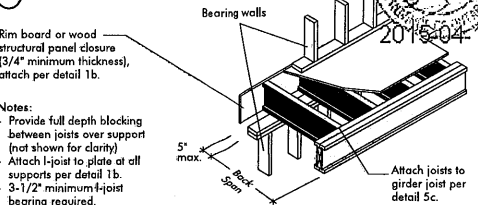

5c SET-BACK CONNECTION


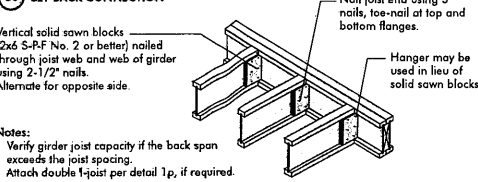


FIGURE 5 (continued)



BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft)	LL = 30 psf, DL = 15 psf				LL = 40 psf, DL = 15 psf				LL = 50 psf, DL = 15 psf			
		12	16	19.2	24	12	16	19.2	24	12	16	19.2	24
9-1/2"	26	1	X	X	X	2	X	X	X	2	X	X	X
	28	1	X	X	X	2	X	X	X	2	X	X	X
	30	1	X	X	X	2	X	X	X	2	X	X	X
	32	2	X	X	X	2	X	X	X	2	X	X	X
	34	2	X	X	X	2	X	X	X	2	X	X	X
11-7/8"	26	N	1	2	X	N	1	2	X	N	2	X	X
	28	N	2	X	X	N	1	2	X	N	2	X	X
	30	1	2	X	X	N	2	X	X	N	2	X	X
	32	1	2	X	X	N	2	X	X	N	2	X	X
	34	1	2	X	X	N	2	X	X	N	2	X	X
14"	26	N	1	2	X	N	2	X	X	N	2	X	X
	28	N	2	X	X	N	2	X	X	N	2	X	X
	30	1	2	X	X	N	2	X	X	N	2	X	X
	32	N	2	X	X	N	2	X	X	N	2	X	X
	34	N	2	X	X	N	2	X	X	N	2	X	X
16"	26	N	1	2	X	N	2	X	X	N	2	X	X
	28	N	2	X	X	N	2	X	X	N	2	X	X
	30	N	1	2	X	N	2	X	X	N	2	X	X
	32	N	2	X	X	N	2	X	X	N	2	X	X
	34	N	2	X	X	N	2	X	X	N	2	X	X


- N = No reinforcement required.
- = NI reinforced with 3/4" wood structural panel on one side only.
- = NI reinforced with 3/4" wood structural panel on both sides, or double I-joist.
- X = Try a deeper joist or closer spacing.
- Maximum design load shall be: 15 psf roof dead load, 55 psf floor total load, and 80 psf wall load. Wall load is based on 3'-0" maximum width window or door openings.
- For larger openings, or multiple 3'-0" width openings spaced less than 6'-0" o.c., additional joists beneath the opening's cripple studs may be required.
- Table applies to joists 12" to 24" o.c. that meet the floor span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. Use 12" o.c. requirements for lesser spacing.
- For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam. When the roof is framed using a ridge beam, the Roof Truss Span is equivalent to the distance between the supporting walls as if a truss is used.
- Cantilevered joists supporting girder trusses or roof beams may require additional reinforcing.

WEB HOLES

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- I-joist top and bottom flanges must NEVER be cut, notched, or otherwise modified.
- Whenever possible, field-cut holes should be centred on the middle of the web.
- The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
- The sides of square holes or largest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the longest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
- A knockout is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
- Holes measuring 1/2 inch or smaller shall be permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
- A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
- All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
- Limit three maximum size holes per span, of which one may be a duct chase opening.
- A group of round holes at approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

FIGURE 7 FIELD-CUT HOLE LOCATOR

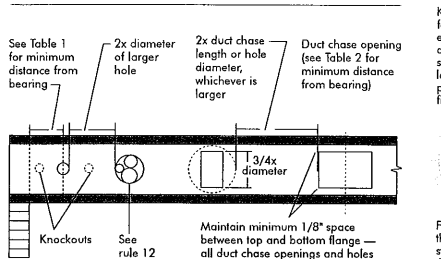

A knockout is NOT considered a hole, may be utilized wherever it occurs and may be ignored for purposes of calculating minimum distances between holes.

Knockouts are precored holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on centre along the length of the I-joist. Where possible, it is preferable to use knockouts instead of field-cut holes.

Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

INSTALLING THE GLUED FLOOR SYSTEM

- Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
- Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
- Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
- Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when topped into place with a block and sledgehammer.
- Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
- Apply two lines of glue on I-joists where panel ends butt to assure proper gluing of each end.
- After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) than used on I-joist flanges.
- Tap the second row of panels into place, using a block to protect groove edges.
- Stagger end joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including T&G edges, is recommended. (Use a spacer tool or an 2-1/2" common nail to assure accurate and consistent spacing.)
- Complete all nailing of each panel before glue sets. Check the manufacturer's recommendations for cure time. (Warm weather accelerates glue setting.) Use 2" ring- or screw-shank nails for panels 3/4-inch thick or less, and 2-1/2" ring- or screw-shank nails for thicker panels. Space nails per the table below. Closer nail spacing may be required by some codes, or for diaphragm construction. The finished deck can be walked on right away and will carry construction loads without damage to the glue bond.

FASTENERS FOR SHEATHING AND SUBFLOORING(1)

Maximum Panel Spacing (in.)	Minimum Panel Thickness (in.)	Common Wire or Spiral Nails	Ring Thread Nails or Screws	Staples	Maximum Spacing of Fasteners	Maximum Spacing of Fasteners
16	5/8	2"	1-3/4"	2"	6"	12"
20	5/8	2"	1-3/4"	2"	6"	12"
24	3/4	2"	1-3/4"	2"	6"	12"

- Fasteners of sheathing and subflooring shall conform to the above table.
- Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
- Flooring screws shall not be less than 1/8-inch in diameter.
- Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
- Use only adhesives conforming to CAN/CGSB-71.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues; check with panel manufacturer.

Ref.: NRC-CNRC, National Building Code of Canada 2010, Table 9.23.3.5.

IMPORTANT NOTE:

Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.

TABLE 1 LOCATION OF CIRCULAR HOLES IN JOIST WEBS Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Joist Depth	Joist Series	Minimum distance from inside face of any support to centre of hole (ft.-in.)												Span adjustment Factor		
		Round hole diameter (in.)														
		2	3	4	5	6	6-1/4	7	8	8-5/8	9	10	10-3/4		11	12
9-1/2"	N-20	0.7	1.4	2.1	4.3	5.8	6.0	---	---	---	---	---	---	---	---	13.6
	N-40x	0.7	1.4	2.1	4.3	6.4	6.4	---	---	---	---	---	---	---	---	14.9
	N-60	1.3	2.6	4.0	5.4	7.0	7.5	---	---	---	---	---	---	---	---	14.11
	N-80	1.3	2.6	4.0	5.4	8.0	8.4	---	---	---	---	---	---	---	---	15.7
	N-100	2.3	3.6	5.0	6.4	8.2	8.8	---	---	---	---	---	---	---	---	15.9
11-7/8"	N-20	0.7	0.8	1.0	2.4	3.8	4.0	5.0	6.4	7.9	---	---	---	---	---	15.4
	N-40x	0.7	0.8	1.3	2.8	4.0	4.4	5.5	7.2	8.4	---	---	---	---	---	16.4
	N-60	0.7	1.5	3.0	4.3	5.9	6.0	7.3	9.1	10.0	---	---	---	---	---	16.9
	N-80	1.3	2.6	4.0	5.4	7.2	7.5	8.6	10.3	11.4	---	---	---	---	---	17.7
	N-100	1.6	2.0	4.2	5.4	7.2	7.5	8.6	10.3	11.4	---	---	---	---	---	18.1
14"	N-20	0.7	0.8	1.5	3.2	4.1	5.4	6.9	8.9	10.2	---	---	---	---	---	17.11
	N-40x	0.7	0.8	1.5	3.2	4.1	5.4	6.9	8.9	10.2	---	---	---	---	---	18.0
	N-60	0.7	0.8	1.0	2.4	2.9	3.9	5.2	6.0	6.8	8.3	10.2	---	---	---	17.11
	N-80	0.7	0.8	1.5	3.2	4.1	5.4	6.9	8.9	10.2	---	---	---	---	---	18.0
	N-100	0.9	1.0	3.0	4.3	5.1	6.2	7.3	8.9	9.9	10.4	12.0	13.6	---	---	19.2
16"	N-20	0.7	0.8	2.0	3.4	4.9	6.2	6.5	7.6	9.0	10.0	10.8	12.4	13.9	---	19.5
	N-40x	0.7	0.8	2.0	3.4	4.9	6.2	6.5	7.6	9.0	10.0	11.4	12.9	14.4	---	19.5
	N-60	0.7	0.8	1.5	3.2	4.1	5.4	6.9	8.9	10.2	---	---	---	---	---	19.2
	N-80	0.7	0.8	1.5	3.2	4.1	5.4	6.9	8.9	10.2	---	---	---	---	---	20.0
	N-100	0.7	0.8	1.5	3.2	4.1	5.4	6.9	8.9	10.2	---	---	---	---	---	20.0
16"	N-20	0.7	0.8	0.8	1.6	2.1	4.2	5.6	6.4	7.0	8.5	9.8	12.2	12.7	13.9	19.10
	N-40x	0.7	0.8	1.2	2.0	2.6	4.2	5.6	6.4	7.0	8.5	9.8	12.2	12.7	13.9	19.10
	N-60	0.7	0.8	1.3	2.6	3.1	5.3	5.6	6.6	8.0	9.0	11.0	12.9	12.9	14.5	16.2
	N-80	0.7	0.8	1.3	2.6	3.1	5.3	5.6	6.6	8.0	9.0	11.0	12.9	11.9	13.9	15.4
	N-100	0.7	0.8	1.3	2.6	3.1	5.3	5.6	6.6	8.0	9.0	11.0	12.9	11.9	13.9	15.4



Refer to the Installation Guide for Residential Floors for additional information.
CCMC EVALUATION REPORT 13032-R

WEB HOLE SPECIFICATIONS

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- I-joist top and bottom flanges must NEVER be cut, notched, or otherwise modified.
- Whenever possible, field-cut holes should be centred on the middle of the web.
- The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
- The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the longest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
- A knock-out is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
- Holes measuring 1-1/2 inches or smaller are permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
- A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
- All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
- Limit three maximum size holes per span, of which one may be a duct chase opening.
- A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

TABLE 1

LOCATION OF CIRCULAR HOLES IN JOIST WEBS

Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Joist Depth	Joist Series	Minimum Distance from Inside Face of Any Support to Centre of Hole (ft - in.)											
		Round Hole Diameter (in.)											
9-1/2"	NI-20	0-7"	1-6"	2-10"	4-3"	5-8"	6-0"	---	---	---	---	---	---
	NI-40x	0-7"	1-6"	3-0"	4-4"	6-0"	6-4"	---	---	---	---	---	---
	NI-60	1-3"	2-6"	4-0"	5-4"	7-0"	7-5"	---	---	---	---	---	---
	NI-70	2-0"	3-4"	4-9"	6-3"	8-0"	8-4"	---	---	---	---	---	---
	NI-80	2-3"	3-6"	5-0"	6-6"	8-2"	8-8"	---	---	---	---	---	---
11-7/8"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---
	NI-40x	0-7"	0-8"	1-3"	2-8"	4-0"	4-4"	5-5"	7-0"	8-4"	---	---	---
	NI-60	0-7"	1-8"	3-0"	4-3"	5-9"	6-0"	7-3"	8-10"	10-0"	---	---	---
	NI-70	1-3"	2-6"	4-0"	5-4"	6-9"	7-2"	8-4"	10-0"	11-2"	---	---	---
	NI-80	1-6"	2-10"	4-2"	5-6"	7-0"	7-5"	8-6"	10-3"	11-4"	---	---	---
14"	NI-20	0-7"	0-8"	1-5"	3-2"	4-10"	5-4"	6-9"	8-9"	10-2"	---	---	---
	NI-40x	0-7"	0-8"	0-9"	2-5"	4-4"	4-9"	6-3"	---	---	---	---	---
	NI-60	0-7"	0-8"	0-8"	1-0"	2-4"	2-9"	3-9"	5-2"	6-0"	6-6"	8-3"	10-2"
	NI-70	0-7"	0-8"	1-8"	3-0"	4-3"	4-8"	5-8"	7-2"	8-0"	8-8"	10-4"	11-9"
	NI-80	0-7"	0-8"	1-10"	3-0"	4-5"	5-10"	6-2"	7-3"	8-9"	9-9"	10-4"	12-0"
16"	NI-20	0-7"	0-8"	1-10"	2-5"	4-0"	4-5"	5-9"	7-5"	8-8"	9-4"	11-4"	12-11"
	NI-40x	0-7"	0-8"	0-8"	2-0"	3-2"	3-2"	4-2"	5-5"	7-3"	8-5"	9-2"	---
	NI-60	0-7"	0-8"	0-8"	1-6"	2-10"	3-2"	4-2"	5-6"	6-4"	7-0"	8-5"	9-8"
	NI-70	0-7"	0-8"	1-0"	2-3"	3-6"	4-10"	5-3"	6-3"	7-8"	8-6"	9-2"	10-8"
	NI-80	0-7"	0-8"	1-3"	2-6"	3-10"	5-3"	5-6"	6-6"	8-0"	9-0"	9-5"	11-0"

- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Hole location distance is measured from inside face of supports to centre of hole.
- Distances in this chart are based on uniformly loaded joists.
- The above table is based on the I-joists being used at their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

TABLE 2



DUCT CHASE OPENING SIZES AND LOCATIONS

Simple Span Only

Joist Depth	Joist Series	Minimum Distance from Inside Face of Supports to Centre of Opening (ft - in.)											
		Duct Chase Length (in.)											
9-1/2"	NI-20	4-1"	4-5"	4-10"	5-4"	5-8"	6-1"	6-6"	7-1"	7-5"	---	---	---
	NI-40x	5-3"	5-8"	6-0"	6-5"	6-10"	7-3"	7-8"	8-2"	8-6"	---	---	---
	NI-60	5-4"	5-9"	6-2"	6-7"	7-1"	7-5"	8-0"	8-3"	8-9"	---	---	---
	NI-70	5-11"	5-5"	5-10"	6-3"	6-7"	7-1"	7-6"	8-1"	8-4"	---	---	---
	NI-80	5-3"	5-8"	6-0"	6-5"	6-10"	7-3"	7-8"	8-2"	8-6"	---	---	---
11-7/8"	NI-20	5-9"	6-2"	6-6"	7-1"	7-5"	7-9"	8-3"	8-9"	9-4"	---	---	---
	NI-40x	6-8"	7-2"	7-6"	8-1"	8-6"	9-1"	9-6"	10-1"	10-9"	---	---	---
	NI-60	7-3"	7-8"	8-0"	8-6"	9-0"	9-3"	9-9"	10-3"	11-0"	---	---	---
	NI-70	7-1"	7-4"	7-9"	8-3"	8-7"	9-1"	9-6"	10-1"	10-4"	---	---	---
	NI-80	7-2"	7-7"	8-0"	8-5"	8-10"	9-3"	9-8"	10-2"	10-8"	---	---	---
14"	NI-20	7-6"	7-11"	8-4"	8-9"	9-2"	9-7"	10-1"	10-7"	10-11"	---	---	---
	NI-40x	7-7"	8-1"	8-5"	8-10"	9-4"	9-8"	10-2"	10-8"	11-2"	---	---	---
	NI-60	8-1"	8-7"	9-0"	9-6"	10-1"	10-7"	11-2"	12-0"	12-5"	---	---	---
	NI-70	8-9"	9-3"	9-8"	10-1"	10-6"	11-1"	11-6"	12-3"	13-0"	---	---	---
	NI-80	8-9"	9-1"	9-5"	9-10"	10-4"	10-9"	11-2"	11-7"	12-3"	---	---	---
16"	NI-20	9-2"	9-8"	10-0"	10-6"	10-11"	11-5"	11-9"	12-4"	12-11"	---	---	---
	NI-40x	9-4"	9-9"	10-3"	10-7"	11-1"	11-6"	12-1"	12-7"	13-2"	---	---	---
	NI-60	10-3"	10-8"	11-2"	11-6"	12-1"	12-6"	13-2"	14-1"	14-10"	---	---	---
	NI-70	10-1"	10-5"	11-0"	11-4"	11-10"	12-3"	12-8"	13-3"	14-0"	---	---	---
	NI-80	10-4"	10-9"	11-3"	11-9"	12-1"	12-7"	13-1"	13-8"	14-4"	---	---	---

- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Duct chase opening location distance is measured from inside face of supports to centre of opening.
- The above table is based on simple-span joists only. For other applications, contact your local distributor.
- Distances are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480.
- The above table is based on the I-joists being used at their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

FIGURE 7
FIELD-CUT HOLE LOCATOR

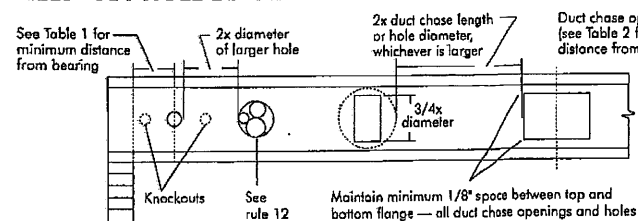

Knockouts are pre-scored holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on centre along the length of the I-joist. Where possible, it is preferable to use knockouts instead of field-cut holes.

Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.

For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.

SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on I-joists until fully fastened and braced, or serious injuries can result.



Never stack building materials over unshathed I-joists. Once shathed, do not over-stress I-joists with concentrated loads from building materials.

WARNING: I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

AVOID ACCIDENTS BY FOLLOWING THESE IMPORTANT GUIDELINES:

- Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
- When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
- Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least 2 I-joists at the end of the bay.
- Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
- For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
- Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
- Never install a damaged I-joist.




Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.



PRODUCT WARRANTY

Chantiers Chibougamau guarantees that, in accordance with our specifications, Nordic products are free from manufacturing defects in material and workmanship.









Furthermore, Chantiers Chibougamau warrants that our products, when utilized in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the structure.

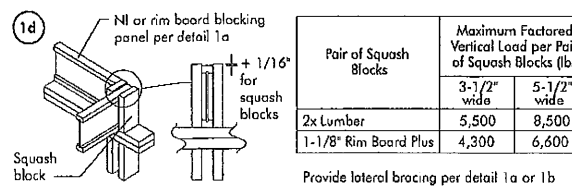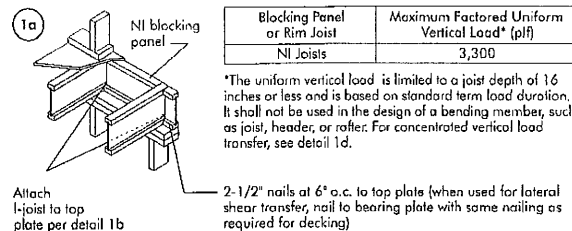

BACKER BLOCKS (Blocks must be long enough to permit required nailing without splitting)

Flange Width	Material Thickness Required*	Minimum Depth**
2-1/2"	1"	5-1/2"
3-1/2"	1-1/2"	7-1/4"

* Minimum grade for backer block material shall be S-PF No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-O325 or CAN/CSA-O437 Standard.
** For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

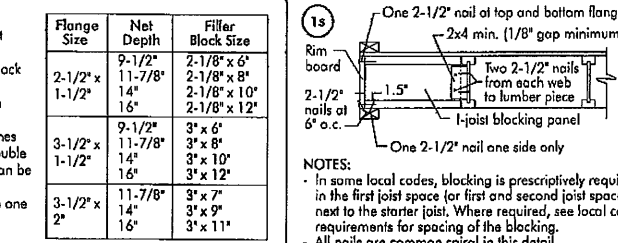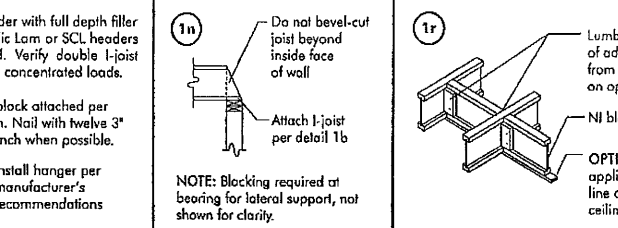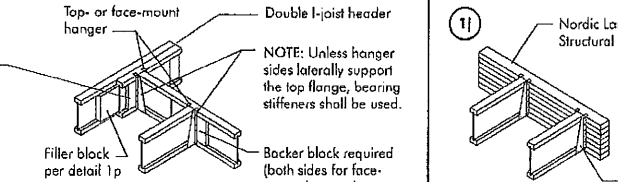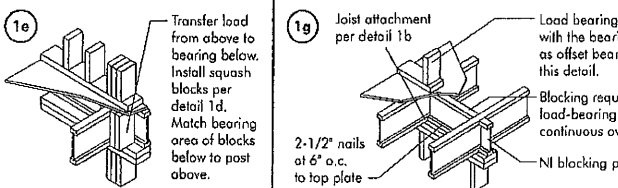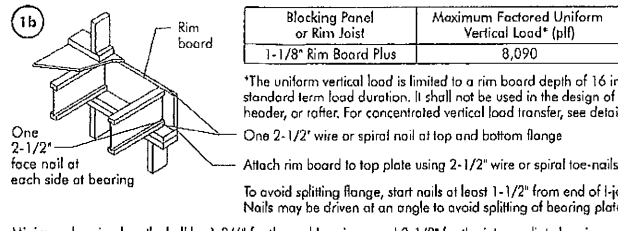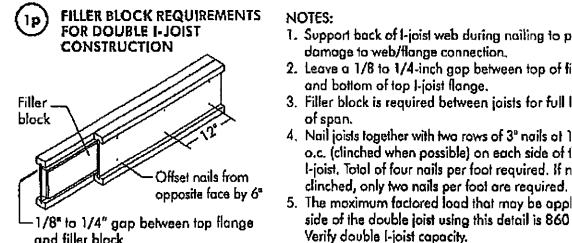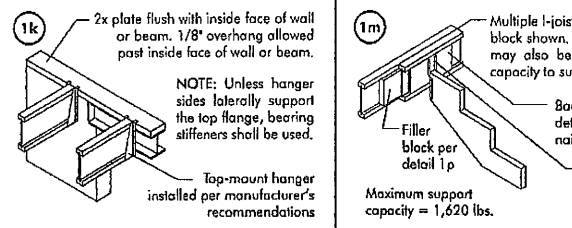

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.


WEB STIFFENERS

RECOMMENDATIONS:

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the I-joist properties table found in the I-joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.
- A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.


FIGURE 2

WEB STIFFENER INSTALLATION DETAILS

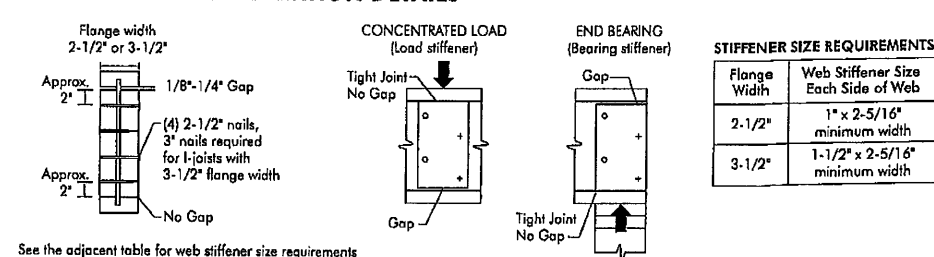


See the adjacent table for web stiffener size requirements

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET

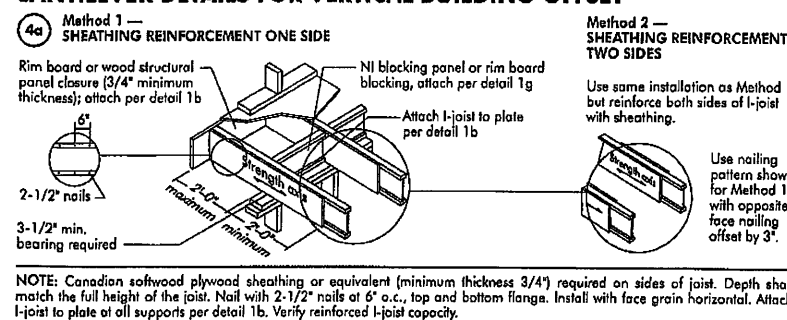

RIM BOARD INSTALLATION DETAILS

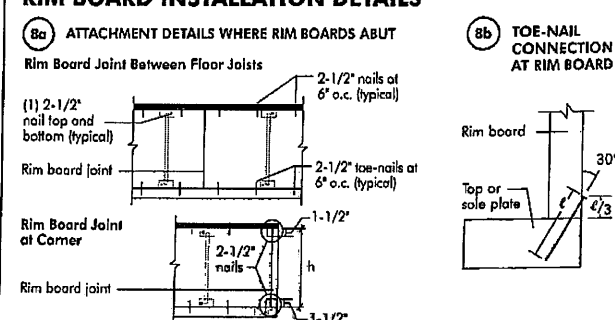

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER
BURLINGTON
Oct. 25, 2017 09:15

PROJECT
J1 GRD FLR


Design Check Calculation Sheet

Nordic Sizer - Canada 6.4

Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

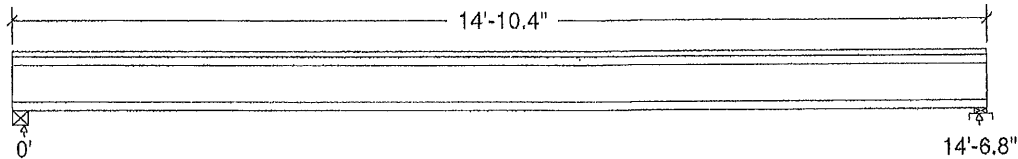

Unfactored:			
Dead	199		198
Live	398		395
Factored:			
Total	845		839
Bearing:			
Resistance			
Joist	1876		1865
Support	-		3971
Des ratio			
Joist	0.45		0.45
Support	-		0.21
Load case	#2		#2
Length	3		2-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
Kd	1.00		1.00
KB support	-		1.00
fcp sup	-		769
Kzcp sup	-		1.09



*Minimum bearing length for joists is 2" for exterior supports

Nordic 9-1/2" NI-40x Floor joist @ 16" o.c.

Supports: 1 - Steel Beam, W; 2 - Lumber Sill plate, No.1/No.2;

Total length: 14'-10.4"; 3/4" nailed and glued OSB sheathing

This section **PASSES** the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 825	Vr = 1895	lbs	Vf/Vr = 0.44
Moment (+)	Mf = 3005	Mr = 4824	lbs-ft	Mf/Mr = 0.62
Perm. Defl'n	0.11 = <L/999	0.49 = L/360	in	0.23
Live Defl'n	0.22 = L/782	0.36 = L/480	in	0.61
Total Defl'n	0.33 = L/521	0.73 = L/240	in	0.46
Bare Defl'n	0.28 = L/635	0.49 = L/360	in	0.57
Vibration	Lmax = 14'-7	Lv = 16'-2	ft	
Defl'n	= 0.033	= 0.045	in	0.72

DWG NO. TAM 8076784
STRUCTURAL
COMPONENT ONLY

T:1811016

J1 GRD FLR

Nordic Sizer – Canada 6.4

Page 2

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L

Moment (+) : LC #2 = 1.25D + 1.5L

Deflection: LC #1 = 1.0D (permanent)

LC #2 = 1.0D + 1.0L (live)

LC #2 = 1.0D + 1.0L (total)

LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L

Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake

L=live (use, occupancy) Ls=live (storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output


CALCULATIONS:Deflection: E_{IEff} = 276e06 lb-in² K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

CONFORMS TO OBC 2012

1. WoodWorks analysis and design are in accordance with the 2010 National Building Code of Canada (NBC Part 4) and the CSA O86-14 Engineering Design in Wood standard (May 2014 edition).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

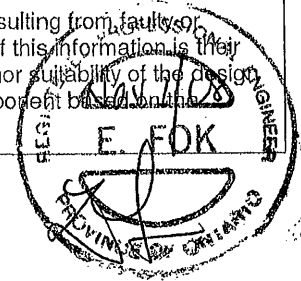

DWG NO. TAM 807618H
STRUCTURAL
COMPONENT ONLY

T-1811016(2)



Bolted Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Flush Beams\B4(i5258)

Dry | 3 spans | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 1ST FLR FRAMING\Flush Beams\B4(i5258)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

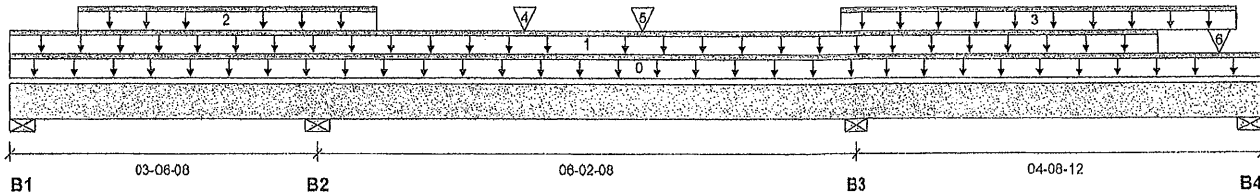

Total Horizontal Product Length = 14-05-12

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-3/4"	808 / 255	250 / 0		
B2, 3-1/2"	2,532 / 0	1,005 / 0		
B3, 3-1/2"	2,642 / 0	1,100 / 0		
B4, 5-1/2"	1,332 / 168	545 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-05-12	Top	100	10			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-00	13-03-04	Top	295	111			n/a
2	User Load	Unf. Lin. (lb/ft)	L	00-09-04	04-02-12	Top	240	120			n/a
3	User Load	Unf. Lin. (lb/ft)	L	09-06-12	14-02-04	Top	240	120			n/a
4	J5(i5740)	Conc. Pt. (lbs)	L	05-10-15	05-10-15	Top	70				n/a
5	J5(i5654)	Conc. Pt. (lbs)	L	07-03-04	07-03-04	Top	70				n/a
6	-	Conc. Pt. (lbs)	L	13-11-13	13-11-13	Top	494				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,924 ft-lbs	23,220 ft-lbs	8.3%	2	12-05-12
Neg. Moment	-2,566 ft-lbs	-23,220 ft-lbs	11.1%	5	09-09-00
End Shear	1,244 lbs	11,571 lbs	10.8%	2	13-02-12
Cont. Shear	2,209 lbs	11,571 lbs	19.1%	4	04-05-12
Total Load Deflection	L/999 (0.012")	n/a	n/a	14	06-07-06
Live Load Deflection	L/999 (0.01")	n/a	n/a	19	06-08-06
Total Neg. Defl.	L/999 (-0.003")	n/a	n/a	13	07-07-04
Max Defl.	0.012"	n/a	n/a	14	06-07-06
Span / Depth	7.8				



Bearing Supports

			Demand/Resistance Support	Demand/Resistance Member		
Bearing Supports	Dim. (LxW)	Demand			Material	
B1	Wall/Plate	2-3/4" x 3-1/2"	1,525 lbs	29.7%	13.0%	Unspecified
B1	Uplift		158 lbs			
B2	Wall/Plate	3-1/2" x 3-1/2"	5,055 lbs	77.3%	33.8%	Unspecified
B3	Wall/Plate	3-1/2" x 3-1/2"	5,337 lbs	81.6%	35.7%	Unspecified
B4	Wall/Plate	5-1/2" x 3-1/2"	2,679 lbs	26.1%	11.4%	Unspecified

Cautions

Uplift of 158 lbs found at span 1 - Left. (SIMPSON 1-1/2-54 @ 0.31)

DWG NO. TAM B0777B4
STRUCTURAL
COMPONENT ONLY

T-184017



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B4(i5258)**

Dry | 3 spans | No cant.

October 29, 2018 16:15:28

BC CALCO® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R

File name: GLENWAY 12A LOT 12.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B4(i5258)

Specifier:

Designer: CF

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.


CONFORMS TO OBC 2012

BC CALCO® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

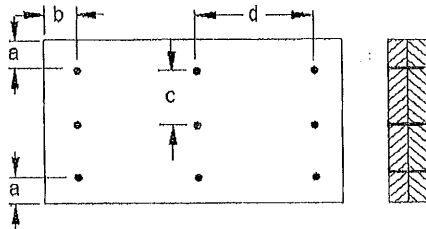Connection Diagram: Full Length of Member

a minimum = 2"

b minimum = 3"


c = 2-3/4"

d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

DWG NO. TAM 00771BH
STRUCTURAL
COMPONENT ONLY

BC CALCO®, BC FRAMER®, AJSTM, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

T-1811017(2)

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Dropped Beams\B5 DR(i6788)**

BC CALC® Member Report

Dry | 1 span | No cant.

October 29, 2018 16:15:28

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 1ST FLR FRAMING\Dropped Beams\B5 DR(i6788)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

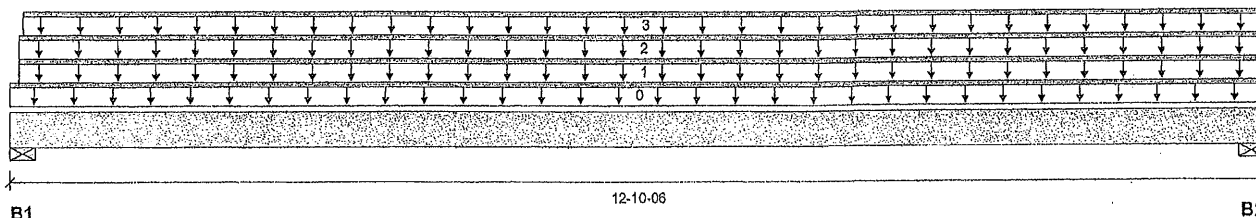**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	229 / 0	552 / 0		
B2, 2-3/8"	223 / 0	540 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	12-10-06	Top		10			00-00-00
1	J2(i5682)	Unf. Lin. (lb/ft)	L	00-01-02	12-10-06	Top	31	14			n/a
2	R1(i5811)	Unf. Lin. (lb/ft)	L	00-01-02	12-10-06	Top	4	2			n/a
3	User Load	Unf. Lin. (lb/ft)	L	00-01-10	12-10-06	Top		60			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	2,277 ft-lbs	15,093 ft-lbs	15.1%	0	06-06-12
End Shear	636 lbs	7,521 lbs	8.5%	0	01-03-00
Total Load Deflection	L/1,179 (0.126")	n/a	20.4%	4	06-06-12
Live Load Deflection	L/999 (0.037")	n/a	n/a	5	06-06-12
Max Defl.	0.126"	n/a	n/a	4	06-06-12
Span / Depth	15.6				

Bearing Supports

	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	773 lbs	7.6%	5.1%	Unspecified
B2	Wall/Plate 2-3/8" x 3-1/2"	755 lbs	9.9%	11.5%	Unspecified

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

DWG NO. TAM 8070734
STRUCTURAL
COMPONENT ONLY

T-1811018



Bolsé Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Dropped Beams\B5 DR(i5788)

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R

File name: GLENWAY 12A LOT 12.mmdl


Description: 1ST FLR FRAMING\Dropped Beams\B5 DR(i5788)

Specifier:

Designer: CF

Company:

Connection Diagram: Full Length of Member

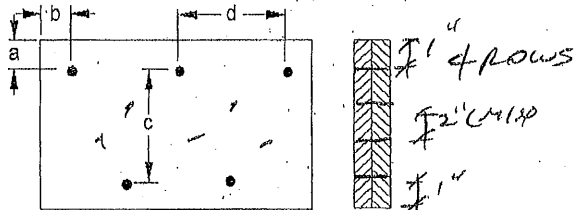

a minimum = 4"
b minimum = 3"


c = 3-1/2"
d = 12"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL



Disclosure

Use of the Bolsé Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Bolsé Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

DWG NO. TAM 80787B4
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BCI®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®,

T-1811018(v)



Boise Cascade



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLR FRAMING\Flush Beams\B2(i5296)

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R


File name: GLENWAY 12A LOT 12.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B2(i5296)

Specifier:

Designer: CF

Company:

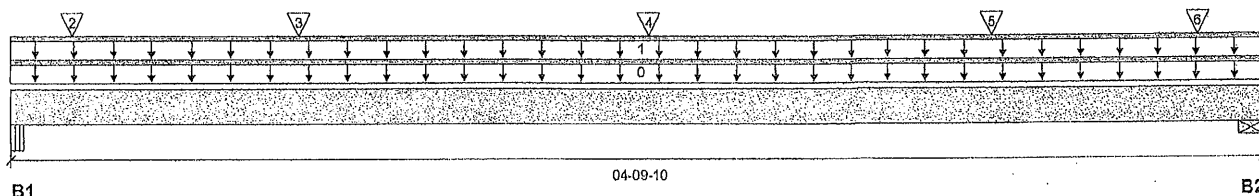

Total Horizontal Product Length = 04-09-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	1,864 / 0	693 / 0		
B2, 5-1/2"	1,097 / 0	549 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-09-10	Top	5				00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	04-09-10	Top	20	7			n/a
2	10(i230)	Conc. Pt. (lbs)	L	00-02-13	00-02-13	Top	1,040	449			n/a
3	J1(i5783)	Conc. Pt. (lbs)	L	01-01-02	01-01-02	Top	392	147			n/a
4	J1(i5696)	Conc. Pt. (lbs)	L	02-05-02	02-05-02	Top	395	148			n/a
5	J1(i5787)	Conc. Pt. (lbs)	L	03-09-02	03-09-02	Top	379	135			n/a
6	13(i155)	Conc. Pt. (lbs)	L	04-06-10	04-06-10	Top	461	305			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,388 ft-lbs	11,610 ft-lbs	12.0%	1	02-05-02
End Shear	1,054 lbs	5,785 lbs	18.2%	1	01-02-12
Total Load Deflection	L/999 (0.011")	n/a	n/a	6	02-04-11
Live Load Deflection	L/999 (0.008")	n/a	n/a	8	02-04-11
Max Defl.	0.011"	n/a	n/a	6	02-04-11
Span / Depth	5.1				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 5-1/4" x 1-3/4"	3,362 lbs	68.5%	30.0%	Unspecified
B2	Wall/Plate 5-1/2" x 1-3/4"	2,332 lbs	45.4%	19.9%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

DWG NO. TAM 0079704
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJST™,
ALLJOIST®, BC RIM BOARD™, BCi®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®

T-1811019



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLR FRAMING\Flush Beams\B3(i5726)**

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R


File name: GLENWAY 12A LOT 12.mmdl

Description: 1ST FLR FRAMING\Flush Beams\B3(i5726)

Specfier:

Designer: CF

Company:

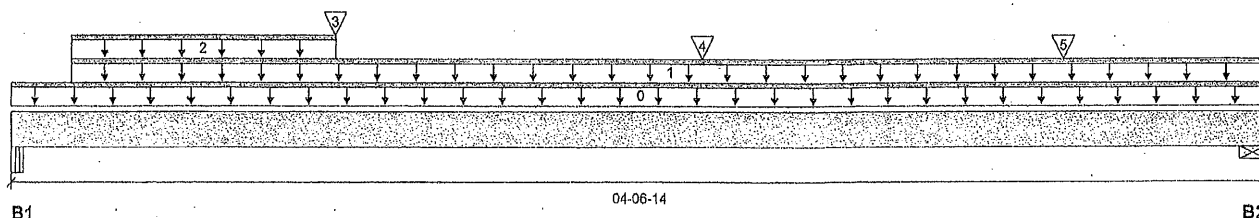

Total Horizontal Product Length = 04-06-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	541 / 0	226 / 0		
B2, 2-3/4"	624 / 0	255 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-06-14	Top		10			00-00-00
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	04-06-14	Top	6	2			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	01-02-02	Top	38	14			n/a
3	J1(i5685)	Conc. Pt. (lbs)	L	01-02-02	01-02-02	Top	319	120			n/a
4	J1(i5623)	Conc. Pt. (lbs)	L	02-06-02	02-06-02	Top	392	147			n/a
5	J1(i5626)	Conc. Pt. (lbs)	L	03-10-02	03-10-02	Top	392	147			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,302 ft-lbs	23,220 ft-lbs	5.6%	1	02-06-02
End Shear	1,010 lbs	11,571 lbs	8.7%	1	01-02-12
Total Load Deflection	L/999 (0.005")	n/a	n/a	4	02-04-11
Live Load Deflection	L/999 (0.004")	n/a	n/a	5	02-04-11
Max Defl.	0.005"	n/a	n/a	4	02-04-11
Span / Depth	5.1				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 5-1/4" x 3-1/2"	1,094 lbs	11.2%	4.9%	Unspecified
B2	Wall/Plate 2-3/4" x 3-1/2"	1,256 lbs	24.4%	10.7%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.


Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWG NO. TAM 8080134
STRUCTURAL
COMPONENT ONLY

T-1811020



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED**

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

October 29, 2018 16:15:28


File name: GLENWAY 12A LOT 12.mmd

Description: 1ST FLR FRAMING\Flush Beams\B3(i5726)

Specifier:

Designer: CF

Company:

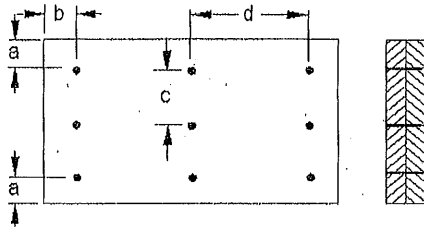Connection Diagram: Full Length of Member


a minimum = 2"

b minimum = 3"

c = 2-3/4"

d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d ¹⁶/₁₆" Nails**3-1/2" ARDOX SPIRAL****Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BCI®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®,

BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BCI®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®,

T-181102067



Boise Cascade



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B7(i5749)

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R


File name: GLENWAY 12A LOT 12.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B7(i5749)

Specifier:

Designer: CF

Company:

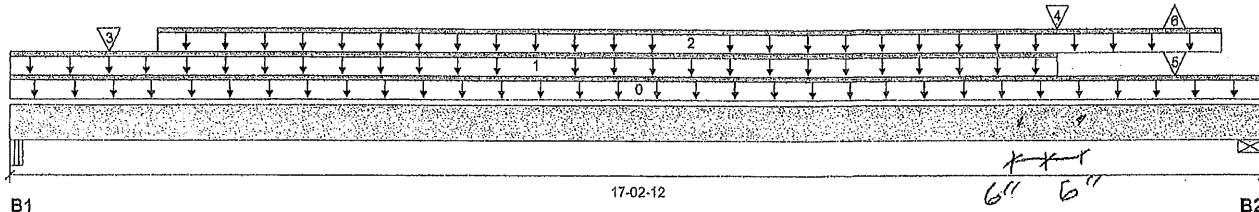

Total Horizontal Product Length = 17-02-12

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 5-1/4"	1,179 / 0	588 / 0		
B2, 3-1/4"	2,952 / 3	1,342 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	17-02-12	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	14-04-14	Top	11	4			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	02-00-00	16-08-00	Top	88	34			n/a
3	J4(i5802)	Conc. Pt. (lbs)	L	01-04-00	01-04-00	Top	92	35			n/a
4	B8(i5343)	Conc. Pt. (lbs)	L	14-04-14	14-04-14	Top	2,433	1,046			n/a
5	J10(i5538)	Conc. Pt. (lbs)	L	16-00-05	16-00-05	Top	115	42			n/a
6	J10(i5538)	Conc. Pt. (lbs)	L	16-00-05	16-00-05	Top	-3				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	15,440 ft-lbs	36,222 ft-lbs	42.6%	1	12-00-00
End Shear	6,067 lbs	17,356 lbs	35.0%	1	16-02-00
Total Load Deflection	L/283 (0.707")	n/a	84.9%	6	09-04-00
Live Load Deflection	L/416 (0.48")	n/a	86.5%	8	09-04-00
Max Defl.	0.707"	n/a	n/a	6	09-04-00
Span / Depth	21.0				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 5-1/4" x 5-1/4"	2,503 lbs	8.3%	7.4%	Unspecified
B2	Wall/Plate 3-1/4" x 5-1/4"	6,106 lbs	67.0%	29.3%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00.

Resistance Factor phi has been applied to all presented results per CSA 086.


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA 086.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Concentrated side-load exceeds allowable magnitude for connection design. Please consult a technical representative or Professional Engineer for the design of the connection.

CONFORMS TO OBC 2012

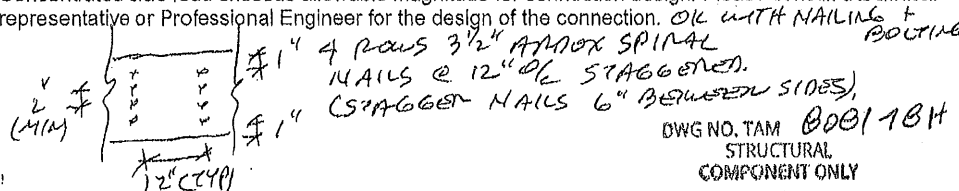

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC1®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

OWG NO. TAM 0001181
STRUCTURAL
COMPONENT ONLY

T-L81102 |



Bolsa Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED**

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

October 29, 2018 16:15:28


File name: GLENWAY 12A LOT 12.mmdl

Description: 2ND FLR FRAMING\Dropped Beams\B32DR(i5752)

Specifier:

Designer: CF

Company:



B1 15-05-00 B2

Total Horizontal Product Length = 15-05-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	354 / 0	328 / 0	49 / 0	
B2, 2"	3 / 0	77 / 0	0 / 0	

Load Summary


Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	15-05-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	B14(i5245)	Conc. Pt. (lbs)	L	00-03-00	00-03-00	Top	357	256	49		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	416 ft-lbs	10,735 ft-lbs	3.9%	0	07-06-00
End Shear	125 lbs	7,521 lbs	1.7%	0	00-11-08
Total Load Deflection	L/999 (0.028")	n/a	n/a	35	07-06-00
Live Load Deflection	L/999 (0.003")	n/a	n/a	51	06-05-05
Max Defl.	0.028"	n/a	n/a	35	07-06-00
Span / Depth	19.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Hanger	2" x 3-1/2"	964 lbs	n/a	11.3%	HGUS410
B2 Hanger	2" x 3-1/2"	107 lbs	n/a	1.9%	HGUS410

**Cautions**

Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculation's assume unbraced length of Top: 15-00-04, Bottom: 15-00-04.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

OWG NO. TAM 808278H
STRUCTURAL
COMPONENT ONLY
p62

T-1811022



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Dropped Beams\B32DR(j5752)**

Dry | 1 span | No cant.

PASSED

October 29, 2018 16:15:28

BC CALC® Member Report
Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Dropped Beams\B32DR(j5752)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

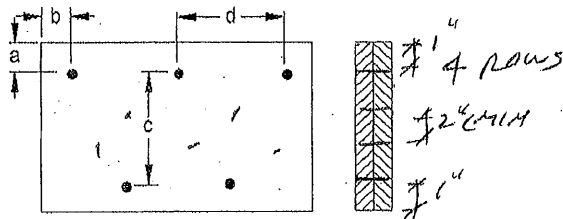Connection Diagram: Full Length of Membera minimum = 0"
b minimum = 3"c = 1 1/2"
d = 12"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM 8032184
STRUCTURAL
COMPONENT ONLY

T-1811022(2)



Boise-Cascade



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B8(i5343)

BC CALC® Member Report
Build 6475

Dry | 1 span | No cant.

October 29, 2018 16:15:28

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B8(i5343)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

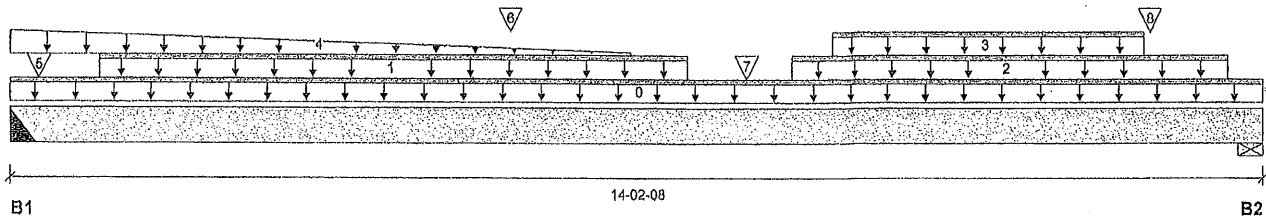

Total Horizontal Product Length = 14-02-08

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 2"	2,447 / 0	1,052 / 0		
B2, 6-1/2"	2,874 / 0	1,453 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-02-08	Top		14			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-11-12	07-07-12	Top	284	107			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	08-09-12	13-09-12	Top	284	106			n/a
3	User Load	Unf. Lin. (lb/ft)	L	09-03-06	12-10-04	Top	240	120			n/a
4	FC2 Floor Material	Trapezoidal (lb/ft)	L	00-00-00	07-00-00	Top	69	26			n/a
							9	3			
5	J1(i5698)	Conc. Pt. (lbs)	L	00-03-12	00-03-12	Top	266	100			n/a
6	J10(i5538)	Conc. Pt. (lbs)	L	05-07-10	05-07-10	Top	153	58			n/a
7	J2(i5728)	Conc. Pt. (lbs)	L	08-03-12	08-03-12	Top	329	123			n/a
8	B11(i5818)	Conc. Pt. (lbs)	L	12-11-02	12-11-02	Top	114	237			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	17,621 ft-lbs	36,222 ft-lbs	48.6%	1	06-11-12
End Shear	5,767 lbs	17,356 lbs	33.2%	1	12-10-08
Total Load Deflection	L/293 (0.558")	n/a	81.9%	4	07-00-00
Live Load Deflection	L/423 (0.387")	n/a	85.1%	5	07-00-00
Max Defl.	0.558"	n/a	n/a	4	07-00-00
Span / Depth	17.2				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 2" x 5-1/4"	4,986 lbs	n/a	38.9%	HGUS5.50/10
B2	Wall/Plate 6-1/2" x 5-1/4"	6,128 lbs	33.6%	14.7%	Unspecified

Cautions

Header for the hanger HGUS5.50/10 at B1 is a Triple 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HGUS5.50/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

DWG NO. TAM 80837B1K
STRUCTURAL
COMPONENT ONLY
Do 11/2

T-6811023



Boise Cascade

**Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B8(i5343)**

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R

File name: GLENWAY 12A LOT 12.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B8(i5343)

Specifier:

Designer: CF

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

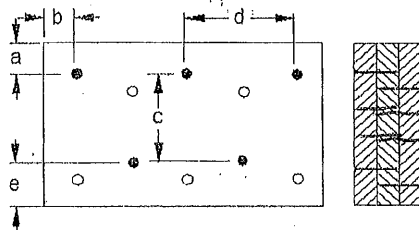Connection Diagram: Full Length of Member

a minimum = 4"

b minimum = 3"

c = 4 1/2"

d = 8"

e minimum = 2"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM 000378
STRUCTURAL
COMPONENT ONLY

T-84023(v)



Bolsa Cascade



Quadruple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B12(I5328)

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B12(I5328)

City, Province, Postal Code: EAS...URY


Specifier:

Customer:

Designer: CF

Code reports: CCMC 12472-R

Company:

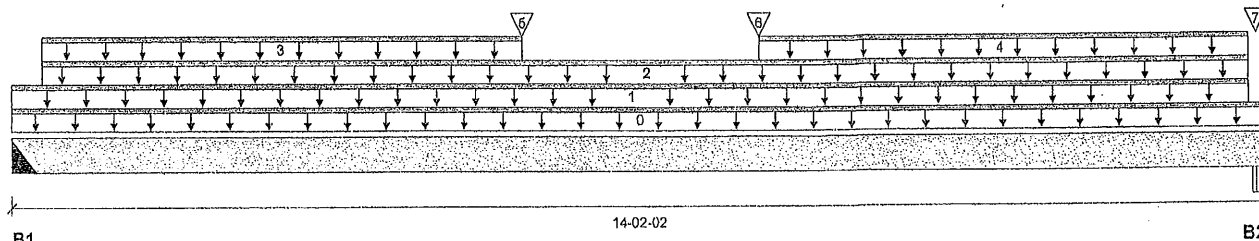

Total Horizontal Product Length = 14-02-02

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 2"	1,018 / 0	1,631 / 0	2,620 / 0	
B2, 4-1/2"	1,095 / 0	1,755 / 0	2,833 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-02-02	Top		19			00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	13-11-14	Top	14	5			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-04-02	13-11-14	Top		94			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-04-02	05-09-00	Top	135	123	385		n/a
4	FC2 Floor Material	Unf. Lin. (lb/ft)	L	08-05-00	13-11-14	Top	135	123	385		n/a
5	User Load	Conc. Pt. (lbs)	L	05-09-00	05-09-00	Top	202	183	575		n/a
6	User Load	Conc. Pt. (lbs)	L	08-05-00	08-05-00	Top	202	183	575		n/a
7	FC2 Floor Material	Conc. Pt. (lbs)	L	14-01-00	14-01-00	Top	28	42	72		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/ Resistance	Case	Location
Pos. Moment	22,592 ft-lbs	48,297 ft-lbs	46.8%	13	06-05-00
End Shear	6,442 lbs	23,142 lbs	27.8%	13	00-11-08
Total Load Deflection	L/286 (0.576")	n/a	83.8%	45	06-11-00
Live Load Deflection	L/435 (0.38")	n/a	82.7%	61	06-11-00
Max Defl.	0.576"	n/a	n/a	45	06-11-00
Span / Depth	17.4				



Bearing Supports	Dim. (LxW)	Demand	Demand/ Resistance Support	Demand/ Resistance Member	Material
B1 Hanger	2" x 7"	6,478 lbs	n/a	37.9%	HGUS5.50/10
B2 Beam	4-1/2" x 7"	6,991 lbs	41.6%	18.2%	Unspecified

Cautions

Header for the hanger HGUS5.50/10 at B1 is a Triple 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.
Hanger model HGUS5.50/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

DWG NO. TAM 800478H
STRUCTURAL
COMPONENT ONLY: 10/16

T-1811024



Boise Cascade

**Quadruple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B12(i5328)**

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R

File name: GLENWAY 12A LOT 12.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B12(i5328)

Specifier:

Designer: CF

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.


Importance Factor: Normal Part code: Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Beams 7 inches wide will be assumed to be either top-loaded only, or equally loaded from each side.

Bolts are assumed to be Grade A307 or Grade 2 or higher.

Member has no side loads.

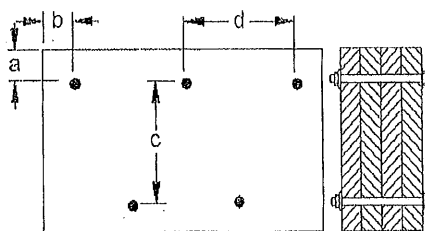Connection Diagram: Full Length of Member

a minimum = 2 1/2"
 b minimum = 2-1/2"
 c = 4-1/2"
 d = 12"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Beams 7 inches wide will be assumed to be either top-loaded only, or equally loaded from each side.

Bolts are assumed to be Grade A307 or Grade 2 or higher.

Member has no side loads.

Connectors are: 1/2 in. Staggered Through Bolt

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM 8004124
 STRUCTURAL
 COMPONENT ONLY

T-184024(y)



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Member Report

2ND FLR FRAMING\Flush Beams\B6(I5355)

Dry | 1 span | No cant.

October 29, 2018 16:15:28

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B6(I5355)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

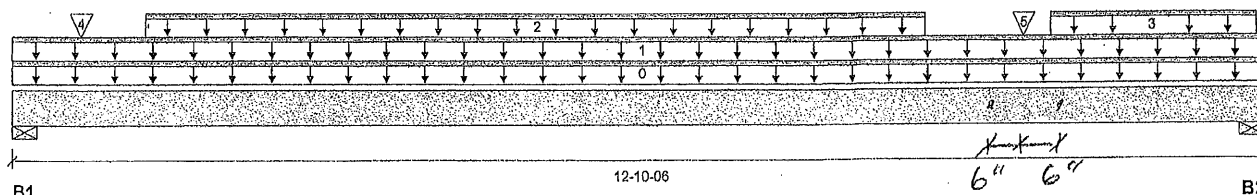

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	1,989 / 0	1,094 / 0	503 / 0	
B2, 4-3/8"	2,196 / 0	2,235 / 0	2,348 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	12-10-06	Top	14				00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	12-10-06	Top	16	6			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	01-04-08	09-04-08	Top	284	106			n/a
3	User Load	Unf. Lin. (lb/ft)	L	10-08-00	12-09-08	Top		100			n/a
4	J2(I5759)	Conc. Pt. (lbs)	L	00-08-08	00-08-08	Top	287	107			n/a
5	-	Conc. Pt. (lbs)	L	10-04-11	10-04-11	Top	1,386	1,882	2,851		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	16,982 ft-lbs	36,222 ft-lbs	46.9%	1	07-04-08
End Shear	7,236 lbs	17,356 lbs	41.7%	13	11-08-08
Total Load Deflection	L/321 (0.454")	n/a	74.7%	35	06-08-08
Live Load Deflection	L/496 (0.294")	n/a	72.6%	51	06-08-08
Max Defl.	0.454"	n/a	n/a	35	06-08-08
Span / Depth	15.4				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 5-1/4"	4,601 lbs	29.8%	13.1%	Unspecified
B2	Wall/Plate 4-3/8" x 5-1/4"	7,413 lbs	60.4%	26.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.


Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Concentrated side-load exceeds allowable magnitude for connection design. Please consult a technical representative or Professional Engineer for the design of the connection.

CONFORMS TO OBC 2012




Disclosure

Use of the Bols Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Bols Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJSTM, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

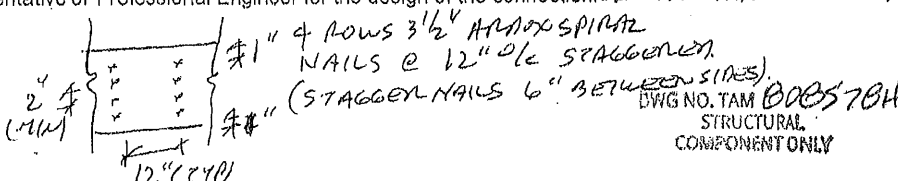

T-L81025



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED**

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

October 29, 2018 16:15:28


File name: GLENWAY 12A LOT 12.mmdl

Description: 2ND FLR FRAMING\Dropped Beams\B17 DR(I5310)

Specifier:

Designer: CF

Company:

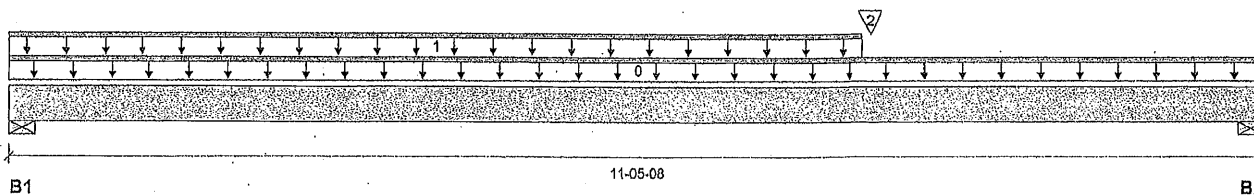**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	170 / 0	136 / 0		
B2, 7-1/4"	246 / 0	170 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-05-08	Top		10			00-00-00
1	R1(I5520)	Unf. Lin. (lb/ft)	L	00-00-00	07-09-08	Top	17	8			n/a
2	B9(I5743)	Conc. Pt. (lbs)	L	07-10-06	07-10-06	Top	286	130			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,702 ft-lbs	22,621 ft-lbs	7.5%	1	07-10-06
End Shear	566 lbs	11,571 lbs	4.9%	1	10-00-12
Total Load Deflection	L/999 (0.044")	n/a	n/a	4	05-11-07
Live Load Deflection	L/999 (0.026")	n/a	n/a	5	06-00-10
Max Defl.	0.044"	n/a	n/a	4	05-11-07
Span / Depth	13.3				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	425 lbs	2.7%	1.8%	Unspecified
B2	Wall/Plate 7-1/4" x 3-1/2"	582 lbs	2.8%	1.9%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 02-11-00, Bottom: 02-11-00.

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.



DWG NO. TAM 0086184
STRUCTURAL
COMPONENT ONLY

T-1811026



Bolse Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLR FRAMING\Dropped Beams\B17 DR(i5310)**

Dry | 1 span | No cant.

PASSED

October 29, 2018 16:15:28

BC CALC® Member Report

Buld 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R


File name: GLENWAY 12A LOT 12.mmdl

Description: 2ND FLR FRAMING\Dropped Beams\B17 DR(i5310)

Specifier:

Designer: CF

Company:

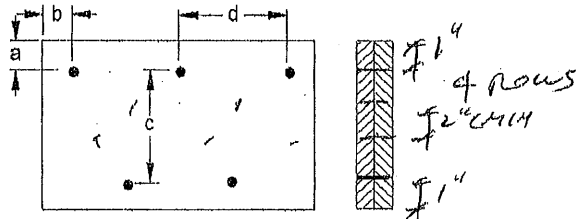Connection Diagram: Full Length of Member

a minimum = 0"

c = 1-1/2"


b minimum = 3"

d = 2-1/2"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails


3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Bolse Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Bolse Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,


DWG NO. TAM 008619H
STRUCTURAL COMPONENT ONLY

T-181026(2)

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Dropped Beams\B18 DR\15285)**BC CALC® Member Report
Build 6475

Dry | 1 span | No cant.

October 29, 2018 16:15:28

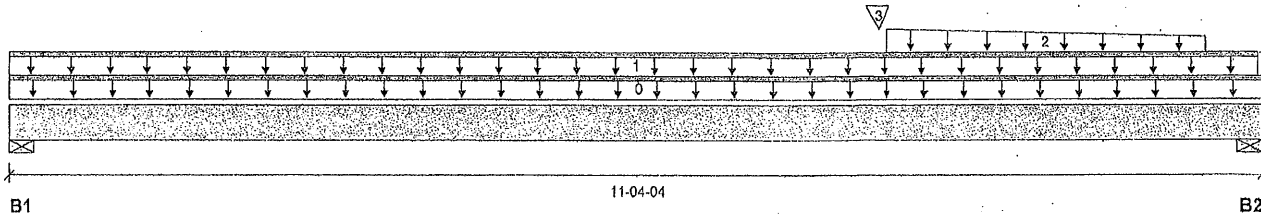Job name:
Address:
City, Province, Postal Code: EAS...URY
Customer:
Code reports: CCMC 12472-RFile name: GLENWAY 12A LOT 12.mmdl
Description: 2ND FLR FRAMING\Dropped Beams\B18 DR\15285)
Specifier:
Designer: CF
Company:

Total Horizontal Product Length = 11-04-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	274 / 0	830 / 0	537 / 0	
B2, 6"	416 / 0	899 / 0	537 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-04-04	Top		10			00-00-00
1	User Load	Unf. Lin. (lb/ft)	L	00-00-00	11-03-12	Top	33	130	95		n/a
2	R1(15794)	Trapezoidal (lb/ft)	L	07-11-04	10-10-04	Top	9				n/a
3	B9(15743)	Conc. Pt. (lbs)	L	07-10-06	07-10-06	Top	288	132			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	5,125 ft-lbs	19,437 ft-lbs	26.4%	13	05-10-13
End Shear	1,712 lbs	11,571 lbs	14.8%	13	10-00-12
Total Load Deflection	L/803 (0.157")	n/a	29.9%	45	05-08-05
Live Load Deflection	L/999 (0.071")	n/a	n/a	61	05-08-05
Max Defl.	0.157"	n/a	n/a	45	05-08-05
Span / Depth	13.3				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 3-1/2"	1,981 lbs	12.7%	8.4%	Unspecified
B2	Wall/Plate 6" x 3-1/2"	2,138 lbs	12.5%	8.3%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
Design meets Code minimum (L/360) Live load deflection criteria.
Calculations assume unbraced length of Top: 07-04-00, Bottom: 07-04-00.
Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012.**
BC CALC® analysis is based on Canadian Limit States Design, as per NBCQ 2010 and CSA O86.
Unbalanced snow loads determined from building geometry were used in selected product's verification.
Design based on Dry Service Condition.
Importance Factor: Normal Part code: Part 9
Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
Member has no side loads.

DWG NO. TAM **BDB7-7B4**
STRUCTURAL
COMPONENT ONLY: *po 1/2**T-181027*



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Dropped Beams\B18 DR(i5285)**

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R


File name: GLENWAY 12A LOT 12.mmdl

Description: 2ND FLR FRAMING\Dropped Beams\B18 DR(i5285)

Specifier:

Designer: CF

Company:

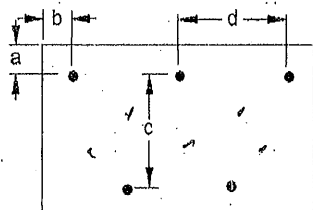Connection Diagram: Full Length of Member

4 rows
2" MIN
1"

a minimum = 1"
b minimum = 3"

c = 1-1/2"
d = 12"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: 16d Nails


3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

DWG NO. TAM 0087184
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJST™,
ALLJOIST®, BC RIM BOARD™, BCI®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®

T-1811027(3)



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B9(i5743)

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B9(i5743)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

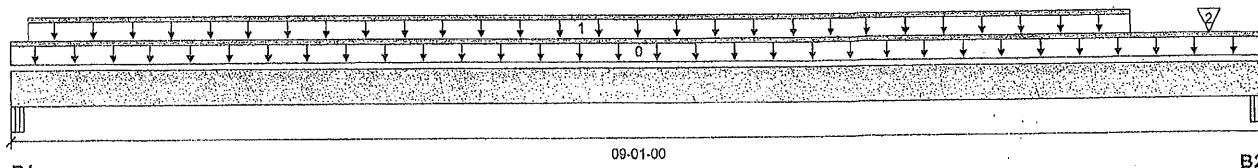

Total Horizontal Product Length = 09-01-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	287 / 0	131 / 0		
B2, 3-1/2"	287 / 0	131 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	09-01-00	Top	5				00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-01-08	08-01-08	Top	65	24			n/a
2	J4(i5518)	Conc. Pt. (lbs)	L	08-08-08	08-08-08	Top	55	21			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,264 ft-lbs	11,610 ft-lbs	10.9%	1	04-09-08
End Shear	524 lbs	5,785 lbs	9.0%	1	01-01-00
Total Load Deflection	L/999 (0.047")	n/a	n/a	4	04-05-08
Live Load Deflection	L/999 (0.032")	n/a	n/a	5	04-05-08
Max Defl.	0.047"	n/a	n/a	4	04-05-08
Span / Depth	10.9				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 3-1/2" x 1-3/4"	593 lbs	8.9%	7.9%	Unspecified
B2	Beam 3-1/2" x 1-3/4"	595 lbs	8.9%	8.0%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).

Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. TAM 808818#
STRUCTURAL
COMPONENT ONLY

T-1811028



Bolted Cascade

**Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Dropped Beams\B25 DR(I5361)**

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Dropped Beams\B25 DR(I5361)

City, Province, Postal Code: EAS...URY


Specifier:

Customer:

Designer: CF

Code reports: CCMC 12472-R

Company:

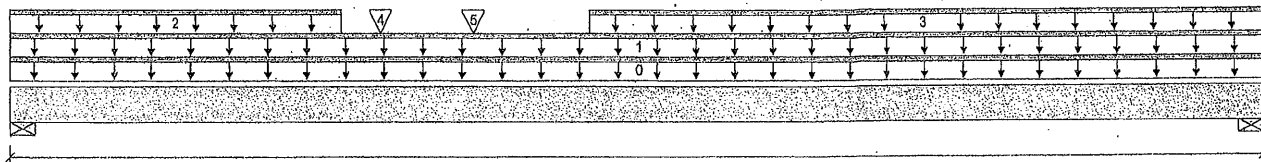

B1

07-03-00

B2

Total Horizontal Product Length = 07-03-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1,365 / 0	1,059 / 0		
B2, 3-1/2"	1,310 / 0	966 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-03-00	Top		14			00-00-00
1	User Load	Unf. Lin. (lb/ft)	L	00-00-00	07-03-00	Top		105			n/a
2	J4(I5449)	Unf. Lin. (lb/ft)	L	00-00-00	01-10-14	Top	27	13			n/a
3	Smoothed Load	Unf. Lin. (lb/ft)	L	03-04-00	07-03-00	Top	297	111			n/a
4	B7(I5749)	Conc. Pt. (lbs)	L	02-01-10	02-01-10	Top	1,181	590			n/a
5	J1(I5698)	Conc. Pt. (lbs)	L	02-08-00	02-08-00	Top	271	102			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	6,140 ft-lbs	36,222 ft-lbs	17.0%	1	02-08-00
End Shear	3,137 lbs	17,356 lbs	18.1%	1	01-01-00
Total Load Deflection	L/999 (0.048")	n/a	n/a	4	03-06-00
Live Load Deflection	L/999 (0.028")	n/a	n/a	5	03-06-00
Max Defl.	0.048"	n/a	n/a	4	03-06-00
Span / Depth	8.6				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 5-1/4"	3,371 lbs	22.6%	15.0%	Unspecified
B2	Wall/Plate 3-1/2" x 5-1/4"	3,172 lbs	21.3%	14.1%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Member has no side loads.



FIG NO. TAM B00910161/2
STRUCTURAL
COMPONENT ONLY

T-6811029



Boise Cascade



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Dropped Beams\B25 DR(i5361)

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R

File name: GLENWAY 12A LOT 12.mmdl


Description: 2ND FLR FRAMING\Dropped Beams\B25 DR(i5361)

Specifier:

Designer: CF

Company:

Connection Diagram: Full Length of Member

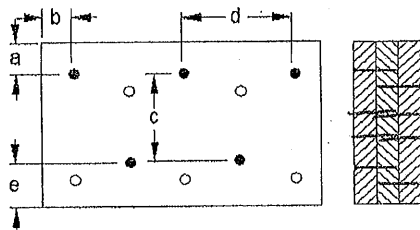

4 rows

a minimum = 0"

b minimum = 3"

c = 4 1/2"

d = 6"

e minimum = 2"


Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Member has no side loads.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL




Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. TAM 000918H
STRUCTURAL
COMPONENT ONLY 10%

T-181029(2)



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B10(i5782)

BC CALC® Member Report

Dry | 1 span | No cant.

October 29, 2018 16:15:28

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B10(i5782)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

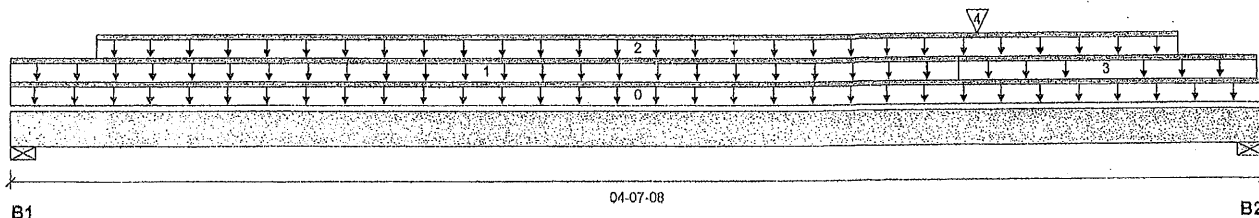

Total Horizontal Product Length = 04-07-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-3/4"	54 / 0	189 / 0		
B2, 3-3/4"	121 / 0	333 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-07-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-06-00	Top	14	5			n/a
2	User Load	Unf. Lin. (lb/ft)	L	00-03-12	04-03-12	Top		60			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	03-06-00	04-07-04	Top	13	5			n/a
4	B11(i5818)	Conc. Pt. (lbs)	L	03-06-14	03-06-14	Top	112	236			n/a

Controls Summary


	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	362 ft-lbs	7,546 ft-lbs	4.8%	0	02-11-11
End Shear	363 lbs	3,761 lbs	9.7%	0	03-06-04
Total Load Deflection	L/999 (0.004")	n/a	n/a	4	02-05-07
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	02-05-07
Max Defl.	0.004"	n/a	n/a	4	02-05-07
Span / Depth	5.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-3/4" x 1-3/4"	265 lbs	11.6%	5.1%	Unspecified
B2	Wall/Plate 3-3/4" x 1-3/4"	466 lbs	20.5%	9.0%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume member is fully braced.
 Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
 Design based on Dry Service Condition.
 Importance Factor: Normal Part code: Part 9



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).
 Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods.
 Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

DWG NO. TAM 00907B14
 STRUCTURAL
 COMPONENT ONLY

T-1811030



Boise Cascade

**Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B11\15818)**

October 29, 2018 16:15:28

BC CALC® Member Report

Dry | 1 span | No cant.

Buld 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B11\15818)

City, Province, Postal Code: EAS...URY


Specifier:

Customer:

Designer: CF

Code reports: CCMC 12472-R

Company:

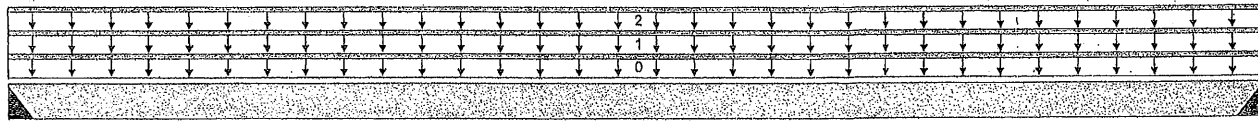

B1

06-00-00

B2

Total Horizontal Product Length = 06-00-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2"	114 / 0	237 / 0		
B2, 2"	112 / 0	236 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-00-00	Top	5				00-00-00
1	User Load	Unf. Lin. (lb/ft)	L	00-00-00	06-00-00	Top	60				n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	06-00-00	Top	38	14			n/a

Controls Summary	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	463 ft-lbs	7,546 ft-lbs	6.1%	0	03-00-00
End Shear	377 lbs	5,785 lbs	6.5%	1	00-11-08
Total Load Deflection	L/999 (0.012")	n/a	n/a	4	03-00-00
Live Load Deflection	L/999 (0.004")	n/a	n/a	5	03-00-00
Max Defl.	0.012"	n/a	n/a	4	03-00-00
Span / Depth	7.3				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Hanger	2" x 1-3/4"	332 lbs	n/a	12.0%	HUS1.81/10
B2 Hanger	2" x 1-3/4"	331 lbs	n/a	11.9%	HUS1.81/10

Cautions

Header for the hanger HUS1.81/10 at B1 is a Triple 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Header for the hanger HUS1.81/10 at B2 is a Single 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume member is fully braced.
 Hanger Manufacturer: Unassigned
 Resistance Factor phi has been applied to all presented results per CSA O86.
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
 Design based on Dry Service Condition.
 Importance Factor : Normal Part code : Part 9


CONFORMS TO OBC 2012**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC1®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM 8091784
 STRUCTURAL
 COMPONENT ONLY

T-181103 |



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B15(i5307)

October 29, 2018 16:15:28

BC CALC® Member Report

Dry | 1 span | No cant.

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B15(i5307)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

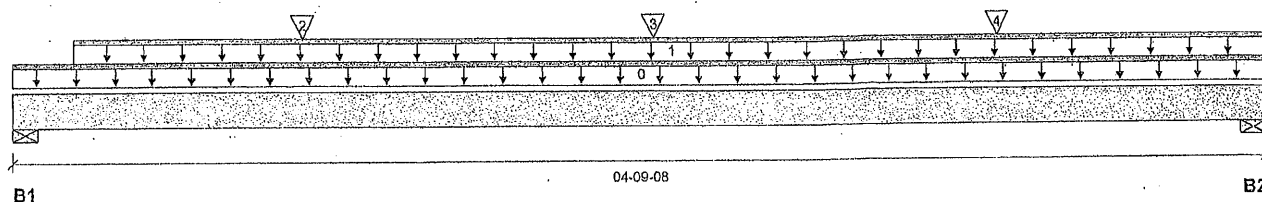

Total Horizontal Product Length = 04-09-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-3/4"	621 / 0	244 / 0		
B2, 5-1/2"	597 / 0	235 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-09-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-12	04-09-08	Top	26	10			n/a
2	J1(i5393)	Conc. Pt. (lbs)	L	01-01-04	01-01-04	Top	390	148			n/a
3	J1(i5394)	Conc. Pt. (lbs)	L	02-05-04	02-05-04	Top	390	146			n/a
4	J1(i5395)	Conc. Pt. (lbs)	L	03-09-04	03-09-04	Top	320	120			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,337 ft-lbs	11,610 ft-lbs	11.5%	1	02-05-04
End Shear	1,015 lbs	5,785 lbs	17.5%	1	01-03-04
Total Load Deflection	L/999 (0.01")	n/a	n/a	4	02-04-13
Live Load Deflection	L/999 (0.007")	n/a	n/a	5	02-04-13
Max Defl.	0.01"	n/a	n/a	4	02-04-13
Span / Depth	5.0				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-3/4" x 1-3/4"	1,238 lbs	23.0%	10.1%	Unspecified
B2	Wall/Plate 5-1/2" x 1-3/4"	1,190 lbs	23.2%	10.1%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
Design meets Code minimum (L/360) Live load deflection criteria.
Calculations assume member is fully braced.
Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
Design based on Dry Service Condition.
Importance Factor : Normal Part code : Part 9



Disclosure

Use of the Bolse Cascade Software is subject to the terms of the End User License Agreement (EULA).
Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods.
Installation of Bolse Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

DWG NO. TAM 80921BH
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BCI®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®

T-111032



Boise Cascade



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B30(I5351)

October 29, 2018 16:15:28

BC CALC® Member Report

Dry | 1 span | No cant.

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B30(I5351)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

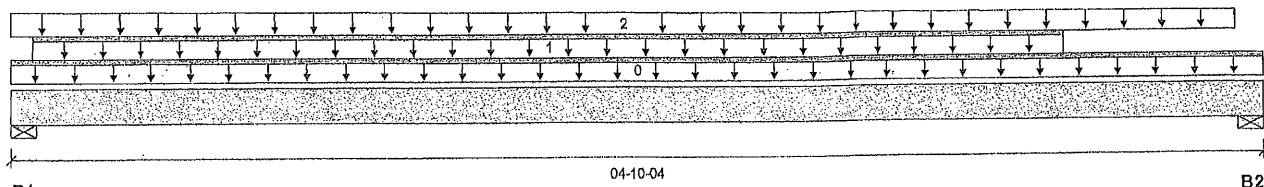

B1

04-10-04

B2

Total Horizontal Product Length = 04-10-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5-1/2"	738 / 0	288 / 0		
B2, 4-3/4"	522 / 0	207 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-10-04	Top	1.00	0.65	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-01-00	04-01-00	Top	292	110			n/a
2	FC2 Floor Material	Trapezoidal (lb/ft)	L	00-00-00	04-09-00	Top	21	8			n/a
							18	7			

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,362 ft-lbs	11,610 ft-lbs	11.7%	1	02-01-00
End Shear	1,024 lbs	5,785 lbs	17.7%	1	03-08-00
Total Load Deflection	L/999 (0.011")	n/a	n/a	4	02-05-08
Live Load Deflection	L/999 (0.008")	n/a	n/a	5	02-05-08
Max Defl.	0.011"	n/a	n/a	4	02-05-08
Span / Depth	5.2				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 5-1/2" x 1-3/4"	1,468 lbs	28.6%	12.5%	Unspecified
B2	Wall/Plate 4-3/4" x 1-3/4"	1,041 lbs	23.5%	10.3%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9




Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM 8093704
STRUCTURAL
COMPONENT ONLY

T-181033



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLR FRAMING\Flush Beams\B31(i5700)

October 29, 2018 16:15:28

BC CALC® Member Report

Dry | 1 span | No cant.

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B31(i5700)

City, Province, Postal Code: EAS...URY


Specifier:

Customer:

Designer: CF

Code reports: CCMC 12472-R

Company:

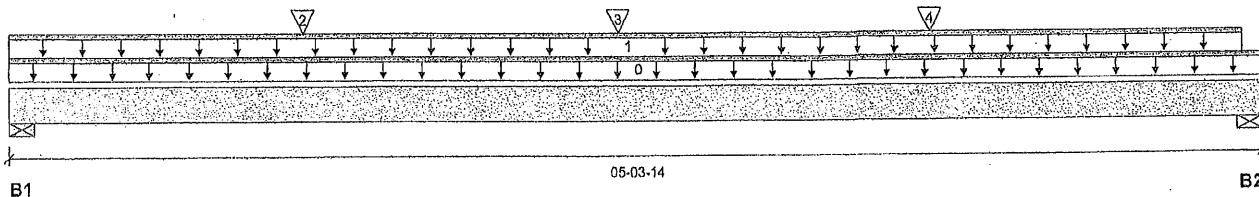

Total Horizontal Product Length = 05-03-14

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-3/8"	585 / 0	232 / 0		
B2, 5-1/2"	581 / 0	231 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-03-14	Top	1.00	0.65	1.00	1.15	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	05-02-14	Top	5	2			n/a
2	J1(i5383)	Conc. Pt. (lbs)	L	01-02-14	01-02-14	Top	361	136			n/a
3	J1(i5554)	Conc. Pt. (lbs)	L	02-06-14	02-06-14	Top	390	146			n/a
4	J1(i5385)	Conc. Pt. (lbs)	L	03-10-14	03-10-14	Top	390	146			n/a

Controls Summary


	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,652 ft-lbs	11,610 ft-lbs	14.2%	1	02-06-14
End Shear	1,149 lbs	5,785 lbs	19.9%	1	01-01-14
Total Load Deflection	L/999 (0.017")	n/a	n/a	4	02-07-06
Live Load Deflection	L/999 (0.012")	n/a	n/a	5	02-07-06
Max Defl.	0.017"	n/a	n/a	4	02-07-06
Span / Depth	5.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4-3/8" x 1-3/4"	1,167 lbs	28.5%	12.5%	Unspecified
B2	Wall/Plate 5-1/2" x 1-3/4"	1,160 lbs	22.6%	9.9%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
 Design meets Code minimum (L/360) Live load deflection criteria.
 Calculations assume member is fully braced.
 Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.
 Design based on Dry Service Condition.
 Importance Factor: Normal Part code: Part 9



Disclosure

Use of the Bolse Cascade Software is subject to the terms of the End User License Agreement (EULA).
 Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods.
 Installation of Bolse Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
 DWG NO. TAM 809412A
 STRUCTURAL
 COMPONENT ONLY

T-1811034P



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B13(I5813)**

October 29, 2018 16:15:28

BC CALC® Member Report

Dry | 1 span | No cant.

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B13(I5813)

City, Province, Postal Code: EAS...URY

Specifier:


Customer:

Designer: CF

Code reports:

CCMC 12472-R

Company:

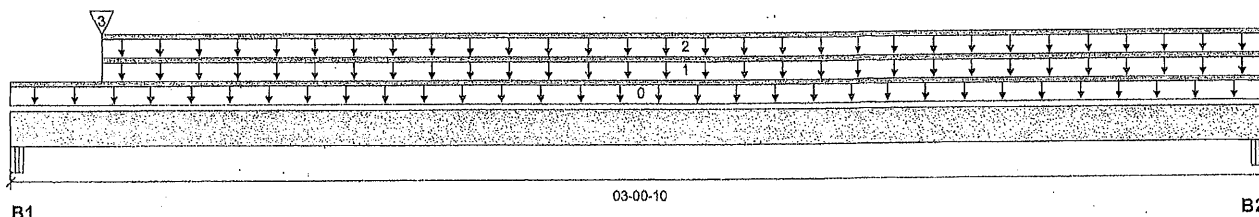

Total Horizontal Product Length = 03-00-10

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	30 / 0	145 / 0		
B2, 5-1/4"	38 / 0	193 / 0		


Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-00-10	Top	1.00	0.65	1.00	1.15	00-00-00
1	User Load	Unf. Lin. (lb/ft)	L	00-02-10	03-00-10	Top		10			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	03-00-10	Top	23	100			n/a
3	FC2 Floor Material	Conc. Pt. (lbs)	L	00-02-10	00-02-10	Top	2	9			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	131 ft-lbs	15,093 ft-lbs	0.9%	0	01-05-00
End Shear	77 lbs	7,521 lbs	1.0%	0	01-00-02
Total Load Deflection	L/999 (0")	n/a	n/a	4	01-05-00
Live Load Deflection	L/999 (0")	n/a	n/a	5	01-05-00
Max Defl.	0"	n/a	n/a	4	01-05-00
Span / Depth	3.2				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	2-5/8" x 3-1/2"	203 lbs	6.4%	2.8%	Unspecified
B2 Beam	5-1/4" x 3-1/2"	271 lbs	4.2%	1.9%	Unspecified

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

DWG NO. TAM **B0957B14**
 STRUCTURAL
 COMPONENT ONLY
 10/16

T-L81035



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B13(i5813)**

BC CALC® Member Report

Dry | 1 span | No cant.

October 29, 2018 16:15:28

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B13(i5813)

City, Province, Postal Code: EAS...URY


Specifier:

Customer:

Designer: CF

Code reports: CCMC 12472-R

Company:

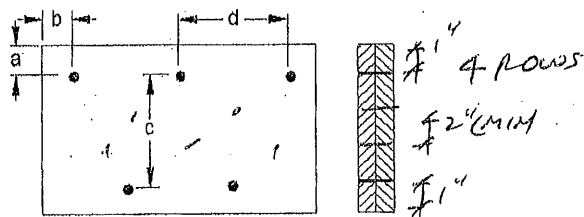
Connection Diagram: Full Length of Member

a minimum = 1"
b minimum = 3"

c = 1-1/2"
d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
Member has no side loads.


Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
DWG NO. TAM 8095194
STRUCTURAL
COMPONENT ONLY

T-1811035(1)

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B14(i5245)**

October 29, 2018 16:15:28

BC CALC® Member Report

Dry | 1 span | No cant.

Build 6475

Job name:

File name: GLENWAY 12A LOT 12.mmdl

Address:

Description: 2ND FLR FRAMING\Flush Beams\B14(i5245)

City, Province, Postal Code: EAS...URY


Specifier:

Customer:

Designer: CF

Code reports: CCMC 12472-R

Company:

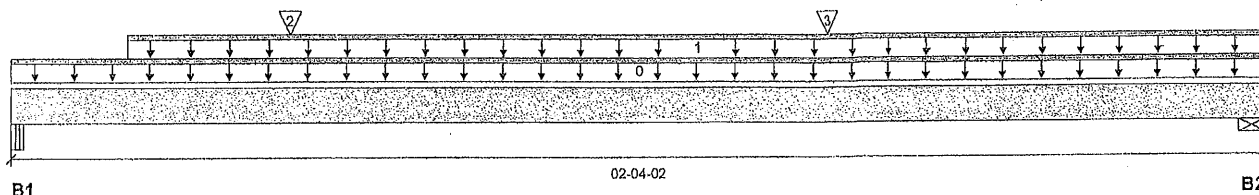

Total Horizontal Product Length = 02-04-02

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	358 / 0	258 / 0	49 / 0	
B2, 4-3/8"	246 / 0	229 / 0	10 / 0	

Load Summary


Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	02-04-02	Top	1.00	0.65	1.00	1.15	00-00-00
1	User Load	Unf. Lin. (lb/ft)	L	00-02-10	02-04-02	Top		100			n/a
2	J1(i5806)	Conc. Pt. (lbs)	L	00-06-04	00-06-04	Top	334	151	59		n/a
3	J1(i5820)	Conc. Pt. (lbs)	L	01-06-04	01-06-04	Top	270	101			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	304 ft-lbs	23,220 ft-lbs	1.3%	1	01-04-12
End Shear	278 lbs	11,571 lbs	2.4%	1	01-02-04
Total Load Deflection	L/999 (0")	n/a	n/a	35	01-01-10
Live Load Deflection	L/999 (0")	n/a	n/a	51	01-01-10
Max Defl.	0"	n/a	n/a	35	01-01-10
Span / Depth	2.3				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 3-1/2" x 3-1/2"	884 lbs	6.6%	5.9%	Unspecified
B2	Wall/Plate 4-3/8" x 3-1/2"	660 lbs	8.1%	3.5%	Unspecified

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2010 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWG NO. TAM 80967 B14
STRUCTURAL
COMPONENT ONLY

T-111036



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****2ND FLR FRAMING\Flush Beams\B14\I5245)**

Dry | 1 span | No cant.

October 29, 2018 16:15:28

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: EAS...URY

Customer:

Code reports: CCMC 12472-R


File name: GLENWAY 12A LOT 12.mmdl

Description: 2ND FLR FRAMING\Flush Beams\B14\I5245)

Specifier:

Designer: CF

Company:

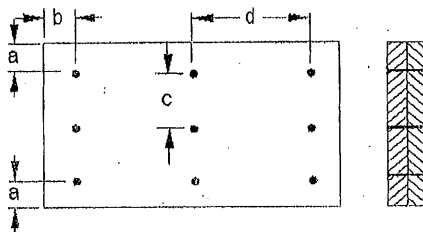Connection Diagram: Full Length of Member


a minimum = 2"
b minimum = 3"

c = 2-3/4" u
d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 16d Nails

3-1/2" ARDOX SPIRAL

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,



DWG NO. TAM 809610H
STRUCTURAL
COMPONENT ONLY

Page

T-811036(1)

Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing






Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing





Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
14"	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
16"	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
14"	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
16"	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing





Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
14"	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
16"	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
14"	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
16"	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of $1.50L + 1.25D$. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of $L/480$ and a total load deflection limit of $L/240$.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.

Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing



Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A
Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.