


FROM PLAN DATED: SEPT 24 2018  
 BUILDER: GREENPARK HOMES  
 SITE: LAMBERTS LANE  
 MODEL: PRESTON 1  
 ELEVATION: 1  
 LOT:  
 CITY: CALEDON  
 SALESMAN: M D  
 DESIGNER: PL  
 REVISION: lbv

**NOTES:**  
 REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.  
**SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING **DUCT CHASE AND FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE APPLICATION** AS PER O.B.C 9.30.6.

**LOADING:**  
 DESIGN LOADS: L/480.000  
 LIVE LOAD: 40.0 lb/ft<sup>2</sup>  
 DEAD LOAD: 15.0 lb/ft<sup>2</sup>  
 TILED AREAS: 20 lb/ft<sup>2</sup>  
**SUBFLOOR: 3/4" GLUED AND NAILED**  
 DATE: 2019-07-06


1st FLOOR

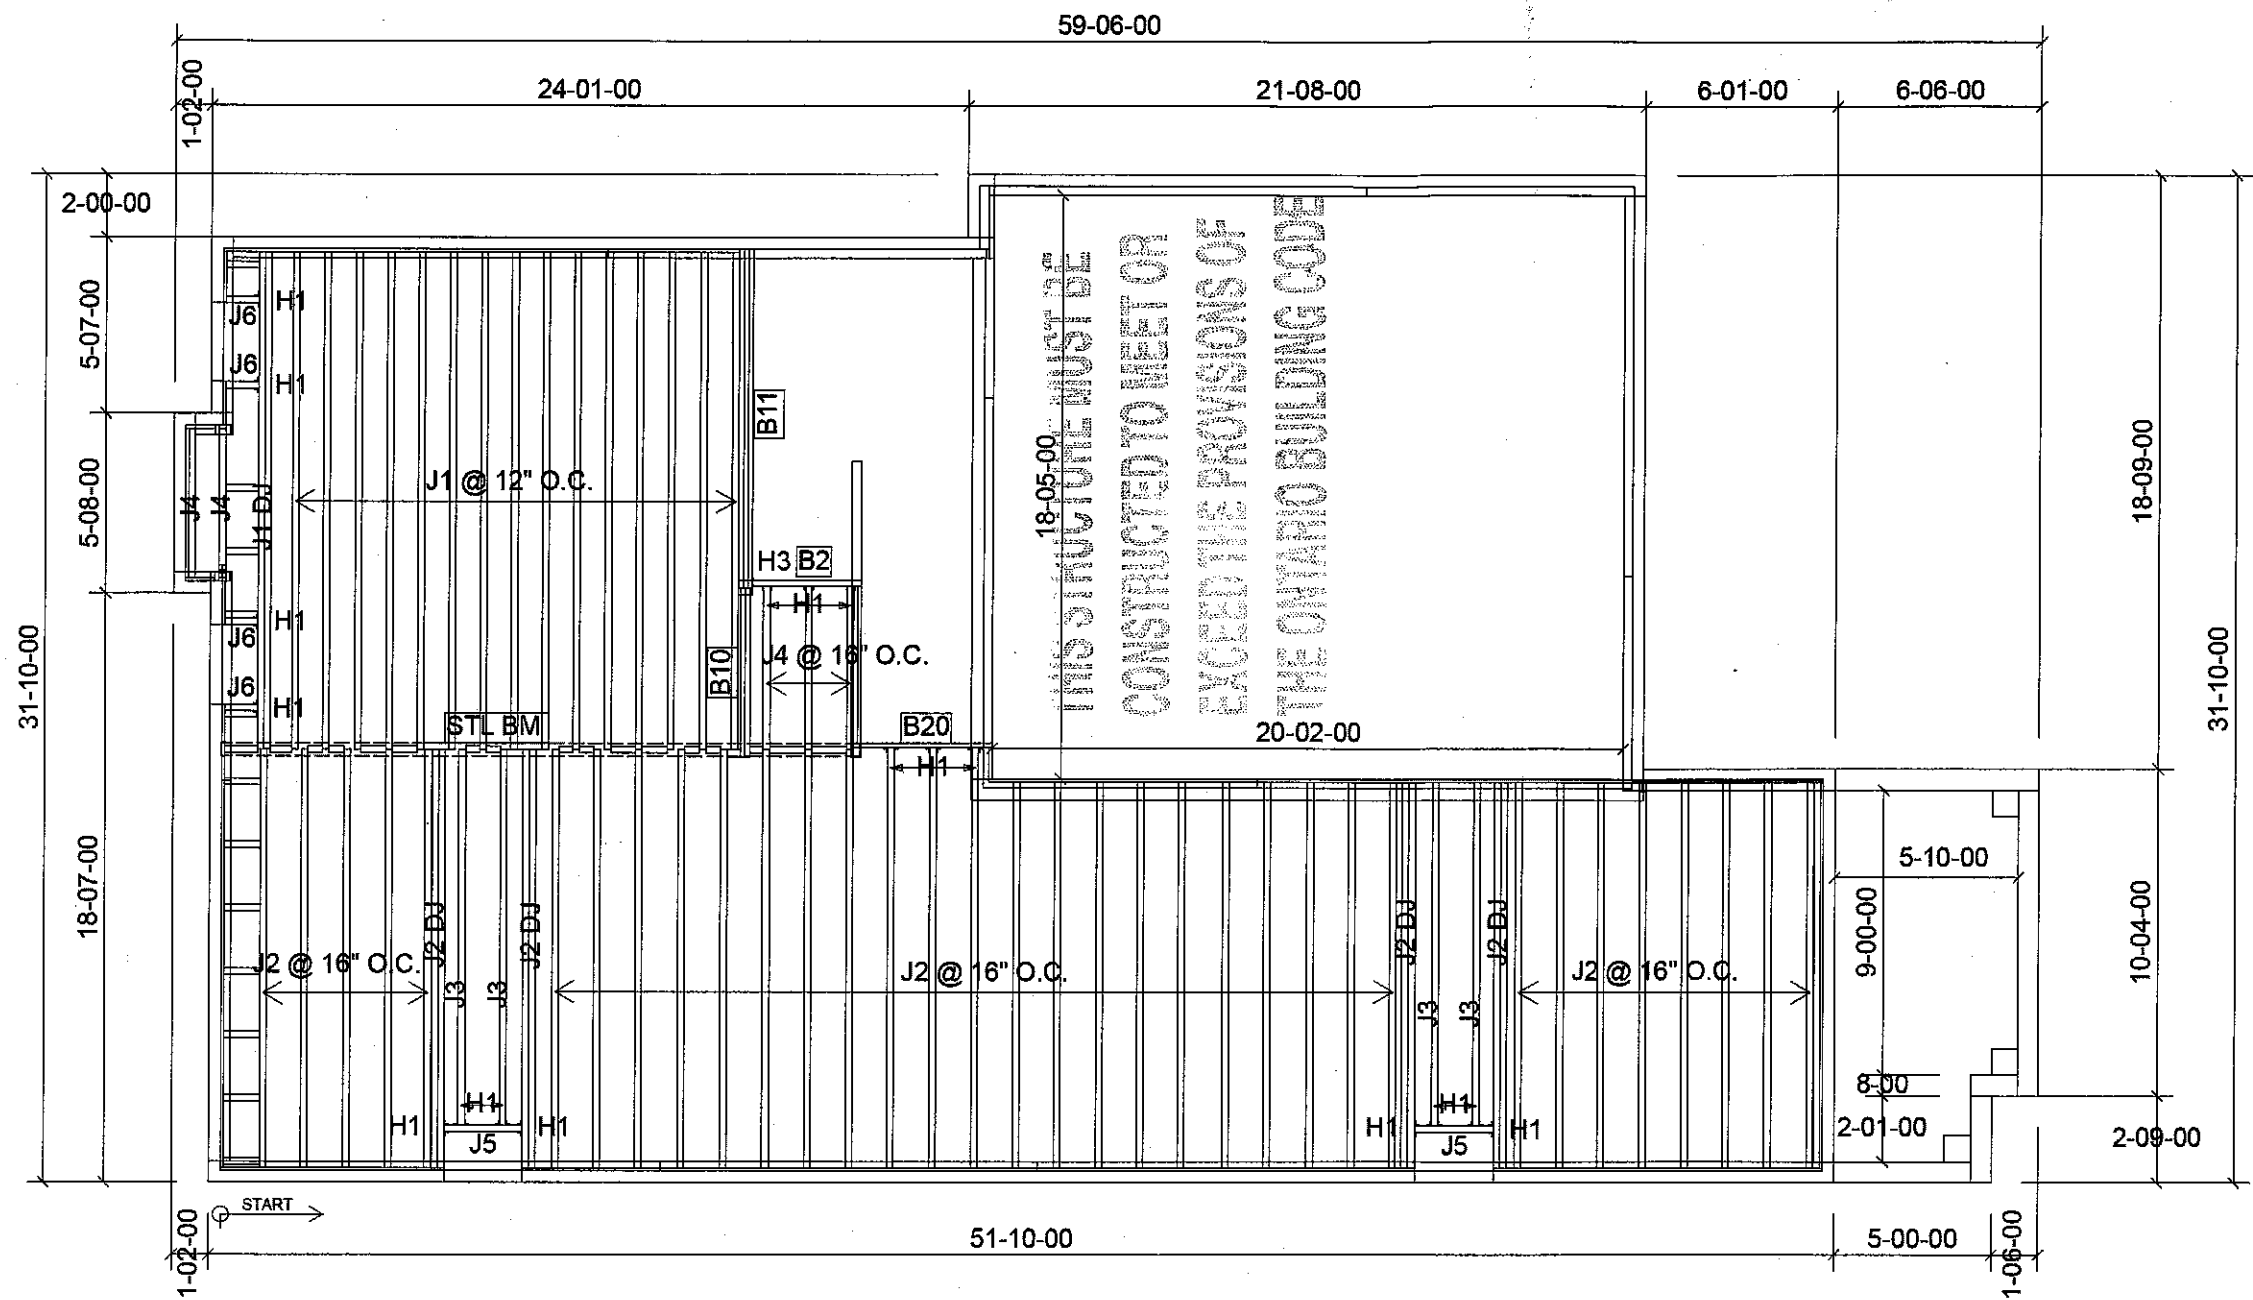

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	15
J1 DJ	16-00-00	9 1/2" NI-40x	2	2
J2	14-00-00	9 1/2" NI-40x	1	34
J2 DJ	14-00-00	9 1/2" NI-40x	2	8
J3	12-00-00	9 1/2" NI-40x	1	4
J4	6-00-00	9 1/2" NI-40x	1	5
J5	4-00-00	9 1/2" NI-40x	1	2
J6	2-00-00	9 1/2" NI-40x	1	4
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B20	6-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
3	H1	IUS2.56/9.5
8	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
3	H1	IUS2.56/11.88
1	H4	HUS1.81/10

**RECEIVED**  
 JUL 26 2019  
 TOWN OF CALEDON  
 BUILDING SECTION  
 FILE NO

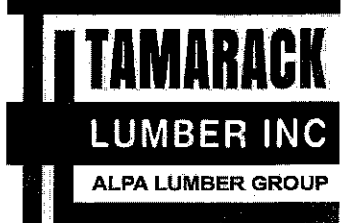

FROM PLAN DATED: SEPT 24 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 1

ELEVATION: 2

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION: lbv

**NOTES:**

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

**SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.


**LOADING:**

DESIGN LOADS: L/480.000  
LIVE LOAD: 40.0 lb/ft<sup>2</sup>  
DEAD LOAD: 15.0 lb/ft<sup>2</sup>  
TILED AREAS: 20 lb/ft<sup>2</sup>

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2019-07-06

1st FLOOR

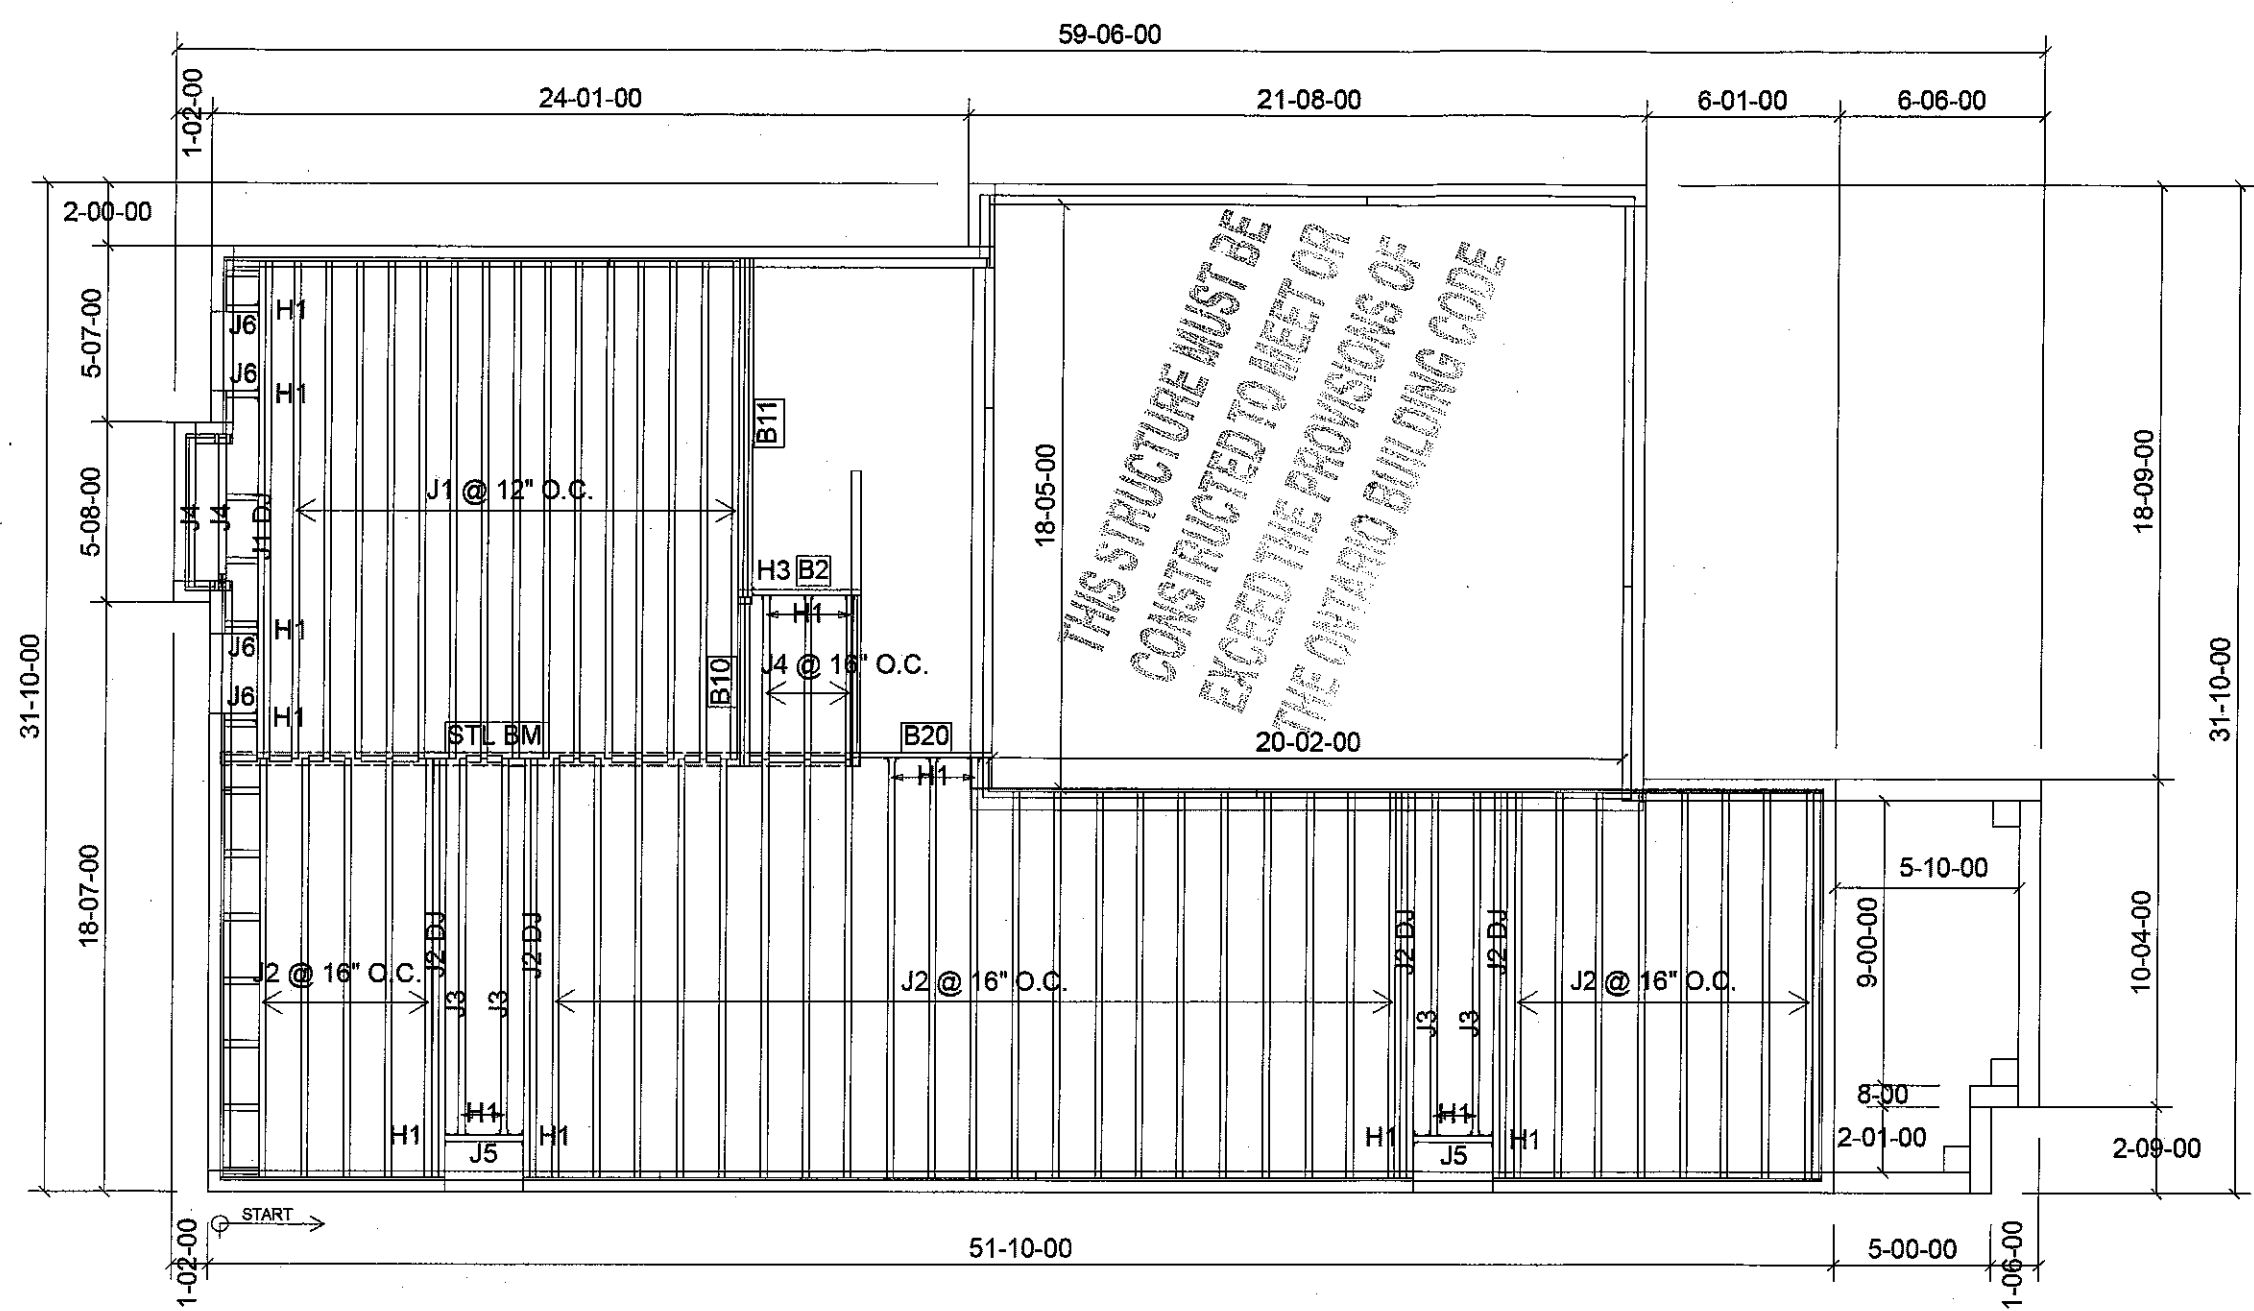


Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	15
J1 DJ	16-00-00	9 1/2" NI-40x	2	2
J2	14-00-00	9 1/2" NI-40x	1	34
J2 DJ	14-00-00	9 1/2" NI-40x	2	8
J3	12-00-00	9 1/2" NI-40x	1	4
J4	6-00-00	9 1/2" NI-40x	1	5
J5	4-00-00	9 1/2" NI-40x	1	2
J6	2-00-00	9 1/2" NI-40x	1	4
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2
B2	4-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	1	1
B20	6-00-00	1-3/4" x 11-7/8" VERSA-LAM@ 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
3	H1	IUS2.56/9.5
8	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
3	H1	IUS2.56/11.88
1	H4	HUS1.81/10

RECEIVED  
JUL 26 2019

TOWN OF CALEDON  
BUILDING SECTION  
FILE NO.

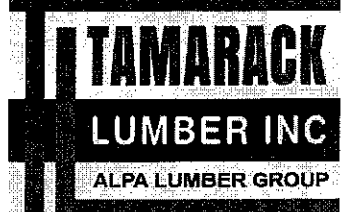

FROM PLAN DATED: SEPT 24 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 1

ELEVATION: 1

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION: lbv

**NOTES:**

REFER TO THE **NORDIC INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION.

**SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

**LOADING:**

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 15.0 lb/ft<sup>2</sup>


TILED AREAS: 20 lb/ft

**SUBFLOOR:** 3/4" GLUED AND NAILED

DATE: 2019-07-06

1st FLOOR

DECK

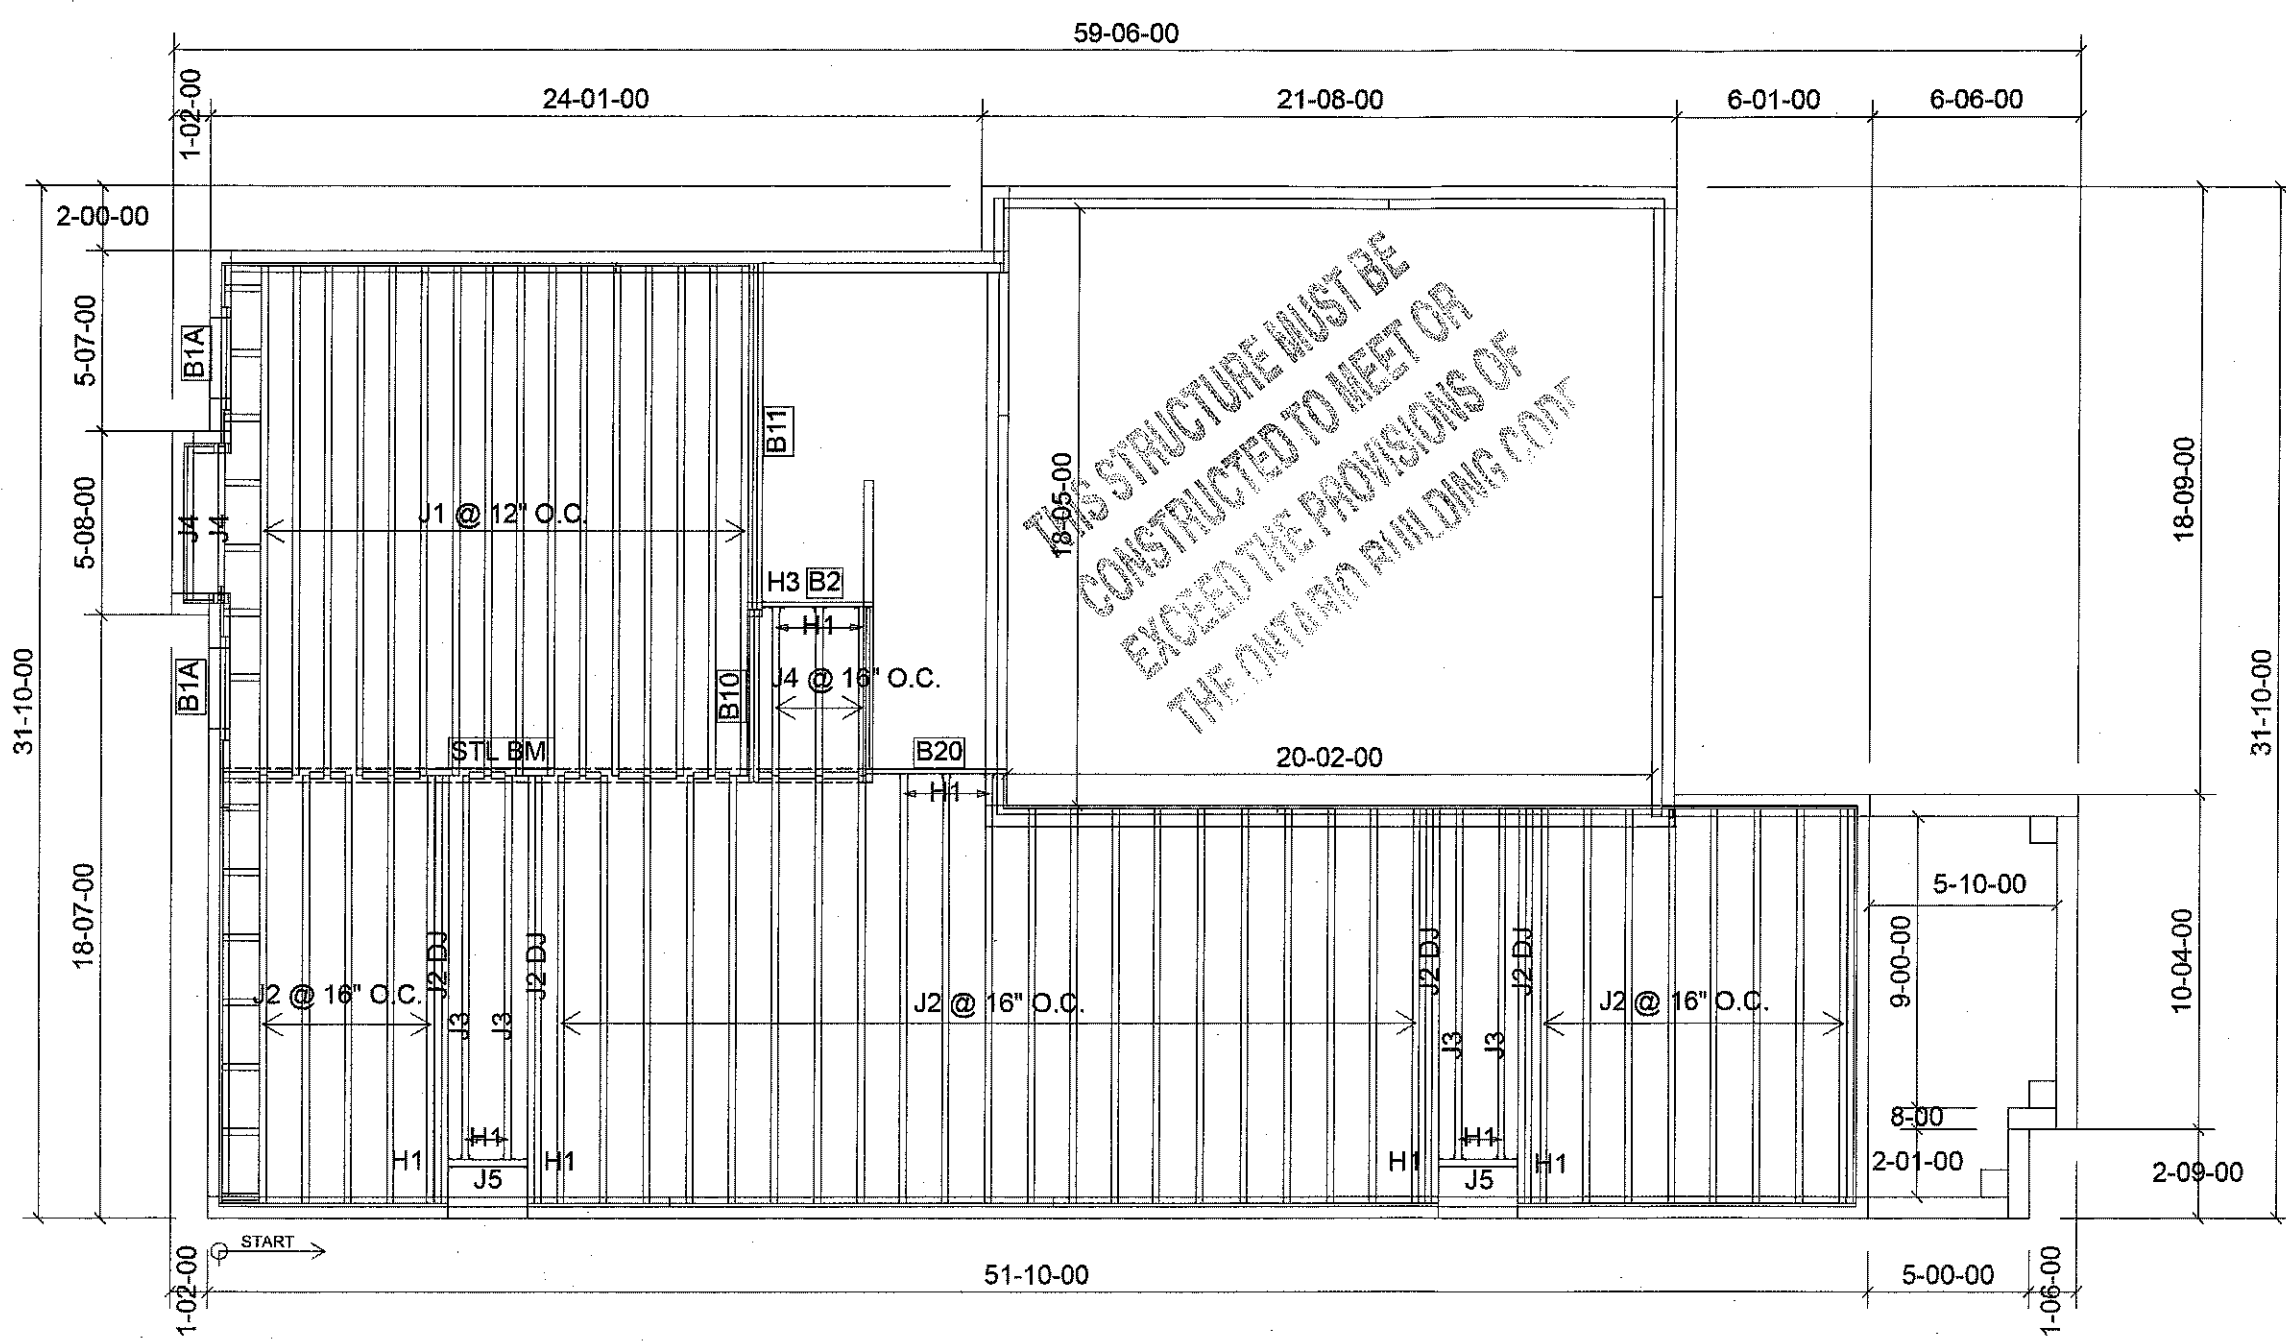


Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	16
J2	14-00-00	9 1/2" NI-40x	1	34
J2 DJ	14-00-00	9 1/2" NI-40x	2	8
J3	12-00-00	9 1/2" NI-40x	1	4
J4	6-00-00	9 1/2" NI-40x	1	5
J5	4-00-00	9 1/2" NI-40x	1	2
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	4
B20	6-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
3	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
3	H1	IUS2.56/11.88
1	H4	HUS1.81/10

RECEIVED  
JUL 26 2019

TOWN OF CALEDON  
BUILDING SECTION  
FILE NO

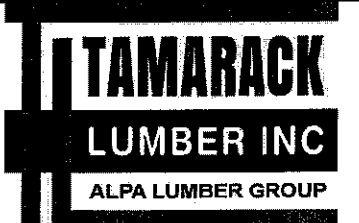

FROM PLAN DATED: SEPT 24 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 1

ELEVATION: 2

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION: lbv

**NOTES:**

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

**SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

**LOADING:**

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft<sup>2</sup>

DEAD LOAD: 15.0 lb/ft<sup>2</sup>


TILED AREAS: 20 lb/ft

**SUBFLOOR:** 3/4" GLUED AND NAILED

DATE: 2019-07-06

1st FLOOR

DECK

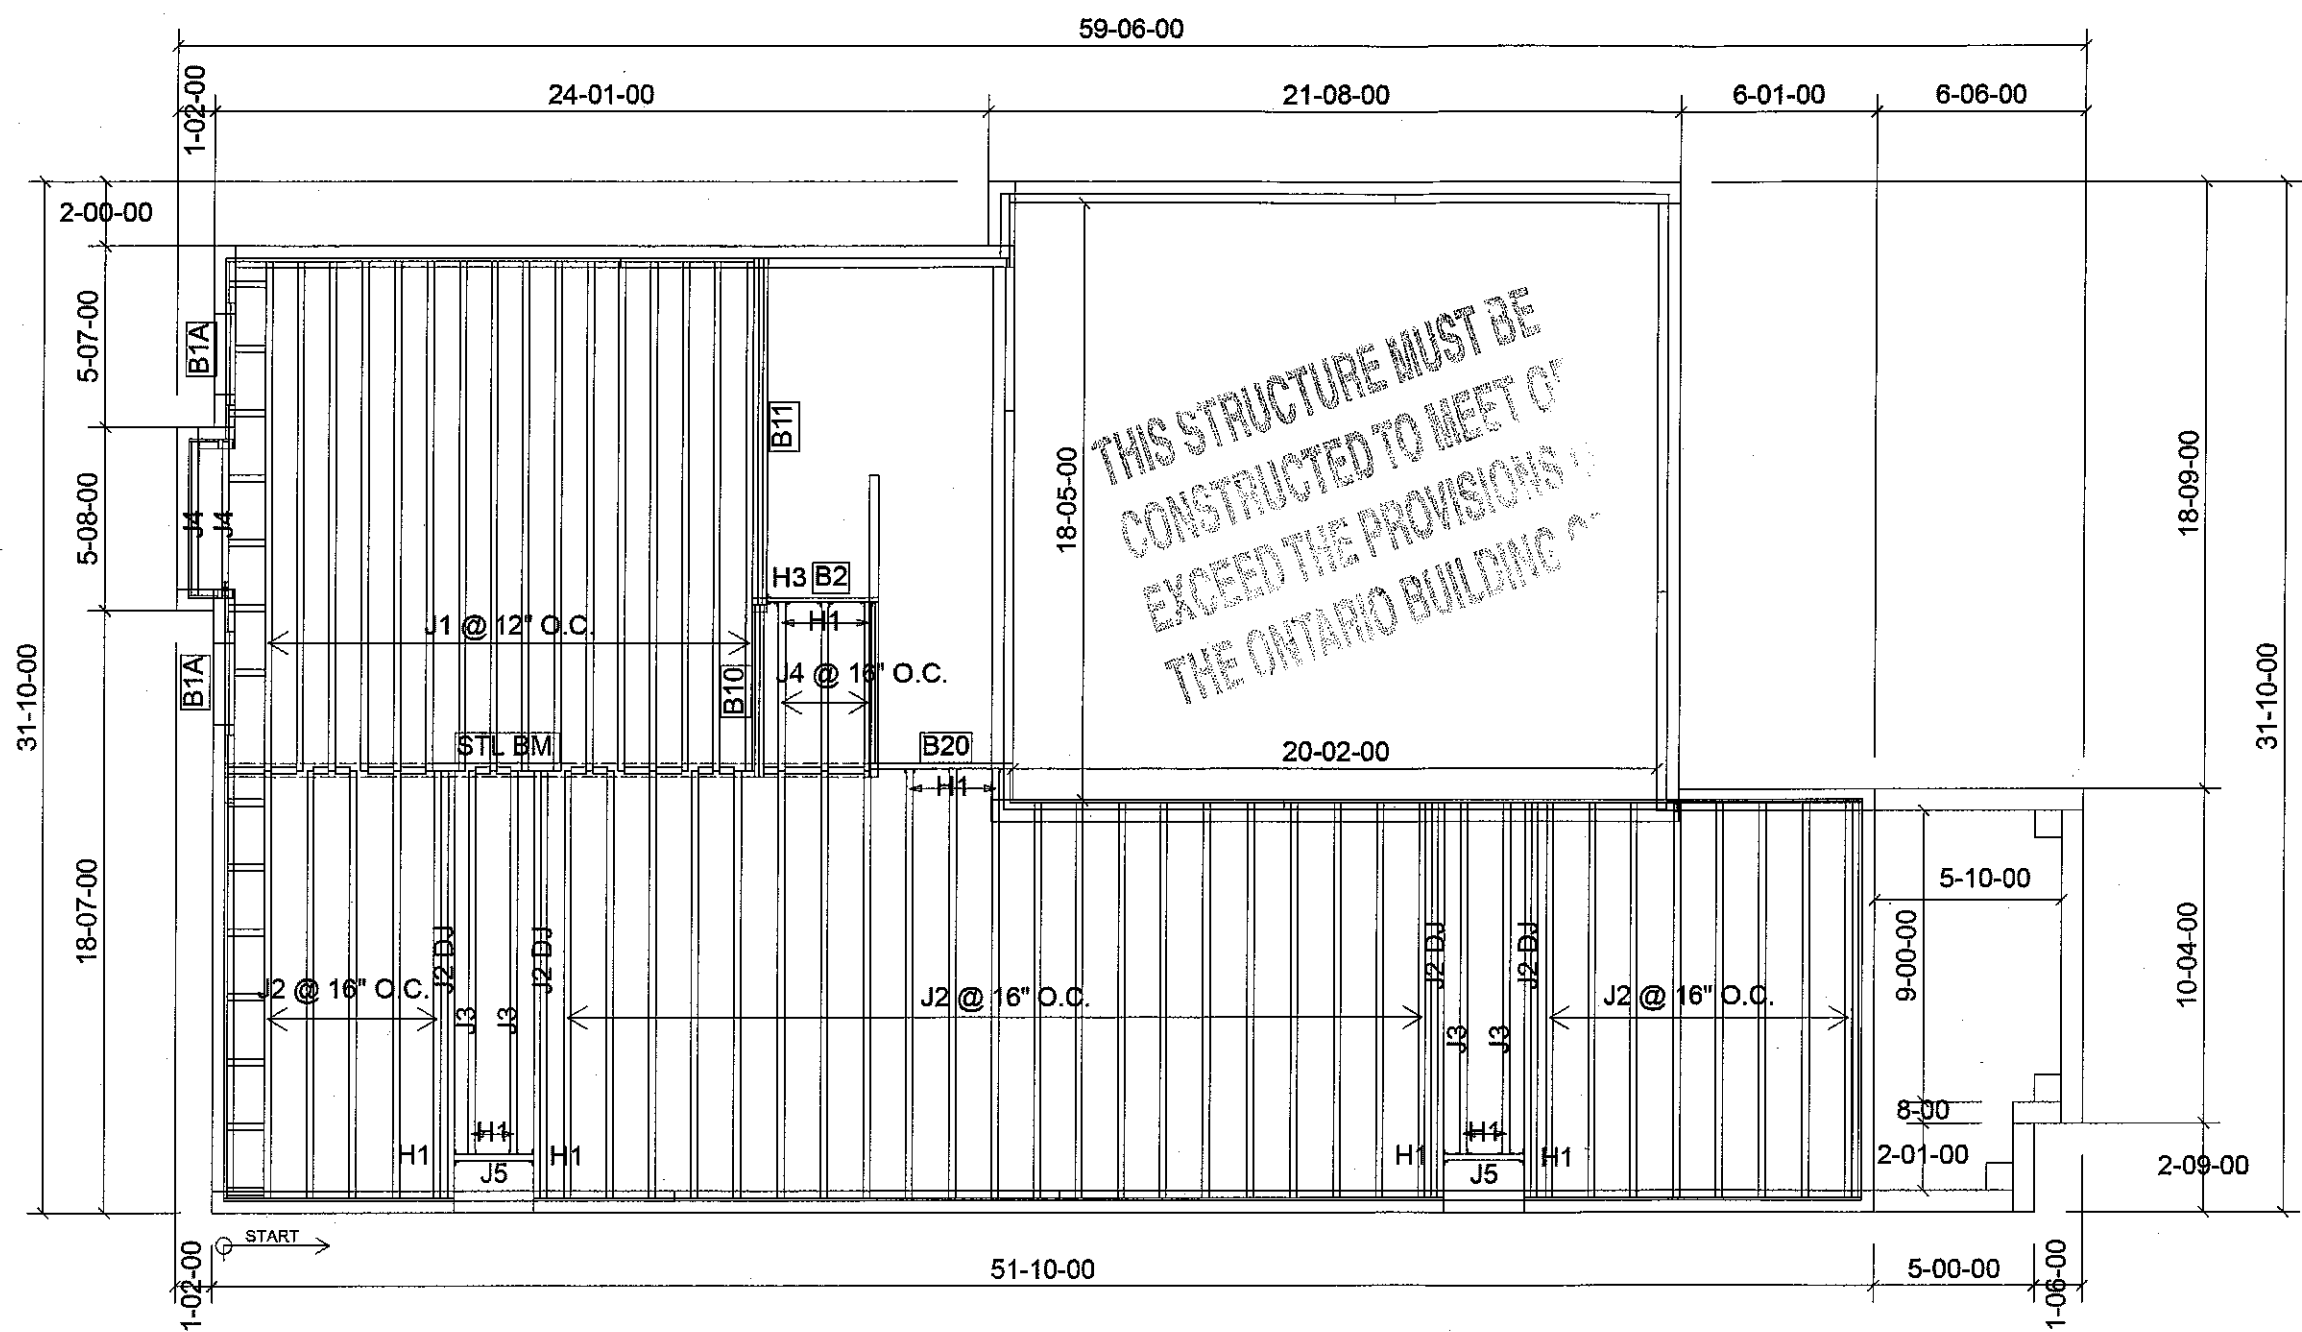


Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	16
J2	14-00-00	9 1/2" NI-40x	1	34
J2 DJ	14-00-00	9 1/2" NI-40x	2	8
J3	12-00-00	9 1/2" NI-40x	1	4
J4	6-00-00	9 1/2" NI-40x	1	5
J5	4-00-00	9 1/2" NI-40x	1	2
B11	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B10	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	4
B20	6-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
3	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
3	H1	IUS2.56/11.88
1	H4	HUS1.81/10

RECEIVED  
JUL 26 2019

TOWN OF CALEDON  
BUILDING SECTION  
FILE NO.

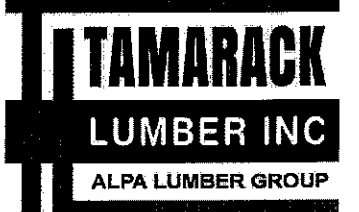

FROM PLAN DATED: SEPT 24 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 1

ELEVATION: 1

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION:

**NOTES:**

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

**LOADING:**


DESIGN LOADS: L/480.000  
LIVE LOAD: 40.0 lb/ft<sup>2</sup>  
DEAD LOAD: 15.0 lb/ft<sup>2</sup>  
TILED AREAS: 20 lb/ft

**SUBFLOOR:** 5/8" GLUED AND NAILED

DATE: 11/9/2018

2nd FLOOR

STANDARD

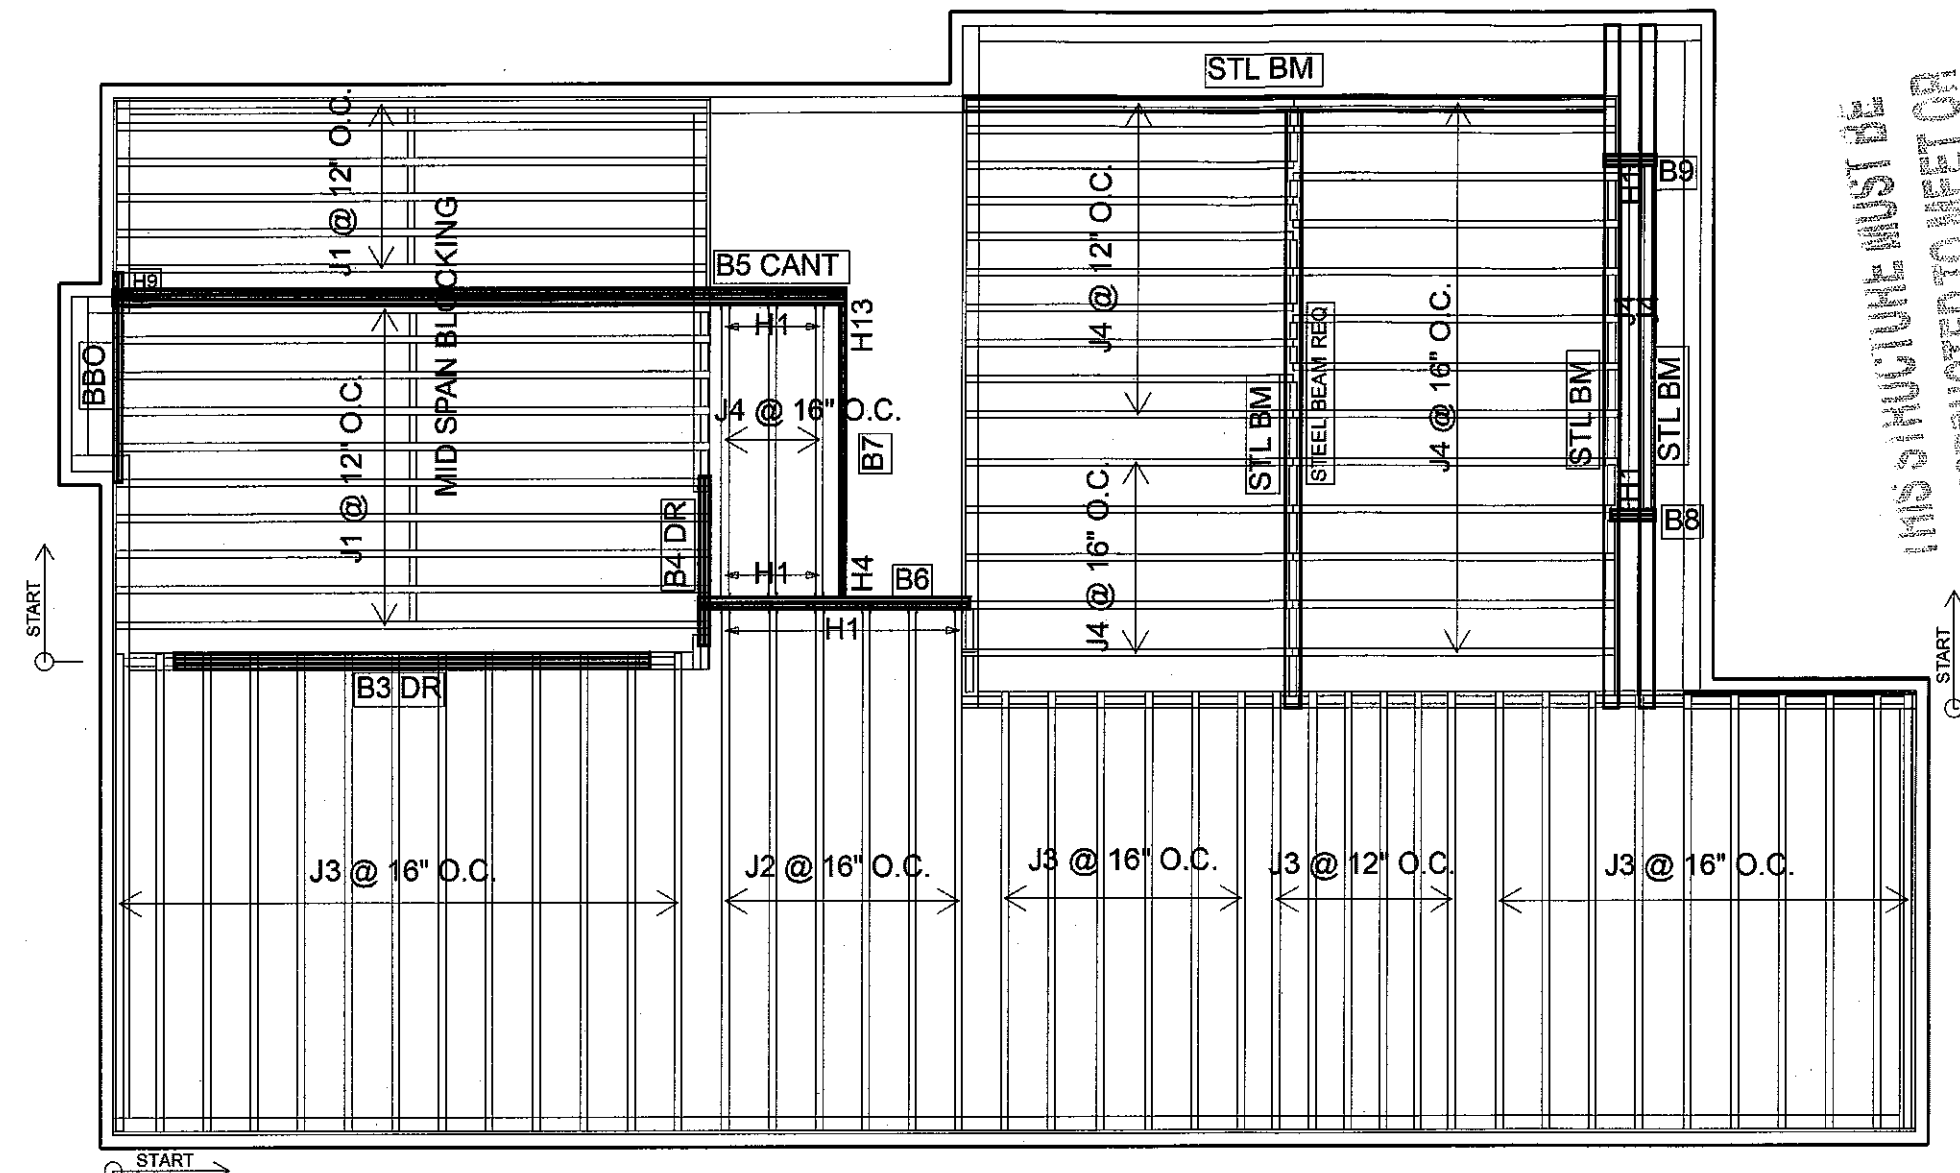


THIS STRUCTURE MUST BE CONSTRUCTED TO MEET OR EXCEED THE PROVISIONS OF THE CANADIAN BUILDING CODE

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	9 1/2" NI-40x	1	16
J2	16-00-00	9 1/2" NI-40x	1	6
J3	14-00-00	9 1/2" NI-40x	1	35
J4	10-00-00	9 1/2" NI-40x	1	33
B5 CANT	22-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B3 DR	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B7	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B6	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B4 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B8	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B9	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
3	H1	IUS2.56/9.5
1	H4	HUS1.81/10
1	H13	LS90
1	H9	H2.5A*

RECEIVED  
JUL 26 2019

TOWN OF CALEDON  
BUILDING SECTION  
FILE NO. \_\_\_\_\_

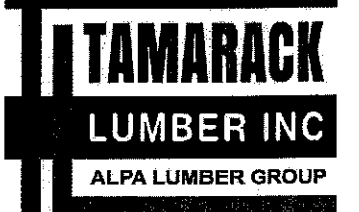

FROM PLAN DATED: SEPT 24 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 1

ELEVATION: 2

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION:

**NOTES:**

REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

**LOADING:**


DESIGN LOADS: L/480.000  
 LIVE LOAD: 40.0 lb/ft<sup>2</sup>  
 DEAD LOAD: 15.0 lb/ft<sup>2</sup>  
 TILED AREAS: 20 lb/ft

**SUBFLOOR:** 5/8" GLUED AND NAILED

DATE: 11/9/2018

2nd FLOOR

STANDARD

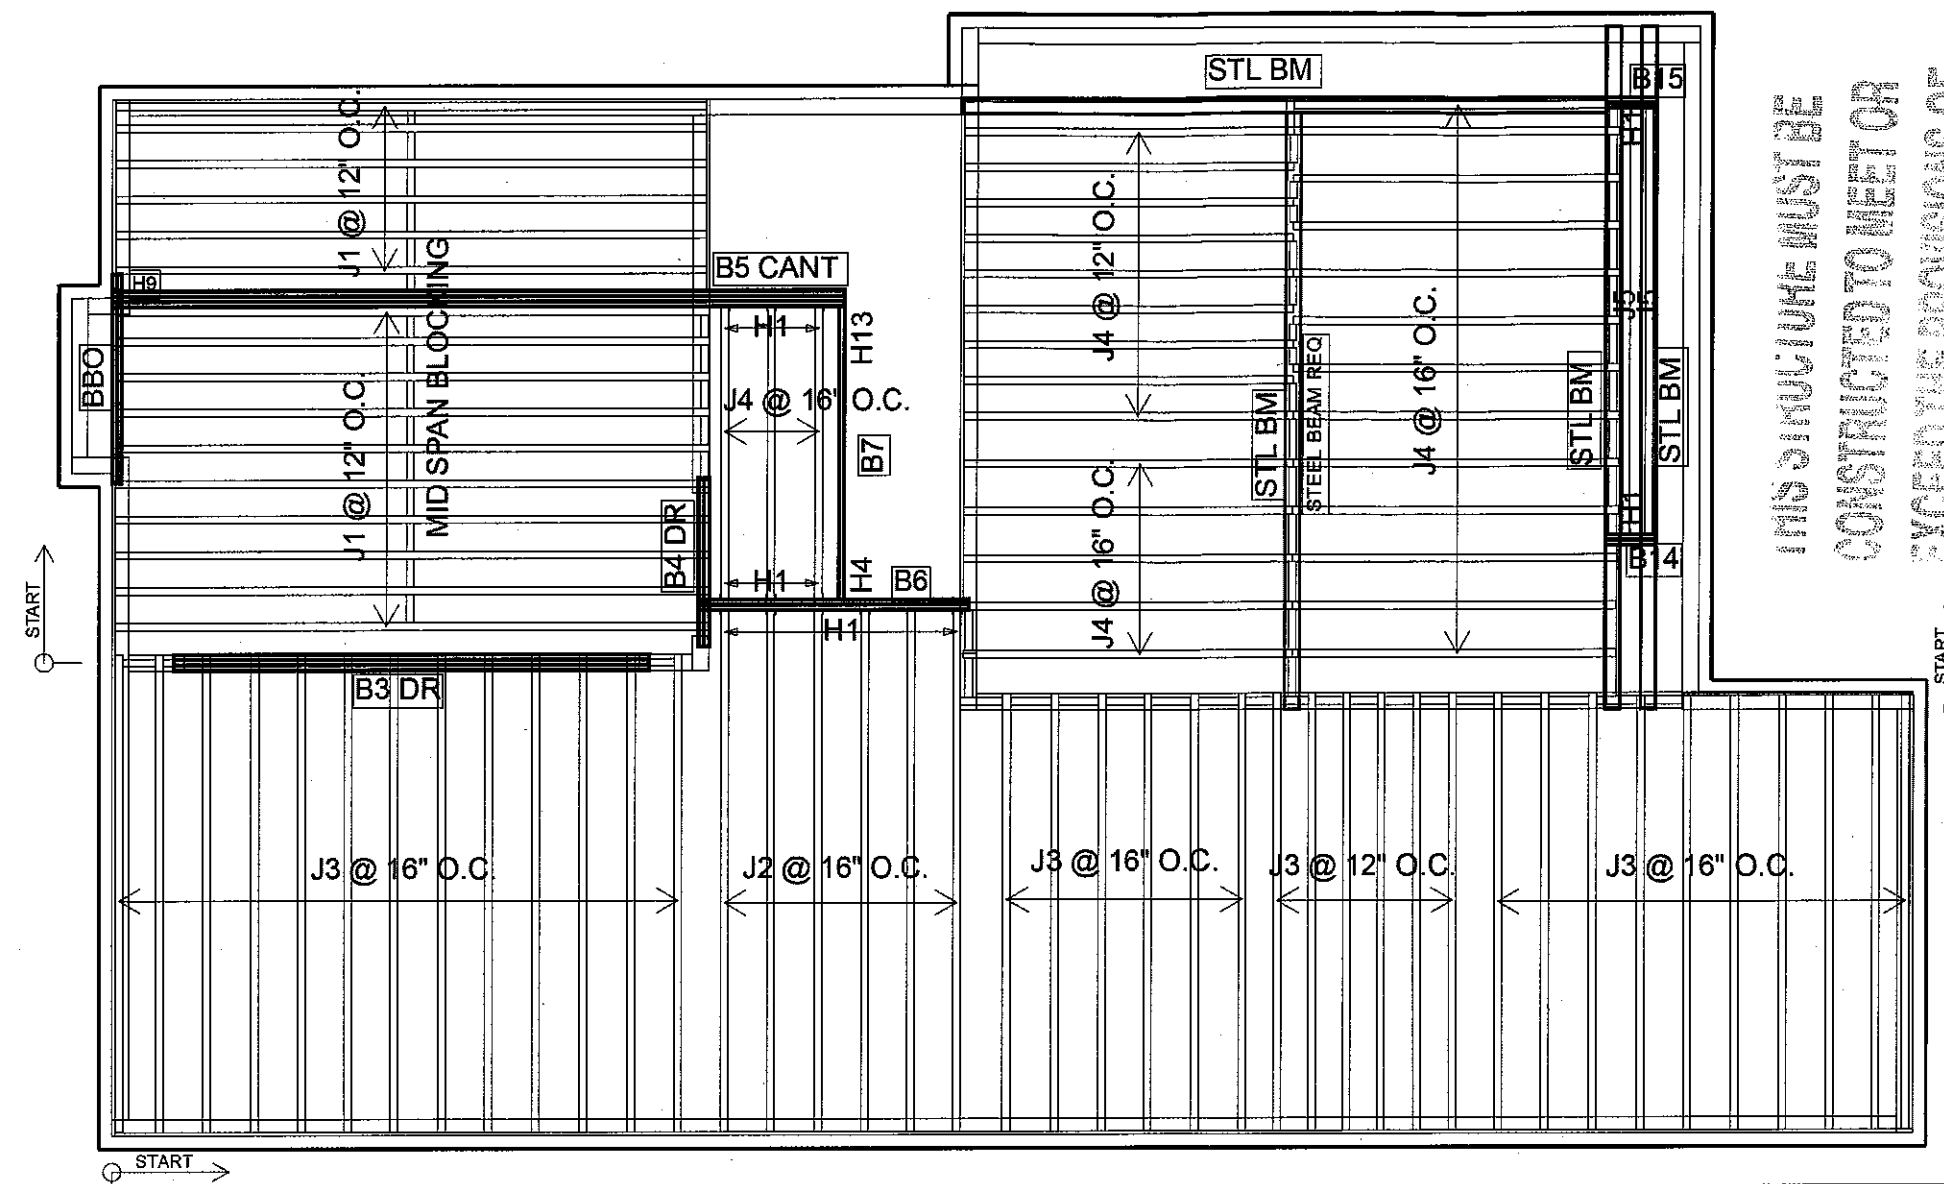

THIS DOCUMENT MUST BE  
 CONSIDERED TO BE FOR  
 EXCLUSIVE USE OF  
 THE CLIENT ONLY

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	9 1/2" NI-40x	1	16
J2	16-00-00	9 1/2" NI-40x	1	6
J3	14-00-00	9 1/2" NI-40x	1	35
J5	12-00-00	9 1/2" NI-40x	1	2
J4	10-00-00	9 1/2" NI-40x	1	30
B5 CANT	22-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B3 DR	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B7	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B6	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B4 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B14	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B15	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
3	H1	IUS2.56/9.5
1	H4	HUS1.81/10
1	H13	LS90
1	H9	H2.5A*

RECEIVED  
 JUL 26 2019

TOWN OF CALEDON  
 BUILDING SECTION  
 FILE NO


FROM PLAN DATED: SEPT 24 2018  
 BUILDER: GREENPARK HOMES  
 SITE: LAMBERTS LANE  
 MODEL: PRESTON 1  
 ELEVATION: 1  
 LOT:  
 CITY: CALEDON  
 SALESMAN: M D  
 DESIGNER: PL  
 REVISION:

**NOTES:**  
 REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS INCLUDING CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES INCLUDING DUCT CHASE AND FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE APPLICATION** AS PER O.B.C. 9.30.6

**LOADING:**  
 DESIGN LOADS: L/480,000  
 LIVE LOAD: 40.0 lb/ft<sup>2</sup>  
 DEAD LOAD: 15.0 lb/ft<sup>2</sup>  
 TILED AREAS: 20 lb/ft<sup>2</sup>  
**SUBFLOOR: 5/8" GLUED AND NAILED**

DATE: 11/9/2018

2nd FLOOR  
 OPTIONAL 5 BEDROOM CONDITION

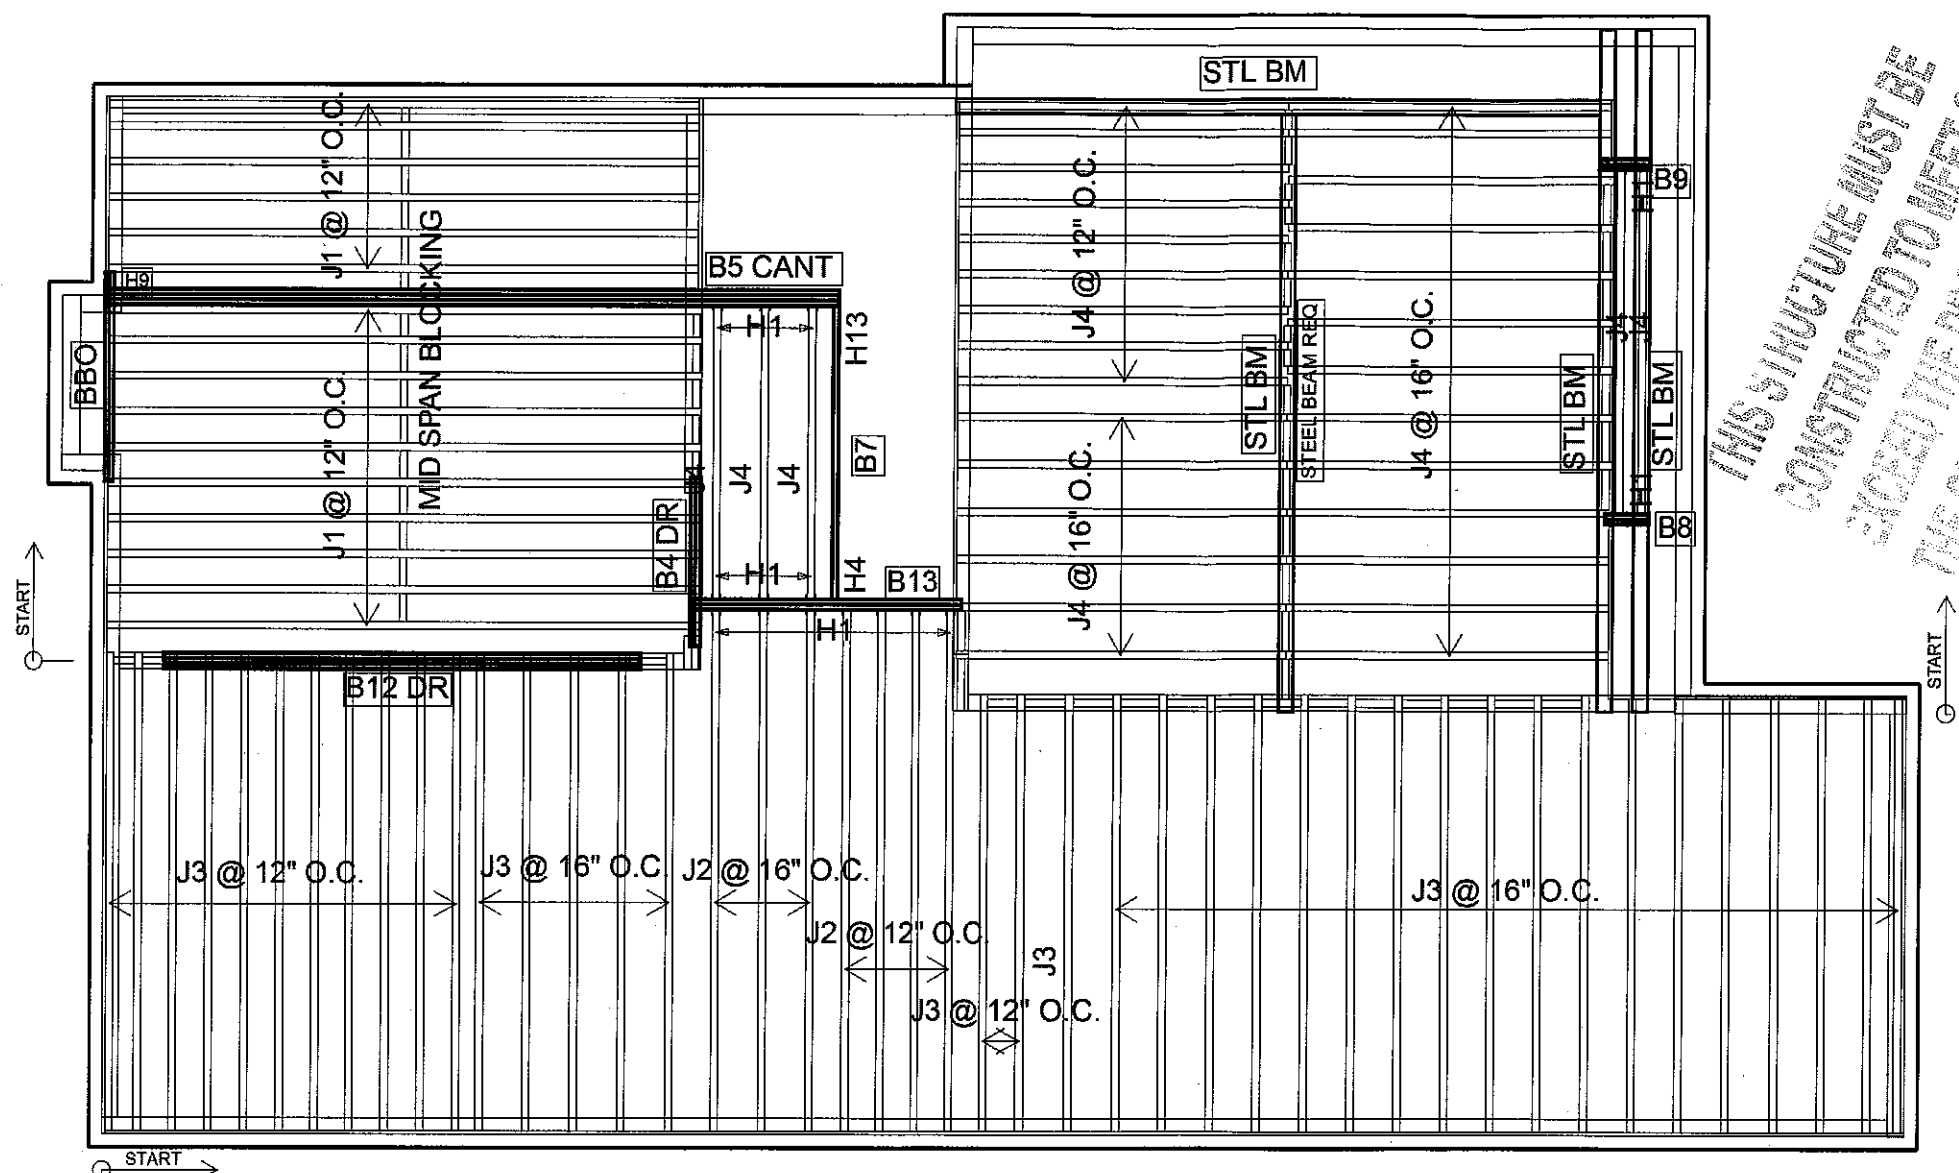

THIS STRUCTURE MUST BE  
 CONSTRUCTED TO MEET OR  
 EXCEED THE PROVISIONS OF  
 THE ONTARIO BUILDING CODE

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	9 1/2" NI-40x	1	16
J2	16-00-00	9 1/2" NI-40x	1	7
J3	14-00-00	9 1/2" NI-40x	1	37
J4	10-00-00	9 1/2" NI-40x	1	33
B5 CANT	22-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3
B12 DR	14-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3
B7	10-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	1	1
B13	8-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2
B4 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2
B8	2-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2
B9	2-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
10	H1	IUS2.56/9.5
3	H1	IUS2.56/9.5
2	J1	H1
1	H4	HUS1.81/10
1	H13	LS90
1	H9	H2.5A*

**RECEIVED**  
 JUL 26 2019  
 TOWN OF CALEDON  
 BUILDING SECTION  
 FILE NO.

FROM PLAN DATED: SEPT 24 2018  
 BUILDER: GREENPARK HOMES  
 SITE: LAMBERTS LANE  
 MODEL: PRESTON 1  
 ELEVATION: 2  
 LOT:  
 CITY: CALEDON  
 SALESMAN: M D  
 DESIGNER: PL  
 REVISION:


**NOTES:**  
 REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

**LOADING:**  
 DESIGN LOADS: L/480.000  
 LIVE LOAD: 40.0 lb/ft<sup>2</sup>  
 DEAD LOAD: 15.0 lb/ft<sup>2</sup>  
 TILED AREAS: 20 lb/ft<sup>2</sup>  
**SUBFLOOR: 5/8" GLUED AND NAILED**

DATE: 11/9/2018

2nd FLOOR

OPTIONAL 5 BEDROOM CONDITION

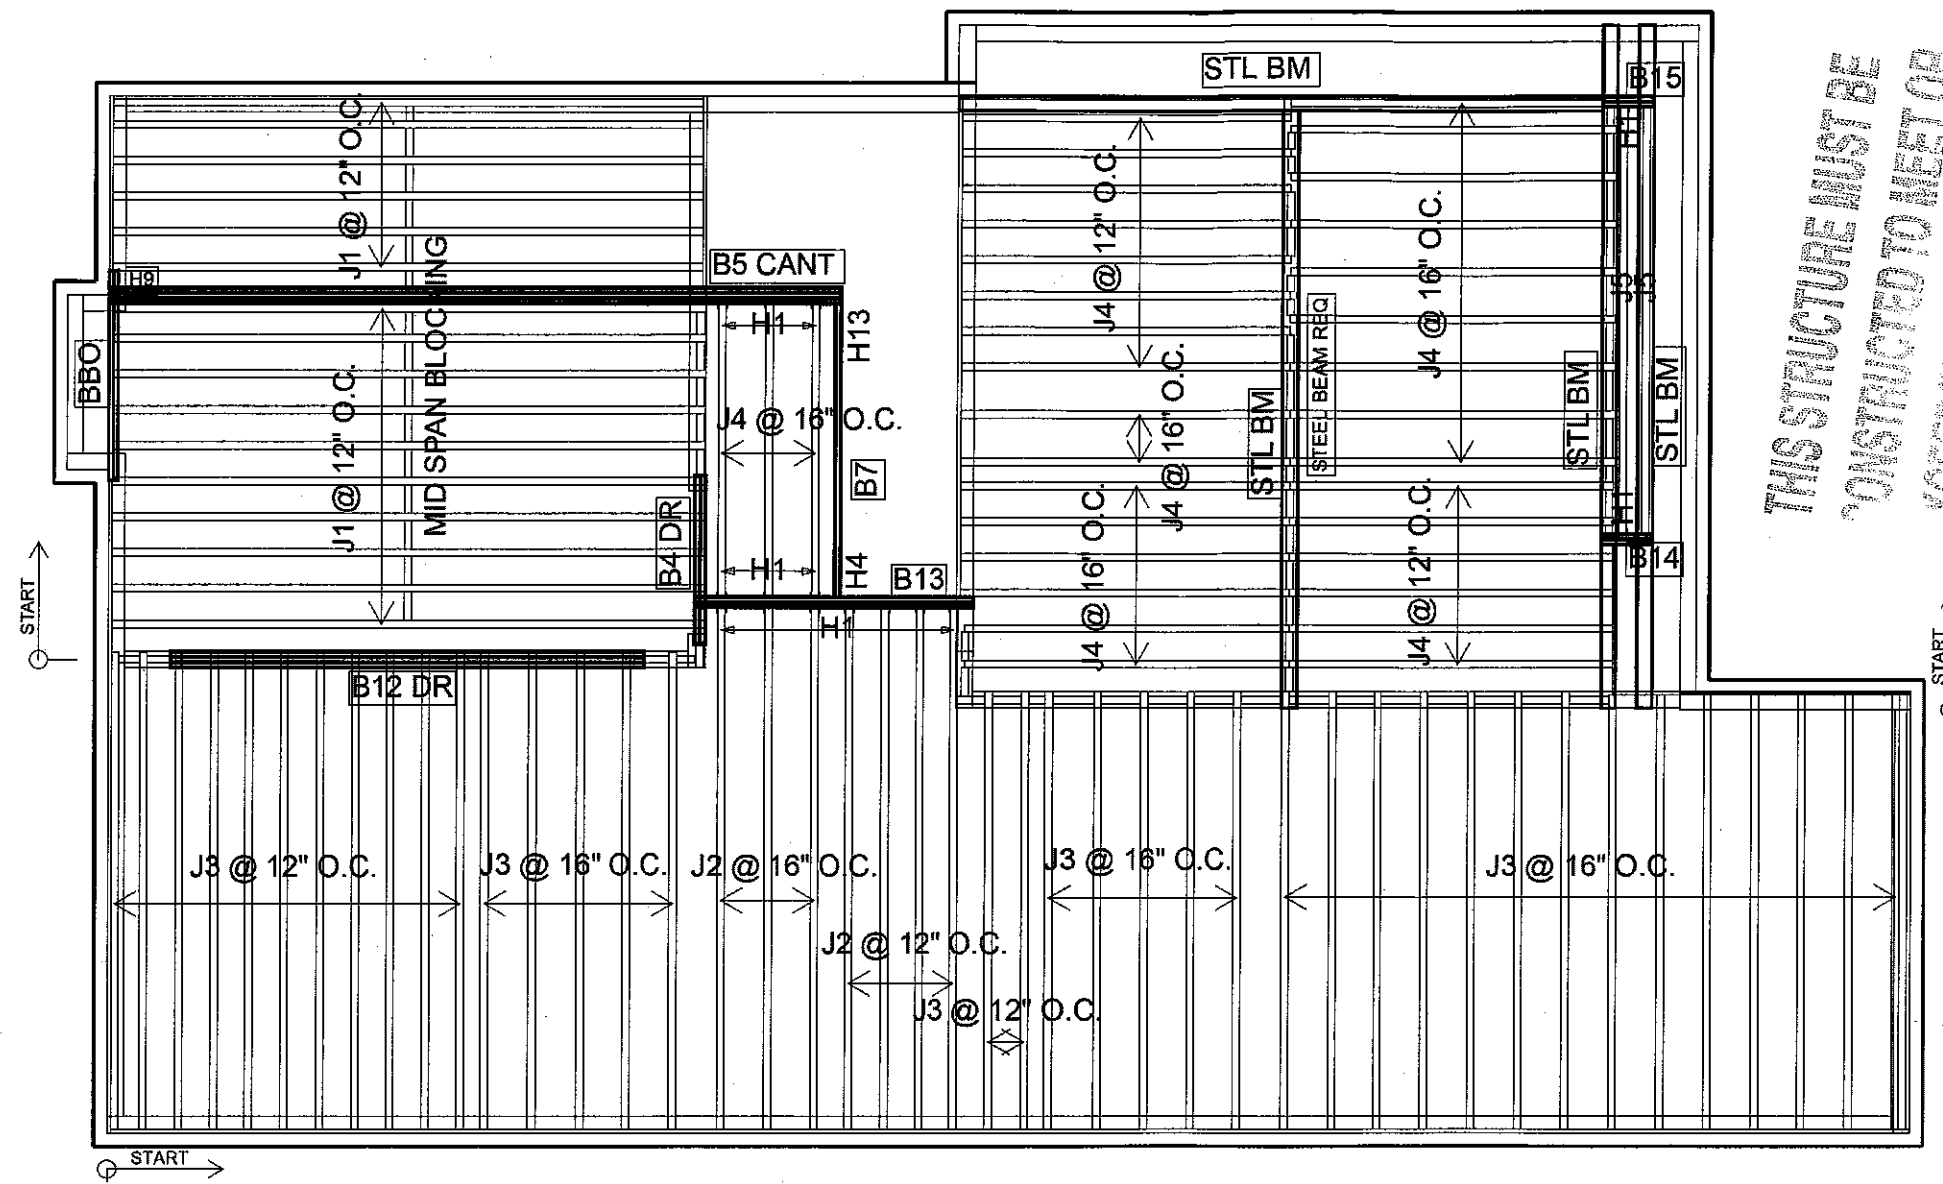

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	9 1/2" NI-40x	1	16
J2	16-00-00	9 1/2" NI-40x	1	7
J3	14-00-00	9 1/2" NI-40x	1	37
J5	12-00-00	9 1/2" NI-40x	1	2
J4	10-00-00	9 1/2" NI-40x	1	34
B5 CANT	22-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3
B12 DR	14-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	3	3
B7	10-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	1	1
B13	8-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2
B4 DR	6-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2
B14	2-00-00	1-3/4" x 9-1/2" VERSA-LAM@ 2.0 3100 SP	2	2
B15	2-00-00	1-3/4" x 11-7/8" VERSA-LAM@ 2.0 3100 SP	2	2

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
1	H1	IUS2.56/9.5
3	H1	IUS2.56/9.5
1	H4	HUS1.81/10
1	H13	LS90
1	H9	H2.5A*



RECEIVED  
 JUL 26 2019

TOWN OF CALEDON  
 BUILDING SECTION  
 FILE NO. \_\_\_\_\_





# INSTALLATION GUIDE FOR RESIDENTIAL FLOORS

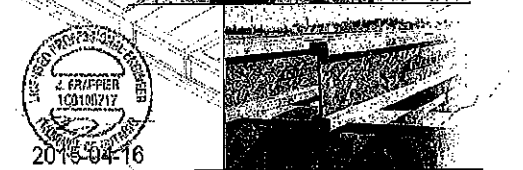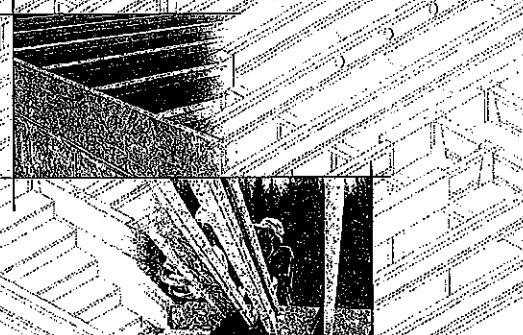

2015-04-16

Distributed by:

### SAFETY AND CONSTRUCTION PRECAUTIONS

**WARNING:**  
I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

**Avoid Accidents by Following these Important Guidelines:**

1. Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
  - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral resistant at the end of each bay. Top ends of adjoining bracing over at least two I-joists.
  - Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of I-joists at the end of the bay.
3. For cantilevered I-joists, brace top and bottom flanges, and brace ends with cleare panels, rim board, or cross-bridging.
4. Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
5. Never install a damaged I-joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

### STORAGE AND HANDLING GUIDELINES

1. Bundles wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle I-joists vertically and level only.
3. Always stack and handle I-joists in the upright position only.
4. Do not store I-joists in direct contact with the ground and/or flatwise.
5. Protect I-joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling I-joists with a crane on the job site, take a few simple precautions to prevent damage to the I-joists and injury to your work crew.
  - Pick I-joists in bundles as shipped by the supplier.
  - Orient the bundles so that the webs of the joists are vertical.
  - Pick the bundles at the 5th points, using a spreader bar if necessary.
8. Do not handle I-joists in a horizontal orientation.
9. NEVER USE OR TRY TO REPAIR A DAMAGED I-JOIST.

### MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to single-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The Ultimate Limit States are based on the factored loads of 1.30L + 1.25D. The serviceability limit states include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.

2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CGS-71.25 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.

3. Minimum bearing length shall be 1-3/4 inches for the end bearing, and 3-1/2 inches for the intermediate bearing.

4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.

5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.

6. Tables are based on Limit States Design per CAN/CSA C86-07 Standard, and NBC 2010.

7. SI units conversion: 1 inch = 25.4 mm  
1 foot = 0.305 m

Joist Depth	Joist Series	Simple spans On center spacing				Multiple spans On center spacing			
		12'	16'	19.2'	24'	12'	16'	19.2'	24'
9-1/2"	NI-20	18.1'	14.2'	13.9'	13.5'	15.4'	14.1'	14.7'	14.7'
	NI-40	16.1'	12.2'	14.8'	14.9'	17.5'	16.5'	15.5'	15.5'
	NI-60	14.5'	10.4'	14.0'	14.1'	17.7'	16.7'	16.0'	16.1'
	NI-80	12.3'	8.1'	15.1'	15.7'	18.7'	17.4'	16.9'	16.10'
11-7/8"	NI-20	18.1'	14.5'	15.8'	15.6'	18.4'	17.3'	16.8'	16.7'
	NI-40	16.1'	12.2'	14.8'	14.9'	20.0'	18.6'	17.9'	17.7'
	NI-60	14.5'	10.4'	14.0'	14.1'	20.3'	18.9'	18.0'	18.1'
	NI-80	12.3'	8.1'	15.1'	15.7'	21.9'	20.2'	19.3'	19.4'
14"	NI-20	20.2'	15.7'	17.0'	17.1'	22.3'	20.7'	19.8'	19.4'
	NI-40	18.1'	13.7'	15.1'	15.2'	23.7'	22.1'	20.9'	20.1'
	NI-60	16.4'	12.3'	14.0'	14.0'	23.10'	21.1'	21.1'	21.2'
	NI-80	14.5'	10.4'	14.9'	14.9'	24.3'	22.5'	21.5'	21.5'
16"	NI-20	22.5'	20.4'	19.9'	19.9'	24.9'	22.10'	21.10'	21.10'
	NI-40	22.2'	20.3'	20.3'	20.3'	25.0'	23.1'	22.0'	22.0'
	NI-60	22.5'	20.4'	19.9'	19.9'	24.7'	22.9'	21.9'	21.9'
	NI-80	23.4'	21.5'	21.1'	21.1'	26.0'	24.0'	22.11'	22.0'

### I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support I-joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the joist.

### WEB STIFFENERS

**RECOMMENDATIONS:**

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the Joist Properties table found in the Joist Construction Guide (C10). The gap between the stiffener and the flange is at the top.
- A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm

**FIGURE 2 WEB STIFFENER INSTALLATION DETAILS**

**STIFFENER SIZE REQUIREMENTS**

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-5/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width

### NORDIC I-JOIST SERIES

Chioniera Chibougamaou Ltd. harvests its own trees, which enables Nordic products to adhere to strict quality control procedures throughout the manufacturing process. Every piece of the operation, from the raw timber to the finished product, reflects our commitment to quality.

Nordic Engineered Wood I-joists use only finger-jointed stock to ensure longer span carrying capacity.

### INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, contact supplier.
2. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.
3. Install I-joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. I-joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple spans must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat I-joists firmly in hanger bottoms to minimize self-rattling.
7. Leave a 1/16-inch gap between the I-joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the I-joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the I-joist. Or, attach the load to blocking that has been securely fastened to the I-joist webs.
9. Never install I-joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent raftering. Use rim board, rim joists or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squash blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge may never be used as blocking or rim boards. I-joist blocking panels or other engineered wood products - such as rim board - must be cut to fit between the I-joists, and an I-joist-compatible depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly support the bottom flange of all cantilevered I-joists at the end support next to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between I-joists with 2x4 blocking. Glue panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Splice nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.

**FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS**

Some framing requirements such as straction bracing and blocking panels have been omitted for clarity.

Figures 3, 4 or 5

Holes may be cut in web for plumbing, wiring and duct work. See Tables 1, 2 and Figure 7.

NOTE: Never not or notch flanges.

Nordic Lam or Structural Composite Lumber (SCL)

Nordic Lam or SCL

Figures 3, 4 or 5

Use hangers recognized in current code evaluation reports

11 12 13 14 15 16 17 18 19 20 21 22

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

**FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS**

Some framing requirements such as straction bracing and blocking panels have been omitted for clarity.

Figures 3, 4 or 5

Holes may be cut in web for plumbing, wiring and duct work. See Tables 1, 2 and Figure 7.

NOTE: Never not or notch flanges.

Nordic Lam or Structural Composite Lumber (SCL)

Nordic Lam or SCL

Figures 3, 4 or 5

Use hangers recognized in current code evaluation reports

11 12 13 14 15 16 17 18 19 20 21 22

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

**FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS**

Some framing requirements such as straction bracing and blocking panels have been omitted for clarity.

Figures 3, 4 or 5

Holes may be cut in web for plumbing, wiring and duct work. See Tables 1, 2 and Figure 7.

NOTE: Never not or notch flanges.

Nordic Lam or Structural Composite Lumber (SCL)

Nordic Lam or SCL

Figures 3, 4 or 5

Use hangers recognized in current code evaluation reports

11 12 13 14 15 16 17 18 19 20 21 22

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

**FIGURE 1 TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS**

Some framing requirements such as straction bracing and blocking panels have been omitted for clarity.

Figures 3, 4 or 5

Holes may be cut in web for plumbing, wiring and duct work. See Tables 1, 2 and Figure 7.

NOTE: Never not or notch flanges.

Nordic Lam or Structural Composite Lumber (SCL)

Nordic Lam or SCL

Figures 3, 4 or 5

Use hangers recognized in current code evaluation reports

11 12 13 14 15 16 17 18 19 20 21 22

All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.122" dia.) common spiral nails may be substituted for 2-1/2" (0.128" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.

RECEIVED  
JUL 26 2019  
TOWN OF CALEDON  
BUILDING SECTION  
FILE NO.





# NORDIC STRUCTURES

COMPANY  
TAMARACK LUMBER INC.  
3289 NORTH SERVICE ROAD  
BURLINGTON ONTARIO  
Nov. 1, 2018 07:53

PROJECT  
J1 1ST FLOOR


## Design Check Calculation Sheet

Nordic Sizer - Canada 7.1

### Loads:

Load	Type	Distribution	Pat-tern	Location [ft.]		Magnitude		Unit
				Start	End	Start	End	
Load1	Dead	Full Area				20.00		psf
Load2	Live	Full Area				40.00		psf

### Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

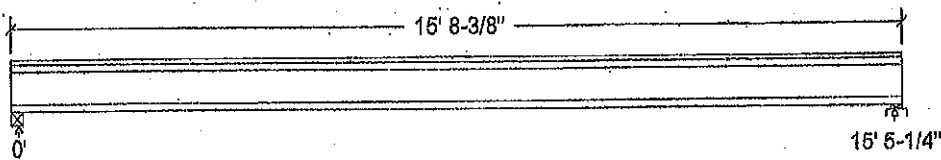

Unfactored:			
Dead	154		154
Live	309		309
Factored:			
Total	656		656
Bearing:			
Resistance			
Joist	1867		1865
Support	-		3659
Des ratio			
Joist	0.35		0.35
Support	-		0.18
Load case	#2		#2
Length	2-1/2		2-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		1.00
fcp sup	-		769
Kzcp sup	-		1.00



**Nordic Joist 9-1/2" NI-40x Floor joist @ 12" o.c.**  
 Supports: 1 - Steel Beam, W; 2 - Lumber Sill plate, No.1/No.2;  
 Total length: 15' 8-3/8"; Clear span: 15' 3-1/2"; 3/4" nailed and glued OSB sheathing  
**This section PASSES the design code check.**

**THIS STRUCTURE MUST BE  
 CONSTRUCTED TO MEET OR  
 EXCEED THE PROVISIONS OF  
 THE ONTARIO BUILDING CODE**

DWNG. TAM 1907-18112  
 STRUCTURAL  
 COMPONENT ONLY

T-19011112

**Limit States Design using CSA O86-14 and Vibration Criterion:**

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 656	Vr = 1895	lbs	Vf/Vr = 0.35
Moment(+)	Mf = 2532	Mr = 4824	lbs-ft	Mf/Mr = 0.52
Perm. Defl'n	0.11 = < L/999	0.51 = L/360	in	0.21
Live Defl'n	0.22 = L/858	0.39 = L/480	in	0.56
Total Defl'n	0.32 = L/572	0.77 = L/240	in	0.42
Bare Defl'n	0.26 = L/719	0.51 = L/360	in	0.50
Vibration	L <sub>max</sub> = 15'-5.3	L <sub>v</sub> = 17'-1.8	ft	0.90
Defl'n	= 0.030	= 0.042	in	0.72

**Additional Data:**

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
BI	218.1 million	-	-	-	-	-	-	-	#2

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L  
 Moment (+) : LC #2 = 1.25D + 1.5L  
 Deflection: LC #1 = 1.0D (permanent)  
               LC #2 = 1.0D + 1.0L (live)  
               LC #2 = 1.0D + 1.0L (total)  
               LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L  
 Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake  
 L=live (use, occupancy) Ls=live (storage, equipment) F=fire

Load Patterns: s=S/2 L=L+Ls =no pattern load in this span  
 All Load Combinations (LCs) are listed in the Analysis output


**CALCULATIONS:**

Deflection: E<sub>eff</sub> = 265e06 lb-in<sup>2</sup> K= 4.94e06 lbs  
 "Live" deflection = Deflection from all non-dead loads (live, wind, etc.)

**Design Notes:**

CONFORMS TO OBC 2012

- WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4; and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
- Please verify that the default deflection limits are appropriate for your application.
- Refer to Nordic Structures technical documentation for installation guidelines and construction details.
- Nordic I-joists are listed in CCMC evaluation report 13032-R.
- Joists shall be laterally supported at supports and continuously along the compression edge.
- The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWUND.TAM 1907-1914  
 STRUCTURAL  
 COMPONENT ONLY

T. 90111260

# NORDIC STRUCTURES

COMPANY  
TAMARACK LUMBER INC.  
3269 NORTH SERVICE ROAD  
BURLINGTON ONTARIO  
Nov. 1, 2018 07:55

PROJECT  
J2 1ST FLOOR


## Design Check Calculation Sheet

Nordic Sizer - Canada 7.1

### Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

### Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

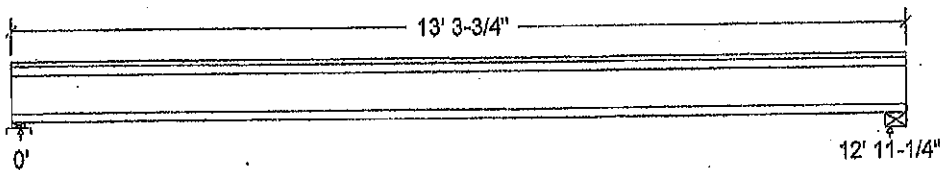

Unfactored:			
Dead	172		172
Live	345		345
Factored:			
Total	733		733
Bearing:			
Resistance			1891
Joist	1865		-
Support	3971		-
Des ratio			0.39
Joist	0.39		-
Support	0.18		-
Load case	#2		#2
Length	2-3/8		3-7/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	1.00		-
fcp sup	769		-
Kzcp sup	1.09		-



**Nordic Joist 9-1/2" NJ-40x Floor Joist @ 16" o.c.**  
 Supports: 1 - Lumber Sill plate, No.1/No.2; 2 - Steel Beam, W;  
 Total length: 13' 3-3/4"; Clear span: 12' 9-1/2"; 3/4" nailed and glued OSB sheathing  
**This section PASSES the design code check.**

### Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 733	Vr = 1895	lbs	Vf/Vr = 0.39
Moment(+)	Mf = 2371	Mr = 4824	lbs-ft	Mf/Mr = 0.49
Perm. Defl'n	0.07 = < L/999	0.43 = L/360	in	0.17
Live Defl'n	0.14 = < L/999	0.32 = L/480	in	0.44
Total Defl'n	0.22 = L/720	0.65 = L/240	in	0.33
Bare Defl'n	0.18 = L/883	0.43 = L/360	in	0.41
Vibration	Lmax = 12'-11.3	Lv = 16'-2.1	ft	0.80
Defl'n	= 0.026	= 0.053	in	0.49

DESIGNED BY T. GOLLUB  
 NOV 1 2018  
 STRUCTURAL  
 COMPONENT ONLY  
 T. GOLLUB

**Additional Data:**

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L  
 Moment (+) : LC #2 = 1.25D + 1.5L  
 Deflection: LC #1 = 1.0D (permanent)  
             LC #2 = 1.0D + 1.0L (live)  
             LC #2 = 1.0D + 1.0L (total)  
             LC #2 = 1.0D + 1.0L (bare joist)  
 Bearing : Support 1 - LC #2 = 1.25D + 1.5L  
             Support 2 - LC #2 = 1.25D + 1.5L  
 Load Types: D=dead W=wind S=snow H=earth,groundwater E=earthquake  
                   L=live(use, occupancy) Ls=live(storage, equipment) f=fire  
 Load Patterns: s=S/2 L=L+Ls =no pattern load in this span  
 All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**

Deflection:  $EI_{eff} = 276e06 \text{ lb-in}^2$   $K = 4.94e06 \text{ lbs}$   
 "Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic I-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building, nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

CONFORMS TO OBC 2012



DWYNO.YAM 1908-1908  
 STRUCTURAL  
 COMPONENT ONLY

T-19081113

# NORDIC STRUCTURES

**COMPANY**  
TAMARACK LUMBER INC.  
3269 NORTH SERVICE ROAD  
BURLINGTON ONTARIO  
Nov. 8, 2018 15:42

**PROJECT**  
J1 2ND FLOOR


## Design Check Calculation Sheet

Nordic Sizer - Canada 7.1

**Loads:**

Load	Type	Distribution	Pat-tern	Location [ft]		Magnitude	Unit
				Start	End		
Load1	Dead	Full Area				20.00	psf
Load2	Live	Full Area				40.00	psf

**Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :**

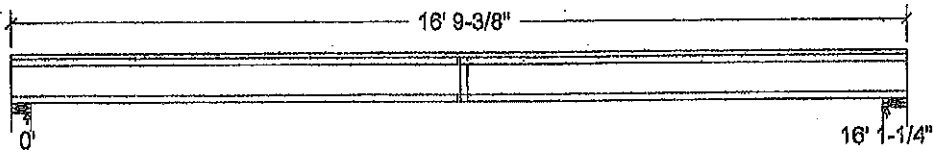

Unfactored:			
Dead	161		161
Live	322		322
Factored:			
Total	684		684
Bearing:			
Resistance			
Joist	1893		1893
Support	7744		9724
Des ratio			
Joist	0.36		0.36
Support	0.09		0.07
Load case	#2		#2
Length	4-3/8		5-1/2
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	1.00		1.00
fcp sup	769		769
Kzcp sup	1.15		1.15



Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

**Nordic Joist 9-1/2" NI-40x Floor joist @ 12" o.c.**

Supports: All - Lumber Wall, No.1/No.2

Total length: 16' 9-3/8"; Clear span: 15' 11-1/2"; 5/8" nailed and glued OSB sheathing with 1 row of blocking and 1/2" gypsum ceiling

**This section PASSES the design code check.**

DWGN. TAM 1909-1842  
STRUCTURAL  
COMPONENT ONLY

T. GOLLUP



Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 684	Vr = 1895	lbs	Vf/Vr = 0.36
Moment(+)	Mf = 2755	Mr = 4824	lbs-ft	ME/Mr = 0.57
Perm. Defl'n	0.13 = < L/999	0.54 = L/360	in	0.24
Live Defl'n	0.26 = L/744	0.40 = L/480	in	0.64
Total Defl'n	0.39 = L/496	0.81 = L/240	in	0.48
Bare Defl'n	0.30 = L/638	0.54 = L/360	in	0.56
Vibration Defl'n	Lmax = 16'-1.3	Lv = 18'-7.3	ft	0.87
	= 0.027	= 0.040	in	0.67

Additional Data:

FACTORS:	F/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L  
 Moment(+): LC #2 = 1.25D + 1.5L  
 Deflection: LC #1 = 1.0D (permanent)  
 LC #2 = 1.0D + 1.0L (live)  
 LC #2 = 1.0D + 1.0L (total)  
 LC #2 = 1.0D + 1.0L (bare joist)


Bearing : Support 1 - LC #2 = 1.25D + 1.5L  
 Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake  
 L=live (use, occupancy) Ls=live (storage, equipment) f=live

Load Patterns: s=S/2 L=L+Ls =no pattern load in this span  
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: E<sub>eff</sub> = 258e06 lb-in<sup>2</sup> K= 4.94e06 lbs  
 "Live" deflection = Deflection from all non-dead loads (live, wind, snow)



Design Notes:

- WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
- Please verify that the default deflection limits are appropriate for your application.
- Refer to Nordic Structures technical documentation for installation guidelines and construction details.
- Nordic I-joists are listed in CCMC evaluation report 13032-R.
- Joists shall be laterally supported at supports and continuously along the compression edge.
- The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

JWB NO. TAM 1909-18H  
 STRUCTURAL  
 COMPONENT ONLY

T. L. Gouws

# NORDIC STRUCTURES

**COMPANY**  
TAMARACK LUMBER INC.  
3269 NORTH SERVICE ROAD  
BURLINGTON ONTARIO  
Nov. 1, 2018 08:00

**PROJECT**  
J2 2ND FLOOR


## Design Check Calculation Sheet

Nordic Sizer - Canada 7.1


**Loads:**

Load	Type	Distribution	Pat-tern	Location [ft]		Magnitude		Unit
				Start	End	Start	End	
Load1	Dead	Full Area				20.00		psf
Load2	Live	Full Area				40.00		psf

**Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :**

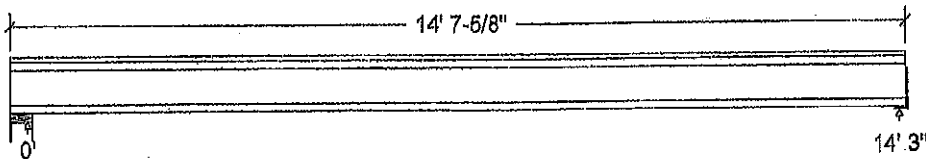

Unfactored:			
Dead	190		190
Live	380		380
Factored:			
Total	807		807
Bearing:			
Resistance			
Joist	1893		1859
Support	7744		-
Des ratio			
Joist	0.43		0.43
Support	0.10		-
Load case	#2		#2
Length	4-3/8		2
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	1.00		-
fcp sup	769		-
Kzcp sup	1.15		-



Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

**Nordic Joist 9-1/2" NI-40x Floor joist @ 16" o.c.**

Supports: 1 - Lumber Wall, No.1/No.2; 2 - Hanger;

Total length: 14' 7-5/8"; Clear span: 14' 1-1/4"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

**This section PASSES the design code check.**

DWG NO. TAM 1910-18H  
STRUCTURAL 16/12  
COMPONENT ONLY

T-1901111D

**Limit States Design using CSA O86-14 and Vibration Criterion:**

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 807	Vr = 1895	lbs	Vf/Vr = 0.43
Moment(+)	Mf = 2877	Mr = 4824	lbs-ft	Mf/Mr = 0.60
Perm. Defl'n	0.11 = < L/999	0.47 = L/360	in	0.22
Live Defl'n	0.21 = L/809	0.36 = L/480	in	0.59
Total Defl'n	0.32 = L/539	0.71 = L/240	in	0.44
Bare Defl'n	0.25 = L/675	0.47 = L/360	in	0.53
Vibration	Lmax = 14'-3	Lv = 15'-9.3	ft	0.90
Defl'n	= 0.034	= 0.047	in	0.73

**Additional Data:**

FACTORS:	F/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

**CRITICAL LOAD COMBINATIONS:**

Shear : LC #2 = 1.25D + 1.5L  
 Moment (+) : LC #2 = 1.25D + 1.5L  
 Deflection: LC #1 = 1.0D (permanent)  
 LC #2 = 1.0D + 1.0L (live)  
 LC #2 = 1.0D + 1.0L (total)  
 LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L  
 Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake  
 L=live (use, occupancy) Ls=live (storage, equipment) f=fire


Load Patterns: s=S/2 L=L+Ls =no pattern load in this span  
 All Load Combinations (LCs) are listed in the Analysis output

**CALCULATIONS:**

Deflection: E<sub>eff</sub> = 268e06 lb-in<sup>2</sup> K= 4.94e06 lbs  
 "Live" deflection = Deflection from all non-dead loads (live, wind, snow)

**Design Notes:**

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC) Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic Joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



**THIS STRUCTURE MUST BE  
 CONSTRUCTED TO MEET OR  
 EXCEED THE PROVISIONS OF  
 THE ONTARIO BUILDING CODE**

DWG NO. YAM1910-184  
 STRUCTURAL  
 COMPONENT ONLY

*F. G. Williams*



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B11(16333)


Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALCO Member Report  
Buld 6476

Job name:  
Address:  
City, Province, Postal Code: CALEDON  
Customer:  
Code reports: CCMC 12472-R

File name: PRESTON 1.mxd  
Description: 1ST FLOOR FRAMING\Flush Beams\B11(16333)  
Specifier:  
Designer: PL  
Company:

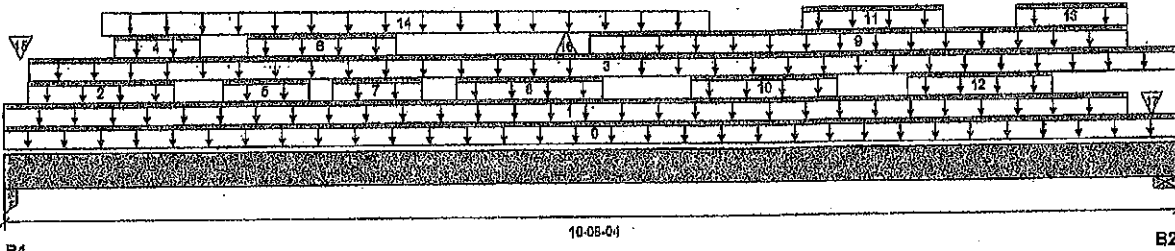

Total Horizontal Product Length = 10-08-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 2-5/8"	3,271 / 0	2,575 / 0	0 / 1	
B2, 3-1/2"	2,565 / 0	2,248 / 0	0 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	10-08-04	Top		14			00-00-00
1	5(282)	Unf. Lin. (lb/ft)	L	00-00-00	10-02-12	Top		81			n/a
2	5(282)	Unf. Lin. (lb/ft)	L	00-02-08	01-06-08	Top	253	136			n/a
3	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	10-08-04	Top	11	5			n/a
4	5(282)	Unf. Lin. (lb/ft)	L	00-11-12	01-08-04	Top		66			n/a
5	5(282)	Unf. Lin. (lb/ft)	L	01-11-12	02-09-04	Top		65			n/a
6	5(282)	Unf. Lin. (lb/ft)	L	02-02-08	03-08-08	Top	253				n/a
7	5(282)	Unf. Lin. (lb/ft)	L	02-11-12	03-09-04	Top					n/a
8	5(282)	Unf. Lin. (lb/ft)	L	04-00-14	05-04-14	Top	149				n/a
9	5(282)	Unf. Lin. (lb/ft)	L	05-03-08	10-02-12	Top					n/a
10	5(282)	Unf. Lin. (lb/ft)	L	06-02-08	07-08-08	Top	253	127			n/a
11	5(282)	Unf. Lin. (lb/ft)	L	07-02-08	08-06-08	Top	253				n/a
12	5(282)	Unf. Lin. (lb/ft)	L	08-02-08	09-06-08	Top	253				n/a
13	5(282)	Unf. Lin. (lb/ft)	L	09-02-08	10-02-12	Top	266	133			n/a
14	5(282)	Trapezoidal (lb/ft)	L	00-10-08	06-04-08	Top	186	101			n/a
15	B2(3970)	Conc. Pt. (lbs)	L	00-01-12	00-01-12	Top		543	278		n/a
16	5(282)	Conc. Pt. (lbs)	L	05-00-14	05-00-14	Top	2,029	1,251	-1		n/a
17	E1(272)	Conc. Pt. (lbs)	L	10-05-08	10-05-08	Top		77			n/a



Controls Summary


	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	23,159 ft-lbs	35,222 ft-lbs	63.9%	11	05-00-14
End Shear	6,502 lbs	17,356 lbs	37.5%	1	09-07-04
Total Load Deflection	L/322 (0.383")	n/a	74.4%	34	05-03-08
Live Load Deflection	L/582 (0.213")	n/a	61.9%	50	05-03-08
Max Defl.	0.383"	n/a	n/a	34	05-03-08
Span / Depth	13.0				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 2-5/8" x 5-1/4"	8,126 lbs	72.6%	48.3%	Unspecified
B2	Wall/Plate 3-1/2" x 5-1/4"	6,658 lbs	67.9%	29.7%	Unspecified

DWG NO. TMM 1911 - 1914  
STRUCTURAL COMPONENT ONLY

T-1911/16



# Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

**PASSED**

## 1ST FLOOR FRAMING\Flush Beams\B11\16333

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CGMC 12472-R

File name: PRESTON 1.mxd

Description: 1ST FLOOR FRAMING\Flush Beams\B11\16333

Specifier:

Designer: PL

Company:

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.


Design based on Dry Service Condition.

Importance Factor : Normal Part code ; Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

### Connection Diagram: Full Length of Member

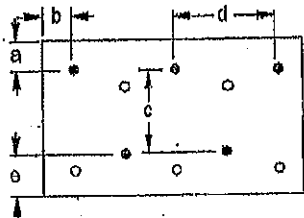

*4 Proves*

a minimum = 2"

b minimum = 3"

c = 6 1/2"

d = 6"


e minimum = 2"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: Nails

*1*  
3-1/2" ARDOX SPIRAL



### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to ensure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWN NO. YAM 1921-186  
STRUCTURAL  
COMPONENT ONLY

*T. Groumbo*



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP.**

**PASSED**

**1ST FLOOR FRAMING (Flush Beams) B10 (16337)**

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report

Build 6476

Job name:

File name: PRESTON 1.mmdl

Address:

Description: 1ST FLOOR FRAMING (Flush Beams) B10 (16337)

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

CCMC 12472-R

Company:

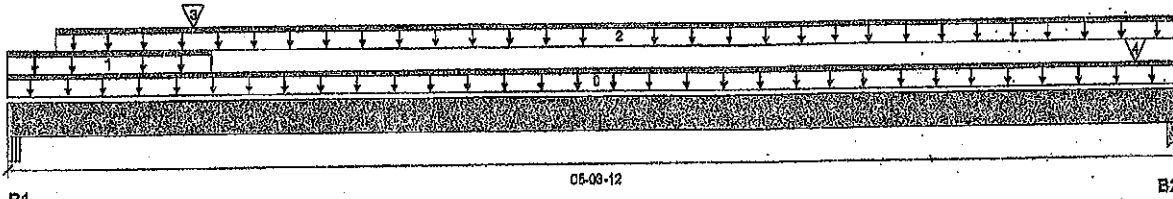

Total Horizontal Product Length = 05-03-12

**Reaction Summary (Down / Uplift) (lbs)**


Bearing	Live	Dead	Snow	Wind
B1, 5"	1,771 / 0	1,043 / 0		
B2, 2-5/8"	1,629 / 0	936 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-03-12	Top		10			00-00-00
1	8(286)	Unf. Lin. (lb/ft)	L	00-00-00	00-11-00	Top		81			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-02-08	05-03-12	Top		7			n/a
3	8(286)	Conc. Pt. (lbs)	L	00-10-00	00-10-00	Top	1,899	1,009			n/a
4	5(282)	Conc. Pt. (lbs)	L	05-01-08	05-01-08	Top	1,299	788			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,849 ft-lbs	23,220 ft-lbs	8.0%	1	00-10-00
End Shear	1,906 lbs	11,671 lbs	16.5%	1	01-02-08
Total Load Deflection	L/999 (0.008")	n/a	n/a	4	02-05-09
Live Load Deflection	L/999 (0.005")	n/a	n/a	5	02-05-09
Max Defl.	0.008"	n/a	n/a	4	02-05-09
Span / Depth	6.1				



**Bearing Supports**

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	5" x 3-1/2"	3,980 lbs	42.4%	18.5%	Unspecified
B2 Column	2-5/8" x 3-1/2"	3,463 lbs	46.4%	30.9%	Unspecified

**Notes**

- Design meets Code minimum (L/240) Total load deflection criteria.
- Design meets Code minimum (L/360) Live load deflection criteria.
- Calculations assume member is fully braced.
- Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**
- BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
- Design based on Dry Service Condition.
- Importance Factor: Normal Part code: Part 0
- Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
- Member has no side loads.

DWG NO. YAM 1912-18H  
STRUCTURAL  
COMPONENT ONLY

1901667



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B10\16337

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report

Buld 6475

Job name:

File name: PRESTON 1.mmdl

Address:

Description: 1ST FLOOR FRAMING\Flush Beams\B10\16337

City, Province, Postal Code: CALEDON

Specifier:

Customer:


Designer: PL

Code reports:

CCMC 12472-R

Company:

Connection Diagram: Full Length of Member

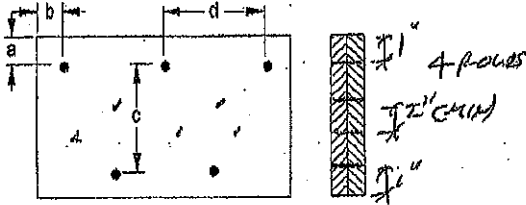

a minimum = 4"  
b minimum = 3"

c = 2-1/2"  
d = 4'

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: Nails

3-1/2" ARDOX SPIRAL




Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

DWG NO. TAM 1912-1811  
STRUCTURAL  
COMPONENT ONLY

T-190111760



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B2(13970)


Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report  
Build 6475

Job name:  
Address:  
City, Province, Postal Code: CALEDON  
Customer:  
Code reports: CCMC 12472-R

File name: PRESTON 1.mmdl  
Description: 1ST FLOOR FRAMING\Flush Beams\B2(13970)  
Specifier:  
Designer: PL  
Company:

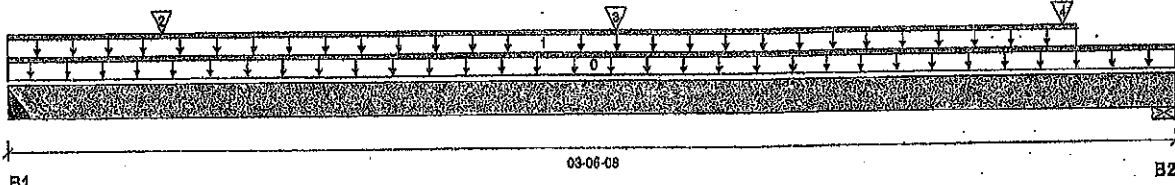

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	579 / 0	297 / 0		
B2, 3-1/2"	521 / 0	268 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-06-08	Top	1.00	0.65	1.00	1.15	00-00-00
1	STAIRS	Unf. Lin. (lb/ft)	L	00-00-00	03-02-00	Top	240	120			n/a
2	J4(13989)	Conc. Pt. (lbs)	L	00-06-08	00-06-08	Top	107	53			n/a
3	J4(13988)	Conc. Pt. (lbs)	L	01-09-08	01-09-08	Top	142	71			n/a
4	J4(13931)	Conc. Pt. (lbs)	L	03-01-08	03-01-08	Top	89	44			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	863 ft-lbs	11,610 ft-lbs	7.4%	1	01-09-08
End Shear	533 lbs	5,786 lbs	9.2%	1	01-00-08
Total Load Deflection	L/999 (0.004")	n/a	n/a	4	01-08-08
Live Load Deflection	L/999 (0.003")	n/a	n/a	5	01-08-06
Max Defl.	0.004"	n/a	n/a	4	01-08-06
Span / Depth	3.8				

Bearing Supports


	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 3" x 1-3/4"	1,240 lbs	n/a	19.4%	HUS1.81/10
B2	Wall/Plato 3-1/2" x 1-3/4"	1,116 lbs	34.1%	14.9%	Unspecified

Cautions

Header for the hanger HUS1.81/10 at B1 is a Triple 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.  
Design meets Code minimum (L/360) Live load deflection criteria.  
Calculations assume member is fully braced.  
Hanger Manufacturer: Unassigned  
Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012.  
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.  
Design based on Dry Service Condition.  
Importance Factor : Normal Part code : Part 9



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWYNG YAM 1913-184  
STRUCTURAL  
COMPONENT ONLY

T-1901118





**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**

**PASSED**

**1ST FLOOR FRAMING\Flush Beams\B1A(17062)**

BC CALC® Member Report

Dry | 1 span | No cant.

January 15, 2019 09:23:34

Build 6475

Job name:

File name: PRESTON 1 ELEV 1 DECK.mmdl

Address:

Description: 1ST FLOOR FRAMING\Flush Beams\B1A(17062)

City, Province, Postal Code: CALEDON


Specifier:

Customer:

Designer: PL

Code reports: CCMC 12472-R

Company:

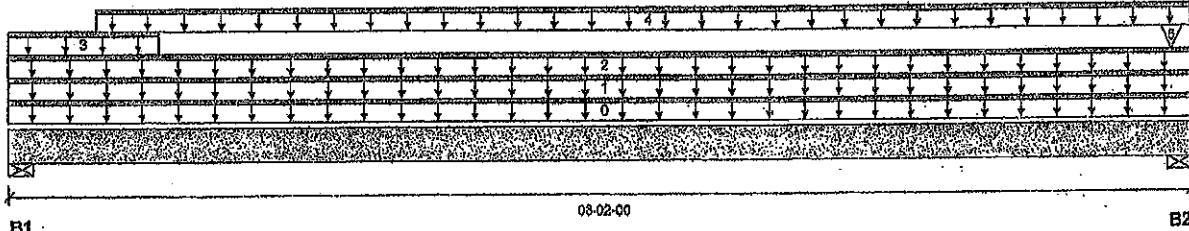

Total Horizontal Product Length = 03-02-00

**Reaction Summary (Down / Uplift) (lbs)**


Bearing	Live	Dead	Snow	Wind
B1, 4"	848 / 0	853 / 0	231 / 0	
B2, 4"	656 / 0	658 / 0	231 / 0	

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-02-00	Top		10			00-00-00
1	E12(1267)	Unf. Lin. (lb/ft)	L	00-00-00	03-02-00	Top	38	217	146		n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	03-02-00	Top	27	13			n/a
3	E12(1267)	Unf. Lin. (lb/ft)	L	00-00-00	00-04-12	Top	228	114			n/a
4	E12(1267)	Unf. Lin. (lb/ft)	L	00-02-12	03-02-00	Top	338	169			n/a
5	E12(1267)	Conc. Pt. (lbs)	L	03-01-06	03-01-06	Top	21				n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,085 ft-lbs	23,220 ft-lbs	4.7%	1	01-07-02
End Shear	605 lbs	11,871 lbs	5.2%	1	01-01-08
Total Load Deflection	L/999 (0.002")	n/a	n/a	35	01-07-02
Live Load Deflection	L/999 (0.001")	n/a	n/a	51	01-07-02
Max Defl.	0.002"	n/a	n/a	35	01-07-02
Span / Depth	3,3				



**Bearing Supports**

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4" x 3-1/2"	2,017 lbs	27.0%	11.8%	Unspecified
B2	Wall/Plate 4" x 3-1/2"	2,038 lbs	27.3%	11.9%	Unspecified

**Notes**

- Design meets Code minimum (L/240) Total load deflection criteria.
- Design meets Code minimum (L/360) Live load deflection criteria.
- Calculations assume member is fully braced.
- Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**
- BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
- Unbalanced snow loads determined from building geometry were used in selected product's verification.
- Design based on Dry Service Condition.
- Importance Factor: Normal Part code: Part 9
- Member has no side loads.

DWG NO. YAM 1925-1841  
STRUCTURAL  
COMPONENT ONLY

T-19011130



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B1A(I7062)

Dry | 1 span | No cant.

January 15, 2019 09:23:34

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMG 12472-R

File name: PRESTON 1 ELEV 1 DECK.mxd


Description: 1ST FLOOR FRAMING\Flush Beams\B1A(I7062)

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

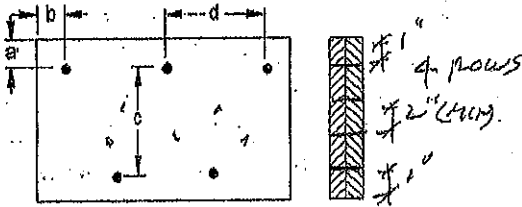

a minimum = 2"      c = 7-1/2"  
b minimum = 3"      d = 6"

Member has no side loads.  
Connectors are: Nails

3-1/2" ARDOX SPIRAL

THIS STRUCTURE MUST BE  
CONSTRUCTED TO MEET OR  
EXCEED THE PROVISIONS OF  
THE ONTARIO BUILDING CODE



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJST™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®  
DWN NO. TAM 1925-1911  
STRUCTURAL  
COMPONENT ONLY

T-1901130 (v)



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

**PASSED**

2ND FLOOR FRAMING\Flush Beams\B6 CANT (16382)

BC CALC® Member Report

Dry | 2 spans | R cant.

November 9, 2018 07:48:09

BUILD 6475

Job name:

File name: PRESTON 1.mxd

Address:

Description: 2ND FLOOR FRAMING\Flu...Beams\B6 CANT (16382)

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

GCMC 12472-R

Company:

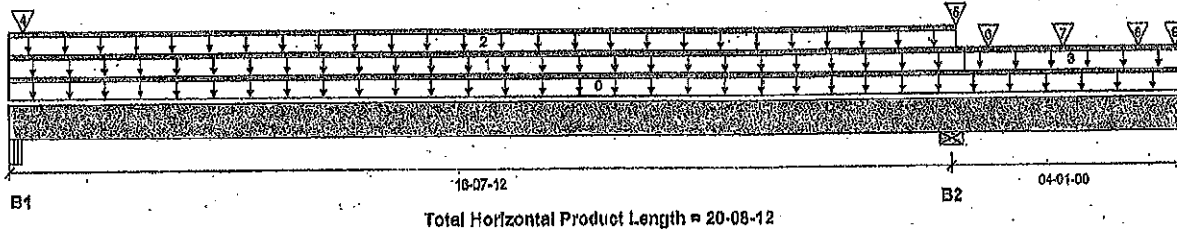

**Reaction Summary (Down / Uplift) (lbs)**


Bearing	Live	Dead	Snow	Wind
B1, 4-7/16"	208 / 216	158 / 0	64 / 0	
B2, 5-1/2"	2,032 / 0	1,253 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	20-08-12	Top	16	8			n/a
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	16-10-08	Top	7	3			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	16-08-12	Top	240	120			n/a
3	STAIRS	Unf. Lin. (lb/ft)	L	16-10-08	20-08-12	Top					n/a
4	E16(1384)	Conc. Pt. (lbs)	L	00-02-12	00-02-12	Top		59	64		n/a
5	13(1409)	Conc. Pt. (lbs)	L	16-08-12	16-08-12	Top		28			n/a
6	J4(16384)	Conc. Pt. (lbs)	L	17-03-13	17-03-13	Top	202	101			n/a
7	J4(16382)	Conc. Pt. (lbs)	L	18-07-13	18-07-13	Top	243	121			n/a
8	J4(16407)	Conc. Pt. (lbs)	L	19-11-13	19-11-13	Top	189	95			n/a
9	B7(16481)	Conc. Pt. (lbs)	L	20-07-14	20-07-14	Top	68	5			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,158 ft-lbs	36,222 ft-lbs	3.2%	2	06-01-10
Neg. Moment	-7,735 ft-lbs	-36,222 ft-lbs	21.4%	1	16-07-12
End Shear	336 lbs	17,356 lbs	1.9%	2	04-01-15
Cont. Shear	2,940 lbs	17,356 lbs	16.9%	1	17-08-00
Total Load Deflection	2xL/338 (0.29")	n/a	71.1%	80	20-08-12
Live Load Deflection	2xL/467 (0.215")	n/a	78.8%	118	20-08-12
Total Neg. Defl.	L/1,200 (-0.163")	n/a	20.0%	80	10-02-06
Max Defl.	-0.163"	n/a	n/a	80	10-02-06
Span / Depth	20.6				



Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Beam	4-7/16" x 5-1/4"	574 lbs	4.6%	2.0%	Unspecified
B1 Uplift		182 lbs			
B2 Wall/Plate	5-1/2" x 5-1/4"	4,615 lbs	29.9%	13.1%	Unspecified

**Cautions**

Uplift of 181 lbs found at span 1 - Left. (SIMPSON 1-1257 @ ST. B1)

DWENU.TAM 1919 11/14  
STRUCTURAL  
COMPONENT ONLY

T-190111810



**Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLOOR FRAMING** Flush Beams | B5 CANT (16382)  
 Dry | 2 spans | R cant.

**PASSED**

November 9, 2018 07:48:09

BC CALC® Member Report  
 Build 0475


Job name:  
 Address:  
 City, Province, Postal Code: CALEDON  
 Customer:  
 Code reports: CCMC 12472-R

File name: PRESTON 1.mindl  
 Description: 2ND FLOOR FRAMING | Flu... Beams | B5 CANT (16382)  
 Specifier:  
 Designer: PL  
 Company:

**Notes**

Design meets User specified (2xL/240) Total load deflection criteria.  
 Design meets User specified (2xL/360) Live load deflection criteria.  
 Calculations assume member is fully braced.  
 Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.  
 Unbalanced snow loads determined from building geometry were used in selected product's verification.  
 Design based on Dry Service Condition.  
 Importance Factor : Normal Part code : Part 9  
 Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.  
 Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.  
 Nailing schedule applies to both sides of the member.

**Connection Diagram: Full Length of Member**

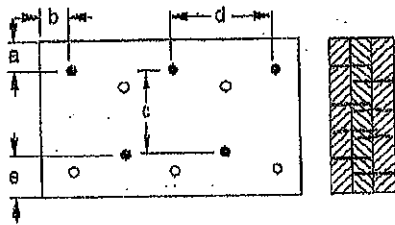

*4 ROWS*

a minimum = 4"  
 b minimum = 3"  
 c = 1 1/2"  
 d = 12"  
 e minimum = 3"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.  
 Nailing schedule applies to both sides of the member.  
 Connectors are: *1* Nails

**3-1/2" ARDOX SPIRAL**



**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

OWEN YAM 1914-1918  
 STRUCTURAL  
 COMPONENT ONLY

*T-1901119*



**Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP.**

**PASSED**

**2ND FLOOR FRAMING/Dropped Beams\B3 DR\16415**

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report

Buld 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 1.mmdl

Description: 2ND FLOOR FRAMING/Dro...ed Beams\B3 DR\16415

Specifier:

Designer: PL

Company:

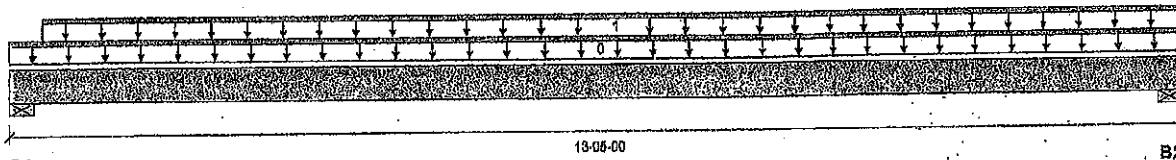

Total Horizontal Product Length = 13-05-00

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1,795 / 0	997 / 0		
B2, 3-1/2"	1,906 / 0	1,062 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	13-05-00	Top	1.00	0.65	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-04-04	13-05-00	Top	286	133			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	12,797 ft-lbs	36,222 ft-lbs	35.3%	1	06-03-00
End Shear	3,761 lbs	17,356 lbs	21.6%	1	04-01-00
Total Load Deflection	L/428 (0.364")	n/a	66.1%	4	06-04-04
Live Load Deflection	L/664 (0.234")	n/a	64.2%	5	06-04-04
Max Defl.	0.364"	n/a	n/a	4	06-04-04
Span / Depth	16.4				



**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 5-1/4"	3,938 lbs	26.4%	17.6%	Unspecified
B2	Wall/Plate 3-1/2" x 5-1/4"	4,174 lbs	28.0%	18.6%	Unspecified

**Notes**

- Design meets Code minimum (L/240) Total load deflection criteria.
- Design meets Code minimum (L/360) Live load deflection criteria.
- Calculations assume unbraced length of Top: 00-05-02, Bottom: 00-05-02.
- Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**
- BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2016 and CSA O86.
- Design based on Dry Service Condition.
- Importance Factor : Normal Part code : Part 9
- Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
- Nailing schedule applies to both sides of the member.
- Member has no side loads.

DWG NO. 2AM1915 - V8H  
STRUCTURAL  
COMPONENT ONLY  
p6/14

T-19011120



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING/Dropped Beams\B3 DR\16415

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALCO® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 1.mmdl


Description: 2ND FLOOR FRAMING/Dropped Beams\B3 DR\16415

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

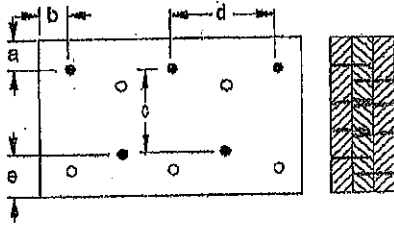

4 rows

a minimum = 1"  
b minimum = 3"

c = 6 1/2"  
d = 12"  
e minimum = 2 1/2"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record. Nailing schedule applies to both sides of the member. Member has no side loads. Connectors are: 1 Nails

3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALCO®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC I®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

DWG NO. TAM 2915-10H  
STRUCTURAL  
COMPONENT ONLY

T-19011120 (2)



# Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

**PASSED**

## 2ND FLOOR FRAMING\Flush Beams\B7(16481)

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report

Build 6476

Job name:

File name: PRESTON 1.mxd

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B7(16481)

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

CGMC 12472-R

Company:



B1 08-02-12 B2

Total Horizontal Product Length = 08-02-12

### Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	62 / 0	51 / 0		
B2, 2"	61 / 0	50 / 0		

### Load Summary


Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-02-12	Top	1.00	0.66	1.00	1.16	00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	08-02-12	Top	15	7			n/a

### Controls Summary

Controls Summary	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	297 ft-lbs	11,610 ft-lbs	2.6%	1	04-01-14
End Shear	117 lbs	6,786 lbs	2.0%	1	01-00-08
Total Load Deflection	L/999 (0.01")	n/a	n/a	4	04-01-14
Live Load Deflection	L/999 (0.005")	n/a	n/a	5	04-01-14
Max Defl.	0.01"	n/a	n/a	4	04-01-14
Span / Depth	10.0				

### Bearing Supports

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 3" x 1-3/4"	157 lbs	n/a	2.4%	HUS1.81/10
B2	Hanger 2" x 1-3/4"	153 lbs	n/a	3.6%	LS90



### Cautions

Header for the hanger HUS1.81/10 at B1 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Header for the hanger LS90 at B2 is a Triple 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model LS90 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

### Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO QBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

OWNED BY YAM 1/9/16 - 1/18/16  
STRUCTURAL  
COMPONENT ONLY

T-1901121



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**

**PASSED**

**2ND FLOOR FRAMING\Flush Beams\B6\16339**

November 9, 2018 07:48:09

BC CALC® Member Report

Dry | 1 span | No cant.

Build 6476

Job name:

File name: PRESTON 1.mxd

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B6\16339

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

CGMC 12472-R

Company:

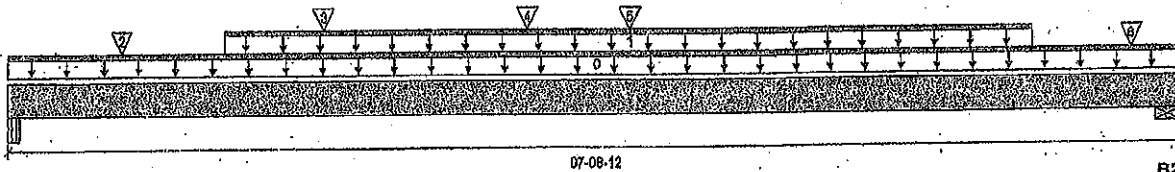

Total Horizontal Product Length = 07-08-12

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1,554 / 0	824 / 0		
B2, 2-3/4"	1,374 / 0	734 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
							1.00	0.88	1.00	1.15	
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-08-12	Top		10			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	01-05-00	06-09-00	Top	295	147			n/a
2		Conc. Pt. (lbs)	L	00-08-16	00-08-16	Top	540	270			n/a
3	J4\16392	Conc. Pt. (lbs)	L	02-00-13	02-00-13	Top	227	114			n/a
4	J4\16407	Conc. Pt. (lbs)	L	03-04-13	03-04-13	Top	175	87			n/a
5	B7\16481	Conc. Pt. (lbs)	L	04-00-14	04-00-14	Top	61	50			n/a
6	J2\16346	Conc. Pt. (lbs)	L	07-05-00	07-05-00	Top	344	172			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	5,816 ft-lbs	23,220 ft-lbs	25.0%	1	03-05-00
End Shear	2,857 lbs	11,571 lbs	24.7%	1	01-01-00
Total Load Deflection	L/999 (0.077")	n/a	n/a	4	03-10-14
Live Load Deflection	L/999 (0.08")	n/a	n/a	5	03-10-14
Max Defl.	0.077"	n/a	n/a	4	03-10-14
Span / Depth	9.3				



**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 3-1/2" x 3-1/2"	3,381 lbs	25.2%	22.5%	Unspecified
B2	Wall/Plate 2-3/4" x 3-1/2"	2,978 lbs	57.9%	25.4%	Unspecified

**Notes**

- Design meets Code minimum (L/240) Total load deflection criteria.
- Design meets Code minimum (L/360) Live load deflection criteria.
- Calculations assume member is fully braced.
- Resistance Factor phi has been applied to all presented results per CSA O86.
- BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
- Design based on Dry Service Condition.
- Importance Factor : Normal Part code : Part 9
- Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

OWN NO. TAM 1917 - 184  
STRUCTURAL 16/14  
COMPONENT ONLY

T-1901122





Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B6\16339

Dry | 1 span | No cant.


November 9, 2018 07:48:09

BC CALC® Member Report  
Build 0475

Job name:  
Address:  
City, Province, Postal Code: CALEDON  
Customer:  
Code reports: CCMC 12472-R

File name: PRESTON 1.mmdl  
Description: 2ND FLOOR FRAMING\Flush Beams\B6\16339  
Specifier:  
Designer: PL  
Company:

Connection Diagram: Full Length of Member

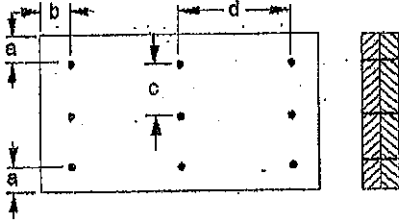

a minimum = 2"      c = 2-3/4"  
b minimum = 3"      d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.  
Connectors are: Nails

3-1/2" ARDOX SPIRAL




Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. TAM 1917-10H  
STRUCTURAL  
COMPONENT ONLY

T-190111260



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLOOR FRAMING\Dropped Beams\B4 DR\16328**


**PASSED**

BC CALC® Member Report  
 Build 6476  
 Job name:  
 Address:  
 City, Province, Postal Code: CALEDON  
 Customer:  
 Code reports: CCMG 12472-R

Dry | 1 span | No cant.

November 9, 2018 07:48:09

File name: PRESTON 1.mxd  
 Description: 2ND FLOOR FRAMING\Dro...ed Beams\B4 DR\16328  
 Specifier:  
 Designer: PL  
 Company:

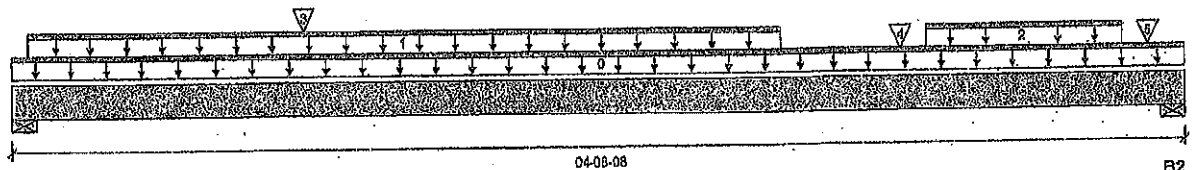

Total Horizontal Product Length = 04-08-08

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1,923 / 0	1,026 / 0		
B2, 6"	1,283 / 0	739 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-08-08	Top		10			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-12	03-00-12	Top	324	162			n/a
2	Bk1(16396)	Unf. Lin. (lb/ft)	L	03-08-00	04-05-08	Top		65			n/a
3	B6(16339)	Conc. Pt. (lbs)	L	01-02-00	01-02-00	Top	1,545	819			n/a
4	J1(16477)	Conc. Pt. (lbs)	L	03-08-12	03-08-12	Top	328	177			n/a
5	J1(16483)	Conc. Pt. (lbs)	L	04-06-12	04-08-12	Top	328	177			n/a

**Controls Summary**

Pos. Moment	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
End Shear	3,526 ft-lbs	23,220 ft-lbs	15.2%	-1	01-06-12
Total Load Deflection	3,703 lbs	11,671 lbs	32.0%	1	01-01-00
Live Load Deflection	L/999 (0.014")	n/a	n/a	4	02-02-04
Max Defl.	L/999 (0.009")	n/a	n/a	5	02-01-08
Span / Depth	0.014"	n/a	n/a	4	02-02-04



**Bearing Supports**


Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 3-1/2"	4,167 lbs	41.9%	27.9%	Unspecified
B2	Wall/Plate 6" x 3-1/2"	2,817 lbs	19.8%	13.2%	Unspecified

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.  
 Design meets Code minimum (L/360) Live load deflection criteria.  
 Calculations assume unbraced length of Top: 00-01-12, Bottom: 00-01-12.  
 Resistance Factor phi has been applied to all presented results per CSA O86.  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.  
 Design based on Dry Service Condition.  
 Importance Factor: Normal Part code: Part 9  
 Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.  
 Member has no side loads.

CONFORMS TO CBC 2012  
 STRUCTURAL COMPONENT ONLY

T-19011023



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**  
**2ND FLOOR FRAMING\Dropped Beams\B4 DR\6328**

**PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

November 9, 2018 07:48:09

Build 6476

Job name:

File name: PRESTON 1.mmdl

Address:

Description: 2ND FLOOR FRAMING\Dro...ed Beams\B4 DR\6328

City, Province, Postal Code: CALEDON

Specifier:

Customer:


Designer: PL

Code reports:

CGMC 12472-R

Company:

**Connection Diagram: Full Length of Member**

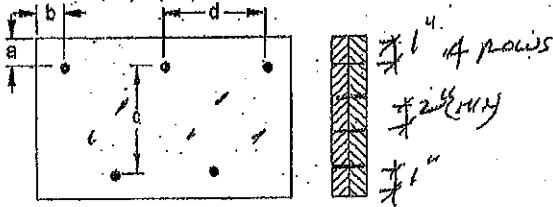

a minimum = 1"  
 b minimum = 3"

c = 7-1/2"  
 d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Member has no side loads.

Connectors are: *3/4" x 3" Nails*

**3-1/2" ARDOX SPIRAL**



**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. YAM 1418 - 18  
 STRUCTURAL  
 COMPONENT ONLY

*T. 190.11230*



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**

**PASSED**

**2ND FLOOR FRAMING\Flush Beams\B8\16285**

November 9, 2018 07:48:09

BC CALC® Member Report

Dry | 1 span | No cant.

Buld 6475

Job name:

File name: PRESTON 1.mmdl

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B8\16285

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

GCMC 12472-R

Company:

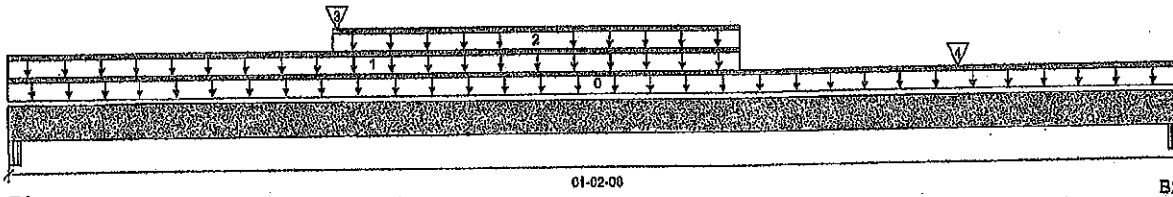

Total Horizontal Product Length = 01-02-08

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 2-1/2"	249 / 0	355 / 0	777 / 0	
B2, 5"	144 / 0	208 / 0	418 / 0	

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
							1.00	0.68	1.00	1.16	
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-02-08	Top		10			00-00-00
1	E23(1388)	Unf. Lin. (lb/ft)	L	00-00-00	00-09-00	Top		81			n/a
2	E23(1388)	Unf. Lin. (lb/ft)	L	00-04-00	00-09-00	Top	72	65	221		n/a
3	-	Conc. Pt. (lbs)	L	00-04-01	00-04-01	Top	328	409	1,000		n/a
4	E22(1389)	Conc. Pt. (lbs)	L	00-11-12	00-11-12	Top	38	53	101		n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	343 ft-lbs	23,220 ft-lbs	1.5%	13	00-04-00
End Shear	225 lbs	11,571 lbs	1.9%	13	00-00-00
Span / Depth	0.9				

**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 2-1/2" x 3-1/2"	1,859 lbs	39.8%	17.4%	Unspecified
B2	Beam 5" x 3-1/2"	1,031 lbs	11.0%	4.8%	Unspecified



**Notes**

Calculations assume member is fully braced.  
 Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.  
 Unbalanced snow loads determined from building geometry were used in selected product's verification.  
 Design based on Dry Service Condition.  
 Importance Factor: Normal Part code: Part 9  
 Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWG NO. TAM 1919-18H  
 STRUCTURAL  
 COMPONENT ONLY

T-19011124



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B8(16286)

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 1.mmdl


Description: 2ND FLOOR FRAMING\Flush Beams\B8(16286)

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

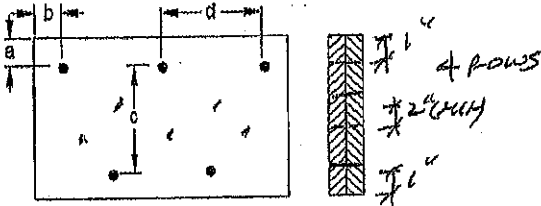

a minimum = 4"
b minimum = 3"
c = 7-1/2"
d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record. Connectors are: 1 Nails

3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DWG NO. TAM 1819-18H STRUCTURAL COMPONENT ONLY

T-1901122460



**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP**

**PASSED**

**2ND FLOOR FRAMING Flush Beams B9 (6298)**

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report

Buld 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 1.mmdl

Description: 2ND FLOOR FRAMING Flush Beams B9 (6298)

Specifier:

Designer: PL

Company:

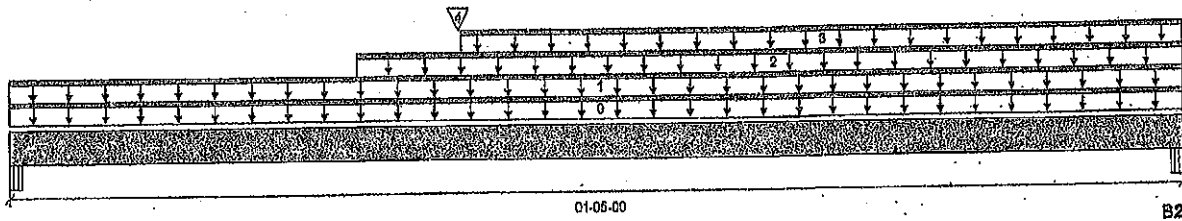

Total Horizontal Product Length = 01-06-00

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 6"	289 / 0	394 / 0	793 / 0	
B2, 6"	165 / 0	239 / 0	436 / 0	

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.68	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-06-00	Top		10			00-00-00
1	LOW ROOF	Unf. Lin. (lb/ft)	L	00-00-00	01-06-00	Top	33	30	34		n/a
2	E21(I383)	Unf. Lin. (lb/ft)	L	00-05-00	01-06-00	Top		81			n/a
3	E21(I383)	Unf. Lin. (lb/ft)	L	00-06-08	01-06-00	Top	72	65	221		n/a
4		Conc. Pt. (lbs)	L	00-06-07	00-06-07	Top	323	439	987		n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	344 ft-lbs	23,220 ft-lbs	1.5%	13	00-06-08
End Shear	163 lbs	11,571 lbs	1.4%	13	00-02-08
Span / Depth	0.9				

**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 6" x 3-1/2"	1,951 lbs	20.9%	9.1%	Unspecified
B2	Beam 6" x 3-1/2"	1,117 lbs	12.0%	5.2%	Unspecified



**Notes**

- Calculations assume member is fully braced.
- Resistance Factor phi has been applied to all presented results per CSA O86.
- BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
- Unbalanced snow loads determined from building geometry were used in selected product's verification.
- Design based on Dry Service Condition.
- Importance Factor: Normal Part code: Part 9.
- Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWR NO. 1920-184  
STRUCTURAL  
COMPONENT ONLY

T. Goulet



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

**PASSED**

## 2ND FLOOR FRAMING\Flush Beams\B9\16298

Dry | 1 span | No cant.

November 9, 2018 07:48:09

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 1.mxd


Description: 2ND FLOOR FRAMING\Flush Beams\B9\16298

Specifier:

Designer: PL

Company:

### Connection Diagram: Full Length of Member

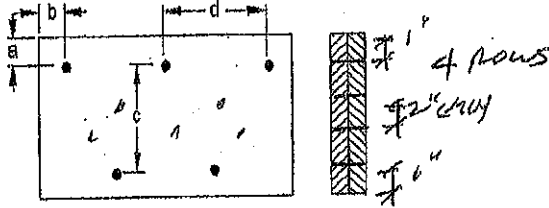

a minimum = 3"  
 b minimum = 3"  
 c = 7-1/2"  
 d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.  
 Connectors are: Nails

3-1/2" ARDOX SPIRAL



**THIS STRUCTURE MUST BE  
 CONSTRUCTED TO MEET OR  
 EXCEED THE PROVISIONS OF  
 THE ONTARIO BUILDING CODE**

### Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,  
 DWANG YAM 19/11/18  
 STRUCTURAL  
 COMPONENT ONLY

T-1901126



Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Dropped Beams\B12 DR(15622)

November 9, 2018 08:08:41

BC CALCO® Member Report

Dry | 1 span | No cant.

Buld 6476

Job name:

File name: PRESTON 1 OPT 5-BED.mmdl

Address:

Description: 2ND FLOOR FRAMING\Dro...d Beams\B12 DR(15622)

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

CCMC 12472-R

Company:

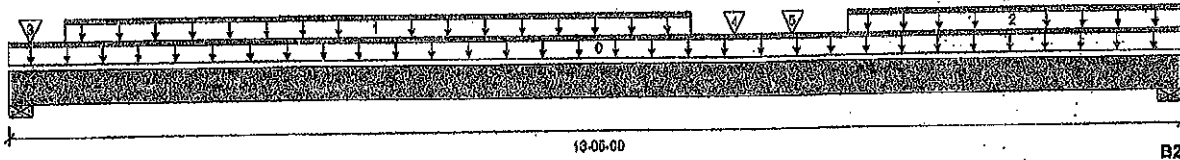

Total Horizontal Product Length = 13-06-00

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1,928 / 0	1,080 / 0		
B2, 3-1/2"	1,904 / 0	1,049 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
							1.00	0.85	1.00	1.15	
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	13-05-00	Top		14			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-07-12	07-09-00	Top	258	129			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	08-07-00	13-05-00	Top	272	136			n/a
3	J3(15675)	Conc. Pt. (lbs)	L	00-03-00	00-03-00	Top	258	129			n/a
4	J3(15654)	Conc. Pt. (lbs)	L	08-03-00	08-03-00	Top	215	107			n/a
5	J3(15659)	Conc. Pt. (lbs)	L	08-11-00	08-11-00	Top	268	129			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	12,748 ft-lbs	36,222 ft-lbs	35.2%	1	06-04-04
End Shear	3,642 lbs	17,356 lbs	21.0%	1	01-01-00
Total Load Deflection	L/428 (0.363")	n/a	58.0%	4	06-04-04
Live Load Deflection	L/865 (0.234")	n/a	54.2%	5	06-04-04
Max Defl.	0.363"	n/a	n/a	4	06-04-04
Span / Depth	16.4				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 5-1/4"	4,214 lbs	28.2%	18.8%	Unspecified
B2	Wall/Plate 3-1/2" x 5-1/4"	4,167 lbs	27.9%	18.6%	Unspecified


Notes

- Design meets Code minimum (L/240) Total load deflection criteria.
- Design meets Code minimum (L/360) Live load deflection criteria.
- Calculations assume unbraced length of Top: 00-03-09, Bottom: 00-03-09.
- Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012
- BC CALCO analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
- Design based on Dry Service Condition.
- Importance Factor : Normal Part code : Part 9
- Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
- Nailing schedule applies to both sides of the member.
- Member has no side loads.

DWG NO. FAW 1921-184  
STRUCTURAL  
COMPONENT ONLY

T-1901126





Triple 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP  
2ND FLOOR FRAMING\Dropped Beams\B12 DR(15922)

**PASSED**

BC CALC® Member Report  
Build 6475


Dry | 1 span | No cant.

November 9, 2018 08:08:41

Job name:  
Address:  
City, Province, Postal Code: CALEDON  
Customer:  
Code reports: CCMC 12472-R

File name: PRESTON 1 OPT 5 BED.mmdl  
Description: 2ND FLOOR FRAMING\Dro...d Beams\B12 DR(15922)  
Specifier:  
Designer: PL  
Company:

**Connection Diagram: Full Length of Member**

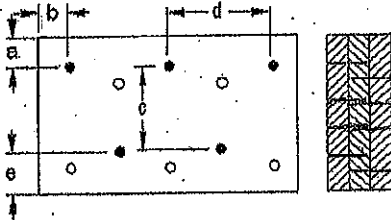

*4 rows*

- a minimum = 1"
- b minimum = 3"
- c = 6-1/2"
- d = 8"
- e minimum = 2"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.  
Nailing schedule applies to both sides of the member.  
Member has no side loads.  
Connectors are: ~~3/8" x 3" Nails~~

3-1/2" ARDOX SPIRAL



**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).  
Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods.  
Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

DWG NO. TAM 2921 - 18  
STRUCTURAL  
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™,  
ALLJOIST®, BC RIM BOARD™, BCI®,  
BOISE GLULAM™, BC FloorValue®,  
VERSA-LAM®, VERSA-RIM PLUS®

*T-19011126(9)*



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

**PASSED**

## 2ND FLOOR FRAMING\Flush Beams\B13\16703

BC CALC® Member Report

Dry | 1 span | No cant.

November 9, 2018 08:08:41

Build 6476

Job name:

File name: PRESTON 1 OPT 6 BED.mmdl

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B13\16703

City, Province, Postal Code: CALEDON


Specifier:

Customer:

Designer: PL

Code reports: CCMC 12472-R

Company:

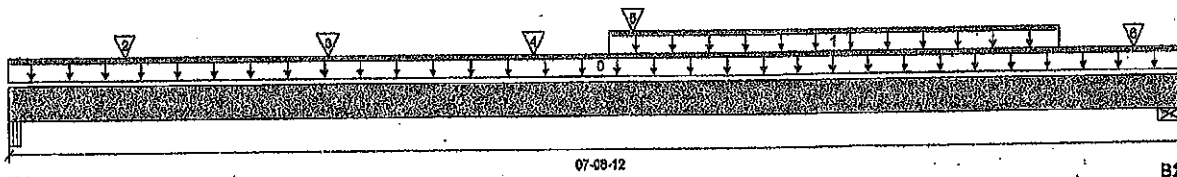

Total Horizontal Product Length = 07-08-12

### Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1,665 / 0	824 / 0		
B2, 2-3/4"	1,340 / 0	717 / 0		

### Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	07-08-12	Top		10			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	03-11-00	06-11-00	Top	298	148			n/a
2	-	Conc. Pt. (lbs)	L	00-09-00	00-09-00	Top	543	271			n/a
3	-	Conc. Pt. (lbs)	L	02-01-00	02-01-00	Top	617	309			n/a
4	-	Conc. Pt. (lbs)	L	03-05-00	03-05-00	Top	516	258			n/a
5	B7\16746	Conc. Pt. (lbs)	L	04-00-14	04-00-14	Top	60	50			n/a
6	J2\16667	Conc. Pt. (lbs)	L	07-05-00	07-05-00	Top	258	129			n/a

### Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	5,824 ft-lbs	23,220 ft-lbs	25.1%	1	03-05-00
End Shear	2,864 lbs	11,571 lbs	24.7%	1	01-01-00
Total Load Deflection	L/999 (0.078")	n/a	n/a	4	03-09-15
Live Load Deflection	L/999 (0.061")	n/a	n/a	5	03-09-15
Max Defl.	0.078"	n/a	n/a	4	03-09-15
Span / Depth	9.3				



### Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 3-1/2" x 3-1/2"	3,862 lbs	25.2%	22.5%	Unspecified
B2	Wall/Plate 2-3/4" x 3-1/2"	2,806 lbs	56.5%	24.7%	Unspecified

### Notes

- Design meets Code minimum (L/240) Total load deflection criteria.
- Design meets Code minimum (L/360) Live load deflection criteria.
- Calculations assume member is fully braced.
- Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**
- BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
- Design based on Dry Service Condition.
- Importance Factor : Normal Part code : Part 0
- Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWYAN TAY 1922-1811  
STRUCTURAL  
COMPONENT ONLY

T-192011127



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B13\15703

Dry | 1 span | No cant.

November 9, 2018 08:08:41

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 1 OPT 5 BED.mmdl


Description: 2ND FLOOR FRAMING\Flush Beams\B13\15703

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

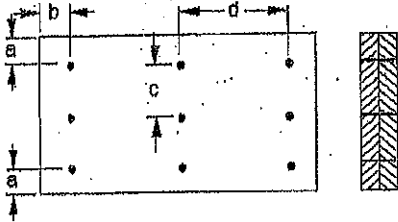

a minimum = 2" c = 2-3/4"
b minimum = 3" d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
Connectors are: Nails

3-1/2" ARDOX SPIRAL




Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

NWB NO. YAM 192218H
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

F-19011127(x)



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

**PASSED**

## 2ND FLOOR FRAMING\Flush Beams\B14\16380


Dry | 1 span | No cant.

November 9, 2018 08:09:48

BC CALC® Member Report  
Build 6475

Job name:  
Address:  
City, Province, Postal Code: CALEDON  
Customer:  
Code reports: CCMC 12472-R

File name: PRESTON 1 ELEV 2.mxd  
Description: 2ND FLOOR FRAMING\Flush Beams\B14\16380  
Specifier:  
Designer: PL  
Company:

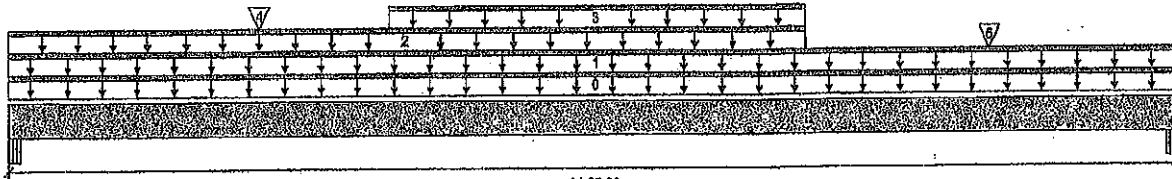

Total Horizontal Product Length = 01-05-00

### Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 6"	237 / 0	278 / 0	399 / 0	
B2, 6"	88 / 0	114 / 0	145 / 0	

### Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-05-00	Top		10			00-00-00
1	LOW ROOF	Unf. Lin. (lb/ft)	L	00-00-00	01-05-00	Top	83	30	102		n/a
2	E23(1388)	Unf. Lin. (lb/ft)	L	00-00-00	00-11-08	Top		81			n/a
3	E23(1388)	Unf. Lin. (lb/ft)	L	00-05-08	00-11-08	Top	33	30	102		n/a
4		Conc. Pt. (lbs)	L	00-03-10	00-03-10	Top	245	206	301		n/a
5	E22(1389)	Conc. Pt. (lbs)	L	01-02-04	01-02-04	Top	15	37	47		n/a

### Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	67 ft-lbs	23,220 ft-lbs	0.3%	1	00-07-00
End Shear	131 lbs	11,671 lbs	1.1%	13	01-02-08
Span / Depth	0.9				

### Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 6" x 3-1/2"	1,182 lbs	12.7%	6.5%	Unspecified
B2	Beam 6" x 3-1/2"	447 lbs	4.8%	2.1%	Unspecified



### Notes

Calculations assume member is fully braced.  
 Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**  
 BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.  
 Unbalanced snow loads determined from building geometry were used in selected product's verification.  
 Design based on Dry Service Condition.  
 Importance Factor : Normal Part code : Part 9  
 Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

OWNED BY FAM 1923 18H  
STRUCTURAL 16/12  
COMPONENT ONLY

T-19011128



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B14\16380

Dry | 1 span | No cant.

November 9, 2018 08:09:48

BC CALC® Member Report

Build 6476

Job name:

File name: PRESTON 1 ELEV 2.mmdl

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B14\16380

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports: CCMC 12472-R

Company:

Connection Diagram: Full Length of Member

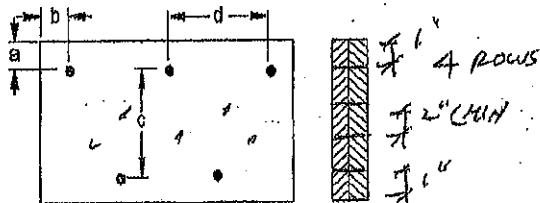

a minimum = 1" c = 1-1/2"
b minimum = 3" d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)292-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC Floor/Value®, VERSA-LAM®, VERSA-RIM PLUS®,

OWNER, TAM 1923 - 1924
STRUCTURAL
COMPONENT ONLY

T-19011286



# Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

## 2ND FLOOR FRAMING\Flush Beams\B15(16372)

Dry | 1 span | No cant.

November 9, 2016 08:09:48

BC CALC® Member Report

Build 6475

Job name:

File name: PRESTON 1 ELEV 2.mmdl

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B15(16372)

City, Province, Postal Code: CALEDON


Specifier:

Customer:

Designer: PL

Code reports: CCMC 12472-R

Company:

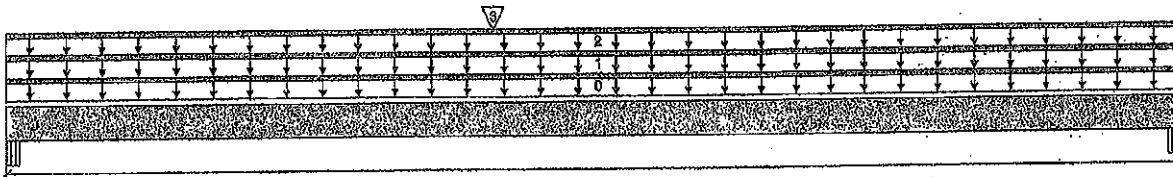

B1

Total Horizontal Product Length = 01-05-00

B2

### Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5"	116 / 0	147 / 0	140 / 0	
B2, 5"	72 / 0	125 / 0	140 / 0	

### Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-05-00	Top		10			00-00-00
1	E29(1414)	Unf. Lin. (lb/ft)	L	00-00-00	01-05-00	Top	10	107	95		n/a
2	LOW ROOF	Unf. Lin. (lb/ft)	L	00-00-00	01-05-00	Top	33	30	102		n/a
3	J6(8277)	Conc. Pt. (lbs)	L	00-07-00	00-07-00	Top	127	84			n/a

### Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	66 ft-lbs	23,220 ft-lbs	0.3%	1	00-07-00
End Shear	131 lbs	11,571 lbs	1.1%	23	01-02-08
Span / Depth	0.9				



### Bearing Supports

	dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 5" x 3-1/2"	509 lbs	6.5%	2.4%	Unspecified
B2	Beam 5" x 3-1/2"	437 lbs	4.7%	2.0%	Unspecified

### Notes

- Calculations assume member is fully braced.
- Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**
- BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
- Unbalanced snow loads determined from building geometry were used in selected product's verification.
- Design based on Dry Service Condition.
- Importance Factor: Normal Part code: Part 9
- Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWG NO. 7AW 1924-18H  
STRUCTURAL  
COMPONENT ONLY

T-19011129



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B15\16372

BC CALC® Member Report

Diy | 1 span | No cant.

November 9, 2018 08:09:48

Build 6475

Job name:

File name: PRESTON 1 ELEV 2.mxd

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B15\16372

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports: CCMC 12472-R

Company:


Connection Diagram: Full Length of Member

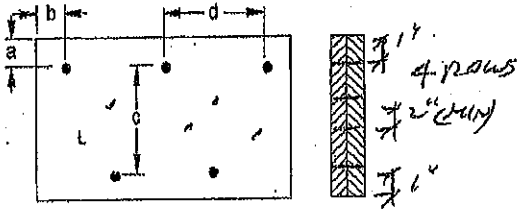

a minimum = 8" c = 1-1/2"
b minimum = 3" d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: Nails
3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, HALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®
DWG NO. TAM 1924-19 STRUCTURAL COMPONENT ONLY

T-190111296



**Single 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP**

**PASSED**

**1ST FLOOR FRAMING\Flush Beams\B20(i7073)**

BC CALC® Member Report

Dry | 1 span | No cant.

July 6, 2019 10:26:41

Buld 7118

Job name:

File name: PRESTON 1 STD.mmdl

Address:

Description: 1ST FLOOR FRAMING\Flush Beams\B20(i7073)

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

CCMC 12472-R

Company:

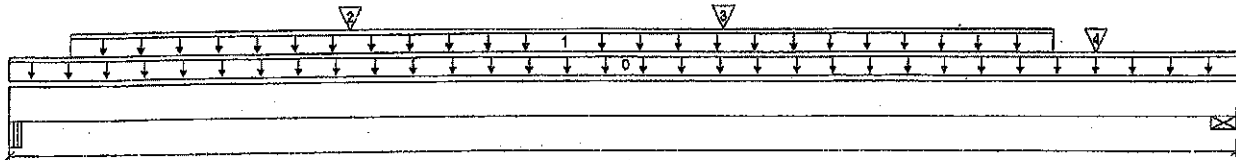

Total Horizontal Product Length = 04-05-04

**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 2-3/4"	907 / 0	467 / 0		
B2, 3-1/2"	1,036 / 0	544 / 0		

**Load Summary**

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-05-04	Top	1.00	0.65	1.00	1.15	00-00-00
1	STAIR	Unf. Lin. (lb/ft)	L	00-02-12	03-09-04	Top	240	120			n/a
2	J2(i6650)	Conc. Pt. (lbs)	L	01-02-12	01-02-12	Top	354	177			n/a
3	J2(i6673)	Conc. Pt. (lbs)	L	02-08-12	02-06-12	Top	358	179			n/a
4	-	Conc. Pt. (lbs)	L	03-11-02	03-11-02	Top	370	197			n/a

**Controls Summary**

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	2,199 ft-lbs	17,696 ft-lbs	12.4%	1	02-05-12
End Shear	1,606 lbs	7,232 lbs	22.2%	1	03-01-14
Total Load Deflection	L/999 (0.009")	n/a	n/a	4	02-02-04
Live Load Deflection	L/999 (0.006")	n/a	n/a	5	02-02-04
Max Defl.	0.009"	n/a	n/a	4	02-02-04
Span / Depth	4.1				

**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 2-3/4" x 1-3/4"	1,943 lbs	75.6%	33.1%	Unspecified
B2	Wall/Plate 3-1/2" x 1-3/4"	2,233 lbs	68.3%	29.9%	Unspecified

**Notes**

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

*CONFORMS TO OBC 2012*



DESIGN CONFORMS TO OBC2012


**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

ET0000638







**Maximum Floor Spans**

Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-4"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-5"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-1274C.



### Maximum Floor Spans



Live Load = 40 psf, Dead Load = 30 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

1. Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings.
4. Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
6. Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.




### Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
16"	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	18'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-40x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-60	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-70	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-80	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
16"	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



### Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf  
Simple Spans, L/480 Deflection Limit  
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A	
14"	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
16"	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A	
14"	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
16"	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.




### Allowance for Piping (Installation Notes)


The floor layouts have usually not been checked for heating and/or plumbing interference. On-site adjustment of joists of up to 3 inches is permitted to avoid interferences. When moving a joist, the subfloor thickness shall be checked with code requirements when the joist spacing exceeds 19.2 inches. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.

Installation of Nordic I-joists shall be as per *Nordic Joist Installation Guide for Residential Floors*. Refer to Tables 1 and 2 for maximum web hole and duct chase openings, respectively. These tables are based on the I-joists being used at their maximum spans. The minimum distance given may be reduced for shorter spans; contact your distributor for additional information.


The detail below shows the 3-inch allowance for piping. Every third joist may be shifted up to 3 inches to avoid heating/plumbing interference. For other applications, please contact your distributor.

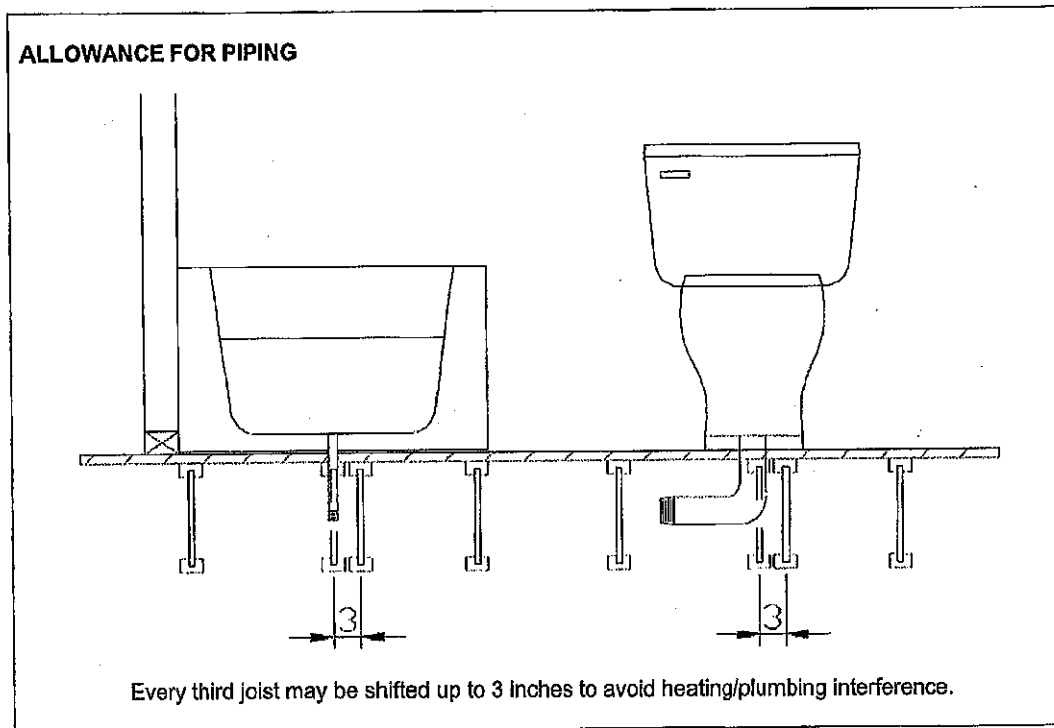

Revised April 12, 2012

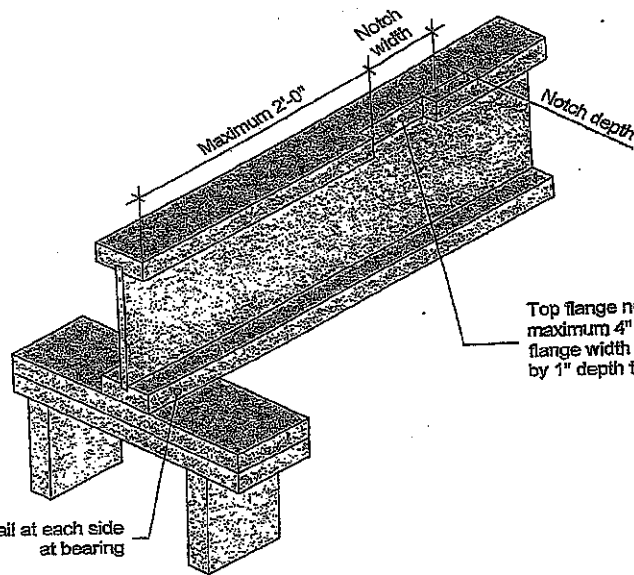

Top flange notch, maximum 4" width by 1/2" depth for flange width of 2-1/2" and 4" width by 1" depth for flange width of 3-1/2"

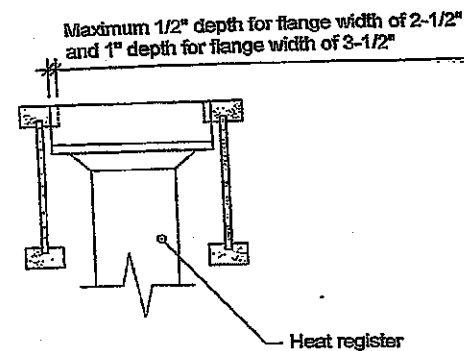

**Notes:**

1. Blocking required at bearing for lateral support, not shown for clarity.
2. The maximum dimensions for a notch on the side of the top flange are 4-inch width by 1/2-inch depth for flange width of 2-1/2 inches, and 4-inch width by 1-inch depth for flange width of 3-1/2 inches.
3. This detail applies to simple-span joists and multiple-span joists where the notch is located at the end half-span.
4. For other applications, contact Nordic Structures.

THIS STRUCTURE MUST BE  
 CONSTRUCTED TO MEET OR  
 EXCEED THE PROVISIONS OF  
 THE CANADIAN NATIONAL  
 BUILDING CODE

This document supersedes all previous versions. If the document has been in effect for more than one year, consult nordic.ca or contact Nordic Structures.

All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

**NORDIC  
STRUCTURES**

T 514-871-8526  
 1 866 817-3418  
 nordic.ca

TITLE  
 Notch in I-joist for Heat Register

CATEGORY  
 I-joist - Typical Floor Framing and Construction Details

DOCUMENT

DATE  
 2018-04-10

NUMBER  
 1w-1