

FROM PLAN DATED: SEPT 25 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 3

ELEVATION: THIS STRUCTURE MUST BE

LOT: CONSTRUCTED TO MEET OR

CITY: CALEDON EXCEED THE PROVISIONS OF

SALESMAN: M-D THE ONTARIO BUILDING CODE

DESIGNER: PL

REVISION:

NOTES:

REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 15.0 lb/ft²


TILED AREAS: 20 lb/ft

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2019-01-15

1st FLOOR

DECK

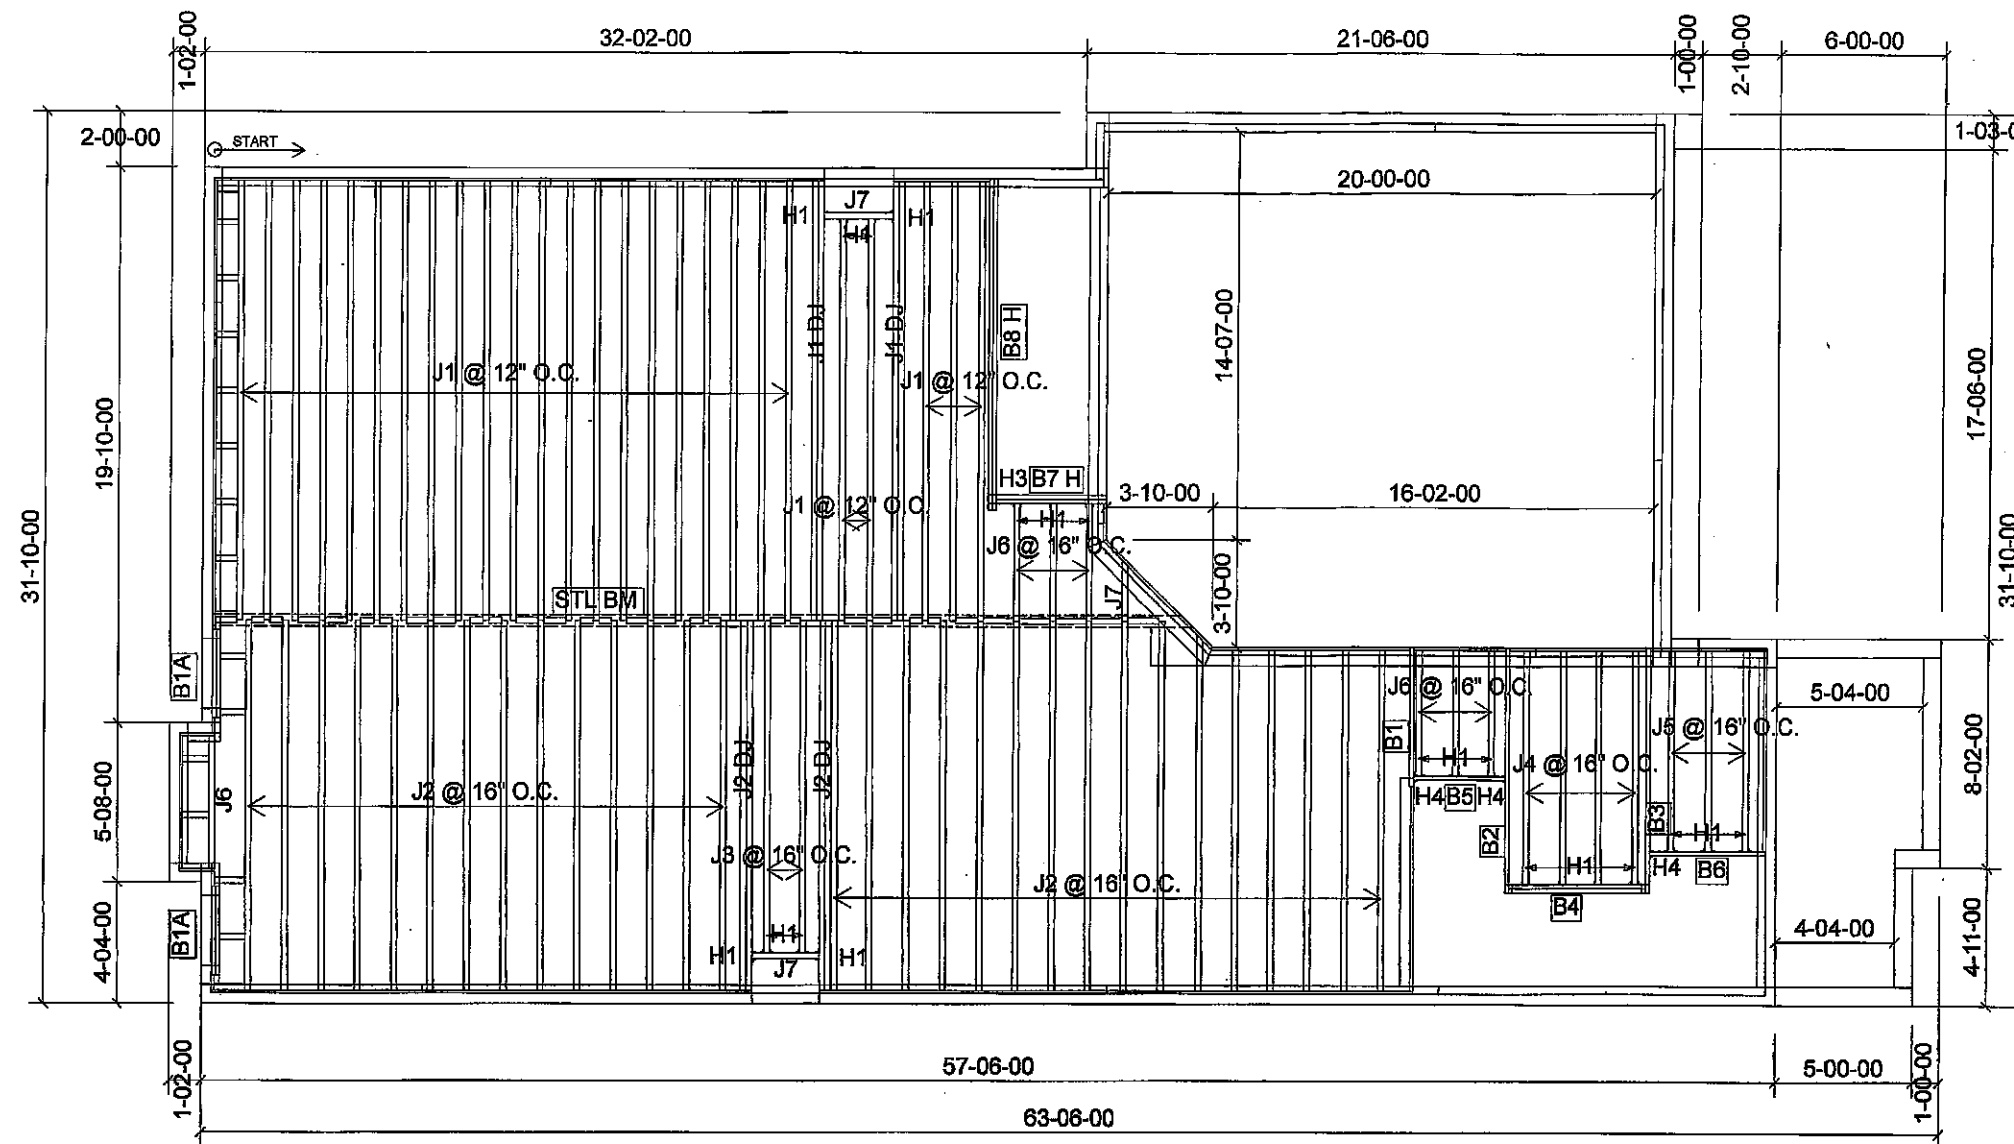

Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	26
J1 DJ	16-00-00	9 1/2" NI-40x	2	4
J2	14-00-00	9 1/2" NI-40x	1	30
J2 DJ	14-00-00	9 1/2" NI-40x	2	4
J3	12-00-00	9 1/2" NI-40x	1	2
J4	10-00-00	9 1/2" NI-40x	1	4
J5	8-00-00	9 1/2" NI-40x	1	3
J6	6-00-00	9 1/2" NI-40x	1	7
J7	4-00-00	9 1/2" NI-40x	1	3
B8 H	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B6	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B7 H	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B5	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	4

Connector Summary		
Qty	Manuf	Product
6	H1	IUS2.56/9.5
7	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
1	H3	HGUS410
3	H4	HUS1.81/10

RECEIVED
JUN 13 2019
TOWN OF CALEDON
BUILDING SECTION



BUILDER: GREENPARK HOMES

MODEL: PRESTON 3

ELEVATION: 2

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION:

REFER TO THE **NORDIC INSTALLATION**
GUIDE FOR PROPER STORAGE AND
INSTALLATION.

SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F
REQ'D UNDER INTERIOR UNIFORM LOAD
BEARING WALLS. MULTIPLE SQUASH
BLOCKS REQ'D UNDER CONCENTRATED
LOADS. SEE FIGURE 1. CANTILEVERED
JOISTS INCLUDING CANT' OVER BRICK REQ.
I-JOIST BLOCKING ALONG BEARING AND
RIMBOARD CLOSURE AT ENDS. SEE
FIGURES 4 & 5 FOR REINFORCEMENT
REQUIREMENTS. FOR HOLES INCLUDING
DUCT CHASE AND FIELD CUT OPENINGS
SEE FIGURE 7, TABLES 1 & 2. CERAMIC TILE
APPLICATION AS PER O.B.C 9.30.6.

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 15.0 lb/ft.²


TILED AREAS: 20 lb/ft²

SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 2019-01-15

1st FLOOR

DECK

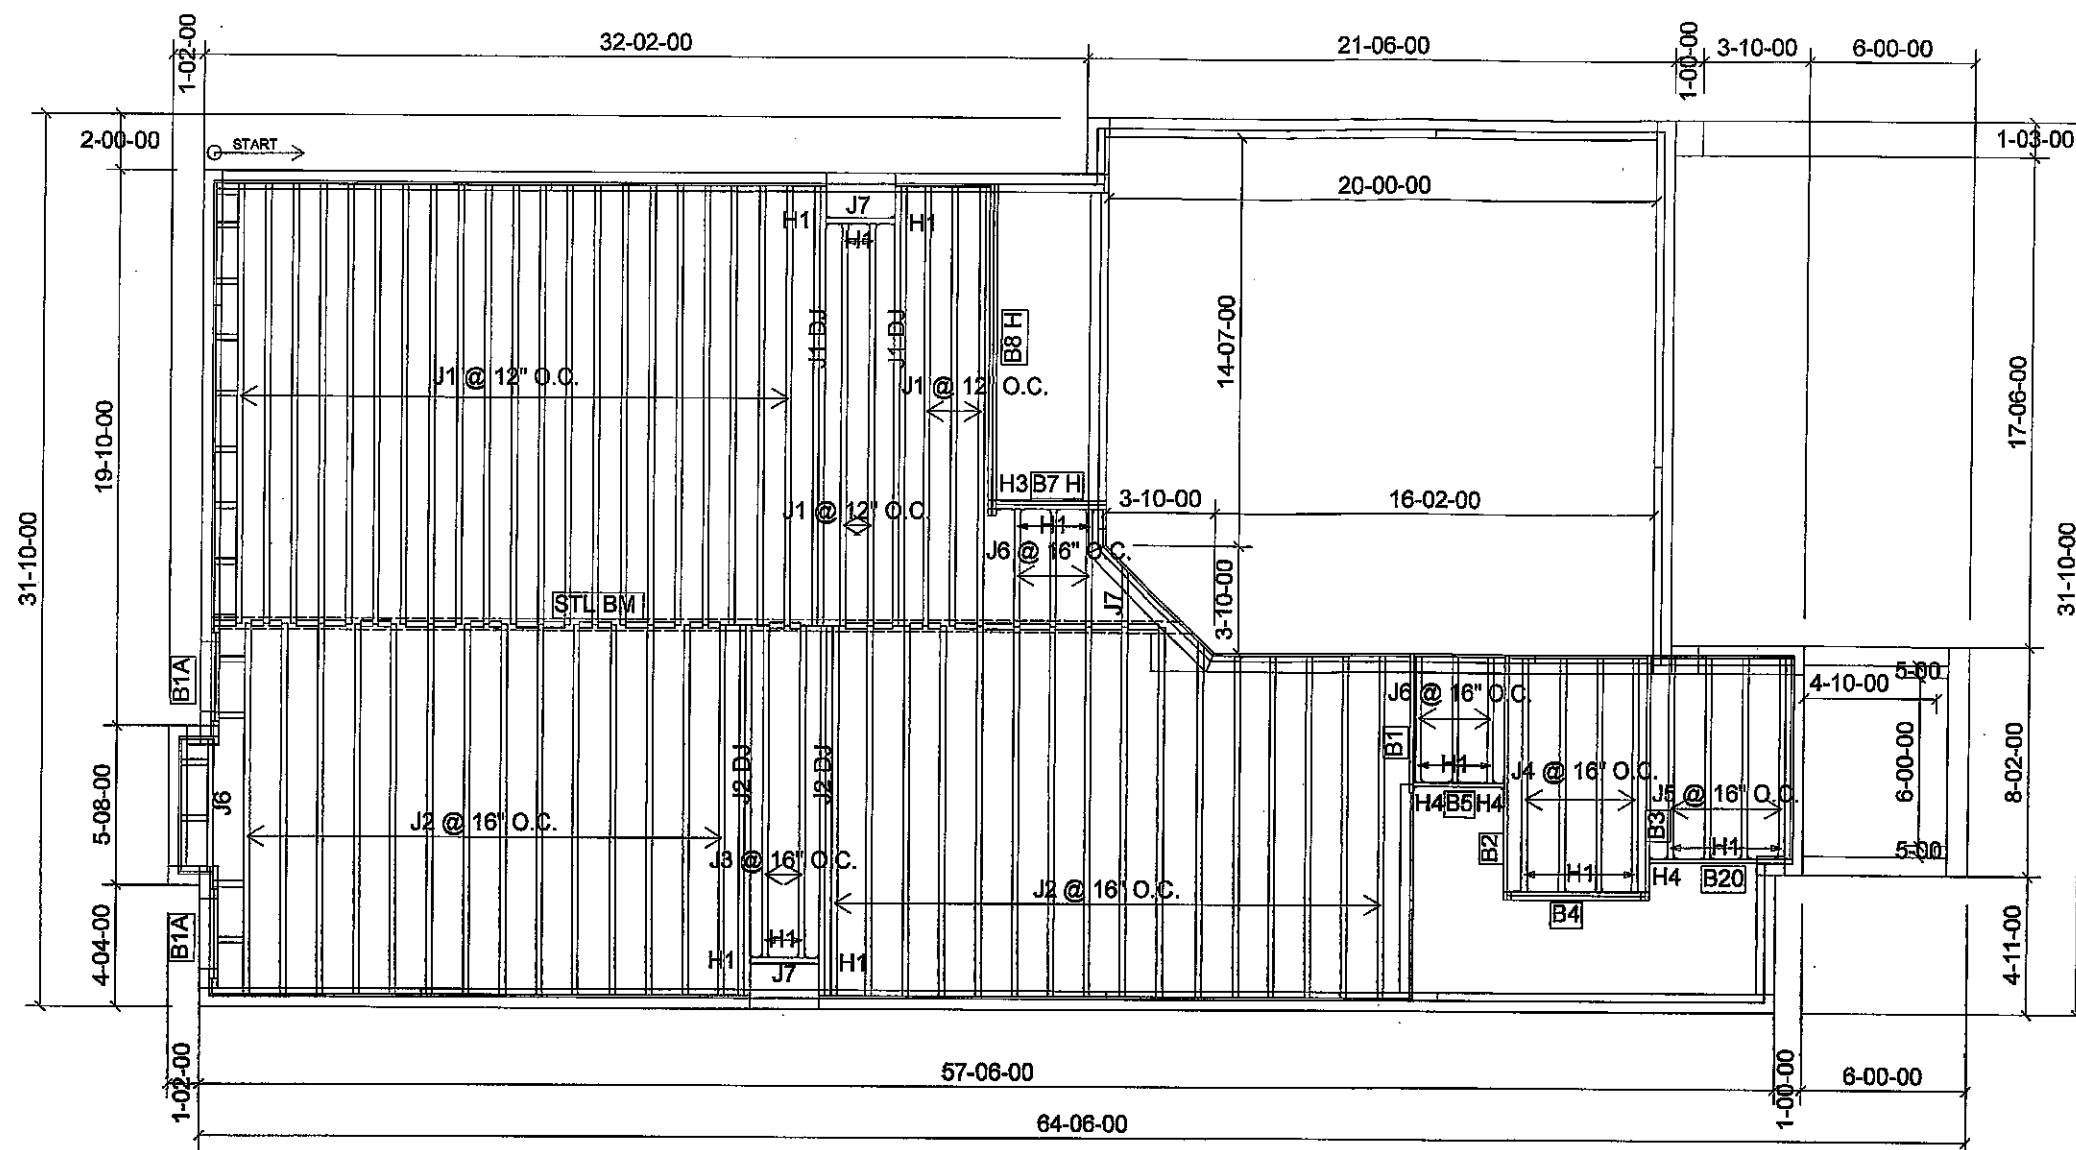


Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	26
J1 DJ	16-00-00	9 1/2" NI-40x	2	4
J2	14-00-00	9 1/2" NI-40x	1	30
J2 DJ	14-00-00	9 1/2" NI-40x	2	4
J3	12-00-00	9 1/2" NI-40x	1	2
J4	10-00-00	9 1/2" NI-40x	1	4
J5	8-00-00	9 1/2" NI-40x	1	4
J6	6-00-00	9 1/2" NI-40x	1	7
J7	4-00-00	9 1/2" NI-40x	1	3
B8 H	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B20	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B7 H	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B5	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1A	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	4

Connector Summary		
Qty	Manuf	Product
7	H1	IUS2.56/9.5
7	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
1	H3	HGUS410
3	H4	HUS1.81/10

RECEIVED
JUN 13 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO _____

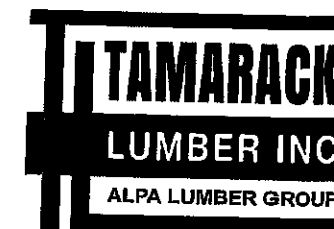

FROM PLAN DATED: SEPT 25 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 3

ELEVATION: 1

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL


REVISION:

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR HOLES INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft²
SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 11/6/2018

1st FLOOR

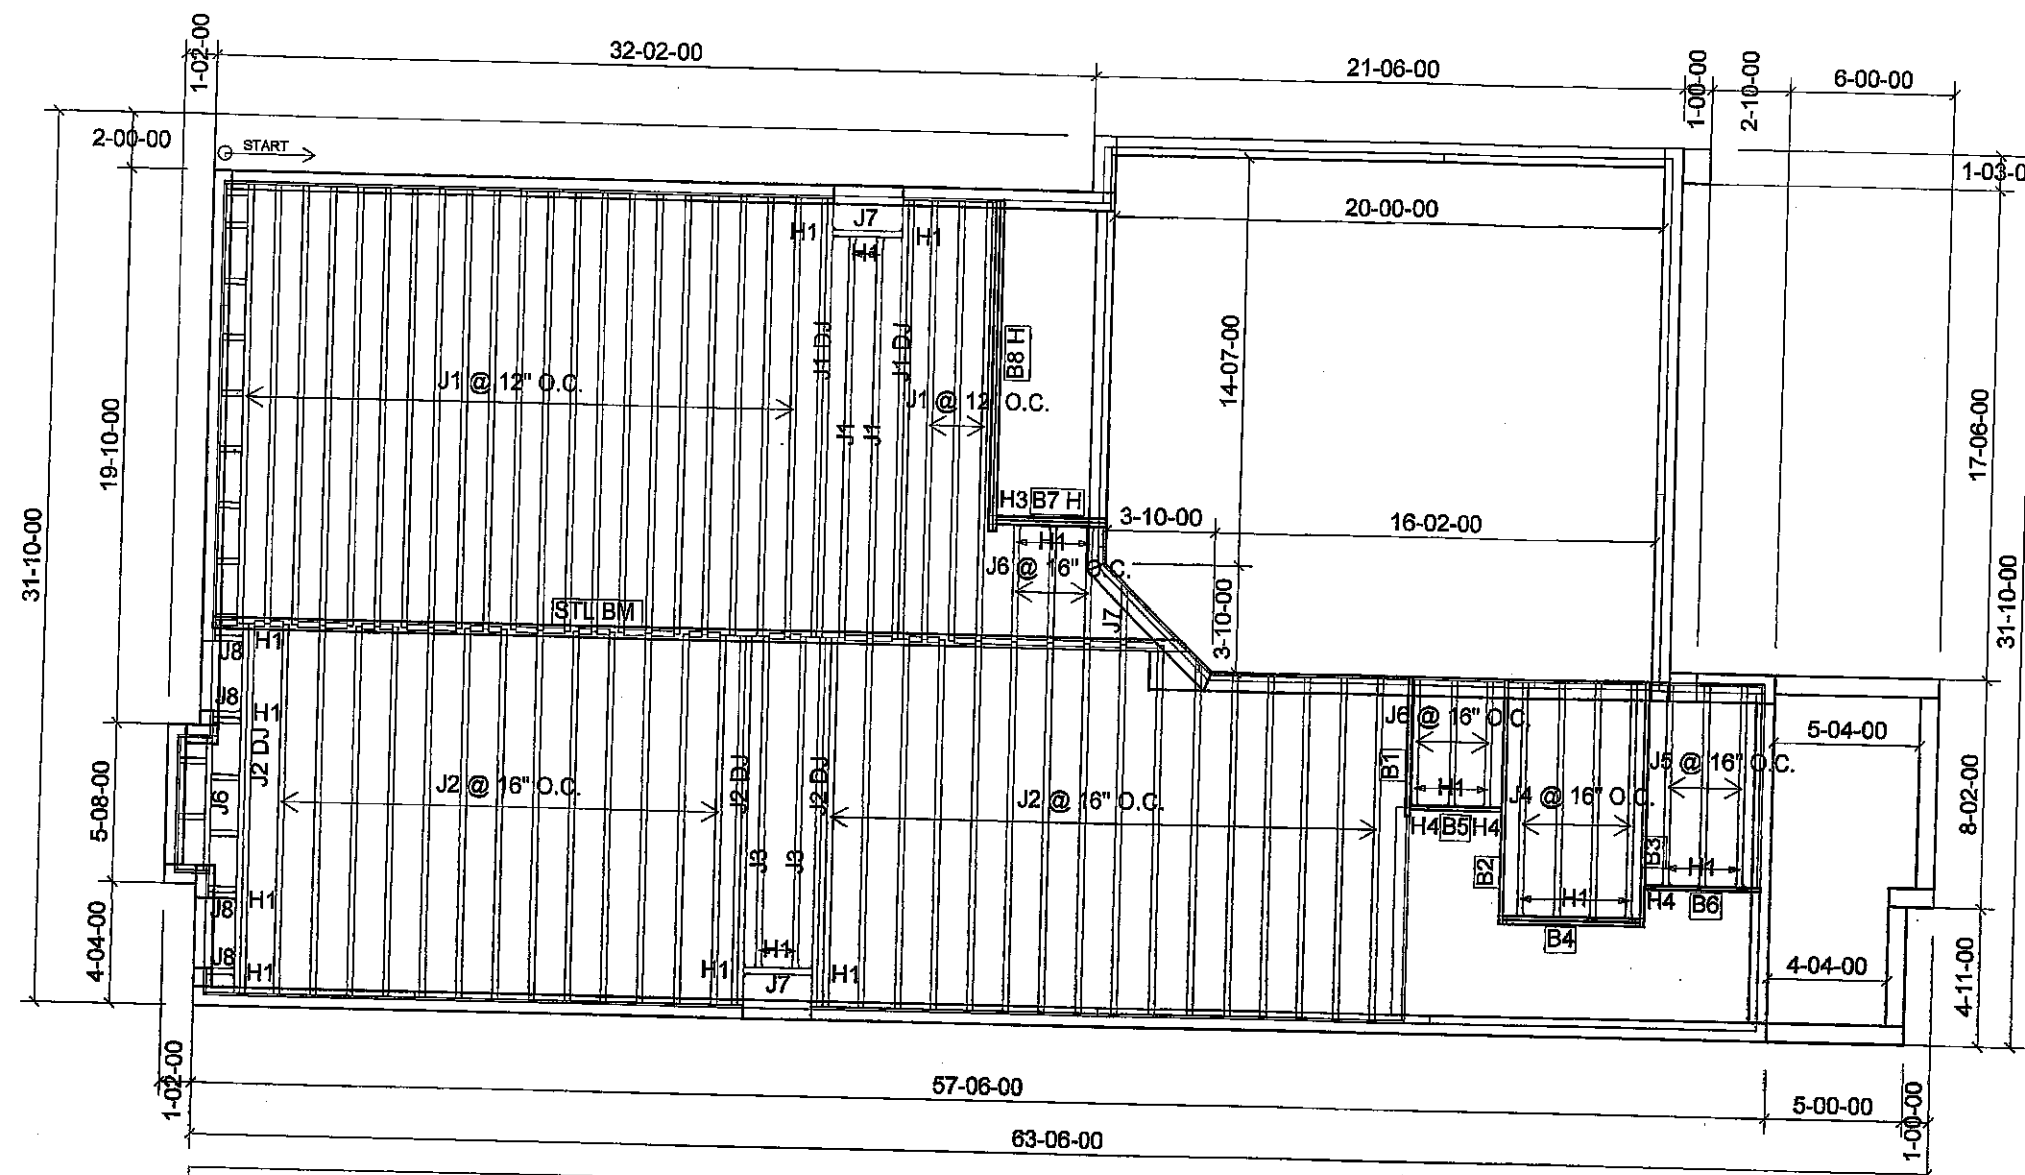


Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	26
J1 DJ	16-00-00	9 1/2" NI-40x	2	4
J2	14-00-00	9 1/2" NI-40x	1	29
J2 DJ	14-00-00	9 1/2" NI-40x	2	6
J3	12-00-00	9 1/2" NI-40x	1	2
J4	10-00-00	9 1/2" NI-40x	1	4
J5	8-00-00	9 1/2" NI-40x	1	3
J6	6-00-00	9 1/2" NI-40x	1	7
J7	4-00-00	9 1/2" NI-40x	1	3
J8	2-00-00	9 1/2" NI-40x	1	4
B8 H	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B6	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B7 H	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B5	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
6	H1	IUS2.56/9.5
7	H1	IUS2.56/9.5
8	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
1	H3	HGUS410
3	H4	HUS1.81/10

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

RECEIVED
JUN 13 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO

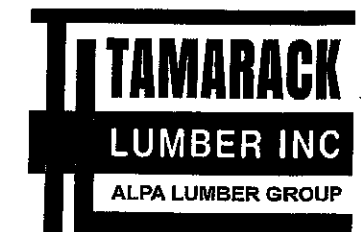

FROM PLAN DATED: SEPT 25 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 3

ELEVATION: 2

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL


REVISION:

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION.
SQUASH BLOCKS OF 2x4, 2x6, 2x8 #2 S.P.F REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING CANT' OVER BRICK REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING DUCT CHASE AND FIELD CUT OPENINGS SEE FIGURE 7, TABLES 1 & 2. **CERAMIC TILE** APPLICATION AS PER O.B.C 9.30.6.

LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft²
SUBFLOOR: 3/4" GLUED AND NAILED

DATE: 11/7/2018

1st FLOOR

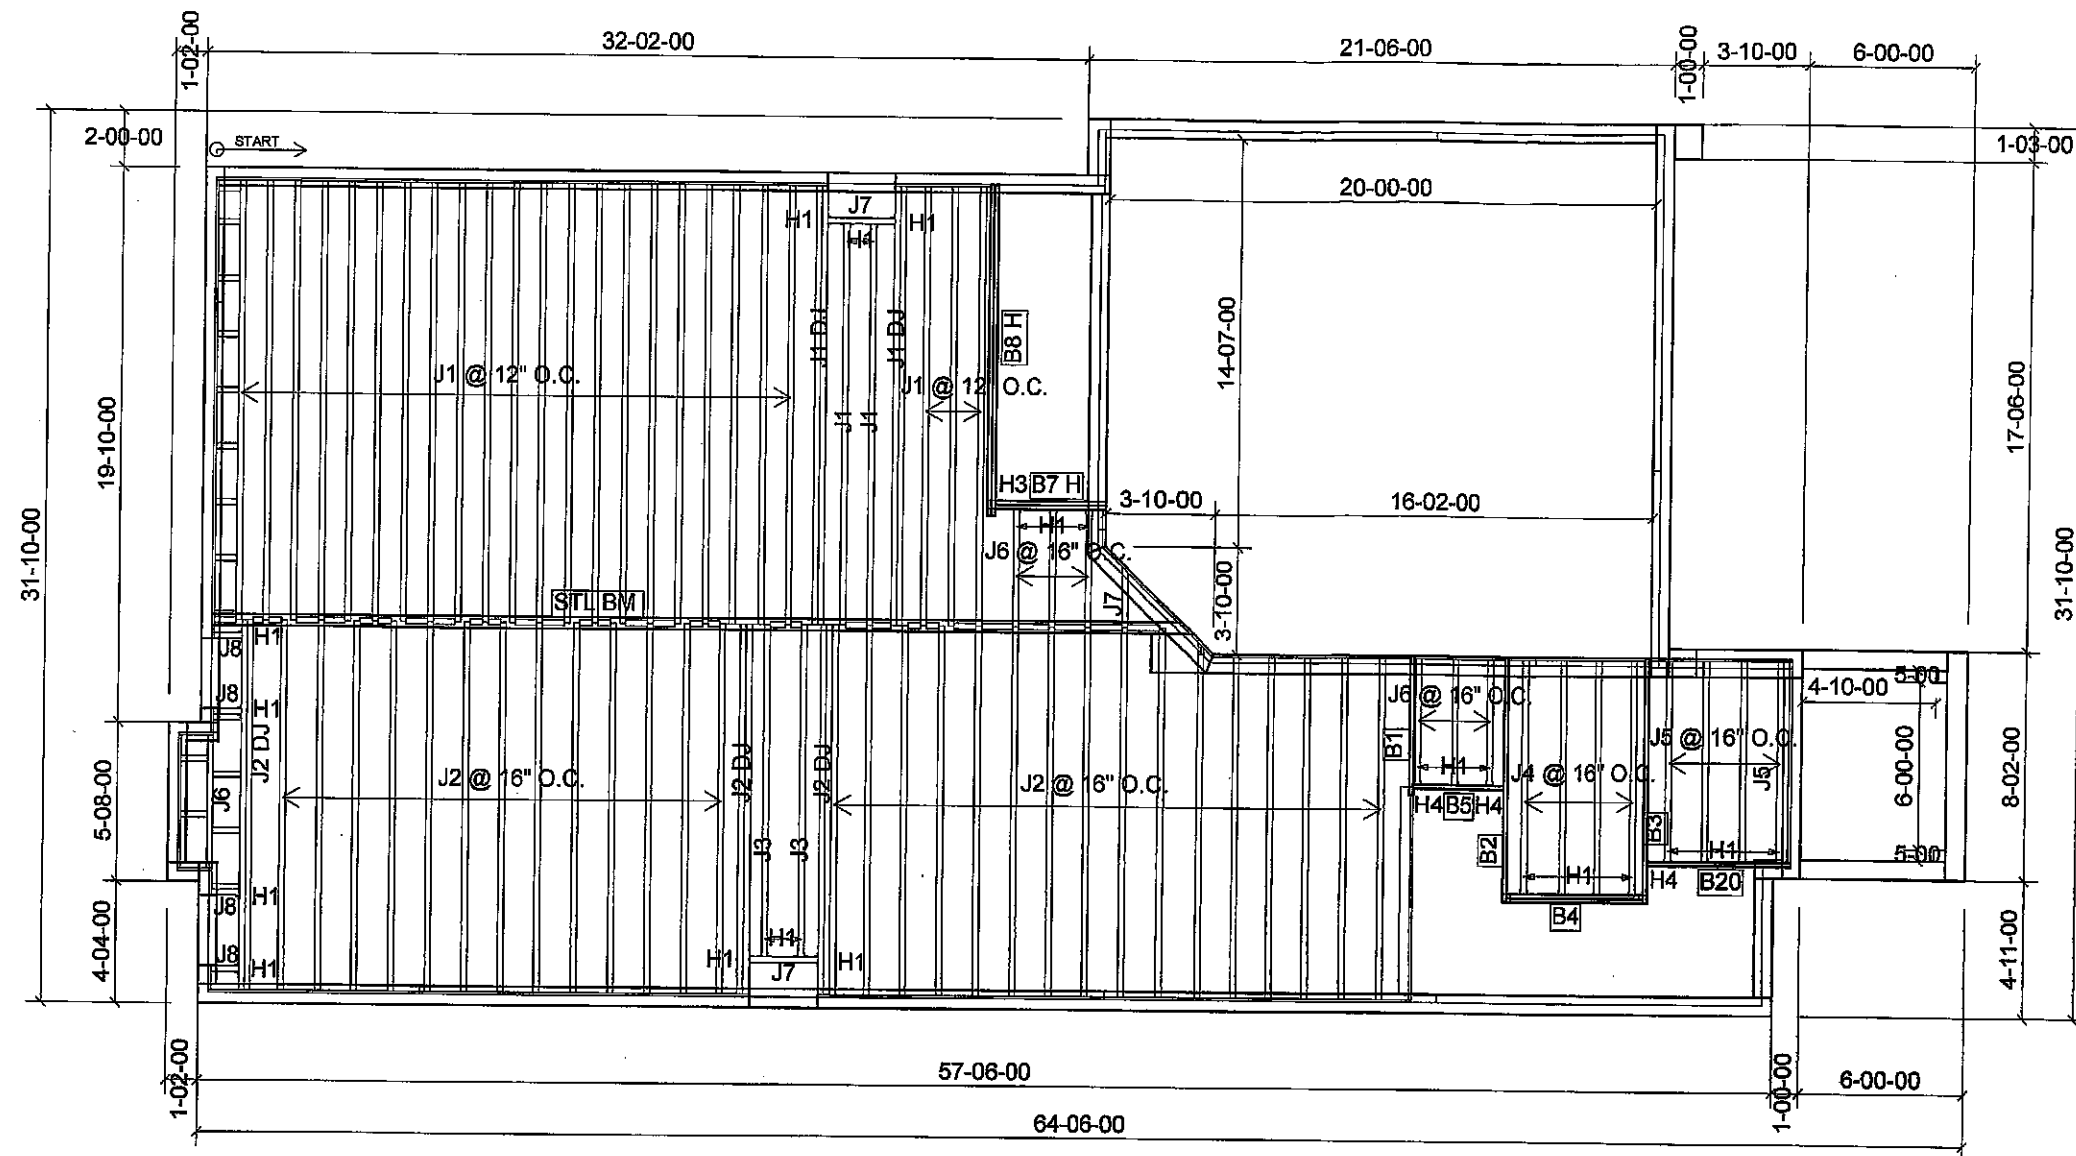


Products				
PlotID	Length	Product	Plies	Net Qty
J1	16-00-00	9 1/2" NI-40x	1	26
J1 DJ	16-00-00	9 1/2" NI-40x	2	4
J2	14-00-00	9 1/2" NI-40x	1	29
J2 DJ	14-00-00	9 1/2" NI-40x	2	6
J3	12-00-00	9 1/2" NI-40x	1	2
J4	10-00-00	9 1/2" NI-40x	1	4
J5	8-00-00	9 1/2" NI-40x	1	4
J6	6-00-00	9 1/2" NI-40x	1	7
J7	4-00-00	9 1/2" NI-40x	1	3
J8	2-00-00	9 1/2" NI-40x	1	4
B8 H	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B2	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B3	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B1	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B20	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B4	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B7 H	6-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B5	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1

Connector Summary		
Qty	Manuf	Product
7	H1	IUS2.56/9.5
7	H1	IUS2.56/9.5
8	H1	IUS2.56/9.5
4	H1	IUS2.56/9.5
1	H3	HGUS410
3	H4	HUS1.81/10

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

RECEIVED
JUN 13 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO.

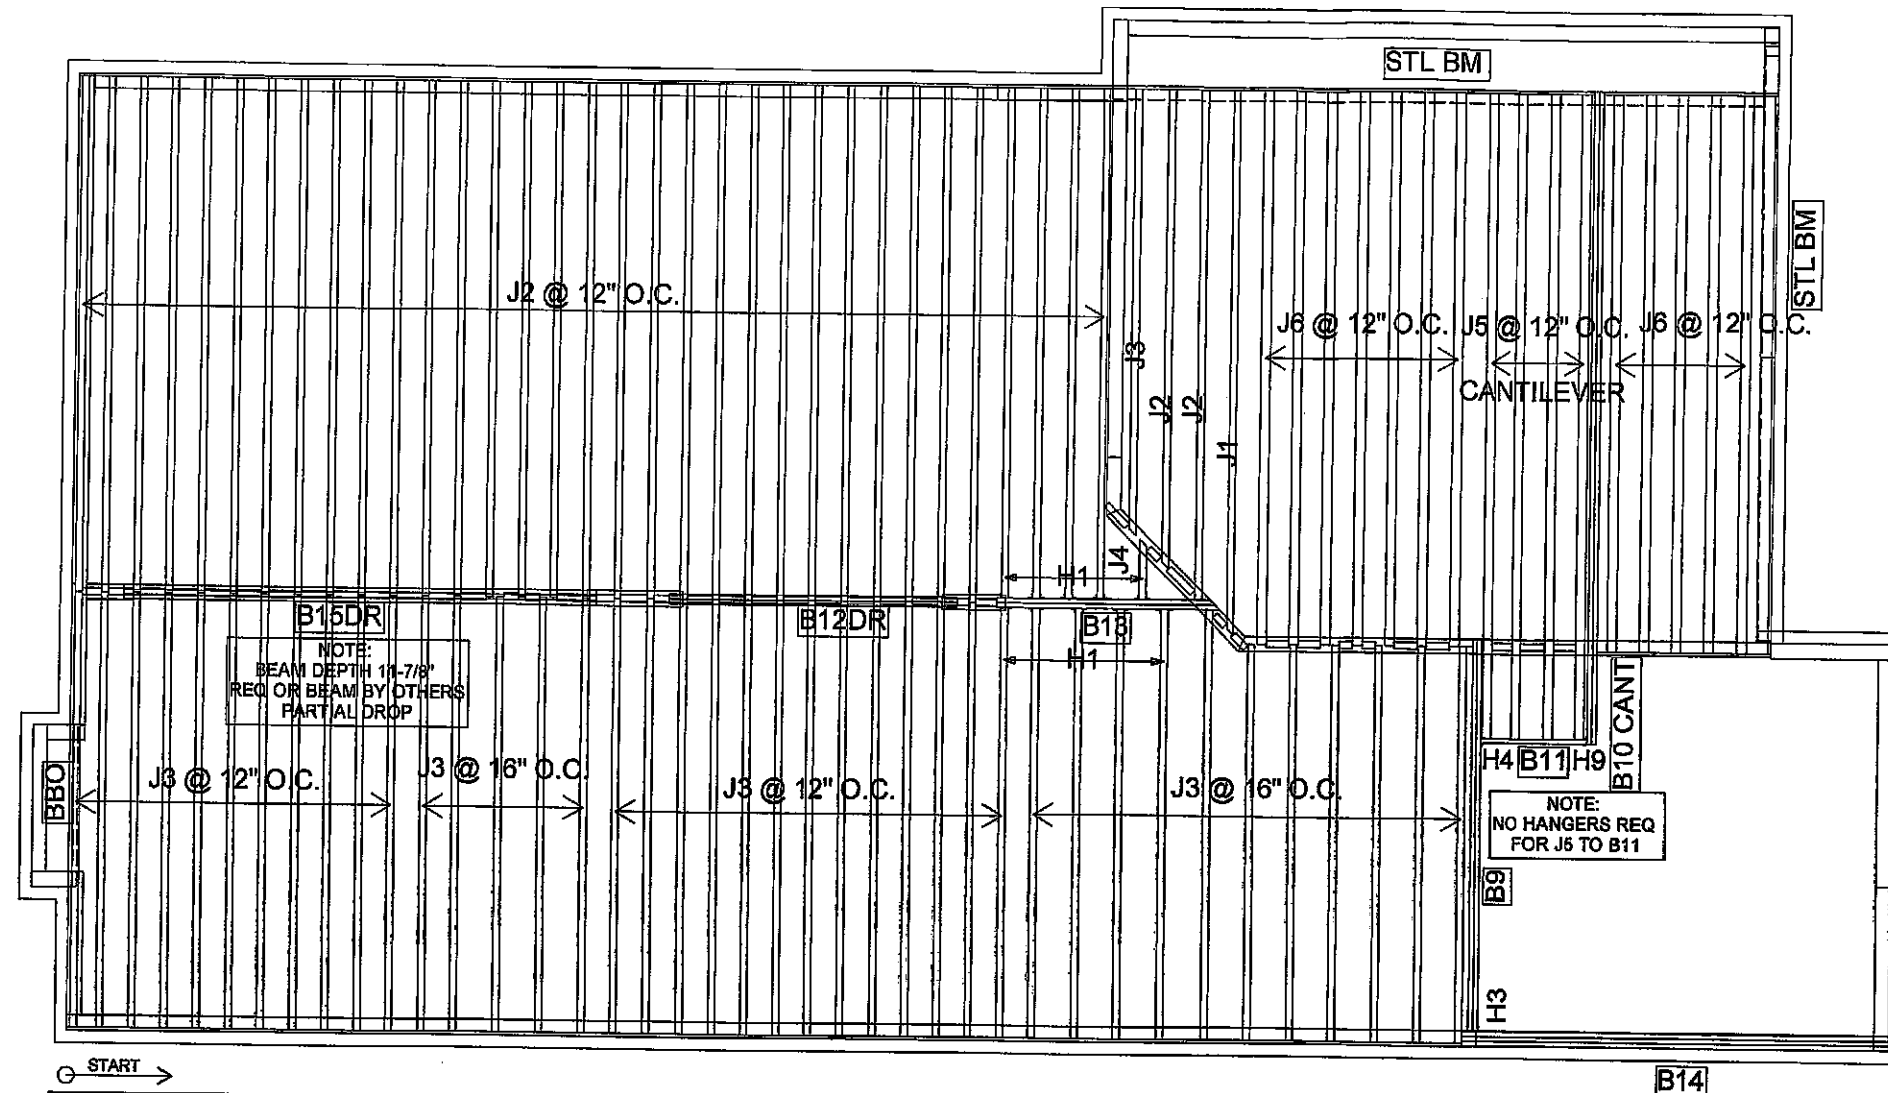

Products					Connector Summary		
PlotID	Length	Product	Plies	Net Qty	Qty	Manuf	Product
J1	18-00-00	9 1/2" NI-40x	1	1	10	H1	IUS2.56/9.5
J2	16-00-00	9 1/2" NI-40x	1	35	1	H3	HGUS410
J3	14-00-00	9 1/2" NI-40x	1	41	1	H4	HUS1.81/10
J4	2-00-00	9 1/2" NI-40x	1	1	1	H9	LS90
J5	20-00-00	9 1/2" NI-80	1	4			
J6	18-00-00	9 1/2" NI-80	1	12			
B10 CANT	20-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B14	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3			
B9	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B12DR	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B13	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B11	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B15DR	16-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	3	3			

RECEIVED
JUN 13 2019
TOWN OF CALEDON
BUILDING SECTION
FILE NO

TAMARACK
LUMBER INC
ALPA LUMBER GROUP

FROM PLAN DATED: SEPT 25 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 3

ELEVATION: 1

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION:

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 15.0 lb/ft²


TILED AREAS: 20 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2019-02-15

2nd FLOOR

OPTIONAL 4 BEDROOM CONDITION

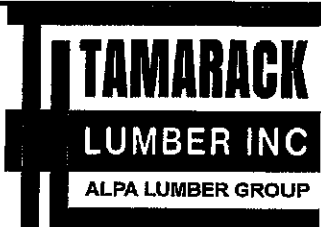

FROM PLAN DATED: SEPT 25 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 3

ELEVATION: 1

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION:

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6


LOADING:
DESIGN LOADS: L/480.000
LIVE LOAD: 40.0 lb/ft²
DEAD LOAD: 15.0 lb/ft²
TILED AREAS: 20 lb/ft

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2019-02-15

2nd FLOOR

OPTIONAL 5 BEDROOM CONDITION

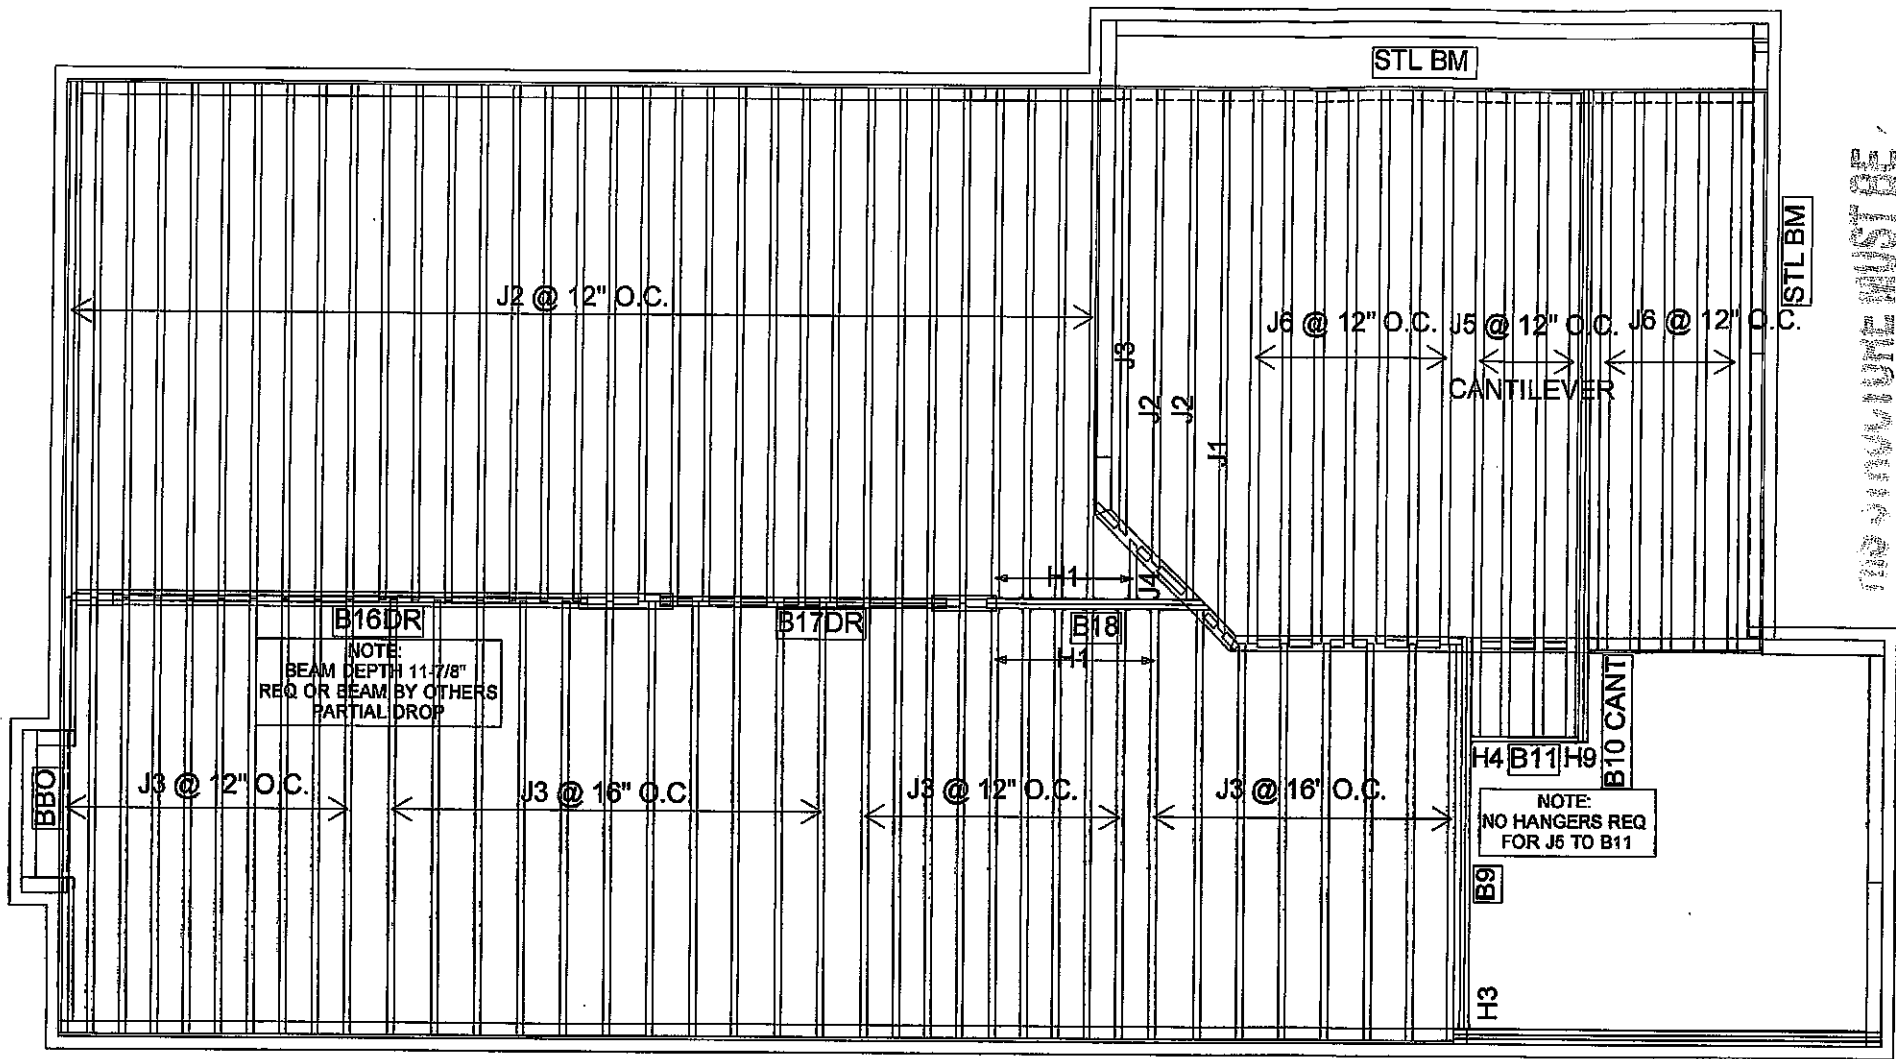

NO JOIST MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE CANADIAN BUILDING CODE

START →

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	9 1/2" NI-40x	1	1
J2	16-00-00	9 1/2" NI-40x	1	35
J3	14-00-00	9 1/2" NI-40x	1	39
J4	2-00-00	9 1/2" NI-40x	1	1
J5	20-00-00	9 1/2" NI-80	1	4
J6	18-00-00	9 1/2" NI-80	1	12
B10 CANT	20-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B14	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B9	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B17DR	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B18	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B11	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B16DR	16-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	3	3

Connector Summary		
Qty	Manuf	Product
11	H1	IUS2.56/9.5
1	H3	HGUS410
1	H4	HUS1.81/10
1	H9	LS90

RECEIVED
JUN 13 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO

FROM PLAN DATED: SEPT 25 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 3

ELEVATION: 2

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION:

NOTES:
REFER TO THE NORDIC INSTALLATION GUIDE FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 15.0 lb/ft²


TILED AREAS: 20 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2019-02-15

2nd FLOOR


OPTIONAL 4 BEDROOM CONDITION

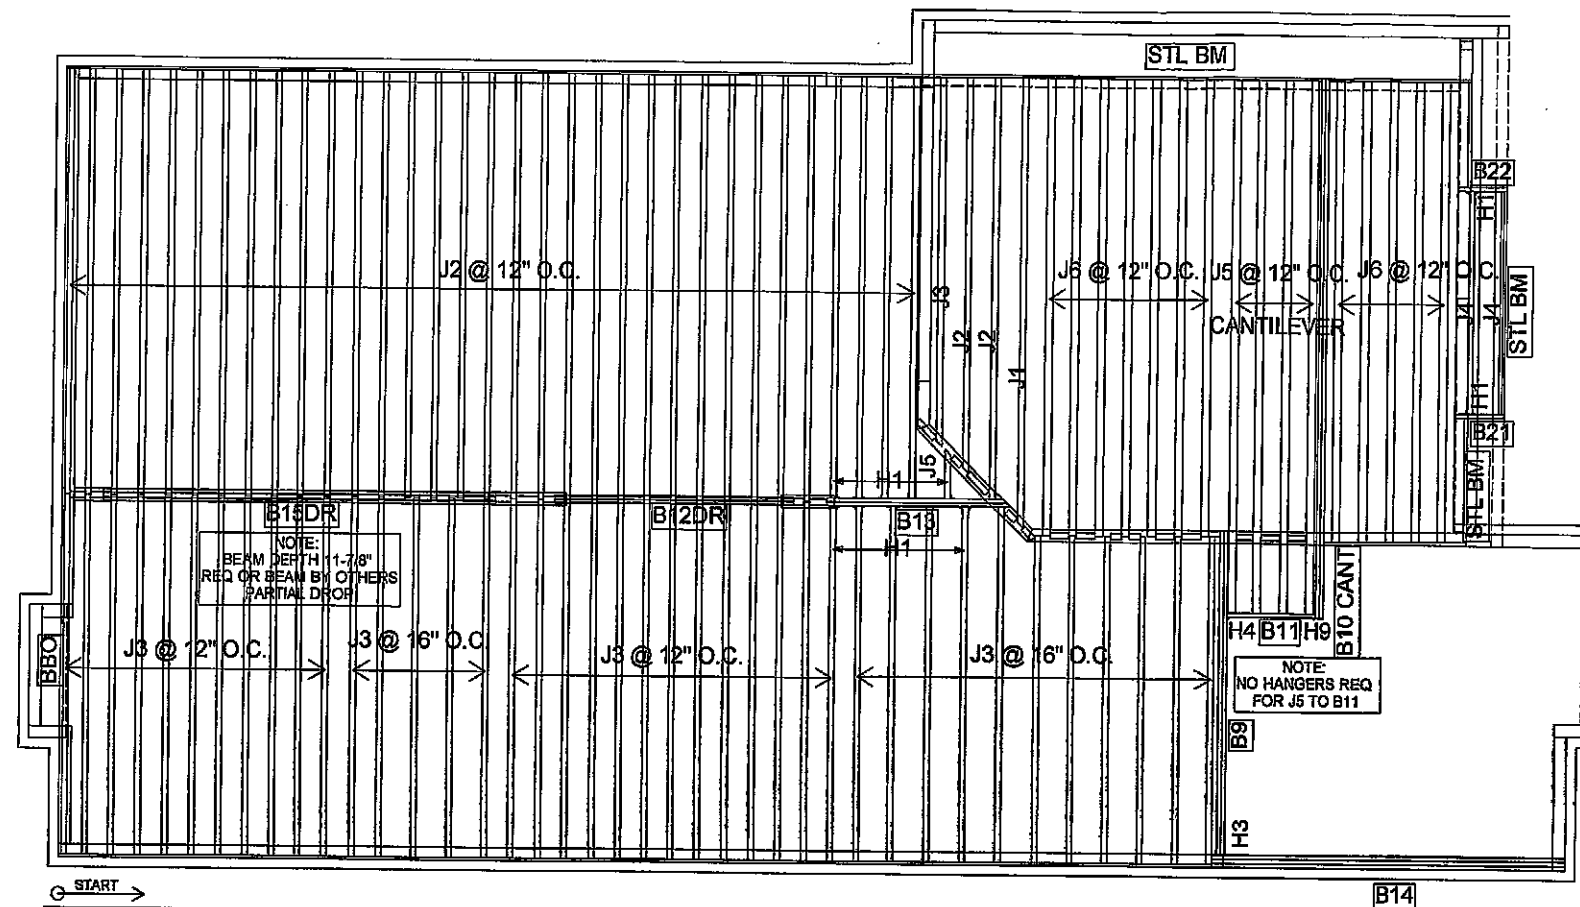

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

Products				
PlotID	Length	Product	Plies	Net Qty
J1	18-00-00	9 1/2" NI-40x	1	1
J2	16-00-00	9 1/2" NI-40x	1	35
J3	14-00-00	9 1/2" NI-40x	1	41
J4	10-00-00	9 1/2" NI-40x	1	2
J5	2-00-00	9 1/2" NI-40x	1	1
J5	20-00-00	9 1/2" NI-80	1	4
J6	18-00-00	9 1/2" NI-80	1	12
B10 CANT	20-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B14	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3
B9	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B12DR	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B13	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2
B11	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B21	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B22	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1
B15DR	16-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	3	3

Connector Summary		
Qty	Manuf	Product
2	H1	IUS2.56/9.5
10	H1	IUS2.56/9.5
1	H3	HGUS410
1	H4	HUS1.81/10
1	H9	LS90

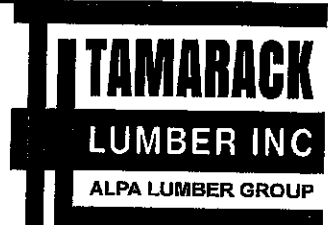

FROM PLAN DATED: SEPT 25 2018

BUILDER: GREENPARK HOMES

SITE: LAMBERTS LANE

MODEL: PRESTON 3

ELEVATION: 2

LOT:

CITY: CALEDON

SALESMAN: M D

DESIGNER: PL

REVISION:

NOTES:
REFER TO THE NORDIC **INSTALLATION GUIDE** FOR PROPER STORAGE AND INSTALLATION. **SQUASH BLOCKS** OF 2x4, 2x6, 2x8 #2 S.P.F. REQ'D UNDER INTERIOR UNIFORM LOAD BEARING WALLS. **MULTIPLE SQUASH BLOCKS** REQ'D UNDER CONCENTRATED LOADS. SEE FIGURE 1. **CANTILEVERED JOISTS** INCLUDING **CANT' OVER BRICK** REQ. I-JOIST BLOCKING ALONG BEARING AND RIMBOARD CLOSURE AT ENDS. SEE FIGURE 7 TABLES 4 & 5 FOR REINFORCEMENT REQUIREMENTS. FOR **HOLES** INCLUDING **DUCT CHASE** AND **FIELD CUT OPENINGS** SEE FIGURE 7 TABLES 1 & 2 OF THE INSTALLATION GUIDE. **CERAMIC TILE** APPLICATION AS PER O.B.C. 9.30.6

LOADING:

DESIGN LOADS: L/480.000

LIVE LOAD: 40.0 lb/ft²

DEAD LOAD: 15.0 lb/ft²


TILED AREAS: 20 lb/ft²

SUBFLOOR: 5/8" GLUED AND NAILED

DATE: 2019-02-15

2nd FLOOR

OPTIONAL 5 BEDROOM CONDITION

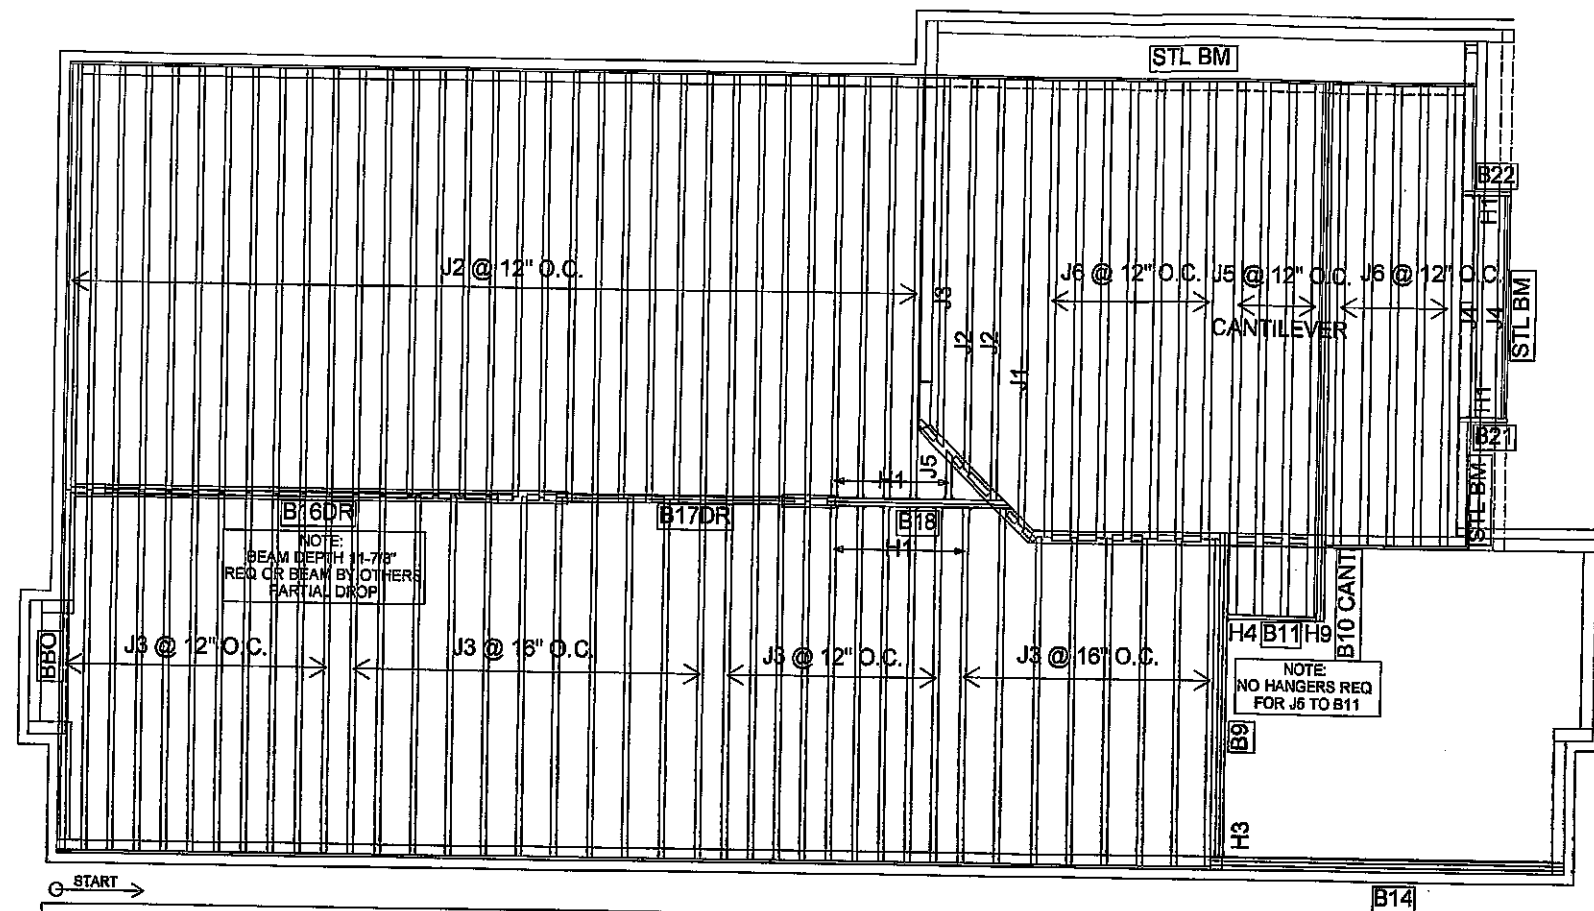

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

Products					Connector Summary		
PlotID	Length	Product	Plies	Net Qty	Qty	Manuf	Product
J1	18-00-00	9 1/2" NI-40x	1	1	2	H1	IUS2.56/9.5
J2	16-00-00	9 1/2" NI-40x	1	35	11	H1	IUS2.56/9.5
J3	14-00-00	9 1/2" NI-40x	1	40	1	H3	HGUS410
J4	10-00-00	9 1/2" NI-40x	1	2	1	H4	HUS1.81/10
J5	2-00-00	9 1/2" NI-40x	1	1	1	H9	LS90
J5	20-00-00	9 1/2" NI-80	1	4			
J6	18-00-00	9 1/2" NI-80	1	12			
B10 CANT	20-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B14	14-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	3	3			
B9	12-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B17DR	10-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B18	8-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	2	2			
B11	4-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B21	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B22	2-00-00	1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP	1	1			
B16DR	16-00-00	1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP	3	3			



Refer to the Installation Guide for Residential Floors for additional information.
CCMC EVALUATION REPORT 13032-R

WEB HOLE SPECIFICATIONS

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centreline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- I-joist top and bottom flanges must NEVER be cut, notched, or otherwise modified.
- Whenever possible, field-cut holes should be centred on the middle of the web.
- The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.

- The sides of square holes or longest sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the largest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
- A knockout is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
- Holes measuring 1-1/2 inches or smaller are permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.


- A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
- All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
- Limit three maximum size holes per span, of which one may be a duct chase opening.
- A group of round holes at approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

TABLE 1
LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 15 psf and Live Loads up to 40 psf

Joist Depth	Joist Series	Minimum Distance from Inside Face of Any Support to Centre of Hole (ft - in.)											
		Round Hole Diameter (in.)											
		2	3	4	5	6	6-1/4	7	8	8-5/8	9	10	10-3/4
9-1/2"	NI-20	0-7"	1-6"	2-10"	4-3"	5-8"	6-0"	---	---	---	---	---	---
	NI-40x	0-7"	1-6"	3-0"	4-4"	6-0"	6-4"	---	---	---	---	---	---
	NI-60	1-3"	2-6"	4-0"	5-4"	7-0"	7-5"	---	---	---	---	---	---
	NI-70	2-0"	3-4"	4-9"	6-3"	8-0"	8-4"	---	---	---	---	---	---
11-7/8"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---
	NI-40x	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---
	NI-60	0-7"	1-8"	3-0"	4-3"	5-9"	6-0"	7-3"	8-10"	10-0"	---	---	---
	NI-70	1-5"	2-0"	4-0"	5-4"	6-9"	7-2"	8-4"	10-0"	11-2"	---	---	---
14"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---
	NI-40x	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---
	NI-60	0-7"	1-8"	3-0"	4-3"	5-9"	6-0"	7-3"	8-10"	10-0"	---	---	---
	NI-70	1-5"	2-0"	4-0"	5-4"	6-9"	7-2"	8-4"	10-0"	11-2"	---	---	---
16"	NI-20	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---
	NI-40x	0-7"	0-8"	1-0"	2-4"	3-8"	4-0"	5-0"	6-6"	7-9"	---	---	---
	NI-60	0-7"	1-8"	3-0"	4-3"	5-9"	6-0"	7-3"	8-10"	10-0"	---	---	---
	NI-70	1-5"	2-0"	4-0"	5-4"	6-9"	7-2"	8-4"	10-0"	11-2"	---	---	---


- Above table may be used for I-joist spacing of 24 inches on centre or less.
- Hole location distance is measured from inside face of supports to centre of hole.
- Distances in this chart are based on uniformly loaded joists.
- The above table is based on the I-joists being used of their maximum spans. The minimum distance as given above may be reduced for shorter spans; contact your local distributor.

FIGURE 7
FIELD-CUT HOLE LOCATOR

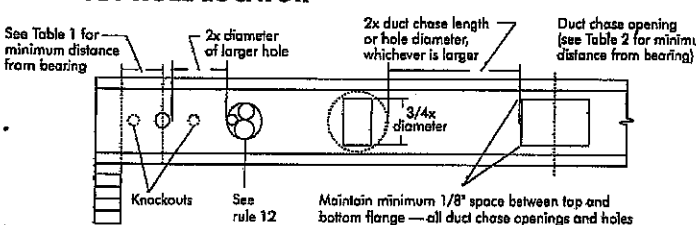

SAFETY AND CONSTRUCTION PRECAUTIONS

- WARNING:** I-joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.
- AVOID ACCIDENTS BY FOLLOWING THESE IMPORTANT GUIDELINES:**
- Brace and nail each I-joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bridging at joist ends. When I-joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
 - When the building is completed, the floor sheathing will provide lateral support for the top flanges of the I-joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary sheathing must be applied to prevent I-joist rollover or buckling.
 - Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on centre, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each I-joist. Nail the bracing to a lateral restraint at the end of each bay. Lap ends of adjoining bracing over at least two I-joists.
 - Or, sheathing (temporary or permanent) can be nailed to the top flange at the first 4 feet of I-joists at the end of the bay.
 - For cantilevered I-joists, brace top and bottom flanges, and brace ends with closure panels, rim board, or cross-bridging.
 - Install and fully nail permanent sheathing to each I-joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
 - Never install a damaged I-joist.
- Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic I-joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.



Knockouts are pre-scored holes provided for the contractor's convenience to install electrical or small plumbing lines. They are 1-1/2 inches in diameter, and are spaced 15 inches on centre along the length of the I-joist. Where possible, it is preferable to use knockouts instead of field-cut holes.

Never drill, cut or notch the flange, or over-cut the web.

Holes in webs should be cut with a sharp saw.




For rectangular holes, avoid over-cutting the corners, as this can cause unnecessary stress concentrations. Slightly rounding the corners is recommended. Starting the rectangular hole by drilling a 1-inch diameter hole in each of the four corners and then making the cuts between the holes is another good method to minimize damage to the I-joist.



PRODUCT WARRANTY

Chantiers Chibougamau guarantees that, in accordance with our specifications, Nordic products are free from manufacturing defects in material and workmanship.


Furthermore, Chantiers Chibougamau warrants that our products, when utilized in accordance with our handling and installation instructions, will meet or exceed our specifications for the lifetime of the structure.

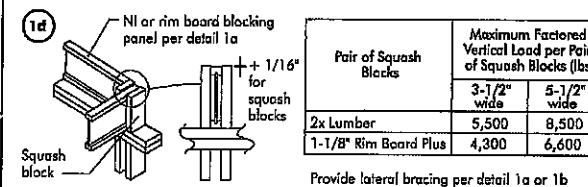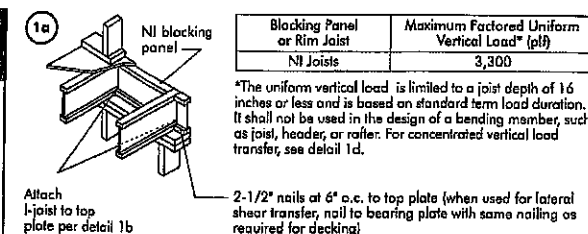


BACKER BLOCKS (Blocks must be long enough to permit required nailing without splitting)

Flange Width	Material Thickness Required*	Minimum Depth**
2-1/2"	1"	5-1/2"
3-1/2"	1-1/2"	7-1/4"





* Minimum grade for backer block material shall be S-PF No. 2 or better for solid sawn lumber and wood structural panels conforming to CAN/CSA-C325 or CAN/CSA-O437 Standard.
** For face-mount hangers use net joist depth minus 3-1/4" for joists with 1-1/2" thick flanges. For 2" thick flanges use net depth minus 4-1/4".

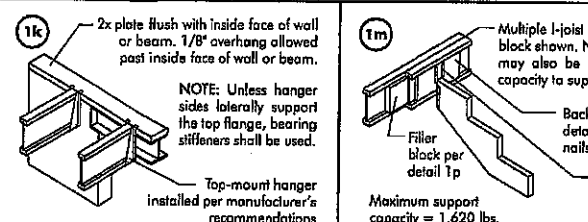


FILLER BLOCK REQUIREMENTS FOR DOUBLE I-JOIST CONSTRUCTION

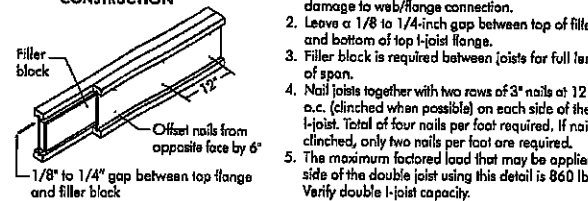

- NOTES:**
- Support back of I-joist web during nailing to prevent damage to web/flange connection.
 - Leave a 1/8 to 1/4-inch gap between top of filler block and bottom of top I-joist flange.
 - Filler block is required between joists for full length of span.
 - Nail joists together with two rows of 3" nails at 12 inches o.c. (clinched when possible) on each side of the double I-joist. Total of four nails per foot required. If nails can be clinched, only two nails per foot are required.
 - The maximum factored load that may be applied to one side of the double joist using this detail is 860 lbs/ft. Verify double I-joist capacity.

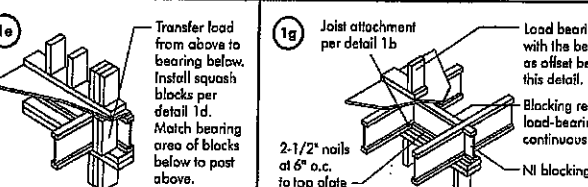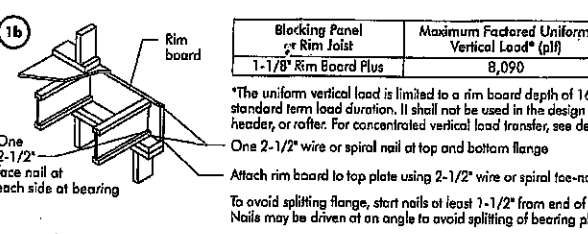

NOTE: Unless hanger sides laterally support the top flange, bearing stiffeners shall be used.

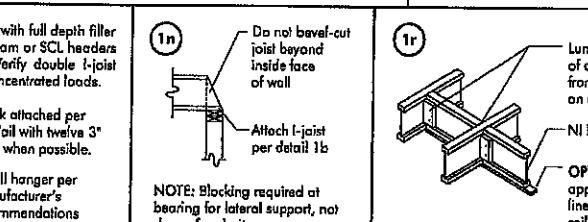

DO NOT BEVEL-CUT JOIST BEYOND INSIDE FACE OF WALL



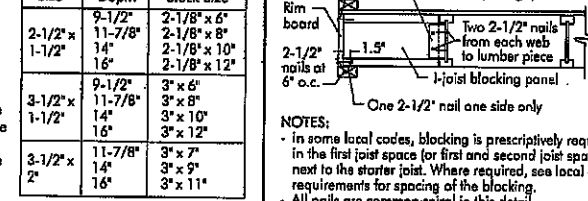



FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

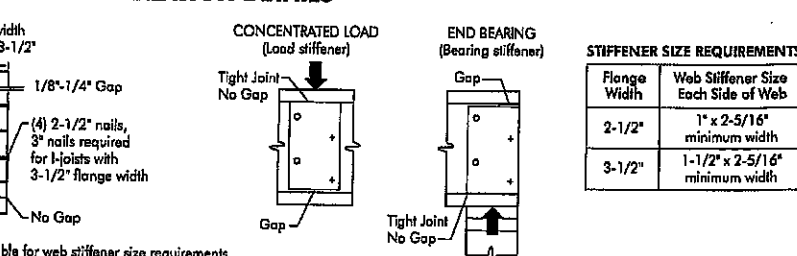

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET

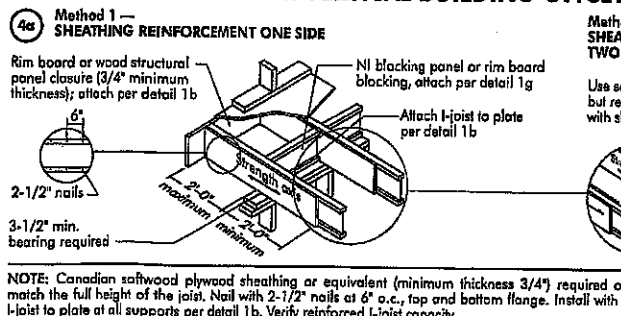


RIM BOARD INSTALLATION DETAILS

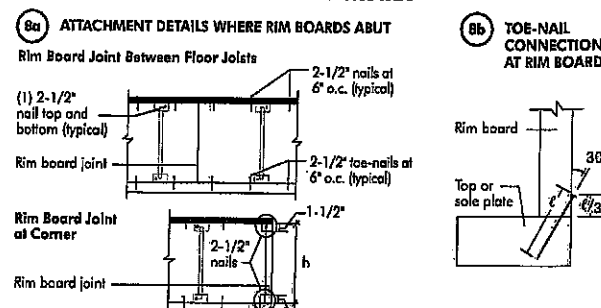



INSTALLATION GUIDE FOR RESIDENTIAL FLOORS

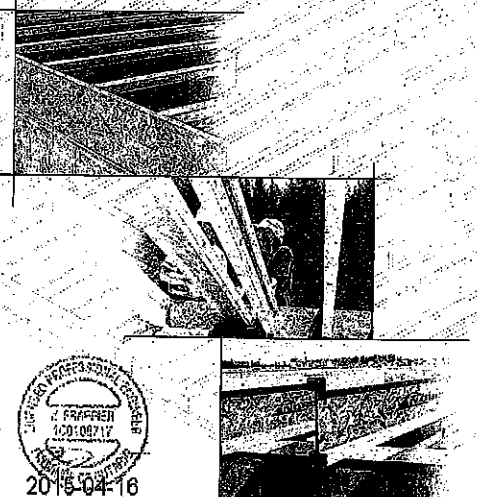

Distributed by:



SAFETY AND CONSTRUCTION PRECAUTIONS



Do not walk on joists until fully fastened and braced, or serious injuries can result.



Never stack building materials over unsupported joists. Once sheathed, do not over-stress joist with concentrated loads from building materials.

WARNING

Joists are not stable until completely installed, and will not carry any load until fully braced and sheathed.

Avoid Accidents by Following these Important Guidelines:

1. Brace and nail each joist as it is installed, using hangers, blocking panels, rim board, and/or cross-bracing of joist ends. When joists are applied continuous over interior supports and a load-bearing wall is planned at that location, blocking will be required at the interior support.
2. When the building is completed, the floor sheathing will provide lateral support for the top flanges of the joists. Until this sheathing is applied, temporary bracing, often called struts, or temporary shoring must be applied to prevent joist rollover or buckling.
3. Temporary bracing or struts must be 1x4 inch minimum, at least 8 feet long and spaced no more than 8 feet on center, and must be secured with a minimum of two 2-1/2" nails fastened to the top surface of each joist. Nail the bracing to a lateral restraint at the end of each bay. Top ends of adjoining bracing over at least two joists.
4. Or, sheathing (temporary or permanent) can be nailed to the top flange of the first 4 feet of joists at the end of the bay.
5. For cantilevered joists, brace top and bottom flanges, and brace ends with cleave panels, rim board, or cross-bracing.
6. Install and fully nail permanent sheathing to each joist before placing loads on the floor system. Then, stack building materials over beams or walls only.
7. Never install a damaged joist.

Improper storage or installation, failure to follow applicable building codes, failure to follow span ratings for Nordic joists, failure to follow allowable hole sizes and locations, or failure to use web stiffeners when required can result in serious accidents. Follow these installation guidelines carefully.

STORAGE AND HANDLING GUIDELINES

1. Bundle wrap can be slippery when wet. Avoid walking on wrapped bundles.
2. Store, stack, and handle joists vertically and level only.
3. Always stack and handle joists in the upright position only.
4. Do not store joists in direct contact with the ground and/or flatwires.
5. Protect joists from weather, and use spacers to separate bundles.
6. Bundled units should be kept intact until time of installation.
7. When handling joists with a crane on the job site, take a few simple precautions to prevent damage to the joists and injury to your work crew.
8. Pick joists in bundles as shipped by the supplier.
9. Orient the bundles so that the webs of the joists are vertical.
10. Pick the bundles at the 5th points, using a spreader bar if necessary.
11. Do not handle joists in a horizontal orientation.
12. NEVER USE OR TRY TO REPAIR A DAMAGED JOIST.



MAXIMUM FLOOR SPANS

1. Maximum clear spans applicable to single-span or multiple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit spans are based on the factored loads of 1.50L + 1.25D. The serviceability limit spans include the consideration for floor vibration and a live load deflection limit of L/480. For multiple-span applications, the end spans shall be 40% or more of the adjacent span.
2. Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for joist spacing of 19.2 inches or less, or 3/4 inch for joist spacing of 24 inches. Adhesive shall meet the requirements given in CCBC 71-26 Standard. No concrete topping or bridging element was assumed. Increased spans may be achieved with the use of gypsum and/or a row of blocking at mid-span.
3. Minimum bearing length shall be 1-3/4 inches for the end bearings, and 3-1/2 inches for the intermediate bearings.
4. Bearing stiffeners are not required when joists are used with the spans and spacings given in this table, except as required for hangers.
5. This span chart is based on uniform loads. For applications with other than uniform loads, an engineering analysis may be required based on the use of the design properties.
6. Tables are based on Limit States Design per CAN/CSA C08-09 Standard, and NBC 2010.
7. SI units conversion: 1 inch = 25.4 mm, 1 foot = 0.305 m


MAXIMUM FLOOR SPANS FOR NORDIC JOISTS SIMPLE AND MULTIPLE SPANS

Joist Depth	Joist Series	Simple Span On center spacing				Multiple Spans On center spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NL-20	13'1"	14'2"	13'9"	13'5"	16'3"	15'4"	14'10"	14'7"
	NL-40	14'1"	15'2"	14'8"	14'4"	17'5"	16'5"	15'10"	15'5"
	NL-60	15'1"	16'2"	15'8"	15'4"	18'7"	17'7"	16'2"	15'7"
	NL-80	16'1"	17'2"	16'8"	16'4"	19'9"	18'9"	17'4"	16'10"
	NL-100	17'1"	18'2"	17'8"	17'4"	21'1"	20'1"	18'6"	17'2"
11-7/8"	NL-20	16'1"	17'2"	16'8"	16'4"	18'4"	17'5"	16'2"	15'7"
	NL-40	17'1"	18'2"	17'8"	17'4"	19'5"	18'5"	17'0"	16'5"
	NL-60	18'1"	19'2"	18'8"	18'4"	20'7"	19'7"	18'2"	17'7"
	NL-80	19'1"	20'2"	19'8"	19'4"	21'9"	20'9"	19'4"	18'9"
	NL-100	20'1"	21'2"	20'8"	20'4"	22'11"	21'11"	20'6"	19'11"
14"	NL-20	18'1"	19'2"	18'8"	18'4"	20'9"	19'9"	18'4"	17'9"
	NL-40	19'1"	20'2"	19'8"	19'4"	21'11"	20'11"	19'6"	18'11"
	NL-60	20'1"	21'2"	20'8"	20'4"	22'3"	21'3"	20'0"	19'5"
	NL-80	21'1"	22'2"	21'8"	21'4"	23'5"	22'5"	21'0"	20'5"
	NL-100	22'1"	23'2"	22'8"	22'4"	24'7"	23'7"	22'2"	21'7"
16"	NL-20	20'1"	21'2"	20'8"	20'4"	22'9"	21'9"	20'4"	19'9"
	NL-40	21'1"	22'2"	21'8"	21'4"	23'11"	22'11"	21'6"	21'1"
	NL-60	22'1"	23'2"	22'8"	22'4"	24'3"	23'3"	22'0"	21'5"
	NL-80	23'1"	24'2"	23'8"	23'4"	25'5"	24'5"	23'0"	22'5"
	NL-100	24'1"	25'2"	24'8"	24'4"	26'7"	25'7"	24'2"	23'7"

CCBC EVALUATION REPORT 13037-2

I-JOIST HANGERS

1. Hangers shown illustrate the three most commonly used metal hangers to support joists.
2. All nailing must meet the hanger manufacturer's recommendations.
3. Hangers should be selected based on the joist depth, flange width and load capacity based on the maximum spans.
4. Web stiffeners are required when the sides of the hangers do not laterally brace the top flange of the joist.




WEB STIFFENERS

RECOMMENDATIONS:

- A bearing stiffener is required in all engineered applications with factored reactions greater than shown in the joist proprietary table found in the Joist Construction Guide (C101). The gap between the stiffener and the flange is at the top.
- A bearing stiffener is required when the I-joist is supported in a hanger and the sides of the hanger do not extend up to, and support, the top flange. The gap between the stiffener and flange is at the top.
- A load stiffener is required at locations where a factored concentrated load greater than 2,370 lbs is applied to the top flange between supports, or in the case of a cantilever, anywhere between the cantilever tip and the support. These values are for standard term load duration, and may be adjusted for other load durations as permitted by the code. The gap between the stiffener and the flange is at the bottom.

SI units conversion: 1 inch = 25.4 mm

FIGURE 2
WEB STIFFENER INSTALLATION DETAILS

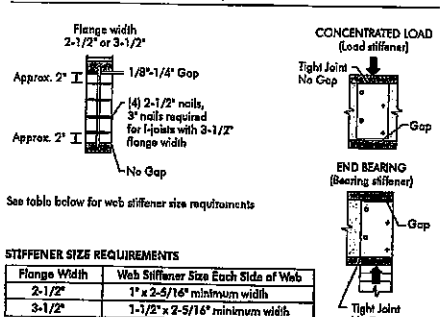


See table below for web stiffener size requirements

STIFFENER SIZE REQUIREMENTS

Flange Width	Web Stiffener Size Each Side of Web
2-1/2"	1" x 2-3/16" minimum width
3-1/2"	1-1/2" x 2-5/16" minimum width


INSTALLING NORDIC I-JOISTS

1. Before laying out floor system components, verify that I-joist flange widths match hanger widths. If not, modify hanger widths.
2. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.
3. Install joists so that top and bottom flanges are within 1/2 inch of true vertical alignment.
4. Joists must be anchored securely to supports before floor sheathing is attached, and supports for multiple spans must be level.
5. Minimum bearing lengths: 1-3/4 inches for end bearings and 3-1/2 inches for intermediate bearings.
6. When using hangers, seat joists firmly in hanger bottoms to minimize settlement.
7. Leave a 1/16-inch gap between the joist end and a header.
8. Concentrated loads greater than those that can normally be expected in residential construction should only be applied to the top surface of the top flange. Normal concentrated loads include track lighting fixtures, audio equipment and security cameras. Never suspend unusual or heavy loads from the joist's bottom flange. Whenever possible, suspend all concentrated loads from the top of the joist. Or, attach the load to blocking that has been securely fastened to the joist webs.
9. Never install joists where they will be permanently exposed to weather, or where they will remain in direct contact with concrete or masonry.
10. Restrain ends of floor joists to prevent rollover. Use rim board, rim joist or I-joist blocking panels.
11. For I-joists installed over and beneath bearing walls, use full depth blocking panels, rim board, or squish blocks (cripple members) to transfer gravity loads through the floor system to the wall or foundation below.
12. Due to shrinkage, common framing lumber set on edge may never be used as blocking or rim boards. I-joist blocking panels or other engineered wood products - such as rim board - must be cut to fit between the joists, and on I-joist-composite depth selected.
13. Provide permanent lateral support of the bottom flange of all I-joists at interior supports of multiple-span joists. Similarly, support the bottom flange of all cantilevered joists at the end support and to the cantilever extension. In the completed structure, the gypsum wallboard ceiling provides this lateral support. Until the final finished ceiling is applied, temporary bracing or struts must be used.
14. If square-edge panels are used, edges must be supported between joists with 2x4 blocking. Give panels to blocking to minimize squeaks. Blocking is not required under structural finish flooring, such as wood strip flooring, or if a separate underlayment layer is installed.
15. Nail spacing: Space nails installed to the flange's top face in accordance with the applicable building code requirements or approved building plans.



Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
NL Joists	3,300


*The uniform vertical load is limited to a joist depth of 14 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.




Blocking Panel or Rim Joist	Maximum Factored Uniform Vertical Load* (plf)
1-1/8" Rim Board Plus	8,000

*The uniform vertical load is limited to a rim board depth of 14 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.

FIGURE 1
TYPICAL NORDIC I-JOIST FLOOR FRAMING AND CONSTRUCTION DETAILS

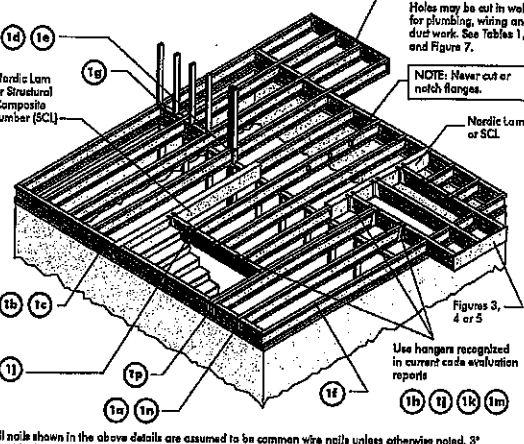


All nails shown in the above details are assumed to be common wire nails unless otherwise noted. 3" (0.125" dia.) common spiral nails may be substituted for 2-1/2" (0.125" dia.) common wire nails. Framing lumber assumed to be Spruce-Pine-Fir No. 2 or better. Individual components not shown to scale for clarity.



























Pair of Squash Blocks	Maximum Factored Uniform Vertical Load* (plf)
3-1/2" wide	5,500
5-1/2" wide	8,500

*The uniform vertical load is limited to a blocking depth of 14 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.




Pair of Squash Blocks	Maximum Factored Uniform Vertical Load* (plf)
1-1/8" Rim Board Plus	4,300
5-1/2" wide	6,400

*The uniform vertical load is limited to a blocking depth of 14 inches or less and is based on standard term load duration. It shall not be used in the design of a bending member, such as joist, header, or rafter. For concentrated vertical load transfer, see detail 1d.




CANTILEVER DETAILS FOR BALCONIES (NO WALL LOAD)

3a I-JOIST CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

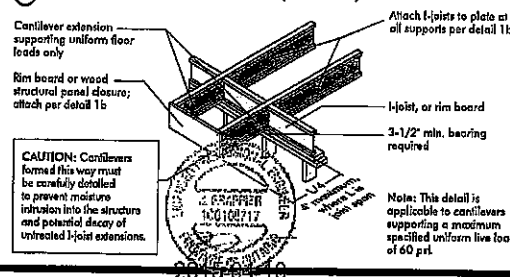

CAUTION: Cantilevers formed this way must be carefully detailed to prevent moisture intrusion into the structure and potential decay of untreated I-joist extensions.


3b LUMBER CANTILEVER DETAIL FOR BALCONIES (No Wall Load)

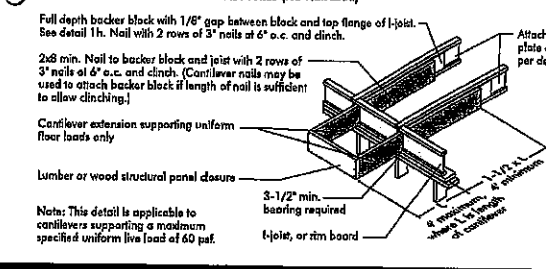

Note: This detail is applicable to cantilevers supporting a maximum specified uniform live load of 60 psf.

CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

4a Method 1 — SHEATHING REINFORCEMENT ONE SIDE

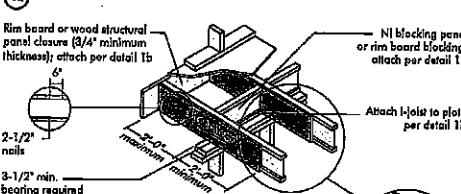


Method 2 — SHEATHING REINFORCEMENT TWO SIDES

- Use same installation as Method 1 but reinforce both sides of I-joist with sheathing.
- Use nailing pattern shown for Method 1 with opposite face nailing offset by 3\".

Note: Canadian softwood plywood sheathing or equivalent (minimum thickness 3/4\".

FIGURE 4 (continued)



For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.


CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft.)	ROOF LOADING (UNFACTORED)			
		U = 30 psf, DL = 15 psf	U = 40 psf, DL = 15 psf	U = 50 psf, DL = 15 psf	U = 60 psf, DL = 15 psf
9-1/2"	26	N	N	N	N
	28	N	N	N	N
	30	N	N	N	N
	32	N	N	N	N
11-7/8"	26	N	N	N	N
	28	N	N	N	N
	30	N	N	N	N
	32	N	N	N	N
14"	26	N	N	N	N
	28	N	N	N	N
	30	N	N	N	N
	32	N	N	N	N
16"	26	N	N	N	N
	28	N	N	N	N
	30	N	N	N	N
	32	N	N	N	N


- N = No reinforcement required.
- N = Not indicated with 3/4\".
- For larger openings, or multiple 3\".
- For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam.
- Cantilevered joists supporting girder trusses or roof beams may require additional reinforcement.

BRICK CANTILEVER DETAILS FOR VERTICAL BUILDING OFFSET (CONCENTRATED WALL LOAD)

5a SHEATHING REINFORCEMENT

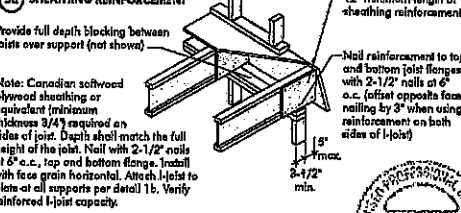

5b SET-BACK DETAIL

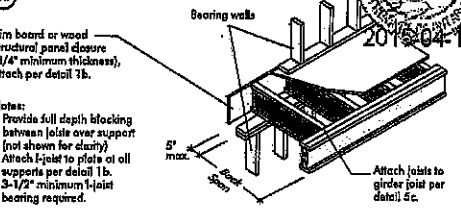

5c SET-BACK CONNECTION

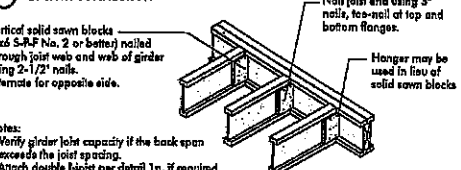


FIGURE 5 (continued)



For hip roofs with the jack trusses running parallel to the cantilevered floor joists, the I-joist reinforcement requirements for a span of 26 ft. shall be permitted to be used.

BRICK CANTILEVER REINFORCEMENT METHODS ALLOWED

JOIST DEPTH (in.)	ROOF TRUSS SPAN (ft.)	ROOF LOADING (UNFACTORED)			
		U = 30 psf, DL = 15 psf	U = 40 psf, DL = 15 psf	U = 50 psf, DL = 15 psf	U = 60 psf, DL = 15 psf
9-1/2"	26	N	N	N	N
	28	N	N	N	N
	30	N	N	N	N
	32	N	N	N	N
11-7/8"	26	N	N	N	N
	28	N	N	N	N
	30	N	N	N	N
	32	N	N	N	N
14"	26	N	N	N	N
	28	N	N	N	N
	30	N	N	N	N
	32	N	N	N	N
16"	26	N	N	N	N
	28	N	N	N	N
	30	N	N	N	N
	32	N	N	N	N


- N = No reinforcement required.
- N = Not indicated with 3/4\".
- For larger openings, or multiple 3\".
- For conventional roof construction using a ridge beam, the Roof Truss Span column above is equivalent to the distance between the supporting wall and the ridge beam.
- Cantilevered joists supporting girder trusses or roof beams may require additional reinforcement.

WEB HOLES

RULES FOR CUTTING HOLES AND DUCT CHASE OPENINGS:

- The distance between the inside edge of the support and the centerline of any hole or duct chase opening shall be in compliance with the requirements of Table 1 or 2, respectively.
- I-joist top and bottom flanges must NEVER be cut, notched, or otherwise modified. Whenever possible, field-cut holes should be centered on the middle of the web.
- The maximum size hole or the maximum depth of a duct chase opening that can be cut into an I-joist web shall equal the clear distance between the flanges of the I-joist minus 1/4 inch. A minimum of 1/8 inch should always be maintained between the top or bottom of the hole or opening and the adjacent I-joist flange.
- The sides of square holes or longer sides of rectangular holes should not exceed 3/4 of the diameter of the maximum round hole permitted at that location.
- Where more than one hole is necessary, the distance between adjacent hole edges shall exceed twice the diameter of the largest round hole or twice the size of the largest square hole (or twice the length of the longest side of the largest rectangular hole or duct chase opening) and each hole and duct chase opening shall be sized and located in compliance with the requirements of Tables 1 and 2, respectively.
- A knockout is not considered a hole, may be utilized anywhere it occurs, and may be ignored for purposes of calculating minimum distances between holes and/or duct chase openings.
- Holes measuring 1-1/2 inches or smaller shall be permitted anywhere in a cantilevered section of a joist. Holes of greater size may be permitted subject to verification.
- A 1-1/2 inch hole or smaller can be placed anywhere in the web provided that it meets the requirements of rule number 6 above.
- All holes and duct chase openings shall be cut in a workman-like manner in accordance with the restrictions listed above and as illustrated in Figure 7.
- Limit three maximum size holes per span, of which one may be a duct chase opening.
- A group of round holes of approximately the same location shall be permitted if they meet the requirements for a single round hole circumscribed around them.

FIGURE 7 FIELD-CUT HOLE LOCATOR

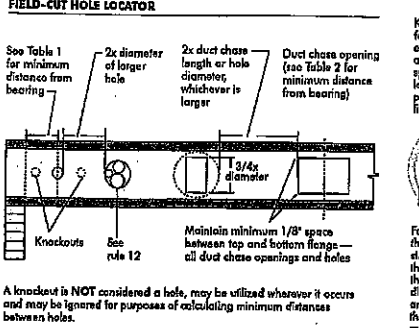

A knockout is NOT considered a hole, may be utilized wherever it occurs and may be ignored for purposes of calculating minimum distances between holes.

TABLE 1 LOCATION OF CIRCULAR HOLES IN JOIST WEBS
Simple or Multiple Span for Dead Loads up to 18 psf and Live Loads up to 40 psf

Joist Depth (in.)	Joist Series	Minimum distance from inside face of any support to center of hole (in.)											
		6	8	10	12	14	16	18	20	22	24	26	28
9-1/2"	N-10	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-12	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-14	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-16	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
11-7/8"	N-10	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-12	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-14	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-16	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
14"	N-10	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-12	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-14	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-16	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
16"	N-10	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-12	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-14	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-16	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7

- Above table may be used for joist spacing of 24 inches on center or less.
- Hole location distance is measured from inside face of supports to center of hole.
- Distance in this chart are based on uniformly loaded joists.

OPTIONAL:

The above table is based on the I-joists used at their maximum span. If the I-joists are placed at less than their full maximum span (see Maximum Span Table), the minimum distance from the centerline of the hole to the face of any support (S) or given above may be reduced as follows:

- Reduced = $\frac{S}{S_{max}} \times D$
- Where:
- Reduced = Distance from the inside face of any support to center of hole, reduced for less than maximum span application.
 - S = Actual span distance between the inside faces of supports (ft).
 - S_{max} = The actual maximum span distance between the inside faces of supports (ft).
 - D = Span Adjustment Factor given in this table.
 - S = The minimum distance from the inside face of any support to center of hole from this table.
 - If S_{max} is greater than 1, use 1 in the above calculation for S_{max}.

TABLE 2 DUCT CHASE OPENING SIZES AND LOCATIONS — Simple Span Only

Joist Depth (in.)	Joist Series	Minimum distance from inside face of any support to center of opening (in.)											
		6	8	10	12	14	16	18	20	22	24	26	28
9-1/2"	N-10	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-12	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-14	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-16	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
11-7/8"	N-10	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-12	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-14	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-16	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
14"	N-10	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-12	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-14	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-16	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
16"	N-10	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-12	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-14	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7
	N-16	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7	0.7

- Above table may be used for joist spacing of 24 inches on center or less.
- Duct chase opening location distance is measured from inside face of supports to center of opening.
- The above table is based on simple-span joists only. For other applications, consult your local distributor.
- Distance are based on uniformly loaded floor joists that meet the span requirements for a design live load of 40 psf and dead load of 15 psf, and a live load deflection limit of L/480. For other applications, consult your local distributor.

INSTALLING THE GLUED FLOOR SYSTEM

- Wipe any mud, dirt, water, or ice from I-joist flanges before gluing.
- Snap a chalk line across the I-joists four feet in from the wall for panel edge alignment and as a boundary for spreading glue.
- Spread only enough glue to lay one or two panels at a time, or follow specific recommendations from the glue manufacturer.
- Lay the first panel with tongue side to the wall, and nail in place. This protects the tongue of the next panel from damage when tapped into place with a block and sledgehammer.
- Apply a continuous line of glue (about 1/4-inch diameter) to the top flange of a single I-joist. Apply glue in a winding pattern on wide areas, such as with double I-joists.
- Apply two lines of glue on I-joists where panels abut to ensure proper gluing of each end.
- After the first row of panels is in place, spread glue in the groove of one or two panels at a time before laying the next row. Glue line may be continuous or spaced, but avoid squeeze-out by applying a thinner line (1/8 inch) then used on I-joist flanges.
- Tap the second row of panels into place, using a block to protect groove edges.
- Stagger and joints in each succeeding row of panels. A 1/8-inch space between all end joints and 1/8-inch at all edges, including T&G edges, is recommended. (Use a square tool or an 1/8-inch common nail to assure accurate and consistent spacing.)
- Complete all nailing of each panel before glue sets. Check the manufacturer's recommendations for cure time. (Warm weather accelerates glue setting.) Use 2\".

FASTENERS FOR SHEATHING AND SUBFLOORING(1)

Maximum Joist Spacing (ft.)	Minimum Panel Thickness (in.)	Common Nail or Screw	Nail Size and Type	Maximum Spacing of Fasteners (ft.)
16	5/8	2"	1-3/4"	6"
20	5/8	2"	1-3/4"	6"
24	3/4	2"	1-3/4"	6"

- Fasteners of sheathing and subflooring shall conform to the above table.
- Staples shall not be less than 1/16-inch in diameter or thickness, with not less than a 3/8-inch crown driven with the crown parallel to framing.
- Flooring screws shall not be less than 1/8-inch in diameter.
- Special conditions may impose heavy traffic and concentrated loads that require construction in excess of the minimums shown.
- Use only adhesives conforming to CAN/CGSB-71.26 Standard, Adhesives for Field-Gluing Plywood to Lumber Framing for Floor System, applied in accordance with the manufacturer's recommendations. If OSB panels with sealed surfaces and edges are to be used, use only solvent-based glues; check with panel manufacturer.


Ref: NRC-CNRC, National Building Code of Canada 2010, Table 9.23.3.5.

IMPORTANT NOTE:


Floor sheathing must be field glued to the I-joist flanges in order to achieve the maximum spans shown in this document. If sheathing is nailed only, I-joist spans must be verified with your local distributor.

RIM BOARD INSTALLATION DETAILS


6a ATTACHMENT DETAILS WHERE RIM BOARDS ABUT

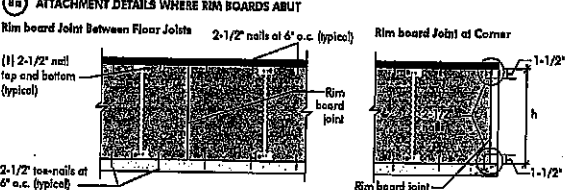

6b TOE-NAIL CONNECTION AT RIM BOARD

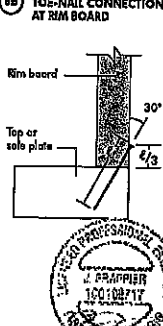

6c 2X LEDGER TO RIM BOARD ATTACHMENT DETAIL

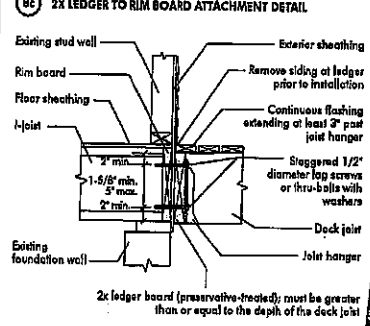

PRODUCT WARRANTY

OSB products are warranted to be free from manufacturing defects in material and workmanship.

For more information, contact your local distributor.

RECEIVED
JUN 13 2019

TOWN OF CALEDON
BUILDING SECTION

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER INC.
3269 NORTH SERVICE ROAD
BURLINGTON ONTARIO
Nov. 1, 2018 11:39


PROJECT
J1 1ST FLOOR

Design Check Calculation Sheet Nordic Sizer -- Canada 7.1


Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (In) :

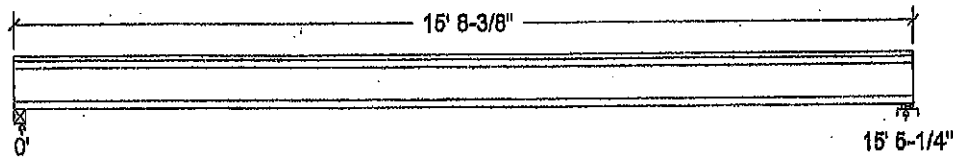

Unfactored:			
Dead	154		154
Live	309		309
Factored:			
Total	656		656
Bearing:			
Resistance			
Joist	1867		1865
Support	-		3659
Des ratio			
Joist	0.35		0.35
Support	-		0.18
Load case	#2		#2
Length	2-1/2		2-3/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	-		1.00
fcp sup	-		769
Kzcp sup	-		1.00



Nordic Joist 9-1/2" NI-40x Floor Joist @ 12" o.c.

Supports: 1 - Steel Beam, W; 2 - Lumber Sill plate, No.1/No.2;

Total length: 15' 8-3/8"; Clear span: 15' 3-1/2"; 3/4" nailed and glued OSB sheathing

This section PASSES the design code check.

**THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE**

DWG NO. TAM 1 944-18H
STRUCTURAL
COMPONENT ONLY

T-19011146

Limit States Design using CSA 086-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 656	Vr = 1895	lbs	Vf/Vr = 0.35
Moment(+)	Mf = 2532	Mr = 4824	lbs-ft	Mf/Mr = 0.52
Perm. Defl'n	0.11 = < L/999	0.51 = L/360	in.	0.21
Live Defl'n	0.22 = L/858	0.39 = L/480	in.	0.56
Total Defl'n	0.32 = L/572	0.77 = L/240	in.	0.42
Bare Defl'n	0.26 = L/719	0.51 = L/360	in.	0.50
Vibration	Lmax = 15'-5.3	Lv = 17'-1.8	ft	0.90
Defl'n	= 0.030	= 0.042	in.	0.72

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vx	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
FI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

```

Shear      : LC #2  = 1.25D + 1.5L
Moment(+)  : LC #2  = 1.25D + 1.5L
Deflection: LC #1  = 1.0D (permanent)
            LC #2  = 1.0D + 1.0L (live)
            LC #2  = 1.0D + 1.0L (total)
            LC #2  = 1.0D + 1.0L (bare joist)

```

Bearing : Support 1 - LC #2 = 1.25D + 1.5L
Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake
L=live (use, occupancy) Ls=live (storage, equipment) P=pile

Load Patterns: $s=S/2$ $L=L+L_s$ =no pattern load in this span
All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Calculation: EIEff = 265e06 lb-in2 K= 4.94e06 lbs
"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

- Design Notes:**
1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
 2. Please verify that the default deflection limits are appropriate for your application.
 3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
 4. Nordic Joists are listed in CCMC evaluation report 13032-R.
 5. Joists shall be laterally supported at supports and continuously along the compression edge.
 6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.
- CONFORMS TO OBC 2012

DWG NO. TAW 1944-18H
STRUCTURAL
COMPONENT ONLY

T. 190114662

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER INC.
3269 NORTH SERVICE ROAD
BURLINGTON ONTARIO
Nov. 1, 2018 11:47

PROJECT
J2 2ND FLOOR


Design Check Calculation Sheet

Nordic Sizer - Canada 7.1


Loads:

Load	Type	Distribution	Pat- tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

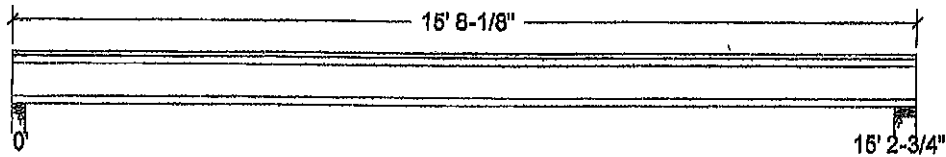

Unfactored:				
Dead	152			152
Live	305			305
Factored:				
Total	647			647
Bearing:				
Resistance				
Joist	1872			1893
Support	4756			7744
Des ratio				
Joist	0.35			0.34
Support	0.14			0.08
Load case	#2			#2
Length	2-3/4			4-3/8
Min req'd	1-3/4			1-3/4
Stiffener	No			No
KD	1.00			1.00
KB support	1.00			1.00
fcp sup	769			769
Kzop sup	1.13			1.15



Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic Joist 9-1/2" NI-40x Floor joist @ 12" o.c.

Supports: All - Lumber Wall, No.1/No.2

Total length: 15' 8-1/8"; Clear span: 15' 1"; 5/8" nailed and glued OSB sheathing with 1/2" gypsum ceiling

This section PASSES the design code check.

HWB NO. TAM 1245-18H
STRUCTURAL
COMPONENT ONLY
pg 14

T-19011697

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	$V_f = 647$	$V_r = 1895$	lbs	$V_f/V_r = 0.34$
Moment(+)	$M_f = 2464$	$M_r = 4824$	lbs-ft	$M_f/M_r = 0.51$
Perm. Defl'n	$0.10 = < L/999$	$0.51 = L/360$	in	0.21
Live Defl'n	$0.21 = L/870$	$0.38 = L/480$	in	0.55
Total Defl'n	$0.31 = L/580$	$0.76 = L/240$	in	0.41
Bare Defl'n	$0.24 = L/747$	$0.51 = L/360$	in	0.48
Vibration	$L_{max} = 15'-2.8$	$L_v = 16'-8.5$	ft	0.91
Defl'n	$= 0.032$	$= 0.043$	in	0.75

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	4824	1.00	1.00	-	1.000	-	-	-	#2
EI	218.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = $1.25D + 1.5L$
 Moment(+) : LC #2 = $1.25D + 1.5L$
 Deflection: LC #1 = $1.0D$ (permanent)
 LC #2 = $1.0D + 1.0L$ (live)
 LC #2 = $1.0D + 1.0L$ (total)
 LC #2 = $1.0D + 1.0L$ (bare joist)

Bearing : Support 1 - LC #2 = $1.25D + 1.5L$
 Support 2 - LC #2 = $1.25D + 1.5L$

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake
 L=live (use, occupancy) Ls=live (storage, equipment)

Load Patterns: s=8/2 L=L+Ls =no pattern load in this span
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:


Deflection: $EI_{eff} = 258e06 \text{ lb-in}^2$ $K = 4.94e06 \text{ lbs}$

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

CONFORMS TO OBC 2012

- WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
- Please verify that the default deflection limits are appropriate for your application.
- Refer to Nordic Structures technical documentation for installation guidelines and construction details.
- Nordic I-joists are listed in CCMC evaluation report 13032-R.
- Joints shall be laterally supported at supports and continuously along the compression edge.
- The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



DWG NO. TAM 1945-18H
 STRUCTURAL
 COMPONENT ONLY

T-190111476

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER INC.
3289 NORTH SERVICE ROAD
BURLINGTON ONTARIO
Nov. 1, 2018 11:49

PROJECT
J5 2ND FLOOR CANT


Design Check Calculation Sheet

Nordic Sizer - Canada 7.1


Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area	No		20.00	psf
Load2	Live	Full Area	Yes		40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

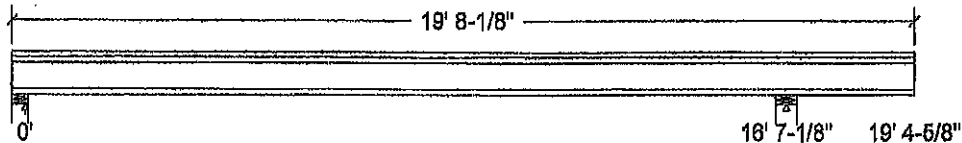

Unfactored:					
Dead	161			226	
Live	332			453	
Factored:					
Total	699			962	
Bearing:					
Resistance					
Joist	1893			4238	
Support	10829			13614	
Des ratio					
Joist	0.37			0.23	
Support	0.06			0.07	
Load case	#4			#2	
Length	4-3/8			5-1/2	
Min req'd	1-3/4			3-1/2	
Stiffener	No			No	
KD	1.00			1.00	
KB support	1.00			1.00	
fcp sup	769			769	
Kzcp sup	1.15			1.15	



Maximum reaction on at least one support is from a different load combination than the critical one for bearing design, shown here, due to KD factor. See Analysis results for reaction from critical load combination.
Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic Joist 9-1/2" NI-80 Floor Joist @ 12" o.c.

Supports: All - Lumber Wall, No.1/No.2

Total length: 19' 8-1/8"; Clear span: 16' 3-1/2", 2' 6-3/4"; 5/8" nailed and glued OSB sheathing

This section PASSES the design code check.

OWNERS: TAM 1946-18H
STRUCTURAL
COMPONENT ONLY 16 1/2

T-19011148

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	$V_f = 725$	$V_r = 1895$	lbs	$V_f/V_r = 0.38$
Moment(+)	$M_f = 2877$	$M_r = 8958$	lbs-ft	$M_f/M_r = 0.32$
Moment(-)	$M_f = 331$	$M_r = 5822$	lbs-ft	$M_f/M_r = 0.06$
Deflection:				
Interior Perm	$0.10 = < L/999$	$0.55 = L/360$	in	0.18
Live	$0.21 = L/936$	$0.41 = L/480$	in	0.51
Total	$0.31 = L/639$	$0.83 = L/240$	in	0.38
Cantil. Perm	$-0.04 = L/767$	$0.19 = L/180$	in	0.23
Live	$-0.10 = L/334$	$0.14 = L/240$	in	0.72
Total	$-0.14 = L/233$	$0.28 = L/120$	in	0.51
Bare Defl'n	$-0.11 = L/295$	$0.19 = L/180$	in	0.61
Vibration	$L_{max} = 16'-7.1$	$L_v = 17'-5$	ft	0.95
Defl'n	$= 0.033$	$= 0.038$	in	0.86

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
V_r	1895	1.00	1.00	-	-	-	-	-	#2
M_r+	8958	1.00	1.00	-	1.000	-	-	-	#4
M_r-	8958	0.65	1.00	-	1.000	-	-	-	#5
EI	324.1 million	-	-	-	-	-	-	-	#4

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = $1.25D + 1.5L$
 Moment(+) : LC #4 = $1.25D + 1.5L$ (pattern: L)
 Moment(-) : LC #5 = $1.25D + 1.5L$ (pattern: L)
 Deflection: LC #1 = $1.0D$ (permanent)
 LC #4 = $1.0D + 1.0L$ (pattern: L) (live)
 LC #4 = $1.0D + 1.0L$ (pattern: L) (total)
 LC #4 = $1.0D + 1.0L$ (pattern: L) (bare joist)
 Bearing : Support 1 - LC #2 = $1.25D + 1.5L$
 Support 2 - LC #0 = $1.4D$

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake
 L=live (use, occupancy) Ls=live (storage, equipment) F=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span
 All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:

Deflection: $EI_{eff} = 367e06 \text{ lb-in}^2$ $K = 4.94e06 \text{ lbs}$
 "Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.



WOODWORK 1946-18H
 STRUCTURAL
 COMPONENT ONLY

T-190111486

NORDIC STRUCTURES

COMPANY
TAMARACK LUMBER INC.
3269 NORTH SERVICE ROAD
BURLINGTON ONTARIO
Nov. 1, 2018 11:44

PROJECT
J6 2ND FLOOR ABOVE
GARAGE


Design Check Calculation Sheet

Nordic Sizer - Canada 7.1


Loads:

Load	Type	Distribution	Pat-tern	Location [ft] Start End	Magnitude Start End	Unit
Load1	Dead	Full Area			20.00	psf
Load2	Live	Full Area			40.00	psf

Maximum Reactions (lbs), Bearing Resistances (lbs) and Bearing Lengths (in) :

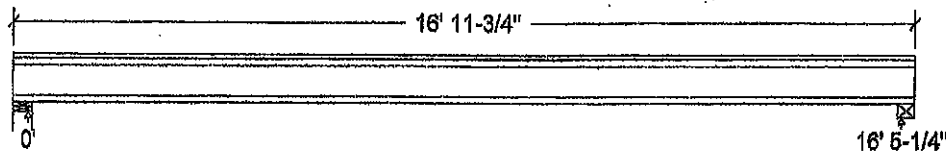

Unfactored:			
Dead	164		164
Live	329		329
Factored:			
Total	699		699
Bearing:			
Resistance			
Joist	1893		1893
Support	10829		-
Des ratio			
Joist	0.37		0.37
Support	0.06		-
Load case	#2		#2
Length	4-3/8		3-7/8
Min req'd	1-3/4		1-3/4
Stiffener	No		No
KD	1.00		1.00
KB support	1.00		-
fcp sup	769		-
Kzcp sup	1.15		-



Bearing for wall supports is perpendicular-to-grain bearing on top plate. No stud design included.

Nordic Joist 9-1/2" NI-80 Floor joist @ 12" o.c.

Supports: 1 - Lumber Wall, No.1/No.2; 2 - Steel Beam, W;

Total length: 16' 11-3/4"; Clear span: 16' 3-1/2"; 5/8" nailed and glued OSB sheathing

This section PASSES the design code check.

Limit States Design using CSA O86-14 and Vibration Criterion:

Criterion	Analysis Value	Design Value	Unit	Analysis/Design
Shear	Vf = 699	Vr = 1895	lbs	Vf/Vr = 0.37
Moment(+)	Mf = 2871	Mr = 8958	lbs-ft	Mf/Mr = 0.32
Perm. Defl'n	0.10 = < L/999	0.55 = L/360	in	0.19
Live Defl'n	0.21 = L/961	0.41 = L/480	in	0.50
Total Defl'n	0.31 = L/640	0.82 = L/240	in	0.37
Bare Defl'n	0.23 = L/861	0.55 = L/360	in	0.42
Vibration	Lmax = 16'-5.3	Lv = 17'-5	ft	0.94
Defl'n	= 0.032	= 0.039	in	0.83

DWG NO. TAM 1947-18H
STRUCTURAL
COMPONENT ONLY
T-19011609

Additional Data:

FACTORS:	f/E	KD	KH	KZ	KL	KT	KS	KN	LC#
Vr	1895	1.00	1.00	-	-	-	-	-	#2
Mr+	8958	1.00	1.00	-	1.000	-	-	-	#2
ET	324.1 million	-	-	-	-	-	-	-	#2

CRITICAL LOAD COMBINATIONS:

Shear : LC #2 = 1.25D + 1.5L
 Moment (+) : LC #2 = 1.25D + 1.5L
 Deflection: LC #1 = 1.0D (permanent)
 LC #2 = 1.0D + 1.0L (live)
 LC #2 = 1.0D + 1.0L (total)
 LC #2 = 1.0D + 1.0L (bare joist)

Bearing : Support 1 - LC #2 = 1.25D + 1.5L
 Support 2 - LC #2 = 1.25D + 1.5L

Load Types: D=dead W=wind S=snow H=earth, groundwater E=earthquake
 L=live (use, occupancy) Ls=live (storage, equipment) f=fire

Load Patterns: s=S/2 L=L+Ls _=no pattern load in this span

All Load Combinations (LCs) are listed in the Analysis output

CALCULATIONS:


Deflection: E_{IEff} = 367e06 lb-in² K= 4.94e06 lbs

"Live" deflection = Deflection from all non-dead loads (live, wind, snow...)

Design Notes:

1. WoodWorks analysis and design are in accordance with the 2015 National Building Code of Canada (NBC), Division B, Part 4, and the CSA O86-14 Engineering Design in Wood standard, Update No. 2 (June 2017).
2. Please verify that the default deflection limits are appropriate for your application.
3. Refer to Nordic Structures technical documentation for installation guidelines and construction details.
4. Nordic i-joists are listed in CCMC evaluation report 13032-R.
5. Joists shall be laterally supported at supports and continuously along the compression edge.
6. The design assumptions and specifications have been provided by the client. Any damages resulting from faulty or incorrect information, specifications, and/or designs furnished, and the correctness or accuracy of this information is their responsibility. This analysis does not constitute a record of the structural integrity of the building nor suitability of the design assumptions made. Nordic Structures is responsible only for the structural adequacy of this component based on the design criteria and loadings shown.

CONFORMS TO QBC 2012



DWNGO.YAM 1947-18H
 STRUCTURAL
 COMPONENT ONLY

T-1901114962



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

1ST FLOOR FRAMING\Flush Beams\B8 H(13793)

Dry | 2 spans | L cant.

PASSED

BC CALC® Member Report

Build 0475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 3.mmdl


Description: 1ST FLOOR FRAMING\Flush Beams\B8 H(13793)

Specifier:

Designer: PL

Company:

November 6, 2018 15:58:05

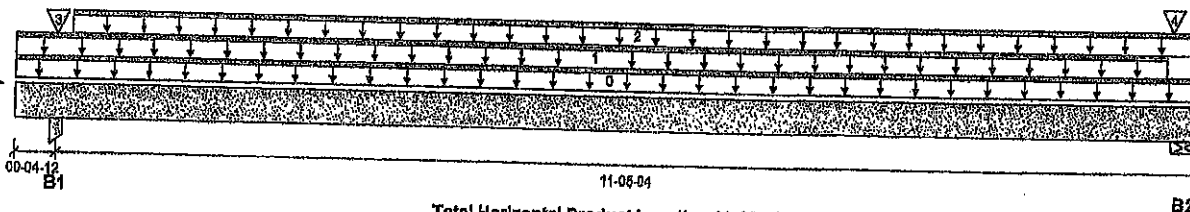

Total Horizontal Product Length = 11'-10'-00"

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	470 / 0	872 / 0		
B2, 3-1/2"	156 / 0	490 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-10-00	Top	1.00	0.85	1.00	1.15	
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	11-06-08	Top		80			00-00-00
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-06-08	11-10-00	Top	11	5			n/a
3	B7 H(13529)	Conc. Pt. (lbs)	L	00-04-12	00-04-12	Top	407	222			n/a
4	E2(I504)	Conc. Pt. (lbs)	L	11-07-04	11-07-04	Top	93	70			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,646 ft-lbs	15,093 ft-lbs	10.9%	0	06-00-08
Neg. Moment	-8 ft-lbs	-15,093 ft-lbs	n/a	0	00-04-12
End Shear	498 lbs	7,521 lbs	6.6%	0	10-09-00
Cont. Shear	491 lbs	7,521 lbs	6.5%	0	01-04-00
Total Load Deflection	L/999 (0.081")	n/a	n/a	10	06-11-10
Live Load Deflection	L/999 (0.008")	n/a	n/a	13	06-11-10
Total Neg. Defl.	2xL/1,999 (-0.007")	n/a	n/a	10	00-00-00
Max Defl.	0.081"	n/a	n/a	10	05-11-10
Span / Depth	14.2				



Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 3-1/2" x 3-1/2"	1,646 lbs	19.4%	10.3%	Unspecified
B2	Wall/Plate 3-1/2" x 3-1/2"	686 lbs	20.2%	7.1%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

OWNED, TAW 1948-19H
STRUCTURAL
COMPONENT ONLY

T-19011150



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B8 H(13793)

Dry | 2 spans | L cant.

November 6, 2018 15:58:06

BC CALC® Member Report

Buld 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 3.mxd


Description: 1ST FLOOR FRAMING\Flush Beams\B8 H(13793)

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

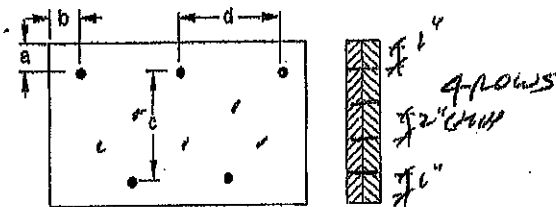

a minimum = 2"
b minimum = 3"

c = 1-1/2"
d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: Nails

3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0768 before installation.

OWNED BY 1948-18H
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BCI®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®

T-190111506



Boise Cascade



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B2(13687)

November 6, 2018 15:56:05

BC CALC® Member Report

Build 6476

Job name:

File name: PRESTON 3.mmdl

Address:

Description: 1ST FLOOR FRAMING\Flush Beams\B2(13687)

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

CCMC 12472-R

Company:

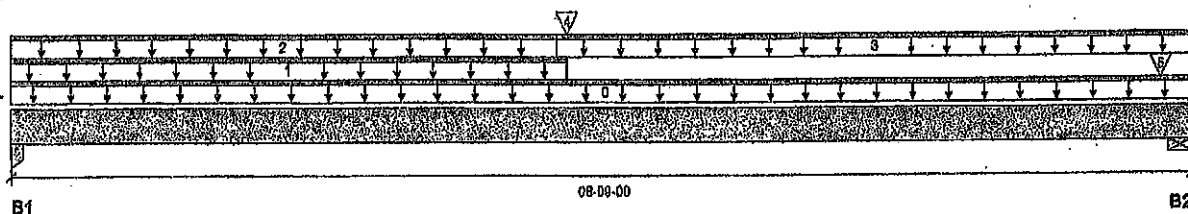

Total Horizontal Product Length = 08-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	370 / 0	402 / 0		
B2, 3-1/2"	455 / 0	331 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-09-00	Top		5			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	04-01-00	Top		60			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	04-00-02	Top	16	8			n/a
3	FC1 Floor Material	Unf. Lin. (lb/ft)	L	04-00-02	08-09-00	Top	27	13			n/a
4	B5(13450)	Conc. Pt. (lbs)	L	04-01-00	04-01-00	Top	537	277			n/a
5	3(1669)	Conc. Pt. (lbs)	L	08-08-04	08-08-04	Top	98				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	3,122 ft-lbs	11,810 ft-lbs	26.9%	1	04-01-00
End Shear	933 lbs	5,786 lbs	16.1%	1	01-01-00
Total Load Deflection	L/999 (0.094")	n/a	n/a	4	04-03-00
Live Load Deflection	L/999 (0.053")	n/a	n/a	5	04-03-00
Max Defl.	0.094"	n/a	n/a	4	04-03-00
Span / Depth	10.5				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 3-1/2" x 1-3/4"	1,087 lbs	26.6%	14.1%	Unspecified
B2	Wall/Plate 3-1/2" x 1-3/4"	1,097 lbs	41.9%	14.7%	Unspecified

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

DWG NO. TAM 1949-1711
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BC®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®.

T-1901115



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Member Report
Build 6476

1ST FLOOR FRAMING (Flush Beams) B3 (13686)

Dry | 1 span | No cant.

November 6, 2018 15:58:05

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports:

COMC 12472-R


File name: PRESTON 3.mmdl

Description: 1ST FLOOR FRAMING (Flush Beams) B3 (13686)

Specifier:

Designer: PL

Company:

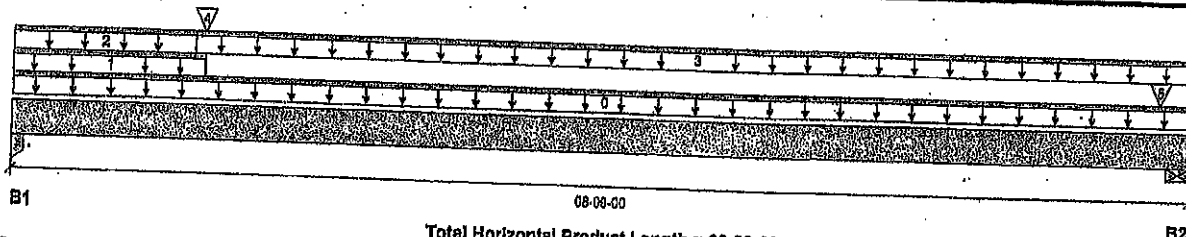

Reaction Summary (Down / Uplift) (lbs)

Total Horizontal Product Length = 08-09-00


Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	718 / 0	485 / 0		
B2, 3-1/2"	265 / 0	167 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-09-00	Top	1.00	0.65	1.00	1.15	
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	01-05-00	Top		60			00-00-00
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	01-04-02	Top	11	5			n/a
3	FC1 Floor Material	Unf. Lin. (lb/ft)	L	01-04-02	08-09-00	Top	27	13			n/a
4	B6(13151)	Conc. Pt. (lbs)	L	01-05-00	01-05-00	Top	719	369			n/a
5	3(1659)	Conc. Pt. (lbs)	L	08-08-04	08-08-04	Top	37	30			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,859 ft-lbs	11,810 ft-lbs	16.0%	1	01-05-00
End Shear	1,838 lbs	6,785 lbs	26.6%	1	01-01-00
Total Load Deflection	L/999 (0.058")	n/a	n/a	4	03-11-08
Live Load Deflection	L/999 (0.036")	n/a	n/a	5	03-11-08
Max Defl.	0.058"	n/a	n/a	4	03-11-08
Span / Depth	10.5				



Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Column	3-1/2" x 1-3/4"	1,851 lbs	41.6%	22.1%	Unspecified
B2 Wall/Plate	3-1/2" x 1-3/4"	592 lbs	22.6%	7.9%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO CBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AIS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. YAM 195018H
STRUCTURAL
COMPONENT ONLY

T-19011152



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
1ST FLOOR FRAMING\Flush Beams\B1(13455)

PASSED

BC CALC® Member Report
Build 6476

Dry | 1 span | No cant.

November 6, 2018 15:58:05

Job name:

File name: PRESTON 3.mmdl

Address:

Description: 1ST FLOOR FRAMING\Flush Beams\B1(13455)

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

CCMC 12472-R

Company:

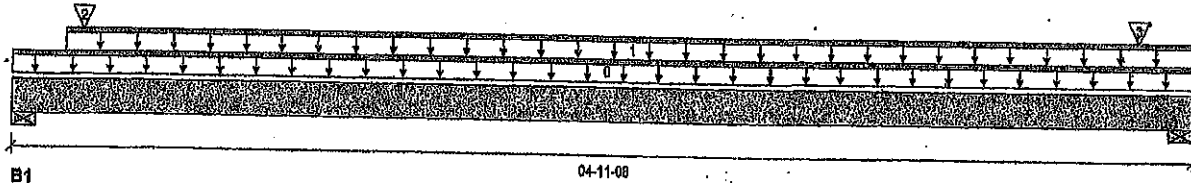

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	616 / 0	327 / 0		
B2, 3-1/2"	185 / 0	164 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-11-08	Top	1.00	0.65	1.00	1.15	
1	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-02-10	04-11-08	Top		5			00-00-00
2	B5(13455)	Conc. Pt. (lbs)	L	00-03-08	00-03-08	Top	27	13			n/a
3	3(1859)	Conc. Pt. (lbs)	L	04-08-12	04-08-12	Top	563	289			n/a
							111	115			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	199 ft-lbs	11,810 ft-lbs	1.7%	1	02-02-10
End Shear	104 lbs	5,785 lbs	1.8%	1	03-10-08
Total Load Deflection	L/999 (0.002")	n/a	n/a	4	02-04-11
Live Load Deflection	L/999 (0.001")	n/a	n/a	5	02-04-11
Max Defl.	0.002"	n/a	n/a	4	02-04-11
Span / Depth	5.7				



Bearing Supports

	Dim. (L x W)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 1-3/4"	1,332 lbs	60.9%	17.8%	Unspecified
B2	Wall/Plate 3-1/2" x 1-3/4"	482 lbs	18.4%	6.5%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®.

DWG NO. YAM 19518H
STRUCTURAL
COMPONENT ONLY

T-19011153



Boise Cascade



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

1ST FLOOR FRAMING\Flush Beams\B6(13151)

Dry | 1 span | No cant.

PASSED

November 6, 2018 15:58:05

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mmdl

Description: 1ST FLOOR FRAMING\Flush Beams\B6(13151)

Specifier:

Designer: PL

Company:

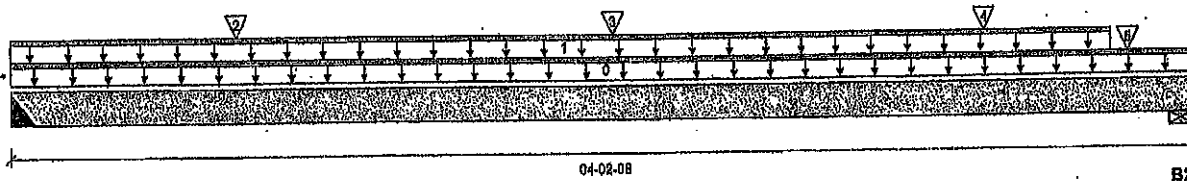

Total Horizontal Product Length = 04-02-08

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 3"	761 / 0	385 / 0		
B2, 3-1/2"	697 / 0	370 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-02-08	Top	1.00	0.65	1.00	1.16	00-00-00
1	STAIRS	Unf. Lin. (lb/ft)	L	00-00-00	03-11-00	Top	240	120			n/a
2	J5(1880)	Conc. Pt. (lbs)	L	00-09-08	00-09-08	Top	160	80			n/a
3	J5(1852)	Conc. Pt. (lbs)	L	02-01-08	02-01-08	Top	195	97			n/a
4	J6(1847)	Conc. Pt. (lbs)	L	03-06-08	03-06-08	Top	152	76			n/a
6	E7(1497)	Conc. Pt. (lbs)	L	03-11-12	03-11-12	Top		12			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,604 ft-lbs	11,610 ft-lbs	13.0%	1	02-01-08
End Shear	962 lbs	5,785 lbs	16.6%	1	01-00-08
Total Load Deflection	L/999 (0.011")	n/a	n/a	4	02-01-01
Live Load Deflection	L/999 (0.007")	n/a	n/a	5	02-01-01
Max Defl.	0.011"	n/a	n/a	4	02-01-01
Span / Depth	4.8				



Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 3" x 1-3/4"	1,607 lbs	n/a	26.1%	HUS1.81/10
B2	Wall/Plate 3-1/2" x 1-3/4"	1,608 lbs	57.6%	20.2%	Unspecified

Cautions

Header for the hanger HUS1.81/10 at B1 is a Single 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.
Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.
Design meets Code minimum (L/360) Live load deflection criteria.
Calculations assume member is fully braced.
Hanger Manufacturer: Unassigned
Resistance Factor phi has been applied to all presented results per CSA O86.
BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.
Design based on Dry Service Condition.
Importance Factor: Normal Part code: Part 9

CONFORMS TO OBC 2012

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA).
Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods.
Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AIS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

SHAWN TAM 1952-184
STRUCTURAL
COMPONENT ONLY

T-19011154

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLOOR FRAMING/Flush Beams/B4(13685)**

Dry | 1 span | No cant.

November 6, 2018 15:58:05

BC CALC® Member Report

Build 6475

Job name:

File name: PRESTON 3.mmdl

Address:

Description: 1ST FLOOR FRAMING/Flush Beams/B4(13685)

City, Province, Postal Code: CALEDON


Specifier:

Customer:

Designer: PL

Code reports: CCMC 12472-R

Company:

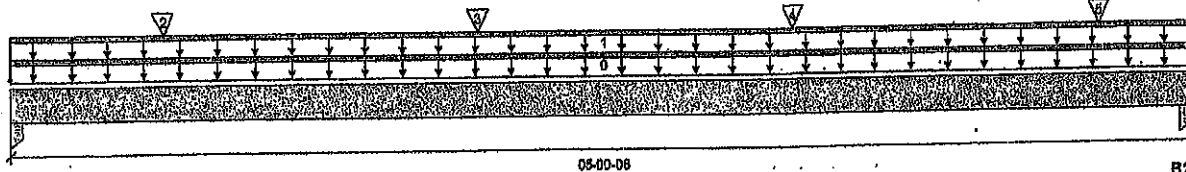

Total Horizontal Product Length = 05-00-08

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 1-3/4"	999 / 0	375 / 0		
B2, 1-3/4"	420 / 0	386 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-00-08	Top		10			00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	05-00-08	Top		80			n/a
2	J4(13473)	Conc. Pt. (lbs)	L	00-07-12	00-07-12	Top	186	93			n/a
3	J4(13474)	Conc. Pt. (lbs)	L	01-11-12	01-11-12	Top	236	118			n/a
4	J4(13474)	Conc. Pt. (lbs)	L	03-03-12	03-03-12	Top	236	118			n/a
5	J4(13483)	Conc. Pt. (lbs)	L	04-07-12	04-07-12	Top	181	81			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	1,325 ft-lbs	23,220 ft-lbs	5.7%	1	01-11-12
End Shear	840 lbs	11,571 lbs	7.3%	1	00-11-04
Total Load Deflection	L/999 (0.008")	n/a	n/a	4	02-06-04
Live Load Deflection	L/999 (0.004")	n/a	n/a	5	02-06-04
Max Defl.	0.008"	n/a	n/a	4	02-06-04
Span / Depth	6.2				

**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Column 1-3/4" x 3-1/2"	1,067 lbs	26.8%	14.3%	Unspecified
B2	Column 1-3/4" x 3-1/2"	1,113 lbs	28.0%	14.9%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. **CONFORMS TO OBC 2012**

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWONG, YAM 1953-18H
STRUCTURAL
COMPONENT ONLY

T-19011155



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

1ST FLOOR FRAMING\Flush Beams\B4(13685)

Dry | 1 span | No cant.

November 8, 2018 15:58:06

File name: PRESTON 3.mmdl


Description: 1ST FLOOR FRAMING\Flush Beams\B4(13685)

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

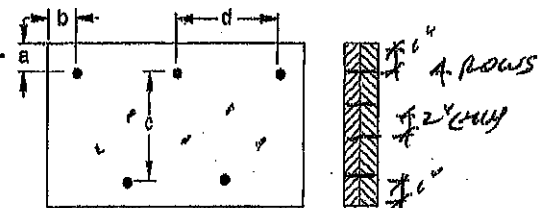

a minimum = 1"
b minimum = 3"

c = 7-1/2"
d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: Nails

3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
STRUCTURAL COMPONENT ONLY

T-19011155(u)



Bolas-Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED****1ST FLOOR FRAMING\Flush Beams\B7 H(13629)**

Dry | 1 span | No cant.

November 8, 2018 15:58:06

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mmdl

Description: 1ST FLOOR FRAMING\Flush Beams\B7 H(13629)

Specifier:

Designer: PL

Company:

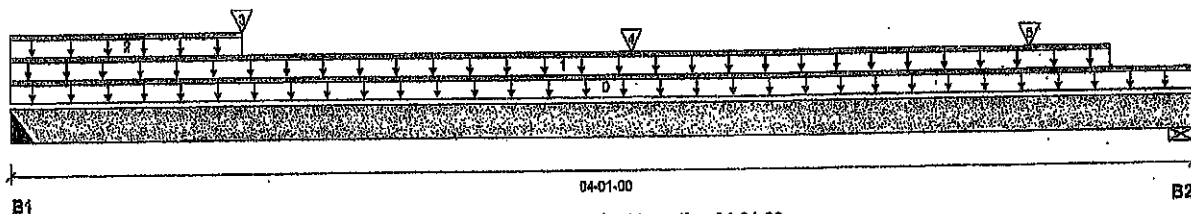**Reaction Summary (Down / Uplift) (lbs)**

Bearing	Live	Dead	Snow	Wind
B1, 4"	434 / 0	237 / 0		
B2, 3-1/2"	377 / 0	233 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	04-01-00	Top		10			00-00-00
1	STAIRS	Unf. Lin. (lb/ft)	L	00-00-00	03-09-08	Top	120	60			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	00-09-08	Top	26	13			n/a
3	J6(12987)	Conc. Pt. (lbs)	L	00-09-08	00-09-08	Top	113	57			n/a
4	J6(12985)	Conc. Pt. (lbs)	L	02-01-08	02-01-08	Top	124	62			n/a
5		Conc. Pt. (lbs)	L	03-08-03	03-08-03	Top	99				n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	771 ft-lbs	23,220 ft-lbs	3.3%	1	02-01-08
End Shear	628 lbs	11,571 lbs	4.6%	1	01-01-08
Total Load Deflection	L/999 (0.002")	n/a	n/a	4	02-00-12
Live Load Deflection	L/999 (0.002")	n/a	n/a	5	02-00-12
Max Defl.	0.002"	n/a	n/a	4	02-00-12
Span / Depth	4.5				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 4" x 3-1/2"	948 lbs	n/a	5.5%	HGUS410
B2	Wall/Plate 3-1/2" x 3-1/2"	856 lbs	16.4%	5.7%	Unspecified

Cautions

Header for the hanger HGUS410 at B1 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

DWG NO. TAM 2954-18H
STRUCTURAL
COMPONENT ONLY

T-190115/6



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B7 H(13529)

Dry | 1 span | No cant.

November 6, 2018 16:58:05

BC CALC® Member Report

Build 6476

Job name:

File name: PRESTON 3.mmdl

Address:

Description: 1ST FLOOR FRAMING\Flush Beams\B7 H(13529)

City, Province, Postal Code: CALEDON

Specifier:

Customer:

Designer: PL

Code reports: CCMC 12472-R

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned


Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

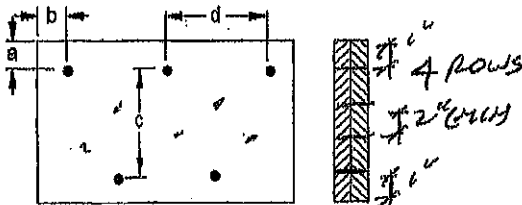Connection Diagram: Full Length of Member

a minimum = 1"

c = 7-1/2"

b minimum = 3"

d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 1 Nails

3-1/2" ARDOX SPIRAL

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
OWNED, TAM 1954-1987, STRUCTURAL COMPONENT ONLY

T-19011156(V)



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B5\B5(13450)

Dry | 1 span | No cant.

November 8, 2018 15:58:05

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mxd

Description: 1ST FLOOR FRAMING\Flush Beams\B5\B5(13450)

Specifier:

Designer: PL

Company:



B1

03-04-08

B2

Total Horizontal Product Length = 03-04-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	560 / 0	286 / 0		
B2, 3"	540 / 0	278 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-04-08	Top	1.00	0.05	1.00	1.15	00-00-00
1	STAIRS	Unf. Lin. (lb/ft)	L	00-00-00	03-04-08	Top	240	120			n/a
2	J6(13485)	Conc. Pt. (lbs)	L	00-02-00	00-02-00	Top	74	37			n/a
3	J6(13486)	Conc. Pt. (lbs)	L	01-06-00	01-06-00	Top	125	62			n/a
4	J6(13481)	Conc. Pt. (lbs)	L	02-10-00	02-10-00	Top	91	46			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	797 ft-lbs	11,610 ft-lbs	6.9%	1	01-06-00
End Shear	505 lbs	5,785 lbs	8.7%	1	01-00-08
Total Load Deflection	L/999 (0.004")	n/a	n/a	4	01-08-03
Live Load Deflection	L/999 (0.002")	n/a	n/a	5	01-08-03
Max Defl.	0.004"	n/a	n/a	4	01-08-03
Span / Depth	3.8				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Hanger	3" x 1-3/4"	1,200 lbs	n/a	18.7%	HUS1.81/10
B2 Hanger	3" x 1-3/4"	1,158 lbs	n/a	18.1%	HUS1.81/10

Cautions

Header for the hanger HUS1.81/10 at B1 is a Single 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Header for the hanger HUS1.81/10 at B2 is a Single 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

CONFORMS TO OBC 2012

BYRON TAM 1955-1011
STRUCTURAL
COMPONENT ONLY



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AIS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

T-19011157



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP 2ND FLOOR FRAMING\Flush Beams\B10 CANT(13616)

PASSED

BC CALC® Member Report

Dry | 2 spans | L cant.

November 6, 2018 16:02:10

Build 6476

Job name:

File name: PRESTON 3.mmdl

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B10 CANT(13616)

City, Province, Postal Code: CALEDON


Specifier:

Customer:

Designer: PL

Code reports: CCMC 12472-R

Company:

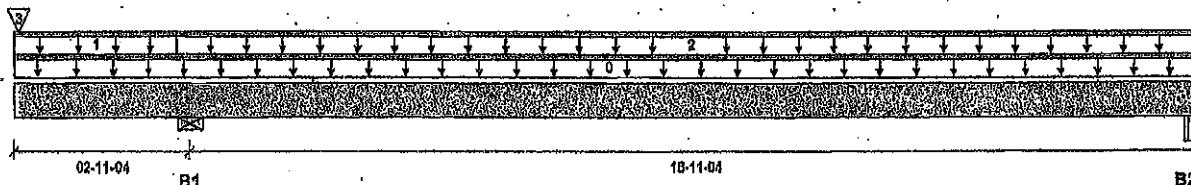

Total Horizontal Product Length = 19-10-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 6-1/2"	878 / 0	469 / 0		
B2, 5"	173 / 73	129 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	19-10-08	Top	10				00-00-00
1	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	02-08-08	Top	11	5			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	02-08-08	19-10-08	Top	20	10			n/a
3	B11(13617)	Conc. Pt. (lbs)	L	00-00-14	00-00-14	Top	405	211			n/a

Controls Summary

Pos. Moment	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Neg. Moment	1,479 ft-lbs	23,220 ft-lbs	6.4%	3	12-02-11
End Shear	-2,848 ft-lbs	-23,220 ft-lbs	11.4%	2	02-11-04
Cont. Shear	355 lbs	11,571 lbs	3.1%	3	18-08-00
Total Load Deflection	938 lbs	11,571 lbs	8.1%	2	01-11-00
Live Load Deflection	L/999 (0.096")	n/a	n/a	10	11-09-00
Total Neg. Defl.	2xL/1,998 (0.079")	n/a	n/a	12	00-00-00
Max Defl.	L/999 (-0.062")	n/a	n/a	9	08-03-1
Span / Depth	0.095"	n/a	n/a	10	11-09-02

Bearing Supports

Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1 Wall/Plate 6-1/2" x 3-1/2"	1,591 lbs	19.3%	6.8%	Unspecified
B2 Beam 5" x 3-1/2"	421 lbs	5.6%	2.0%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets User specified (2xL/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Cantilevers require sheathed bottom flanges, blocking at cantilever support and closure at ends.

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

UWB NO. TAM 19570-19H
STRUCTURAL
COMPONENT ONLY

T-1901158



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLOOR FRAMING\Flush Beams\B10 CANT(13616)**

Dry | 2 spans | L cant.

PASSED

November 6, 2018 16:02:10

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING\Flu...eams\B10 CANT(13616)

Specifier:

Designer: PL

Company:

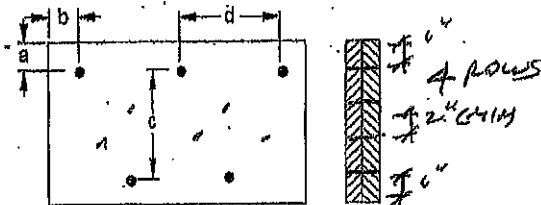Connection Diagram: Full Length of Member

a minimum = 1/2"

c = 1-1/2"

b minimum = 3"

d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 3-1/2" ARDOX SPIRAL

3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AIS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DRGNO.TAM 195619H
STRUCTURAL
COMPONENT ONLY

E-190115861



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING Flush Beams B9 (I3459)

Dry | 1 span | No cant.

November 6, 2018 15:56:05

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING Flush Beams B9 (I3459)

Specifier:

Designer: PL

Company:

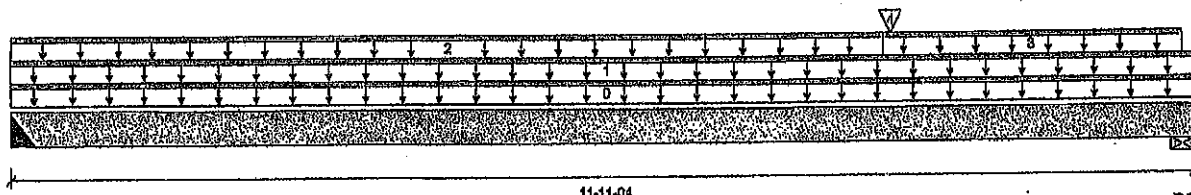

B1

11-11-04

B2

Total Horizontal Product Length = 11-11-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4"	168 / 0	497 / 0		
B2, 5-1/2"	388 / 0	620 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	11-11-04	Top	1.00	0.85	1.00	1.15	00-00-00
1	WALL	Unf. Lin. (lb/ft)	L	00-00-00	11-11-04	Top		60			n/a
2	FC2 Floor Material	Unf. Lin. (lb/ft)	L	00-00-00	08-08-04	Top	12	6			n/a
3	FC2 Floor Material	Unf. Lin. (lb/ft)	L	08-08-04	11-08-12	Top	15	8			n/a
4	B11(I3617)	Conc. Pt. (lbs)	L	08-10-02	08-10-02	Top	405	211			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	2,107 ft-lbs	15,083 ft-lbs	14.0%	0	08-07-07
End Shear	1,211 lbs	11,571 lbs	10.5%	1	10-08-04
Total Load Deflection	L/999 (0.106")	n/a	n/a	4	08-01-11
Live Load Deflection	L/999 (0.037")	n/a	n/a	5	08-04-09
Max Defl.	0.106"	n/a	n/a	4	08-01-11
Span / Depth	14.2				

Bearing Supports	Dim. (LxW)	Demand	Demand/Support	Demand/Resistance Member	Material
B1 Hanger	4" x 3-1/2"	688 lbs	n/a	6.3%	HGUS410
B2 Wall/Plate	5-1/2" x 3-1/2"	1,357 lbs	16.6%	6.8%	Unspecified

Cautions

Header for the hanger HGUS410 at B1 is a Triple 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HGUS410 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.



THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

DWNN.YAM 195 7-18H
STRUCTURAL
COMPONENT ONLY
p6 '12

T-19011639



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMG 12472-R

Dry | 1 span | No cant.

November 8, 2018 15:58:05

File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B9\13459

Specifier:

Designer: PL

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-00-00, Bottom: 00-00-00.

Hanger Manufacturer: Unassigned.

Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012


BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2016 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connection Diagram: Full Length of Member



4 Rows
12" Center
7 1/2"

a minimum = 4"
b minimum = 3"

c = 7 1/2"
d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCIO®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
DWNG. YAM 1957-1911
STRUCTURAL
COMPONENT ONLY

T-1901115963



Boles Canada



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLOOR FRAMING\Flush Beams\B12\13696

PASSED

November 6, 2018 15:58:05

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B12\13696

Specifier:

Designer: PL

Company:

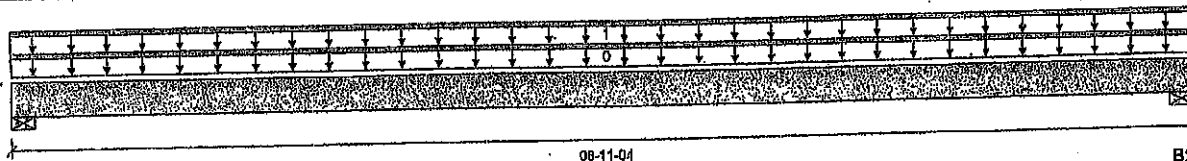

Total Horizontal Product Length = 08-11-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-3/4"	2,574 / 0	1,330 / 0		
B2, 5-1/2"	2,574 / 0	1,330 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-11-04	Top	1.00	0.65	1.00	1.16	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-00	08-11-04	Top	576	288			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	10,395 ft-lbs	23,220 ft-lbs	44.8%	1	04-05-04
End Shear	4,357 lbs	11,571 lbs	37.7%	1	01-02-04
Total Load Deflection	L/559 (0.176")	n/a	43.0%	4	04-05-04
Live Load Deflection	L/899 (0.116")	n/a	n/a	5	04-05-04
Max Defl.	0.176"	n/a	n/a	4	04-05-04
Span / Depth	10.4				

Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4-3/4" x 3-1/2"	5,523 lbs	77.8%	27.2%	Unspecified
B2	Wall/Plate 5-1/2" x 3-1/2"	5,524 lbs	67.2%	23.5%	Unspecified



Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA 086.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA 086.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

CONFORMS TO OBC 2012

BWD NO. TAM 195B-18H
STRUCTURAL
COMPONENT ONLY

T-1901160



Boise Cascade



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant,

November 8, 2018 15:58:05


File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B12\13696

Specifier:

Designer: PL

Company:

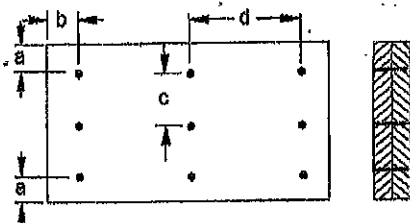Connection Diagram: Full Length of Member

a minimum = 2"
b minimum = 3"

c = 2-3/4"
d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
Connectors are: 3-1/2" ARDOX SPIRAL

**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
DWG NO. TAM 1958-19H
STRUCTURAL
COMPONENT ONLY

F190116060



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B13(13812)

November 8, 2018 15:58:05

BCALCO Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B13(13812)

Specifier:

Designer: PL

Company:

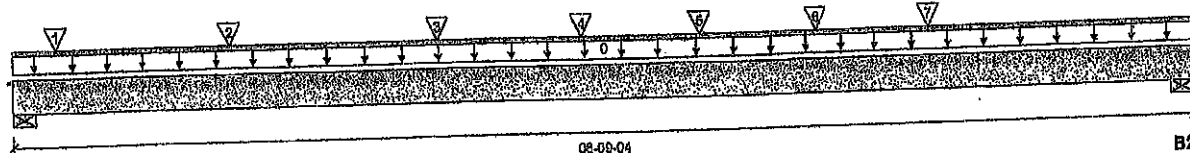

Total Horizontal Product Length = 06-09-04

Reaction Summary (Down / Uplift) (lbs)


Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1,854 / 0	957 / 0		
B2, 7-3/4"	1,070 / 0	568 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	06-09-04	Top	1.00	0.65	1.00	1.18	00-00-00
1	-	Conc. Pt. (lbs)	L	00-03-00	00-03-00	Top	572	286			n/a
2	-	Conc. Pt. (lbs)	L	01-03-00	01-03-00	Top	616	308			n/a
3	-	Conc. Pt. (lbs)	L	02-05-02	02-05-02	Top	660	329			n/a
4	J2(13828)	Conc. Pt. (lbs)	L	03-03-00	03-03-00	Top	316	158			n/a
5	J3(13814)	Conc. Pt. (lbs)	L	03-11-00	03-11-00	Top	349	174			n/a
6	J4(13590)	Conc. Pt. (lbs)	L	04-07-00	04-07-00	Top	37	18			n/a
7	J3(13814)	Conc. Pt. (lbs)	L	05-03-00	05-03-00	Top	349	174			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	4,530 ft-lbs	23,220 ft-lbs	19.5%	1	03-03-00
End Shear	2,748 lbs	11,571 lbs	23.8%	1	01-01-00
Total Load Deflection	L/999 (0.04")	n/a	n/a	4	03-02-00
Live Load Deflection	L/999 (0.026")	n/a	n/a	6	03-02-00
Max Defl.	0.04"	n/a	n/a	4	03-02-00
Span / Depth	7.5				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 3-1/2"	3,977 lbs	78.0%	26.6%	Unspecified
B2	Wall/Plate 7-3/4" x 3-1/2"	2,315 lbs	19.9%	7.0%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-01-12, Bottom: 00-01-12.

Resistance Factor phi has been applied to all presented results per CSA O86.

BCALCO analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

OWNED BY TAM 1959-18H
STRUCTURAL
COMPONENT ONLY

T-1901461



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLOOR FRAMING\Flush Beams\B13\B13(13812)**

Dry | 1 span | No cant.

PASSED

November 6, 2018 16:58:05

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: GCMC 12472-R


File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B13\B13(13812)

Specifier:

Designer: PL

Company:

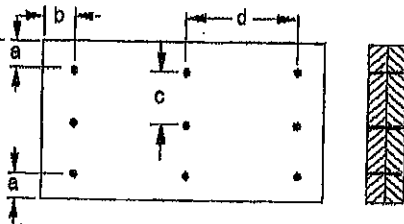Connection Diagram: Full Length of Member

a minimum = 2"

c = 2-3/4" "

b minimum = 3"

d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.


Connectors are: Nails

3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC I®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
 DWR NO. TAM 1959-19H
 STRUCTURAL
 COMPONENT ONLY

T-19011161(2)



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B11(13617)

Dry | 1 span | No cant.

November 6, 2018 15:58:05

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B11(13617)

Specifier:

Designer: PL

Company:



B1

03-04-08

B2

Total Horizontal Product Length = 03-04-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	415 / 0	216 / 0		
B2, 2"	396 / 0	205 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-04-08	Top	1.00	0.05	1.00	1.15	00-00-00
1	STAIRS	Unf. Lin. (lb/ft)	L	00-00-00	03-04-08	Top	240	120			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	613 ft-lbs	11,610 ft-lbs	5.3%	1	01-08-12
End Shear	355 lbs	5,785 lbs	6.1%	1	01-00-08
Total Load Deflection	L/999 (0.003")	n/a	n/a	4	01-08-12
Live Load Deflection	L/999 (0.002")	n/a	n/a	5	01-08-12
Max Defl.	0.003"	n/a	n/a	4	01-08-12
Span / Depth	3.0				

Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 3" x 1-3/4"	892 lbs	n/a	13.8%	HUS1.81/10
B2	Hanger 2" x 1-3/4"	849 lbs	n/a	19.8%	LS90

Cautions

Header for the hanger HUS1.81/10 at B1 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Header for the hanger LS90 at B2 is a Double 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model LS90 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

DIWANG, TAM 1960-18H
STRUCTURAL
COMPONENT ONLY

T-1701462



Boise Cascade



Triple 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP

2ND FLOOR FRAMING/Flush Beams/B15(13621)

Dry | 1 span | No cant.

PASSED

November 8, 2018 16:58:05

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3.mmdl

Description: 2ND FLOOR FRAMING/Flush Beams/B15(13621)

Specifier:

Designer: PL

Company:

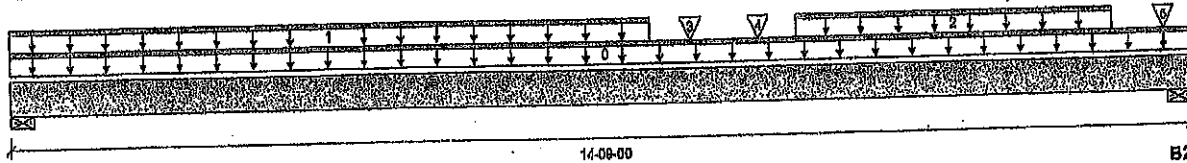

Total Horizontal Product Length = 14-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	4,280 / 0	2,275 / 0		
B2, 3-1/2"	4,338 / 0	2,299 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary 00-00-00
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-09-00	Top		18			n/a
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-00	07-10-14	Top	582	290			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	08-09-00	13-09-00	Top	575	287			n/a
3	-	Conc. Pt. (lbs)	L	08-04-15	08-04-15	Top	532	266			n/a
4	-	Conc. Pt. (lbs)	L	09-03-03	09-03-03	Top	576	288			n/a
5	-	Conc. Pt. (lbs)	L	14-05-00	14-05-00	Top	517	308			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	31,828 ft-lbs	55,212 ft-lbs	57.6%	1	07-04-14
End Shear	8,177 lbs	21,696 lbs	37.7%	1	01-03-06
Total Load Deflection	L/306 (0.563")	n/a	78.6%	4	07-04-14
Live Load Deflection	L/466 (0.368")	n/a	77.2%	5	07-04-14
Max Defl.	0.563"	n/a	n/a	4	07-04-14
Span / Depth	14.4				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 5-1/4"	9,278 lbs	77.7%	41.4%	Unspecified
B2	Wall/Plate 3-1/2" x 5-1/4"	9,380 lbs	78.6%	41.8%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

CONFORMS TO OBC 2012

DWG NO. TAM 19617-18H
STRUCTURAL
COMPONENT ONLY

T-19011163



Triple 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B15\13621

Dry | 1 span | No cant.

November 6, 2018 15:58:05

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports:

CCMC 12472-R

File name: PRESTON 3.mmdl


Description: 2ND FLOOR FRAMING\Flush Beams\B15\13621

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

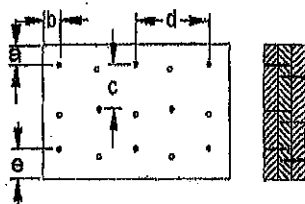

a minimum = 2"

b minimum = 3"

c = 3-1/2"

d = 4"

e minimum = 3"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 7 Nails

3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure the adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BOISE CASCADE, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC1®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,
DWG NO. TAM 1961-18
STRUCTURAL
COMPONENT ONLY

T-180116362



Triple 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING/Flush Beams/B16(4018)

Dry | 1 span | No oant.

November 6, 2018 16:17:31

BC CALCO Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3 ELEV 1(5 BED).mmdl

Description: 2ND FLOOR FRAMING/Flush Beams/B16(4018)

Specifier:

Designer: PL

Company:

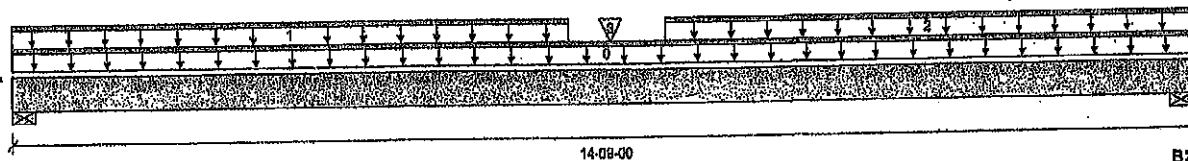

Total Horizontal Product Length = 14-09-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	4,283 / 0	2,276 / 0		
B2, 3-1/2"	4,282 / 0	2,276 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	14-09-00	Top	1.00	0.66	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-00	08-10-14	Top	582	280			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	08-01-00	14-09-00	Top	690	285			n/a
3	-	Conc. Pt. (lbs)	L	07-04-15	07-04-15	Top	620	310			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	31,878 ft-lbs	55,212 ft-lbs	57.7%	1	07-04-14
End Shear	8,184 lbs	21,688 lbs	37.7%	1	01-03-08
Total Load Deflection	L/304 (0.584")	n/a	78.9%	4	07-04-14
Live Load Deflection	L/468 (0.368")	n/a	77.3%	6	07-04-14
Max Defl.	0.884"	n/a	n/a	4	07-04-14
Span / Depth	14.4				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 5-1/4"	9,284 lbs	77.8%	41.4%	Unspecified
B2	Wall/Plate 3-1/2" x 5-1/4"	9,283 lbs	77.8%	41.4%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012

BC CALCO analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

OWNED BY TAM 1962-18H
STRUCTURAL
COMPONENT ONLY p614

T. 19011164



Boise Cascade

**Triple 1-3/4" x 11-7/8" VERSA-LAM® 2.0 3100 SP****2ND FLOOR FRAMING\Flush Beams\B16(14018)**

Dry | 1 span | No cant.

PASSED

November 6, 2018 16:17:31

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CQMC 12472-R


File name: PRESTON 3 ELEV 1(5 BED).mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B16(14018)

Specifier:

Designer: PL

Company:

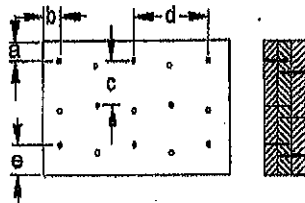Connection Diagram: Full Length of Member

a minimum = 2"

b minimum = 3"

c = 3-1/2"

d = 4"

e minimum = 3"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Nailing schedule applies to both sides of the member.

Connectors are: 3" Nails

3-1/2" ARDOX SPIRAL**Disclosure**

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

DWGN. TAM 1962-181
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™,
ALLJOIST®, BC RIM BOARD™, BC®,
BOISE GLULAM™, BC FloorValue®,
VERSA-LAM®, VERSA-RIM PLUS®,

T-19011646



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****PASSED**

BC CALC® Member Report

Build 8476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

Dry | 1 span | No cant.

November 6, 2018 16:17:31


File name: PRESTON 3 ELEV 1(6 BED).mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B17(13843)

Specifier:

Designer: PL

Company:

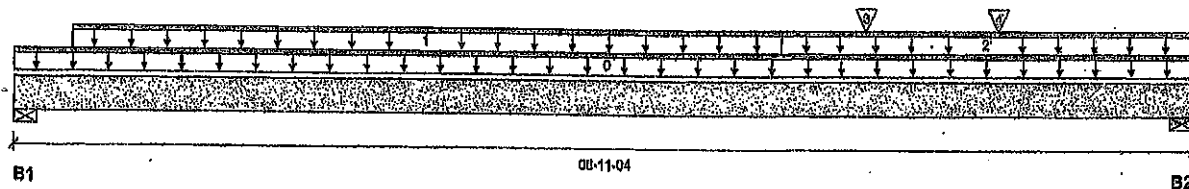

Total Horizontal Product Length = 08-11-04

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4-3/4"	2,442 / 0	1,280 / 0		
B2, 5-1/2"	2,581 / 0	1,332 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-11-04	Top	1.00	0.85	1.00	1.15	00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-05-04	05-09-04	Top	849	324			n/a
2	Smoothed Load	Unf. Lin. (lb/ft)	L	05-09-04	08-11-04	Top	313	156			n/a
3	J3(13845)	Conc. Pt. (lbs)	L	08-05-04	08-05-04	Top	305	183			n/a
4	J3(4001)	Conc. Pt. (lbs)	L	07-05-04	07-05-04	Top	281	131			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	10,323 ft-lbs	23,220 ft-lbs	44.5%	1	04-05-04
End Shear	4,519 lbs	11,571 lbs	39.1%	1	01-02-04
Total Load Deflection	L/558 (0.177")	n/a	43.0%	4	04-05-04
Live Load Deflection	L/999 (0.117")	n/a		5	04-05-04
Max Defl.	0.177"	n/a		4	04-05-04
Span / Depth	10.4				



Bearing Supports	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4-3/4" x 3-1/2"	5,238 lbs	73.7%	25.8%	Unspecified
B2	Wall/Plate 5-1/2" x 3-1/2"	5,537 lbs	87.3%	23.6%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWNN, YAM 1963 JTH
STRUCTURAL
COMPONENT ONLY

T-1901165



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

2ND FLOOR FRAMING\Flush Beams\B17\13843

PASSED

November 8, 2018 16:17:31

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 3 ELEV 1(5 BED).mmdl


Description: 2ND FLOOR FRAMING\Flush Beams\B17\13843

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

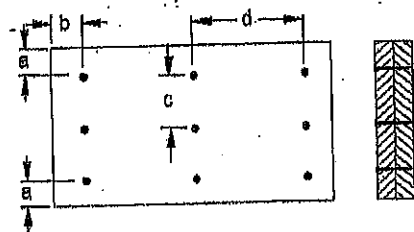

a minimum = 2"

c = 2-3/4"

b minimum = 3"

d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

Connectors are: 3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of Input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

ANDONG.TAM 1967-1811
STRUCTURAL
COMPONENT ONLY

T-1901116561



Boise Cascade

**Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP****2ND FLOOR FRAMING\Flush Beams\B18(13948)****PASSED**

BC CALC® Member Report

Dry | 1 span | No cant.

November 6, 2018 16:17:31

Build 6476

Job name:

File name: PRESTON 3 ELEV 1(6 BED).mmd

Address:

Description: 2ND FLOOR FRAMING\Flush Beams\B18(13948)

City, Province, Postal Code: CALEDON

Specifier:


Customer:

Designer: PL

Code reports:

CCMC 12472-R

Company:

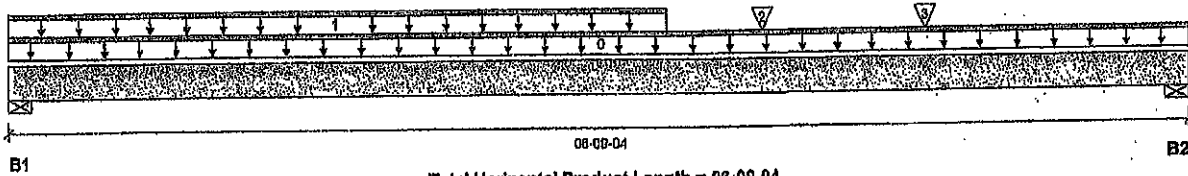**Reaction Summary (Down / Uplift) (lbs)**


Bearing	Live	Dead	Snow	Wind
B1, 3-1/2"	1,852 / 0	957 / 0		
B2, 7-3/4"	1,089 / 0	569 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.65	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	08-09-04	Top		10			00-00-00
1	Smoothed Load	Unf. Lin. (lb/ft)	L	00-00-00	03-09-00	Top	812	306			n/a
2	"	Conc. Pt. (lbs)	L	04-03-08	04-03-08	Top	298	149			n/a
3	J3(13918)	Conc. Pt. (lbs)	L	05-03-00	05-03-00	Top	305	153			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	4,651 ft-lbs	23,220 ft-lbs	20.0%	1	03-03-00
End Shear	2,747 lbs	11,671 lbs	23.7%	1	01-01-00
Total Load Deflection	L/999 (0.041")	n/a	n/a	4	03-01-08
Live Load Deflection	L/999 (0.027")	n/a	n/a	5	03-01-08
Max Defl.	0.041"	n/a	n/a	4	03-01-08
Span / Depth	7.5				

**Bearing Supports**

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 3-1/2" x 3-1/2"	3,975 lbs	78.0%	28.6%	Unspecified
B2	Wall/Plate 7-3/4" x 3-1/2"	2,314 lbs	19.9%	7.0%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume unbraced length of Top: 00-01-12, Bottom: 00-01-12.

Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCQ 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DUPLICATE 1964-18H
STRUCTURAL
COMPONENT ONLY

T-19011166



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP
2ND FLOOR FRAMING\Flush Beams\B18(13946)

PASSED

November 6, 2018 16:17:31

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 3 ELEV 1(5 BED).mmdl


Description: 2ND FLOOR FRAMING\Flush Beams\B18(13946)

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

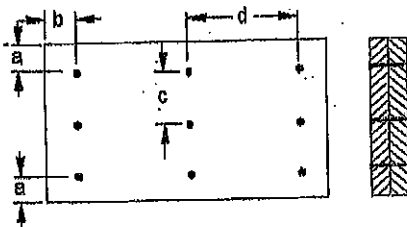

a minimum = 2"
b minimum = 3"

c = 2-3/4"
d = 4"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.
Connectors are: 3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®

DWG NO. FAW 1964-18H
STRUCTURAL
COMPONENT 3XL

T-19011166(v)



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B20(14785)

Dry | 1 span | No cant.

November 7, 2018 07:45:54

BC CALC® Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: COMC 12472-R


File name: PRESTON 3 ELEV 2.mxd

Description: 1ST FLOOR FRAMING\Flush Beams\B20(14785)

Specifier:

Designer: PL

Company:

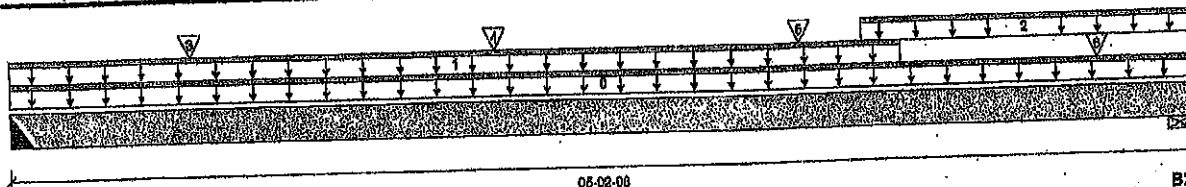

Total Horizontal Product Length = 05-02-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 3"	916 / 0	482 / 0		
B2, 3-1/2"	704 / 0	489 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.66	Snow 1.00	Wind 1.18	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	05-02-08	Top		5			00-00-00
1	STAIRS	Unf. Lin. (lb/ft)	L	00-00-00	03-11-00	Top	240	120			n/a
2	E24(14146)	Unf. Lin. (lb/ft)	L	03-09-00	05-02-08	Top		81			n/a
3	J6(14784)	Conc. Pt. (lbs)	L	00-09-08	00-09-08	Top	160	80			n/a
4	J6(14787)	Conc. Pt. (lbs)	L	02-01-08	02-01-08	Top	195	97			n/a
5	J6(14782)	Conc. Pt. (lbs)	L	03-05-08	03-05-08	Top	195	97			n/a
6	J6(14783)	Conc. Pt. (lbs)	L	04-09-08	04-09-08	Top	128	84			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	2,232 ft-lbs	11,610 ft-lbs	19.2%	1	02-04-08
End Shear	1,330 lbs	5,785 lbs	23.0%	1	01-00-08
Total Load Deflection	L/999 (0.026")	n/a	n/a	4	02-07-00
Live Load Deflection	L/999 (0.017")	n/a	n/a	5	02-06-08
Max Defl.	0.026"	n/a	n/a	4	02-07-00
Span / Depth	6.1				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Hanger 3" x 1-3/4"	1,975 lbs	n/a	30.8%	HUS1.81/10
B2	Wall/Plate 3-1/2" x 1-3/4"	1,642 lbs	50.2%	22.0%	Unspecified

Cautions

Header for the hanger HUS1.81/10 at B1 is a Single 1-3/4" x 9-1/2" VERSA-LAM® 1.7 2400 DF. Hanger model HUS1.81/10 and seat length were input by the user. Hanger has not been analyzed for adequate capacity.

DWG NO. TAM 1965-184
STRUCTURAL
COMPONENT ONLY

T-1901167



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B20(14785)

Dry | 1 span | No cant.

November 7, 2018 07:45:54

BC CALC® Member Report

Build 0475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 3 ELEV 2.mmd

Description: 1ST FLOOR FRAMING\Flush Beams\B20(14785)

Specifier:

Designer: PL

Company:

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Hanger Manufacturer: Unassigned

Resistance Factor phi has been applied to all presented results per CSA O86. CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Design based on Dry Service Condition.

Importance Factor : Normal Part code : Part 9



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current installation Guide and applicable building codes. To obtain installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCI®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

OWNED BY TAM 196578H
STRUCTURAL
COMPONENT ONLY PLW

T-1901167(2)



Boise Cascade



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B21(14615)

Dry | 1 span | No cant.

November 7, 2018 07:46:54

BC CALC® Member Report

Build 6475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports:

CCMC 12472-R


File name: PRESTON 3 ELEV 2.mmdl

Description: 2ND FLOOR FRAMING\Flush Beams\B21(14615)

Specifier:

Designer: PL

Company:

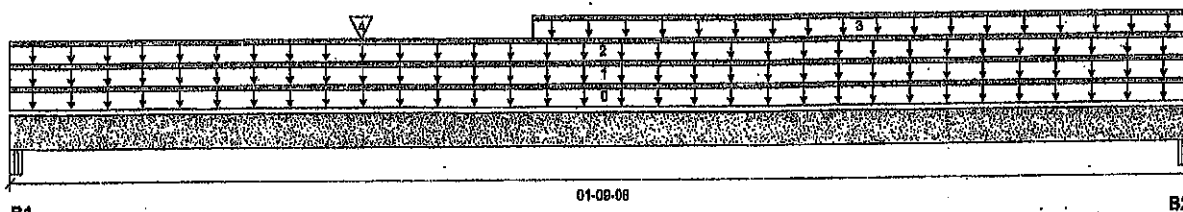

Total Horizontal Product Length = 01-09-08

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 6"	319 / 0	404 / 0	760 / 0	
B2, 6"	127 / 0	202 / 0	369 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.15	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-09-08	Top	5				00-00-00
1	LOW ROOF	Unf. Lin. (lb/ft)	L	00-00-00	01-09-08	Top	33	30	102		n/a
2	16(14606)	Unf. Lin. (lb/ft)	L	00-00-00	01-09-08	Top		81			n/a
3	16(14606)	Unf. Lin. (lb/ft)	L	00-09-08	01-09-08	Top	61	65	187		n/a
4	-	Conc. Pt. (lbs)	L	00-06-06	00-06-06	Top	325	344	749		n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	318 ft-lbs	11,610 ft-lbs	2.7%	13	00-06-08
End Shear	365 lbs	5,785 lbs	6.3%	13	00-07-00
Total Load Deflection	L/999 (0")	n/a	n/a	35	00-10-04
Live Load Deflection	L/999 (0")	n/a	n/a	51	00-10-02
Max Defl.	0"	n/a	n/a	35	00-10-04
Span / Depth	1.4				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam 6" x 1-3/4"	1,949 lbs	41.7%	18.3%	Unspecified
B2	Beam 6" x 1-3/4"	933 lbs	20.0%	8.7%	Unspecified

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BC®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86: CONFORMS TO OBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

OWNED BY 1966-18H
STRUCTURAL
COMPONENT ONLY

T-19011168



Single 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

2ND FLOOR FRAMING\Flush Beams\B22\14807

November 7, 2018 07:45:54

BC CALC® Member Report

Build 8476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports:

CCMC 12472-R


File name: PRESTON 3 ELEV 2.mxd

Description: 2ND FLOOR FRAMING\Flush Beams\B22\14807

Specifier:

Designer: PL

Company:

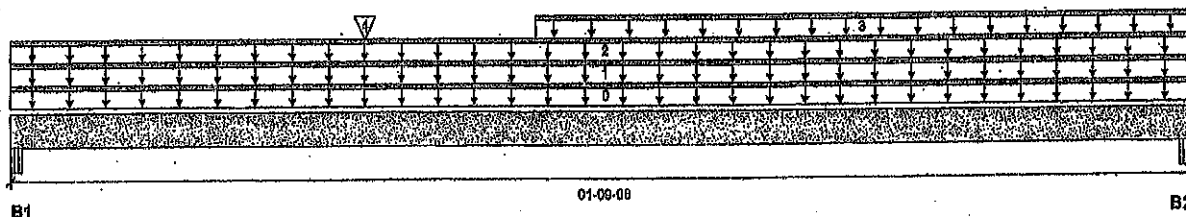

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 5"	318 / 0	403 / 0	748 / 0	
B2, 5"	128 / 0	204 / 0	371 / 0	

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live	Dead	Snow	Wind	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	01-09-08	Top	5				00-00-00
1	LOW ROOF	Unf. Lin. (lb/ft)	L	00-00-00	01-09-08	Top	33	30	102		n/a
2	15\14805	Unf. Lin. (lb/ft)	L	00-00-00	01-09-08	Top		81			n/a
3	15\14805	Unf. Lin. (lb/ft)	L	00-09-08	01-09-08	Top	61	66	187		n/a
4		Conc. Pt. (lbs)	L	00-06-06	00-06-06	Top	326	344	749		n/a

Controls Summary

Pos.	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Moment	323 ft-lbs	11,810 ft-lbs	2.8%	13	00-06-08
End Shear	370 lbs	5,785 lbs	6.4%	13	00-07-00
Total Load Deflection	L/999 (0")	n/a	n/a	35	00-10-02
Live Load Deflection	L/999 (0")	n/a	n/a	51	00-10-02
Max Defl.	0"	n/a	n/a	35	00-10-02
Span / Depth	1.4				



Bearing Supports

Bearing	Support	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Beam	5" x 1-3/4"	1,944 lbs	41.6%	18.2%	Unspecified
B2	Beam	5" x 1-3/4"	940 lbs	20.1%	8.8%	Unspecified

Notes

Design meets Code minimum (L/240) Total load deflection criteria.

Design meets Code minimum (L/360) Live load deflection criteria.

Calculations assume member is fully braced.

Resistance Factor phi has been applied to all presented results per CSA O86.

CONFORMS TO CBC 2012

BC CALC® analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA O86.

Unbalanced snow loads determined from building geometry were used in selected product's verification.

Design based on Dry Service Condition.

Importance Factor: Normal Part code: Part 9

Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCi®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

OWNED BY TAM 1967-18H
STRUCTURAL
COMPONENT ONLY

T-19011169



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING/Flush Beams/B1A(13841)

Dry | 1 span | No cant.

January 15, 2019 09:51:52

BC CALCO Member Report

Build 6476

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R


File name: PRESTON 3 ELEV 1(4 BED).mmdl

Description: 1ST FLOOR FRAMING/Flush Beams/B1A(13841)

Specifier:

Designer: PL

Company:

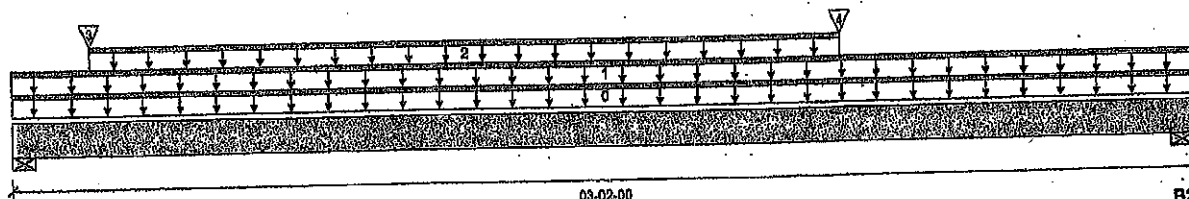

Total Horizontal Product Length = 03-02-00

Reaction Summary (Down / Uplift) (lbs)

Bearing	Live	Dead	Snow	Wind
B1, 4"	86 / 0	194 / 0		
B2, 4"	79 / 0	191 / 0		

Load Summary

Tag	Description	Load Type	Ref.	Start	End	Loc.	Live 1.00	Dead 0.85	Snow 1.00	Wind 1.18	Tributary
0	Self-Weight	Unf. Lin. (lb/ft)	L	00-00-00	03-02-00	Top		10			00-00-00
1	E13(1508)	Unf. Lin. (lb/ft)	L	00-00-00	03-02-00	Top	24	98			n/a
2	FC1 Floor Material	Unf. Lin. (lb/ft)	L	00-02-08	02-02-08	Top	27	13			n/a
3	Bk37(14011)	Conc. Pt. (lbs)	L	00-02-08	00-02-08	Top	6				n/a
4	Bk38(13993)	Conc. Pt. (lbs)	L	02-02-08	02-02-08	Top	29	15			n/a

Controls Summary

	Factored Demand	Factored Resistance	Demand/Resistance	Case	Location
Pos. Moment	151 ft-lbs	15,093 ft-lbs	1.0%	0	01-07-05
End Shear	151 lbs	11,571 lbs	1.3%	1	02-00-08
Total Load Deflection	L/999 (0")	n/a	n/a	4	01-07-00
Live Load Deflection	L/999 (0")	n/a	n/a	5	01-07-05
Max Defl.	0"	n/a	n/a	4	01-07-00
Span / Depth	3.3				



Bearing Supports

	Dim. (LxW)	Demand	Demand/Resistance Support	Demand/Resistance Member	Material
B1	Wall/Plate 4" x 3-1/2"	272 lbs	5.6%	2.4%	Unspecified
B2	Wall/Plate 4" x 3-1/2"	267 lbs	5.6%	2.4%	Unspecified

Notes

- Design meets Code minimum (L/240) Total load deflection criteria.
- Design meets Code minimum (L/360) Live load deflection criteria.
- Calculations assume member is fully braced.
- Resistance Factor phi has been applied to all presented results per CSA 086. CONFORMS TO OBC 2012
- BC CALCO analysis is based on Canadian Limit States Design, as per NBCC 2015 and CSA 086.
- Design based on Dry Service Condition.
- Importance Factor: Normal Part code: Part 9
- Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of Record.

DWG NO. TAM 1968-19H
STRUCTURAL
COMPONENT ONLY

T-19011170



Double 1-3/4" x 9-1/2" VERSA-LAM® 2.0 3100 SP

PASSED

1ST FLOOR FRAMING\Flush Beams\B1A(13841)

January 15, 2019 09:51:52

BC CALC® Member Report

Build 8475

Job name:

Address:

City, Province, Postal Code: CALEDON

Customer:

Code reports: CCMC 12472-R

File name: PRESTON 3 ELEV 1(4 BED).mmdl


Description: 1ST FLOOR FRAMING\Flush Beams\B1A(13841)

Specifier:

Designer: PL

Company:

Connection Diagram: Full Length of Member

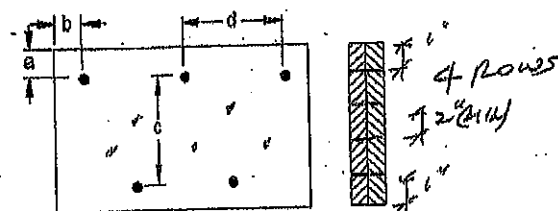

a minimum = 0"
b minimum = 3"

c = 1-1/2"
d = 6"

Connection design assumes point load is top-loaded. For connection design of side-loaded point loads, please consult a technical representative or professional of record.
Connectors are: Nails

3-1/2" ARDOX SPIRAL



Disclosure

Use of the Boise Cascade Software is subject to the terms of the End User License Agreement (EULA). Completeness and accuracy of input must be reviewed and verified by a qualified engineer or other appropriate expert to assure its adequacy, prior to anyone relying on such output as evidence of suitability for a particular application. The output here is based on building code-accepted design properties and analysis methods. Installation of Boise Cascade engineered wood products must be in accordance with current Installation Guide and applicable building codes. To obtain Installation Guide or ask questions, please call (800)232-0788 before installation.


UNDESIGNED 1968
STRUCTURAL
COMPONENT ONLY

BC CALC®, BC FRAMER®, AJS™, ALLJOIST®, BC RIM BOARD™, BCIO®, BOISE GLULAM™, BC FloorValue®, VERSA-LAM®, VERSA-RIM PLUS®,

T-190117062

Maximum Floor Spans


Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing



Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-0"	16'-0"	15'-1"	13'-11"	17'-5"	16'-1"	15'-1"	13'-11"
	NI-60	17'-2"	16'-2"	15'-5"	14'-3"	17'-6"	16'-5"	15'-5"	14'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-6"	18'-5"	17'-3"	16'-7"	15'-6"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	15'-10"
11-7/8"	NI-20	17'-10"	16'-10"	16'-0"	14'-10"	18'-6"	17'-1"	16'-0"	14'-10"
	NI-40x	19'-4"	17'-11"	17'-3"	15'-10"	19'-11"	18'-6"	17'-9"	15'-10"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-1"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-5"	22'-1"	20'-6"	19'-6"	17'-5"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-2"	13'-4"	12'-4"	15'-7"	14'-2"	13'-4"	12'-4"
	NI-40x	17'-9"	16'-1"	15'-1"	13'-11"	17'-9"	16'-1"	15'-1"	13'-11"
	NI-60	18'-1"	16'-5"	15'-5"	14'-3"	18'-1"	16'-5"	15'-5"	14'-3"
	NI-70	19'-10"	17'-11"	16'-9"	15'-6"	19'-10"	17'-11"	16'-9"	15'-6"
	NI-80	20'-2"	18'-3"	17'-1"	15'-10"	20'-2"	18'-3"	17'-1"	15'-10"
11-7/8"	NI-20	18'-10"	17'-1"	16'-0"	14'-10"	18'-10"	17'-1"	16'-0"	14'-10"
	NI-40x	21'-3"	19'-3"	17'-9"	15'-10"	21'-3"	19'-3"	17'-9"	15'-10"
	NI-60	21'-9"	19'-8"	18'-5"	17'-1"	21'-9"	19'-8"	18'-5"	17'-1"
	NI-70	23'-4"	21'-5"	20'-1"	18'-6"	23'-8"	21'-5"	20'-1"	18'-6"
	NI-80	23'-7"	21'-10"	20'-5"	18'-11"	24'-1"	21'-10"	20'-5"	18'-11"
14"	NI-90x	24'-3"	22'-6"	21'-3"	19'-7"	24'-8"	22'-7"	21'-3"	19'-7"
	NI-40x	24'-2"	21'-5"	19'-6"	17'-5"	24'-2"	21'-5"	19'-6"	17'-5"
	NI-60	24'-9"	22'-5"	21'-0"	19'-6"	24'-9"	22'-5"	21'-0"	19'-6"
	NI-70	26'-1"	24'-3"	22'-9"	21'-0"	26'-8"	24'-3"	22'-9"	21'-0"
	NI-80	26'-6"	24'-7"	23'-3"	21'-6"	27'-1"	24'-10"	23'-3"	21'-6"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-4"	27'-9"	25'-10"	24'-3"	22'-4"
	NI-60	27'-3"	24'-11"	23'-5"	21'-7"	27'-6"	24'-11"	23'-5"	21'-7"
	NI-70	28'-8"	26'-8"	25'-3"	23'-4"	29'-3"	26'-11"	25'-3"	23'-4"
	NI-80	29'-1"	27'-0"	25'-9"	23'-10"	29'-8"	27'-6"	25'-10"	23'-10"
	NI-90x	29'-11"	27'-10"	26'-6"	24'-10"	30'-6"	28'-5"	26'-11"	24'-10"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of $1.50L + 1.25D$. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of $L/480$ and a total load deflection limit of $L/240$.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.





Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-2"	13'-9"	N/A	15'-7"	14'-8"	14'-2"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-8"	15'-3"	14'-5"	N/A	16'-8"	15'-3"	14'-5"	N/A
	NI-40x	17'-11"	16'-11"	16'-1"	N/A	18'-5"	17'-1"	16'-1"	N/A
	NI-60	18'-2"	17'-1"	16'-4"	N/A	18'-7"	17'-4"	16'-4"	N/A
	NI-70	19'-2"	17'-10"	17'-2"	N/A	19'-7"	18'-3"	17'-7"	N/A
	NI-80	19'-5"	18'-0"	17'-4"	N/A	19'-10"	18'-5"	17'-8"	N/A
11-7/8"	NI-20	19'-6"	18'-1"	17'-3"	N/A	19'-11"	18'-3"	17'-3"	N/A
	NI-40x	21'-0"	19'-6"	18'-8"	N/A	21'-7"	20'-2"	19'-2"	N/A
	NI-60	21'-4"	19'-9"	18'-11"	N/A	21'-11"	20'-4"	19'-6"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-5"	20'-5"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-8"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-11"	20'-11"	N/A	24'-3"	22'-7"	21'-7"	N/A
	NI-60	24'-0"	22'-3"	21'-3"	N/A	24'-8"	22'-11"	21'-11"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-11"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	25'-3"	24'-2"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.




Maximum Floor Spans

Live Load = 40 psf, Dead Load = 15 psf
Simple Spans, L/480 Deflection Limit
3/4" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-10"	15'-0"	14'-5"	13'-5"	16'-4"	15'-5"	14'-6"	13'-5"
	NI-40x	17'-0"	16'-0"	15'-5"	14'-9"	17'-5"	16'-5"	15'-10"	15'-2"
	NI-60	17'-2"	16'-2"	15'-7"	14'-11"	17'-6"	16'-7"	15'-11"	15'-3"
	NI-70	18'-0"	16'-11"	16'-3"	15'-7"	18'-5"	17'-3"	16'-7"	15'-11"
	NI-80	18'-3"	17'-1"	16'-5"	15'-9"	18'-8"	17'-5"	16'-9"	16'-1"
11-7/8"	NI-20	17'-10"	16'-10"	16'-2"	15'-6"	18'-6"	17'-4"	16'-9"	16'-1"
	NI-40x	19'-4"	17'-11"	17'-3"	16'-6"	19'-11"	18'-6"	17'-9"	17'-0"
	NI-60	19'-7"	18'-2"	17'-5"	16'-9"	20'-2"	18'-9"	17'-11"	17'-2"
	NI-70	20'-9"	19'-2"	18'-3"	17'-5"	21'-4"	19'-9"	18'-10"	17'-10"
	NI-80	21'-1"	19'-5"	18'-6"	17'-7"	21'-7"	20'-0"	19'-0"	18'-0"
14"	NI-90x	21'-8"	20'-0"	19'-1"	18'-0"	22'-2"	20'-6"	19'-6"	18'-6"
	NI-40x	21'-5"	19'-10"	18'-11"	17'-11"	22'-1"	20'-6"	19'-7"	18'-7"
	NI-60	21'-10"	20'-2"	19'-3"	18'-2"	22'-5"	20'-10"	19'-11"	18'-10"
	NI-70	23'-0"	21'-3"	20'-3"	19'-2"	23'-8"	21'-11"	20'-10"	19'-9"
	NI-80	23'-5"	21'-7"	20'-7"	19'-5"	24'-0"	22'-3"	21'-2"	20'-0"
16"	NI-90x	24'-1"	22'-3"	21'-2"	20'-0"	24'-8"	22'-10"	21'-9"	20'-7"
	NI-60	23'-9"	22'-0"	20'-11"	19'-10"	24'-6"	22'-9"	21'-8"	20'-6"
	NI-70	25'-1"	23'-2"	22'-0"	20'-10"	25'-9"	23'-10"	22'-9"	21'-6"
	NI-80	25'-6"	23'-6"	22'-4"	21'-2"	26'-1"	24'-2"	23'-1"	21'-10"
	NI-90x	26'-4"	24'-3"	23'-1"	21'-10"	26'-11"	24'-11"	23'-8"	22'-5"

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	16'-10"	15'-5"	14'-6"	13'-5"	16'-10"	15'-5"	14'-6"	13'-5"
	NI-40x	18'-8"	17'-2"	16'-3"	15'-2"	18'-10"	17'-2"	16'-3"	15'-2"
	NI-60	18'-11"	17'-6"	16'-6"	15'-5"	19'-2"	17'-6"	16'-6"	15'-5"
	NI-70	20'-0"	18'-7"	17'-9"	16'-7"	20'-5"	18'-11"	17'-10"	16'-7"
	NI-80	20'-3"	18'-10"	17'-11"	16'-10"	20'-8"	19'-3"	18'-2"	16'-10"
11-7/8"	NI-20	20'-1"	18'-5"	17'-5"	16'-2"	20'-1"	18'-5"	17'-5"	16'-2"
	NI-40x	21'-10"	20'-4"	19'-4"	17'-8"	22'-5"	20'-6"	19'-4"	17'-8"
	NI-60	22'-1"	20'-7"	19'-7"	18'-4"	22'-8"	20'-10"	19'-8"	18'-4"
	NI-70	23'-4"	21'-8"	20'-8"	19'-7"	23'-10"	22'-3"	21'-2"	19'-9"
	NI-80	23'-7"	21'-11"	20'-11"	19'-9"	24'-1"	22'-6"	21'-5"	20'-0"
14"	NI-90x	24'-3"	22'-6"	21'-6"	20'-4"	24'-8"	23'-0"	22'-0"	20'-9"
	NI-40x	24'-5"	22'-9"	21'-8"	19'-5"	25'-1"	23'-2"	21'-9"	19'-5"
	NI-60	24'-10"	23'-1"	22'-0"	20'-10"	25'-6"	23'-8"	22'-4"	20'-10"
	NI-70	26'-1"	24'-3"	23'-2"	21'-10"	26'-8"	24'-11"	23'-9"	22'-4"
	NI-80	26'-6"	24'-7"	23'-5"	22'-2"	27'-1"	25'-3"	24'-1"	22'-9"
16"	NI-90x	27'-3"	25'-4"	24'-1"	22'-9"	27'-9"	25'-11"	24'-8"	23'-4"
	NI-60	27'-3"	25'-5"	24'-2"	22'-10"	28'-0"	26'-2"	24'-9"	23'-1"
	NI-70	28'-8"	26'-8"	25'-4"	23'-11"	29'-3"	27'-4"	26'-1"	24'-8"
	NI-80	29'-1"	27'-0"	25'-9"	24'-4"	29'-8"	27'-9"	26'-5"	25'-0"
	NI-90x	29'-11"	27'-10"	26'-6"	25'-0"	30'-6"	28'-5"	27'-2"	25'-8"

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 15 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 3/4 inch for a joist spacing of 24 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Maximum Floor Spans

Live Load = 40 psf, Dead Load = 30 psf
Simple Spans, L/480 Deflection Limit
5/8" OSB G&N Sheathing

Depth	Series	Bare				1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-1"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	16'-1"	15'-2"	14'-8"	N/A	16'-7"	15'-7"	15'-1"	N/A
	NI-60	16'-3"	15'-4"	14'-10"	N/A	16'-8"	15'-9"	15'-3"	N/A
	NI-70	17'-1"	16'-1"	15'-6"	N/A	17'-5"	16'-5"	15'-10"	N/A
	NI-80	17'-3"	16'-3"	15'-8"	N/A	17'-8"	16'-7"	16'-0"	N/A
11-7/8"	NI-20	16'-11"	16'-0"	15'-5"	N/A	17'-6"	16'-6"	16'-0"	N/A
	NI-40x	18'-1"	17'-0"	16'-5"	N/A	18'-9"	17'-6"	16'-11"	N/A
	NI-60	18'-4"	17'-3"	16'-7"	N/A	19'-0"	17'-8"	17'-1"	N/A
	NI-70	19'-6"	18'-0"	17'-4"	N/A	20'-1"	18'-7"	17'-9"	N/A
	NI-80	19'-9"	18'-3"	17'-6"	N/A	20'-4"	18'-10"	17'-11"	N/A
14"	NI-90x	20'-4"	18'-9"	17'-11"	N/A	20'-10"	19'-3"	18'-5"	N/A
	NI-40x	20'-1"	18'-7"	17'-10"	N/A	20'-10"	19'-4"	18'-6"	N/A
	NI-60	20'-5"	18'-11"	18'-1"	N/A	21'-2"	19'-7"	18'-9"	N/A
	NI-70	21'-7"	20'-0"	19'-1"	N/A	22'-3"	20'-7"	19'-8"	N/A
	NI-80	21'-11"	20'-3"	19'-4"	N/A	22'-7"	20'-11"	20'-0"	N/A
16"	NI-90x	22'-7"	20'-11"	19'-11"	N/A	23'-3"	21'-6"	20'-6"	N/A
	NI-60	22'-3"	20'-8"	19'-9"	N/A	23'-1"	21'-5"	20'-6"	N/A
	NI-70	23'-6"	21'-9"	20'-9"	N/A	24'-3"	22'-5"	21'-5"	N/A
	NI-80	23'-11"	22'-1"	21'-1"	N/A	24'-8"	22'-10"	21'-9"	N/A
	NI-90x	24'-8"	22'-9"	21'-9"	N/A	25'-4"	23'-5"	22'-4"	N/A

Depth	Series	Mid-Span Blocking				Mid-Span Blocking and 1/2" Gypsum Ceiling			
		On Centre Spacing				On Centre Spacing			
		12"	16"	19.2"	24"	12"	16"	19.2"	24"
9-1/2"	NI-20	15'-7"	14'-1"	13'-3"	N/A	15'-7"	14'-1"	13'-3"	N/A
	NI-40x	17'-9"	16'-1"	15'-1"	N/A	17'-9"	16'-1"	15'-1"	N/A
	NI-60	18'-1"	16'-4"	15'-4"	N/A	18'-1"	16'-4"	15'-4"	N/A
	NI-70	19'-2"	17'-10"	16'-9"	N/A	19'-7"	17'-10"	16'-9"	N/A
	NI-80	19'-5"	18'-0"	17'-1"	N/A	19'-10"	18'-3"	17'-1"	N/A
11-7/8"	NI-20	18'-9"	17'-0"	16'-0"	N/A	18'-9"	17'-0"	16'-0"	N/A
	NI-40x	21'-0"	19'-3"	17'-9"	N/A	21'-3"	19'-3"	17'-9"	N/A
	NI-60	21'-4"	19'-8"	18'-5"	N/A	21'-8"	19'-8"	18'-5"	N/A
	NI-70	22'-6"	20'-10"	19'-11"	N/A	23'-0"	21'-4"	20'-0"	N/A
	NI-80	22'-9"	21'-1"	20'-1"	N/A	23'-3"	21'-7"	20'-5"	N/A
14"	NI-90x	23'-4"	21'-8"	20'-8"	N/A	23'-10"	22'-2"	21'-2"	N/A
	NI-40x	23'-7"	21'-5"	19'-6"	N/A	24'-1"	21'-5"	19'-6"	N/A
	NI-60	24'-0"	22'-3"	21'-0"	N/A	24'-8"	22'-5"	21'-0"	N/A
	NI-70	25'-3"	23'-4"	22'-3"	N/A	25'-10"	24'-0"	22'-9"	N/A
	NI-80	25'-7"	23'-8"	22'-7"	N/A	26'-2"	24'-4"	23'-2"	N/A
16"	NI-90x	26'-4"	24'-4"	23'-3"	N/A	26'-10"	24'-11"	23'-9"	N/A
	NI-60	26'-5"	24'-6"	23'-4"	N/A	27'-2"	24'-10"	23'-4"	N/A
	NI-70	27'-9"	25'-8"	24'-6"	N/A	28'-5"	26'-5"	25'-2"	N/A
	NI-80	28'-2"	26'-1"	24'-10"	N/A	28'-10"	26'-9"	25'-6"	N/A
	NI-90x	29'-0"	26'-10"	25'-7"	N/A	29'-7"	27'-5"	26'-2"	N/A

- Maximum clear span applicable to simple-span residential floor construction with a design live load of 40 psf and dead load of 30 psf. The ultimate limit states are based on the factored loads of 1.50L + 1.25D. The serviceability limit states include the consideration for floor vibration, a live load deflection limit of L/480 and a total load deflection limit of L/240.
- Spans are based on a composite floor with glued-nailed oriented strand board (OSB) sheathing with a minimum thickness of 5/8 inch for a joist spacing of 19.2 inches or less. The composite floor may include 1/2 inch gypsum ceiling and/or one row of blocking at mid-span with strapping. Strapping shall be minimum 1x4 inch strap applied to underside of joists at blocking line or 1/2 inch gypsum ceiling attached to joists.
- Minimum bearing length shall be 1-3/4 inches for the end bearings.
- Bearing stiffeners are not required when I-joists are used with the spans and spacings given in this table, except as required for hangers.
- This span chart is based on uniform loads. For applications with other than uniformly distributed loads, an engineering analysis may be required based on the use of the design properties. Tables are based on Limit States Design per CSA O86-09, NBC 2010, and OBC 2012.
- Joists shall be laterally supported at supports and continuously along the compression edge. Refer to technical documentation for installation guidelines and construction details. Nordic I-joists are listed in CCMC evaluation report 13032-R and APA Product Report PR-L274C.



Construction Detail


Limit States Design

Allowance for Piping (Installation Notes)

The floor layouts have usually not been checked for heating and/or plumbing interference. On-site adjustment of joists of up to 3 inches is permitted to avoid interferences. When moving a joist, the subfloor thickness shall be checked with code requirements when the joist spacing exceeds 19.2 inches. Except for cutting to length, I-joist flanges should never be cut, drilled, or notched.



Installation of Nordic I-joists shall be as per *Nordic Joist Installation Guide for Residential Floors*. Refer to Tables 1 and 2 for maximum web hole and duct chase openings, respectively. These tables are based on the I-joists being used at their maximum spans. The minimum distance given may be reduced for shorter spans; contact your distributor for additional information.

The detail below shows the 3-inch allowance for piping. Every third joist may be shifted up to 3 inches to avoid heating/plumbing interference. For other applications, please contact your distributor.

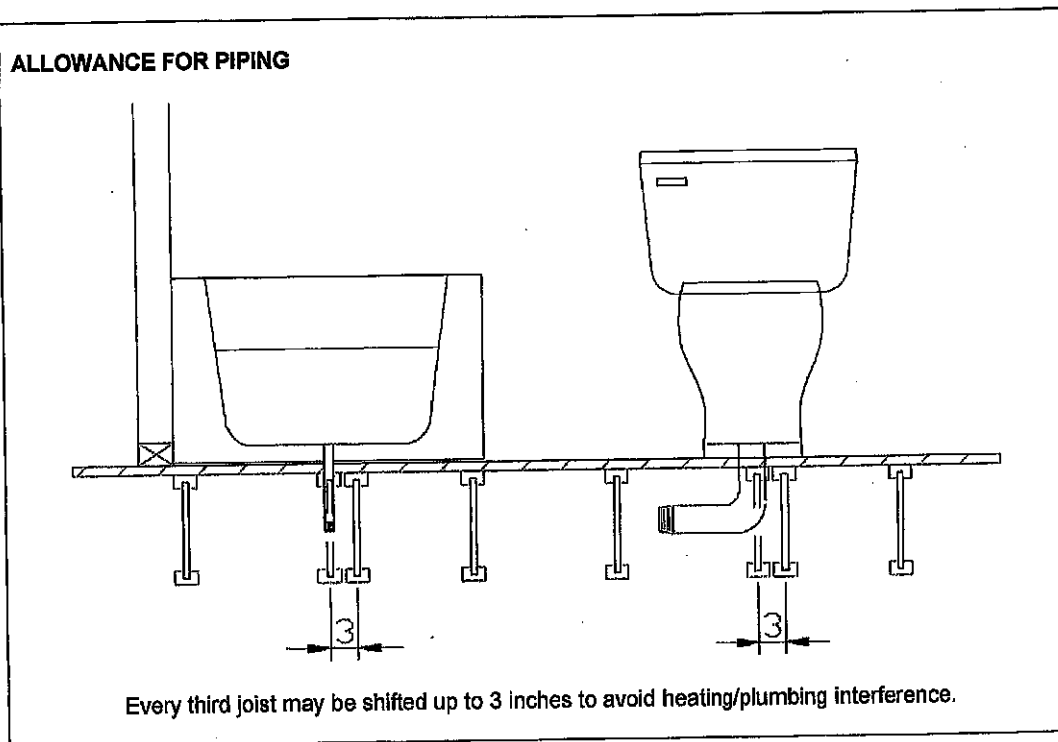

Revised April 12, 2012

1w-1

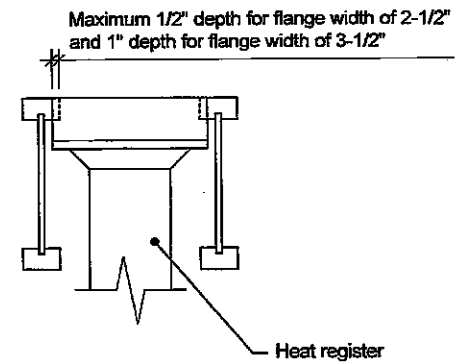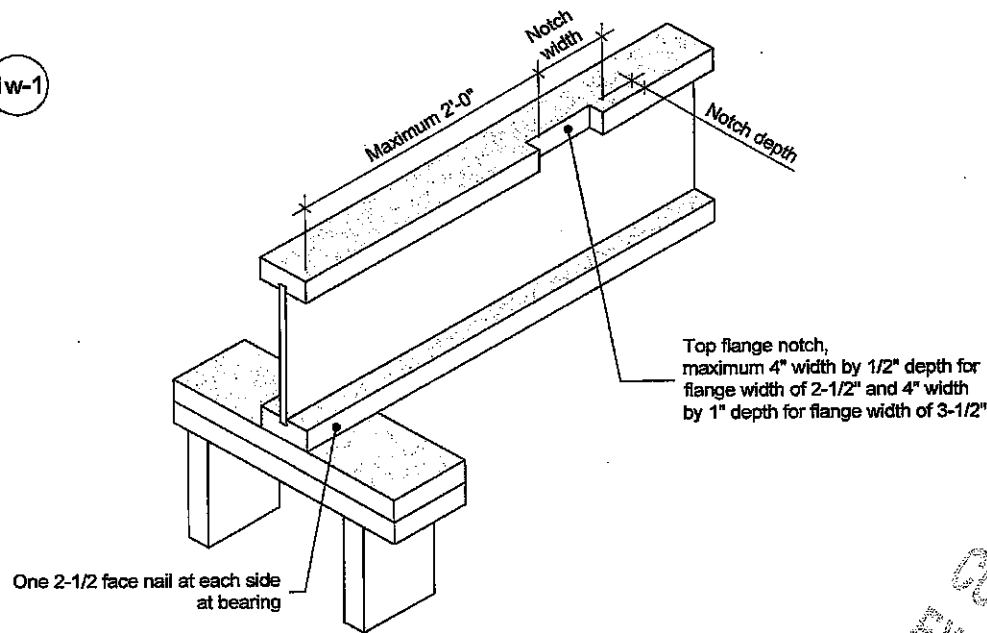

Notes:

1. Blocking required at bearing for lateral support, not shown for clarity.
2. The maximum dimensions for a notch on the side of the top flange are 4-inch width by 1/2-inch depth for flange width of 2-1/2 inches, and 4-inch width by 1-inch depth for flange width of 3-1/2 inches.
3. This detail applies to simple-span joists and multiple-span joists where the notch is located at the end half-span.
4. For other applications, contact Nordic Structures.

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

This document supersedes all previous versions. If the document has been in effect for more than one year, consult nordic.ca or contact Nordic Structures.
All nails shown in the details are assumed to be common nails unless otherwise noted. Nails shall have a diameter not less than 0.128 inch for 2-1/2-inch nails, or 0.144 inch for 3-inch nails. Individual components not shown to scale for clarity.

**NORDIC
STRUCTURES**

T 514-871-8526
1 866 817-3418
nordic.ca

TITLE

Notch in I-joist for Heat Register

CATEGORY

I-joist - Typical Floor Framing and Construction Details

DOCUMENT

DATE

2018-04-10

NUMBER

1w-1