


10/12 ROOF PITCH
UNLESS OTHERWISE SPECIFIED

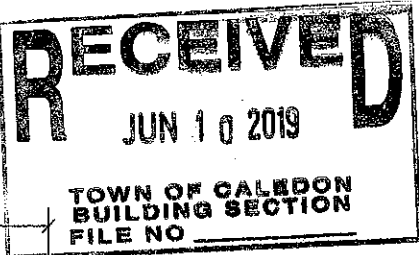

12 " FINISH O.H
R.T.M.C
2X6 EXTERIOR WALLS
ASPHALT SHINGLES
2X6 FASCIA BOARD

DESIGN LOADS:
GS LOAD 1.8 KPA
TC DEAD 6 PSF
BC LIVE 10.5 PSF
BC DEAD 7 PSF

ALL CONVENTIONAL ROOF
FRAMING TO CONFORM TO
PART9 OF THE OBC.LATEST
EDITION ROOF RAFTERS
THAT MEET OR CROSS
OVER TRUSSES ARE TO BE
2"X4" SPF @24"o.c. WITH A
2"X4"SPF VERTICAL POST
TO THE TRUSS UNDER AT
EACH CROSS POINT. POSTS
LONGER THAN 6' TO BE
LATERALLY BRACED SO
THAT THE DISTANCE
BETWEEN END POINTS AND
BETWEEN ROWS OF
BRACING DOES NOT
EXCEED 6'.

TRUSSES DESIGNED
CONFORM TO THE
RELEVANT SECTION OF THE
LATEST EDITION OF THE
ONTARIO BUILDING CODE
(RESIDENTIAL PART 9)


HARDWARE
HGUS26-2(XX)
LUS26-2(VV)
LJS26DS(V)
LUS24(O)

DENOTES
CONVENTIONAL
FRAMING



T- ...

FOR REAR UPGRADE ONLY

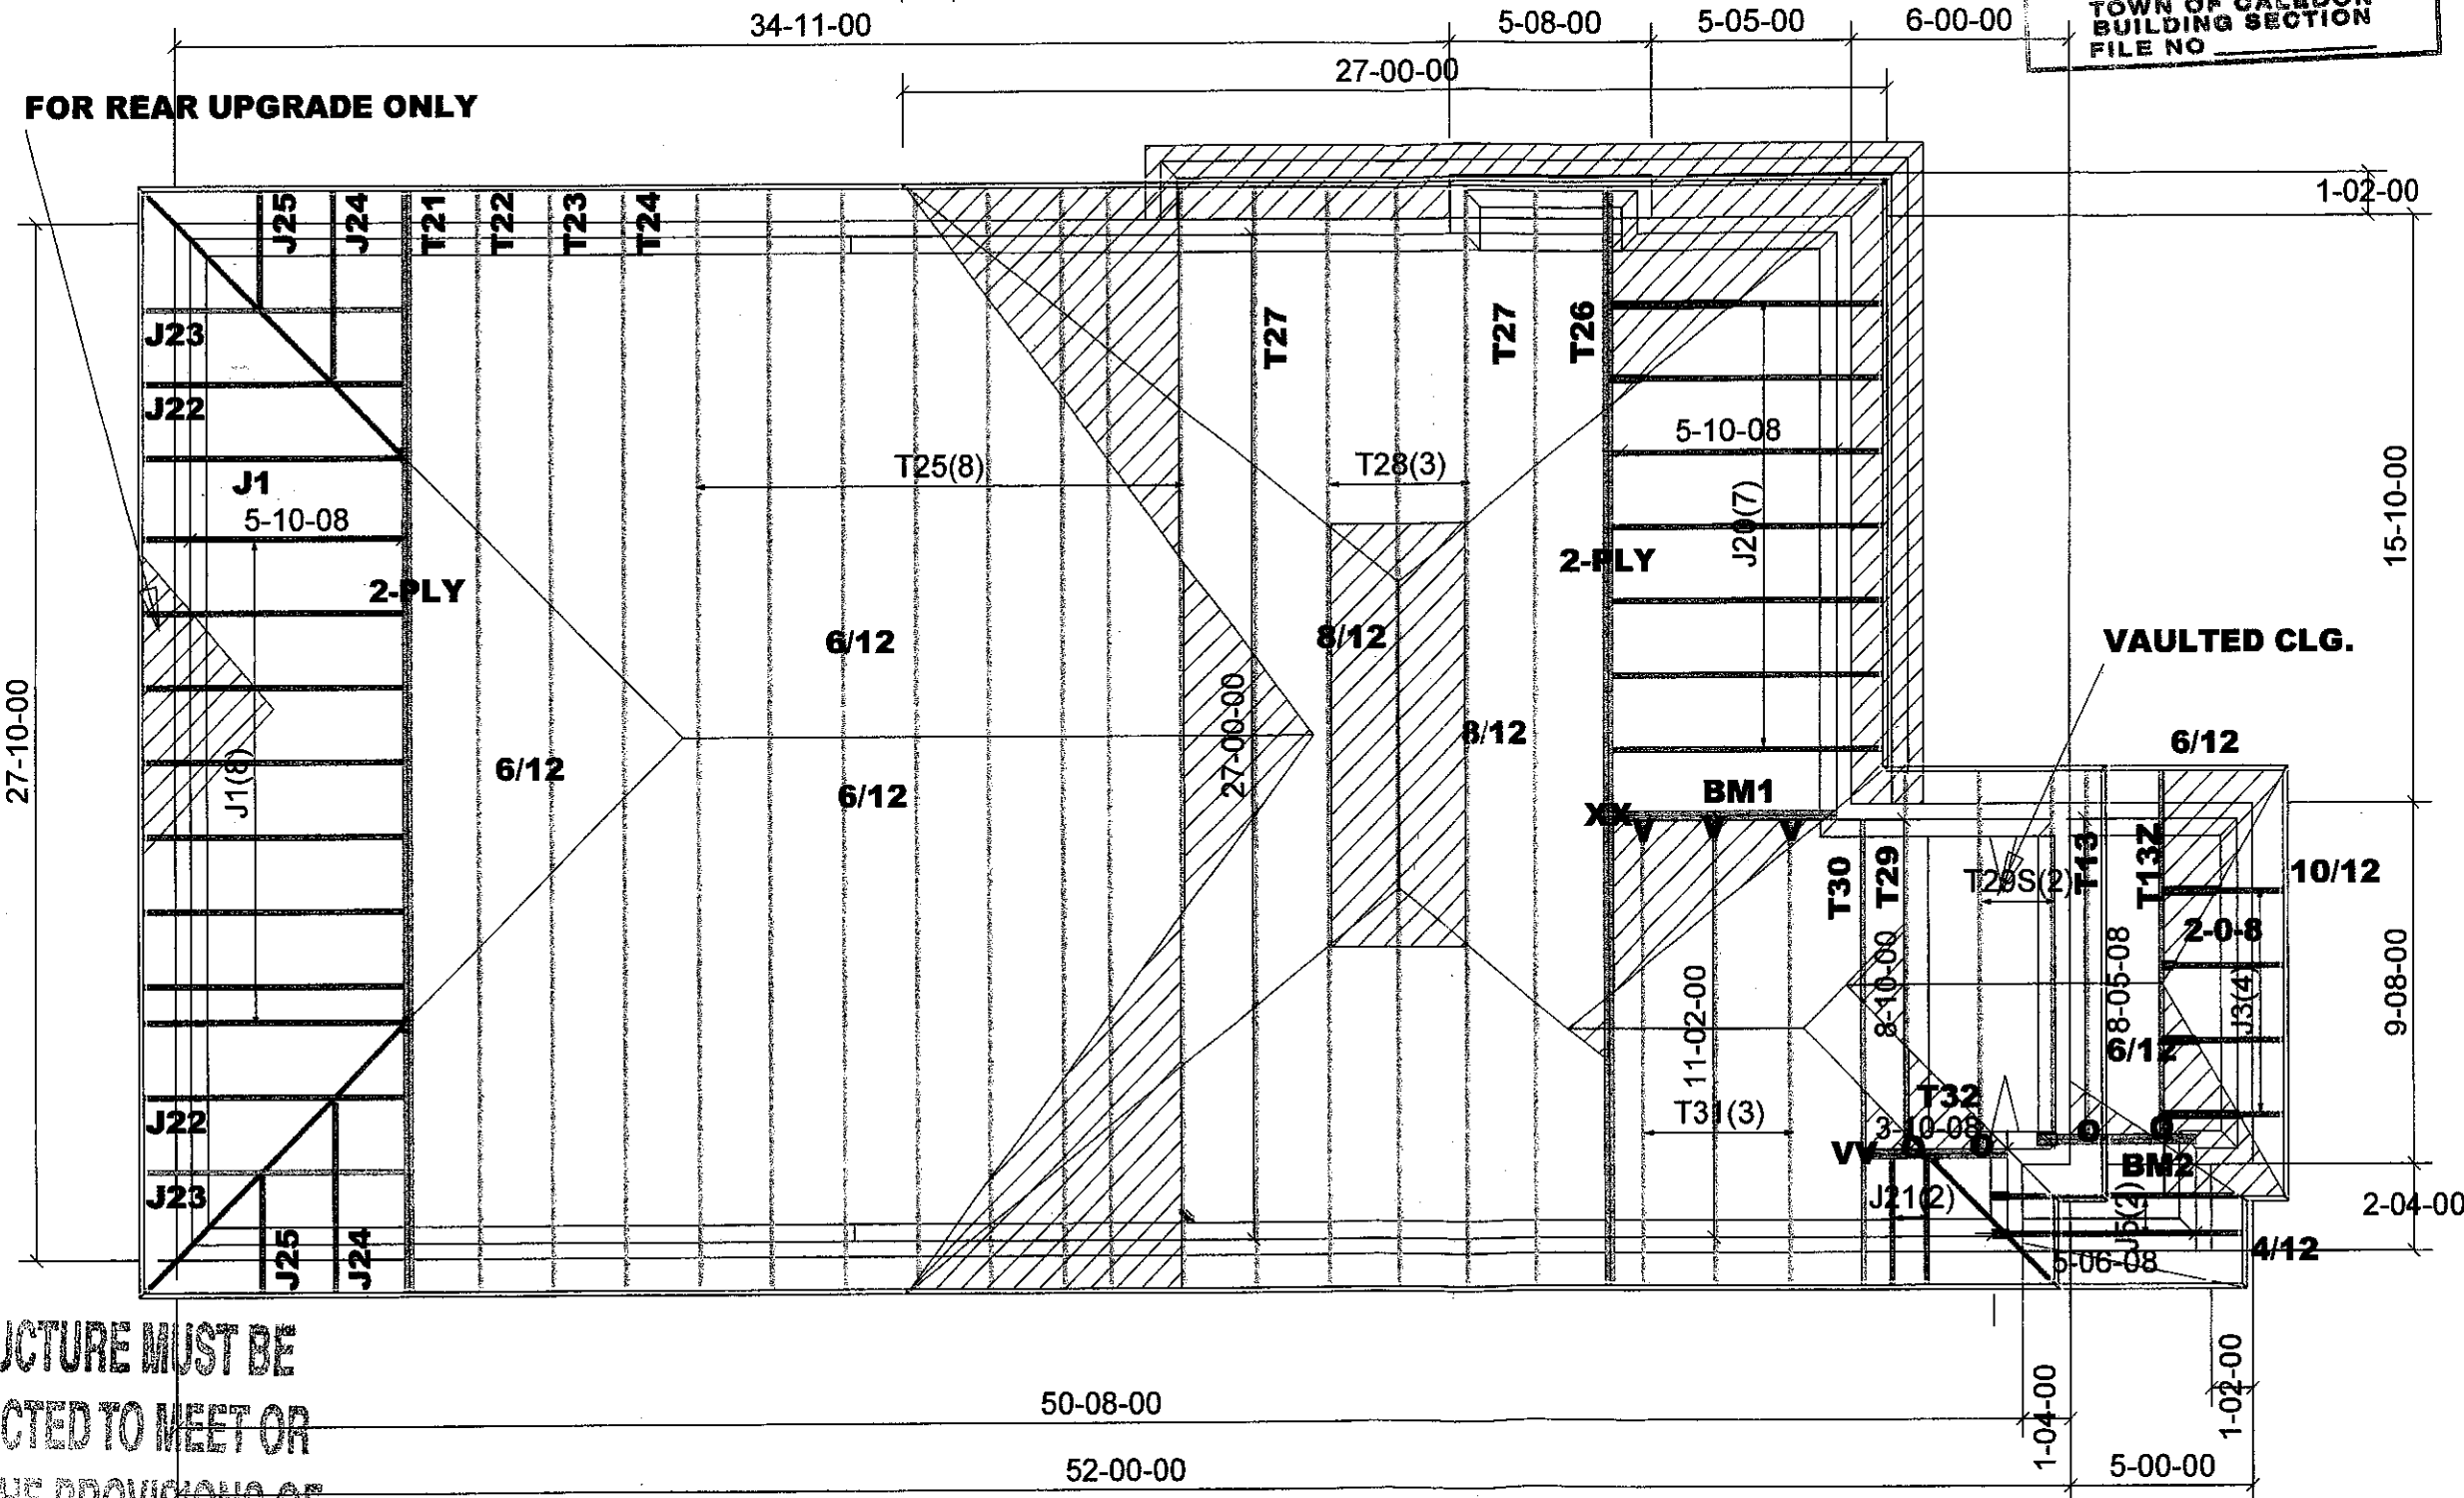

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

M12245



Job Track: 50033	Builder / Location: GREEN PARK HOMES / CALEDON	Model / Elevation: BARTON 1/2 - STD OR REAR UPGRADE	Milek ver 8.2.3.229
Plan Log: 201007	Project: LAMBERT LANE PH.2	THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.	
Layout ID: 402939	Date: 5/3/2019	Sales: Mario DiCano	Designer: JG




DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BARTON 1
 Lot #:
 Elevation: 2 - STD OR REAR UPGRADE

Job Track: 50033
 Plan Log: 201007
 Layout ID: 402939
 Ref #
 Page: 1 of 2
 Date: 05/03/2019
 Designer:
 Sales Rep: Mario DiCano







Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	T13 Common	6 /12	8-05-08	3-02-03	2 x 4 2 x 6	1-03-08	6-12 9-00	30.87 20.33		
	1	T13Z Common Girder	6 /12	8-05-08	3-02-03	2 x 4 2 x 6	1-03-08	6-12 9-00	30.87 20.33		
	1 2-ply	T21 Hip Girder	6 /12	27-00-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	252.71 158.00		
	1	T22 Hip	6 /12	27-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	109.31 68.83		
	1	T23 Hip	6 /12	27-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	110.98 70.67		
	1	T24 Hip	6 /12	27-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	100.67 63.87		
	8	T25 Common	6 /12	27-00-00	7-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	812.08 538.67		
	1 2-ply	T26 Hip Girder	10 /12	27-00-00	5-05-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	269.6 167.33		
	2	T27 Hip	10 /12	27-00-00	6-09-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	254.7 164.00		
	3	T28 Hip	10 /12	27-00-00	8-01-13	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	389.5 248.00		
	1	T29 Common	10 /12	8-10-00	5-03-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	40.97 26.83		
	2	T29S Scissor	10 /12 8 /12	8-10-00	5-03-14	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	82.47 55.67		
	1	T30 Hip Girder	10 /12	11-02-00	4-10-07	2 x 4 2 x 6	1-03-08 1-03-08	1-07-11 1-07-11	62.12 40.67		
	3	T31 Common	10 /12	11-02-00	6-03-08	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	149.15 99.00		

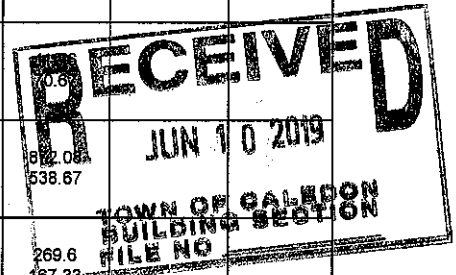

		DELIVERY SHIPLIST	
		Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: LAMBERT LANE PH.2 Location: CALEDON Model: BARTON 1 Lot #: Elevation: 2 - STD OR REAR UPGRADE	Job Track: 50033 PlanLog: 201007 Layout ID: 402939 Ref # Page: 2 of 2 Date: 05/03/2019 Designer: Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T32 Jack-Closed Girder	10 / 12	3-10-08	3-04-08	2 x 4 2 x 6		1-07-11 3-04-08	45.51 30.33		
	9	J1 Jack-Open	6 / 12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	151.15 96.00		
	4	J3 Jack-Open	10 / 12	2-00-08	3-01-14	2 x 4	1-03-08	1-00-07 2-08-14	32.99 24.00		
	2	J5 Jack-Open	4 / 12	5-06-08	2-07-00	2 x 4	1-03-08	3-15 2-02-02	29.29 18.67		
	7	J20 Jack-Open	8 / 12	6-01-08	5-05-13	2 x 4	1-03-08	1-04-13 5-05-13	129.2 84.00		
	2	J21 Jack-Open	10 / 12	2-00-07	3-04-01	2 x 4	1-03-08 0-09	1-07-11 3-04-01	21.01 15.33		
	2	J22 Jack-Open	6 / 12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	J23 Jack-Open Girder	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	J24 Jack-Open	6 / 12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	2	J25 Jack-Open	6 / 12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		


TOTAL # TRUSS= 63 TOTAL BFT OF ALL TRUSSES= 2070.66 BFT. TOTAL WEIGHT OF ALL TRSSES 3261.7 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	HGUS26-2	
3	Hardware	LJS26DS	
4	Hardware	LUS24	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 9

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402938	T13	1	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:48 2019 Page 1			
		ID: VdmZNlanRCr_yT1tp?OGrfzKFlu-bRIE7CzyFNc8GXmPwuSTU?IGCkK0ErjY2r?PxQzIqjX			
		Scale = 1:18.3			

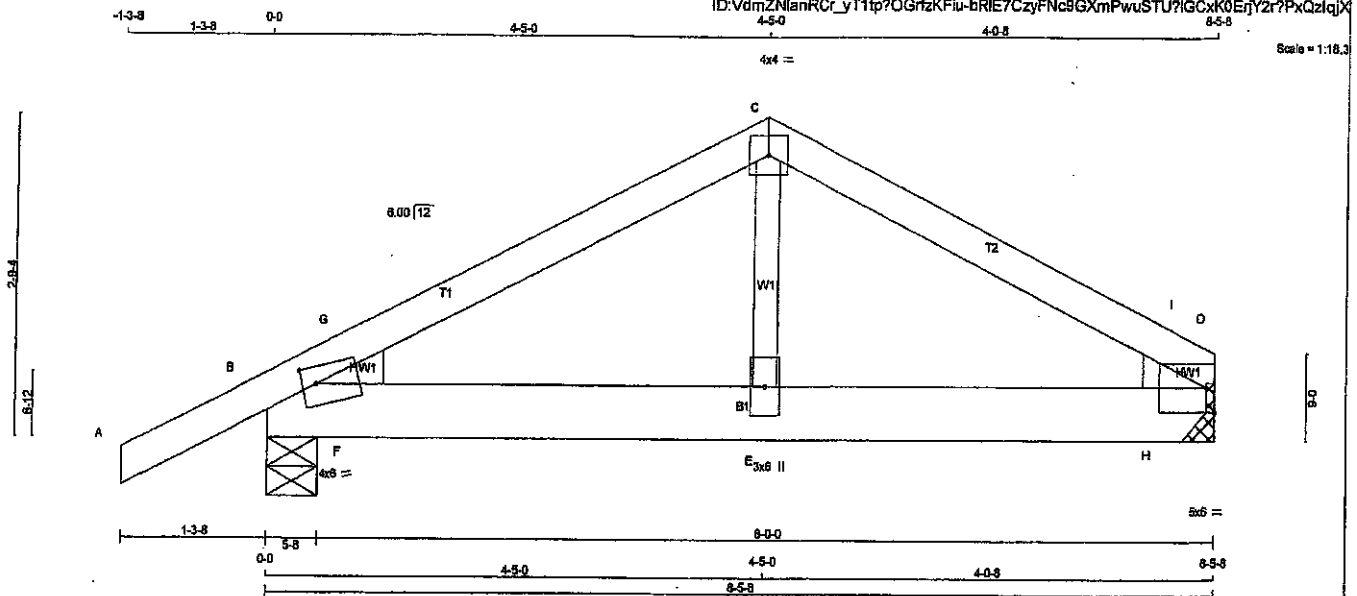

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
B - D	2x6	DRY	No.2	SPF	
ALL WEBS 2x3 DRY					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-m	MT20	4.0	6.0	1.75	1.50
C	TTW-p	MT20	4.0	4.0		
D	TMBH1-l	MT20	5.0	6.0		Edge
E	BMW-w	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD	HEEL
	GROSS REACTION	GROSS REACTION	BRG	BRG	WEDGE
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
B	733	0	733	0	0
D	595	0	595	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 3'-8".

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	540	324 / 0	89 / 0	0 / 0	0 / 0	128 / 0	0 / 0
D	444	246 / 0	89 / 0	0 / 0	0 / 0	110 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLF)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 24	-102.1	-102.1 0.13 (1)	E-C	0 / 278
B-G	-635 / 0	-102.1	-102.1 0.10 (1)	F-G	-244 / 24
G-C	-680 / 0	-102.1	-102.1 0.17 (1)	H-I	-73 / 128
C-I	-655 / 0	-102.1	-102.1 0.14 (1)		
I-D	-713 / 0	-102.1	-102.1 0.13 (1)		
B-F	0 / 572	-38.5	-38.5 0.19 (1)		
F-E	0 / 572	-38.5	-38.5 0.19 (1)		
E-H	0 / 572	-38.5	-38.5 0.14 (1)		
H-D	0 / 572	-38.5	-38.5 0.10 (1)		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.28")
CALCULATED VERT. DEFL. (LL) = L/969 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.28")
CALCULATED VERT. DEFL. (TL) = L/968 (0.02")

CSI: TC=0.17/1.00 (C-G-1), BC=0.19/1.00 (E-F-1), WB=0.08/1.00 (C-E-2), SSI=0.16/1.00 (B-F-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.70 (D) (INPUT = 0.90)
JSI METAL = 0.18 (B) (INPUT = 1.00)

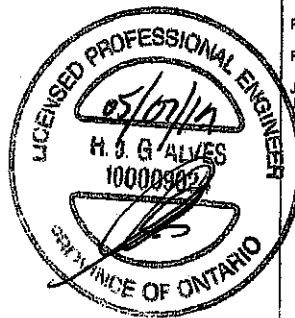

DRWG NO. TAMA 1910771
STRUCTURAL
CLIENT ONLY


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402938	T13Z	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MTEK Industries, Inc. Tue May 7 17:41:49 2019 Page 1

ID: VdmZNlanRCr_yT1tp?OGrtzKFlu-3dldLYza0hk0thLbUbzI0CIQJLgqzGxhGVkyTszlqjVW

Scale = 1:16.0

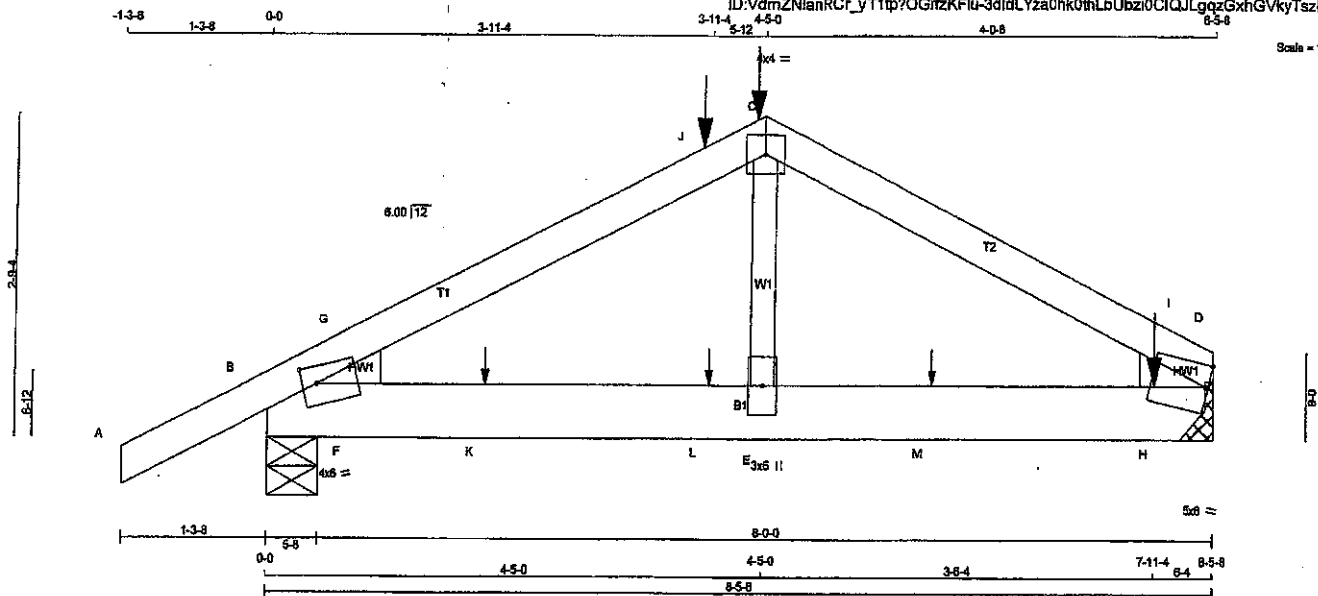

TOTAL WEIGHT = 31 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
B - D	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMBH1-m	MT20	4.0	6.0	1.75	1.50
C TTW-p	MT20	4.0	4.0		
D TMBH1-m	MT20	5.0	6.0	2.25	Edge
E BMW-w	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD	HEEL
	GROSS REACTION	GROSS REACTION	BRG	BRG	WEDGE
JT	VERT	DOWN	HORIZ	UPLIFT	IN-SX
B	808	0	808	0	5-8
D	680	0	680	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	591	387 / 0	89 / 0	0 / 0	0 / 0	135 / 0	0 / 0
D	504	291 / 0	91 / 0	0 / 0	0 / 0	121 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.18 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED MAX. LOAD (LC1)	FACTORED MAX. UNBRACED LENGTH (LC)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO						FR-TO			
A-B	0 / 24	-102.1	-102.1	0.15 (1)	10.00	E-C	0 / 281	0.06 (2)	
B-G	-791 / 0	-102.1	-102.1	0.15 (1)	6.25	F-G	-218 / 28	0.00 (1)	
G-J	-792 / 0	-102.1	-102.1	0.20 (1)	6.25	H-I	0 / 141	0.00 (1)	
J-C	-792 / 0	-102.1	-102.1	0.20 (1)	6.25				
C-I	-787 / 0	-102.1	-102.1	0.21 (1)	6.25				
I-D	-806 / 0	-102.1	-102.1	0.20 (1)	6.18				
B-F	0 / 899	-38.5	-38.5	0.22 (1)	10.00				
F-K	0 / 899	-38.5	-38.5	0.22 (1)	10.00				
K-L	0 / 899	-38.5	-38.5	0.22 (1)	10.00				
L-E	0 / 899	-38.5	-38.5	0.22 (1)	10.00				
E-M	0 / 899	-38.5	-38.5	0.15 (1)	10.00				
M-H	0 / 899	-38.5	-38.5	0.15 (1)	10.00				
H-D	0 / 899	-38.5	-38.5	0.11 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-5-0	-23	-25		FRONT	VERT	DEAD		
C	4-5-0	-129	-129		FRONT	VERT	SNOW		
H	7-11-4	-5	-7		BACK	VERT	TOTAL		
J	3-11-4	-3	-3		BACK	VERT	TOTAL		
K	1-11-4	1	1		BACK	VERT	TOTAL		
L	3-11-4	1	1		BACK	VERT	TOTAL		
M	5-11-4	1	1		BACK	VERT	TOTAL		

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 28.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

*** NON STANDARD GIRDER ***
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-08, CSA 086-14
- TPC 2011, TPC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.28")
CALCULATED VERT. DEFL. (LL) = U/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.28")
CALCULATED VERT. DEFL. (TL) = U/999 (0.02")

CSI: TC=0.21/1.00 (C-E-1), BC=0.22/1.00 (B-F-1),
WB=0.06/1.00 (C-E-2), SS=0.17/1.00 (C-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (D) (INPUT = 0.90)
JSI METAL= 0.21 (B) (INPUT = 1.00)


DRWG NO. TAM 719/0712
COLLECTOR
COMPUTER ONLY

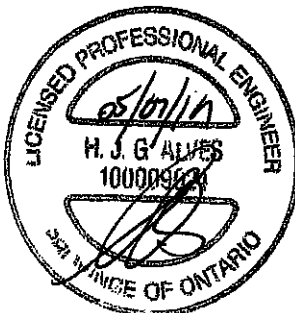

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	T21	1	2	TRUSS DESC.		
Tamarack Roof Truss, Burlington				Version 8.230 S Nov 17 2018 Mittek Industries, Inc. Tue May 7 17:48:13 2019 Page 2 ID: yH3luQzwKBaXQAh?hsf8URzKCTp-gVVnxrdSag6XyilP Fsla8Cy48h4xgRDaeEHyczlqdVW		

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
O	10-1-4	-123	-123	--	FRONT	VERT	TOTAL	--	--
P	12-1-4	-123	-123	--	FRONT	VERT	TOTAL	--	--
Q	14-1-4	-123	-123	--	FRONT	VERT	TOTAL	--	--
R	16-1-4	-123	-123	--	FRONT	VERT	TOTAL	--	--
S	18-1-4	-123	-123	--	FRONT	VERT	TOTAL	--	--
T	20-1-4	-123	-123	--	FRONT	VERT	TOTAL	--	--
U	1-11-4	-55	-74	--	FRONT	VERT	TOTAL	--	--
V	3-11-4	-55	-70	--	FRONT	VERT	TOTAL	--	--
W	8-1-4	-55	-70	--	FRONT	VERT	TOTAL	--	--
X	10-1-4	-55	-70	--	FRONT	VERT	TOTAL	--	--
Y	12-1-4	-55	-70	--	FRONT	VERT	TOTAL	--	--
Z	14-1-4	-55	-70	--	FRONT	VERT	TOTAL	--	--
AA	18-1-4	-55	-70	--	FRONT	VERT	TOTAL	--	--
AB	20-1-4	-55	-70	--	FRONT	VERT	TOTAL	--	--
AC	23-0-12	-55	-70	--	FRONT	VERT	TOTAL	--	--
AD	25-0-12	-55	-74	--	FRONT	VERT	TOTAL	--	--

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

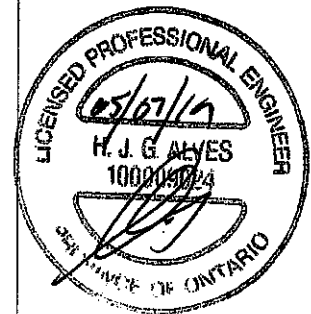


RUE NO. TAM 7910779
STRUCTURAL
CONCRETE ONLY

3/2

JOB NAME 402939	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Tue May 7 17:48:14 2018 Page 1
 ID: yH3luQzwKBaXQAh7hsf8URzKCTp-I3A8Be4LzEOasHbXyN_70K7GYygDEMouVqU2zldv
 1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 5-7-8 13-6-0 5-7-8 19-1-8 3-10-0 22-11-8 4-0-8 1-3-8
 1-3-8 0-0 7-10-8 7-10-8 5-7-8 13-6-0 5-7-8 19-1-8 7-10-8 27-0-0
 Scale = 1:48.8

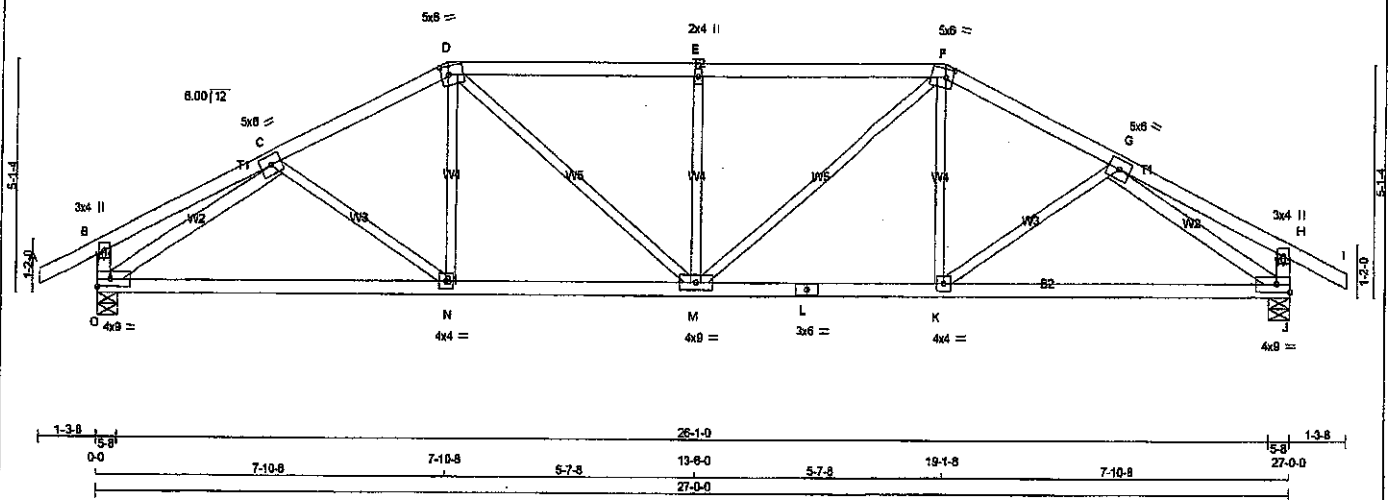

LUMBER			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
O - C	2x4	DRY	No.2
G - J	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMVW-i	MT20	5.0	6.0	
D	TTVW-m	MT20	5.0	6.0	2.25 2.00
E	TMVW-w	MT20	2.0	4.0	
F	TTVW-m	MT20	5.0	6.0	2.25 2.00
G	TMVW-i	MT20	5.0	6.0	
H	TMV+p	MT20	3.0	4.0	
J	BMVW-i	MT20	4.0	9.0	Edge
K	BMVW-i	MT20	4.0	4.0	
L	BS-i	MT20	3.0	6.0	
M	BMVW-i	MT20	4.0	9.0	
N	BMVW-i	MT20	4.0	4.0	
O	BMVW-i	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG
O	2037	0	0
J	2037	0	0

UNFACTORED REACTIONS			
JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS	
O	COMBINED	SNOW LIVE PERMLIVE WIND DEAD SOIL	
J	1514	863 / 0 284 / 0 0 / 0 0 / 0 367 / 0 0 / 0	


BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.68 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)
FR-TO			
A-B	0 / 31	-102.1	-102.1 0.13 (1)
B-C	0 / 19	-102.1	-102.1 0.23 (1)
C-D	-2533 / 0	-102.1	-102.1 0.25 (1)
D-E	-2746 / 0	-102.1	-102.1 0.52 (1)
E-F	-2746 / 0	-102.1	-102.1 0.52 (1)
F-G	-2533 / 0	-102.1	-102.1 0.25 (1)
G-H	0 / 19	-102.1	-102.1 0.23 (1)
H-I	0 / 31	-102.1	-102.1 0.13 (1)
O-B	-289 / 0	0.0	0.0 0.03 (1)
J-H	-289 / 0	0.0	0.0 0.03 (1)
O-N	0 / 2250	-38.5	-38.5 0.70 (2)
N-M	0 / 2254	-38.5	-38.5 0.71 (2)
M-L	0 / 2254	-38.5	-38.5 0.71 (2)
L-K	0 / 2254	-38.5	-38.5 0.71 (2)
K-J	0 / 2250	-38.5	-38.5 0.70 (2)

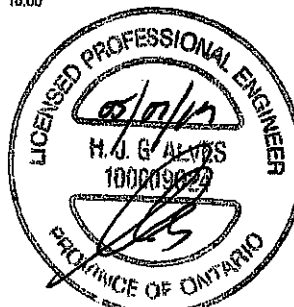

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 29.1 PSF
 DL = 6.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012
 - CSA 086-08, CSA 086-14
 - TPIIC 2011, TPIIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/380 (0.90")
 CALCULATED VERT. DEFL.(LL) = 1/989 (0.18")
 ALLOWABLE DEFL.(TL) = 1/980 (0.90")
 CALCULATED VERT. DEFL.(TL) = 1/989 (0.30")

CSI: TC=0.52/1.00 (D-E:1), SC=0.71/1.00 (K-M:2), WB=0.77/1.00 (G-J:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (C) (INPUT = 0.90)
 JSI METAL= 0.73 (L) (INPUT = 1.00)

ENGINEERED BY **17/10/20**
 STRUCTURAL
 GREEN PARK HOMES

JOB NAME 402939	TRUSS NAME T23	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:48:15 2019 Page 1
 ID: yH3luQzwKBaXQAh?hsf8URzKCTp-mudYMXe6HMFBOan5fuDf6HKjyKoPkxW1YEO0VzldU
 Scale = 1:48.8

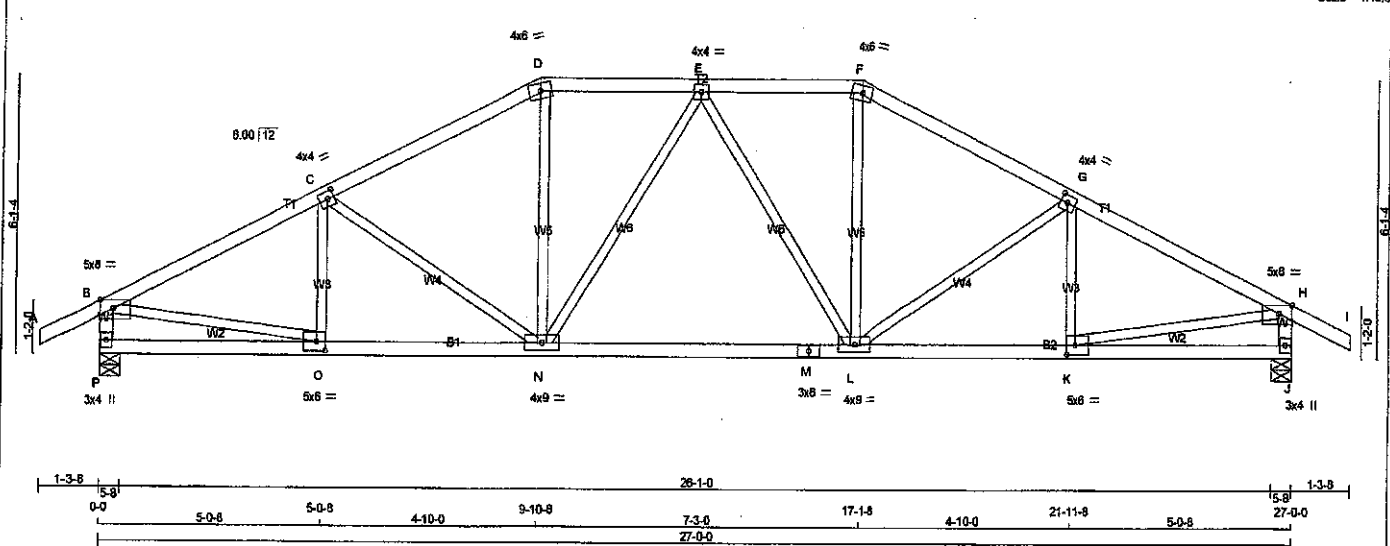

LUMBER			
N L C A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
F - I	2x4 DRY	No.2	SPF
P - B	2x4 DRY	No.2	SPF
J - H	2x4 DRY	No.2	SPF
P - M	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
DRY, SEASONED LUMBER.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0 Edge 3.50
C	TMVW-t	MT20	4.0	4.0 2.00 1.75
D	TTW-m	MT20	4.0	6.0
E	TMVW-t	MT20	4.0	4.0
F	TTW-m	MT20	4.0	6.0
G	TMVW-t	MT20	4.0	4.0 2.00 1.75
H	TMVW-p	MT20	5.0	8.0 Edge 3.50
J	BMV1+p	MT20	3.0	4.0
K	BMVW-t	MT20	5.0	6.0 2.50 2.25
L	BMVW-t	MT20	4.0	6.0
M	BS-t	MT20	3.0	6.0
N	BMVW-t	MT20	4.0	6.0
O	BMVW-t	MT20	5.0	6.0 2.50 2.25
P	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT HORZ	DOWN HORZ UPLIFT	IN-SX	IN-SX
P 2037 0	2037 0	5-8	5-8
J 2037 0	2037 0	5-8	5-8

UNFACTORED REACTIONS						
1ST LCASE	MAX	MIN	COMPONENT	REACTIONS		
JT COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P 1514	863 / 0	284 / 0	0 / 0	0 / 0	357 / 0	0 / 0
J 1514	863 / 0	284 / 0	0 / 0	0 / 0	357 / 0	0 / 0


BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO			
A-B	0 / 31	-102.1	-102.1 0.13 (1)
B-C	-2663 / 0	-102.1	-102.1 0.41 (1)
C-D	-2337 / 0	-102.1	-102.1 0.38 (1)
D-E	-2078 / 0	-102.1	-102.1 0.20 (1)
E-F	-2078 / 0	-102.1	-102.1 0.20 (1)
F-G	-2337 / 0	-102.1	-102.1 0.38 (1)
G-H	-2663 / 0	-102.1	-102.1 0.41 (1)
H-I	0 / 31	-102.1	-102.1 0.13 (1)
P-B	-1951 / 0	0.0	0.0 0.20 (1)
J-H	-1951 / 0	0.0	0.0 0.20 (1)
P-O	0 / 0	-38.5	-38.5 0.16 (3)
O-N	0 / 2404	-38.5	-38.5 0.56 (1)
N-M	0 / 2211	-38.5	-38.5 0.53 (2)
M-L	0 / 2211	-38.5	-38.5 0.53 (2)
L-K	0 / 2404	-38.5	-38.5 0.56 (1)
K-J	0 / 0	-38.5	-38.5 0.16 (3)



DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 29.1 PSF
 DL = 8.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012
 - CSA 986-09, CSA 986-14
 - TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/380 (0.90")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.13")
 ALLOWABLE DEFL. (TL) = L/380 (0.90")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.23")

CSI: TC=8.41/1.00 (G-H-1), EC=0.58/1.00 (K-L-1), WB=0.55/1.00 (H-K-1), SS=0.22/1.00 (G-H-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (K) (INPUT = 0.90)
 JSI METAL= 0.85 (M) (INPUT = 1.00)


DATE: MAY 7 2019 17:48:15
 17910781
 STRUCTURAL
 ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	T24	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitak Industries, Inc. Tue May 7 17:48:16 2019 Page 1

ID: yH3luQzwKBaXQAh?hsf8URzKCTp-E4BwZfKbU6p9RzfNPSCpqSQLf89JfGC_xZxldqDT

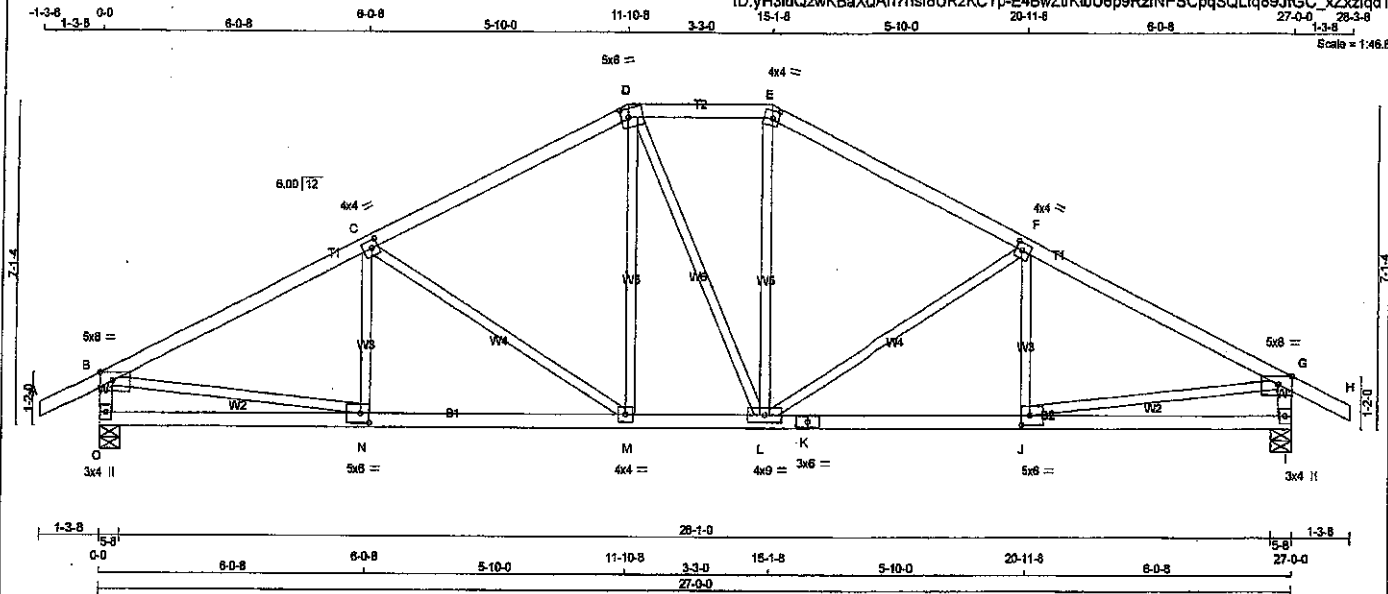

TOTAL WEIGHT = 113 lb

LUMBER

N L G A RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - H	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
O - K	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	Edge	3.50
C TMVW-t	MT20	4.0	4.0	2.00	1.75
D TTWW-m	MT20	5.0	6.0	2.25	2.00
E TTW-m	MT20	4.0	4.0	2.00	1.75
F TMVW-t	MT20	4.0	4.0	2.00	1.75
G TMVW-p	MT20	5.0	8.0	Edge	3.50
I BMV1+p	MT20	3.0	4.0		
J BMVW-t	MT20	5.0	6.0	2.50	2.25
K BS-t	MT20	3.0	6.0		
L BMVW-t	MT20	4.0	9.0		
M BMVW-t	MT20	4.0	4.0		
N BMVW-t	MT20	5.0	6.0	2.50	2.25
O BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQRD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	HORIZ	BRG	IN-SX	BRG	IN-SX
O	2037	0	2037	0	0	5-8	5-8	5-8	5-8
I	2037	0	2037	0	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1514	863 / 0	284 / 0	0 / 0	0 / 0	367 / 0	0 / 0
I	1514	863 / 0	284 / 0	0 / 0	0 / 0	367 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.63 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	
FR-TO		FROM TO	CS1 (LX)	FR-TO		CS1 (LX)	
A-B	0 / 31	-102.1	-102.1 0.13 (1)	N-C	-84 / 185	0.04 (3)	
B-C	-2694 / 0	-102.1	-102.1 0.81 (1)	C-M	-692 / 0	0.67 (1)	
C-D	-2111 / 0	-102.1	-102.1 0.53 (1)	M-D	0 / 537	0.12 (1)	
D-E	-1868 / 0	-102.1	-102.1 0.18 (1)	D-L	0 / 4	0.00 (1)	
E-F	-2113 / 0	-102.1	-102.1 0.53 (1)	L-E	0 / 541	0.12 (1)	
F-G	-2693 / 0	-102.1	-102.1 0.61 (1)	L-F	-689 / 0	0.66 (1)	
G-H	0 / 31	-102.1	-102.1 0.13 (1)	J-F	-86 / 183	0.04 (3)	
O-B	-1942 / 0	0.0	0.0 0.20 (1)	B-N	0 / 2462	0.55 (1)	
I-G	-1942 / 0	0.0	0.0 0.20 (1)	J-G	0 / 2461	0.55 (1)	

O-N	0 / 0	-38.5	-38.5	0.27 (3)	10.00
N-M	0 / 2438	-38.5	-38.5	0.58 (2)	10.00
M-L	0 / 1866	-38.5	-38.5	0.40 (1)	10.00
L-K	0 / 2437	-38.5	-38.5	0.57 (2)	10.00
K-J	0 / 2437	-38.5	-38.5	0.57 (2)	10.00
J-I	0 / 0	-38.5	-38.5	0.27 (3)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.90")
CALCULATED VERT. DEFL.(LL) = L/999 (0.12")
ALLOWABLE DEFL.(TL) = L/360 (0.90")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.61/1.00 (B-C:1), BC=0.58/1.00 (M-N:2), WB=0.67/1.00 (C-M:1), SS=0.28/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 798 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)
JSI METAL= 0.71 (K) (INPUT = 1.00)

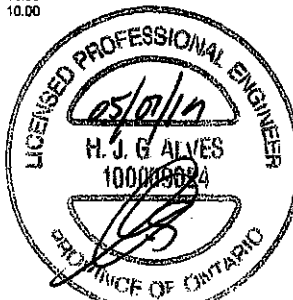


DATE: 05/07/2019
TIME: 14:07:02
C:\Users\HJG\Documents\TRUSS\T24\T24.DWG

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	T25	8	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Tue May 7 17:48:17 2018 Page 1
ID: yH3luQzwKBaXQAh?hsf8URzKCtp-iHlnDgyeuczRJOAD4xhl1MbJxotZpoUsjU5NzldqS

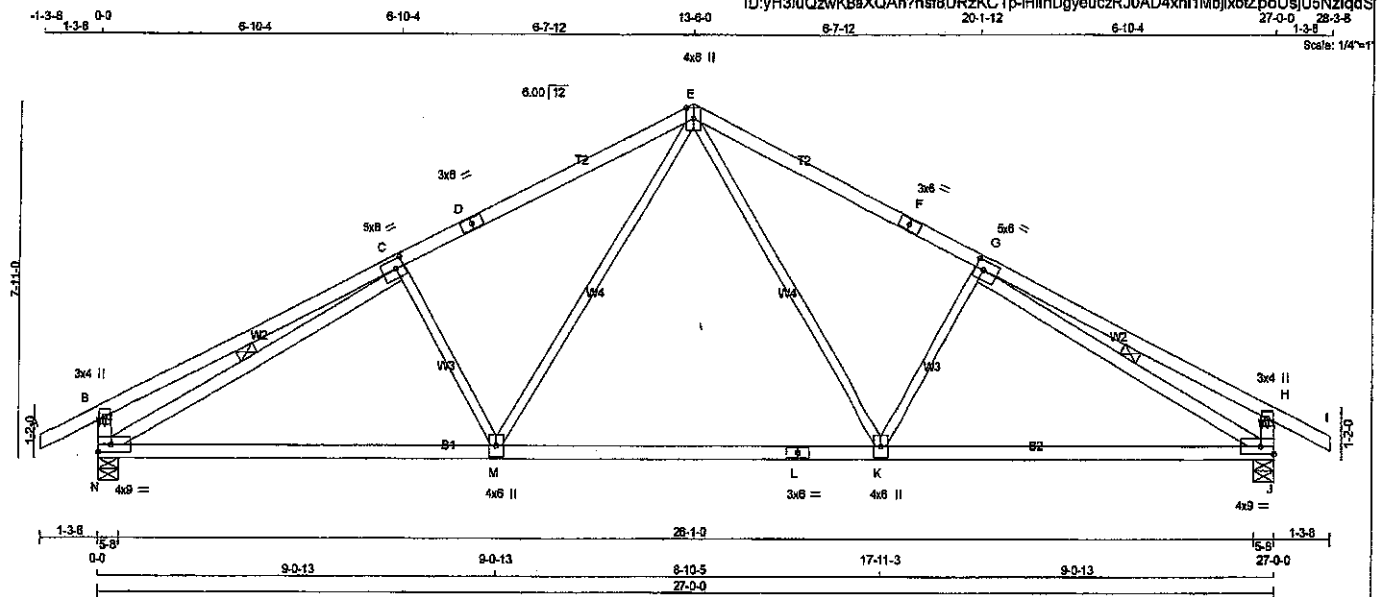

TOTAL WEIGHT = 8 X 109 = 872 lb
[M/F]

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
N - C	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	5.0	6.0	2.50	2.25
D	TS-t	MT20	3.0	6.0		
E	TTVW+p	MT20	4.0	6.0	Edge	
F	TS-t	MT20	3.0	6.0		
G	TMVW-t	MT20	5.0	6.0	2.50	2.25
H	TMV+p	MT20	3.0	4.0		
J	BMVW-t	MT20	4.0	9.0	Edge	
K	BMVW+t	MT20	4.0	6.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW+t	MT20	4.0	6.0		
N	BMVW-t	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	VERT	HORZ	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION DOWN	HORZ	UPLIFT	INPUT BRG IN-SX	REQRD BRG IN-SX
N	2037	0	2037	0	0	0	5-8	5-8
J	2037	0	2037	0	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1514	863 / 0	284 / 0	0 / 0	0 / 0	367 / 0	0 / 0
J	1514	863 / 0	284 / 0	0 / 0	0 / 0	367 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	FORCE (LBS)	CHORDS			MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX. FACTORED
		MAX. FACTORED	VERT. LOAD	LC1 MAX				
FR-TO					FR-TO			
A-B	0 / 31	-102.1	-102.1	0.13 (1)	E-K	0 / 937	0.21 (1)	
B-C	0 / 37	-102.1	-102.1	0.76 (1)	K-G	-493 / 7	0.19 (1)	
C-D	-2435 / 0	-102.1	-102.1	0.76 (1)	M-E	0 / 937	0.21 (1)	
D-E	-2435 / 0	-102.1	-102.1	0.76 (1)	C-M	-493 / 7	0.19 (1)	
E-F	-2435 / 0	-102.1	-102.1	0.76 (1)	N-C	-2813 / 0	0.84 (1)	
F-G	-2435 / 0	-102.1	-102.1	0.76 (1)	G-J	-2813 / 0	0.84 (1)	
G-H	0 / 37	-102.1	-102.1	0.76 (1)				
H-I	0 / 31	-102.1	-102.1	0.13 (1)				
N-B	-400 / 0	0.0	0.0	0.04 (1)				
J-H	-400 / 0	0.0	0.0	0.04 (1)				
N-M	0 / 2383	-38.5	-38.5	0.85 (2)				
M-L	0 / 1874	-38.5	-38.5	0.75 (2)				
L-K	0 / 1874	-38.5	-38.5	0.75 (2)				
K-J	0 / 2383	-38.5	-38.5	0.85 (2)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 29.1 PSF
DL = 6.0 PSF	
BOT CH.	LL = 10.5 PSF
DL = 7.0 PSF	
TOTAL LOAD = 52.5 PSF	

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 9.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.80")
CALCULATED VERT. DEFL.(LL) = $L/989$ (0.27")
ALLOWABLE DEFL.(TL) = $L/360$ (0.80")
CALCULATED VERT. DEFL.(TL) = $L/705$ (0.46")

CSI: TC=0.76/1.00 (G-H:1), BC=0.85/1.00 (H-K:2), WB=0.84/1.00 (G-J:1), SSF=0.30/1.00 (E-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	610 354 1687 788 1987 1656	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

ISI GRIP = 0.88 (G) (INPUT = 0.90)
ISI METAL = 0.69 (G) (INPUT = 1.00)

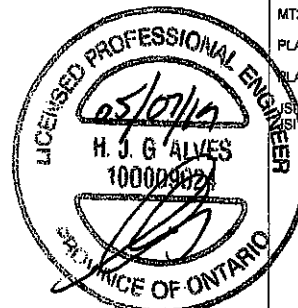

DESIGNED BY 17110783
CHECKED BY
DATE 05/07/19

JOB NAME 402939	TRUSS NAME T26	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	
Version 8.230 S Nov 17 2018 MITek Industries, Inc. Tue May 7 17:46:18 2019 Page 1				ID: yH3luQzwKBaXQAh?hsf8URzKCTp-BTJg_ZhaPCKp2TbMmoSwHEvkq9Ohc82y/WT2dpzfgdR	
1-3-8 0.0 4-7-6 4-7-6 5-11-4 2-0-0 7-11-4 9-1-5 4-4-11 13-6-0 4-4-11 17-10-11 4-5-15 22-4-10 4-7-6 27-0-0 1-3-8 Scale = 1:48.8					

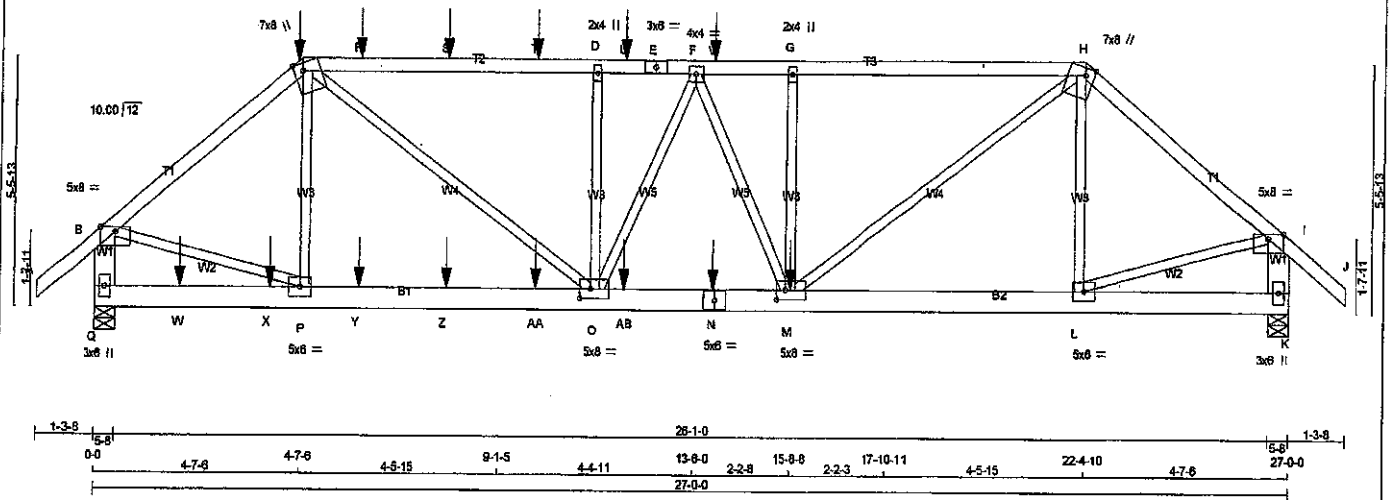

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - H	2x4	DRY No.2	SPF
H - J	2x4	DRY No.2	SPF
Q - B	2x6	DRY No.2	SPF
K - I	2x6	DRY No.2	SPF
Q - N	2x6	DRY No.2	SPF
N - K	2x6	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 12		SIDE(61.0)
C - E 12		SIDE(61.0)
E - H 12		SIDE(0.0)
H - J 12		TOP
Q - B 2		TOP
K - I 2		TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
Q - N 2		SIDE(0.0)
N - K 2		SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 6		SIDE(283.2)
G - M 1		

NAIls TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMWV-p MT20	5.0	8.0	Edge	
C TTWVW+m MT20	7.0	8.0	Edge 2.25	
D TMWV-w MT20	2.0	4.0		
E TS-t MT20	3.0	8.0		
F TMWVW-1 MT20	4.0	4.0		
G TMWV-w MT20	2.0	4.0		
H TTWVW+m MT20	7.0	8.0	Edge 2.25	
I TMWV-p MT20	5.0	8.0	Edge	
K BMV1+p MT20	3.0	6.0		
L BMWVW-1 MT20	5.0	8.0		
M BMWVW-1 MT20	5.0	8.0	2.50 2.50	
N BS-t MT20	5.0	8.0		
O BMWVW-1 MT20	5.0	8.0	2.50 3.00	
P BMWVW-1 MT20	5.0	8.0		
Q BMV1+p MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	3821 0	3821 0	0 0	5-8 5-8
Q VERT	3821 0	3821 0	0 0	5-8 5-8
K VERT	3513 0	3513 0	0 0	5-8 5-8

UNFACTORED REACTIONS	1ST LCASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED	SNOW	LIVE
Q	2838	1623 / 0
K	2601	1513 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED HORIZ. LOAD LC1 (PLF)	MAX. FACTORED UNBRACED LENGTH FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD LC1 (PLF)
FR-TO						FR-TO			
A-B	0 / 45	-102.1	-102.1	0.08 (1)	10.00	P-C	-334 / 216	0.07 (1)	
B-C	-3695 / 0	-102.1	-102.1	0.32 (1)	4.47	C-O	0 / 3018	0.37 (1)	
C-R	-5458 / 0	-102.1	-102.1	0.87 (1)	3.28	O-D	-1222 / 0	0.27 (1)	
R-S	-5458 / 0	-102.1	-102.1	0.87 (1)	3.28	M-G	-776 / 0	0.17 (1)	
S-T	-5458 / 0	-102.1	-102.1	0.87 (1)	3.28	M-H	0 / 3732	0.46 (1)	
T-D	-5458 / 0	-102.1	-102.1	0.87 (1)	3.28	L-H	-487 / 15	0.09 (1)	
D-U	-5458 / 0	-102.1	-102.1	0.84 (1)	3.28	B-P	0 / 3859	0.38 (1)	
U-E	-5458 / 0	-102.1	-102.1	0.84 (1)	3.28	F-R	-238 / 0	0.06 (1)	
E-F	-5458 / 0	-102.1	-102.1	0.84 (1)	3.28	F-R	0 / 535	0.07 (1)	
F-V	-5763 / 0	-102.1	-102.1	0.42 (1)	3.61				
V-G	-5763 / 0	-102.1	-102.1	0.42 (1)	3.61				
G-H	-5763 / 0	-102.1	-102.1	0.81 (1)	3.61				
H-I	-3687 / 0	-102.1	-102.1	0.30 (1)	4.64				
I-J	0 / 45	-102.1	-102.1	0.08 (1)	10.00				
Q-B	-3737 / 0	0.0	0.0	0.14 (1)	7.28				
K-I	-3481 / 0	0.0	0.0	0.13 (1)	7.51				
Q-W	0 / 0	-38.5	-38.5	0.12 (3)	10.00				
W-X	0 / 0	-38.5	-38.5	0.12 (3)	10.00				
X-P	0 / 0	-38.5	-38.5	0.12 (3)	10.00				
P-Y	0 / 3055	-38.5	-38.5	0.29 (1)	10.00				
Y-Z	0 / 3055	-38.5	-38.5	0.29 (1)	10.00				
Z-AA	0 / 3055	-38.5	-38.5	0.29 (1)	10.00				
AA-O	0 / 3055	-38.5	-38.5	0.29 (1)	10.00				
O-AB	0 / 5551	-38.5	-38.5	0.42 (1)	10.00				
AB-N	0 / 5551	-38.5	-38.5	0.42 (1)	10.00				
N-M	0 / 5551	-38.5	-38.5	0.42 (1)	10.00				
M-L	0 / 2802	-38.5	-38.5	0.25 (1)	10.00				
L-K	0 / 0	-38.5	-38.5	0.08 (2)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	JT LOC.	LC1 MAX	FACE	DIR.	TYPE	HEEL	CONN.
JT	4-7-6	-56	FRONT	VERT	DEAD		
C	4-7-6	-327	FRONT	VERT	SNOW		
C	4-7-6	-327	BACK	VERT	TOTAL		
M	15-8-8	-1787	BACK	VERT	TOTAL		
N	13-11-4	-60	BACK	VERT	TOTAL		
R	5-11-4	-133	BACK	VERT	TOTAL		
S	7-11-4	-133	BACK	VERT	TOTAL		
T	9-11-4	-133	BACK	VERT	TOTAL		
U	11-11-4	-133	BACK	VERT	TOTAL		

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT. CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SPACING OF 2.00/12 MINIMUM

*** NON STANDARD GIRDER ***
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(56 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.90")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.90")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.87/1.00 (C-D:1), BC=0.42/1.00 (M-O:1)

WB=0.48/1.00 (H-M:1), SS=0.28/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (O) (INPUT = 0.90)

JSI METAL= 0.55 (N) (INPUT = 1.00)


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	T26	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MITek Industries, Inc. Tue May 7 17:46:18 2019 Page 2
ID:yH3luQzwKBaXQAh?hsf8URzKCTp-BTJg_ZhePCKp2TbMmoSwHEVkg9Ohc62vWV72dpzlgdR

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
V	13-11-4	-133	-133	—	BACK	VERT	TOTAL	—	—
W	1-11-4	-60	-77	—	BACK	VERT	TOTAL	—	—
X	3-11-4	-60	-77	—	BACK	VERT	TOTAL	—	—
Y	5-11-4	-60	-77	—	BACK	VERT	TOTAL	—	—
Z	7-11-4	-60	-77	—	BACK	VERT	TOTAL	—	—
AA	9-11-4	-60	-77	—	BACK	VERT	TOTAL	—	—
AB	11-11-4	-60	-77	—	BACK	VERT	TOTAL	—	—

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

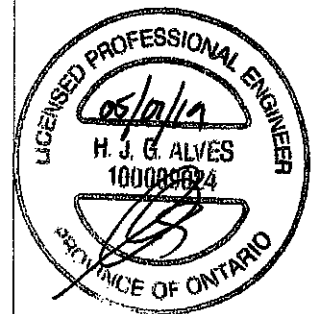


ENGINEER 17/11/0784
CENTRAL
CITY OF BURLINGTON 2/2

JOB NAME 402939	TRUSS NAME T27	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington Version 8.230 S Nov 17 2018 MITek Industries, Inc. Tue May 7 17:48:19 2019 Page 1

ID: yH3luQzwKBaXQAh?hsf8URzKCTp-ft3BuhDAWsggd9YKvz9qSR0vZkflTP5yACb9GzldqQ
1-3-8 0.0 3-2-8 3-2-8 3-0-0 6-2-8 4-10-11 11-1-4 4-9-7 15-10-12 4-10-11 20-9-7 3-0-0 23-8-8 3-2-8 27-0-0 26-3-8
Scale = 1:48.8

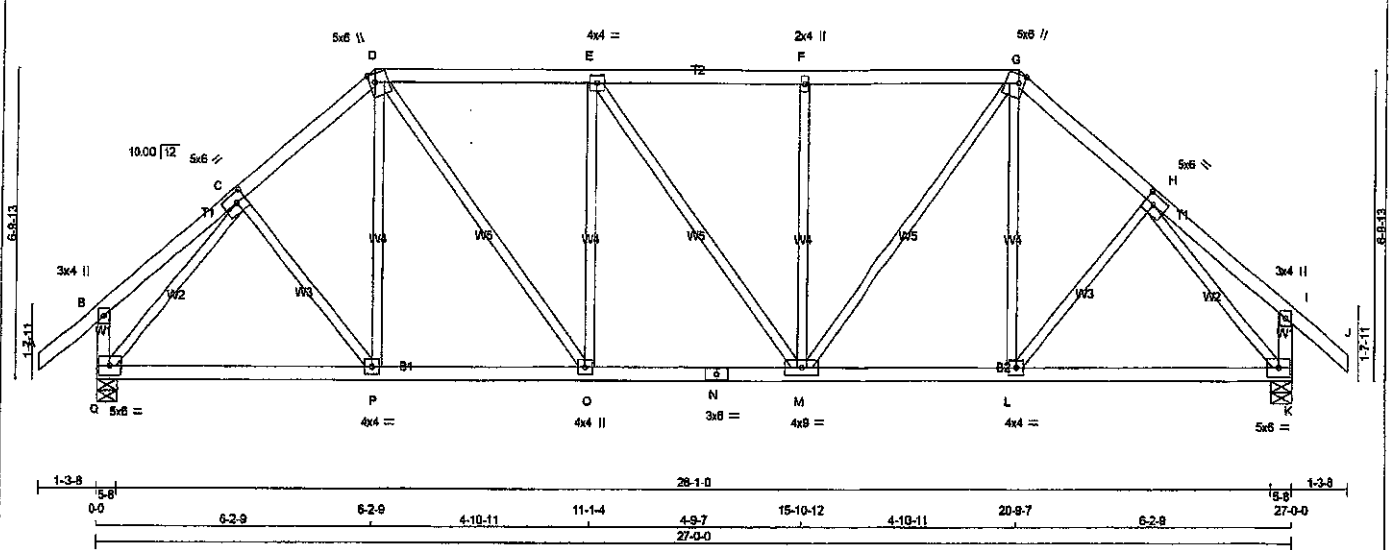

TOTAL WEIGHT = 2 X 127 = 255 lb

LUMBERS	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
G - J	2x4	DRY	No.2	SPF	
J - K	2x4	DRY	No.2	SPF	
K - L	2x4	DRY	No.2	SPF	
L - M	2x4	DRY	No.2	SPF	
M - N	2x4	DRY	No.2	SPF	
N - K	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
DRY: SEASONED LUMBER.					

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMVW+1	MT20	5.0	6.0	2.50	2.50
D TTWW+m	MT20	5.0	6.0	2.25	1.50
E TMVW+1	MT20	4.0	4.0		
F TMVW+w	MT20	2.0	4.0		
G TTWW+m	MT20	5.0	6.0	2.25	1.50
H TMVW+1	MT20	5.0	6.0	2.50	2.50
I TMV+p	MT20	3.0	4.0		
K BMVW+1	MT20	5.0	6.0		
L BMVW+1	MT20	4.0	4.0		
M BMVW+1	MT20	4.0	4.0		
N BS-1	MT20	3.0	6.0		
O BMVW+1	MT20	4.0	4.0		
P BMVW+1	MT20	4.0	4.0		
Q BMVW+1	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQRD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
Q	2040	0	2040	0
K	2040	0	2040	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD
Q	1516	885 / 0	284 / 0	0 / 0	0 / 0	368 / 0	0 / 0
K	1516	885 / 0	284 / 0	0 / 0	0 / 0	368 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) Q, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.41 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX.	CS1 (LC)	UNBRAC	LENGTH	FR-TO	WEBS	MEMB.	MAX. FACTORED	FORCE	MAX.	CS1 (LC)
		(LBS)		(PLF)									(LBS)			
A-B	0 / 45	-102.1	-102.1	0.14 (1)	10.00	C-P	0 / 157	0.04 (2)								
B-C	0 / 20	-102.1	-102.1	0.14 (1)	10.00	P-D	0 / 213	0.05 (3)								
C-D	-1870 / 0	-102.1	-102.1	0.18 (1)	4.74	D-O	0 / 876	0.20 (1)								
D-E	-1948 / 0	-102.1	-102.1	0.40 (1)	4.41	O-E	-532 / 0	0.42 (1)								
E-F	-1944 / 0	-102.1	-102.1	0.39 (1)	4.41	E-M	-3 / 0	0.00 (1)								
F-G	-1944 / 0	-102.1	-102.1	0.39 (1)	4.42	M-F	-531 / 0	0.41 (1)								
G-H	-1871 / 0	-102.1	-102.1	0.18 (1)	4.74	M-G	0 / 873	0.20 (1)								
H-I	0 / 20	-102.1	-102.1	0.14 (1)	10.00	L-G	0 / 213	0.05 (3)								
I-J	0 / 45	-102.1	-102.1	0.14 (1)	10.00	L-H	0 / 157	0.04 (2)								
Q-B	-287 / 0	0.0	0.0	0.03 (1)	7.81	Q-C	-2138 / 0	0.84 (1)								
K-I	-287 / 0	0.0	0.0	0.03 (1)	7.81	H-K	-2138 / 0	0.84 (1)								
Q-P	0 / 1331	-38.5	-38.5	0.42 (2)	10.00											
P-O	0 / 1419	-38.5	-38.5	0.44 (2)	10.00											
O-N	0 / 1946	-38.5	-38.5	0.39 (1)	10.00											
N-M	0 / 1946	-38.5	-38.5	0.39 (1)	10.00											
M-L	0 / 1419	-38.5	-38.5	0.44 (2)	10.00											
L-K	0 / 1331	-38.5	-38.5	0.42 (2)	10.00											

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, CBC 2012
- CSA 086-03, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.90")
CALCULATED VERT. DEFL. (LL) = L/999 (0.08")
ALLOWABLE DEFL. (TL) = L/360 (0.90")
CALCULATED VERT. DEFL. (TL) = L/999 (0.13")

CSI: TC=0.40/1.00 (D-E:1), BC=0.44/1.00 (L-M:2), WS=0.84/1.00 (H-K:1), SS=0.23/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (O) (INPUT = 0.90)
JSI METAL= 0.69 (N) (INPUT = 1.00)



7/7/2018
17710785
STRUCTURAL
ENGINEER

JOB NAME 402939	TRUSS NAME T28	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:48:20 2019 Page 1	

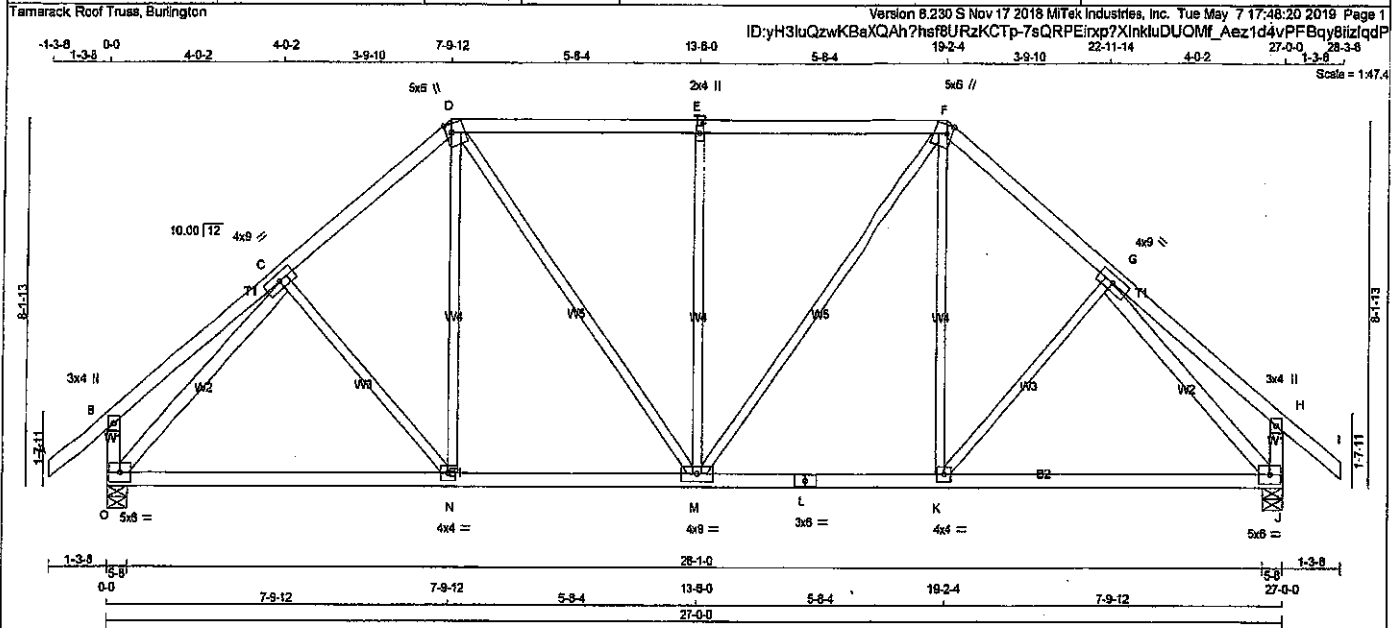

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS 2x3 DRY No.2 SPF				
EXCEPT				
O - C	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW+t	MT20	4.0	9.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMVW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.25	1.50
G	TMVW+t	MT20	4.0	9.0		
H	TMV+p	MT20	3.0	4.0		
J	BMVW+t	MT20	5.0	6.0		
K	BMVW+t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	6.0		
M	BMVW+t	MT20	4.0	9.0		
N	BMVW+t	MT20	4.0	4.0		
O	BMVW+t	MT20	5.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
O	2040	0	2040	0	5-8	5-8
J	2040	0	2040	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM. LIVE	WIND			
O	1516	865 / 0	284 / 0	0 / 0	388 / 0	0 / 0	0 / 0
J	1516	865 / 0	284 / 0	0 / 0	388 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX UNBRACED LENGTH (FR-TO)	MEMB.	FACTORED FORCE (LBS)	MAX LC1 (LC)
FR-TO					FR-TO		
A-B	0 / 45	-102.1	-102.1 0.14 (1)	10.00	C-N	-23 / 95	0.02 (3)
B-C	0 / 29	-102.1	-102.1 0.24 (1)	10.00	N-D	0 / 387	0.09 (2)
C-D	-1818 / 0	-102.1	-102.1 0.23 (1)	4.78	D-M	0 / 527	0.12 (1)
D-E	-1685 / 0	-102.1	-102.1 0.46 (1)	4.58	M-E	-708 / 0	0.91 (1)
E-F	-1685 / 0	-102.1	-102.1 0.46 (1)	4.58	M-F	0 / 527	0.12 (1)
F-G	-1818 / 0	-102.1	-102.1 0.23 (1)	4.76	K-F	0 / 387	0.09 (2)
G-H	0 / 29	-102.1	-102.1 0.24 (1)	10.00	K-G	-23 / 95	0.02 (3)
H-I	0 / 45	-102.1	-102.1 0.14 (1)	10.00	O-C	-2134 / 0	0.92 (1)
O-B	-294 / 0	0.0	0.0 0.03 (1)	7.81	G-J	-2134 / 0	0.92 (1)
J-H	-294 / 0	0.0	0.0 0.03 (1)	7.81			
O-N	0 / 1386	-38.5	-38.5 0.58 (2)	10.00			
N-M	0 / 1375	-38.5	-38.5 0.58 (2)	10.00			
M-L	0 / 1375	-38.5	-38.5 0.58 (2)	10.00			
L-K	0 / 1375	-38.5	-38.5 0.58 (2)	10.00			
K-J	0 / 1386	-38.5	-38.5 0.58 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.90")
CALCULATED VERT. DEFL.(LL) = L/999 (0.16")
ALLOWABLE DEFL.(TL)= L/360 (0.90")
CALCULATED VERT. DEFL.(TL) = L/999 (0.26")

CSI: TC=0.46/1.00 (D-E-1), BC=0.59/1.00 (K-M-2), WB=0.92/1.00 (G-J-1), SSI=0.23/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

ISI GRIP= 0.88 (C) (INPUT = 0.90)
ISI METAL= 0.47 (L) (INPUT = 1.00)

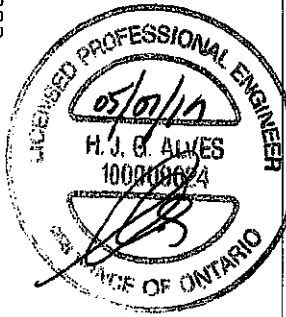


05/01/19
H.J. G. ALVES
100008624
PROVINCE OF ONTARIO

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	T29	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitak Industries, Inc. Tue May 7 17:48:21 2018 Page 1

ID: yH3luQzwKBaXQAh?hsf8URzKCTp-b2_pcaIT77OvXJxSw?dvtXOcMUKpZwOPUhiEbZlqdQ

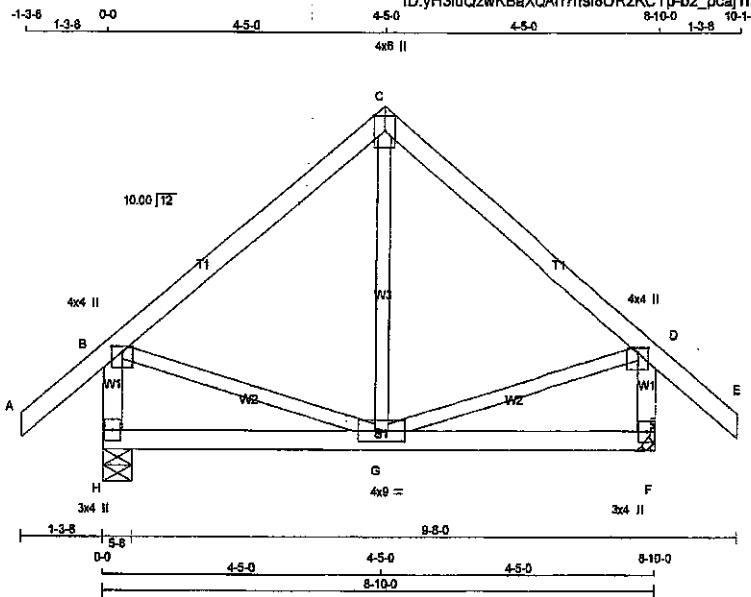

Scale = 1:33.1

TOTAL WEIGHT = 41 lb [M/F]

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER
A - C	2x4 DRY	No.2
C - E	2x4 DRY	No.2
H - B	2x4 DRY	No.2
F - D	2x4 DRY	No.2
H - F	2x4 DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW+p	MT20	4.0	6.0	Edge	
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	783	0	783	0
F	783	0	783	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX / MIN	COMPONENT REACTIONS
	COMBINED	SNOW	LIVE
H	581	337 / 0	93 / 0
F	581	337 / 0	93 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD LC1	MEMB.	FORCE
	(LBS)	(PLF)		(LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 45	-102.1 -102.1 0.14 (1)	G-C	0 / 181
B-C	-381 / 0	-102.1 -102.1 0.26 (1)	B-G	0 / 305
C-D	-381 / 0	-102.1 -102.1 0.26 (1)	G-D	0 / 305
D-E	0 / 45	-102.1 -102.1 0.14 (1)		
H-B	-897 / 0	0.0 0.0 0.07 (1)		
F-D	-897 / 0	0.0 0.0 0.07 (1)		
H-G	0 / 0	-38.5 -38.5 0.17 (3)		
G-F	0 / 0	-38.5 -38.5 0.17 (3)		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 29.1 PSF
	DL = 8.0 PSF
BOT CH.	LL = 10.5 PSF
	DL = 7.0 PSF
TOTAL LOAD	= 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.29")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.01")
ALLOWABLE DEFL. (TL) = $L/360$ (0.29")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CSI: TC=0.26/1.00 (C-D:1), BC=0.17/1.00 (F-G:3), WB=0.07/1.00 (B-G:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	354	1887

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.90)
JSI METAL= 0.16 (D) (INPUT = 1.00)

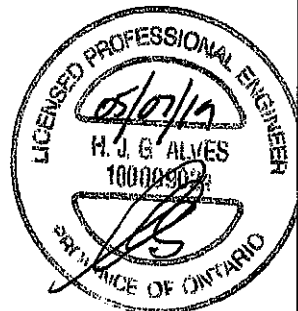


71910787
STRUCTURAL
ENGINEER ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	T29S	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MTek Industries, Inc. Tue May 7 17:46:22 2018 Page 1

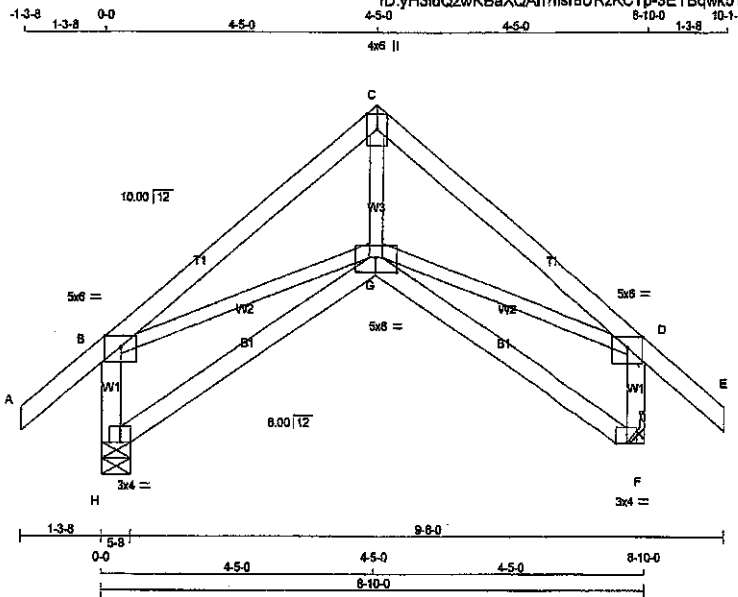

Scale = 1:33.6

TOTAL WEIGHT = 2 X 41 = 82 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - E	2x4 DRY	No.2	SPF		
H - B	2x4 DRY	No.2	SPF		
F - D	2x4 DRY	No.2	SPF		
G - F	2x4 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	Edge	
C	TTW-p	MT20	4.0	6.0	Edge	
D	TMVW-p	MT20	5.0	6.0	Edge	
F	BVM1-p	MT20	3.0	4.0		
G	BBWW-p	MT20	5.0	8.0	2.75	4.00
H	BVM1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	783	0	783	0
F	783	0	783	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	PERM	LIVE	WIND	DEAD	SOIL
H	561	337	0	93	0	0	131	0
F	561	337	0	93	0	0	131	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (LC1)	MAX. FACTORED LENGTH (LC)	UNBRACED	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (LC)
FR-TO										
A-B	0/45	-102.1	-102.1	0.14 (1)	10.00	G-C	0/536	0.12 (1)		
B-C	-771/0	-102.1	-102.1	0.28 (1)	6.25	B-G	0/620	0.14 (1)		
C-D	-771/0	-102.1	-102.1	0.28 (1)	6.25	G-D	0/620	0.14 (1)		
D-E	0/45	-102.1	-102.1	0.14 (1)	10.00					
H-B	-678/0	0.0	0.0	0.08 (1)	7.81					
F-D	-678/0	0.0	0.0	0.08 (1)	7.81					
H-G	0/0	-38.5	-38.5	0.18 (3)	10.00					
G-F	0/0	-38.5	-38.5	0.18 (3)	10.00					



DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.29")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.29")
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.28/1.00 (C-D:1), BC=0.18/1.00 (F-G:3), WB=0.14/1.00 (B-G:1), SSI=0.14/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.55 (H) (INPUT = 0.90)
JSI METAL= 0.40 (H) (INPUT = 1.00)

DATE: 05/07/19
DRAWN BY: TAM
CHECKED BY: NATURAL
APPROVED BY: ONLY

JOB NAME 402939	TRUSS NAME T30	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 6.230 S Nov 17 2018 MITek Industries, Inc. Tue May 7 17:48:22 2019 Page 1		ID: yH3luQzwKBaXQAht8URzKCTp-3EYBqwk5TRFFX4u77eVVsS43YLmJXy_wYe8RFmbzldqN	
		TRUSS DESC.		Scale = 1:28.3	

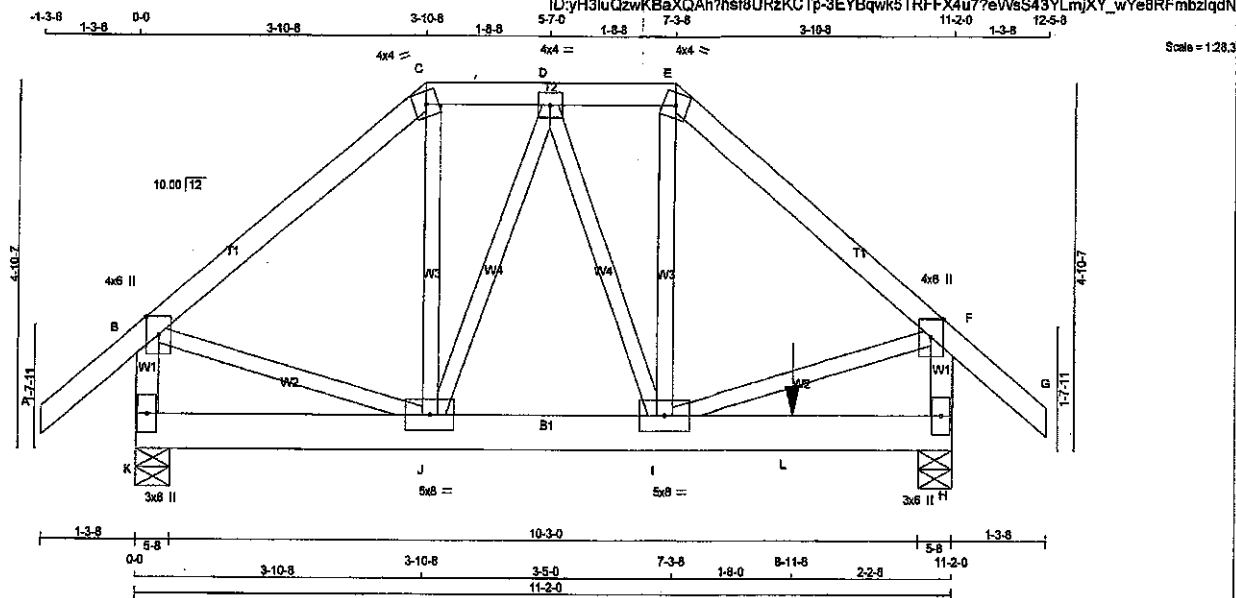

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2
	C - E	2x4	DRY	No.2
	E - G	2x4	DRY	No.2
	K - B	2x4	DRY	No.2
	H - F	2x4	DRY	No.2
	K - H	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	6.0	Edge	
C	TTW-m	MT20	4.0	4.0		
D	TMWW-t	MT20	4.0	4.0		
E	TTW-m	MT20	4.0	4.0		
F	TMVW+p	MT20	4.0	6.0	Edge	
H	BMV1+p	MT20	3.0	6.0		
I	BMWW-t	MT20	5.0	8.0		
J	BMWW-t	MT20	5.0	8.0		
K	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	HORZ	DOWN	HORZ
	UP	DOWN	UP	DOWN
JT	1108	0	1108	0
K	1108	0	1108	0
H	1684	0	1684	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM. LIVE
K	816	490 / 0	135 / 0	0 / 0
H	1218	751 / 0	188 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0 / 45	-102.1	-102.1	0.15 (1)	10.00	J-C	0 / 224	0.06 (2)	
B-C	-777 / 0	-102.1	-102.1	0.31 (1)	6.25	I-E	0 / 401	0.10 (1)	
C-D	-800 / 0	-102.1	-102.1	0.05 (1)	6.25	B-J	0 / 623	0.15 (1)	
D-E	-829 / 0	-102.1	-102.1	0.05 (1)	6.25	I-F	0 / 857	0.21 (1)	
E-F	-1070 / 0	-102.1	-102.1	0.32 (1)	5.65	J-D	-433 / 0	0.16 (1)	
F-G	0 / 45	-102.1	-102.1	0.15 (1)	10.00	D-I	0 / 247	0.08 (1)	
K-B	-1022 / 0	0.0	0.0	0.12 (1)	7.72				
H-F	-1279 / 0	0.0	0.0	0.15 (1)	7.10				
K-J	0 / 0	-38.5	-38.5	0.08 (2)	10.00				
J-I	0 / 746	-38.5	-38.5	0.39 (1)	10.00				
I-L	0 / 0	-38.5	-38.5	0.56 (1)	10.00				
L-H	0 / 0	-38.5	-38.5	0.56 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
L	8-11-8	-919	-919	-	BACK	VERT	TOTAL	-	-

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. G.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/380$ (0.37")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.03")
ALLOWABLE DEFL.(TL) = $L/380$ (0.37")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.08")

CSI: TC=0.32/1.00 (E-F:1), BC=0.56/1.00 (H-I:1), WB=0.21/1.00 (F-I:1), SS=0.46/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788	1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SSI GRIP= 0.85 (F) (INPUT = 0.90)
SSI METAL= 0.54 (B) (INPUT = 1.00)

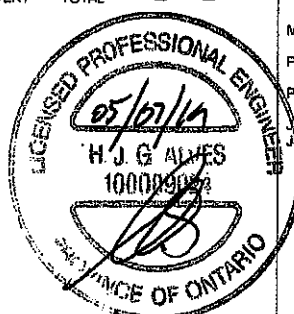


ENGINEER TAM 71910789
STRUCTURAL
FOR OFFICIAL USE ONLY

JOB NAME 402939	TRUSS NAME T31	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 MITek Industries, Inc. Tue May 7 17:48:23 2019 Page 1

ID:yH3luQzwKBaXQAh?haf8URzKCTp-XR6Z1GjDKN69ETKZL15_IcfA7CHT3htoBpl1zldm

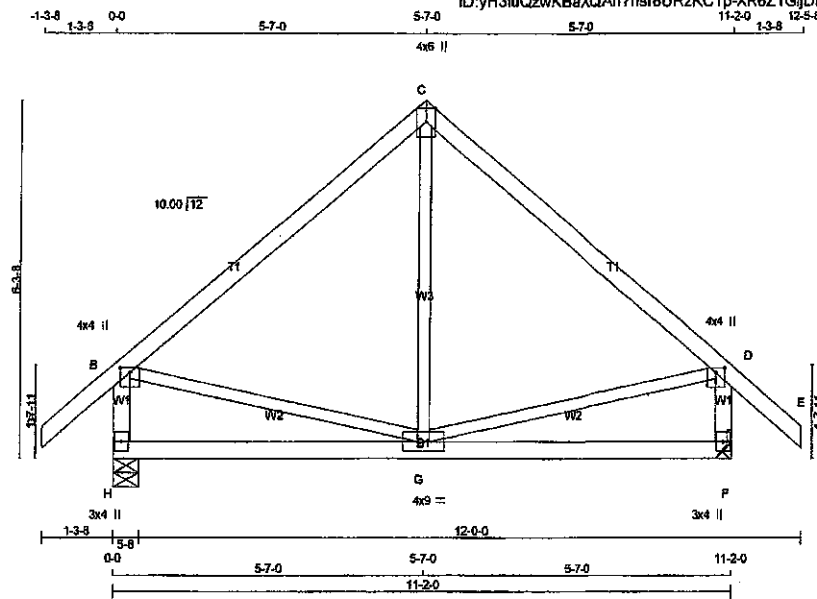

Scale = 1:37.5

TOTAL WEIGHT = 3 X 50 = 149 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF		
C - E	2x4	DRY	No.2	SPF		
H - B	2x4	DRY	No.2	SPF		
F - D	2x4	DRY	No.2	SPF		
H - F	2x4	DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTW+p	MT20	4.0	6.0	Edge
D	TMVW+p	MT20	4.0	4.0	1.00 2.00
F	BMV1+p	MT20	3.0	4.0	
G	BMVW+wt	MT20	4.0	9.0	
H	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	HORIZ	UPLIFT
H	927	0	927	0
F	927	0	927	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3'-6".

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE		
H	684	405 / 0	117 / 0	0 / 0	162 / 0
F	684	405 / 0	117 / 0	0 / 0	162 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)
FR-TO						FR-TO				
A-B	0 / 45	-102.1	-102.1	0.14 (1)	10.00	G-C	0 / 248	0.06 (3)		
B-C	-510 / 0	-102.1	-102.1	0.41 (1)	6.25	B-G	0 / 403	0.09 (1)		
C-D	-510 / 0	-102.1	-102.1	0.41 (1)	6.25	G-D	0 / 403	0.09 (1)		
D-E	0 / 45	-102.1	-102.1	0.14 (1)	10.00					
H-B	-845 / 0	0.0	0.0	0.09 (1)	7.81					
F-D	-845 / 0	0.0	0.0	0.09 (1)	7.81					
H-G	0 / 0	-38.5	-38.5	0.27 (3)	10.00					
G-F	0 / 0	-38.5	-38.5	0.27 (3)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2010, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.37")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.03")
ALLOWABLE DEFL. (TL) = $L/360$ (0.37")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.03")

CSI: TC=0.41/1.00 (C-D:1), BC=0.27/1.00 (G-H:3), WB=0.09/1.00 (B-G:1), SS=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	618	364	1667
	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.76 (D) (INPUT = 0.80)
JSI METAL= 0.21 (B) (INPUT = 1.00)

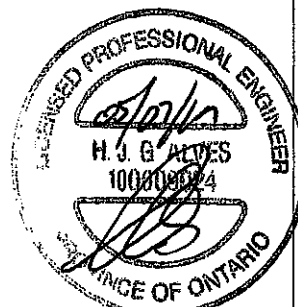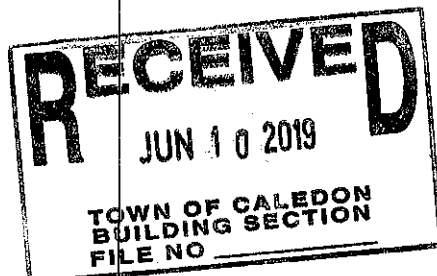


PROJ. NO. TAM 7210790
STRUCTURAL
DATE: 05/10/19

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	T32	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mittek Industries, Inc. Tue May 7 17:48:24 2019 Page 1

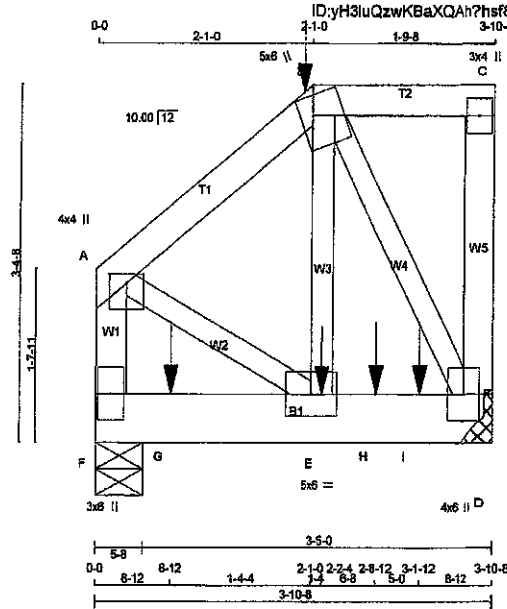

Scale = 1:20.1

TOTAL WEIGHT = 2 X 23 = 46 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - A	2x4	DRY	No.2	SPF	
A - B	2x4	DRY	No.2	SPF	
B - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
F-A 1	12	TOP
A-B 1	12	SIDE(81.0)
B-C 1	12	SIDE(81.0)
C-D 1	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
F-D 2	12	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
W3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTWV+m	MT20	5.0	6.0	2.25	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW-1	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER							
<u>BEARINGS</u>							
	FACTORED		MAXIMUM FACTORED			INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
F	1108	0	1108	0	0	5-8	5-8
D	957	0	957	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4'-0".

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM LIVE WIND DEAD SOIL
F	811 501/0 124/0 0/0 0/0 185/0 0/0
D	701 431/0 109/0 0/0 0/0 162/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO					FR-TO		
F-A	-827/0	0.0	0.0	0.04 (1)	A-E	0/426	0.05 (1)
A-B	-486/0	-102.1	-102.1	0.04 (1)	E-B	0/718	0.09 (1)
B-C	0/0	-102.1	-102.1	0.03 (1)	B-D	-770/0	0.08 (1)
D-C	-91/0	0.0	0.0	0.01 (1)			
F-G	0/0	-38.5	-38.5	0.13 (1)			
G-E	0/0	-38.5	-38.5	0.13 (1)			
E-H	0/397	-38.5	-38.5	0.10 (1)			
H-I	0/397	-38.5	-38.5	0.10 (1)			
I-D	0/397	-38.5	-38.5	0.10 (1)			

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.
B	2-1-0	-58	-58			BACK	VERT
E	2-2-4	-2	-2			BACK	VERT
G	8-12	-729	-729			FRONT	VERT
H	2-8-12	-724	-724			FRONT	VERT
I	3-1-12	-7	-7			BACK	VERT

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	29.1	PSF
DL	=	6.0	PSF	
BOT CH.	LL	=	10.5	PSF
DL	=	7.0	PSF	
TOTAL LOAD	=	52.5	PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.01")

CSI: TC=0.04/1.00 (A-B:1), BC=0.13/1.00 (E-F:1), WS=0.08/1.00 (B-E:1), SS=0.20/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
MT20	788	1987	1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JS GRIP= 0.28 (A) (INPUT = 0.90)
JS METAL= 0.09 (D) (INPUT = 1.00)

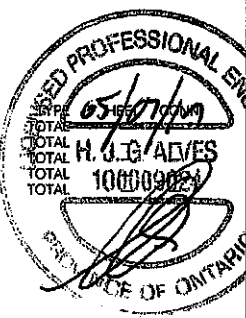


THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

NOTED TAM 11/10/19
JOURNAL
11/10/19

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402938	J1	19	1	GREEN PARK HOMES	
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:32 2019 Page 1
ID:VdmZNlanRCr_yT1tp?OGrtzKFiu-3MnBmkmw0SbQL4YK_XAlqd8QSVtyUbkbMM7ZNLzlgj

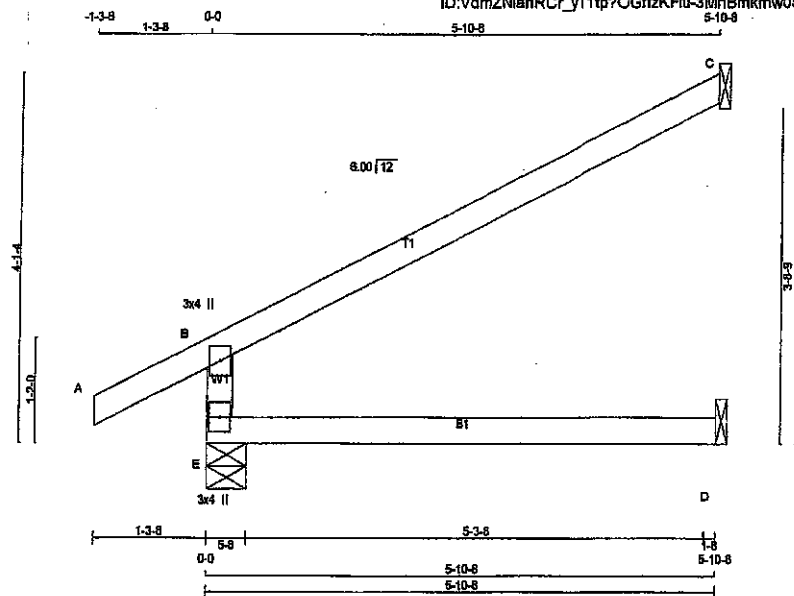

TOTAL WEIGHT = 19 X 17 = 319 lb

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	DOWN	UP	IN-SX	IN-SX
E	646	0	5-8	5-8
C	225	0	1-8	1-8
D	63	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	473	292 / 0	72 / 0	0 / 0	0 / 0	109 / 0	0 / 0
C	154	128 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
D	85	0 / 0	51 / 0	0 / 0	0 / 0	34 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)
FR-TO		FROM TO		
E-B	-514 / 0	0.0	0.0 0.22 (3)	7.81
A-B	0 / 31	-102.1	-102.1 0.13 (1)	10.00
B-C	-34 / 0	-102.1	-102.1 0.60 (1)	8.25
E-D	0 / 0	-38.5	-38.5 0.22 (3)	10.00

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/898$ (0.04")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/942$ (0.07")

CSI: TC=0.60/1.00 (B-C-1), BC=0.22/1.00 (D-E-3),
WB=0.60/1.00 (F-G-0), SSI=0.25/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1967 1958

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.21 (E) (INPUT = 0.90)
JSI METAL = 0.14 (B) (INPUT = 1.00)




DWG NO. TAM 1910753
STRUCTURAL
COMPONENT ONLY

JOB NAME 402939	TRUSS NAME J3	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.300.5 Apr 23 2019 Mitek Industries, Inc. Tue May 14 10:22:21 2019 Page 1

ID: yH3luQzwKBaXQAh7hsf8URzKCTp-9Oz5UIGT1BRyFvJDLAREZCL3okyZzoqV6x2R3zGdVW

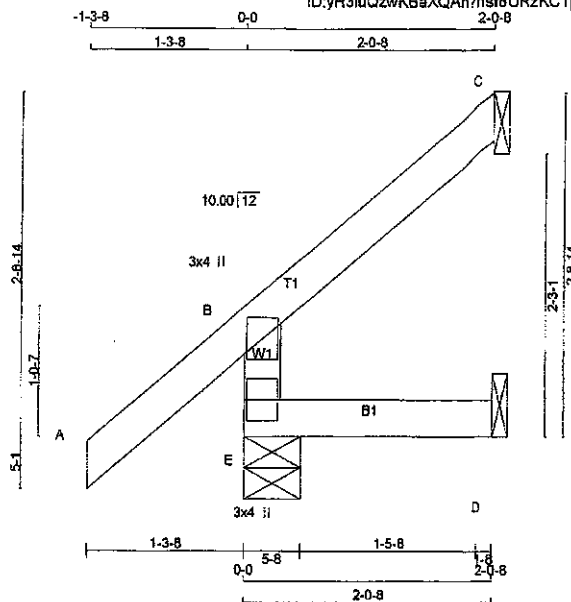

Scale = 1:17.0

TOTAL WEIGHT = 4 X 8 = 33 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED		MAXIMUM FACTORED		INPUT	RECORD
	GROSS REACTION	GROSS REACTION	DOWN	HORZ		
E	316	0	316	0	5-8	5-8
C	79	0	79	0	1-8	1-8
D	34	0	44	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	226	154 / 0	24 / 0	0 / 0	0 / 0	48 / 0	0 / 0
C	54	45 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
D	31	0 / 0	19 / 0	0 / 0	0 / 0	13 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS					WEBS					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)			LC1	MAX. CSI (LC)	UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO						FR-TO		
E-B	-271 / 0	0.0	0.0	0.02 (3)		7.81				
A-B	0 / 45	-102.1	-102.1	0.14 (1)		10.00				
B-C	-16 / 0	-102.1	-102.1	0.07 (1)		6.25				
E-D	0 / 0	-38.5	-38.5	0.03 (3)		10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 29.1	PSF
	DL = 8.0	PSF
BOT CH.	LL = 10.5	PSF
	DL = 7.0	PSF
TOTAL LOAD	= 52.5	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.00")

CSI: TC=0.14/1.00 (A-B:1), BC=0.03/1.00 (D-E:3), WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1687	788
	1987	1658

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.13 (B) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)



DWG NO. TAM 1194525
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402938	J5	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.230 8 Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:34 2019 Page 1					
ID:VdmZNlanRCr_YT1tp?OGrtzKFiu-0luYBQoAY4r8aOj8yCBv2AobIVVkyVDUqcfREZlqj					
TRUSS DESC.					

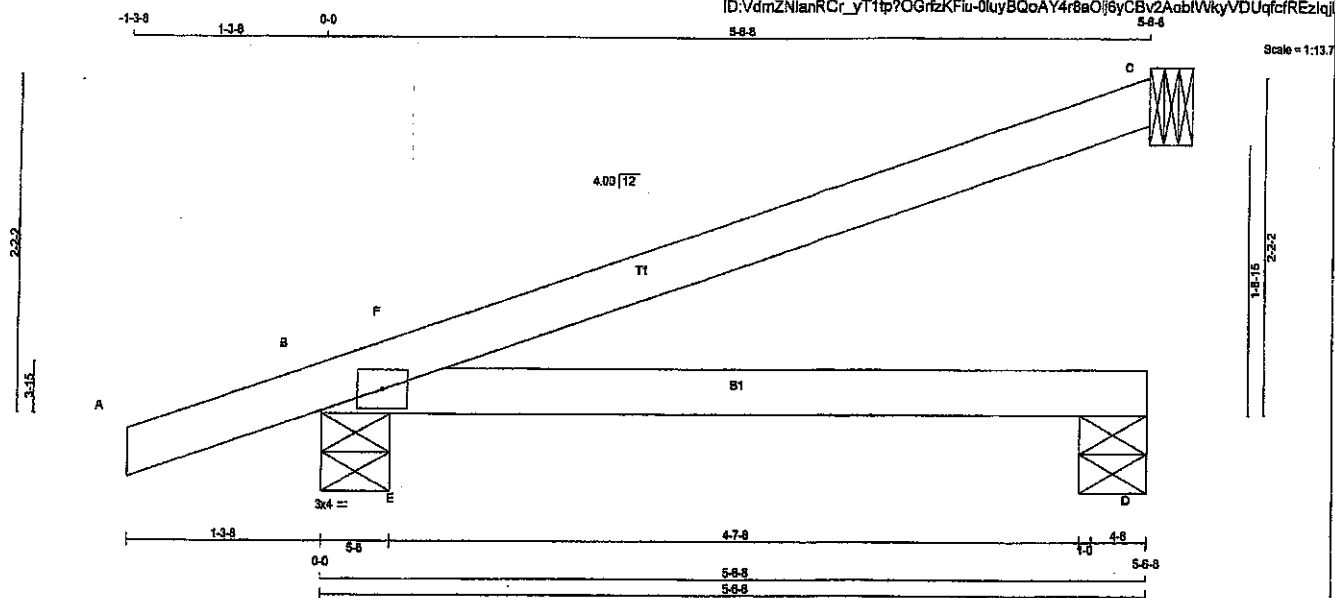

LUMBER					
N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.		
A - C	2x4	DRY	No.2		
B - D	2x4	DRY	No.2		
DRY: SEASONED LUMBER.					

PLATES (table in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B TMB14	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
FACTORED	MAXIMUM FACTORED	INPUT	REQD		
GROSS REACTION	GROSS REACTION	BRG	BRG		
JT VERT	JT VERT	IN-SX	IN-SX		
C 254	0	254	0	4-8	4-8
B 526	0	526	0	5-8	5-8
D 136	0	147	0	5-8	5-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C

UNFACTORED REACTIONS

1ST LCASE								
JT COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
C 178	136 / 0	9 / 0	0 / 0	0 / 0	34 / 0	0 / 0		
B 385	239 / 0	58 / 0	0 / 0	0 / 0	88 / 0	0 / 0		
D 113	25 / 0	49 / 0	0 / 0	0 / 0	38 / 0	0 / 0		

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING


TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS								
MEMB.	MAX. FACTORED	FACTORED	MAX.	MAX.	MEMB.	MAX. FACTORED	MAX.	
	FORCE	VERT. LOAD	LC1	LC1		FORCE	LC1	
	(LBS)	(PLF)	(LC)	(LC)		(LBS)	(LC)	
FR-TO		FROM	TO	LENGTH	FR-TO			
A-B	0 / 20	-102.1	-102.1	0.13 (1)	10.00	E-F	-281 / 125	0.00 (1)
B-F	-53 / 0	-102.1	-102.1	0.13 (3)	8.25			
F-C	0 / 6	-102.1	-102.1	0.43 (1)	10.00			
B-E	0 / 0	-38.5	-38.5	0.27 (1)	10.00			
E-D	0 / 0	-38.5	-38.5	0.32 (1)	10.00			

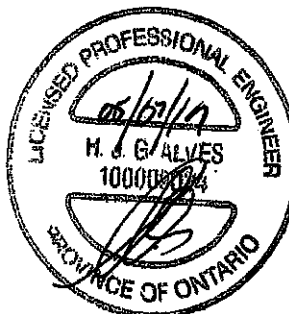

DESIGN CRITERIA

SPECIFIED LOADS:			
TOP CH.	LL	=	28.1 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	10.5 PSF
	DL	=	7.0 PSF
TOTAL LOAD			= 52.5 PSF

SPACING = 240 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/806$ (0.08")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/468$ (0.14")

CSI: TC=0.43N.00 (C-F:1), BC=0.32/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.28/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354 1667 788	1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.31 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)

DRWG NO. TAM 17910755
STRUCTURAL
COMPONENT ONLY


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	J20	7	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Tue May 7 17:48:08 2019 Page 1

ID:YH3luQzwKBaXQAht?hsf8URzkCTp-TYuu8ZJm7UErxqRBhGa7U7371HGimUQz2VGPzldqb

Scale = 1:30.0

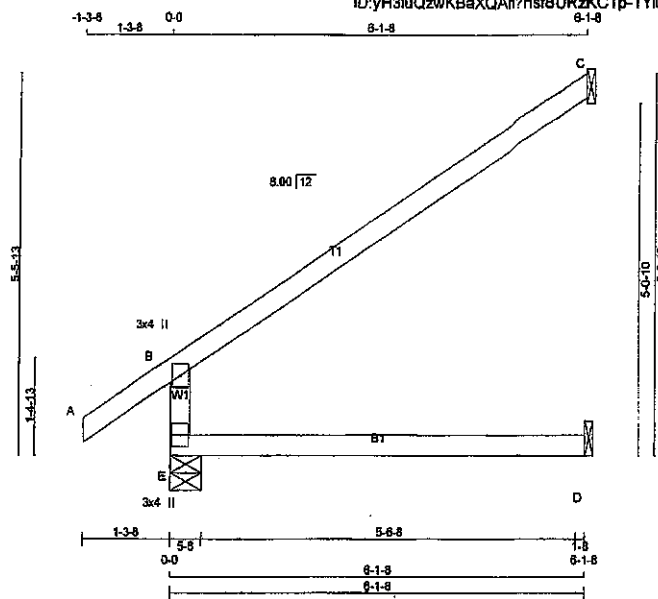

TOTAL WEIGHT = 7 X 18 = 126 lb

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	688	0	688	0	5-8	5-8
C	235	0	235	0	1-8	1-8
D	99	0	126	0	1-8	1-8

SEE MITEK STANDARD DETAIL 837821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	489	302 / 0	75 / 0	0 / 0	0 / 0	112 / 0	0 / 0
C	161	133 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
D	90	0 / 0	54 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED		MAX. UNBRAC LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
				FROM	TO				
E-B		-531 / 0	0.0	0.0	0.19 (3)	7.81			
A-B		0 / 39	-102.1	-102.1	0.14 (1)	10.00			
B-C		-43 / 0	-102.1	-102.1	0.50 (1)	6.25			
E-D		0 / 0	-38.5	-38.5	0.24 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.06")
ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL.(TL) = $L/799$ (0.08")

CSI: TC=0.50/1.00 (B-C:1), SC=0.24/1.00 (D-E:3), WB=0.00/1.00 (n/a:0), SS=0.25/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	618	354	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.18 (B) (INPUT = 1.00)

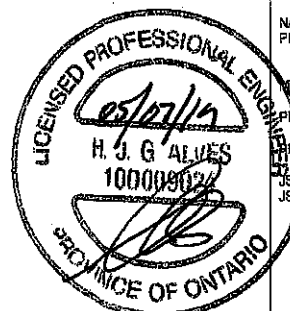


DRWG NO. TAN 11910773
FOR JOURNAL
CONSULT ONLY

JOB NAME 402939	TRUSS NAME J21	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamrack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MTEK Industries, Inc. Tue May 7 17:48:09 2019 Page 1

ID: yH3luQzwKBaXQAh?hsf8URzKCTp-xkGH5UaxRc5T5PdPnpQL1LhXPZ?90dfdn3przldda

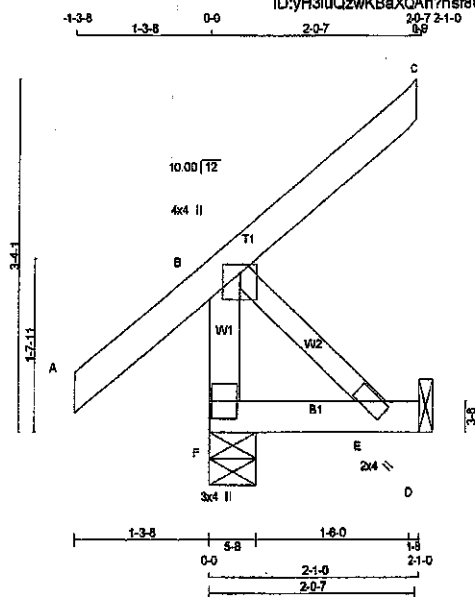

Scale = 1/202

TOTAL WEIGHT = 2 X 11 = 21 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No. 2	SPF		
A - C	2x4	DRY	No. 2	SPF		
F - D	2x4	DRY	No. 2	SPF		
ALL WEBS	2x3	DRY	No. 2	SPF		
DRY: SEASONED LUMBER.						

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
E	BMVW+p	MT20	2.0	4.0		
F	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
F	399	0	399	0
D	40	0	51	0

SEE MTEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) D

UNFACTORED REACTIONS

1ST CASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	283	204 / 0	22 / 0	0 / 0	0 / 0	57 / 0	0 / 0
D	36	0 / 0	22 / 0	0 / 0	0 / 0	15 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	LC1	MAX	MAX	MEMB.	MAX. FACTORED	FORCE	MAX
MEMB.	FORCE	VERT. LOAD	LC1	MAX	MAX	MEMB.	MAX. FACTORED	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)	UNBRAC	LENGTH	FR-TO		(LBS)	CSI (LC)	
FR-TO										
F-B	-359 / 0	0.0	0.0	0.04 (1)	7.81	B-E	0 / 0	0.00 (1)		
A-B	0 / 45	-102.1	-102.1	0.14 (1)	10.00					
B-C	-70 / 0	-102.1	-102.1	0.32 (1)	6.25					
F-E	0 / 0	-38.5	-38.5	0.04 (3)	10.00					
E-D	0 / 0	-38.5	-38.5	0.03 (3)	10.00					

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBCC 2015
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/889 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/889 (0.00")

CSI: TC=0.32/1.00 (B-C:1), BC=0.04/1.00 (E-F:3), WB=0.00/1.00 (B-E:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)	
	MAX	MIN	MAX	MIN
MT20	618	354	1887	788

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.28 (B) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)

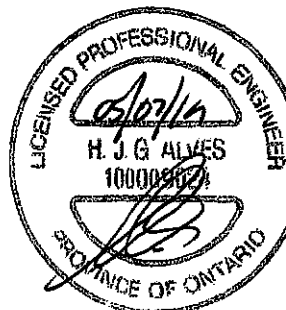

DESIGN NO. TAM 1910774
NATURAL
CITY ONLY

JOB NAME

402939

TRUSS NAME

J22

QUANTITY

2

PLY

1

JOB DESC.

GREEN PARK HOMES

TRUSS DESC.

DRWG NO.

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitak Industries, Inc. Tue May 7 17:48:10 2019 Page 1

ID:yH3luQzwKBaXQAhh7hsf8URzKCTp-QxqfJqbZHky5Ezqt6I2yYaXVxiCkcFmitGXdLHzlqdZ

Scale = 1:18

LUMBER

N. L. G. A. RULES

CHORDS SIZE

E - B 2x4 DRY No.2

A - C 2x4 DRY No.2

E - D 2x4 DRY No.2

DESCR.

SPF

SPF

SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	IN-SX	IN-SX
E	513	513	5-8	5-8
C	145	145	1-8	1-8
D	93	119	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	382	216 / 0	72 / 0	0 / 0	0 / 0	93 / 0	0 / 0
C	100	63 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	85	0 / 0	51 / 0	0 / 0	0 / 0	34 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRACED LENGTH	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO						FR-TO		
E-B	-380 / 0	0.0	0.0	0.21 (3)	7.81			
A-B	0 / 31	-102.1	-102.1	0.13 (1)	10.00			
B-C	-22 / 0	-102.1	-102.1	0.25 (1)	6.25			
E-D	0 / 0	-38.5	-38.5	0.21 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.1 PSF

DL = 6.0 PSF

BOT CH. LL = 10.5 PSF

DL = 7.0 PSF

TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. GC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

PART 9 OF CBC 2018, OBC 2012

CSA 086-09, CSA 086-14

TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")

CALCULATED VERT. DEFL. (LL) = L/999 (0.04")

ALLOWABLE DEFL. (TL) = L/360 (0.20")

CALCULATED VERT. DEFL. (TL) = L/942 (0.07")

CSI: TC=0.25/1.00 (B-C:1), BC=0.21/1.00 (D-E:3), WE=0.00/1.00 (N/A:0), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TEN=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

MAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION

(PSI) (PLI) (PLI)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.16 (E) (INPUT = 0.90)

JSI METAL= 0.11 (B) (INPUT = 1.00)

05/11/19

H. J. G. ALVES

10000902

LICENSED PROFESSIONAL ENGINEER

PROVINCE OF ONTARIO


ENGR. NO. TAM 1910775

STRUCTURAL

CLIP DESIGN ONLY

JOB NAME 402939	TRUSS NAME J23	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:48:10 2019 Page 1
 ID:yH3luQzwKBaXQAh?hsf8URzKCTp-QxqfJqbZHlky6Ezql612yYaYVxiokcFmtGXdlHHzldZ
 5-10-8

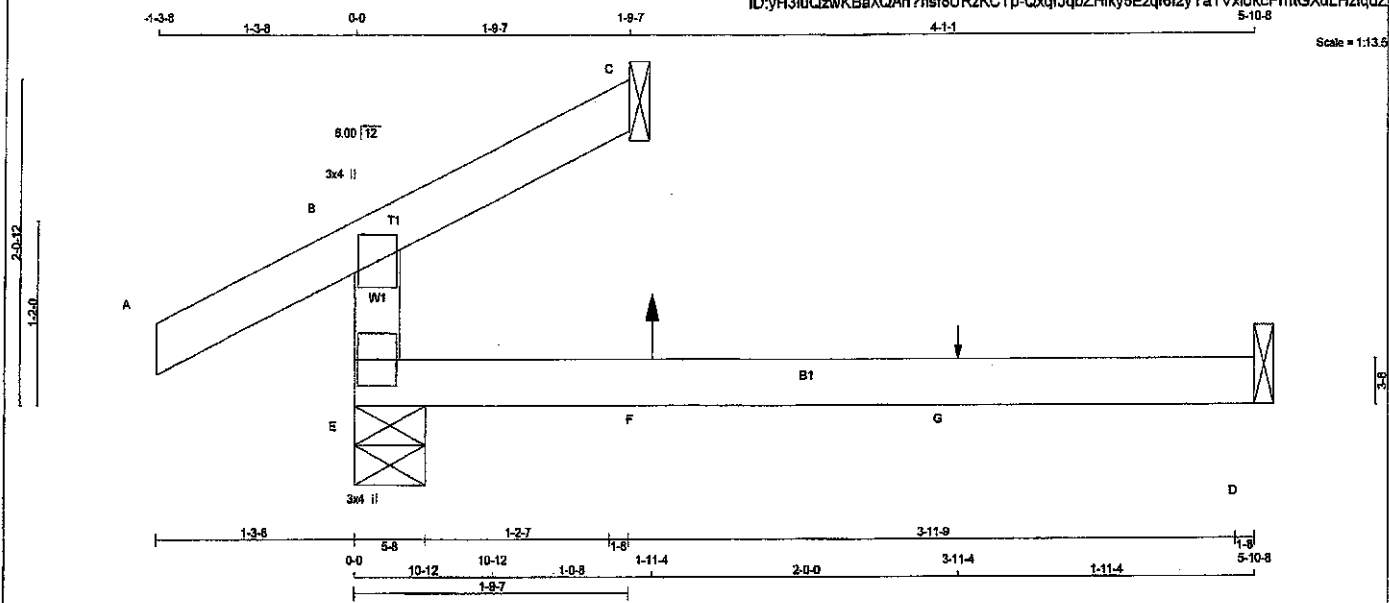

TOTAL WEIGHT = 2 X 12 = 23 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG					
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
E	352	0	352	0	0	5-8	5-8		
C	94	0	97	0	0	1-8	1-8		
D	94	0	123	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS							
JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	259	156 / 0	42 / 0	0 / 0	0 / 0	61 / 0	0 / 0
C	76	24 / 0	28 / 0	0 / 0	0 / 0	24 / 0	0 / 0
D	66	0 / -3	53 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING									
TOTAL LOAD CASES: (7)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LBS)	MAX. LC2 (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LBS)	MAX. LC2 (LBS)	
FR-TO		FROM TO			FR-TO				
E-B	-229 / 26	0.0	0.0	0.18 (3)	7.81				
A-B	0 / 31	-102.1	-102.1	0.15 (1)	10.00				
B-C	0 / 27	-102.1	-102.1	0.18 (3)	10.00				
E-F	0 / 0	-38.5	-38.5	0.23 (3)	10.00				
F-G	0 / 0	-38.5	-38.5	0.23 (3)	10.00				
G-D	0 / 0	-38.5	-38.5	0.23 (3)	10.00				

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	8	1	13	BACK	VERT	TOTAL	-	-
G	3-11-4	1	1	-	BACK	VERT	TOTAL	-	-

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 28.1 PSF
 DL = 8.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. O.C.
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015
 THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, CBC 2012
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.
 (55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
 CALCULATED VERT. DEFL. (LL) = L/699 (0.05")
 ALLOWABLE DEFL. (TL) = L/360 (0.20")
 CALCULATED VERT. DEFL. (TL) = L/639 (0.08")
 CSI: TC=0.18/1.00 (B-E-3), BC=0.23/1.00 (D-E-3),
 WB=0.00/1.00 (n/a-0), SS=0.14/1.00 (D-E-3)

DOL LUMBER=1.00 NAIL=1.00 LBS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00
 COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
 JSI METAL= 0.06 (B) (INPUT = 1.00)

ENGINEER, TAM 71910776
 STRUCTURAL
 CIVIL ENGINEERING



THIS STRUCTURE MUST BE
 CONSTRUCTED TO MEET OR
 EXCEED THE PROVISIONS OF
 THE ONTARIO BUILDING CODE

JOB NAME 402939	TRUSS NAME J24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:48:11 2019 Page 1	
ID: yH3luQzwKBaXQAn7hsf8URzKCTp-u7O1W9bB22spIOYsqHvM6IFK5DT3Vw8wGAijzldqY Scale = 1:18.7					

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER E - B 2x4 DRY No.2 A - C 2x4 DRY No.2 E - D 2x4 DRY No.2 DRY: SEASONED LUMBER. PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMV+p MT20 3.0 4.0 E BMV1+p MT20 3.0 4.0	DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">JT</th> <th colspan="2">FACTORED GROSS REACTION</th> <th colspan="2">MAXIMUM FACTORED GROSS REACTION</th> <th rowspan="2">INPUT BRG IN-SX</th> <th rowspan="2">REQD BRG IN-SX</th> </tr> <tr> <th>VERT</th> <th>HORZ</th> <th>DOWN</th> <th>HORZ</th> </tr> </thead> <tbody> <tr> <td>E</td> <td>420</td> <td>0</td> <td>420</td> <td>0</td> <td>5-8</td> <td>5-8</td> </tr> <tr> <td>C</td> <td>145</td> <td>0</td> <td>145</td> <td>0</td> <td>1-8</td> <td>1-8</td> </tr> <tr> <td>D</td> <td>32</td> <td>0</td> <td>41</td> <td>0</td> <td>1-8</td> <td>1-8</td> </tr> </tbody> </table> SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D UNFACTORED REACTIONS <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">JT</th> <th rowspan="2">COMBINED</th> <th colspan="2">1ST LCASE</th> <th rowspan="2">LIVE</th> <th rowspan="2">PERM. LIVE</th> <th rowspan="2">WIND</th> <th rowspan="2">DEAD</th> <th rowspan="2">SOIL</th> </tr> <tr> <th>MAX</th> <th>MIN</th> </tr> </thead> <tbody> <tr> <td>E</td> <td>297</td> <td>216/0</td> <td>22/0</td> <td>0/0</td> <td>0/0</td> <td>59/0</td> <td>0/0</td> <td>0/0</td> </tr> <tr> <td>C</td> <td>100</td> <td>83/0</td> <td>0/0</td> <td>0/0</td> <td>0/0</td> <td>17/0</td> <td>0/0</td> <td>0/0</td> </tr> <tr> <td>D</td> <td>29</td> <td>0/0</td> <td>18/0</td> <td>0/0</td> <td>0/0</td> <td>12/0</td> <td>0/0</td> <td>0/0</td> </tr> </tbody> </table> BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.	JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX	VERT	HORZ	DOWN	HORZ	E	420	0	420	0	5-8	5-8	C	145	0	145	0	1-8	1-8	D	32	0	41	0	1-8	1-8	JT	COMBINED	1ST LCASE		LIVE	PERM. LIVE	WIND	DEAD	SOIL	MAX	MIN	E	297	216/0	22/0	0/0	0/0	59/0	0/0	0/0	C	100	83/0	0/0	0/0	0/0	17/0	0/0	0/0	D	29	0/0	18/0	0/0	0/0	12/0	0/0	0/0	LOADING TOTAL LOAD CASES: (5) <table border="1" style="width:100%; border-collapse: collapse;"> <thead> <tr> <th rowspan="2">MEMB.</th> <th rowspan="2">MAX. FACTORED FORCE (LBS)</th> <th colspan="2">FACTORED VERT. LOAD</th> <th rowspan="2">MAX. FACTORED VERT. LOAD (LBS)</th> <th rowspan="2">MAX. FACTORED HORIZ. LOAD (LBS)</th> <th rowspan="2">MAX. FACTORED TORSION (LBS-FT)</th> </tr> <tr> <th>FROM</th> <th>TO</th> </tr> </thead> <tbody> <tr> <td>E-B</td> <td>-380/0</td> <td>0.0</td> <td>0.0</td> <td>0.01 (3)</td> <td>7.81</td> <td></td> </tr> <tr> <td>A-B</td> <td>0/31</td> <td>-102.1</td> <td>-102.1</td> <td>0.13 (1)</td> <td>10.00</td> <td></td> </tr> <tr> <td>B-C</td> <td>-22/0</td> <td>-102.1</td> <td>-102.1</td> <td>0.25 (1)</td> <td>6.25</td> <td></td> </tr> <tr> <td>E-D</td> <td>0/0</td> <td>-38.5</td> <td>-38.5</td> <td>0.03 (3)</td> <td>10.00</td> <td></td> </tr> </tbody> </table> CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD		MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED TORSION (LBS-FT)	FROM	TO	E-B	-380/0	0.0	0.0	0.01 (3)	7.81		A-B	0/31	-102.1	-102.1	0.13 (1)	10.00		B-C	-22/0	-102.1	-102.1	0.25 (1)	6.25		E-D	0/0	-38.5	-38.5	0.03 (3)	10.00	
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX																																																																																																							
	VERT	HORZ	DOWN	HORZ																																																																																																									
E	420	0	420	0	5-8	5-8																																																																																																							
C	145	0	145	0	1-8	1-8																																																																																																							
D	32	0	41	0	1-8	1-8																																																																																																							
JT	COMBINED	1ST LCASE		LIVE	PERM. LIVE	WIND	DEAD	SOIL																																																																																																					
		MAX	MIN																																																																																																										
E	297	216/0	22/0	0/0	0/0	59/0	0/0	0/0																																																																																																					
C	100	83/0	0/0	0/0	0/0	17/0	0/0	0/0																																																																																																					
D	29	0/0	18/0	0/0	0/0	12/0	0/0	0/0																																																																																																					
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD		MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)	MAX. FACTORED TORSION (LBS-FT)																																																																																																							
		FROM	TO																																																																																																										
E-B	-380/0	0.0	0.0	0.01 (3)	7.81																																																																																																								
A-B	0/31	-102.1	-102.1	0.13 (1)	10.00																																																																																																								
B-C	-22/0	-102.1	-102.1	0.25 (1)	6.25																																																																																																								
E-D	0/0	-38.5	-38.5	0.03 (3)	10.00																																																																																																								

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 29.1 PSF
 DL = 8.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012
 - CSA 088-09, CSA 086-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.
 (55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
 ALLOWABLE DEFL. (TL) = L/360 (0.19")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.25/1.00 (B-C:1), BC=0.03/1.00 (D-E:3)
 WB=0.00/1.00 (n/a:0), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1867 789 1987 1655

PLATE PLACEMENT TOL = 0.250 inches
 PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.16 (E) (INPUT = 0.90)
 JSI METAL= 0.11 (B) (INPUT = 1.00)

DWG NO. TAM 17910777
 DATE 07/11/19
 CHECKED BY ONLY


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
402939	J25	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:48:12 2019 Page 1

ID:YH3luQzwKBaXQAh7hsf8URzKCTp-MJyPjVcqpM_gKY7CQXLW2zfpkRGCV13La0jQAZlqdX

Scale = 1:13.5

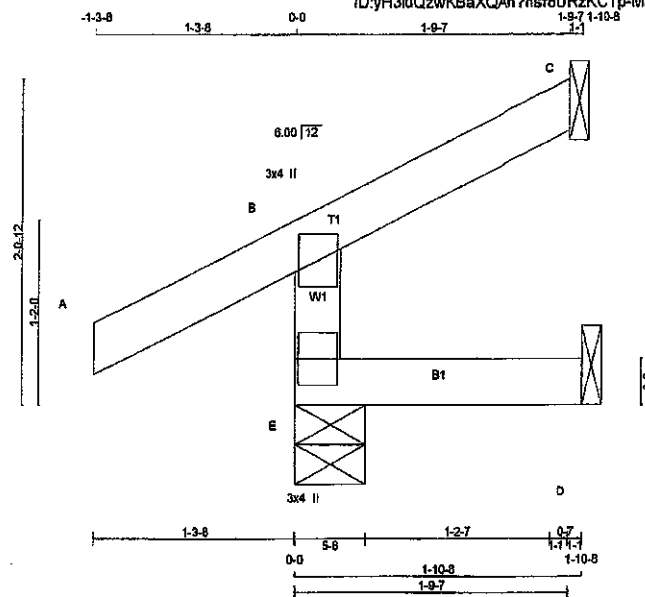

TOTAL WEIGHT = 2 X 7 = 14 lb

LUMBER

N. L. G. A. RULES

CHORDS SIZE

E - B 2x4 DRY

A - C 2x4 DRY

E - D 2x4 DRY

LUMBER

No.2

No.2

No.2

DESCR.

SPF

SPF

SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	318	0	318	0	5-8	5-8
C	51	0	51	0	-28	1-8
D	24	0	41	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. COMPONENT REACTIONS					SOIL
		SNOW	LIVE	PERMLIVE	WIND	DEAD	
E	226	160 / 0	20 / 0	0 / 0	0 / 0	46 / 0	0 / 0
C	38	27 / -21	2 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	24	0 / -9	18 / 0	0 / 0	0 / 0	11 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED UNBRAC LENGTH FR-TO	MAX. FACTORED FORCE (LBS)
E-B	-270 / 0	0.0	0.0	0.04 (5)
A-B	0 / 31	-102.1	-102.1	0.13 (1)
B-C	-18 / 0	-102.1	-102.1	0.10 (1)
E-D	0 / 0	-38.5	-38.5	0.04 (5)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	29.1	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	52.5	PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OSC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.00/1.00 (n/a:0), SSI=0.10/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354
	1667	788
	1987	1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)



ENGINEER TAM 7/10/17
STRUCTURAL
CALCULATIONS ONLY





isDesign™

Client:
Project:
Address:Date: 5/7/2019
Designer:
Job Name: 201007
Project #:

Page 1 of 4

BM1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

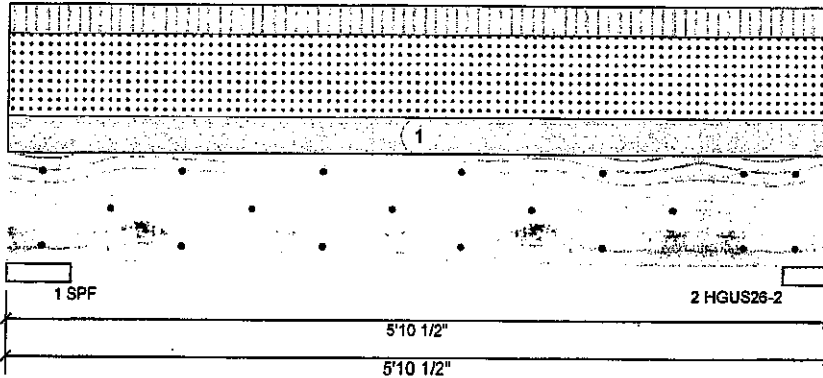**Member Information**

Type: Girder
Plies: 2
Moisture Condition: Dry
Deflection LL: 360
Deflection TL: 360
Importance: Normal

Application: Roof (Residential)
Slope: 0/12
Design Method: LSD
Building Code: NBCC 2015
Load Sharing: No
Deck: Not Checked
Vibration: Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	207	257	583	0
2	199	246	558	0

Bearings and Factored Reactions


Bearing	Length	Cap. React	D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	5.500"	14%	321 / 1081	1402 L	1.25D+1.5S +L
2 - HGUS...	4.000"	18%	308 / 1036	1344 L	1.25D+1.5S +L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	1585 ft-lb	3'	6039 ft-lb	0.262 (26%)	1.25D+1.5S +L	L
Unbraced	1585 ft-lb	3'	5236 ft-lb	0.303 (30%)	1.25D+1.5S +L	L
Shear	1217 lb	1'2"	3984 lb	0.306 (31%)	1.25D+1.5S +L	L
LL Defl inch	0.014 (L/4497)	3'	0.174 (L/360)	0.080 (8%)	S+0.5L	L
TL Defl inch	0.019 (L/3273)	3'	0.174 (L/360)	0.110 (11%)	D+S+0.5L	L

Design Notes

- 1 Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top braced at bearings.
- 5 Bottom braced at bearings.
- 6 Lateral slenderness ratio based on single ply width.

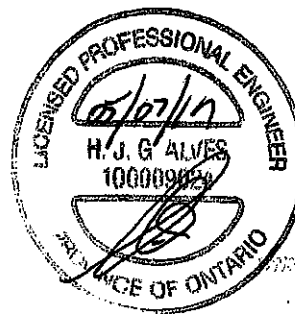

77910792

STRUCTURAL

100009029

1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		6-7-0	Near Face	13 PSF	10.5 PSF	29.5 PSF	0 PSF	

Manufacturer Info

Tamarack Roof Trusses
3289 North Service Rd., ON
Canada
L7N3G2
(905) 335-1115



This design is valid until 12/11/2021





isDesign™


Client:
Project:
Address:

Date: 5/7/2019
Designer:
Job Name: 201007
Project #:

Page 2 of 4

BM1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

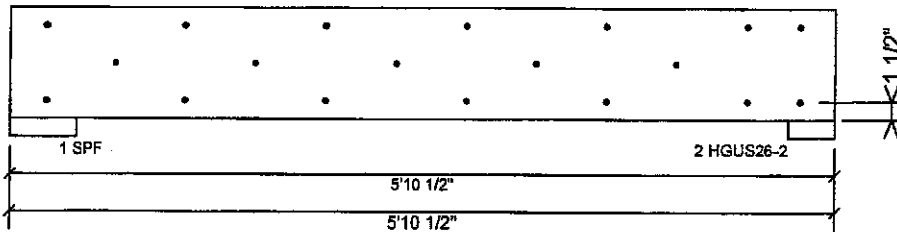

Multi-Ply Analysis

Fasten all plies using 3 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c.. Maximum end distance not to exceed 6"

Capacity	88.7 %
Load	233.7 PLF
Yield Limit per Foot	340.0 PLF
Yield Limit per Fastener	113.3 lb.
Yield Mode	9
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S+L
Duration Factor	1.00



ENGINEER 1910192
STRUCTURAL
CONSTRUCTION
3/2

Manufacturer Info	Tamarack Roof Trusses 3269 North Service Rd., ON Canada L7N3G2 (905) 335-1115
	TAMARACK LUMBER INC. ALMA LUMBER GROUP

This design is valid until 12/11/2021







isDesign™

Client:
Project:
Address:Date: 5/7/2019
Designer:
Job Name: 201007
Project #:

Page 3 of 4

BM2 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

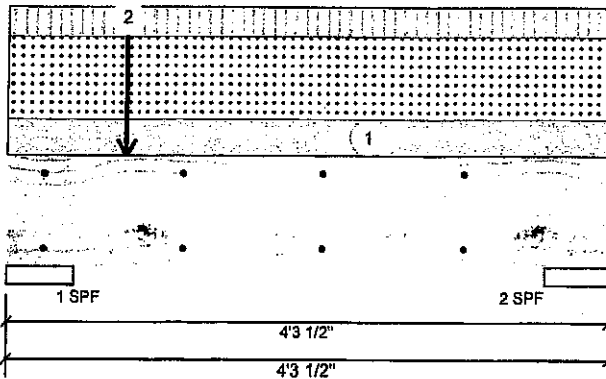**Member Information**

Type: Girder
Plies: 2
Moisture Condition: Dry
Deflection LL: 360
Deflection TL: 360
Importance: Normal

Application: Roof (Residential)
Slope: 0/12
Design Method: LSD
Building Code: NBCC 2015
Load Sharing: No
Deck: Not Checked
Vibration: Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	149	192	449	0
2	81	101	232	0

Bearings and Factored Reactions


Bearing	Length	Cap. React D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	5.500"	10%	239 / 822	1062 L
2 - SPF	5.500"	5%	127 / 430	557 L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	504 ft-lb	1'9"	6039 ft-lb	0.084 (8%)	1.25D+1.5S	L
Unbraced	504 ft-lb	1'9"	5676 ft-lb	0.089 (9%)	1.25D+1.5S	L
Shear	691 lb	1'2"	3984 lb	0.173 (17%)	1.25D+1.5S	L
LL Defl inch	0.002	2' 3/4"	0.117 (L/360)	0.020 (2%)	S+0.5L	L
	(L/20503)					
TL Defl inch	0.003	2' 3/4"	0.117 (L/360)	0.020 (2%)	D+S+0.5L	L
	(L/14977)					

Design Notes

- 1 Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 8".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top loads must be supported equally by all plies.
- 5 Top braced at bearings.
- 6 Bottom braced at bearings.
- 7 Lateral slenderness ratio based on single ply width.

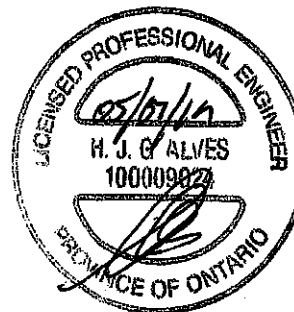

REGISTERED TAM 17410793
STRUCTURAL
ALPHA LUMBER GROUP

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		3-1-0	Near Face	13 PSF	10.5 PSF	29.5 PSF	0 PSF	
2	Point	0-10-2		Top	121 lb	91 lb	291 lb	0 lb	

Manufacturer Info

Tamarack Roof Trusses
3269 North Service Rd., ON
Canada
L7N3G2
(905) 335-1115



This design is valid until 12/11/2021





isDesign™



Client:
Project:
Address:

Date: 5/7/2019
Designer:
Job Name: 201007
Project #:

Page 4 of 4

BM2 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED


Level: Level

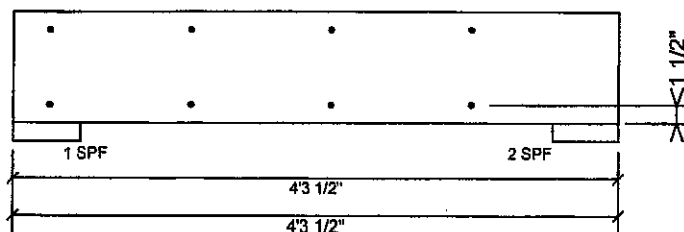

Multi-Ply Analysis

Fasten all plies using 2 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6"

Capacity	42.8 %
Load	109.5 PLF
Yield Limit per Foot	255.6 PLF
Yield Limit per Fastener	127.8 lb.
Yield Mode	9
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S+L
Duration Factor	1.00

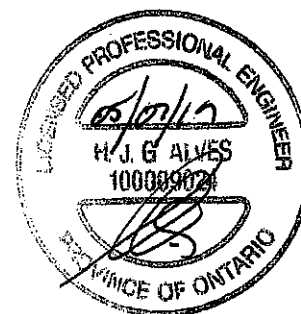

PROF. TAM 17910793
STRUCTURAL
2019-01-01

Manufacturer Info

Tamarack Roof Trusses
3288 North Service Rd., ON
Canada
L7N3G2
(805) 335-1115



This design is valid until 12/11/2021



ONTARIO WOOD TRUSS
FABRICATORS ASSOCIATION

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

TECH-NOTES


TN 15-001 Piggyback Bracing

Overview:

Where piggybacks are connected overtop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

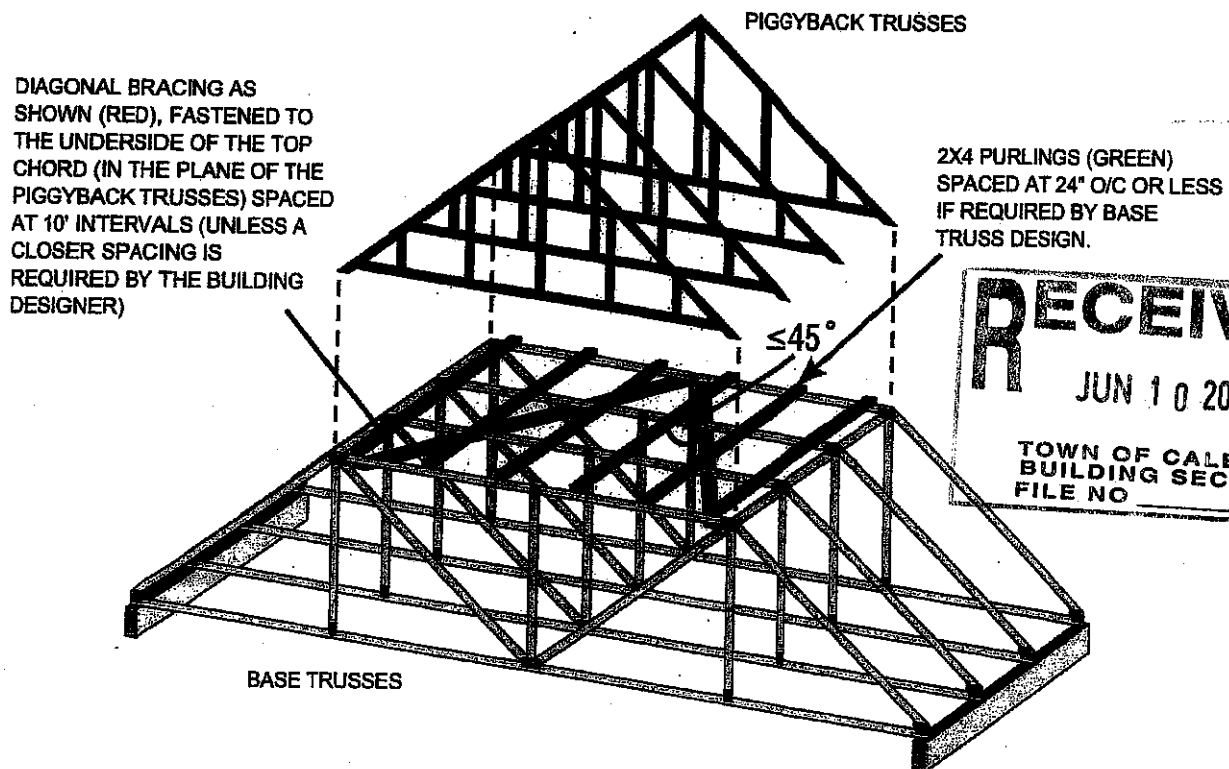

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

SKETCH FROM BCSI-CANADA 2013

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

LUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge


Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:

- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.




Typical LUS Installation

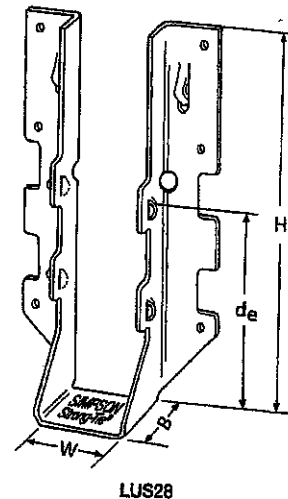


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
LUS24	18	1 1/8	3 1/8	1 1/4	1 1/8	(4) 10d	(2) 10d	710	1630	645	1155
LUS24-2	18	3 1/8	3 1/8	2	1 1/8	(4) 16d	(2) 16d	835	2020	590	1435
LUS26	18	1 1/8	4 1/8	1 1/4	3 3/8	(4) 10d	(4) 10d	1420	2170	1290	1630
LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
LUS26-3	18	4 1/8	4 1/8	2	3 1/4	(4) 16d	(4) 16d	1720	2595	1545	2340
LUS28	18	1 1/8	6 1/8	1 1/4	3 3/4	(6) 10d	(6) 10d	1420	2520	1290	1790
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
LUS28-3	18	4 1/8	6 1/4	2	3 3/4	(6) 16d	(4) 16d	1720	3325	1545	2375
LUS210	18	1 1/8	7 1/8	1 1/4	3 3/8	(8) 10d	(4) 10d	1420	2785	1290	2210
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
LUS210-3	18	4 1/8	8 3/8	2	5 1/4	(8) 16d	(6) 16d	2580	3345	2320	2375

1. d_e is the distance from the seat of the hanger to the highest joist nail.



Dome Double Shear Nailing prevents tabs breaking off (available on some models).
U.S. Patent 5,603,580



Double Shear Nailing Top View.




DESIGN

The products shown are manufactured by Simpson Strong-Tie Company, Inc. and are registered trademarks of Simpson Strong-Tie Company, Inc. in the United States and other countries. All other trademarks are the property of their respective owners. © 2017 Simpson Strong-Tie Company, Inc.

(800) 999-5099
strongtie.com

SIMPSON
Strong-Tie

- See current catalogue for options



Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e	Face	Joist	D.F-I-L		S-P-F	
								Uplift (K _p =1.15) lb.	Normal (K _p =1.00) lb.	Uplift (K _p =1.15) lb.	Normal (K _p =1.00) lb.
LJS26DS	18	1 ¹ / ₁₆	5	3 ¹ / ₂	4 ¹ / ₂	(16) 16d	(6) 16d	2055	4265	1480	4115
HUS26	16	1 ¹ / ₈	5 ¹ / ₂	3	3 ¹ / ₁₆	(14) 16d	(6) 16d	2705	4940	2065	3875
HUS28	16	1 ¹ / ₈	7 ¹ / ₂	3	6 ¹ / ₂	(22) 16d	(8) 16d	3605	5365	2675	4345
HUS210	16	1 ¹ / ₈	9 ¹ / ₂	3	7 ¹ / ₂	(30) 16d	(10) 16d	4505	5795	4010	4740
HUS1.81/10	16	1 ¹ / ₁₆	9	3	8	(30) 16d	(10) 16d	4505	6450	4010	5200

Double
Shear
Nailing
Top View



中国

© 2017 Springer Science+Business Media B.V. All rights reserved. This article is distributed under the terms of the Creative Commons Attribution 4.0 International License (<http://creativecommons.org/licenses/by/4.0/>), which permits unrestricted use, distribution, and reproduction in any medium, provided you give appropriate credit to the original author(s) and the source, provide a link to the Creative Commons license, and indicate if changes were made.

(800) 999-5099
strongtie.com

HGUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:




- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%.
No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:

- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications




Options:

- See current catalogue for options

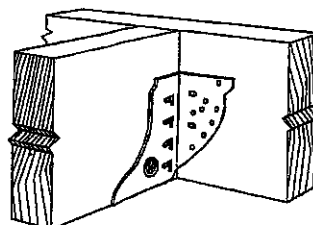


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁ ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _u =1.00)	Uplift (K _u =1.15)	Normal (K _u =1.00)
HGUS26	12	1 1/8	5 3/8	5	4 3/32	(20) 16d	(8) 16d	2685	6625	2685	5700
HGUS26-2	12	3 3/16	5 7/16	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-3	12	4 1/16	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-4	12	6 3/16	5 7/16	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d	3310	7675	3100	6900
HGUS28-2	12	3 3/16	7 3/16	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-3	12	4 1/16	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-4	12	6 3/16	7 3/16	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS210-2	12	3 3/16	9 3/16	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS210-3	12	4 1/16	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS210-4	12	6 3/16	9 3/16	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS212-4	12	6 3/16	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
HGUS214-4	12	6 3/16	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645

1. d₁ is the distance from the seat of the hanger to the highest joist nail.



(800) 999-5099
strongtie.com

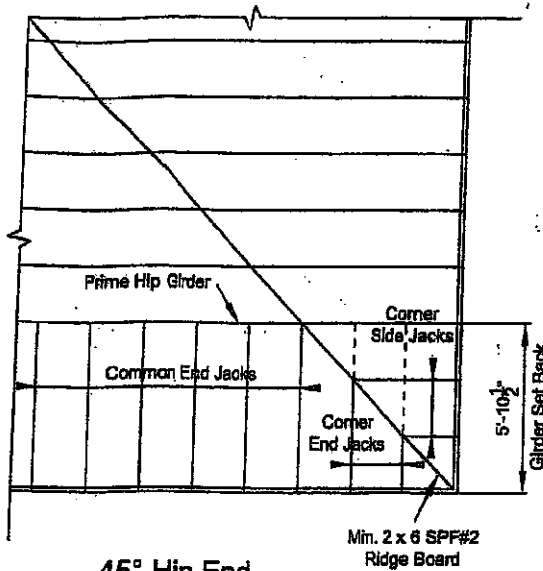

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD : 50.5 P.S.F

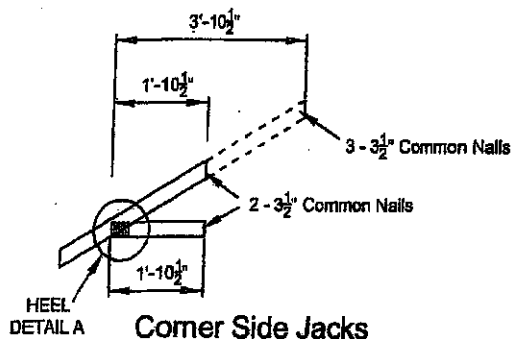


Corner Side Jacks

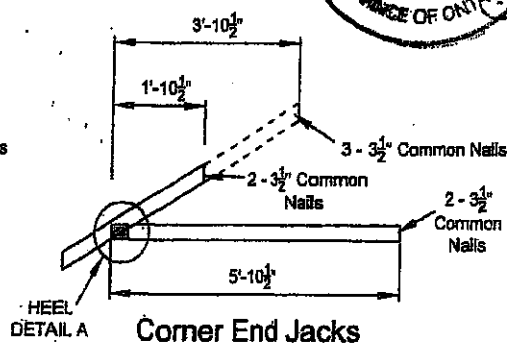

Corner End Jacks

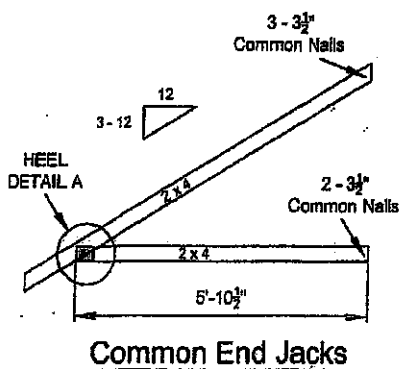


Common End Jacks

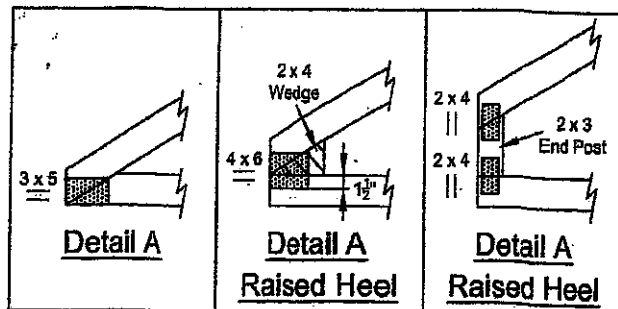

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1820216

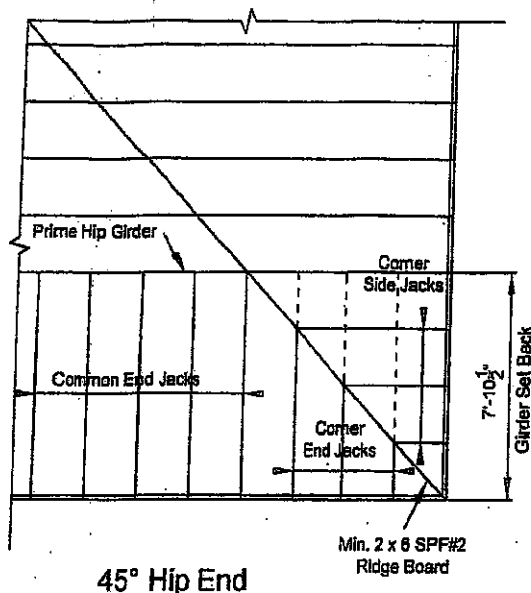

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD

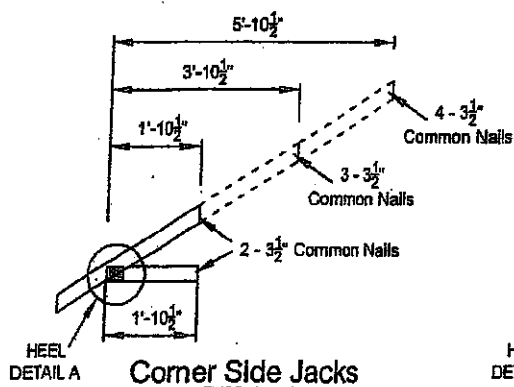


Corner Side Jacks

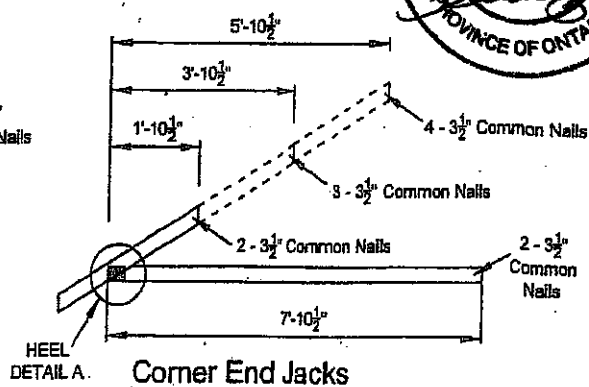

Corner End Jacks

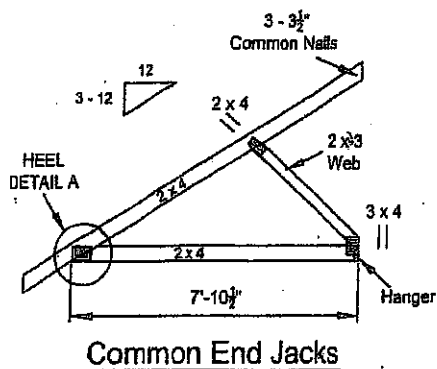

Common End Jacks

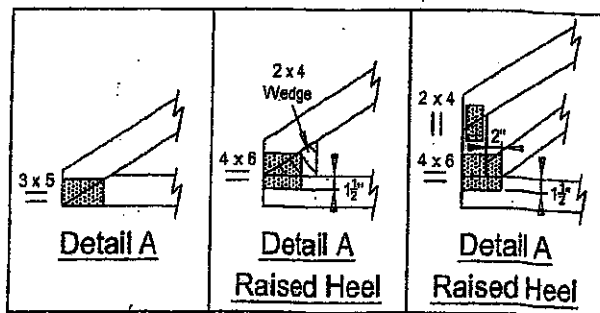


NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)


T-1800217

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

TPIC: Truss Design Procedures and Specifications for Light Metal-Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

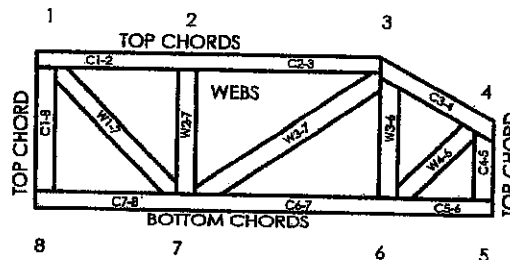

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MH-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

**THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE**

T-1900218

Feb 09, 2018