

9/12 ROOF PITCH
UNLESS OTHERWISE SPECIFIED

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF
THE ONTARIO BUILDING CODE

12 " FINISH O.H
R.T.M.C
2X6 EXTERIOR WALLS
ASPHALT SHINGLES
2X6 FASCIA BOARD

DESIGN LOADS:
GS LOAD 1.8 KPA
TC DEAD 6 PSF
BC LIVE 10.5 PSF
BC DEAD 7 PSF

ALL CONVENTIONAL ROOF
FRAMING TO CONFORM TO
PART9 OF THE OBC.LATEST
EDITION ROOF RAFTERS
THAT MEET OR CROSS
OVER TRUSSES ARE TO BE
2"X4" SPF @24"o.c. WITH A
2"X4"SPF VERTICAL POST
TO THE TRUSS UNDER AT
EACH CROSS POINT. POSTS
LONGER THAN 6' TO BE
LATERALLY BRACED SO
THAT THE DISTANCE
BETWEEN END POINTS AND
BETWEEN ROWS OF
BRACING DOES NOT
EXCEED 6'.


TRUSSES DESIGNED
CONFORM TO THE
RELEVANT SECTION OF THE
LATEST EDITION OF THE
ONTARIO BUILDING CODE
(RESIDENTIAL PART 9)

HARDWARE
LUS24(O)
...
LJS26DS(V)
...

BM21,22: 2-2X10

DENOTES
CONVENTIONAL
FRAMING

RECEIVED
JUN 13 2019
TOWN OF CALEDON
BUILDING SECTION
FILE NO

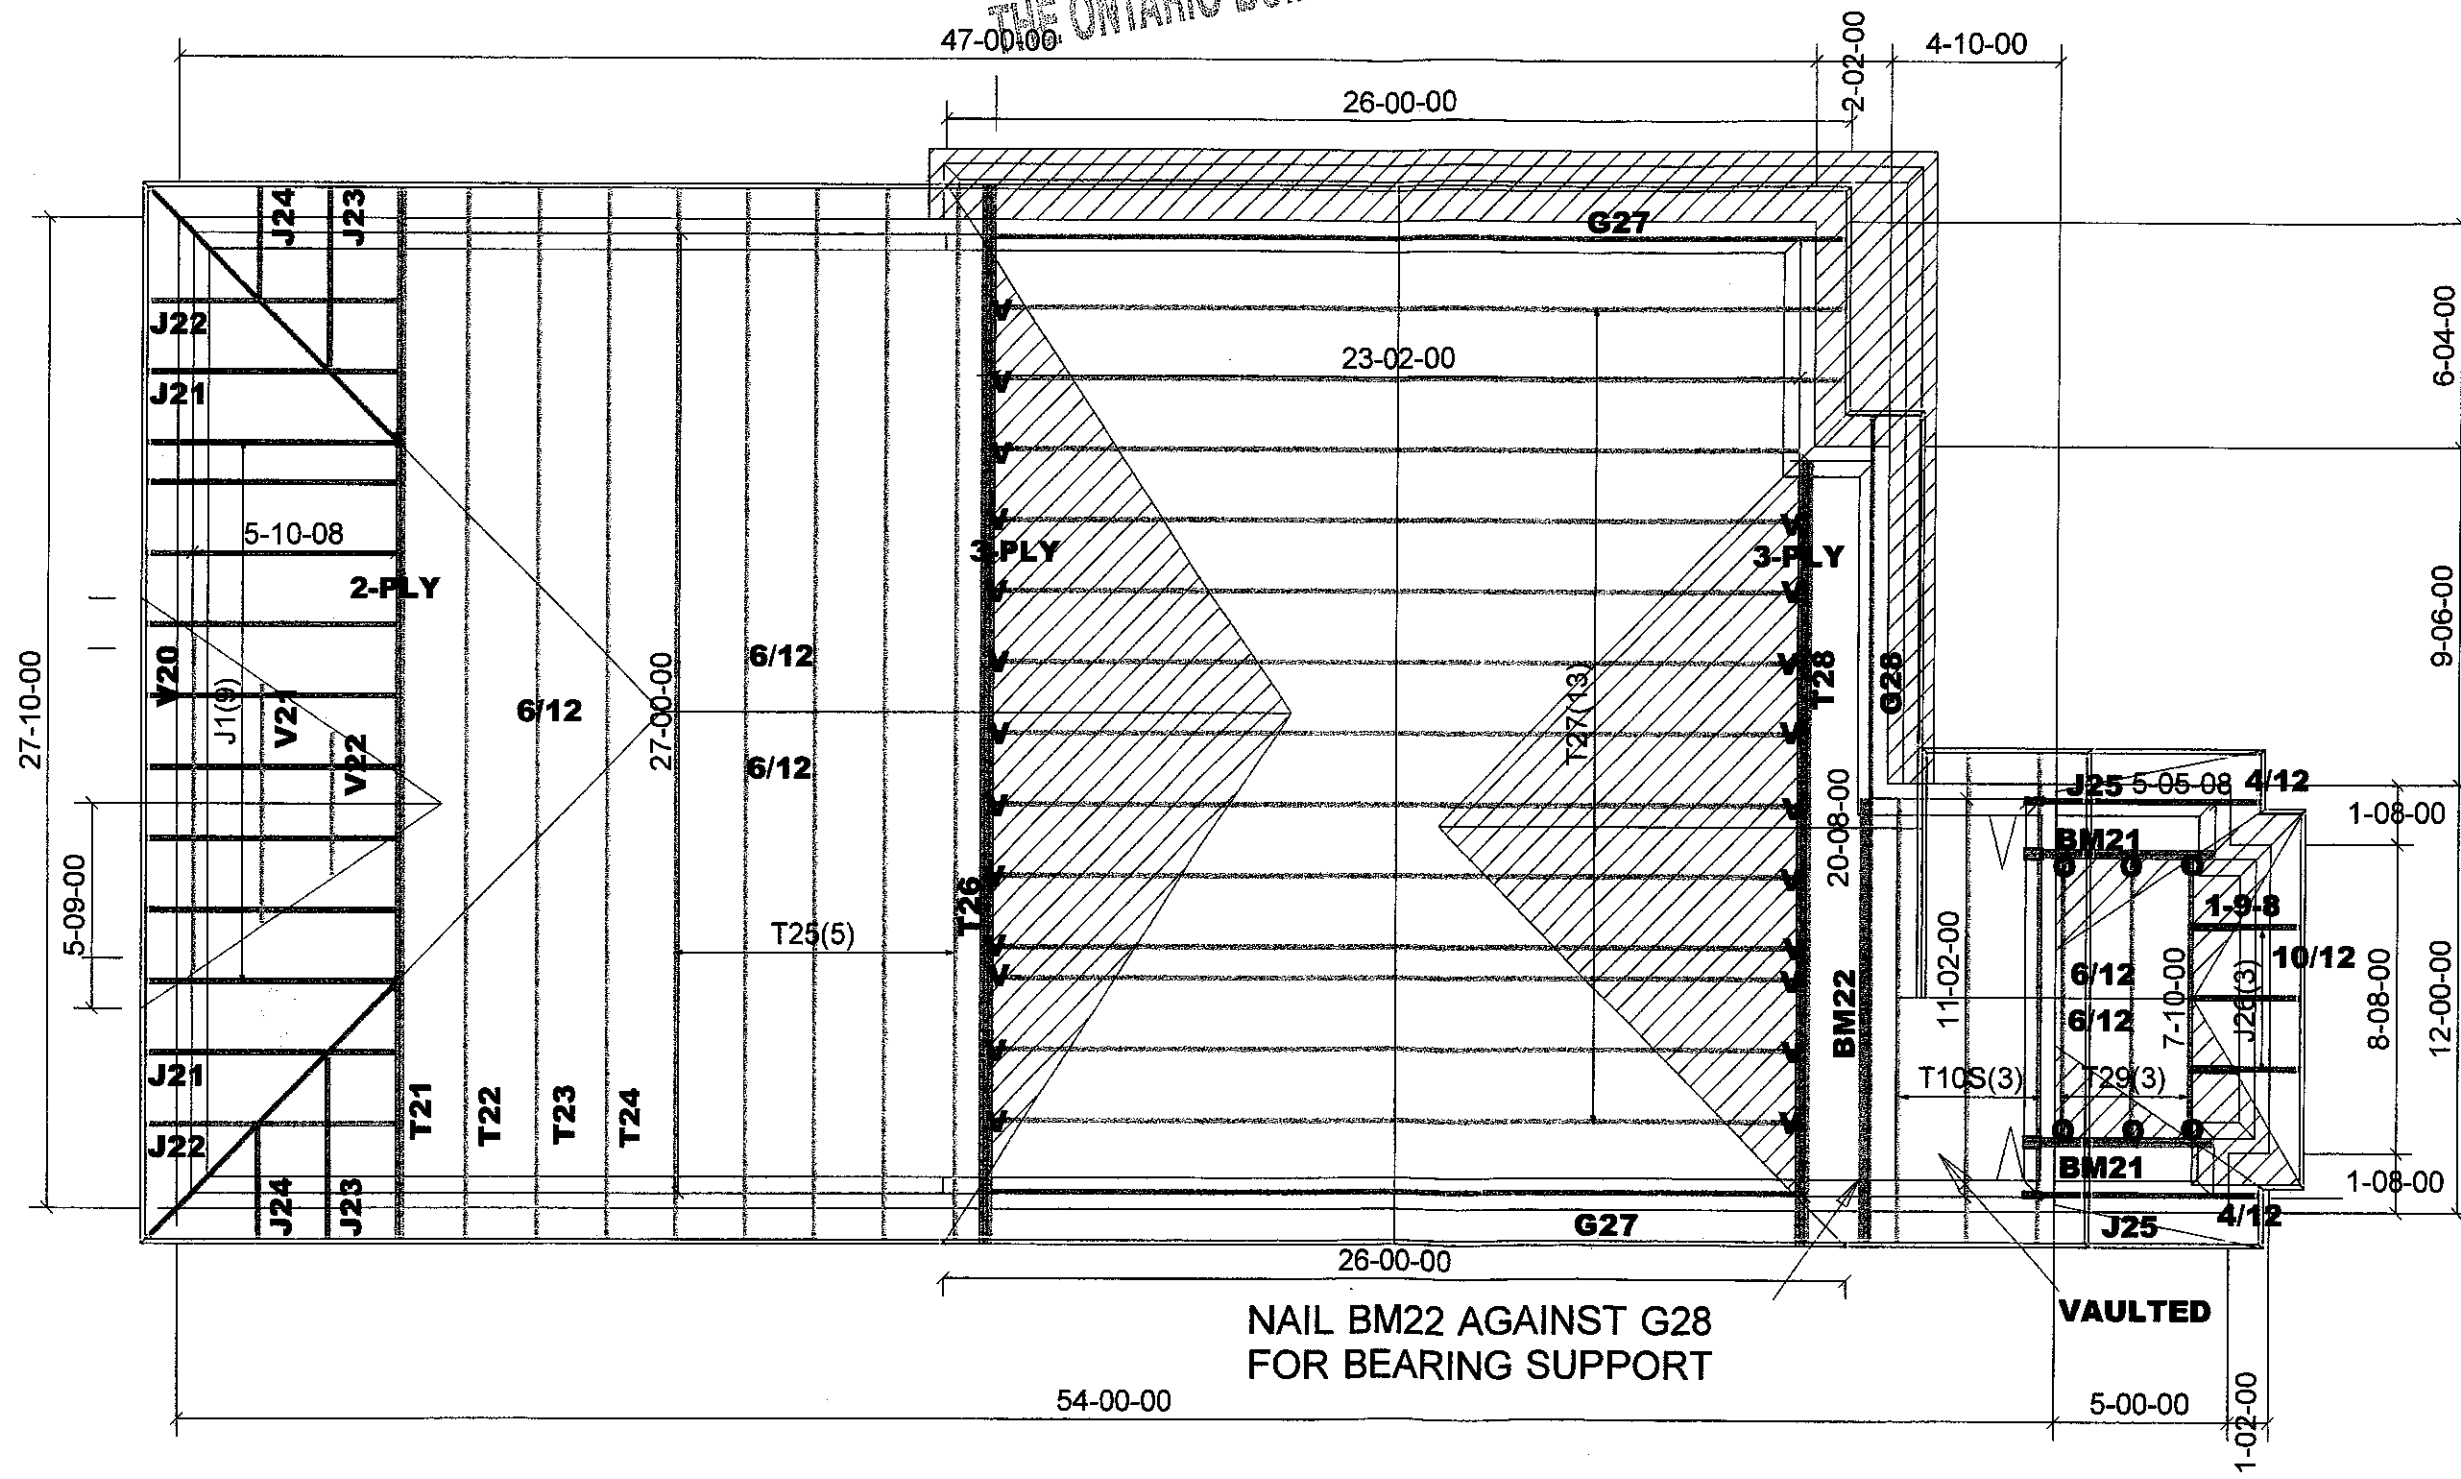

M12249



Job Track: **50033**
Plan Log: **201008**
Layout ID: **402970**

Builder / Location:
GREEN PARK HOMES / CALEDON
Project: **LAMBERT LANE PH.2**
Date: 5/6/2019 Sales: **Mario DiCano** Designer: JG

Model / Elevation:
BARTON 2/2-REAR UPGRADE

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.




DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BARTON 2
 Lot #:
 Elevation: 2-REAR UPGRADE

Job Track: 50033
 PlanLog: 201008
 Layout ID: 402970
 Ref #
 Page: 1 of 2
 Date: 05/06/2019
 Designer:
 Sales Rep: Mario DiCano





Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	T10S Scissor	9/12 7/12	11-02-00	5-08-08	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	145.11 94.50		
	1 2-ply	T21 Hip Girder	6/12	27-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	217.92 138.00		
	1	T22 Hip	6/12	27-00-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	109.31 68.83		
	1	T23 Hip	6/12	27-00-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	110.95 70.67		
	1	T24 Hip	6/12	27-00-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	112.6 70.67		
	5	T25 Common	6/12	27-00-00	7-11-00	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	545.05 336.67		
	1 3-ply	T26 Common Girder	6/12	27-00-00	7-11-00	2 x 4 2 x 6	1-05-00 1-05-00	1-02-00 1-02-00	383.04 234.00		
	13	T27 Common	9/12	23-02-00	10-02-08	2 x 4		1-06-04 1-06-04	1396.45 875.33		
	2	G27 GABLE	9/12	23-02-00	10-02-08	2 x 4	1-03-08 1-03-08	1-06-04 1-06-04	236.55 154.67		
	1 3-ply	T28 Common Girder	9/12	20-08-00	9-03-04	2 x 4 2 x 6	1-05-00 1-05-00	1-06-04 1-06-04	324.72 199.50		
	1	G28 GABLE	9/12	20-08-00	9-03-04	2 x 4 2 x 6	1-03-08 1-03-08	1-06-04 1-06-04	115.75 74.50		
	3	T29 Common	6/12	7-10-00	2-06-04	2 x 4		6-12 6-12	66.4 43.00		
	1	V20 Valley	9/12	9-04-00	3-06-00	2 x 4			27.35 18.17		
	1	V21 Valley	9/12	6-08-00	2-06-00	2 x 4			17.38 11.00		

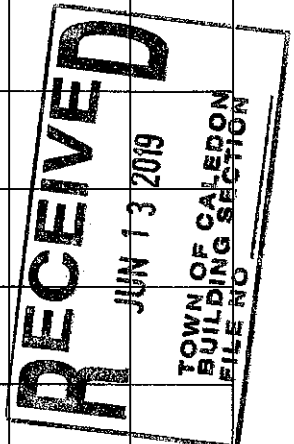

DELIVERY SHIPLIST		
 TAMARACK LUMBER INC. ALPA LUMBER GROUP	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: LAMBERT LANE PH.2 Location: CALEDON Model: BARTON 2 Lot #: Elevation: 2-REAR UPGRADE	Job Track: 50033 PlanLog: 201008 Layout ID: 402970 Ref # Page: 2 of 2 Date: 05/06/2019 Designer: Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	V22 Valley	9 /12	4-00-00	1-06-00	2 x 4			9.1 6.67		
	9	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	151.15 96.00		
	2	J21 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	J22 Jack-Open Girder	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	J23 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	2	J24 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		
	2	J25 GABLE	4 /12	5-05-08	2-06-11	2 x 4	1-03-08	3-15 2-01-12	28.9 18.67		
	3	J26 Jack-Open	10 /12	1-09-08	2-11-07	2 x 4	1-03-08	1-00-07 2-06-06	22.79 16.00		

TOTAL # TRUSS= 63 TOTAL BFT OF ALL TRUSSES= 2580.18 BFT. TOTAL WEIGHT OF ALL TRSSES 4105.15 LBS


HARDWARE

QTY	TYPE	MODEL	LENGTH
23	Hardware	LJS26DS	
6	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 29

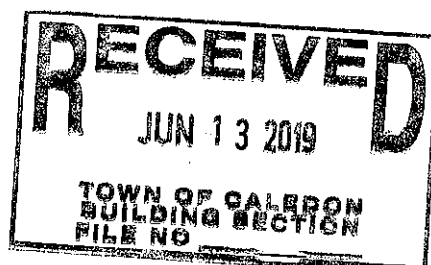

JOB NAME 402939	TRUSS NAME T21	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 6 Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:48:13 2019 Page 1 ID: yH3luQzwKBaXQAh7ha8URzKCTp-qVvNxdSag8XyilP_FslaBCy48h4xqRDaElHyozlqdW	
1-3-8 0-0 5-10-8 5-10-8 7-7-8 13-8-0 7-7-8 21-1-8 5-10-8 27-0-0 1-3-8 Scale = 1/4" = 1'-0"					

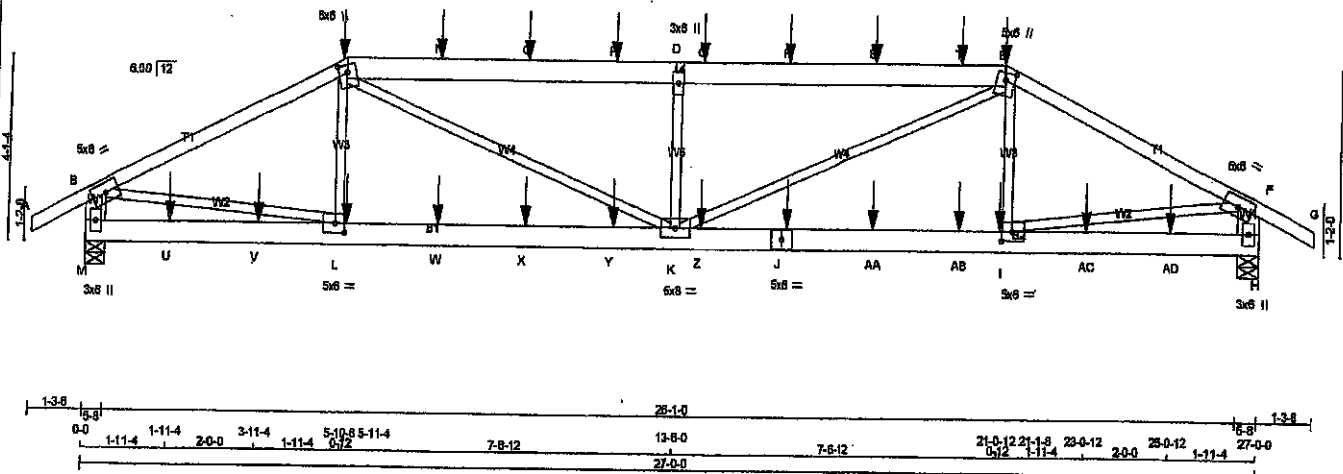

TOTAL WEIGHT = 2 X 128 = 256 lb

LUMBER			
N. L. & A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No. 2
C - E	2x4	DRY	No. 2
E - G	2x4	DRY	No. 2
M - B	2x4	DRY	No. 2
H - F	2x4	DRY	No. 2
M - J	2x4	DRY	No. 2
J - H	2x4	DRY	No. 2

ALL WEBS EXCEPT
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122'X3') SPIRAL NAILS		
A-C 1	12	SIDE (61.0)
E-G 1	12	SIDE (61.0)
C-E 2	12	SIDE (61.0)
M-B 2	12	TOP
H-F 2	12	TOP
BOTTOM CHORDS: (0.122'X3') SPIRAL NAILS		
M-J 2	12	SIDE (163.1)
J-H 2	12	SIDE (163.1)
WEBS: (0.122'X3') SPIRAL NAILS		
L-C 1	6	SIDE (1.4)
I-E 1	6	SIDE (1.4)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table in in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TMVW	MT20	5.0	8.0		
D	TTWW	MT20	5.0	6.0	2.00	2.50
C	TMVW	MT20	5.0	8.0		
E	TTWW	MT20	5.0	6.0	2.00	2.50
F	TMVW	MT20	5.0	8.0		
H	BMVW	MT20	5.0	6.0		
I	BMVW	MT20	6.0	6.0	2.50	2.75
J	BSA	MT20	5.0	6.0		
K	BMVW	MT20	5.0	8.0		
L	BMVW	MT20	5.0	6.0	2.50	2.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	JT	BRG	JT	BRG
M	3270	0	3270	0	5-8	5-8	5-8
H	3325	0	3325	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS
M	COMBINED	SNOW LIVE PERMLIVE WIND DEAD SOIL
M	2445	1351 / 0 487 / 0 0 / 0 0 / 0 805 / 0 0 / 0
H	2485	1373 / 0 497 / 0 0 / 0 0 / 0 818 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED MEMB. FORCE (LBS)
A-B	0 / 31	-102.1 -102.1 0.07 (1)	10.00
B-C	-4802 / 0	-102.1 -102.1 0.54 (1)	3.92
C-N	-9483 / 0	-102.1 -102.1 0.48 (1)	4.20
N-O	-9483 / 0	-102.1 -102.1 0.48 (1)	4.20
O-P	-9483 / 0	-102.1 -102.1 0.48 (1)	4.20
P-Q	-9483 / 0	-102.1 -102.1 0.48 (1)	4.20
Q-R	-9483 / 0	-102.1 -102.1 0.48 (1)	4.20
R-S	-9483 / 0	-102.1 -102.1 0.48 (1)	4.20
S-T	-9483 / 0	-102.1 -102.1 0.48 (1)	4.20
T-E	-9483 / 0	-102.1 -102.1 0.48 (1)	4.20
E-F	-4902 / 0	-102.1 -102.1 0.55 (1)	3.88
F-G	0 / 31	-102.1 -102.1 0.07 (1)	10.00
M-B	-3144 / 0	0.0 0.0 0.11 (1)	7.78
H-F	-3201 / 0	0.0 0.0 0.11 (1)	7.74

MEMB.	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED MEMB. FORCE (LBS)
M-U	0 / 0	-38.5 -38.5 0.13 (3)
U-V	0 / 0	-38.5 -38.5 0.13 (3)
V-L	0 / 0	-38.5 -38.5 0.13 (3)
L-W	0 / 4307	-38.5 -38.5 0.38 (1)
W-X	0 / 4307	-38.5 -38.5 0.38 (1)
X-Y	0 / 4307	-38.5 -38.5 0.38 (1)
Y-K	0 / 4307	-38.5 -38.5 0.38 (1)
K-Z	0 / 4396	-38.5 -38.5 0.38 (1)
Z-J	0 / 4396	-38.5 -38.5 0.38 (1)
J-AA	0 / 4396	-38.5 -38.5 0.38 (1)
AA-AB	0 / 4396	-38.5 -38.5 0.38 (1)
AB-I	0 / 4396	-38.5 -38.5 0.38 (1)
I-AC	0 / 0	-38.5 -38.5 0.13 (3)
AC-AD	0 / 0	-38.5 -38.5 0.13 (3)
AD-H	0 / 0	-38.5 -38.5 0.13 (3)

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-473	-473	FRONT	VERT	TOTAL	---	---
E	21-1-8	-473	-473	FRONT	VERT	TOTAL	---	---
J	21-0-12	-53	-70	FRONT	VERT	TOTAL	---	---
L	18-1-4	-55	-70	FRONT	VERT	TOTAL	---	---
N	5-11-4	-55	-70	FRONT	VERT	TOTAL	---	---
N	8-1-4	-123	-123	FRONT	VERT	TOTAL	---	---

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-06, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.90")
CALCULATED VERT. DEFL. (LL) = L/988 (0.13")
ALLOWABLE DEFL. (TL) = L/360 (0.90")
CALCULATED VERT. DEFL. (TL) = L/988 (0.22")

CSI: TC=0.55/1.00 (E-F:1), BC=0.39/1.00 (H-K:1),
WB=0.55/1.00 (F-1:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1657 788 1987 1858

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

SI GRIP=0.88 (L) (INPUT = 0.90)
SI METAL=0.95 (I) (INPUT = 1.00)

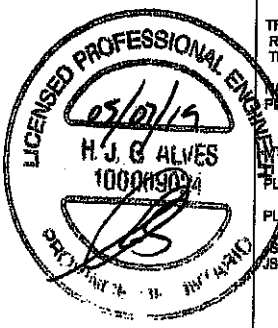

DRWG NO. TAM 17910779
DATE 12/1/19
BY 1/2

CONTINUED ON PAGE 2



RECEIVED
JUN 13 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO. _____

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402939	T21	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 Mittek Industries, Inc. Tue May 7 17:48:13 2018 Page 2
ID:yH3luQzwKBaXQAht?hsf8URzkCTp-qVWnxrdSap8XyilP_FalaBCy48h4xqRDaEIHyczlodW


FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
O	10-1-4	-123	-123	—	FRONT	VERT	TOTAL	—	—
P	12-1-4	-123	-123	—	FRONT	VERT	TOTAL	—	—
Q	14-1-4	-123	-123	—	FRONT	VERT	TOTAL	—	—
R	16-1-4	-123	-123	—	FRONT	VERT	TOTAL	—	—
S	18-1-4	-123	-123	—	FRONT	VERT	TOTAL	—	—
T	20-1-4	-123	-123	—	FRONT	VERT	TOTAL	—	—
U	1-11-4	-55	-74	—	FRONT	VERT	TOTAL	—	—
V	3-11-4	-55	-70	—	FRONT	VERT	TOTAL	—	—
W	8-1-4	-55	-70	—	FRONT	VERT	TOTAL	—	—
X	10-1-4	-55	-70	—	FRONT	VERT	TOTAL	—	—
Y	12-1-4	-55	-70	—	FRONT	VERT	TOTAL	—	—
Z	14-1-4	-55	-70	—	FRONT	VERT	TOTAL	—	—
AA	16-1-4	-55	-70	—	FRONT	VERT	TOTAL	—	—
AB	20-1-4	-55	-70	—	FRONT	VERT	TOTAL	—	—
AC	23-0-12	-55	-70	—	FRONT	VERT	TOTAL	—	—
AD	25-0-12	-55	-74	—	FRONT	VERT	TOTAL	—	—

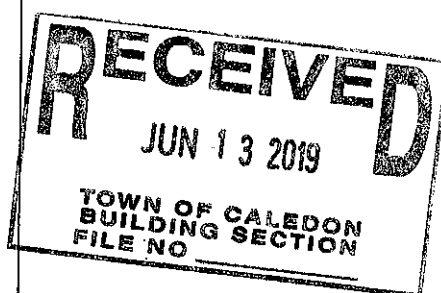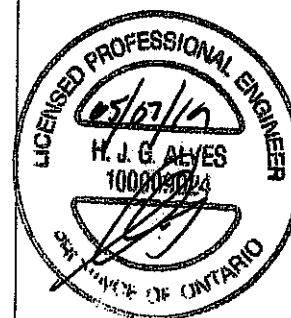

ENGINE NO. TAM 1910779
STRUCTURAL
CHECKED ONLY
3/2

JOB NAME 402939	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:48:14 2019 Page 1
 ID: yH3luQzwKBaXQah7hsf8URzKCTp-113A8B4LzEOasHbXyN_70K7GYlgDEMouVqU2zldv
 Scale = 1:46.8

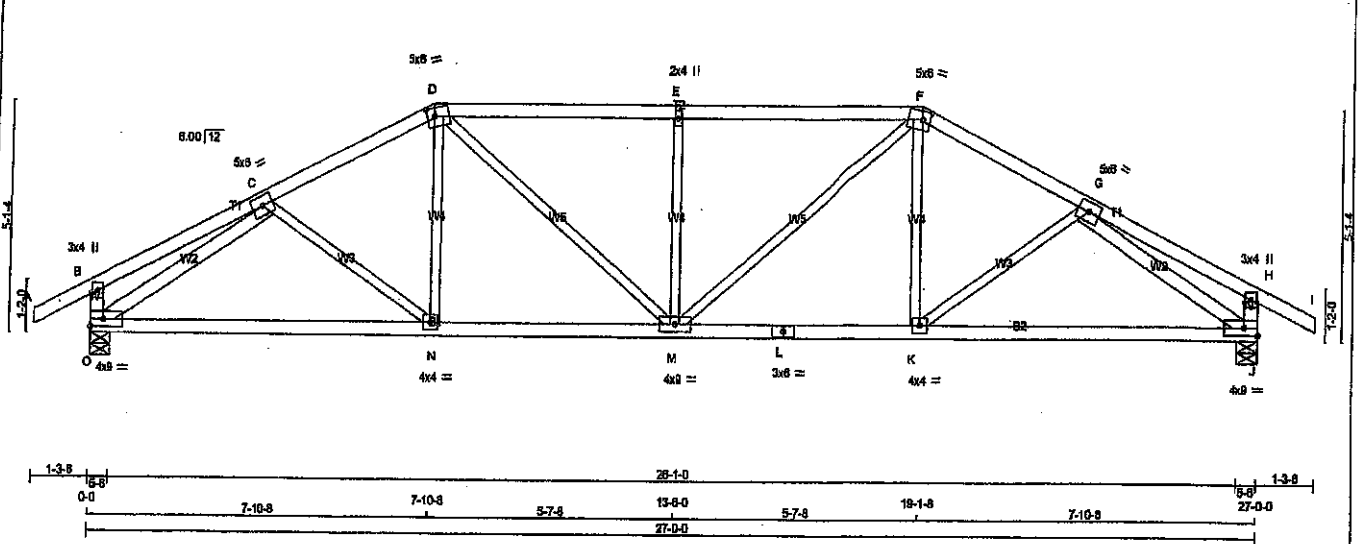

TOTAL WEIGHT = 109 lb
(NIP)

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
D - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
O - C	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	8.0		
D	TTWW-m	MT20	5.0	8.0	2.25	2.00
E	TMWW-w	MT20	2.0	4.0		
F	TTWW-m	MT20	5.0	8.0	2.25	2.00
G	TMWW-t	MT20	5.0	8.0		
H	TMV+p	MT20	3.0	4.0		
J	BMVW-t	MT20	4.0	9.0		Edge
K	BMWW-t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	8.0		
M	BMWW-w	MT20	4.0	9.0		
N	BMWW-t	MT20	4.0	4.0		
O	BMVW-t	MT20	4.0	9.0		Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQ'D BRG	
JT	VERT	JT	DOWN	IN-SX	IN-SX		
O	2037	0	2037	0	5-8	5-8	
J	2037	0	2037	0	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	1514	863 / 0	284 / 0	0 / 0	0 / 0	367 / 0	0 / 0
J	1514	863 / 0	284 / 0	0 / 0	0 / 0	367 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 31	-102.1 -102.1	0.13 (1)	C-N	-3 / 138	0.03 (3)	
B-C	0 / 19	-102.1 -102.1	0.23 (1)	N-D	0 / 375	0.08 (2)	
C-D	-2533 / 0	-102.1 -102.1	0.25 (1)	D-M	0 / 647	0.15 (1)	
D-E	-2748 / 0	-102.1 -102.1	0.52 (1)	M-E	-702 / 0	0.27 (1)	
E-F	-2748 / 0	-102.1 -102.1	0.52 (1)	M-F	0 / 647	0.15 (1)	
F-G	-2533 / 0	-102.1 -102.1	0.25 (1)	K-G	0 / 375	0.08 (2)	
G-H	0 / 19	-102.1 -102.1	0.23 (1)	K-F	-3 / 138	0.03 (3)	
H-I	0 / 31	-102.1 -102.1	0.13 (1)	O-C	-2788 / 0	0.77 (1)	
O-B	-299 / 0	0.0 0.0	0.03 (1)	G-J	-2788 / 0	0.77 (1)	
J-H	-299 / 0	0.0 0.0	0.03 (1)				
O-N	0 / 2250	-38.5 -38.5	0.70 (2)				
N-M	0 / 2254	-38.5 -38.5	0.71 (2)				
M-L	0 / 2254	-38.5 -38.5	0.71 (2)				
L-K	0 / 2254	-38.5 -38.5	0.71 (2)				
K-J	0 / 2250	-38.5 -38.5	0.70 (2)				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 29.1 PSF
 DL = 8.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, ORC 2012
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 0.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.90")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.18")
 ALLOWABLE DEFL. (TL) = L/360 (0.90")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.30")

CS1: TC=0.52/1.00 (D-E-1), BC=0.71/1.00 (K-M-2),
 WB=0.77/1.00 (G-J-1), SB=0.28/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP (DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 768 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (C) (INPUT = 0.83)
 JSI METAL = 0.73 (L) (INPUT = 1.00)

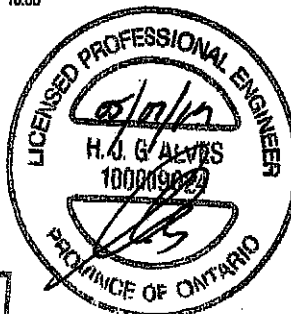

RECEIVED
 JUN 13 2019

TOWN OF CALEDON
 BUILDING SECTION
 FILE NO.


ENG NO. TAM 17410780
 STRUCTURAL
 CONSULTANT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
402939	T23	1	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version B.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:48:15 2019 Page 1

ID: yH3luQzwKBaXQAh7hsfBURzKCTp-mudYMx6l6HMF80n8fuDfHkYKoPkoW1YEO0VzldqU

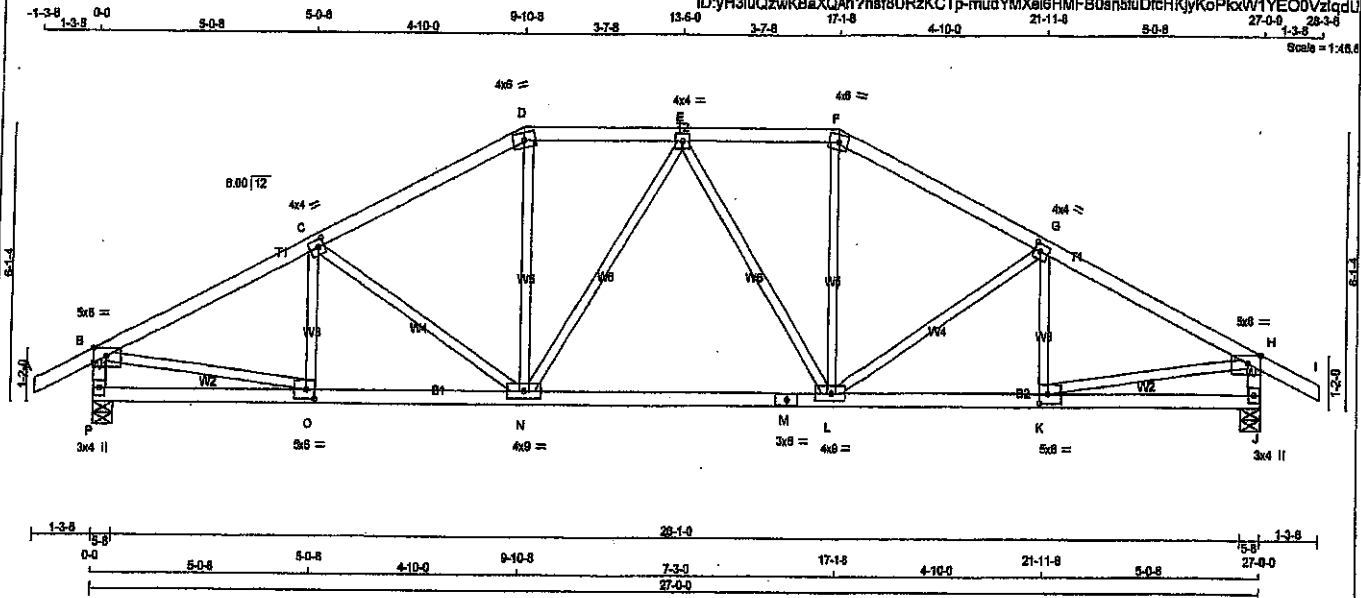

TOTAL WEIGHT = 111 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
P - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - M	2x4	DRY	No.2	SPF
M - J	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-H	MT20	4.0	4.0	2.00	1.75
D	TTVW-m	MT20	4.0	8.0		
E	TMVW-H	MT20	4.0	4.0		
F	TTVW-m	MT20	4.0	8.0		
G	TMVW-H	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMVW-p	MT20	3.0	4.0		
K	BMVW-H	MT20	5.0	8.0	2.50	2.25
L	BMVW-H	MT20	4.0	8.0		
M	BS-4	MT20	3.0	8.0		
N	BMVW-H	MT20	4.0	8.0		
O	BMVW-H	MT20	5.0	8.0	2.50	2.25
P	BMVW-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	JT	VERT	IN-SX		IN-SX	
P	2037	0	2037	0	5-8	5-8	
J	2037	0	2037	0	5-8	5-8	

UNFACTORED REACTIONS

1ST CASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1514	883 / 0	284 / 0	0 / 0	0 / 0	387 / 0	0 / 0
J	1514	883 / 0	284 / 0	0 / 0	0 / 0	387 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.88 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (L/C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (L/C)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 31	-102.1 -102.1	0.13 (1)	10.00	O-C	-221 / 84	0.05 (1)
B-C	-2683 / 0	-102.1 -102.1	0.41 (1)	3.88	C-N	-410 / 0	0.28 (1)
C-D	-2337 / 0	-102.1 -102.1	0.38 (1)	4.14	N-D	9 / 898	0.16 (1)
D-E	-2078 / 0	-102.1 -102.1	0.20 (1)	4.53	E-L	-258 / 0	0.22 (1)
E-F	-2078 / 0	-102.1 -102.1	0.20 (1)	4.53	L-F	0 / 898	0.16 (1)
F-G	-2337 / 0	-102.1 -102.1	0.38 (1)	4.14	L-G	-410 / 0	0.28 (1)
G-H	-2683 / 0	-102.1 -102.1	0.41 (1)	3.88	K-G	-221 / 84	0.05 (1)
H-I	0 / 31	-102.1 -102.1	0.13 (1)	10.00	B-O	0 / 2438	0.55 (1)
I-J	-1951 / 0	0.0 0.0	0.20 (1)	8.03	K-H	0 / 2438	0.55 (1)
J-H	-1951 / 0	0.0 0.0	0.20 (1)	8.03			
P-O	0 / 0	-38.5 -38.5	0.18 (3)	10.00			
O-N	0 / 2404	-38.5 -38.5	0.56 (1)	10.00			
N-M	0 / 2211	-38.5 -38.5	0.53 (2)	10.00			
M-L	0 / 2211	-38.5 -38.5	0.53 (2)	10.00			
L-K	0 / 2404	-38.5 -38.5	0.56 (1)	10.00			
K-J	0 / 0	-38.5 -38.5	0.16 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.90")
CALCULATED VERT. DEFL.(LL) = 1/899 (0.13")
ALLOWABLE DEFL.(TL) = L/360 (0.90")
CALCULATED VERT. DEFL.(TL) = 1/989 (0.23")

CSI: TC=0.41/1.00 (G-H-T), BC=0.58/1.00 (K-L-T), WB=0.55/1.00 (H-K-T), SS=0.22/1.00 (G-H-T)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1867 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.85 (K) (INPUT = 0.90)
JSI METAL= 0.65 (M) (INPUT = 1.00)

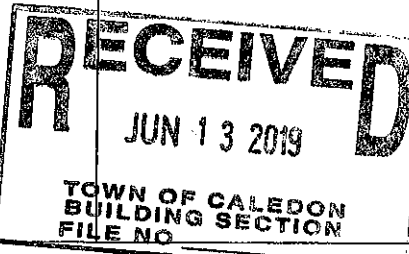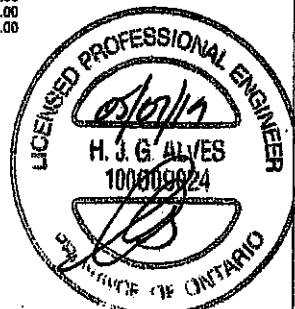

DR: JNO.TAM 17910781
STRUCTURAL
CHECK ONLY

JOB NAME 402939	TRUSS NAME T24	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 5 Nov 17 2018 Mitak Industries, Inc. Tue May 7 17:48:16 2019 Page 1
 ID:YH3luQzwKBaXQAh7h8URzKCTp-E4BwZfKibU8p9RzNPSCpqSQLf9JfGC_xZxlgdT
 27-0-0 26-3-8 1-3-8
 Scale = 1:16.8

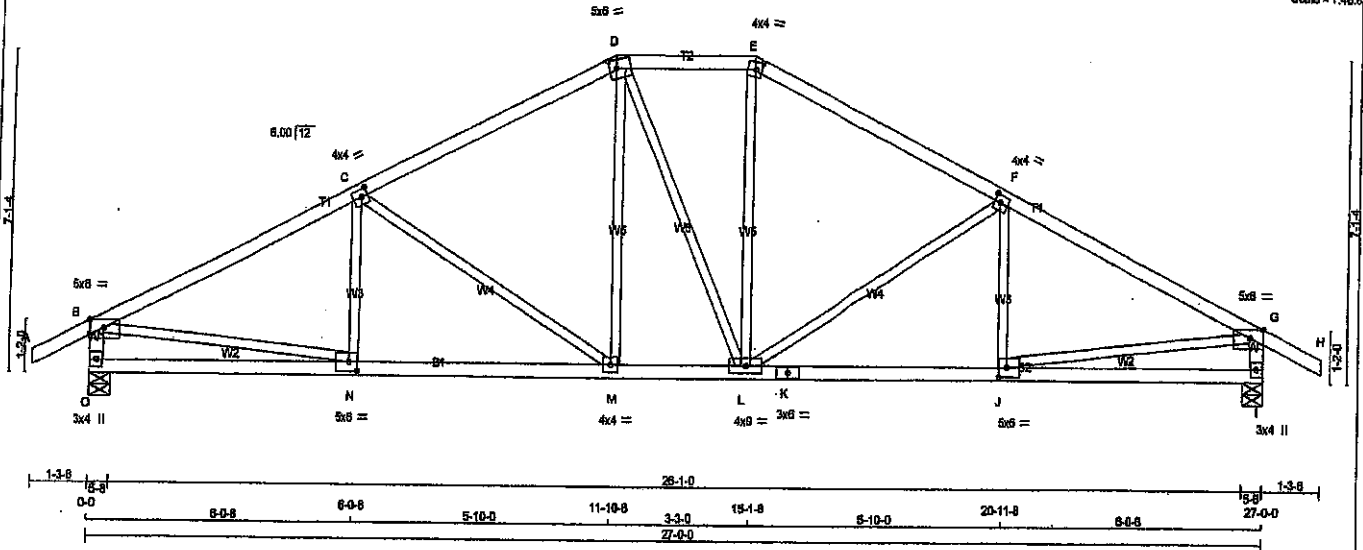

TOTAL WEIGHT = 113 lb
 (M/F)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
E - H	2x4	DRY No.2	SPF
I - J	2x4	DRY No.2	SPF
K - L	2x4	DRY No.2	SPF
M - N	2x4	DRY No.2	SPF
O - P	2x4	DRY No.2	SPF
Q - R	2x4	DRY No.2	SPF
S - T	2x4	DRY No.2	SPF
U - V	2x4	DRY No.2	SPF
W - X	2x4	DRY No.2	SPF
Y - Z	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQ'D BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
O	2037	0	2037	0	5-8	5-8	5-8	5-8
I	2037	0	2037	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
O	1514	883 / 0	284 / 0	0 / 0	0 / 0	387 / 0	0 / 0
I	1514	883 / 0	284 / 0	0 / 0	0 / 0	387 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, I

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.83 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO				
A-B	0 / 31	-102.1	10.00	-84 / 185
B-C	-2894 / 0	-102.1	3.83	-592 / 0
C-D	-2111 / 0	-102.1	4.11	0 / 537
D-E	-1868 / 0	-102.1	4.78	0 / 4
E-F	-2113 / 0	-102.1	4.11	0 / 541
F-G	-2883 / 0	-102.1	3.83	-589 / 0
G-H	0 / 31	-102.1	10.00	-55 / 185
H-I	-1942 / 0	0.0	6.04	0 / 2482
I-J	-1942 / 0	0.0	6.04	0 / 2481
J-K	0 / 0	-38.5	10.00	
K-L	0 / 2438	-38.5	10.00	
L-M	0 / 1868	-38.5	10.00	
M-N	0 / 2437	-38.5	10.00	
N-O	0 / 2437	-38.5	10.00	
O-P	0 / 0	-38.5	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 20.1 PSF
 DL = 8.0 PSF
 BOT CH. LL = 10.5 PSF
 DL = 7.0 PSF
 TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. G/C

LOADING IN PLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2010, OBC 2012
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.90")
 CALCULATED VERT. DEFL.(LL) = 1 / 888 (0.12")
 ALLOWABLE DEFL.(TL) = L/360 (0.90")
 CALCULATED VERT. DEFL.(TL) = 1 / 899 (0.20")

CSI: TC=0.81/1.00 (B-C:1), BC=0.58/1.00 (M-N:2), WB=0.67/1.00 (C-M:1), SSI=0.26/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.89 (E) (INPUT = 0.90)
 JSI METAL= 0.71 (K) (INPUT = 1.00)

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	TMVW-m	MT20	5.0	8.0	2.25	2.00
E	TMVW-m	MT20	4.0	4.0	2.00	1.75
F	TMVW-t	MT20	4.0	4.0	2.00	1.75
G	TMVW-p	MT20	5.0	8.0	Edge	3.50
I	BMV1+p	MT20	3.0	4.0		
J	BMVW-t	MT20	5.0	8.0	2.50	2.25
K	BS-t	MT20	3.0	4.0		
L	BMVW-t	MT20	4.0	4.0		
M	BMVW-t	MT20	4.0	4.0		
N	BMVW-t	MT20	5.0	8.0	2.50	2.25
O	BMV1+p	MT20	3.0	4.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

RECEIVED
 JUN 13 2019
 TOWN OF CALEDON
 BUILDING SECTION
 FILE NO

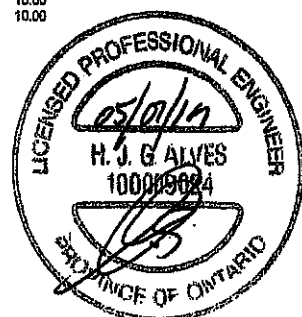

05/01/19
 R410782
 CTURAL
 ONLY

JOB NAME 402939	TRUSS NAME T25	QUANTITY 8	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

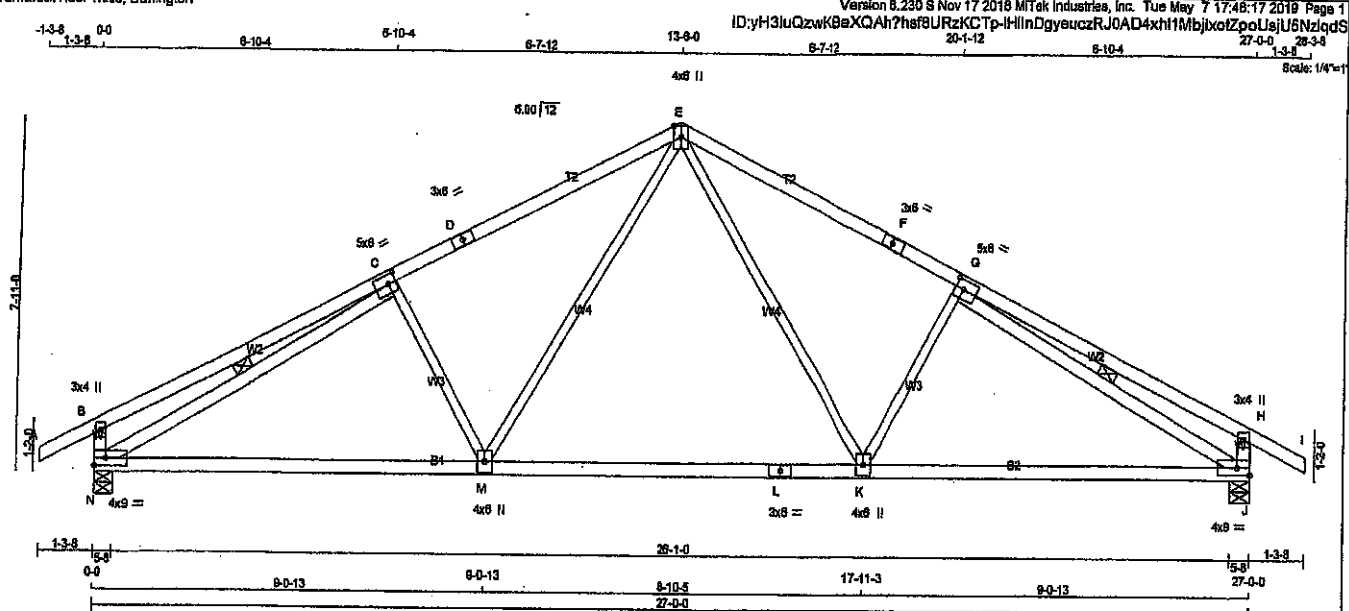

TOTAL WEIGHT = 8 X 109 = 872 lb

LUMBER	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES				
CHORDS				
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
N - C	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
C TMVW+1	MT20	5.0	8.0	2.50	2.26
D TS+1	MT20	3.0	6.0		
E TMVW+p	MT20	4.0	8.0	Edge	
F TS+1	MT20	3.0	4.0		
G TMVW+1	MT20	5.0	8.0	2.50	2.26
H TMV+p	MT20	3.0	4.0		
J BMVW+1	MT20	4.0	8.0	Edge	
K BMVW+1	MT20	4.0	6.0		
L BS+1	MT20	3.0	6.0		
M BMVW+1	MT20	4.0	8.0		
N BMVW+1	MT20	4.0	9.0	Edge	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
N	2037	0	2037	0	5-8	5-8	
J	2037	0	2037	0	5-8	5-8	

UNFACTORED REACTIONS

1ST CASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
N	1514	883 / 0 284 / 0 0 / 0 0 / 0 387 / 0 0 / 0
J	1514	883 / 0 284 / 0 0 / 0 0 / 0 387 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.54 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-N, G-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX (LC)	MEMB.	MAX. FORCE (LBS)	MAX. (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 31	-102.1 -102.1	0.13 (1)	B-K	0 / 837	0.21 (1)	
B-C	0 / 37	-102.1 -102.1	0.78 (1)	K-G	-493 / 7	0.19 (1)	
C-D	-2435 / 0	-102.1 -102.1	0.78 (1)	M-E	0 / 837	0.21 (1)	
D-E	-2435 / 0	-102.1 -102.1	0.78 (1)	C-M	-493 / 7	0.19 (1)	
E-F	-2435 / 0	-102.1 -102.1	0.78 (1)	N-C	-2813 / 0	0.84 (1)	
F-G	-2435 / 0	-102.1 -102.1	0.78 (1)	G-J	-2813 / 0	0.84 (1)	
G-H	0 / 37	-102.1 -102.1	0.13 (1)				
H-I	0 / 31	-102.1 -102.1	0.13 (1)				
N-B	-400 / 0	0.0	0.0	0.04 (1)	7.81		
J-H	-400 / 0	0.0	0.0	0.04 (1)	7.81		
N-M	0 / 2383	-38.5 -38.5	0.85 (2)	10.00			
M-L	0 / 1674	-38.5 -38.5	0.75 (2)	10.00			
L-K	0 / 1674	-38.5 -38.5	0.75 (2)	10.00			
K-J	0 / 2383	-38.5 -38.5	0.85 (2)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010; NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.80")
CALCULATED VERT. DEFL.(LL) = 1/889 (0.27")
ALLOWABLE DEFL.(TL) = L/860 (0.90")
CALCULATED VERT. DEFL.(TL) = 1/705 (0.46")

CSI: TO=0.78/1.00 (G-H:1), BC=0.85/1.00 (J-K:2), WB=0.84/1.00 (G-J:1), SS=0.30/1.00 (E-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVEHEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



MAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1987 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


IS GRIP= 0.88 (G) (INPUT = 0.80)
SI METAL= 0.89 (G) (INPUT = 1.00)

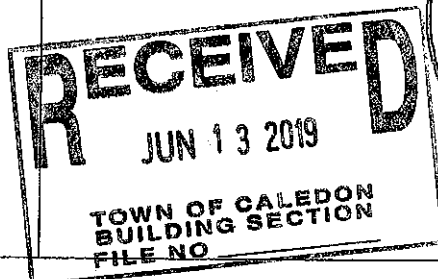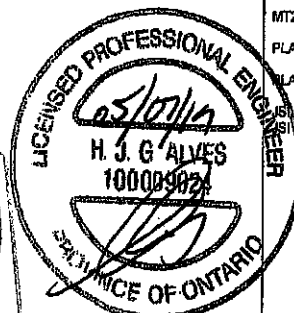

05/07/19
H. J. G. ALVES
100009024
PROVINCE OF ONTARIO
7/10/19
10/10/19
10/10/19

JOB NAME 402970	TRUSS NAME T26	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 5 Nov 17 2018 MTEK Industries, Inc. Tue May 7 17:00:46 2018 Page 1
ID:8VhTGnkzd3QgXgD8mV0hyJKd0-SNfe2OCVLro3leHpNyqpJRPaPiv8aUQcbmqn7S2rJy

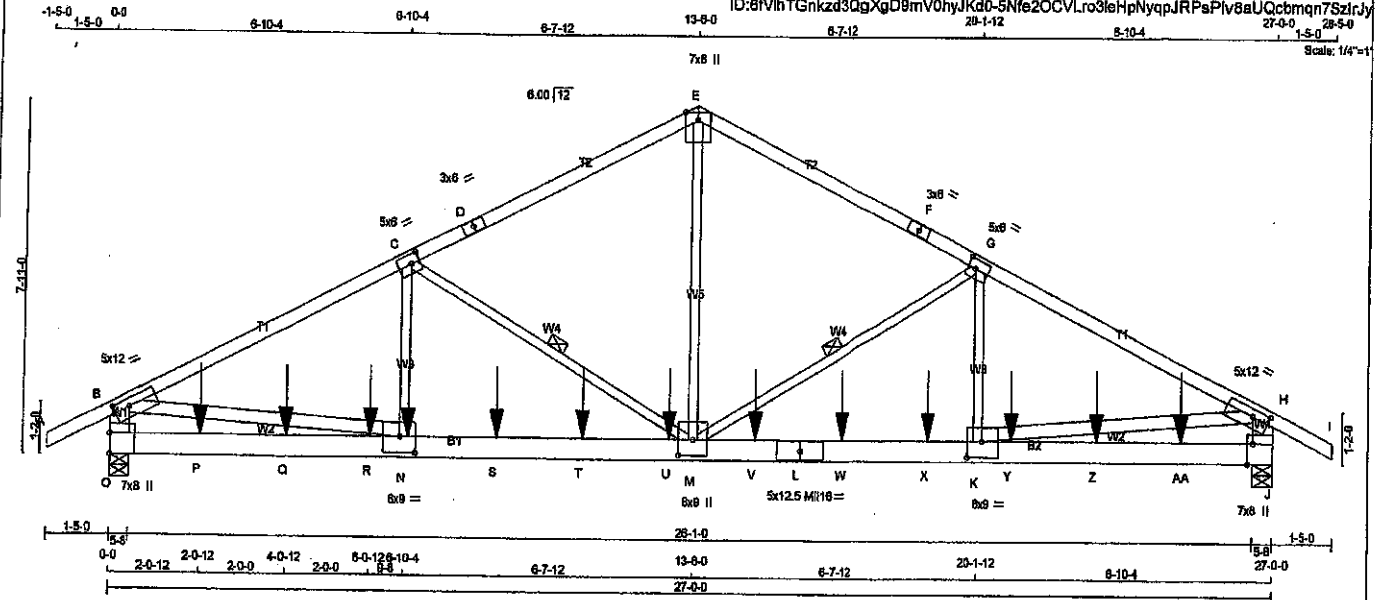

TOTAL WEIGHT = 3 X 128 = 383 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
A - D	2x4	1650F 1.5E	SPF
D - E	2x4	1650F 1.5E	SPF
E - F	2x4	1650F 1.5E	SPF
F - I	2x4	1650F 1.5E	SPF
O - B	2x8	No.2	SPF
J - H	2x8	No.2	SPF
O - L	2x8	1650F 1.5E	SPF
L - J	2x8	1650F 1.5E	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
B - N	2x4	DRY No.2	SPF
K - H	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A - D 1	12	TOP
D - E 1	12	TOP
E - F 1	12	TOP
F - I 1	12	TOP
O - B 2	12	TOP
J - H 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
O - L 2	9	SIDE (608.4)
L - J 2	9	SIDE (414.9)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x4 1	6	

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-I	MT20	5.0	12.0	2.00	4.50
C TMVW-I	MT20	5.0	8.0	2.50	2.25
D TS-I	MT20	3.0	8.0		
E ITW+p	MT20	7.0	8.0	Edge	
F TS-I	MT20	3.0	8.0		
G TMVW-I	MT20	5.0	8.0	2.50	2.25
H TMVW-I	MT20	5.0	12.0	2.00	4.50
J BMV-I	MT20	7.0	8.0	4.25	1.50
K BMVW-I	MT20	8.0	9.0	4.25	4.25
L SS-I	MT16	5.0	12.5		
M BMVW-I	MT20	8.0	9.0	4.25	4.00
N BMVW-I	MT20	8.0	9.0	4.25	4.25
O BMV-I	MT20	7.0	8.0	5.50	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
O	12825	0	12825	0	5-8
J	12152	0	12152	0	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
O	9393	5344 / 0	1761 / 0	0 / 0	0 / 0	2278 / 0	0 / 0	0 / 0
J	9032	5144 / 0	1695 / 0	0 / 0	0 / 0	2183 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.02 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-M, C-M.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH FR-TO	CS1 (LC)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH FR-TO	CS1 (LC)
FR-TO						FR-TO			
A-B	0 / 34	-102.1	-102.1	0.04 (1)	10.00	M-E	0 / 11488	0.86 (1)	
B-C	-19251 / 0	-102.1	-102.1	0.89 (1)	3.02	M-G	-5315 / 0	0.73 (1)	
C-D	-13489 / 0	-102.1	-102.1	0.49 (1)	3.66	K-G	0 / 4274	0.32 (1)	
D-E	-13489 / 0	-102.1	-102.1	0.49 (1)	3.66	C-M	-8154 / 0	0.85 (1)	
E-F	-13490 / 0	-102.1	-102.1	0.49 (1)	3.65	N-C	0 / 5076	0.38 (1)	
F-G	-13490 / 0	-102.1	-102.1	0.49 (1)	3.65	B-N	0 / 17352	0.93 (1)	
G-H	-18458 / 0	-102.1	-102.1	0.83 (1)	3.09	K-H	0 / 16838	0.89 (1)	
H-I	0 / 34	-102.1	-102.1	0.04 (1)	10.00				
O-B	-11011 / 0	0.0	0.0	0.24 (1)	5.58				
J-H	-10575 / 0	0.0	0.0	0.23 (1)	5.88				
O-P	0 / 0	-38.5	-38.5	0.50 (1)	10.00				
P-Q	0 / 0	-38.5	-38.5	0.50 (1)	10.00				
Q-R	0 / 0	-38.5	-38.5	0.50 (1)	10.00				
R-N	0 / 0	-38.5	-38.5	0.50 (1)	10.00				
N-S	0 / 17242	-38.5	-38.5	0.91 (1)	10.00				
S-T	0 / 17242	-38.5	-38.5	0.91 (1)	10.00				
T-U	0 / 17242	-38.5	-38.5	0.91 (1)	10.00				
U-M	0 / 17242	-38.5	-38.5	0.91 (1)	10.00				
M-V	0 / 16533	-38.5	-38.5	0.94 (1)	10.00				
V-L	0 / 16533	-38.5	-38.5	0.94 (1)	10.00				
L-W	0 / 16533	-38.5	-38.5	0.94 (1)	10.00				
W-X	0 / 16533	-38.5	-38.5	0.94 (1)	10.00				
X-K	0 / 16533	-38.5	-38.5	0.94 (1)	10.00				
K-Y	0 / 0	-38.5	-38.5	0.53 (1)	10.00				
Y-Z	0 / 0	-38.5	-38.5	0.53 (1)	10.00				
Z-AA	0 / 0	-38.5	-38.5	0.53 (1)	10.00				
AA-J	0 / 0	-38.5	-38.5	0.53 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
N	6-11-4	-1591	-1591		FRONT	VERT	TOTAL		
P	2-0-12	-1591	-1591		FRONT	VERT	TOTAL		
Q	4-0-12	-1591	-1591		FRONT	VERT	TOTAL		
R	6-0-12	-1591	-1591		FRONT	VERT	TOTAL		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2016, OBC 2012
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.90")
CALCULATED VERT. DEFL. (LL) = L/999 (0.28")
ALLOWABLE DEFL. (TL) = L/360 (0.90")
CALCULATED VERT. DEFL. (TL) = L/788 (0.42")

CSI: TC=0.89/1.00 (B-C:1), BC=0.94/1.00 (K-M:1), WB=0.93/1.00 (B-N:1), SS=0.70/1.00 (J-K:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)
MAX MIN MAX MIN		
MT20 618 354 1887 788		
MT16 438 278 2341 1245		
		1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (B) (INPUT = 0.90)
JSI METAL = 0.86 (K) (INPUT = 1.00)

DWG NO. TAM 1910736
STRUCTURAL
COMPONENT ONLY

CONTINUED ON PAGE 2

JOB NAME 402970	TRUSS NAME T26	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------



Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MITek Industries, Inc. Tue May 7 17:00:48 2019 Page 2
 ID:8VihTGnkzd3QgXgD9mV0hyJKd0-5Nfe2OCVLro3leHpNyapJRPpPiv8aUQcbmqn7SzlrJy

Edge - INDICATES REFERENCE CORNER OF PLATE
 TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
S	8-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-
T	10-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-
U	12-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-
V	14-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-
W	16-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-
X	18-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-
Y	20-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-
Z	22-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-
AA	24-11-4	-1591	-1591	-	FRONT	VERT	TOTAL	-	-

THIS STRUCTURE MUST BE
 CONSTRUCTED TO MEET OR
 EXCEED THE PROVISIONS OF
 THE ONTARIO BUILDING CODE

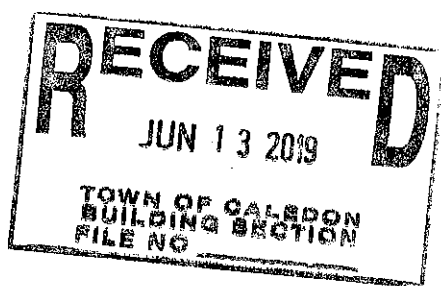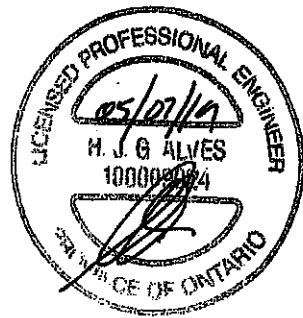


DWG NO. TAM 1910736
 STRUCTURAL
 COMPONENT ONLY 3/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402970	T27	13	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:00:50 2019 Page 1

ID:6FVhTGnkzd3QgXgD9mV0hyJKd0-ZZD0FJD869wwNos7xfM2sfy6D6L5J1QlqQaKfuzlrJx

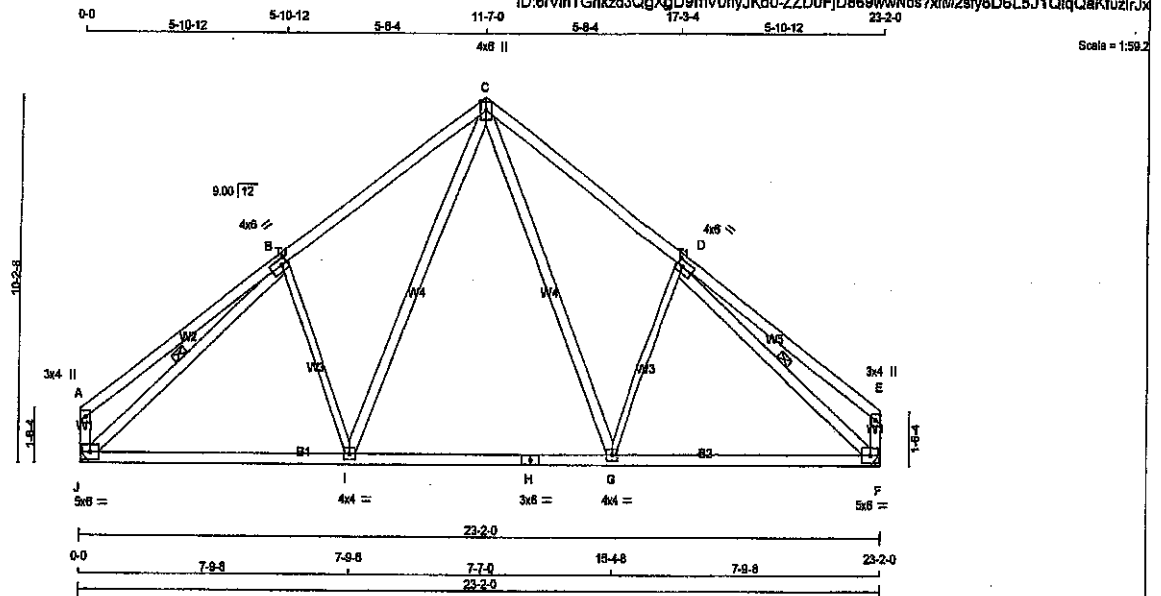

TOTAL WEIGHT = 13 X 112 = 1461 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
J - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
J - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS EXCEPT	2x4	DRY	No.2
G - D	2x3	DRY	No.2
B - I	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0	
B	TMVW+1	MT20	4.0	8.0	2.00 2.00
C	TTVW+p	MT20	4.0	8.0	Edge
D	TMVW+1	MT20	4.0	8.0	2.00 2.00
E	TMV+p	MT20	3.0	4.0	
F	BMVW+1	MT20	5.0	8.0	
G	BMVW+1	MT20	4.0	4.0	
H	BS-t	MT20	3.0	6.0	
I	BMVW+1	MT20	4.0	4.0	
J	BMVW+1	MT20	5.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
J	1829	0	1829	0	0
F	1829	0	1829	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J, F. MINIMUM BEARING LENGTH AT JOINT J = 3-8, JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	1217	673 / 0	243 / 0	0 / 0	0 / 0	301 / 0	0 / 0
F	1217	673 / 0	243 / 0	0 / 0	0 / 0	301 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.71 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF B-J, D-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	UNBRACED LENGTH (FT)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 42	-102.1	-102.1	0.57 (1)	C-G	0 / 728	0.12 (1)
B-C	-1560 / 0	-102.1	-102.1	0.49 (1)	G-D	-378 / 12	0.23 (1)
C-D	-1555 / 0	-102.1	-102.1	0.50 (1)	D-E	0 / 728	0.12 (1)
D-E	0 / 43	-102.1	-102.1	0.57 (1)	E-F	-388 / 10	0.24 (1)
E-F	-228 / 0	0.0	0.0	0.02 (1)	F-G	-1853 / 0	0.58 (1)
F-G	-221 / 0	0.0	0.0	0.02 (1)	G-H	-1859 / 0	0.58 (1)
H-I	0 / 1341	-38.5	-38.5	0.57 (2)	I-J		
I-J	0 / 949	-38.5	-38.5	0.52 (2)			
J-K	0 / 949	-38.5	-38.5	0.52 (2)			
K-L	0 / 1343	-38.5	-38.5	0.57 (2)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.77")
CALCULATED VERT. DEFL.(LL) = L/999 (0.15")
ALLOWABLE DEFL.(TL) = L/360 (0.77")
CALCULATED VERT. DEFL.(TL) = L/977 (0.24")

CSI: TC=0.57/1.00 (D-E:1), BC=0.57/1.00 (F-G:2),
WB=0.58/1.00 (D-F:1), SS=0.23/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1897 788 1897 1858

PLATE PLACEMENT TOL = 0.250 Inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.90 (D) (INPUT = 0.90)
JSI METAL= 0.49 (B) (INPUT = 1.00)

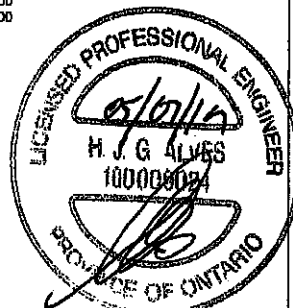


DWG NO. TAM 1910737
STRUCTURAL
QUAD-DRAWING ONLY

JOB NAME 402970	TRUSS NAME G27	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.230 8 Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:00:42 2019 Page 1
ID:6FVhTGnkzd3QgXgD9mV0hyJKd0-o0k_a_767lw2PZFST_CAXzcryukkSWOa_BevOMzlrK3
22-10-8 23-2-0 24-5-8
2-8 13-8

Scale = 1:50.0

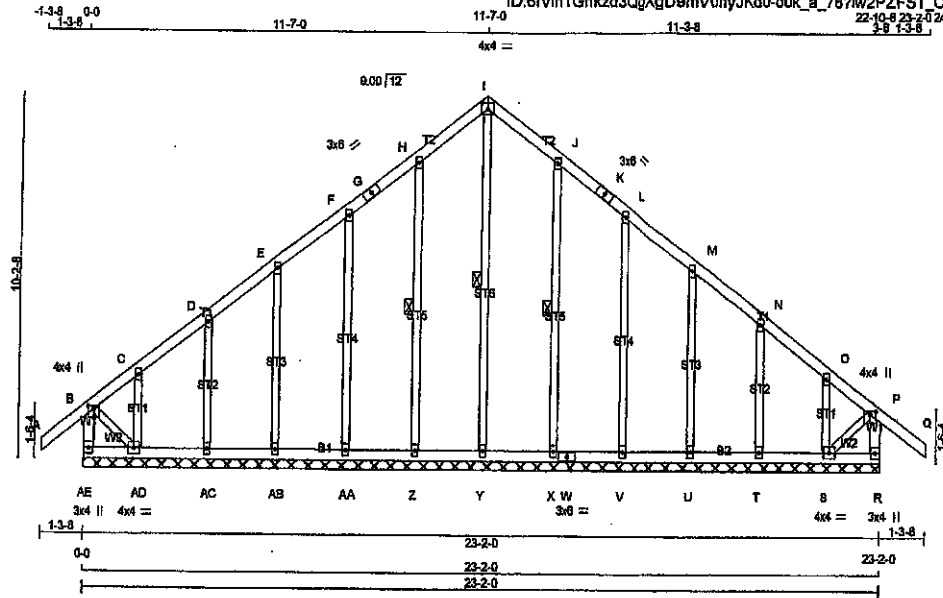

TOTAL WEIGHT = 2 X 118 = 237 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
AE - B	2x4	DRY	No.2	SPF
A - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - K	2x4	DRY	No.2	SPF
K - Q	2x4	DRY	No.2	SPF
R - P	2x4	DRY	No.2	SPF
AE - W	2x4	DRY	No.2	SPF
W - R	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2'-0-0 OC.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C, D, E, F, H, J, L, M, N, O					
C TMVW+p	MT20	2.0	4.0		
G TS-t	MT20	3.0	6.0		
I TTW+p	MT20	4.0	4.0	2.25	2.00
K TS-t	MT20	3.0	6.0		
P TMVW+p	MT20	4.0	4.0	1.00	2.00
R BMV1+p	MT20	3.0	4.0		
S BMVW1-t	MT20	4.0	4.0		
T, U, V, X, Y, Z, AA, AB, AC					
T BMV1+p	MT20	2.0	4.0		
W BS-t	MT20	3.0	6.0		
AD BMVW1-t	MT20	4.0	4.0		
AE BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF I-Y, H-Z, J-X.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
AE-B	-324 / 0	0.0 0.0	0.03 (1)	Y-I	-149 / 0	0.10 (1)	
A-B	0 / 42	-102.1 -102.1	0.14 (1)	10.00	Z-H	-232 / 0	0.11 (1)
B-C	-75 / 0	-102.1 -102.1	0.13 (1)	8.25	AA-F	-198 / 0	0.18 (1)
C-D	-28 / 0	-102.1 -102.1	0.05 (1)	8.25	AB-E	-198 / 0	0.10 (1)
D-E	-32 / 0	-102.1 -102.1	0.05 (1)	8.25	AC-D	-217 / 0	0.08 (1)
E-F	-26 / 0	-102.1 -102.1	0.05 (1)	8.25	AD-C	-105 / 0	0.02 (1)
F-G	-20 / 0	-102.1 -102.1	0.06 (1)	8.25	X-J	-232 / 0	0.11 (1)
G-H	-20 / 0	-102.1 -102.1	0.06 (1)	8.25	V-L	-198 / 0	0.18 (1)
H-I	-32 / 0	-102.1 -102.1	0.06 (1)	8.25	U-M	-199 / 0	0.10 (1)
I-J	-32 / 0	-102.1 -102.1	0.06 (1)	8.25	T-N	-217 / 0	0.08 (1)
J-K	-20 / 0	-102.1 -102.1	0.06 (1)	8.25	S-O	-105 / 0	0.02 (1)
K-L	-20 / 0	-102.1 -102.1	0.06 (1)	8.25	B-AD	0 / 41	0.01 (1)
L-M	-28 / 0	-102.1 -102.1	0.05 (1)	8.25	S-P	0 / 41	0.01 (1)
M-N	-32 / 0	-102.1 -102.1	0.05 (1)	8.25			
N-O	-28 / 0	-102.1 -102.1	0.05 (1)	8.25			
O-P	-75 / 0	-102.1 -102.1	0.13 (1)	8.25			
P-Q	0 / 42	-102.1 -102.1	0.14 (1)	10.00			
R-P	-324 / 0	0.0 0.0	0.03 (1)	7.81			
AE-AD	0 / 0	-38.5 -38.5	0.02 (3)	10.00			
AD-AC	0 / 29	-38.5 -38.5	0.03 (2)	10.00			
AC-AB	0 / 24	-38.5 -38.5	0.03 (2)	10.00			
AB-AA	0 / 21	-38.5 -38.5	0.02 (2)	10.00			
AA-Z	0 / 18	-38.5 -38.5	0.02 (2)	10.00			
Z-Y	0 / 18	-38.5 -38.5	0.02 (3)	10.00			
Y-X	0 / 16	-38.5 -38.5	0.02 (3)	10.00			
X-W	0 / 18	-38.5 -38.5	0.02 (2)	10.00			
W-V	0 / 18	-38.5 -38.5	0.02 (2)	10.00			
V-U	0 / 21	-38.5 -38.5	0.02 (2)	10.00			
U-T	0 / 24	-38.5 -38.5	0.03 (2)	10.00			
T-S	0 / 29	-38.5 -38.5	0.03 (2)	10.00			
S-R	0 / 0	-38.5 -38.5	0.02 (3)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. G.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (A-B:1), BC=0.03/1.00 (S-T:2),

WB=0.18/1.00 (L-V:1), SS=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10

COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.50 (I) (INPUT = 0.80)
JSI METAL= 0.12 (J) (INPUT = 1.00)

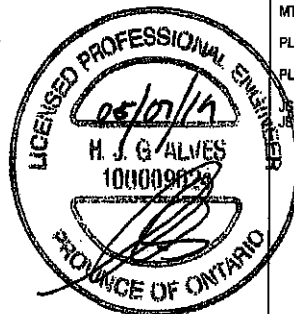


DRWG NO. TAM1910728
STRUCTURAL
COMPONENT ONLY

JOB NAME 402970	TRUSS NAME T28	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:00:51 2019 Page 1

ID:6VhTgNkzd3QgXgD9mVohyJKd0-2lnOS3EmT2n7yRBUNIH0eUJOWcw2Oxu24JtBkZlrJw

Scale = 1:50.0

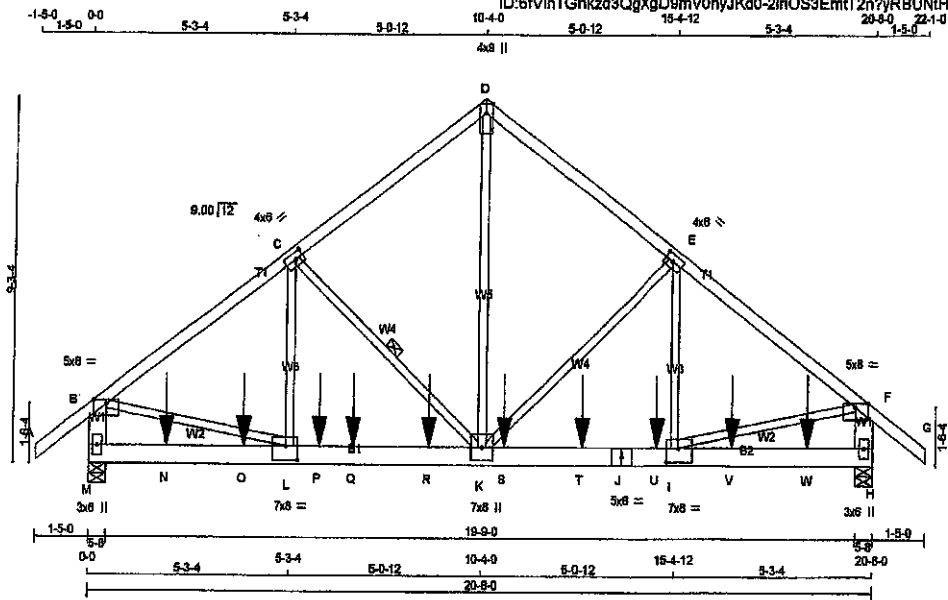

TOTAL WEIGHT = 3 X 108 = 325 lb

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
M - B	2x6	DRY No.2	SPF
H - F	2x6	DRY No.2	SPF
M - J	2x6	DRY No.2	SPF
J - H	2x6	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 3 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS	#ROWS	SURFACE SPACING (IN)	LOAD (PLF)
A-D	1	12	TOP
D-G	1	12	TOP
M-B	2	12	TOP
H-F	2	12	TOP
BOTTOM CHORDS: (0.122'x3') SPIRAL NAILS			
M-J	2	6	SIDE(829.8)
J-H	2	6	SIDE(414.9)
WEBS: (0.122'x3') SPIRAL NAILS			
2x3	1	6	

STAGGER NAILS BY HALF THE SURFACE SPACING IN ADJACENT PLIES.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	1.25	4.00
C TMVW-w	MT20	4.0	6.0	2.00	2.50
D TTW-p	MT20	4.0	9.0	Edge	
E TMVW-w	MT20	4.0	6.0	2.00	2.50
F TMVW-p	MT20	5.0	8.0	1.25	4.00
H BMV1-p	MT20	3.0	6.0		
I BMVW-w	MT20	7.0	8.0	4.25	3.75
J BS-t	MT20	5.0	6.0		
K BMVW-w	MT20	7.0	8.0		
L BMVW-w	MT20	7.0	8.0	4.25	3.75
M BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT				
M	9804	0	0	5-8
H	9515	0	0	5-8

UNFACTORED REACTIONS

	1ST LCASE	MAX MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	7135	4071 / 0	1394 / 0	0 / 0	0 / 0	1731 / 0	0 / 0
H	7070	4033 / 0	1322 / 0	0 / 0	0 / 0	1715 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.53 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO									
A-B	0 / 48	-102.1	-102.1	0.05 (1)	10.00	K-D	0 / 8801	0.89 (1)	
B-C	-10685 / 0	-102.1	-102.1	0.41 (1)	3.53	K-E	-2889 / 0	0.93 (1)	
C-D	-7715 / 0	-102.1	-102.1	0.28 (1)	4.16	L-E	0 / 2854	0.22 (1)	
D-E	-7715 / 0	-102.1	-102.1	0.28 (1)	4.16	C-K	-3422 / 0	0.39 (1)	
E-F	-10213 / 0	-102.1	-102.1	0.39 (1)	3.62	L-C	0 / 3616	0.27 (1)	
F-G	0 / 46	-102.1	-102.1	0.05 (1)	10.00	B-L	0 / 8757	0.66 (1)	
M-B	-8809 / 0	0.0	0.0	0.19 (1)	6.20	I-F	0 / 8372	0.83 (1)	
H-F	-8246 / 0	0.0	0.0	0.16 (1)	6.30				
M-N	0 / 0	-38.5	-38.5	0.52 (1)	10.00				
N-O	0 / 0	-38.5	-38.5	0.52 (1)	10.00				
O-L	0 / 0	-38.5	-38.5	0.52 (1)	10.00				
L-P	0 / 8569	-38.5	-38.5	0.85 (1)	10.00				
P-Q	0 / 8569	-38.5	-38.5	0.85 (1)	10.00				
Q-R	0 / 8569	-38.5	-38.5	0.85 (1)	10.00				
R-K	0 / 8569	-38.5	-38.5	0.85 (1)	10.00				
K-S	0 / 8192	-38.5	-38.5	0.75 (1)	10.00				
S-T	0 / 8192	-38.5	-38.5	0.75 (1)	10.00				
T-J	0 / 8192	-38.5	-38.5	0.75 (1)	10.00				
J-U	0 / 8192	-38.5	-38.5	0.75 (1)	10.00				
U-I	0 / 8192	-38.5	-38.5	0.75 (1)	10.00				
I-V	0 / 0	-38.5	-38.5	0.48 (1)	10.00				
V-W	0 / 0	-38.5	-38.5	0.48 (1)	10.00				
W-H	0 / 0	-38.5	-38.5	0.48 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEIG.	CONN.
N	2-0-12	-1591	-1591		BACK	VERT	TOTAL		
O	4-0-12	-1591	-1591		BACK	VERT	TOTAL		
P	8-0-12	-1591	-1591		BACK	VERT	TOTAL		
Q	8-11-4	-1591	-1591		BACK	VERT	TOTAL		
R	8-11-4	-1591	-1591		BACK	VERT	TOTAL		
S	10-11-4	-1591	-1591		BACK	VERT	TOTAL		
T	12-11-4	-1591	-1591		BACK	VERT	TOTAL		
U	14-11-4	-1591	-1591		BACK	VERT	TOTAL		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 29.1 PSF
DL	= 6.0 PSF
BOT CH. LL	= 10.5 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.68")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.11")
ALLOWABLE DEFL. (TL) = $L/360$ (0.68")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.19")

CSI: TC=0.41/1.00 (B-C-1), BC=0.85/1.00 (K-L-1), WB=0.93/1.00 (E-K-1), SSI=0.61/1.00 (K-L-1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1667
	788	1997	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

SI GRIP= 0.90 (J) (INPUT = 0.90)

SI METAL= 0.79 (J) (INPUT = 1.00)



DWG NO. TAM 7910738
STRUCTURAL
COMPONENT ONLY 1/2



CONTINUED ON PAGE 2

RECEIVED
JUN 13 2019


TOWN OF CALEDON
BUILDING SECTION
FILE NO

JOB NAME 402970	TRUSS NAME T28	QUANTITY 1	PLY 3	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 S Nov 17 2018 MITek Industries, Inc. Tue May 7 17:00:51 2019 Page 2 ID:8fVhTGnkzd3QpXgD9mV0hyJKd0-2lnOSSEmT2n?yRBUNtH0aUJOwaw2Oxu24JfBKzlrJw	


FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
V	18-11-4	-1591	-1591	—	BACK	VERT	TOTAL	—	—
W	18-11-4	-1591	-1591	—	BACK	VERT	TOTAL	—	—

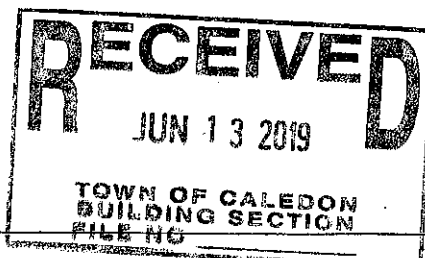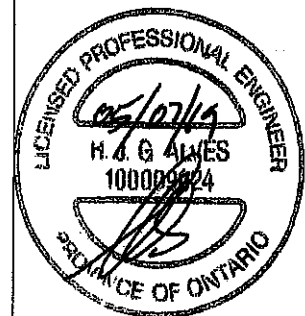

DWG NO. TAM 771073B
STRUCTURAL
COMPONENT ONLY

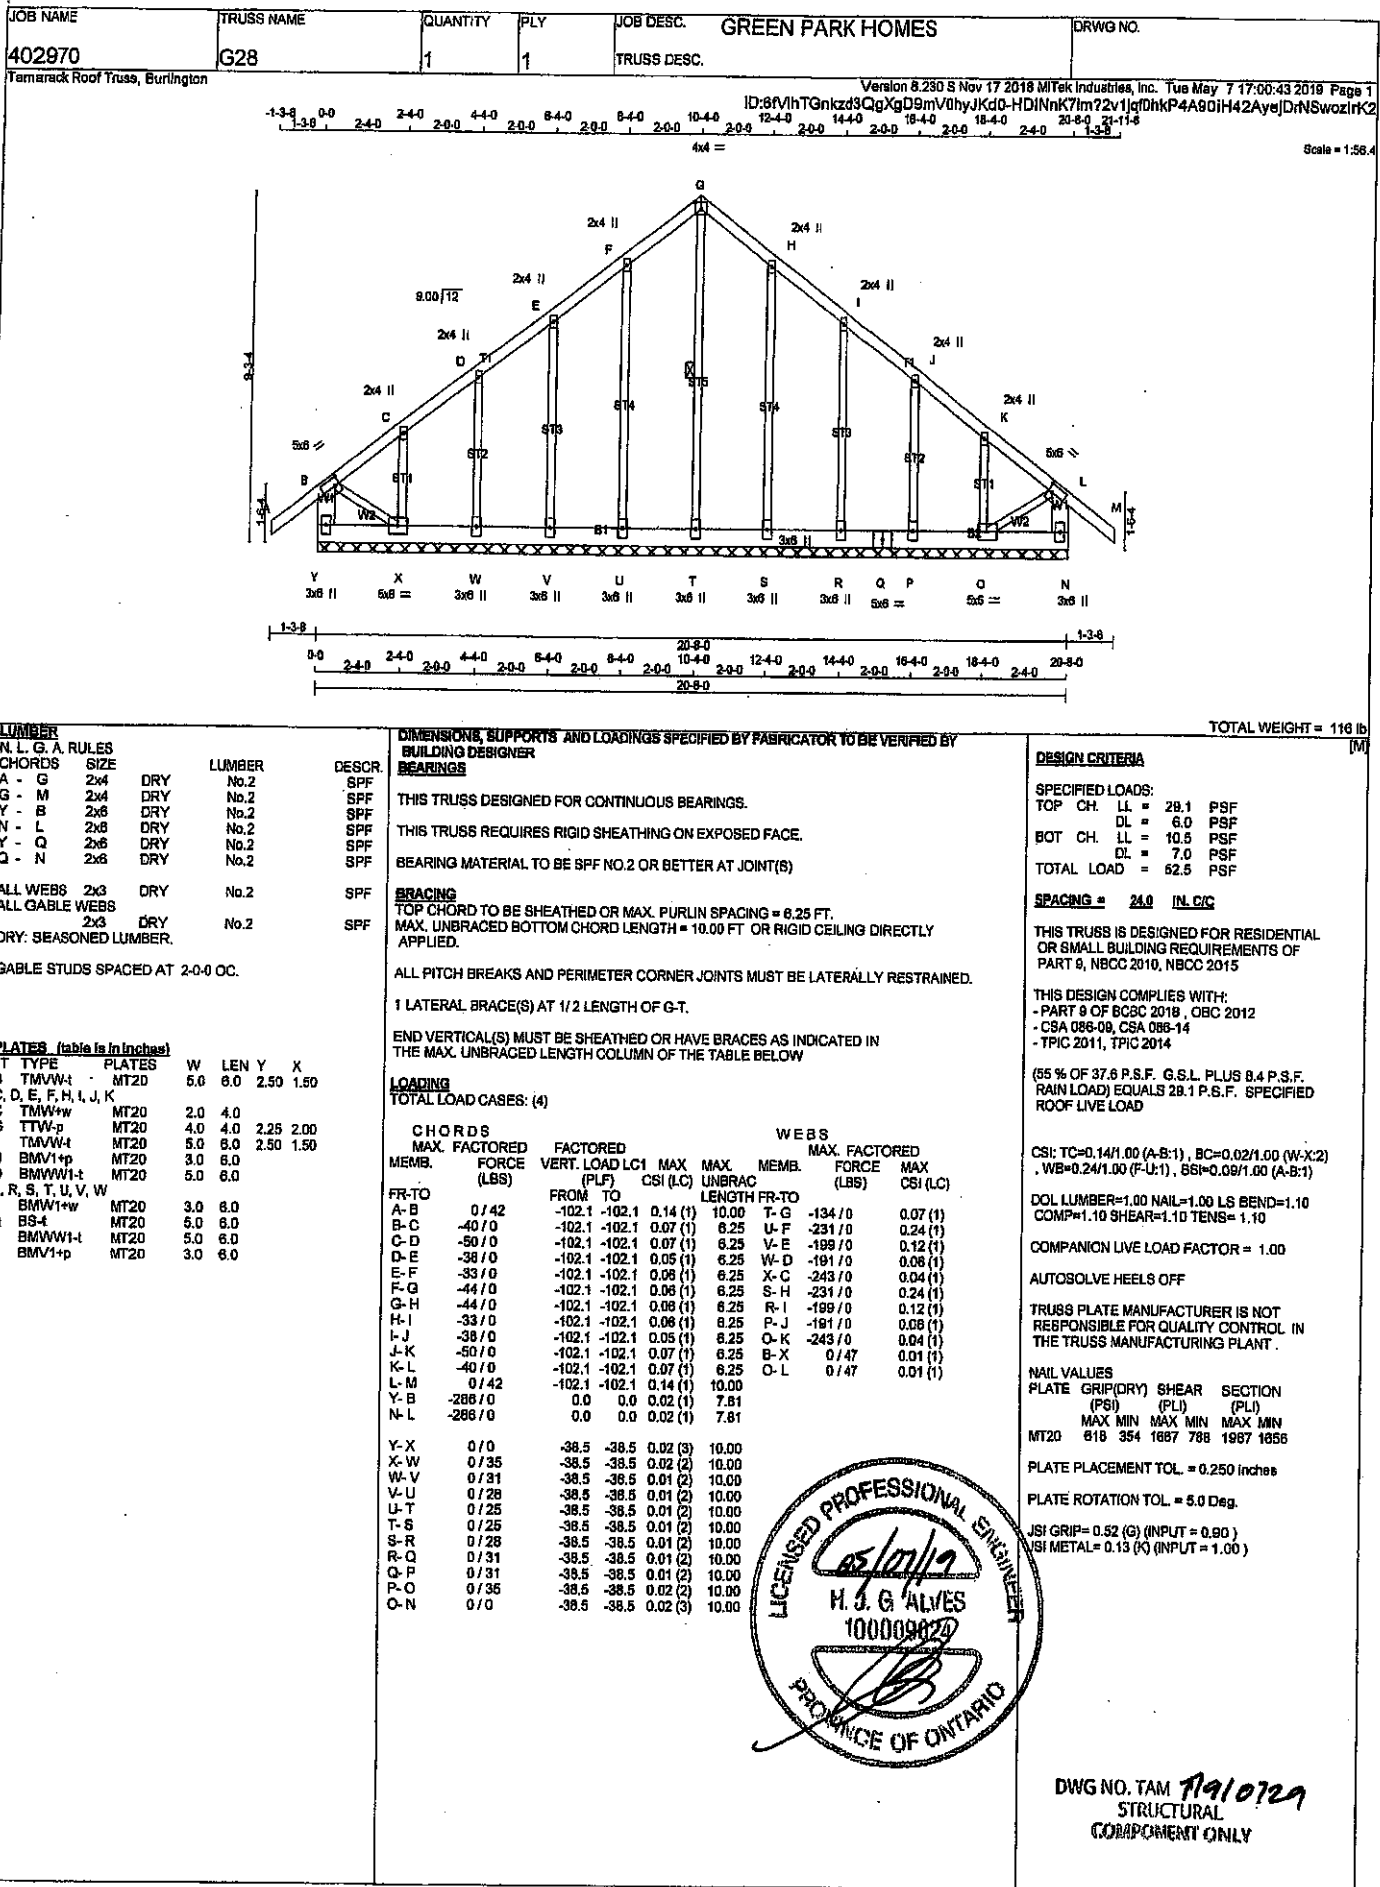

JOB NAME 402970	TRUSS NAME T29	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.230 8 Nov 17 2018 MITek Industries, Inc. Tue May 7 17:00:52 2019 Page 1	ID:8fVlhTGnkzd3QgXgD9mV0hyJKd0-WyLmgPEOemAec50N24OVWx41YFw8Hn3s2Hk3RknzlrJv
Scale = 1:17.0					

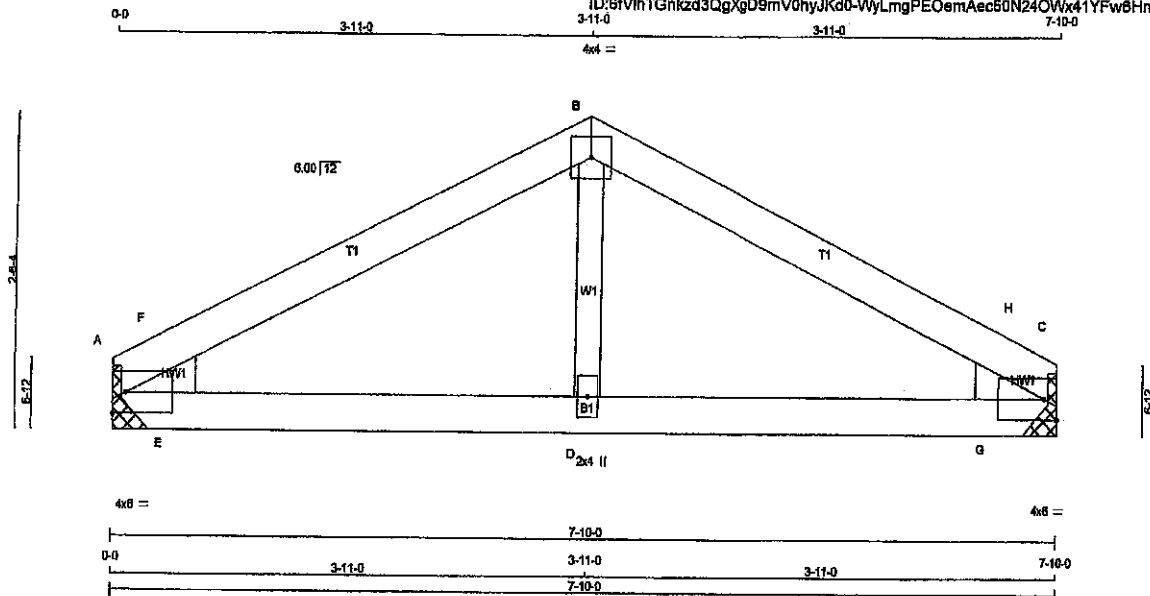

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - B	2x4	DRY	No.2	SFF
B - C	2x4	DRY	No.2	SFF
A - C	2x4	DRY	No.2	SFF

ALL WEBS 2x3 DRY SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMBH-1	MT20	4.0	6.0	Edge
B	TTW-p	MT20	4.0	4.0	Edge
C	TMBH-1	MT20	4.0	6.0	Edge
D	BMW-w	MT20	2.0	4.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG	HEEL WEDGE
	VERT	HORZ	DOWN	HORZ			
A	551	0	551	0	0	MECHANICAL	2x4 L
C	551	0	551	0	0	MECHANICAL	2x4 R

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT A, C. MINIMUM BEARING LENGTH AT JOINT A = 3-8, JOINT C = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SO
A	412	228 / 0	82 / 0	0 / 0	0 / 0	102 / 0	0 /
C	412	228 / 0	82 / 0	0 / 0	0 / 0	102 / 0	0 /

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)		
FR-TO		FROM TO			FR-TO				
A-F	-855 / 0	-102.1	-102.1	0.07 (1)	6.25	D-B	0 / 238	0.05 (2)	
F-B	-598 / 0	-102.1	-102.1	0.15 (1)	6.25	E-F	-83 / 99	0.00 (1)	
B-H	-598 / 0	-102.1	-102.1	0.15 (1)	6.25	G-H	-83 / 99	0.00 (1)	
H-C	-855 / 0	-102.1	-102.1	0.07 (1)	6.25				
A-E	0 / 527	-38.5	-38.5	0.17 (1)	10.00				
E-D	0 / 527	-38.5	-38.5	0.20 (1)	10.00				
D-G	0 / 527	-38.5	-38.5	0.20 (1)	10.00				
G-C	0 / 527	-38.5	-38.5	0.17 (1)	10.00				

TOTAL WEIGHT = 3 X 22 = 66 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 29.1 PSF
DL	= 6.0 PSF
BOT CH. LL	= 10.5 PSF
DL	= 7.0 PSF
TOTAL LOAD	= 52.5 PSF

SPACING = 24.0 IN. O.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.26")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.26")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.15/1.00 (B-H-1), BC=0.20/1.00 (D-G-1), WB=0.05/1.00 (B-D-2), SS=0.13/1.00 (B-H-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00



TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1858


PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.70 (A) (INPUT = 0.90)
JSI METAL = 0.14 (A) (INPUT = 1.00)

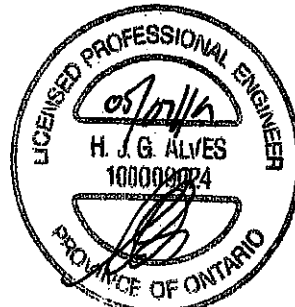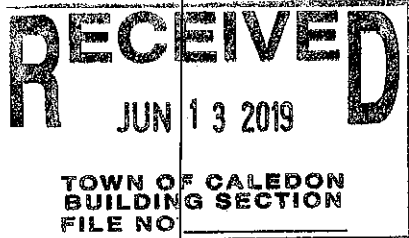

DRWG NO. TAM 87910739
STRUCTURAL
COMPONENT ONLY

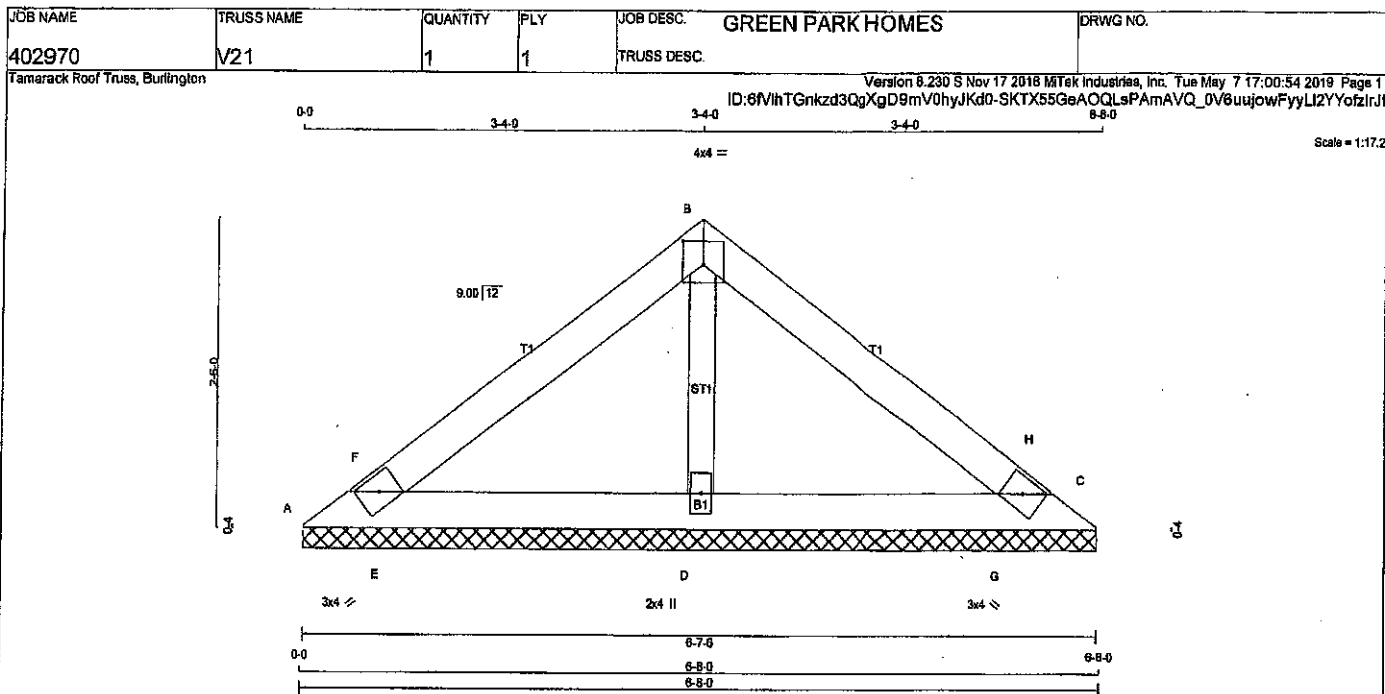

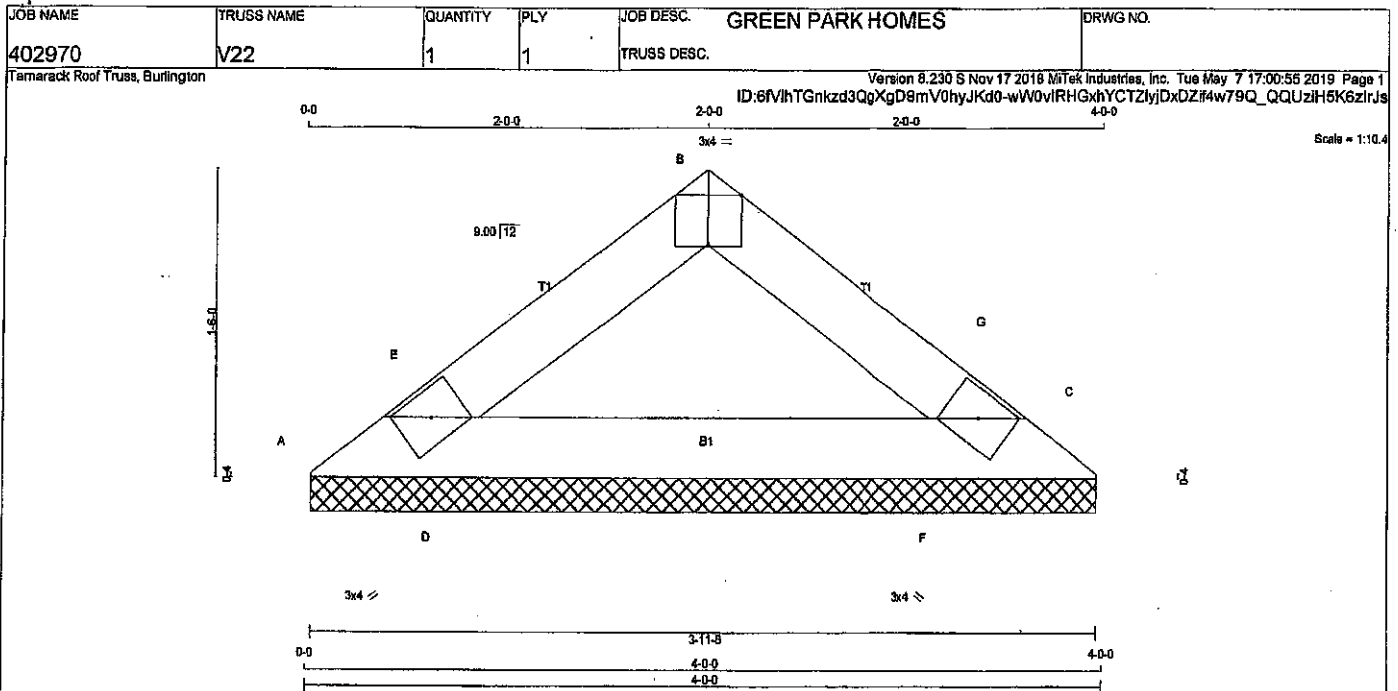

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.

A - B	2x4	DRY	No.2	SPF
B - C	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TBM1-h	MT20	3.0	4.0		
B	TT-p	MT20	3.0	4.0	Edge	2.00
C	TBM1-h	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
A	278	0	278	0	3-11-6	3-11-6
C	278	0	278	0	3-11-6	3-11-6

UNFACTORED REACTIONS							
JT	1ST LCASE		MAX / MIN COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
A	207	115 / 0	41 / 0	0 / 0	0 / 0	51 / 0	0 / 0
C	207	115 / 0	41 / 0	0 / 0	0 / 0	51 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) A, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MAX. FACTORED UNBRACED LENGTH FR-TO	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)
A-E	-282 / 0	-102.1	-102.1	0.12 (1)	D-E	0 / 88	0.00 (1)
E-B	-183 / 0	-102.1	-102.1	0.12 (1)	F-G	0 / 88	0.00 (1)
B-G	-183 / 0	-102.1	-102.1	0.12 (1)			
G-C	-282 / 0	-102.1	-102.1	0.12 (1)			
A-D	0 / 176	-38.5	-38.5	0.07 (1)			
D-F	0 / 181	-38.5	-38.5	0.11 (1)			
F-C	0 / 176	-38.5	-38.5	0.07 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.12/1.00 (A-E:1), BC=0.11/1.00 (D-F:1), WB=0.00/1.00 (D-E:1), SSI=0.11/1.00 (A-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.14 (C) (INPUT = 0.90)
JSI METAL= 0.08 (C) (INPUT = 1.00)

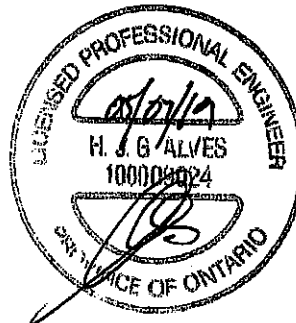

DWS NO. TAM 07910792
STRUCTURAL
COMMITMENT ONLY

JOB NAME 402938	TRUSS NAME J1	QUANTITY 19	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:41:32 2019 Page 1
ID: VdmZNianRCr_yT1tp?OGfzKFiw-3MnBmkmw0SbQL4YK_XAlqdSQSVtyUbkbMM7ZNLzlgln

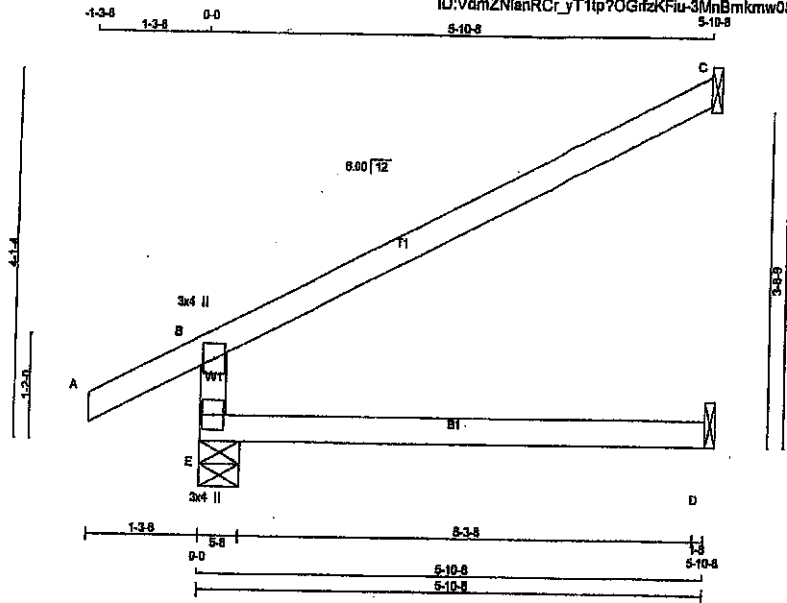

Scale = 1/23.6

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0			
E	BMV+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
E	646	0	646	0	5-8	5-8
C	225	0	225	0	1-8	1-8
D	93	0	119	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	MAX/MIN COMPONENT REACTIONS				WIND	DEAD	SOIL
		1ST LCASE	SNOW	LIVE	PERM.LIVE			
E	473	282/0	72/0	0/0	0/0	109/0	0/0	0/0
C	154	128/0	0/0	0/0	0/0	26/0	0/0	0/0
D	85	0/0	51/0	0/0	0/0	34/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	WEBS		MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSF (LC)
				MAX. CSF (LC)	MAX. UNBRACED LENGTH FR-TO		
FR-TO							
E-B	-514/0	0.0	0.0	0.22 (3)	7.81		
A-B	0/31	-102.1	-102.1	0.13 (1)	10.00		
B-C	-34/0	-102.1	-102.1	0.60 (1)	6.25		
E-D	0/0	-38.5	-38.5	0.22 (3)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 62.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012
- CSA 089-08, CSA 089-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL) = L/880 (0.20")
CALCULATED VERT. DEFL.(TL) = L/942 (0.07")

CSI: TC=0.83/1.00 (B-C-1), BC=0.22/1.00 (D-E-3),
WB=0.00/1.00 (n/a.0), SS=0.28/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	818 354	1887 788


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.21 (B) (INPUT = 0.90)
JSI METAL = 0.14 (B) (INPUT = 1.00)

DWG NO. TAM 71910753
STRUCTURAL
COMPONENT ONLY

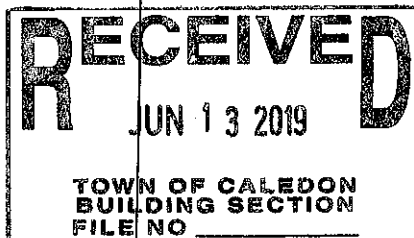

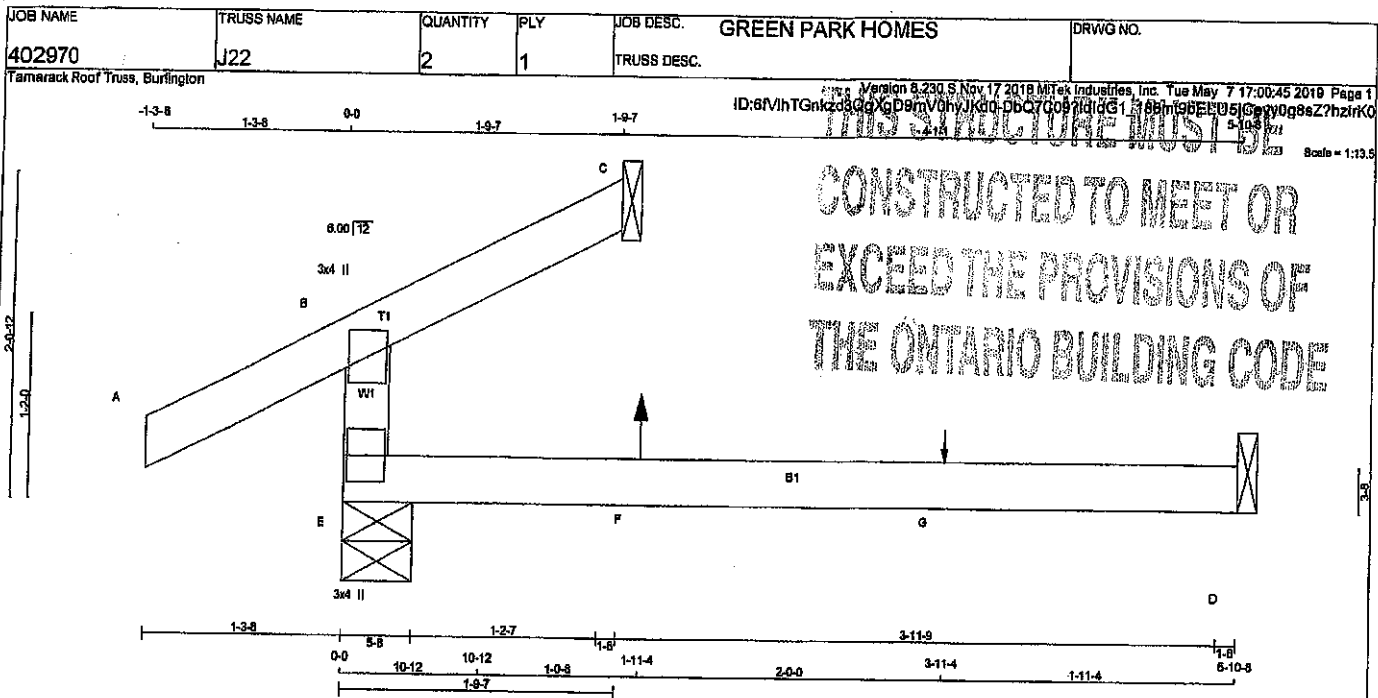

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0		
E BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
E	352	0	352	0
C	94	0	97	0
D	94	0	123	0

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	259	158 / 0	42 / 0	0 / 0	0 / 0	61 / 0	0 / 0
C	76	24 / 0	28 / 0	0 / 0	0 / 0	24 / 0	0 / 0
D	86	0 / -3	53 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (7)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED PLF (PLF)	WEBS		MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)
				MAX. FACTORED UNBRACED LENGTH	MAX. FACTORED CSI (LC)		
FR-TO				FROM	TO		
E-B	-228 / 28	0.0	0.0	0.16 (3)	7.81		
A-B	0 / 31	-102.1	-102.1	0.15 (1)	10.00		
B-C	0 / 27	-102.1	-102.1	0.16 (3)	10.00		
E-F	0 / 0	-38.5	-38.5	0.23 (3)	10.00		
F-G	0 / 0	-38.5	-38.5	0.23 (3)	10.00		
G-D	0 / 0	-38.5	-38.5	0.23 (3)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	8	1	13	BACK	VERT	TOTAL	-	-
G	3-11-4	1	1	-	BACK	VERT	TOTAL	-	-

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
DL = 6.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 62.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/899 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/839 (0.08")

CSI: TC=0.18/1.00 (B-E-3), BC=0.23/1.00 (D-E-3), WB=0.00/1.00 (W-E-0), SSI=0.14/1.00 (D-E-3)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1898

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.08 (E) (INPUT = 1.00)


DWG NO. TAM 0731
STRUCTURAL
COMPONENT ONLY

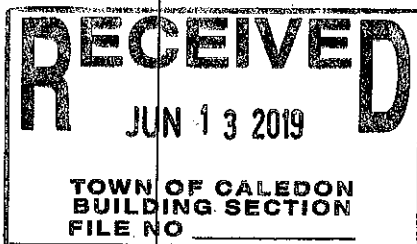

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
402970	J23	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Tue May 7 17:00:46 2018 Page 1
ID:8VhTGnkzd3QgXgD9mV0hyJKd0-ho_VPMAd2wQUuAZElqH8hpnVEV5dNLB9voc8X7zlrK?

Scale = 1:18.7

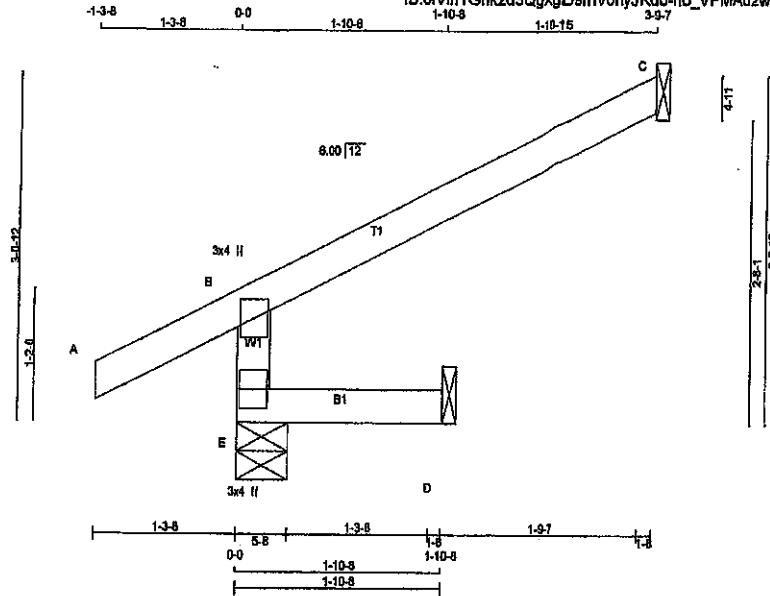

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
E - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ
JT	420	0	420	0
E	145	0	145	0
C	32	0	41	0

SEE MITEK STANDARD DETAIL B37621H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOOSE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	287	218 / 0	22 / 0	0 / 0	0 / 0	59 / 0	0 / 0
C	100	83 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	28	0 / 0	18 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LOAD LC1	MAX. CS1 (LC)	UNBRACED LENGTH	MEMB. MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)
FR-TO							
E-B	-380 / 0	0.0	0.0	0.01 (3)	7.81		
A-B	0 / 31	-102.1	-102.1	0.13 (1)	10.00		
B-C	-22 / 0	-102.1	-102.1	0.25 (1)	6.25		
E-D	0 / 0	-38.5	-38.5	0.03 (3)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 2 X 10 = 19 lb

DESIGN CRITERIA

SPECIFIED LOADS:	TOP CH.	LL	DL
	29.1	6.0	10.5
SPECIFIED LOADS:	BOT CH.	LL	DL
	29.1	6.0	10.5
TOTAL LOAD			52.5

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.25/1.00 (B-C:1), BC=0.03/1.00 (D-E:3),
WB=0.00/1.00 (n/a:0), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES



PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1657 788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.16 (E) (INPUT = 0.50)
JSI METAL= 0.11 (B) (INPUT = 1.00)

DWG NO. TAM 171910732
STRUCTURAL
COMPONENT ONLY

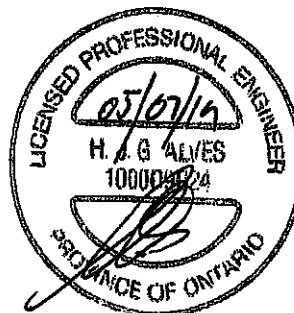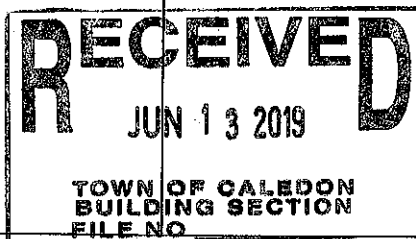

JOB NAME 402970	TRUSS NAME J24	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

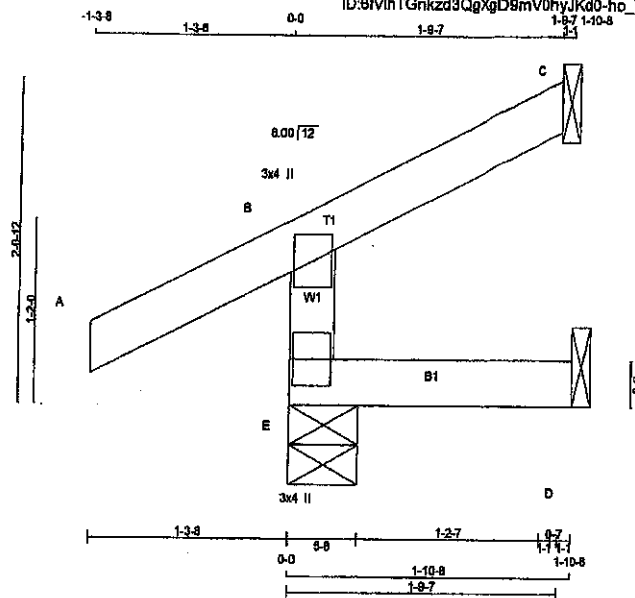

TOTAL WEIGHT = 2 X 7 = 14 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	HORZ	UP/LIFT	IN-SX
E	318	0	0	5-8
C	51	0	-28	1-8
D	24	0	-4	1-8

SEE MITEK STANDARD DETAIL B87821H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	228	160 / 0	20 / 0	0 / 0	0 / 0	48 / 0	0 / 0	0 / 0
C	38	27 / -21	2 / 0	0 / 0	0 / 0	7 / 0	0 / 0	0 / 0
D	24	0 / -8	18 / 0	0 / 0	0 / 0	11 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (LBS)	WEBS	MAX. FACTORED FORCE (LBS)
FR-TO						
E-B	-270 / 0	0.0	0.0	0.04 (5)	7.81	
A-B	0 / 31	-102.1	-102.1	0.13 (1)	10.00	
B-C	-18 / 0	-102.1	-102.1	0.10 (1)	8.25	
E-D	0 / 0	-38.5	-38.5	0.04 (5)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.1 PSF
DL = 8.0 PSF
BOT CH. LL = 10.5 PSF
DL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/380 (0.10")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/380 (0.10")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.04/1.00 (D-E:5).
WB=0.00/1.00 (n/a:0), SS=0.10/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.11 (E) (INPUT = 0.90)
JSI METAL= 0.07 (E) (INPUT = 1.00)

DWG NO. TAM 17910733
STRUCTURAL
COMPONENT ONLY

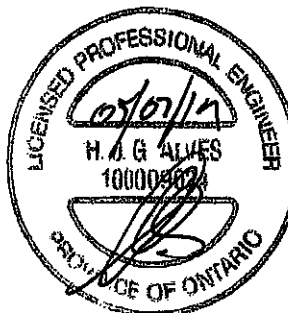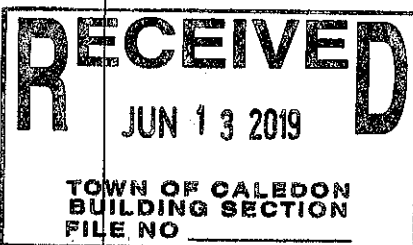

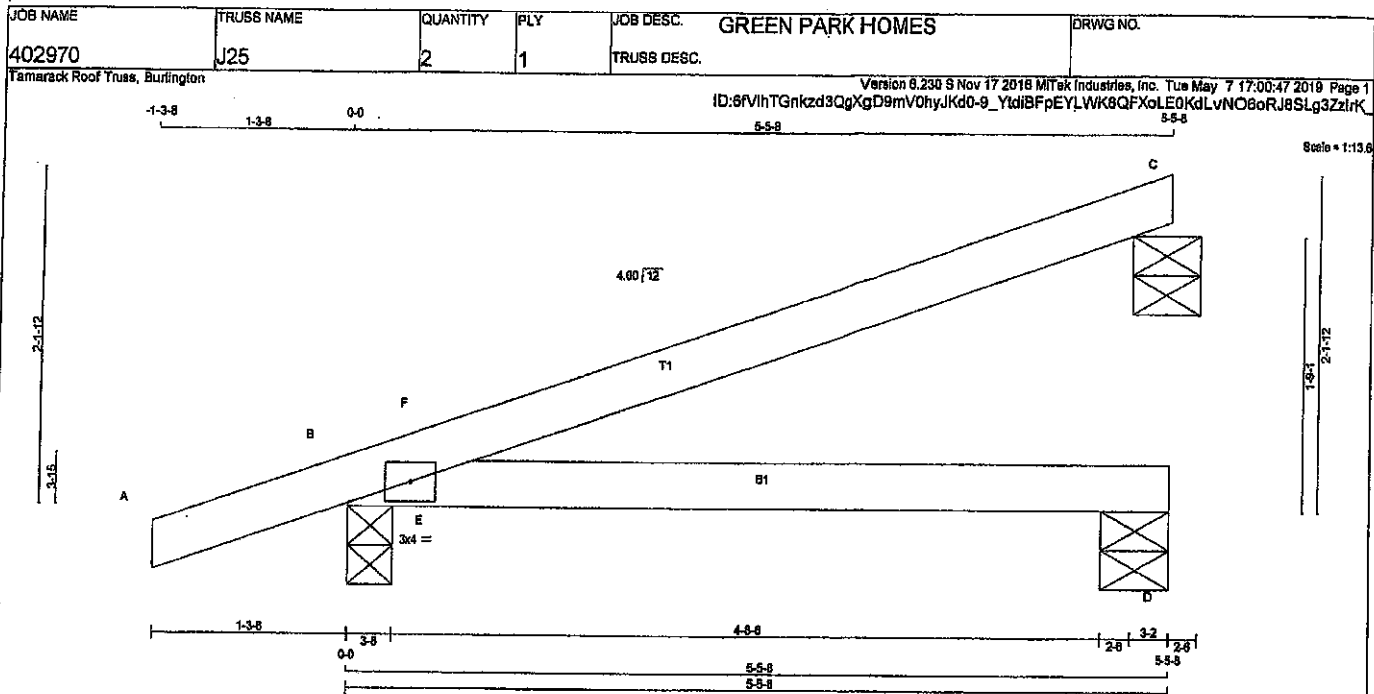

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 MAX	MAX CS1 (LC)	UNBRACED LENGTH FR-TO	MEMB.	WEBS MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)
FR-TO								
A-B	0/20	-102.1	-102.1	0.13 (1)	10.00	E-F	-254/122	0.00 (1)
B-F	-51/0	-102.1	-102.1	0.13 (3)	6.25			
F-C	0/8	-102.1	-102.1	0.42 (1)	10.00			
B-E	0/0	-38.5	-38.5	0.28 (1)	10.00			
E-D	0/0	-38.5	-38.5	0.31 (1)	10.00			

TOTAL WEIGHT = 2 X 14 = 28 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	29.1	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	10.5	PSF
	DL	=	7.0	PSF
TOTAL LOAD		=	52.5	PSF

SPACING = 24.0 IN C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/842 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/489 (0.13")

CS1: TC=0.42/1.00 (C-F:1), BC=0.31/1.00 (D-E:1),
WB=0.00/1.00 (E-F:1), SS=0.28/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	618	354	1667 788 1987 1668

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.31 (B) (INPUT = 0.80)
JSI METAL = 0.09 (B) (INPUT = 1.00)

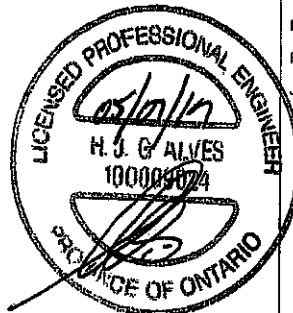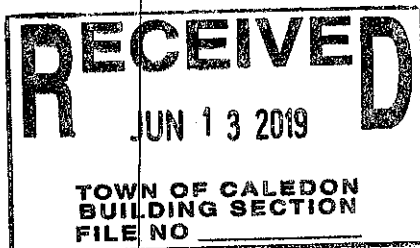


DWG NO. TAM 174/0734
STRUCTURAL
COMMITMENT ONLY

JOB NAME 402970	TRUSS NAME J26	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2016 Mitek Industries, Inc. Tue May 7 17:00:48 2016 Page 1
ID:8fVihTGnkzd3QgXpD9mV0hyJKd0-dA5Gq2BtaYgC8UcpFJanEssPlntrFhSM65Db0zlrJz

Scale: 3/4"=1'

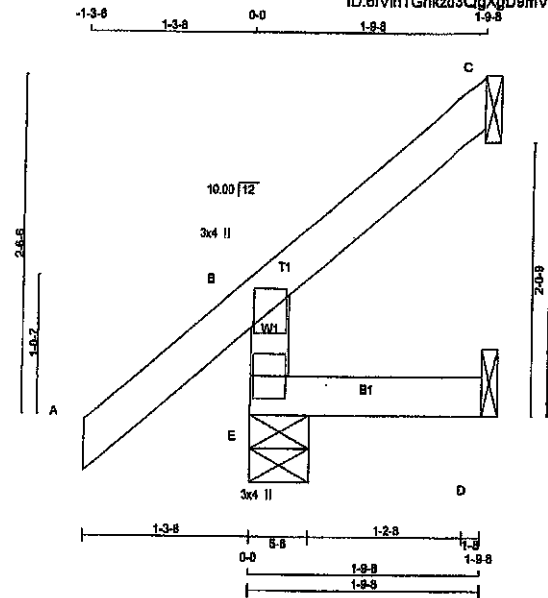

TOTAL WEIGHT = 3 X 8 = 23 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMA+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	322	0	322	0	5-8	5-8
C	82	0	52	0	1-8	1-8
D	20	0	39	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE		MAX MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
E	229	164/0	19/0	0/0	0/0	46/0	0/0
C	36	28/-19	1/0	0/0	0/0	7/0	0/0
D	21	0/-12	17/0	0/0	0/0	10/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		MAX. FACTORED	MEMB.	WEBS		MAX. FACTORED
	FORCE (LBS)	VERT. LOAD LC1	FACTORED (PLF)	MAX. FACTORED (LC)			FORCE (LBS)	MAX. FACTORED (LC)	
FR-TO									
E-B	-273/0	0.0	0.0	0.05 (5)	7.81				
A-B	0/45	-102.1	-102.1	0.14 (1)	10.00				
B-C	-25/0	-102.1	-102.1	0.10 (1)	8.25				
E-D	0/0	-38.5	-38.5	0.05 (5)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.1 PSF
CL = 6.0 PSF
BOT CH. LL = 10.5 PSF
CL = 7.0 PSF
TOTAL LOAD = 52.5 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2010, CBC 2012
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.1 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/380$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/380$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC=0.14/1.00 (A-B:1), BC=0.05/1.00 (D-E:5),
WB=0.00/1.00 (n/a:0), SS=0.08/1.00 (A-B:1)

DCL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES


PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PL)	(PL)	(PL)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1607
	768	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.13 (B) (INPUT = 0.80)
JSI METAL= 0.10 (B) (INPUT = 1.00)

DWG NO. TAM 77910735
STRUCTURAL
COMPONENT ONLY

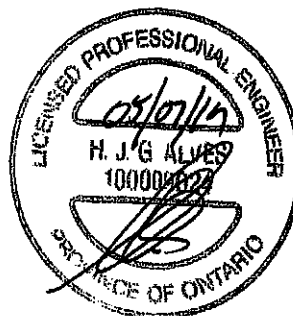





isDesign™

Client:
Project:
Address:Date: 5/7/2019
Designer:
Job Name: 201008
Project #:

Page 3 of 4

BM21 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

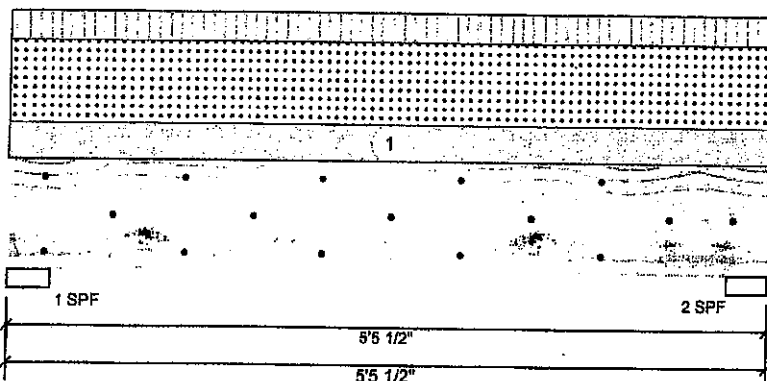**Member Information**

Type:	Girder	Application:	Roof (Residential)
Piles:	2	Slope:	0/12
Moisture Condition:	Dry	Design Method:	LSD
Deflection LL:	360	Building Code:	NBCC 2015
Deflection TL:	360	Load Sharing:	No
Importance:	Normal	Deck:	Not Checked
		Vibration:	Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	141	174	396	0
2	141	174	396	0

Bearings and Factored Reactions


Bearing	Length	Cap. React D/L lb	Total Ld. Case	Ld. Comb.
1 - SPF	3.500"	15% 218 / 735	953 L	1.25D+1.5S +L
2 - SPF	3.500"	15% 218 / 735	953 L	1.25D+1.5S +L

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	1091 ft-lb	2'8 3/4"	6039 ft-lb	0.181 (18%)	1.25D+1.5S +L	L
Unbraced	1091 ft-lb	2'8 3/4"	5299 ft-lb	0.206 (21%)	1.25D+1.5S +L	L
Shear	873 lb	4'5 1/2"	3984 lb	0.219 (22%)	1.25D+1.5S +L	L
LL Defl inch	0.009 (L/8806)	2'8 3/4"	0.167 (L/360)	0.050 (5%)	S+0.5L	L
TL Defl inch	0.012 (L/4953)	2'8 3/4"	0.167 (L/360)	0.070 (7%)	D+S+0.5L	L

Design Notes

- 1 Fasten all piles using 3 rows of 10d Box nails (.128x3") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top braced at bearings.
- 5 Bottom braced at bearings.
- 6 Lateral slenderness ratio based on single ply width.

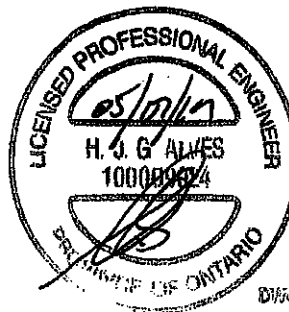DWG NO. TAM 1710751
STRUCTURAL
CALCULATIONS ONLY 1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		4-11-0	Near Face	13 PSF	10.5 PSF	29.5 PSF	0 PSF	

RECEIVED
JUN 13 2019TOWN OF CALEDON
BUILDING SECTION
FILE NO. _____**Manufacturer Info**Tamarack Roof Trusses
3259 North Service Rd., ON
Canada
L7N3G2
(905) 336-1115

This design is valid until 12/11/2021





isDesign™



Client:
Project:
Address:

Date: 5/7/2019
Designer:
Job Name: 201006
Project #:

Page 4 of 4

BM21 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED



Level: Level

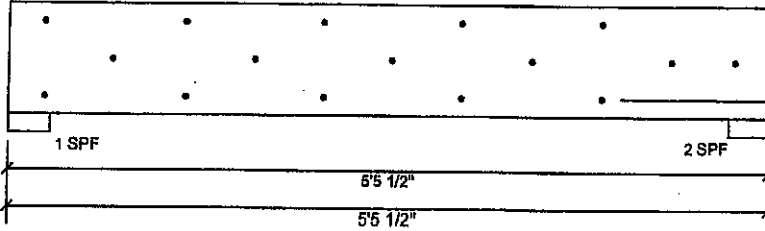

Multi-Ply Analysis

Fasten all plies using 3 rows of 10d Box nails (.128x3") at 12" o.c.. Maximum end distance not to exceed 6"

Capacity	45.5 %
Load	174.5 PLF
Yield Limit per Foot	383.4 PLF
Yield Limit per Fastener	127.8 lb.
Yield Mode	g
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S+L
Duration Factor	1.00

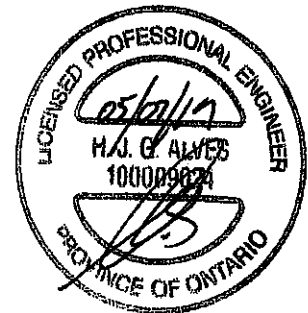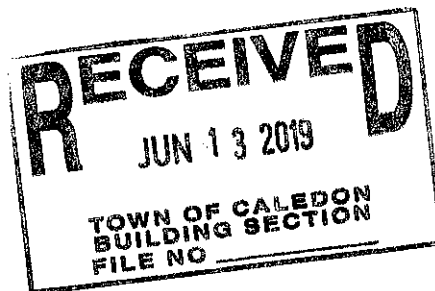

DWG NO. IAM 19/0751
STRUCTURAL
CHECKED BY 3/2

Manufacturer Info	Tamarack Roof Trusses 3266 North Service Rd., ON Canada L7N3G2 (905) 335-1115
	TAMARACK LUMBER INC. ALPA LUMBER GROUP

This design is valid until 12/11/2021




Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.

Detail:

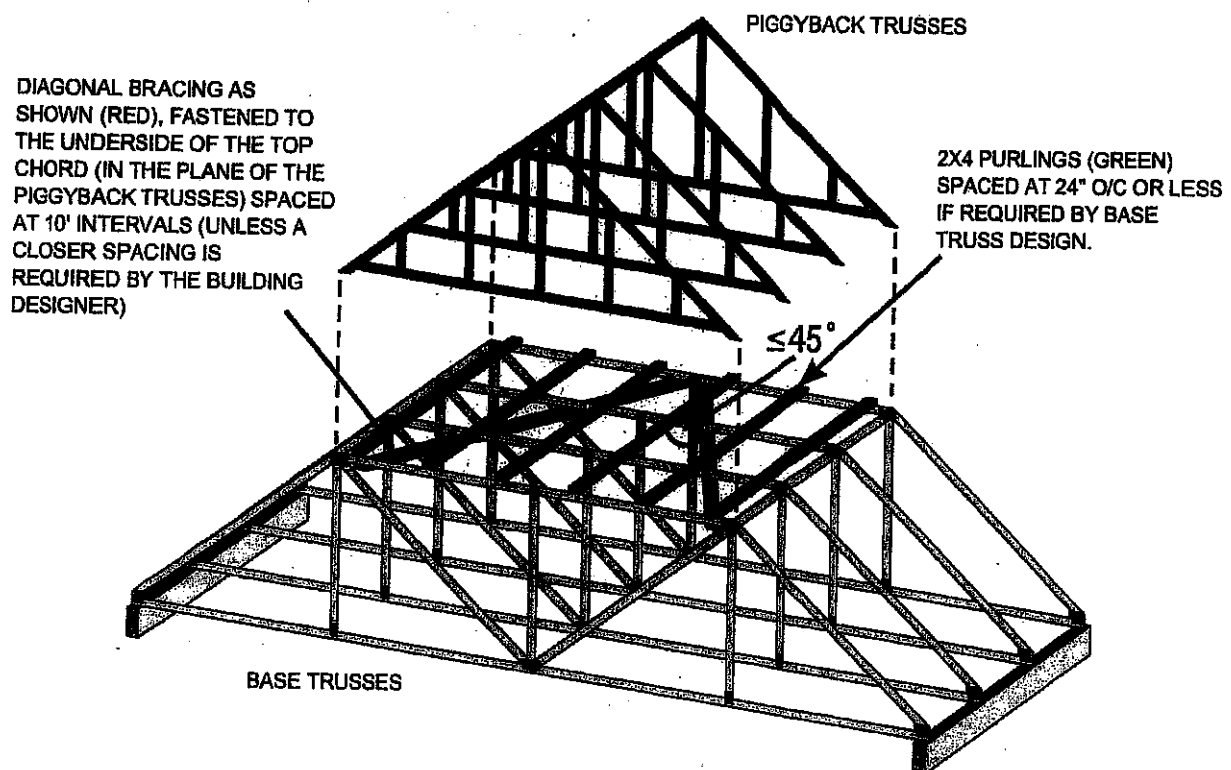

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.


SKETCH FROM BCSI-CANADA 2013

Disclaimer:


OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.

SIMPSON
Strong-Tie


- These hangers cannot be modified

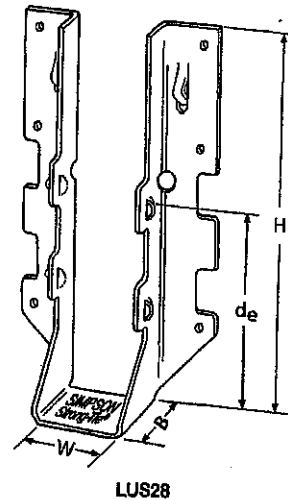

1. d_s is the distance from the seat of the hanger to the highest joist nail.



**Double
Shear
Nailing
Top View.**

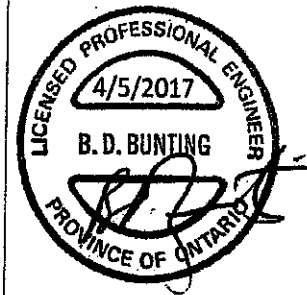

(800) 999-5099
strongtie.com

HUS/LJS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86 -14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options




LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS28DS
Installation




Typical HUS
Installation



Typical HUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁	Face	Joist		D.Fir-L		S-P-F	
									Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
LJS26DS	18	1 1/8	5	3 1/2	4 3/8	(16) 16d	(8) 16d		2055	4265	1460	4115
HUS26	16	1 1/8	5 1/2	3	3 1/8	(14) 16d	(8) 16d		2705	4940	2065	3875
HUS28	16	1 1/8	7 3/4	3	6 1/2	(22) 16d	(8) 16d		3805	5365	2675	4345
HUS210	16	1 1/8	9 3/4	3	7 1/4	(30) 16d	(10) 16d		4505	5795	4010	4740
HUS1.81/10	16	1 1/8	9	3	8	(30) 16d	(10) 16d		4505	6450	4010	5200

1. d₂ is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).


U.S. Patent 5,803,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

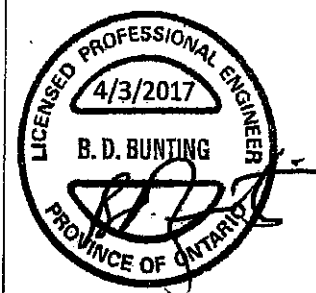

(800) 999-5099
strongtie.com

HGUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%.
No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options



HGUS28-2

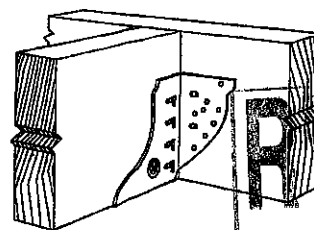


Typical HGUS
Installation




Typical HGUS
Installation
(Truss Designer to
provide fastener
quantity for
connecting multiple
members together)

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁	Face	Joist	D.Fr-L		S-P-F	
								Uplift (K ₁ =1.15)	Normal (K ₂ =1.00)	Uplift (K ₁ =1.15)	Normal (K ₂ =1.00)
HGUS26	12	1 1/2	5 1/2	5	4 1/2	(20) 16d	(8) 16d	2685	6625	2685	5700
HGUS26-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS28	12	1 1/2	7 1/2	5	8 1/2	(36) 16d	(12) 16d	3310	7675	3100	6900
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-3	12	4 1/8	7 1/4	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	8840	14645	4855	10400
HGUS210-3	12	4 1/8	9 1/4	4	8 1/8	(46) 16d	(16) 16d	8840	14645	4855	10400
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	8840	14645	4855	10400
HGUS212-4	12	8 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11845


1. d₁ is the distance from the seat of the hanger to the highest joist nail.




Dome Double
Shear Nailing
prevents tabs
breaking off
(available on
some models).
U.S. Patent
5,603,580




Double
Shear
Nailing
Side View.
Do not
bend tab
back.



Double
Shear
Nailing
Top View.

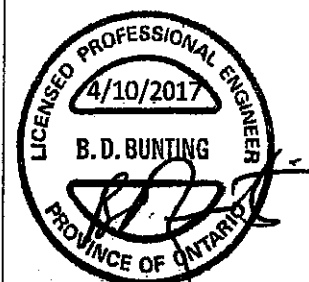

(800) 999-5099
strongtie.com

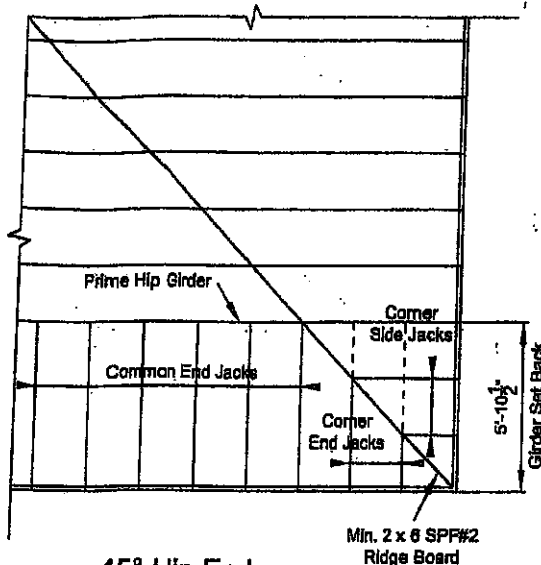

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD : 50.5 P.S.F

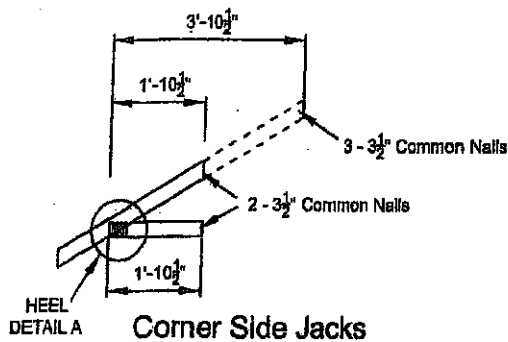


Corner Side Jacks

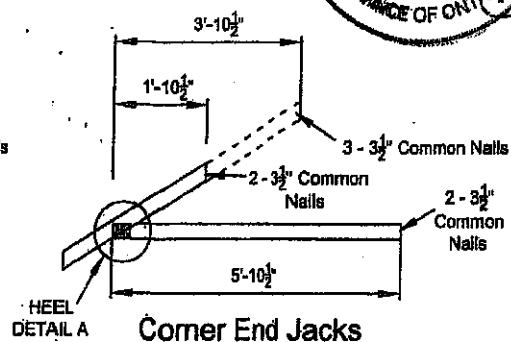

Corner End Jacks

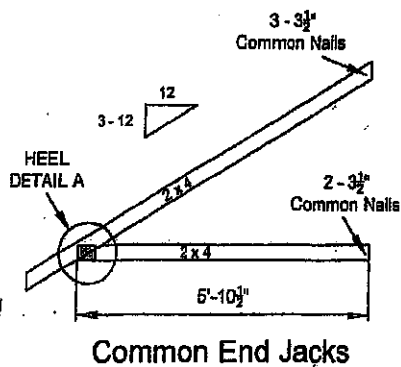

Common End Jacks

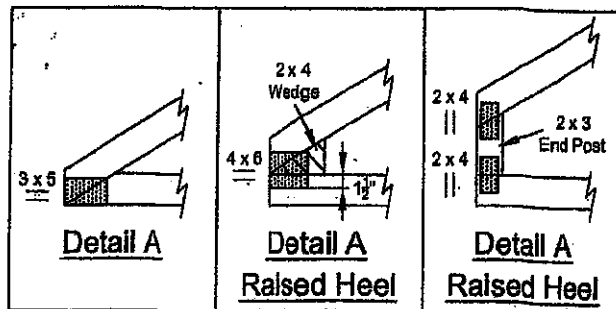


NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

RECEIVED
 JUN 13 2019

1800216

TOWN OF CALEDON
 BUILDING SECTION
 FILE NO

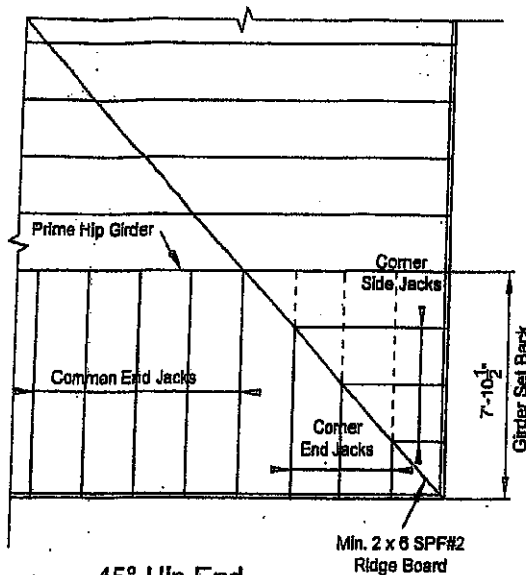






LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN

DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.

TOTAL LOAD

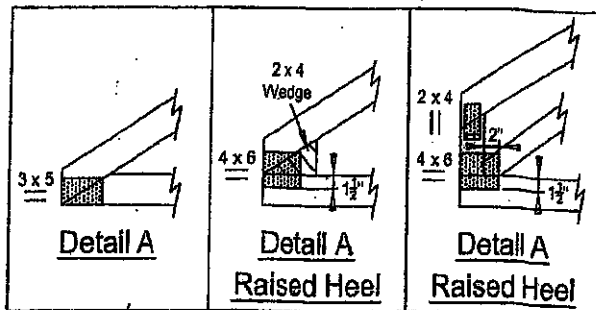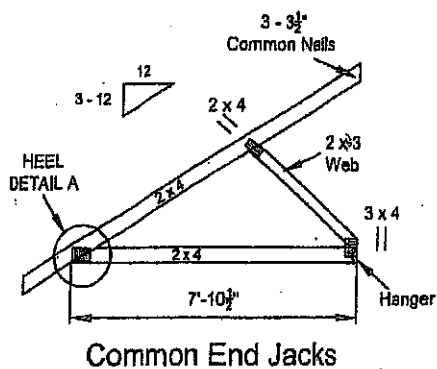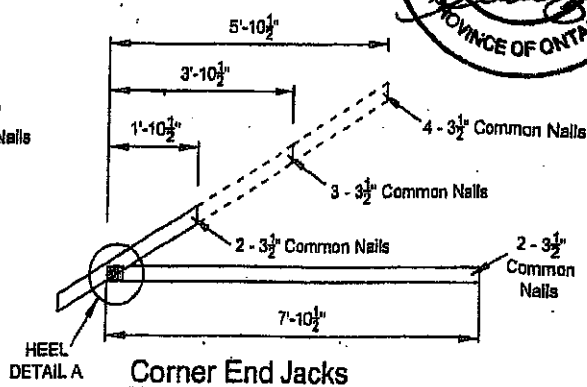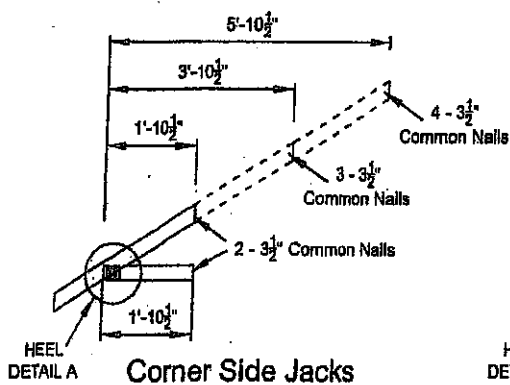


NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)


T-1800217

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

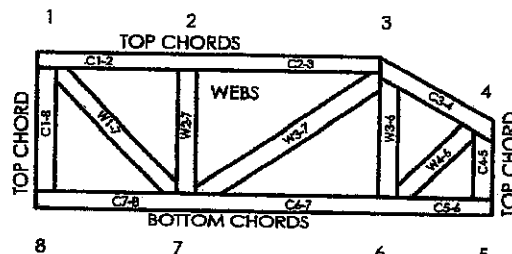

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-L

© 2007 MiTek All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

- Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
- Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
- Never exceed the design loading shown and never stack materials on inadequately braced trusses.
- Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
- Cut members to bear tightly against each other.
- Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
- Design assumes trusses will be suitably protected from the environment in accord with TPIC.
- Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
- Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
- Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
- Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
- Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
- Top chords must be sheathed or purlins provided at spacing indicated on design.
- Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
- Connections not shown are the responsibility of others.
- Do not cut or alter truss member or plate without prior approval of an engineer.
- Install and load vertically unless indicated otherwise.
- Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
- Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
- Design assumes manufacture in accordance with TPIC Quality Criteria.

RECEIVED
JUN 13 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufacturer's responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate Institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

