


SEP 16 2019
TOWN OF CALEDON
BUILDING SECTION

URBAN 2
FRONT ELEV.-3
UNIT 87-3
LOWES HILL CIRCLE
405521

URBAN 12
FRONT ELEV.-1
UNIT 87-4
LOWES HILL CIRCLE
405520

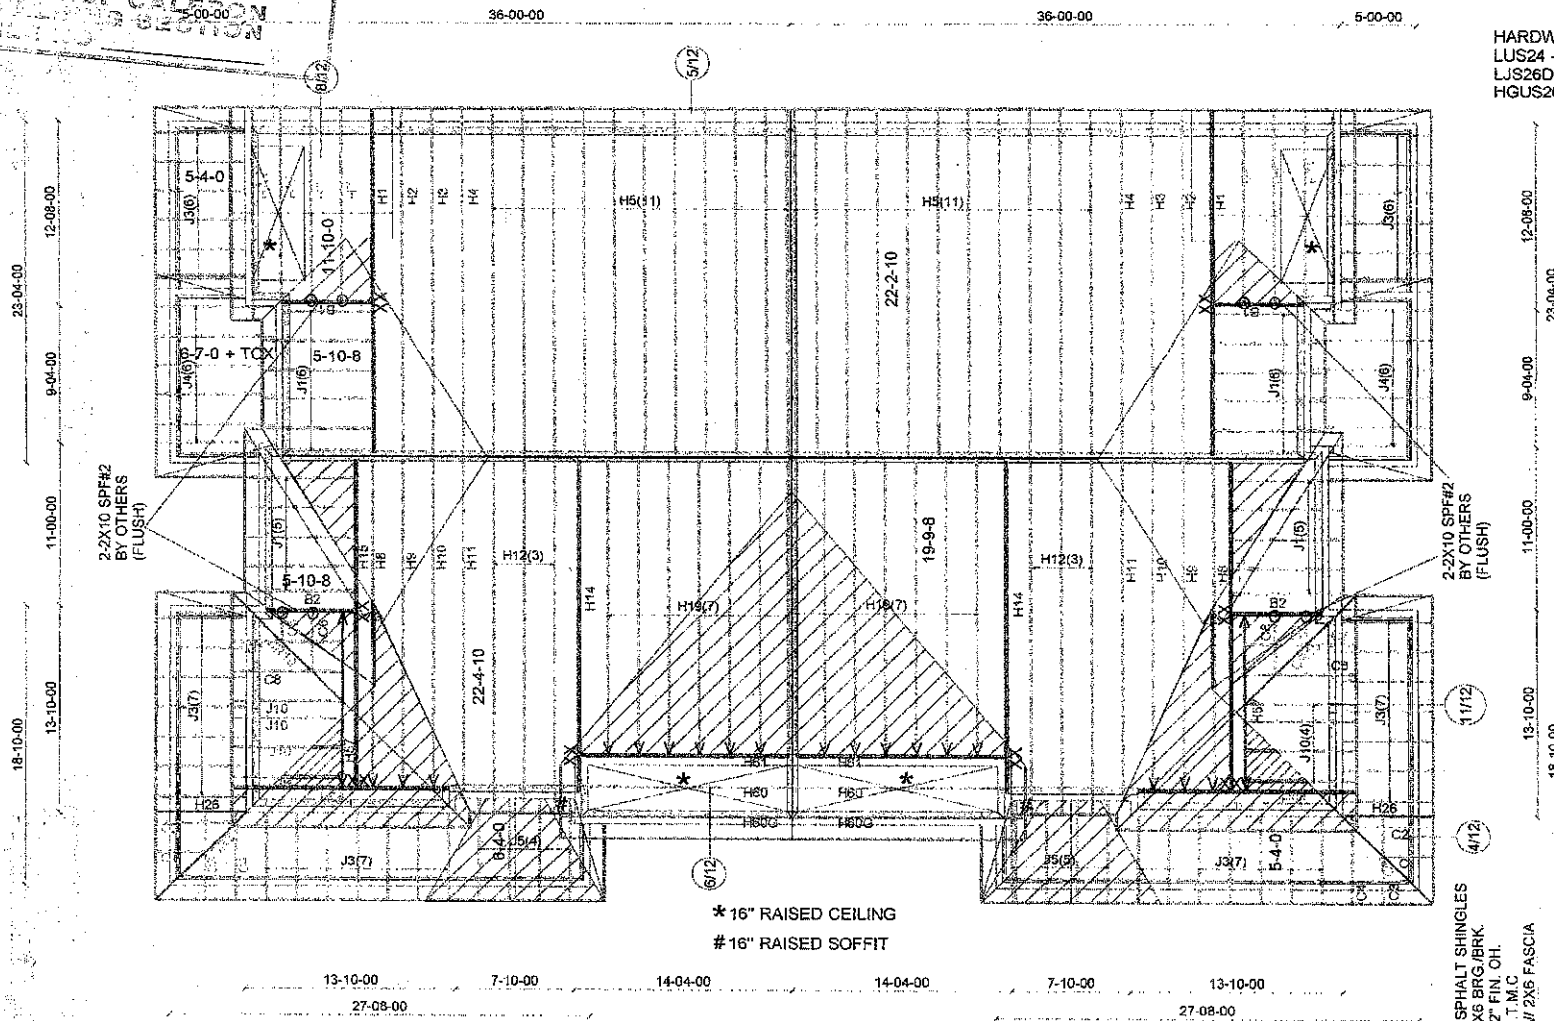

HARDWARE:
LUS24 - (O)
LJS26DS - (V)
HGUS26-2 - (XX)

URBAN 2
FRONT ELEV.-3
UNIT 87-2
DEER RIDGE TRAIL
405521

URBAN 12
FRONT ELEV.-1
UNIT 87-1
DEER RIDGE TRAIL
405520

ASPHALT SHINGLES
2X6 BRG/BRK.
12\"/>

M12631



Job Track: **50033**
Plan Log: **201715**
Layout ID: **405515**

Builder / Location:

GREEN PARK HOMES / CALEDON

Project: **LAMBERT LANE PH.2**

Date: 9/13/2019 Sales: Mario DiCano Designer: AC

Model / Elevation:


BLOCK 87 / UNITS 87-1 - 87-4

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST			
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: LAMBERT LANE PH.2 Location: CALEDON Model: BLOCK 87 Lot #: Elevation: 87-1, 87-4	Job Track: 50033 PlanLog: 201715 Layout ID: 405520 Ref #: Page: 1 of 2 Date: 09/12/2019 Designer: Andrew Conway Sales Rep: Mario DiCano		

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	H8 Half Hip	5/12	22-00-02	5-03-13	2 x 4		1-02-07 5-03-13	87.8 55.33		
	1	H9 Half Hip	5/12	22-00-02	6-07-13	2 x 4		1-02-07 6-07-13	94.89 61.17		
	1	H10 Half Hip	5/12	22-00-02	7-11-13	2 x 4		1-02-07 7-11-13	96.28 60.83		
	1	H11 Half Hip	5/12	22-04-10	9-03-13	2 x 4		1-00-09 9-03-13	103.89 65.17		
	3	H12 Monopitch	5/12	22-04-10	10-04-08	2 x 4	1-03-08	1-00-09 10-04-08	288.88 178.50		
	1 2-ply	H14 Monopitch Girder	5/12	22-04-10	10-04-08	2 x 4 2 x 6		1-00-09 10-04-08	235.07 144.67		
	1 2-ply	H15 Hip Girder	5/12	22-00-02	5-03-13	2 x 4 2 x 6		1-02-07 1-03-10	201.49 127.33		
	7	H19 Common	5/12	19-09-08	10-04-08	2 x 4		2-01-09 10-04-08	620.06 385.00		
	1	H26 Monopitch Girder	4/12	4-07-00	2-05-10	2 x 4	1-03-08	7-15 2-02-04	20.23 14.00		
	1 2-ply	H56 Hip Girder	11/12	13-00-00	2-09-15	2 x 6	1-03-08 1-03-08	1-09-01 1-09-01	152.09 98.00		
	1	H57 Hip Girder	11/12	11-07-08	7-01-11	2 x 4		1-09-01 3-00-03	63.6 41.33		
	1	H60 Common	6/12	13-08-10	8-00-05	2 x 4		1-02-00 8-00-05	57.32 36.00		
	1	H60G GABLE	6/12	13-08-10	8-00-05	2 x 4	1-03-08	1-02-00 8-00-05	63.54 40.17		
	1 2-ply	H61 Jack-Closed Girder	6/12	13-08-10	9-04-05	2 x 4 2 x 6		2-06-00 9-04-05	160.85 97.33		

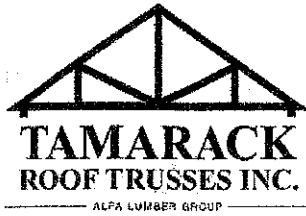

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BLOCK 87
 Lot #:
 Elevation: 87-1, 87-4

Job Track: 50033
 Plan Log: 201715
 Layout ID: 405520
 Ref #
 Page: 2 of 2
 Date: 09/12/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	5	J1 Jack-Open	8/12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	89.15 53.33		
	14	J3 Jack-Open	4/12	5-04-00	2-06-03	2 x 4	1-03-08	7-15 2-02-04	206.9 149.33		
	4	J5 Jack-Open	4/12	6-04-00	2-10-03	2 x 4	1-03-08	7-15 2-06-04	68.48 48.00		
	4	J10 Jack-Open	11/12	5-10-08	7-01-11	2 x 4	1-03-08	1-09-01 7-01-11	84.64 52.00		

TOTAL # TRUSS= 53

TOTAL BFT OF ALL TRUSSES= 1707.49


BFT: TOTAL WEIGHT OF ALL TRSSES 2695.17 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	LUS24	
11	Hardware	LJS26DS	
3	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS=

16

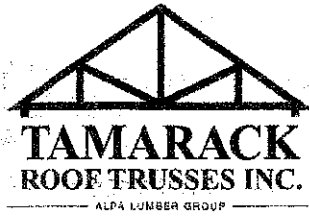

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: BLOCK 87
 Lot #:
 Elevation: 87-2, 87-3

Job Track: 50033
 Plan Log: 201715
 Layout ID: 405521
 Ref #
 Page: 1 of 1
 Date: 09/13/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	H1 Half Hip Girder	5/12	22-02-10	5-03-13	2 x 4 2 x 6	1-03-08	1-00-09 5-03-13	219.48 135.00		
	1	H2 Half Hip	5/12	22-02-10	6-07-13	2 x 4	1-03-08	1-00-09 6-07-13	96.92 62.50		
	1	H3 Half Hip	5/12	22-02-10	7-11-13	2 x 4	1-03-08	1-00-09 7-11-13	98.18 61.67		
	1	H4 Half Hip	5/12	22-02-10	9-03-13	2 x 4	1-03-08	1-00-09 9-03-13	105.08 66.50		
	11	H5 Monopitch	5/12	22-02-10	10-03-10	2 x 4	1-03-08	1-00-09 10-03-10	1051.67 654.50		
	2	H7 Common	8/12	11-10-00	5-04-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	104.75 63.67		
	2	H7A Roof Special Structural Gable	8/12	11-10-00	5-04-02	2 x 4	1-03-08 1-03-08	1-04-13 1-04-13	103.8 69.33		
	6	J1 Jack-Open	8/12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	106.98 64.00		
	6	J3 Jack-Open	4/12	5-04-00	2-06-03	2 x 4	1-03-08	7-15 2-02-04	88.67 64.00		
	6	J4 Jack-Closed	4/12	6-07-00	3-02-03	2 x 4	1-03-08	7-15 2-10-04	174.1 123.00		

TOTAL # TRUSS= 38 TOTAL BFT OF ALL TRUSSES= 1364.17 BFT. TOTAL WEIGHT OF ALL TRSSES 2149.64 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	LUS24	
1	Hardware	HGUS26-2	

TOTAL NUMBER OF
ITEMS= 3

JOB NAME 405481 **TRUSS NAME** H1 **QUANTITY** 2 **PLY** 2 **JOB DESC.** GREEN PARK HOMES TRUSS DESC. **DATE** SEP 16 2019

Tamarack Roof Truss, Burlington

Version 8.300 6 May 10 2019 Mitek Industries, Inc. File Sep 13 12:21:51 2019 Page 1
ID: CGPETwIRwz3I2C D8UHFYR8a-68VNCPU02x00P2MHTTCSyqfPX17C5UVve3DU

LUMBER
N. L. G. A. RULES
CHORDS SIZE LUMBER DESCR.
A - O 2x4 DRY No.2 SPF
D - G 2x4 DRY No.2 SPF
H - B 2x4 DRY No.2 SPF
N - J 2x6 DRY No.2 SPF
J - W 2x6 DRY No.2 SPF
ALL WEBS 2x3 DRY No.2 SPF EXCEPT
DRY: SEASONED LUMBER.
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:
TOP CHORDS : (0.122"x3") SPIRAL NAILS
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS
WEBS : (0.122"x3") SPIRAL NAILS
NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.
PLATES (table is in inches)
L M TYPE PLATES W LEN Y X
BMWW-p MT20 4.0 8.0 Edge
BMWW-t MT20 4.0 4.0
TTWW-w MT20 5.0 6.0 2.50 1.75
TMW-w MT20 2.0 4.0
BMWW-t MT20 4.0 6.0
BMWW-l MT20 5.0 6.0
BMVV-l MT20 3.0 6.0
L M BMWW-t MT20 5.0 6.0
SS-t MT20 5.0 6.0
BMWW-t MT20 5.0 8.0
BMVV-l MT20 3.0 6.0 3.25 1.50
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER
BEARINGS
FACTORED MAXIMUM FACTORED INPUT REQ'D
GROSS REACTION GROSS REACTION BRG BRG
DOWN HORZ DOWN HORZ UPLIFT IN-SX IN-SX
JT 2745 0 2745 0 0 1-10 1-10
N 2223 0 2223 0 0 5-8 5-8
UNFACTORED REACTIONS
1ST CASE MAX./MIN. COMPONENT REACTIONS
JT COMBINED SNOW LIVE PERMLIVE WIND DEAD SOIL
H 1931 1327 / 0 0 / 0 0 / 0 604 / 0 0 / 0
N 1580 1094 / 0 0 / 0 0 / 0 466 / 0 0 / 0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, N
BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.89 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
LOADING
TOTAL LOAD CASES: (4)
CHORDS FACTORED WEBS FACTORED
MEMB. MAX. FORCE VERT. LOAD LC1 MAX. CS1 (LC) MAX. MEMB. MAX. FORCE VERT. LOAD LC1 MAX. CS1 (LC) MAX.
FR-TO FROM TO LENGTH FR-TO
A-B 0 / 26 -102.0 -102.0 0.07 (1) 10.00 M-C -488 / 0 0.05 (1)
B-C -3551 / 0 -102.0 -102.0 0.30 (1) 4.69 C-L -206 / 0 0.08 (1)
C-D -3401 / 0 -102.0 -102.0 0.29 (1) 4.78 L-D 0 / 1040 0.13 (1)
D-O -3024 / 0 -102.0 -102.0 0.20 (1) 5.11 I-G 0 / 2913 0.36 (1)
O-E -3024 / 0 -102.0 -102.0 0.29 (1) 5.11 D-K -184 / 0 0.06 (1)
E-P -3024 / 0 -102.0 -102.0 0.23 (1) 5.07 T-F 2208 / 0 0.45 (1)
P-Q -3024 / 0 -102.0 -102.0 0.23 (1) 5.07 K-E -672 / 0 0.14 (1)
Q-F -3024 / 0 -102.0 -102.0 0.23 (1) 5.07 K-F 0 / 1899 0.23 (1)
F-R -1854 / 0 -102.0 -102.0 0.21 (1) 8.13 B-M 0 / 3324 0.41 (1)
R-S -1854 / 0 -102.0 -102.0 0.21 (1) 8.13
S-G -1854 / 0 -102.0 -102.0 0.21 (1) 8.13
G-H -2843 / 0 0.0 0.0 0.61 (1) 7.00
H-N -2138 / 0 0.0 0.0 0.07 (1) 7.81
N-M 0 / 0 -18.5 -18.5 0.07 (1) 10.00
M-L 0 / 3298 -18.5 -18.5 0.35 (1) 10.00
L-T 0 / 3139 -18.5 -18.5 0.52 (1) 10.00
T-U 0 / 3139 -18.5 -18.5 0.52 (1) 10.00
U-K 0 / 3139 -18.5 -18.5 0.52 (1) 10.00
K-V 0 / 1854 -18.5 -18.5 0.21 (1) 10.00
V-J 0 / 1854 -18.5 -18.5 0.21 (1) 10.00
J-W 0 / 1854 -18.5 -18.5 0.21 (1) 10.00
W-I 0 / 1854 -18.5 -18.5 0.21 (1) 10.00
I-X 0 / 0 -18.5 -18.5 0.04 (4) 10.00
X-Y 0 / 0 -18.5 -18.5 0.04 (4) 10.00
Y-H 0 / 0 -18.5 -18.5 0.04 (4) 10.00
FACTORED CONCENTRATED LOADS (LBS)
JT LOC. LC1 MAX+ MAX- FACE DIR. TOTAL
G 22-2-10 -184 -164 --- FRONT VERT TOTAL --- C1
H 22-2-10 -35 -35 --- FRONT VERT TOTAL --- C1
O 12-6-14 -123 -123 --- FRONT VERT TOTAL --- C1
P 14-6-14 -123 -123 --- FRONT VERT TOTAL --- C1
Q 16-6-14 -123 -123 --- FRONT VERT TOTAL --- C1
R 18-6-14 -123 -123 --- FRONT VERT TOTAL --- C1
S 20-6-14 -123 -123 --- FRONT VERT TOTAL --- C1
T 11-11-9 -1206 -1206 --- FRONT VERT TOTAL --- C1
U 12-9-14 -27 -27 --- FRONT VERT TOTAL --- C1
V 14-8-14 -27 -27 --- FRONT VERT TOTAL --- C1
W 16-6-14 -27 -27 --- FRONT VERT TOTAL --- C1
X 18-6-14 -27 -27 --- FRONT VERT TOTAL --- C1
Y 20-6-14 -27 -27 --- FRONT VERT TOTAL --- C1

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF DL = 6.0 PSF
BOT CH. LL = 0.0 PSF DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014
ISS % OF 37.0 P.S.F. G.S.L PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED DEFLECT.(LL) = U/899 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.74")
CALCULATED VERT. DEFL.(TL) = U/959 (0.13")
CSI: TC=0.61/1.00 (G-H-I), BC=0.52/1.00 (K-L-I), WB=0.45/1.00 (F-I-T), SS=0.28/1.00 (K-L-I)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00
COMPANION LIVE LOAD FACTOR = 1.00
AUTOSOLVE RIGHT HEEL ONLY
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.
NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1987 1856
PLATE PLACEMENT TOL. = 0.250 inches
PLATE ROTATION TOL. = 5.0 Deg.
JSI GRIP= 0.88 (B) (INPUT = 0.90)
JSI METAL= 0.41 (M) (INPUT = 1.00)


LICENSED PROFESSIONAL ENGINEER
09/13/19
H. J/G ALVES
100009822
PROVINCE OF ONTARIO

Structural component only
DWG# T-1923489 CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
405481	H2	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2019 MTek Industries, Inc. Fri Sep 13 12:21:32 2019 Page 1
ID:CGPEtwIRwz3f2cd6UuHFyIR8a-bn3lXQH8olvZA?ec3ax?h9aBMCV7xxBMsr211ys3DT

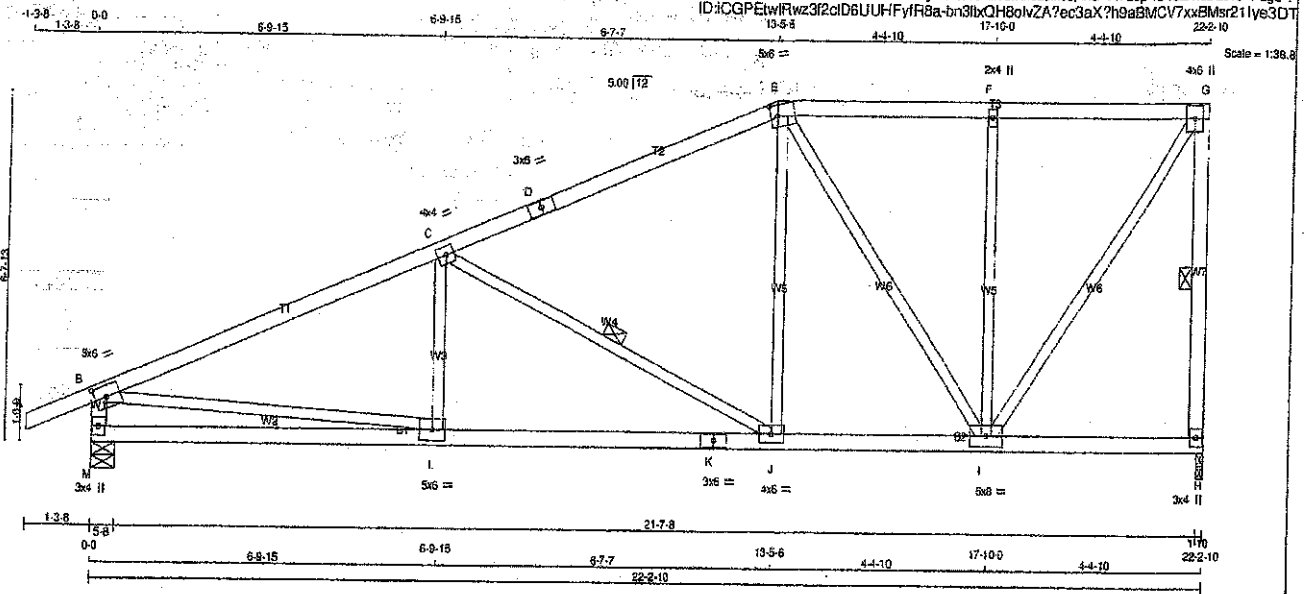

TOTAL WEIGHT = 2 X 97 = 194 lb
(NIF)

LUMBER	CHORDS	SIZE	LUMBER	DESCR.
N.L.G.A. RULES				
A - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
M - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY, SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	DOWN	UP	DOWN
H	1339	0	1339	0
M	1476	0	1476	0

UNFACTORED REACTIONS							
	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	942	644 / 0	0 / 0	0 / 0	0 / 0	298 / 0	0 / 0
M	1087	723 / 0	0 / 0	0 / 0	0 / 0	314 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, C-J.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	LC1	MAX. FACTORED CS1 (LBS)	UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LBS)
FR-TO							FR-TO		
A-B	0 / 28	-102.0	-102.0	0.13 (1)	10.00		L-C	-72 / 86	0.03 (4)
B-C	-2068 / 0	-102.0	-102.0	0.70 (1)	3.85		C-J	-929 / 0	0.37 (1)
C-D	-1244 / 0	-102.0	-102.0	0.82 (1)	4.87		J-E	0 / 542	0.12 (1)
D-E	-1244 / 0	-102.0	-102.0	0.82 (1)	4.87		E-I	-604 / 0	0.70 (1)
E-F	-786 / 0	-102.0	-102.0	0.25 (1)	6.25		I-G	-552 / 0	0.40 (1)
F-G	-786 / 0	-102.0	-102.0	0.25 (1)	6.25		G-L	0 / 1376	0.31 (1)
H-G	-1303 / 0	0.0	0.0	0.26 (1)	5.66				
M-B	-1423 / 0	0.0	0.0	0.14 (1)	6.84				
M-L	0 / 0	-18.5	-18.5	0.21 (4)	10.00				
L-K	0 / 1938	-18.5	-18.5	0.40 (1)	10.00				
K-J	0 / 1938	-18.5	-18.5	0.40 (1)	10.00				
J-I	0 / 1127	-18.5	-18.5	0.25 (1)	10.00				
I-H	0 / 0	-18.5	-18.5	0.07 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.74")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.15")

CSK TC=0.70/1.00 (B-C-I), BC=0.40/1.00 (J-L-I), WS=0.70/1.00 (E-I-I), SS=0.31/1.00 (B-C-I)

DOIL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1567 798 1887 1556

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (I) (INPUT = 0.90)
JSI METAL = 0.56 (K) (INPUT = 1.00)

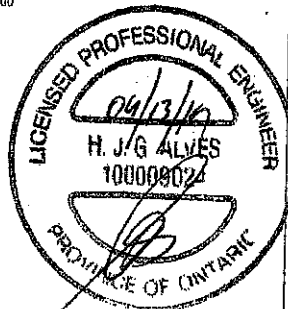


Structural component only
DWG# T-1923490

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
405481	H3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.300 5 May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:21:53 2019 Page 1
ID:ICGPEwIRwz3t2cID6UHFYfR8a-3zd74HRw5IBKaq9n6mYujpmZQsSKkbWabaky3DS

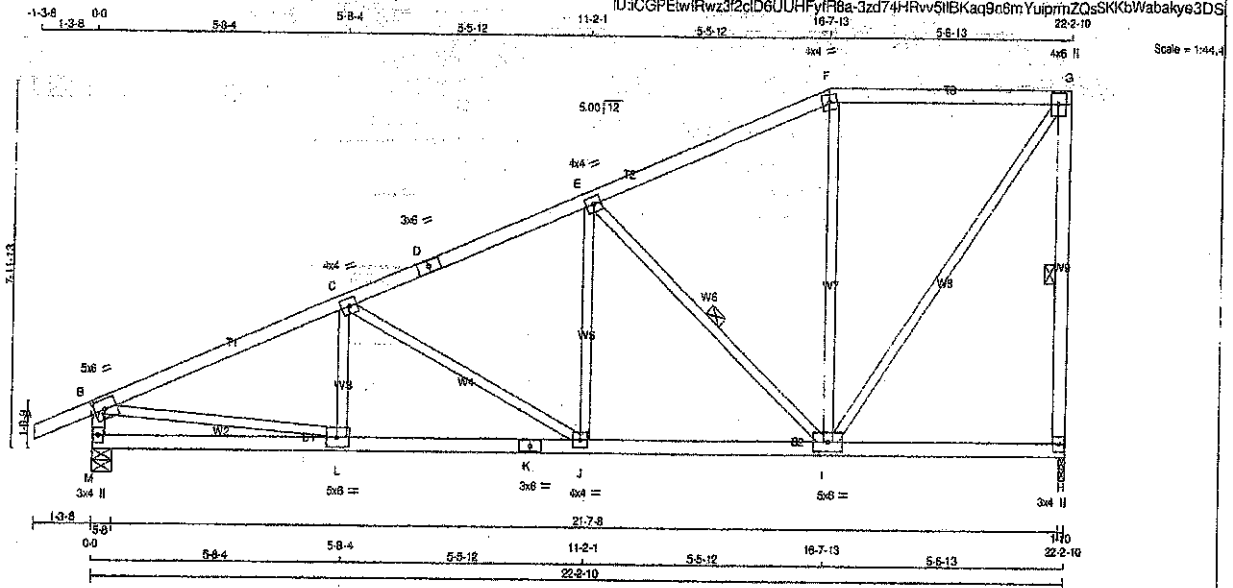

TOTAL WEIGHT = 3 X 98 = 294 lb

LUMBER				
N.L. & A. RULES				
CHORDS	SIZE		LUMBER	DESCR
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - G	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
M - B	2x4	DRY	No.2	SPF
M - K	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	HORIZ	DOWN	HORIZ	UPLIFT
H 1339 0	1339 0	0 0	1-10	1-10
M 1478 0	1478 0	0 0	5-8	5-8

UNFACTORED REACTIONS	1ST CASE	MAX/MIN COMPONENT REACTIONS
COMBINED	SNOW	LIVE
H 942	644 / 0	0 / 0
M 1037	728 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.28 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, E-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	VERT. LOAD	MAX	MAX	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CSJ (LC)	UNBRAC	LENGTH	MEMB.	FORCE (LBS)
FR-TO						FR-TO	
A-B	0 / 26	-102.0	-102.0	0.13 (1)	10.00	L-C	-143 / 51
B-C	-2087 / 0	-102.0	-102.0	0.45 (1)	4.25	C-J	-589 / 0
C-D	-1581 / 0	-102.0	-102.0	0.36 (1)	4.90	J-E	0 / 376
D-E	-1581 / 0	-102.0	-102.0	0.36 (1)	4.90	E-I	987 / 0
E-F	-805 / 0	-102.0	-102.0	0.36 (1)	8.25	I-F	207 / 13
F-G	-721 / 0	-102.0	-102.0	0.41 (1)	6.25	G-L	0 / 1245
H-G	-1298 / 0	0.0	0.0	0.37 (1)	5.66	B-L	0 / 1843
M-B	-1430 / 0	0.0	0.0	0.14 (1)	8.82		
M-L	0 / 0	-18.5	-18.5	0.13 (4)	10.00		
L-K	0 / 1927	-18.5	-18.5	0.36 (1)	10.00		
K-J	0 / 1927	-18.5	-18.5	0.36 (1)	10.00		
J-I	0 / 1441	-18.5	-18.5	0.30 (1)	10.00		
I-H	0 / 0	-18.5	-18.5	0.14 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 20.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 5.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.74")
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSJ: TC=0.45/1.00 (B-C-1), BC=0.38/1.00 (I-L-1), WS=0.44/1.00 (B-L-1), SS=0.25/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.84 (L) (INPUT = 0.90)
JSI METAL=0.57 (K) (INPUT = 1.00)

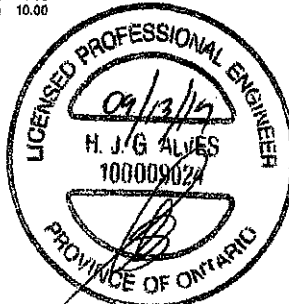


Structural component only
DWG# T-1923491

JOB NAME 405481	TRUSS NAME H4	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO. 16 2019
--------------------	------------------	---------------	----------	-------------------------------	-------------	---------------------

Tamarack Roof Truss, Burlington

Version 8.000 S May 10 2019 M Tek Industries, Inc. Fri Sep 13 12:21:54 2019 Page 1
ID:CGP6tWrw2312cID8UUFYrR8a-XABWdRkgP?c0790U07566XYAt1000U0AK86Aye3DP
13-10 19-103 22-2-10 24-7

1-3-8 0-0 6-9-1 6-9-1 6-9-2 13-3-10 6-9-9 19-10-3 24-7 22-2-10
Scale = 1:51.2

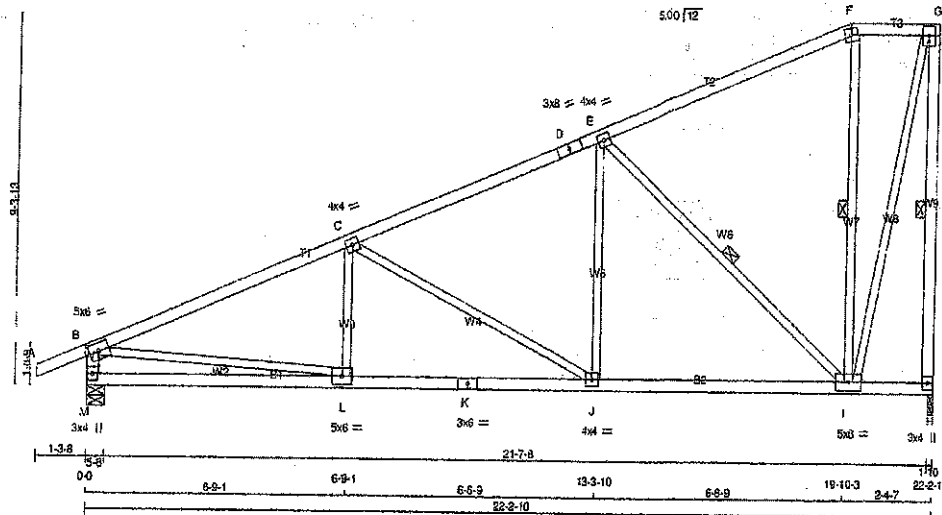

TOTAL WEIGHT = 2 X 105 = 210 lb
[M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - G	2x4	DRY	No.2	SPF	
H - B	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
K - H	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT
DRY: SEASONED LUMBER.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORZ	UPLIFT
H	1339	0	1339	0
M	1476	0	1476	0

UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
H	942	644 / 0 0 / 0 0 / 0 298 / 0 0 / 0
M	1037	723 / 0 0 / 0 0 / 0 314 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURUN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, E-F, F-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	MAX. FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	LCI MAX (LBS)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	0 / 28	-102.0	-102.0 0.13 (1)	10.00	L-C -79 / 88 0.03 (4)
B-C	-2042 / 0	-102.0	-102.0 0.05 (1)	3.99	C-J -787 / 0 0.87 (1)
C-D	-1318 / 0	-102.0	-102.0 0.50 (1)	5.00	J-E 0 / 505 0.11 (1)
D-E	-1318 / 0	-102.0	-102.0 0.50 (1)	5.00	E-I -1252 / 0 0.73 (1)
E-F	-350 / 0	-102.0	-102.0 0.51 (1)	6.25	F-G -261 / 0 0.15 (1)
F-G	-304 / 0	-102.0	-102.0 0.07 (1)	8.25	G-H 0 / 1249 0.28 (1)
H-G	-1331 / 0	0.0	0.0 0.54 (1)	5.62	B-L 0 / 1920 0.43 (1)
M-B	-1423 / 0	0.0	0.0 0.14 (1)	8.84	
M-L	0 / 0	-18.5	-18.5 0.18 (4)	10.00	
L-K	0 / 1908	-18.5	-18.5 0.40 (1)	10.00	
K-J	0 / 1908	-18.5	-18.5 0.40 (1)	10.00	
J-I	0 / 1217	-18.5	-18.5 0.29 (1)	10.00	
I-H	0 / 0	-18.5	-18.5 0.11 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OGC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56% OF 97.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.74")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.74")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.65/1.00 (B-C-1), BC=0.40/1.00 (J-L-1),
WB=0.87/1.00 (C-J-1), SS=0.29/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 755 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.86 (G) (INPUT = 0.90)
JSI METAL = 0.53 (K) (INPUT = 1.00)




Structural component only
DWG# T-1923492

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
405481	H5	22	1	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.300 3 May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:21:58 2019 Page 1
ID:CGPEtWIRwz3f2cdD6UJHfYR8a-?MiuVzS9Rj7TQdDHC8EdJn6Y2DKHpd2q3ledye3DC
14-8-15 22-2-10

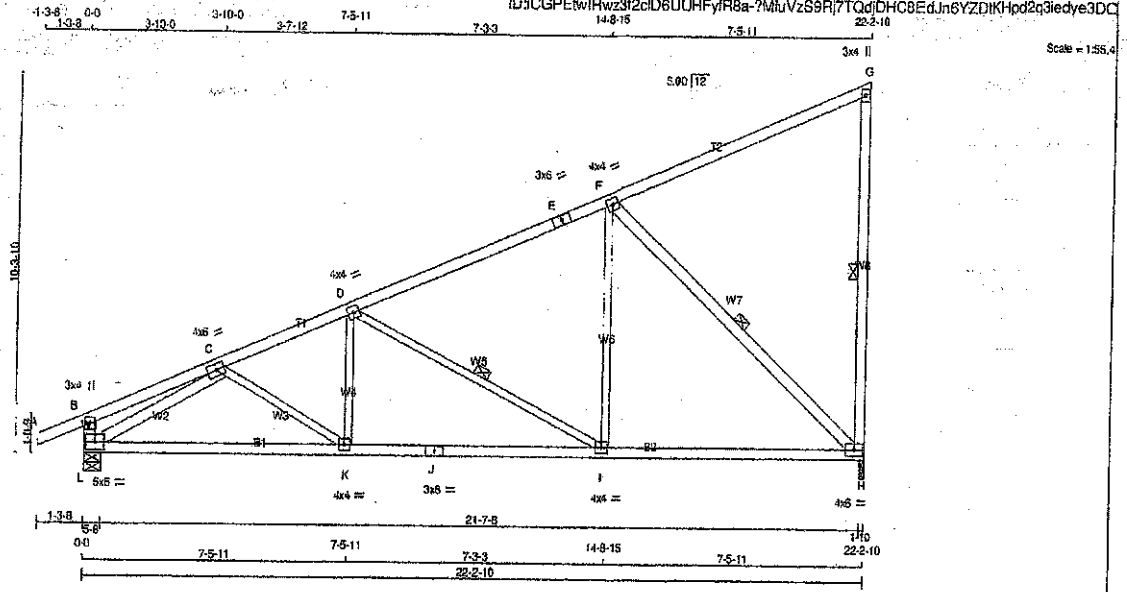

Scale = 1/8" = 1'-0"

TOTAL WEIGHT = 22 X 100 = 2200 LB

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
H - J	2x4	DRY	No.2
L - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
F - H	2x4	DRY	No.2
L - C	2x4	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
	FACTORED	MAXIMUM FACTORED	INPUT	REQD			
	GROSS REACTION	GROSS REACTION	BRG	BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	1338	0	1338	0	0	1-10	1-10
L	1476	0	1476	0	0	5-8	5-8

UNFACTORED REACTIONS							
1ST CASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL	
JT	COMBINED						
H	842	644/0	0/0	0/0	0/0	298/0	0/0
L	1037	723/0	0/0	0/0	0/0	314/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.50 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, D-I, F-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. MAX. UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	0/28	-102.0	-102.0 0.13 (1)	10.00	K-D	0/142	0.05 (4)
B-C	0/8	-102.0	-102.0 0.20 (1)	10.00	D-I	-841/0	0.39 (1)
C-D	-1944/0	-102.0	-102.0 0.33 (1)	4.50	I-F	0/548	0.12 (1)
D-E	-1140/0	-102.0	-102.0 0.59 (1)	4.86	F-H	-1454/0	0.76 (1)
E-F	-1140/0	-102.0	-102.0 0.59 (1)	4.86	C-K	0/54	0.02 (4)
F-G	-32/0	-102.0	-102.0 0.70 (1)	6.25	L-C	-2122/0	0.50 (1)
G-H	-298/0	0.0	0.0 0.16 (1)	6.25			
H-I	-308/0	0.0	0.0 0.03 (1)	7.81			
L-K	0/1806	-18.5	-18.5 0.42 (1)	10.00			
K-J	0/1812	-18.5	-18.5 0.43 (1)	10.00			
J-I	0/1812	-18.5	-18.5 0.43 (1)	10.00			
I-H	0/1069	-18.5	-18.5 0.32 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. G/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, OBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.74")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.07")
ALLOWABLE DEFL.(TL) = 1/360 (0.74")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.15")

CSI: TC=0.70/1.00 (F-G:1), BC=0.43/1.00 (I-K:1), WB=0.78/1.00 (F-H:1), SH=0.33/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1997 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (F) (INPUT = 0.90)
JSI METAL= 0.57 (J) (INPUT = 1.00)



Structural component only
DWG# T-1923493

JOB NAME 405481	TRUSS NAME H7	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.300 5 May 10 2019 Mitek Industries, Inc. R1 Sep 13 12:21:58 2019 Page 1 ID:CGPEHwRwz3f2dD6UHFyR8a-TYJGUtnC0FK2niPvTAXKP2zcl3sQnHUpFA3ya3DP		

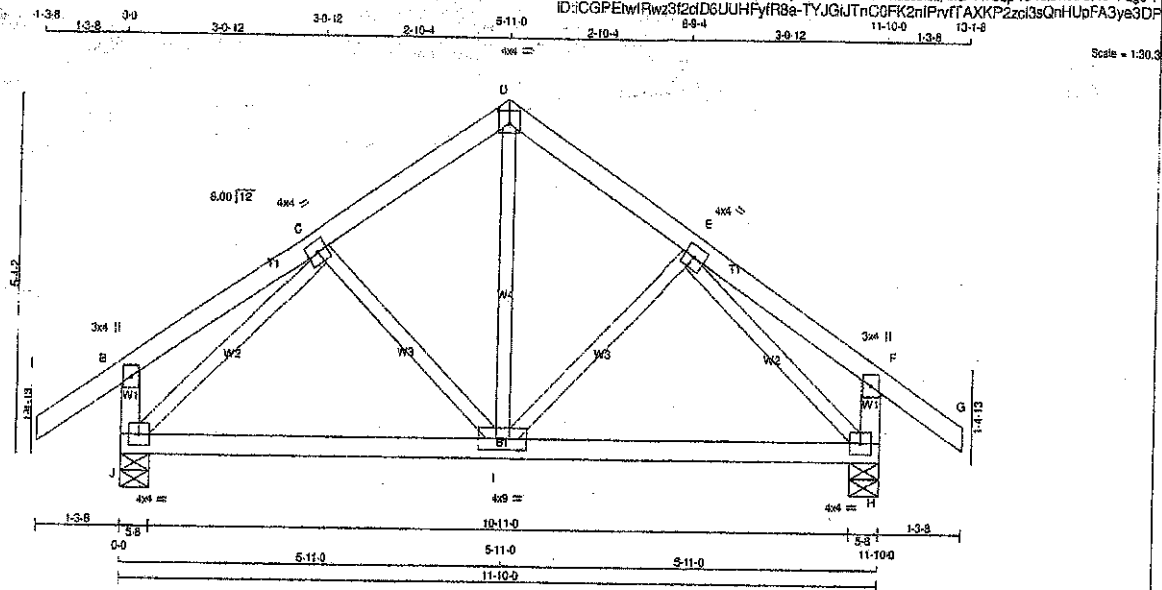

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
J - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMV+p	MT20	3.0	4.0	
C TMVW-1	MT20	4.0	4.0	
D TTW-p	MT20	4.0	4.0	2.25 2.00
E TMVW-1	MT20	4.0	4.0	
F TMV+p	MT20	3.0	4.0	
H BMVW-1	MT20	4.0	4.0	
I BMVW-1	MT20	4.0	9.0	
J BMVW-1	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	SNOW	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
JT	853	0	853	0	0
H	853	0	853	0	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM	LIVE
J	598	423 / 0	0 / 0	0 / 0	175 / 0
H	598	423 / 0	0 / 0	0 / 0	175 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1	MEMB.	MAX. FACTORED	FACTORED	VERT. LOAD LC1
FR-TO	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLP) CSI (LC)	FR-TO	FORCE (LBS)	VERT. LOAD LC1	MAX. (PLP) CSI (LC)
A-B	0 / 38	-102.0	-102.0 0.14 (1)	I-D	0 / 342	0.08 (1)	0.08 (1)
B-C	0 / 18	-102.0	-102.0 0.14 (1)	I-E	-145 / 0	0.04 (1)	0.04 (1)
C-D	-540 / 0	-102.0	-102.0 0.11 (1)	C-I	-145 / 0	0.04 (1)	0.04 (1)
D-E	-540 / 0	-102.0	-102.0 0.11 (1)	J-C	-770 / 0	0.22 (1)	0.22 (1)
E-F	0 / 18	-102.0	-102.0 0.14 (1)	E-H	-770 / 0	0.22 (1)	0.22 (1)
F-G	0 / 38	-102.0	-102.0 0.14 (1)				
J-B	-257 / 0	0.0	0.0 0.03 (1)				
H-F	-257 / 0	0.0	0.0 0.03 (1)				
J-I	0 / 536	-18.5	-18.5 0.22 (4)				
I-H	0 / 536	-18.5	-18.5 0.22 (4)				

TOTAL WEIGHT = 6 X 52 = 312 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	= 28.0	PSF
	DL	= 6.0	PSF
BOT CH.	LL	= 0.0	PSF
	DL	= 7.4	PSF
TOTAL LOAD		= 42.4	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")
CSI: TC=0.14/1.00 (A-B:1), SC=0.22/1.00 (I-J:4),
WB=0.22/1.00 (C-J:1), SS=0.12/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PLI)
MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP=0.70 (C) (INPUT = 0.90)
JSI METAL=0.27 (B) (INPUT = 1.00)



Structural component only
DWG# T-1923494

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
405515	H7A	4	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.300 S May 10 2019 MTEK Industries, Inc. Fri Sep 13 15:16:46 2019 Page 1
ID:08dJueNb1pNAXNn9U7SyyCEPz-K19wKCCQon4uwY1EVM?SPKfn29ZpEU7YpSWuLM2ye0fV

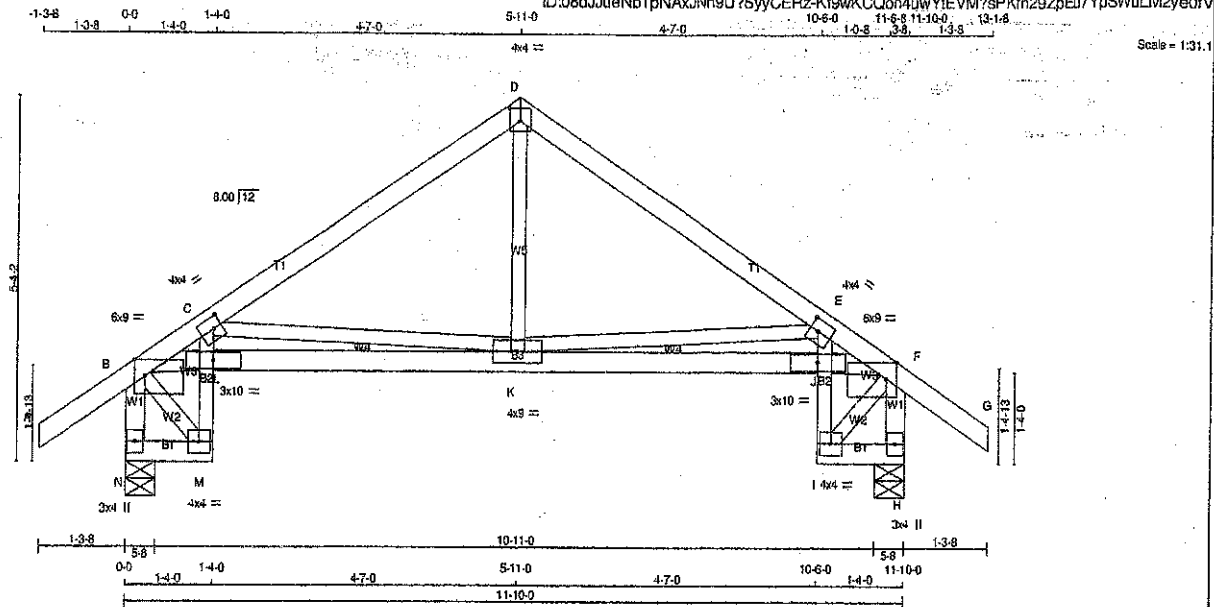

TOTAL WEIGHT = 4 X 52 = 210 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
N - B	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
N - M	2x4	DRY	No.2	SPF
M - C	2x3	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
J - E	2x3	DRY	No.2	SPF
I - H	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
B - L	2x4	DRY	No.2	SPF
J - F	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVWW-p	MT20	6.0	9.0	Edge	2.00
C	TMVW-i	MT20	4.0	4.0	2.00	1.50
D	TTW-p	MT20	4.0	4.0	2.25	3.00
E	TMVW-i	MT20	4.0	4.0	2.00	1.50
F	TMVWW-p	MT20	6.0	9.0	Edge	2.00
H	BMV-i+p	MT20	3.0	4.0		
I	BMVW-i	MT20	4.0	4.0		
J	BMVW-i	MT20	3.0	10.0		
K	BMVWW-i	MT20	4.0	9.0		
L	BMVW-i	MT20	3.0	10.0		
M	BMVW-i	MT20	4.0	4.0		
N	BMV-i+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
		GROSS REACTION		GROSS REACTION		BRG		BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX	IN-SX
N	853	0	853	0	0	5-8	5-8		
H	853	0	853	0	0	5-8	5-8		

UNFACTORED REACTIONS

JT	1ST CASE	MAX	MIN	COMPONENT REACTIONS
N	598	423 / 0	0 / 0	0 / 0
H	598	423 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.04 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MEMB.	FORCE (LBS)	LC1 MAX	LC1
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 39	-102.0	-102.0	0.14 (1)	10.00	K-D	0 / 321
B-C	-1632 / 0	-102.0	-102.0	0.16 (1)	5.04	K-E	-886 / 0
C-D	-687 / 0	-102.0	-102.0	0.30 (1)	6.25	C-K	-886 / 0
D-E	-687 / 0	-102.0	-102.0	0.30 (1)	6.25	B-M	0 / 40
E-F	-1632 / 0	-102.0	-102.0	0.16 (1)	5.04	B-L	0 / 1368
F-G	0 / 39	-102.0	-102.0	0.14 (1)	10.00	I-F	0 / 39
N-B	-842 / 0	0.0	0.0	0.09 (1)	7.81	J-F	0 / 1368
H-F	-842 / 0	0.0	0.0	0.09 (1)	7.81		
N-M	0 / 0	-18.5	-18.5	0.01 (4)	10.00		
M-L	-15 / 5	0.0	0.0	0.08 (1)	7.81		
L-C	0 / 294	0.0	0.0	0.17 (1)	10.00		
L-K	0 / 1439	-18.5	-18.5	0.30 (1)	10.00		
K-J	0 / 1439	-18.5	-18.5	0.30 (1)	10.00		
I-J	-15 / 5	0.0	0.0	0.08 (1)	7.81		
J-E	0 / 294	0.0	0.0	0.17 (1)	10.00		
I-H	0 / 0	-18.5	-18.5	0.01 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

(65 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.06")

CSI: TO=0.30/1.00 (C-D-1), BC=0.30/1.00 (K-L-1), WB=0.34/1.00 (C-K-1), SSI=0.17/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.73 (E) (INPUT = 0.90)
JSI METAL = 0.41 (L) (INPUT = 1.00)

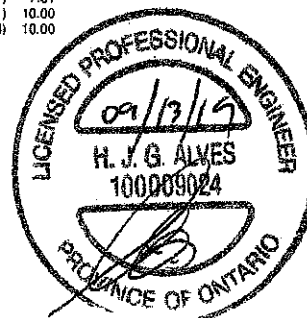


Structural component only
DWG# T-1923566

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
405481	H8	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.300 5 May 10 2019 MTEK Industries, Inc. Fri Sep 13 12:21:58 2019 Page 1
ID:ICGPEIwRwz3f2dD6UUhFyIR6a-FxQ077V2jeW2H5SoyKhxYFpCnG3XU3k0lMFxe3DN
15-11-5 22-0-2
Scale = 1:35.2

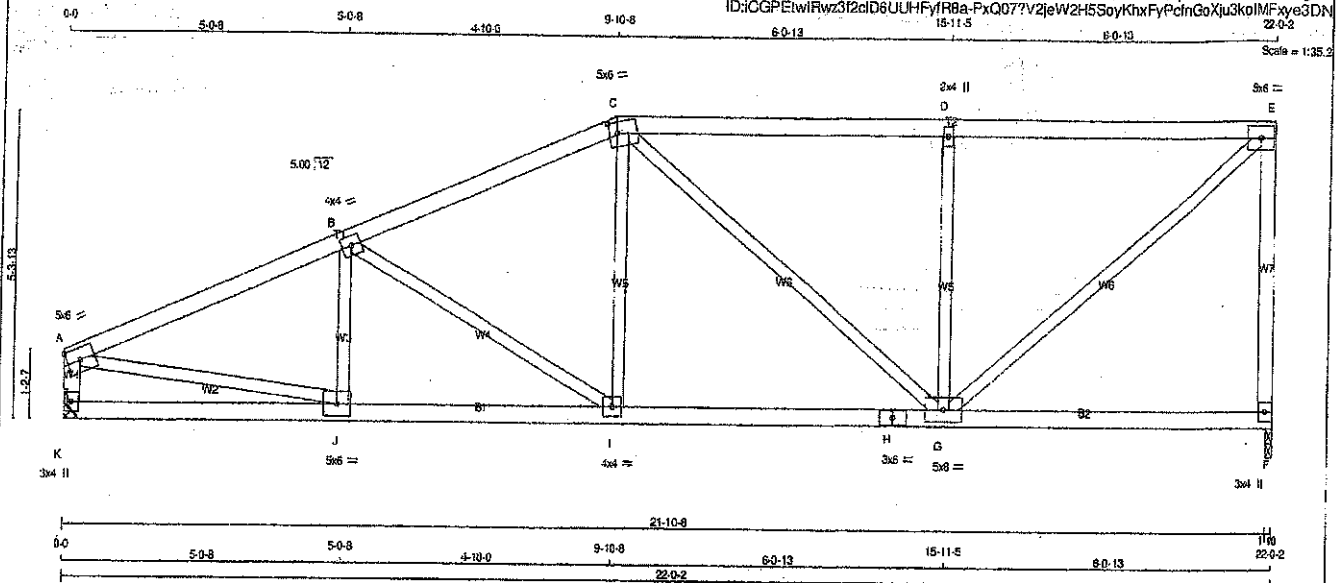

TOTAL WEIGHT = 2 X 88 = 176 lb

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
F - H	2x4 DRY	No.2	SPF
K - H	2x4 DRY	No.2	SPF
H - F	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			

DRY: SEASONED LUMBER

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-1	MT20	5.0	6.0		Edge
B	TMVW-1	MT20	4.0	4.0		
C	TTWV-m	MT20	5.0	6.0	2.25	1.75
D	TMVW-w	MT20	2.0	4.0		
E	TMVW-1	MT20	5.0	6.0		
F	BMV1-p	MT20	3.0	4.0		
G	BMVW-1	MT20	5.0	6.0		
H	BS-1	MT20	3.0	6.0		
I	BMVW-1	MT20	4.0	4.0		
J	BMVW-1	MT20	5.0	6.0		
K	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UP	IN-SX
F	1326	0	0	1-10
K	1326	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	933	638 / 0	0 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0
K	933	638 / 0	0 / 0	0 / 0	0 / 0	0 / 0	235 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.27 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC: MAX (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-1950 / 0	-102.0 -102.0	0.49 (1)	4.27	J-B	-232 / 12	0.05 (1)
B-C	-1584 / 0	-102.0 -102.0	0.46 (1)	4.88	B-I	-444 / 0	0.25 (1)
C-D	-1287 / 0	-102.0 -102.0	0.70 (1)	4.60	I-C	0 / 332	0.07 (1)
D-E	-1287 / 0	-102.0 -102.0	0.71 (1)	4.60	C-G	-235 / 0	0.29 (1)
F-E	-1280 / 0	0.0 0.0	0.63 (1)	7.13	G-D	-767 / 0	0.32 (1)
K-A	-1284 / 0	0.0 0.0	0.13 (1)	7.11	G-E	0 / 1841	0.37 (1)
					A-J	0 / 1848	0.42 (1)
K-J	0 / 0	-18.5 -18.5	0.09 (4)	10.00			
J-I	0 / 1820	-18.5 -18.5	0.35 (1)	10.00			
I-H	0 / 1448	-18.5 -18.5	0.31 (1)	10.00			
H-G	0 / 1448	-18.5 -18.5	0.31 (1)	10.00			
G-F	0 / 0	-18.5 -18.5	0.17 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 8, NBC 2010, NBC 2015

THIS DESIGN COMPLES WITH:
- PART 9 OF CBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = 1/999 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = 1/999 (0.12")

CSI: TC=0.71/1.00 (D-E-1), BC=0.35/1.00 (I-J-1),
WB=0.42/1.00 (A-J-1), SS=0.30/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (G) (INPUT = 0.80)
JSI METAL = 0.50 (A) (INPUT = 1.00)

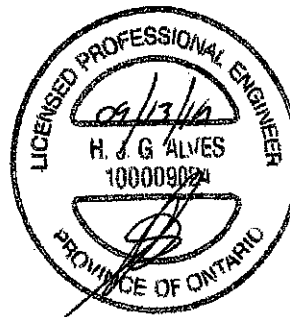

Structural component only
DWG# T-1923496

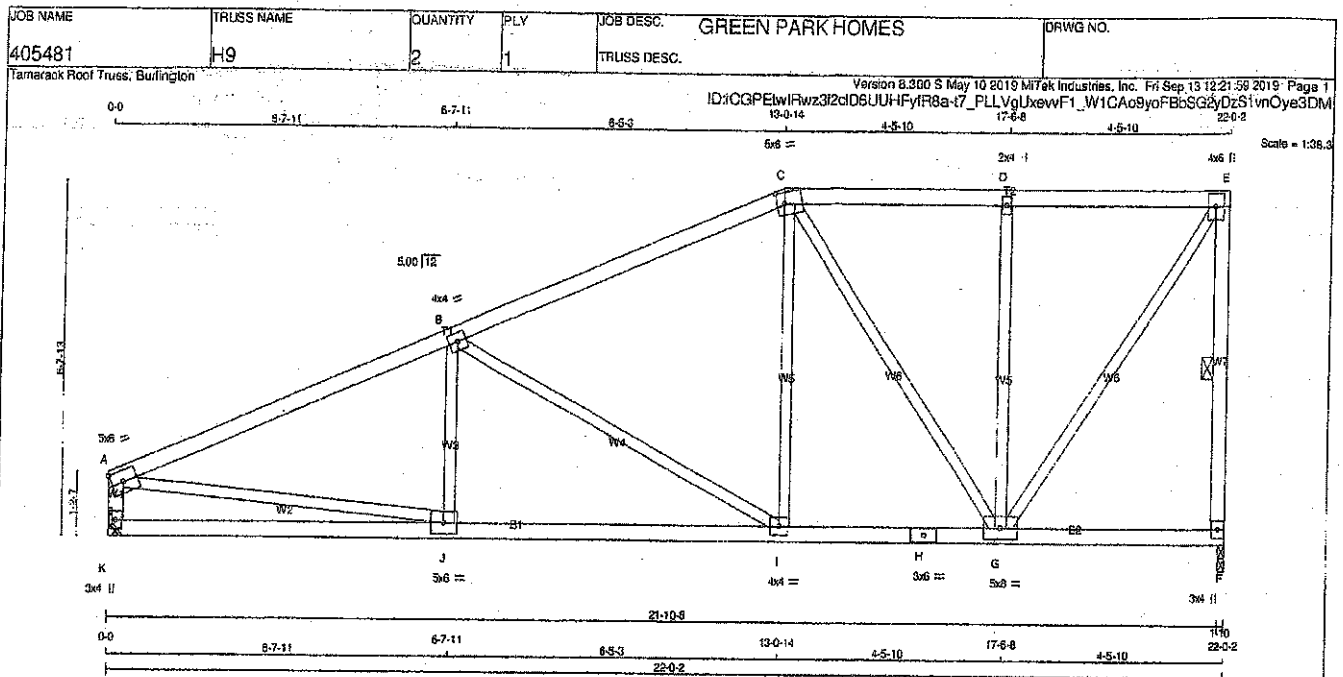

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
K - A	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-I	MT20	5.0	6.0		Edge
B	TMVW-I	MT20	4.0	4.0		
C	TTWW-in	MT20	5.0	6.0	2.50	1.75
D	TMVW-w	MT20	2.0	4.0		
E	TMVW-p	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-I	MT20	5.0	8.0		
H	GS-I	MT20	3.0	5.0		
I	BMVW-I	MT20	4.0	4.0		
J	BMVW-I	MT20	5.0	6.0		
K	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	1326	0	1326	0
K	1326	0	1326	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 3-8.

UNFACTORED REACTIONS

1ST CASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	933	638 / 0	0 / 0	0 / 0	0 / 0	285 / 0	0 / 0
K	933	638 / 0	0 / 0	0 / 0	0 / 0	285 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MAX. FACTORED		FACTORED		MAX. UNBRACED LENGTH	MAX. FACTORED		MAX. CSI (L/C)		
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (L/C)		MEMB.	FORCE (LBS)			
FR-TO		FROM	TO	FR-TO					
A-B	-1661 / 0	-102.0	-102.0	0.65 (1)	4.03	J-B	-114 / 80	0.03 (1)	
B-C	-1232 / 0	-102.0	-102.0	0.58 (1)	4.96	B-I	-837 / 0	0.84 (1)	
C-D	-789 / 0	-102.0	-102.0	0.26 (1)	8.25	I-C	0 / 512	0.12 (1)	
D-E	-790 / 0	-102.0	-102.0	0.26 (1)	8.25	C-G	-571 / 0	0.68 (1)	
E-F	-1290 / 0	0.0	0.0	0.28 (1)	5.68	G-D	-983 / 0	0.41 (1)	
K-A	-1275 / 0	0.0	0.0	0.13 (1)	7.13	D-E	0 / 1385	0.31 (1)	
						A-J	0 / 1855	0.42 (1)	
K-J	0 / 0	-18.5	-18.5	0.19 (4)	10.00				
J-I	0 / 1838	-18.5	-18.5	0.38 (1)	10.00				
I-H	0 / 1116	-18.5	-18.5	0.24 (1)	10.00				
H-G	0 / 1116	-18.5	-18.5	0.24 (1)	10.00				
G-F	0 / 0	-18.5	-18.5	0.08 (4)	10.00				

TOTAL WEIGHT = 2 X 95 = 190 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012
- CSA 086-03, CSA 085-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.73")
CALCULATED VERT. DEFL. (LL) = L/999 (0.07")
ALLOWABLE DEFL. (TL) = L/360 (0.73")
CALCULATED VERT. DEFL. (TL) = L/999 (0.14")

CSI: TC=0.65/1.00 (A-B:1), BC=0.38/1.00 (I-J:1), WB=0.94/1.00 (B-I:1), SS=0.30/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1067 788 1987 1556


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.83 (G) (INPUT = 0.90)
JSI METAL = 0.51 (A) (INPUT = 1.00)

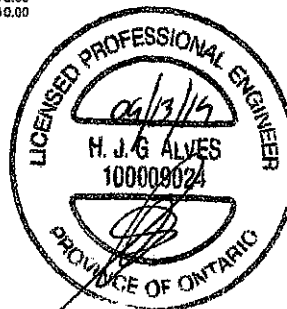

Structural component only
DWG# T-1923497

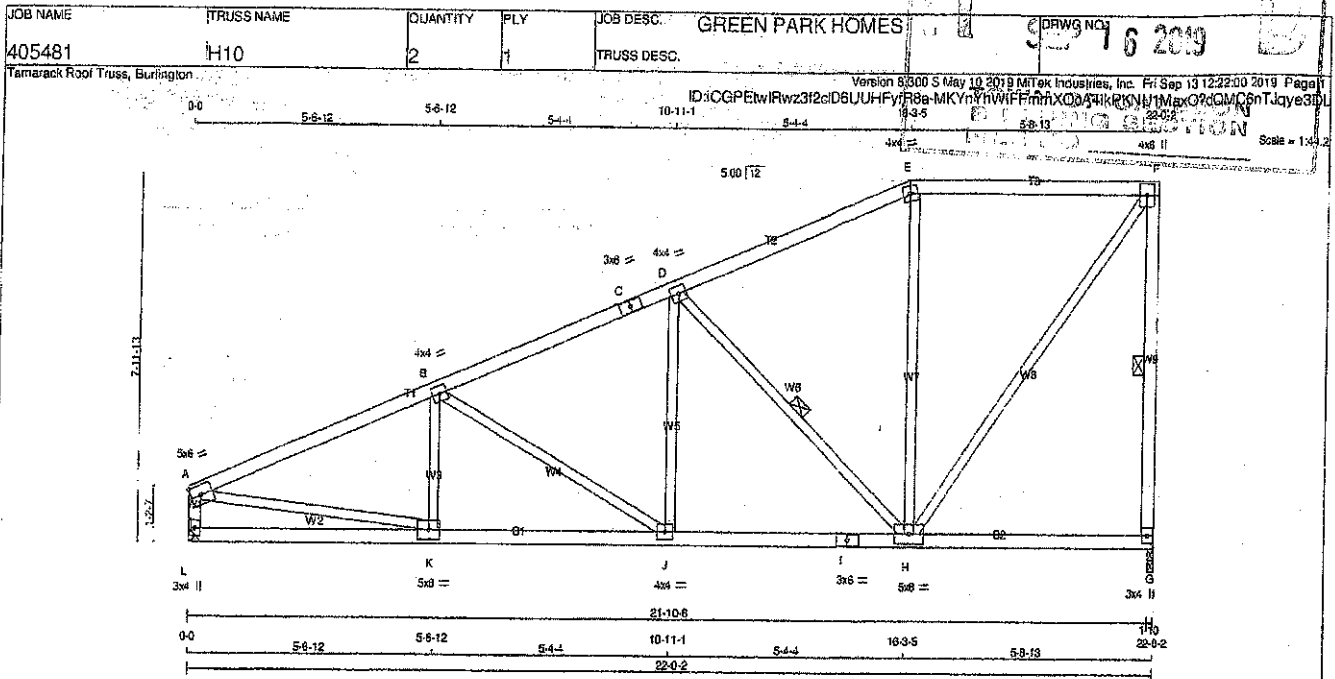

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - F	2x4	DRY	No.2
G - A	2x4	DRY	No.2
L - 1	2x4	DRY	No.2
I - G	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATE TYPE	PLATES	W	LEN	Y	X
A - TMW-I	MT20	5.0	6.0		Edge
B - TMW-W-I	MT20	4.0	4.0		
C - TS-I	MT20	3.0	6.0		
D - TMW-W-I	MT20	4.0	4.0		
E - TTW-m	MT20	4.0	4.0		
F - TMW-p	MT20	4.0	6.0		
G - BMV1-p	MT20	3.0	4.0		
H - BMW-W-I	MT20	5.0	6.0		
I - BS-I	MT20	3.0	6.0		
J - BMW-W-I	MT20	4.0	4.0		
K - BMW-W-I	MT20	5.0	6.0		
L - BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
G	1326	0	1326	0
L	1326	0	1326	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT L. MINIMUM BEARING LENGTH AT JOINT L = 3'-8\"/>

UNFACTORED REACTIONS

1ST CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	933	638 / 0	0 / 0	0 / 0	0 / 0	295 / 0	0 / 0
L	933	638 / 0	0 / 0	0 / 0	0 / 0	295 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.40 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS			FACTORED			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LCI	MAX (LBS)	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX (LBS)
FR-TO		FROM	TO	OSI (LC)	UNSTRAC LENGTH	FR-TO		OSI (LC)
A-B	-1945 / 0	-102.0	-102.0	0.42 (1)	4.40	K-B	-185 / 36	0.04 (1)
B-C	-1515 / 0	-102.0	-102.0	0.34 (1)	4.97	B-J	-405 / 0	0.34 (1)
C-D	-1515 / 0	-102.0	-102.0	0.34 (1)	4.97	J-D	0 / 345	0.08 (1)
D-E	-911 / 0	-102.0	-102.0	0.34 (1)	6.25	D-H	-845 / 0	0.38 (1)
E-F	-726 / 0	-102.0	-102.0	0.44 (1)	6.25	H-E	-208 / 13	0.28 (1)
G-F	-1284 / 0	0.0	0.0	0.37 (1)	5.69	F-F	0 / 1230	0.28 (1)
L-A	-1281 / 0	0.0	0.0	0.13 (1)	7.13	A-K	0 / 1837	0.41 (1)
L-K	0 / 0	-18.5	-18.5	0.12 (4)	10.00			
K-J	0 / 1814	-18.5	-18.5	0.34 (1)	10.00			
J-I	0 / 1368	-18.5	-18.5	0.30 (1)	10.00			
I-H	0 / 1398	-18.5	-18.5	0.30 (1)	10.00			
H-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.1 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.73")
CALCULATED VERT. DEFL.(LL) = L/998 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.73")
CALCULATED VERT. DEFL.(TL) = L/998 (0.13")

CSI: TC=0.44/1.00 (E-F:1), BC=0.34/1.00 (J-K:1), WB=0.41/1.00 (A-K:1), SSI=0.24/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 738 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.82 (K) (INPUT = 0.90)
JSI METAL = 0.50 (A) (INPUT = 1.00)

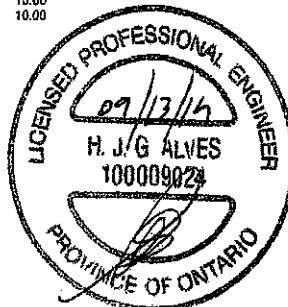


Structural component only
DWG# T-1923498

JOB NAME 405481	TRUSS NAME H11	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.300.5 May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:22:01 2019 Page 1

ID:CGPEWIRWz3f2cD6UJHFYfR8a-qW69m0XW0Zud8YBMd3SFela18k_GakzaWQmW0sGye3DK

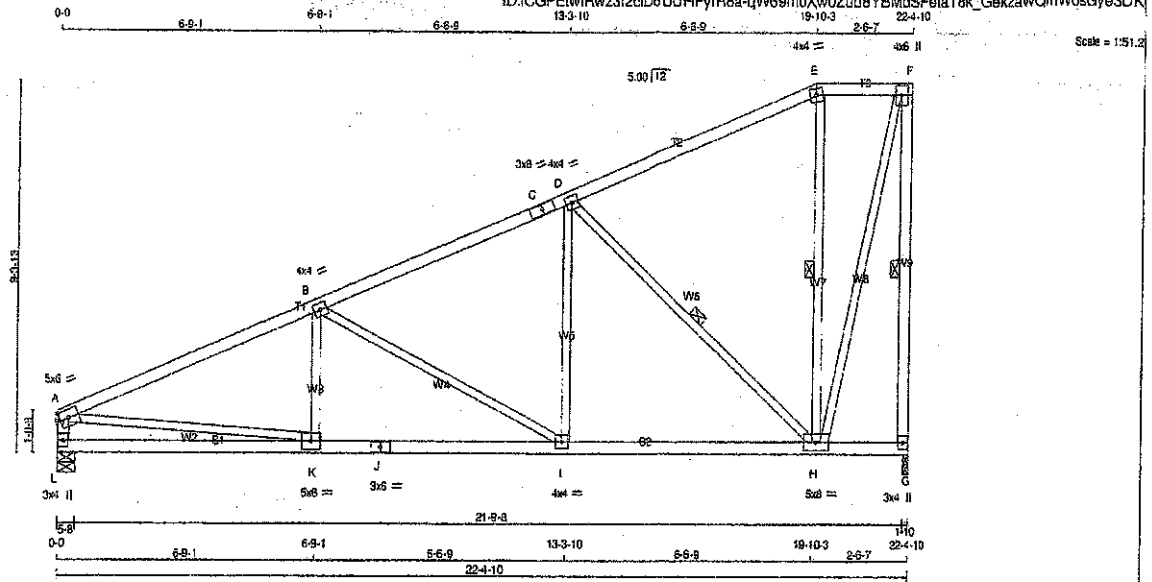

TOTAL WEIGHT = 2 X 104 = 208 lb

LUMBER	N. L. G. A. RULES	SIZE	CHORDS	DRY	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
G - F	2x4	DRY	No.2	SPF	
L - A	2x4	DRY	No.2	SPF	
L - J	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT
DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
A - TMVW-1	MT20	5.0	6.0			Edge
B - TMVW-1	MT20	4.0	4.0			
C - TS-1	MT20	3.0	8.0			
D - TMVW-1	MT20	4.0	4.0			
E - TTW-m	MT20	4.0	4.0			
F - TMVW-p	MT20	4.0	6.0			
G - BMV1-p	MT20	3.0	4.0			
H - BMVW-1	MT20	5.0	8.0			
I - BS-1	MT20	4.0	4.0			
J - BS-1	MT20	3.0	6.0			
K - BMVW-1	MT20	5.0	6.0			
L - BMV1-p	MT20	3.0	4.0			

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
G	1349 0	1349 0	0 0	1-10	1-10
L	1349 0	1349 0	0 0	5-8	5-8

UNFACTORED REACTIONS		1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
JT	COMBINED	949	649 0	0 0	0 0	0 0	300 0	0 0
G		949	649 0	0 0	0 0	0 0	300 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.98 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-G, D-H, E-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO	FROM TO	FR-TO	FROM TO
A-B	-2089 / 0	K-B	-81 / 87
B-C	-1341 / 0	B-I	-784 / 0
C-D	-1341 / 0	I-D	0 / 503
D-E	-382 / 0	D-H	-1250 / 0
E-F	-382 / 0	H-E	-281 / 0
F-G	-1340 / 0	H-F	0 / 1254
G-L	-1295 / 0	A-K	0 / 1938
L-K	0 / 0		
K-J	0 / 1927		
J-I	0 / 1927		
I-H	0 / 1258		
H-G	0 / 0		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 10 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(65% OF 37.8 P.S.F. G.S.L. PLUS 3.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.75')
CALCULATED VERT. DEFL.(LL) = L/999 (0.08')
ALLOWABLE DEFL.(TL) = L/360 (0.75')
CALCULATED VERT. DEFL.(TL) = L/999 (0.15')

CSF: TC=0.65/1.00 (A-B:1), BC=0.40/1.00 (I-K:1), WB=0.87/1.00 (B-I:1), SS=0.29/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.59 (J) (INPUT = 1.00)




Structural component only
DWG# T-1923499

JOB NAME 405481	TRUSS NAME H12	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.300 © May 10 2019 MITek Industries, Inc. Fri Sep 13 12:22:02 2019 Page 1

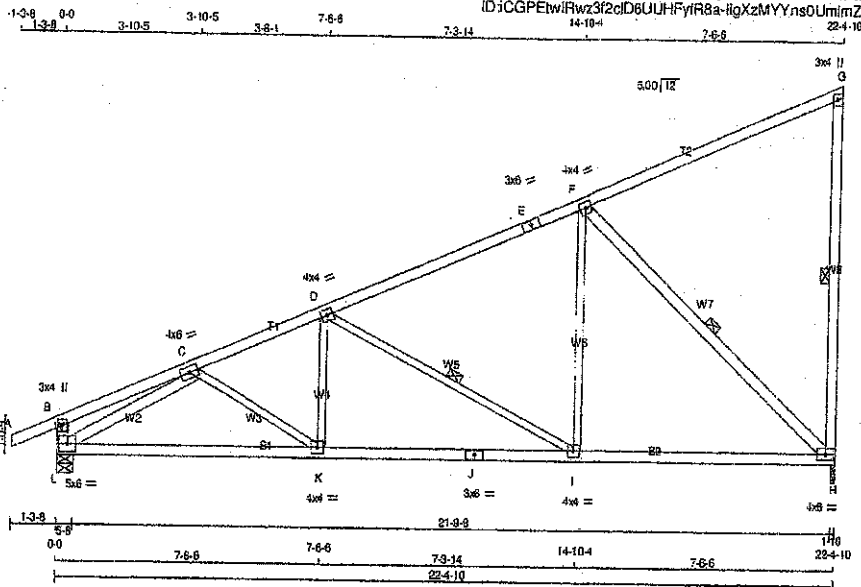

Scale = 1/55.8

TOTAL WEIGHT = 6 X 101 = 605 lb (MIP)

CHORDS	SIZE	LUMBER
A - E	2x4	DRY No.2
E - G	2x4	DRY No.2
H - G	2x4	DRY No.2
L - B	2x4	DRY No.2
L - J	2x4	DRY No.2
J - H	2x4	DRY No.2

ALL WEBS	2x3	DRY	No.2
EXCEPT			
F - H	2x4	DRY	No.2
L - C	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATE TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-1	MT20	4.0	6.0	
D	TMWW-1	MT20	4.0	4.0	
E	TS-1	MT20	3.0	6.0	
F	TMWW-1	MT20	4.0	4.0	
G	TMV+p	MT20	3.0	4.0	
H	BMWW-1	MT20	4.0	6.0	
I	BMWW-1	MT20	4.0	4.0	
J	BS-1	MT20	3.0	6.0	
K	BMWW-1	MT20	4.0	4.0	
L	BMWW-1	MT20	5.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESCR.	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQD
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT		VERT	DOWN	UPLIFT	IN-SX
H		1349	0	0	1-10
L		1486	0	0	5-8

DESCR.	SPF	1ST LCASE	MAX/MIN COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT		949	649 / 0	0 / 0	0 / 0	0 / 0	0 / 0	300 / 0	0 / 0
L		1044	728 / 0	0 / 0	0 / 0	0 / 0	0 / 0	316 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.48 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-H, D-I, F-H.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LCI (LBS)	MAX. CSI (LBS)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LBS)
FR-TO		FROM	TO			FR-TO		
A-B	0 / 26	-102.0	-102.0	0.13 (1)	10.00	K-D	0 / 144	0.05 (4)
B-C	0 / 8	-102.0	-102.0	0.20 (1)	10.00	D-I	-850 / 0	0.40 (1)
C-D	-1962 / 0	-102.0	-102.0	0.34 (1)	4.48	F-F	0 / 551	0.12 (1)
D-E	-1149 / 0	-102.0	-102.0	0.71 (1)	4.81	F-H	-1495 / 0	0.78 (1)
E-F	-1149 / 0	-102.0	-102.0	0.71 (1)	4.81	C-K	0 / 54	0.02 (4)
F-G	-32 / 0	-102.0	-102.0	0.71 (1)	6.25	L-C	-2141 / 0	0.51 (1)
G-H	-300 / 0	0.0	0.0	0.16 (1)	6.25			
H-I	-309 / 0	0.0	0.0	0.03 (1)	7.81			
L-K	0 / 1826	-18.5	-18.5	0.42 (1)	10.00			
K-J	0 / 1829	-18.5	-18.5	0.43 (1)	10.00			
J-I	0 / 1829	-18.5	-18.5	0.43 (1)	10.00			
I-H	0 / 1078	-18.5	-18.5	0.32 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
PART 9 OF NBC 2010, NBC 2012
CSA 086-08, CSA 086-14
TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.75")
CALCULATED VERT. DEFL.(LL) = L/899 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.75")
CALCULATED VERT. DEFL.(TL) = L/999 (0.15")

CSI: TC=0.71/1.00 (F-G:1), BC=0.43/1.00 (I-K:1), WB=0.78/1.00 (F-H:1), SS=0.34/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 738 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (F) (INPUT = 0.90)
JSI METAL = 0.58 (J) (INPUT = 1.00)

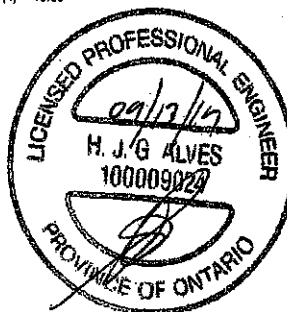

Structural component only
DWG# T-1923500

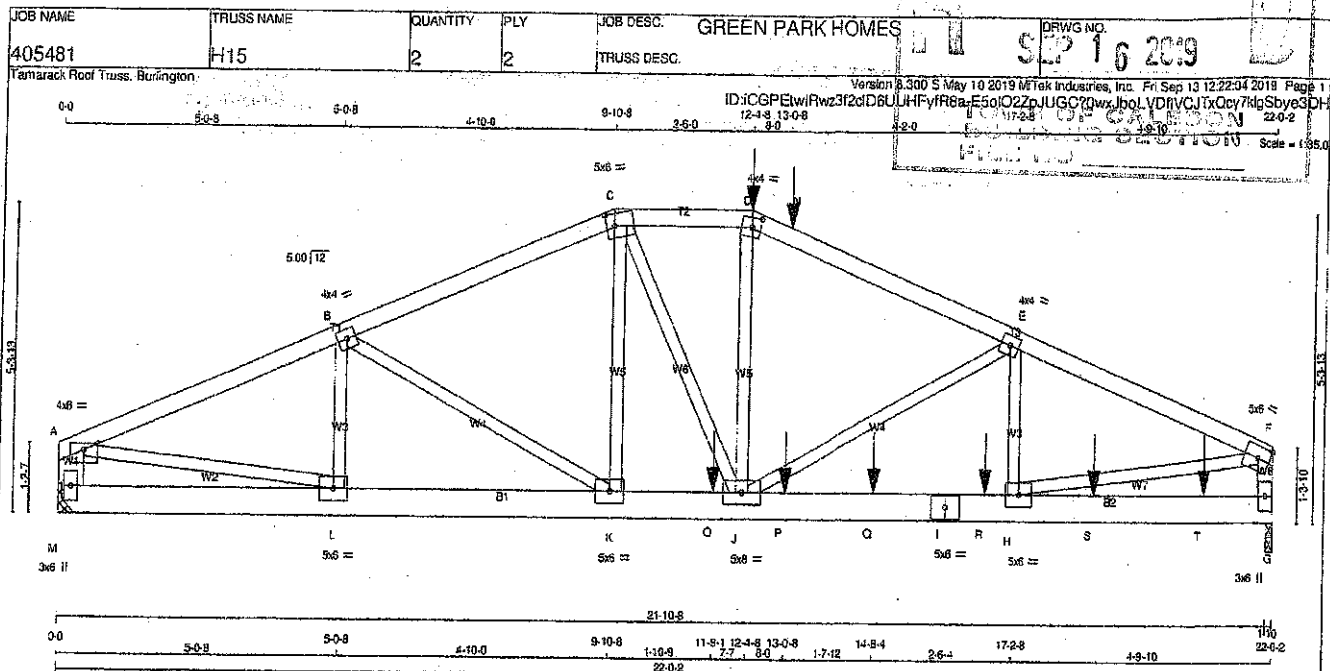

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
M - A	2x6	DRY	No.2	SPF
M - I	2x6	DRY	No.2	SPF
I - G	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1 12	TOP	TOP
C-D 1 12	SIDE(61.0)	SIDE(61.0)
D-F 1 12	TOP	TOP
G-F 1 12	TOP	TOP
M-A 2 12	TOP	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
M-I 2 12	SIDE(0.0)	SIDE(0.0)
I-G 2 12	SIDE(0.0)	SIDE(0.0)
WEBS: (0.122"x3") SPIRAL NAILS		
J-D 1 8	SIDE(96.5)	SIDE(96.5)
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A TMWV-p	MT20	4.0	6.0	Edge	
B TMWV-L	MT20	4.0	4.0		
C TTWV-m	MT20	5.0	6.0	2.50	1.75
D TTW-m	MT20	4.0	4.0	2.00	1.75
E TMWV-L	MT20	4.0	4.0		
F TMWV-L	MT20	5.0	6.0	Edge	
G BMV1+p	MT20	3.0	6.0		
H, K, L					
H BMWV-L	MT20	5.0	5.0		
I BS-L	MT20	5.0	5.0		
J BMWVW-L	MT20	5.0	3.0		
M BMV1+p	MT20	3.0	5.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT VERT	SNOW	DOWN	IN-SX	IN-SX
M	2256 0	2256 0	MECHANICAL	MECHANICAL
G	2527 0	2527 0	1-10	1-10

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT M MINIMUM BEARING LENGTH AT JOINT M = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	1582	1115 / 0	0 / 0	0 / 0	0 / 0	467 / 0	0 / 0
G	1777	1224 / 0	0 / 0	0 / 0	0 / 0	553 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.47 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO				FR-TO			
A-B	-3688 / 0	-102.0 -102.0 0.28 (1)	4.64	L-B	-534 / 0	0.05 (1)	
B-C	-3643 / 0	-102.0 -102.0 0.28 (1)	4.65	B-K	-98 / 0	0.03 (1)	
C-D	-3884 / 0	-102.0 -102.0 0.30 (1)	4.47	K-C	0 / 389	0.05 (1)	
D-N	-3889 / 0	-102.0 -102.0 0.30 (1)	4.47	C-J	0 / 787	0.09 (1)	
N-E	-3889 / 0	-102.0 -102.0 0.30 (1)	4.47	J-D	0 / 787	0.09 (1)	
E-F	-3884 / 0	-102.0 -102.0 0.30 (1)	4.48	D-E	-82 / 0	0.03 (4)	
G-F	-2493 / 0	0.0 0.0 0.13 (1)	7.23	H-E	-610 / 0	0.08 (1)	
M-A	-2184 / 0	0.0 0.0 0.08 (1)	7.81	H-F	0 / 3765	0.47 (1)	
				A-L	0 / 3468	0.43 (1)	
M-L	0 / 0	-18.5 -18.5 0.05 (1)	10.00				
L-K	0 / 3423	-18.5 -18.5 0.27 (1)	10.00				
K-O	0 / 3349	-18.5 -18.5 0.38 (1)	10.00				
O-J	0 / 3349	-18.5 -18.5 0.38 (1)	10.00				
J-P	0 / 3698	-18.5 -18.5 0.29 (1)	10.00				
P-Q	0 / 3698	-18.5 -18.5 0.29 (1)	10.00				
Q-I	0 / 3698	-18.5 -18.5 0.29 (1)	10.00				
I-R	0 / 3698	-18.5 -18.5 0.29 (1)	10.00				
R-H	0 / 3698	-18.5 -18.5 0.29 (1)	10.00				
H-S	0 / 0	-18.5 -18.5 0.08 (1)	10.00				
S-T	0 / 0	-18.5 -18.5 0.08 (1)	10.00				
T-G	0 / 0	-18.5 -18.5 0.06 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC	LC1	MAX.	MAX+	FACE	DIR.	TYPE	MIN.
O	12-4-8	-125	-140	--	FRONT	VERT	DEAD	C1
D	12-4-8	-713	-713	--	FRONT	VERT	SNOW	C1
N	13-0-8	-140	-140	--	FRONT	VERT	TOTAL	C1
O	11-8-1	-1018	-1018	--	FRONT	VERT	TOTAL	C1
P	13-0-8	-27	-27	--	FRONT	VERT	TOTAL	C1
Q	14-8-4	-27	-27	--	FRONT	VERT	TOTAL	C1
R	18-8-4	-27	-27	--	FRONT	VERT	TOTAL	C1
S	18-8-4	-27	-27	--	FRONT	VERT	TOTAL	C1
T	20-8-4	-27	-27	--	FRONT	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL = 29.0 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD = 42.4 PSF	

SPACING = 24.0 IN. CC

LOADING IN PLAT SECTION BASED ON A SLOPE OF 8.00/12

*** NON STANDARD GIRDER ***

ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.73")

CALCULATED VERT. DEFL.(LL) = L/999 (0.07")

ALLOWABLE DEFL.(TL) = L/360 (0.73")

CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.30/1.00 (D-E:1), BC=0.33/1.00 (J-K:1), WB=0.47/1.00 (F-H:1), SS=0.27/1.00 (J-K:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)		SHEAR		SECTION	
	(PSI)		(PL)		(PL)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (A) (INPUT = 0.90)

JSI METAL = 0.50 (F) (INPUT = 1.00)

Structural component only

DWG# T-1923502

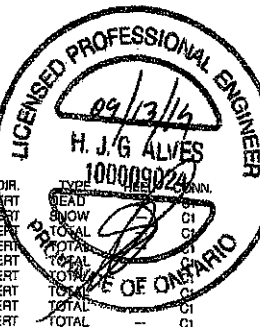


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
405481	H19	12	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.900 S May 10 2019 Mitak Industries, Inc. Fri Sep 13 12:22:07 2019 Page 1

ID:CGPEtWIRwz312cd6SUHFyR8a-egTQ04choPemsTeW_IM26rHCXPLbsh6OpizL3wye3DE

Scale = 1/32"

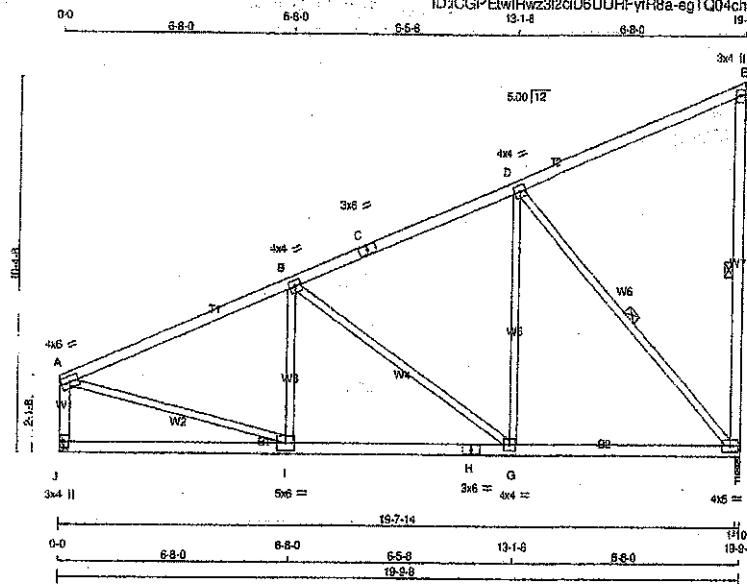

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2	
C - E	2x4	DRY	No.2	
F - E	2x4	DRY	No.2	
J - A	2x4	DRY	No.2	
J - H	2x4	DRY	No.2	
H - F	2x4	DRY	No.2	

ALL WEBS 2x3 DRY No.2 EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT	TYPE	PLATES	W	LEN	Y	X
A - TMWW-1	MT20	4.0	6.0				
B - TMWW-1	MT20	4.0	4.0				
C - TS-1	MT20	3.0	6.0				
D - TMWW-1	MT20	4.0	4.0				
E - TMWW-1	MT20	3.0	4.0				
F - BMWW-1	MT20	4.0	6.0				
G - BMWW-1	MT20	4.0	4.0				
H - BS-1	MT20	3.0	6.0				
I - BMWW-1	MT20	5.0	6.0				
J - BMWW-1	MT20	3.0	4.0				

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG
SPF	VERT	DOWN	HORZ	UPLIFT
SPF	1193	0	1193	0
SPF	1193	0	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX	MIN	COMPONENT REACTIONS	DEAD	SOIL
SPF	839	574	0	0	0	0
SPF	839	574	0	0	0	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.85 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-F, D-F.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				W E B S			
MEMB.	MAX. FACTORED	FACTORED	MAX.	MAX.	MEMB.	MAX. FACTORED	MAX.
	FORCE	VERT. LOAD	CS1 (LC)	UNBRAC		FORCE	CS1 (LC)
FR-TO	(LBS)	FROM TO	LENGTH	FR-TO	(LBS)		
A-B	-1333 / 0	-102.0	0.57 (1)	4.55	I-B	-213 / 42	0.08 (1)
B-C	-859 / 0	-102.0	0.48 (1)	5.30	B-G	-584 / 0	0.74 (1)
C-D	-859 / 0	-102.0	0.48 (1)	5.30	C-D	0 / 461	0.10 (1)
D-E	-25 / 0	-102.0	0.52 (1)	6.25	D-F	-1176 / 0	0.80 (1)
E-F	-274 / 0	0.0	0.13 (1)	6.25	A-I	0 / 1299	0.29 (1)
J-A	-1141 / 0	0.0	0.13 (1)	7.44			
J-I	0 / 0	-18.5	-18.5 0.18 (4)	10.00			
I-H	0 / 1253	-18.5	-18.5 0.30 (1)	10.00			
H-G	0 / 1253	-18.5	-18.5 0.30 (1)	10.00			
G-F	0 / 794	-18.5	-18.5 0.25 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OSC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.66")
CALCULATED VERT. DEFL.(LL) = L/998 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.66")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CS1: TC=0.57/1.00 (A-B:1), GC=0.30/1.00 (G-I:1),
WB=0.80/1.00 (D-F:1), SS=0.29/1.00 (D-E:1)

DOL LUMBER=1.00 NAL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 789 1987 1655


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.74 (D) (INPUT = 0.50)
JSI METAL= 0.39 (H) (INPUT = 1.00)

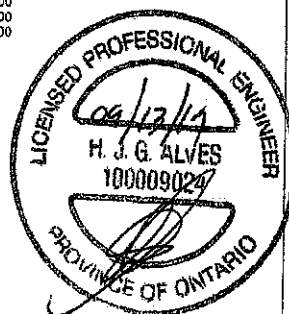

Structural component only
DWG# T-1923505

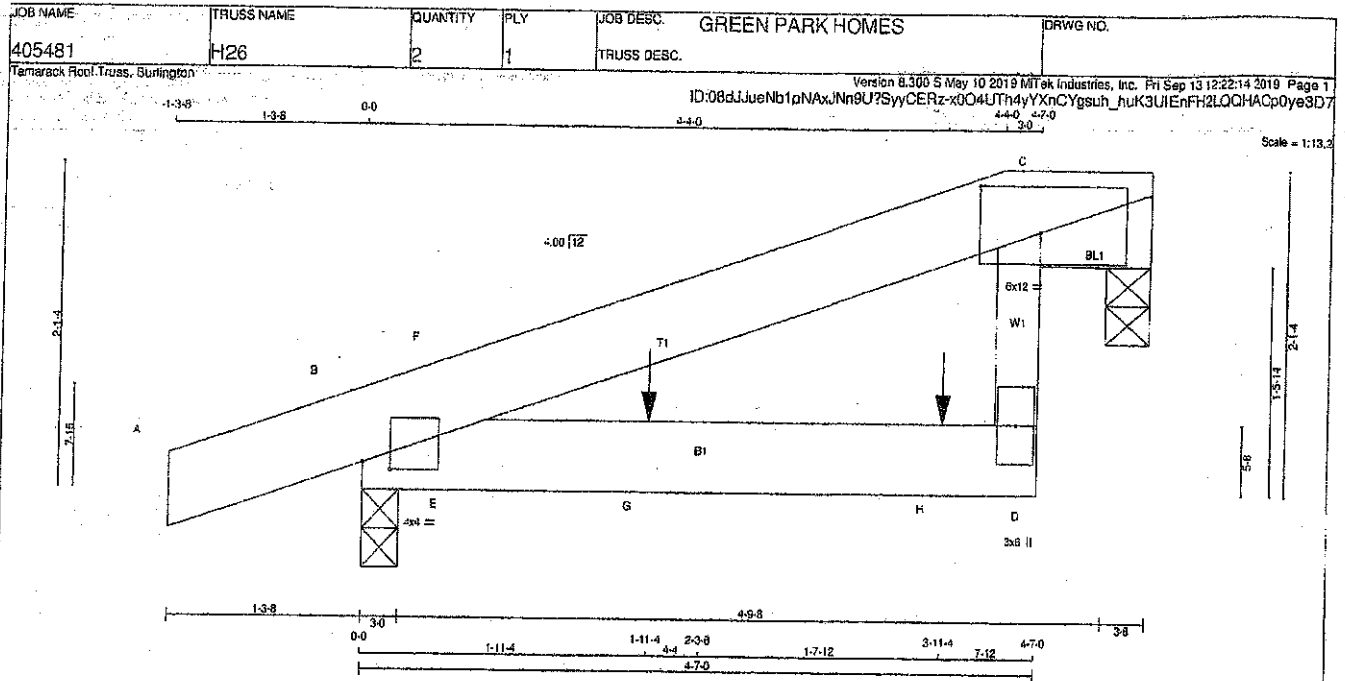

LUMBER		N. L. G. A. RULES		LUMBER		DESCR.	
CHORDS	SIZE						
A - C	2x6	DRY		No.2		SPF	
D - C	2x4	DRY		No.2		SPF	
B - D	2x6	DRY		No.2		SPF	
BEARING BLOCKS							
BL1	2x6	DRY		No.2		SPF	
DRY: SEASONED LUMBER.							

PLATES (Table is in inches)		W		LEN		Y		X	
JT	TYPE	PLATES							
B	TMB1-4	MT20	4.0	4.0	0.50	2.25			
C	TMBV1-p	MT20	6.0	12.0	3.50	5.00			
D	BMV-p	MT20	3.0	6.0					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
C	298	0	0	298	0	0	0	3-8	3-8
B	425	0	0	425	0	0	0	3-0	3-0

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): C

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS		PERM LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL				
C	211	132 / 0	0 / 0	0 / 0	0 / 0	78 / 0	0 / 0				
B	298	211 / 0	0 / 0	0 / 0	0 / 0	87 / 0	0 / 0				

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S): C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (LBS)	MAX.	MAX.	MEMB.	FORCE (LBS)	MAX.	MAX.
FR-TO						FR-TO			
A-B	0 / 13		-102.0 -102.0	0.07 (1)	10.00	E-F	-214 / 29	0.00 (1)	
B-F	-31 / 0		-102.0 -102.0	0.04 (4)	6.25				
F-C	0 / 3		-102.0 -102.0	0.15 (1)	10.00				
D-C	0 / 92		0.0 0.0	0.02 (4)	10.00				
B-E	0 / 0		-18.5 -18.5	0.11 (1)	10.00				
E-G	0 / 0		-18.5 -18.5	0.11 (1)	10.00				
G-H	0 / 0		-18.5 -18.5	0.11 (1)	10.00				
H-D	0 / 0		-18.5 -18.5	0.11 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11-4	-13	-14		FRONT	VERT	TOTAL		C1
H	3-11-4	-17	-17		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 20.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.5 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.15/1.00 (D-F:1), BC=0.11/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1967 786 1967 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.19 (B) (INPUT = 0.99)
JSI METAL=0.08 (B) (INPUT = 1.00)

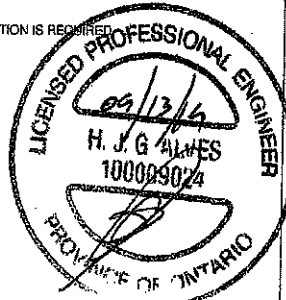


Structural component only
DWG# T-1923558

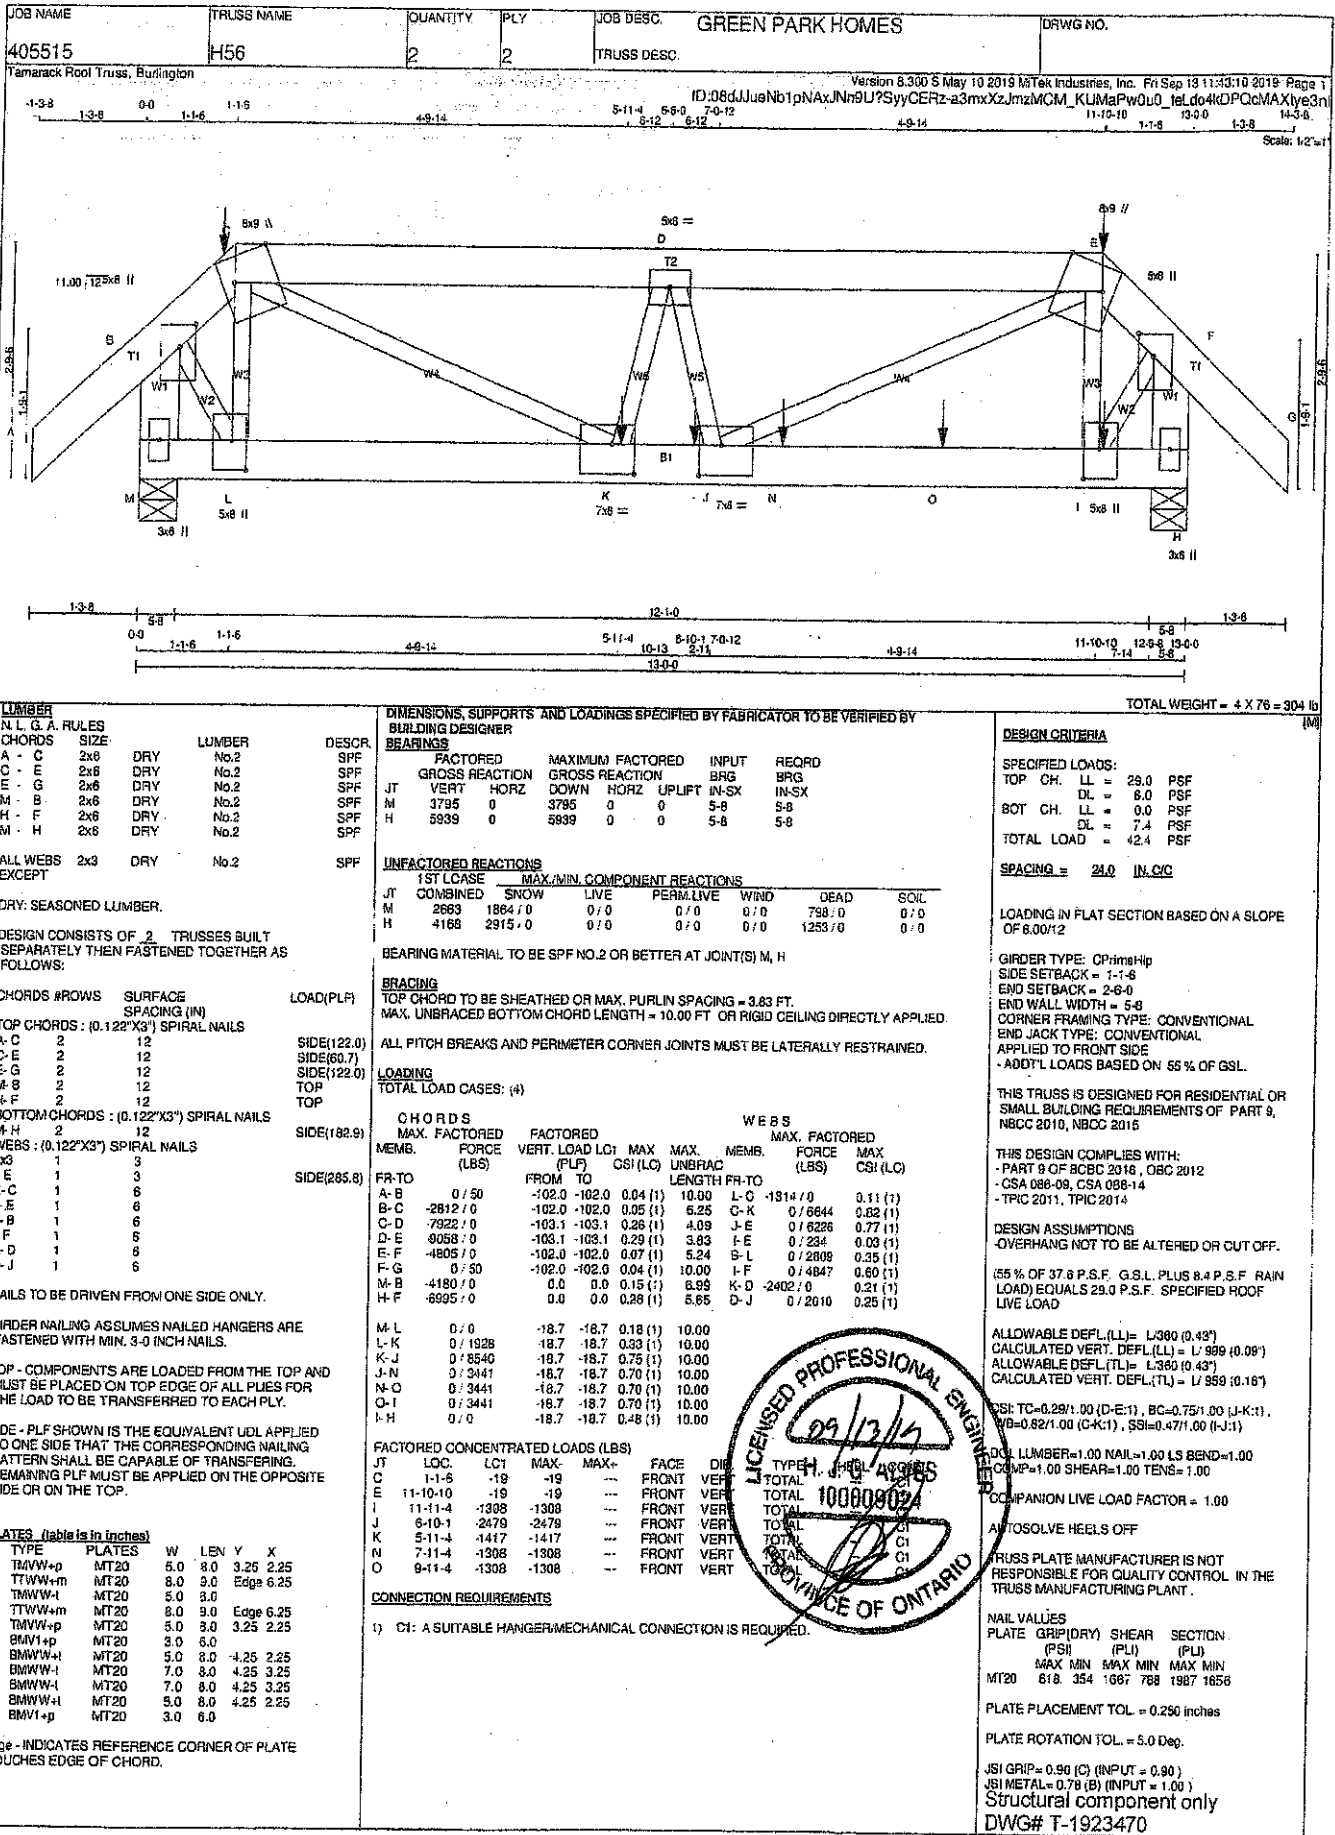

JOB NAME 405515	TRUSS NAME H57	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO. SEP 16 2019
Tamarack Roof Truss, Burlington				Version 8300 S May 10 2019 Nitek Industries, Inc. Fri Sep 13 11:48:11 2019 Page 1	TRUSS DESC.

Version 8300 S May 10 2019 Nitek Industries, Inc. Fri Sep 13 11:48:11 2019 Page 1
CER2-2GKJUKOKgKDCU3Z86RFRFX0532pFgZ6G8K3Jye3dk

TOWN OF CALEDON
BUILDING SECTION
Scale = 1/32

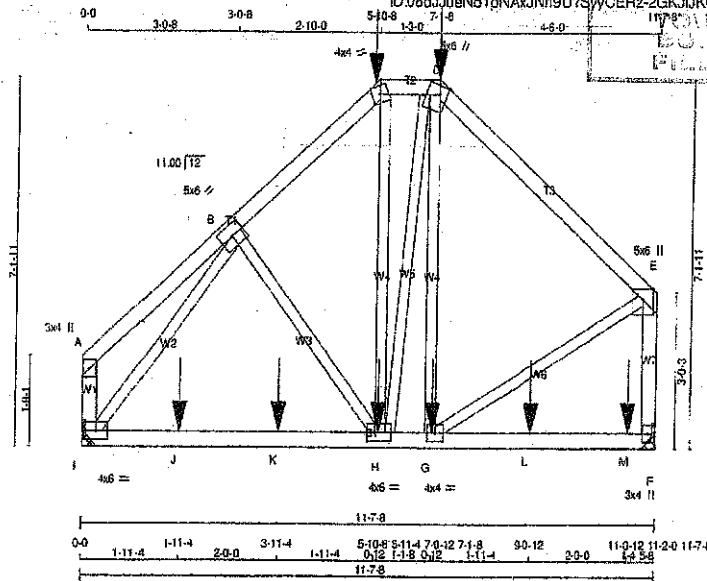

TOTAL WEIGHT = 2 X 84 = 127 lb

LUMBER			
N. L. & A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
I - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMV+p	MT20	3.0	4.0	
B	TMVW-i	MT20	5.0	6.0	
C	TTW-m	MT20	4.0	4.0	
D	TTWW-m	MT20	5.0	6.0	2.00 1.75
E	TMVW+p	MT20	5.0	6.0	Edge
F	BMV1+p	MT20	3.0	4.0	
G	BMVW-i	MT20	4.0	4.0	
H	BMVW-i	MT20	4.0	6.0	2.00 2.00
I	BMVW-i	MT20	4.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	1435	0	1435	0	MECHANICAL
I	1270	0	1270	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, I. MINIMUM BEARING LENGTH AT JOINT F = 3-8, JOINT I = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
F	1012	679 / 0	0 / 0	0 / 0	0 / 0	333 / 0	0 / 0
I	886	603 / 0	0 / 0	0 / 0	0 / 0	293 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.57 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FR-TO	
A-B	0 / 22	B-H	0 / 35
B-C	-1072 / 0	H-C	0 / 100
C-D	-771 / 0	D-E	0 / 157
D-E	-1021 / 0	E-F	335 / 0
F-A	-115 / 0	F-B	-1325 / 0
F-E	-1358 / 0	G-E	0 / 888
I-J	0 / 769	J-K	-18.5 / -18.5
J-K	0 / 769	K-H	-18.5 / -18.5
K-H	0 / 769	H-G	-18.5 / -18.5
H-G	0 / 745	G-L	-18.5 / -18.5
G-L	0 / 0	L-M	-18.5 / -18.5
L-M	0 / 0	M-F	-18.5 / -18.5

FACTORED CONCENTRATED LOADS (LBS)		FACE DIR.		HEEL		CONN.	
JT	LOC.	LOC1	MAX	TYPE	HEEL	CONN.	
C	5-10-8	-508	-508	FRONT VERT	---	C1	
D	7-1-8	-55	-52	FRONT VERT	---	C1	
D	7-1-8	-205	-205	FRONT VERT	---	C1	
D	7-1-8	-320	-320	FRONT VERT	---	C1	
G	7-0-12	-36	-36	FRONT VERT	---	C1	
H	5-11-4	-36	-36	FRONT VERT	---	C1	
J	1-11-4	-36	-36	FRONT VERT	---	C1	
K	3-11-4	-36	-36	FRONT VERT	---	C1	
L	9-0-12	-36	-36	FRONT VERT	---	C1	
M	11-0-12	-40	-40	FRONT VERT	---	C1	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDTL USER DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, CBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TO=0.44/1.00 (B-E:1), BC=0.37/1.00 (G-H:1), WB=0.55/1.00 (B-I:1), SS=0.16/1.00 (H-I:4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PL) (PLS)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1567 788 1987 1856

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.89 (G) (INPUT = 0.90)
JSI METAL = 0.37 (E) (INPUT = 1.00)

Structural component only
DWG# T-1923471

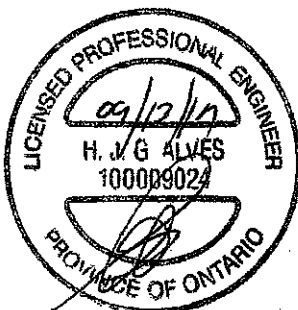

JOB NAME 405515	TRUSS NAME H60	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington
Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 11:43:12 2019 Page 1

ID:08dJueNb1pNAxJNn9U?SyYcERz-W5uiy1L1VzS4EeethqzU_R47Z9QDYk7itwrHamye3nj
Scale = 1:13.7


LUMBER N.L.G.A. RULES CHORDS SIZE LUMBER DESCR. A - C 2x4 DRY No.2 SPF D - C 2x4 DRY No.2 SPF F - A 2x4 DRY No.2 SPF F - D 2x4 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 EXCEPT DRY: SEASONED LUMBER. PLATES (table is in inches) <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>JT</th> <th>TYPE</th> <th>PLATES</th> <th>W</th> <th>LEN</th> <th>Y</th> <th>X</th> </tr> <tr> <td>A</td> <td>TMVV-p</td> <td>MT20</td> <td>4.0</td> <td>4.0</td> <td>1.50</td> <td>2.00</td> </tr> <tr> <td>B</td> <td>TMWW-t</td> <td>MT20</td> <td>4.0</td> <td>4.0</td> <td>2.00</td> <td>1.75</td> </tr> <tr> <td>C</td> <td>TMV-p</td> <td>MT20</td> <td>3.0</td> <td>4.0</td> <td></td> <td></td> </tr> <tr> <td>D</td> <td>BMVV-t</td> <td>MT20</td> <td>4.0</td> <td>4.0</td> <td></td> <td></td> </tr> <tr> <td>E</td> <td>BMWW-t</td> <td>MT20</td> <td>4.0</td> <td>4.0</td> <td></td> <td></td> </tr> <tr> <td>F</td> <td>BMV1-p</td> <td>MT20</td> <td>3.0</td> <td>4.0</td> <td></td> <td></td> </tr> </table>	JT	TYPE	PLATES	W	LEN	Y	X	A	TMVV-p	MT20	4.0	4.0	1.50	2.00	B	TMWW-t	MT20	4.0	4.0	2.00	1.75	C	TMV-p	MT20	3.0	4.0			D	BMVV-t	MT20	4.0	4.0			E	BMWW-t	MT20	4.0	4.0			F	BMV1-p	MT20	3.0	4.0			DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th rowspan="2">JT</th> <th colspan="2">FACTORED GROSS REACTION</th> <th colspan="2">MAXIMUM FACTORED GROSS REACTION</th> <th rowspan="2">INPUT BRG</th> <th rowspan="2">RECORD BRG</th> </tr> <tr> <th>VERT</th> <th>HORZ</th> <th>DOWN</th> <th>HORZ</th> </tr> <tr> <td>D</td> <td>827</td> <td>0</td> <td>827</td> <td>0</td> <td>1-10</td> <td>1-10</td> </tr> <tr> <td>F</td> <td>827</td> <td>0</td> <td>827</td> <td>0</td> <td>5-8</td> <td>5-8</td> </tr> </table> UNFACTORED REACTIONS <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th rowspan="2">JT</th> <th colspan="2">1ST LCASE</th> <th colspan="5">MAX./MIN. COMPONENT REACTIONS</th> </tr> <tr> <th>COMBINED</th> <th>SNOW</th> <th>LIVE</th> <th>PERM. LIVE</th> <th>WIND</th> <th>DEAD</th> <th>SOIL</th> </tr> <tr> <td>D</td> <td>562</td> <td>389 / 0</td> <td>0 / 0</td> <td>0 / 0</td> <td>0 / 0</td> <td>184 / 0</td> <td>0 / 0</td> </tr> <tr> <td>F</td> <td>562</td> <td>389 / 0</td> <td>0 / 0</td> <td>0 / 0</td> <td>0 / 0</td> <td>184 / 0</td> <td>0 / 0</td> </tr> </table> BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, F BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.46 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. 1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-D, B-D. END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW LOADING TOTAL LOAD CASES: (4) <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th rowspan="2">MEMB.</th> <th colspan="2">CHORDS</th> <th colspan="2">FACTORED</th> <th rowspan="2">MAX. UNBRACED LENGTH</th> <th rowspan="2">MEMB.</th> <th colspan="2">WEBS</th> <th rowspan="2">MAX. UNBRACED LENGTH</th> </tr> <tr> <th>MAX. FACTORED FORCE (LBS)</th> <th>VERT. LOAD</th> <th>LOAD</th> <th>CSF (L/C)</th> <th>MAX. FACTORED FORCE (LBS)</th> <th>CSF (L/C)</th> </tr> <tr> <td>A-B</td> <td>-880 / 0</td> <td>-102.0</td> <td>-102.0</td> <td>0.65 (1)</td> <td>5.46</td> <td>E-B</td> <td>0 / 144</td> <td>0.05 (4)</td> <td></td> </tr> <tr> <td>B-C</td> <td>-88 / 0</td> <td>-102.0</td> <td>-102.0</td> <td>0.63 (1)</td> <td>6.25</td> <td>B-D</td> <td>-969 / 0</td> <td>0.41 (1)</td> <td></td> </tr> <tr> <td>D-C</td> <td>-264 / 0</td> <td>0.0</td> <td>0.0</td> <td>0.08 (1)</td> <td>6.25</td> <td>A-E</td> <td>0 / 828</td> <td>0.19 (1)</td> <td></td> </tr> <tr> <td>F-A</td> <td>-777 / 0</td> <td>0.0</td> <td>0.0</td> <td>0.08 (1)</td> <td>7.81</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>F-E</td> <td>0 / 0</td> <td>-18.5</td> <td>-18.5</td> <td>0.25 (4)</td> <td>10.00</td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>E-D</td> <td>0 / 821</td> <td>-18.5</td> <td>-18.5</td> <td>0.31 (4)</td> <td>10.00</td> <td></td> <td></td> <td></td> <td></td> </tr> </table>	JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG	VERT	HORZ	DOWN	HORZ	D	827	0	827	0	1-10	1-10	F	827	0	827	0	5-8	5-8	JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS					COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	D	562	389 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0	F	562	389 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0	MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS		MAX. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LOAD	CSF (L/C)	MAX. FACTORED FORCE (LBS)	CSF (L/C)	A-B	-880 / 0	-102.0	-102.0	0.65 (1)	5.46	E-B	0 / 144	0.05 (4)		B-C	-88 / 0	-102.0	-102.0	0.63 (1)	6.25	B-D	-969 / 0	0.41 (1)		D-C	-264 / 0	0.0	0.0	0.08 (1)	6.25	A-E	0 / 828	0.19 (1)		F-A	-777 / 0	0.0	0.0	0.08 (1)	7.81					F-E	0 / 0	-18.5	-18.5	0.25 (4)	10.00					E-D	0 / 821	-18.5	-18.5	0.31 (4)	10.00					DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 29.0 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 42.4 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF NBC 2018, CBC 2012 - CSA 066-09, CSA 068-14 - TPC 2011, TPC 2014 (55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL) = L/360 (0.46") CALCULATED VERT. DEFL.(LL) = L/999 (0.02") ALLOWABLE DEFL.(TL) = L/360 (0.46") CALCULATED VERT. DEFL.(TL) = L/999 (0.07") CSF: TC=0.65/1.00 (A-B:1) , BC=0.31/1.00 (D-E:4) , WB=0.41/1.00 (B-D:1) , SE=0.30/1.00 (A-B:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10 COMPANION LIVE LOAD FACTOR = 1.00 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES <table border="1" style="width:100%; border-collapse: collapse;"> <tr> <th>PLATE</th> <th>GRIP(DRY)</th> <th>SHEAR (PSI)</th> <th>SECTION (PL)</th> </tr> <tr> <td>MT20</td> <td>618</td> <td>354</td> <td>1667 788 1987 1856</td> </tr> </table> PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP = 0.89 (D) (INPUT = 0.90) JSI METAL = 0.31 (E) (INPUT = 1.00)	PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PL)	MT20	618	354	1667 788 1987 1856
JT	TYPE	PLATES	W	LEN	Y	X																																																																																																																																																																																									
A	TMVV-p	MT20	4.0	4.0	1.50	2.00																																																																																																																																																																																									
B	TMWW-t	MT20	4.0	4.0	2.00	1.75																																																																																																																																																																																									
C	TMV-p	MT20	3.0	4.0																																																																																																																																																																																											
D	BMVV-t	MT20	4.0	4.0																																																																																																																																																																																											
E	BMWW-t	MT20	4.0	4.0																																																																																																																																																																																											
F	BMV1-p	MT20	3.0	4.0																																																																																																																																																																																											
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG																																																																																																																																																																																									
	VERT	HORZ	DOWN	HORZ																																																																																																																																																																																											
D	827	0	827	0	1-10	1-10																																																																																																																																																																																									
F	827	0	827	0	5-8	5-8																																																																																																																																																																																									
JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS																																																																																																																																																																																												
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL																																																																																																																																																																																								
D	562	389 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0																																																																																																																																																																																								
F	562	389 / 0	0 / 0	0 / 0	0 / 0	184 / 0	0 / 0																																																																																																																																																																																								
MEMB.	CHORDS		FACTORED		MAX. UNBRACED LENGTH	MEMB.	WEBS		MAX. UNBRACED LENGTH																																																																																																																																																																																						
	MAX. FACTORED FORCE (LBS)	VERT. LOAD	LOAD	CSF (L/C)			MAX. FACTORED FORCE (LBS)	CSF (L/C)																																																																																																																																																																																							
A-B	-880 / 0	-102.0	-102.0	0.65 (1)	5.46	E-B	0 / 144	0.05 (4)																																																																																																																																																																																							
B-C	-88 / 0	-102.0	-102.0	0.63 (1)	6.25	B-D	-969 / 0	0.41 (1)																																																																																																																																																																																							
D-C	-264 / 0	0.0	0.0	0.08 (1)	6.25	A-E	0 / 828	0.19 (1)																																																																																																																																																																																							
F-A	-777 / 0	0.0	0.0	0.08 (1)	7.81																																																																																																																																																																																										
F-E	0 / 0	-18.5	-18.5	0.25 (4)	10.00																																																																																																																																																																																										
E-D	0 / 821	-18.5	-18.5	0.31 (4)	10.00																																																																																																																																																																																										
PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PL)																																																																																																																																																																																												
MT20	618	354	1667 788 1987 1856																																																																																																																																																																																												

Structural component only
DWG# T-1923472

JOB NAME 405515	TRUSS NAME H60G	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.300 S May 10 2019 MTek Industries, Inc. Fri Sep 13 11:43:13 2019 Page 1
ID:08dJueNbt1pNAXJNnsU7SyyCERz-eR4A7MCHaxsnDxFXUjWbQMZqYHFsr6abr8Cye3ni
13-8-10 13-8-10 13-8-10

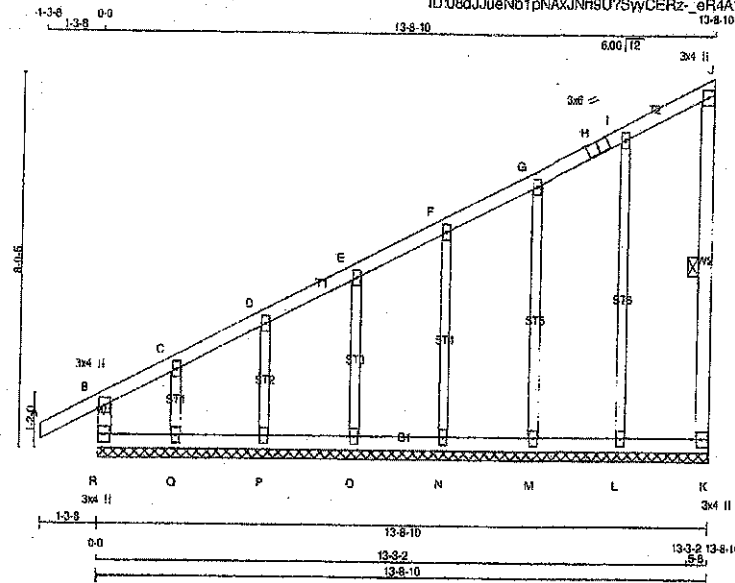

Scale = 1/4\"/>

TOTAL WEIGHT = 2 X 64 = 127 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER
R - B	2x4 DRY	No.2		
A - H	2x4 DRY	No.2		
H - J	2x4 DRY	No.2		
K - J	2x4 DRY	No.2		
R - K	2x4 DRY	No.2		
ALL WEBS	2x3 DRY	No.2		
ALL GABLE WEBS	2x3 DRY	No.2		
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)	JF TYPE	PLATES	W	LEN	Y	X
B TMV+p	MT20	3.0	4.0			
C, D, E, F, G, I	MT20	2.0	4.0			
C TMW+w	MT20	3.0	4.0			
H TS-I	MT20	3.0	4.0			
J TMV+p	MT20	3.0	4.0			
K BMV1+p	MT20	3.0	4.0			
L, M, N, O, P, Q	MT20	2.0	4.0			
L BMW1+w	MT20	3.0	4.0			
R BMV1+p	MT20	3.0	4.0			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.

THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF J-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	FACTORED LC1 MAX. CSI (LC) UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO				FR-TO			
R-B	-274 / 0	0.0	0.0 0.04 (1)	L-I	-221 / 0	0.19 (1)	
A-B	0 / 31	-102.0	-102.0 0.13 (1)	M-G	-201 / 0	0.11 (1)	
B-C	-44 / 0	-102.0	-102.0 0.11 (1)	N-F	-204 / 0	0.08 (1)	
C-D	-15 / 0	-102.0	-102.0 0.05 (1)	O-E	-189 / 0	0.05 (1)	
D-E	-18 / 0	-102.0	-102.0 0.05 (1)	P-D	-216 / 0	0.04 (1)	
E-F	-10 / 0	-102.0	-102.0 0.05 (1)	Q-C	-132 / 0	0.02 (1)	
F-G	-7 / 0	-102.0	-102.0 0.05 (1)				
G-H	-4 / 0	-102.0	-102.0 0.05 (1)				
H-I	-4 / 0	-102.0	-102.0 0.05 (1)				
I-J	-8 / 0	-102.0	-102.0 0.05 (1)				
J-K	-91 / 0	0.0	0.0 0.02 (1)				
R-Q	0 / 23	-18.5	-18.5 0.05 (1)				
O-P	0 / 18	-18.5	-18.5 0.02 (4)				
P-O	0 / 13	-18.5	-18.5 0.02 (4)				
O-N	0 / 9	-18.5	-18.5 0.02 (4)				
N-M	0 / 6	-18.5	-18.5 0.02 (4)				
M-L	0 / 4	-18.5	-18.5 0.02 (4)				
L-K	0 / 2	-18.5	-18.5 0.02 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 28.0	PSF
DL	= 6.0	PSF
BOT CH. LL	= 0.0	PSF
DL	= 7.4	PSF
TOTAL LOAD	= 42.4	PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, CBC 2012
- CSA 086-06, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CS: TC=0.13/1.00 (A-B:1), BC=0.05/1.00 (Q-R:1), WB=0.19/1.00 (I-L:1), SS=0.10/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PS)	SECTION (PL)
MT20	618	354
	1657	788
	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.13 (I) (INPUT = 0.90)
JSI METAL = 0.09 (I) (INPUT = 1.00)

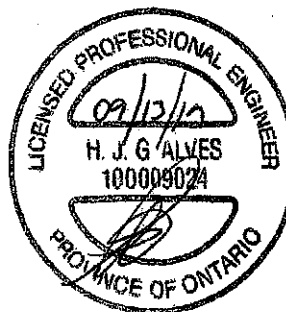

Structural component only
DWG# T-1923473

JOB NAME 405515	TRUSS NAME H61	QUANTITY 2	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO. 16 2019
Tamarack Roof Truss, Burlington		Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 11:43:14 2019 Page 1			
ID:08dJueNb1pNAXJNh9U?SyyCEfz-Sr7SNLNH1biotxobpFy368aRy790X?KEKOObeye3nh					

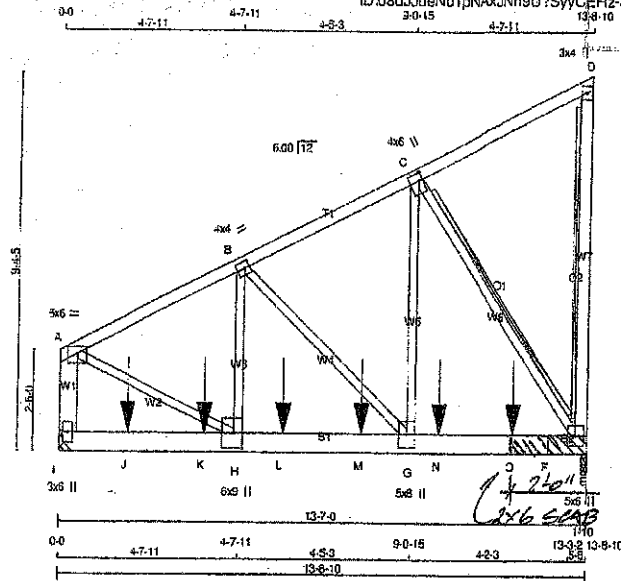

TOTAL WEIGHT = 4 X 80 = 322 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
I - A	2x6	DRY	No.2	SPF	
A - D	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
I - E	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
DRY, SEASONED LUMBER.					

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
I - A	2	12
A - D	1	12
D - E	1	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I - E	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP : COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE : PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (Table in inches)	PLATES	W	LEN	Y	X
JT	TYPE				
A	TMVW-p	MT20	5.0	6.0	2.00 3.00
B	TMVW-t	MT20	4.0	4.0	2.00 1.50
C	TMVW-t	MT20	4.0	6.0	2.25 1.00
D	TMVW-p	MT20	3.0	4.0	
E	BMVW-t	MT20	5.0	8.0	
G	BMVW-t	MT20	5.0	8.0	
H	BMVW-t	MT20	6.0	9.0	4.50 2.50
I	BMVW-p	MT20	3.0	6.0	



DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
I	4379	0	4379	0
E	4320	0	4320	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 4'-0.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
I	3078	2135	0	0/0	0/0	941	0
E	3055	2108	0	0/0	0/0	929	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

2x6 DRY SPF No.2 BEARING BLOCK 24" LONG AT JT. E ATTACHED TO FRONT SIDE WITH 3 ROWS OF (0.122"x3") SPIRAL NAILS SPACED 3" C.C. 21 NAILS TOTAL.

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.53 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

2x4 DRY SPF No.2 T-BRACE AT D-E

2x6 DRY SPF No.2 T-BRACE AT C-E

FASTEN T AND T-BRACES TO NARROW EDGE OF WEB WITH ONE ROW PER PLY OF 3" COMMON WIRE NAILS @ 6" O.C. WITH 3" MINIMUM END DISTANCE. BRACE MUST COVER 90% OF WEB LENGTH.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CS1 (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM	TO		LENGTH	FR-TO			
I-A	-3854	0.0	0.0	0.16 (1)	7.35	A-H	0	-3872 0.49 (1)	
A-B	-4029	0	-102.0	-102.0 0.24 (1)	4.53	H-B	0	-1318 0.16 (1)	
B-C	-2695	0	-102.0	-102.0 0.29 (1)	5.55	B-G	-1698	0 0.59 (1)	
C-D	-21	0	-102.0	-102.0 0.16 (1)	6.25	G-C	0	-4143 0.51 (1)	
D-E	-191	0	0.0	0.0 0.07 (1)	7.81	C-E	-4218	0 0.85 (1)	
F-J	0	0	-18.5	-18.5 0.47 (1)	10.00				
J-K	0	0	-18.5	-18.5 0.47 (1)	10.00				
K-H	0	0	-18.5	-18.5 0.47 (1)	10.00				
H-L	0	3817	-18.5	-18.5 0.88 (1)	10.00				
L-M	0	3817	-18.5	-18.5 0.88 (1)	10.00				
M-G	0	3817	-18.5	-18.5 0.88 (1)	10.00				
G-N	0	2415	-18.5	-18.5 0.62 (1)	10.00				
N-O	0	2415	-18.5	-18.5 0.62 (1)	10.00				
O-F	0	2415	-18.5	-18.5 0.62 (1)	10.00				
F-E	0	2415	-18.5	-18.5 0.62 (1)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
J	1-9-10	-1174	-1174	---	BACK	VERT	TOTAL	---	C1
K	3-9-10	-1174	-1174	---	BACK	VERT	TOTAL	---	C1
L	5-9-10	-1174	-1174	---	BACK	VERT	TOTAL	---	C1
M	7-9-10	-1174	-1174	---	BACK	VERT	TOTAL	---	C1
N	9-9-10	-1174	-1174	---	BACK	VERT	TOTAL	---	C1
O	11-9-10	-1174	-1174	---	BACK	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
OL = 6.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 2x6 IN. CG

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCG 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OSC 2012
- CSA 088-10, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.46")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.46")
CALCULATED VERT. DEFL.(TL) = L/999 (0.09")

CSI: TC=0.24/1.00 (A-B:1), BC=0.66/1.00 (G-H:1), WB=0.85/1.00 (C-E:1), SI=0.58/1.00 (E-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP=0.88 (C) (INPUT = 0.89)
JSI METAL=0.55 (C) (INPUT = 1.00)

Structural component only
DWG# T-1923474

JOB NAME
405481

TRUSS NAME
J1

QUANTITY
22

PLY
1

JOB DESC.
GREEN PARK HOMES

TRUSS DESC.

DRWG NO.

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:22:15 2019 Page 1

ID:CGPEw/Rwz3I2cID6UHFYIR8a-PCySipijseqif3SPVwRXcY7d680VbaexvmlL.Sye3D6

Scale = 1:28.2

1-3-8 1-3-8 0-0 5-10-8 5-10-8

6'-0" 12'

3x4 11

3x4 11

1-3-8 1-3-8 0-0 5-10-8 5-10-8

LUMBER

N.L.G.A. RULES	CHORDS	SIZE	DRY	LUMBER
E - B	2x4	DRY	No.2	
A - C	2x4	DRY	No.2	
E - D	2x4	DRY	No.2	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV-p	MT20	3.0	4.0		
E	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
E	578	578	5-8	5-8
C	225	225	1-8	1-8
D	46	51	1-8	1-8

SEE MITEK STANDARD DETAIL 697781H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	404	293 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	154	128 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
E-B	-515 / 0	0.0	0.0	0.12 (4)	7.81		
A-B	0 / 39	-102.0	-102.0	0.14 (1)	10.00		
B-C	-42 / 0	-102.0	-102.0	0.60 (1)	8.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF

LL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 42.4 PSF

SPACING E 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = 1/360 (0.20")

CALCULATED VERT. DEFL.(LL) = 1/999 (0.00")

ALLOWABLE DEFL.(TL) = 1/360 (0.20")

CALCULATED VERT. DEFL.(TL) = 1/999 (0.03")

CSI: TC=0.60/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1987 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.22 (B) (INPUT = 0.90)

JSI METAL = 0.17 (B) (INPUT = 1.00)

09/13/19

H. J. G. ALVES


100009024

PROVINCE OF ONTARIO

Structural component only

DWG# T-1923559

JOB NAME 405481	TRUSS NAME J4	QUANTITY 12	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:22:19 2019 Page 1			
ID:08dJJueNb1pNAXJnn9U?SyyCERz-I_CyXAI0n593UJZqhEZsbNnLPFVWyHa9ZZizUDye3D2		3-4-8 3-2-8 6-7-0			

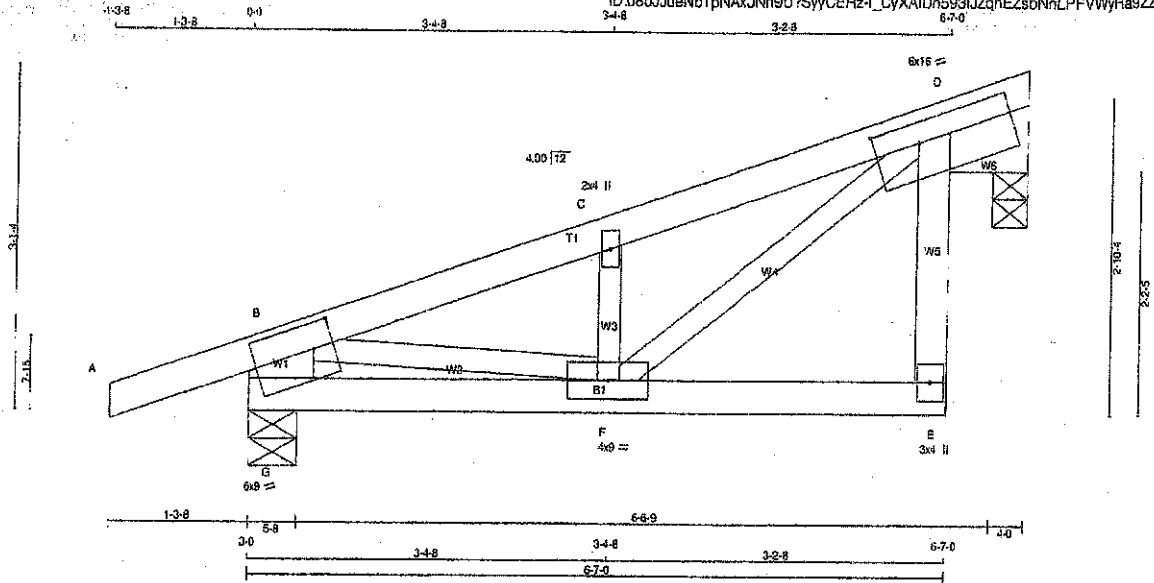

TOTAL WEIGHT = 12 X 29 = 348 LB

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
A - D	2x4	DRY	No.2
E - D	2x4	DRY	No.2
G - E	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
G - B	2x8	DRY	No.2
DRY: SEASONED LUMBER.			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B					
C	TMW-w	MT20	2.0	4.0	
D	TMVWW-1	MT20	6.0	16.0	2.25 5.00
E	BMV-w	MT20	3.0	4.0	
F	BMVWW-1	MT20	4.0	9.0	
G					
G	TMVWW-1	MT20	6.0	9.0	2.75 2.25

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESCR.	SPF	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
		GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
D	379	0	379	0	+0 (3-15)
G	546	0	546	0	5-8

VALUE IN PARENTHESIS INDICATES EFFECTIVE BEARING LENGTH

BEVELED PLATE OR SHIM REQUIRED TO PROVIDE FULL BEARING SURFACE WITH TRUSS CHORD AT JT(S): D

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
D	266	182 / 0	0 / 0	0 / 0	0 / 0	84 / 0	0 / 0	0 / 0
G	381	277 / 0	0 / 0	0 / 0	0 / 0	104 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) D, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
FR-TO		FROM TO	CS (LC)	FR-TO		FROM TO	CS (LC)
A-B	0 / 26	-102.0 -102.0	0.19 (1)	G-B	-517 / 0	0.02 (1)	
B-C	-494 / 0	-102.0 -102.0	0.15 (1)	B-F	0 / 484	0.11 (1)	
C-D	-479 / 0	-102.0 -102.0	0.15 (1)	F-C	-377 / 0	0.05 (1)	
E-D	0 / 29	0.0 0.0	0.01 (4)	F-D	0 / 575	0.13 (1)	
G-F	0 / 0	-18.5 -18.5	0.04 (4)				
F-E	0 / 0	-18.5 -18.5	0.04 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015.

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012
- CSA 086-09, CSA 086-14
- TRC 2011, TRC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.21")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.21")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.19/1.00 (A-B:1), BC=0.04/1.00 (E-F:4), WB=0.13/1.00 (D-F:1), SG=0.15/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
	MAX	MIN	MAX MIN MAX MIN
MT20	619	354	1657 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.42 (G) (INPUT = 0.90)
JSI METAL= 0.13 (F) (INPUT = 1.00)

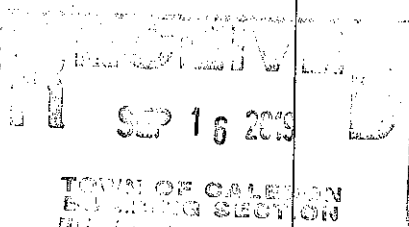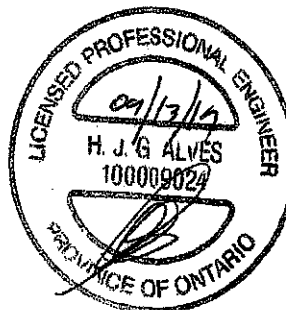

Structural component only
DWG# T-1923561

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
405481	J5	10	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington					
Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 12:22:20 2019 Page 1					
ID:08dJJueNb1pNAxJNn9U7SyyCERz-mAmLIWmrYOHwwT80Fy658bJQmso1hmqJoDdX1gye3D1					

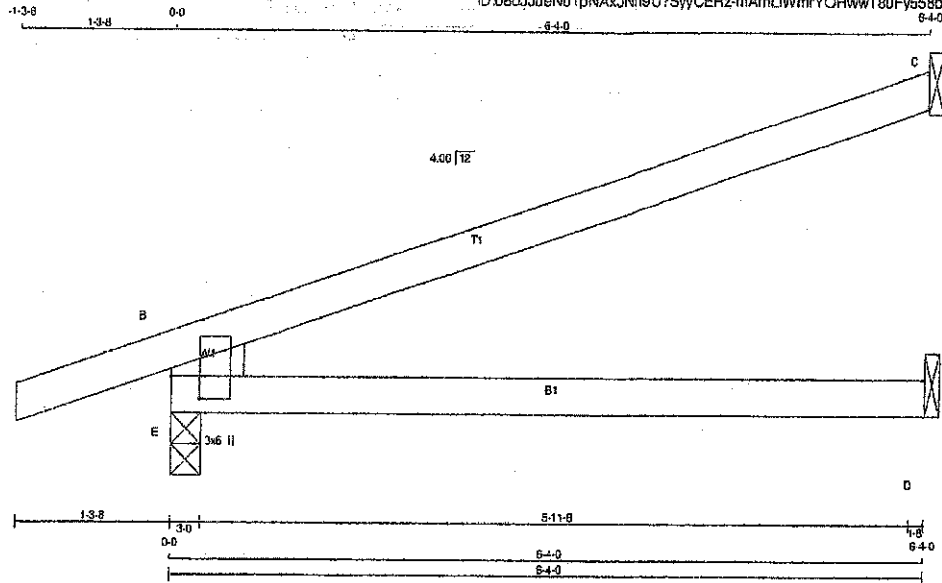

TOTAL WEIGHT = 10 X 17 = 171 lb

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESOR.
E - B	2x8	DRY	No.2	SPF	
A - C	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)	W	LEN	Y	X
BT TYPE PLATES				
E TMBMV1+p MT20	3.0	6.0	2.25	2.75

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
E	613	0	813	0
C	242	0	242	0
D	44	0	50	0

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST LOASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW	LIVE
E	429	307/0	0/0
C	168	138/0	0/0
D	35	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MAX. FACTORED		FACTORED		MAX. FACTORED			
MEMB.	FORCE	VERT. LOAD	LCI	MAX	MEMB.	FORCE	MAX
	(LBS)	(PLF)	CS1 (LC)	UNBRAC		(LBS)	CS1 (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
E-B	-540 / 0	0.0	0.0	0.05 (4)	7.81		
A-B	0 / 22	-102.0	-102.0	0.13 (1)	10.00		
B-C	-28 / 0	-102.0	-102.0	0.54 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.21 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 3.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, NBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.21")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.21")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.21/1.00 (D-E:4), WB=0.00/1.00 (Inad), SSI=0.30/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(F5) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1567 738 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.27 (5) (INPUT = 0.50)
JSI METAL = 0.11 (5) (INPUT = 1.00)

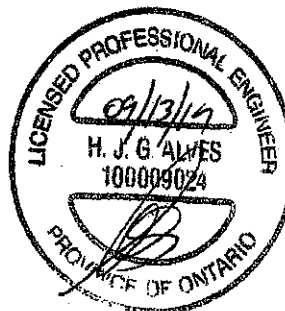

Structural component only
DWG# T-1923562

JOB NAME 405515	TRUSS NAME J10	QUANTITY 8	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

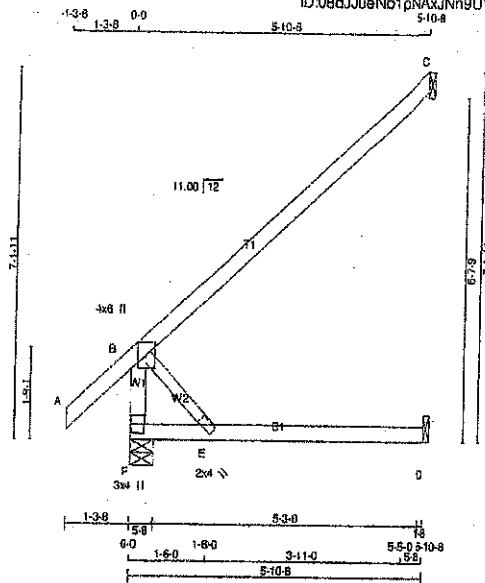

Scale = 1:30.0

Version 8.300 S May 10 2019 Mitek Industries, Inc. Fri Sep 13 11:43:15 2019 Page 1
ID:08dJueNb1pNAXJNn9U?SyyCEPz-wfZqahNvouqf55NKnyWBB4hikMTpIB8Zu4xC5ye3ng

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	No.2
F - B	2x4	DRY	No.2
A - C	2x4	DRY	2100F 1.8E
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT	TYPE	PLATES	W	LEN Y X
B	TM/VW+p	MT20	4.0	6.0 Edge
E	BMW+w	MT20	2.0	4.0
F	BMV1+p	MT20	3.0	4.0

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	VERT	GROSS REACTION	HORIZ	DOWN	HORIZ	BRG	IN-SX	BRG	IN-SX
F	496	0	496	0	0	5-8	5-8	5-8	5-8
C	300	0	300	0	0	1-8	1-8	1-8	1-8
D	54	0	61	0	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		LIVE		PERM. LIVE		WIND		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	PERM. LIVE	WIND	DEAD	SOIL	PERM. LIVE	WIND
F	348	251.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
C	206	170.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
D	43	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		W E B S		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (PLF)
FR-TO					FR-TO		
F-B	-442.0	0.0	0.0	0.05 (1)	B-E	0.0	0.00 (1)
A-B	0.48	-102.0	-102.0	0.09 (1)			
B-C	0.0	-102.0	-102.0	0.40 (1)			
F-E	0.0	-18.5	-18.5	0.14 (4)			
E-D	0.0	-18.5	-18.5	0.19 (4)			

TOTAL WEIGHT = 8 X 21 = 168 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, ORC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.40/1.00 (B-C:1), BC=0.19/1.00 (D-E:4),
WB=0.00/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

COL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PS)	(PL)	(PL)	(PL)
MT20	618	354	1657 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.32 (B) (INPUT = 0.90)
JSI METAL=0.12 (B) (INPUT = 1.00)

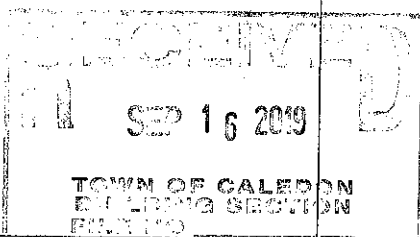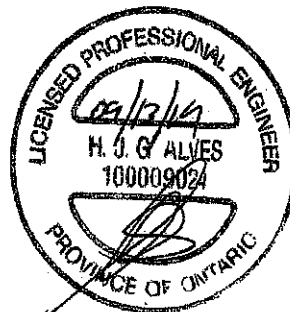

Structural component only
DWG# T-1923475



isDesign™

Client:
Project:
Address:

Date: 2/2019



Page 1 of 4

Designer:
Job Name: 405515

Project #:

B1 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED

Level: Level

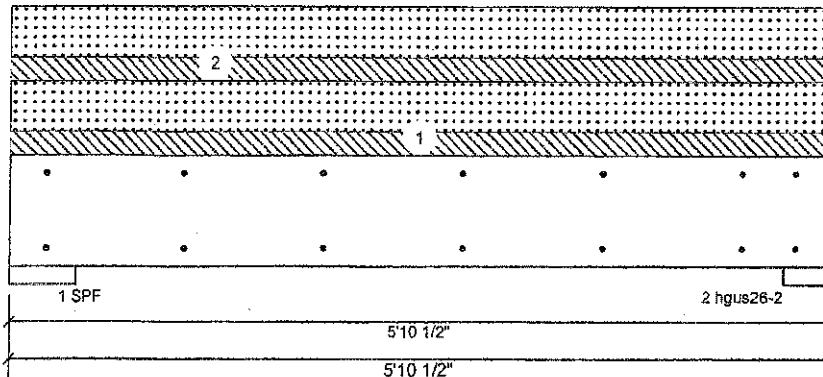**Member Information**

Type: Girder
Plies: 2
Moisture Condition: Dry
Deflection LL: 360
Deflection TL: 360
Importance: Normal

Application: Roof (Residential)
Slope: 0/12
Design Method: LSD
Building Code: NBCC 2015 / OBC 2012
Load Sharing: No
Deck: Not Checked
Vibration: Not Checked

Unfactored Reactions UNPATTERNED lb (Uplift)

Brg	Live	Dead	Snow	Wind
1	0	278	602	0
2	0	266	577	0

Bearings and Factored Reactions


Bearing	Length	Cap. React D/Lib	Total Ld. Case	Ld. Comb.
1 - SPF	5.500"	12% 348 / 903	1250 L	1.25D+1.5S
2 - hgs2...	4.000"	16% 333 / 865	1198 L	1.25D+1.5S

Analysis Results

Analysis	Actual	Location	Allowed	Capacity	Comb.	Case
Moment	1413 ft-lb	3'	6039 ft-lb	0.234 (23%)	1.25D+1.5S	L
Unbraced	1413 ft-lb	3'	5236 ft-lb	0.270 (27%)	1.25D+1.5S	L
Shear	1085 lb	12"	3984 lb	0.272 (27%)	1.25D+1.5S	L
LL Defl inch	0.012 (L/5129)	3'	0.174 (L/360)	0.070 (7%)	S	L
TL Defl inch	0.018 (L/3508)	3'	0.174 (L/360)	0.100 (10%)	D+S	L

Design Notes

- 1 Fasten all plies using 2 rows of Pneumatic Gun Nail (.120x3.25") at 12" o.c. Maximum end distance not to exceed 6".
- 2 Refer to last page of calculations for fasteners required for specified loads.
- 3 Girders are designed to be supported on the bottom edge only.
- 4 Top braced at bearings.
- 5 Bottom braced at bearings.
- 6 Lateral slenderness ratio based on single ply width.

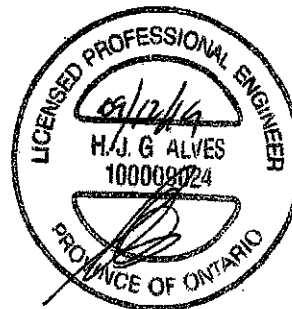

DWG NO. TAM 1723476
STRUCTURAL
COMPONENT ONLY 1/2

ID	Load Type	Location	Trib Width	Side	Dead	Live	Snow	Wind	Comments
1	Uniform		1-0-0	Far Face	13.4 PSF	0 PSF	29 PSF	0 PSF	
2	Uniform		5-11-0	Near Face	13.4 PSF	0 PSF	29 PSF	0 PSF	

Manufacturer Info

Tamarack Roof Trusses
3255 North Service Road, ON
L7N 3G2
905-335-1115



This design is valid until 12/11/2021





isDesign™

Client:
Project:
Address:


Date: 12/2019

Page 4 of 4

Designer:
Job Name: 405515
Project #:**B2 S-P-F #2 2.000" X 10.000" 2-Ply - PASSED**

Level: Level

SEP 16 2019

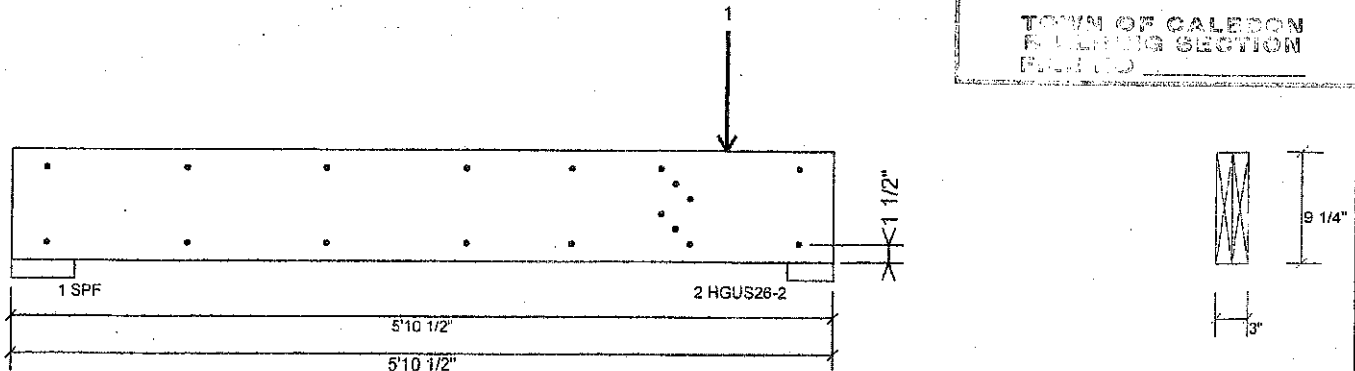TOWN OF CALEDON
BUILDING SECTION
PERMITTED**Multi-Ply Analysis**


Fasten all plies using 2 rows of 10d Box nails (128x3") at 12" o.c. except for regions covered by concentrated load fastening.
Maximum end distance not to exceed 6"

Capacity	34.6 %
Load	88.5 PLF
Yield Limit per Foot	265.6 PLF
Yield Limit per Fastener	127.8 lb.
Yield Mode	9
Edge Distance	1 1/2"
Min. End Distance	3"
Load Combination	1.25D+1.5S
Duration Factor	1.00

Concentrated Load

Fasten at concentrated side load at 5-1-4 with a minimum of (6) - 10d Box nails (128x3") in the pattern shown.

Capacity	77.3 %
Load	592.8lb.
Total Yield Limit	766.9 lb.
Yield Limit per Fastener	127.8 lb.
Yield Mode	9
Load Combination	1.25D+1.5S
Duration Factor	1.00

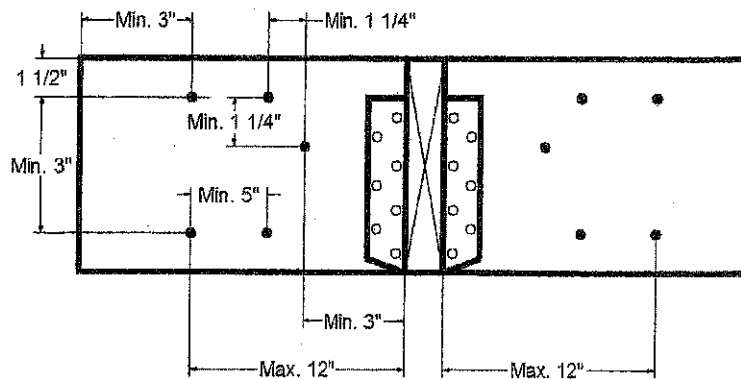Min/Max fastener distances for Concentrated Side Loads

DWG NO. TAM 11923477
STRUCTURAL
COMPONENT ONLY 3/2

This design is valid until 12/11/2021

Manufacturer Info

Tamarack Roof Trusses
3255 North Service Road, ON
L7N 3G2
905-335-1115



LUL/LUS/LJS/HUS/HHUS/HGUS

SIMPSON
Strong-Tie

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.




Double-Shear Nailing Top View



Double-Shear Nailing Side View; Do not bend tab



Double-Shear Nailing Side View (available on some models)
U.S. Patent 5,603,580

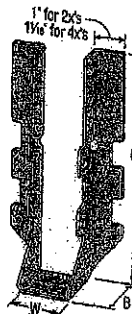


LUS28




LU26L




HUS210
(HUS26, HUS28, and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26 Installation with Reduced Heel Height
(Truss Designer to provide fastener quantity for connecting multiple members together)

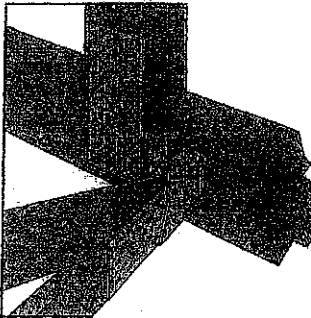

Plated Truss Connectors

SEP 16 2019

Simpson Strong-Tie® Wood Construction Connectors — Canadian Limit States Design

LUL/LUS/LJS/HUS/HHUS/HGUS

HHUS/HGUS

See Hanger Options information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
W < 2"	Bevel or square cut	0.62 of table value	0.48 of table value
2" < W < 6"	Bevel cut	0.67 of table value	0.41 of table value
2" < W < 6"	Square cut	0.46 of table value	0.41 of table value
W > 6"	Bevel cut	0.75 of table value	0.41 of table value



Top View HHUS Hanger
Skewed Right
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _a ³	Header	Joist	Uplift		S-E-F	
								(K _u = 3.0)	(K _u = 3.24)	(K _u = 1.15)	(K _u = 1.00)
		lb.	lb.	lb.	lb.	lb.	lb.	lb.	lb.	lb.	lb.
								KN	KN	KN	KN
Single 2x Sizes											
LUS24	18	1 1/8	3 1/8	1 1/4	2 1/4	(4) 10d	(2) 10d	710	1625	645	1155
LU24L	22	1 1/8	3	1 1/4	2 1/8	(4) 10d	(2) 10d x 1 1/2"	360	1020	320	725
LU26L	22	1 1/8	5	1 1/4	4 1/4	(8) 10d	(4) 10d x 1 1/2"	720	1605	645	1140
LUS26	18	1 1/8	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420	2170	1290	1630
HUS26	16	1 1/8	5 3/8	3	3 1/8	(14) 16d	(6) 16d	2705	4940	2065	3875
LJS26DS	18	1 1/8	5	3 1/4	4 1/4	(16) 16d	(6) 16d	2055	4265	1460	4115
HGUS26	12	1 1/8	5 3/8	5	4 1/4	(20) 16d	(8) 16d	2685	6625	2685	5700
LU28L	20	1 1/8	6 1/4	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140	2185	1020	1550
LUS28	18	1 1/8	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420	2520	1290	1790
HUS28	16	1 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3605	5365	2675	4345
HGUS28	12	1 1/8	7 1/4	5	6 1/4	(36) 16d	(12) 16d	3310	7675	3310	6900
LU210L	20	1 1/8	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140	2465	1020	1770
LJS210	18	1 1/8	7 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d	1420	2785	1290	2210

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.
2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.
3. d_a is the distance from the bearing seat to the top joist nail.
4. Resistances shown require a minimum 2-ply glider truss. For fastening to single-ply truss request technical bulletin T-C-N10THSSCN and/or see installation notes.
5. Nails: 16d = 0.162" dia. x 3 1/2" long. See pp. 27–28 for other nail sizes and information.

C-C-CAN2018 ©2017 SIMPSON STRONG-TIE COMPANY INC.


Face-Mount Hangers

SIMPSON
Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)					Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist		D-F		S-P-F	
									Uplift	Normal	Uplift	Normal
									(K _D = 1.75)	(K _D = 2.00)	(K _D = 1.15)	(K _D = 1.80)
									lb.	lb.	lb.	lb.
									kN	kN	kN	kN
Double 2x Sizes												
LUS24-2	18	3 1/8	3 1/8	2	1 1/2	(4) 16d	(2) 16d		835	2020	590	1435
SS LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d		1720	2595	1545	1920
HHUS26-2	14	3 1/8	6 1/8	3	3 1/4	(14) 16d	(6) 16d		2850	7395	2065	5205
HGUS26-2	12	3 1/8	5 1/8	4	4 1/4	(20) 16d	(8) 16d		4385	8950	3110	6355
SS LUS28-2	18	3 1/8	7 1/8	2	4	(8) 16d	(4) 16d		1720	3325	1545	2575
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d		3765	8940	2675	6345
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
SS LUS210-2	18	3 1/8	9 1/8	2	6	(8) 16d	(6) 16d		2580	4500	2320	3195
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d		4670	9660	4235	7000
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14015	4855	10270
Triple 2x Sizes												
HGUS26-3	12	4 1/8	5 1/8	4	4 1/4	(20) 16d	(8) 16d		4385	8950	3110	6355
HGUS28-3	12	4 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
HHUS210-3	14	4 1/8	9 1/8	3	7 1/8	(30) 16d	(10) 16d		4670	9670	4235	6865
HGUS210-3	12	4 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14045	4855	10400
Quadruple 2x Sizes												
HGUS26-4	12	6 1/8	5 1/8	4	4 1/4	(20) 16d	(8) 16d		4385	8950	3110	6355
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
HHUS210-4	14	6 1/8	9 1/8	3	7 1/8	(30) 16d	(10) 16d		4670	10155	4235	7210
HGUS210-4	12	6 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14645	4855	10400
HGUS212-4	12	6 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d		7640	14995	5425	10645
HGUS214-4	12	6 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d		10130	16400	7195	11645
4x Sizes												
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d		1720	2595	1545	1920
HHUS46	14	3 1/8	5 1/8	3	3 1/4	(14) 16d	(6) 16d		2540	7395	2065	5205
HGUS46	12	3 1/8	5 1/8	4	4 1/4	(20) 16d	(8) 16d		4385	8950	3110	6355
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d		1720	3325	1545	2575
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d		3765	8940	2675	6345
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d		6070	12980	4310	9215
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d		2580	4500	2320	3195
HGUS410	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d		6840	14015	4855	10270
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d		7640	14995	5425	10645
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d		10130	16400	7195	11645



Plated Truss Connectors

See footnotes on p. 258.

SEP 16 2010



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD

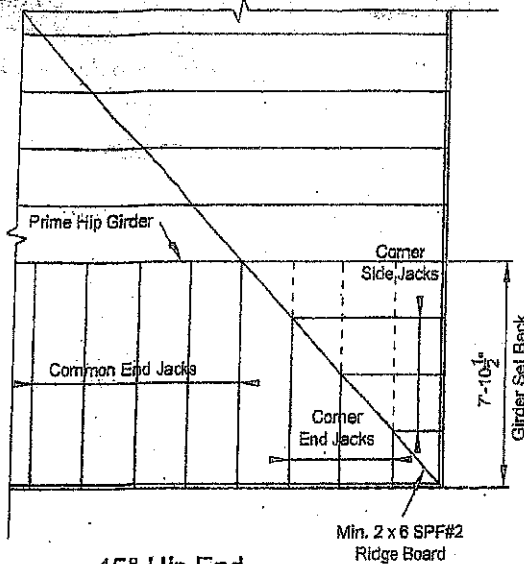


45° Hip End

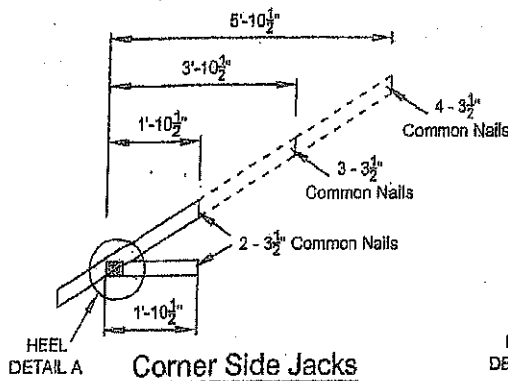


Corner Side Jacks

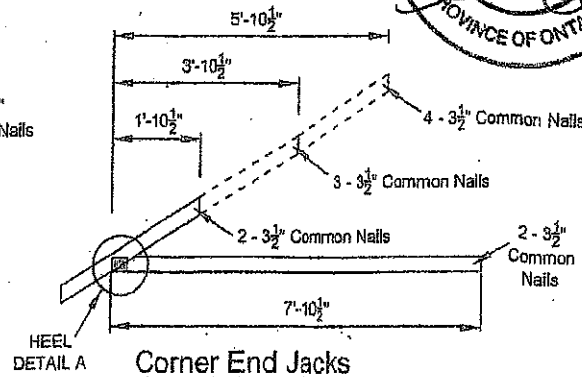

Corner End Jacks

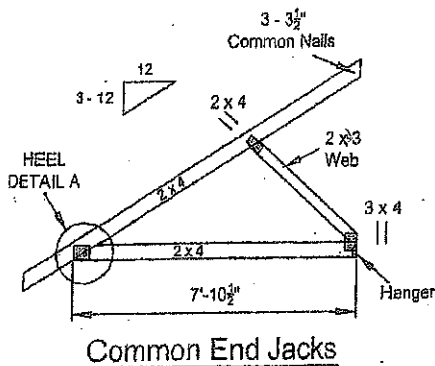


Common End Jacks

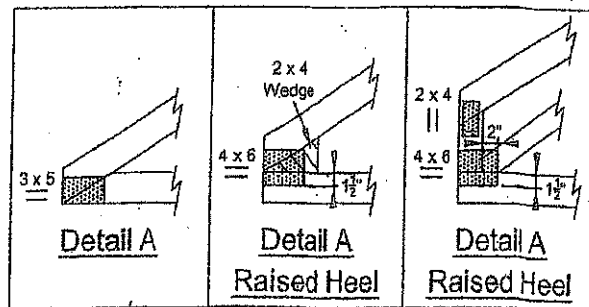

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800217

RECEIVED
SEP 16 2013
TOWN OF CALEDON
BUILDING SECTION
FILE NO

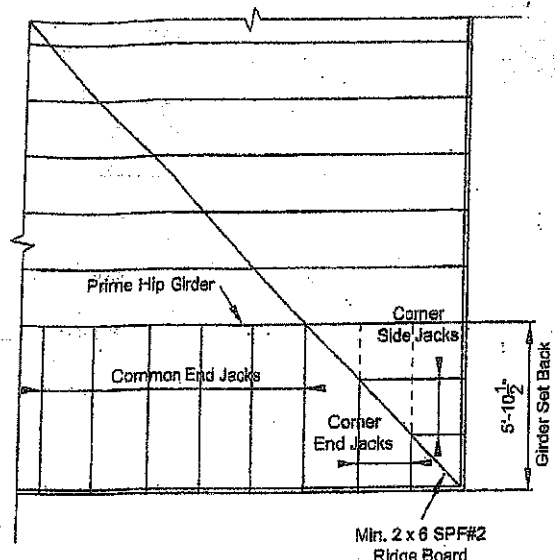

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
BOTTOM CHORD : 2 x 4 SPF#2
WEBS : 2 x 3 SPF#2
UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
TOP CHORD DEAD LOAD : 3.0 P.S.F.
BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD : 50.5 P.S.F.

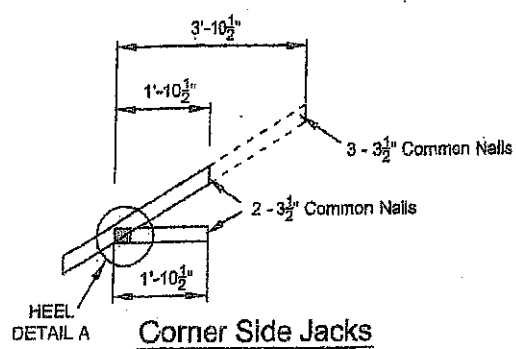


Corner Side Jacks

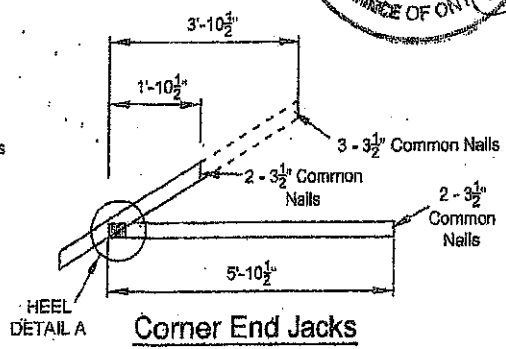

Corner End Jacks

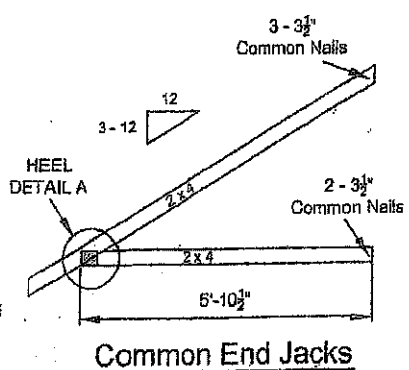

Common End Jacks


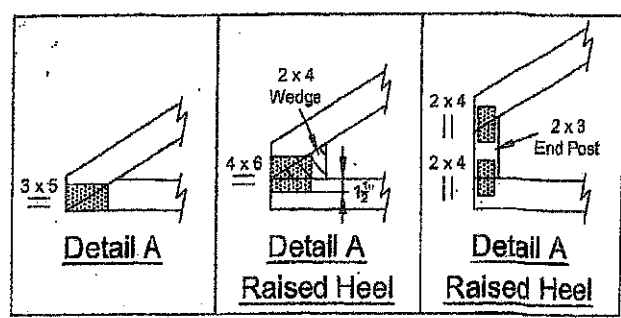


NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800216

Symbols

PLATE LOCATION AND ORIENTATION



*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



BEARING




Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

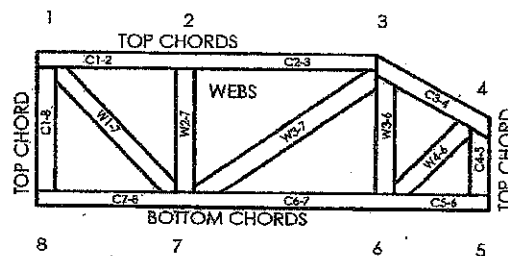

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIL-7473C rev. 10-08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

SP 16 2019
TOWN OF CALEDON
BUILDING SECTION

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MH7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900213

Feb 09, 2018