

GALE 1B
TH 95-2 / 1
TH 96-3 / 1
401786

19-07-00

GALE 1B
TH 95-1 / 1
TH 96-2 / 1
401787

19-07-00


ASPHALT SHINGLES
12" FINISHED OH.
STD HEEL
2X4 EXTERIOR WALLS
2X6 FASCIA BOARD

DESIGN CONFORMS
WITH O.B.C. 2012 PART 9
DESIGN LOADS:
SNOW LOAD 29.02 PSF
TC DEAD 6 PSF
BC LIVE 10.5 PSF
BC DEAD 7 PSF

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C. 2012
 ROOF RAFTERS THAT CROSS MEET OVER TRUSSES TO BE 2X4
 SPF @ 24" O.C. WITH A 2X4 VERT. POST TO THE TRUSS
 UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6"
 TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN
 END PT. & BETWEEN ROWS OF BRACING DOES NOT EXCEED 6"

TOWN OF CALEDON
 BUILDING SECTION
 FILE NO. _____

RECEIVED
AUG 15 2019

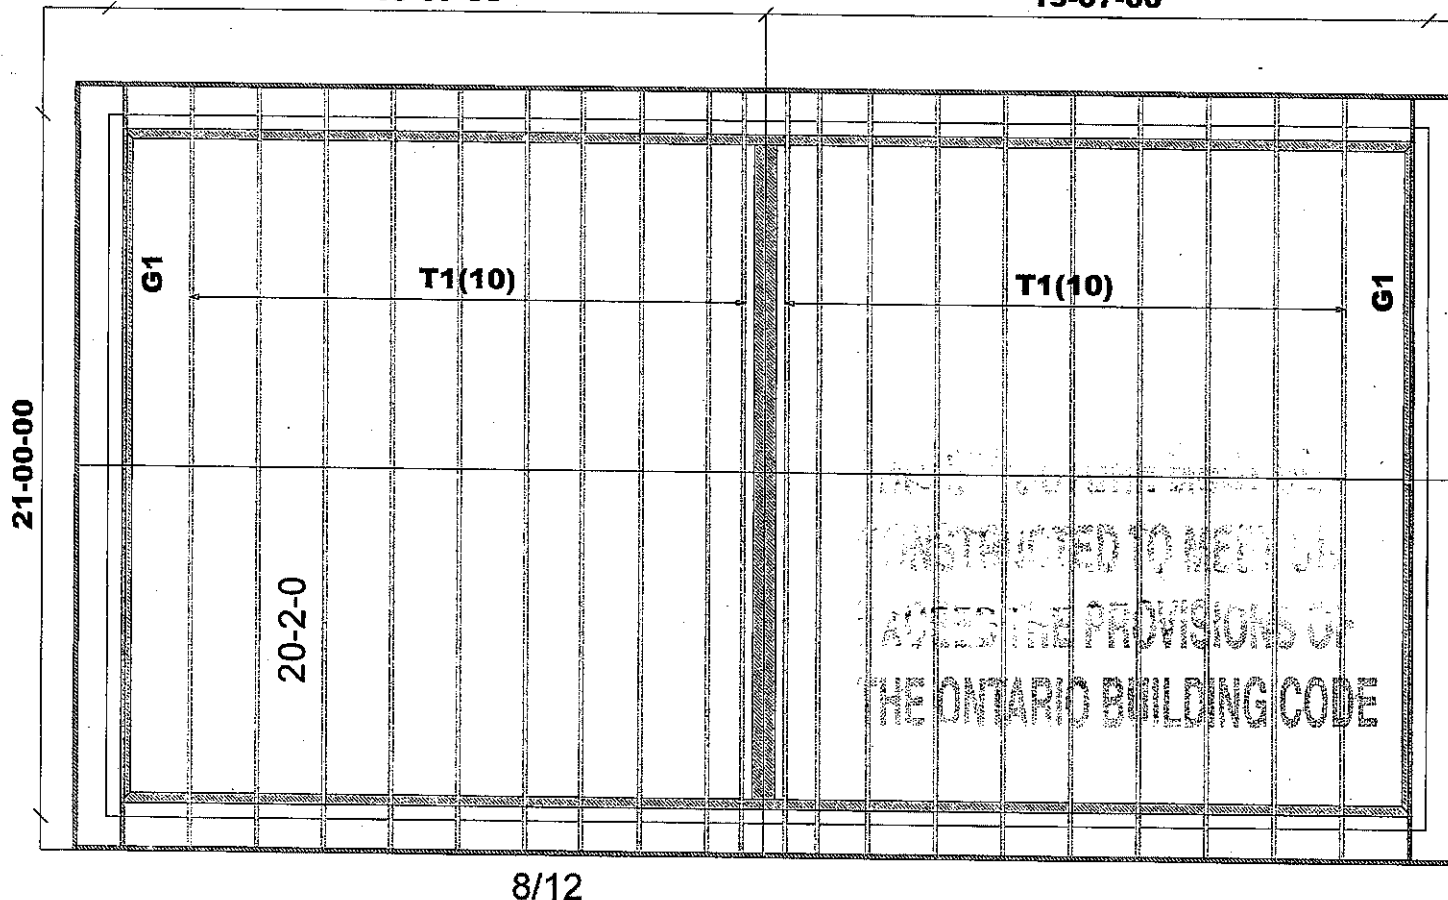

Job Track: **50033**
 Plan Log: **200645**
 Layout ID: **401785**

Builder / Location:
GREEN PARK HOMES / CALEDON
 Project: **LAMBERT LANE PH.2**

Model / Elevation:
GALE 1B / 1 **Block 95-1**

Date: 3/8/2019 Sales: Mario DiCano Designer: AC

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Mitek ver 8.2.3.229



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: GALE 1B
 Lot #:
 Elevation: TH95-1 / 1

Job Track: 50033
 PlanLog: 200645
 Layout ID: 401786
 Ref #
 Page: 1 of 1
 Date: 03/09/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	10	T1 Common	8 /12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	722.64 448.67		
	1	G1 GABLE	8 /12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	80.64 51.17		

TOTAL # TRUSS= 11

TOTAL BFT OF ALL TRUSSES= 497.84

BFT.

TOTAL WEIGHT OF ALL TRSSES 803.28 LBS

RECEIVED
 AUG 15 2019

TOWN OF CALEDON
 BUILDING SECTION
 FILE NO _____



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: GALE 1B
 Lot #:
 Elevation: TH95-2 / 1

Job Track: 50033
 PlanLog: 200645
 Layout ID: 401787
 Ref #
 Page: 1 of 1
 Date: 03/09/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	10	T1 Common	8 / 12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	722.64 448.67		
	1	G1 GABLE	8 / 12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	80.64 51.17		

TOTAL # TRUSS= 11


TOTAL BFT OF ALL TRUSSES= 497.84

BFT. TOTAL WEIGHT OF ALL TRSSES 803.28 LBS

JOB NAME 401788	TRUSS NAME T1	QUANTITY 10	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 6.230 S Nov 17 2018 MITek Industries, Inc. Mon Mar 18 17:29:32 2019 Page 1
ID:UoHQ90YyA/FCG5Y3nxXfDmzciez-OrP0vUmFzhvPICv7YaWAA6VW0_e60q81hgSKo0jzZeh1

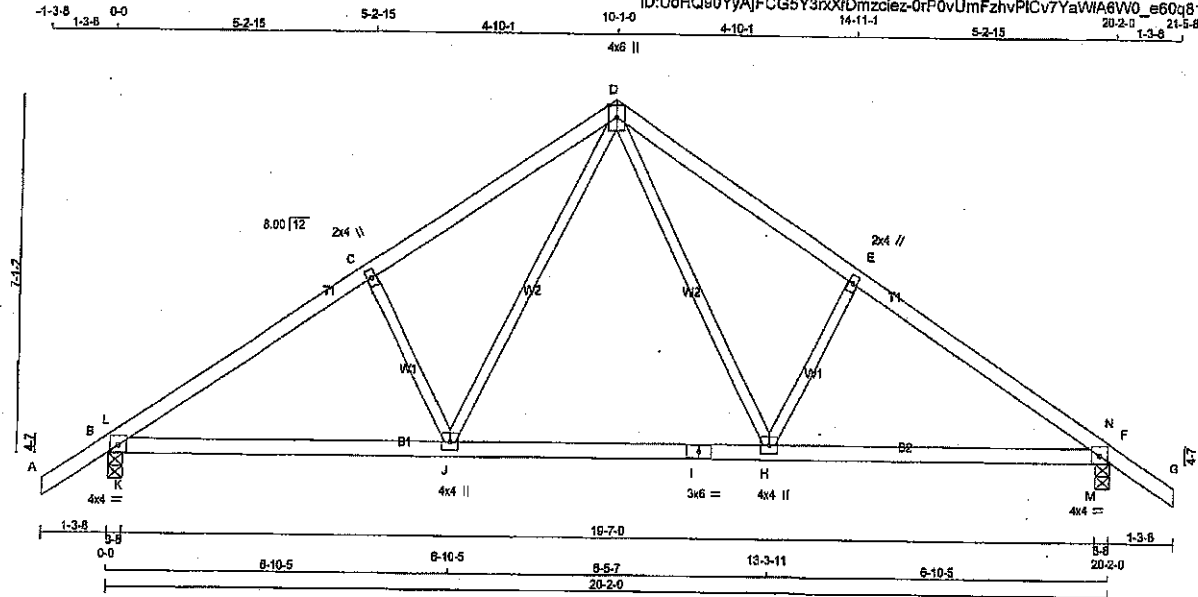

TOTAL WEIGHT = 10 X 72 = 723 lb
(M/F)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
B - I	2x4	DRY	No.2
I - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY
DRY: SEASONED LUMBER.

DESCR.	SPF
SPF	No.2
SPF	No.2
SPF	No.2
SPF	No.2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
B	1356	0	1356	0	3-8	3-8
F	1356	0	1356	0	3-8	3-8

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
B	952	665 / 0	0 / 0	0 / 0	0 / 0	287 / 0	0 / 0
F	952	665 / 0	0 / 0	0 / 0	0 / 0	287 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LOA1 (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM	TO			FR-TO			
A-B	0 / 37	-102.1	-102.1	0.14 (1)	10.00	D-H	0 / 681	0.15 (1)	
B-L	-1747 / 0	-102.1	-102.1	0.07 (1)	5.00	H-E	-508 / 0	0.13 (1)	
L-C	-1666 / 0	-102.1	-102.1	0.34 (1)	4.80	J-D	0 / 681	0.15 (1)	
C-D	-1468 / 0	-102.1	-102.1	0.33 (1)	5.07	C-J	-508 / 0	0.13 (1)	
D-E	-1468 / 0	-102.1	-102.1	0.33 (1)	5.07	K-L	-117 / 132	0.00 (1)	
E-N	-1666 / 0	-102.1	-102.1	0.34 (1)	4.80	M-N	-117 / 132	0.00 (1)	
N-F	-1747 / 0	-102.1	-102.1	0.07 (1)	5.00				
F-G	0 / 37	-102.1	-102.1	0.14 (1)	10.00				
B-K	0 / 1409	-18.5	-18.5	0.29 (1)	10.00				
K-J	0 / 1409	-18.5	-18.5	0.35 (1)	10.00				
J-I	0 / 903	-18.5	-18.5	0.25 (1)	10.00				
I-H	0 / 903	-18.5	-18.5	0.25 (1)	10.00				
H-M	0 / 1409	-18.5	-18.5	0.35 (1)	10.00				
M-F	0 / 1409	-18.5	-18.5	0.29 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	29.0	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	42.4	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-06, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.67")
CALCULATED VERT. DEFL.(LL) = L/899 (0.06")
ALLOWABLE DEFL.(TL) = L/360 (0.67")
CALCULATED VERT. DEFL.(TL) = L/899 (0.12")

CSI: TC=0.34/1.00 (C-L:1), BC=0.35/1.00 (J-K:1), WB=0.15/1.00 (D-J:1), SSI=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	618	354	1687


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (F) (INPUT = 0.90)
JSI METAL= 0.68 (B) (INPUT = 1.00)


RECEIVED
AUG 15 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO

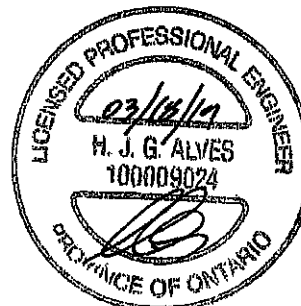

DWG NO. TAM 7905975
STRUCTURAL
COMPONENT ONLY

JOB NAME 401785	TRUSS NAME G1	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

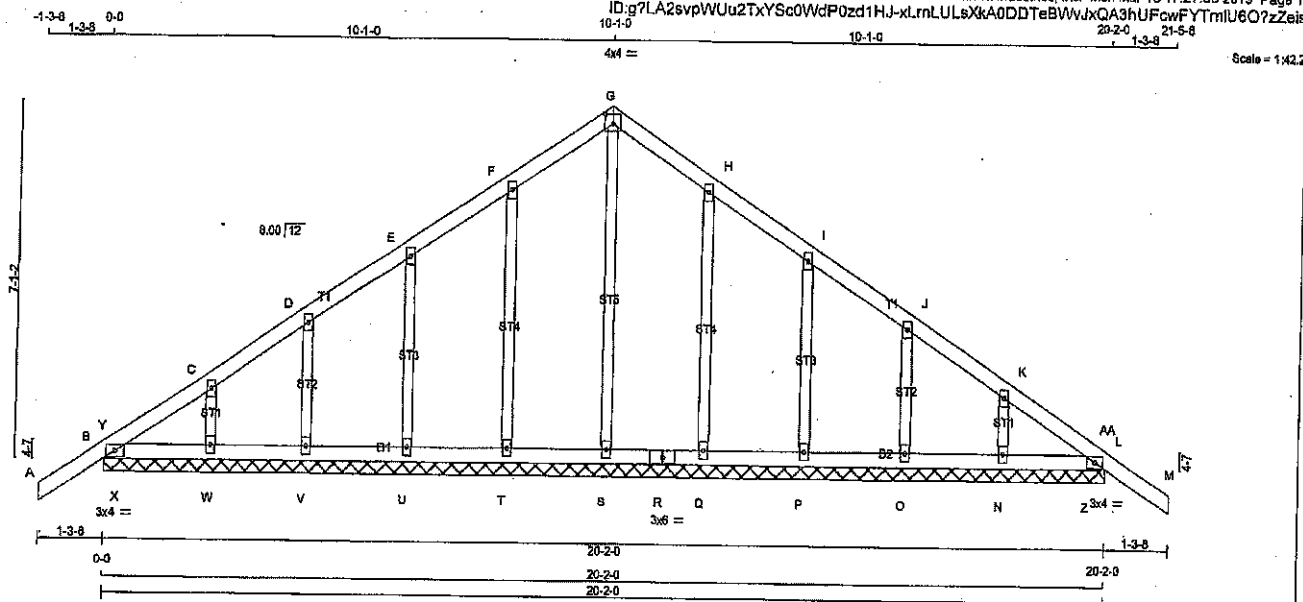

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - G	2x4	DRY	No.2
G - M	2x4	DRY	No.2
B - R	2x4	DRY	No.2
R - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT	2'-0" OC.		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED L _{C1} (LBS)	MAX. FACTORED UNBRACED LENGTH (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED L _{C1} (LBS)
FR-TO		FROM TO			FR-TO		
A-B	0/37	-102.1 -102.1	0.14 (1)	10.00	S-G	-138/0	0.12 (1)
B-Y	-67/0	-102.1 -102.1	0.01 (4)	8.25	T-F	-232/0	0.12 (1)
Y-C	-48/0	-102.1 -102.1	0.05 (1)	8.25	U-E	-196/0	0.05 (1)
C-D	-47/0	-102.1 -102.1	0.05 (1)	8.25	V-D	-199/0	0.04 (1)
D-E	-39/0	-102.1 -102.1	0.05 (1)	8.25	W-C	-205/0	0.03 (1)
E-F	-31/0	-102.1 -102.1	0.06 (1)	8.25	Q-H	-232/0	0.12 (1)
F-G	-41/0	-102.1 -102.1	0.06 (1)	8.25	P-I	-186/0	0.06 (1)
G-H	-41/0	-102.1 -102.1	0.06 (1)	8.25	C-J	-199/0	0.04 (1)
H-I	-31/0	-102.1 -102.1	0.05 (1)	8.25	N-K	-205/0	0.03 (1)
I-J	-39/0	-102.1 -102.1	0.05 (1)	8.25	X-Y	-68/2	0.00 (1)
J-K	-47/0	-102.1 -102.1	0.05 (1)	8.25	Z-AA	-68/2	0.00 (1)
K-AA	-48/0	-102.1 -102.1	0.01 (4)	8.25			
AA-L	-87/0	-102.1 -102.1	0.14 (1)	10.00			
L-M	0/37	-102.1 -102.1	0.14 (1)	10.00			
B-X	0/50	-18.5 -18.5	0.04 (1)	10.00			
X-W	0/50	-18.5 -18.5	0.04 (1)	10.00			
W-V	0/38	-18.5 -18.5	0.02 (1)	10.00			
V-U	0/32	-18.5 -18.5	0.02 (4)	10.00			
U-T	0/28	-18.5 -18.5	0.02 (4)	10.00			
T-S	0/25	-18.5 -18.5	0.02 (4)	10.00			
S-R	0/25	-18.5 -18.5	0.02 (4)	10.00			
R-Q	0/25	-18.5 -18.5	0.02 (4)	10.00			
Q-P	0/28	-18.5 -18.5	0.02 (4)	10.00			
P-O	0/32	-18.5 -18.5	0.02 (4)	10.00			
O-N	0/38	-18.5 -18.5	0.02 (1)	10.00			
N-Z	0/50	-18.5 -18.5	0.04 (1)	10.00			
Z-L	0/50	-18.5 -18.5	0.04 (1)	10.00			

PLATES (Table in Inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMB1-I	MT20	3.0	4.0	
C, D, E, F, H, I, J, K				
C TMB1-w	MT20	2.0	4.0	
G TTB-p	MT20	4.0	4.0	2.25 2.00
L TMB1-I	MT20	3.0	4.0	
N, O, P, Q, S, T, U, V, W				
N BMB1-w	MT20	2.0	4.0	
R BS-I	MT20	3.0	6.0	

TOTAL WEIGHT = 2 X 81 = 161 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (L-M:1), BC=0.04/1.00 (B-X:1),
WB=0.12/1.00 (H-Q:1), SS=0.09/1.00 (L-M:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.47 (G) (INPUT = 0.90)
JSI METAL= 0.12 (H) (INPUT = 1.00)

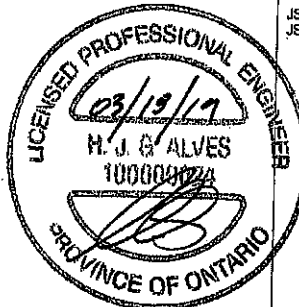

RECEIVED
AUG 15 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO.

DRWG NO. TAM T1902473
STRUCTURAL
FOR PERMIT ONLY

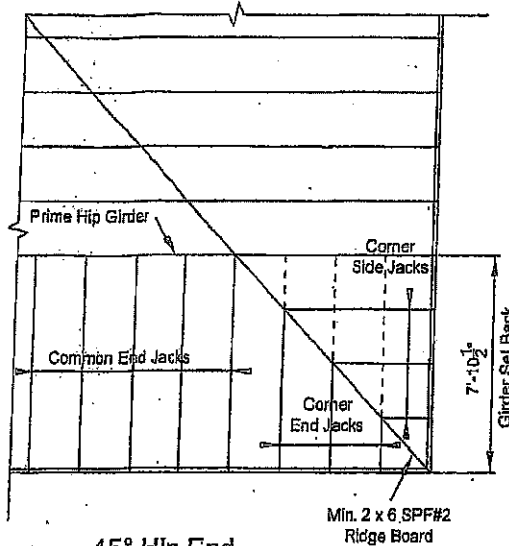

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD

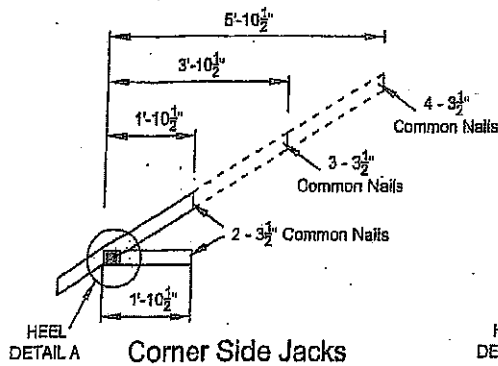


Corner Side Jacks

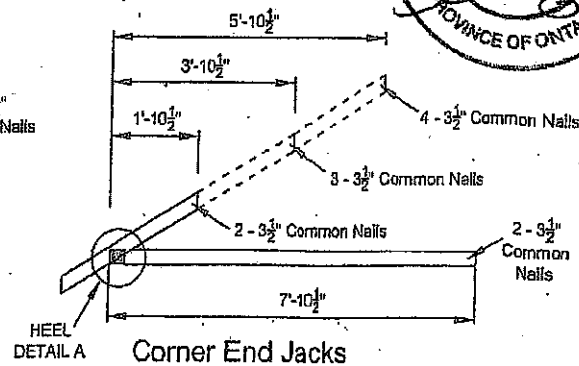

Corner End Jacks

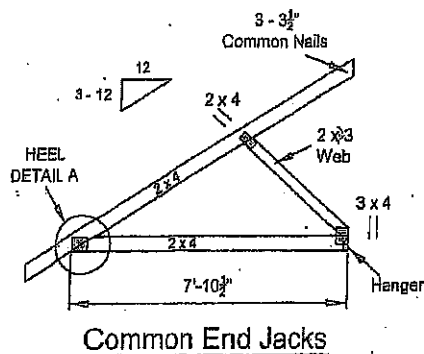


Common End Jacks

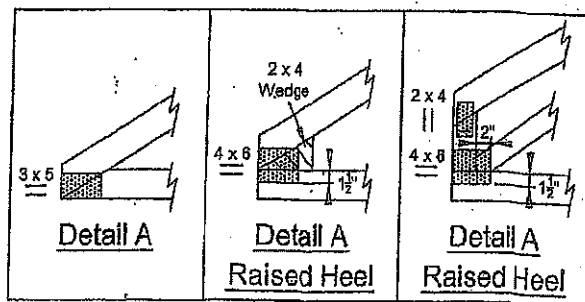

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800217

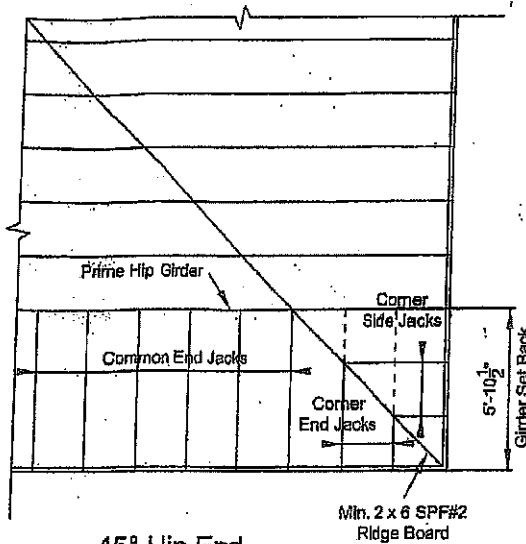

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.

TOTAL LOAD : 50.5 P.S.F

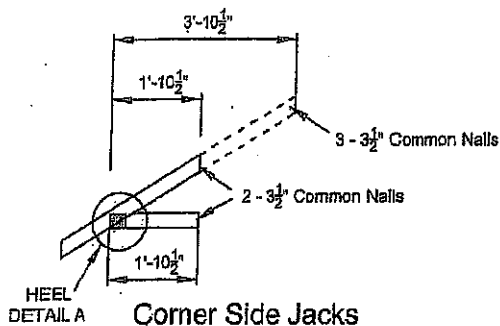


Corner Side Jacks

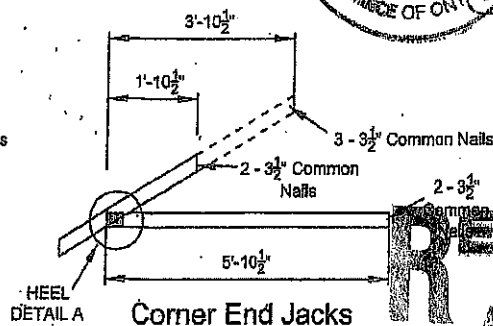


Corner End Jacks


RECEIVED
 AUG 15 2019

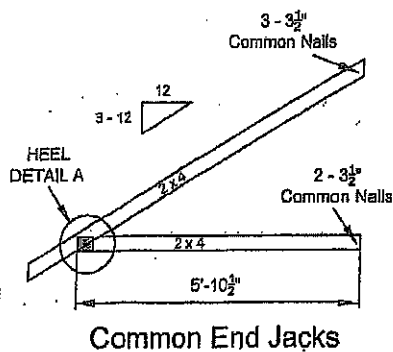


Common End Jacks



Detail A



**Detail A
 Raised Heel**



**Detail A
 Raised Heel**

TOWN OF CALEDON
 BUILDING SECTION

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)


T-1800216

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0 1/4" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- IPIC: Truss Design Procedures and Specifications for Light Metal Plate-Connected Wood Trusses
DSB-89: Design Standard for Bracing
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

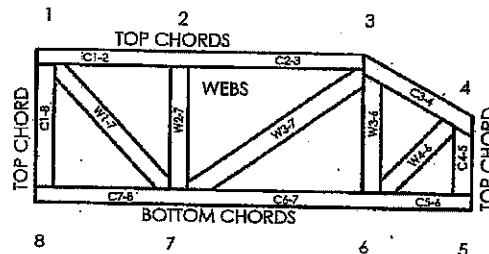

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-'08


General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by IPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with IPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with IPIC Quality Criteria.

RECEIVED
AUG 15 2019

TOWN OF CALEDON
BUILDING SECTION
FILE NO



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

T-1900219

Feb 09, 2018

THIS STRUCTURE MUST BE
CONSTRUCTED TO MEET OR
EXCEED THE PROVISIONS OF

THE ONTARIO BUILDING CODE