


GALE 1B
TH 95-2 / 1
TH 96-3 / 1
401786
19-07-00

GALE 1B
TH 95-1 / 1
TH 96-2 / 1
401787
19-07-00

ASPHALT SHINGLES
12" FINISHED OH.
STD HEEL
2X4 EXTERIOR WALLS
2X6 FASCIA BOARD

DESIGN CONFORMS
WITH O.B.C. 2012 PART 9
DESIGN LOADS:
SNOW LOAD 29.02 PSF
TC DEAD 6 PSF
BC LIVE 10.5 PSF
BC DEAD 7 PSF

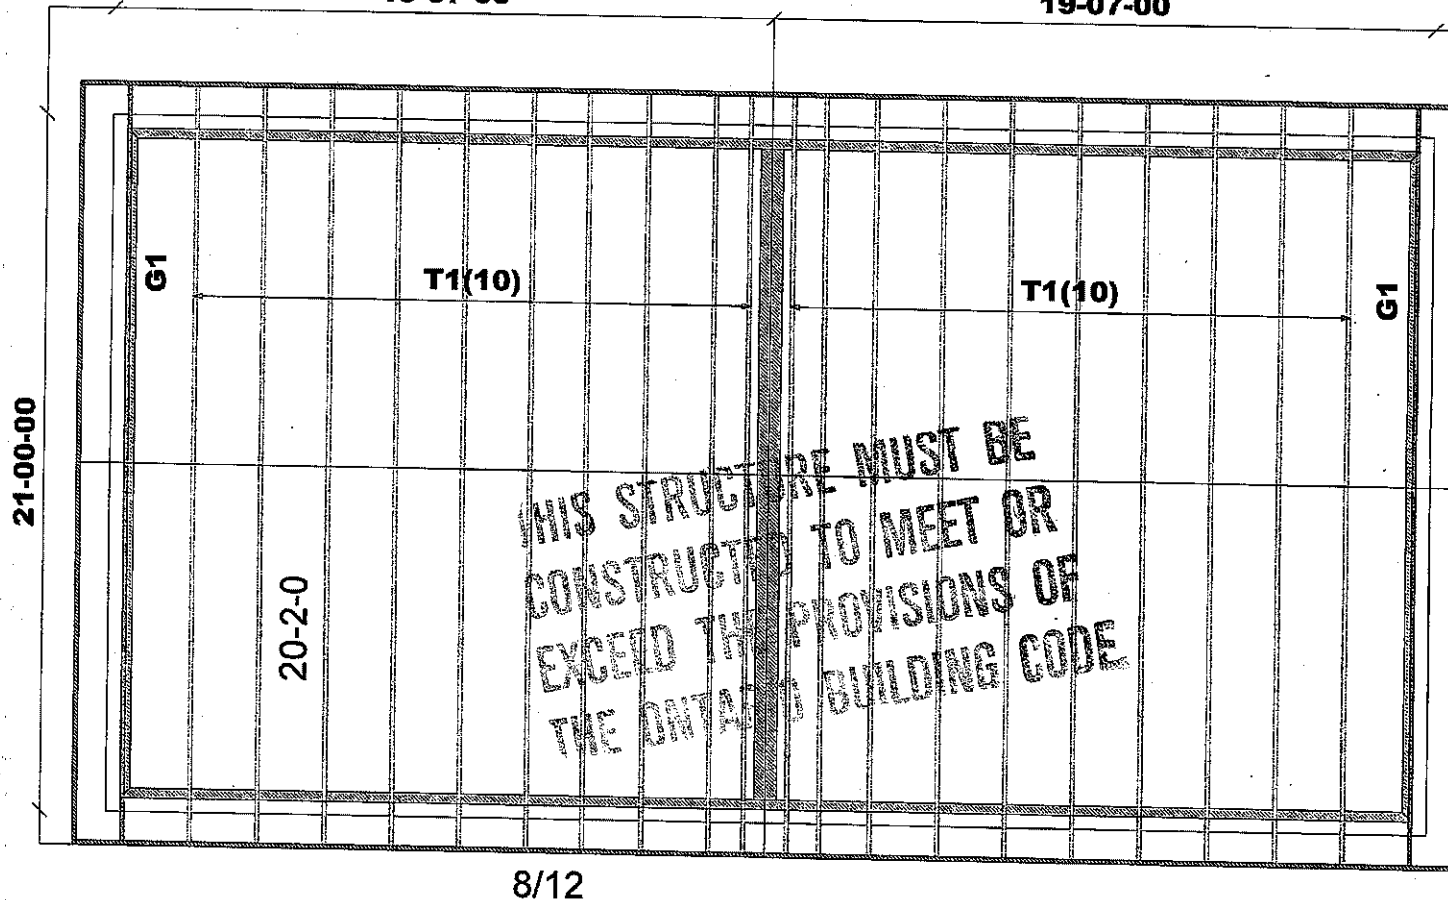

ALL CONV. FRAMING TO CONFORM WITH PART 9 OF O.B.C. 2012
 IN ROOF SAIL FIRST NAIL CROSS MEET OVER TRUSSES TO BE 2X4
 N 6" @ 24" O.C. WITH A 2X4 VERT. POST TO THE TRUSS
 UNDER NEATH AT EACH CROSS PT. VERT. POST LONGER THAN 6"
 TO HAVE LATERAL BRACING SO THAT THE DISTANCE BETWEEN
 END OF BRACING DOES NOT EXCEED 6"

RECEIVED



Job Track: **50033**
 Plan Log: **200645**
 Layout ID: **401785**

Builder / Location:

GREEN PARK HOMES / CALEDON

Project: **LAMBERT LANE PH.2**

Date: **3/8/2019** Sales: **Mario DiCano** Designer: **AC**

Model / Elevation:

GALE 1B / 1

Block 95-4


THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Millk ver 8.2.3.229

GALE 1B
TH 95-4 / 4
TH 96-5 / 3
401789


GALE 1B
TH 95-3 / 5
TH 96-4 / 2
401790

ASPHALT SHINGLES
12" FINISHED OH.
STD HEEL
2X4 EXTERIOR WALLS
2X6 FASCIA BOARD

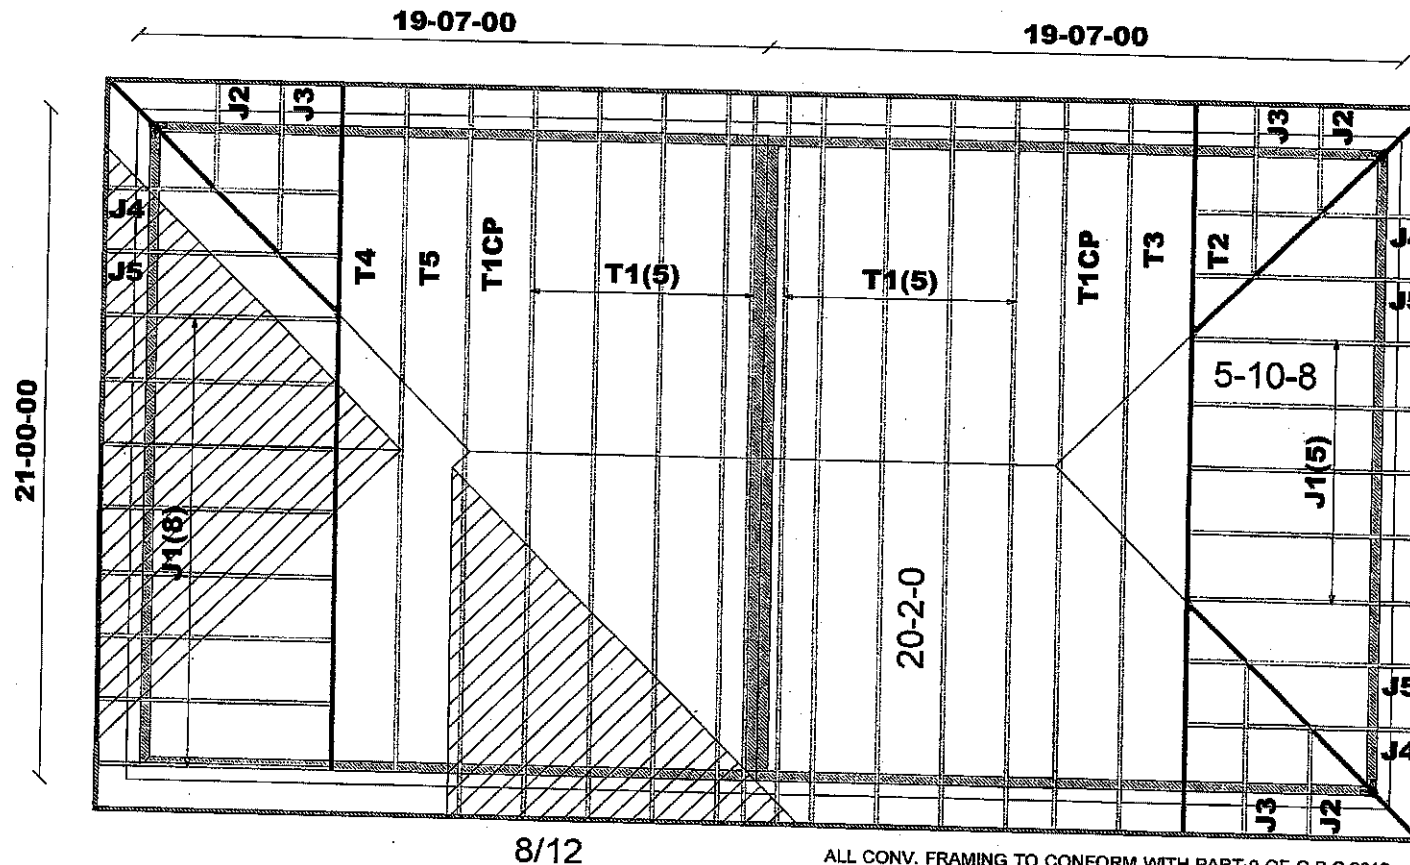

DESIGN CONFORMS
WITH O.B.C.2012 PART 9
DESIGN LOADS:
SNOW LOAD 29.02 PSF
TC DEAD 6 PSF
BC LIVE 10.5 PSF
BC DEAD 7 PSF

DENOTES
CONV.
FRAMING



Job Track: **50033**
 Plan Log: **200646**
 Layout ID: **401788**

Builder / Location:

GREEN PARK HOMES / CALEDON

Project: **LAMBERT LANE PH.2**

Date: **3/8/2019**

Sales: **Mario DiCano**

Designer: **AC**

Model / Elevation:

GALE 1B / 2, 3, 4, 5

THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.

Milek ver 3.2.3.229



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: GALE 1B
 Lot #:
 Elevation: TH95-1 / 1

Job Track: 50033
 PlanLog: 200645
 Layout ID: 401786
 Ref #
 Page: 1 of 1
 Date: 03/09/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	10	T1 Common	8 / 12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	722.64 446.67		
	1	G1 GABLE	8 / 12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	80.64 51.17		

TOTAL # TRUSS= 11

TOTAL BFT OF ALL TRUSSES= 497.84

BFT. TOTAL WEIGHT OF ALL TRSSES 803.28 LBS

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: GALE 1B
 Lot #:
 Elevation: TH95-2 / 1

Job Track: 50033
 PlanLog: 200645
 Layout ID: 401787
 Ref #
 Page: 1 of 1
 Date: 03/09/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses


PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	10	T1 Common	8 / 12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	722.64 446.67		
	1	G1 GABLE	8 / 12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	80.64 51.17		

TOTAL # TRUSS= 11

TOTAL BFT OF ALL TRUSSES= 497.84

BFT.

TOTAL WEIGHT OF ALL TRSSES 803.28 LBS



DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: LAMBERT LANE PH.2
 Location: CALEDON
 Model: GALE 1B
 Lot #:
 Elevation:

Job Track: 50033
 PlanLog: 200646
 Layout ID: 401789
 Ref #
 Page: 1 of 1
 Date: 03/09/2019
 Designer: Andrew Conway
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	5	T1 Common	8 /12	20-02-00	7-11-03	2 x 4	1-03-08 1-03-08	4-07 4-07	361.32 223.33		
	1	T1CP Hip	8 /12	20-02-00	7-09-09	2 x 4	1-03-08 1-03-08	4-07 4-07	72.09 44.67		
	1	T4 Half Hip Girder	8 /12	20-02-00	5-01-09	2 x 4	1-03-08	4-07 4-03-07	79.99 50.33		
	1	T5 Half Hip	8 /12	20-02-00	6-05-09	2 x 4	1-03-08	4-07 5-07-07	79.94 51.17		
	8	J1 Jack-Open	8 /12	5-10-08	5-01-09	2 x 4	1-03-08	4-07 4-03-07	133.94 80.00		
	1	J2 Jack-Open	8 /12	1-10-15	2-05-13	2 x 4	1-03-08 1-01	4-07 1-07-12	6.89 4.67		
	1	J3 Jack-Open	8 /12	2-00-00	3-09-13	2 x 4	1-03-08 1-10-15	4-07 1-08-07	9.63 6.00		
	1	J4 Jack-Open	8 /12	1-10-15	2-05-13	2 x 4	1-03-08 3-11-09	4-07 1-07-12	11.31 7.33		
	1	J5 Jack-Open	8 /12	3-10-15	3-09-13	2 x 4	1-03-08 1-11-09	4-07 2-11-12	14.05 8.67		

TOTAL # TRUSS= 20

TOTAL BFT OF ALL TRUSSES= 476.17

BFT. TOTAL WEIGHT OF ALL TRSSES 769.17 LBS

DELIVERY SHIPLIST

Lumber Yard: TAMARACK LUMBER
Builder: GREEN PARK HOMES
Project: LAMBERT LANE PH.2
Location: CALEDON
Model: GALE 1B

Job Track:	50033
PlanLog:	200646
Layout ID:	401790
Ref #	
Page:	1 of 1
Date:	03/09/2019
Designer:	Andrew Conway
Sales Rep:	Mario DiCano

Roof Trusses

[illegible]

TOTAL # TRUSS= 21

TOTAL BFT OF ALL TRUSSES= 468.49

BFT:


TOTAL WEIGHT OF ALL TRSSES 752.24 LBS

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
401788	T1	10	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MTsk Industries, Inc. Mon Mar 18 17:29:32 2019 Page 1

ID:UoHQ90YyJFCG5Y3nXIDmzclez-OrPdvUmFzhvPICv7YaWIA8W0_e60q81hgSKo0jzZeh1

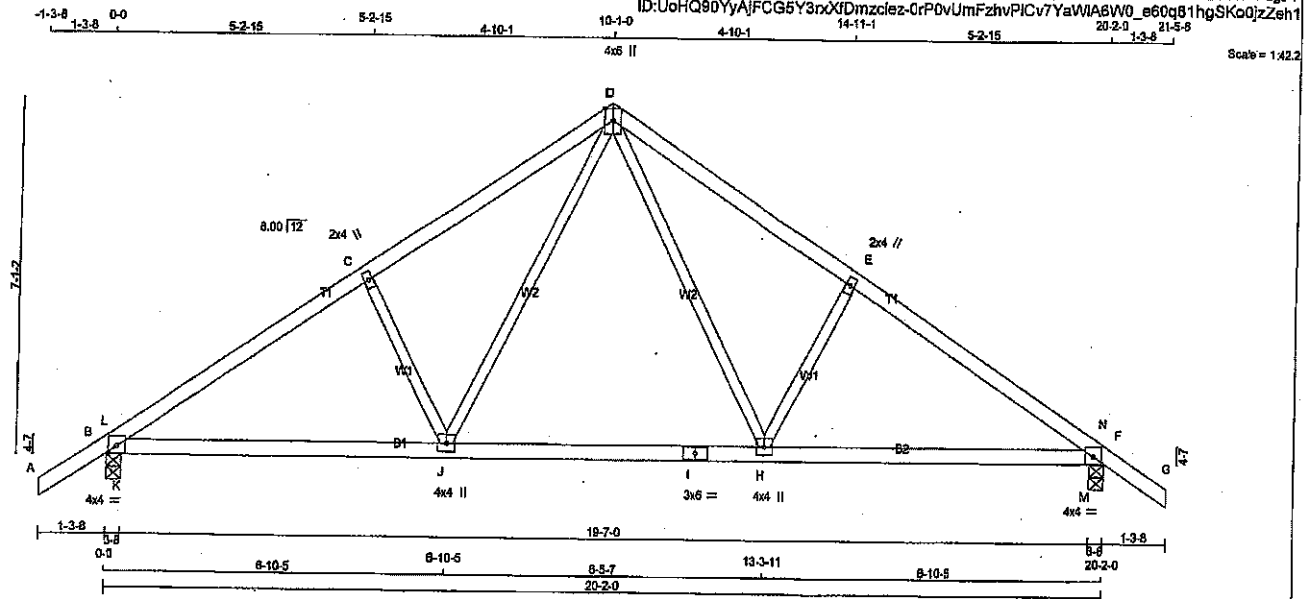

TOTAL WEIGHT = 10 X 72 = 723 lb

LUMBER

N. L. G. A. RULES

CHORDS SIZE

A - D 2x4 DRY

D - G 2x4 DRY

B - I 2x4 DRY

I - F 2x4 DRY

ALL WEBS 2x3 DRY

DRY: SEASONED LUMBER.

LUMBER

No.2

No.2

No.2

No.2

No.2

DESCR.

SPF

SPF

SPF

SPF

SPF

PLATES (table is in inches)

JT TYPE PLATES

B TMB1-I MT20

C TMW+w MT20

D TTWW+p MT20

E TMW+w MT20

F TMB1-I MT20

H BMWW+t MT20

I BS-I MT20

J BMWW+t MT20

W LEN Y X

4.0 4.0 1.75 2.00

2.0 4.0

4.0 6.0 Edge

2.0 4.0

4.0 4.0 1.75 2.00

4.0 4.0

3.0 6.0

4.0 4.0

Edge - INDICATES REFERENCE CORNER OF PLATE

TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
	VERT	DOWN	HORIZ	UPLIFT
	IN-SX	IN-SX	IN-SX	IN-SX
B	1355	0	1355	0
F	1355	0	1355	0

UNFACTORED REACTIONS

JT	1ST LCASE	MAX/MIN. COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
	COMBINED	SNOW	PERM. LIVE	WIND	DEAD	SOIL
B	952	665 / 0	0 / 0	0 / 0	287 / 0	0 / 0
F	952	665 / 0	0 / 0	0 / 0	287 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY
APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED	FORCE	VERT. LOAD	LC1	MAX	CS1 (LC)	UNBRAC	LENGTH	FR-TO	MEMB.	MAX. FACTORED	FORCE	MAX	CS1 (LC)
A-B	0 / 37	-102.1	-102.1	0.14	(1)	10.00	0 / 661	0.15	(1)						
B-L	-1747 / 0	-102.1	-102.1	0.07	(1)	5.00	H-E	-508 / 0	0.13	(1)					
L-C	-1666 / 0	-102.1	-102.1	0.34	(1)	4.80	J-D	0 / 661	0.15	(1)					
C-D	-1458 / 0	-102.1	-102.1	0.33	(1)	5.07	C-J	-508 / 0	0.13	(1)					
D-E	-1458 / 0	-102.1	-102.1	0.33	(1)	5.07	K-L	-117 / 132	0.00	(1)					
E-N	-1666 / 0	-102.1	-102.1	0.34	(1)	4.80	M-N	-117 / 132	0.00	(1)					
N-F	-1747 / 0	-102.1	-102.1	0.07	(1)	5.00									
F-G	0 / 37	-102.1	-102.1	0.14	(1)	10.00									
B-K	0 / 1409	-18.5	-18.5	0.29	(1)	10.00									
K-J	0 / 1409	-18.5	-18.5	0.35	(1)	10.00									
J-I	0 / 903	-18.5	-18.5	0.25	(1)	10.00									
I-H	0 / 603	-18.5	-18.5	0.25	(1)	10.00									
H-M	0 / 1409	-18.5	-18.5	0.35	(1)	10.00									
M-F	0 / 1409	-18.5	-18.5	0.29	(1)	10.00									

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF

DL = 6.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL
OR SMALL BUILDING REQUIREMENTS OF
PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 988-09, CSA 988-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F.
RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED
ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.87")
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.87")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TO=0.34/1.00 (C-L:1), BC=0.35/1.00 (J-K:1),
WB=0.15/1.00 (D-J:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN
THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (F) (INPUT = 0.90)
JSI METAL= 0.68 (B) (INPUT = 1.00)

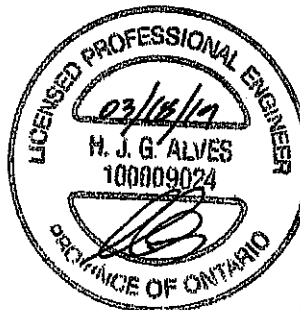

DRWG NO. TAM 7905975
STRUCTURAL
COMPONENT ONLY

JOB NAME 401788	TRUSS NAME T1CP	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

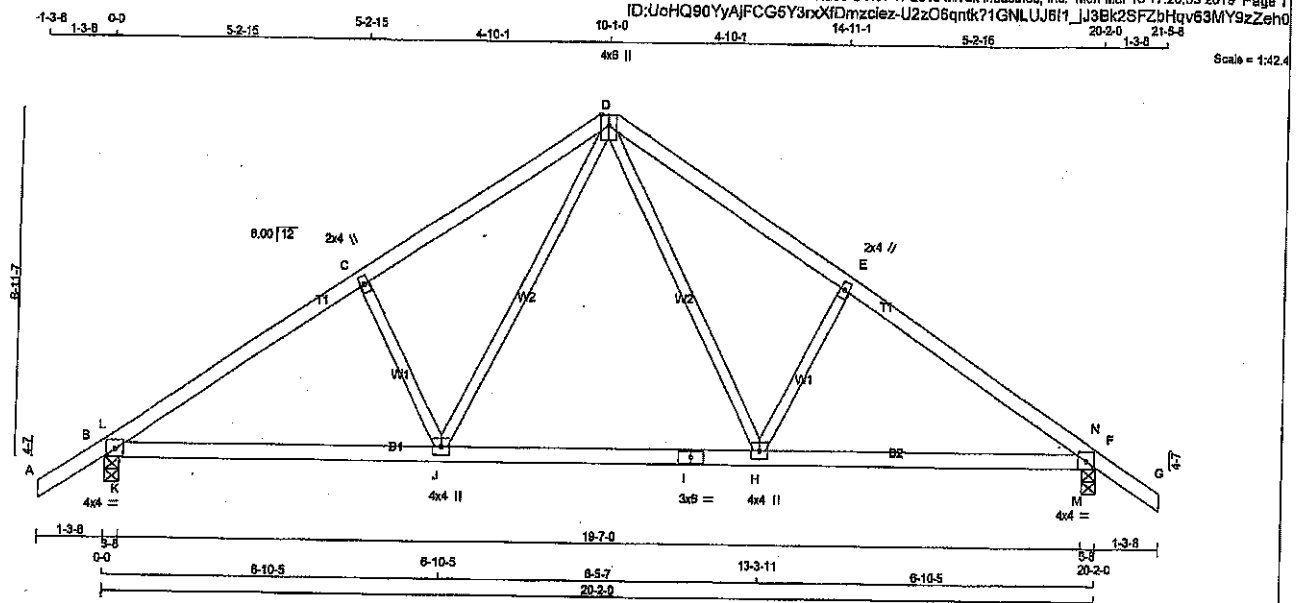

<u>LUMBER</u>					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER	DESCR	
A - D	2x4	DRY	No.2	SPF	
D - G	2x4	DRY	No.2	SPF	
B - I	2x4	DRY	No.2	SPF	
I - F	2x4	DRY	No.2	SPF	
ALL WEBS		2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.					

PLATES (table is in inches)	W	LEN	Y	X
B-TMB1-H	MT20	4.0	4.0	1.75 2.00
C-TMW+H	MT20	2.0	4.0	
D-TTW+H	MT20	4.0	6.0	Edge
E-TMW+H	MT20	2.0	4.0	
F-TMB1-H	MT20	4.0	4.0	1.75 2.00
H-BMW+H	MT20	4.0	4.0	
I-BS-1	MT20	3.0	6.0	
J-BMW+H	MT20	4.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	DOWN	UPLIFT	IN-SX
B	1356	0	0	3-8
F	1356	0	0	3-8

UNFACTORED REACTIONS

1ST CASE	MAX/MIN COMPONENT REACTIONS
JT	COMBINED
B	952
F	952

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.80 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)
FR-TO				FR-TO	
A-B	0/37	-102.1	10.00	D-H	0/661
B-L	-1747/0	-102.1	5.00	H-E	-508/0
L-C	-1688/0	-102.1	4.80	J-D	0/661
C-D	-1458/0	-102.1	5.07	C-J	-508/0
D-E	-1458/0	-102.1	5.07	K-L	-117/132
E-N	-1688/0	-102.1	4.80	M-N	-117/132
N-F	-1747/0	-102.1	5.00		
F-G	0/37	-102.1	10.00		
B-K	0/1409	-18.5	10.00		
K-J	0/1409	-18.5	10.00		
J-I	0/803	-18.5	10.00		
I-H	0/803	-18.5	10.00		
H-M	0/1409	-18.5	10.00		
M-F	0/1409	-18.5	10.00		

TOTAL WEIGHT = 2 X 72 = 144 LB

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.67")
CALCULATED VERT. DEFL.(LL) = L/989 (0.05")
ALLOWABLE DEFL.(TL) = L/360 (0.67")
CALCULATED VERT. DEFL.(TL) = L/989 (0.12")

CSI: TC=0.34/1.00 (C-L1), BC=0.36/1.00 (J-K1),
WB=0.15/1.00 (D-J1), SSI=0.20/1.00 (C-D1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1697 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

SSI GRIP=0.80 (F) (INPUT = 0.90)
SSI METAL=0.68 (B) (INPUT = 1.00)

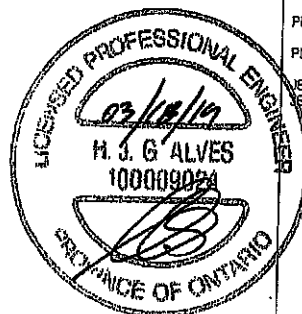

DRWG NO. TAM 17905476
STRUCTURAL
COMPONENT ONLY

JOB NAME 401785	TRUSS NAME G1	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

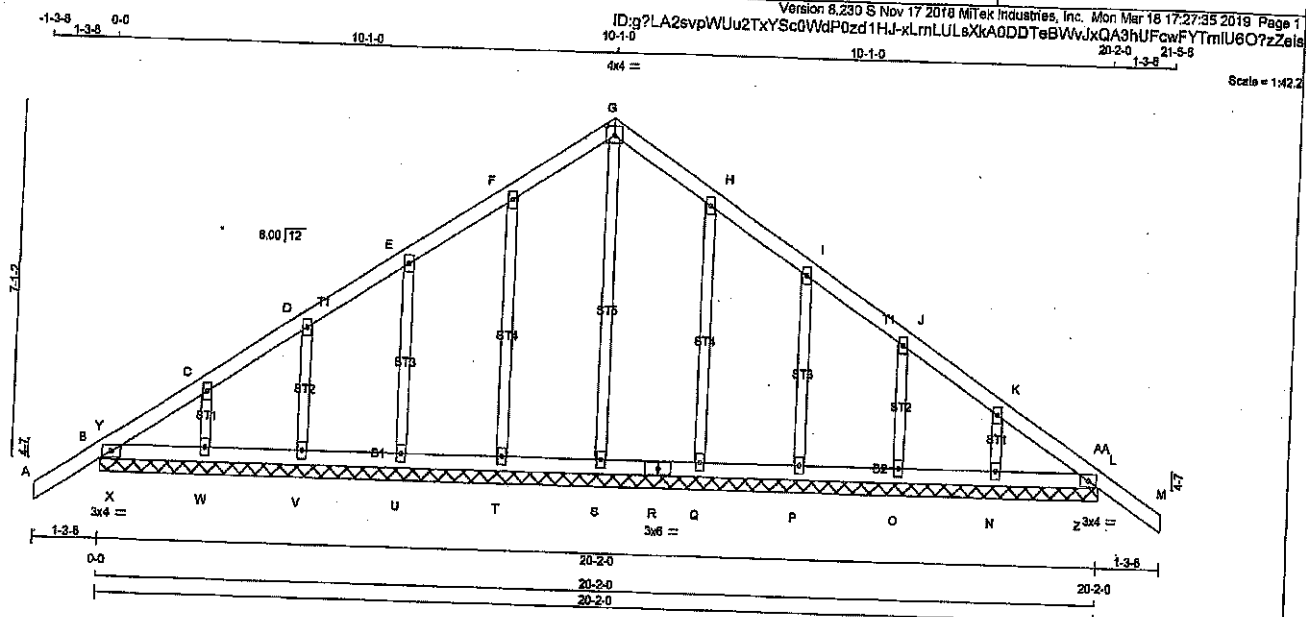

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - G	2x4	DRY	No.2
G - M	2x4	DRY	No.2
B - R	2x4	DRY	No.2
R - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2'-0" OC.			

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMB1-I	MT20	3.0	4.0	
C, D, E, F, H, I, J, K				
G TMB1-I	MT20	2.0	4.0	
H TMB1-I	MT20	4.0	4.0	2.25 2.00
L TMB1-I	MT20	3.0	4.0	
N, O, P, Q, S, T, U, V, W				
N BMW1-I	MT20	2.0	4.0	
R BS-I	MT20	3.0	6.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0/37	-102.1	-102.1	0.14 (1)	10.00	S-G	-138/0
B-Y	-57/0	-102.1	-102.1	0.01 (4)	8.25	T-F	-232/0
Y-C	-48/0	-102.1	-102.1	0.05 (1)	8.25	U-E	-198/0
C-D	-47/0	-102.1	-102.1	0.05 (1)	8.25	V-D	-189/0
D-E	-39/0	-102.1	-102.1	0.05 (1)	8.25	W-C	-205/0
E-F	-31/0	-102.1	-102.1	0.06 (1)	8.25	Q-H	-232/0
F-G	-41/0	-102.1	-102.1	0.06 (1)	8.25	P-I	-196/0
H-I	-41/0	-102.1	-102.1	0.08 (1)	6.25	O-J	-199/0
I-J	-31/0	-102.1	-102.1	0.08 (1)	6.25	N-K	-205/0
J-K	-39/0	-102.1	-102.1	0.05 (1)	8.25	X-Y	-58/2
K-AA	-48/0	-102.1	-102.1	0.05 (1)	6.25	Z-AA	-68/2
AA-L	-57/0	-102.1	-102.1	0.01 (4)	8.25		
L-M	0/37	-102.1	-102.1	0.14 (1)	10.00		
B-X	0/50	-18.5	-18.5	0.04 (1)	10.00		
X-W	0/50	-18.5	-18.5	0.04 (1)	10.00		
W-V	0/38	-18.5	-18.5	0.02 (1)	10.00		
V-U	0/32	-18.5	-18.5	0.02 (4)	10.00		
U-T	0/28	-18.5	-18.5	0.02 (4)	10.00		
T-S	0/25	-18.5	-18.5	0.02 (4)	10.00		
S-R	0/25	-18.5	-18.5	0.02 (4)	10.00		
R-Q	0/25	-18.5	-18.5	0.02 (4)	10.00		
Q-P	0/28	-18.5	-18.5	0.02 (4)	10.00		
P-O	0/32	-18.5	-18.5	0.02 (4)	10.00		
O-N	0/38	-18.5	-18.5	0.02 (1)	10.00		
N-Z	0/50	-18.5	-18.5	0.04 (1)	10.00		
Z-L	0/50	-18.5	-18.5	0.04 (1)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(56% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.14/1.00 (L-M:1), BC=0.04/1.00 (B-X:1), WB=0.12/1.00 (H-Q:1), SSI=0.09/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1887 788 1687 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.47 (G) (INPUT = 0.80)
JSI METAL= 0.12 (H) (INPUT = 1.00)

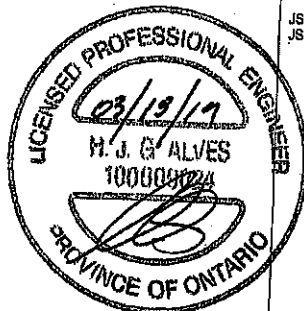

DRWG NO. TAM T1903473
STRUCTURAL
(COMPONENT ONLY)

JOB NAME 401788	TRUSS NAME T2	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.230 S Nov 17 2018 M Tek Industries, Inc. Mon Mar 18 17:29:34 2018 Page 1
 ID: UoHQ90YyAIFCG5Y3nXIDmzciez-yEXmKAnVVI97_V3V7YDFXbHySJUI1s_Bmpv4bzZeh?
 Scale = 1:36.0

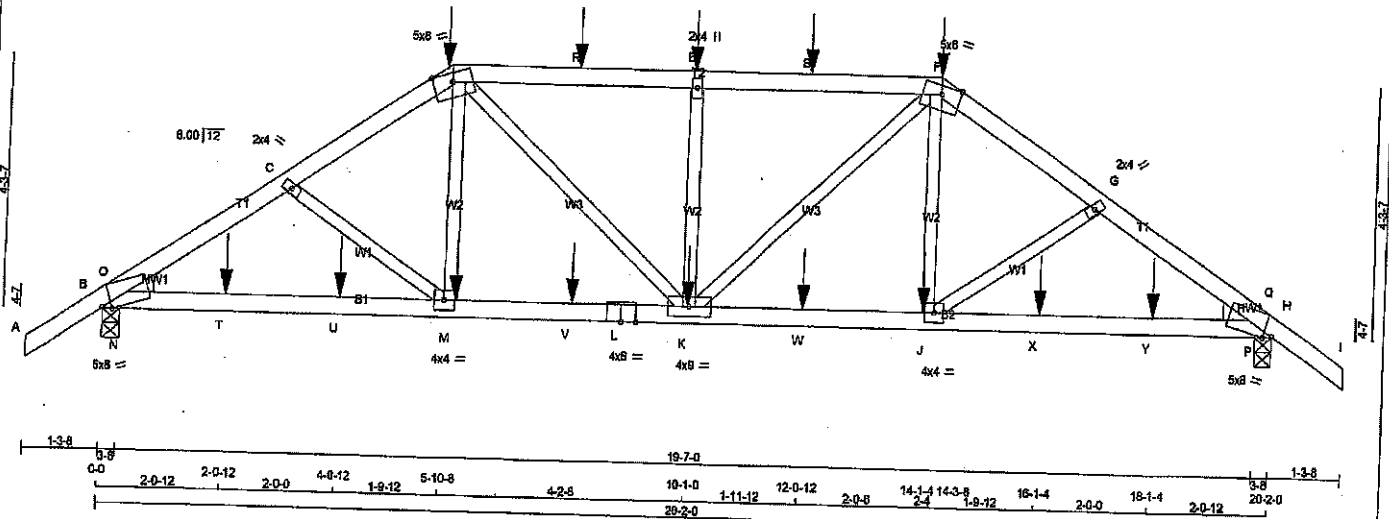

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
B - L	2x4	DRY No.2	SPF
L - H	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY
 DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMB1-m	MT20	5.0	8.0	Edge	1.75
C, E, G					
C TMW+w	MT20	2.0	4.0		
D TTWW-m	MT20	5.0	8.0	Edge	
F TTWW-m	MT20	5.0	8.0	Edge	
H TMB1-m	MT20	5.0	8.0	Edge	1.75
J BMWw-w	MT20	4.0	4.0		
K BMWw-w	MT20	4.0	8.0		
L BS-1	MT20	4.0	6.0		
M BMWw-w	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG IN-SX	REQD BRG IN-SX	HEEL WEDGE
JT VERT 1670	DOWN 2376	0	3-8	2x4 L
B 2376	HORIZ 0	0	3-8	2x4 R
H 2374	DOWN 2374	0	3-8	

UNFACTORED REACTIONS

1ST LOASE	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL
JT COMBINED	SNOW 1151 / 0	0 / 0	0 / 0
B 1670	LIVE 1151 / 0	0 / 0	0 / 0
H 1668	PERM. LIVE 1151 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, H

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.02 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LENGTH (LC)	
FR-TO	0 / 37	-102.1	-102.1	0.15 (1)	10.00	C-M	-291 / 0
A-B	0 / 37	-102.1	-102.1	0.19 (1)	10.00	M-D	0 / 443
B-O	-3807 / 0	-102.1	-102.1	0.28 (1)	3.49	D-K	0 / 783
O-C	-3530 / 0	-102.1	-102.1	0.27 (1)	3.62	K-E	-886 / 0
C-D	-3270 / 0	-102.1	-102.1	0.69 (1)	3.02	K-F	0 / 785
D-R	-3287 / 0	-102.1	-102.1	0.69 (1)	3.02	J-F	0 / 442
R-E	-3287 / 0	-102.1	-102.1	0.69 (1)	3.02	J-G	-291 / 0
E-S	-3287 / 0	-102.1	-102.1	0.69 (1)	3.02	N-O	0 / 308
S-F	-3287 / 0	-102.1	-102.1	0.27 (1)	3.62	P-Q	0 / 308
F-G	-3288 / 0	-102.1	-102.1	0.28 (1)	3.49		
G-Q	-3529 / 0	-102.1	-102.1	0.19 (1)	10.00		
Q-H	-3805 / 0	-102.1	-102.1	0.15 (1)	10.00		
H-I	0 / 37	-102.1	-102.1	0.15 (1)	10.00		
B-N	0 / 2943	-18.5	-18.5	0.61 (1)	10.00		
N-T	0 / 2943	-18.5	-18.5	0.67 (1)	10.00		
T-U	0 / 2943	-18.5	-18.5	0.67 (1)	10.00		
U-M	0 / 2943	-18.5	-18.5	0.67 (1)	10.00		
M-V	0 / 2718	-18.5	-18.5	0.62 (1)	10.00		
V-L	0 / 2718	-18.5	-18.5	0.62 (1)	10.00		
L-K	0 / 2718	-18.5	-18.5	0.62 (1)	10.00		
K-W	0 / 2717	-18.5	-18.5	0.62 (1)	10.00		
W-J	0 / 2717	-18.5	-18.5	0.62 (1)	10.00		
J-X	0 / 2942	-18.5	-18.5	0.67 (1)	10.00		
X-Y	0 / 2942	-18.5	-18.5	0.67 (1)	10.00		
Y-P	0 / 2942	-18.5	-18.5	0.67 (1)	10.00		
P-H	0 / 2942	-18.5	-18.5	0.61 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
D	5-10-8	-483	-483	---	BACK	VERT	---	---
E	10-0-12	-160	-160	---	BACK	VERT	---	---
F	14-3-8	-483	-483	---	BACK	VERT	---	---
J	14-1-4	-74	-74	---	BACK	VERT	---	---
K	10-0-12	-74	-74	---	BACK	VERT	---	---
M	6-0-12	-74	-74	---	BACK	VERT	---	---
R	8-0-12	-160	-160	---	BACK	VERT	---	---
S	12-0-12	-160	-160	---	BACK	VERT	---	---
T	2-0-12	-67	-67	---	BACK	VERT	---	---
U	4-0-12	-44	-44	---	BACK	VERT	---	---
V	8-0-12	-74	-74	---	BACK	VERT	---	---

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 29.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012
 - CSA 088-09, CSA 088-14
 - TPC 2011, TPC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.67")
 CALCULATED VERT. DEFL.(LL) = L/869 (0.10")
 ALLOWABLE DEFL.(TL) = L/360 (0.67")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.69/1.00 (D-E:1), BC=0.67/1.00 (M-N:1),
 WB=0.26/1.00 (E-H:1), SSI=0.32/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1887	788	1987

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP=0.76 (D) (INPUT = 0.90)
 JSI METAL=0.83 (L) (INPUT = 1.00)

DRWG NO. TAM 1905477
 STRUCTURAL

JOB NAME 401788	TRUSS NAME T2	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington						

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Mon Mar 18 17:29:35 2019 Page 2
 ID:UoHQ90YyAjFCG8Y3nxXfDmzciez-QQ58XWo7GcH_cfeIDJ3Sok8Ris2l1U67MQYtc22Zeh


FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
W	12-0-12	-74	-74	—	BACK	VERT	TOTAL	—	—
X	18-1-4	-44	-44	—	BACK	VERT	TOTAL	—	—
Y	18-1-4	-67	-67	—	BACK	VERT	TOTAL	—	—

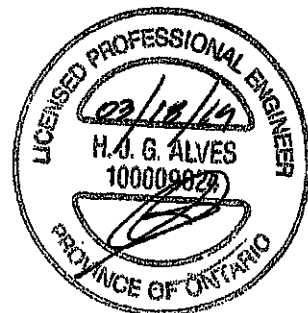

DWG NO. TAM **71905477**
 STRUCTURAL
 COMPONENT ONLY **3/2**

JOB NAME 401788	TRUSS NAME T3	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Mon Mar 18 17:29:38 2018 Page 1	

1-3-8 0-0 4-1-11 4-1-11 3-8-13 7-10-8 4-5-0 12-3-8 3-8-13 16-0-5 4-1-11 20-2-0 21-5-8
 ID: UoHQ90YyAIFCG5Y3rxXfDmzciz-udfWlpm1wQrEpDunQahKxh4GTumykHb3108UzZegz
 Scale = 1:38.0

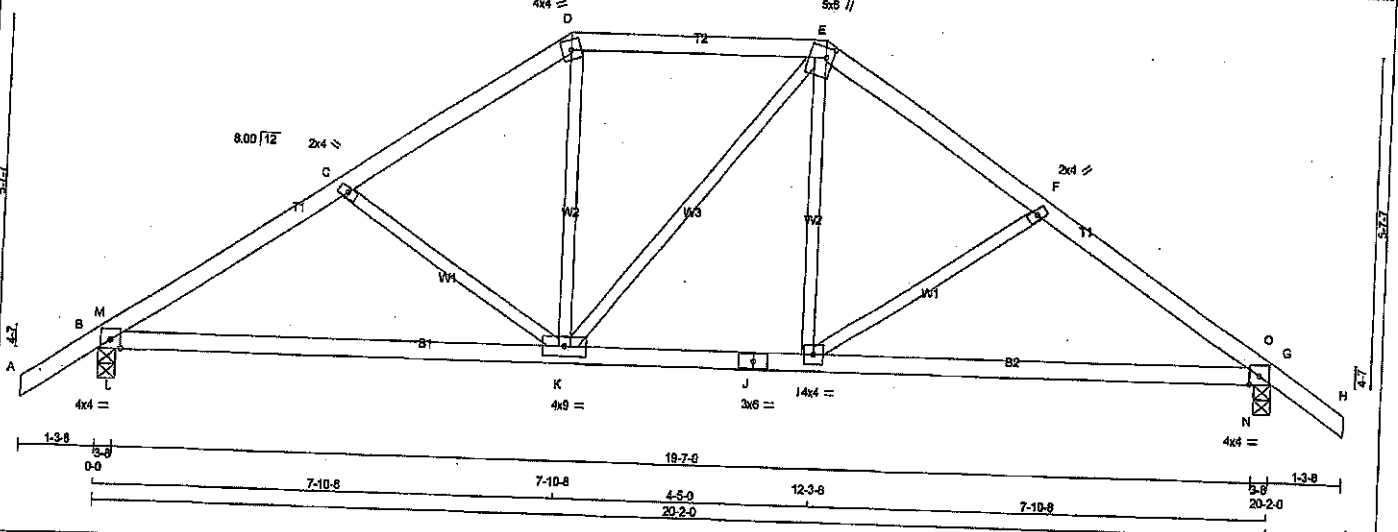

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE
 A - D 2x4 DRY No.2
 D - E 2x4 DRY No.2
 E - H 2x4 DRY No.2
 B - J 2x4 DRY No.2
 J - G 2x4 DRY No.2
 ALL WEBS 2x3 DRY No.2
 DRY: SEASONED LUMBER

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER		BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	FACTORED	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UPLIFT	BRG	IN-SX	BRG	IN-SX
B	1356	0	1356	0	0	0	0	3-8	3-8	3-8	3-8
G	1356	0	1356	0	0	0	0	3-8	3-8	3-8	3-8

UNFACTORED REACTIONS
 1ST LC CASE
 JT COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
 B 952 665/0 0/0 0/0 0/0 287/0 0/0
 G 952 665/0 0/0 0/0 0/0 287/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, G
BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.82 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
FR-TO		FR-TO	
A-B	0/37	C-K	-432/0
B-M	-1891/0	K-D	0/366
M-C	-1727/0	D-E	0/0
C-D	-1356/0	E-F	0/365
D-E	-1113/0	F-G	-433/0
E-F	-1356/0	G-H	0/280
F-G	-1726/0	H-I	0/282
G-H	-1893/0		

DESIGN CRITERIA
 SPECIFIED LOADS:
 TOP CH. LL = 28.0 PSF
 DL = 8.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 42.4 PSF
 SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, OBC 2012
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(65 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.87")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.04")
 ALLOWABLE DEFL. (TL) = L/360 (0.87")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.14")

CSI: TC=0.27/1.00 (D-E-1), BC=0.36/1.00 (I-N-1), WB=0.17/1.00 (F-1), SS=0.25/1.00 (G-N-4)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches
 PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.80 (B) (INPUT = 0.90)
 JSI METAL= 0.89 (B) (INPUT = 1.00)

DRWG NO. TAM 71405478
 STRUCTURAL
 COMPONENT ONLY

RECEIVED
 JUN 05 2019
 TOWN OF CALEDON
 BUILDING SECTION
 FILE NO.

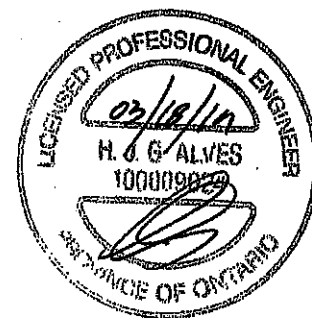


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
401788	T4	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Mon Mar 18 17:29:37 2019 Page 1
ID:UcHQ90YyAFCG5Y3nXfDmzclez-MpCvyCqOaDyIzso4L85w9DkIfkVJGIGqj1ZgwzZegY
10-7-12 15-3-12 20-2-0

Scale = 1/32.3

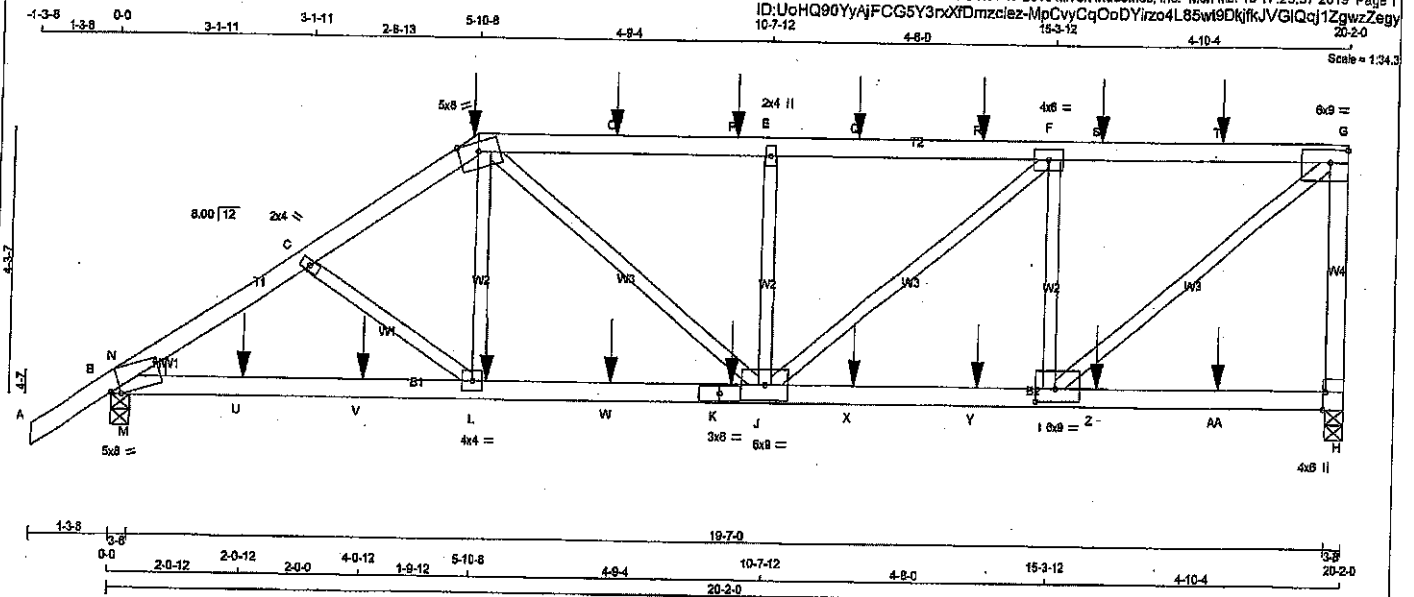

TOTAL WEIGHT = 80 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
K - H	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TM31-m	MT20	5.0	8.0	Edge	1.75
C	TMVW-w	MT20	2.0	4.0		
D	TTWV-m	MT20	5.0	8.0	Edge	
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-w	MT20	4.0	6.0		
G	TMVW-w	MT20	6.0	9.0	2.50	Edge
H	BMVW-w	MT20	4.0	6.0	Edge	0.50
I	BMVW-w	MT20	6.0	9.0	2.50	4.00
J	BMVW-w	MT20	6.0	9.0		
K	BS-1	MT20	3.0	8.0		
L	BMVW-w	MT20	4.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED	MAXIMUM FACTORED	INPUT	REQD	HEEL
GROSS REACTION	GROSS REACTION	BRG	BRG	WEDGE
JT	VERT	HORZ	UPLIFT	IN-SX
H	2305	0	2305	0
B	2337	0	2337	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS	DEAD	SOIL
JT	COMBINED	SNOW	LIVE	PERM
H	1622	1111 / 0	0 / 0	0 / 0
B	1643	1132 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.76 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE	VERT. LOAD	MEMB.	FORCE
(LBS)	(PLF)	LC1	(LBS)	(LBS)
FR-TO	FROM	TO	FR-TO	FROM
A-B	0 / 37	-102.1	C-L	-290 / 0
B-N	-3734 / 0	-102.1	L-D	0 / 457
N-C	-3468 / 0	-102.1	I-G	0 / 3083
C-D	-3206 / 0	-102.1	D-J	0 / 682
D-O	-3189 / 0	-102.1	I-F	-1652 / 0
O-P	-3189 / 0	-102.1	J-E	-910 / 0
P-Q	-3189 / 0	-102.1	J-F	0 / 1086
Q-R	-3189 / 0	-102.1	M-N	0 / 294
R-F	-3189 / 0	-102.1		
F-S	-2385 / 0	-102.1		
S-T	-2385 / 0	-102.1		
T-G	-2385 / 0	-102.1		
G-H	-2228 / 0	0.0		
B-M	0 / 2880	-18.5		
M-U	0 / 2880	-18.5		
U-V	0 / 2880	-18.5		
V-L	0 / 2880	-18.5		
L-W	0 / 2880	-18.5		
W-K	0 / 2880	-18.5		
K-J	0 / 2880	-18.5		
J-X	0 / 2385	-18.5		
X-Y	0 / 2385	-18.5		
Y-I	0 / 2385	-18.5		
I-Z	0 / 0	-18.5		
Z-AA	0 / 0	-18.5		
AA-H	0 / 0	-18.5		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX	FACE	DIR.	TYPE	HEEL	CONN.
D	5-10-8	-483	-483	FRONT	VERT	TOTAL	---	---
K	10-1-4	-74	-74	FRONT	VERT	TOTAL	---	---
L	6-1-4	-74	-74	FRONT	VERT	TOTAL	---	---
O	8-1-4	-160	-160	FRONT	VERT	TOTAL	---	---
P	10-1-4	-160	-160	FRONT	VERT	TOTAL	---	---
Q	12-1-4	-160	-160	FRONT	VERT	TOTAL	---	---
R	14-1-4	-160	-160	FRONT	VERT	TOTAL	---	---
S	16-1-4	-160	-160	FRONT	VERT	TOTAL	---	---
T	18-1-4	-160	-160	FRONT	VERT	TOTAL	---	---

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.67")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.67")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.65/1.00 (E-F-1), BC=0.67/1.00 (L-M-1), WB=0.78/1.00 (G-I-1), SSI=0.48/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

AIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.78 (I) (INPUT = 0.80)
JSI METAL= 0.81 (K) (INPUT = 1.00)

DWG NO. TAM 17905479
STRUCTURAL
COMPOUND SHIP 1/2

CONTINUED ON PAGE 2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
401788	T4	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 MITek Industries, Inc. Mon Mar 18 17:29:38 2019 Page 2
ID:UoHQ90YyAIFCG5Y3nXfDmzciez-r?mh9Xq0ZxgZIT7NHurd9QMmvT34YEI_a2Nn7CMzzegx

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
U	2-0-12	-67	-67	—	FRONT	VERT	TOTAL	—	—
V	4-0-12	-44	-44	—	FRONT	VERT	TOTAL	—	—
W	8-1-4	-74	-74	—	FRONT	VERT	TOTAL	—	—
X	12-1-4	-74	-74	—	FRONT	VERT	TOTAL	—	—
Y	14-1-4	-74	-74	—	FRONT	VERT	TOTAL	—	—
Z	16-1-4	-74	-74	—	FRONT	VERT	TOTAL	—	—
AA	18-1-4	-74	-74	—	FRONT	VERT	TOTAL	—	—

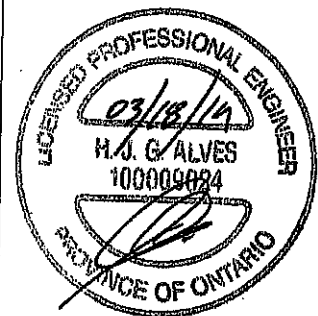

DWG NO. TAM 7705479
STRUCTURAL
COMPONENT ONLY 3/2

JOB NAME 401788	TRUSS NAME T5	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 6.230 S Nov 17 2018 MITek Industries, Inc. Mon Mar 16 17:29:36 2019 Page 1
ID:UoHQ90YyAjFCG5Y3nxXfDmzciaz-r7mH9Xq0ZgZT7NHurd9QMmxg39SEp1a2Nn7CMzZegx

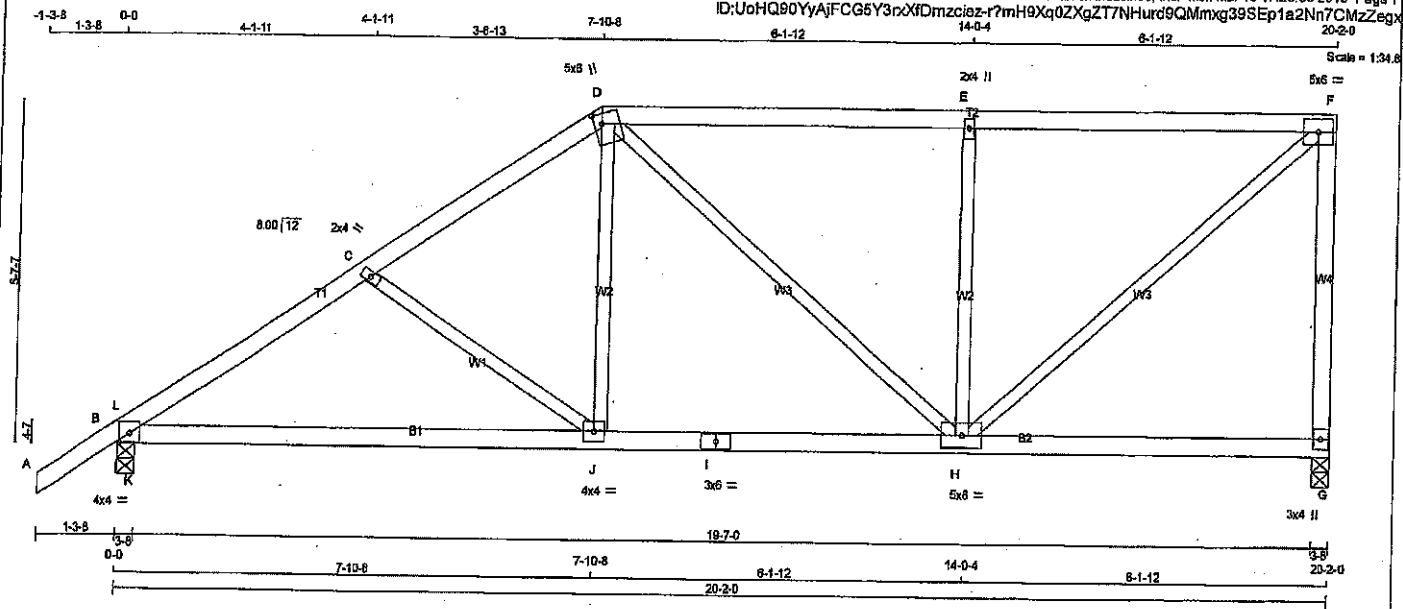

TOTAL WEIGHT = 80 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
B - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TM31-i	MT20	4.0	4.0	1.75 2.00
C	TM31-w	MT20	2.0	4.0	
D	TM31-w	MT20	5.0	6.0	2.00 1.50
E	TM31-w	MT20	2.0	4.0	
F	TM31-w	MT20	3.0	6.0	
G	BMV1-p	MT20	3.0	4.0	
H	BMV1-w	MT20	5.0	8.0	
I	BS-1	MT20	3.0	6.0	
J	BMV1-w	MT20	4.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG
G	1216	0		1216	0	0	IN-SX
B	1356	0		1356	0	0	IN-SX

UNFACTORED REACTIONS

JT	1ST LCASE	MAX	MIN	COMPONENT REACTIONS	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
G	858	588 / 0	0 / 0	0 / 0	0 / 0	0 / 0	270 / 0	0 / 0			
B	952	665 / 0	0 / 0	0 / 0	0 / 0	0 / 0	287 / 0	0 / 0			

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC) (1)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC) (1)
FR-TO		FROM TO		FR-TO			
A-B	0 / 37	-102.1 -102.1	0.14 (1)	10.00	C-J	-431 / 0	0.17 (1)
B-L	-1924 / 0	-102.1 -102.1	0.14 (4)	4.83	J-D	0 / 388	0.09 (1)
L-C	-1725 / 0	-102.1 -102.1	0.28 (1)	4.77	D-H	-52 / 0	0.07 (1)
C-D	-1358 / 0	-102.1 -102.1	0.27 (1)	5.26	H-E	-777 / 0	0.37 (1)
D-E	-1076 / 0	-102.1 -102.1	0.71 (1)	4.87	H-F	0 / 1421	0.32 (1)
E-F	-1076 / 0	-102.1 -102.1	0.71 (1)	4.87	K-L	0 / 285	0.00 (1)
G-F	-1167 / 0	0.0 0.0	0.67 (1)	7.38			
B-K	0 / 1460	-18.5 -18.5	0.28 (1)	10.00			
K-J	0 / 1460	-18.5 -18.5	0.35 (1)	10.00			
J-I	0 / 1116	-18.5 -18.5	0.30 (1)	10.00			
I-H	0 / 1116	-18.5 -18.5	0.30 (1)	10.00			
H-G	0 / 0	-18.5 -18.5	0.15 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 2.00/12 MINIMUM

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.67")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.04")
ALLOWABLE DEFL. (TL) = $L/360$ (0.67")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.13")

CSI: TC=0.71/1.00 (E-F:1), BC=0.35/1.00 (J-K:1), WB=0.37/1.00 (E-H:1), SS=0.31/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

SI GRIP= 0.80 (B) (INPUT = 0.90)
SI METAL= 0.89 (B) (INPUT = 1.00)

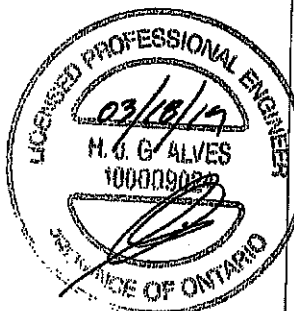


DWG NO. TAM 1705480
STRUCTURAL
COMPONENT ONLY

JOB NAME 401788	TRUSS NAME J1	QUANTITY 13	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	------------------	----------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Mon Mar 18 17:28:27 2018 Page 1
ID:UoHQ90YyAJFCG5Y3nXIDmzcicz-fuc7snl699H7Q19t1wat2p7PseQT9w6yXAc2KVzZeh6

Scale = 1/28.3

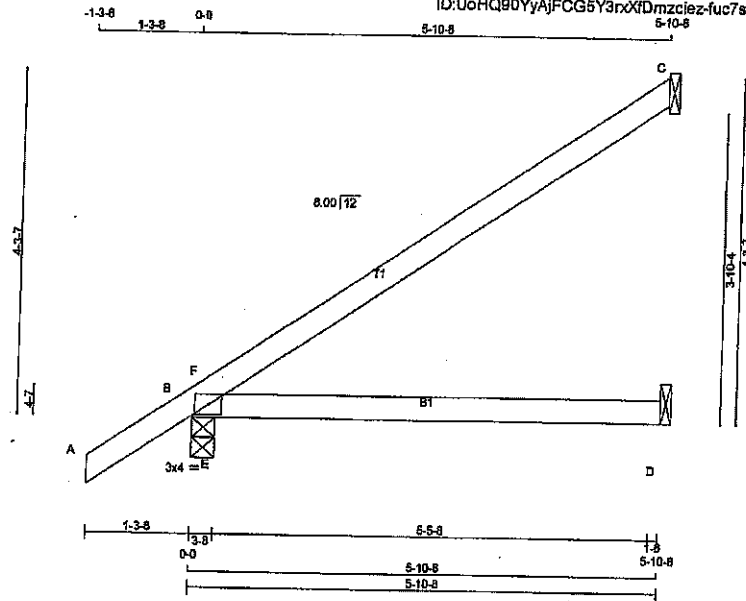

LUMBER

N. L. G. A. RULES			
CHORDS	SIZE		LUMBER
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB14	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
C	262	0	262	0	1-8	1-8
B	494	0	494	0	3-8	3-8
D	92	0	82	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	180	145 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0
B	345	250 / 0	0 / 0	0 / 0	0 / 0	95 / 0	0 / 0
D	69	26 / 0	0 / 0	0 / 0	0 / 0	43 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 MAX		MAX. UNBRACED LENGTH	WEBS MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
		FROM TO	CSI (LC)			
FR-TO						
A-B	0 / 37	-102.1	-102.1 0.14 (1)	10.00	E-F	-738 / 3
B-F	-32 / 264	-102.1	-102.1 0.21 (1)	6.25		
F-C	-13 / 2	-102.1	-102.1 0.46 (1)	6.25		
B-E	0 / 0	-18.5	-18.5 0.31 (1)	10.00		
E-D	0 / 0	-18.5	-18.5 0.31 (1)	10.00		

TOTAL WEIGHT = 13 X 17 = 218 lb

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH. LL	= 28.0 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012
- CSA 088-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 37.8 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/910$ (0.08")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/453$ (0.16")

CSI: TC=0.48/1.00 (C-F:1), BC=0.31/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.59/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP (DRY)	SHEAR	SECTION	
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	618 354	1667 788	1887 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.42 (B) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)

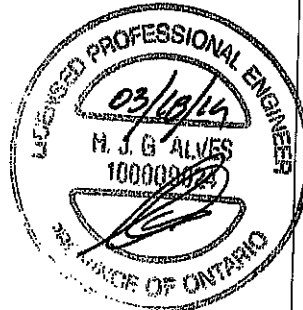


DRWG NO. TAM 17405481
STRUCTURAL
COMPONENT ONLY

JOB NAME 401788	TRUSS NAME J2	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2016 Mitek Industries, Inc. Mon Mar 18 17:28:28 2016 Page 1
ID:UoHQ90YyAJFCG5Y3noXfDmzclez-74AV37jkwSP_GaoMJRp0GLNA1qhuNM5IqMbsxzZeh5

Scale = 1:12.1

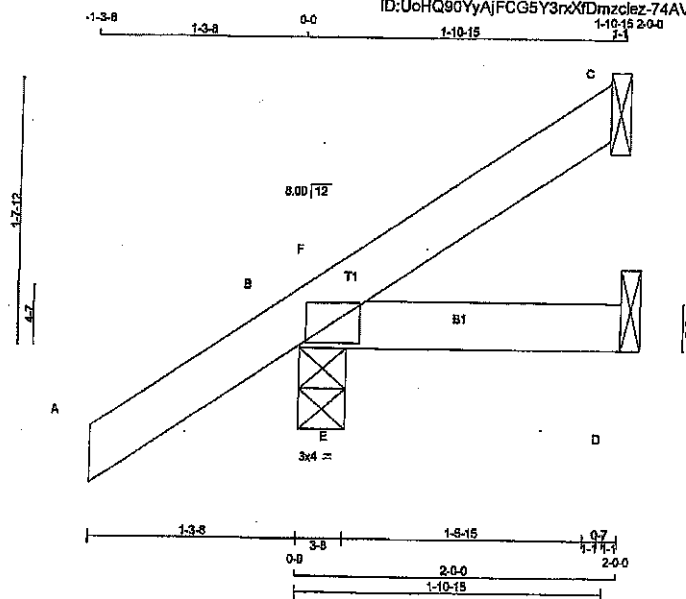

TOTAL WEIGHT = 3 X 7 = 21 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMB-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
C	62	0	62	0	-11	1-8
B	306	0	306	0	3-8	3-8
D	5	0	16	0	-14	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

1ST LCASE		MAX/MIN COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	43	33 / -12	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0
B	212	164 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0
D	5	0 / -16	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		MAX. FACTORED (LBS)	MAX. FACTORED (LBS)	MEMB.	WEBS		MAX. FACTORED (LBS)	MAX. FACTORED (LBS)
	FORCE (LBS)	VERT. LOAD (LBS)	VERT. LOAD (LBS)	VERT. LOAD (LBS)				FORCE (LBS)	VERT. LOAD (LBS)		
FR-TO											
A-B	0 / 37	-102.1	-102.1	0.14 (1)	10.00		E-F	0 / 162	0.00 (1)		
B-F	-136 / 0	-102.1	-102.1	0.13 (5)	6.25						
F-C	-11 / 0	-102.1	-102.1	0.04 (1)	6.25						
B-E	0 / 0	-18.5	-18.5	0.05 (5)	10.00						
E-D	0 / 0	-18.5	-18.5	0.05 (5)	10.00						

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.6 P.S.F. G.S.L. PLUS 6.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:1), BC=0.08/1.00 (B-E:5),
WB=0.00/1.00 (E-F:1), SI=0.13/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


SI GRIP= 0.23 (B) (INPUT = 0.90)
SI METAL= 0.05 (B) (INPUT = 1.00)

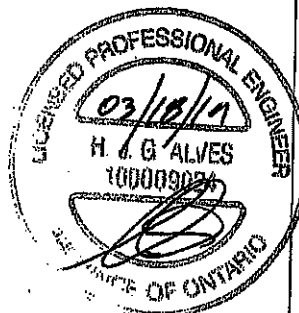

DWG NO. TAM 7705402
STRUCTURAL
COMPONENT ONLY

JOB NAME 401788	TRUSS NAME J3	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Mon Mar 18 17:28:28 2019 Page 1
ID:UoHQ90YyAFCG5Y3nxXIDmzciez-bHjIGTJNhmXrukBYtSy2YtYRR6rdqcF_U58PozZeh4

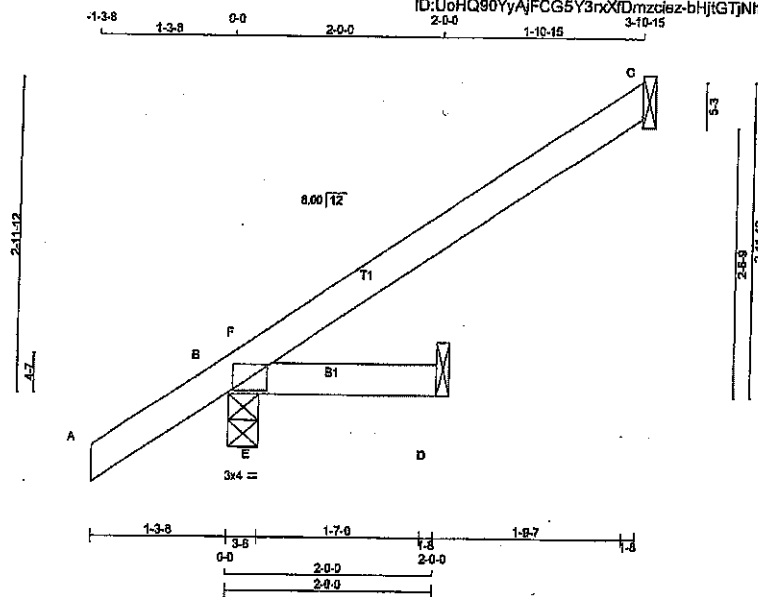

LUMBER
N. L. G. A. RULES
CHORDS SIZE
A - C 2x4 DRY
B - D 2x4 DRY
LUMBER No.2
No.2
DRY: SEASONED LUMBER.

PLATES (table in inches)
JT TYPE PLATES W LEN Y X
B TMB1-1 MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED		MAXIMUM FACTORED		INPUT		REQD	
	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
JT	VERT	HORZ	VERT	HORZ	UPLIFT	IN-SX	IN-SX	IN-SX
C	159	0	159	0	0	1-8	1-8	1-8
B	319	0	319	0	0	3-8	3-8	3-8
D	99	0	99	0	0	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

	1ST LCASE		MAX/MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
JT	109	90/0	0/0	0/0	19/0	0/0	0/0
C	221	170/0	0/0	0/0	51/0	0/0	0/0
D	70	47/0	0/0	0/0	23/0	0/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FACTORED	FORCE (LBS)	VERT. LOAD	LC1 MAX	MAX. FACTORED	FORCE (LBS)	MAX. FACTORED	FORCE (LBS)
FR-TO								
A-B	0/37		-102.1	-102.1 0.14 (1)	10.00	E-F	-528/0	0.00 (1)
B-F	0/194		-102.1	-102.1 0.16 (1)	10.00			
F-C	-14/0		-102.1	-102.1 0.17 (1)	6.25			
B-E	0/0		-18.5	-18.5 0.19 (1)	10.00			
E-D	0/0		-18.5	-18.5 0.19 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 3 X 10 = 29 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 29.0 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 37.0 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.01")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.01")

CSI: TC=0.17/1.00 (C-F:1), BC=0.19/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SS=0.39/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	816	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.28 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



DWG NO. TAM 7705483
STRUCTURAL
COMPONENT ONLY

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
401788	J4	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 MiTek Industries, Inc. Mon Mar 18 17:28:29 2019 Page 1
ID:UoHQ80YyAJFCG5Y3rxXfDmzcicz-bHjGTJNhmXukBYtSy2YTUyWR7BdgcF_U68POzZeh4

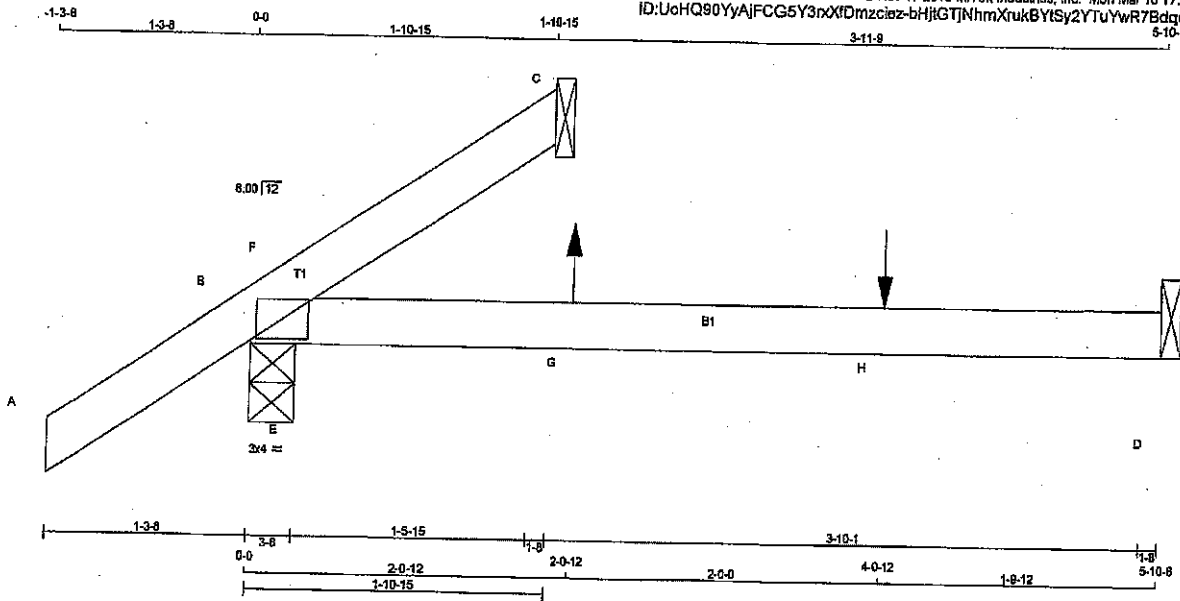

LUMBER

N. L. G. A. RULES					
CHORDS	SIZE	DRY	LUMBER	DESCR.	SPF
A - C	2x4	DRY	No.2		
B - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMB1-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
C	112	0	112	0
B	316	0	316	0
D	88	0	88	0

SEE MITEK STANDARD DETAIL B37821H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	81	44/0	0/0	0/0	0/0	37/0	0/0
B	222	163/0	0/0	0/0	0/0	56/0	0/0
D	84	25/-4	0/0	0/0	0/0	38/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS				WEBS							
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC1)	MAX. FACTORED VERT. LOAD (LC2)	MAX. FACTORED VERT. LOAD (LC3)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC4)	MAX. FACTORED VERT. LOAD (LC5)		
FR-TO		FROM TO		CS1 (LC)	UNBRAC LENGTH	FR-TO					
A-B	0/37	-102.1	-102.1	0.14 (1)	10.00	E-F	0/403		0.00 (1)		
B-F	-301/0	-102.1	-102.1	0.13 (1)	6.25						
F-C	-1/21	-102.1	-102.1	0.13 (4)	10.00						
B-E	0/0	-18.5	-18.5	0.13 (1)	10.00						
E-G	0/0	-18.5	-18.5	0.17 (1)	10.00						
G-H	0/0	-18.5	-18.5	0.17 (1)	10.00						
H-D	0/0	-18.5	-18.5	0.17 (1)	10.00						

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	2-0-12	8	1	23	BACK	VERT	TOTAL	—	—
H	4-0-12	-80	-80	—	BACK	VERT	TOTAL	—	—

DESIGN CRITERIA

SPECIFIED LOADS:	
TOP CH. LL	= 29.0 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 42.4 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/999 (0.05")

CSI: TC=0.14/1.00 (A-B-1), BC=0.17/1.00 (D-E-1),
WB=0.00/1.00 (E-F-1), SS=0.28/1.00 (B-F-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES	
PLATE GRIP(DRY) SHEAR SECTION	
(PSI) (PLI) (PLI)	
MAX MIN MAX MIN MAX MIN	
MT20 618 354 1887 788 1987 1658	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)

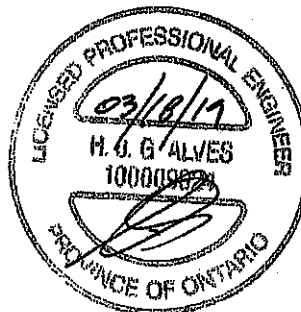

DWG NO. 141719054B4
STRUCTURAL
COMPONENT ONLY

JOB NAME 401788	TRUSS NAME J5	QUANTITY 3	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.230 S Nov 17 2018 Mitek Industries, Inc. Man Mar 18 17:28:30 2019 Page 1
ID:UoHQ90YyAFcGSY3nXWdmzciez-4THFuk?S4fhVulkQ9TH5hRi7TnMHsOD8nXqzZeh3

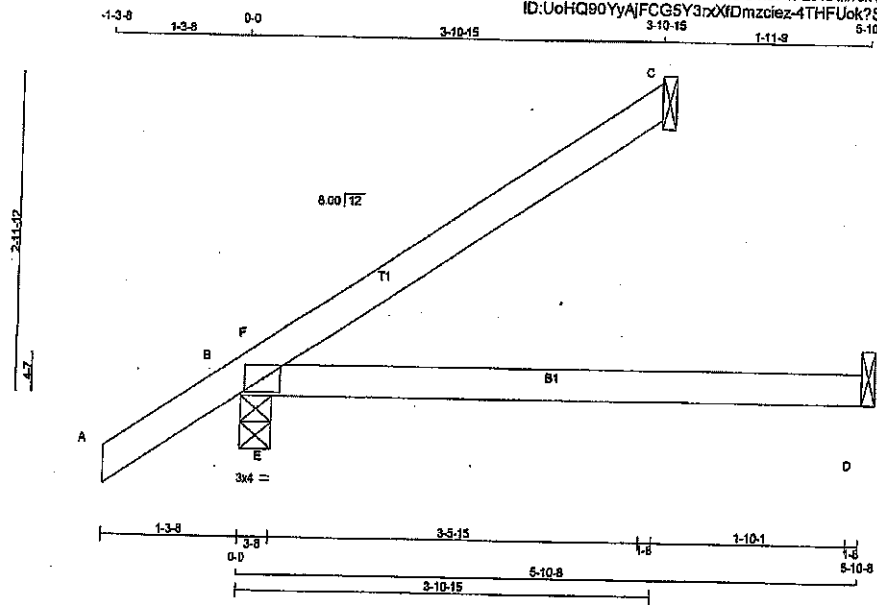

Scale = 1:10.8

TOTAL WEIGHT = 3 X 14 = 42 lb

LUMBER
N.L.G.A. RULES
CHORDS SIZE LUMBER
A - C 2x4 DRY No.2
B - D 2x4 DRY No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)
JT TYPE PLATES W LEN Y X
B TMB1-MT20 3.0 4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
C	188	0	188	0	1-8	1-8
B	398	0	398	0	3-8	3-8
D	62	0	62	0	1-8	1-8

SEE MITEK STANDARD DETAIL B37621H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED		MAX/MIN COMPONENT REACTIONS		WIND	DEAD	SOIL
	SNOW	LIVE	PERM.LIVE				
C	130	99.0	0.0	0.0	0.0	31.0	0.0
B	278	198.0	0.0	0.0	0.0	81.0	0.0
D	48	9.0	0.0	0.0	0.0	38.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD (PLF)		MAX. UNBRACED LENGTH (FT)	WEBS MAX. FACTORED FORCE (LBS)	
	FR-TO		FROM TO	CSI (LC)		FR-TO	
A-B	0.37		-102.1 -102.1	0.14 (1)	10.00	E-F	-155 / 130
B-F	-88.0		-102.1 -102.1	0.10 (4)	6.25		
F-C	0.17		-102.1 -102.1	0.23 (1)	10.00		
B-E	0.0		-18.5 -18.5	0.08 (1)	10.00		
E-D	0.0		-18.5 -18.5	0.15 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 28.0 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 42.4 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012
- CSA 086-08, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 37.6 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 29.0 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.20")
CALCULATED VERT. DEFL.(LL) = L/989 (0.03")
ALLOWABLE DEFL.(TL) = L/380 (0.20")
CALCULATED VERT. DEFL.(TL) = L/920 (0.08")

CSI: TC=0.23/1.00 (C-F:1), BC=0.15/1.00 (D-E:4), WB=0.00/1.00 (E-F:1), SS=0.18/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1666


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.30 (B) (INPUT= 0.90)
JSI METAL= 0.07 (B) (INPUT= 1.00)

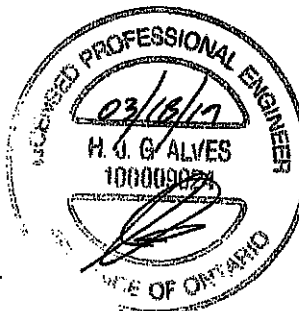

DRWG NO. 11907485
STRUCTURAL
COMPONENT ONLY

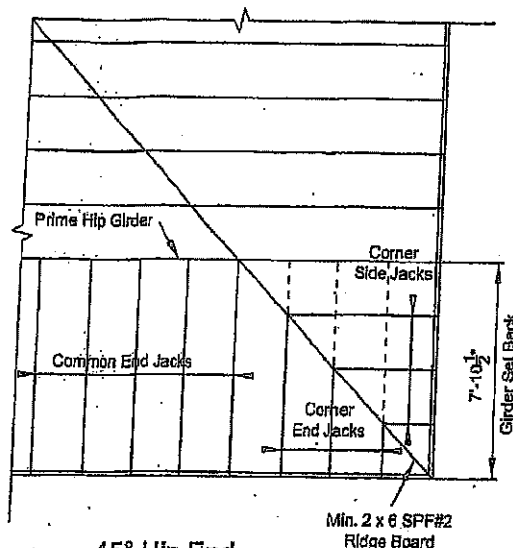

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD

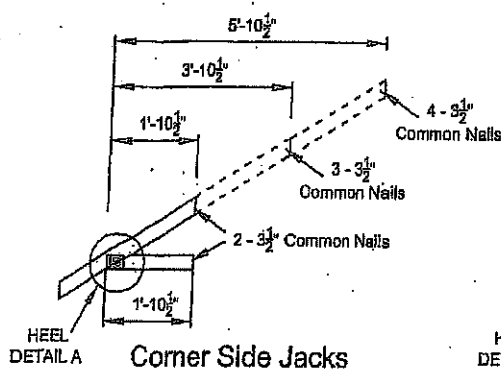


Corner Side Jacks

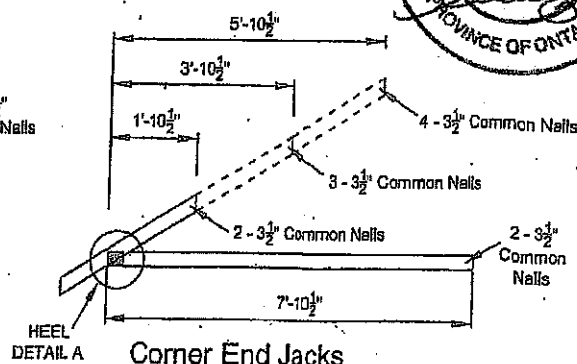

Corner End Jacks

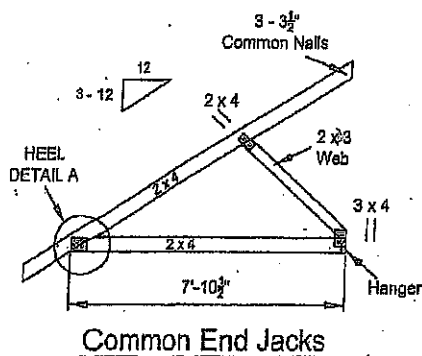


Common End Jacks

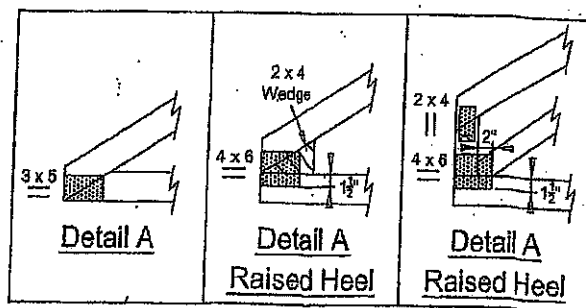

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)

T-1800217

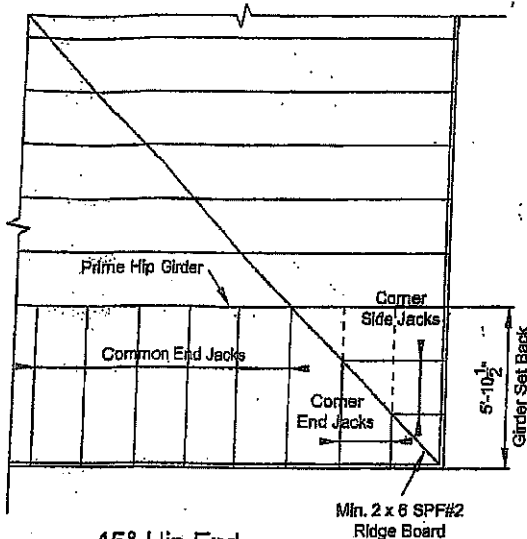

45° Hip End



LUMBER SPECIFICATION

TOP CHORD : 2 x 4 SPF#2
 BOTTOM CHORD : 2 x 4 SPF#2
 WEBS : 2 x 3 SPF#2
 UNLESS OTHERWISE SHOWN


DESIGN LOAD

TOP CHORD SNOW LOAD : 40.5 P.S.F.
 TOP CHORD DEAD LOAD : 3.0 P.S.F.
 BOTTOM CHORD LIVE LOAD : 0.0 P.S.F.
 BOTTOM CHORD DEAD LOAD : 7.0 P.S.F.


TOTAL LOAD : 50.5 P.S.F.

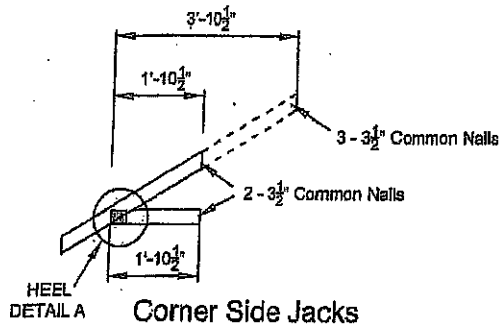


Corner Side Jacks

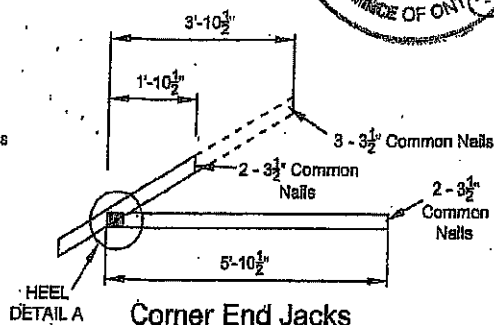

Corner End Jacks

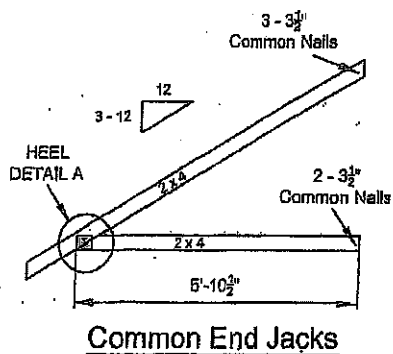

Common End Jacks

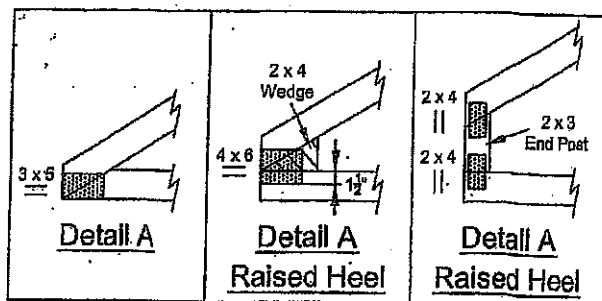

NOTE: DESIGN CONFORMS TO PART 9, O.B.C. 2012 (L.S.D. DESIGN)


T-1800216

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate-Connected Wood Trusses
- DSB-89: Design Standard for Bracing.
- BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

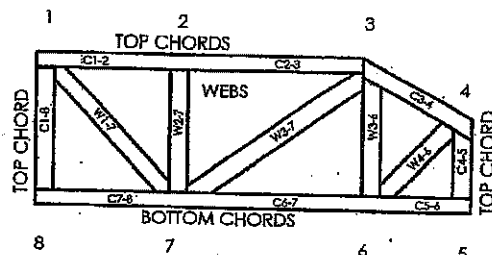

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet M117473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

F-1900218

Feb 09, 2018