

DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER
 Builder: GREEN PARK HOMES
 Project: RUSSELL GARDENS PH.3
 Location: WATERDOWN
 Model: MOUNTAINASH 7-018
 Lot #:
 Elevation: 3




Job Track: 51225
 PlanLog: 202428
 Layout ID: 412096
 Ref #
 Page: 1 of 3
 Date: 08-19-2020
 Designer:
 Sales Rep: Mario DiCano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T30 Hip Girder	6/12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	350.24 218.00		
	1 2-ply	T30Z Hip Girder	6/12	35-02-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	350.24 218.00		
	2	T31 Hip	6/12	35-02-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.99 174.00		
	2	T32 Hip	6/12	35-02-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	277.12 174.67		
	2	T33 Hip	6/12	35-02-00	7-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	289.07 179.67		
	2	T34 Hip	6/12	35-02-00	8-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	290.73 183.33		
	2	T35 Hip	6/12	35-02-00	9-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	309.55 196.00		
	5	T36 Common	6/12	35-02-00	9-11-08	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	758.4 465.00		
	1	T37 Hip Girder	6/12	19-00-00	4-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	75.77 49.00		
	1	T38 Hip	6/12	19-00-00	4-10-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	76.22 49.33		
	1 2-ply	T39S Roof Special Girder	6/12	25-11-00	4-10-08	2 x 4 2 x 6	1-03-08	1-02-00 1-00-08	260.76 167.33		
	1	T40 Hip	6/12	25-08-00	5-01-04	2 x 4	1-03-08	1-02-00 2-06-00	100.45 63.50		
	1	T41 Hip	6/12	25-08-00	6-01-04	2 x 4	1-03-08	1-02-00 2-06-00	109.71 69.67		
	1	T42 Hip Girder	6/12	11-06-00	3-11-13	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	44.51 28.00		

DELIVERY SHIPLIST				
	Lumber Yard:	TAMARACK LUMBER	Job Track:	51225
	Builder:	GREEN PARK HOMES	PlanLog:	202428
	Project:	RUSSELL GARDENS PH.3	Layout ID:	412096
	Location:	WATERDOWN	Ref #	
	Model:	MOUNTAINASH 7-018	Page:	2 of 3
	Lot #:		Date:	08-19-2020
	Elevation:	3	Designer:	
		Sales Rep:	Mario DiCano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T43 Common	6 /12	11-06-00	5-04-08	2 x 4	1-03-08 1-03-08	2-06-00 2-06-00	98.46 65.00		
	1	T43A Common	6 /12	11-01-08	5-04-08	2 x 4		2-08-04 2-06-00	45.02 29.83		
	1 2-ply	T44 Flat Girder	0 /12	5-10-08	1-04-00	2 x 6		1-04-00 1-04-00	53.05 33.67		
	1 2-ply	T300 Hip Girder	6 /12	9-03-00	1-08-00	2 x 4		1-02-00 1-02-00	66.44 48.00		
	13	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	218.33 138.67		
	5	J30 Jack-Open	8 /12	3-10-08	3-11-13	2 x 4	1-03-08	1-04-13 3-11-13	70.85 46.00		
	4	J31 Jack-Open	8 /12	3-02-08	3-06-08	2 x 4	1-03-08	1-04-13 3-06-08	49.98 33.33		
	5	C30 Jack-Open	6 /12	3-10-15	3-01-08	2 x 4	1-03-08 1-11-09	1-02-00 3-01-08	71.46 43.33		
	5	C31 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 3-11-09	1-02-00 2-01-08	58.71 36.67		
	5	C32 Jack-Open	6 /12	2-00-00	3-01-08	2 x 4	1-03-08 1-10-15	1-02-00 2-02-00	49.36 30.00		
	5	C33 Jack-Open	6 /12	1-10-15	2-01-08	2 x 4	1-03-08 1-01	1-02-00 2-01-08	36.61 23.33		

TOTAL # TRUSS= 75

TOTAL BFT OF ALL TRUSSES= 2762.33

BFT.

TOTAL WEIGHT OF ALL TRSSES 4389.03 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
1	Hardware	HUSC26-2	
4	Hardware	LJS26DS	
9	Hardware	LUS24	
1	Hardware	LUS26-2	

 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREEN PARK HOMES Project: RUSSELL GARDENS PH.3 Location: WATERDOWN Model: MOUNTAINASH 7-018 Lot #: Elevation: 3	Job Track: 51225 PlanLog: 202428 Layout ID: 412096 Ref # Page: 3 of 3 Date: 08-19-2020 Designer: Sales Rep: Mario DiCano


HARDWARE

QTY	TYPE	MODEL	LENGTH
-----	------	-------	--------

TOTAL NUMBER OF ITEMS= 17

JOB NAME 408266	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 8 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:25:58 2020 Page 1
 ID:DMCubINVR6TsFoe31v6f_zns1l-pk3oIO_SbmQZ8s1vp7F_gxKokudU5WIMYw7SXzMEwN
 1-3-8 0-0 4-0-10 4-0-10 6-9-13 10-10-7 6-9-9 17-7-0 19-8-12 4-8-13 24-3-0 6-9-13 31-1-6 4-0-10 35-2-0 1-3-8
 Scale = 1:57.6

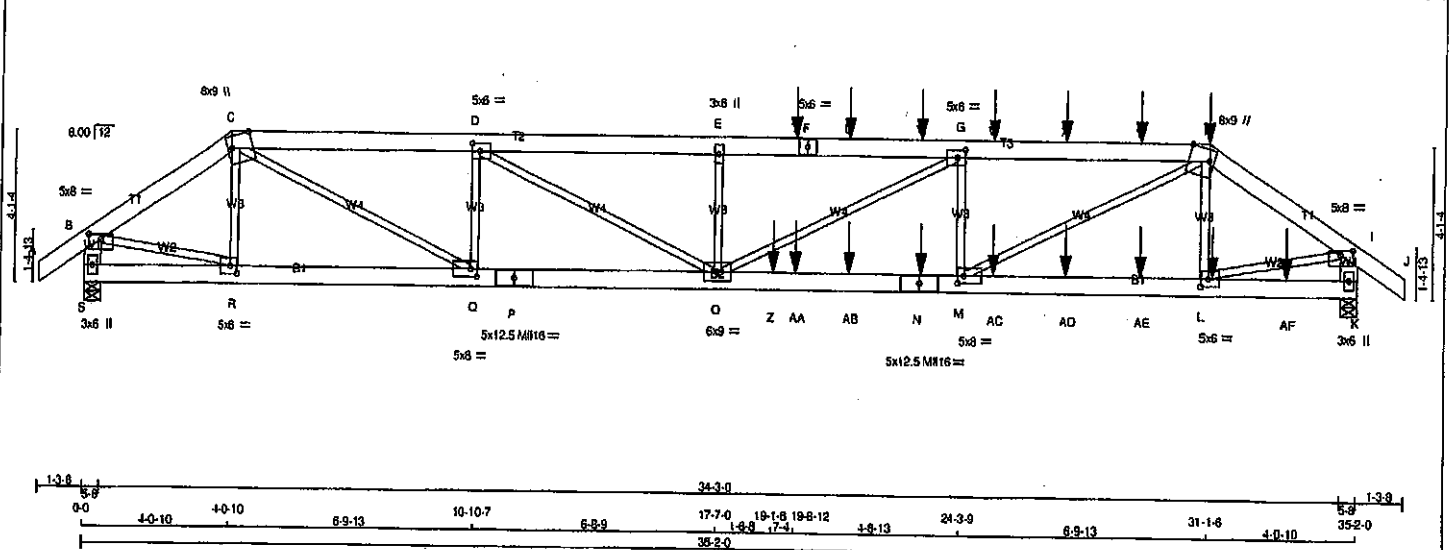


LUMBER	N L G A RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x8 DRY	No.2	SPF		
C - F	2x8 DRY	No.2	SPF		
F - H	2x8 DRY	No.2	SPF		
H - J	2x8 DRY	No.2	SPF		
S - B	2x8 DRY	No.2	SPF		
K - I	2x8 DRY	No.2	SPF		
S - P	2x8 DRY	2100F 1.8E	SPF		
P - N	2x8 DRY	2100F 1.8E	SPF		
N - K	2x8 DRY	2100F 1.8E	SPF		
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF		

DRY: SEASONED LUMBER.
 DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2	12	TOP SIDE(0.0)
C - F 2	12	SIDE(61.0)
F - H 2	12	SIDE(122.0)
H - J 2	12	TOP
S - B 2	12	TOP
K - I 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
S - P 2	12	TOP
P - N 2	12	SIDE(0.0)
N - K 2	12	SIDE(197.8)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	8	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.
 GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.
 TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

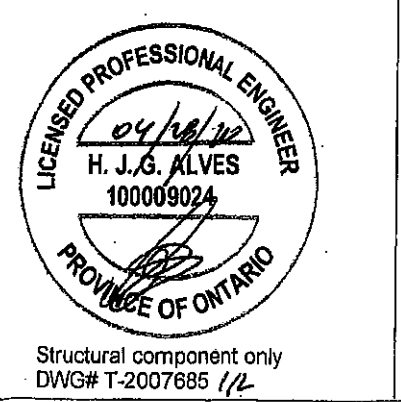

Structural component only
 DWG# T-2007685 1/2

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	JT	GROSS REACTION	BRG	BRG	IN-SX	IN-SX
S	3472 0	S	3472 0	0	5-8	5-8	5-8
K	4364 0	K	4364 0	0	5-8	5-8	5-8

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS	
JT	1ST LOOSE	JT	COMBINED
S	2449	S	1841 0
K	3078	K	2062 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, K
 BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.24 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.
 LOADING
 TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM	TO	FR-TO	
A-B	0.36	-91.8	-91.8 0.04 (1)	R-C	-529 0
B-C	-4304.0	-91.8	-91.8 0.10 (1)	C-Q	0 5233
C-D	-8178.0	-91.8	-91.8 0.28 (1)	Q-D	-2610.0
D-E	-11739.0	-91.8	-91.8 0.42 (1)	D-O	0 4052
E-T	-11739.0	-91.8	-91.8 0.52 (1)	O-E	-658 0
T-F	-11739.0	-91.8	-91.8 0.52 (1)	F-G	0 2068
F-U	-11739.0	-91.8	-91.8 0.52 (1)	G-H	-2108 0
U-V	-11739.0	-91.8	-91.8 0.52 (1)	H-I	0 6170
V-G	-11739.0	-91.8	-91.8 0.52 (1)	I-L	-877 0
G-W	-9923.0	-91.8	-91.8 0.44 (1)	W-R	0 3654
W-X	-9923.0	-91.8	-91.8 0.44 (1)	X-L	0 4604
X-Y	-9923.0	-91.8	-91.8 0.44 (1)		
Y-H	-9923.0	-91.8	-91.8 0.44 (1)		
H-I	-5423.0	-91.8	-91.8 0.11 (1)		
I-J	0.36	-91.8	-91.8 0.04 (1)		
S-B	-3490.0	0.0	0.0 0.12 (1)		
K-I	-4314.0	0.0	0.0 0.15 (1)		

FACTORED CONCENTRATED LOADS (LBS)		MAX. MIN. COMPONENT REACTIONS	
JT	LOC.	JT	COMBINED
H	31-1-6	H	-49 -55
H	31-1-6	H	-117 -117
H	31-1-6	H	-255 -255
L	31-2-12	L	-26 -26
N	23-2-12	N	-26 -26
T	19-8-12	T	-110 -110
U	21-2-12	U	-110 -110

TOTAL WEIGHT = 2 X 181 = 361 lb

DESIGN CRITERIA
 *** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT
 NO FURTHER MODIFICATIONS WERE MADE
 SPECIFIED LOADS:
 TOP CH. LL = 25.8 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF
 SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
 *** NON STANDARD GIRDER ***
 ADDTL. USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, CBC 2012, ABC 2010
 - PART 9 OF CBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17')
 CALCULATED VERT. DEFL.(LL) = L/999 (0.33')
 ALLOWABLE DEFL.(TL) = L/360 (1.17')
 CALCULATED VERT. DEFL.(TL) = L/693 (0.61')

CSK TC=0.52/1.00 (E-G:1), BC=0.69/1.00 (M-O:1), WB=0.76/1.00 (H-M:1), SS=0.67/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00
 AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1667 788 1987 1656
 MI16 438 276 2341 1245 4283 1656

PLATE PLACEMENT TOL. = 0.250 inches
 PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (0) (INPUT = 0.90)
 JSI METAL = 0.56 (0) (INPUT = 1.00)

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	T1	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:25:58 2020 Page 2
ID:DMCubINVR6TstFoe31v6l zns1l-pk3aIo SbmaZ6s1vp7F qxKekudU5WIMYvw7SXzMEwN

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	1.50	4.00
C	TTWW+m	MT20	8.0	9.0	Edge	6.50
D	TMWV-t	MT20	5.0	8.0	2.50	2.50
E	TMW+w	MT20	3.0	8.0		
F	TS-t	MT20	5.0	6.0		
G	TMWV-t	MT20	5.0	6.0	2.50	2.50
H	TTWW+m	MT20	8.0	9.0	Edge	6.50
I	TMWV-p	MT20	5.0	8.0	1.50	4.00
K	BMV1-p	MT20	3.0	8.0		
L	BMWV-t	MT20	5.0	8.0	2.50	2.25
M	BMWV-t	MT20	5.0	8.0	2.50	2.00
N	BS-t	MH16	5.0	12.5		
O	BMWVW-t	MT20	6.0	9.0		
P	BS-t	MH16	5.0	12.5		
Q	BMWV-t	MT20	5.0	8.0	2.50	2.00
R	BMWV-t	MT20	5.0	8.0	2.50	2.25
S	BMV1-p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
V	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
W	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
X	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Y	29-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	19-1-6	-2404	-2404	---	FRONT	VERT	TOTAL	---	C1
AA	19-8-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	29-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	33-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007685 42

Tamarack Roof Truss, Burlington


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:25:56 2020 Page 1

ID:DMCubINVR6TsIFoe31v6l_zns11-HwcAWk_4M4zCjC5MqMqDN8tpNI_NqxDWmcfg_zMEwM

1-3-8 0-0 4-0-10 4-0-10 8-9-13 10-10-7 14-4-12 16-4-12 17-7-0 17-10-12 24-3-9 8-4-13 8-9-13 31-1-6 35-2-0 38-5-8

1-3-8 4-0-10 8-9-13 10-10-7 14-4-12 16-4-12 17-7-0 17-10-12 24-3-9 8-4-13 8-9-13 31-1-6 35-2-0 38-5-8

Scale: 1/57

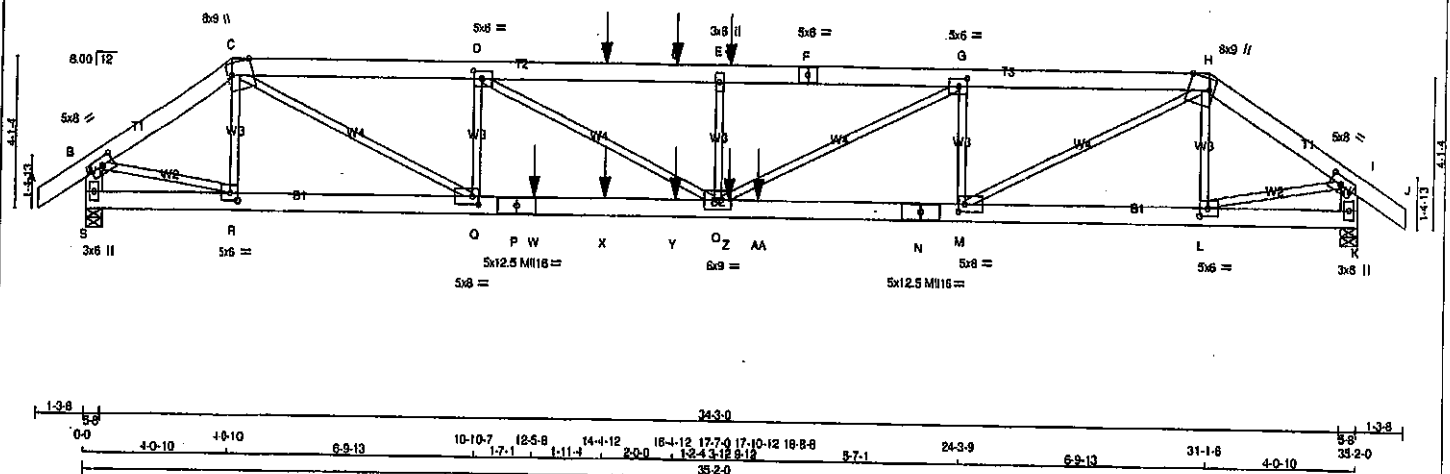

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

UNFACTORED REACTIONS

DESIGN CRITERIA

SPECIFIED LOADS:				
TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT. CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD				= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE
OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.31")
ALLOWABLE DEFL.(TL)= L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/732 (0.58")

CS: TC=0.53/1.00 (D-E:1), BC=0.58/1.00 (O-Q:1),
WB=0.87/1.00 (C-Q:1), SS=0.55/1.00 (M-O:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	818	354	1687	788	1987	1656
MI16	438	276	2341	1245	4283	1658

PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg

JSI GRIP= 0.89 (I) (INPUT = 0.90)
JSI METAL= 0.63 (P) (INPUT = 1.00)

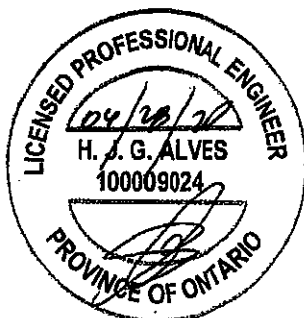

Structural component only
DWG# T-2007686 1/1

CHORDS				FACTORED				WEBS			
MAX. FACTORED		FORCE		VERT. LOAD		MAX		MAX. UNBRAC		MAX. FACTORED	
MEMB.	FORCE	VERT.	LOAD	LC1	MAX	UNBRAC	MEMB.	FORCE	VERT.	LOAD	LC1
FR-TO	(LBS)	(PLF)	CSI (LC)	LENGTH	FR-TO	(LBS)	CSI (LC)	LENGTH	FR-TO	(LBS)	CSI (LC)
A-B	0 ' 38	-91.8	-91.8	0.04 (1)	10.00	R-C	-895 ' 0	0.11 (1)			
B-C	-5186 ' 0	-91.8	-91.8	0.11 (1)	5.05	C-Q	0 ' 7044	0.87 (1)			
C-D	-10498 ' 0	-91.8	-91.8	0.37 (1)	3.57	Q-D	-1897 ' 0	0.23 (1)			
D-T	-12836 ' 0	-91.8	-91.8	0.53 (1)	3.13	D-O	0 ' 2433	0.30 (1)			
T-U	-12836 ' 0	-91.8	-91.8	0.53 (1)	3.13	O-E	-819 ' 0	0.10 (1)			
U-E	-12836 ' 0	-91.8	-91.8	0.53 (1)	3.13	C-G	0 ' 3917	0.48 (1)			
E-V	-12836 ' 0	-91.8	-91.8	0.45 (1)	3.22	M-G	-2535 ' 0	0.30 (1)			
V-F	-12836 ' 0	-91.8	-91.8	0.45 (1)	3.22	M-H	0 ' 6046	0.75 (1)			
F-G	-12836 ' 0	-91.8	-91.8	0.45 (1)	3.22	L-H	-714 ' 0	0.09 (1)			
G-H	-9194 ' 0	-91.8	-91.8	0.32 (1)	3.83	B-R	0 ' 4403	0.54 (1)			
H-I	-4670 ' 0	-91.8	-91.8	0.10 (1)	5.27	L-I	0 ' 3965	0.49 (1)			
I-J	0 ' 38	-91.8	-91.8	0.04 (1)	10.00						
S-B	-4140 ' 0	0.0	0.0	0.15 (1)	7.01						
K-I	-9759 ' 0	0.0	0.0	0.13 (1)	7.28						
S-R	0 ' 0	-18.5	-18.5	0.01 (4)	10.00						
R-Q	0 ' 4278	-18.5	-18.5	0.21 (1)	10.00						
Q-P	0 ' 10498	-18.5	-18.5	0.58 (1)	10.00						
P-W	0 ' 10498	-18.5	-18.5	0.58 (1)	10.00						
W-X	0 ' 10498	-18.5	-18.5	0.58 (1)	10.00						
X-Y	0 ' 10498	-18.5	-18.5	0.58 (1)	10.00						
Y-O	0 ' 10498	-18.5	-18.5	0.58 (1)	10.00						
O-Z	0 ' 9194	-18.5	-18.5	0.42 (1)	10.00						
Z-AA	0 ' 9194	-18.5	-18.5	0.42 (1)	10.00						
AA-N	0 ' 9194	-18.5	-18.5	0.42 (1)	10.00						
N-M	0 ' 9184	-18.5	-18.5	0.42 (1)	10.00						
M-L	0 ' 3655	-18.5	-18.5	0.13 (1)	10.00						
L-K	0 ' 0	-18.5	-18.5	0.02 (4)	10.00						

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN
T	14-4-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
U	16-4-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
V	17-10-12	-110	-110	---	BACK	VERT	TOTAL	---	C1
W	12-5-6	-1654	-1654	---	BACK	VERT	TOTAL	---	C1
X	14-4-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	16-4-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
Z	17-10-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
AA	18-8-3	-1744	-1744	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

JOB NAME 408266	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:25:59 2020 Page 2 ID:DMCubINVR6TstFoe31v6I_zns1I-HwcAWK_4M4zGJ0c5MamDN8ipNI_NqxDWmcIq_zzMEwM	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-t	MT20	5.0	8.0	2.50	3.75
C	TTWW+m	MT20	8.0	9.0	Edge	6.50
D	TMWW-l	MT20	5.0	6.0	2.50	2.75
E	TMWW-w	MT20	3.0	8.0		
F	TS-l	MT20	5.0	8.0		
G	TMWW-t	MT20	5.0	6.0	2.50	2.75
H	TTWW+m	MT20	8.0	9.0	Edge	6.50
I	TMWW-t	MT20	5.0	8.0	2.50	3.75
K	BMVl+p	MT20	3.0	6.0		
L	BMWW-t	MT20	5.0	6.0	2.50	2.50
M	BMWW-t	MT20	5.0	8.0	2.50	2.00
N	BS-l	MH16	5.0	12.5		
O	BMWWWW-t	MT20	6.0	9.0		
P	BS-l	MH16	5.0	12.5		
Q	BMWW-t	MT20	5.0	8.0	2.50	2.00
R	BMWW-t	MT20	5.0	6.0	2.50	2.50
S	BMVl+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.




Structural component only
DWG# T-2007686 *72*

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T2	2	1	GREEN PARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1
ID:DMCubINVR6TsFoe31v8I zns11-F8H4ajCx5wImvMOcuAP1xf2LGGy5TgYwUz? UzMFId

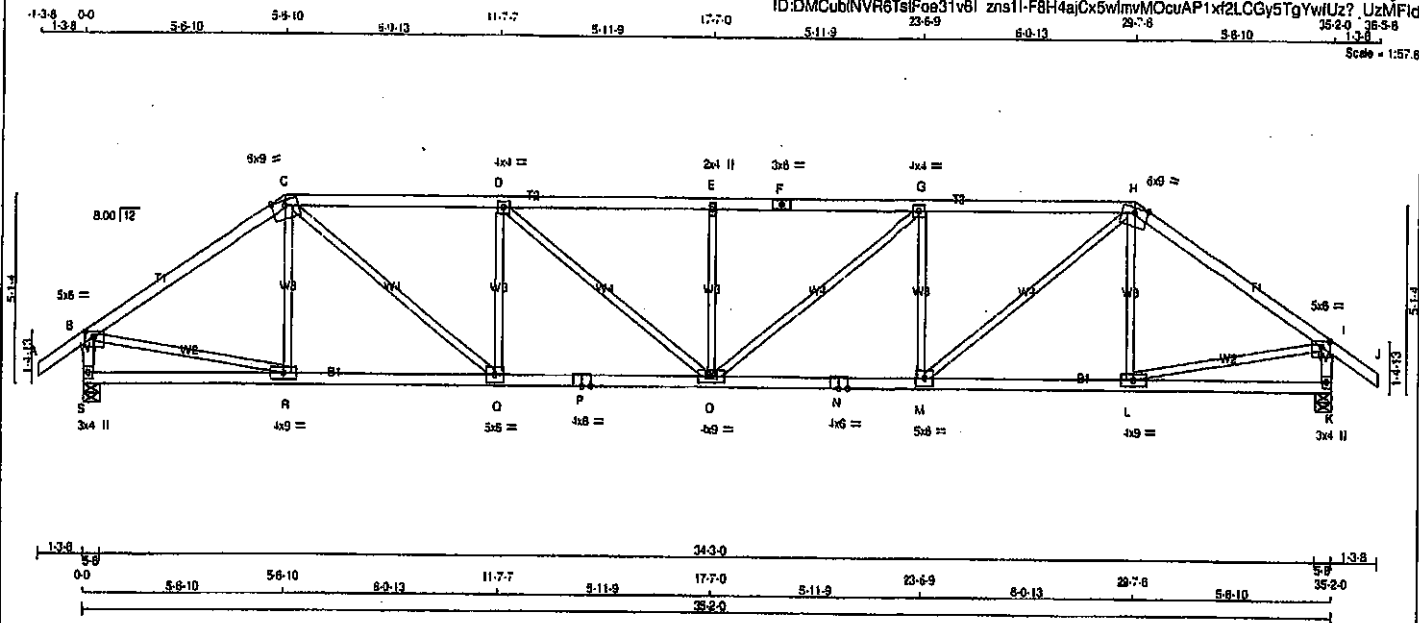

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No. 2	SPF	
C - F	2x4	DRY	No. 2	SPF	
F - H	2x4	DRY	No. 2	SPF	
H - J	2x4	DRY	No. 2	SPF	
S - B	2x4	DRY	No. 2	SPF	
K - I	2x4	DRY	No. 2	SPF	
S - P	2x4	DRY	No. 2	SPF	
P - N	2x4	DRY	No. 2	SPF	
N - K	2x4	DRY	No. 2	SPF	
ALL WEBS EXCEPT	2x3	DRY	No. 2	SPF	

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMW-p	MT20	5.0	6.0	1.75	2.75
C TTWW-m	MT20	6.0	9.0	Edge	
D TMW-l	MT20	4.0	4.0		
E TMW-w	MT20	2.0	4.0		
F TS-l	MT20	3.0	6.0		
G TMW-l	MT20	4.0	4.0		
H TTWW-m	MT20	6.0	9.0	Edge	
I TMW-p	MT20	5.0	6.0	1.75	2.75
K BMV-l-p	MT20	3.0	4.0		
L BMW-l	MT20	4.0	9.0		
M BMW-l	MT20	5.0	6.0		
N BS-l	MT20	4.0	6.0		
O BMW-l	MT20	4.0	9.0		
P BS-l	MT20	4.0	6.0		
Q BMW-l	MT20	5.0	6.0		
R BMW-l	MT20	4.0	9.0		
S BMV-l-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
S	2065	0	2065	0	0	5-8	5-8
K	2065	0	2065	0	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1458	970	0	0	0	0	488	0
K	1458	970	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO. 2 OR BETTER AT JOINT(S) S, K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.97 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: 14)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED GSI (LC)	UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED GSI (LC)
FR-TO					FR-TO		
A-B	0 35	-91.8	-91.8	0.12 (1)	10.00	R-C	-243 10
B-C	-2298 0	-91.8	-91.8	0.70 (1)	3.78	C-O	0 1670
C-D	-3213 0	-91.8	-91.8	0.80 (1)	3.19	O-Q	-929 0
D-E	-3594 0	-91.8	-91.8	0.88 (1)	2.97	Q-O	0 490
E-F	-3594 0	-91.8	-91.8	0.88 (1)	2.97	O-E	-505 0
F-G	-3594 0	-91.8	-91.8	0.88 (1)	2.97	G-O	0 490
G-H	-3213 0	-91.8	-91.8	0.80 (1)	3.19	M-Q	-929 0
H-I	-2298 0	-91.8	-91.8	0.70 (1)	3.78	M-H	0 1670
I-J	0 35	-91.8	-91.8	0.12 (1)	10.00	L-H	-243 10
S-B	-2023 0	0.0	0.0	0.21 (1)	5.94	B-R	0 1943
K-I	-2023 0	0.0	0.0	0.21 (1)	5.94	L-I	0 1943
S-R	0 0	-18.5	-18.5	0.15 (4)	10.00		
R-Q	0 1903	-18.5	-18.5	0.39 (1)	10.00		
Q-P	0 3213	-18.5	-18.5	0.58 (1)	10.00		
P-O	0 3213	-18.5	-18.5	0.58 (1)	10.00		
O-N	0 3213	-18.5	-18.5	0.58 (1)	10.00		
N-M	0 3213	-18.5	-18.5	0.58 (1)	10.00		
M-L	0 1903	-18.5	-18.5	0.39 (1)	10.00		
L-K	0 0	-18.5	-18.5	0.15 (4)	10.00		

TOTAL WEIGHT = 2 X 140 = 280 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.21")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.38")

GSI: TC=0.88/1.00 (D-E:1), BC=0.58/1.00 (M-O:1),
WB=0.44/1.00 (L-I:1), SSL=0.26/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 616 354 1887 786 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.87 (I), INPUT = 0.90
JSI METAL = 0.74 (P), INPUT = 1.00



Structural component only
DWG# T-2007604

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408222	T3	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:00:06 2020 Page 1
 ID:DMCubINVR6TstFos31v8l_zns1l-F8H4ajCx5wlmvMOcuAP1x12QrG_VTXHwIuz? UzMFid
 1-3-8 0-0 3-7-9 3-5-1 7-0-10 5-3-13 12-4-7 5-2-9 17-7-0 5-2-9 22-9-9 5-3-13 28-1-8 3-5-1 31-6-7 37-9 39-2-0 36-5-8
 Scale = 1/5" = 6'

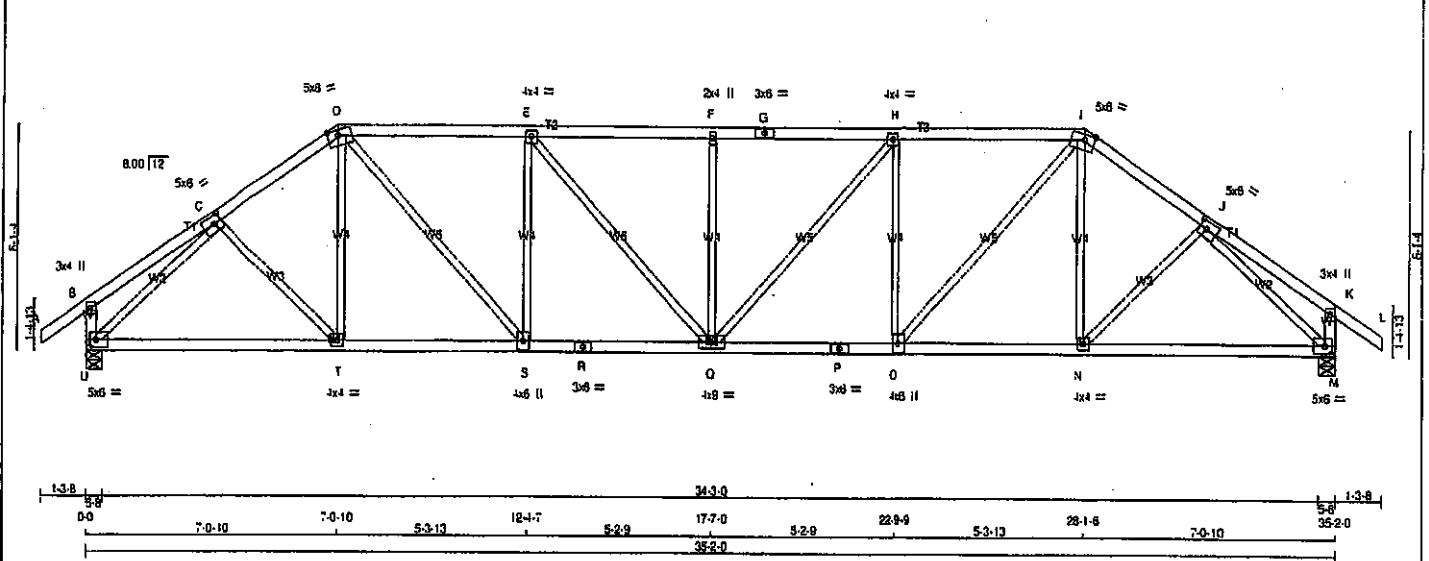

TOTAL WEIGHT = 2 X 151 = 303 lb


LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER				DESIGN CRITERIA			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.	BEARINGS				SPECIFIED LOADS:			
CHORDS				FACTORED	MAXIMUM FACTORED	INPUT	RECORD	TOP CH.	LL = 25.6	PSF	
A - D	2x4	DRY	No.2	GROSS REACTION	GROSS REACTION	BRG	BRG	DL	= 8.0	PSF	
D - G	2x4	DRY	No.2	VERT	HORZ	DOWN	HORZ	BOT CH.	LL = 0.0	PSF	
G - I	2x4	DRY	No.2	U	2065	0	0	DL	= 7.4	PSF	
I - L	2x4	DRY	No.2	M	2065	0	0	TOTAL LOAD	= 39.0	PSF	
U - B	2x4	DRY	No.2	UNFACTORED REACTIONS				SPACING = 24.0 IN. C/C			
M - K	2x4	DRY	No.2	1ST LCASE	MAX. MIN. COMPONENT REACTIONS			LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.0/12			
U - R	2x4	DRY	No.2	JT	COMBINED	SNOW	LIVE	THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015			
R - P	2x4	DRY	No.2	U	1458	970	0	THIS DESIGN COMPLIES WITH:			
P - M	2x4	DRY	No.2	M	1458	970	0	- PART 9 OF BCBC 2018, OBC 2012, ABC 2019			
ALL WEBS	2x3	DRY	No.2					- PART 9 OF OBC 2012 (2018 AMENDMENT)			
EXCEPT								- CSA 086-09, CSA 086-14			
								- TPIC 2011, TPIC 2014			
								155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD			
DRY: SEASONED LUMBER.								ALLOWABLE DEFL.(LL) = L/360 (1.17")			
								CALCULATED VERT. DEFL.(LL) = L/999 (0.16")			
								ALLOWABLE DEFL.(TL) = L/360 (1.17")			
								CALCULATED VERT. DEFL.(TL) = L/999 (0.29")			
								CSI: TC=0.58/1.00 (E-F:1), SC=0.49/1.00 (O-C:1)			
								WB=0.97 1.00 (J-M:1), SB=0.23/1.00 (D-E:1)			
								DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10			
								COMP=1.10 SHEAR=1.10 TENS=1.10			
								COMPANION LIVE LOAD FACTOR = 1.00			
								TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT			
								NAIL VALUES			
								PLATE GRIP(DRY) SHEAR SECTION			
								(PSI) (PLI) (PLI)			
								MAX MIN MAX MIN MAX MIN			
								MT20 618 354 1887 788 1987 1656			
								PLATE PLACEMENT TOL. = 0.250 inches			
								PLATE ROTATION TOL. = 5.0 Deg.			
								JSI GRIP = 0.80 (M) INPUT = 0.90			
								JSI METAL = 0.84 (P) INPUT = 1.00			

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) U, M

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. FURLIN SPACING = 3.53 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING				TOTAL LOAD CASES: (4)			
CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO				FR-TO			
A-B	0 35	-91.8	-91.8 0.12 (1)	C-T	0 135	0.03 (4)	
B-C	0 18	-91.8	-91.8 0.16 (1)	D-S	0 90	0.03 (4)	
C-D	-2305 0	-91.8	-91.8 0.23 (1)	E-Q	0 1218	0.27 (1)	
D-E	-2723 0	-91.8	-91.8 0.54 (1)	F-R	-814 0	0.48 (1)	
E-F	-2966 0	-91.8	-91.8 0.58 (1)	G-H	0 383	0.08 (1)	
F-G	-2988 0	-91.8	-91.8 0.56 (1)	H-I	-440 0	0.26 (1)	
G-H	-2988 0	-91.8	-91.8 0.58 (1)	I-J	0 383	0.08 (1)	
H-I	-2723 0	-91.8	-91.8 0.54 (1)	J-K	-814 0	0.48 (1)	
I-J	-2305 0	-91.8	-91.8 0.23 (1)	K-L	0 1218	0.27 (1)	
J-K	0 18	-91.8	-91.8 0.16 (1)	L-M	0 90	0.03 (4)	
K-L	0 35	-91.8	-91.8 0.12 (1)	M-N	0 135	0.03 (4)	
L-M	-255 0	0.0	0.0 0.03 (1)	N-O	-2514 0	0.97 (1)	
M-N	-255 0	0.0	0.0 0.03 (1)	O-P	-2514 0	0.97 (1)	
				P-Q			
U-T	0 1801	-18.5	-18.5 0.40 (1)	Q-R			
T-S	0 1900	-18.5	-18.5 0.41 (1)	R-O			
S-R	0 2723	-18.5	-18.5 0.49 (1)	O-P			
R-O	0 2723	-18.5	-18.5 0.49 (1)	P-Q			
O-P	0 2723	-18.5	-18.5 0.49 (1)	Q-R			
P-Q	0 2723	-18.5	-18.5 0.49 (1)	R-O			
Q-R	0 1900	-18.5	-18.5 0.41 (1)	O-P			
R-O	0 1801	-18.5	-18.5 0.40 (1)	P-Q			

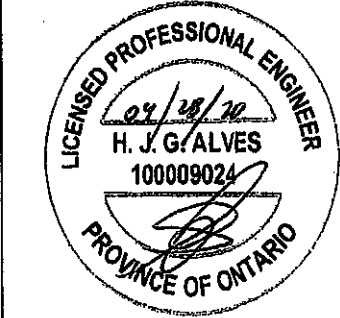

Structural component only
 DWG# T-2007605



JSI GRIP= 0.90 (D) INPUT = 0.90
JSI METAL= 0.62 (O) INPUT = 1.00




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408222	T5	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:00:08 2020 Page 1

ID:DMCubINVR6TsFoe31v6J zns11-BXPq ODBdXYU8Y7?bRV048IM4gExZrD7oSS2NmMFIt

1-3.8 0-0 5-1.9 5-1.9 4-11.1 10-0-10 7-8.6 17-7.0 7-8.6 25-1.6 30-0-7 5-1.9 35-2-0 1-3.8
Scale = 1/8" = 1'-0"

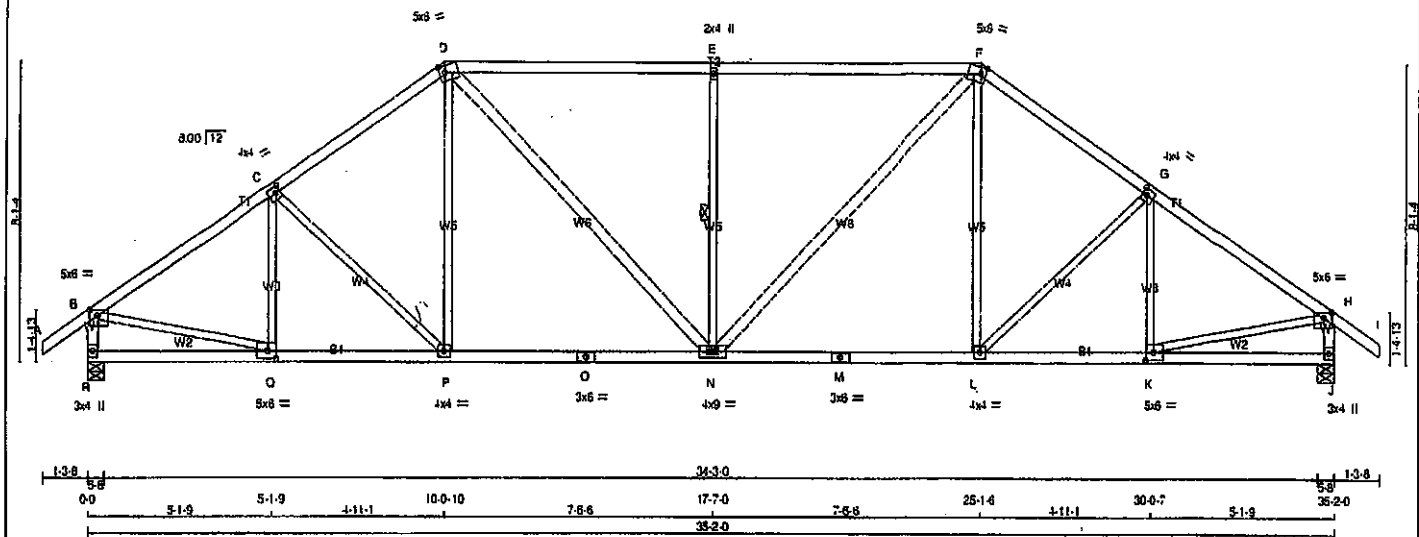

TOTAL WEIGHT = 2 X 158 = 317 lb

LUMBER				DESCR.	
CHORDS	SIZE	LUMBER			
A - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
F - I	2x4	DRY	No.2	SPF	
I - H	2x4	DRY	No.2	SPF	
H - O	2x4	DRY	No.2	SPF	
O - M	2x4	DRY	No.2	SPF	
M - J	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					
D - N	2x4	DRY	No.2	SPF	
N - F	2x4	DRY	No.2	SPF	
DRY: SEASONED LUMBER.					

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
	FACTORED	GROSS REACTION	MAXIMUM FACTORED	INPUT	RECORD				
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
R	2065	0	2065	0	5-8	5-8			
J	2065	0	2065	0	0	5-8	5-8		
UNFACTORED REACTIONS									
1ST CASE	MAX	MIN	COMPONENT	RECTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL		
R	1458	970	0	0	0	0	488	0	0
J	1458	970	0	0	0	0	488	0	0
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J									
BRACING									
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.47 FT.									
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.									
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.									
1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N.									
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW									

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED	FORCE	VERT. LOAD	LC1 MAX	MEMB.	MAX. FACTORED	FORCE	MAX	
		(LBS)	(PLF)	CSI (LC)			(LBS)	CSI (LC)	
FR-TO			FROM TO		FR-TO				
A-B	0	35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-321	0	0.11 (1)
B-C	-2317	0	-91.8	-91.8 0.38 (1)	4.16	C-P	-218	0	0.18 (1)
C-D	-2185	0	-91.8	-91.8 0.37 (1)	4.28	P-D	0	268	0.08 (1)
D-E	-2274	0	-91.8	-91.8 0.81 (1)	3.47	D-N	0	691	0.11 (1)
E-F	-2274	0	-91.8	-91.8 0.81 (1)	3.47	N-E	-851	0	0.35 (1)
F-G	-2185	0	-91.8	-91.8 0.37 (1)	4.28	N-F	0	691	0.11 (1)
G-H	-2317	0	-91.8	-91.8 0.38 (1)	4.16	L-F	0	268	0.08 (1)
H-I	0	35	-91.8	-91.8 0.12 (1)	10.00	L-G	-218	0	0.18 (1)
R-B	-2022	0	0.0	0.0 0.21 (1)	5.94	K-G	-321	0	0.11 (1)
J-H	-2022	0	0.0	0.0 0.21 (1)	5.94	B-Q	0	1995	0.45 (1)
R-Q	0	0	-18.5	-18.5 0.10 (4)	10.00	K-H	0	1995	0.45 (1)
Q-P	0	1993	-18.5	-18.5 0.40 (1)	10.00				
P-O	0	1794	-18.5	-18.5 0.41 (1)	10.00				
O-N	0	1794	-18.5	-18.5 0.41 (1)	10.00				
N-M	0	1794	-18.5	-18.5 0.41 (1)	10.00				
M-L	0	1794	-18.5	-18.5 0.41 (1)	10.00				
L-K	0	1953	-18.5	-18.5 0.40 (1)	10.00				
K-J	0	0	-18.5	-18.5 0.10 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CG

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
PART 9 OF CBC 2018, CBC 2012, ABC 2019
PART 9 OF CBC 2012 (2019 AMENDMENT)
CSA 088-09, CSA 088-14
TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.22")

CSI: TC=0.81 (1.00 (E-F:1), BC=0.41 (1.00 (L-N:1), WB=0.45 (1.00 (H-K:1), SS=0.34 (1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 789 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (H) (INPUT = 0.30)
JSI METAL = 0.84 (M) (INPUT = 1.00)

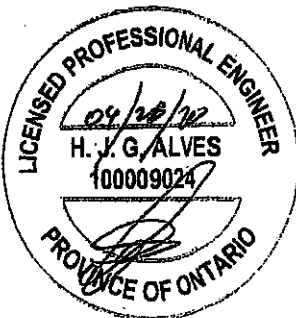

Structural component only
DWG# T-2007807

JOB NAME 408222	TRUSS NAME T6	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

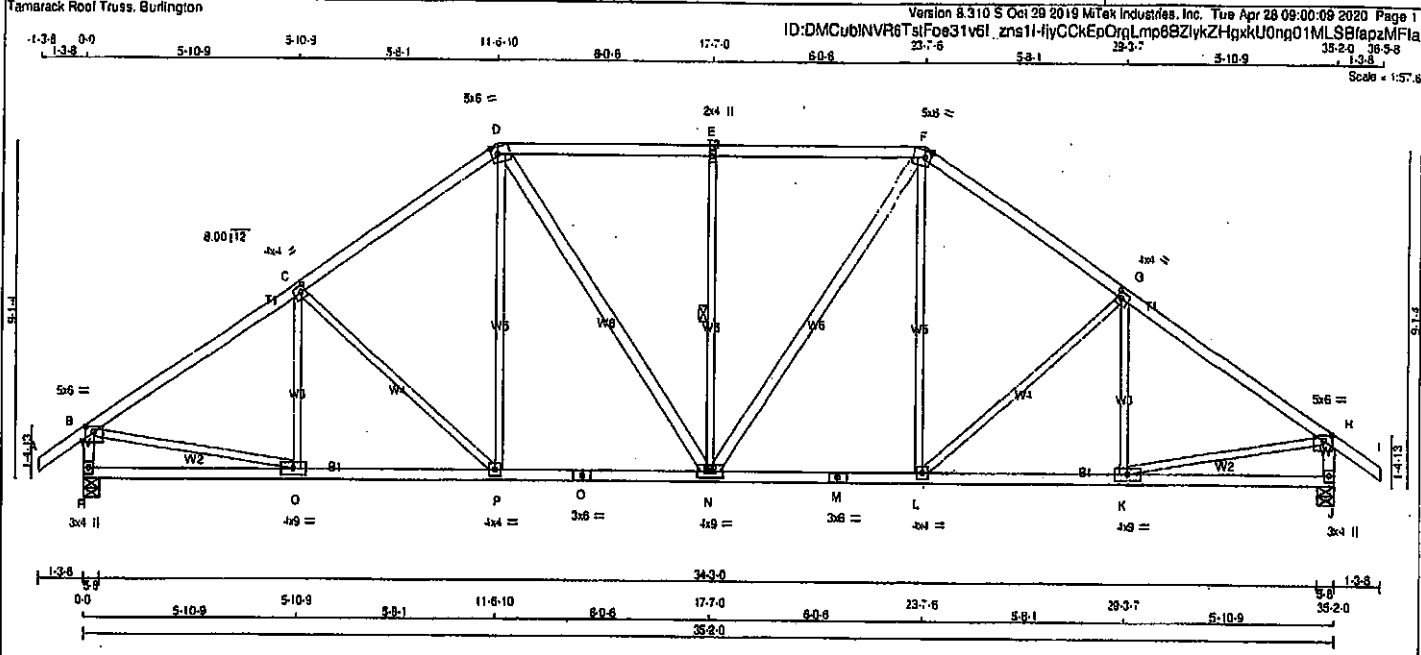

TOTAL WEIGHT = 2 X 165 = 329 LBS (M/F)

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
I - B	2x4	DRY	No.2
B - H	2x4	DRY	No.2
H - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
D - N	2x4	DRY	No.2
N - F	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	6.0	1.75	2.75
C	TMWV-t	MT20	4.0	4.0	2.00	1.50
D	TTWV-m	MT20	5.0	6.0	2.25	2.00
E	TMWV-w	MT20	2.0	4.0		
F	TTWV-m	MT20	5.0	6.0	2.25	2.00
G	TMWV-t	MT20	4.0	4.0	2.00	1.50
H	TMWV-p	MT20	5.0	6.0	1.75	2.75
J	BMV1-p	MT20	3.0	4.0		
K	BMWV-t	MT20	4.0	4.0		
L	BMWV-t	MT20	4.0	4.0		
M	BS-1	MT20	3.0	6.0		
N	BMWVW-t	MT20	3.0	6.0		
O	BS-1	MT20	3.0	6.0		
P	BMWV-t	MT20	4.0	4.0		
Q	BMWV-t	MT20	4.0	4.0		
R	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT	HORZ	DOWN	HORZ
R	2065	0	2065	0
J	2065	0	2065	0

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED							
R	1458	970	0	0	0	0	488	0
J	1458	970	0	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF E-N

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
FR-TO		FROM TO			FR-TO		
A-B	0	35	-91.8	-91.8 0.12 (1)	10.00	Q-C	-249
B-C	-2346	0	-91.8	-91.8 0.52 (1)	3.99	C-P	-356
C-D	-2095	0	-91.8	-91.8 0.48 (1)	4.22	P-D	0
D-E	-1985	0	-91.8	-91.8 0.49 (1)	4.28	D-N	0
E-F	-1885	0	-91.8	-91.8 0.49 (1)	4.28	N-E	-678
F-G	-2095	0	-91.8	-91.8 0.48 (1)	4.22	N-F	0
G-H	-2346	0	-91.8	-91.8 0.52 (1)	3.99	F-P	0
H-I	0	35	-91.8	-91.8 0.12 (1)	10.00	I-G	-356
I-B	-2018	0	0.0	0.0 0.21 (1)	5.84	K-G	-249
J-H	-2018	0	0.0	0.0 0.21 (1)	5.84	B-Q	0
R-Q	0	0	-18.5	-18.5 0.14 (4)	10.00	K-H	0
Q-P	0	1980	-18.5	-18.5 0.39 (1)	10.00		
P-O	0	1716	-18.5	-18.5 0.34 (1)	10.00		
O-N	0	1716	-18.5	-18.5 0.34 (1)	10.00		
N-M	0	1716	-18.5	-18.5 0.34 (1)	10.00		
M-L	0	1716	-18.5	-18.5 0.34 (1)	10.00		
L-K	0	1981	-18.5	-18.5 0.39 (1)	10.00		
K-J	0	0	-18.5	-18.5 0.14 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (11.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.107")
ALLOWABLE DEFL.(TL) = L/360 (11.17")
CALCULATED VERT. DEFL.(TL) = L/989 (0.197")

CS: TC=0.52/1.00 (G-H:1), BC=0.38/1.00 (K-L:1), WB=0.45/1.00 (H-K:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1867 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (H) INPUT = 0.90
JSI METAL = 0.58 (M) INPUT = 1.00



Structural component only
DWG# T-2007608

JOB NAME 408222	TRUSS NAME T7	QUANTITY 6	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

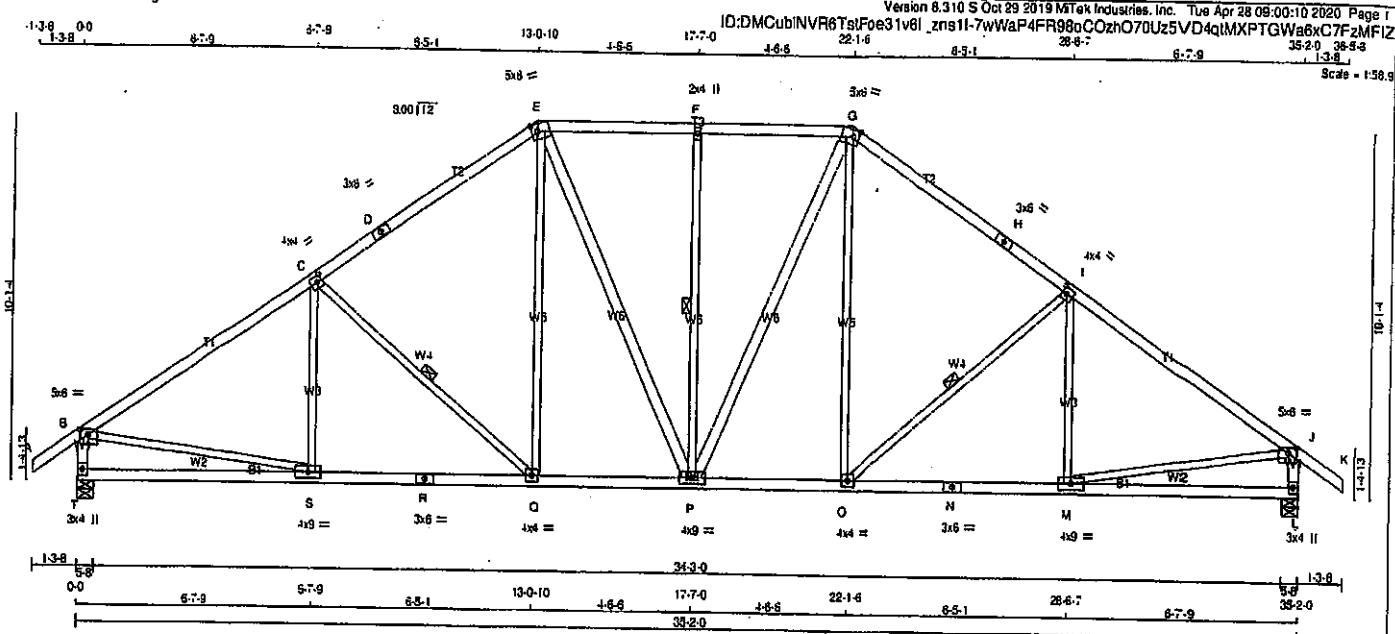

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
G - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
T - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
T - R	2x4	DRY	No.2
R - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
E - P	2x4	DRY	No.2
P - G	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMWW-p	MT20	5.0	6.0	1.75	2.75
C TMWW-1	MT20	4.0	4.0	2.00	1.50
D TS-1	MT20	3.0	6.0		
E TTWW-m	MT20	5.0	6.0	2.25	2.00
F TMWW-w	MT20	2.0	4.0		
G TTWW-m	MT20	5.0	6.0	2.25	2.00
H TS-1	MT20	3.0	6.0		
I TMWW-1	MT20	4.0	4.0	2.00	1.50
J TMWW-p	MT20	5.0	6.0	1.75	2.75
L BMV1-p	MT20	3.0	4.0		
M BMWW-1	MT20	4.0	9.0		
N BS-1	MT20	3.0	6.0		
O BMWW-1	MT20	4.0	4.0		
P BMWW-1	MT20	4.0	9.0		
Q BMWW-1	MT20	4.0	4.0		
R BS-1	MT20	3.0	6.0		
S BMWW-1	MT20	4.0	9.0		
T BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
T	2085	0	2085	0	5-8	5-8
L	2085	0	2085	0	5-8	5-8

UNFACTORED REACTIONS

JT	1ST LOASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM.LIVE			
T	1458	970	0	0	0	488	0
L	1458	970	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINTS) T, L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.77 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1:2 LENGTH OF C-O, F-P, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. (PLF)	MAX. (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. (LBS)
FR-TO					FR-TO		
A-B	0	35	-91.8	-91.8	10.00	S-C	-189
B-C	-2358	0	-91.8	-91.8	0.89 (1)	C-Q	-484
C-D	-1996	0	-91.8	-91.8	0.62 (1)	Q-E	0
D-E	-1996	0	-91.8	-91.8	0.62 (1)	E-P	0
E-F	-1781	0	-91.8	-91.8	0.27 (1)	P-F	-502
F-G	-1781	0	-91.8	-91.8	0.27 (1)	G-G	0
G-H	-1996	0	-91.8	-91.8	0.62 (1)	H-I	0
H-I	-1996	0	-91.8	-91.8	0.62 (1)	I-J	-484
I-J	-2358	0	-91.8	-91.8	0.89 (1)	J-K	-189
J-K	0	35	-91.8	-91.8	0.12 (1)	K-L	0
K-L	-2014	0	0.0	0.0	0.21 (1)	L-M	-189
L-M	-2014	0	0.0	0.0	0.21 (1)	M-J	0
M-J	0	0	-18.5	-18.5	0.19 (4)	J-K	0
J-K	0	0	-18.5	-18.5	0.42 (1)	K-L	0
K-L	0	0	-18.5	-18.5	0.42 (1)	L-M	0
L-M	0	0	-18.5	-18.5	0.32 (1)	M-J	0
M-J	0	0	-18.5	-18.5	0.32 (1)	J-K	0
J-K	0	0	-18.5	-18.5	0.42 (1)	K-L	0
K-L	0	0	-18.5	-18.5	0.42 (1)	L-M	0
L-M	0	0	-18.5	-18.5	0.42 (1)	M-J	0
M-J	0	0	-18.5	-18.5	0.19 (4)	J-K	0

TOTAL WEIGHT = 8 X 172 = 1030 lb (M/P)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (11.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.09")
ALLOWABLE DEFL.(TL) = L/360 (11.17")
CALCULATED VERT. DEFL.(TL) = L/999 (0.18")

CSI: TC=0.69(1.00 (I-J)), SC=0.42(1.00 (M-O)), WB=0.45(1.00 (J-M)), SS=0.24(1.00 (I-J))

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (I) (INPUT = 0.80)
JSI METAL = 0.87 (I) (INPUT = 1.00)



Structural component only
DWG# T-2007609

JOB NAME 408266	TRUSS NAME T9	QUANTITY 1	PLV 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Tue Apr 28 09:26:00 2020 Page 1	
ID:DMCubINVR6TstF0e31v6L_zns11-16AY4?7N5GLABHwyHSwMPwMINRZVE?GPExPzMEW				20-3-8	
Scale = 1:32.8					

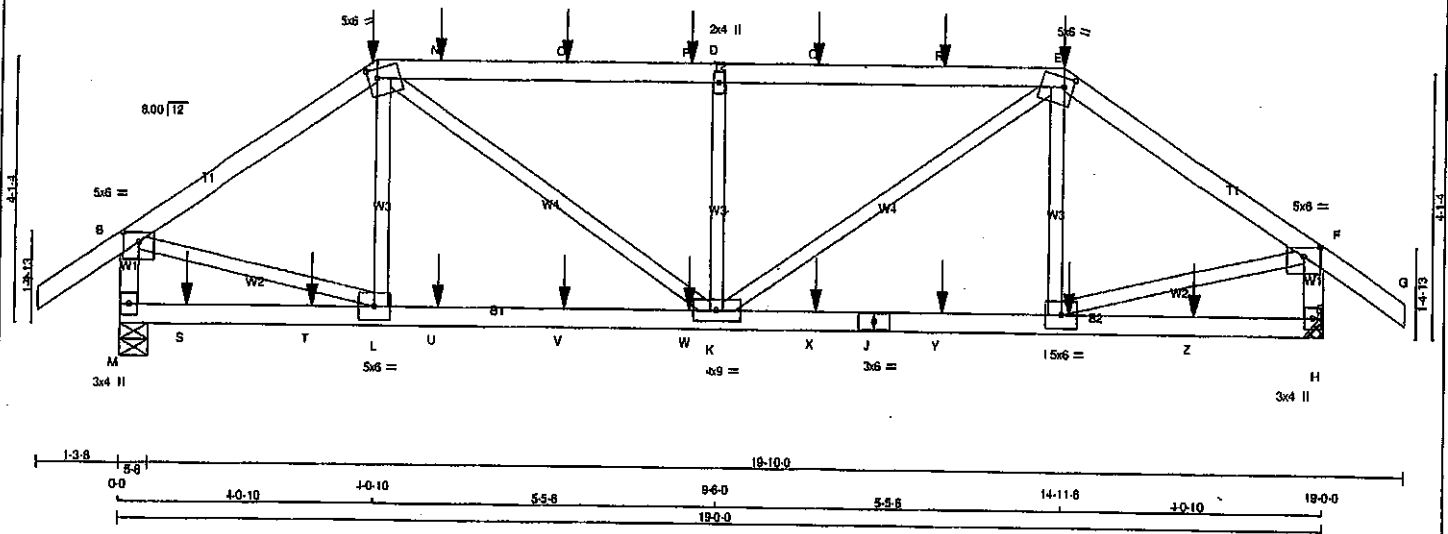

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	1650F 1.5E
E - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - F	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	5.0	8.0	1.75	3.00
C	TTWW-m	MT20	5.0	8.0	1.75	1.75
D	TMW-w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	1.75	1.75
F	TMWV-p	MT20	5.0	8.0	1.75	3.00
H	BMV1-p	MT20	3.0	4.0		
I	BMWV-t	MT20	5.0	6.0		
J	BS-1	MT20	3.0	8.0		
K	BMWVW-1	MT20	4.0	9.0		
L	BMWVW-1	MT20	5.0	6.0		
M	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	BRG	BRG	
M	VERT	1915	0	1915	0
H	HORIZ	1946	0	1946	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1352	901.0	0.0	0.0	0.0	452.0	0.0
H	1372	922.0	0.0	0.0	0.0	450.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.78 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	FORCE (LBS)	MEMB.	FORCE (LBS)
A-B	0.735	L-C	-265.42
B-C	-2012.0	C-K	0.1024
C-N	-2504.0	K-D	-975.0
N-O	-2504.0	D-E	0.971
O-P	-2504.0	E-F	-279.37
P-Q	-2504.0	F-G	0.1727
Q-R	-2504.0	G-H	0.1772
R-E	-2504.0		
E-F	-2065.0		
F-G	0.735		
M-B	-1867.0		
H-F	-1908.0		

FR-TO	FROM	TO	CS1 (LC)	MAX. FACTORED	UNBRACED LENGTH	FR-TO	FROM	TO	CS1 (LC)	MAX. FACTORED
A-B	0.735	-91.8	-91.8	0.14 (1)	10.00	L-C	-265.42	0.07 (1)		
B-C	-2012.0	-91.8	-91.8	0.37 (1)	4.35	C-K	0.1024	0.25 (1)		
C-N	-2504.0	-91.8	-91.8	0.77 (1)	3.78	K-D	-975.0	0.26 (1)		
N-O	-2504.0	-91.8	-91.8	0.77 (1)	3.78	D-E	0.971	0.24 (1)		
O-P	-2504.0	-91.8	-91.8	0.77 (1)	3.78	E-F	-279.37	0.08 (1)		
P-Q	-2504.0	-91.8	-91.8	0.77 (1)	3.78	F-G	0.1727	0.43 (1)		
Q-R	-2504.0	-91.8	-91.8	0.77 (1)	3.78	G-H	0.1772	0.44 (1)		
R-E	-2504.0	-91.8	-91.8	0.77 (1)	3.78					
E-F	-2065.0	-91.8	-91.8	0.38 (1)	4.30					
F-G	0.735	-91.8	-91.8	0.14 (1)	10.00					
M-B	-1867.0	0.0	0.0	0.21 (1)	6.09					
H-F	-1908.0	0.0	0.0	0.22 (1)	6.03					

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	---	C1
E	4-0-10	-255	-255	---	FRONT	VERT	SNOW	---	C1
E	14-11-6	-49	-55	---	FRONT	VERT	DEAD	---	C1
E	14-11-6	-117	-117	---	FRONT	VERT	TOTAL	---	C1
E	14-11-6	-255	-255	---	FRONT	VERT	SNOW	---	C1
I	15-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
N	5-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
O	7-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
P	9-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.83")
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")
ALLOWABLE DEFL.(TL) = L/360 (0.83")
CALCULATED VERT. DEFL.(TL) = L/999 (0.12")

CSI: TC=0.77/1.00 (D-E:1), BC=0.40/1.00 (K-L:1),
WB=0.44/1.00 (F:1), SS=0.45/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PS) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (i) (INPUT = 0.90)
JSI METAL= 0.82 (i) (INPUT = 1.00)



Structural component only
DWG# T-2007687

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Q	11-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
R	13-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
S	1-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
T	3-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
U	5-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
V	7-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
W	9-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
X	11-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Y	13-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
Z	17-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007687

JOB NAME 408266	TRUSS NAME T10	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

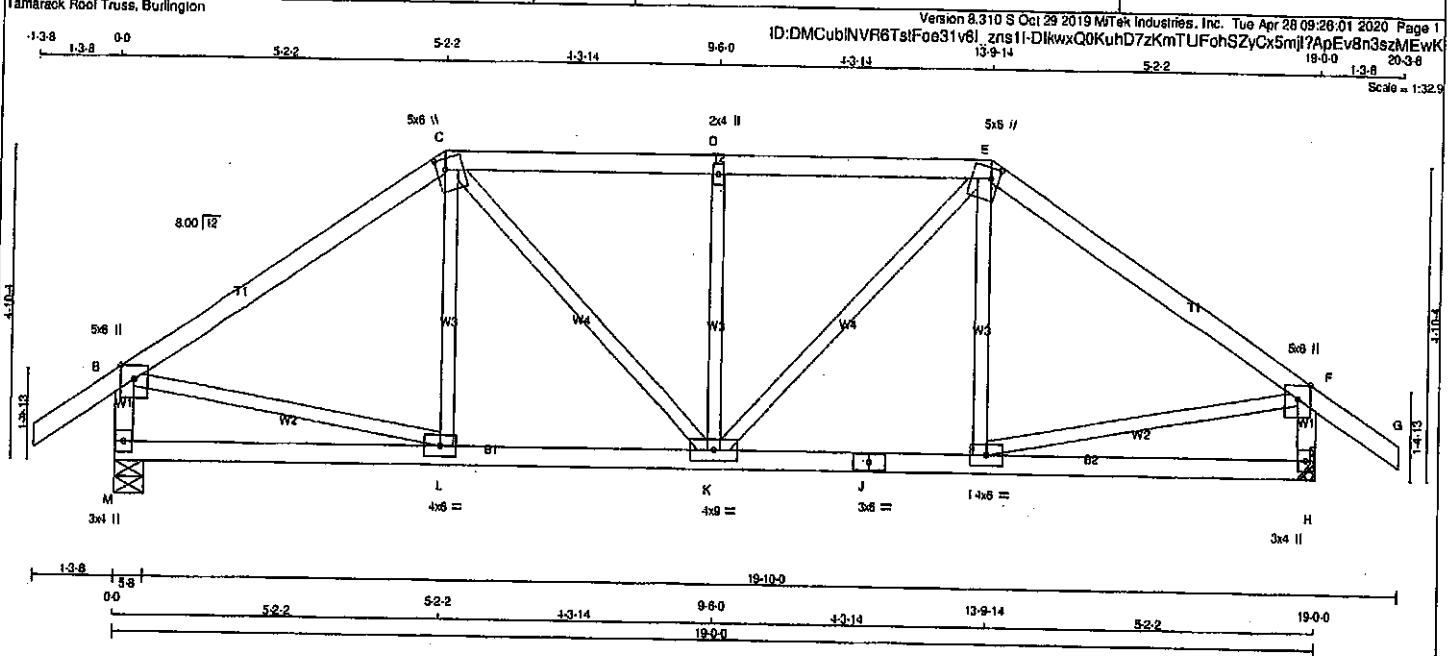

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - I	2x4	DRY	No.2	SPF
I - K	2x4	DRY	No.2	SPF
K - L	2x4	DRY	No.2	SPF
L - M	2x4	DRY	No.2	SPF
M - H	2x4	DRY	No.2	SPF
H - J	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	8.0	Edge
C	TTWW+m	MT20	5.0	8.0	2.00 1.50
D	TMVW-w	MT20	2.0	4.0	
E	TTWW+m	MT20	5.0	8.0	2.00 1.50
F	TMVW+p	MT20	5.0	8.0	Edge
H	BMV1+p	MT20	3.0	4.0	
I	BMVW-t	MT20	4.0	8.0	
J	BS-t	MT20	3.0	6.0	
K	BMVW-w	MT20	4.0	8.0	
L	BMVW-t	MT20	4.0	8.0	
M	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	RECORD BRG
	VERT	HORZ	DOWN	HORZ		
M	1173	0	1173	0	5-8	5-8
H	1173	0	1173	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	827	556 / 0	0 / 0	0 / 0	0 / 0	271 / 0	0 / 0
H	827	556 / 0	0 / 0	0 / 0	0 / 0	271 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.71 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED HORZ. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LC)	FACTORED HORZ. LOAD (LC)
FR-TO		FROM TO		FR-TO			
A-B	0.35	-91.8	-91.8 0.12 (1)	L-C	-75.55	0.03 (1)	
B-C	-1059.0	-91.8	-91.8 0.33 (1)	C-K	0.373	0.08 (1)	
C-D	-1135.0	-91.8	-91.8 0.23 (1)	K-D	-482.0	0.17 (1)	
D-E	-1135.0	-91.8	-91.8 0.23 (1)	K-E	0.373	0.08 (1)	
E-F	-1059.0	-91.8	-91.8 0.33 (1)	I-E	-75.55	0.03 (1)	
F-G	0.35	-91.8	-91.8 0.12 (1)	B-L	0.899	0.20 (1)	
M-B	-1133.0	0.0	0.0 0.12 (1)	B-L	0.899	0.20 (1)	
H-F	-1133.0	0.0	0.0 0.12 (1)				
M-L	0.0	-18.5	-18.5 0.11 (4)				
L-K	0.879	-18.5	-18.5 0.20 (1)				
K-J	0.879	-18.5	-18.5 0.20 (1)				
J-I	0.879	-18.5	-18.5 0.20 (1)				
I-H	0.0	-18.5	-18.5 0.11 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.83")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL) = L/360 (0.83")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.33/1.00 (B-C:1), BC=0.20/1.00 (K-L:1), WB=0.20/1.00 (B-L:1), SS=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PL)
MT20	618	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.66 (B) (INPUT = 0.80)
JSI METAL = 0.46 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007688

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	T12	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MTEK Industries, Inc. Tue Apr 26 08:26:04 2020 Page 1
ID:DMCubINVR6TstFos31v6f_zns11-dtQ3ZS2DBcbqgnU29NMO4CaiyJmVfVfWtNRqBzMEwH

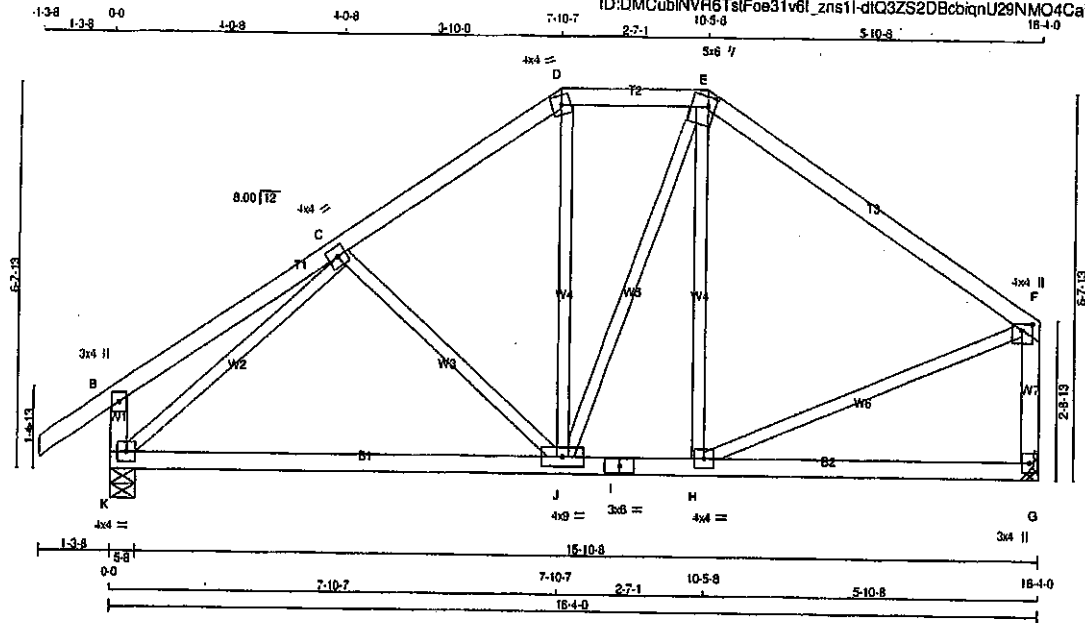

Scale = 1:36.7

LUMBER				N. L. G. A. RULES	
CHORDS	SIZE	DRY	LUMBER	DESCR	SPF
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - F	2x4	DRY	No.2	SPF	
K - B	2x4	DRY	No.2	SPF	
G - I	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-i	MT20	4.0	4.0		
D	TTW-m	MT20	4.0	4.0		
E	TTWW+m	MT20	5.0	6.0	2.00	1.50
F	TMWW+p	MT20	4.0	4.0	1.25	2.00
G	BMV1+p	MT20	3.0	4.0		
H	BMWW-i	MT20	4.0	4.0		
I	BS-i	MT20	3.0	8.0		
J	BMWWW-i	MT20	4.0	9.0		
K	BMWW1-i	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	HORIZ	UPLIFT
K	1026 0	1026 0	0	0	5-8
G	900 0	900 0	0	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	723	488 / 0	0 / 0	0 / 0	0 / 0	235 0	0 / 0
G	637	418 / 0	0 / 0	0 / 0	0 / 0	219 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED HORIZ. LOAD (LBS)
FR-TO			
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00
B-C	0 23	-91.8 -91.8 0.23 (1)	10.00
C-D	-735 0	-91.8 -91.8 0.18 (1)	6.25
D-E	-593 0	-91.8 -91.8 0.08 (1)	6.25
E-F	-654 0	-91.8 -91.8 0.41 (1)	6.25
K-B	-264 0	0.0 0.0 0.03 (1)	7.81
G-F	-853 0	0.0 0.0 0.12 (1)	7.81
K-J	0 -744	-18.5 -18.5 0.31 (4)	10.00
J-I	0 -541	-18.5 -18.5 0.30 (4)	10.00
I-H	0 -541	-18.5 -18.5 0.30 (4)	10.00
H-G	0 0	-18.5 -18.5 0.14 (4)	10.00

TOTAL WEIGHT = 75 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEF. (LL) = L/360 (0.54")
CALCULATED VERT. DEF. (LL) = L/999 (0.02")
ALLOWABLE DEF. (TL) = L/360 (0.54")
CALCULATED VERT. DEF. (TL) = L/999 (0.12")

CSK: TC=0.41/1.00 (E-F:1), BC=0.31/1.00 (J-K:4), WB=0.48/1.00 (C-K:1), SS=0.17/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (K) (INPUT = 0.90)
JSI METAL= 0.10 (I) (INPUT = 1.00)




Structural component only
DWG# T-2007690

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	T13	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:26:05 2020 Page 1
ID:DMCubINVR6TsiFoe31v6I zns11-54_Rmn3rywJZRx3F5iddP7wAjsEEpUO9X8?CdzMEwG

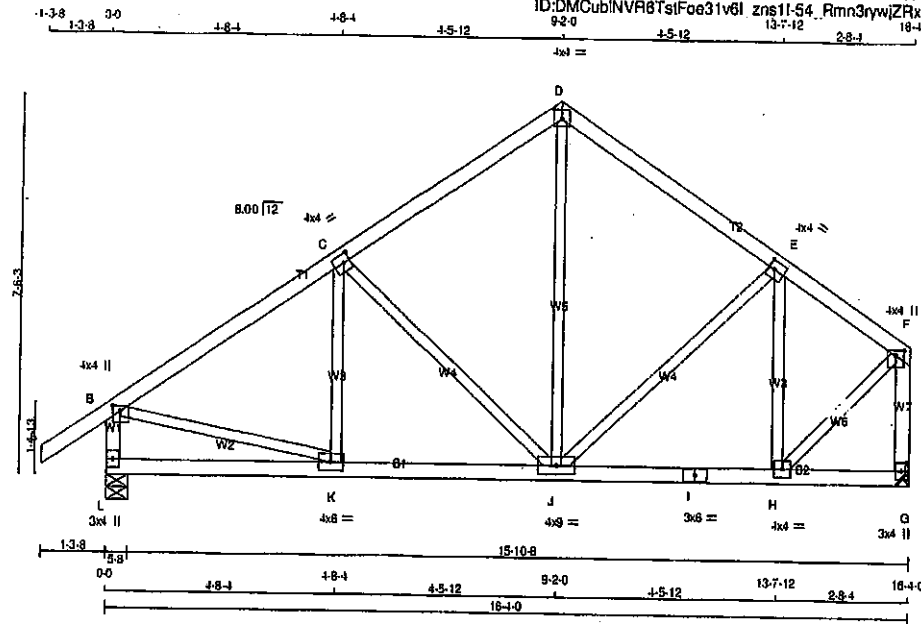

Scale = 1:12.2

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2		
D - F	2x4	DRY	No.2		
L - B	2x4	DRY	No.2		
G - F	2x4	DRY	No.2		
L - I	2x4	DRY	No.2		
I - G	2x4	DRY	No.2		

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWV+p	MT20	4.0	4.0	1.25	2.00
C	TMWV-l	MT20	4.0	4.0	2.00	1.50
D	TTW+p	MT20	4.0	4.0	2.25	2.00
E	TMWV-l	MT20	4.0	4.0	2.00	1.50
F	TMWV+p	MT20	4.0	4.0	2.00	1.50
G	BMV-l+p	MT20	3.0	4.0		
H	BMWV-l	MT20	4.0	4.0		
I	BS-l	MT20	3.0	6.0		
J	BMWVW-l	MT20	4.0	9.0		
K	BMWV-l	MT20	4.0	6.0		
L	BMV-l+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UPLIFT
L	1028	0	1028	0
G	900	0	900	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3'-8".

UNFACTORED REACTIONS

1ST LC CASE	MAX. MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
L	723	488.0	0.0	0.0	0.0	235.0	0.0
G	637	418.0	0.0	0.0	0.0	219.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.16 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 35	-91.8 -91.8	0.12 (1)	10.00	K-C	-88.45	0.03 (1)
B-C	-907.0	-91.8 -91.8	0.25 (1)	8.16	C-J	-370.0	0.25 (1)
C-D	-639.0	-91.8 -91.8	0.25 (1)	8.25	J-D	0 355	0.08 (1)
D-E	-631.0	-91.8 -91.8	0.21 (1)	6.25	J-E	-24.0	0.02 (1)
E-F	-597.0	-91.8 -91.8	0.18 (1)	6.25	H-E	-400.0	0.12 (1)
L-B	-980.0	0.0 0.0	0.10 (1)	7.81	B-K	0 798	0.18 (1)
G-F	-883.0	0.0 0.0	0.13 (1)	7.81	H-F	0 705	0.16 (1)
L-K	0 0	-18.5 -18.5	0.09 (4)	10.00			
K-J	0 778	-18.5 -18.5	0.17 (1)	10.00			
J-I	0 525	-18.5 -18.5	0.12 (1)	10.00			
I-H	0 525	-18.5 -18.5	0.12 (1)	10.00			
H-G	0 0	-18.5 -18.5	0.06 (4)	10.00			

TOTAL WEIGHT = 75 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.54")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.54")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CS1: TC=0.25/1.00 (B-C:1), BC=0.17/1.00 (J-K:1), WB=0.25/1.00 (C-J:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1867 788 1987 1858

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.26 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007691

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	T14	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:28:06 2020 Page 1
ID:DMCubINVR6TslFoe31v6l_znst1-aGYp_74TjDrQ35eRHoOs9df2p6UKzIEYNBSYk3zMEwF

Scale = 1:37.2

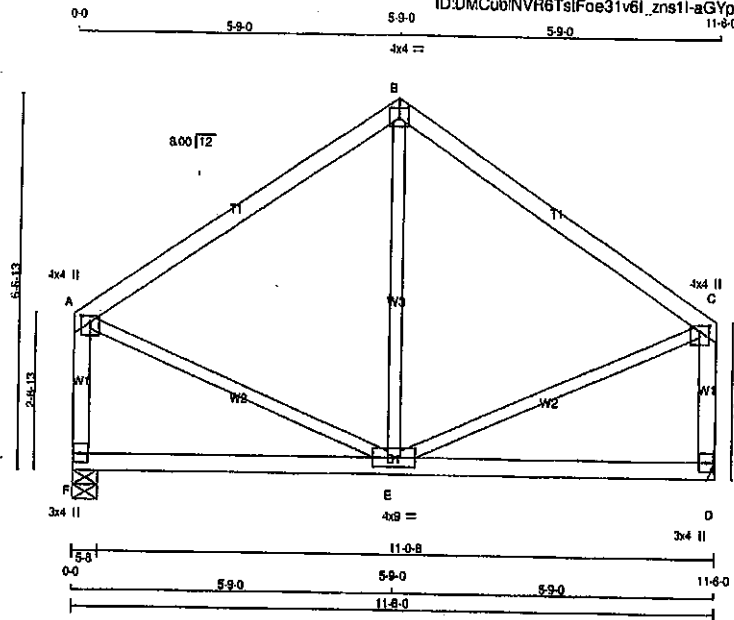

LUMBER	N. L. G. A. RULES	SIZE	LUMBER
A - B	2x4 DRY	No.2	
B - C	2x4 DRY	No.2	
F - A	2x4 DRY	No.2	
D - C	2x4 DRY	No.2	
F - D	2x4 DRY	No.2	

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table in inches)	W	LEN	Y	X
JT TYPE PLATES				
A - TMVW+p MT20	4.0	4.0	1.25	2.00
B - TTW+p MT20	4.0	4.0	2.25	2.00
C - TMVW+p MT20	4.0	4.0	1.25	2.00
D - BMV1+p MT20	3.0	4.0		
E - BMVWW-1 MT20	4.0	9.0		
F - BMV1+p MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	634	0	634	0
D	634	0	634	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-0.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM. LIVE WIND DEAD SOIL
F	448 294 / 0 0 / 0 0 / 0 0 0 0 154 / 0 0 / 0
D	448 294 / 0 0 / 0 0 / 0 0 0 0 154 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1 (PLF)	MEMB.	FORCE (LBS)
FR-TO			FR-TO	
A-B	-365 0	-91.8 -91.8 0.39 (1)	E-B	-123 54
B-C	-365 0	-91.8 -91.8 0.39 (1)	A-E	0 329
F-A	-593 0	0.0 0.0 0.09 (1)	E-C	0 329
D-C	-593 0	0.0 0.0 0.09 (1)		
F-E	0 0	-18.5 -18.5 0.18 (4)		
E-D	0 0	-18.5 -18.5 0.18 (4)		

TOTAL WEIGHT = 3 X 49 = 147 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
BOT CH. LL = 6.0 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CS: TC=0.39/1.00 (B-C:1), BC=0.18/1.00 (E-F:4), WB=0.09/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.41 (C) (INPUT = 0.80)
JSI METAL = 0.12 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007692

JOB NAME 408267	TRUSS NAME T14A	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 28 09:31:39 2020 Page 1
ID:DMCubINVR6TstFoe31v6I_zns1H-KK9it76LIYcAWGcRHEty9ryynL8PVuaZyV0WgZMe72

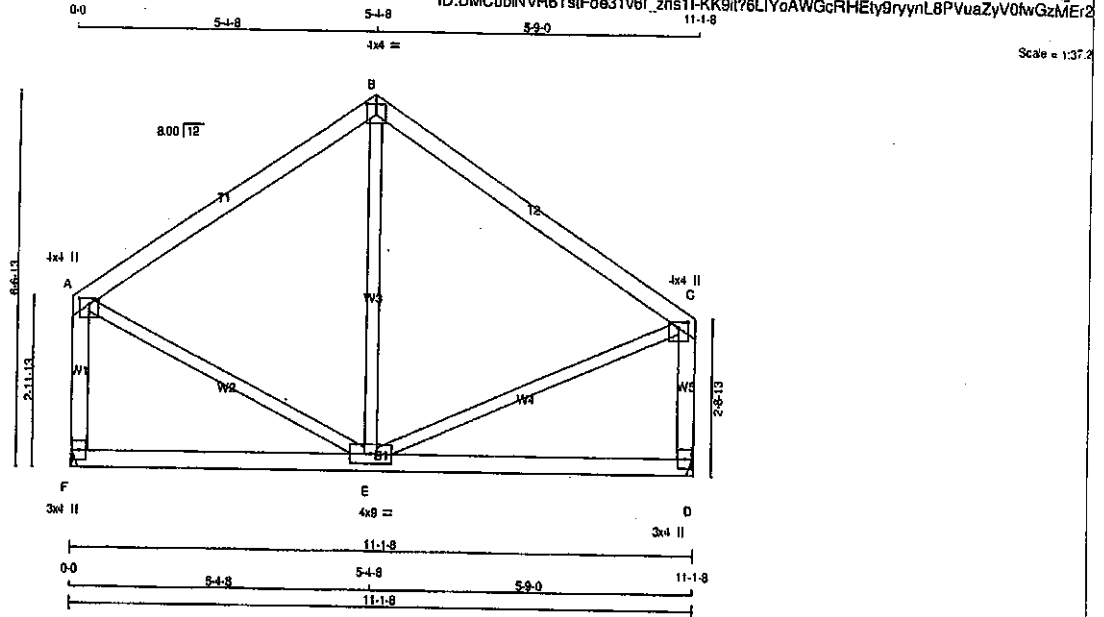

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
F - A	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMW+p	MT20	4.0	4.0	1.25 2.00
B	TTW+p	MT20	4.0	4.0	2.25 2.00
C	TMW+p	MT20	4.0	4.0	1.25 2.00
D	BMV1+p	MT20	3.0	4.0	
E	BMWVW-1	MT20	4.0	9.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
F	613	0	613	0	0
D	613	0	613	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1'-8", JOINT D = 1'-8".

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	434	285	0	0	0	0	149	0
D	434	285	0	0	0	0	149	0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX (PLF)	MEMB.	FORCE (LBS)
FR-TO				FR-TO	
A-B	-341	0	-91.8	E-B	-132
B-C	-341	0	-91.8	A-E	0
F-A	-578	0	0.0	E-C	0
D-C	-578	0	0.0		
F-E	0	0	-18.5		
E-D	0	0	-18.5		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.37")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.37")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.16/1.00 (D-E:4), WB=0.09/1.00 (B-E:1), SS=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.40 (A) (INPUT = 0.90)
JSI METAL= 0.12 (A) (INPUT = 1.00)



Structural component only
DWG# T-2007700

JOB NAME 408266	TRUSS NAME T15	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

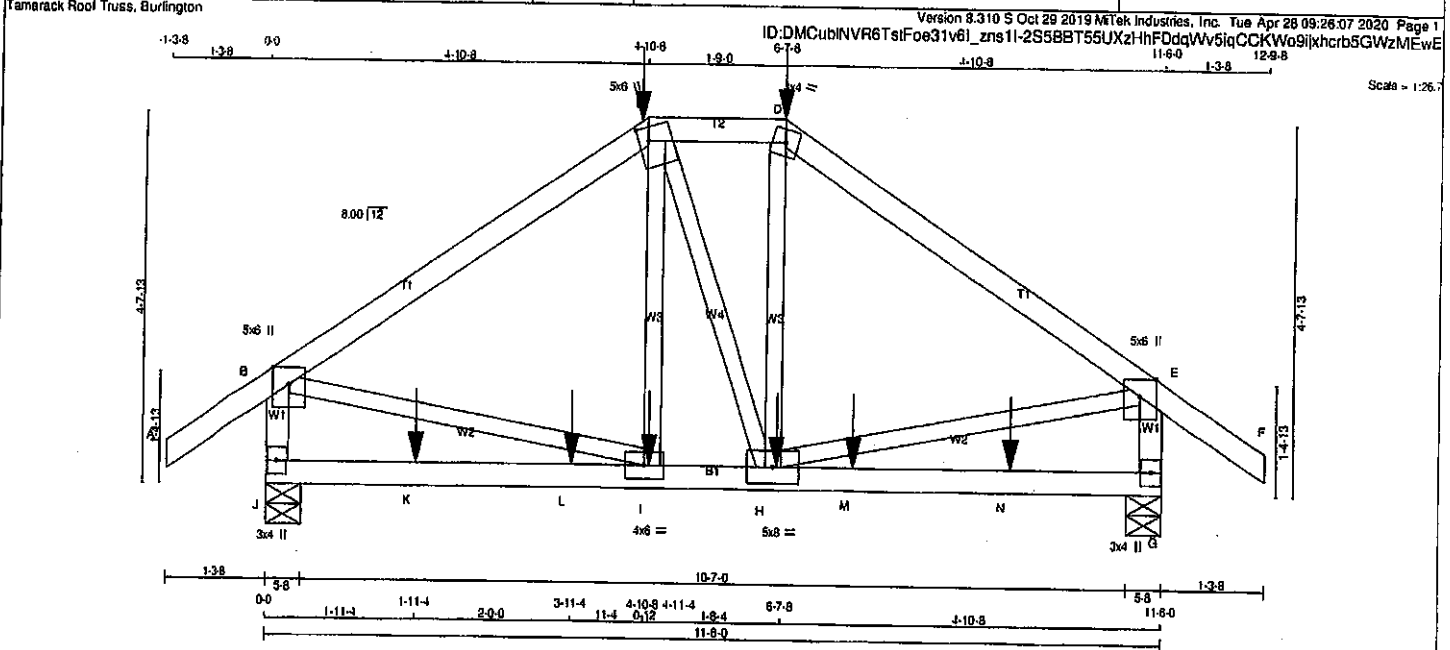

TOTAL WEIGHT = 52 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	8.0	Edge	
C	TTWW+m	MT20	5.0	8.0	2.00	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	5.0	8.0	Edge	
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-I	MT20	5.0	8.0		
I	BMVWW-I	MT20	4.0	8.0		
J	BMV1+p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	DOWN	GROSS REACTION	BRG	BRG
J	1274	0	1274	0	5-8
G	1274	0	1274	0	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	899	803.0	0.0	0.0	0.0	288.0	0.0
G	899	803.0	0.0	0.0	0.0	288.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.21 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL FITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO	
A-B	0 35	-91.8 -91.8	0.14 (1)	I-C	-83.73
B-C	-1179 0	-91.8 -91.8	0.47 (1)	C-H	0 4
C-D	-978 0	-91.8 -91.8	0.06 (1)	H-D	-82.77
D-E	-1180 0	-91.8 -91.8	0.47 (1)	B-I	0 1002
E-F	0 35	-91.8 -91.8	0.14 (1)	H-E	0 1003
J-B	-1218 0	0.0 0.0	0.14 (1)		
G-E	-1217 0	0.0 0.0	0.14 (1)		
J-K	0 0	-18.5 -18.5	0.18 (4)		
K-L	0 0	-18.5 -18.5	0.18 (4)		
L-I	0 0	-18.5 -18.5	0.18 (4)		
I-H	0 878	-18.5 -18.5	0.27 (4)		
H-M	0 0	-18.5 -18.5	0.19 (4)		
M-N	0 0	-18.5 -18.5	0.19 (4)		
N-G	0 0	-18.5 -18.5	0.19 (4)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	4-10-8	-434	-434	---	BACK	VERT	TOTAL	---	C1
D	8-7-8	-434	-434	---	BACK	VERT	TOTAL	---	C1
H	6-6-12	-27	-27	---	BACK	VERT	TOTAL	---	C1
I	4-11-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
K	1-11-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
L	3-11-4	-27	-27	---	BACK	VERT	TOTAL	---	C1
M	7-6-12	-27	-27	---	BACK	VERT	TOTAL	---	C1
N	9-6-12	-27	-27	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. G/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.36")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.36")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.47/1.00 (D-E:1), BC=0.27/1.00 (H-I:4), WB=0.25/1.00 (E-H:1), SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1887 788 1887 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.74 (E) (INPUT = 0.80)
JSI METAL = 0.51 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007893

JOB NAME 408266	TRUSS NAME T16	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:26:08 2020 Page 1
ID:DMCubINVR6TsiFoe31v6I_zns11-WifaPp5iFr58IPogODOKE2IRVw6CR8PrvVLipyZMEwD

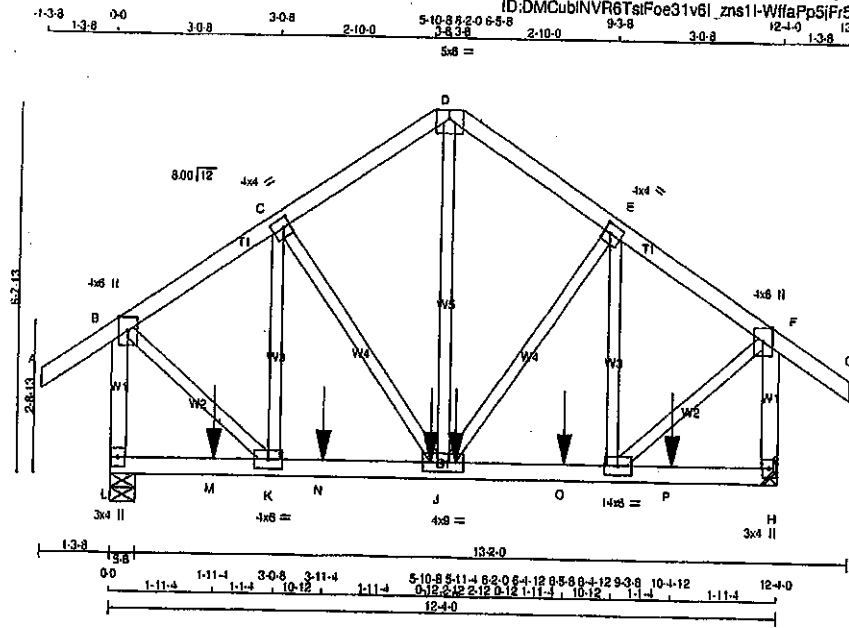

LUMBER			
N. L. G. A. RULES	SIZE	DRY	LUMBER
CHORDS			
A - D	2x4	DRY	No.2
D - G	2x4	DRY	No.2
L - B	2x4	DRY	No.2
L - F	2x4	DRY	No.2
L - H	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMWV+p	MT20	4.0	6.0	Edge
C	TMWV-l	MT20	4.0	4.0	2.00 1.50
D	TMTMW+m	MT20	5.0	6.0	Edge 3.00
E	TMWV-t	MT20	4.0	4.0	2.00 1.50
F	TMWV+p	MT20	4.0	6.0	Edge
H	BMV1+p	MT20	3.0	4.0	
I	BMWV-l	MT20	4.0	6.0	
J	BMWVW-l	MT20	4.0	6.0	
K	BMWV-l	MT20	4.0	6.0	
L	BMV1+p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS					
FACTORED	MAXIMUM FACTORED	INPUT	RECORD		
GROSS REACTION	GROSS REACTION	BRG	BRG		
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
L	1699	0	1699	0	0
H	1699	0	1699	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3'-8".

UNFACTORED REACTIONS						
1ST CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
L	1194	825 / 0	0 / 0	0 / 0	0 / 0	0 / 0
H	1194	825 / 0	0 / 0	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.79 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MAX. FACTORED		FACTORED		MEMB.		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. UNBRAC (LBS)	MEMB.	FORCE (LBS)	MAX. CS (LBS)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0 35	-91.8	-91.8 0.14 (1)	10.00	K-C	-208 0 0.07 (1)	
B-C	-1121 0	-91.8	-91.8 0.15 (1)	5.79	C-J	-112 0 0.06 (1)	
C-D	-1075 0	-91.8	-91.8 0.15 (1)	5.88	J-E	-112 0 0.06 (1)	
D-E	-1075 0	-91.8	-91.8 0.15 (1)	5.88	E-I	-208 0 0.07 (1)	
E-F	-1121 0	-91.8	-91.8 0.14 (1)	5.79	B-K	0 1208 0.30 (1)	
F-G	0 35	-91.8	-91.8 0.14 (1)	10.00	I-F	0 1208 0.30 (1)	
L-B	-1618 0	0.0	0.0 0.25 (1)	6.46	J-D	0 946 0.23 (1)	
H-F	-1618 0	0.0	0.0 0.25 (1)	6.46			
L-M	0 0	-18.5	-18.5 0.24 (1)	10.00			
M-K	0 0	-18.5	-18.5 0.24 (1)	10.00			
K-N	0 946	-18.5	-18.5 0.41 (1)	10.00			
N-J	0 946	-18.5	-18.5 0.41 (1)	10.00			
J-O	0 946	-18.5	-18.5 0.40 (1)	10.00			
O-I	0 946	-18.5	-18.5 0.40 (1)	10.00			
I-P	0 0	-18.5	-18.5 0.24 (1)	10.00			
P-H	0 0	-18.5	-18.5 0.24 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)							
JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE
J	5-11-4	-297	-297	---	BACK	VERT	TOTAL
J	6-4-12	-297	-297	---	BACK	VERT	TOTAL
M	1-11-4	-291	-291	---	BACK	VERT	TOTAL
N	3-11-4	-305	-305	---	BACK	VERT	TOTAL
O	8-4-12	-305	-305	---	BACK	VERT	TOTAL
P	10-4-12	-291	-291	---	BACK	VERT	TOTAL

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCG 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

165 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.41")
CALCULATED VERT. DEFL. (LL) = L/999 (0.02")
ALLOWABLE DEFL. (TL) = L/360 (0.41")
CALCULATED VERT. DEFL. (TL) = L/999 (0.04")

CSI: TC=0.28/1.00 (B-L:1), BC=0.41/1.00 (J-K:1), WB=0.30/1.00 (B-K:1), SS=0.24/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.88 (B) (INPUT = 0.90)
JSI METAL = 0.58 (F) (INPUT = 1.00)



Structural component only
DWG# T-2007694

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408266	T17S	2	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:28:10 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1t-S1nKqV7_nSLsYiCWetokTqpkzt5v6e7lpqmtqzMEwB

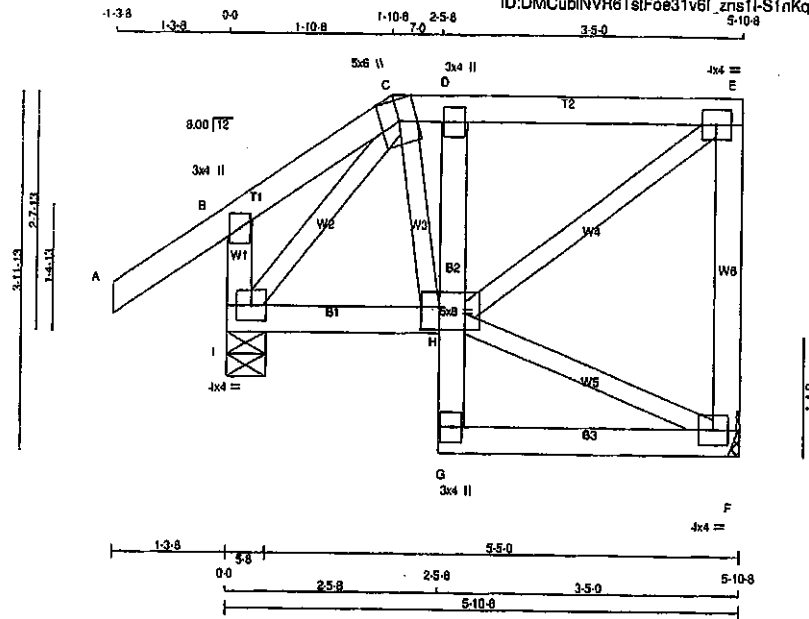

TOTAL WEIGHT = 2 X 34 = 68 lb

N. L. G. A. RULES	SIZE	LUMBER
I - B	2x4 DRY	No.2
A - C	2x4 DRY	No.2
C - E	2x4 DRY	No.2
F - E	2x4 DRY	No.2
I - H	2x4 DRY	No.2
G - D	2x4 DRY	No.2
G - F	2x4 DRY	No.2
ALL WEBS	2x3 DRY	No.2
SEASONED LUMBER.		

DESCR.
SPF
SPF
SPF
SPF
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
I	485 0	485 0	5-8	5-8
F	309 0	309 0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	326	229 0	0 0	0 0	0 0	0 0	97 0	0 0
F	219	142 0	0 0	0 0	0 0	0 0	77 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO		FR-TO			
I-B	-259 0	0.0 0.0 0.03 (1)	7.81	H-F	-8 0	0.00 (1)	
A-B	0 35	-91.8 -91.8 0.12 (1)	10.00	H-E	0 259	0.06 (1)	
B-C	-25 0	-91.8 -91.8 0.12 (1)	8.25	C-H	0 237	0.05 (1)	
C-D	-214 0	-91.8 -91.8 0.11 (1)	8.25	I-C	-234 0	0.04 (1)	
D-E	-210 0	-91.8 -91.8 0.12 (1)	6.25				
F-E	-277 0	0.0 0.0 0.07 (1)	7.81				
I-H	0 148	-18.5 -18.5 0.05 (4)	10.00				
G-H	0 34	0.0 0.0 0.02 (1)	10.00				
H-D	-327 0	0.0 0.0 0.01 (1)	7.81				
G-F	0 6	-18.5 -18.5 0.06 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

OVERHANG NOT TO BE ALTERED OR CUT OFF.
(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = L/969 (0.01")

CS1: TC=0.12/1.00 (A-B:1), BC=0.08/1.00 (F-G:4), WB=0.06/1.00 (E-H:1), SS1=0.14/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PL)
MAX MIN	MAX MIN	MAX MIN
MT20	618 354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 6.0 Deg.

JSI GRIP = 0.26 (E) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007695

JOB NAME 408266	TRUSS NAME T18S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	--------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:26:11 2020 Page 1
ID:DMCubINVR6TstFoe31vdl_zns11-wEU11r8cXmT9sXO3L_1sgN_17DKeYwHXTZJQHMEwA

Scale = 1:30.5

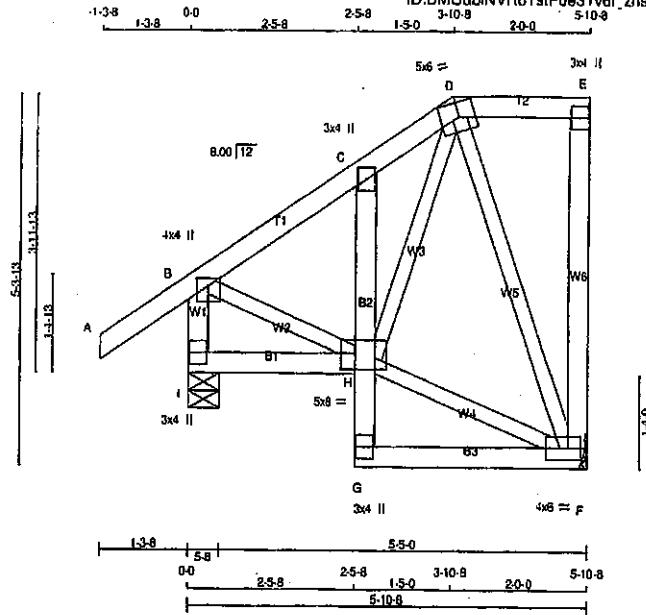

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
I - B	2x4	DRY	No.2
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
F - E	2x4	DRY	No.2
I - H	2x4	DRY	No.2
G - C	2x4	DRY	No.2
G - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
C	TMV+p	MT20	3.0	4.0	
D	TTWW-m	MT20	5.0	8.0	2.50 2.75
E	TMV+p	MT20	3.0	4.0	
F	BMVWW1-i	MT20	4.0	6.0	
G	BMV+p	MT20	3.0	4.0	
H	BMVWWW-i	MT20	5.0	8.0	2.75 2.50
I	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
I	450	0	450	0	5-8
F	324	0	324	0	5-8
		MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
I	316	221.0	0.0	0.0	0.0	0.0	95.0	0.0
F	229	150.0	0.0	0.0	0.0	0.0	79.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)	
FR-TO		FROM TO		FR-TO			
I-B	-428.0	0.0	0.0 (1)	7.81	B-H	0.201	0.05 (1)
A-B	0.35	-91.8	-91.8 (1)	10.00	H-F	0.90	0.02 (1)
B-C	-214.0	-91.8	-91.8 (1)	6.25	H-D	0.245	0.08 (1)
C-D	-227.0	-91.8	-91.8 (1)	6.25	D-F	-255.0	0.12 (1)
D-E	0.0	-91.8	-91.8 (1)	10.00			
F-E	-90.0	0.0	0.0 (1)	7.81			
I-H	0.0	-18.5	-18.5 (4)	10.00			
G-H	0.34	0.0	0.0 (1)	10.00			
H-C	-220.0	0.0	0.0 (1)	7.81			
G-F	0.9	-18.5	-18.5 (4)	10.00			

TOTAL WEIGHT = 2 X 39 = 77 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSR: TC=0.12/1.00 (A-B:1), BC=0.08/1.00 (F-G:4),
WB=0.12/1.00 (D-F:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1856


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.30 (B) (INPUT = 0.90)
JSI METAL = 0.09 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007696

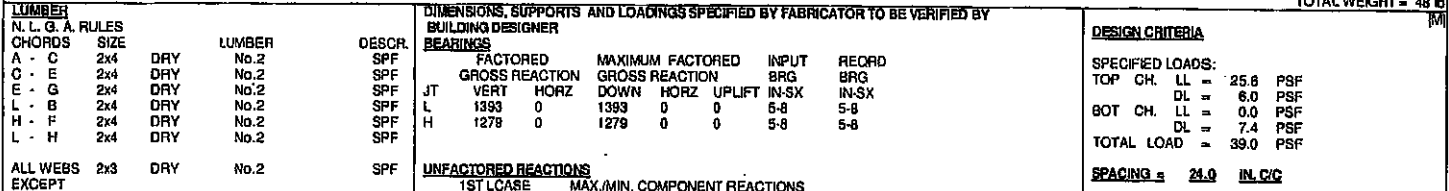

PLATES (table in inches)							BRACING				SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015			
JT	TYPE	PLATES	W	LEN	Y	X	TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.43 FT.				THIS DESIGN COMPLIES WITH: - PART 9 OF NBC 2010, NBC 2012, NBC 2019 - PART 9 OF NBC 2012 (2019 AMENDMENT) - CSA 086-09, CSA 086-14 - TPC 2011, TPC 2014			
B	TMVW+p	MT20	5.0	6.0	Edge		MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.							
C	TTWW+m	MT20	6.0	9.0	Edge 1.75		ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.				DESIGN ASSUMPTIONS - OVERHANG NOT TO BE ALTERED OR CUT OFF.			
D	TMVW+w	MT20	2.0	4.0										
E	TTWW+m	MT20	6.0	9.0	Edge 1.75		LOADING TOTAL LOAD CASES: (4)				CHORDS MAX. FACTORED FACTORED MAX. FACTORED			
F	TMVW+p	MT20	5.0	6.0	Edge									
H	BMV1+p	MT20	3.0	4.0			WEBS							
I	BMVW-1	MT20	4.0	4.0										
J	BMVW-1	MT20	4.0	9.0										
K	BMVW-1	MT20	4.0	4.0										

B-C	-1119	0	-91.8	-91.8	0.15 (1)	5.79	C-J	0	1028	0.25 (1)	ALLOWABLE DEFL.(LL)= L/360 (0.38")
C-M	-1857	0	-91.8	-91.8	0.52 (1)	4.43	J-D	-791	0	0.14 (1)	CALCULATED VERT. DEFL.(LL) = L/ 999 (0.03")
M-N	-1657	0	-91.8	-91.8	0.52 (1)	4.43	J-E	0	1117	0.28 (1)	ALLOWABLE DEFL.(TL)= L/360 (0.38")
N-O	-1857	0	-91.8	-91.8	0.52 (1)	4.43	I-E	-167	4	0.03 (1)	CALCULATED VERT. DEFL.(TL) = L/ 999 (0.06")
D-O	-1858	0	-91.8	-91.8	0.52 (1)	4.43	B-K	0	852	0.21 (1)	
O-E	-1656	0	-91.8	-91.8	0.52 (1)	4.43	I-F	0	783	0.19 (1)	
E-F	-1007	0	-91.8	-91.8	0.15 (1)	8.03					
F-G	0	-45	-91.8	-91.8	0.14 (1)	10.00					
L-B	-1425	0	0.0	0.0	0.16 (1)	8.80					
H-F	-1303	0	0.0	0.0	0.15 (1)	7.03					
L-K	0	0	-18.5	-18.5	0.11 (4)	10.00					
K-P	0	745	-18.5	-18.5	0.24 (1)	10.00					
P-Q	0	745	-18.5	-18.5	0.24 (1)	10.00					
Q-J	0	745	-18.5	-18.5	0.24 (1)	10.00					
J-R	0	685	-18.5	-18.5	0.21 (1)	10.00					
R-I	0	685	-18.5	-18.5	0.21 (1)	10.00					
I-H	0	0	-18.5	-18.5	0.09 (4)	10.00					

CSI: TC=0.52/1.00 (C-D:1), BC=0.24/1.00 (J-K:1),
WB=0.28/1.00 (E-J:1), SS=0.31/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT
RESPONSIBLE FOR QUALITY CONTROL IN THE
TRUSS MANUFACTURING PLANT.


11. C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

Structural component only
DWG# T-2007697



Structural component only
DWG# T-2007697

JOB NAME 408267	TRUSS NAME T20	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 9 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:31:41 2020 Page 1	
ID:DMCubINVR6TstFoe31v6I_zns1t-GHSlq7cq92ulakPhVQEG1Kr9dMzcKsQpVm79zMEr0				Scale = 1:50	

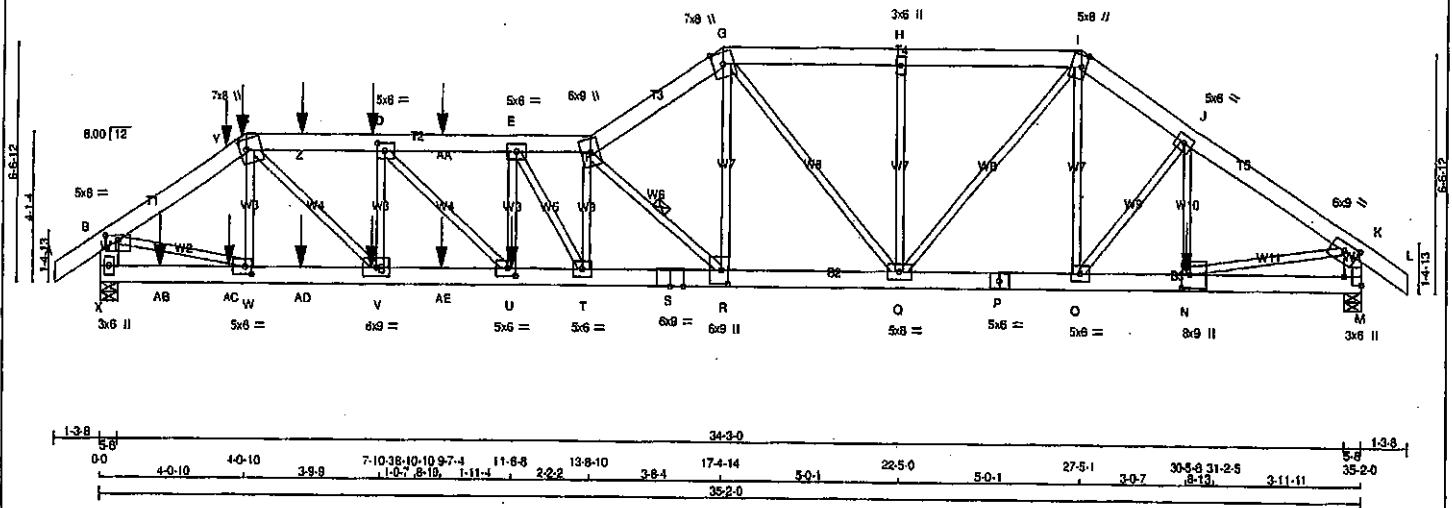

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - C	2x8	DRY	No.2
C - F	2x8	DRY	No.2
F - G	2x8	DRY	No.2
G - I	2x8	DRY	No.2
I - L	2x8	DRY	No.2
X - B	2x8	DRY	No.2
M - K	2x8	DRY	No.2
X - S	2x8	DRY	No.2
S - P	2x8	DRY	No.2
P - M	2x8	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	2	12
C-F	2	12
F-G	2	12
G-I	2	12
I-L	2	12
X-B	2	12
M-K	2	12
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
X-S	2	12
S-P	2	12
P-M	2	12
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6
J-N	1	2
E-U	1	4

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	RECORD
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
X	4943	0	4943	0	5-8
M	6230	0	6230	0	5-8

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
X	3484	2351.0	0.0	0.0	0.0	0.0	1133.0	0.0
M	4391	2963.0	0.0	0.0	0.0	0.0	1428.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) X, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.40 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF F-R.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	FACTORED MAX. CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0.38	-91.8	-91.8 0.04 (1)	10.00	W-C	-958.0	0.11 (1)
B-Y	-6162.0	-91.8	-91.8 0.14 (1)	4.68	T-F	-349.0	0.04 (1)
Y-C	-6162.0	-91.8	-91.8 0.14 (1)	4.68	F-R	-6799.0	0.77 (1)
C-Z	-8807.0	-91.8	-91.8 0.19 (1)	3.97	R-G	0.4855	0.60 (1)
Z-D	-8807.0	-91.8	-91.8 0.19 (1)	3.97	G-Q	-861.0	0.52 (1)
D-AA	-11625.0	-91.8	-91.8 0.29 (1)	3.40	Q-H	-481.0	0.15 (1)
AA-E	-11625.0	-91.8	-91.8 0.29 (1)	3.40	H-I	0.1604	0.20 (1)
E-F	-11774.0	-91.8	-91.8 0.24 (1)	3.43	C-I	0.1975	0.24 (1)
F-G	-8253.0	-91.8	-91.8 0.15 (1)	4.13	B-W	0.5256	0.85 (1)
G-H	-6402.0	-91.8	-91.8 0.13 (1)	4.81	N-K	0.6816	0.84 (1)
H-I	-6402.0	-91.8	-91.8 0.13 (1)	4.61	U-E	-320.0	0.04 (1)
I-J	-6431.0	-91.8	-91.8 0.12 (1)	4.62	N-J	0.2292	0.28 (1)
J-K	-8060.0	-91.8	-91.8 0.22 (1)	4.11	O-J	-2194.0	0.46 (1)
K-L	0.36	-91.8	-91.8 0.04 (1)	10.00	E-T	0.298	0.04 (1)
X-B	-4896.0	0.0	0.0 0.17 (1)	6.58	V-D	-3366.0	0.40 (1)
M-K	-6107.0	0.0	0.0 0.22 (1)	5.99	C-V	0.5109	0.63 (1)
					D-U	0.3960	0.49 (1)
X-AB	0.0	-18.5	-18.5 0.03 (4)	10.00			
AB-AC	0.0	-18.5	-18.5 0.03 (4)	10.00			
AC-W	0.0	-18.5	-18.5 0.03 (4)	10.00			
W-AD	0.5110	-18.5	-18.5 0.35 (1)	10.00			
AD-V	0.5110	-18.5	-18.5 0.35 (1)	10.00			
V-AE	0.8807	-18.5	-18.5 0.67 (1)	10.00			
AE-U	0.8807	-18.5	-18.5 0.67 (1)	10.00			
U-T	0.11625	-18.5	-18.5 0.89 (1)	10.00			
T-S	0.11782	-18.5	-18.5 0.90 (1)	10.00			
S-R	0.11782	-18.5	-18.5 0.90 (1)	10.00			
R-Q	0.6950	-18.5	-18.5 0.47 (1)	10.00			
Q-P	0.5382	-18.5	-18.5 0.39 (1)	10.00			
P-O	0.5382	-18.5	-18.5 0.39 (1)	10.00			
O-N	0.6896	-18.5	-18.5 0.57 (1)	10.00			
N-M	0.0	-18.5	-18.5 0.14 (1)	10.00			

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	4-0-10	-49	-55	---	FRONT	VERT	DEAD	C1
C	4-0-10	-255	-255	---	FRONT	VERT	SNOW	C1
D	7-7-4	-110	-110	---	BACK	VERT	TOTAL	C1

TOTAL WEIGHT = 2 X 205 = 410 lb

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
ADDT'L USER DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.26")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/905 (0.47")

CSI: TC=0.29/1.00 (D-E:1), BC=0.90/1.00 (R-T:1),
WB=0.84/1.00 (K-N:1), SS=0.10/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (W) (INPUT = 0.90)
JSI METAL = 0.98 (F) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007701/1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	ORWG NO.
408267	T20	1	2	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:31:41 2020 Page 2

ID:DMCubINVR6TsiFoe3Iv6I_zns1I-GHSIn7cg92ulakPfvQEG1Kr9dMzcKsOpVm79zMErQ

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE PLATES				
B TMVW-p MT20	5.0	8.0	1.50	4.00
C TTWW+m MT20	7.0	8.0	3.50	2.00
D TMWW-l MT20	5.0	8.0	2.50	2.50
E TMWW-l MT20	5.0	6.0		
F TTWW+m MT20	6.0	9.0		
G TTWW+m MT20	7.0	8.0	Edge	
H TMW+w MT20	3.0	6.0		
I TTWW+m MT20	5.0	8.0	4.00	1.50
J TMWW-l MT20	5.0	6.0		
K TMWW-l MT20	6.0	9.0	2.50	4.50
M BMV1+p MT20	3.0	6.0	3.00	Edge
N BMWW-l MT20	8.0	9.0	4.50	3.00
O BMWW-l MT20	5.0	6.0		
P BS-l MT20	5.0	6.0		
Q BMWW-l MT20	5.0	8.0		
R BMWW-l MT20	6.0	9.0	4.50	2.25
S BS-l MT20	6.0	9.0		
T BMWW-l MT20	5.0	6.0		
U BMWW-l MT20	5.0	8.0	2.50	2.50
V BMWW-l MT20	6.0	9.0		
W BMWW-l MT20	5.0	8.0	2.50	2.00
X BMV1+p MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
N	30-5-8	-3728	-3728	---	BACK	VERT	TOTAL	---	C1
U	11-6-8	-2404	-2404	---	BACK	VERT	TOTAL	---	C1
V	7-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	3-7-4	-136	-136	---	BACK	VERT	TOTAL	---	C1
Z	5-7-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AA	9-7-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
AB	1-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AC	3-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AD	5-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1
AE	9-7-4	-26	-26	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007701 92

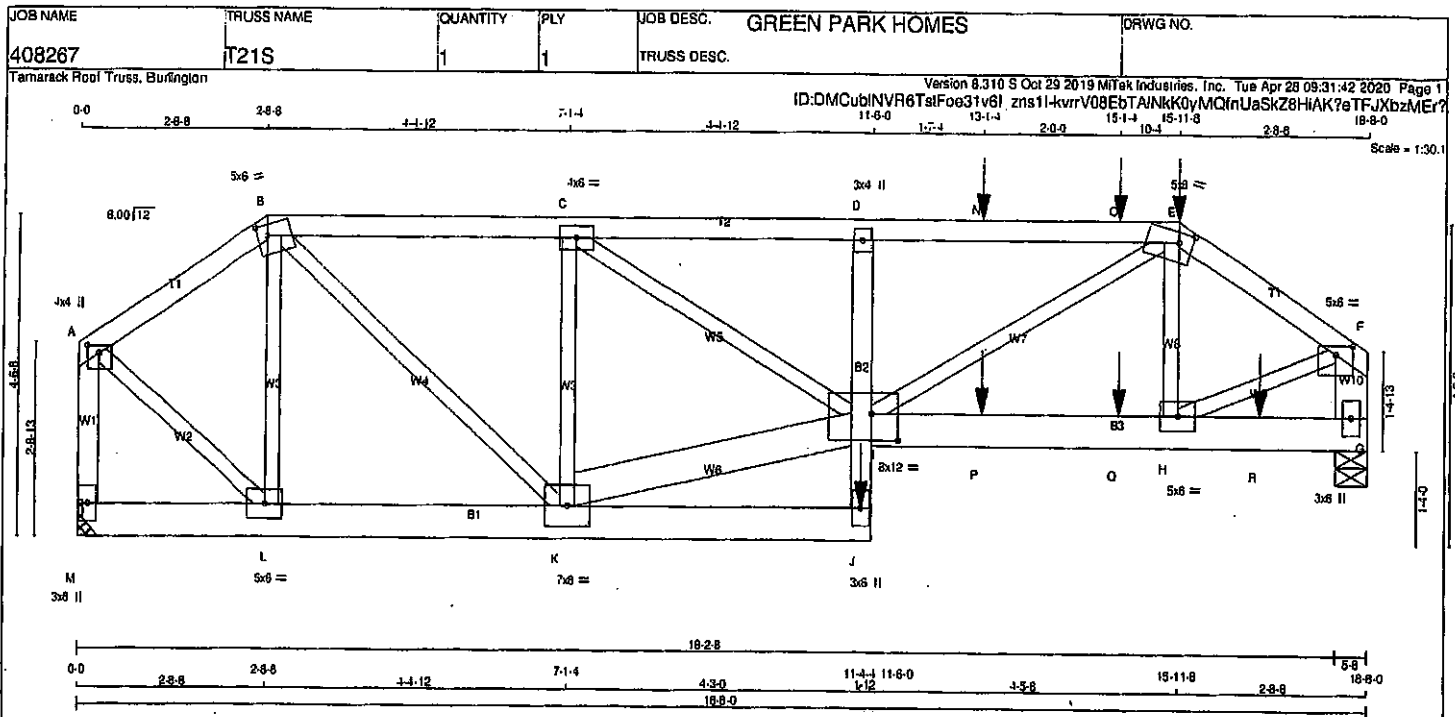

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	OESCR.
A - B	2x4	DRY No.2	SPF
B - E	2x4	DRY No.2	SPF
E - F	2x4	DRY No.2	SPF
M - A	2x4	DRY No.2	SPF
G - F	2x6	DRY No.2	SPF
M - J	2x6	DRY No.2	SPF
J - D	2x4	DRY No.2	SPF
I - G	2x6	DRY No.2	SPF
ALL WEBS EXCEPT K - I	2x3	DRY No.2	SPF
K - I	2x6	DRY No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.26	2.00
B	TTWV-m	MT20	5.0	8.0	1.75	1.75
C	TMWV-t	MT20	4.0	6.0		
D	TMV+p	MT20	3.0	4.0		
E	TTWV-m	MT20	5.0	8.0	1.75	2.50
F	TMVW+p	MT20	5.0	8.0	1.50	3.00
G	BMV+p	MT20	3.0	8.0		
H	BMWV-t	MT20	5.0	8.0		
I	BVMWV-t	MT20	8.0	12.0	4.50	4.50
J	BMV+p	MT20	3.0	8.0		
K	BMWV-t	MT20	7.0	8.0		
L	BMWV-t	MT20	5.0	8.0		
M	BMV+p	MT20	3.0	8.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
M	1301	0	1301	0	0	MECHANICAL
G	1539	0	1539	0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT M. MINIMUM BEARING LENGTH AT JOINT M = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
M	919	609 / 0	0 / 0	0 / 0	0.0	310 / 0	0.0
G	1086	728 / 0	0 / 0	0 / 0	0.0	360 / 0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.67 FT.

MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CS1 (LC)
FR-TO		FROM TO	FR-TO	
A-B	-935 0	-91.8 -91.8 0.14 (1)	B-K	-558 0
B-C	-1578 0	-91.8 -91.8 0.29 (1)	K-C	0 1133
C-D	-2743 0	-91.8 -91.8 0.38 (1)	K-C	-1189 0
D-N	-2767 0	-91.8 -91.8 0.47 (1)	K-I	0 1621
N-O	-2767 0	-91.8 -91.8 0.47 (1)	C-I	0 1373
O-E	-2767 0	-91.8 -91.8 0.47 (1)	I-E	0 1661
E-F	-1644 0	-91.8 -91.8 0.17 (1)	H-E	-384 0
M-A	-1288 0	0.0 0.0 0.19 (1)	A-L	0 1007
G-F	-1525 0	0.0 0.0 0.11 (1)	H-F	0 1447
M-L	0 0	-18.5 -18.5 0.03 (4)		
L-K	0 762	-18.5 -18.5 0.13 (1)		
K-J	0 51	-18.5 -18.5 0.04 (4)		
J-I	0 652	0.0 0.0 0.22 (1)		
I-D	-482 0	0.0 0.0 0.11 (1)		
I-P	0 1350	-18.5 -18.5 0.20 (1)		
P-Q	0 1350	-18.5 -18.5 0.20 (1)		
Q-H	0 1350	-18.5 -18.5 0.20 (1)		
H-R	0 0	-18.5 -18.5 0.05 (4)		
R-G	0 0	-18.5 -18.5 0.05 (4)		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
E	15-11-8	-14	-15	-15	FRONT	VERT	DEAD	---	C1
E	15-11-8	-69	-69	-69	FRONT	VERT	SNOW	---	C1
J	11-4-4	-614	-614	-614	FRONT	VERT	TOTAL	---	C1
N	13-1-4	-32	-32	-32	FRONT	VERT	TOTAL	---	C1
O	15-1-4	-39	-39	-39	FRONT	VERT	TOTAL	---	C1
P	13-1-4	-5	-5	-5	FRONT	VERT	TOTAL	---	C1
Q	15-1-4	-5	-5	-5	FRONT	VERT	TOTAL	---	C1
R	17-1-4	-5	-5	-5	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***

GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.

LOADS WERE DERIVED FROM USER INPUT

NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF

DL = 8.0 PSF

BOT CH. LL = 0.0 PSF

DL = 7.4 PSF

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 086-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.62")

CALCULATED VERT. DEFL. (LL) = L/999 (0.08")

ALLOWABLE DEFL. (TL) = L/360 (0.62")

CALCULATED VERT. DEFL. (TL) = L/999 (0.14")

OSI: TC=0.47/1.00 (D-E:1), BC=0.22/1.00 (I-J:1), WB=0.41/1.00 (E-I:1), SS=0.24/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PS) (PL) (PL)

MAX MIN MAX MIN MAX MIN

MT20 618 354 1667 768 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (A) (INPUT = 0.90)

JSI METAL = 0.34 (H) (INPUT = 1.00)



Structural component only


DRWG# T-2007702

JOB NAME 408267	TRUSS NAME T22	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
---------------------------	--------------------------	----------------------	-----------------	--------------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:31:43 2020 Page 1
ID:DMCubINVR6TsIFoe31v6I zns1I-C5PDjM9sMmIc7uvCW4xuJh7f0zVKRfg87 s31zMEr

Scale = 1:33.5

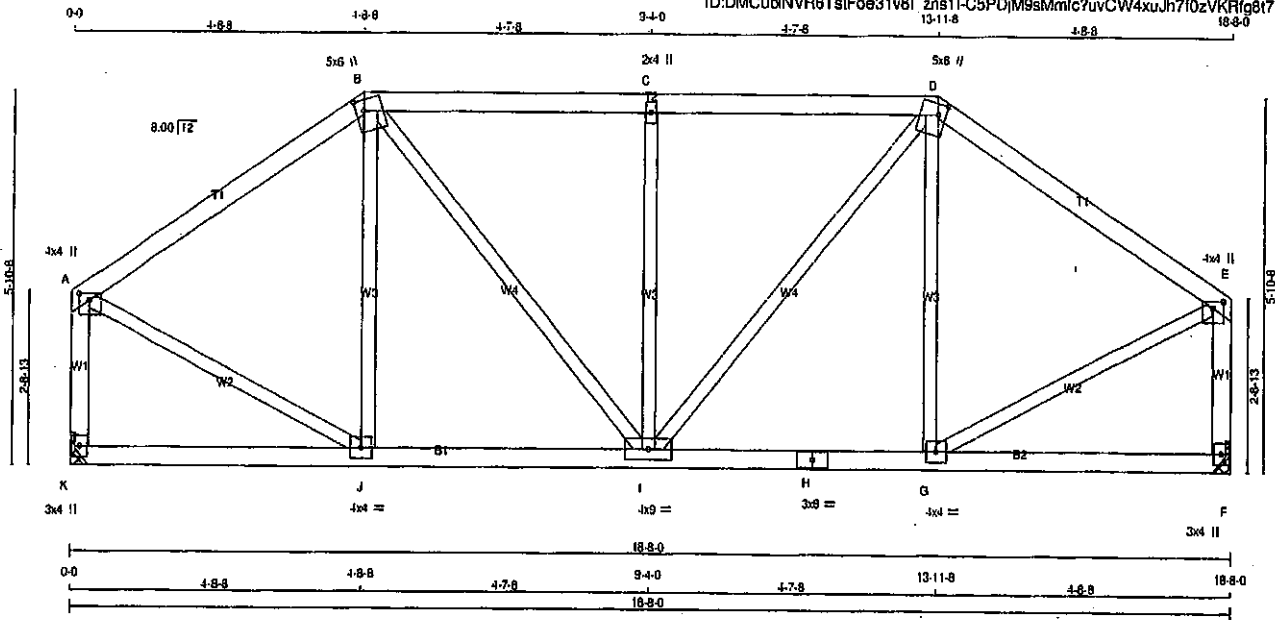

TOTAL WEIGHT = 63 b

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
A - B	2x4	DRY	No.2
B - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
K - A	2x4	DRY	No.2
F - E	2x4	DRY	No.2
K - H	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.25	2.00
B	TTWW+m	MT20	5.0	8.0	2.00	1.50
C	TMVW+w	MT20	2.0	4.0		
D	TTWW+m	MT20	5.0	8.0	2.00	1.50
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVW-1	MT20	4.0	4.0		
H	BS-1	MT20	3.0	8.0		
I	BMVW-1	MT20	4.0	8.0		
J	BMVW-1	MT20	4.0	4.0		
K	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REORD
JT	VERT	GROSS REACTION	GROSS REACTION	BRG	BRG
K	1029	0	1029	0	0
F	1029	0	1029	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K, F. MINIMUM BEARING LENGTH AT JOINT K = 3-8, JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
K	728	478 / 0	0 / 0	0 / 0	0 / 0	0 / 0	250 / 0	0 / 0
F	728	478 / 0	0 / 0	0 / 0	0 / 0	0 / 0	250 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.99 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LG1 (PLF)	MAX. CSl (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSl (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-799 / 0	-81.8	-91.8 0.37 (1)	5.23	J-B	-231 0	0.12 (1)
B-C	-805 / 0	-91.8	-91.8 0.34 (1)	5.99	B-I	0 384	0.09 (1)
C-D	-805 / 0	-91.8	-91.8 0.34 (1)	5.99	I-C	-519 0	0.28 (1)
D-E	-799 / 0	-91.8	-91.8 0.37 (1)	6.23	I-D	0 384	0.09 (1)
K-A	-994 / 0	0.0	0.0 0.14 (1)	7.81	G-D	-231 0	0.12 (1)
F-E	-994 / 0	0.0	0.0 0.14 (1)	7.81	A-J	0 743	0.17 (1)
					G-E	0 743	0.17 (1)
K-J	0 / 0	-18.5	-18.5 0.10 (4)	10.00			
J-I	0 / 680	-18.5	-18.5 0.17 (1)	10.00			
I-H	0 / 680	-18.5	-18.5 0.17 (1)	10.00			
H-G	0 / 680	-18.5	-18.5 0.17 (1)	10.00			
G-F	0 / 0	-18.5	-18.5 0.10 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL (LL) = $L/360$ (0.62")
CALCULATED VERT. DEFL (LL) = $L/999$ (0.02")
ALLOWABLE DEFL (TL) = $L/360$ (0.62")
CALCULATED VERT. DEFL (TL) = $L/999$ (0.04")

CSI: TC=0.37/1.00 (A-B:1), BC=0.17/1.00 (I-J:1), WB=0.28/1.00 (C-I:1), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.79 (J) (INPUT = 0.90)
JSI METAL=0.25 (J) (INPUT = 1.00)




Structural component only
DWG# T-2007703

JOB NAME 408267	TRUSS NAME T23	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTak Industries, Inc. Tue Apr 28 09:31:44 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-glzbwIAU64QTc1UO4nS7svfqTMqA2Ll6nkQbTzMEqz

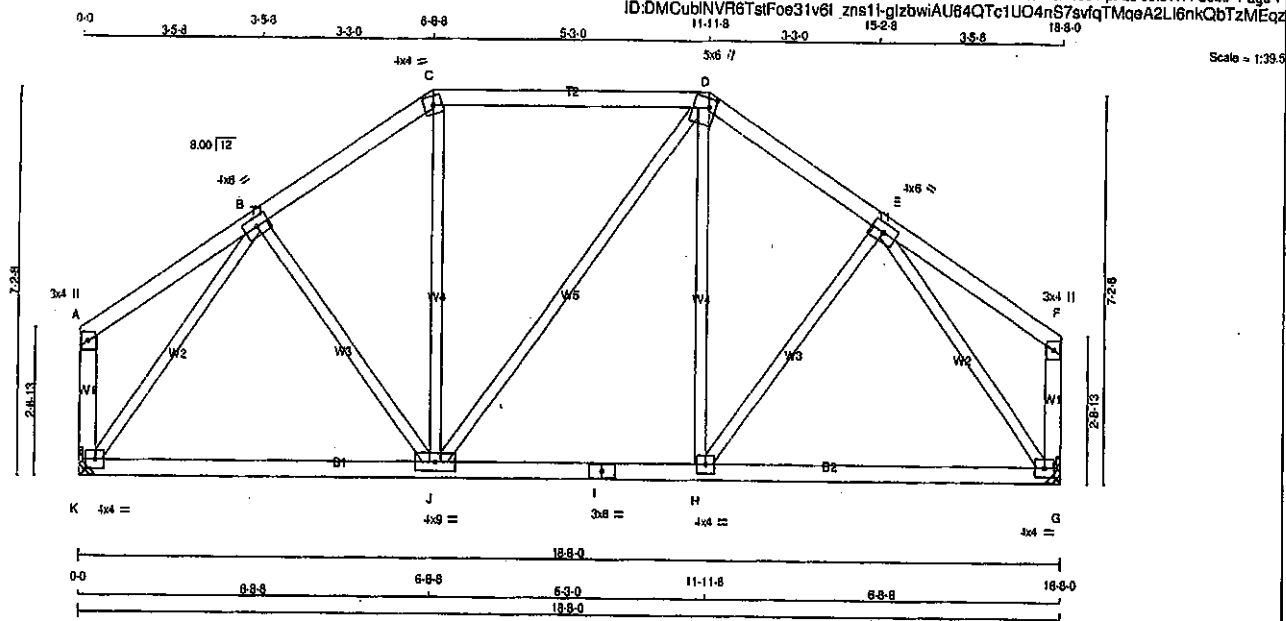

Scale = 1:39.6

TOTAL WEIGHT = 88 lb (MIF)

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
K - A	2x4	DRY	No.2	SPF
G - F	2x4	DRY	No.2	SPF
K - I	2x4	DRY	No.2	SPF
I - G	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY; SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV-vp	MT20	3.0	4.0		
B	TMVW-v	MT20	4.0	6.0		
C	TTW-v	MT20	4.0	4.0		
D	TTWV-v	MT20	5.0	6.0	2.00	1.50
E	TMVW-v	MT20	4.0	6.0		
F	TMV-vp	MT20	3.0	4.0		
G	BMVW-v	MT20	4.0	4.0		
H	BMVW-v	MT20	4.0	4.0		
I	BS-v	MT20	3.0	6.0		
J	BMVW-v	MT20	4.0	9.0		
K	BMVW-v	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
K	1029	0	1029	0
G	1029	0	1029	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K, G. MINIMUM BEARING LENGTH AT JOINT K = 3-8, JOINT G = 3-8.

UNFACTORED REACTIONS

1ST CASE	MAX/MIN. COMPONENT REACTIONS
JT	COMBINED
K	728
G	728

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LGT MAX (LBS)	MAX. UNBRACED LENGTH FR-TO	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)
A-B	0	19	-91.8	-91.8	0.18 (1)	10.00	B-J	0	58
B-C	-903	0	-91.8	-91.8	0.13 (1)	8.25	J-C	0	87
C-D	-651	0	-91.8	-91.8	0.33 (1)	8.25	J-D	0	0
D-E	-802	0	-91.8	-91.8	0.13 (1)	8.25	H-D	0	87
E-F	0	19	-91.8	-91.8	0.18 (1)	10.00	H-E	0	58
K-A	-120	0	0.0	0.0	0.02 (1)	7.81	K-B	-1058	0
G-F	-120	0	0.0	0.0	0.02 (1)	7.81	E-G	-1058	0
K-J	0	619	-18.5	-18.5	0.22 (4)	10.00			
J-I	0	851	-18.5	-18.5	0.22 (4)	10.00			
I-H	0	851	-18.5	-18.5	0.22 (4)	10.00			
H-G	0	619	-18.5	-18.5	0.22 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. CC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.62")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.62")
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.33/1.00 (C-D:1), BC=0.22/1.00 (G-H:4)
WB=0.57/1.00 (B-K:1), SI=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 810 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.81 (K) (INPUT=0.90)
JSI METAL=0.25 (B) (INPUT=1.00)




Structural component only
DWG# T-2007704

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408267	T26	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:31:45 2020 Page 1

ID:DMCubINVR6TstFoe31v6l_zns1f-8UWz72A6fOYKEB3baVzMP6C_EmBfvc6RKRtZ7wzMEqy

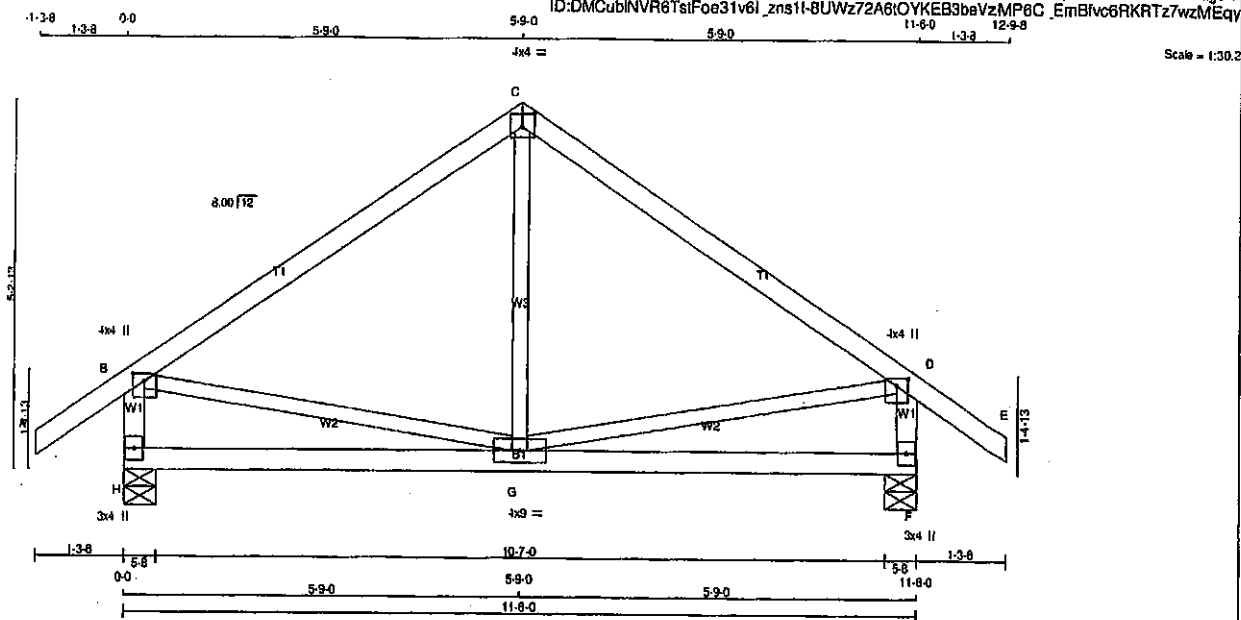

LUMBER			
N.L.G.A. RULES	CHORDS	SIZE	LUMBER
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	X
B	TMVW+p	MT20	4.0	4.0 1.25 2.00
C	TTW+p	MT20	4.0	4.0 2.25 2.00
D	TMVW+p	MT20	4.0	4.0 1.25 2.00
F	BMV1+p	MT20	3.0	4.0
G	BMVWW-t	MT20	4.0	9.0
H	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
H	760	0	760	0	0	5-8	5-8
F	760	0	760	0	0	5-8	5-8

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS					
JT	1ST LCASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	535	384.0	0.0	0.0	0.0	171.0	0.0
F	535	384.0	0.0	0.0	0.0	171.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS1 (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	0.35	-91.8 -91.8	0.12 (1)	10.00	G-C	-14.94	0.03 (4)
B-C	-463.0	-91.8 -91.8	0.39 (1)	6.25	B-G	0.392	0.09 (1)
C-D	-463.0	-91.8 -91.8	0.39 (1)	6.25	G-D	0.392	0.09 (1)
D-E	0.35	-91.8 -91.8	0.12 (1)	10.00			
H-B	-719.0	0.0 0.0	0.07 (1)	7.81			
F-D	-719.0	0.0 0.0	0.07 (1)	7.81			
H-G	0.0	-18.5 -18.5	0.17 (4)	10.00			
G-F	0.0	-18.5 -18.5	0.17 (4)	10.00			

TOTAL WEIGHT = 2 X 48 = 95 lb

(M/F)

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 # OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.38")
CALCULATED VERT. DEFL. (LL) = L/989 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.38")
CALCULATED VERT. DEFL. (TL) = L/989 (0.03")

CS1: TC=0.39/1.00 (C-D:1), BC=0.17/1.00 (F-G:4), WB=0.09/1.00 (D-G:1), SS=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSH) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.55 (D) (INPUT = 0.90)
JSI METAL = 0.16 (D) (INPUT = 1.00)



Structural component only
DWG# T-2007705

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MITek Industries, Inc. Fri May 8 12:57:36 2020 Page 1

ID:DMCubINVR6TstFoe31vbl_zns1l-dzBZS0P0qf1AxOmdGvs1ZqxMxY17bmezb_qNcvziZnz


1-3-8 1-3-6 0-0 5-9-0 5-9-0 11-6-0 12-9-8 1-3-8


4x4 =

Scale = 1/28.8



JSI GRIP= 0.19 (B) (INPUT = 0.90)
JSI METAL= 0.11 (D) (INPUT = 1.00)



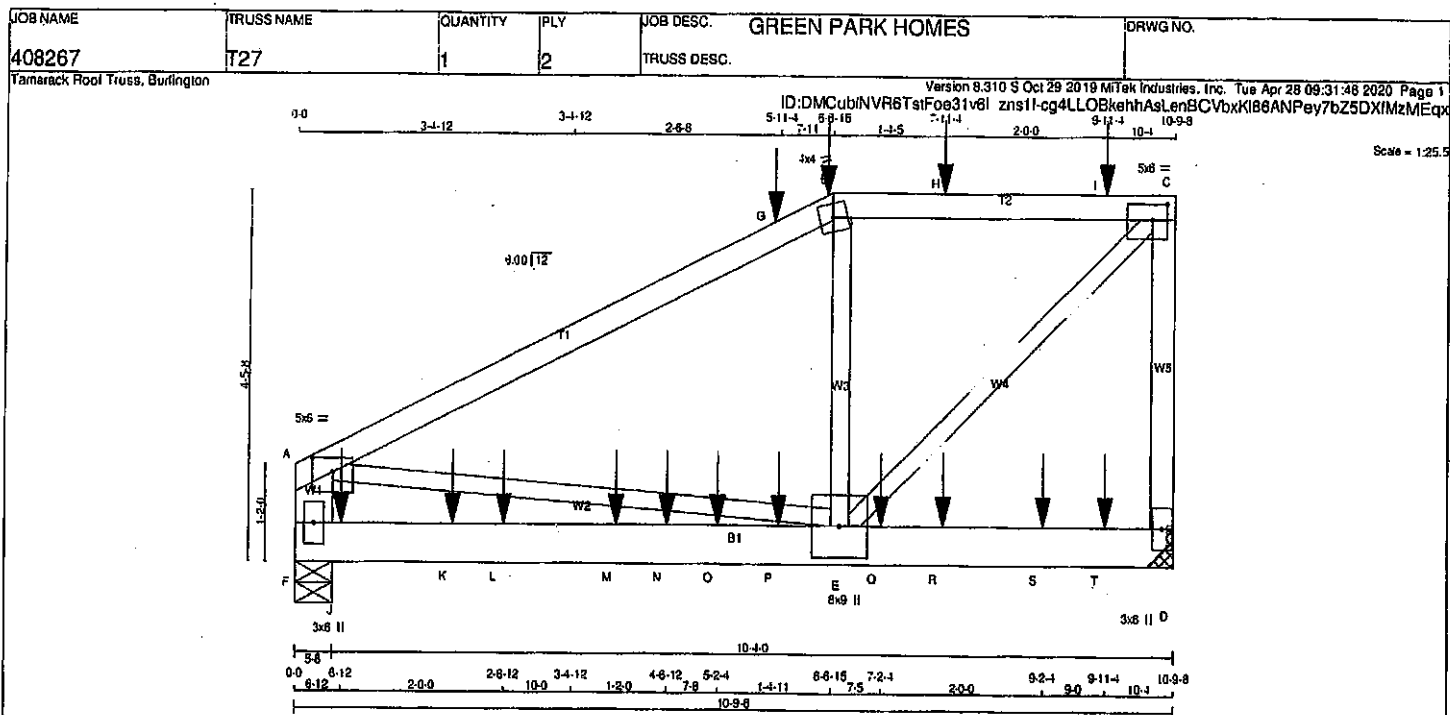

CHORDS	SIZE	DRY	NO.2
A - B	2x4	DRY	No.2
B - C	2x4	DRY	No.2
D - C	2x4	DRY	No.2
F - A	2x6	DRY	No.2
F - D	2x6	DRY	No.2

ALL WEBS 2x3 DRY NO.2 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-B 1 12	SIDE(61.0)	
B-C 1 12	SIDE(61.0)	
C-D 1 12	TOP	
F-A 2 2	SIDE(11.4)	
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2 12	SIDE(183.1)	
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1 6		

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
A	TM/VW-p	MT20	5.0	8.0	2.00	3.00
B	TTW-m	MT20	4.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT HORZ	DOWN HORZ	UPLIFT	IN-SX
D	3747 0	3747 0	0	MECHANICAL
F	3553 0	3553 0	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST LC CASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
D	2641	1782	0	0	0	880
F	2505	1688	0	0	0	817

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.44 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LC1 (PLF)	MAX. CSI (LC)	MAX. UNBRACED LENGTH FR-TO	WEBS	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO					FR-TO		
A-G	-3456	-91.8	-91.8	0.58 (1)	4.44	A-E	0 3132
G-B	-3456	-91.8	-91.8	0.58 (1)	4.44	E-B	0 459
B-H	-3131	-91.8	-91.8	0.30 (1)	4.90	E-C	0 4455
H-I	-3131	-91.8	-91.8	0.30 (1)	4.90		
I-C	-3131	-91.8	-91.8	0.30 (1)	4.90		
D-C	-3493	0.0	0.0	0.52 (1)	6.26		
F-A	-2231	0.0	0.0	0.08 (1)	7.81		
F-J	0	-18.5	-18.5	0.78 (1)	10.00		
J-K	0	-18.5	-18.5	0.78 (1)	10.00		
K-L	0	-18.5	-18.5	0.78 (1)	10.00		
L-M	0	-18.5	-18.5	0.78 (1)	10.00		
M-N	0	-18.5	-18.5	0.78 (1)	10.00		
N-O	0	-18.5	-18.5	0.78 (1)	10.00		
O-P	0	-18.5	-18.5	0.78 (1)	10.00		
P-Q	0	-18.5	-18.5	0.78 (1)	10.00		
Q-R	0	-18.5	-18.5	0.78 (1)	10.00		
R-S	0	-18.5	-18.5	0.78 (1)	10.00		
S-T	0	-18.5	-18.5	0.78 (1)	10.00		
T-D	0	-18.5	-18.5	0.78 (1)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
B	6-6-15	-60	-87	---	FRONT	VERT	DEAD	C1
B	6-6-15	-312	-312	---	FRONT	VERT	DEAD	C1
G	5-11-4	-135	-135	---	BACK	VERT	SNOW	C1
H	7-11-4	-119	-119	---	BACK	VERT	TOTAL	C1
I	9-11-4	-125	-125	---	BACK	VERT	TOTAL	C1
J	6-12	-745	-745	---	FRONT	VERT	TOTAL	C1
K	1-11-4	-24	-24	---	BACK	VERT	TOTAL	C1
L	2-6-12	-595	-595	---	FRONT	VERT	TOTAL	C1
M	3-11-4	-24	-24	---	BACK	VERT	TOTAL	C1
N	4-6-12	-595	-595	---	FRONT	VERT	TOTAL	C1
O	5-2-4	-1283	-1283	---	FRONT	VERT	TOTAL	C1
P	5-11-4	-24	-24	---	BACK	VERT	TOTAL	C1
Q	7-2-4	-1011	-1011	---	FRONT	VERT	TOTAL	C1
R	7-11-4	-24	-24	---	BACK	VERT	TOTAL	C1
S	9-2-4	-1011	-1011	---	FRONT	VERT	TOTAL	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH.	LL =	25.8	PSF
DL =	8.0	PSF	
BOT CH.	LL =	0.0	PSF
DL =	7.4	PSF	
TOTAL LOAD =	39.0	PSF	

SPACING = 24.0 IN./C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/380 (0.38")

CALCULATED VERT. DEFL.(LL) = L/899 (0.13")

ALLOWABLE DEFL.(TL) = L/380 (0.38")

CALCULATED VERT. DEFL.(TL) = L/544 (0.24")

CSI: TC=0.58/1.00 (A-B:1), BC=0.78/1.00 (D-E:1),

WB=0.55/1.00 (C-E:1), SS=0.69/1.00 (E-F:1).

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00

COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	618	354	1667
			788
			1987
			1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (C) (INPUT = 0.90)

JSI METAL= 0.39 (C) (INPUT = 1.00)

CONTINUED ON PAGE 2



Structural component only
DWG# T-2007706 1/2

JOB NAME 408267	TRUSS NAME T27	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 MITek Industries, Inc. Tue Apr 28 09:31:48 2020 Page 2
ID:DMCubNVR6TslFoe31v8I_zns1l-cq4LLOBkhhAsLenBCVbxKl66ANPay7bZ5DXIMzMEok

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TMVW-t	MT20	5.0	8.0	2.25	2.25
D	BMV1+p	MT20	3.0	6.0		
E	BMVWW-t	MT20	8.0	9.0		
F	BMV1+p	MT20	3.0	8.0		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	9-11-4	-25	-25	---	BACK	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
DWG# T-2007706 2/2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	TRUSS DESC.	DRWG NO.
408268	T30	1	2	GREEN PARK HOMES		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:54:29 2020 Page 1

ID:DMCubINVR6TstF0e31v6I_zns1I-CuxdPRhITPnlpKKYzSDhii0pcZdULTC_eu87szMEVE

1-3-8 0-0 5-10-8 5-10-8 4-8-15 10-7-7 4-7-11 15-3-2 15-0-8 17-7-0 19-1-8 19-8-12 19-10-14 24-4-9 29-3-8 35-2-0 35-5-8 1-3-8
Scale = 1:57.6

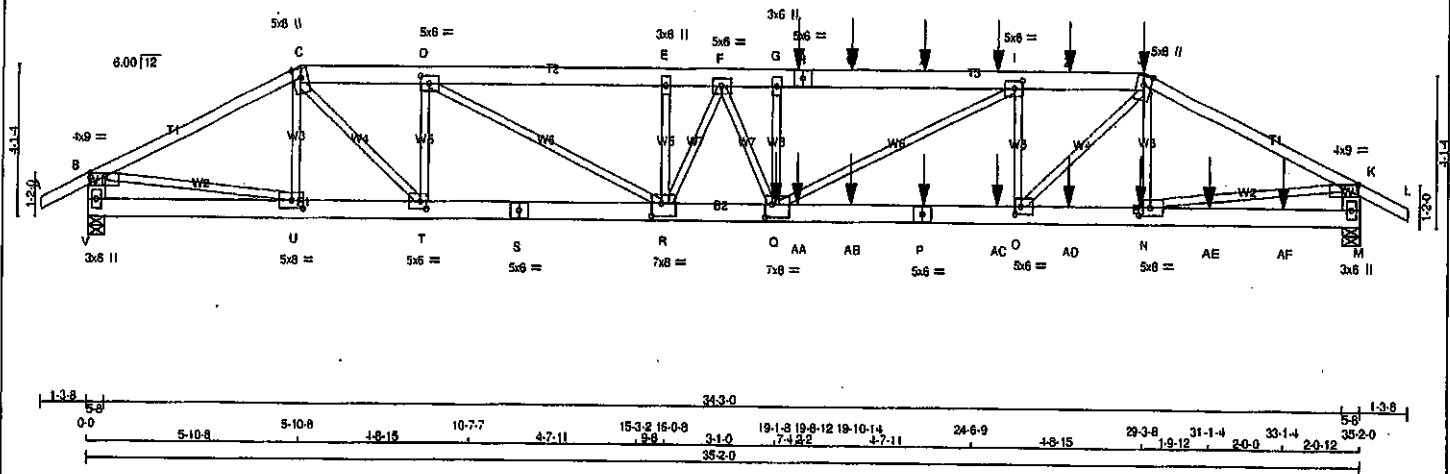

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - H	2x8	DRY	No.2	SPF	
H - J	2x6	DRY	No.2	SPF	
J - L	2x4	DRY	No.2	SPF	
V - B	2x6	DRY	No.2	SPF	
M - K	2x6	DRY	No.2	SPF	
V - S	2x6	DRY	No.2	SPF	
S - P	2x8	DRY	No.2	SPF	
P - M	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
J - L	12	SIDE(61.0)
C - H	12	SIDE(0.0)
H - J	12	SIDE(61.0)
V - B	12	TOP
M - K	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
V - S	12	TOP
S - P	12	SIDE(183.1)
P - M	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	SIDE(447.5)
Q - G	4	
R - E	4	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARING DESIGNER							
<u>BEARINGS</u>			MAXIMUM FACTORED		INPUT	REQD	
GROSS REACTION			GROSS REACTION		BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
V	3478	0	3478	0	0	5-8	5-8
M	4257	0	4257	0	0	5-8	5-8

UNFACTORED REACTIONS

1ST CASE	MAX-MIN. COMPONENT REACTIONS
JT	COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL
V	2452 1842/0 0/0 0/0 0/0 810 0 0/0
M	3008 2000/0 0/0 0/0 0/0 1005 0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.22 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LO1 (PLF)	MAX. FACTORED CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO		FR-TO			
A-B	0 28	-81.8	-81.8 0.07 (1)	10.00	U-C	-607 0	0.08 (1)
B-C	-5352 0	-81.8	-81.8 0.54 (1)	3.77	C-T	0 3711	0.46 (1)
C-D	-7374 0	-81.8	-81.8 0.18 (1)	4.32	T-D	-2525 0	0.30 (1)
D-E	-10837 0	-81.8	-81.8 0.37 (1)	3.52	O-I	-2728 0	0.33 (1)
E-F	-10837 0	-81.8	-81.8 0.21 (1)	3.83	O-J	0 4129	0.51 (1)
F-G	-12031 0	-81.8	-81.8 0.29 (1)	3.39	N-I	-723 0	0.08 (1)
G-H	-12031 0	-81.8	-81.8 0.51 (1)	3.22	B-U	0 4841	0.60 (1)
H-W	-12031 0	-81.8	-81.8 0.51 (1)	3.22	N-K	0 6051	0.75 (1)
W-X	-12031 0	-81.8	-81.8 0.51 (1)	3.22	R-E	-454 0	0.05 (1)
X-Y	-12031 0	-81.8	-81.8 0.51 (1)	3.22	Q-G	-713 0	0.09 (1)
Y-I	-12031 0	-81.8	-81.8 0.51 (1)	3.22	D-R	0 3948	0.48 (1)
I-Z	-8868 0	-81.8	-81.8 0.29 (1)	3.88	Q-I	0 3809	0.45 (1)
Z-J	-8868 0	-81.8	-81.8 0.29 (1)	3.88	R-F	-1472 0	0.20 (1)
J-K	-6691 0	-81.8	-81.8 0.68 (1)	3.33	F-Q	0 1593	0.20 (1)
K-L	0 28	-81.8	-81.8 0.07 (1)	10.00			
V-B	-3410 0	0.0	0.0 0.12 (1)	7.55			
M-K	-4164 0	0.0	0.0 0.15 (1)	7.00			

LOC.	LC1	MAX.	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
H	19-8-12	-110	-110	---	FRONT	VERT	TOTAL	C1
J	29-3-8	-426	-426	---	FRONT	VERT	TOTAL	C1
N	29-2-12	-28	-28	---	FRONT	VERT	TOTAL	C1
P	23-2-12	-26	-26	---	FRONT	VERT	TOTAL	C1
Q	19-1-8	-2417	-2417	---	FRONT	VERT	TOTAL	C1
W	21-2-12	-110	-110	---	FRONT	VERT	TOTAL	C1
X	23-2-12	-110	-110	---	FRONT	VERT	TOTAL	C1

TOTAL WEIGHT = 2 X 175 = 350 LB

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. GC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
CALCULATED VERT. DEFL.(LL) = L/999 (0.30")
ALLOWABLE DEFL.(TL) = L/360 (1.17")
CALCULATED VERT. DEFL.(TL) = L/775 (0.54")

CSI: TC=0.66/1.00 (J-K:1), BC=0.82/1.00 (Q-R:1),
WB=0.75/1.00 (K-N:1), SS=0.19/1.00 (G-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 783 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.90 (I) (INPUT = 0.90)
JSI METAL = 0.84 (I) (INPUT = 1.00)

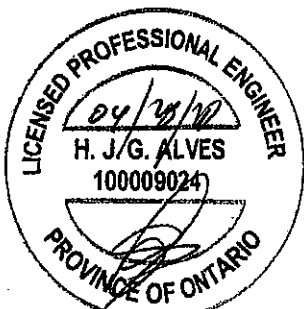

Structural component only
DWG# T-2007713 1/2

CONTINUED ON PAGE 2

JOB NAME 408268	TRUSS NAME T30	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mittek Industries, Inc. Tue Apr 28 09:54:30 2020 Page 2
 ID:DMCubINVR8TstFoe31v6I zns1t-g5V?cnkQnXev2vx5gzSDzEBY0vsDojMDIdiYizMEVd

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	9.0	1.00	4.75
C	TTWW+m	MT20	5.0	8.0	Edge	
D	TMWW-t	MT20	5.0	8.0	2.50	2.75
E	TMW+w	MT20	3.0	6.0		
F	TMWW-t	MT20	5.0	6.0		
G	TMW+w	MT20	3.0	6.0		
H	TS-t	MT20	5.0	6.0		
I	TMWW-t	MT20	5.0	8.0	2.50	2.75
J	TTWW+m	MT20	5.0	8.0	Edge	
K	TMVW-p	MT20	4.0	9.0	1.00	4.75
M	BMV1+p	MT20	3.0	6.0		
N	BMWW-t	MT20	5.0	8.0	2.50	3.75
O	BMWW-t	MT20	5.0	8.0	2.50	2.00
P	BS-t	MT20	5.0	8.0		
Q	BMWW-t	MT20	7.0	8.0	4.25	2.25
R	BMWW-t	MT20	7.0	8.0	4.25	3.25
S	BS-t	MT20	5.0	8.0		
T	BMWW-t	MT20	5.0	6.0	2.50	2.00
U	BMWW-t	MT20	5.0	8.0	2.50	3.75
V	BMV1+p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

FACTORED CONCENTRATED LOADS (LBS)


JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
Y	25-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
Z	27-2-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
AA	19-8-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AB	21-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AC	25-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AD	27-2-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AE	31-1-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1
AF	33-1-4	-26	-26	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
 DWG# T-2007713 2/2

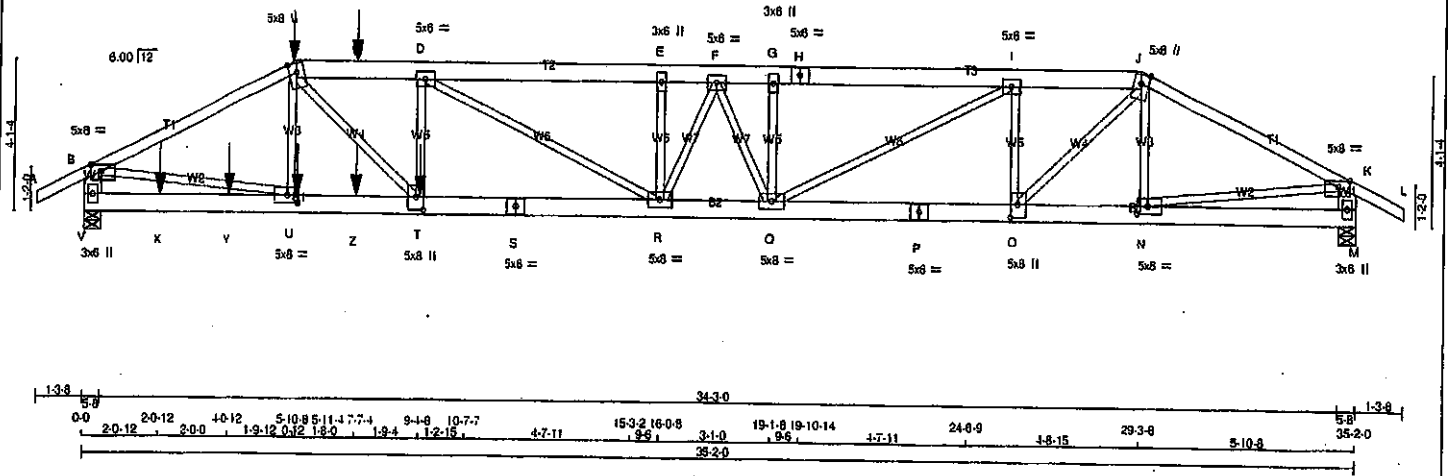

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - H	2x6	DRY No.2	SPF
H - J	2x6	DRY No.2	SPF
J - L	2x4	DRY No.2	SPF
V - B	2x6	DRY No.2	SPF
M - K	2x6	DRY No.2	SPF
V - S	2x6	DRY No.2	SPF
S - P	2x6	DRY No.2	SPF
P - M	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122'X3') SPIRAL NAILS		
A - C	12	SIDE(61.0) TOP
J - L	12	SIDE(61.0) TOP
C - H	12	SIDE(61.0) TOP
H - J	12	SIDE(61.0) TOP
V - B	12	SIDE(61.0) TOP
M - K	12	SIDE(61.0) TOP
BOTTOM CHORDS : (0.122'X3') SPIRAL NAILS		
V - S	12	SIDE(103.1) TOP
S - P	12	SIDE(103.1) TOP
P - M	12	SIDE(103.1) TOP
WEBS : (0.122'X3') SPIRAL NAILS		
2x3	6	SIDE(495.3)
D - T	3	SIDE(495.3)
I - O	3	SIDE(495.3)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
JT	VERT 4503	HORZ 0	DOWN 4503	HORZ 0
V	4503	0	0	0
M	2886	0	2886	0

UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	0.0	0.0	0.0	1067.0	0.0
V	3180	2113.0	0.0	0.0	0.0	674.0	0.0
M	2023	1349.0	0.0	0.0	0.0	0.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) V, M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.20 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH (FT)	WEBS	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO						FR-TO			
A-B	0.28	-91.8	-91.8	0.07 (1)	10.00	U-C	-686.0	0.09 (1)	
B-C	-7137.0	-91.8	-91.8	0.71 (1)	3.20	C-T	-4212.0	0.52 (1)	
C-W	-9321.0	-91.8	-91.8	0.21 (1)	3.88	T-D	-393.0	0.05 (1)	
W-D	-9321.0	-91.8	-91.8	0.21 (1)	3.88	O-I	-1905.0	0.23 (1)	
D-E	-8909.0	-91.8	-91.8	0.29 (1)	3.89	O-J	0.2838	0.35 (1)	
E-F	-8909.0	-91.8	-91.8	0.20 (1)	3.95	N-J	-467.0	0.06 (1)	
F-G	-8178.0	-91.8	-91.8	0.15 (1)	4.16	B-U	0.6465	0.80 (1)	
G-H	-8178.0	-91.8	-91.8	0.26 (1)	4.08	N-K	0.3688	0.48 (1)	
H-I	-8178.0	-91.8	-91.8	0.28 (1)	4.08	R-E	-575.0	0.07 (1)	
I-J	-5804.0	-91.8	-91.8	0.15 (1)	4.80	Q-G	-489.0	0.06 (1)	
J-K	-4277.0	-91.8	-91.8	0.48 (1)	4.21	D-R	-469.0	0.27 (1)	
K-L	0.28	-91.8	-91.8	0.07 (1)	10.00	Q-I	0.2704	0.33 (1)	
V-B	-4416.0	0.0	0.0	0.16 (1)	6.84	R-F	0.1033	0.13 (1)	
M-K	-2804.0	0.0	0.0	0.10 (1)	7.81	F-Q	-850.0	0.11 (1)	
V-X	0.0	-18.5	-18.5	0.07 (4)	10.00				
X-Y	0.0	-18.5	-18.5	0.07 (4)	10.00				
Y-U	0.0	-18.5	-18.5	0.07 (4)	10.00				
U-Z	0.8417	-18.5	-18.5	0.48 (1)	10.00				
Z-T	0.8417	-18.5	-18.5	0.48 (1)	10.00				
T-S	0.9321	-18.5	-18.5	0.68 (1)	10.00				
S-R	0.9321	-18.5	-18.5	0.68 (1)	10.00				
R-Q	0.8507	-18.5	-18.5	0.60 (1)	10.00				
Q-P	0.5803	-18.5	-18.5	0.43 (1)	10.00				
P-O	0.5803	-18.5	-18.5	0.43 (1)	10.00				
O-N	0.3847	-18.5	-18.5	0.27 (1)	10.00				
N-M	0.0	-18.5	-18.5	0.04 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)	JT	LOC.	LC1	MAX.	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-428	-428	---	BACK	VERT	TOTAL	---	C1
T	9-4-8	-2801	-2801	---	BACK	VERT	TOTAL	---	C1
U	5-11-4	-28	-28	---	BACK	VERT	TOTAL	---	C1
W	7-7-4	-110	-110	---	BACK	VERT	TOTAL	---	C1
X	2-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
Y	4-0-12	-26	-26	---	BACK	VERT	TOTAL	---	C1
Z	7-7-4	-28	-28	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

TOTAL WEIGHT = 2 X 175 = 350 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 8.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17)
CALCULATED VERT. DEFL.(LL) = L/999 (0.23)
ALLOWABLE DEFL.(TL) = L/380 (1.17)
CALCULATED VERT. DEFL.(TL) = L/997 (0.42)

CSI: TO=0.71/1.00 (B-C:1), BC=0.68/1.00 (R-T:1),
WB=0.80/1.00 (B-U:1), SSI=0.11/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1887 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.89 (N) (INPUT = 0.90)
JSI METAL = 0.88 (P) (INPUT = 1.00)

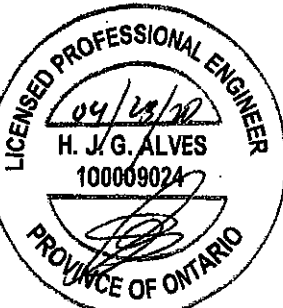

Structural component only
DWG# T-2007714 1/2

JOB NAME 408268	TRUSS NAME T30Z	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 08:54:31 2020 Page 2
 ID:DMCubINVR6TgFoe31v6I zns1I-9H3Ng7ivB5IV66U77NUhmAnLaPHOyEBVSyNG4kzMEVc

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW-p	MT20	5.0	8.0	2.00	3.50
C TTWW+m	MT20	5.0	8.0	Edge	
D, F, I					
D TMVW-t	MT20	5.0	6.0		
E TMW+w	MT20	3.0	6.0		
G TMW+w	MT20	3.0	6.0		
H TS-t	MT20	5.0	8.0		
J TTWW+m	MT20	5.0	8.0	Edge	
K TMVW-p	MT20	5.0	8.0	2.00	3.50
M BMV1+p	MT20	3.0	6.0		
N BMWW-t	MT20	5.0	8.0	2.50	3.50
O BMWW-t	MT20	5.0	8.0	4.25	2.25
P BS-t	MT20	5.0	8.0		
Q BMWW-t	MT20	5.0	8.0		
R BMWW-t	MT20	5.0	8.0		
S BS-t	MT20	5.0	6.0		
T BMWW-t	MT20	5.0	8.0	4.25	2.25
U BMWW-t	MT20	5.0	8.0	2.50	3.50
V BMV1+p	MT20	3.0	6.0		


Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



Structural component only
 DWG# T-2007714 72

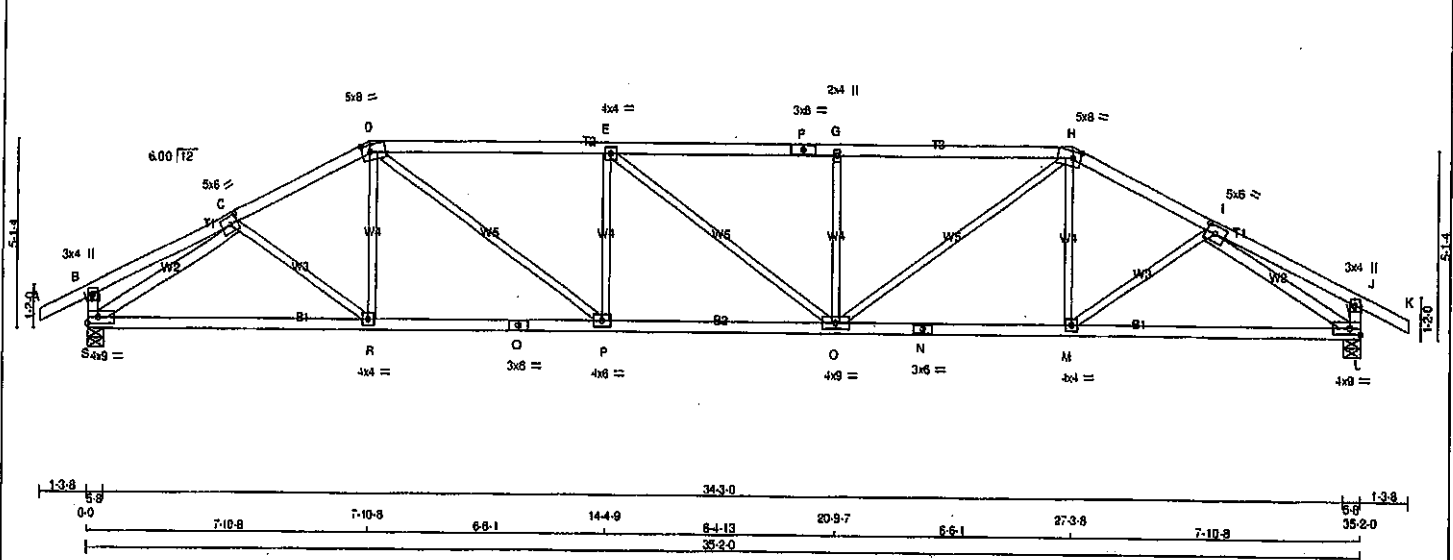

LUMBER
 N. L. G. A. RULES
 CHORDS SIZE LUMBER DESCR.

A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - H	2x4	DRY	No.2	SPF
H - K	2x4	DRY	No.2	SPF
S - B	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
S - O	2x4	DRY	No.2	SPF
Q - N	2x4	DRY	No.2	SPF
N - L	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT	2x3	DRY	No.2	SPF
S - C	2x4	DRY	No.2	SPF
I - L	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMVWV-i	MT20	5.0	6.0	2.50 2.75
D	TTWVW-m	MT20	5.0	8.0	2.25 2.75
E	TMVWV-i	MT20	4.0	4.0	
F	TS-i	MT20	3.0	8.0	
G	TMVWV-i	MT20	2.0	4.0	
H	TTWVW-m	MT20	5.0	8.0	2.25 2.75
I	TMVWV-i	MT20	5.0	8.0	2.50 2.75
J	TMV+p	MT20	3.0	4.0	
L	BMVWV-i	MT20	4.0	9.0	Edge
M	BMVWV-i	MT20	4.0	4.0	
N	BS-i	MT20	3.0	6.0	
O	BMVWVW-i	MT20	4.0	9.0	
P	BMVWV-i	MT20	4.0	6.0	
Q	BS-i	MT20	3.0	6.0	
R	BMVWV-i	MT20	4.0	4.0	
S	BMVWV-i	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
S	2063	0	2063	0
L	2063	0	2063	0

UNFACTORED REACTIONS

	1ST CASE	MAX. MIN. COMPONENT REACTIONS						
	JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
S	1457	969 / 0	0 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0
L	1457	969 / 0	0 / 0	0 / 0	0 / 0	0 / 0	488 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.94 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 28	-91.8 -91.8 0.12 (1)	10.00	C-R	0 93	0.03 (4)	
B-C	0 18	-91.8 -91.8 0.20 (1)	10.00	R-D	0 121	0.04 (4)	
C-D	-2799 0	-91.8 -91.8 0.32 (1)	3.88	D-P	0 1267	0.29 (1)	
D-E	-3508 0	-91.8 -91.8 0.95 (1)	2.94	P-E	-843 0	0.25 (1)	
E-F	-3507 0	-91.8 -91.8 0.93 (1)	2.94	E-O	-2 0	0.00 (1)	
F-G	-3507 0	-91.8 -91.8 0.93 (1)	2.94	O-G	-843 0	0.25 (1)	
G-H	-3507 0	-91.8 -91.8 0.94 (1)	2.95	O-H	0 1288	0.28 (1)	
H-I	-2799 0	-91.8 -91.8 0.32 (1)	3.88	M-H	0 121	0.04 (4)	
I-J	0 18	-91.8 -91.8 0.20 (1)	10.00	M-I	0 93	0.03 (4)	
J-K	0 28	-91.8 -91.8 0.12 (1)	10.00	S-C	-2974 0	0.83 (1)	
S-B	-270 0	0.0 0.0 0.03 (1)	7.81	I-L	-2974 0	0.83 (1)	
L-J	-270 0	0.0 0.0 0.03 (1)	7.81				
S-R	0 2417	-18.5 -18.5 0.53 (1)	10.00				
R-Q	0 2489	-18.5 -18.5 0.54 (1)	10.00				
Q-P	0 2489	-18.5 -18.5 0.54 (1)	10.00				
P-O	0 3509	-18.5 -18.5 0.94 (1)	10.00				
O-N	0 2489	-18.5 -18.5 0.54 (1)	10.00				
N-M	0 2489	-18.5 -18.5 0.54 (1)	10.00				
M-L	0 2417	-18.5 -18.5 0.53 (1)	10.00				

TOTAL WEIGHT = 2 X 139 = 278 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL	= 25.6 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 39.0 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2018, NBC 2012, ABC 2019
 - PART 9 OF NBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.21")
 ALLOWABLE DEFL. (TL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.41")

CSI: TC=0.95/1.00 (D-E:1), BC=0.64/1.00 (O-P:1), WB=0.83/1.00 (I-L:1), SS=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PS)	SECTION (PLI)
MT20	818	354	1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (L) (INPUT = 0.80)
 JSI METAL = 0.77 (N) (INPUT = 1.00)



Structural component only
 DWG# T-2007715

JOB NAME 408268	TRUSS NAME T32	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:33 2020 Page 1
 ID:DMCubNVVR6TstFoe31v6l_zns11-5gB7FpkCjvDMQeWnoW9rbsdwD?WQB2ovGsM8dzMEVa
 35-20 38-3-8 1-3-8
 Scale = 1:57.6

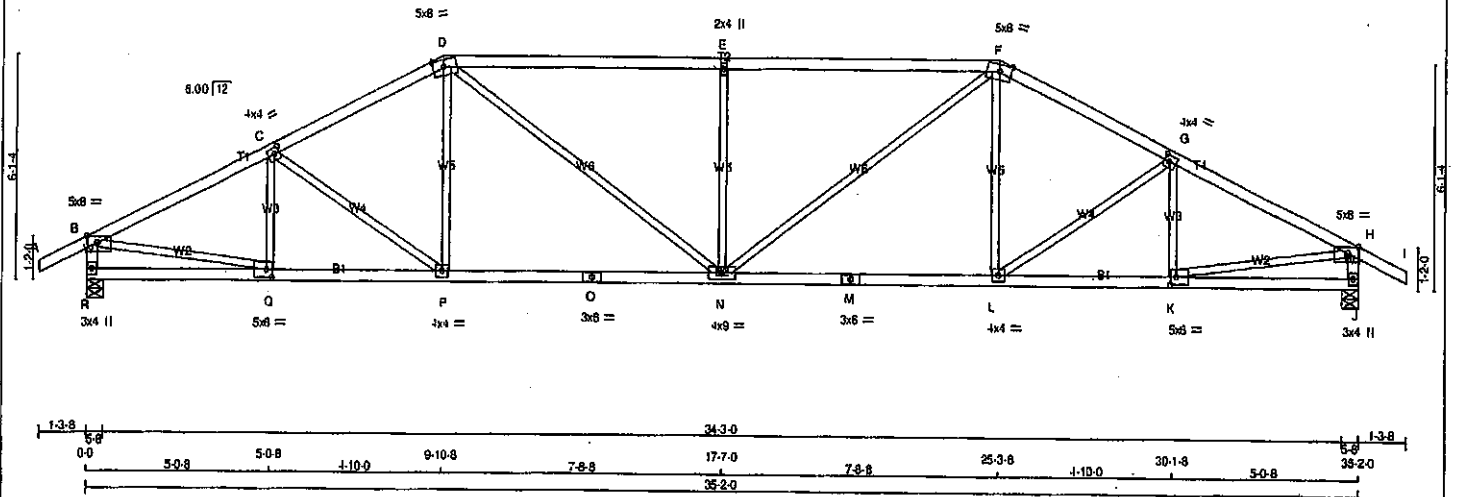

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMWV-p	MT20	5.0	8.0	Edge 3.50
C	TMWV-l	MT20	4.0	4.0	2.00 1.75
D	TTWV-m	MT20	5.0	8.0	2.25 3.75
E	TMWV-w	MT20	2.0	4.0	
F	TTWV-m	MT20	5.0	8.0	2.25 3.75
G	TMWV-l	MT20	4.0	4.0	2.00 1.75
H	TMWV-p	MT20	5.0	8.0	Edge 3.50
J	BMV1-p	MT20	3.0	4.0	
K	BMWV-l	MT20	5.0	8.0	2.50 2.00
L	BMWV-l	MT20	4.0	4.0	
M	BS-l	MT20	3.0	6.0	
N	BMWVW-l	MT20	4.0	9.0	
O	BS-l	MT20	3.0	6.0	
P	BMWV-l	MT20	4.0	4.0	
Q	BMWV-l	MT20	5.0	8.0	2.50 2.00
R	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	UPLIFT	BRG	IN-SX
R	2063	0	0	2063	0	0	5.8	5.8	5.8
J	2063	0	0	2063	0	0	5.8	5.8	5.8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
R	1457	969 0	0 0	0 0	0 0	488 0	0 0
J	1457	969 0	0 0	0 0	0 0	488 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 2.78 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD	LC1 MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 28	-91.8	-91.8 0.12 (1)	10.00	Q-C	-353	0 0.08 (1)
B-C	-2834	0	-91.8 -91.8 0.39 (1)	3.91	P-D	-210	0 0.13 (1)
C-D	-2887	0	-91.8 -91.8 0.37 (1)	3.91	P-D	0	246 0.08 (4)
D-E	-3080	0	-91.8 -91.8 0.97 (1)	2.78	D-N	0	844 0.19 (1)
E-F	-3080	0	-91.8 -91.8 0.97 (1)	2.78	N-F	-872	0 0.51 (1)
F-G	-2887	0	-91.8 -91.8 0.37 (1)	3.91	N-F	0	844 0.19 (1)
G-H	-2834	0	-91.8 -91.8 0.39 (1)	3.91	L-F	0	246 0.08 (4)
H-I	0 28	-91.8	-91.8 0.12 (1)	10.00	L-G	-210	0 0.13 (1)
R-B	-2018	0	0.0 0.0 0.20 (1)	5.94	K-G	-353	0 0.08 (1)
J-H	-2018	0	0.0 0.0 0.20 (1)	5.94	B-Q	0	2591 0.58 (1)
R-Q	0 0	-18.5	-18.5 0.10 (4)	10.00	K-H	0	2591 0.58 (1)
O-P	0 2555	-18.5	-18.5 0.51 (1)	10.00			
P-O	0 2388	-18.5	-18.5 0.49 (1)	10.00			
O-N	0 2388	-18.5	-18.5 0.49 (1)	10.00			
N-M	0 2388	-18.5	-18.5 0.49 (1)	10.00			
M-L	0 2388	-18.5	-18.5 0.49 (1)	10.00			
L-K	0 2555	-18.5	-18.5 0.51 (1)	10.00			
K-J	0 0	-18.5	-18.5 0.10 (4)	10.00			

TOTAL WEIGHT = 2 X 139 = 277 lb

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPC 2011, TPC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.17")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.34")

CSI: TG=0.97/1.00 (D-E:1), BC=0.51/1.00 (K-L:1), WB=0.58/1.00 (H-K:1), SSI=0.34/1.00 (D-E:1)

DOL BEND=1.00 NAIL=1.00 LB BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (MAX) (MIN)
 MT20 618 354 1587 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.87 (D) (INPUT = 0.90)
 JSI METAL = 0.82 (M) (INPUT = 1.00)




Structural component only
 DWG# T-2007716

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	T33	2	1	GREEN PARK HOMES	

Tamareck Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:54:34 2020 Page 1
ID:DMCubiNVR6TsF0e31v6I_zns1I-ZsIWS9rU014zaDiKW10CoPtdL09e8y8wbwh3zMEVZ
23-3-8 29-1-8 35-2-0 36-5-8
Scale = 1:57.6

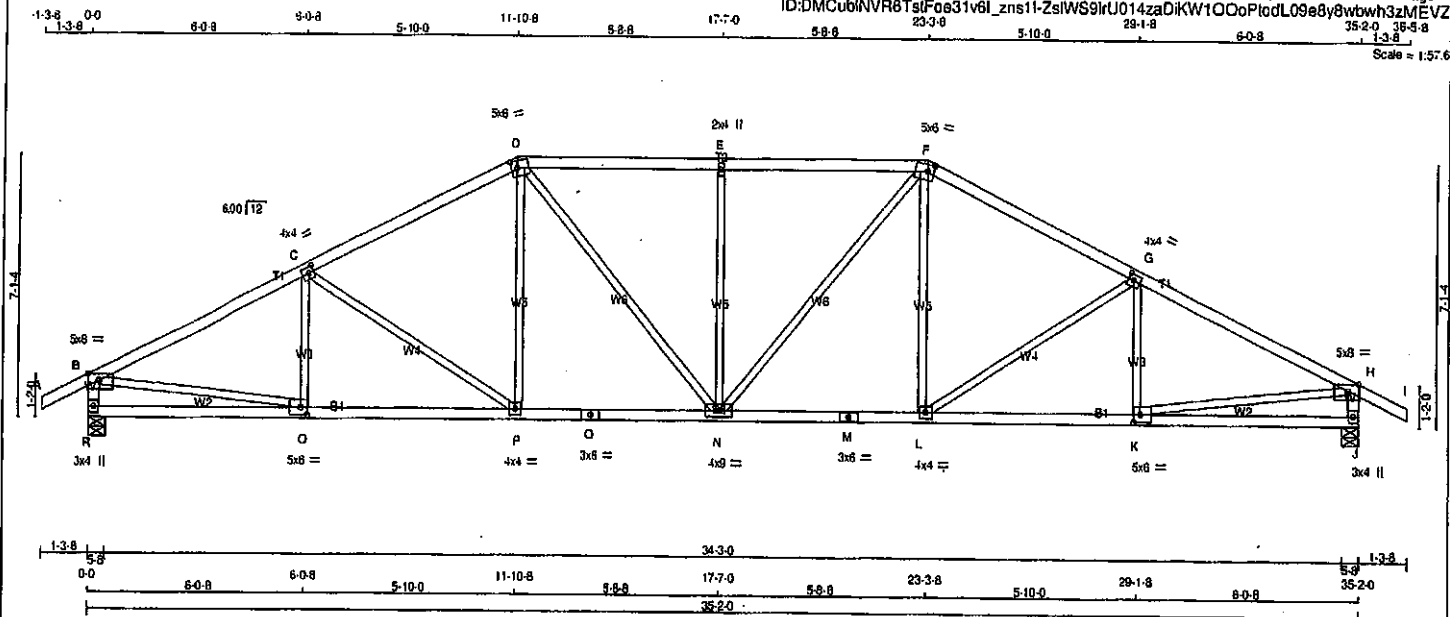

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
R - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
R - O	2x4	DRY	No.2
O - M	2x4	DRY	No.2
M - J	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2
EXCEPT SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
D	TMVW-p	MT20	5.0	8.0	Edge	3.50
C	TMVW-i	MT20	4.0	4.0	2.00	1.75
D	TMVW-m	MT20	5.0	5.0	2.25	2.00
E	TMVW-w	MT20	2.0	4.0		
F	TMVW-m	MT20	5.0	5.0	2.25	2.00
G	TMVW-i	MT20	4.0	4.0	2.00	1.75
H	TMVW-p	MT20	5.0	8.0	Edge	3.50
J	BMV1-p	MT20	3.0	4.0		
K	BMVW-i	MT20	5.0	8.0	2.50	2.25
L	BMVW-i	MT20	4.0	4.0		
M	BS-i	MT20	3.0	8.0		
N	BMVW-w	MT20	4.0	9.0		
O	BS-i	MT20	3.0	8.0		
P	BMVW-i	MT20	4.0	4.0		
Q	BMVW-i	MT20	5.0	6.0	2.50	2.25
R	BMV1-p	MT20	3.0	4.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQHD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	HORZ	BRG	IN-SX	BRG
R	2083	0	0	2083	0	0	5-8	5-8	
J	2083	0	0	2083	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL		
R	1457	989.0	0.0	0.0	0.0	498.0	0.0	0.0	
J	1457	989.0	0.0	0.0	0.0	498.0	0.0	0.0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) R, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.58 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0.28	-91.8 -91.8	0.12 (1)	10.00	Q-C	-255.12	0.07 (1)
B-C	-2889.0	-91.8 -91.8	0.58 (1)	3.58	C-P	-435.0	0.42 (1)
C-D	-2539.0	-91.8 -91.8	0.52 (1)	3.83	P-D	0.350	0.08 (1)
D-E	-2559.0	-91.8 -91.8	0.48 (1)	3.55	D-N	0.482	0.11 (1)
E-F	-2559.0	-91.8 -91.8	0.48 (1)	3.55	N-E	-841.0	0.56 (1)
F-G	-2539.0	-91.8 -91.8	0.52 (1)	3.83	N-F	0.482	0.11 (1)
G-H	-2889.0	-91.8 -91.8	0.58 (1)	3.58	L-F	0.350	0.08 (1)
H-I	0.28	-91.8 -91.8	0.12 (1)	10.00	L-G	-435.0	0.42 (1)
I-B	-2014.0	0.0 0.0	0.20 (1)	5.95	K-G	-255.12	0.07 (1)
J-H	-2014.0	0.0 0.0	0.20 (1)	5.95	K-Q	0.2635	0.59 (1)
					K-H	0.2635	0.59 (1)
R-Q	0.0	-18.5 -18.5	0.15 (4)	10.00			
Q-P	0.2809	-18.5 -18.5	0.49 (1)	10.00			
P-O	0.2249	-18.5 -18.5	0.43 (1)	10.00			
O-N	0.2249	-18.5 -18.5	0.43 (1)	10.00			
N-M	0.2249	-18.5 -18.5	0.43 (1)	10.00			
M-L	0.2249	-18.5 -18.5	0.43 (1)	10.00			
L-K	0.2609	-18.5 -18.5	0.49 (1)	10.00			
K-J	0.0	-18.5 -18.5	0.15 (4)	10.00			

TOTAL WEIGHT = 2 X 145 = 289 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. O.C.

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(5% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
CALCULATED VERT. DEFL. (LL) = L/999 (0.15")
ALLOWABLE DEFL. (TL) = L/360 (1.17")
CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CSI: TC=0.58/1.00 (G-H:1), BC=0.49/1.00 (K-L:1), WB=0.59/1.00 (H-K:1), SS=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (ORY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 518 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.89 (Q) (INPUT = 0.90)
JSI METAL = 0.69 (M) (INPUT = 1.00)



Structural component only
DWG# T-2007717

JOB NAME 408268	TRUSS NAME T34	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:35 2020 Page 1
 ID:DMCubINVR6TstFoe31v6l zns11-12lufVmfJ9xbkquuDYdowX7f1gjuSK5MaLTDWzMEVY
 1-3-8 0-0 7-0-8 7-0-8 8-10-0 13-10-8 3-8-8 17-7-0 3-8-8 21-3-8 8-10-0 7-0-8 35-2-0 1-3-8
 Scale = 1:58.3

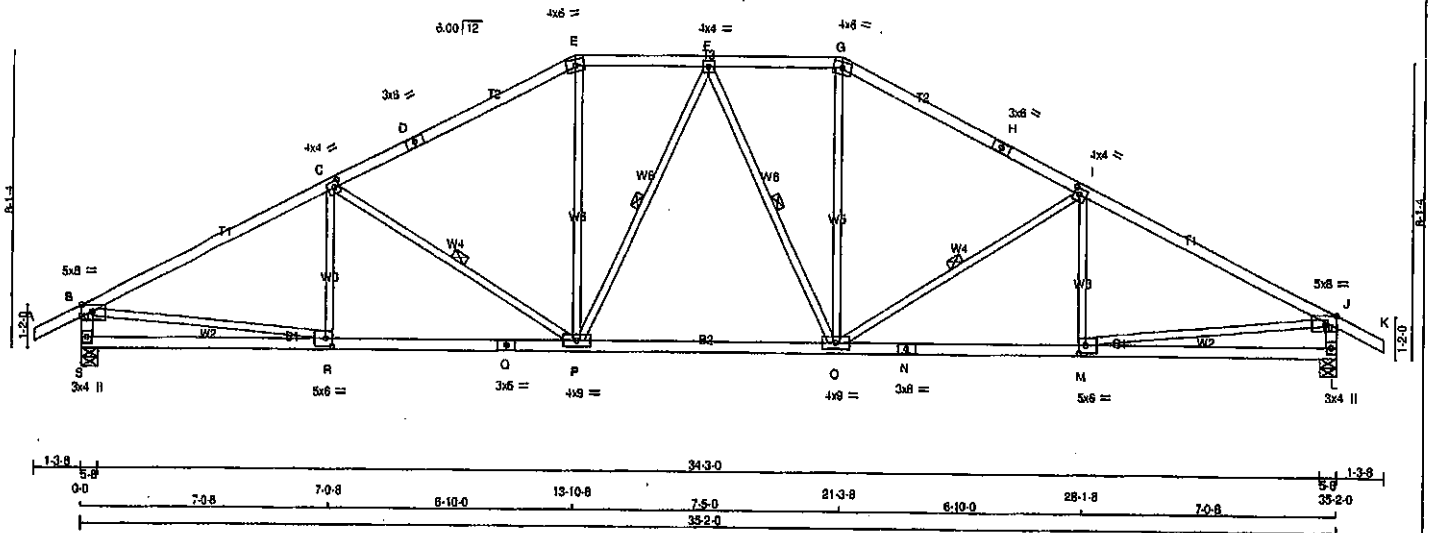

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	DRY	LUMBER
A - D	2x4	DRY	No.2
E - G	2x4	DRY	No.2
H - K	2x4	DRY	No.2
L - J	2x4	DRY	No.2
M - N	2x4	DRY	No.2
O - P	2x4	DRY	No.2
Q - R	2x4	DRY	No.2
S - L	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
DRY: SEASONED LUMBER.			

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW-p	MT20	5.0	8.0	Edge 3.50
C	TMVW-t	MT20	4.0	4.0	2.00 1.75
D	TS-t	MT20	3.0	6.0	
E	TTW-m	MT20	4.0	6.0	
F	TMVW-t	MT20	4.0	4.0	
G	TTW-m	MT20	4.0	6.0	
H	TS-t	MT20	3.0	6.0	
I	TMVW-t	MT20	4.0	4.0	2.00 1.75
J	TMVW-p	MT20	5.0	8.0	Edge 3.50
L	BMV1-p	MT20	3.0	4.0	
M	BMVW-t	MT20	5.0	8.0	2.50 2.25
N	BS-t	MT20	3.0	6.0	
O	BMVW-t	MT20	4.0	9.0	
P	BMVW-t	MT20	4.0	9.0	
Q	BS-t	MT20	3.0	6.0	
R	BMVW-t	MT20	5.0	8.0	2.50 2.25
S	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS							
FACTORED				MAXIMUM FACTORED			
GROSS REACTION				GROSS REACTION			
JT	VERT	HORZ	DOWN	JT	VERT	HORZ	DOWN
S	2083	0	0	S	2083	0	0
L	2083	0	0	L	2083	0	0

UNFACTORED REACTIONS							
1ST LCASE MAX. MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
S	1457	999	0	0	0	488	0
L	1457	999	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.25 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-P, F-P, F-O, I-O.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING									
TOTAL LOAD CASES: (4)									
CHORDS					WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	FACTORED HORZ. LOAD (CS)	MAX. UNBRACED LENGTH (FT)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	FACTORED HORZ. LOAD (CS)	MAX. UNBRACED LENGTH (FT)
FR-TO					FR-TO				
A-B	0	28	-91.8	-91.8 0.12 (1)	10.00	R-C	-182	52	0.06 (1)
B-C	-2906	0	-91.8	-91.8 0.83 (1)	3.25	C-P	-637	0	0.29 (1)
C-D	-2373	0	-91.8	-91.8 0.72 (1)	3.66	P-E	0	674	0.15 (1)
D-E	-2373	0	-91.8	-91.8 0.72 (1)	3.66	E-F	-222	0	0.11 (1)
E-F	-2100	0	-91.8	-91.8 0.19 (1)	4.53	F-O	-222	0	0.11 (1)
F-G	-2100	0	-91.8	-91.8 0.19 (1)	4.53	O-G	0	674	0.15 (1)
G-H	-2373	0	-91.8	-91.8 0.72 (1)	3.66	H-I	-637	0	0.29 (1)
H-I	-2373	0	-91.8	-91.8 0.72 (1)	3.66	I-J	-182	52	0.06 (1)
I-J	-2906	0	-91.8	-91.8 0.83 (1)	3.25	J-K	0	2649	0.60 (1)
J-K	0	28	-91.8	-91.8 0.12 (1)	10.00	K-L	0	2649	0.60 (1)
K-L	-2008	0	0.0	0.0 0.20 (1)	5.96				
L-M	-2008	0	0.0	0.0 0.20 (1)	5.96				
M-N	0	0	-18.5	-18.5 0.20 (4)	10.00				
N-O	0	0	-18.5	-18.5 0.52 (1)	10.00				
O-P	0	0	-18.5	-18.5 0.52 (1)	10.00				
P-Q	0	2193	-18.5	-18.5 0.45 (1)	10.00				
Q-R	0	2630	-18.5	-18.5 0.52 (1)	10.00				
R-S	0	2630	-18.5	-18.5 0.52 (1)	10.00				
S-T	0	0	-18.5	-18.5 0.20 (4)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:
 TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF NBC 2010, NBC 2012, ABC 2019
 - PART 9 OF NBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.14")
 ALLOWABLE DEFL.(TL) = L/360 (1.17")
 CALCULATED VERT. DEFL.(TL) = L/999 (0.30")

CSI: TC=0.83/1.00 (J-I), BC=0.62/1.00 (M-O), WB=0.60/1.00 (J-M), SI=0.28/1.00 (B-C)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1687 788 1987 1650


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
 JSI METAL= 0.75 (Q) (INPUT = 1.00)

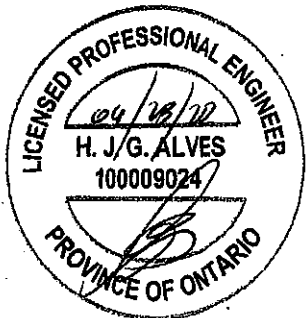

Structural component only
 DWG# T-2007718

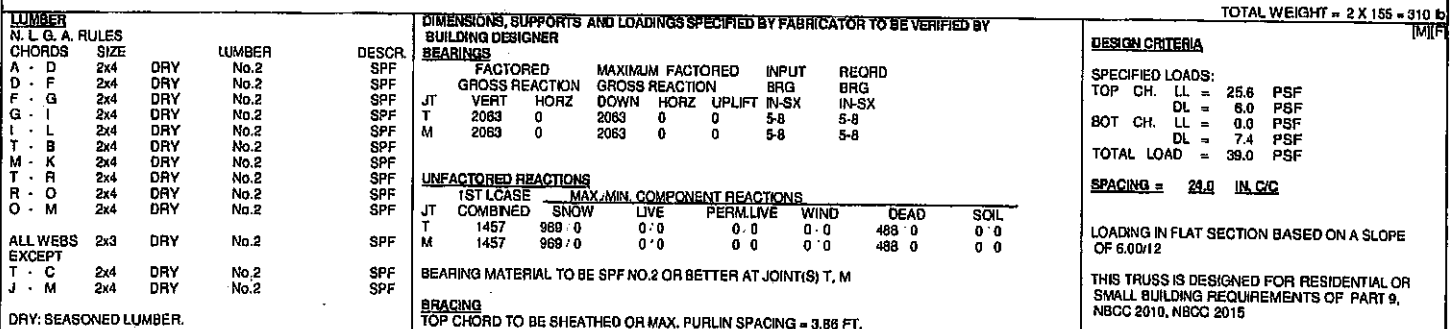

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY ABOVE


END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

CHORDS	WEBS
MAX. FACTORED	MAX. FACTORED

MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX CSI (LC)	MAX. UNBRAC	MEMB.	FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO		LENGTH FR-TO			
A-B	0-28	-91.8	-91.8 0.12 (1)	10.00	C-S	-110 37	0.04 (1)
B-C	0-20	-91.8	-91.8 0.32 (1)	10.00	E-Q	0 277	0.08 (1)
C-D	-2780 0	-91.8	-91.8 0.40 (1)	3.86	E-Q	-881 0	0.31 (1)
D-E	-2760, 0	-91.8	-91.8 0.40 (1)	3.86	Q-F	0 613	0.14 (1)
E-F	2197 0	-91.8	-91.8 0.36 (1)	4.30	C-G	0 4	0.00 (1)
F-G	-1925-0	-91.8	-91.8 0.18 (1)	4.71	P-G	0 609	0.14 (1)
G-H	-2165 0	-91.8	-91.8 0.38 (1)	4.30	P-H	-583-0	0.31 (1)
H-I	-2761 0	-91.8	-91.8 0.40 (1)	3.86	H-N	0 279	0.08 (1)
I-J	-2761 0	-91.8	-91.8 0.40 (1)	3.86	N-J	-110 37	0.04 (1)
J-K	0 20	-91.8	-91.8 0.32 (1)	10.00	T-C	-3042 0	0.61 (1)
K-L	0 28	-91.8	-91.8 0.12 (1)	10.00	J-M	-3043 0	0.61 (1)
T-B	-325 0	0.0	0.0 0.03 (1)	7.81			
M-K	-325 0	0.0	0.0 0.03 (1)	7.81			


T-S	0 2538	-18.5	-18.5	0.56 (1)	10.00
S-R	0 2362	-18.5	-18.5	0.53 (1)	10.00
R-Q	0 2302	-18.5	-18.5	0.53 (1)	10.00
Q-P	0 1924	-18.5	-18.5	0.40 (1)	10.00
P-O	0 2362	-18.5	-18.5	0.53 (1)	10.00
O-N	0 2362	-18.5	-18.5	0.53 (1)	10.00
N-M	0 2538	-18.5	-18.5	0.56 (1)	10.00

JSI GRIP= 0.89 (F) (INPUT = 0.90)
JSI METAL= 0.83 (O) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	T36	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 M/Tek Industries, Inc. Tue Apr 28 09:54:37 2020 Page 1
 ID:DMCubINVR6TstF0831v6I_zns1I-zRQe4BnmjxP1q1yH0eb5?R1QPqM5MzsOquqaH0zMEVW
 23-4-8 29-2-0 35-2-0 1-3-8
 1-3-8 0-0 6-0-0 6-0-0 5-9-8 11-9-8 5-9-8 17-7-0 5-9-8 5-9-8 6-0-0 1-3-8
 Scale = 1:58.2

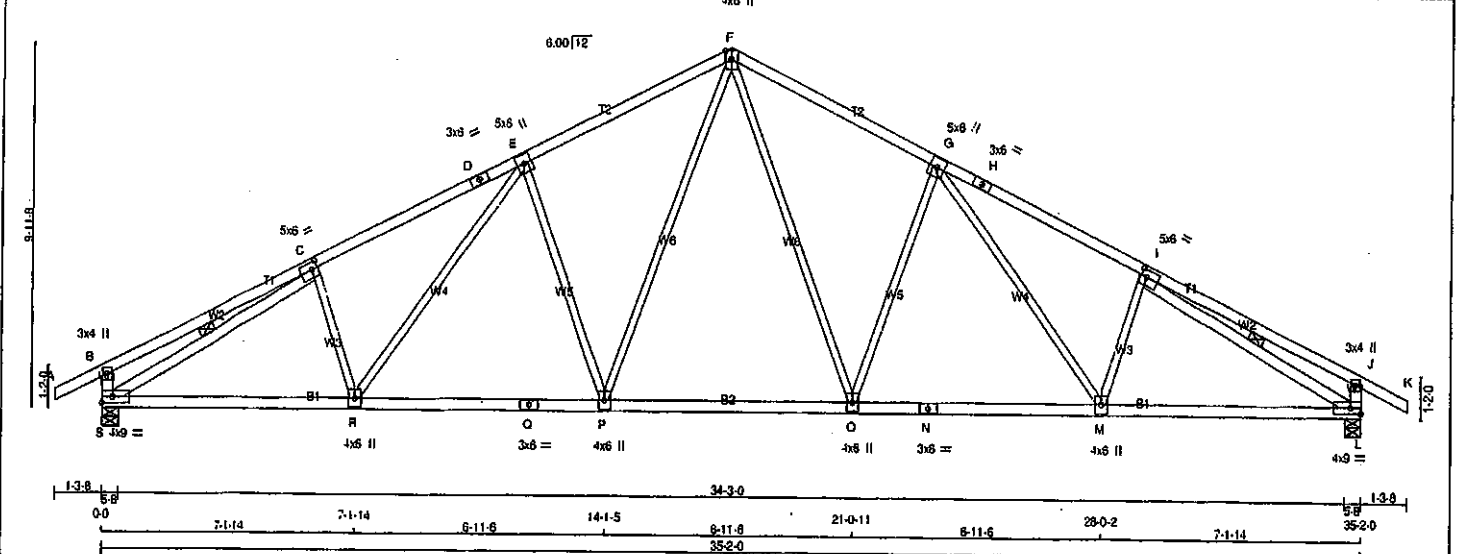

LUMBER			
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - H	2x4	DRY	No.2
H - K	2x4	DRY	No.2
S - B	2x4	DRY	No.2
L - J	2x4	DRY	No.2
S - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
N - L	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2
S - C	2x4	DRY	No.2
I - L	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)				
JT TYPE	PLATES	W	LEN Y	X
B TMV+p	MT20	3.0	4.0	
C TMWV-t	MT20	5.0	6.0	2.25 2.00
D TS-t	MT20	3.0	6.0	
E TMWV-t	MT20	5.0	6.0	
F TTWV+p	MT20	4.0	6.0	Edge
G TMWV-t	MT20	5.0	6.0	
H TS-t	MT20	3.0	6.0	
I TMWV-t	MT20	5.0	6.0	2.25 2.00
J TMV+p	MT20	3.0	4.0	
L BMVW-t	MT20	4.0	9.0	Edge
M, O, P, R				
M BMWV-t	MT20	4.0	6.0	
N BS-t	MT20	3.0	6.0	
Q BS-t	MT20	3.0	6.0	
S BMVW-t	MT20	4.0	9.0	Edge

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	VERT	GROSS REACTION	DOWN	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
S	2063	0	0	2063	0	5-8	5-8	5-8	5-8
L	2063	0	0	2063	0	5-8	5-8	5-8	5-8

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS		DEAD		SOIL	
JT	COMBINED	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
S	1457	989	0	0	0	488	0
L	1457	989	0	0	0	488	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) S, L

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.75 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF C-S, L.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (LBS)	MAX. (PLF)	MEMB.	FORCE (LBS)	MAX. (LBS)	MAX. (LBS)
FR-TO				FR-TO			
A-B	0 28	-91.8	-91.8 0.12 (1)	F-O	0 868	0.19 (1)	
B-C	0 22	-91.8	-91.8 0.40 (1)	Q-G	-728 0	0.72 (1)	
C-D	-2808 0	-91.8	-91.8 0.49 (1)	G-M	0 391	0.09 (1)	
D-E	-2808 0	-91.8	-91.8 0.49 (1)	M-I	-192 18	0.05 (1)	
E-F	-2322 0	-91.8	-91.8 0.46 (1)	P-F	0 868	0.19 (1)	
F-G	-2322 0	-91.8	-91.8 0.46 (1)	E-P	-728 0	0.72 (1)	
G-H	-2808 0	-91.8	-91.8 0.49 (1)	R-E	0 391	0.09 (1)	
H-I	-2808 0	-91.8	-91.8 0.49 (1)	C-R	-192 18	0.05 (1)	
I-J	0 22	-91.8	-91.8 0.40 (1)	S-C	-3064 0	0.72 (1)	
J-K	0 28	-91.8	-91.8 0.12 (1)	I-L	-3064 0	0.72 (1)	
S-B	-344 0	0.0	0.0 0.03 (1)				
L-J	-344 0	0.0	0.0 0.03 (1)				
S-R	0 2574	-18.5	-18.5 0.53 (1)				
R-Q	0 2291	-18.5	-18.5 0.47 (1)				
Q-P	0 2291	-18.5	-18.5 0.47 (1)				
P-O	0 1762	-18.5	-18.5 0.38 (1)				
O-N	0 2291	-18.5	-18.5 0.47 (1)				
N-M	0 2291	-18.5	-18.5 0.47 (1)				
M-L	0 2574	-18.5	-18.5 0.53 (1)				

TOTAL WEIGHT = 5 X 152 = 758 lb (M/F)

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 25.6 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-09, CSA 086-14
 - TPIC 2011, TPIC 2014

155 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (LL) = L/999 (0.14")
 ALLOWABLE DEFL. (TL) = L/360 (1.17")
 CALCULATED VERT. DEFL. (TL) = L/999 (0.28")

CSI: TC=0.49/1.00 (C-E:1), BC=0.53/1.00 (L-M:1), WB=0.72/1.00 (E-P:1), SSI=0.22/1.00 (I-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION
 (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 618 354 1657 788 1987 1658

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP = 0.87 (C) (INPUT = 0.90)
 JSI METAL = 0.77 (I) (INPUT = 1.00)




Structural component only
 DWG# T-2007720

Scale = 1:22.5



LOC.	LOC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN
5-10-8	-428	-428	---	FRONT	VERT	TOTAL	---	C1
13-1-8	-428	-428	---	FRONT	VERT	TOTAL	---	C1
13-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
11-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
5-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1
7-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
9-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
11-0-12	-110	-110	---	FRONT	VERT	TOTAL	---	C1
2-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
4-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
7-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
9-0-12	-28	-28	---	FRONT	VERT	TOTAL	---	C1
14-11-4	-28	-28	---	FRONT	VERT	TOTAL	---	C1



JOB NAME 408268	TRUSS NAME T37	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:38 2020 Page 2	
ID:DMCubINVR6TslFoe31v6I zns11-woYPVspziYIM4LS73dZ5s6qge1low_hHCJhMHZMEVU					

FACTORED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
V	16-11-4	-20	-20	---	FRONT	VERT	TOTAL	---	C1
CONNECTION REQUIREMENTS									
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.									




Structural component only
DWG# T-2007721 72

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408268	T38	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mtek Industries, Inc. Tue Apr 28 09:54:40 2020 Page 1
ID:DMCubINVR6TstFoe31v6t_zns1f-C06njCpb3soDhVgsh8od3f7q1R6ZOBqWs2EujzMEVT

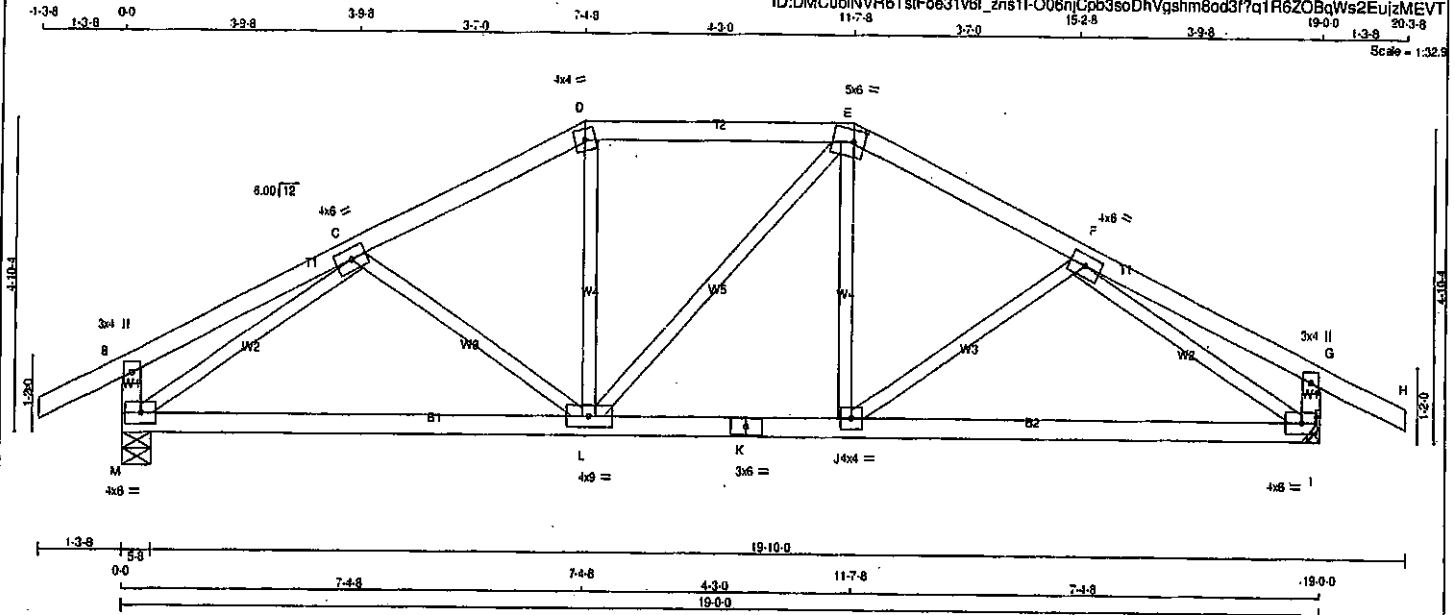

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
D - E	2x4	DRY	No.2	SPF	
E - H	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
I - G	2x4	DRY	No.2	SPF	
M - K	2x4	DRY	No.2	SPF	
K - I	2x4	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT TYPE	PLATES	W	LEN	Y	X
8 TMV+p	MT20	3.0	4.0		
C TMVW-1	MT20	4.0	6.0		
D TTW-m	MT20	4.0	4.0		
E TTW-m	MT20	5.0	6.0	2.25	2.00
F TMVW-1	MT20	4.0	6.0		
G TMV+p	MT20	3.0	4.0		
I BMVW-1	MT20	4.0	6.0		
J BMVW-1	MT20	4.0	4.0		
K BS-1	MT20	3.0	6.0		
L BMVW-1	MT20	4.0	9.0		
M BMVW-1	MT20	4.0	6.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT	REQD
JT	GROSS REACTION	GROSS REACTION	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
M	1172	0	1172	0	0	5-8	5-8
I	1172	0	1172	0	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3.8.

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 3-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	828	558.0	0.0	0.0	0.0	271.0	0.0
I	828	558.0	0.0	0.0	0.0	271.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.69 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. CS (I/C)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (I/C)	
FR-TO		FROM TO		FR-TO			
A-B	0.28	-91.8 -91.8 0.12 (1)	10.00	C-L	-144.10	0.05 (1)	
B-C	0.16	-91.8 -91.8 0.18 (1)	10.00	L-D	0.200	0.05 (1)	
C-D	-1192.0	-91.8 -91.8 0.15 (1)	5.69	L-E	0.0	0.00 (1)	
D-E	-1055.0	-91.8 -91.8 0.23 (1)	5.87	J-F	0.200	0.05 (1)	
E-F	-1191.0	-91.8 -91.8 0.18 (1)	5.69	J-F	-144.10	0.05 (1)	
F-G	0.16	-91.8 -91.8 0.18 (1)	10.00	M-C	-1447.0	0.49 (1)	
G-H	0.28	-91.8 -91.8 0.12 (1)	10.00	F-I	-1448.0	0.49 (1)	
M-B	-258.0	0.0 0.0 0.03 (1)	7.81				
I-G	-258.0	0.0 0.0 0.03 (1)	7.81				
M-L	0.1168	-18.5 -18.5 0.32 (1)	10.00				
L-K	0.1055	-18.5 -18.5 0.28 (4)	10.00				
K-J	0.1055	-18.5 -18.5 0.28 (4)	10.00				
J-I	0.1187	-18.5 -18.5 0.32 (1)	10.00				

TOTAL WEIGHT = 76 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 21.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF 8CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

(58 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.63")
CALCULATED VERT. DEFL.(LL) = L/998 (0.04")
ALLOWABLE DEFL.(TL) = L/360 (0.63")
CALCULATED VERT. DEFL.(TL) = L/998 (0.13")

CSI: TC=0.23/1.00 (D-E:1), BC=0.32/1.00 (I-J:1),
WB=0.49/1.00 (C-M:1), SSI=0.15/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LB BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	618	354	1887	788

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.76 (M) (INPUT = 0.90)
JSI METAL = 0.40 (K) (INPUT = 1.00)



Structural component only
DWG# T-2007722

JOB NAME 408268	TRUSS NAME T39S	QUANTITY 1	PLY 2	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
Tamarack Roof Truss, Burlington				Version 8.910 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:54:41 2020 Page 1		
				ID:DMCubINVR6TstFoe31v6l zns1l-sCgwyqEq9w4JIF2FUM1AHB6MRkzirm JWooQ9zMEVS 13-8 0-0 3-0-8 3-0-8 2-10-0 5-10-8 2-2-0 6-0-8 1-6-7 9-6-15 3-4-8 12-11-8 16-4-0 17-8-12 2-0-0 19-8-12 20-11-1 25-11-0 Scale = 1:43.9		

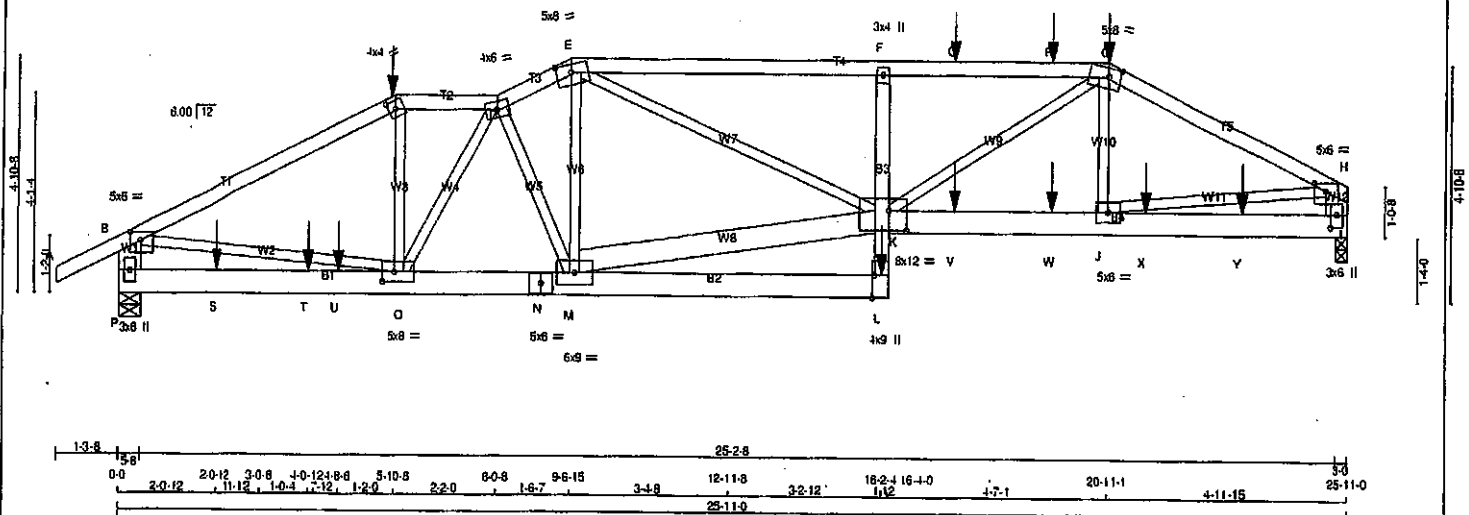

CHORDS	SIZE	DRY	NUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - E	2x4	DRY	No.2	SPF
E - G	2x4	DRY	No.2	SPF
G - H	2x4	DRY	No.2	SPF
P - B	2x6	DRY	No.2	SPF
I - H	2x6	DRY	No.2	SPF
P - N	2x6	DRY	No.2	SPF
N - L	2x6	DRY	No.2	SPF
L - F	2x4	DRY	No.2	SPF
K - I	2x6	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
M - K	2x6	DRY	No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS: (0.122"x3") SPIRAL NAILS		
A-C 1	12	SIDE(61.0)
C-D 1	12	SIDE(61.0)
D-E 1	12	TOP
E-G 1	12	SIDE(61.0)
G-H 1	12	SIDE(61.0)
P-B 2	12	TOP
I-H 2	12	TOP
BOTTOM CHORDS: (0.122"x3") SPIRAL NAILS		
P-N 2	12	SIDE(0.0)
N-L 2	12	SIDE(122.0)
K-I 2	12	SIDE(0.0)
L-F 1	12	SIDE(7.1)
WEBS: (0.122"x3") SPIRAL NAILS		
2x3 1	6	
2x6 2	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		RECORD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
P	3012	0	0	3012	0	0	5-8	5-8	5-8
I	2272	0	0	2272	0	0	3-0	3-0	3-0

UNFACTORED REACTIONS		MAX. MIN. COMPONENT REACTIONS					
JT	1ST CASE COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
P	2122	1438 0	0 0	0 0	0 0	687 0	0 0
I	1803	1072 0	0 0	0 0	0 0	531 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) P, I

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED			WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (LBS)	LC1 (PLF)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO			
A-B	0.28	-91.8	-91.8	0.07 (1)	10.00	C-C	0.1220	0.15 (1)
B-C	-4231	0	-91.8	-91.8	0.48 (1)	4.22	D-M	0.22 (1)
C-D	-3836	0	-91.8	-91.8	0.09 (1)	4.77	M-E	0.879
D-E	-3876	0	-91.8	-91.8	0.07 (1)	4.77	M-K	0.3448
E-F	-5003	0	-91.8	-91.8	0.50 (1)	3.92	E-K	0.1694
F-G	-5043	0	-91.8	-91.8	0.41 (1)	3.91	J-G	0.21 (1)
Q-R	-5043	0	-91.8	-91.8	0.41 (1)	3.91	B-O	-290 20
R-G	-5043	0	-91.8	-91.8	0.41 (1)	3.91	O-D	0.3813
G-H	-3531	0	-91.8	-91.8	0.30 (1)	4.71	K-G	0.08 (1)
P-B	-2778	0	0.0	0.10 (1)	7.81	J-H	0.2279	0.28 (1)
I-H	-2215	0	0.0	0.08 (1)	7.81		0.3182	0.39 (1)
P-S	0	0	-18.5	-18.5	0.30 (1)	10.00		
S-T	0	0	-18.5	-18.5	0.30 (1)	10.00		
T-U	0	0	-18.5	-18.5	0.30 (1)	10.00		
U-O	0	0	-18.5	-18.5	0.30 (1)	10.00		
O-N	0	4082	-18.5	-18.5	0.47 (1)	10.00		
N-M	0	4082	-18.5	-18.5	0.47 (1)	10.00		
M-L	0	95	-18.5	-18.5	0.06 (4)	10.00		
L-K	0	562	0.0	0.0	0.14 (1)	10.00		
K-F	-591	0	0.0	0.10 (1)	7.81			
K-V	0	3147	-18.5	-18.5	0.23 (1)	10.00		
V-W	0	3147	-18.5	-18.5	0.23 (1)	10.00		
W-J	0	3147	-18.5	-18.5	0.23 (1)	10.00		
J-X	0	0	-18.5	-18.5	0.04 (4)	10.00		
X-Y	0	0	-18.5	-18.5	0.04 (4)	10.00		
Y-I	0	0	-18.5	-18.5	0.04 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)		FACE		DIR.		TYPE		HEEL		CONN.	
JT	LOC.	LOC1	MAX.	MAX.	FRONT	VERT	TOTAL	---	---	---	---
C	5-10-8	-309	-309	---	FRONT	VERT	TOTAL	---	C1	---	---
G	20-11-1	-29	-32	---	FRONT	VERT	DEAD	---	C1	---	---
G	20-11-1	-144	-144	---	FRONT	VERT	SNOW	---	C1	---	---
L	16-2-4	-495	-495	---	FRONT	VERT	TOTAL	---	C1	---	---
Q	17-8-12	-55	-55	---	FRONT	VERT	TOTAL	---	C1	---	---
R	19-8-12	-55	-55	---	FRONT	VERT	TOTAL	---	C1	---	---
S	2-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1	---	---
T	4-0-12	-26	-26	---	FRONT	VERT	TOTAL	---	C1	---	---
U	4-8-6	-1117	-1117	---	FRONT	VERT	TOTAL	---	C1	---	---
V	17-8-12	-11	-11	---	FRONT	VERT	TOTAL	---	C1	---	---
W	19-8-12	-11	-11	---	FRONT	VERT	TOTAL	---	C1	---	---
X	21-8-12	-11	-11	---	FRONT	VERT	TOTAL	---	C1	---	---
Y	23-8-12	-11	-11	---	FRONT	VERT	TOTAL	---	C1	---	---

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIAL LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

LOADING IN ALL FLAT SECTIONS BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***

ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, NBC 2012, ABG 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.86")
CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
ALLOWABLE DEFL.(TL) = L/360 (0.86")
CALCULATED VERT. DEFL.(TL) = L/999 (0.20")

CSI: TC=0.50/1.00 (E-F:1), BC=0.47/1.00 (M-O:1),
WB=0.47/1.00 (B-O:1), SS=0.35/1.00 (O-P:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE (GRIP/DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1886

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP=0.88 (E) (INPUT = 0.90)
JSI METAL=0.46 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007723 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	T39S	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:41 2020 Page 2
ID:DMCubINVR6TslFae31v6l_zns1l-sCa9wYqEg9w4JfF2Fu1AHB6MRkzlm IWooQ9zMEVS


PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	2.00	2.75
C	TTW-h	MT20	4.0	4.0	2.00	1.75
D	TTWW-m	MT20	4.0	6.0		
E	TTWW-m	MT20	5.0	8.0	2.00	3.75
F	TMV-p	MT20	3.0	4.0		
G	TTWW-m	MT20	5.0	8.0	2.25	3.00
H	TMVW-p	MT20	5.0	6.0	2.00	3.00
I	BMV1-p	MT20	3.0	6.0	3.25	1.50
J	BMWW-1	MT20	5.0	6.0		
K	BMWWWW-1	MT20	8.0	12.0	5.00	4.50
L	BMV-p	MT20	4.0	9.0	Edge	0.75
M	BMWWWW-1	MT20	6.0	9.0		
N	BS-1	MT20	5.0	6.0		
O	BMWWWW-1	MT20	5.0	8.0	2.50	3.00
P	BMV1-p	MT20	3.0	6.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.

CONNECTION REQUIREMENTS


- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

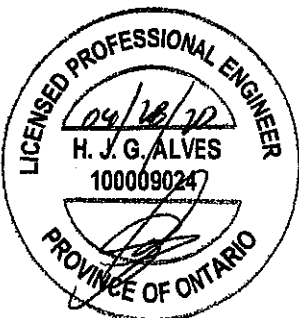

Structural component only
DWG# T-2007723 42

JOB NAME 408268	TRUSS NAME T40	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 09:54:42 2020 Page 1	

ID:DMCubINVR8tstF0e31v6l_2ns11-KOEX8unsbt2xxpqEoBAGiUkGbr571Dx7zAXLczMEVR
14-2-0 14-2-0 20-5-8 20-5-8 25-8-0 25-8-0
Scale = 1:12.0

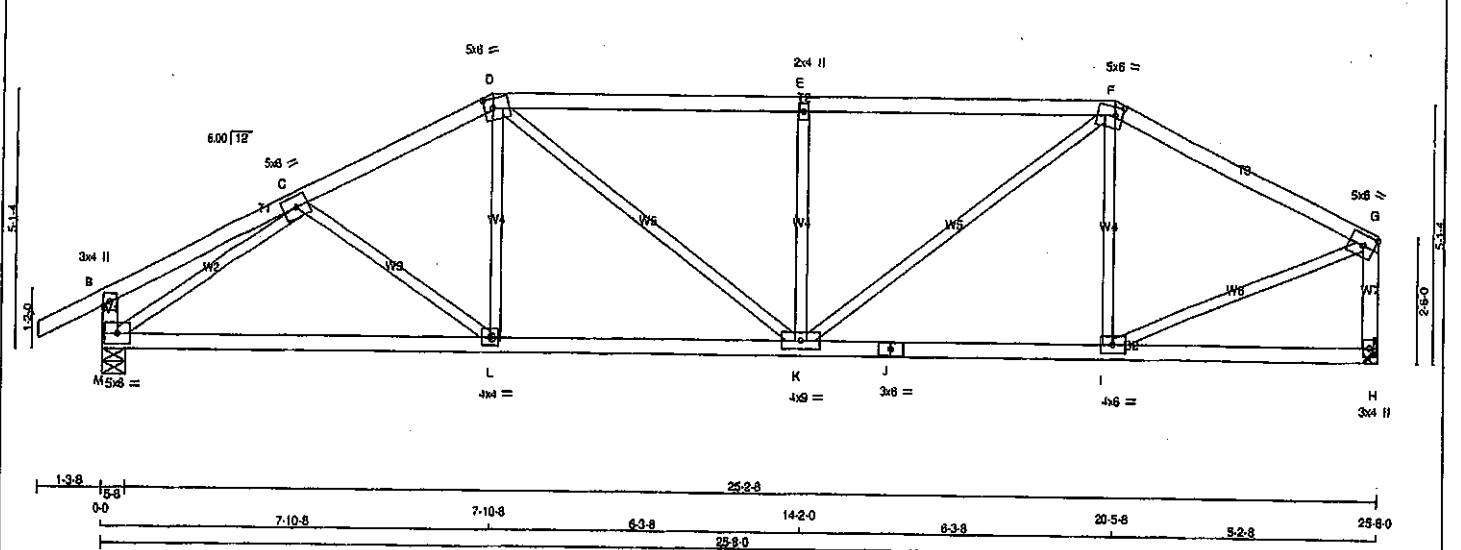

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - G	2x4	DRY	No.2
M - B	2x4	DRY	No.2
H - G	2x4	DRY	No.2
M - J	2x4	DRY	No.2
J - H	2x4	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-I	MT20	5.0	6.0	
D	TTWW-m	MT20	5.0	6.0	2.25 2.00
E	TMV-w	MT20	2.0	4.0	
F	TTWW-m	MT20	5.0	6.0	2.00 1.75
G	TMVW-I	MT20	5.0	6.0	Edge
H	BMV1+p	MT20	3.0	4.0	
I	BMVW-I	MT20	4.0	6.0	
J	BS-I	MT20	3.0	6.0	
K	BMVW-I	MT20	4.0	6.0	
L	BMVW-I	MT20	4.0	4.0	
M	BMVW-I	MT20	5.0	6.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER									
BEARINGS									
JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG					
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
M	1539	0	1539	0	0	5-8	5-8		
H	1415	0	1415	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

UNFACTORED REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1088	728 / 0	0 / 0	0 / 0	0 / 0	380 / 0	0 / 0
H	1001	657 / 0	0 / 0	0 / 0	0 / 0	344 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.22 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LG1 MAX (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LG1 MAX (LBS)	MAX. FACTORED LG1 MAX (LBS)
FR-TO		FROM TO	LENGTH	FR-TO		FROM TO	LENGTH
A-B	0 28	-91.8 -91.8	0.12 (1)	10.00	C-L	-75 38	0.03 (1)
B-C	0 17	-91.8 -91.8	0.20 (1)	10.00	L-D	0 198	0.05 (4)
C-D	-1837 0	-91.8 -91.8	0.20 (1)	4.77	D-K	0 419	0.09 (1)
D-E	-1963 0	-91.8 -91.8	0.53 (1)	4.22	K-E	-711 0	0.27 (1)
E-F	-1963 0	-91.8 -91.8	0.53 (1)	4.22	K-F	0 913	0.21 (1)
F-G	-1394 0	-91.8 -91.8	0.35 (1)	5.12	I-F	-390 0	0.15 (1)
M-B	-288 0	0 0	0.03 (1)	7.81	M-C	-2077 0	0.80 (1)
H-G	-1378 0	0 0	0.18 (1)	8.93	I-G	0 1348	0.30 (1)
M-L	0 1688	-18.5 -18.5	0.41 (1)	10.00			
L-K	0 1631	-18.5 -18.5	0.40 (1)	10.00			
K-J	0 1237	-18.5 -18.5	0.29 (1)	10.00			
J-I	0 1237	-18.5 -18.5	0.29 (1)	10.00			
I-H	0 0	-18.5 -18.5	0.15 (4)	10.00			

DESIGN CRITERIA			
SPECIFIED LOADS:			
TOP CH.	LL	=	25.8 PSF
	DL	=	8.0 PSF
BOT CH.	LL	=	0.0 PSF
	DL	=	7.4 PSF
TOTAL LOAD	=	39.0 PSF	
SPACING	=	24.0	N/C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2010, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.88")
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")
ALLOWABLE DEFL.(TL) = L/360 (0.88")
CALCULATED VERT. DEFL.(TL) = L/999 (0.17")

CSI: TC=0.53/1.00 (D-E:1), BC=0.41/1.00 (L-M:1), WB=0.80/1.00 (C-M:1), SG=0.28/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES			
PLATE GRIP(DRY) SHEAR	SECTION	(PSI)	(PL)
		MAX MIN	MAX MIN
MT20		618 354	1687 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.88 (M) (INPUT = 0.90)
JSI METAL= 0.60 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007724

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408268	T42	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 2019 MTek Industries, Inc. Tue Apr 28 09:54:44 2020 Page 1
ID:DMCubINVR6TslF0831v6l zns11-GnLiYal674IIA6 dwCDknvpa9forVEIQRU0S1UzMEVP

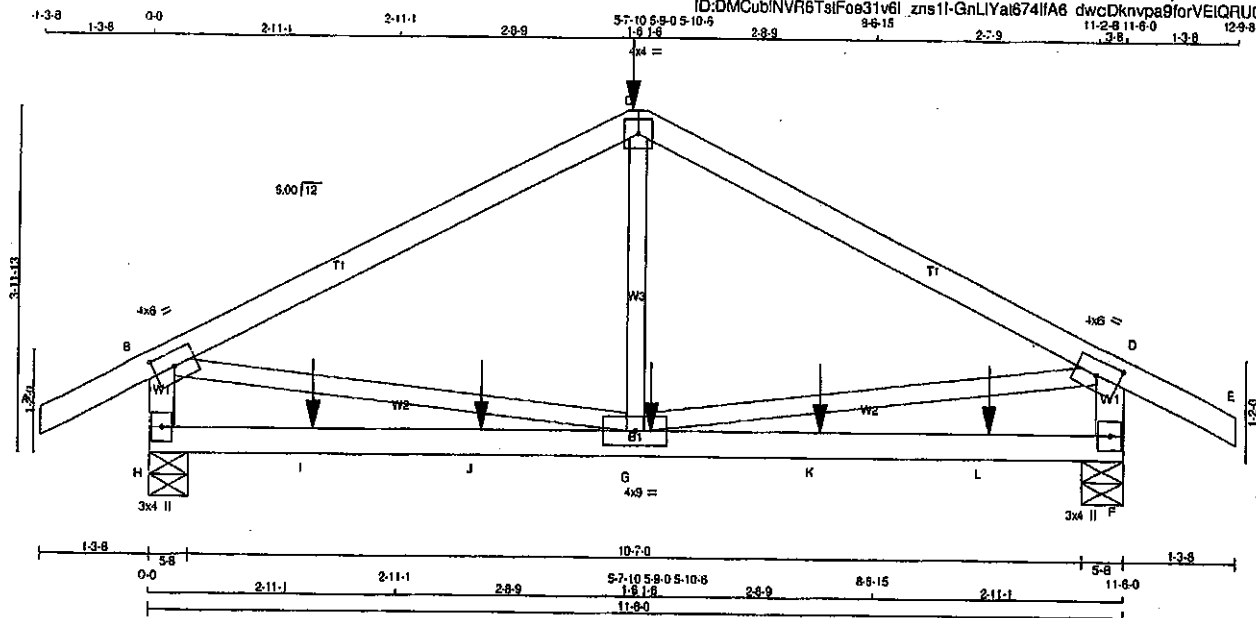

Scale = 1/24.6

TOTAL WEIGHT = 45 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-1	MT20	4.0	6.0	2.00	3.00
C	TTW-p	MT20	4.0	4.0		
D	TMVW-1	MT20	4.0	6.0	2.00	3.00
F	BMV1-p	MT20	3.0	4.0		
G	BMVWW-1	MT20	4.0	9.0		
H	BMV1-p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	1108	0	1108	0
F	1110	0	1110	0

UNFACTORED REACTIONS

	1ST LOASE	MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	780	533	0	0.0	0.0	247	0
F	782	533	0	0.0	0.0	249	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.91 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	FACTORED HORZ. LOAD (LBS)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0	28	-91.8	B-G	0	1037	0.28 (1)
B-C	-1146	0	-91.8	G-D	0	1037	0.28 (1)
C-D	-1146	0	-91.8	D-E	-117	116	0.04 (4)
D-E	0	28	-91.8	E-F	0	1037	0.28 (1)
E-F	-1054	0	-91.8	F-G	0	1037	0.28 (1)
F-G	-1054	0	-91.8	G-H	0	1037	0.28 (1)
H-I	0	0	-18.5	I-J	0	1037	0.28 (1)
I-J	0	0	-18.5	J-K	0	1037	0.28 (1)
J-K	0	0	-18.5	K-L	0	1037	0.28 (1)
K-L	0	0	-18.5	L-F	0	1037	0.28 (1)
L-F	0	0	-18.5				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-9-0	-88	-98	---	FRONT	VERT	DEAD	---	C1
C	5-9-0	-92	-92	---	BACK	VERT	TOTAL	---	C1
C	5-9-0	-435	-435	---	FRONT	VERT	SNOW	---	C1
G	5-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
I	1-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
J	3-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
K	7-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1
L	9-11-4	-17	-17	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
LOADS WERE DERIVED FROM USER INPUT
NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

NON STANDARD GIRDER

ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 088-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.65/1.00 (C-D:1), BC=0.27/1.00 (G-H:4),
WB=0.28/1.00 (B-G:1), SS=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 610 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.59 (B) (INPUT = 0.90)
JSI METAL = 0.33 (D) (INPUT = 1.00)




Structural component only
DWG# T-2007726

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408268	T43	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:54:45 2020 Page 1

ID:DMCubINVR6TstFoe31v6I_zns11-kzvgrwtkuCQW6GZpUKkzK7Mp_2AWEkZg8m?ZxzMEVO

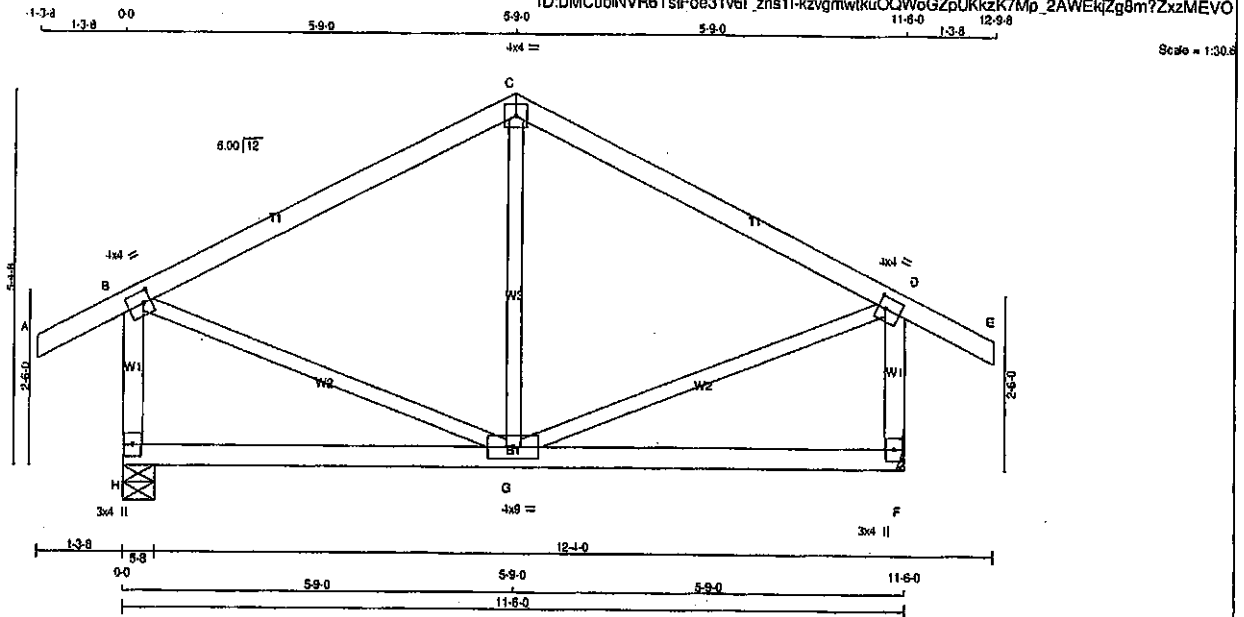

TOTAL WEIGHT = 2 X 49 = 98 lb
[M/F]

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-I	MT20	4.0	4.0	2.00	1.25
C	TTW-p	MT20	4.0	4.0		
D	TMVW-I	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-I	MT20	4.0	9.0		
H	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	HORIZ	UP/LIFT
H	758	0	758	0
F	758	0	758	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1'-8".

UNFACTORED REACTIONS

1ST CASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	534	384.0	0.0	0.0	0.0	170.0	0.0
F	534	384.0	0.0	0.0	0.0	170.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00	G-C	-154 42
B-C	-418 0	-91.8	-91.8	0.39 (1)	8.25	B-G	0 400
C-D	-418 0	-91.8	-91.8	0.39 (1)	8.25	G-D	0 400
D-E	0 28	-91.8	-91.8	0.12 (1)	10.00		
H-B	-718 0	0.0	0.0	0.09 (1)	7.81		
F-D	-718 0	0.0	0.0	0.09 (1)	7.81		
H-G	0 0	-18.5	-18.5	0.17 (4)	10.00		
G-F	0 0	-18.5	-18.5	0.17 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.38")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.38")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.17/1.00 (G-H:4), WB=0.09/1.00 (D-G:1), SS=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1887 1856

PLATE PLACEMENT TOL = 0.250 inches


PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.84 (B) (INPUT = 0.90)
JSI METAL= 0.22 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007727

JOB NAME 408268	TRUSS NAME T43A	QUANTITY 1	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

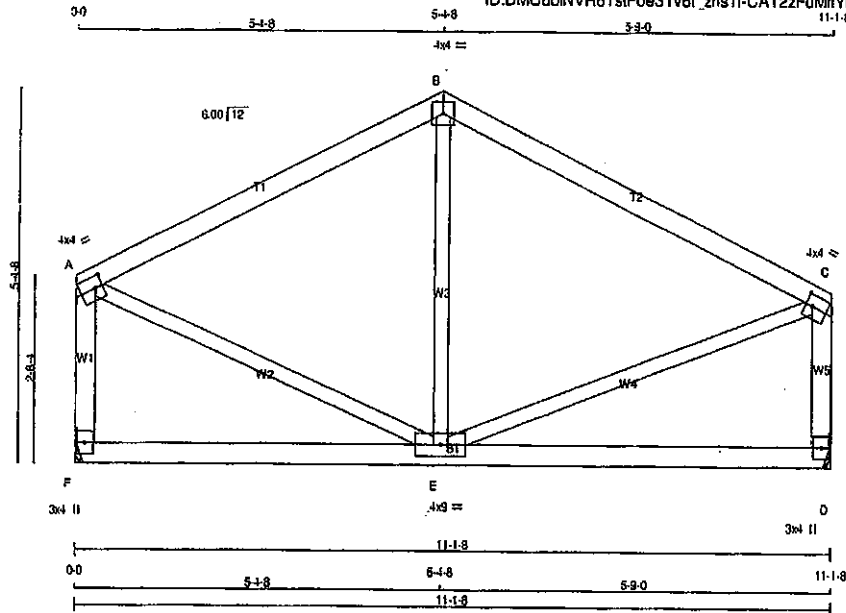

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
F - A	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
A	TMVW-1	MT20	4.0	4.0	2.00 1.25
B	TTW-p	MT20	4.0	4.0	
C	TMVW-1	MT20	4.0	4.0	2.00 1.25
D	BMV1-p	MT20	3.0	4.0	
E	BMVWW-1	MT20	4.0	9.0	
F	BMV1-p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
F	613	0	613	0
D	613	0	613	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F, D. MINIMUM BEARING LENGTH AT JOINT F = 1-8, JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	MAX. MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	434	285.0	0.0	0.0	0.0	149.0	0.0
D	434	285.0	0.0	0.0	0.0	149.0	0.0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO	LENGTH	FR-TO			
A-B	-391 0	-91.8 -91.8	0.34 (1)	6.25	E-B	-161 36	0.07 (1)
B-C	-391 0	-91.8 -91.8	0.39 (1)	6.25	A-E	0 382	0.09 (1)
F-A	-576 0	0.0 0.0	0.08 (1)	7.81	E-C	0 -374	0.08 (1)
D-C	-572 0	0.0 0.0	0.07 (1)	7.81			
F-E	0 0	-18.5 -18.5	0.16 (4)	10.00			
E-D	0 0	-18.5 -18.5	0.16 (4)	10.00			

TOTAL WEIGHT = 45 lb

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	8.0	PSF
BOY CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	39.0	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBCC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.37")
CALCULATED VERT. DEFL. (LL) = L/999 (0.01")
ALLOWABLE DEFL. (TL) = L/360 (0.37")
CALCULATED VERT. DEFL. (TL) = L/999 (0.03")

CSI: TC=0.39/1.00 (B-C:1), BC=0.16/1.00 (E-F:4), WB=0.09/1.00 (A-E:1), SS=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.60 (A) (INPUT = 0.90)
JSI METAL = 0.19 (C) (INPUT = 1.00)

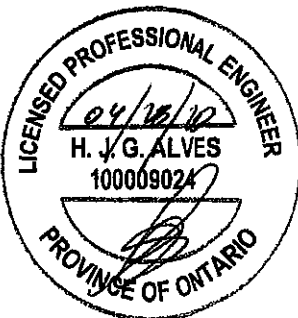

Structural component only
DWG# T-2007728

Tamarack Roof Truss, Burlington



CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	T44	1	2	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 08:54:47 2020 Page 2
ID:DMCubINVR6TstF0e31v6l zns1l-hM1QBby Q7aE1aIcBkmRPYR5asppjXYs7SF6pzMVM

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
F BMV1+p	MT20	3.0	6.0	3.50	1.50



Structural component only
DWG# T-2007729 1/2

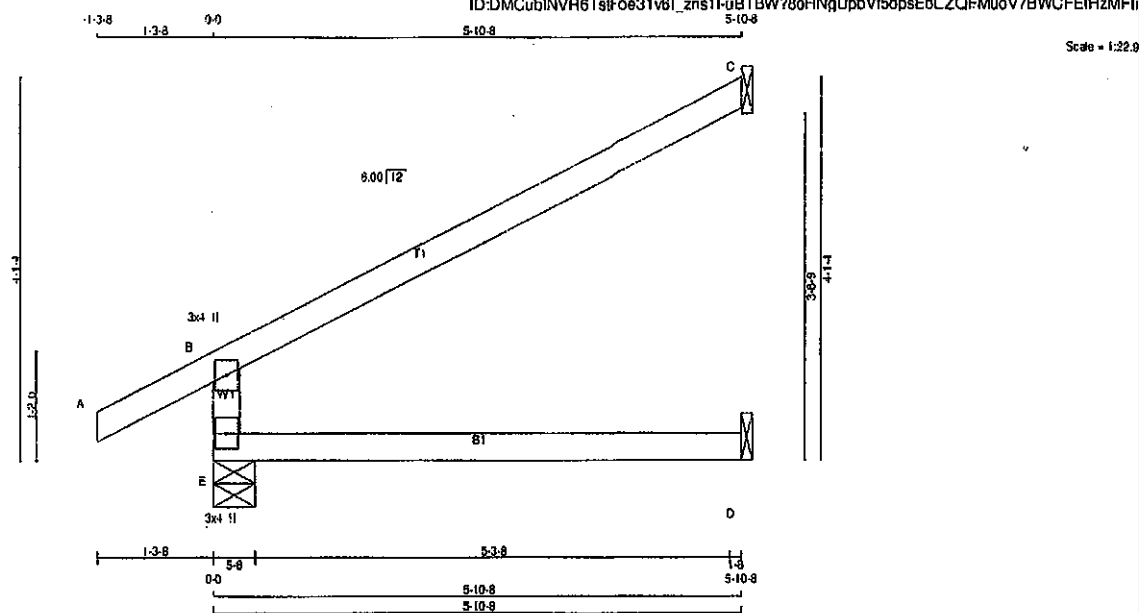

TOTAL WEIGHT = 21 X 17 = 353 lb

LUMBER			
N. L. G. A. RULE			
CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF

DRY, SEASONED LUMBER.

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JTB	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	RECORD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	525	0	525	0	5-8	5-8
C	202	0	202	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C.D.

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	369	257 0	0 0	0 0	0 0	111 0	0 0
C	139	113 0	0 0	0 0	0 0	26 0	0 0
D	36	0 0	0 0	0 0	0 0	36 0	0 0

BEARING MATERIAL TO BE SPE NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

LOADING
TOTAL LOAD CASES: 141

CHORDS				WEBBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD LCI (PLF)	MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO		
E-B	-161 0	0.0	0.0	0.13 (4)			7.81
A-B	0 23	-91.8	-91.8	0.12 (1)		10.00	
B-C	-30 0	-91.8	-91.8	0.54 (1)		6.25	
E-D	0 0	-18.5	-18.5	0.13 (4)		10.00	

DESIGN CRITERIA

SPECIFIED LOADS:

SPECIFIED LOADS.				
TOP	CH.	LL	=	25.8 PSF
		DL	=	6.0 PSF
BOT	CH.	LL	=	0.0 PSF
		DL	=	7.3 PSF
TOTAL LOAD			=	39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9.
NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2010 , OBC 2012 , ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 088-09, CSA 088-14
 - TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS

DESIGN ASSUMPTIONS
-OVERHANG NOT TO BE ALTERED OR CUT OFF.

55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN
LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF
LIVE LOAD

ALLOWABLE DEFL.(LL) = 1.360 (0.20")
CALCULATED VERT. DEFL.(LL) = 1.999 (0.00")
ALLOWABLE DEFL.(TL) = 1.380 (0.20")
CALCULATED VERT. DEFL.(TL) = 1.999 (0.03")

CSI: TC=0.54/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (nao), SSJ=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER


RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES					
PLATE	GRIP(DRY)		SHEAR		SECTION
	(PSI)		(PL)		(PL)
	MAX	MIN	MAX	MIN	MAX MIN
MT20	618	354	1667	788	1987 1856

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI MÉTAL= 0.13 (B) (INPUT = 1.00)

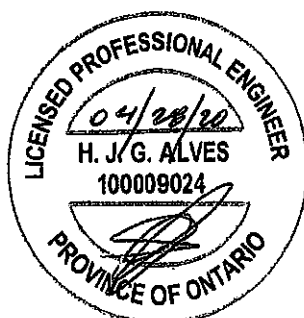

Structural component only
DWG# T-2007598

JOB NAME 408266	TRUSS NAME J2S	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	ORWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

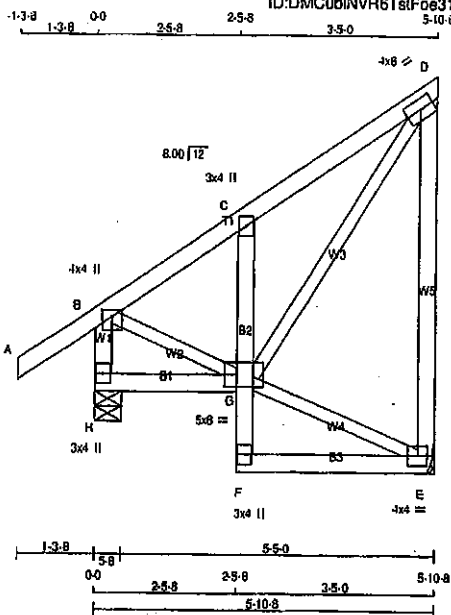

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
H - B	2x4	DRY	No.2	SPF
A - D	2x4	DRY	No.2	SPF
H - G	2x4	DRY	No.2	SPF
F - C	2x4	DRY	No.2	SPF
F - E	2x4	DRY	No.2	SPF
ALL WEBS EXCEPT E - D	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
C	TMV+p	MT20	3.0	4.0	
D	TMVW-i	MT20	4.0	6.0	2.00 2.75
E	BMVW-i	MT20	4.0	4.0	
F	BMV+p	MT20	3.0	4.0	
G	BMVW-i	MT20	5.0	8.0	2.50 2.50
H	BMV-i+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
JT	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
H	442 0	442 0	0 0	5-8	5-8
E	316 0	316 0	0 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
H	310	217 0	0 0	0 0	0 0	0 0	93 0	0 0
E	223	147 0	0 0	0 0	0 0	0 0	77 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	CS (LC)	
H-B	-418 0	0.0	0.0 0.04 (1)	H-B	0 211	0.05 (1)	
A-B	0 35	-91.8	-91.8 0.12 (1)	E-D	-282 0	0.14 (1)	
B-C	-215 0	-91.8	-91.8 0.12 (1)	G-E	-12 0	0.00 (1)	
C-D	-232 0	-91.8	-91.8 0.12 (1)	G-D	0 335	0.08 (1)	
H-G	0 0	-18.5	-18.5 0.04 (4)				
F-G	0 32	0.0	0.0 0.02 (1)				
G-C	-316 0	0.0	0.0 0.02 (1)				
F-E	0 11	-18.5	-18.5 0.05 (4)				

TOTAL WEIGHT = 2 X 38 = 76 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 38.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/889 (0.01")

CSI: TC=0.12/1.00 (A-B:1), BC=0.05/1.00 (E-F:4), WB=0.14/1.00 (D-E:1), SS=0.11/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1967 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.29 (B) (INPUT = 0.90)
JSI METAL= 0.10 (C) (INPUT = 1.00)




Structural component only
DWG# T-2007682

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	J3	2	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 MTEK Industries, Inc. Tue Apr 28 09:25:55 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns11-09NlgNxZJrs_FPIK7_jHDiBuhkUuKrws_hTrCzMEwC

Scale = 1:25.8

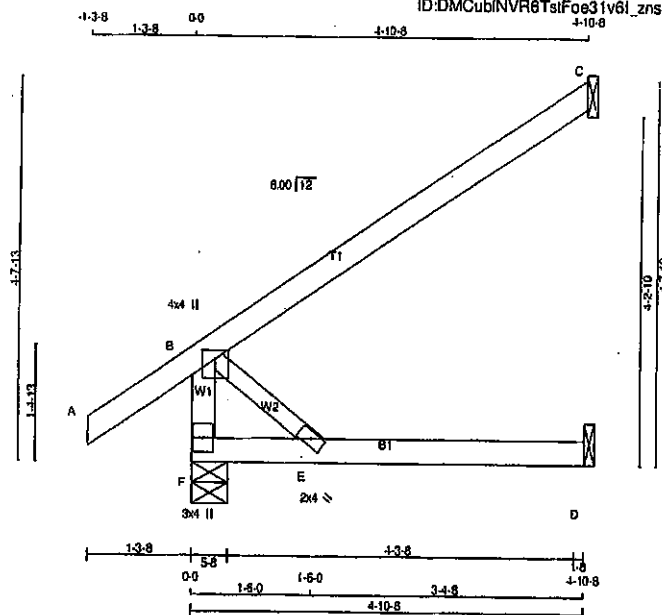

LUMBER	DESCR.
N. L. G. A. RULES	
CHORDS	SIZE
F - B	2x4 DRY No.2
A - C	2x4 DRY No.2
F - D	2x4 DRY No.2
ALL WEBS	2x3 DRY No.2
DRY: SEASONED LUMBER.	

PLATES (table is in inches)	W	LEN	Y	X
JT TYPE	PLATES			
B TMVW+p	MT20	4.0	4.0	1.25 2.00
E BMVW+p	MT20	2.0	4.0	
F BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQ'D
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	DOWN	UP	IN-SX
F	395	0	0	5-8
C	224	0	0	1-8
D	45	0	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS	1ST LCASE	MAX. MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM. LIVE WIND DEAD SOIL
F	277	195 / 0 0 / 0 0 / 0 0 / 0 82 / 0 0 / 0
C	154	125 / 0 0 / 0 0 / 0 0 / 0 29 / 0 0 / 0
D	38	0 / 0 0 / 0 0 / 0 0 / 0 36 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING	CHORDS	WEBS
TOTAL LOAD CASES: (4)	MAX. FACTORED	MAX. FACTORED
	MEMB. FORCE (LBS)	MEMB. FORCE (LBS)
FR-TO	FROM TO	FROM TO
F-B	-350 / 0 0.0 0.0 0.04 (1)	7.81 B-E 0 0 0.00 (1)
A-B	0 35 -91.8 -91.8 0.12 (1)	10.00
B-C	0 0 -91.8 -91.8 0.37 (1)	10.00
F-E	0 0 -18.5 -18.5 0.11 (4)	10.00
E-D	0 0 -18.5 -18.5 0.13 (4)	10.00

TOTAL WEIGHT = 2 X 17 = 33 lb

DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN./C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-08, CSA 086-14
- TPIC 2011, TPIC 2014

155% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TO=0.37/1.00 (B-C:1), BC=0.13/1.00 (D-E:1), WB=0.00/1.00 (B-E:1), SSI=0.15/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1667 788 1987 1856

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.24 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007683

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	J4	6	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 28 2019 Mitek Industries, Inc. Tue Apr 28 09:25:58 2020 Page 1
ID:DMCubINVR6TstFoe31v6l_zns1f-sLx1u1yC49arsZiWhDWWFL243_dn544eR0CezMEwP

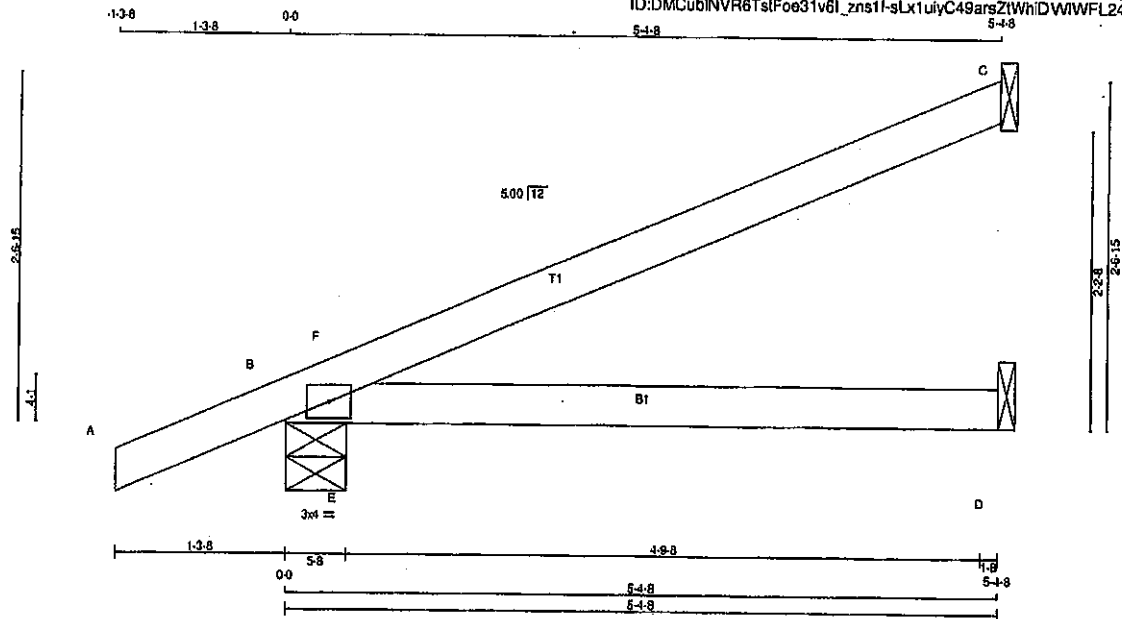

Scale = 1:15.7

LUMBER	CHORDS	SIZE	DRY	LUMBER	DESCR.
N. L. G. A. RULES	A - C	2x4	DRY	No.2	SPF
	B - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-1	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX	IN-SX	IN-SX
C	216	0	216	0	1-8	1-8	1-8	1-8
B	420	0	420	0	5-8	5-8	5-8	5-8
D	81	0	81	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	149	118.0	0.0	0.0	0.0	33.0	0.0
B	295	208.0	0.0	0.0	0.0	88.0	0.0
D	60	21.0	0.0	0.0	0.0	39.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. FORCE (LBS)	VERT. LOAD (PLF)
FR-TO								
A-B	0.23	-91.8	-91.8	0.12 (1)	10.00			
B-F	-22.38	-91.8	-91.8	0.06 (1)	6.25			
F-C	-3.2	-91.8	-91.8	0.34 (1)	10.00			
B-E	0.0	-18.5	-18.5	0.24 (1)	10.00			
E-D	0.0	-18.5	-18.5	0.24 (1)	10.00			

TOTAL WEIGHT = 6 X 15 = 87 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C.C.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2015
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPI 2011, TPI 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.05")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/641 (0.10")

CSI: TC=0.34/1.00 (C-F:1), BC=0.24/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.28/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION (PSI) (PL) (FL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1667 768 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.31 (B) (INPUT = 0.90)
JSI METAL = 0.08 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007684

JOB NAME 408267	TRUSS NAME J20	QUANTITY 5	PLY 1	JOB DESC. GREEN PARK HOMES	TRUSS DESC.	DRWG NO.
--------------------	-------------------	---------------	----------	-------------------------------	-------------	----------

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:31:37 2020 Page 1
ID:DMCubINVR6TstFoe31v8I_zns11-Nx2ySJ45mwYSGzS2ApqU4QbFYTk1?VGVbXysNzMEr4

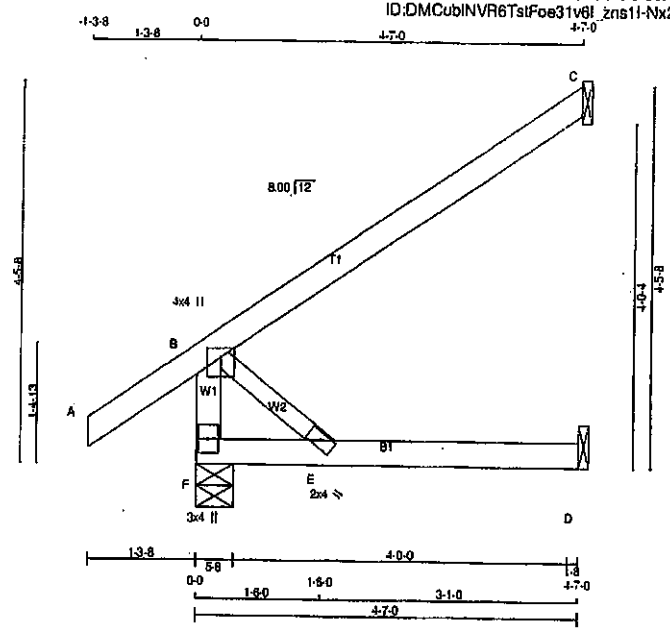

Scale = 1:24.8

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2

DRY: SEASONED LUMBER.

PLATES (tablets in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVH+p	MT20	4.0	4.0	1.25	2.00
E	BMVH+p	MT20	2.0	4.0		
F	BMVH+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT		REQ'D	
	VERT	HORZ	DOWN	HORZ	BRG	IN-SX	BRG	IN-SX
F	379	0	379	0	5-8	5-8	5-8	5-8
C	210	0	210	0	1-8	1-8	1-8	1-8
D	42	0	47	0	1-8	1-8	1-8	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
F	265	187.0	0.0	0.0	0.0	78.0	0.0
C	145	117.0	0.0	0.0	0.0	28.0	0.0
D	34	0.0	0.0	0.0	0.0	34.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PL)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	UNBRACED LENGTH FR-TO
F-B	-336	0	0.0	0.0	0.03 (1)	7.81	7.81
A-B	0	35	-91.8	-91.8	0.12 (1)	10.00	10.00
B-C	0	0	-91.8	-91.8	0.33 (1)	10.00	10.00
F-E	0	0	-18.5	-18.5	0.10 (4)	10.00	10.00
E-D	0	0	-18.5	-18.5	0.11 (4)	10.00	10.00

TOTAL WEIGHT = 5 X 16 = 80 LB

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	DL
LL	25.8	PSF
DL	6.0	PSF

BOT CH.

LL	DL
LL	0.0
DL	7.4

TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.18")
CALCULATED VERT. DEFL. (LL) = $L/899$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.02")

CSI: TC=0.33/1.00 (B-C:1), BC=0.11/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP = 0.23 (B) (INPUT = 0.90)
JSI METAL = 0.07 (B) (INPUT = 1.00)

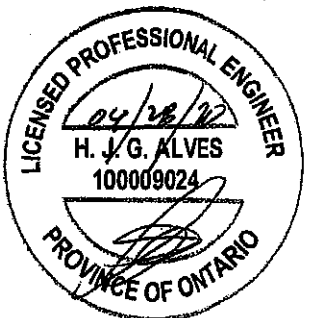

Structural component only
DWG# T-2007698

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408267	J21	3	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:31:38 2020 Page 1
ID:DMCubINVR6TstF0e31v6l_zns11-r6bKI5jXEGJu61FjXlJcePr5yqBmSIPjH6OqzMER3

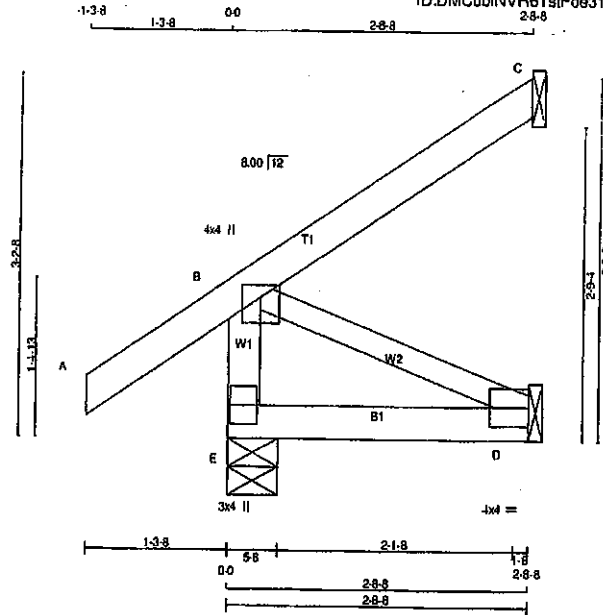

Scale = 1:18.0

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)					
JT TYPE	PLATES	W	LEN	Y	X
B	TMWV-p	MT20	4.0	4.0	1.25 2.00
D	BMW1-1	MT20	4.0	4.0	2.00 Edge
E	BMV1-p	MT20	3.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		RECORD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	274	0	274	0	0	5-8	5-8	
C	124	0	124	0	0	1-8	1-8	
D	24	0	27	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE		MAX. MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE			
E	191	140.0	0.0	0.0	0.0	52.0	0.0
C	88	68.0	0.0	0.0	0.0	16.0	0.0
D	19	0.0	0.0	0.0	0.0	19.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	MAX. FORCE (LBS)	MAX. FORCE (LBS)	MAX. FORCE (LBS)	MAX. FORCE (LBS)	MAX. FORCE (LBS)	MAX. FORCE (LBS)
FR-TO								
E-B	-250	0	0.0	0.0	0.03 (1)	7.81	0.0	0.00 (1)
A-B	0	35	-91.8	-91.8	0.13 (5)	10.00		
B-C	0	0	-91.8	-91.8	0.11 (1)	10.00		
E-D	0	0	-18.5	-18.5	0.04 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.04/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SS=0.09/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX	MIN	MAX
MT20	618	354	1667

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)

JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007699

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 MiTek Industries, Inc. Tue Apr 26 09:54:27 2020 Page 1


ID:DMCubINV6TstFae31v6l_zns1l-GWqs mfS7s93eVBMQYPibKcnzo2l0ctwXKP2xzzMEVg

1-38 0.0



JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)


CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN



JOB NAME 408268	TRUSS NAME J31	QUANTITY 4	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.310 S Oct 29 2019 MITek Industries, Inc. Tue Apr 28 08:54:28 2020 Page 1	

ID:DMCubINVR6TstFoe31v6I_znst1i-kiNEB6g4uAHwFmY_Fw_8Y9zICPOI3v3I_8bTQzMEV

Scale = 1/20

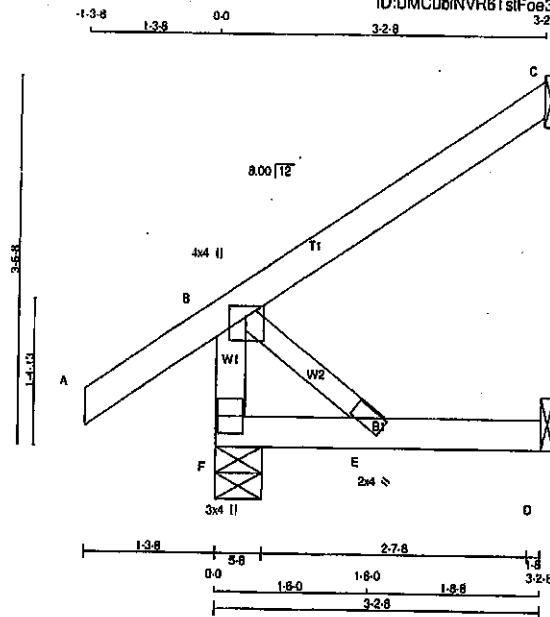

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW+p	MT20	4.0	4.0	1.25 2.00
E BMVW+w	MT20	2.0	4.0	
F BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT		VERT	HORZ	DOWN	HORZ
F	303	0	303	0	5-8
C	147	0	147	0	1-8
D	30	0	33	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS		1ST LCASE	MAX MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL	
F	212	152 / 0	0 / 0	0 / 0	0 / 0	59 / 0	0 / 0	
C	101	82 / 0	0 / 0	0 / 0	0 / 0	19 / 0	0 / 0	
D	24	0 / 0	0 / 0	0 / 0	0 / 0	24 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (5)

CHORDS		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)	MAX. FACTORED VERT. LOAD (LBS)
MEMB.								
FR-TO								
F-B	-273.0	0.0	0.0	0.03 (1)	7.81	0.0	0.00 (1)	
A-B	0.35	-91.8	-91.8	0.13 (5)	10.00	0.0	0.00 (1)	
B-C	0.0	-91.8	-91.8	0.16 (1)	10.00	0.0	0.00 (1)	
F-E	0.0	-18.5	-18.5	0.06 (4)	10.00	0.0	0.00 (1)	
E-D	0.0	-18.5	-18.5	0.06 (4)	10.00	0.0	0.00 (1)	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 4 X 12 = 50 LB

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.18")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.18")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.18/1.00 (B-C:1) , BC=0.06/1.00 (D-E:4) , WB=0.00/1.00 (B-E:1) , SSI=0.10/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.19 (B) (INPUT = 0.90)
JSI METAL = 0.06 (B) (INPUT = 1.00)




Structural component only
DWG# T-2007712

Version 8.310 S Oct 29 2019 MTek Industries, Inc. Tue Apr 28 09:25:47 2020 Page 1



JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)




JOB NAME 408266	TRUSS NAME C2	QUANTITY 2	PLY 1	JOB DESC. GREEN PARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.310 5 Oct 2019 Mitek Industries, Inc. Tue Apr 28 08:25:48 2020 Page 1

ID:DMCubINVR8TstFoe31v6l_zns1l-5o50CzsAyzvKQ_D03eRqw2WslmAGuFOVb86zMEwX

4-10-8

Scale = 1:15.8

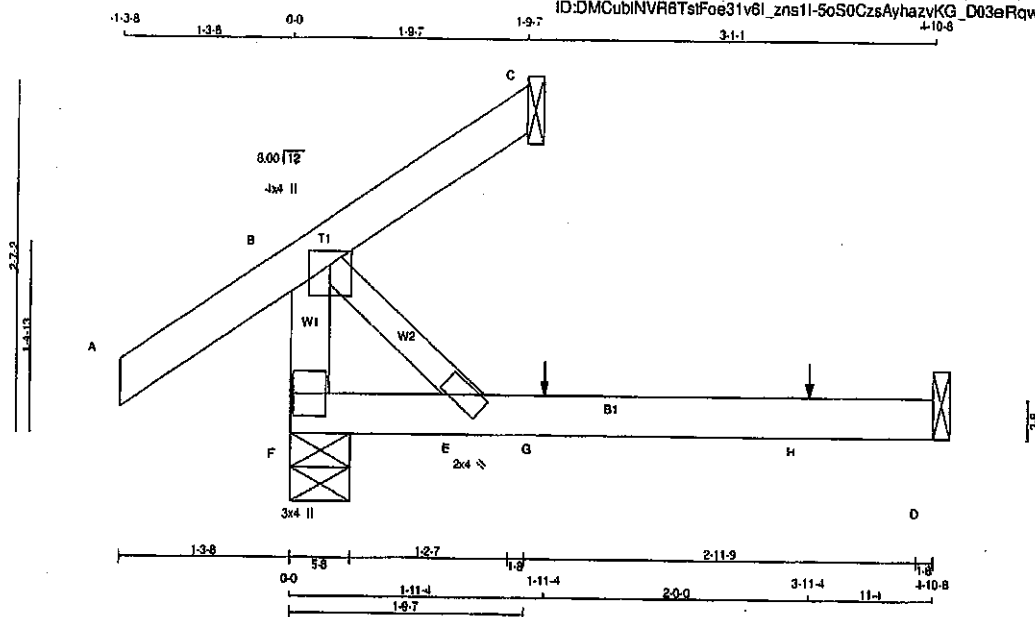

TOTAL WEIGHT = 2 X 12 = 25 lb

LUMBER			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER
F - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
F - D	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS			
FACTORED	MAXIMUM FACTORED	INPUT	RECORD
GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	UPLIFT	IN-SX
F 301 0	301 0	0 0	5-8
C 34 0	34 0	0 0	1-8
D 45 0	51 0	0 0	1-8

SEE MITEK STANDARD DETAIL B87791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS			
1ST LCASE	MAX. MIN. COMPONENT REACTIONS		
JT COMBINED	SNOW	LIVE	PERM. LIVE
F 213	143 0	0 0	0 0
C 213	19 0	0 0	0 0
D 38	0 0	0 0	0 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)
FR-TO		FROM TO	LENGTH
F-B	-258 0	0.0 0.0	0.03 (1)
A-B	0 35	-91.8 -91.8	0.12 (1)
B-C	-27 0	-91.8 -91.8	0.12 (1)
F-E	0 0	-18.5 -18.5	0.10 (4)
E-G	0 0	-18.5 -18.5	0.13 (4)
G-H	0 0	-18.5 -18.5	0.13 (4)
H-D	0 0	-18.5 -18.5	0.13 (4)

FACTORED CONCENTRATED LOADS (LBS)			
JT	LOC.	LC1	MAX. MAX+
G	1-11-4	1	---
H	3-11-4	1	---

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. OC

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCAC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.12/1.00 (A-B:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1658

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) INPUT = 0.90
JSI METAL= 0.05 (B) INPUT = 1.00




Structural component only
DWG# T-2007677

Structural component only
DWG# T-2007678

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408266	C4	3	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 5 Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:25:50 2020 Page 1
ID:DMCubNVR6TsiFog31v8l_zns11-2BamdfrUJqh8eQMLR66WF7O0q33D3cBil_JA7zMEwV

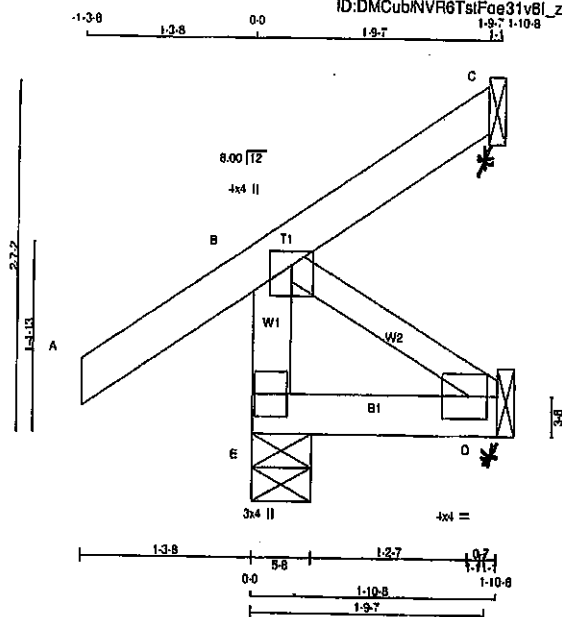

TOTAL WEIGHT = 3 X 9 = 28 lb

LUMBER
N. L. & A. RULES

CHORDS	SIZE	LUMBER
E - B	2x4 DRY	No.2
A - C	2x4 DRY	No.2
E - D	2x4 DRY	No.2

ALL WEBS 2x3 DRY SEASONED LUMBER.

DESCR.
SPF
SPF
SPF

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECORD BRG
E	273	273	5-8	5-8
C	33	33	1-8	1-8
D	16	16	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LOASE	MAX. MIN. COMPONENT REACTIONS
E	190	143.0 0.0 0.0 0.0 47.0 0.0
C	23	19.27 0.0 0.0 0.0 4.0 0.0
D	13	0.0 0.0 0.0 0.0 13.0 0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1	MAX. LC2	MAX. UNBRACED LENGTH	WEBS MEMB. MAX. FACTORED FORCE (LBS)	MAX. LC1
E-B	-256	0	0.0	0.0	0.03 (1)	0	0.00 (1)
A-B	0	35	-91.8	-91.8	0.12 (1)	0	0.00 (1)
B-C	-27	0	-91.8	-91.8	0.12 (1)	0	0.00 (1)
E-D	0	0	-18.5	-18.5	0.02 (4)	0	0.00 (1)

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 8.0 PSF
BOT CH. LL = 8.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL) = L/360 (0.10")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (B-D:1), SS=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.90)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007679

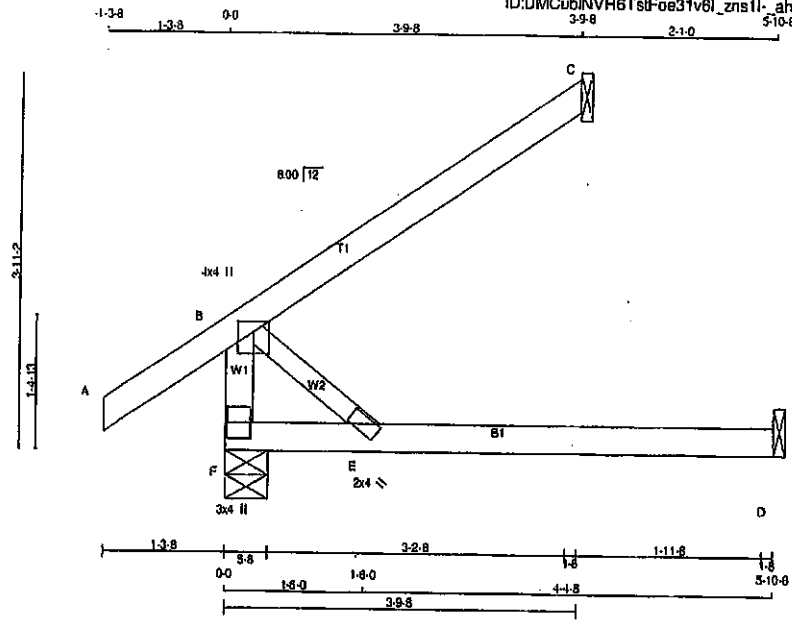

Scale = 1:22.5

TOTAL WEIGHT = 16 lb [M]

LUMBER

N.L.G.A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQD BRG IN-SX
	VERT	HORZ	DOWN	HORZ UPLIFT		
F	354	0	354	0	5-8	5-8
C	174	0	174	0	1-8	1-8
D	54	0	51	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE COMBINED	MAX. MIN. COMPONENT REACTIONS				
		SNOW	LIVE	PERM. LIVE	WIND	DEAD
F	250	167.0	0.0	0.0	0.0	63.0
C	120	97.0	0.0	0.0	0.0	23.0
D	43	0.0	0.0	0.0	0.0	43.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB. MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO		
F-B	-300.0	0.0 0.0 0.03 (1)	7.81	B-E	0.0	0.00 (1)
A-B	0.35	-91.8 -91.8 0.12 (1)	10.00			
B-C	0.0	-91.8 -91.8 0.22 (1)	10.00			
F-E	0.0	-18.5 -18.5 0.14 (4)	10.00			
E-D	0.0	-18.5 -18.5 0.19 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NSCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (LL) = $L/999$ (0.00")
ALLOWABLE DEFL. (TL) = $L/360$ (0.20")
CALCULATED VERT. DEFL. (TL) = $L/999$ (0.05")

CSI: TC=0.22/1.00 (B-C:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.11/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1697 768 1987 1658


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.21 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007680

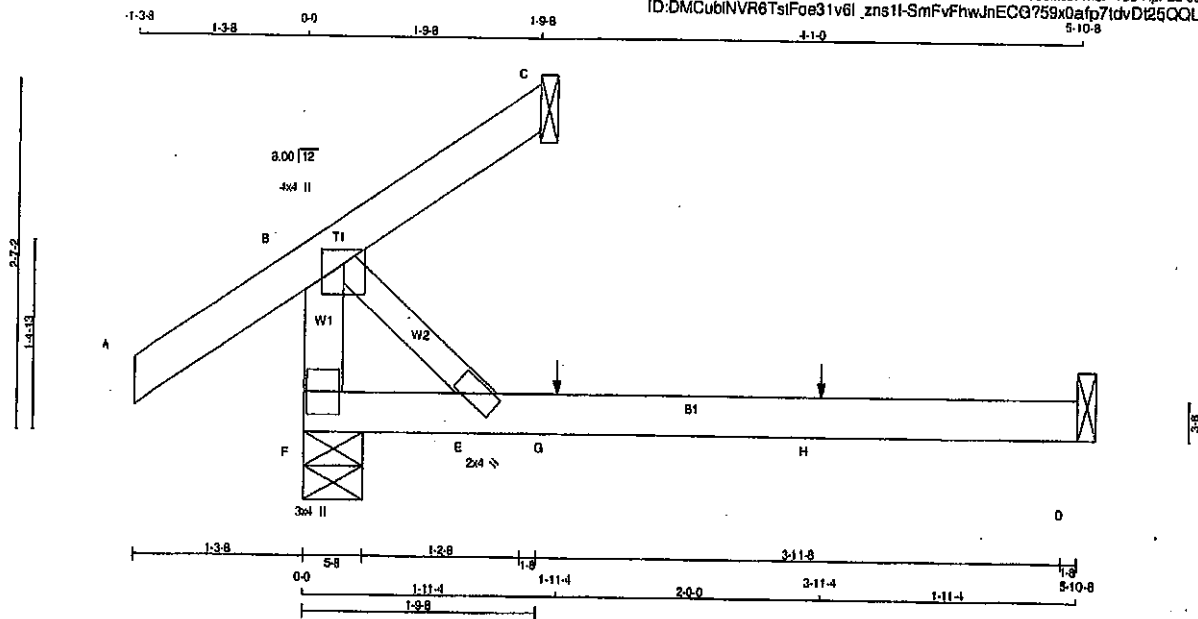

Scale = 1:15.8

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
F - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMW+p	MT20	4.0	4.0	1.25	2.00
E	BMW+w	MT20	2.0	4.0		
F	BMV+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
F	311	0	311	0	5-8	5-8
C	34	0	34	0	1-8	1-8
D	54	0	54	0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE		MAX. MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
F	220	143.0	0.0	0.0	0.0	77.0	0.0
C	23	19.0	0.0	0.0	0.0	4.0	0.0
D	43	0.0	0.0	0.0	0.0	43.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS					WEBS				
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LOC1 MAX CSI (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FORCE (LBS)	FACTORED MAX CSI (LC)		
FR-TO		FROM	TO		FR-TO				
F-B	-256.0	0.0	0.0	0.03 (1)	7.81	B-E	0.00 (1)		
A-B	0.35	-91.8	-91.8	0.13 (1)	10.00				
B-C	-27.0	-91.8	-91.8	0.12 (1)	6.25				
F-E	0.0	-18.5	-18.5	0.13 (4)	10.00				
E-G	0.0	-18.5	-18.5	0.19 (4)	10.00				
G-H	0.0	-18.5	-18.5	0.19 (4)	10.00				
H-D	0.0	-18.5	-18.5	0.19 (4)	10.00				

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-11.4	1	1	---	BACK	VERT	TOTAL	---	C1
H	3-11.4	1	1	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF NBC 2010, NBC 2012, ABC 2019
- PART 9 OF NBC 2012 (2019 AMENDMENT)
- CSA 088-08, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.20")
CALCULATED VERT. DEFL. (LL) = U/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.20")
CALCULATED VERT. DEFL. (TL) = U/999 (0.05")

CS: TC=0.13/1.00 (A-B:1), BC=0.19/1.00 (D-E:4), WB=0.00/1.00 (B-E:1), SS=0.09/1.00 (B-C:1)

DOL LUMBER=0.98 NAIL=0.98 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP (DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	618	354	1687 788 1987 1856


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.18 (B) (INPUT = 0.80)
JSI METAL = 0.05 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007681

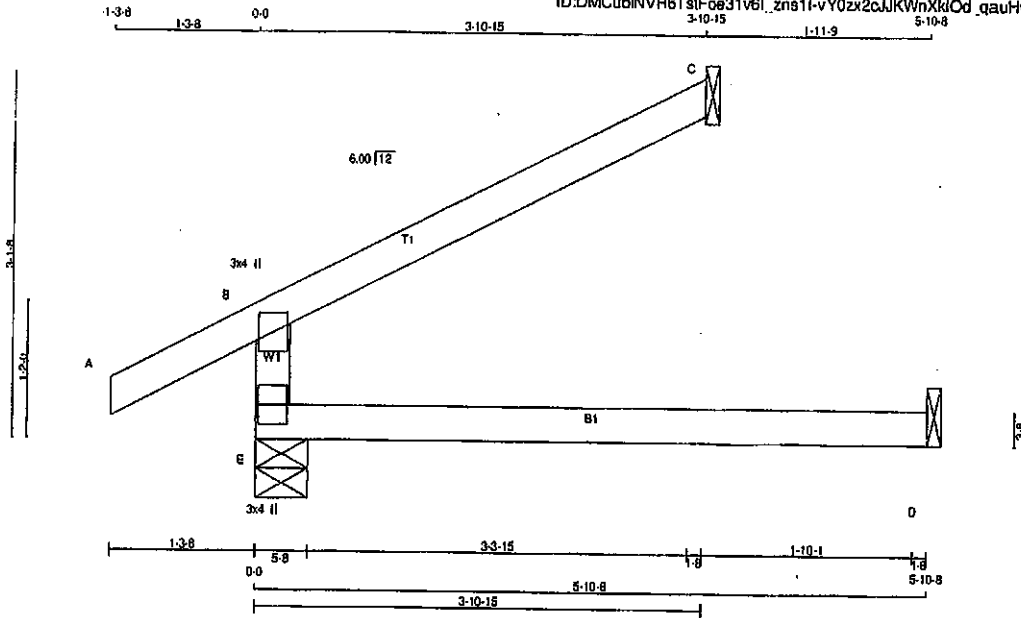

LUMBER

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	412 0	412 0	5-8	5-8
C	135 0	135 0	1-8	1-8
D	45 0	50 0	1-8	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	291	194 / 0	0 / 0	0 / 0	0 / 0	97 / 0	0 / 0
C	93	75 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0
D	38	0 / 0	0 / 0	0 / 0	0 / 0	38 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PL)	MAX. FORCE (LBS)	VERT. LOAD (PL)	MAX. FORCE (LBS)	VERT. LOAD (PL)	MAX. FORCE (LBS)	VERT. LOAD (PL)
FR-TO								
E-B	-349 0	0.0	0.0	0.13 (4)	7.81			
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00			
B-C	-20 0	-91.8	-91.8	0.24 (1)	6.25			
E-D	0 0	-18.5	-18.5	0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
DL = 8.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
OVERHANG NOT TO BE ALTERED OR CUT OFF.

65% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL) = L/380 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.24/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (A-B:0), SSI=0.18/1.00 (B-C:1)

DCL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656


PLATE PLACEMENT TOL = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.15 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)



Tamarack Roof Truss, Burlington

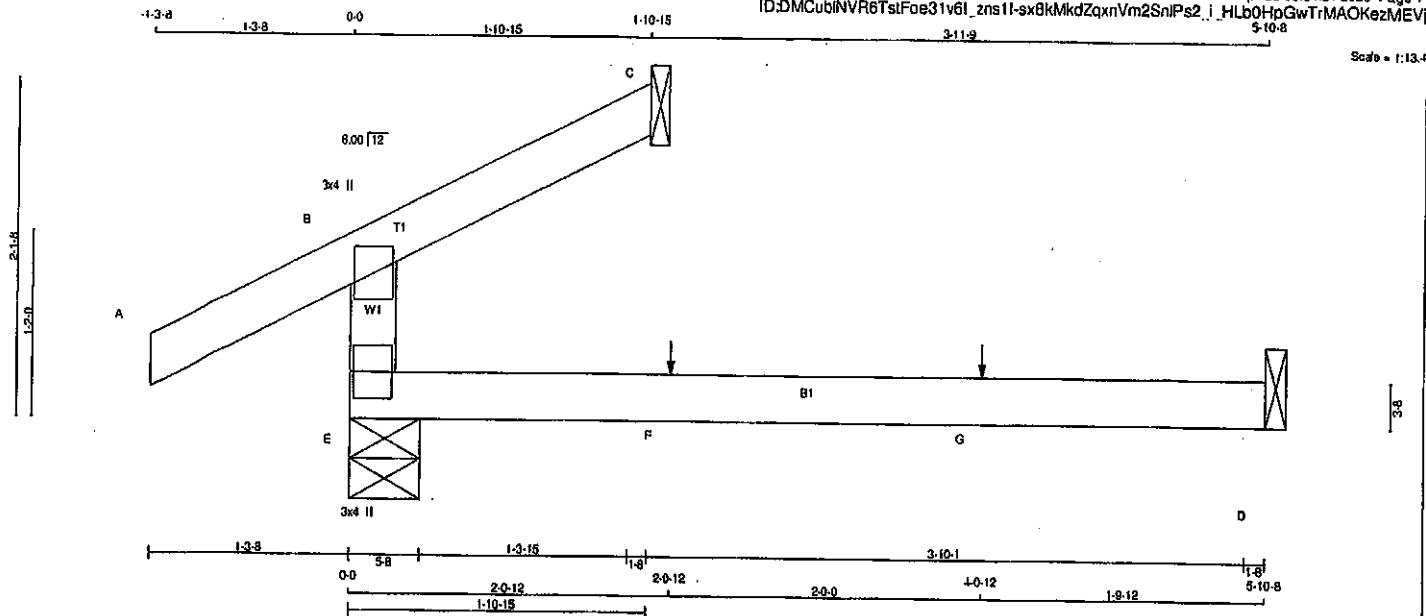

PLATES (tablets in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+g	MT20	3.0	4.0	

FACTORED		MAXIMUM FACTORED		INPUT	RECORD
JY	GROSS REACTION	GROSS REACTION	DOWN	BRG	BRG
E	VERT	HORZ	HORZ	UPLIFT	IN-SX
C	297	0	297	0	5-8
D	66	0	66	0	1-8
C	45	0	50	0	1-8

1ST CASE COMBINED		MAX. MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT	212	130' 0	0' 0	0' 0	0' 0	82' 0	0' 0
E	46	37' 0	0' 0	0' 0	0' 0	9' 0	0' 0
C	35	0' 0	0' 0	0' 0	0' 0	36' 0	0' 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E. C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBB			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LCI (L)	MAX. UNBRAC. CFI (L)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CFI (L)
FR-TO		FROM TO		LENGTH	FR-TO		
E-B	-234 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 28	-91.8	-91.8	0.12 (1)	10.00		
B-C	-10 0	-91.8	-91.8	0.06 (1)	10.00		
E-F	0 0	-18.5	-18.5	0.13 (4)	10.00		
F-G	0 0	-18.5	-18.5	0.13 (4)	10.00		
G-D	0 0	-18.5	-18.5	0.13 (4)	10.00		

FACTORED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN
F	2-0-12	1	1	--	FRONT	VERT	TOTAL	--	C1
G	4-0-12	1	1	--	FRONT	VERT	TOTAL	--	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	25.8	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD				= 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR
SMALL BUILDING REQUIREMENTS OF PART 9,
NBC 2010, NBC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, OBC 2012, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-09, CSA 086-14
- TPKC 2011, TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.20")
 CALCULATED VERT. DEFL.(LL) = $L \cdot 999$ (0.00")
 ALLOWABLE DEFL.(TL) = $L/360$ (0.20")
 CALCULATED VERT. DEFL.(TL) = $L \cdot 999$ (0.03")

CSI: TC=0.13/1.00 (B-E:4) , BC=0.13/1.00 (D-E:4) ,
WB=0.00/1.00 (na:0) , SS(-0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)		(PLI)		(PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	618	354	1667	788	1987	1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.06 (B) (INPUT = 1.00)

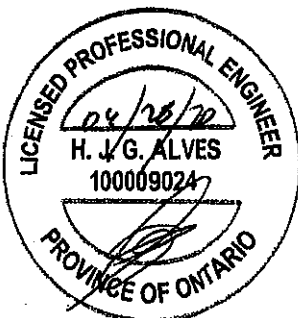


Structural component only
DWG# T-2007708

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREEN PARK HOMES	DRWG NO.
408268	C32	5	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.310 S Oct 29 2019 Mitek Industries, Inc. Tue Apr 28 09:54:25 2020 Page 1

ID:DMCubINVR6TsiFos31v8I_zns1I-K7ibZ4eBbFvMOB1zJ7NHvWvXRP?NHvYAd30wxs5zMEV

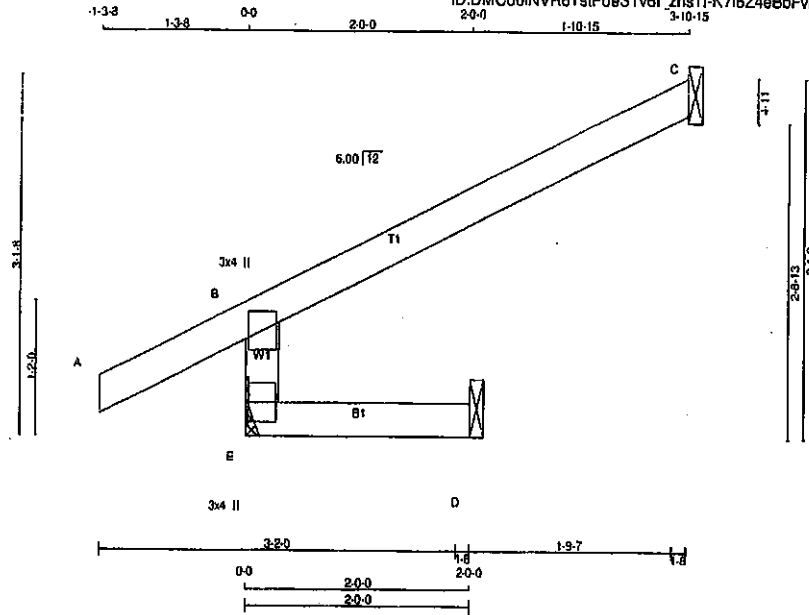

Scale = 1:18.5

LUMBER					
N. L. G. A. RULES					
CHORDS		SIZE	LUMBER		DESCR.
E - B	2x4	DRY	No.2		SPF
A - C	2x4	DRY	No.2		SPF
E - D	2x4	DRY	No.2		SPF
DRY: SEASONED LUMBER.					

DRY: SEASONED LUMBER.

PLATES (tablets in inches)	JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	389 0	389 0	MECHANICAL	
C	135 0	135 0	1-8	1-8
D	16 0	16 0	1-8	1-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 1-8.

SEE MITEK STANDARD DETAIL 897791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX. MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	258	194.0	0.0	0.0	0.0	0.0	62.0	0.0
C	93	75.0	0.0	0.0	0.0	0.0	18.0	0.0
D	13	0.0	0.0	0.0	0.0	0.0	13.0	0.0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (PLF)
FR-TO								
E-B		-349.0	0.0	0.0	0.01 (4)	7.81		
A-B		0.28	-91.8	-91.8	0.13 (5)	10.00		
B-C		-20.0	-91.8	-91.8	0.24 (1)	6.25		
E-D		0.0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 5 X 10 = 49 lb (M)

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.6 PSF
OL = 8.0 PSF
BOT CH. LL = 0.0 PSF
OL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPC 2011, TPC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.6 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL. (LL) = L/360 (0.19")
CALCULATED VERT. DEFL. (LL) = L/999 (0.00")
ALLOWABLE DEFL. (TL) = L/360 (0.19")
CALCULATED VERT. DEFL. (TL) = L/999 (0.00")

CSI: TC=0.24/1.00 (B-C:1), BC=0.02/1.00 (D-E:4),
WB=0.00/1.00 (m:a:0), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP (DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 818 354 1887 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.15 (E) (INPUT = 0.90)
JSI METAL = 0.10 (B) (INPUT = 1.00)



Structural component only
DWG# T-2007709

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
408268	C33	5	1	GREEN PARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

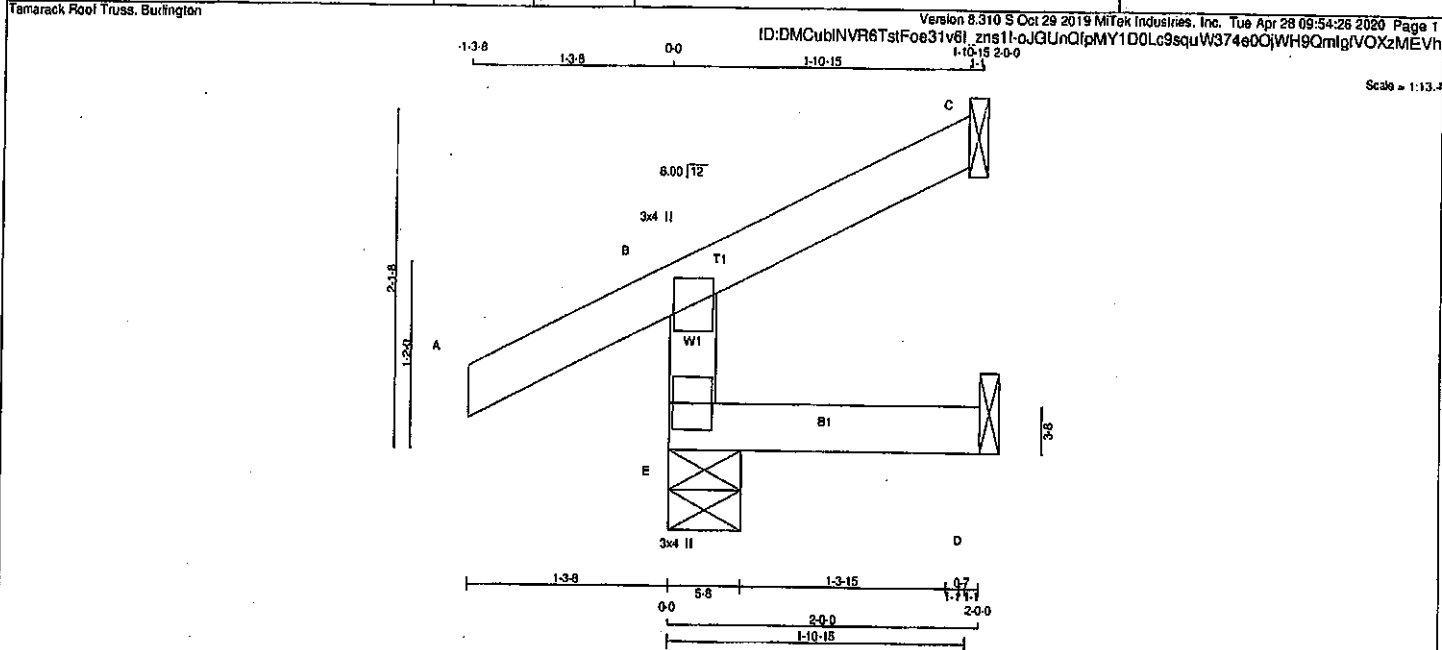

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			SPF
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y
B	TMV+p	MT20	3.0	4.0
E	BMV1+p	MT20	3.0	4.0

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED	MAXIMUM FACTORED	INPUT	RECORD
JT	GROSS REACTION	GROSS REACTION	DOWN	UP	BRG
E	254	0	254	0	5-8
C	68	0	68	0	1-8
D	18	0	18	0	1-8

SEE MITEK STANDARD DETAIL B97791H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	177	130.0	0.0	0.0	0.0	47.0	0.0
C	46	37.0	0.0	0.0	0.0	9.0	0.0
D	13	0.0	0.0	0.0	0.0	13.0	0.0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS	
MEMB.	MAX. FACTORED	VERT. LOAD	MAX. FACTORED	MEMB.	MAX. FACTORED
	(LBS)	(PLF)	CSI (LC)		(LBS)
FR-TO		FROM TO	LENGTH	FR-TO	
E-B	-234	0.0	0.0 (1)	7.81	
A-B	0	-91.8	-91.8 (1)	10.00	
B-C	-10	-91.8	-91.8 (1)	10.00	
E-D	0	-18.5	-18.5 (1)	10.00	

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

TOTAL WEIGHT = 6 X 7 = 37 lb

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 25.8 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 39.0 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2010, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, CBC 2012, ABC 2019
- PART 9 OF CBC 2012 (2019 AMENDMENT)
- CSA 088-09, CSA 088-14
- TPIC 2011, TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 31.3 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 25.8 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(LL) = $L/999$ (0.00")
ALLOWABLE DEFL.(TL) = $L/360$ (0.19")
CALCULATED VERT. DEFL.(TL) = $L/999$ (0.00")

CSI: TC = 0.12/1.00 (A-B:1), BC = 0.02/1.00 (D-E:4),
WB = 0.00/1.00 (na:0), SSI = 0.09/1.00 (A-B:1)

DOL LUMBER = 1.00 NAIL = 1.00 LS BEND = 1.10
COMP = 1.10 SHEAR = 1.10 TENS = 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PS) (PL) (PL)
MAX MIN MAX MIN MAX MIN
MT20 618 354 1687 788 1987 1656

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP = 0.10 (E) (INPUT = 0.90)
JSI METAL = 0.08 (E) (INPUT = 1.00)



Structural component only
DWG# T-2007710

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of
a) easier installation, b) higher capacities, c) lower installed
cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 258–259.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 20–24.

Installation:


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/4" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on p. 126.



Double-Shear
Nailing
Top View




Double-Shear
Nailing
Side View;
Do not
bend tab




Double-Shear
Nailing Side View
(available on
some models)


U.S. Patent 5,603,680

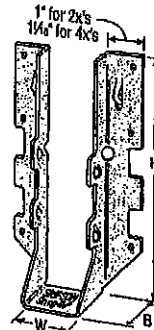


LUS28




LU26L

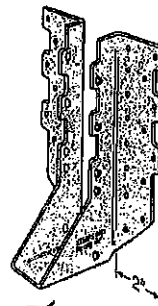


HUS210
(HUS26, HUS28,
and HHUS similar)



HGUS28-2




HHUS210-2



LJS26DS

Typical HUS26
Installation
with Reduced
Heel Height
(Truss Designer
to provide
fastener quantity
for connecting
multiple members
together)

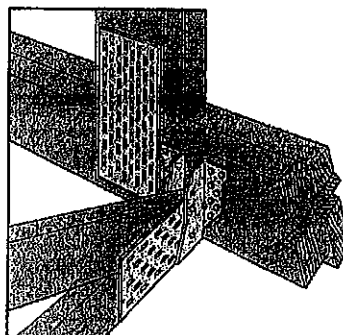

LUL/LUS/LJS/HUS/HHUS/HGUS**HHUS/HGUS**

See Hanger Options Information on pp. 125–127.



HHUS — Sloped and/or Skewed Seat

- HHUS hangers can be skewed to a maximum of 45° and/or sloped to a maximum of 45°
- For skew only, maximum factored down resistance is 0.85 of the table value
- For sloped only or sloped and skewed hangers, the maximum factored down resistance is 0.72 of the table value
- Uplift resistances for sloped/skewed conditions are 0.62 of the table value
- The joist must be bevel-cut to allow for double-shear nailing

HGUS — Skewed Seat

- HGUS hangers can be skewed only to a maximum of 45°. Factored resistances are:

HGUS Seat Width	Joist	Down Resistance	Uplift
$W < 2"$	Bevel or square cut	0.62 of table value	0.46 of table value
$2" < W < 6"$	Bevel cut	0.67 of table value	0.41 of table value
$2" < W < 6"$	Square cut	0.46 of table value	0.41 of table value
$W > 6"$	Bevel cut	0.75 of table value	0.41 of table value

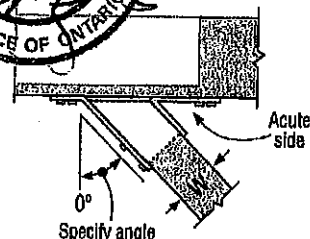

**Top View HHUS Hanger
Skewed Right**
(joist must be bevel cut)
All joist nails installed on the
outside angle (non-acute side).

Standard and Double-Shear Joist Hangers (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32–34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _g ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb.	(K _D = 1.00) lb.	(K _D = 1.15) lb.	(K _D = 1.00) lb.
Single 2x Sizes											
LUS24	18	1 9/16	3 1/8	1 1/4	2 1/4	(4) 10d	(2) 10d	710 3.16	1625 7.23	645 2.87	1155 5.14
LU24L	22	1 9/16	3	1 1/4	2 1/4	(4) 10d	(2) 10d x 1 1/2"	360 1.60	1020 4.54	320 1.42	725 3.22
LU26L	22	1 9/16	5	1 1/4	4 1/4	(6) 10d	(4) 10d x 1 1/2"	720 3.20	1605 7.14	645 2.87	1140 5.07
LUS26	18	1 9/16	4 1/4	1 1/4	3 3/4	(4) 10d	(4) 10d	1420 6.32	2170 9.65	1290 5.74	1630 7.25
HUS26	16	1 1/4	5 1/8	3	3 1/4	(14) 16d	(6) 16d	2705 11.90	4940 21.97	2065 9.20	3875 17.24
LJS26DS	18	1 9/16	5	3 1/2	4 1/4	(16) 16d	(6) 16d	2055 9.14	4265 18.97	1460 6.49	4115 18.31
HGUS26	12	1 1/4	5 1/8	5	4 1/4	(20) 16d	(8) 16d	2685 11.96	6625 29.51	2685 11.96	5700 25.35
LU28L	20	1 9/16	6 3/8	1 1/4	5 1/4	(8) 10d	(6) 10d x 1 1/2"	1140 5.07	2185 9.72	1020 4.54	1550 6.89
LUS28	18	1 9/16	6 1/4	1 1/4	3 3/4	(6) 10d	(4) 10d	1420 6.32	2520 11.21	1290 5.74	1790 7.96
HUS28	16	1 1/4	7 1/8	3	6 1/4	(22) 16d	(8) 16d	3605 16.04	6365 23.86	2675 11.90	4345 19.33
HGUS28	12	1 1/4	7 1/8	5	6 1/4	(36) 16d	(12) 16d	3310 14.74	7675 34.19	3310 14.74	6900 30.73
LU210L	20	1 9/16	8	1 1/4	7 1/4	(10) 10d	(6) 10d x 1 1/2"	1140 5.07	2495 11.10	1020 4.54	1770 7.87
LUS210	18	1 9/16	7 1/8	1 1/4	3 3/4	(8) 10d	(4) 10d	1420 6.32	2785 12.39	1290 5.74	2210 9.83

1. Factored uplift resistances have been increased 15% for wind or earthquake loading; no further increase is allowed.

2. Designer must ensure that hanger is compatible with truss when reduced heel height is used.

3. d_g is the distance from the bearing seat to the top joist nail.

4. Resistances shown require a minimum 2-ply girder truss. For fastening to single-ply truss request technical bulletin T-C-N10TRSSCN and/or see installation notes.

5. Nails: 16d = 0.162" dia. x 3 3/4" long. See pp. 27–28 for other nail sizes and information.

Face-Mount Hangers

SIMPSON


Strong-Tie

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance			
		W	H	B	d _o ³	Header	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
								(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN	(K _D = 1.15) lb. kN	(K _D = 1.00) lb. kN
Double 2x Sizes											
LUS24-2	18	3 1/8	3 1/8	2	1 1/8	(4) 16d	(2) 16d	835 3.71	2020 8.99	590 2.62	1435 6.38
LUS26-2	18	3 1/8	4 1/8	2	4	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.64
HHUS28-2	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2850 12.68	7335 32.63	2065 9.20	5205 23.15
HGUS28-2	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS28-2	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.76	8940 39.77	2675 11.90	6345 28.22
HGUS28-2	12	3 1/8	7 1/8	4	8 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HHUS210-2	14	3 1/8	9 1/8	3	8	(30) 16d	(10) 16d	4670 20.77	9660 42.97	4235 18.84	7000 31.14
HGUS210-2	12	3 1/8	9 1/8	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
Triple 2x Sizes											
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-3	12	4 1/8	7 1/4	4	6 3/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-3	14	4 1/8	9	3	7 1/8	(30) 16d	(10) 16d	4670 20.77	9670 43.02	4235 18.84	6865 30.54
HGUS210-3	12	4 1/8	9 1/4	4	8 3/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
Quadruple 2x Sizes											
HGUS28-4	12	6 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
HHUS210-4	14	6 1/8	8 3/8	3	7 3/8	(30) 16d	(10) 16d	4670 20.77	10155 45.17	4235 18.84	7210 32.07
HGUS210-4	12	6 1/8	9 3/8	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14645 65.14	4855 21.60	10400 46.26
HGUS212-4	12	6 1/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS214-4	12	8 1/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80
4x Sizes											
LUS46	18	3 1/8	4 1/8	2	3 1/8	(4) 16d	(4) 16d	1720 7.65	2595 11.54	1545 6.87	1920 8.64
HHUS46	14	3 1/8	5 1/8	3	3 1/8	(14) 16d	(6) 16d	2540 11.30	7335 32.83	2065 9.20	5205 23.15
HGUS46	12	3 1/8	5 1/8	4	4 1/8	(20) 16d	(8) 16d	4385 19.51	8950 39.81	3110 13.83	6355 28.27
LUS48	18	3 1/8	6 1/8	2	3 1/8	(6) 16d	(4) 16d	1720 7.65	3325 14.79	1545 6.87	2575 11.45
HHUS48	14	3 1/8	7 1/8	3	6 1/8	(22) 16d	(8) 16d	3765 16.76	8940 39.77	2675 11.90	6345 28.22
HGUS48	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070 27.00	12980 57.74	4310 19.17	9215 40.99
LUS410	18	3 1/8	8 1/8	2	5 1/8	(8) 16d	(6) 16d	2580 11.48	4500 20.02	2320 10.32	3195 14.21
HGUS410	12	3 1/8	9	4	8 1/8	(46) 16d	(16) 16d	6840 30.43	14015 62.34	4855 21.60	10270 45.69
HGUS412	12	3 1/8	10 1/8	4	10 1/8	(56) 16d	(20) 16d	7640 33.98	14995 66.70	5425 24.13	10645 47.35
HGUS414	12	3 1/8	12 1/8	4	11 1/8	(66) 16d	(22) 16d	10130 45.06	16400 72.95	7195 32.00	11645 51.80

See footnotes on p. 258.



Plated Truss Connectors

TC - Truss Connectors

SIMPSON
Strong-Tie

The TC truss connector is an ideal connector for scissor trusses and can allow horizontal movement up to 1/4". The TC also attaches plated trusses to top plates or sill plates to resist uplift forces. Typically used on one or both ends of truss as determined by the building designer.

Material: 16 gauge

Finish: G90 galvanized


Design: Factored resistances are in accordance with CSA 086-14

Installation:


- Use all specified fasteners.
- Nails: 10d = 0.148" dia. x 3" long common wire, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long.
- Drive 10d nails into the truss at the inside end of the slotted holes (inside end is towards the centre of the truss) and clinch on the back side. Do not seat these nails into the truss—allow room under the nail head for movement of the truss with respect to the wall.

Optional TC Installation:


- Bend one flange up 90°. Drive specified nails into the top and face of the top plates or install Titen® screws into the top and face of masonry wall. See optional load tables and installation details.

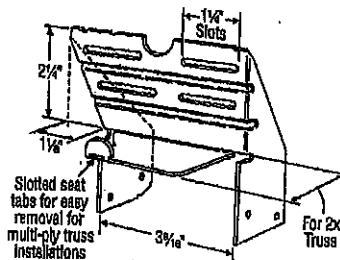


TC24
U.S. Patent 4,932,173

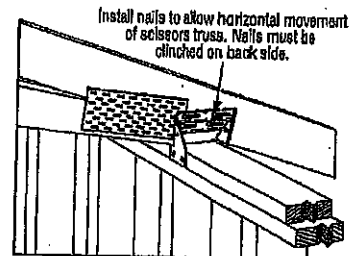


Typical TC24 Installation

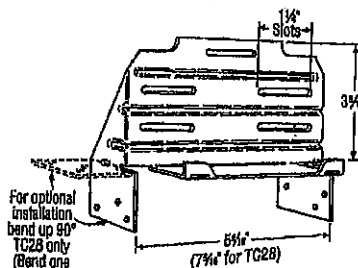

TC26
(TC28 Similar)

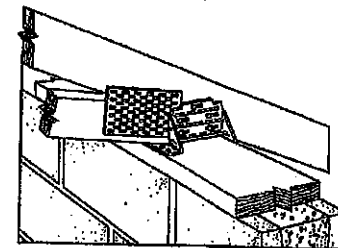

Optional TC26 Installation for Grouted Concrete Block using a Wood Nailer
(8", 10", 12" Wall Installation Similar)

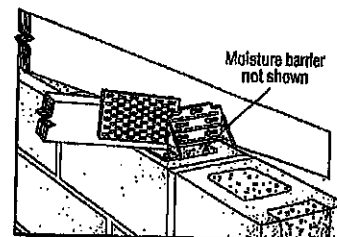

Optional TC26 Installation for Grouted Concrete Block using Titen® Screws

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC24	(4) 10d	(4) 10d	605	430
TC26	(5) 10d	(6) 10d	1015	720
TC28	(5) 10d	(6) 10d	1015	720

Optional TC Installation Table

Model No.	Fasteners		Factored Resistance	
	Truss	Wall Plates	D.Fir-L	S-P-F
			Uplift (K ₀ =1.15)	Uplift (K ₀ =1.15)
TC26	(5) 10d	(6) 10d x 1 1/2"	810	660
	(5) 10d	(6) 10d	930	660

1. Factored resistances have been increased 15% for earthquake or wind loading; no further increase allowed; reduce where other loads govern.

2. Grout strength is 15 MPa minimum.

3. Optional TC28 installation with 10d nails requires minimum 3" top plate thickness.

4. TC26 fastened to grouted concrete block with (6) - 3/8" x 2 1/4" Titen® screws has a factored uplift resistance of 275 lb.



MIT
SALES
DESIGN

For more information, visit us online at www.strongtie.com or call 1-800-999-5099. We are your one-stop source for all your construction needs.

© 2017 Simpson Strong-Tie Company

(800) 999-5099
strongtie.com

H/TSP

Seismic and Hurricane Ties (cont.)

These products are available with additional corrosion protection. For more information, see p. 24.

These products are approved for installation with the Strong-Drive® SD Connector screw. See pp. 32-34 for more information.

Model No.	Ga.	Fasteners			Factored Resistance ($K_D = 1.15$)					
					D.Fir-L			S-P-F		
		To Rafters/Truss	To Plates	To Studs	Uplift	Lateral		Uplift	Lateral	
						F ₁	F ₂		F ₁	F ₂
					lb.	lb.	lb.	lb.	lb.	lb.
					kN	kN	kN	kN	kN	kN
H1	18	(8) 8d x 1 1/2"	(4) 8d	—	740	685	300	680	485	215
					3.29	3.05	1.33	3.02	2.16	0.96
SS H2A	18	(5) 8d x 1 1/2"	(2) 8d x 1 1/2"	(5) 8d x 1 1/2"	830	220	75	590	155	55
					3.69	0.98	0.33	2.62	0.69	0.24
SS H2.5A	18	(5) 8d	(5) 8d	—	605	160	160	755	160	160
					3.68	0.71	0.71	3.36	0.71	0.71
H2.5T	18	(5) 8d	(5) 8d	—	835	175	210	740	160	210
					3.71	0.78	0.93	3.29	0.71	0.93
SS H3	18	(4) 8d	(4) 8d	—	740	180	285	615	125	190
					3.29	0.80	1.18	2.74	0.56	0.85
H6	16	—	(8) 8d	(8) 8d	1585	1085	—	1125	770	—
					7.05	4.83	—	5.00	3.43	—
H7Z	16	(4) 8d	(2) 8d	(8) 8d	1390	670	—	990	475	—
					6.18	2.98	—	4.40	2.11	—
SS H8 ²	18	(5) 10d x 1 1/2"	(5) 10d x 1 1/2"	—	1120	—	—	1025	—	—
					4.98	—	—	4.56	—	—
SS H10A ⁹	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1735	795	410	1505	565	290
					7.72	3.54	1.82	6.69	2.51	1.29
H10AR	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1485	690	430	1220	570	305
					6.61	3.07	1.91	5.43	2.54	1.36
H10A-2	18	(9) 10d x 1 1/2"	(9) 10d x 1 1/2"	—	1835	1275	430	1645	880	305
					8.16	5.67	1.91	7.32	3.91	1.36
H10S ^{7,2}	18	(8) 8d x 1 1/2"	(8) 8d x 1 1/2"	(8) 8d	1465	795	315	1040	565	225
					6.52	3.54	1.40	4.63	2.51	1.00
H11Z	18	(6) 16d x 2 1/2"	(6) 16d x 2 1/2"	—	1095	920	545	780	655	390
					4.87	4.09	2.42	3.47	2.91	1.73
H14	18	① (12) 8d x 1 1/2"	(13) 8d	—	2390	855	320	1805	810	230
					10.63	3.80	1.42	8.03	2.71	1.02
		② (12) 8d x 1 1/2"	(15) 8d	—	2390	855	320	1805	810	230
					10.63	3.80	1.42	8.03	2.71	1.02
TSP	16	(9) 10d x 1 1/2"	(6) 10d x 1 1/2"	—	1295	440	—	920	310	—
					5.76	1.96	—	4.09	1.38	—
		(9) 10d x 1 1/2"	(6) 10d	—	1560	440	—	1105	310	—
					6.94	1.96	—	4.92	1.38	—

- Factored resistances have been increased 15% for short term loading; no further increase is allowed.
- Factored resistances are for one anchor. A minimum rafter thickness of 2 1/2" must be used when framing anchors are installed on the same side of the plate (exception: H2.5A).
- H8 factored uplift resistances for stud-to-bottom plate installations are 595 lb. (2.65 kN) for D.Fir-L and 390 lb. (1.74 kN) for S-P-F.
- When cross-grain bending or cross-grain tension cannot be avoided, mechanical reinforcement to resist such forces should be considered.
- Hurricane ties are shown installed on the outside of the wall for clarity. Installation on the inside of the wall is acceptable. For a continuous load path, connections at the top and bottom of the wall must be on the same side of the wall (see technical bulletin T-HTIECONPATH).
- Factored resistances in the F₁ direction are not intended to replace diaphragm boundary members or prevent cross grain bending of the truss or rafter members. Additional shear transfer elements shall be considered where there may be effects of cross grain bending or tension.

- H10S can have the stud offset a maximum of 1" from the rafter (centre to centre) for a reduced uplift of 1435 lb. (6.38 kN) D.Fir-L and 1015 lb. (4.51 kN) S-P-F.
- H10S nails to plates are optional for uplift but required for lateral loads.
- H10A may be field-bent up to a slope of 6/12. Multiply the tabulated uplift value x 0.75. Full tabulated lateral resistances apply.
- The factored resistances of stainless-steel connectors match carbon-steel connectors when installed with Simpson Strong-Tie® stainless-steel, SCNR ring-shank nails. For more information, refer to engineering letter L-F-SSNAILS at strongtie.com.
- D.Fir-L/S-P-F factored uplift resistances for the H2.5A fastened to a 2x4 truss bottom chord and double top plates using (5) 8d x 1 1/2" nails into the top plates and (3) 8d x 1 1/2" nails into the lowest three flange holes into the truss bottom chord is 495 lb. (2.20 kN).
- Nails: 16d x 2 1/2" = 0.162" dia. x 2 1/2" long, 10d = 0.148" dia. x 3" long, 10d x 1 1/2" = 0.148" dia. x 1 1/2" long, 8d = 0.131" dia. x 2 1/2" long, 8d x 1 1/2" = 0.131" dia. x 1 1/2" long. See pp. 27-28 for other nail sizes and information.



BEARING ANCHORAGE BY TOE-NAILS FOR LATERAL CAPACITY

B97791H1

NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL LATERAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	132	147
	3.25	0.144	132	147
	3.50	0.160	159	177
COMMON SPIRAL	3.00	0.122	97	108
	3.25	0.122	97	108
	3.50	0.152	145	162

NOTES:

1. Rafter and ceiling members may be anchored to top and bottom chords of girder truss by toe-nailing rafter and ceiling members to girder chords provided the reaction does not exceed the lateral capacities in the table. Hangers (specified by others) are required for reactions higher than the maximum toe-nail capacity. Reactions are based on factored loads.
2. Toe nail capacities shown in the table are for one toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14; section 12.9.4.1.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in tables below.
5. Nail values in table are based on the following relative lumber densities: G = 0.42 (SPF), G = 0.49 (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See next page for nailing on bearing plate).
7. For loads due to wind the nail lateral capacity in this table may be multiplied by 1.15 (K_D factor).
8. Lumber must be dry (< 19% moisture content) at the time of nail installation.
9. Nail values in this table comply with CSA O86-14, section 12.9.4
10. This design is not valid after March 31, 2021.

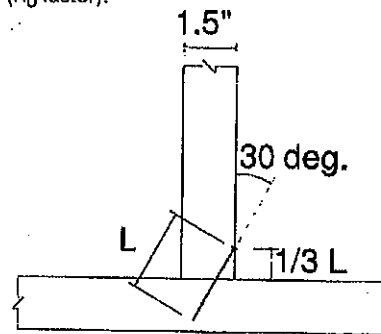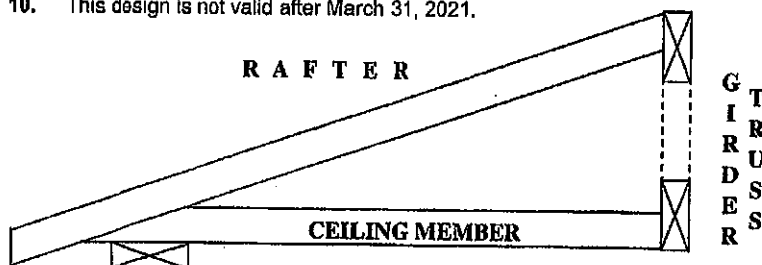


TOE-NAIL INSTALLATION

Nail type	Common wire	Common spiral	Common wire	Common spiral
Nail dia. (in)	0.160	0.152	0.144	0.122
	(3.5" nail)		(3" and 3.25" nail)	
LUMBER SIZE	MAXIMUM NUMBER OF TOE-NAILS			
2X4 SPF	2	2	3	3
2X4 D. Fir	2	2	2	2
2X6 SPF	4	4	4	5
2X6 D. Fir	3	3	3	4

MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7

December 2, 2019



BEARING ANCHORAGE BY TOE-NAILS FOR WIND LOADING

B97791H2



NAIL TYPE	LENGTH (IN)	DIAMETER (IN)	NAIL WITHDRAWAL CAPACITY (LB)	
			S-P-F	D. FIR
COMMON WIRE	3.00	0.144	30	42
	3.25	0.144	32	45
	3.50	0.160	38	52
COMMON SPIRAL	3.00	0.122	26	36
	3.25	0.122	28	40
	3.50	0.152	36	50

Note: If using truss with D. Fir lumber and S-P-F bearing plate, use values in table for S-P-F.



NOTES:

1. Truss chord, rafter, or ceiling members may be anchored to bearing plate by toe-nails, provided that the actual factored uplift force due to **wind or earthquake** load does not exceed the withdrawal capacities in the table. Hangers (specified by others) are required for uplift forces that are higher than the maximum toe-nail withdrawal capacity.
2. Toe nail capacities shown in the table are for **one** toe-nail. For additional toe-nails multiply values in table by the number of toe-nails used. Toe-nail capacities take into account toe-nailing factor J_A in CSA O86-14, section 12.9.5.2.
3. For 9-3/4 gauge 3.25" common wire gun nails (diameter = 0.120") use 3" common spiral nail values.
4. Maximum number of toe-nails allowed depends on the lumber size & species to be toe-nailed to supporting member and nail diameter, as shown in table above.
5. Nail values in table are based on the following relative lumber densities: $G = 0.42$ (SPF), $G = 0.49$ (D. Fir).
6. Toe-nails shall be driven at approximately 1/3 the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member (See drawing on detail B37579H1).
7. Lumber must be dry (< 19% moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-14, section 12.9.5
9. This design is not valid after March 31, 2021.


Toe-nailing on 2x6 Bearing Plate

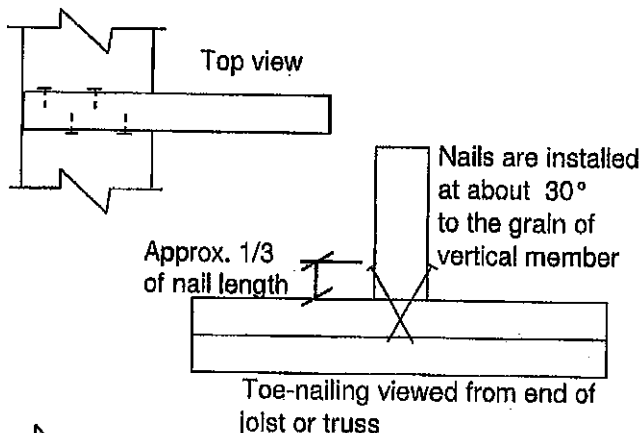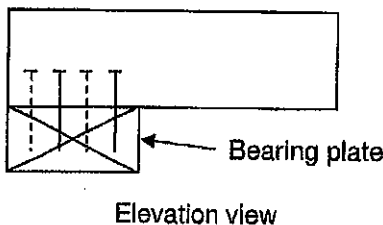

Toe-nailing on 2x4 Bearing Plate

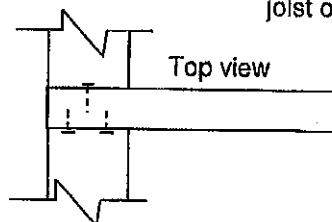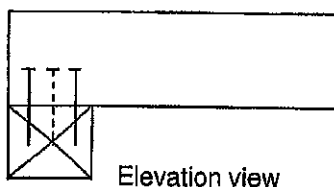


MiTek® MiTek Canada Inc
100 Industrial Rd.
Bradford, Ontario L3Z 3G7




December 2, 2019

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint, unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/4\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

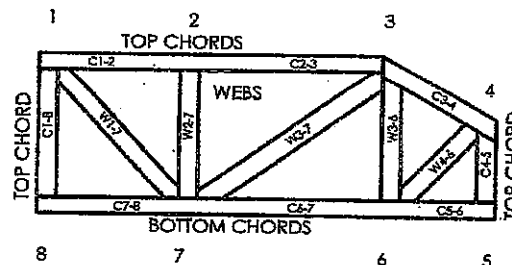

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L 10319-L 13270-L 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MIT-7473C rev. 10-08



General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury


1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss of each joint and embed fully. Knots and wane of joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.

Overview:

Where piggybacks are connected ovetop of base trusses, 2x4 purlins must be first added to the flat portion of the base truss at a spacing no more than 24" o/c. These purlins not only provide support for the piggyback trusses above, but are required to laterally support the top chord of the base truss which will not have the sheathing directly connected to the flat portion of the base truss. This ensures the top chord, most often in compression, will not buckle laterally.

Further, the purlins in the plane of the flat portion require diagonal bracing to prevent lateral displacement of the purlins themselves where under certain conditions, the trusses may in fact all buckle in the same direction if this additional bracing is not added in the plane of the purlins.


Detail:

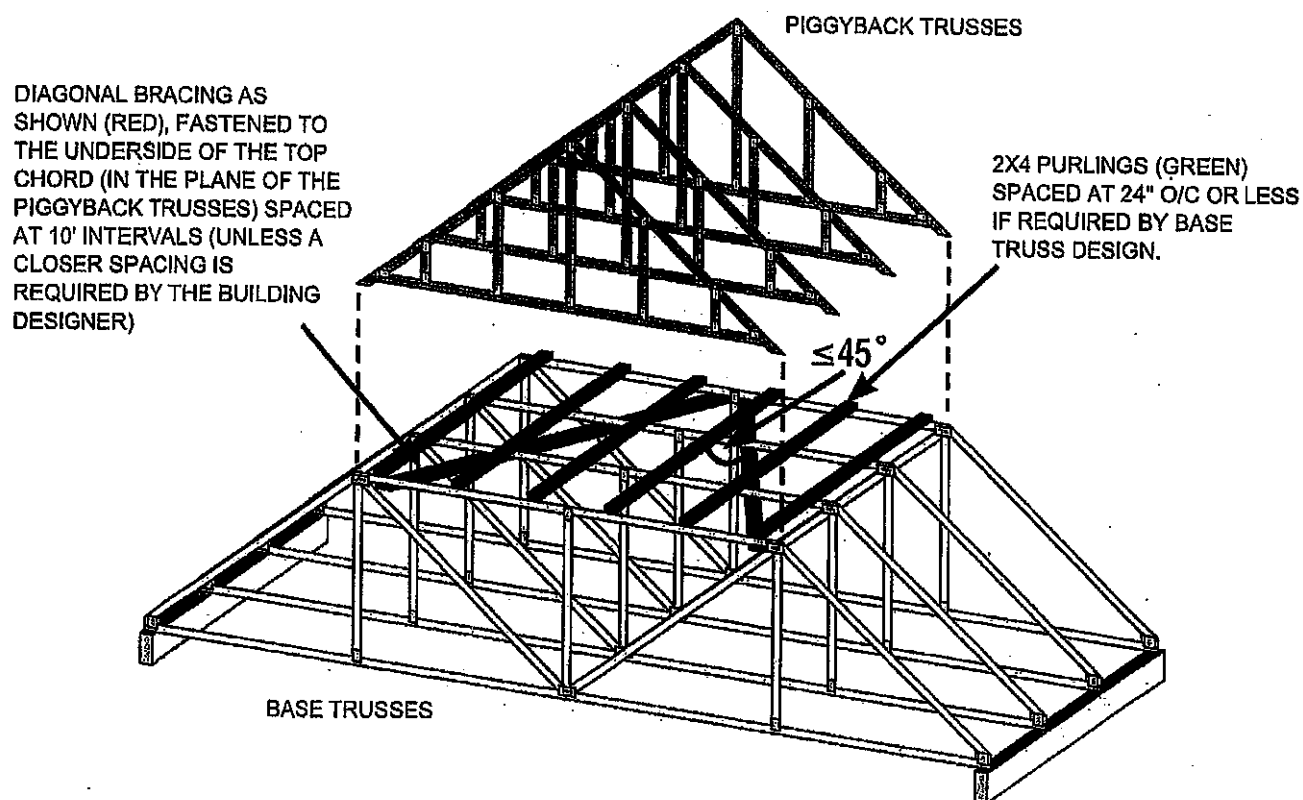

NOTE: THE SLOPED PORTION OF THE TOP CHORD OF THE BASE TRUSS AND PIGGYBACK TRUSS IN THIS SKETCH IS ASSUMED TO BE SHEATHED IN ACCORDANCE WITH THE OBC.

Disclaimer:

OWTFA Tech Notes are intended to provide guidance to the design community both within the membership as well as to third party designers who might benefit from the information. The details have been developed by the OWTFA technical committee and although there may be professional engineers involved in development, the information contained in the tech-note are not intended to be used without having a professional engineer review the information for a specific application. The OWTFA takes no responsibility with respect to the information provided but has developed this tech-note to offer guidance where it is not currently readily available.



Alves Engineering Services Inc.

5208 Easton road
Burlington, Ontario L7L 6N6
(289) 259 5455

RESPONSABILITIES

- 1-Alves Engineering Services Inc. is responsible for the design of trusses as individual components
- 2-It is the responsibility of others to ascertain that the design loads utilized on this drawing meet or exceed the actual dead load imposed by the structure and the live load imposed by the local building code or the authorities having jurisdictions.
- 3- All dimensions are to be verified by owner, contractor, architect or other authority before manufacture.
- 4- Alves Engineering Services Inc. bears no responsibility for the erection of the trusses. Persons erecting trusses are cautioned to seek professional advice regarding temporary and permanent bracing system. Bracing shown on Alves Engineering Services Inc. drawings is specified for the truss as a single component and forms an integral part of the truss design, but is not meant to represent the only required bracing for that truss when trusses are installed in a series of trusses forming a roof truss system.
- 5- It is the manufactures responsibility to ensure that the trusses are manufactured in conformance with Alves Engineering Services Inc. specifications outlined below.

SPECIFICATIONS

- 1-Truss components sealed by Alves Engineering Services Inc. conform to the relevant sections of the current Building Code of Ontario and Canada (part 4 or part 9) or the current Canadian code for Farm Buildings in accordance with the application specified on the sealed truss component drawing. All truss component design procedures must conform to the current design standard issued by the truss plate institute of Canada (TPIC). All lumber and nailing stresses to conform to the current CSA wood design standard identified on the current Building Code and TPIC.
- 2- Lumber is to be the sizes and grade specified on the truss drawing.
- 3- Moist content of lumber is not to exceed 19% in service unless otherwise specified.
- 4- Plates shall be applied to both faces of the each truss joint and shall be positioned as shown on the truss drawings
- 5- Lumber used on manufacture of trusses is not to be treated with chemicals unless otherwise specified on the truss drawings.
- 6- The top chord is assumed to be continuously laterally braced by the roof sheathing or purlins at intervals specified on the truss drawing but not exceeding 24" c/c for (part 9) and not exceeding 48" for (part 4 or farm design)
- 7- When rigid ceiling is not attached directly to the bottom chord, lateral bracing is required and it should not exceed more than 3m or 10' intervals.
- 8-Refer to Mitek sheet MII7473C REV.10-08 attached for information on symbols, numbering system and General Safety notes.

F-1300213

Feb 09, 2018