


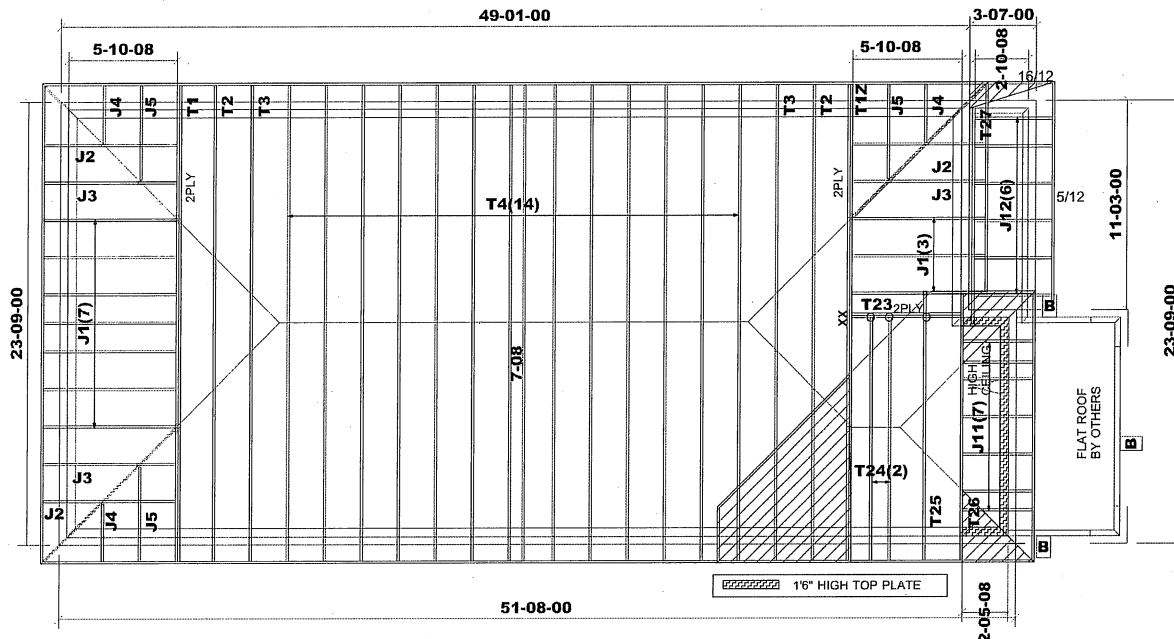

FINISH O.H: 12"
Heel: R.T.M.C
CLADDING ALLOWANCE: 5"
2X6 EXTERIOR WALLS
ASPHALT SHINGLES
2X6 FASCIA BOARD

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PART 9 OF THE OBC LATEST EDITION
ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4"SPF@24"o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER AT EACH CROSS POINT. POSTS LONGER THAN 6' TO BE Laterally BRACED SO THAT THE DISTANCE BETWEEN END POINTS AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

TRUSSES DESIGNED CONFORM TO THE RELEVANT SECTION OF THE LATEST EDITION OF THE ONTARIO BUILDING CODE (RESIDENTIAL PART 9)

DESIGN CONFORMS WITH OBC 2012(2019 AMENDMENT)
OCCUPANCY: RESIDENTIAL | PART: 9
Ss = 33.4 psf | Sr = 8.4 psf

DESIGN LOADS:
TCSL = 26.7 psf
TCOL = 8.0 psf
BCLL = 0.0 psf
BCDL = 7.4 psf

HARDWARE
LUS24(O)
LJS26DS(V)
LUS26-2(VV)
CP3-S(P)
HGU26-2(XX)

ALL ROOF PITCHES ARE 6/12 UNLESS OTHERWISE NOTED

 DENOTES:
CONVENTIONAL
FRAMING

DWG# TR22080001 TO TR22080009
DWG# TR22080035 TO TR22080042



STRUCTURAL COMPONENTS ONLY
DWG# TR22080045

TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.



M15035


Job Track: 52956
Layout ID: 427323
Plan Log: 206323
Builder / Location: GREENPARK HOMES / CAMBRIDGE
Project: BARLASSINA
Date: 8/02/22
Designer: AT

Model / Elevation: GARDEN 1 / 3
Mitek ver 8.5.3.233
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.







DELIVERY SHIPLIST											
 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP		Lumber Yard: TAMARACK LUMBER Builder: GREENPARK HOMES Project: BARLASSINA Location: CAMBRIDGE Model: GARDEN 1 Lot #: Elevation: 1						Job Track: 52956 PlanLog: 206323 Layout ID: 427257 Ref #: 13864 Page: 1 of 2 Date: 08-03-2022 Designer: Sales Rep: Rick DiCiano			

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 /12	22-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	203.69 128.00		
	1	T2 Hip	6 /12	22-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	94.14 59.33		
	1	T3 Hip	6 /12	22-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	96.52 60.17		
	12	T4 Common	6 /12	22-11-00	6-10-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1097.59 692.00		
	2	T5 Hip	10 /12	22-11-00	6-07-13	2 x 4	1-03-08 1-03-08	1-07-10 1-07-10	212.06 134.33		
	2	T6 Hip	10 /12	22-11-00	7-11-13	2 x 4	1-03-08 1-03-08	1-07-10 1-07-10	235.4 148.67		
	1 2-ply	T7 Hip Girder	10 /12	22-11-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-10 1-07-10	216.67 135.67		
	1 2-ply	T8 Jack-Open Girder	8 /12	5-10-08	5-03-13	2 x 4 2 x 6	1-03-08	1-04-13 5-03-13	67.91 42.67		
	1	T9 Common	10 /12	11-08-00	6-05-15	2 x 4	1-03-08 1-03-08	1-07-10 1-07-10	51.58 33.00		
	1 2-ply	T10 Hip Girder	10 /12	11-08-00	4-10-06	2 x 4 2 x 6	1-03-08 1-03-08	1-07-10 1-07-10	121.64 77.33		
	1	T11 Common	10 /12	9-04-00	5-06-05	2 x 4	1-03-08 1-03-08	1-07-10 1-07-10	42.82 27.50		
	1 2-ply	T12 Half Hip Girder	10 /12	3-10-08	3-04-07	2 x 4 2 x 6	1-03-08	1-07-10 3-04-07	49.3 33.00		
	2	T13S Roof Special	10 /12	9-04-00	5-06-05	2 x 4	1-03-08 1-03-08	1-07-10 1-07-10	99.66 68.67		
	3	T14 Common	6 /12	9-04-00	3-04-05	2 x 4	1-03-08 1-05-00	6-08 6-12	88.51 56.50		

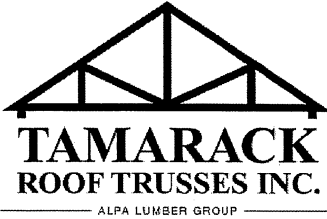 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST							
	Lumber Yard: TAMARACK LUMBER	Job Track: 52956	PlanLog: 206323 Layout ID: 427257 Ref #: 13864 Page: 2 of 2 Date: 08-03-2022 Designer: Sales Rep: Rick DiCiano					
Builder: GREENPARK HOMES								
Project: BARLASSINA								
Location: CAMBRIDGE								
Model: GARDEN 1								
Lot #:								
Elevation: 1								

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1	G14 GABLE	6 /12	9-04-00	3-04-05	2 x 4	1-03-08 1-05-00	6-08 6-12	31.65 20.83		
	1	T15 Half Hip Girder	12 /12	10-10-00	2-05-03	2 x 4 2 x 6	1-03-08 10-08	1-00-11 1-09-07	48.87 32.17		
	7	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	117.56 74.67		
	2	J2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	J3 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	J4 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		
	2	J5 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	5	J6 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	89.15 53.33		
	2	J7 Jack-Open	10 /12	2-01-00	3-04-07	2 x 4	1-03-08	1-07-10 3-04-07	18.08 13.33		
	2	J8 Jack-Open	4 /12	6-05-08	2-11-03	2 x 4	1-05-00	3-15 2-05-12	33.88 21.33		
	6	J9 Jack-Open	6 /12	2-10-08	2-04-15	2 x 4	1-03-08	4-03 1-09-07	52.54 32.00		


TOTAL # TRUSS= 67 TOTAL BFT OF ALL TRUSSES= 1997.83 BFT. TOTAL WEIGHT OF ALL TRSSES 3153.86 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LUS24	
2	Hardware	LUS26-2	
1	Hardware	HGUS26-2	
1	Hardware	LJS26DS	

TOTAL NUMBER OF ITEMS= 7

DELIVERY SHIPLIST

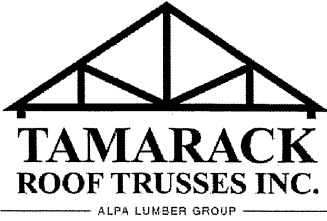


Lumber Yard: TAMARACK LUMBER
 Builder: GREENPARK HOMES
 Project: BARLASSINA
 Location: CAMBRIDGE
 Model: GARDEN 1
 Lot #:
 Elevation: 2










Job Track: 52956
 PlanLog: 206323
 Layout ID: 427303
 Ref #: 13864
 Page: 1 of 2
 Date: 08-03-2022
 Designer:
 Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 /12	22-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	203.69 128.00		
	1	T2 Hip	6 /12	22-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	94.14 59.33		
	1	T3 Hip	6 /12	22-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	96.52 60.17		
	12	T4 Common	6 /12	22-11-00	6-10-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1097.59 692.00		
	2	T5 Hip	10 /12	22-11-00	6-07-13	2 x 4	1-03-08 1-03-08	1-07-10 1-07-10	212.06 134.33		
	2	T6 Hip	10 /12	22-11-00	7-11-13	2 x 4	1-03-08 1-03-08	1-07-10 1-07-10	235.4 148.67		
	1 2-ply	T7Z Hip Girder	10 /12	22-11-00	5-03-13	2 x 4 2 x 6	1-03-08 1-03-08	1-07-10 1-07-10	216.67 135.67		
	1	T15 Half Hip Girder	12 /12	10-10-00	2-05-03	2 x 4 2 x 6	1-03-08 10-08	1-00-11 1-09-07	48.87 32.17		
	1 2-ply	T16 Monopitch Girder	8 /12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	68.79 43.33		
	1 2-ply	T17 Hip Girder	10 /12	11-08-00	6-03-15	2 x 4 2 x 6	1-03-08	1-07-11 3-01-11	131.72 85.00		
	1 2-ply	T18 Flat Girder	0 /12	5-07-08	1-06-00	2 x 4 2 x 6		1-06-00 1-06-00	45.87 29.67		
	2	T19 Common	10 /12	9-01-00	7-00-06	2 x 4	1-03-08 1-03-08	3-01-11 3-04-03	96 60.67		
	2	T21 Common	10 /12	9-04-00	5-06-06	2 x 4	1-05-00 1-03-08	1-07-11 1-07-11	86.05 56.33		
	1	G21 GABLE	10 /12	9-04-00	5-06-06	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	47.1 31.50		

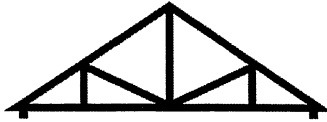DELIVERY SHIPLIST			
 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	Lumber Yard:	TAMARACK LUMBER	Job Track: 52956
	Builder:	GREENPARK HOMES	PlanLog: 206323
	Project:	BARLASSINA	Layout ID: 427303
	Location:	CAMBRIDGE	Ref #: 13864
	Model:	GARDEN 1	Page: 2 of 2
	Lot #:		Date: 08-03-2022
	Elevation:	2	Designer:
			Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	2	T22 Monopitch	10 /12	2-04-00	3-07-00	2 x 4	1-03-08	1-07-11 3-07-00	29.52 20.33		
	7	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	117.56 74.67		
	2	J2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67		
	2	J3 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33		
	2	J4 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33		
	2	J5 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00		
	6	J6 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	106.98 64.00		
	6	J9 Jack-Open	6 /12	2-10-08	2-04-15	2 x 4	1-03-08	4-03 1-09-07	52.54 32.00		
	8	J10 Jack-Open	4 /12	6-05-08	2-10-11	2 x 4	1-03-08	3-15 2-05-12	134.32 85.33		

TOTAL # TRUSS= 71

TOTAL BFT OF ALL TRUSSES= 2026.5


BFT.

TOTAL WEIGHT OF ALL TRSSES 3206.01 LBS







HARDWARE


QTY	TYPE	MODEL	LENGTH
6	Hardware	LUS24	
3	Hardware	HGUS26-2	

TOTAL NUMBER OF ITEMS= 9



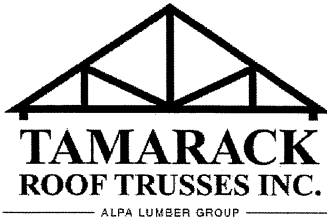
DELIVERY SHIPLIST				
 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	Lumber Yard:	TAMARACK LUMBER	Job Track:	52956
	Builder:	GREENPARK HOMES	PlanLog:	206323
	Project:	BARLASSINA	Layout ID:	427323
	Location:	CAMBRIDGE	Ref #	13864
	Model:	GARDEN 1	Page:	1 of 2
	Lot #:		Date:	08-03-2022
	Elevation:	3	Designer:	
		Sales Rep:	Rick DiCiano	

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	1 2-ply	T1 Hip Girder	6 /12	22-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	203.69 128.00		
	1 2-ply	T1Z Hip Girder	6 /12	22-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	203.69 128.00		
	2	T2 Hip	6 /12	22-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	188.29 118.67		
	2	T3 Hip	6 /12	22-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	193.05 120.33		
	14	T4 Common	6 /12	22-11-00	6-10-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1280.52 807.33		
	1 2-ply	T23 Monopitch Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6	1-03-08	1-02-00 4-01-04	61.69 40.33		
	2	T24 Common	6 /12	11-08-00	5-07-00	2 x 4	1-03-08 1-03-08	2-08-00 2-08-00	100.81 65.00		
	1	T25 Hip	6 /12	11-08-00	4-10-12	2 x 4	1-03-08 1-05-00	2-08-00 2-08-00	55.29 35.83		
	1	T26 Hip Girder	6 /12	11-08-00	2-04-12	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	53.02 34.67		
	1	T27 Flat Girder	0 /12	10-10-00	1-06-07	2 x 4 2 x 6	10-08	1-06-07 1-06-07	45.04 27.83		
	10	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	167.94 106.67		
	3	J2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	34.75 22.00		
	3	J3 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	42.4 26.00		
	3	J4 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	21.06 14.00		

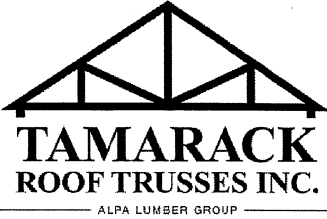 TAMARACK ROOF TRUSSES INC. ALPA LUMBER GROUP	DELIVERY SHIPLIST	
	Lumber Yard: TAMARACK LUMBER Builder: GREENPARK HOMES Project: BARLASSINA Location: CAMBRIDGE Model: GARDEN 1 Lot #: Elevation: 3	Job Track: 52956 PlanLog: 206323 Layout ID: 427323 Ref #: 13864 Page: 2 of 2 Date: 08-03-2022 Designer: Sales Rep: Rick DiCiano

Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG LEFT RIGHT	HEEL HEIGHT LEFT RIGHT	LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	3	J5 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	28.71 18.00		
	7	J11 Jack-Open	6 /12	2-05-08	2-04-12	2 x 4	1-03-08	1-02-00 2-04-12	59.8 42.00		
	6	J12 Jack-Open	5 /12	2-10-08	2-00-10	2 x 4	1-03-08	4-01 1-06-07	51.38 32.00		

TOTAL # TRUSS= 64 TOTAL BFT OF ALL TRUSSES= 1766.66 BFT. TOTAL WEIGHT OF ALL TRSSES 2791.12 LBS

HARDWARE

QTY	TYPE	MODEL	LENGTH
3	Hardware	LUS24	
1	Hardware	HGUS26-2	


TOTAL NUMBER OF ITEMS= 4

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T1	1	2	GREENPARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 08:43:58 2022 Page 11	

ID: v?Q AaaDSFuR0QQj2X oUz5fnk-DsrPL 78b tqZ02oKpHFNamG9qtSvPgCj31spqyryLI

1-3-8 0-0 5-10-8 5-10-8 5-7-0 11-5-8 5-7-0 17-0-8 5-10-8 22-11-0 24-2-8 1-3-8

Scale = 1:42.5

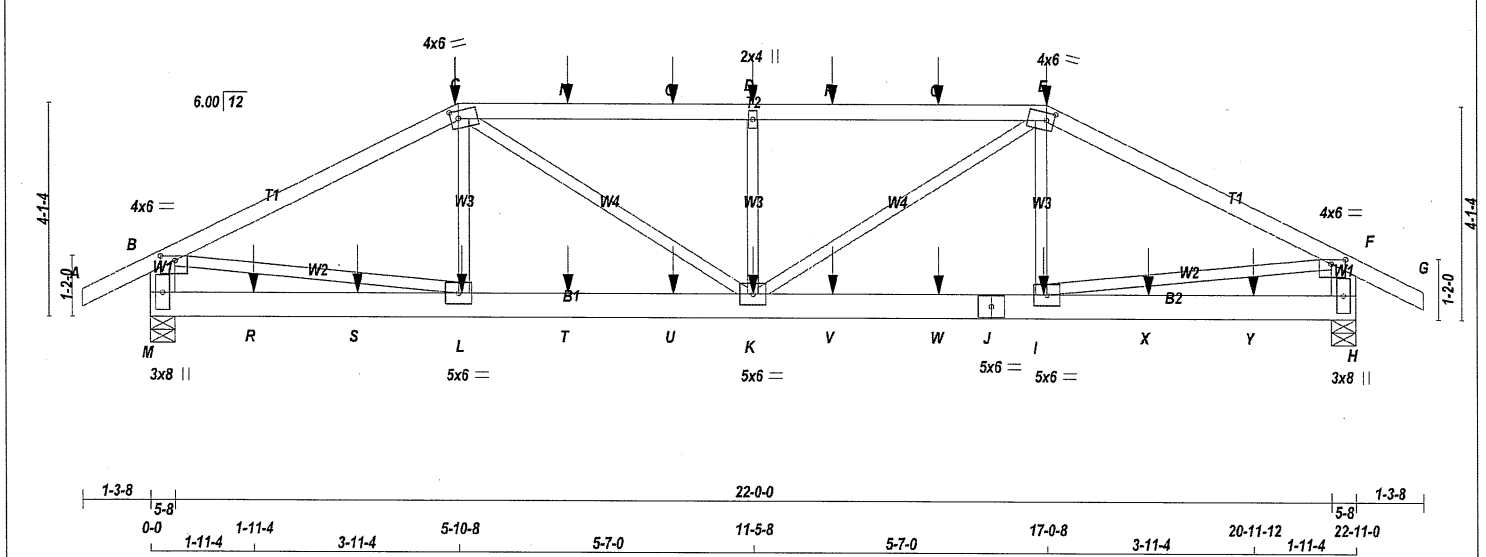

LUMBER	SIZE	LUMBER	DESCR.
N. L. G. A. RULES			
CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
M - B	2x6	DRY	No.2
H - F	2x6	DRY	No.2
M - J	2x6	DRY	No.2
J - H	2x6	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF

EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	SIDE(61.0)
C - E 1	12	SIDE(61.0)
E - G 1	12	SIDE(61.0)
M - B 2	12	TOP
H - F 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
M - J 2	12	SIDE(183.1)
J - H 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
M	2249	0	0	5-8
H	2249	0	0	5-8

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED	SNOW	LIVE		
M	1588	1056 / 0	0 / 0	533 / 0	0 / 0
H	1588	1056 / 0	0 / 0	533 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.28 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (FT)	WEBS	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (FT)
FR-TO				FR-TO		
A-B	0 / 29	-95.2	-95.2 0.07 (1)	L-C	-154 / 111	0.02 (4)
B-C	-3135 / 0	-95.2	-95.2 0.41 (1)	C-K	0 / 1109	0.14 (1)
C-N	-3721 / 0	-95.2	-95.2 0.52 (1)	K-D	-1081 / 0	0.14 (1)
N-O	-3721 / 0	-95.2	-95.2 0.52 (1)	D-E	0 / 1109	0.14 (1)
O-D	-3721 / 0	-95.2	-95.2 0.52 (1)	E-I	-154 / 111	0.02 (4)
D-P	-3721 / 0	-95.2	-95.2 0.52 (1)	I-F	0 / 2826	0.35 (1)
P-Q	-3721 / 0	-95.2	-95.2 0.52 (1)	F-H	0 / 2826	0.35 (1)
Q-E	-3721 / 0	-95.2	-95.2 0.52 (1)			
E-F	-3135 / 0	-95.2	-95.2 0.41 (1)			
F-G	0 / 29	-95.2	-95.2 0.07 (1)			
M-B	-2177 / 0	0.0	0.0 0.08 (1)			
H-F	-2177 / 0	0.0	0.0 0.08 (1)			

M-R	0 / 0	-18.5	-18.5 0.06 (4)	10.00
R-S	0 / 0	-18.5	-18.5 0.06 (4)	10.00
S-L	0 / 0	-18.5	-18.5 0.06 (4)	10.00
L-T	0 / 2798	-18.5	-18.5 0.23 (1)	10.00
T-U	0 / 2798	-18.5	-18.5 0.23 (1)	10.00
U-K	0 / 2798	-18.5	-18.5 0.23 (1)	10.00
K-V	0 / 2798	-18.5	-18.5 0.23 (1)	10.00
V-W	0 / 2798	-18.5	-18.5 0.23 (1)	10.00
W-J	0 / 2798	-18.5	-18.5 0.23 (1)	10.00
J-I	0 / 2798	-18.5	-18.5 0.23 (1)	10.00
I-X	0 / 0	-18.5	-18.5 0.06 (4)	10.00
X-Y	0 / 0	-18.5	-18.5 0.06 (4)	10.00
Y-H	0 / 0	-18.5	-18.5 0.06 (4)	10.00

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-268	-268	---	FRONT	VERT	TOTAL	---	C1
D	11-5-8	-79	-79	---	FRONT	VERT	TOTAL	---	C1
E	17-0-8	-268	-268	---	FRONT	VERT	TOTAL	---	C1
I	16-11-12	-21	-21	---	FRONT	VERT	TOTAL	---	C1
K	11-5-8	-21	-21	---	FRONT	VERT	TOTAL	---	C1
L	5-11-4	-21	-21	---	FRONT	VERT	TOTAL	---	C1
N	7-11-4	-79	-79	---	FRONT	VERT	TOTAL	---	C1
O	9-11-4	-79	-79	---	FRONT	VERT	TOTAL	---	C1
P	12-11-12	-79	-79	---	FRONT	VERT	TOTAL	---	C1
Q	14-11-12	-79	-79	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")
CALCULATED VERT. DEFL.(LL)= L/999 (0.07")
ALLOWABLE DEFL.(TL)= L/360 (0.76")
CALCULATED VERT. DEFL.(TL)= L/999 (0.12")

CSI: TC=0.52/1.00 (D-E:1), BC=0.23/1.00 (I-K:1), WB=0.35/1.00 (F-I:1), SSI=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.84 (C) (INPUT = 0.90)
JSI METAL= 0.41 (C) (INPUT = 1.00)

CONTINUED ON PAGE 2



STRUCTURAL COMPONENT ONLY
DWG # TR22080006 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T1	1	2	GREENPARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:43:58 2022 Page 2
ID: v?Q AaaDSFuR0QQj2X oUz5fnk-DsrPL 78b tqZ02oKpHFNamG9qtSvPgCj31spgyryLI

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.25
C	TTWW-m	MT20	4.0	6.0	1.75	1.75
D	TMW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	4.0	6.0	1.75	1.75
F	TMVW-p	MT20	4.0	6.0	1.00	3.25
H	BMV1+p	MT20	3.0	8.0		
I	BMWW-t	MT20	5.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BMWWW-t	MT20	5.0	6.0		
L	BMWW-t	MT20	5.0	6.0		
M	BMV1+p	MT20	3.0	8.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
R	1-11-4	-20	-20	—	FRONT	VERT	TOTAL	—	C1
S	3-11-4	-21	-21	—	FRONT	VERT	TOTAL	—	C1
T	7-11-4	-21	-21	—	FRONT	VERT	TOTAL	—	C1
U	9-11-4	-21	-21	—	FRONT	VERT	TOTAL	—	C1
V	12-11-12	-21	-21	—	FRONT	VERT	TOTAL	—	C1
W	14-11-12	-21	-21	—	FRONT	VERT	TOTAL	—	C1
X	18-11-12	-21	-21	—	FRONT	VERT	TOTAL	—	C1
Y	20-11-12	-20	-20	—	FRONT	VERT	TOTAL	—	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.





STRUCTURAL COMPONENT ONLY
DWG # TR22080006 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427323	T1Z	1	2	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:00:56 2022 Page 1

ID: v?Q AaaDSFuR0QQj2X oUz5fnk-QiMG74Sirm8EiStRzcYzdFwFXBGeQnq2pReiXqvy5r

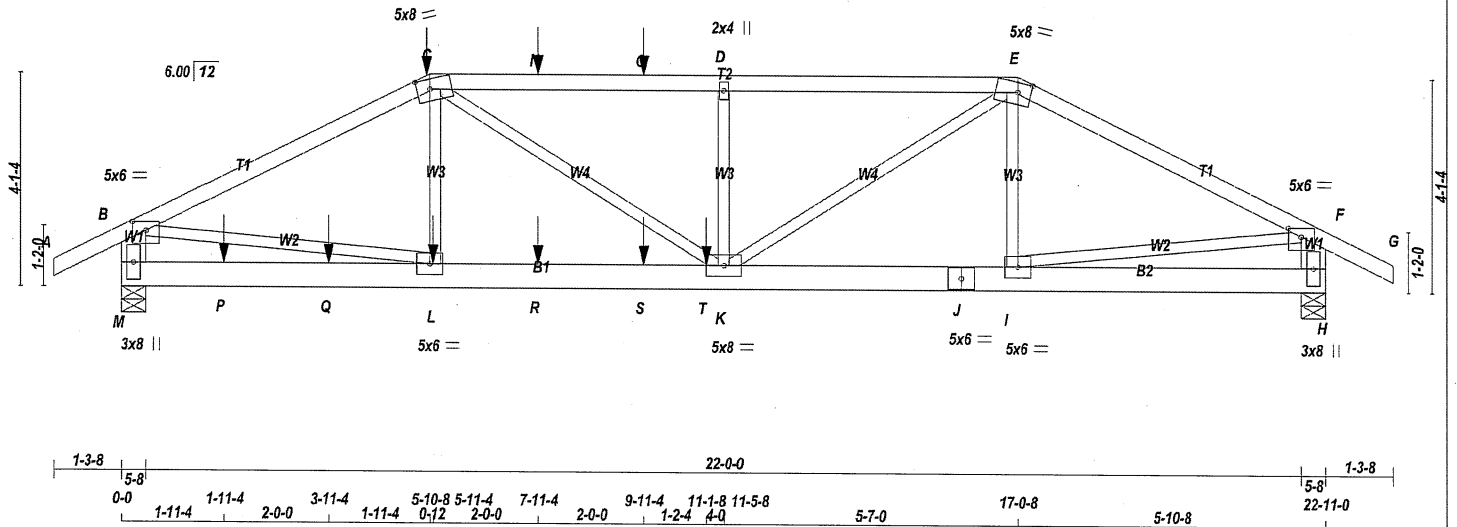

TOTAL WEIGHT = 2 X 102 = 204 lb

LUMBER			
N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
E - G	2x4	DRY	No.2
M - B	2x6	DRY	No.2
H - F	2x6	DRY	No.2
M - J	2x6	DRY	No.2
J - H	2x6	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	SIDE(61.0)
C-E	12	SIDE(61.0)
E-G	12	TOP
M-B	2	TOP
H-F	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
M-J	2	SIDE(183.1)
J-H	2	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	
D-K	6	SIDE(263.3)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ	UPLIFT
M	2837	0	2837	0	0
H	2485	0	2485	0	0

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1998	1357 / 0	0 / 0	0 / 0	0 / 0	641 / 0	0 / 0
H	1748	1202 / 0	0 / 0	0 / 0	0 / 0	545 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.73 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	MAX. FORCE (LBS)	VERT. LOAD	LC1 MAX (PLF)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO		FR-TO		
A-B	0 / 29	-95.2	-95.2	0.07 (1)	L-C	-169 / 112	0.02 (1)
B-C	-4201 / 0	-95.2	-95.2	0.47 (1)	C-K	0 / 1952	0.24 (1)
C-N	-5374 / 0	-95.2	-95.2	0.50 (1)	K-D	-790 / 0	0.10 (1)
N-O	-5374 / 0	-95.2	-95.2	0.50 (1)	K-E	0 / 2623	0.32 (1)
O-D	-5374 / 0	-95.2	-95.2	0.50 (1)	I-E	-329 / 0	0.04 (1)
D-E	-5374 / 0	-95.2	-95.2	0.50 (1)	B-L	0 / 3786	0.47 (1)
E-F	-3581 / 0	-95.2	-95.2	0.43 (1)	I-F	0 / 3228	0.40 (1)
F-G	0 / 29	-95.2	-95.2	0.07 (1)			
M-B	-2778 / 0	0.0	0.0	0.10 (1)			
H-F	-2429 / 0	0.0	0.0	0.09 (1)			
M-P	0 / 0	-18.5	-18.5	0.07 (4)			
P-Q	0 / 0	-18.5	-18.5	0.07 (4)			
Q-L	0 / 0	-18.5	-18.5	0.07 (4)			
L-R	0 / 3750	-18.5	-18.5	0.42 (1)			
R-S	0 / 3750	-18.5	-18.5	0.42 (1)			
S-T	0 / 3750	-18.5	-18.5	0.42 (1)			
T-K	0 / 3750	-18.5	-18.5	0.42 (1)			
K-J	0 / 3192	-18.5	-18.5	0.24 (1)			
J-I	0 / 3192	-18.5	-18.5	0.24 (1)			
I-H	0 / 0	-18.5	-18.5	0.04 (4)			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-268	-268	---	BACK	VERT	TOTAL	---	C1
L	5-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
N	7-11-4	-79	-79	---	BACK	VERT	TOTAL	---	C1
O	9-11-4	-79	-79	---	BACK	VERT	TOTAL	---	C1
P	1-11-4	-20	-20	---	BACK	VERT	TOTAL	---	C1
Q	3-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
R	7-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
S	9-11-4	-21	-21	---	BACK	VERT	TOTAL	---	C1
T	11-1-8	-1199	-1199	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN./C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")
CALCULATED VERT. DEFL.(LL)= L/999 (0.10")
ALLOWABLE DEFL.(TL)= L/360 (0.76")
CALCULATED VERT. DEFL.(TL)= L/999 (0.18")

CSI: TC=0.50/1.00 (D-E-1), BC=0.42/1.00 (K-L-1), WB=0.47/1.00 (B-L-1), SSI=0.56/1.00 (K-L-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (F) (INPUT = 0.90)
JSI METAL= 0.43 (L) (INPUT = 1.00)

CONTINUED ON PAGE 2



STRUCTURAL COMPONENT ONLY
DWG # TR22080037 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427323	T1Z	1	2	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:00:56 2022 Page 2

ID: v?Q AaaDSFuR0QQj2X oUz5fkn-QiMG74Sirm8EiStRzcYzdFwFXBGeQnq2pReiXqyny5r

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	5.0	6.0	2.00	3.00
C	TTWW-m	MT20	5.0	8.0	2.25	3.00
D	TMW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	2.25	3.00
F	TMVW-p	MT20	5.0	6.0	2.00	3.00
H	BMV1+p	MT20	3.0	8.0		
I	BMWW-t	MT20	5.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BMWWW-t	MT20	5.0	8.0		
L	BMWW-t	MT20	5.0	6.0		
M	BMV1+p	MT20	3.0	8.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



STRUCTURAL COMPONENT ONLY
DWG # TR22080037 PG 2/2


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREENPARK HOMES	DRWG NO.
427257	T2	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

ID: v?Q AaaDSFuR0QQi2X oUz5fknk-h3PoYK8mMI?XB9d uXoUvoIWaEABepELyinPLHvryLk

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:43:59 2022 Page 1

-1-3-8 0-0 4-0-8 4-0-8 3-10-0 7-10-8 3-7-0 11-5-8 3-7-0 15-0-8 3-10-0 18-10-8 4-0-8 22-11-0 1-3-8 24-2-8
Scale = 1:42.5

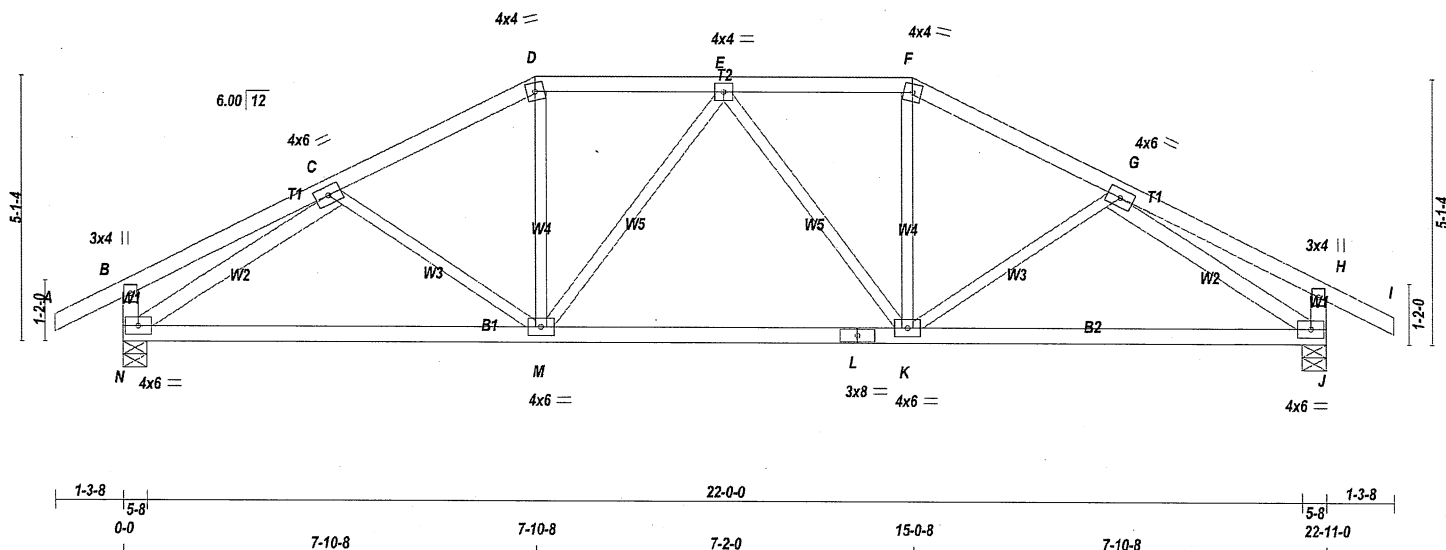

TOTAL WEIGHT = 94 lb

LUMBER N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
N - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
N - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2

ALL WEBS	EXCEPT	SIZE	LUMBER	DESCR.
N - C	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	6.0		
D	TTW-m	MT20	4.0	4.0		
E	TMVW-t	MT20	4.0	4.0		
F	TTW-m	MT20	4.0	4.0		
G	TMVW-t	MT20	4.0	6.0		
H	TMV+p	MT20	3.0	4.0		
J	BMVW1-t	MT20	4.0	6.0		
K	BMVW1-t	MT20	4.0	6.0		
L	BS-t	MT20	3.0	8.0		
M	BMVW1-t	MT20	4.0	6.0		
N	BMVW1-t	MT20	4.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

DESIGNER								
BEARINGS			FACTORED		MAXIMUM FACTORED		INPUT	REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
N	1432	0	1432	0	0	5-8	5-8	
J	1432	0	1432	0	0	5-8	5-8	

UNFACTORED REACTIONS

JT	1ST LCASE	MAX /MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1009	685 / 0	0 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0
J	1009	685 / 0	0 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.03 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		MAX. FACTORED		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX	UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX	CSI (LC)
FR-TO		FROM	TO			FR-TO			
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00	C-M	-131 / 21	0.05 (1)	
B-C	0 / 18	-95.2	-95.2	0.22 (1)	10.00	M-D	0 / 431	0.10 (1)	
C-D	-1606 / 0	-95.2	-95.2	0.20 (1)	5.03	M-E	-253 / 0	0.16 (1)	
D-E	-1428 / 0	-95.2	-95.2	0.17 (1)	5.30	E-K	-253 / 0	0.16 (1)	
E-F	-1428 / 0	-95.2	-95.2	0.17 (1)	5.30	K-F	0 / 431	0.10 (1)	
F-G	-1606 / 0	-95.2	-95.2	0.20 (1)	5.03	K-G	-131 / 21	0.05 (1)	
G-H	0 / 18	-95.2	-95.2	0.22 (1)	10.00	N-C	-1877 / 0	0.52 (1)	
H-I	0 / 29	-95.2	-95.2	0.12 (1)	10.00	G-J	-1877 / 0	0.52 (1)	
N-B	-277 / 0	0.0	0.0	0.03 (1)	7.81				
J-H	-277 / 0	0.0	0.0	0.03 (1)	7.81				
N-M	0 / 1525	-18.5	-18.5	0.39 (1)	10.00				
M-L	0 / 1576	-18.5	-18.5	0.38 (1)	10.00				
L-K	0 / 1576	-18.5	-18.5	0.38 (1)	10.00				
K-J	0 / 1525	-18.5	-18.5	0.39 (1)	10.00				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	26.7	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	40.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.76")
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.22/1.00 (G-H:1), BC=0.39/1.00 (J-K:1)
WB=0.52/1.00 (G-J:1), SSI=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
		788	1987
		1873	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.89 (N) (INPUT = 0.90)
JSI METAL= 0.56 (L) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080007

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T3	1	1	GREENPARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:44:00 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fmk-9FzAmg9O6c7OpJCAREJJS?rf dVkBcVANWvjtyryLi

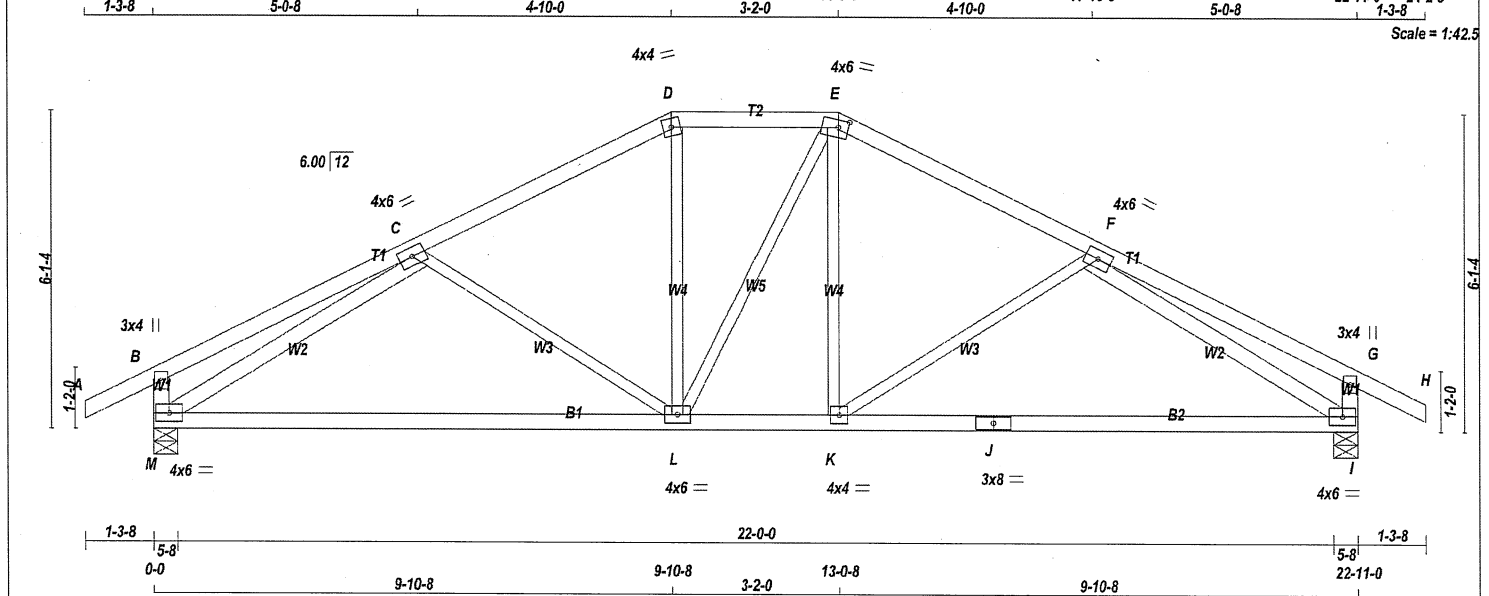

TOTAL WEIGHT = 97 lb
(M)(F)

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4 DRY	No.2	SPF
D - E	2x4 DRY	No.2	SPF
E - H	2x4 DRY	No.2	SPF
M - B	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
M - J	2x4 DRY	No.2	SPF
J - I	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
EXCEPT			
M - C	2x4 DRY	No.2	SPF
F - I	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMW-w-t	MT20	4.0	6.0		
D	TTW-m	MT20	4.0	4.0		
E	TTW-w-m	MT20	4.0	6.0	1.75	2.25
F	TMW-w-t	MT20	4.0	6.0		
G	TMV+p	MT20	3.0	4.0		
I	BMVW1-t	MT20	4.0	6.0		
J	BS-t	MT20	3.0	8.0		
K	BMW-w-t	MT20	4.0	4.0		
L	BMW-w-w-t	MT20	4.0	6.0		
M	BMVW1-t	MT20	4.0	6.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2x4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
M	1432	0	1432	0
I	1432	0	1432	0

UNFACTORED REACTIONS

1ST LCASE MAX / MIN. COMPONENT REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1009	685 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0
I	1009	685 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.08 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 29	-95.2	-95.2	C-L	-323 / 0	0.21	(1)
B-C	0 / 24	-95.2	-95.2	L-D	0 / 314	0.07	(1)
C-D	-1460 / 0	-95.2	-95.2	E-F	0 / 1	0.00	(1)
D-E	-1289 / 0	-95.2	-95.2	K-E	0 / 313	0.07	(1)
E-F	-1460 / 0	-95.2	-95.2	K-F	-323 / 0	0.21	(1)
F-G	0 / 24	-95.2	-95.2	M-C	-1870 / 0	0.83	(1)
G-H	0 / 29	-95.2	-95.2	F-I	-1870 / 0	0.83	(1)
M-B	-311 / 0	0.0	0.0				
I-G	-311 / 0	0.0	0.0				
M-L	0 / 1552	-18.5	-18.5				
L-K	0 / 1288	-18.5	-18.5				
K-J	0 / 1551	-18.5	-18.5				
J-I	0 / 1551	-18.5	-18.5				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 26.7 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 40.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.05")
ALLOWABLE DEFL.(TL)= L/360 (0.76")
CALCULATED VERT. DEFL.(TL)= L/ 861 (0.32")

CSI: TC=0.37/1.00 (F-G:1), BC=0.49/1.00 (L-M:4),
WB=0.83/1.00 (C-M:1), SS=0.20/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747
		788	1987
		1873	

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)
JSI METAL= 0.67 (J) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080008

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T4	12	1	GREENPARK HOMES	
				TRUSS DESC.	

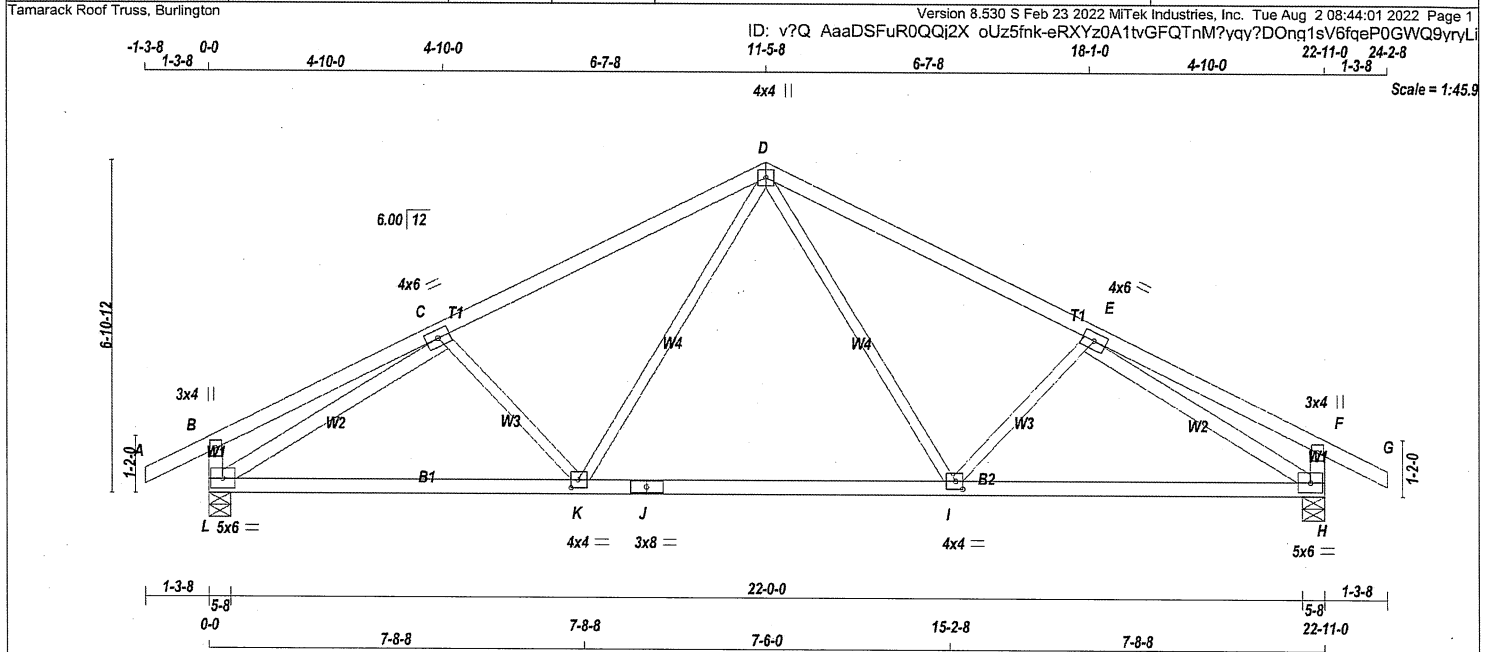


TOTAL WEIGHT = 12 X 91 = 1098 lb										[M][F]	
LUMBER N. L. G. A. RULES											
CHORDS		SIZE	LUMBER	DESCR.							
A - D	2x4	DRY	No.2	SPF							
D - G	2x4	DRY	No.2	SPF							
L - B	2x4	DRY	No.2	SPF							
H - F	2x4	DRY	No.2	SPF							
L - J	2x4	DRY	No.2	SPF							
J - H	2x4	DRY	No.2	SPF							
ALL WEBS 2x3 DRY No.2 SPF											
EXCEPT											
L - C	2x4	DRY	No.2	SPF							
E - H	2x4	DRY	No.2	SPF							
DRY: SEASONED LUMBER.											
PLATES (table is in inches)											
JT	TYPE	PLATES	W	LEN	Y	X					
B	TMV+p	MT20	3.0	4.0							
C	TMWW-t	MT20	4.0	6.0							
D	TTWW+p	MT20	4.0	4.0							
E	TMWW-t	MT20	4.0	6.0							
F	TMV+p	MT20	3.0	4.0							
H	BMVW1-t	MT20	5.0	6.0							
I	BMWW-t	MT20	4.0	4.0	2.00	1.75					
J	BS-t	MT20	3.0	8.0							
K	BMWW-t	MT20	4.0	4.0	2.00	1.75					
L	BMVW1-t	MT20	5.0	6.0							
NOTES- (1) 1) Lateral braces to be a minimum of 2X4 SPF #2.											
											
STRUCTURAL COMPONENT ONLY DWG # TR22080009											
DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER											
BEARINGS											
		FACTORED		MAXIMUM FACTORED		INPUT		REQRD			
		GROSS REACTION		GROSS REACTION		BRG		BRG			
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX				
L	1432	0	1432	0	0	5-8	5-8				
H	1432	0	1432	0	0	5-8	5-8				
UNFACTORED REACTIONS											
		1ST LCASE		MAX./MIN. COMPONENT REACTIONS							
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL				
L	1009	685 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0				
H	1009	685 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0				
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H											
BRACING											
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.											
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.											
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.											
LOADING											
TOTAL LOAD CASES: (4)											
CHORDS											
MEMB.		MAX. FACTORED		FACTORED		VERT. LOAD		LC1 MAX		MAX. FACTORED	
		FORCE		(PLF)		CSI (LC)		UNBRAC		MEMB. MAX. FACTORED	
		(LBS)								(LBS) CSI (LC)	
FR-TO		FROM		TO		LENGTH		FR-TO			
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00	D-I	0 / 496	0.11 (1)			
B-C	0 / 38	-95.2	-95.2	0.56 (1)	10.00	I-E	-368 / 0	0.12 (1)			
C-D	-1566 / 0	-95.2	-95.2	0.57 (1)	4.58	K-D	0 / 496	0.11 (1)			
D-E	-1566 / 0	-95.2	-95.2	0.57 (1)	4.58	C-K	-368 / 0	0.12 (1)			
E-F	0 / 38	-95.2	-95.2	0.56 (1)	10.00	L-C	-1964 / 0	0.77 (1)			
F-G	0 / 29	-95.2	-95.2	0.12 (1)	10.00	E-H	-1964 / 0	0.77 (1)			
L-B	-268 / 0	0.0	0.0	0.03 (1)	7.81						
H-F	-268 / 0	0.0	0.0	0.03 (1)	7.81						
L-K	0 / 1623	-18.5	-18.5	0.39 (1)	10.00						
K-J	0 / 1127	-18.5	-18.5	0.34 (4)	10.00						
J-I	0 / 1127	-18.5	-18.5	0.34 (4)	10.00						
I-H	0 / 1623	-18.5	-18.5	0.39 (1)	10.00						
DESIGN CRITERIA											
SPECIFIED LOADS:											
TOP	CH.	LL	=	26.7	PSF						
		DL	=	6.0	PSF						
BOT	CH.	LL	=	0.0	PSF						
		DL	=	7.4	PSF						
TOTAL LOAD		=	40.1	PSF							
SPACING = 24.0 IN. C/C											
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015											
THIS DESIGN COMPLIES WITH:											
- PART 9 OF BCBC 2018, ABC 2019											
- PART 9 OF OBC 2012 (2019 AMENDMENT)											
- CSA 086-14											
- TPIC 2014											
(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD											
ALLOWABLE DEFL.(LL)= L/360 (0.76")											
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.06")											
ALLOWABLE DEFL.(TL)= L/360 (0.76")											
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.14")											
CSI: TC=0.57/1.00 (D-E:1) , BC=0.39/1.00 (H-I:1) ,											
WB=0.77/1.00 (E-H:1) , SSI=0.27/1.00 (C-D:1)											
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10											
COMP=1.10 SHEAR=1.10 TENS= 1.10											
COMPANION LIVE LOAD FACTOR = 1.00											
AUTOSOLVE HEELS OFF											
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .											
NAIL VALUES											
PLATE		GRIP(DRY)		SHEAR		SECTION					
		(PSI)		(PLI)		(PLI)					
		MAX MIN		MAX MIN		MAX MIN					
MT20		650 371		1747 788		1987 1873					
PLATE PLACEMENT TOL. = 0.250 inches											
PLATE ROTATION TOL. = 5.0 Deg.											
JSI GRIP= 0.89 (E) (INPUT = 0.90)											
JSI METAL= 0.42 (E) (INPUT = 1.00)											

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T5	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 08:44:43 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fnk-PW3QnNgN pYHTw RTmboi37?1zEoxipq3ZRkvjvryL2

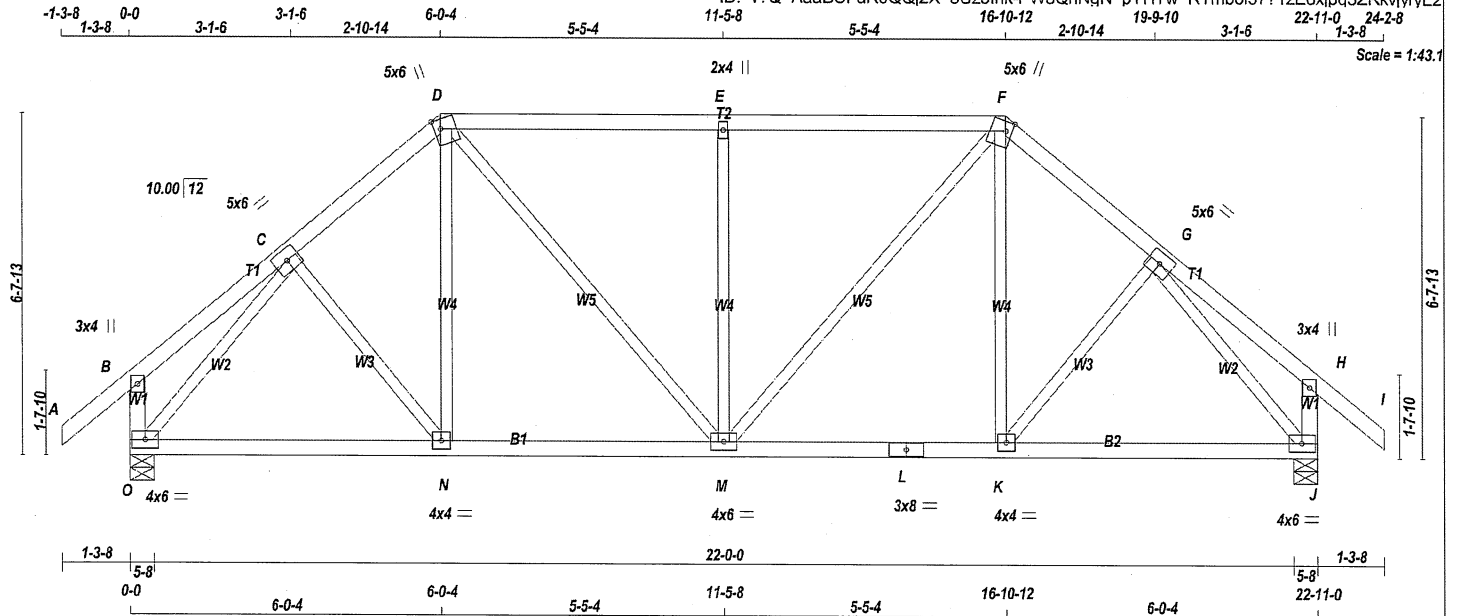

TOTAL WEIGHT = 2 X 106 = 212 lb

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS			
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	5.0	6.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.25	1.50
G	TMW-t	MT20	5.0	6.0		
H	TMV+p	MT20	3.0	4.0		
J	BMVW1-t	MT20	4.0	6.0		
K	BMW-t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	8.0		
M	BMW-t	MT20	4.0	6.0		
N	BMW-t	MT20	4.0	4.0		
O	BMVW1-t	MT20	4.0	6.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	RECORD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	UPLIFT
O	1435	0	1435	0
J	1435	0	1435	0

UNFACTORED REACTIONS

1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1010	687 / 0	0 / 0	0 / 0	0 / 0	324 / 0	0 / 0
J	1010	687 / 0	0 / 0	0 / 0	0 / 0	324 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.32 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED	FACTORED	MAX	MEMB.	MAX. FACTORED	MAX	
	FORCE	VERT. LOAD	LC1		FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)		(LBS)	CSI (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 42	-95.2	-95.2	0.13 (1)	C-N	0 / 47	0.02 (4)
B-C	0 / 19	-95.2	-95.2	0.12 (1)	N-D	0 / 103	0.04 (4)
C-D	-1223 / 0	-95.2	-95.2	0.11 (1)	K-F	0 / 103	0.04 (4)
D-E	-1231 / 0	-95.2	-95.2	0.38 (1)	K-G	0 / 47	0.02 (4)
E-F	-1231 / 0	-95.2	-95.2	0.38 (1)	O-C	-1458 / 0	0.54 (1)
F-G	-1223 / 0	-95.2	-95.2	0.11 (1)	G-J	-1458 / 0	0.54 (1)
G-H	0 / 19	-95.2	-95.2	0.12 (1)	M-F	0 / 472	0.11 (1)
H-I	0 / 42	-95.2	-95.2	0.13 (1)	D-M	0 / 472	0.11 (1)
O-B	-244 / 0	0.0	0.0	0.03 (1)	M-E	-632 / 0	0.46 (1)
J-H	-244 / 0	0.0	0.0	0.03 (1)			
O-N	0 / 902	-18.5	-18.5	0.23 (1)			
N-M	0 / 924	-18.5	-18.5	0.24 (1)			
M-L	0 / 924	-18.5	-18.5	0.24 (1)			
L-K	0 / 924	-18.5	-18.5	0.24 (1)			
K-J	0 / 902	-18.5	-18.5	0.23 (1)			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")
ALLOWABLE DEFL.(TL)= L/360 (0.76")
CALCULATED VERT. DEFL.(TL) = L/999 (0.07")

CSI: TC=0.38/1.00 (D-E:1), BC=0.24/1.00 (M-N:1), WB=0.54/1.00 (C-O:1), SSI=0.25/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.84 (J) (INPUT = 0.90)
JSI METAL= 0.32 (G) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080012

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T6	2	1	GREENPARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:44:44 2022 Page 1
ID: v?Q AaaDSFuR0QQi2X oUz5fkn-tido?ih?i7g844Zd0U61EHqCENZmg9GzIDAHRvryL1

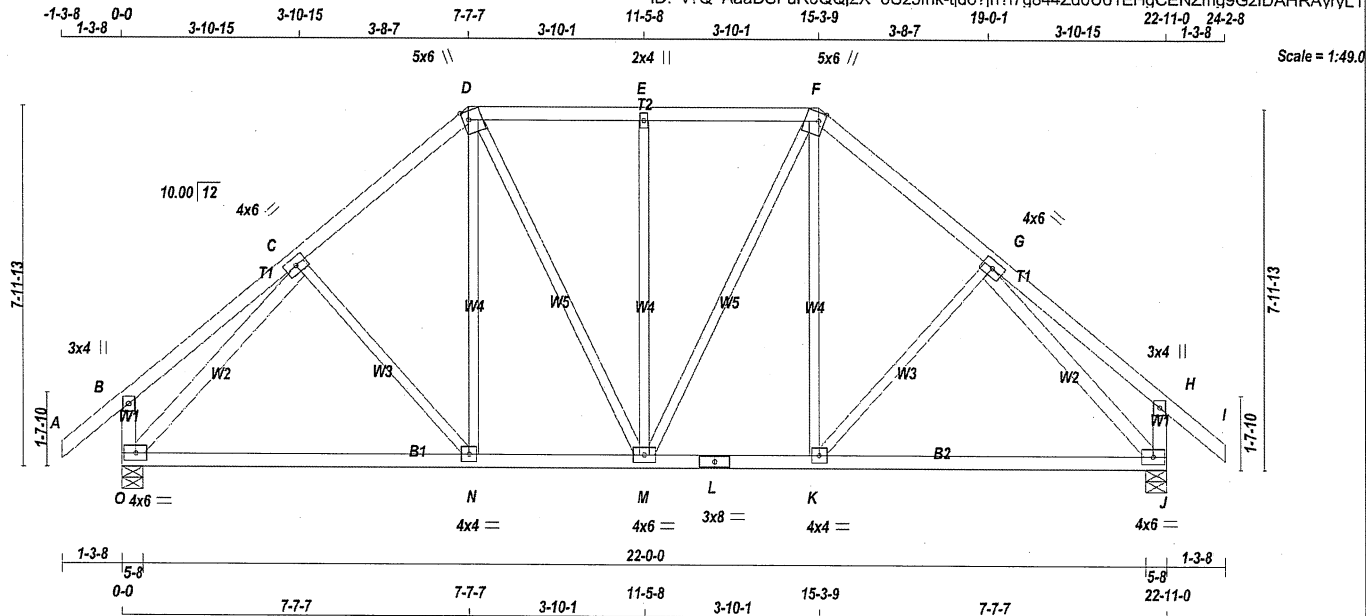

TOTAL WEIGHT = 2 X 118 = 235 lb

LUMBER N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
F - I	2x4	DRY	No.2
O - B	2x4	DRY	No.2
J - H	2x4	DRY	No.2
O - L	2x4	DRY	No.2
L - J	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
EXCEPT			
O - C	2x4	DRY	No.2
G - J	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWw-t	MT20	4.0	6.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMWw	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.25	1.50
G	TMWw-t	MT20	4.0	6.0		
H	TMV+p	MT20	3.0	4.0		
J	BMWw1-t	MT20	4.0	6.0		
K	BMWw-t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	8.0		
M	BMWwW-t	MT20	4.0	6.0		
N	BMWw-t	MT20	4.0	4.0		
O	BMVW1-t	MT20	4.0	6.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER								
BEARINGS								
	FACTORED		MAXIMUM FACTORED			INPUT	REQRD	
	GROSS REACTION		GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
O	1435	0	1435	0	0	5-8	5-8	
J	1435	0	1435	0	0	5-8	5-8	

UNFACTORED REACTIONS

1ST LCASE		MAX./MIN. COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1010	687 / 0	0 / 0	0 / 0	0 / 0	324 / 0	0 / 0
J	1010	687 / 0	0 / 0	0 / 0	0 / 0	324 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.70 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 / 42	-95.2	-95.2	0.13 (1)	10.00	C-N	-98 / 15
B-C	0 / 27	-95.2	-95.2	0.22 (1)	10.00	N-D	0 / 225
C-D	-1168 / 0	-95.2	-95.2	0.19 (1)	5.70	K-F	0 / 225
D-E	-988 / 0	-95.2	-95.2	0.18 (1)	6.07	K-G	-98 / 15
E-F	-988 / 0	-95.2	-95.2	0.18 (1)	6.07	O-C	-1452 / 0
F-G	-1168 / 0	-95.2	-95.2	0.19 (1)	5.70	G-J	-1452 / 0
G-H	0 / 27	-95.2	-95.2	0.22 (1)	10.00	M-F	0 / 247
H-I	0 / 42	-95.2	-95.2	0.13 (1)	10.00	D-M	0 / 247
O-B	-269 / 0	0.0	0.0	0.03 (1)	7.81	M-E	-438 / 0
J-H	-269 / 0	0.0	0.0	0.03 (1)	7.81		
O-N	0 / 940	-18.5	-18.5	0.31 (4)	10.00		
N-M	0 / 878	-18.5	-18.5	0.32 (4)	10.00		
M-L	0 / 878	-18.5	-18.5	0.32 (4)	10.00		
L-K	0 / 878	-18.5	-18.5	0.32 (4)	10.00		
K-J	0 / 940	-18.5	-18.5	0.31 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2015, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")
ALLOWABLE DEFL.(TL)= L/360 (0.76")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.22/1.00 (B-C:1), BC=0.32/1.00 (M-N:4), WB=0.59/1.00 (C-O:1), SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.32 (G) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080013

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T7	1	2	GREENPARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:26 2022 Page 1
 ID: v?Q AaaDSFuR0Qj2X oUz5fink-eo9hp4CLs1zB7XmiUlstx8PFcluxWDF9yIMWvkryKN
 -1-3-8 0-0 4-5-0 4-5-0 7-0-8 11-5-8 2-4-12 13-10-4 2-0-0 15-10-4 17-10-4 18-6-0 22-11-0 24-2-8
 1-3-8 1-3-8 4-5-0 4-5-0 7-0-8 11-5-8 2-4-12 13-10-4 2-0-0 15-10-4 17-10-4 18-6-0 22-11-0 24-2-8
 Scale = 1:42.5

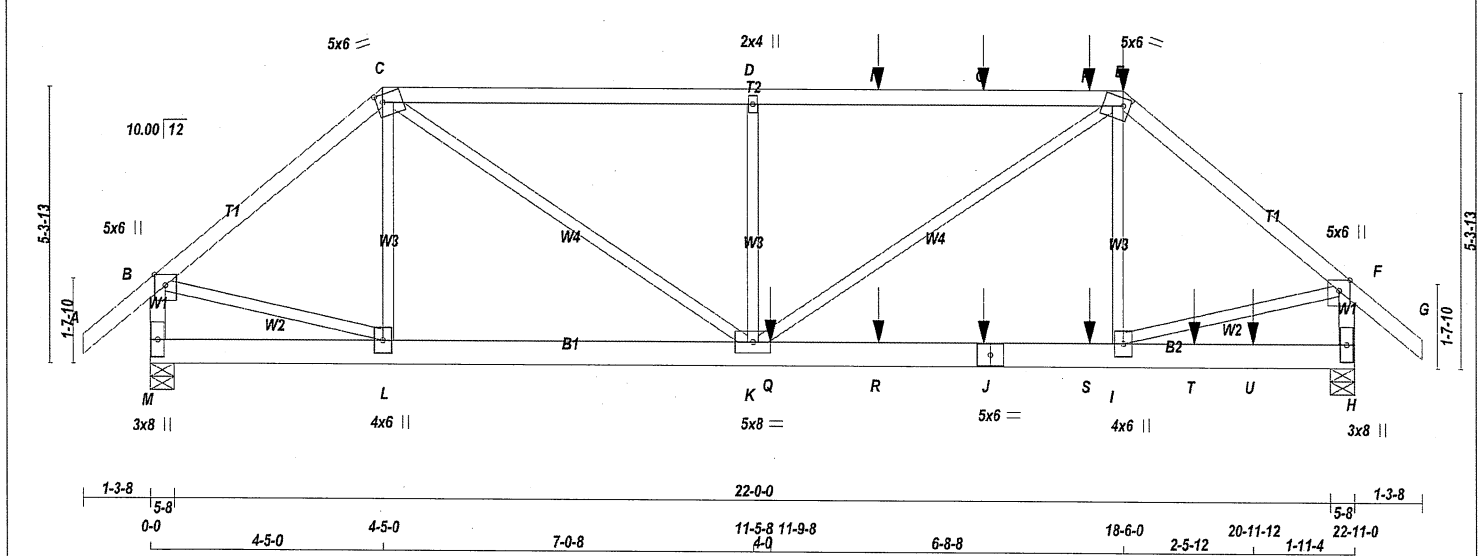

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - E	2x4	DRY	No.2	SPF	
E - G	2x4	DRY	No.2	SPF	
M - B	2x4	DRY	No.2	SPF	
H - F	2x4	DRY	No.2	SPF	
M - J	2x6	DRY	No.2	SPF	
J - H	2x6	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF
 EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - E 1	12	SIDE(61.0)
E - G 1	12	SIDE(61.0)
M - B 1	12	TOP
H - F 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
M - J 2	12	SIDE(183.1)
J - H 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	
D - K 1	6	SIDE(176.5)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
M	2310	0	2310	0
H	2776	0	2776	0

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW
M	1625	1118 / 0
H	1954	1336 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.02 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 42	-95.2 -95.2 0.07 (1)	L-C	-372 / 0
B-C	-2281 / 0	-95.2 -95.2 0.21 (1)	C-K	0 / 2411
C-D	-3715 / 0	-95.2 -95.2 0.73 (1)	K-D	-980 / 0
D-N	-3716 / 0	-95.2 -95.2 0.73 (1)	K-E	0 / 1879
N-O	-3716 / 0	-95.2 -95.2 0.73 (1)	I-E	-276 / 81
O-P	-3716 / 0	-95.2 -95.2 0.73 (1)	B-L	0 / 1810
P-E	-3716 / 0	-95.2 -95.2 0.73 (1)	I-F	0 / 2259
E-F	-2847 / 0	-95.2 -95.2 0.23 (1)		
F-G	0 / 42	-95.2 -95.2 0.07 (1)		
M-B	-2277 / 0	0.0 0.0 0.13 (1)		
H-F	-2758 / 0	0.0 0.0 0.16 (1)		
M-L	0 / 0	-18.5 -18.5 0.03 (4)		
L-K	0 / 1740	-18.5 -18.5 0.17 (1)		
K-Q	0 / 2176	-18.5 -18.5 0.26 (1)		
Q-R	0 / 2176	-18.5 -18.5 0.26 (1)		
R-J	0 / 2176	-18.5 -18.5 0.26 (1)		
J-S	0 / 2176	-18.5 -18.5 0.26 (1)		
S-I	0 / 2176	-18.5 -18.5 0.26 (1)		
I-T	0 / 0	-18.5 -18.5 0.09 (4)		
T-U	0 / 0	-18.5 -18.5 0.09 (4)		
U-H	0 / 0	-18.5 -18.5 0.09 (4)		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	18-6-0	-44	-44	---	FRONT	VERT	DEAD	---	C1
E	18-6-0	-192	-192	---	FRONT	VERT	SNOW	---	C1
J	15-10-4	-22	-22	---	FRONT	VERT	TOTAL	---	C1
N	13-10-4	-79	-79	---	FRONT	VERT	TOTAL	---	C1
O	15-10-4	-79	-79	---	FRONT	VERT	TOTAL	---	C1
P	17-10-4	-90	-90	---	FRONT	VERT	TOTAL	---	C1
Q	11-9-8	-965	-965	---	FRONT	VERT	TOTAL	---	C1
R	13-10-4	-22	-22	---	FRONT	VERT	TOTAL	---	C1
S	17-10-4	-22	-22	---	FRONT	VERT	TOTAL	---	C1
T	19-10-4	-22	-22	---	FRONT	VERT	TOTAL	---	C1
U	20-11-12	-22	-22	---	FRONT	VERT	TOTAL	---	C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:

TOP CH. LL = 26.7 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
 ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF CBC 2018, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-14
 - TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD
 ALLOWABLE DEFL.(LL)= L/360 (0.76")
 CALCULATED VERT. DEFL.(LL)= L/999 (0.06")
 ALLOWABLE DEFL.(TL)= L/360 (0.76")
 CALCULATED VERT. DEFL.(TL)= L/999 (0.12")

CSI: TC=0.73/1.00 (D-E-1), BC=0.26/1.00 (H-K-1), WB=0.30/1.00 (C-K-1), SSI=0.46/1.00 (H-K-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (I) (INPUT = 0.90)
 JSI METAL= 0.51 (B) (INPUT = 1.00)

CONTINUED ON PAGE 2

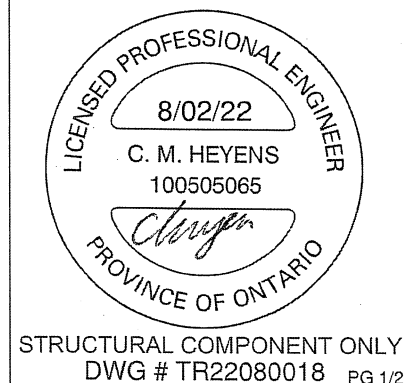

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T7	1	2	GREENPARK HOMES	
				TRUSS DESC.	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TTWW-m	MT20	5.0	6.0	1.75	1.50
D	TMW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	1.75	1.50
F	TMVW+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	8.0		
I	BMWW+t	MT20	4.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BMWWW-t	MT20	5.0	8.0		
L	BMWW+t	MT20	4.0	6.0		
M	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	T7Z	1	2	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 08:55:41 2022 Page 2
ID: v?Q_AaaDSFuR0QQj2X_oUz5fnk-86qAuMe61_SwP2Hv0yQ5MqNLhCo26M5gNwqY_byryAm

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge	
C	TTWW-m	MT20	5.0	8.0	Edge	3.00
D	TMW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	Edge	3.00
F	TMVW+p	MT20	5.0	6.0	Edge	
H	BMV1+p	MT20	3.0	8.0		
I	BMWW-t	MT20	5.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BMWWW-t	MT20	5.0	8.0		
L	BMWW-t	MT20	5.0	6.0		
M	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE
TOUCHES EDGE OF CHORD.


NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

CONNECTION REQUIREMENTS
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T8	1	2	GREENPARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:26 2022 Page 1
ID: v?Q AaaDSFuR0Qqj2X oUz5fmk-eo9hp4CLs1zB7XmiUlsb8PPulu3WEa9yIMWvkrykN

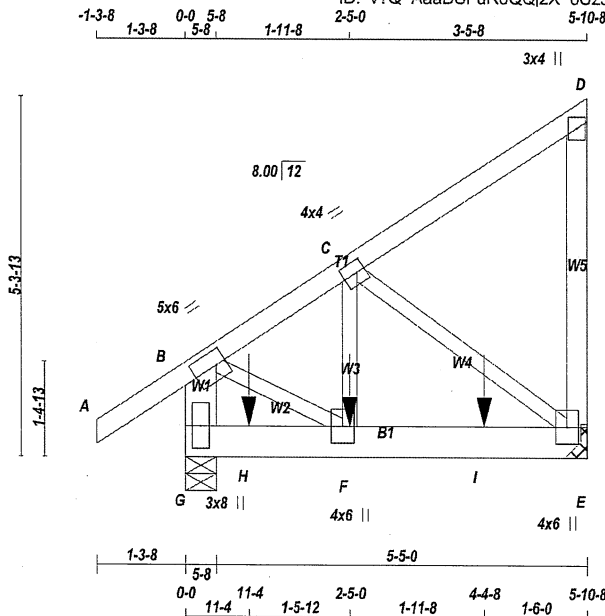

Scale = 1:32.7

TOTAL WEIGHT = 2 X 34 = 68 lb

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x4 DRY No.2 SPF E - D 2x4 DRY No.2 SPF G - B 2x6 DRY No.2 SPF G - E 2x6 DRY No.2 SPF ALL WEBS 2x3 DRY No.2 SPF DRY: SEASONED LUMBER. DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS: CHORDS #ROWS SURFACE SPACING (IN) LOAD (PLF) TOP CHORDS : (0.122"x3") SPIRAL NAILS A-D 1 12 TOP D-E 1 12 TOP G-B 2 12 TOP BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS G-E 2 12 SIDE (183.1) WEBS : (0.122"x3") SPIRAL NAILS C-F 1 6 SIDE (59.0) 2x3 1 6 NAILS TO BE DRIVEN FROM ONE SIDE ONLY. GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS. TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY. SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP. PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMVW-t MT20 5.0 6.0 2.50 1.75 C TMVW-t MT20 4.0 4.0 2.00 1.50				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX E 1397 0 1397 0 0 MECHANICAL G 1751 0 1751 0 0 5-8 5-8 A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 4-0. UNFACTORED REACTIONS 1ST LCASE MAX/MIN COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL E 980 686 / 0 0 / 0 0 / 0 294 / 0 0 / 0 G 1226 873 / 0 0 / 0 0 / 0 353 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS MAX. FACTORED WEBS MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. FORCE MAX. (LBS) (PLF) CSI (LC) UNBRAC (LBS) CSI (LC) FR-TO FROM TO LENGTH FR-TO A-B 0 / 36 -95.2 -95.2 0.07 (1) 10.00 B-F 0 / 1229 0.15 (1) B-C -1345 / 0 -95.2 -95.2 0.07 (1) 6.25 C-E -1423 / 0 0.21 (1) C-D -15 / 0 -95.2 -95.2 0.08 (1) 6.25 F-C 0 / 1271 0.16 (1) E-D -138 / 0 0.0 0.0 0.03 (1) 7.81 G-B -1434 / 0 0.0 0.0 0.05 (1) 7.81 G-H 0 / 0 -18.5 -18.5 0.11 (1) 10.00 H-F 0 / 0 -18.5 -18.5 0.11 (1) 10.00 F-I 0 / 1136 -18.5 -18.5 0.29 (1) 10.00 I-E 0 / 1136 -18.5 -18.5 0.29 (1) 10.00 SPECIFIED CONCENTRATED LOADS (LBS) JT LOC. LC1 MAX- MAX+ FACE DIR. TYPE HEEL CONN. F 2-5-0 -650 -650 --- BACK VERT TOTAL --- C1 H 11-4 -451 -451 --- BACK VERT TOTAL --- C1 I 4-4-8 -544 -544 --- BACK VERT TOTAL --- C1 CONNECTION REQUIREMENTS 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 26.7 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 40.1 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 (55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.20") CALCULATED VERT. DEFL.(LL) = L/999 (0.01") ALLOWABLE DEFL.(TL)= L/360 (0.20") CALCULATED VERT. DEFL.(TL) = L/999 (0.02") CSI: TC=0.08/1.00 (C-D:1), BC=0.29/1.00 (E-F:1), WB=0.21/1.00 (C-E:1), SSI=0.15/1.00 (E-F:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE RIGHT HEEL ONLY TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT. NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.76 (C) (INPUT = 0.90) JSI METAL= 0.26 (E) (INPUT = 1.00)			
---	--	--	--	---	--	--	--	--	--	--	--



STRUCTURAL COMPONENT ONLY
DWG # TR22080019 PG 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T8	1	2	GREENPARK HOMES	
				TRUSS DESC.	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
D	TMV+p	MT20	3.0	4.0		
E	BMVW1+p	MT20	4.0	6.0		
F	BMWW+t	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	8.0		


NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T9	1	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:27 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fkn-6 j31QCzdL52lhLu20N6ULxVhIGzFj IBP53RAyryKM

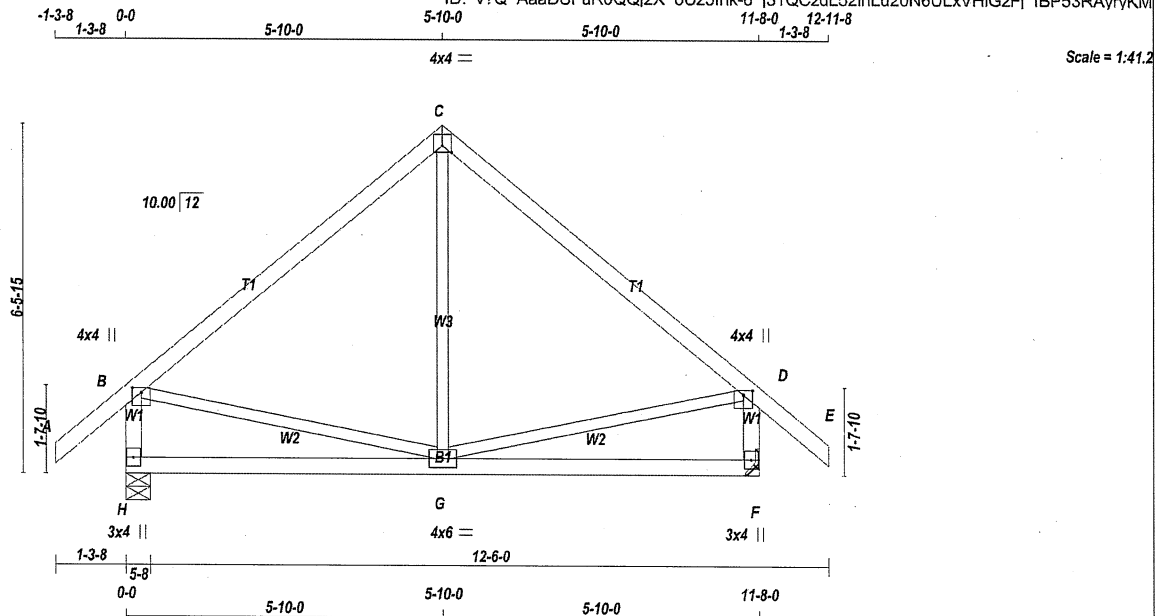

TOTAL WEIGHT = 52 lb

LUMBER **DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER** **DESIGN CRITERIA**

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
H - D	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	1.50	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-l	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
H	795	0	795	0
F	795	0	795	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	COMBINED						
H	559	386 / 0	0 / 0	0 / 0	0 / 0	173 / 0	0 / 0
F	559	386 / 0	0 / 0	0 / 0	0 / 0	173 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED LC1 (LC)	
FR-TO		FROM	TO	FR-TO			
A-B	0 / 42	-95.2	-95.2 0.13 (1)	G-C	-12 / 98	0.03 (4)	
B-C	-424 / 0	-95.2	-95.2 0.42 (1)	B-G	0 / 334	0.08 (1)	
C-D	-424 / 0	-95.2	-95.2 0.42 (1)	G-D	0 / 334	0.08 (1)	
D-E	0 / 42	-95.2	-95.2 0.13 (1)				
H-B	-754 / 0	0.0	0.0 0.08 (1)				
F-D	-754 / 0	0.0	0.0 0.08 (1)				
H-G	0 / 0	-18.5	-18.5 0.18 (4)				
G-F	0 / 0	-18.5	-18.5 0.18 (4)				

SPECIFIED LOADS:

TOP CH.	LL	=	26.7	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	40.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.39")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.42/1.00 (B-C:1), BC=0.18/1.00 (G-H:4),
WB=0.08/1.00 (D-G:1), SSI=0.17/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.63 (D) (INPUT = 0.90)
JSI METAL= 0.17 (D) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080020

JOB NAME 427257	TRUSS NAME T10	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

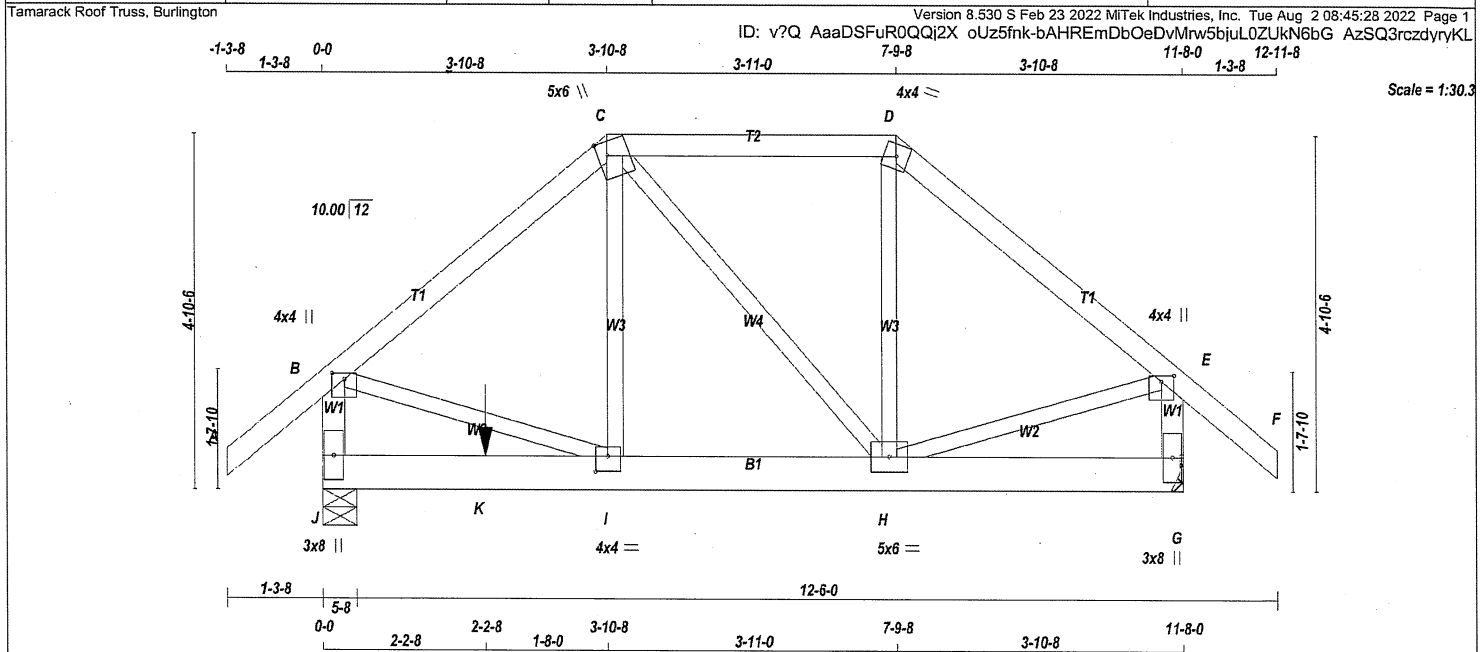

TOTAL WEIGHT = 2 X 61 = 122 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
J - G	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - D 1	12	TOP
D - F 1	12	TOP
J - B 1	12	TOP
G - E 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
J - G 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	BRG	IN-SX
J	1443	0	1443	0	0	5-8	5-8		
G	946	0	946	0	0	MECHANICAL			

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 2-0.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
J	1012	713 / 0 0 / 0 0 / 0 0 / 0 300 / 0 0 / 0
G	665	462 / 0 0 / 0 0 / 0 0 / 0 203 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

C H O R D S				W E B S				
MAX. FACTORED		FACTORED		MAX. FACTORED				
MEMB.	FORCE	VERT. LOAD	LC1 MAX	MAX.	MEMB.	FORCE	MAX	
	(LBS)	(PLF)	CSI (LC)	UNBRAC		(LBS)	CSI (LC)	
FR-TO		FROM TO		LENGTH	FR-TO			
A-B	0 / 42	-95.2	-95.2	0.07 (1)	10.00	I-C	0 / 469	0.06 (1)
B-C	-925 / 0	-95.2	-95.2	0.14 (1)	6.25	C-H	-323 / 0	0.09 (1)
C-D	-509 / 0	-95.2	-95.2	0.14 (1)	6.25	H-D	0 / 73	0.01 (4)
D-E	-663 / 0	-95.2	-95.2	0.14 (1)	6.25	B-I	0 / 741	0.09 (1)
E-F	0 / 42	-95.2	-95.2	0.07 (1)	10.00	H-E	0 / 531	0.07 (1)
J-B	-1127 / 0	0.0	0.0	0.06 (1)	7.81			
G-E	-898 / 0	0.0	0.0	0.05 (1)	7.81			
J-K	0 / 0	-18.5	-18.5	0.24 (1)	10.00			
K-I	0 / 0	-18.5	-18.5	0.24 (1)	10.00			
I-H	0 / 719	-18.5	-18.5	0.16 (1)	10.00			
H-G	0 / 0	-18.5	-18.5	0.02 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
K	2-2-8	-559	-559		FRONT	VERT	TOTAL		C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	26.7	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	40.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.14/1.00 (B-C:1), BC=0.24/1.00 (I-J:1), WB=0.09/1.00 (C-H:1), SSI=0.18/1.00 (H-J:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.52 (I) (INPUT = 0.90)
JSI METAL= 0.14 (B) (INPUT = 1.00)

CONTINUED ON PAGE 2



STRUCTURAL COMPONENT ONLY
DWG # TR22080021 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T10	1	2	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:28 2022 Page 2
ID: v?Q AaaDSFuR0QQj2X oUz5fnk-bAHREmDbOeDvMrw5bjuL0ZUkN6bG AzSQ3rczdynyKL

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	3.0	8.0		
H	BMWWW-t	MT20	5.0	6.0		
I	BMWW-t	MT20	4.0	4.0	2.50	2.00
J	BMV1+p	MT20	3.0	8.0		


NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T11	1	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:29 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fnk-3NrpR5ED9yLm ?VH9QPzAm1t9VzUjembejaAW3yryKK

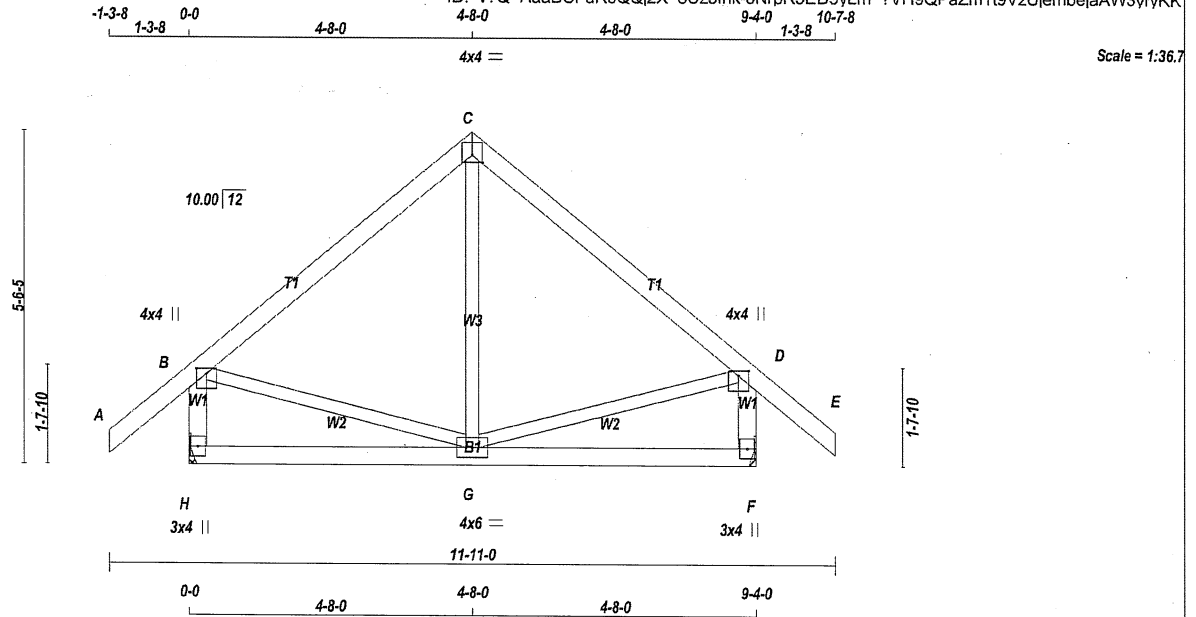

TOTAL WEIGHT = 43 lb
(M)F

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	1.50	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

NOTES-

(1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED	MAXIMUM FACTORED	INPUT	REQD
	GROSS REACTION	GROSS REACTION	BRG	BRG
JT	VERT	HORZ	DOWN	HORZ
H	662	0	662	0
F	662	0	662	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H, F. MINIMUM BEARING LENGTH AT JOINT H = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	465	324 / 0	0 / 0	0 / 0	0 / 0	142 / 0	0 / 0
F	465	324 / 0	0 / 0	0 / 0	0 / 0	142 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (LC)	
FR-TO		FROM	TO	FR-TO		FROM	TO
A-B	0 / 42	-95.2	-95.2	0.13 (1)	10.00	G-C	-32 / 70
B-C	-322 / 0	-95.2	-95.2	0.27 (1)	6.25	B-G	0 / 257
C-D	-322 / 0	-95.2	-95.2	0.27 (1)	6.25	G-D	0 / 257
D-E	0 / 42	-95.2	-95.2	0.13 (1)	10.00		
H-B	-629 / 0	0.0	0.0	0.07 (1)	7.81		
F-D	-629 / 0	0.0	0.0	0.07 (1)	7.81		
H-G	0 / 0	-18.5	-18.5	0.11 (4)	10.00		
G-F	0 / 0	-18.5	-18.5	0.11 (4)	10.00		

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	26.7	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	40.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.31")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.31")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.27/1.00 (B-C:1), BC=0.11/1.00 (G-H:4), WB=0.06/1.00 (D-G:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
		788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.51 (B) (INPUT = 0.90)
JSI METAL= 0.14 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080022

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T12	1	2	GREENPARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:30 2022 Page 1	

ID: v?Q AaaDSFuR0QQj2X oUz5fmk-XZPBfRFrWFTdc84Tj8xp5 Z5LvJdS4TktNKj2VvryKJ

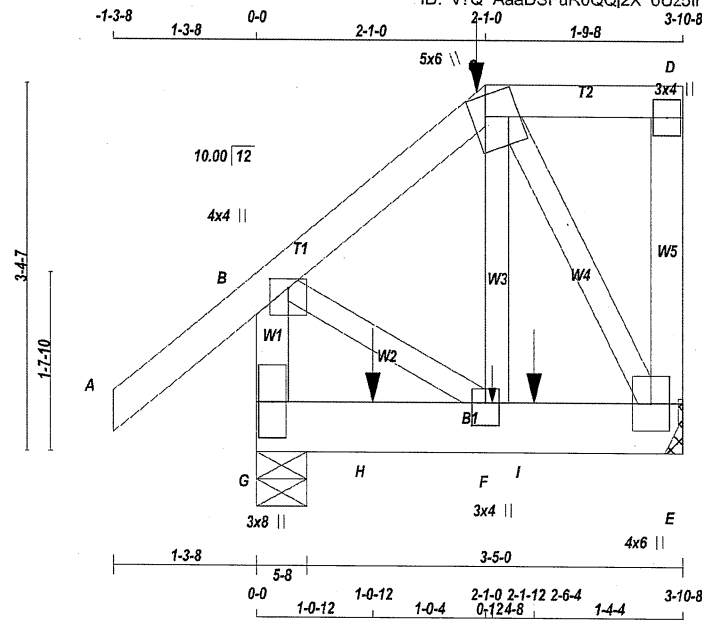

TOTAL WEIGHT = 2 X 25 = 49 lb [M]

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - D	2x4	DRY	No.2	SPF
E - B	2x4	DRY	No.2	SPF
G - B	2x4	DRY	No.2	SPF
G - E	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	SIDE(61.0)
C - D 1	12	SIDE(61.0)
D - E 1	12	TOP
G - B 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
G - E 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
E	818	0	818	0
G	1046	0	1046	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 2-0.

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERMLIVE WIND DEAD SOIL
E	574	403 / 0 0 / 0 0 / 0 0 / 0 171 / 0 0 / 0
G	732	526 / 0 0 / 0 0 / 0 0 / 0 206 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 42	-95.2 -95.2	0.11 (5)	10.00	F-C	0 / 750	0.09 (1)
B-C	-467 / 0	-95.2 -95.2	0.04 (1)	6.25	C-E	-743 / 0	0.08 (1)
C-D	0 / 0	-95.2 -95.2	0.03 (1)	10.00	B-F	0 / 409	0.05 (1)
E-D	-85 / 0	0.0 0.0	0.01 (1)	7.81			
G-B	-731 / 0	0.0 0.0	0.04 (1)	7.81			
G-H	0 / 0	-18.5 -18.5	0.12 (1)	10.00			
H-F	0 / 0	-18.5 -18.5	0.12 (1)	10.00			
F-I	0 / 383	-18.5 -18.5	0.07 (1)	10.00			
I-E	0 / 383	-18.5 -18.5	0.07 (1)	10.00			

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-1-0	-3	-3	---	BACK	VERT	TOTAL	---	C1
F	2-1-12	1	1	---	BACK	VERT	TOTAL	---	C1
H	1-0-12	-450	-450	---	TOP	VERT	TOTAL	---	C1
I	2-6-4	-450	-450	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 26.7	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 40.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.11/1.00 (A-B:5), BC=0.12/1.00 (F-G:1), WB=0.09/1.00 (C-F:1), SSI=0.19/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	PSI	PLI	SECTION
			MAX MIN MAX MIN MAX MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (F) (INPUT = 0.90)
JSI METAL = 0.13 (F) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080023 PG 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T12	1	2	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:30 2022 Page 2
ID: v?Q AaaDSFuR0QQj2X oUz5fnk-XZPBfRFwFTdc84Tj8xp5 Z5LvJdS4TktNKj2VvryKJ

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TMV+p	MT20	3.0	4.0		
E	BMVW1+p	MT20	4.0	6.0		
F	BMWW+t	MT20	3.0	4.0	2.50	1.50
G	BMV1+p	MT20	3.0	8.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.




JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T13S	2	1	GREENPARK HOMES	
				TRUSS DESC.	


Tamarack Roof Truss, Burlington

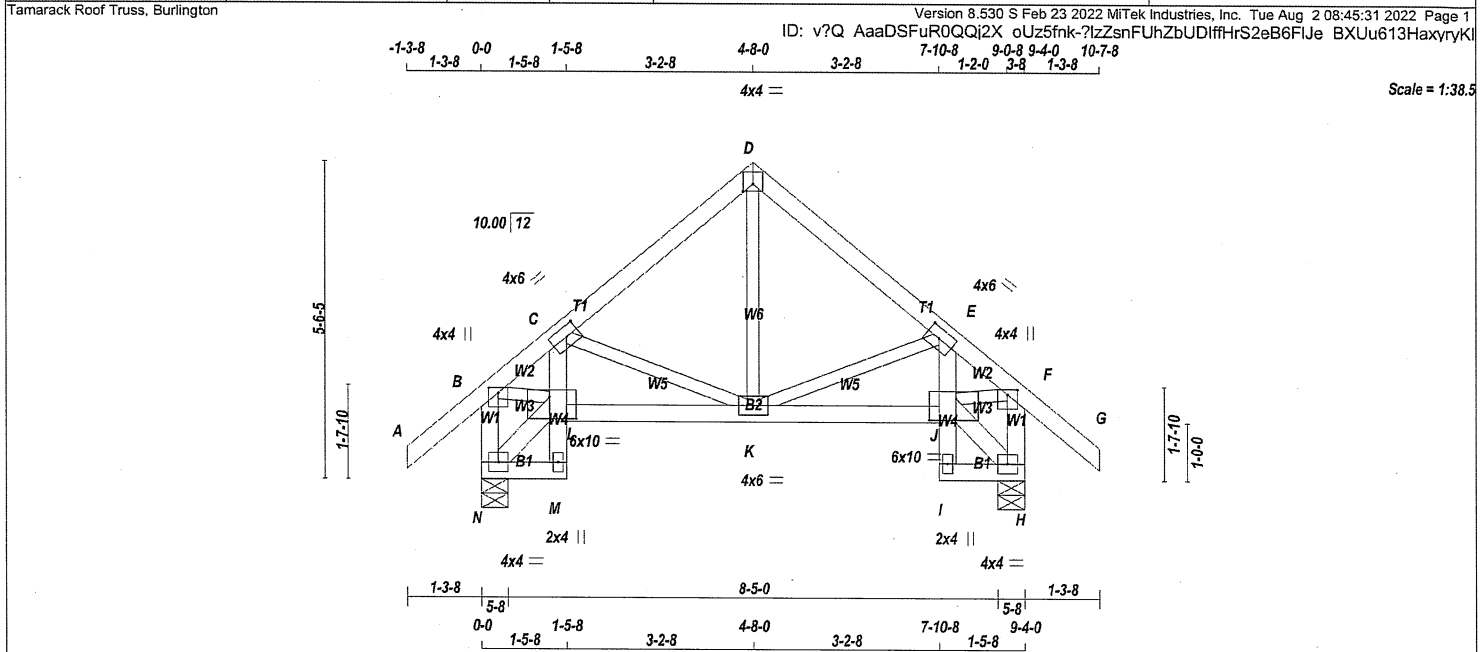

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. A - D 2x4 DRY No.2 SPF D - G 2x4 DRY No.2 SPF N - B 2x4 DRY No.2 SPF H - F 2x4 DRY No.2 SPF N - M 2x4 DRY No.2 SPF L - J 2x4 DRY No.2 SPF I - H 2x4 DRY No.2 SPF ALL WEBS 2x4 DRY No.2 SPF EXCEPT K - D 2x3 DRY No.2 SPF K - E 2x3 DRY No.2 SPF C - K 2x3 DRY No.2 SPF B - L 2x3 DRY No.2 SPF J - F 2x3 DRY No.2 SPF DRY: SEASONED LUMBER. PLATES (table is in inches) JT TYPE PLATES W LEN Y X B TMVW+p MT20 4.0 4.0 1.00 2.00 C TMWW-t MT20 4.0 6.0 2.00 2.75 D TTW-p MT20 4.0 4.0 1.50 2.00 E TMWW-t MT20 4.0 6.0 2.00 2.75 F TMVW+p MT20 4.0 4.0 1.00 2.00 H BMVW-t MT20 4.0 4.0 I BMW+w MT20 2.0 4.0 J BMVWW-t MT20 6.0 10.0 4.50 5.50 K BMVWW-t MT20 4.0 6.0 L BMVWW-t MT20 6.0 10.0 4.50 5.50 M BMW+w MT20 2.0 4.0 N BMVW-t MT20 4.0 4.0 NOTES- (1) 1) Lateral braces to be a minimum of 2X4 SPF #2.				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS FACTORED MAXIMUM FACTORED INPUT REQD GROSS REACTION GROSS REACTION BRG BRG JT VERT HORZ DOWN HORZ UPLIFT IN-SX IN-SX N 662 0 662 0 0 5-8 5-8 H 662 0 662 0 0 5-8 5-8 UNFACTORED REACTIONS 1ST CASE MAX./MIN. COMPONENT REACTIONS JT COMBINED SNOW LIVE PERM.LIVE WIND DEAD SOIL N 465 324 / 0 0 / 0 0 / 0 142 / 0 0 / 0 H 465 324 / 0 0 / 0 0 / 0 142 / 0 0 / 0 BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, H BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. MAX. UNBRACED INTERIOR CHORD LENGTH = 10.00 FT ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (4) CHORDS WEBS MAX. FACTORED MAX. FACTORED MAX. FACTORED MEMB. FORCE VERT. LOAD LC1 MAX. MAX. MEMB. FORCE MAX. (LBS) (PLF) CSI (LC) UNBRAC LENGTH FR-TO (LBS) CSI (LC) FR-TO FROM TO A-B 0 / 42 -95.2 -95.2 0.13 (1) 10.00 M-L 0 / 14 0.03 (1) B-C -627 / 0 -95.2 -95.2 0.10 (1) 6.25 L-C 0 / 35 0.03 (1) C-D -378 / 0 -95.2 -95.2 0.13 (1) 6.25 I-J 0 / 14 0.03 (1) D-E -378 / 0 -95.2 -95.2 0.13 (1) 6.25 J-E 0 / 35 0.03 (1) E-F -627 / 0 -95.2 -95.2 0.10 (1) 6.25 K-D 0 / 190 0.04 (1) F-G 0 / 42 -95.2 -95.2 0.13 (1) 10.00 K-E -233 / 0 0.06 (1) N-B -633 / 0 0.0 0.0 0.07 (1) 7.81 C-K -233 / 0 0.06 (1) H-F -633 / 0 0.0 0.0 0.07 (1) 7.81 N-L -25 / 0 0.00 (1) N-M 0 / 18 -18.5 -18.5 0.01 (4) 10.00 J-H -25 / 0 0.00 (1) L-K 0 / 495 -18.5 -18.5 0.11 (1) 10.00 J-F 0 / 476 0.11 (1) K-J 0 / 495 -18.5 -18.5 0.11 (1) 10.00 I-H 0 / 18 -18.5 -18.5 0.01 (4) 10.00				DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 26.7 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 40.1 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF CBC 2018, ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.31") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01") ALLOWABLE DEFL.(TL)= L/360 (0.31") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01") CSI: TC=0.13/1.00 (A-B:1), BC=0.11/1.00 (K-L:1), WB=0.11/1.00 (B-L:1), SSI=0.11/1.00 (C-D:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE HEELS OFF TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.68 (F) (INPUT = 0.90) JSI METAL= 0.19 (F) (INPUT = 1.00)			
--	--	--	--	---	--	--	--	--	--	--	--

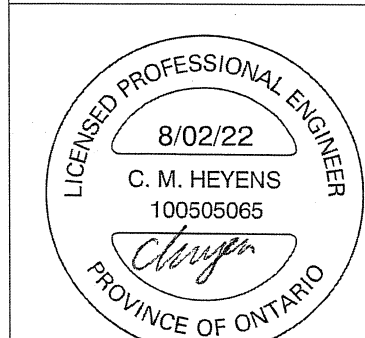

STRUCTURAL COMPONENT ONLY
DWG # TR22080024

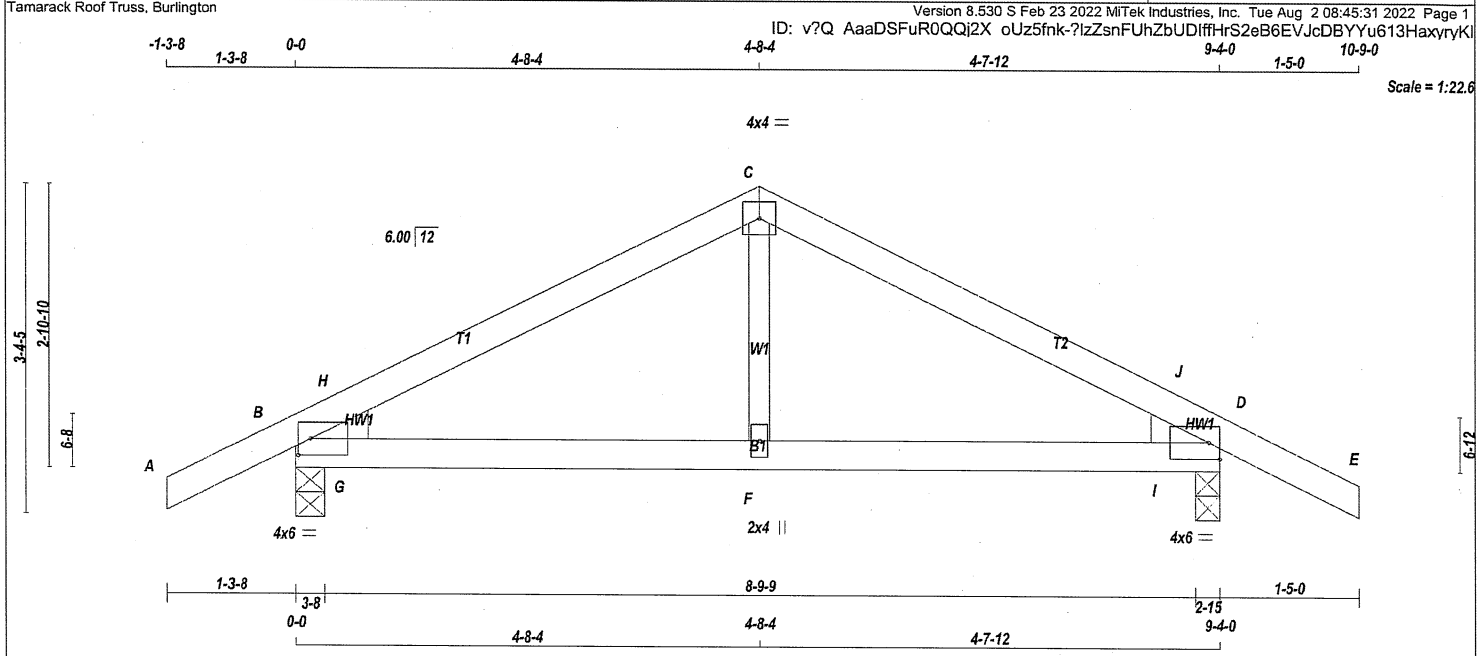

LUMBER							TOTAL WEIGHT = 3 X 30 = 89 lb																	
N. L. G. A. RULES							[M][F]																	
CHORDS			SIZE		LUMBER		DESCR.																	
A - C			2x4		DRY		No.2		SPF															
C - E			2x4		DRY		No.2		SPF															
B - D			2x4		DRY		No.2		SPF															
ALL WEBS			2x3		DRY		No.2		SPF															
DRY: SEASONED LUMBER.																								
PLATES (table is in inches)																								
JT			TYPE		PLATES		W		LEN		Y		X											
B			TMBH1-I		MT20		4.0		6.0		2.00		1.50											
C			TTW-p		MT20		4.0		4.0															
D			TMBH1-I		MT20		4.0		6.0				Edge											
F			BMW+w		MT20		2.0		4.0															
Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.																								
NOTES- (1)																								
1) Lateral braces to be a minimum of 2X4 SPF #2.																								
DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER																								
BEARINGS																								
			FACTORED		MAXIMUM FACTORED		INPUT		REQRD															
			GROSS REACTION		GROSS REACTION		BRG		BRG		HEEL													
JT			VERT		HORZ		DOWN		HORZ		UPLIFT		IN-SX		IN-SX		WEDGE							
B			660		0		660		0		0		3-8		3-8		2x4 L							
D			672		0		672		0		0		2-15		2-15		2x4 R							
UNFACTORED REACTIONS																								
			1ST LCASE		MAX./MIN. COMPONENT REACTIONS																			
JT			COMBINED		SNOW		LIVE		PERM.LIVE		WIND		DEAD		SOIL									
B			463		322 / 0		0 / 0		0 / 0		0 / 0		141 / 0		0 / 0									
D			472		329 / 0		0 / 0		0 / 0		0 / 0		143 / 0		0 / 0									
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D																								
BRACING																								
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.																								
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.																								
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.																								
LOADING																								
TOTAL LOAD CASES: (4)																								
			CHORDS						WEBS															
			MAX. FACTORED		FACTORED				MAX. FACTORED		MAX. FACTORED													
MEMB.			FORCE		VERT. LOAD		LC1 MAX		MAX.		MEMB.		FORCE		MAX									
			(LBS)		(PLF)		CSI (LC)		UNBRAC				(LBS)		CSI (LC)									
FR-TO					FROM TO				LENGTH		FR-TO													
A-B			0 / 20		-95.2 -95.2		0.12 (1)		10.00		F-C		0 / 171		0.04 (4)									
B-H			-592 / 0		-95.2 -95.2		0.10 (1)		6.25		G-H		-193 / 19		0.00 (1)									
H-C			-589 / 0		-95.2 -95.2		0.21 (1)		6.25		I-J		-185 / 24		0.00 (1)									
C-J			-590 / 0		-95.2 -95.2		0.21 (1)		6.25															
J-D			-593 / 0		-95.2 -95.2		0.11 (1)		6.25															
D-E			0 / 22		-95.2 -95.2		0.15 (1)		10.00															
B-G			0 / 518		-18.5 -18.5		0.22 (1)		10.00															
G-F			0 / 518		-18.5 -18.5		0.22 (1)		10.00															
F-I			0 / 518		-18.5 -18.5		0.21 (1)		10.00															
I-D			0 / 518		-18.5 -18.5		0.21 (1)		10.00															
DESIGN CRITERIA																								
SPECIFIED LOADS:																								
TOP			CH.		LL		=		26.7		PSF													
					DL		=		6.0		PSF													
BOT			CH.		LL		=		0.0		PSF													
					DL		=		7.4		PSF													
TOTAL			LOAD		=		40.1		PSF															
SPACING = 24.0 IN. C/C																								
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015																								
THIS DESIGN COMPLIES WITH:																								
- PART 9 OF CBC 2018, ABC 2019																								
- PART 9 OF OBC 2012 (2019 AMENDMENT)																								
- CSA 086-14																								
- TPIC 2014																								
(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD																								
ALLOWABLE DEFL.(LL)= L/360 (0.31")																								
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.02")																								
ALLOWABLE DEFL.(TL)= L/360 (0.31")																								
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.03")																								
CSI: TC=0.21/1.00 (C-H:1), BC=0.22/1.00 (B-G:1), WB=0.04/1.00 (C-F:4), SSI=0.15/1.00 (C-J:1)																								
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10																								
COMPANION LIVE LOAD FACTOR = 1.00																								
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .																								
NAIL VALUES																								
PLATE			GRIP(DRY)		SHEAR		SECTION																	
			(PSI)		(PLI)		(PLI)																	
			MAX		MIN		MAX		MIN		MAX		MIN											
MT20			650		371		1747		788		1987		1873											
PLATE PLACEMENT TOL. = 0.250 inches																								
PLATE ROTATION TOL. = 5.0 Deg.																								
JSI GRIP= 0.80 (D) (INPUT = 0.90)																								
JSI METAL= 0.14 (D) (INPUT = 1.00)																								

LICENSED PROFESSIONAL ENGINEER

8/02/22

C. M. HEYENS

100505065


Province of Ontario

STRUCTURAL COMPONENT ONLY

DWG # TR22080025



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	G14	1	1	GREENPARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.		Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:23 2022 Page 1	

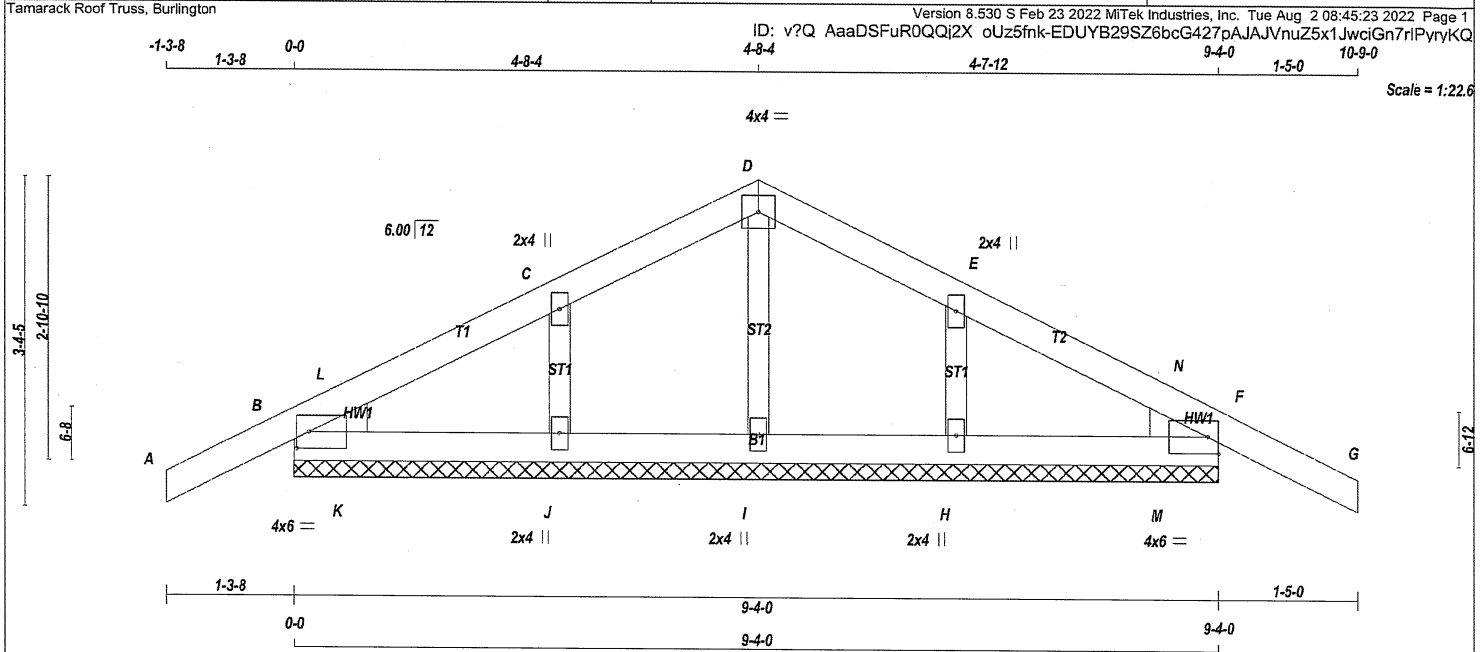

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF
D - G	2x4	DRY	No.2	SPF
B - F	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				
GABLE STUDS SPACED AT 2-0-0 OC.				

PLATES (table is in inches)					
JT	TYPE	PLATES	W	LEN	Y X
B	TMBH1-I	MT20	4.0	6.0	2.00 1.50
C	TMW+w	MT20	2.0	4.0	
D	TTW-p	MT20	4.0	4.0	
E	TMW+w	MT20	2.0	4.0	
F	TMBH1-I	MT20	4.0	6.0	Edge
H, I, J					
H	BMW1+w	MT20	2.0	4.0	

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
HEEL
WEDGE
2x4 L
2x4 R
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 20	-95.2 -95.2	0.12 (1)	I-D	-79 / 0	0.01 (1)	
B-L	-110 / 0	-95.2 -95.2	0.01 (4)	J-C	-247 / 0	0.04 (1)	
L-C	-72 / 0	-95.2 -95.2	0.07 (1)	H-E	-245 / 0	0.04 (1)	
C-D	-85 / 0	-95.2 -95.2	0.07 (1)	K-L	-54 / 7	0.00 (1)	
D-E	-85 / 0	-95.2 -95.2	0.07 (1)	M-N	-51 / 8	0.00 (1)	
E-N	-73 / 0	-95.2 -95.2	0.07 (1)				
N-F	-112 / 0	-95.2 -95.2	0.01 (4)				
F-G	0 / 22	-95.2 -95.2	0.15 (1)				
B-K	0 / 76	-18.5 -18.5	0.05 (1)				
K-J	0 / 76	-18.5 -18.5	0.05 (1)				
J-I	0 / 66	-18.5 -18.5	0.04 (1)				
I-H	0 / 66	-18.5 -18.5	0.04 (1)				
H-M	0 / 76	-18.5 -18.5	0.05 (1)				
M-F	0 / 76	-18.5 -18.5	0.05 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.15/1.00 (F-G:1), BC=0.05/1.00 (B-K:1), WB=0.04/1.00 (C-J:1), SSI=0.10/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.31 (F) (INPUT = 0.90)
JSI METAL= 0.10 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080015

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T15	1	1	GREENPARK HOMES	
Tamarack Roof Truss, Burlington		TRUSS DESC.			

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:44:45 2022 Page 1
 ID: v?Q AaaDSFuR0QQi2X oUz5fml-LvBBC3idWRo?iE8qaBdGnUCJTmr7PeD6XtwrcyryL0
 -1-3-8 1-3-8 0-0 8-12 8-12 2-2-8 2-11-4 2-0-0 4-11-4 5-8-14 1-2-6 6-11-4 2-0-0 8-11-4 1-7-0 10-6-4 10-10-0 11-8-8 10-8
 Scale = 1:21.7

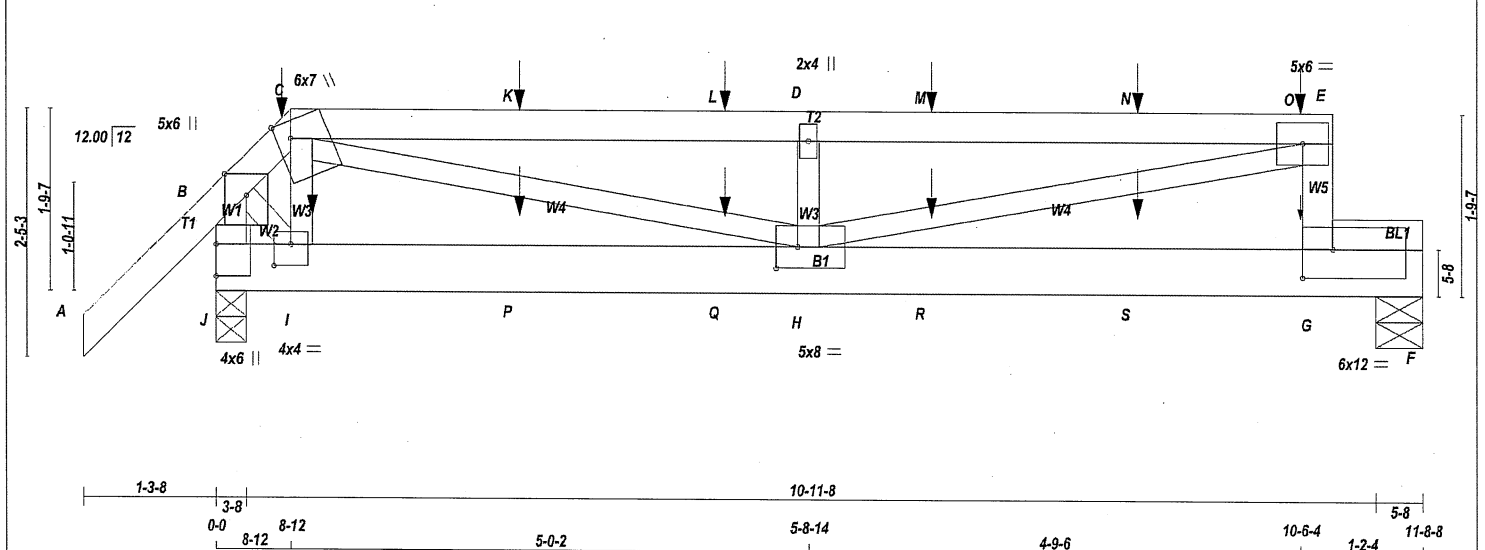

TOTAL WEIGHT = 49 lb

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
G - E	2x4	DRY	No.2	SPF
J - B	2x4	DRY	No.2	SPF
J - F	2x6	DRY	No.2	SPF

BEARING BLOCKS				
BL1	2x4	DRY	No.2	SPF

ALL WEBS EXCEPT				
2x3	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)				
JT TYPE	PLATES	W	LEN	Y X
B TMVW+p	MT20	5.0	6.0	Edge 2.50
C TTWW+m	MT20	6.0	7.0	Edge 1.75
D TMVW+w	MT20	2.0	4.0	
E TMVW+t	MT20	5.0	6.0	
G BMVKm	MT20	6.0	12.0	3.25 3.50
H BMVWW-t	MT20	5.0	8.0	2.50 2.50
I BMVW-t	MT20	4.0	4.0	2.50 2.00
J BMV1+p	MT20	4.0	6.0	3.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)
 1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS		FACTORED		MAXIMUM FACTORED		INPUT		REQD	
JT	GROSS REACTION	VERT	HORZ	GROSS REACTION	DOWN	BRG	IN-SX	BRG	IN-SX
J	963	0	0	963	0	0	3-8	3-8	3-8
F	810	0	0	810	0	0	5-8	5-8	5-8

UNFACTORED REACTIONS

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	675	476 / 0	0 / 0	0 / 0	0 / 0	199 / 0	0 / 0
F	570	391 / 0	0 / 0	0 / 0	0 / 0	178 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, F

BRACING
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.33 FT.
 MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		MAX. FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 47	-95.2 -95.2	0.15 (1)	I-C	-54 / 15	0.01 (1)	
B-C	-765 / 0	-95.2 -95.2	0.15 (1)	C-H	0 / 1391	0.34 (1)	
C-K	-1803 / 0	-95.2 -95.2	0.51 (1)	H-D	-637 / 0	0.10 (1)	
K-L	-1803 / 0	-95.2 -95.2	0.51 (1)	H-E	0 / 1955	0.48 (1)	
L-D	-1803 / 0	-95.2 -95.2	0.51 (1)	B-I	0 / 582	0.14 (1)	
D-M	-1803 / 0	-95.2 -95.2	0.51 (1)				
M-N	-1803 / 0	-95.2 -95.2	0.51 (1)				
N-O	-1803 / 0	-95.2 -95.2	0.51 (1)				
O-E	-1803 / 0	-95.2 -95.2	0.51 (1)				
G-E	-785 / 0	0.0 0.0	0.09 (1)				
J-B	-1128 / 0	0.0 0.0	0.12 (1)				
J-I	0 / 0	-18.5 -18.5	0.11 (1)				
I-P	0 / 462	-18.5 -18.5	0.17 (1)				
P-Q	0 / 462	-18.5 -18.5	0.17 (1)				
Q-H	0 / 462	-18.5 -18.5	0.17 (1)				
H-R	-81 / 0	-18.5 -18.5	0.57 (1)				
R-S	-81 / 0	-18.5 -18.5	0.57 (1)				
S-G	-81 / 0	-18.5 -18.5	0.57 (1)				
G-F	0 / 0	-113.7 -113.7	0.35 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	8-12	-3	-3		FRONT	VERT	DEAD		C1
C	8-12	-22	-22		BACK	VERT	TOTAL		C1
C	8-12	-12	-12		FRONT	VERT	SNOW		C1
G	10-6-4	1	1		BACK	VERT	TOTAL		C1
I	11-4	-13	-13		BACK	VERT	TOTAL		C1
K	2-11-4	-16	-16		BACK	VERT	TOTAL		C1
L	4-11-4	-16	-16		BACK	VERT	TOTAL		C1
M	6-11-4	-16	-16		BACK	VERT	TOTAL		C1
N	8-11-4	-16	-16		BACK	VERT	TOTAL		C1
O	10-6-4	-38	-38		BACK	VERT	TOTAL		C1
P	2-11-4	-13	-13		BACK	VERT	TOTAL		C1
Q	4-11-4	-13	-13		BACK	VERT	TOTAL		C1
R	6-11-4	-13	-13		BACK	VERT	TOTAL		C1
S	8-11-4	-13	-13		BACK	VERT	TOTAL		C1

DESIGN CRITERIA

*** SPECIAL LOADS ANALYSIS ***
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.
 LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:
 TOP CH. LL = 26.7 PSF
 DL = 6.0 PSF
 BOT CH. LL = 0.0 PSF
 DL = 7.4 PSF
 TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

*** NON STANDARD GIRDER ***
 ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
 - PART 9 OF BCBC 2018, ABC 2019
 - PART 9 OF OBC 2012 (2019 AMENDMENT)
 - CSA 086-14
 - TPIC 2014

DESIGN ASSUMPTIONS
 -OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")
 CALCULATED VERT. DEFL.(LL) = L/999 (0.11")
 ALLOWABLE DEFL.(TL)= L/360 (0.39")
 CALCULATED VERT. DEFL.(TL) = L/674 (0.21")

CSI: TC=0.51/1.00 (D-E-1), BC=0.57/1.00 (G-H-1), WB=0.48/1.00 (E-H-1), SSI=0.33/1.00 (F-G-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
 MAX MIN MAX MIN MAX MIN
 MT20 650 371 1747 788 1987 1873



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	T15	1	1	GREENPARK HOMES TRUSS DESC.	

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (I) (INPUT = 0.90)


JSI METAL= 0.41 (E) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	T16	1	2	GREENPARK HOMES TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:55:41 2022 Page 1
ID:7fXwnl 4d7 qdlir?p?nqz5NPJ-86qAuMe61 SwP2Hv0yO5MqNW2Cob6NogNwqY byryAm

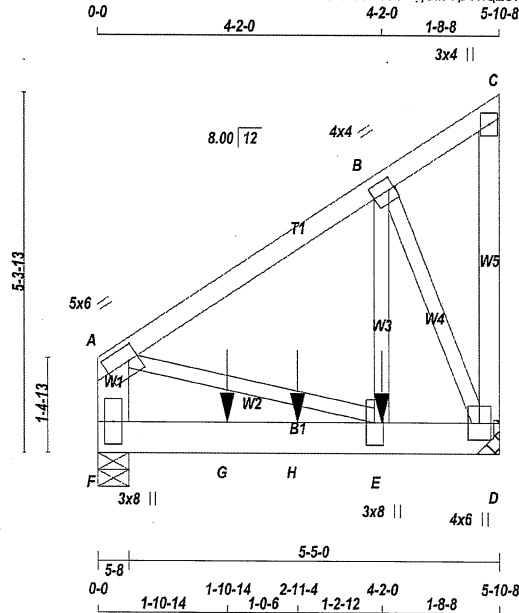

Scale = 1:32.7

TOTAL WEIGHT = 2 X 34 = 69 lb
[M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x6	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	TOP
C - D 1	12	TOP
F - A 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2	12	SIDE (183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E 1	6	SIDE (66.3)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	6.0	2.50 1.75
B	TMWW-t	MT20	4.0	4.0	2.00 1.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	UPLIFT	IN-SX
D	1531	0	1531	0
F	1352	0	1352	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1075	751 / 0	0 / 0	0 / 0	324 / 0	0 / 0
F	949	666 / 0	0 / 0	0 / 0	283 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	-945 / 0	-95.2 -95.2 0.12 (1)	E-B	0 / 1916
B-C	-42 / 0	-95.2 -95.2 0.10 (1)	A-E	0 / 823
D-C	-6 / 0	0.0 0.0 0.00 (1)	B-D	-1941 / 0
F-A	-892 / 0	0.0 0.0 0.03 (1)		
F-G	0 / 0	-18.5 -18.5 0.31 (1)		
G-H	0 / 0	-18.5 -18.5 0.31 (1)		
H-E	0 / 0	-18.5 -18.5 0.31 (1)		
E-D	0 / 800	-18.5 -18.5 0.21 (1)		

SPECIFIED CONCENTRATED LOADS (LBS)

LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	4-2-0	-671	-671	---	BACK	VERT	TOTAL	C1
G	1-10-14	-440	-440	---	BACK	VERT	TOTAL	C1
H	2-11-4	-440	-440	---	BACK	VERT	TOTAL	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.02")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.31/1.00 (E-F:1)
WB=0.28/1.00 (B-D:1), SS=0.29/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (B) (INPUT = 0.90)
JSI METAL= 0.29 (E) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080029 PG 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	T16	1	2	GREENPARK HOMES	
				TRUSS DESC.	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMWW+t	MT20	3.0	8.0		
F	BMV1+p	MT20	3.0	8.0		


NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	T17	1	2	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:55:42 2022 Page 1
ID: ?ftXwnl 4d7 gdlr? p?nqz5NPJ-clNY5ifkolan1Cs5ZqvKv2werc3prp4qcaa6W1ryAl

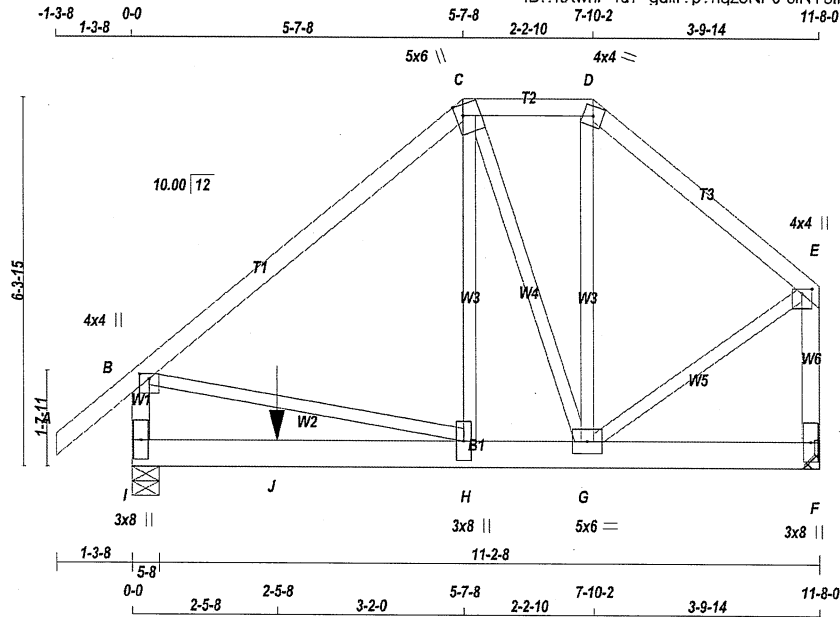

Scale = 1:37.9

TOTAL WEIGHT = 2 X 66 = 132 lb [M]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF		
C - D	2x4 DRY	No.2	SPF		
D - E	2x4 DRY	No.2	SPF		
I - B	2x4 DRY	No.2	SPF		
F - E	2x4 DRY	No.2	SPF		
I - F	2x6 DRY	No.2	SPF		

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD (PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	12	TOP
C - D	12	TOP
D - E	12	TOP
I - B	12	TOP
F - E	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
I - F	12	SIDE (0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	BRG	BRG	
JT VERT	HORZ	DOWN	HORZ	UPLIFT
I 1961	0	1961	0	0
F 975	0	975	0	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 4-0.

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
JT COMBINED						
I 1374	973 / 0	0 / 0	0 / 0	0 / 0	401 / 0	0 / 0
F 686	469 / 0	0 / 0	0 / 0	0 / 0	217 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	W E B S	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 42	-95.2 -95.2 0.07 (1)	H-C	0 / 1233
B-C	-1044 / 0	-95.2 -95.2 0.31 (1)	C-G	-994 / 0
C-D	-489 / 0	-95.2 -95.2 0.04 (1)	G-D	0 / 121
D-E	-635 / 0	-95.2 -95.2 0.13 (1)	B-H	0 / 819
I-B	-1241 / 0	0.0 0.0 0.07 (1)	G-E	0 / 592
F-E	-927 / 0	0.0 0.0 0.08 (1)		
I-J	0 / 0	-18.5 -18.5 0.63 (1)		
J-H	0 / 0	-18.5 -18.5 0.63 (1)		
H-G	0 / 822	-18.5 -18.5 0.42 (1)		
G-F	0 / 0	-18.5 -18.5 0.02 (1)		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
J	2-5-8	-1033	-1033	---	FRONT	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 26.7 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD = 40.1 PSF	

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")
ALLOWABLE DEFL.(TL)= L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.31/1.00 (B-C:1), BC=0.63/1.00 (H-I:1), WB=0.34/1.00 (C-G:1), SSI=0.29/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) (INPUT = 0.90)
JSI METAL= 0.25 (H) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080030 PG 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	T17	1	2	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:55:42 2022 Page 2
ID:?ftXwnl 4d7_gdlIr?p?qz5NPJ-clNY5ifkolan1Cs5ZgvKv2werc3prp4qcaa6W1vryAl

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	8.0		
G	BMWW-t	MT20	5.0	6.0		
H	BMWW+t	MT20	3.0	8.0		
I	BMV1+p	MT20	3.0	8.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.



STRUCTURAL COMPONENT ONLY
DWG # TR22080030 PG 2/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	T18	1	2	GREENPARK HOMES	
				TRUSS DESC.	

PLATES (table is in inches)


JT	TYPE	PLATES	W	LEN	Y	X
D	BMV1+p	MT20	3.0	8.0		
E	BMVWW-t	MT20	5.0	8.0		
F	BMV1+p	MT20	3.0	8.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.



JOB NAME 427303	TRUSS NAME T19	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington					

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:55:43 2022 Page 1
ID:?ftXwnl 4d7 gdlIr?p?nqz5NPJ-4VxxJ2fMZcieeMRH7NQZRFSpD0WDaK?zqEJf3TyryAk

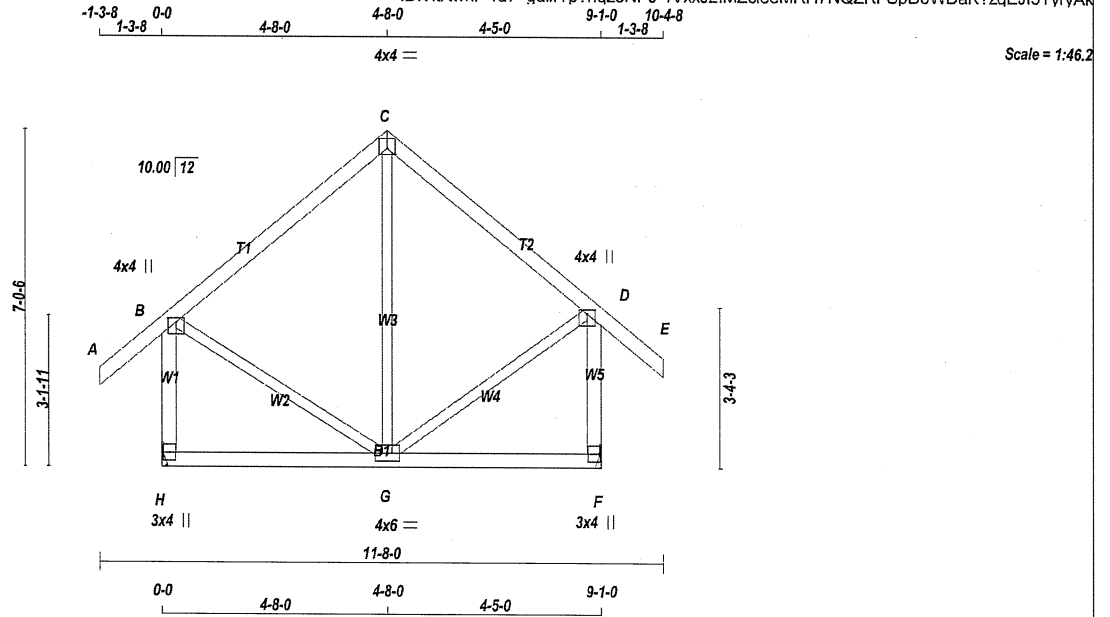

LUMBER				
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
C - E	2x4	DRY	No.2	SPF
H - B	2x4	DRY	No.2	SPF
F - D	2x4	DRY	No.2	SPF
H - F	2x4	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	1.50	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-l	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
H	648 0	648 0	MECHANICAL	MECHANICAL
F	648 0	648 0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H, F. MINIMUM BEARING LENGTH AT JOINT H = 1-8, JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	455	317 / 0	0 / 0	0 / 0	0 / 0	138 / 0	0 / 0
F	455	317 / 0	0 / 0	0 / 0	0 / 0	138 / 0	0 / 0

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 42	-95.2 -95.2	0.13 (1)	G-C	-130 / 33	0.11 (1)	
B-C	-236 / 0	-95.2 -95.2	0.27 (1)	B-G	0 / 212	0.05 (1)	
C-D	-236 / 0	-95.2 -95.2	0.24 (1)	G-D	0 / 220	0.05 (1)	
D-E	0 / 42	-95.2 -95.2	0.13 (1)				
H-B	-615 / 0	0.0 0.0	0.11 (1)				
F-D	-617 / 0	0.0 0.0	0.12 (1)				
H-G	0 / 0	-18.5 -18.5	0.11 (4)				
G-F	0 / 0	-18.5 -18.5	0.11 (4)				

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 26.7	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 40.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.30")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.30")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.27/1.00 (B-C:1), BC=0.11/1.00 (G-H:4), WB=0.11/1.00 (C-G:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.44 (B) (INPUT = 0.90)
JSI METAL= 0.12 (D) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080032

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	T21	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:55:44 2022 Page 1
ID:7fXwnl 4d7 qdlr?nqz5NPJ-YhVJWOg KvqVGVOUh5yo T? yQsNJn063u3DbvryAj

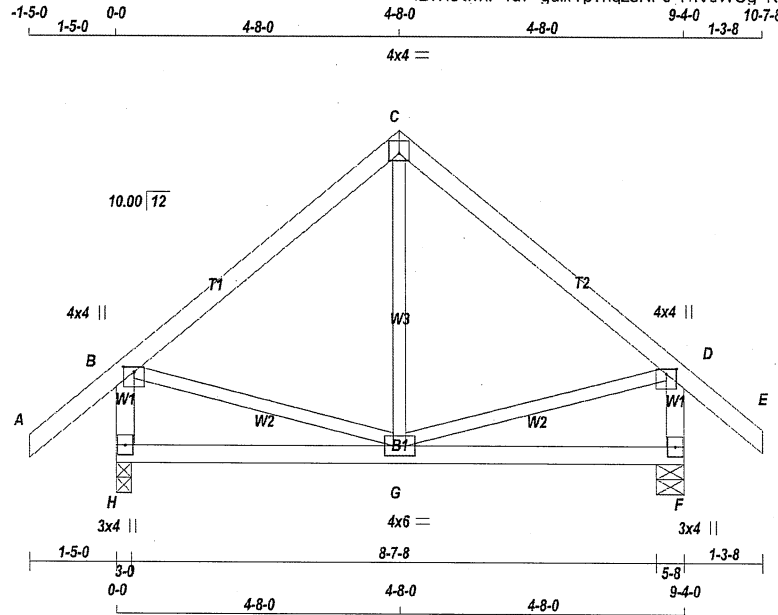

Scale = 1:36.8

TOTAL WEIGHT = 2 X 43 = 86 lb

LUMBER					DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER								DESIGN CRITERIA			
N. L. G. A. RULES																
CHORDS		SIZE		LUMBER		DESCR.		BEARINGS				SPECIFIED LOADS:				
A - C	2x4	DRY	No.2	SPF	FACTORED		MAXIMUM FACTORED		INPUT		REQRD		TOP CH. LL = 26.7 PSF			
C - E	2x4	DRY	No.2	SPF	GROSS REACTION		GROSS REACTION		BRG		BRG		DL = 6.0 PSF			
H - B	2x4	DRY	No.2	SPF	JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	BOT CH. LL = 0.0 PSF			
F - D	2x4	DRY	No.2	SPF	H	674	0	674	0	0	3-0	3-0	DL = 7.4 PSF			
H - F	2x4	DRY	No.2	SPF	F	662	0	662	0	0	5-8	5-8	TOTAL LOAD = 40.1 PSF			
ALL WEBS EXCEPT	2x3	DRY.	No.2	SPF	UNFACTORED REACTIONS								SPACING = 24.0 IN. C/C			

PLATES (table is in inches)						
JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	1.50	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-l	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H, F

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CS (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CS (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 46	-95.2 -95.2	0.16 (1)	G-C	-32 / 70	0.02 (4)	
B-C	-322 / 0	-95.2 -95.2	0.27 (1)	B-G	0 / 257	0.06 (1)	
C-D	-322 / 0	-95.2 -95.2	0.27 (1)	G-D	0 / 257	0.06 (1)	
D-E	0 / 42	-95.2 -95.2	0.13 (1)				
H-B	-641 / 0	0.0 0.0	0.07 (1)				
F-D	-629 / 0	0.0 0.0	0.07 (1)				
H-G	0 / 0	-18.5 -18.5	0.11 (4)				
G-F	0 / 0	-18.5 -18.5	0.11 (4)				

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.31")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.31")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.01")

CSI: TC=0.27/1.00 (C-D:1), BC=0.11/1.00 (G-H:4), WB=0.06/1.00 (B-G:1), SSI=0.13/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.52 (D) (INPUT = 0.90)
JSI METAL= 0.14 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080033

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	G21	1	1	GREENPARK HOMES	
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 08:55:39 2022 Page 1

ID:7fXwnl 4d7 gdlr?p?nqz5NPJ-CjiQThcsVNCCAk8WuYMdHPi9JPAjeWcNvdLSviynyAo

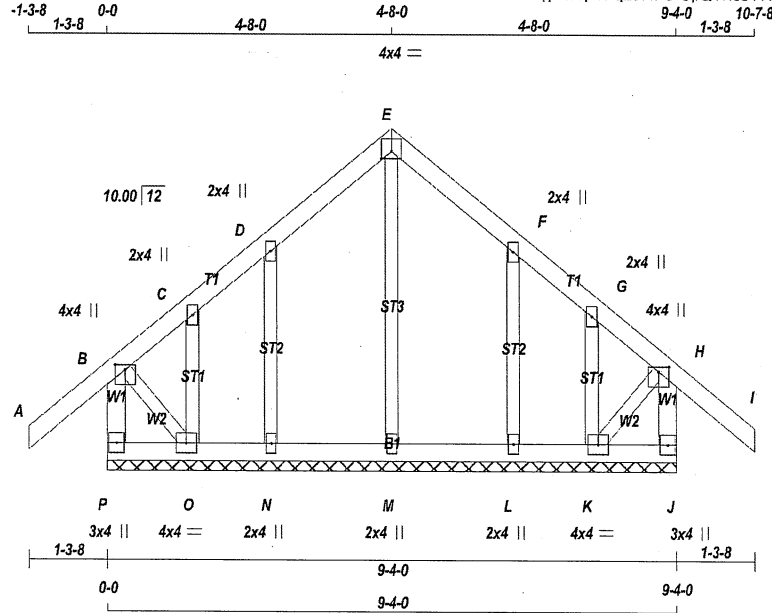

Scale = 1:36.8

TOTAL WEIGHT = 47 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
P - B	2x4	DRY	No.2	SPF
A - E	2x4	DRY	No.2	SPF
E - I	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
P - J	2x4	DRY	No.2	SPF

ALL WEBS	2x3	DRY	No.2	SPF
ALL GABLE WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

GABLE STUDS SPACED AT 2-0-0 OC.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B TMVW+p	MT20	4.0	4.0	1.00	2.00
C D F G					
C TMVW+w	MT20	2.0	4.0		
E TTW+p	MT20	4.0	4.0	1.50	2.00
H TMVW+p	MT20	4.0	4.0	1.00	2.00
J BMV1+p	MT20	3.0	4.0		
K BMVW1-t	MT20	4.0	4.0		
L M N					
L BMV1+w	MT20	2.0	4.0		
O BMVW1-t	MT20	4.0	4.0		
P BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

BRACING
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM	TO		FR-TO			
P-B	-289 / 0	0.0	0.0	0.03 (1)	7.81	M-E	-155 / 0	0.07 (1)
A-B	0 / 42	-95.2	-95.2	0.13 (1)	10.00	N-D	-208 / 0	0.05 (1)
B-C	-63 / 0	-95.2	-95.2	0.12 (1)	6.25	O-C	-13 / 0	0.00 (1)
C-D	0 / 8	-95.2	-95.2	0.05 (1)	10.00	L-F	-208 / 0	0.05 (1)
D-E	-18 / 0	-95.2	-95.2	0.05 (1)	6.25	K-G	-13 / 0	0.00 (1)
E-F	-18 / 0	-95.2	-95.2	0.05 (1)	6.25	B-O	0 / 16	0.00 (1)
F-G	0 / 8	-95.2	-95.2	0.05 (1)	10.00	K-H	0 / 16	0.00 (1)
G-H	-63 / 0	-95.2	-95.2	0.12 (1)	6.25			
H-I	0 / 42	-95.2	-95.2	0.13 (1)	10.00			
J-H	-289 / 0	0.0	0.0	0.03 (1)	7.81			
P-O	0 / 0	-18.5	-18.5	0.01 (4)	10.00			
O-N	0 / 11	-18.5	-18.5	0.01 (4)	10.00			
N-M	0 / 5	-18.5	-18.5	0.02 (4)	10.00			
M-L	0 / 5	-18.5	-18.5	0.02 (4)	10.00			
L-K	0 / 11	-18.5	-18.5	0.01 (4)	10.00			
K-J	0 / 0	-18.5	-18.5	0.01 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (M-N:4), WB=0.07/1.00 (E-M:1), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.24 (E) (INPUT = 0.90)
JSI METAL= 0.11 (D) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080026

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427303	T22	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:55:45 2022 Page 1
ID:Sxi284EpBPx8mampTunioFz5N6c-0t3hkkhd5DyMufbgFoT2XqYAoqDw2E9GIYom7MyryA

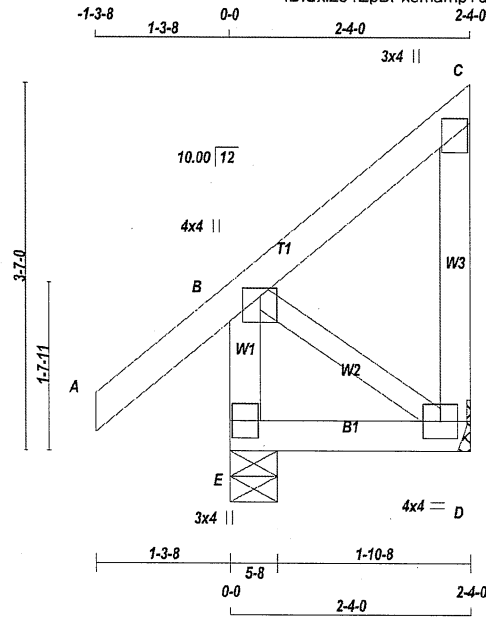

Scale = 1:21.6

TOTAL WEIGHT = 2 X 15 = 30 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
E - B	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
DRY: SEASONED LUMBER.				

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TMV+p	MT20	3.0	4.0		
D	BMVW1-t	MT20	4.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
D	133 0	133 0	MECHANICAL	
E	265 0	265 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	94	62 / 0	0 / 0	0 / 0	0 / 0	31 / 0	0 / 0
E	184	136 / 0	0 / 0	0 / 0	0 / 0	48 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 42	-95.2 -95.2	0.13 (5)	B-D	0 / 0	0.00 (1)	
B-C	0 / 0	-95.2 -95.2	0.09 (1)				
D-C	-111 / 0	0.0 0.0	0.02 (1)				
E-B	-243 / 0	0.0 0.0	0.03 (1)				
E-D	0 / 0	-18.5 -18.5	0.03 (4)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.03/1.00 (D-E:4), WB=0.00/1.00 (B-D:1), SSI=0.08/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080034

JOB NAME 427323	TRUSS NAME T23	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:00:57 2022 Page 1

ID:AmwvXzx kdh117WNqXZi0Uz4SAN-uvweCQTKc4G5JcSeWK3CATTW2beN9IJB15NG4Gyny5q

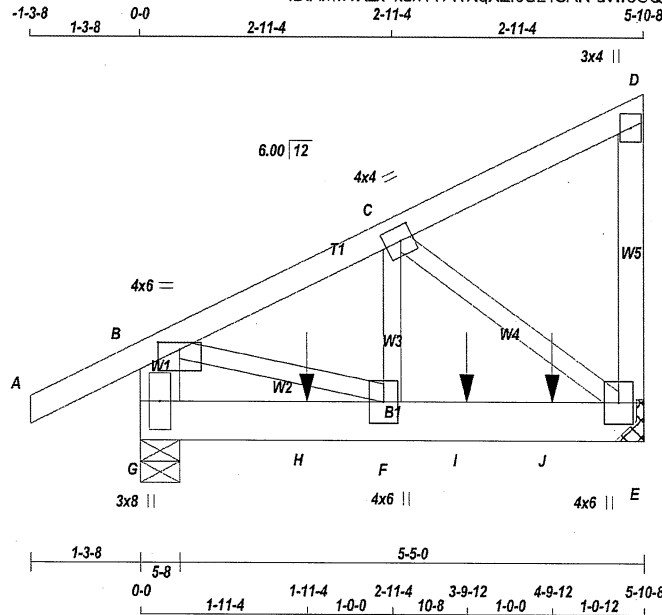

Scale = 1:26.1

TOTAL WEIGHT = 2 X 31 = 62 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	DRY	LUMBER	DESCR.
A - D	2x4	DRY	No.2	SPF	
E - D	2x4	DRY	No.2	SPF	
G - B	2x6	DRY	No.2	SPF	
G - E	2x6	DRY	No.2	SPF	
ALL WEBS	2x3	DRY	No.2	SPF	
EXCEPT					

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF **2** TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - D 1	12	TOP
D - E 1	12	TOP
G - B 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
G - E 2	12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00 3.00

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS	FACTORED	MAXIMUM FACTORED	INPUT	REQD
GROSS REACTION	GROSS REACTION	GROSS REACTION	BRG	BRG
JT VERT	DOWN	HORZ	UPLIFT	IN-SX
E 1730	0	1730	0	MECHANICAL
G 1401	0	1401	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT E. MINIMUM BEARING LENGTH AT JOINT E = 4-0.

UNFACTORED REACTIONS

1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT COMBINED	851 / 0	0 / 0	0 / 0	0 / 0	363 / 0	0 / 0
G 982	696 / 0	0 / 0	0 / 0	0 / 0	286 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	MEMB.	FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 29	-95.2 -95.2 0.07 (1)	F-C	0 / 1338
B-C	-1463 / 0	-95.2 -95.2 0.06 (1)	C-E	-1659 / 0
C-D	-11 / 0	-95.2 -95.2 0.05 (1)	B-F	0 / 1364
E-D	-115 / 0	0.0 0.0 0.01 (1)		
G-B	-1252 / 0	0.0 0.0 0.04 (1)		
G-H	0 / 0	-18.5 -18.5 0.16 (1)		
H-F	0 / 0	-18.5 -18.5 0.16 (1)		
F-I	0 / 1319	-18.5 -18.5 0.32 (1)		
I-J	0 / 1319	-18.5 -18.5 0.32 (1)		
J-E	0 / 1319	-18.5 -18.5 0.32 (1)		

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	1-11-4	-550	-550	---	BACK	VERT	TOTAL	---	C1
I	3-9-12	-542	-542	---	BACK	VERT	TOTAL	---	C1
J	4-9-12	-542	-542	---	BACK	VERT	TOTAL	---	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = **24.0** IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.02")

CSI: TC=0.07/1.00 (A-B:1), BC=0.32/1.00 (E-F:1)
WB=0.20/1.00 (C-E:1), SSI=0.33/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.90)
JSI METAL= 0.30 (E) (INPUT = 1.00)

CONTINUED ON PAGE 2



STRUCTURAL COMPONENT ONLY
DWG # TR22080038 PG 1/2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427323	T23	1	2	GREENPARK HOMES	
				TRUSS DESC.	

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
C	TMWW-t	MT20	4.0	4.0	2.00	1.75
D	TMV+p	MT20	3.0	4.0		
E	BMVW1+p	MT20	4.0	6.0		
F	BMWW+t	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	8.0		

NOTES- (1)


1) Lateral braces to be a minimum of 2X4 SPF #2.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427323	T24	2	1	GREENPARK HOMES	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:00:58 2022 Page 1
ID:AmwvXzx kdh117WNqXZIOUz4SAN-M5T0QmTyN00yxm0q41aRiq?cM?0nunCKGI7pcjyry5p

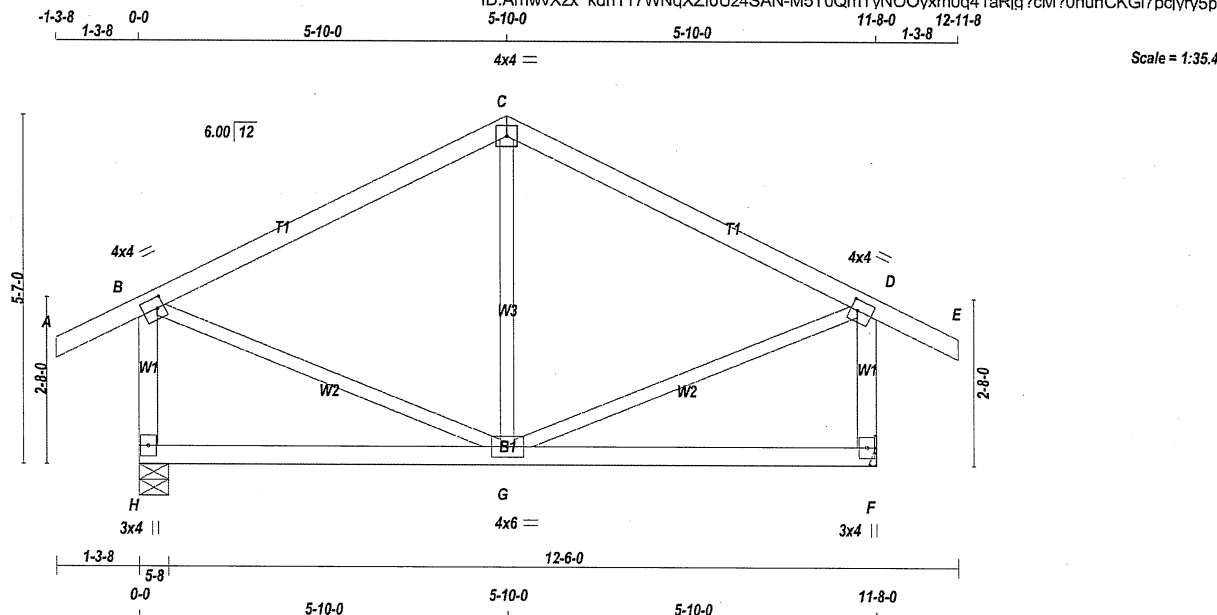

TOTAL WEIGHT = 2 X 50 = 101 lb

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. **DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER** **BEARINGS** **DESIGN CRITERIA**

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
H - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF
EXCEPT

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTW-p	MT20	4.0	4.0		
D	TMVW-t	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BUILDING DESIGNER								
<u>BEARINGS</u>								
FACTORED			MAXIMUM FACTORED			INPUT		REQRD
	GROSS REACTION		GROSS REACTION			BRG	BRG	
JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
H	792	0	792	0	0	5-8	5-8	
F	792	0	792	0	0	MECHANICAL		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	557	384 / 0	0 / 0	0 / 0	0 / 0	173 / 0	0 / 0
F	557	384 / 0	0 / 0	0 / 0	0 / 0	173 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC LENGTH	MEMB.	FORCE (LBS)	MAX
FR-TO		FROM TO	CSI (LC)		FR-TO		CSI (LC)
A-B	0 / 29	-95.2 -95.2	0.12 (1)	10.00	G-C	-175 / 39	0.08 (1)
B-C	-426 / 0	-95.2 -95.2	0.42 (1)	6.25	B-G	0 / 411	0.09 (1)
C-D	-426 / 0	-95.2 -95.2	0.42 (1)	6.25	G-D	0 / 411	0.09 (1)
D-E	0 / 29	-95.2 -95.2	0.12 (1)	10.00			
H-B	-751 / 0	0.0 0.0	0.10 (1)	7.81			
F-D	-751 / 0	0.0 0.0	0.10 (1)	7.81			
H-G	0 / 0	-18.5 -18.5	0.18 (4)	10.00			
G-F	0 / 0	-18.5 -18.5	0.18 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	26.7	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	40.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.42/1.00 (B-C:1), BC=0.18/1.00 (G-H:4)

, WB=0.09/1.00 (D-G:1), SSI=0.19/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.62 (B) (INPUT = 0.90)
JSI METAL= 0.21 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080039

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	GREENPARK HOMES	DRWG NO.
427323	T25	1	1	TRUSS DESC.		

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:00:58 2022 Page 1
ID:AmwvXzx kdh117WNqXZI0Uz4SAN-M5T0QmTyNOOyxm0q41aRjg?f2?1 un1KGI7pciyry5p

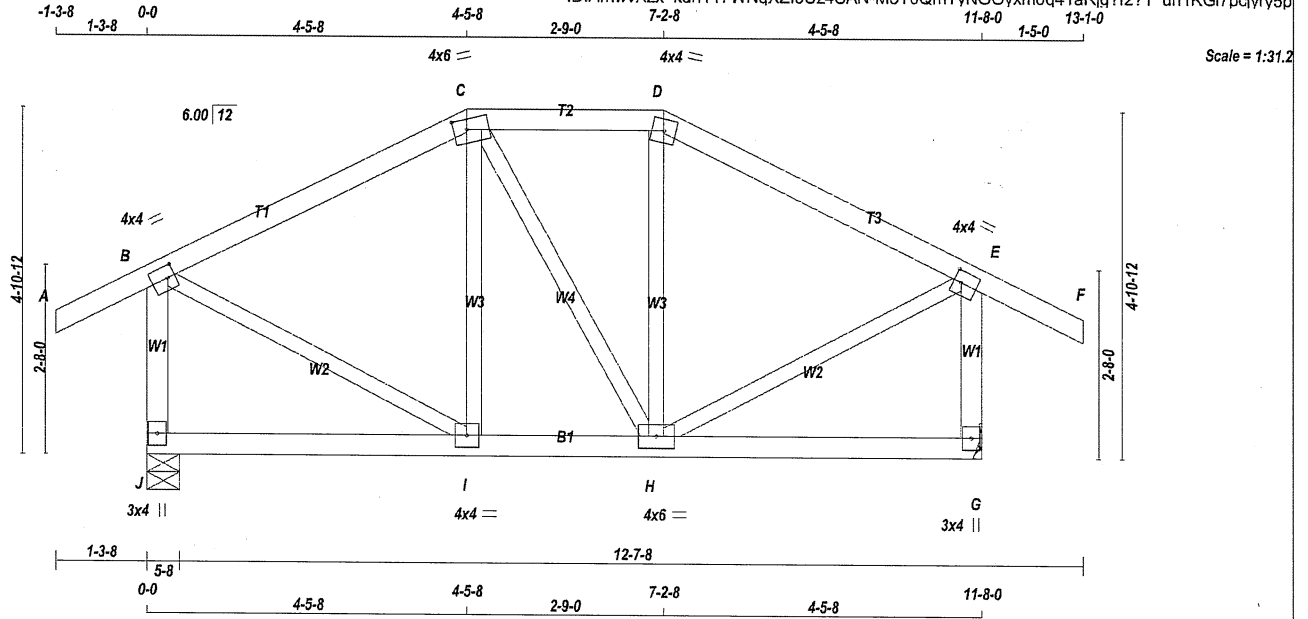

TOTAL WEIGHT = 55 lb
[M/F]

LUMBER	N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF	
C - D	2x4	DRY	No.2	SPF	
D - F	2x4	DRY	No.2	SPF	
J - B	2x4	DRY	No.2	SPF	
G - E	2x4	DRY	No.2	SPF	
J - G	2x4	DRY	No.2	SPF	

ALL WEBS 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTWW-m	MT20	4.0	6.0	1.75	2.25
D	TTW-m	MT20	4.0	4.0		
E	TMVW-t	MT20	4.0	4.0	2.00	1.25
G	BMV1+p	MT20	3.0	4.0		
H	BMVWW-t	MT20	4.0	6.0		
I	BMVW-t	MT20	4.0	4.0		
J	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
J	792	0	792	0
G	804	0	804	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 1-8.

UNFACTORED REACTIONS

JT	1ST LCASE	MAX / MIN	COMPONENT REACTIONS	PERM. LIVE	WIND	DEAD	SOIL
J	COMBINED	SNOW	LIVE				
J	567	384 / 0	0 / 0	0 / 0	0 / 0	173 / 0	0 / 0
G	565	391 / 0	0 / 0	0 / 0	0 / 0	174 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

MEMB.	CHORDS	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MAX. UNBRACED LENGTH	MEMB.	WEBS	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO			FROM	TO			FR-TO			
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00	I-C	-138 / 9	0.05 (1)		
B-C	-456 / 0	-95.2	-95.2	0.24 (1)	6.25	C-H	-1 / 0	0.00 (1)		
C-D	-403 / 0	-95.2	-95.2	0.09 (1)	6.25	H-D	-139 / 9	0.05 (1)		
D-E	-455 / 0	-95.2	-95.2	0.24 (1)	6.25	B-I	0 / 458	0.10 (1)		
E-F	0 / 32	-95.2	-95.2	0.15 (1)	10.00	H-E	0 / 458	0.10 (1)		
J-B	-756 / 0	0.0	0.0	0.11 (1)	7.81					
G-E	-768 / 0	0.0	0.0	0.11 (1)	7.81					
J-I	0 / 0	-18.5	-18.5	0.08 (4)	10.00					
I-H	0 / 404	-18.5	-18.5	0.10 (4)	10.00					
H-G	0 / 0	-18.5	-18.5	0.08 (4)	10.00					

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL =	26.7	PSF
	DL =	6.0	PSF
BOT CH.	LL =	0.0	PSF
	DL =	7.4	PSF
TOTAL LOAD	=	40.1	PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL) = L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.24/1.00 (B-C-1), BC=0.10/1.00 (H-I-4), WB=0.10/1.00 (B-I-1), SSI=0.15/1.00 (B-C-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.67 (B) (INPUT = 0.90)
JSI METAL= 0.21 (E) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080040

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427323	T26	1	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

SPECIFIED CONCENTRATED LOADS (LBS)									
JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	10-4-12	-1	-1	—	FRONT	VERT	TOTAL	—	C1


CONNECTION REQUIREMENTS

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME 427323	TRUSS NAME T27	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:01:00 2022 Page 1
ID:AmwvXzx kdh117WNqXZIOUz4SAN-IUbmRVCv?efA3ACCScvo55vDocL.MaEdk3cwhbyrv5n

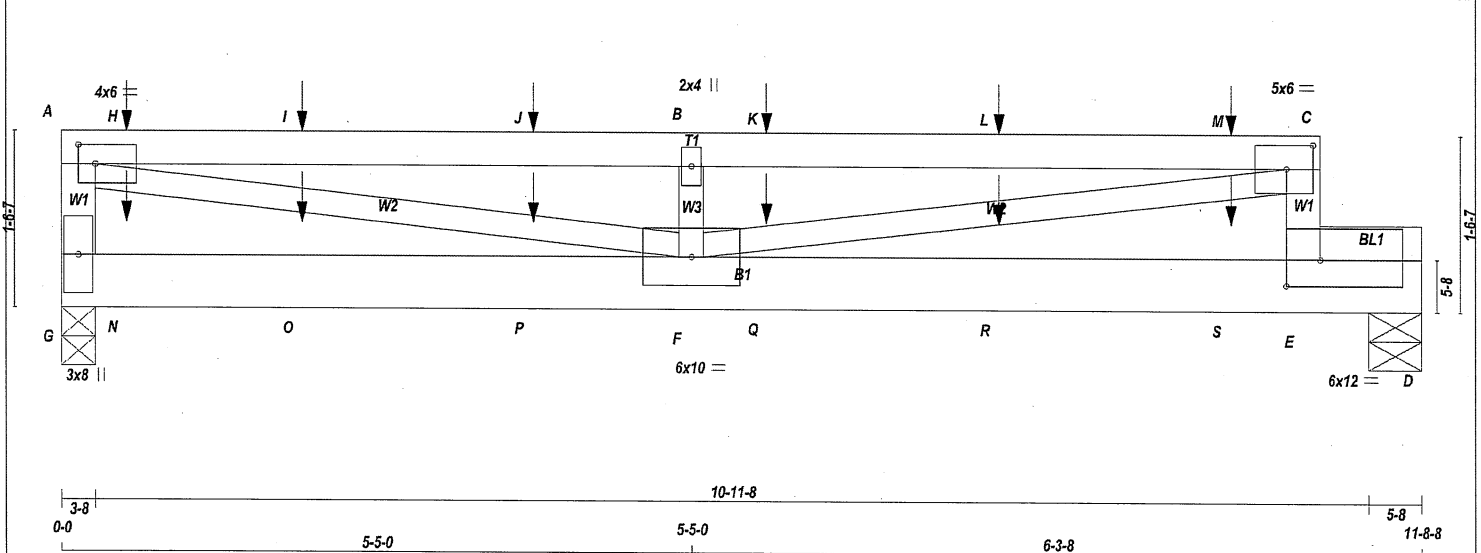

TOTAL WEIGHT = 45 lb

LUMBER				DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY			
N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.	BUILDING DESIGNER		
G - A	2x4	DRY	No.2	SPF	BEARINGS		
A - C	2x4	DRY	No.2	SPF	FACTORED		
E - C	2x4	DRY	No.2	SPF	GROSS REACTION		
G - D	2x6	DRY	No.2	SPF	MAXIMUM FACTORED		
					INPUT		
					REQD		

BEARING BLOCKS				UNFACTORED REACTIONS			
BL1	2x4	DRY	No.2	SPF	1ST LOASE		
					MAX/MIN. COMPONENT REACTIONS		
					JT COMBINED		
					SNOW		
					LIVE		
					PERM.LIVE		
					WIND		
					DEAD		
					SOIL		


DESIGN CRITERIA
SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF
SPACING = 24.0 IN. C/C
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015
THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014
(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD
ALLOWABLE DEFL.(LL)= L/360 (0.39")
CALCULATED VERT. DEFL.(LL) = L/878 (0.16")
ALLOWABLE DEFL.(TL)= L/360 (0.39")
CALCULATED VERT. DEFL.(TL) = L/487 (0.29")
CSI: TC=0.59/1.00 (A-B:1), BC=0.56/1.00 (E-F:1), WB=0.57/1.00 (C-F:1), SSI=0.32/1.00 (D-E:1)
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00
COMPANION LIVE LOAD FACTOR = 1.00

NOTES- (1)
1) Lateral braces to be a minimum of 2X4 SPF #2.

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRAC LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH (LC)	
FR-TO				FR-TO			
G-A	-724 / 0	0.0	0.0 0.08 (1)	A-F	0 / 2212	0.55 (1)	
A-H	-2163 / 0	-95.2	-95.2 0.59 (1)	F-B	-689 / 0	0.11 (1)	
H-I	-2163 / 0	-95.2	-95.2 0.59 (1)	F-C	0 / 2305	0.57 (1)	
I-J	-2163 / 0	-95.2	-95.2 0.59 (1)				
J-B	-2163 / 0	-95.2	-95.2 0.59 (1)				
B-K	-2163 / 0	-95.2	-95.2 0.59 (1)				
K-L	-2163 / 0	-95.2	-95.2 0.59 (1)				
L-M	-2163 / 0	-95.2	-95.2 0.59 (1)				
M-C	-2163 / 0	-95.2	-95.2 0.59 (1)				
E-C	-733 / 0	0.0	0.0 0.08 (1)				
G-N	0 / 0	-18.5	-18.5 0.12 (1)				
N-O	0 / 0	-18.5	-18.5 0.12 (1)				
O-P	0 / 0	-18.5	-18.5 0.12 (1)				
P-F	0 / 0	-18.5	-18.5 0.12 (1)				
F-Q	-91 / 0	-18.5	-18.5 0.56 (1)				
Q-R	-91 / 0	-18.5	-18.5 0.56 (1)				
R-S	-91 / 0	-18.5	-18.5 0.56 (1)				
S-E	-91 / 0	-18.5	-18.5 0.56 (1)				
E-D	0 / 0	-113.7	-113.7 0.35 (1)				

SPECIFIED CONCENTRATED LOADS (LBS)				CONNECTION REQUIREMENTS			
JT	LOC.	LC1	MAX- MAX+	FACE	DIR.	TYPE	HEEL
H	6-12	-30	-30	---	BACK	VERT	TOTAL
I	2-0-12	-15	-15	---	BACK	VERT	TOTAL
J	4-0-12	-15	-15	---	BACK	VERT	TOTAL
K	6-0-12	-15	-15	---	BACK	VERT	TOTAL
L	8-0-12	-15	-15	---	BACK	VERT	TOTAL
M	10-0-12	-23	-23	---	BACK	VERT	TOTAL
N	6-12	-14	-14	---	BACK	VERT	TOTAL
O	2-0-12	-14	-14	---	BACK	VERT	TOTAL
P	4-0-12	-14	-14	---	BACK	VERT	TOTAL
Q	6-0-12	-14	-14	---	BACK	VERT	TOTAL
R	8-0-12	-14	-14	---	BACK	VERT	TOTAL
S	10-0-12	-14	-14	---	BACK	VERT	TOTAL

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

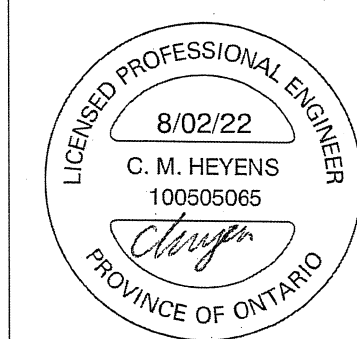

STRUCTURAL COMPONENT ONLY
DWG # TR22080042 PG 1/2

CONTINUED ON PAGE 2

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427323	T27	1	1	GREENPARK HOMES TRUSS DESC.	

CONNECTION REQUIREMENTS


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J1	7	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:43:54 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fk-L5cvVd4eXmNE5Ok05 CJCKbaYDX7zg8coR3eq3yryLp

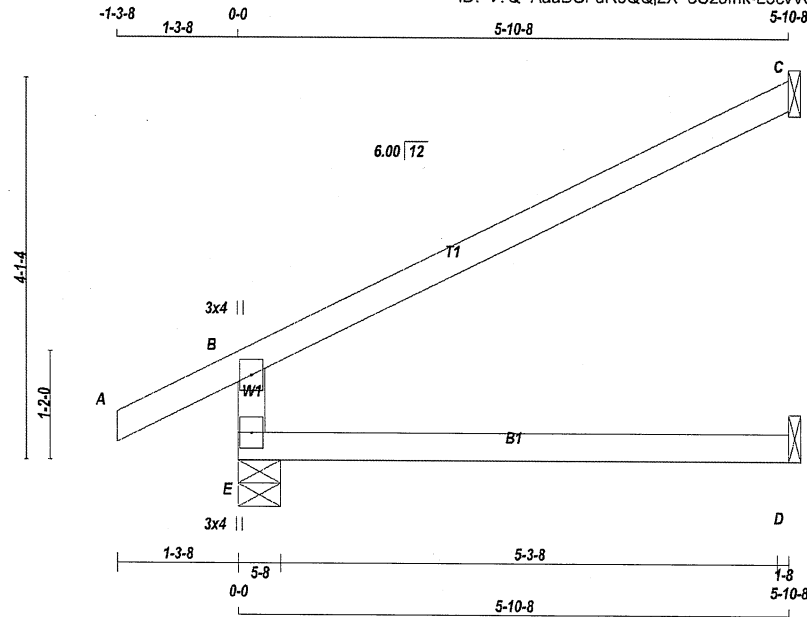

Scale: 1/2"=1'

TOTAL WEIGHT = 7 X 17 = 118 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	HORZ
E	542	0	542	0
C	210	0	210	0
D	45	0	50	0

SEE MITTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	COMBINED	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
E	380	269 / 0	0 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	144	118 / 0	0 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	FR-TO
E-B	-479 / 0	0.0	0.0 0.13 (4)	7.81			
A-B	0 / 29	-95.2	-95.2 0.12 (1)	10.00			
B-C	-31 / 0	-95.2	-95.2 0.56 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00			

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 26.7 PSF
DL = 6.0 PSF	
BOT CH.	LL = 0.0 PSF
DL = 7.4 PSF	
TOTAL LOAD	= 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.56/1.00 (B-C:1), BC=0.13/1.00 (D-E:4)
WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90)
JSI METAL= 0.13 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080001


JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J2	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:43:55 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fnk-pH9Hjy5GI3V5iYJDfhYly8s6ct8j7O15pBCWYryLo

-1-3-8 1-3-8 0-0 1-9-7 1-9-7 4-1-1 5-10-8

Scale = 1:14.1

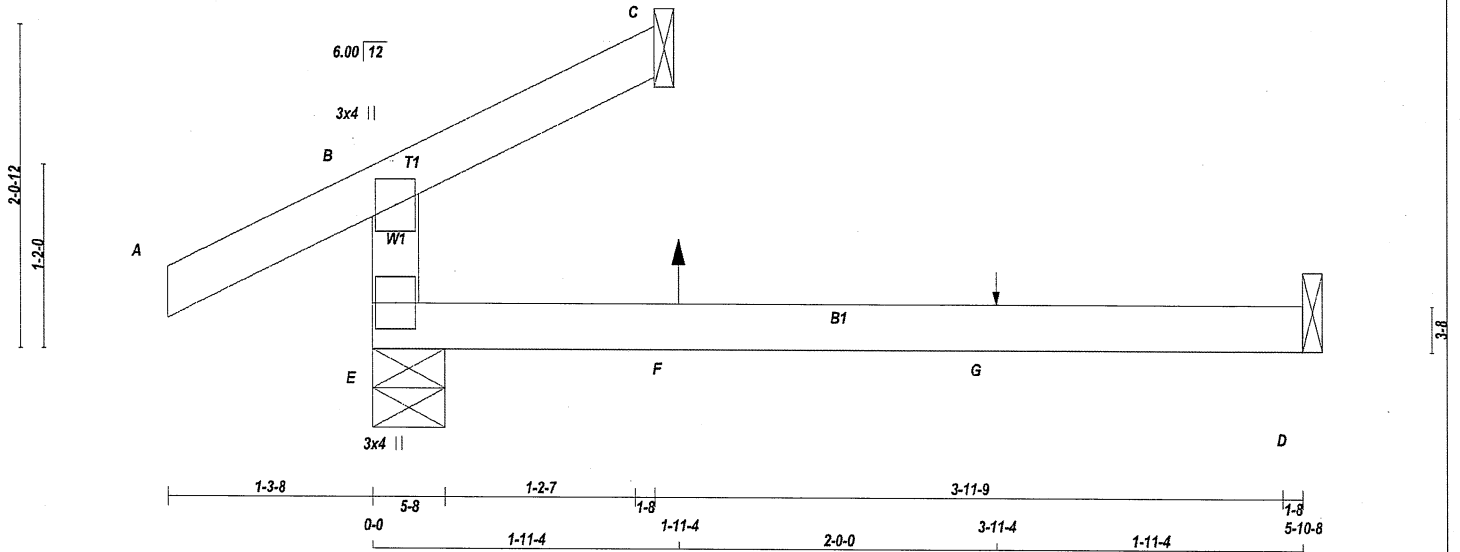

TOTAL WEIGHT = 2 X 12 = 23 lb [M]

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	SPF
E - B	2x4	DRY	No.2
A - C	2x4	DRY	No.2
E - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY

BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
E	293	0	5-8	5-8
C	64	0	1-8	1-8
D	43	0	1-8	1-8

SEE MITTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	MAX / MIN	COMPONENT REACTIONS	DEAD	SOIL
	COMBINED	SNOW	LIVE	PERM. LIVE	WIND
E	206	144 / 0	0 / 0	0 / 0	62 / 0
C	47	22 / 0	0 / 0	0 / 0	25 / 0
D	35	0 / -3	0 / 0	0 / 0	37 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (7)

CHORDS			WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB. MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM	TO		FR-TO	
E-B	-237 / 0	0.0	0.0	0.11 (4)	7.81	
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00	
B-C	-10 / 9	-95.2	-95.2	0.08 (4)	6.25	
E-F	0 / 0	-18.5	-18.5	0.14 (4)	10.00	
F-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00	
G-D	0 / 0	-18.5	-18.5	0.14 (4)	10.00	

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	5	1	8	BACK	VERT	TOTAL	—	C1
G	3-11-4	1	1	—	BACK	VERT	TOTAL	—	C1

CONNECTION REQUIREMENTS

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 26.7	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 40.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4)
, WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX MIN	MAX MIN	MAX MIN	
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.09 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080002

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J3	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:43:55 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fkn-pH9Hjy5GI3V5iYJDfhjYly8qQctEI7OI15pBCWryLo

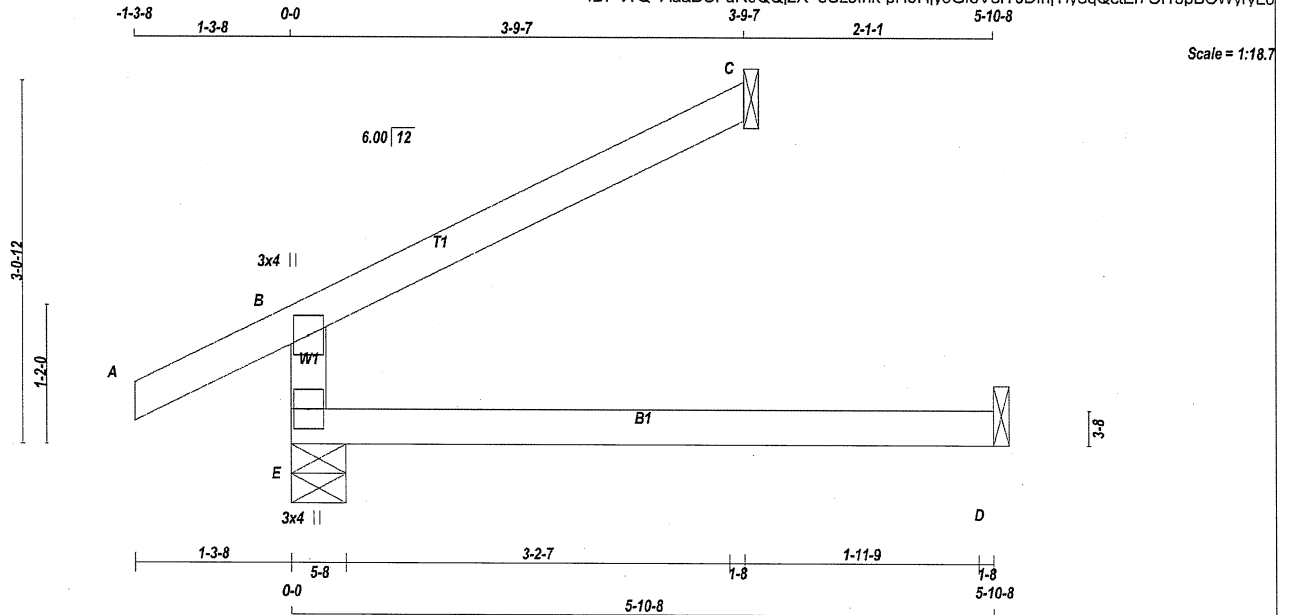

TOTAL WEIGHT = 2 X 14 = 28 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
E	418	418	5-8	5-8
C	135	135	1-8	1-8
D	45	50	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LOASE	MAX/MIN. COMPONENT REACTIONS	DEAD	SOIL
E	295	199 / 0	0 / 0	0 / 0
C	93	76 / 0	0 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD LC1	MAX. UNBRAC LENGTH	MEMB. FORCE (LBS)
FR-TO		FROM TO		FR-TO
E-B	-354 / 0	0.0 0.0 0.13 (4)	7.81	
A-B	0 / 29	-95.2 -95.2 0.12 (1)	10.00	
B-C	-20 / 0	-95.2 -95.2 0.23 (1)	6.25	
E-D	0 / 0	-18.5 -18.5 0.13 (4)	10.00	

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.23/1.00 (B-C:1), BC=0.13/1.00 (D-E:4)
WB=0.00/1.00 (n/a:0), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)
JSI METAL= 0.10 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080003

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J4	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:43:56 2022 Page 1
ID: v?Q AaaDSFuR0QQi2X oUz5fmk-HUjfwl6u3NdyKiuPCOFnl9g1s0EwRadvGIYlkyyrLn

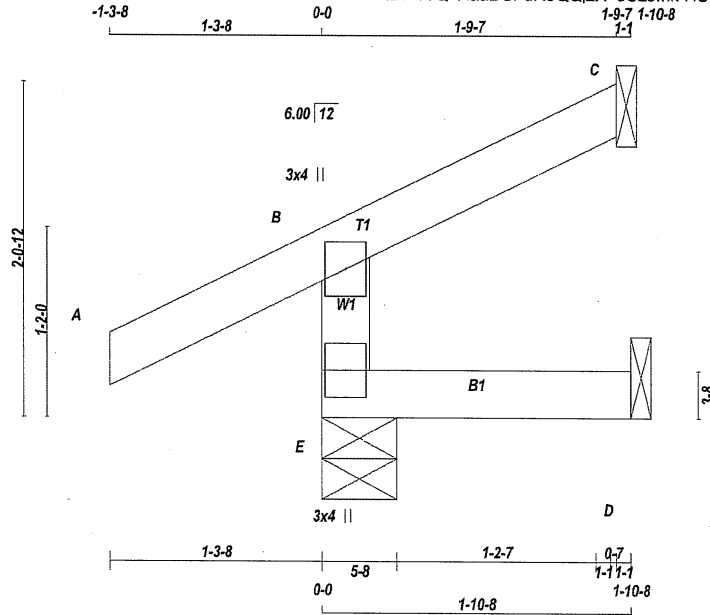

Scale = 1:13.6

TOTAL WEIGHT = 2 X 7 = 14 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	UP
JT				
E	280	0	280	0
C	46	0	46	0
D	8	0	17	0

SEE MITTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

UNFACTORED REACTIONS

JT	1ST LCASE COMBINED	MAX/MIN. COMPONENT REACTIONS	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	195	148 / 0	0 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
C	32	25 / -19	0 / 0	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0
D	7	0 / -8	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED VERT. LOAD (PLF)	MAX. FACTORED VERT. LOAD LC1 (LC)
FR-TO		FROM	TO	FR-TO		FROM	TO
E-B	-253 / 0	0.0	0.0	0.04 (5)	7.81		
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00		
B-C	-17 / 0	-95.2	-95.2	0.09 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	26.7	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	40.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5)
WB=0.00/1.00 (n/a:0), SI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747	788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90)
JSI METAL= 0.07 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080004

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J5	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:43:57 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fmk-IgH18e7WqhlpsTbm6m0qNDAwQaVA1t2UPIHOyryLm

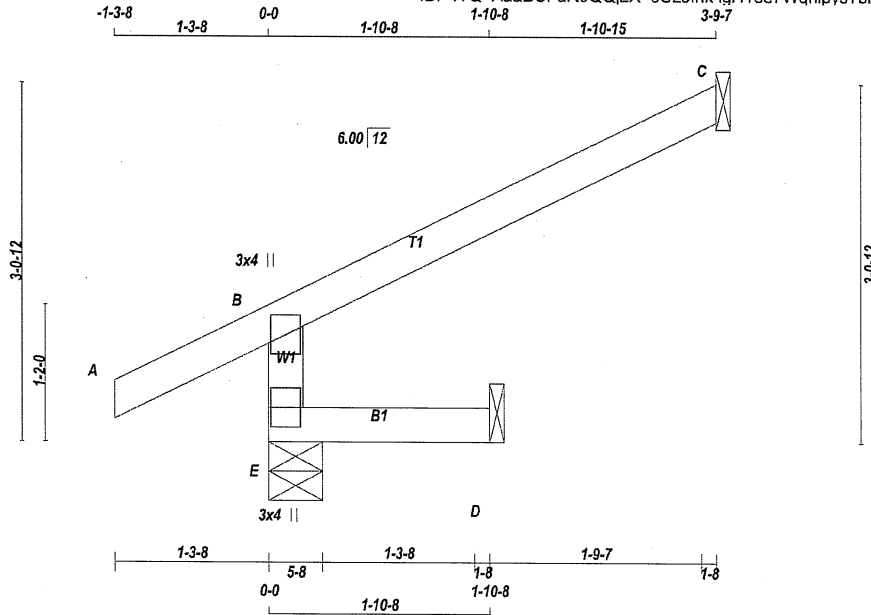

Scale = 1:18.9

TOTAL WEIGHT = 2 X 10 = 19 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQ'D
	VERT	DOWN	BRG	BRG
E	374	0	5-8	5-8
C	135	0	1-8	1-8
D	16	0	1-8	1-8

SEE MITTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
E	259	199 / 0	0 / 0	0 / 0	0 / 0	60 / 0	0 / 0
C	93	76 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0
D	12	0 / 0	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH (LC)	
FR-TO		FROM	TO	FR-TO			
E-B	-354 / 0	0.0	0.0 0.01 (4)	7.81			
A-B	0 / 29	-95.2	-95.2 0.13 (5)	10.00			
B-C	-20 / 0	-95.2	-95.2 0.23 (1)	6.25			
E-D	0 / 0	-18.5	-18.5 0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 26.7 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.23/1.00 (B-C:1), BC=0.02/1.00 (D-E:4)
WB=0.00/1.00 (n/a:0), SSI=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
		788	1987
			1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)

JSI METAL= 0.10 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080005

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J6	5	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:44:41 2022 Page 1

ID: v?Q AaaDSFuR0QQj2X oUz5frnk-T8xgNhf6SClaDcq2LLYKce2cg9ZzUxmXcFydqrryL4

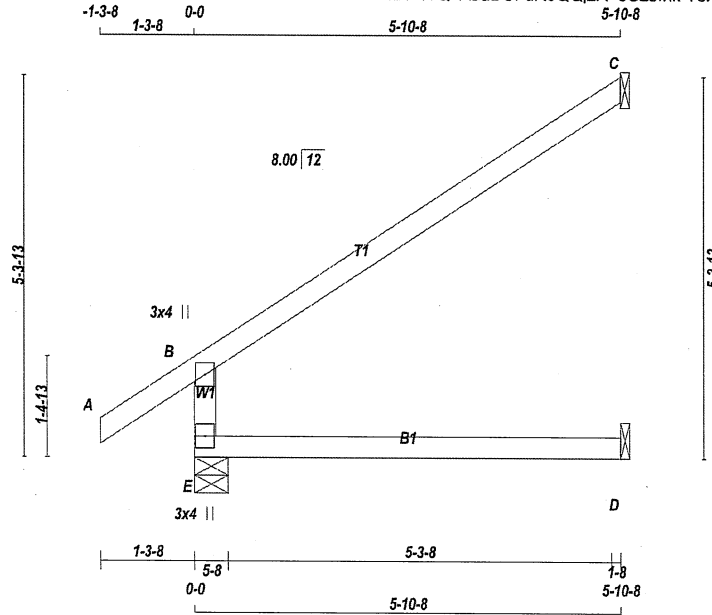

Scale = 1:30.8

TOTAL WEIGHT = 5 X 18 = 89 lb

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
E	543	0	5-8	5-8
C	210	0	1-8	1-8
D	46	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	SNOW	LIVE	PERM LIVE	WIND	DEAD	SOIL
E	381	270 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	144	118 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS	MAX. FACTORED	FACTORED	WEBS	MAX. FACTORED
MEMB.	FORCE (LBS)	VERT. LOAD (PLF)	CS (LC)	MEMB. FORCE (LBS)
FR-TO		FROM TO	UNBRAC	FR-TO
E-B	-480 / 0	0.0	0.0	7.81
A-B	0 / 36	-95.2	-95.2	10.00
B-C	-39 / 0	-95.2	-95.2	6.25
E-D	0 / 0	-18.5	-18.5	10.00

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL = 26.7 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.20")
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.56/1.00 (B-C:1), BC=0.13/1.00 (D-E:4)
WB=0.00/1.00 (n/a:0), SSI=0.23/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.16 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080010

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J7	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 08:45:24 2022 Page 1
ID: v?Q AaaDSFuR0QQi2X oUz5fnk-iP2wOOA5KQjTuDdJMtqPsjK2XUHn2NQsVRtPqrryKP

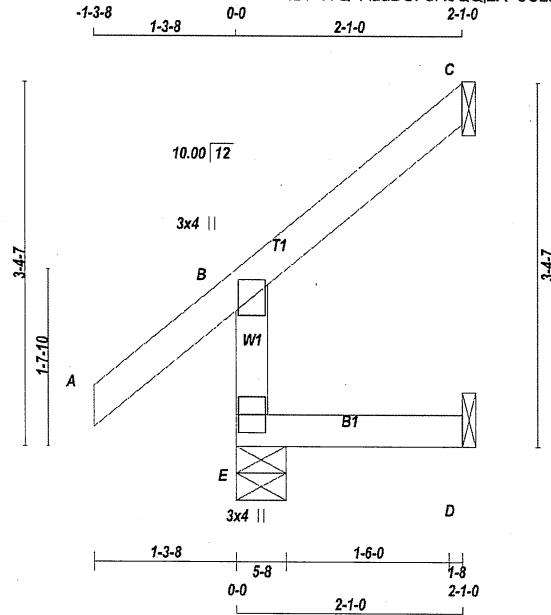

Scale = 1:20.5

TOTAL WEIGHT = 2 X 9 = 18 lb [M]

LUMBER

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
E	BMV1+p	MT20	3.0	4.0		

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT	REQD
JT	VERT	HORZ	DOWN	UP
E	276	0	276	0
C	75	0	75	0
D	18	0	20	0

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST CASE	SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
E	192	143/0	0/0	0/0	0/0	0/0	49/0	0/0
C	52	42/0	0/0	0/0	0/0	0/0	9/0	0/0
D	14	0/0	0/0	0/0	0/0	0/0	14/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		FACTORED		WEBS		FACTORED	
	MAX.	FORCE	VERT.	LOAD	MAX.	MEMB.	MAX.	FORCE
		(LBS)		(PLF)				(LBS)
FR-TO			FROM	TO		LENGTH	FR-TO	
E-B	-255/0		0.0	0.0	0.01 (4)	7.81		
A-B	0/42		-95.2	-95.2	0.13 (1)	10.00		
B-C	-15/0		-95.2	-95.2	0.07 (1)	6.25		
E-D	0/0		-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	26.7	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	40.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

DESIGN ASSUMPTIONS

-OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (D-E:4)
WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
		788	1987

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.12 (B) (INPUT = 0.90)

JSI METAL= 0.09 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080016

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J8	2	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:45:25 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fmk-AbblckBj5rKVNCWwbLeOws7HuXnnqg?i5cyNlvyryKO

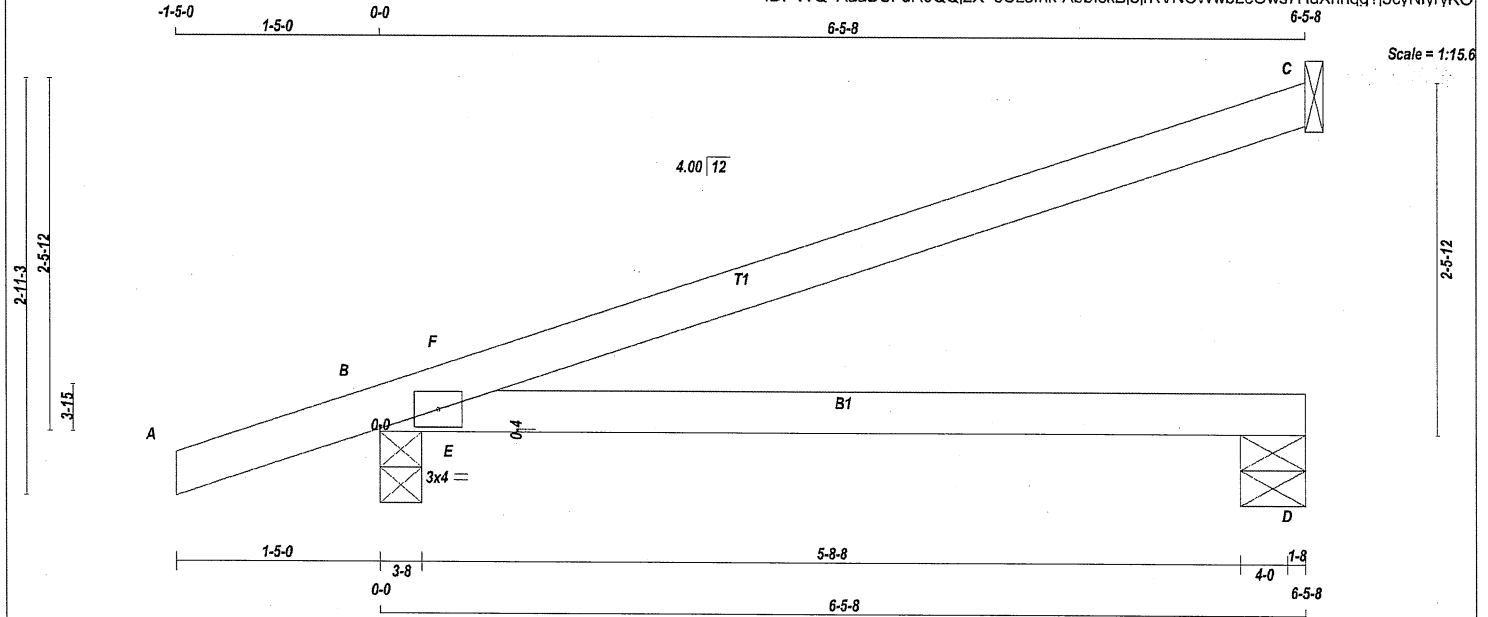

TOTAL WEIGHT = 2 X 17 = 34 lb
(M)(F)

LUMBER

N. L. G. A. RULES	SIZE	LUMBER	DESCR.
CHORDS	2x4	DRY	SPF
A - C	2x4	DRY	No.2
B - D	2x4	DRY	No.2

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
	VERT	DOWN	IN-SX	IN-SX
C	269	0	1-8	1-8
B	506	0	3-8	3-8
D	98	0	5-8	5-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C

UNFACTORED REACTIONS

JT	1ST LOASE COMBINED	MAX./MIN. SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	186	146 / 0	0 / 0	0 / 0	0 / 0	40 / 0	0 / 0
B	355	251 / 0	0 / 0	0 / 0	0 / 0	104 / 0	0 / 0
D	73	27 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 21	-95.2	-95.2 0.14 (1)	E-F	-408 / 15	0.00 (1)	
B-F	-22 / 32	-95.2	-95.2 0.08 (1)				
F-C	-3 / 2	-95.2	-95.2 0.51 (1)				
B-E	0 / 0	-18.5	-18.5 0.35 (1)				
E-D	0 / 0	-18.5	-18.5 0.35 (1)				

DESIGN CRITERIA

SPECIFIED LOADS:
TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:
- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.22")
CALCULATED VERT. DEFL.(LL)= L/733 (0.11")
ALLOWABLE DEFL.(TL)= L/360 (0.22")
CALCULATED VERT. DEFL.(TL)= L/362 (0.21")

CSI: TC=0.51/1.00 (C-F:1), BC=0.35/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.33/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES
PLATE GRIP(DRY) SHEAR SECTION
(PSI) (PLI) (PLI)
MAX MIN MAX MIN MAX MIN
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.34 (B) (INPUT = 0.90)
JSI METAL= 0.09 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY
DWG # TR22080017

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427257	J9	6	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 08:44:42 2022 Page 1
ID: v?Q AaaDSFuR0QQj2X oUz5fuk-xKV2a1fIDWQRmPFv33Z9sat8Zw2CO0grvhBMHyryL3

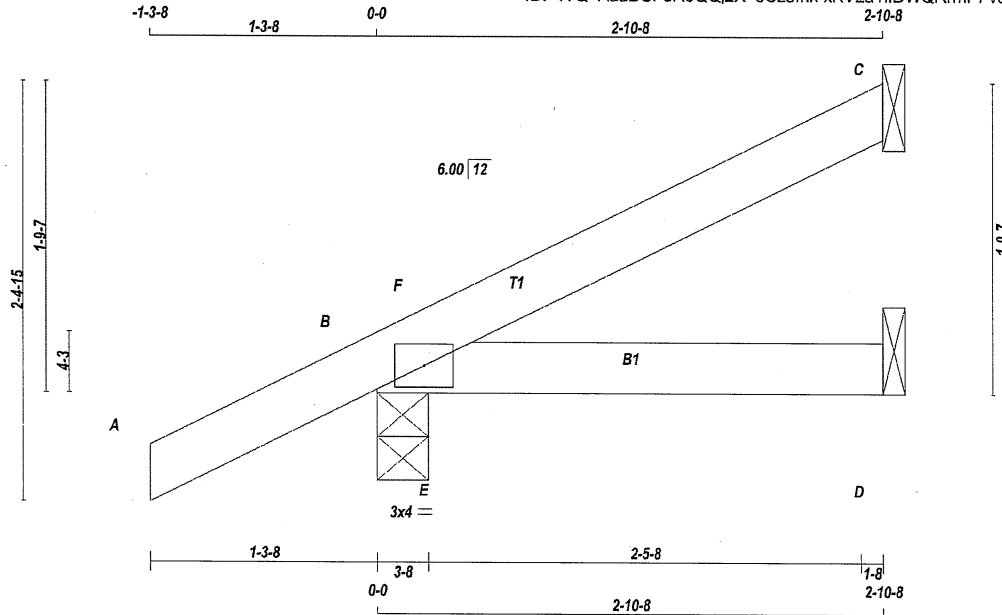

Scale = 1:12.7

TOTAL WEIGHT = 6 X 9 = 53 lb

LUMBER

N. L. G. A. RULES
CHORDS SIZE
A - C 2x4 DRY
B - D 2x4 DRY

LUMBER
No.2
No.2

DESCR.
SPF
SPF

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
C	118	0	118	0	0	1-8	1-8	
B	293	0	293	0	0	3-8	3-8	
D	46	0	46	0	0	1-8	1-8	

SEE MITTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

JT	1ST LCASE	MAX / MIN. COMPONENT REACTIONS		SNOW	LIVE	PERM. LIVE	WIND	DEAD	SOIL
		COMBINED							
C	81	64 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0
B	204	149 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	55 / 0	0 / 0
D	34	13 / 0	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	21 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS		FACTORED		WEBS		FACTORED	
MEMB.	FORCE (LBS)	VERT.	LOAD (PLF)	MAX. (LC)	MEMB.	FORCE (LBS)	MAX. (LC)
FR-TO		FROM	TO	LENGTH	FR-TO		
A-B	0 / 27	-95.2	-95.2	0.13 (5)	10.00	E-F	-138 / 3
B-F	-12 / 0	-95.2	-95.2	0.02 (4)	6.25		
F-C	0 / 2	-95.2	-95.2	0.10 (1)	10.00		
B-E	0 / 0	-18.5	-18.5	0.08 (1)	10.00		
E-D	0 / 0	-18.5	-18.5	0.08 (1)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH. LL = 26.7 PSF
DL = 6.0 PSF
BOT CH. LL = 0.0 PSF
DL = 7.4 PSF
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.13/1.00 (A-B:5), BC=0.08/1.00 (B-E:1), WB=0.00/1.00 (E-F:1), SSI=0.11/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.23 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080011



TOTAL WEIGHT = $8 \times 17 = 134 \text{ lb}$


1) Lateral braces to be a minimum of 2X4 SPF #2.

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 19	-95.2	-95.2	0.12 (1)	10.00	E-F	-408 / 15
B-F	-22 / 32	-95.2	-95.2	0.08 (1)	6.25		0.00 (1)
F-C	-3 / 2	-95.2	-95.2	0.51 (1)	10.00		
B-E	0 / 0	-18.5	-18.5	0.35 (1)	10.00		
E-D	0 / 0	-18.5	-18.5	0.35 (1)	10.00		

JSI GRIP= 0.33 (B) (INPUT = 0.90)
JSI METAL= 0.08 (B) (INPUT = 1.00)



JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427323	J11	7	1	GREENPARK HOMES	
				TRUSS DESC.	

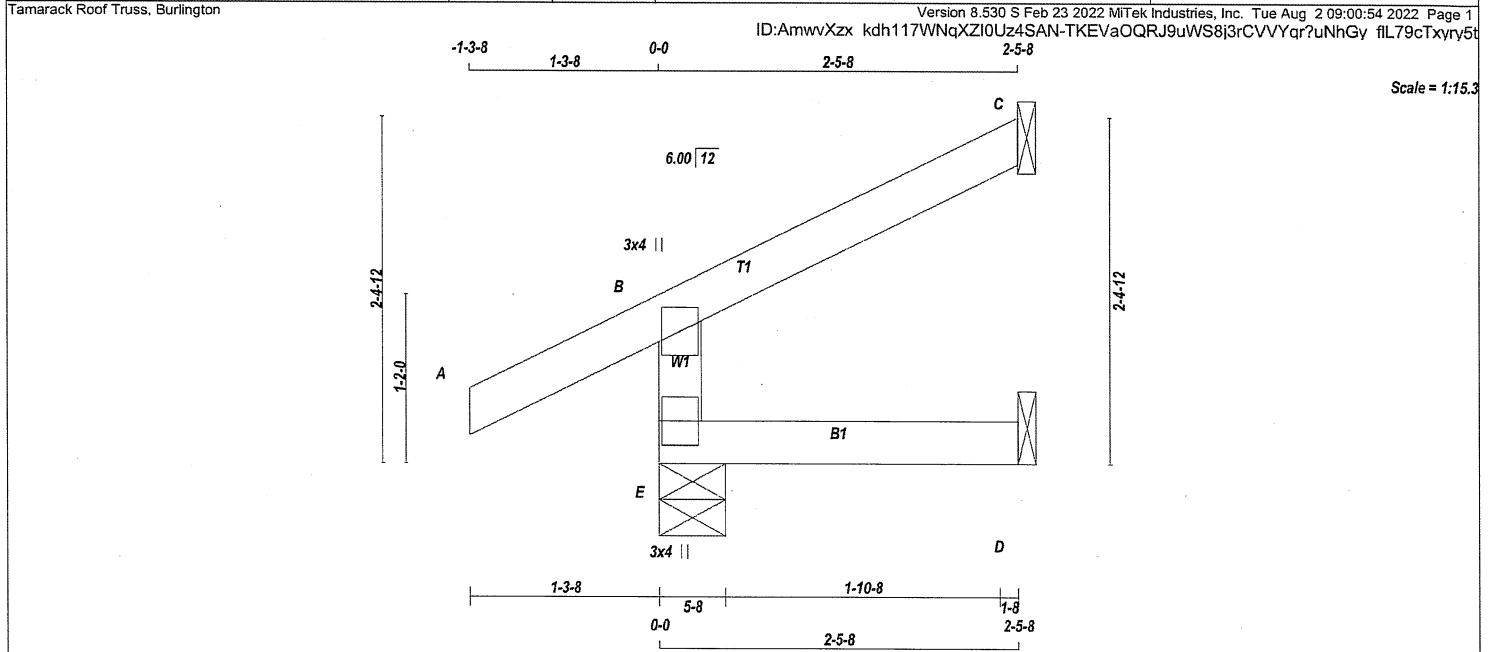

TOTAL WEIGHT = 7 X 9 = 60 lb

LUMBER N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. E - B 2x4 DRY No.2 SPF A - C 2x4 DRY No.2 SPF E - D 2x4 DRY No.2 SPF DRY: SEASONED LUMBER.							DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS <table><tr><th rowspan="2">JT</th><th colspan="2">FACTORED GROSS REACTION</th><th colspan="2">MAXIMUM FACTORED GROSS REACTION</th><th colspan="2">INPUT BRG</th><th colspan="2">REQD BRG</th></tr><tr><th>VERT</th><th>HORZ</th><th>DOWN</th><th>HORZ</th><th>UPLIFT</th><th>IN-SX</th><th>IN-SX</th></tr><tr><td>E</td><td>301</td><td>0</td><td>301</td><td>0</td><td>0</td><td>5-8</td><td>5-8</td></tr><tr><td>C</td><td>88</td><td>0</td><td>88</td><td>0</td><td>0</td><td>1-8</td><td>1-8</td></tr><tr><td>D</td><td>20</td><td>0</td><td>22</td><td>0</td><td>0</td><td>1-8</td><td>1-8</td></tr></table> SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C , D UNFACTORED REACTIONS <table><tr><th rowspan="2">JT</th><th rowspan="2">1ST LCASE COMBINED</th><th colspan="6">MAX./MIN. COMPONENT REACTIONS</th></tr><tr><th>SNOW</th><th>LIVE</th><th>PERM.LIVE</th><th>WIND</th><th>DEAD</th><th>SOIL</th></tr><tr><td>E</td><td>210</td><td>155 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>55 / 0</td><td>0 / 0</td></tr><tr><td>C</td><td>61</td><td>49 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>11 / 0</td><td>0 / 0</td></tr><tr><td>D</td><td>16</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>0 / 0</td><td>16 / 0</td><td>0 / 0</td></tr></table> BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E BRACING TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED. ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED. LOADING TOTAL LOAD CASES: (5) <table><tr><th colspan="4">CHORDS</th><th colspan="4">WEBS</th></tr><tr><th rowspan="2">MEMB.</th><th rowspan="2">MAX. FACTORED FORCE (LBS)</th><th colspan="2">FACTORED VERT. LOAD</th><th rowspan="2">LC1 MAX</th><th rowspan="2">MEMB.</th><th rowspan="2">MAX. FACTORED FORCE (LBS)</th><th rowspan="2">MAX CSI (LC)</th></tr><tr><th>PLF</th><th>CSI (LC)</th><th>UNBRAC LENGTH</th></tr><tr><td>FR-TO</td><td></td><td>FROM</td><td>TO</td><td></td><td>FR-TO</td><td></td><td></td></tr><tr><td>E- B</td><td>-275 / 0</td><td>0.0</td><td>0.0</td><td>0.02 (4)</td><td>7.81</td><td></td><td></td></tr><tr><td>A- B</td><td>0 / 29</td><td>-95.2</td><td>-95.2</td><td>0.13 (5)</td><td>10.00</td><td></td><td></td></tr><tr><td>B- C</td><td>-13 / 0</td><td>-95.2</td><td>-95.2</td><td>0.10 (1)</td><td>6.25</td><td></td><td></td></tr><tr><td>E- D</td><td>0 / 0</td><td>-18.5</td><td>-18.5</td><td>0.03 (4)</td><td>10.00</td><td></td><td></td></tr></table> <u>CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN</u>							JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG		VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	E	301	0	301	0	0	5-8	5-8	C	88	0	88	0	0	1-8	1-8	D	20	0	22	0	0	1-8	1-8	JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS						SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	E	210	155 / 0	0 / 0	0 / 0	0 / 0	55 / 0	0 / 0	C	61	49 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0	D	16	0 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0	CHORDS				WEBS				MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD		LC1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	PLF	CSI (LC)	UNBRAC LENGTH	FR-TO		FROM	TO		FR-TO			E- B	-275 / 0	0.0	0.0	0.02 (4)	7.81			A- B	0 / 29	-95.2	-95.2	0.13 (5)	10.00			B- C	-13 / 0	-95.2	-95.2	0.10 (1)	6.25			E- D	0 / 0	-18.5	-18.5	0.03 (4)	10.00			DESIGN CRITERIA SPECIFIED LOADS: TOP CH. LL = 26.7 PSF DL = 6.0 PSF BOT CH. LL = 0.0 PSF DL = 7.4 PSF TOTAL LOAD = 40.1 PSF SPACING = 24.0 IN. C/C THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015 THIS DESIGN COMPLIES WITH: - PART 9 OF BCBC 2018 , ABC 2019 - PART 9 OF OBC 2012 (2019 AMENDMENT) - CSA 086-14 - TPIC 2014 DESIGN ASSUMPTIONS -OVERHANG NOT TO BE ALTERED OR CUT OFF. (55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD ALLOWABLE DEFL.(LL)= L/360 (0.19") CALCULATED VERT. DEFL.(LL) = L/ 999 (0.00") ALLOWABLE DEFL.(TL)= L/360 (0.19") CALCULATED VERT. DEFL.(TL) = L/ 999 (0.00") CSI: TC=0.13/1.00 (A-B:5) , BC=0.03/1.00 (D-E:4) , WB=0.00/1.00 (n/a:0) , SSI=0.10/1.00 (B-C:1) DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10 COMPANION LIVE LOAD FACTOR = 1.00 AUTOSOLVE RIGHT HEEL ONLY TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT . NAIL VALUES PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) MAX MIN MAX MIN MAX MIN MT20 650 371 1747 788 1987 1873 PLATE PLACEMENT TOL. = 0.250 inches PLATE ROTATION TOL. = 5.0 Deg. JSI GRIP= 0.11 (E) (INPUT = 0.90) JSI METAL= 0.08 (B) (INPUT = 1.00)						
JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQD BRG																																																																																																																																																						
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX																																																																																																																																																						
E	301	0	301	0	0	5-8	5-8																																																																																																																																																						
C	88	0	88	0	0	1-8	1-8																																																																																																																																																						
D	20	0	22	0	0	1-8	1-8																																																																																																																																																						
JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS																																																																																																																																																											
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL																																																																																																																																																						
E	210	155 / 0	0 / 0	0 / 0	0 / 0	55 / 0	0 / 0																																																																																																																																																						
C	61	49 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0																																																																																																																																																						
D	16	0 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0																																																																																																																																																						
CHORDS				WEBS																																																																																																																																																									
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD		LC1 MAX	MEMB.	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)																																																																																																																																																						
		PLF	CSI (LC)					UNBRAC LENGTH																																																																																																																																																					
FR-TO		FROM	TO		FR-TO																																																																																																																																																								
E- B	-275 / 0	0.0	0.0	0.02 (4)	7.81																																																																																																																																																								
A- B	0 / 29	-95.2	-95.2	0.13 (5)	10.00																																																																																																																																																								
B- C	-13 / 0	-95.2	-95.2	0.10 (1)	6.25																																																																																																																																																								
E- D	0 / 0	-18.5	-18.5	0.03 (4)	10.00																																																																																																																																																								

8/02/22

C. M. HEYENS

100505065

Cheng

LICENSED PROFESSIONAL ENGINEER

PROVINCE OF ONTARIO

STRUCTURAL COMPONENT ONLY
DWG # TR22080035




STRUCTURAL COMPONENT ONLY
DWG # TR22080035

JOB NAME	TRUSS NAME	QUANTITY	PLY	JOB DESC.	DRWG NO.
427323	J12	6	1	GREENPARK HOMES	
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:00:55 2022 Page 1
ID:AmwvXzx kdh117WNqXZi0Uz4SAN-xWotokR44TON4IFPv1k52N9cn?fhRuuanu9?Oyry5s

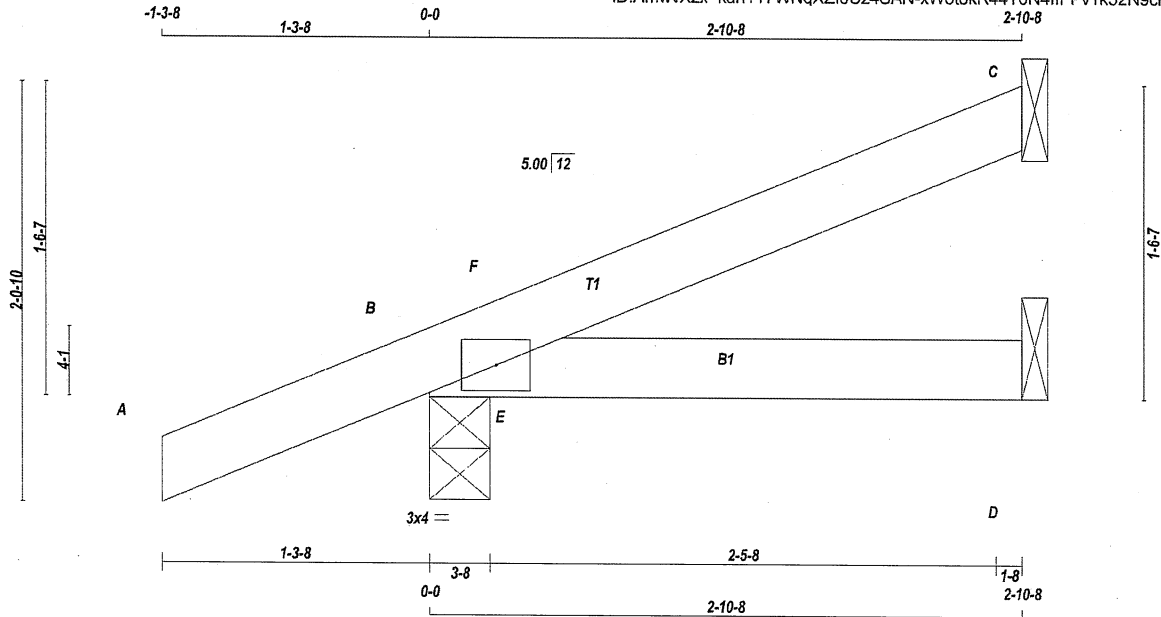

TOTAL WEIGHT = 6 X 9 = 51 lb [M]

LUMBER

N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.		
A - C	2x4	DRY	No.2	SPF	
B - D	2x4	DRY	No.2	SPF	

DRY: SEASONED LUMBER.

PLATES (table is in inches)

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

NOTES- (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER

BEARINGS

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQD BRG
JT	VERT	HORZ	DOWN	UPLIFT
C	117	0	117	0
B	292	0	292	0
D	47	0	47	0

SEE MITTEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

UNFACTORED REACTIONS

1ST LCASE	MAX/MIN	COMPONENT REACTIONS					
JT	COMBINED	SNOW	LIVE	PERM.	LIVE	WIND	DEAD
C	81	63/0	0/0	0/0	0/0	0/0	18/0
B	204	149/0	0/0	0/0	0/0	0/0	55/0
D	34	14/0	0/0	0/0	0/0	0/0	21/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

BRACING

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

LOADING

TOTAL LOAD CASES: (5)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0/23	-95.2	-95.2 0.13 (5)	E-F	-118/3	0.00 (1)	
B-F	-10/0	-95.2	-95.2 0.02 (4)				
F-C	0/2	-95.2	-95.2 0.10 (1)				
B-E	0/0	-18.5	-18.5 0.08 (1)				
E-D	0/0	-18.5	-18.5 0.08 (1)				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

DESIGN CRITERIA

SPECIFIED LOADS:

TOP CH.	LL	=	26.7	PSF
	DL	=	6.0	PSF
BOT CH.	LL	=	0.0	PSF
	DL	=	7.4	PSF
TOTAL LOAD		=	40.1	PSF

SPACING = 24.0 IN. C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")
ALLOWABLE DEFL.(TL)= L/360 (0.19")
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.13/1.00 (A-B:5), BC=0.08/1.00 (B-E:1)

, WB=0.00/1.00 (E-F:1), SSI=0.10/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX	MIN	MAX MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.20 (B) (INPUT = 0.90)
JSI METAL= 0.05 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY
DWG # TR22080036

EWP DESIGN INC.

(905) 832-2250

FAX (905) 832-0286

RESPONSIBILITIES AND SPECIFICATIONS

RESPONSIBILITIES

1. EWP DESIGN INC. is responsible for the design of trusses as individual components.
2. It is the responsibility of others to ascertain that the design loads utilized on each drawing meet or exceed the actual dead load imposed by the structure, the live load imposed by the intended use and the snow load imposed by local building code or authorities with jurisdictions.
3. All dimensions are to be verified by the owner, contractor, architect or other authorities with jurisdictions before truss fabrication.
4. EWP DESIGN INC. bears no responsibility for the erection of trusses. Persons erecting trusses are cautioned to seek professional advice regarding the temporary and permanent bracing for the system. Bracing shown on EWP DESIGN INC. drawing is specified for the truss as a component only and forms an integral part of the truss design.
5. It is the truss manufacturer's responsibility to ensure that trusses are manufactured in conformance with specifications of EWP DESIGN INC. as outlined below.

SPECIFICATIONS

1. Trusses designed by EWP DESIGN INC. conform to the relevant section of the Ontario Building Code of Canada (Part 9 or Part 4) or to the Canadian code for farm buildings, whichever applies to the building type, as indicated on the EWP DESIGN INC. drawings, and conform to the design procedures established by the Truss Plate Institute of Canada. Unit stresses used for truss designs are as per the edition of CSA-O86 shown on EWP DESIGN INC. drawings.
2. Lumber is to be the size, species and grade as specified on EWP DESIGN INC. drawings.
3. Moisture content of lumber shall not exceed 19% in service unless specified otherwise.
4. Metal connector plates shall be applied to both faces of truss at each joint and shall be positioned as specified.
5. Top chords of trusses are assumed to be continuously braced laterally by roof sheathing or by purlins at intervals not exceeding 12.5 times the thickness of top chord member.
6. Bottom chords shall be laterally braced at intervals not exceeding 3M (10') o.c., where rigid ceiling is not applied directly to the underside of chords.

THESE DRAWINGS CONSTITUTE THE PROPERTY OF EWP DESIGN INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY THE ALPA LUMBER GROUP, AND WILL BE RETRACTED BY EWP DESIGN INC. IF UTILIZED FOR ANY OTHER PURPOSE.

February 1, 2019

TOE-NAIL CAPACITY DETAILS

LATERAL AND WITHDRAWAL RESISTANCE OF BEARING ANCHORAGE BY TOE-NAILS

			SPF	D. FIR	SPF	D. FIR
COMMON WIRE	3.00	0.144	122	139	30	42
	3.25	0.144	127	144	32	45
	3.50	0.160	152	173	38	52
COMMON SPIRAL	3.00	0.122	96	108	26	36
	3.25	0.122	97	108	28	40
	3.50	0.152	142	161	36	50
3.25" Gun nail	3.25	0.120	94	105	28	39

Note: If using truss with D. Fir lumber and SPF bearing plate, use tabulated SPF values in table.

Nail type:	Common wire	Common spiral	Common wire	Common spiral	Gun Nail
Diameter (in.)	0.160	0.152	0.144	0.122	0.120
Length (in.)	3.50	3.50	3.00	3.00	3.25
2x4 SPF	2	2	3	3	3
2x6 SPF	4	4	4	5	5
2x4 D. FIR	2	2	2	2	2
2x6 D. FIR	3	3	3	4	4


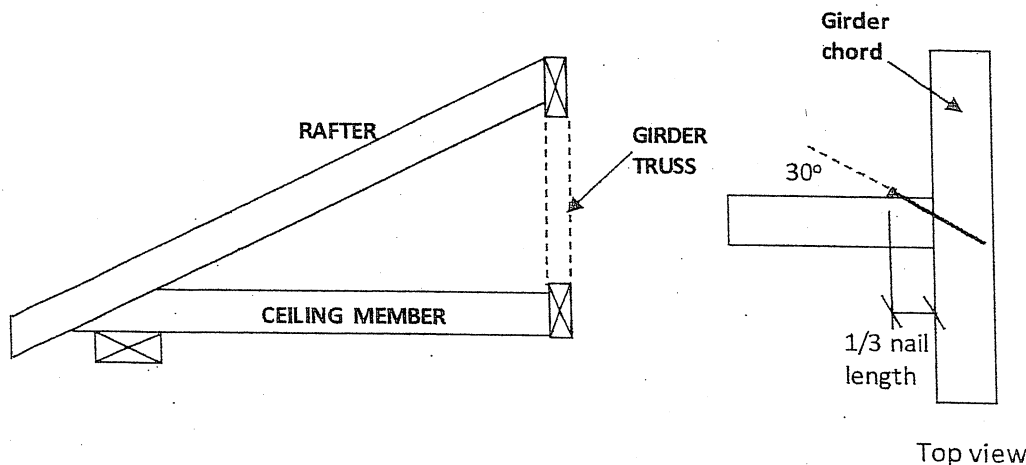


Figure 1: Toe-Nailing Rafter / Ceiling Member to Girder Truss



TOE-NAIL CAPACITY DETAILS


Figure 2: Toe-Nail Anchorage to Bearing Plate for Uplift

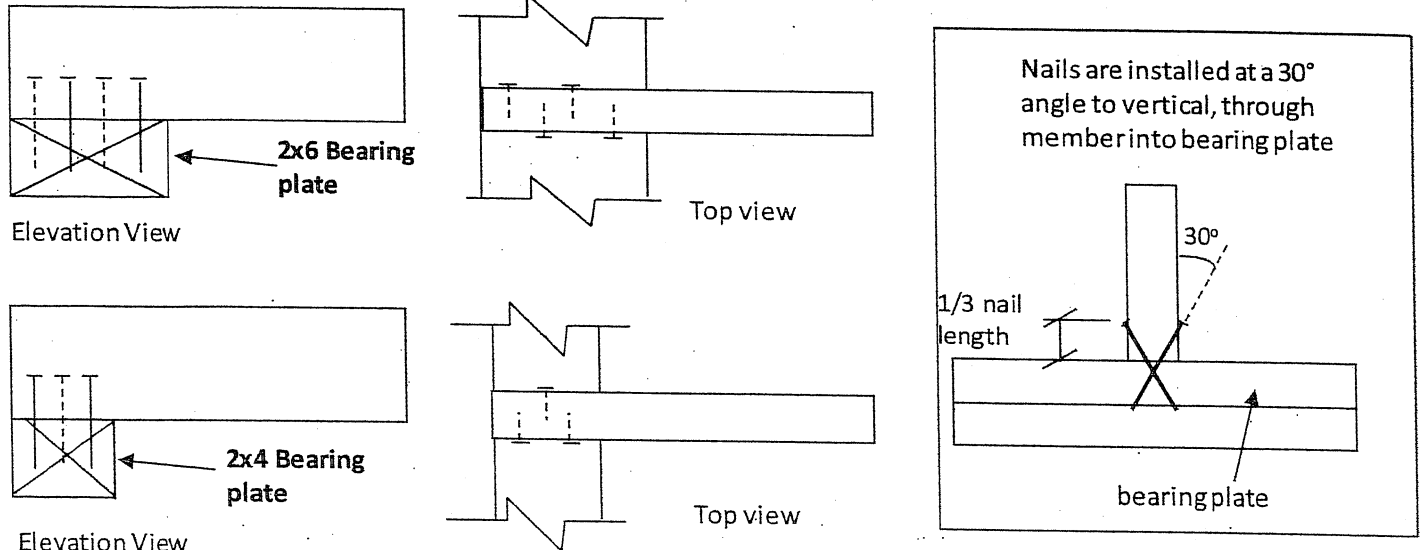

NOTES:

1. Rafter and ceiling members may be connected to top and bottom chords of girder truss by toe-nailing the members into the girder chords (see fig. 1), provided the factored vertical reactions of the supported members do not exceed the lateral resistance of the toe-nails. Mechanical connectors (hangers) are required if factored vertical reactions exceed the toe-nail capacity, or if the connection must resist horizontal loads (loads perpendicular to the face of girder or rafter).
2. Trusses, rafters or ceiling members may be anchored to the bearing plate with toe-nails (see fig. 2), provided that the factored uplift reactions due to **wind or earthquake loads** do not exceed the **withdrawal resistance of the toe-nails**. Mechanical anchors (tie-downs) are required for reactions that exceed the toe-nail withdrawal capacity. Toe-nail anchorage to bearing plates is **NOT** permitted if uplift reactions are generated from gravity loads (snow, floor live, dead).
3. Tabulated toe-nail resistances on page 1 are for **one** toe-nail. Multiply unit values by the number of nails used in the connection. Maximum number of nails in a connection shall not exceed the tabulated limits shown on page 1 for a given lumber size /species.
4. Nail values are based on specific gravity of $G = 0.42$ (SPF) and $G = 0.49$ (D. Fir).
5. Toe-nails shall be driven at approximately $1/3$ the nail length from the edge of the joist/truss chord and driven at an angle of 30° to the grain of the member.
6. For wind / earthquake loads, tabulated lateral resistances may be multiplied by 1.15 (K_0 factor). No increases are permitted for tabulated withdrawal resistances.
7. Lumber must be dry ($< 19\%$ moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-19, Clause 12.9.

PEO
Certificate No. 10889485

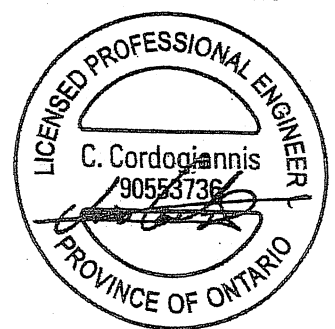

LUL/LUS/LJS/HUS/HHUS/HGUS

Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LUS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

Material: See table on pp. 217–218.

Finish: Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 18–20.

Installation:

- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1½" nails into the header and 10d commons into the joist, and reduce the resistance to 0.84 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

Options:

- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on pp. 105–107.



Double-Shear Nailing Top View






Double-Shear Nailing Side View; Do not bend tab




Dome Double-Shear Nailing Side View (available on some models)


Typical HUS26 Installation with Reduced Heel Height (Truss Designer to provide fastener quantity for connecting multiple members together)

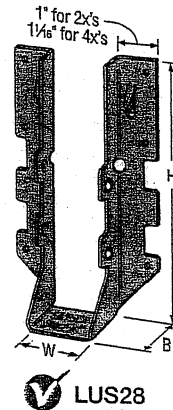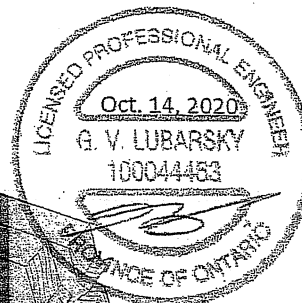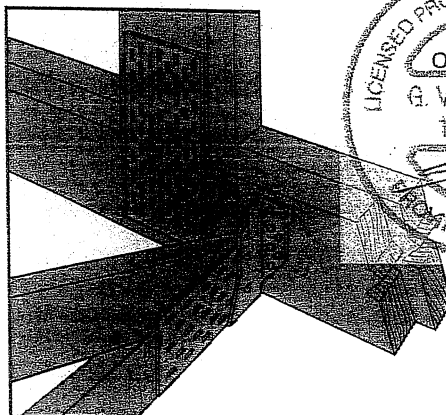


✓ LUS28

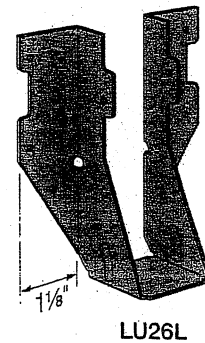


LU26L

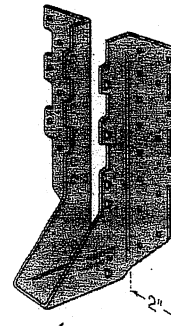


✓ HUS210
(HUS26, HUS28, and HHUS similar)

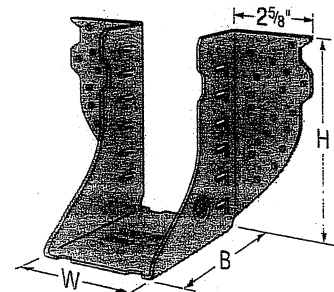

✓ HGUS28-2

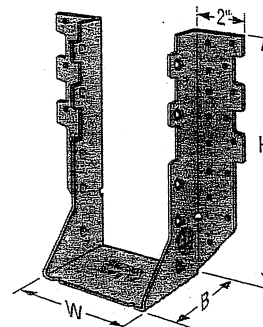

✓ HHUS210-2

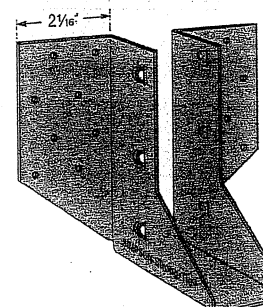

LJS26DS

LUS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

Material: 18 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3½" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.

Options:

- These hangers cannot be modified

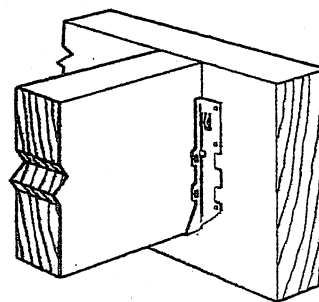


Typical LUS Installation

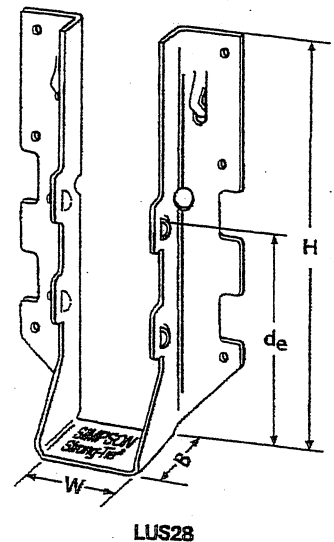


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
LUS24	18	1½	3½	1¾	1½	(4) 10d	(2) 10d	710	1630	645	1155
LUS24-2	18	3½	3½	2	1½	(4) 16d	(2) 16d	835	2020	590	1435
LUS26	18	1½	4¾	1¾	3½	(4) 10d	(4) 10d	1420	2170	1290	1630
LUS26-2	18	3½	4¾	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
LUS26-3	18	4¾	4¾	2	3¾	(4) 16d	(4) 16d	1720	2595	1545	2340
LUS28	18	1½	6¾	1¾	3¾	(6) 10d	(6) 10d	1420	2520	1290	1790
LUS28-2	18	3½	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
LUS28-3	18	4¾	6¾	2	3¾	(6) 16d	(4) 16d	1720	3325	1545	2375
LUS210	18	1½	7½	1¾	3¾	(8) 10d	(4) 10d	1420	2785	1290	2210
LUS210-2	18	3½	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
LUS210-3	18	4¾	8¾	2	5¾	(8) 16d	(6) 16d	2580	3345	2320	2375


1. d_e is the distance from the seat of the hanger to the highest joist nail.



Dome Double Shear Nailing prevents tabs breaking off (available on some models).
U.S. Patent 5,603,580



Double Shear Nailing Top View.

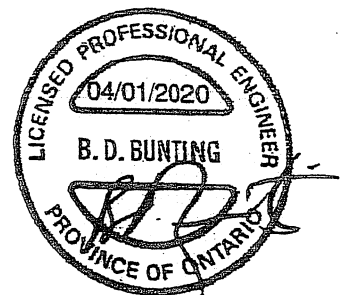

LIMIT STATES DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPEC LUS20 3/20 exp. 6/22

(800) 999-5099
strongtie.com

HUS/LJS - Double Shear Joist Hangers

SIMPSON
Strong-Tie

All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: See table

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86 -14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options

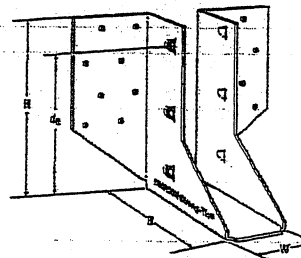


LJS26DS




HUS210
(HUS26, HUS28, similar)



Typical LJS26DS
Installation

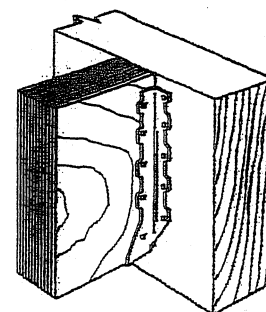


Typical HUS
Installation

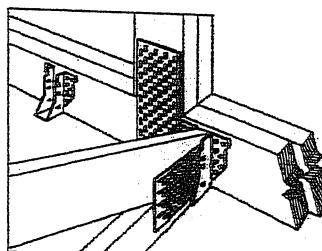


Typical HUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d _e ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _u =1.00)	Uplift (K _u =1.15)	Normal (K _u =1.00)
LJS26DS	18	1 1/16	5	3 1/2	4 1/8	(16) 16d	(6) 16d	2055	4265	1460	4115
HUS26	16	1 1/8	5 1/8	3	3 1/16	(14) 16d	(6) 16d	2705	4940	2065	3875
HUS28	16	1 1/8	7 1/32	3	6 1/32	(22) 16d	(8) 16d	3605	5365	2675	4345
HUS210	16	1 1/8	9 1/32	3	7 3/32	(30) 16d	(10) 16d	4505	5795	4010	4740
HUS1.81/10	16	1 13/16	9	3	8	(30) 16d	(10) 16d	4505	6450	4010	5200


1. d_e is the distance from the seat of the hanger to the highest joist nail.



Dome Double Shear Nailing prevents tabs breaking off (available on some models).
U.S. Patent 5,803,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.




LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22



(800) 999-5099
strongtie.com

HGUS – Double Shear Joist Hangers

SIMPSON
Strong-Tie

All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

Material: 12 gauge

Finish: G90 galvanized

Design:


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%.
No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

Installation:


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

Options:


- See current catalogue for options

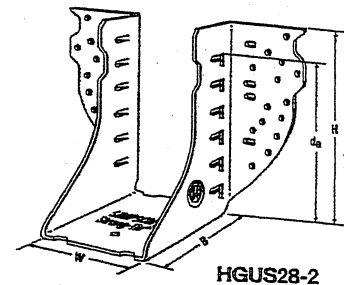

HGUS28-2

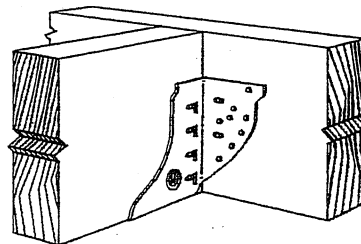


Typical HGUS Installation

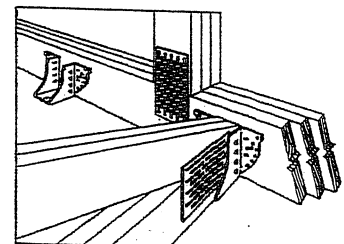

Typical HGUS Installation
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d ₁ ¹	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K _u =1.15)	Normal (K _n =1.00)	Uplift (K _u =1.15)	Normal (K _n =1.00)
HGUS26	12	1⅞	5⅜	5	4⅝	(20) 16d	(8) 16d	2685	6625	2685	5700
HGUS26-2	12	3⅞	5⅞	4	4⅝	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-3	12	4⅞	5½	4	4⅝	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-4	12	6⅞	5⅞	4	4⅝	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS28	12	1⅞	7⅞	5	6⅝	(36) 16d	(12) 16d	3310	7675	3100	6900
HGUS28-2	12	3⅞	7⅞	4	6⅝	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-3	12	4⅞	7¼	4	6⅝	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-4	12	6⅞	7⅞	4	6⅝	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS210	12	1⅞	9⅞	5	7⅞	(46) 16d	(16) 16d	3535	11070	2510	8090
HGUS210-2	12	3⅞	9⅞	4	8⅞	(46) 16d	(16) 16d	6840	14015	4855	10270
HGUS210-3	12	4⅞	9¼	4	8⅞	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS210-4	12	6⅞	9⅞	4	8⅞	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS212-4	12	6⅞	10⅞	4	10⅞	(56) 16d	(20) 16d	7640	14995	5425	10645
HGUS214-4	12	6⅞	12⅞	4	11⅞	(66) 16d	(22) 16d	10130	16400	7195	11645

1. d₁ is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).

U.S. Patent
5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.




LIMIT
STATES
DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see strongtie.com.

© 2020 Simpson Strong-Tie Company Inc.


T-SPECHGUS20 3/20 exp. 6/22

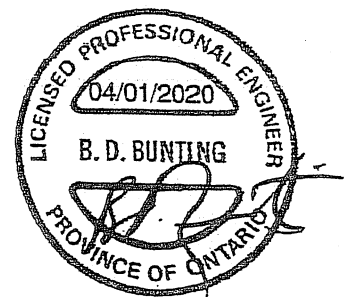


(800) 999-5099
strongtie.com

Symbols

PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/8" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

*Plate location details available in MiTek software or upon request.

PLATE SIZE

4 x 4

The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.


Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses
DSB-89: Design Standard for Bracing.
BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

Numbering System



dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

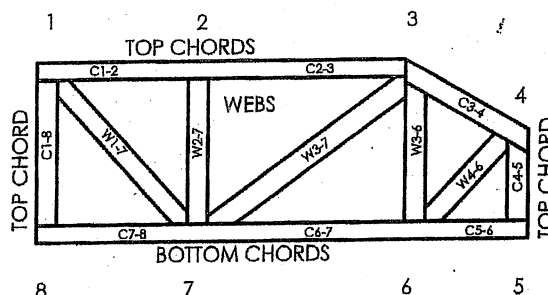

JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.

CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.

PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

MiTek
POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-'08

General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.