

FINISH O.H: 12'  
 Heel: R.T.M.C  
 CLADDING ALLOWANCE: 5"  
 2X6 EXTERIOR WALLS  
 ASPHALT SHINGLES  
 2X6 FASCIA BOARD

ALL CONVENTIONAL ROOF FRAMING TO CONFORM TO PARTS OF THE OBC LATEST EDITION  
 ROOF RAFTERS THAT MEET OR CROSS OVER TRUSSES ARE TO BE 2"x4" SPF @ 24" o.c. WITH A 2"x4" SPF VERTICAL POST TO THE TRUSS UNDER AT EACH CROSS POINT. POSTS LONGER THAN 6' TO BE Laterally BRACED SO THAT THE DISTANCE BETWEEN END POINTS AND BETWEEN ROWS OF BRACING DOES NOT EXCEED 6'.

TRUSSES DESIGNED CONFORM TO THE RELEVANT SECTION OF THE LATEST EDITION OF THE ONTARIO BUILDING CODE (RESIDENTIAL PART 9)

DESIGN CONFORMS WITH OBC 2012(2019 AMENDMENT)  
 OCCUPANCY: RESIDENTIAL | PART: 9  
 S<sub>s</sub> = 33.4 psf | S<sub>r</sub> = 8.4 psf



DESIGN LOADS:  
 TC<sub>SL</sub> = 26.7 psf  
 TC<sub>DL</sub> = 6.0 psf  
 BC<sub>LL</sub> = 0.0 psf  
 BC<sub>DL</sub> = 7.4 psf

HARDWARE  
 LUS24(O)  
 LUS26(S)(V)  
 LUS26-(W)(V)  
 HGUS26-2(XX)

DROPPED BEAM (DB)

ALL ROOF PITCHES ARE 10/12 UNLESS OTHERWISE NOTED

 DENOTES: CONVENTIONAL FRAMING

 1'-6" HIGHER PLATE  
 1'-6" HIGHER FASCIA

DWG# TR22080046 TO TR22080070



STRUCTURAL COMPONENTS ONLY  
 DWG# TR22080108

### TRUSS PLACEMENT PLAN.

This is a truss placement plan only, NOT a final roof framing plan. These trusses are designed as individual building components to be incorporated into the building design at the specification of the building designer. See individual truss drawings for each component identified on this placement plan.

Please verify that all dimensions match the dimensions found on the job. The Building designer is responsible for the temporary/permanent bracing of the roof and floor system and its integration into the bracing of the overall structure. The design of the truss support structure including headers, beams, walls, and columns is the responsibility of the building designer unless otherwise noted in this plan. Building designer to review and approve this plan to ascertain conformity to his overall structural plan.


MIF0036



Job Track: 52956	Builder / Location: GREENPARK HOMES / CAMBRIDGE
Layout ID: 427369	Project: BARLASSINA
Plan Log: 206367	Date: 8/02/22 Designer: AT

Model / Elevation: GARDEN 2 / 1	Mitek ver 8.5.3.293
THESE DRAWINGS CONSTITUTE THE PROPERTY OF TAMARACK ROOF TRUSSES INC. SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY TAMARACK ROOF TRUSSES INC AND WILL BE RETRACTED BY TAMARACK ROOF TRUSSES INC IF UTILIZED FOR ANY OTHER PURPOSE.	

# DELIVERY SHIPLIST

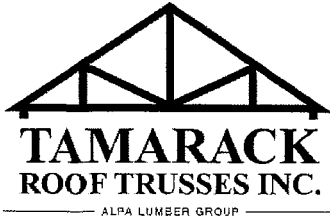

Lumber Yard: TAMARACK LUMBER  
 Builder: GREENPARK HOMES  
 Project: BARLASSINA  
 Location: CAMBRIDGE  
 Model: GARDEN 2  
 Lot #:   
 Elevation: 1

Job Track: 52956  
 PlanLog: 206367  
 Layout ID: 427369  
 Ref #  
 Page: 1 of 2  
 Date: 08-03-2022  
 Designer: )  
 Sales Rep: Rick DiCiano

## Roof Trusses

PROFILE	QTY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG		HEEL HEIGHT		LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	PLY						LEFT RIGHT	LEFT RIGHT					
	1 2-ply	T1 Hip Girder	6/12	22-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	203.69 128.00				
	1	T2 Hip	6/12	22-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	94.14 59.33				
	1	T3 Hip	6/12	22-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	96.52 60.17				
	12	T4 Common	6/12	22-11-00	6-10-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1097.59 692.00				
	1 2-ply	T5 Hip Girder	10/12	22-11-00	5-05-08	2 x 6	1-03-08 1-05-00	1-07-10 1-07-10	257.06 157.00				
	2	T6 Hip	10/12	22-11-00	6-07-13	2 x 4	1-03-08 1-05-00	1-07-10 1-07-10	212.43 134.33				
	2	T7 Hip	10/12	22-11-00	7-11-13	2 x 4	1-03-08 1-05-00	1-07-10 1-07-10	235.77 150.00				
	1 2-ply	T8 Jack-Open Girder	8/12	5-10-08	5-03-13	2 x 4 2 x 6		1-04-13 5-03-13	65.64 41.33				
	2	T9 Common	10/12	11-07-00	7-11-09	2 x 4	1-03-08 1-05-00	3-01-10 3-01-10	113.85 72.67				
	1 2-ply	T10 Hip Girder	10/12	11-07-00	6-08-15	2 x 4 2 x 6	1-03-08 1-03-08	3-01-10 3-01-10	139.93 86.33				
	1	T11 Common	10/12	9-03-00	6-11-14	2 x 4	1-03-08 1-03-08	3-01-10 3-01-10	48.17 30.83				
	1 2-ply	T12 Half Hip Girder	10/12	4-04-00	4-10-07	2 x 4 2 x 6		3-01-10 4-10-07	61.68 42.67				
	1	T13 Hip Girder	10/12	9-03-00	3-06-15	2 x 4	1-03-08 1-03-08	1-07-10 1-07-10	42.77 28.33				
	1	T14 Half Hip Girder	12/12	10-11-00	2-09-03	2 x 4 2 x 6	1-03-08 10-08	1-00-11 2-01-07	50.35 31.50				

# DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER  
 Builder: GREENPARK HOMES  
 Project: BARLASSINA  
 Location: CAMBRIDGE  
 Model: GARDEN 2  
 Lot #:   
 Elevation: 1

Job Track: 52956  
 PlanLog: 206367  
 Layout ID: 427369  
 Ref #  
 Page: 2 of 2  
 Date: 08-03-2022  
 Designer: )  
 Sales Rep: Rick DiCiano

## Roof Trusses

PROFILE	QTY	MARK	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG		HEEL HEIGHT		LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	PLY	TYPE					LEFT RIGHT	LEFT RIGHT					
	7	J1 Jack-Open	6 /12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	117.56 74.67				
	2	J2 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67				
	2	J3 Jack-Open	6 /12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33				
	2	J4 Jack-Open	6 /12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33				
	2	J5 Jack-Open	6 /12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00				
	6	J6 Jack-Open	8 /12	5-10-08	5-03-13	2 x 4	1-03-08	1-04-13 5-03-13	106.98 64.00				
	2	J7 Jack-Open	10 /12	2-01-00	4-10-07	2 x 4	1-03-08	3-01-10 4-10-07	26.45 18.67				
	5	J8 Jack-Open	10 /12	2-04-00	3-06-15	2 x 4	1-03-08	1-07-10 3-06-15	48.48 33.33				
	6	J9 Jack-Open	6 /12	3-06-08	2-08-15	2 x 4	1-03-08	4-03 2-01-07	62.2 40.00				
	6	J10 Jack-Open	5 /12	6-05-08	3-06-09	2 x 4	1-03-08	4-01 3-00-06	102.46 64.00				
	2	J11 Jack-Open	5 /12	6-05-08	3-07-03	2 x 4	1-05-00	4-01 3-00-06	34.46 21.33				

TOTAL # TRUSS= 75

TOTAL BFT OF ALL TRUSSES= 2083.82

BFT.


TOTAL WEIGHT OF ALL TRSSES 3302.79 LBS

## HARDWARE

QTY	TYPE	MODEL	LENGTH
2	Hardware	LJS26DS	
1	Hardware	LUS24	
2	Hardware	HGUS26	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 6

# DELIVERY SHIPLIST

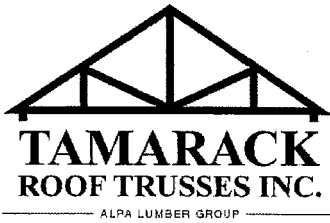

Lumber Yard: TAMARACK LUMBER  
 Builder: GREENPARK HOMES  
 Project: BARLASSINA  
 Location: CAMBRIDGE  
 Model: GARDEN 2  
 Lot #:   
 Elevation: 2

Job Track: 52956  
 PlanLog: 206367  
 Layout ID: 427429  
 Ref #  
 Page: 1 of 3  
 Date: 08-03-2022  
 Designer:  
 Sales Rep: Rick DiCiano

## Roof Trusses

PROFILE	QTY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG		HEEL HEIGHT		LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
	PLY						LEFT RIGHT	LEFT RIGHT					
	1 2-ply	T1 Hip Girder	6 /12	22-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	203.69 128.00				
	1	T2 Hip	6 /12	22-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	94.14 59.33				
	1	T3 Hip	6 /12	22-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	96.52 60.17				
	7	T4 Common	6 /12	22-11-00	6-10-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	640.26 403.67				
	4	T4A Common	6 /12	22-07-00	6-10-12	2 x 4		1-03-00 1-03-00	349.62 220.00				
	1	T20Z Roof Special	0 /12	22-07-00	6-03-13	2 x 4		6-03-13 6-03-15	104.11 63.67				
	2	T21 Flat	0 /12	22-07-00	7-11-13	2 x 4		7-11-13 7-11-15	232.38 146.67				
	2	T22 Flat	0 /12	22-07-00	9-07-13	2 x 4		9-07-13 9-07-15	284.66 176.67				
	1 2-ply	T23 Flat Girder	0 /12	22-07-00	6-03-15	2 x 6		6-03-15 6-03-15	262.56 158.00				
	1 2-ply	T24 Monopitch Girder	10 /12	5-07-08	6-03-15	2 x 4 2 x 6		1-07-11 6-03-15	70.17 46.67				
	1	T25 Hip	8 /12	20-05-00	7-09-03	2 x 4		1-06-02 2-10-02	92.38 59.17				
	1 2-ply	T26 Hip Girder	8 /12	20-05-00	6-01-03	2 x 4 2 x 6	1-03-08 1-03-08	1-06-02 2-10-02	211.07 132.67				
	1 2-ply	T27 Flat Girder	0 /12	3-07-08	1-06-00	2 x 4 2 x 6		1-06-00 1-06-00	31.12 21.00				
	1	T28 Roof Special Girder	-8 /12	9-00-00	3-06-05	2 x 4 2 x 6	1-03-08	3-06-05 1-04-02	42.71 27.17				

# DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER  
 Builder: GREENPARK HOMES  
 Project: BARLASSINA  
 Location: CAMBRIDGE  
 Model: GARDEN 2  
 Lot #:   
 Elevation: 2

Job Track: 52956  
 PlanLog: 206367  
 Layout ID: 427429  
 Ref #  
 Page: 2 of 3  
 Date: 08-03-2022  
 Designer: )  
 Sales Rep: Rick DiCiano

## Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG		HEEL HEIGHT		LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
							LEFT RIGHT	LEFT RIGHT	LEFT RIGHT	LEFT RIGHT			
	2	T29 Common	8/12	11-07-00	5-11-13	2 x 4	1-03-08	1-04-13 2-10-02	101.51 65.00				
	1	T30 Hip Girder	8/12	9-03-00	3-06-05	2 x 4 2 x 6	1-05-00 1-03-08	1-04-13 1-04-02	46.93 29.83				
	1	T31 Half Hip Girder	12/12	10-11-00	2-02-11	2 x 4	1-03-08 10-08	1-00-11 1-06-15	41.98 27.33				
	1	T32 Hip Girder	6/12	9-03-00	2-10-15	2 x 4	1-03-08 1-03-08	4-03 4-05	30.19 19.50				
	1	T33 Common	6/12	9-03-00	3-03-07	2 x 4	1-03-08 1-03-08	4-05 4-05	27.64 17.50				
	2	G1 GABLE	10/12	21-02-06	10-05-11	2 x 4	1-03-08 1-03-08	1-07-11 1-07-11	224.31 143.33				
	7	J1 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08	1-02-00 4-01-04	117.56 74.67				
	2	J2 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01	1-02-00 2-00-12	23.16 14.67				
	2	J3 Jack-Open	6/12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01	1-02-00 3-00-12	28.26 17.33				
	2	J4 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 1-01	1-02-00 2-00-12	14.04 9.33				
	2	J5 Jack-Open	6/12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15	1-02-00 2-01-04	19.14 12.00				
	1	J21 Jack-Open	10/12	5-07-08	6-03-15	2 x 4	1-05-00	1-07-11 6-03-15	18.53 12.00				
	4	J22 Jack-Open	10/12	2-04-00	3-06-05	2 x 4	1-03-08	1-06-15 3-06-05	38.53 26.67				
	5	J23 Jack-Open	10/12	2-04-00	3-06-05	2 x 4	1-03-08	1-06-15 3-06-05	48.16 33.33				

# DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER  
 Builder: GREENPARK HOMES  
 Project: BARLASSINA  
 Location: CAMBRIDGE  
 Model: GARDEN 2  
 Lot #:   
 Elevation: 2

Job Track: 52956  
 PlanLog: 206367  
 Layout ID: 427429  
 Ref #  
 Page: 3 of 3  
 Date: 08-03-2022  
 Designer:  
 Sales Rep: Rick DiCiano

## Roof Trusses

PROFILE	QTY PLY	MARK TYPE	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG		HEEL HEIGHT		LBS. BFT.	BUNDLE # STACK #	LOAD BY REMARKS
							LEFT RIGHT	LEFT RIGHT	LEFT RIGHT	LEFT RIGHT			
	2	J24 Jack-Open	6 /12	6-05-08	4-03-03	2 x 4	1-05-00	4-03 3-06-15	35.14 21.33				
	2	J25 Jack-Open	6 /12	3-10-08	2-10-15	2 x 4	1-03-08	4-03 2-03-07	22.34 13.33				
	2	J26 Jack-Open	6 /12	1-09-07	1-10-06	2 x 4	1-03-08 2-01-01	4-03 1-02-15	17.02 10.67				
	2	J27 Jack-Open	6 /12	1-09-07	1-10-06	2 x 4	1-03-08 1-01	4-05 1-03-01	12.46 8.00				
	6	J28 Jack-Open	6 /12	2-05-08	2-02-07	2 x 4	1-03-08	4-03 1-06-15	46.5 32.00				


TOTAL # TRUSS= 77      TOTAL BFT OF ALL TRUSSES= 2290.68      BFT.      TOTAL WEIGHT OF ALL TRSSES 3628.81      LBS

## HARDWARE

QTY	TYPE	MODEL	LENGTH
1	Hardware	LUS24	
1	Hardware	LJS26DS	
2	Hardware	HGUS26-2	
1	Hardware	LUS26-2	

TOTAL NUMBER OF ITEMS= 5

# DELIVERY SHIPLIST

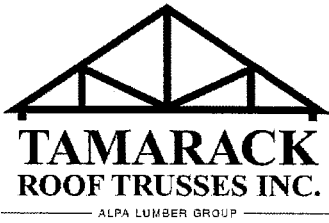

Lumber Yard: TAMARACK LUMBER  
 Builder: GREENPARK HOMES  
 Project: BARLASSINA  
 Location: CAMBRIDGE  
 Model: GARDEN 2  
 Lot #:   
 Elevation: 3

Job Track: 52956  
 PlanLog: 206367  
 Layout ID: 427451  
 Ref #  
 Page: 1 of 2  
 Date: 08-03-2022  
 Designer:  
 Sales Rep: Rick DiCiano

## Roof Trusses

PROFILE	QTY	MARK	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG		HEEL HEIGHT		LBS.	BUNDLE #	LOAD BY
	PLY	TYPE					LEFT	RIGHT	LEFT	RIGHT	BFT.	STACK #	
	1 2-ply	T1 Hip Girder	6 /12	22-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	203.69 128.00				
	1 2-ply	T1Z Hip Girder	6 /12	22-11-00	4-01-04	2 x 4 2 x 6	1-03-08 1-03-08	1-02-00 1-02-00	203.69 128.00				
	2	T2 Hip	6 /12	22-11-00	5-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	188.29 118.67				
	2	T3 Hip	6 /12	22-11-00	6-01-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	193.05 120.33				
	14	T4 Common	6 /12	22-11-00	6-10-12	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	1280.52 807.33				
	1 2-ply	T34 Jack-Open Girder	6 /12	5-10-08	4-01-04	2 x 4 2 x 6		1-02-00 4-01-04	60.42 38.67				
	1	T35 Hip Girder	6 /12	17-02-00	4-08-04	2 x 4 2 x 6	1-03-08 1-03-08	2-02-00 2-00-08	86.77 54.83				
	1	T36 Roof Special	-6 /12	5-03-08	2-08-12	2 x 4	1-00-08	2-08-12 1-00-08	28.71 21.17				
	1	T37 Roof Special	-6 /12	5-03-08	3-02-00	2 x 4	1-00-08	3-02-00 1-00-08	27.88 19.67				
	1	T38 Roof Special	-6 /12	5-03-08	4-02-00	2 x 4	1-03-08	4-02-00 1-00-08	34.58 24.33				
	2	T39 Common	6 /12	11-07-00	5-00-12	2 x 4	1-03-08 1-03-08	2-02-00 2-02-00	96.6 62.33				
	1	T40 Hip	6 /12	11-07-00	4-04-00	2 x 4	1-03-08	2-02-00 1-02-00	51.75 34.17				
	1	T41 Hip Girder	6 /12	11-07-00	2-03-04	2 x 4	1-03-08 1-03-08	1-02-00 1-02-00	45.66 31.33				
	1 2-ply	T42 Monopitch Girder	6 /12	5-03-08	4-08-04	2 x 4 2 x 6		1-00-08 4-08-04	64.54 43.67				

# DELIVERY SHIPLIST



Lumber Yard: TAMARACK LUMBER  
 Builder: GREENPARK HOMES  
 Project: BARLASSINA  
 Location: CAMBRIDGE  
 Model: GARDEN 2  
 Lot #:   
 Elevation: 3

Job Track: 52956  
 PlanLog: 206367  
 Layout ID: 427451  
 Ref #  
 Page: 2 of 2  
 Date: 08-03-2022  
 Designer:  
 Sales Rep: Rick DiCiano

## Roof Trusses

PROFILE	QTY	MARK	PITCH	SPAN	HEIGHT	LUMBER	OVERHANG		HEEL HEIGHT		LBS.	BUNDLE #	LOAD BY
	PLY	TYPE					LEFT	RIGHT	LEFT	RIGHT	BFT.	STACK #	REMARKS
	7	J1 Jack-Open	6/12	5-10-08	4-01-04	2 x 4	1-03-08		1-02-00 4-01-04		117.56 74.67		
	3	J2 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 4-01-01		1-02-00 2-00-12		34.75 22.00		
	3	J3 Jack-Open	6/12	3-09-07	3-00-12	2 x 4	1-03-08 2-01-01		1-02-00 3-00-12		42.4 26.00		
	3	J4 Jack-Open	6/12	1-09-07	2-00-12	2 x 4	1-03-08 1-01		1-02-00 2-00-12		21.06 14.00		
	3	J5 Jack-Open	6/12	1-10-08	3-00-12	2 x 4	1-03-08 1-10-15		1-02-00 2-01-04		28.71 18.00		
	6	J31 Jack-Open	6/12	2-04-00	2-04-00	2 x 4	1-03-08		1-02-00 2-04-00		49.44 36.00		
	3	J32 Jack-Open	5/12	3-03-08	2-09-14	2 x 6 2 x 4	2-03-08		9-01 2-01-08		49.25 31.00		
	3	J33 Jack-Open	5/12	4-08-08	3-04-15	2 x 6 2 x 4	2-03-08		9-01 2-08-10		62.25 38.00		

TOTAL # TRUSS= 65

TOTAL BFT OF ALL TRUSSES= 1892.17

BFT.

TOTAL WEIGHT OF ALL TRSSES 2971.56 LBS

## HARDWARE


QTY	TYPE	MODEL	LENGTH
2	Hardware	HGUS26-2	
1	Hardware	LJS26DS	
6	Hardware	LUS24	

TOTAL NUMBER OF ITEMS= 9



JOB NAME 427369	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:27:22 2022 Page 1

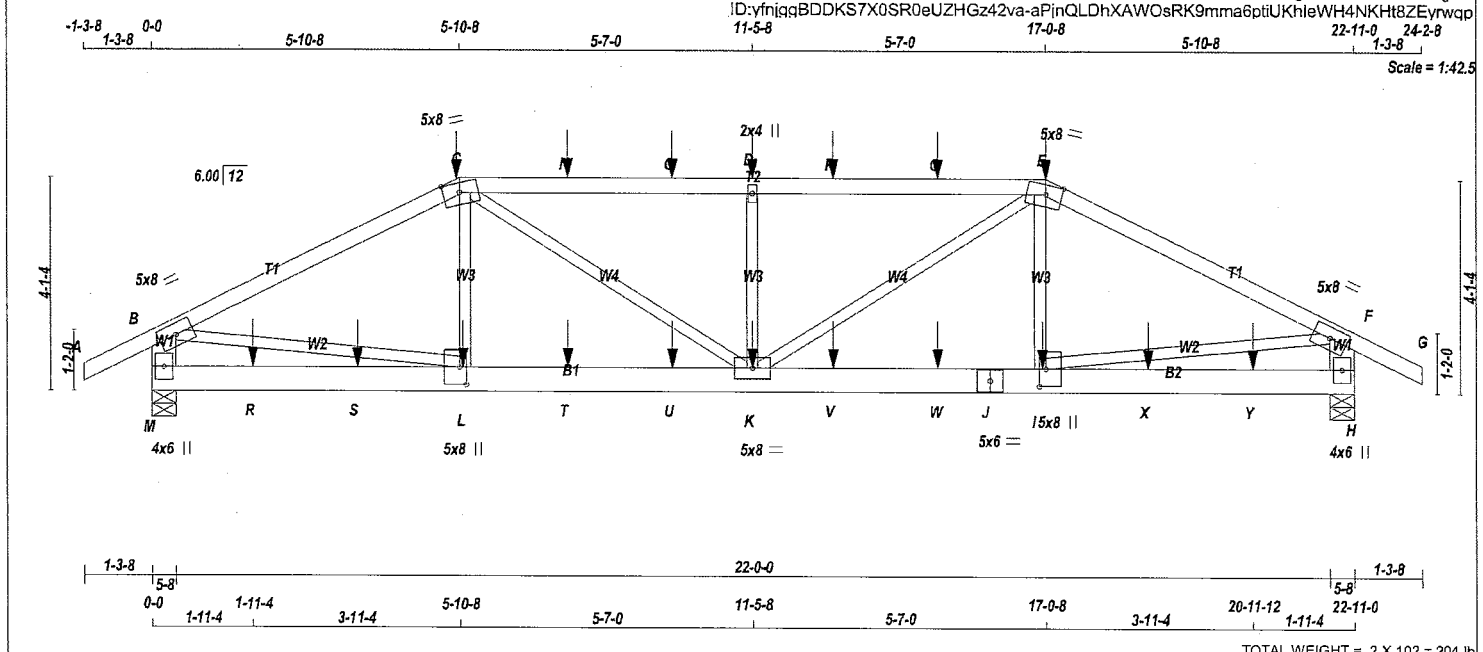

TOTAL WEIGHT = 2 X 102 = 204 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
M - B	2x6	DRY No.2	SPF
H - F	2x6	DRY No.2	SPF
M - J	2x6	DRY No.2	SPF
J - H	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF  
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	SIDE(61.0)
C-E 1	12	SIDE(61.0)
E-G 1	12	SIDE(61.0)
M-B 2	12	TOP
H-F 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
M-J 2	12	SIDE(183.1)
J-H 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
L-C 1	6	SIDE(17.4)
I-E 1	6	SIDE(17.4)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
M	2396	0	2396	0	5-8	5-8
H	2396	0	2396	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
M	1689	1140/0	0/0	0/0	0/0	549/0
H	1689	1140/0	0/0	0/0	0/0	549/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.17 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	C H O R D S		W E B S	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRACED LENGTH
FR-TO				
A-B	0/29	-95.2 -95.2 0.07 (1)	10.00	L-C -187/106 0.02 (1)
B-C	-3393/0	-95.2 -95.2 0.42 (1)	4.64	K-D 0/1110 0.14 (1)
C-N	-3951/0	-95.2 -95.2 0.53 (1)	4.17	K-E -1080/0 0.14 (1)
N-O	-3951/0	-95.2 -95.2 0.53 (1)	4.17	K-F 0/1110 0.14 (1)
O-D	-3951/0	-95.2 -95.2 0.53 (1)	4.17	I-E -187/106 0.02 (1)
D-P	-3951/0	-95.2 -95.2 0.53 (1)	4.17	B-L 0/3058 0.38 (1)
P-Q	-3951/0	-95.2 -95.2 0.53 (1)	4.17	I-F 0/3058 0.38 (1)
Q-E	-3951/0	-95.2 -95.2 0.53 (1)	4.17	
E-F	-3393/0	-95.2 -95.2 0.42 (1)	4.64	
F-G	0/29	-95.2 -95.2 0.07 (1)	10.00	
M-B	-2322/0	0.0 0.0 0.08 (1)	7.81	
H-F	-2322/0	0.0 0.0 0.08 (1)	7.81	

M-R	0/0	-18.5 -18.5 0.06 (4)	10.00
R-S	0/0	-18.5 -18.5 0.06 (4)	10.00
S-L	0/0	-18.5 -18.5 0.06 (4)	10.00
L-T	0/3027	-18.5 -18.5 0.24 (1)	10.00
T-U	0/3027	-18.5 -18.5 0.24 (1)	10.00
U-K	0/3027	-18.5 -18.5 0.24 (1)	10.00
K-V	0/3027	-18.5 -18.5 0.24 (1)	10.00
V-W	0/3027	-18.5 -18.5 0.24 (1)	10.00
W-J	0/3027	-18.5 -18.5 0.24 (1)	10.00
J-I	0/3027	-18.5 -18.5 0.24 (1)	10.00
I-X	0/0	-18.5 -18.5 0.06 (4)	10.00
X-Y	0/0	-18.5 -18.5 0.06 (4)	10.00
Y-H	0/0	-18.5 -18.5 0.06 (4)	10.00

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	5-10-8	-368	-368		FRONT	VERT	TOTAL		C1
D	11-5-8	-79	-79		FRONT	VERT	TOTAL		C1
E	17-0-8	-368	-368		FRONT	VERT	TOTAL		C1
I	16-11-12	-21	-21		FRONT	VERT	TOTAL		C1
K	11-5-8	-21	-21		FRONT	VERT	TOTAL		C1
L	5-11-4	-21	-21		FRONT	VERT	TOTAL		C1
N	7-11-4	-79	-79		FRONT	VERT	TOTAL		C1
O	9-11-4	-79	-79		FRONT	VERT	TOTAL		C1
P	12-11-12	-79	-79		FRONT	VERT	TOTAL		C1
Q	14-11-12	-79	-79		FRONT	VERT	TOTAL		C1

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")  
ALLOWABLE DEFL.(TL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.53/1.00 (C-D-1), BC=0.24/1.00 (I-K-1),  
WB=0.38/1.00 (F-I-1), SSI=0.21/1.00 (C-D-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.58 (I) (INPUT = 0.90 )  
JSI METAL= 0.55 (L) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080051 PG 1/2

JOB NAME 427369	TRUSS NAME T1	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:27:23 2022 Page 2  
ID:yfnjggBDDKS7X0SR0eUZHGz42va-2cH9ehDKIUeFUavlKLU6LM5F45etFKKWZxdh5hyrwqo

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-t	MT20	5.0	8.0		
C	TTWW-m	MT20	5.0	8.0	2.25	3.75
D	TMWW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	2.25	3.75
F	TMWW-t	MT20	5.0	8.0		
H	BMV1+p	MT20	4.0	6.0		
I	BMWW+t	MT20	5.0	8.0	4.00	1.50
J	BS-t	MT20	5.0	6.0		
K	BMWWW-t	MT20	5.0	8.0		
L	BMWW+t	MT20	5.0	8.0	4.00	1.50
M	BMV1+p	MT20	4.0	6.0		

**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.


**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
R	1-11-4	-20	-20	--	FRONT	VERT	TOTAL	--	C1
S	3-11-4	-21	-21	--	FRONT	VERT	TOTAL	--	C1
T	7-11-4	-21	-21	--	FRONT	VERT	TOTAL	--	C1
U	9-11-4	-21	-21	--	FRONT	VERT	TOTAL	--	C1
V	12-11-12	-21	-21	--	FRONT	VERT	TOTAL	--	C1
W	14-11-12	-21	-21	--	FRONT	VERT	TOTAL	--	C1
X	18-11-12	-21	-21	--	FRONT	VERT	TOTAL	--	C1
Y	20-11-12	-20	-20	--	FRONT	VERT	TOTAL	--	C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.



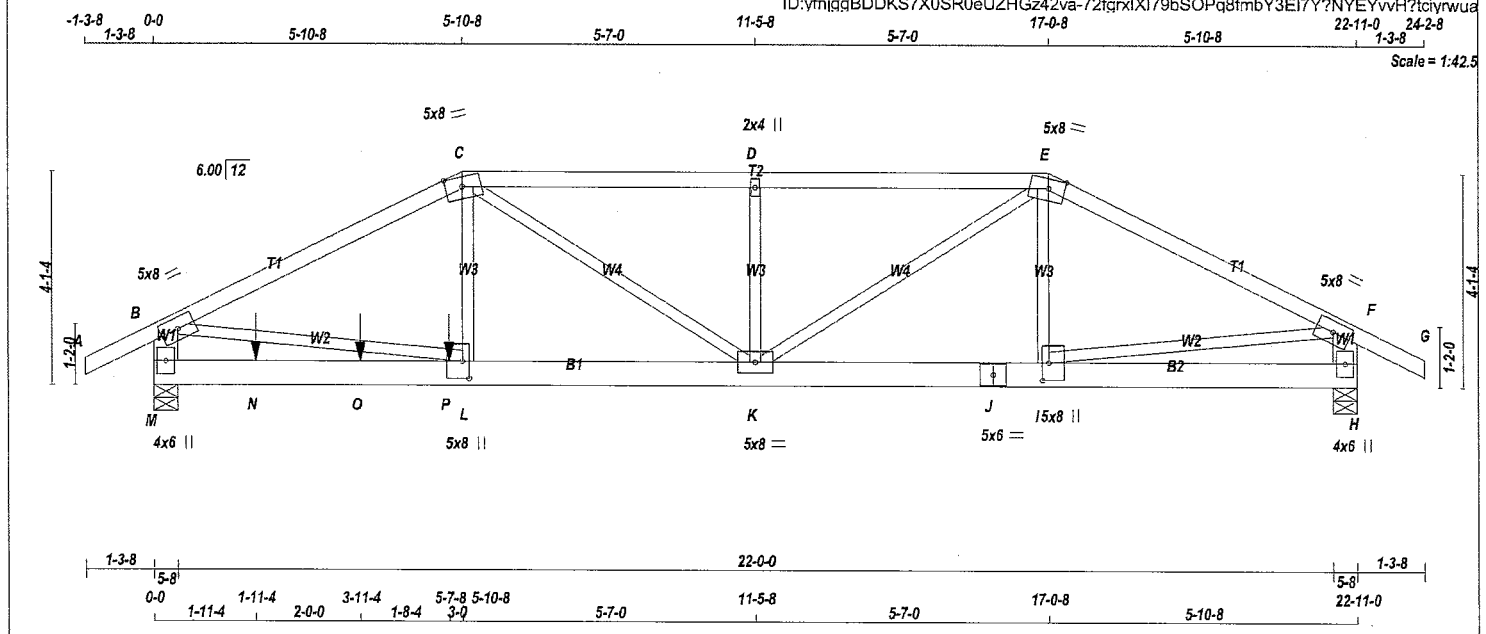

TOTAL WEIGHT = 2 X 102 = 204 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
M - B	2x6	DRY No.2	SPF
H - F	2x6	DRY No.2	SPF
M - J	2x6	DRY No.2	SPF
J - H	2x6	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	12	TOP
C-E	12	TOP
E-G	12	TOP
M-B	2	TOP
H-F	2	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
M-J	2	SIDE(0.0)
J-H	2	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1	6

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
M	3427	0	3427	0	5-8	5-8
H	2073	0	2073	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	2408	1664 / 0	0 / 0	0 / 0	0 / 0	744 / 0	0 / 0
H	1458	1004 / 0	0 / 0	0 / 0	0 / 0	453 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.86 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1	MAX. CSI (LC)	MEMB. UNBRAC LENGTH	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 29	-95.2 -95.2	0.07 (1)	10.00	L-C	0 / 2128	0.26 (1)	
B-C	-5040 / 0	-95.2 -95.2	0.53 (1)	3.86	C-K	-647 / 0	0.26 (1)	
C-D	-4026 / 0	-95.2 -95.2	0.36 (1)	4.39	K-D	-641 / 0	0.08 (1)	
D-E	-4026 / 0	-95.2 -95.2	0.36 (1)	4.39	K-E	0 / 1765	0.22 (1)	
E-F	-2867 / 0	-95.2 -95.2	0.39 (1)	4.99	I-E	-185 / 39	0.02 (1)	
F-G	0 / 29	-95.2 -95.2	0.07 (1)	10.00	B-L	0 / 4543	0.56 (1)	
M-B	-3251 / 0	0.0	0.0	11 (1)	I-F	0 / 2584	0.32 (1)	
H-F	-2026 / 0	0.0	0.0	0.07 (1)				
M-N	0 / 0	-18.5	-18.5	0.20 (1)	10.00			
N-O	0 / 0	-18.5	-18.5	0.20 (1)	10.00			
O-P	0 / 0	-18.5	-18.5	0.20 (1)	10.00			
P-L	0 / 0	-18.5	-18.5	0.20 (1)	10.00			
L-K	0 / 4565	-18.5	-18.5	0.43 (1)	10.00			
K-J	0 / 2557	-18.5	-18.5	0.22 (1)	10.00			
J-I	0 / 2557	-18.5	-18.5	0.22 (1)	10.00			
I-H	0 / 0	-18.5	-18.5	0.04 (4)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX.	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
N	1-11-4	-20	-20	--	BACK	VERT	TOTAL	--	C1
O	3-11-4	-21	-21	--	BACK	VERT	TOTAL	--	C1
P	5-7-8	-1807	-1807	--	BACK	VERT	TOTAL	--	C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018 , ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")  
ALLOWABLE DEFL.(TL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.53/1.00 (B-C:1) , BC=0.43/1.00 (K-L:1) , WB=0.56/1.00 (B-L:1) , SSI=0.85/1.00 (L-M:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.87 (C) (INPUT = 0.90)  
JSI METAL= 0.82 (L) (INPUT = 1.00)



JOB NAME 427451	TRUSS NAME T1Z	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:23:21 2022 Page 2  
ID:yfnjggBDDKS7X0SR0eUZHGz42va-72fgrxIXI79bSOPq8fmbY3E17Y?NYEYvvh?tcjyrwua

**PLATES (table is in inches)**


JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0		
C	TTWW-m	MT20	5.0	8.0	2.25	3.75
D	TMW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	8.0	2.25	3.75
F	TMVW-t	MT20	5.0	8.0		
H	BMV1+p	MT20	4.0	6.0		
I	BMWW+t	MT20	5.0	8.0	4.00	1.50
J	BS-t	MT20	5.0	6.0		
K	BMWWW+t	MT20	5.0	8.0		
L	BMWW+t	MT20	5.0	8.0	4.00	1.50
M	BMV1+p	MT20	4.0	6.0		

**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.



STRUCTURAL COMPONENT ONLY  
DWG # TR22080098 PG 2/2

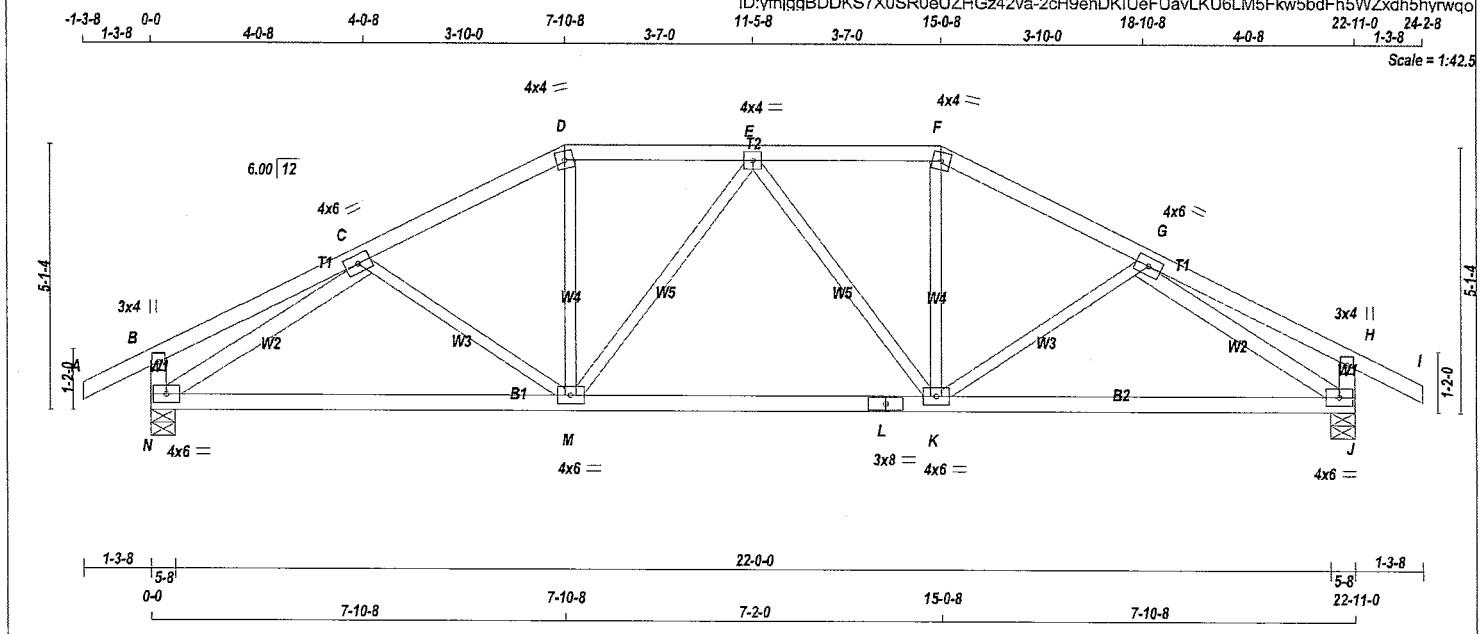

TOTAL WEIGHT = 94 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
N - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
N - L	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
ALL WEBS	2x3	DRY No.2	SPF
EXCEPT			
N - C	2x4	DRY No.2	SPF
G - J	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTW-m	MT20	4.0	4.0		
E	TMWW-t	MT20	4.0	4.0		
F	TTW-m	MT20	4.0	4.0		
G	TMWW-t	MT20	4.0	6.0		
H	TMV+p	MT20	3.0	4.0		
J	BMVW1-t	MT20	4.0	6.0		
K	BMVWW-t	MT20	4.0	6.0		
L	BS-t	MT20	3.0	8.0		
M	BMVWW-t	MT20	4.0	6.0		
N	BMVW1-t	MT20	4.0	6.0		

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
N	1432	0	1432	0	5-8	5-8
J	1432	0	1432	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
N	1009	685 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0
J	1009	685 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N, J

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.03 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MAX. FACTORED FORCE (LBS)
FR-TO				
A-B	0 / 29	-95.2 -95.2	0.12 (1)	10.00
B-C	0 / 18	-95.2 -95.2	0.22 (1)	10.00
C-D	-1806 / 0	-95.2 -95.2	0.20 (1)	5.03
D-E	-1428 / 0	-95.2 -95.2	0.17 (1)	5.30
E-F	-1428 / 0	-95.2 -95.2	0.17 (1)	5.30
F-G	-1806 / 0	-95.2 -95.2	0.20 (1)	5.03
G-H	0 / 18	-95.2 -95.2	0.22 (1)	10.00
H-I	0 / 29	-95.2 -95.2	0.12 (1)	10.00
N-B	-277 / 0	0.0	0.03 (1)	7.81
J-H	-277 / 0	0.0	0.03 (1)	7.81
N-M	0 / 1525	-18.5	-18.5	0.39 (1)
M-L	0 / 1576	-18.5	-18.5	0.38 (1)
L-K	0 / 1576	-18.5	-18.5	0.38 (1)
K-J	0 / 1525	-18.5	-18.5	0.39 (1)

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. G/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")  
ALLOWABLE DEFL.(TL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.16")

CSI: TC=0.22/1.00 (G-H:1), BC=0.39/1.00 (J-K:1)  
WB=0.52/1.00 (G-J:1), SSI=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (N) (INPUT = 0.90)  
JSI METAL= 0.56 (L) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080052

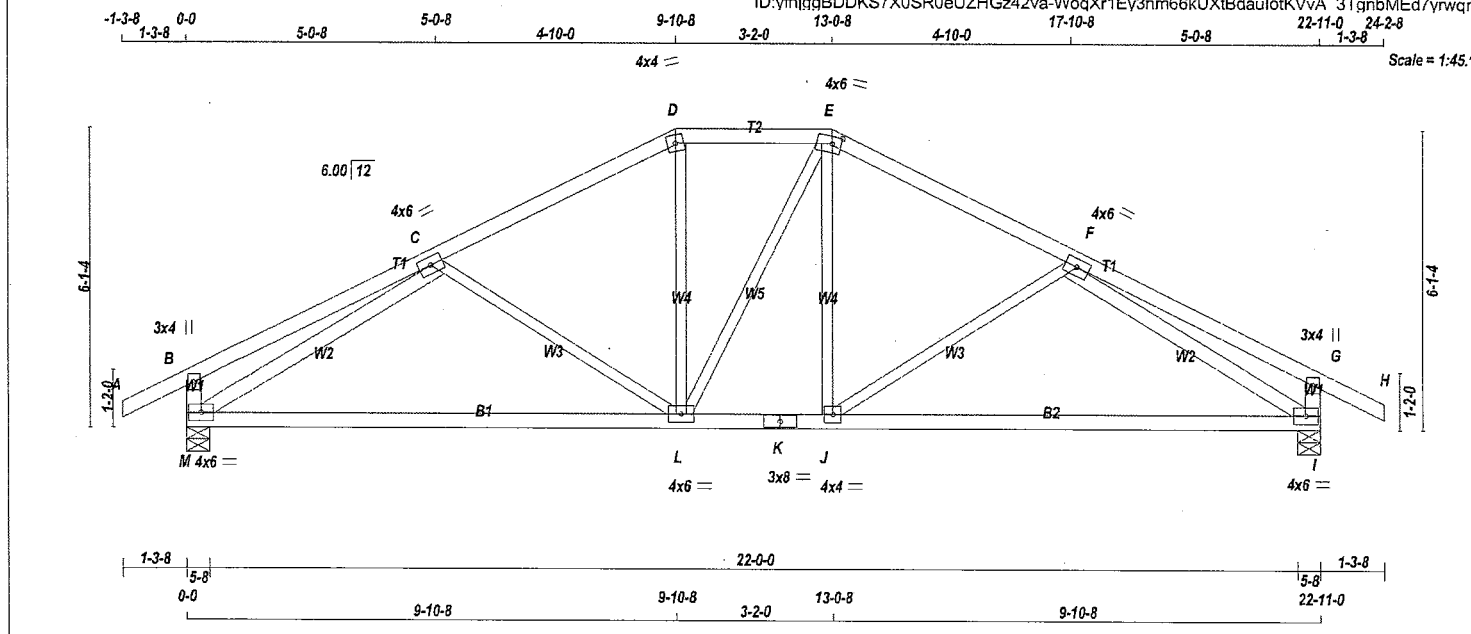

TOTAL WEIGHT = 97 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - E	2x4	DRY No.2	SPF
E - H	2x4	DRY No.2	SPF
M - B	2x4	DRY No.2	SPF
I - G	2x4	DRY No.2	SPF
M - K	2x4	DRY No.2	SPF
K - I	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
M - C	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTW-m	MT20	4.0	4.0		
E	TTWW-m	MT20	4.0	6.0	1.75	2.25
F	TMWW-t	MT20	4.0	6.0		
G	TMV+p	MT20	3.0	4.0		
I	BMVW1-t	MT20	4.0	6.0		
J	BMVW-t	MT20	4.0	4.0		
K	BS-t	MT20	3.0	8.0		
L	BMVWW-t	MT20	4.0	6.0		
M	BMVW1-t	MT20	4.0	6.0		

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
M	1432	0	1432	0	5-8	5-8
I	1432	0	1432	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
M	1009	685 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0
I	1009	685 / 0	0 / 0	0 / 0	0 / 0	323 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, I

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.08 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX LC1 (LC)	MAX (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX UNBRAC LENGTH	FR-TO
FR-TO								
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00	C-L	-323 / 0	0.21 (1)
B-C	0 / 24	-95.2	-95.2	0.37 (1)	10.00	L-D	0 / 314	0.07 (1)
C-D	-1460 / 0	-95.2	-95.2	0.31 (1)	5.08	L-E	0 / 1	0.00 (1)
D-E	-1289 / 0	-95.2	-95.2	0.14 (1)	5.55	J-E	0 / 313	0.07 (1)
E-F	-1460 / 0	-95.2	-95.2	0.31 (1)	5.08	J-F	-323 / 0	0.21 (1)
F-G	0 / 24	-95.2	-95.2	0.37 (1)	10.00	M-C	-1870 / 0	0.83 (1)
G-H	0 / 29	-95.2	-95.2	0.12 (1)	10.00	F-I	-1870 / 0	0.83 (1)
M-B	-311 / 0	0.0	0.0	0.03 (1)	7.81			
I-G	-311 / 0	0.0	0.0	0.03 (1)	7.81			
M-L	0 / 1552	-18.5	-18.5	0.49 (4)	10.00			
L-K	0 / 1288	-18.5	-18.5	0.49 (4)	10.00			
K-J	0 / 1288	-18.5	-18.5	0.49 (4)	10.00			
J-I	0 / 1551	-18.5	-18.5	0.49 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. / C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.05")  
 ALLOWABLE DEFL.(TL)= L/360 (0.76")  
 CALCULATED VERT. DEFL.(TL) = L/861 (0.32")

CSI: TC=0.37/1.00 (F-G:1), BC=0.49/1.00 (L-M:4), WB=0.83/1.00 (C-M:1), SS=0.20/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 650 371	1747 788	1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (M) (INPUT = 0.90)  
 JSI METAL= 0.85 (K) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080053

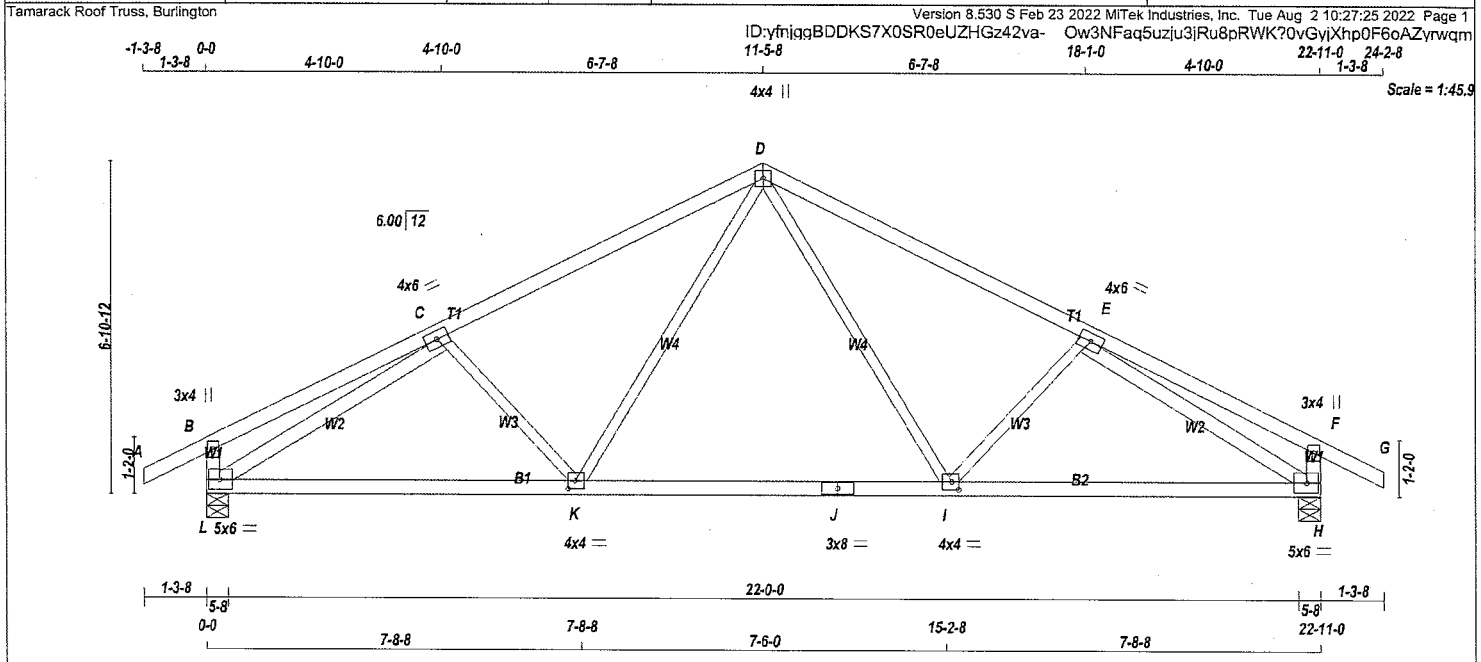

TOTAL WEIGHT = 12 X 91 = 1098 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - G	2x4	DRY No.2	SPF
L - B	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
<b>ALL WEBS EXCEPT</b>			
L - C	2x4	DRY No.2	SPF
E - H	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-t	MT20	4.0	6.0	
D	TTWW+p	MT20	4.0	4.0	
E	TMWW-t	MT20	4.0	6.0	
F	TMV+p	MT20	3.0	4.0	
H	BMVW1-t	MT20	5.0	6.0	
I	BMVW-t	MT20	4.0	4.0	2.00 1.75
J	BS-t	MT20	3.0	8.0	
K	BMVW-t	MT20	4.0	4.0	2.00 1.75
L	BMVW1-t	MT20	5.0	6.0	

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
L	1432	0	1432	0	5-8	5-8
H	1432	0	1432	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS					
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
L	1009	685/0	0/0	0/0	0/0	323/0
H	1009	685/0	0/0	0/0	0/0	323/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.58 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 29	-95.2 -95.2	0.12 (1)	10.00	D-I	0 / 496	
B-C	0 / 38	-95.2 -95.2	0.56 (1)	10.00	I-E	-368 / 0	
C-D	-1566 / 0	-95.2 -95.2	0.57 (1)	4.58	K-D	0 / 496	
D-E	-1566 / 0	-95.2 -95.2	0.57 (1)	4.58	C-K	-368 / 0	
E-F	0 / 38	-95.2 -95.2	0.56 (1)	10.00	L-C	-1964 / 0	
F-G	0 / 29	-95.2 -95.2	0.12 (1)	10.00	E-H	-1964 / 0	
L-B	-268 / 0	0.0	0.0	0.03 (1)	7.81		
H-F	-268 / 0	0.0	0.0	0.03 (1)	7.81		
L-K	0 / 1623	-18.5	-18.5	0.39 (1)	10.00		
K-J	0 / 1127	-18.5	-18.5	0.34 (4)	10.00		
J-I	0 / 1127	-18.5	-18.5	0.34 (4)	10.00		
I-H	0 / 1623	-18.5	-18.5	0.39 (1)	10.00		

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.76")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.06")  
 ALLOWABLE DEFL.(TL) = L/360 (0.76")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.57/1.00 (D-E:1), BC=0.39/1.00 (H-I:1), WB=0.77/1.00 (C-L:1), SS=0.27/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747 788 1987 1873



PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)  
 JSI METAL= 0.42 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080054

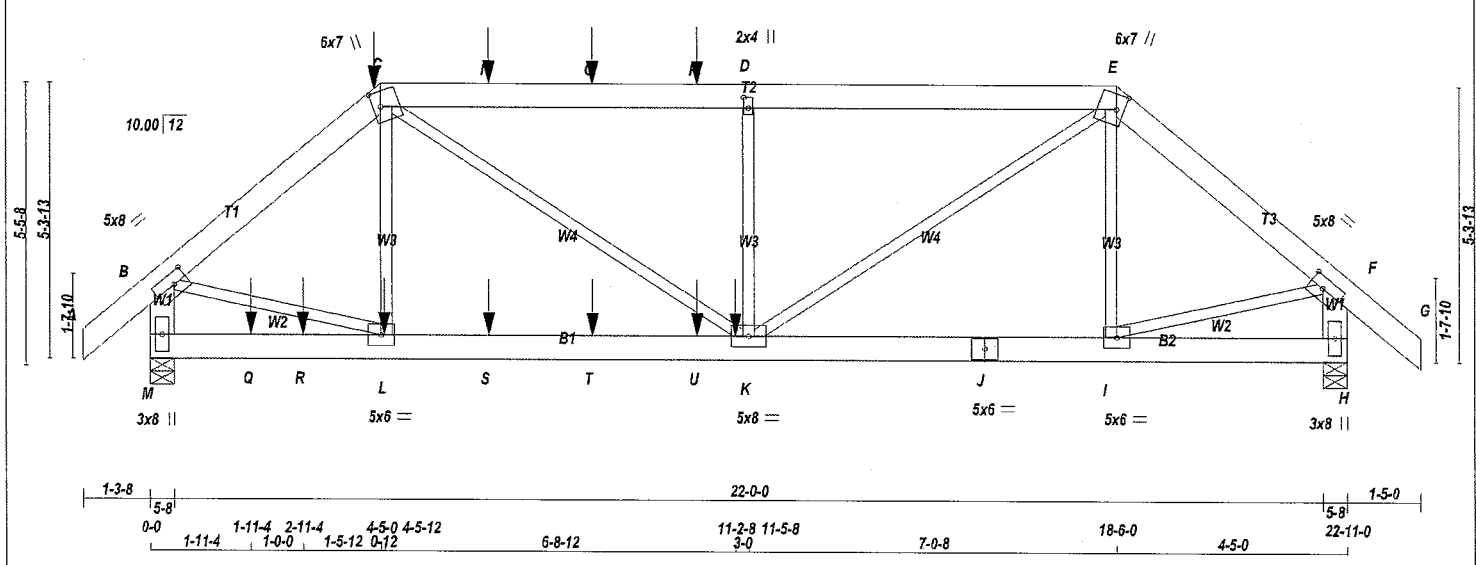

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x6 DRY	No.2	SPF
C - E	2x6 DRY	No.2	SPF
E - G	2x6 DRY	No.2	SPF
M - B	2x6 DRY	No.2	SPF
H - F	2x6 DRY	No.2	SPF
M - J	2x6 DRY	No.2	SPF
J - H	2x6 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF  
EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 2	12	SIDE(122.0)
C - E 2	12	SIDE(61.0)
E - G 2	12	TOP
M - B 2	12	TOP
H - F 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
M - J 2	12	SIDE(183.1)
J - H 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	SIDE(189.3)
D - K 1	6	SIDE(189.3)

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	DOWN	UP	IN-SX
M	2866	0	0	5-8
H	2423	0	0	5-8

**UNFACTORED REACTIONS**

	1ST LCASE	MAX /MIN. COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
M	2018	1374 / 0 0 / 0 0 / 0 0 / 0 645 / 0 0 / 0
H	1704	1173 / 0 0 / 0 0 / 0 0 / 0 532 / 0 0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M, H

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.41 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	WEBS MAX. FACTORED FORCE (LBS)
FR-TO				
A - B	0 / 44	-95.2 -95.2 0.04 (1)	10.00	L - C -303 / 79 0.06 (1)
B - C	-2990 / 0	-95.2 -95.2 0.10 (1)	6.24	C - K 0 / 2022 0.25 (1)
C - N	-3949 / 0	-95.2 -95.2 0.27 (1)	5.41	K - D -1010 / 0 0.19 (1)
N - O	-3949 / 0	-95.2 -95.2 0.27 (1)	5.41	K - E 0 / 2513 0.31 (1)
O - P	-3949 / 0	-95.2 -95.2 0.27 (1)	5.41	I - E -311 / 0 0.06 (1)
P - D	-3949 / 0	-95.2 -95.2 0.27 (1)	5.41	B - L 0 / 2356 0.29 (1)
D - E	-3949 / 0	-95.2 -95.2 0.27 (1)	5.41	I - F 0 / 1939 0.24 (1)
E - F	-2462 / 0	-95.2 -95.2 0.10 (1)	6.25	
F - G	0 / 48	-95.2 -95.2 0.05 (1)	10.00	
M - B	-2833 / 0	0.0 0.0 0.10 (1)	7.81	
H - F	-2405 / 0	0.0 0.0 0.09 (1)	7.81	
M - Q	0 / 0	-18.5 -18.5 0.08 (4)	10.00	
Q - R	0 / 0	-18.5 -18.5 0.08 (4)	10.00	
R - L	0 / 0	-18.5 -18.5 0.08 (4)	10.00	
L - S	0 / 2282	-18.5 -18.5 0.20 (1)	10.00	
S - T	0 / 2282	-18.5 -18.5 0.20 (1)	10.00	
T - U	0 / 2282	-18.5 -18.5 0.20 (1)	10.00	
U - K	0 / 2282	-18.5 -18.5 0.20 (1)	10.00	
K - J	0 / 1877	-18.5 -18.5 0.16 (1)	10.00	
J - I	0 / 1877	-18.5 -18.5 0.16 (1)	10.00	
I - H	0 / 0	-18.5 -18.5 0.04 (4)	10.00	

**DESIGN CRITERIA**

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

SPECIFIED LOADS:  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN. C/C

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018 , ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(LL)= L/999 (0.05")  
ALLOWABLE DEFL.(TL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(TL)= L/999 (0.09")

CSI: TC=0.27/1.00 (C-D:1), BC=0.20/1.00 (K-L:1),  
WB=0.31/1.00 (E-K:1), SS=0.21/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

NAIL VALUES  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.



STRUCTURAL COMPONENT ONLY  
DWG # TR22080061 PG 1/2



JOB NAME 427369	TRUSS NAME T5	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:26:54 2022 Page 2  
 ID:yfnjqgBDDKS7X0SR0eUZHGz42va-oRVF pJ\_xTQAcutEqVKnpSYxD3STT?M3q29EXyrxjV

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	5.0	8.0	2.50	3.25
C	TTWW+m	MT20	6.0	7.0	3.50	1.75
D	TMW+w	MT20	2.0	4.0	2.50	1.00
E	TTWW+m	MT20	6.0	7.0	3.50	1.75
F	TMVW-t	MT20	5.0	8.0	2.50	3.25
H	BMV1+p	MT20	3.0	8.0		
I	BMWW-t	MT20	5.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BMWWW-t	MT20	5.0	8.0		
L	BMWW-t	MT20	5.0	6.0		
M	BMV1+p	MT20	3.0	8.0		

**CONNECTION REQUIREMENTS**


1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

JSI GRIP= 0.88 (E) (INPUT = 0.90 )  
 JSI METAL= 0.29 (B) (INPUT = 1.00 )

**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.



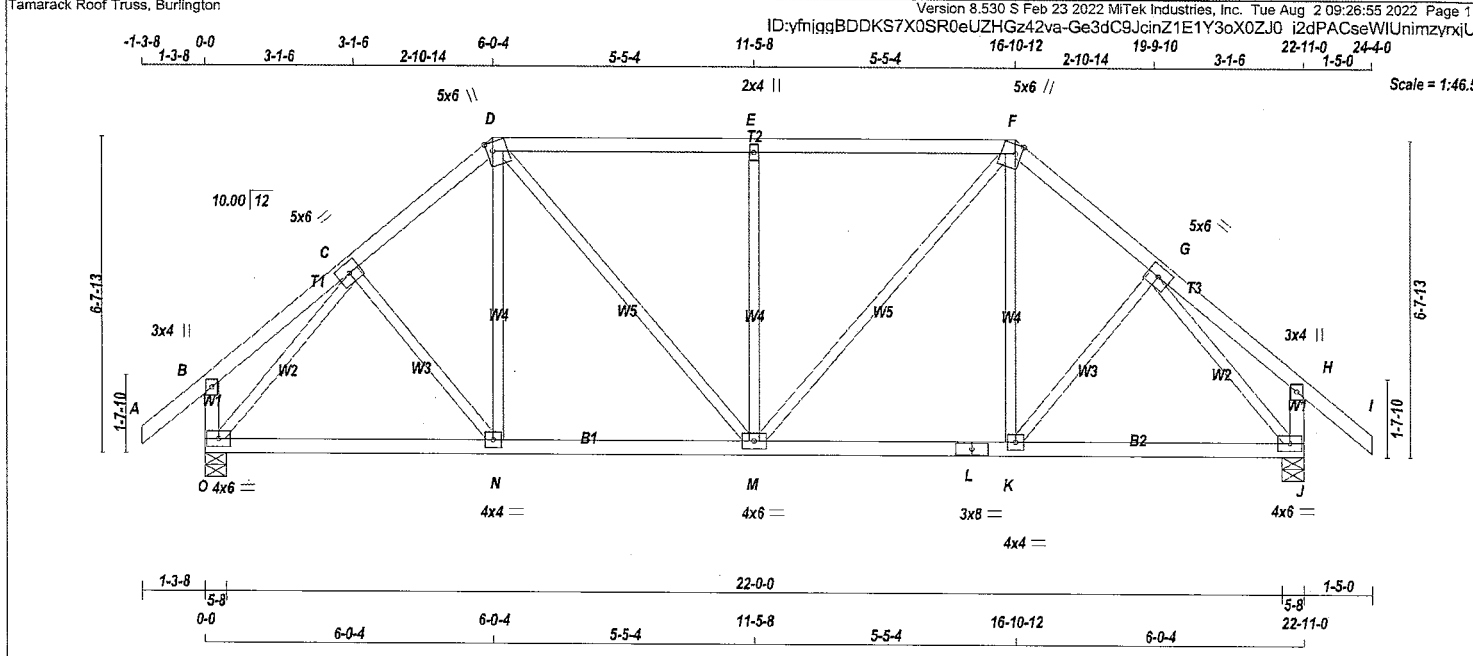

TOTAL WEIGHT = 2 X 106 = 212 lb [M][F]

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - I	2x4	DRY No.2	SPF
O - B	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
Q - L	2x4	DRY No.2	SPF
L - J	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TMWW-t	MT20	5.0	6.0	
D	TTWW+m	MT20	5.0	6.0	2.25 1.50
E	TMW+w	MT20	2.0	4.0	
F	TTWW+m	MT20	5.0	6.0	2.25 1.50
G	TMWW-t	MT20	5.0	6.0	
H	TMV+p	MT20	3.0	4.0	
J	BMVW1-t	MT20	4.0	6.0	
K	BMWW-t	MT20	4.0	4.0	
L	BS-t	MT20	3.0	8.0	
M	BMWWW-t	MT20	4.0	6.0	
N	BMWW-t	MT20	4.0	4.0	
O	BMVW1-t	MT20	4.0	6.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2x4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
O	1435	0	1435	0	5-8	5-8
J	1447	0	1447	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1010	587 / 0	0 / 0	0 / 0	0 / 0	324 / 0	0 / 0
J	1019	693 / 0	0 / 0	0 / 0	0 / 0	325 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.32 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 42	-95.2 -95.2	0.13 (1)	10.00	C-N	0 / 47	0.02 (4)
B-C	0 / 19	-95.2 -95.2	0.12 (1)	10.00	N-D	0 / 103	0.04 (4)
C-D	-1223 / 0	-95.2 -95.2	0.11 (1)	5.69	D-M	0 / 472	0.11 (1)
D-E	-1231 / 0	-95.2 -95.2	0.38 (1)	5.32	M-E	-632 / 0	0.46 (1)
E-F	-1231 / 0	-95.2 -95.2	0.38 (1)	5.32	M-F	0 / 472	0.11 (1)
F-G	-1223 / 0	-95.2 -95.2	0.11 (1)	5.69	K-F	0 / 103	0.04 (4)
G-H	0 / 19	-95.2 -95.2	0.12 (1)	10.00	K-G	0 / 47	0.02 (4)
H-I	0 / 46	-95.2 -95.2	0.16 (1)	10.00	O-C	-1458 / 0	0.54 (1)
O-B	-244 / 0	0.0 0.0	0.03 (1)	7.81	G-J	-1458 / 0	0.54 (1)
J-H	-256 / 0	0.0 0.0	0.03 (1)	7.81			
O-N	0 / 902	-18.5 -18.5	0.23 (1)	10.00			
N-M	0 / 924	-18.5 -18.5	0.24 (1)	10.00			
M-L	0 / 924	-18.5 -18.5	0.24 (1)	10.00			
L-K	0 / 924	-18.5 -18.5	0.24 (1)	10.00			
K-J	0 / 902	-18.5 -18.5	0.23 (1)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(LL) = L/ 999 (0.04")  
ALLOWABLE DEFL.(TL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(TL) = L/ 999 (0.07")

CSI: TC=0.38/1.00 (D-E:1), BC=0.24/1.00 (M-N:1)  
WB=0.54/1.00 (G-J:1), SSI=0.25/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.84 (J) (INPUT = 0.90)  
JSI METAL= 0.32 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080062

JOB NAME 427369	TRUSS NAME T7	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:26:56 2022 Page 1  
ID:yfnjggBDDKS7X0SR0eUZHGz42va-kqc?PVKET4hurB7GLFXosEXvF1k8x15fX8XGIPyrxJT

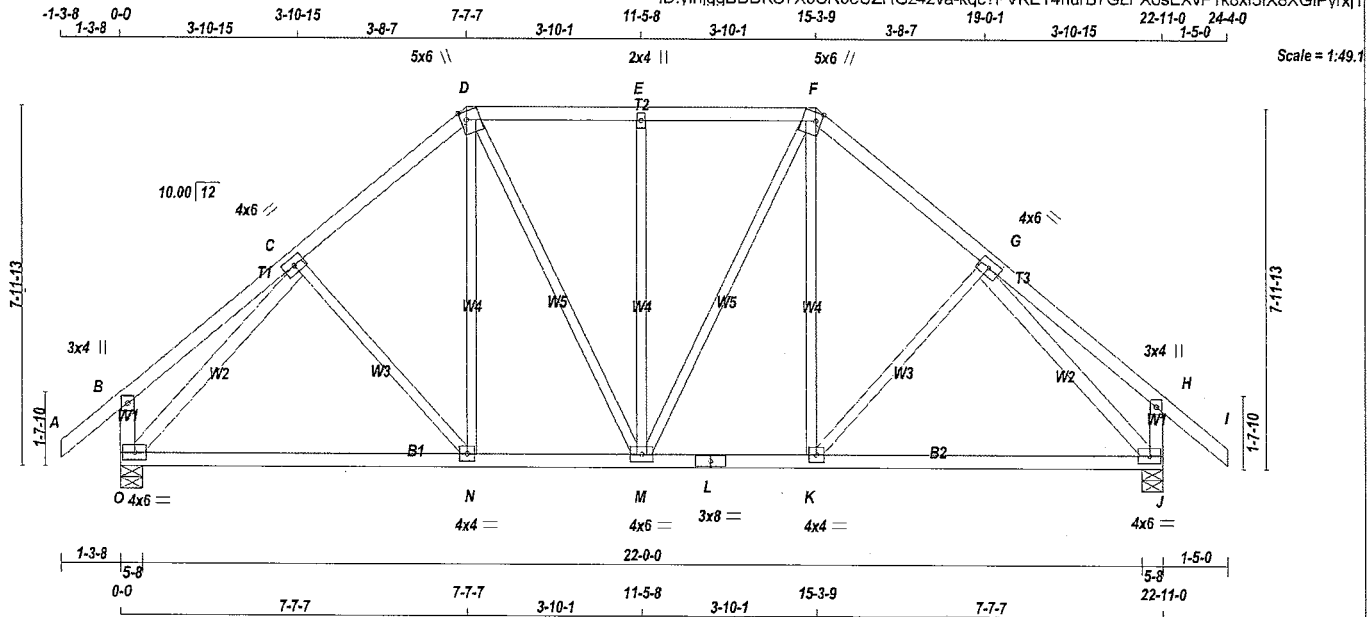

TOTAL WEIGHT = 2 X 118 = 236 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	DRY	NO.2	DESCR.
A - D	2x4	DRY	No.2	SPF
D - F	2x4	DRY	No.2	SPF
F - I	2x4	DRY	No.2	SPF
O - B	2x4	DRY	No.2	SPF
J - H	2x4	DRY	No.2	SPF
O - L	2x4	DRY	No.2	SPF
L - J	2x4	DRY	No.2	SPF
ALL WEBS	2x3	DRY	No.2	SPF
EXCEPT				
O - C	2x4	DRY	No.2	SPF
G - J	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	6.0		
D	TTWW+m	MT20	5.0	6.0	2.25	1.50
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.25	1.50
G	TMWW-t	MT20	4.0	6.0		
H	TMV+p	MT20	3.0	4.0		
J	BMVW1-t	MT20	4.0	6.0		
K	BMWW-t	MT20	4.0	4.0		
L	BS-t	MT20	3.0	8.0		
M	BMWWW-t	MT20	4.0	6.0		
N	BMWW-t	MT20	4.0	4.0		
O	BMVW1-t	MT20	4.0	6.0		

NOTES- (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
O	1435	0	1435	0	5-8	5-8
J	1447	0	1447	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED MAX /MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
O	1010	687 / 0	0 / 0	0 / 0	0 / 0	324 / 0	0 / 0
J	1019	693 / 0	0 / 0	0 / 0	0 / 0	325 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) O, J

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.70 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

CHORDS				WEBS				
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	MEMB.	
FR-TO		FROM TO		FR-TO				
A-B	0 / 42	-95.2 -95.2	0.13 (1)	10.00	C-N	-98 / 15	0.06 (1)	
B-C	0 / 27	-95.2 -95.2	0.22 (1)	10.00	N-D	0 / 225	0.06 (4)	
C-D	-1168 / 0	-95.2 -95.2	0.19 (1)	5.70	K-F	0 / 225	0.06 (4)	
D-E	-988 / 0	-95.2 -95.2	0.18 (1)	6.07	K-G	-98 / 15	0.06 (1)	
E-F	-988 / 0	-95.2 -95.2	0.18 (1)	6.07	O-C	-1452 / 0	0.59 (1)	
F-G	-1168 / 0	-95.2 -95.2	0.19 (1)	5.70	G-J	-1452 / 0	0.59 (1)	
G-H	0 / 27	-95.2 -95.2	0.22 (1)	10.00	M-F	0 / 247	0.06 (1)	
H-I	0 / 46	-95.2 -95.2	0.16 (1)	10.00	D-M	0 / 247	0.06 (1)	
O-B	-269 / 0	0.0	0.0	0.03 (1)	7.81	M-E	-438 / 0	0.53 (1)
J-H	-281 / 0	0.0	0.0	0.03 (1)	7.81			
O-N	0 / 940	-18.5	-18.5	0.31 (4)	10.00			
N-M	0 / 878	-18.5	-18.5	0.32 (4)	10.00			
M-L	0 / 878	-18.5	-18.5	0.32 (4)	10.00			
L-K	0 / 878	-18.5	-18.5	0.32 (4)	10.00			
K-J	0 / 940	-18.5	-18.5	0.31 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2018 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")  
ALLOWABLE DEFL.(TL)= L/360 (0.76")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.22/1.00 (G-H:1), BC=0.32/1.00 (K-M:4), WB=0.59/1.00 (G-J:1), SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (C) (INPUT= 0.90)  
JSI METAL= 0.32 (C) (INPUT= 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080063

JOB NAME 427369	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington ID:vfynjggBDDKS7X0SR0eUZHGz42va-C0ANdqLsEopITLiSvy21OR46NR47gr5pmoGpqrYxJS Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:26:57 2022 Page 1

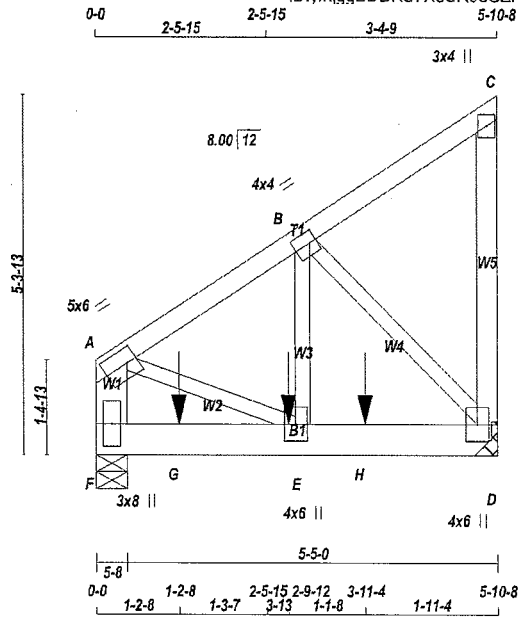

TOTAL WEIGHT = 2 X 33 = 66 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
F - A	2x6	DRY No.2	SPF
F - D	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF  
 DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C 1	12	TOP
D-C 1	12	TOP
F-A 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B-E 1	6	SIDE(21.4)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X	
A	TMWV-t	MT20	3.0	6.0	2.50	1.75
B	TMWV-t	MT20	4.0	4.0	2.00	1.25

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	RECRD BRG
D	1446 0	1446 0	0 0	MECHANICAL
F	1683 0	1683 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX /MIN SNOW	MAX /MIN LIVE	MAX /MIN PERM.LIVE	MAX /MIN WIND	MAX /MIN DEAD	MAX /MIN SOIL
D	1015	711 / 0	0 / 0	0 / 0	0 / 0	304 / 0	0 / 0
F	1181	830 / 0	0 / 0	0 / 0	0 / 0	351 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (CSI)	MAX. UNBRAC (LC)	MEMB. FORCE (LBS)	MAX. FACTORED (LBS)	MAX. UNBRAC (CSI)	MAX. FACTORED (LC)
FR-TO		FROM TO			FR-TO			
A-B	-1302 / 0	-95.2 -95.2	0.07 (1)	6.25	B-D	-1593 / 0	0.22 (1)	
B-C	-16 / 0	-95.2 -95.2	0.06 (1)	6.25	E-B	0 / 1552	0.19 (1)	
D-C	-107 / 0	0.0 0.0	0.02 (1)	7.81	A-E	0 / 1154	0.14 (1)	
F-A	-1209 / 0	0.0 0.0	0.04 (1)	7.81				
F-G	0 / 0	-18.5 -18.5	0.21 (1)	10.00				
G-E	0 / 0	-18.5 -18.5	0.21 (1)	10.00				
E-H	0 / 1096	-18.5 -18.5	0.19 (1)	10.00				
H-D	0 / 1096	-18.5 -18.5	0.19 (1)	10.00				

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	2-9-12	-549	-549		BACK	VERT	TOTAL		C1
G	1-2-8	-626	-626		BACK	VERT	TOTAL		C1
H	3-11-4	-549	-549		BACK	VERT	TOTAL		C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
 ALLOWABLE DEFL.(TL)= L/360 (0.20")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS: TC=0.07/1.00 (A-B:1), BC=0.21/1.00 (E-F:1), WB=0.22/1.00 (B-D:1), SS=0.22/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP (DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.82 (D) (INPUT = 0.90)  
 JSI METAL= 0.25 (D) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080064 PG 1/2

JOB NAME 427369	TRUSS NAME T8	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 09:26:57 2022 Page 2  
ID:yfnjggBDDKS7X0SR0eUZHGz42va-C0ANdgLsEOplTLiSvy21OR46NR47gr5pmoGparyrxjS

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMWW+t	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	8.0		

**NOTES- (1)**


1) Lateral braces to be a minimum of 2X4 SPF #2.



JOB NAME 427369	TRUSS NAME T9	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
				TRUSS DESC.	

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 09:26:58 2022 Page 1  
ID: yfnjggBDDKS7X0SR0eUZHgz42va-hDkmgAMU?ixb5VHeTfZGxfcCmrRnPJqy S0NNlYrxjR

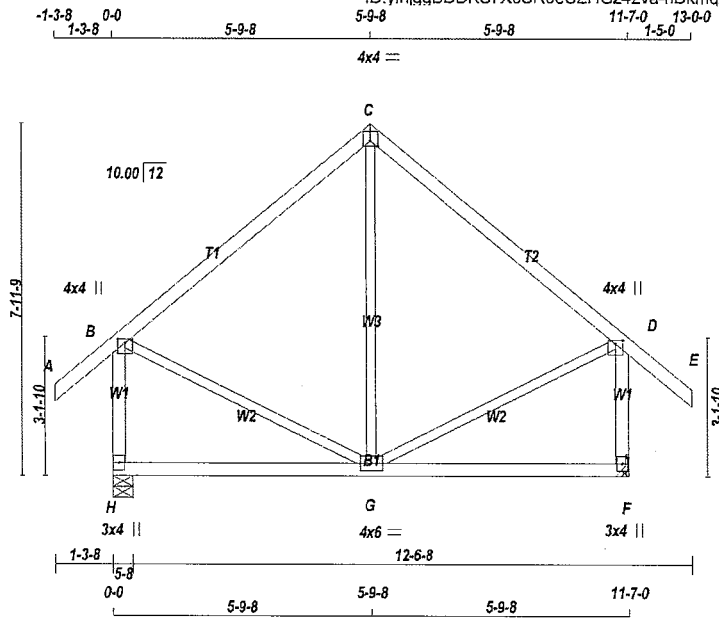

Scale = 1:50.1

TOTAL WEIGHT = 2 X 57 = 114 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	1.50	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-l	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	DOWN	HORZ	UPLIFT
H	790	0	790	0
F	802	0	802	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 3-8.

**UNFACTORED REACTIONS**

JT	1ST LCASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	556	384	0	0	0	0	172	0
F	564	390	0	0	0	0	173	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MEMB.
FR-TO		FROM TO		FR-TO			
A-B	0 / 42	-95.2 -95.2	0.13 (1)	10.00	G-C	-118 / 59	0.14 (1)
B-C	-338 / 0	-95.2 -95.2	0.41 (1)	6.25	B-G	0 / 288	0.06 (1)
C-D	-338 / 0	-95.2 -95.2	0.41 (1)	6.25	G-D	0 / 288	0.06 (1)
D-E	0 / 46	-95.2 -95.2	0.16 (1)	10.00			
H-B	-750 / 0	0.0	0.0	13 (1)	7.81		
F-D	-761 / 0	0.0	0.0	13 (1)	7.81		
H-G	0 / 0	-18.5 -18.5	0.18 (4)	10.00			
G-F	0 / 0	-18.5 -18.5	0.18 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2016, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL) = L/360 (0.39")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.41/1.00 (B-C:1) , BC=0.18/1.00 (G-H:4) , WB=0.14/1.00 (C-G:1) , SSI=0.17/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX	MIN	MAX	MIN
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.57 (D) (INPUT = 0.90 )  
JSI METAL= 0.15 (D) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080065

JOB NAME 427369	TRUSS NAME T10	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington ID:yfnjqBDDKSTX0SR0eUZHGz42va-9P182WM6m73Sjfsr1N4VUs9REEmM8nE5D6lwwkxrxjQ Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:26:59 2022 Page 1

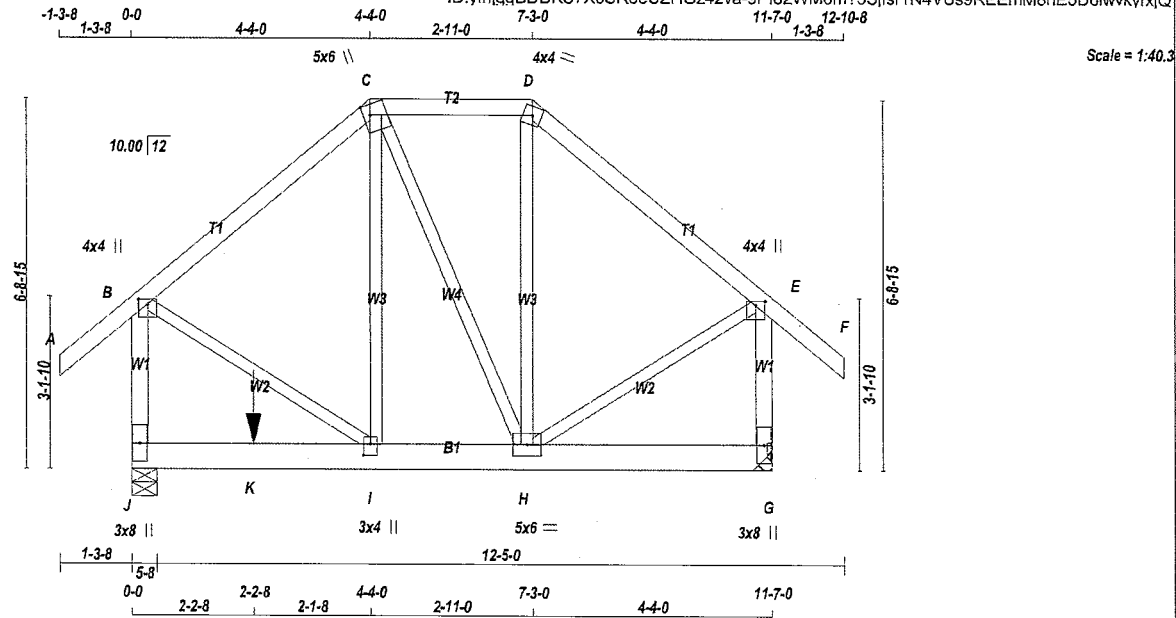

TOTAL WEIGHT = 2 X 70 = 140 lb [M]

**LUMBER**  
N. L. G. A. RULES  
CHORDS SIZE LUMBER DESCR.  
A - C 2x4 DRY No.2 SPF  
C - D 2x4 DRY No.2 SPF  
D - F 2x4 DRY No.2 SPF  
J - B 2x4 DRY No.2 SPF  
G - E 2x4 DRY No.2 SPF  
J - G 2x6 DRY No.2 SPF  
ALL WEBS 2x3 DRY No.2 EXCEPT SPF  
DRY: SEASONED LUMBER.  
DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:  
CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)  
TOP CHORDS : (0.122"x3") SPIRAL NAILS  
A-C 1 12 TOP  
C-D 1 12 TOP  
D-F 1 12 TOP  
J-B 1 12 TOP  
G-E 1 12 TOP  
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS  
J-G 2 12 SIDE(0.0)  
WEBS : (0.122"x3") SPIRAL NAILS  
2x3 1 6  
NAILS TO BE DRIVEN FROM ONE SIDE ONLY.  
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.  
TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.  
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
J	1309	0	1309	0	5-8	5-8
G	913	0	913	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 4-0.

**UNFACTORED REACTIONS**

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS						
		1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	918	647/0	0/0	0/0	0/0	0/0	271/0	0/0
G	641	446/0	0/0	0/0	0/0	0/0	195/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MEMB. MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO			
A-B	0/42	-95.2	-95.2	0.07 (1)	10.00	I-C	0/295	0.04 (1)
B-C	-611/0	-95.2	-95.2	0.17 (1)	6.25	C-H	-270/0	0.12 (1)
C-D	-364/0	-95.2	-95.2	0.08 (1)	6.25	H-D	-40/39	0.01 (1)
D-E	-475/0	-95.2	-95.2	0.17 (1)	6.25	B-I	0/549	0.07 (1)
E-F	0/42	-95.2	-95.2	0.07 (1)	10.00	H-E	0/427	0.05 (1)
J-B	-1017/0	0.0	0.0	0.09 (1)	7.81			
G-E	-866/0	0.0	0.0	0.07 (1)	7.81			
J-K	0/0	-18.5	-18.5	0.22 (1)	10.00			
K-I	0/0	-18.5	-18.5	0.22 (1)	10.00			
I-H	0/473	-18.5	-18.5	0.15 (1)	10.00			
H-G	0/0	-18.5	-18.5	0.02 (4)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
K	2-2-8		-448						C1

**CONNECTION REQUIREMENTS**  
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**  
LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12  
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF NBC 2019, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014  
(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
ALLOWABLE DEFL.(TL)= L/360 (0.39")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")  
CSI: TC=0.17/1.00 (B-C:1), BC=0.22/1.00 (I-J:1), WB=0.12/1.00 (C-H:1), SSI=0.14/1.00 (I-J:1)  
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00  
COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MAX MIN	MAX MIN	MAX MIN
MT20 650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.  
JSI GRIP= 0.66 (I) (INPUT = 0.90)  
JSI METAL = 0.14 (I) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080066 PG 1/2

JOB NAME 427369	TRUSS NAME T10	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:26:59 2022 Page 2  
 ID:yfnjggBDDKS7X0SR0eUZHGz42va-9PI82WM6m?3Sifs1N4VUs9REEmM8nE5D6lwwkyrxjQ

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTWW+m	MT20	5.0	6.0	2.25	1.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.00	2.00
G	BMV1+p	MT20	3.0	8.0		
H	BMWW-t	MT20	5.0	6.0		
I	BMWW+t	MT20	3.0	4.0	2.50	1.50
J	BMV1+p	MT20	3.0	8.0		

**NOTES- (1)**


1) Lateral braces to be a minimum of 2X4 SPF #2.





JOB NAME 427369	TRUSS NAME T11	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:26:59 2022 Page 1  
ID:yfnjggBDDKS7X0SR0eUZHgz42va-9PI82WM6m?3Sjfsr1N4VUs9PsEo28nW5D6lwwkxjQ

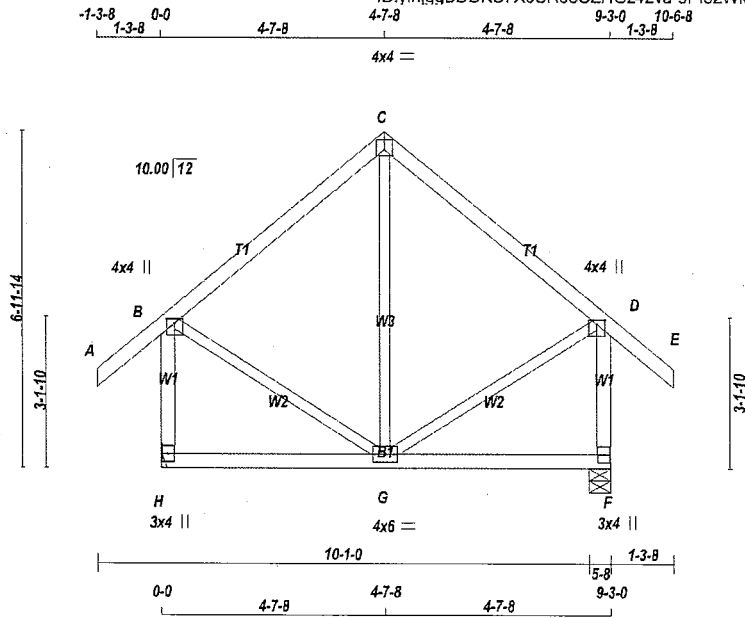

Scale = 1:45.9

TOTAL WEIGHT = 48 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
H - B	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2  
EXCEPT

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00	2.00
C	TTW-p	MT20	4.0	4.0	1.50	2.00
D	TMVW+p	MT20	4.0	4.0	1.00	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVWW-t	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

**NOTES-** (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
H	658	0	658	0	MECHANICAL	
F	658	0	658	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 1-8.

**UNFACTORED REACTIONS**

JT	COMBINED	1ST LCASE MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	462	321/0	0/0	0/0	0/0	141/0	0/0
F	462	321/0	0/0	0/0	0/0	141/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0 / 42	-95.2 -95.2	0.13 (1)	10.00	G-C	-124 / 36	0.10 (1)
B-C	-247 / 0	-95.2 -95.2	0.26 (1)	6.25	B-G	0 / 222	0.05 (1)
C-D	-247 / 0	-95.2 -95.2	0.26 (1)	6.25	G-D	0 / 222	0.05 (1)
D-E	0 / 42	-95.2 -95.2	0.13 (1)	10.00			
H-B	-625 / 0	0.0 0.0	0.11 (1)	7.81			
F-D	-625 / 0	0.0 0.0	0.11 (1)	7.81			
H-G	0 / 0	-18.5 -18.5	0.11 (4)	10.00			
G-F	0 / 0	-18.5 -18.5	0.11 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH.	LL = 26.7	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 40.1	PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.31")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.31")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.26/1.00 (B-C:1), BC=0.11/1.00 (G-H:4), WB=0.10/1.00 (C-G:1), SSI=0.13/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.45 (D) (INPUT = 0.90)  
JSI METAL= 0.13 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY  
DWG # TR22080067

JOB NAME 427369	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:27:00 2022 Page 1

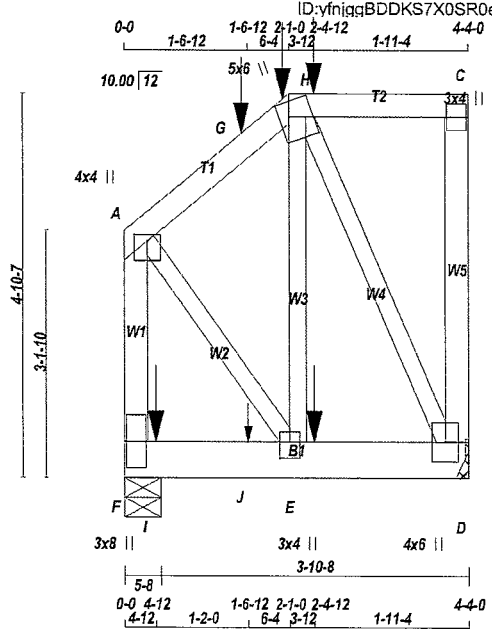

TOTAL WEIGHT = 2 X 31 = 62 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - B	2x4 DRY	No.2	SPF
B - C	2x4 DRY	No.2	SPF
D - C	2x4 DRY	No.2	SPF
F - A	2x4 DRY	No.2	SPF
F - D	2x6 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT  
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"X3") SPIRAL NAILS		
A-B	12	SIDE(61.0)
B-C	12	SIDE(61.0)
C-D	12	TOP
F-A	12	TOP
BOTTOM CHORDS : (0.122"X3") SPIRAL NAILS		
F-D	12	SIDE(183.1)
WEBS : (0.122"X3") SPIRAL NAILS		
2x3	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.  
GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.  
SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT VERT	659	0	0
D	1231	0	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 2-0.

**UNFACTORED REACTIONS**

1ST LCASE	MAX./MIN	COMPONENT REACTIONS
JT COMBINED	325 / 0	0 / 0
D	612 / 0	0 / 0
F	863	251 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-G	-325 / 0	-95.2	-95.2	0.04 (1)	E-B	0 / 470	0.06 (1)	
G-B	-325 / 0	-95.2	-95.2	0.04 (1)	B-D	-577 / 0	0.11 (1)	
B-H	0 / 0	-95.2	-95.2	0.05 (1)	A-E	0 / 396	0.05 (1)	
H-C	0 / 0	-95.2	-95.2	0.05 (1)				
D-C	-109 / 0	0.0	0.0	0.02 (1)				
F-A	-618 / 0	0.0	0.0	0.05 (1)				
F-I	0 / 0	-18.5	-18.5	0.09 (1)				
I-J	0 / 0	-18.5	-18.5	0.09 (1)				
J-E	0 / 0	-18.5	-18.5	0.09 (1)				
E-D	0 / 259	-18.5	-18.5	0.03 (1)				

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	2-1-0	-4	-4	---	FRONT	VERT	DEAD	---	C1
B	2-1-0	-20	-20	---	FRONT	VERT	SNOW	---	C1
E	2-4-12	-447	-447	---	FRONT	VERT	TOTAL	---	C1
E	2-4-12	1	1	---	BACK	VERT	TOTAL	---	C1
G	1-6-12	-2	-2	---	BACK	VERT	TOTAL	---	C1
H	2-4-12	-9	-9	---	BACK	VERT	TOTAL	---	C1
I	4-12	-494	-494	---	TOP	VERT	TOTAL	---	C1
J	1-6-12	1	1	---	BACK	VERT	TOTAL	---	C1

**CONNECTION REQUIREMENTS**  
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

**SPECIFIED LOADS:**

TOP CH. LL	= 26.7 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018 , ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL)= L/999 (0.01")

CSI: TC=0.05/1.00 (A-F:1) , BC=0.09/1.00 (E-F:1) , WB=0.11/1.00 (B-D:1) , SS=0.20/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (Psi)	SECTION (PLI)
MT20	650	371	1747
	788	1967	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.54 (E) (INPUT = 0.90 )  
JSI METAL= 0.11 (E) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080068 PG 1/2

JOB NAME 427369	TRUSS NAME T12	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:27:00 2022 Page 2  
ID:yfnjggBDDKS7X0SR0eUZHGz42va-dbsWFsNkWJBJKpR1a4ck04iese8ffEaFSmVTRAvrxjP

**PLATES (table is in inches)**


JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	4.0	1.00	2.00
B	TTWW+m	MT20	5.0	6.0	2.25	1.50
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMWW+t	MT20	3.0	4.0	2.50	1.50
F	BMV1+p	MT20	3.0	8.0		

**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.



JOB NAME 427369	TRUSS NAME T13	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

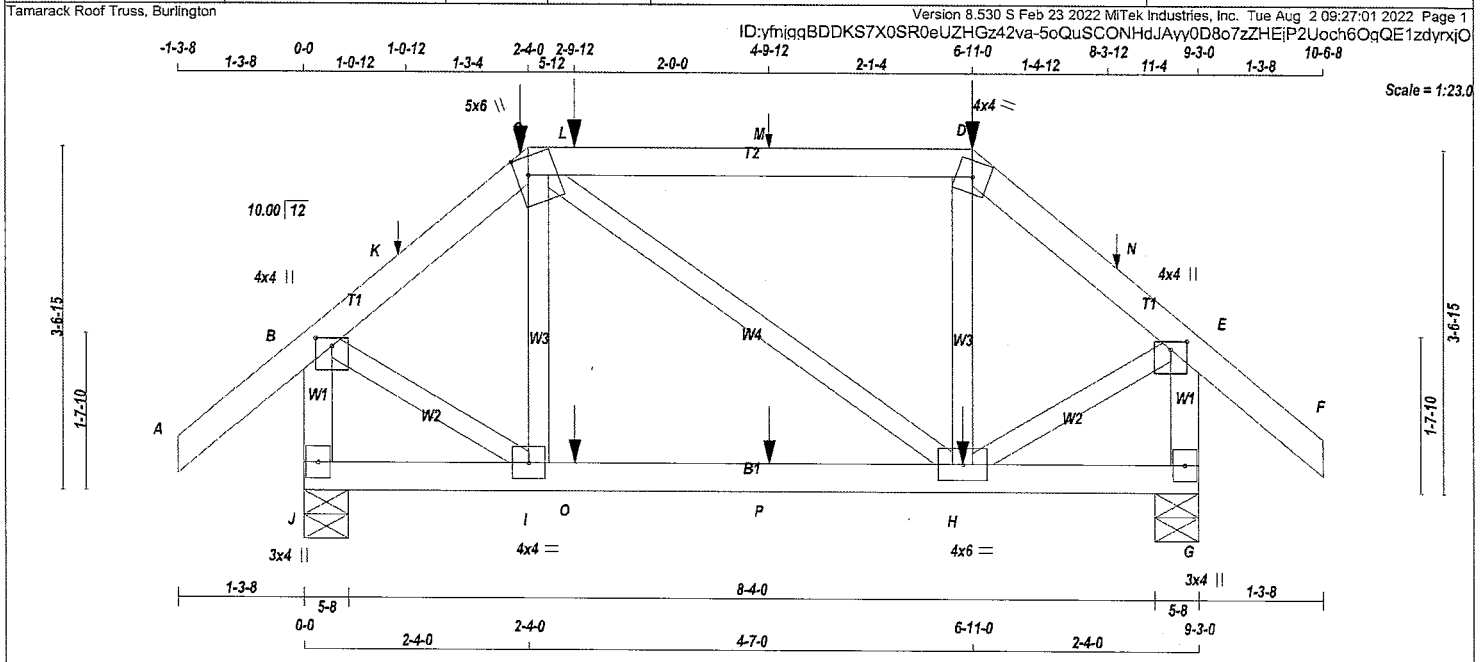

TOTAL WEIGHT = 43 lb [M]

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x4	DRY	No.2

ALL WEBS 2x3 DRY DRY EXCEPT  
SPF

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C	TTWW+m	MT20	5.0	6.0	2.25 1.50
D	TTW-m	MT20	4.0	4.0	
E	TMVW+p	MT20	4.0	4.0	1.00 2.00
G	BMV1+p	MT20	3.0	4.0	
H	BMVWW-t	MT20	4.0	6.0	
I	BMVW-t	MT20	4.0	4.0	
J	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2x4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
J	719	0	719	0	5-8	5-8
G	717	0	717	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE						MAX./MIN. COMPONENT REACTIONS							
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	505	355/0	0/0	0/0	0/0	150/0	0/0	505	355/0	0/0	0/0	0/0	150/0	0/0
G	503	352/0	0/0	0/0	0/0	151/0	0/0	503	352/0	0/0	0/0	0/0	151/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	C H O R D S			W E B S		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO				FR-TO		
A-B	0/42	-95.2	0.14 (1)	10.00	I-C	-106/24 0.02 (1)
B-K	-440/0	-95.2	0.10 (1)	6.25	C-H	-3/2 0.00 (1)
K-C	-440/0	-95.2	0.10 (1)	6.25	H-D	-103/23 0.02 (1)
C-L	-331/0	-95.2	0.39 (1)	6.25	B-I	0/381 0.09 (1)
L-M	-331/0	-95.2	0.39 (1)	6.25	H-E	0/379 0.09 (1)
M-D	-331/0	-95.2	0.39 (1)	6.25		
D-N	-437/0	-95.2	0.10 (1)	6.25		
N-E	-437/0	-95.2	0.10 (1)	6.25		
E-F	0/42	-95.2	0.14 (1)	10.00		
J-B	-706/0	0.0	0.08 (1)	7.81		
G-E	-703/0	0.0	0.08 (1)	7.81		
J-I	0/0	-18.5	-18.5 0.06 (4)	10.00		
I-O	0/333	-18.5	-18.5 0.09 (1)	10.00		
O-P	0/333	-18.5	-18.5 0.09 (1)	10.00		
P-H	0/333	-18.5	-18.5 0.09 (1)	10.00		
H-G	0/0	-18.5	-18.5 0.06 (4)	10.00		

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-4-0	-6	-6		FRONT	VERT	DEAD		C1
C	2-4-0	-28	-28		FRONT	VERT	SNOW		C1
D	6-11-0	-6	-6		FRONT	VERT	DEAD		C1
D	6-11-0	-4	-4		FRONT	VERT	TOTAL		C1
D	6-11-0	-28	-28		FRONT	VERT	SNOW		C1
H	6-9-12	-1	-1		FRONT	VERT	TOTAL		C1
K	1-0-12	1	1		FRONT	VERT	TOTAL		C1
L	2-9-12	-9	-9		FRONT	VERT	TOTAL		C1
M	4-9-12	1	1		FRONT	VERT	TOTAL		C1
N	8-3-12	1	1		FRONT	VERT	TOTAL		C1
O	2-9-12	-1	-1		FRONT	VERT	TOTAL		C1
P	4-9-12	-1	-1		FRONT	VERT	TOTAL		C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018 , ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.31")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.31")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.39/1.00 (C-D:1) , BC=0.09/1.00 (H-I:1) ,  
WB=0.09/1.00 (B-I:1) , SSI=0.20/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.



**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.54 (B) (INPUT = 0.90 )  
JSI METAL= 0.15 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080069

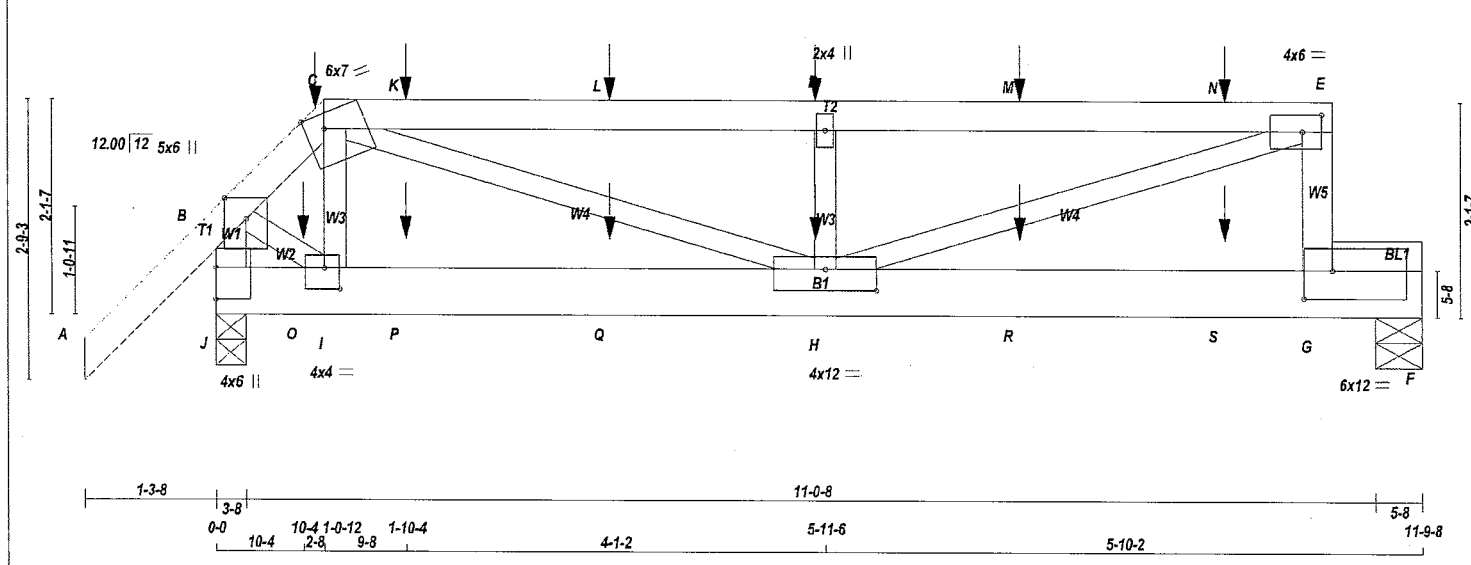

TOTAL WEIGHT = 50 lb

**LUMBER** N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER BEARINGS UNFACTORED REACTIONS DESIGN CRITERIA

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
G - E	2x4	DRY No.2	SPF
J - B	2x4	DRY No.2	SPF
J - F	2x6	DRY No.2	SPF

BEARING BLOCKS	SIZE	LUMBER	DESCR.
BL1	2x4	DRY No.2	SPF

ALL WEBS EXCEPT 2x3 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	5.0	6.0	Edge 2.50
C	TTWW-m	MT20	6.0	7.0	Edge 2.25
D	TMW+w	MT20	2.0	4.0	
E	TMVW-t	MT20	4.0	6.0	2.00 2.25
G	BMVKm	MT20	6.0	12.0	3.25 3.25
H	BMVWW-t	MT20	4.0	12.0	2.50 6.00
I	BMVW-t	MT20	4.0	4.0	2.50 1.75
J	BMV1+p	MT20	4.0	6.0	3.75

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1) 1) Lateral braces to be a minimum of 2X4 SPF #2.

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
J	1128 0	1128 0	3-8	3-8
F	872 0	872 0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX. SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
J	790	566 / 0	0 / 0	0 / 0	0 / 0	223 / 0	0 / 0
F	612	427 / 0	0 / 0	0 / 0	0 / 0	185 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, F

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.32 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. (PLF)	MAX. UNBRAC LENGTH	MEMB.	MAX. FORCE (LBS)	MAX. UNBRAC LENGTH	CS I (LC)
FR-TO		FROM TO	CS I (LC)	FR-TO			
A-B	0 / 47	-95.2 -95.2	0.15 (1)	10.00	I-C	-132 / 0	0.02 (1)
B-C	-895 / 0	-95.2 -95.2	0.15 (1)	6.25	C-H	0 / 1233	0.31 (1)
C-K	-1736 / 0	-95.2 -95.2	0.55 (1)	4.32	H-D	-715 / 0	0.11 (1)
K-L	-1736 / 0	-95.2 -95.2	0.55 (1)	4.32	H-E	0 / 1917	0.47 (1)
L-D	-1736 / 0	-95.2 -95.2	0.55 (1)	4.32	B-I	0 / 658	0.16 (1)
D-M	-1736 / 0	-95.2 -95.2	0.55 (1)	4.32			
M-N	-1736 / 0	-95.2 -95.2	0.55 (1)	4.32			
N-E	-1736 / 0	-95.2 -95.2	0.55 (1)	4.32			
G-E	-872 / 0	0.0 0.0	0.10 (1)	7.81			
J-B	-1177 / 0	0.0 0.0	0.13 (1)	7.32			
J-O	0 / 0	-18.5 -18.5	0.06 (1)	10.00			
O-I	0 / 0	-18.5 -18.5	0.06 (1)	10.00			
I-P	0 / 573	-18.5 -18.5	0.13 (1)	10.00			
P-Q	0 / 573	-18.5 -18.5	0.13 (1)	10.00			
Q-H	0 / 573	-18.5 -18.5	0.13 (1)	10.00			
H-R	-73 / 0	-18.5 -18.5	0.61 (1)	6.25			
R-S	-73 / 0	-18.5 -18.5	0.61 (1)	6.25			
S-G	-73 / 0	-18.5 -18.5	0.61 (1)	6.25			
G-F	0 / 0	-113.7 -113.7	0.81 (1)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	1-0-12	-5	-5		FRONT	VERT	DEAD		C1
C	1-0-12	-44	-44		BACK	VERT	TOTAL		C1
C	1-0-12	-24	-24		FRONT	VERT	SNOW		C1
D	5-10-4	-35	-35		BACK	VERT	TOTAL		C1
H	5-10-4	-15	-15		BACK	VERT	TOTAL		C1
K	1-10-4	-42	-42		BACK	VERT	TOTAL		C1
L	3-10-4	-35	-35		BACK	VERT	TOTAL		C1
M	7-10-4	-35	-35		BACK	VERT	TOTAL		C1
N	9-10-4	-35	-35		BACK	VERT	TOTAL		C1
O	10-4	-20	-20		BACK	VERT	TOTAL		C1
P	1-10-4	-16	-16		BACK	VERT	TOTAL		C1
Q	3-10-4	-15	-15		BACK	VERT	TOTAL		C1
R	7-10-4	-15	-15		BACK	VERT	TOTAL		C1
S	9-10-4	-15	-15		BACK	VERT	TOTAL		C1

**DESIGN CRITERIA**  
\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
LOADS WERE DERIVED FROM USER INPUT  
NO FURTHER MODIFICATIONS WERE MADE

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF CBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**  
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.10")  
ALLOWABLE DEFL.(TL)= L/360 (0.39")  
CALCULATED VERT. DEFL.(TL) = L/756 (0.19")

CSI: TC=0.55/1.00 (D-E:1), BC=0.61/1.00 (G-H:1), WB=0.47/1.00 (E-H:1), SSI=0.35/1.00 (F-G:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873	



JOB NAME 427369	TRUSS NAME T14	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
TRUSS DESC.					

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:27:02 2022 Page 2  
 ID:ROANg0IPsVIVzpOakd5KQlz S1P-Z GgYP?2wR1a6bQiVeC5VnraSixL2QYv4 aW3vrxjN

**CONNECTION REQUIREMENTS**

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.87 (H) (INPUT = 0.90 )  
 JSI METAL= 0.39 (E) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080070 PG 2/2

JOB NAME 427429	TRUSS NAME G1	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:47:58 2022 Page 1

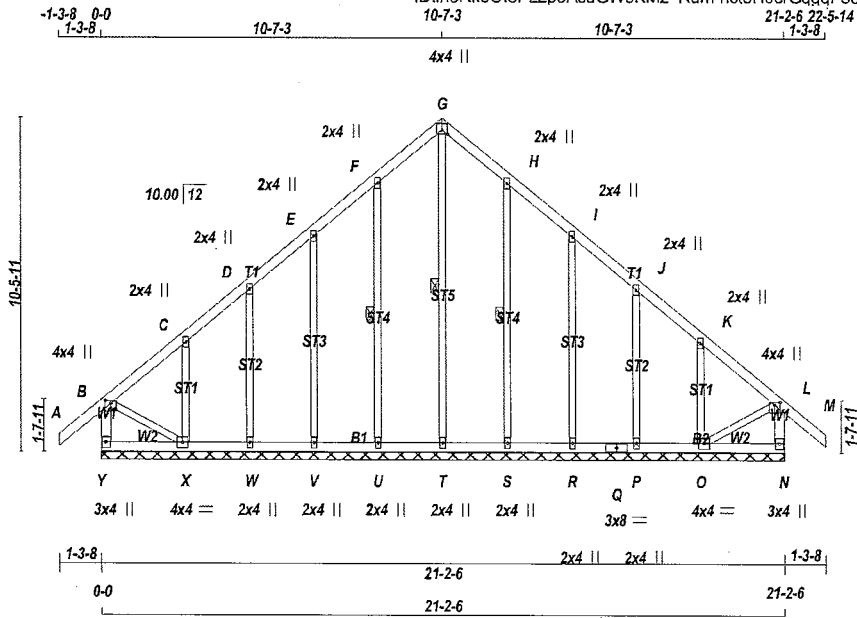

Scale = 1:69.3

TOTAL WEIGHT = 2 X 112 = 224 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
Y - B	2x4	DRY	No.2
A - G	2x4	DRY	No.2
G - M	2x4	DRY	No.2
N - L	2x4	DRY	No.2
Y - Q	2x4	DRY	No.2
Q - N	2x4	DRY	No.2
ALL WEBS	2x3	DRY	No.2
ALL GABLE WEBS	2x3	DRY	No.2
DRY: SEASONED LUMBER.			
GABLE STUDS SPACED AT 2-0-0 OC.			

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
C, D, E, F, H, I, J, K					
C	TMW+w	MT20	2.0	4.0	
G	TTW+p	MT20	4.0	4.0	1.50 2.00
L	TMVW+p	MT20	4.0	4.0	1.00 2.00
N	BMV1+p	MT20	3.0	4.0	
O	BMVW1+t	MT20	4.0	4.0	
P, R, S, T, U, V, W					
P	BMV1+w	MT20	2.0	4.0	
Q	BS-t	MT20	3.0	8.0	
X	BMVW1+t	MT20	4.0	4.0	
Y	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**  
THIS TRUSS DESIGNED FOR CONTINUOUS BEARINGS.  
THIS TRUSS REQUIRES RIGID SHEATHING ON EXPOSED FACE.  
BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S)

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.  
1 LATERAL BRACE(S) AT 1/2 LENGTH OF G-T, F-U, H-S.  
END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	C H O R D S			W E B S		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (CSI (LC))	MEMB. UNBRAC LENGTH (FR-TO)	MAX. FACTORED FORCE (LBS)	MAX (CSI (LC))
FR-TO		FROM TO				
Y-B	-277 / 0	0.0	0.0 0.03 (1)	7.81	T-G	-127 / 0 0.10 (1)
A-B	0 / 42	-95.2	-95.2 0.13 (1)	10.00	U-F	-215 / 0 0.11 (1)
B-C	-32 / 0	-95.2	-95.2 0.08 (1)	6.25	V-E	-187 / 0 0.17 (1)
C-D	-47 / 0	-95.2	-95.2 0.08 (1)	6.25	W-D	-171 / 0 0.08 (1)
D-E	-32 / 0	-95.2	-95.2 0.04 (1)	6.25	X-C	-245 / 0 0.06 (1)
E-F	-28 / 0	-95.2	-95.2 0.05 (1)	6.25	S-H	-215 / 0 0.11 (1)
F-G	-39 / 0	-95.2	-95.2 0.05 (1)	6.25	R-I	-187 / 0 0.17 (1)
G-H	-39 / 0	-95.2	-95.2 0.05 (1)	6.25	P-J	-171 / 0 0.08 (1)
H-I	-28 / 0	-95.2	-95.2 0.05 (1)	6.25	O-K	-246 / 0 0.06 (1)
I-J	-32 / 0	-95.2	-95.2 0.04 (1)	6.25	B-X	0 / 40 0.01 (1)
J-K	-47 / 0	-95.2	-95.2 0.08 (1)	6.25	O-L	0 / 40 0.01 (1)
K-L	-32 / 0	-95.2	-95.2 0.08 (1)	6.25		
L-M	0 / 42	-95.2	-95.2 0.13 (1)	10.00		
N-L	-277 / 0	0.0	0.0 0.03 (1)	7.81		
Y-X	0 / 0	-18.5	-18.5 0.03 (4)	10.00		
X-W	0 / 29	-18.5	-18.5 0.03 (4)	10.00		
W-V	0 / 26	-18.5	-18.5 0.02 (4)	10.00		
V-U	0 / 23	-18.5	-18.5 0.02 (4)	10.00		
U-T	0 / 21	-18.5	-18.5 0.02 (4)	10.00		
T-S	0 / 21	-18.5	-18.5 0.02 (4)	10.00		
S-R	0 / 23	-18.5	-18.5 0.02 (4)	10.00		
R-Q	0 / 26	-18.5	-18.5 0.02 (4)	10.00		
Q-P	0 / 26	-18.5	-18.5 0.02 (4)	10.00		
P-O	0 / 29	-18.5	-18.5 0.03 (4)	10.00		
O-N	0 / 0	-18.5	-18.5 0.03 (4)	10.00		

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

CSI: TC=0.13/1.00 (A-B:1), BC=0.03/1.00 (O-P:4), WB=0.17/1.00 (I-R:1), SS=0.08/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.  
JSI GRIP= 0.74 (G) (INPUT = 0.90)  
JSI METAL= 0.13 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080071

JOB NAME 427429	TRUSS NAME T4A	QUANTITY 4	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 15:23:24 2022 Page 1  
 ID:in5Rk6OlePz2poAsdGW0KMz Rum-VXzYHoAAZYLAo3Bsh6FMIXMtbqPzAOmnhhW1 kyrsVH

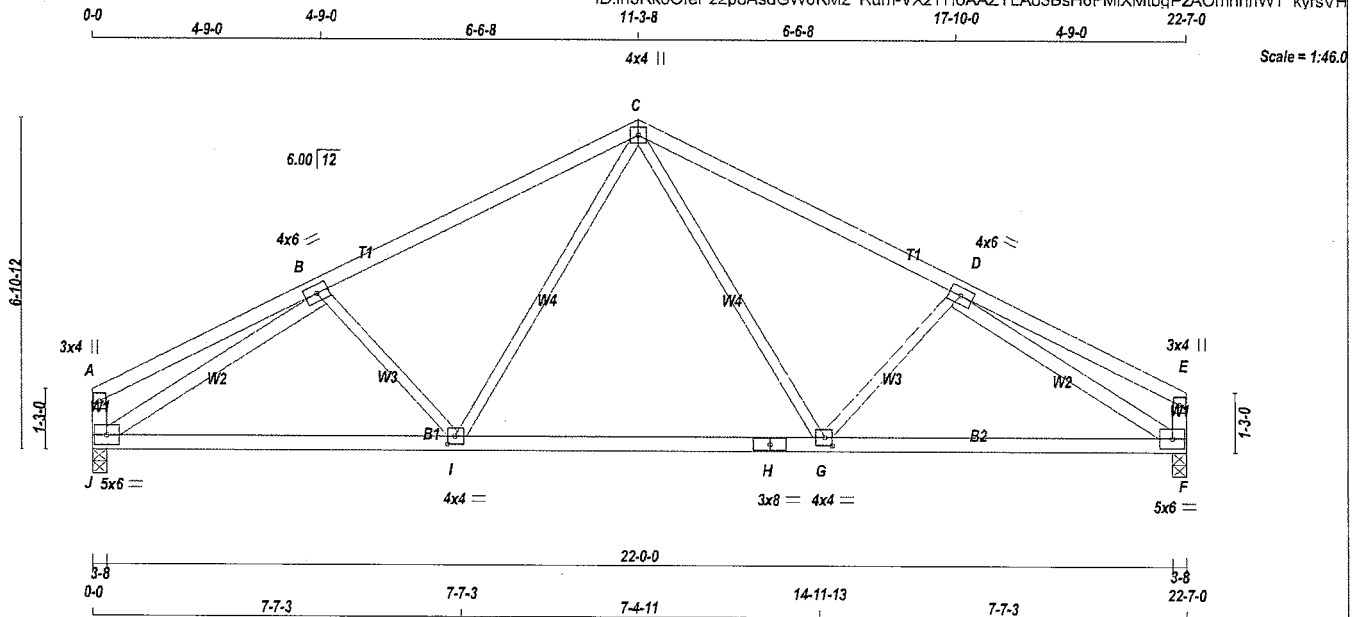

TOTAL WEIGHT = 4 X 87 = 350 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
J - A	2x4	DRY No.2	SPF
F - E	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF
ALL WEBS EXCEPT	2x3	DRY No.2	SPF
J - B	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0	
B	TMWW-t	MT20	4.0	6.0	
C	TTWW+p	MT20	4.0	4.0	
D	TMWW-t	MT20	4.0	6.0	
E	TMV+p	MT20	3.0	4.0	
F	BMVW1-t	MT20	5.0	6.0	
G	BMWW-t	MT20	4.0	4.0	2.00 1.75
H	BS-t	MT20	3.0	8.0	
I	BMWW-t	MT20	4.0	4.0	2.00 1.75
J	BMVW1-t	MT20	5.0	6.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
J	1284	0	1284	0	3-8	3-8
F	1284	0	1284	0	3-8	3-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	906	604 / 0	0 / 0	0 / 0	0 / 0	303 / 0	0 / 0
F	906	604 / 0	0 / 0	0 / 0	0 / 0	303 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, F

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.68 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	C H O R D S			W E B S		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)
FR-TO						
A-B	0 / 38	-95.2	-95.2 0.54 (1)	10.00	C-G	0 / 470
B-C	-1512 / 0	-95.2	-95.2 0.55 (1)	4.68	G-D	-340 / 0
C-D	-1512 / 0	-95.2	-95.2 0.55 (1)	4.68	I-C	0 / 470
D-E	0 / 38	-95.2	-95.2 0.54 (1)	10.00	B-I	-340 / 0
J-A	-136 / 0	0.0	0.0 0.01 (1)	7.81	J-B	-1898 / 0
F-E	-136 / 0	0.0	0.0 0.01 (1)	7.81	D-F	-1898 / 0
J-I	0 / 1553	-18.5	-18.5 0.38 (1)	10.00		
I-H	0 / 1095	-18.5	-18.5 0.33 (4)	10.00		
H-G	0 / 1095	-18.5	-18.5 0.33 (4)	10.00		
G-F	0 / 1553	-18.5	-18.5 0.38 (1)	10.00		

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ASC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.75")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.06")  
ALLOWABLE DEFL.(TL)= L/360 (0.75")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.13")

CSI: TC=0.55/1.00 (B-C:1), BC=0.38/1.00 (I-J:1), WB=0.73/1.00 (D-F:1), SSI=0.26/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (B) (INPUT = 0.90)  
JSI METAL= 0.41 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080080



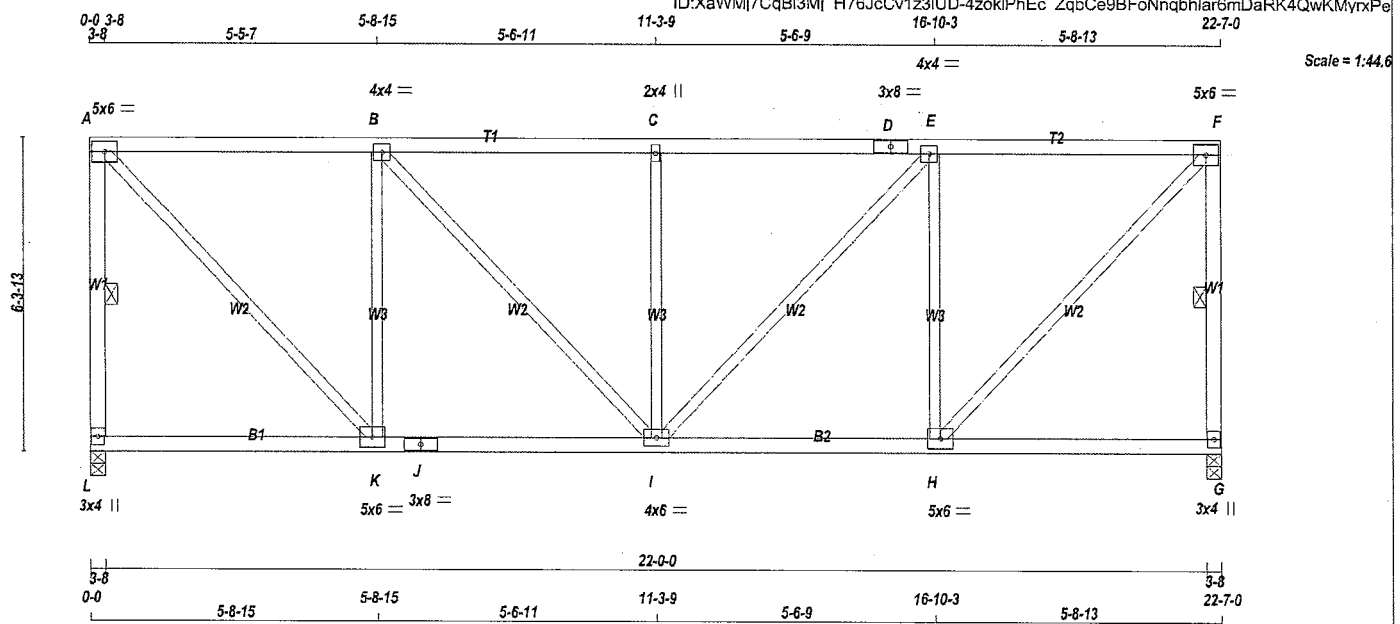

TOTAL WEIGHT = 104 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
L - A	2x4 DRY	No.2	SPF
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
L - J	2x4 DRY	No.2	SPF
J - G	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF  
DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	5.0	6.0	
B	TMVW-t	MT20	4.0	4.0	
C	TMVW-t	MT20	2.0	4.0	
D	TS-t	MT20	3.0	8.0	
E	TMVW-t	MT20	4.0	4.0	
F	TMVW-t	MT20	5.0	6.0	
G	BMV1+p	MT20	3.0	4.0	
H	BMVW-t	MT20	5.0	6.0	
I	BMVW-t	MT20	4.0	6.0	
J	BS-t	MT20	3.0	8.0	
K	BMVW-t	MT20	5.0	6.0	
L	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2x4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	IN-SX	IN-SX		
L	1397	0	1397	0	3-8	3-8		
G	1397	0	1397	0	3-8	3-8		

**UNFACTORED REACTIONS**

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS					
		1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD
L	997	604 / 0	0 / 0	0 / 0	0 / 0	393 / 0	0 / 0
G	997	604 / 0	0 / 0	0 / 0	0 / 0	393 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, G

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.81 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-L, F-G.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)		MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	
		FROM	TO				FR-TO	MAX. CSI (LC)
L-A	-1354 / 0	0.0	0.0	0.25 (1)	5.58	H-F	0 / 1538	0.35 (1)
A-B	-1061 / 0	-105.2	-105.2	0.54 (1)	5.30	A-K	0 / 1539	0.35 (1)
B-C	-1349 / 0	-105.2	-105.2	0.56 (1)	4.81	H-E	-994 / 0	0.63 (1)
C-D	-1349 / 0	-105.2	-105.2	0.56 (1)	4.81	K-B	-994 / 0	0.63 (1)
D-E	-1349 / 0	-105.2	-105.2	0.56 (1)	4.81	I-E	0 / 425	0.10 (1)
E-F	-1061 / 0	-105.2	-105.2	0.54 (1)	5.30	B-I	0 / 425	0.10 (1)
G-F	-1354 / 0	0.0	0.0	0.25 (1)	5.58	I-C	-533 / 0	0.34 (1)

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)		MAX. CSI (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	
		FROM	TO				FR-TO	MAX. CSI (LC)
L-K	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
K-J	0 / 1061	-18.5	-18.5	0.25 (1)	10.00			
J-I	0 / 1061	-18.5	-18.5	0.25 (1)	10.00			
I-H	0 / 1061	-18.5	-18.5	0.25 (1)	10.00			
H-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF DL = 10.0 PSF  
BOT CH. LL = 0.0 PSF DL = 7.4 PSF  
TOTAL LOAD = 44.1 PSF

**SPACING = 24.0 IN./C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.75")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.05")  
ALLOWABLE DEFL.(TL) = L/360 (0.75")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.11")

CSI: TC=0.56/1.00 (B-C:1), BC=0.25/1.00 (H-K:1), WB=0.63/1.00 (B-K:1), SSI=0.28/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.76 (K) (INPUT = 0.90)  
JSI METAL= 0.34 (J) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080081

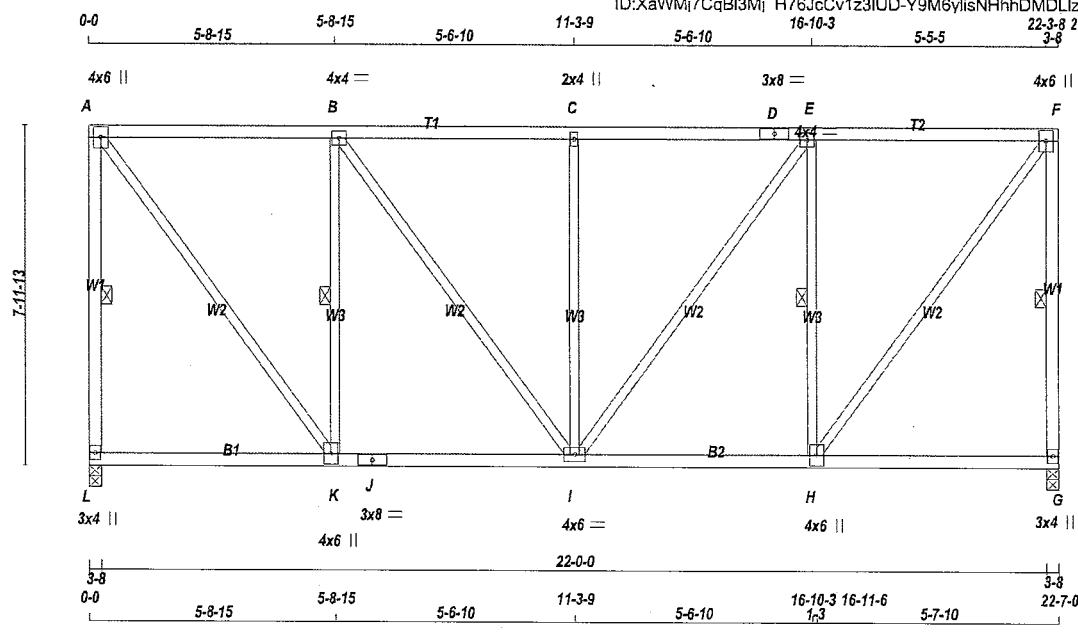

TOTAL WEIGHT = 2 X 116 = 232 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
L - A	2x4 DRY	No.2	SPF
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
G - J	2x4 DRY	No.2	SPF
L - J	2x4 DRY	No.2	SPF
J - G	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF  
 DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0	
B	TMVW-t	MT20	4.0	4.0	
C	TMW+w	MT20	2.0	4.0	
D	TS-t	MT20	3.0	8.0	
E	TMVW-t	MT20	4.0	4.0	
F	TMVW+p	MT20	4.0	6.0	
G	BMV1+p	MT20	3.0	4.0	
H	BMVW-t	MT20	4.0	6.0	
I	BMVW-t	MT20	4.0	6.0	
J	BS-t	MT20	3.0	8.0	
K	BMVW-t	MT20	4.0	6.0	
L	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
L	1397	0	1397	0	3-8	3-8
G	1397	0	1397	0	3-8	3-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	997	604 / 0	0 / 0	0 / 0	0 / 0	393 / 0	0 / 0
G	997	604 / 0	0 / 0	0 / 0	0 / 0	393 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, G

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.31 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-L, F-G, E-H, B-K.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

**LOADING**  
 TOTAL LOAD CASES: (4)

MEMB.	CHORDS MAX. FACTORED FORCE (LBS)		FACTORED VERT. LOAD LC1 (PLF)		MAX. UNBRAC LENGTH (LC)		WEBS MAX. FACTORED FORCE (LBS)	
	FR-TO	FROM TO	FROM TO	LC1 MAX	UNBRAC LENGTH	FR-TO	MAX	
L-A	-1354 / 0	0.0	0.0	0.39 (1)	5.58	A-K	0 / 1391	0.31 (1)
A-B	-832 / 0	-105.2	-105.2	0.52 (1)	5.83	B-I	0 / 385	0.09 (1)
B-C	-1057 / 0	-105.2	-105.2	0.54 (1)	5.31	I-E	0 / 385	0.09 (1)
C-D	-1057 / 0	-105.2	-105.2	0.54 (1)	5.31	H-F	0 / 1391	0.31 (1)
D-E	-1057 / 0	-105.2	-105.2	0.54 (1)	5.31	H-E	-994 / 0	0.40 (1)
E-F	-832 / 0	-105.2	-105.2	0.52 (1)	5.83	K-B	-994 / 0	0.40 (1)
F-G	-1354 / 0	0.0	0.0	0.39 (1)	5.58	I-C	-533 / 0	0.65 (1)
L-K	0 / 0	-18.5	-18.5	0.15 (4)	10.00			
K-J	0 / 832	-18.5	-18.5	0.23 (4)	10.00			
J-I	0 / 832	-18.5	-18.5	0.23 (4)	10.00			
I-H	0 / 832	-18.5	-18.5	0.23 (4)	10.00			
H-G	0 / 0	-18.5	-18.5	0.15 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF DL = 10.0 PSF  
 BOT CH. LL = 0.0 PSF DL = 7.4 PSF  
 TOTAL LOAD = 44.1 PSF

**SPACING = 24.0 IN./G/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF CBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.75")  
 CALCULATED VERT. DEFL.(LL) = L/ 999 (0.05")  
 ALLOWABLE DEFL.(TL)= L/360 (0.75")  
 CALCULATED VERT. DEFL.(TL) = L/ 999 (0.10")

CSI: TC=0.54/1.00 (C-E:1), BC=0.23/1.00 (H-I:4), WB=0.65/1.00 (C-I:1), SSI=0.28/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
 MAX MIN MAX MIN MAX MIN  
 MT20 650 371 1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.80 (F) (INPUT = 0.90)  
 JSI METAL= 0.37 (F) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080082

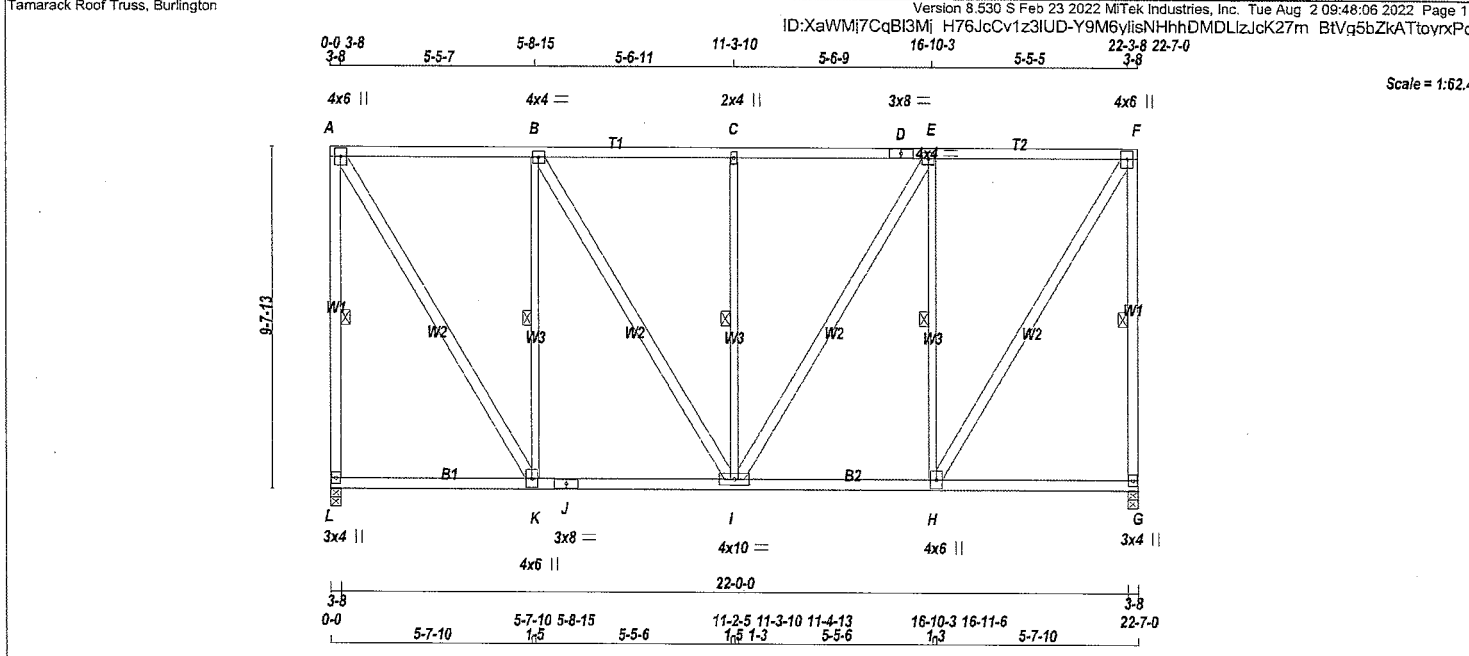

TOTAL WEIGHT = 2 X 142 = 285 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
L - A	2x4 DRY	No.2	SPF
A - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
L - J	2x4 DRY	No.2	SPF
J - G	2x4 DRY	No.2	SPF
<b>ALL WEBS EXCEPT</b>			
H - E	2x3 DRY	No.2	SPF
K - B	2x3 DRY	No.2	SPF
I - C	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0		
B	TMWW-t	MT20	4.0	4.0		
C	TMW+w	MT20	2.0	4.0		
D	TS-t	MT20	3.0	8.0		
E	TMWW-t	MT20	4.0	4.0		
F	TMVW+p	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	4.0		
H	BMWW+t	MT20	4.0	6.0		
I	BMWWW-t	MT20	4.0	10.0		
J	BS-t	MT20	3.0	8.0		
K	BMWW+t	MT20	4.0	6.0		
L	BMV1+p	MT20	3.0	4.0		

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
L	1397	0	1397	0	3-8	3-8
G	1397	0	1397	0	3-8	3-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	997	604/0	0/0	0/0	0/0	393/0	0/0
G	997	604/0	0/0	0/0	0/0	393/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, G

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.73 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

1 LATERAL BRACE(S) AT 1/2 LENGTH OF A-L, F-G, E-H, B-K, C-I.

END VERTICAL(S) MUST BE SHEATHED OR HAVE BRACES AS INDICATED IN THE MAX. UNBRACED LENGTH COLUMN OF THE TABLE BELOW

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS			MEMB.	WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED REACTION (CSI (LC))		MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRAC LENGTH (FT)	MAX. FACTORED REACTION (CSI (LC))	
FR-TO		FROM	TO	FR-TO				
L-A	-1355/0	0.0	0.0	0.60 (1)	5.58	H-F	0/1308	0.21 (1)
A-B	-684/0	-105.2	-105.2	0.52 (1)	6.25	A-K	0/1308	0.21 (1)
B-C	-869/0	-105.2	-105.2	0.53 (1)	5.73	H-E	-993/0	0.62 (1)
C-D	-869/0	-105.2	-105.2	0.53 (1)	5.73	K-B	-993/0	0.62 (1)
D-E	-869/0	-105.2	-105.2	0.53 (1)	5.73	I-E	0/362	0.06 (1)
E-F	-684/0	-105.2	-105.2	0.52 (1)	6.25	B-I	0/361	0.06 (1)
G-F	-1354/0	0.0	0.0	0.60 (1)	5.58	I-C	-533/0	0.33 (1)
L-K	0/0	-18.5	-18.5	0.15 (4)	10.00			
K-J	0/684	-18.5	-18.5	0.21 (4)	10.00			
J-I	0/684	-18.5	-18.5	0.21 (4)	10.00			
I-H	0/684	-18.5	-18.5	0.21 (4)	10.00			
H-G	0/0	-18.5	-18.5	0.15 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 10.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 44.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.75")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.04")  
ALLOWABLE DEFL.(TL)= L/360 (0.75")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.08")

CSI: TC=0.60/1.00 (A-L:1), BC=0.21/1.00 (I-K:4),  
WB=0.62/1.00 (B-K:1), SSI=0.28/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (F) (INPUT = 0.90)  
JSI METAL= 0.31 (K) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080083

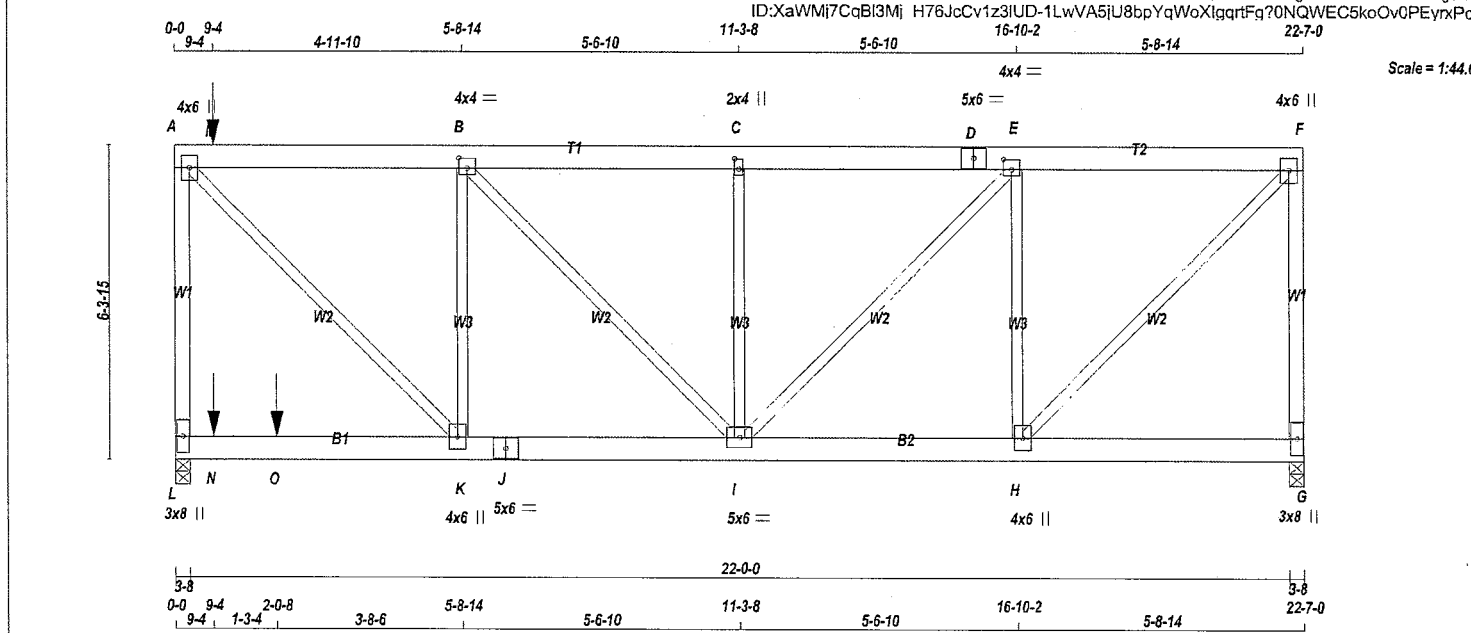

TOTAL WEIGHT = 2 X 131 = 263 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
L - A	2x4	DRY No.2	SPF
A - D	2x6	DRY No.2	SPF
D - F	2x6	DRY No.2	SPF
G - F	2x4	DRY No.2	SPF
L - J	2x6	DRY No.2	SPF
J - G	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF  
DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
L-A 1	12	TOP
F-G 1	12	TOP
A-D 2	12	SIDE(0.0)
D-F 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
L-J 2	12	SIDE(0.0)
J-G 2	12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
L	2978	0	2978	0	3-8	3-8
G	1546	0	1546	0	3-8	3-8

**UNFACTORED REACTIONS**

JT	1ST LCASE		MAX./MIN. COMPONENT REACTIONS				
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
L	2108	1370 / 0	0 / 0	0 / 0	0 / 0	738 / 0	0 / 0
G	1101	676 / 0	0 / 0	0 / 0	0 / 0	425 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, G

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		FACTORED		MAX. UNBRAC LENGTH	WEBS		FACTORED	
	MAX. FORCE (LBS)	VERT. LOAD (PLF)	LC1	MAX		MEMB. FORCE (LBS)	MAX	CS1 (LC)	
FR-TO									
L-A	-2009 / 0	0.0	0.0	0.70 (1)	7.77	H-F	0 / 1766	0.22 (1)	
A-M	-1634 / 0	-105.2	-105.2	0.13 (1)	6.25	A-K	0 / 2337	0.29 (1)	
M-B	-1634 / 0	-105.2	-105.2	0.13 (1)	6.25	H-E	-1093 / 0	0.31 (1)	
B-C	-1632 / 0	-105.2	-105.2	0.13 (1)	6.25	K-B	-685 / 0	0.20 (1)	
C-D	-1632 / 0	-105.2	-105.2	0.13 (1)	6.25	I-E	0 / 578	0.07 (1)	
D-E	-1632 / 0	-105.2	-105.2	0.13 (1)	6.25	B-I	-3 / 38	0.01 (4)	
E-F	-1235 / 0	-105.2	-105.2	0.12 (1)	6.25	I-C	-539 / 0	0.15 (1)	
G-F	-1507 / 0	0.0	0.0	0.52 (1)	7.81				
L-N	0 / 0	-18.5	-18.5	0.70 (1)	10.00				
N-O	0 / 0	-18.5	-18.5	0.70 (1)	10.00				
O-K	0 / 0	-18.5	-18.5	0.70 (1)	10.00				
K-J	0 / 1634	-18.5	-18.5	0.39 (1)	10.00				
J-I	0 / 1634	-18.5	-18.5	0.39 (1)	10.00				
I-H	0 / 1235	-18.5	-18.5	0.15 (1)	10.00				
H-G	0 / 0	-18.5	-18.5	0.04 (4)	10.00				

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
M	9-4	-73	-73		BACK	VERT	TOTAL		C1
N	9-4	-22	-22		BACK	VERT	TOTAL		C1
O	2-0-8	-1120	-1120		BACK	VERT	TOTAL		C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 10.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 44.1 PSF

**SPACING = 24.0 IN./C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.75")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.07")  
ALLOWABLE DEFL.(TL)= L/360 (0.75")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.70/1.00 (A-L:1), BC=0.70/1.00 (K-L:1), WB=0.31/1.00 (E-H:1), SS=0.32/1.00 (K-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.77 (K) (INPUT = 0.80)  
JSI METAL= 0.42 (J) (INPUT = 1.00)



JOB NAME 427429	TRUSS NAME T23	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:07 2022 Page 2  
 ID: XaW/Mj7CqBI3Mj H76JcCv1z3JUD-1LwVA5jU8bpYqWoXlgrtFg?0NQWEC5koOv0PEyrxPc

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	4.0	6.0		
B	TMWW-t	MT20	4.0	4.0	2.50	2.00
C	TMW+w	MT20	2.0	4.0	2.50	1.00
D	TS-t	MT20	5.0	6.0		
E	TMWW-t	MT20	4.0	4.0	2.50	2.00
F	TMVW+p	MT20	4.0	6.0		
G	BMV1+p	MT20	3.0	8.0		
H	BMWW+t	MT20	4.0	6.0		
I	BMWWW-t	MT20	5.0	6.0		
J	BS-t	MT20	5.0	6.0		
K	BMWW+t	MT20	4.0	6.0		
L	BMV1+p	MT20	3.0	8.0		

**NOTES-** (1)


1) Lateral braces to be a minimum of 2X4 SPF #2.



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080084 PG 2/2

JOB NAME 427429	TRUSS NAME T24	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:08 2022 Page 1  
ID: XaWMj7CqB13Mj H76JcV1z3IU-D-VYTfNRj6vxvPsgNksOL4PTDjQns zfwu12faxhyrxPb

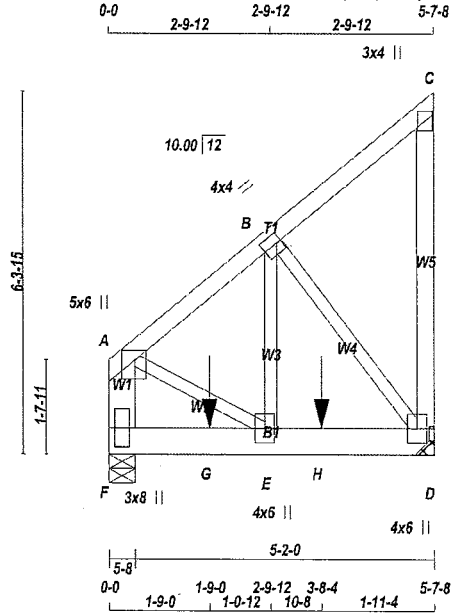

Scale = 1:38.6

TOTAL WEIGHT = 2 X 35 = 70 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER	DESCR.
A - C	2x4	DRY	No.2	SPF
D - C	2x4	DRY	No.2	SPF
F - A	2x6	DRY	No.2	SPF
F - D	2x6	DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C	1 12	TOP
C - D	1 12	TOP
F - A	2 12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D	2 12	SIDE(0.0)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1 6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW+p	MT20	5.0	6.0	2.00 2.25

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
D	1611	0	1611	0	MECHANICAL	
F	1914	0	1914	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX /MIN COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
D	1135	768 / 0	0 / 0	0 / 0	0 / 0	366 / 0	0 / 0
F	1348	915 / 0	0 / 0	0 / 0	0 / 0	433 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. CSI (LC)	MEMB. UNBRAC LENGTH	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	-1341 / 0	-95.2 -95.2	0.06 (1)	6.25	E-B	0 / 1870	0.23 (1)	
B-C	-17 / 0	-95.2 -95.2	0.06 (1)	6.25	B-D	-1685 / 0	0.28 (1)	
D-C	-107 / 0	0.0 0.0	0.04 (1)	7.81	A-E	0 / 1138	0.14 (1)	
F-A	-1429 / 0	0.0 0.0	0.05 (1)	7.81				
F-G	0 / 0	-18.5 -18.5	0.30 (1)	10.00				
G-E	0 / 0	-18.5 -18.5	0.30 (1)	10.00				
E-H	0 / 1043	-18.5 -18.5	0.27 (1)	10.00				
H-D	0 / 1043	-18.5 -18.5	0.27 (1)	10.00				

**SPECIFIED CONCENTRATED LOADS (LBS)**

LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
G	1-9-0	-1227	-1227	---	BACK	VERT	---	C1
H	3-8-4	-805	-805	---	BACK	VERT	---	C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH. LL	= 26.7 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 085-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.06/1.00 (A-B:1) , BC=0.30/1.00 (E-F:1)  
WB=0.28/1.00 (B-D:1) , SSI=0.43/1.00 (E-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.86 (B) (INPUT = 0.90 )  
JSI METAL= 0.24 (E) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080085 PG 1/2

CONTINUED ON PAGE 2

JOB NAME 427429	TRUSS NAME T24	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 09:48:08 2022 Page 2  
ID: XaWmJ7CgBI3Mj H76JcCv1z3lUD-VYtNRj6vxxPSgNksOL4PTDJqns\_zfwu12faxhyrxPb


**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMWW-t	MT20	4.0	4.0	2.00	1.00
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMWW+t	MT20	4.0	6.0		
F	BMV1+p	MT20	3.0	8.0		

**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.



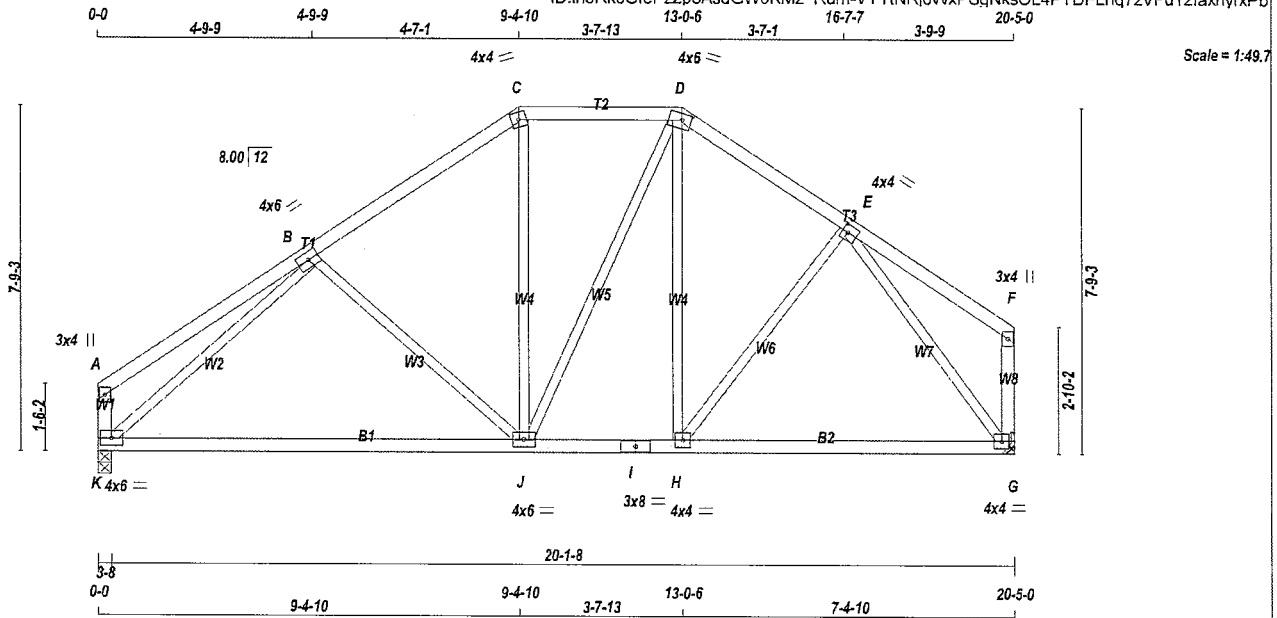

TOTAL WEIGHT = 92 lb [M][F]

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
K - A	2x4 DRY	No.2	SPF
G - F	2x4 DRY	No.2	SPF
K - I	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
A	TMV+p	MT20	3.0	4.0		
B	TTWW-t	MT20	4.0	6.0		
C	TTW-m	MT20	4.0	4.0		
D	TTWW-m	MT20	4.0	6.0	1.75	2.50
E	TMWW-t	MT20	4.0	4.0	2.00	1.50
F	TMV+p	MT20	3.0	4.0		
G	BMVW1-t	MT20	4.0	4.0		
H	BMVW1-t	MT20	4.0	4.0		
I	BS-t	MT20	3.0	8.0		
J	BMVW1-t	MT20	4.0	6.0		
K	BMVW1-t	MT20	4.0	6.0		

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
K	1161	0	1161	0	3-8	3-8
G	1161	0	1161	0	MECHANICAL	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT G. MINIMUM BEARING LENGTH AT JOINT G = 3-8.

**UNFACTORED REACTIONS**

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	819	546 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0
G	819	546 / 0	0 / 0	0 / 0	0 / 0	274 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.92 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC1 MAX	MEMB. MAX. FORCE (LBS)	FACTORED UNBRAC LENGTH	MEMB. MAX. FORCE (LBS)	FACTORED UNBRAC LENGTH
FR-TO		FROM TO			FR-TO			
A-B	0 / 29	-95.2 -95.2	0.34 (1)	10.00	B-J	-259 / 0	0.20 (1)	
B-C	-997 / 0	-95.2 -95.2	0.27 (1)	5.92	J-C	0 / 194	0.04 (4)	
C-D	-807 / 0	-95.2 -95.2	0.17 (1)	6.25	J-D	0 / 149	0.03 (1)	
D-E	-916 / 0	-95.2 -95.2	0.17 (1)	6.25	H-D	0 / 55	0.02 (4)	
E-F	0 / 22	-95.2 -95.2	0.21 (1)	10.00	H-E	0 / 59	0.02 (4)	
K-A	-170 / 0	0.0 0.0	0.02 (1)	7.81	K-B	-1355 / 0	0.96 (1)	
G-F	-136 / 0	0.0 0.0	0.02 (1)	7.81	E-G	-1201 / 0	0.79 (1)	
K-J	0 / 997	-18.5 -18.5	0.42 (4)	10.00				
J-I	0 / 743	-18.5 -18.5	0.41 (4)	10.00				
I-H	0 / 743	-18.5 -18.5	0.41 (4)	10.00				
H-G	0 / 716	-18.5 -18.5	0.28 (4)	10.00				

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2019, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.68")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.03")  
ALLOWABLE DEFL.(TL)= L/360 (0.68")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.24")

CSI: TC=0.34/1.00 (A-B:1), BC=0.42/1.00 (J-K:4), WB=0.96/1.00 (B-K:1), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.88 (G) (INPUT = 0.90 )  
JSI METAL= 0.44 (I) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080086



JOB NAME 427429	TRUSS NAME T26	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
				TRUSS DESC.	

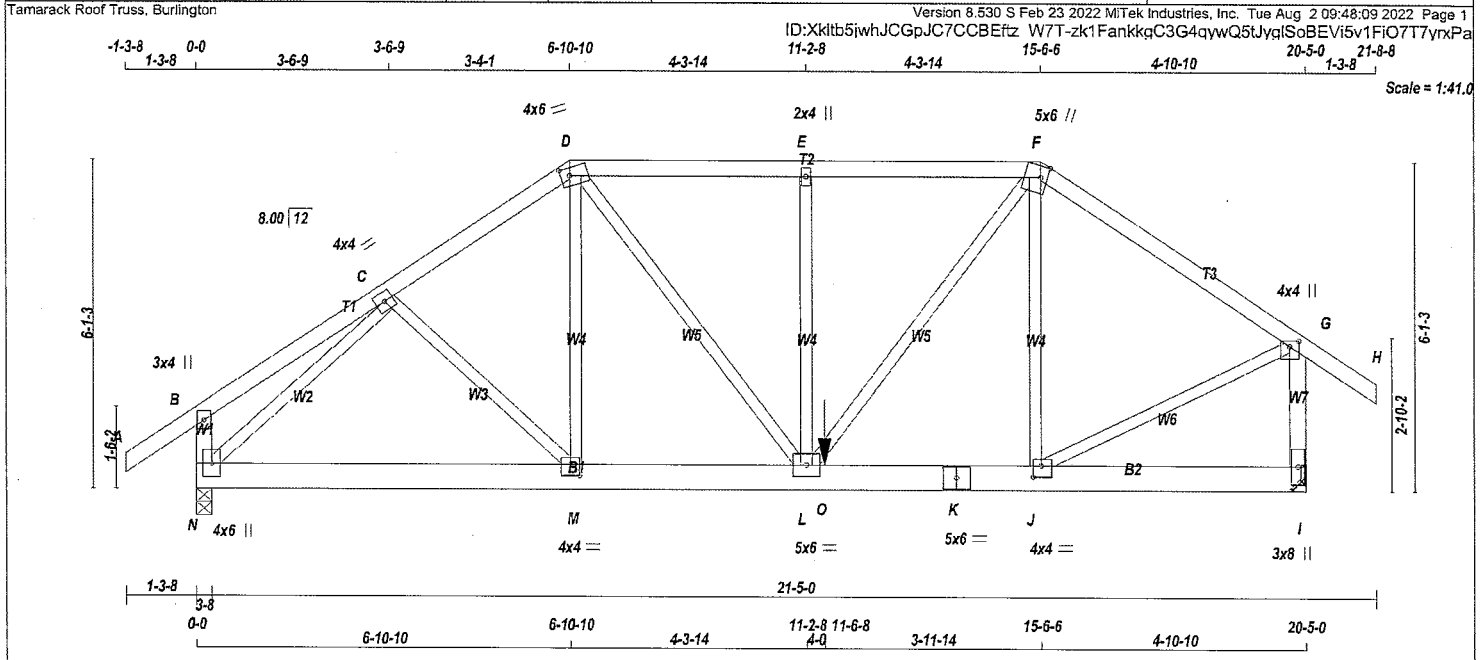

TOTAL WEIGHT = 2 X 106 = 211 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY No.2	SPF
D - F	2x4	DRY No.2	SPF
F - H	2x4	DRY No.2	SPF
N - B	2x4	DRY No.2	SPF
I - G	2x4	DRY No.2	SPF
N - K	2x6	DRY No.2	SPF
K - I	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS SURFACE SPACING (IN) LOAD(PLF)

TOP CHORDS : (0.122"x3") SPIRAL NAILS

A-D	1	12	TOP
D-F	1	12	TOP
F-H	1	12	TOP
N-B	1	12	TOP
I-G	1	12	TOP

BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS

N-K	2	12	SIDE(183.1)
K-I	2	12	TOP

WEBS : (0.122"x3") SPIRAL NAILS

E-L	1	6	SIDE(33.6)
2x3	1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
N	1652	0	1652	0	3-8	3-8
I	1761	0	1761	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 4-0.

**UNFACTORED REACTIONS**

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS		WIND	DEAD	SOIL
		SNOW	LIVE			
N	1165	786 / 0	0 / 0	0 / 0	378 / 0	0 / 0
I	1241	837 / 0	0 / 0	0 / 0	405 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) N

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO	FR-TO	
A-B	0 / 36	-95.2 -95.2 0.07 (1)	C-M	0 / 57 0.01 (4)
B-C	0 / 19	-95.2 -95.2 0.09 (1)	M-D	0 / 100 0.02 (4)
C-D	-1669 / 0	-95.2 -95.2 0.10 (1)	J-F	-398 / 0 0.11 (1)
D-E	-1775 / 0	-95.2 -95.2 0.17 (1)	N-C	-1899 / 0 0.36 (1)
E-F	-1775 / 0	-95.2 -95.2 0.17 (1)	J-G	0 / 1316 0.16 (1)
F-G	-1423 / 0	-95.2 -95.2 0.23 (1)	L-E	-492 / 0 0.14 (1)
G-H	0 / 36	-95.2 -95.2 0.07 (1)	L-F	0 / 993 0.12 (1)
N-B	-259 / 0	0.0 0.0 0.01 (1)	D-L	0 / 668 0.08 (1)
I-G	-1733 / 0	0.0 0.0 0.13 (1)		

MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH
N-M	0 / 1350	-18.5 -18.5 0.12 (1)	10.00
M-L	0 / 1372	-18.5 -18.5 0.11 (1)	10.00
L-O	0 / 1175	-18.5 -18.5 0.16 (1)	10.00
O-K	0 / 1175	-18.5 -18.5 0.16 (1)	10.00
K-J	0 / 1175	-18.5 -18.5 0.16 (1)	10.00
J-I	0 / 0	-18.5 -18.5 0.04 (4)	10.00

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
O	11-6-8		-588	-588					C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.68")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")  
ALLOWABLE DEFL.(TL)= L/360 (0.68")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.23/1.00 (F-G:1), BC=0.16/1.00 (J-L:1),  
WB=0.36/1.00 (C-N:1), SSI=0.26/1.00 (J-L:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (J) (INPUT = 0.90)  
JSI METAL= 0.32 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080087 PG 1/2

JOB NAME 427429	TRUSS NAME T26	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 09:48:09 2022 Page 2  
 ID:Xkltb5jwhJCGpJC7CCBEftz W7T-zk1FankkgC3G4qywQ5JyqISoBEVi5v1FiO7T7yvxPa

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMWW-t	MT20	4.0	4.0		
D	TTWW-m	MT20	4.0	6.0	1.75	2.00
E	TMW+w	MT20	2.0	4.0		
F	TTWW+m	MT20	5.0	6.0	2.50	1.50
G	TMWW+p	MT20	4.0	4.0	1.25	2.00
I	BMV1+p	MT20	3.0	8.0		
J	BMWW-t	MT20	4.0	4.0	2.50	1.75
K	BS-t	MT20	5.0	6.0		
L	BMWW-t	MT20	5.0	6.0		
M	BMWW-t	MT20	4.0	4.0	2.50	2.00
N	BMVW1+p	MT20	4.0	6.0		


**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.

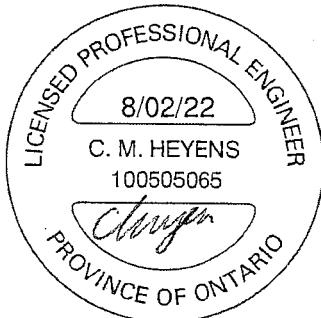

JOB NAME 427429	TRUSS NAME T27	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:10 2022 Page 1  
 ID: Xkltb5jwhJCGpJC7CCBEftz W7T-Rwbd07INRWB7h W6 pOYUule7bbyRcrAUM8h0ZyrxPZ

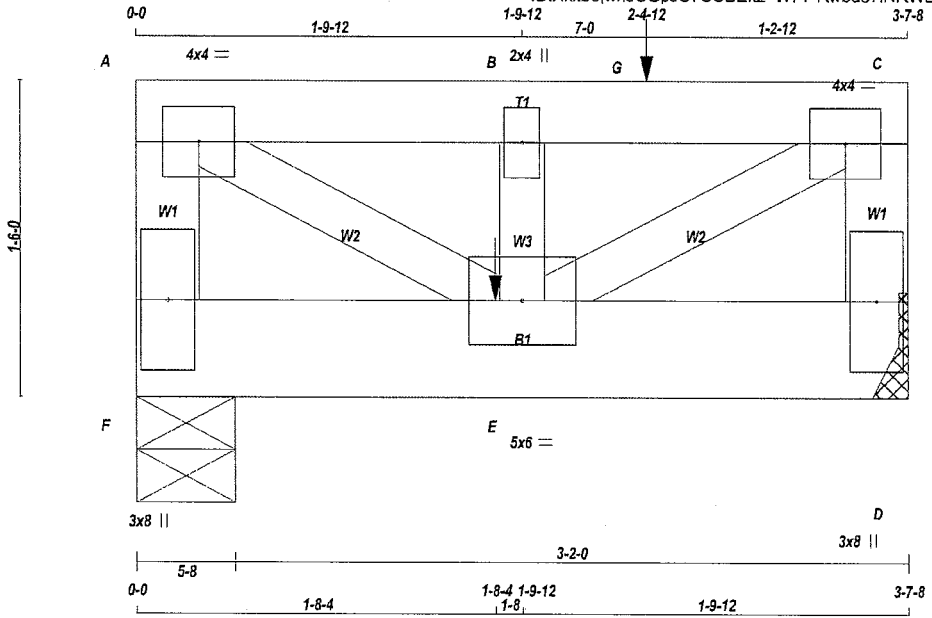

TOTAL WEIGHT = 2 X 16 = 31 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - A	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
F - D	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF  
 DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
F-A 1	12	TOP
A-C 1	12	TOP
C-D 1	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F-D 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLIES FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERRING. REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
A	TMW-t	MT20	4.0	4.0		
B	TMW-w	MT20	2.0	4.0		
C	TMW-t	MT20	4.0	4.0		

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
F	706	706	0	5-8
D	849	849	0	MECHANICAL

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 2-0.

**UNFACTORED REACTIONS**

JT	1ST LCASE CD	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	501	320 / 0	0 / 0	0 / 0	0 / 0	181 / 0	0 / 0
D	602	385 / 0	0 / 0	0 / 0	0 / 0	218 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FORCE (LBS)	FACTORED VERT. (PLF)	MAX. LOAD LC1 (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	CS I (LC)
F-A	-573 / 0	0.0	0.0	0.03 (1)	7.81	E-B	-538 / 0	0.04 (1)
A-B	-833 / 0	-95.2	-95.2	0.04 (1)	6.25	A-E	0 / 981	0.12 (1)
B-G	-833 / 0	-95.2	-95.2	0.13 (1)	6.25	E-C	0 / 981	0.12 (1)
G-C	-833 / 0	-95.2	-95.2	0.13 (1)	6.25			
D-C	-716 / 0	0.0	0.0	0.04 (1)	7.81			
F-E	0 / 0	-18.5	-18.5	0.08 (1)	10.00			
E-D	0 / 0	-18.5	-18.5	0.08 (1)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	1-8-4	-496	-496	---	BACK	VERT	TOTAL	---	C1
G	2-4-12	-316	-316	---	TOP	VERT	TOTAL	---	C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF

BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF

TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(5% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
 ALLOWABLE DEFL.(TL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.13/1.00 (B-C:1), BC=0.09/1.00 (E-F:1), WB=0.12/1.00 (A-E:1), SSI=0.18/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.60 (E) (INPUT = 0.80)  
 JSI METAL= 0.14 (A) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080088 PG 1/2

JOB NAME 427429	TRUSS NAME T27	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:10 2022 Page 2  
ID:Xkktb5jwhJCGpJC7CCBEftz\_W7T-Rwbdo7INRWB7h\_W6\_pOYUule7bbyRcrAUM8h0ZyrxPZ


**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
D	BMV1+p	MT20	3.0	8.0		
E	BMWWW-t	MT20	5.0	6.0		
F	BMV1+p	MT20	3.0	8.0		

**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.



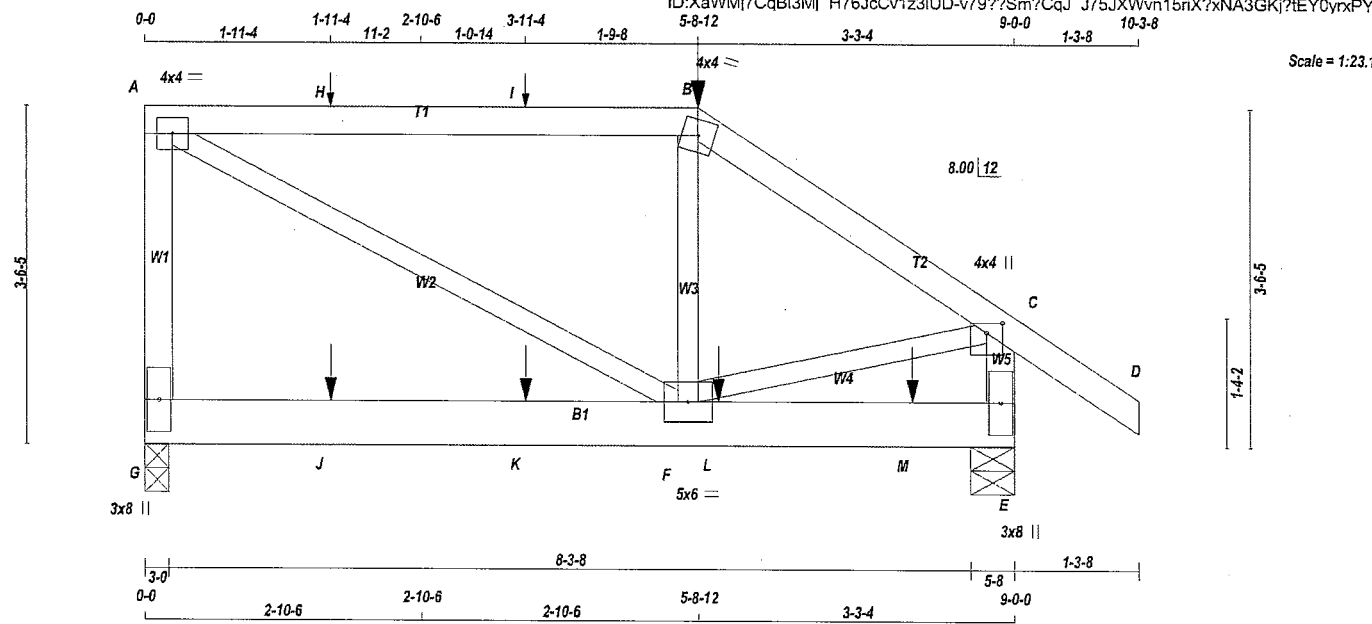

TOTAL WEIGHT = 43 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
G - A	2x4	DRY	No.2 SPF
A - B	2x4	DRY	No.2 SPF
B - D	2x4	DRY	No.2 SPF
E - C	2x4	DRY	No.2 SPF
G - E	2x6	DRY	No.2 SPF

ALL WEBS 2x3 DRY No.2 SPF EXCEPT  
DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0	
B	TTW-m	MT20	4.0	4.0	
C	TMVW+p	MT20	4.0	4.0	1.25 2.00
E	BMV1+p	MT20	3.0	8.0	
F	BMVWV-t	MT20	5.0	6.0	
G	BMV1+p	MT20	3.0	8.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	DOWN	IN-SX	IN-SX
G	540	0	0	3-0
E	692	0	0	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX./MIN. SNOW	MIN. COMPONENT LIVE	PERM. LIVE	WIND	DEAD	SOIL
G	381	255 / 0	0 / 0	0 / 0	0 / 0	127 / 0	0 / 0
E	485	339 / 0	0 / 0	0 / 0	0 / 0	147 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G, E

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (CSI)	MAX. LC2 (LC)	MEMB. FORCE (LBS)	MAX. FACTORED (LBS)	MAX. UNBRACED LENGTH (LC)	CS1 (LC)
FR-TO		FROM	TO		FR-TO			
G-A	-492 / 0	0.0	0.0	0.09 (1)	7.81	A-F	0 / 444	0.11 (1)
A-H	-386 / 0	-95.2	-95.2	0.60 (1)	6.25	F-B	-234 / 0	0.05 (1)
H-I	-386 / 0	-95.2	-95.2	0.60 (1)	6.25	F-C	0 / 416	0.10 (1)
I-B	-386 / 0	-95.2	-95.2	0.60 (1)	6.25			
B-C	-484 / 0	-95.2	-95.2	0.20 (1)	6.25			
C-D	0 / 36	-95.2	-95.2	0.14 (1)	10.00			
E-C	-664 / 0	0.0	0.0	0.07 (1)	7.81			
G-J	0 / 0	-18.5	-18.5	0.07 (4)	10.00			
J-K	0 / 0	-18.5	-18.5	0.07 (4)	10.00			
K-F	0 / 0	-18.5	-18.5	0.07 (4)	10.00			
F-L	0 / 0	-18.5	-18.5	0.06 (4)	10.00			
L-M	0 / 0	-18.5	-18.5	0.06 (4)	10.00			
M-E	0 / 0	-18.5	-18.5	0.06 (4)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
B	5-8-12	-9	-	-	FRONT	VERT	DEAD	-	C1
B	5-8-12	-3	-3	-	FRONT	VERT	TOTAL	-	C1
B	5-8-12	-39	-39	-	FRONT	VERT	SNOW	-	C1
H	1-11-4	1	1	-	FRONT	VERT	TOTAL	-	C1
I	3-11-4	1	1	-	FRONT	VERT	TOTAL	-	C1
J	1-11-4	-1	-1	-	FRONT	VERT	TOTAL	-	C1
K	3-11-4	-1	-1	-	FRONT	VERT	TOTAL	-	C1
L	5-11-4	-1	-1	-	FRONT	VERT	TOTAL	-	C1
M	7-11-4	-1	-1	-	FRONT	VERT	TOTAL	-	C1

**CONNECTION REQUIREMENTS**  
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
LOADS WERE DERIVED FROM USER INPUT  
NO FURTHER MODIFICATIONS WERE MADE

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
ADDT'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018 , ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.30")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
ALLOWABLE DEFL.(TL)= L/360 (0.30")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CS1: TC=0.60/1.00 (A-B:1) , BC=0.07/1.00 (F-G:4) , WB=0.11/1.00 (A-F:1) , SSI=0.23/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	650	371	1747
	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.55 (F) (INPUT = 0.90 )  
JSI METAL= 0.14 (C) (INPUT = 1.00 )




STRUCTURAL COMPONENT ONLY  
DWG # TR22080089

JOB NAME 427429	TRUSS NAME T29	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:11 2022 Page 1  
ID: XaWmJ7CqBj3Mj H76JcV1z3UD-v79?Sm?CqJ J75JXWvn15rnE?vcA0hKj?tEY0yrxPY

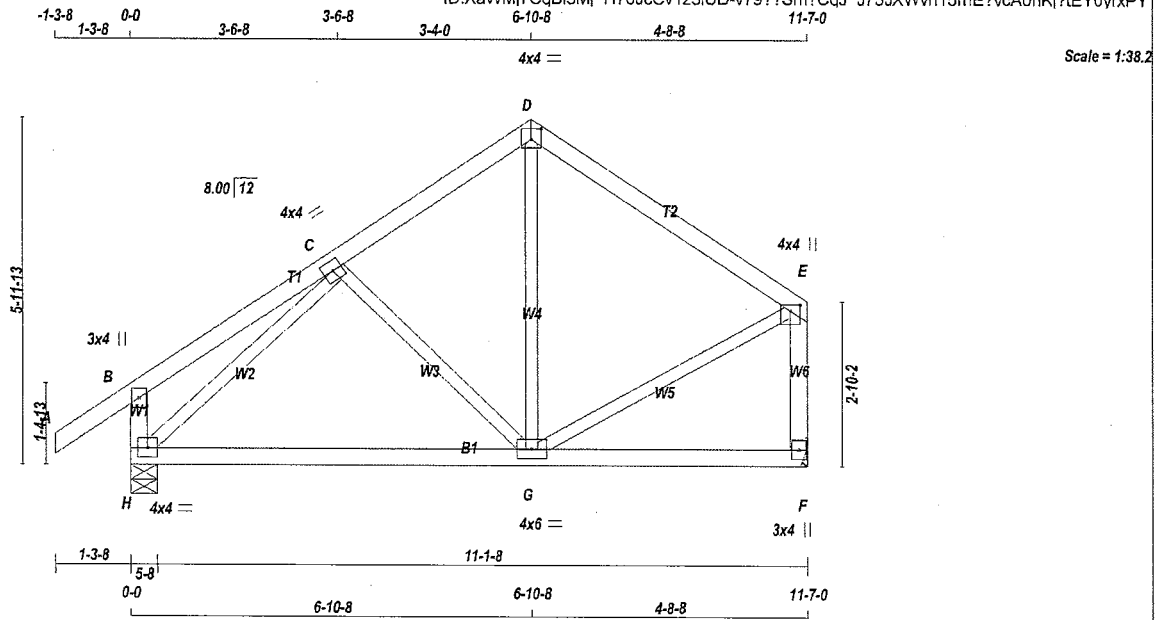

TOTAL WEIGHT = 2 X 51 = 102 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - D	2x4	DRY	No.2
D - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - E	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2  
EXCEPT

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	4.0		
D	TTW-p	MT20	4.0	4.0	2.25	2.00
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
F	BMV1+p	MT20	3.0	4.0		
G	BMVW-t	MT20	4.0	6.0		
H	BMVW1-t	MT20	4.0	4.0		

**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

SPF	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	DOWN	HORZ	UPLIFT
F	716	0	716	0
H	861	0	861	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

**UNFACTORED REACTIONS**

JT	1ST LCASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	511	310	0	0	0	0	202	0
H	612	383	0	0	0	0	229	0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH
FR-TO		FROM	TO		FR-TO		
A-B	0 / 40	-105.2	-105.2	0.14 (1)	10.00	C-G	-235 / 0
B-C	0 / 23	-105.2	-105.2	0.20 (1)	10.00	G-D	0 / 104
C-D	-465 / 0	-105.2	-105.2	0.15 (1)	6.25	H-C	-751 / 0
D-E	-442 / 0	-105.2	-105.2	0.30 (1)	6.25	G-E	0 / 417
H-B	-283 / 0	0.0	0.0	0.03 (1)	7.81		
F-E	-690 / 0	0.0	0.0	0.10 (1)	7.81		
H-G	0 / 536	-18.5	-18.5	0.24 (4)	10.00		
G-F	0 / 0	-18.5	-18.5	0.19 (4)	10.00		

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH.	LL = 26.7	PSF
	DL = 10.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 44.1	PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.39")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
ALLOWABLE DEFL.(TL) = L/360 (0.39")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.06")

CSI: TC=0.30/1.00 (D-E:1), BC=0.24/1.00 (G-H:4), WB=0.28/1.00 (C-H:1), SSI=0.16/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS=1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	
MT20	650	371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.60 (C) (INPUT = 0.90)  
JSI METAL= 0.23 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080090

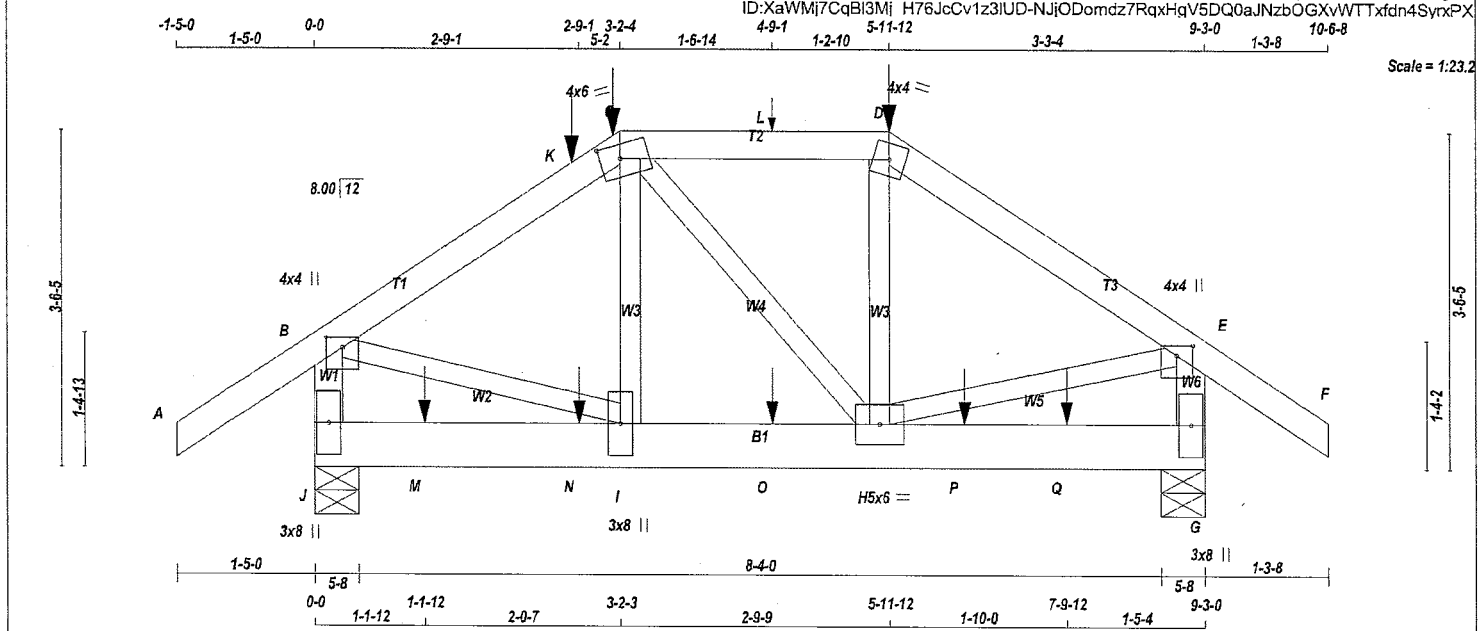

TOTAL WEIGHT = 47 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - D	2x4	DRY	No.2
D - F	2x4	DRY	No.2
J - B	2x4	DRY	No.2
G - E	2x4	DRY	No.2
J - G	2x6	DRY	No.2
ALL WEBS EXCEPT	2x3	DRY	No.2

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X	
B	TMVW+p	MT20	4.0	4.0	1.25	2.00
C	TTWW-m	MT20	4.0	6.0	1.75	2.50
D	TTW-m	MT20	4.0	4.0		
E	TMVW+p	MT20	4.0	4.0	1.25	2.00
G	BMV1+p	MT20	3.0	8.0		
H	BMWWW-t	MT20	5.0	6.0		
I	BMWW-t	MT20	3.0	8.0		
J	BMV1+p	MT20	3.0	8.0		

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
J	752	0	752	0	5-8	5-8
G	733	0	733	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
J	527	373 / 0	0 / 0	0 / 0	0 / 0	154 / 0	0 / 0
G	514	362 / 0	0 / 0	0 / 0	0 / 0	152 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) J, G

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 8.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (CSI (LC))	MEMB.	MAX. FORCE (LBS)	MAX. UNBRACED LENGTH	FACTORED VERT. LOAD (PLF)
FR-TO				FR-TO			
A-B	0 / 40	-95.2	-95.2 0.17 (1)	10.00	L-C	-76 / 23	0.02 (1)
B-K	-521 / 0	-95.2	-95.2 0.19 (1)	8.25	C-H	0 / 4	0.00 (4)
K-C	-521 / 0	-95.2	-95.2 0.19 (1)	8.25	H-D	-66 / 29	0.01 (1)
C-L	-433 / 0	-95.2	-95.2 0.14 (1)	6.25	B-I	0 / 455	0.11 (1)
L-D	-433 / 0	-95.2	-95.2 0.14 (1)	6.25	H-E	0 / 452	0.11 (1)
D-E	-526 / 0	-95.2	-95.2 0.20 (1)	6.25			
E-F	0 / 38	-95.2	-95.2 0.14 (1)	10.00			
J-B	-721 / 0	0.0	0.0 0.08 (1)	7.81			
G-E	-898 / 0	0.0	0.0 0.08 (1)	7.81			
J-M	0 / 0	-18.5	-18.5 0.03 (4)	10.00			
M-N	0 / 0	-18.5	-18.5 0.03 (4)	10.00			
N-I	0 / 0	-18.5	-18.5 0.03 (4)	10.00			
I-O	0 / 433	-18.5	-18.5 0.07 (1)	10.00			
O-H	0 / 433	-18.5	-18.5 0.07 (1)	10.00			
H-P	0 / 0	-18.5	-18.5 0.03 (4)	10.00			
P-Q	0 / 0	-18.5	-18.5 0.03 (4)	10.00			
Q-G	0 / 0	-18.5	-18.5 0.03 (4)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-2-4	-9	-39	-	FRONT	VERT	DEAD	-	C1
C	3-2-4	-39	-39	-	FRONT	VERT	SNOW	-	C1
D	5-11-12	-9	-9	-	FRONT	VERT	DEAD	-	C1
D	5-11-12	-39	-39	-	FRONT	VERT	SNOW	-	C1
K	2-9-1	-11	-11	-	FRONT	VERT	TOTAL	-	C1
L	4-9-1	1	1	-	FRONT	VERT	TOTAL	-	C1
M	1-1-12	-1	-1	-	FRONT	VERT	TOTAL	-	C1
N	2-9-1	-1	-1	-	FRONT	VERT	TOTAL	-	C1
O	4-9-1	-1	-1	-	FRONT	VERT	TOTAL	-	C1
P	6-9-1	-1	-1	-	FRONT	VERT	TOTAL	-	C1
Q	7-9-12	-1	-1	-	FRONT	VERT	TOTAL	-	C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
 LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
 ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF CBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.31")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
 ALLOWABLE DEFL.(TL) = L/360 (0.31")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.20/1.00 (D-E:1), BC=0.07/1.00 (H-I:1), WB=0.11/1.00 (B-I:1), SS=0.12/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00


TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
650	371	1747
788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches



PLATE ROTATION TOL. = 5.0 Deg.  
 JSI GRIP= 0.60 (I) (INPUT = 0.90)  
 JSI METAL= 0.26 (I) (INPUT = 1.00)

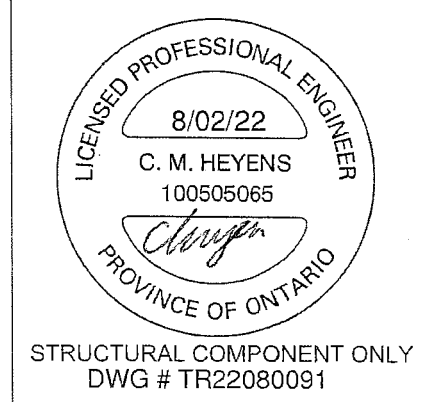

STRUCTURAL COMPONENT ONLY  
 DWG # TR22080091

JOB NAME 427429	TRUSS NAME T31	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:13 2022 Page 1  
 ID:In5Rk6OlePz2poAsdGW0KMz Rum-rVHmQ8nFkRzYRfhfxF6Ww8soTJet(dAJMLduyrxPW

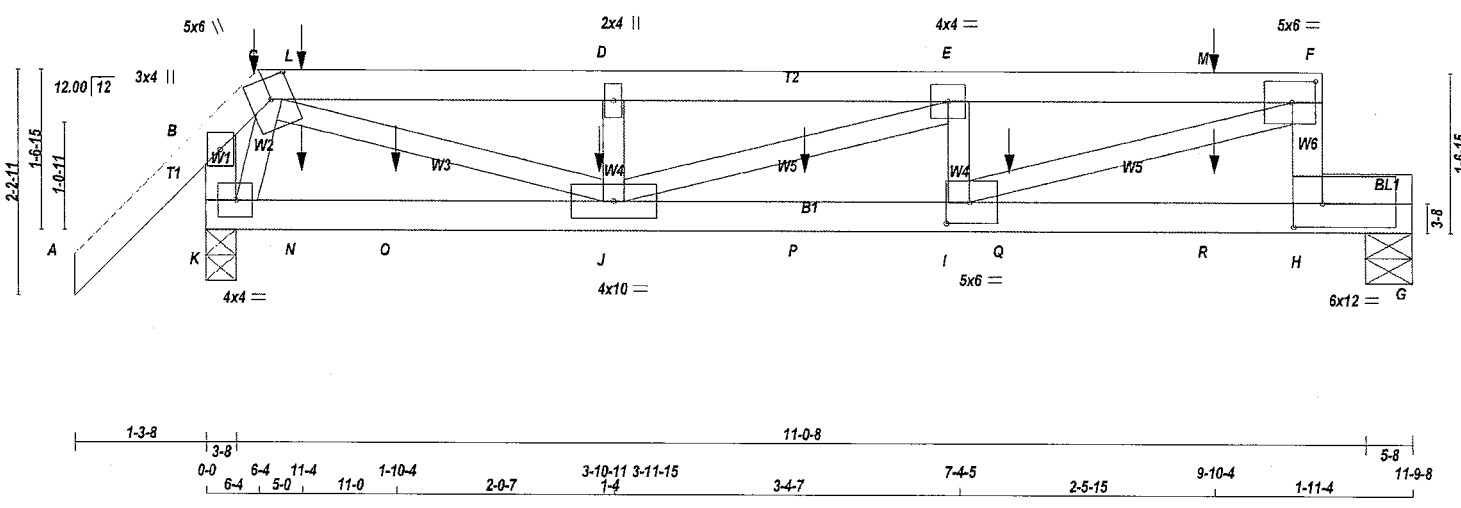

TOTAL WEIGHT = 42 lb

**LUMBER**  
 N. L. G. A. RULES  
 CHORDS SIZE LUMBER DESCR.  
 A - C 2x4 DRY No.2 SPF  
 C - F 2x4 DRY No.2 SPF  
 H - F 2x4 DRY No.2 SPF  
 K - B 2x4 DRY No.2 SPF  
 K - G 2x4 DRY 2100F 1.8E SPF

**BEARING BLOCKS**  
 BL1 2x4 DRY No.2 SPF  
**ALL WEBS** 2x3 DRY No.2 SPF  
 DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
C	TTWW+m	MT20	5.0	6.0	2.50 2.50
D	TMW+w	MT20	2.0	4.0	
E	TMWW-t	MT20	4.0	4.0	
F	TMVW-t	MT20	5.0	6.0	2.50 2.75
H	BMVKm	MT20	6.0	12.0	2.75 3.50
I	BMVW-t	MT20	5.0	6.0	2.50 2.75
J	BMVWW-t	MT20	4.0	10.0	
K	BMVW-t	MT20	4.0	4.0	

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED		MAXIMUM FACTORED		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
K	917	0	917	0	3-8	3-8
G	728	0	728	0	5-8	5-8

**UNFACTORED REACTIONS**

JT	1ST LCASE						MAX./MIN. COMPONENT REACTIONS							
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	642	458/0	0/0	0/0	0/0	184/0	0/0							
G	512	350/0	0/0	0/0	0/0	162/0	0/0							

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) K, G

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 4.81 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 6.25 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (4)

C H O R D S				W E B S			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	CS I (LC)
FR-TO				FR-TO			
A-B	0/47	-95.2	0.15 (1)	10.00	I-F	0/1926	0.48 (1)
B-C	-113/0	-95.2	0.14 (1)	6.25	I-E	-267/0	0.04 (1)
C-L	-1509/0	-95.2	0.20 (1)	5.11	J-D	-353/0	0.06 (1)
L-D	-1509/0	-95.2	0.20 (1)	5.11	J-E	-225/0	0.06 (1)
D-E	-1509/0	-95.2	0.16 (1)	5.16	K-C	-581/0	0.09 (1)
E-M	-1719/0	-95.2	0.23 (1)	4.81	C-J	0/1357	0.34 (1)
M-F	-1719/0	-95.2	0.23 (1)	4.81			
H-F	-813/0	0.0	0.09 (1)	7.81			
K-B	-320/0	0.0	0.04 (1)	7.81			
K-N	0/239	-18.5	-18.5	0.10 (1)	10.00		
N-O	0/239	-18.5	-18.5	0.10 (1)	10.00		
O-J	0/239	-18.5	-18.5	0.10 (1)	10.00		
J-P	0/1719	-18.5	-18.5	0.29 (1)	10.00		
P-I	0/1719	-18.5	-18.5	0.29 (1)	10.00		
I-Q	-92/0	-18.5	-18.5	0.68 (1)	6.25		
Q-R	-92/0	-18.5	-18.5	0.68 (1)	6.25		
R-H	-92/0	-18.5	-18.5	0.68 (1)	6.25		
H-G	0/0	-113.7	-113.7	0.28 (1)	10.00		

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	7-0	-2	-2		FRONT	VERT	DEAD		C1
C	7-0	-7	-7		FRONT	VERT	SNOW		C1
J	3-10-4	-12	-12		BACK	VERT	TOTAL		C1
L	11-4	-25	-25		BACK	VERT	TOTAL		C1
M	9-10-4	-4	-4		BACK	VERT	TOTAL		C1
N	11-4	-12	-12		BACK	VERT	TOTAL		C1
O	1-10-4	-12	-12		BACK	VERT	TOTAL		C1
P	5-10-4	-12	-12		BACK	VERT	TOTAL		C1
Q	7-10-4	-12	-12		BACK	VERT	TOTAL		C1
R	9-10-4	-12	-12		BACK	VERT	TOTAL		C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
 LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
 ADD'L USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF CBC 2018 , ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

**DESIGN ASSUMPTIONS**  
 -OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.12")  
 ALLOWABLE DEFL.(TL)= L/360 (0.39")  
 CALCULATED VERT. DEFL.(TL) = L/626 (0.23")

CSI: TC=0.23/1.00 (E-F:1), BC=0.68/1.00 (H-I:1), WB=0.48/1.00 (F-I:1), SSI=0.31/1.00 (G-H:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN	MAX MIN
MT20	650	371	1747	788	1987	1873



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080092 PG 1/2



JOB NAME 427429	TRUSS NAME T31	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	


Version 8.530 S Feb 23 2022 MITek Industries, inc. Tue Aug 2 09:48:13 2022 Page 2  
ID:in5Rk6OlePz2poAsdGW0KMz Rum-rVhmQ8nFkRZhYRFhfxF6Ww8soTJet1dAJMLduyxpW

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.  
JSI GRIP= 0.87 (C) (INPUT = 0.90 )  
JSI METAL= 0.41 (I) (INPUT = 1.00 )



JOB NAME 427429	TRUSS NAME T32	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:14 2022 Page 1  
 ID: XaWMij7CqBl3Mj H76JcV1z3lUD-Jhr8eUotViiYAbqtDeSUfKtJsCvGNREmPz6u9KyrxPV



Scale = 1:22.6

TOTAL WEIGHT = 30 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
D - F	2x4 DRY	No.2	SPF
B - E	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF
DRY: SEASONED LUMBER.			

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-l MT20	3.0	4.0		
C	TTWW-m MT20	4.0	6.0	1.75	2.25
D	TTWW-m MT20	4.0	4.0		
E	TMB1-l MT20	3.0	4.0		
G	BMWW-t MT20	4.0	4.0		
H	BMW+w MT20	2.0	4.0		

**NOTES - (1)**  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
B	889	0	889	0	3-8	3-8
E	892	0	892	0	3-8	3-8

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	626	428 / 0	0 / 0	0 / 0	0 / 0	198 / 0	0 / 0
E	628	428 / 0	0 / 0	0 / 0	0 / 0	200 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, E

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.57 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH	CS1 (LC)
FR-TO		FROM TO			FR-TO			
A-B	0 / 27	-95.2 -95.2	0.14 (1)	10.00	H-C	0 / 121	0.03 (4)	10.00
B-J	-1186 / 0	-95.2 -95.2	0.08 (1)	5.76	C-G	0 / 5	0.00 (4)	10.00
J-C	-1194 / 0	-95.2 -95.2	0.21 (1)	5.57	G-D	0 / 115	0.03 (4)	10.00
C-D	-1070 / 0	-95.2 -95.2	0.06 (1)	6.02	I-J	-195 / 21	0.00 (1)	10.00
D-L	-1197 / 0	-95.2 -95.2	0.21 (1)	5.57	K-L	-183 / 27	0.00 (1)	10.00
L-E	-1193 / 0	-95.2 -95.2	0.09 (1)	5.74				
E-F	0 / 27	-95.2 -95.2	0.14 (1)	10.00				
B-I	0 / 1062	-18.5 -18.5	0.31 (1)	10.00				
I-M	0 / 1062	-18.5 -18.5	0.31 (1)	10.00				
M-H	0 / 1062	-18.5 -18.5	0.31 (1)	10.00				
H-G	0 / 1089	-18.5 -18.5	0.24 (1)	10.00				
G-N	0 / 1064	-18.5 -18.5	0.30 (1)	10.00				
N-K	0 / 1064	-18.5 -18.5	0.30 (1)	10.00				
K-E	0 / 1064	-18.5 -18.5	0.30 (1)	10.00				

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	3-10-8	-129	-129	---	FRONT	VERT	TOTAL	---	C1
D	5-4-12	-137	-137	---	FRONT	VERT	TOTAL	---	C1
G	5-3-12	-30	-30	---	FRONT	VERT	TOTAL	---	C1
H	3-11-4	-30	-30	---	FRONT	VERT	TOTAL	---	C1
M	1-11-4	-3	-3	---	FRONT	VERT	TOTAL	---	C1
N	7-3-12	-3	-3	---	FRONT	VERT	TOTAL	---	C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.31")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")  
ALLOWABLE DEFL.(TL)= L/360 (0.31")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.21/1.00 (C-J-1), BC=0.31/1.00 (H-I-1),  
WB=0.03/1.00 (C-H-4), SSI=0.18/1.00 (B-I-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION  
(PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.89 (E) (INPUT = 0.90)  
JSI METAL= 0.37 (E) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080093

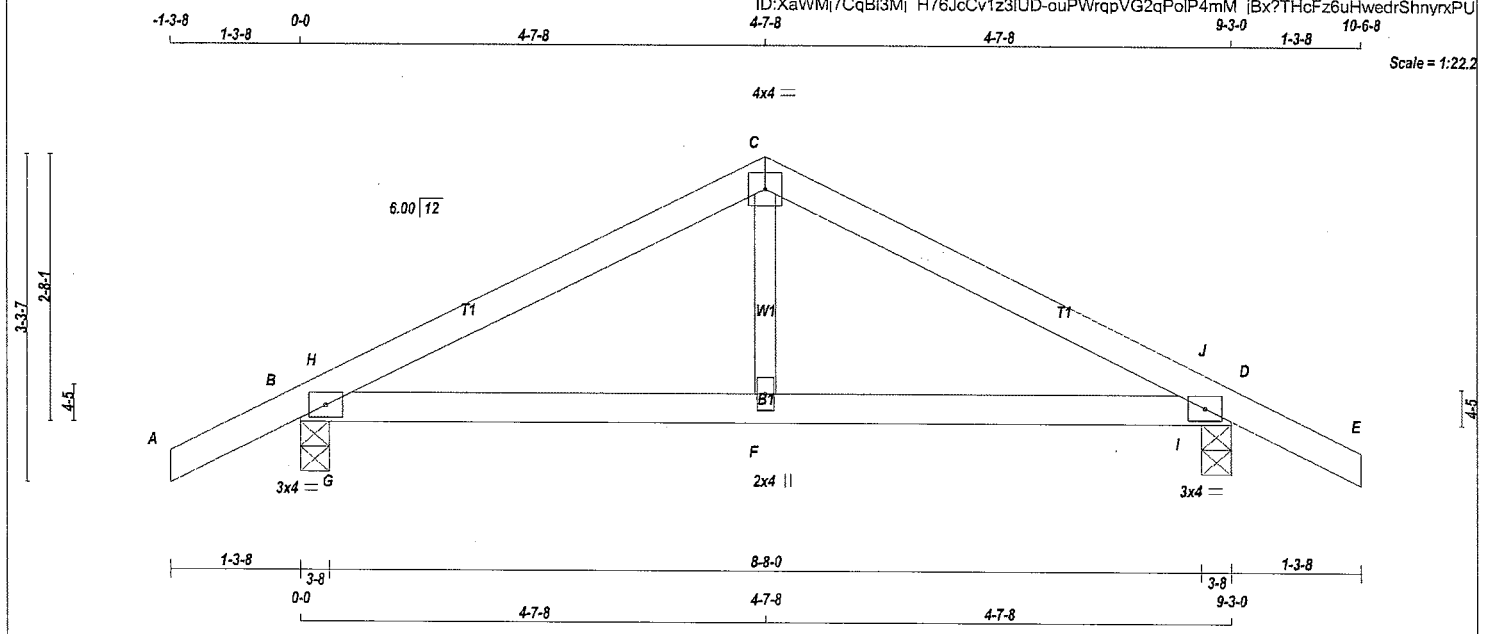

TOTAL WEIGHT = 28 lb [M][F]

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
B - D	2x4 DRY	No.2	SPF
ALL WEBS	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	
C	TTW-p	MT20	4.0	4.0	
D	TMB1-I	MT20	3.0	4.0	
F	BMW+w	MT20	2.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
B	655	0	655	0	3-8	3-8
D	655	0	655	0	3-8	3-8

**UNFACTORED REACTIONS**

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS						
		1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
B	460	320/0	0/0	0/0	0/0	0/0	140/0	0/0
D	460	320/0	0/0	0/0	0/0	0/0	140/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	MAX. UNBRAC LENGTH
FR-TO					FR-TO			
A-B	0/27	-95.2	-95.2	0.12 (1)	10.00	F-C	0/197	0.04 (1)
B-H	-552/0	-95.2	-95.2	0.09 (1)	6.25	G-H	-375/0	0.00 (1)
H-C	-637/0	-95.2	-95.2	0.23 (1)	6.25	I-J	-375/0	0.00 (1)
C-J	-637/0	-95.2	-95.2	0.23 (1)	6.25			
J-D	-552/0	-95.2	-95.2	0.09 (1)	6.25			
D-E	0/27	-95.2	-95.2	0.12 (1)	10.00			
B-G	0/562	-18.5	-18.5	0.28 (1)	10.00			
G-F	0/562	-18.5	-18.5	0.28 (1)	10.00			
F-I	0/562	-18.5	-18.5	0.28 (1)	10.00			
I-D	0/562	-18.5	-18.5	0.28 (1)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.31")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")  
ALLOWABLE DEFL.(TL)= L/360 (0.31")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.23/1.00 (C-J:1), BC=0.28/1.00 (D-I:1), WB=0.04/1.00 (C-F:1), SSI=0.28/1.00 (D-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.59 (B) (INPUT = 0.90)  
JSI METAL= 0.22 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY  
DWG # TR22080094

JOB NAME 427451	TRUSS NAME T34	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 10:23:22 2022 Page 1  
ID: Eiaeo5ja? p88EwQscch? tz3O5z-bED23HJ93RHS4Y 0iMHq5GmaSyOMHI628xiR89yrwuz

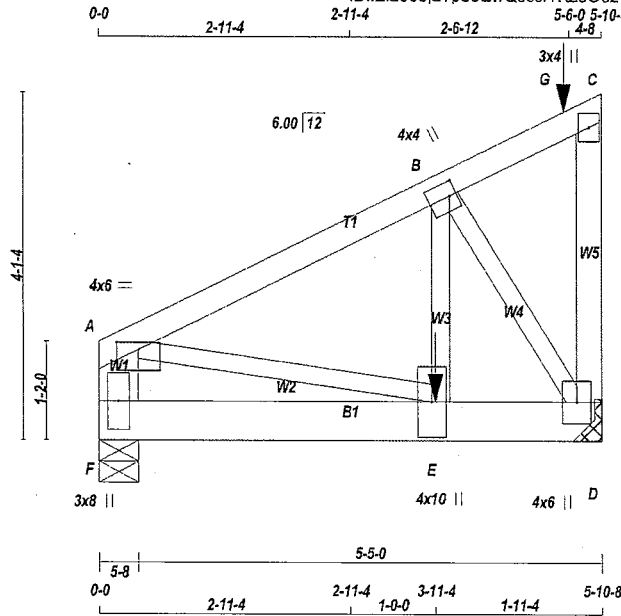

TOTAL WEIGHT = 2 X 30 = 60 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
F - A	2x6	DRY No.2	SPF
F - D	2x6	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A - C 1	12	SIDE(61.0)
C - D 1	12	SIDE(52.8)
F - A 2	12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
F - D 2	12	SIDE(183.1)
WEBS : (0.122"x3") SPIRAL NAILS		
B - E 1	2	SIDE(529.8)
2x3 1	6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

SIDE - PLF SHOWN IS THE EQUIVALENT UDL APPLIED TO ONE SIDE THAT THE CORRESPONDING NAILING PATTERN SHALL BE CAPABLE OF TRANSFERING REMAINING PLF MUST BE APPLIED ON THE OPPOSITE SIDE OR ON THE TOP.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT VERT	DOWN	MECHANICAL	5-8
D 2603	0		
F 1234	0		

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

**UNFACTORED REACTIONS**

1ST LCASE	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	1822	1300 / 0	0 / 0	0 / 0	0 / 0	522 / 0	0 / 0
F	867	601 / 0	0 / 0	0 / 0	0 / 0	266 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX+ CSI (LC)	MEMB. MAX. FORCE (LBS)	MAX. FACTORED UNBRAC LENGTH	FR-TO	MAX CSI (LC)
FR-TO		FROM TO						
A-B	-1555 / 0	-95.2	-95.2	0.11 (1)	6.25	E-B	0 / 2311	0.29 (1)
B-G	0 / 28	-95.2	-95.2	0.10 (1)	6.25	B-D	-2508 / 0	0.27 (1)
G-C	0 / 28	-95.2	-95.2	0.10 (1)	6.25	A-E	0 / 1430	0.18 (1)
D-C	-369 / 0	0.0	0.0	0.05 (1)	7.81			
F-A	-1132 / 0	0.0	0.0	0.04 (1)	7.81			
F-E	0 / 0	-18.5	-18.5	0.10 (1)	10.00			
E-D	0 / 1404	-18.5	-18.5	0.19 (1)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
E	3-11-4	-1918	-1918	---	BACK	VERT	TOTAL	---	C1
G	5-6-0	-300	-300	---	FRONT	VERT	TOTAL	---	C1

**CONNECTION REQUIREMENTS**  
1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
ALLOWABLE DEFL.(TL)= L/360 (0.20")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.11/1.00 (A-B:1), BC=0.19/1.00 (D-E:1), WB=0.29/1.00 (B-E:1), SSI=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (B) (INPUT = 0.90)  
JSI METAL= 0.48 (E) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080099 PG 1/2

CONTINUED ON PAGE 2

JOB NAME 427451	TRUSS NAME T34	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:23:22 2022 Page 2  
ID:EIaeo5ja?p88EwQscch?tz3O5z-bED23HJ93RHS4Y\_0iMHq5GmaSyOMHI628xiR89yrwuZ

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	6.0	1.00	3.00
B	TMVW+t	MT20	4.0	4.0	2.00	1.00
C	TMV+p	MT20	3.0	4.0		
D	BMVW1+p	MT20	4.0	6.0		
E	BMVW+t	MT20	4.0	10.0		
F	BMV1+p	MT20	3.0	8.0		

**NOTES- (1)**


1) Lateral braces to be a minimum of 2X4 SPF #2.



STRUCTURAL COMPONENT ONLY  
DWG # TR22080099 PG 2/2

JOB NAME 427451	TRUSS NAME T35	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington ID: Eiaeo5ja? p88EwQscch? tz3O5z-bED23HJ93RHS4Y 0iMHq5GmQTYiLHgo28xiR89yrwuz Version 8.630 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:23:22 2022 Page 1

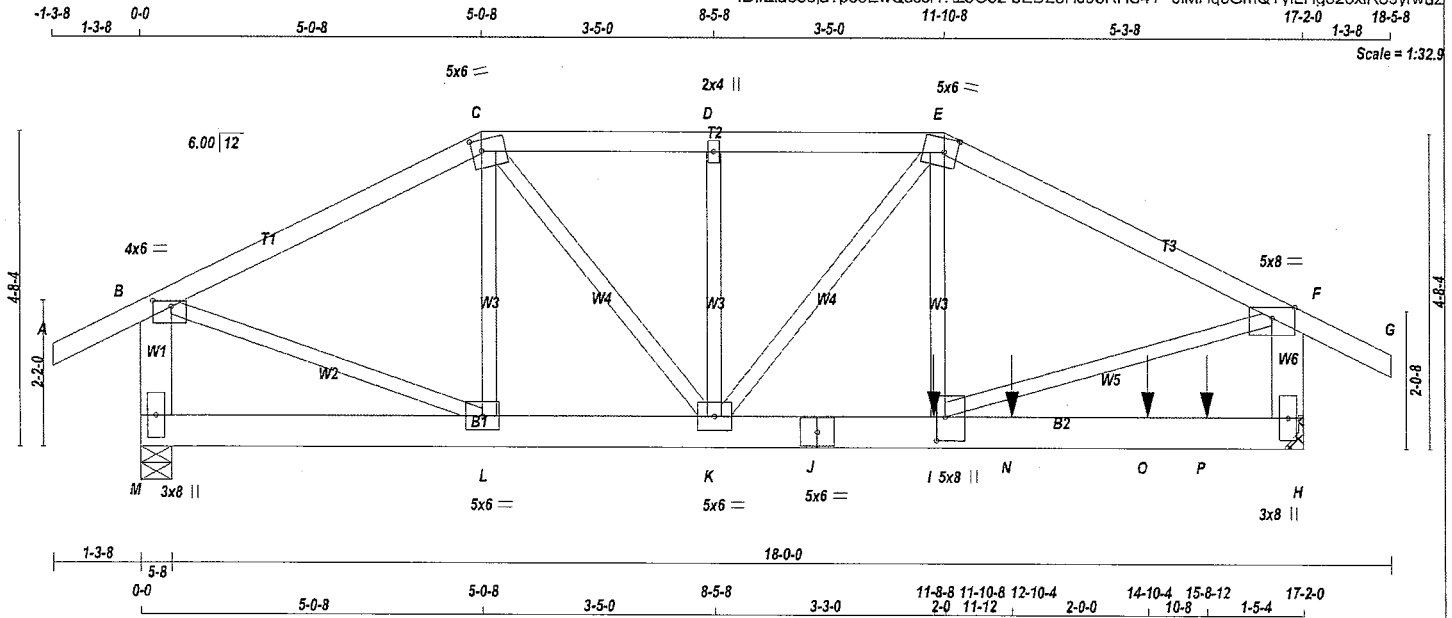

TOTAL WEIGHT = 87 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - E	2x4 DRY	No.2	SPF
E - G	2x4 DRY	No.2	SPF
M - B	2x6 DRY	No.2	SPF
H - F	2x6 DRY	No.2	SPF
M - J	2x6 DRY	No.2	SPF
J - H	2x6 DRY	No.2	SPF
ALL WEBS EXCEPT	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-p	MT20	4.0	6.0	1.00	3.25
C	TTWW-m	MT20	5.0	6.0	2.00	1.75
D	TMW+w	MT20	2.0	4.0		
E	TTWW-m	MT20	5.0	6.0	2.50	2.25
F	TMVW-p	MT20	5.0	8.0	Edge	
H	BMV1+p	MT20	3.0	8.0		
J	BMVW+t	MT20	5.0	8.0	4.25	1.50
K	BS-t	MT20	5.0	6.0		
L	BMVW-w	MT20	5.0	6.0		
M	BMV1+p	MT20	3.0	8.0		

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

NOTES- (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
M	1663 0	1663 0	5-8	5-8
H	2751 0	2751 0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT H. MINIMUM BEARING LENGTH AT JOINT H = 3-8.

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX /MIN SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
M	1168	808 / 0	0 / 0	0 / 0	0 / 0	361 / 0	0 / 0
H	1933	1342 / 0	0 / 0	0 / 0	0 / 0	590 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) M

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 3.36 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS			WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH (LC)	MEMB.	
A-B	0 / 29	-95.2	-95.2 0.14 (1)	10.00	L-C	-381 / 0	0.12 (1)
B-C	-1657 / 0	-95.2	-95.2 0.55 (1)	4.43	I-E	0 / 1313	0.33 (1)
C-D	-2069 / 0	-95.2	-95.2 0.25 (1)	4.44	B-L	0 / 1567	0.39 (1)
D-E	-2069 / 0	-95.2	-95.2 0.25 (1)	4.44	I-F	0 / 2531	0.63 (1)
E-F	-2708 / 0	-95.2	-95.2 0.75 (1)	3.36	K-D	-386 / 0	0.12 (1)
F-G	0 / 29	-95.2	-95.2 0.14 (1)	10.00	K-E	-616 / 0	0.30 (1)
M-B	-1623 / 0	0.0	0.0 0.13 (1)	7.69	C-K	0 / 960	0.24 (1)
H-F	-2335 / 0	0.0	0.0 0.18 (1)	6.68			
M-L	0 / 0	-18.5	-18.5 0.05 (4)	10.00			
L-K	0 / 1472	-18.5	-18.5 0.27 (1)	10.00			
K-J	0 / 2452	-18.5	-18.5 0.57 (1)	10.00			
J-I	0 / 2452	-18.5	-18.5 0.57 (1)	10.00			
I-N	0 / 0	-18.5	-18.5 0.49 (1)	10.00			
N-O	0 / 0	-18.5	-18.5 0.49 (1)	10.00			
O-P	0 / 0	-18.5	-18.5 0.49 (1)	10.00			
P-H	0 / 0	-18.5	-18.5 0.49 (1)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
I	11-8-8	-945	-945	---	FRONT	VERT	TOTAL	---	C1
N	12-10-4	-197	-197	---	FRONT	VERT	TOTAL	---	C1
O	14-10-4	-202	-202	---	FRONT	VERT	TOTAL	---	C1
P	15-8-12	-201	-201	---	FRONT	VERT	TOTAL	---	C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(5% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.57")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.08")  
ALLOWABLE DEFL.(TL)= L/360 (0.57")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.14")

CSI: TC=0.75/1.00 (E-F:1), BC=0.57/1.00 (H-K:1), WB=0.63/1.00 (F-I:1), SS=0.36/1.00 (H-I:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
COMP=1.00 SHEAR=1.00 TENS=1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE HEELS OFF

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR	SECTION
(PSI)	(PLI)	(PLI)	(PLI)
MAX MIN	MAX MIN	MAX MIN	MAX MIN
MT20	650 371	1747 788	1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.90 (I) (INPUT = 0.90 )  
JSI METAL= 0.88 (I) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080100

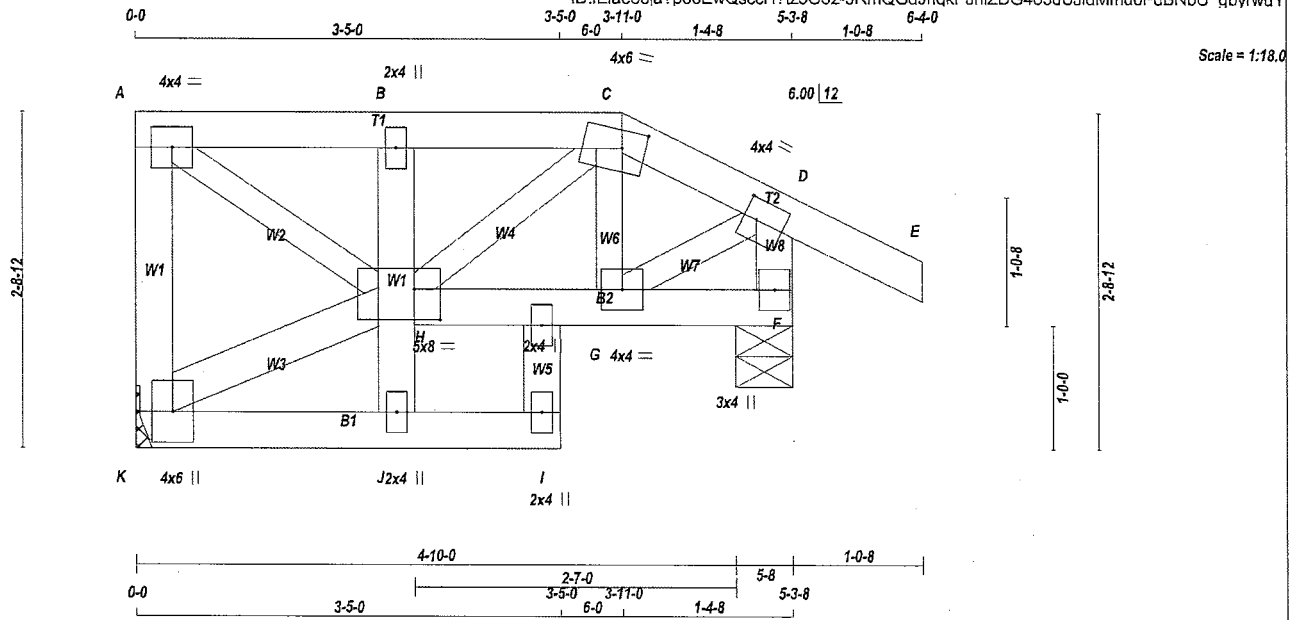

TOTAL WEIGHT = 29 lb

**LUMBER** N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. **DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER** **DESIGN CRITERIA**

CHORDS	SIZE	LUMBER	DESCR.
K - A	2x4	DRY	No.2 SPF
A - C	2x4	DRY	No.2 SPF
C - E	2x4	DRY	No.2 SPF
F - D	2x4	DRY	No.2 SPF
K - I	2x4	DRY	No.2 SPF
H - F	2x4	DRY	No.2 SPF
ALL WEBS EXCEPT	2x4	DRY	No.2 SPF
A - H	2x3	DRY	No.2 SPF
G - C	2x3	DRY	No.2 SPF
G - D	2x3	DRY	No.2 SPF
H - C	2x3	DRY	No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0	
B	TMW+w	MT20	2.0	4.0	
C	TTWW-m	MT20	4.0	6.0	1.75 2.25
D	TMVW-t	MT20	4.0	4.0	2.00 1.25
F	BMV1+p	MT20	3.0	4.0	
G	BMWW-t	MT20	4.0	4.0	
H	BVMWWW-t	MT20	5.0	8.0	3.00 2.50
I	NP+w	MT20	2.0	4.0	
J	BMW+w	MT20	2.0	4.0	
K	BMVW1+p	MT20	4.0	6.0	
L	NP+w	MT20	2.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**BEARINGS**

JT	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX
K	304	0	304	0	0	MECHANICAL	
F	427	0	427	0	0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K. MINIMUM BEARING LENGTH AT JOINT K = 1-8.

**UNFACTORED REACTIONS**

JT	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K	216	135 / 0	0 / 0	0 / 0	0 / 0	81 / 0	0 / 0
F	300	207 / 0	0 / 0	0 / 0	0 / 0	93 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
MAX. UNBRACED INTERIOR CHORD LENGTH = 7.81 FT  
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED	FACTORED	VERT. LOAD	LC1 MAX	MAX. UNBRAC	MEMB. FORCE	MAX. FACTORED	MAX. FACTORED
FR-TO					LENGTH	FR-TO		
K-A	-277 / 0	0.0	0.0	0.04 (1)	7.81	J-H	0 / 49	0.03 (1)
A-B	-286 / 0	-95.2	-95.2	0.05 (1)	6.25	H-B	-219 / 0	0.02 (1)
B-C	-292 / 0	-95.2	-95.2	0.05 (1)	6.25	K-H	-18 / 0	0.00 (1)
C-D	-244 / 0	-95.2	-95.2	0.08 (1)	6.25	A-H	0 / 344	0.08 (1)
D-E	0 / 24	-95.2	-95.2	0.08 (1)	10.00	G-C	-68 / 0	0.01 (1)
F-D	-414 / 0	0.0	0.0	0.04 (1)	7.81	G-D	0 / 224	0.05 (1)
						H-C	0 / 123	0.03 (1)
K-J	0 / 16	-18.5	-18.5	0.03 (4)	10.00			
J-I	0 / 0	-18.5	-18.5	0.04 (4)	10.00			
H-G	0 / 196	-18.5	-18.5	0.04 (1)	10.00			
G-F	0 / 0	-18.5	-18.5	0.01 (4)	10.00			

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 240 IN./C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**  
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL)= L/ 999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL)= L/ 999 (0.01")

CSI: TC=0.08/1.00 (D-E:1) , BC=0.04/1.00 (G-H:1) , WB=0.08/1.00 (A-H:1) , SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
	MAX	MIN	MAX
MT20	650	371	1747
			788
			1987
			1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.33 (A) (INPUT = 0.90 )  
JSI METAL= 0.11 (D) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080101

JOB NAME 427451	TRUSS NAME T37	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

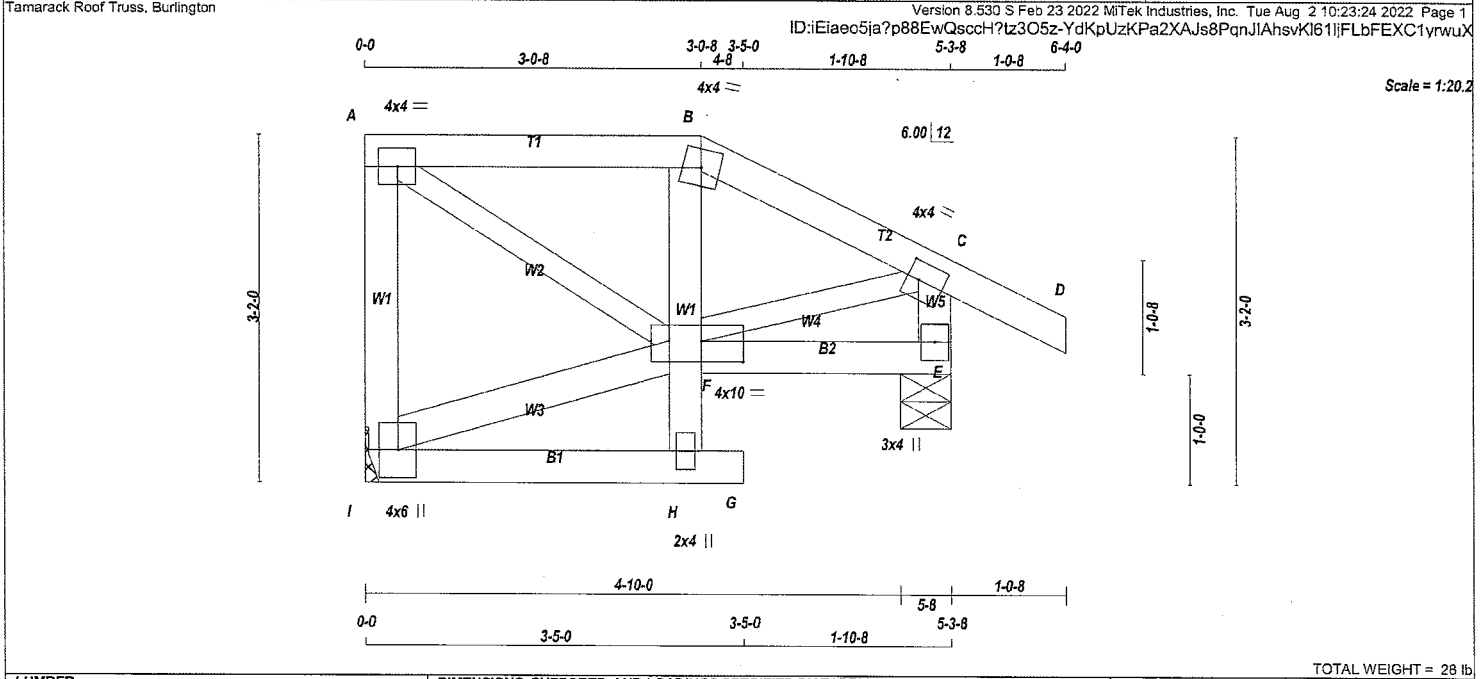

TOTAL WEIGHT = 28 lb [M]

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
I - A	2x4 DRY	No.2	SPF
A - B	2x4 DRY	No.2	SPF
B - D	2x4 DRY	No.2	SPF
E - C	2x4 DRY	No.2	SPF
I - G	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
ALL WEBS EXCEPT	2x4 DRY	No.2	SPF
A - F	2x3 DRY	No.2	SPF
F - C	2x3 DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0		
B	TTW-m	MT20	4.0	4.0		
C	TMVW-t	MT20	4.0	4.0	2.00	1.25
E	BMV1+p	MT20	3.0	4.0		
F	BMWVW*-i	MT20	4.0	10.0	2.25	4.50
H	BMV+w	MT20	2.0	4.0		
I	BMVW1+p	MT20	4.0	6.0		

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
I	306	0	306	0	MECHANICAL	
E	412	0	412	0	5-8	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT I. MINIMUM BEARING LENGTH AT JOINT I = 1-8.

**UNFACTORED REACTIONS**

JT	COMBINED	1ST LCASE MAX / MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
I	216	141 / 0	0 / 0	0 / 0	0 / 0	75 / 0	0 / 0
E	290	201 / 0	0 / 0	0 / 0	0 / 0	89 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
MAX. UNBRACED INTERIOR CHORD LENGTH = 7.81 FT

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. GROSS REACT. (LC)	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. GROSS REACT. (LC)	MAX. UNBRACED LENGTH
FR-TO		FROM	TO		FR-TO			
I-A	-276 / 0	0.0	0.0	0.05 (1)	7.81	H-F	0 / 41	0.02 (1)
A-B	-200 / 0	-95.2	-95.2	0.15 (1)	6.25	F-B	-143 / 0	0.01 (1)
B-C	-247 / 0	-95.2	-95.2	0.08 (1)	6.25	I-F	-7 / 0	0.00 (1)
C-D	0 / 24	-95.2	-95.2	0.08 (1)	10.00	A-F	0 / 239	0.05 (1)
E-C	-389 / 0	0.0	0.0	0.04 (1)	7.81	F-C	0 / 230	0.05 (1)
I-H	0 / 7	-18.5	-18.5	0.05 (4)	10.00			
H-G	0 / 0	-18.5	-18.5	0.01 (4)	10.00			
F-E	0 / 0	-18.5	-18.5	0.03 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF CBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.15/1.00 (A-B:1), BC=0.05/1.00 (H-I:4), WB=0.05/1.00 (A-F:1), SSI=0.11/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.  
JSI GRIP= 0.37 (C) (INPUT = 0.90)  
JSI METAL= 0.12 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080102



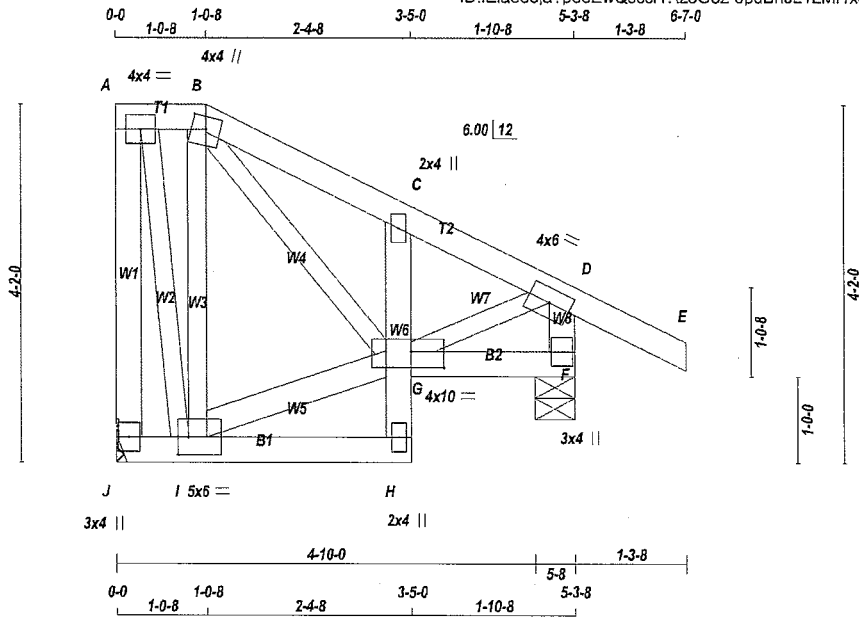

TOTAL WEIGHT = 35 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
J - A	2x4	DRY No.2	SPF
A - B	2x4	DRY No.2	SPF
B - E	2x4	DRY No.2	SPF
F - D	2x4	DRY No.2	SPF
J - H	2x4	DRY No.2	SPF
G - F	2x4	DRY No.2	SPF
ALL WEBS EXCEPT			
A - I	2x3	DRY No.2	SPF
I - B	2x3	DRY No.2	SPF
G - D	2x3	DRY No.2	SPF
B - G	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
A	TMVW-t	MT20	4.0	4.0	
B	TTWW+m	MT20	4.0	4.0	1.75 2.00
C	TMW+w	MT20	2.0	4.0	
D	TMVW-t	MT20	4.0	6.0	
F	BMV1+p	MT20	3.0	4.0	
G	BWMWVW*-I	MT20	4.0	10.0	2.25 4.50
H	BMW+w	MT20	2.0	4.0	
I	BWMWVW-t	MT20	5.0	6.0	2.50 1.50
J	BMV1+p	MT20	3.0	4.0	

**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG DOWN	REQRD BRG UPLIFT
JT	VERT 300	HORZ 0	0	0
F	VERT 429	HORZ 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT J. MINIMUM BEARING LENGTH AT JOINT J = 1-8.

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
JT	212	141 / 0	0 / 0	0 / 0	0 / 0	71 / 0	0 / 0
F	301	214 / 0	0 / 0	0 / 0	0 / 0	87 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

MAX. UNBRACED INTERIOR CHORD LENGTH = 7.81 FT

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX (LC)	UNBRAC LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM	TO		FR-TO			
J-A	-289 / 0	0.0	0.0	0.08 (1)	7.81	H-G	0 / 25	
A-B	-51 / 0	-95.2	-95.2	0.02 (1)	6.25	G-C	-237 / 0	
B-C	-265 / 0	-95.2	-95.2	0.06 (1)	6.25	A-I	0 / 245	
C-D	-259 / 0	-95.2	-95.2	0.06 (1)	6.25	I-B	-232 / 0	
D-E	0 / 29	-95.2	-95.2	0.12 (1)	10.00	G-D	0 / 257	
F-D	-411 / 0	0.0	0.0	0.04 (1)	7.81	I-G	0 / 47	
						B-G	0 / 265	
J-I	0 / 0	-18.5	-18.5	0.01 (4)	10.00			
I-H	0 / 20	-18.5	-18.5	0.03 (4)	10.00			
G-F	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH.	LL = 26.7	PSF
	DL = 6.0	PSF
BOT CH.	LL = 0.0	PSF
	DL = 7.4	PSF
TOTAL LOAD	= 40.1	PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF CBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(5% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
 ALLOWABLE DEFL.(TL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12/1.00 (D-E-1), BC=0.03/1.00 (H-I-4), WB=0.06/1.00 (B-I-1), SSI=0.09/1.00 (D-E-1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR	SECTION
	(PSI)	(PLI)	(PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.43 (B) (INPUT = 0.90)  
 JSI METAL= 0.09 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080103

JOB NAME 427451	TRUSS NAME T39	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:23:26 2022 Page 1

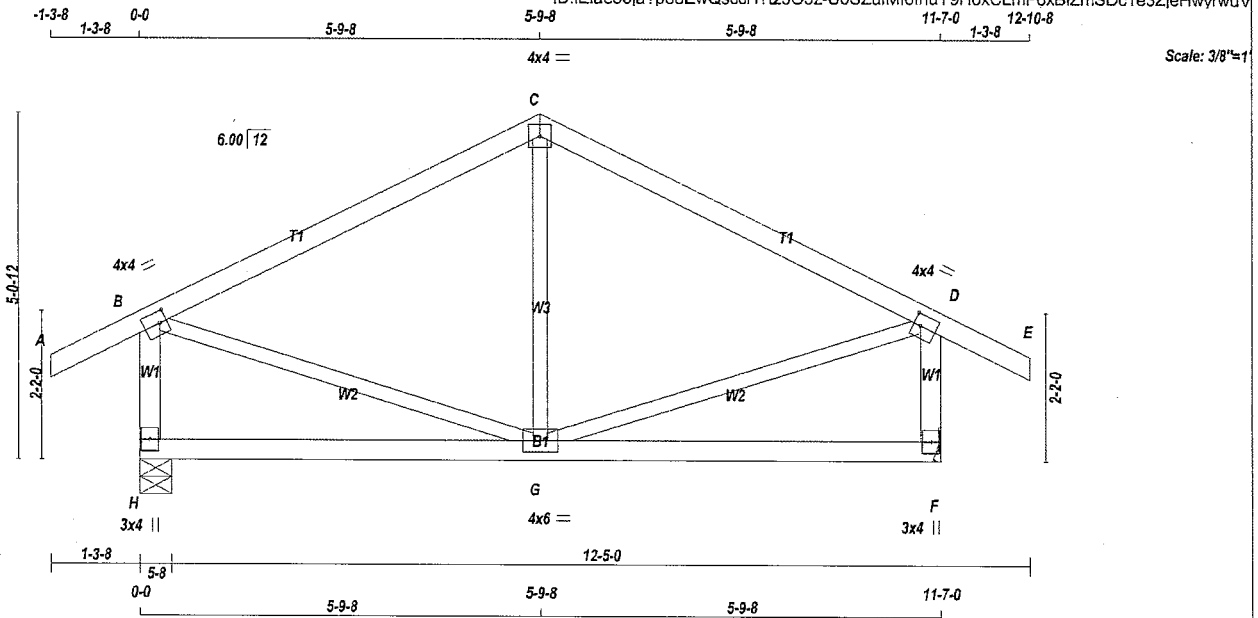

TOTAL WEIGHT = 2 X 48 = 97 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY	No.2
C - E	2x4	DRY	No.2
H - B	2x4	DRY	No.2
F - D	2x4	DRY	No.2
H - F	2x4	DRY	No.2

ALL WEBS 2x3 DRY No.2 SPF  
EXCEPT  
DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTW-p	MT20	4.0	4.0		
D	TMVW-t	MT20	4.0	4.0	2.00	1.25
F	BMV1+p	MT20	3.0	4.0		
G	BMVWV-t	MT20	4.0	6.0		
H	BMV1+p	MT20	3.0	4.0		

NOTES- (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
H	788	0	788	0	5-8	5-8
F	788	0	788	0	MECHANICAL	

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT F. MINIMUM BEARING LENGTH AT JOINT F = 1-8.

**UNFACTORED REACTIONS**

JT	1ST LCASE MAX./MIN. COMPONENT REACTIONS						
	COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
H	554	382/0	0/0	0/0	0/0	171/0	0/0
F	554	382/0	0/0	0/0	0/0	171/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) H

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. UNBRACED LENGTH	MAX. FACTORED CSI (LC)
FR-TO		FROM TO			FR-TO			
A-B	0 / 29	-95.2 -95.2	0.12 (1)	10.00	G-C	-135 / 53		0.05 (1)
B-C	-465 / 0	-95.2 -95.2	0.41 (1)	6.25	B-G	0 / 437		0.10 (1)
C-D	-465 / 0	-95.2 -95.2	0.41 (1)	6.25	G-D	0 / 437		0.10 (1)
D-E	0 / 29	-95.2 -95.2	0.12 (1)	10.00				
H-B	-746 / 0	0.0	0.0	0.09 (1)				7.81
F-D	-746 / 0	0.0	0.0	0.09 (1)				7.81
H-G	0 / 0	-18.5 -18.5	0.18 (4)	10.00				
G-F	0 / 0	-18.5 -18.5	0.18 (4)	10.00				

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.39")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
ALLOWABLE DEFL.(TL)= L/360 (0.39")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.41/1.00 (C-D:1), BC=0.18/1.00 (F-G:4), WB=0.10/1.00 (B-G:1), SS=0.19/1.00 (C-D:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
MAX MIN MAX MIN MAX MIN  
MT20 650 371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.69 (G) (INPUT = 0.90)  
JSI METAL= 0.22 (D) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080104

JOB NAME 427451	TRUSS NAME T40	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

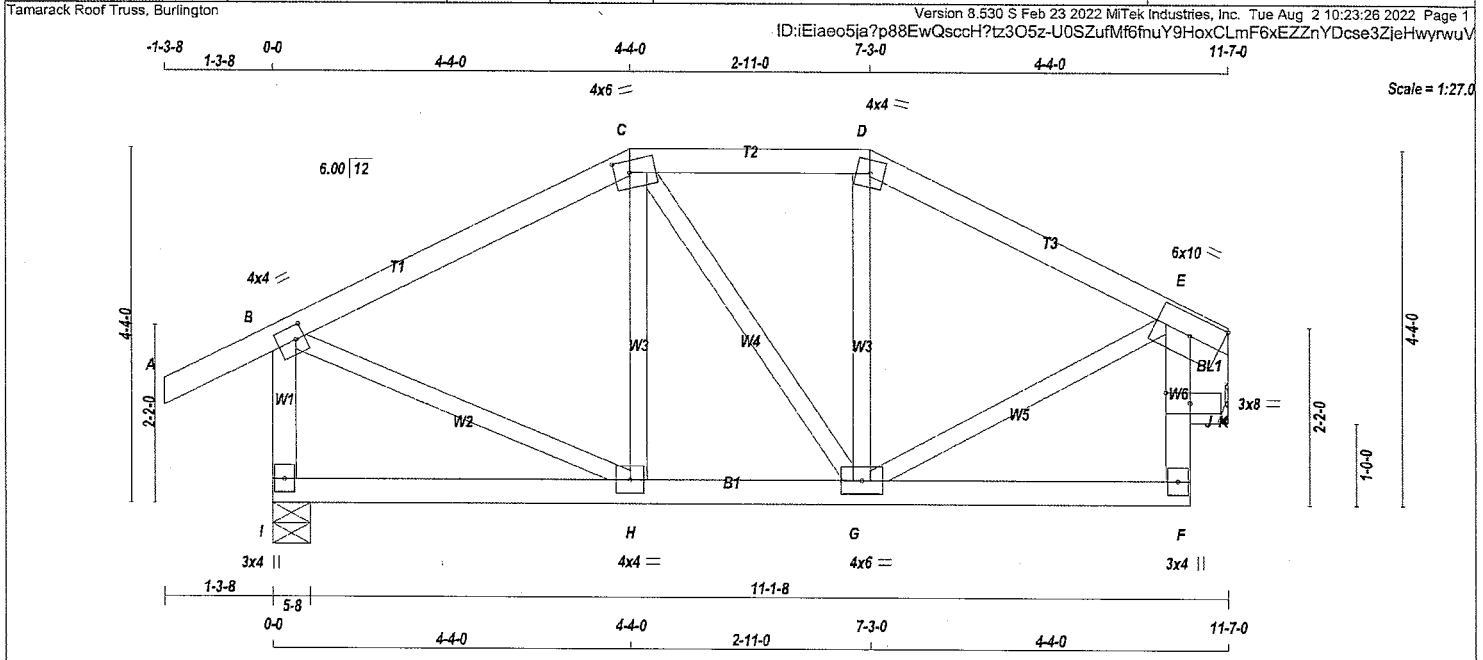

TOTAL WEIGHT = 52 lb [M][F]

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4 DRY	No.2	SPF
C - D	2x4 DRY	No.2	SPF
D - E	2x4 DRY	No.2	SPF
I - B	2x4 DRY	No.2	SPF
F - E	2x4 DRY	No.2	SPF
I - F	2x4 DRY	No.2	SPF

**BEARING BLOCKS**

BL1	2x6 DRY	No.2	SPF
-----	---------	------	-----

**ALL WEBS** 2x3 DRY No.2 SPF EXCEPT

DRY: SEASONED LUMBER.

BEARING NOTE: GAP BETWEEN INSIDE OF TOP CHORD BEARING AND FIRST DIAGONAL OR VERTICAL WEB SHALL NOT EXCEED 0.5 INCHES.

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
B	TMVW-t	MT20	4.0	4.0	2.00	1.25
C	TTW-m	MT20	4.0	6.0	1.75	2.25
D	TTW-m	MT20	4.0	4.0		
E	TMVWK1-t	MT20	6.0	10.0		Edge
F	BMV+p	MT20	3.0	4.0		
G	BMVW-t	MT20	4.0	6.0		
H	BMVW-t	MT20	4.0	4.0		
I	BMV1+p	MT20	3.0	4.0		
J	KP-p	MT20	3.0	8.0	1.50	3.50

Edge - INDICATES REFERENCE CORNER OF PLATE TOUCHES EDGE OF CHORD.

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
K(E)	611 0	611 0	0 0	MECHANICAL
I	783 0	783 0	5-8	5-8

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT K(E). MINIMUM BEARING LENGTH AT JOINT K(E) = 1-8.

**UNFACTORED REACTIONS**

JT	1ST CASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
K(E)	431	287 / 0	0 / 0	0 / 0	0 / 0	144 / 0	0 / 0
I	551	380 / 0	0 / 0	0 / 0	0 / 0	170 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) I

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

CHORDS				WEBS			
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED CSI (LC)	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. FACTORED CSI (LC)	
FR-TO		FROM TO		FR-TO			
A-B	0 / 29	-95.2 -95.2	0.12 (1)	10.00	H-C	-113 / 20	0.03 (1)
B-C	-502 / 0	-95.2 -95.2	0.23 (1)	6.25	C-G	-9 / 0	0.00 (1)
C-D	-440 / 0	-95.2 -95.2	0.11 (1)	6.25	G-D	-101 / 18	0.03 (1)
D-E	-496 / 0	-95.2 -95.2	0.19 (1)	6.25	B-H	0 / 486	0.11 (1)
I-B	-748 / 0	0.0 0.0	0.09 (1)	7.81	G-E	0 / 369	0.08 (1)
F-J	0 / 35	0.0 0.0	0.14 (1)	10.00	E-K	-641 / 0	0.04 (1)
J-E	0 / 35	0.0 0.0	0.14 (1)	10.00	J-K	0 / 196	0.00 (1)
I-H	0 / 0	-18.5 -18.5	0.08 (4)	10.00			
H-G	0 / 445	-18.5 -18.5	0.11 (1)	10.00			
G-F	0 / 116	-18.5 -18.5	0.07 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018 , ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.37")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
ALLOWABLE DEFL.(TL)= L/360 (0.37")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.02")

CSI: TC=0.23/1.00 (B-C:1) , BC=0.11/1.00 (G-H:1) , WB=0.11/1.00 (B-H:1) , SS=0.14/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
650	371	1747
788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.72 (B) (INPUT = 0.90 )  
JSI METAL= 0.22 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080105

JOB NAME 427451	TRUSS NAME T41	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 10:23:27 2022 Page 1  
 ID:IEiaeo5ja?p88EwQscch7tz3O5z-yCOx6?NHtzvkAJs Vwt?oKUPaz67y26nHDCpMyrwuU  
 Scale = 1:23.6

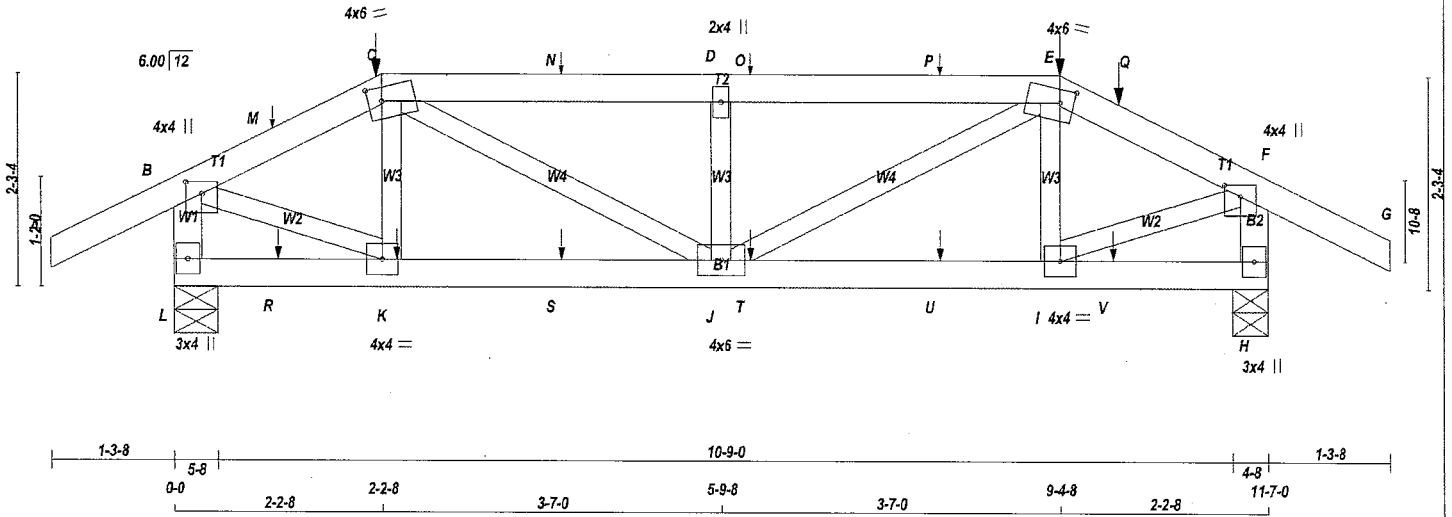

TOTAL WEIGHT = 46 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
C - E	2x4	DRY No.2	SPF
E - G	2x4	DRY No.2	SPF
L - B	2x4	DRY No.2	SPF
L - H	2x4	DRY No.2	SPF
H - F	2x4	DRY No.2	SPF

ALL WEBS 2x3 DRY No.2 EXCEPT SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.50 2.00
C	TTWW-m	MT20	4.0	6.0	1.75 1.75
D	TMVW+w	MT20	2.0	4.0	
E	TTWW-m	MT20	4.0	6.0	1.75 1.75
F	TMVW+p	MT20	4.0	4.0	1.50 2.00
H	BMV1+p	MT20	3.0	4.0	
I	BMVW-t	MT20	4.0	4.0	
J	BMVWW-t	MT20	4.0	6.0	
K	BMVW-t	MT20	4.0	4.0	
L	BMV1+p	MT20	3.0	4.0	

**NOTES - (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT VERT	825	825	0	5-8
L	863	863	0	4-8

**UNFACTORED REACTIONS**

1ST CASE	MAX./MIN. COMPONENT REACTIONS
JT COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
L	580 401/0 0/0 0/0 0/0 179/0 0/0
H	606 424/0 0/0 0/0 0/0 181/0 0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) L, H

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 5.87 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (4)

CHORDS		MEMB.			WEBS		
MEMB.	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRACED LENGTH	MEMB.	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO			FR-TO		
A-B	0/29	-95.2 -95.2	0.14 (1)	10.00	K-C	-178 / 0	0.03 (1)
B-M	-737 / 0	-95.2 -95.2	0.09 (1)	6.25	C-J	0 / 444	0.11 (1)
M-C	-737 / 0	-95.2 -95.2	0.09 (1)	6.25	J-D	-409 / 0	0.07 (1)
C-N	-1038 / 0	-95.2 -95.2	0.21 (1)	5.87	J-E	0 / 518	0.13 (1)
N-D	-1038 / 0	-95.2 -95.2	0.21 (1)	5.87	I-E	-189 / 0	0.03 (1)
D-O	-1038 / 0	-95.2 -95.2	0.21 (1)	5.87	B-K	0 / 702	0.17 (1)
O-P	-1038 / 0	-95.2 -95.2	0.21 (1)	5.87	I-F	0 / 647	0.16 (1)
P-E	-1038 / 0	-95.2 -95.2	0.21 (1)	5.87			
E-Q	-688 / 0	-95.2 -95.2	0.17 (1)	6.25			
Q-F	-688 / 0	-95.2 -95.2	0.17 (1)	6.25			
F-G	0 / 32	-95.2 -95.2	0.17 (1)	10.00			
L-B	-810 / 0	0.0	0.0 0.09 (1)	7.81			
L-R	0 / 0	-18.5	-18.5 0.04 (4)	10.00			
R-K	0 / 0	-18.5	-18.5 0.04 (4)	10.00			
K-S	0 / 649	-18.5	-18.5 0.15 (1)	10.00			
S-J	0 / 649	-18.5	-18.5 0.15 (1)	10.00			
J-T	0 / 584	-18.5	-18.5 0.14 (1)	10.00			
T-U	0 / 584	-18.5	-18.5 0.14 (1)	10.00			
U-I	0 / 584	-18.5	-18.5 0.14 (1)	10.00			
I-V	0 / 0	-18.5	-18.5 0.04 (4)	10.00			
V-H	0 / 0	-18.5	-18.5 0.04 (4)	10.00			
H-F	-851 / 0	0.0	0.0 0.09 (1)	7.81			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	2-2-8	-6	-6	---	FRONT	VERT	DEAD	---	C1
C	2-2-8	-4	-4	---	FRONT	VERT	TOTAL	---	C1
C	2-2-8	-28	-28	---	FRONT	VERT	SNOW	---	C1
E	9-4-8	-6	-6	---	FRONT	VERT	DEAD	---	C1
E	9-4-8	-28	-28	---	FRONT	VERT	SNOW	---	C1
K	2-4-6	-0	-0	---	FRONT	VERT	TOTAL	---	C1
M	1-1-4	1	1	---	FRONT	VERT	TOTAL	---	C1
N	4-1-4	1	1	---	FRONT	VERT	TOTAL	---	C1
O	6-1-4	1	1	---	FRONT	VERT	TOTAL	---	C1
P	8-1-4	1	1	---	FRONT	VERT	TOTAL	---	C1
Q	9-11-4	-6	-6	---	FRONT	VERT	TOTAL	---	C1
R	1-1-4	-0	-0	---	FRONT	VERT	TOTAL	---	C1
S	4-1-4	-0	-0	---	FRONT	VERT	TOTAL	---	C1

**DESIGN CRITERIA**

\*\*\* SPECIAL LOADS ANALYSIS \*\*\*  
 GEOMETRY AND/OR BASIC LOADS CHANGED BY USER.  
 LOADS WERE DERIVED FROM USER INPUT NO FURTHER MODIFICATIONS WERE MADE

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

LOADING IN FLAT SECTION BASED ON A SLOPE OF 6.00/12

\*\*\* NON STANDARD GIRDER \*\*\*  
 ADDTL USER-DEFINED LOADS APPLIED TO ALL LOAD CASES.

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 -PART 9 OF BCBC 2018, ABC 2019  
 -PART 9 OF OBC 2012 (2019 AMENDMENT)  
 -CSA 086-14  
 -TPIC 2014

**DESIGN ASSUMPTIONS**  
 -OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.38")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.02")  
 ALLOWABLE DEFL.(TL)= L/360 (0.38")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.21/1.00 (C-D:1), BC=0.15/1.00 (J-K:1), WB=0.17/1.00 (B-K:1), SSI=0.18/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00  
 COMP=1.00 SHEAR=1.00 TENS=1.00  
 COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE LEFT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	MAX MIN	MAX MIN
MT20	650	371	1747	788	1987 1873



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080106 PG 1/2

JOB NAME 427451	TRUSS NAME T41	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
--------------------	-------------------	---------------	----------	------------------------------	----------

Tamarack Roof Truss, Burlington

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 10:23:27 2022 Page 2  
 ID:iEiaeo5ja?p88EwQscch?tz3O5z-yC0x6?NHtzvkAJs Vwf?oKUPaz67y26nHDSCpMyrrwuU

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
T	6-1-4	-0	-0	---	FRONT	VERT	TOTAL	---	C1
U	8-1-4	-0	-0	---	FRONT	VERT	TOTAL	---	C1
V	9-11-4	-0	-0	---	FRONT	VERT	TOTAL	---	C1


**CONNECTION REQUIREMENTS**

- 1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.85 (K) (INPUT = 0.90 )  
 JSI METAL= 0.22 (I) (INPUT = 1.00 )

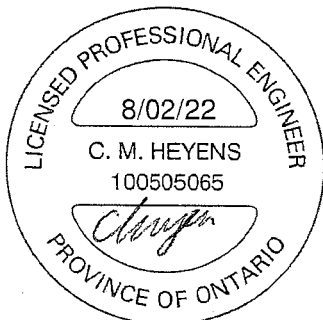

JOB NAME 427451	TRUSS NAME T42	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:23:28 2022 Page 1  
 ID: iEiaeo5ja? p88EwQscH? tz3O5z-QOaJJKNweH1boTRA3dOEKX0c0NQChVNxWtClLoyrwuT

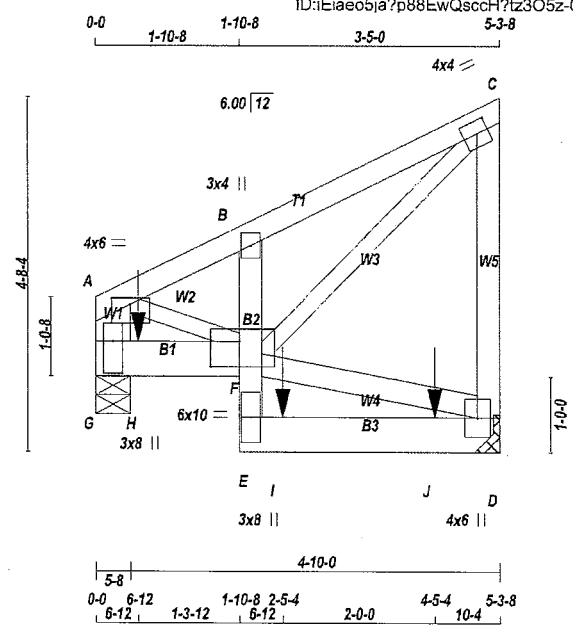

TOTAL WEIGHT = 2 X 32 = 65 lb (M)

**LUMBER**  
 N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
A - C	2x4	DRY No.2	SPF
D - C	2x4	DRY No.2	SPF
G - A	2x6	DRY No.2	SPF
G - F	2x6	DRY No.2	SPF
E - B	2x4	DRY No.2	SPF
E - D	2x6	DRY No.2	SPF
ALL WEBS EXCEPT F - D	2x3	DRY No.2	SPF

DRY: SEASONED LUMBER.

DESIGN CONSISTS OF 2 TRUSSES BUILT SEPARATELY THEN FASTENED TOGETHER AS FOLLOWS:

CHORDS #ROWS	SURFACE SPACING (IN)	LOAD(PLF)
TOP CHORDS : (0.122"x3") SPIRAL NAILS		
A-C	1 12	TOP
C-D	1 12	TOP
G-A	2 12	TOP
BOTTOM CHORDS : (0.122"x3") SPIRAL NAILS		
G-F	2 12	SIDE(183.1)
E-D	2 12	SIDE(0.0)
B-E	1 12	TOP
WEBS : (0.122"x3") SPIRAL NAILS		
2x3	1 6	
2x4	1 6	

NAILS TO BE DRIVEN FROM ONE SIDE ONLY.

GIRDER NAILING ASSUMES NAILED HANGERS ARE FASTENED WITH MIN. 3-0 INCH NAILS.

TOP - COMPONENTS ARE LOADED FROM THE TOP AND MUST BE PLACED ON TOP EDGE OF ALL PLYS FOR THE LOAD TO BE TRANSFERRED TO EACH PLY.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
JT	VERT	HORZ	DOWN	HORZ
D	1367	0	1367	0
G	1376	0	1376	0

A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED AT JOINT D. MINIMUM BEARING LENGTH AT JOINT D = 4-0.

**DESIGN CRITERIA**

SPECIFIED LOADS:

TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF

BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF

TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

UNFACTORED REACTIONS

1ST LOASE	MAX /MIN	COMPONENT REACTIONS
JT	COMBINED	SNOW LIVE PERM.LIVE WIND DEAD SOIL
D	960	669 / 0 0 / 0 0 / 0 0 / 0 292 / 0 0 / 0
G	967	666 / 0 0 / 0 0 / 0 0 / 0 301 / 0 0 / 0

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) G

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 7.81 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(LL)= L/999 (0.01")  
 ALLOWABLE DEFL.(TL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(TL)= L/999 (0.02")

**LOADING**  
 TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX+ CS1 (LC)	MEMB. UNBRAC LENGTH	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO			FR-TO			
A-B	-1157 / 0	-95.2 -95.2	0.04 (1)	6.25	A-F	0 / 1098	0.14 (1)	
B-C	-1102 / 0	-95.2 -95.2	0.09 (1)	6.25	F-D	-93 / 0	0.01 (1)	
D-C	-642 / 0	0.0 0.0	0.11 (1)	7.81	F-C	0 / 1391	0.17 (1)	
G-A	-927 / 0	0.0 0.0	0.03 (1)	7.81				
G-H	0 / 0	-18.5 -18.5	0.09 (1)	10.00				
H-F	0 / 0	-18.5 -18.5	0.09 (1)	10.00				
E-F	0 / 907	0.0 0.0	0.15 (1)	10.00				
F-B	-261 / 0	0.0 0.0	0.07 (1)	7.81				
E-I	0 / 89	-18.5 -18.5	0.22 (1)	10.00				
I-J	0 / 89	-18.5 -18.5	0.22 (1)	10.00				
J-D	0 / 89	-18.5 -18.5	0.22 (1)	10.00				

CS1: TC=0.11/1.00 (C-D:1), BC=0.22/1.00 (D-E:1), WB=0.17/1.00 (C-F:1), SS1=0.30/1.00 (D-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.00 COMP=1.00 SHEAR=1.00 TENS= 1.00

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

SPECIFIED CONCENTRATED LOADS (LBS)

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
H	6-12	-420	-420	---	BACK	VERT	TOTAL	---	C1
I	2-5-4	-543	-543	---	BACK	VERT	TOTAL	---	C1
J	4-5-4	-540	-540	---	BACK	VERT	TOTAL	---	C1

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.81 (C) (INPUT = 0.90)  
 JSI METAL= 0.18 (C) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080107 PG 1/2

JOB NAME 427451	TRUSS NAME T42	QUANTITY 1	PLY 2	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

**PLATES (table is in inches)**

JT	TYPE	PLATES	W	LEN	Y	X
A	TMVW-p	MT20	4.0	6.0	1.00	3.00
B	TMV+p	MT20	3.0	4.0		
C	TMVW-t	MT20	4.0	4.0	2.00	1.75
D	BMVW1+p	MT20	4.0	6.0		
E	BMV+p	MT20	3.0	8.0		
F	BVMWVW-l	MT20	6.0	10.0	4.00	4.50
G	BMV1+p	MT20	3.0	8.0	5.25	1.50


**NOTES- (1)**

1) Lateral braces to be a minimum of 2X4 SPF #2.



JOB NAME 427369	TRUSS NAME J1	QUANTITY 7	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:27:18 2022 Page 1  
 ID:yfnjggBDDKS7XOSR0eUZHGz42va-heTGb 9BUx0zOp0NXwWAF1You4xRaY?nPfwQTyrwqf

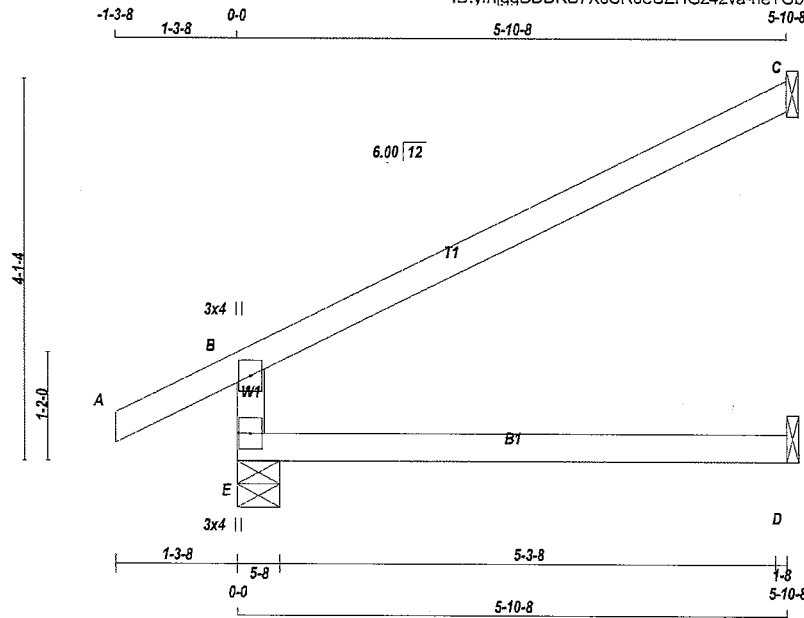

Scale: 1/2"=1'

TOTAL WEIGHT = 7 X 17 = 118 lb [M]

**LUMBER**  
 N. L. G. A. RULES  
 CHORDS SIZE LUMBER DESCR.  
 E - B 2x4 DRY No.2 SPF  
 A - C 2x4 DRY No.2 SPF  
 E - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table ts in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	542	0	542	0	5-8	5-8
C	210	0	210	0	1-8	1-8
D	45	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS				DEAD	SOIL
		COMBINED	SNOW	LIVE	PERM.LIVE		
E	380	269 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	144	118 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (4)

MEMB.	FR-TO	CHORDS		WEBS			
		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1	MAX. UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)
E-B	-479 / 0	0.0	0.0	0.13 (4)	7.81		
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00		
B-C	-31 / 0	-95.2	-95.2	0.56 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00		

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**  
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

**DESIGN ASSUMPTIONS**  
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.  
 (55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")  
 CALCULATED DEFL.(LL)= L/999 (0.00")  
 ALLOWABLE DEFL.(TL)= L/360 (0.20")  
 CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.56/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.24/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10  
 COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY  
 TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
			MAX MIN	MAX MIN
MT20	650	371	1747	1987


PLATE PLACEMENT TOL. = 0.250 inches  
 PLATE ROTATION TOL = 5.0 Deg.

JSI GRIP= 0.19 (E) (INPUT = 0.90 )  
 JSI METAL= 0.13 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080046



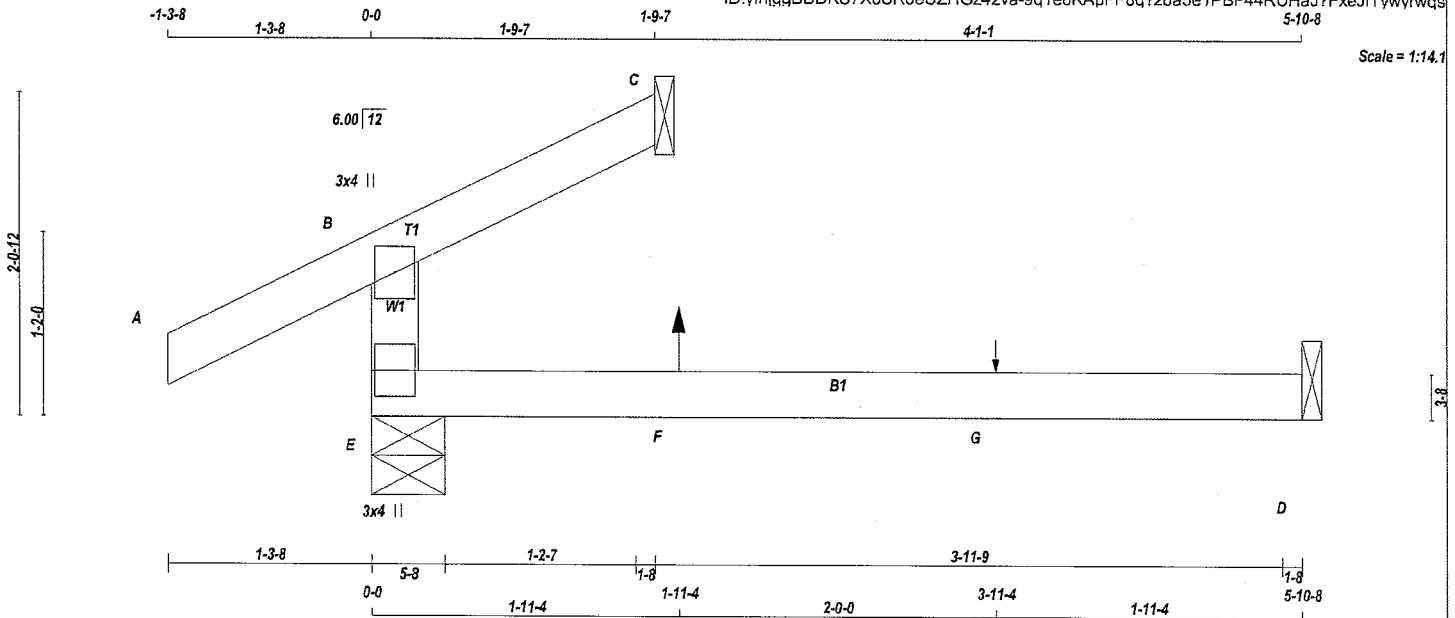

TOTAL WEIGHT = 2 X 12 = 23 lb

**LUMBER**  
 N. L. G. A. RULES  
 CHORDS SIZE LUMBER DESCR.  
 E - B 2x4 DRY No.2 SPF  
 A - C 2x4 DRY No.2 SPF  
 E - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	293	0	293	0	5-8	5-8
C	64	0	64	0	1-8	1-8
D	43	0	52	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS				DEAD	SOIL
		SNOW	LIVE	PERM.LIVE	WIND		
E	206	144 / 0	0 / 0	0 / 0	0 / 0	62 / 0	0 / 0
C	47	22 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
D	35	0 / -3	0 / 0	0 / 0	0 / 0	37 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (7)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MEMB. FORCE (LBS)	MAX FACTORED UNBRAC	CS1 (LC)	MAX
FR-TO		FROM TO			LENGTH	FR-TO		
E-B	-237 / 0	0.0	0.0	0.11 (4)	7.81			
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00			
B-C	-10 / 9	-95.2	-95.2	0.08 (4)	6.25			
E-F	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
F-G	0 / 0	-18.5	-18.5	0.14 (4)	10.00			
G-D	0 / 0	-18.5	-18.5	0.14 (4)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
F	1-11-4	5	1	8	FRONT	VERT	TOTAL	---	C1
G	3-11-4	1	1	---	FRONT	VERT	TOTAL	---	C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 088.14  
 - TPIC 2014

**DESIGN ASSUMPTIONS**  
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
 ALLOWABLE DEFL.(TL)= L/360 (0.20")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.04")

CSI: TC=0.12/1.00 (A-B:1), BC=0.14/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (Psi)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.09 (E) (INPUT = 0.90 )  
 JSI METAL= 0.07 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080047

JOB NAME 427369	TRUSS NAME J3	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 10:27:20 2022 Page 1  
ID:yfniqqBDDKS7X0SR0eUZHGz42va-d1b10qBR?ZGhd7AmelYekSdDVudv2SV4sz01UMyrwqr

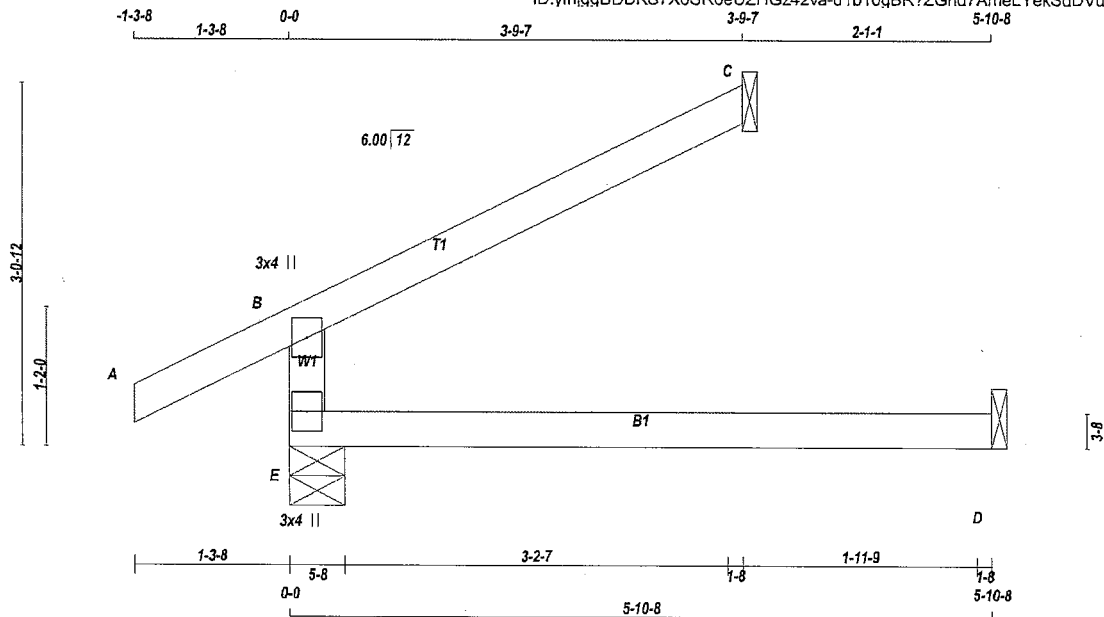

Scale = 1:18.7

TOTAL WEIGHT = 2 X 14 = 28 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p MT20	3.0	4.0		
E	BMV1+p MT20	3.0	4.0		

**NOTES-** (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT		
E	418	0	418	0	0	5-8	5-8
C	135	0	135	0	0	1-8	1-8
D	45	0	50	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	COMBINED	1ST LCASE MAX./MIN. COMPONENT REACTIONS					DEAD	SOIL
		SNOW	LIVE	PERM.LIVE	WIND			
E	295	199 / 0	0 / 0	0 / 0	0 / 0	96 / 0	0 / 0	
C	93	76 / 0	0 / 0	0 / 0	0 / 0	17 / 0	0 / 0	
D	36	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MAX. FACTORED FORCE (LBS)
FR-TO		FROM TO		FR-TO
E-B	-354 / 0	0.0	0.0 0.13 (4)	7.81
A-B	0 / 29	-95.2	-95.2 0.12 (1)	10.00
B-C	-20 / 0	-95.2	-95.2 0.23 (1)	6.25
E-D	0 / 0	-18.5	-18.5 0.13 (4)	10.00

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH.	LL = 26.7 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 40.1 PSF

**SPACING = 24.0 IN./C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")  
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.20")  
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.23/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SS=0.16/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (E) (INPUT = 0.90)  
JSI METAL= 0.10 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080048

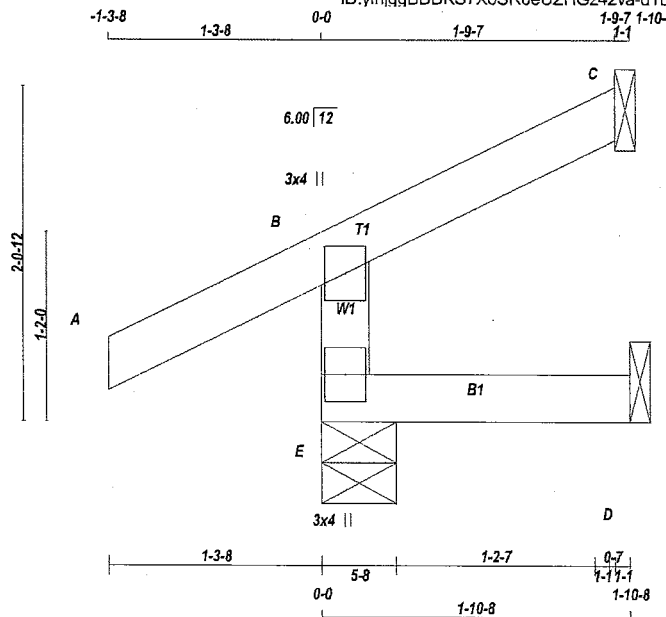

Scale = 1:13.6

TOTAL WEIGHT = 2 X 7 = 14 lb

**LUMBER**  
N. L. G. A. RULES  
CHORDS SIZE LUMBER DESCR.  
E - B 2x4 DRY No.2 SPF  
A - C 2x4 DRY No.2 SPF  
E - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	280	0	280	0	5-8	5-8
C	46	0	46	-24	1-8	1-8
D	8	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT  
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS. FACTORED UPLIFT

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS					DEAD	SOIL
		SNOW	LIVE	PERM.	LIVE	WIND		
E	195	148 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0	
C	32	25 / -19	0 / 0	0 / 0	0 / 0	7 / 0	0 / 0	
D	7	0 / -8	0 / 0	0 / 0	0 / 0	12 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E, C

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (5)

MEMB.	FR-TO	C H O R D S			W E B S		
		MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED HORIZ. LOAD (CSI (LC))	MEMB. FORCE (LBS)	MAX. FACTORED HORIZ. LOAD (CSI (LC))	MEMB. FORCE (LBS)
E-B	-253 / 0	0.0	0.0	0.04 (5)	7.81		
A-B	0 / 29	-95.2	-95.2	0.12 (1)	10.00		
B-C	-17 / 0	-95.2	-95.2	0.09 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.04 (5)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**  
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.04/1.00 (D-E:5), WB=0.00/1.00 (n/a:0), SS=0.09/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)	
			MAX	MIN
MT20	650	371	1747	788
			1987	1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.10 (E) (INPUT = 0.90 )  
JSI METAL= 0.07 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080049

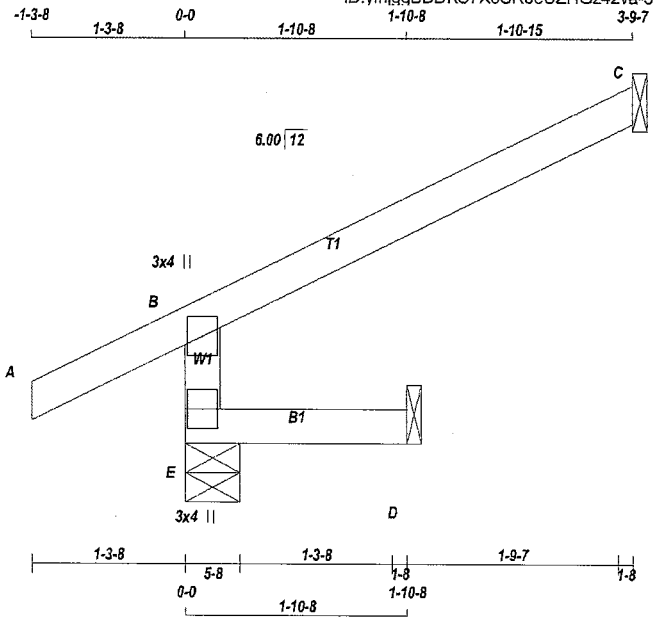

Scale = 1/18.9

TOTAL WEIGHT = 2 X 10 = 19 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	374	0	374	0	5-8	5-8
C	135	0	135	0	1-8	1-8
D	16	0	17	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS				WIND	DEAD	SOIL
		SNOW	LIVE	PERM	LIVE			
E	259	199/0	0/0	0/0	0/0	60/0	0/0	
C	93	76/0	0/0	0/0	0/0	17/0	0/0	
D	12	0/0	0/0	0/0	0/0	12/0	0/0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (5)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	VERT. LOAD (PLF)	LC1 MAX	UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED	CS1 (LC)	UNBRAC LENGTH
E-B	-354/0	0.0	0.0	0.01 (4)	7.81			
A-B	0/29	-95.2	-95.2	0.13 (5)	10.00			
B-C	-20/0	-95.2	-95.2	0.23 (1)	6.25			
E-D	0/0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**  
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**  
- OVERHANG NOT TO BE ALTERED OR CUT OFF.  
(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CS1: TC=0.23/1.00 (B-C:1), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.16/1.00 (B-C:1)  
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00  
AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.14 (E) (INPUT = 0.90 )  
JSI METAL= 0.10 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080050

JOB NAME 427369	TRUSS NAME J6	QUANTITY 6	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 09:26:50 2022 Page 1  
ID:yfnjggBDDKS7X0SR0eUZHgz42va-wgFk9RFTiEwk7Gg6? QOczHoRcjeXjsn9C4x5lyrxjZ

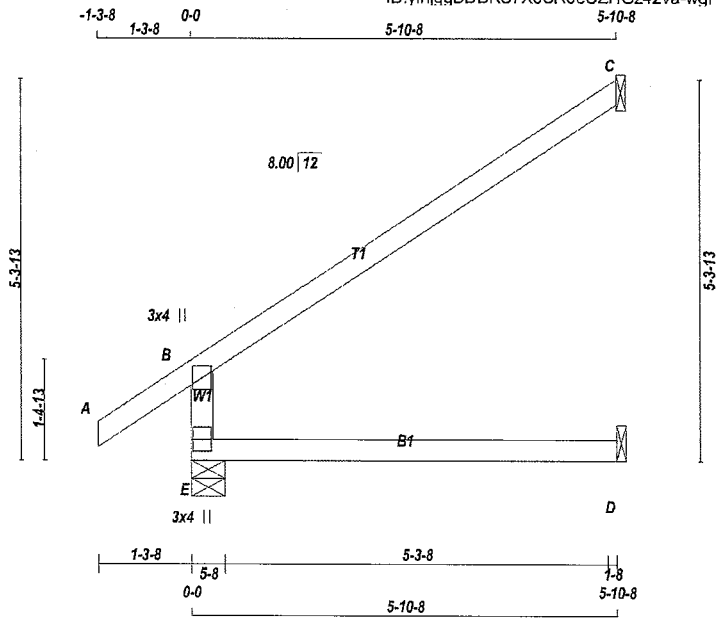

TOTAL WEIGHT = 6 X 18 = 107 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
E - D	2x4 DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	543	0	543	0	0	5-8	5-8	
C	210	0	210	0	0	1-8	1-8	
D	46	0	51	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	381	270 / 0	0 / 0	0 / 0	0 / 0	0 / 0	111 / 0	0 / 0
C	144	118 / 0	0 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0
D	36	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	36 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (4)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC2 MAX	MEMB. FORCE (LBS)	MAX. FACTORED UNBRAC LENGTH	FR-TO	FR-TO
E-B	-480 / 0	0.0	0.0	0.12 (4)	7.81			
A-B	0 / 36	-95.2	-95.2	0.13 (1)	10.00			
B-C	-39 / 0	-95.2	-95.2	0.56 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.13 (4)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C**  
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015  
THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**  
- OVERHANG NOT TO BE ALTERED OR CUT OFF.  
(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.20")  
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.20")  
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")  
CSI: TC=0.56/1.00 (B-C:1), BC=0.13/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.23/1.00 (B-C:1)  
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10  
COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY  
TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)		SHEAR		SECTION	
	(PSI)	(PLI)	(PSI)	(PLI)	(PLI)	(PLI)
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL = 5.0 Deg.


JSI GRIP= 0.20 (B) (INPUT = 0.90 )  
JSI METAL= 0.16 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080055

JOB NAME 427369	TRUSS NAME J7	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 15:29:00 2022 Page 1  
 ID: yfnjggBDDKS7XOSR0eUZHGz42va-gAGaohExRngV5itRzqH9JNHOH698WLEyzvnpFyrsQ1

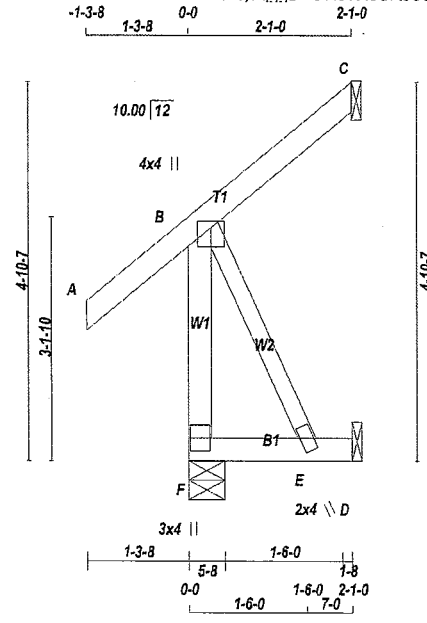

Scale = 1:28.5

TOTAL WEIGHT = 2 X 13 = 26 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
F - B	2x4 DRY	No.2	SPF
A - C	2x4 DRY	No.2	SPF
F - D	2x4 DRY	No.2	SPF

ALL WEBS 2x3 DRY No.2 SPF  
 DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMVW+p	MT20	4.0	4.0	1.00 2.00
E	BMW+w	MT20	2.0	4.0	
F	BMV1+p	MT20	3.0	4.0	

**NOTES- (1)**  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
F	250 0	250 0	5-8	5-8
C	99 0	99 0	1-8	1-8
D	19 0	22 0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	1ST LCASE	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
F	174	130/0	0/0	0/0	0/0	45/0	0/0
C	68	56/0	0/0	0/0	0/0	13/0	0/0
D	15	0/0	0/0	0/0	0/0	15/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) F

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (5)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC1 MIN	MAX. MEMB. UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)	MIN
FR-TO		FROM TO			FR-TO			
F-B	-231/0	0.0	0.0	0.04 (1)	7.81	B-E	0/0	0.00 (1)
A-B	0/42	-95.2	-95.2	0.13 (1)	10.00			
B-C	0/0	-95.2	-95.2	0.07 (1)	10.00			
F-E	0/0	-18.5	-18.5	0.02 (4)	10.00			
E-D	0/0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2019, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
 ALLOWABLE DEFL.(TL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:1), BC=0.02/1.00 (E-F:4), WB=0.00/1.00 (B-E:1), SSI=0.08/1.00 (A-B:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.17 (B) (INPUT = 0.90)  
 JSI METAL= 0.95 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080056

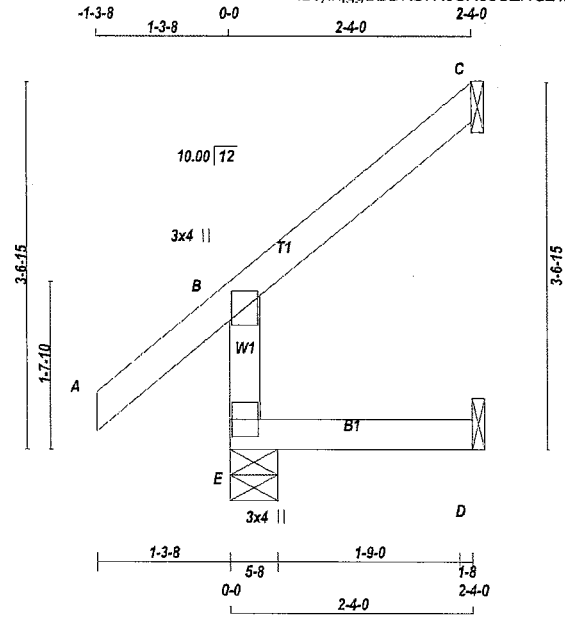

Scale = 1:21.6

TOTAL WEIGHT = 5 X 10 = 48 lb

**LUMBER**  
N. L. G. A. RULES

CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY No.2	SPF
A - C	2x4	DRY No.2	SPF
E - D	2x4	DRY No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG IN-SX	REQRD BRG IN-SX
	VERT	HORZ	DOWN	HORZ		
E	294	0	294	0	5-8	5-8
C	84	0	84	0	1-8	1-8
D	20	0	22	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX / MIN COMPONENT REACTIONS						
		SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
E	205	152 / 0	0 / 0	0 / 0	0 / 0	0 / 0	53 / 0	0 / 0
C	58	47 / 0	0 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0
D	16	0 / 0	0 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (5)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. CSI (LC)	MEMB. UNBRAC LENGTH FR-TO	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)	
E-B	-270 / 0	0.0	0.0	0.01 (4)	7.81			
A-B	0 / 42	-95.2	-95.2	0.13 (5)	10.00			
B-C	-17 / 0	-95.2	-95.2	0.09 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 8.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**  
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP(DRY)	SHEAR (PSI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN
MT20	650	371	1747	783
			1987	1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.12 (B) (INPUT = 0.90)  
JSI METAL= 0.10 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080057

JOB NAME 427369	TRUSS NAME J9	QUANTITY 6	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

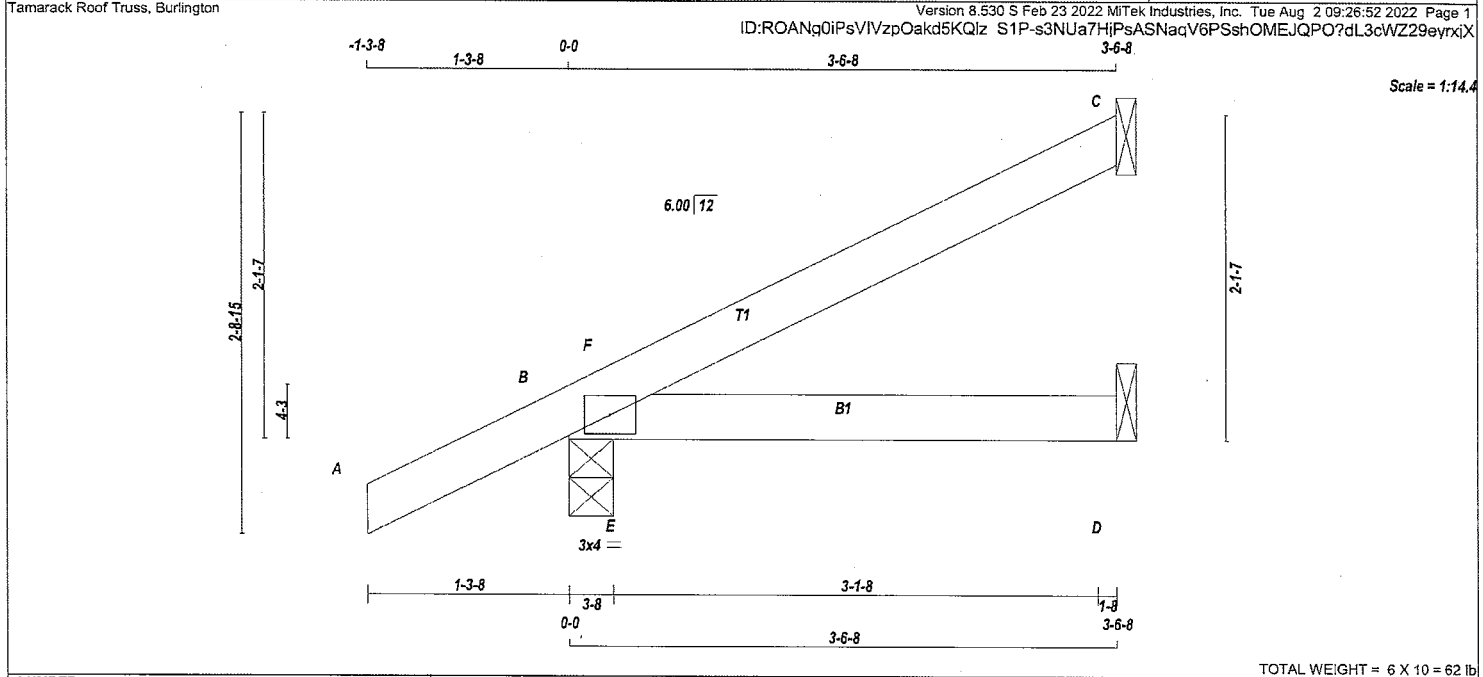

TOTAL WEIGHT = 6 X 10 = 62 lb

**LUMBER** N. L. G. A. RULES CHORDS SIZE LUMBER DESCR. LUMBER No.2 LUMBER No.2 LUMBER No.2

A - C	2x4	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-1	MT20	3.0	4.0	

**NOTES-** (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
C	146	0	146	0	1-8	1-8
B	331	0	331	0	3-8	3-8
D	55	0	55	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	COMBINED	MAX / MIN. COMPONENT REACTIONS						
		SNOW	LIVE	PERM	LIVE	WIND	DEAD	SOIL
C	101	79 / 0	0 / 0	0 / 0	0 / 0	0 / 0	22 / 0	0 / 0
B	231	167 / 0	0 / 0	0 / 0	0 / 0	0 / 0	64 / 0	0 / 0
D	41	15 / 0	0 / 0	0 / 0	0 / 0	0 / 0	26 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (5)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	LC1	MAX. UNBRACED LENGTH
FR-TO		FROM TO			FR-TO			
A-B	0 / 27	-95.2	-95.2	0.14 (5)	10.00	E-F	-199 / 4	0.00 (1)
B-F	-15 / 14	-95.2	-95.2	0.03 (4)	6.25			
F-C	-2 / 2	-95.2	-95.2	0.15 (1)	10.00			
B-E	0 / 0	-18.5	-18.5	0.11 (1)	10.00			
E-D	0 / 0	-18.5	-18.5	0.11 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH.	LL = 26.7 PSF
	DL = 6.0 PSF
BOT CH.	LL = 0.0 PSF
	DL = 7.4 PSF
TOTAL LOAD	= 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)=	L / 360 (0.19")
CALCULATED VERT. DEFL.(LL) =	L / 999 (0.01")
ALLOWABLE DEFL.(TL)=	L / 360 (0.19")
CALCULATED VERT. DEFL.(TL) =	L / 999 (0.02")

CSI: TC=0.15/1.00 (C-F:1), BC=0.11/1.00 (D-E:1)

, WB=0.00/1.00 (E-F:1), SSI=0.16/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.26 (B) (INPUT = 0.90)

JSI METAL= 0.05 (B) (INPUT = 1.00)




STRUCTURAL COMPONENT ONLY  
DWG # TR22080058



JOB NAME 427369	TRUSS NAME J10	QUANTITY 6	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:26:53 2022 Page 1  
 ID:yfniggBDDKS7X0SR0eUZHgz42va-KFxtnTILA9IJ kPhg6 5EbWJlqhkk4bDrAlch4yrxjW

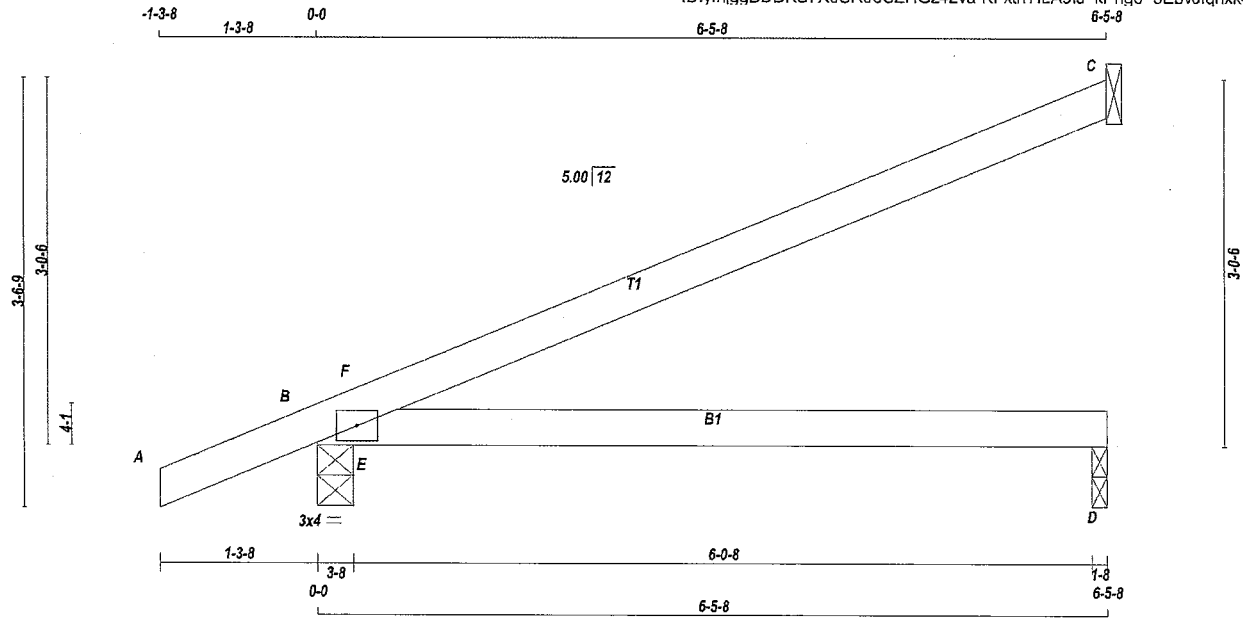

TOTAL WEIGHT = 6 X 17 = 102 lb [M][F]

**LUMBER**  
 N. L. G. A. RULES  
 CHORDS SIZE LUMBER DESCR.  
 A - C 2x4 DRY No.2 SPF  
 B - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-1	MT20	3.0	4.0	

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT		
C	270	0	270	0	0	1-8	1-8
B	495	0	495	0	0	3-8	3-8
D	98	0	98	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C

**UNFACTORED REACTIONS**

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	186	147 / 0	0 / 0	0 / 0	0 / 0	0 / 0	40 / 0	0 / 0
B	347	245 / 0	0 / 0	0 / 0	0 / 0	0 / 0	103 / 0	0 / 0
D	73	26 / 0	0 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (4)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC1 UNBRAC	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRAC	MAX. FACTORED FORCE (LBS)	MAX. FACTORED UNBRAC
FR-TO		FROM TO	CS (LC)	LENGTH	FR-TO			
A-B	0 / 23	-95.2 -95.2	0.12 (1)	10.00	E-F	-504 / 15	0.00 (1)	
B-F	-28 / 80	-95.2 -95.2	0.13 (1)	6.25				
F-C	-8 / 2	-95.2 -95.2	0.52 (1)	10.00				
B-E	0 / 0	-18.5 -18.5	0.34 (1)	10.00				
E-D	0 / 0	-18.5 -18.5	0.35 (1)	10.00				

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.22")  
 CALCULATED VERT. DEFL.(LL) = L/747 (0.10")  
 ALLOWABLE DEFL.(TL)= L/360 (0.22")  
 CALCULATED VERT. DEFL.(TL) = L/365 (0.21")

CSI: TC=0.52/1.00 (C-F:1), BC=0.35/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.41/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.37 (B) (INPUT = 0.90)  
 JSI METAL= 0.08 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080059

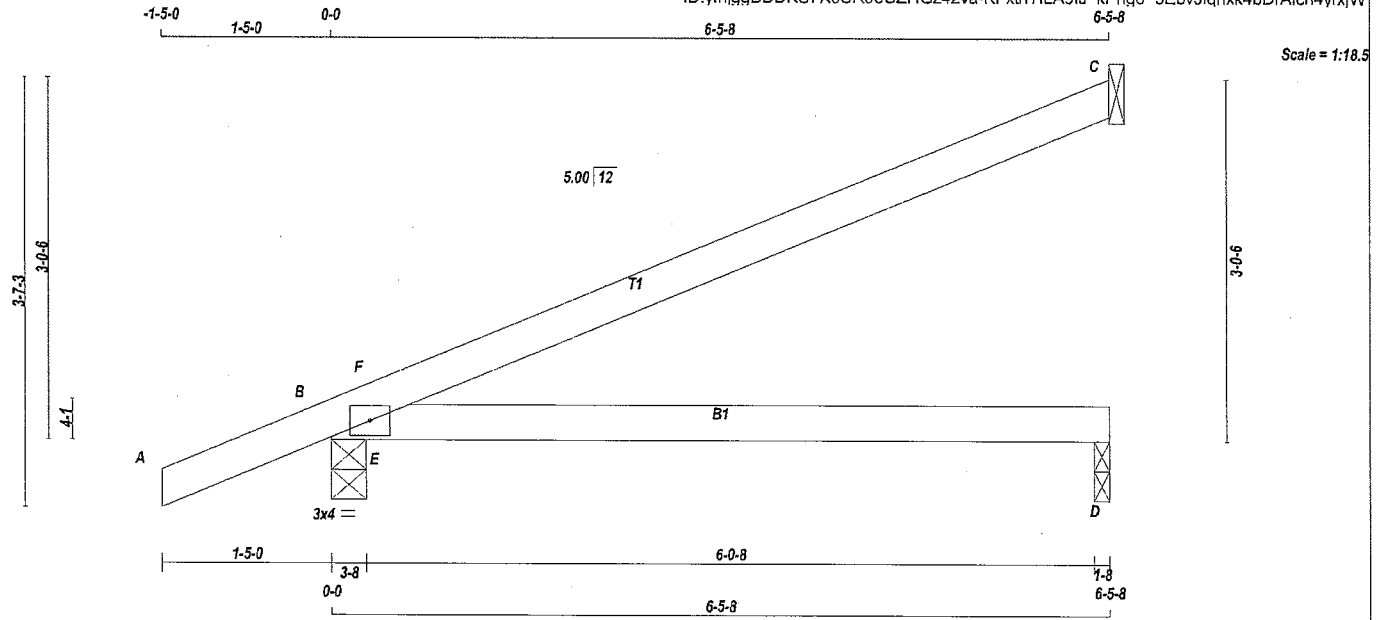

TOTAL WEIGHT = 2 X 17 = 34 lb

**LUMBER**  
N. L. G. A. RULES  
CHORDS SIZE LUMBER DESCR.  
A - C 2x4 DRY No.2 SPF  
B - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

**NOTES-** (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
C	270	0	270	0	1-8	1-8
B	507	0	507	0	3-8	3-8
D	98	0	98	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C

**UNFACTORED REACTIONS**

JT	1ST LCASE	MAX /MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM. LIVE	WIND	DEAD
C	186	147 / 0	0 / 0	0 / 0	0 / 0	40 / 0	0 / 0
B	356	251 / 0	0 / 0	0 / 0	0 / 0	104 / 0	0 / 0
D	73	26 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	C H O R D S MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (LBS)	LC1 MAX (PLF)	MAX. UNBRAC LENGTH (1)	W E B S MAX. FACTORED FORCE (LBS)	MAX. UNBRAC LENGTH (1)		
							FR-TO	FR-TO
A-B	0 / 26	-95.2	-95.2	0.14 (1)	10.00	E-F	-504 / 15	0.00 (1)
B-F	-28 / 80	-95.2	-95.2	0.13 (1)	6.25			
F-C	-6 / 2	-95.2	-95.2	0.52 (1)	10.00			
B-E	0 / 0	-18.5	-18.5	0.34 (1)	10.00			
E-D	0 / 0	-18.5	-18.5	0.35 (1)	10.00			

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH. LL	= 26.7 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 40.1 PSF

**SPACING = 24.0 IN. / C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF BCBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.22")  
CALCULATED VERT. DEFL.(LL) = L/747 (0.10")  
ALLOWABLE DEFL.(TL)= L/360 (0.22")  
CALCULATED VERT. DEFL.(TL) = L/365 (0.21")

CSI: TC=0.52/1.00 (C-F:1), BC=0.35/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.41/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP (PSI)	DRY (PLI)	SHEAR (PLI)	SECTION (PLI)			
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.38 (B) (INPUT = 0.80)  
JSI METAL= 0.09 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080060

JOB NAME 427429	TRUSS NAME J21	QUANTITY 1	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 09:47:59 2022 Page 1  
ID:fYXyxBAiDNnEHGUY5nNMmTz3MZl-GpRTUMcT18phtHB?q?hzYZLfw9qeMf?Zy8zb7iyxPk

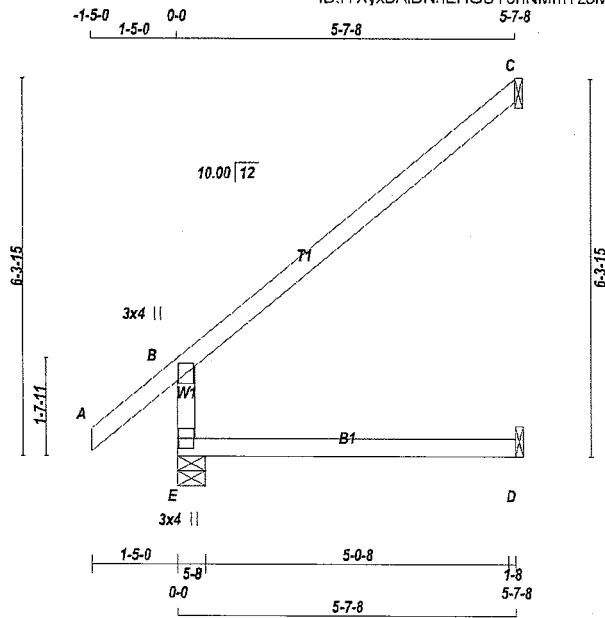

Scale = 1:37.1

TOTAL WEIGHT = 19 lb

**LUMBER**  
N. L. G. A. RULES  
CHORDS SIZE LUMBER DESCR.  
E - B 2x4 DRY No.2 SPF  
A - C 2x4 DRY No.2 SPF  
E - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	538	0	538	0	5-8	5-8
C	201	0	201	0	1-8	1-8
D	44	0	50	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	377	269 / 0	0 / 0	0 / 0	0 / 0	108 / 0	0 / 0
C	138	113 / 0	0 / 0	0 / 0	0 / 0	25 / 0	0 / 0
D	35	0 / 0	0 / 0	0 / 0	0 / 0	35 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX. UNBRAC LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)
E-B	-478 / 0	0.0	0.0	0.10 (4)	7.81	
A-B	0 / 46	-95.2	-95.2	0.16 (1)	10.00	
B-C	-43 / 0	-95.2	-95.2	0.51 (1)	6.25	
E-D	0 / 0	-18.5	-18.5	0.12 (4)	10.00	

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**  
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.03")

CSI: TC=0.51/1.00 (B-C:1), BC=0.12/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.20/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)		SHEAR (PSI)	SECTION (PLI)	
	MAX	MIN		MAX	MIN
MT20	650	371	1747	788	1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.22 (B) (INPUT = 0.90 )  
JSI METAL= 0.17 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080072

JOB NAME 427429	TRUSS NAME J22	QUANTITY 4	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:47:59 2022 Page 1  
 ID: XaWmj7CqBI3Mj H76JcCv1z3lUD-GpRTUMcT18phtHB?q?hzYZLIt9rCMf?Zy8zb7iyxPk

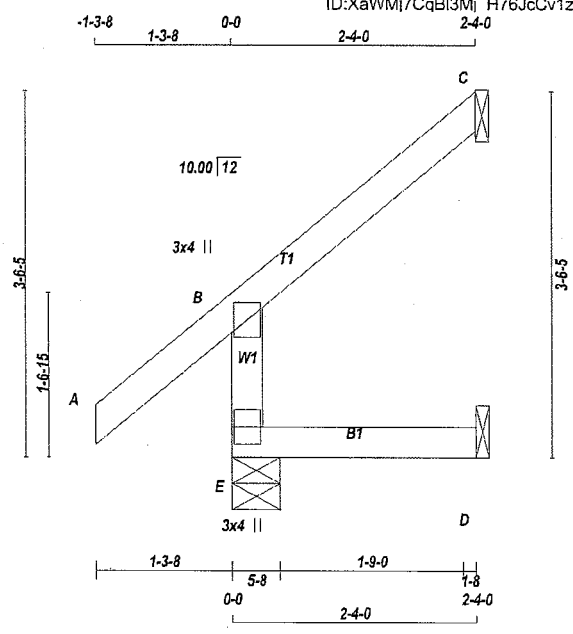

TOTAL WEIGHT = 4 X 10 = 39 lb [M]

**LUMBER**  
 N. L. G. A. RULES  
 CHORDS SIZE LUMBER DESCR.  
 E - B 2x4 DRY No.2 SPF  
 A - C 2x4 DRY No.2 SPF  
 E - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES- (1)**  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG		REQRD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX	
E	294	0	294	0	0	5-8	5-8	
C	84	0	84	0	0	1-8	1-8	
D	20	0	22	0	0	1-8	1-8	

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	COMBINED	1ST LOASE MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
E	205	152 / 0	0 / 0	0 / 0	0 / 0	53 / 0	0 / 0
C	58	47 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0
D	16	0 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS				
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MEMB. UNBRAC	MAX. FACTORED FORCE (LBS)	MAX. CSI (LC)
FR-TO		FROM TO		LENGTH	FR-TO		
E-B	-270 / 0	0.0	0.0	0.01 (4)	7.81		
A-B	0 / 42	-95.2	-95.2	0.13 (5)	10.00		
B-C	-17 / 0	-95.2	-95.2	0.09 (1)	6.25		
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00		

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**  
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

**DESIGN ASSUMPTIONS**  
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.  
 (55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
 ALLOWABLE DEFL.(TL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.02/1.00 (D-E:4)  
 , WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**  
 PLATE GRIP(DRY) SHEAR SECTION (PSI) (PLI) (PLI)  
 MAX MIN MAX MIN MAX MIN  
 MT20 650 371 1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches  
 PLATE ROTATION TOL. = 5.0 Deg.  
 JSI GRIP= 0.12 (B) (INPUT = 0.90 )  
 JSI METAL= 0.10 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080073

JOB NAME 427429	TRUSS NAME J23	QUANTITY 5	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:00 2022 Page 1  
 ID: XaWm|7CqB|3M| H76JcVt1z3IUD-k? ?rid5oSxXVRIBOICC4nuwdZBR56FIBoj9f8yrxP

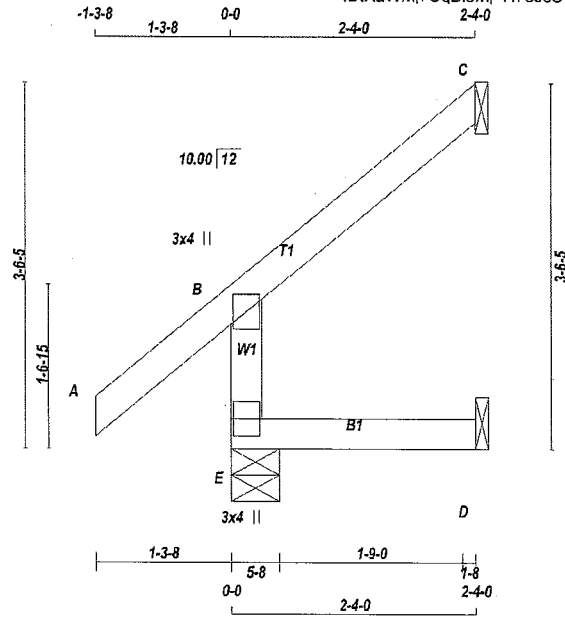

Scale = 1:21.3

TOTAL WEIGHT = 5 X 10 = 48 lb

**LUMBER**  
 N. L. G. A. RULES  
 CHORDS SIZE LUMBER DESCR.  
 E - B 2x4 DRY No.2 SPF  
 A - C 2x4 DRY No.2 SPF  
 E - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQD BRG
	VERT	HORZ	DOWN	HORZ		
E	294	0	294	0	5-8	5-8
C	84	0	84	0	1-8	1-8
D	20	0	22	0	1-8	1-8

SEE MITEK STANDARD DETAIL, MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	1ST LCASE	MAX /MIN. COMPONENT REACTIONS					
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD
E	205	152 / 0	0 / 0	0 / 0	0 / 0	53 / 0	0 / 0
C	58	47 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0
D	16	0 / 0	0 / 0	0 / 0	0 / 0	16 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE LATERALLY RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS		
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. FACTORED FORCE (LBS)	MAX. FACTORED FORCE (LBS)	
FR-TO		FROM TO		FR-TO	
E-B	-270 / 0	0.0	0.0	0.01 (4)	7.81
A-B	0 / 42	-95.2	-95.2	0.13 (5)	10.00
B-C	-17 / 0	-95.2	-95.2	0.09 (1)	6.25
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

**DESIGN ASSUMPTIONS**  
 - OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
 ALLOWABLE DEFL.(TL)= L/360 (0.19")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.08/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

AUTOSOLVE RIGHT HEEL ONLY

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.12 (B) (INPUT = 0.90)  
 JSI METAL= 0.10 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080074

JOB NAME 427429	TRUSS NAME J24	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:01 2022 Page 1  
 ID: XaWMj7CqB3Mj H76JcCv1z3lUD-CBYDv2ejZl3O6bKOyQlRd Q?EzSbqZVsQSSiBbyrxPi

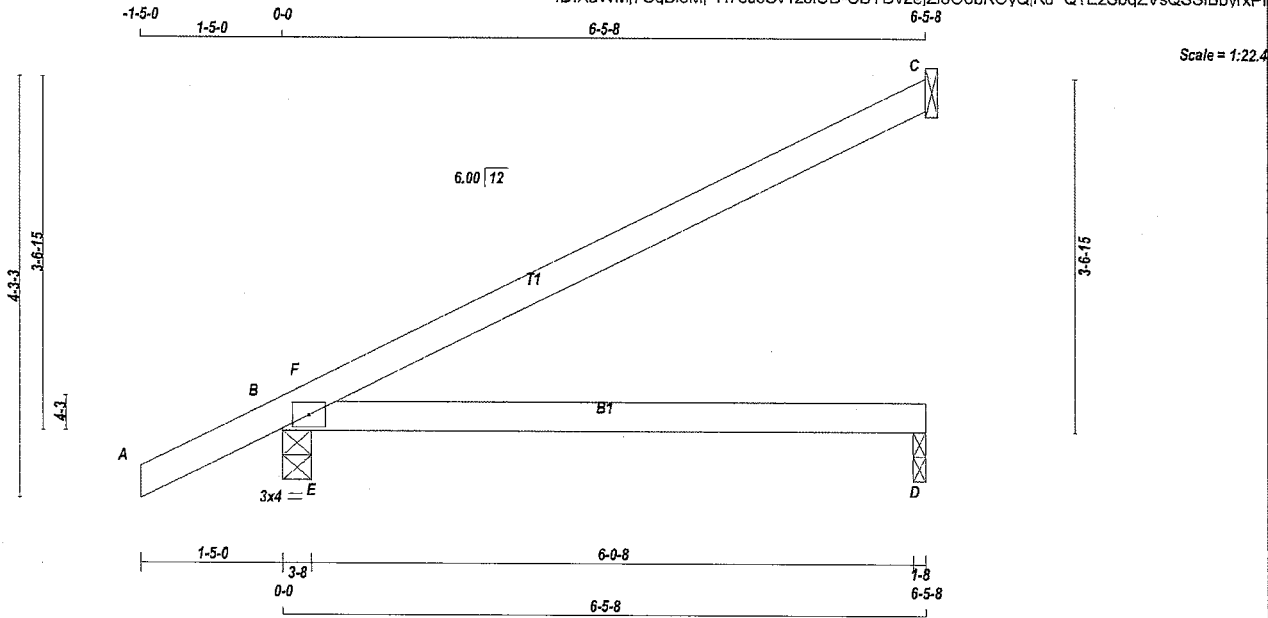

TOTAL WEIGHT = 2 X 18 = 35 lb [M] [F]

**LUMBER**  
 N. L. G. A. RULES  
 CHORDS SIZE LUMBER DESCR.  
 A - C 2x4 DRY No.2 SPF  
 B - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-1	MT20	3.0	4.0	

**NOTES-** (1)  
 1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	UPLIFT	IN-SX
C	270	0	0	1-8
B	508	0	0	3-8
D	97	0	0	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX / MIN SNOW	MIN. LIVE	PERM. LIVE	WIND	DEAD	SOIL
C	186	147 / 0	0 / 0	0 / 0	0 / 0	39 / 0	0 / 0
B	356	252 / 0	0 / 0	0 / 0	0 / 0	104 / 0	0 / 0
D	73	26 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

**BRACING**  
 TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
 ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
 TOTAL LOAD CASES: (4)

MEMB.	CHORDS		WEBS	
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. UNBRACED LENGTH (LC)	MAX. FACTORED FORCE (LBS)
FR-TO				
A-B	0 / 30	-95.2	-95.2 0.15 (1)	10.00
B-F	-32 / 143	-95.2	-95.2 0.18 (1)	6.25
F-C	-8 / 2	-95.2	-95.2 0.53 (1)	10.00
B-E	0 / 0	-18.5	-18.5 0.34 (1)	10.00
E-D	0 / 0	-18.5	-18.5 0.35 (1)	10.00

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
 TOP CH. LL = 26.7 PSF  
 DL = 6.0 PSF  
 BOT CH. LL = 0.0 PSF  
 DL = 7.4 PSF  
 TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**  
 THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD  
 ALLOWABLE DEFL.(LL)= L/360 (0.22")  
 CALCULATED VERT. DEFL.(LL) = L/753 (0.10")  
 ALLOWABLE DEFL.(TL)= L/360 (0.22")  
 CALCULATED VERT. DEFL.(TL) = L/366 (0.21")

CSI: TC=0.53/1.00 (C-F:1), BC=0.35/1.00 (D-E:1)  
 , WB=0.00/1.00 (E-F:1), SSI=0.49/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT .

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)	SECTION (PLI)	SHEAR (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
 PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.42 (B) (INPUT = 0.90 )  
 JSI METAL= 0.08 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080075

JOB NAME 427429	TRUSS NAME J25	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:01 2022 Page 1  
ID: XaWmJ7CqB13Mj; H76JcCv1z3iUD-CBYDv2eiZ13O6bKOyQjRd Q5azVzqZVsQSSiBbyrxPj

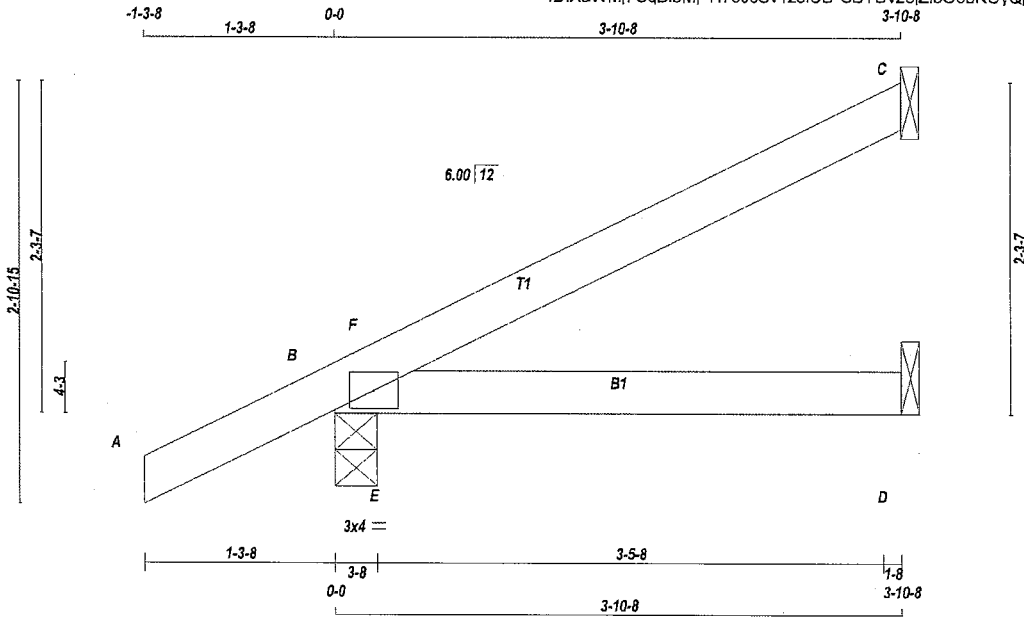

TOTAL WEIGHT = 2 X 11 = 22 lb

**LUMBER**

N. L. G. A. RULES					
CHORDS	SIZE	LUMBER	DESCR.	SPF	SPF
A - C	2x4	DRY	No.2		
B - D	2x4	DRY	No.2		

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

**NOTES-** (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ	UPLIFT		
C	160	0	160	0	0	1-8	1-8
B	349	0	349	0	0	3-8	3-8
D	60	0	60	0	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	COMBINED	MAX./MIN. COMPONENT REACTIONS					DEAD	SOIL
		SNOW	LIVE	PERM.LIVE	WIND			
C	111	87 / 0	0 / 0	0 / 0	0 / 0	24 / 0	0 / 0	
B	244	176 / 0	0 / 0	0 / 0	0 / 0	68 / 0	0 / 0	
D	45	17 / 0	0 / 0	0 / 0	0 / 0	28 / 0	0 / 0	

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (5)

MEMB.	CHORDS		WEBS					
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1	MAX	MEMB. UNBRAC LENGTH	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO								
A-B	0 / 27	-95.2	-95.2	0.14 (5)	10.00	E-F	-234 / 5	0.00 (1)
B-F	-17 / 23	-95.2	-95.2	0.03 (4)	6.25			
F-C	-2 / 2	-95.2	-95.2	0.18 (1)	10.00			
B-E	0 / 0	-18.5	-18.5	0.13 (1)	10.00			
E-D	0 / 0	-18.5	-18.5	0.13 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH. LL	= 26.7 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:

- PART 9 OF CBC 2018, ABC 2019
- PART 9 OF OBC 2012 (2019 AMENDMENT)
- CSA 086-14
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL)= L/999 (0.01")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL)= L/999 (0.03")

CSI: TC=0.18/1.00 (C-F:1), BC=0.13/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.19/1.00 (B-E:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
	MAX	MIN
MT20	650	371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.28 (B) (INPUT = 0.90)  
JSI METAL= 0.05 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080076

JOB NAME 427429	TRUSS NAME J26	QUANTITY 2	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:02 2022 Page 1  
 ID: XaWMJ7CqBI3M| H76JcV1z3lUD-gO6c6NLJ3BFkIvaW7FgACzG?MtUZ?l?e6CGk1yrxPh

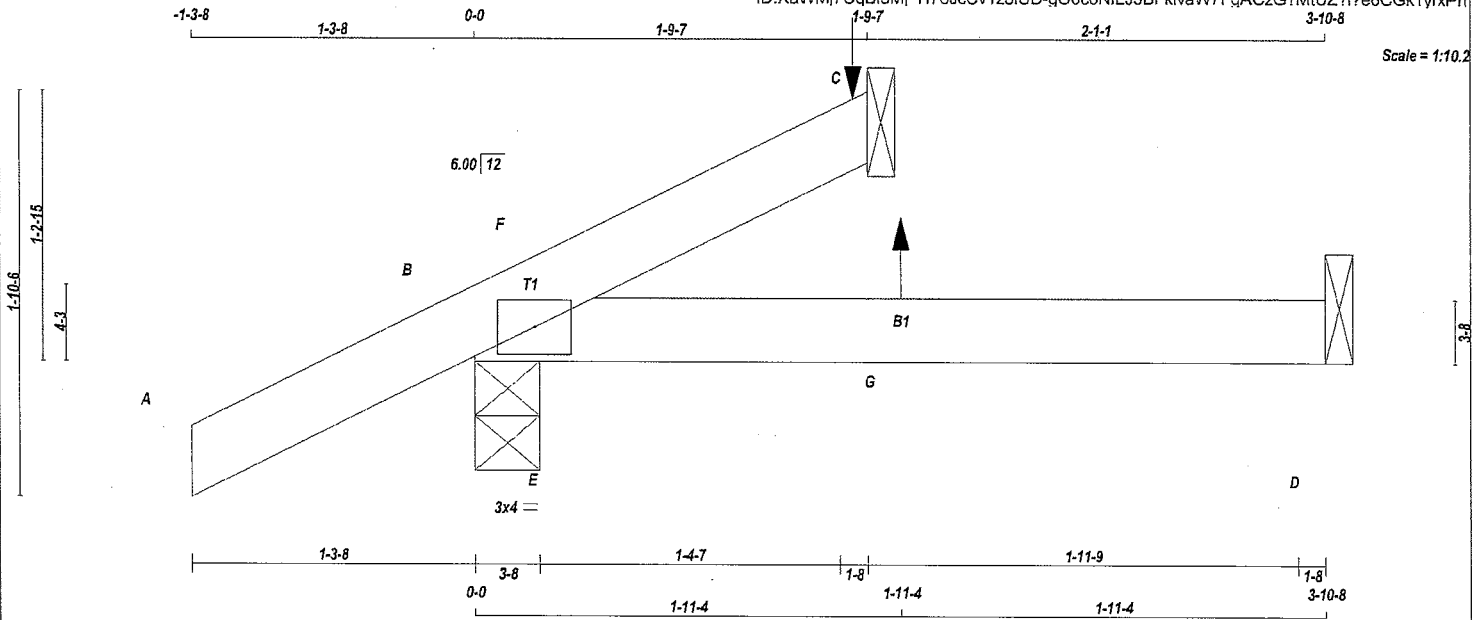

TOTAL WEIGHT = 2 X 9 = 17 lb

**LUMBER**  
 N. L. G. A. RULES  
 CHORDS SIZE LUMBER DESCR.  
 A - C 2x4 DRY No.2 SPF  
 B - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

**NOTES-** (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION			INPUT BRG		REQD BRG	
	VERT	HORZ	DOWN	HORZ	UPLIFT	IN-SX	IN-SX		
C	67	0	67	0	-9	1-8	1-8		
B	283	0	283	0	0	3-8	3-8		
D	22	0	31	0	0	1-8	1-8		

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS. FACTORED UPLIFT

**UNFACTORED REACTIONS**

JT	COMBINED	1ST LCASE MAX./MIN. COMPONENT REACTIONS					
		SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	48	26 / -19	0 / 0	0 / 0	0 / 0	22 / 0	0 / 0
B	198	144 / 0	0 / 0	0 / 0	0 / 0	54 / 0	0 / 0
D	18	0 / -7	0 / 0	0 / 0	0 / 0	22 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
 MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT. OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (9)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	MAX	MEMB. UNBRAC LENGTH	MAX. FACTORED FORCE (LBS)	MAX CSI (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 27	-95.2	-95.2	0.14 (5)	10.00	E-F	0 / 119	0.00 (1)
B-F	-95 / 0	-95.2	-95.2	0.14 (5)	6.25			
F-C	-9 / 7	-95.2	-95.2	0.04 (4)	10.00			
B-E	0 / 0	-18.5	-18.5	0.05 (5)	10.00			
E-G	0 / 0	-18.5	-18.5	0.05 (5)	10.00			
G-D	0 / 0	-18.5	-18.5	0.05 (5)	10.00			

**SPECIFIED CONCENTRATED LOADS (LBS)**

JT	LOC.	LC1	MAX-	MAX+	FACE	DIR.	TYPE	HEEL	CONN.
C	1-9-7	-8	-8	31	FRONT	VERT	TOTAL		C1
G	1-11-4	7	1	15	FRONT	VERT	TOTAL		C1

**CONNECTION REQUIREMENTS**

1) C1: A SUITABLE HANGER/MECHANICAL CONNECTION IS REQUIRED.

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH. LL	=	26.7	PSF
DL	=	6.0	PSF
BOT CH. LL	=	0.0	PSF
DL	=	7.4	PSF
TOTAL LOAD	=	40.1	PSF

SPACING = 24.0 IN./C/C

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

**DESIGN ASSUMPTIONS**

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
 ALLOWABLE DEFL.(TL) = L/360 (0.19")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.14/1.00 (A-B:5), BC=0.05/1.00 (B-E:5)  
 , WB=0.00/1.00 (E-F:1), SSI=0.14/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10  
 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MAX	MIN	MAX
MT20	650	371
	1747	788
	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches


PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.19 (B) (INPUT = 0.90)  
 JSI METAL= 0.04 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
 DWG # TR22080077



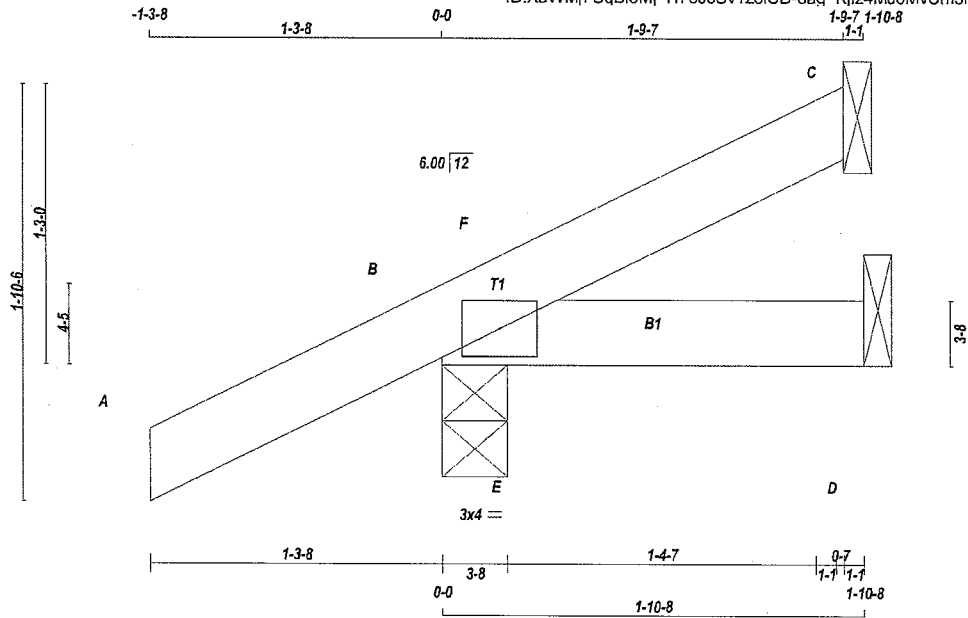

TOTAL WEIGHT = 2 X 6 = 12 lb [M]

**LUMBER**  
N. L. G. A. RULES  
CHORDS SIZE LUMBER DESCR.  
A - C 2x4 DRY No.2 SPF  
B - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
C	51	0	51	0	-11 1-8	1-8
B	280	0	280	0	3-8	3-8
D	3	0	14	0	-15 1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

PROVIDE ANCHORAGE AT BEARING JOINT C FOR 150 LBS FACTORED UPLIFT  
PROVIDE ANCHORAGE AT BEARING JOINT D FOR 150 LBS FACTORED UPLIFT

**UNFACTORED REACTIONS**

JT	1ST LCASE	MAX./MIN. COMPONENT REACTIONS						
		COMBINED	SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	36	27 / -12	0 / 0	0 / 0	0 / 0	0 / 0	9 / 0	0 / 0
B	194	148 / 0	0 / 0	0 / 0	0 / 0	0 / 0	47 / 0	0 / 0
D	3	0 / -15	0 / 0	0 / 0	0 / 0	0 / 0	10 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (5)

MEMB.	CHORDS				WEBS			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	CS1 (LC)	MEMB. UNBRAC LENGTH	MAX. FACTORED FORCE (LBS)	MAX CS1 (LC)	
FR-TO		FROM TO			FR-TO			
A-B	0 / 27	-95.2	-95.2	0.12 (1)	10.00	E-F	0 / 132	0.00 (1)
B-F	-91 / 0	-95.2	-95.2	0.12 (1)	6.25			
F-C	-8 / 0	-95.2	-95.2	0.03 (5)	10.00			
B-E	0 / 0	-18.5	-18.5	0.05 (5)	10.00			
E-D	0 / 0	-18.5	-18.5	0.05 (5)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

**DESIGN ASSUMPTIONS**  
- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 28.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.12/1.00 (A-B:1), BC=0.05/1.00 (B-E:5), WB=0.00/1.00 (E-F:1), SSI=0.13/1.00 (B-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE GRIP (DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650 371 1747 788 1987 1873	

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.20 (B) (INPUT = 0.90 )  
JSI METAL= 0.04 (B) (INPUT = 1.00 )



STRUCTURAL COMPONENT ONLY  
DWG # TR22080078

JOB NAME 427429	TRUSS NAME J28	QUANTITY 6	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MiTek Industries, Inc. Tue Aug 2 09:48:03 2022 Page 1  
ID:in5Rk6OlePz2poAsdGW0KMz Rum-8aq Kifz4MJ6MvUm3rmviPVSymDclS?9tmxpGTyrxPg

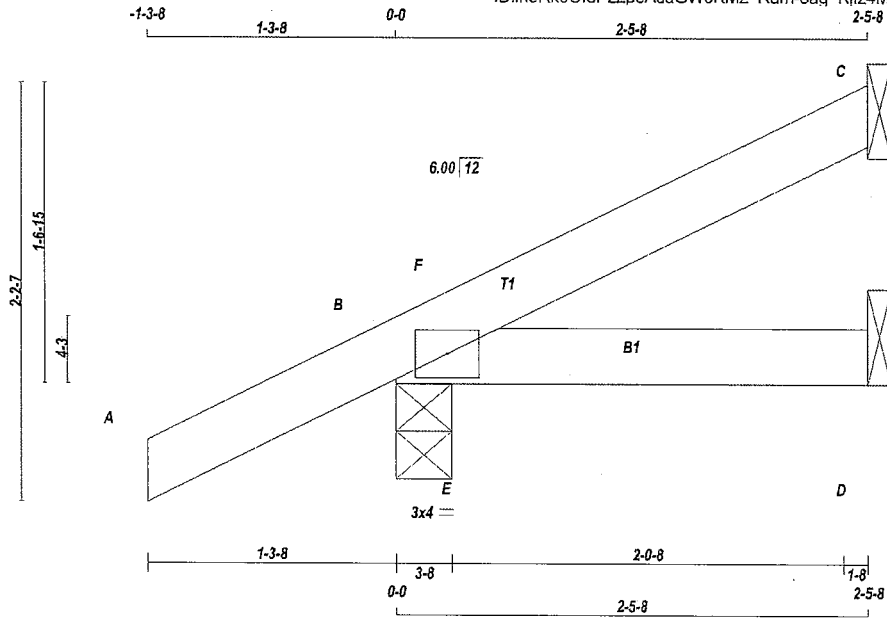

TOTAL WEIGHT = 6 X 8 = 47 lb [M]

**LUMBER**  
N. L. G. A. RULES  
CHORDS SIZE LUMBER DESCR.  
A - C 2x4 DRY No.2 SPF  
B - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMB1-I	MT20	3.0	4.0	

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION	MAXIMUM FACTORED GROSS REACTION	INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ
C	100	0	100	0
B	269	0	269	0
D	40	0	40	0

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	1ST LCASE	MAX./MIN. SNOW	LIVE	PERM.LIVE	WIND	DEAD	SOIL
C	69	54 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0
B	187	138 / 0	0 / 0	0 / 0	0 / 0	49 / 0	0 / 0
D	30	12 / 0	0 / 0	0 / 0	0 / 0	18 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) C, B

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 10.00 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.  
ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (5)

MEMB.	CHORDS				WEBS				
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX	LC1 CSI (LC)	MEMB. FORCE (LBS)	MAX. FACTORED UNBRAC LENGTH	FR-TO	MEMB. FORCE (LBS)	MAX. FACTORED CSI (LC)
FR-TO		FROM TO							
A-B	0 / 27	-95.2	-95.2	0.13 (5)	10.00	E-F	-105 / 2	0.00 (1)	
B-F	-10 / 0	-95.2	-95.2	0.02 (4)	10.00				
F-C	0 / 2	-95.2	-95.2	0.07 (1)	10.00				
B-E	0 / 0	-18.5	-18.5	0.06 (1)	10.00				
E-D	0 / 0	-18.5	-18.5	0.06 (1)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**  
THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD  
ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL)= L/999 (0.00")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL)= L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.06/1.00 (B-E:1), WB=0.00/1.00 (E-F:1), SSI=0.09/1.00 (A-B:5)  
DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10  
COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


**NAIL VALUES**

PLATE GRIP(DRY)	SHEAR (PSI)	SECTION (PLI)
MT20	650	371 1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches  
PLATE ROTATION TOL. = 5.0 Deg.  
JSI GRIP= 0.21 (B) (INPUT = 0.90)  
JSI METAL= 0.04 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080079

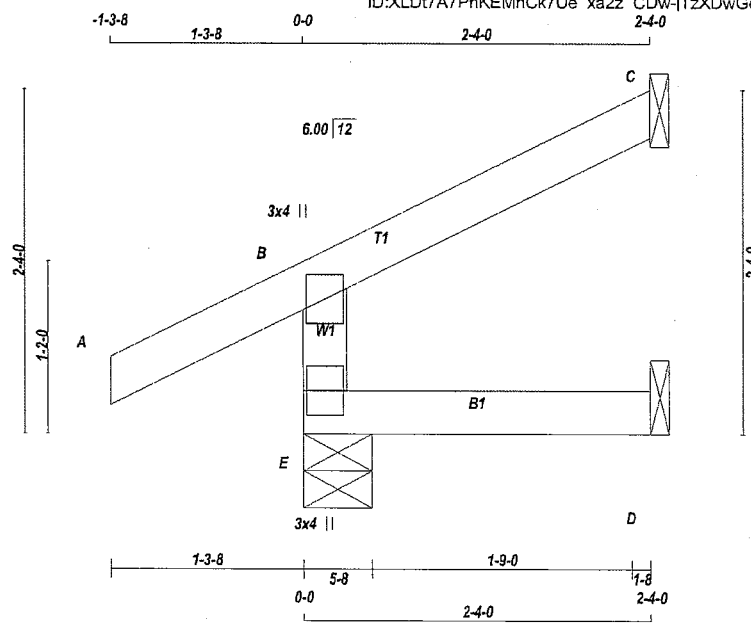

TOTAL WEIGHT = 6 X 8 = 49 lb

**LUMBER**

N. L. G. A. RULES	CHORDS	SIZE	LUMBER	DESCR.
E - B	2x4	DRY	No.2	SPF
A - C	2x4	DRY	No.2	SPF
E - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMV+p	MT20	3.0	4.0	
E	BMV1+p	MT20	3.0	4.0	

**NOTES-** (1)

1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION		MAXIMUM FACTORED GROSS REACTION		INPUT BRG	REQRD BRG
	VERT	HORZ	DOWN	HORZ		
E	292	0	292	0	5-8	5-8
C	84	0	84	0	1-8	1-8
D	19	0	21	0	1-8	1-8

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C, D

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX./MIN. COMPONENT REACTIONS				DEAD	SOIL
		SNOW	LIVE	PERM.LIVE	WIND		
E	203	150 / 0	0 / 0	0 / 0	0 / 0	53 / 0	0 / 0
C	58	47 / 0	0 / 0	0 / 0	0 / 0	11 / 0	0 / 0
D	15	0 / 0	0 / 0	0 / 0	0 / 0	15 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) E

**BRACING**

TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT. MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**

TOTAL LOAD CASES: (5)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH (FT)	MEMB. FORCE (LBS)	MAX. FACTORED FORCE (LBS)	MAX. LC1 (LC)	MAX. UNBRACED LENGTH (FT)
E-B	-268 / 0	0.0	0.0	0.01 (4)	7.81			
A-B	0 / 29	-95.2	-95.2	0.13 (5)	10.00			
B-C	-12 / 0	-95.2	-95.2	0.09 (1)	6.25			
E-D	0 / 0	-18.5	-18.5	0.02 (4)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**

TOP CH. LL	= 26.7 PSF
DL	= 6.0 PSF
BOT CH. LL	= 0.0 PSF
DL	= 7.4 PSF
TOTAL LOAD	= 40.1 PSF

**SPACING = 24.0 IN./C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
 - PART 9 OF BCBC 2018, ABC 2019  
 - PART 9 OF OBC 2012 (2019 AMENDMENT)  
 - CSA 086-14  
 - TPIC 2014

**DESIGN ASSUMPTIONS**

- OVERHANG NOT TO BE ALTERED OR CUT OFF.

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")  
 CALCULATED VERT. DEFL.(LL) = L/999 (0.00")  
 ALLOWABLE DEFL.(TL) = L/360 (0.19")  
 CALCULATED VERT. DEFL.(TL) = L/999 (0.00")

CSI: TC=0.13/1.00 (A-B:5), BC=0.02/1.00 (D-E:4), WB=0.00/1.00 (n/a:0), SSI=0.10/1.00 (B-C:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.


**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.


JSI GRIP= 0.11 (E) (INPUT = 0.90)  
 JSI METAL= 0.07 (B) (INPUT = 1.00)

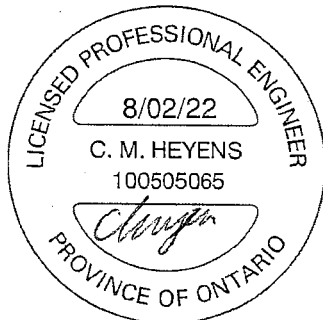

STRUCTURAL COMPONENT ONLY  
 DWG # TR22080095

JOB NAME 427451	TRUSS NAME J32	QUANTITY 3	PLY 1	JOB DESC. GREENPARK HOMES	DRWG NO.
Tamarack Roof Truss, Burlington				TRUSS DESC.	

Version 8.530 S Feb 23 2022 MITek Industries, Inc. Tue Aug 2 10:23:19 2022 Page 1  
ID:UhVv4TnsExo5x4kq8YDpvz Rrh-BfxwQGGGmWvtD5FS1Ej7Te838kPb4SqcSzWnXqyrwuc

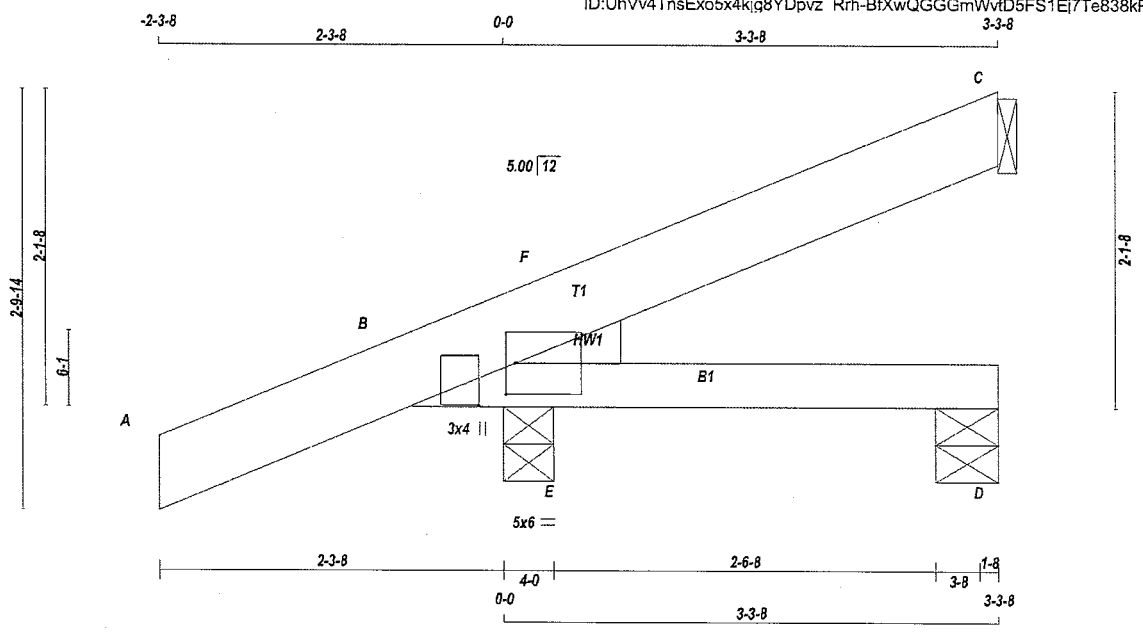

TOTAL WEIGHT = 3 X 16 = 49 lb [M]

**LUMBER**  
N. L. G. A. RULES  
CHORDS SIZE LUMBER DESCR.  
A - C 2x6 DRY No.2 SPF  
B - D 2x4 DRY No.2 SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B	TMBH1-I	MT20	5.0	6.0	2.50 0.75
B	TP+p	MT20	3.0	4.0	3.50 3.00

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION VERT	FACTORED GROSS REACTION HORZ	MAXIMUM FACTORED GROSS REACTION DOWN	MAXIMUM FACTORED GROSS REACTION HORZ	INPUT BRG	REQRD BRG	HEEL WEDGE
C	180	0	180	0	1-8	1-8	
B	391	0	391	0	4-0	4-0	2x4 L
D	41	0	41	0	5-0	5-0	

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX./MIN. SNOW	MIN. LIVE	PERM LIVE	WIND	DEAD	SOIL
C	125	95 / 0	0 / 0	0 / 0	0 / 0	30 / 0	0 / 0
B	273	199 / 0	0 / 0	0 / 0	0 / 0	74 / 0	0 / 0
D	31	9 / 0	0 / 0	0 / 0	0 / 0	22 / 0	0 / 0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (5)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	LC1 MAX. (LC)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)	MAX. FACTORED (LC)	MAX. UNBRACED LENGTH	MEMB. FORCE (LBS)
FR-TO		FROM TO			FR-TO			
A-B	0 / 28	-95.2	-95.2 0.11 (5)	10.00	E-F	-19 / 37	0.00 (1)	
B-F	-57 / 0	-95.2	-95.2 0.08 (1)	6.25				
F-C	0 / 17	-95.2	-95.2 0.12 (1)	10.00				
B-E	0 / 0	-18.5	-18.5 0.06 (1)	10.00				
E-D	0 / 0	-18.5	-18.5 0.06 (1)	10.00				

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN. C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55 % OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.01")  
ALLOWABLE DEFL.(TL)= L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.01")

CSI: TC=0.12/1.00 (C-F:1), BC=0.06/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.10/1.00 (A-B:5)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)	SHEAR (PLI)	SECTION (PLI)
MT20	650	371	1747 788 1987 1873


PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.14 (B) (INPUT = 0.90)  
JSI METAL= 0.03 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080096

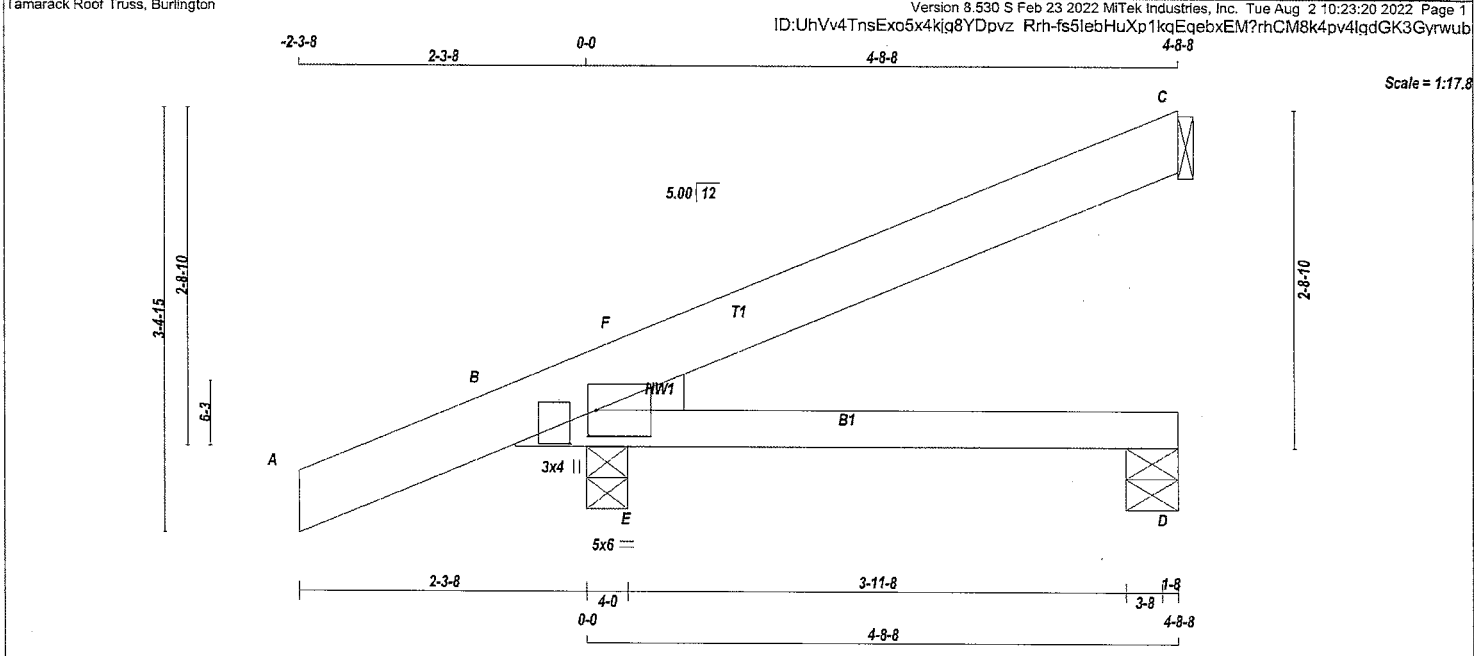

TOTAL WEIGHT = 3 X 21 = 62 lb

**LUMBER**

N. L. G. A. RULES

CHORDS	SIZE	DRY	LUMBER No.2	DESCR. SPF
A - C	2x6	DRY	No.2	SPF
B - D	2x4	DRY	No.2	SPF

DRY: SEASONED LUMBER.

**PLATES (table is in inches)**

JT TYPE	PLATES	W	LEN	Y	X
B TMBH1-I	MT20	5.0	6.0	2.50	0.75
B TP+p	MT20	3.0	4.0	3.25	2.50

**NOTES-** (1)  
1) Lateral braces to be a minimum of 2X4 SPF #2.

**DIMENSIONS, SUPPORTS AND LOADINGS SPECIFIED BY FABRICATOR TO BE VERIFIED BY BUILDING DESIGNER**

**BEARINGS**

JT	FACTORED GROSS REACTION VERT	FACTORED GROSS REACTION HORZ	MAXIMUM FACTORED GROSS REACTION DOWN	MAXIMUM FACTORED GROSS REACTION HORZ	INPUT BRG IN-SX	REGRD BRG IN-SX	HEEL WEDGE
C	245	0	245	0	1-8	1-8	
B	472	0	472	0	4-0	4-0	2x4 L
D	55	0	55	0	5-0	5-0	

SEE MITEK STANDARD DETAIL MSD2015-H FOR CONNECTION TO JOINT(S) C

**UNFACTORED REACTIONS**

JT	1ST LCASE COMBINED	MAX /MIN SNOW	MAX /MIN LIVE	MAX /MIN PERM.LIVE	MAX /MIN WIND	MAX /MIN DEAD	MAX /MIN SOIL
C	170	130/0	0/0	0/0	0/0	40/0	0/0
B	330	238/0	0/0	0/0	0/0	92/0	0/0
D	42	11/0	0/0	0/0	0/0	31/0	0/0

BEARING MATERIAL TO BE SPF NO.2 OR BETTER AT JOINT(S) B, D

**BRACING**  
TOP CHORD TO BE SHEATHED OR MAX. PURLIN SPACING = 6.25 FT.  
MAX. UNBRACED BOTTOM CHORD LENGTH = 10.00 FT OR RIGID CEILING DIRECTLY APPLIED.

ALL PITCH BREAKS AND PERIMETER CORNER JOINTS MUST BE Laterally RESTRAINED.

**LOADING**  
TOTAL LOAD CASES: (5)

MEMB.	C H O R D S				W E B S			
	MAX. FACTORED FORCE (LBS)	FACTORED VERT. LOAD (PLF)	FACTORED LC1 MAX (LC)	FACTORED UNBRAC LENGTH	MEMB. FR-TO	MAX. FACTORED FORCE (LBS)	FACTORED LC1 MAX (LC)	FACTORED UNBRAC LENGTH
A-B	0/28	-95.2	-95.2	0.12 (5)	10.00	E-F	-32/61	0.00 (1)
B-F	-84/0	-95.2	-95.2	0.12 (1)	6.25			
F-C	0/16	-95.2	-95.2	0.21 (1)	10.00			
B-E	0/0	-18.5	-18.5	0.09 (1)	10.00			
E-D	0/0	-18.5	-18.5	0.11 (1)	10.00			

CANTILEVER ANALYSIS HAS BEEN CONSIDERED IN THIS DESIGN

**DESIGN CRITERIA**

**SPECIFIED LOADS:**  
TOP CH. LL = 26.7 PSF  
DL = 6.0 PSF  
BOT CH. LL = 0.0 PSF  
DL = 7.4 PSF  
TOTAL LOAD = 40.1 PSF

**SPACING = 24.0 IN./C/C**

THIS TRUSS IS DESIGNED FOR RESIDENTIAL OR SMALL BUILDING REQUIREMENTS OF PART 9, NBCC 2015

THIS DESIGN COMPLIES WITH:  
- PART 9 OF BCBC 2018, ABC 2019  
- PART 9 OF OBC 2012 (2019 AMENDMENT)  
- CSA 086-14  
- TPIC 2014

(55% OF 33.4 P.S.F. G.S.L. PLUS 8.4 P.S.F. RAIN LOAD) EQUALS 26.7 P.S.F. SPECIFIED ROOF LIVE LOAD

ALLOWABLE DEFL.(LL) = L/360 (0.19")  
CALCULATED VERT. DEFL.(LL) = L/999 (0.02")  
ALLOWABLE DEFL.(TL) = L/360 (0.19")  
CALCULATED VERT. DEFL.(TL) = L/999 (0.05")

CSI: TC=0.21/1.00 (C-F:1), BC=0.11/1.00 (D-E:1), WB=0.00/1.00 (E-F:1), SSI=0.14/1.00 (C-F:1)

DOL LUMBER=1.00 NAIL=1.00 LS BEND=1.10 COMP=1.10 SHEAR=1.10 TENS= 1.10

COMPANION LIVE LOAD FACTOR = 1.00

TRUSS PLATE MANUFACTURER IS NOT RESPONSIBLE FOR QUALITY CONTROL IN THE TRUSS MANUFACTURING PLANT.

**NAIL VALUES**

PLATE	GRIP(DRY) (PSI)		SHEAR (PLI)		SECTION (PLI)	
	MAX	MIN	MAX	MIN	MAX	MIN
MT20	650	371	1747	788	1987	1873

PLATE PLACEMENT TOL. = 0.250 inches

PLATE ROTATION TOL. = 5.0 Deg.

JSI GRIP= 0.18 (B) (INPUT = 0.90)  
JSI METAL= 0.04 (B) (INPUT = 1.00)



STRUCTURAL COMPONENT ONLY  
DWG # TR22080097

# EWP DESIGN INC.

(905) 832-2250

FAX (905) 832-0286

## RESPONSIBILITIES AND SPECIFICATIONS

### RESPONSIBILITIES

1. EWP DESIGN INC. is responsible for the design of trusses as individual components.
2. It is the responsibility of others to ascertain that the design loads utilized on each drawing meet or exceed the actual dead load imposed by the structure, the live load imposed by the intended use and the snow load imposed by local building code or authorities with jurisdictions.
3. All dimensions are to be verified by the owner, contractor, architect or other authorities with jurisdictions before truss fabrication.
4. EWP DESIGN INC. bears no responsibility for the erection of trusses. Persons erecting trusses are cautioned to seek professional advice regarding the temporary and permanent bracing for the system. Bracing shown on EWP DESIGN INC. drawing is specified for the truss as a component only and forms an integral part of the truss design.
5. It is the truss manufacturer's responsibility to ensure that trusses are manufactured in conformance with specifications of EWP DESIGN INC. as outlined below.

### SPECIFICATIONS

1. Trusses designed by EWP DESIGN INC. conform to the relevant section of the Ontario Building Code of Canada (Part 9 or Part 4) or to the Canadian code for farm buildings, whichever applies to the building type, as indicated on the EWP DESIGN INC. drawings, and conform to the design procedures established by the Truss Plate Institute of Canada. Unit stresses used for truss designs are as per the edition of CSA-O86 shown on EWP DESIGN INC. drawings.
2. Lumber is to be the size, species and grade as specified on EWP DESIGN INC. drawings.
3. Moisture content of lumber shall not exceed 19% in service unless specified otherwise.
4. Metal connector plates shall be applied to both faces of truss at each joint and shall be positioned as specified.
5. Top chords of trusses are assumed to be continuously braced laterally by roof sheathing or by purlins at intervals not exceeding 12.5 times the thickness of top chord member.
6. Bottom chords shall be laterally braced at intervals not exceeding 3M (10') o.c., where rigid ceiling is not applied directly to the underside of chords.

THESE DRAWINGS CONSTITUTE THE PROPERTY OF EWP DESIGN INC., SHALL NOT BE REPRODUCED, PUBLISHED, OR REDISTRIBUTED IN ANY MANNER OR UTILIZED FOR ANY PURPOSE OTHER THAN THE MANUFACTURE OF TRUSSES BY THE ALPA LUMBER GROUP, AND WILL BE RETRACTED BY EWP DESIGN INC. IF UTILIZED FOR ANY OTHER PURPOSE.

February 1, 2019

### TOE-NAIL CAPACITY DETAILS

#### LATERAL AND WITHDRAWAL RESISTANCE OF BEARING ANCHORAGE BY TOE-NAILS

			SPF	D. FIR	SPF	D. FIR
COMMON WIRE	3.00	0.144	122	139	30	42
	3.25	0.144	127	144	32	45
	3.50	0.160	152	173	38	52
COMMON SPIRAL	3.00	0.122	96	108	26	36
	3.25	0.122	97	108	28	40
	3.50	0.152	142	161	36	50
3.25" Gun nail	3.25	0.120	94	105	28	39

Note: If using truss with D. Fir lumber and SPF bearing plate, use tabulated SPF values in table.

Nail type:	Common wire	Common spiral	Common wire	Common spiral	Gun Nail
Diameter (in.)	0.160	0.152	0.144	0.122	0.120
Length (in.)	3.50	3.50	3.00	3.00	3.25
<b>2x4 SPF</b>	2	2	3	3	3
<b>2x6 SPF</b>	4	4	4	5	5
<b>2x4 D. FIR</b>	2	2	2	2	2
<b>2x6 D. FIR</b>	3	3	3	4	4



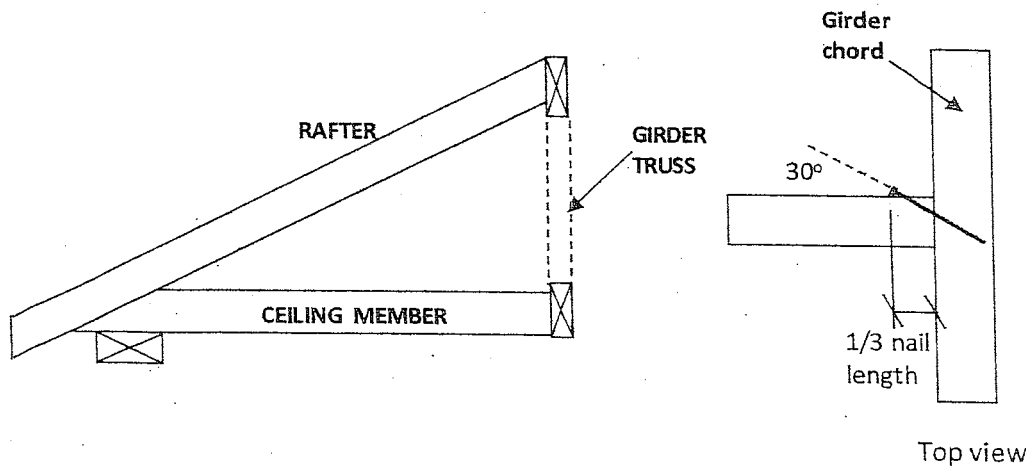


Figure 1: Toe-Nailing Rafter / Ceiling Member to Girder Truss

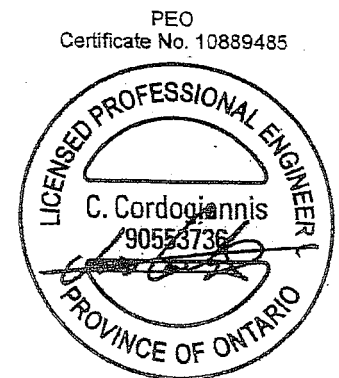

### TOE-NAIL CAPACITY DETAILS


Figure 2: Toe-Nail Anchorage to Bearing Plate for Uplift

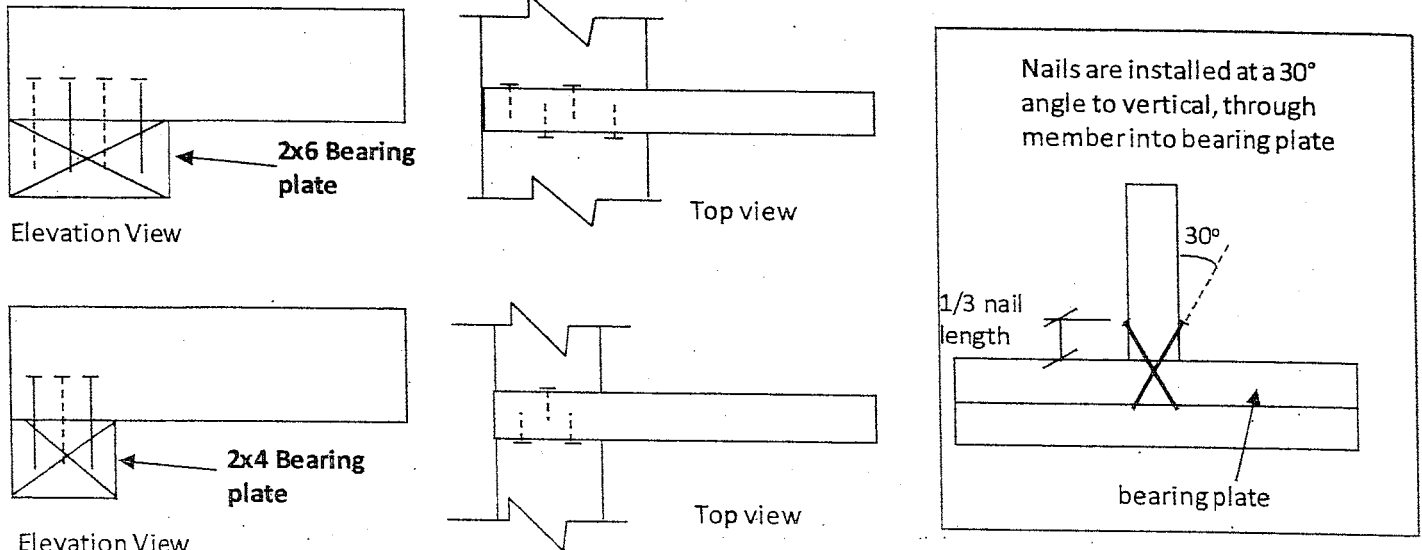

#### NOTES:

1. Rafter and ceiling members may be connected to top and bottom chords of girder truss by toe-nailing the members into the girder chords (see fig. 1), provided the factored vertical reactions of the supported members do not exceed the lateral resistance of the toe-nails. Mechanical connectors (hangers) are required if factored vertical reactions exceed the toe-nail capacity, or if the connection must resist horizontal loads (loads perpendicular to the face of girder or rafter).
2. Trusses, rafters or ceiling members may be anchored to the bearing plate with toe-nails (see fig. 2), provided that the factored uplift reactions due to **wind or earthquake loads** do not exceed the **withdrawal resistance of the toe-nails**. Mechanical anchors (tie-downs) are required for reactions that exceed the toe-nail withdrawal capacity. Toe-nail anchorage to bearing plates is **NOT** permitted if uplift reactions are generated from gravity loads (snow, floor live, dead).
3. Tabulated toe-nail resistances on page 1 are for **one** toe-nail. Multiply unit values by the number of nails used in the connection. Maximum number of nails in a connection shall not exceed the tabulated limits shown on page 1 for a given lumber size /species.
4. Nail values are based on specific gravity of  $G = 0.42$  (SPF) and  $G = 0.49$  (D. Fir).
5. Toe-nails shall be driven at approximately  $1/3$  the nail length from the edge of the joist/truss chord and driven at an angle of  $30^\circ$  to the grain of the member.
6. For wind / earthquake loads, tabulated lateral resistances may be multiplied by 1.15 ( $K_D$  factor). No increases are permitted for tabulated withdrawal resistances.
7. Lumber must be dry ( $< 19\%$  moisture content) at the time of nail installation.
8. Nail values in this table comply with CSA O86-19, Clause 12.9.

PEO  
Certificate No. 10889485

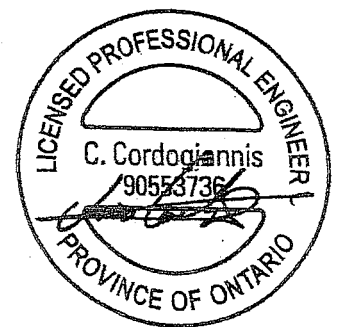



# LUL/LUS/LJS/HUS/HHUS/HGUS

## Standard and Double-Shear Joist Hangers



This product is preferable to similar connectors because of a) easier installation, b) higher capacities, c) lower installed cost, or a combination of these features.

Most hangers in this series have double-shear nailing — an innovation that distributes the load through two points on each joist nail for greater strength. This allows for fewer nails, faster installation, and the use of all common nails for the same connection. (Do not bend or remove tabs)

Double-shear hangers range from the light capacity LJS hangers to the highest capacity HGUS hangers. For medium load truss applications, the HUS offers a lower cost alternative and easier installation than the HGUS hangers, while providing greater load capacity and bearing than the LUS.

**Material:** See table on pp. 217–218.


**Finish:** Galvanized. Some products available in stainless steel or ZMAX® coating; see Corrosion Information, pp. 18–20.

**Installation:**


- Use all specified fasteners; see General Notes.
- Nails must be driven at an angle through the joist or truss into the header to achieve the tabulated resistances (except LUL).
- Where 16d commons are specified, 10d commons may be used at 0.83 of the tabulated factored resistance.
- Not designed for welded or nailer applications.
- With single ply 2x carrying members, use 10d x 1 1/2" nails into the header and 10d commons into the joist, and reduce the resistance to 0.64 of the table value where 16d nails are specified and 0.77 where 10d nails are specified.

**Options:**


- LUS, LJS, LUL and HUS hangers cannot be modified.
- Other sizes available; consult your Simpson Strong-Tie representative.
- See Hanger Options information on pp. 105–107.

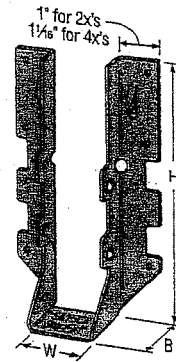


**LUS28**

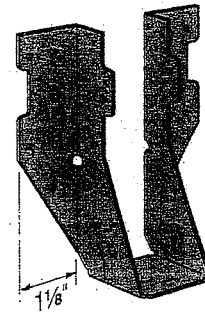


**LU26L**

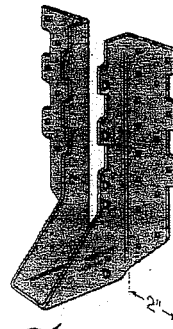


**HUS210**  
(HUS26, HUS28, and HHUS similar)

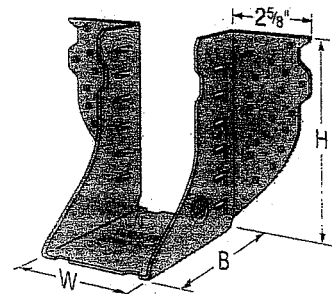


**HGUS28-2**

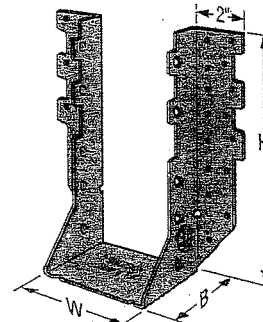

**HHUS210-2**

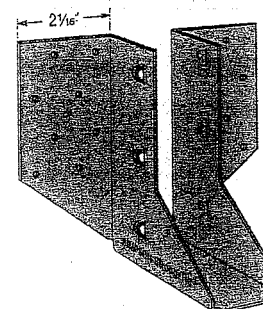

**LJS26DS**



Double-Shear Nailing Top View





Double-Shear Nailing Side View; Do not bend tab




Dome Double-Shear Nailing Side View (available on some models)

Typical HUS26 Installation with Reduced Heel Height  
(Truss Designer to provide fastener quantity for connecting multiple members together)

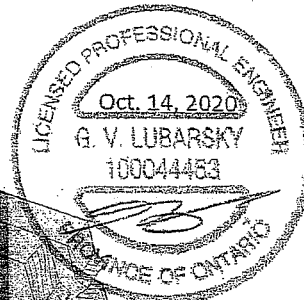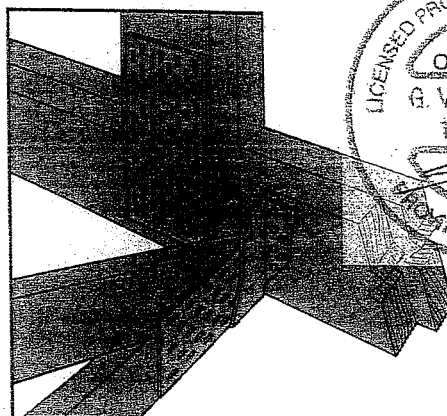

# LUS - Double Shear Joist Hangers



All LUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections.

**Material:** 18 gauge

**Finish:** G90 galvanized

**Design:**



- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

**Installation:**

- Use all specified fasteners.
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire, 10d = 0.148" x 3" long common wire.
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads.
- Not designed for welded or nailer applications.

**Options:**




- These hangers cannot be modified

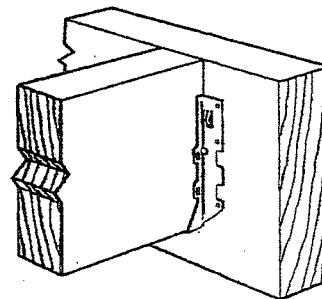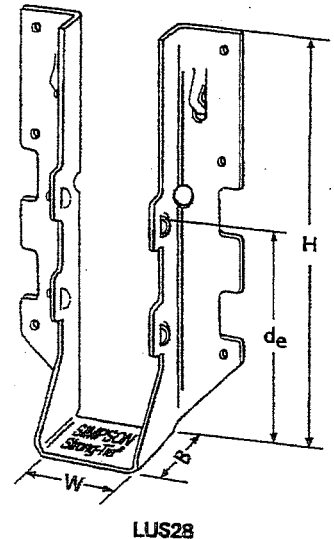

Typical LUS Installation

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d <sub>e</sub> <sup>1</sup>	Face	Joist	D.Fir-L		S-P-F	
								Uplift	Normal	Uplift	Normal
LUS24	18	1 9/16	3 3/8	1 3/4	1 7/16	(4) 10d	(2) 10d	(K <sub>p</sub> =1.15)	(K <sub>p</sub> =1.00)	(K <sub>p</sub> =1.15)	(K <sub>p</sub> =1.00)
LUS24-2	18	3 1/8	3 3/8	2	1 9/16	(4) 16d	(2) 16d	835	2020	645	1155
LUS26	18	1 9/16	4 3/4	1 3/4	3 3/8	(4) 10d	(4) 10d	1420	2170	1290	1630
LUS26-2	18	3 1/8	4 7/8	2	4	(4) 16d	(4) 16d	1720	2595	1545	1920
LUS26-3	18	4 3/8	4 9/16	2	3 1/4	(4) 16d	(4) 16d	1720	2595	1545	2340
LUS28	18	1 9/16	6 5/8	1 3/4	3 3/4	(6) 10d	(6) 10d	1420	2520	1290	1790
LUS28-2	18	3 1/8	7	2	4	(6) 16d	(4) 16d	1720	3325	1545	2575
LUS28-3	18	4 3/8	6 1/4	2	3 1/4	(6) 16d	(4) 16d	1720	3325	1545	2375
LUS210	18	1 9/16	7 13/16	1 3/4	3 3/8	(8) 10d	(4) 10d	1420	2785	1290	2210
LUS210-2	18	3 1/8	9	2	6	(8) 16d	(6) 16d	2580	4500	2320	3195
LUS210-3	18	4 3/8	8 3/16	2	5 1/4	(8) 16d	(6) 16d	2580	3345	2320	2375

1. d<sub>e</sub> is the distance from the seat of the hanger to the highest joist nail.

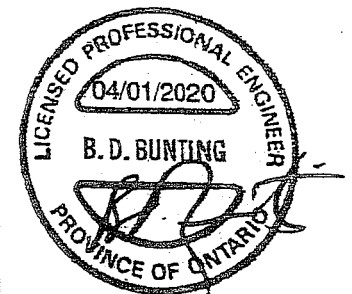

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see [strongtie.com](http://strongtie.com).  
 © 2020 Simpson Strong-Tie Company Inc. T-SPECLUS20 3/20 exp. 6/22

(800) 999-5099  
[strongtie.com](http://strongtie.com)

# HUS/LJS - Double Shear Joist Hangers



All hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

**Material:** See table

**Finish:** G90 galvanized

**Design:**


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

**Installation:**


- Use all specified fasteners
- Nails: 16d = 0.162" dia. x 3 1/2" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

**Options:**


- See current catalogue for options

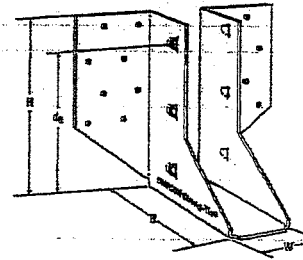


LJS26DS




HUS210  
(HUS26, HUS28, similar)



Typical LJS26DS Installation

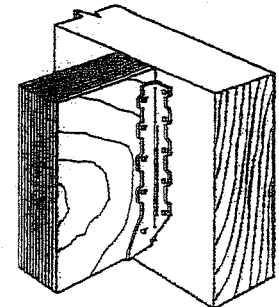


Typical HUS Installation

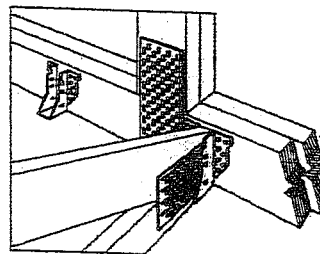

Typical HUS installation  
(Truss Designer to provide fastener quantity for connecting multiple members together)


Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d <sub>e</sub> <sup>1</sup>	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K <sub>u</sub> =1.15)	Normal (K <sub>u</sub> =1.00)	Uplift (K <sub>u</sub> =1.15)	Normal (K <sub>u</sub> =1.00)
LJS26DS	18	1 1/16	5	3 1/2	4 5/8	(16) 16d	(6) 16d	2055	4265	1460	4115
HUS26	16	1 1/8	5 1/8	3	3 15/16	(14) 16d	(6) 16d	2705	4940	2065	3875
HUS28	16	1 1/8	7 1/32	3	6 1/32	(22) 16d	(8) 16d	3605	5365	2675	4345
HUS210	16	1 1/8	9 1/32	3	7 1/32	(30) 16d	(10) 16d	4505	5795	4010	4740
HUS1.81/10	16	1 7/16	9	3	8	(30) 16d	(10) 16d	4505	6450	4010	5200

1. d<sub>e</sub> is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).


U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

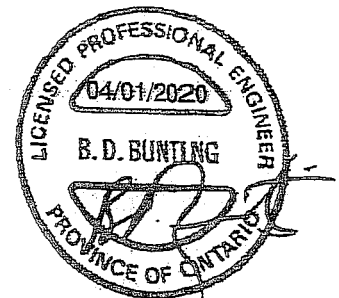


This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see [strongtie.com](http://strongtie.com).

© 2020 Simpson Strong-Tie Company Inc.

T-SPECHUS20 3/20 exp. 6/22

(800) 999-5099  
[strongtie.com](http://strongtie.com)

# HGUS – Double Shear Joist Hangers



All HGUS hangers have double shear nailing. This patented innovation distributes the load through two points on each joist nail for greater strength. It also allows the use of fewer nails, faster installation and the use of common nails for all connections. Do not bend or remove tabs.

**Material:** 12 gauge

**Finish:** G90 galvanized

**Design:**


- Factored resistances are in accordance with CSA O86-14.
- Uplift resistances have been increased 15%. No further increase is permitted.
- Wood shear is not considered in the factored resistances given. The specifier must ensure that the joist and header capacities are capable of withstanding these loads.

**Installation:**


- Use all specified fasteners
- Nails: 16d = 0.162" dia x 3½" long common wire
- Double shear nails must be driven at an angle through the joist or truss into the header to achieve the table loads
- Not designed for welded or nailer applications

**Options:**


- See current catalogue for options

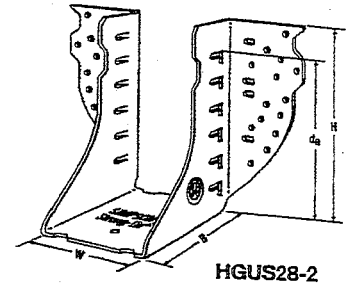

HGUS28-2

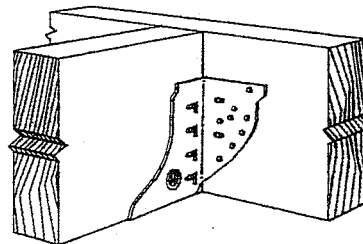


Typical HGUS Installation

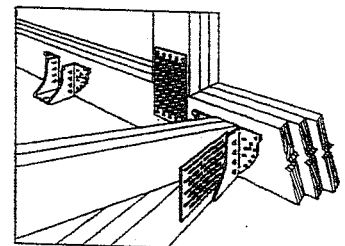


Typical HGUS Installation  
(Truss Designer to provide fastener quantity for connecting multiple members together)

Model No.	Ga.	Dimensions (in.)				Fasteners		Factored Resistance (lb.)			
		W	H	B	d <sub>0</sub> <sup>1</sup>	Face	Joist	D.Fir-L		S-P-F	
								Uplift (K <sub>p</sub> =1.15)	Normal (K <sub>p</sub> =1.00)	Uplift (K <sub>p</sub> =1.15)	Normal (K <sub>p</sub> =1.00)
HGUS26	12	1 1/8	5 3/8	5	4 3/8	(20) 16d	(8) 16d	2685	6625	2685	5700
HGUS26-2	12	3 1/8	5 7/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-3	12	4 1/8	5 1/2	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS26-4	12	6 1/8	5 7/8	4	4 1/8	(20) 16d	(8) 16d	4385	8950	3100	6355
HGUS28	12	1 1/8	7 1/8	5	6 1/8	(36) 16d	(12) 16d	3310	7675	3100	6900
HGUS28-2	12	3 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-3	12	4 1/8	7 1/8	4	6 3/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS28-4	12	6 1/8	7 1/8	4	6 1/8	(36) 16d	(12) 16d	6070	12980	4310	9215
HGUS210	12	1 1/8	9 1/8	5	7 1/8	(46) 16d	(16) 16d	3535	11070	2510	8090
HGUS210-2	12	3 1/8	9 3/8	4	8 1/8	(46) 16d	(16) 16d	6840	14015	4855	10270
HGUS210-3	12	4 1/8	9 1/8	4	8 3/8	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS210-4	12	6 1/8	9 3/8	4	8 1/8	(46) 16d	(16) 16d	6840	14645	4855	10400
HGUS212-4	12	6 1/8	10 3/8	4	10 1/8	(56) 16d	(20) 16d	7640	14995	5425	10645
HGUS214-4	12	6 1/8	12 3/8	4	11 1/8	(66) 16d	(22) 16d	10130	16400	7195	11645


1. d<sub>0</sub> is the distance from the seat of the hanger to the highest joist nail.




Dome Double Shear Nailing prevents tabs breaking off (available on some models).  
U.S. Patent 5,603,580



Double Shear Nailing Side View. Do not bend tab back.



Double Shear Nailing Top View.

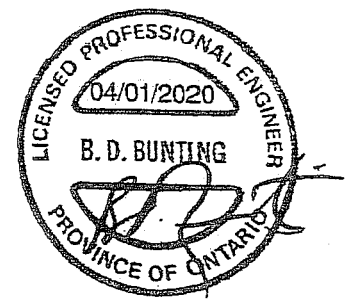

LIMIT STATES DESIGN

This technical bulletin is effective until June 30, 2022, and reflects information available as of April 1, 2020. This information is updated periodically and should not be relied upon after June 30, 2022. Contact Simpson Strong-Tie for current information and limited warranty or see [strongtie.com](http://strongtie.com).


© 2020 Simpson Strong-Tie Company Inc.

T-SPECHGUS20 3/20 exp. 6/22


(800) 999-5099  
[strongtie.com](http://strongtie.com)

# Symbols

## PLATE LOCATION AND ORIENTATION



Center plate on joint unless x, y offsets are indicated. Dimensions are in ft-in-sixteenths or mm. Apply plates to both sides of truss and fully embed teeth.



For 4 x 2 orientation, locate plates 0-1/16\" from outside edge of truss.



This symbol indicates the required direction of slots in connector plates.

\*Plate location details available in MiTek software or upon request.

## PLATE SIZE

4 X 4


The first dimension is the plate width measured perpendicular to slots. Second dimension is the length parallel to slots.

## LATERAL BRACING LOCATION



Indicated by symbol shown and/or by text in the bracing section of the output. Use T, I or Eliminator bracing if indicated.

## BEARING




Indicates location where bearings (supports) occur. Icons vary but reaction section indicates joint number where bearings occur.

## Industry Standards:

- TPIC: Truss Design Procedures and Specifications for Light Metal Plate Connected Wood Trusses  
 DSB-89: Design Standard for Bracing.  
 BCSI: Building Component Safety Information, Guide to Good Practice for Handling, Installing & Bracing of Metal Plate Connected Wood Trusses.

# Numbering System

6-4-8 dimensions shown in ft-in-sixteenths or mm (Drawings not to scale)

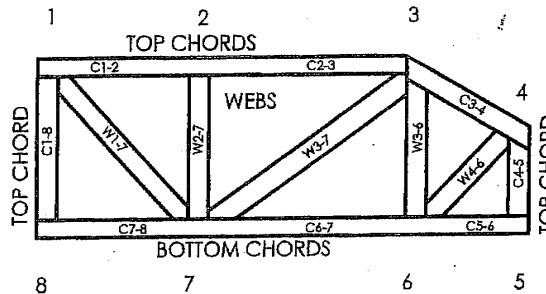

**JOINTS ARE GENERALLY NUMBERED/LETTERED CLOCKWISE AROUND THE TRUSS STARTING AT THE JOINT FARTHEST TO THE LEFT.**

**CHORDS AND WEBS ARE IDENTIFIED BY END JOINT NUMBERS/LETTERS.**

## PRODUCT CODE APPROVALS

CCMC Reports:

11996-L, 10319-L, 13270-L, 12691-R

© 2007 MiTek® All Rights Reserved

**MiTek**  
 POWER TO PERFORM.™

MiTek Engineering Reference Sheet: MII-7473C rev. 10-'08

# General Safety Notes

Failure to Follow Could Cause Property Damage or Personal Injury

1. Additional stability bracing for truss system, e.g. diagonal or X-bracing, is always required. See BCSI.
2. Truss bracing must be designed by an engineer. For wide truss spacing, individual lateral braces themselves may require bracing, or alternative T, I, or Eliminator bracing should be considered.
3. Never exceed the design loading shown and never stack materials on inadequately braced trusses.
4. Provide copies of this truss design to the building designer, erection supervisor, property owner and all other interested parties.
5. Cut members to bear tightly against each other.
6. Place plates on each face of truss at each joint and embed fully. Knots and wane at joint locations are regulated by TPIC.
7. Design assumes trusses will be suitably protected from the environment in accord with TPIC.
8. Unless otherwise noted, moisture content of lumber shall not exceed 19% at time of fabrication.
9. Unless expressly noted, this design is not applicable for use with fire retardant, preservative treated, or green lumber.
10. Camber is a non-structural consideration and is the responsibility of truss fabricator. General practice is to camber for dead load deflection.
11. Plate type, size, orientation and location dimensions indicated are minimum plating requirements.
12. Lumber used shall be of the species and size, and in all respects, equal to or better than that specified.
13. Top chords must be sheathed or purlins provided at spacing indicated on design.
14. Bottom chords require lateral bracing at 10 ft. spacing, or less, if no ceiling is installed, unless otherwise noted.
15. Connections not shown are the responsibility of others.
16. Do not cut or alter truss member or plate without prior approval of an engineer.
17. Install and load vertically unless indicated otherwise.
18. Use of green or treated lumber may pose unacceptable environmental, health or performance risks. Consult with project engineer before use.
19. Review all portions of this design (front, back, words and pictures) before use. Reviewing pictures alone is not sufficient.
20. Design assumes manufacture in accordance with TPIC Quality Criteria.